


# PRELIMINARY/FINAL DRAINAGE REPORT

FOR

## SOUTH ACADEMY BUSINESS CENTER

Prepared For:  
10230 Hall Boulevard, LLC  
PO Box 38014  
Colorado Springs, CO 80937

Prepared By:  
Associated Design Professionals, Inc.  
3520 Austin Bluffs Parkway, Suite 102  
Colorado Springs, CO 80918  
(719) 266-5212  
Project No. 161103  
2/27/18  
PCD Project No 17-004

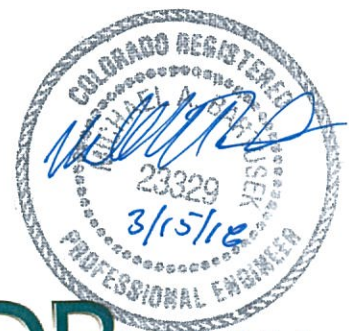


**ADPCIVIL**  
ENGINEERING FOR THE FUTURE



**ENGINEER'S STATEMENT:**

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the city/county for drainage reports, and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

  
Michael A. Bartusek, P.E. #23329

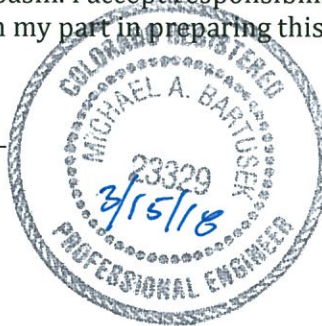

**DEVELOPER'S STATEMENT:**

I, the Developer, have read and will comply with all of the requirements specified in this drainage report and plan.

By:   
Mr Michael Turley

Title: Manager

Address: 10230 Hall Boulevard, LLC  
PO Box 38014  
Colorado Springs, CO 80937

**EL PASO COUNTY:**

Filed in accordance with the El Paso County Land Development Code; the Drainage Criteria Manual, Volumes 1 and 2; and the Engineering Criteria Manual, as amended.

\_\_\_\_\_  
Jennifer Irvine, P.E., County Engineer  
ECM Administrator  
Conditions:

\_\_\_\_\_  
Date



## PROJECT DESCRIPTION

This proposed project is contained within a new subdivision named the South Academy Business Center. This currently vacant lot consists of 7.60 acres. It is located in the Southeast Quarter of Section 3, Township 15 South, Range 66 West of the Sixth Principal Meridian, County of El Paso, State of Colorado. The site is located on a narrow strip of land which is bordered on the west by State Highway 85/87 and on the east by the Denver and Rio Grande Western Railroad. Its northern boundary is situated on the south boundary line of the South Academy Boulevard right-of-way.

## FLOODPLAIN STATEMENT

This site does not lie within a designated 100-year floodplain as delineated on LOMR No. 03-08-0318P, dated April 9, 2004. It is located within the West Little Johnson drainage basin. The drainage basin map shows a split in the property between the Little Johnson and West Little Johnson Basins. However, field verification revealed that all of the property was located within the West Little Johnson Basin.

## SOILS

The soils on the northern site are classified as Blakeland loamy sand by the USDA Soil Conservation Service. This soil is further classified as Hydrologic Soil Group "A". The soils on the proposed site are classified as Nunn clay loam by the USDA Soil Conservation Service. This soil is further classified as Hydrologic Soil Group "C".

## METHOD OF COMPUTATION

The methodology utilized for this report is in accordance with *City/County Drainage Criteria Manual*. The Rational Method for computation of runoff was used for determining on-site flows.

$Q = CIA$

Where

- Q = maximum rate of runoff in cubic feet per second
- c = runoff coefficient representing drainage area characteristics
- i = average rainfall intensity, in inches per hour, for the duration required for the runoff to become established
- a = drainage basin size in acres

Off-site flows were determined using the TR20 hydrologic program for project hydrology by the Soil Conservation Service.

## EXISTING DRAINAGE CHARACTERISTICS

This previously unplatted site was included in the *Little Johnson/West Little Johnson Drainage Basin Planning Study* prepared by Simons, Li & Associates in 1987. Much of the land north of the proposed project lies within either the Rocky Mountain Materials property or the Stephen Schnurr Living Trust. The Rocky Mountain property encompasses approximately 42 acres of the 54.5-acre basin. The Stephen Schnurr Living Trust owns the 4.6 acres just north of the site. Flows from these properties are released at historic levels onto the site to its south. This vacant land is just north of the proposed project and is covered with rangeland grasses. The tributary area slopes generally southwest at an average slope of one percent. The existing runoff is contained within a broad drainage swale located near the existing railroad tracks.



According to the analysis performed by Simons, Li & Associates, the runoff produced by the entire drainage basin along SH 85/87 would result in no flow for the ten-year storm event and one cfs for the 100-year storm event. The low runoff amounts were due to the Type "A" soils and the long overland flow times. These off-site flows travel to the southeast and are currently directed toward the railroad ditch east of the parcel and do not enter the parcel.

An analysis of the South Academy Business Center site using the Rational Method produced the following flow rates: Sub-Basin A, which drains toward the interior of the parcel and produces 1.6 cfs for the five-year storm and 9.2 cfs for the 100-year storm; Sub-Basin B, which drains to a ditch along SH 85/87 produces a flow of 0.4 cfs for the five-year storm and 2.1 cfs for the 100-year storm. The total flow tributary to the site is 1.9 cfs for the five-year storm and 11.1 cfs for the 100-year storm.

**DEVELOPED DRAINAGE CHARACTERISTICS**

The proposed development of 7.6 acres will be storage facility comprised of 8' x 40' trailers placed on the site with loose gravel placed over the site.

Runoff from Sub-Basin A will be directed in a southeasterly direction toward the south property line. Based on the proposed developed conditions, Sub-Basin A will produce flows of 4.7 cfs for the five-year storm and 14.3 cfs for the 100-year storm. The detained flows from the Water Quality/Detention Basin will be 1.0 cfs for the five-year storm and 5.0 cfs for the 100-year storm. These detained flows will be directed into an existing grass swale just east of the basin. The existing broad, grassed swale continues flowing to the east at a 0.7% slope with 10:1 side slopes. The 100 year outflow will produce a flow depth of 0.6 ft and a velocity of 1.5 fps.

Runoff from Sub-Basin B will increase slightly to 0.4 cfs for the five-year storm and 2.3 cfs for the 100-year storm. The total flow tributary to the site is 1.4 cfs for the five-year storm and 7.2 cfs for the 100-year storm.

**WATER QUALITY/DETENTION REQUIREMENTS**

In accordance with current NPDES, stormwater quality BMPs will be provided for this site when it is developed. Based on actual calculations, the commercial development of the site will produce an imperviousness of 48 percent. The water quality component is accomplished by a 2.42' deep 0.703 acre foot private extended detention facility located at the south end of the project. The facility will be maintained by the owner

**DRAINAGE BASIN FEE**

The proposed development is located within the West Little Johnson drainage basin. The 2017 drainage basin fee calculation is as follows:

Impervious Coverage	=	48%
Area Subject to Fee	=	0.48 x 7.6 acres = 3.648 acre
West Little Johnson Basin Fee	=	\$1,072/acre
Drainage Basin Fee	=	\$1,072 x 3.648 = \$3,911

There are no associated Bridge Fees for the West Little Johnson drainage basin.



**PRIVATE DRAINAGE FACILITIES**

Item	Unit	Quantity	Unit Cost	Total Cost
18" RCP FES	EA	1	\$500	\$ 600
18" HDPE	LF	15	\$84	\$ 1,260
Detention Outlet Structure	EA	1	\$3,000	\$ 5,000
Emergency Spillway	EA	1	\$1,000	\$ 1,500
			Sub-Total	\$8,360
			15% Contingency & Engineering	\$ 1,254
			<b>TOTAL</b>	<b>\$9,614</b>

**CONCLUSION**

Storm runoff from this property will not adversely affect downstream properties or facilities. Grading will take place on the property; therefore, appropriate erosion control measures will be implemented to will include a water quality basin. An on-site detention basin will be incorporated into the parcel to reduce developed flows to historic levels.

Step 1: Runoff has been reduced by disconnecting impervious areas where possible, eliminating "unnecessary" impervious areas and encouraging infiltration into suitable soils.

Step 2: All drainageways, ditches and channels have been stabilized by the following methods:

- New swales within the site are broad and covered with gravel and with a slope of about 0.7% no erosion will take place
- An existing roadside ditch will be enhanced as part of the proposed development.

Step 3: The proposed development will disturb approximately 7.6 acres.

Step 4: The development of this project will not affect sensitive waters.

The development of this site will have little impact on downstream properties once the water quality/detention basin is constructed.



**REFERENCES**

1. City of Colorado Springs and El Paso County (1994). *Drainage Criteria Manual Volume 1* (DCM).
2. City of Colorado Springs and El Paso County (1994). *Drainage Criteria Manual Volume II* (DCM).
3. Soil Survey of El Paso County Area, Colorado by USDA, NRCS.
4. *El Paso County (January 2006) Engineering Criteria Manual*.
5. Urban Drainage and Flood Control District (June 2011). *Urban Storm Drainage Criteria Manual, Volume 1-3*.

**PRELIMINARY/FINAL DRAINAGE REPORT  
SOUTH ACADEMY BUSINESS CENTER**

---

**APPENDIX A  
MAPS & EXHIBITS**

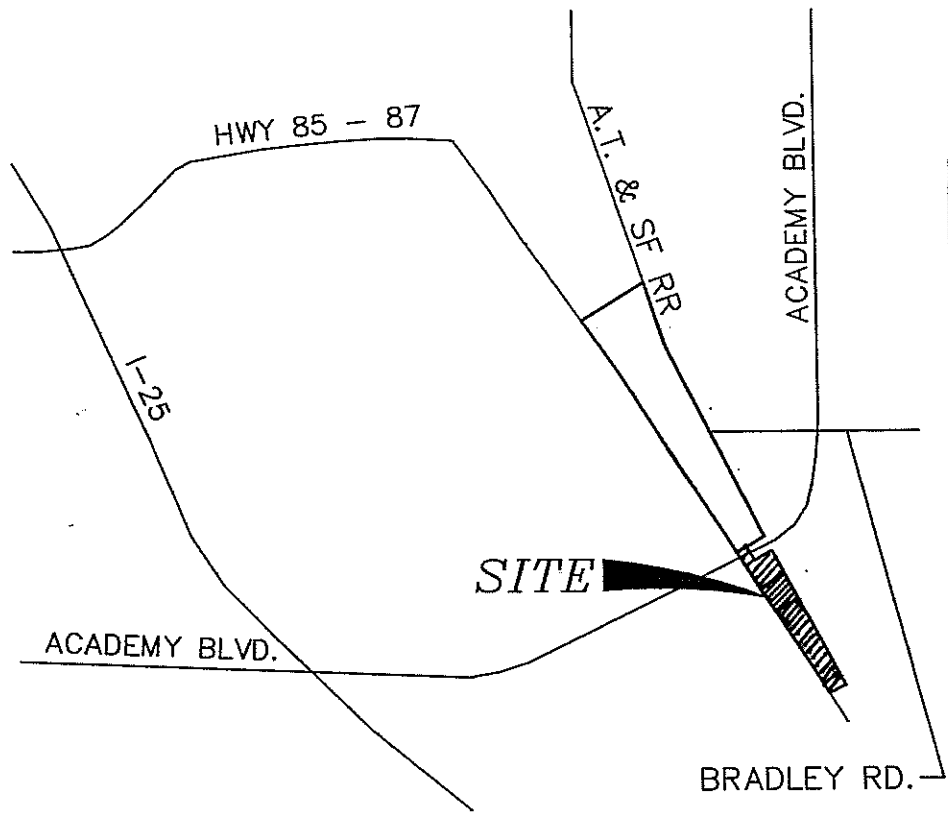

VICINITY MAP

N.T.S.

**ADP**CIVIL



ENGINEERING FOR THE FUTURE

3520 Austin Bluffs Pkwy, Suite 102

Colorado Springs, CO 80918

(719) 266-5212

fax: (719) 266-5341

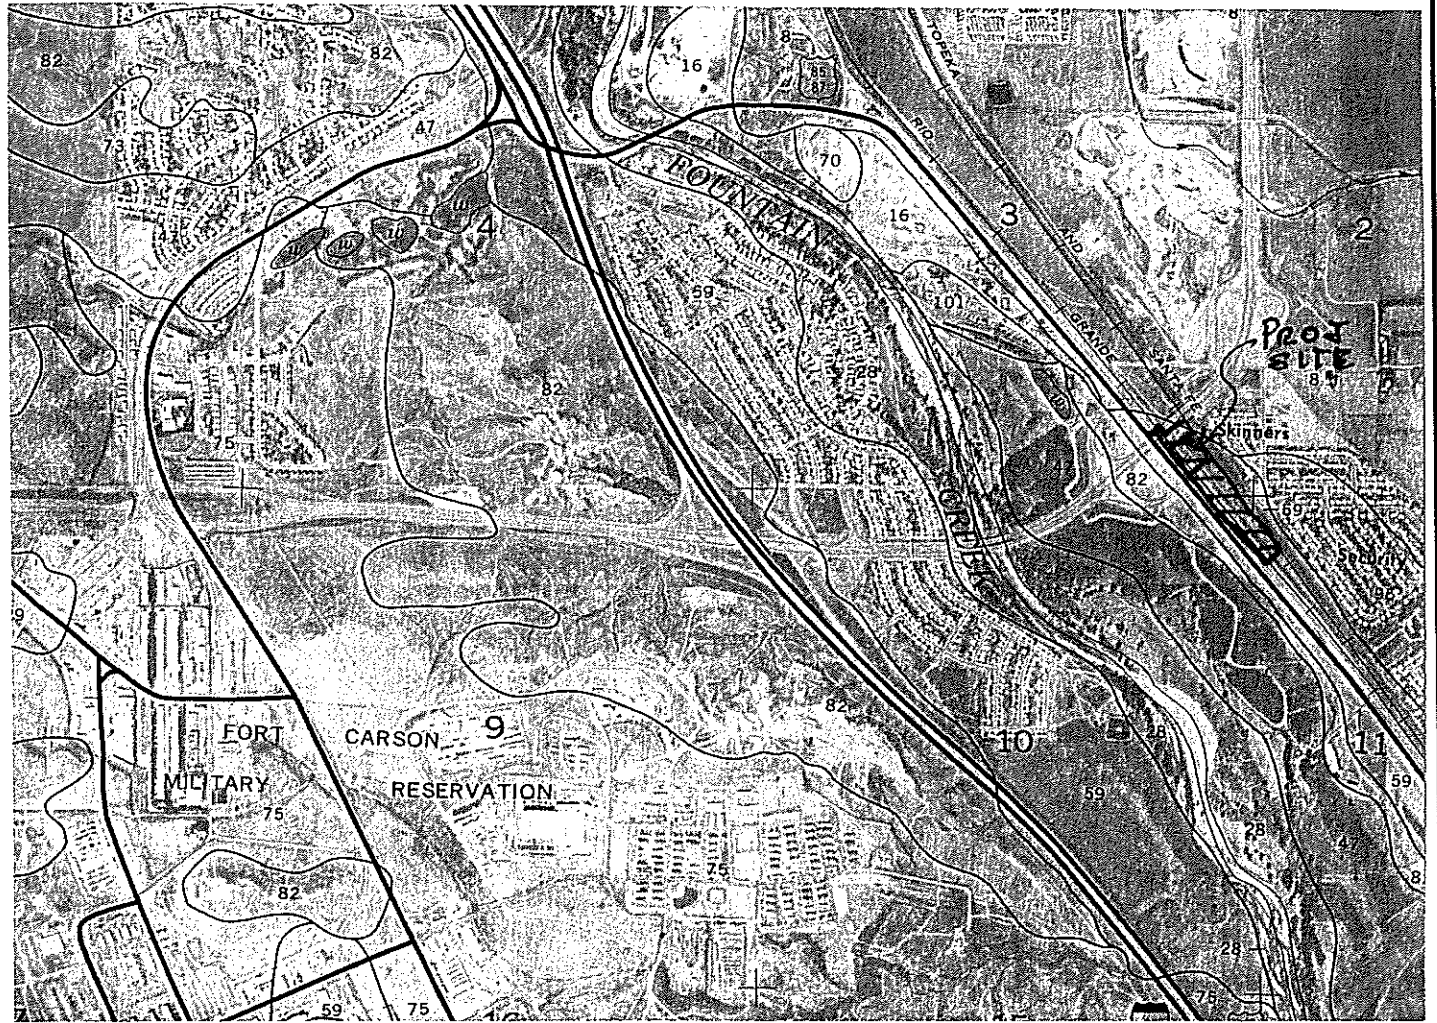


**SOILS MAP**  
N.T.S.


**ADP CIVIL**  
ENGINEERING FOR THE FUTURE

3520 Austin Bluffs Pkwy, Suite 102  
Colorado Springs, CO 80918  
(719) 266-5212  
fax: (719) 266-5341



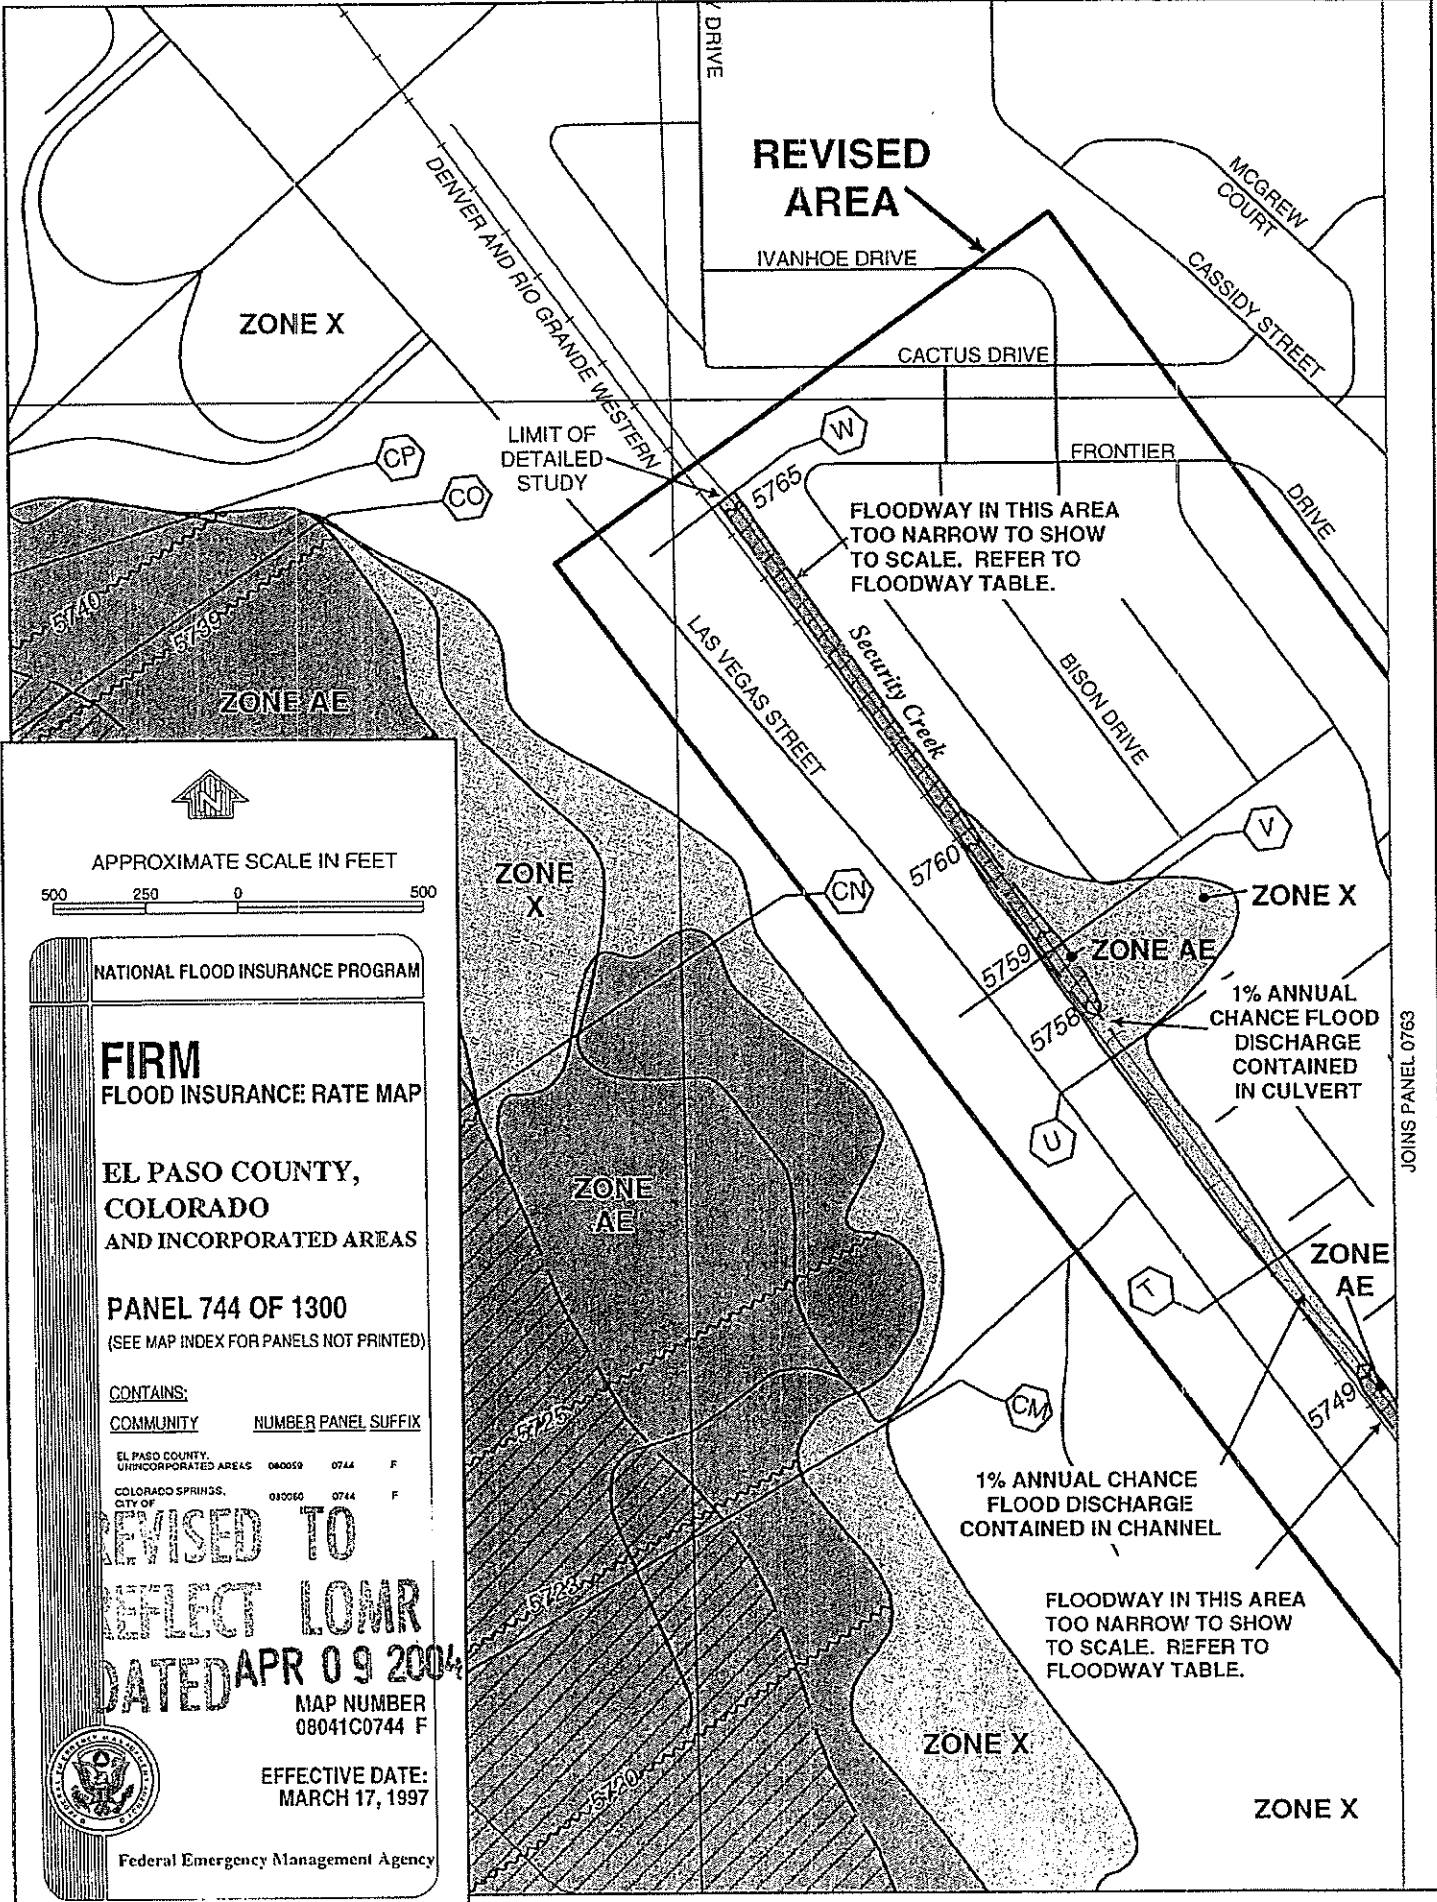

APPROXIMATE SCALE IN FEET



NATIONAL FLOOD INSURANCE PROGRAM

**FIRM**  
FLOOD INSURANCE RATE MAP

EL PASO COUNTY,  
COLORADO  
AND INCORPORATED AREAS

PANEL 744 OF 1300  
(SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:  
COMMUNITY NUMBER PANEL SUFFIX

EL PASO COUNTY, UNINCORPORATED AREAS	080059	0744	F
COLORADO SPRINGS, CITY OF	010060	0744	F

**REVISED TO  
REFLECT LOMR  
DATED APR 09 2004**

MAP NUMBER  
08041C0744 F

EFFECTIVE DATE:  
MARCH 17, 1997



Federal Emergency Management Agency

JOINS PANEL 0763

**PRELIMINARY/FINAL DRAINAGE REPORT  
SOUTH ACADEMY BUSINESS CENTER**

---

**APPENDIX B  
DRAINAGE CALCULATIONS**

SOUTH ACADEMY BUSINESS CENTER						
C FACTOR CALCULATION SHEET						
<b>RUNOFF COEFICIENT</b>						
<b>TYPE C SOILS</b>						
LAND USE			5 YR	100 YR		
UNDEV & LOOSE GRAVEL			0.15	0.5		
STREETS/PARKING GRAVEL			0.63	0.74		
ROOFS/ PAVED AREAS			0.75	0.83		
<b>Historic Conditions</b>						
	TOTAL	SURFACE CONDITION AREAS			CALCULATED C	
AREA	AREA	UNDEV	STREETS/ PARKING GRAVEL	ROOFS/ PAVED AREAS	5	100
DESIG.	(acre)				YR	YR
Aex	6.40	6.40			0.15	0.50
Bex	1.30	1.30			0.15	0.50
<b>RUNOFF COEFICIENT</b>						
<b>TYPE C SOILS</b>						
LAND USE			5 YR	100 YR		
UNDEV & LOOSE GRAVEL			0.15	0.5		
STREETS/PARKING GRAVEL			0.63	0.74		
ROOFS/ PAVED AREAS			0.75	0.83		
<b>Developed Conditions</b>						
	TOTAL	SURFACE CONDITION AREAS			CALCULATED C	
AREA	AREA	UNDEV	LOOSE GRAVEL	ROOFS/ PAVED AREAS	5	100
DESIG.	(acre)				YR	YR
A	7.30	1.80	2.90	2.60	0.36	0.62
B	0.30	0.30			0.15	0.50
<b>IMPERVIOUS</b>						
COVERAGE	ACREAGE	% IMP				
Undev	1.80	0	0			
Loose Grav	2.90	0.4	1.16			
Trailers	2.60	0.9	2.34			
	7.30		3.50			
		<b>TOTAL IMP</b>	<b>47.95%</b>			

SOUTH ACADEMY BUSINESS CENTER																				
DRAINAGE CALCULATION SHEET																				
file:lock - load dr																				
06/09/17 Rev 2/27/18																				
AREA	AREA (acre)	C5 (5 yr)	C100 (100 yr)	C5 X A	C100 X A	L (ft)	Initial Tci Slope (%)	ti (min)	L (ft)	Slope (%)	V (fps)	Tt (min)	TC (min)	I5 (in/hr)	I100 (in/hr)	Q5 (cfs)	Q100 (cfs)	AREA DESIG.		
CURRENT CONDITIONS																				
OS1	54.50																			
Aex	6.30	0.15	0.50	0.95	3.15	100	1.50	15.54	1900	0.70	0.90	35.19	50.73	1.67	2.91	1.58	9.18	Aex		
Bex	1.30	0.15	0.50	0.20	0.65	15	1.00	6.88	1900	0.70	0.90	35.19	42.07	1.88	3.29	0.37	2.14	Bex		
DP1	7.60			1.14	3.80								50.73	1.67	2.91	1.90	11.07	DP1		
DEVELOPED CONDITIONS																				
OS1	54.50																			
A	7.30	0.36	0.62	2.63	4.53	50	1.00	9.78	1900	0.70	0.90	35.19	44.97	1.80	3.15	4.74	14.26	A		
B	1.37	0.15	0.50	0.56	1.59	12	2.00	4.90	1900	0.70	0.90	35.19	40.08	1.94	3.39	0.40	2.32	B		
DP1	8.67			0.77	2.28								44.97	1.80	3.15	1.38	7.17	DP1		
DITCH CAPACITY CALCULATION SHEET																				
Swale Location	Q5 cfs	Q100 cfs	S %	B ft	Z	d 100 ft	V fps	Froude #	Riprap Size											
Outlet Swale	1.00	5.00	0.70	0.00	10:1	0.60	1.50	0.52												
Spillway	4.70	14.30	1.00	10.00	4:1	0.50	2.20	0.57	0.03											
FOREBAY CALCULATION SHEET																				
(Per Table EDB-4)																				
RELEASE RATE	OPENING	VOLUME	FOREBAY DEPTH	TRICKLE CHAN CAP																
2% 100 yr slm	Q = C x D <sup>0.92</sup>	2% WQCV	D = 6"	OUTLET Q = 0.28 cfs																
0.02 X 14.3 = 0.28 cfs	@W = 0.26'	0.02 X 0.122 ac ft = 0.002 ac ft		@d = 4", b = 1', s = 0.5%																
	Q = 0.28 cfs	0.002 ac ft x 43560 = 87.1 cf		MAX Q = 0.79 cfs																

Flows from this off-site are drain into the railroad ditch and by-pass the proposed development

Flows from this off-site are drain into the railroad ditch and by-pass the proposed development

$ti = (0.395 * (1.1 - C5) * L^{0.5}) / S^{0.33}$  (EQ 6-8)

V from Fig 6-25

Tt = LV/60


TC = tt + Tt

Use 6" Rock



**DETENTION BASIN STAGE-STORAGE TABLE BUILDER**

UD-Detention, Version 3.07 (February 2017)

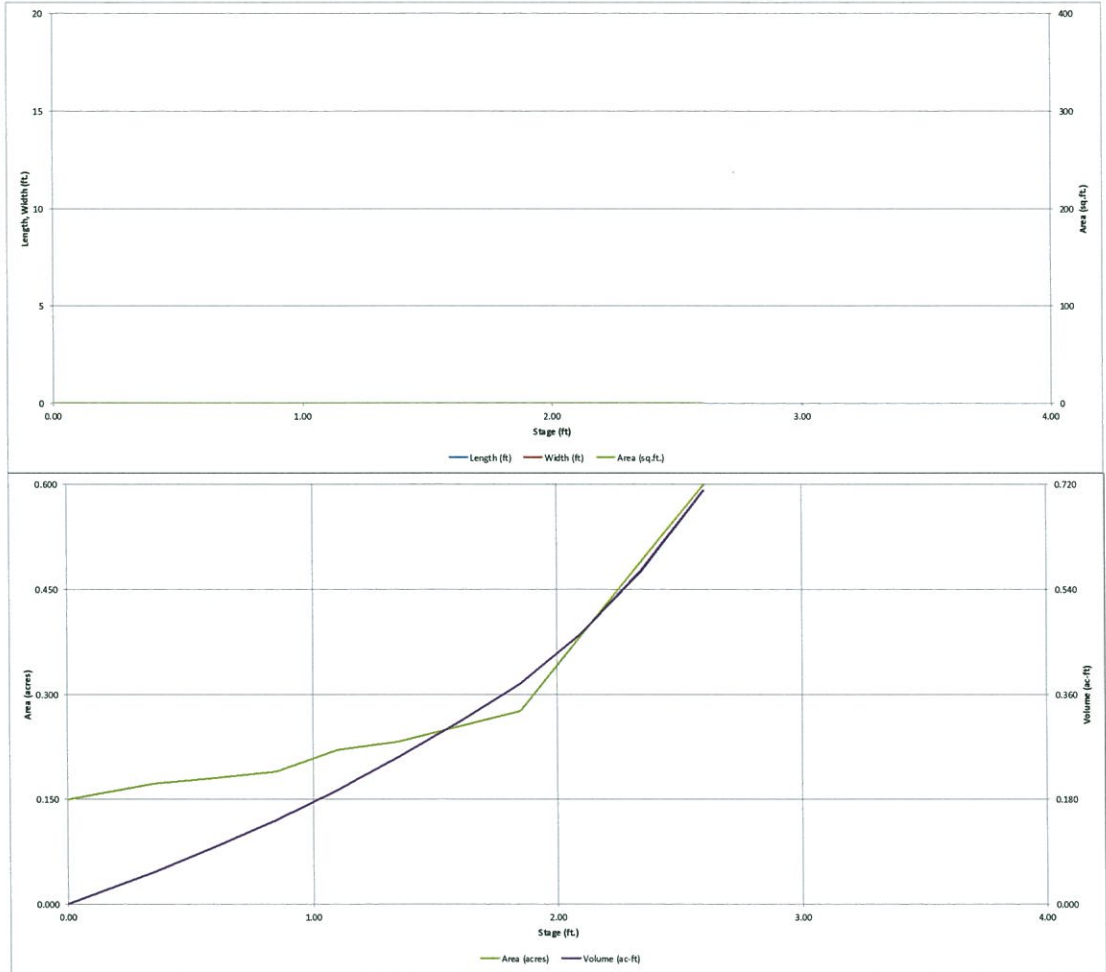




## Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: s Academy Business Ctr

Basin ID: A

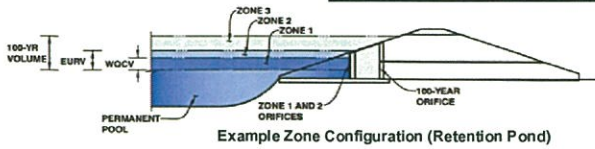

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	0.65	0.122	Orifice Plate
Zone 2 (EURV)	1.50	0.208	Orifice Plate
1 (100+1/2WQCV)	2.42	0.373	Weir & Pipe (Restrict)
		0.703	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
 Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain

Underdrain Orifice Area =  ft<sup>2</sup>  
 Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
 Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft)  
 Orifice Plate: Orifice Vertical Spacing =  inches  
 Orifice Plate: Orifice Area per Row =  sq. inches (diameter = 1-3/4 inches)

Calculated Parameters for Plate

WQ Orifice Area per Row =  ft<sup>2</sup>  
 Elliptical Half-Width =  feet  
 Elliptical Slot Centroid =  feet  
 Elliptical Slot Area =  ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.50	1.00					
Orifice Area (sq. inches)	2.45	2.45	2.45					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	inches

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected	
Vertical Orifice Area =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft <sup>2</sup>
Vertical Orifice Centroid =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	<input type="text" value="1.50"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	<input type="text" value="3.00"/>	<input type="text" value="N/A"/>	feet
Overflow Weir Slope =	<input type="text" value="0.00"/>	<input type="text" value="N/A"/>	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	<input type="text" value="3.00"/>	<input type="text" value="N/A"/>	feet
Overflow Grate Open Area % =	<input type="text" value="70%"/>	<input type="text" value="N/A"/>	%, grate open area/total area
Debris Clogging % =	<input type="text" value="50%"/>	<input type="text" value="N/A"/>	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H <sub>g</sub> =	<input type="text" value="1.50"/>	<input type="text" value="N/A"/>	feet
Over Flow Weir Slope Length =	<input type="text" value="3.00"/>	<input type="text" value="N/A"/>	feet
Grate Open Area / 100-yr Orifice Area =	<input type="text" value="6.93"/>	<input type="text" value="N/A"/>	should be ≥ 4
Overflow Grate Open Area w/o Debris =	<input type="text" value="6.30"/>	<input type="text" value="N/A"/>	ft <sup>2</sup>
Overflow Grate Open Area w/ Debris =	<input type="text" value="3.15"/>	<input type="text" value="N/A"/>	ft <sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	<input type="text" value="0.00"/>	<input type="text" value="N/A"/>	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	<input type="text" value="18.00"/>	<input type="text" value="N/A"/>	inches
Restrictor Plate Height Above Pipe Invert =	<input type="text" value="9.20"/>	<input type="text" value="N/A"/>	inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	<input type="text" value="0.91"/>	<input type="text" value="N/A"/>	ft <sup>2</sup>
Outlet Orifice Centroid =	<input type="text" value="0.44"/>	<input type="text" value="N/A"/>	feet
Half-Central Angle of Restrictor Plate on Pipe =	<input type="text" value="1.59"/>	<input type="text" value="N/A"/>	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	<input type="text" value="2.42"/>	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	<input type="text" value="8.00"/>	feet
Spillway End Slopes =	<input type="text" value="4.00"/>	H:V
Freeboard above Max Water Surface =	<input type="text" value="1.00"/>	feet

Calculated Parameters for Spillway




Spillway Design Flow Depth =	<input type="text" value="0.48"/>	feet
Stage at Top of Freeboard =	<input type="text" value="3.90"/>	feet
Basin Area at Top of Freeboard =	<input type="text" value="0.60"/>	acres

### Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.01
Calculated Runoff Volume (acre-ft) =	0.122	0.330	0.310	0.464	0.601	0.830	1.003	1.218	1.579
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.121	0.330	0.310	0.463	0.600	0.830	1.002	1.217	1.578
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.01	0.07	0.19	0.47	0.62	0.82	1.15
Predevelopment Peak Q (cfs) =	0.0	0.0	0.1	0.5	1.4	3.4	4.5	6.0	8.4
Peak Inflow Q (cfs) =	1.0	2.7	2.5	3.7	4.8	6.7	8.0	9.7	12.6
Peak Outflow Q (cfs) =	0.1	0.2	0.2	1.0	2.3	4.1	5.2	5.5	6.1
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	2.0	1.6	1.2	1.2	0.9	0.7
Structure Controlling Flow =	Plate	Plate	Plate	Overflow Grate 1	Overflow Grate 1	Overflow Grate 1	Outlet Plate 1	Outlet Plate 1	Outlet Plate 1
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	0.1	0.3	0.6	0.8	0.8	0.9
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	37	48	47	49	47	44	42	40	37
Time to Drain 99% of Inflow Volume (hours) =	40	53	52	55	54	52	51	50	49
Maximum Ponding Depth (ft) =	0.55	1.32	1.25	1.59	1.68	1.78	1.85	2.05	2.39
Area at Maximum Ponding Depth (acres) =	0.20	0.27	0.27	0.31	0.32	0.33	0.34	0.42	0.57
Maximum Volume Stored (acre-ft) =	0.102	0.278	0.262	0.359	0.388	0.417	0.444	0.516	0.690

# Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

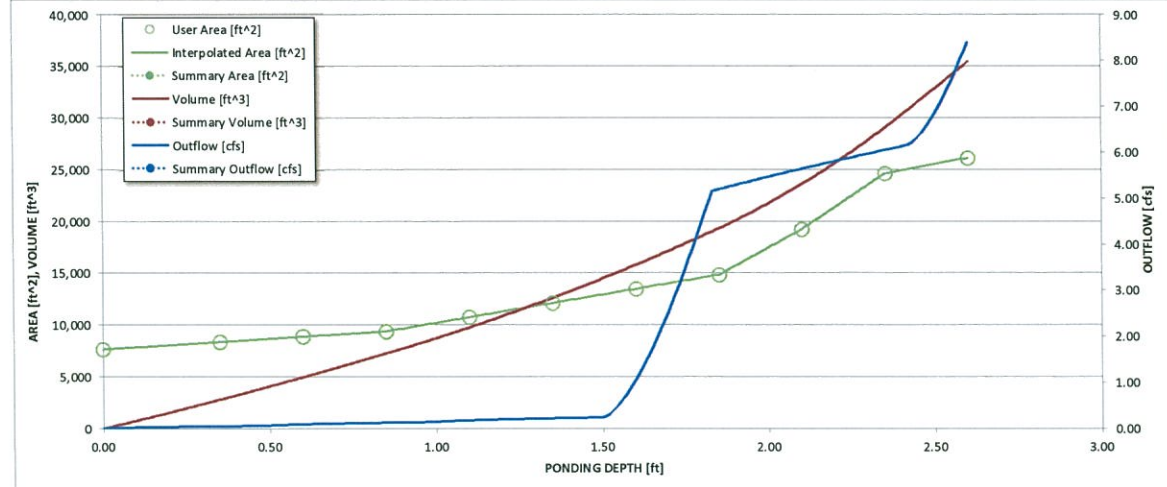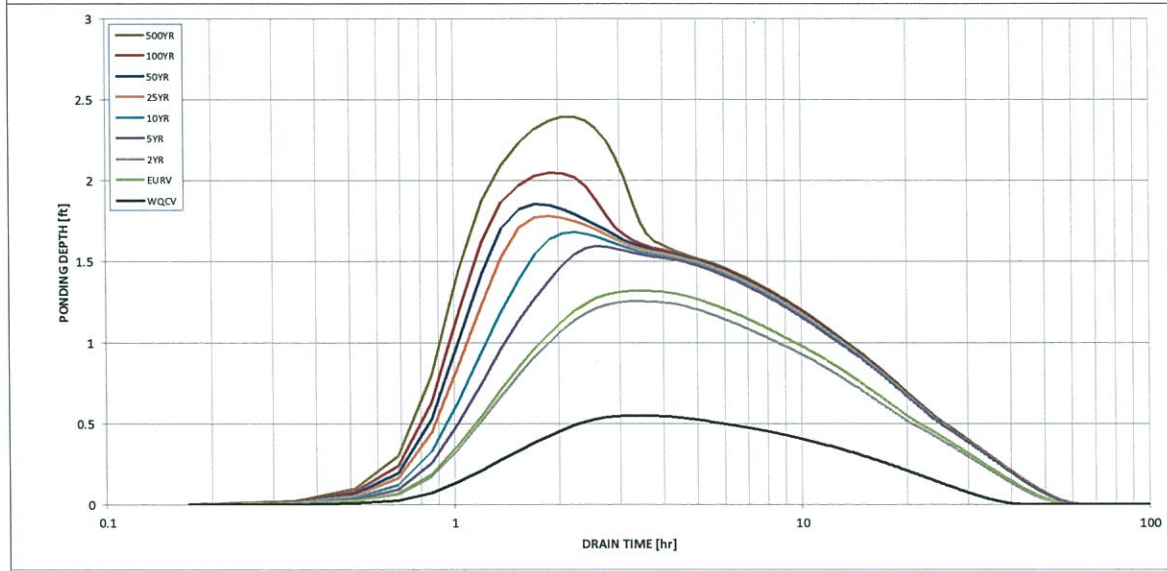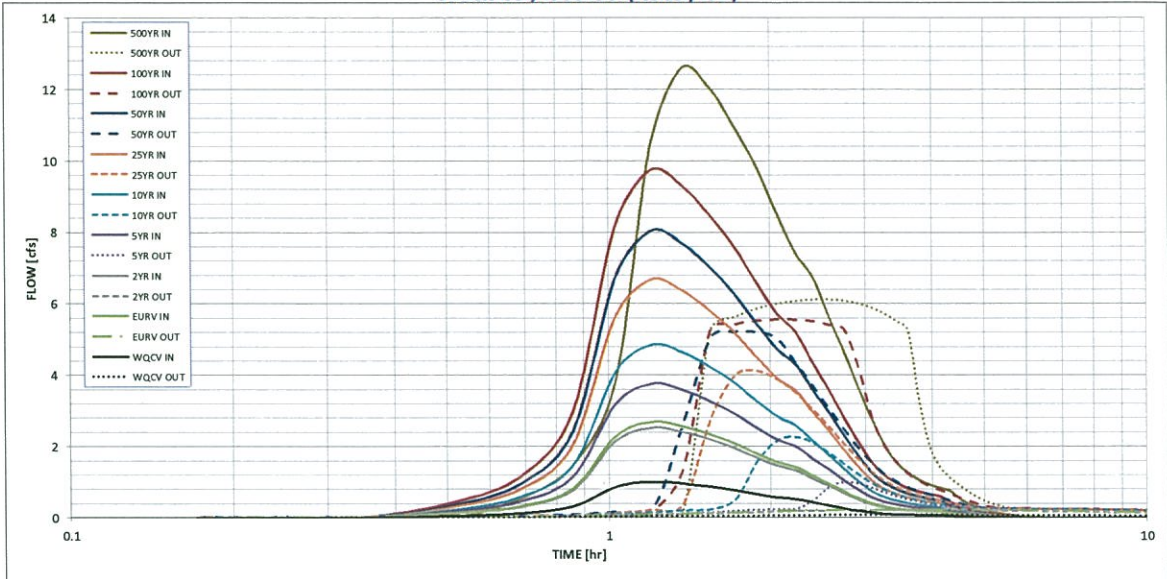

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			









**PRELIMINARY/FINAL DRAINAGE REPORT  
SOUTH ACADEMY BUSINESS CENTER**

---

**APPENDIX C  
DESIGN CHARTS**

Table 6-6. Runoff Coefficients for Rational Method  
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
<b>Business</b>													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
<b>Residential</b>													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
<b>Industrial</b>													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
<b>Parks and Cemeteries</b>	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
<b>Undeveloped Areas</b>													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
<b>Streets</b>													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
<b>Drive and Walks</b>	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
<b>Roofs</b>	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
<b>Lawns</b>	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

Figure 6-25. Estimate of Average Concentrated Shallow Flow


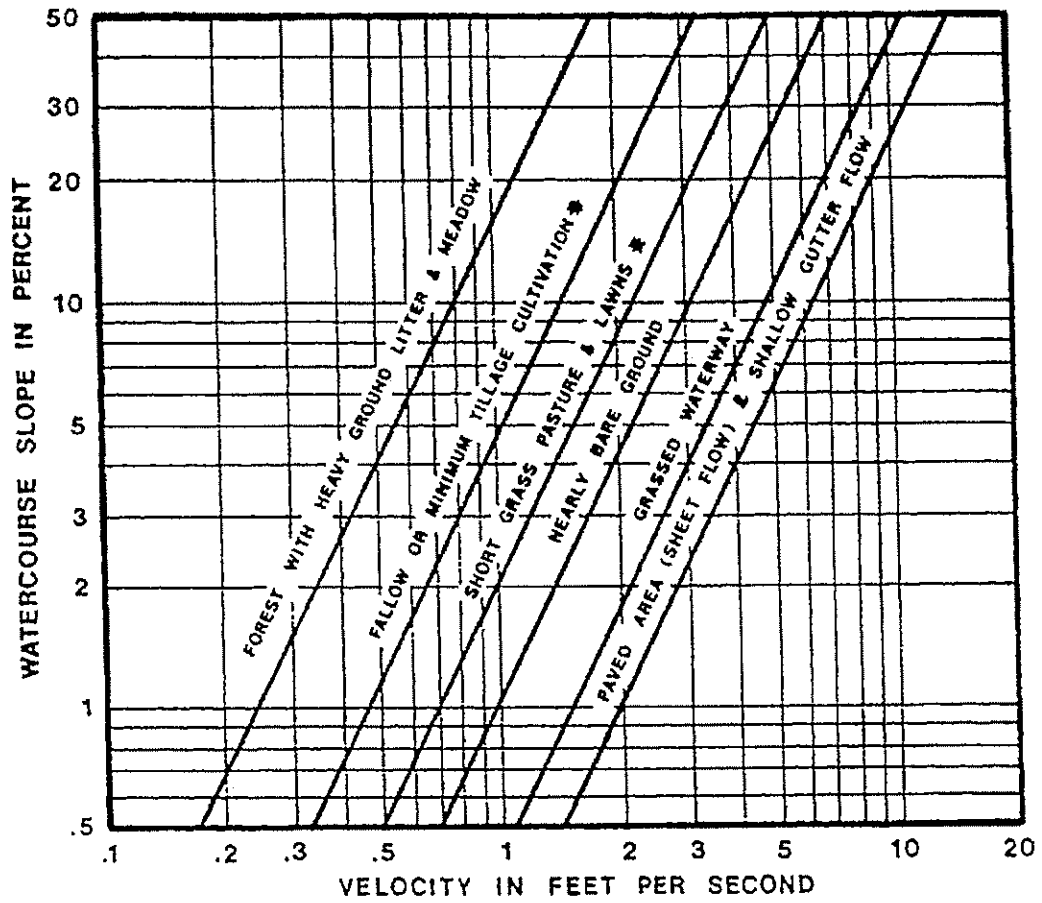


Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

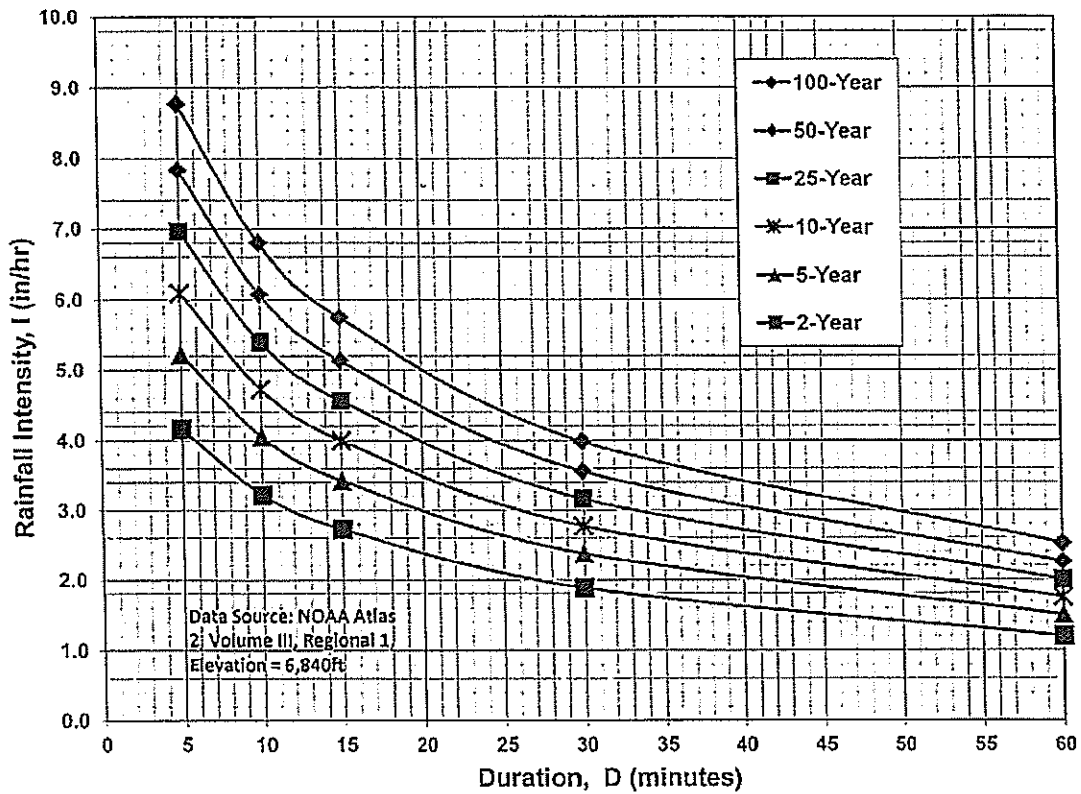

**IDF Equations**

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$

$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$


$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.





MSL:LAND PRODUCTS 2018\161103-5 - Academy Business Ctr\DWG\161103-Drainage.dwg Date: Thu, 02/27/18 1:33 PM

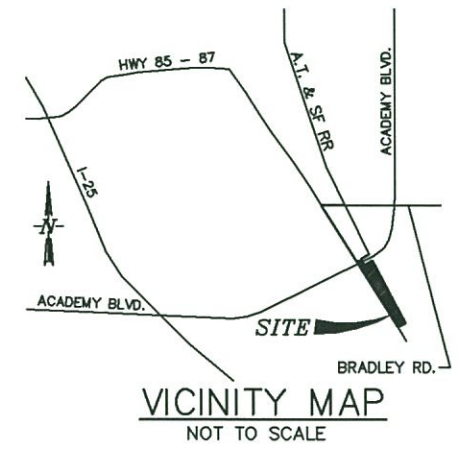

VICINITY MAP  
NOT TO SCALE

LEGEND

- BASIN DESIGNATION
- BASIN AREA, ACRES
- 5 YEAR STORM, CFS
- 100 YEAR STORM, CFS
- DESIGN POINT  
5 YEAR ACCUMULATED FLOW, CFS  
100 YEAR ACCUMULATED FLOW, CFS
- SUB-BASIN BOUNDARY
- DIRECTION OF DRAINAGE FLOW

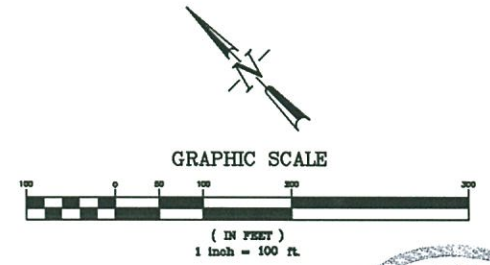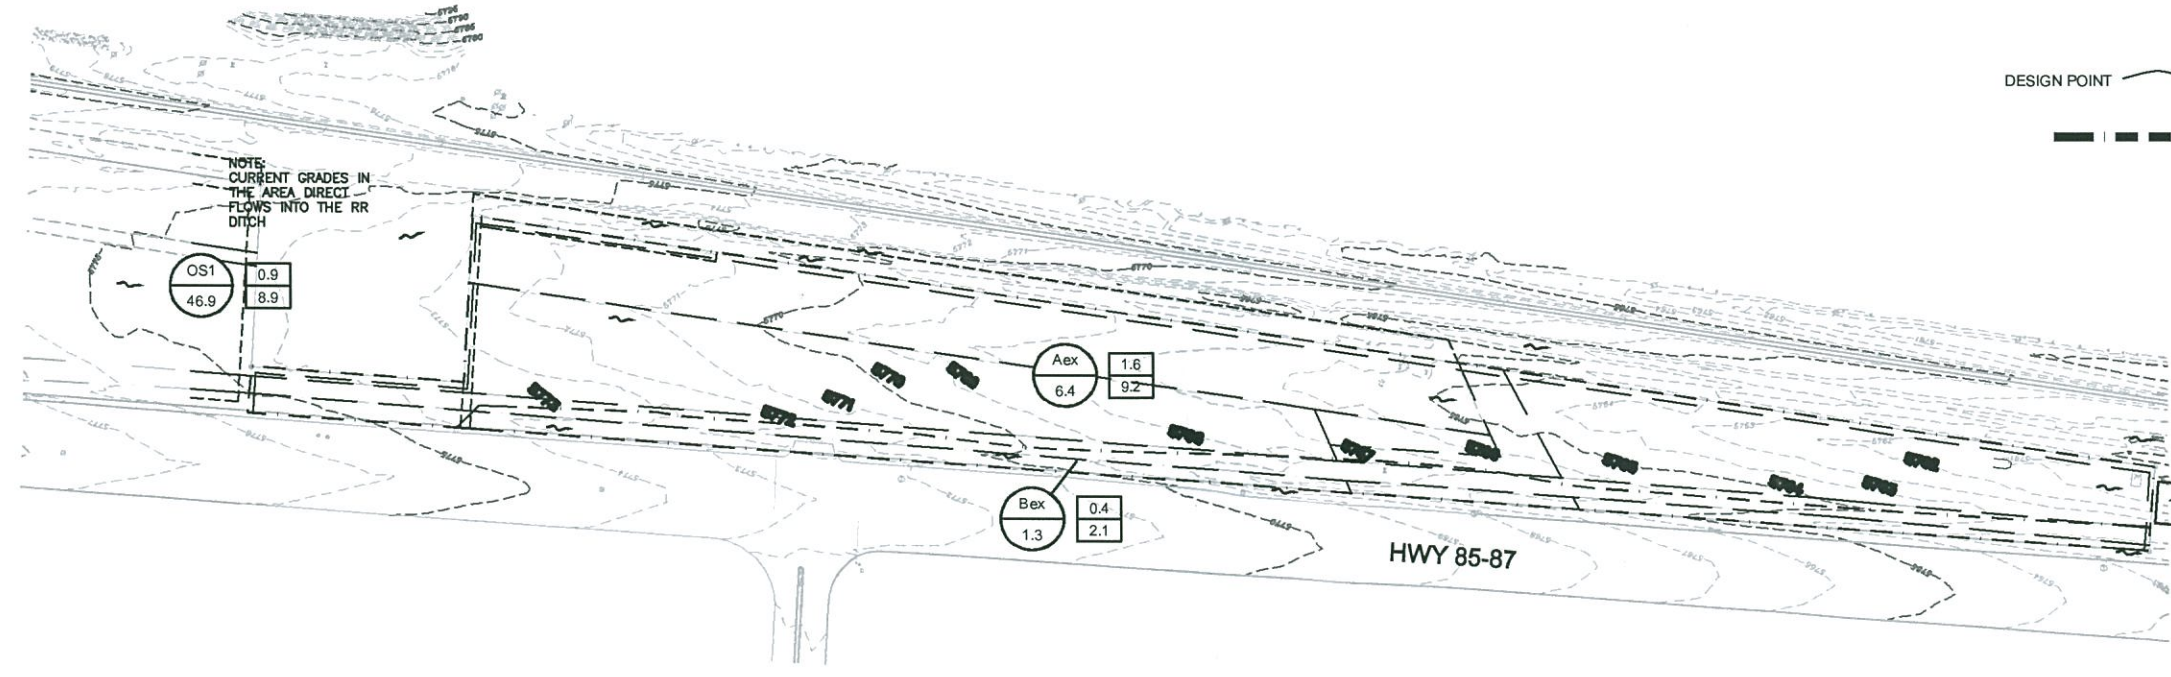

ASSOCIATED DESIGN PROFESSIONALS

PREPARED UNDER MY DIRECT SUPERVISION FOR AND ON THE BEHALF OF ASSOCIATED DESIGN PROFESSIONALS, INC.

*[Signature]*  
MICHAEL BARTUSEK, COLORADO P.E. #23329



DESIGNED BY	MMB
PROJECT ENGINEER	MMB
PROJECT MANAGER	MMB
CAD FILE NO.	161103-Drainage
DRAWN BY	HJG
DATE	1/22/17
JOB NO.	161103
SCALE	HORIZ. 1"=100' VERT. N/A

PREPARED BY:



3520 Austin Bluffs Parkway  
Suite 102  
Colorado Springs, CO 80918  
(719) 266-9212  
fax (719) 266-9241

NO.	DATE	REVISION	BY


**SOUTH ACADEMY BUSINESS CENTER**  
**4425 HWY 85-87**  
**EL PASO COUNTY, COLORADO**  
**DRAINAGE PLAN - EXISTING CONDITIONS**

SHEET

1 of 2





M:\LAND PRODUCTS\2016\161103-5\_Academy Business Ctr\DWG\161103-Drainage.dwg Date: Tue, 02/27/18 1:32 PM

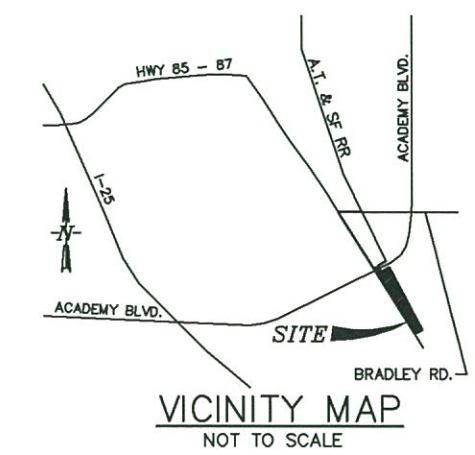


**LEGEND**

- A1A BASIN DESIGNATION
- XX BASIN AREA, ACRES
- XX 5 YEAR STORM, CFS
- XX 100 YEAR STORM, CFS
- XX XX 5 YEAR ACCUMULATED FLOW, CFS
- XX XX 100 YEAR ACCUMULATED FLOW, CFS
- SUB-BASIN BOUNDARY
- ~> DIRECTION OF DRAINAGE FLOW

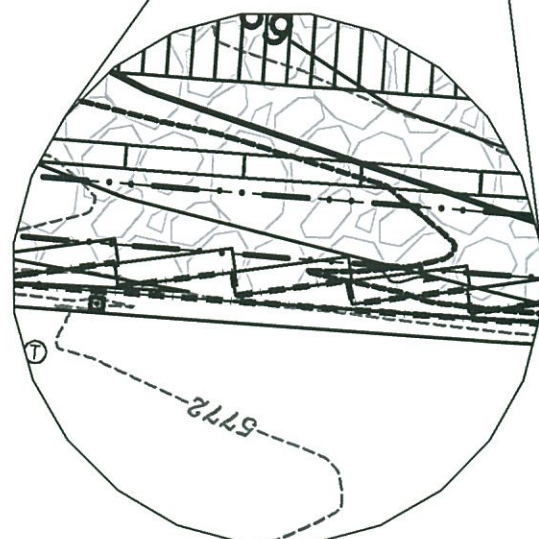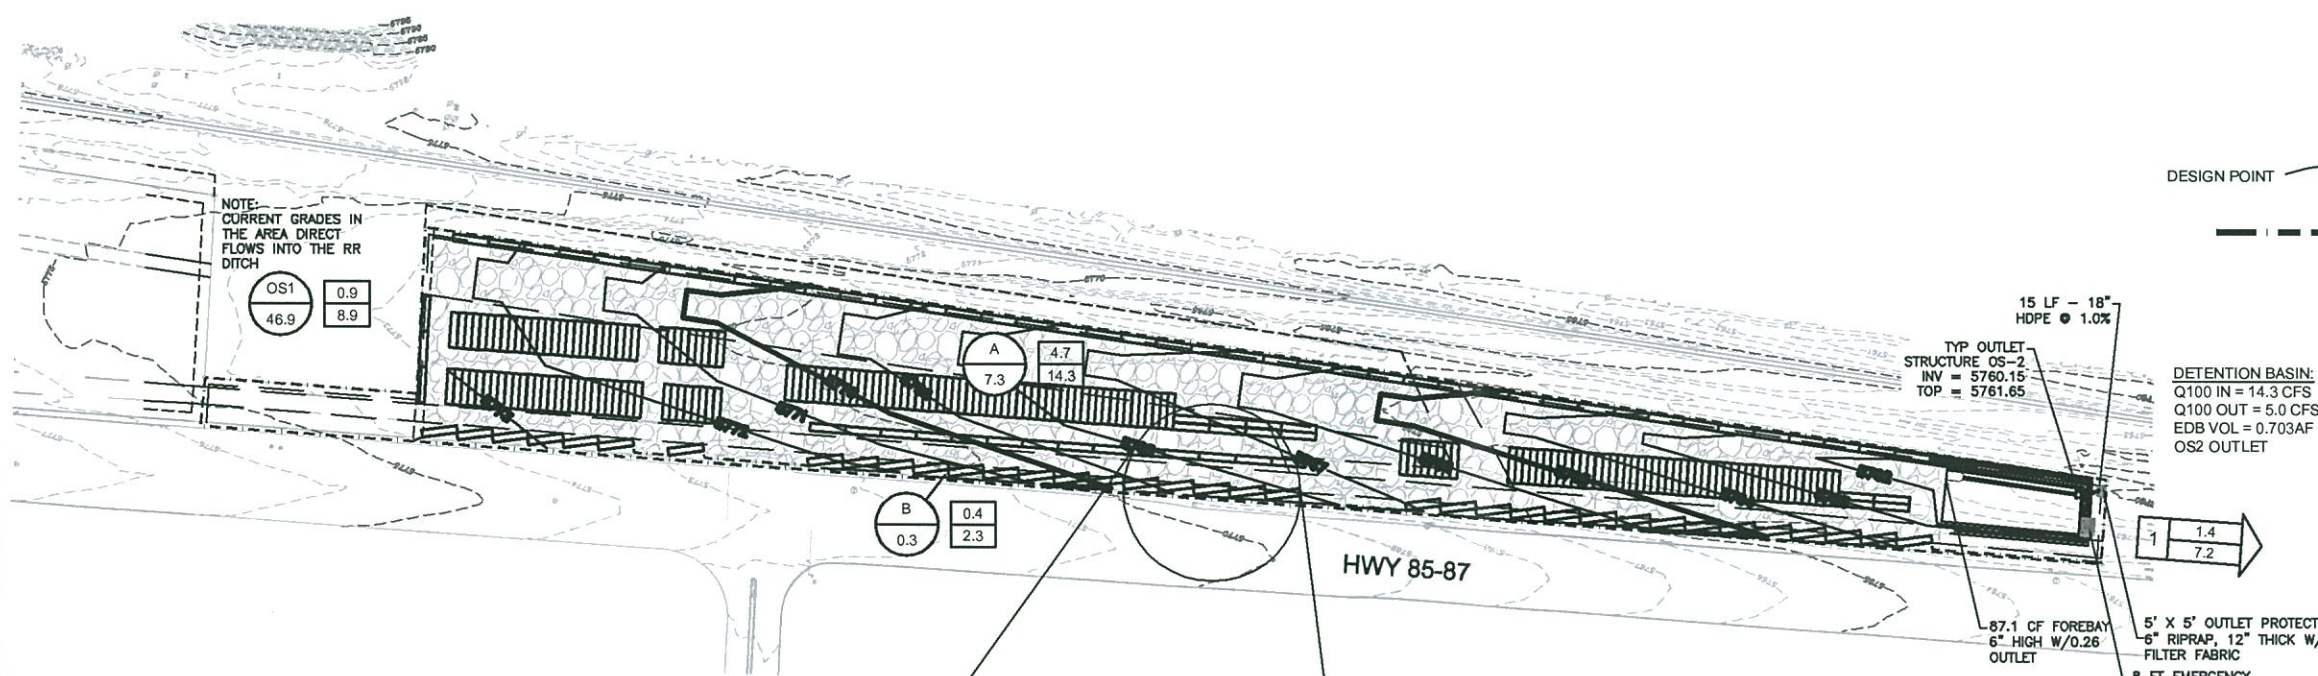

DETAIL - DRAINAGE AREA 'B'

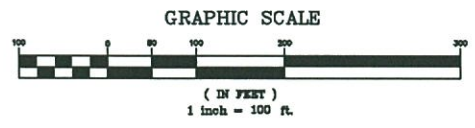

NOTE: DETENTION POND AREA TO BE UTILIZED AS A SEDIMENTATION BASIN UNTIL EARTH MOVING IS COMPLETED AND THE GROUND STABILIZED, AT WHICH TIME IT WILL BE CLEANED OUT AND THE DETENTION POND STRUCTURES ADDED.

**ASSOCIATED DESIGN PROFESSIONALS**

PREPARED UNDER MY DIRECT SUPERVISION FOR AND ON THE BEHALF OF ASSOCIATED DESIGN PROFESSIONALS, INC.

*Michael Bartusek*  
MICHAEL BARTUSEK, COLORADO P.E. #23329

3/15/18  
DATE



DESIGNED BY: MMB  
PROJECT ENGINEER: MMB  
PROJECT MANAGER: MMB  
DATE: 12/28/17  
JOB NO: 161103  
CAD FILE NO: 161103-Drainage  
DRAWN BY: HAJ  
SCALE: HORIZ. 1"=100'  
VERT. N/A

PREPARED BY:  
**ADPCIVIL**  
ENGINEERING FOR THE FUTURE

3520 Austin Bluffs Parkway  
Suite 102  
Colorado Springs, CO 80918  
(719) 296-5212  
fax: (719) 296-5241

NO.	DATE	REVISION	BY

**SOUTH ACADEMY BUSINESS CENTER**  
**4425 HWY 85-87**  
**EL PASO COUNTY, COLORADO**  
**DRAINAGE PLAN - PROPOSED CONDITIONS**