
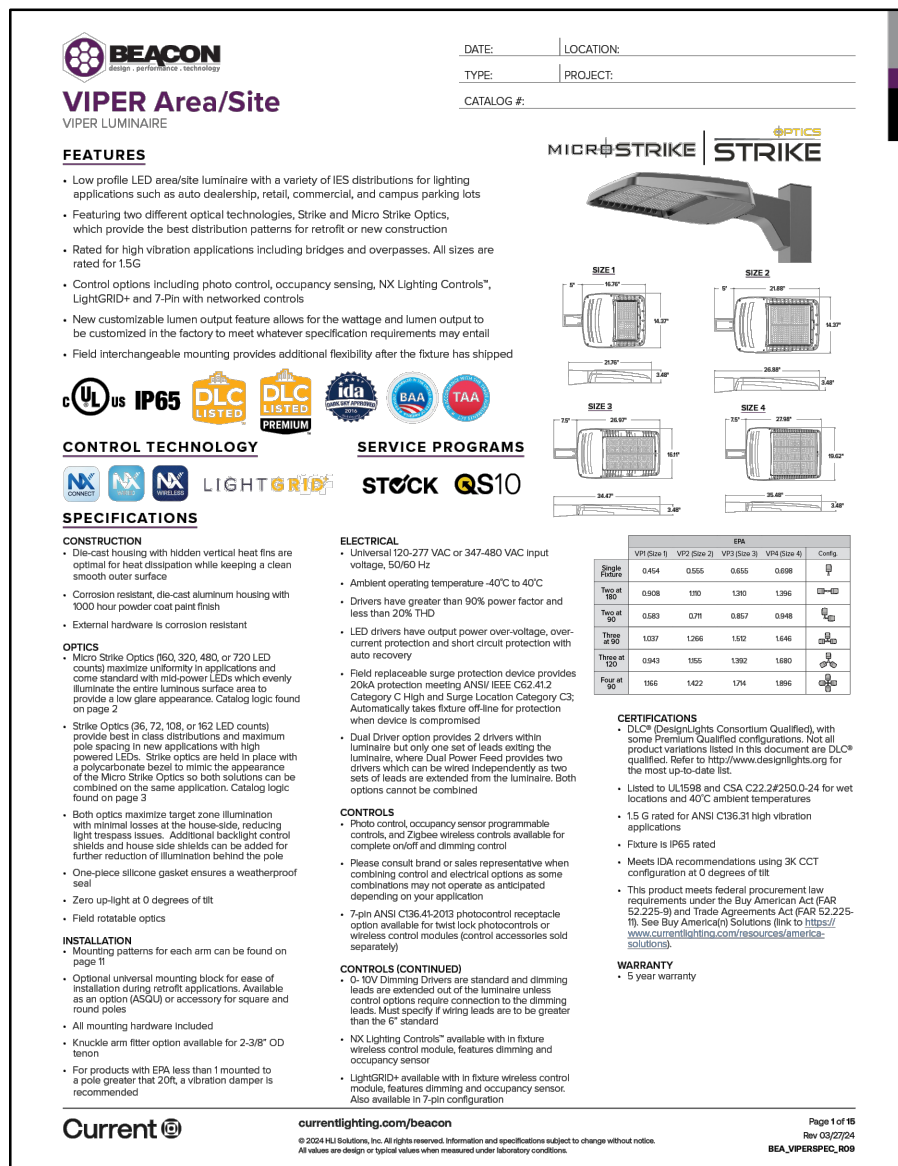


**WIDEFIELD COMMUNITY BIBLE
CHURCH
702 QUEBEC ST
COLORADO SPRINGS, CO 80911**

	ISSUED FOR PERMIT	12/29/2024
NO.	REVISION	DATE

SHEET NUMBER:

E100A

[illegible]

18'-0"

BOLT COVER PLATE

2'-0"

2'-6"

PVC CONDUIT (1" MIN)

CONCRETE AS SPECIFIED.

POLE AS SPECIFIED.


3"x5" HANDHOLE

ANCHOR BOLTS PER POLE MANUFACTURERS REQUIREMENTS WITH LEVELING NUTS ABOVE AND BELOW BASE PLATE

FINISHED GRADE

POLE BASE DETAIL
SCALE: NTS

1



SITE PHOTOMETRIC PLAN

SCALE: 1" = 20'-0"