

PROJECT DESCRIPTION

REMOVE (3) EXISTING ANTENNAS, (1) PER SECTOR. REMOVE EXISTING ANTENNA MOUNT. REMOVE (14) DIPLEXERS, (4) PER SECTOR REMOVE EXISTING (6) TMA UNITS, (2) PER SECTOR. INSTALL (3) NEW ANTENNAS, (1) PER SECTOR. INSTALL (9) NEW RRH UNITS, (3) PER SECTOR. INSTALL (6) NEW TMA UNITS, (2) PER SECTOR. INSTALL (2) NEW SURGE SUPPRESSORS. INSTALL (4) POWER, (2) FIBER TRUNKS, AND (12) NEW COAX. INSTALL (1) NEW BATTERY CABINET WITH (8) NEW BATTERIES. INSTALL (1) NEW PURCELL CABINET WITH (6) NEW ACU'S. INSTALL (2) TWIN PENTAPLEXERS

SCOPE OF WORK

1C 3C 5C RRH SWAP 4T4R
 2C 4C 2ND RRH ADD

PROJECT INFORMATION

SITE ADDRESS: 3650 BRADLEY ROAD ZONING DISTRICT: I-3
 COLORADO SPRINGS, CO 80911 EXISTING USE: UNMANNED TELECOMMUNICATIONS FACILITY
 LATITUDE: 38° 46' 17.51988" NEW USE: UNMANNED TELECOMMUNICATIONS FACILITY
 LONGITUDE: -104° 45' 42.76404" CONSTRUCTION TYPE: II-B
 JURISDICTION: EL PASO COUNTY/PIKES PEAK REGIONAL BUILDING DEPT A.P.N. 6503400036

RF DATA SHEET

DATE ISSUED: 08/01/2017 VERSION: 2.00

DRAWING INDEX


DRAWING INDEX	TITLE	REV
10093574-COL02044-T-1	TITLE SHEET	0
10093574-COL02044-GN-1	GENERAL NOTES	0
10093574-COL02044-A-1	OVERALL SITE PLAN	0
10093574-COL02044-A-2	EXISTING ENLARGED EQUIPMENT LAYOUT	0
10093574-COL02044-A-3	NEW ENLARGED EQUIPMENT LAYOUT	0
10093574-COL02044-A-4	EXISTING & NEW ELEVATIONS	0
10093574-COL02044-A-5	DETAILS & SPECIFICATIONS	0
10093574-COL02044-RF-1	EXISTING & NEW ANTENNA CONFIGURATION	0
10093574-COL02044-RF-2	RF & EQUIPMENT DETAILS	0
10093574-COL02044-G-1	SCHEMATIC GROUNDING PLAN	0
10093574-COL02044-G-2	GROUNDING DETAILS	0

SITE PROJECT PARTICIPANTS

	NAME	COMPANY	NUMBER
A/E	JON BOUTILIER	WYCO FIELD SERVICES	602-218-8820
SAC	RONNIE HYDE	WYCO FIELD SERVICES	562-900-3698
RF	ROMMEL LICUDINE	AT&T WIRELESS	703-956-0341
LANDLORD	JEREMY TAKAS	US WASTE INDUSTRIES	602-323-9101
SAC MNGR	BEN CRUTCHLEY	SMARTLINK, LLC	410-980-1269




ADDRESS
 3650 BRADLEY ROAD
 COLORADO SPRINGS, CO 80911
 SITE NUMBER
 COL02044
 SITE NAME
 ACADEMY AND I-25 SOUTH

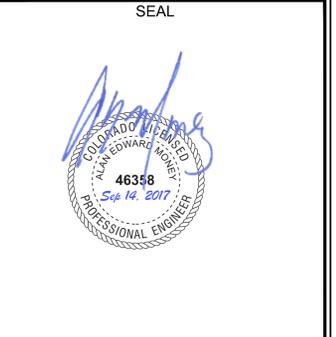

**SITE NAME: ACADEMY AND I-25 SOUTH
 SITE NUMBER: COL02044
 CONSTRUCTION DRAWINGS**

VICINITY MAP

DIRECTIONS: (188 INVERNESS DR WEST, SUITE 400 ENGLEWOOD, CO 80112):
 GET ON I-25 S IN LONE TREE FOR 1.7 MI, HEAD SOUTH ON INVERNESS DR W FOR 0.4 MI, TURN RIGHT ONTO E COUNTY LINE RD FOR 0.3 MI, MERGE ONTO I-25 S VIA THE RAMP TO COLO SPRINGS FOR 1.0 MI, FOLLOW I-25 S TO BRADLEY RD IN EL PASO COUNTY. TAKE THE BRADLEY RD EXIT FROM S ACADEMY BLVD FOR 60.4 MI, MERGE ONTO I-25 S FOR 58.7 MI, TAKE EXIT 135 FOR CO-83/ACADEMY BLVD FOR 0.2 MI, KEEP LEFT AT THE FORK AND CONTINUE TOWARD S ACADEMY BLVD FOR 312 FT., TURN LEFT ONTO S ACADEMY BLVD FOR 1.3 MI, TAKE THE BRADLEY RD EXIT FOR 0.2 MI, DRIVE TO YOUR DESTINATION IN STRATMOOR FOR 0.3 MI, AT THE TRAFFIC CIRCLE, TAKE THE 1ST EXIT ONTO BRADLEY RD FOR 0.1 MI, TURN RIGHT

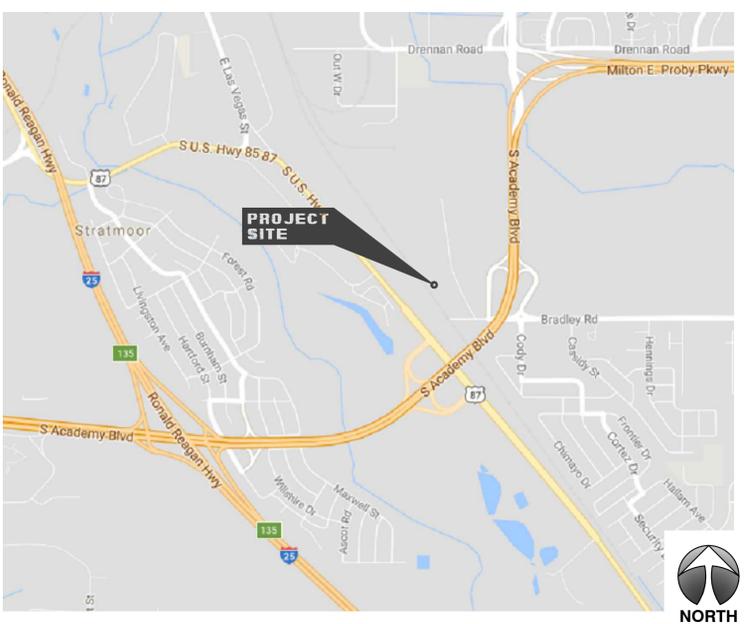

APPLICABLE BLDG. CODES AND STANDARDS

SUBCONTRACTOR'S WORK SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE, AND LOCAL CODES AS ADOPTED BY THE LOCAL AUTHORITY HAVING JURISDICTION (AHJ) FOR THE LOCATION. THE EDITION OF THE AHJ ADOPTED CODES AND STANDARDS IN EFFECT ON THE DATE OF CONTRACT AWARD SHALL GOVERN THE DESIGN.

BUILDING CODE:
 [INTERNATIONAL BUILDING CODE (IBC), 2009 AS ADOPTED BY THE LOCAL JURISDICTION]

ELECTRICAL CODE:
 [NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) 70 - 2007, NATIONAL ELECTRICAL CODE, 2014 AS ADOPTED BY THE LOCAL JURISDICTION]

LIGHTNING PROTECTION CODE:
 [NFPA 780 - 2002, LIGHTNING PROTECTION CODE]

SUBCONTRACTOR'S WORK SHALL COMPLY WITH THE LATEST EDITION OF THE FOLLOWING STANDARDS. AMERICAN CONCRETE INSTITUTE (ACI) 318, BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC), MANUAL OF STEEL CONSTRUCTION, ASD, THIRTEENTH EDITION ANSI/TIA 222-G, STRUCTURAL STANDARDS FOR ANTENNA SUPPORTING STRUCTURES AND ANTENNAS.

TIA 607, COMMERCIAL BUILDING GROUNDING AND BONDING REQUIREMENTS FOR TELECOMMUNICATIONS

INSTITUTE FOR ELECTRICAL AND ELECTRONICS ENGINEERS (IEEE) 81, GUIDE FOR MEASURING EARTH RESISTIVITY, GROUND IMPEDANCE, AND EARTH SURFACE POTENTIALS OF A GROUND SYSTEM IEEE 1100 (1999) RECOMMENDED PRACTICE FOR POWERING AND GROUNDING OF ELECTRONIC EQUIPMENT

IEEE C2 NATIONAL ELECTRIC SAFETY CODE, LATEST VERSION

TELCORDIA GR-1275, GENERAL INSTALLATION REQUIREMENTS

ANSI T1.311, FOR TELECOM - DC POWER SYSTEMS - TELECOM, ENVIRONMENTAL PROTECTION

FOR ANY CONFLICTS BETWEEN SECTIONS OF LISTED CODES AND STANDARDS REGARDING MATERIAL, METHODS OF CONSTRUCTION, OR OTHER REQUIREMENTS, THE MOST RESTRICTIVE REQUIREMENT SHALL GOVERN. WHERE THERE IS CONFLICT BETWEEN A GENERAL REQUIREMENT AND A SPECIFIC REQUIREMENT, THE SPECIFIC REQUIREMENT SHALL GOVERN.

DIG INFO

CALL COLORADO ONE CALL
 (800) 922-1987
 CALL 3 WORKING DAYS
 BEFORE YOU DIG!

SCALING DRAWINGS

SUBCONTRACTOR SHALL VERIFY ALL PLANS, EXISTING DIMENSIONS & CONDITIONS ON THE JOB SITE & SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK OR BE RESPONSIBLE FOR THE SAME.

IF USING 11"x17" PLOT, DRAWINGS WILL BE AT HALF SCALE.

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW	REV	DATE	DESCRIPTION
			A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
			B	07/26/17	CLIENT COMMENTS
			C	08/11/17	CLIENT COMMENTS
			D	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS
SHEET TITLE					
TITLE SHEET					
SHEET NUMBER					
T-1					

GENERAL NOTES:

- FOR THE PURPOSE OF CONSTRUCTION DRAWING, THE FOLLOWING DEFINITIONS SHALL APPLY:
 CONTRACTOR – SMARTLINK, LLC
 SUBCONTRACTOR – GENERAL CONTRACTOR (CONSTRUCTION)
 OWNER – AT&T MOBILITY
 OEM – ORIGINAL EQUIPMENT MANUFACTURE
- PRIOR TO THE SUBMISSION OF BIDS, THE BIDDING SUBCONTRACTOR SHALL VISIT THE CELL SITE TO FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS AND TO CONFIRM THAT THE WORK CAN BE ACCOMPLISHED AS SHOWN ON THE CONSTRUCTION DRAWINGS. ANY DISCREPANCY FOUND SHALL BE BROUGHT TO THE ATTENTION OF CONTRACTOR.
- ALL MATERIALS FURNISHED AND INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES. SUBCONTRACTOR SHALL ISSUE ALL APPROPRIATE NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY REGARDING THE PERFORMANCE OF THE WORK. ALL WORK CARRIED OUT SHALL COMPLY WITH ALL APPLICABLE MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS AND LOCAL JURISDICTIONAL CODES, ORDINANCES AND APPLICABLE REGULATIONS.
- UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, APPURTENANCES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.
- THE SUBCONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY STATED OTHERWISE.
- IF THE SPECIFIED EQUIPMENT CANNOT BE INSTALLED AS SHOWN ON THESE DRAWINGS, THE SUBCONTRACTOR SHALL PROPOSE AN ALTERNATIVE INSTALLATION FOR APPROVAL BY THE CONTRACTOR.
- SUBCONTRACTOR SHALL DETERMINE ACTUAL ROUTING OF CONDUIT, POWER AND T1 CABLES, GROUNDING CABLES AS SHOWN ON THE POWER, GROUNDING AND TELCO PLAN DRAWING. SUBCONTRACTOR SHALL UTILIZE EXISTING TRAYS AND/OR SHALL ADD NEW TRAYS AS NECESSARY. SUBCONTRACTOR SHALL CONFIRM THE ACTUAL ROUTING WITH THE CONTRACTOR. ROUTING OF TRENCHING SHALL BE APPROVED BY CONTRACTOR.
- THE SUBCONTRACTOR SHALL PROTECT EXISTING IMPROVEMENTS, PAVEMENTS, CURBS, LANDSCAPING AND STRUCTURES. ANY DAMAGED PART SHALL BE REPAIRED AT SUBCONTRACTOR'S EXPENSE TO THE SATISFACTION OF OWNER.
- SUBCONTRACTOR SHALL LEGALLY AND PROPERLY DISPOSE OFF ALL SCRAP MATERIALS SUCH AS COAXIAL CABLES AND OTHER ITEMS REMOVED FROM THE EXISTING FACILITY. ANTENNAS REMOVED SHALL BE RETURNED TO THE OWNER'S DESIGNATED LOCATION.
- SUBCONTRACTOR SHALL LEAVE PREMISES IN CLEAN CONDITION.
- ALL CONCRETE REPAIR WORK SHALL BE DONE IN ACCORDANCE WITH AMERICAN CONCRETE INSTITUTE (ACI) 301.
- ANY NEW CONCRETE NEEDED FOR THE CONSTRUCTION SHALL HAVE 4000 PSI STRENGTH AT 28 DAYS UNLESS OTHERWISE SPECIFIED. ALL CONCRETING WORK SHALL BE DONE IN ACCORDANCE WITH ACI 318 CODE REQUIREMENTS.
- ALL STRUCTURAL STEEL WORK SHALL BE DONE IN ACCORDANCE WITH AISC SPECIFICATIONS.
- CONSTRUCTION SHALL COMPLY WITH SPECIFICATION 25741-000-3APS-A00Z-00002, "GENERAL CONSTRUCTION SERVICES.
- SUBCONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS PRIOR TO COMMENCING ANY WORK. ALL DIMENSIONS OF EXISTING CONSTRUCTION SHOWN ON THE DRAWINGS MUST BE VERIFIED. SUBCONTRACTOR SHALL NOTIFY THE CONTRACTOR OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIAL OR PROCEEDING WITH CONSTRUCTION.
- THE EXISTING CELL SITE IS IN FULL COMMERCIAL OPERATION. ANY CONSTRUCTION WORK BY SUBCONTRACTOR SHALL NOT DISRUPT THE EXISTING NORMAL OPERATION. ANY WORK ON EXISTING EQUIPMENT MUST BE COORDINATED WITH CONTRACTOR. ALSO, WORK MAY NEED TO BE SCHEDULED FOR AN APPROPRIATE MAINTENANCE WINDOW USUALLY IN LOW TRAFFIC PERIODS AFTER MIDNIGHT.
- SINCE THE CELL SITE MAY BE ACTIVE, ALL SAFETY PRECAUTIONS MUST BE TAKEN WHEN WORKING AROUND HIGH LEVELS OF ELECTROMAGNETIC RADIATION. EQUIPMENT SHOULD BE SHUTDOWN PRIOR TO PERFORMING ANY WORK THAT COULD EXPOSE THE WORKERS TO DANGER. PERSONAL RF EXPOSURE MONITORS ARE REQUIRED TO BE WORN TO ALERT OF ANY DANGEROUS EXPOSURE LEVELS.

ELECTRICAL INSTALLATION NOTES:

- WIRING, RACEWAY, AND SUPPORT METHODS AND MATERIALS SHALL COMPLY WITH THE REQUIREMENTS OF THE NEC AND TELCORDIA.
- SUBCONTRACTOR SHALL MODIFY EXISTING CABLE TRAY SYSTEM AS REQUIRED TO SUPPORT RF AND TRANSPORT CABLING TO THE NEW BTS EQUIPMENT. SUBCONTRACTOR SHALL SUBMIT MODIFICATIONS TO CONTRACTOR FOR APPROVAL.
- ALL CIRCUITS SHALL BE SEGREGATED AND MAINTAIN MINIMUM CABLE SEPARATION AS REQUIRED BY THE NEC AND TELCORDIA.

ELECTRICAL INSTALLATION NOTES CONT.:

- CABLES SHALL NOT BE ROUTED THROUGH LADDER-STYLE CABLE TRAY RUNGS.
- EACH END OF EVERY POWER, GROUNDING, AND T1 CONDUCTOR AND CABLE SHALL BE LABELED WITH COLOR-CODED INSULATION OR ELECTRICAL TAPE (3M BRAND, 1/2 INCH PLASTIC ELECTRICAL TAPE WITH UV PROTECTION, OR EQUAL). THE IDENTIFICATION METHOD SHALL CONFORM WITH NEC & OSHA, AND MATCH EXISTING INSTALLATION REQUIREMENTS.
- POWER PHASE CONDUCTORS (I.E., HOTS) SHALL BE LABELED WITH COLOR-CODED INSULATION OR ELECTRICAL TAPE (3M BRAND, 1/2 INCH PLASTIC ELECTRICAL TAPE WITH UV PROTECTION, OR EQUAL). PHASE CONDUCTOR COLOR CODES SHALL CONFORM WITH THE NEC & OSHA AND MATCH EXISTING INSTALLATION REQUIREMENTS.
- ALL ELECTRICAL COMPONENTS SHALL BE CLEARLY LABELED WITH ENGRAVED LAMACOID PLASTIC LABELS. ALL EQUIPMENT SHALL BE LABELED WITH THEIR VOLTAGE RATING, PHASE CONFIGURATION, WIRE CONFIGURATION, POWER OR AMPACITY RATING, AND BRANCH CIRCUIT ID NUMBERS (I.E., PLANELOAD AND CIRCUIT ID'S).
- PANELBOARDS (ID NUMBERS) AND INTERNAL CIRCUIT BREAKERS (CIRCUIT ID NUMBERS) SHALL BE CLEARLY LABELED WITH ENGRAVED LAMACOID PLASTIC LABELS.
- ALL TIE WRAPS WHERE PERMITTED SHALL BE CUT FLUSH WITH APPROVED CUTTING TOOL TO REMOVE SHARP EDGES. USE LOW PROFILES TIE WRAPS.
- POWER, CONTROL, AND EQUIPMENT GROUND WIRING IN TUBING OR CONDUIT SHALL BE SINGLE CONDUCTOR (12 AWG OR LARGER), 600 V, OIL RESISTANT THHN OR THWN-2, CLASS B STRANDED COPPER CABLE RATED FOR 90 °C (WET AND DRY) OPERATION; LISTED OR LABELED FOR THE LOCATION AND RACEWAY SYSTEM USED, UNLESS OTHERWISE SPECIFIED.
- SUPPLEMENTAL EQUIPMENT GROUND WIRING LOCATED INDOORS SHALL BE SINGLE CONDUCTOR (6 AWG OR LARGER), 600 V, OIL RESISTANT THHN OR THWN-2 GREEN INSULATION, CLASS B STRANDED COPPER CABLE RATED FOR 90 °C (WET AND DRY) OPERATION; LISTED OR LABELED FOR THE LOCATION AND RACEWAY SYSTEM USED, UNLESS OTHERWISE SPECIFIED.
- SUPPLEMENTAL EQUIPMENT GROUND WIRING LOCATED OUTDOORS, OR BELOW GRADE, SHALL BE SINGLE CONDUCTOR 2 AWG SOLID TINNED COPPER CABLE, UNLESS OTHERWISE SPECIFIED.
- POWER WIRING, NOT IN TUBING OR CONDUIT, SHALL BE MULTI-CONDUCTOR, TYPE TC CABLE (12 AWG OR LARGER), 600 V, OIL RESISTANT THHN OR THWN-2, CLASS B STRANDED COPPER CABLE RATED FOR 90 °C (WET AND DRY) OPERATION; WITH OUTER JACKET; LISTED OR LABELED FOR THE LOCATION USED, UNLESS OTHERWISE SPECIFIED.
- ALL POWER AND GROUNDING CONNECTIONS SHALL BE CRIMP-STYLE, COMPRESSION WIRE LUGS AND WIRENUTS BY THOMAS AND BETTS (OR EQUAL). LUGS AND WIRENUTS SHALL BE RATED FOR OPERATION AT NO LESS THAN 75°C (90°C IF AVAILABLE).
- RACEWAY AND CABLE TRAY SHALL BE LISTED OR LABELED FOR ELECTRICAL USE IN ACCORDANCE WITH NEMA, UL, ANSI/IEEE, AND NEC.
- NEW RACEWAY OR CABLE TRAY WILL MATCH THE EXISTING INSTALLATION WHERE POSSIBLE.
- ELECTRICAL METALLIC TUBING (EMT) OR RIGID NONMETALLIC CONDUIT (I.E., RIGID PVC SCHEDULE 40, OR RIGID PVC SCHEDULE 80 FOR LOCATIONS SUBJECT TO PHYSICAL DAMAGE) SHALL BE USED FOR EXPOSED INDOOR LOCATIONS.
- ELECTRICAL METALLIC TUBING (EMT), ELECTRICAL NONMETALLIC TUBING (ENT), OR RIGID NONMETALLIC CONDUIT (RIGID PVC, SCHEDULE 40) SHALL BE USED FOR CONCEALED INDOOR LOCATIONS.
- GALVANIZED STEEL INTERMEDIATE METALLIC CONDUIT (IMC) SHALL BE USED FOR OUTDOOR LOCATIONS ABOVE GRADE.
- RIGID NONMETALLIC CONDUIT (I.E., RIGID PVC SCHEDULE 40 OR RIGID PVC SCHEDULE 80) SHALL BE USED UNDERGROUND; DIRECT BURIED, IN AREAS OF OCCASIONAL LIGHT VEHICLE TRAFFIC OR ENCASED IN REINFORCED CONCRETE IN AREAS OF HEAVY VEHICLE TRAFFIC.
- LIQUID-TIGHT FLEXIBLE METALLIC CONDUIT (LIQUID-TITE FLEX) SHALL BE USED INDOORS AND OUTDOORS, WHERE VIBRATION OCCURS OR FLEXIBILITY IS NEEDED.
- CONDUIT AND TUBING FITTINGS SHALL BE THREADED OR COMPRESSION-TYPE AND APPROVED FOR THE LOCATION USED. SETSCREW FITTINGS ARE NOT ACCEPTABLE.
- CABINETS, BOXES, AND WIREWAYS SHALL BE LISTED OR LABELED FOR ELECTRICAL USE IN ACCORDANCE WITH NEMA, UL, ANSI/IEEE, AND NEC.
- CABINETS, BOXES, AND WIREWAYS TO MATCH THE EXISTING INSTALLATION WHERE POSSIBLE.
- WIREWAYS SHALL BE EPOXY-COATED (GRAY) AND INCLUDE A HINGED COVER, DESIGNED TO SWING OPEN DOWNWARD; SHALL BE PANDUIT TYPE E (OR EQUAL); AND RATED NEMA 1 (OR BETTER) INDOORS, OR NEMA 3R (OR BETTER) OUTDOORS.
- EQUIPMENT CABINETS, TERMINAL BOXES, JUNCTION BOXES, AND PULL BOXES SHALL BE GALVANIZED OR EPOXY-COATED SHEET STEEL, SHALL MEET OR EXCEED UL 50, AND RATED NEMA 1 (OR BETTER) INDOORS, OR NEMA 3R (OR BETTER) OUTDOORS.
- METAL RECEPTACLE, SWITCH, AND DEVICE BOXES SHALL BE GALVANIZED, EPOXY-COATED, OR NON-CORRODING; SHALL MEET OR EXCEED UL 514A AND NEMA OS 1; AND RATED NEMA 1 (OR BETTER) INDOORS, OR WEATHER PROTECTED (WP OR BETTER) OUTDOORS.

ELECTRICAL INSTALLATION NOTES CONT.:

- NONMETALLIC RECEPTACLE, SWITCH, AND DEVICE BOXES SHALL MEET OR EXCEED NEMA OS 2; AND RATED NEMA 1 (OR BETTER) INDOORS, OR WEATHER PROTECTED (WP OR BETTER) OUTDOORS.
- THE SUBCONTRACTOR SHALL NOTIFY AND OBTAIN NECESSARY AUTHORIZATION FROM THE CONTRACTOR BEFORE COMMENCING WORK ON THE AC POWER DISTRIBUTION PANELS.
- THE SUBCONTRACTOR SHALL PROVIDE NECESSARY TAGGING ON THE BREAKERS, CABLES AND DISTRIBUTION PANELS IN ACCORDANCE WITH THE APPLICABLE CODES AND STANDARDS TO SAFEGUARD AGAINST LIFE AND PROPERTY.

GROUNDING NOTES:

- THE SUBCONTRACTOR SHALL REVIEW AND INSPECT THE EXISTING FACILITY GROUNDING SYSTEM AND LIGHTNING PROTECTION SYSTEM (AS DESIGNED AND INSTALLED) FOR STRICT COMPLIANCE WITH THE NEC (AS ADOPTED BY THE AHJ), THE SITE-SPECIFIC (UL, LPI, OR NFPA) LIGHTING PROTECTION CODE, AND GENERAL COMPLIANCE WITH TELCORDIA AND TIA GROUNDING STANDARDS. THE SUBCONTRACTOR SHALL REPORT ANY VIOLATIONS OR ADVERSE FINDINGS TO THE CONTRACTOR FOR RESOLUTION.
- ALL GROUND ELECTRODE SYSTEMS (INCLUDING TELECOMMUNICATION, RADIO, LIGHTNING PROTECTION, AND AC POWER GES'S) SHALL BE BONDED TOGETHER, AT OR BELOW GRADE, BY TWO OR MORE COPPER BONDING CONDUCTORS IN ACCORDANCE WITH THE NEC.
- THE SUBCONTRACTOR SHALL PERFORM IEEE FALL-OF-POTENTIAL RESISTANCE TO EARTH TESTING (PER IEEE 1100 AND 81) FOR NEW GROUND ELECTRODE SYSTEMS. THE SUBCONTRACTOR SHALL FURNISH AND INSTALL SUPPLEMENTAL GROUND ELECTRODES AS NEEDED TO ACHIEVE A TEST RESULT OF 5 OHMS OR LESS. TESTS SHALL BE PERFORMED IN ACCORDANCE WITH 25471-000-3PS-EG00-0001, DESIGN & TESTING OF FACILITY GROUNDING FOR CELL SITES.
- METAL RACEWAY SHALL NOT BE USED AS THE NEC REQUIRED EQUIPMENT GROUND CONDUCTOR. STRANDED COPPER CONDUCTORS WITH GREEN INSULATION, SIZED IN ACCORDANCE WITH THE NEC, SHALL BE FURNISHED AND INSTALLED WITH THE POWER CIRCUITS TO BTS EQUIPMENT.
- EACH BTS CABINET FRAME SHALL BE DIRECTLY CONNECTED TO THE MASTER GROUND BAR WITH GREEN INSULATED SUPPLEMENTAL EQUIPMENT GROUND WIRES, 6 AWG STRANDED COPPER OR LARGER FOR INDOOR BTS; 2 AWG STRANDED COPPER FOR OUTDOOR BTS.
- EXOTHERMIC WELDS SHALL BE USED FOR ALL GROUNDING CONNECTIONS BELOW GRADE.
- APPROVED ANTIOXIDANT COATINGS (I.E., CONDUCTIVE GEL OR PASTE) SHALL BE USED ON ALL COMPRESSION AND BOLTED GROUND CONNECTIONS.
- ICE BRIDGE BONDING CONDUCTORS SHALL BE EXOTHERMICALLY BONDED OR BOLTED WITH STAINLESS STEEL HARDWARE TO THE BRIDGE AND THE TOWER GROUND BAR.
- ALUMINUM CONDUCTOR OR COPPER CLAD STEEL CONDUCTOR SHALL NOT BE USED FOR GROUNDING CONNECTIONS.
- MISCELLANEOUS ELECTRICAL AND NON-ELECTRICAL METAL BOXES, FRAMES AND SUPPORTS SHALL BE BONDED TO THE GROUND RING, IN ACCORDANCE WITH THE NEC.
- METAL CONDUIT AND TRAY SHALL BE GROUNDED AND MADE ELECTRICALLY CONTINUOUS WITH LISTED BONDING FITTINGS OR BY BONDING ACROSS THE DISCONTINUITY WITH 6 AWG COPPER WIRE UL APPROVED GROUNDING TYPE CONDUIT CLAMPS.
- GROUND CONDUCTORS USED IN THE FACILITY GROUND AND LIGHTNING PROTECTION SYSTEMS SHALL NOT BE ROUTED THROUGH METALLIC OBJECTS THAT FORM A RING AROUND THE CONDUCTOR, SUCH AS METALLIC CONDUITS, METAL SUPPORT CLIPS OR SLEEVES THROUGH WALLS OR FLOORS. WHEN IT IS REQUIRED TO BE HOUSED IN CONDUIT TO MEET CODE REQUIREMENTS OR LOCAL CONDITIONS, NON-METALLIC MATERIAL SUCH AS PVC PLASTIC CONDUIT SHALL BE USED. WHERE USE OF METAL CONDUIT IS UNAVOIDABLE (E.G., NON-METALLIC CONDUIT PROHIBITED BY LOCAL CODE) THE GROUND CONDUCTOR SHALL BE BONDED TO EACH END OF THE METAL CONDUIT.
- ALL TOWER GROUNDING SYSTEMS SHALL COMPLY WITH THE REQUIREMENTS OF ANSI/TIA 222. FOR TOWERS BEING BUILT TO REV G OF THE STANDARD, THE WIRE SIZE OF THE BURIED GROUND RING AND CONNECTIONS BETWEEN THE TOWER AND THE BURIED GROUND RING SHALL BE CHANGED FROM 2 AWG TO 2/0 AWG. IN ADDITION, THE MINIMUM LENGTH OF THE GROUND RODS SHALL BE INCREASED FROM 8 FEET TO 10 FEET.



AT&T MOBILITY
 188 INVERNESS DR WEST, SUITE 400
 ENGLEWOOD, CO 80112



8502 E VIA DE VENTURA, SUITE 220
 SCOTTSDALE, AZ 85258




4240 E. ELWOOD ST.
 PHOENIX, AZ 85040

ADDRESS
 3650 BRADLEY ROAD
 COLORADO SPRINGS, CO 80911

SITE NUMBER
 COL02044


SITE NAME
 ACADEMY AND I-25 SOUTH

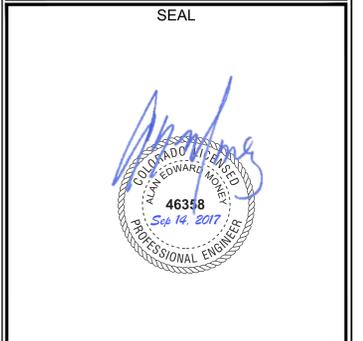

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW	FA #: 10093574	REV	DATE	DESCRIPTION
				A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
				B	07/26/17	CLIENT COMMENTS
				C	08/11/17	CLIENT COMMENTS
				D	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS

SHEET TITLE
GENERAL NOTES

SHEET NUMBER
GN-1

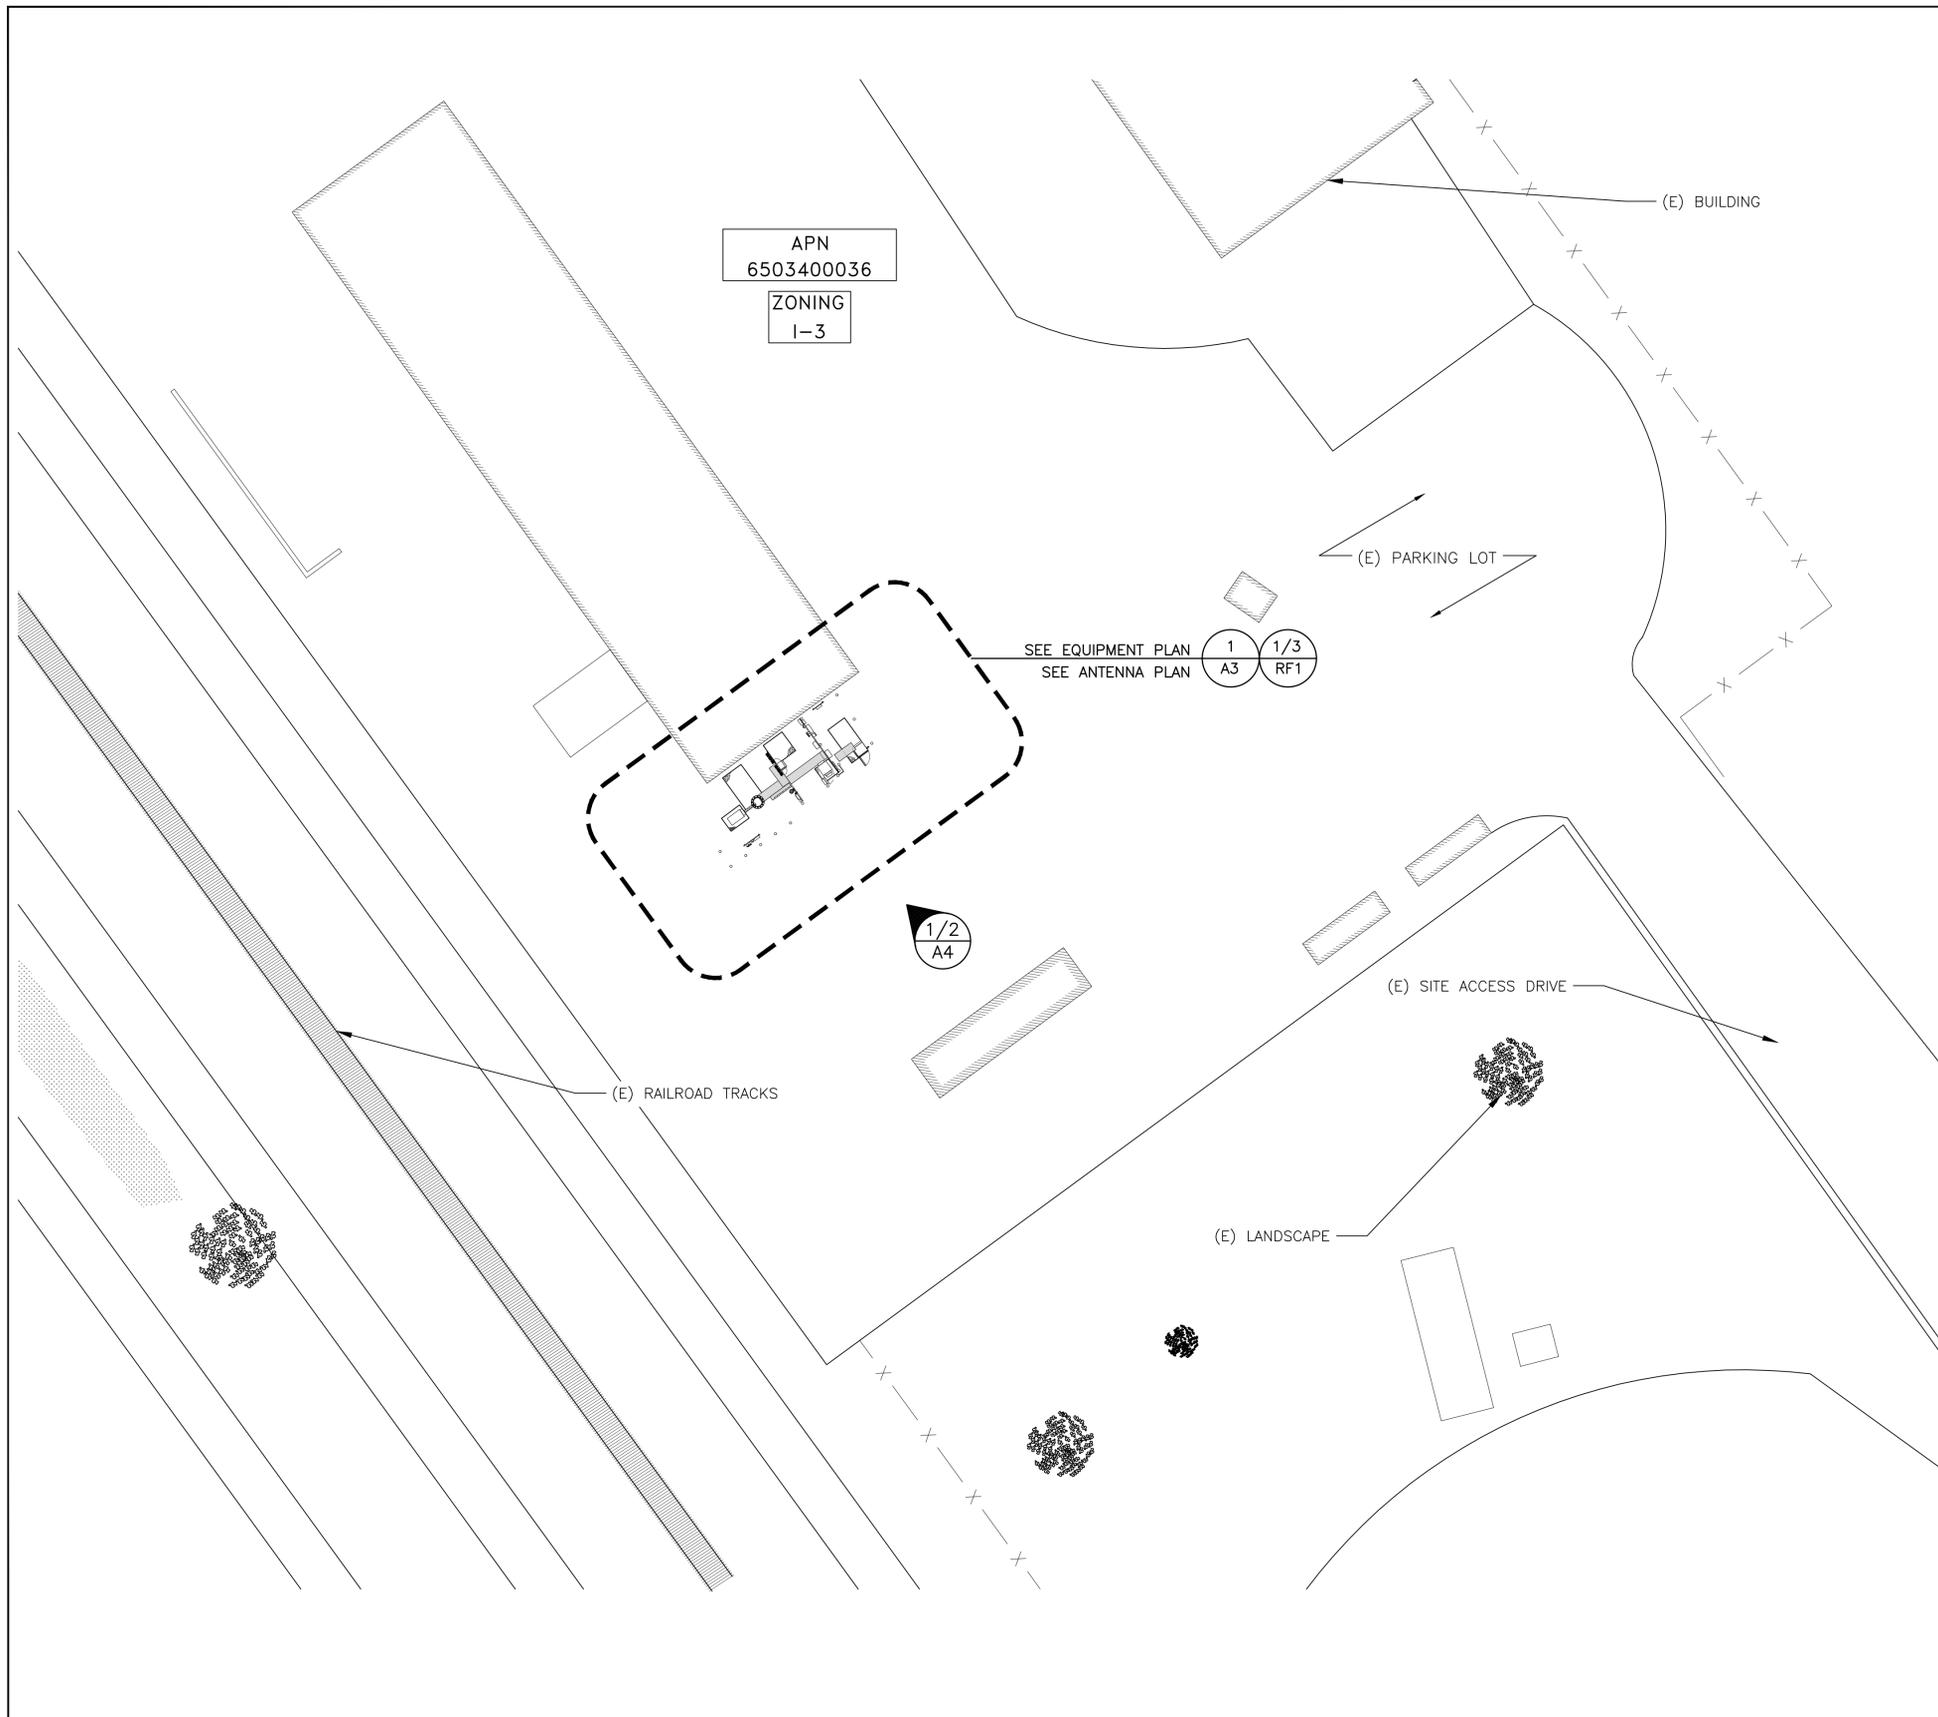

- LEGEND**
- UTILITIES**
- UGP BURIED POWER LINE
 - BURIED GAS LINE
 - OHT OVERHEAD TELEPHONE LINE
 - UGT BURIED TELEPHONE LINE
 - W W BURIED WATER LINE
 - SS BURIED SANITARY SEWER
 - SD BURIED STORM DRAIN
 - OHP OVERHEAD POWER LINE
- LANDSCAPE**
- DITCH LINE/FLOW LINE
 - ROCK RETAINING WALL
 - VEGETATION LINE
 - x - x - x - CHAIN LINK FENCE
 - WOOD FENCE
 - BARBED WIRE FENCE
 - RAILROAD TRACKS
 - EDGE OF ROAD/STREET
 - CENTERLINE OF ROAD/STREET
- PROPERTY**
- PROPERTY LINE
 - RIGHT-OF-WAY CENTERLINE
 - RIGHT-OF-WAY LINE
 - ADJACENT BOUNDARY LINE
 - SECTIONAL BREAKDOWN LINE
- AT&T SITE PROPERTY**
- SUBJECT BOUNDARY LINE

- SYMBOL KEY**
- FIRE HYDRANT
 - GATE VALVE
 - WATER METER
 - FIRE STAND PIPE
 - CATCH BASIN, TYPE I
 - CATCH BASIN, TYPE II
 - TRANSFORMER
 - LIGHT STANDARD
 - POWER VAULT
 - UTILITY BOX
 - UTILITY POLE
 - POLE GUY WIRE
 - GAS VALVE
 - GAS METER
 - TELEPHONE VAULT
 - TELEPHONE RISER
 - SIGN
 - BOLLARD
 - MAIL BOX
 - SPOT ELEVATION

at&t Mobility
AT&T MOBILITY
188 INVERNESS DR WEST, SUITE 400
ENGLEWOOD, CO 80112

smartlink
8502 E VIA DE VENTURA, SUITE 220
SCOTTSDALE, AZ 85258

WYCO FIELD SERVICES
here quality still counts.
4240 E. ELWOOD ST.
PHOENIX, AZ 85040

ADDRESS
3650 BRADLEY ROAD
COLORADO SPRINGS, CO 80911

SITE NUMBER
COL02044

SITE NAME
ACADEMY AND I-25 SOUTH

SEAL


DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW	FA #: 10093574			
			REV	DATE	DESCRIPTION	
			A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS	CLIENT COMMENTS
			B	07/26/17	CLIENT COMMENTS	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS	CLIENT COMMENTS			
D	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS				

811
Know what's below.
Call before you dig
1-800-424-5555

NORTH

FULL SCALE (22x34 SHEET ONLY) 1" = 20'
40' 20' 0 20' 40'

HALF SCALE (11x17 SHEET ONLY) 1" = 40'

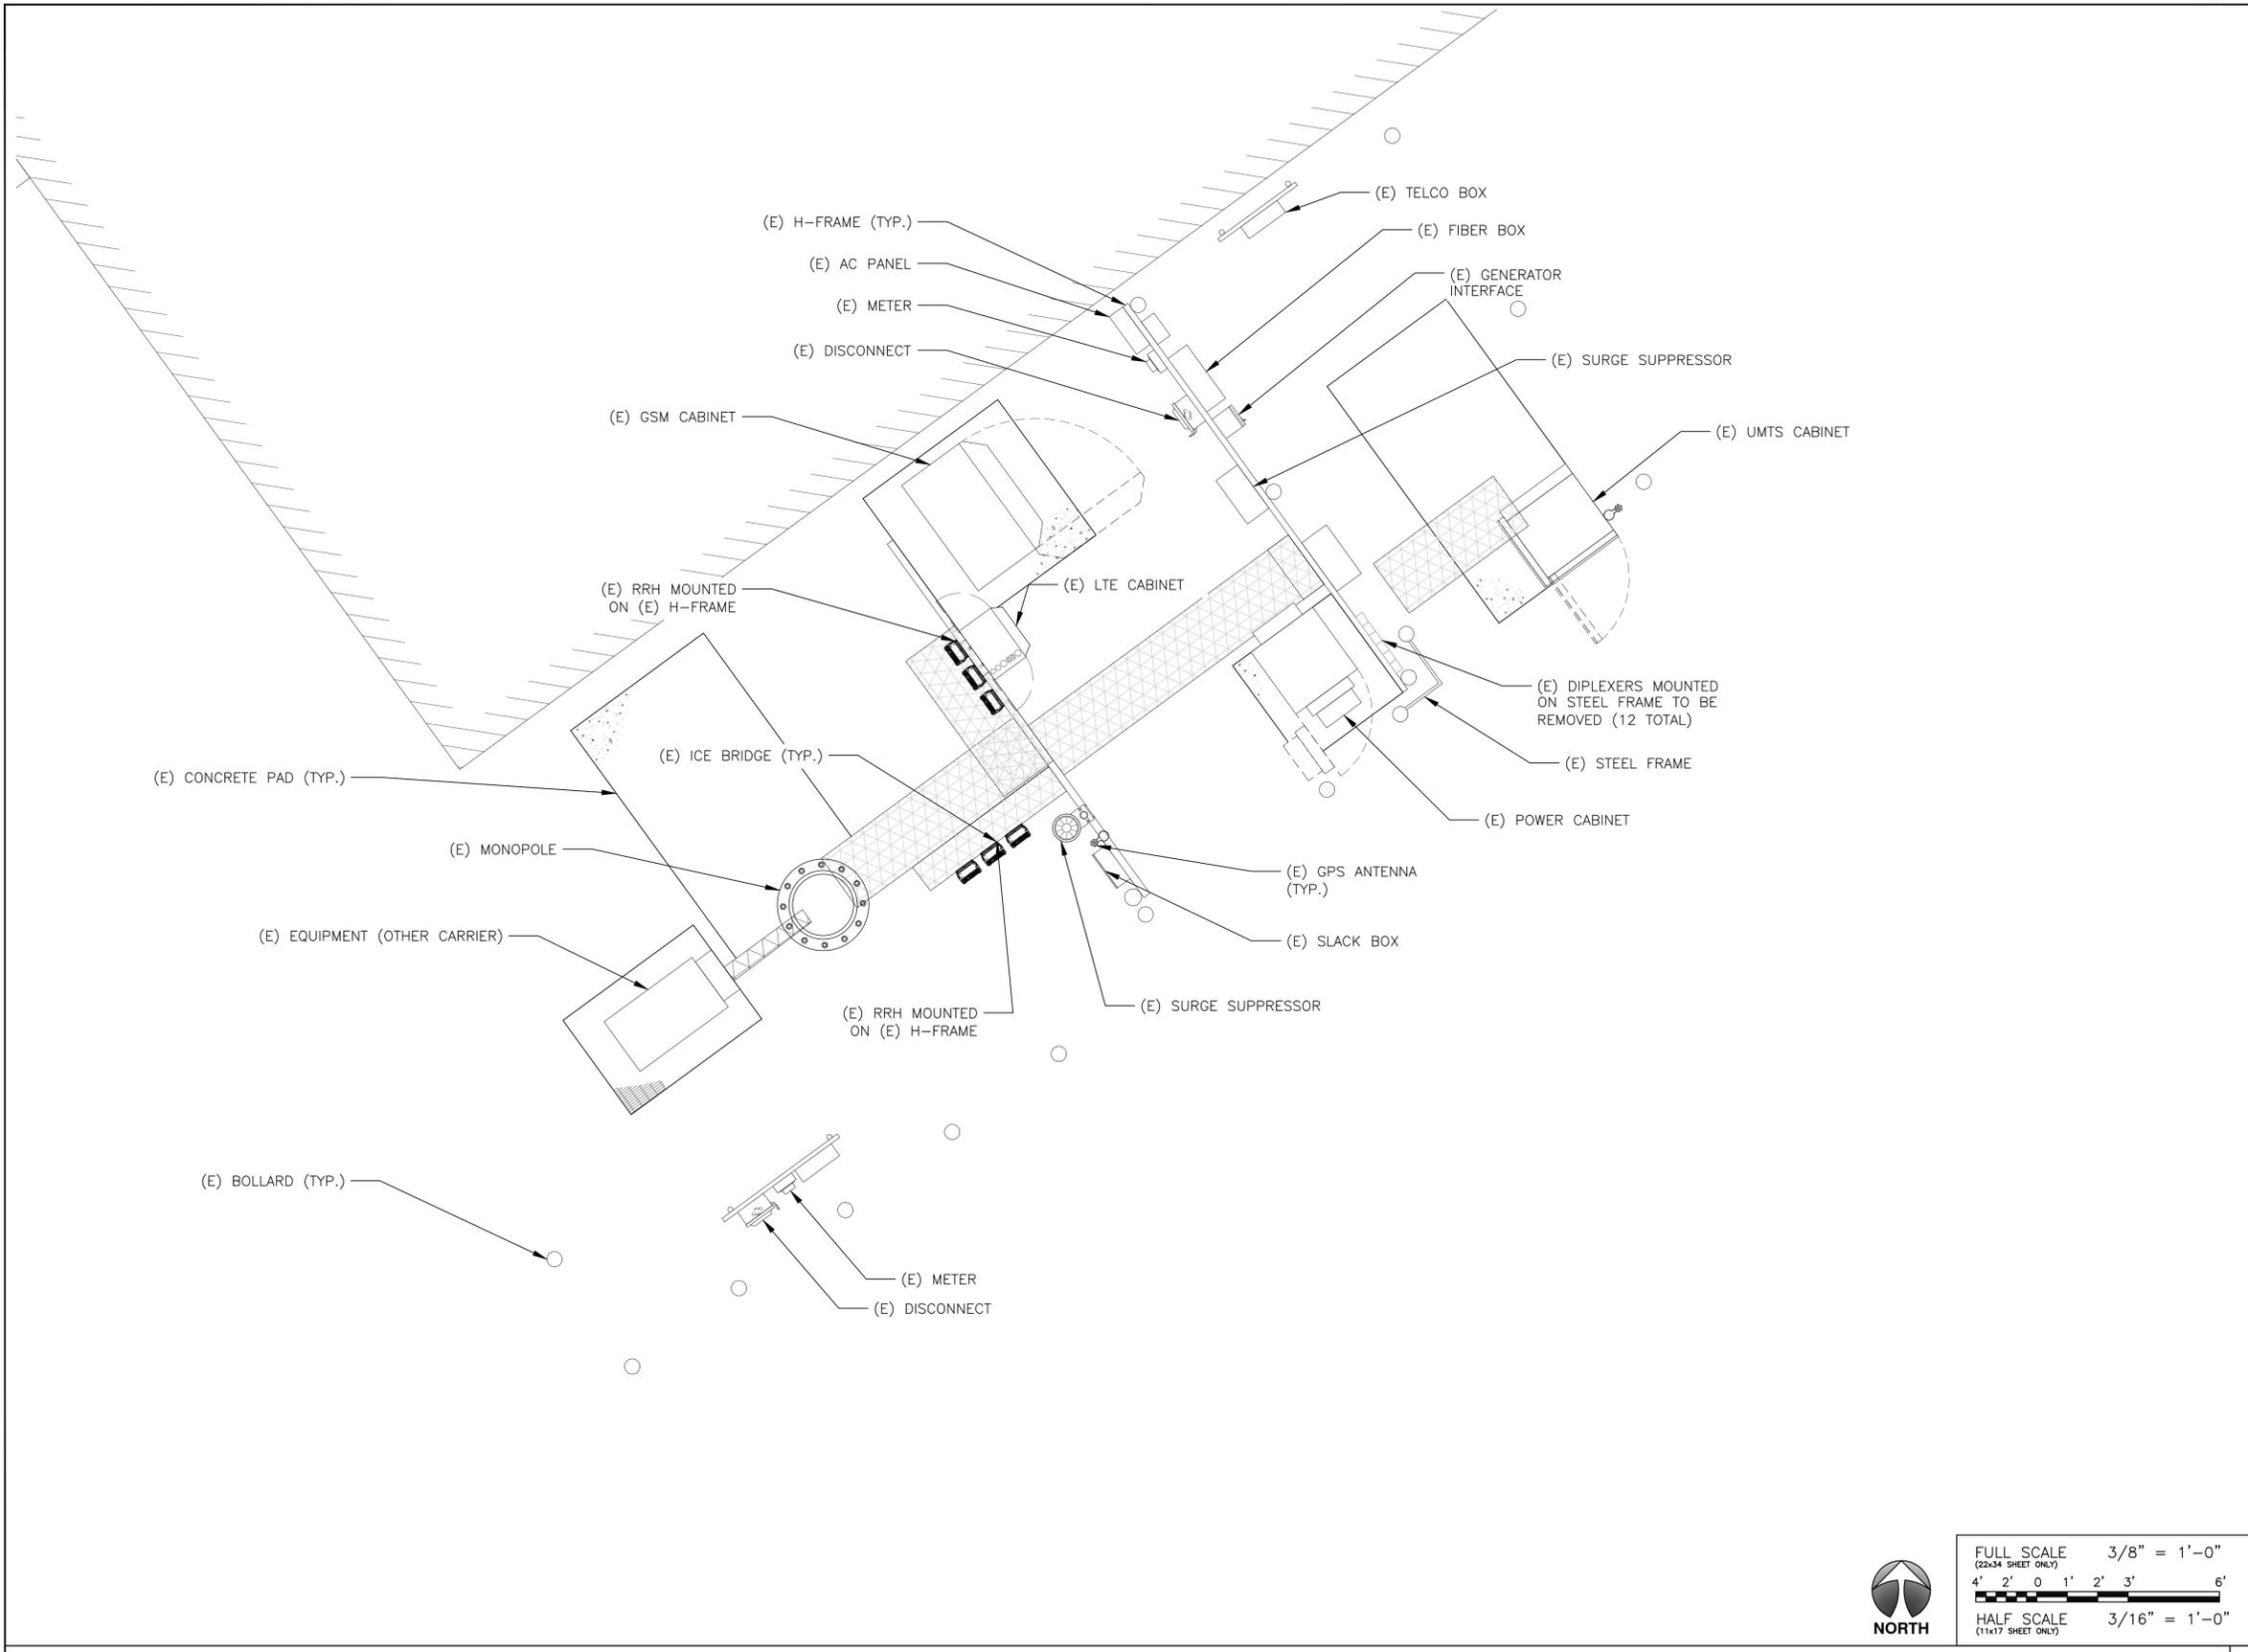

AT&T MOBILITY
188 INVERNESS DR WEST, SUITE 400
ENGLEWOOD, CO 80112

8502 E VIA DE VENTURA, SUITE 220
SCOTTSDALE, AZ 85258

here quality still counts.
4240 E. ELWOOD ST.
PHOENIX, AZ 85040

ADDRESS
3650 BRADLEY ROAD
COLORADO SPRINGS, CO 80911

SITE NUMBER
COLO2044


SITE NAME
ACADEMY AND I-25 SOUTH


SEAL

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW
FA #: 10093574		
REV	DATE	DESCRIPTION
A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
B	07/26/17	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS
O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS

SHEET TITLE
EXISTING ENLARGED EQUIPMENT PLAN

SHEET NUMBER
A-2



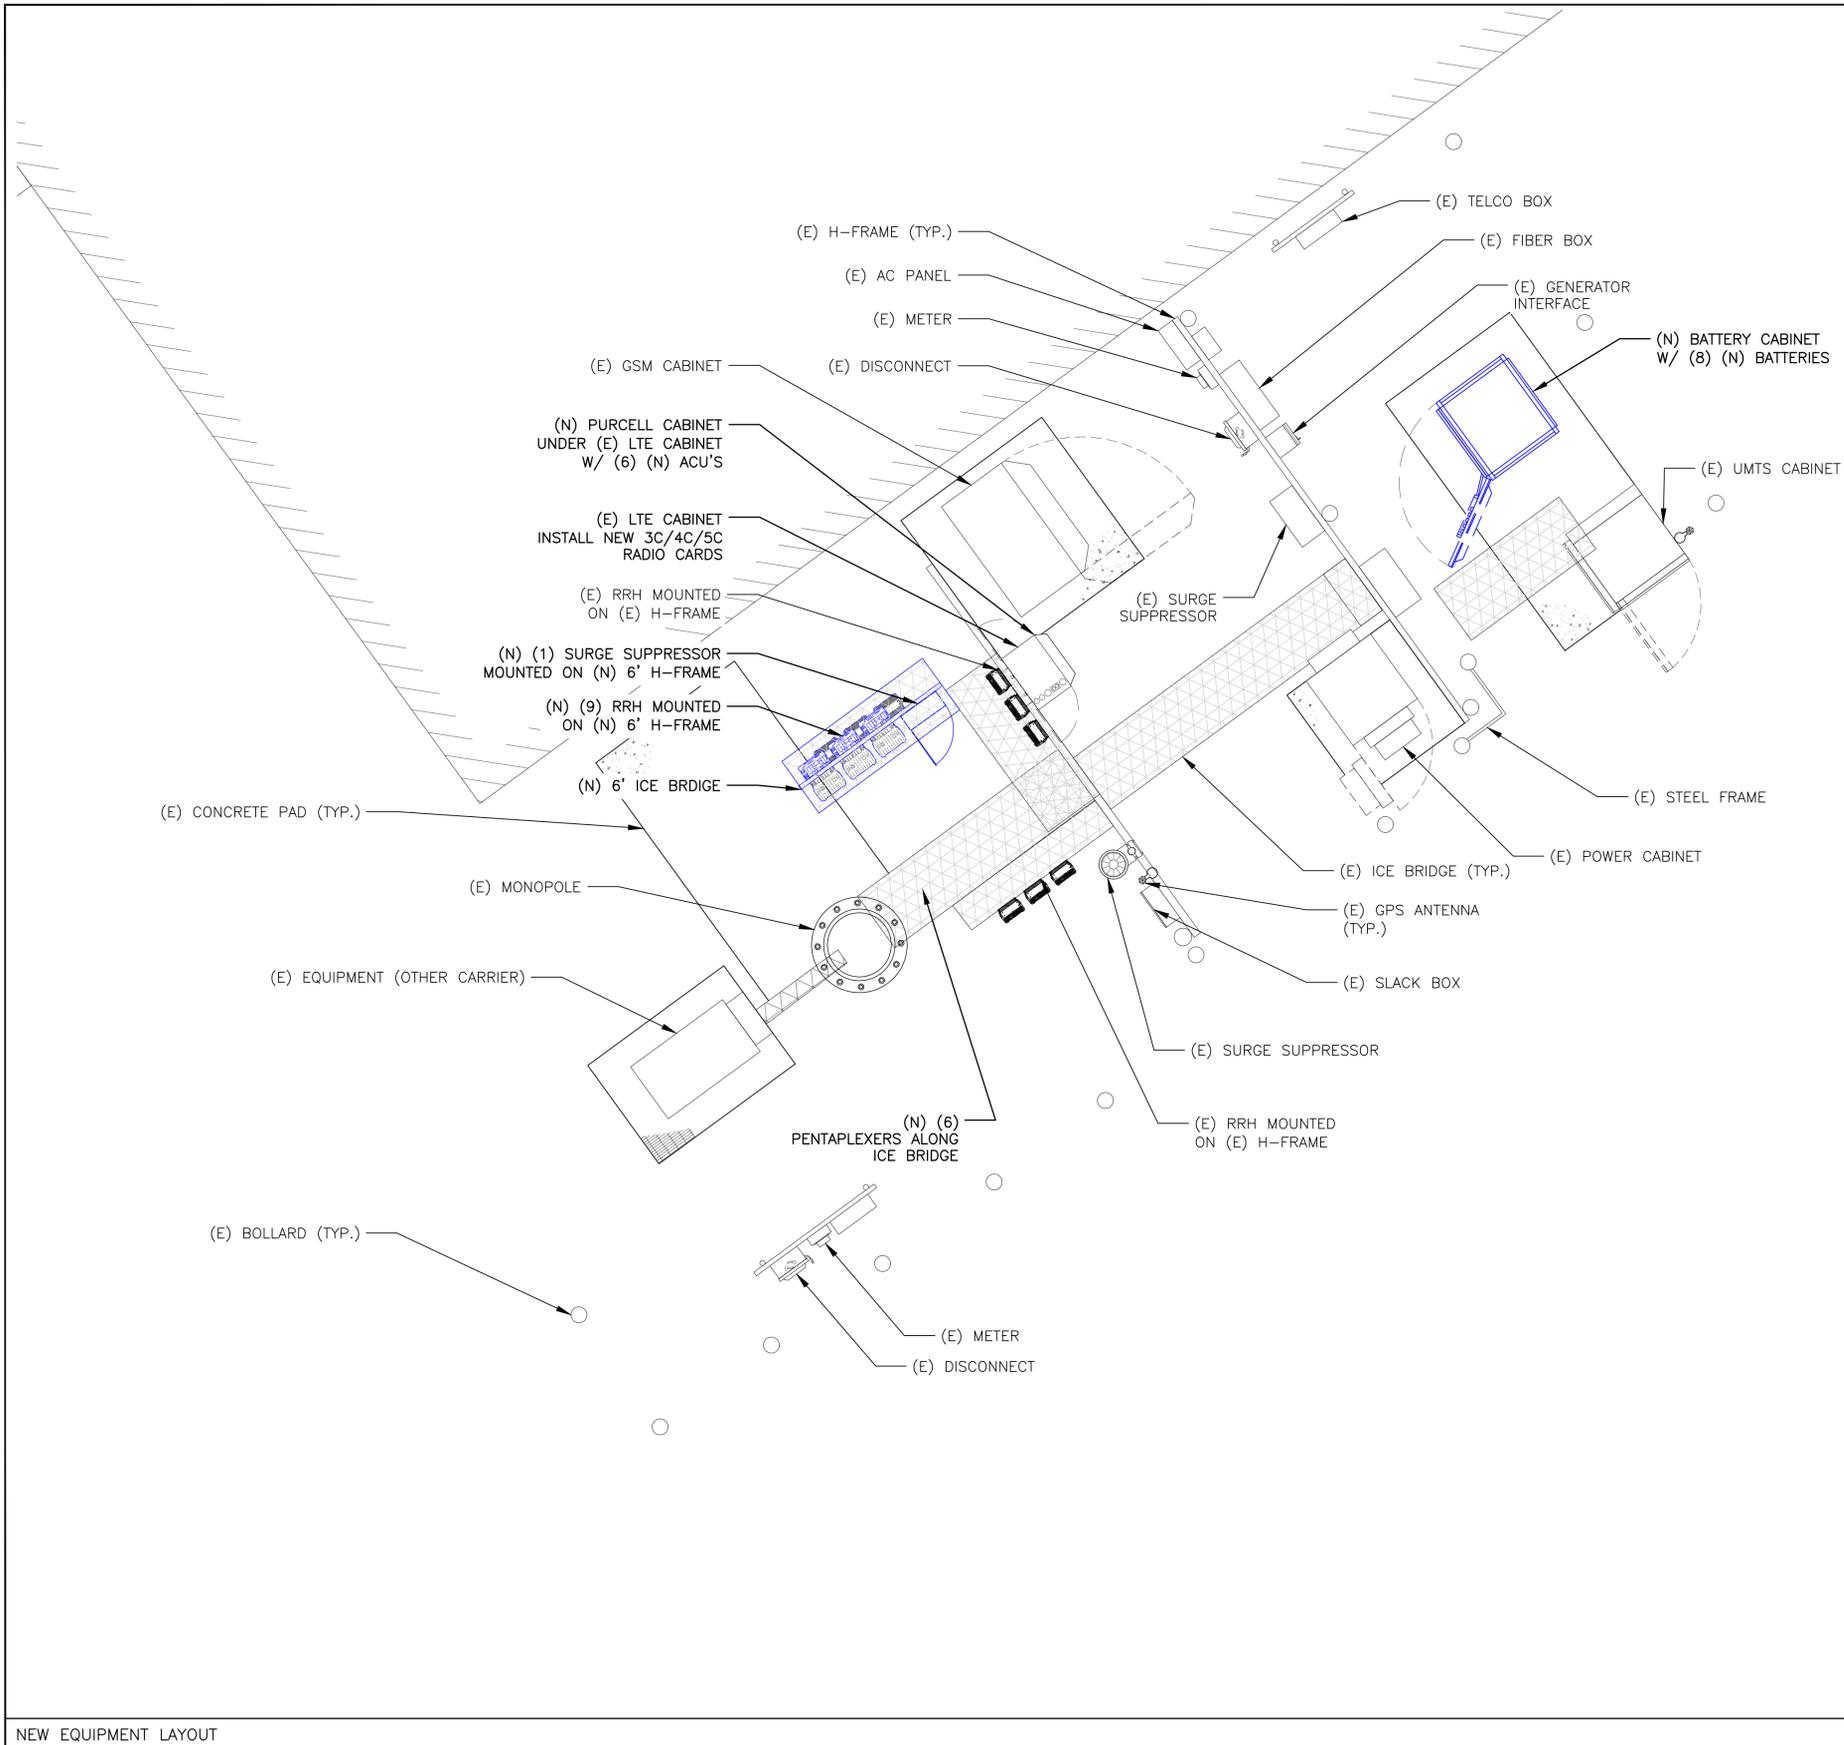

ELECTRICAL SOW SUMMARY:

1. PROPOSED LTE 3C, 4C & 5C CONFIGURATION PER RFDS V1.0 DATED 06.07.17 (UPDATED 06.23.17)
2. PASSES RECTIFIER CAPACITY; EXISTING TE45V3 POWER PLANT [NEQ.15368] IS EQUIPPED WITH FOUR (4) CORDEX HP 4.0 KW (74A @ -54VDC) RECTIFIERS [NEQ.15852].
3. CONVERTER CAPACITY; N/A
4. NO PERMANENT GENERATOR
5. FAILS BATTERY RESERVE CAPACITY @ 2.81 HRS; THERE ARE (12) GNB MARATHON M12V155FT BATTERIES [NEQ.12090] I.E. (3) STRINGS @ -48VDC NOMINAL INSTALL (1) NEW ARGUS TE45V3B BATTERY CABINET AND EQUIP WITH (8) NEW GNB MARATHON M12V155FT BATTERIES [NEQ.12090] FOR A REVISED TOTAL OF (5) STRINGS CONFIGURED @ -48VDC NOMINAL TO ACHIEVE 4.43 HRS OF BATTERY RESERVE CAPACITY.
6. INSTALL (1) EA. NEW -48VDC PURCELL FLX16WS CABINET
7. HVAC TONNAGE CAPACITY: N/A - OUTDOOR CABINETS

AT&T MOBILITY
188 INVERNESS DR WEST, SUITE 400
ENGLEWOOD, CO 80112

8502 E VIA DE VENTURA, SUITE 220
SCOTTSDALE, AZ 85258

here quality still counts.
4240 E. ELWOOD ST.
PHOENIX, AZ 85040

ADDRESS
3650 BRADLEY ROAD
COLORADO SPRINGS, CO 80911

SITE NUMBER
COL02044


SITE NAME
ACADEMY AND I-25 SOUTH


SEAL

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW
FA #: 10093574		
REV	DATE	DESCRIPTION
A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
B	07/26/17	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS
O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS


SHEET TITLE
**NEW ENLARGED
EQUIPMENT LAYOUT**

SHEET NUMBER
A-3



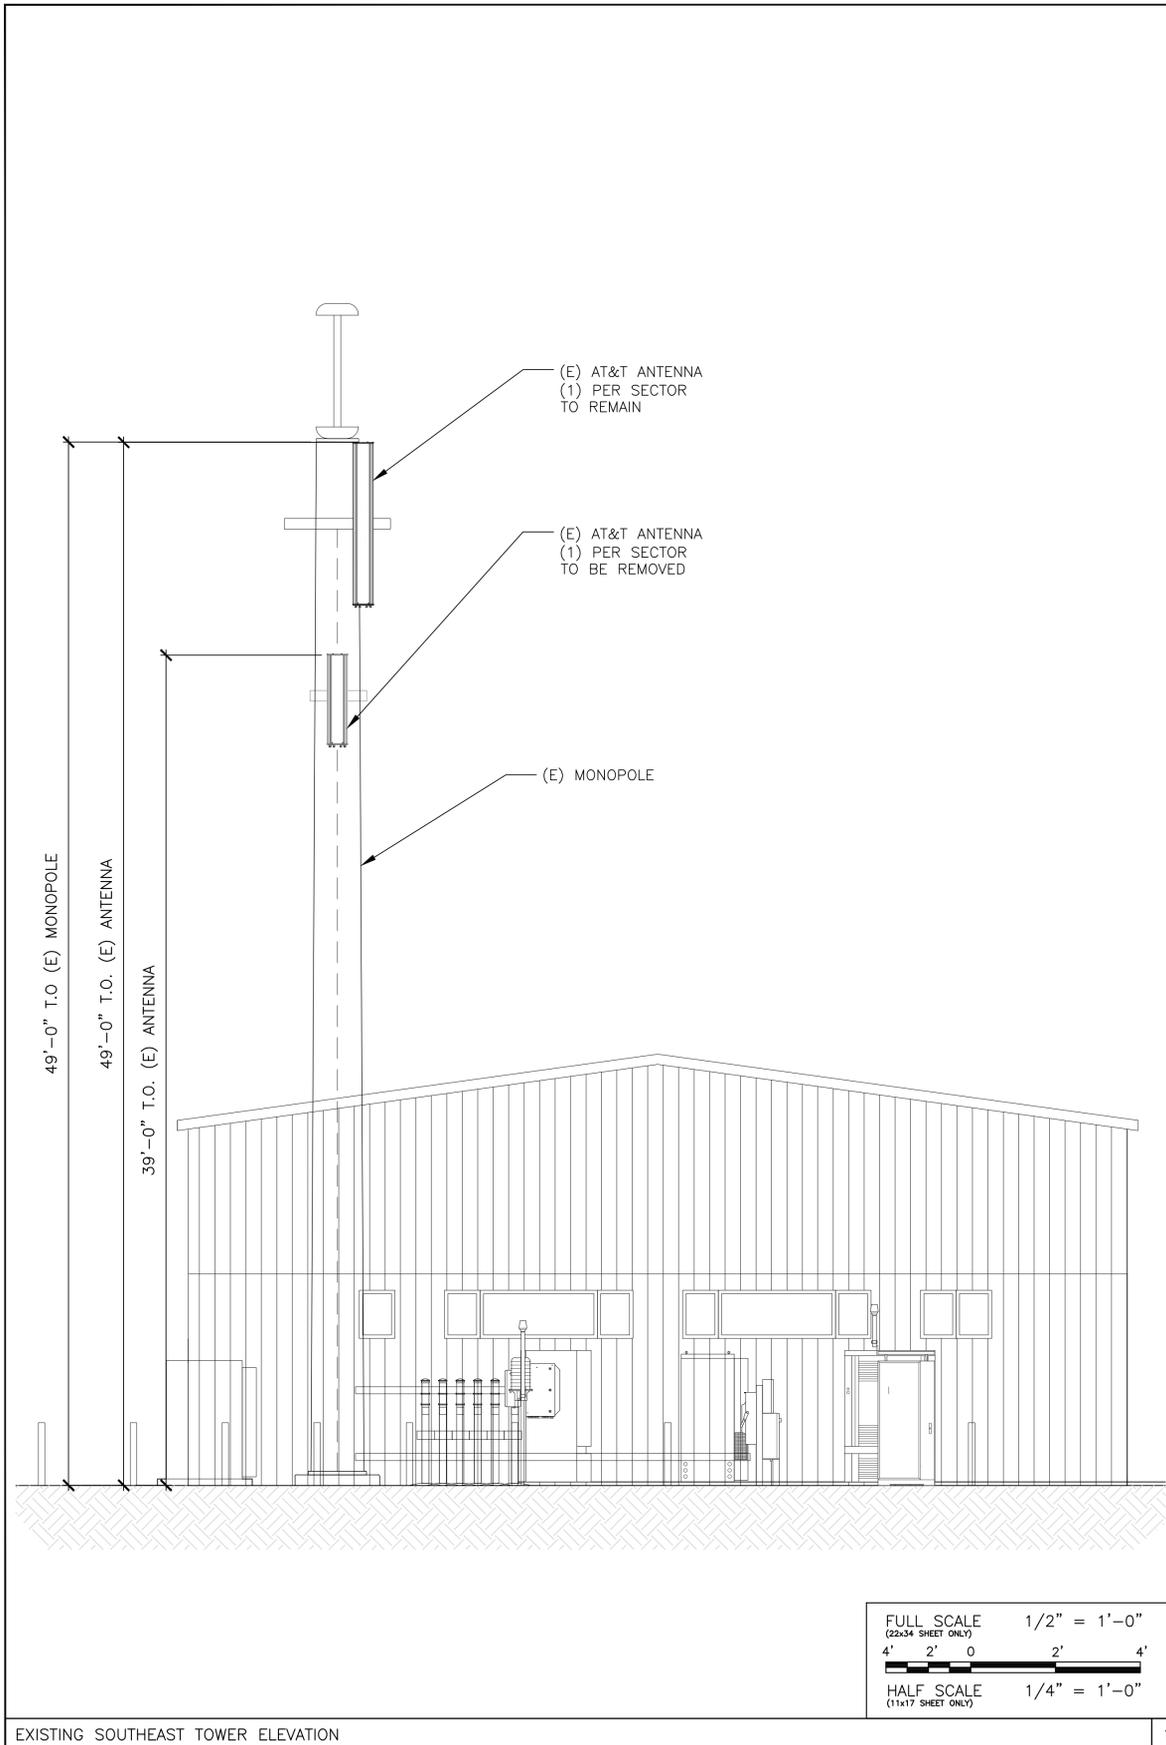

EXISTING SOUTHEAST TOWER ELEVATION

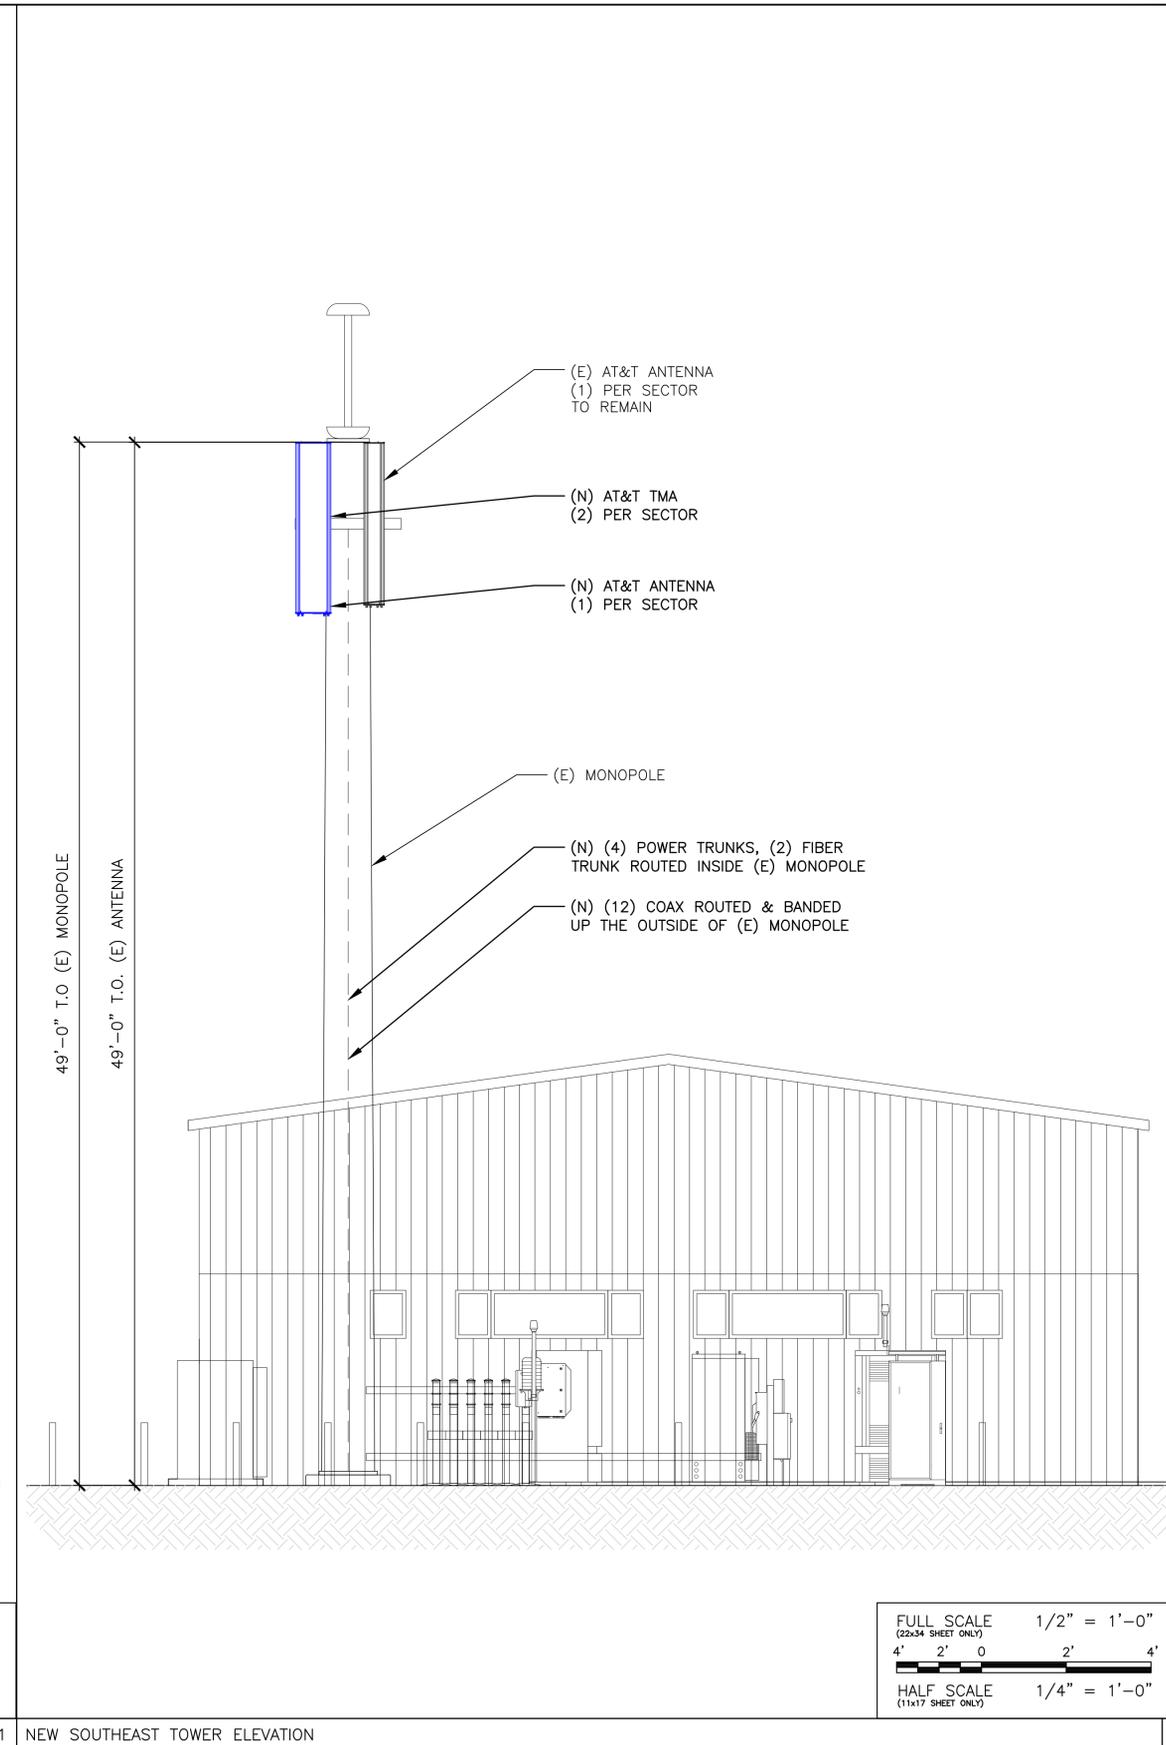

NEW SOUTHEAST TOWER ELEVATION



AT&T MOBILITY
188 INVERNESS DR WEST, SUITE 400
ENGLEWOOD, CO 80112



8502 E VIA DE VENTURA, SUITE 220
SCOTTSDALE, AZ 85258



4240 E. ELWOOD ST.
PHOENIX, AZ 85040

ADDRESS
3650 BRADLEY ROAD
COLORADO SPRINGS, CO 80911

SITE NUMBER
COL02044

SITE NAME
ACADEMY AND I-25 SOUTH

SEAL



DRAWN BY: CW CHECKED BY: MW APPROVED BY: MW

FA #: 10093574

REV	DATE	DESCRIPTION
A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
B	07/26/17	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS
O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS

SHEET TITLE
**EXISTING & NEW
TOWER ELEVATIONS**

SHEET NUMBER



A-4

OUTDOOR CABINET DIMENSIONS
MANUFACTURER: ARGUS TE45V3B
HEIGHT: 84"
DEPTH: 30"
WIDTH: 30"
MAXIMUM CABINET WEIGHT: 3500 LBS.

BATTERY TYPE: M12V155FT
 LEAD WEIGHT: 36.8 KG/81.0 LBS
 ELECTROLYTE VOLUME: 8.19 L/2.17 GAL
 ELECTROLYTE WEIGHT: 10.80 KG/23.80 LBS
 SULFURIC ACID WEIGHT: 4.53 KG/9.98 LBS
 SULFURIC ACID VOLUME: 2.46 L/0.65 GAL

TOTAL ELECTROLYTE PER BATTERY:
 2.17 GALLONS

(20) BATTERIES X 2.17 GA =
 43.4 GALLONS OF TOTAL ELECTROLYTES

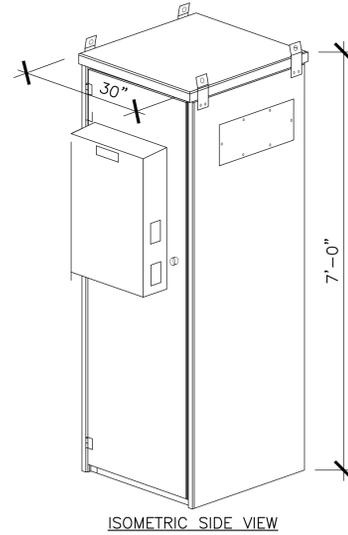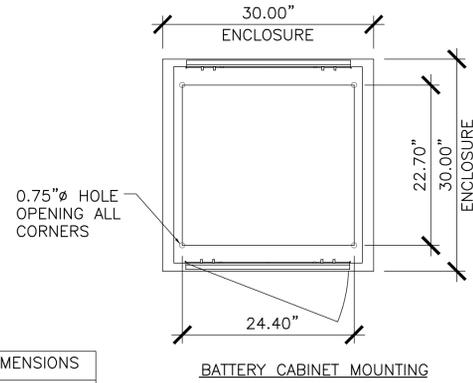

ISOMETRIC SIDE VIEW



AT&T MOBILITY
 188 INVERNESS DR WEST, SUITE 400
 ENGLEWOOD, CO 80112



8502 E VIA DE VENTURA, SUITE 220
 SCOTTSDALE, AZ 85258



4240 E. ELWOOD ST.
 PHOENIX, AZ 85040

ADDRESS
 3650 BRADLEY ROAD
 COLORADO SPRINGS, CO 80911

SITE NUMBER
 COLO2044

SITE NAME
 ACADEMY AND I-25 SOUTH

SEAL



DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW	FA #: 10093574	DESCRIPTION	
				DATE	
				REV	
				PRELIMINARY CONSTRUCTION DRAWINGS	
				CLIENT COMMENTS	
				CLIENT COMMENTS	
				CLIENT COMMENTS	
				SUBMITTAL CONSTRUCTION DRAWINGS	

SHEET TITLE

DETAILS & SPECIFICATIONS

SHEET NUMBER

A-5

NOT USED 6 NOT USED 5

NOT USED 4

NEW BATTERY CABINET DETAIL 3 NOT USED 2 NOT USED 1

EXISTING ANTENNA SCHEDULE					
SECTOR	POSITION	TECH	ANTENNA	RRH	FEED LINE TYPE
ALPHA	1	LTE	91.7" PANEL	(2) LTE	EXISTING COAX CABLES
ALPHA	2	LTE	55" PANEL	-	EXISTING COAX CABLES
ALPHA	3	-	-	-	-
ALPHA	4	-	-	-	-
BETA	1	LTE	91.7" PANEL	(2) LTE	EXISTING COAX CABLES
BETA	2	LTE	55" PANEL	-	EXISTING COAX CABLES
BETA	3	-	-	-	-
BETA	4	-	-	-	-
GAMMA	1	LTE	91.7" PANEL	(2) LTE	EXISTING COAX CABLES
GAMMA	2	LTE	55" PANEL	-	EXISTING COAX CABLES
GAMMA	3	-	-	-	-
GAMMA	4	-	-	-	-

NEW ANTENNA SCHEDULE					
SECTOR	POSITION	TECH	ANTENNA	RRH	FEED LINE TYPE
ALPHA	1	LTE	91.7" PANEL*	(2) LTE	EXISTING COAX CABLES
ALPHA	2	UMTS/LTE	96" PANEL*	(3) LTE	NEW COAX CABLES
ALPHA	3	-	-	-	-
ALPHA	4	-	-	-	-
BETA	1	LTE	91.7" PANEL	(2) LTE	EXISTING COAX CABLES
BETA	2	UMTS/LTE	96" PANEL*	(3) LTE	NEW COAX CABLES
BETA	3	-	-	-	-
BETA	4	-	-	-	-
GAMMA	1	LTE	91.7" PANEL	(2) LTE	EXISTING COAX CABLES
GAMMA	2	UMTS/LTE	96" PANEL*	(3) LTE	NEW COAX CABLES
GAMMA	3	-	-	-	-
GAMMA	4	-	-	-	-

NOTES:
 1. DO NOT USE COAX LENGTHS FOR CUT LENGTHS: ESTIMATES ONLY
 2. CONFIRM THAT GENERAL CONTRACTOR IS USING LATEST VERSION OF RFDS.
 * OR SIMILAR



AT&T MOBILITY
 188 INVERNESS DR WEST, SUITE 400
 ENGLEWOOD, CO 80112



8502 E VIA DE VENTURA, SUITE 220
 SCOTTSDALE, AZ 85258



4240 E. ELWOOD ST.
 PHOENIX, AZ 85040

ADDRESS
 3650 BRADLEY ROAD
 COLORADO SPRINGS, CO 80911

SITE NUMBER
 COL02044



SITE NAME
 ACADEMY AND I-25 SOUTH

SEAL



EXISTING ANTENNAS AND COAX CONFIGURATION AND SCHEDULE

NEW ANTENNA AND COAX CONFIGURATION AND SCHEDULE

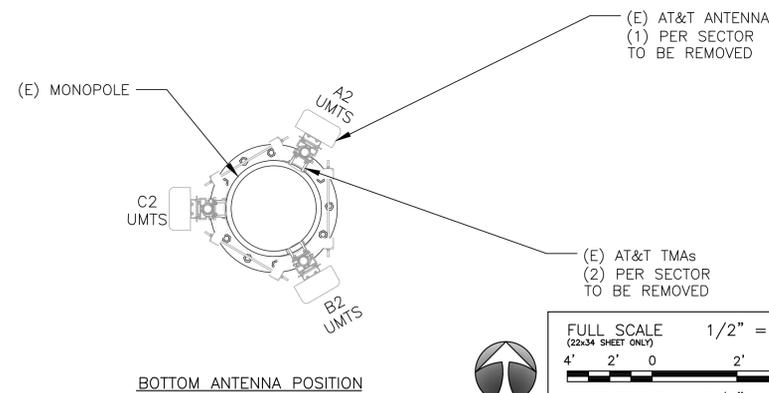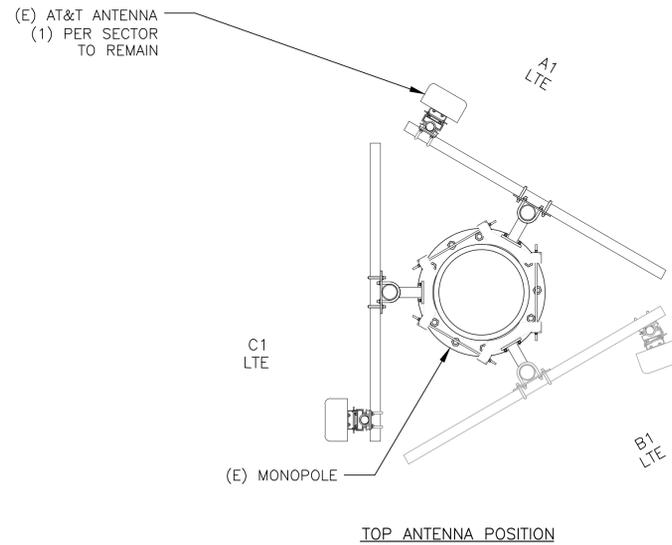


NOTE:
 STRUCTURAL ANALYSIS
 REQUIRED & DONE
 BY OTHERS

FULL SCALE 1/2" = 1'-0"
 (22x34 SHEET ONLY)
 4' 2' 0 2' 4'
 HALF SCALE 1/4" = 1'-0"
 (11x17 SHEET ONLY)



FULL SCALE 1/2" = 1'-0"
 (22x34 SHEET ONLY)
 4' 2' 0 2' 4'
 HALF SCALE 1/4" = 1'-0"
 (11x17 SHEET ONLY)

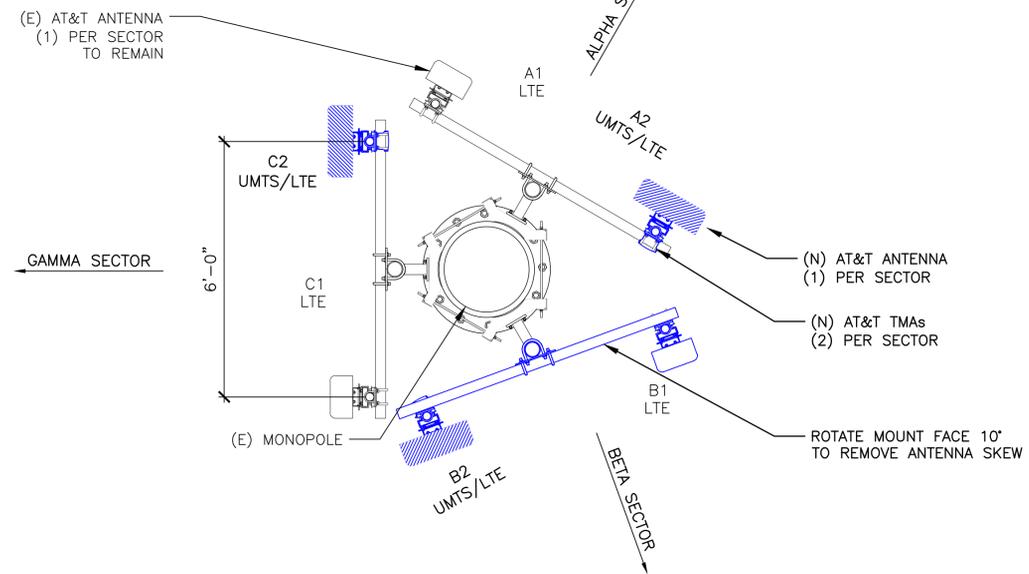

EXISTING ANTENNA CONFIGURATION

NEW ANTENNA CONFIGURATION

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW
FA #: 10093574		
REV	DATE	DESCRIPTION
A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
B	07/26/17	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS
O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS

SHEET TITLE
**EXISTING & NEW
 ANTENNA CONFIGURATION**

SHEET NUMBER

RF-1



AT&T MOBILITY
188 INVERNESS DR WEST, SUITE 400
ENGLEWOOD, CO 80112



8502 E VIA DE VENTURA, SUITE 220
SCOTTSDALE, AZ 85258



4240 E. ELWOOD ST.
PHOENIX, AZ 85040

ADDRESS
3650 BRADLEY ROAD
COLORADO SPRINGS, CO 80911

SITE NUMBER
COLO2044

SITE NAME
ACADEMY AND I-25 SOUTH


SEAL



DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW
FA #: 10093574		
REV	DATE	DESCRIPTION
A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
B	07/26/17	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS
O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS


SHEET TITLE
RF & EQUIPMENT DETAILS

SHEET NUMBER
RF-2

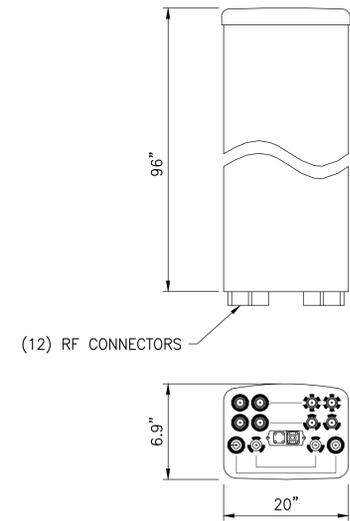

MANUFACTURER: KATHREIN
HEIGHT: 96"
WIDTH: 20"
DEPTH: 6.9"
WEIGHT: 114.6 lbs

MANUF: RAYCAP
DESC: DC/FIBER DISTRIBUTION UNIT
WEIGHT: 20.35 LBS

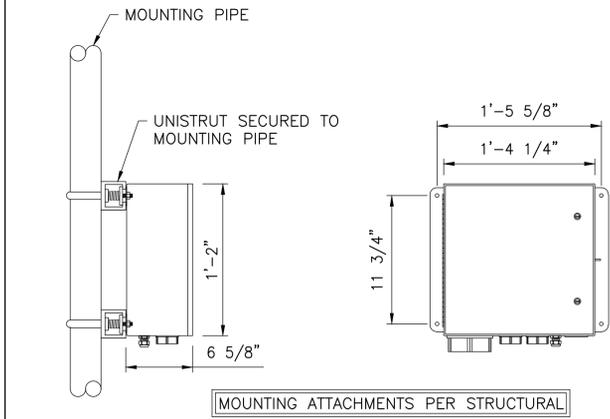


NOT USED


7 NEW ANTENNA DETAIL

6 DC & FIBER DISTRIBUTION UNIT


5

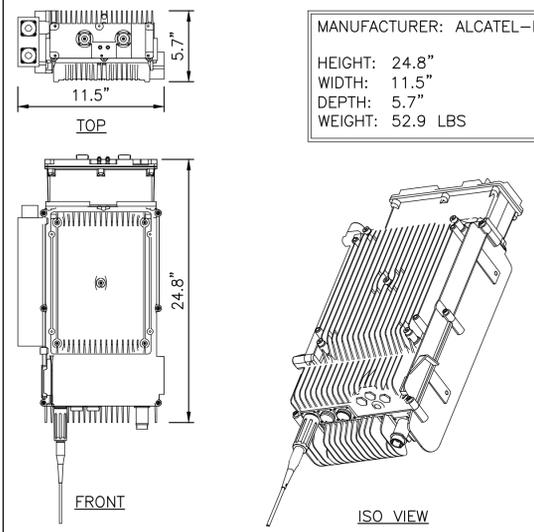

MANUFACTURER: ALCATEL-LUCENT
HEIGHT: 24.8"
WIDTH: 11.5"
DEPTH: 5.7"
WEIGHT: 52.9 LBS

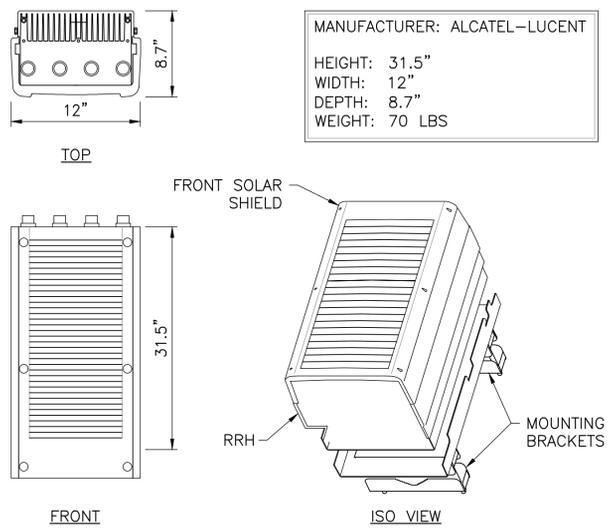

MANUFACTURER: ALCATEL-LUCENT
HEIGHT: 31.5"
WIDTH: 12"
DEPTH: 8.7"
WEIGHT: 70 LBS

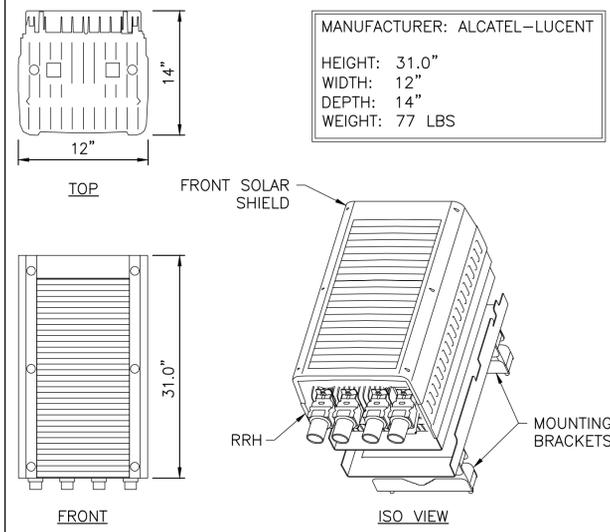

MANUFACTURER: ALCATEL-LUCENT
HEIGHT: 31.0"
WIDTH: 12"
DEPTH: 14"
WEIGHT: 77 LBS

NOT USED

4 NEW RRH DETAIL

3 NEW RRH DETAIL



2 NEW RRH DETAIL

1


SYMBOL	DESCRIPTION
	COPPER GROUND ROD
	TEST WELL
	CADWELD CONNECTION
	GROUND BAR
	MECHANICAL CONNECTION
	FIELD VERIFY & TIE INTO EXISTING GROUNDING SYSTEM

- GENERAL GROUNDING NOTES:**
- GROUNDING SHALL BE INSTALLED 6" BELOW FROST DEPTH OR 30" BELOW GRADE, WHICHEVER IS GREATER. CONFIRM FROST DEPTH WITH JURISDICTION.
 - ALL DETAILS ARE SHOWN IN GENERAL TERMS. ACTUAL INSTALLATION AND CONSTRUCTION MAY VARY DUE TO SITE SPECIFIC CONDITIONS.
 - GROUND ALL ANTENNA BASES, FRAMES, CABLE RUNS, AND OTHER METALLIC COMPONENTS USING GROUND WIRES AND CONNECT TO SURFACE MOUNTED BUS BARS. FOLLOW ANTENNA AND BTS MANUFACTURERS PRACTICES FOR GROUNDING REQUIREMENTS. GROUND COAX SHIELD AT BOTH ENDS AND EXIT FROM TOWER OR POLE USING MFR'S PRACTICES.
 - ALL GROUND CONNECTIONS SHALL BE CADWELDED. ALL WIRES SHALL BE COPPER THHN/THWN. ALL GROUND WIRE SHALL BE GREEN INSULATED WIRE ABOVE GROUND.
 - CONTRACTOR TO VERIFY AND TEST GROUND TO SOURCE. GROUNDING AND OTHER OPERATIONAL TESTING WILL BE WITNESSED BY AT&T REPRESENTATIVE.
 - REFER TO DIVISION 16 GENERAL ELECTRIC; GENERAL ELECTRICAL PROVISION AND COMPLY WITH ALL REQUIREMENTS OF GROUNDING STANDARDS.
 - ELECTRICAL CONTRACTOR TO PROVIDE DETAILED DESIGN OF GROUNDING SYSTEM, AND RECEIVE APPROVAL OF DESIGN BY AUTHORIZED AT&T MOBILITY REPRESENTATIVE, PRIOR TO INSTALLATION OF GROUNDING SYSTEM. PHOTO DOCUMENT ALL CADWELDS AND GROUND RING
 - NOTIFY CONSTRUCTION MANAGER IF THERE ARE ANY DIFFICULTIES INSTALLING GROUNDING SYSTEM DUE TO SITE SOIL CONDITIONS.

- GENERAL ROD NOTES (WHERE APPLICABLE):**
- ELECTRICAL CONTRACTOR SHALL ORDER GROUND RESISTANCE TESTING ONCE THE GROUND SYSTEM HAS BEEN INSTALLED; A QUALIFIED INDIVIDUAL, UTILIZING THE FALL OF POTENTIAL METHOD, SHOULD PERFORM THE TEST. THE REPORT WILL SHOW THE LOCATION OF THE TEST AND CONTAIN NO LESS THAN 9 TEST POINTS ALONG THE TESTING LINE, GRAPHED OUT TO SHOW THE PLATEAU.
 - 2 POINT GROUND TEST OR 3 POINT 62% TESTS WILL NOT BE ACCEPTED AS ALTERNATIVES TO THE AFOREMENTIONED GROUND TESTS. TEST SHALL BE PERFORMED WHILE THE COUNTERPOISE IS ISOLATED FROM THE A/C SYSTEM GRIDS AND EXISTING COMMUNICATIONS FACILITY.

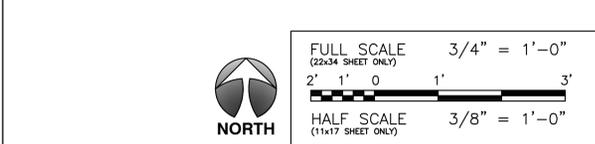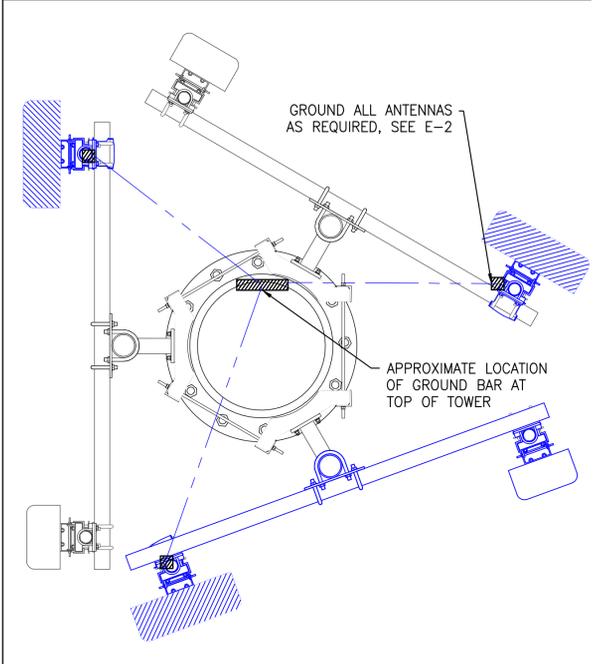

1 ANTENNA PLAN 2

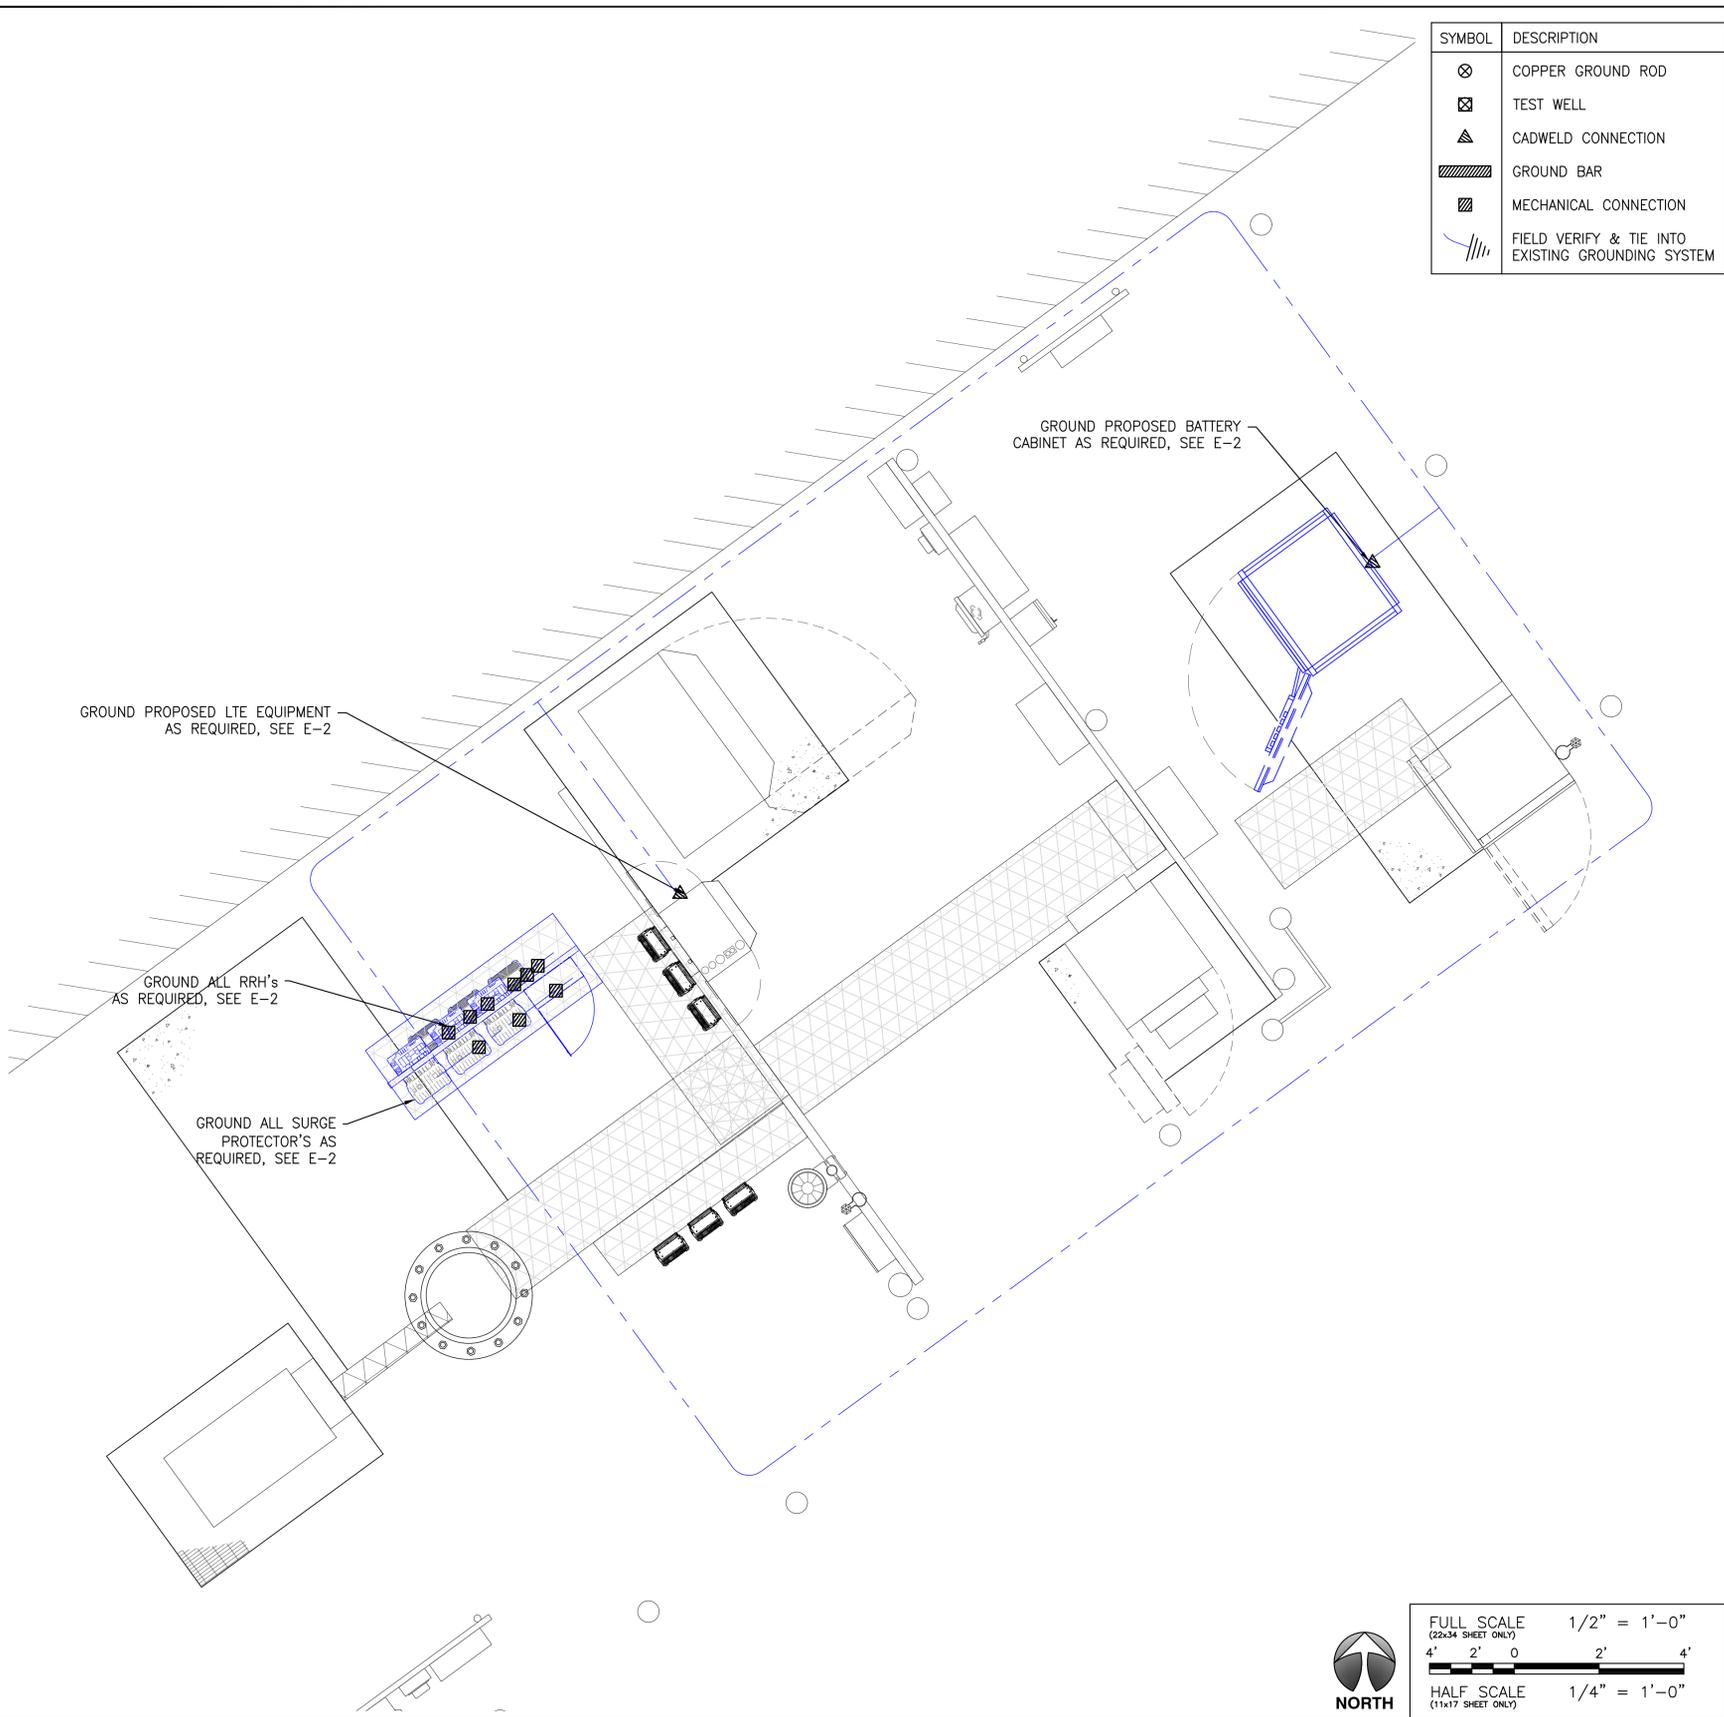

GROUNDING PLAN

at&t Mobility
 AT&T MOBILITY
 188 INVERNESS DR WEST, SUITE 400
 ENGLEWOOD, CO 80112

smartlink
 8502 E VIA DE VENTURA, SUITE 220
 SCOTTSDALE, AZ 85258

WYCO FIELD SERVICES
 here quality still counts.
 4240 E. ELWOOD ST.
 PHOENIX, AZ 85040

ADDRESS
 3650 BRADLEY ROAD
 COLORADO SPRINGS, CO 80911

SITE NUMBER
 COL02044

SITE NAME
 ACADEMY AND I-25 SOUTH




SEAL

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW	REV	DATE	DESCRIPTION
			A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
			B	07/26/17	CLIENT COMMENTS
			C	08/11/17	CLIENT COMMENTS
			O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS

FA #: 10093574

SHEET TITLE
SCHEMATIC GROUNDING PLAN

SHEET NUMBER
G-1

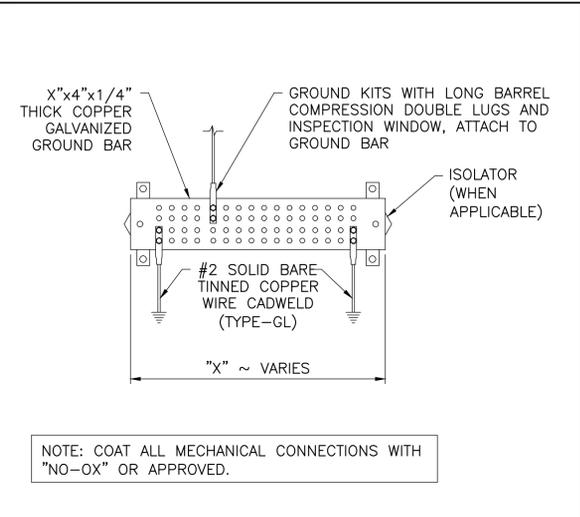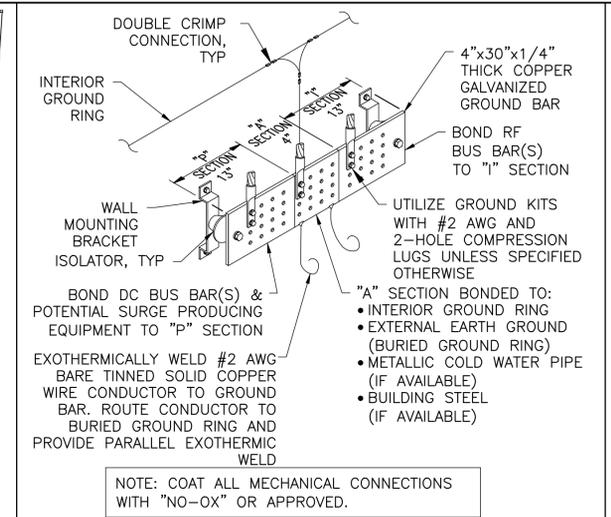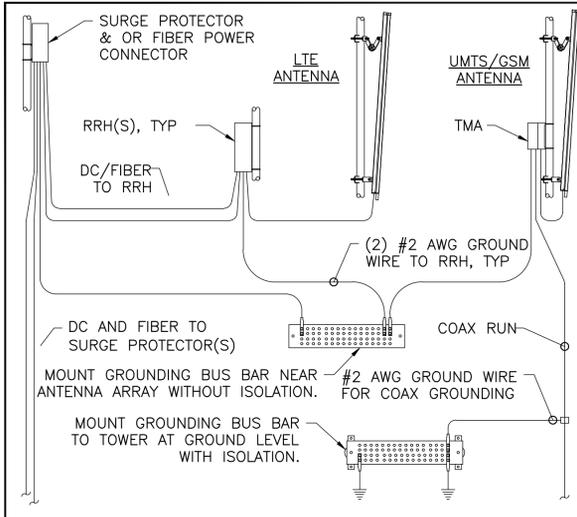

TYPE TA	TYPE VN	TYPE NC	TYPE SS
TYPE W	TYPE VS	TYPE VB	TYPE PT
TYPE GT	TYPE GY	TYPE GR	TYPE GL

NOTE: CADWELD "TYPES" SHOWN ABOVE ARE EXAMPLES - CONSULT WITH PROJECT MANAGER FOR SPECIFIC TYPES OF CADWELDS TO BE USED.

GROUNDING DETAILS 5

GROUNDING DETAILS 4

GROUNDING DETAILS 3

CAD WELD EXAMPLES 2

AT&T MOBILITY
188 INVERNESS DR WEST, SUITE 400
ENGLEWOOD, CO 80112

8502 E VIA DE VENTURA, SUITE 220
SCOTTSDALE, AZ 85258

here quality still counts.
4240 E. ELWOOD ST.
PHOENIX, AZ 85040

ADDRESS
3650 BRADLEY ROAD
COLORADO SPRINGS, CO 80911

SITE NUMBER
COL02044

SITE NAME
ACADEMY AND I-25 SOUTH

SEAL

DRAWN BY: CW	CHECKED BY: MW	APPROVED BY: MW
FA #: 10093574		
REV	DATE	DESCRIPTION
A	07/21/17	PRELIMINARY CONSTRUCTION DRAWINGS
B	07/26/17	CLIENT COMMENTS
C	08/11/17	CLIENT COMMENTS
O	09/06/17	SUBMITTAL CONSTRUCTION DRAWINGS

SHEET TITLE
GROUNDING DETAILS

SHEET NUMBER
G-2

NOT USED

1

Markup Summary

dsdsevigny (1)



Subject: Craig Dossey
Page Label: [1] COL02044_ACADEMY AND I-25
SOUTH_REV_0_FCD_09.06.17-T1
Lock: Locked
Status:
Checkmark: Unchecked
Author: dsdsevigny
Date: 12/14/2017 1:35:49 PM
Color: ■