


Add note:
Gas LESS
4.03.c.
Service Line
Clearances:
Gas service
lines should
have the
following
minimum
separations
(see also
Section
2.02c and
Table 8): 1)
Minimum
3-foot
horizontal
separation
from
property
lines, above
or below
ground
structures,
and/or other
utilities.

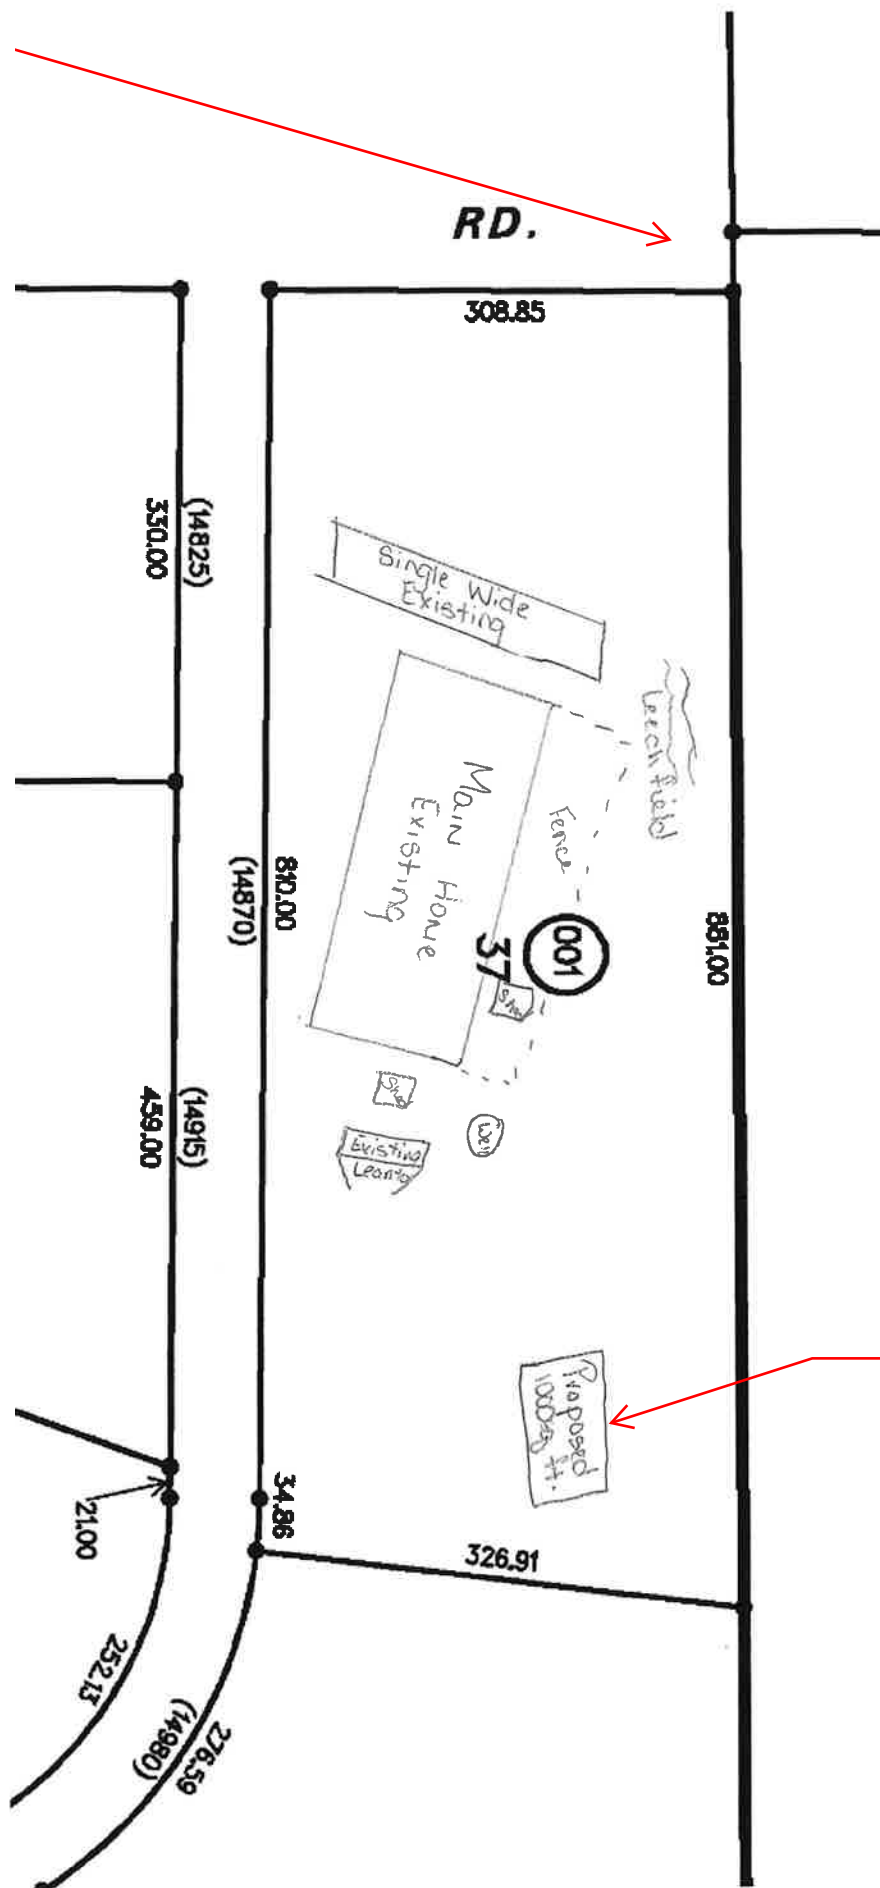

Advise if any
gas service
to be
provided