

Final Drainage Report

for the

McGehee Subdivision
El Paso County, Colorado

July 2021

Prepared for:

Mr. Dale McGehee
10958 Mount Evans Drive
Falcon, Colorado 80831

Prepared by:

Kenneth C. Harrison, P.E.
KCH Engineering Solutions
5228 Cracker Barrel Circle
Colorado Springs, Colorado 80917
719-246-4471
ksharrison5228@msn.com

PCD No. SF2111

TABLE OF CONTENTS

	Certifications and Approvals.....	3
I.	Report Purpose.....	4
II.	General Description.....	4
III.	Design Criteria and Methodology.....	6
IV.	Existing Reports, Mapping, and Information.....	9
V.	FEMA Floodplain.....	9
VI.	Hydrologic Soils Information.....	9
VII.	Existing Drainage Conditions.....	9
VIII.	Developed onsite Drainage Conditions.....	16
IX.	Existing/ Developed Runoff Comparison.....	19
X.	Full Spectrum Detention Pond.....	21
XI.	Four Step Process.....	21
XII.	Erosion Control.....	21
XIII.	Stormwater Management Plan (SWMP).....	21
XIV.	Drainage/ Bridge Fees.....	21
XV.	Summary.....	22

APPENDIX


Exhibit 1:	Location Map
Exhibit 2:	FEMA FIRM Map
Exhibit 3:	SCS Soils Map and Data
Exhibit 4:	Charts and Tables
Exhibit 5:	Calculation Sheets
Exhibit 6:	Hydrologic Calculations
Exhibit 7:	Hydraulic Calculations
Exhibit 8:	State of Colorado Water Tank Jurisdiction
Exhibit 9:	Existing Swale Photographs
Exhibit 10:	Historic Drainage Conditions (map pocket)
Exhibit 11:	Developed Drainage Conditions (map pocket)

Certifications and Approvals

Engineer's Statement

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report had been prepared according to the criteria established by El Paso County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omission on my part in preparation this report

Signature *Kenneth C. Harrison*
(Kenneth C. Harrison, P.E.)

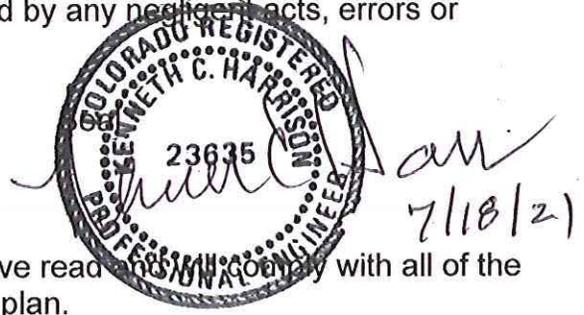

Developer/Owner Statement

I, the developer/owner, Dale D. & Stephanie B. McGehee, have read this report with all of the requirements specified in this drainage report and plan.

(Business Name)

By: *Dale D McGehee Stephanie B McGehee* July 21, 2021
(Signature) (Date)

Print Name and Title Dale D and Stephanie B McGehee

Address: 10957 Mount Evans Dr, Falcon, CO 80831

El Paso County

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

For El Paso County Engineer

Jenner Irvine, P.E.
County Engineer/ ECM Administrator

APPROVED
Engineering Department
10/26/2021 9:01:40 AM
dsdnijkamp
**EPC Planning & Community
Development Department**

Flood Plain Statement

See Section V of this report

I. Report Purpose

The purpose of this report is to evaluate the existing and developed drainage characteristics for the McGehee Residence project site. This will include:

- The evaluation of offsite conditions both upstream and downstream of the project site.
- A description of the existing offsite and onsite drainage improvements.
- Hydrologic analysis for both the existing and developed conditions. The main purpose for the analysis of the developed conditions was to demonstrate the negligible increase in runoff as a result of development.
- A hydraulic analysis was performed for both the existing and proposed culverts, the onsite swales and the Thompson Road borrow ditch.
- Recommendations regarding onsite drainage improvements.
- Research and provide a summary of information provided by the State of Colorado Water Resources regarding the existing large stock pond located on the project site.
- Discussion regarding detention and storm water quality.
- General recommendations regarding erosion control.

II. General Description

Location

The site is a 10.5-acre tract is noted as Lot 3 (the site) of the Mountain Shadows Ranch Second Phase Subdivision which was platted December 12, 1999 (*Exhibit 1, Appendix*). Mountain Shadows Ranch Second Phase Subdivision is located in the northerly section of El Paso County in the Section 19, Township 11 South, Range 65 West of the 6th Principal Meridian, El Paso County, Colorado.

Lot 3 of the Mountain Shadows Ranch Second Phase Subdivision consists of approximately 10.5-acres. It is proposed to subdivide the site into 2 lots. The sizes of these lots are:

- Lot 1: 5.0-acres
- Lot 2: 5.5-acres

The property to the north of the site is unplatted. The property to the west and east of the site is Mountain Shadows Ranch Second Phase Lots 1 and 2. The property to the east of the site is the Thompson Road right-of-way with a varying right-of-way width.

Topography

The topographic characteristics of the site were determined from GIS mapping provided by El Paso County. The majority of the runoff from the site is collected by a natural swale that traverses the site in a west to east to west direction. The swale is stable and vegetated with natural grasses and a few bushes and trees. There are several stock ponds located along the swale. The approximate

locations of these ponds are shown on the Drainage Map included in the map pocket of this report.

The high point of the swale (S1) located west and offsite of the site is located approximately 2,200 feet west of the site's westerly property line. The average slope of the swale west of the site is 4.6%. Despite the relatively steep slope the existing swale (S1) appears to be stable with only minimal signs of erosion. The average slope of the swale (S2) within the site boundaries of Subbasin A is approximately 3.6%. Swale S2 outfalls into a large stock pond at DP5. The pond's embankment is located approximately 130 feet west of the easterly property line which is also the westerly right-of-way line of Thompson Road. It appears that the pond is typically dry since the vegetation throughout the bottom and sides of the pond is well established. The swale located in the bottom of the existing stock pond is noted as Swale S3. It extends from DP5 to DP6. The average slope is 8.3%. The swale is heavily vegetated with natural grasses and appears to be very stable.

The embankment of the stock pond is approximately 12 feet high. The outlet of the pond consists of a 24-inch corrugated metal pipe (STR1). The water from the pond is routed to the 30-inch culvert (STR2) under Thompson Road via Swale 4 (S4). Once under Thompson Road the water is routed in a northeasterly direction in another stable grass-lined swale (S8). The following physical characteristics of S8 were obtained from the topographic map used for the Drainage Maps;

- Bottom Width (average): 15ft to 25ft
- Side slopes (average): 6 to 1
- Slope (average): 5%
- Vegetation: Thick grass cover with negligible signs of erosion

Based on the physical characteristics of Swale 8, the stability of the swale based on visual observations, and the negligible increase in flows as a result of development ($Q_5 = 0.5$ cfs, $Q_{100} = 0.6$ cfs), it is accurate to state that no negative impacts will result on downstream facilities as a result of the increase in flows. A detailed hydraulic analysis of swale east of the Thompson Road crossing is beyond the scope of this report. Also, a drainage report for Mountain Shadow Ranch was not available.

Additional runoff from small acreage sub basin OS9 located along Thompson Road is collected by borrow ditch S6 that carries the water to the culvert under Thompson Road..

Additional runoff from OS8 is collected by another section of the Thompson Road borrow ditch (S5) located south of the culvert at DP14.

Only preliminary hydraulic analyses for the swales and culverts discussed above was performed to obtain a "preliminary" estimation of the suitability of each

drainage facility. A complete analysis of each drainage facility is outside the scope of this report since the increase in the runoff, based on the developed conditions, is only negligible and will not have an impact on the existing facilities.

Structures (Existing and Proposed)

There are three (3) **existing** drainage culverts (see Existing Conditions Drainage Plan) and one (1) **proposed** culvert see (Developed Conditions Drainage Plan) to be installed. They are as follows:

- The **existing** 24 " culvert, noted as STR1, under the existing large stock pond.
- The **existing** 30", noted as STR2, is located under Thompson Road approximately 270 feet south of the northeasterly property corner. All of the runoff from the site drains to this culvert.
- The **existing** 18" culvert, noted as STR3, under the farm access road off of Thompson Road. This is located approximately 225-feet north of the southeasterly property corner.
- The **proposed** culvert, noted as (STR4), is proposed under the proposed driveway access to be constructed to access the proposed residences. This culvert is to be installed at approximately 150-feet south of the northeasterly property corner (see Developed Conditions Map).

III. Design Criteria and Methodology

a. Design Manuals

Applicable excerpts from the following manuals are included in the Appendix of this report (*Exhibit 4, Appendix*) El Paso County Drainage Criteria Manual (EPCDCM), dated September 30, 1990, Revised July, 2019

- El Paso County Engineering Criteria Manual (EPCECM), Revised 2020
- Colorado Springs Drainage Criteria Manuals, Volume 1 and 2, dated May, 2014
- Urban Drainage and Flood Control Manual, Volumes 2 and 3, dated August 2018
- CDOT Erosion Control Field Handbook, dated April 20, 2017
- GIS mapping obtained from El Paso County. El Paso County Information Technologies at 325 South Cascade Avenue, Colorado Springs, 80903.

b. Specific Criteria

- Design storms

The design storms are as follows:

Minor storm: 5 year

Major storm: 100 year

Any recommended drainage facilities are sized for the 5-year storm event.

Routing of the 100-storm event is analyzed and discussed regarding the safe conveyance to offsite facilities.

- Drainage Areas

Areas for the offsite and onsite sub basins were delineated from available topographic GIS mapping obtained from El Paso County. El Paso County Information Technologies at 325 South Cascade Avenue, Colorado Springs, 80903.
- Runoff Estimation
 - Rational Method: This method was used to determine runoff estimates since the Offsite and onsite drainage basins are less than 130 acres.
 - Intensity-Duration-Frequency (IDF) curves were obtained from the CSDCM (*Appendix, Exhibit 4*)
 - Time of concentration was determined using the equations provided in the EPC Drainage Criteria Manual (*Appendix, Exhibit 4*). The time of concentration values shown in the "Area Drainage Summary" tables (*Appendix, Exhibit 7*) reflect the time it takes for all of the runoff from each individual sub basin to reach the DP for each sub basin. The time of concentration used to determine the total runoff for the entire site was determined from the cumulative time for water to travel from DP1 to DP7. This was based on the assumed velocity in the existing swale segments 1 through 4. This is summarized in the "Surface Routing Summary" table in *Exhibit 7 of the Appendix*.
- Drainage swale and borrow ditch sizing

The only swale that drains this site is located approximately in the middle and it drains the site in a west to east direction. This entire swale is broken into segments, S1 through S4. The swale drains all the offsite and onsite runoff to an existing stock pond noted as STR1. The swale was evaluated for both the minor 5-year storm and the major 100-year storm events. The swale is a stable natural swale lined with native grasses with a few bushes and trees.
- The Froude Numbers are shown for both the 5 year and the 100-year storm events for information purposes only. By definition, values under 1.0 indicate sub critical flow which is stable. Values above 1.0 indicate super critical flow which can cause a substantial amount of erosion. Values from 0.9 to 1.1 are considered to be unstable. The Froude numbers indicated in this report are determined from a substantial number of assumptions regarding the physical characteristics of each swale. These characteristics were determined based on the topography made available from El Paso County. Additional field information is required in order to obtain a more accurate determination of the stability of each swale section. Based on

visual observations, all swale sections appear to be relatively stable with only a minimal amount of erosion and down cutting.

- **Stock Ponds (see Appendix, Exhibit 8)**

There is a total of four (4) stock ponds located along the existing swale. Three (3) of the stock ponds are small and therefore non-jurisdictional. The ponds located east of the largest pond are minor with embankment heights between 2 to 4 feet. The furthest easterly one is the largest and jurisdictional. Based on visual observations they appear to be stable with permanent stands of native vegetation. Evaluation of these ponds are outside the scope of this report. The State of Colorado Water Resources Department was contacted to obtain information regarding the largest of these ponds. This information is included in Exhibit 8 of the Appendix. It is also assumed that the property owner owns the ponds as well.

- **Culverts**

- The **existing** 24 " culvert, noted as STR1, functions as the outfall to the large stock pond.
- The **existing** 30", noted as STR2, is located under Thompson Road approximately 270 feet south of the northeasterly property corner. All of the runoff from the site drains to this culvert.
- The **existing** 18" culvert, noted as STR3, under the farm access road off of Thompson Road. This is located approximately 225-feet north of the southeasterly property corner.
- The **proposed** culvert, noted as (STR4), is proposed under the proposed driveway access to be constructed to access the proposed residences

The culvert under Thompson Road was evaluated as follows:

- Headwater to Depth Ratio = 1.5 for the 5-year storm
- One lane open along Thompson Road for the 100-year storm. Since this criteria typically produces substantial erosion at the outlet the allowable velocity in the culvert was limited to no greater than 10 fps.

It is understood that the Owner will not be required to install any erosion control improvements at the outfall of the 30" culvert under Thompson Road since the negligible increase in runoff ($Q_5 = 0.5$ cfs, $Q_{100} = 0.6$ cfs) is not significant enough to have a negative impact on the hydraulic and/or physical characteristics/ conditions of the existing culvert.

- **Detention/ Water Quality Pond**

A full spectrum detention pond is not required for this development. Reasons will be discussed in a subsequent section of this report. The

reasons are based on El Paso County criteria as well as Colorado State criteria.

- **Erosion control**

The following facilities are anticipated to be required along the proposed driveway located as shown on the Developed Conditions Drainage Plan:

- Erosion Control Blankets
- Silt fences
- Staked hay bales
- Erosion control fabric
- Erosion control logs

IV. EXISTING REPORTS, MAPPING AND INFORMATION

No drainage reports have been prepared for the areas adjacent to the project site

V. FEMA FLOODPLAIN

The project site is located in FEMA map # 08041CO305G (eff 12/7/2018) (*Appendix, Exhibit 2*). The entire site is located outside the 100-year floodplain in Zone X which is an "Area of Minimal Disturbance" for which there are no special requirements for the construction of commercial or industrial structures.

VI. HYDROLOGIC SOILS INFORMATION

The hydrologic soils groups were obtained from the USDA National Resource Conservation Service website for soils types in El Paso County, Colorado (*Appendix, Exhibit 3*). The soils are identified as follows:

- a. **Peyton Sandy Loam (Soil ID 67)** which have the following characteristics:
 - Well drained
 - Runoff Class; Medium
 - Depth to water table: >80 inches
 - Frequency of flooding: none
 - Frequency of ponding: none
 - Hydrologic Soil Group: B

A detailed description of each of the type soil is included in *Appendix Exhibit 3*.

VII. EXISTING DRAINAGE CONDITIONS

- a. **Existing Drainage Reports**

The drainage report for Mountain Shadows Ranch Second Phase Subdivision was not available through the EDARP service from El Paso County.

- b. **Offsite Drainage Areas for Existing Conditions**

- i. The hydrologic characteristics for both the existing and developed conditions of the site are included in the Appendix (*Exhibit 6*). The hydraulic conditions for the existing swales and the existing and the

proposed culverts are summarized in the tables included in the Appendix (*Exhibit 7*).

ii. **Design Point 1**

Description

DP1 is the collection point for runoff from Sub-basin OS1 (34.1 acres). This Sub-basin is vegetated with natural grasses with a few bushes and trees located along the flowline of the existing swale (S1). All the runoff is collected by an existing natural and stable swale (S1) that basically bisects the site in a west to east direction. The swale routes the water to DP1 located on the westerly property line 300-feet south of the northwesterly property corner of the study tract. The portion of the sub basin to the north of the swale slopes from north to south at an average slope between 4.0% and 7%.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS1 at DP1 for the existing conditions is as follows:

- Drainage Area = 34.1 acres
- Runoff Coefficients: 5 year = 0.09, 100 year = 0.36
- Time of Concentration: 23.2 minutes
- Runoff: 5 year = 8.7 cfs, 100 year = 58.5 cfs

Hydraulic Summary for Offsite Swale 1 (S1) Calc Sheets CS1, CS2.

- Runoff: 5 year = 8.7 cfs, 100 year = 58.5 cfs
- Average Bottom width: 5 feet
- Average Side Slope ratio: 20 to 1
- Average Slope: 4.7%
- Velocity: 5-year = 2.9 fps, 100 year = 4.9 fps
- Depth of Flow = 5-year = 0.3 ft, 100 year = 0.7 ft.
- Froude No.= 5-year = 1.21 (Supercritical), 100 year = 1.38 (Super critical)

iii. **Design Point 2 (offsite)**

Description

DP2 is the collection point for runoff from Sub-basin OS3 (0.6 acres). Runoff at this DP flows to the south and enters swale 1 near DP1. The Sub-basin slopes from north to south at an average grade of 10%. Sub-basin OS3 is vegetated with natural grasses. All the runoff is collected by an existing natural and stable swale (S1) that basically bisects the Sub-basin in an east to west direction.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS3 at DP1 for the existing conditions is as follows:

- Drainage Area = 0.6 acres
- Runoff Coefficients: 5 year = 0.08, 100 year = 0.35
- Time of Concentration: 15 minutes
- Runoff: 5 year = 0.2 cfs, 100 year = 1.2 cfs

iv. Design Point 3 (offsite)

Description

DP3 is the collection point for runoff from Sub-basin OS4 (0.6 acres). Runoff at this DP flows to the north and enters swale 1 near DP1. The Sub basin slopes from south to north at an average grade of 8%. Sub-basin OS4 is vegetated with natural grasses. All the runoff is collected by the existing natural and stable swale (S1).

Hydrologic Summary

The hydrologic characteristics of the runoff from OS4 at DP3 for the existing conditions is as follows:

- Drainage Area = 0.6 acres
- Runoff Coefficients: 5 year = 0.17, 100 year = 0.041
- Time of Concentration: 13.3 minutes
- Runoff: 5 year = 0.4 cfs, 100 year = 1.5 cfs

v. Design Point 4 (offsite)

Description

Runoff from Sub-basin OS7 (3.6 acres) sheet flows onto onsite Sub-basin A. There is not a specific collection point. DP4 only represents the total amount of sheet flow that enters onsite Sub-basin A. This DP is also located at the entrance to the large stock pond. Runoff at this DP flows to the north and enters swale 2 (S2) at DP4. Sub basin OS7 slopes from south to north at an average grade of 8.3%. Sub basin OS7 is vegetated with natural grasses. All the runoff is collected by the existing natural and stable swale (S2) which outfalls into the stock pond.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS7 at DP4 for the existing conditions is as follows:

- Drainage Area = 3.6 acres
- Runoff Coefficients: 5 year = 0.12, 100 year = 0.38
- Time of Concentration: 15.5 minutes

- Runoff: 5 year = 1.5 cfs, 100 year = 8.0 cfs

The hydraulic characteristics for the swale that drains this study site are summarized in the Onsite Drainage Areas for Existing Conditions section of this report in order to account for all of the upstream runoff that contributes storm water to swale 2.

v. Design Point 5 (see Onsite Drainage Areas for Existing Conditions)

vi. Design Point 6 (see Onsite Drainage Areas for Existing Conditions)

vii. Design Point 7 (see Onsite Drainage Areas for Existing Conditions)

viii. Design Point 8 (offsite)

Description

Runoff from sub basin OS5 (0.4 acres) sheet flows onto onsite Sub-basin A. There is not a specific collection point. DP8 only represents the total amount of sheet flow that enters onsite Sub- basin A. Sub-basin OS5 slopes from north to south to north at an average grade of 1.2%. Sub basin OS5 is vegetated with natural grasses.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS5 at DP8 for the existing conditions is as follows:

- Drainage Area = 0.4 acres
- Runoff Coefficients: 5 year = 0.08, 100 year = 0.35
- Time of Concentration: 10.9 minutes
- Runoff: 5 year = 0.1 cfs, 100 year = 0.9 cfs

ix. Design Point 9 (offsite)

Description

Runoff from Sub-basin OS6 (0.9 acres) sheet flows onto onsite Sub-basin B. There is not a specific collection point for the runoff from Sub-basin OS6. DP9 only represents the total amount of sheet flow that enters onsite sub basin B. Sub-basin OS6 slopes from north to south to north at an average grade of 5.0%. Sub-basin OS6 is vegetated with natural grasses.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS5 at DP8 for the existing conditions is as follows:

- Drainage Area = 0.9 acres
- Runoff Coefficients: 5 year = 0.08, 100 year = 0.35
- Time of Concentration: 15.2 minutes
- Runoff: 5 year = 0.3 cfs, 100 year = 1.9 cfs

x. Design Point 10 (offsite)

Description

Runoff from Sub-basin OS2 (10.3 acres) sheet flows into the stock pond from the south. There is no specific collection point. DP10 only represents the total amount of sheet flow that enters the stock pond. Sub-basin OS2 slopes from south to north at an average grade of 7.3%. Sub-basin OS2 is vegetated with natural grasses. All the runoff is collected by the existing stock pond.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS2 at DP10 for the existing conditions is as follows:

- Drainage Area = 10.3 acres
- Runoff Coefficients: 5 year = 0.10, 100 year = 0.36
- Time of Concentration: 17.9 minutes
- Runoff: 5 year = 3.3 cfs, 100 year = 20.5 cfs

xi. Design Point 11 (offsite)

Description

Runoff from Sub-basin OS8 (1.4 acres) sheet flows into an existing grass lined swale (S4) that routes the storm water from the outlet of the stock pond to the existing 30-inch culvert under Thompson Road. There is no specific collection point from OS8. DP11 only represents the total amount of sheet flow that enters swale S4. Sub-basin OS8 slopes from south to north at an average grade of 5.5%. Sub-basin OS8 is vegetated with natural grasses. All the runoff is collected by the existing swale (S4).

Hydrologic Summary

The hydrologic characteristics of the runoff from OS8 at DP11 for the existing conditions is as follows:

- Drainage Area = 1.4 acres
- Runoff Coefficients: 5 year = 0.08, 100 year = 0.35
- Time of Concentration: 14.1 minutes
- Runoff: 5 year = 0.4 cfs, 100 year = 3.0 cfs

xii. Design Point 12 (offsite)

Description

Runoff from Sub-basin OS10 (0.5 acres) is collected by the westerly borrow ditch (S4) along Thompson Road. The high point of the borrow ditch is located approximately 500-feet south of the culvert under Thompson Road at DP14. The water flows from south to north and joins the water flowing from the north from Sub-basin OS9. The water is then routed under Thompson Road via a 30-inch corrugated metal culvert at DP14.

Sub-basin OS10 is composed of native vegetation and asphalt roadway for Thompson Road. All the runoff is collected by the existing borrow ditch (S5) which routes the water under Thompson Road via a 30-inch CMP culvert.

Hydrologic Summary

The hydrologic characteristics of the runoff from OS10 at DP12 for the existing conditions are as follows:

- Drainage Area = 0.5 acres
- Runoff Coefficients: 5 year = 0.57, 100 year = 0.72
- Time of Concentration: 5.3 minutes
- Runoff: 5 year = 1.5 cfs, 100 year = 3.1 cfs

Hydraulic Summary for Offsite Swale 5 (S5) Calc Sheets 3-4,

- Runoff: 5 year = 1.5 cfs, 100 year = 3.1 cfs
- Average Bottom width: 2 feet
- Average Side Slope ratio: 3 to 1
- Average Slope: 5%
- Velocity: 5-year = 2.7 fps, 100 year = 3.5 fps
- Depth of Flow = 5-year = 0.2 ft, 100 year = 0.3 ft.
- Froude No.= 5-year = 1.2 (Supercritical), 100 year = 1.28 (Super critical)
- Swale Condition: the swale is in good and stable condition, with minimal erosion, despite the super critical flow range. This is due to the low velocities and the heavy vegetation.

xiii. Design Point 13 (offsite)

Description

Runoff from Sub-basin OS9 (0.4 acres) is collected by the westerly borrow ditch (S6) for Thompson Road. The high point of the borrow ditch is located approximately 550-feet north of the culvert under Thompson Road at DP14. The water flows from north to the south and joins the water flowing from Sub-basin OS10. The water then is

routed under Thompson Road via a 30-inch corrugated metal culvert at DP14.

Sub-basin OS9 is composed of native vegetation and asphalt roadway for Thompson Road. All the runoff is collected by the existing borrow ditch (S6) which routes the water under Thompson Road via a 30" CMP culvert

Hydrologic Summary

The hydrologic characteristics of the runoff from OS9 at DP13 for the existing conditions is as follows:

- Drainage Area = 0.4 acres
- Runoff Coefficients: 5 year = 0.70, 100 year = 0.81
- Time of Concentration: 6.1 minutes
- Runoff: 5 year = 1.4 cfs, 100 year = 2.6 cfs

Hydraulic Summary for Offsite Swale 6 (S6) Calc Sheets CS13, 14.

- Runoff: 5 year = 1.4 cfs, 100 year = 2.6 cfs
- Average Bottom width: 2 feet
- Average Side Slope ratio: 3 to 1
- Average Slope: 5.5%
- Velocity: 5-year = 2.8 fps, 100 year = 3.4 fps
- Depth of Flow = 5-year = 0.2 ft, 100 year = 0.3 ft.
- Froude No.= 5-year = 1.27 (Supercritical), 100 year = 1.32 (Super critical)
- Swale Condition: the swale is in good and stable condition, with minimal erosion, despite the super critical flow range. This is due to the low velocities and the heavy vegetation.

Preliminary Hydraulic Summary for Proposed Driveway Culvert 150 south of NE Property Corner (Calc Sheet 9)

- Runoff: 5 year = 1.4 cfs, 100 year = 2.6 cfs
- Culvert Size: 18- inches
- Conditions: inlet control
Headwater to Depth Ratio: 5 year = neg, 100 year = 0.6
- Depth at inlet
5 year = neg, 100 year = 0.9 ft

xiv. Design Point 14 (offsite)

Description

DP 14 is located at the entrance to the **following** section of this report (Onsite Drainage Areas for Existing Conditions, Sub Section iv).

VIII. DEVELOPED ONSITE DRAINAGE CONDITIONS

Supercritical vs. Subcritical Flow

Sub critical flow is characterized by relatively stable energy flow. Supercritical flow is characterized by unstable flows that will typically go "through" a hydraulic jump in order to dissipate energy which can typically cause a lot of erosion. The state of flow is determined by the Froude number. A number less than 1 is considered subcritical and above 1 critical. The flow regime for the majority of the swale conditions evaluated were determined to be supercritical. Since there is very little erosion in the existing primary swale that is located in the center of the site, it is assumed that the flow is fairly stable even under the major storm event. It is assumed that is because the hydraulic program that was used only assumed that the flow was "straight" where in actuality it meanders through the "valley". Photographs of the existing swale are included in Exhibit 9 of the Appendix.

i. Design Point 5 (Onsite)

Description

Runoff from Sub-basins OS1 (34.1 acres), OS3 (0.6 acres), OS4 (0.6 acres), OS5 (0.4 acres), OS7 (3.6 acres) and onsite Sub-basin A (6.3 acres), resulting in a total drainage area of 45.6 acres, is collected at DP5 which is located at the entrance to the existing stock pond. The DP is also located where the existing swale (S2) routes the water outside the site along the southerly property line. The swale (S2) is grass lined and stable with only a minimal amount of erosion.

Hydrologic Summary

The hydrologic characteristics of the runoff DP1 for the existing conditions is as follows:

- Drainage Area = 45.6 acres
- CA: 5 year = 4.16, 100 year = 16.31
- Time of Concentration: 27 minutes
- Runoff: 5 year = 11.0 cfs, 100 year = 72.2 cfs

Hydraulic Summary for Onsite Swale 2 (S2) (Calc Sheets 5 and 6)

- Runoff: 5 year = 11.0 cfs, 100 year = 72.2 cfs
- Average Bottom width: 5 feet
- Average Side Slope ratio: 18
- Average Slope: 5.5%
- Velocity: 5-year = 3.4 fps, 100 year = 5.5 fps
- Depth of Flow = 5-year = 0.3 ft, 100 year = 0.7 ft.
- Froude No. = 5-year = 1.32 (Supercritical), 100 year = 1.5 (Supercritical)

ii. **Design Point 6 (Onsite)**

Description

DP6 is located at the 24-inch outlet for the stock pond. Runoff from Sub-basins B (3.5 acres) and OS2 (10.3 acres) and OS6 (0.9 acres) combines with runoff at DP 5 for a total contributing drainage acreage of 60.3 acres. The water from this acreage is collected in the stock pond and is routed under the pond embankment via a 24-inch CMP. The water in Swale 2 is routed to the south of the site's southerly property line along the bottom of the stock pond. Swale 2 swale routes the natural "low flow" section when there is no water in the pond. This pond may provide some type of "detention" should the flow into it become substantial. The structural and hydraulic evaluation of the stock pond is beyond the scope of this report.

Hydrologic Summary

The hydrologic characteristics of the runoff at DP6 for the existing conditions is as follows:

- Drainage Area = 60.3 acres
- CA: 5 year = 5.47, 100 year = 21.32
- Time of Concentration: 28.4 minutes
- Runoff: 5 year = 14.0 cfs, 100 year = 91.7 cfs

Hydraulic Summary for Offsite Swale 3 (S3) (Calc Sheets 7 and 8)

- Runoff: 5 year = 14 cfs, 100 year = 91.7 cfs
- Average Bottom width: 5 feet
- Average Side Slope ratio: 15
- Average Slope: 8.3%
- Velocity: 5-year = 4.4 fps, 100 year = 7.2 fps
- Depth of Flow = 5-year = 0.3 ft, 100 year = 0.8 ft.
- Froude No.= 5-year = 1.66 (super critical), 100 year = 1.89 (super critical)

Preliminary Hydraulic Summary for Existing culvert at DP6 (Calc Sheet 9)

- Runoff: 5 year = 14 cfs, 100 year = 91.7 cfs
- Culvert Size: 24- inches
- Conditions: inlet control
- Headwater to Depth Ratio: 5 year = 1.1, 100 year = out of range and roadway overtopping.

iii. **Design Point 7 (Onsite)**

Description

DP7 is located on the easterly property line between the pond outlet and the culvert under Thompson Road. DP7 is located approximately

530-feet north of the southeast property corner. Runoff from Sub-basins C (0.8 acres) and OS8 (1.4 acres) join with runoff at DP6 (60.3 acres) resulting in a total drainage area of 62.5 acres.

Hydrologic Summary

The hydrologic characteristics of the runoff at DP7 for the existing conditions is as follows:

- a. Drainage Area = 62.5 acres
- b. CA: 5 year = 5.71, 100 year = 22.37
- c. Time of Concentration: 29 minutes
- d. Runoff: 5 year = 14.5 cfs, 100 year = 95 cfs

Hydraulic Summary for Offsite Swale 3 (S4) (Calc Sheets 11 and 12)

- a. Runoff: 5 year = 14.5 cfs, 100 year = 95 cfs
- b. Average Bottom width: 5 feet
- c. Average Side Slope ratio: 10
- d. Average Slope: 8.3%
- e. Velocity: 5-year = 4.8 fps, 100 year = 8.0 fps
- f. Depth of Flow = 5-year = 0.4 ft, 100 year = 0.9 ft.
- g. Froude No.= 5-year = 1.69 (super critical), 100 year = 1.92 (super critical)

iv. Design Point 14 (Onsite)

Description

DP 14 is located at the upstream end of the 30" CMP culvert under Thompson Road. Runoff from OS9 (0.4 acres) and OS10 (0.5 acres) join the runoff at DP7 (62.5 acres) resulting in a total acreage of 63.4 acres.

Hydrologic Summary

The hydrologic characteristics of the runoff at DP14 for the existing condition is as follows:

- a. Drainage Area = 63.4 acres
- b. CA: 5 year = 6.28, 100 year = 23.05
- c. Time of Concentration: 29 minutes
- d. Runoff: 5 year = 15.9 cfs, 100 year = 97.9 cfs

Preliminary Hydraulic Summary for Existing culvert at DP14 (Calc Sheet 10)

- a. Runoff: 5 year = 15.9 cfs, 100 year = 97.9 cfs
- b. Culvert Size: 30-inches
- c. Conditions: inlet control
- d. Headwater to Depth Ratio: 5 year = 0.76, 100 year = >6.0
- e. Upstream Depth: 5 year = 1.9 ft, 100 year = roadway overtopping

IX. EXISTING/DEVELOPED RUNOFF COMPARISON

Offsite Sub-basin Characteristics for Developed Conditions

There are no plans to develop the tracts located upstream and/or adjacent to the project site. Therefore, the hydrologic conditions for the offsite sub basins will remain the same, as described *Section VII*.

i. Onsite Sub-basin Characteristics for Developed Conditions

The development of this site consists of the subdivision of the entire 10.495-acre into one 5-acre parcel (Lot 2) and a 5.5-acre parcel (Lot 1). Lot 1 is located in Sub-basin B and Lot 2 is located in Sub-basin A. The development includes a single-family residence, area landscaping, and a gravel driveway. The hydrologic parameters used to estimate runoff were determined based on the following parameters;

- **Drainage Area Sub basins:**
 - The only sub basins that will change to reflect proposed development will be onsite Subbasins B (Lot 1) and A (Lot 2).
- **Runoff Coefficients**
 - Gravel Driveway: Lot 1= 250 ft. Lot 2 = 420 feet; C5 = 0.59, C100 = 0.70
 - The driveways were conservatively sized at 20 feet wide.
 - The roof of each house was conservatively estimated to be 3,000 sf each with the following coefficients: C5 = 0.90, C100 = 0.96
 - It was conservatively assumed that ½ acre would be landscaped resulting in the following coefficients; C5 = 0.12, C100 = 0.39
 - The remaining area of each lot would remain as the native vegetation resulting in the following coefficients: C5 = 0.08, C100 = 0.35.
- **Time of Concentration**
 - The time of concentration for each sub-basin remains the same despite development since the time of concentration is defined as the time it takes for runoff from the farthest “corner” of the contributing drainage sub-basin to reach the design point.
- **Rainfall Intensity**
 - The rainfall intensity for each sub-basin remains the same since the time of concentration remains the same.

- Estimated Runoff
 - Based on the above assumptions, runoff for the minor (5 year) and major (100 year) storms were estimated for each sub-basin.

ii. **Runoff Comparison Summary**

a. **Drainage Area**

The areas are as follows:

- Lot 1: 5.000 acres (portion of sub basin A)
- Lot 2: 5.495 acres (portion of sub basin B)

b. **Composite Runoff Coefficients**

Exist Conditions

- Lot 1(sub basin B): C5 = 0.08, C100 = 0.35
- Lot 2 (sub basin A): C5 = 0.08, C100 = 0.35

Developed Conditions

- Lot 1(sub basin B): C5 = 0.11, C100 = 0.37
- Lot 2 (sub basin A): C5 = 0.11, C100 = 0.37

c. **Rainfall Intensity**

- i. The Rainfall Intensity is the same for both the existing and proposed conditions.

d. **Estimate Runoff for each Developed Lot**

Runoff from each lot will sheet flow to swales (S2, S3, S4) and the stock pond. The runoff for the existing and developed conditions are summarized as follows:

- i. Lot 1 (sub basin B)
 - 1. Existing Conditions: Q5 = 1.8 cfs, Q100 = 13.3 cfs
 - 2. Developed Conditions: Q5 = 2.5 cfs, Q100 = 14.1 cfs
- ii. Lot 2 (sub basin A)
 - 1. Existing Conditions: Q5 = 1.2 cfs, Q100 = 8.9 cfs
 - 2. Developed Conditions: Q5 = 1.9 cfs, Q100 = 11.1 cfs

e. **Total Discharge at Thompson Road Culvert**

Refer to Surface Routing Summary for table using the Times of Concentration applicable to determining cumulation runoff in the channel located in the center of the site.

- i. Existing Conditions: Q5 = 15.9 cfs, Q100 = 97.9 cfs
- ii. Developed Conditions: Q5 = 16.4 cfs, Q100 = 98.5 cfs

As demonstrated, the increase in runoff, as a result of development, is negligible and therefore has little, if any, impact on the existing facilities.

X FULL SPECTRUM DETENTION POND

Criteria

Reference is made to El Paso County Engineering Criteria Manual, Appendix 1, Page 1.18-19. According to El Paso County criteria a Water Quality Capture Volume (WQCV) pond is not required for lots 2.5 acres or larger. Also, since the area of disturbance is less than 1- acre a WQCV pond is not required.

The disturbed are was determined as follows:

- Gravel Drive: Lot 1 = 250 ft by 20 ft = 5,000 sf; Lot 2: 420 frt by 20 ft = 8,400 sf
- Residence footprint: Lot 1 = 3000 sf; Lot 2 =3000 sf
- Totals disturbed area: Lot 1 = 8,000 sf, Lot 2 = 8,820 sf, Total = 16,820 sf

XI FOUR STEP PROCESS

Even though the 4-step process is not required for this project the following are descriptions of the steps that are being taken to address the 4-step process.

Large Lot Single Family Sites.

A single-family residential lot, or agricultural zoned lands, greater than or equal to 2.5 acres in size per dwelling and having a total lot impervious area of less than 10 percent. A total lot imperviousness greater than 10 percent is allowed when a study specific to the watershed and/or MS4 shows that expected soil and vegetation conditions are suitable for infiltration/filtration of the WQCV for a typical site, and the permittee accepts such study as applicable within its MS4 boundaries. The maximum total lot impervious covered under this exclusion shall be 20 percent. In accordance with section 4.0 of chapter 1 of the El Paso County ECM Appendix 1.7.1, the four-step process applies to "projects with construction activities that disturb 1 acre or greater or that disturb less than 1 acre but are part of a larger plan of development or sale". Therefore, the four-step process does not apply to this development.

Step 1: Reduce runoff by disconnecting impervious area, eliminating "unnecessary" impervious area and encouraging infiltration into soils that are suitable.

All of the downspouts for each residence is planned to discharge either within landscaped areas of natural areas.

Step 2: Treat and slowly release the WQCV.

A Full Spectrum Water Quality Detention Pond is not required for this site and therefor does not have the WQCV component..

Step 3: Stabilize stream channels.

An existing swale located in the center of the property is stable)see Exhibit 9, Appendix. And therefore, it can be safely assumed that the negligible increase in flow as a result of development will have minimal negative impact on the existing swale.

Step 4: Implement source controls.

There are no water sources with the project limits or runoff

XII EROSION CONTROL

The following erosion control measures are recommended for the proposed private driveway:

- Silt fence along the southerly side of the proposed driveway
- Erosion control fabric on all disturbed surfaces
- Buried riprap at the outlet end of the proposed culverts installed under the proposed driveway.

XIII STORMWATER MANAGEMENT PLAN (SWMP)

A **SWMP** will not be required for this site since the improvements are limited to a shared private gravel driveway with a shared access off of Thompson Road.

XIV DRAINAGE/ BRIDGE FEES

The site is located in the **Cherry Creek Drainage Basin** for which there are no established fees.

XVI. SUMMARY

This report provides a thorough analysis of the historic and developed drainage conditions for the proposed McGehee Subdivision. The property is comprised of 10.5 acres and is located north of Hodgen Road and west of Thompson Road. The subdivision is to be subdivided into two (2) consisting of a 5-acre lot and a 5.5-acre lot.

The vegetation consists of primarily prairie grass with no trees. There is a main natural drainage way that is located in the southerly half of the site which correlates to the approximate center of the Mountain Shadow Ranch Second Phase subdivision.

It has been demonstrated that there is only a negligible increase in runoff as a result of development. Also, based on the present engineering criteria for El Paso County a full spectrum detention pond is not required. Improvements are to be limited to two (2) residential homes, a common gravel driveway with a common access to Thompson Road, and a driveway culvert located approximately 150-foot south of the northeast property corner.

Included in the map pocket are drainage maps for the **Existing Drainage Conditions** and the **Developed Drainage Conditions**. No storm water structures are proposed for this subdivision.

APPENDIX

Exhibit 1: Location Map



Vicinity Map

Exhibit 2: FEMA FIRM Map

National Flood Hazard Layer FIRMette



104°43'11"W 39°4'48"N



Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone I
		Channel, Culvert, or Storm Sewer
OTHER FEATURES		Levee, Dike, or Floodwall
		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
MAP PANELS		17.5 Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature
MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 11/9/2020 at 3:17 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

USGS The National Map, Orthoimagery, Data refreshed October 2020
LOMR 18-04
eff 7/1/2019
104°42'33"W 39°4'20"N



Exhibit 3: SCS Soils Map and Data



United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for El Paso County Area, Colorado



October 24, 2020

Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
El Paso County Area, Colorado.....	13
21—Cruckton sandy loam, 1 to 9 percent slopes.....	13
67—Peyton sandy loam, 5 to 9 percent slopes.....	14
68—Peyton-Pring complex, 3 to 8 percent slopes.....	15
References	17

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.


Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



Map Scale: 1:3,640 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84

MAP LEGEND

Area of Interest (AOI)		 Spoil Area	
 Area of Interest (AOI)		 Stony Spot	
Soils		 Very Stony Spot	
 Soil Map Unit Polygons		 Wet Spot	
 Soil Map Unit Lines		 Other	
 Soil Map Unit Points		 Special Line Features	
Special Point Features		Water Features	
 Blowout		 Streams and Canals	
 Borrow Pit		Transportation	
 Clay Spot		 Rails	
 Closed Depression		 Interstate Highways	
 Gravel Pit		 US Routes	
 Gravelly Spot		 Major Roads	
 Landfill		 Local Roads	
 Lava Flow		Background	
 Marsh or swamp		 Aerial Photography	
 Mine or Quarry			
 Miscellaneous Water			
 Perennial Water			
 Rock Outcrop			
 Saline Spot			
 Sandy Spot			
 Severely Eroded Spot			
 Sinkhole			
 Slide or Slip			
 Sodic Spot			

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 8, 2018—May 26, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
21	Cruckton sandy loam, 1 to 9 percent slopes	2.0	3.5%
67	Peyton sandy loam, 5 to 9 percent slopes	55.9	96.5%
68	Peyton-Pring complex, 3 to 8 percent slopes	0.0	0.0%
Totals for Area of Interest		57.9	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or

Custom Soil Resource Report

landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

El Paso County Area, Colorado

21—Cruckton sandy loam, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 367s
Elevation: 7,200 to 7,600 feet
Mean annual precipitation: 16 to 18 inches
Mean annual air temperature: 42 to 46 degrees F
Frost-free period: 110 to 120 days
Farmland classification: Not prime farmland

Map Unit Composition

Cruckton and similar soils: 85 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Cruckton

Setting

Landform: Flats, hills
Landform position (three-dimensional): Side slope, talf
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Alluvium derived from arkose

Typical profile

A - 0 to 11 inches: sandy loam
Bt - 11 to 28 inches: sandy loam
C - 28 to 60 inches: loamy coarse sand

Properties and qualities

Slope: 1 to 9 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high
(0.60 to 2.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Available water capacity: Low (about 5.9 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 4e
Hydrologic Soil Group: B
Ecological site: R049XB216CO - Sandy Divide
Hydric soil rating: No

Minor Components

Other soils

Percent of map unit:
Hydric soil rating: No

67—Peyton sandy loam, 5 to 9 percent slopes

Map Unit Setting

National map unit symbol: 369d
Elevation: 6,800 to 7,600 feet
Mean annual air temperature: 43 to 45 degrees F
Frost-free period: 115 to 125 days
Farmland classification: Not prime farmland

Map Unit Composition

Peyton and similar soils: 85 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Peyton

Setting

Landform: Hills
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Arkosic alluvium derived from sedimentary rock and/or arkosic residuum weathered from sedimentary rock

Typical profile

A - 0 to 12 inches: sandy loam
Bt - 12 to 25 inches: sandy clay loam
BC - 25 to 35 inches: sandy loam
C - 35 to 60 inches: sandy loam

Properties and qualities

Slope: 5 to 9 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately high (0.20 to 0.60 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Available water capacity: Moderate (about 7.3 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 4e
Hydrologic Soil Group: B
Ecological site: R049XB216CO - Sandy Divide
Hydric soil rating: No

Minor Components

Pleasant

Percent of map unit:
Landform: Depressions
Hydric soil rating: Yes

Other soils

Percent of map unit:
Hydric soil rating: No

68—Peyton-Pring complex, 3 to 8 percent slopes

Map Unit Setting

National map unit symbol: 369f
Elevation: 6,800 to 7,600 feet
Farmland classification: Not prime farmland

Map Unit Composition

Peyton and similar soils: 40 percent
Pring and similar soils: 30 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Peyton

Setting

Landform: Hills
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Arkosic alluvium derived from sedimentary rock and/or arkosic residuum weathered from sedimentary rock

Typical profile

A - 0 to 12 inches: sandy loam
Bt - 12 to 25 inches: sandy clay loam
BC - 25 to 35 inches: sandy loam
C - 35 to 60 inches: sandy loam

Properties and qualities

Slope: 3 to 5 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high (0.20 to 0.60 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Available water capacity: Moderate (about 7.3 inches)

Custom Soil Resource Report

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 4c
Hydrologic Soil Group: B
Ecological site: R049XB216CO - Sandy Divide
Hydric soil rating: No

Description of Pring

Setting

Landform: Hills
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Arkosic alluvium derived from sedimentary rock

Typical profile

A - 0 to 14 inches: coarse sandy loam
C - 14 to 60 inches: gravelly sandy loam

Properties and qualities

Slope: 3 to 8 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): High (2.00 to 6.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Available water capacity: Low (about 6.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 3e
Hydrologic Soil Group: B
Ecological site: R048AY222CO
Hydric soil rating: No

Minor Components

Pleasant

Percent of map unit:
Landform: Depressions
Hydric soil rating: Yes

Other soils

Percent of map unit:
Hydric soil rating: No

References

American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.

American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.

Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.

Federal Register. July 13, 1994. Changes in hydric soils of the United States.

Federal Register. September 18, 2002. Hydric soils of the United States.

Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.

National Research Council. 1995. Wetlands: Characteristics and boundaries.

Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262

Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577

Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580

Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.

United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.

United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374

United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelp2rb1043084>

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

Exhibit 4 Charts and Tables

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_t) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_t) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

$$t_c = t_l + t_t \quad (\text{Eq. 6-7})$$

Where:

t_c = time of concentration (min)

t_l = overland (initial) flow time (min)

t_t = travel time in the ditch, channel, gutter, storm sewer, etc. (min)

3.2.1 Overland (Initial) Flow Time

The overland flow time, t_l , may be calculated using Equation 6-8.

$$t_l = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_l = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_l , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

concentration, all other factors being equal. Although it is possible to calculate a longer time of concentration for a post-development condition versus a pre-development condition by increasing the length of the flow path, this is often a result of selecting unrealistic flow path lengths. As a matter of practice and for the sake of conservative design, it is required that the post-development time of concentration be less than or equal to the pre-development time of concentration. As a general rule and when sufficiently detailed development plans are not available, the post-development time of concentration can be estimated to be about 75% of the pre-development value.

3.2.6 Common Error in Calculating Time of Concentration

A common error in estimating the time of concentration occurs when a designer does not check the peak runoff generated from smaller portions of the catchment that may have a significantly shorter time of concentration (and, therefore, a higher rainfall intensity) than the drainage basin as a whole. Sometimes calculations using the Rational Method for a lower, urbanized portion of a watershed will produce a higher peak runoff than the calculations for the drainage basin as a whole, especially if the drainage basin is long or the upper portion has little or no impervious cover.

3.3 Rainfall Intensity (I)

The average rainfall intensity (I), in inches per hour, by recurrence interval, can be found from the Intensity-Duration-Frequency curves provided in Figure 6-5. The value for I is based on the assumption that the peak runoff will occur when the duration of the rainfall is equal to the time of concentration. For example, Figure 6-5 indicates a rainfall intensity of approximately 5.00 inches/hour for the 100-year event for a catchment with a time of concentration of 20 minutes. These curves are based on the rainfall depths for an elevation of 6,840 feet in the Colorado Springs area. IDF curves for other elevations or locations can be created using the UD-Rain spreadsheet based on 6-hour and 24-hour rainfall depths for each recurrence interval needed. The Z-1 (Zone 1) tab should be used for Arkansas River basin locations.


3.4 Drainage Basin Area (A)

The size of a drainage basin contributing runoff to a design point, in acres, is used to calculate peak runoff in the Rational Method. Accurately delineating the area contributing to each design point is one of the most important tasks for hydrologic analyses since the estimated runoff is directly proportional to the basin area. The area may be determined through the use of planimetric-topographic maps, supplemented by field surveys where topographic data has changed or where the contour interval is too great to distinguish the direction of flow. The drainage basin lines are determined by the natural topography, pavement slopes, locations of downspouts and inlets, paved and unpaved yards, grading of lawns, and many other features found on the urban landscape. In areas where there are storm drains, the entire contributing drainage area can sometimes be greater than the drainage area determined by topographic analysis of the ground surface, due to storm drains collecting runoff from areas that lie outside of the surface topographic extent of the basin.

4.0 NRCS Curve Number Loss and Dimensionless Unit Hydrograph Method

The NRCS curve number loss and dimensionless unit hydrograph method has been the most widely used method in the region. It can be applied for drainage basins as small as 10 acres and is the only method that should be applied for drainage basins larger than 640 acres. This method can be used to estimate peak flows or to produce a runoff hydrograph and also provides estimates of runoff volume.

Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

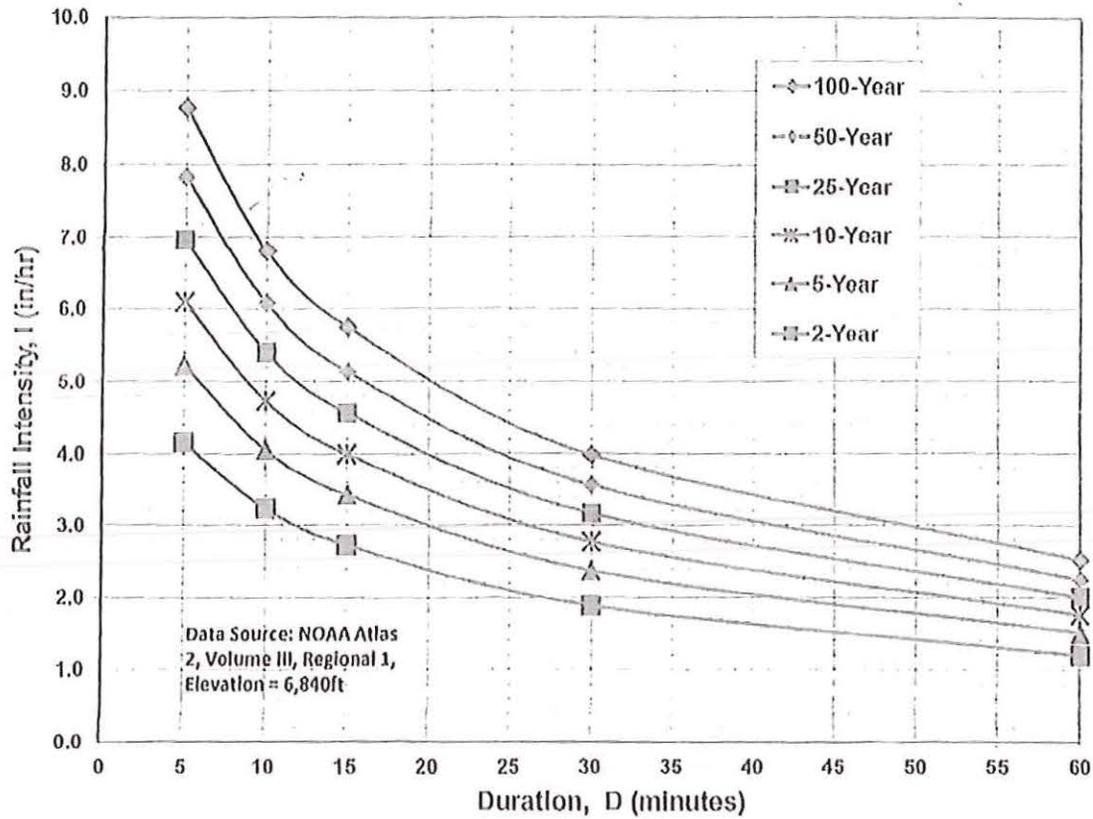

IDF Equations

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$

$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$

$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

The travel time is calculated by dividing the flow distance (in feet) by the velocity calculated using Equation 6-9 and converting units to minutes.

The time of concentration (t_c) is then the sum of the overland flow time (t_o) and the travel time (t_t) per Equation 6-7.

3.2.3 First Design Point Time of Concentration in Urban Catchments

Using this procedure, the time of concentration at the first design point (typically the first inlet in the system) in an urbanized catchment should not exceed the time of concentration calculated using Equation 6-10. The first design point is defined as the point where runoff first enters the storm sewer system.

$$t_c = \frac{L}{180} + 10 \quad (\text{Eq. 6-10})$$

Where:

t_c = maximum time of concentration at the first design point in an urban watershed (min)

L = waterway length (ft)

Equation 6-10 was developed using the rainfall-runoff data collected in the Denver region and, in essence, represents regional "calibration" of the Rational Method. Normally, Equation 6-10 will result in a lesser time of concentration at the first design point and will govern in an urbanized watershed. For subsequent design points, the time of concentration is calculated by accumulating the travel times in downstream drainageway reaches.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

3.2.5 Post-Development Time of Concentration

As Equation 6-8 indicates, the time of concentration is a function of the 5-year runoff coefficient for a drainage basin. Typically, higher levels of imperviousness (higher 5-year runoff coefficients) correspond to shorter times of concentration, and lower levels of imperviousness correspond to longer times of

trol were developed. These nomographs give headwater-discharge relationships for most conventional culverts flowing with inlet control through a range of headwater depths or discharges. An example of these nomographs is shown in Figure 3.25.

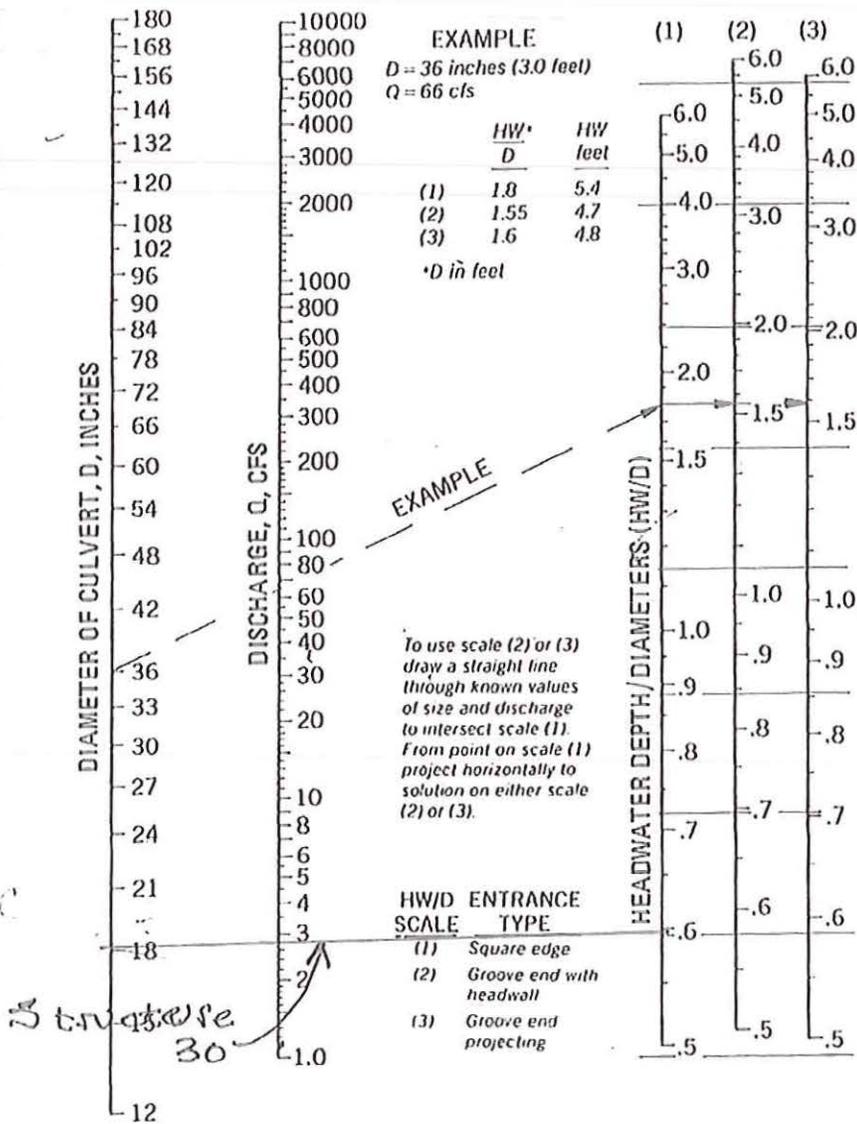


Figure 3.25. Headwater Depth for Circular Concrete Pipe Culverts with Inlet Control.

Exhibit 5: Calculation Sheets

KCH Engineering Solutions

5228 Cracker Barrel Circle
Colorado Springs, CO 80917
(719) 246-4471

JOB _____

SHEET NO. _____ OF _____

CALCULATED BY _____ DATE _____

CHECKED BY _____ DATE _____

SCALE _____

Developed Runoff Coefficients

Gravel Drive

$$\text{Lot 1} - 250\text{ft} \times 20\text{ft} = 0.11 \text{ Acres (Lot B)}$$

$$\text{Lot 2} \approx 420\text{ft} \times 20\text{ft} = 0.19 \text{ Acres (Lot A)}$$

$$C_5 = 0.59 \quad C_{100} = 0.70$$

$$\text{Roof: } 3000\text{ft}^2 / 43560 = 0.07 \text{ Acres per block lot 1 & 2}$$

$$C_5 = 0.90 \quad C_{100} = 0.96$$

Landscaping

$$\text{Each lot } 1/2 \text{ acre, } C_5 = 0.12 \quad C_{100} = 0.39$$

Cumulative C

Lot A (5.0 Acres)

$$5\text{yr } (0.11 \times 0.59 + 0.07 \times 0.90 + 0.5 \times 0.12) + 4.3(0.08) / 5.0 = 0.11$$

$$100\text{yr } (0.11 \times 0.59) + 0.07(0.96) + 0.5(0.39) + 4.3(0.35) / 5.0 = 0.37$$

Lot B (5.5 Acres)

$$5\text{yr } (0.19)(0.59) + 0.07(0.90) + 0.5(0.12) + 4.74(0.08) / 5.5 = 0.11 \quad 5\text{yr}$$

$$100\text{yr } (0.19 \times 0.59) + 0.07 \times 0.96 + 0.5 \times 0.39 + 4.74 \times 0.35 / 5.5 = 0.37$$

KCH Engineering Solutions

5228 Cracker Barrel Circle
Colorado Springs, CO 80917
(719) 246-4471

JOB McGee Tract

SHEET NO. 1 OF 1

CALCULATED BY K. Hornum DATE 10/28/20

CHECKED BY _____ DATE _____

SCALE _____

Cumulative Runoff

A. DP 1

1. Areas: 051, 03, 04 = 35.3 acres
2. Runoff Coef: see excel spreadsheet
3. Time of concentration = 23.2 min

B. DP 5

1. Areas: DP1 + 065 + 067 + A
 $35.3 + 0.4 + 3.6 = 39.3$ acres

2. Runoff Coef: see excel spreadsheet

3. T_c : DP1 + channel from DP1 to DP5

$$V = C_v \sum w^{0.5} \quad \text{where } C_v = 15 \text{ (grassed waterway)}$$
$$S = 20\% / 100 = 0.2 = 3.3\%$$

$$V = 15 (0.033)^{0.5} = 2.6 \text{ ft on dk}$$
$$T_c = 600 / 2.6 * 60 = 3.8 \text{ min}$$

$$\text{Total } T_c @ \text{ DP5} = 23.2 + 3.8 = \boxed{27.0 \text{ min}}$$

KCH Engineering Solutions

5228 Cracker Barrel Circle
Colorado Springs, CO 80917
(719) 246-4471

JOB McGreece Blvd
SHEET NO. 2 OF 7
CALCULATED BY K. Harrison DATE 10/28/20
CHECKED BY _____ DATE _____
SCALE _____

C. DP 6 (Pond Embankment Outlet pipe)

$$\begin{aligned} \text{A Area: DP 5 + B + 0.2} \\ = 39.3 + 3.5 + 10.3 = 53.1 \text{ acres} \end{aligned}$$

B T_c
DP 6 + swale (DP 5 to DP 6)

Swale Travel Time

$$\begin{aligned} C_v &= 15 \text{ (grassed lined swale)} \\ S_w &= 3/200 = 2.5\% \\ T_T &= 75 * (0.025)^{1/2} \\ &= 2.4 \text{ min} \end{aligned}$$

$$\text{Travel Time} = 200 / 2.4 * 60 = 1.4 \text{ min}$$

$$\boxed{\text{Total } T_c \text{ @ DP 6} = 27.6 + 1.4 = 28.4 \text{ min}}$$

D. DP 7 (Thompson Road culvert)

$$\begin{aligned} \text{1. Area + DP 6 + 0.56 + D + 0.59 + 0.510 + C} \\ = 53.1 + 0.9 + 1.4 + 0.4 + 0.5 + 0.8 \\ = 57.1 \text{ Acres} \end{aligned}$$

2. Travel Time DP 6 to DP 7

Channel Time $C_v * (S)^{1/2}$

$$\begin{aligned} C_v &= 15 \quad L = 100 \quad \text{Fall} = 4' \\ S_w &= 4/100 = 4.0\% \end{aligned}$$

$$V_f = 15 * (0.04)^{1/2} = 3.0 \text{ ft/s}$$

$$T_T = 100 / 3.0 * 60 = 0.6 \text{ min}$$

Time of concentration @ DP 7 =

$$\boxed{28.4 + 0.6 = 29.0 \text{ min}}$$

Exhibit 6: Hydrologic Calculations

Stormwater Runoff Summary Comparison

Existing Conditions

DP	Contributing Sub basins	Area	Tc	C5	C100	CA5	CA100	Q5	Q100
14	DP7, OS9, OS10	63.4	29			6.28	23.05	15.9	97.9
	Lot 1 (sub basin B)	5.5	12.9	0.11	0.37			1.8	13.3
	Lot 2 (Sub basin A)	5.0	14.8	0.11	0.37			1.2	8.9

Developed Conditions

DP	Contributing Sub basins	Area	Rational						
			Tc	C5	C100	CA5	CA100	Q5	Q100
14	DP7, OS9, OS10	63.4	29			6.47	23.18	16.4	98.5
	Lot 1 (sub basin B)	5.5	12.9	0.11	0.37			2.5	14.1
	Lot 2 (Sub basin A)	5.0	14.8	0.11	0.37			1.7	9.4

Notes

- 1 Design Point 14 is located at the upstream end of the culvert under Thompson Road
- 2 The majority of Lot 2 is located in sub basin A.
- 3 The majority of Lot 1 is located in sub basin B.
- 4 All of the runoff from the sub basins not shown in the above table remains The same as shown on the Existing Conditions Drainage Plan
- 5 CA values are used in order to accurately reflect controlling Tc

Cumulative Acreage at Design Points

DP	Sub Basin ID	Sub basin Area	Sub total
1	OS1	34.1	34.1
5	OS1	34.1	
	OS3	0.6	
	OS4	0.6	
	OS5	0.4	
	A	6.3	
5	OS7	3.6	45.6
6	DP5	45.6	
	OS6	0.9	
	B	3.5	
6	OS2	10.3	60.3
7	DP6	60.3	
	C	0.8	
7	OS8	1.4	62.5
14	DP7	62.5	
	OS9	0.4	
14	OS10	0.5	63.4

Design Point Summary

Existing Conditions

DP	Contributing Sub basins	Area	Tc	C5	C100	CA5	CA100	Q5	Q100
1	OS1	34.1	23.2	0.09	0.36			8.7	58.5
2	OS3	0.6	15	0.08	0.35			0.2	1.2
3	OS4	0.6	13.3	0.17	0.41			0.4	1.5
4	OS7	3.6	15.5	0.12	0.38			1.5	8.0
5	OS1,OS3, OS4, OS5,OS7,A	45.6	27			4.16	16.31	11.0	72.2
6	DP5,OS6,B,OS2	60.3	28.4			5.47	21.28	14.0	91.5
7	DP6, C, OS8	62.5	29			5.71	22.37	14.5	95.0
8	OS5	0.4	10.9	0.08	0.35			0.1	0.9
9	OS6	0.9	15.2	0.08	0.35			0.3	1.9
10	OS2	10.3	17.9	0.10	0.36			3.3	20.5
11	OS8	1.4	14.1	0.08	0.35			0.4	3.0
12	OS10	0.5	5.3	0.57	0.72			1.5	3.1
13	OS9	0.4	6.1	0.70	0.81			1.4	2.6
14	DP7, OS9, OS10	61.5	29			6.28	23.05	15.9	97.9
	Lot 1 located in sub basin B	5.5	12.9	0.08	0.35			1.8	13.3
	Lot 2 Located in sub basin A	5.0	14.8	0.08	0.35			1.2	8.9

Cummulative Flows Existing Conditions

Design Point	DP1	DP5	DP6	DP7	DP14
Swale ID	S1	S2	S3	S4	S5
Contributing Basins	OS1, OS3, OS4	DP1, OS5, OS7, A	DP5, B, OS2	DP6, OS6, C, OS8	DP7, OS9, OS10
CA5	3.18	4.36	5.47	5.71	6.28
CA100	12.6	16.31	21.28	22.37	23.05
Tc (min)	23.2	27	28.4	29	29
Q5 (cfs)	9.1	11	14.0	14.5	15.9
Q100 (cfs)	60.6	72.2	91.5	95	97.9

Design Point Summary

Developed Conditions

DP	Contributing Sub basins	Area	Tc	C5	C100	CA5	CA100	Q5	Q100
1	OS1	34.1	23.2	0.09	0.36			8.7	58.5
2	OS3	0.6	15	0.08	0.35			0.2	1.2
3	OS4	0.6	13.5	0.17	0.41			0.3	1.3
4	OS7	3.6	15.5	0.12	0.38			1.5	8.0
5	OS1,OS3, OS4, OS5,OS7,A	45.6	27			4.28	16.39	11.3	72.6
6	DP5,OS6,B,OS2	60.3	28.4			5.66	21.42	14.5	92.1
7	DP6, C, OS8	62.5	29			5.71	22.37	14.5	95.0
8	OS5	0.4	10.9	0.08	0.35			0.1	0.9
9	OS6	0.9	15.2	0.08	0.35			0.3	1.9
10	OS2	10.3	17.9	0.10	0.36			3.3	20.5
11	OS8	1.4	14.1	0.08	0.35			0.4	3.0
12	OS10	0.5	5.3	0.57	0.72			1.5	3.1
13	OS9	0.4	6.1	0.70	0.81			1.4	2.6
14	DP7, OS9, OS10	63.4	29			6.47	23.18	16.4	98.5
	Lot 1 located in sub basin B	5.5	12.9	0.11	0.37			1.7	9.4
	Lot 2 Located in sub basin A	5.0	14.8	0.08	0.35			2.5	14.1

Cummulative Flows Developed Conditions

Design Point	DP1	DP5	DP6	DP7	DP14
Swale ID	S1	S2	S3	S4	S5
Contributing Basins	OS1, OS3, OS4	DP1, OS5, OS7, A	DP5, B, OS2	DP6, OS6, C, OS8	DP7, OS9, OS10
CA5	3.17	4.28	5.66	5.9	6.47
CA100	12.57	16.39	21.42	22.53	23.18
Tc (min)	23.2	27	28.4	29	29
Q5 (cfs)	9.1	11.3	14.5	14.9	16.4
Q100 (cfs)	60.5	72.6	92.1	95.7	98.5

**MCGEHEE TRACT
DRAINAGE CALCULATIONS
(Area Runoff Coefficient Summary)
Existing Conditions**

See surface flow routing table for total combined flow at culvert under Thompson Road

BASIN	TOTAL AREA (Acres)	GRAVEL/ ASPHALT ROADS			DEVELOPED LOTS			NATURAL			RUNOFF COEFFICIENT	
		AREA (Acres)	C ₅	C ₁₀₀	AREA (Acres)	C ₅	C ₁₀₀	AREA (Acres)	C ₅	C ₁₀₀	C ₅	C ₁₀₀
OS1	34.10	0.60	0.59	0.70	0.00	0.38	0.57	33.50	0.08	0.35	0.09	0.36
OS2	10.30	0.40	0.59	0.70	0.00	0.38	0.57	9.90	0.08	0.35	0.10	0.36
OS3	0.60	0.00	0.59	0.70	0.00	0.38	0.57	0.60	0.08	0.35	0.08	0.35
OS4	0.60	0.10	0.59	0.70	0.00	0.38	0.57	0.50	0.08	0.35	0.17	0.41
OS5	0.40	0.00	0.59	0.70	0.00	0.38	0.57	0.40	0.08	0.35	0.08	0.35
OS6	0.90	0.00	0.59	0.70	0.00	0.38	0.57	0.90	0.08	0.35	0.08	0.35
OS7	3.60	0.30	0.59	0.70	0.00	0.38	0.57	3.30	0.08	0.35	0.12	0.38
OS8	1.40	0.00	0.59	0.70	0.00	0.38	0.57	1.40	0.08	0.35	0.08	0.35
OS9	0.40	0.30	0.90	0.96	0.00	0.38	0.57	0.10	0.08	0.35	0.70	0.81
OS10	0.50	0.30	0.90	0.96	0.00	0.38	0.57	0.20	0.08	0.35	0.57	0.72
A	6.30	0.00	0.59	0.70	0.00	0.38	0.57	6.30	0.08	0.35	0.08	0.35
B	3.50	0.00	0.59	0.70	0.00	0.38	0.57	3.50	0.08	0.35	0.08	0.35
C	0.80	0.00	0.59	0.70	0.00	0.38	0.57	0.80	0.08	0.35	0.08	0.35
<i>Sub Total</i>	63.40											
<i>Lots to be developed</i>												
<i>Lot 2 located in Sub basin A</i>	5.00										0.08	0.35
<i>Lot 1 located in Sub basin B</i>	5.50										0.08	0.35

**MCGEHEE TRACT
FINAL DRAINAGE REPORT
(Area Drainage Summary)
Existing Conditions**

See surface flow routing table for total combined flow at culvert under Thompson Road

From Area Runoff Coefficient Summary				OVERLAND				CHANNEL FLOW				Time of Travel (T _t)		INTENSITY *		TOTAL FLOWS	
BASIN	AREA TOTAL	C _s	C ₁₀₀	C _s	Length	Height	T _c	Length	Slope	Velocity	T _t	TOTAL	CHECK	I _s	I ₁₀₀	Q _s	Q ₁₀₀
	(Acres)	From DCM Table 2-1			(ft)	(ft)	(min)	(ft)	(%)	(fps)	(min)	(min)	(min)	(in/hr)	(in/hr)	(c.f.s.)	(c.f.s.)
OS1	34.10	0.09	0.36	0.09	300	40	13.4	1900	4.7%	3.3	9.7	23.2	22.2	2.9	4.8	8.7	58.5
OS2	10.30	0.10	0.36	0.10	300	20	16.7	300	8.3%	4.3	1.2	17.9	13.3	3.3	5.5	3.3	20.5
OS3	0.60	0.08	0.35	0.08	300	30	14.9	1	0.1%	0.5	0.0	15.0	11.7	3.5	5.9	0.2	1.2
OS4	0.60	0.17	0.41	0.17	300	35	13.0	100	10.0%	4.7	0.4	13.3	12.2	3.7	6.2	0.4	1.5
OS5	0.40	0.08	0.35	0.08	100	5	10.8	1	0.1%	0.5	0.0	10.9	10.6	4.0	6.7	0.1	0.9
OS6	0.90	0.08	0.35	0.08	150	5	15.2	1	0.1%	0.5	0.0	15.2	10.8	3.5	5.9	0.3	1.9
OS7	3.60	0.12	0.38	0.12	300	25	15.2	100	15.0%	5.8	0.3	15.5	12.2	3.5	5.8	1.5	8.0
OS8	1.40	0.08	0.35	0.08	50	0.5	13.0	250	7.3%	4.1	1.0	14.1	11.7	3.6	6.1	0.4	3.0
OS9	0.40	0.70	0.81	0.70	20	0.5	2.4	550	2.7%	2.5	3.7	6.1	13.2	4.9	8.2	1.4	2.6
OS10	0.50	0.57	0.72	0.57	20	0.5	3.2	550	8.2%	4.3	2.1	5.3	13.2	5.1	8.5	1.5	3.1
A	6.30	0.08	0.35	0.08	200	20	12.2	550	5.5%	3.5	2.6	14.8	14.2	3.5	5.9	1.8	13.1
B	3.50	0.08	0.35	0.08	150	10	12.1	175	5.7%	3.6	0.8	12.9	11.8	3.8	6.3	1.1	7.7
C	0.80	0.08	0.35	0.08	150	10	12.1	250	10.0%	4.7	0.9	12.9	12.2	3.7	6.3	0.2	1.8
Sub Total	63.40																
Lots to be developed																	
Lot 2 located in Sub basin A	5.00	0.08	0.35									14.8	10.0	3.1	5.1	1.2	8.9
Lot 1 located in Sub basin E	5.50	0.08	0.35									12.9	10.0	4.1	6.9	1.8	13.3

MCGEHEE TRACT
FINAL DRAINAGE REPORT
(Surface Routing Summary- surface runoff)
Existing Conditions

<i>From Area Runoff Coefficient Summary</i>					<i>Time of Travel (T_t)</i>	<i>INTENSITY *</i>			<i>TOTAL FLOWS</i>		COMMENTS
DESIGN POINT	Swale ID	CONTRIBUTING BASINS	CA ₅	CA ₁₀₀	TOTAL	I ₅	I ₁₀₀	Q ₅	Q ₁₀₀		
					<i>(min)</i>	<i>(in/hr)</i>	<i>(in/hr)</i>	<i>(c.f.s.)</i>	<i>(c.f.s.)</i>		
DP1	S1	OS1, OS3, OS4	3.18	12.60	23.2	2.9	4.8	9.1	60.6	west property line	
DP5	S2	DP1,OS5,OS7,A	4.16	16.31	27.0	2.6	4.4	11.0	72.2	entrance to the stock pond	
DP6	S3	DP5, B, OS2	5.47	21.28	28.4	2.6	4.3	14.0	91.5	outlet to the pond	
DP7	S4	DP6,OS6,C,OS8	5.71	22.37	29.0	2.5	4.2	14.5	95.0	Thompson Road culvert	
DP14	S5	DP7,OS9,OS10	6.28	23.05	29.0	2.5	4.2	15.9	97.9	Thompson Road culvert	

MCGEHEE TRACT
DRAINAGE CALCULATIONS
(Sub basin Runoff Coefficient Summary)
Developed Conditions

See surface flow routing table for total combined flow at culvert under Thompson Road

BASIN	TOTAL AREA (Acres)	GRAVEL/ ASPHALT ROADS			ROOFS			NATURAL			RUNOFF COEFFICIENT	
		AREA (Acres)	C ₅	C ₁₀₀	AREA (Acres)	C ₅	C ₁₀₀	AREA (Acres)	C ₅	C ₁₀₀	C ₅	C ₁₀₀
OS1	34.10	0.60	0.59	0.70	0.00	0.38	0.57	33.50	0.08	0.35	0.09	0.36
OS2	10.30	0.40	0.59	0.70	0.00	0.38	0.57	9.90	0.08	0.35	0.10	0.36
OS3	0.60	0.00	0.59	0.70	0.00	0.38	0.57	0.60	0.08	0.35	0.08	0.35
OS4	0.60	0.10	0.59	0.70	0.00	0.38	0.57	0.40	0.08	0.35	0.15	0.35
OS5	0.40	0.00	0.59	0.70	0.00	0.38	0.57	0.50	0.08	0.35	0.10	0.44
OS6	0.90	0.00	0.59	0.70	0.00	0.38	0.57	0.90	0.08	0.35	0.08	0.35
OS7	3.60	0.30	0.59	0.70	0.00	0.38	0.57	3.30	0.08	0.35	0.12	0.38
OS8	1.40	0.00	0.59	0.70	0.00	0.38	0.57	1.40	0.08	0.35	0.08	0.35
OS9	0.40	0.30	0.90	0.96	0.00	0.38	0.57	0.10	0.08	0.35	0.70	0.81
OS10	0.50	0.30	0.90	0.96	0.00	0.38	0.57	0.20	0.08	0.35	0.57	0.72
A	6.30	0.19	0.59	0.70	0.07	0.38	0.57	6.04	0.08	0.35	0.10	0.36
B	3.50	0.11	0.59	0.70	0.07	0.38	0.57	3.32	0.08	0.35	0.10	0.37
C	0.80	0.00	0.59	0.70	0.00	0.38	0.57	0.80	0.08	0.35	0.08	0.35
Sub Total	63.40											
<i>Lots to be developed</i>												
Lot 2 located in Sub Basin A	5.00										0.11	0.37
Lot 1 located in Sub Basin B	5.50										0.11	0.37

**MCGEHEE TRACT
FINAL DRAINAGE REPORT
(Area Drainage Summary)
Developed Conditions**

See surface flow routing table for total combined flow at culvert under Thompson Road

From Area Runoff Coefficient Summary				OVERLAND				CHANNEL FLOW				Time of Travel (T _t)	INTENSITY *		TOTAL FLOWS	
BASIN	AREA TOTAL	C _s	C ₁₀₀	C _s	Length	Height	T _c	Length	Slope	Velocity	T _c	TOTAL	I _s	I ₁₀₀	Q _s	Q ₁₀₀
	(Acres)	From DCM Table 2-1			(ft)	(ft)	(min)	(ft)	(%)	(fps)	(min)	(min)	(in/hr)	(in/hr)	(c.f.s.)	(c.f.s.)
OS1	34.10	0.09	0.36	0.09	300	40	13.4	1900	4.7%	3.3	9.7	23.2	2.9	4.8	8.7	58.5
OS2	10.30	0.10	0.36	0.10	300	20	16.7	300	8.3%	4.3	1.2	17.9	3.3	5.5	3.3	20.5
OS3	0.60	0.08	0.35	0.08	300	30	14.9	1	0.1%	0.5	0.0	15.0	3.5	5.9	0.2	1.2
OS4	0.60	0.15	0.35	0.15	300	35	13.2	100	10.0%	4.7	0.4	13.5	3.7	6.2	0.3	1.3
OS5	0.40	0.10	0.44	0.10	100	5	10.6	1	0.1%	0.5	0.0	10.7	4.0	6.8	0.2	1.2
OS6	0.90	0.08	0.35	0.08	150	5	15.2	1	0.1%	0.5	0.0	15.2	3.5	5.9	0.3	1.9
OS7	3.60	0.12	0.38	0.12	300	25	15.2	100	15.0%	5.8	0.3	15.5	3.5	5.8	1.5	3.0
OS8	1.40	0.08	0.35	0.08	50	0.5	13.0	250	7.3%	4.1	1.0	14.1	3.6	6.1	0.4	3.0
OS9	0.40	0.70	0.81	0.70	20	0.5	2.4	550	2.7%	2.5	3.7	6.1	4.9	8.2	1.4	2.6
OS10	0.50	0.57	0.72	0.57	20	0.5	3.2	550	8.2%	4.3	2.1	5.3	5.1	8.5	1.5	3.1
A	6.30	0.10	0.36	0.10	200	20	12.0	550	5.5%	3.5	2.6	14.8	3.5	5.9	2.2	13.6
B	3.50	0.10	0.37	0.10	150	10	11.8	175	5.7%	3.6	0.8	12.9	3.7	6.3	1.3	8.0
C	0.80	0.08	0.35	0.08	150	10	12.1	250	10.0%	4.7	0.9	12.9	3.7	6.3	0.2	1.3
Sub Totals	63.40															
Lots to be developed																
Lot 2 located in Sub Basin A	5.00	0.11	0.37									14.8	3.1	5.1	1.7	9.4
Lot 1 located in Sub Basin B	5.50	0.11	0.37									12.9	4.1	6.9	2.5	14.1

3

Date: 12/11/2019
Checked by: _____

MCGEHEE TRACT
FINAL DRAINAGE REPORT
(Surface Routing Summary- surface runoff)
Developed Conditions

<i>From Area Runoff Coefficient Summary</i>					<i>Time of Travel (T_t)</i>	<i>INTENSITY *</i>		<i>TOTAL FLOWS</i>		<i>COMMENTS</i>
<i>DESIGN POINT</i>	<i>Swale ID</i>	<i>CONTRIBUTING BASINS</i>	<i>CA₅</i>	<i>CA₁₀₀</i>	<i>TOTAL</i>	<i>I₅</i>	<i>I₁₀₀</i>	<i>Q₅</i>	<i>Q₁₀₀</i>	
					<i>(min)</i>	<i>(in/hr)</i>	<i>(in/hr)</i>	<i>(c.f.s.)</i>	<i>(c.f.s.)</i>	
<i>DP1</i>	<i>S1</i>	<i>OS1, OS3, OS4</i>	3.17	12.57	23.2	2.9	4.8	<i>9.1</i>	<i>60.5</i>	west property line
<i>DP5</i>	<i>S2</i>	<i>DP1, OS5, OS7, A</i>	4.28	16.39	27.0	2.6	4.4	<i>11.3</i>	<i>72.6</i>	entrance to the stock pond
<i>DP6</i>	<i>S3</i>	<i>DP5, B, OS2</i>	5.66	21.42	28.4	2.6	4.3	<i>14.5</i>	<i>92.1</i>	outlet to the pond
<i>DP7</i>	<i>S4</i>	<i>DP6, OS6, C, OS8</i>	5.90	22.53	29.0	2.5	4.2	<i>14.9</i>	<i>95.7</i>	
<i>DP14</i>	<i>S5</i>	<i>DP7, OS9, OS10</i>	6.47	23.18	29.0	2.5	4.2	<i>16.4</i>	<i>98.5</i>	Thompson Road culvert

Exhibit 7: Hydraulic Calculations

Swale Summary

Existing Conditions and Developed Conditions

Negligible Changes for Developed Conditions

Swale #	Design Points	Contributing Subbasins	Slope	Design Flow		Depth of Flow		Velocity		Froude Number (5 year)	Flow Regime
				Q5	Q100	Q5	Q100	Q5	Q100		
			%	cfs	cfs	ft	ft	fps	fps		
S1	1	OS1	4.7	8.7	58.5	0.3	0.7	2.9	4.8	1.21	super
S2	1 to 5	OS1, OS3, OS4, A, OS7	5.5	11	72.2	0.3	0.7	3.4	5.5	1.32	super
S3	5 to 6	DP5, B, OS2	8.3	14	91.7	0.3	0.8	4.4	7.2	1.66	super
S4	6 to 7	DP10, C, OS8	8.3	14.5	95	0.4	0.9	4.8	7.9	1.7	super
S5	12	OS10	5.0	1.5	3.1	0.2	0.3	2.8	3.5	1.2	super
S6	13	OS9	5.5	1.4	2.6	0.2	0.3	2.8	3.4	1.27	super

CS 1
5 year
swale 1

The open channel flow calculator			
Select Channel Type: Trapezoid ▼			
Depth from Q ▼	Select unit system: Feet(ft) ▼		
Channel slope: <input type="text" value="0.047"/> (ft/ft)	Water depth(y): <input type="text" value="0.28"/> (ft)	Bottom width(b) <input type="text" value="5"/> (ft)	
Flow velocity <input type="text" value="2.9425"/> (ft/s)	LeftSlope (Z1): <input type="text" value="20"/> (to 1 (H:V))	RightSlope (Z2): <input type="text" value="20"/> (to 1 (H:V))	
Flow discharge <input type="text" value="8.7"/> (ft ³ /s)	Input n value <input type="text" value="0.035"/> (or select n)		
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="16.19"/> (ft)	Flow area <input type="text" value="2.96"/> (ft ²)	Top width(T) <input type="text" value="16.17"/> (ft)	
Specific energy <input type="text" value="0.41"/> (ft)	Froude number <input type="text" value="1.21"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.31"/> (ft)	Critical slope <input type="text" value="0.0304"/> (ft/ft)	Velocity head <input type="text" value="0.13"/> (ft)	

Copyright 2000 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

CS-2
100 year
3000 ft

The open channel flow calculator

Select Channel Type: Trapezoid ▾




Depth from Q ▾

Select unit system: Feet(ft) ▾

Channel slope: <input type="text" value="0.047"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.66"/> <input type="text" value="ft"/>	Bottom width(b): <input type="text" value="5"/> <input type="text" value="ft"/>
Flow velocity: <input type="text" value="4.851"/> <input type="text" value="ft/s"/>	Left Slope (Z1): <input type="text" value="20"/> <input type="text" value="to 1 (H:V)"/>	Right Slope (Z2): <input type="text" value="20"/> <input type="text" value="to 1 (H:V)"/>
Flow discharge: <input type="text" value="58.5"/> <input type="text" value="ft^3/s"/>	Input n value: <input type="text" value="0.035"/> <input type="text" value="or select n"/>	
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>
Wetted perimeter: <input type="text" value="31.49"/> <input type="text" value="ft"/>	Flow area: <input type="text" value="12.06"/> <input type="text" value="ft^2"/>	Top width(T): <input type="text" value="31.46"/> <input type="text" value="ft"/>
Specific energy: <input type="text" value="1.03"/> <input type="text" value="ft"/>	Froude number: <input type="text" value="1.38"/>	Flow status: <input type="text" value="Supercritical flow"/>
Critical depth: <input type="text" value="0.77"/> <input type="text" value="ft"/>	Critical slope: <input type="text" value="0.0232"/> <input type="text" value="ft/ft"/>	Velocity head: <input type="text" value="0.37"/> <input type="text" value="ft"/>

Copyright 2000 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

0.543
5 yed. 1.02 yed
swale 5

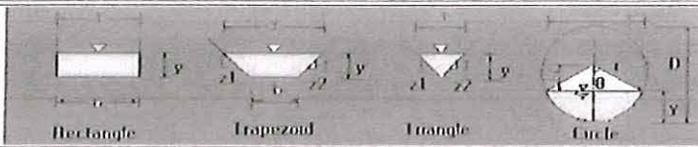The open channel flow calculator			
Select Channel Type: Trapezoid ▾			
Depth from Q ▾	Select unit system: Feet(ft) ▾		
Channel slope: <input type="text" value="0.05"/> (ft/ft)	Water depth(y): <input type="text" value="0.21"/> (ft)	Bottom width(b) <input type="text" value="2"/> (ft)	
Flow velocity <input type="text" value="2.784683"/> (ft/s)	Left Slope (Z1): <input type="text" value="3"/> (to 1 (H:V))	Right Slope (Z2): <input type="text" value="3"/> (to 1 (H:V))	
Flow discharge <input type="text" value="1.5"/> (ft ³ /s)	Input n value <input type="text" value="0.035"/> (or select r)		
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="3.3"/> (ft)	Flow area <input type="text" value="0.54"/> (ft ²)	Top width(T) <input type="text" value="3.23"/> (ft)	
Specific energy <input type="text" value="0.33"/> (ft)	Froude number <input type="text" value="1.2"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.23"/> (ft)	Critical slope <input type="text" value="0.0321"/> (ft/ft)	Velocity head <input type="text" value="0.12"/> (ft)	

Copyright 2009 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

C.S. 21
10/10/20
Scale H5

The open channel flow calculator			
Select Channel Type: Trapezoid ▼			
Depth from Q ▼	Select unit system: Feet(ft) ▼		
Channel slope: <input type="text" value="0.05"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.3"/> <input type="text" value="ft"/>	Bottom width(b) <input type="text" value="2"/> <input type="text" value="ft"/>	
Flow velocity <input type="text" value="3.504871"/> <input type="text" value="ft/s"/>	Left Slope (Z1): <input type="text" value="3"/> <input type="text" value="to 1 (H:V)"/>	Right Slope (Z2): <input type="text" value="3"/> <input type="text" value="to 1 (H:V)"/>	
Flow discharge <input type="text" value="3.1"/> <input type="text" value="ft^3/s"/>	Input n value <input type="text" value="0.035"/> <input type="text" value="or select n"/>		
<input type="button" value="Calculate!"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="3.92"/> <input type="text" value="ft"/>	Flow area <input type="text" value="0.88"/> <input type="text" value="ft^2"/>	Top width(T) <input type="text" value="3.82"/> <input type="text" value="ft"/>	
Specific energy <input type="text" value="0.49"/> <input type="text" value="ft"/>	Froude number <input type="text" value="1.28"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.35"/> <input type="text" value="ft"/>	Critical slope <input type="text" value="0.0283"/> <input type="text" value="ft/ft"/>	Velocity head <input type="text" value="0.19"/> <input type="text" value="ft"/>	


Copyright 2000 Dr. Xing Fang, Department of Civil Engineering, Lamar University.

CS 465
5 year
Swale 2

The open channel flow calculator			
Select Channel Type: Trapezoid ▼			
Depth from Q ▼	Select unit system: Feet(ft) ▼		
Channel slope: <input type="text" value="0.055"/> (ft/ft)	Water depth(y): <input type="text" value="0.31"/> (ft)	Bottom width(b) <input type="text" value="5"/> (ft)	
Flow velocity <input type="text" value="3.375452"/> (ft/s)	LeftSlope (Z1): <input type="text" value="18"/> (to 1 (H:V))	RightSlope (Z2): <input type="text" value="18"/> (to 1 (H:V))	
Flow discharge <input type="text" value="11"/> (ft ³ /s)	Input n value <input type="text" value="0.035"/> or select n		
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="16.13"/> (ft)	Flow area <input type="text" value="3.26"/> (ft ²)	Top width(T) <input type="text" value="16.11"/> (ft)	
Specific energy <input type="text" value="0.49"/> (ft)	Froude number <input type="text" value="1.32"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.36"/> (ft)	Critical slope <input type="text" value="0.0287"/> (ft/ft)	Velocity head <input type="text" value="0.18"/> (ft)	

Copyright 2000 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

*CS #6
100 year
swale 2*

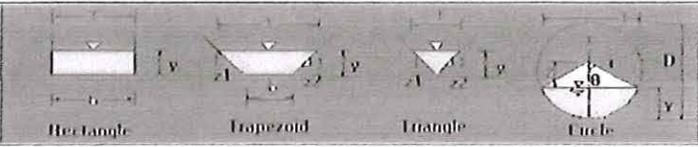The open channel flow calculator			
Select Channel Type: Trapezoid ▼			
Depth from Q ▼	Select unit system: Feet(ft) ▼		
Channel slope: <input type="text" value=".055"/> (ft/ft)	Water depth(y): <input type="text" value="0.73"/> (ft)	Bottom width(b): <input type="text" value="5"/> (ft)	
Flow velocity <input type="text" value="5.515"/> (ft/s)	Left Slope (Z1): <input type="text" value="18"/> to 1 (H:V)	Right Slope (Z2): <input type="text" value="18"/> to 1 (H:V)	
Flow discharge <input type="text" value="72.2"/> (ft ³ /s)	Input n value <input type="text" value=".035"/> or select n		
<input type="button" value="Calculate!"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="31.15"/> (ft)	Flow area <input type="text" value="13.09"/> (ft ²)	Top width(T) <input type="text" value="31.11"/> (ft)	
Specific energy <input type="text" value="1.2"/> (ft)	Froude number <input type="text" value="1.5"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.88"/> (ft)	Critical slope <input type="text" value="0.022"/> (ft/ft)	Velocity head <input type="text" value="0.47"/> (ft)	

Copyright 2000 Dr. Xing Fang, Department of Civil Engineering, Lamar University.

C.S 17
35 y 5
Swale 3

The open channel flow calculator			
Select Channel Type: Trapezoid ▼			
Depth from Q ▼	Select unit system: Feet(ft) ▼		
Channel slope: <input type="text" value="0.083"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.32"/> <input type="text" value="ft"/>	Bottom width(b) <input type="text" value="5"/> <input type="text" value="ft"/>	
Flow velocity <input type="text" value="4.394482"/> <input type="text" value="ft/s"/>	Left Slope (Z1): <input type="text" value="15"/> <input type="text" value="to 1 (H:V)"/>	Right Slope (Z2): <input type="text" value="15"/> <input type="text" value="to 1 (H:V)"/>	
Flow discharge <input type="text" value="14"/> <input type="text" value="ft^3/s"/>	Input n value <input type="text" value="0.035"/> <input type="text" value="or select n"/>		
<input type="button" value="Calculate!"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="14.72"/> <input type="text" value="ft"/>	Flow area <input type="text" value="3.19"/> <input type="text" value="ft^2"/>	Top width(T) <input type="text" value="14.7"/> <input type="text" value="ft"/>	
Specific energy <input type="text" value="0.62"/> <input type="text" value="ft"/>	Froude number <input type="text" value="1.66"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.42"/> <input type="text" value="ft"/>	Critical slope <input type="text" value="0.0274"/> <input type="text" value="ft/ft"/>	Velocity head <input type="text" value="0.3"/> <input type="text" value="ft"/>	

Copyright 2000 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

CS8
100 y. edr
swale 3

The open channel flow calculator		
Select Channel Type: Trapezoid ▾		
Depth from Q ▾	Select unit system: Feet(ft) ▾	
Channel slope: <input type="text" value="0.083"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.77"/> <input type="text" value="ft"/>	Bottom width(b): <input type="text" value="5"/> <input type="text" value="ft"/>
Flow velocity <input type="text" value="7.207"/> <input type="text" value="ft/s"/>	Left Slope (Z1): <input type="text" value="15"/> <input type="text" value="to 1 (H:V)"/>	Right Slope (Z2): <input type="text" value="15"/> <input type="text" value="to 1 (H:V)"/>
Flow discharge <input type="text" value="91.7"/> <input type="text" value="ft^3/s"/>	Input n value <input type="text" value="0.035"/> <input type="text" value="or select n"/>	
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>
Wetted perimeter <input type="text" value="28.13"/> <input type="text" value="ft"/>	Flow area <input type="text" value="12.72"/> <input type="text" value="ft^2"/>	Top width(T) <input type="text" value="28.08"/> <input type="text" value="ft"/>
Specific energy <input type="text" value="1.58"/> <input type="text" value="ft"/>	Froude number <input type="text" value="1.89"/>	Flow status <input type="text" value="Supercritical flow"/>
Critical depth <input type="text" value="1.03"/> <input type="text" value="ft"/>	Critical slope <input type="text" value="0.0211"/> <input type="text" value="ft/ft"/>	Velocity head <input type="text" value="0.81"/> <input type="text" value="ft"/>

Copyright 2000 Dr. Xing Fang, Department of Civil Engineering, Lamar University.

Improved Inlets

Culvert capacity may be increased through the use of special inlet designs. The Federal Highway Administration has developed extensive data^{19,20} on these. While these designs increase the flow, their use has not been as expected. The increased costs of the special treatments is apparently responsible.

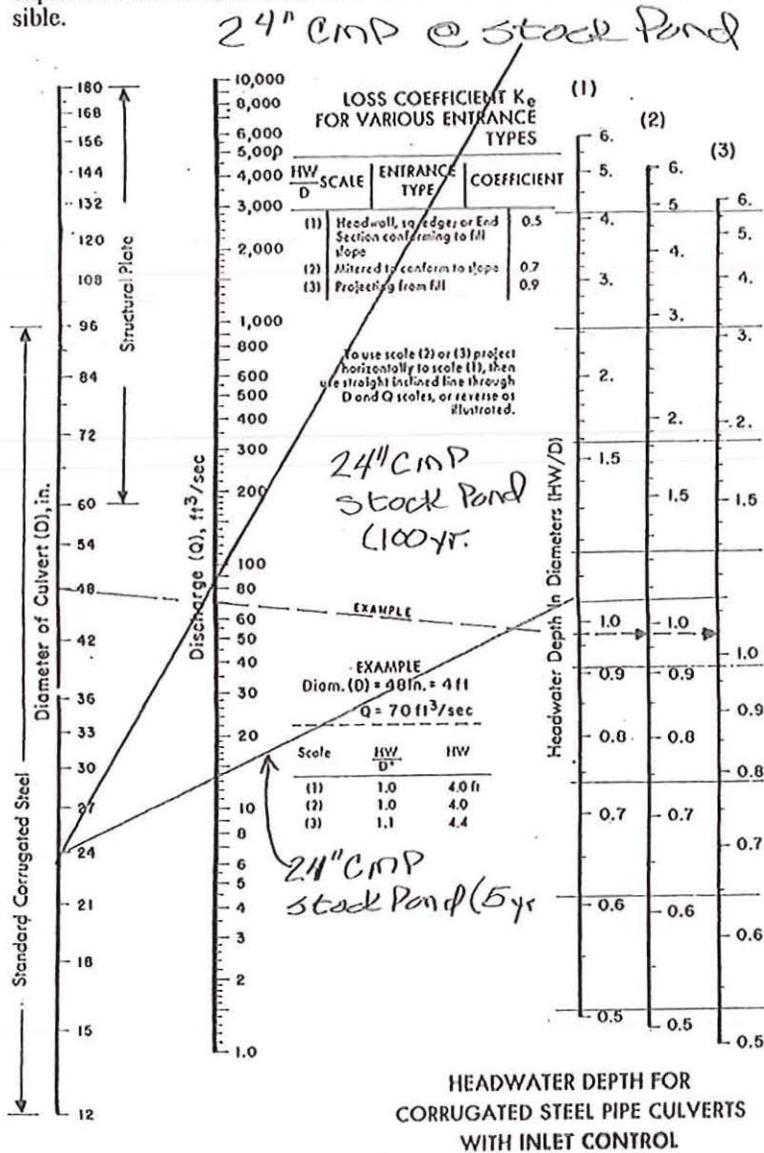


Figure 3.20 Inlet control nomograph for corrugated steel pipe culverts.¹³ The manufacturers recommend keeping HW/D to a maximum of 1.5 and preferably to no more than 1.0 for diameters greater than 4 to 5 feet.

30" Culvert under Thompson Road / 18" Driveaway Culvert CS 10

Improved Inlets

Culvert capacity may be increased through the use of special inlet designs. The Federal Highway Administration has developed extensive data^{19,20} on these. While these designs increase the flow, their use has not been as expected. The increased costs of the special treatments is apparently responsible.

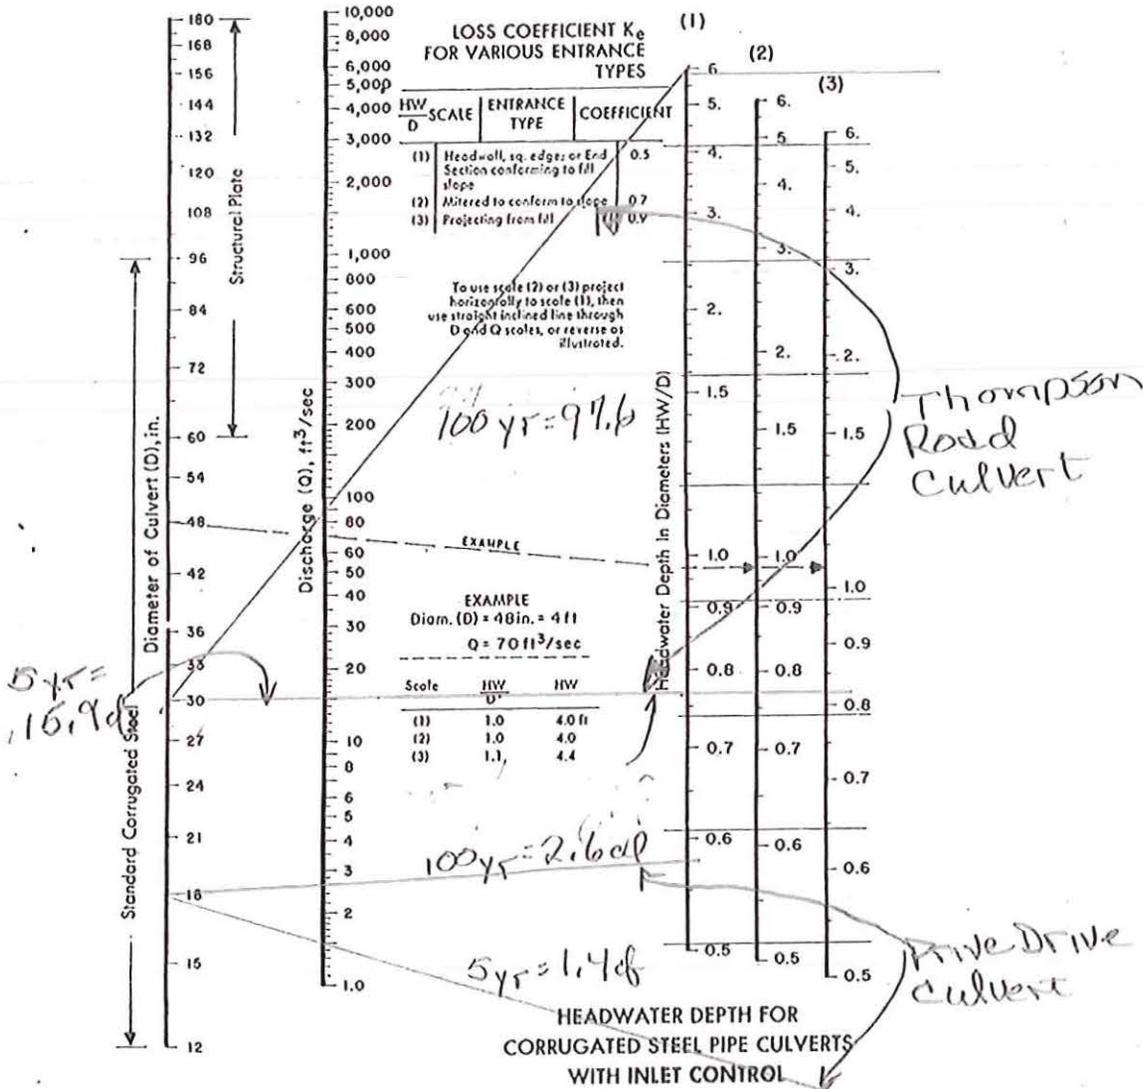


Figure 3.20 Inlet control nomograph for corrugated steel pipe culverts.¹³ The manufacturers recommend keeping HWD to a maximum of 1.5 and preferably to no more than 1.0 for diameters greater than 4 to 5 feet.

C-311
5 year
swale

The open channel flow calculator

Select Channel Type: **Trapezoid** ▼



Depth from Q ▼

Select unit system: **Feet(ft)** ▼

Channel slope: <input type="text" value="0.083"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.35"/> <input type="text" value="ft"/>	Bottom width(b): <input type="text" value="5"/> <input type="text" value="ft"/>
Flow velocity: <input type="text" value="4.819392"/> <input type="text" value="ft/s"/>	Left Slope (Z1): <input type="text" value="10"/> <input type="text" value="to 1 (H:V)"/>	Right Slope (Z2): <input type="text" value="10."/> <input type="text" value="to 1 (H:V)"/>
Flow discharge: <input type="text" value="14.5"/> <input type="text" value="ft^3/s"/>	Input n value: <input type="text" value="0.035"/> <input type="text" value="or select n"/>	
<input type="button" value="Calculate!"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>
Wetted perimeter: <input type="text" value="12.09"/> <input type="text" value="ft"/>	Flow area: <input type="text" value="3.01"/> <input type="text" value="ft^2"/>	Top width(T): <input type="text" value="12.06"/> <input type="text" value="ft"/>
Specific energy: <input type="text" value="0.71"/> <input type="text" value="ft"/>	Froude number: <input type="text" value="1.7"/>	Flow status: <input type="text" value="Supercritical flow"/>
Critical depth: <input type="text" value="0.47"/> <input type="text" value="ft"/>	Critical slope: <input type="text" value="0.026"/> <input type="text" value="ft/ft"/>	Velocity head: <input type="text" value="0.36"/> <input type="text" value="ft"/>

Copyright 2000 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

CS 12
100 years

Swale ~~4~~

The open channel flow calculator		
Select Channel Type: Trapezoid ▼		
Depth from Q ▼	Select unit system: Feet(ft) ▼	
Channel slope: <input type="text" value="0.083"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.87"/> <input type="text" value="ft"/>	Bottom width(b): <input type="text" value="5"/> <input type="text" value="ft"/>
Flow velocity: <input type="text" value="7.938"/> <input type="text" value="ft/s"/>	LeftSlope (Z1): <input type="text" value="10"/> <input type="text" value="to 1 (H:V)"/>	RightSlope (Z2): <input type="text" value="10."/> <input type="text" value="to 1 (H:V)"/>
Flow discharge: <input type="text" value="95"/> <input type="text" value="ft^3/s"/>	Input n value: <input type="text" value="0.035"/> <input type="text" value="or select n"/>	
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>
Wetted perimeter: <input type="text" value="22.53"/> <input type="text" value="ft"/>	Flow area: <input type="text" value="11.97"/> <input type="text" value="ft^2"/>	Top width(T): <input type="text" value="22.44"/> <input type="text" value="ft"/>
Specific energy: <input type="text" value="1.85"/> <input type="text" value="ft"/>	Froude number: <input type="text" value="1.92"/>	Flow status: <input type="text" value="Supercritical flow"/>
Critical depth: <input type="text" value="1.19"/> <input type="text" value="ft"/>	Critical slope: <input type="text" value="0.02"/> <input type="text" value="ft/ft"/>	Velocity head: <input type="text" value="0.98"/> <input type="text" value="ft"/>

Copyright 2000 Dr. Xing Fang, Department of Civil Engineering, Lamar University.

0513
 6yedd
 500le6

The open channel flow calculator			
Select Channel Type: Trapezoid ▾			
Depth from Q ▾	Select unit system: Feet(ft) ▾		
Channel slope: .055 (ft/ft)	Water depth(y): 0.19 (ft)	Bottom width(b): 2 (ft)	
Flow velocity: 2.846931 (ft/s)	Left Slope (Z1): 3 (to 1 (H:V))	Right Slope (Z2): 3 (to 1 (H:V))	
Flow discharge: 1.4 (ft ³ /s)	Input n value: .035 (or select n)		
<input type="button" value="Calculate"/>	Status: Calculation finished	<input type="button" value="Reset"/>	
Wetted perimeter: 3.21 (ft)	Flow area: 0.49 (ft ²)	Top width(T): 3.15 (ft)	
Specific energy: 0.32 (ft)	Froude number: 1.27	Flow status: Supercritical flow	
Critical depth: 0.23 (ft)	Critical slope: 0.0303 (ft/ft)	Velocity head: 0.13 (ft)	

Copyright 2000 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

CS 14

100 yards
3000 ft

The open channel flow calculator			
Select Channel Type: Trapezoid ▼			
Depth from Q ▼	Select unit system: Feet(ft) ▼		
Channel slope: <input type="text" value="0.055"/> <input type="text" value="ft/ft"/>	Water depth(y): <input type="text" value="0.27"/> <input type="text" value="ft"/>	Bottom width(b) <input type="text" value="2"/> <input type="text" value="ft"/>	
Flow velocity <input type="text" value="3.435106"/> <input type="text" value="ft/s"/>	Left Slope (Z1): <input type="text" value="3"/> <input type="text" value="to 1 (H:V)"/>	Right Slope (Z2): <input type="text" value="3"/> <input type="text" value="to 1 (H:V)"/>	
Flow discharge <input type="text" value="2.6"/> <input type="text" value="ft^3/s"/>	Input n value <input type="text" value="0.035"/> <input type="text" value="or select r"/>		
<input type="button" value="Calculate"/>	Status: <input type="text" value="Calculation finished"/>	<input type="button" value="Reset"/>	
Wetted perimeter <input type="text" value="3.7"/> <input type="text" value="ft"/>	Flow area <input type="text" value="0.76"/> <input type="text" value="ft^2"/>	Top width(T) <input type="text" value="3.62"/> <input type="text" value="ft"/>	
Specific energy <input type="text" value="0.45"/> <input type="text" value="ft"/>	Froude number <input type="text" value="1.32"/>	Flow status <input type="text" value="Supercritical flow"/>	
Critical depth <input type="text" value="0.32"/> <input type="text" value="ft"/>	Critical slope <input type="text" value="0.0293"/> <input type="text" value="ft/ft"/>	Velocity head <input type="text" value="0.18"/> <input type="text" value="ft"/>	

Copyright 2009 Dr. Ning Fang, Department of Civil Engineering, Lamar University.

Exhibit 8: State of Colorado Water Tank Jurisdiction

Thompson

RECEIPT NO. *5369* 1-8

5369

STATE OF COLORADO
DEPARTMENT OF WATER RESOURCES
Office of State Engineer

Standard Plans, Drawings
and

SPECIFICATIONS

Including

RULES AND REGULATIONS

Pertaining to

THE FILING OF APPLICATIONS

for

THE APPROVAL

of

LIVESTOCK WATER TANKS



PURSUANT TO H.B. No. 750
SESSION LAWS OF 1941
DENVER, COLORADO, MAY 1, 1941

1D-WK
1-8
621

APPLICATION FOR APPROVAL OF LIVESTOCK WATER TANK

This application and Statement is made in conformity with provisions of the Livestock Water Tank Act of Colorado.

This application must be accompanied by a filing fee of one dollar, payable to the State Engineer of Colorado.

5369

Name of Owner Wilbur Thompson Motor Rte #3 - Colo. Spgs., Colo.
P. O. Address
Location of Tank SW 1/4 Section 19, Township 11 50, Range 65 W 6th P.M.
Name of water course on which tank is located Trib. to East Cherry Creek
Is water course normally dry Yes
Approximate area of drainage basin above tank 80 acres.
Nature of vegetative cover over drainage basin above tank Grass

Character of topography of drainage basin (steep, medium or flat) Medium

Character of surface formation of drainage basin (rock, rocky soil, or soil) Soil

Approximate elevation of drainage basin above sea level 7480 feet.

Is water course subject to floods at times No

Height of top of dam above bottom of water course 9.5 feet.

Height of bottom of spillway above bottom of water course 5.5 feet.

Approximate capacity of tank 2.2 0.2.2 acre feet.

Location of spillway with respect to dam Around Right side facing downstream

Bottom width of spillway at narrowest point 25 feet.

Distance of lower end of spillway below dam 75 feet.

Kind of formations in which spillway is located (rock, shale, clay, earth or mixture of soil and rock) Earth

Width of top of dam 8.0 feet.

Length of top of dam 2.22 feet.

Slope of upstream face of dam 3:1

Slope of downstream face of dam 2:1

Nature of riprap or other protection to be placed over water face of dam

Is the reservoir to be provided with an outlet pipe No
If so, give kind and size of pipe

Give location by section, township and range, and size of every other stock tank now constructed in drainage basin in which this tank will be located

NOTE—Remainder of statements to be furnished by State Engineer's office, 57
Date of receipt of application by State Engineer DEC 6 '57, 19.....
Date of notice from applicant of completion of tank....., 19.....
Tank or site inspected by....., 19.....
Recommendation of Inspector.....
Date of return of plans and specifications to applicant for correction or revision.....


Reasons therefor

Filing Fee Paid DEC 6 '57, 19.....


Application approved this 16 day of December, 1957

Number assigned this stock tank is


By J. B. Whittier
State Engineer
J. G. Marshall
Deputy

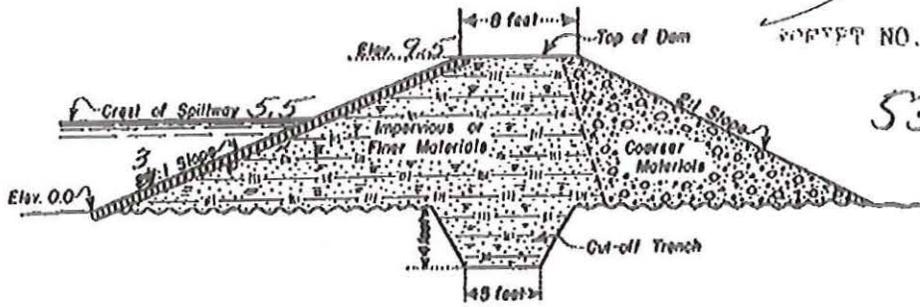

MAXIMUM CROSS-SECTION OF DAM

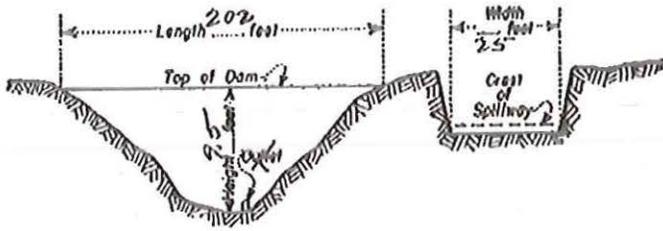

CROSS-SECTION OF DAM SITE AND SPILLWAY
Show length and height of dam and width of spillway on drawing

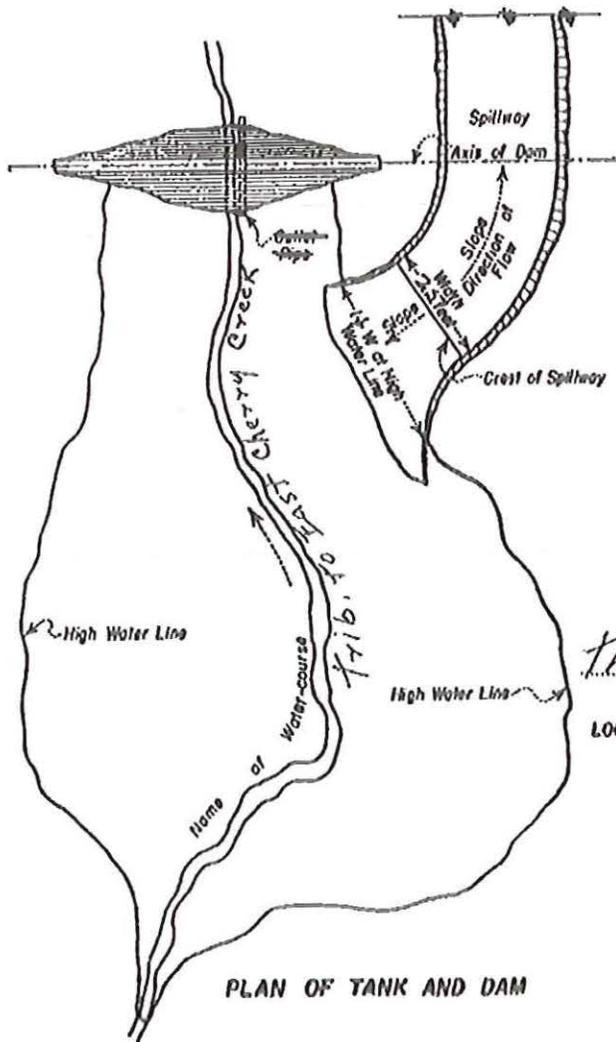

PLAN OF TANK AND DAM

STATEMENT BY OWNER

Know all men by these presents: That the undersigned WILLIAM THOMPSON whose postoffice address is Box 2, C.R. 2, S.E. 9. E. has caused to be located this Stock Water Tank, the essential features of which are shown by this map and plans, which together with the accompanying application and statements are hereby filed with the State Engineer pursuant to the provisions of law.

First: Height of dam above bottom of water-course is 9.5 feet.

Second: Height of spillway above bottom of water-course is 5.5 feet.

Third: Total capacity of said Stock Water Tank is 222 acre feet.

Fourth: The source of supply for said Stock Water Tank is (name of stream) East Cherry Creek

Fifth: Filing of this map and accompanying statements with the State Engineer was made on the 13 day of April, 1927

William Thompson
Owner

MAP AND PLANS

FOR

THOMPSON STOCK WATER TANK AND DAM

LOCATED IN SECTION 19 TWP. 11 S. RANGE 65 W. OF 6 E. P.M.

F.L. PASO COUNTY

DRAINAGE AREA ABOVE DAM 80 ACRES

Approved this 16 day of December, 1927

J. B. Whitson
Stock Engineer
by J. B. Whitson
Deputy

5369

**STATE OF COLORADO
DEPARTMENT OF WATER RESOURCES
OFFICE OF STATE ENGINEER**

**SPECIFICATIONS TO GOVERN THE CONSTRUCTION OF A LIVESTOCK WATER TANK
IN COLORADO CONSTRUCTED AFTER APRIL 17, 1941**

The following specifications and attached general plans shall be followed in the construction of stock water tank No. _____, located in Sec. 19, Township 11 S, Range 65 W 6th am, for which the undersigned on Dec. 13, 1937 filed an application with the State Engineer, as required by law.

Preparation of Foundation for Dam—All vegetable matter of every description, including roots to a depth of two feet, shall be removed from the entire area upon which the dam will rest, following which the top six-inch layer of soil, together with boggy or unstable materials shall be removed and deposited outside the toes of the dam. The banks of the stream channel shall be dressed to a slope of about 1½:1. A bonding trench, with sloping sides and a bottom width of not less than 5 feet and depth of 4 feet, shall then be excavated beneath the center line of the dam the full length thereof, which trench shall be refilled with the most impervious materials available. The foundation of the dam shall then be lightly plowed lengthwise of the dam, to provide proper contact between the foundation and the dam embankment.

Placing of Dam Embankment—The materials shall be placed in the bonding trench and in the embankment of the dam in layers not exceeding 6 inches in thickness, after which each layer shall be thoroughly compacted by a heavily loaded disc cultivator, a corrugated or sheep's foot roller, the treads of a caterpillar or trucks, or by livestock used in the construction. During the construction period, the top of the embankment shall be maintained as a horizontal plane the full width and length thereof, and no side dumping of materials shall be permitted. The materials shall at all times contain just sufficient moisture to provide proper compaction. Puddling of material with water shall not be permitted. No frozen material or large clods or stones shall be incorporated in the dam. The upstream face of the dam shall be constructed with a slope not steeper than 2½:1, and the downstream face on a slope not steeper than 2:1. The crest or top of the finished dam shall be not less than 8 feet in width.

The upstream two-thirds of the dam shall be constructed of the most impervious materials, such as clay loam, or a mixture of clay and sand, and the downstream one third of more pervious material, such as sand or gravel. The upstream face of the dam shall be adequately protected against wave action by stone riprap, or other suitable materials.

Outlet—Should the state engineer so require, there shall be located beneath the dam a galvanized, corrugated steel pipe of No. 14 gauge and not less than 8 inches in diameter, equipped with a suitable control valve attached to the upstream end of the pipe, together with suitable mechanism for operating the valve. Such outlet pipe, when required, shall be provided with concrete collars enclosing each joint of the pipe. The pipe shall be placed in a trench bottomed in stable formations, and shall be completely surrounded with well compacted impervious materials.

Spillway—For the protection of the dam, an adequate spillway or channel shall be constructed around one or both ends of the dam, of sufficient width to provide a capacity to carry the entire discharge from the drainage basin above the dam during periods of unusual runoff. The spillway shall be located in stable formations not easily eroded, and shall extend to a point well downstream from the dam. The following table shall be used to determine the necessary depth and width of spillway to meet the above requirements. The top of the dam at all points shall be not less than 4 feet above the bottom of the spillway.

Table Showing Required Freeboard, Widths and slopes of Spillways for small Earth Dams, with Drainage Areas above the Same as Shown, Based upon a maximum Peak Runoff of 640 Second Feet per Square Mile, or 1 Second Foot per Acre, with an Allowance of a Minimum Freeboard between the Maximum High Water Line and Top of Dam, of 2.3 Feet, and Maximum Velocities of 3.5 Feet per Second of Time.


AREA OF DRAINAGE BASIN ABOVE DAM IN ACRES	PEAK RUNOFF IN CU. FT. PER SECOND	ASSUMED VELOCITY THROUGH SPILLWAY IN FEET PER SECOND	REQUIRED WIDTH OF SPILLWAY "W" AT HIGHEST POINT IN FEET	DEPTH OF WATER IN SPILLWAY IN FEET	SLOPE OF SPILLWAY IN FEET PER 100 FEET OF LENGTH
100	100	3.0	88	1.5	0.25
200	200	3.0	44	1.5	0.25
300	300	3.0	60	1.5	0.25
400	400	3.0	63	1.5	0.25
500	500	3.0	110	1.5	0.25
600	600	3.0	133	1.5	0.25
700	700	3.0	125	1.5	0.25
800	800	3.0	177	1.5	0.25
900	900	3.0	209	1.5	0.25
1000	1000	3.0	239	1.5	0.25
1100	1100	3.0	210	1.6	0.23
1200	1200	3.2	214	1.7	0.23
1300	1300	3.3	220	1.7	0.23
1400	1400	3.4	240	1.7	0.23
1500	1500	3.4	260	1.7	0.23
1600	1600	3.5	270	1.7	0.23
1700	1700	3.5	285	1.7	0.23
1800	1800	3.5	299	1.7	0.23
1900	1900	3.5	315	1.7	0.23
2000	2000	3.5	330	1.7	0.23

The above spillway widths may be reduced at a point 50 feet below intake, by 25 per cent, where the spillway is located the full length thereof in hard clay or shale, and by 50 per cent when located in hard rock formations, if the slope or grade of the bottom is increased accordingly. The grade for clay and shale formations should be 0.30 foot per 100 feet, and for rock formations 0.0 foot per 100 feet. The width of the entrance to the spillway must in all cases be one-third wider than shown in the Table, and the bottom should slope from the lower end of the funnel section, toward the reservoir 1.0 foot in the distance of 50 feet.

Borrow Pits—Borrow pits, from which materials are taken to build the dam, shall be cleared of all vegetable matter, and no material shall be borrowed within a distance of 50 feet of any part of the dam. Materials excavated from the spillway, when suitable, are to be used in building the dam.

Date Dec. 13, 1937

Walter C. Thompson
Owner
Colorado Springs #H3 Colo.
Post Office Address

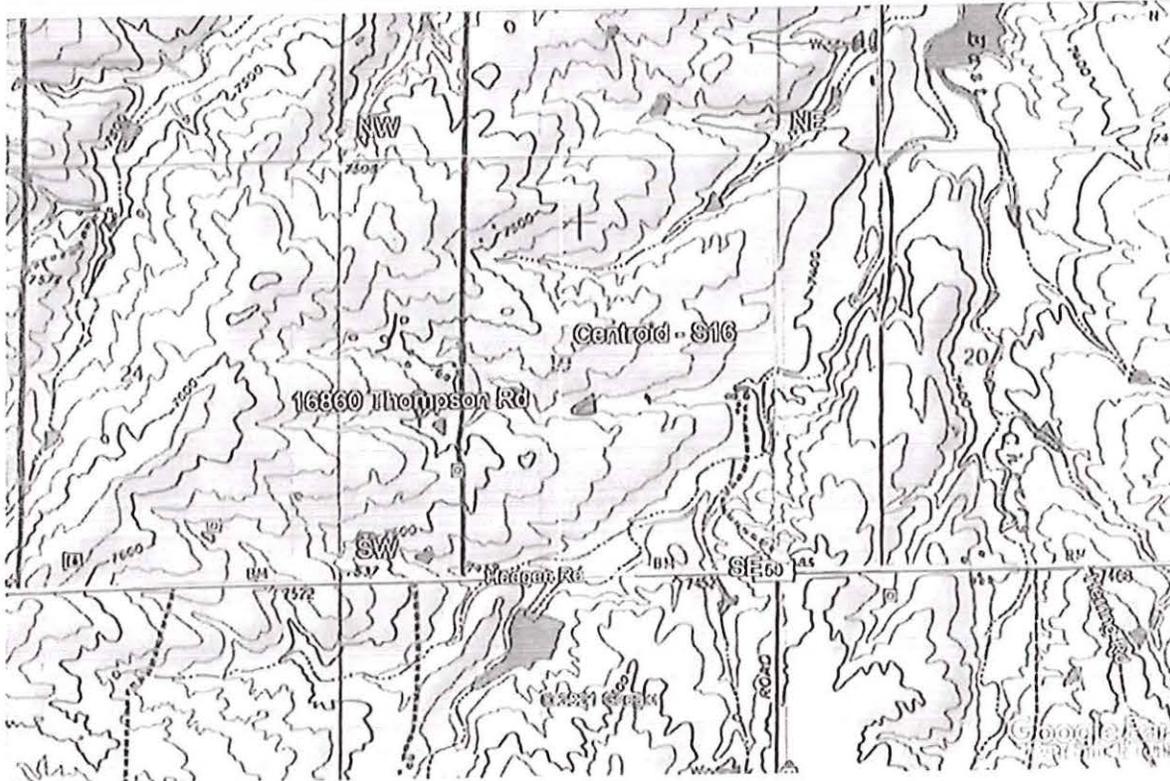

Completion of Construction

PLATE 19, 231A

Upon the completion of the construction of the
W. THOMPSON Live Stock Water Tank, located
in Sec. 19, Twp. 11 So., Rng. 65 W. 62 E. the
approved Plans and Specifications of which are hereto attached, indicate
in the blank at the bottom of this form, the date of completion of con-
struction and return to—

THE STATE ENGINEER, CAPITOL BLDG., DENVER, COLO-
RADO, so that he may, if he desires, inspect said tank.

Date of completion 6th August 1947

Section - BLM database

Section	S19 T11S R65W
Meridian	Sixth
State	Colorado
Source	<u>BLM</u>
GLO	<u>GLO Township Records</u>

Calculated Values

Acres	670
Centroid	39.0783479, -104.7098090
Corners	NW 39.0855777, -104.7195110
	NE 39.0856382, -104.7000033
	SE 39.0711175, -104.7001627
	SW 39.0710445, -104.7195517

Exhibit 9: Existing Swale Photographs



Figure 1: facing east along central swale (S1, S2)



Figure 3: Facing NW from east side of property

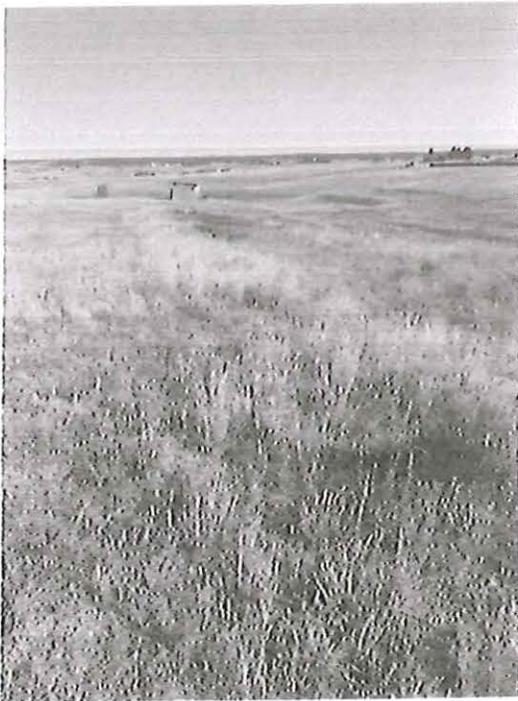


Figure 2: Facing east along central swale




Figure 4: top of Stock Pond Embankment facing south

Exhibit 10: Historic Drainage Conditions (map pocket)

DESIGN POINT SUMMARY



DESIGN POINT	CONTRIB SUB BASINS	AREA (ACRES)	Tc (CFS)	C5 (CFS)	C100 (CFS)	CA5 (CFS)	CA100 (CFS)	Q5 (CFS)	Q100 (CFS)
1	OS1	34.1	23.2	0.09	0.36			8.7	58.5
2	OS3	0.6	15	0.08	0.35			0.2	1.2
3	OS4	0.6	13.3	0.17	0.41			0.4	1.5
4	OS7	3.6	15.5	0.12	0.38			1.5	8.0
5	OS1,OS3,OS4,OS5,OS7,A	45.6	27			4.16	16.31	11.0	72.2
6	DP5,OS6,B,OS2	60.3	28.4			5.47	21.28	14.0	91.5
7	DP6,C,OS8	62.5	29			5.71	22.37	14.5	95.0
8	OS5	0.4	10.9	0.08	0.35			0.1	0.9
9	OS6	0.9	15.2	0.08	0.35			0.3	1.9
10	OS2	10.3	17.9	0.10	0.36			3.3	20.5
11	OS8	1.4	14.1	0.08	0.35			0.4	3.0
12	OS10	0.5	5.3	0.57	0.72			1.5	3.1
13	OS9	0.4	6.1	0.70	0.81			1.4	2.6
14	DP7,OS9,OS10	61.5	29			6.28	23.05	15.9	97.9
	Lot 1 located in sub basin B	5.5	12.9	0.08	0.35			1.8	13.3
	Lot 2 located in sub basin A	5.0	14.8	0.08	0.35			1.2	8.9



LEGEND:

- XXX-- INDEX CONTOURS
- - - - - INTERMEDIATE CONTOURS
- - - - - SUBDIVISION BOUNDARY
- - - - - SUBBASIN BOUNDARY
- ← DIRECTION OF FLOW
- - - - - EXISTING SWALE CENTERLINE
- △ DESIGN POINT
- ⊗ SWALE NUMBER
- ⊗ SUBBASIN I.D.
- ⊗ DRAINAGE STRUCTURE NUMBER
- STR DRAINAGE STRUCTURE
- EXISTING BUILDING
- NO BUILD AREA BOUNDARY
- EXISTING STOCK POND

Swale Summary												
Existing Conditions and Developed Conditions												
Swale #	Design Points	Contributing Subbasins	Slope %	Design Flow		Depth of Flow		Velocity		Froude Number (5 year)	Flow Regime	
				Q5 cfs	Q100 cfs	Q5 ft	Q100 ft	Q5 fps	Q100 fps			
S1	1	OS1	4.7	8.7	58.5	0.3	0.7	2.9	4.8	1.21	super	
S2	1 to 5	OS1,OS3, OS4, A, OS7	5.5	11	72.2	0.3	0.7	3.4	5.5	1.32	super	
S3	5 to 6	DP5, B, OS2	8.3	14	91.7	0.3	0.8	4.4	7.2	1.66	super	
S4	6 to 7	DP10, C, OS8	8.3	14.5	95	0.4	0.9	4.8	7.9	1.7	super	
S5	12	OS10	5.0	1.5	3.1	0.2	0.3	2.8	3.5	1.2	super	
S6	13	OS9	5.5	1.4	2.6	0.2	0.3	2.8	3.4	1.27	super	

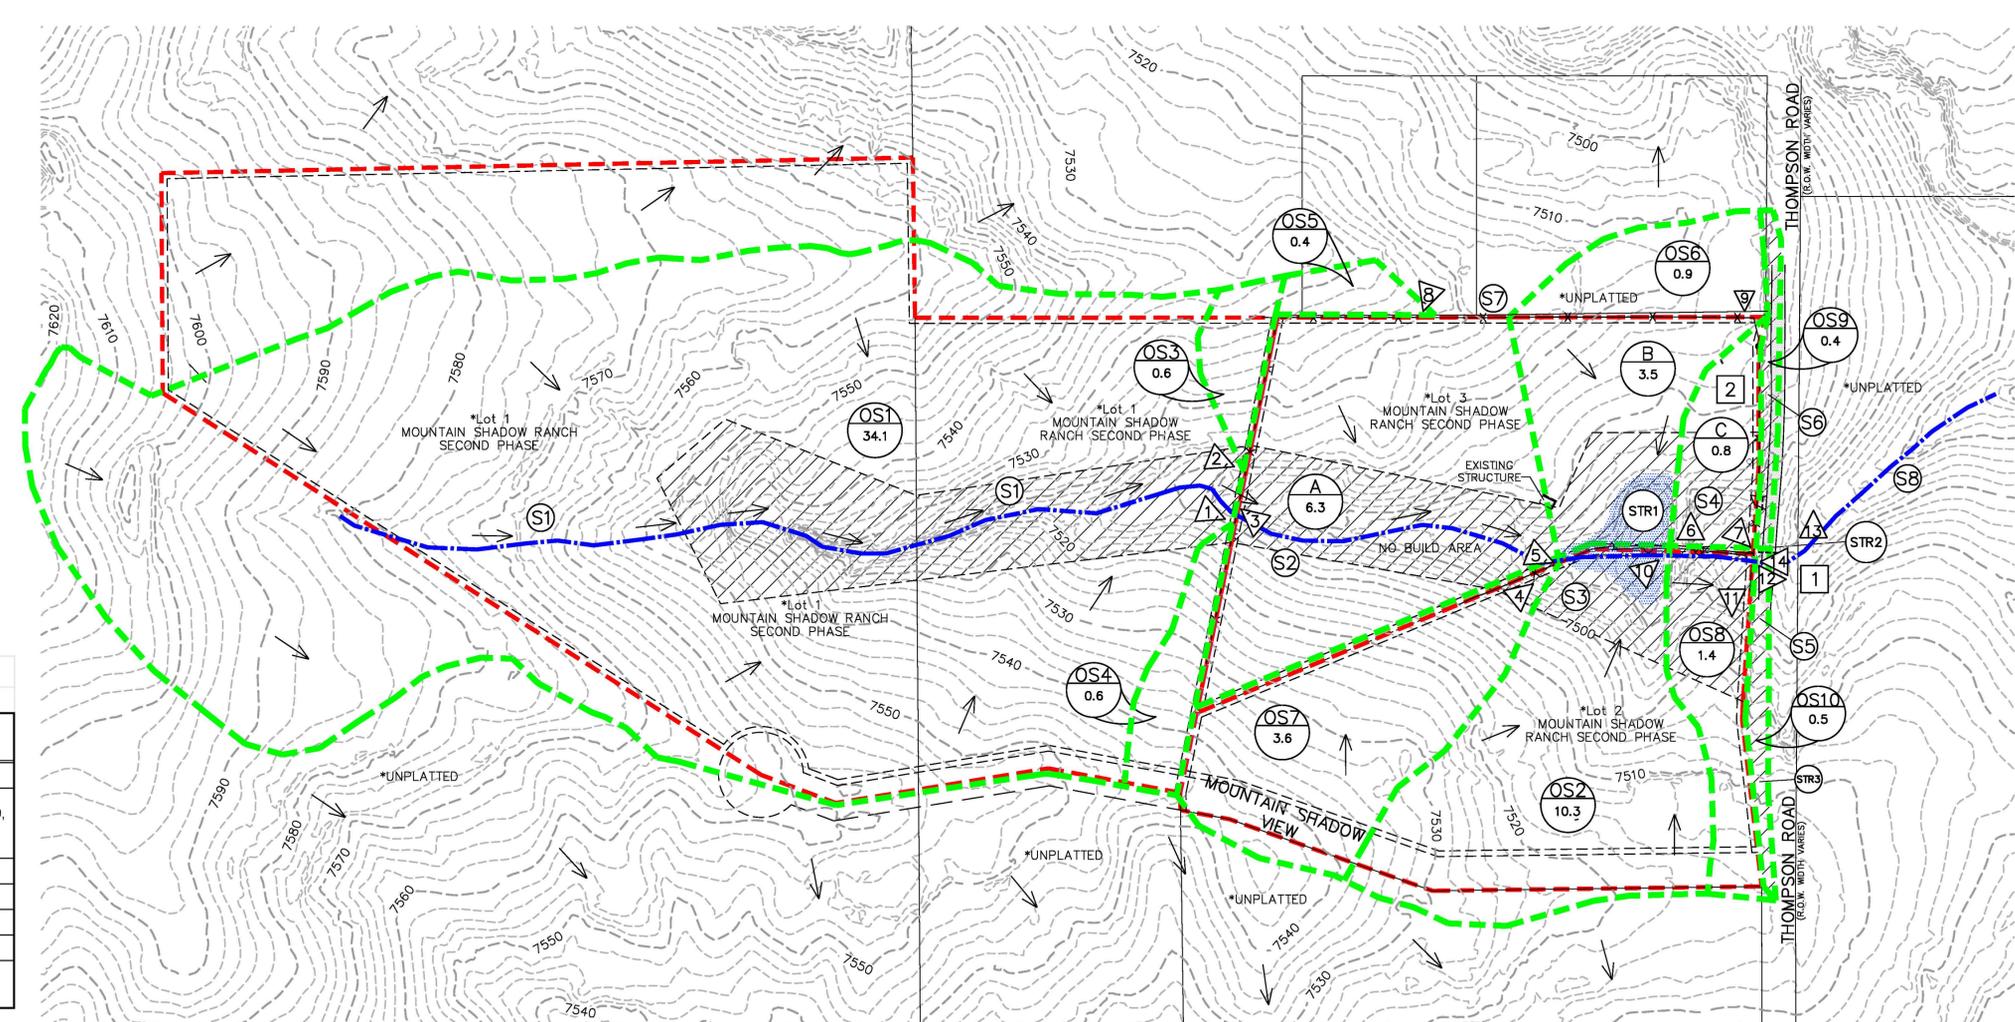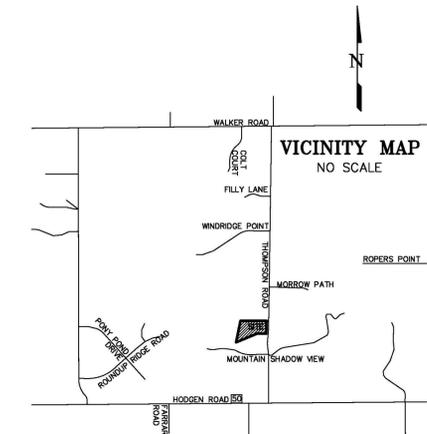

Design Point	DP1	DP5	DP6	DP7	DP14
Swale ID	S1	S2	S3	S4	S5
Contributing Basins	OS1, OS3, OS4	DP1, OS5, OS7, A	DP5, B, OS2	DP6, OS6, C, OS8	DP7, OS9, OS10
CA5	3.17	4.28	5.66	5.9	6.47
CA100	12.57	16.39	21.42	22.53	23.18
Tc (min)	23.2	27	28.4	29	29
Q5 (cfs)	9.1	11.3	14.5	14.9	16.4
Q100 (cfs)	60.5	72.6	92.1	95.7	98.5

According to Colorado law, this plan is void if any legal action based upon any defect in this survey within three years after you sign it. In no event, may any action be based upon any defect in this plan more than ten years from the date of the certification shown hereon.

811 CALL BEFORE YOU DIG

DIAL 811

48 HOURS BEFORE YOU DIG, CALL UTILITY LOCATORS FOR LOCATING AND MARKING GAS, ELECTRIC, WATER AND FIBER OPTIC.

No.	REVISIONS	Date
1	COUNTY COMMENTS	04/09/21
2	COUNTY COMMENTS	07/19/21

H Scale: 1" = 150'
 V Scale: N/A
 Designed By: KH
 Drawn By: TLC
 Checked By: KH
 Date: 11/12/2020

Land Development Consultants, Inc.
 PLANNING · SURVEYING
 www ldc inc · TEL: (719) 528-6133 · FAX: (719) 528-8948
 3888 MAZELAND ROAD · COLORADO SPRINGS, CO 80909


MCGEEHEE SUBDIVISION
 DRAINAGE PLAN
 EXISTING CONDITIONS

Project No.: 20018
 Sheet: 1 of 1

Exhibit 11: Developed Drainage Conditions (map pocket)

DESIGN POINT SUMMARY

DESIGN POINT	CONTRIB SUB BASINS	AREA (ACRES)	Tc (CFS)	C5 (CFS)	C100 (CFS)	CA5 (CFS)	CA100 (CFS)	Q5 (CFS)	Q100 (CFS)
1	OS1	34.1	23.2	0.09	0.36			8.7	58.5
2	OS3	0.6	15	0.08	0.35			0.2	1.2
3	OS4	0.6	13.5	0.17	0.41			0.3	1.3
4	OS7	3.6	15.5	0.12	0.38			1.5	8.0
5	OS1,OS3,OS4,OS5,OS7,A	45.6	27			4.28	16.39	11.3	72.6
6	DP5,OS6,B,OS2	60.3	28.4			5.66	21.42	14.5	92.1
7	DP6,C,OS8	62.5	29			5.71	22.37	14.5	95.0
8	OS5	0.4	10.9	0.08	0.35			0.1	0.9
9	OS6	0.9	15.2	0.08	0.35			0.3	1.9
10	OS2	10.3	17.9	0.10	0.36			3.3	20.5
11	OS8	1.4	14.1	0.08	0.35			0.4	3.0
12	OS10	0.5	5.3	0.57	0.72			1.5	3.1
13	OS9	0.4	6.1	0.70	0.81			1.4	2.6
14	DP7,OS9,OS10	63.4	29			6.47	23.18	16.4	98.5
	Lot 1 located in sub basin B	5.5	12.9	0.11	0.37			1.7	9.4
	Lot 2 located in sub basin A	5.0	14.8	0.08	0.35			2.5	14.1




LEGEND:

- XXX--- INDEX CONTOURS
- XXX--- INTERMEDIATE CONTOURS
- - - - - SUBDIVISION BOUNDARY
- - - - - SUBBASIN BOUNDARY
- ← DIRECTION OF FLOW
- - - - - EXISTING SWALE CENTERLINE
- ▽ DESIGN POINT
- ⊗ SWALE NUMBER
- ⊗ SUBBASIN I.D.
- ⊗ DRAINAGE STRUCTURE NUMBER
- ⊗ DRAINAGE STRUCTURE
- EXISTING BUILDING
- NO BUILD AREA BOUNDARY
- EXISTING STOCK POND

Cummulative Flows

Design Point	DP1	DP5	DP6	DP7	DP14
Swale ID	S1	S2	S3	S4	S5
Contributing Basins	OS1, OS3, OS4	DP1, OS5, OS7, A	DP5, B, OS2	DP6, OS6, C, OS8	DP7, OS9, OS10
CA5	3.17	4.28	5.66	5.9	6.47
CA100	12.57	16.39	21.42	22.53	23.18
Tc (min)	23.2	27	28.4	29	29
Q5 (cfs)	9.1	11.3	14.5	14.9	16.4
Q100 (cfs)	60.5	72.6	92.1	95.7	98.5

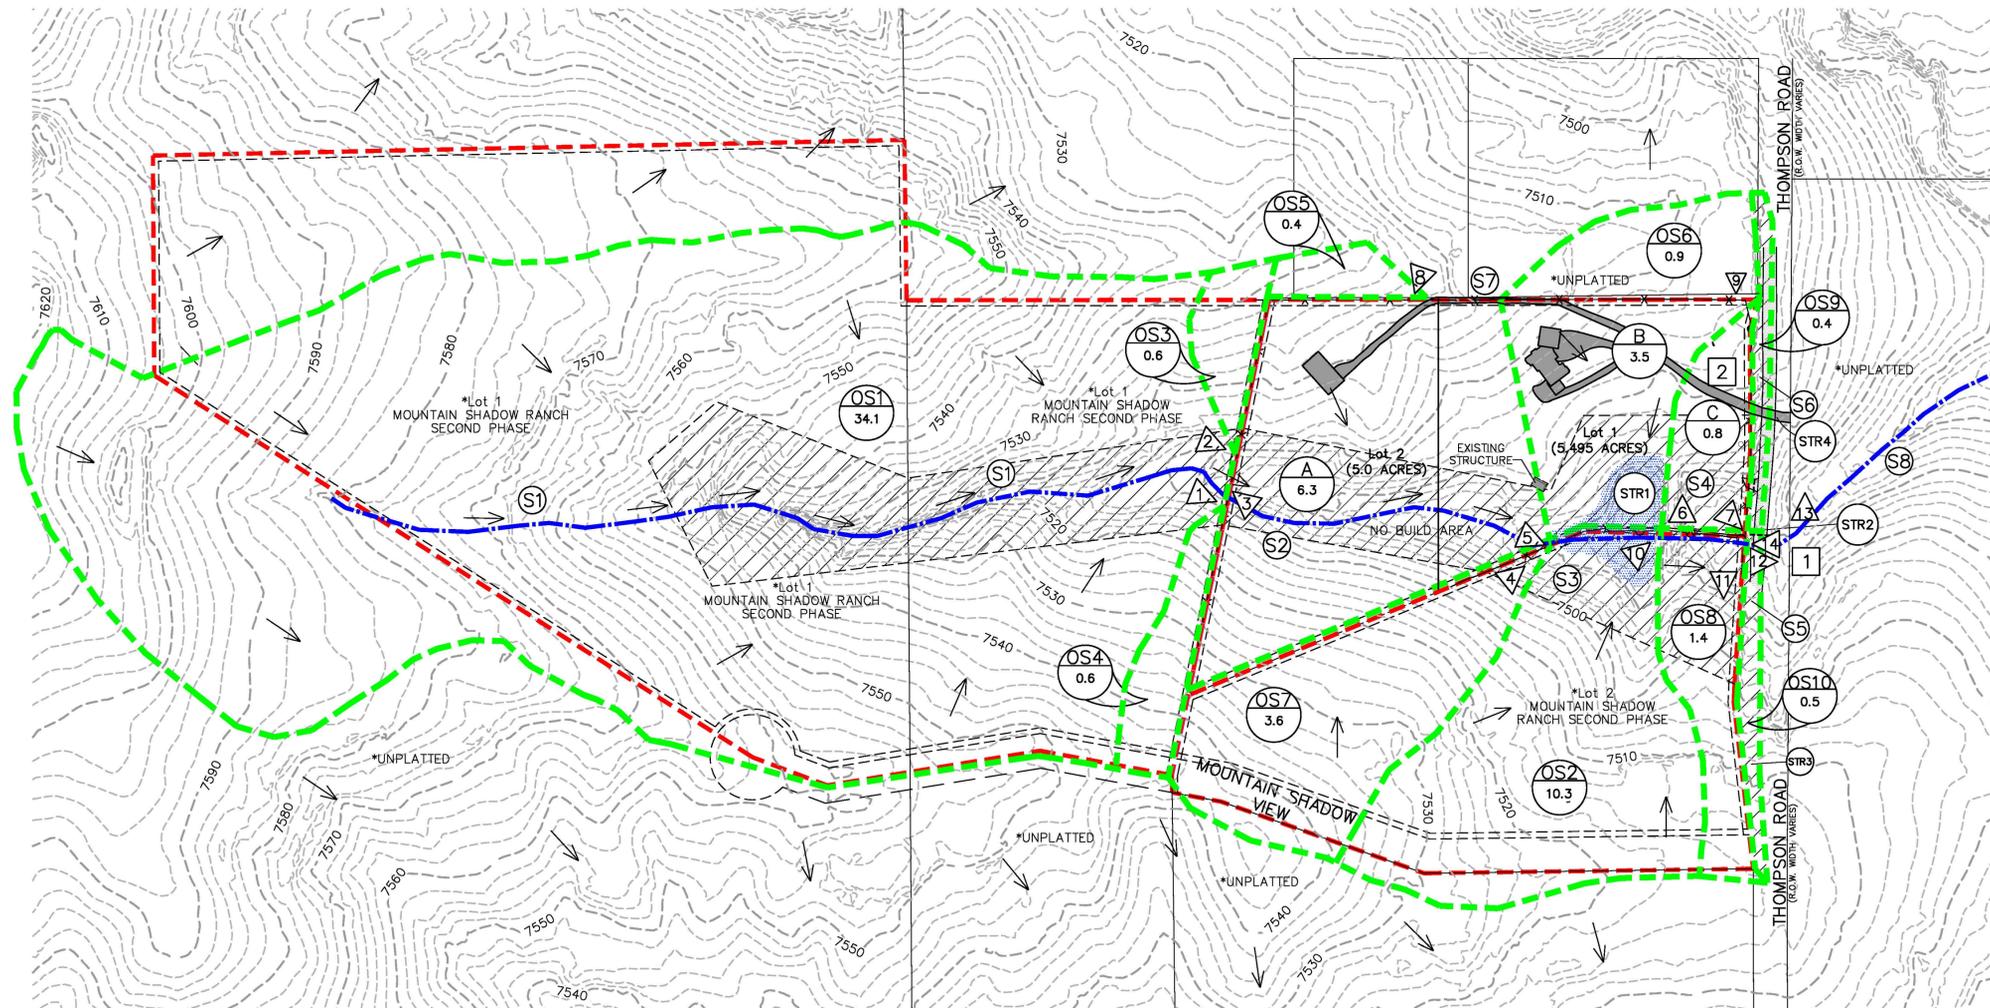


Swale Summary

Swale #	Design Points	Contributing Subbasins	Slope %	Design Flow		Depth of Flow		Velocity		Froude Number (5 year)	Flow Regime
				Q5	Q100	Q5	Q100	Q5	Q100		
				cfs	cfs	ft	ft	fps	fps		
S1	1	OS1	4.7	8.7	58.5	0.3	0.7	2.9	4.8	1.21	super
S2	1 to 5	OS1, OS3, OS4, A, OS7	5.5	11	72.2	0.3	0.7	3.4	5.5	1.32	super
S3	5 to 6	DP5, B, OS2	8.3	14	91.7	0.3	0.8	4.4	7.2	1.66	super
S4	6 to 7	DP10, C, OS8	8.3	14.5	95	0.4	0.9	4.8	7.9	1.7	super
S5	12	OS10	5.0	1.5	3.1	0.2	0.3	2.8	3.5	1.2	super
S6	13	OS9	5.5	1.4	2.6	0.2	0.3	2.8	3.4	1.27	super

DEVELOPED CONDITIONS

DP	CONTRIBUTING SUB BASINS	AREA	Tc	C5	C100	CA5	CA100	Q5	Q100
14	DP7, OS9, OS10	63.4	29			6.47	23.18	16.4	98.5
	Lot 1 (sub basin B)	5.5	12.9	0.11	0.37			2.5	14.1
	Lot 2 (sub basin A)	5.0	14.8	0.11	0.37			1.7	9.4

- NOTES:
- DESIGN POINT 14 IS LOCATED AT THE UPSTREAM END OF THE CULVERT UNDER THOMPSON ROAD.
 - THE MAJORITY OF LOT 2 IS LOCATED IN BASIN A.
 - THE MAJORITY OF LOT 1 IS LOCATED IN BASIN B.
 - ALL OF THE OFFSITE SUB BASINS ARE UNCHANGED FROM EXSITING CONDITIONS.
 - CA VALUES ARE USED IN ORDER TO ACCURATELY REFLECT CONTROLLING Tc.

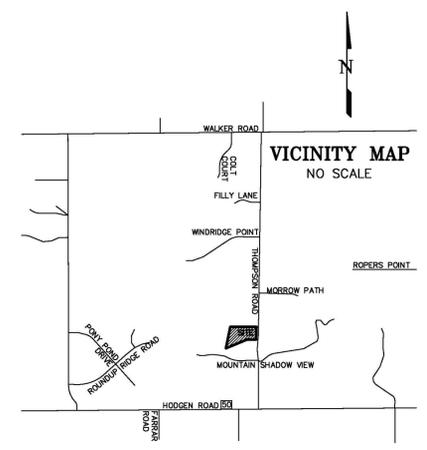

According to Colorado law, this plan is void if any legal action based upon any defect in this survey within three years after you receive this plan. This plan in no event, may any action based upon any defect in this plan be brought more than ten years from the date of the certification shown hereon.

CALL BEFORE YOU DIG ... 811 DIAL 811

48 HOURS BEFORE YOU DIG, CALL UTILITY LOCATORS FOR LOCATING AND MARKING GAS, ELECTRIC, WATER AND FIBER OPTIC.

REVISIONS	No.	Description	Date
	1	COUNTY COMMENTS	04/09/21
	2	COUNTY COMMENTS	07/19/21

H Scale: 1" = 150'
V Scale: N/A
Designed By: KH
Drawn By: TLC
Checked By: KH
Date: 11/12/2020

Land Development Consultants, Inc.
PLANNING · SURVEYING
www ldc inc com · TEL: (719) 528-6133 · FAX: (719) 528-8948
3888 MAZELAND ROAD · COLORADO SPRINGS, CO 80909

MCGEHEE SUBDIVISION
DRAINAGE PLAN
DEVELOPED CONDITIONS

Project No.: 20018
Sheet: 1 of 1