

Stormwater Detention and Infiltration Design Data Sheet

SDI-Design Data v2.00, Released January 2020

Stormwater Facility Name: **Detention Pond A**

Facility Location & Jurisdiction: **Flying Horse North Filing No. 4 - El Paso County**

User Input: Watershed Characteristics

Extended Detention Basin (EDB) ▼	EDB	
Watershed Area =	128.48	acres
Watershed Length =	3,560	ft
Watershed Length to Centroid =	1,400	ft
Watershed Slope =	0.040	ft/ft
Watershed Imperviousness =	7.1%	percent
Percentage Hydrologic Soil Group A =	0.0%	percent
Percentage Hydrologic Soil Group B =	100.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours

Location for 1-hr Rainfall Depths (use dropdown):

User Input	▼
------------	---

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Once CUHP has been run and the Stage-Area-Discharge information has been provided, click 'Process Data' to interpolate the Stage-Area-Volume-Discharge data and generate summary results in the table below. Once this is complete, click 'Print to PDF'.



User Defined Stage [ft]	User Defined Area [ft^2]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	10	0.00	0.00
0.50	379	0.50	0.04
1.00	2,192	1.00	0.08
1.50	7,097	1.50	0.12
2.00	14,797	2.00	0.17
2.50	22,565	2.50	0.21
3.00	29,838	3.00	0.31
3.50	37,249	3.50	16.14
4.00	43,958	4.00	65.05
4.50	49,678	4.50	132.43
5.00	53,785	5.00	162.09
5.50	56,812	5.50	230.47
6.00	59,334	6.00	353.96
6.50	62,623	6.50	518.17
7.00	64,854	7.00	719.05

After completing and printing this worksheet to a pdf, go to:
<https://maperture.digitaldataservices.com/qvh/?viewer=cswdif>
 Create a new stormwater facility, and attach the PDF of this worksheet to that record.

Routed Hydrograph Results

Design Storm Return Period =	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
One-Hour Rainfall Depth =	N/A	1.19	1.50	1.75	2.25	2.52	in
CUHP Runoff Volume =	0.532	1.441	3.437	5.467	11.701	15.348	acre-ft
Inflow Hydrograph Volume =	N/A	1.441	3.437	5.467	11.701	15.348	acre-ft
Time to Drain 97% of Inflow Volume =	36.8	43.9	38.2	33.5	21.2	14.9	hours
Time to Drain 99% of Inflow Volume =	38.8	47.8	45.3	43.1	37.3	34.4	hours
Maximum Ponding Depth =	2.72	3.26	3.70	3.93	4.60	5.07	ft
Maximum Pondered Area =	0.59	0.77	0.91	0.99	1.16	1.24	acres
Maximum Volume Stored =	0.533	0.895	1.263	1.490	2.211	2.771	acre-ft

Stormwater Detention and Infiltration Design Data Sheet

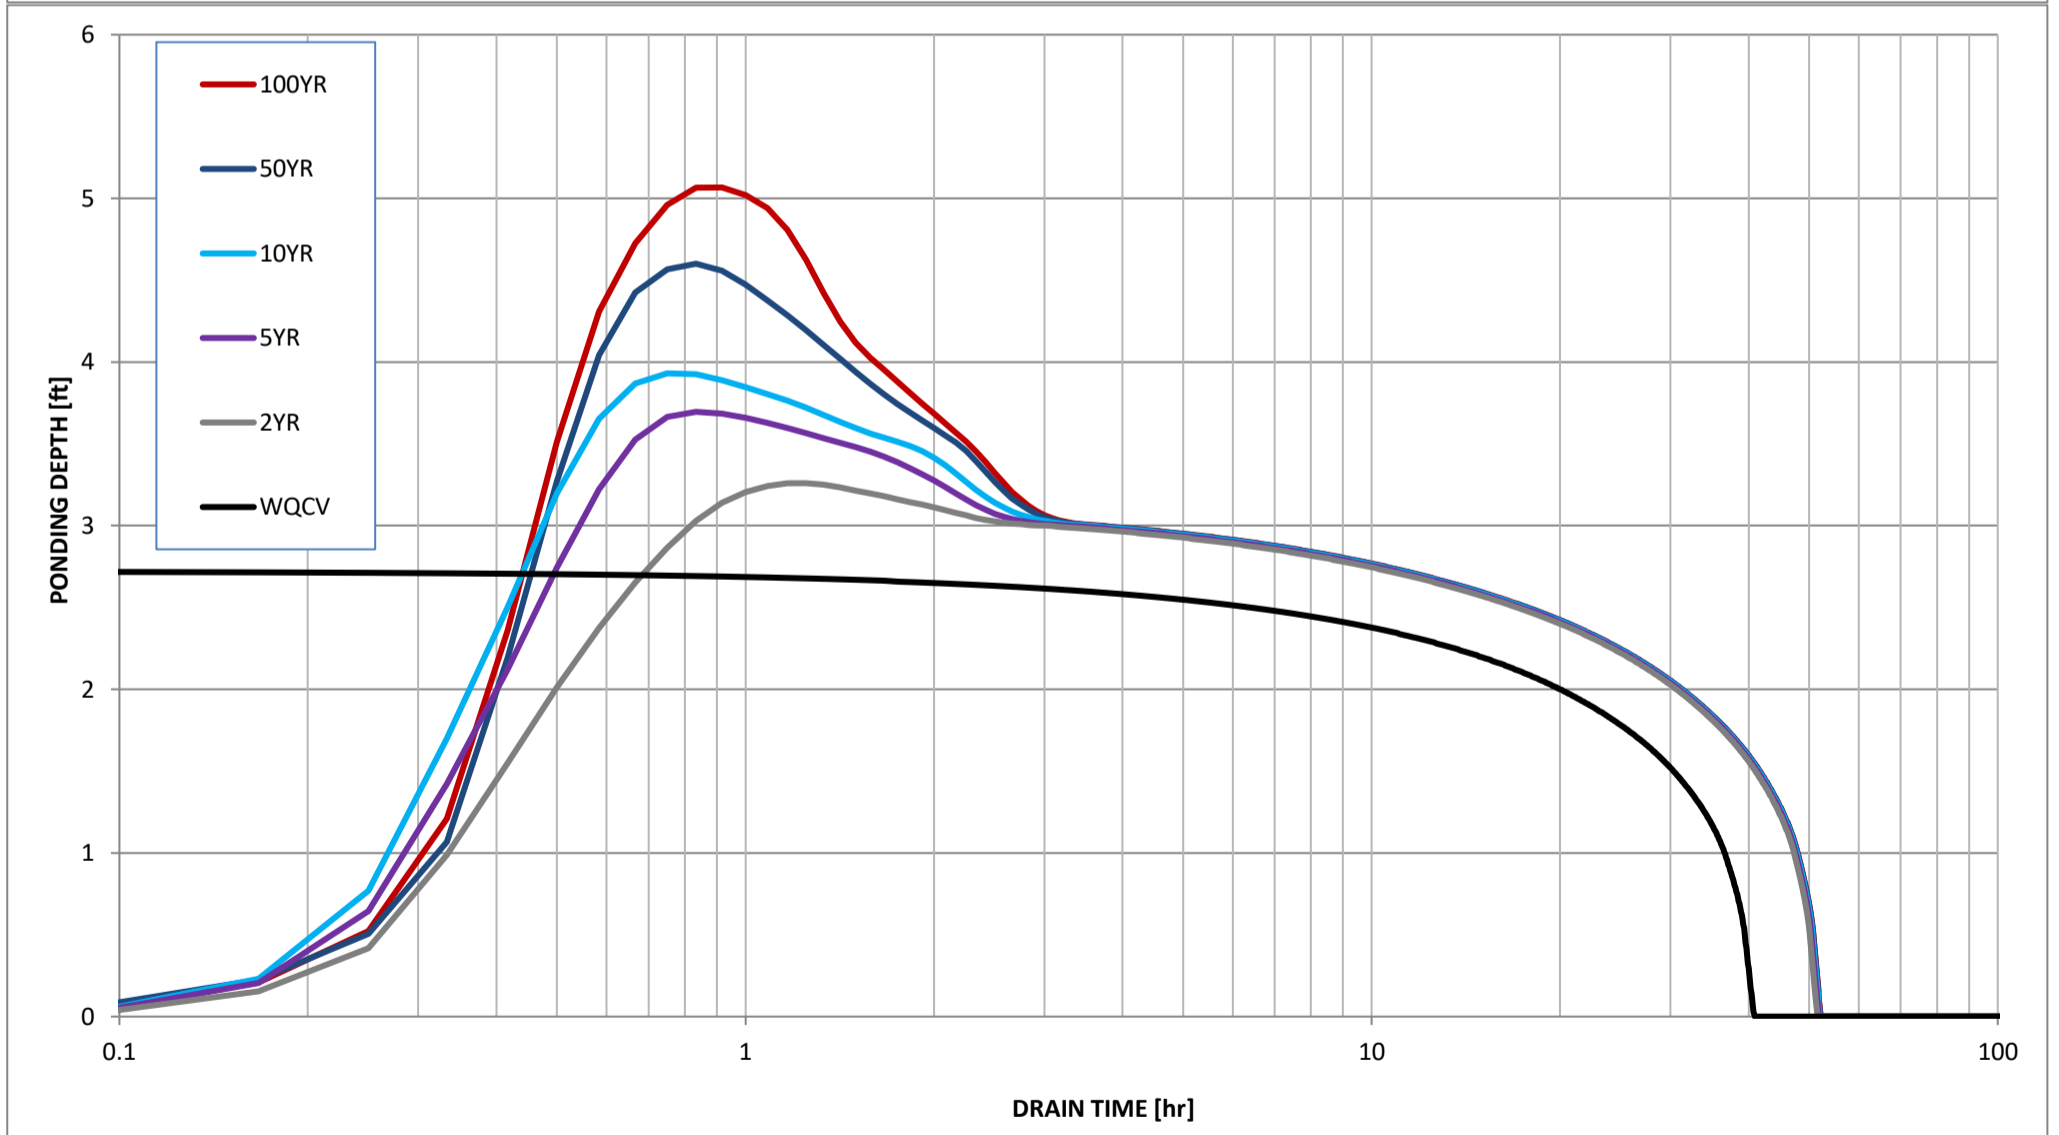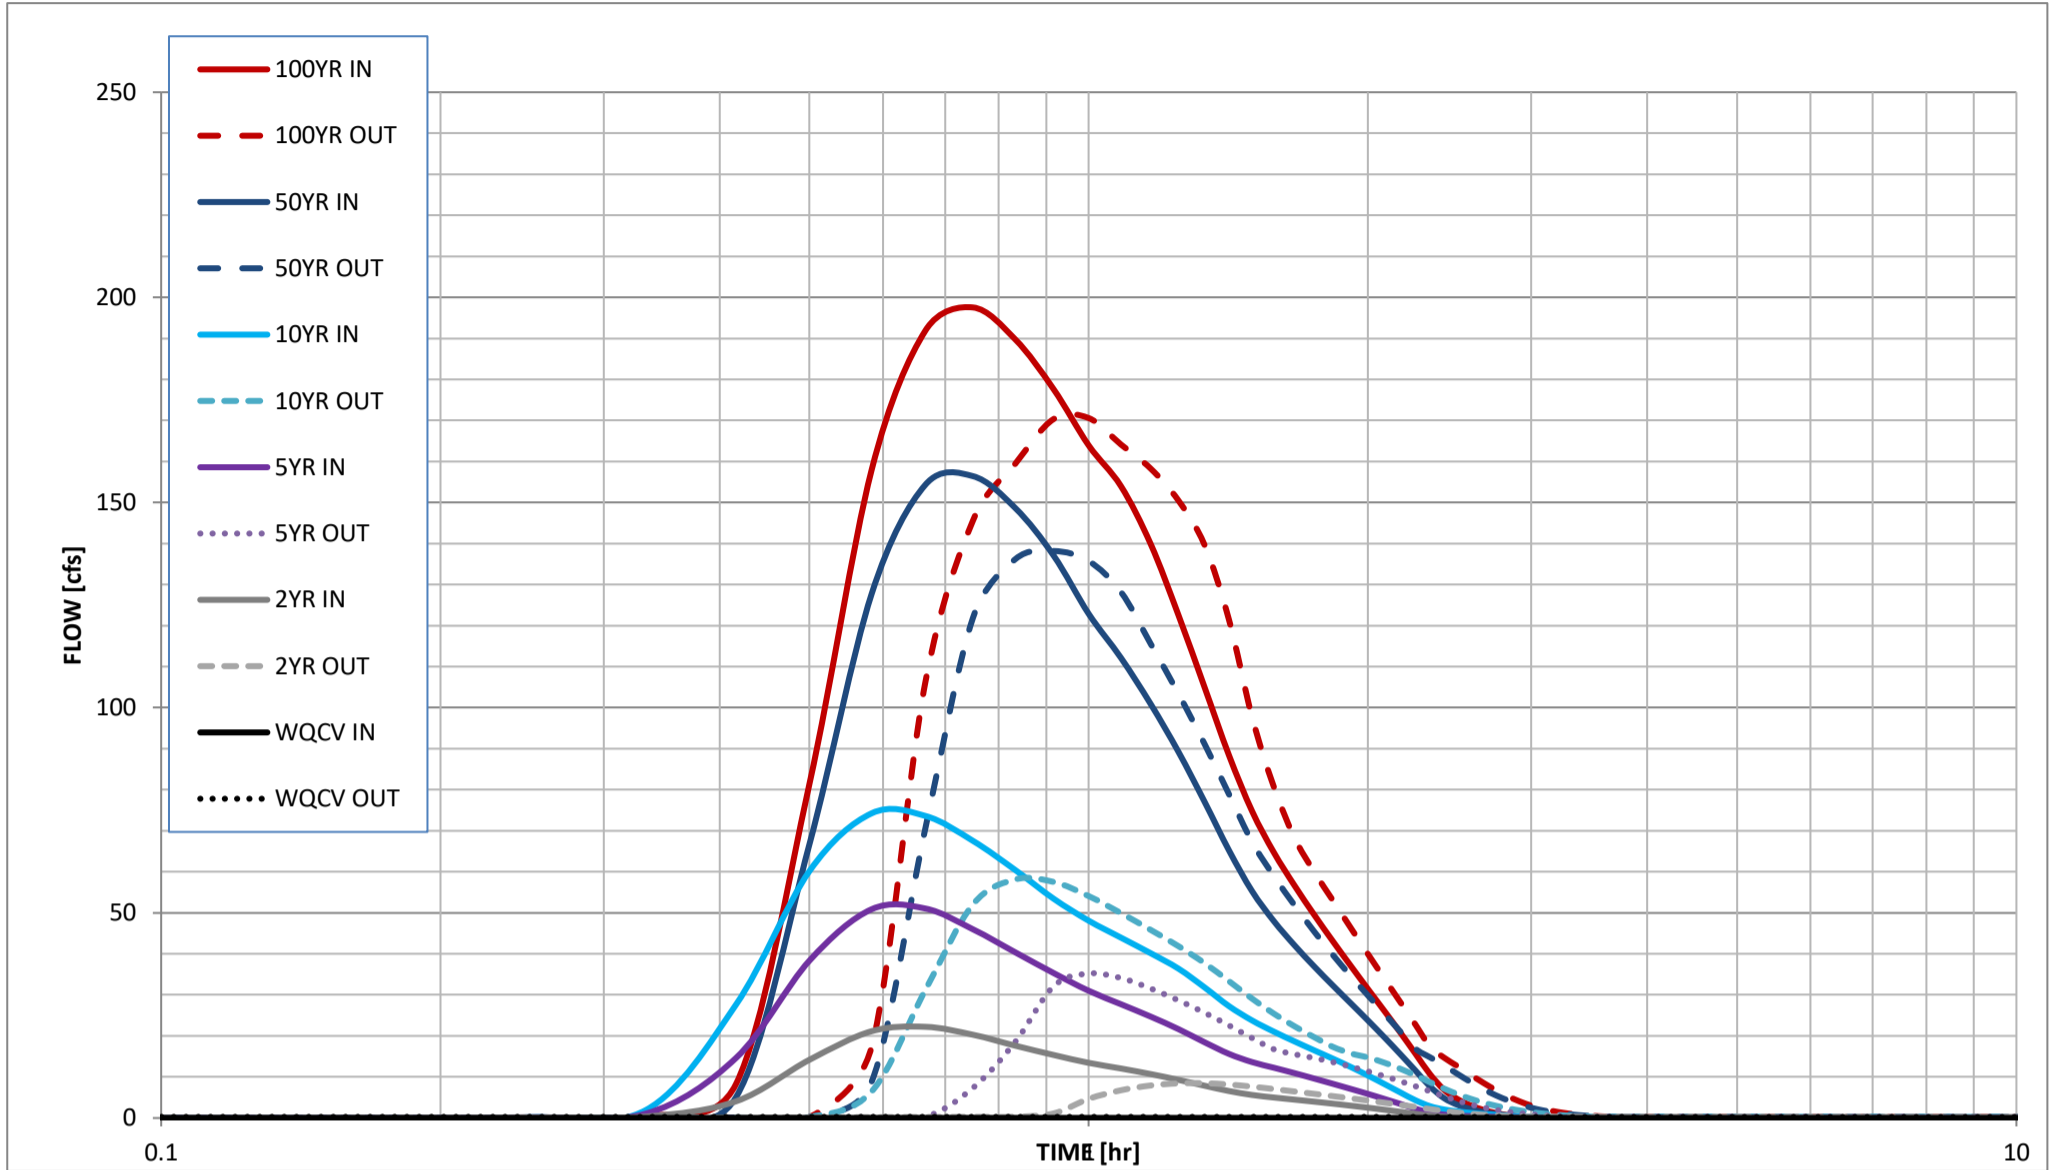

Stormwater Detention and Infiltration Design Data Sheet

SDI-Design Data v2.00, Released January 2020

Stormwater Facility Name: **Detention Pond B**

Facility Location & Jurisdiction: **Flying Horse North Filing No. 4 - El Paso County**

User Input: Watershed Characteristics

Extended Detention Basin (EDB)	
Watershed Area =	EDB 105.65 acres
Watershed Length =	3,000 ft
Watershed Length to Centroid =	1,000 ft
Watershed Slope =	0.035 ft/ft
Watershed Imperviousness =	8.3% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depths (use dropdown):	
User Input	▼

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Once CUHP has been run and the Stage-Area-Discharge information has been provided, click 'Process Data' to interpolate the Stage-Area-Volume-Discharge data and generate summary results in the table below. Once this is complete, click 'Print to PDF'.



User Defined Stage [ft]	User Defined Area [ft^2]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	10	0.00	0.00
0.50	2,138	0.50	0.05
1.00	7,169	1.00	0.11
1.50	13,715	1.50	0.15
2.00	18,729	2.00	0.23
2.50	23,635	2.50	0.29
3.00	27,602	3.00	6.89
3.50	30,042	3.50	59.48
4.00	32,274	4.00	139.49
4.50	34,626	4.50	208.28
5.00	37,052	5.00	216.90
5.50	39,551	5.50	225.20
6.00	42,125	6.00	277.32
6.50	44,776	6.50	370.54
7.00	47,667	7.00	495.34

After completing and printing this worksheet to a pdf, go to: <https://maperture.digitaldataservices.com/gvh/?viewer=cswdif>
 Create a new stormwater facility, and attach the PDF of this worksheet to that record.

Routed Hydrograph Results

Design Storm Return Period =	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
One-Hour Rainfall Depth =	N/A	1.19	1.50	1.75	2.25	2.52	in
CUHP Runoff Volume =	0.500	1.270	2.932	4.609	9.710	12.690	acre-ft
Inflow Hydrograph Volume =	N/A	1.270	2.932	4.609	9.710	12.690	acre-ft
Time to Drain 97% of Inflow Volume =	36.6	41.1	35.6	31.1	19.8	14.8	hours
Time to Drain 99% of Inflow Volume =	39.3	45.5	42.7	40.5	35.0	32.3	hours
Maximum Ponding Depth =	2.28	2.94	3.28	3.49	3.99	4.24	ft
Maximum Ponded Area =	0.49	0.62	0.66	0.69	0.74	0.77	acres
Maximum Volume Stored =	0.500	0.869	1.084	1.230	1.588	1.772	acre-ft

Stormwater Detention and Infiltration Design Data Sheet

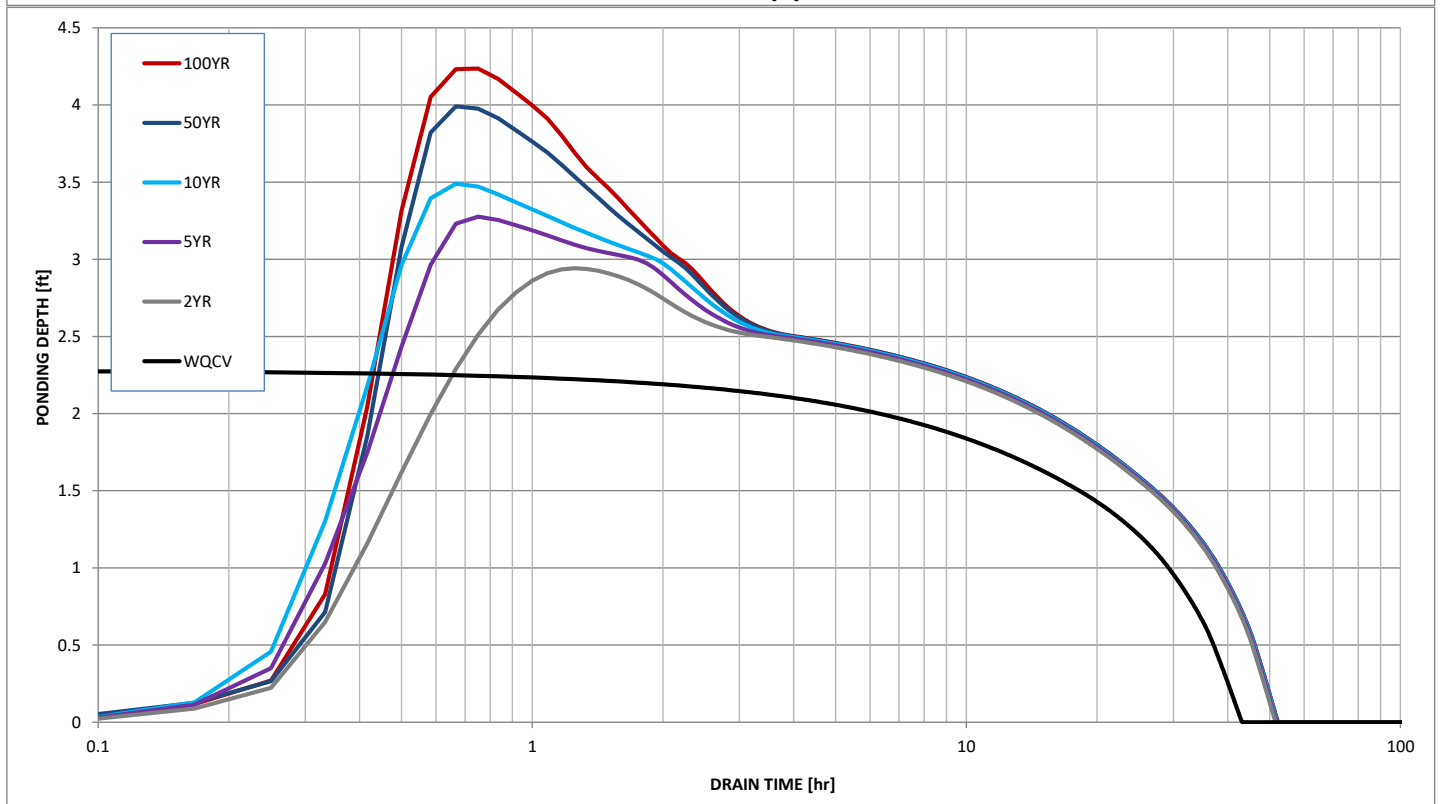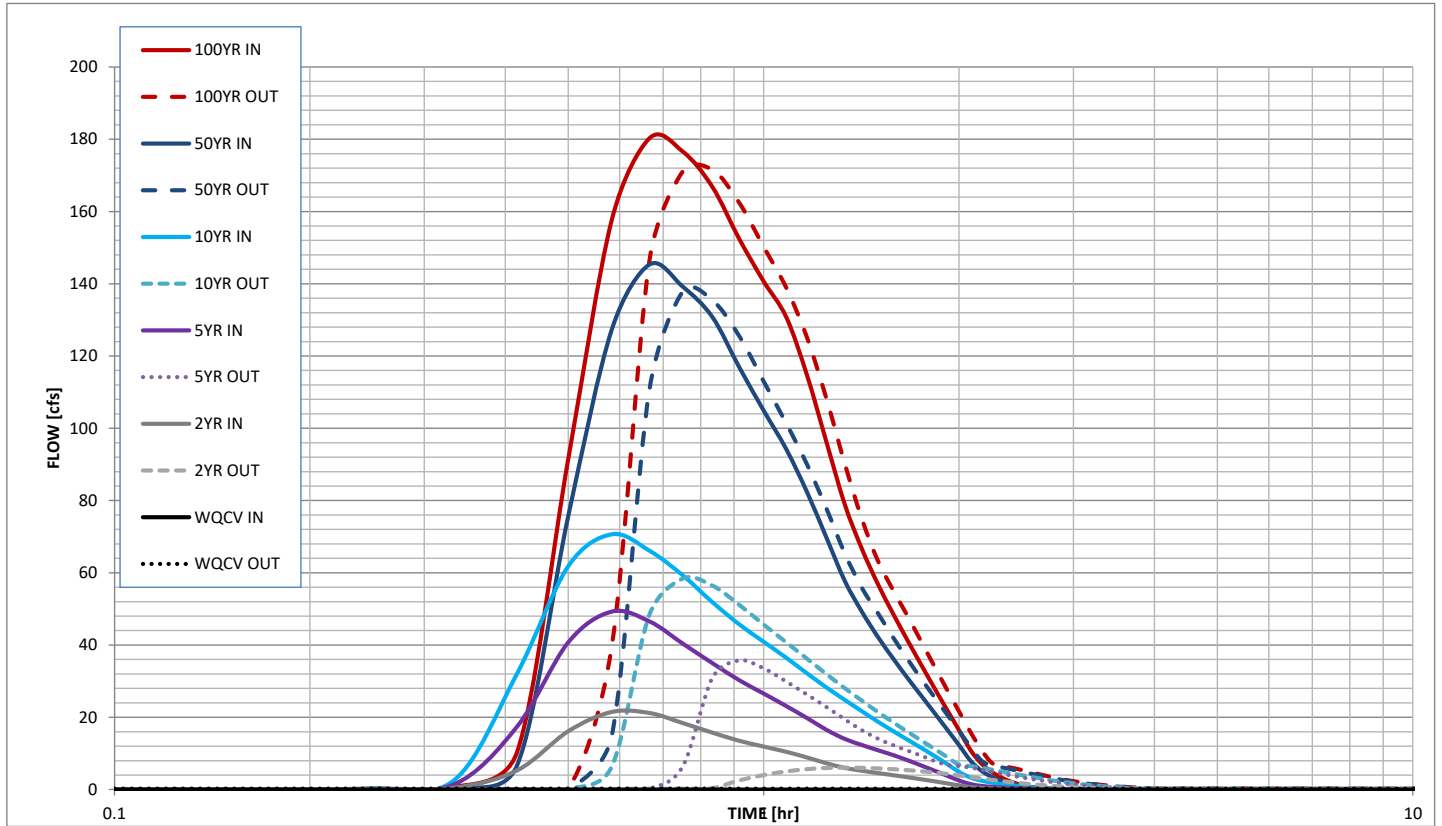

Stormwater Detention and Infiltration Design Data Sheet

SDI-Design Data v2.00, Released January 2020

Stormwater Facility Name: **Detention Pond C**

Facility Location & Jurisdiction: **Flying Horse North Filing No. 4 - El Paso County**

User Input: Watershed Characteristics

Extended Detention Basin (EDB)	EDB
Watershed Area =	39.31 acres
Watershed Length =	1,300 ft
Watershed Length to Centroid =	700 ft
Watershed Slope =	0.055 ft/ft
Watershed Imperviousness =	10.4% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	40.0 hours

Note: L / W Ratio < 1
L / W Ratio = 0.99

Location for 1-hr Rainfall Depths (use dropdown):

User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Once CUHP has been run and the Stage-Area-Discharge information has been provided, click 'Process Data' to interpolate the Stage-Area-Volume-Discharge data and generate summary results in the table below. Once this is complete, click 'Print to PDF'.

User Defined Stage [ft]	User Defined Area [ft^2]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	10	0.00	0.00
0.50	249	0.50	0.02
1.00	1,554	1.00	0.04
1.50	5,593	1.50	0.06
2.00	11,944	2.00	0.09
2.50	19,387	2.50	0.11
3.00	26,211	3.00	9.55
3.50	31,825	3.50	34.13
4.00	35,777	4.00	67.32
4.50	38,050	4.50	96.21
5.00	40,396	5.00	146.69
5.50	42,815	5.50	217.39
6.00	45,306	6.00	308.17
6.50	47,871	6.50	419.52
7.00	50,508	7.00	552.10
7.50	53,221	7.50	706.66

After completing and printing this worksheet to a pdf, go to: <https://maperture.digitaldataservices.com/gvh/?viewer=cswdif>
Create a new stormwater facility, and attach the PDF of this worksheet to that record.

Routed Hydrograph Results

	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
Design Storm Return Period =							
One-Hour Rainfall Depth =	N/A	1.19	1.50	1.75	2.25	2.52	in
CUHP Runoff Volume =	0.227	0.534	1.166	1.796	3.678	4.777	acre-ft
Inflow Hydrograph Volume =	N/A	0.534	1.166	1.796	3.678	4.777	acre-ft
Time to Drain 97% of Inflow Volume =	36.8	48.8	44.4	40.6	31.0	26.3	hours
Time to Drain 99% of Inflow Volume =	38.7	52.3	50.3	48.8	44.3	42.0	hours
Maximum Ponding Depth =	2.24	2.64	3.02	3.20	3.72	3.94	ft
Maximum Poned Area =	0.36	0.49	0.61	0.65	0.77	0.81	acres
Maximum Volume Stored =	0.228	0.395	0.602	0.714	1.090	1.261	acre-ft

Stormwater Detention and Infiltration Design Data Sheet

