


Drainage Report Final_V1 REDLINES.pdf Markup Summary

Daniel Torres (15)




Subject: Callout
Page Label: 2
Author: Daniel Torres
Date: 6/22/2022 7:13:57 AM
Status:
Color: ■
Layer:
Space:

Please revise as there is currently an interim County Engineer, Joshua Palmer, P.E.



Subject: Callout
Page Label: 3
Author: Daniel Torres
Date: 6/22/2022 7:14:37 AM
Status:
Color: ■
Layer:
Space:

Please revise to Joshua Palmer, P.E. Interim County Engineer/ECM Administrator




Subject: Callout
Page Label: 4
Author: Daniel Torres
Date: 6/22/2022 7:19:17 AM
Status:
Color: ■
Layer:
Space:

zone D per the FIRM map. Please revise




Subject: Re: SW - Textbox
Page Label: 5
Author: Daniel Torres
Date: 6/22/2022 7:38:12 AM
Status:
Color: ■
Layer:
Space:

I do not see the calcs. I have provided a comment for them to identify the existing facilities and to provide the calcs.



Subject: Callout
Page Label: 21
Author: Daniel Torres
Date: 6/22/2022 8:00:13 AM
Status:
Color: ■
Layer:
Space:

Please label what is existing and what is proposed. Also provide analysis of the CMP's




Subject: Callout
Page Label: 4
Author: Daniel Torres
Date: 6/22/2022 8:02:07 AM
Status:
Color: ■
Layer:
Space:

Review 3: As indicated on the previous review comment, please revise your FIRM# per your attached FIRM Map (08041C0467G)




Subject: Callout
Page Label: 4
Author: Daniel Torres
Date: 6/22/2022 8:08:15 AM
Status:
Color: ■
Layer:
Space:

Review 3: Please elaborate on your historic conditions description. How many sub-basins are there? are they the same as the proposed? etc. Also provide a historic conditions drainage map.




Subject: Callout
Page Label: 5
Author: Daniel Torres
Date: 6/22/2022 8:10:29 AM
Status:
Color: ■
Layer:
Space:

Please also identify the retaining wall/block walls constructed on the west side and campground area and some of the reasoning behind it (to revert the Lucky Rd runoff back to historic conditions as stated previously?)




Subject: Callout
Page Label: 11
Author: Daniel Torres
Date: 6/22/2022 8:14:02 AM
Status:
Color: ■
Layer:
Space:

please provide calculation as to how the impervious % was determined.



Subject: Callout
Page Label: 13
Author: Daniel Torres
Date: 6/22/2022 8:17:13 AM
Status:
Color: ■
Layer:
Space:

please provide calculation as to how the impervious % was determined.



Subject: Cloud+
Page Label: 21
Author: Daniel Torres
Date: 6/22/2022 8:28:04 AM
Status:
Color: ■
Layer:
Space:

see comments in the narrative of the report regarding with this area and revise accordingly.



Subject: Cloud
Page Label: 21
Author: Daniel Torres
Date: 6/22/2022 8:30:38 AM
Status:
Color: ■
Layer:
Space:




Subject: Callout
Page Label: 21
Author: Daniel Torres
Date: 6/22/2022 8:39:05 AM
Status:
Color: ■
Layer:
Space:

Per these existing contours and flow arrow it appears that the flow will not be directed to the sand filter basin. Please adjust the contours as necessary and/or relocate the basin.



Subject: Callout
Page Label: 5
Author: Daniel Torres
Date: 6/22/2022 8:41:39 AM
Status:
Color: ■
Layer:
Space:


Review 1 comment: Please indicate what the downstream facilities are and provide analysis.
 Review 2: Unresolved. Please address the above comment and identify the suitable outfall (ECM 3.2.4) location. Please be specific.
 Review 3: Unresolved. Please address the above. Provide analysis/calcs. Detention may be needed.



Subject: Callout
Page Label: 21
Author: Daniel Torres
Date: 6/22/2022 8:43:15 AM
Status:
Color: ■
Layer:
Space:


Identify the outfall/spillway of the sand filter basin(SFB). How will be outfall of each of these SFB be conveyed to the downstream facilities? Please discuss in your narrative

Glenn Reese - EPC Stormwater (24)




Subject: SW - Textbox with Arrow
Page Label: 21
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 10:00:00 AM
Status:
Color: ■
Layer:
Space:

Provide LxWxH dimensions of riprap apron.
 Also specify the type of riprap.




Subject: SW - Textbox with Arrow
Page Label: 21
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 10:03:51 AM
Status:
Color: ■
Layer:
Space:

See comments on plans to the left and the identical details on the GEC Plan for what to update on these details.




Subject: SW - Textbox with Arrow
Page Label: 4
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 10:20:55 AM
Status:
Color: ■
Layer:
Space:

Unresolved comment from Review #2: discuss total proposed soil disturbance for this project. That is part of the "description." Until this discussion is added, it is unclear whether or not an ESQCP and SWMP is required.



Subject: SW - Textbox with Arrow
Page Label: 11
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 7:53:18 AM
Status:
Color: ■
Layer:
Space:


Note that a "PLD" is different than a Sand Filter. So revise this to just say "SW corner of Basin C"



Subject: SW - Textbox with Arrow
Page Label: 10
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:05:24 AM
Status:
Color: ■
Layer:
Space:

Provide a figure showing all proposed UIA and RPA areas to be utilized for runoff reduction. Area ID "E" is not labeled/shown on Drainage Map or GEC Plan.

All RPA areas will need to be within a no build/drainage easement and discussed in the maintenance agreement and O&M manual. Also make sure to show RPA limits on GEC Plans (not just FDR) so our SW inspectors and the QSM know that these areas are to remain pervious and vegetated post-construction.




Subject: SW - Textbox with Arrow
Page Label: 11
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:12:30 AM
Status:
Color: ■
Layer:
Space:

Complete this section. From the detail shown on the GEC Plans, an underdrain will be installed, so select "yes" here and then you will need to show the subsequent a orifice plate in the detail.




Subject: SW - Textbox with Arrow
Page Label: 12
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:12:47 AM
Status:
Color: ■
Layer:
Space:

Complete this section.




Subject: SW - Textbox with Arrow
Page Label: 13
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:19:39 AM
Status:
Color: ■
Layer:
Space:

Input these values based on the size of the sand filter shown on the plans.




Subject: SW - Textbox with Arrow
Page Label: 13
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:19:49 AM
Status:
Color: ■
Layer:
Space:

Complete this section. From the detail shown on the GEC Plans, an underdrain will be installed, so select "yes" here and then you will need to show the subsequent a orifice plate in the detail.




Subject: SW - Textbox with Arrow
Page Label: 11
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:19:56 AM
Status:
Color: ■
Layer:
Space:

Input these values based on the size of the sand filter shown on the plans.




Subject: SW - Textbox with Arrow
Page Label: 14
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:20:01 AM
Status:
Color: ■
Layer:
Space:

Complete this section.



Subject: SW - Textbox with Arrow
Page Label: 13
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:26:29 AM
Status:
Color: ■
Layer:
Space:

Note that a "PLD" is different than a Sand Filter. So revise this to just say "Basin B for Basins O-1 thru B," since it's just asking for location



Subject: SW - Highlight
Page Label: 5
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:30:03 AM
Status:
Color: ■
Layer:
Space:

at a point along the entrance road



Subject: SW - Textbox with Arrow
Page Label: 5
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 8:30:30 AM
Status:
Color: ■
Layer:
Space:

At what point? The entrance road is very long. Please be more specific.



Subject: SW - Highlight
Page Label: 5
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 9:34:13 AM
Status:
Color: ■
Layer:
Space:

unless structures are involved

Review 1 comment: Address WQ per discussion in LOI except from VATES shown below from an earlier page for Review 2. Please detail all land disturbance that has occurred onsite since March 10, 2008 and whether or not each of those disturbances has been finally stabilized. If total soil disturbance has been >1 ac, you will need to address WQ.

Review 2: Unresolved.
Review 3: Unresolved.

Subject: Contractor
Page Label: 5
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 9:41:47 AM
Status:
Color: ■
Layer:
Space:

Review 1 comment: Address WQ per discussion in LOI excerpt from VA185 shown below (now on next page for Review 3). Please detail all land disturbance that has occurred onsite since March 10, 2008 and whether or not each of those disturbances has been finally stabilized. If total soil disturbance has been >1ac, you will need to address WQ.

Review 2: Unresolved.
Review 3: Unresolved.



Subject: SW - Textbox with Arrow
Page Label: 21
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 9:59:35 AM
Status:
Color: ■
Layer:
Space:


Provide sections/alignments of pipes to show depth, length, finished grade, etc.



Subject: SW - Textbox with Arrow
Page Label: 21
Author: Glenn Reese - EPC Stormwater
Date: 6/21/2022 9:59:58 AM
Status:
Color: ■
Layer:
Space:

Provide LxWxH dimensions of riprap apron.

Also specify the type of riprap.



Subject: SW - Textbox with Arrow
Page Label: 5
Author: Glenn Reese - EPC Stormwater
Date: 6/22/2022 9:49:41 AM
Status:
Color: ■
Layer:
Space:

So if there is a suitable outfall such that detention is not required, describe that the Sand Filter is only designed for WQCV. But if Detention is required (once PCD comments above have been addressed), you will need to increase the size of the Sand Filter and provide both the UD-Detention worksheet and SDI Form.

Preliminary and Final DRAINAGE PLAN AND REPORT

ROCKY TOP MOTEL AND CAMPGROUND

10090 W Highway 24

A portion of the NW $\frac{1}{4}$, Section 9, Township 13 South, Range 68 West
EL PASO COUNTY

June 14, 2019

Updated
August 16, 2021

Revised
January 4, 2022

Revised
April 13, 2022

Prepared for

G & D Enterprises
10090 West Highway 24
Green Mountain Falls, CO 80819

County File No.: PPR2140

Oliver E. Watts, Consulting Engineer, Inc.
Colorado Springs, Colorado

OLIVER E. WATTS, PE-LS
OLIVER E. WATTS, CONSULTING ENGINEER, INC.
CIVIL ENGINEERING AND SURVEYING
614 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907
(719) 593-0173
fax (719) 265-9660
olliewatts@aol.com
Celebrating over 43 years in business

April 13, 2022

El Paso County Planning and Community Development
2880 International Circle
Colorado Springs, CO 80910

Please revise as
there is currently an
Interim County
Engineer, Joshua
Palmer, P.E.

ATTN: *Jennifer Irvine, P.E.*

SUBJECT: Drainage Plan and Report
Rocky Top Motel and Campground

Transmitted herewith for your review and approval is the drainage plan and report for The Rocky Top Motel and Campground in El Paso County. This report is prepared and a result of Craig Dossey's letter of May 2, 2019 regarding an alleged violation of County grading regulations. It has been revised per the 10-7-21 County Review and our subsequent meetings. This report will accompany the submittal of other land use applications. Please contact me if I may provide any further information.

Oliver E. Watts, Consulting Engineer, Inc.

BY: _____
Oliver E. Watts, President

Encl:

Drainage Report 6 pages
Runoff Computations, 3 pages
UD Computations, 5 pages
FEMA Panel No. 08041C0952 G
SCS Soils Map
Backup Information, 4 sheets
Drainage Plan, Dwg 19-5341-02

1. ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Oliver E. Watts, Consulting Engineer, Inc.

Oliver E. Watts Colo. PE-LS No. 9853

2. OWNERS / DEVELOPER'S STATEMENT:

I the owner / developer have read and will comply with all of the requirements specified in this drainage report and plan.

G & D Enterprises, Corp.

By: _____
Daniel P. Nieman, owner
10090 West Highway 24
Green Mountain Falls, CO 80819
684-9044

3. EL PASO COUNTY:

Filed in accordance with the requirements of the El Paso Land Development Code, Drainage Criteria Manual Volumes 1 and 2, and the Engineering Criteria Manual, as amended.

Jennifer Irvine, P.E., _____
County Engineer / ECM Administrator date

Conditions:

Please revise to Joshua Palmer, P.E.
Interim County Engineer/ECM
Administrator

Unresolved comment from Review #2: discuss total proposed soil disturbance for this project. That is part of the "description." Until this discussion is added, it is unclear whether or not an ESQCP and SWMP is required.

4. LOCATION AND DESCRIPTION:

The Rocky Top Motel and Campground is located in a portion of the NW ¼, Section 9, Township 13 South, Range 68 West, of the 6th P.M., in El Paso County. The address, located at 10090 West Highway 24, is adjacent to Green Mountain Falls, on the north side of Highway 24 as shown in detail on the enclosed drainage plan. This facility has been in use at this location since 1947 as a motel and since 1950 as a camp ground. A use application for RV storage has been recently submitted to the County for this additional use. A detailed site survey is submitted as part of the enclosed drainage plan to delineate current conditions.

Review 3: As indicated on the previous review comment, please revise your FIRM# per your attached FIRM Map (08041C0467G)

The County issued a notice of violation dated May 2, 2019, in reply to neighbors itemizing items that needed to be completed to reply to violations of grading in and the un-permitted use as RV storage. The County is considering road construction several years to be included in the disturbed area.

The grading reported by the neighbors mostly involved repair and maintenance. The owner has had to contend with erosion from stormwater runoff. This had lead to grading of, to repair said erosion, especially along Lucky 4 Road to the west of the site. This is a private road that is not maintained by the County.

5. FLOOD PLAIN STATEMENT:

This subdivision is not within the limits of a flood plain or flood hazard area, according to FEMA map panel number 08041C0952 G, dated December 7, 2018, a copy of which is enclosed for reference. Note that the site is in Zone X on said Firmette

zone D per the FIRM map. Please revise

6. METHOD AND CRITERIA:

The method used for all computations is that specified in the City-County Drainage Criteria Manual, using the rational method for areas of the size of the development. All computations are enclosed for reference and review.

The soils in the subdivision have been mapped by the local USDA/SCS office, and a soils map and is enclosed for reference, indication that all soils in this area are of hydrologic group "A". The soils in this area are largely usable as gravel surfacing and are

Review 3: Please elaborate on your historic conditions description. How many sub-basins are there? are they the same as the proposed? etc. Also provide a historic conditions drainage map.

7. DESCRIPTION OF RUNOFF:

A. Historic Drainage:

Computations are enclosed to show the historic drainage conditions prior to construction of any existing facilities (pre-1947). The drainage pattern has remained unchanged, and is increased due to development over the years.

B. Drainage Inflows:

As shown on the enclosed drainage plan one small area (Basin O-1) will drain into the property near the northwest corner, creating 0.15 cfs / 1.1 cfs (5-year / 100-year runoffs) from a small vacant grassed site. This runoff is in the undeveloped historic state.

This statement is still unclear. Suggested revision: "except in areas where structures or paving/gravel will be added."

C. On Site Runoff:

On site runoff has existed in the current state for many years. Improvements and improvements, including paving, to the road system. Other improvements include regrading the area for use as campground and tented areas and increases in runoff are minimal unless structures are involved. The type "A" soils of the site exhibit minimal runoff, which is not significantly increased with gravel or similar surfacing used for dust control

At what point? The entrance road is very long. Please be more specific.

The above mentioned inflow will combine with runoff from Basin A for a total of 4.0 cfs/ at a point along the entrance road. The historic runoff for this area is 0.85 cfs \ 6.2 cfs. This is a mixture of part of the paved road and graveled campground sites graded into the natural and areas of native vegetation covering steeper boundary areas. This will combine with runoff from Basin B, consisting of the motel site, paved roads and parking. The 0.44 acre RV parking area has been abandoned and reclaimed. The total runoff at the outfall point into Highway 24 is 5.6 cfs / 17.2 cfs, compared with the historic value of 1.49 cfs / 11.1 cfs. This runoff is well within the capacity of existing downstream drainage facilities, as shown by the enclosed computation. Runoff reduction is employed along this drainage path and a sand filter basin is provided at the subdivision boundary.

So if there is a suitable outfall such that detention is not required, describe what the Sand Filter is being designed for. WQCV only, right?

Basin C is the Southwesterly third of the site, containing graveled campground sites, tent sites, and a gravel road. The 0.38 acre RV storage site has been abandoned and reclaimed. The total runoff at the historic outfall point into Highway 24 is 3.2 cfs / 9.1 cfs, compared with the historic value of 0.748 cfs / 5.7 cfs. A few culverts exist within the site and below the outfall point, all of which have the computed capacity to safely accommodate this total runoff. Highway 24 culverts have proved historically adequate and will remain so as far as this development is concerned. A sand filter basin is provided at the subdivision boundary.

So if there is a suitable outfall such that detention is not required, describe that the Sand Filter is only designed for WQCV. But if Detention is required (once PCD comments above have been addressed), you will need to increase the size of the Sand Filter and provide both the UD-Detention worksheet and SDI Form.

8. WATER QUALITY REQUIREMENTS:

The total historic and proposed development work on the site is largely mitigated by the existing Type A soils of the area. A runoff reduction work sheet is enclosed analyzing the proposed efforts to minimize these effects. Two proposed sand filter basins are proposed at the outfall points of the development for this purpose. The proposed grading is represented on the enclosed drainage plan and the grading plan that accompanies the total submittal. The work is minimal and necessary erosion BMP's are proposed.

Review 1 comment: Please indicate what the downstream facilities are and provide analysis.
Review 2: Unresolved. Please address the above comment and identify the suitable outfall (ECM 3.2.4) location. Please be specific.
Review 3: Unresolved. Please address the above. Provide analysis/calcs. Detention may be needed.

Please also identify the retaining wall/block walls constructed on the west side and campground area and some of the reasoning behind it (to revert the Lucky Rd runoff back to historic conditions as stated previously?)



Review 1 comment: Address WQ per discussion in LOI excerpt from VA185 shown below (now on next page for Review 3). Please detail all land disturbance that has occurred onsite since March 10, 2008 and whether or not each of those disturbances has been finally stabilized. If total soil disturbance has been >1ac, you will need to address WQ.

Review 2: Unresolved.
Review 3: Unresolved.

Unresolved comment from Review #2:
A water quality PBMP is required for sites with total cumulative soil disturbance >1ac since March 10, 2008 (which is when the MS4 Permit was issued to EPC that first discussed this PBMP requirement).

Between 2018 and 2020 the E/W driveway was paved
Between 2014 and 2016 the N/S driveway was paved

The total of just that pavement area is ~0.5ac. So that area plus the proposed soil disturbance of 0.695ac pushes the site >1ac since 2008 (less any PBMP exclusions). Please discuss all post-2008 disturbances in this section and provide a water quality PBMP (unless exclusions apply).

For this submittal, all mention or discussion of total disturbed acreage was removed. That is important information that must be included.

The defined tent sites and retaining walls are recent areas of land disturbance that exceed one acre in total area. All land disturbances that have occurred on the property since February 2008 are part of a Large Common Plan of Development and are considered for Water Quality Capture Volume. The drainage report submitted with the subsequent site development plan will address the historic/undeveloped condition of the property. All required engineering documents will be submitted with the site development plan.

9. COST ESTIMATE:

All facilities are private.

V. Waiver Requests.

Item No.	Description	Quantity	Unit Cost	Cost
1	West Sand Filter Basin	1 ea	LS	\$ 1600.00
2	East Sand Filter Basin	1 ea	LS	2500.00
3	24" CMP Storm Sewer	80 LF	30.00	2400.00
Subtotal Construction Cost				\$ 6500.00
Engineering		10%		650.00
Total Estimated Cost				\$ 7150.00

10. SUMMARY

The motel and campground have existed at this address since 1947 and 1950 respectively. The proposed facilities will mitigate the effects of historic development as well as proposed improvements. There will be no adverse effects on downstream or surrounding properties.

The drainage analysis has been prepared in accordance with the current El Paso County Drainage Criteria Manual. Supporting information and calculations are included in this report.

MAJOR BASIN	SUB BASIN	AREA		BASIN		T _c MIN	I		SOIL GRP	DEV. TYPE	C		FLOW		RETURN PERIOD	
		PLANIM READ	ACRES	LENGTH	HEIGHT								qp	qp		
FOUNTAIN CR	O-1	COGO	0.66	100	4	20			A	MDW	0.08	0.35			5	100
				+200	6	+1										
						21	2.9	4.8					0.15	1.1	5	100
	+A	COGO	3.12	+420	34	+1.2			A	MDW	0.08	0.35	15%			
				V=5.7						GRAVEL	0.50	0.70	85%			
										MIX	0.437	0.648				
	TOTAL	COGO	3.78			22.2	2.8	4.7	A	MIX	0.375	0.596	4.0	10.6	5	100
	+B	COGO	3.13	+360	34	+1.0			A	ROOF	0.73	0.81	2%			
				V=6.1						GRAVEL	0.50	0.70	20%			
										MDW	0.08	0.35	70%			
										MIX	0.215	0.478				
	TOTAL	COGO	6.91			23.2	2.7	4.6	A	MIX	0.302	0.542	5.6	17.2	5	100
	C	COGO	2.97	100	2	14.7			A	GRAVEL	0.50	0.70	60%			
			V=5.4	+640	46	+2.0				MDW	0.08	0.35	40%			
						16.7	3.3	5.5	A	MIX	0.332	0.560	3.2	9.1	5	100

HYDROLOGICAL COMPUTATION – BASIC DATA
 PROJ: ROCKY TOP MOTEL & CAMPGROUND BY: O.E. WATTS
 RATIONAL METHOD DATE: 6-14-19, 8-16-21

OLIVER E. WATTS, CONSULTING ENGINEER, INC.
 614 ELKTON DRIVE COLORADO SPRINGS, CO 80907

PAGE 1
 OF
 3

MAJOR BASIN	SUB BASIN	AREA		BASIN		T _c MIN	I in./hr.		SOIL GRP	DEV. TYPE	C		FLOW		RETURN PERIOD -years-	
		PLANIM READ	ACRES	LENGTH -FT.-	HEIGHT -FT.-								5-ry qp -CFS-	100-yr qp -CFS-		
HISTORIC	O-1	COGO	0.66	100	4	20			A	MDW	0.08	0.35			5	100
				+200	6	+1										
						21	2.9	4.8					0.15	1.1	5	100
	+A	COGO	3.13	+420	34	+1.2										
	TOTAL		3.748			22.2	2.8	4.7	A	MDW	0.08	0.35	0.85	6.2	5	100
	+B	COGO	3.13	+360	34	+1.0										
	TOTAL		6.91			23.2	2.7	4.6	A	MDW	0.08	0.35	1.49	11.1	5	100
	C	COGO	2.97	100	2	14.7										
				+640	46	+2.0										
						16.7	3.3	5.5	A	MDW	0.08	0.35	0.78	5.7	5	100
HYDROLOGICAL COMPUTATION – BASIC DATA PROJ: ROCKY TOP MOTEL & CAMPGROUND BY: O.E. WATTS RATIONAL METHOD DATE: April 14, 2022							OLIVER E. WATTS, CONSULTING ENGINEER, INC. 614 ELKTON DRIVE COLORADO SPRINGS, CO 80907							PAGE 2 OF 3		

STREET AND STORM SEWER CALCULATIONS

STREET	LOCATION	DISTANCE	ELEVATION & SLOPE	TOTAL RUNOFF	STREET FLOW / CAPACITY	PIPE FLOW	TYPE PIPE, CATCH BASIN & SLOPE %
PRIVATE	B OUTFALL			5.6/172		17.2	24" CMP hi=0.62' S=0.60% MIN
	C OUTFALL			3.7/9.1		9.1	24" CMP hi=0.24' S=0.20% MIN.

STREET AND STORM SEWER CALCULATIONS
PROJECT: ROCKY TOP MOTEL & CAMPGROUND
BY: O.E. WATTS **DATE: 6-14-19, 8-16-21**

OLIVER E. WATTS, CONSULTING ENGINEER, INC.
 614 ELKTON DRIVE COLORADO SPRINGS, CO 80907

Page:3
 Of
 Pages:3

Provide a figure showing all proposed UIA and RPA areas to be utilized for runoff reduction. Area ID "E" is not labeled/shown on Drainage Map or GEC Plan.
 All RPA areas will need to be within a no build/drainage easement and discussed in the maintenance agreement and O&M manual. Also make sure to show RPA limits on GEC Plans (not just FDR) so our SW inspectors and the QSM know that these areas are to remain pervious and vegetated post-construction.

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: O.E. Wats
 Company: Oliver E. Watts, CE
 Date: April 14, 2022
 Project: Rockytop Motel and Campround
 Location: E Paso County

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth = 0.60 inches
 Depth of Average Runoff Producing Storm, d_6 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	UIA/RPA																			
Area ID	E																			
Downstream Design Point ID	E																			
Downstream BMP Type	None																			
DCIA (ft ²)	--																			
UIA (ft ²)	7,096																			
RPA (ft ²)	8,022																			
SPA (ft ²)	--																			
HSG A (%)	100%																			
HSG B (%)	0%																			
HSG C/D (%)	0%																			
Average Slope of RPA (ft/ft)	0.100																			
UIA:RPA Interface Width (ft)	16.00																			

CALCULATED RUNOFF RESULTS

Area ID	E																			
UIA:RPA Area (ft ²)	15,118																			
L / W Ratio	16.00																			
UIA / Area	0.4694																			
Runoff (in)	0.00																			
Runoff (ft ³)	0																			
Runoff Reduction (ft ³)	296																			

CALCULATED WQCV RESULTS

Area ID	E																			
WQCV (ft ³)	296																			
WQCV Reduction (ft ³)	296																			
WQCV Reduction (%)	100%																			
Untreated WQCV (ft ³)	0																			

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	E																			
DCIA (ft ²)	0																			
UIA (ft ²)	7,096																			
RPA (ft ²)	8,022																			
SPA (ft ²)	0																			
Total Area (ft ²)	15,118																			
Total Impervious Area (ft ²)	7,096																			
WQCV (ft ³)	296																			
WQCV Reduction (ft ³)	296																			
WQCV Reduction (%)	100%																			
Untreated WQCV (ft ³)	0																			

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	15,118
Total Impervious Area (ft ²)	7,096
WQCV (ft ³)	296
WQCV Reduction (ft ³)	296
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

Note that a "PLD" is different than a Sand Filter. So revise this to just say "SW corner of Basin C"

Design Procedure Form: Sand Filter (SF)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 2

Designer: O.E. WATTS
Company: Oliver E. Watts, CE
Date: April 14, 2022
Project: Rocky Top Motel and Campground
Location: Basin C PLD Pond

please provide calculation as to how the impervious % was determined.

1. Basin Storage Volume
- A) Effective Imperviousness of Tributary Area, I_a
(100% if all paved and roofed areas upstream of sand filter)
 - B) Tributary Area's Imperviousness Ratio ($i = I_a/100$)
 - C) Water Quality Capture Volume (WQCV) Based on 12-hour Drain Time
 $WQCV = 0.8 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)$
 - D) Contributing Watershed Area (including sand filter area)
 - E) Water Quality Capture Volume (WQCV) Design Volume
 $V_{WQCV} = WQCV / 12 * Area$
 - F) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm
 - G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume
 - H) User Input of Water Quality Capture Volume (WQCV) Design Volume
(Only if a different WQCV Design Volume is desired)

$I_a =$ %
 $i =$
 WQCV = watershed inches
 Area = sq ft
 $V_{WQCV} =$ cu ft
 $d_b =$ in
 $V_{WQCV \text{ OTHER}} =$ cu ft
 $V_{WQCV \text{ USER}} =$ cu ft

2. Basin Geometry
- A) WQCV Depth
 - B) Sand Filter Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred). Use "0" if sand filter has vertical walls.
 - C) Minimum Filter Area (Flat Surface Area)
 - D) Actual Filter Area
 - E) Volume Provided

$D_{WQCV} =$ ft
 $Z =$ ft / ft
 $A_{Min} =$ sq ft
 $A_{Actual} =$ sq ft
 $V_T =$ cu ft

Input these values based on the size of the sand filter shown on the plans.

3. Filter Material

Choose One
 18" CDOT Class B or C Filter Material
 Other (Explain):
 TYPE A SOIL

4. Underdrain System
- A) Are underdrains provided?
 - B) Underdrain system orifice diameter for 12 hour drain time
 - i) Distance From Lowest Elevation of the Storage Volume to the Center of the Orifice
 - ii) Volume to Drain in 12 Hours
 - iii) Orifice Diameter, 3/8" Minimum

Choose One
 YES
 NO
 $y =$ ft
 $Vol_{12} =$ cu ft
 $D_o =$ in

Complete this section. From the detail shown on the GEC Plans, an underdrain will be installed, so select "yes" here and then you will need to show the subsequent a orifice plate in the detail.

Design Procedure Form: Sand Filter (SF)

Sheet 2 of 2

Designer: O.E. WATTS
Company: Oliver E. Watts, CE
Date: April 14, 2022
Project: Rocky Top Motel and Campground
Location: Basin C PLD Pond

5. Impermeable Geomembrane Liner and Geotextile Separator Fabric

A) Is an impermeable liner provided due to proximity of structures or groundwater contamination?

Choose One

YES NO

Complete this section.

6. Inlet / Outlet Works

A) Describe the type of energy dissipation at inlet points and means of conveying flows in excess of the WQCV through the outlet

Notes: _____

Note that a "PLD" is different than a Sand Filter. So revise this to just say "Basin B for Basins O-1 thru B," since it's just asking for location

Design Procedure Form: Sand Filter (SF)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 2

Designer: O.E. WATTS
 Company: Oliver E. Watts, CE
 Date: April 14, 2022
 Project: Rocky Top Motel and Campground
 Location: BASINS O-1 THRU B PLD POND

please provide calculation as to how the impervious % was determined.

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, I_a (100% if all paved and roofed areas upstream of sand filter)</p> <p>B) Tributary Area's Imperviousness Ratio ($i = I_a/100$)</p> <p>C) Water Quality Capture Volume (WQCV) Based on 12-hour Drain Time $WQCV = 0.8 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)$</p> <p>D) Contributing Watershed Area (including sand filter area)</p> <p>E) Water Quality Capture Volume (WQCV) Design Volume $V_{WQCV} = WQCV / 12 * Area$</p> <p>F) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p>	<p>$I_a =$ <input type="text" value="43.0"/> %</p> <p>$i =$ <input type="text" value="0.430"/></p> <p>WQCV = <input type="text" value="0.15"/> watershed inches</p> <p>Area = <input type="text" value="136,300"/> sq ft</p> <p>$V_{WQCV} =$ <input type="text" value=""/></p> <p>$d_b =$ <input type="text" value="2.52"/> in</p> <p>$V_{WQCV \text{ OTHER}} =$ <input type="text" value="9,997"/> cu ft</p> <p>$V_{WQCV \text{ USER}} =$ <input type="text" value=""/> cu ft</p>
<p>2. Basin Geometry</p> <p>A) WQCV Depth</p> <p>B) Sand Filter Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred). Use "0" if sand filter has vertical walls.</p> <p>C) Minimum Filter Area (Flat Surface Area)</p> <p>D) Actual Filter Area</p> <p>E) Volume Provided</p>	<p>$D_{WQCV} =$ <input type="text" value="2.0"/> ft</p> <p>$Z =$ <input type="text" value="4.00"/> ft / ft</p> <p>$A_{Min} =$ <input type="text" value="733"/> sq ft</p> <p>$A_{Actual} =$ <input type="text" value=""/> sq ft</p> <p>$V_T =$ <input type="text" value=""/> cu ft</p>
<p>3. Filter Material</p>	<p>Choose One <input type="text"/></p> <p><input type="radio"/> 18" CDOT Class B or C Filter Material</p> <p><input checked="" type="radio"/> Other (Explain): <input type="text" value="TYPE A SOIL"/></p>
<p>4. Underdrain System</p> <p>A) Are underdrains provided?</p> <p>B) Underdrain system orifice diameter for 12 hour drain time</p> <p>i) Distance From Lowest Elevation of the Storage Volume to the Center of the Orifice</p> <p>ii) Volume to Drain in 12 Hours</p> <p>iii) Orifice Diameter, 3/8" Minimum</p>	<p>Choose One <input type="text"/></p> <p><input type="radio"/> YES</p> <p><input type="radio"/> NO</p> <p>$y =$ <input type="text" value=""/> ft</p> <p>$Vol_{12} =$ <input type="text" value=""/> cu ft</p> <p>$D_o =$ <input type="text" value=""/> in</p>

Input these values based on the size of the sand filter shown on the plans.

Complete this section. From the detail shown on the GEC Plans, an underdrain will be installed, so select "yes" here and then you will need to show the subsequent a orifice plate in the detail.

Design Procedure Form: Sand Filter (SF)

Sheet 2 of 2

Designer: O.E. WATTS
Company: Oliver E. Watts, CE
Date: April 14, 2022
Project: Rocky Top Motel and Campground
Location: BASINS O-1 THRU B PLD POND

5. Impermeable Geomembrane Liner and Geotextile Separator Fabric

A) Is an impermeable liner provided due to proximity of structures or groundwater contamination?

Choose One

YES NO

Complete this section.

6. Inlet / Outlet Works

A) Describe the type of energy dissipation at inlet points and means of conveying flows in excess of the WQCV through the outlet

Notes: _____

National Flood Hazard Layer FIRMette



38°56'20.49"N



Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway

OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Area of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone J
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D

OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone
		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall

OTHER FEATURES		20.2 17.5 Cross Sections with 1% Annual Chance Water Surface Elevation
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature


MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped
		The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 6/14/2019 at 10:34:12 AM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.



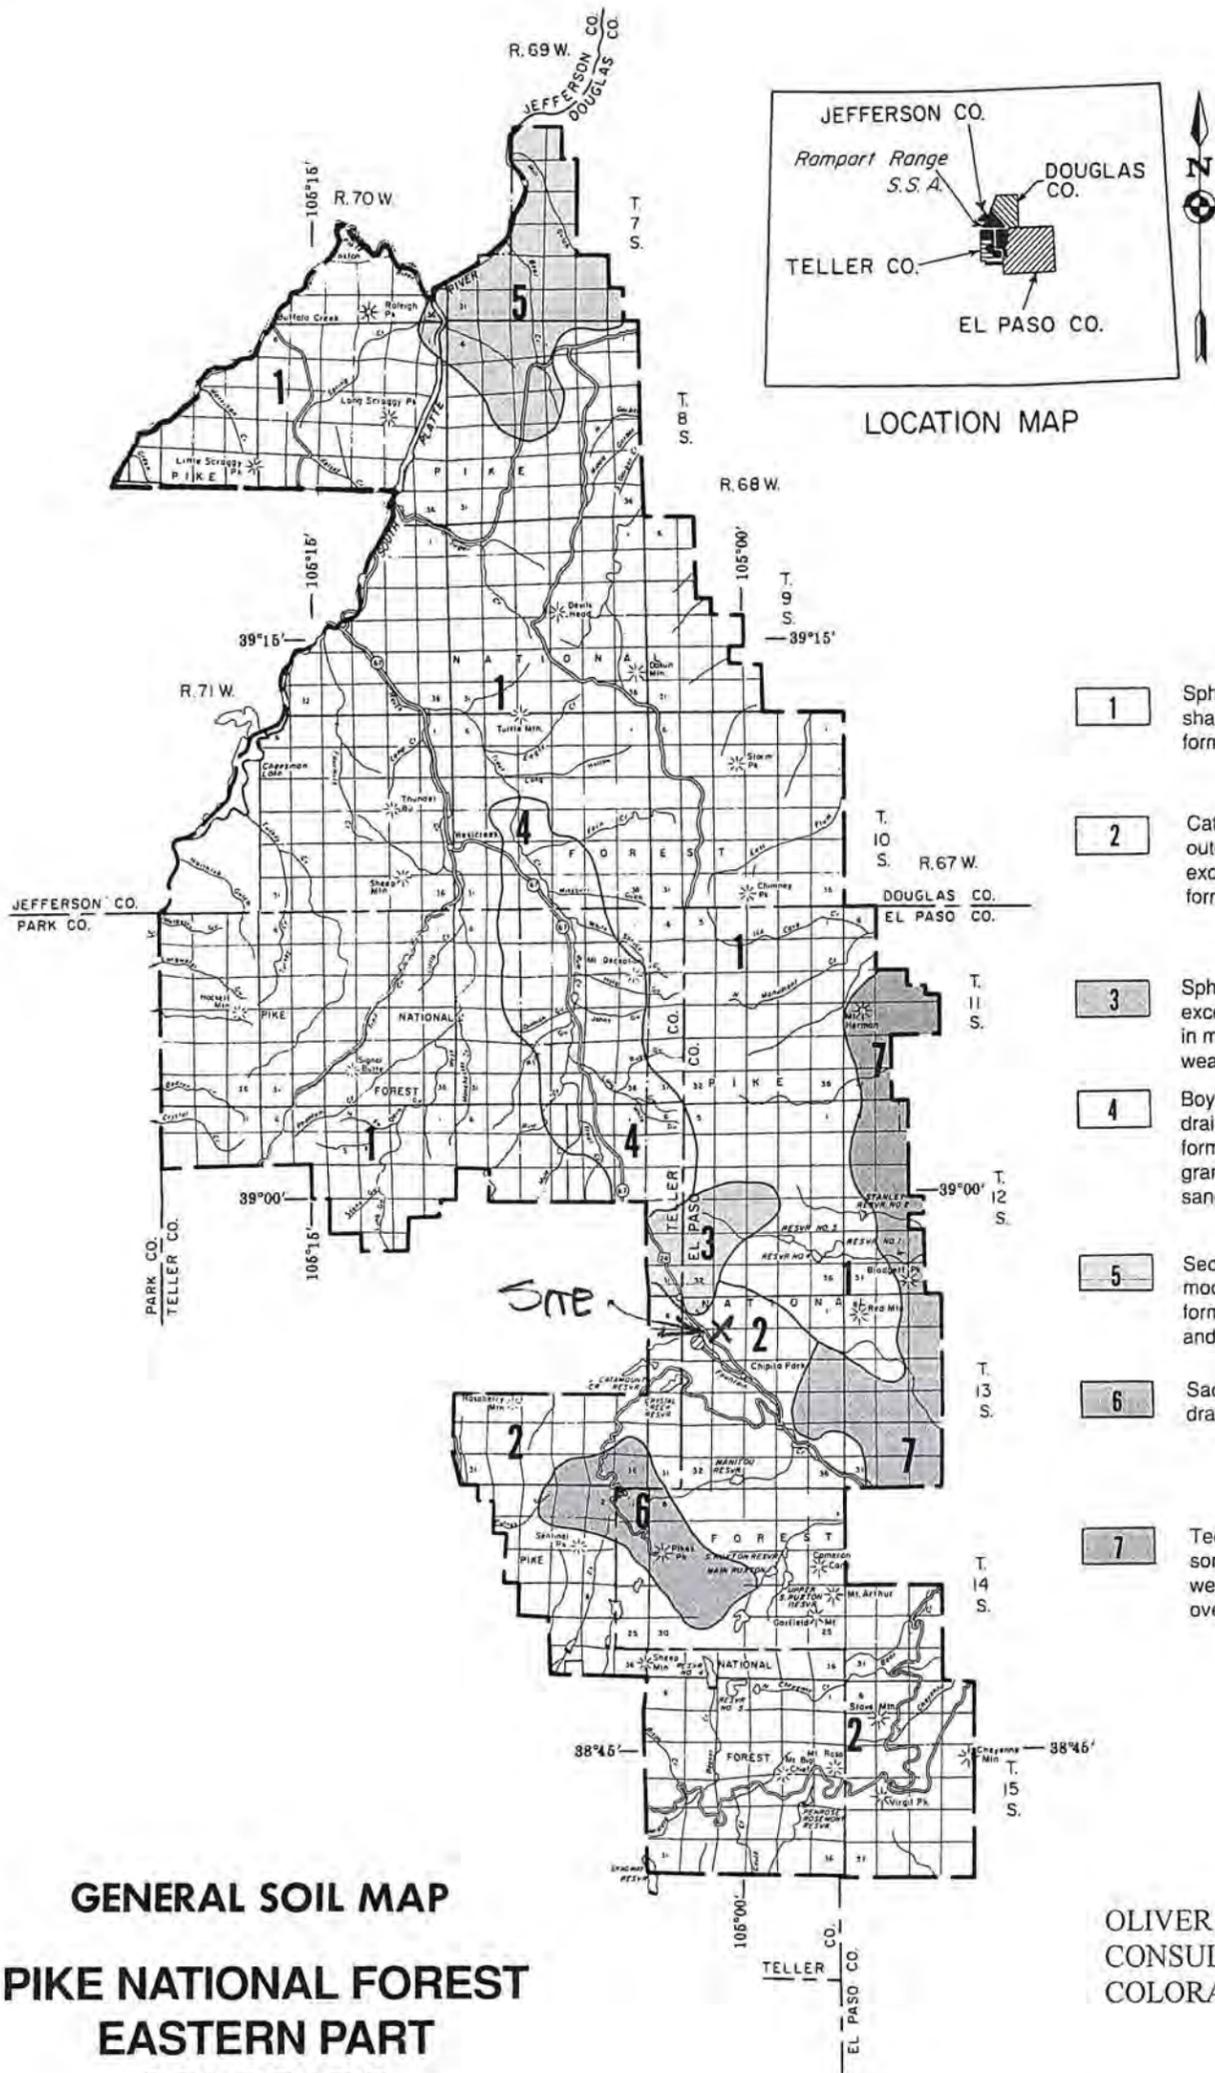

SOIL LEGEND

- 1** Sphinx-Legault-Rock outcrop: Rock outcrop and shallow, somewhat excessively drained soils that formed in material weathered from granite
- 2** Catamount-Ivywild-Legault-Rock outcrop: Rock outcrop and shallow and moderately deep, somewhat excessively drained, and excessively drained soils that formed in material weathered from granite
- 3** Sphinx-Tecolote-Condrie: Shallow and deep, somewhat excessively drained and well drained soils that formed in material weathered from granite or in colluvium over weathered granite
- 4** Boyett-Frenchcreek-Pendant: Deep and shallow, well drained and somewhat excessively drained soils that formed in material weathered from limestone and granite, and in alluvium derived from mixed red arkosic sandstone
- 5** Security-Cathedral-Rock outcrop: Rock outcrop and moderately deep and shallow, well drained soils that formed in material weathered from mixed schist, gneiss, and granite
- 6** Sachett-Cirque land: Cirque land and shallow, excessively drained soils that formed in material weathered from granite
- 7** Tecolote-Pendant: Deep and shallow, well drained and somewhat excessively drained soils that formed in material weathered from limestone and in cobbly or stony colluvium over weathered granite

Compiled 1986

OLIVER E. WATTS
CONSULTING ENGINEER, INC.
COLORADO SPRINGS

ROCKY TOP MOTEL AND CAMPGROUND
SCS SOILS MAP

**GENERAL SOIL MAP
PIKE NATIONAL FOREST
EASTERN PART
COLORADO**

JULY 1992



Scale 1:362,057

1 inch equals approximately 5.7 miles

PARTS OF DOUGLAS, EL PASO, JEFFERSON,
AND TELLER COUNTIES, COLORADO

U.S. DEPARTMENT OF AGRICULTURE
FOREST SERVICE
SOIL CONSERVATION SERVICE
COLORADO AGRICULTURAL EXPERIMENT STATION

$$t_c = t_i + t_t \quad (\text{Eq. 6-7})$$

Where:

t_c = time of concentration (min)

t_i = overland (initial) flow time (min)

t_t = travel time in the ditch, channel, gutter, storm sewer, etc. (min)

3.2.1 Overland (Initial) Flow Time

The overland flow time, t_i , may be calculated using Equation 6-8.

$$t_i = \frac{0.395(1.1 - C_5)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_5 = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries													
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks													
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_t) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_t) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

* For buried riprap, select C_v value based on type of vegetative cover.

The travel time is calculated by dividing the flow distance (in feet) by the velocity calculated using Equation 6-9 and converting units to minutes.

The time of concentration (t_c) is then the sum of the overland flow time (t_i) and the travel time (t_r) per Equation 6-7.

3.2.3 First Design Point Time of Concentration in Urban Catchments

Using this procedure, the time of concentration at the first design point (typically the first inlet in the system) in an urbanized catchment should not exceed the time of concentration calculated using Equation 6-10. The first design point is defined as the point where runoff first enters the storm sewer system.

$$t_c = \frac{L}{180} + 10 \quad (\text{Eq. 6-10})$$

Where:

t_c = maximum time of concentration at the first design point in an urban watershed (min)

L = waterway length (ft)

Equation 6-10 was developed using the rainfall-runoff data collected in the Denver region and, in essence, represents regional “calibration” of the Rational Method. Normally, Equation 6-10 will result in a lesser time of concentration at the first design point and will govern in an urbanized watershed. For subsequent design points, the time of concentration is calculated by accumulating the travel times in downstream drainageway reaches.


3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

3.2.5 Post-Development Time of Concentration

As Equation 6-8 indicates, the time of concentration is a function of the 5-year runoff coefficient for a drainage basin. Typically, higher levels of imperviousness (higher 5-year runoff coefficients) correspond to shorter times of concentration, and lower levels of imperviousness correspond to longer times of

Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

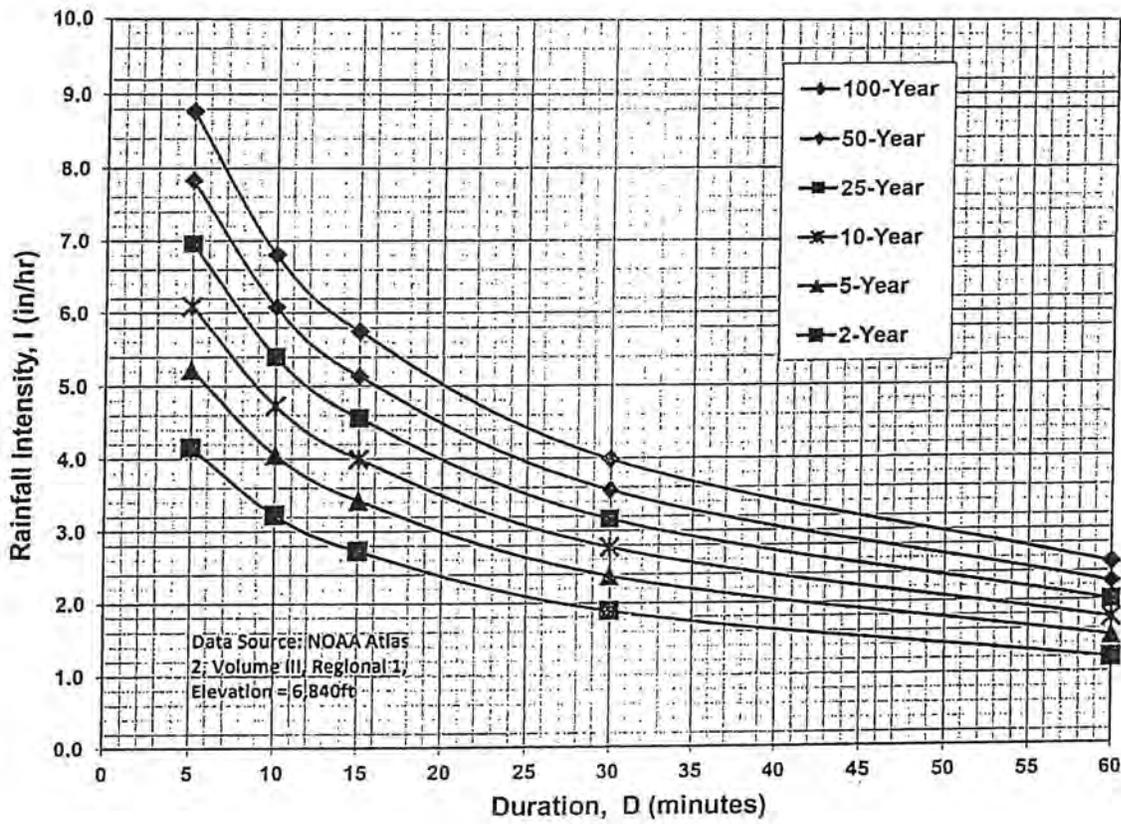

IDF Equations

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$




$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$

$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.

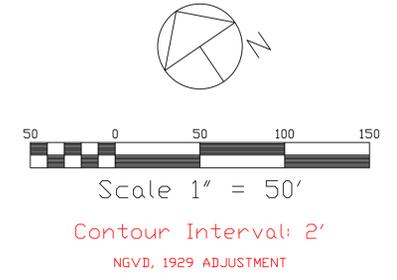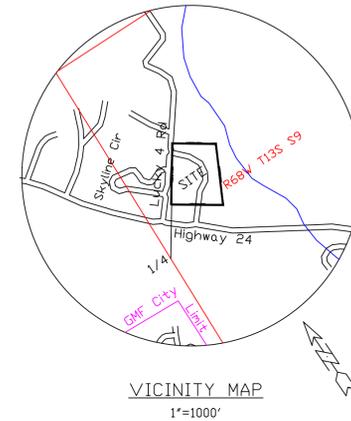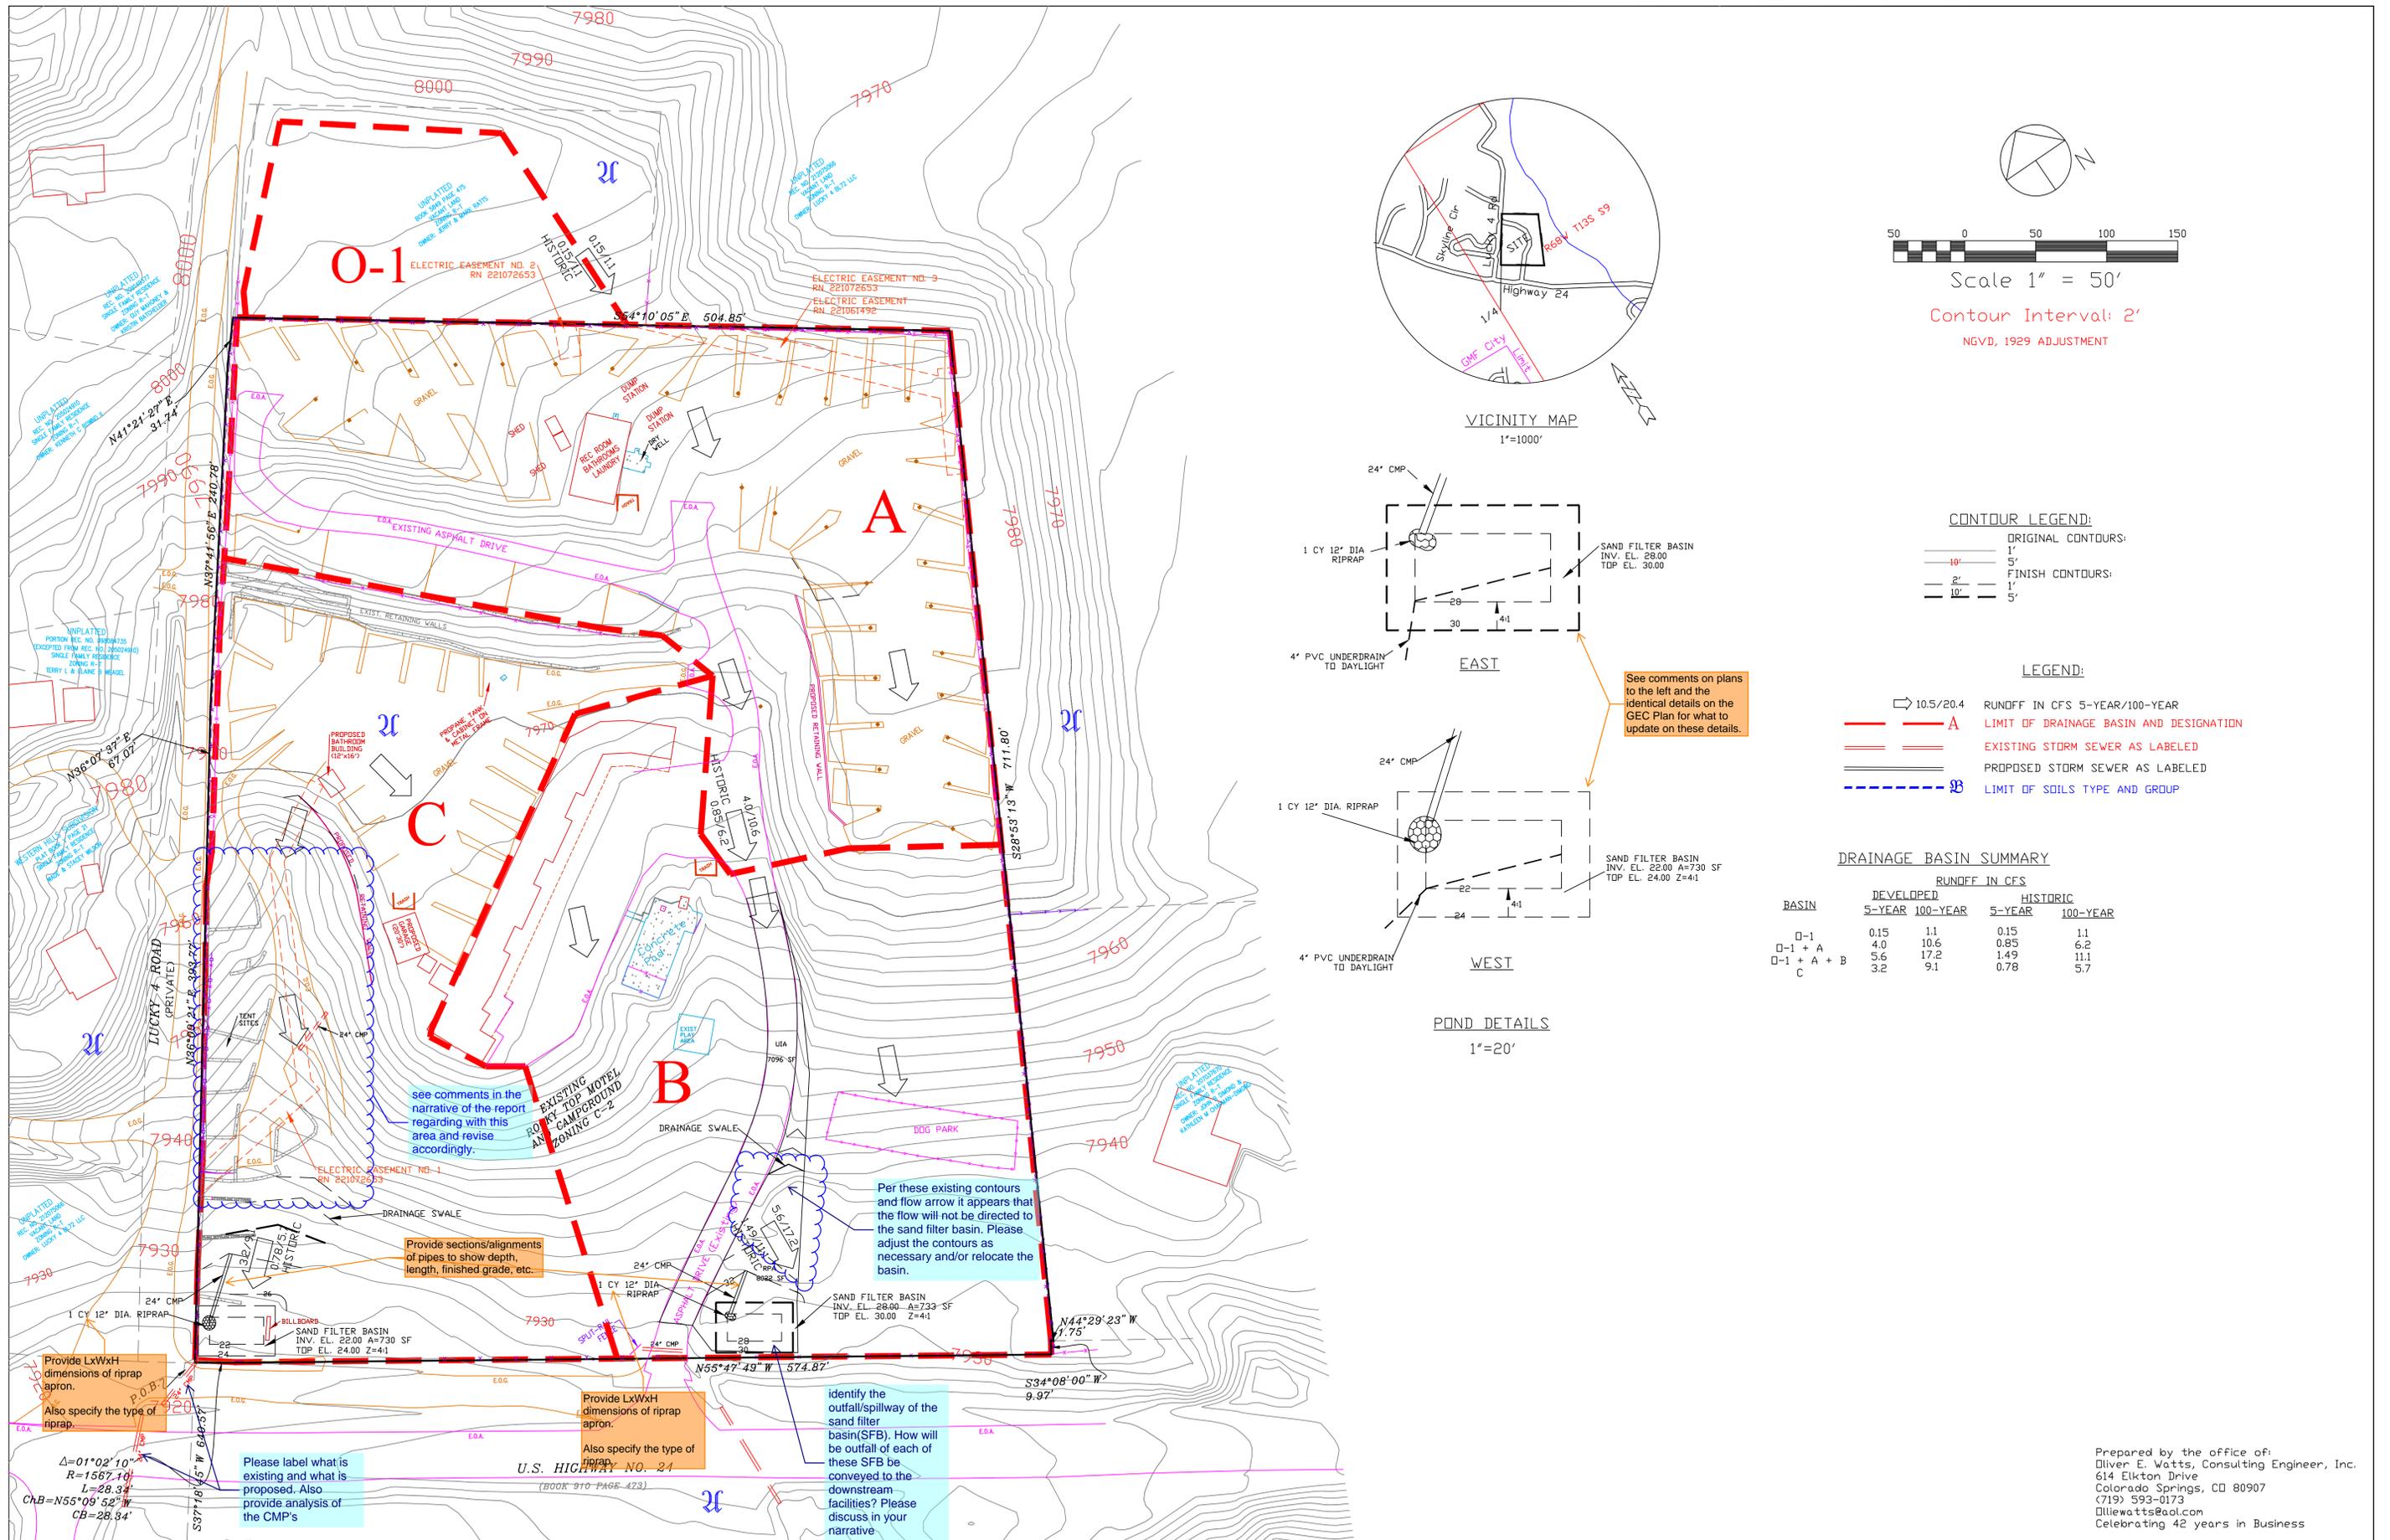

CONTOUR LEGEND:


—	ORIGINAL CONTOURS:
—	1'
—	5'
—	FINISH CONTOURS:
—	1'
—	5'

LEGEND:

→ 10.5/20.4	RUNOFF IN CFS 5-YEAR/100-YEAR
— A —	LIMIT OF DRAINAGE BASIN AND DESIGNATION
— — —	EXISTING STORM SEWER AS LABELED
— — —	PROPOSED STORM SEWER AS LABELED
— B —	LIMIT OF SOILS TYPE AND GROUP

DRAINAGE BASIN SUMMARY

BASIN	DEVELOPED RUNOFF IN CFS		HISTORIC RUNOFF IN CFS	
	5-YEAR	100-YEAR	5-YEAR	100-YEAR
O-1	0.15	1.1	0.15	1.1
O-1 + A	4.0	10.6	0.85	6.2
O-1 + A + B	5.6	17.2	1.49	11.1
C	3.2	9.1	0.78	5.7

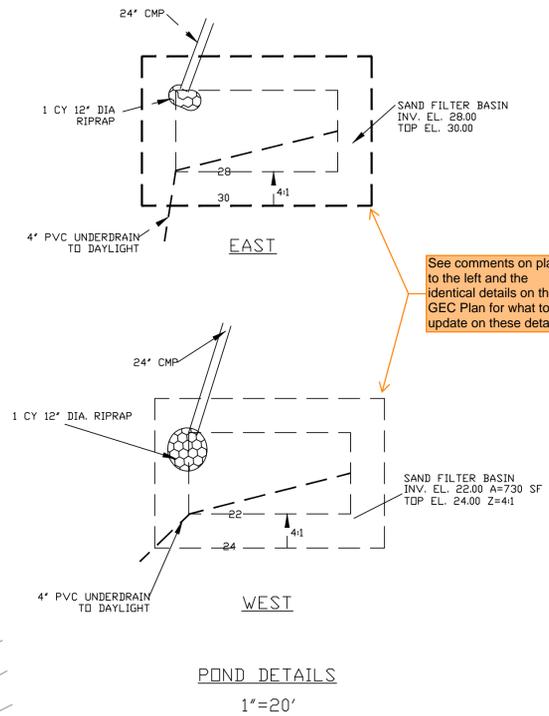

See comments on plans to the left and the identical details on the GEC Plan for what to update on these details.

see comments in the narrative of the report regarding with this area and revise accordingly.

Per these existing contours and flow arrow it appears that the flow will not be directed to the sand filter basin. Please adjust the contours as necessary and/or relocate the basin.

Provide sections/alignments of pipes to show depth, length, finished grade, etc.

Identify the outfall/spillway of the sand filter basin (SFB). How will be outfall of each of these SFB be conveyed to the downstream facilities? Please discuss in your narrative.

Please label what is existing and what is proposed. Also provide analysis of the CMP's

Provide LxWxH dimensions of riprap apron. Also specify the type of riprap.

Provide LxWxH dimensions of riprap apron. Also specify the type of riprap.

$\Delta = 01^{\circ}02'10''$
 $R = 1567.10'$
 $L = 28.34'$
 $ChB = N55^{\circ}09'52''W$
 $CB = 28.84'$

Prepared by the office of:
 Oliver E. Watts, Consulting Engineer, Inc.
 614 Elkton Drive
 Colorado Springs, CO 80907
 (719) 593-0173
 Oliewatts@aol.com
 Celebrating 42 years in Business

DRAWN BY: D.E. WATTS DATE: 6-13-19 DWG. NO.: 19-5341-02 TOPOGRAPHY BY: CITY FMS 6-12-19 SURVEY INFORMATION BY: RAMPART JOB NO. 18384	APPROVED BY: PROJ. NO.: DWG.:	REVISIONS 8-16-21 UPDATED DEW 12-30-21 REVISED PER COUNTY REVIEW COMMENTS DEW 4-13-22 REVISED PER COUNTY REVIEW COMMENTS DEW	OLIVER E. WATTS CONSULTING ENGINEER COLORADO SPRINGS	PROJECT ROCKY TOP MOTEL & CAMPGROUND PART NW1/4 SECTION 9, T.13S., R.68W., 6TH P.M. EL PASO COUNTY	SHEET NAME DRAINAGE PLAN	SHEET NO. 1 OF 1
--	-------------------------------------	--	--	---	------------------------------------	---------------------------