



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
COLORADO SPRINGS, CO 80907
PHONE (719) 531-5599
FAX (719) 531-5238

May 26, 2022

Classic Communities
2138 Flying Horse Club Drive
Colorado Springs, CO. 80921

Attn: Mark Sherwood

Re: Density Testing – Sanitary Sewer
Forest Lakes Development, Filing 7
Colorado Springs, Colorado
Report No. 2, Tests 13 - 39

Dear Mr. Sherwood,


As requested, personnel of Entech Engineering, Inc. have performed density testing at the above referenced site.

Density testing on this site was performed on March 25 through 30, 2022. The density testing indicates that the materials have been adequately compacted at the depths and in the locations noted, with the exception of test 23. However, a re-test was taken the same day on March 29, 2022. Results of the density tests are enclosed with this letter.

We trust that this has provided you with the information you require. Should you have any questions or need further information, please do not hesitate to contact us.

Respectfully Submitted,

ENTECH ENGINEERING, INC.

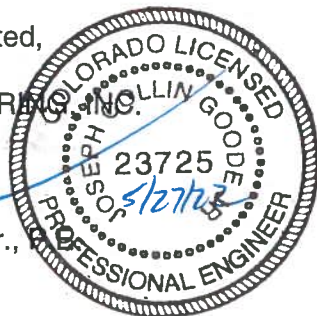

Joseph C. Goode, Jr.,
President

JCG/pb

Enclosure

Entech Job No. 220622

F:\AA projects\2022\220622-FKRD-Forest Lakes F7-110-ConMat\220622_2cl2.doc


Client: Classic Communities	Entech Job #: 220622.2	Proctor Value Key: M = modified, ASTM D-1557
Project: Forest Lakes Development, Filing 7	Tested By: B. Wasilik	S = standard, ASTM D-698
Subject: Sanitary Sewer	Report Date: 05-26-2022	T = AASHTO, T-180

Test #	Test Location	Testing Date	Percent Compaction	Percent Required	Percent Moisture	Soil Type	Proctor Type/Value	Pass/Fail
13	Manhole # 8, at grade.	3/25/2022	96	95	8.9	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
14	Main, Station # 21 + 00, 10' below grade.	3/25/2022	99	95	10.0	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
15	Main, Station # 21 + 00, 8' below grade.	3/25/2022	100	95	10.3	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
16	Main, Station # 21 + 00, 6' below grade.	3/25/2022	97	95	10.2	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
17	Main, Station # 21 + 00, 4' below grade.	3/25/2022	99	95	10.6	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
18	Main, Station # 21 + 00, 2' below grade.	3/25/2022	98	95	10.4	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
19	Main, Station # 21 + 00, at grade.	3/25/2022	99	95	10.0	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
20	Main, Station # 20 + 00, 12' below grade.	3/25/2022	98	95	9.5	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
21	Manhole # 7, 10' below grade.	3/29/2022	96	95	9.1	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
22	Manhole # 7, 8' below grade.	3/29/2022	96	95	9.5	SM	M - 125.7 @ 8.8	<input type="checkbox"/>

Comments:

Scope of Observation: PERIODIC; CONTRACTOR'S OR CLIENT'S REPRESENTATIVE ADVISED

All dimensions are approximate. Cl. = Centerline

 <p>ENTECH ENGINEERING, INC. 505 Elkton Drive Colorado Springs, CO 80907 (719) 531-5599 • (719) 531-5238 (fax)</p>	<p>FIELD DENSITY RESULTS</p>	<p><i>Joseph C. Goode, Jr., P.E.</i></p>
--	-------------------------------------	--


Client: Classic Communities	Entech Job #: 220622.2	Proctor Value Key: M = modified, ASTM D-1557
Project: Forest Lakes Development, Filing 7	Tested By: B. Wasilik	S = standard, ASTM D-698
Subject: Sanitary Sewer	Report Date: 05-26-2022	T = AASHTO, T-180

Test #	Test Location	Testing Date	Percent Compaction	Percent Required	Percent Moisture	Soil Type	Proctor Type/Value	Pass/Fail
23	Manhole # 7, 6' below grade.	3/29/2022	88	95	10.3	SM	M - 125.7 @ 8.8	<input checked="" type="checkbox"/>
23a	Manhole # 7, 6' below grade.	3/29/2022	97	95	9.6	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
24	Manhole # 7, 4' below grade.	3/29/2022	97	95	9.1	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
25	Manhole # 7, 2' below grade.	3/29/2022	97	95	9.5	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
26	Main, Station # 18 + 50, 10' below grade.	3/29/2022	98	95	9.0	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
27	Main, Station # 18 + 50, 8' below grade.	3/29/2022	99	95	10.3	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
28	Main, Station # 18 + 50, 6' below grade.	3/30/2022	99	95	10.2	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
29	Main, Station # 18 + 50, 4' below grade.	3/30/2022	96	95	9.3	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
30	Main, Station # 18 + 50, 2' below grade.	3/30/2022	97	95	9.9	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
31	Main, Station # 18 + 50, at grade.	3/30/2022	97	95	9.3	SM	M - 125.7 @ 8.8	<input type="checkbox"/>

Comments:

Scope of Observation: PERIODIC; CONTRACTOR'S OR CLIENT'S REPRESENTATIVE ADVISED

All dimensions are approximate. Cl. = Centerline

 <p>ENTECH ENGINEERING, INC. 505 Elkton Drive Colorado Springs, CO 80907 (719) 531-5599 • (719) 531-5238 (fax)</p>	<p>FIELD DENSITY RESULTS</p>	<p><i>Joseph C. Gonde, Jr., P.E.</i></p>
--	-------------------------------------	--


Client: Classic Communities	Entech Job #: 220622.2	Proctor Value Key: M = modified, ASTM D-1557
Project: Forest Lakes Development, Filing 7	Tested By: B. Wasilik	S = standard, ASTM D-698
Subject: Sanitary Sewer	Report Date: 05-26-2022	T = AASHTO, T-180

Test #	Test Location	Testing Date	Percent Compaction	Percent Required	Percent Moisture	Soil Type	Proctor Type/Value	Pass/Fail
32	Manhole # 7, at grade.	3/30/2022	95	95	9.6	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
33	Service, Lot # 1, 10' below grade.	3/30/2022	98	95	9.0	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
34	Service, Lot # 1, 8' below grade.	3/30/2022	95	95	9.6	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
35	Service, Lot # 1, 6' below grade.	3/30/2022	95	95	10.0	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
36	Service, Lot # 1, 5' below grade.	3/30/2022	97	95	7.9	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
37	Service, Lot # 1, 4' below grade.	3/30/2022	95	95	9.7	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
38	Service, Lot # 1, 2' below grade.	3/30/2022	96	95	8.9	SM	M - 125.7 @ 8.8	<input type="checkbox"/>
39	Service, Lot # 1, at grade.	3/30/2022	96	95	9.1	SM	M - 125.7 @ 8.8	<input type="checkbox"/>

Comments:

Scope of Observation: PERIODIC; CONTRACTOR'S OR CLIENT'S REPRESENTATIVE ADVISED

All dimensions are approximate. Cl. = Centerline

 <p>ENTECH ENGINEERING, INC. 505 Elkton Drive Colorado Springs, CO 80907 (719) 531-5599 • (719) 531-5238 (fax)</p>	<p>FIELD DENSITY RESULTS</p>	<p><i>Joseph C. Goode, Jr., P.E.</i></p>
--	------------------------------	--