



The Cottages at Mesa Ridge Preliminary Drainage Report

August 2021

HR Green Project No: 200541

Prepared For:

Goodwin Knight

Contact: Bryan D. Kniep

8605 Explorer Drive, Suite 250

Colorado Springs, CO 80920

Prepared By:

HR Green Development, LLC

Contact: Ken Huhn, PE

khuhn@hrgreen.com

(720) 602-4965




Table of Contents

| | |
|---|---|
| Table of Contents | 2 |
| I. General Purpose, Location and Description..... | 3 |
| a. Purpose | 3 |
| b. Location | 3 |
| c. Description of Property | 3 |
| d. Floodplain Statement..... | 3 |
| II. Drainage Basins and Subbasins | 3 |
| a. Major Basin Description..... | 3 |
| b. Existing Subbasin Description | 4 |
| c. Proposed Subbasin Description | 4 |
| III. Drainage Design Criteria | 5 |
| a. Development Criteria Reference | 5 |
| b. Hydrologic Criteria | 5 |
| IV. Drainage Facility Design..... | 5 |
| a. General Concept | 5 |
| b. Water Quality & Detention | 5 |
| c. Inspection and Maintenance..... | 8 |
| d. Four Step Method to Minimize Adverse Impacts of Urbanization | 8 |
| e. Drainage and Bridge Fees..... | 9 |
| V. Summary | 9 |
| VI. Drawings..... | 9 |
| VII. References | 9 |

Appendices

- A. Vicinity Map, FEMA Map, NRCS Soil Survey
- B. Hydrologic Analysis
- C. Hydraulic Analysis
- D. Water Quality and Detention Calculations
- E. Reference Material
- F. Drainage Maps

I. General Purpose, Location and Description

a. Purpose

The purpose of this Preliminary Drainage Report (PDR) is to describe the onsite and offsite drainage patterns, existing and proposed storm infrastructure, and the planned stormwater management for The Cottages at Mesa Ridge. This report will support the development plan that is currently in review with El Paso County.

b. Location

The Cottages at Mesa Ridge, referred to as 'the site' herein, is in a portion of the northeast quarter of section 29, the southeast quarter of section 20, the southwest quarter of section 21, and the northwest quarter of section 28, township 15 south, range 65 west of the 6th P.M., County of El Paso, Colorado. The site is bound by S. Powers Boulevard to the east, multi-family residential development to the south, single-family residential development to the west and undeveloped land to the north. Surrounding platted developments include Mesa Ridge Filing 8 and 9 to the south, Sunrise Ridge to the west and the Glen at Widefield to the east. A vicinity map is presented in Appendix A.

c. Description of Property

The site is approximately 10.22 acres of undeveloped land with existing vegetation consisting of native grasses. Once developed, the site will include 122 dwelling units, a club house and open space tracts. The site will be platted as a single lot. In general, the site slopes south towards the Fountain Mutual Irrigation Co canal. Onsite elevations range from 5750' - 5795' with slopes ranging 1 – 33%. Per a NRCS soil survey, the site is made up of Type B Stoneham sandy loam and Type B Nelson-Tassel fine sand loams. The NRCS soil survey is presented in Appendix A.

There are no major drainageways or irrigation facilities that traverse the site nor does the site fall within the Streamside Overlay Zone. Onsite, existing utilities include water, sewer, fiberoptic, underground gas and underground electric/telecommunication. An existing drainage map is presented in Appendix F.

d. Floodplain Statement

Based on FEMA Firm map 08041C0956G dated December 8, 2018, the site is Zone X, which are areas determined to be outside the 0.2% annual chance flood.

II. Drainage Basins and Subbasins

a. Major Basin Description

The site is not located within one of the major drainage basins from the City of Colorado Springs Drainage Basin Planning Study Inventory prepared by Kiowa Engineering Corporation, 2017. The site's drainage characteristics were previously studied in the following reports:

1. "Master Development Drainage Plan Mesa Ridge Development" prepared by Kiowa Engineering Corporation, December 17, 2006. (2006 MDDP)
2. "Mesa Ridge Development Master Development Drainage Plan Update" prepared by Kiowa Engineering Corporation, January 15, 2013. (2013 MDDP)

In the 2006 MDDP, the site was identified as Basin 1040 and Basin 1030. Basin 1040 was planned to be routed to Detention Basin D (located within Mesa Ridge Subdivision Filing 8) while Basin 1030 was routed to

Detention Basin 1031 (located on the east side of S. Powers Boulevard adjacent to the site). The 2013 MDDP did not alter the planned detention scenario for the site.

b. Existing Subbasin Description

The site's existing drainage is split into five basins. An existing drainage map is presented in Appendix B. See below for existing basin descriptions:

Basin EX1 is 5.69 acres of undeveloped area and existing single family residential lots. Existing stormwater from this basin ($Q_5 = 2.5$ cfs $Q_{100} = 13.7$ cfs) is conveyed onsite to DP1.

Basin EX2 is 3.12 acres of undeveloped area and a portion of S. Powers Boulevard. Existing stormwater from this basin ($Q_5 = 4.2$ cfs $Q_{100} = 12.4$ cfs) is conveyed in an existing roadside swale to DP2. An existing area inlet at DP2 conveys the stormwater underneath S. Powers Boulevard to an existing detention pond.

Basin EX3 is 1.46 acres of undeveloped area. Existing stormwater from this basin ($Q_5 = 1.6$ cfs $Q_{100} = 5.1$ cfs) is conveyed to the existing irrigation canal to DP3.

Basin EX4 is 0.28 acres of undeveloped area. Existing stormwater from this basin ($Q_5 = 0.1$ cfs $Q_{100} = 0.8$ cfs) is conveyed in an existing roadside swale to DP4.

Basin EX5 is 3.38 acres of undeveloped area and existing single family residential lots. Existing stormwater from this basin ($Q_5 = 2.8$ cfs $Q_{100} = 11.9$ cfs) flows offsite along the site's southern boundary at DP5.

c. Proposed Subbasin Description

The proposed site has been divided into 9 subbasins for analysis. All storm sewer and appurtenances are private. A drainage map has been presented in Appendix F. See below for basin descriptions:

Basin 1 is 3.56 acres of single-family residential lots, duplex homes, roadway and landscaping. Stormwater from this basin ($Q_5 = 7.6$ cfs $Q_{100} = 16.1$ cfs) is conveyed in curb and gutter to a 15' Type R on-grade inlet at DP1. Basin 1 stormwater is piped to the full spectrum detention pond for water quality and detention.

Basin 2 is 4.93 acres of single-family residential lots, duplex homes, roadway and landscaping. Stormwater from this basin ($Q_5 = 9.5$ cfs $Q_{100} = 20.3$ cfs) is conveyed in curb and gutter to a 15' Type R on-grade inlet at DP2. Basin 2 stormwater is piped to the full spectrum detention pond for water quality and detention.

Basin 3 is 3.03 acres of existing roadway (S. Powers Boulevard) and undeveloped area. Stormwater from this basin ($Q_5 = 3.4$ cfs $Q_{100} = 9.7$ cfs) follows historic drainage patterns in an existing roadside swale to an existing Type C inlet at DP3.

Basin 4 is 0.52 acres of landscaping and undeveloped area. Stormwater from this basin ($Q_5 = 0.4$ cfs $Q_{100} = 1.8$ cfs) follows historic drainage patterns towards S. Powers Boulevard at DP4.

Basin 5 is 1.50 acres of landscaping and a fire access road. Stormwater from this basin ($Q_5 = 2.1$ cfs $Q_{100} = 5.7$ cfs) is captured in a grass-lined swale and captured in a Type C inlet. Basin 5 stormwater is piped to the full spectrum detention pond for water quality and detention.

Basin 6 is 0.63 acres of undeveloped area. Stormwater from this basin ($Q_5 = 0.2$ cfs $Q_{100} = 1.2$ cfs) follows historic drainage patterns in an existing roadside swale along S. Powers Boulevard at DP5.

Basin 7 is 0.56 acres of landscaping and existing single family residential. Stormwater from this basin ($Q_5 = 0.4$ cfs $Q_{100} = 1.8$ cfs) follows historic drainage patterns towards DP7.

Basin 8 is 0.24 acres of roadway. Stormwater from this basin ($Q_5 = 1.1$ cfs $Q_{100} = 2.0$ cfs) is conveyed in curb and gutter down Landover Lane to a 10' Type R inlet at DP8. Basin 8 stormwater is piped to the full spectrum detention pond for water quality and detention.

Basin 9 is 0.14 acres of roadway. Stormwater from this basin ($Q_5 = 0.7$ cfs $Q_{100} = 1.2$ cfs) is conveyed in curb and gutter down Landover Lane to a 10' Type R inlet at DP9. Basin 9 stormwater is piped to the full spectrum detention pond for water quality and detention.

III. Drainage Design Criteria

a. Development Criteria Reference

The drainage analysis, proposed storm sewer system, and proposed full spectrum water quality and detention pond follow the criteria from the “*City of Colorado Springs Drainage Criteria Manual*” Volumes 1 and 2” (CCSDCM, latest revision).

b. Hydrologic Criteria

Hydrologic data was obtained from the “*City of Colorado Springs Drainage Criteria Manual – Chapter 6 Hydrology*”. Onsite drainage improvements are designed for the 5-year storm (minor event) and 100-year storm (major event) using rainfall values from CCSDCM Table 6-2 below. Runoff was calculated per CCSDCM Section 6.3.0 - Rational Method. Full spectrum pond design was completed using the latest version of Mile High Flood District's (MHFD) UD-Detention per CCSDCM Section 13.3.2.1 – Full Spectrum Detention in addition to CUHP v.2.0.1 and EPA-SWMM v.5.1. Detention pond allowable release rate will be limited to less than or equal to those noted in the 2013 Mesa Ridge MDDP.

| Table 6-2: Rainfall Depths for Colorado Springs | | |
|---|------|------|
| Return Period (yr) | 5 | 100 |
| 1-hr Rainfall Depth (in) | 1.50 | 2.52 |

IV. Drainage Facility Design

a. General Concept

Onsite stormwater will be conveyed via Type 5 curb and gutter to Type R inlets. Captured stormwater will be piped to and detained in an existing, full spectrum detention pond located in Mesa Ridge Filing 9 south of the site. The full spectrum detention pond will outfall at less than historic values to the east side of S. Powers Boulevard and to the site's historic outfall. See below section regarding the existing detention basin analysis and retrofit. The ultimate outfall for the site is Jimmy Camp Creek, south of Hale Reservoir.

b. Water Quality & Detention

The Cottages at Mesa Ridge will utilize the existing regional Full Spectrum Detention Basin D for water quality and detention. This pond was included originally as flood control in the 2006 MDDP and was updated to provide Full Spectrum detention with the 2013 MDDP. In addition, the record drawings for the retrofit of the pond confirmed the use of an orifice plate to control the full spectrum volume. Record documents are titled: *Mesa Ridge Filings 8 & 9, Detention Basin 'D', Full Spectrum Detention Modifications, Final Design Drawings*, by Kiowa Engineering Corporation, dated October 2011. Both MDDPs show Basin 1040 routed to Full

Spectrum Detention Basin D. However, the basin characteristics provided with the most recent MDDP included The Cottages at Mesa Ridge site as historic.

In order to confirm that the existing Full Spectrum Detention Basin D has capacity for development of The Cottages at Mesa Ridge, updated modeling with proposed basin 1040 characteristics is necessary.

Hydrology and hydraulics included with the previous MDDPs utilized HEC-1 software to determine peak runoff quantities at specific design points and routing elements. These HEC-1 models were not available for use, so an effort was made to update them to the more current HEC-HMS program. However, there were too many unknown variables with the program to get it to provide reliable results.

Current CCSDCM V.1 CH.6 1.4 Selecting Methods for Estimating Design Flows notes in part that:

- For more complex drainage basins and routing requirements, the HEC-HMS model or the EPA SWMM method is better suited but requires more experience and expertise to properly apply. The EPA SWMM method also provides hydrographs, reservoir routing, and the ability to evaluate runoff reduction practices in detail.
- If detention facilities are to be sized based on hydrograph routing, or if hydrograph information is desired for any other reason, the EPA SWMM or the NRCS method must be used.

Therefore, CUHP and EPA SWMM methodology were selected as appropriate modeling programs to confirm volumes and release rates for Full Spectrum Detention Basin D are in line with the intent of the previous MDDPs and current CCSDCM criteria.

CUHP

A new CUHP model was prepared streamlined with only the MDDP basins being updated at this time and major basins tributary to Full Spectrum Detention Basin D. This includes Basin 1040, 6001, 6005, 6010, 6011 and 6020. Basin parameters included in the CUHP as follows:

- Basin parameters for Basin 1040 were updated based on the most current design information available and correspond to the Rational Method calculations noted elsewhere in this report. The area to Basin 1040 increased from what was accounted for in the previous MDDPs.
- Basins 6001, 6005, 6010, 6011 and 6020 used area and length parameters taken directly from the HEC-1 noted above.
- Basins 6001, 6005, 6010, 6011 and 6020 utilized percent impervious estimated from existing as-constructed land uses.
- All basins used the standard depression storage and infiltration parameters for Hydrologic Soil Type B.

Rainfall data was taken from NOAA Atlas 14 Point Precipitation for a 60-minute (1-hour) recurrence interval depth, 100=2.74 in. The 1-hour point precipitation was chosen in part because the MHFD-Detention worksheet uses the 1-hour depth as an input parameter to run the CUHP program in the background. This allows a more accurate review of the existing pond by using consistent storms across both the CUHP and MHFD-Detention software.

Input parameters and results for the 100-year event are included with Appendix D.

EPA SWMM

Similar to the CUHP modeling, a simplified hydraulic routing model was prepared. In this case, the U.S. Environmental Protection Agency Stormwater Management Model (EPA SWMM) software was used for the proposed conditions with the development of The Cottages at Mesa Ridge.

The model includes a stage-storage curve for Pond D extracted directly from the pond grading shown on the 2011 Full Spectrum Detention Modifications Plan noted above. The proposed Pond D stage-release curve was developed through an iterative process, described more in depth below.

The other separate existing pond (Detention Basin 6002) which is tributary to Pond D provides storage for Basin 6001. Parameters for modeling Detention Basin 6002 were taken directly from the 2013 MDDP HEC-1. Additionally, EPA SWMM element routing parameters such as channel length and size were taken directly from the previous HEC-1 model with the exception of elevations (not used in HEC-1). For this a reasonable starting (downstream) elevation was used from the Pond D plans, and slope/length parameters from HEC-1 used to set all other upstream elevations. A back-check was completed to ensure resultant upstream elevations seem reasonable given rough elevations on 2013 MDDP Exhibit.

Input parameters and results for the 100-year event are included with Appendix D.

Full Spectrum Detention Basin D

MHFD-Detention worksheets were set up using updated total watershed area and percent imperviousness for several reasons, they include:

- To confirm the updated full spectrum volume required within Pond D. Note, because an inflow hydrograph will be used for the 100-year event only the resultant full spectrum volumes are relevant from this data.
- To review how the existing pond is functioning under the proposed condition by incorporating the as-built stage-storage and stage-release data into the workbook. Note, the release structure was surveyed to provide accurate structure parameters.
- To route the 100-year hydrograph developed in the CUHP and EPA SWMM through the provided pond volume and as-built release structure.

MHFD-Detention (as-built) results from routing the proposed 100-year hydrograph through the as-built pond volume and release structure indicate that there is adequate 100-year volume in the existing pond for development of The Cottages at Mesa Ridge site. However, results also indicate that the existing pond is exceeding drain time limitations noted in current MHFD criteria and Colorado Revised Statute 37-92-602(8).

To rectify the drain times discrepancy a separate MHFD-Detention (proposed) worksheet was set up matching the previously noted stage-storage curve and input hydrograph but altering the release structure (and corresponding stage-release curve). The drain times were revised by enlarging the orifice areas and updating the detention stages to correlate with the new Full Spectrum volume. Once the 100-year peak release rate was confirmed to be at or below the threshold established with the 2013 MDDP (223 cfs) the resultant stage-release curve was transferred back to the prepared SWMM and re-run to confirm the same results as found with the MHFD-Detention (proposed) analysis.

Key pond parameters from the 2011 Full Spectrum Detention Modifications Plan along with the values determined with this Preliminary Drainage Report are summarized below.

| Full Spectrum Detention Basin D Summary | | | |
|--|---|--|--|
| | 2011 Full Spectrum Modifications | As-Built Pond D without Modifications | As-Built Pond D with Proposed Modifications |
| Tributary Area (acres) | not provided | 98.8 | 98.8 |
| % Impervious (%) | not provided | 48.8 | 48.8 |
| Full Spectrum Volume (acre-ft) | 4.2 | 5.1 | 5.1 |
| Full Spectrum WSEL (ft) | 5686.8 | 5687.2 | 5687.2 |
| Full Spectrum Drain Time (hrs) | not provided | > 120 | 73 |
| 100-yr volume (acre-ft) | 8.3 | 11.6 | 12.5 |
| Release Rate (cfs) | 219 | 252 | 232 |
| 100-yr WSEL (ft) | 5690.2 | 5691.2 | 5691.7 |
| 100-yr Drain Time (hrs) | not provided | > 120 | 70 |

Conclusions from the analysis presented with this Report are that Full Spectrum Detention Basin D will function as intended in the proposed conditions taking into consideration the Basin 1040 changes (including increase in basin area) that will occur with development of The Cottages at Mesa Ridge. No modifications to the as-built volume are anticipated at this time. Minor modifications are expected to the release structure to bring the existing pond in conformance with current drain time and stage-storage requirements. The detailed extent of modifications to the existing structure will be provided with the Final Drainage Report as the project design progresses.

c. Inspection and Maintenance

An Inspection and maintenance manual will be provided with the Final Drainage Report. The manual will specify maintenance intervals and required actions to maintain the function of the extended detention basin and appurtenances.

d. Grading and Erosion Control Plan

Due to the project disturbance area, a separate Grading and Erosion Control plan will be required. The Grading and Erosion Control Plan will be submitted in conjunction with the Final Drainage Report and Construction Drawings.

e. Four Step Method to Minimize Adverse Impacts of Urbanization

Step 1 – Reducing Runoff Volumes: Roof drains will route across landscape areas and grass lined swales are used for stormwater conveyance, whenever possible to promote infiltration.

Step 2 – Treat and slowly release the WQCV: An onsite full spectrum detention pond provides water quality treatment for the site. The WQCV is released over a period of 44 hours.

Step 3 – Stabilize stream channels: Drainage swales will be lined with non-erosive soils and permanently seeded to provide stabilization. If required due to erosive velocities, additional protection will be provided in the form of riprap lining and drop structures to reduce stormwater velocities and provide stabilization.

Step 4 – Consider the need for source controls: No industrial or commercial uses are proposed within this development and therefore no source controls are proposed.

f. Drainage and Bridge Fees

Cottages at Mesa Ridge are not within a defined major drainage basin per Colorado Springs and therefore no drainage fees are due at time of platting.

g. Opinion of Probable Cost

We respectfully request that the engineer's opinion of probable cost be postponed until the Final Drainage Report.

V. Summary

The Cottages at Mesa Ridge development remains consistent with pre-development drainage conditions with the construction of the recommended drainage improvements. The proposed development will not adversely affect downstream stormwater infrastructure or surrounding developments. This report meets the latest El Paso County Drainage criteria and is in accordance with the Mesa Ridge MDDP.



VI. Drawings

Please refer to the appendices for vicinity and drainage basin maps.

VII. References

1. City of Colorado Springs – Drainage Criteria Manual, May 2014, Revised January 2021.
2. Urban Storm Drainage Criteria Manual, Mile High Flood District, January 2018.
3. *Master Development Drainage Plan Mesa Ridge Development*, Kiowa Engineering Corporation, December 17, 2006.
4. *Mesa Ridge Development Master Development Drainage Plan Update*, Kiowa Engineering Corporation, January 15, 2013.
5. *Mesa Ridge Filings 8 & 9, Detention Basin 'D', Full Spectrum Detention Modifications, Final Design Drawings*, by Kiowa Engineering Corporation, October 2011.
6. Colorado Unit Hydrograph Procedure (CUHP), Version 2.0.1, October 2019.
7. Environmental Protection Agency Stormwater Management Model (EPA SWMM), Version 5.1, 2020.
8. Mile High Flood District Detention Basin Design Workbook (MHFD-Detention), Version 4.04, February 2021.

APPENDIX A – VICINITY MAP, SOIL MAP, FEMA MAP

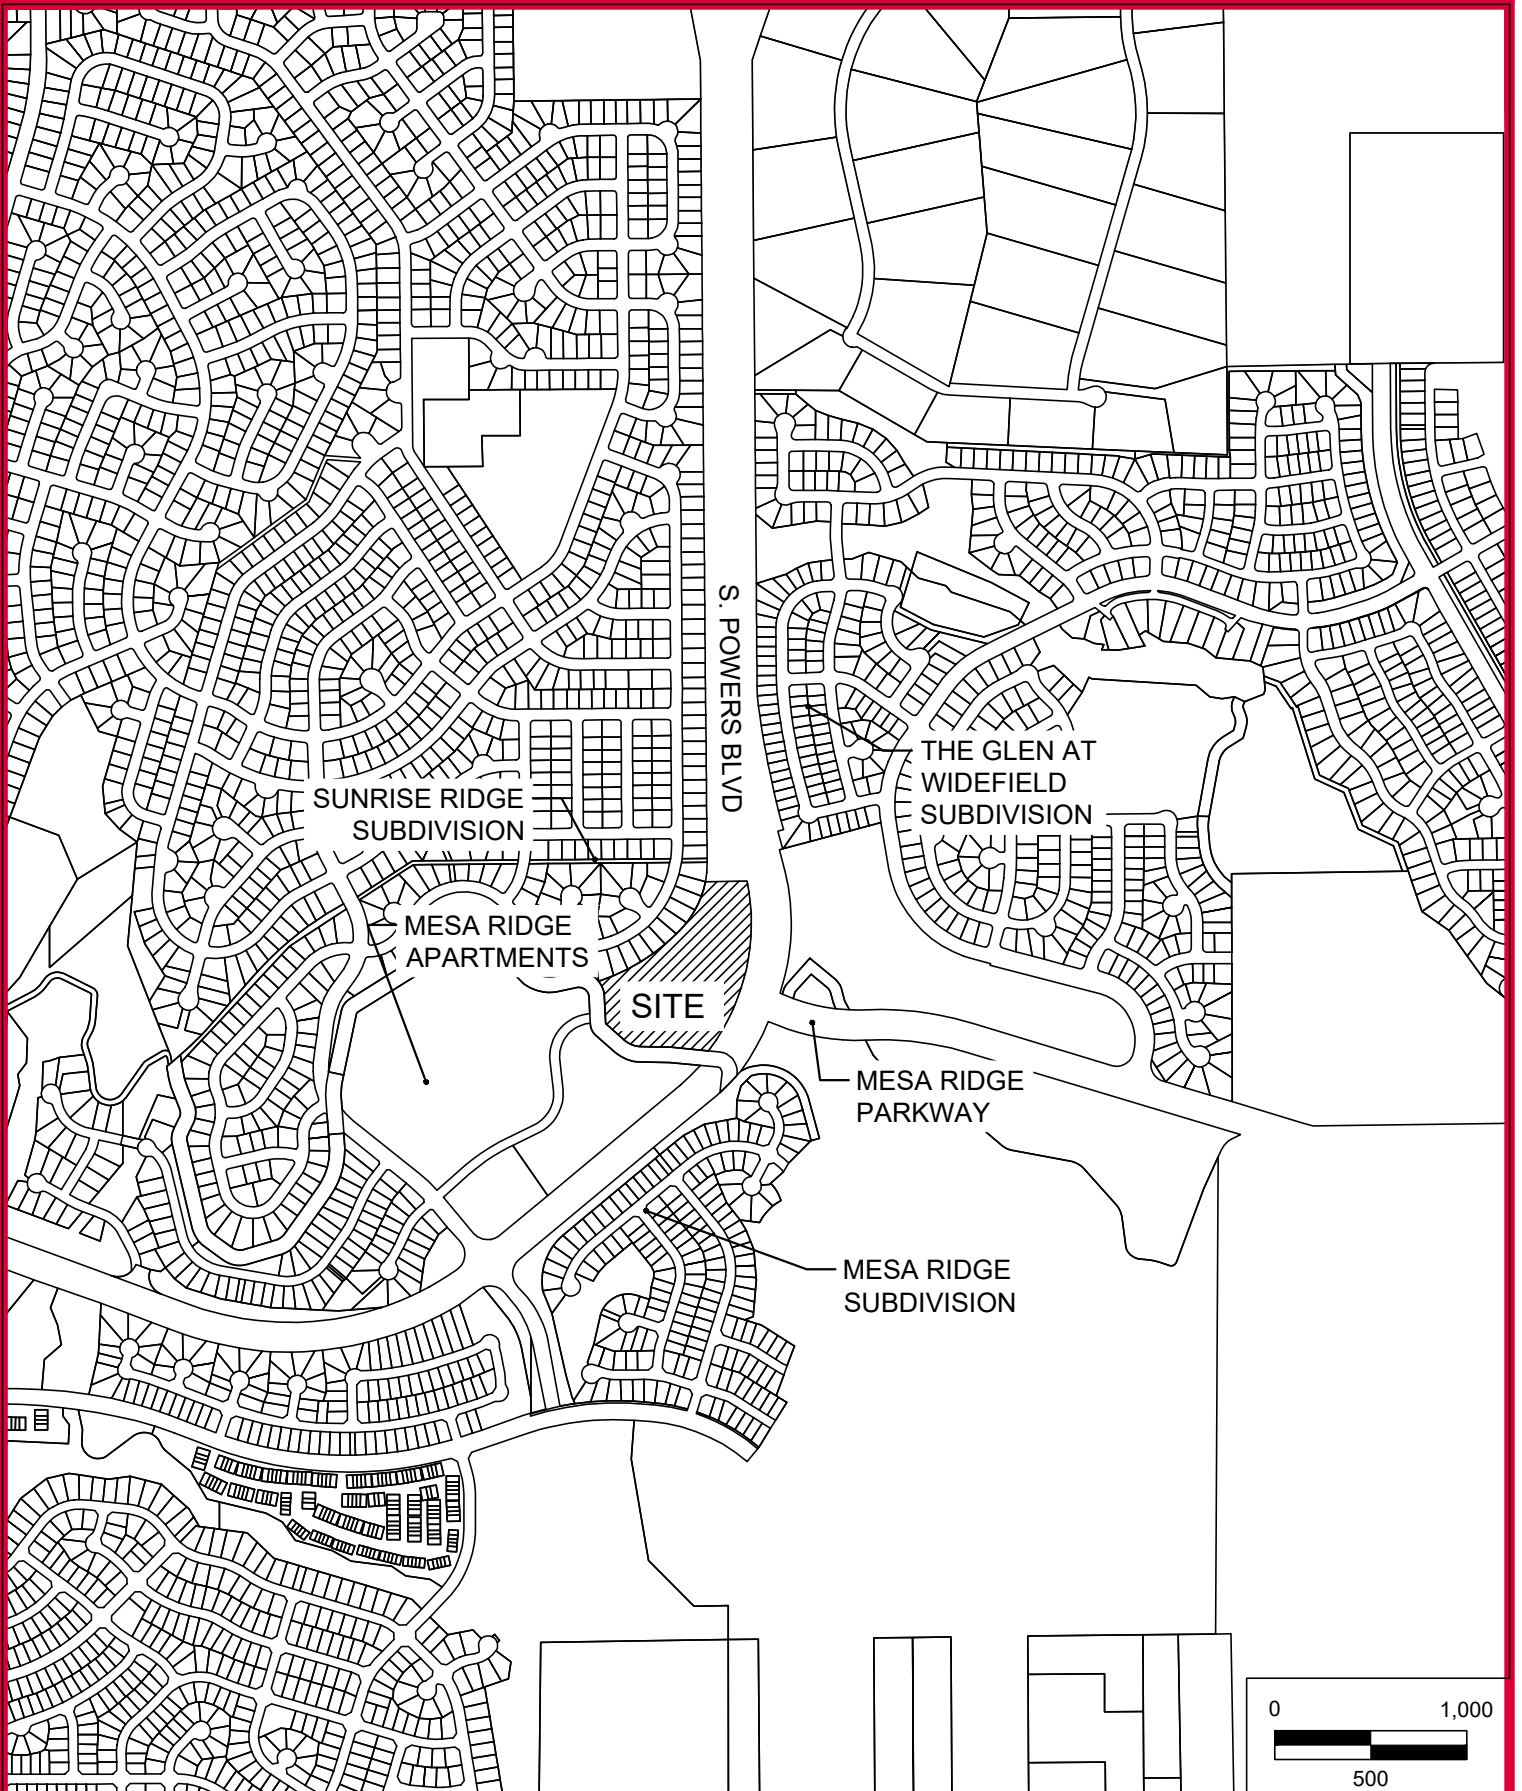


HRGreen.com



SHEET
VICINITY MAP

SCALE: 1"=1,000'
DATE: 03/29/2021

Hydrologic Soil Group—El Paso County Area, Colorado

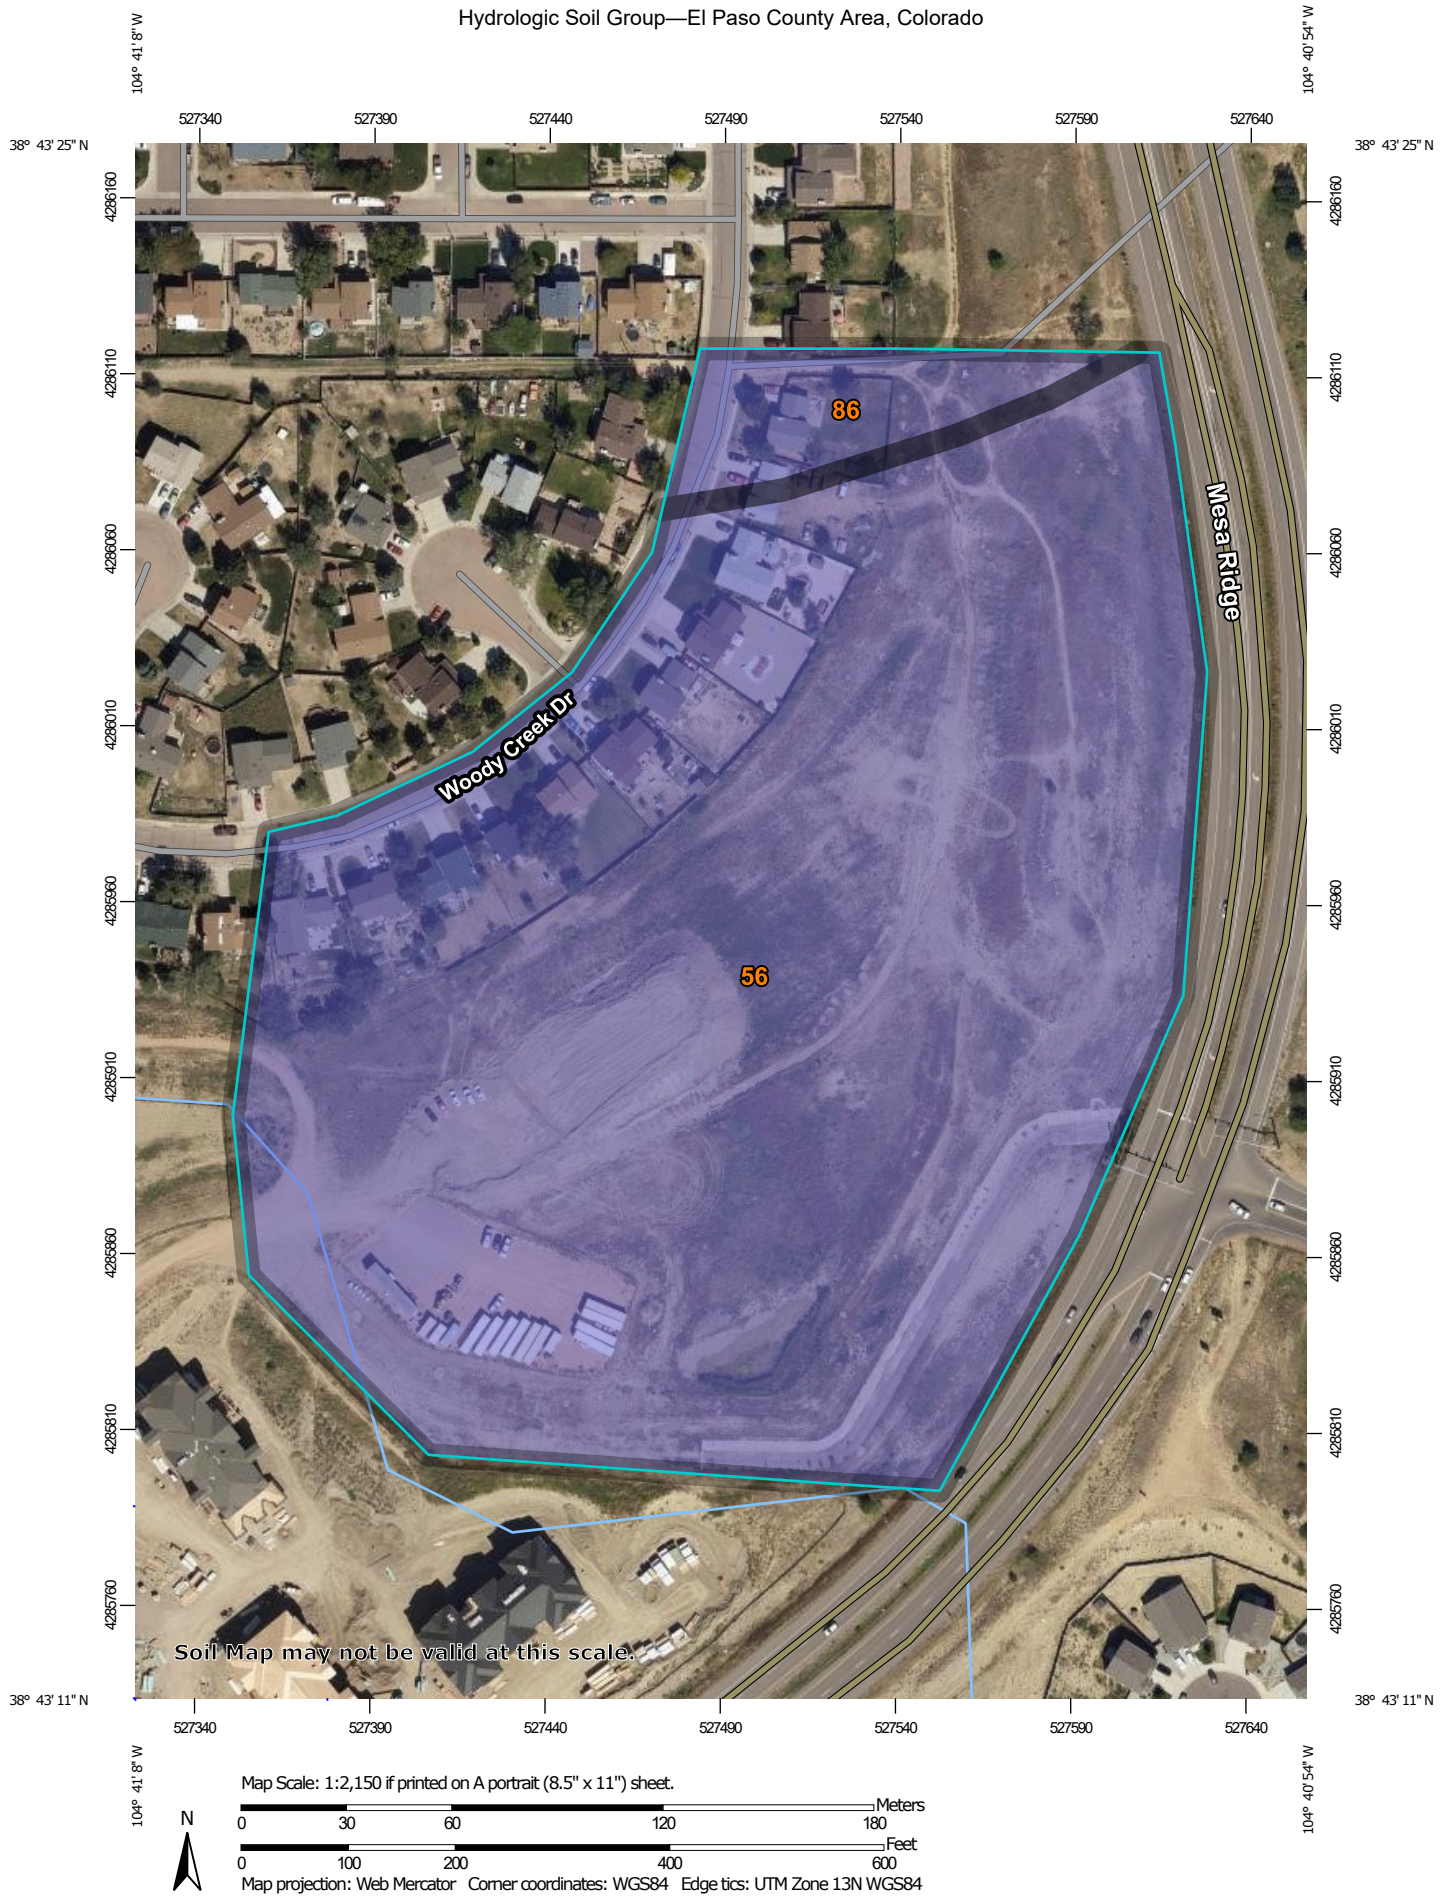

**Natural Resources
Conservation Service**

Web Soil Survey
National Cooperative Soil Survey

6/30/2020
Page 1 of 4

MAP LEGEND

Area of Interest (AOI)









 Area of Interest (AOI)

Soils

Soil Rating Polygons





 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Lines


 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Points






 A
 A/D
 B
 B/D

 C
 C/D
 D
 Not rated or not available

Water Features

 Streams and Canals

Transportation

 Rails
 Interstate Highways
 US Routes
 Major Roads
 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 17, Sep 13, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 14, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

| Map unit symbol | Map unit name | Rating | Acres in AOI | Percent of AOI |
|------------------------------------|--|--------|--------------|----------------|
| 56 | Nelson-Tassel fine sandy loams, 3 to 18 percent slopes | B | 15.6 | 94.7% |
| 86 | Stoneham sandy loam, 3 to 8 percent slopes | B | 0.9 | 5.3% |
| Totals for Area of Interest | | | 16.5 | 100.0% |

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.


APPENDIX B – HYDROLOGIC CALCULATIONS


**COTTAGES AT MESA RIDGE****Calc'd by:****NQJ****EXISTING CONDITIONS****Checked by:****LOCATION: COLORADO SPRINGS, COLORADO****Date:****8/10/2021****SUMMARY RUNOFF TABLE**

| BASIN | AREA (ac) | % IMPERVIOUS | Q ₅ (cfs) | Q ₁₀₀ (cfs) |
|-------|-----------|-----------------|----------------------|------------------------|
| EX1 | 5.69 | 7 | 2.5 | 13.7 |
| EX2 | 3.12 | 28 | 4.2 | 12.4 |
| EX3 | 1.46 | 24 | 1.6 | 5.1 |
| EX4 | 0.28 | 2 | 0.1 | 0.8 |
| EX5 | 3.38 | 15 | 2.8 | 11.9 |

DESIGN POINT SUMMARY TABLE

| DESIGN POINT | UPSTREAM BASIN | ΣQ ₅ (cfs) | ΣQ ₁₀₀ (cfs) |
|-----------------|-------------------|-----------------------|-------------------------|
| 1 | EX1 | 2.5 | 13.7 |
| 2 | EX2 | 4.2 | 12.4 |
| 3 | EX3 | 1.6 | 5.1 |
| 4 | EX4 | 0.1 | 0.8 |
| 5 | EX5 | 2.8 | 11.9 |

|  | COTTAGES AT MESA RIDGE | | | | | | | | | | | | NQJ | Calc'd by: | | | |
|--|---|--------------|------------------------------|--------------|----------------------|--------------------|----------------------|------------------------|--------------|----------------------|------------------------|------------------------------|----------------------|------------------------|---|----------------------|------------------------|
| | EXISTING CONDITIONS | | | | | | | | | | | | | Checked by: | | | |
| | LOCATION: COLORADO SPRINGS, COLORADO | | | | | | | | | | | | 8/10/2021 | Date: | | | |
| COMPOSITE 'C' FACTORS | | | | | | | | | | | | | | | | | |
| BASIN | UNDEVELOPED | PAVED | SINGLE FAMILY LOT | TOTAL | SOIL TYPE | UNDEVELOPED | | | PAVED | | | SINGLE FAMILY LOT | | | COMPOSITE IMPERVIOUSNESS & C | | |
| | ACRES | | | | | %I | C₅ | C₁₀₀ | %I | C₅ | C₁₀₀ | %I | C₅ | C₁₀₀ | %I | C₅ | C₁₀₀ |
| EX1 | 5.25 | 0.00 | 0.44 | 5.69 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 65 | 0.45 | 0.69 | 7 | 0.12 | 0.39 |
| EX2 | 2.28 | 0.84 | 0.00 | 3.12 | B | 2 | 0.16 | 0.51 | 100 | 0.90 | 0.96 | 65 | 0.45 | 0.69 | 28 | 0.36 | 0.63 |
| EX3 | 1.13 | 0.33 | 0.00 | 1.46 | B | 2 | 0.16 | 0.51 | 100 | 0.90 | 0.96 | 65 | 0.45 | 0.69 | 24 | 0.33 | 0.61 |
| EX4 | 0.28 | 0.00 | 0.00 | 0.28 | B | 2 | 0.16 | 0.51 | 100 | 0.90 | 0.96 | 65 | 0.45 | 0.69 | 2 | 0.16 | 0.51 |
| EX5 | 2.70 | 0.00 | 0.68 | 3.38 | B | 2 | 0.16 | 0.51 | 100 | 0.90 | 0.96 | 65 | 0.45 | 0.69 | 15 | 0.22 | 0.55 |
| | | | | | | | | | | | | | | | | | |
| Total | | | | 13.93 | | | | | | | | | | | 15.30 | | |

| | | | | | | | | | | | |
|---|---|-----------|--------------------------------------|---------|----------------------|------------------------------------|-------------|--------------------|----------|----------------------|----------------------|
|  | COTTAGES AT MESA RIDGE | | | | | | | Calc'd by: | | NQJ | |
| | EXISTING CONDITIONS | | | | | | | Checked by: | | | |
| | LOCATION: COLORADO SPRINGS, COLORADO | | | | | | | Date: | | 8/10/2021 | |
| TIME OF CONCENTRATION | | | | | | | | | | | |
| BASIN DATA | | | OVERLAND TIME (T_o) | | | TRAVEL TIME (T_t) | | | | | TOTAL |
| DESIGNATION | C _s | AREA (ac) | LENGTH (ft) | SLOPE % | t _o (min) | C _v | LENGTH (ft) | SLOPE % | V (ft/s) | t _t (min) | t _c (min) |
| EX1 | 0.12 | 5.69 | 100 | 25.0 | 6.2 | 10 | 750 | 3.2 | 1.8 | 7.0 | 13.1 |
| EX2 | 0.36 | 3.12 | 158 | 7.1 | 8.9 | 10 | 620 | 6.5 | 2.5 | 4.1 | 12.9 |
| EX3 | 0.33 | 1.46 | 25 | 25.0 | 2.4 | 20 | 520 | 0.1 | 0.6 | 13.7 | 16.1 |
| EX4 | 0.16 | 0.28 | 75 | 1.0 | 14.9 | 10 | 305 | 5.4 | 2.3 | 2.2 | 17.1 |
| EX5 | 0.22 | 3.38 | 42 | 1.8 | 8.6 | 10 | 440 | 4.2 | 2.0 | 3.6 | 12.2 |
| | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | | | | | | | | |
|---|--------------|----------|------------------------|----------------|----------------------|------------------------|--------------|---------|----------------------|------------------------|--------------|---------|---------------------------|------------------------|---------|-------------------------|------------------------|-------------|----------------|-------------|------------|-------------------|---------|--|
| <div><div>1+3+3</div><div>HRGreen</div></div> | | | COTTAGES AT MESA RIDGE | | | | | | | | | | | | | | | Calc'd by: | | NQJ | | | | |
| | | | EXISTING CONDITIONS | | | | | | | | | | | | | | | Checked by: | | | | | | |
| | | | DESIGN STORM: 5-YEAR | | | | | | | | | | | | | | | Date: | | 8/10/2021 | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | DIRECT RUNOFF | | | | | | TOTAL RUNOFF | | | | STREET | | | PIPE | | | | TRAVEL TIME | | | REMARKS | |
| STREET | DESIGN POINT | BASIN ID | AREA (ac) | C ₅ | t _c (min) | C ₅ *A (ac) | I (in./ hr.) | Q (cfs) | t _c (min) | C ₅ *A (ac) | I (in./ hr.) | Q (cfs) | Q _{street} (cfs) | C ₅ *A (ac) | SLOPE % | Q _{PIPE} (cfs) | C ₅ *A (ac) | SLOPE % | PIPE SIZE (in) | LENGTH (FT) | VEL. (FPS) | TRAVEL TIME (min) | | |
| | 1 | EX1 | 5.69 | 0.12 | 13.1 | 0.67 | 3.72 | 2.5 | | | | | | | | | | | | | | | | |
| | 2 | EX2 | 3.12 | 0.36 | 12.9 | 1.12 | 3.74 | 4.2 | | | | | | | | | | | | | | | | |
| | 3 | EX3 | 1.46 | 0.33 | 16.1 | 0.48 | 3.41 | 1.6 | | | | | | | | | | | | | | | | |
| | 4 | EX4 | 0.28 | 0.16 | 17.1 | 0.04 | 3.32 | 0.1 | | | | | | | | | | | | | | | | |
| | 5 | EX5 | 3.38 | 0.22 | 12.2 | 0.74 | 3.83 | 2.8 | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | |



COTTAGES AT MESA RIDGE

EXISTING CONDITIONS

DESIGN STORM: 100-YEAR

Calc'd by:

NQJ

Checked by:

Date:

8/10/2021

| | | | DIRECT RUNOFF | | | | | | TOTAL RUNOFF | | | | STREET | | | PIPE | | | | TRAVEL TIME | | | REMARKS |
|--------|--------------|----------|---------------|------------------|----------------------|--------------------------|-------------|---------|----------------------|--------------------------|-------------|---------|---------------------------|--------------------------|---------|-------------------------|--------------------------|---------|----------------|-------------|-------------|-------------------|---------|
| STREET | DESIGN POINT | BASIN ID | AREA (ac) | C ₁₀₀ | t _c (min) | C ₁₀₀ *A (ac) | I (in./hr.) | Q (cfs) | t _c (min) | C ₁₀₀ *A (ac) | I (in./hr.) | Q (cfs) | Q _{street} (cfs) | C ₁₀₀ *A (ac) | SLOPE % | Q _{PIPE} (cfs) | C ₁₀₀ *A (ac) | SLOPE % | PIPE SIZE (ft) | LENGTH (ft) | VEL. (ft/s) | TRAVEL TIME (min) | |
| | 1 | EX1 | 5.69 | 0.39 | 13.1 | 2.19 | 6.24 | 13.7 | | | | | | | | | | | | | | | |
| | 2 | EX2 | 3.12 | 0.63 | 12.9 | 1.97 | 6.28 | 12.4 | | | | | | | | | | | | | | | |
| | 3 | EX3 | 1.46 | 0.61 | 16.1 | 0.89 | 5.73 | 5.1 | | | | | | | | | | | | | | | |
| | 4 | EX4 | 0.28 | 0.51 | 17.1 | 0.14 | 5.58 | 0.8 | | | | | | | | | | | | | | | |
| | 5 | EX5 | 3.38 | 0.55 | 12.2 | 1.85 | 6.43 | 11.9 | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | |




| | | | |
|---|--|--------------------|------------------|
| COTTAGES AT MESA RIDGE | | Calc'd by: | NQJ |
| PROPOSED CONDITIONS | | Checked by: | |
| LOCATION: COLORADO SPRINGS, COLORADO | | Date: | 8/11/2021 |

| SUMMARY RUNOFF TABLE | | | | |
|----------------------|-----------|--------------|----------------------|------------------------|
| BASIN | AREA (ac) | % IMPERVIOUS | Q ₅ (cfs) | Q ₁₀₀ (cfs) |
| 1 | 3.56 | 63 | 7.6 | 16.1 |
| 2 | 4.93 | 59 | 9.5 | 20.3 |
| 3 | 3.03 | 29 | 3.4 | 9.7 |
| 4 | 0.52 | 8 | 0.4 | 1.8 |
| 5 | 1.50 | 32 | 2.1 | 5.7 |
| 6 | 0.63 | 2 | 0.2 | 1.2 |
| 7 | 0.56 | 26 | 0.5 | 1.6 |
| 8 | 0.24 | 100 | 1.1 | 2.0 |
| 9 | 0.14 | 100 | 0.7 | 1.2 |

| DESIGN POINT SUMMARY TABLE | | | |
|----------------------------|----------------|-----------------------|-------------------------|
| DESIGN POINT | UPSTREAM BASIN | ΣQ ₅ (cfs) | ΣQ ₁₀₀ (cfs) |
| 1 | 1 | 7.6 | 16.1 |
| 2 | 2 | 9.5 | 20.3 |
| 2.1 | 3 | 15.6 | 29.9 |
| 3 | 4 | 3.4 | 9.7 |
| 4 | 5 | 0.4 | 1.8 |
| 5 | 5 | 2.1 | 5.7 |
| 6 | 6 | 0.2 | 1.2 |
| 7 | 7 | 0.5 | 1.6 |
| 8 | 8 | 1.1 | 2.0 |
| 9 | 9 | 1.1 | 1.2 |
| 9.1 | 8&9 | 17.1 | 39.6 |

**COTTAGES AT MESA RIDGE****PROPOSED CONDITIONS****LOCATION: COLORADO SPRINGS, COLORADO****Calc'd by:****Checked by:****Date:****COMPOSITE 'C' FACTORS**

| BASIN | LANDSCAPING | PAVED | ROOFS | SINGLE FAMILY | TOTAL | SOIL TYPE | LANDSCAPING | | | PAVED | | | ROOFS | | | SINGLE FAMILY | | | COMPOSITE IMPERVIOUSNESS & C | | |
|-------|-------------|-------|-------|---------------|-------|-----------|-------------|----------------|------------------|-------|----------------|------------------|-------|----------------|------------------|---------------|----------------|------------------|------------------------------|----------------|------------------|
| | ACRES | | | | | | %I | C ₅ | C ₁₀₀ | %I | C ₅ | C ₁₀₀ | %I | C ₅ | C ₁₀₀ | %I | C ₅ | C ₁₀₀ | %I | C ₅ | C ₁₀₀ |
| 1 | 0.86 | 1.38 | 0.66 | 0.66 | 3.56 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 63 | 0.56 | 0.70 |
| 2 | 1.76 | 1.69 | 1.21 | 0.27 | 4.93 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 59 | 0.54 | 0.68 |
| 3 | 2.19 | 0.84 | 0.00 | 0.00 | 3.03 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 29 | 0.31 | 0.53 |
| 4 | 0.49 | 0.03 | 0.00 | 0.00 | 0.52 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 8 | 0.14 | 0.39 |
| 5 | 1.04 | 0.46 | 0.00 | 0.00 | 1.50 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 32 | 0.34 | 0.54 |
| 6 | 0.63 | 0.00 | 0.00 | 0.00 | 0.63 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 2 | 0.09 | 0.36 |
| 7 | 0.21 | 0.00 | 0.00 | 0.35 | 0.56 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 26 | 0.22 | 0.45 |
| 8 | 0.00 | 0.24 | 0.00 | 0.00 | 0.24 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 100 | 0.90 | 0.96 |
| 9 | 0.00 | 0.14 | 0.00 | 0.00 | 0.14 | B | 2 | 0.09 | 0.36 | 100 | 0.90 | 0.96 | 90 | 0.73 | 0.81 | 40 | 0.30 | 0.50 | 100 | 0.90 | 0.96 |
| | | | | | | | | | | | | | | | | | | | | | |
| Pond | | | | | 11.56 | | | | | | | | | | | | | | 54 | | |
| Total | | | | | 15.11 | | | | | | | | | | | | | | | | |

| | | | | | | | | | | | |
|---|---|-----------|---|---------|-------------|---------------------------------------|-------------|--------------------|----------|------------------|--------------|
|  | COTTAGES AT MESA RIDGE | | | | | | | Calc'd by: | | NQJ | |
| | PROPOSED CONDITIONS | | | | | | | Checked by: | | | |
| | LOCATION: COLORADO SPRINGS, COLORADO | | | | | | | Date: | | 8/10/2021 | |
| TIME OF CONCENTRATION | | | | | | | | | | | |
| BASIN DATA | | | OVERLAND TIME (T_i) | | | TRAVEL TIME (T_t) | | | | | TOTAL |
| DESIGNATION | C_5 | AREA (ac) | LENGTH (ft) | SLOPE % | t_i (min) | C_v | LENGTH (ft) | SLOPE % | V (ft/s) | t_t (min) | t_c (min) |
| 1 | 0.56 | 3.56 | 100 | 2.0 | 7.8 | 20 | 900 | 2.9 | 3.4 | 4.4 | 12.2 |
| 2 | 0.54 | 4.93 | 100 | 2.0 | 8.2 | 20 | 1160 | 2.5 | 3.2 | 6.1 | 14.3 |
| 3 | 0.31 | 3.03 | 65 | 2.0 | 9.2 | 10 | 715 | 6.0 | 2.4 | 4.9 | 14.1 |
| 4 | 0.14 | 0.52 | 22 | 25.0 | 2.8 | 20 | 92 | 9.0 | 6.0 | 0.3 | 5.0 |
| 5 | 0.34 | 1.50 | 54 | 25.0 | 3.5 | 10 | 260 | 0.5 | 0.7 | 6.1 | 9.6 |
| 6 | 0.09 | 0.63 | 70 | 1.0 | 15.5 | 10 | 380 | 5.5 | 2.3 | 2.7 | 18.2 |
| 7 | 0.22 | 0.56 | 58 | 2.0 | 9.7 | 10 | 260 | 3.0 | 1.7 | 2.5 | 12.2 |
| 8 | 0.90 | 0.24 | 16 | 2.0 | 1.2 | 20 | 270 | 9.0 | 6.0 | 0.8 | 5.0 |
| 9 | 0.90 | 0.14 | 16 | 2.0 | 1.2 | 20 | 270 | 9.0 | 6.0 | 0.8 | 5.0 |
| | | | | | | | | | | | |

| | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|--------------|----------|------------------------|----------------|----------------------|------------------------|--------------|---------|----------------------|------------------------|--------------|---------|---------------------------|------------------------|---------|-------------------------|------------------------|-----------|----------------|-------------|------------|-------------------|--|--|--|
| <div><div>1433</div><div>HRGreen</div></div> | | | COTTAGES AT MESA RIDGE | | | | | | | | | | | | | Calc'd by: | | NQJ | | | | | | | |
| | | | PROPOSED CONDITIONS | | | | | | | | | | | | | Checked by: | | | | | | | | | |
| | | | DESIGN STORM: 5-YEAR | | | | | | | | | | | | | Date: | | 8/10/2021 | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | DIRECT RUNOFF | | | | | | TOTAL RUNOFF | | | | STREET | | | PIPE | | | | TRAVEL TIME | | | REMARKS | | |
| STREET | DESIGN POINT | BASIN ID | AREA (ac) | C ₅ | t _c (min) | C ₅ *A (ac) | I (in./ hr.) | Q (cfs) | t _c (min) | C ₅ *A (ac) | I (in./ hr.) | Q (cfs) | Q _{street} (cfs) | C ₅ *A (ac) | SLOPE % | Q _{PIPE} (cfs) | C ₅ *A (ac) | SLOPE % | PIPE SIZE (in) | LENGTH (FT) | VEL. (FPS) | TRAVEL TIME (min) | | | |
| | 1 | 1 | 3.56 | 0.56 | 12.2 | 2.00 | 3.83 | 7.6 | | | | | 0.2 | 0.07 | 2.0 | 7.4 | 1.93 | 9.0 | 18.0 | 16 | 21.6 | 0.01 | BASIN 1 FLOW CAPTURED IN 15' TYPE R INLET (ON GRADE) | | |
| | | | | | | | | | | | | | | | | | | | | 280 | 2.8 | 1.65 | DP1 FLOW BY, C&G FLOW TO DP8 | | |
| | 2 | 2 | 4.93 | 0.54 | 14.3 | 2.64 | 3.59 | 9.5 | | | | | 0.8 | 0.22 | 2.0 | 8.7 | 2.42 | 9.0 | 18.0 | 16 | 21.6 | 0.01 | BASIN 2 FLOW CAPTURED IN 15' TYPE R INLET (ON GRADE) | | |
| | | | | | | | | | | | | | | | | | | | | 280 | 2.8 | 1.65 | DP2 FLOW BY, C&G FLOW TO DP9 | | |
| | 3 | 3 | 3.03 | 0.31 | 14.1 | 0.95 | 3.62 | 3.4 | | | | | | | | | | | | | | | BASIN 3 FLOW, SWALE FLOW TO EX TYPE C INLET @ DP3 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 4 | 4 | 0.52 | 0.14 | 5.0 | 0.07 | 5.17 | 0.4 | | | | | | | | | | | | | | | BASIN 4 FLOW, FOLLOW HISTORIC DRAINAGE PATTERNS TO DP4 | | |
| | 5 | 5 | 1.5 | 0.34 | 9.6 | 0.51 | 4.18 | 2.1 | | | | | | | | 2.1 | 0.51 | 0.5 | 18.0 | 536 | 5.1 | 1.75 | BASIN 5 FLOW @ DP5, CAPTURED IN TYPE C INLET, PIPE TO DP2.1 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 2.1 | | | | | | | | 14.3 | 4.36 | 3.59 | 15.6 | | | | 15.6 | 4.36 | 9.0 | 18.0 | 280 | 21.6 | 0.22 | COMBINED DP1 & DP2 FLOW, PIPE TO DP9.1 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 6 | 6 | 0.63 | 0.09 | 18.2 | 0.06 | 3.23 | 0.2 | | | | | | | | | | | | | | | BASIN 6 FLOW @ DP6, FOLLOWS HISTORIC DRAINAGE PATTERNS | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 7 | 7 | 0.56 | 0.22 | 12.2 | 0.12 | 3.83 | 0.5 | | | | | | | | | | | | | | | BASIN 7 FLOW @ DP7, FOLLOWS HISTORIC DRAINAGE PATTERNS | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 8 | 8 | 0.24 | 0.90 | 5.0 | 0.22 | 5.17 | 1.1 | 13.9 | 0.28 | 3.64 | 1.0 | | | | 1.0 | 0.28 | 2.0 | 18.0 | 16 | 10.2 | 0.03 | BASIN 8 AND DP1 FLOW BY, CAPTURED IN 10' TYPE R INLET (ON GRADE) | | |
| | | | | | | | | | | | | | | | | | | | | | | | DP8 FLOW BY, C&G FLOW TO LANDOVER LANE | | |
| | 9 | 9 | 0.14 | 0.90 | 5.0 | 0.13 | 5.17 | 0.7 | 16.0 | 0.35 | 3.43 | 1.2 | | | | 1.2 | 0.35 | 2.0 | 18.0 | 16 | 10.2 | 0.03 | BASIN 9 AND DP2 FLOW BY, CAPTURED IN 10' TYPE R INLET (ON GRADE) | | |
| | | | | | | | | | | | | | | | | | | | | | | | DP9 FLOW BY, C&G FLOW TO LANDOVER LANE | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9.1 | | | | | | | | 16.0 | 4.98 | 3.42 | 17.1 | | | | | | | | | | | COMBINED DP2.1, DP8 DP9 FLOW, PIPE TO EX DETENTION POND D | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |




| | | | | | | | | | | | |
|-------------------------------|--|--|--|--|--|--|--|--|--|-------------|-----------|
| COTTAGES AT MESA RIDGE | | | | | | | | | | Calc'd by: | NQJ |
| PROPOSED CONDITIONS | | | | | | | | | | Checked by: | |
| DESIGN STORM: 100-YEAR | | | | | | | | | | Date: | 8/10/2021 |

| | | | DIRECT RUNOFF | | | | | | TOTAL RUNOFF | | | | STREET | | | PIPE | | | | TRAVEL TIME | | | REMARKS |
|--------|--------------|----------|---------------|------------------|----------------------|--------------------------|-------------|---------|----------------------|--------------------------|-------------|---------|---------------------------|--------------------------|---------|-------------------------|--------------------------|---------|----------------|-------------|-------------|-------------------|--|
| STREET | DESIGN POINT | BASIN ID | AREA (ac) | C ₁₀₀ | t _c (min) | C ₁₀₀ *A (ac) | I (in./hr.) | Q (cfs) | t _c (min) | C ₁₀₀ *A (ac) | I (in./hr.) | Q (cfs) | Q _{street} (cfs) | C ₁₀₀ *A (ac) | SLOPE % | Q _{PIPE} (cfs) | C ₁₀₀ *A (ac) | SLOPE % | PIPE SIZE (ft) | LENGTH (ft) | VEL. (ft/s) | TRAVEL TIME (min) | |
| | 1 | 1 | 3.56 | 0.70 | 12.2 | 2.50 | 6.42 | 16.1 | | | | | 4.0 | 0.62 | 9.0 | 12.1 | 1.88 | 2.0 | 18.0 | 16 | 10.2 | 0.03 | BASIN 1 FLOW CAPTURED IN 15' TYPE R INLET (ON GRADE) |
| | | | | | | | | | | | | | | | | | | | | 280 | 6.0 | 0.78 | DP1 FLOW BY, C&G FLOW TO DP8 |
| | 2 | 2 | 4.93 | 0.68 | 14.3 | 3.37 | 6.03 | 20.3 | | | | | 6.7 | 1.11 | 9.0 | 13.6 | 2.26 | 2.0 | 18.0 | 16 | 10.2 | 0.03 | BASIN 2 FLOW CAPTURED IN 15' TYPE R INLET (ON GRADE) |
| | | | | | | | | | | | | | | | | | | | | 280 | 6.0 | 0.78 | DP2 FLOW BY, C&G FLOW TO DP9 |
| | 3 | 3 | 3.03 | 0.53 | 14.1 | 1.59 | 6.07 | 9.7 | | | | | | | | | | | | | | | BASIN 3 FLOW, SWALE FLOW TO EX TYPE C INLET @ DP3 |
| | 4 | 4 | 0.52 | 0.39 | 5.0 | 0.21 | 8.68 | 1.8 | | | | | | | | | | | | | | | BASIN 4 FLOW, FOLLOW HISTORIC DRAINAGE PATTERNS TO DP4 |
| | 5 | 5 | 1.5 | 0.54 | 9.6 | 0.82 | 7.03 | 5.7 | | | | | | | | 5.7 | 0.82 | 0.5 | 18.0 | 536 | 5.1 | 1.75 | BASIN 5 FLOW @ DP5, CAPTURED IN TYPE C INLET, PIPE TO DP2.1 |
| | 2.1 | | | | | | | | 14.3 | 4.96 | 6.02 | 29.9 | | | | 29.9 | 4.96 | 9.0 | 18.0 | 280 | 21.6 | 0.22 | COMBINED DP1 & DP2 FLOW, PIPE TO DP9.1 |
| | 6 | 6 | 0.63 | 0.36 | 18.2 | 0.23 | 5.42 | 1.2 | | | | | | | | | | | | | | | BASIN 6 FLOW @ DP6, FOLLOWS HISTORIC DRAINAGE PATTERNS |
| | 7 | 7 | 0.56 | 0.45 | 12.2 | 0.25 | 6.42 | 1.6 | | | | | | | | | | | | | | | BASIN 7 FLOW @ DP7, FOLLOWS HISTORIC DRAINAGE PATTERNS |
| | 8 | 8 | 0.24 | 0.96 | 5.0 | 0.23 | 8.68 | 2.0 | 13.0 | 0.85 | 6.27 | 5.3 | 0.5 | 0.08 | 9.0 | 4.8 | 0.77 | 9.0 | 18.0 | 16 | 21.6 | 0.01 | BASIN 8 AND DP1 FLOW BY, CAPTURED IN 10' TYPE R INLET (ON GRADE) |
| | | | | | | | | | | | | | | | | | | | | | | | DP8 FLOW BY, C&G FLOW TO LANDOVER LANE |
| | 9 | 9 | 0.14 | 0.96 | 5.0 | 0.13 | 8.68 | 1.2 | 15.1 | 1.25 | 5.89 | 7.4 | 1.5 | 0.25 | 9.0 | 5.9 | 1.00 | 9.0 | 18.0 | 16 | 21.6 | 0.01 | BASIN 9 AND DP2 FLOW BY, CAPTURED IN 10' TYPE R INLET (ON GRADE) |
| | | | | | | | | | | | | | | | | | | | | | | | DP9 FLOW BY, C&G FLOW TO LANDOVER LANE |
| | 9.1 | | | | | | | | 15.1 | 6.72 | 5.89 | 39.6 | | | | | | | | | | | COMBINED DP2.1, DP8 DP9 FLOW, PIPE TO EX DETENTION POND D |

APPENDIX C – HYDRAULIC CALCULATIONS*

*** HYDRAULIC CALCULATIONS INCLUDING INLET, STREET CAPACITY AND
HYDRAULIC MODELING WILL BE INCLUDED WITH THE FINAL DRAINAGE REPORT.**

APPENDIX D – WATER QUALITY & DETENTION

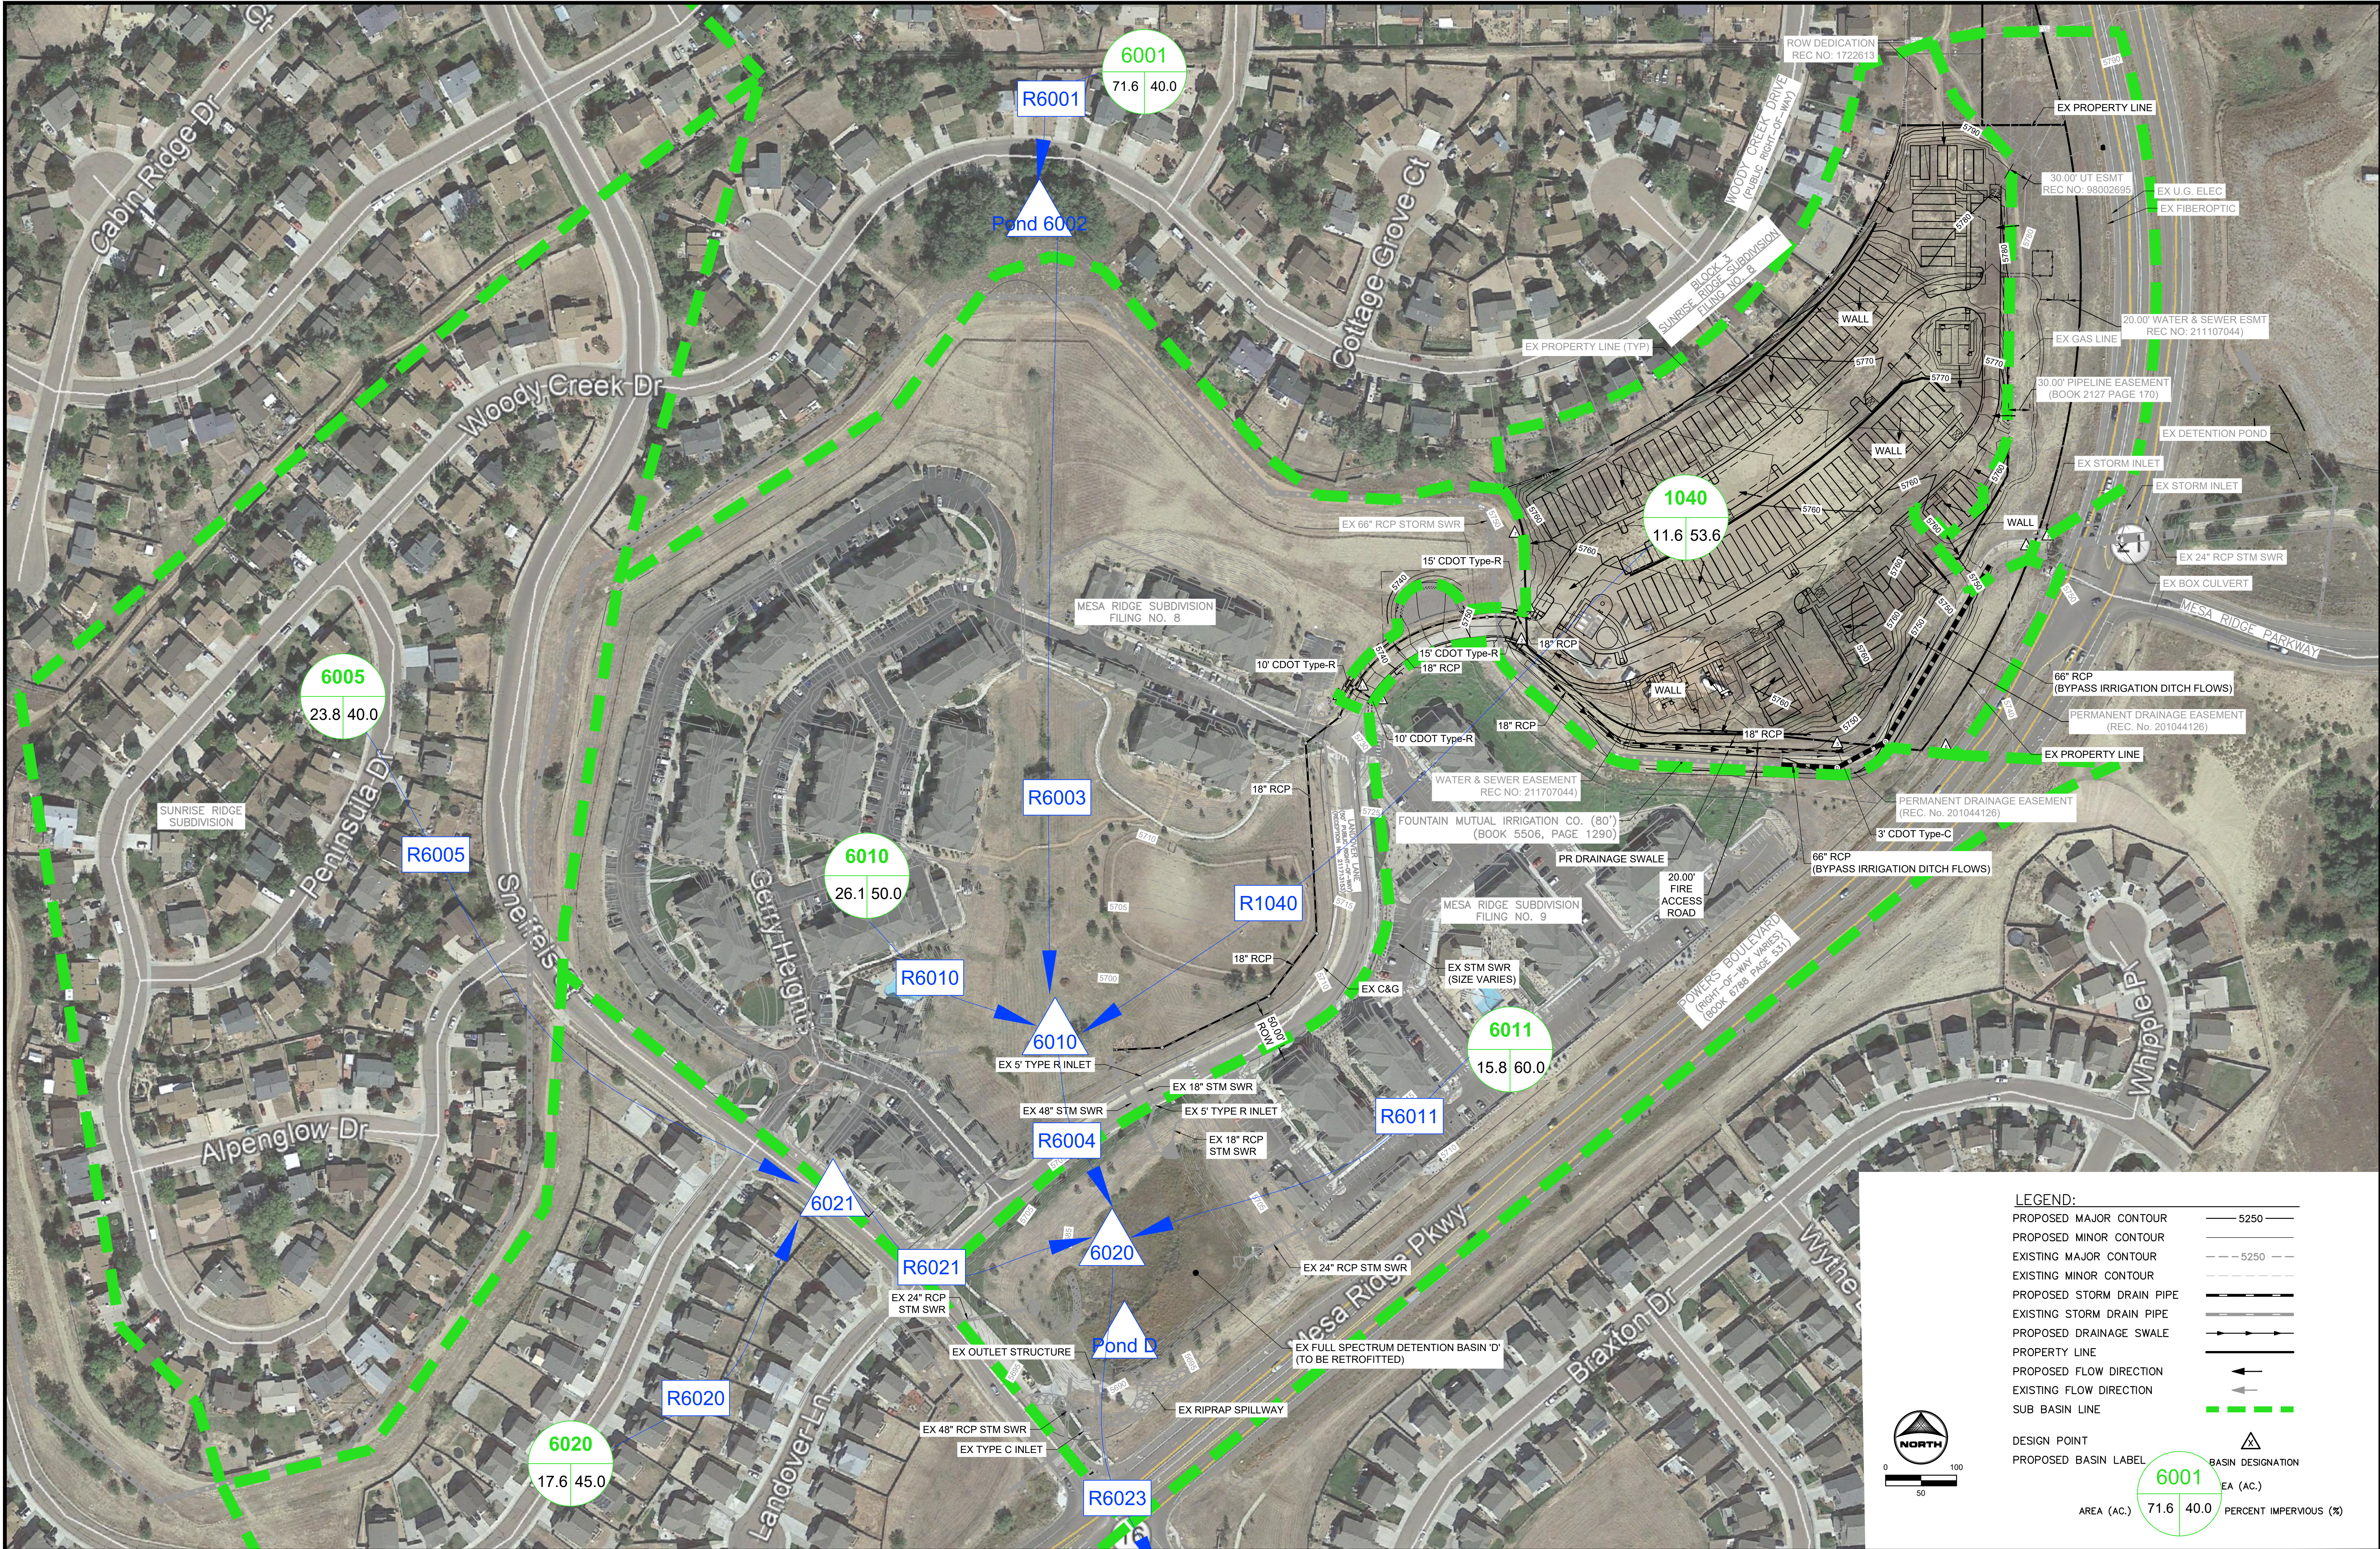

DRAWN BY: NQJ JOB DATE: 8/18/2021
APPROVED: KMH JOB NUMBER: 200541
CAD DATE: 8/18/2021
CAD FILE: J:\2020\200541\CAD\Drawings\CD\Drainage\Pr_Dm_Map_PondD

BAR IS ONE INCH ON
OFFICIAL DRAWINGS.
0" 1"
IF NOT ONE INCH,
ADJUST SCALE ACCORDINGLY.

| NO. | DATE | BY | REVISION DESCRIPTION |
|-----|------|----|----------------------|
| | | | |
| | | | |
| | | | |

HR GREEN - COLORADO SPRINGS
7222 COMMERCE CENTER DR SUITE 220
COLORADO SPRINGS CO 80919
PHONE: 719.300.4140 TOLL FREE: 800.728.7805
FAX: 844.273.1057 | HRGreen.com

THE COTTAGES AT MESA RIDGE
GOODWIN KNIGHT
EL PASO COUNTY, COLORADO

PRELIMINARY DRAINAGE REPORT
REGIONAL POND D MAP

SHEET
DRN
2

CUHP SUBCATCHMENTS - PROPOSED CONDITION

CUHP SUBCATCHMENTS

Columns with this color heading are for required user-input
 Columns with this color heading are for optional override values
 Columns with this color heading are for program-calculated values


| | | | | | | | | Maximum Depression Storage (Watershed inches) | | Horton's Infiltration Parameters | | | DCIA | Comment |
|----------------------|-------------------------|----------|----------------------------|----------------------------|----------------|---------------|---------------------------|--|------------|-------------------------------------|-------------------------------------|--------------------------|------------------------|--|
| Subcatchment Name | EPA SWMM Target Node | Raingage | Area (mi ²) | Length to Centroid (mi) | Length (mi) | Slope (ft/ft) | Percent Imperviousness | Pervious | Impervious | Initial Rate (in/hr) | Decay Coefficient (1/seconds) | Final Rate (in/hr) | Level 0, 1, or 2 | |
| 6001 | E6001 | 100-YR | 0.1120 | 0.2178 | 0.4356 | 0.0120 | 40.0 | 0.35 | 0.1 | 4.5 | 0.0018 | 0.6 | 0 | |
| 6005 | E6005 | 100-YR | 0.0362 | 0.0786 | 0.2235 | 0.0300 | 40.0 | 0.35 | 0.1 | 4.5 | 0.0018 | 0.6 | 0 | |
| 6010 | E6010 | 100-YR | 0.0433 | 0.1009 | 0.2216 | 0.0490 | 50.0 | 0.35 | 0.1 | 4.5 | 0.0018 | 0.6 | 0 | Updated imperviousness to include open space |
| 6011 | E6011 | 100-YR | 0.0267 | 0.1621 | 0.3136 | 0.0362 | 60.0 | 0.35 | 0.1 | 4.5 | 0.0018 | 0.6 | 0 | |
| 6020 | E6020 | 100-YR | 0.0300 | 0.1345 | 0.2083 | 0.0504 | 45.0 | 0.35 | 0.1 | 4.5 | 0.0018 | 0.6 | 0 | Updated to single-family imperviousness |
| 1040 | E1040 | 100-YR | 0.0181 | 0.0758 | 0.1894 | 0.0220 | 53.6 | 0.35 | 0.1 | 4.5 | 0.0018 | 0.6 | 0 | Updated for new size and imperviousness |

Summary of Unit Hydrograph Parameters Used By Program and Calculated Results (Version 2.0.1)

| Catchment Name/ID | User Comment for Catchment | Unit Hydrograph Parameters and Results | | | | | | | | | Excess Precip. | | Storm Hydrograph | | | |
|-------------------|--|--|-------|------------|-----------------|------------|-----------------|---------------------|------------|--------------|-----------------|---------------|---------------------|-----------------|---------------------|---------------------------------|
| | | CT | Cp | W50 (min.) | W50 Before Peak | W75 (min.) | W75 Before Peak | Time to Peak (min.) | Peak (cfs) | Volume (c.f) | Excess (inches) | Excess (c.f.) | Time to Peak (min.) | Peak Flow (cfs) | Total Volume (c.f.) | Runoff per Unit Area (cfs/acre) |
| 6,001 | | 0.094 | 0.178 | 23.1 | 3.45 | 12.0 | 2.44 | 5.7 | 146 | 260,198 | 2.09 | 542,819 | 40.0 | 173 | 542,806 | 2.41 |
| 6,005 | | 0.094 | 0.107 | 13.7 | 1.42 | 7.1 | 1.01 | 2.4 | 79 | 84,100 | 2.09 | 175,447 | 36.0 | 77 | 175,455 | 3.32 |
| 6,010 | Updated imperviousness to include open space | 0.089 | 0.131 | 10.5 | 1.36 | 5.5 | 0.96 | 2.3 | 123 | 100,595 | 2.22 | 223,481 | 35.0 | 110 | 223,473 | 3.96 |
| 6,011 | | 0.084 | 0.115 | 18.3 | 1.91 | 9.5 | 1.35 | 3.2 | 44 | 62,029 | 2.36 | 146,231 | 37.0 | 51 | 146,214 | 2.99 |
| 6,020 | Updated to single-family imperviousness | 0.091 | 0.105 | 15.0 | 1.51 | 7.8 | 1.07 | 2.5 | 60 | 69,696 | 2.15 | 150,108 | 36.0 | 62 | 150,075 | 3.21 |
| 1,040 | Updated for new size and imperviousness | 0.087 | 0.092 | 14.5 | 1.32 | 7.5 | 0.93 | 2.2 | 37 | 42,050 | 2.27 | 95,468 | 36.0 | 39 | 95,489 | 3.36 |

The Cottages at Mesa Ridge

01/01/2005 00:05:00

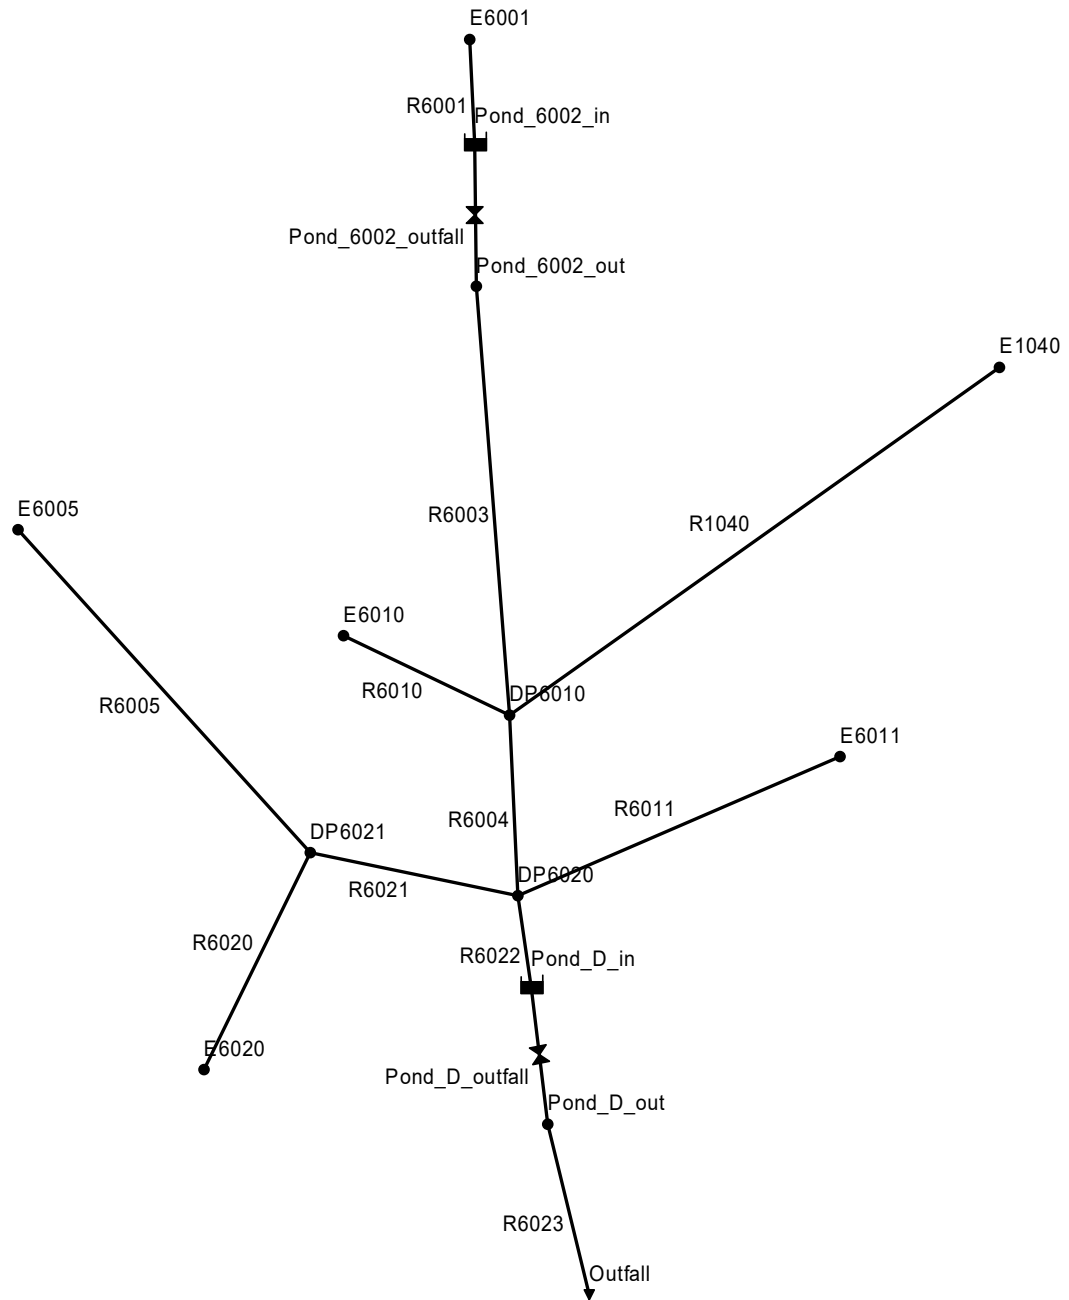

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.1 (Build 5.1.012)

WARNING 04: minimum elevation drop used for Conduit R6022

NOTE: The summary statistics displayed in this report are
based on results found at every computational time step,
not just on results from each reporting time step.

Analysis Options

Flow Units CFS

Process Models:

Rainfall/Runoff NO

RDII NO

Snowmelt NO

Groundwater NO

Flow Routing YES

Ponding Allowed NO

Water Quality NO

Flow Routing Method KINWAVE

Starting Date 01/01/2005 00:00:00

Ending Date 01/01/2005 12:00:00

Antecedent Dry Days 0.0

Report Time Step 00:05:00

Routing Time Step 60.00 sec

| | Volume acre-feet | Volume 10^6 gal |
|----------------------------|---------------------|--------------------|
| Flow Routing Continuity | | |
| Dry Weather Inflow | 0.000 | 0.000 |
| Wet Weather Inflow | 0.000 | 0.000 |
| Groundwater Inflow | 0.000 | 0.000 |
| RDII Inflow | 0.000 | 0.000 |
| External Inflow | 30.612 | 9.975 |
| External Outflow | 25.293 | 8.242 |
| Flooding Loss | 0.000 | 0.000 |
| Evaporation Loss | 0.000 | 0.000 |
| Exfiltration Loss | 0.000 | 0.000 |
| Initial Stored Volume | 0.000 | 0.000 |
| Final Stored Volume | 5.306 | 1.729 |
| Continuity Error (%) | 0.042 | |

Highest Flow Instability Indexes

All links are stable.

Routing Time Step Summary

Minimum Time Step : 60.00 sec

Average Time Step : 60.00 sec

Maximum Time Step : 60.00 sec

Percent in Steady State : 0.00

Average Iterations per Step : 1.13

Percent Not Converging : 0.00

Node Depth Summary

| Node | Type | Average Depth Feet | Maximum Depth Feet | Maximum HGL Feet | Time of Max Occurrence days hr:min | Reported Max Depth Feet |
|-------|----------|--------------------------|--------------------------|------------------------|--|-------------------------------|
| E6005 | JUNCTION | 0.14 | 1.79 | 5715.48 | 0 00:37 | 1.76 |
| E6010 | JUNCTION | 0.00 | 0.00 | 5693.19 | 0 00:00 | 0.00 |
| E6001 | JUNCTION | 0.00 | 0.00 | 5750.46 | 0 00:00 | 0.00 |
| E1040 | JUNCTION | 0.04 | 0.53 | 5732.80 | 0 00:37 | 0.53 |
| E6011 | JUNCTION | 0.00 | 0.00 | 5688.69 | 0 00:00 | 0.00 |
| E6020 | JUNCTION | 0.00 | 0.00 | 5691.39 | 0 00:00 | 0.00 |

The Cottages at Mesa Ridge
Preliminary Drainage Report
EPA SWMM Results – 100-year with pond modifications

| | | | | | | | |
|---------------|----------|------|------|---------|---|-------|------|
| DP6010 | JUNCTION | 0.48 | 3.14 | 5691.33 | 0 | 00:42 | 3.08 |
| DP6021 | JUNCTION | 0.18 | 2.13 | 5693.32 | 0 | 00:37 | 2.09 |
| DP6020 | JUNCTION | 0.48 | 3.14 | 5686.83 | 0 | 00:42 | 3.06 |
| Pond_D_out | JUNCTION | 0.18 | 1.06 | 5683.65 | 0 | 01:13 | 1.06 |
| Pond_6002_out | JUNCTION | 0.18 | 1.25 | 5749.71 | 0 | 00:59 | 1.24 |
| Outfall1 | OUTFALL | 0.18 | 1.06 | 5673.90 | 0 | 01:13 | 1.06 |
| Pond_6002_in | STORAGE | 4.90 | 9.61 | 5759.07 | 0 | 00:59 | 9.61 |
| Pond_D_in | STORAGE | 5.06 | 9.34 | 5693.03 | 0 | 01:13 | 9.32 |

Node Inflow Summary

| Node | Type | Maximum Lateral Inflow CFS | Maximum Total Inflow CFS | Time of Max Occurrence days hr:min | Lateral Inflow Volume 10^6 gal | Total Inflow Volume 10^6 gal | Flow Balance Error Percent |
|---------------|----------|-------------------------------------|-----------------------------------|--|---|---------------------------------------|-------------------------------------|
| E6005 | JUNCTION | 76.91 | 76.91 | 0 00:37 | 1.31 | 1.31 | 0.000 |
| E6010 | JUNCTION | 109.76 | 109.76 | 0 00:36 | 1.67 | 1.67 | 0.000 |
| E6001 | JUNCTION | 172.95 | 172.95 | 0 00:41 | 4.06 | 4.06 | 0.000 |
| E1040 | JUNCTION | 38.88 | 38.88 | 0 00:37 | 0.714 | 0.714 | -0.000 |
| E6011 | JUNCTION | 51.06 | 51.06 | 0 00:38 | 1.09 | 1.09 | 0.000 |
| E6020 | JUNCTION | 61.62 | 61.62 | 0 00:37 | 1.12 | 1.12 | 0.000 |
| DP6010 | JUNCTION | 0.00 | 231.62 | 0 00:42 | 0 | 6.26 | 0.000 |
| DP6021 | JUNCTION | 0.00 | 138.54 | 0 00:37 | 0 | 2.43 | 0.000 |
| DP6020 | JUNCTION | 0.00 | 412.18 | 0 00:41 | 0 | 9.79 | 0.000 |
| Pond_D_out | JUNCTION | 0.00 | 233.78 | 0 01:13 | 0 | 8.24 | 0.000 |
| Pond_6002_out | JUNCTION | 0.00 | 136.68 | 0 00:59 | 0 | 3.87 | 0.000 |
| Outfall1 | OUTFALL | 0.00 | 233.77 | 0 01:13 | 0 | 8.24 | 0.000 |
| Pond_6002_in | STORAGE | 0.00 | 172.95 | 0 00:41 | 0 | 4.06 | 0.152 |
| Pond_D_in | STORAGE | 0.00 | 412.18 | 0 00:41 | 0 | 9.79 | 0.048 |

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

| Storage Unit | Average Volume 1000 ft3 | Avg Pcnt Full | Evap Pcnt Loss | Exfil Pcnt Loss | Maximum Volume 1000 ft3 | Max Pcnt Full | Time of Max Occurrence days hr:min | Maximum Outflow CFS |
|--------------|-------------------------------|---------------------|----------------------|-----------------------|-------------------------------|---------------------|--|---------------------------|
| Pond_6002_in | 45.849 | 16 | 0 | 0 | 126.976 | 45 | 0 00:59 | 136.68 |
| Pond_D_in | 246.767 | 32 | 0 | 0 | 548.176 | 70 | 0 01:13 | 233.78 |

Outfall Loading Summary

| Outfall Node | Flow Freq Pcnt | Avg Flow CFS | Max Flow CFS | Total Volume 10^6 gal |
|--------------|----------------------|--------------------|--------------------|-----------------------------|
| Outfall1 | 97.92 | 26.05 | 233.77 | 8.242 |
| System | 97.92 | 26.05 | 233.77 | 8.242 |

The Cottages at Mesa Ridge
Preliminary Drainage Report
EPA SWMM Results – 100-year with pond modifications

Link Flow Summary

| Link | Type | Maximum Flow CFS | Time of Max Occurrence days hr:min | Maximum Veloc ft/sec | Max/ Full Flow | Max/ Full Depth |
|-------------------|---------|--------------------------|--|------------------------------|----------------------|-----------------------|
| R1040 | CONDUIT | 38.58 | 0 00:38 | 6.04 | 0.01 | 0.11 |
| R6003 | CONDUIT | 136.55 | 0 01:01 | 8.00 | 0.06 | 0.25 |
| R6004 | CONDUIT | 231.40 | 0 00:42 | 19.56 | 0.83 | 0.70 |
| R6005 | CONDUIT | 76.92 | 0 00:37 | 17.52 | 0.67 | 0.60 |
| R6011 | DUMMY | 51.06 | 0 00:38 | | | |
| R6010 | DUMMY | 109.76 | 0 00:36 | | | |
| R6021 | CONDUIT | 138.54 | 0 00:37 | 20.33 | 0.56 | 0.53 |
| R6020 | DUMMY | 61.62 | 0 00:37 | | | |
| R6001 | DUMMY | 172.95 | 0 00:41 | | | |
| R6022 | DUMMY | 412.18 | 0 00:41 | | | |
| R6023 | CONDUIT | 233.77 | 0 01:13 | 18.44 | 0.10 | 0.18 |
| Pond_6002_outfall | DUMMY | 136.68 | 0 00:59 | | | |
| Pond_D_outfall | DUMMY | 233.78 | 0 01:13 | | | |


Conduit Surcharge Summary

No conduits were surcharged.

Analysis begun on: Tue Aug 17 14:10:59 2021
Analysis ended on: Tue Aug 17 14:10:59 2021
Total elapsed time: < 1 sec

MHFD-Detention, Version 4.04 (February 2021)

Basin ID: Existing Pond D Sizing Confirmation



Location for 1-hr Rainfall Depths = User Input

Optional User Overrides

| | |
|------|-----------|
| | acre-feet |
| | acre-feet |
| 1.00 | inches |
| 1.28 | inches |
| 1.55 | inches |
| 1.97 | inches |
| 2.34 | inches |
| 2.74 | inches |
| 3.84 | inches |

| | | |
|--|-------|-----------|
| Zone 1 Volume (User Defined) = | 5.14 | acre-feet |
| Zone 2 Volume (User Defined - Zone 1) = | 0.32 | acre-feet |
| Zone 3 Volume (User Defined - Zones 1 & 2) = | 6.10 | acre-feet |
| Total Detention Basin Volume = | 11.57 | acre-feet |


[illegible]

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-DETENTION, Version 4.04 (February 2021)

Project: Mesa Ridge Cottages

Basin ID: Existing Pond D Sizing Confirmation

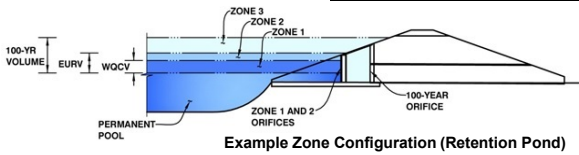

Example Zone Configuration (Retention Pond)

| | Estimated Stage (ft) | Estimated Volume (ac-ft) | Outlet Type |
|-------------------|----------------------|--------------------------|-------------------|
| Zone 1 (User) | 4.79 | 5.144 | Orifice Plate |
| Zone 2 (User) | 5.01 | 0.318 | Orifice Plate |
| Zone 3 (User) | 8.76 | 6.104 | Weir&Pipe (Rect.) |
| Total (all zones) | | 11.566 | |

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Calculated Parameters for Plate

Invert of Lowest Orifice = 0.00 ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = 4.46 ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = N/A inches
Orifice Plate: Orifice Area per Row = N/A inches

WQ Orifice Area per Row = N/A ft²
Elliptical Half-Width = N/A feet
Elliptical Slot Centroid = N/A feet
Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

| | Row 1 (required) | Row 2 (optional) | Row 3 (optional) | Row 4 (optional) | Row 5 (optional) | Row 6 (optional) | Row 7 (optional) | Row 8 (optional) |
|--------------------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|
| Stage of Orifice Centroid (ft) | 0.85 | 1.19 | 1.52 | 1.85 | 2.19 | 2.52 | 2.85 | 3.19 |
| Orifice Area (sq. inches) | 3.93 | 3.93 | 3.93 | 3.93 | 3.93 | 3.93 | 3.93 | 3.93 |

| | Row 9 (optional) | Row 10 (optional) | Row 11 (optional) | Row 12 (optional) | Row 13 (optional) | Row 14 (optional) | Row 15 (optional) | Row 16 (optional) |
|--------------------------------|------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|
| Stage of Orifice Centroid (ft) | | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| Orifice Area (sq. inches) | | | | | | | | |

User Input: Vertical Orifice (Circular or Rectangular)

Calculated Parameters for Vertical Orifice

Invert of Vertical Orifice = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter = Not Selected Not Selected inches

Vertical Orifice Area = Not Selected Not Selected ft²
Vertical Orifice Centroid = Not Selected Not Selected feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Gate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe)

Calculated Parameters for Overflow Weir

Overflow Weir Front Edge Height, H_o = Zone 3 Weir Not Selected ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length = 4.46 N/A feet
Overflow Weir Gate Slope = 12.00 N/A
Horiz. Length of Weir Sides = 3.00 N/A H:V
Overflow Gate Type = 6.00 N/A feet
Debris Clogging % = Close Mesh Gate N/A
 0% N/A %

Height of Gate Upper Edge, H_u = Zone 3 Weir Not Selected feet
Overflow Weir Slope Length = 6.46 N/A feet
Gate Open Area / 100-yr Orifice Area = 6.32 N/A
Overflow Gate Open Area w/o Debris = 3.34 N/A
Overflow Gate Open Area w/ Debris = 60.03 N/A ft²
 60.03 N/A ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

Depth to Invert of Outlet Pipe = Zone 3 Rectangular Not Selected ft (distance below basin bottom at Stage = 0 ft)
Rectangular Orifice Width = 1.21 N/A inches
Rectangular Orifice Height = 72.00 N/A inches
 36.00 inches

Outlet Orifice Area = Zone 3 Rectangular Not Selected ft²
Outlet Orifice Centroid = 18.00 N/A feet
Half-Central Angle of Restrictor Plate on Pipe = 1.50 N/A radians
 N/A N/A

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Calculated Parameters for Spillway

Spillway Invert Stage = 11.00 ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = 185.00 feet
Spillway End Slopes = 4.00 H:V
Freeboard above Max Water Surface = 0.40 feet

Spillway Design Flow Depth = 0.59 feet
Stage at Top of Freeboard = 11.99 feet
Basin Area at Top of Freeboard = 2.00 acres
Basin Volume at Top of Freeboard = 16.89 acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

| | WQCV | EURV | 2 Year | 5 Year | 10 Year | 25 Year | 50 Year | 100 Year | 500 Year |
|--|-------|-----------------|---------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| Design Storm Return Period = | N/A | N/A | 1.00 | 1.28 | 1.55 | 1.97 | 2.34 | 2.74 | 3.84 |
| One-Hour Rainfall Depth (in) = | N/A | N/A | 1.00 | 1.28 | 1.55 | 1.97 | 2.34 | 2.74 | 3.84 |
| CUHP Runoff Volume (acre-ft) = | 1.671 | 5.144 | 3.741 | 5.462 | 7.357 | 11.295 | 14.367 | 18.116 | 27.672 |
| User Override Inflow Hydrograph Volume (acre-ft) = | N/A | N/A | 3.741 | 7.663 | 7.357 | 11.295 | 14.367 | 29.508 | 27.672 |
| CUHP Predevelopment Peak Q (cfs) = | N/A | N/A | 1.1 | 11.3 | 25.6 | 67.8 | 94.1 | 127.9 | 209.2 |
| OPTIONAL Override Predevelopment Peak Q (cfs) = | N/A | N/A | | | | | | | |
| Predevelopment Unit Peak Flow, q (cfs/acre) = | N/A | N/A | 0.01 | 0.11 | 0.26 | 0.69 | 0.95 | 1.29 | 2.12 |
| Peak Inflow Q (cfs) = | N/A | N/A | 48.9 | 94.1 | 98.7 | 161.4 | 204.6 | 407.9 | 385.0 |
| Peak Outflow Q (cfs) = | 0.5 | 6.0 | 1.3 | 21.3 | 20.1 | 64.1 | 99.5 | 252.3 | 246.5 |
| Ratio Peak Outflow to Predevelopment Q = | N/A | N/A | N/A | 1.9 | 0.8 | 0.9 | 1.1 | 2.0 | 1.2 |
| Structure Controlling Flow = | Plate | Overflow Weir 1 | Plate | Overflow Weir 1 | Overflow Weir 1 | Overflow Weir 1 | Overflow Weir 1 | Outlet Plate 1 | Outlet Plate 1 |
| Max Velocity through Gate 1 (fps) = | N/A | 0.08 | N/A | 0.3 | 0.3 | 1.0 | 1.6 | 4.2 | 4.1 |
| Max Velocity through Gate 2 (fps) = | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Time to Drain 97% of Inflow Volume (hours) = | >120 | >120 | >120 | >120 | >120 | >120 | 116 | 71 | 74 |
| Time to Drain 99% of Inflow Volume (hours) = | >120 | >120 | >120 | >120 | >120 | >120 | >120 | >120 | >120 |
| Maximum Ponding Depth (ft) = | 2.22 | 4.79 | 3.66 | 5.27 | 5.24 | 6.08 | 6.57 | 8.76 | 8.38 |
| Area at Maximum Ponding Depth (acres) = | 1.23 | 1.49 | 1.35 | 1.52 | 1.52 | 1.58 | 1.61 | 1.72 | 1.69 |
| Maximum Volume Stored (acre-ft) = | 1.674 | 5.147 | 3.537 | 5.869 | 5.823 | 7.107 | 7.888 | 11.566 | 10.904 |
| Equivalent Elevation (ft) = | | 5687.19 | 5686.06 | 5687.67 | 5687.64 | 5688.48 | 5688.97 | 5691.16 | |
| Pond Bottom (ft) = | | 5682.400 | | | | | | | |

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

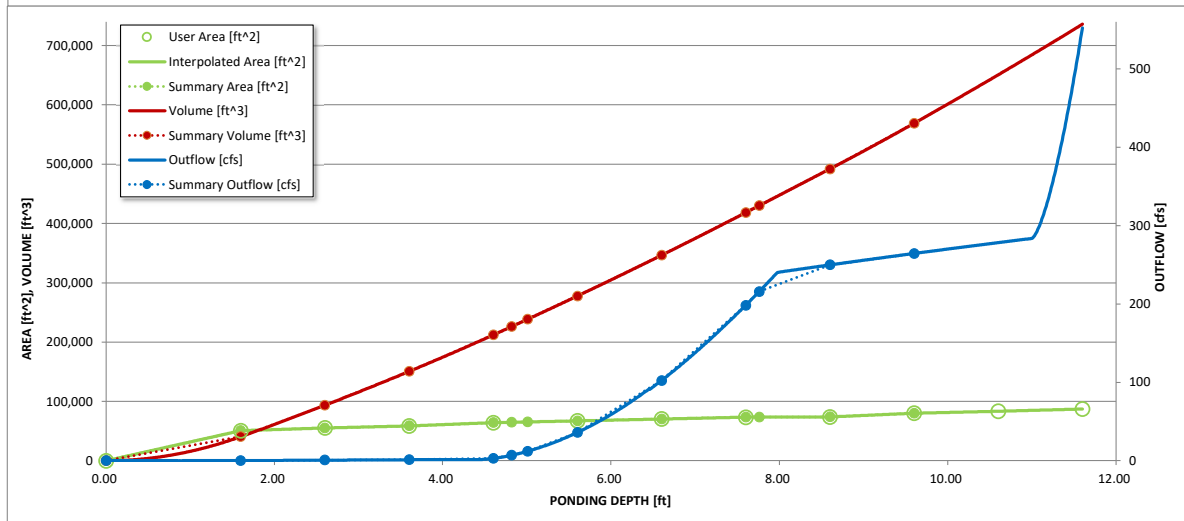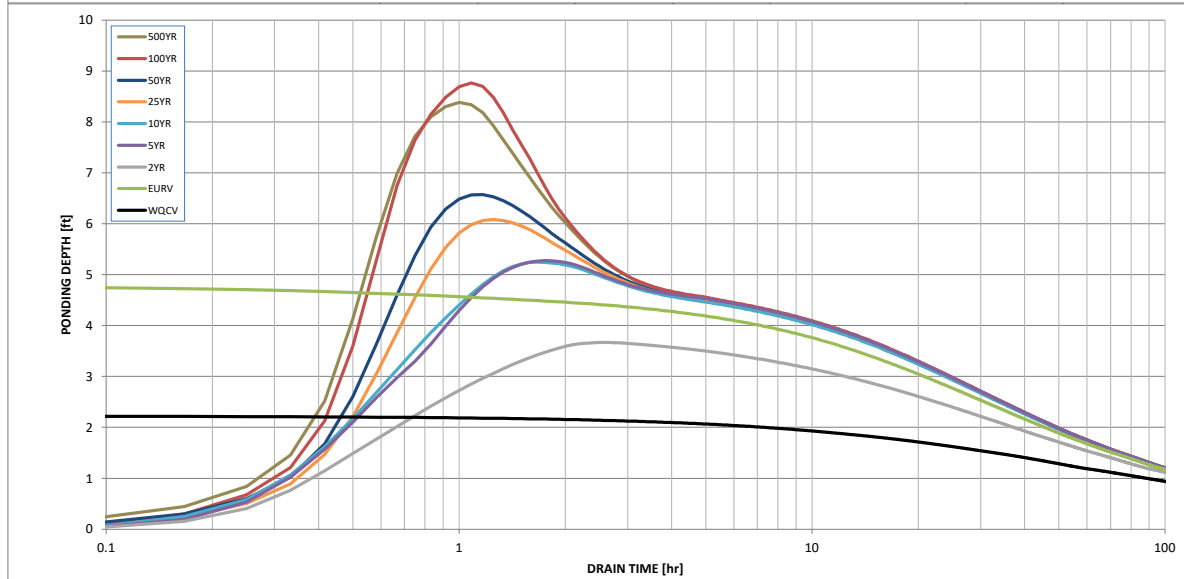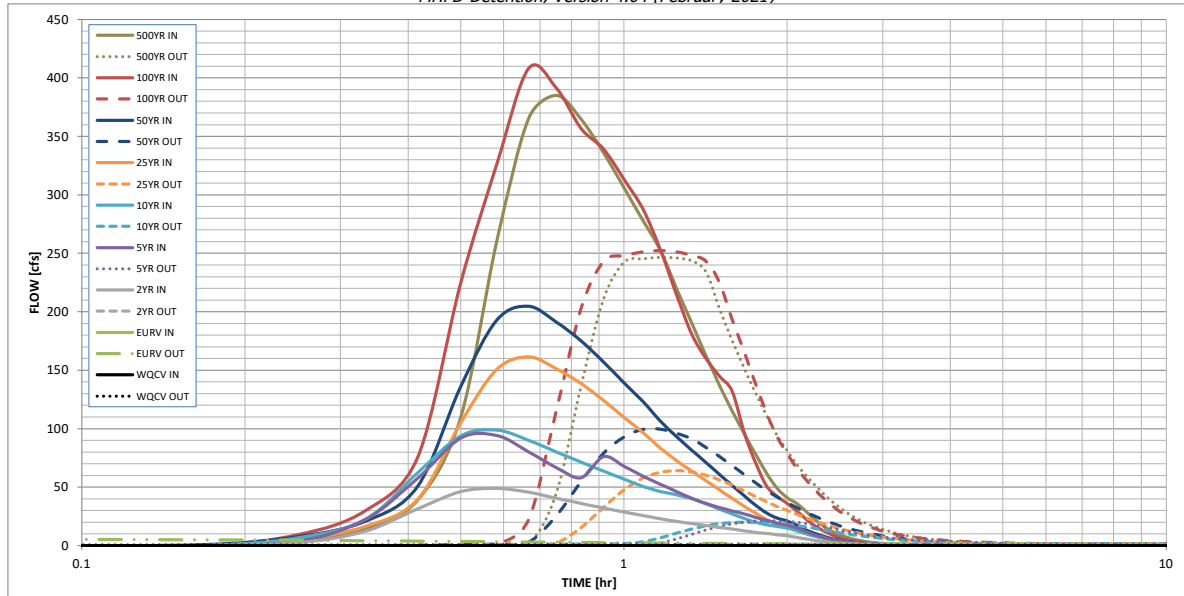

| S-A-V-D Chart Axis Override | X-axis | Left Y-Axis | Right Y-Axis |
|-----------------------------|--------|-------------|--------------|
| minimum bound | | | |
| maximum bound | | | |

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

| | SOURCE | CUHP | CUHP | CUHP | USER | CUHP | CUHP | CUHP | USER | CUHP |
|---------------|---------|------------|------------|--------------|--------------|---------------|---------------|---------------|----------------|----------------|
| Time Interval | TIME | WQCV [cfs] | EURV [cfs] | 2 Year [cfs] | 5 Year [cfs] | 10 Year [cfs] | 25 Year [cfs] | 50 Year [cfs] | 100 Year [cfs] | 500 Year [cfs] |
| 5.00 min | 0:00:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 0:05:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 0:10:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.70 | 0.00 | 3.09 |
| | 0:15:00 | 0.00 | 0.00 | 2.43 | 3.68 | 6.53 | 5.30 | 7.67 | 9.15 | 14.49 |
| | 0:20:00 | 0.00 | 0.00 | 12.29 | 22.29 | 22.28 | 16.37 | 20.88 | 29.83 | 38.98 |
| | 0:25:00 | 0.00 | 0.00 | 31.51 | 57.69 | 62.37 | 39.54 | 50.87 | 75.72 | 109.68 |
| | 0:30:00 | 0.00 | 0.00 | 46.16 | 91.81 | 93.76 | 105.05 | 136.02 | 224.60 | 260.83 |
| | 0:35:00 | 0.00 | 0.00 | 48.87 | 94.12 | 98.66 | 150.75 | 193.05 | 326.49 | 365.14 |
| | 0:40:00 | 0.00 | 0.00 | 45.61 | 80.25 | 90.11 | 161.36 | 204.64 | 407.93 | 385.04 |
| | 0:45:00 | 0.00 | 0.00 | 40.59 | 66.76 | 80.26 | 151.30 | 191.18 | 391.67 | 364.86 |
| | 0:50:00 | 0.00 | 0.00 | 35.99 | 58.09 | 71.47 | 138.64 | 175.05 | 356.83 | 336.13 |
| | 0:55:00 | 0.00 | 0.00 | 32.15 | 76.08 | 63.78 | 124.09 | 157.03 | 339.23 | 306.19 |
| | 1:00:00 | 0.00 | 0.00 | 28.77 | 67.82 | 56.86 | 109.79 | 139.37 | 313.47 | 278.30 |
| | 1:05:00 | 0.00 | 0.00 | 25.79 | 59.43 | 50.69 | 96.85 | 123.27 | 288.08 | 252.85 |
| | 1:10:00 | 0.00 | 0.00 | 23.01 | 52.50 | 46.30 | 83.54 | 106.61 | 253.54 | 220.13 |
| | 1:15:00 | 0.00 | 0.00 | 20.74 | 46.35 | 43.41 | 72.79 | 93.34 | 214.87 | 190.34 |
| | 1:20:00 | 0.00 | 0.00 | 18.86 | 40.52 | 40.10 | 63.61 | 81.64 | 180.99 | 162.52 |
| | 1:25:00 | 0.00 | 0.00 | 17.22 | 36.01 | 35.76 | 55.52 | 71.12 | 160.14 | 137.32 |
| | 1:30:00 | 0.00 | 0.00 | 15.66 | 32.65 | 31.27 | 47.74 | 60.92 | 145.01 | 115.32 |
| | 1:35:00 | 0.00 | 0.00 | 14.12 | 29.66 | 27.06 | 40.42 | 51.35 | 132.08 | 95.75 |
| | 1:40:00 | 0.00 | 0.00 | 12.62 | 27.15 | 23.26 | 33.66 | 42.55 | 96.68 | 77.90 |
| | 1:45:00 | 0.00 | 0.00 | 11.30 | 24.16 | 19.99 | 27.50 | 34.55 | 70.46 | 61.83 |
| | 1:50:00 | 0.00 | 0.00 | 10.40 | 21.51 | 17.80 | 22.22 | 27.75 | 50.89 | 48.98 |
| | 1:55:00 | 0.00 | 0.00 | 9.39 | 19.21 | 16.39 | 18.85 | 23.57 | 42.17 | 41.05 |
| | 2:00:00 | 0.00 | 0.00 | 8.38 | 17.41 | 15.05 | 16.81 | 20.99 | 36.08 | 35.98 |
| | 2:05:00 | 0.00 | 0.00 | 7.01 | 14.97 | 12.69 | 13.93 | 17.36 | 29.63 | 29.23 |
| | 2:10:00 | 0.00 | 0.00 | 5.61 | 11.89 | 10.11 | 10.84 | 13.48 | 22.74 | 22.26 |
| | 2:15:00 | 0.00 | 0.00 | 4.44 | 9.04 | 7.93 | 8.34 | 10.34 | 16.89 | 16.62 |
| | 2:20:00 | 0.00 | 0.00 | 3.50 | 7.02 | 6.20 | 6.43 | 7.94 | 12.61 | 12.36 |
| | 2:25:00 | 0.00 | 0.00 | 2.75 | 5.27 | 4.81 | 4.94 | 6.07 | 9.30 | 9.21 |
| | 2:30:00 | 0.00 | 0.00 | 2.14 | 4.09 | 3.67 | 3.78 | 4.62 | 6.83 | 6.99 |
| | 2:35:00 | 0.00 | 0.00 | 1.67 | 3.12 | 2.78 | 2.86 | 3.48 | 4.99 | 5.26 |
| | 2:40:00 | 0.00 | 0.00 | 1.28 | 2.39 | 2.10 | 2.16 | 2.62 | 3.71 | 4.01 |
| | 2:45:00 | 0.00 | 0.00 | 0.98 | 1.78 | 1.61 | 1.65 | 2.00 | 2.77 | 3.10 |
| | 2:50:00 | 0.00 | 0.00 | 0.72 | 1.41 | 1.20 | 1.25 | 1.51 | 2.08 | 2.33 |
| | 2:55:00 | 0.00 | 0.00 | 0.51 | 1.22 | 0.86 | 0.90 | 1.09 | 1.53 | 1.67 |
| | 3:00:00 | 0.00 | 0.00 | 0.34 | 1.11 | 0.58 | 0.61 | 0.74 | 1.24 | 1.12 |
| | 3:05:00 | 0.00 | 0.00 | 0.20 | 1.06 | 0.35 | 0.38 | 0.45 | 1.11 | 0.67 |
| | 3:10:00 | 0.00 | 0.00 | 0.10 | 1.03 | 0.18 | 0.20 | 0.24 | 1.05 | 0.34 |
| | 3:15:00 | 0.00 | 0.00 | 0.04 | 1.02 | 0.07 | 0.08 | 0.09 | 1.03 | 0.12 |
| | 3:20:00 | 0.00 | 0.00 | 0.01 | 1.02 | 0.01 | 0.01 | 0.01 | 1.02 | 0.00 |
| | 3:25:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.02 | 0.00 |
| | 3:30:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:35:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:40:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:45:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:50:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:55:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:00:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:05:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:10:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:15:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:20:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:25:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:30:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:35:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:40:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:45:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:50:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:55:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 5:00:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 5:05:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:10:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:15:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:20:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:25:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:30:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:35:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:40:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:45:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:50:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:55:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 6:00:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

Summary Stage-Area-Volume-Discharge Relationships


The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

[illegible]

MHFD-Detention, Version 4.04 (February 2021)

Basin ID: Existing Pond D Sizing Confirmation - with Structure Modifications



| | | |
|--|--------|-----------|
| Water Quality Capture Volume (WQCV) = | 1.671 | acre-feet |
| Excess Urban Runoff Volume (EURV) = | 5.144 | acre-feet |
| 2-yr Runoff Volume (P1 = 1 in.) = | 3.741 | acre-feet |
| 5-yr Runoff Volume (P1 = 1.28 in.) = | 5.462 | acre-feet |
| 10-yr Runoff Volume (P1 = 1.55 in.) = | 7.357 | acre-feet |
| 25-yr Runoff Volume (P1 = 1.97 in.) = | 11.295 | acre-feet |
| 50-yr Runoff Volume (P1 = 2.34 in.) = | 14.367 | acre-feet |
| 100-yr Runoff Volume (P1 = 2.74 in.) = | 18.116 | acre-feet |
| 500-yr Runoff Volume (P1 = 3.84 in.) = | 27.672 | acre-feet |
| Approximate 2-yr Detention Volume = | 3.247 | acre-feet |
| Approximate 5-yr Detention Volume = | 4.538 | acre-feet |
| Approximate 10-yr Detention Volume = | 6.263 | acre-feet |
| Approximate 25-yr Detention Volume = | 7.639 | acre-feet |
| Approximate 50-yr Detention Volume = | 8.436 | acre-feet |
| Approximate 100-yr Detention Volume = | 9.873 | acre-feet |

| | | |
|--|-------|-----------|
| Zone 1 Volume (User Defined) = | 5.14 | acre-feet |
| Zone 2 Volume (User Defined - Zone 1) = | 0.32 | acre-feet |
| Zone 3 Volume (User Defined - Zones 1 & 2) = | 7.04 | acre-feet |
| Total Detention Basin Volume = | 12.50 | acre-feet |

| | |
|------|-----------|
| | acre-feet |
| | acre-feet |
| 1.00 | inches |
| 1.28 | inches |
| 1.55 | inches |
| 1.97 | inches |
| 2.34 | inches |
| 2.74 | inches |
| 3.84 | inches |


8/17/2021, 2:17 PM

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

Project: Mesa Ridge Cottages

Basin ID: Existing Pond D Sizing Confirmation - with Structure Modifications

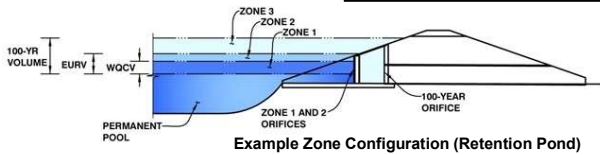

Example Zone Configuration (Retention Pond)

| | Estimated Stage (ft) | Estimated Volume (ac-ft) | Outlet Type |
|-------------------|----------------------|--------------------------|---------------------|
| Zone 1 (User) | 4.79 | 5.144 | Orifice Plate |
| Zone 2 (User) | 5.01 | 0.318 | Rectangular Orifice |
| Zone 3 (User) | 9.30 | 7.035 | Weir&Pipe (Rect.) |
| Total (all zones) | | 12.497 | |

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = N/A ft (distance below the filtration media surface)
Underdrain Orifice Diameter = N/A inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = N/A ft²
Underdrain Orifice Centroid = N/A feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Calculated Parameters for Plate

Invert of Lowest Orifice = 0.00 ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = 4.79 ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = 19.20 inches
Orifice Plate: Orifice Area per Row = 11.10 sq. inches (use rectangular openings)

WQ Orifice Area per Row = 7.708E-02 ft²
Elliptical Half-Width = N/A feet
Elliptical Slot Centroid = N/A feet
Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

| | Row 1 (required) | Row 2 (optional) | Row 3 (optional) | Row 4 (optional) | Row 5 (optional) | Row 6 (optional) | Row 7 (optional) | Row 8 (optional) |
|--------------------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|
| Stage of Orifice Centroid (ft) | 0.00 | 1.60 | 3.19 | | | | | |
| Orifice Area (sq. inches) | 11.10 | 11.10 | 11.10 | | | | | |

| | Row 9 (optional) | Row 10 (optional) | Row 11 (optional) | Row 12 (optional) | Row 13 (optional) | Row 14 (optional) | Row 15 (optional) | Row 16 (optional) |
|--------------------------------|------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|
| Stage of Orifice Centroid (ft) | | | | | | | | |
| Orifice Area (sq. inches) | | | | | | | | |

User Input: Vertical Orifice (Circular or Rectangular)

Calculated Parameters for Vertical Orifice

| | Zone 2 Rectangular | Not Selected | | | Zone 2 Rectangular | Not Selected | |
|---|--------------------|--------------|---|-----------------------------|--------------------|--------------|-----------------|
| Invert of Vertical Orifice = | 4.79 | N/A | ft (relative to basin bottom at Stage = 0 ft) | Vertical Orifice Area = | 1.00 | N/A | ft ² |
| Depth at top of Zone using Vertical Orifice = | 5.01 | N/A | ft (relative to basin bottom at Stage = 0 ft) | Vertical Orifice Centroid = | 0.08 | N/A | feet |
| Vertical Orifice Height = | 2.00 | N/A | inches | | | | |
| Vertical Orifice Width = | 72.00 | N/A | inches | | | | |

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe).

Calculated Parameters for Overflow Weir

| | Zone 3 Weir | Not Selected | | | Zone 3 Weir | Not Selected | |
|---|------------------|--------------|---|--|-------------|--------------|-----------------|
| Overflow Weir Front Edge Height, H _o = | 5.01 | N/A | ft (relative to basin bottom at Stage = 0 ft) | Height of Grate Upper Edge, H _g = | 7.01 | N/A | feet |
| Overflow Weir Front Edge Length = | 12.00 | N/A | feet | Overflow Weir Slope Length = | 6.32 | N/A | feet |
| Overflow Weir Grate Slope = | 3.00 | N/A | H:V | Grate Open Area / 100-yr Orifice Area = | 3.75 | N/A | |
| Horiz. Length of Weir Sides = | 6.00 | N/A | feet | Overflow Grate Open Area w/o Debris = | 60.03 | N/A | ft ² |
| Overflow Grate Type = | Close Mesh Grate | N/A | | Overflow Grate Open Area w/ Debris = | 60.03 | N/A | ft ² |
| Debris Clogging % = | 0% | N/A | % | | | | |

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

| | Zone 3 Rectangular | Not Selected | | | Zone 3 Rectangular | Not Selected | |
|----------------------------------|--------------------|--------------|--|--|--------------------|--------------|-----------------|
| Depth to Invert of Outlet Pipe = | 1.21 | N/A | ft (distance below basin bottom at Stage = 0 ft) | Outlet Orifice Area = | 16.00 | N/A | ft ² |
| Rectangular Orifice Width = | 72.00 | N/A | inches | Outlet Orifice Centroid = | 1.33 | N/A | feet |
| Rectangular Orifice Height = | 32.00 | N/A | inches | Half-Central Angle of Restrictor Plate on Pipe = | N/A | N/A | radians |

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Calculated Parameters for Spillway

| Spillway Invert Stage = | 11.00 | ft (relative to basin bottom at Stage = 0 ft) | Spillway Design Flow Depth = | 0.59 | feet | |
|-------------------------------------|--------|---|------------------------------------|-------|---------|--|
| Spillway Crest Length = | 185.00 | feet | Stage at Top of Freeboard = | 11.99 | feet | |
| Spillway End Slopes = | 4.00 | H:V | Basin Area at Top of Freeboard = | 2.00 | acres | |
| Freeboard above Max Water Surface = | 0.40 | feet | Basin Volume at Top of Freeboard = | 16.89 | acre-ft | |


Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

| | WQCV | EURV | 2 Year | 5 Year | 10 Year | 25 Year | 50 Year | 100 Year | 500 Year |
|--|----------|--------------------|---------|-----------------|-----------------|-----------------|-----------------|----------------|----------------|
| Design Storm Return Period = | N/A | N/A | 1.00 | 1.28 | 1.55 | 1.97 | 2.34 | 2.74 | 3.84 |
| One-Hour Rainfall Depth (in) = | 1.671 | 5.144 | 3.741 | 5.462 | 7.357 | 11.295 | 14.367 | 18.116 | 27.672 |
| CUHP Runoff Volume (acre-ft) = | N/A | N/A | 3.741 | 7.663 | 7.357 | 11.295 | 14.367 | 29.508 | 27.672 |
| User Override Inflow Hydrograph Volume (acre-ft) = | N/A | N/A | 1.1 | 11.3 | 25.6 | 67.8 | 94.1 | 127.9 | 209.2 |
| CUHP Predevelopment Peak Q (cfs) = | N/A | N/A | | | | | | | |
| OPTIONAL Override Predevelopment Peak Q (cfs) = | N/A | N/A | | | | | | | |
| Predevelopment Unit Peak Flow, q (cfs/acre) = | N/A | N/A | 0.01 | 0.11 | 0.26 | 0.69 | 0.95 | 1.29 | 2.12 |
| Peak Inflow Q (cfs) = | N/A | N/A | 48.9 | 94.1 | 98.7 | 161.4 | 204.6 | 407.9 | 385.0 |
| Peak Outflow Q (cfs) = | 0.8 | 1.9 | 1.5 | 16.0 | 14.5 | 55.9 | 91.5 | 233.4 | 228.2 |
| Ratio Peak Outflow to Predevelopment Q = | N/A | N/A | N/A | 1.4 | 0.6 | 0.8 | 1.0 | 1.8 | 1.1 |
| Structure Controlling Flow = | Plate | Vertical Orifice 1 | Plate | Overflow Weir 1 | Overflow Weir 1 | Overflow Weir 1 | Overflow Weir 1 | Outlet Plate 1 | Outlet Plate 1 |
| Max Velocity through Grate 1 (fps) = | N/A | N/A | N/A | 0.2 | 0.1 | 0.8 | 1.4 | 3.7 | 3.6 |
| Max Velocity through Grate 2 (fps) = | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Time to Drain 97% of Inflow Volume (hours) = | 41 | 69 | 62 | 72 | 71 | 67 | 64 | 52 | 53 |
| Time to Drain 99% of Inflow Volume (hours) = | 43 | 73 | 65 | 78 | 77 | 76 | 75 | 70 | 70 |
| Maximum Ponding Depth (ft) = | 2.22 | 4.79 | 3.63 | 5.54 | 5.50 | 6.40 | 6.91 | 9.30 | 8.90 |
| Area at Maximum Ponding Depth (acres) = | 1.23 | 1.49 | 1.35 | 1.54 | 1.54 | 1.60 | 1.64 | 1.79 | 1.74 |
| Maximum Volume Stored (acre-ft) = | 1.674 | 5.147 | 3.496 | 6.282 | 6.205 | 7.615 | 8.440 | 12.497 | 11.791 |
| Equivalent Elevation (ft) = | | 5687.19 | 5686.03 | 5687.94 | 5687.90 | 5688.80 | 5689.31 | 5691.70 | |
| Pond Bottom (ft) = | 5682.400 | | | | | | | | |

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

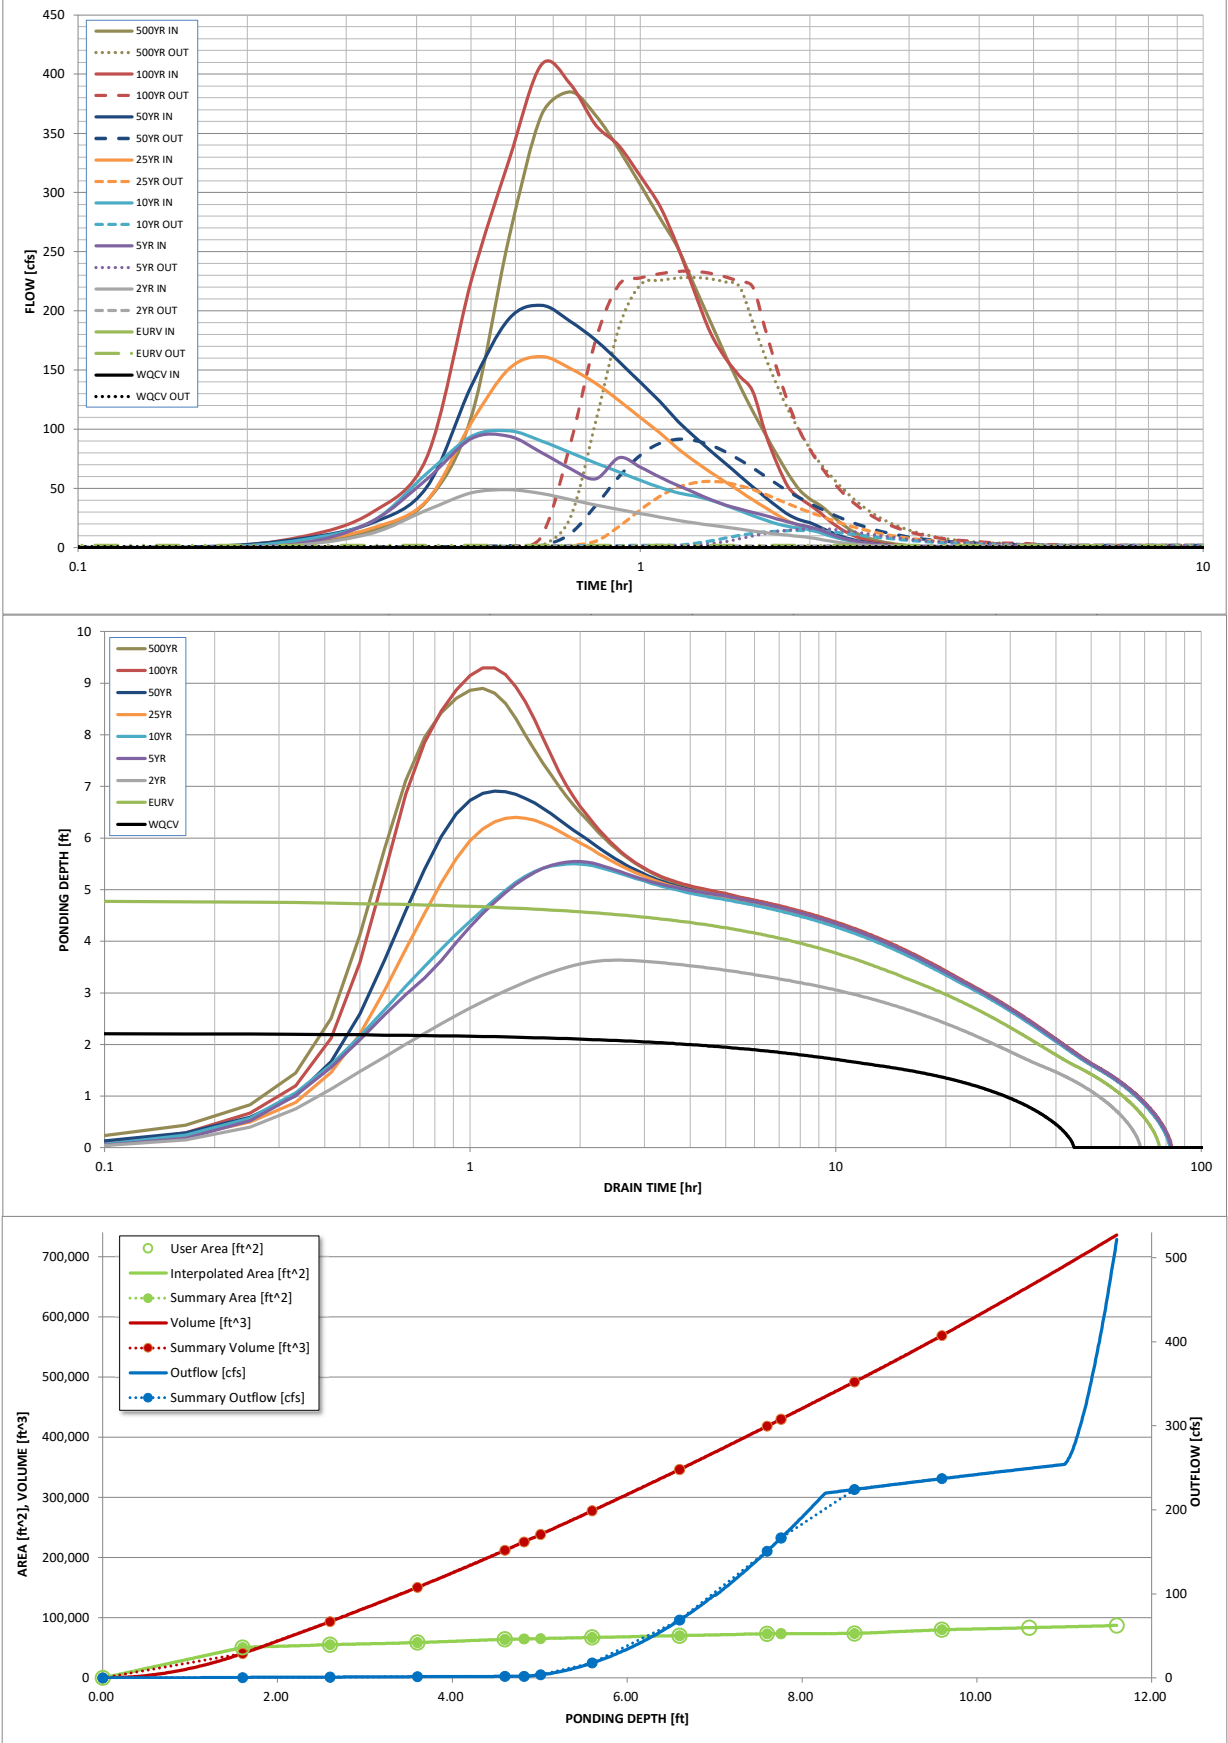

| | | | |
|-----------------------------|--------|-------------|--------------|
| S-A-V-D Chart Axis Override | X-axis | Left Y-Axis | Right Y-Axis |
| minimum bound | | | |
| maximum bound | | | |

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename:

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

| | SOURCE | CUHP | CUHP | CUHP | USER | CUHP | CUHP | CUHP | USER | CUHP |
|---------------|---------|------------|------------|--------------|--------------|---------------|---------------|---------------|----------------|----------------|
| Time Interval | TIME | WQCV [cfs] | EURV [cfs] | 2 Year [cfs] | 5 Year [cfs] | 10 Year [cfs] | 25 Year [cfs] | 50 Year [cfs] | 100 Year [cfs] | 500 Year [cfs] |
| 5.00 min | 0:00:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 0:05:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 0:10:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.70 | 0.00 | 3.09 |
| | 0:15:00 | 0.00 | 0.00 | 2.43 | 3.68 | 6.53 | 5.30 | 7.67 | 9.15 | 14.49 |
| | 0:20:00 | 0.00 | 0.00 | 12.29 | 22.29 | 22.28 | 16.37 | 20.88 | 29.83 | 38.98 |
| | 0:25:00 | 0.00 | 0.00 | 31.51 | 57.69 | 62.37 | 39.54 | 50.87 | 75.72 | 109.68 |
| | 0:30:00 | 0.00 | 0.00 | 46.16 | 91.81 | 93.76 | 105.05 | 136.02 | 224.60 | 260.83 |
| | 0:35:00 | 0.00 | 0.00 | 48.87 | 94.12 | 98.66 | 150.75 | 193.05 | 326.49 | 365.14 |
| | 0:40:00 | 0.00 | 0.00 | 45.61 | 80.25 | 90.11 | 161.36 | 204.64 | 407.93 | 385.04 |
| | 0:45:00 | 0.00 | 0.00 | 40.59 | 66.76 | 80.26 | 151.30 | 191.18 | 391.67 | 364.86 |
| | 0:50:00 | 0.00 | 0.00 | 35.99 | 58.09 | 71.47 | 138.64 | 175.05 | 356.83 | 336.13 |
| | 0:55:00 | 0.00 | 0.00 | 32.15 | 76.08 | 63.78 | 124.09 | 157.03 | 339.23 | 306.19 |
| | 1:00:00 | 0.00 | 0.00 | 28.77 | 67.82 | 56.86 | 109.79 | 139.37 | 313.47 | 278.30 |
| | 1:05:00 | 0.00 | 0.00 | 25.79 | 59.43 | 50.69 | 96.85 | 123.27 | 288.08 | 252.85 |
| | 1:10:00 | 0.00 | 0.00 | 23.01 | 52.50 | 46.30 | 83.54 | 106.61 | 253.54 | 220.13 |
| | 1:15:00 | 0.00 | 0.00 | 20.74 | 46.35 | 43.41 | 72.79 | 93.34 | 214.87 | 190.34 |
| | 1:20:00 | 0.00 | 0.00 | 18.86 | 40.52 | 40.10 | 63.61 | 81.64 | 180.99 | 162.52 |
| | 1:25:00 | 0.00 | 0.00 | 17.22 | 36.01 | 35.76 | 55.52 | 71.12 | 160.14 | 137.32 |
| | 1:30:00 | 0.00 | 0.00 | 15.66 | 32.65 | 31.27 | 47.74 | 60.92 | 145.01 | 115.32 |
| | 1:35:00 | 0.00 | 0.00 | 14.12 | 29.66 | 27.06 | 40.42 | 51.35 | 132.08 | 95.75 |
| | 1:40:00 | 0.00 | 0.00 | 12.62 | 27.15 | 23.26 | 33.66 | 42.55 | 96.68 | 77.90 |
| | 1:45:00 | 0.00 | 0.00 | 11.30 | 24.16 | 19.99 | 27.50 | 34.55 | 70.46 | 61.83 |
| | 1:50:00 | 0.00 | 0.00 | 10.40 | 21.51 | 17.80 | 22.22 | 27.75 | 50.89 | 48.98 |
| | 1:55:00 | 0.00 | 0.00 | 9.39 | 19.21 | 16.39 | 18.85 | 23.57 | 42.17 | 41.05 |
| | 2:00:00 | 0.00 | 0.00 | 8.38 | 17.41 | 15.05 | 16.81 | 20.99 | 36.08 | 35.98 |
| | 2:05:00 | 0.00 | 0.00 | 7.01 | 14.97 | 12.69 | 13.93 | 17.36 | 29.63 | 29.23 |
| | 2:10:00 | 0.00 | 0.00 | 5.61 | 11.89 | 10.11 | 10.84 | 13.48 | 22.74 | 22.26 |
| | 2:15:00 | 0.00 | 0.00 | 4.44 | 9.04 | 7.93 | 8.34 | 10.34 | 16.89 | 16.62 |
| | 2:20:00 | 0.00 | 0.00 | 3.50 | 7.02 | 6.20 | 6.43 | 7.94 | 12.61 | 12.36 |
| | 2:25:00 | 0.00 | 0.00 | 2.75 | 5.27 | 4.81 | 4.94 | 6.07 | 9.30 | 9.21 |
| | 2:30:00 | 0.00 | 0.00 | 2.14 | 4.09 | 3.67 | 3.78 | 4.62 | 6.83 | 6.99 |
| | 2:35:00 | 0.00 | 0.00 | 1.67 | 3.12 | 2.78 | 2.86 | 3.48 | 4.99 | 5.26 |
| | 2:40:00 | 0.00 | 0.00 | 1.28 | 2.39 | 2.10 | 2.16 | 2.62 | 3.71 | 4.01 |
| | 2:45:00 | 0.00 | 0.00 | 0.98 | 1.78 | 1.61 | 1.65 | 2.00 | 2.77 | 3.10 |
| | 2:50:00 | 0.00 | 0.00 | 0.72 | 1.41 | 1.20 | 1.25 | 1.51 | 2.08 | 2.33 |
| | 2:55:00 | 0.00 | 0.00 | 0.51 | 1.22 | 0.86 | 0.90 | 1.09 | 1.53 | 1.67 |
| | 3:00:00 | 0.00 | 0.00 | 0.34 | 1.11 | 0.58 | 0.61 | 0.74 | 1.24 | 1.12 |
| | 3:05:00 | 0.00 | 0.00 | 0.20 | 1.06 | 0.35 | 0.38 | 0.45 | 1.11 | 0.67 |
| | 3:10:00 | 0.00 | 0.00 | 0.10 | 1.03 | 0.18 | 0.20 | 0.24 | 1.05 | 0.34 |
| | 3:15:00 | 0.00 | 0.00 | 0.04 | 1.02 | 0.07 | 0.08 | 0.09 | 1.03 | 0.12 |
| | 3:20:00 | 0.00 | 0.00 | 0.01 | 1.02 | 0.01 | 0.01 | 0.01 | 1.02 | 0.00 |
| | 3:25:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.02 | 0.00 |
| | 3:30:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:35:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:40:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:45:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:50:00 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 | 0.00 | 0.00 | 1.01 | 0.00 |
| | 3:55:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:00:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:05:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:10:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:15:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:20:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:25:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:30:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:35:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:40:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:45:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:50:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 4:55:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 5:00:00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 | 0.00 | 0.00 | 1.00 | 0.00 |
| | 5:05:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:10:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:15:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:20:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:25:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:30:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:35:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:40:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:45:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:50:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 5:55:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| | 6:00:00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

Summary Stage-Area-Volume-Discharge Relationships

The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

[illegible]

For best results, include the stages of all grade slope changes (e.g. ISV and Floor) from the S-A-V table on Sheet 'Basin'.

Also include the inverts of all outlets (e.g. vertical orifice, overflow grate, and spillway, where applicable).

APPENDIX E – REFERENCE MATERIAL

**Mesa Ridge Development
Master Development Drainage Plan Update**


Fountain, Colorado

Prepared for:
Nor'wood Development
111 South Tejon Suite 222
Colorado Springs, Colorado 80903

Prepared by:
Kiowa
Engineering Corporation

1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342

Kiowa Project No. 11045
January 15, 2013

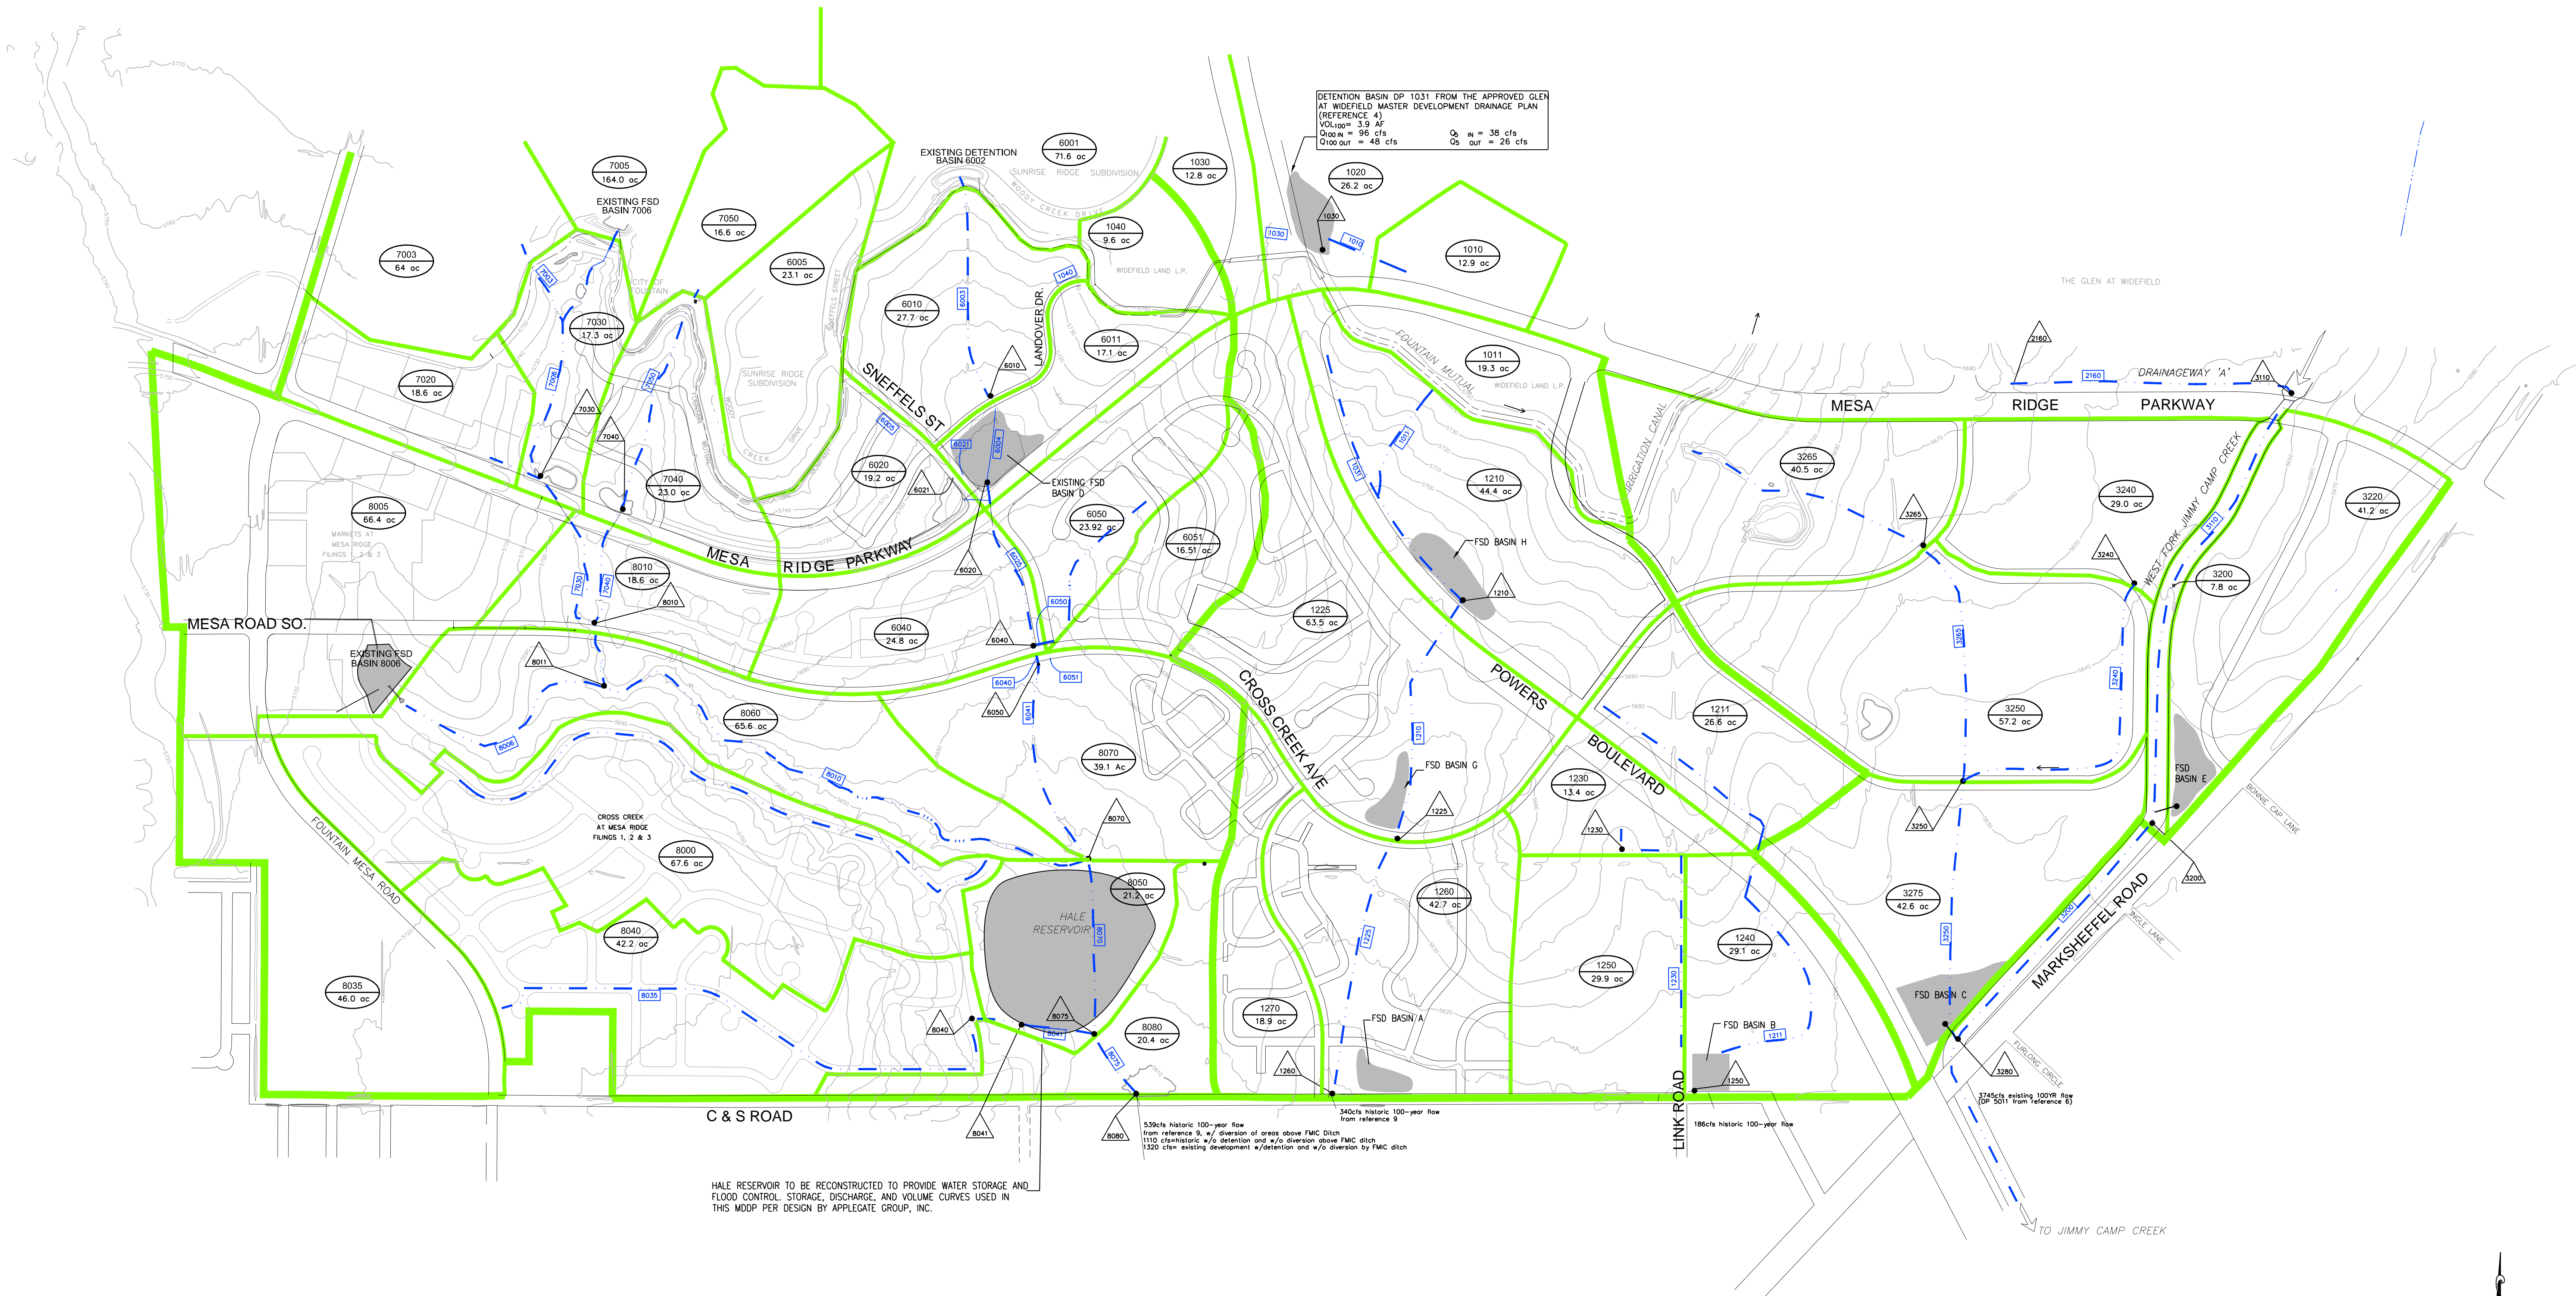

| SUMMARY OF PROPOSED FSD BASIN DATA (24-HOUR STORM) | | | |
|--|-----------|---------------------------------------|-----------|
| PROPOSED FS DETENTION BASIN A | | PROPOSED FS DETENTION BASIN B | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 69 cfs | 187 cfs | IN 102 cfs | 297 cfs |
| OUT 9 cfs | 52 cfs | OUT 13 cfs | 91 cfs |
| 100 yr VOLUME= 6.8 ac-ft | | 100 yr VOLUME= 8.4 ac-ft | |
| EURV VOLUME= 3.1 ac-ft | | EURV VOLUME= 3.1 ac-ft | |
| PROPOSED FS DETENTION BASIN C | | AS-BUILT FS DETENTION BASIN D | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 158 cfs | 490 cfs | IN 109 cfs | 375 cfs |
| OUT 9 cfs | 145 cfs | OUT 24 cfs | 233 cfs |
| 100 yr VOLUME= 14.8 ac-ft | | 100 yr VOLUME= 8.0 ac-ft | |
| EURV VOLUME= 8.3 ac-ft | | 5 yr VOLUME= 4.1 ac-ft | |
| PROPOSED FS DETENTION BASIN E | | RECONSTRUCTED DAM & RESERVOIR BASIN F | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 41 cfs | 120 cfs | IN 540 cfs | 1540 cfs |
| OUT 5 cfs | 24 cfs | OUT 7 cfs | 255 cfs |
| 100 yr VOLUME= 3.9 ac-ft | | 100 yr VOLUME= 95.9 ac-ft | |
| EURV VOLUME= 1.3 ac-ft | | 5 yr VOLUME= 50.0 ac-ft | |
| PROPOSED FS DETENTION BASIN G | | PROPOSED FS DETENTION BASIN H | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 74 cfs | 216 cfs | IN 161 cfs | 323 cfs |
| OUT 10 cfs | 51 cfs | OUT 23 cfs | 56 cfs |
| 100 yr VOLUME= 6.6 ac-ft | | 100 yr VOLUME= 13.2 ac-ft | |
| EURV VOLUME= 2.2 ac-ft | | EURV VOLUME= 2.5 ac-ft | |

| SUMMARY OF DESIGN POINT DISCHARGES (24-HOUR STORM WITH FSD) | | | | |
|---|--------------------------------|-------------------|---------|----------|
| DESIGN POINT | LOCATION | DRAINAGE AREA | 5 Year | 100 Year |
| DP 6010 | AT LANDOVER | 108.9 ac 0.18 sm | 43 cfs | 196 cfs |
| DP 6020 | INFLOW TO DETENTION BASIN D | 168.3 ac 0.27 sm | 109 cfs | 375 cfs |
| DB 6020 | OUTFLOW FROM DETENTION BASIN D | 168.3 ac 0.27 sm | 24 cfs | 233 cfs |
| DP 6040 | U/S CROSS CREEK | 217.0 ac 0.35 sm | 74 cfs | 334 cfs |
| DP 6050 | D/S CROSS CREEK AVE | 233.5 ac 0.37 sm | 92 cfs | 358 cfs |
| DP 7030 | AT OUTLET OF BASIN 7030 | 263.9 ac 0.41 sm | 183 cfs | 420 cfs |
| DP 7040 | AT OUTLET OF BASIN 7040 | 39.6 ac 0.06 sm | 30 cfs | 110 cfs |
| DP 8010 | AT OUTLET OF BASIN 8010 | 322.1 ac 0.50 sm | 241 cfs | 603 cfs |
| DP 8070 | U/S OF HAILE RESERVOIR | 726.7 ac 1.15 sm | 446 cfs | 1259 cfs |
| DP 8075 | INFLOW TO HAILE RESERVOIR | 908.8 ac 1.42 sm | 540 cfs | 1540 cfs |
| DB 8075 | OUTFLOW FROM HAILE RESERVOIR | 908.8 ac 1.42 sm | 7 cfs | 255 cfs |
| DP 8080 | C&S ROAD | 928 ac 1.45 sm | 13 cfs | 257 cfs |
| DP 1031 | D/S POWERS BOULEVARD | 51.0 ac 0.08 sm | 28 cfs | 55 cfs |
| DP 1211 | INFLOW TO DET. BASIN H | 108.8 ac 0.17 sm | 161 cfs | 323 cfs |
| DP 1210 | OUTFLOW FROM DET. BASIN H | 108.8 ac 0.17 sm | 23 cfs | 36 cfs |
| SB 1225 | INFLOW TO DETENTION BASIN G | 70.4 ac 0.11 sm | 74 cfs | 216 cfs |
| DP 1225 | AT CROSS CREEK AVENUE | 185.6 ac 0.29 sm | 33 cfs | 104 cfs |
| DP 1250 | INFLOW TO DETENTION BASIN B | 96.0 ac 0.15 sm | 102 cfs | 297 cfs |
| DB 1250 | OUTFLOW FROM DETENTION BASIN B | 96.0 ac 0.15 sm | 13 cfs | 91 cfs |
| DP 1265 | INFLOW TO DETENTION BASIN A | 64 ac 0.10 sm | 69 cfs | 187 cfs |
| DP 1260 | AT C & S ROAD | 34.3 ac 0.08 sm | 41 cfs | 156 cfs |
| DP 2160 | DESIGN POINT 2160 | 448 ac 0.70 sm | 188 cfs | 640 cfs |
| DP 3110 | AT MESA RIDGE PARKWAY | 2163.2 ac 3.38 sm | 766 cfs | 3095 cfs |
| DP 3200 | DESIGN POINT 3200 | 2208 ac 3.44 sm | 764 cfs | 3089 cfs |
| DP 3250 | AT COLLECTOR ROAD | 126.7 ac 0.20 sm | 130 cfs | 380 cfs |
| DP 3265 | AT OUTLET OF BASIN 3265 | 40.5 ac 0.06 sm | 52 cfs | 135 cfs |
| DP 3275 | INFLOW TO DET. BASIN C | 172.8 ac 0.27 sm | 158 cfs | 490 cfs |
| DB 3280 | OUTFLOW FROM DETENTION BASIN C | 172.8 ac 0.27 sm | 9 cfs | 145 cfs |
| DP 3280 | AT MARKSHEFFEL ROAD | 2381.0 ac 3.72 sm | 772 cfs | 3215 cfs |

| LEGEND | |
|--------|----------------------------|
| | DRAINAGE BASIN DESIGNATION |
| | DRAINAGE BASIN AREA |
| | DESIGN POINT |
| | DRAINAGE BASIN BOUNDARY |
| | FLOW DIRECTION |
| | ROUTING ELEMENT |

| SUMMARY OF HISTORIC DISCHARGES | | | |
|--------------------------------|--|---------|----------|
| DESIGN POINT | LOCATION | 5 Year | 100 Year |
| 3280 | W/ JIMMY CAMP CREEK @ MARKSHEFFEL ROAD | 992 cfs | 3745 cfs |
| 1250 | @ C & S ROAD | 35 cfs | 186 cfs |
| 1260 | @ C & S ROAD | 48 cfs | 340 cfs |
| 8080 (1) | @ C & S ROAD | 152 cfs | 1110 cfs |

(1) AREA ABOVE FOUNTAIN MUTUAL IRRIGATION CANAL ASSUMED TRIBUTARY TO THIS DESIGN POINT. FMC CANAL ASSUMED TO CONVEY IRRIGATION FLOW ONLY.

NOTE: TOPOGRAPHY USED IN THIS MDDP MAY NOT REFLECT THE EXISTING CONDITIONS FOR ALL AREAS OF THE DRAINAGE BASINS.


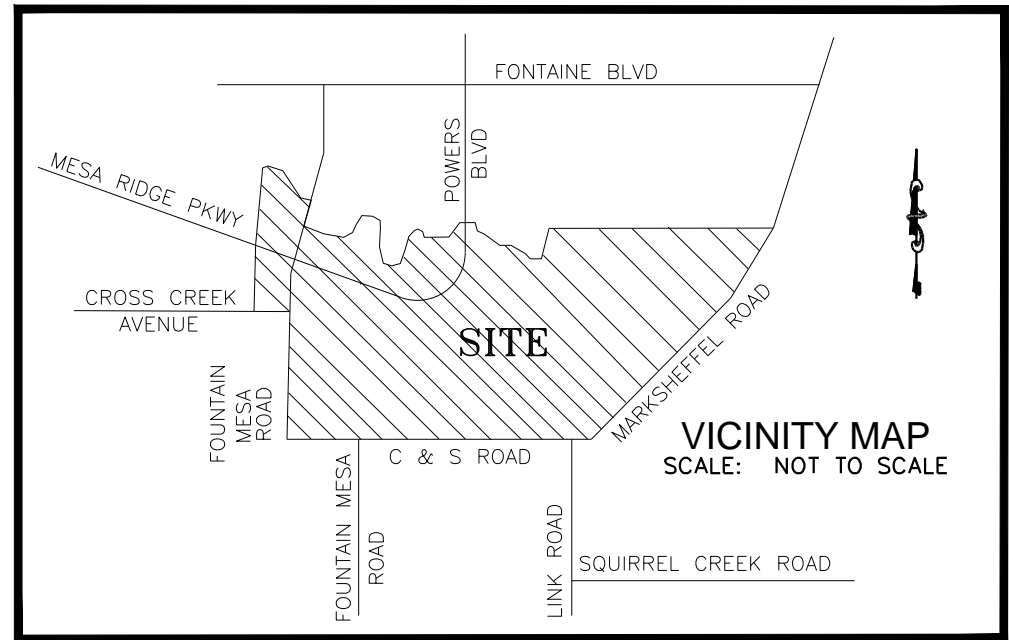


EXHIBIT 1 MESA RIDGE DEVELOPMENT MASTER DEVELOPMENT DRAINAGE PLAN UPDATE HYDROLOGIC SUB-BASIN MAP DEVELOPED WITH EXISTING & PROPOSED DETENTION FOUNTAIN, COLORADO

Kiowa Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado
80904 - 4208
(719) 630-7342

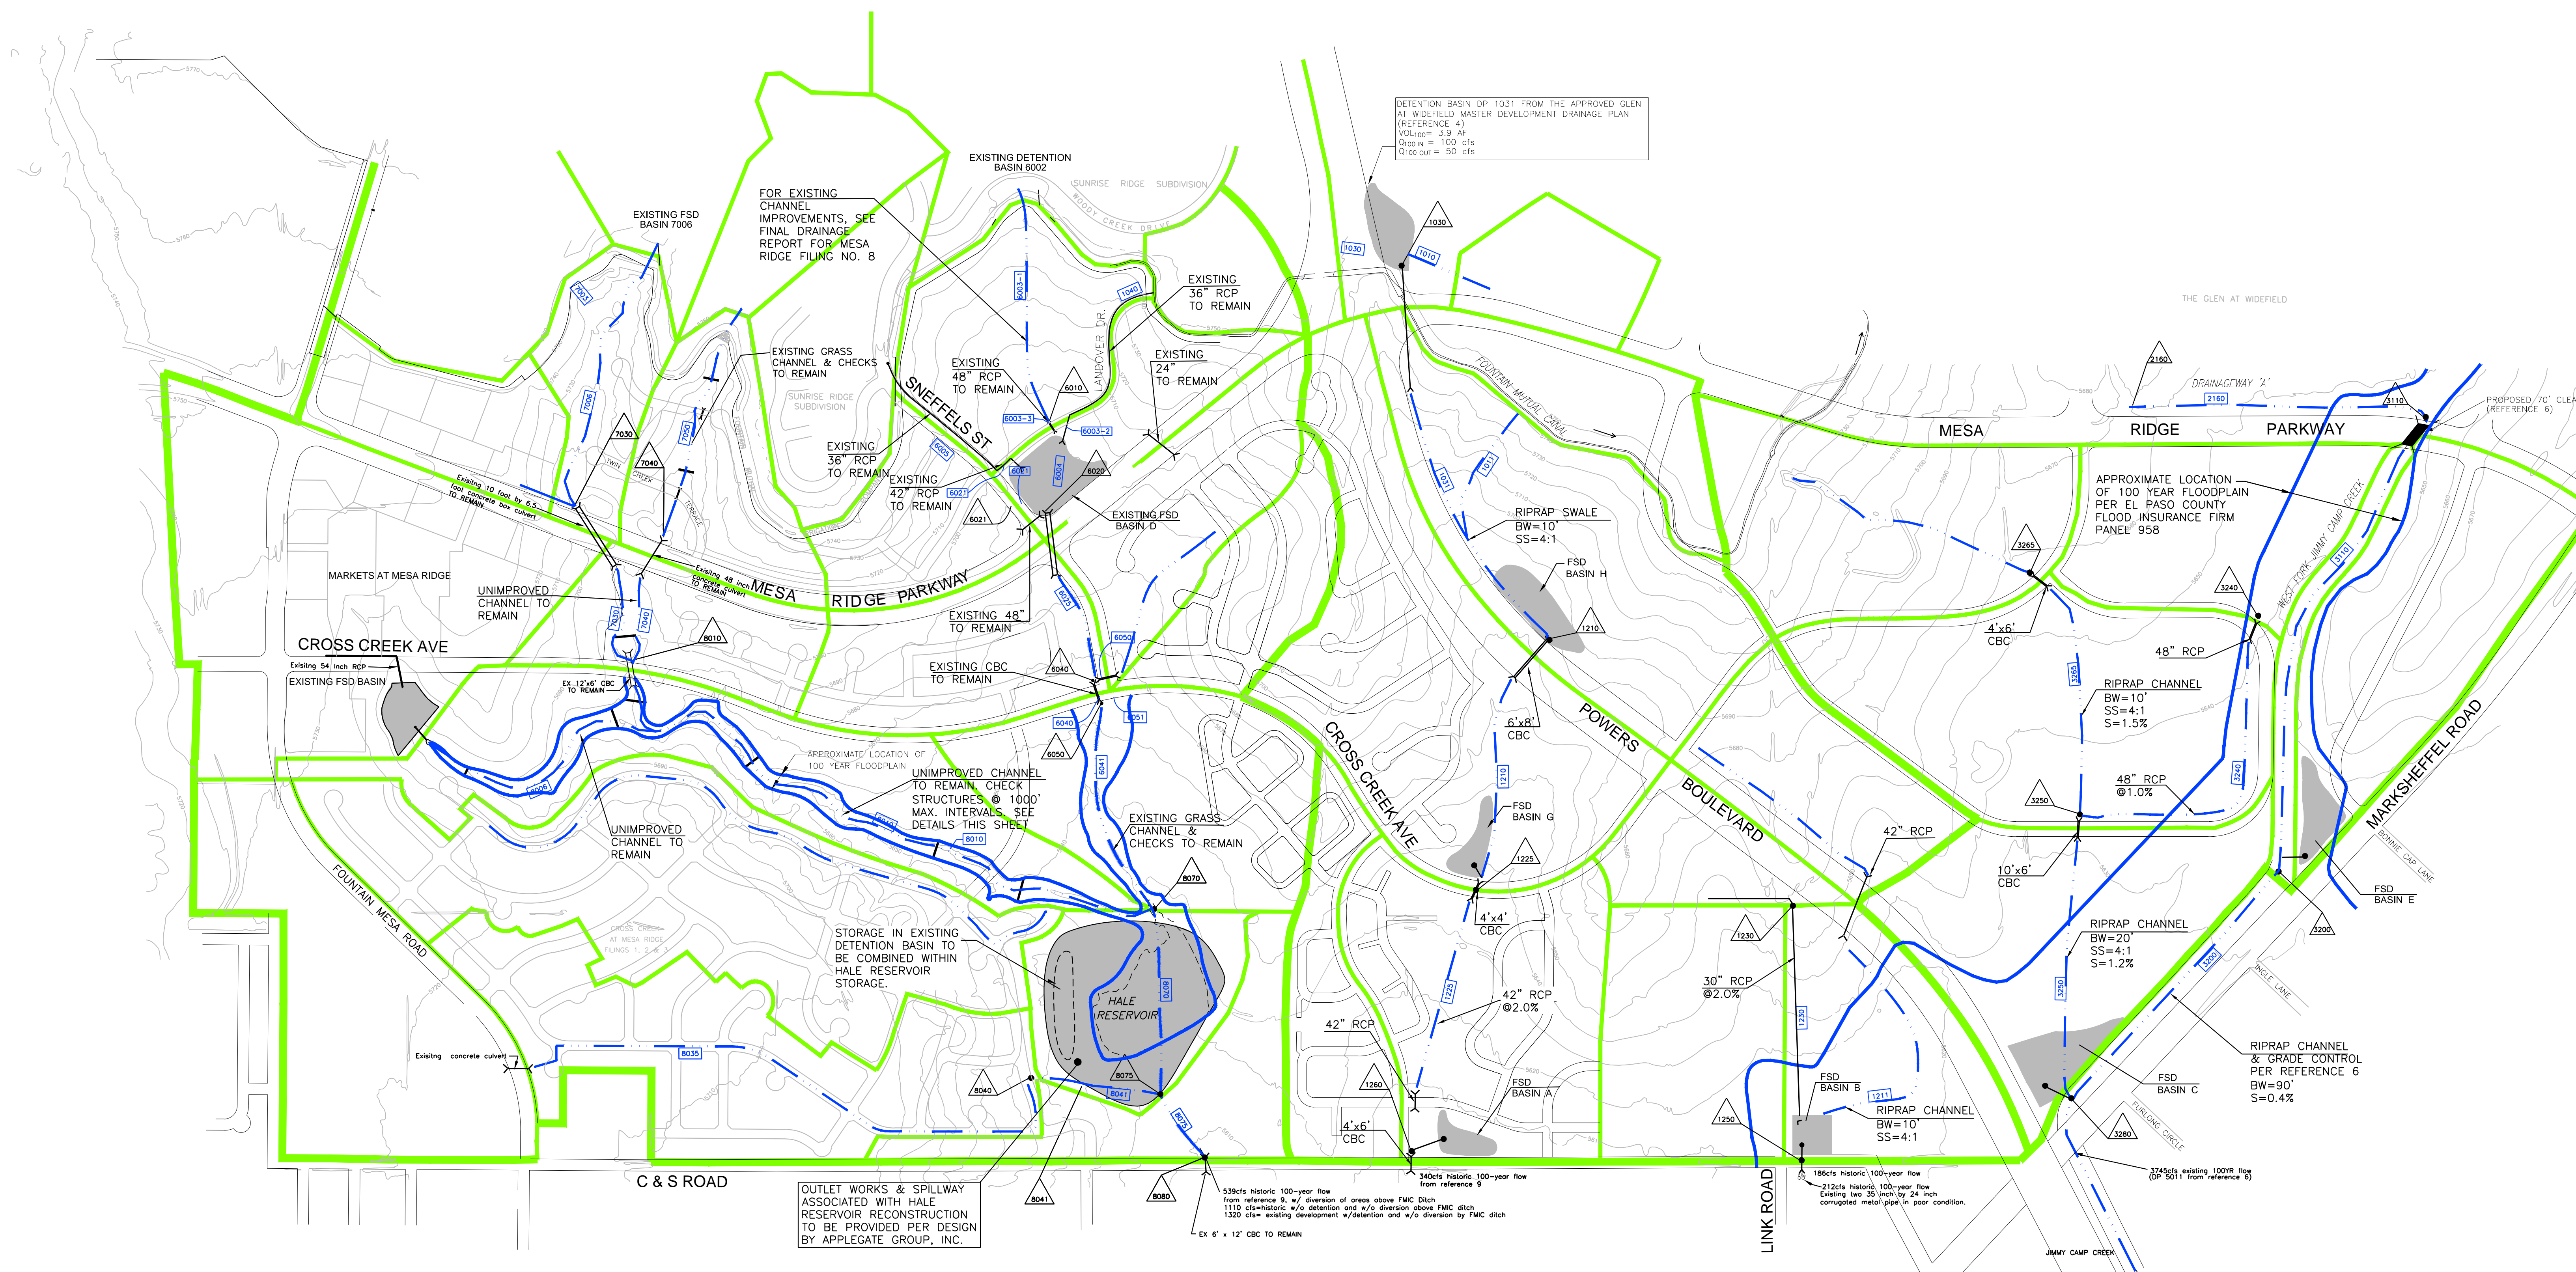

| SUMMARY OF PROPOSED FSD BASIN DATA (24-HOUR STORM) | | | |
|--|-----------|---------------------------------------|-----------|
| PROPOSED FS DETENTION BASIN A | | PROPOSED FS DETENTION BASIN B | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 69 cfs | 187 cfs | IN 102 cfs | 297 cfs |
| OUT 9 cfs | 52 cfs | OUT 13 cfs | 91 cfs |
| 100 yr VOLUME= 6.8 ac-ft | | 100 yr VOLUME= 8.4 ac-ft | |
| EURV VOLUME= 3.1 ac-ft | | EURV VOLUME= 3.1 ac-ft | |
| PROPOSED FS DETENTION BASIN C | | AS-BUILT FS DETENTION BASIN D | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 158 cfs | 490 cfs | IN 109 cfs | 375 cfs |
| OUT 9 cfs | 145 cfs | OUT 24 cfs | 233 cfs |
| 100 yr VOLUME= 14.8 ac-ft | | 100 yr VOLUME= 8.0 ac-ft | |
| EURV VOLUME= 8.3 ac-ft | | 5 yr VOLUME= 4.1 ac-ft | |
| PROPOSED FS DETENTION BASIN E | | RECONSTRUCTED DAM & RESERVOIR BASIN F | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 41 cfs | 120 cfs | IN 540 cfs | 1540 cfs |
| OUT 5 cfs | 24 cfs | OUT 7 cfs | 255 cfs |
| 100 yr VOLUME= 3.9 ac-ft | | 100 yr VOLUME= 95.9 ac-ft | |
| EURV VOLUME= 1.3 ac-ft | | 5 yr VOLUME= 50.0 ac-ft | |
| PROPOSED FS DETENTION BASIN G | | PROPOSED FS DETENTION BASIN H | |
| Q_5 | Q_{100} | Q_5 | Q_{100} |
| IN 74 cfs | 216 cfs | IN 161 cfs | 323 cfs |
| OUT 10 cfs | 51 cfs | OUT 23 cfs | 58 cfs |
| 100 yr VOLUME= 6.6 ac-ft | | 100 yr VOLUME= 13.2 ac-ft | |
| EURV VOLUME= 2.2 ac-ft | | EURV VOLUME= 2.5 ac-ft | |

| SUMMARY OF DESIGN POINT DISCHARGES (24-HOUR STORM WITH FSD) | | | | | |
|---|--|-------------------|---------|----------|--|
| DESIGN POINT | LOCATION | DRAINAGE AREA | 5 Year | 100 Year | |
| DP 6010 | AT LANDOVER | 108.9 ac 0.18 sm | 43 cfs | 196 cfs | |
| DP 6020 | INFLOW TO DETENTION BASIN D | 168.3 ac 0.27 sm | 109 cfs | 375 cfs | |
| DB 6020 | OUTFLOW FROM DETENTION BASIN D | 168.3 ac 0.27 sm | 24 cfs | 223 cfs | |
| DP 6040 | U/S CROSS CREEK | 217.0 ac 0.35 sm | 74 cfs | 334 cfs | |
| DP 6050 | D/S CROSS CREEK AVE | 233.5 ac 0.37 sm | 92 cfs | 358 cfs | |
| DP 7030 | AT OUTLET OF BASIN 7030 | 263.9 ac 0.41 sm | 183 cfs | 420 cfs | |
| DP 7040 | AT OUTLET OF BASIN 7040 | 39.6 ac 0.06 sm | 30 cfs | 110 cfs | |
| DP 8010 | AT OUTLET OF BASIN 8010 | 322.1 ac 0.50 sm | 241 cfs | 603 cfs | |
| DP 8070 | U/S OF HALE RESERVOIR | 726.7 ac 1.15 sm | 446 cfs | 1259 cfs | |
| DP 8075 | INFLOW TO HALE RESERVOIR | 908.8 ac 1.42 sm | 540 cfs | 1540 cfs | |
| DB 8075 | OUTFLOW FROM HALE RESERVOIR | 908.8 ac 1.42 sm | 7 cfs | 255 cfs | |
| DP 8080 | C&S ROAD | 928 ac 1.45 sm | 13 cfs | 257 cfs | |
| DP 1031 | D/S POWERS BOULEVARD | 51.0 ac 0.08 sm | 28 cfs | 55 cfs | |
| DP 1211 | INFLOW TO DET. BASIN H 1210, POWERS BLVD | 108.8 ac 0.17 sm | 161 cfs | 323 cfs | |
| DP 1210 | OUTFLOW FROM DET. BASIN H | 108.8 ac 0.17 sm | 23 cfs | 36 cfs | |
| SB 1225 | INFLOW TO DETENTION BASIN G | 70.4 ac 0.11 sm | 74 cfs | 216 cfs | |
| DP 1225 | AT CROSS CREEK AVENUE | 185.6 ac 0.29 sm | 33 cfs | 104 cfs | |
| DP 1250 | INFLOW TO DETENTION BASIN B | 96.0 ac 0.15 sm | 102 cfs | 297 cfs | |
| DB 1250 | OUTFLOW FROM DETENTION BASIN B | 96.0 ac 0.15 sm | 13 cfs | 91 cfs | |
| DP 1265 | INFLOW TO DETENTION BASIN A | 64 ac 0.10 sm | 69 cfs | 187 cfs | |
| DP 1260 | AT C & S ROAD | 243 ac 0.38 sm | 41 cfs | 156 cfs | |
| DP 2160 | DESIGN POINT 2160 | 448 ac 0.70 sm | 188 cfs | 640 cfs | |
| DP 3110 | AT MESA RIDGE PARKWAY | 2163.2 ac 3.38 sm | 766 cfs | 3095 cfs | |
| DP 3200 | DESIGN POINT 3200 | 2208 ac 3.44 sm | 764 cfs | 3089 cfs | |
| DP 3250 | AT COLLECTOR ROAD | 126.7 ac 0.20 sm | 130 cfs | 380 cfs | |
| DP 3265 | AT OUTLET OF BASIN 3265 | 40.5 ac 0.06 sm | 52 cfs | 135 cfs | |
| DP 3281 | INFLOW TO DET. BASIN C | 172.8 ac 0.27 sm | 158 cfs | 490 cfs | |
| DB 3281 | OUTFLOW FROM DETENTION BASIN C | 172.8 ac 0.27 sm | 9 cfs | 145 cfs | |
| DP 3280 | AT MARKSHEFFEL ROAD | 2381.0 ac 3.72 sm | 772 cfs | 3215 cfs | |




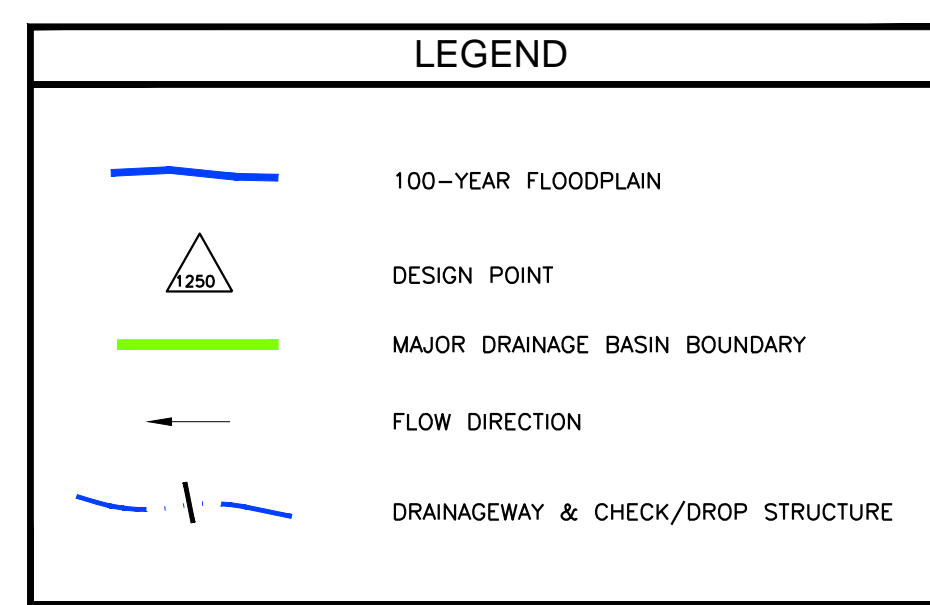


EXHIBIT 2
MESA RIDGE DEVELOPMENT
MASTER DEVELOPMENT DRAINAGE PLAN UPDATE
PROPOSED FACILITIES PLAN
DEVELOPED WITH REGIONAL DETENTION
FOUNTAIN, COLORADO

Kiowa Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado
80904 - 4208
(719) 630-7342

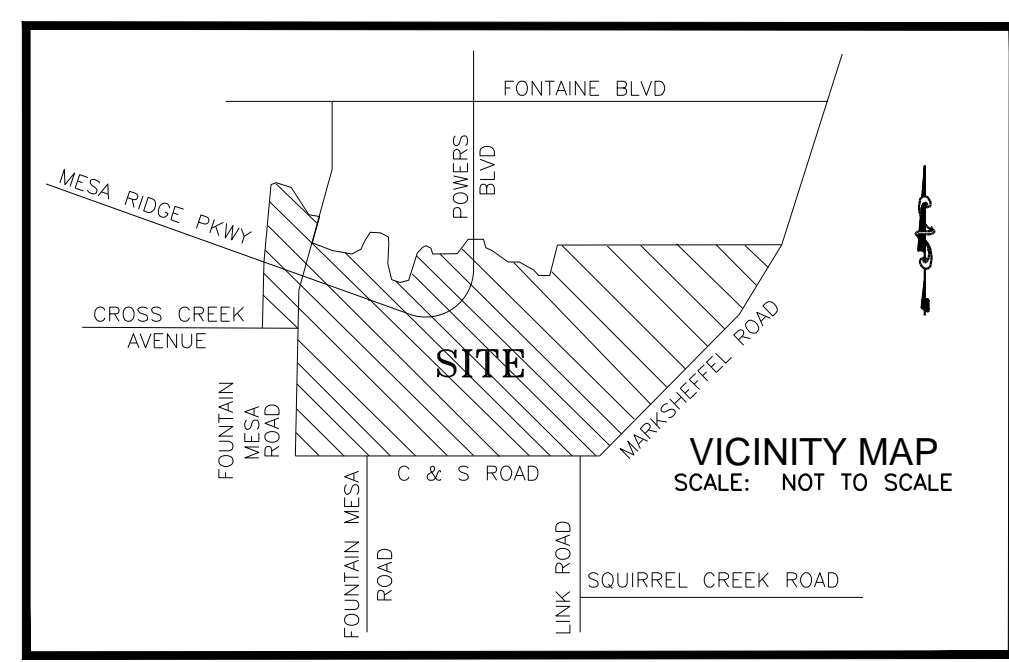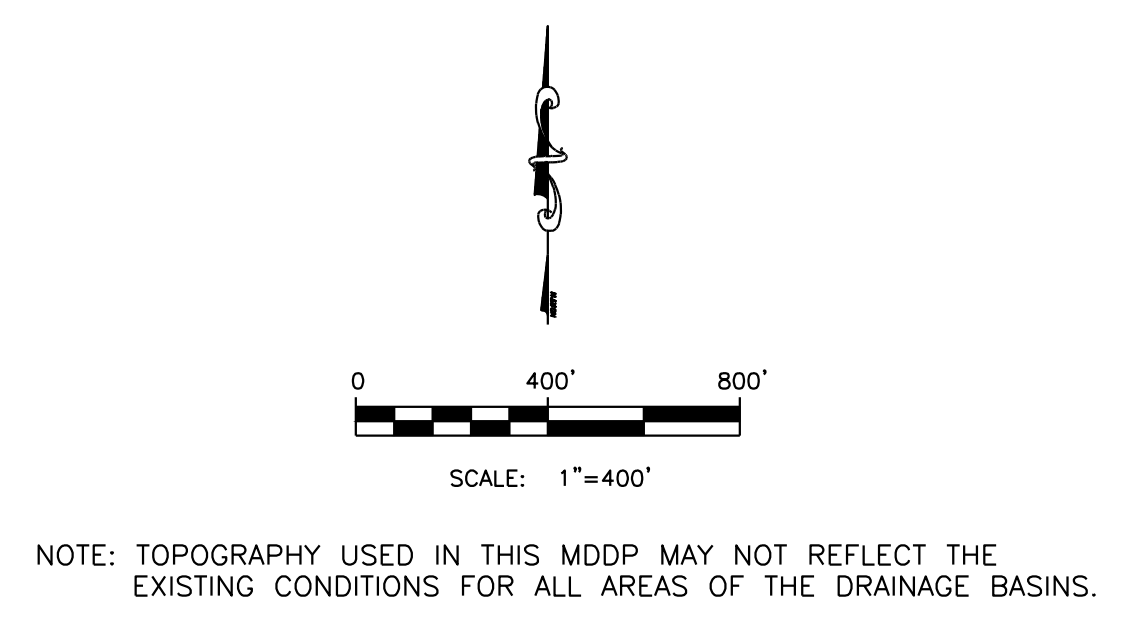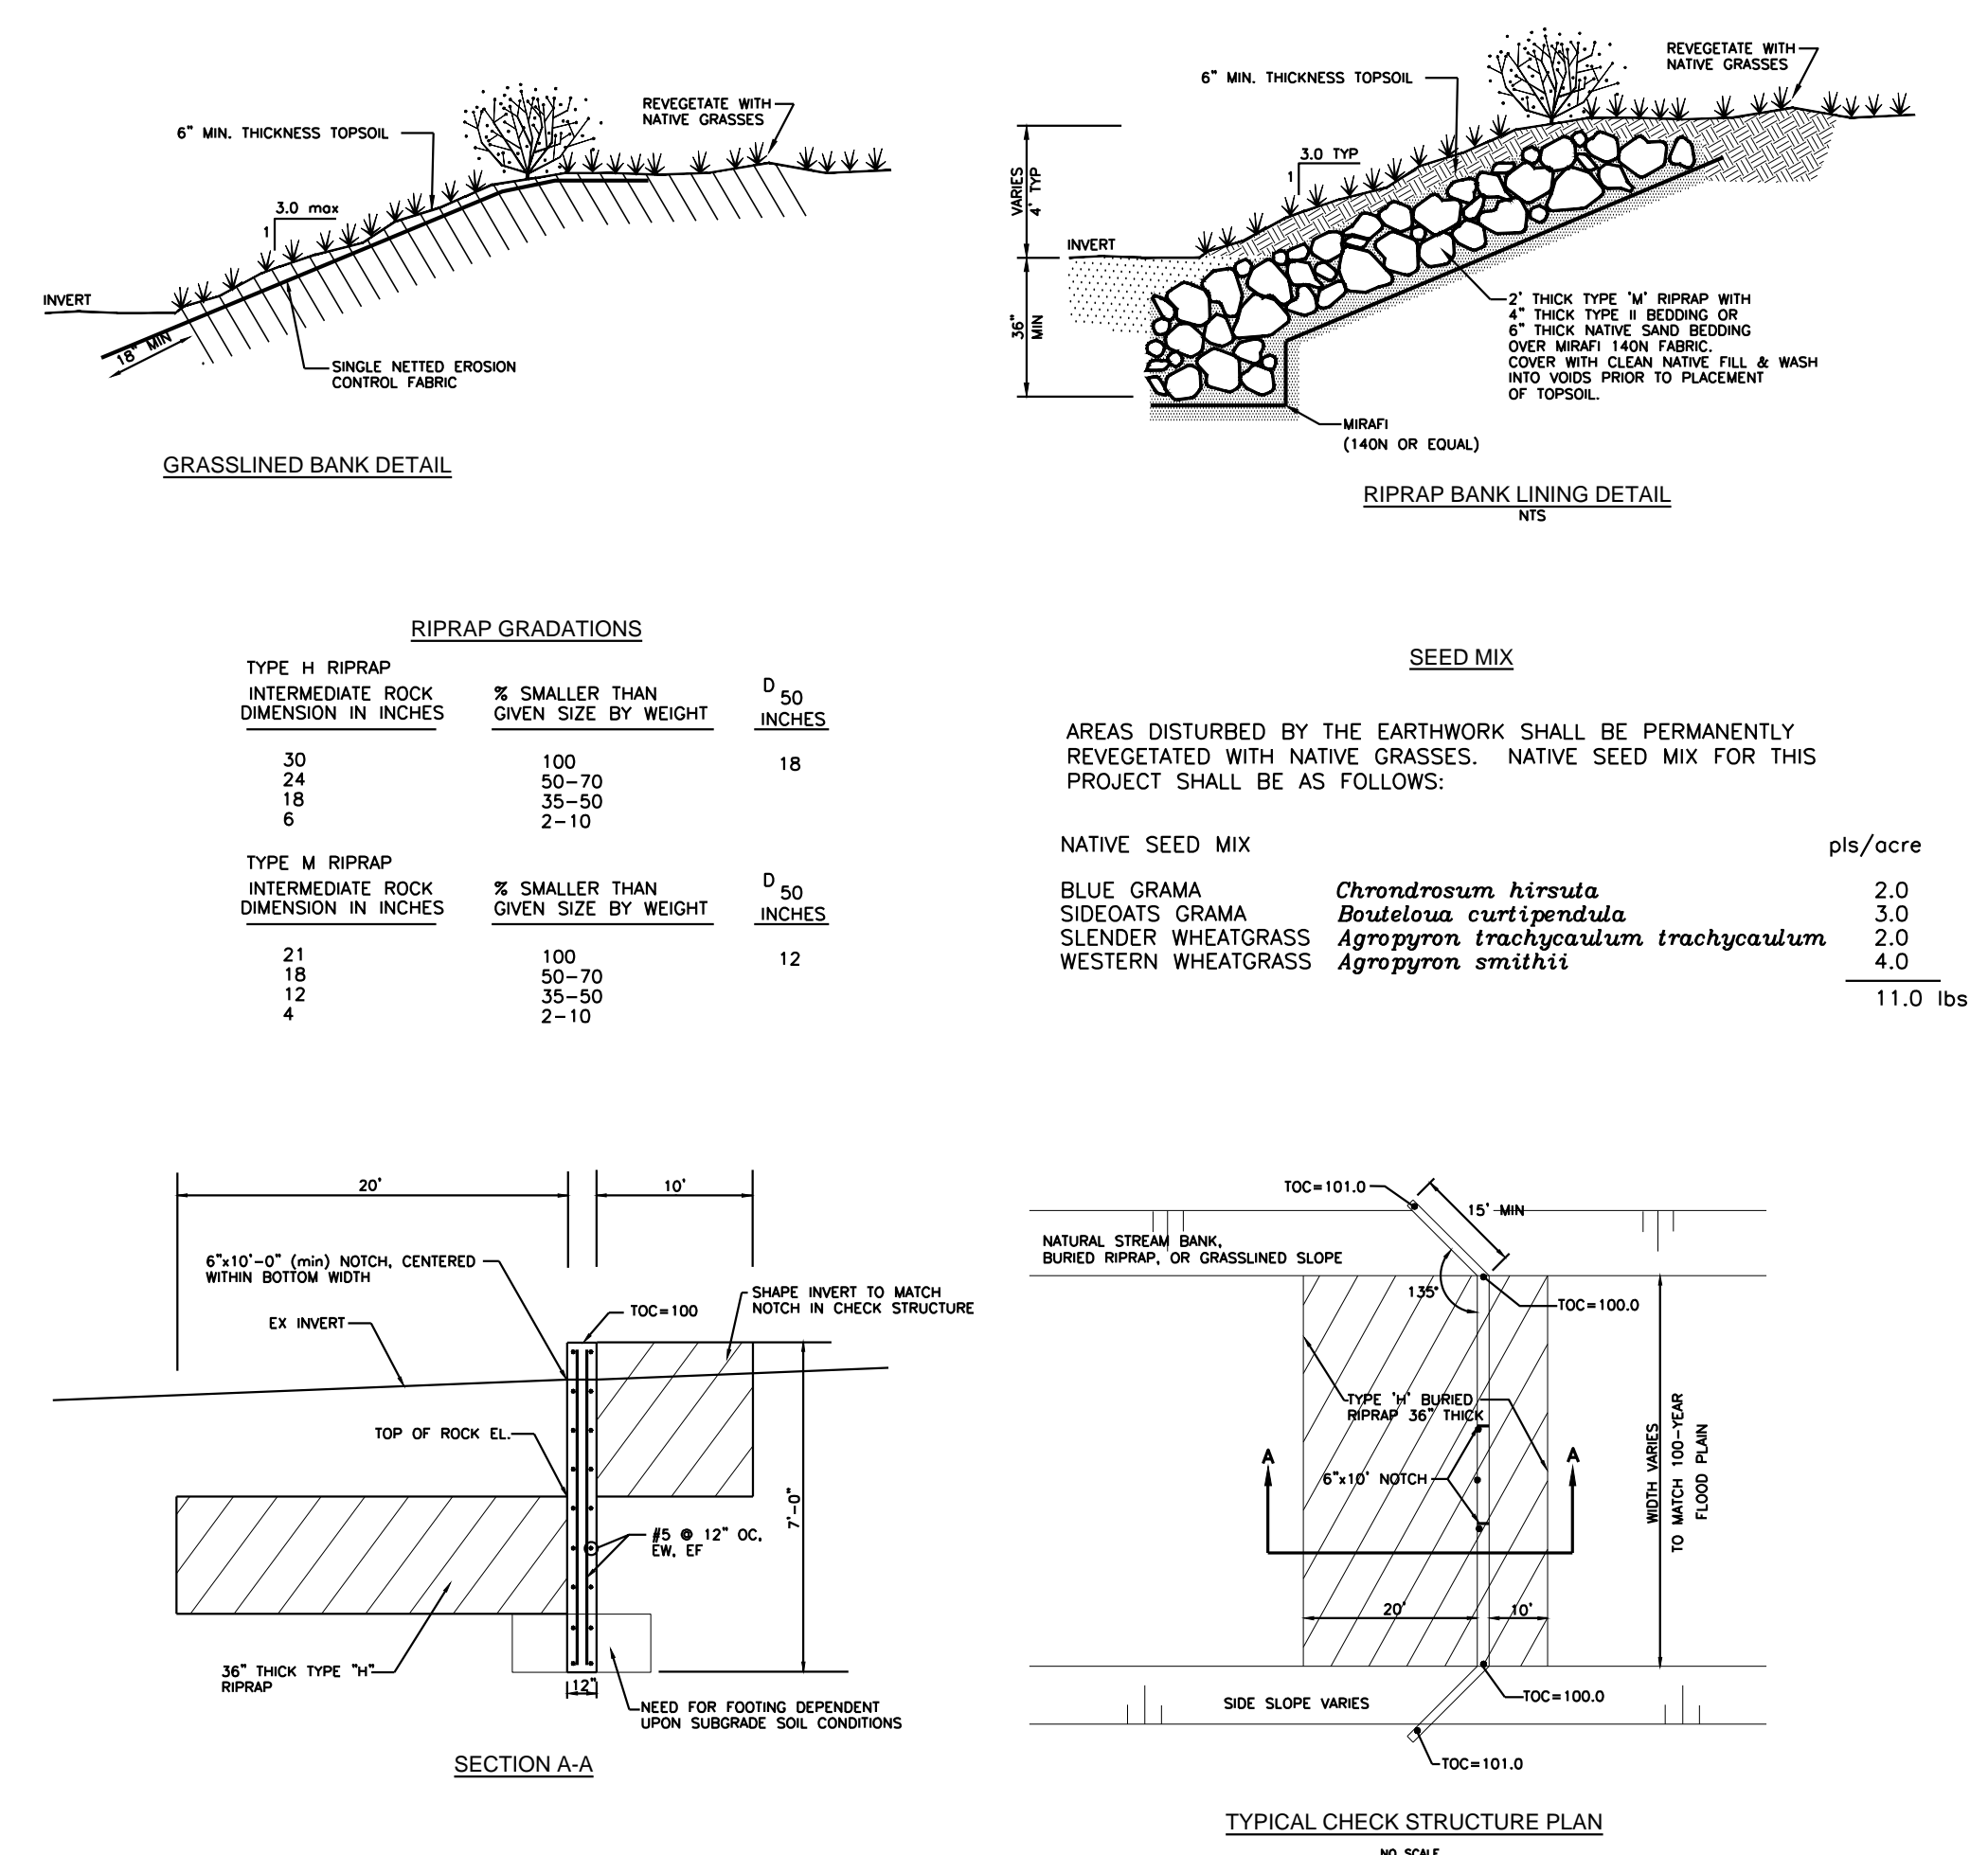

NEW DOC

Master Development Drainage Plan
Mesa Ridge Development

City of Fountain, Colorado


Prepared For:

Norwood Development
111 South Tejon #222
Colorado Springs, CO 80903

Prepared By:

Kiowa Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado 80904

Project Number 05011
December 17, 2006

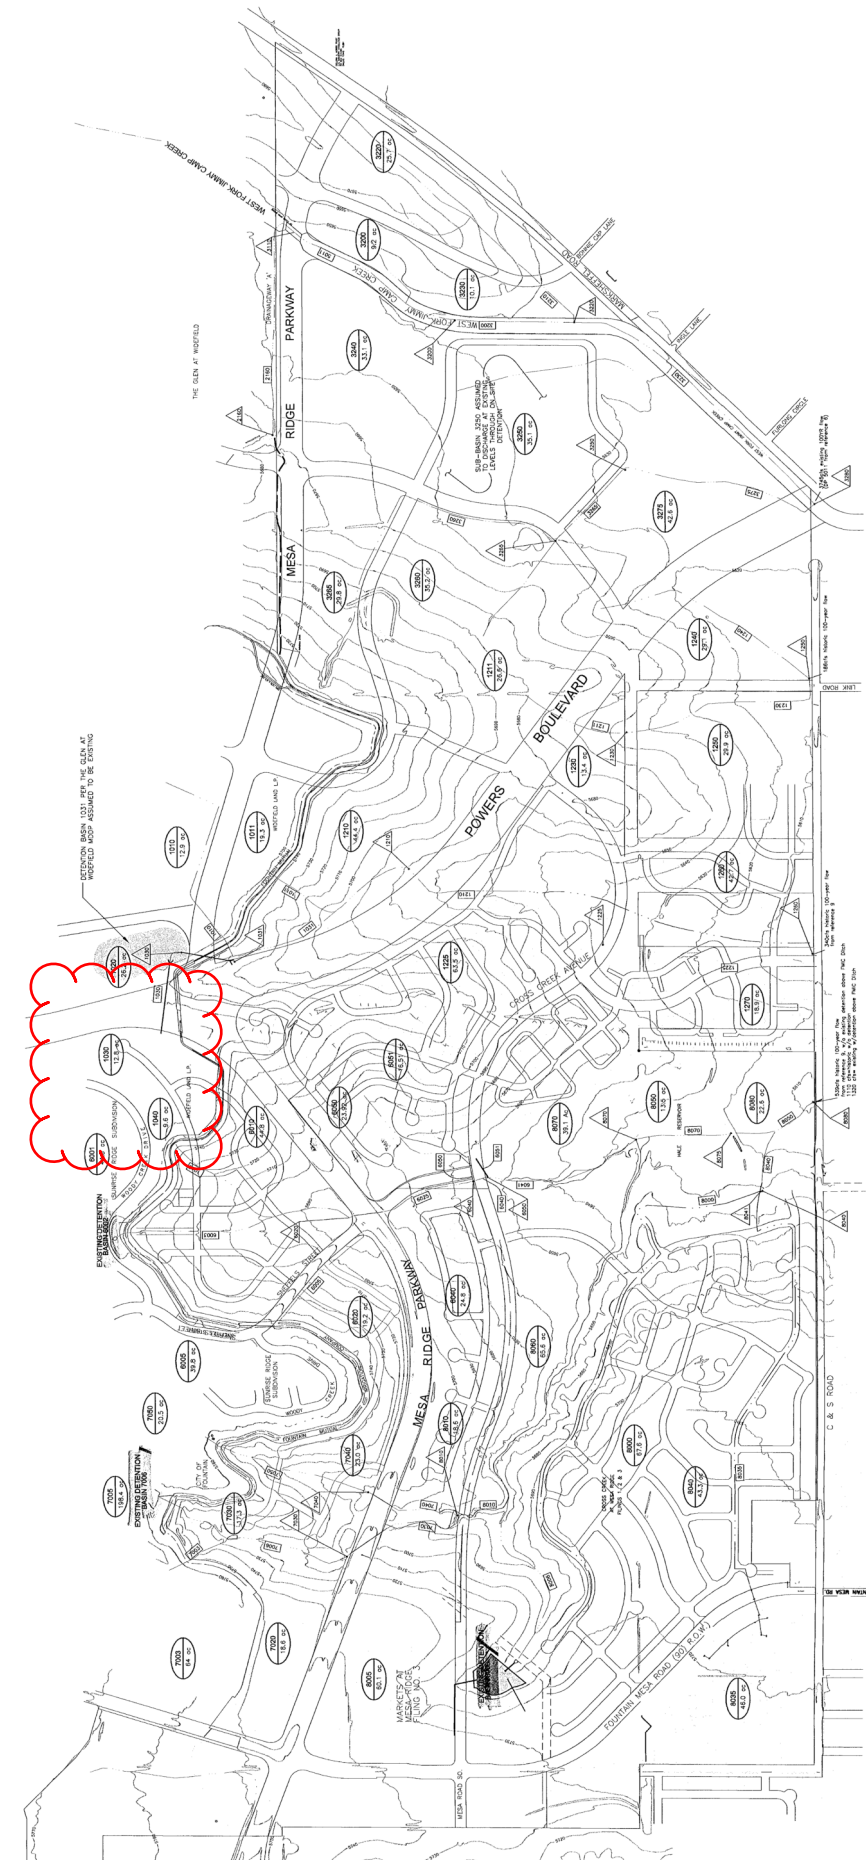

6000 - 8000 BASINS

| SUMMARY OF WEST DESIGN POINT DISCHARGES (24-HOUR STORM) | | | |
|---|-------------------------|---------------|---------------------|
| WITHOUT DETENTION IN CROSS CREEK DEVELOPMENT | | | |
| DESIGN POINT | LOCATION | DRAINAGE AREA | DEVELOPED CONDITION |
| DP 8000 | AT OUTLET OF BASIN 6010 | 180.0 ac | 422 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |
| DP 8000 | AT OUTLET OF BASIN 6010 | 230.0 ac | 535 cfs |

1000-1200 BASINS

| SUMMARY OF CENTRAL DESIGN POINT DISCHARGES (24-HOUR STORM) | | | |
|--|---------------------|---------------|---------------------|
| WITHOUT DETENTION IN CROSS CREEK DEVELOPMENT | | | |
| DESIGN POINT | LOCATION | DRAINAGE AREA | DEVELOPED CONDITION |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 1000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |

WESTCORK JIMMY CAMP CREEK (3000 BASINS)

| SUMMARY OF WESTCORK DESIGN POINT DISCHARGES (24-HOUR STORM) | | | |
|---|---------------------|---------------|---------------------|
| WITHOUT DETENTION IN CROSS CREEK DEVELOPMENT | | | |
| DESIGN POINT | LOCATION | DRAINAGE AREA | DEVELOPED CONDITION |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |
| DP 3000 | AT POWER SUBSTATION | 15.2 ac | 27 cfs |

| SUMMARY OF HISTORIC DISCHARGES | | | |
|--------------------------------|----------------|---------|----------|
| DESIGN POINT | LOCATION | 5 Year | 100 Year |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |
| 3275 | AT JAMES CREEK | 892 cfs | 3743 cfs |

(1) AREA AROUND POWER SUBSTATION CANAL ASSUMED TO BE 100% DETENTION

LEGEND

3275 14.08 ac

DESIGN POINT

DRAINAGE BASIN BOUNDARY


FLOW DIRECTION

CONFIRMED ELEVATION

0 400' 800'

SCALE: 1"=400'

NOTE: TOPOGRAPHY USED IN THIS MDP MAY NOT REFLECT THE EXISTING CONDITIONS FOR ALL AREAS OF THE DRAINAGE BASIN.



Kiowa Records 10/25/11

GENERAL NOTES

1. ALL WORK REQUIRED OF THESE PLANS SHALL BE COMPLETED IN ACCORDANCE WITH CITY OF COLORADO SPRINGS, ENGINEERING DIVISION, STANDARD SPECIFICATIONS, AND WITH THE APPLICABLE SECTIONS OF THE COLORADO DEPARTMENT OF TRANSPORTATION, STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.
2. THE CONTRACTOR IS RESPONSIBLE FOR THE FIELD VERIFICATION OF ALL PUBLIC AND PRIVATE UTILITIES PRIOR TO THE COMMENCEMENT OF WORK. THE UTILITIES SHOWN ON THESE PLANS HAVE BEEN LOCATED USING THE BEST AVAILABLE INFORMATION. SHOULD A UTILITY BE DAMAGED AS A RESULT OF THIS CONSTRUCTION, IT SHALL BE REPAIRED IMMEDIATELY BY EITHER THE CONTRACTOR OR THE AFFECTED UTILITY OWNER. THE FULL COST OF SUCH A REPAIR SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
3. SURFACE AND GROUNDWATER AT THE SITE MAY CREATE A NEED FOR DEWATERING DURING THE CONSTRUCTION OF THE DRAINAGEWAY FACILITIES. CONTRACTOR SHALL BE RESPONSIBLE FOR THE MAINTENANCE OF TEMPORARY DEWATERING STRUCTURES, AND PROVIDE FOR THE SAFE AND STABLE DISCHARGE OF WATER FROM THE CONSTRUCTION SITE. THE COST OF DEWATERING IS CONSIDERED INCIDENTAL TO THE CONSTRUCTION AND WILL NOT BE PAID FOR UNDER A SPECIFIC ITEM IN THE BID DOCUMENTS.
4. CLASS III RCP SHALL BE USED FOR ALL STORM SEWERS UNLESS OTHERWISE SPECIFIED.
5. THE CONTRACTOR SHALL NOTIFY THE CITY OF FOUNTAIN DEPARTMENT OF PUBLIC WORKS 48 HOURS PRIOR TO THE START OF CONSTRUCTION TO OUTLINE METHODS OF CONSTRUCTION, SCHEDULING, AND ISSUING OF INSPECTION PERMITS.

STRUCTURAL CONCRETE NOTES

1. ALL CONSTRUCTION INVOLVING THE PLACEMENT OF STRUCTURAL CONCRETE SHALL BE COMPLETED IN ACCORDANCE WITH SECTION 600 OF THE CITY OF COLORADO SPRINGS ENGINEERING DIVISION STANDARD SPECIFICATIONS.
2. STEEL REINFORCING SHALL BE GRADE 60 FOR ALL REINFORCING STEEL GREATER THAN #4. A TABLE SPECIFYING MINIMUM SPLICE LENGTHS HAS BEEN PROVIDED ON THE STRUCTURAL DETAIL SHEETS. ALL REINFORCING SHALL HAVE A 2-INCH MINIMUM COVER UNLESS OTHERWISE SPECIFIED. REBAR SHOP DRAWINGS SHALL BE SUBMITTED TO THE ENGINEER FOR REVIEW PRIOR TO FABRICATION.
3. CAST-IN-PLACE CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH (F'C) OF 4,000 PSI AT 28 DAYS. ALL CONCRETE PLACED AGAINST SOIL SHALL BE TYPE II/V PORTLAND CEMENT. ALL EXPOSED CORNERS SHALL BE FORMED WITH A 3/4" CHAMFER UNLESS OTHERWISE SPECIFIED.
4. EXPANSION JOINT MATERIAL SHALL MEET AASHTO SPECIFICATION M-213.
5. BACKFILL AGAINST STRUCTURES SHALL NOT COMMENCE UNTIL ALL SUPPORTING DIAPHRAGMS ARE IN PLACE AND CONCRETE HAS OBTAINED ITS FULL SEVEN DAY STRENGTH. BACKFILL SHALL BE PLACED EQUALLY ON EACH SIDE OF CHECK STRUCTURES AND CUTOFF WALLS UNTIL THE FINAL GRADE IS REACHED.
6. FOOTING EXCAVATIONS SHALL BE EXAMINED BY THE GEOTECHNICAL ENGINEER PRIOR TO THE FORMING AND PLACING OF CONCRETE.
7. CONTRACTOR IS RESPONSIBLE FOR PROVIDING THE ENGINEER AND GEOTECHNICAL ENGINEER WITH A 24-HOUR MINIMUM NOTIFICATION FOR REBAR OBSERVATION, SOIL AND/OR CONCRETE TESTING. PLACEMENT OF CONCRETE IN THE ABSENCE OF TESTING SHALL BE COMPLETED AT THE SOLE RISK OF THE CONTRACTOR.
8. CONCRETE:
 - A. NO ADMIXTURES PERMITTED WITHOUT THE REVIEW OF ENGINEER. SUBMIT DESIGN MIX FOR ENGINEER APPROVAL.
 - B. CONTRACTOR IS RESPONSIBLE FOR THE ADEQUACY OF FORMS AND SHORING AND FOR SAFE PRACTICE IN THEIR USE AND REMOVAL.
 - C. COMPRESSIVE STRENGTH SHALL BE 4,000 psi, MIN.
9. REINFORCING STEEL:
 - A. TO BE BILLET STEEL CONFORMING TO THE LATEST A.S.T.M./ A615 GRADE 60 SPECIFICATION, FABRICATED IN ACCORDANCE WITH MANUAL OF STANDARD PRACTICE OF THE C.R.S.I. AND PLACED IN ACCORDANCE WITH A.C.I. 315 AND A.C.I. MANUAL OF PRACTICE.
 - B. MINIMUM OF CONCRETE COVER UNLESS OTHERWISE DETAILED ON DRAWINGS: FOOTINGS 3 INCHES, WALLS 3 INCHES, SLABS EXPOSED TO WEATHER 1-1/2 INCHES, SLABS ON GRADE 1-1/2 INCHES MEASURED FROM TOP OF SLAB.
 - C. SLAB REINFORCEMENT: LAPPED 36 BAR DIAMETER OR MINIMUM 18 INCHES. BOTTOM BARS SPICED ONLY AT SUPPORTS, TOP BARS SPICED ONLY AT MID-SPAN. ALL TOP BARS HOOKED AT NON-CONTINUOUS EDGES (U.O.N.) ALL HOOKS TO BE STANDARD 90 DEGREE OR 180 DEGREE HOOKS AS REQUIRED (U.O.N.), DOWELS IN FOUNDATION TO MATCH REINFORCING ABOVE.
 - D. SUBMIT SHOP DRAWINGS FOR REINFORCING PRIOR TO FABRICATION.
10. FOUNDATIONS:
 - A. STRUCTURES SHALL BEAR ON SOIL HAVING A MINIMUM BEARING CAPACITY OF 2,000 P.S.F. COMPACTION FOR SUBGRADE PREPARATION SHALL BE IN ACCORDANCE WITH REQUIREMENTS OF THE SOILS REPORT. SUBGRADE PREPARATION SHALL BE MONITORED BY THE SOILS ENGINEER.
11. BACKFILL AND STABILIZATION MATERIAL:
 - A. BACKFILL MATERIAL CONSISTING OF SELECT, GRANULAR, NON-SWELLING MATERIAL TO BE PLACED ALONG THE SIDES OF THE VAULTS EXTENDING 3 FEET OUTSIDE THE VAULT WALLS.
 - B. 3/4-INCH ROCK, 12-INCHES DEEP, TO BE PLACED UNDER ALL VAULTS.
 - C. 2-INCH TO 4-INCH STABILIZATION MATERIAL SHALL BE PLACED UNDER THE 3/4" ROCK IF SUBGRADE STABILIZATION IS REQUIRED.
12. ABBREVIATIONS
E.C. -- EPOXY COATED O.F. -- OUTSIDE FACE E.F. -- EACH FACE
E.W. -- EACH WAY I.F. -- INSIDE FACE N.F. -- NEAR FACE
T.O.C. -- TOP OF CONCRETE B.O.C. -- BOTTOM OF CONCRETE
CONT. -- CONTINUOUS

INDEX OF SHEETS

- 1 COVER SHEET
- 2 GRADING AND EROSION CONTROL PLAN & STORM PROFILE
- 3 OUTLET STRUCTURE DETAILS

ABBREVIATIONS

| | | |
|-------------------------------|---|--------------------------------------|
| ASSY = ASSEMBLY | HORIZ. = HORIZONTAL | PVC = POINT OF VERTICAL CURVATURE |
| BNDY = BOUNDARY | HYD = HYDRANT | PMI = POINT OF VERTICAL INTERSECTION |
| B.O.P. = BOTTOM OF PIPE | I.D. = INSIDE DIAMETER | PVT = POINT OF VERTICAL TANGENCY |
| CL = CENTERLINE | LT = LEFT | RCB = REINFORCED CONCRETE BOX |
| CRA = CONCRETE REVERSE ANCHOR | LF = LINEAR FEET | RCP = REINFORCED CONCRETE PIPE |
| CTRB = CONCRETE THRUST BLOCK | LP = LOW POINT | ROW = RIGHT OF WAY |
| CR = POINT OF CURB RETURN | MAX. = MAXIMUM | RT = RIGHT |
| DIP = DUCTILE IRON PIPE | M.H. = MANHOLE | SHT = SHEET |
| EL = ELEVATION | MIN. = MINIMUM | SS = SANITARY SEWER |
| ESMT = EASEMENT | NTS = NOT TO SCALE | STA. = STATION |
| EX. = EXISTING | O.D. = OUTSIDE DIAMETER | STD. = STANDARD |
| FG = FACE OF CURB | P.C. = POINT OF HORIZONTAL CURVATURE | T.O.P. = TOP OF PIPE |
| FES = FLARED END SECTION | PCHC = POINT OF CURVATURE ON HORIZ. CURVE | TYP. = TYPICAL |
| FG = FLANGE | PP = PROPOSED | VC = VERTICAL CURVE |
| FL = FLOWLINE | PT = POINT OF HORIZONTAL TANGENCY | VERT. = VERTICAL |
| GB = GRADE BREAK | PTHC = POINT OF TANGENCY ON HORIZ. CURVE | |
| HP = HIGH POINT | PVC = POLY VINYL CHLORIDE PIPE | |


MESA RIDGE FILINGS 8 & 9

DETENTION BASIN 'D'


FULL SPECTRUM DETENTION MODIFICATIONS

FINAL DESIGN DRAWINGS

FOUNTAIN, COLORADO

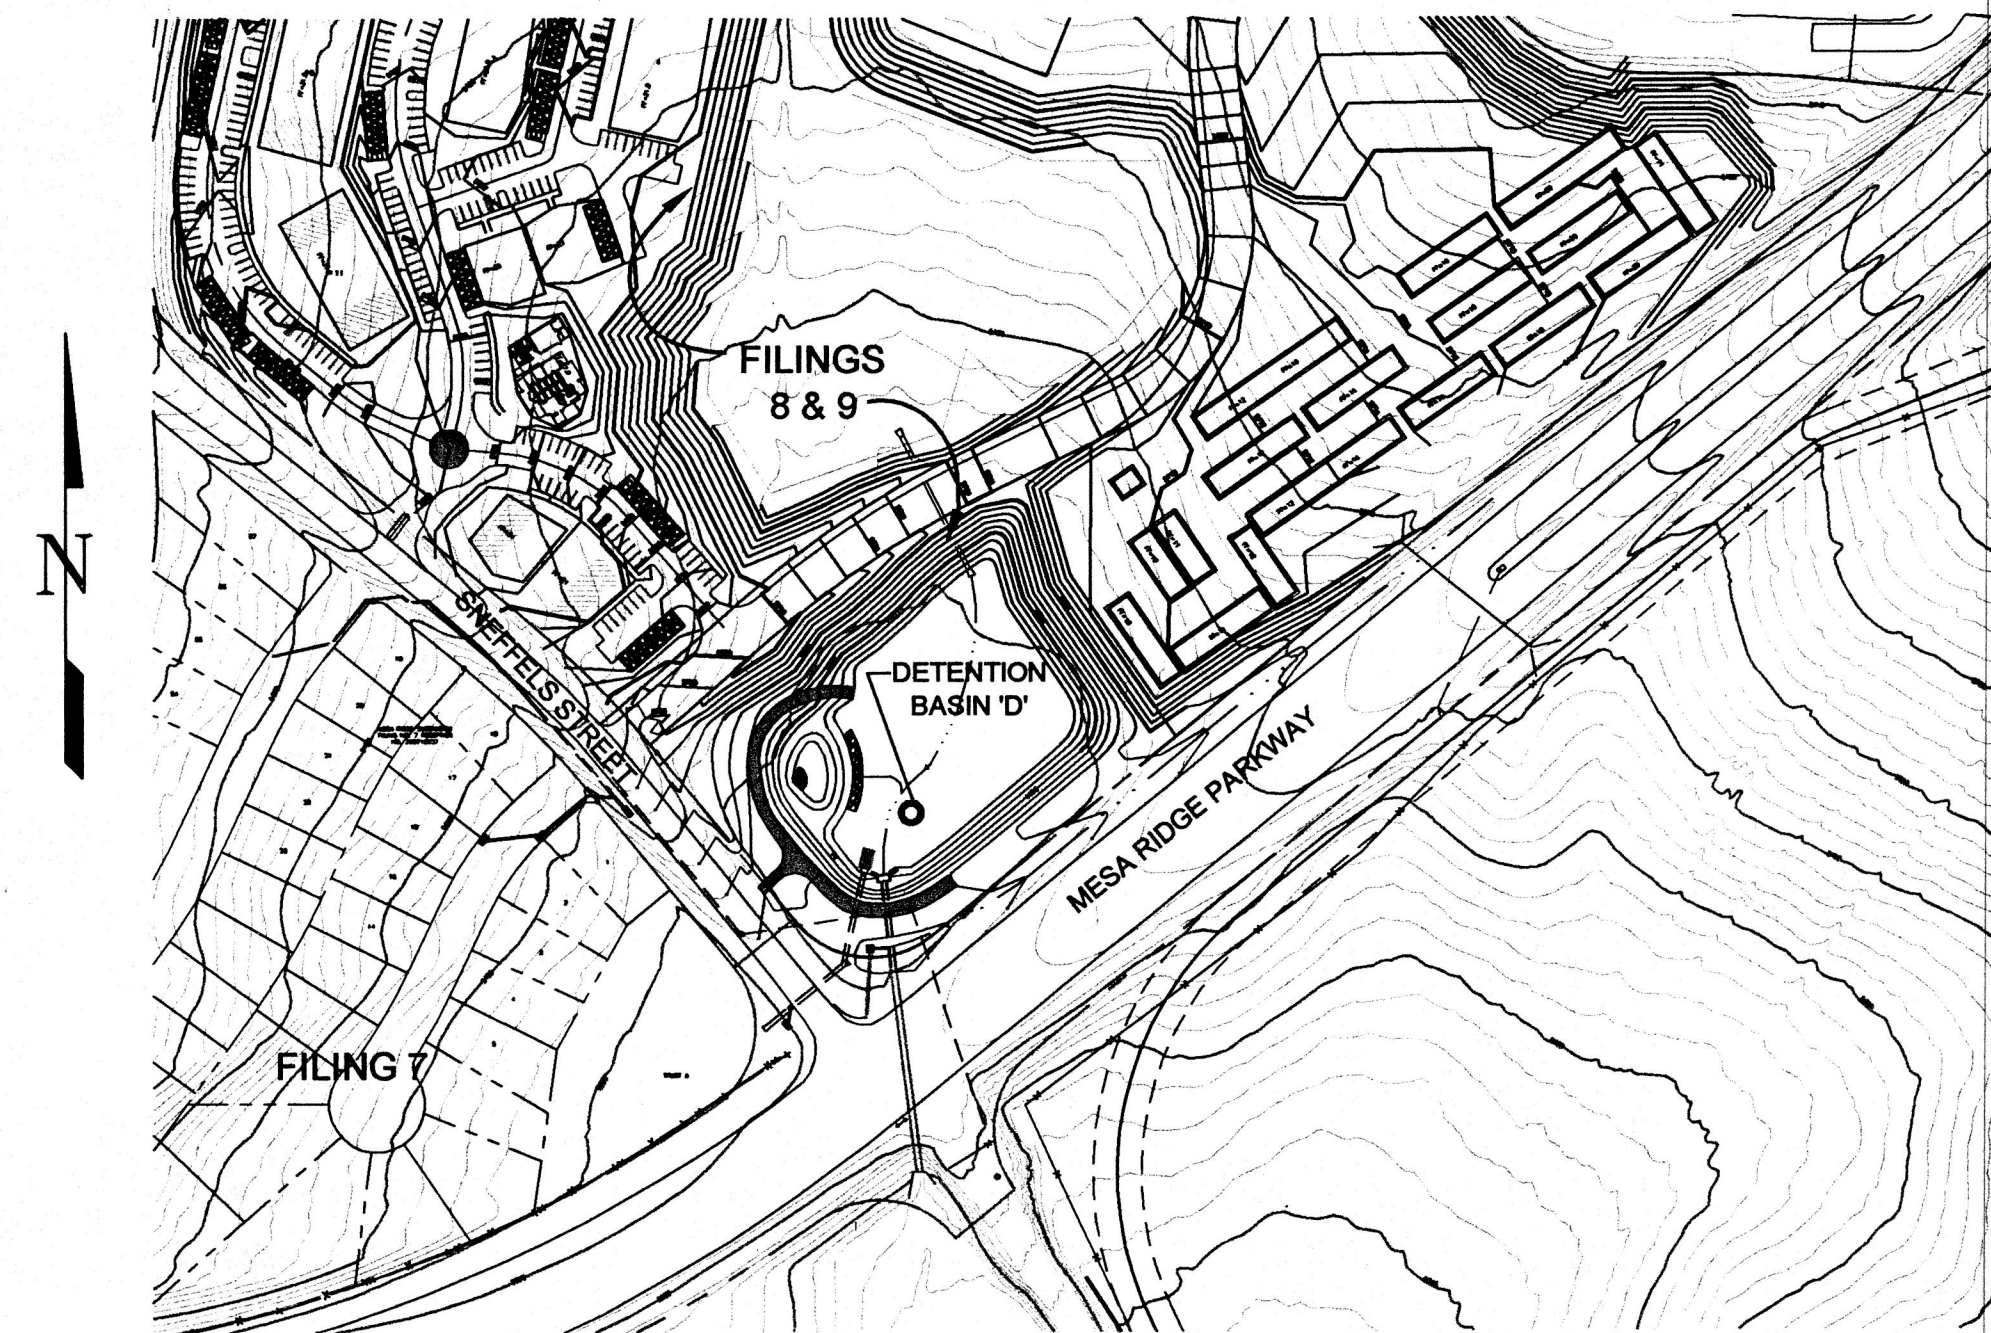

SITE MAP
SCALE: 1"=200'

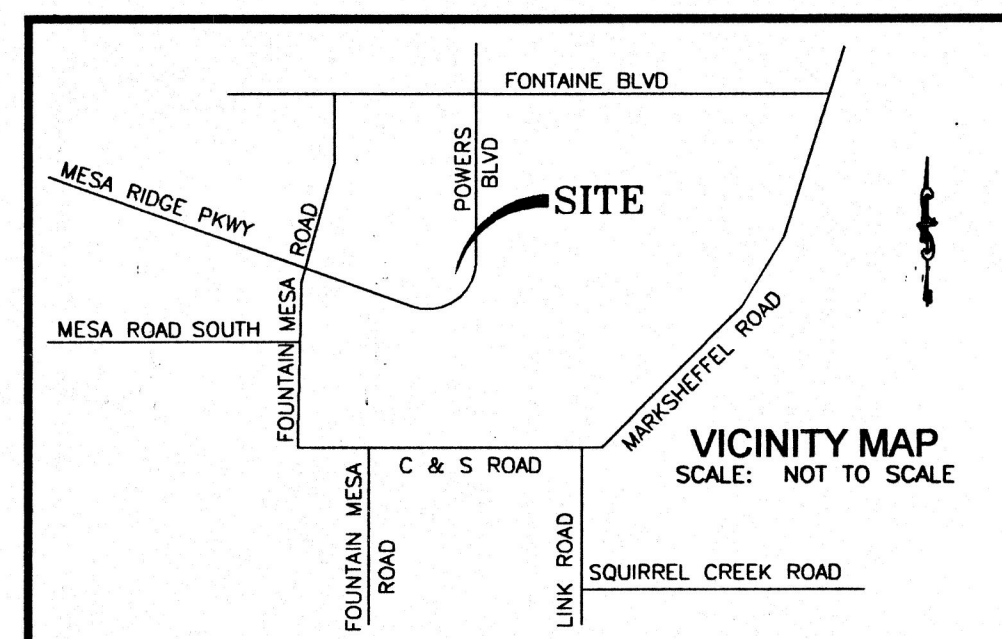

*A.G.A./A.P.W.A. STANDARD UTILITY MARKING COLOR CODE

| | |
|-------------|--------|
| NATURAL GAS | YELLOW |
| ELECTRIC | RED |
| WATER | BLUE |
| WASTEWATER | GREEN |

CALL BEFORE YOU DIG...
48 HOURS BEFORE YOU DIG, CALL UTILITY LOCATIONS FOR LOCATING AND MARKING GAS, ELECTRIC, WATER AND WASTEWATER
1-800-922-1987

STATEMENTS

CITY OF FOUNTAIN ACCEPTANCE:

THE PLANS OR REPORT SUBMITTED APPEAR TO BE IN CONFORMANCE WITH THE CITY OF FOUNTAIN SUBMITTAL REQUIREMENTS AND STANDARD ENGINEERING PRINCIPALS AND PRACTICES APPEAR TO HAVE BEEN FOLLOWED. THE PROFESSIONAL ENGINEER SUBMITTING AND SEALING THE PLANS OR REPORT IS SOLELY RESPONSIBLE FOR THEIR ACCURACY AND VALIDITY. THIS REVIEW IS ONLY VALID FOR ONE (1) YEAR FROM THE DATE BELOW.

Duane Greenwood
DUANE GREENWOOD, PUBLIC WORKS DIR./CITY ENGINEER
DATE: 10/25/2011

DETAILED DRAINAGE CONSTRUCTION PLANS & SPECIFICATIONS
ENGINEER'S STATEMENT:

THESE DETAILED PLANS AND SPECIFICATIONS WERE PREPARED UNDER MY DIRECTION AND SUPERVISION. SAID DETAILED PLANS AND SPECIFICATIONS HAVE BEEN PREPARED ACCORDING TO THE CRITERIA ESTABLISHED BY THE CITY FOR DETAILED DRAINAGE PLANS AND SPECIFICATIONS. SAID DETAILED DRAINAGE PLANS AND SPECIFICATIONS MEET THE PURPOSES FOR WHICH THE PARTICULAR DRAINAGE FACILITY(IES) IS DESIGNED. I ACCEPT RESPONSIBILITY FOR LIABILITY CAUSED BY NEGLIGENT ACTS, ERRORS OR OMISSIONS, ON MY PART IN PREPARATION OF THE DETAILED DRAINAGE PLANS AND SPECIFICATIONS.

Richard N. Gray
RICHARD N. GRAY, P.E. #19310
DEVELOPER
DATE: 10/25/11

COMPANY: NORWOOD DEVELOPMENT
ADDRESS: PLAZA OF THE ROCKIES
11 S. TEJON STREET, SUITE 222
COLORADO SPRINGS, COLORADO 80903
DATE: 10/24/11

PROJECT SPECIFIC GRADING AND EROSION CONTROL NOTES

1. All earthwork required of this construction shall be completed in accordance with all applicable sections of the Project Specifications and Soil Investigation Report (Geotechnical Report).
2. Rubbish including timber, concrete rubble, trees, brush, and asphalt shall not be backfilled adjacent to any of the structures or be in the placement of any unclassified fill. The Contractor shall be responsible for the removal and hauling of such materials to a suitable spoil area. Costs associated with the removal of such materials shall be paid for as documented in the Project Specifications.
3. Excess excavation shall become the property of the Contractor and shall be disposed of at the Contractor's expense. The cost of haulage and spilling of excess excavated materials shall be paid for as documented in the Project Specifications.
4. Water shall be used as a dust palliative as required and shall be included in the cost for earthwork item(s). No separate payment will be made for dust control associated with the site construction.
5. The road grades shall be cleared of vegetation and the topsoil stockpiled for later use.
6. All grading shall be in conformance with the Geotechnical Report for the area.
7. Placement of fill for roadway embankments shall be completed in conformance with the Geotechnical Report.
8. Grading contours shown on this plan are to final grade.
9. Compaction under filled areas, including roadway and detention basin embankments, shall be 95 percent of the maximum Standard Proctor Density (ASTM D698) at two (2) percent of optimum moisture content.
10. No rubble or debris shall be placed in the backfill under any of the proposed buildings, streets, curb & gutter, sidewalk and drainage structures or within five (5) feet of a building footprint. Properly graded rubble may be used in some locations as specified and verified by the Geotechnical Engineer.
11. Contractor is responsible for reviewing the site prior to bidding to verify site conditions.
12. Contractor is responsible for providing erosion control measures as approved by the City of Fountain Dept. of Public Works Division and as may be required by the El Paso County Inspector.
13. All slopes equal to or greater than 3:1 shall require erosion control blanket, single netted fabric, American Excelsior or equal.
14. The Developer is responsible for maintaining erosion control measures until a mature stage of vegetation is established.
15. All soils used for fill must be approved by a representative of the Geotechnical Engineer.
16. All natural ground to receive fill must be properly scarified, watered and compacted prior to placing fill.
17. The Contractor is solely responsible for the design, maintenance and operation of any required dewatering system. The Contractor shall perform such independent investigation as he deems necessary to satisfy himself as to the subsurface groundwater conditions and unstable soil conditions to be encountered throughout the construction.
18. No fill shall be placed, spread or rolled while it is frozen, thawing or during unfavorable weather conditions. When the work is interrupted by heavy rain, fill operations shall not be resumed until a representative of the Geotechnical Engineer indicates that the moisture content and density of the previously placed fill are as specified. Fill surfaces may be scarified and recompacted after rainfall if necessary, to obtain proper moisture density relation.
19. Additional erosion control structures and/or grading may be required at the time of construction.
20. Sediment removal for erosion control facilities shall be performed continuously for proper function.
21. Base mapping was provided by Rockwell Consulting. The date of the survey was January 2008.
22. Proposed Construction Schedule:
Begin Construction: 01-01-2011
End Construction: FEBRUARY 28, 2012
Total Site Area = 3.8 Acres
23. Area to be disturbed = 3.8 Acres (est.)
Existing 100-year runoff coefficient = 0.40
Proposed 100-year runoff coefficient = 0.40
Existing Hydrological Soil Groups: B & C
24. Site is currently undeveloped and covered with native grasses on mild slopes (2%-7%).
25. Site is located in the Jimmy Camp Creek Drainage Basin.
26. All grading and erosion control shall be completed in accordance with the City of Fountain Municipal Code Sections 12.04.160 and 12.10

GRADING AND EROSION CONTROL NOTES

1. ALL GRADING AND EROSION CONTROL SHALL BE COMPLETED IN ACCORDANCE WITH THE CITY OF FOUNTAIN MUNICIPAL CODE SECTIONS 12.04.160 AND 12.10.
2. ALL FILL AREAS SHALL BE COMPACTED IN ACCORDANCE WITH THE GEOTECHNICAL ENGINEER'S RECOMMENDATIONS.
3. SOIL EROSION CONTROL MEASURES FOR ALL SLOPES, CHANNELS, DITCHES, OR ANY DISTURBED LAND AREA SHALL BE COMPLETED WITHIN TWENTY ONE (21) CALENDAR DAYS AFTER FINAL GRADING, OR FINAL EARTH DISTURBANCE HAS BEEN COMPLETED. AN AREA THAT IS GOING TO REMAIN IN AN INTERIM STATE FOR MORE THAN 60 DAYS SHALL ALSO BE SEEDDED. ALL TEMPORARY SOIL EROSION CONTROL MEASURES AND BMPs SHALL BE MAINTAINED UNTIL PERMANENT SOIL EROSION CONTROL MEASURES ARE IMPLEMENTED.
4. EROSION CONTROL SHALL CONSIST OF SILT FENCES AND HAY BALES AS SHOWN ON THE DRAWING, AND TOPSOIL WITH GRASS SEED WHICH WILL BE WATERED UNTIL VEGETATION HAS BEEN REESTABLISHED.
5. EROSION CONTROL BALES OR SILT FENCE SHALL BE PLACED AT THE TOE AND DRAINAGE OUTFALL POINTS OF ALL SLOPES 4:1 OR STEEPER TO PREVENT SILTATION ON STREETS. REFER TO STORM WATER MANAGEMENT PLAN FOR DETAIL AND LOCATION OF EROSION CONTROL MEASURES.
6. CONTRACTOR SHALL COMPLY WITH ALL LOCAL, COUNTY AND STATE REGULATIONS PERTAINING TO GRADING, DUST AND EROSION.
7. NATURAL VEGETATION SHALL BE RETAINED AND PROTECTED WHEREVER POSSIBLE. EXPOSURE OF SOIL TO EROSION BY REMOVAL OR DISTURBANCE OF VEGETATION SHALL BE LIMITED TO THE AREA REQUIRED FOR IMMEDIATE CONSTRUCTION OPERATIONS AND FOR THE SHORTEST PRACTICAL PERIOD OF TIME.
8. TOPSOIL SHALL BE STOCKPILED TO THE EXTENT PRACTICABLE ON THE SITE FOR USE ON AREAS TO BE REVEGETATED. ANY AND ALL STOCKPILES SHALL BE LOCATED AND PROTECTED FROM EROSION ELEMENTS.
9. AT ALL TIMES, THE PROPERTY SHALL BE MAINTAINED AND/OR WATERED TO PREVENT WIND-CAUSED EROSION. EARTHWORK OPERATIONS SHALL BE DISCONTINUED WHEN FUGITIVE DUST SIGNIFICANTLY IMPACTS ADJACENT PROPERTY. IF EARTHWORK IS COMPLETE OR DISCONTINUED AND DUST FROM THE SITE CONTINUES TO CREATE PROBLEMS, THE OWNER/DEVELOPER SHALL IMMEDIATELY INSTITUTE MITIGATIVE MEASURES AND SHALL CORRECT DAMAGE TO ADJACENT PROPERTY.
10. ALL PERSONS ENGAGED IN EARTH DISTURBANCE SHALL IMPLEMENT AND MAINTAIN ACCEPTABLE SOIL EROSION AND SEDIMENT CONTROL MEASURES INCLUDING BMPs IN CONFORMANCE WITH THE EROSION CONTROL TECHNICAL STANDARDS OF THE MANUAL AND IN ACCORDANCE WITH THE EROSION AND STORMWATER QUALITY CONTROL PLAN APPROVED BY THE CITY OF FOUNTAIN, IF REQUIRED.
11. ALL EARTH DISTURBANCE SHALL BE CONDUCTED IN SUCH A MANNER SO AS TO EFFECTIVELY REDUCE ACCELERATED SOIL EROSION.
12. ALL EARTH DISTURBANCE SHALL BE DESIGNED, CONSTRUCTED, AND COMPLETED IN SUCH A MANNER SO THAT THE EXPOSED AREA OF ANY DISTURBED LAND SHALL BE LIMITED TO THE SHORTEST PRACTICAL PERIOD OF TIME.
13. ALL EARTH DISTURBANCE SHALL BE DONE IN A MANNER THAT MINIMIZES POLLUTION OF ANY ON-SITE OR OFF-SITE WATERS.
14. SUSPENDED SEDIMENT CAUSED BY ACCELERATED SOIL EROSION SHALL BE MINIMIZED IN RUNOFF WATER BEFORE IT LEAVES THE SITE.
15. TEMPORARY SOIL EROSION CONTROL FACILITIES SHALL BE REMOVED AND EARTH DISTURBANCE AREAS GRADED AND STABILIZED WITH PERMANENT SOIL EROSION CONTROL MEASURES PURSUANT TO THE STANDARDS AND SPECIFICATIONS PRESCRIBED IN THE MANUAL, AND IN ACCORDANCE WITH THE PERMANENT EROSION CONTROL FEATURES SHOWN ON THE EROSION AND STORMWATER CONTROL PLANS APPROVED BY THE CITY OF FOUNTAIN, IF REQUIRED.
16. ANY STREET OR DRAINAGE FACILITY WHICH HAS HAD EROSION SEDIMENT DEPOSITED IN IT DUE TO CONSTRUCTION, GRADING, OR OTHER DEVELOPMENT ACTIVITY, MUST BE CLEANED IMMEDIATELY AT THE EXPENSE OF THE CONTRACTOR, DEVELOPER, HOMEOWNER, OR WHOEVER IS RESPONSIBLE FOR THE CONSTRUCTION, GRADING, OR LAND DEVELOPMENT ACTIVITY. IF THE FACILITY IS NOT CLEANED IMMEDIATELY OR WITHIN A RESPONSIBLE PERIOD OF TIME AFTER NOTIFICATION BY THE CITY, THE CITY MAY PERFORM THE WORK OR HAVE THE WORK DONE AND BILL THE RESPONSIBLE PARTY.
17. IT IS THE RESPONSIBILITY OF THE OWNER TO ENSURE THAT VEHICLE TRACKING CONTROL IS IN PLACE, FUNCTIONAL, AND MAINTAINED THROUGHOUT THE CONSTRUCTION PHASE OF THIS PROJECT.
18. INDIVIDUALS SHALL COMPLY WITH THE "COLORADO WATER QUALITY CONTROL ACT" (TITLE 25, ARTICLE 8, CRS), AND THE "CLEAN WATER ACT" (33USC 1344), REGULATIONS PROMULGATED, CERTIFICATIONS OR PERMITS ISSUED, IN ADDITION TO CITY OF FOUNTAIN REQUIREMENTS. IN THE EVENT OF CONFLICTS BETWEEN THESE REQUIREMENTS, THE MORE RESTRICTIVE LAWS, RULES, OR REGULATIONS SHALL APPLY.

PREPARED BY:


Kiowa Engineering Corporation

1604 South 21st Street
Colorado Springs, Colorado
80904-4208
[719] 630-7342


DEVELOPER:

NORWOOD DEVELOPMENT
PLAZA OF THE ROCKIES
11 S. TEJON STREET, SUITE 222
COLORADO SPRINGS, COLORADO 80903


Kiowa Project No. 09061
October 25, 2011

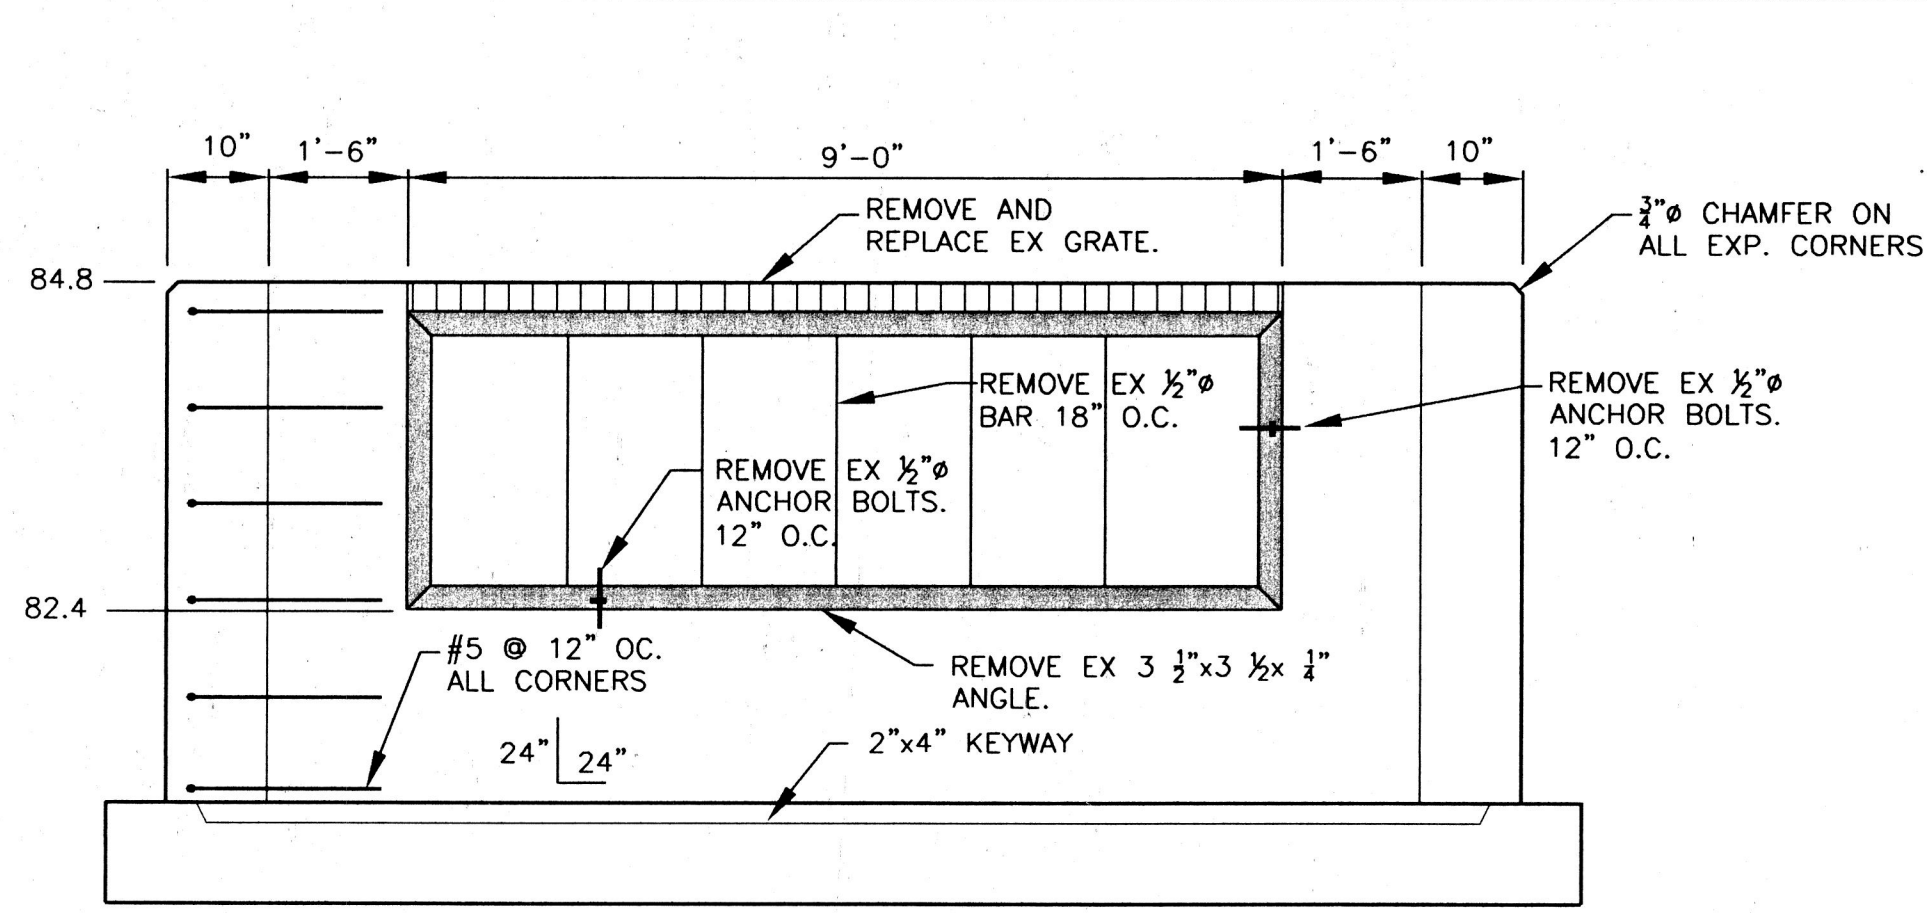


SECTION C-C
SCALE: 1"=2'

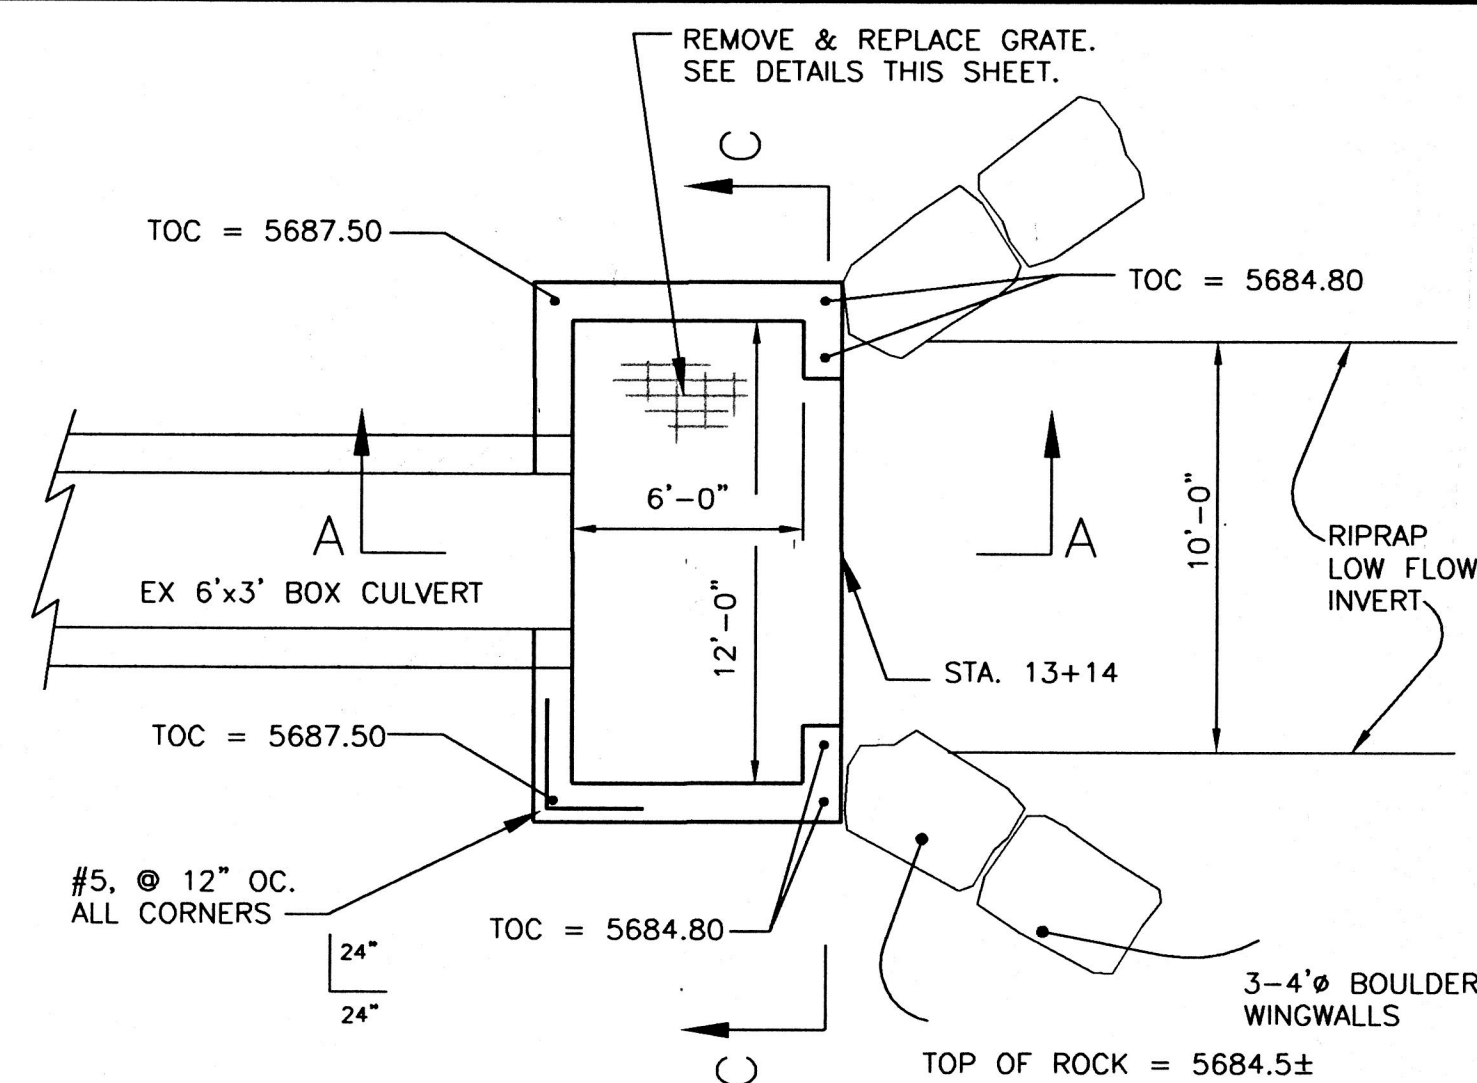


EX. OUTLET STRUCTURE PLAN
SCALE: N.T.S.

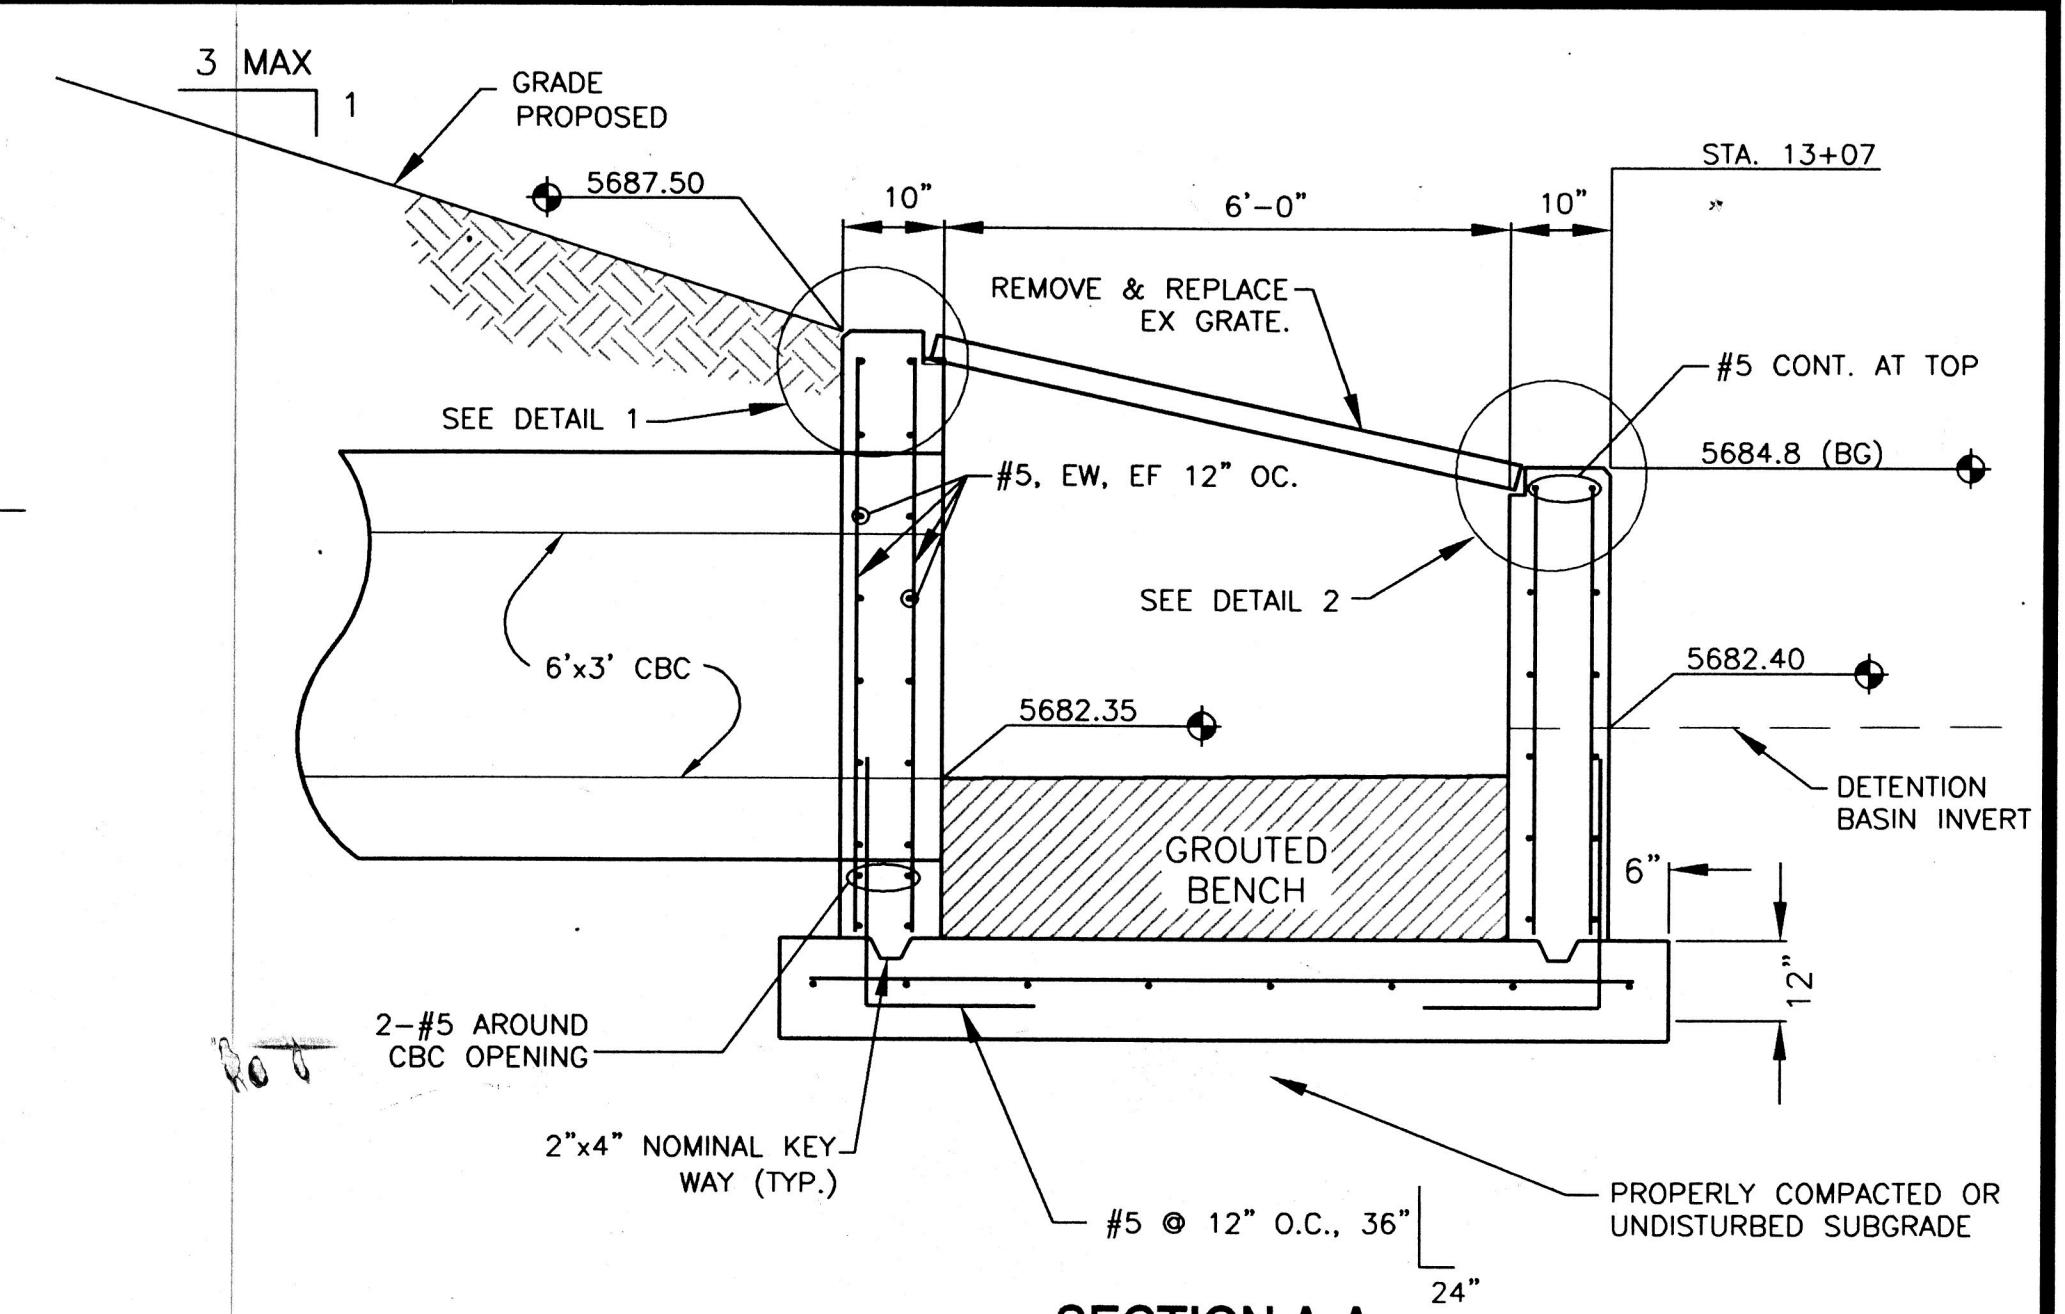


SECTION A-A
SCALE: 1"=2'

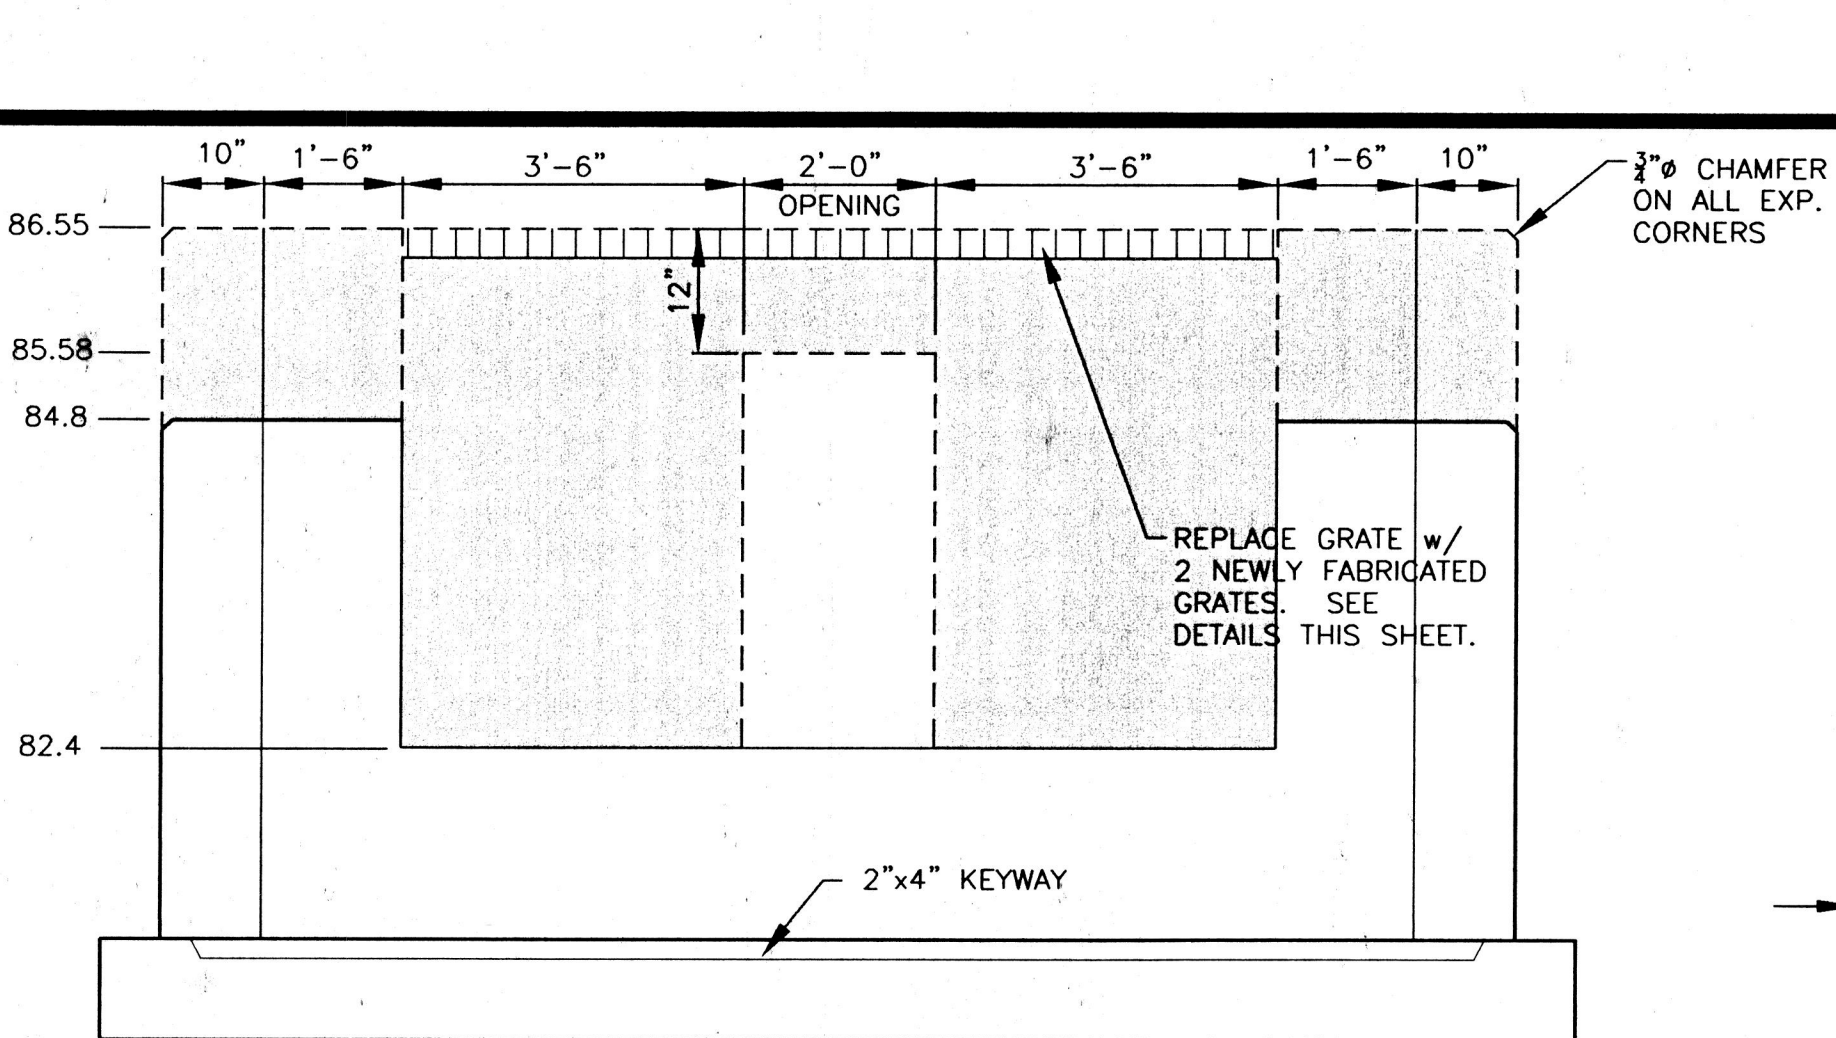


SECTION C-C
SCALE: 1"=2'

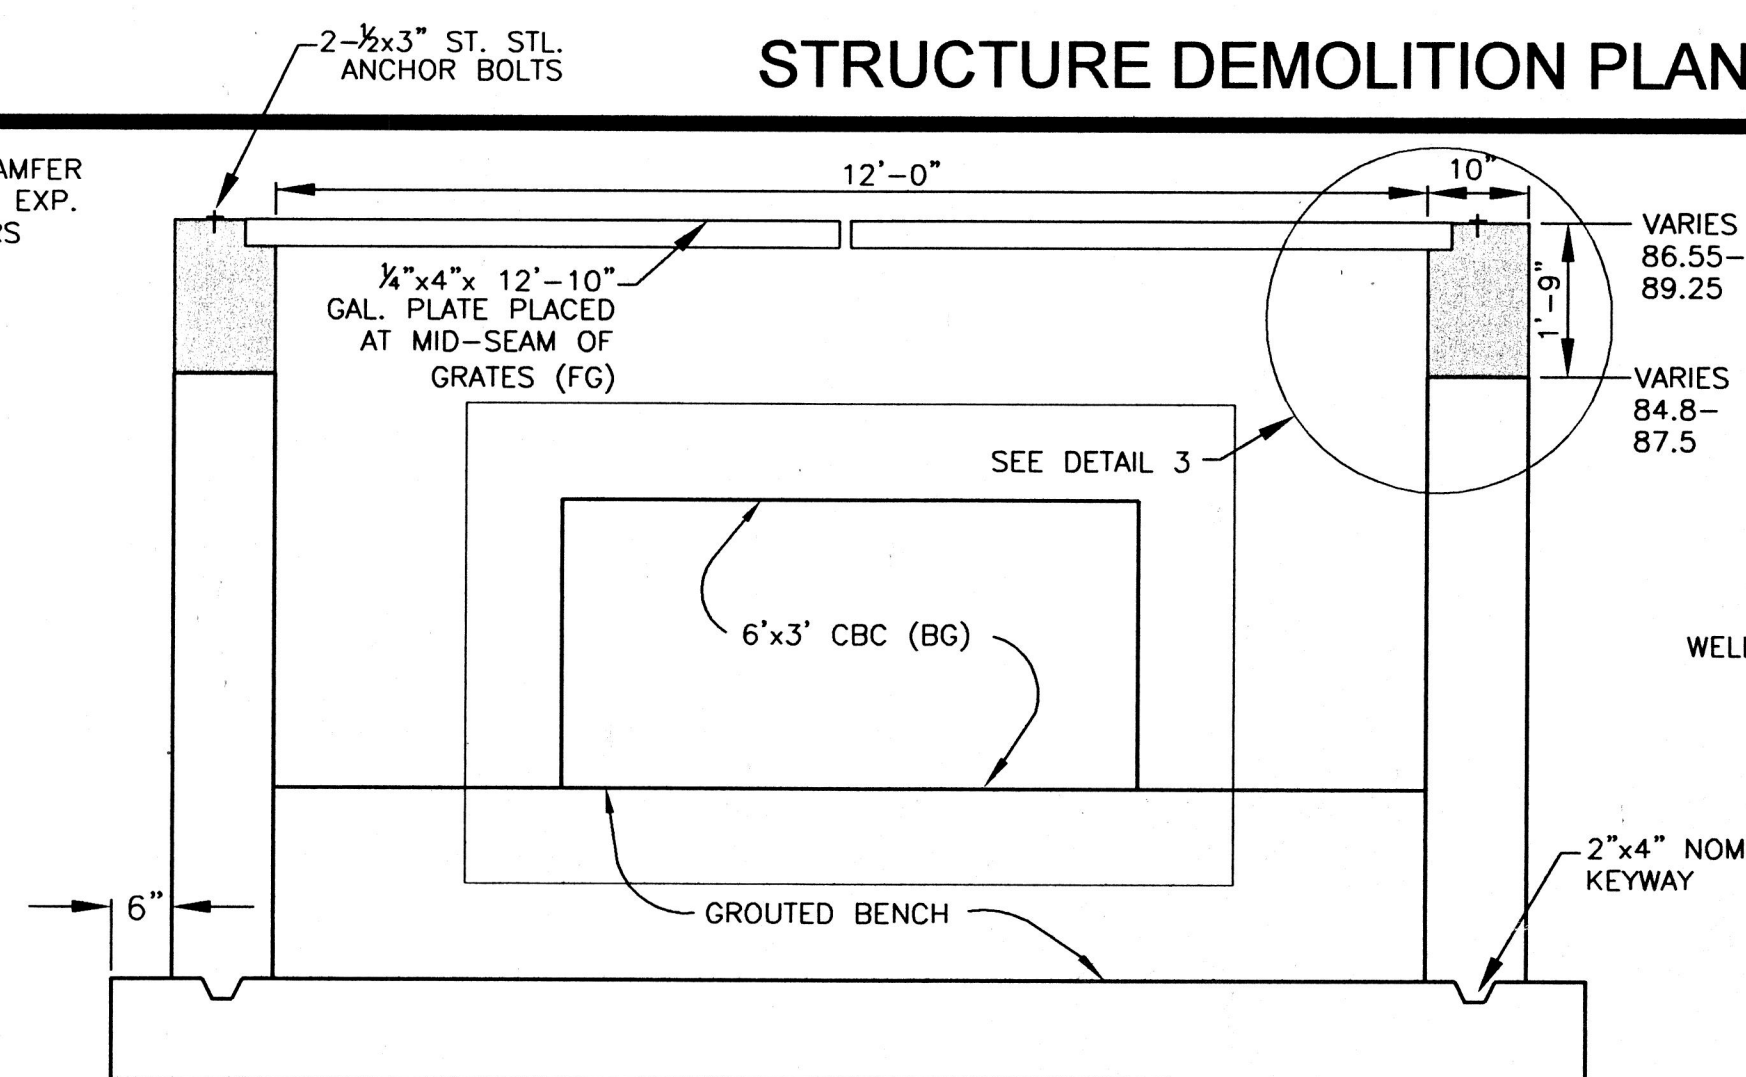


STRUCTURE DEMOLITION PLAN

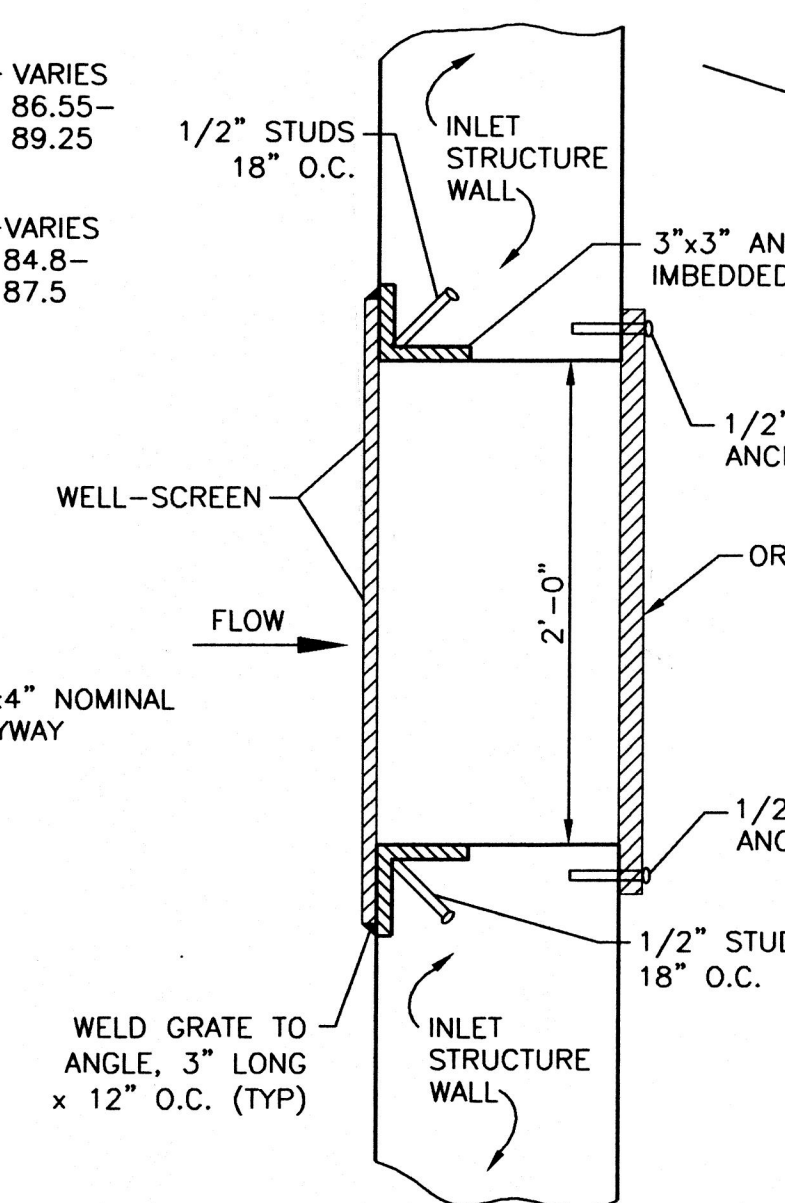


TRASH RACK DETAIL
SCALE: N.T.S.

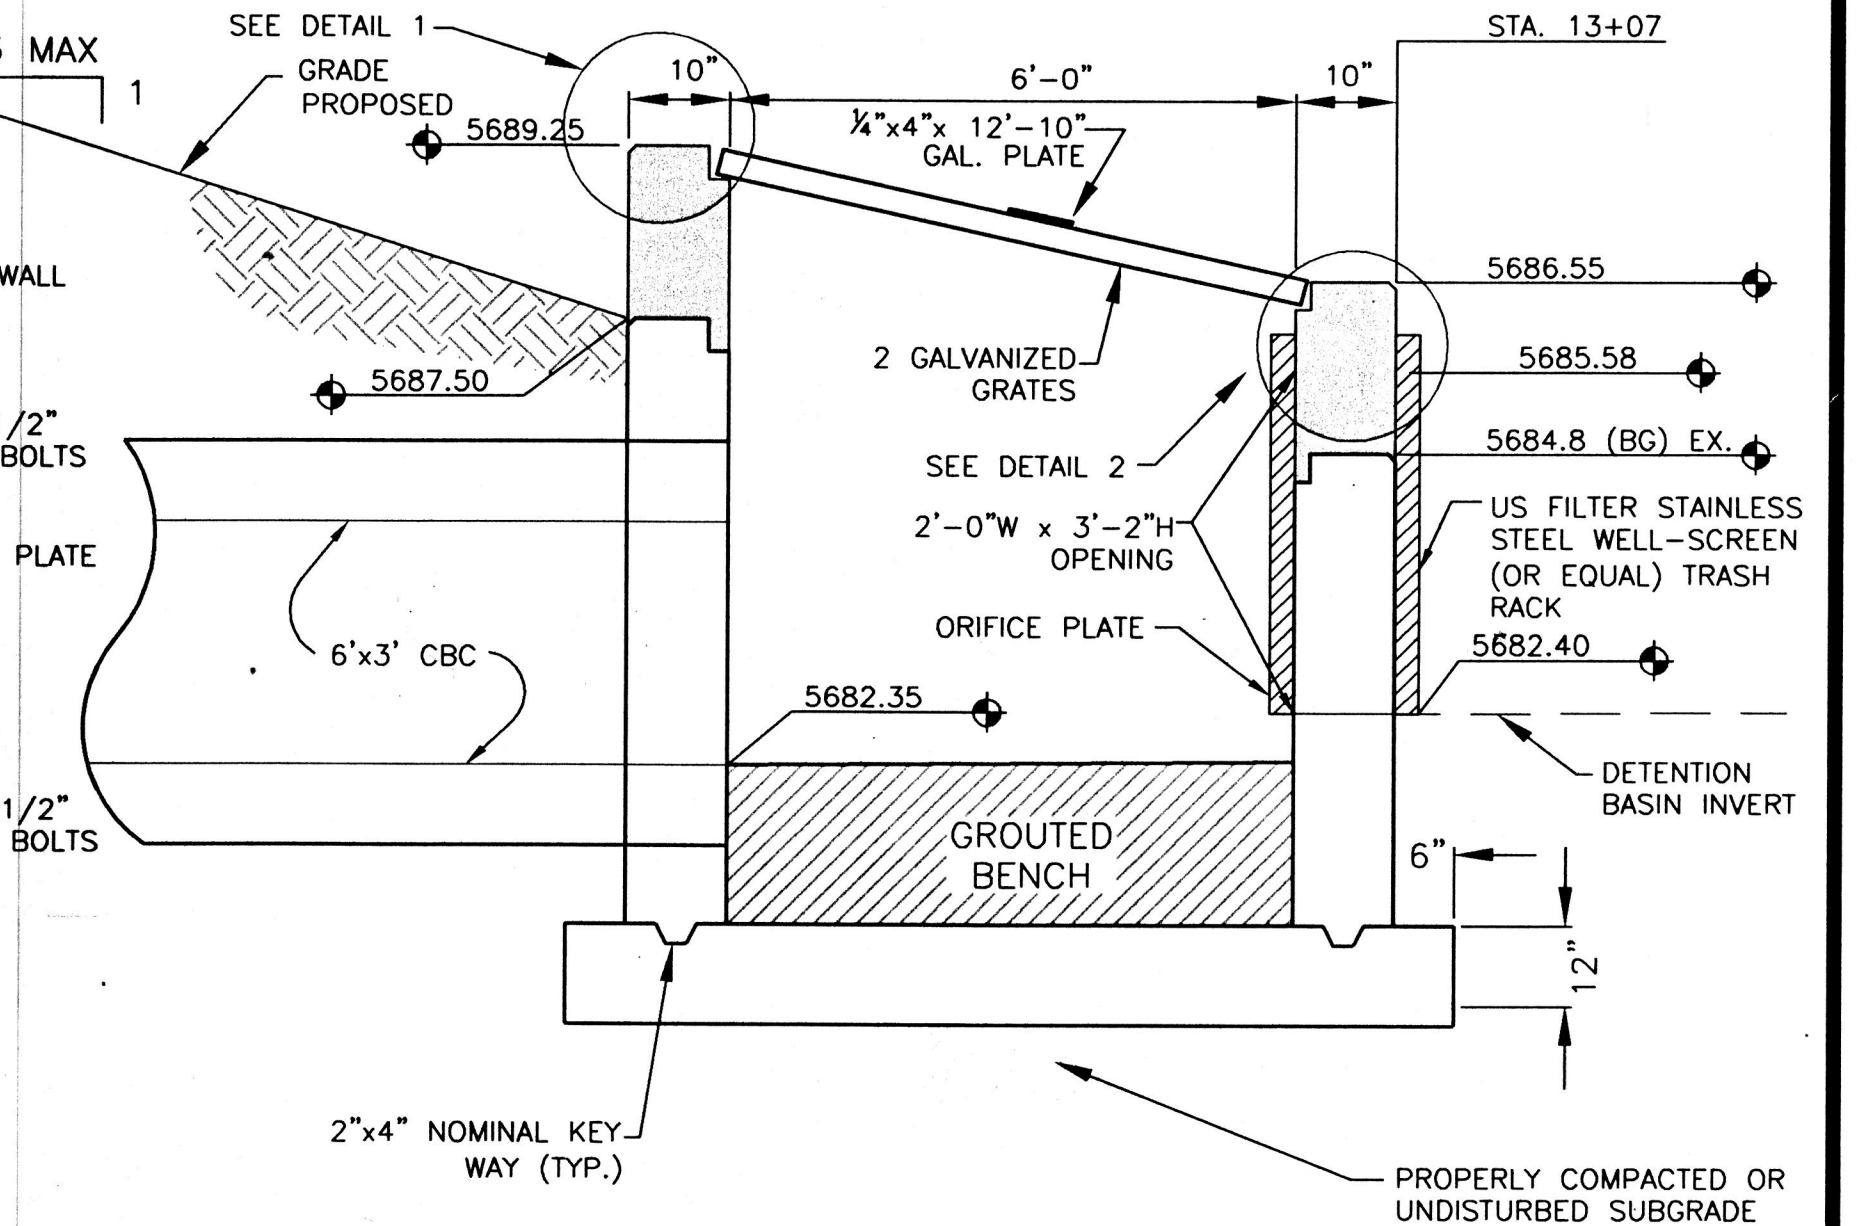


SECTION A-A
SCALE: 1"=2'

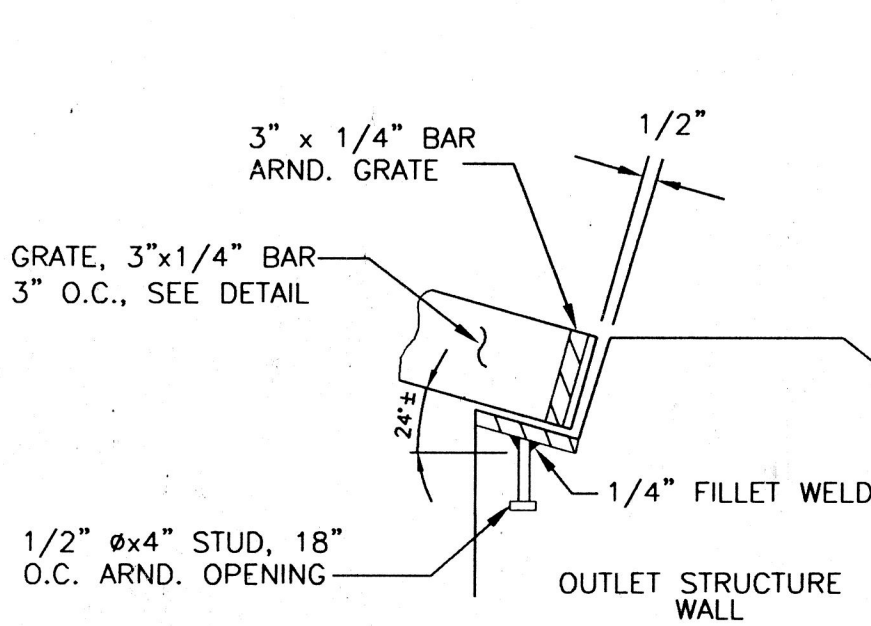


DETAIL 2
SCALE: N.T.S.

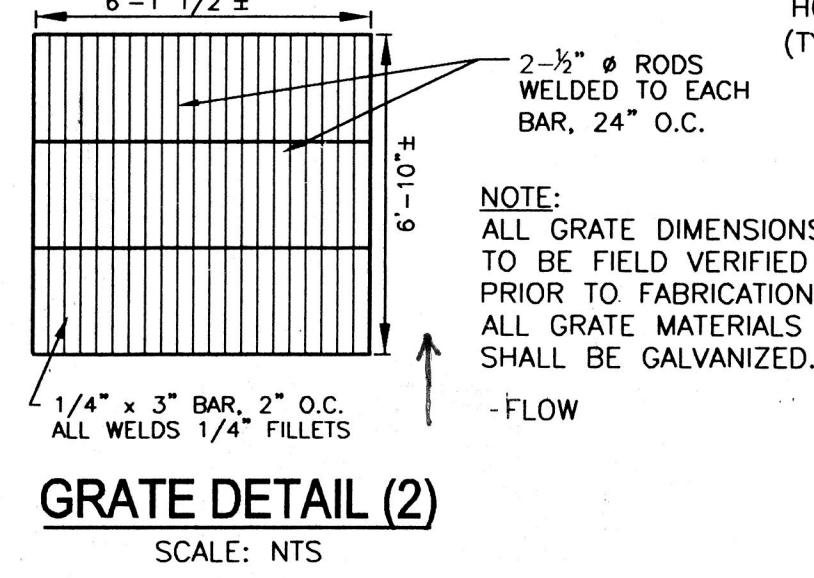


GRATE DETAIL (2)
SCALE: N.T.S.

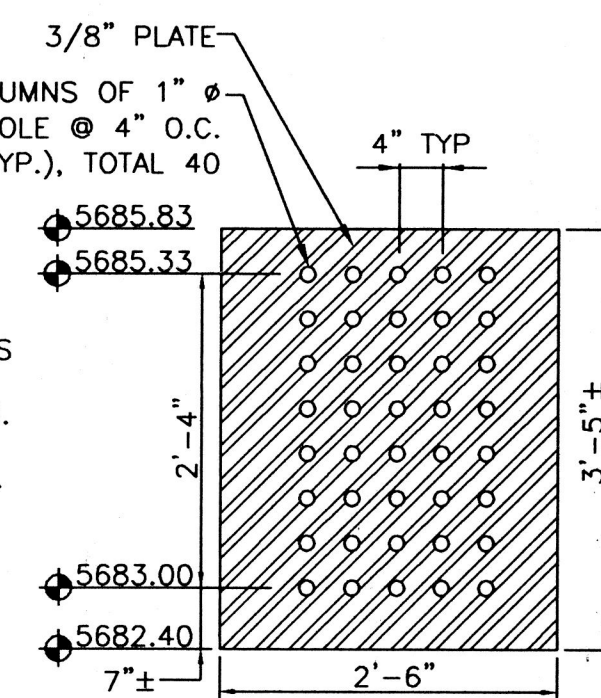

ORIFICE PLATE HOLE DETAIL
SCALE: N.T.S.

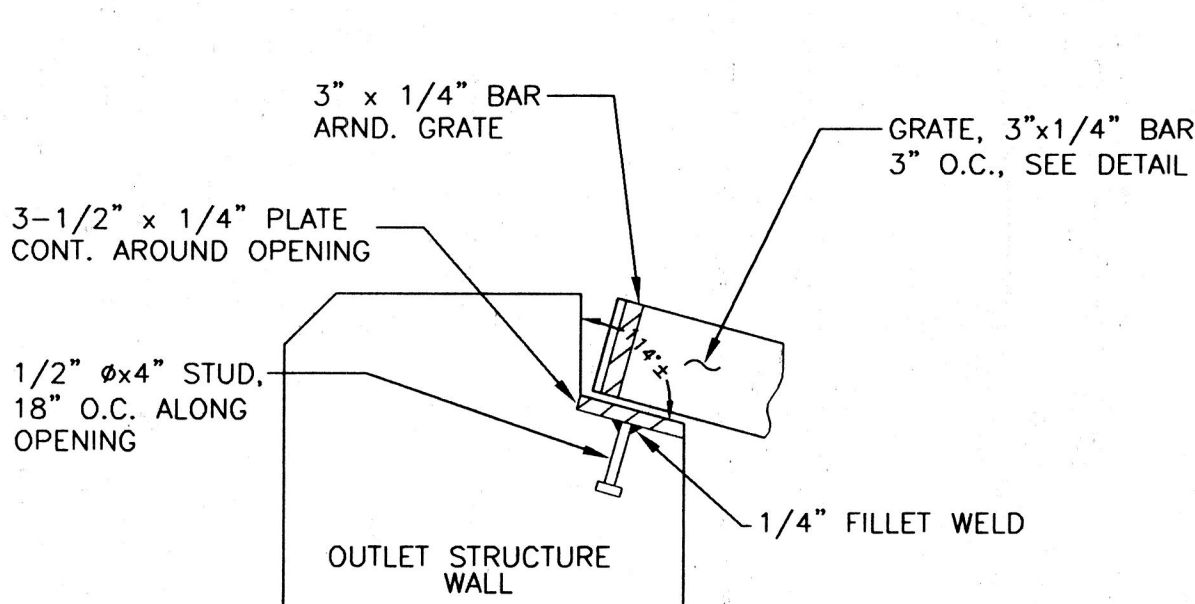


DETAIL 1
SCALE: N.T.S.

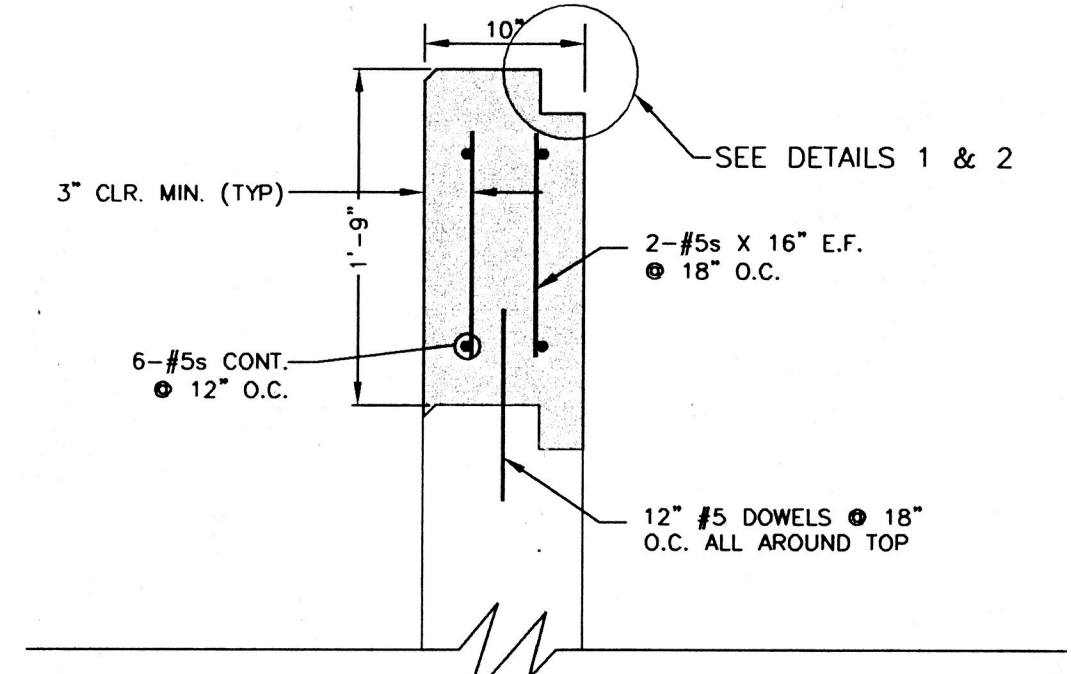


DETAIL 3
SCALE: 1/2"=1'-0"

SECTION B-B
SCALE: 1"=2'

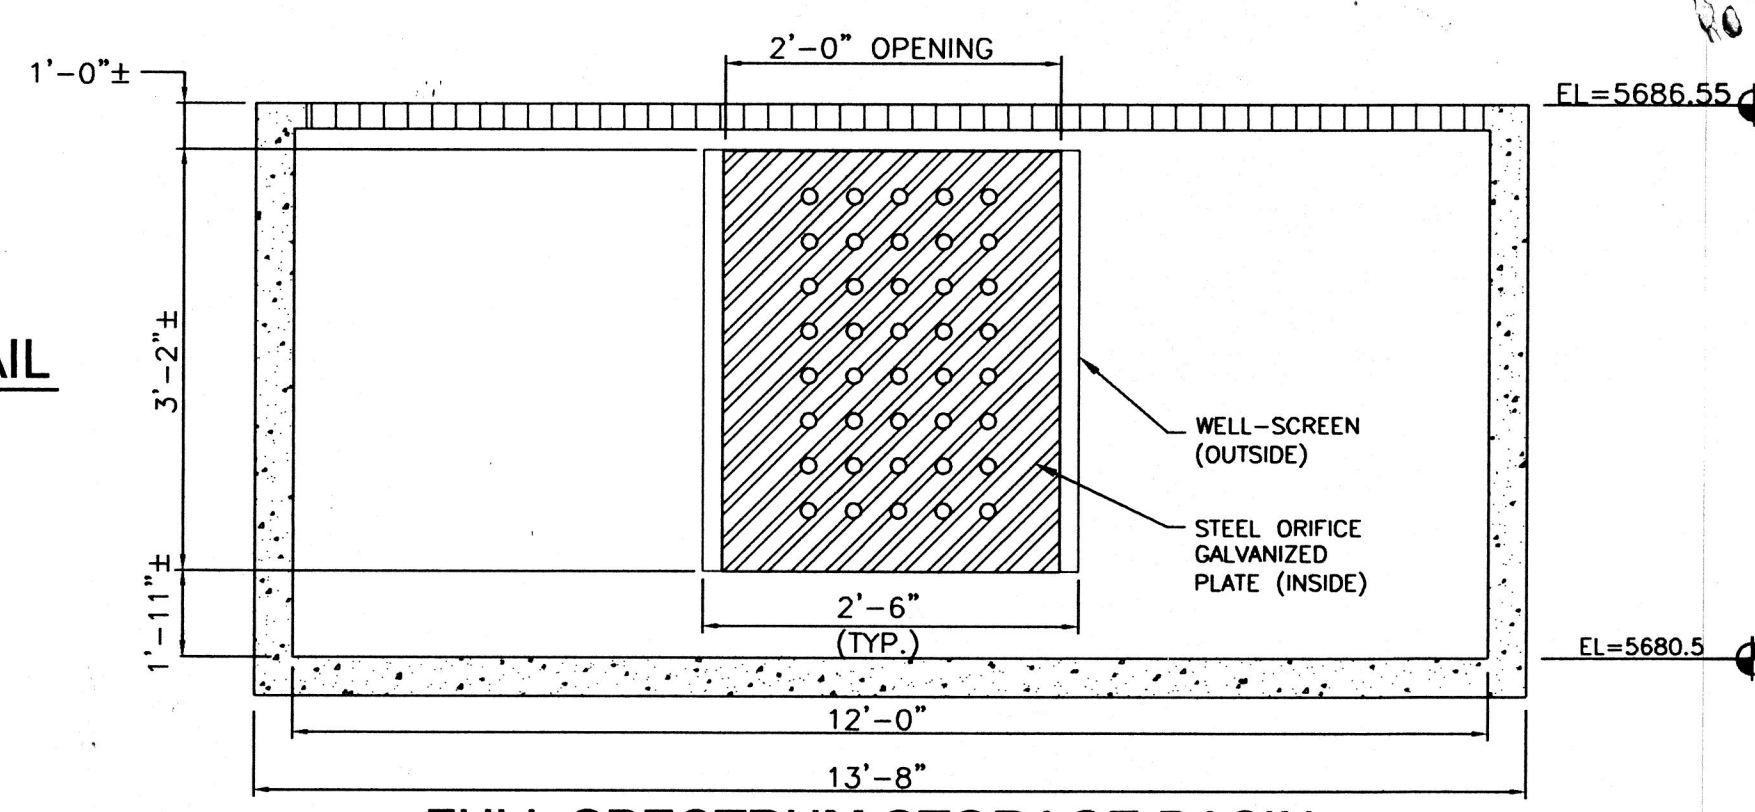

FULL SPECTRUM STORAGE BASIN OUTLET STRUCTURE ELEVATION DETAIL
SCALE: N.T.S.

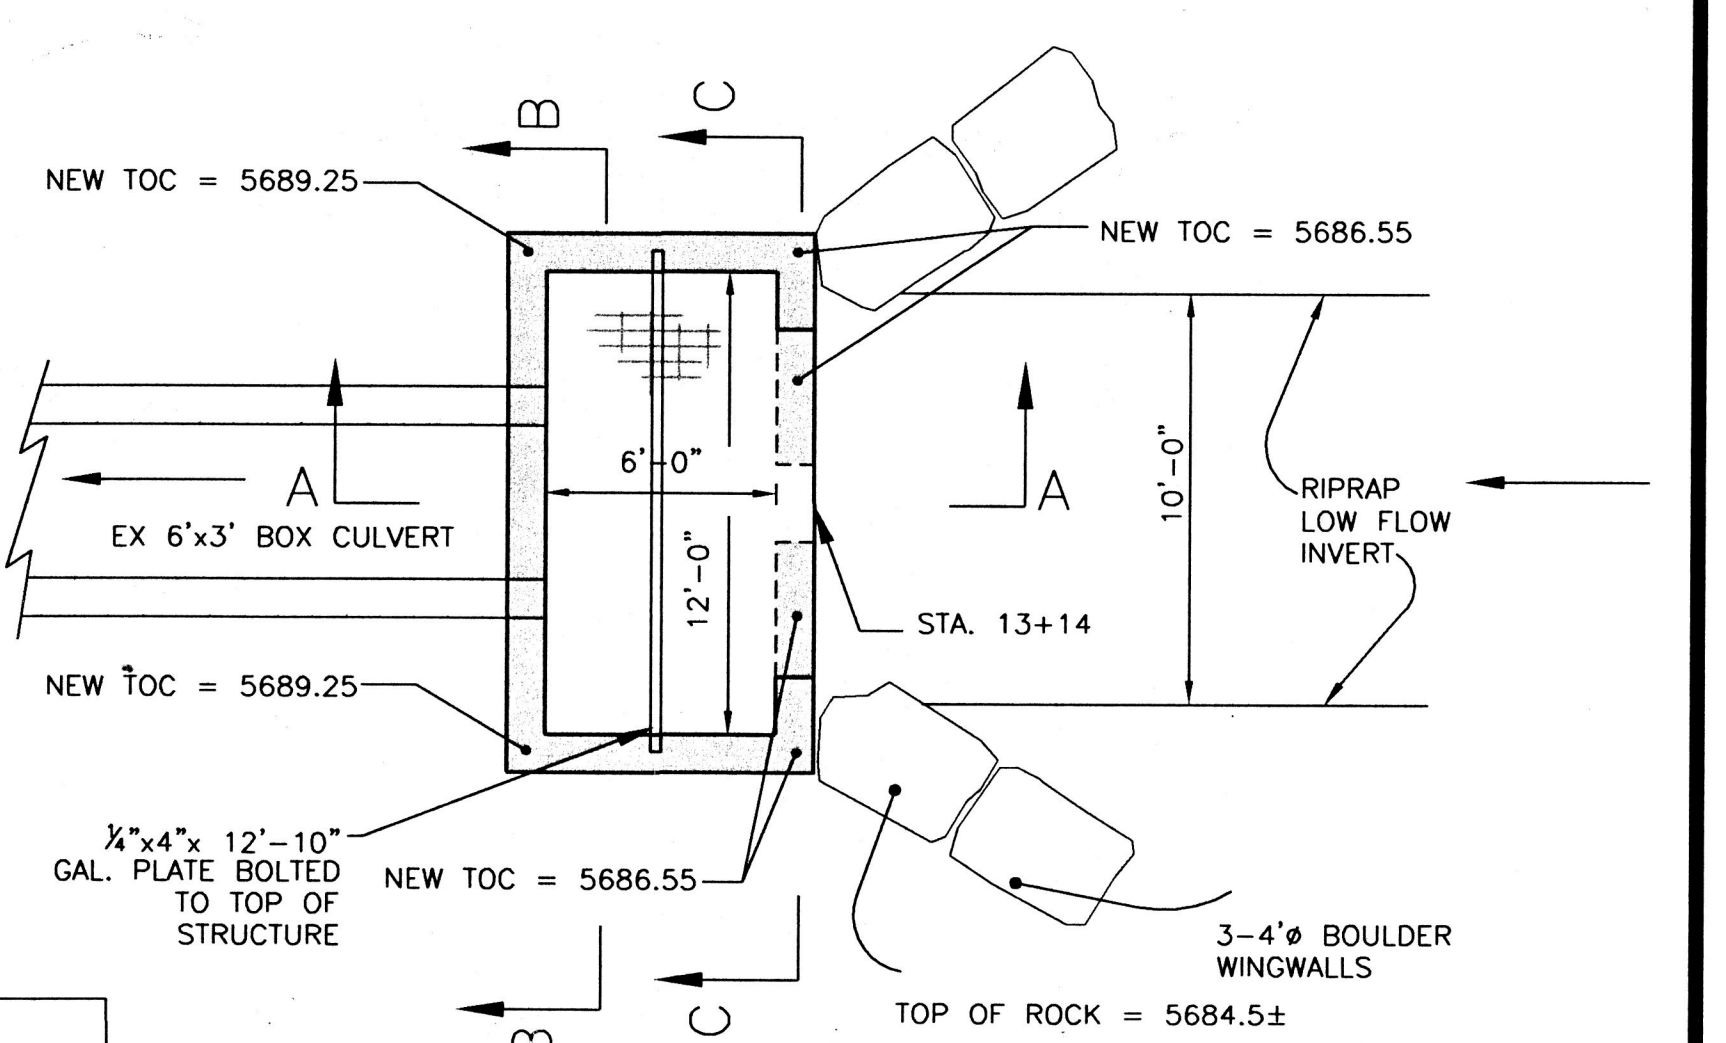

OUTLET STRUCTURE PLAN
SCALE: N.T.S.


NOTE: ALL METAL PLATE & EMBEDMENTS SHALL BE GALVANIZED STEEL. ALL BOLTS & NUTS SHALL BE STAINLESS STEEL.

Kiowa Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado
80904-4208
(719) 630-7342

MESA RIDGE FILINGS 8 & 9 - DETENTION BASIN 'D'
FULL SPECTRUM DETENTION MODIFICATIONS
OUTLET STRUCTURE DETAILS
FOUNTAIN, COLORADO

| | |
|--------------|------------------|
| Project No.: | 09061 |
| Date: | October 24, 2011 |
| Design: | RNW |
| Drawn: | JGD |
| Check: | RNW |
| Revisions: | |

APPENDIX F – DRAINAGE MAPS

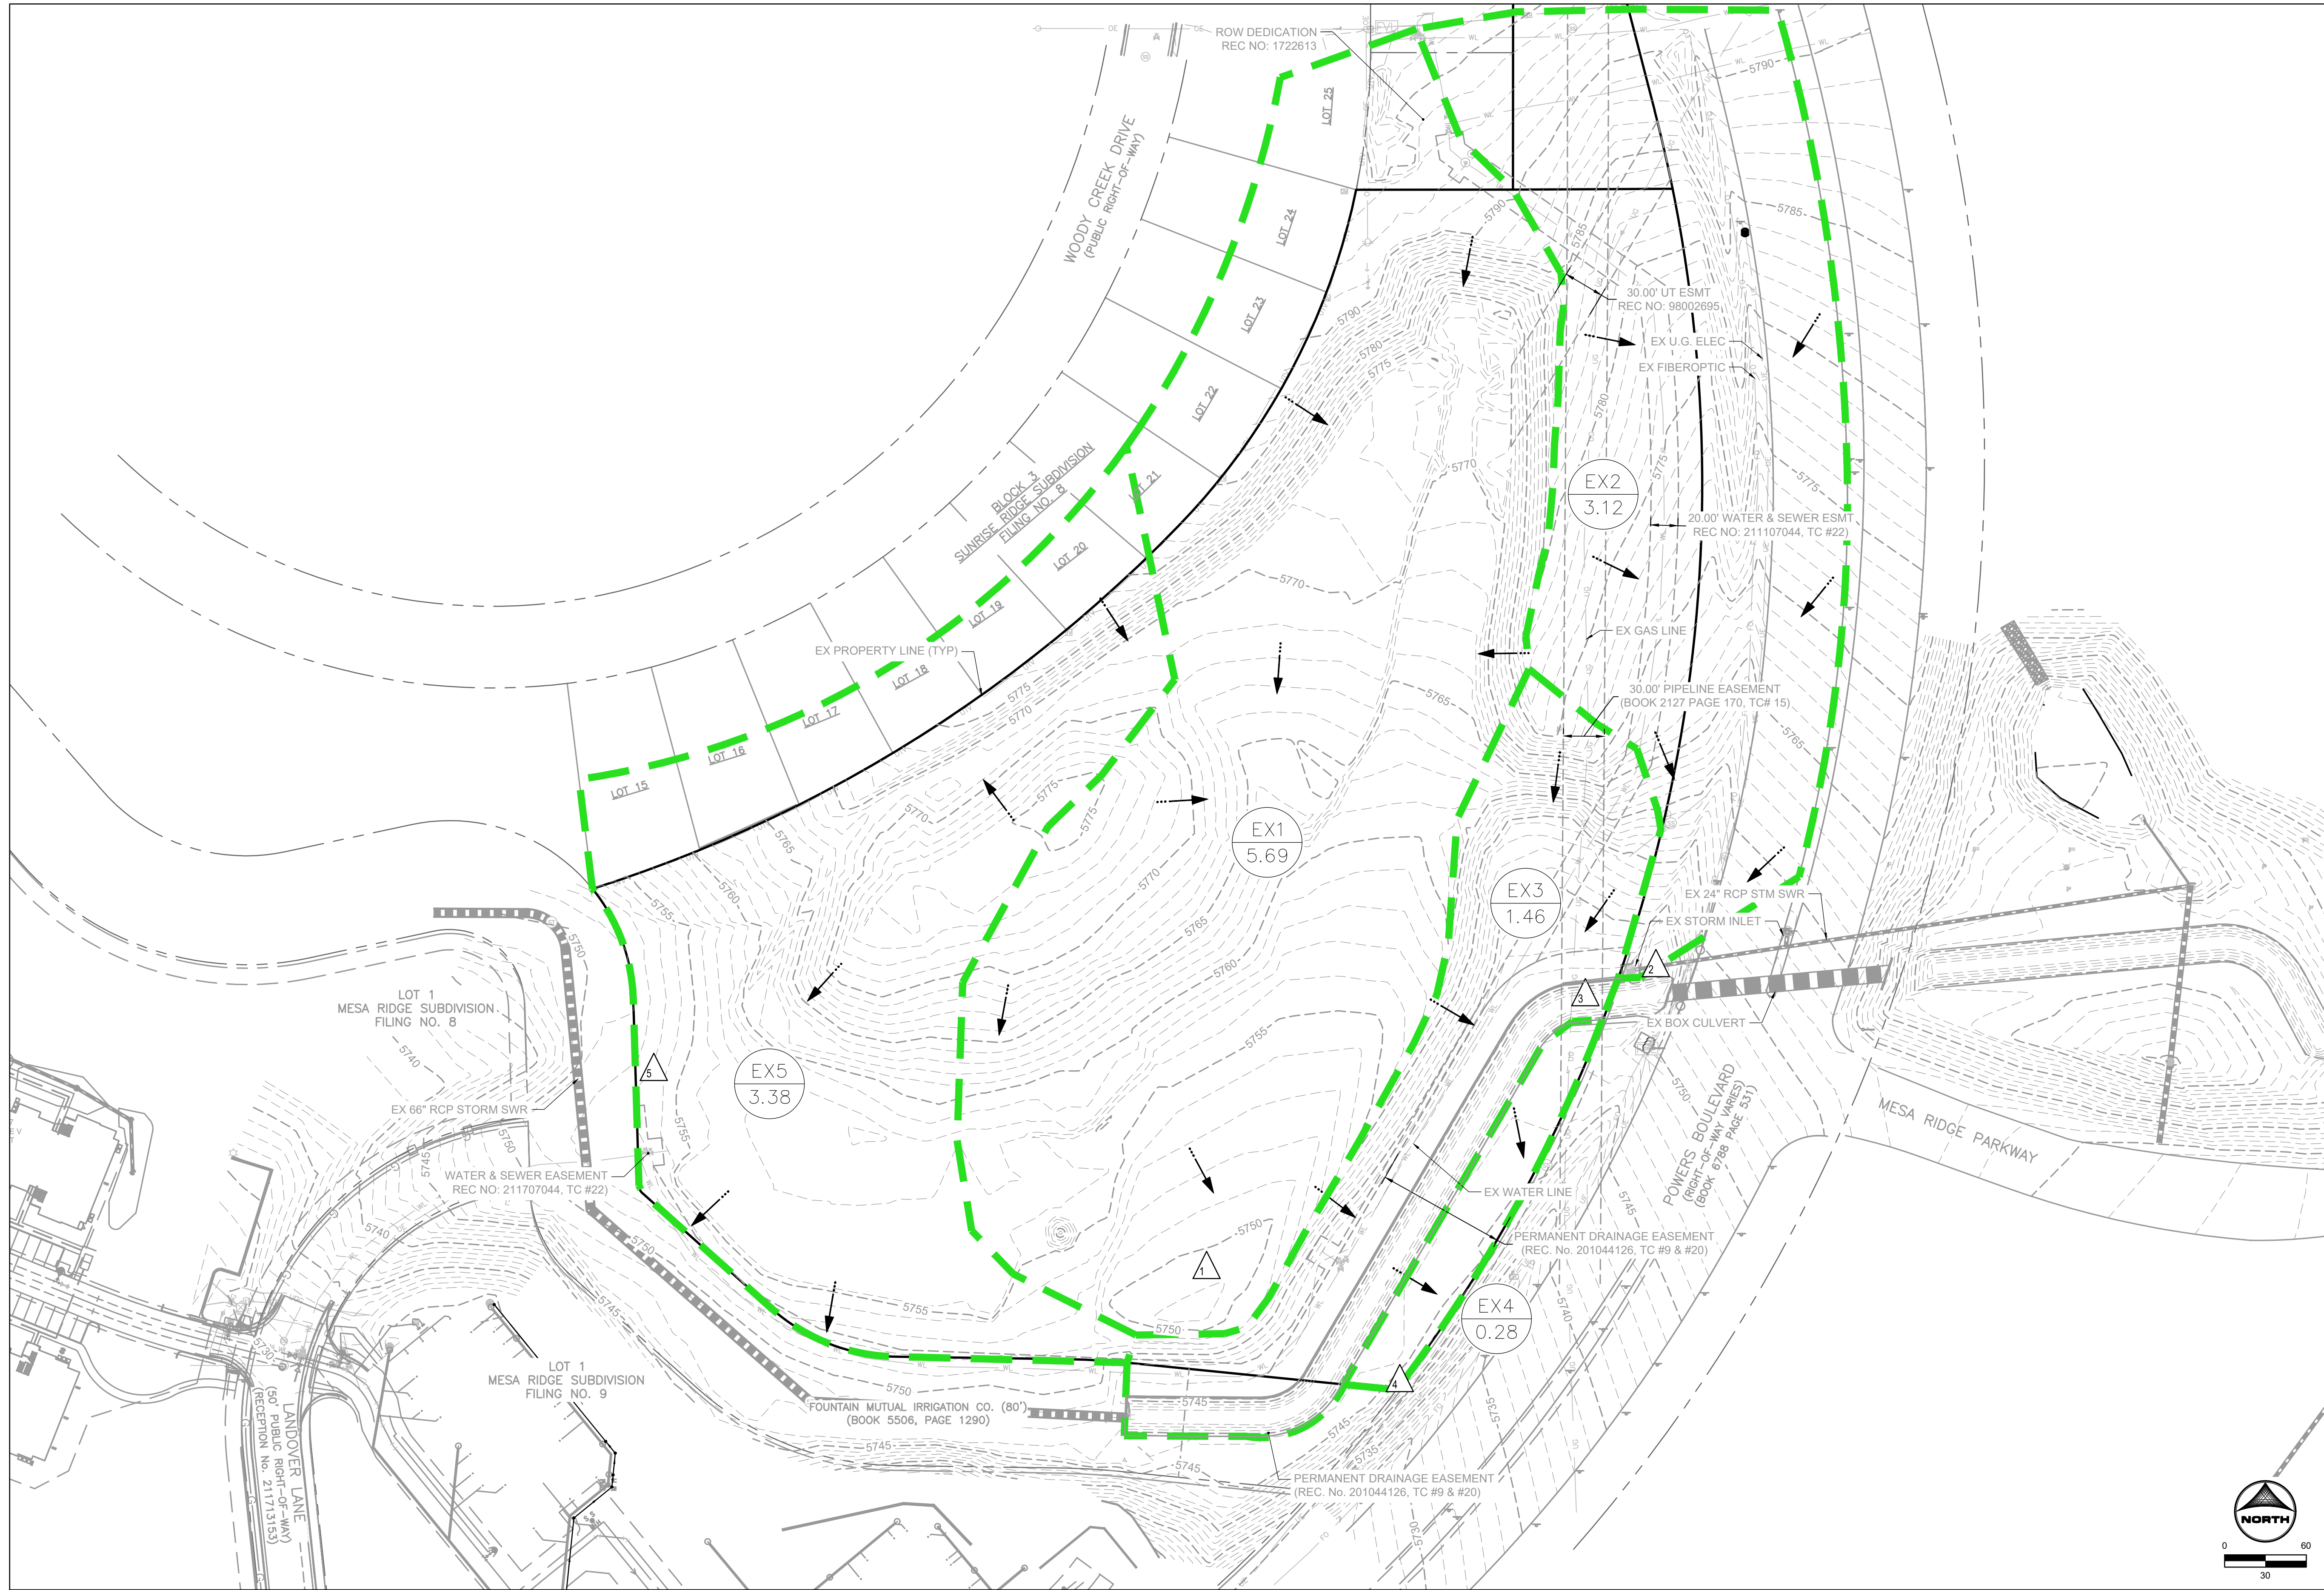

LEGEND:

| | |
|---------------------------|------------------|
| PROPOSED MAJOR CONTOUR | — 5250 — |
| PROPOSED MINOR CONTOUR | — 5250 — |
| EXISTING MAJOR CONTOUR | - - - 5250 - - - |
| EXISTING MINOR CONTOUR | - - - - - |
| PROPOSED STORM DRAIN PIPE | — — — — — |
| EXISTING STORM DRAIN PIPE | — — — — — |
| PROPOSED DRAINAGE SWALE | — — — — — |
| PROPERTY LINE | — — — — — |
| EXISTING FLOW DIRECTION | ← |
| SUB BASIN LINE | — — — — — |
| DESIGN POINT | △ |
| PROPOSED BASIN LABEL | 11 1.25 |
| BASIN DESIGNATION | △ |
| AREA (AC.) | 1.25 |

| SUMMARY RUNOFF TABLE | | | | |
|----------------------|-----------|--------------|----------------------|------------------------|
| BASIN | AREA (ac) | % IMPERVIOUS | Q ₅ (cfs) | Q ₁₀₀ (cfs) |
| EX1 | 5.69 | 7 | 2.5 | 13.7 |
| EX2 | 3.12 | 28 | 4.2 | 12.4 |
| EX3 | 1.46 | 24 | 1.6 | 5.1 |
| EX4 | 0.28 | 2 | 0.1 | 0.8 |
| EX5 | 3.38 | 15 | 2.8 | 11.9 |

| DESIGN POINT SUMMARY TABLE | | | |
|----------------------------|----------------|-----------------------|-------------------------|
| DESIGN POINT | UPSTREAM BASIN | ΣQ ₅ (cfs) | ΣQ ₁₀₀ (cfs) |
| 1 | EX1 | 2.5 | 13.7 |
| 2 | EX2 | 4.2 | 12.4 |
| 3 | EX3 | 1.6 | 5.1 |
| 4 | EX4 | 0.1 | 0.8 |
| 5 | EX5 | 2.8 | 11.9 |

| | | |
|--|--------------------|--|
| DRAWN BY: YOU | JOB DATE: 8/9/2021 | BAR IS ONE INCH ON OFFICIAL DRAWINGS. 0" = 1" IF NOT ONE INCH, ADJUST SCALE ACCORDINGLY. |
| APPROVED: KEN | JOB NUMBER: 200541 | |
| CAD DATE: 8/10/2021 | | |
| CAD FILE: J:\2020\200541\CAD\Drawings\CDrainage\Ex_Drn_Map | | |

| NO. | DATE | BY | REVISION DESCRIPTION |
|-----|------|----|----------------------|
| | | | |
| | | | |
| | | | |

HR GREEN - COLORADO SPRINGS

7222 COMMERCE CENTER DR SUITE 220
COLORADO SPRINGS CO 80919

PHONE: 719.300.4140 TOLL FREE: 800.728.7805
FAX: 844.273.1057 | HRGreen.com

THE COTTAGES AT MESA RIDGE

GOODWIN KNIGHT

EL PASO COUNTY, COLORADO

PRELIMINARY DRAINAGE REPORT

EXISTING DRAINAGE MAP

| | |
|-------|---|
| SHEET | 1 |
| DRN | |



LEGEND:

- PROPOSED MAJOR CONTOUR — 5250 —
- PROPOSED MINOR CONTOUR - - - 5250 - - -
- EXISTING MAJOR CONTOUR - - - 5250 - - -
- EXISTING MINOR CONTOUR - - - 5250 - - -
- PROPOSED STORM DRAIN PIPE ———
- EXISTING STORM DRAIN PIPE ———
- PROPOSED DRAINAGE SWALE ———
- PROPERTY LINE ———
- PROPOSED FLOW DIRECTION ———
- EXISTING FLOW DIRECTION ———
- SUB BASIN LINE ———

- DESIGN POINT ———
- PROPOSED BASIN LABEL ———
- BASIN DESIGNATION ———
- AREA (AC.) ———

SUMMARY RUNOFF TABLE

| BASIN | AREA (ac) | % IMPERVIOUS | Q ₅ (cfs) | Q ₁₀₀ (cfs) |
|-------|-----------|--------------|----------------------|------------------------|
| 1 | 3.56 | 63 | 7.6 | 16.1 |
| 2 | 4.93 | 59 | 9.5 | 20.3 |
| 3 | 3.03 | 29 | 3.4 | 9.7 |
| 4 | 0.52 | 8 | 0.4 | 1.8 |
| 5 | 1.50 | 32 | 2.1 | 5.7 |
| 6 | 0.63 | 2 | 0.2 | 1.2 |
| 7 | 0.56 | 26 | 0.5 | 1.6 |
| 8 | 0.24 | 100 | 1.1 | 2.0 |
| 9 | 0.14 | 100 | 0.7 | 1.2 |

DESIGN POINT SUMMARY TABLE

| DESIGN POINT | UPSTREAM BASIN | ΣQ ₅ (cfs) | ΣQ ₁₀₀ (cfs) |
|--------------|----------------|-----------------------|-------------------------|
| 1 | 1 | 7.6 | 16.1 |
| 2 | 2 | 9.5 | 20.3 |
| 2.1 | 3 | 15.6 | 29.9 |
| 3 | 4 | 3.4 | 9.7 |
| 4 | 5 | 0.4 | 1.8 |
| 5 | 5 | 2.1 | 5.7 |
| 6 | 6 | 0.2 | 1.2 |
| 7 | 7 | 0.5 | 1.6 |
| 8 | 8 | 1.1 | 2.0 |
| 9 | 9 | 1.1 | 1.2 |
| 9.1 | 8&9 | 17.1 | 39.6 |

DRAWN BY: NJQ JOB DATE: 8/11/2021
APPROVED: KMH JOB NUMBER: 200541
CAD DATE: 8/11/2021
CAD FILE: J:\2020\200541\CAD\Drawings\C\Drainage\Pr_Drn_Map

BAR IS ONE INCH ON
OFFICIAL DRAWINGS.
0 1"
IF NOT ONE INCH,
ADJUST SCALE ACCORDINGLY.

| NO. | DATE | BY | REVISION DESCRIPTION |
|-----|------|----|----------------------|
| | | | |
| | | | |
| | | | |



HR GREEN - COLORADO SPRINGS
7222 COMMERCE CENTER DR SUITE 220
COLORADO SPRINGS CO 80919
PHONE: 719.300.4140 TOLL FREE: 800.728.7805
FAX: 844.273.1057 | HRGreen.com

THE COTTAGES AT MESA RIDGE
GOODWIN KNIGHT
EL PASO COUNTY, COLORADO



PRELIMINARY DRAINAGE REPORT
PROPOSED DRAINAGE MAP

SHEET
DRN

1