



INNOVATIVE DESIGN. CLASSIC RESULTS.

**PRELIMINARY DRAINAGE REPORT
FOR
TRIPLE H RANCH - PRELIMINARY PLAN**

Prepared for:
P760 LAND, LLC
13395 VOYAGER PKWY., SUITE 130
COLORADO SPRINGS CO 80921

Prepared by:
CLASSIC CONSULTING
619 N. CASCADE AVE SUITE 200
COLORADO SPRINGS CO 80903
(719) 785-2802

Job No. 2604.00

PCD Project No. SP254



**PRELIMINARY DRAINAGE REPORT FOR
TRIPLE H RANCH PRELIMINARY PLAN**

ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.

Marc A. Whorton Colorado P.E. #37155

Date

OWNER'S/DEVELOPER'S STATEMENT:

I, the owner/developer, have read and will comply with all of the requirements specified in this drainage report and plan.

Business Name: P760 LAND, LLC

By: _____

Title: _____

Address: 13395 Voyager Pkwy., Suite 130

Colorado Springs, CO 80921

EL PASO COUNTY:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Joshua J. Palmer, P.E.
County Engineer, / ECM Administrator

Date

Conditions:



PRELIMINARY DRAINAGE REPORT FOR TRIPLE H RANCH PRELIMINARY PLAN

TABLE OF CONTENTS:

PURPOSE	Page 4
GENERAL DESCRIPTION	Page 4
EXISTING DRAINAGE CONDITIONS	Page 5
PROPOSED DRAINAGE CONDITIONS	Page 10
DETENTION/SWQ FACILITIES	Page 25
DRAINAGE CRITERIA	Page 26
FLOODPLAIN STATEMENT	Page 28
DRAINAGE AND BRIDGE FEES	Page 28
SUMMARY	Page 28
REFERENCES	Page 30

APPENDICES

VICINITY MAP
SOILS MAP (WEB SOIL SURVEY)
F.E.M.A. MAP
REFERENCES FROM HAEGLER RANCH DBPS
HYDROLOGIC CALCULATIONS
STORMWATER QUALITY / BMP CALCULATIONS
DRAINAGE MAPS



PRELIMINARY DRAINAGE REPORT FOR TRIPLE H RANCH PRELIMINARY PLAN

PURPOSE

The purpose of this Preliminary Drainage Report is to address on-site and off-site drainage patterns and identify specific drainage improvements and facilities required to minimize impacts to the adjacent properties.

GENERAL DESCRIPTION

The Triple H Ranch Preliminary Plan is 752.68-acre site located in portions of sections 19 and 20, township 13 south, range 63 west of the sixth principal meridian. 244 rural residential 2.5-ac. lots are planned along with two park tracts, two pond tracts and a tract for a water tank/well site. The site is bounded on the north and east by unplatted rural property zoned A-35, to the west by Government lots owned by various individuals that remain rural undeveloped property zoned A-35 and to the south by existing Jones Road and an existing 40-ac. rural residential out parcel zoned A-35 with a current homestead owned by Russel and Loretta Branham. This existing residence accesses directly to Jones Road. The site lies within both the Gieck Ranch and Haegler Ranch Drainage Basins. This site was recently rezoned from A-35 to RR-2.5 approved by BOCC August 28, 2025 (P251).

The majority soil condition reflects Hydrologic Group "A" (Blakeland loamy sand - 8 and Truckton sandy loam – 95, 96 & 97) as determined by the "Web Soil Survey of El Paso County Area," prepared by the Natural Resources Conservation Service (see map in Appendix). These type A soils exhibit a high to very high capacity to transmit water (5.95 to 19.98 in/hr. for soil type 8 and 2.0 to 6.0 in/hr. for soil types 95, 96 & 97). Given the proposed land use of rural residential, large lot (2.5 ac. min.), only roadways, sideroad/drainage ditches and stormwater quality/detention ponds are planned to be graded. No significant overlot grading within the lot areas will take place. Therefore, the pre-developed soils condition will remain in-tact for the majority of the site. As such, Type A soils are utilized for both pre-developed and developed site conditions.



EXISTING DRAINAGE CONDITIONS

The Triple H Ranch property is located in the middle portion of Haegler Ranch Drainage Basin with the extreme northeast portion of the site within the Gieck Ranch Drainage Basin. The entire site generally drains in a southeast direction towards Jones Road along the south boundary. The entire site is covered with native grasses with no trees or other vegetation. There are fenced portions of the site being used for cattle grazing. Off-site flows come onto the property at the northwest corner from undeveloped property within the High Plains Ranch Sketch Plan, approved in 2008. However, no other planning or development has taken place on this adjacent property yet. There is about 136 feet of fall from the northwest portion to the southeast portion of the property but over a dozen low areas throughout the site that appear to have no gravity outfall. Given the well-draining Type A soils across the entire property, these areas show no signs of ponding water. This is consistent with the findings contained in the "Soil and Geology Study – Jones Road", prepared by RMG – Rocky Mountain Group dated September 2023 and recent update. Based on the bore logs contained within said report, no evidence of groundwater was found on-site.

The main stem channel within the Haegler Ranch Basin crosses the extreme southwest corner of the property at a low point in Jones Road. This channel is currently within an unstudied, Zone A FEMA 100-yr. floodplain (Map Panel 0590G) and crosses Jones Road with three 60" CMP culverts that appear to be in good condition. There are also multiple other low points along Jones Road further to the east adjacent to this property with various sized CMP and RCP culvert crossings, most of which are severely silted in and overgrown.

To our knowledge, this site has not been studied in any site-specific drainage report. Only the "Haegler Ranch Drainage Basin Planning Study", prepared for El Paso County by URS Corporation, approved June 2009 contains drainage information for this property. Reference the Appendix for excerpts from the DBPS that refer to this site and drainage crossings of Jones Road adjacent to the property. Several drainage facilities crossing Jones Road are discussed as reimbursable facilities. These will be further discussed later in this report.



The following descriptions represent both the off-site and on-site pre-developed drainage basins for the property all within the Haegler Ranch Drainage Basin:

Basin EX-1 ($Q_5 = 1.3$ cfs, $Q_{100} = 8.3$ cfs) consists of approximately 9.9 acres of off-site undeveloped property currently zoned A-35 that sheet flows in a southeasterly direction on-site directly into Basin EX-2. Upon any future development in this basin, these total pre-developed flows must be adhered to.

Basin EX-2 ($Q_5 = 6.3$ cfs, $Q_{100} = 27.7$ cfs) consists of approximately 64.1 acres of on-site property that sheet flows in a southeasterly direction towards Jones Road combined with the off-site flows from Basin EX-1. These combined flows sheet flow to a low point north of Jones Road shown as **Design Point E2 ($Q_5 = 6.3$ cfs, $Q_{100} = 34.0$ cfs)**. Based on current field conditions, no culvert crossing of Jones Road was found in this low area. It appears that the flows pond in this low area to a depth of about 12"-18" and then spill over the high point in the ditch and travel to the west into Basin EX-5 down the north side of Jones Road towards the existing channel.

Basin EX-3 ($Q_5 = 3.5$ cfs, $Q_{100} = 18.1$ cfs) consists of approximately 20.2 acres of on-site property that sheet flows in a southeasterly direction towards another low area on-site just north of Jones Road shown as **Design Point E3 ($Q_5 = 3.5$ cfs, $Q_{100} = 18.1$ cfs)**. Based on current field conditions, no culvert crossing of Jones Road could be located at this crossing. However, the DBPS shows a 15" RCP culvert crossing at this location. This crossing will be confirmed with Final Drainage Report. It appears that these pre-developed flows pond in this low area on-site approximately 150' north of Jones Road. No evidence of overtopping of Jones Road was found.

Basin EX-4 ($Q_5 = 0.3$ cfs, $Q_{100} = 3.7$ cfs) consists of approximately 1.3 acres of on-site property just west of the unplatted out parcel that sheet flows in a southerly direction towards Jones Road. The minor flows from this basin flow into the ditch along the north side of Jones Road and then east within Basin EX-10.



Basin EX-5 ($Q_5 = 3.6$ cfs, $Q_{100} = 18.7$ cfs) consists of approximately 21.9 acres of on-site property that sheet flows in a southwesterly direction directly into the creek that crosses the southwest corner of the property and Jones Road. This location is represented by **Design Point E1 ($Q_5 = 3.6$ cfs, $Q_{100} = 18.7$ cfs)**, which only accounts for the on-site flows entering the channel. This crossing of Jones Road is represented by Junction JHR0370 in the Haegler Ranch DBPS with a total flow of ($Q_{100} = 2300$ cfs). (Reference the Off-site Drainage Map in the Appendix) Three 60" CMP culverts, that appear to be clean and in good working condition exist currently at this roadway crossing. The DBPS recommends multiple box culverts to be installed at this location which also appear to be a reimbursable expense within the basin.

Basin EX-6 ($Q_5 = 80.5$ cfs, $Q_{100} = 211.7$ cfs) consists of approximately 536 acres of tributary off-site property as found within basins HR0510, HR0520 and HR0530 in the Haegler Ranch DBPS. (Reference Off-site Drainage Map in Appendix) This area covers the very upper portion of the Haegler Ranch Drainage Basin. The off-site area appears to be partially developed with basins HR0510 and HR0520 and not developed in Basin HR0530. The DBPS analyzes this area as Reach T1. DBPS Junction JHR0520 represents the upstream off-site crossing of Murr Road as ($Q_{100} = 200$ cfs). **Design Point E4 ($Q_5 = 80.5$ cfs, $Q_{100} = 211.7$ cfs)** represents the total off-site pre-developed flows entering the property at the northwest corner. Upon future development upstream, these total pre-developed flows must be adhered to.

Basin EX-7 ($Q_5 = 10.4$ cfs, $Q_{100} = 43.8$ cfs) consists of approximately 132.5 acres of tributary off-site property as found within basins HR0540 and HR0560 in the Haegler Ranch DBPS. (Reference Off-site Drainage Map in Appendix) This off-site area appears to not be developed yet even with a Sketch plan approved for this area as found by "High Plains Ranch Sketch Plan", approved in 2008. Upon future development in this basin, these total pre-developed flows must be adhered to. These off-site flows sheet flow on-site directly into Basin EX-8.

Basin EX-9 ($Q_5 = 2.0$ cfs, $Q_{100} = 10.3$ cfs) consists of approximately 9.7 acres of off-site property within the unplatted out parcel and found to be a contained within basin HR0570 in the Haegler

Ranch DBPS. (Reference Off-site Drainage Map in Appendix) This off-site area contains the northern portion of the existing homestead currently on this adjacent property. Upon any future development in this basin, these total pre-developed flows must be adhered to. These off-site flows sheet flow on-site directly into Basin EX-8.

The various off-site flows from Basins EX-6, EX-7 and EX-9 then travel in a southeasterly direction across the site within **Basin EX-8 ($Q_5 = 34.4$ cfs, $Q_{100} = 106.6$ cfs)**. This large on-site basin that makes up the major portion of the property combines with these off-site flows as they travel within a not-well defined corridor through multiple low areas. Again, this corridor is represented by Reach T1 in the DBPS and its length across the property is approximately 7800 LF to another low point at Jones Road represented by **Design Point E5 ($Q_5 = 125.4$ cfs, $Q_{100} = 360.4$ cfs)**. This crossing of Jones Road is represented by Junction JHR0570 in the Haegler Ranch DBPS with a total flow of ($Q_{100} = 370$ cfs). (Reference the Off-site Drainage Map in the Appendix) Both Dual 24" CMP culverts and dual 24" RCP culverts, that appear to be almost completely silted in and overgrown exist currently at this roadway crossing. The DBPS recommends a box culvert to be installed at this location which also appears to be a reimbursable expense within the basin.

Basin EX-10 ($Q_5 = 6.2$ cfs, $Q_{100} = 30.5$ cfs) consists of approximately 30.3 acres of off-site property within the unplatted out parcel. This off-site area contains the major portion of the existing homestead currently on this adjacent property. Upon any future development in this basin, these total pre-developed flows must be adhered to. These off-site flows travel in a southeasterly direction towards the sideroad ditch along Jones Road and then on-site directly into Basin EX-11.

Basin EX-11 ($Q_5 = 2.0$ cfs, $Q_{100} = 10.4$ cfs) consists of approximately 8.2 acres of on-site property that sheet flows in a southeasterly direction towards another low point adjacent to Jones Road found as **Design Point E6 ($Q_5 = 7.4$ cfs, $Q_{100} = 42.7$ cfs)**. This Design Point represents the total pre-developed flows at this location from Basins EX-4, EX-10 and EX-11. An existing 18" RCP culvert, that appears to be severely silted in and overgrown was found at this road crossing.



However, the DBPS did not describe any culvert crossing at his location. This crossing will be confirmed with Final Drainage Report.

Basin EX-12 ($Q_5 = 0.5$ cfs, $Q_{100} = 9.0$ cfs) consists of approximately 6.5 acres of off-site undeveloped property currently zoned A-35 that sheet flows in a southeasterly direction on-site directly into Basin EX-13. Upon any future development in this basin, these total pre-developed flows must be adhered to.

Basin EX-13 ($Q_5 = 14.9$ cfs, $Q_{100} = 48.8$ cfs). This large on-site basin, of approximately 173.2 acres, consists of the eastern portion of the property that drains in a southeasterly direction towards Jones Road. This corridor length across the property is approximately 5700 LF towards **Design Point E7 ($Q_5 = 14.9$ cfs, $Q_{100} = 48.8$ cfs)** which includes off-site basin EX-12, on-site basin EX-13 along with multiple low points throughout this tributary area. At Design Point E7, the flows exit the property to the east, just north of Jones Road. This Design Point includes flows from off-site basins EX-12 and EX-18.

Basin EX-18 ($Q_5 = 0.1$ cfs, $Q_{100} = 2.7$ cfs) consists of approximately 1.7 acres of off-site undeveloped property currently zoned A-35 that sheet flows in a southwesterly direction on-site directly into Basin EX-13. Upon any future development in this basin, these total pre-developed flows must be adhered to.

The following descriptions represent both the off-site and on-site pre-developed drainage basins for the property all within the **Gieck Ranch Drainage Basin:**

Basin EX-14 ($Q_5 = 0.2$ cfs, $Q_{100} = 3.6$ cfs) consists of approximately 2.4 acres of off-site undeveloped property within the Gieck Ranch Drainage Basin that sheet flows in a southeasterly direction on-site directly into Basin EX-16. Upon any future development in this basin, these total pre-developed flows must be adhered to.

Basin EX-16 ($Q_5 = 1.1$ cfs, $Q_{100} = 9.2$ cfs) consists of approximately 14.0 acres of on-site property at the extreme northeast corner of the site. This area is also within the Gieck Ranch Drainage basin. The combined flows sheet flow in a southeasterly direction through several low points on-site towards **Design Point E10 ($Q_5 = 1.1$ cfs, $Q_{100} = 12.3$ cfs)**. At this location, the flows will exit the property along the east boundary.

Basin EX-15 ($Q_5 = 0.1$ cfs, $Q_{100} = 2.6$ cfs) consists of approximately 1.2 acres of on-site property again at the extreme northeast corner of the site. This area is also within the Gieck Ranch Drainage basin and sheet flows in an easterly direction towards **Design Point E11 ($Q_5 = 0.1$ cfs, $Q_{100} = 2.6$ cfs)**. At this location, the flows will exit the property along the east boundary.

Basin EX-17 ($Q_5 = 0.3$ cfs, $Q_{100} = 6.1$ cfs) consists of approximately 3.5 acres of on-site property along the eastern boundary. This area is within the Gieck Ranch Drainage basin and sheet flows in a southeasterly direction towards **Design Point E9 ($Q_5 = 0.3$ cfs, $Q_{100} = 6.1$ cfs)**. At this location, the flows will exit the property along the east boundary.

Basin EX-19 ($Q_5 = 0.3$ cfs, $Q_{100} = 5.3$ cfs) consists of approximately 3.8 acres of on-site property along the eastern boundary. This area is within the Gieck Ranch Drainage basin and sheet flows in a southeasterly direction towards **Design Point E8 ($Q_5 = 0.3$ cfs, $Q_{100} = 5.3$ cfs)**. At this location, the flows will exit the property along the east boundary.

PROPOSED DRAINAGE CONDITIONS

Proposed development will consist of 244 large lot rural residential properties with a 2.5 ac. min. lot size. These lots will be accessed from public paved rural streets with roadside ditches. Development of these rural lots will be limited to roadways, ditches and building pads, conserving the natural feature areas. Individual home sites on these lots are to be left generally in their natural condition with minimal disturbance to existing conditions per individual lot construction.



Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide Water Quality Capture Volume (WQCV). However, based on the current County/Urban Drainage stormwater quality standards, a WQCV component is automatically built into the UD Detention spreadsheet utilized in the detention basin design. Multiple proposed permanent detention/stormwater quality facilities will provide WQCV along with an Excess Urban Runoff Volume (EURV) in the lower portion of the facilities storage volume with an outlet control device. Frequent and infrequent inflows are released at rates approximating undeveloped conditions. This concept provides some mitigation of increased runoff volume by releasing a portion of the increased runoff at a low rate over an extended period of time, up to 72 hours. This means that frequent storms, smaller than the 2-year event, will be reduced to very low flows near or below the sediment carrying threshold value for downstream drainage ways. Also, by incorporating an outlet structure that limits the 100-year runoff to the undeveloped condition rate, the discharge hydrograph for storms between the 2 year and the 100-year event will approximate the hydrograph for the undeveloped conditions and will help effectively mitigate the effects of development. The following describes how this development proposes to handle both the off-site and on-site drainage conditions:

The following descriptions represent the proposed developed design points that are **tributary to Pond 1 West**:

Design Point 1 ($Q_5 = 3.6$ cfs, $Q_{100} = 15.5$ cfs) represents developed flows from Basin W-A (9.0 ac.) that sheet flow in a southerly direction towards Design Point 1. At this location, a future public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the anticipated future roadway tract and continue within the sideroad ditch along the west side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 2 ($Q_5 = 3.9$ cfs, $Q_{100} = 18.6$ cfs) represents developed flows from Basin W-B (10.0 ac.) that sheet flow in a southwesterly direction towards the low point at Design Point 2. At this location, a public area inlet will be sized to completely accept both the 5-yr. and 100-yr.



developed flows. A public storm sewer will then convey these developed flows further west downstream towards Design Point 3. Sizing of these facilities will be provided in a future FDR.

Design Point 3 ($Q_5 = 14.6$ cfs, $Q_{100} = 44.9$ cfs) represents developed flows from Basin W-C (37.5 ac.) that sheet flow in a southerly direction towards the low point at Design Point 3. At this location, a public area inlet will be sized to completely accept both the 5-yr. and 100-yr. developed flows. A public storm sewer will then convey these developed flows along with the collected flows from DP-2 further south downstream and directly into the proposed Pond 1W. Sizing of these facilities will be provided in a future FDR.

Design Point 4 ($Q_5 = 23.9$ cfs, $Q_{100} = 79.9$ cfs) represents the total developed flows from Design Points 1-3 along with Basin W-D (15.4 ac.) that sheet flows into the sideroad ditch and then directly into Pond1W. The following represents the proposed **Pond 1W design**:
(See MHFD-Detention Design Sheets in Appendix)

Total Tributary acreage: 71.9 Ac.

0.402 Ac.-ft. WQCV required

0.171 Ac.-ft. EURV required

1.480 Ac.-ft. 100-yr. Storage

2.053 Ac.-ft. Total

Total In-flow: $Q_5 = 23.9$ cfs, $Q_{100} = 79.9$ cfs

Pond Design Release: $Q_5 = 0.2$ cfs, $Q_{100} = 37.6$ cfs

(Ownership and maintenance by the Triple H Ranch Metro District)

Design Point 5 ($Q_5 = 0.2$ cfs, $Q_{100} = 37.6$ cfs) represents the proposed Pond 1W release into the existing sideroad ditch that then routes the flows directly into the adjacent creek. Ultimate creek crossing improvements are anticipated at Jones Road as described in the Haegler Ranch DBPS. These improvements will help facilitate a continued suitable outfall at this location.



Basin W-F ($Q_5 = 0.4$ cfs, $Q_{100} = 3.5$ cfs) is a 1.1 ac. basin that represents developed flows within the public Right-of-Way along the north side of Jones Road that are also currently directly tributary to the creek.

Basin W-G ($Q_5 = 7.6$ cfs, $Q_{100} = 26.3$ cfs) is a 21.9 ac. basin that represents the rear of lots 11-18 that sheet flow in a southwest direction into Tract A of Filing No. 1 that the existing creek flows through. This basin will continue to sheet flow directly into the creek. Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV.

Basin W-E ($Q_5 = 3.9$ cfs, $Q_{100} = 19.6$ cfs) is a 11.0 ac. basin that represents developed flows from lots 47-50 that sheet flow in a southwest direction towards a low point along the north side of Jones Road. A proposed drainage easement will be provided within lots 49 and 50 as necessary to handle any stormwater ponding area. Again, per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV. An existing 15" RCP culvert crosses Jones Road at this location. This facility may be upsized and further analyzed in the FDR to help facilitate a continued suitable outfall at this location.

The following descriptions represent the proposed developed design points that are **tributary to Pond 1 East:**

As described in the existing conditions section of this report, Basin EX-6 is a 536 ac. off-site basin within the top portion of the Haegler Ranch Drainage Basin. **Design Point 16 ($Q_5 = 95.8$ cfs, $Q_{100} = 246.1$ cfs)** represents this off-site tributary area known as Reach T1 within the DBPS and enters the proposed site within Basin E-A at the northwest corner of the property. This development proposes to construct a diversion channel along the west boundary to convey these significant off-site flows around the property rather than through the proposed residential lots and public roads. This channel will be located within a public drainage easement on all proposed lots and will be maintained by the Triple H Ranch Metro District. (See



Channel Section in Appendix) **Design Point 17 ($Q_5 = 65.1$ cfs, $Q_{100} = 214.2$ cfs)** represents the total off-site pre-developed flows conveyed within the channel that directly enter the existing creek at the southwest corner of the property.

Basin OS-3 ($Q_5 = 0.2$ cfs, $Q_{100} = 6.7$ cfs) is a 3.1 ac. basin that represents off-site pre-developed flows from undeveloped property to the west. This tributary area sheet flows easterly onto the property directly into the proposed diversion channel.

Basin OS-2 ($Q_5 = 1.0$ cfs, $Q_{100} = 13.7$ cfs) is a 12.5 ac. basin that also represents off-site pre-developed flows from undeveloped property to the west. This tributary area sheet flows easterly onto the property directly into the proposed diversion channel.

Basin OS-1 ($Q_5 = 1.3$ cfs, $Q_{100} = 8.3$ cfs) is a 9.9 ac. basin that also represents off-site pre-developed flows from undeveloped property to the west. This tributary area sheet flows easterly onto the property directly into the proposed diversion channel.

Design Point 6 ($Q_5 = 0.8$ cfs, $Q_{100} = 4.5$ cfs) represents developed flows from Basin E-F (1.9 ac.) that sheet flow in an easterly direction towards Design Point 6. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the south side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 7 ($Q_5 = 2.9$ cfs, $Q_{100} = 15.3$ cfs) represents developed flows from Basin E-G (5.7 ac.) along with the ditch flows from DP-6 that sheet flow in a northeasterly direction towards the low point at Design Point 7. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and be conveyed in a proposed ditch across lots 43 and 41 to the sideroad ditch and then towards DP-8. Sizing of these facilities will be provided in a future FDR.

Design Point 8 ($Q_5 = 10.8$ cfs, $Q_{100} = 40.1$ cfs) represents developed flows from Basin E-E (28.6 ac.) along with the previously described upstream flows that sheet flow in an easterly direction towards Design Point 8. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 9 ($Q_5 = 0.9$ cfs, $Q_{100} = 4.5$ cfs) represents developed flows from Basin E-H (2.2 ac.) that sheet flow in an easterly direction towards Design Point 9. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the south side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 10 ($Q_5 = 3.9$ cfs, $Q_{100} = 15.6$ cfs) represents developed flows from Basin E-C (9.8 ac.) that sheet flow in an easterly direction towards Design Point 10. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 11 ($Q_5 = 3.5$ cfs, $Q_{100} = 11.4$ cfs) represents developed flows from Basin E-A (8.9 ac.) that sheet flow in a southerly direction towards Design Point 11. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the east side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 12 ($Q_5 = 8.4$ cfs, $Q_{100} = 38.3$ cfs) represents the off-site pre-developed flows from Basin OS-5 (106.6 ac.) that sheet flow in a southerly direction towards the property. This condition will remain until this adjacent property (High Plains Sketch Plan) is developed. At that

time, based on the Sketch Plan, it is anticipated that approximately 12.0 acres of large lot residential development will be tributary to this Design Point.

Design Point 13 ($Q_5 = 11.9$ cfs, $Q_{100} = 48.1$ cfs) represents developed flows from Basin E-B (12.3 ac.) along with the previously described off-site flows from DP-12 that sheet flow in a southerly direction towards Design Point 13. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and then be conveyed in a ditch within a drainage easement across lots 26 and 31 (Filing 2) towards DP-15. Sizing of these facilities will be provided in a future FDR.

Design Point 14 ($Q_5 = 3.4$ cfs, $Q_{100} = 12.4$ cfs) represents developed flows from Basins TANK (1.9 ac.) and E-N (2.2 ac.) that sheet flow in a westerly direction towards the sideroad ditch and then south to Design Point 14. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the southeast side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 15 ($Q_5 = 23.0$ cfs, $Q_{100} = 100.0$ cfs) represents developed flows from Basin E-D (29.0 ac.) that sheet flow in a southerly direction along with ditch flows from the previously described Design Points 10-13 all towards Design Point 15. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 18 ($Q_5 = 0.3$ cfs, $Q_{100} = 5.8$ cfs) represents the off-site pre-developed flows from Basin OS-6 (4.0 ac.) that sheet flow in a southeasterly direction directly onto the property. This condition will remain until this adjacent property (High Plains Sketch Plan) is developed. At that time, based on the Sketch Plan, it is anticipated that approximately the same acreage of large lot residential development will be tributary to this Design Point.

Design Point 19 ($Q_5 = 1.5$ cfs, $Q_{100} = 15.2$ cfs) represents the off-site pre-developed flows from Basin OS-7 (19.3 ac.) that sheet flow in a southerly direction towards the property. This condition will remain until this adjacent property (High Plains Sketch Plan) is developed. At that time, based on the Sketch Plan, it is anticipated that approximately 6.0 acres of large lot residential development will be tributary to this Design Point.

Design Point 20 ($Q_5 = 0.2$ cfs, $Q_{100} = 5.5$ cfs) represents the off-site pre-developed flows from Basin OS-8 (2.3 ac.) that sheet flow in a southeasterly direction directly onto the property. This condition will remain until this adjacent property (High Plains Sketch Plan) is developed. At that time, based on the Sketch Plan, it is anticipated that approximately the same acreage of large lot residential development will be tributary to this Design Point.

Design Point 21 ($Q_5 = 5.8$ cfs, $Q_{100} = 22.2$ cfs) represents developed flows from Basin E-O (16.4 ac.) that sheet flow in a southerly direction towards Design Point 21 along with the combined off-site flows previously described from DP-20. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 22 ($Q_5 = 14.0$ cfs, $Q_{100} = 59.5$ cfs) represents developed flows from Basin E-P (30.5 ac.) that sheet flow in a southeasterly direction towards Design Point 22 along with the previously described flows from Design Points 18-21. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 23 ($Q_5 = 5.9$ cfs, $Q_{100} = 20.3$ cfs) represents developed flows from Basin E-I (13.7 ac.) that sheet flow in an easterly direction towards the low point at Design Point 23. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr.

developed flows under the roadway and continue within a ditch across the park within Tract A (Filing 1) towards the sideroad ditch along Appaloosa Run Dr. Sizing of these facilities will be provided in a future FDR.

Design Point 24 ($Q_5 = 0.3$ cfs, $Q_{100} = 2.5$ cfs) represents developed flows from Basin E-J (0.68 ac.) that sheet flow in a northwesterly direction to Design Point 24. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the east side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 25 ($Q_5 = 13.9$ cfs, $Q_{100} = 52.2$ cfs) represents developed flows from Basins E-K (8.3 ac.) and E-L (25.1 ac.) that sheet flow to sideroad ditches and then towards Design Point 25 along with the previously described developed flows from Design Points 9, 23 and 24. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the south side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 26 ($Q_5 = 0.2$ cfs, $Q_{100} = 4.4$ cfs) represents the off-site pre-developed flows from Basin OS-12 (2.9 ac.) that sheet flow in a northerly direction directly onto the property.

Design Point 27 ($Q_5 = 27.1$ cfs, $Q_{100} = 101.0$ cfs) represents developed flows from Basin E-S (26.5 ac.) and Basin E-Q (24.8 ac.) that sheet flow in a southerly direction towards Design Point 27 along with the combined off-site flows previously described from DP-22. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 28 ($Q_5 = 31.1$ cfs, $Q_{100} = 183.6$ cfs) represents developed flows from Basin E-R (65.2 ac.) that sheet flow in a southerly direction towards Design Point 28 along with the

combined off-site flows previously described from Design Points 8 and 15. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within a proposed channel across lots 26, 27 and 34 (Filing 1) that will convey these developed flows further downstream. Public drainage easements will be provided on these lots. Sizing of these facilities will be provided in a future FDR.

Design Point 29 ($Q_5 = 30.7$ cfs, $Q_{100} = 109.3$ cfs) represents developed flows from Basin E-T1 (9.8 ac.) that sheet flow in a southerly direction towards Design Point 29 along with the combined off-site flows previously described from Design Point 27. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within a proposed channel across lots 26, 27 and 34 (Filing 1) that will convey these developed flows further downstream. Public drainage easements will be provided on these lots. Sizing of these facilities will be provided in a future FDR.

Design Point 30 ($Q_5 = 77.4$ cfs, $Q_{100} = 225.1$ cfs) represents the combined developed flows from Basin E-V (7.5 ac.), Basin E-M (19.0 ac.) along with the combined off-site flows previously described from Design Points 25, 26, 28 and 29. At this location, the developed flows exit the site and cross the corner of the adjacent property for only 200 feet and then enter the site again at Lot 26 (Filing 1).

Design Point 31 ($Q_5 = 78.8$ cfs, $Q_{100} = 235.3$ cfs) represents the combined developed flows that re-enter the site into Lot 26 (Filing 1) along with off-site sheet flows from Basin OS-13 (6.8 ac.). At this location, the proposed channel will be constructed across lots 26 and 27 (Filing 1) that will convey these developed flows further downstream. Public drainage easements will be provided on these lots. Sizing of this facility will be provided in a future FDR.

Design Point 32 ($Q_5 = 4.2$ cfs, $Q_{100} = 15.6$ cfs) represents developed flows from Basin E-T2 (10.7 ac.) that sheet flow in a southerly direction towards the low point at Design Point 32. At this location, the developed flows will be routed further east within the sideroad ditch towards Design Point 33.

Design Point 33 ($Q_5 = 9.4$ cfs, $Q_{100} = 36.3$ cfs) represents developed flows from Basin E-U (16.8 ac.) that sheet flow in a southerly direction towards the low point at Design Point 33. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the west side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 34 ($Q_5 = 88.4$ cfs, $Q_{100} = 295.4$ cfs) represents the developed flows from Basin E-X (6.7 ac.) along with the combined developed flows previously described from Design Points 31 and 33. At this location, the developed flows will be completely collected by a public storm system that will route the flows directly to the proposed Pond 1E. Sizing of this facility will be provided in a future FDR.

Design Point 35 ($Q_5 = 2.1$ cfs, $Q_{100} = 9.3$ cfs) represents the developed flows from Basin E-Y (5.3 ac.) that sheet flow in an easterly direction towards Design Point 35. At this location, the developed flows will be completely collected by a public storm system that will route the flows directly to the proposed Pond 1E. Sizing of this facility will be provided in a future FDR.

Design Point 36 ($Q_5 = 6.1$ cfs, $Q_{100} = 33.5$ cfs) represents the off-site pre-developed flows from Basin OS-14 (30.3 ac.) and Basin E-MM (1.3 ac.) that combine and sheet flow into the sideroad ditch along the north side of Jones Roads and then towards Design Point 36. At this location, the combined flows continue to travel in the sideroad ditch towards Design Point 37.

Design Point 37 ($Q_5 = 8.2$ cfs, $Q_{100} = 43.9$ cfs) represents the developed flows from Basin E-NN (8.3 ac.) along with the previously described flows from Design Point 36. At this location, the

combined flows are collected by a public storm system and routed directly into Pond 1E. Sizing of this facility will be provided in a future FDR. The existing 18" RCP culvert crossing Jones Road at this location will be further analyzed in the future FDR to maintain a suitable outfall at this location.

Design Point 38 ($Q_5 = 0.5$ cfs, $Q_{100} = 9.0$ cfs) represents the off-site pre-developed flows from Basin OS-9 (6.5 ac.) that sheet flow in a southeasterly direction directly onto the property. This condition will remain until this adjacent property (High Plains Sketch Plan) is developed. At that time, based on the Sketch Plan, it is anticipated that approximately the same acreage of large lot residential development will be tributary to this Design Point.

Design Point 39 ($Q_5 = 7.6$ cfs, $Q_{100} = 25.4$ cfs) represents developed flows from Basin E-AA (19.2 ac.) that sheet flow in a southeasterly direction towards Design Point 39 along with the combined off-site flows previously described from DP-38. At this location, a future public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the anticipated future roadway tract and continue within the sideroad ditch along the north side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 40 ($Q_5 = 0.2$ cfs, $Q_{100} = 3.6$ cfs) represents the off-site pre-developed flows from Basin OS-10 (2.4 ac.) that sheet flow in a southeasterly direction directly onto the property. This condition will remain until this adjacent property (High Plains Sketch Plan) is developed. At that time, based on the Sketch Plan, it is anticipated that approximately the same acreage of large lot residential development will be tributary to this Design Point.

Design Point 41 ($Q_5 = 7.3$ cfs, $Q_{100} = 29.0$ cfs) represents developed flows from the northern portion of Basin E-DD (Approx. 6.5 ac.) that sheet flow in a southeasterly direction towards Design Point 41 along with the combined off-site flows previously described from Design Points 39 and 40. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the

sideroad ditch along the west side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 42 ($Q_5 = 22.4$ cfs, $Q_{100} = 69.0$ cfs) represents developed flows from Basin E-BB (46.2 ac.) that sheet flow in a southerly direction towards the sideroad ditch and then conveyed along the north side of the roadway towards Design Point 42 along with the combined off-site flows previously described from Design Point 41. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the west side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 43 ($Q_5 = 6.6$ cfs, $Q_{100} = 21.1$ cfs) represents developed flows from Basin E-CC (16.9 ac.) that sheet flow in a southeasterly direction towards Design Point 43. At this location, a proposed public culvert will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the north side of the road. Sizing of this facility will be provided in a future FDR.

Design Point 44 ($Q_5 = 30.4$ cfs, $Q_{100} = 106.0$ cfs) represents developed flows from Basin E-EE (19.8 ac.) that sheet flow in a southeasterly direction towards the sideroad ditch and then to Design Point 44 along with the combined off-site flows previously described from Design Points 42 and 43. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the west side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 45 ($Q_5 = 0.1$ cfs, $Q_{100} = 2.7$ cfs) represents the off-site pre-developed flows from Basin OS-11 (1.7 ac.) that sheet flow in a southwesterly direction directly onto the property.

Design Point 46 ($Q_5 = 32.3$ cfs, $Q_{100} = 128.2$ cfs) represents developed flows from Basin E-GG (24.0 ac.) that sheet flow in a southeasterly direction towards the sideroad ditch and then to Design Point 46 along with the combined off-site flows previously described from Design Point 44. At this location, multiple proposed public culverts will be sized to completely convey both the 5-yr. and 100-yr. developed flows under the roadway and continue within the sideroad ditch along the west side of the road. Sizing of these facilities will be provided in a future FDR.

Design Point 47 ($Q_5 = 8.2$ cfs, $Q_{100} = 31.4$ cfs) represents developed flows from Basin E-DD (17.5 ac.), Basin E-HH (21.0 ac.) that sheet flow in a southwesterly direction towards the sideroad ditch and then south to the low point at Design Point 47 along with the minor off-site flows previously described from Design Point 45. At this location, the developed flows will be completely collected by a public storm system that will route the flows directly to the proposed Pond 1E. Sizing of this facility will be provided in a future FDR.

Design Point 48 ($Q_5 = 41.5$ cfs, $Q_{100} = 175.8$ cfs) represents developed flows from Basin E-II (15.7 ac.) that sheet flow in an easterly direction towards the sideroad ditch and then south to the low point at Design Point 48 along with the developed flows previously described from Design Point 46. At this location, the developed flows will be completely collected by a public storm system that will route the flows directly to the proposed Pond 1E. Sizing of this facility will be provided in a future FDR.

Basin E-Z ($Q_5 = 7.5$ cfs, $Q_{100} = 24.1$ cfs) is a 21.4 ac. basin that sheet flows in a southerly direction directly into the proposed Pond 1E.

Basin E-LL ($Q_5 = 1.8$ cfs, $Q_{100} = 9.0$ cfs) is a 5.7 ac. basin that represents developed flows within the rear of Lots 6 and 7 (Filing 3) that sheet flow in a southerly direction towards the sideroad ditch along Jones Road. These flows will continue to be conveyed to the existing culvert crossings of Jones Road. Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac.

and larger are not required to provide WQCV. The existing dual 24" culverts crossing Jones Road at this location will be further analyzed in the future FDR to maintain this suitable outfall.

The following represents the total developed inflow to Pond 1E ($Q_5 = 131.0$ cfs, $Q_{100} = 526.6$ cfs) and the proposed Pond 1E design:

(See MHFD-Detention Design Sheets in Appendix)

Total Tributary acreage: 693.1 Ac.

3.870 Ac.-ft. WQCV required

1.649 Ac.-ft. EURV required

14.269 Ac.-ft. 100-yr. Storage

19.788 Ac.-ft. Total

Total In-flow: $Q_5 = 131.0$ cfs, $Q_{100} = 526.6$ cfs

Pond Design Release: $Q_5 = 1.8$ cfs, $Q_{100} = 164.5$ cfs

(Ownership and maintenance by the Triple H Ranch Metro District)

The following descriptions represent the proposed developed design points within the **Gieck Ranch Drainage Basin**:

A minor basin transfer of approximately 16.4 ac. from the Gieck Ranch basin into the Haegler Ranch basin is proposed due to the site layout and grading. (See Developed Drainage Map)

Basin E-JJ ($Q_5 = 1.2$ cfs, $Q_{100} = 6.3$ cfs) is a 3.8 ac. basin that represents the rear of lots 13-18 (Filing 3) that will continue to sheet flow in a southeast direction off-site. Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV. This proposed minor sheet flow off-site will not significantly affect this suitable outfall.



Basin E-KK ($Q_5 = 6.1$ cfs, $Q_{100} = 20.5$ cfs) is a 15.5 ac. basin that represents lots 7-14 (Filing 3) that will continue to sheet flow in a southeast direction off-site. Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV. This proposed sheet flow off-site is well less than the pre-developed conditions at this location and thus will continue to be a suitable outfall.

Basin E-FF ($Q_5 = 1.1$ cfs, $Q_{100} = 7.2$ cfs) is a 3.5 ac. basin that represents lots 1-4 (Filing 4) that will continue to sheet flow in a southeast direction off-site. Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV. This proposed minor sheet flow off-site will not significantly affect this suitable outfall.

Basin E-OO ($Q_5 = 0.1$ cfs, $Q_{100} = 2.7$ cfs) is a 1.2 ac. basin that represents the rear of Lot 6 (Filing 4) and will continue to sheet flow in an easterly direction off-site. Per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV. This proposed minor sheet flow off-site will not significantly affect this suitable outfall.

DETENTION / STORMWATER QUALITY FACILITIES

As required, storm water quality measures will be utilized in order to reduce the amount of sediment, debris and pollutants that are allowed to be released downstream. These features include but are not limited to Pond 1W and Pond 1E (both owned and maintained by the Triple H Ranch Metropolitan District). These proposed facilities will provide a detention and Water Quality Capture Volume (WQCV) and Excess Urban Runoff Volume (EURV) in the lower portion of the facility storage volume that will release the more frequent storms at a slower rate to help minimize the effects of development of the property. The proposed facilities are to be private facilities with ownership and maintenance by the Triple H Ranch Metropolitan District. After completion of construction and upon the Board of County Commissioners acceptance, all the drainage facilities within the public Right-of-Way will be owned and maintained by El Paso County.



DRAINAGE CRITERIA

Hydrologic calculations were performed using the City of Colorado Springs/El Paso County Drainage Criteria Manual, as revised in November 1991 and October 1994 with County adopted Chapter 6 and Section 3.2.1 of Chapter 13 of the City of Colorado Springs/El Paso County Drainage Criteria Manual as revised in May 2014. Per the ECM and the size of this proposed development, all off-site and on-site developed basin design was calculated using EPA SWMM Modeling as discussed in Chapter 6. Percent Impervious Area per Table 3-1 and imperviousness of the particular land use and the hydrologic soil type in accordance with Table 6-6. Point Precipitation Frequency Estimates determined from NOAA Atlas 14 for the specific site location. These 1-Hour rainfall depths then converted to 2-Hour Design Storms for a drainage basin area of 1-5 sq. mi. (See Appendix)

The City of Colorado Springs/El Paso County DCM requires the Four Step Process for receiving water protection that focuses on reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing drainage ways, and implementing long-term source controls. The Four Step Process pertains to management of smaller, frequently occurring storm events, as opposed to larger storms for which drainage and flood control infrastructure are sized. Implementation of these four steps helps to achieve storm water permit requirements.

This site adheres to this **Four Step Process** as follows:

1. **Employ Runoff Reduction Practices:** All proposed lot impervious area (roof tops, patios, etc.) will sheet flow across landscaped portions of the large lots (2.5 ac. min.) and through open space/park areas to slow runoff and increase time of concentration prior to being conveyed to the proposed public streets, sideroad ditches and detention facilities. This will minimize directly connected impervious areas within the project site. Final Drainage Report will provide further detail on basins that will be providing Runoff Reduction.

2. **Stabilize Drainageways:** After developed flows utilize the runoff reduction practices through these large lots, developed flows will travel via sideroad ditches and culverts within the public streets and eventually public storm systems. These collected flows are then routed directly to the proposed extended detention basins (full-spectrum facilities). Where developed flows are not able to be routed to public street, sheet flows will travel across landscaped rear yards and then through undeveloped property prior to being released off-site. Final Drainage Report will provide further detail on basins that will be providing Runoff Reduction.

3. **Provide Water Quality Capture Volume (WQCV):** Runoff from this development will be treated through capture and slow release of the WQCV and excess urban runoff volume (EURV) in the proposed Full-Spectrum permanent Extended Detention Basins designed per current El Paso County drainage criteria. For any area that is not able to be captured and routed to a permanent EDB, Runoff Reduction practices may be utilized. However, per the El Paso County ECM, Appendix I.7.1.B.5, rural lots of 2.5 ac. and larger are not required to provide WQCV. Final Drainage Report will provide further detail on basins that may be providing Runoff Reduction.

4. **Consider need for Industrial and Commercial BMPs:** No industrial or commercial uses are proposed within this development. However, a site-specific storm water quality and erosion control plan and narrative along with the grading and erosion control plan will be submitted with the future Final Plat submittal. Details such as site-specific sediment and erosion control construction BMP's as well as temporary and permanent BMP's will be detailed in this plan and narrative to protect receiving waters. BMP's will be constructed and maintained as the development has been graded and erosion control methods employed.

FLOODPLAIN STATEMENT

A portion of this site is located within a floodplain as determined by the Flood Insurance Rate Maps (F.I.R.M.) Map Number 08041C0590G with effective date of December 7, 2018 (See Appendix).

DRAINAGE AND BRIDGE FEES

The majority of this site lies within the **Haegler Ranch Drainage Basin** boundaries with just a small portion along the northeast corner and eastern edge within the **Gieck Ranch Drainage Basin**.

There is no final platting proposed at this time. Fees using the impervious acreage method approved by El Paso County will be defined in the future Final Drainage Report(s).

SUMMARY

The proposed Triple H Ranch Preliminary Plan is within the Haegler Ranch and Gieck Ranch Drainage Basins. Recommendations are made within this report concerning necessary improvements that will be required as a result of development of this property. The points of storm water release from the proposed site are required to be at or below the calculated pre-developed flow quantities. The development of the proposed site does not significantly impact any downstream facility or property to an extent greater than that which currently exists in the pre-development conditions. All drainage facilities within this report were sized according to the Drainage Criteria Manuals and the full-spectrum storm water quality requirements.



PREPARED BY:

Classic Consulting Engineers & Surveyors, LLC



Marc A. Whorton, P.E.
Project Manager

maw/260400 PDR.doc




REFERENCES

1. City of Colorado Springs/County of El Paso Drainage Criteria Manual as revised in November 1991 and October 1994 with County adopted Chapter 6 and Section 3.2.1 of Chapter 13 of the City of Colorado Springs/El Paso County Drainage Criteria Manual as revised in May 2014.
2. "Urban Storm Drainage Criteria Manual Volume 1, 2 & 3" Urban Drainage and Flood Control District, dated January 2016.
3. "General Drainage Report for High Plains Ranch" Kiowa Engineering Corporation, dated June 2008.
4. "Haegler Ranch Drainage Basin Planning Study", URS Corporation, dated May 2009.
5. "Gieck Ranch Drainage Basin Planning Study", Drexel, Barrell & Co., dated Feb. 2010

APPENDIX

VICINITY MAP

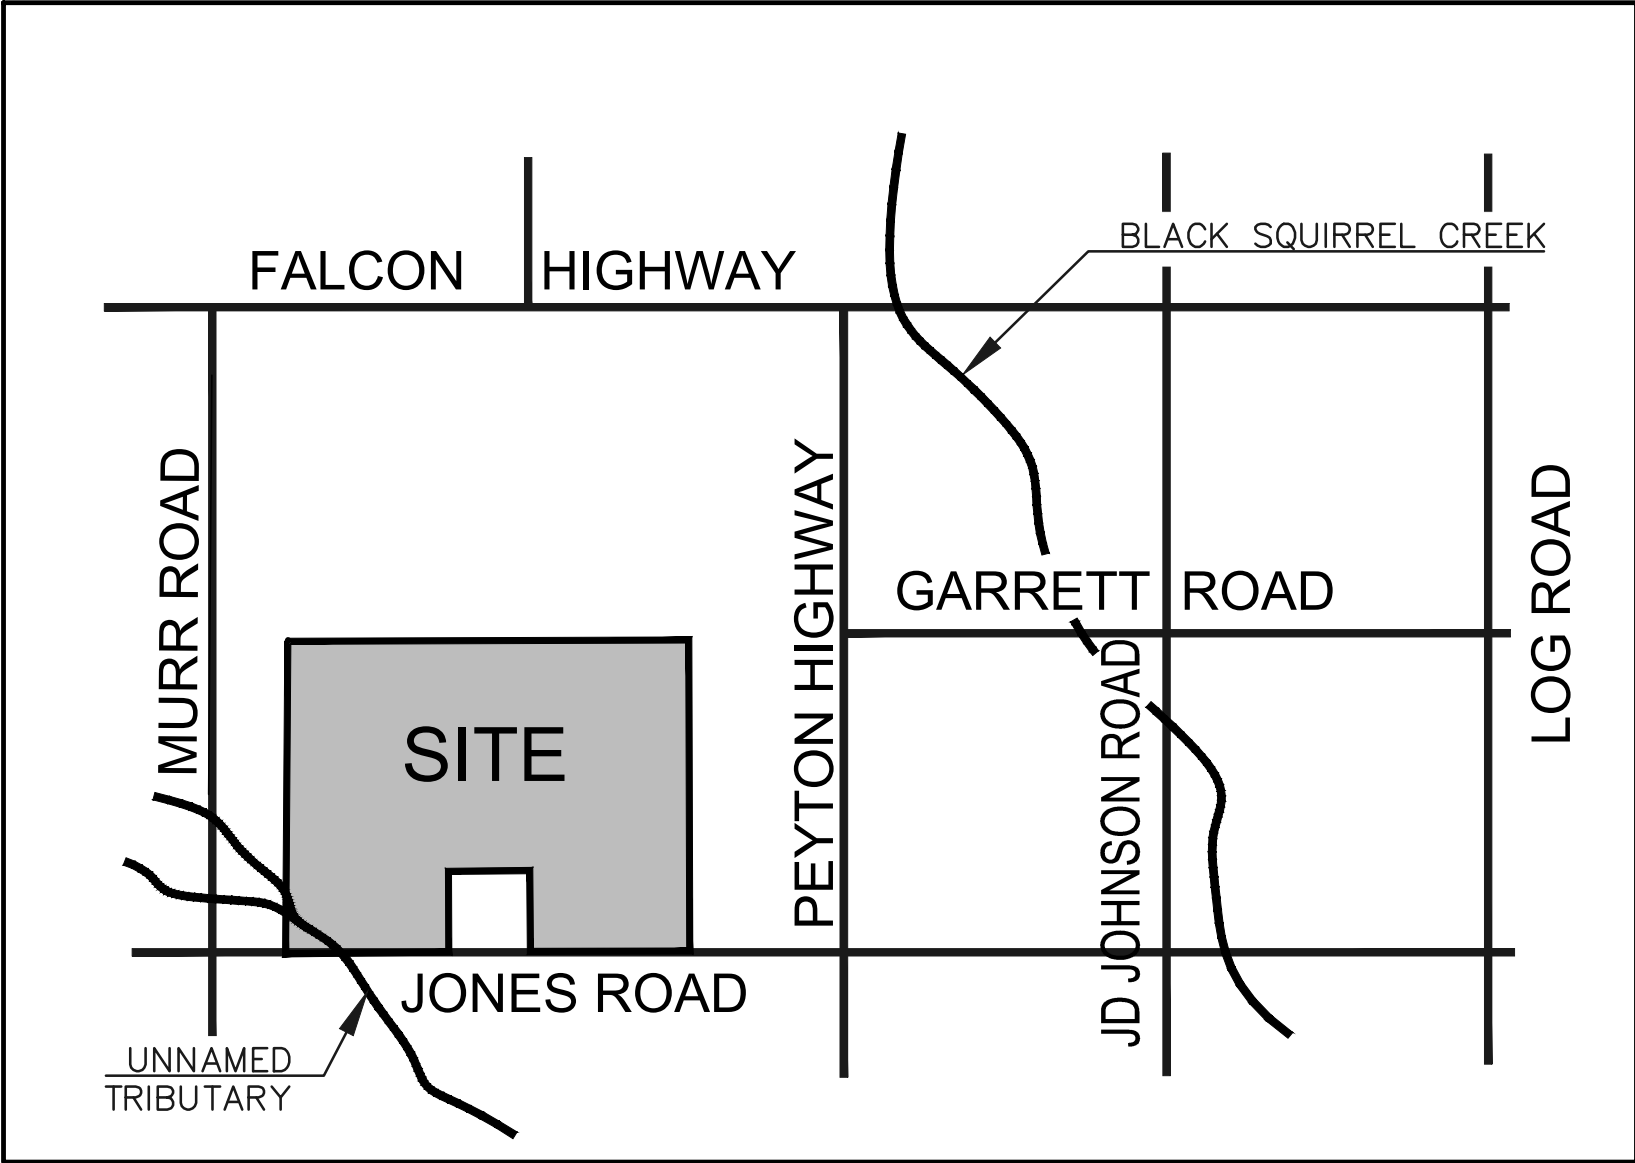


VICINITY MAP
N.T.S.




SOILS MAP (S.C.S SURVEY)

Soil Map—El Paso County Area, Colorado

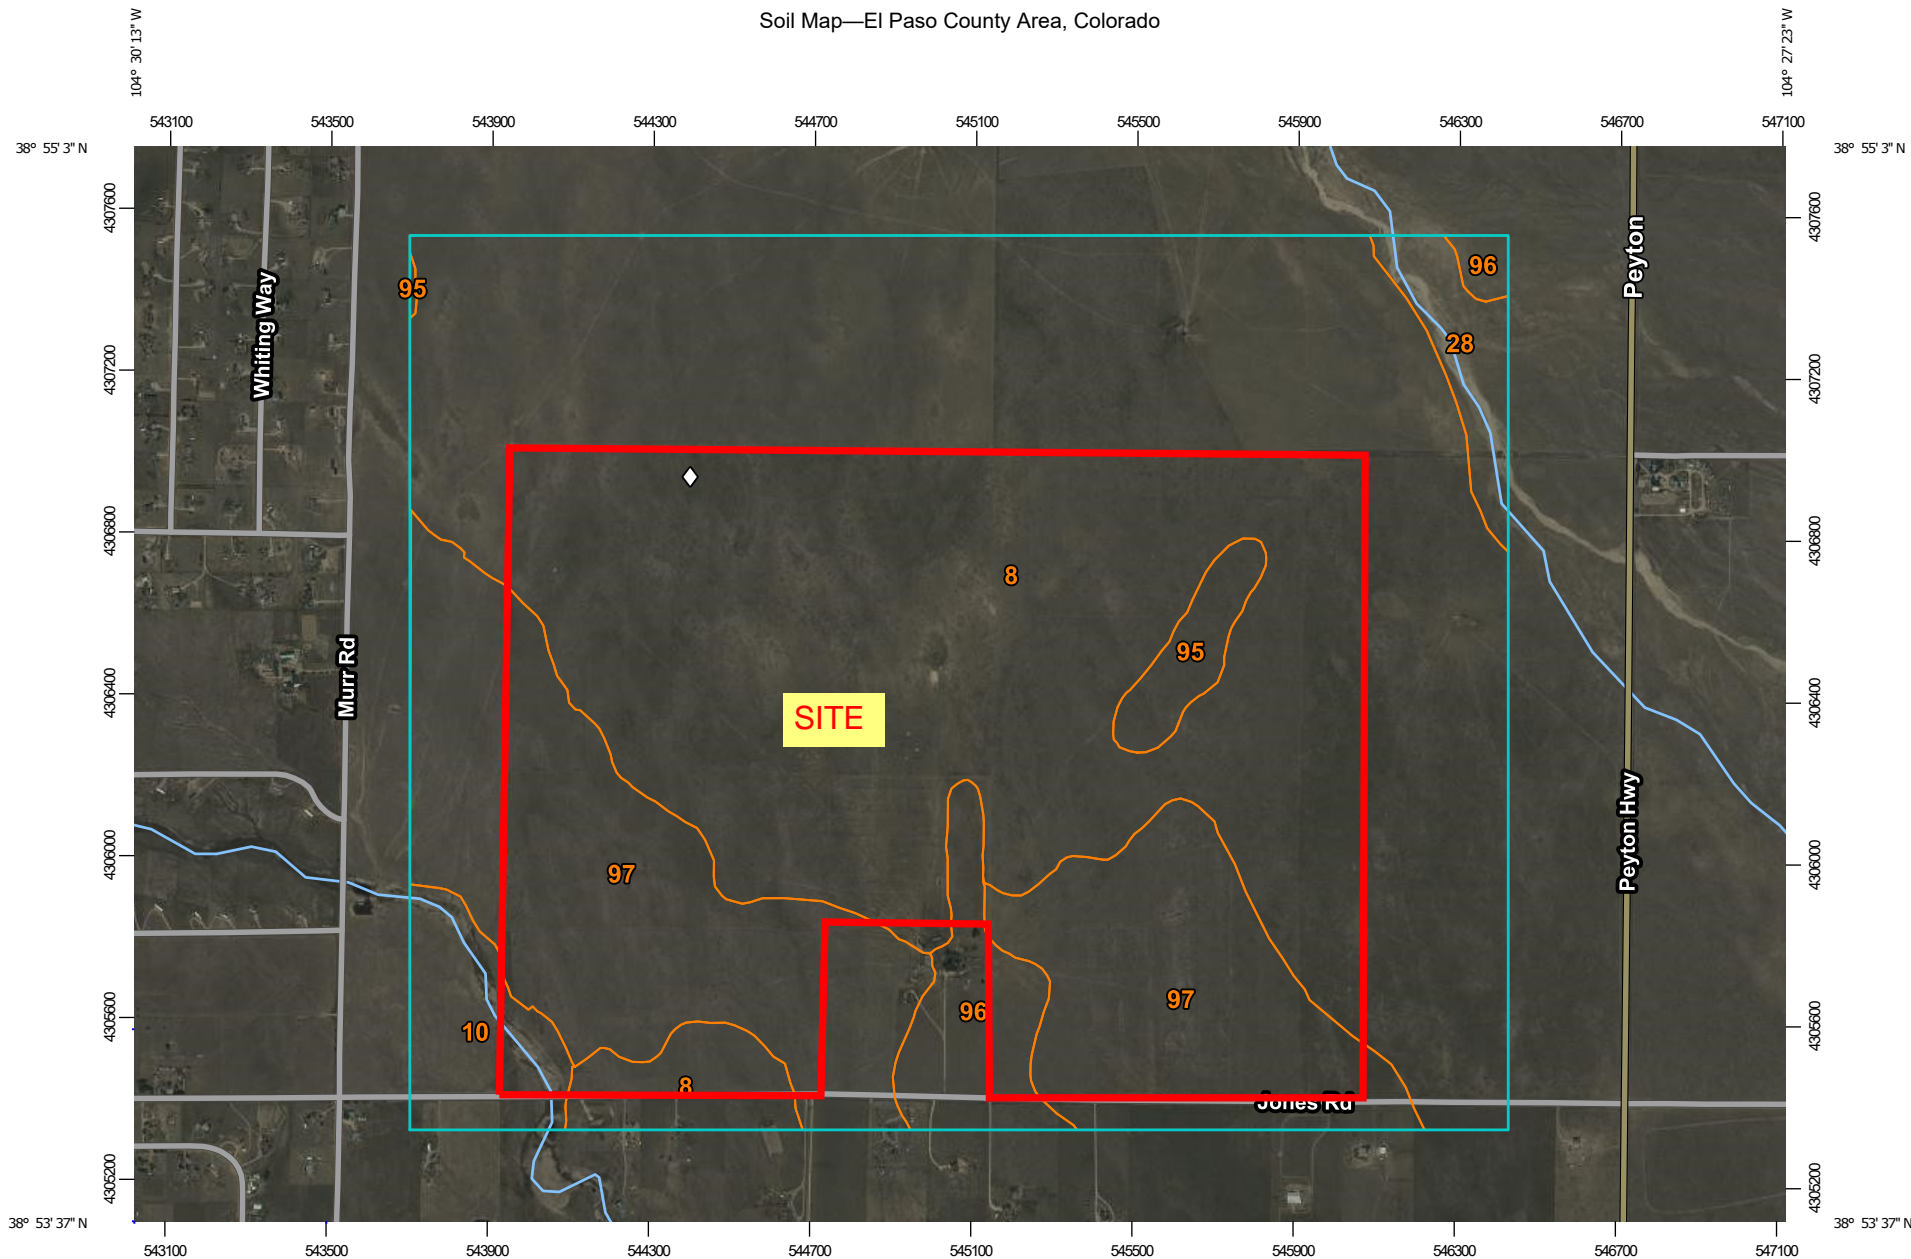

Map Scale: 1:18,700 if printed on A landscape (11" x 8.5") sheet.




Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)




















Soils







 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

Special Point Features






-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features


Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 21, Aug 24, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 11, 2018—Oct 20, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	1,026.5	68.7%
10	Blendon sandy loam, 0 to 3 percent slopes	43.2	2.9%
28	Ellicott loamy coarse sand, 0 to 5 percent slopes	26.5	1.8%
95	Truckton loamy sand, 1 to 9 percent slopes	19.7	1.3%
96	Truckton sandy loam, 0 to 3 percent slopes	49.5	3.3%
97	Truckton sandy loam, 3 to 9 percent slopes	329.8	22.1%
Totals for Area of Interest		1,495.2	100.0%

El Paso County Area, Colorado

8—Blakeland loamy sand, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 369v
Elevation: 4,600 to 5,800 feet
Mean annual precipitation: 14 to 16 inches
Mean annual air temperature: 46 to 48 degrees F
Frost-free period: 125 to 145 days
Farmland classification: Not prime farmland

Map Unit Composition

Blakeland and similar soils: 98 percent
Minor components: 2 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blakeland

Setting

Landform: Hills, flats
Landform position (three-dimensional): Side slope, talus
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Alluvium derived from sedimentary rock and/or eolian deposits derived from sedimentary rock

Typical profile

A - 0 to 11 inches: loamy sand
AC - 11 to 27 inches: loamy sand
C - 27 to 60 inches: sand

Properties and qualities

Slope: 1 to 9 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Somewhat excessively drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95 to 19.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 5 percent
Available water supply, 0 to 60 inches: Low (about 4.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: A
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Minor Components

Other soils

Percent of map unit: 1 percent

Hydric soil rating: No

Pleasant

Percent of map unit: 1 percent

Landform: Depressions

Hydric soil rating: Yes

Data Source Information

Soil Survey Area: El Paso County Area, Colorado

Survey Area Data: Version 21, Aug 24, 2023

El Paso County Area, Colorado

10—Blendon sandy loam, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 3671

Elevation: 6,000 to 6,800 feet

Mean annual precipitation: 14 to 16 inches

Mean annual air temperature: 46 to 48 degrees F

Frost-free period: 125 to 145 days

Farmland classification: Not prime farmland

Map Unit Composition

Blendon and similar soils: 98 percent

Minor components: 2 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blendon

Setting

Landform: Terraces, alluvial fans

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Sandy alluvium derived from arkose

Typical profile

A - 0 to 10 inches: sandy loam

Bw - 10 to 36 inches: sandy loam

C - 36 to 60 inches: gravelly sandy loam

Properties and qualities

Slope: 0 to 3 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water

(Ksat): Moderately high to high (0.60 to 2.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum content: 2 percent

Available water supply, 0 to 60 inches: Moderate (about 6.2 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 3e

Hydrologic Soil Group: B

Ecological site: R049XB210CO - Sandy Foothill

Hydric soil rating: No

Minor Components

Other soils

Percent of map unit: 1 percent

Hydric soil rating: No

Pleasant

Percent of map unit: 1 percent

Landform: Depressions

Hydric soil rating: Yes

Data Source Information

Soil Survey Area: El Paso County Area, Colorado

Survey Area Data: Version 21, Aug 24, 2023

El Paso County Area, Colorado

95—Truckton loamy sand, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 2yvrn

Elevation: 5,800 to 7,100 feet

Mean annual precipitation: 12 to 19 inches

Mean annual air temperature: 46 to 50 degrees F

Frost-free period: 90 to 155 days

Farmland classification: Not prime farmland

Map Unit Composition

Truckton and similar soils: 87 percent

Minor components: 13 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Truckton

Setting

Landform: Fan remnants, interfluves

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Wind re-worked alluvium derived from arkose

Typical profile

A - 0 to 4 inches: loamy sand

Bt1 - 4 to 12 inches: sandy loam

Bt2 - 12 to 19 inches: sandy loam

C - 19 to 80 inches: sandy loam

Properties and qualities

Slope: 1 to 9 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): High
(2.00 to 6.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum content: 1 percent

Maximum salinity: Nonsaline to very slightly saline (0.1 to 2.0
mmhos/cm)

Available water supply, 0 to 60 inches: Moderate (about 6.5
inches)

Interpretive groups

Land capability classification (irrigated): 6e

Land capability classification (nonirrigated): 6e

Hydrologic Soil Group: A

Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Minor Components

Blakeland

Percent of map unit: 5 percent
Landform: Hills, interfluves
Landform position (two-dimensional): Shoulder, backslope, summit
Landform position (three-dimensional): Side slope, crest
Down-slope shape: Convex, linear
Across-slope shape: Convex, linear
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Bresser

Percent of map unit: 5 percent
Landform: Terraces, interfluves
Landform position (three-dimensional): Tread
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Urban land

Percent of map unit: 2 percent
Hydric soil rating: No

Ellicott, occasionally flooded

Percent of map unit: 1 percent
Landform: Drainageways, flood plains
Down-slope shape: Linear
Across-slope shape: Concave, linear
Ecological site: R067BY031CO - Sandy Bottomland
Hydric soil rating: No

Data Source Information

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 21, Aug 24, 2023

El Paso County Area, Colorado

96—Truckton sandy loam, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 2yvrd

Elevation: 5,400 to 7,000 feet

Mean annual precipitation: 14 to 23 inches

Mean annual air temperature: 45 to 52 degrees F

Frost-free period: 90 to 155 days

Farmland classification: Prime farmland if irrigated and the product of
I (soil erodibility) x C (climate factor) does not exceed 60

Map Unit Composition

Truckton and similar soils: 85 percent

Minor components: 15 percent

*Estimates are based on observations, descriptions, and transects of
the mapunit.*

Description of Truckton

Setting

Landform: Interfluves, fan remnants

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Wind re-worked alluvium derived from arkose

Typical profile

A - 0 to 4 inches: sandy loam

Bt1 - 4 to 12 inches: sandy loam

Bt2 - 12 to 19 inches: sandy loam

C - 19 to 80 inches: sandy loam

Properties and qualities

Slope: 0 to 3 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Well drained

Runoff class: Very low

Capacity of the most limiting layer to transmit water (Ksat): High
(2.00 to 6.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum content: 1 percent

Maximum salinity: Nonsaline to very slightly saline (0.1 to 2.0
mmhos/cm)

Available water supply, 0 to 60 inches: Moderate (about 6.6
inches)

Interpretive groups

Land capability classification (irrigated): 3e

Land capability classification (nonirrigated): 4e

Hydrologic Soil Group: A
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Minor Components

Blakeland

Percent of map unit: 5 percent
Landform: Interfluves, hills
Landform position (two-dimensional): Summit, shoulder, backslope
Landform position (three-dimensional): Crest, side slope
Down-slope shape: Convex, linear
Across-slope shape: Convex, linear
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Bresser

Percent of map unit: 5 percent
Landform: Interfluves, terraces
Landform position (three-dimensional): Tread
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Pleasant, frequently ponded

Percent of map unit: 2 percent
Landform: Closed depressions
Down-slope shape: Concave, linear
Across-slope shape: Concave
Ecological site: R067BY010CO - Closed Depression
Hydric soil rating: Yes

Urban land

Percent of map unit: 2 percent
Hydric soil rating: No

Ellicott, occasionally flooded

Percent of map unit: 1 percent
Landform: Flood plains, drainageways
Down-slope shape: Linear
Across-slope shape: Concave, linear
Ecological site: R067BY031CO - Sandy Bottomland
Hydric soil rating: No

Data Source Information

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 21, Aug 24, 2023

El Paso County Area, Colorado

97—Truckton sandy loam, 3 to 9 percent slopes

Map Unit Setting

National map unit symbol: 2x0j2

Elevation: 5,300 to 6,850 feet

Mean annual precipitation: 14 to 19 inches

Mean annual air temperature: 48 to 52 degrees F

Frost-free period: 85 to 155 days

Farmland classification: Not prime farmland

Map Unit Composition

Truckton and similar soils: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Truckton

Setting

Landform: Interfluves, hillslopes

Landform position (two-dimensional): Backslope

Landform position (three-dimensional): Side slope

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Re-worked alluvium derived from arkose

Typical profile

A - 0 to 4 inches: sandy loam

Bt1 - 4 to 12 inches: sandy loam

Bt2 - 12 to 19 inches: sandy loam

C - 19 to 80 inches: sandy loam

Properties and qualities

Slope: 3 to 9 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): High
(2.00 to 6.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum content: 1 percent

Maximum salinity: Nonsaline (0.1 to 1.9 mmhos/cm)

Available water supply, 0 to 60 inches: Moderate (about 6.6 inches)

Interpretive groups

Land capability classification (irrigated): 6e

Land capability classification (nonirrigated): 6e

Hydrologic Soil Group: A
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Minor Components

Blakeland

Percent of map unit: 8 percent
Landform: Interfluves, hillslopes
Landform position (two-dimensional): Summit, shoulder, backslope
Landform position (three-dimensional): Side slope, crest
Down-slope shape: Convex, linear
Across-slope shape: Convex, linear
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Bresser

Percent of map unit: 7 percent
Landform: Interfluves, low hills
Landform position (two-dimensional): Footslope, toeslope
Landform position (three-dimensional): Base slope
Down-slope shape: Concave, linear
Across-slope shape: Concave, linear
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Data Source Information

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 21, Aug 24, 2023

F.E.M.A. MAP

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, N/NGS12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, and Anderson Consulting Engineers, Inc. These data are current as of 2008.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call **1-877-FEMA MAP (1-877-336-2627)** or visit the FEMA website at <http://www.fema.gov/business/nfp>.

El Paso County Vertical Datum Offset Table	
Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION


REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION

REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION



Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

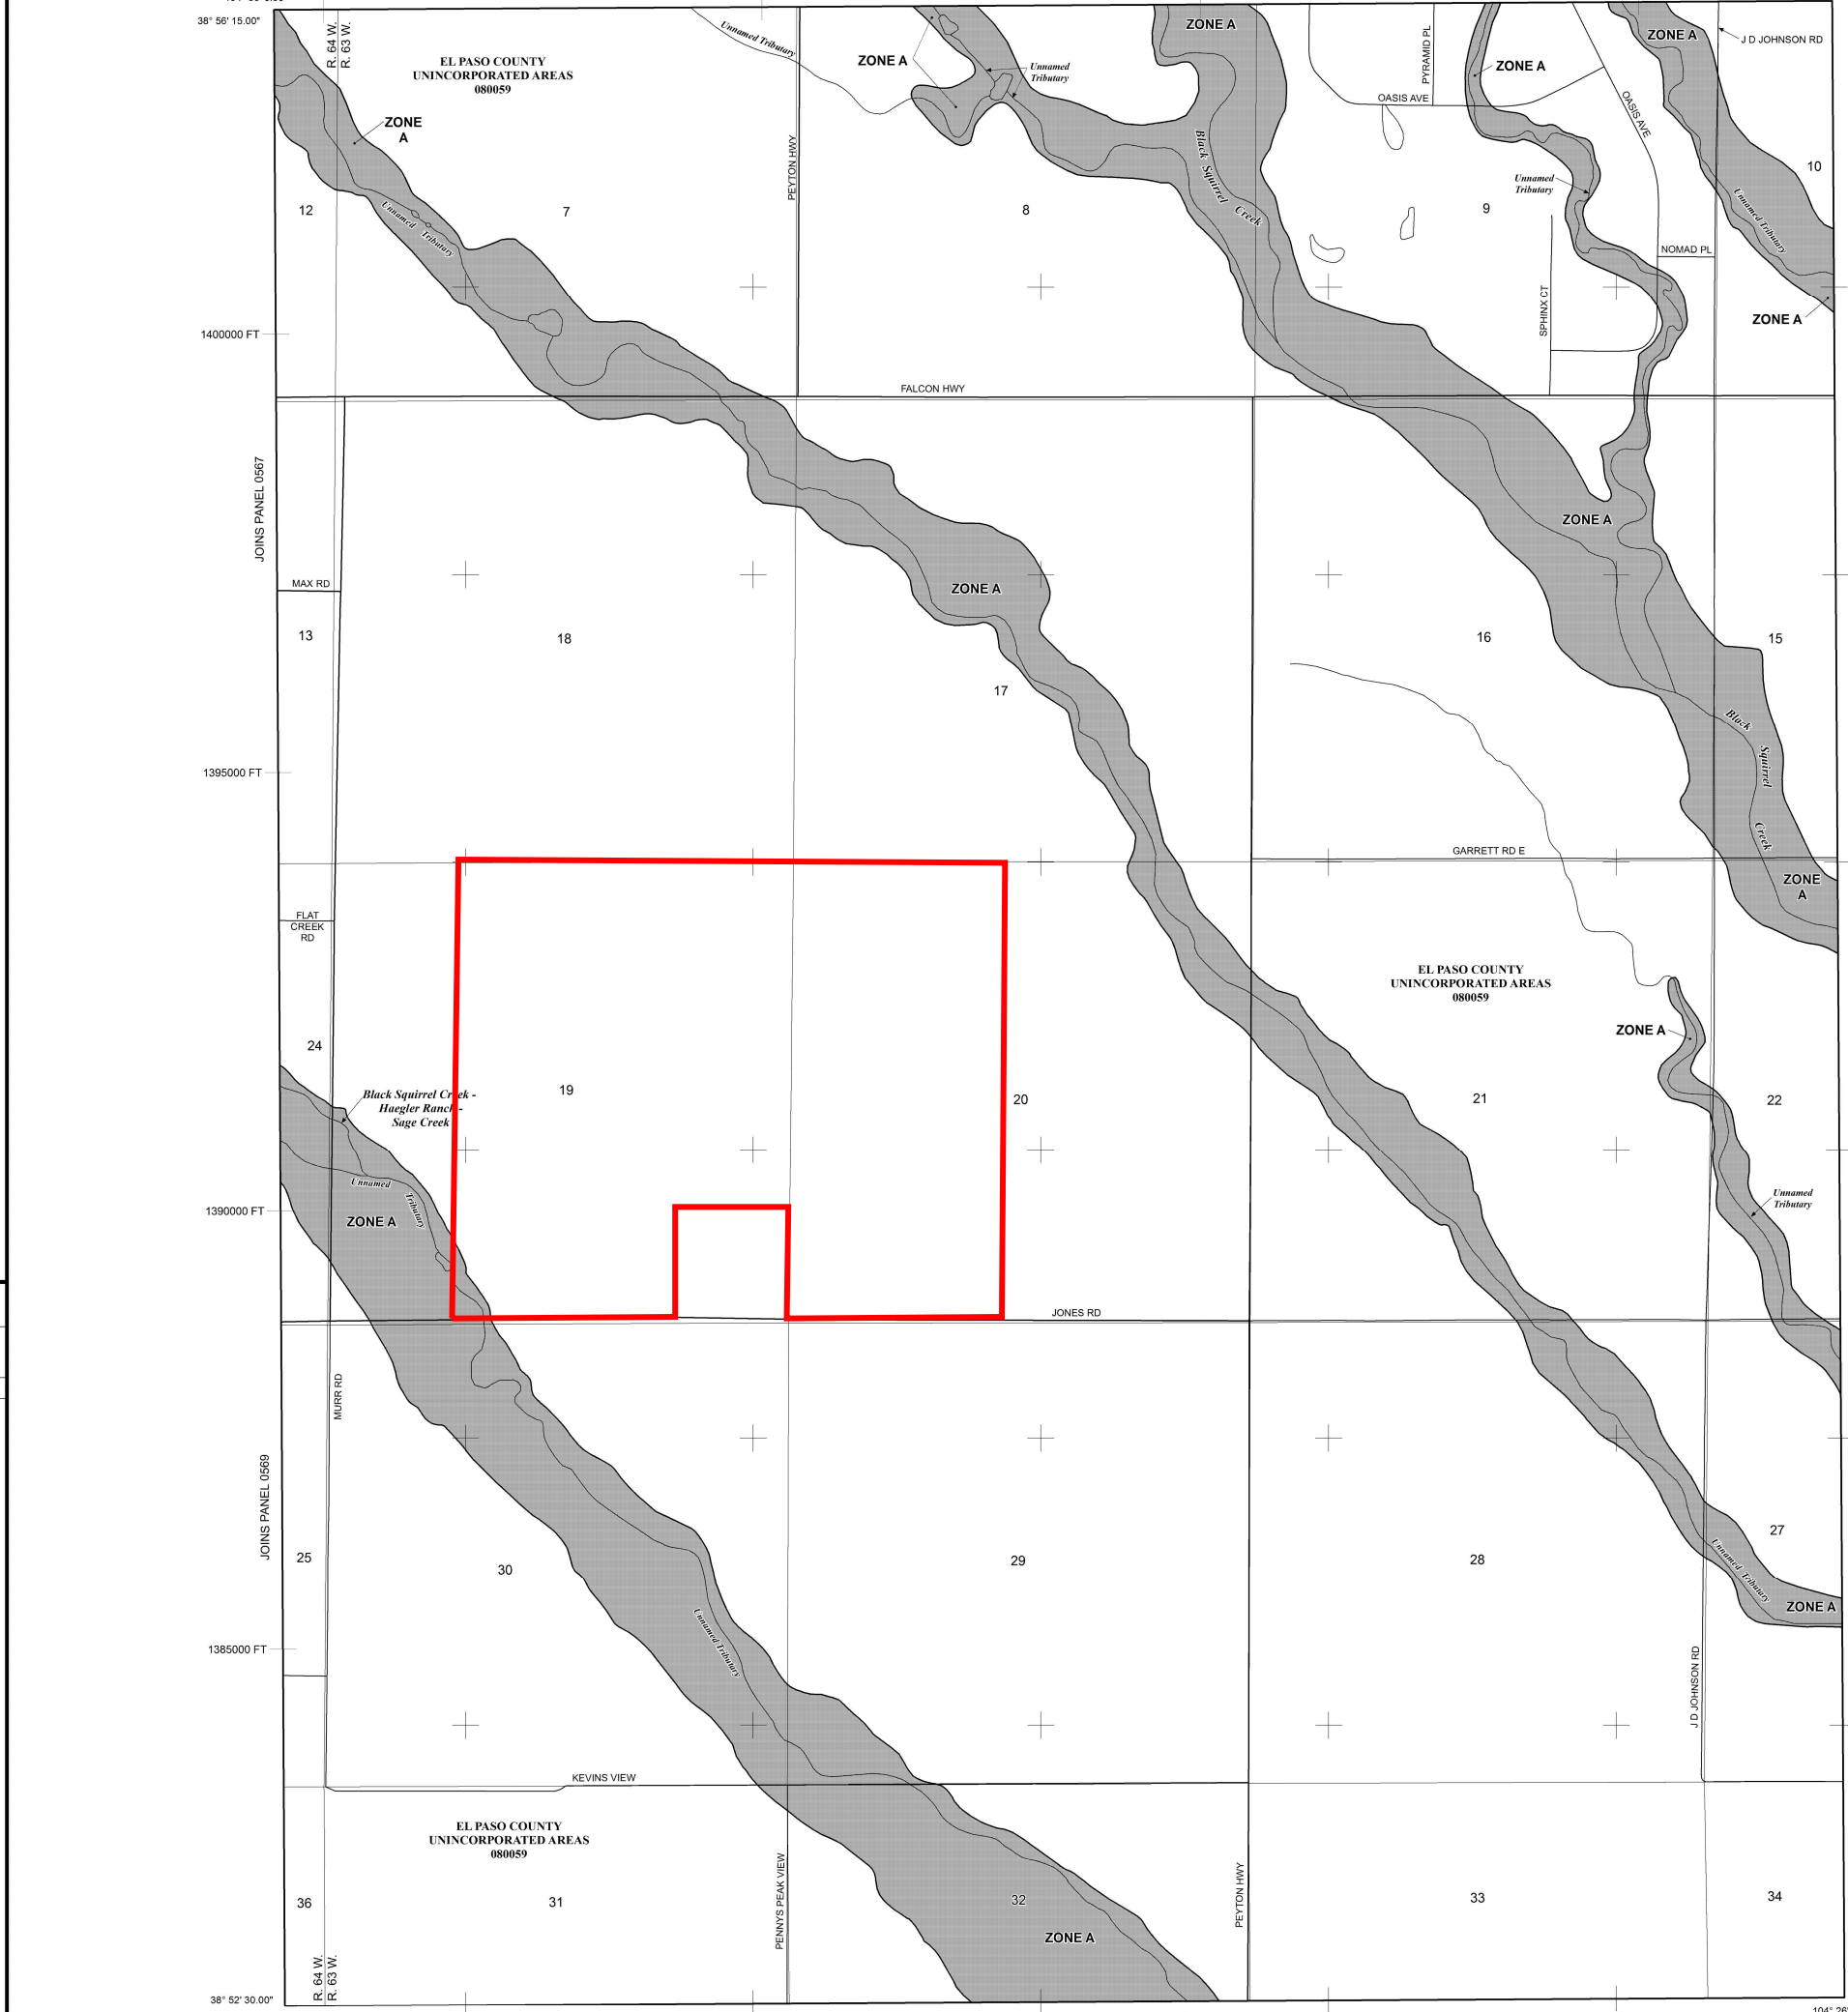

ZONE A No Base Flood Elevations determined.

ZONE AE Base Flood Elevations determined.

ZONE AH Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.

ZONE AO Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.

ZONE AR Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.

ZONE A99 Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.

ZONE V Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.

ZONE VE Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

OTHER FLOOD AREAS

ZONE X Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

ZONE X Areas determined to be outside the 0.2% annual chance floodplain.

ZONE D Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

Floodplain boundary
Floodway boundary
Zone D Boundary
CBRS and OPA boundary
Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.
Base Flood Elevation line and value; elevation in feet*
Base Flood Elevation value where uniform within zone; elevation in feet*

* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

A-A Cross section line
23-23 Transect line
97° 07' 30.00" 32° 22' 30.00" Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
4275000N 1000-meter Universal Transverse Mercator grid ticks, zone 13
6000000 FT 5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 5002), Lambert Conformal Conic Projection
DX5510 X Bench mark (see explanation in Notes to Users section of this FIRM panel)
M1.5 River Mile


MAP REPOSITORIES
Refer to Map Repositories list on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
MARCH 17, 1997

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL
DECEMBER 7, 2018 To update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.



PANEL 0590G

FIRM
FLOOD INSURANCE RATE MAP
EL PASO COUNTY, COLORADO AND INCORPORATED AREAS

PANEL 590 OF 1300
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:	COMMUNITY	NUMBER	PANEL	SUFFIX
	EL PASO COUNTY	080059	0590	G


Notice to User: The Map Number shown below should be used when placing map orders: the Community Number shown above should be used on insurance applications for the subject community.

MAP NUMBER
08041C0590G
MAP REVISED

National Flood Hazard Layer FIRMMette



104°29'51"W 38°54'2"N



1:6,000

104°29'14"W 38°53'34"N

Basemap Imagery Source: USGS National Map 2023

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) <i>Zone A, V, A99</i>
		With BFE or Depth <i>Zone AE, AO, AH, VE, AR</i>
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile <i>Zone X</i>
		Future Conditions 1% Annual Chance Flood Hazard <i>Zone X</i>
		Area with Reduced Flood Risk due to Levee. See Notes. <i>Zone X</i>
		Area with Flood Risk due to Levee <i>Zone D</i>
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard <i>Zone X</i>
		Effective LOMRs
		Area of Undetermined Flood Hazard <i>Zone D</i>
GENERAL STRUCTURES		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
		17.5 Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Profile Baseline
MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped
		The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.








This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 6/8/2023 at 12:19 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

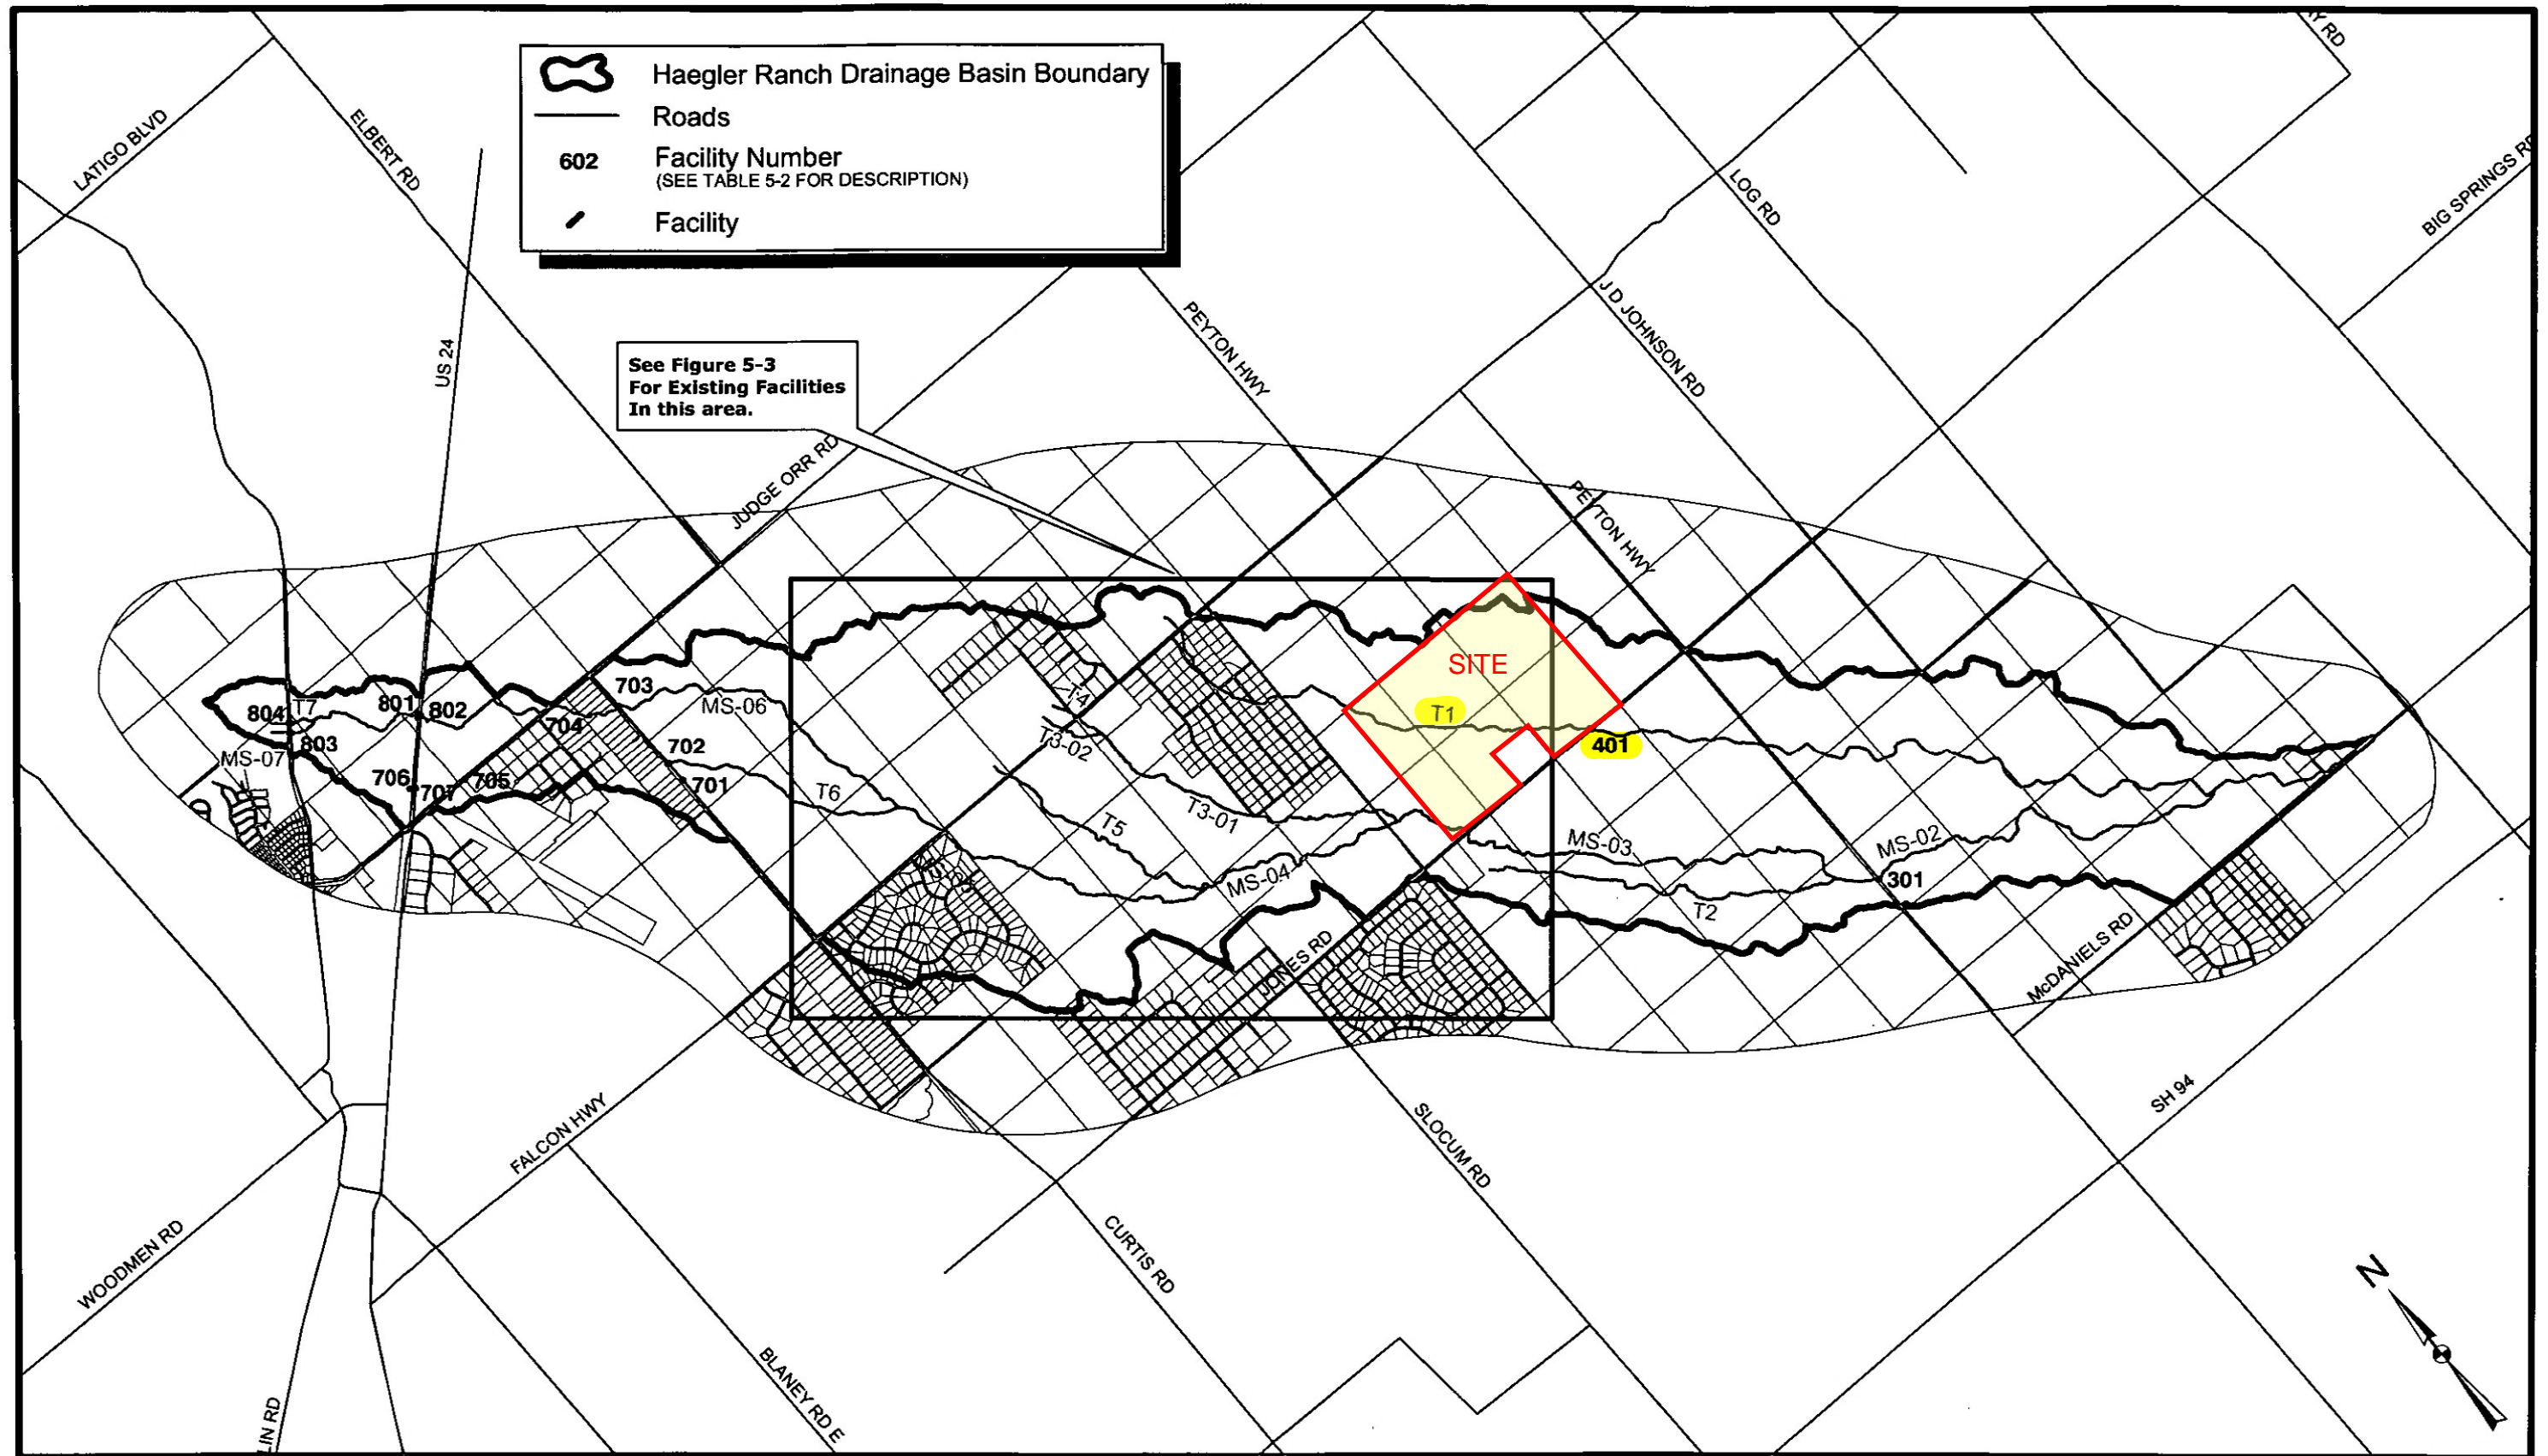This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.


**REFERENCES FROM
HAEGLER RANCH DBPS**



 Haegler Ranch Drainage Basin Boundary
 Roads
 Facility Number
 (SEE TABLE 5-2 FOR DESCRIPTION)
 Facility


See Figure 5-3
For Existing Facilities
In this area.

URS
 9960 Federal Dr.
 Suite 300
 Colorado Springs, CO 80921
 719.531.0001




DATE: 09/08

HAEGLER RANCH DRAINAGE BASIN
FACILITY INVENTORY A
FIGURE 5-2

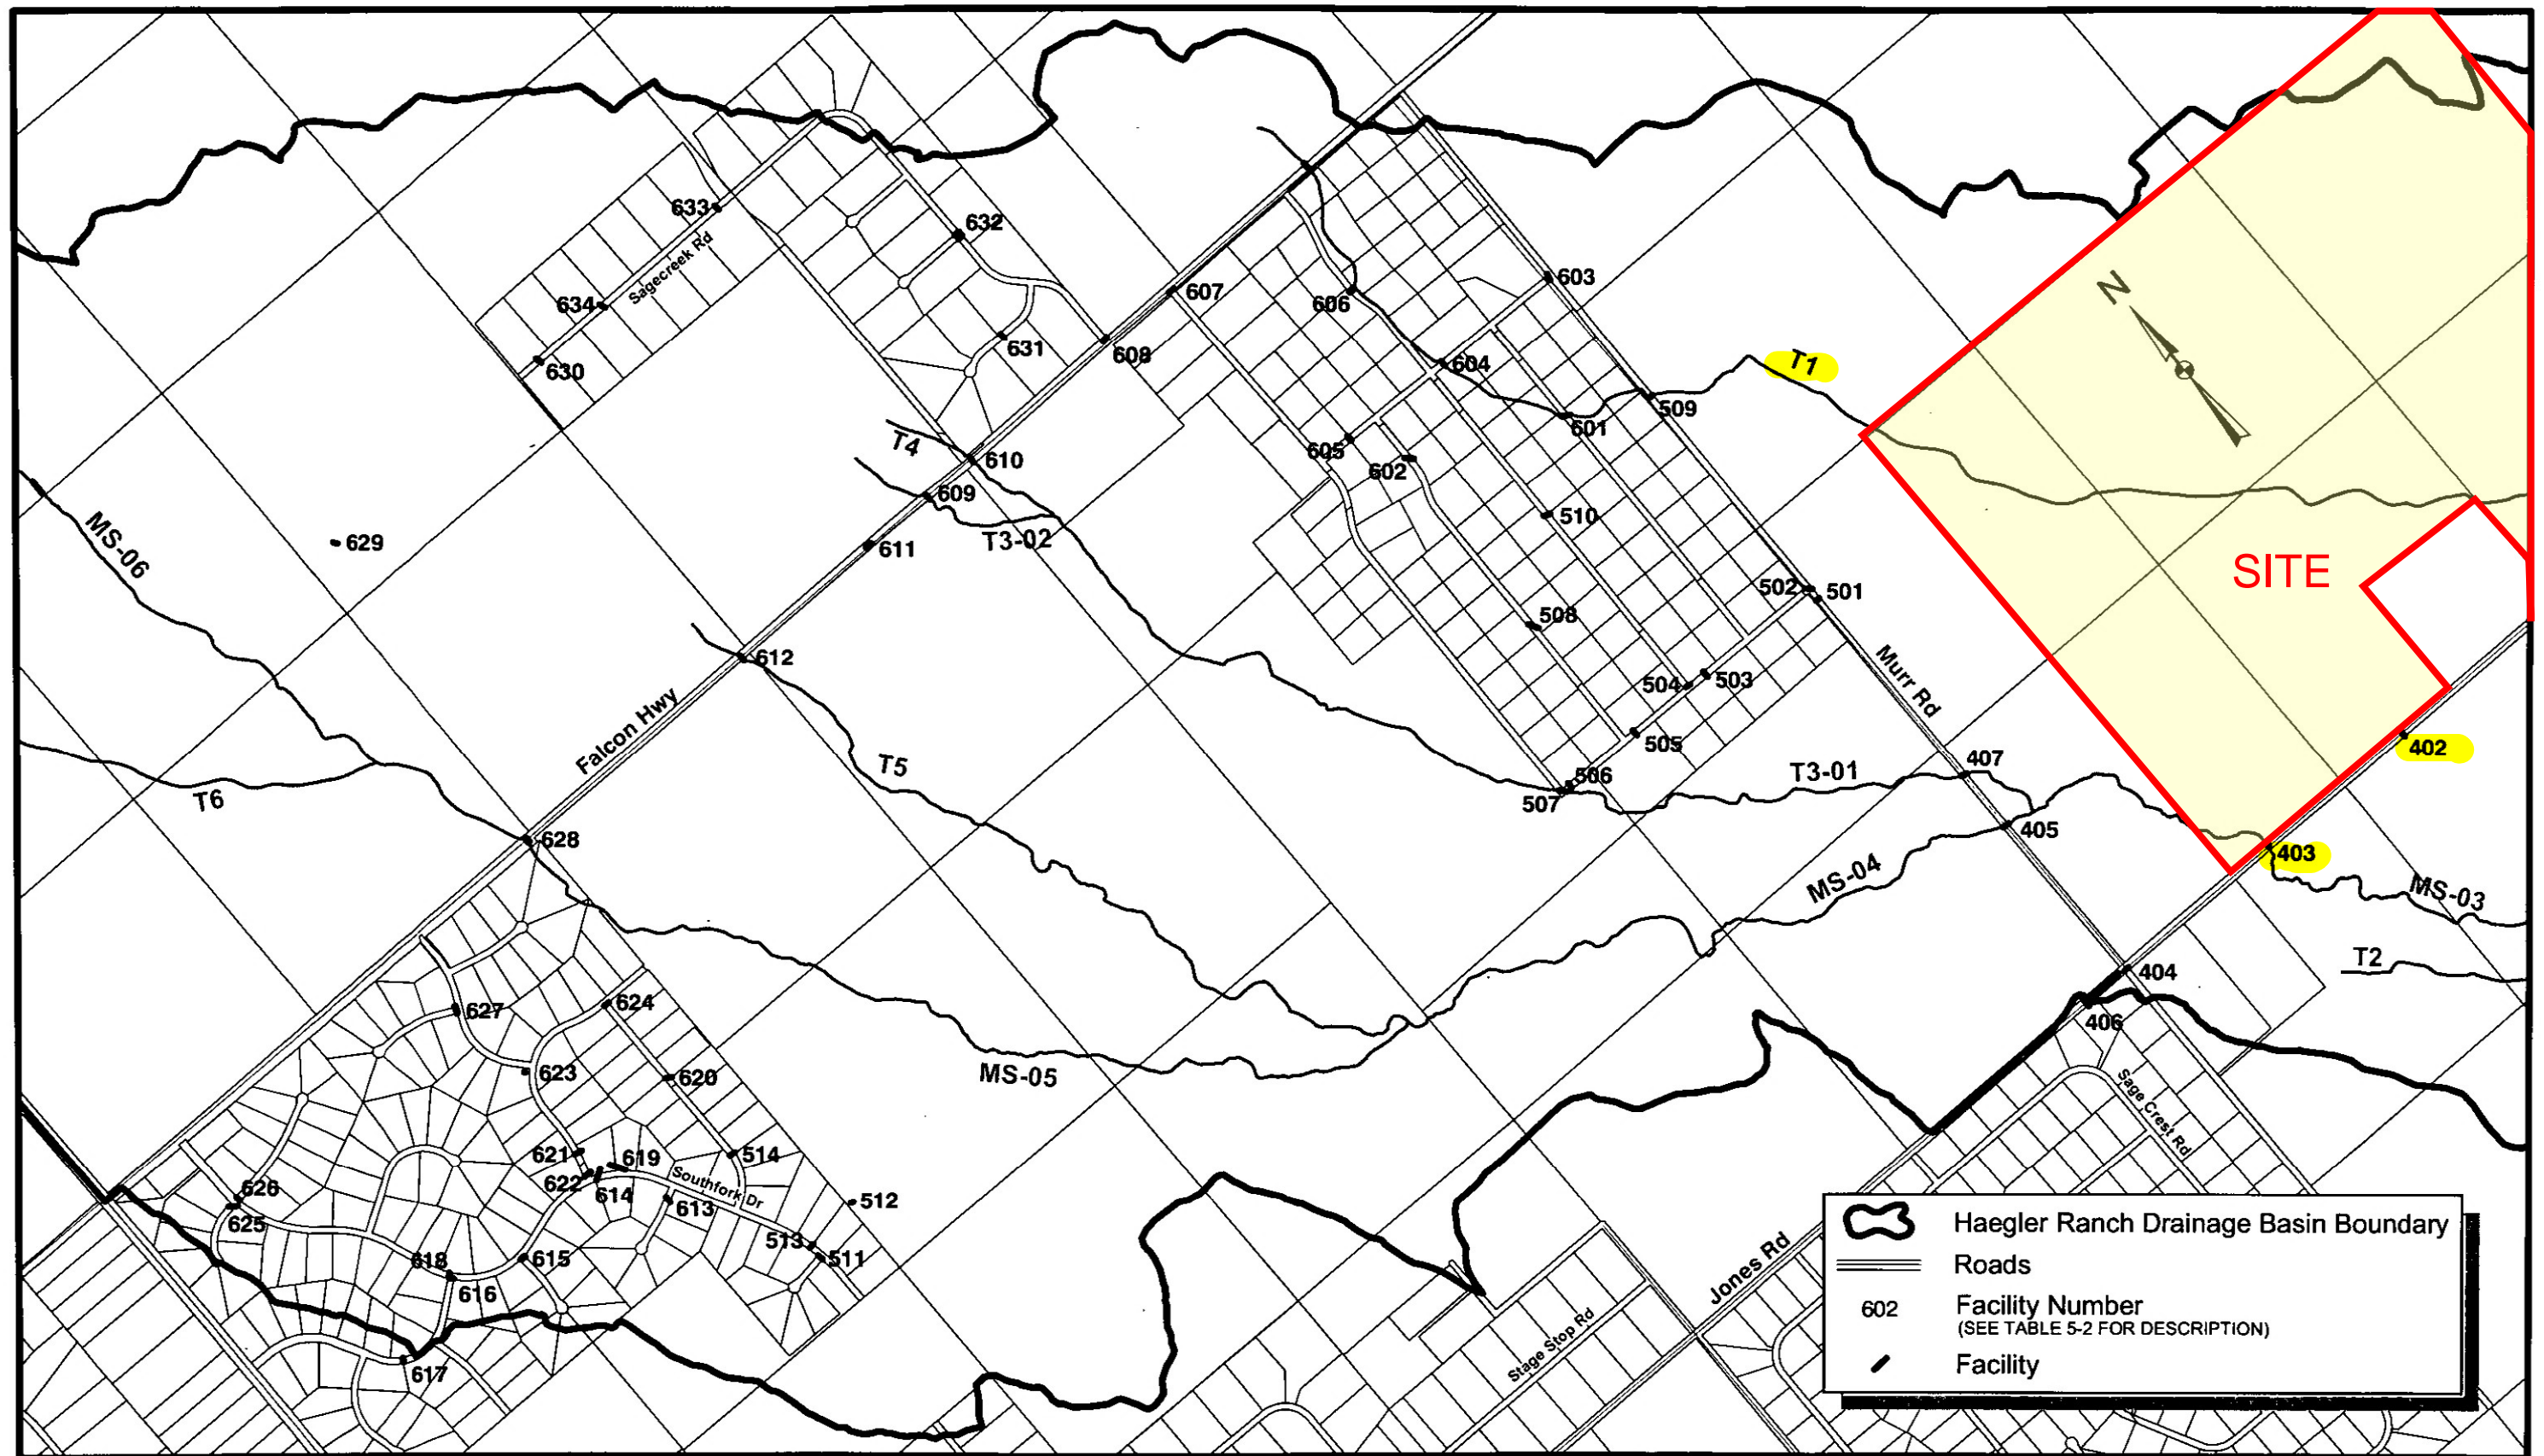

URS
 9960 Federal Dr.
 Suite 300
 Colorado Springs, CO 80921
 719.531.0001



DATE: 09/08

HAEGLER RANCH DRAINAGE BASIN

FACILITY INVENTORY B
FIGURE 5-3

**Table C3
Existing Condition Culvert Improvements Cost Estimate**

Facility Number	Road Crossing	Channel	Existing Size	Existing 100-yr Flow (cfs)	Deficiency	Necessary Facility for Existing 100-year Flow	Number of Culverts	Assumed Length (LF)	Unit Cost	End Section Unit Cost	Headwall Concrete (LF/HW)	Headwall Steel (LB/HW)	Wingwall Concrete (CY)	Wingwall Steel (tons)	Concrete Unit Cost \$/CY	Steel Unit Cost \$/ton	Total Cost
301	Peyton Highway	Main Stem (MS-02)	2-33"X48" CMPs	2,500	Overtops	7-6'X6' RCBs	7	90	\$475		0.581	151	19.7	774.4	\$435	\$1.1	\$314,535
401	Jones Road	Tributary 1 (T1)	2-24" CMPs	370	Overtops	6'X6' RCB	1	90	\$475		0.652	169.4	19.7	774.4	\$435	\$1.1	\$53,111
403	Jones Road	Main Stem (MS-03)	3-60" CMPs	2,300	Overtops	6-6'X6' RCBs	6	90	\$475		0.581	151	19.7	774.4	\$435	\$1.1	\$270,947
405	Murr Road	Main Stem (MS-04)	66" RCP	1,700	Overtops	5-6'X6' RCBs	5	70	\$475		0.652	169.4	19.7	774.4	\$435	\$1.1	\$180,371
407	Murr Road	Tributary 3 (T3-01)	66" RCP	670	Overtops	2-6'X6' RCBs	2	70	\$475		0.652	169.4	19.7	774.4	\$435	\$1.1	\$77,801
507	Peerless Farms Road	Tributary 3 (T3-01)	60" CMP	600	Overtops	2-6'X6' RCBs	2	110	\$475		0.652	169.4	19.7	774.4	\$435	\$1.1	\$115,801
509	Murr Road	Tributary 1 (T1)	2-15" RCPs	220	Overtops	66" RCP	1	70	\$210	\$2,300							\$19,300
601	Whiting Way	Tributary 1 (T1)	24" CMP	220	Overtops	66" RCP	1	90	\$210	\$2,300							\$23,500
604	Max Road	Tributary 1 (T1)	18" CMP	220	Overtops	66" RCP	1	70	\$210	\$2,300							\$19,300
609	Falcon Highway	Tributary 3 (T3-02)	18" CMP	180	Overtops	66" RCP	1	100	\$210	\$2,300							\$25,600
610	Falcon Highway	Tributary 4 (T4)	24" CMP	200	Overtops	66" RCP	1	90	\$210	\$2,300							\$23,500
612	Falcon Highway	Tributary 5 (T5)	24" CMP	150	Overtops	60" RCP	1	90	\$185	\$2,275							\$21,200
628	Falcon Highway	Main Stem (MS-05)	2-60" CMPs	1,000	Overtops	3-6'X6' RCBs	3	100	\$475		0.652	169.4	19.7	774.4	\$435	\$1.1	\$154,741
702	Curtis Road	Tributary 6 (T6)	36" CMP	120	Overtops	54" RCP	1	130	\$145	\$2,150							\$23,150
703	Curtis Road	Main Stem (MS-06)	24" CMP	590	Overtops	2-6'X6' RCBs	2	120	\$475		0.652	169.4	19.7	774.4	\$435	\$1.1	\$125,301
704	Judge Orr Road	Main Stem (MS-06)	Blocked Culvert	540	Overtops	2-72" RCPs	2	160	\$230	\$2,400							\$83,200
801	Pedestrian Bridge	Main Stem (MS-06)	Bridge	350	Meets Capacity	Existing Bridge											\$0
802	US24	Main Stem (MS-06)	2-66" CMPs	350	Meets Capacity	Existing Culvert											\$0
803	Eastonville Road	Main Stem (MS-07)	27"X21" CMP	25	Overtops	30" RCP	1	110	\$68	\$1,100							\$9,680
804	Eastonville Road	Tributary 7 (T7)	18" CMP	99	Overtops	48" RCP	1	100	\$110	\$1,990							\$14,980
N/A	Peyton Highway	Tributary 1 (T1)	No Culvert	500	Overtops	2-72" RCPs	2	90	\$230	\$2,400							\$51,000
N/A	Falcon Highway	Tributary 1 (T1)	No Culvert	33	Overtops	36" RCP	1	90	\$80	\$1,275							\$9,750

¹ Length is based on Future Land Use Road widths

² Wingwalls assumed 15' long for calculations. Calculations based on CDOT cross sections.

Sub-Total	\$1,616,769
30% Construction Contingency	\$485,031
15% Engineering Contingency	\$242,515
Total	\$2,344,315

6.4. Cost Estimates

The regional and subregional detention alternatives have been evaluated by assembling necessary design requirements using the above criteria and estimating the capital cost of the improvements. Proposed improvements are separated into existing or future, depending on whether facilities are designed for the existing or future peak flow rates. Unit rates for all cost estimating are based on an average of the bid tabulations published by CDOT for 2006. These unit rates are presented in Table 6-11. Land acquisition costs were included only for the detention facilities in the alternatives analysis, because channel improvements would essentially be in floodplain areas not otherwise developable. Cost estimates are included in Appendix C.

Table 6-11 Unit Rates

Item Number	Description	Units	URS Estimated Unit Price
203-00010	Unclassified Excavation (Complete In Place)	CY	\$7.00
203-00060	Embankment Material (Complete In Place)	CY	\$9.00
207-00205	Topsoil	CY	\$8.00
212-00006	Seeding (Native)	ACRE	\$580.00
420-00100	Geotextile (Erosion Control) (Class A)	SY	\$3.00
506-00206	Riprap (6 Inch)	CY	\$80.00
506-00212	Riprap (12 Inch)	CY	\$76.00
506-00218	Riprap (18 Inch)	CY	\$64.00
507-00100	Concrete Slope and Ditch Paving (Reinforced)	CY	\$300.00
601-03030	Concrete Class D (Box Culvert)	CY	\$435.00
602-00000	Reinforcing Steel	LB	\$1.10
603-01185	18 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$48.00
603-01245	24 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$56.00
603-01305	30 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$68.00
603-01365	36 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$80.00
603-01425	42 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$100.00
603-01485	48 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$110.00
603-01545	54 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$145.00
603-01605	60 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$185.00
603-01665	66 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$210.00
603-01725	72 Inch Reinforced Concrete Pipe (Complete In Place)	LF	\$230.00
603-05018	18 Inch Reinforced Concrete End Section	EACH	\$735.00
603-05024	24 Inch Reinforced Concrete End Section	EACH	\$850.00
603-05030	30 Inch Reinforced Concrete End Section	EACH	\$1,100.00
603-05036	36 Inch Reinforced Concrete End Section	EACH	\$1,275.00
603-05042	42 Inch Reinforced Concrete End Section	EACH	\$1,550.00
603-05048	48 Inch Reinforced Concrete End Section	EACH	\$1,990.00
603-05054	54 Inch Reinforced Concrete End Section	EACH	\$2,150.00
603-05060	60 Inch Reinforced Concrete End Section	EACH	\$2,275.00

Item Number	Description	Units	URS Estimated Unit Price
603-05066	66 Inch Reinforced Concrete End Section	EACH	\$2,300.00
603-05072	72 Inch Reinforced Concrete End Section	EACH	\$2,400.00
603-70606	6x6 Foot Concrete Box Culvert (Precast)	LF	\$475.00
603-70806	8x6 Foot Concrete Box Culvert (Precast)	LF	\$535.00
603-71006	10x6 Foot Concrete Box Culvert (Precast)	LF	\$570.00
N/A	Land Acquisition	ACRE	\$55,000

Note: Land acquisition costs were provided by El Paso County

Cost estimates have been prepared for public roadway crossing facilities designed for existing peak flow rates and are shown in Table 6-12.

Table 6-12 Existing Conditions Roadway Crossing Deficiencies and Costs to Correct

Facility Number	Road Crossing	Channel	Necessary Facility	Cost
301	Peyton Highway	Main Stem (MS-02)	7-6' X6' RCBs	\$314,535
401	Jones Road	Tributary 1 (T1)	6' X6' RCB	\$53,111
403	Jones Road	Main Stem (MS-03)	6-6' X6' RCBs	\$270,947
405	Murr Road	Main Stem (MS-04)	5-6' X6' RCBs	\$180,371
407	Murr Road	Tributary 3 (T3-01)	2-6' X6' RCBs	\$77,801
507	Peerless Farms Road	Tributary 3 (T3-01)	2-6' X6' RCBs	\$115,801
509	Murr Road	Tributary 1 (T1)	66" RCP	\$19,300
601	Whiting Way	Tributary 1 (T1)	66" RCP	\$23,500
604	Max Road	Tributary 1 (T1)	66" RCP	\$19,300
609	Falcon Highway	Tributary 3 (T3-02)	66" RCP	\$25,600
610	Falcon Highway	Tributary 4 (T4)	66" RCP	\$23,500
612	Falcon Highway	Tributary 5 (T5)	60" RCP	\$21,200
628	Falcon Highway	Main Stem (MS-05)	3-6' X6' RCBs	\$154,741
702	Curtis Road	Tributary 6 (T6)	54" RCP	\$23,150
703	Curtis Road	Main Stem (MS-06)	2-6' X6' RCBs	\$125,301
704	Judge Orr Road	Main Stem (MS-06)	2-72" RCPs	\$83,200
801	Pedestrian Bridge	Main Stem (MS-06)	Existing Bridge	\$0
802	US24	Main Stem (MS-06)	Existing Culvert	\$0
803	Eastonville Road	Main Stem (MS-07)	30" RCP	\$9,680
804	Eastonville Road	Tributary 7 (T7)	48" RCP	\$14,980
N/A	Peyton Highway	Tributary 1 (T1)	2-72" RCPs	\$51,000
N/A	Falcon Highway	Tributary 1 (T1)	36" RCP	\$9,750
Sub-Total				\$1,616,769
30% Construction Contingency				\$485,031
15% Engineering Contingency				\$242,515
Total				\$2,344,315

(See Table C3 in Appendix C for details)

Table 6-16 Sub-Regional Detention Roadway Crossing Cost Estimate Summary

Facility Number	Road Crossing	Channel	Proposed 100-yr Flow (cfs)	Necessary Facility for Proposed 100-year Flow	Estimated Cost
301	Peyton Highway	Main Stem (MS-02)	3,370	9-6'X6' RCBs	\$402,000
403	Jones Road	Main Stem (MS-03)	2,970	8-6'X6' RCBs	\$358,000
405	Murr Road	Main Stem (MS-04)	2,870	8-6'X6' RCBs	\$283,000
609	Falcon Highway	Tributary 3 (T3-02)	460	2-6'X6' RCBs	\$106,000
N/A	Falcon Highway	Tributary 1 (T1)	110	2 - 36" RCP	\$20,000
1001	Future Pastura Street	Main Stem (MS-06)	610	2-6'X6' RCBs	\$107,000
1002	Future Arroyo Hondo Blvd. N.	Main Stem (MS-06)	610	2-6'X6' RCBs	\$87,000
1003	Future Arroyo Hondo Blvd. N.	Main Stem (MS-06)	530	2-6'X6' RCBs	\$87,000
1004	Future Pastura Street	Tributary 6 (T6)	440	2-66" RCPs	\$43,000
1005	Future El Vado Road	Tributary 6 (T6)	440	2-66" RCPs	\$43,000
1006	Future Socorro Trail	Tributary 6 (T6)	440	2-66" RCPs	\$43,000
Sub-Total					\$1,582,000
30% Construction Contingency					\$475,000
15% Engineering Contingency					\$237,000
Total					\$2,294,000

(See Tables C5 in Appendix C for details)

6.4.2. Detention Pond Costs

The cost of detention ponds, both regional and subregional, is based on the cubic yards of excavation, an estimated outlet structure, and the cost of the land required for the facility. These costs are presented in Table 6-17 and Table 6-18.

Table 6-17 Regional Detention Pond Cost Summary

Facility	Storage (AF)	Total Cost Including Construction and Engineering Contingencies
RG-01 9.02	9.02	\$542,000
RG-02 64.52	64.52	\$4,053,000
RG-03 0.04	0.04	\$146,000
RG-04 1.07	1.07	\$160,000
RG-05 0.03	0.03	\$146,000
Total		\$5,048,000

(See Tables C1 in Appendix C for details)

Table 6-18 Sub-Regional Detention Pond Cost Summary

Facility	Storage (AF)	Total Cost Including Construction and Engineering Contingencies
SR-01	10	\$899,000
SR-02	5	\$640,000
SR-03	16	\$868,000
SR-04	25	\$1,453,000
SR-05	24	\$1,557,000
SR-06	9	\$547,000
SR-07	5	\$524,000
SR-08	5	\$326,000
SR-09	20	\$861,000
SR-10	23	\$1,069,000
SR-11	2	\$182,000
SR-12	9	\$477,000
SR-13	3	\$376,000
Total		\$9,780,000

(See Table C1 in Appendix C for details)

6.4.3. Other Costs

Design Engineering costs are also included as 15% of the construction costs. Construction contingencies (30%) include such items as utility relocations, mobilization, temporary erosion control, and construction engineering.

6.4.4. Conceptual Alternative Costs

The total estimated capital costs for each alternative are based on the sum of the cost of the proposed facilities, plus costs for engineering and construction contingencies. These costs are listed in Table 6-19.

Table 6-19 Conceptual Alternative Costs

	Regional Alternative	Subregional Alternative
Detention Ponds	\$5,048,000	\$9,780,000
Channel Improvements	\$10,737,000	\$2,110,000
Drop Structures	\$9,988,000	\$3,442,000
Roadway Crossing Culverts	\$2,307,000	\$2,294,000
Total	\$28,080,000	\$17,627,000

Table 5-3 Existing Hydraulic Deficiencies

Facility Number	Road Crossing	Channel	Existing Size	Existing 100-yr Flow (cfs)	Deficiency
301	Peyton Highway	Main Stem (MS-02)	2-33"X48" CMPs	2,500	Overtops
N/A	Peyton Highway	Tributary 1 (T1)	No Culvert	500	Overtops
401	Jones Road	Tributary 1 (T1)	2-24" CMPs	370	Overtops
402	Jones Road	N/A	15" RCP	N/A	N/A
403	Jones Road	Main Stem (MS-03)	3-60" CMPs	2,300	Overtops
404	Jones Road	N/A	18" CMP	N/A	N/A
405	Murr Road	Main Stem (MS-04)	66" RCP	1,700	Overtops
406	Jones Road	N/A	4.1' x 6.9' RCP	N/A	N/A
407	Murr Road	Tributary 3 (T3-01)	66" RCP	670	Overtops
501	Murr Road	N/A	2-14" RCP	N/A	N/A
502	Murr Road	N/A	2-18" CMP	N/A	N/A
503	Flat Creek Road	N/A	30" CMP	N/A	N/A
504	Flat Creek Road	N/A	18" CMP	N/A	N/A
505	Flat Creek Road	N/A	36" CMP	N/A	N/A
506	Flat Creek Road	N/A	60" CMP	N/A	N/A
507	Peerless Farms Road	Tributary 3 (T3-01)	60" CMP	600	Overtops
508	Whipsaw Road	N/A	30" CMP	N/A	N/A
509	Murr Road	Tributary 1 (T1)	2-15" RCPs	220	Overtops
510	Prospero Road	N/A	18" CMP	N/A	N/A
511	Southfork Dr	N/A	24" CMP	N/A	N/A
512	Falcon Grassy Hts	N/A	2-12" CMP	N/A	N/A
513	Southfork Dr	N/A	36" CMP	N/A	N/A
514	Oil Baron Dr	N/A	30" CMP	N/A	N/A
601	Whiting Way	Tributary 1 (T1)	24" CMP	220	Overtops
602	Whipsaw Road	N/A	24" CMP	N/A	N/A
603	Murr Road	N/A	24" CMP	N/A	N/A
604	Max Road	Tributary 1 (T1)	18" CMP	220	Overtops
605	Max Road	N/A	2-24" CMP	N/A	N/A

Table 7-4 Reimbursable Costs

Reimbursable Culvert Improvements					
Culvert	Road Crossing	Channel	Culvert Construction Cost	Contingency Cost	Total Cost
N/A	Peyton Highway	Tributary 1 (T1)	\$51,000	\$22,950	\$73,950
N/A	Falcon Highway	Tributary 1 (T1)	\$9,7580	\$4,388	\$14,138
301	Peyton Highway	Main Stem (MS-02)	\$314,535	\$141,541	\$456,076
401	Jones Road	Tributary 1 (T1)	\$53,111	\$23,900	\$77,011
403	Jones Road	Main Stem (MS-03)	\$270,947	\$121,926	\$392,874
405	Murr Road	Main Stem (MS-04)	\$180,371	\$81,167	\$261,538
407	Murr Road	Tributary 3 (T3-01)	\$77,801	\$35,011	\$112,812
507	Peerless Farms Road	Tributary 3 (T3-01)	\$115,801	\$52,111	\$167,912
509	Murr Road	Tributary 1 (T1)	\$19,300	\$8,685	\$27,985
601	Whiting Way	Tributary 1 (T1)	\$23,500	\$10,575	\$34,075
604	Max Road	Tributary 1 (T1)	\$19,300	\$8,685	\$27,985
609	Falcon Highway	Tributary 3 (T3-02)	\$25,600	\$11,520	\$37,120
610	Falcon Highway	Tributary 4 (T4)	\$23,500	\$10,575	\$34,075
612	Falcon Highway	Tributary 5 (T5)	\$21,200	\$9,540	\$30,740
628	Falcon Highway	Main Stem (MS-05)	\$154,741	\$69,633	\$224,375
702	Curtis Road	Tributary 6 (T6)	\$23,150	\$10,418	\$33,568
703	Curtis Road	Main Stem (MS-06)	\$125,301	\$56,386	\$181,687
704	Judge Orr Road	Main Stem (MS-06)	\$83,200	\$37,440	\$120,640
803	Eastonville Road	Main Stem (MS-07)	\$9,680	\$4,356	\$14,036
804	Eastonville Road	Tributary 7 (T7)	\$14,980	\$6,741	\$21,721
Subtotal Channel Costs					\$2,344,315
Reimbursable Detention Improvements					
Facility	Storage (AF)	Construction Cost	Contingency Cost	Total Cost	
SR-01	10	\$296,701	\$133,516	\$430,217	
SR-02	5	\$207,949	\$93,577	\$301,525	
SR-03	16	\$186,252	\$83,814	\$270,066	
SR-04	25	\$390,182	\$175,582	\$565,764	
SR-05	24	\$455,235	\$204,856	\$660,091	
SR-06	9	\$140,670	\$63,301	\$203,971	
SR-07	5	\$162,046	\$72,921	\$234,967	
SR-08	5	\$87,489	\$39,370	\$126,860	
SR-09	20	\$188,250	\$84,713	\$272,963	
SR-10	23	\$331,635	\$149,236	\$480,871	
SR-11	2	\$56,880	\$25,596	\$82,476	
SR-12	9	\$108,987	\$49,044	\$158,031	
SR-13	3	\$107,812	\$48,515	\$156,327	
Subtotal Detention Costs					\$3,944,129
Total Reimbursable Cost					\$6,288,444

HYDROLOGIC CALCULATIONS

SWMM 5.1 Subcatchment Hydrology

City of Colorado Springs Workshop

Instructors:

Derek Rapp, PE
Ben Urbonas, PE, D.WRE

1

2

Primary Inputs to describe SWMM Subcatchments

Property	Value
Name	2
X-Coordinate	3933.419
Y-Coordinate	4464.789
Description	
Tag	
Rain-Gage	*
Outlet	
Area	5
Width	500
% Slope	0.5
% Imperv	25
N-Imperv	0.01
N-Perv	0.1
Dstore-Imperv	0.05
Dstore-Perv	0.05
%Zero-Imperv	25
Subarea Routing	OUTLET
Percent Routed	100
Infiltration Data	HORTON
Groundwater	NO
Snow Pack	
LID Controls	0

Inputs and their corresponding properties:

- Description (optional) → Description
- Tag (optional) → Tag
- Name of Rain Gage for this catchment → Rain-Gage
- Name of Junction intercepting runoff → Outlet
- Subcatchment area in acres → Area
- Subcatchment Width – very sensitive user-defined parameter → Width
- Subcatchment slope towards Width in % → % Slope
- Subcatchment Imperviousness in % → % Imperv
- Manning's n Impervious surfaces → N-Imperv
- Manning's n pervious surfaces → N-Perv
- Inches of Depression Storage - impervious surfaces → Dstore-Imperv
- Inches of Depression Storage - pervious surfaces → Dstore-Perv
- % of Impervious Subcatchment with zero Dstore → %Zero-Imperv
- Routed to Outlet, Pervious, Impervious Surface → Subarea Routing
- % of Subcatchment Routed → Percent Routed
- Horton's Model: defined under "Options – General". Define here Max & Min Infiltration Rate, Decay Coeff. Drying Time and Max. Volume → Infiltration Data
- Identifies previously defined LID Control for this Subcatchment (if used) → LID Controls

2



General Information

- Homepage
- Progress Reports
- FAQ
- Glossary

Precipitation Frequency

- Data Server
- GIS Grids
- Maps
- Time Series
- Temporals
- Documents

Probable Maximum Precipitation

- Documents

Miscellaneous

- Publications
- Storm Analysis
- Record Precipitation

Contact Us

- Inquiries



NOAA ATLAS 14 POINT PRECIPITATION FREQUENCY ESTIMATES: CO

Data description

Data type: Units: Time series type:

Select location

1) Manually:

a) **By location** (decimal degrees, use "-" for S and W): Latitude: Longitude:

b) **By station (list of CO stations):**

c) **By address**

2) Use map:

<div style="display: flex; justify-content: space-between; align-items: center;"> Map <input type="button" value="v"/> </div>	<p>a) Select location Move crosshair or double click</p> <p>b) Click on station icon <input type="checkbox"/> Show stations on map</p> <hr/> <p>Location information: Name: Peyton, Colorado, USA* Latitude: 38.9025° Longitude: -104.4833° Elevation: 6429 ft **</p> <p style="font-size: small;">* Source: ESRI Maps ** Source: USGS</p>
--	--



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Deborah Martin, Sandra Pavlovic, Ishani Roy, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Michael Yekta, Geoffrey Bonnin

NOAA, National Weather Service, Silver Spring, Maryland

[PF_tabular](#) | [PF_graphical](#) | [Maps & aerials](#)

PF tabular





PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.241 (0.193-0.304)	0.294 (0.235-0.371)	0.386 (0.308-0.489)	0.468 (0.371-0.594)	0.587 (0.453-0.778)	0.685 (0.515-0.916)	0.787 (0.572-1.08)	0.897 (0.625-1.26)	1.05 (0.703-1.51)	1.17 (0.763-1.70)
10-min	0.353 (0.282-0.445)	0.431 (0.344-0.544)	0.566 (0.451-0.716)	0.685 (0.543-0.870)	0.859 (0.663-1.14)	1.00 (0.754-1.34)	1.15 (0.838-1.58)	1.31 (0.915-1.84)	1.54 (1.03-2.21)	1.71 (1.12-2.49)
15-min	0.430 (0.344-0.543)	0.525 (0.420-0.663)	0.690 (0.550-0.873)	0.835 (0.662-1.06)	1.05 (0.808-1.39)	1.22 (0.919-1.64)	1.41 (1.02-1.92)	1.60 (1.12-2.25)	1.87 (1.26-2.69)	2.09 (1.36-3.03)
30-min	0.621 (0.497-0.784)	0.758 (0.606-0.957)	0.994 (0.792-1.26)	1.20 (0.952-1.53)	1.51 (1.16-2.00)	1.76 (1.32-2.35)	2.02 (1.47-2.76)	2.30 (1.60-3.22)	2.69 (1.80-3.86)	3.00 (1.95-4.35)
60-min	0.797 (0.638-1.00)	0.963 (0.770-1.22)	1.26 (1.00-1.59)	1.52 (1.21-1.94)	1.92 (1.49-2.56)	2.26 (1.70-3.03)	2.61 (1.90-3.58)	3.00 (2.09-4.21)	3.54 (2.37-5.10)	3.97 (2.59-5.77)
2-hr	0.972 (0.783-1.22)	1.17 (0.940-1.46)	1.52 (1.22-1.91)	1.85 (1.47-2.33)	2.34 (1.83-3.10)	2.76 (2.09-3.68)	3.20 (2.35-4.38)	3.69 (2.60-5.17)	4.39 (2.97-6.29)	4.95 (3.25-7.14)
3-hr	1.06 (0.858-1.32)	1.26 (1.02-1.58)	1.64 (1.32-2.05)	1.99 (1.60-2.50)	2.54 (2.00-3.36)	3.01 (2.30-4.01)	3.52 (2.60-4.79)	4.08 (2.89-5.69)	4.88 (3.32-6.98)	5.53 (3.65-7.95)
6-hr	1.21 (0.985-1.49)	1.43 (1.16-1.77)	1.84 (1.50-2.29)	2.24 (1.81-2.79)	2.86 (2.27-3.77)	3.40 (2.62-4.51)	3.99 (2.97-5.41)	4.64 (3.32-6.45)	5.59 (3.84-7.95)	6.37 (4.24-9.08)
12-hr	1.36 (1.12-1.68)	1.61 (1.32-1.98)	2.06 (1.69-2.54)	2.50 (2.03-3.08)	3.17 (2.53-4.14)	3.75 (2.91-4.93)	4.38 (3.29-5.90)	5.08 (3.66-7.01)	6.10 (4.22-8.61)	6.92 (4.64-9.82)
24-hr	1.55 (1.28-1.89)	1.82 (1.50-2.21)	2.30 (1.90-2.82)	2.76 (2.26-3.39)	3.47 (2.79-4.48)	4.08 (3.18-5.31)	4.74 (3.58-6.31)	5.46 (3.96-7.46)	6.49 (4.53-9.10)	7.34 (4.96-10.3)
2-day	1.78 (1.48-2.15)	2.07 (1.72-2.51)	2.60 (2.16-3.16)	3.10 (2.55-3.77)	3.85 (3.11-4.92)	4.49 (3.53-5.79)	5.18 (3.94-6.84)	5.93 (4.33-8.03)	7.00 (4.92-9.73)	7.87 (5.37-11.0)
3-day	1.94 (1.62-2.33)	2.27 (1.90-2.73)	2.86 (2.38-3.45)	3.40 (2.81-4.12)	4.20 (3.40-5.34)	4.88 (3.85-6.26)	5.61 (4.28-7.36)	6.39 (4.68-8.61)	7.50 (5.29-10.4)	8.40 (5.75-11.7)
4-day	2.08 (1.75-2.50)	2.44 (2.04-2.93)	3.07 (2.56-3.69)	3.64 (3.02-4.40)	4.49 (3.64-5.67)	5.20 (4.11-6.63)	5.95 (4.55-7.78)	6.76 (4.97-9.07)	7.90 (5.59-10.9)	8.82 (6.07-12.3)
7-day	2.47 (2.09-2.94)	2.86 (2.41-3.41)	3.54 (2.98-4.23)	4.16 (3.47-4.99)	5.07 (4.14-6.36)	5.83 (4.64-7.39)	6.64 (5.11-8.62)	7.50 (5.55-10.0)	8.73 (6.22-12.0)	9.71 (6.72-13.4)
10-day	2.81 (2.38-3.33)	3.23 (2.73-3.84)	3.97 (3.35-4.73)	4.63 (3.88-5.54)	5.61 (4.59-6.99)	6.41 (5.12-8.09)	7.26 (5.61-9.38)	8.17 (6.07-10.8)	9.45 (6.76-12.9)	10.5 (7.28-14.4)
20-day	3.70 (3.16-4.35)	4.30 (3.66-5.06)	5.29 (4.49-6.24)	6.14 (5.18-7.27)	7.33 (6.01-9.00)	8.28 (6.64-10.3)	9.25 (7.18-11.8)	10.3 (7.66-13.4)	11.6 (8.36-15.7)	12.7 (8.90-17.4)
30-day	4.44 (3.80-5.20)	5.17 (4.42-6.06)	6.36 (5.42-7.47)	7.34 (6.23-8.66)	8.70 (7.14-10.6)	9.74 (7.83-12.0)	10.8 (8.40-13.6)	11.8 (8.87-15.4)	13.2 (9.56-17.7)	14.3 (10.1-19.5)
45-day	5.40 (4.65-6.29)	6.26 (5.38-7.30)	7.64 (6.54-8.93)	8.76 (7.46-10.3)	10.3 (8.44-12.4)	11.4 (9.18-14.0)	12.5 (9.75-15.7)	13.6 (10.2-17.6)	15.0 (10.9-19.9)	16.0 (11.4-21.7)
60-day	6.24 (5.38-7.24)	7.18 (6.19-8.34)	8.68 (7.46-10.1)	9.87 (8.44-11.6)	11.5 (9.44-13.7)	12.6 (10.2-15.4)	13.8 (10.8-17.2)	14.9 (11.2-19.1)	16.2 (11.8-21.5)	17.2 (12.3-23.3)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

PDS-based depth-duration-frequency (DDF) curves
 Latitude: 38.9025°, Longitude: -104.4833°

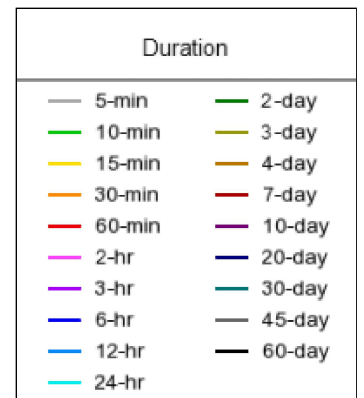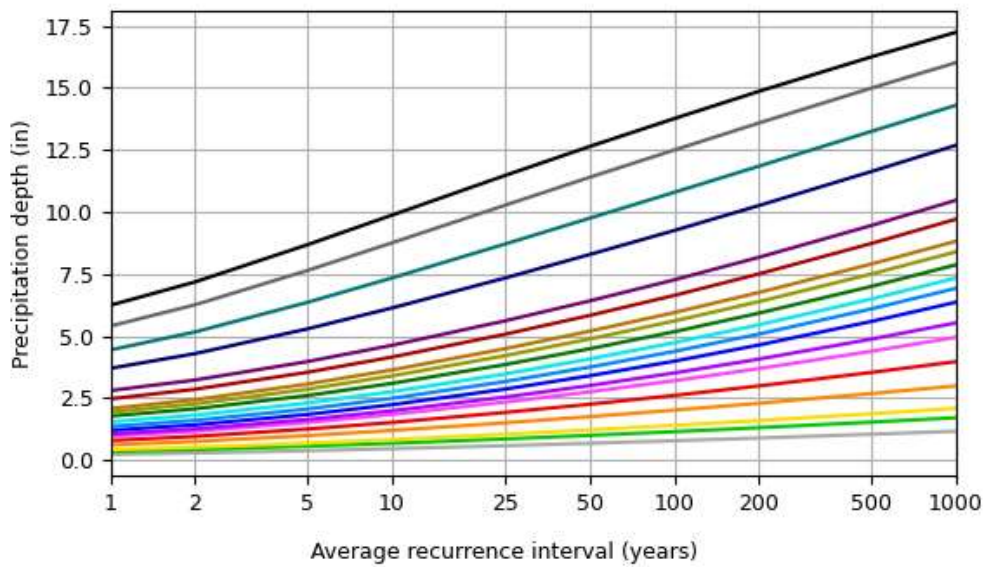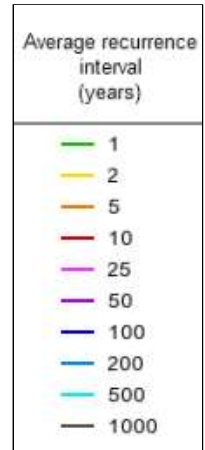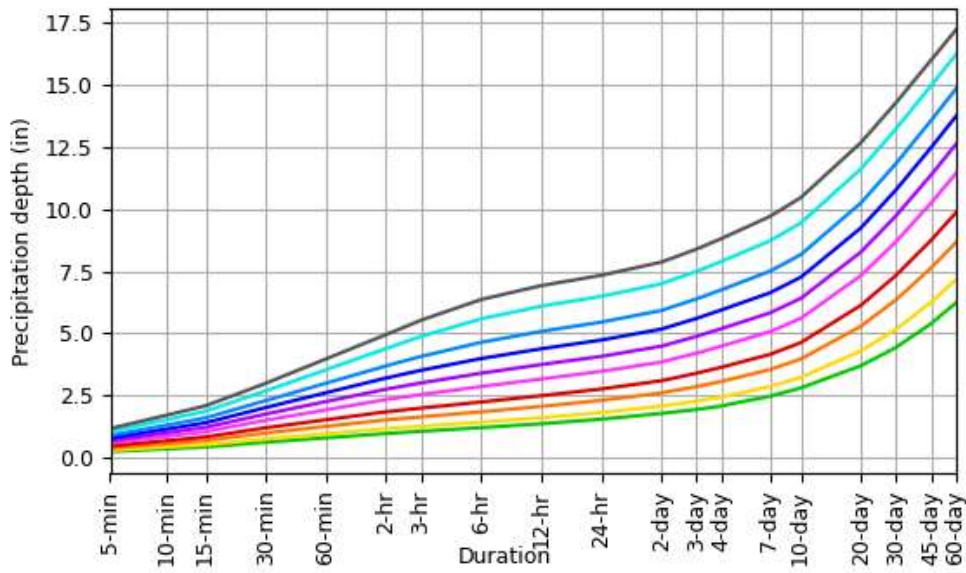

[Back to Top](#)

Maps & aeriels

Small scale terrain



[Back to Top](#)


[US Department of Commerce](#)
[National Oceanic and Atmospheric Administration](#)
[National Weather Service](#)
[National Water Center](#)
1325 East West Highway
Silver Spring, MD 20910
Questions?: HDSC.Questions@noaa.gov

[Disclaimer](#)

City of Colorado Springs **2-Hour Design Storms** (Cumulative Depth Distributions) (inches)

DCM Storm Depths - Inches

Return Period	1-Hour Depth	6-Hour Depth	24-Hour Depth
2	0.963	1.7	2.1
5	1.26	2.1	2.7
10	1.52	2.4	3.2
25	1.92	2.9	3.6
50	2.26	3.2	4.2
100	2.61	3.5	4.6
500	3.54	5.95	7.34

 Values from NOAA chart for site


Cumulative Rainfall Depths in Inches - 5-yr Storm

Time Min.	Drainage Basin Area (square miles)						
	0-1	>1-5	>5-10	>10-15	>15-20	>20-40	>40-60
0	0.000	0.000	0.000	0.000	0.000	0.000	0.000
5	0.018	0.018	0.018	0.018	0.019	0.019	0.021
10	0.058	0.055	0.052	0.052	0.053	0.053	0.050
15	0.100	0.096	0.093	0.093	0.092	0.088	0.086
20	0.151	0.146	0.137	0.137	0.134	0.129	0.120
25	0.226	0.222	0.213	0.212	0.205	0.198	0.185
30	0.325	0.314	0.301	0.297	0.286	0.272	0.249
35	0.530	0.499	0.446	0.412	0.387	0.348	0.305
40	0.897	0.825	0.704	0.624	0.564	0.480	0.397
45	1.038	0.953	0.803	0.706	0.638	0.532	0.435
50	1.124	1.038	0.882	0.780	0.713	0.604	0.499
55	1.178	1.091	0.932	0.829	0.757	0.645	0.539
60	1.225	1.135	0.975	0.869	0.799	0.684	0.575
65	1.265	1.177	1.016	0.903	0.833	0.718	0.607
70	1.283	1.194	1.034	0.922	0.854	0.742	0.631
75	1.298	1.212	1.052	0.940	0.872	0.760	0.649
80	1.312	1.226	1.070	0.958	0.890	0.777	0.667
85	1.326	1.240	1.087	0.975	0.907	0.795	0.684
90	1.339	1.254	1.103	0.993	0.925	0.813	0.702
95	1.351	1.268	1.116	1.011	0.942	0.830	0.719
100	1.363	1.281	1.129	1.024	0.960	0.848	0.737
105	1.375	1.293	1.143	1.038	0.974	0.866	0.755
110	1.386	1.305	1.157	1.052	0.987	0.879	0.770
115	1.397	1.317	1.171	1.066	1.000	0.893	0.784
120	1.410	1.328	1.182	1.080	1.014	0.907	0.798


Cumulative Rainfall Depths in Inches - 100-yr Storm

Time Min.	Drainage Basin Area (square miles)						
	0-1	>1-5	>5-10	>10-15	>15-20	>20-40	>40-60
0	0.000	0.000	0.000	0.000	0.000	0.000	0.000
5	0.037	0.037	0.037	0.037	0.039	0.039	0.044
10	0.120	0.115	0.107	0.107	0.110	0.110	0.104
15	0.206	0.198	0.193	0.193	0.191	0.183	0.177
20	0.313	0.303	0.284	0.284	0.277	0.266	0.248
25	0.467	0.459	0.441	0.438	0.425	0.410	0.384
30	0.673	0.650	0.624	0.616	0.592	0.564	0.517
35	1.099	1.034	0.924	0.853	0.801	0.720	0.632
40	1.858	1.710	1.459	1.292	1.169	0.994	0.822
45	2.151	1.973	1.663	1.462	1.321	1.101	0.900
50	2.328	2.151	1.827	1.616	1.477	1.250	1.034
55	2.440	2.260	1.931	1.717	1.569	1.336	1.117
60	2.537	2.352	2.020	1.801	1.655	1.417	1.190
65	2.620	2.438	2.104	1.871	1.725	1.488	1.258
70	2.657	2.474	2.143	1.911	1.770	1.537	1.308
75	2.688	2.511	2.179	1.947	1.806	1.574	1.344
80	2.717	2.540	2.216	1.984	1.843	1.610	1.381
85	2.746	2.568	2.252	2.020	1.879	1.647	1.417
90	2.774	2.597	2.284	2.057	1.916	1.683	1.454
95	2.798	2.626	2.312	2.093	1.952	1.720	1.490
100	2.824	2.654	2.339	2.122	1.989	1.757	1.527
105	2.848	2.678	2.367	2.151	2.018	1.793	1.563
110	2.871	2.704	2.396	2.179	2.044	1.822	1.595
115	2.894	2.727	2.425	2.208	2.072	1.850	1.623
120	2.921	2.751	2.448	2.237	2.101	1.879	1.652

Subcatchment Conceptual Model

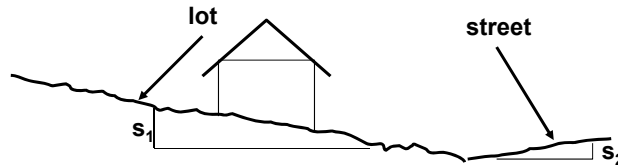

Pervious and Impervious areas are processed independently and are then combined.
Both have the same tributary width (W).

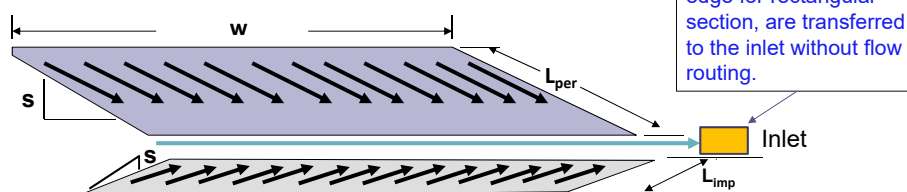

You can set them up as separate subcatchments.

9

Width Parameter

NEVER use default value

Approx. Width = (Area) \div (Length)

Length = average overland sheet flow length of runoff

Suggested Rules of Thumb:

Undeveloped:

- Maximum length = 100- to 500-feet

Residential Catchments:

- Maximum length = 100 to 300 feet
- back of lot to street gutter (100-175 ft)

10


Width Parameter



11

Transforming Subcatchment Shape to a Rectangle

Equations Suggested by Guo and Urbanas, 2009

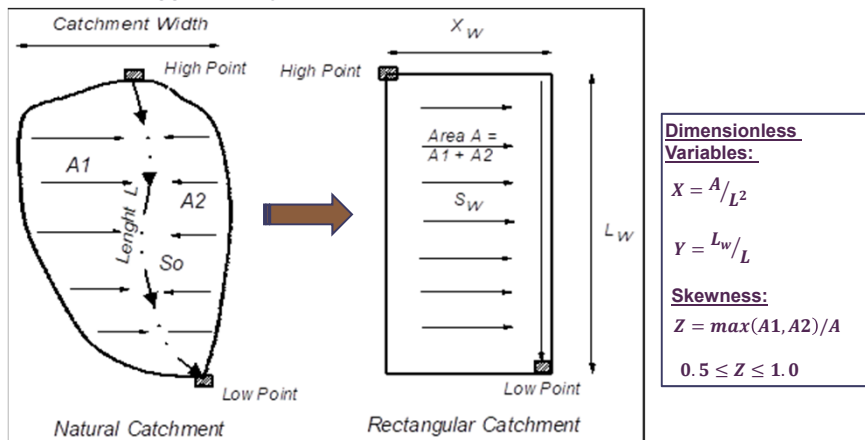


$$Y = \frac{L_w}{L} = (1.5 - Z)(2.286X - 0.286X^2) \quad \Rightarrow \quad \frac{L_w}{L} = (1.5 - Z) \left\{ 2.286 \left(\frac{A}{L^2} \right) - 0.286 \left(\frac{A}{L^2} \right)^2 \right\}$$

$$\frac{S_o}{S_w} = \left(\frac{X}{Y} + Y \right) \quad \Rightarrow \quad \frac{S_o}{S_w} = \frac{A}{LL_w} + \frac{L_w}{L}$$

12

Example for finding L_w and S_w

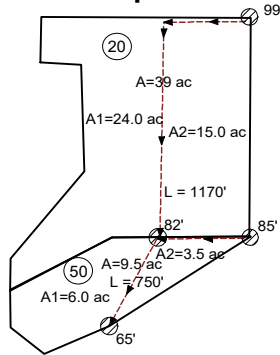

Variables for 20:

$$X = A/L^2 = 39 \times 43,560 / 1,170^2 = 1.24$$

$$Y = L_w/L = 2.12$$

$$Z = A^1/A = 24/39 = 0.62$$

$$S_o = 17/(1,170) = 0.0145 \text{ (1.45\%)}$$

$$X_w = A/L_w = 685 \text{ ft}$$

Variables for 50:

$$X = A/L^2 = 9.5 \times 43,560 / 750^2 = 0.74$$

$$Y = L_w/L = 1.33$$

$$Z = A^1/A = 6/9.5 = 0.63$$

$$S_o = 20/(750) = 0.0267 \text{ (2.67\%)}$$

$$X_w = A/L_w = 416 \text{ ft}$$

$$L_w/L = (1.5 - Z) \left[(2.286 \times A/L^2) - 0.286 (A/L^2)^2 \right] \quad [20]: \quad (1.5 - 0.62)(2.286 \times 1.24 - 0.286 \times 1.54) = 2.12$$

$$L_w/L = (1.5 - Z) \left[(2.286 \times A/L^2) - 0.286 (A/L^2)^2 \right] \quad [50]: \quad (1.5 - 0.63)(2.286 \times 0.74 - 0.286 \times 0.55) = 1.33$$

$$L_w = (2.12 \times L) = (2.12 \times 1,170) = \mathbf{2,480 \text{ ft.}}$$

$$L_w = (1.33 \times L) = (1.33 \times 750) = \mathbf{995 \text{ ft.}}$$

$$[20]: \quad S_o/S_w = A/(LL_w) + L_w/L = 2.71 \quad S_w = S_o/2.71 = 1.45/2.71 = \mathbf{0.54\%}$$

$$[50]: \quad S_o/S_w = A/(LL_w) + L_w/L = 1.88 \quad S_w = S_o/1.88 = 2.67/1.88 = \mathbf{1.42\%}$$

Percent Impervious

Estimating/Measuring Percent Impervious:

- If site-specific information is not available, use land use classification
- Sometimes, site-specific impervious GIS layers are available

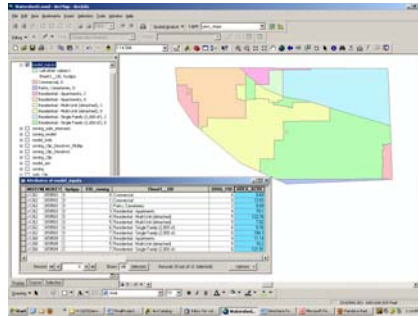


Table RO-3—Recommended Percentage Imperviousness Values

Land Use or Surface Characteristics	Percentage Imperviousness
Business:	
Commercial areas	95
Neighborhood areas	85
Residential:	
Single-family	*
Multi-unit (detached)	60
Multi-unit (attached)	75
Half-acre lot or larger	*
Apartments	80
Industrial:	
Light areas	80
Heavy areas	90
Parks, cemeteries	5
Playgrounds	10
Schools	50
Railroad yard areas	15
Undeveloped Areas:	
Historic flow analysis	2
Greenbelts, agricultural	2
Off-site flow analysis (when land use not defined)	45
Streets:	
Paved	100
Gravel (packed)	40
Drive and walks	90
Roofs	90
Lawns, sandy soil	0
Lawns, clayey soil	0

* See Figures RO-3 through RO-5 for percentage imperviousness.

Source: UDFCD Storm Drainage Criteria Manual

15

City of Colorado Springs DCM - Manning's n

Table 6-11. Roughness Coefficients (Manning's n) for NRCS Overland Flow

Surface description	n ¹
Smooth surfaces (concrete, asphalt, gravel, bare soil, etc.)	0.011
Fallow (no residue)	0.05
Cultivated Soils:	
Residue cover <20%	0.06
Residue cover >20%	0.17
Grass:	
Short grass prairie	0.15
Dense grasses ²	0.24
Bermuda grass	0.41
Range (natural)	0.13
Woods³	
Light underbrush	0.40
Dense underbrush	0.80

16

Table 3-1 Impervious area as a percentage of land use.

Land Use	Percent Impervious Area
Commercial	56
Industrial	76
High density residential	51
Medium density residential	38
Low density residential	19
Institutional	34
Agricultural	2
Forest	1.9
Open Urban Land	11

As mentioned earlier, impervious areas in SWMM are hydraulically (directly) connected to the drainage system – called directly connected impervious areas (DCIA). For instance, if rooftops drain onto adjacent pervious lawn areas, they should not be treated as a hydraulically effective impervious area. Such areas are non-effective impervious areas (Doyle and Miller, 1980). On the other hand, if a driveway drains to a street and then to a stormwater inlet, the driveway would be considered hydraulically connected. Rooftops with downspouts connected directly to a sewer are clearly hydraulically connected. An example of careful measurements and statistics on imperviousness may be found in Field et al. (2000), Lee (2003), and Roy and Shuster (2007). Lee and Heaney (2003) provide detailed comparisons of imperviousness computations and their implications for modeling.

Should rooftops be treated as “pervious,” the real surrounding pervious area is subject to more incoming water than rainfall alone and thus might produce runoff sooner than if rainfall alone were considered. In the possible event that this effect is important (a judgment based on infiltration parameters) it can be modeled using the overland flow re-routing option discussed earlier in Section 3.7. For example, if disconnected rooftops comprised 25 percent of the total impervious area of a subcatchment (as opposed to the total DCIA) then one could tell SWMM that this percentage of impervious area should be internally routed onto the pervious sub-area of the subcatchment.

Another method of estimating the effective impervious area given measured data is to plot the runoff (in. or mm) vs. rainfall (in. or mm) for small storms. The slope of the regression line is a good estimate of the effective impervious area (Doyle and Miller, 1980).

Table 3-5 Estimates of Manning's roughness coefficient for overland flow

Source	Ground Cover	n	Range
Crawford and Linsley (1966) ^a	Smooth asphalt	0.01	
	Asphalt of concrete paving	0.014	
	Packed clay	0.03	
	Light turf	0.20	
	Dense turf	0.35	
	Dense shrubbery and forest litter	0.4	
Engman (1986) ^b	Concrete or asphalt	0.011	0.010-0.013
	Bare sand	0.010	0.01-0.016
	Graveled surface	0.02	0.012-0.03
	Bare clay-loam (eroded)	0.02	0.012-0.033
	Range (natural)	0.13	0.01-0.32
	Bluegrass sod	0.45	0.39-0.63
	Short grass prairie	0.15	0.10-0.20
	Bermuda grass	0.41	0.30-0.48
Yen (2001) ^c	Smooth asphalt pavement	0.012	0.010-0.015
	Smooth impervious surface	0.013	0.011-0.015
	Tar and sand pavement	0.014	0.012-0.016
	Concrete pavement	0.017	0.014-0.020
	Rough impervious surface	0.019	0.015-0.023
	Smooth bare packed soil	0.021	0.017-0.025
	Moderate bare packed soil	0.030	0.025-0.035
	Rough bare packed soil	0.038	0.032-0.045
	Gravel soil	0.032	0.025-0.045
	Mowed poor grass	0.038	0.030-0.045
	Average grass, closely clipped sod	0.050	0.040-0.060
	Pasture	0.055	0.040-0.070
	Timberland	0.090	0.060-0.120
	Dense grass	0.090	0.060-0.120
	Shrubs and bushes	0.120	0.080-0.180
	Business land use	0.022	0.014-0.035
	Semi-business land use	0.035	0.022-0.050
	Industrial land use	0.035	0.020-0.050
	Dense residential land use	0.040	0.025-0.060
	Suburban residential land use	0.055	0.030-0.080
Parks and lawns	0.075	0.040-0.120	
^a Obtained by calibration of Stanford Watershed Model.			
^b Computed by Engman (1986) by kinematic wave and storage analysis of measured rainfall-runoff data.			
^c Computed on basis of kinematic wave analysis.			

Recommend Adjusting Manning's n Values for SWMM Sheet Flow Inputs

“N-perv” and “N-imperv”

- Obtain from local design criteria, or Textbooks/Literature, or SWMM Help Menu.
- Recommend increasing recommended COS values of n for Smooth Surfaces (i.e., paved and fallow) by at least 25%


NOTE:

Table values in literature are for small roughness/depth ratios.
Sheet flow has a very large roughness/depth ratio

17

Depression Storage

- “Dstore-Imperv” and “Dstore-Perv”
- Represents surface storage that does not runoff
 - infiltrates or evaporates later

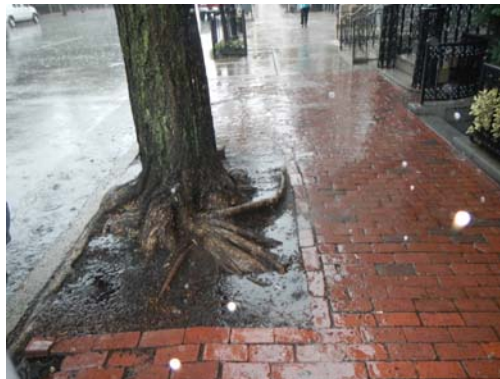

18

Depression Storage

Table RO-6—Typical Depression Losses for Various Land Covers

(All Values in Inches. For use with the CUHP Method)


Land Cover	Range in Depression (Retention) Losses	Recommended
Impervious:		
Large paved areas	0.05 - 0.15	0.1
Roofs-flat	0.1 - 0.3	0.1
Roofs-sloped	0.05 - 0.1	0.05
Pervious:		
Lawn grass	0.2 - 0.5	0.35
Wooded areas and open fields	0.2 - 0.6	0.4

Source: UDFCD Storm Drainage Criteria Manual

19

%Zero-Imperv


- Percentage of impervious area with “zero” depression storage
- Used as calibration factor to help match early part of hydrograph
- Default value = 25%

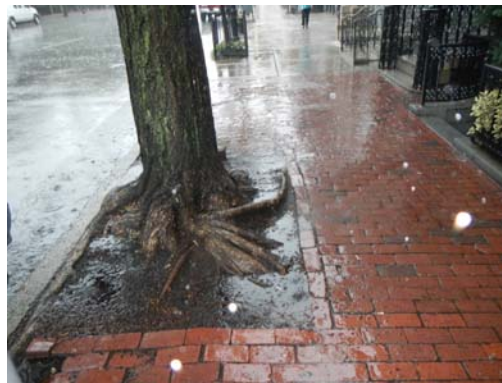

20

Subarea Routing and Percent Routed

- Pervious – routes some % of impervious to pervious (e.g. rooftop to lawn)

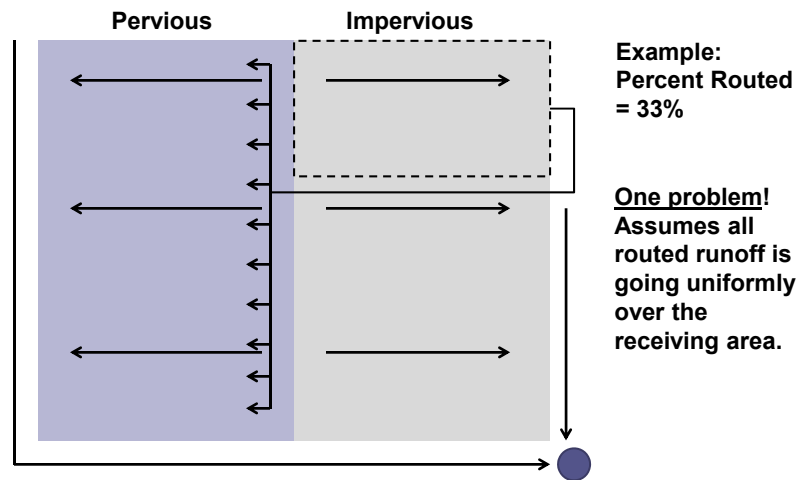

21

Subarea Routing and Percent Routed


- Internal subcatchment routing (i.e. to how the runoff connects in the downstream system)
- 3 options
 - Outlet (default)
 - Impervious
 - Pervious

22

Infiltration

Three Options:


- Green - Ampt Method
- Horton's Method
- Curve Number (SCS) Method
 - Select the desired method in "Options-General" editor

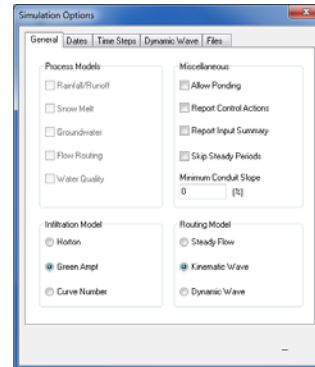


23

Comparison of Infiltration Models



Horton:

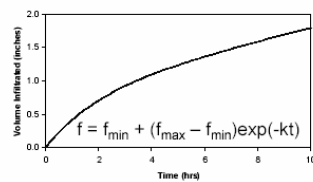

Green-Ampt:

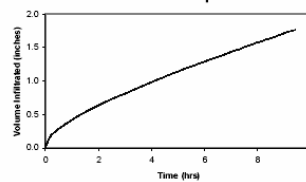


Curve Number:

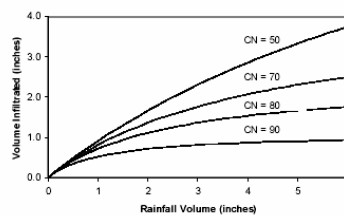

24

Comparison of Infiltration Models

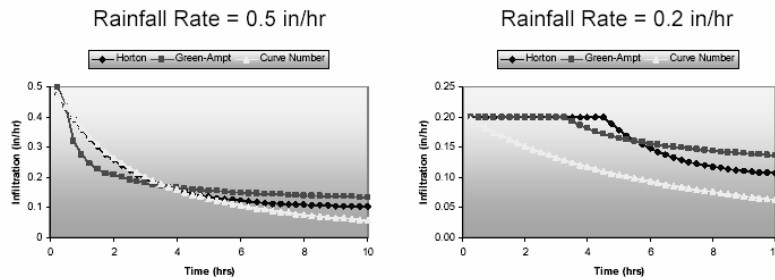

Horton Parameters: $f_{\max} = 0.5$, $f_{\min} = 0.1$, $k = 0.5$
 Green-Ampt Parameters: $\Psi = 3.0$, $K_{\text{sat}} = 0.1$, $\theta_0 = 0.2$
 Curve Number Parameters: $CN = 80$

25

Infiltration Parameters

Horton's Infiltration Recommendations by MHFD (formerly UDFCD) when Using Design Storms

Table RO-7—Recommended Horton's Equation Parameters

NRCS Hydrologic Soil Group	Infiltration (inches per hour)		Decay Coefficient— a
	Initial— f_i	Final— f_o	
A	5.0	1.0	0.0007
B	4.5	0.6	0.0018
C	3.0	0.5	0.0018
D	3.0	0.5	0.0018

Source: Urban Storm Drainage Criteria Manual (Referenced in COS DCM)

↑
Units
(inches/second)

Drying Time (days): time to recover full infiltration capacity

- Ignore for single storm analysis

26

Infiltration Parameters

Horton's **Initial** Infiltration for Continuous Simulation

Soil Type	(in/hr)
Dry sandy soils with little or no vegetation	5.0
Dry loam soils with little or no vegetation	3.0
Dry clay soils with little or no vegetation	1.0
Dry sandy soils with dense vegetation	10.0
Dry loam soils with dense vegetation	6.0
Dry clay soils with dense vegetation	2.0
Moist sandy soils with little or no vegetation	1.7
Moist loam soils with little or no vegetation	1.0
Moist clay soils with little or no vegetation	0.3
Moist sandy soils with dense vegetation	3.3
Moist loam soils with dense vegetation	2.0
Moist clay soils with dense vegetation	0.7

27

Infiltration Parameters

Horton's **Final** Infiltration for Continuous Simulation

Soil Type	Final Infiltration Rate	
	(in/hr)	(mm/hr)
Clay loam, silty clay loam, sandy clay, silty clay, clay	0.01 - 0.08	0.25 - 2.0
Sandy clay loam	0.06 - 0.12	1.57 - 3.1
Silt loam, loam	0.15 - 0.30	3.8 - 7.6
Sandy loam	0.43 - 0.86	11 - 22
Loamy sand	1.2 - 2.4	30 - 60
Sand, ,	4.7 - 9.3	119 - 236

Horton's Infiltration Decay Rate (can vary a lot)

Range: 2/hr to 6/hr Units in SWMM (0.00056 to 0.00167/sec units in CUHP).

Little sensitivity in results when used with modified Horton's equation in performing continuous simulation whenever values larger than 3/hr are used. Thus, suggest a value 3/hr is appropriate for NRCS Hydrologic Soil Groups B, C and D, and a value of 2/hr for Soil Group A.

28

Drying Time (SWMM)

- Drying Time (days): time to recover full infiltration capacity
- Ignore for design storm and single-storm analysis


For Continuous Simulation:

Climate/Region	Drying time in days (typically used)
Arid regions	1 to 3 (2)
Semi- Arid regions	2 to 5 (3)
Midwest, East and SE USA	3 to 8 (5 to 7)
Very Humid and prolonged precipitation regions	7 to 14 (7 to10)


TRIPLE H RANCH

Pre-Developed Conditions

08/22/2025 00:15:00

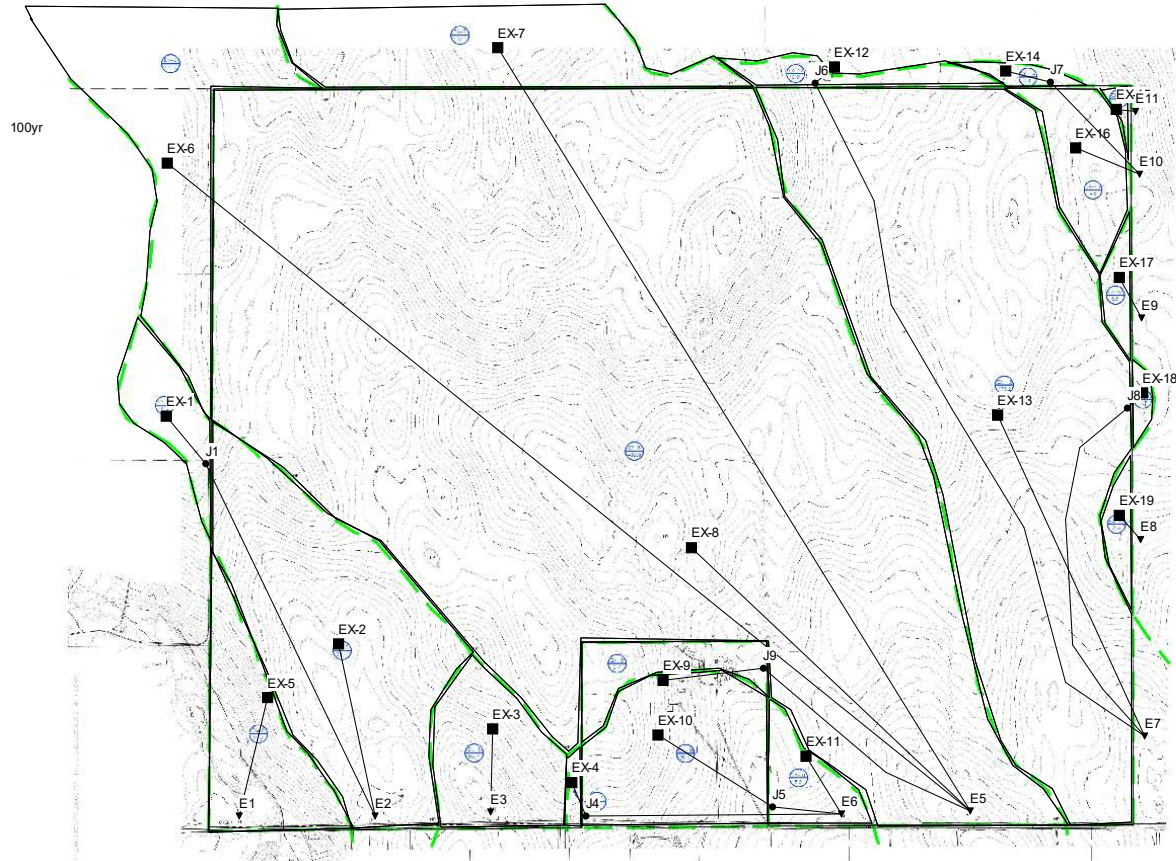

Convert Natural Catchment to a Rectangular Shape

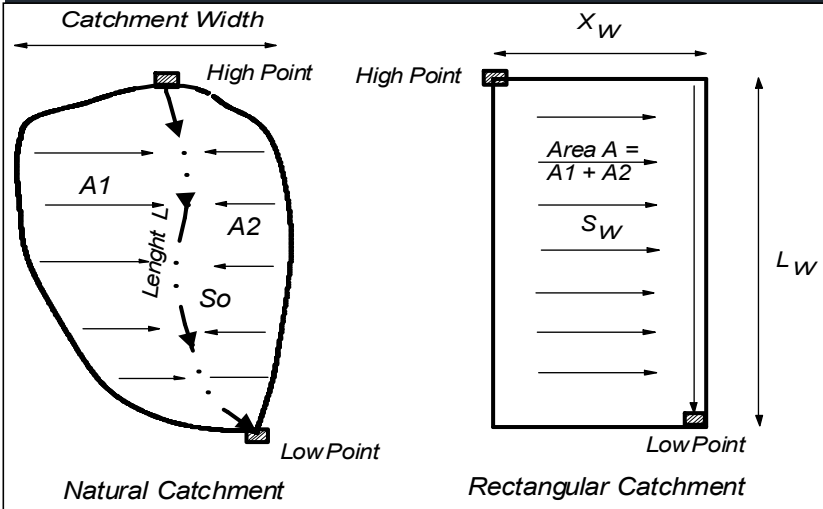

Subcatchment Center	Z=0.5
Side Collector	Z=1
Skewed Location	0.5 < Z < 1

Dimensionless Variables

$$Y = \frac{L}{L_w}; \quad X = \frac{A}{L^2}$$

$$Y = (1.5 - Z)(2.286X - 0.286X^2)$$

$$\frac{L_w}{L} = (1.5 - Z) \left[2.286 \left(\frac{A}{L^2} \right) - 0.286 \left(\frac{A}{L^2} \right)^2 \right]$$

$$S_o / S_w = A / (L L_w) + L_w / L$$

$$X_w = A / L_w$$

Subarea ID	Area acre	A1 acre	A2 acre	L ft	High Pt Elev. ft	Low Pt Elev. ft	Z=Am/A	X=A/L ²	Y=Lw/L	Lw ft	Xw ft	So %	So/Sw	Sw %
EX-1	9.90	5.00	4.90	1,200	6498.0	6484.0	0.51	0.30	0.66	787	548	1.17	1.11	1.05
EX-2	64.10	21.00	43.10	2,900	6484.0	6428.0	0.67	0.33	0.60	1,746	1,599	1.93	1.15	1.67
EX-3	20.20	5.00	15.20	1,200	6,472	6,428	0.75	0.61	0.96	1,157	760	3.67	1.60	2.29
EX-4	1.30	0.70	0.60	420	6,465	6,442	0.54	0.32	0.68	284	199	5.48	1.15	4.76
EX-5	21.90	7.00	14.90	1,350	6,452	6,410	0.68	0.52	0.92	1,237	771	3.11	1.49	2.09
EX-6	536.00	210.00	326.00	7,400	6,610	6,498	0.61	0.43	0.82	6,089	3,834	1.51	1.34	1.13
EX-7	132.50	60.00	72.50	3,940	6,560	6,500	0.55	0.37	0.77	3,042	1,897	1.52	1.25	1.21
EX-8	439.90	150.00	289.90	7,220	6,500	6,380	0.66	0.37	0.67	4,868	3,937	1.66	1.22	1.36
EX-9	9.70	3.50	6.20	1,500	6,467	6,417	0.64	0.19	0.36	541	781	3.33	0.88	3.78
EX-10	30.30	15.00	15.30	1,340	6,467	6,408	0.50	0.74	1.52	2,034	649	4.40	2.00	2.20
EX-11	8.20	2.00	6.20	540	6,415	6,398	0.76	1.22	1.76	952	375	3.15	2.46	1.28
EX-12	6.50	3.00	3.50	745	6,504	6,479	0.54	0.51	1.05	782	362	3.36	1.54	2.19
EX-13	173.20	43.20	130.00	5,700	6,479	6,382	0.75	0.23	0.39	2,202	3,427	1.70	0.99	1.72
EX-14	2.40	1.20	1.20	600	6,467	6,456	0.50	0.29	0.64	384	272	1.83	1.09	1.68
EX-15	1.20	0.40	0.80	200	6,452	6,446	0.67	1.31	2.08	416	126	3.00	2.71	1.11
EX-16	14.00	8.00	6.00	1,000	6,457	6,448	0.57	0.61	1.20	1,196	510	0.90	1.71	0.53
EX-17	3.50	1.70	1.80	250	6,452	6,442	0.51	2.44	3.82	955	160	4.00	4.46	0.90
EX-18	1.70	0.80	0.90	130	6,441	6,438	0.53	4.38	4.39	571	130	2.31	5.39	0.43
EX-19	3.80	2.20	1.60	670	6,432	6,416	0.58	0.37	0.74	496	334	2.39	1.24	1.93

TRIPLE H RANCH PRELIMINARY DRAINAGE REPORT (Predeveloped Conditions)

SUBCATCHMENT INPUT DATA										
							Depth of Depression Storage	Depth of Depression Storage	Imperv. Area with no Depression Storage	Infiltration
Subcatchment Basin Name	Area (Ac.)	Width Lw (Ft.)	Slope Sw (%)	Imperv. (%)	Mannings N (Imperv. Area)	Mannings N (Perv. Area)	Imperv. Area (in.)	Perv. Area (in.)	Imperv. Area (%)	Infiltration Method
EX-1	9.9	787	1.05	3.2	0.014	0.24	0.10	0.35	25	Horton
EX-2	64.1	1746	1.67	2.5	0.014	0.24	0.10	0.35	25	Horton
EX-3	20.2	1157	2.29	4.4	0.014	0.24	0.10	0.35	25	Horton
EX-4	1.3	284	4.76	6.5	0.014	0.24	0.10	0.35	25	Horton
EX-5	21.9	1237	2.09	4.2	0.014	0.24	0.10	0.35	25	Horton
EX-6	536	6089	1.13	4	0.014	0.24	0.10	0.35	25	Horton
EX-7	132.5	3042	1.21	2	0.014	0.24	0.10	0.35	25	Horton
EX-8	439.9	4868	1.36	2	0.014	0.24	0.10	0.35	25	Horton
EX-9	9.7	541	3.78	5.2	0.014	0.24	0.10	0.35	25	Horton
EX-10	30.3	2034	2.2	5.2	0.014	0.24	0.10	0.35	25	Horton
EX-11	8.2	952	1.28	6.2	0.014	0.24	0.10	0.35	25	Horton
EX-12	6.5	782	2.19	2	0.014	0.24	0.10	0.35	25	Horton
EX-13	173.2	2202	1.72	2.2	0.014	0.24	0.10	0.35	25	Horton
EX-14	2.4	384	1.68	2	0.014	0.24	0.10	0.35	25	Horton
EX-15	1.2	416	1.1	2	0.014	0.24	0.10	0.35	25	Horton
EX-16	14	1196	0.53	2	0.014	0.24	0.10	0.35	25	Horton
EX-17	3.5	955	0.9	2	0.014	0.24	0.10	0.35	25	Horton
EX-18	1.7	571	0.43	2	0.014	0.24	0.10	0.35	25	Horton
EX-19	3.8	496	1.93	2	0.014	0.24	0.10	0.35	25	Horton

TRIPLE H RANCH - 5-yr. Pre-Developed Conditions

 NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.

 Analysis Options

Flow Units CFS
 Process Models:
 Rainfall/Runoff YES
 RDII NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed NO
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method KINWAVE
 Starting Date 08/22/2025 00:00:00
 Ending Date 08/22/2025 06:00:00
 Antecedent Dry Days 0.0
 Report Time Step 00:15:00
 Wet Time Step 00:05:00
 Dry Time Step 01:00:00
 Routing Time Step 30.00 sec

*****	Volume	Depth
Runoff Quantity Continuity	acre-feet	inches
*****	-----	-----
Total Precipitation	163.820	1.328
Evaporation Loss	0.000	0.000
Infiltration Loss	158.812	1.287
Surface Runoff	4.777	0.039
Final Storage	0.275	0.002
Continuity Error (%)	-0.027	

*****	Volume	Volume
Flow Routing Continuity	acre-feet	10^6 gal
*****	-----	-----

Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	4.777	1.557
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	4.821	1.571
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.004	0.001
Continuity Error (%)	-0.996	

Highest Flow Instability Indexes

Link C4 (2)
Link C9 (1)
Link C1 (1)

Routing Time Step Summary

Minimum Time Step	:	30.00 sec
Average Time Step	:	30.00 sec
Maximum Time Step	:	30.00 sec
Percent in Steady State	:	0.00
Average Iterations per Step	:	1.00
Percent Not Converging	:	0.00

Subcatchment Runoff Summary

			Total	Total	Total	Total	Total
Total	Peak	Runoff	Precip	Runon	Evap	Infil	Runoff
Runoff	Runoff	Coeff	in	in	in	in	in
Subcatchment	Subcatchment						
10^6 gal	CFS						
EX-1			1.33	0.00	0.00	1.28	0.04

0.01	1.25	0.034						
EX-10			1.33	0.00	0.00	1.25	0.07	
0.06	6.21	0.054						
EX-11			1.33	0.00	0.00	1.24	0.09	
0.02	2.01	0.064						
EX-12			1.33	0.00	0.00	1.29	0.03	
0.01	0.51	0.026						
EX-13			1.33	0.00	0.00	1.30	0.03	
0.14	14.93	0.022						
EX-14			1.33	0.00	0.00	1.29	0.04	
0.00	0.19	0.027						
EX-15			1.33	0.00	0.00	1.28	0.04	
0.00	0.09	0.032						
EX-16			1.33	0.00	0.00	1.30	0.03	
0.01	1.10	0.022						
EX-17			1.33	0.00	0.00	1.29	0.04	
0.00	0.28	0.029						
EX-18			1.33	0.00	0.00	1.29	0.04	
0.00	0.13	0.028						
EX-19			1.33	0.00	0.00	1.29	0.03	
0.00	0.30	0.026						
EX-2			1.33	0.00	0.00	1.29	0.03	
0.06	6.32	0.025						
EX-3			1.33	0.00	0.00	1.26	0.06	
0.03	3.51	0.045						
EX-4			1.33	0.00	0.00	1.22	0.10	
0.00	0.33	0.077						
EX-6			1.33	0.00	0.00	1.27	0.05	
0.75	80.48	0.039						
EX-7			1.33	0.00	0.00	1.30	0.03	
0.10	10.44	0.020						
EX-5			1.33	0.00	0.00	1.27	0.06	
0.03	3.63	0.043						
EX-8			1.33	0.00	0.00	1.30	0.03	
0.31	34.35	0.020						
EX-9			1.33	0.00	0.00	1.25	0.07	
0.02	1.99	0.054						

Node Depth Summary

Node	Type	Average Depth Feet	Maximum Depth Feet	Maximum HGL Feet	Time of Max Occurrence days hr:min	Reported Max Depth Feet
J1	JUNCTION	0.06	0.33	6484.33	0 00:45	0.33
J4	JUNCTION	0.06	0.32	6442.32	0 00:45	0.32

J5	JUNCTION	0.17	1.00	6409.00	0	00:45	0.99
J6	JUNCTION	0.05	0.24	6479.24	0	00:45	0.24
J7	JUNCTION	0.04	0.19	6456.19	0	00:45	0.19
J8	JUNCTION	0.03	0.15	6438.15	0	00:45	0.14
J9	JUNCTION	0.07	0.39	6415.39	0	00:45	0.38
E2	OUTFALL	0.09	0.24	6430.24	0	01:15	0.24
E3	OUTFALL	0.00	0.00	6428.00	0	00:00	0.00
E6	OUTFALL	0.18	0.97	6398.97	0	00:47	0.88
E5	OUTFALL	0.09	0.30	6380.30	0	00:54	0.30
E7	OUTFALL	0.10	0.19	6382.19	0	01:25	0.19
E1	OUTFALL	0.00	0.00	6410.00	0	00:00	0.00
E10	OUTFALL	0.05	0.16	6448.16	0	01:15	0.16
E9	OUTFALL	0.00	0.00	6440.00	0	00:00	0.00
E8	OUTFALL	0.00	0.00	6418.00	0	00:00	0.00
E11	OUTFALL	0.00	0.00	6448.00	0	00:00	0.00

Node Inflow Summary

Total Inflow Volume		Flow Balance Error	Type	Maximum Lateral Inflow	Maximum Total Inflow	Time of Max Occurrence	Lateral Inflow Volume
gal	Percent			CFS	CFS	days hr:min	10^6 gal
J1	0.0121	0.000	JUNCTION	1.25	1.25	0 00:45	0.0121
J4	0.00363	0.000	JUNCTION	0.33	0.33	0 00:45	0.00363
J5	0.0585	0.000	JUNCTION	6.21	6.21	0 00:45	0.0585
J6	0.00612	0.000	JUNCTION	0.51	0.51	0 00:45	0.00612
J7	0.00235	0.000	JUNCTION	0.19	0.19	0 00:45	0.00235
J8	0.00169	0.000	JUNCTION	0.13	0.13	0 00:45	0.00169
J9	0.0189	0.000	JUNCTION	1.99	1.99	0 00:45	0.0189
E2			OUTFALL	6.32	6.32	0 00:45	0.0585

0.0751	0.000					
E3		OUTFALL	3.51	3.51	0 00:45	0.0331
0.0331	0.000					
E6		OUTFALL	2.01	7.35	0 00:47	0.019
0.0815	0.000					
E5		OUTFALL	125.27	125.37	0 00:45	1.15
1.17	0.000					
E7		OUTFALL	14.93	14.93	0 00:45	0.135
0.151	0.000					
E1		OUTFALL	3.63	3.63	0 00:45	0.0343
0.0343	0.000					
E10		OUTFALL	1.10	1.11	0 00:45	0.0109
0.0135	0.000					
E9		OUTFALL	0.28	0.28	0 00:45	0.00364
0.00364	0.000					
E8		OUTFALL	0.30	0.30	0 00:45	0.0036
0.0036	0.000					
E11		OUTFALL	0.09	0.09	0 00:45	0.00138
0.00138	0.000					

Node Flooding Summary

No nodes were flooded.

Outfall Loading Summary

Outfall Node	Flow Freq Pcmt	Avg Flow CFS	Max Flow CFS	Total Volume 10^6 gal
E2	98.47	0.47	6.32	0.075
E3	43.19	0.47	3.51	0.033
E6	69.72	0.72	7.35	0.081
E5	98.47	7.38	125.37	1.173
E7	98.47	0.95	14.93	0.151
E1	43.47	0.49	3.63	0.034
E10	63.33	0.13	1.11	0.014
E9	34.31	0.07	0.28	0.004
E8	34.31	0.06	0.30	0.004
E11	33.33	0.03	0.09	0.001
System	61.71	10.77	162.19	1.571

 Link Flow Summary

Link	Type	Maximum Flow CFS	Time of Max Occurrence days hr:min	Maximum Veloc ft/sec	Max/ Full Flow	Max/ Full Depth
C1	CONDUIT	0.54	0 01:15	1.85	0.00	0.12
C3	CONDUIT	0.17	0 01:15	1.76	0.00	0.08
C4	CONDUIT	5.67	0 00:47	2.59	0.05	0.32
C6	CONDUIT	0.12	0 01:15	0.87	0.00	0.07
C7	CONDUIT	0.28	0 01:25	2.15	0.00	0.08
C8	CONDUIT	0.08	0 01:20	1.40	0.00	0.05
C9	CONDUIT	1.00	0 00:54	1.60	0.01	0.15

 Conduit Surcharge Summary

No conduits were surcharged.

Analysis begun on: Tue Nov 25 10:44:02 2025
 Analysis ended on: Tue Nov 25 10:44:03 2025
 Total elapsed time: 00:00:01

TRIPLE H RANCH - 5-yr. Pre-Developed Conditions

Subcatchment Runoff Summary

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
EX-1	1.33	0.00	0.00	1.28	0.04	0.01	1.25	0.034
EX-10	1.33	0.00	0.00	1.25	0.07	0.06	6.21	0.054
EX-11	1.33	0.00	0.00	1.24	0.09	0.02	2.01	0.064
EX-12	1.33	0.00	0.00	1.29	0.03	0.01	0.51	0.026
EX-13	1.33	0.00	0.00	1.30	0.03	0.14	14.93	0.022
EX-14	1.33	0.00	0.00	1.29	0.04	0.00	0.19	0.027
EX-15	1.33	0.00	0.00	1.28	0.04	0.00	0.09	0.032
EX-16	1.33	0.00	0.00	1.30	0.03	0.01	1.10	0.022
EX-17	1.33	0.00	0.00	1.29	0.04	0.00	0.28	0.029
EX-18	1.33	0.00	0.00	1.29	0.04	0.00	0.13	0.028
EX-19	1.33	0.00	0.00	1.29	0.03	0.00	0.30	0.026
EX-2	1.33	0.00	0.00	1.29	0.03	0.06	6.32	0.025
EX-3	1.33	0.00	0.00	1.26	0.06	0.03	3.51	0.045
EX-4	1.33	0.00	0.00	1.22	0.10	0.00	0.33	0.077
EX-6	1.33	0.00	0.00	1.27	0.05	0.75	80.48	0.039
EX-7	1.33	0.00	0.00	1.30	0.03	0.10	10.44	0.020

TRIPLE H RANCH - 5-yr. Pre-Developed Conditions

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
EX-5	1.33	0.00	0.00	1.27	0.06	0.03	3.63	0.043
EX-8	1.33	0.00	0.00	1.30	0.03	0.31	34.35	0.020
EX-9	1.33	0.00	0.00	1.25	0.07	0.02	1.99	0.054

TRIPLE H RANCH - 5-yr. Pre-Developed Conditions

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error Percent
J1	JUNCTION	1.25	1.25	0	00:45	0.0121	0.0121	0.000
J4	JUNCTION	0.33	0.33	0	00:45	0.00363	0.00363	0.000
J5	JUNCTION	6.21	6.21	0	00:45	0.0585	0.0585	0.000
J6	JUNCTION	0.51	0.51	0	00:45	0.00612	0.00612	0.000
J7	JUNCTION	0.19	0.19	0	00:45	0.00235	0.00235	0.000
J8	JUNCTION	0.13	0.13	0	00:45	0.00169	0.00169	0.000
J9	JUNCTION	1.99	1.99	0	00:45	0.0189	0.0189	0.000
E2	OUTFALL	6.32	6.32	0	00:45	0.0585	0.0751	0.000
E3	OUTFALL	3.51	3.51	0	00:45	0.0331	0.0331	0.000
E6	OUTFALL	2.01	7.35	0	00:47	0.019	0.0815	0.000
E5	OUTFALL	125.27	125.37	0	00:45	1.15	1.17	0.000
E7	OUTFALL	14.93	14.93	0	00:45	0.135	0.151	0.000
E1	OUTFALL	3.63	3.63	0	00:45	0.0343	0.0343	0.000
E10	OUTFALL	1.10	1.11	0	00:45	0.0109	0.0135	0.000
E9	OUTFALL	0.28	0.28	0	00:45	0.00364	0.00364	0.000
E8	OUTFALL	0.30	0.30	0	00:45	0.0036	0.0036	0.000

TRIPLE H RANCH - 5-yr. Pre-Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error Percent
E11	OUTFALL	0.09	0.09	0	00:45	0.00138	0.00138	0.000

TRIPLE H RANCH - 5-yr. Pre-Developed Conditions

Outfall Loading Summary

Outfall Node	Flow Freq. Pcnt.	Avg. Flow CFS	Max. Flow CFS	Total Volume 10 ⁶ gal
E2	98.47	0.47	6.32	0.075
E3	43.19	0.47	3.51	0.033
E6	69.72	0.72	7.35	0.081
E5	98.47	7.38	125.37	1.173
E7	98.47	0.95	14.93	0.151
E1	43.47	0.49	3.63	0.034
E10	63.33	0.13	1.11	0.014
E9	34.31	0.07	0.28	0.004
E8	34.31	0.06	0.30	0.004
E11	33.33	0.03	0.09	0.001

TRIPLE H RANCH - 100-yr. Pre-Developed Conditions

 NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.

 Analysis Options

Flow Units CFS
 Process Models:
 Rainfall/Runoff YES
 RDII NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed NO
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method KINWAVE
 Starting Date 08/22/2025 00:00:00
 Ending Date 08/22/2025 06:00:00
 Antecedent Dry Days 0.0
 Report Time Step 00:15:00
 Wet Time Step 00:05:00
 Dry Time Step 01:00:00
 Routing Time Step 30.00 sec

*****	Volume	Depth
Runoff Quantity Continuity	acre-feet	inches
*****	-----	-----
Total Precipitation	339.359	2.751
Evaporation Loss	0.000	0.000
Infiltration Loss	288.876	2.342
Surface Runoff	50.433	0.409
Final Storage	0.275	0.002
Continuity Error (%)	-0.066	

*****	Volume	Volume
Flow Routing Continuity	acre-feet	10^6 gal
*****	-----	-----

Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	50.433	16.434
Groundwater Inflow	0.000	0.000
RDI Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	50.741	16.535
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.009	0.003
Continuity Error (%)	-0.629	

Highest Flow Instability Indexes

Link C4 (2)

Routing Time Step Summary

Minimum Time Step	:	30.00 sec
Average Time Step	:	30.00 sec
Maximum Time Step	:	30.00 sec
Percent in Steady State	:	0.00
Average Iterations per Step	:	1.04
Percent Not Converging	:	0.00

Subcatchment Runoff Summary

Total	Peak	Runoff	Total	Total	Total	Total	Total
Runoff	Runoff	Coeff	Precip	Runon	Evap	Infil	Runoff
Subcatchment	Subcatchment		in	in	in	in	in
10 ⁶ gal	10 ⁶ gal	CFS					
EX-1			2.75	0.00	0.00	1.94	0.81
0.22	8.25	0.295					
EX-10			2.75	0.00	0.00	1.85	0.91

0.75	30.53	0.330						
EX-11			2.75	0.00	0.00	1.76	1.00	
0.22	10.35	0.362						
EX-12			2.75	0.00	0.00	1.78	0.98	
0.17	9.02	0.357						
EX-13			2.75	0.00	0.00	2.38	0.37	
1.73	48.78	0.134						
EX-14			2.75	0.00	0.00	1.75	1.01	
0.07	3.64	0.368						
EX-15			2.75	0.00	0.00	1.65	1.11	
0.04	2.58	0.405						
EX-16			2.75	0.00	0.00	2.04	0.71	
0.27	9.19	0.258						
EX-17			2.75	0.00	0.00	1.71	1.06	
0.10	6.14	0.384						
EX-18			2.75	0.00	0.00	1.74	1.03	
0.05	2.68	0.373						
EX-19			2.75	0.00	0.00	1.77	0.99	
0.10	5.33	0.358						
EX-2			2.75	0.00	0.00	2.19	0.56	
0.98	27.69	0.204						
EX-3			2.75	0.00	0.00	1.90	0.85	
0.47	18.10	0.311						
EX-4			2.75	0.00	0.00	1.54	1.23	
0.04	3.69	0.446						
EX-6			2.75	0.00	0.00	2.40	0.35	
5.11	211.67	0.128						
EX-7			2.75	0.00	0.00	2.29	0.46	
1.66	43.83	0.168						
EX-5			2.75	0.00	0.00	1.92	0.83	
0.50	18.73	0.303						
EX-8			2.75	0.00	0.00	2.44	0.31	
3.71	106.57	0.113						
EX-9			2.75	0.00	0.00	1.82	0.93	
0.24	10.29	0.338						

Node Depth Summary

Node	Type	Average Depth Feet	Maximum Depth Feet	Maximum HGL Feet	Time of Max Occurrence days hr:min	Reported Max Depth Feet
J1	JUNCTION	0.19	0.68	6484.68	0 00:55	0.67
J4	JUNCTION	0.13	0.80	6442.80	0 00:45	0.77
J5	JUNCTION	0.47	1.82	6409.82	0 00:45	1.78
J6	JUNCTION	0.15	0.71	6479.71	0 00:55	0.69

J7	JUNCTION	0.12	0.57	6456.57	0	00:55	0.55
J8	JUNCTION	0.09	0.45	6438.45	0	00:50	0.43
J9	JUNCTION	0.18	0.72	6415.72	0	00:55	0.71
E2	OUTFALL	0.24	0.64	6430.64	0	01:19	0.64
E3	OUTFALL	0.00	0.00	6428.00	0	00:00	0.00
E6	OUTFALL	0.48	1.82	6399.82	0	00:56	1.80
E5	OUTFALL	0.21	0.70	6380.70	0	01:07	0.69
E7	OUTFALL	0.27	0.62	6382.62	0	01:25	0.62
E1	OUTFALL	0.00	0.00	6410.00	0	00:00	0.00
E10	OUTFALL	0.14	0.55	6448.55	0	01:04	0.54
E9	OUTFALL	0.00	0.00	6440.00	0	00:00	0.00
E8	OUTFALL	0.00	0.00	6418.00	0	00:00	0.00
E11	OUTFALL	0.00	0.00	6448.00	0	00:00	0.00

Node Inflow Summary

Total Inflow Volume		Flow Balance Error	Type	Maximum Lateral Inflow	Maximum Total Inflow	Time of Max Occurrence	Lateral Inflow Volume
Node	gal	Percent		CFS	CFS	days hr:min	10 ⁶ gal
J1	0.218	0.000	JUNCTION	8.25	8.25	0 00:55	0.218
J4	0.0433	0.000	JUNCTION	3.69	3.69	0 00:45	0.0433
J5	0.747	0.000	JUNCTION	30.53	30.53	0 00:45	0.747
J6	0.173	0.000	JUNCTION	9.02	9.02	0 00:55	0.173
J7	0.066	0.000	JUNCTION	3.64	3.64	0 00:55	0.066
J8	0.0473	0.000	JUNCTION	2.68	2.68	0 00:50	0.0473
J9	0.245	0.000	JUNCTION	10.29	10.29	0 00:55	0.245
E2	1.22	0.000	OUTFALL	27.69	34.00	0 01:10	0.978
E3			OUTFALL	18.10	18.10	0 00:55	0.469

0.469	0.000						
E6		OUTFALL	10.35	42.69	0	00:56	0.222
1.02	0.000						
E5		OUTFALL	360.28	360.44	0	00:45	10.5
10.7	0.000						
E7		OUTFALL	48.78	48.78	0	00:45	1.73
2.03	0.000						
E1		OUTFALL	18.73	18.73	0	00:55	0.496
0.496	0.000						
E10		OUTFALL	9.19	12.30	0	01:03	0.27
0.339	0.000						
E9		OUTFALL	6.14	6.14	0	00:50	0.1
0.1	0.000						
E8		OUTFALL	5.33	5.33	0	00:55	0.102
0.102	0.000						
E11		OUTFALL	2.58	2.58	0	00:50	0.0363
0.0363	0.000						

Node Flooding Summary

No nodes were flooded.

Outfall Loading Summary

Outfall Node	Flow Freq Pcmt	Avg Flow CFS	Max Flow CFS	Total Volume 10^6 gal
E2	98.47	7.64	34.00	1.215
E3	45.69	6.35	18.10	0.469
E6	75.56	8.31	42.69	1.015
E5	98.47	67.47	360.44	10.734
E7	98.47	12.74	48.78	2.027
E1	45.69	6.72	18.73	0.496
E10	77.64	2.70	12.30	0.339
E9	37.22	1.67	6.14	0.100
E8	38.61	1.63	5.33	0.102
E11	34.17	0.66	2.58	0.036
System	65.00	115.89	523.57	16.533

Link Flow Summary

Link	Type	Maximum Flow CFS	Time of Max Occurrence days hr:min	Maximum Veloc ft/sec	Max/ Full Flow	Max/ Full Depth
C1	CONDUIT	7.12	0 01:19	3.91	0.05	0.32
C3	CONDUIT	2.79	0 01:00	2.90	0.02	0.23
C4	CONDUIT	30.24	0 00:56	3.45	0.26	0.61
C6	CONDUIT	3.24	0 01:04	1.90	0.03	0.27
C7	CONDUIT	6.19	0 01:25	4.82	0.04	0.30
C8	CONDUIT	1.93	0 01:20	3.21	0.01	0.19
C9	CONDUIT	9.31	0 01:07	3.37	0.06	0.35

Conduit Surcharge Summary

No conduits were surcharged.

Analysis begun on: Fri Nov 21 14:02:05 2025
Analysis ended on: Fri Nov 21 14:02:05 2025
Total elapsed time: < 1 sec

TRIPLE H RANCH - 100-yr. Pre-Developed Conditions

Subcatchment Runoff Summary

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
EX-1	2.75	0.00	0.00	1.94	0.81	0.22	8.25	0.295
EX-10	2.75	0.00	0.00	1.85	0.91	0.75	30.53	0.330
EX-11	2.75	0.00	0.00	1.76	1.00	0.22	10.35	0.362
EX-12	2.75	0.00	0.00	1.78	0.98	0.17	9.02	0.357
EX-13	2.75	0.00	0.00	2.38	0.37	1.73	48.78	0.134
EX-14	2.75	0.00	0.00	1.75	1.01	0.07	3.64	0.368
EX-15	2.75	0.00	0.00	1.65	1.11	0.04	2.58	0.405
EX-16	2.75	0.00	0.00	2.04	0.71	0.27	9.19	0.258
EX-17	2.75	0.00	0.00	1.71	1.06	0.10	6.14	0.384
EX-18	2.75	0.00	0.00	1.74	1.03	0.05	2.68	0.373
EX-19	2.75	0.00	0.00	1.77	0.99	0.10	5.33	0.358
EX-2	2.75	0.00	0.00	2.19	0.56	0.98	27.69	0.204
EX-3	2.75	0.00	0.00	1.90	0.85	0.47	18.10	0.311
EX-4	2.75	0.00	0.00	1.54	1.23	0.04	3.69	0.446
EX-6	2.75	0.00	0.00	2.40	0.35	5.11	211.67	0.128
EX-7	2.75	0.00	0.00	2.29	0.46	1.66	43.83	0.168

TRIPLE H RANCH - 100-yr. Pre-Developed Conditions

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
EX-5	2.75	0.00	0.00	1.92	0.83	0.50	18.73	0.303
EX-8	2.75	0.00	0.00	2.44	0.31	3.71	106.57	0.113
EX-9	2.75	0.00	0.00	1.82	0.93	0.24	10.29	0.338

TRIPLE H RANCH - 100-yr. Pre-Developed Conditions

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error Percent
J1	JUNCTION	8.25	8.25	0	00:55	0.218	0.218	0.000
J4	JUNCTION	3.69	3.69	0	00:45	0.0433	0.0433	0.000
J5	JUNCTION	30.53	30.53	0	00:45	0.747	0.747	0.000
J6	JUNCTION	9.02	9.02	0	00:55	0.173	0.173	0.000
J7	JUNCTION	3.64	3.64	0	00:55	0.066	0.066	0.000
J8	JUNCTION	2.68	2.68	0	00:50	0.0473	0.0473	0.000
J9	JUNCTION	10.29	10.29	0	00:55	0.245	0.245	0.000
E2	OUTFALL	27.69	34.00	0	01:10	0.978	1.22	0.000
E3	OUTFALL	18.10	18.10	0	00:55	0.469	0.469	0.000
E6	OUTFALL	10.35	42.69	0	00:56	0.222	1.02	0.000
E5	OUTFALL	360.28	360.44	0	00:45	10.5	10.7	0.000
E7	OUTFALL	48.78	48.78	0	00:45	1.73	2.03	0.000
E1	OUTFALL	18.73	18.73	0	00:55	0.496	0.496	0.000
E10	OUTFALL	9.19	12.30	0	01:03	0.27	0.339	0.000
E9	OUTFALL	6.14	6.14	0	00:50	0.1	0.1	0.000
E8	OUTFALL	5.33	5.33	0	00:55	0.102	0.102	0.000

TRIPLE H RANCH - 100-yr. Pre-Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error Percent
E11	OUTFALL	2.58	2.58	0	00:50	0.0363	0.0363	0.000

TRIPLE H RANCH - 100-yr. Pre-Developed Conditions

Outfall Loading Summary

Outfall Node	Flow Freq. Pcnt.	Avg. Flow CFS	Max. Flow CFS	Total Volume 10 ⁶ gal
E2	98.47	7.64	34.00	1.215
E3	45.69	6.35	18.10	0.469
E6	75.56	8.31	42.69	1.015
E5	98.47	67.47	360.44	10.734
E7	98.47	12.74	48.78	2.027
E1	45.69	6.72	18.73	0.496
E10	77.64	2.70	12.30	0.339
E9	37.22	1.67	6.14	0.100
E8	38.61	1.63	5.33	0.102
E11	34.17	0.66	2.58	0.036


TRIPLE H RANCH

Developed Conditions

08/22/2025 00:15:00



Convert Natural Catchment to a Rectangular Shape

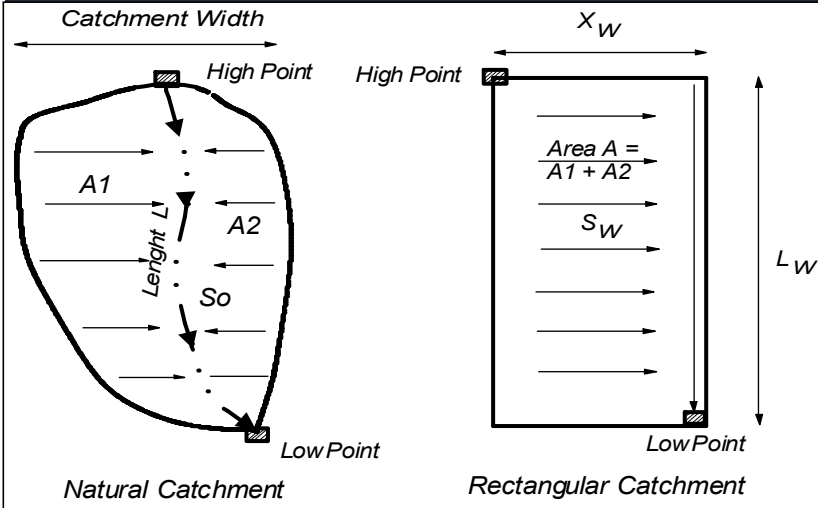

Subcatchment Center	Z=0.5
Side Collector	Z=1
Skewed Location	0.5<Z<1

Dimensionless Variables
 $Y = \frac{L}{L_w}; \quad X = \frac{A}{L^2}$

$$Y = (1.5 - Z)(2.286X - 0.286X^2)$$


$$\frac{L_w}{L} = (1.5 - Z)[2.286\left(\frac{A}{L^2}\right) - 0.286\left(\frac{A}{L^2}\right)^2]$$

$$S_o/S_w = A/(LL_w) + L_w/L$$

$$X_w = A/L_w$$

Subarea ID	Area acre	A1 acre	A2 acre	L ft	High Pt Elev. ft	Low Pt Elev. ft	Z=Am/A	X=A/L ²	Y=Lw/L	Lw ft	Xw ft	So %	So/Sw	Sw %
OS-1	9.90	5.00	4.90	1,200	6498.0	6484.0	0.51	0.30	0.66	787	548	1.17	1.11	1.05
OS-2	12.50	8.75	3.75	630	6512.0	6488.0	0.70	1.37	2.08	1,309	416	3.81	2.74	1.39
OS-3	3.10	1.60	1.50	410	6,524	6,499	0.52	0.80	1.63	666	203	6.10	2.12	2.88
OS-4	520.40	210.00	310.40	7,400	6,610	6,498	0.60	0.41	0.81	6,000	3,778	1.51	1.32	1.15
OS-5	106.60	55.00	51.60	3,940	6,560	6,500	0.52	0.30	0.65	2,552	1,820	1.52	1.11	1.37
OS-6	4.00	2.50	1.50	615	6,517	6,499	0.63	0.46	0.87	534	326	2.93	1.40	2.09
OS-7	19.30	12.00	7.30	1,360	6,525	6,493	0.62	0.45	0.86	1,170	718	2.35	1.39	1.69
OS-8	2.30	1.10	1.20	200	6,516	6,500	0.52	2.50	3.85	769	130	8.00	4.50	1.78
OS-9	6.50	3.00	3.50	745	6,504	6,479	0.54	0.51	1.05	782	362	3.36	1.54	2.19
OS-10	2.40	1.20	1.20	600	6,467	6,456	0.50	0.29	0.64	384	272	1.83	1.09	1.68
OS-11	1.70	0.80	0.90	130	6,441	6,438	0.53	4.38	4.39	571	130	2.31	5.39	0.43
OS-12	2.90	1.60	1.30	440	6,467	6,458	0.55	0.65	1.30	572	221	2.05	1.80	1.14
OS-13	6.80	3.70	3.10	1,430	6,467	6,417	0.54	0.14	0.31	444	666	3.50	0.78	4.50
OS-14	30.30	15.00	15.30	1,340	6,467	6,408	0.50	0.74	1.52	2,034	649	4.40	2.00	2.20

Convert Natural Catchment to a Rectangular Shape

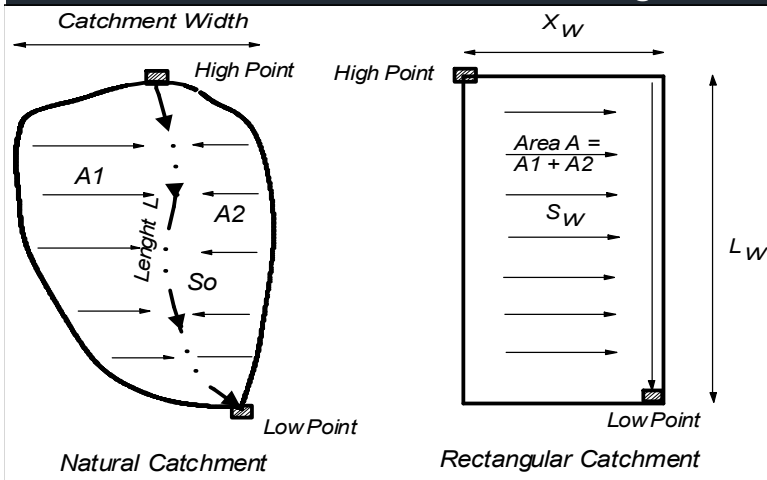

Subcatchment Center	Z=0.5
Side Collector	Z=1
Skewed Location	0.5<Z<1

Dimensionless Variables

$$Y = \frac{L}{L_w}; \quad X = \frac{A}{L^2}$$

$$Y = (1.5 - Z)(2.286X - 0.286X^2)$$


$$\frac{L_w}{L} = (1.5 - Z)[2.286\left(\frac{A}{L^2}\right) - 0.286\left(\frac{A}{L^2}\right)^2]$$

$$S_o/S_w = A/(LL_w) + L_w/L$$

$$X_w = A/L_w$$

Subarea ID	Area acre	A1 acre	A2 acre	L ft	High Pt Elev. ft	Low Pt Elev. ft	Z=A _m /A	X=A/L ²	Y=L _w /L	L _w ft	X _w ft	S _o %	S _o /S _w	S _w %
E-A	8.90	7.00	1.90	815	6498.0	6486.0	0.79	0.58	0.88	719	539	1.47	1.54	0.95
E-B	12.30	7.90	4.40	490	6500.0	6493.0	0.64	2.23	3.15	1,545	347	1.43	3.86	0.37
E-C	9.80	4.50	5.30	735	6,498	6,478	0.54	0.79	1.56	1,148	372	2.72	2.07	1.32
E-D	29.00	15.00	14.00	1,160	6,494	6,452	0.52	0.94	1.86	2,159	585	3.62	2.37	1.53
E-E	28.60	20.00	8.60	1,270	6,488	6,452	0.70	0.77	1.28	1,622	768	2.83	1.88	1.51
E-F	1.90	0.60	1.30	420	6,490	6,475	0.68	0.47	0.82	346	239	3.57	1.39	2.56
E-G	5.70	2.90	2.80	610	6,485	6,459	0.51	0.67	1.39	845	294	4.26	1.87	2.28
E-H	2.20	0.60	1.60	450	6,462	6,450	0.73	0.47	0.79	354	271	2.67	1.39	1.92
E-I	13.70	7.70	6.00	1,285	6,485	6,452	0.56	0.36	0.74	951	628	2.57	1.23	2.09
E-J	0.68	0.40	0.28	250	6,473	6,460	0.59	0.47	0.93	232	128	5.20	1.44	3.61
E-K	8.30	4.00	4.30	915	6,463	6,450	0.52	0.43	0.92	839	431	1.42	1.39	1.02
E-L	25.10	8.00	17.10	1,500	6,463	6,426	0.68	0.49	0.85	1,281	853	2.47	1.42	1.73
E-M	19.00	3.00	16.00	1,390	6,473	6,426	0.84	0.43	0.61	847	977	3.38	1.31	2.58
E-N	2.20	0.70	1.50	585	6,514	6,500	0.68	0.28	0.51	296	324	2.39	1.06	2.26
E-O	16.40	8.40	8.00	1,075	6,504	6,484	0.51	0.62	1.29	1,385	516	1.86	1.77	1.05
E-P	30.50	20.00	10.50	2,010	6,513	6,466	0.66	0.33	0.61	1,223	1,086	2.34	1.15	2.04
E-Q	24.80	8.80	16.00	1,530	6,503	6,466	0.65	0.46	0.85	1,300	831	2.42	1.39	1.74
E-R	65.20	15.00	50.20	2,000	6,500	6,426	0.77	0.71	1.08	2,159	1,315	3.70	1.74	2.13
E-S	26.50	16.50	10.00	1,340	6,485	6,440	0.62	0.64	1.19	1,589	727	3.36	1.73	1.94
E-T1	9.80	5.00	4.80	1,700	6,450	6,424	0.51	0.15	0.33	558	765	1.53	0.78	1.97
E-T2	10.70	6.70	4.00	1,080	6,447	6,418	0.63	0.40	0.76	819	569	2.69	1.29	2.09
E-U	16.80	8.80	8.00	1,230	6,458	6,418	0.52	0.48	1.01	1,247	587	3.25	1.49	2.18
E-V	7.50	4.50	3.00	940	6,450	6,419	0.60	0.37	0.73	682	479	3.30	1.24	2.67
E-W	15.20	8.00	7.20	1,310	6,430	6,394	0.53	0.39	0.82	1,071	618	2.75	1.29	2.13
E-X	6.70	3.50	3.20	740	6,417	6,394	0.52	0.53	1.11	823	355	3.11	1.59	1.95
E-Y	5.30	1.30	4.00	605	6,415	6,394	0.75	0.63	0.99	599	386	3.47	1.63	2.13
E-Z	21.40	6.40	15.00	1,650	6,422	6,383	0.70	0.34	0.60	988	944	2.36	1.17	2.02

Convert Natural Catchment to a Rectangular Shape

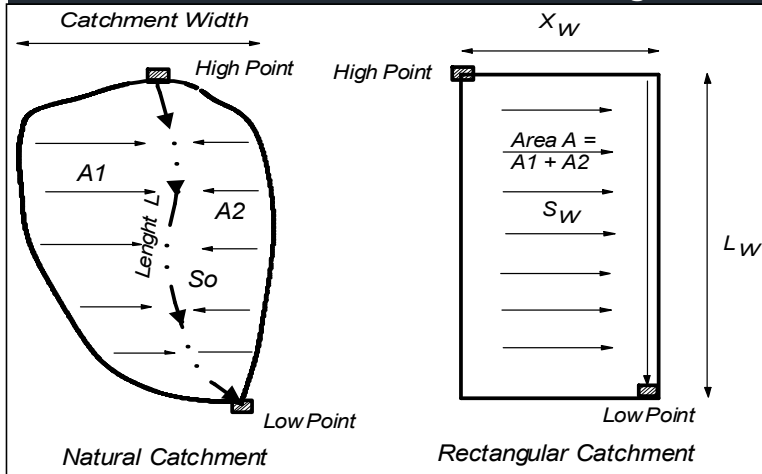

Subcatchment Center	Z=0.5
Side Collector	Z=1
Skewed Location	0.5<Z<1

Dimensionless Variables

$$Y = \frac{L}{L_w}; \quad X = \frac{A}{L^2}$$

$$Y = (1.5 - Z)(2.286X - 0.286X^2)$$

$$\frac{L_w}{L} = (1.5 - Z)[2.286\left(\frac{A}{L^2}\right) - 0.286\left(\frac{A}{L^2}\right)^2]$$

$$S_o/S_w = A/(LL_w) + L_w/L$$

$$X_w = A/L_w$$

Subarea ID	Area acre	A1 acre	A2 acre	L ft	High Pt Elev. ft	Low Pt Elev. ft	Z=Am/A	X=A/L ²	Y=Lw/L	Lw ft	Xw ft	So %	So/Sw	Sw %
E-AA	19.20	12.00	7.20	1,240	6479.0	6456.0	0.63	0.54	1.01	1,257	665	1.85	1.55	1.20
E-BB	46.20	30.00	16.20	1,140	6499.0	6450.0	0.65	1.55	2.43	2,768	727	4.30	3.07	1.40
E-CC	16.90	8.50	8.40	1,225	6,463	6,446	0.50	0.49	1.05	1,286	573	1.39	1.52	0.91
E-DD	17.50	9.00	12.50	1,950	6,453	6,432	0.71	0.20	0.35	685	1,114	1.08	0.92	1.17
E-EE	19.80	12.00	7.80	830	6,459	6,432	0.61	1.25	2.16	1,791	482	3.25	2.74	1.19
E-FF	3.50	1.70	1.80	250	6,452	6,442	0.51	2.44	3.82	955	160	4.00	4.46	0.90
E-GG	24.00	14.00	10.00	1,650	6,458	6,406	0.58	0.38	0.77	1,264	827	3.15	1.27	2.49
E-HH	21.00	6.00	15.00	2,420	6,441	6,392	0.71	0.16	0.28	666	1,374	2.02	0.84	2.40
E-II	15.70	10.00	5.70	1,070	6,422	6,392	0.64	0.60	1.09	1,167	586	2.80	1.64	1.71
E-JJ	3.80	2.20	1.60	670	6,432	6,416	0.58	0.37	0.74	496	334	2.39	1.24	1.93
E-KK	15.50	3.00	12.50	1,160	6,421	6,382	0.81	0.50	0.75	865	781	3.36	1.42	2.37
E-LL	5.70	1.70	4.00	565	6,400	6,382	0.70	0.78	1.28	724	343	3.19	1.89	1.69
E-MM	1.30	0.60	0.70	420	6,465	6,442	0.54	0.32	0.68	284	199	5.48	1.15	4.76
E-NN	8.30	6.00	2.30	550	6,415	6,398	0.72	1.20	1.81	993	364	3.09	2.47	1.25
E-OO	1.20	0.40	0.80	200	6,452	6,446	0.67	1.31	2.08	416	126	3.00	2.71	1.11
W-A	9.00	5.00	4.00	970	6,490	6,450	0.56	0.42	0.85	827	474	4.12	1.34	3.07
W-B	10.00	6.50	3.50	675	6,473	6,430	0.65	0.96	1.64	1,104	395	6.37	2.22	2.87
W-C	37.50	18.00	19.50	1,610	6,470	6,432	0.52	0.63	1.30	2,094	780	2.36	1.79	1.32
W-D	15.40	7.00	8.40	2,240	6,464	6,426	0.55	0.13	0.29	643	1,044	1.70	0.75	2.25
W-E	11.00	6.00	5.00	640	6,465	6,427	0.55	1.17	2.18	1,395	344	5.94	2.72	2.19
W-F	1.10	0.70	0.40	430	6,440	6,428	0.64	0.26	0.50	213	225	2.79	1.02	2.74
TANK	1.90	0.95	0.95	185	6,515	6,510	0.50	2.42	3.86	713	116	2.70	4.48	0.60

TRIPLE H RANCH PRELIMINARY DRAINAGE REPORT (Developed Conditions)

SUBCATCHMENT INPUT DATA										
							Depth of Depression Storage	Depth of Depression Storage	Imperv. Area with no Depression Storage	Infiltration
Subcatchment Basin Name	Area (Ac.)	Width Lw (Ft.)	Slope Sw (%)	Imperv. (%)	Mannings N (Imperv. Area)	Mannings N (Perv. Area)	Imperv. Area (in.)	Perv. Area (in.)	Storage (%)	Method
OS-1	9.9	787	1.05	3	0.014	0.24	0.10	0.35	25	Horton
OS-2	12.5	1309	1.39	2	0.014	0.24	0.10	0.35	25	Horton
OS-3	3.1	666	2.88	2	0.014	0.24	0.10	0.35	25	Horton
OS-4	520.4	6000	1.15	5	0.014	0.24	0.10	0.35	25	Horton
OS-5	106.6	2552	1.37	2	0.014	0.24	0.10	0.35	25	Horton
OS-6	4.0	534	2.09	2	0.014	0.24	0.10	0.35	25	Horton
OS-7	19.3	1170	1.69	2	0.014	0.24	0.10	0.35	25	Horton
OS-8	2.3	769	1.78	2	0.014	0.24	0.10	0.35	25	Horton
OS-9	6.5	782	2.19	2	0.014	0.24	0.10	0.35	25	Horton
OS-10	2.4	384	1.68	2	0.014	0.24	0.10	0.35	25	Horton
OS-11	1.7	571	0.43	2	0.014	0.24	0.10	0.35	25	Horton
OS-12	2.9	572	1.14	2	0.014	0.24	0.10	0.35	25	Horton
OS-13	6.8	444	4.50	10	0.014	0.24	0.10	0.35	25	Horton
OS-14	30.3	2034	2.20	5	0.014	0.24	0.10	0.35	25	Horton
E-A	8.9	719	0.95	10	0.014	0.24	0.10	0.35	25	Horton
E-B	12.3	1545	0.37	10	0.014	0.24	0.10	0.35	25	Horton
E-C	9.8	1148	1.32	10	0.014	0.24	0.10	0.35	25	Horton
E-D	29.0	2159	1.53	10	0.014	0.24	0.10	0.35	25	Horton
E-E	28.6	1622	1.51	10	0.014	0.24	0.10	0.35	25	Horton
E-F	1.9	346	2.56	10	0.014	0.24	0.10	0.35	25	Horton
E-G	5.7	845	2.28	11	0.014	0.24	0.10	0.35	25	Horton
E-H	2.2	354	1.92	10	0.014	0.24	0.10	0.35	25	Horton
E-I	13.7	951	2.09	11	0.014	0.24	0.10	0.35	25	Horton
E-J	0.68	232	3.61	10	0.014	0.24	0.10	0.35	25	Horton
E-K	8.3	839	1.02	6	0.014	0.24	0.10	0.35	25	Horton
E-L	25.1	1281	1.73	9	0.014	0.24	0.10	0.35	25	Horton
E-M	19.0	847	2.58	10	0.014	0.24	0.10	0.35	25	Horton

TRIPLE H RANCH PRELIMINARY DRAINAGE REPORT (Developed Conditions)

SUBCATCHMENT INPUT DATA										
							Depth of Depression Storage	Depth of Depression Storage	Imperv. Area with no Depression Storage	Infiltration
Subcatchment Basin Name	Area (Ac.)	Width Lw (Ft.)	Slope Sw (%)	Imperv. (%)	Mannings N (Imperv. Area)	Mannings N (Perv. Area)	Imperv. Area (in.)	Perv. Area (in.)	Storage (%)	Method
E-N	2.2	296	2.26	10	0.014	0.24	0.10	0.35	25	Horton
E-O	16.4	1385	1.05	10	0.014	0.24	0.10	0.35	25	Horton
E-P	30.5	1223	2.04	10	0.014	0.24	0.10	0.35	25	Horton
E-Q	24.8	1300	1.74	10	0.014	0.24	0.10	0.35	25	Horton
E-R	65.2	2159	2.13	10	0.014	0.24	0.10	0.35	25	Horton
E-S	26.5	1589	1.94	10	0.014	0.24	0.10	0.35	25	Horton
E-T1	9.8	558	1.97	10	0.014	0.24	0.10	0.35	25	Horton
E-T2	10.7	819	2.09	10	0.014	0.24	0.10	0.35	25	Horton
E-U	16.8	1247	2.18	10	0.014	0.24	0.10	0.35	25	Horton
E-V	7.5	682	2.67	10	0.014	0.24	0.10	0.35	25	Horton
E-W	15.2	1071	2.13	10	0.014	0.24	0.10	0.35	25	Horton
E-X	6.7	823	1.95	11	0.014	0.24	0.10	0.35	25	Horton
E-Y	5.3	599	2.13	10	0.014	0.24	0.10	0.35	25	Horton
E-Z	21.4	988	2.02	9	0.014	0.24	0.10	0.35	25	Horton
E-AA	19.2	1257	1.20	10	0.014	0.24	0.10	0.35	25	Horton
E-BB	46.2	2768	1.40	11	0.014	0.24	0.10	0.35	25	Horton
E-CC	16.9	1286	0.91	10	0.014	0.24	0.10	0.35	25	Horton
E-DD	17.5	685	1.17	10	0.014	0.24	0.10	0.35	25	Horton
E-EE	19.8	1791	1.19	10	0.014	0.24	0.10	0.35	25	Horton
E-FF	3.5	955	0.90	8	0.014	0.24	0.10	0.35	25	Horton
E-GG	24.0	1264	2.49	10	0.014	0.24	0.10	0.35	25	Horton
E-HH	21.0	666	2.40	10	0.014	0.24	0.10	0.35	25	Horton
E-II	15.7	1167	1.71	10	0.014	0.24	0.10	0.35	25	Horton
E-JJ	3.8	496	1.93	8	0.014	0.24	0.10	0.35	25	Horton
E-KK	15.5	865	2.37	10	0.014	0.24	0.10	0.35	25	Horton
E-LL	5.7	724	1.69	8	0.014	0.24	0.10	0.35	25	Horton
E-MM	1.3	284	4.76	10	0.014	0.24	0.10	0.35	25	Horton
E-NN	8.3	993	1.25	10	0.014	0.24	0.10	0.35	25	Horton
E-OO	1.2	416	1.11	2	0.014	0.24	0.10	0.35	25	Horton

TRIPLE H RANCH PRELIMINARY DRAINAGE REPORT (Developed Conditions)

SUBCATCHMENT INPUT DATA										
							Depth of Depression Storage	Depth of Depression Storage	Imperv. Area with no Depression Storage	Infiltration
Subcatchment Basin Name	Area (Ac.)	Width Lw (Ft.)	Slope Sw (%)	Imperv. (%)	Mannings N (Imperv. Area)	Mannings N (Perv. Area)	Imperv. Area (in.)	Perv. Area (in.)	Storage (%)	Method
W-A	9.0	827	3.07	10	0.014	0.24	0.10	0.35	25	Horton
W-B	10.0	1104	2.87	10	0.014	0.24	0.10	0.35	25	Horton
W-C	37.5	2094	1.32	10	0.014	0.24	0.10	0.35	25	Horton
W-D	15.4	643	2.25	10	0.014	0.24	0.10	0.35	25	Horton
W-E	11.0	1395	2.19	9	0.014	0.24	0.10	0.35	25	Horton
W-F	1.1	213	2.74	10	0.014	0.24	0.10	0.35	25	Horton
TANK	1.9	713	0.60	50	0.014	0.24	0.10	0.35	25	Horton

TRIPLE H RANCH - 5-yr. Developed Conditions

Analysis Options

Flow Units CFS
 Process Models:
 Rainfall/Runoff YES
 RDII NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed NO
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method KINWAVE
 Starting Date 08/22/2025 00:00:00
 Ending Date 08/22/2025 06:00:00
 Antecedent Dry Days 0.0
 Report Time Step 00:15:00
 Wet Time Step 00:05:00
 Dry Time Step 01:00:00
 Routing Time Step 30.00 sec

*****	Volume	Depth
Runoff Quantity Continuity	acre-feet	inches
*****	-----	-----
Total Precipitation	163.762	1.328
Evaporation Loss	0.000	0.000
Infiltration Loss	151.534	1.229
Surface Runoff	11.662	0.095
Final Storage	0.671	0.005
Continuity Error (%)	-0.064	

*****	Volume	Volume
Flow Routing Continuity	acre-feet	10^6 gal
*****	-----	-----
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	11.662	3.800
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	11.779	3.838
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.043	0.014

Continuity Error (%) -1.364

 Highest Flow Instability Indexes

 Link LW-2 (5)
 Link C35 (2)
 Link CW-3 (2)
 Link C108 (2)
 Link CE-28 (2)

 Routing Time Step Summary

 Minimum Time Step : 30.00 sec
 Average Time Step : 30.00 sec
 Maximum Time Step : 30.00 sec
 % of Time in Steady State : 0.00
 Average Iterations per Step : 1.22
 % of Steps Not Converging : 0.00

 Subcatchment Runoff Summary

Imperv		Perv		Total	Total	Total	Total
Runoff	Runoff	Total	Total	Peak	Runoff		
Subcatchment	Subcatchment	Runoff	Runoff	Runoff	Runoff	Evap	Infil
in	in	in	in	10^6 gal	in	in	in
				Precip	Runon	Coeff	
				in	in	in	
				in	in	in	
E-A				1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.03	0.03	3.49	0.098	
E-AA				1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.07	0.07	7.51	0.098	
E-B				1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.04	0.04	4.82	0.098	
E-BB				1.33	0.00	0.00	1.18
0.14	0.00	0.14	0.18	0.18	19.84	0.108	
E-C				1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.04	0.04	3.86	0.101	
E-CC				1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.06	0.06	6.62	0.098	
E-D				1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.10	0.10	11.39	0.099	
E-DD				1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.06	0.06	6.72	0.097	

E-E			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.10	11.19	0.098	
E-EE			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.07	7.79	0.099	
E-F			1.33	0.00	0.00	1.18
0.13	0.01	0.14	0.01	0.75	0.106	
E-FF			1.33	0.00	0.00	1.21
0.10	0.01	0.11	0.01	1.10	0.086	
E-G			1.33	0.00	0.00	1.17
0.14	0.01	0.15	0.02	2.47	0.113	
E-GG			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.09	9.42	0.099	
E-H			1.33	0.00	0.00	1.18
0.13	0.01	0.14	0.01	0.87	0.104	
E-HH			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.07	8.12	0.097	
E-I			1.33	0.00	0.00	1.18
0.14	0.01	0.14	0.05	5.92	0.109	
E-II			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.06	6.17	0.099	
E-J			1.33	0.00	0.00	1.17
0.13	0.03	0.15	0.00	0.27	0.114	
E-JJ			1.33	0.00	0.00	1.21
0.10	0.01	0.11	0.01	1.20	0.083	
E-K			1.33	0.00	0.00	1.24
0.08	0.01	0.08	0.02	1.96	0.061	
E-KK			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.06	6.08	0.099	
E-L			1.33	0.00	0.00	1.20
0.11	0.00	0.12	0.08	8.85	0.088	
E-LL			1.33	0.00	0.00	1.21
0.10	0.01	0.11	0.02	1.80	0.083	
E-M			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.07	7.44	0.098	
E-N			1.33	0.00	0.00	1.19
0.13	0.01	0.14	0.01	0.87	0.103	
E-O			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.06	6.44	0.099	
E-P			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.11	11.87	0.098	
E-Q			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.09	9.70	0.098	
E-R			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.23	25.21	0.097	
E-S			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.09	10.40	0.099	
E-T1			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.03	3.84	0.098	
E-U			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.06	6.61	0.100	
E-V			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.03	2.96	0.101	
E-W			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.05	5.98	0.099	

E-X			1.33	0.00	0.00	1.17
0.14	0.01	0.15	0.03	2.91	0.111	
W-G			1.33	0.00	0.00	1.20
0.11	0.00	0.12	0.07	7.57	0.089	
E-MM			1.33	0.00	0.00	1.18
0.13	0.02	0.15	0.01	0.51	0.110	
E-NN			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.03	3.27	0.100	
E-Y			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.02	2.09	0.102	
E-Z			1.33	0.00	0.00	1.20
0.11	0.00	0.12	0.07	7.54	0.088	
OS-1			1.33	0.00	0.00	1.28
0.04	0.00	0.04	0.01	1.25	0.034	
OS-10			1.33	0.00	0.00	1.29
0.03	0.01	0.04	0.00	0.19	0.027	
E-OO			1.33	0.00	0.00	1.28
0.03	0.02	0.04	0.00	0.09	0.032	
OS-11			1.33	0.00	0.00	1.29
0.03	0.01	0.04	0.00	0.13	0.028	
OS-12			1.33	0.00	0.00	1.29
0.03	0.01	0.04	0.00	0.23	0.027	
OS-13			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.02	2.68	0.101	
OS-14			1.33	0.00	0.00	1.26
0.06	0.01	0.07	0.06	5.97	0.052	
OS-2			1.33	0.00	0.00	1.29
0.03	0.01	0.03	0.01	0.99	0.024	
OS-3			1.33	0.00	0.00	1.28
0.03	0.02	0.04	0.00	0.24	0.032	
OS-4			1.33	0.00	0.00	1.26
0.06	0.00	0.06	0.90	95.82	0.048	
OS-5			1.33	0.00	0.00	1.30
0.03	0.00	0.03	0.08	8.40	0.020	
OS-6			1.33	0.00	0.00	1.29
0.03	0.01	0.04	0.00	0.32	0.027	
OS-7			1.33	0.00	0.00	1.30
0.03	0.00	0.03	0.02	1.52	0.022	
OS-8			1.33	0.00	0.00	1.28
0.03	0.02	0.05	0.00	0.18	0.034	
OS-9			1.33	0.00	0.00	1.29
0.03	0.01	0.03	0.01	0.51	0.026	
TANK-SITE			1.33	0.00	0.00	0.65
0.63	0.01	0.64	0.03	3.70	0.485	
W-A			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.03	3.55	0.101	
W-B			1.33	0.00	0.00	1.19
0.13	0.01	0.14	0.04	3.94	0.102	
W-C			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.13	14.64	0.098	
W-D			1.33	0.00	0.00	1.19
0.13	0.00	0.13	0.05	6.01	0.098	
W-E			1.33	0.00	0.00	1.20
0.11	0.01	0.12	0.04	3.90	0.093	

W-F			1.33	0.00	0.00	1.17
0.13	0.02	0.15	0.00	0.43	0.111	
E-T2			1.33	0.00	0.00	1.19
0.13	0.01	0.13	0.04	4.21	0.100	

Node Depth Summary

Reported Max Depth Node Feet	Type	Average Depth Feet	Maximum Depth Feet	Maximum HGL Feet	Time of Max Occurrence days hr:min
DP-1 0.55	JUNCTION	0.07	0.57	6449.57	0 00:45
JW3 1.00	JUNCTION	0.17	1.09	6483.09	0 00:55
J-W3 0.71	JUNCTION	0.12	0.72	6448.72	0 00:45
DP-3 1.04	JUNCTION	0.14	1.07	6434.07	0 00:45
DP-2 0.57	JUNCTION	0.08	0.58	6436.58	0 00:45
JW2 0.83	JUNCTION	0.16	1.21	6490.21	0 00:50
DP-6 0.29	JUNCTION	0.04	0.30	6473.30	0 00:45
J23 0.78	JUNCTION	0.14	0.80	6452.80	0 00:45
DP-15 0.75	JUNCTION	0.17	0.83	6452.83	0 00:50
DP-10 0.62	JUNCTION	0.08	0.63	6475.63	0 00:45
JW1 1.04	JUNCTION	0.15	1.20	6494.20	0 00:47
DP-16 1.21	JUNCTION	0.14	1.24	6498.24	0 00:45
DP-11 0.33	JUNCTION	0.05	0.33	6485.83	0 00:45
J29 0.32	JUNCTION	0.05	0.33	6472.33	0 00:46
J30 0.63	JUNCTION	0.14	0.65	6474.65	0 00:46
J31 0.80	JUNCTION	0.15	0.87	6451.87	0 00:48
DP-7 0.58	JUNCTION	0.11	0.59	6460.59	0 00:45

J33	JUNCTION	0.11	0.60	6459.60	0	00:48
0.55						
DP-23	JUNCTION	0.13	0.77	6453.77	0	00:45
0.76						
J35	JUNCTION	0.00	0.00	6480.00	0	00:00
0.00						
J36	JUNCTION	0.00	0.00	6479.00	0	00:00
0.00						
J38	JUNCTION	0.12	0.68	6485.18	0	00:46
0.67						
J39	JUNCTION	0.12	0.67	6481.67	0	00:47
0.60						
J40	JUNCTION	0.11	0.59	6480.59	0	00:49
0.48						
DP-12	JUNCTION	0.12	0.70	6500.70	0	00:45
0.69						
DP-13	JUNCTION	0.13	0.79	6494.79	0	00:46
0.75						
J43	JUNCTION	0.16	0.85	6493.85	0	00:46
0.82						
J44	JUNCTION	0.11	0.83	6451.83	0	00:46
0.77						
J45	JUNCTION	0.12	0.86	6450.86	0	00:49
0.74						
DP-9	JUNCTION	0.04	0.32	6449.32	0	00:45
0.32						
J47	JUNCTION	0.06	0.38	6448.38	0	00:46
0.37						
DP-8	JUNCTION	0.13	0.79	6449.79	0	00:50
0.59						
J49	JUNCTION	0.14	0.87	6448.87	0	00:51
0.72						
J50	JUNCTION	0.16	0.90	6504.90	0	00:45
0.89						
J51	JUNCTION	0.16	0.88	6504.38	0	00:47
0.81						
DP-14	JUNCTION	0.15	0.71	6500.71	0	00:51
0.55						
J53	JUNCTION	0.11	0.60	6499.60	0	00:51
0.46						
DP-18	JUNCTION	0.04	0.19	6498.19	0	00:45
0.18						
DP-21	JUNCTION	0.20	1.05	6484.05	0	00:48
0.93						
J56	JUNCTION	0.14	0.78	6482.78	0	00:48
0.65						
DP-22	JUNCTION	0.17	0.71	6465.71	0	00:51
0.68						
J58	JUNCTION	0.24	1.01	6465.01	0	00:46
0.99						
DP-20	JUNCTION	0.04	0.16	6500.16	0	00:45
0.16						
J61	JUNCTION	0.05	0.25	6485.25	0	01:01
0.25						

J62	JUNCTION	0.20	1.09	6485.09	0	00:45
1.08						
DP-36	JUNCTION	0.14	0.77	6407.77	0	00:45
0.76						
J64	JUNCTION	0.05	0.28	6442.28	0	00:45
0.27						
DP-42	JUNCTION	0.22	0.96	6445.96	0	00:52
0.87						
DP-44	JUNCTION	0.15	0.88	6431.88	0	00:48
0.78						
DP-27	JUNCTION	0.26	0.96	6439.96	0	00:50
0.89						
DP-35	JUNCTION	0.04	0.29	6394.29	0	00:45
0.29						
DP-31	JUNCTION	0.26	1.32	6418.32	0	00:47
1.18						
DP-33	JUNCTION	0.14	0.76	6414.76	0	00:48
0.68						
DP-37	JUNCTION	0.15	0.75	6398.75	0	00:47
0.67						
DP-28	JUNCTION	0.23	0.84	6425.84	0	01:02
0.84						
DP-19	JUNCTION	0.07	0.40	6493.40	0	00:45
0.39						
J74	JUNCTION	0.08	0.44	6492.44	0	00:47
0.40						
J75	JUNCTION	0.15	0.84	6452.84	0	00:46
0.82						
J76	JUNCTION	0.16	0.79	6443.79	0	00:49
0.63						
DP-24	JUNCTION	0.05	0.24	6459.24	0	00:45
0.24						
J78	JUNCTION	0.04	0.24	6458.24	0	00:46
0.23						
DP-25	JUNCTION	0.14	0.85	6426.85	0	00:45
0.83						
J80	JUNCTION	0.25	1.24	6426.24	0	00:45
1.21						
J81	JUNCTION	0.28	1.24	6425.24	0	00:46
1.20						
DP-26	JUNCTION	0.03	0.13	6458.13	0	00:45
0.13						
DP-30	JUNCTION	0.26	1.32	6420.32	0	00:46
1.23						
J82	JUNCTION	0.20	0.91	6438.91	0	00:46
0.88						
DP-29	JUNCTION	0.21	1.03	6426.03	0	00:46
0.99						
DP-32	JUNCTION	0.14	0.80	6417.80	0	00:45
0.79						
DP-34	JUNCTION	0.37	1.61	6394.61	0	00:49
1.33						
POND1-E-OUTFALL-NW	JUNCTION	0.50	1.70	6389.70	0	00:50
1.48						

J84	JUNCTION	0.16	0.87	6413.87	0	00:46
0.85						
DP-38	JUNCTION	0.06	0.29	6479.29	0	00:45
0.29						
DP-40	JUNCTION	0.04	0.17	6456.17	0	00:45
0.17						
DP-39	JUNCTION	0.13	0.90	6453.90	0	00:45
0.88						
J86	JUNCTION	0.18	0.95	6452.95	0	00:45
0.94						
DP-41	JUNCTION	0.18	0.94	6450.94	0	00:47
0.88						
J88	JUNCTION	0.20	1.02	6450.02	0	00:47
0.94						
J89	JUNCTION	0.14	0.88	6444.88	0	00:45
0.86						
DP-43	JUNCTION	0.11	0.83	6445.83	0	00:45
0.81						
J91	JUNCTION	0.14	0.83	6444.83	0	00:45
0.81						
J92	JUNCTION	0.15	0.88	6430.88	0	00:48
0.77						
J93	JUNCTION	0.15	0.81	6445.81	0	00:45
0.80						
J94	JUNCTION	0.15	0.76	6430.76	0	00:49
0.63						
DP-46	JUNCTION	0.17	0.86	6404.86	0	00:51
0.71						
J96	JUNCTION	0.17	0.86	6403.86	0	00:51
0.70						
J97	JUNCTION	0.23	0.97	6403.97	0	00:45
0.95						
DP-48	JUNCTION	0.33	1.61	6393.61	0	00:54
1.46						
DP-47	JUNCTION	0.24	0.92	6393.92	0	00:55
0.88						
POND1-E-OUTFALL-NE	JUNCTION	0.35	1.60	6389.60	0	00:55
1.49						
POND1-E-OUTFALL-SW	JUNCTION	0.13	0.69	6388.69	0	00:47
0.66						
DP-45	JUNCTION	0.04	0.17	6438.17	0	00:45
0.17						
CREEK-OUTFALL-2	OUTFALL	0.00	0.00	6414.00	0	00:00
0.00						
POND2-WEST	OUTFALL	0.00	0.00	6429.00	0	00:00
0.00						
POND1-EAST	OUTFALL	0.50	1.68	6387.68	0	00:51
1.49						
Out11	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
Out13	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
Out14	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						

Out15	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
Out16	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
DP-4-POND1-WEST	OUTFALL	0.20	1.06	6432.06	0	00:46
1.03						
DP-17-CREEK-OUTFALL-1	OUTFALL	0.09	0.58	6418.58	0	01:00
0.58						

Node Inflow Summary

Lateral		Total	Flow	Maximum	Maximum	Time of Max	
Inflow	Inflow	Balance	Lateral	Total	Inflow	Occurrence	
Volume	Volume	Error	Inflow	Inflow			
Node	Node	Type	CFS	CFS	days	hr:min	10^6
gal	10^6 gal	Percent					
DP-1		JUNCTION	3.55	3.55	0	00:45	
0.0329	0.0329	0.000					
JW3		JUNCTION	1.25	69.33	0	00:55	
0.0121	0.951	0.000					
J-W3		JUNCTION	0.00	3.49	0	00:45	
0	0.0329	0.000					
DP-3		JUNCTION	14.64	18.16	0	00:45	
0.132	0.169	0.000					
DP-2		JUNCTION	3.94	3.94	0	00:45	
0.0369	0.0369	0.000					
JW2		JUNCTION	0.99	83.29	0	00:50	
0.0109	0.922	0.000					
DP-6		JUNCTION	0.75	0.75	0	00:45	
0.00723	0.00723	0.000					
J23		JUNCTION	11.19	12.37	0	00:45	
0.101	0.132	0.000					
DP-15		JUNCTION	11.39	23.04	0	00:47	
0.103	0.292	0.000					
DP-10		JUNCTION	3.86	3.86	0	00:45	
0.0355	0.0355	0.000					
JW1		JUNCTION	0.24	87.94	0	00:47	
0.00358	0.908	0.000					
DP-16		JUNCTION	95.82	95.82	0	00:45	
0.903	0.903	0.000					
DP-11		JUNCTION	3.49	3.49	0	00:45	
0.0316	0.0316	0.000					
J29		JUNCTION	0.00	0.73	0	00:46	
0	0.00721	0.000					

J30		JUNCTION	0.00	5.26	0	00:46
0	0.067	0.000				
J31		JUNCTION	0.00	25.02	0	00:48
0	0.333	0.000				
DP-7		JUNCTION	2.47	2.93	0	00:45
0.0232	0.0305	0.000				
J33		JUNCTION	0.00	2.71	0	00:48
0	0.0305	0.000				
DP-23		JUNCTION	5.92	5.92	0	00:45
0.0537	0.0537	0.000				
J35		JUNCTION	0.00	0.00	0	00:00
0	0	0.000 gal				
J36		JUNCTION	0.00	0.00	0	00:00
0	0	0.000 gal				
J38		JUNCTION	0.00	3.42	0	00:46
0	0.0315	0.000				
J39		JUNCTION	0.00	3.19	0	00:47
0	0.0316	0.000				
J40		JUNCTION	0.00	3.09	0	00:49
0	0.0316	0.000				
DP-12		JUNCTION	8.40	8.40	0	00:45
0.0778	0.0778	0.000				
DP-13		JUNCTION	4.82	11.90	0	00:46
0.0436	0.122	0.000				
J43		JUNCTION	0.00	11.86	0	00:46
0	0.121	0.000				
J44		JUNCTION	0.00	11.83	0	00:46
0	0.132	0.000				
J45		JUNCTION	0.00	24.85	0	00:49
0	0.333	0.000				
DP-9		JUNCTION	0.87	0.87	0	00:45
0.00821	0.00821	0.000				
J47		JUNCTION	0.00	0.85	0	00:46
0	0.00819	0.000				
DP-8		JUNCTION	0.00	10.75	0	00:50
0	0.132	0.000				
J49		JUNCTION	0.00	33.80	0	00:51
0	0.466	0.000				
J50		JUNCTION	3.70	3.70	0	00:45
0.0332	0.0332	0.000				
J51		JUNCTION	0.00	3.43	0	00:47
0	0.0332	-0.000				
DP-14		JUNCTION	0.87	3.44	0	00:51
0.00816	0.0415	0.000				
J53		JUNCTION	0.00	3.43	0	00:51
0	0.0414	0.000				
DP-18		JUNCTION	0.32	0.32	0	00:45
0.00384	0.00384	0.000				
DP-21		JUNCTION	0.00	5.78	0	00:48
0	0.0613	0.000				
J56		JUNCTION	0.00	5.78	0	00:48
0	0.0612	-0.000				
DP-22		JUNCTION	11.87	14.00	0	00:45
0.107	0.191	0.000				

J58		JUNCTION	0.00	13.76	0	00:46
0	0.19	0.000				
DP-20		JUNCTION	0.18	0.18	0	00:45
0.00284	0.00284	0.000				
J61		JUNCTION	0.00	0.17	0	01:01
0	0.00285	0.000				
J62		JUNCTION	6.44	6.48	0	00:45
0.0584	0.0613	0.000				
DP-36		JUNCTION	5.97	6.10	0	00:45
0.0565	0.0618	0.000				
J64		JUNCTION	0.51	0.51	0	00:45
0.00518	0.00518	0.000				
DP-42		JUNCTION	19.84	22.43	0	00:45
0.179	0.256	0.000				
DP-44		JUNCTION	7.79	30.37	0	00:48
0.0708	0.387	0.000				
DP-27		JUNCTION	20.10	27.09	0	00:45
0.182	0.373	0.000				
DP-35		JUNCTION	2.09	2.09	0	00:45
0.0194	0.0194	0.000				
DP-31		JUNCTION	2.68	78.75	0	00:47
0.0247	1.4	0.000				
DP-33		JUNCTION	6.61	9.42	0	00:45
0.0605	0.099	0.000				
DP-37		JUNCTION	3.27	8.22	0	00:46
0.0301	0.0919	0.000				
DP-28		JUNCTION	25.21	31.09	0	01:02
0.229	0.71	0.000				
DP-19		JUNCTION	1.52	1.52	0	00:45
0.0156	0.0156	0.000				
J74		JUNCTION	0.00	1.68	0	00:47
0	0.0194	0.000				
J75		JUNCTION	0.00	5.98	0	00:46
0	0.0565	0.000				
J76		JUNCTION	1.96	6.23	0	00:48
0.0183	0.0751	0.000				
DP-24		JUNCTION	0.27	0.27	0	00:45
0.0028	0.0028	0.000				
J78		JUNCTION	0.00	0.26	0	00:46
0	0.0028	0.000				
DP-25		JUNCTION	8.85	13.85	0	00:45
0.0801	0.164	0.000				
J80		JUNCTION	7.44	21.11	0	00:45
0.0673	0.234	0.000				
J81		JUNCTION	0.00	76.47	0	00:46
0	1.35	0.000				
DP-26		JUNCTION	0.23	0.23	0	00:45
0.00285	0.00285	0.000				
DP-30		JUNCTION	2.96	77.44	0	00:46
0.0273	1.38	0.000				
J82		JUNCTION	0.00	27.05	0	00:46
0	0.372	0.000				
DP-29		JUNCTION	3.84	30.67	0	00:46
0.0348	0.407	0.000				

DP-32		JUNCTION	4.21	4.21	0	00:45
0.0384	0.0384	0.000				
DP-34		JUNCTION	8.88	88.41	0	00:49
0.0814	1.58	0.000				
POND1-E-OUTFALL-NW		JUNCTION	0.00	89.14	0	00:50
0	1.6	0.000				
J84		JUNCTION	0.00	9.40	0	00:46
0	0.0988	0.000				
DP-38		JUNCTION	0.51	0.51	0	00:45
0.00612	0.00612	-0.000				
DP-40		JUNCTION	0.19	0.19	0	00:45
0.00235	0.00235	0.000				
DP-39		JUNCTION	7.51	7.62	0	00:45
0.068	0.0742	0.000				
J86		JUNCTION	0.00	7.49	0	00:45
0	0.0741	0.000				
DP-41		JUNCTION	0.00	7.32	0	00:47
0	0.0765	0.000				
J88		JUNCTION	0.00	7.33	0	00:47
0	0.0764	0.000				
J89		JUNCTION	0.00	22.06	0	00:45
0	0.256	0.000				
DP-43		JUNCTION	6.62	6.62	0	00:45
0.0599	0.0599	0.000				
J91		JUNCTION	0.00	6.52	0	00:45
0	0.0598	0.000				
J92		JUNCTION	0.00	30.27	0	00:48
0	0.387	0.000				
J93		JUNCTION	6.72	6.72	0	00:45
0.0612	0.0612	0.000				
J94		JUNCTION	0.00	5.67	0	00:49
0	0.0614	0.000				
DP-46		JUNCTION	9.42	32.26	0	00:51
0.0853	0.473	0.000				
J96		JUNCTION	0.00	32.28	0	00:51
0	0.472	0.000				
J97		JUNCTION	8.12	9.44	0	00:45
0.0737	0.137	0.000				
DP-48		JUNCTION	6.17	41.54	0	00:54
0.0561	0.665	0.000				
DP-47		JUNCTION	0.00	8.18	0	00:55
0	0.137	0.000				
POND1-E-OUTFALL-NE		JUNCTION	0.00	41.33	0	00:55
0	0.663	0.000				
POND1-E-OUTFALL-SW		JUNCTION	0.00	8.21	0	00:47
0	0.0919	0.000				
DP-45		JUNCTION	0.13	0.13	0	00:45
0.00169	0.00169	0.000				
CREEK-OUTFALL-2		OUTFALL	8.00	8.00	0	00:45
0.0732	0.0732	0.000				
POND2-WEST		OUTFALL	3.90	3.90	0	00:45
0.0368	0.0368	0.000				
POND1-EAST		OUTFALL	7.54	130.89	0	00:52
0.0682	2.42	0.000				

Out11		OUTFALL	6.08	6.08	0	00:45
0.0552	0.0552	0.000				
Out13		OUTFALL	1.20	1.20	0	00:45
0.0114	0.0114	0.000				
Out14		OUTFALL	1.80	1.80	0	00:45
0.017	0.017	0.000				
Out15		OUTFALL	1.10	1.10	0	00:45
0.0108	0.0108	0.000				
Out16		OUTFALL	0.09	0.09	0	00:45
0.00139	0.00139	0.000				
DP-4-POND1-WEST		OUTFALL	6.01	23.92	0	00:46
0.0543	0.258	0.000				
DP-17-CREEK-OUTFALL-1		OUTFALL	0.00	65.08	0	01:00
0	0.953	0.000				

Node Flooding Summary

No nodes were flooded.

Outfall Loading Summary

Outfall Node	Flow Freq Pcmt	Avg Flow CFS	Max Flow CFS	Total Volume 10^6 gal
CREEK-OUTFALL-2	55.69	0.81	8.00	0.073
POND2-WEST	43.47	0.52	3.90	0.037
POND1-EAST	98.47	15.22	130.89	2.421
Out11	54.44	0.63	6.08	0.055
Out13	38.75	0.18	1.20	0.011
Out14	40.28	0.26	1.80	0.017
Out15	37.50	0.18	1.10	0.011
Out16	33.33	0.03	0.09	0.001
DP-4-POND1-WEST	98.47	1.62	23.92	0.258
DP-17-CREEK-OUTFALL-1	89.31	6.61	65.08	0.953
System	58.97	26.06	188.93	3.838

Link Flow Summary

Max/ Maximum Time of Max Maximum Max/

Full Link Depth	Type	Flow CFS	Occurrence days hr:min	Veloc ft/sec	Full Flow
0.23	CW-1	3.49	0 00:45	4.23	0.11
0.27	LW-2	1.81	0 00:56	2.08	0.03
0.15	CE-1	0.73	0 00:46	2.54	0.05
0.25	CE-4	3.80	0 00:45	3.97	0.14
0.15	LE-2	0.65	0 00:48	1.98	0.01
0.00	C25	0.00	0 00:00	0.00	0.00
0.31	C26	4.90	0 00:50	3.24	0.05
0.00	C27	0.00	0 00:00	0.00	0.00
0.28	CE-2	2.71	0 00:48	1.23	0.04
0.11	CE-5	3.42	0 00:46	2.73	0.03
0.33	C32	3.19	0 00:47	2.00	0.05
0.27	C33	3.09	0 00:49	1.45	0.05
0.29	C34	2.98	0 00:51	2.34	0.04
0.34	C35	7.76	0 00:47	2.51	0.06
0.32	CE-6	11.86	0 00:46	4.48	0.22
0.41	C37	11.01	0 00:50	4.55	0.10
0.23	CE-7	22.94	0 00:48	4.67	0.11
0.39	LE-4	11.83	0 00:46	1.91	0.14
0.39	LE-5	10.75	0 00:50	1.83	0.15
0.30	CE-3	10.76	0 00:50	4.35	0.20
0.16	CE-9	0.85	0 00:46	2.64	0.06
0.43	C43	24.85	0 00:49	2.15	0.20
0.37	C44	23.78	0 00:53	1.82	0.17
0.44	C45	3.43	0 00:47	1.22	0.11

CE-8	CONDUIT	3.43	0	00:51	3.84	0.12
0.24						
C47	CONDUIT	3.08	0	00:51	1.75	0.06
0.35						
C48	CONDUIT	3.32	0	00:53	3.75	0.02
0.24						
CE-10	CONDUIT	5.78	0	00:48	4.44	0.21
0.31						
C50	CONDUIT	5.28	0	00:51	2.94	0.06
0.35						
CE-11	CONDUIT	13.76	0	00:46	4.19	0.17
0.28						
C52	CONDUIT	0.17	0	01:01	1.27	0.00
0.08						
C53	CONDUIT	0.16	0	01:05	0.72	0.00
0.12						
J63'	CONDUIT	5.78	0	00:48	1.55	0.18
0.52						
C55	CONDUIT	0.85	0	01:03	1.60	0.01
0.17						
C56	CONDUIT	0.36	0	00:50	2.01	0.00
0.12						
C57	CONDUIT	5.56	0	00:47	2.83	0.07
0.37						
C61	CONDUIT	11.79	0	00:50	3.45	0.14
0.47						
C70	CONDUIT	26.35	0	01:03	3.04	0.16
0.37						
CW-3	CONDUIT	3.78	0	00:46	4.68	0.11
0.23						
CW-4	CONDUIT	17.96	0	00:46	8.07	0.27
0.35						
LE-3	CONDUIT	2.52	0	00:51	2.01	0.04
0.29						
C72	CONDUIT	0.29	0	00:47	1.30	0.00
0.09						
C73	CONDUIT	1.39	0	00:47	1.04	0.01
0.19						
CE-13	CONDUIT	0.26	0	00:46	1.17	0.00
0.12						
C75	CONDUIT	0.24	0	00:49	1.35	0.00
0.11						
CE-12	CONDUIT	5.81	0	00:46	2.54	0.08
0.38						
C77	CONDUIT	5.10	0	00:49	2.52	0.08
0.38						
C78	CONDUIT	0.51	0	00:51	1.76	0.01
0.15						
C79	CONDUIT	6.23	0	00:49	7.46	0.02
0.23						
CE-14	CONDUIT	13.78	0	00:46	4.69	0.25
0.34						
C80	CONDUIT	0.19	0	00:50	1.58	0.00
0.06						

C81	CONDUIT	21.08	0	00:46	3.46	0.28
0.62						
CE-16	CONDUIT	31.07	0	01:02	4.35	0.13
0.24						
C83	CONDUIT	74.83	0	00:46	4.44	0.35
0.58						
C84	CONDUIT	76.70	0	00:47	3.84	0.19
0.44						
CE-15	CONDUIT	27.05	0	00:46	4.97	0.20
0.30						
C86	CONDUIT	27.04	0	00:46	9.68	0.10
0.42						
CE-17	CONDUIT	30.63	0	00:46	4.77	0.25
0.34						
CE-19	CONDUIT	88.07	0	00:50	15.29	0.19
0.29						
CE-20	CONDUIT	2.05	0	00:45	7.40	0.05
0.15						
C89	CONDUIT	3.73	0	00:48	1.94	0.08
0.38						
C90	CONDUIT	8.61	0	00:50	3.45	0.10
0.41						
C91	CONDUIT	75.05	0	00:49	5.31	0.13
0.35						
CE-18	CONDUIT	9.40	0	00:46	4.19	0.17
0.28						
C92	CONDUIT	87.23	0	00:51	2.55	0.10
0.42						
C93	CONDUIT	0.34	0	00:50	1.96	0.00
0.12						
CE-22	CONDUIT	7.49	0	00:45	4.81	0.27
0.36						
C95	CONDUIT	0.15	0	00:50	1.00	0.00
0.08						
CE-23	CONDUIT	7.33	0	00:47	2.81	0.21
0.31						
C97	CONDUIT	7.20	0	00:47	2.14	0.13
0.47						
C98	CONDUIT	6.29	0	00:52	1.96	0.14
0.47						
CE-25	CONDUIT	6.52	0	00:45	4.61	0.24
0.33						
C100	CONDUIT	5.96	0	00:48	3.18	0.07
0.36						
CE-26	CONDUIT	30.27	0	00:48	4.38	0.19
0.29						
C102	CONDUIT	5.67	0	00:49	3.00	0.08
0.37						
C103	CONDUIT	19.39	0	00:49	3.25	0.15
0.39						
CE-24	CONDUIT	22.06	0	00:45	4.79	0.27
0.35						
C105	CONDUIT	28.50	0	00:51	3.93	0.11
0.30						

C106	CONDUIT	4.97	0	00:53	3.11	0.05
0.33						
CE-27	CONDUIT	32.28	0	00:51	4.80	0.18
0.29						
C107	CONDUIT	31.39	0	00:54	3.25	0.16
0.38						
C108	CONDUIT	8.18	0	00:55	2.58	0.13
0.46						
CE-28	CONDUIT	8.19	0	00:55	4.03	0.15
0.26						
CE-29	CONDUIT	41.33	0	00:55	8.17	0.27
0.36						
C110	CONDUIT	8.21	0	00:47	6.49	0.03
0.28						
C111	CONDUIT	41.06	0	00:57	2.30	0.04
0.30						
C112	CONDUIT	7.65	0	00:50	1.49	0.01
0.17						
C113	CONDUIT	0.08	0	01:15	1.79	0.00
0.07						
C1	CONDUIT	87.73	0	00:47	3.20	0.18
0.39						
C2	CONDUIT	82.76	0	00:50	3.10	0.18
0.38						
C3	CONDUIT	68.89	0	00:55	2.85	0.16
0.35						
C4	CONDUIT	65.08	0	01:00	5.23	0.05
0.19						

 Conduit Surcharge Summary

No conduits were surcharged.

Analysis begun on: Wed May 13 14:11:51 2026
 Analysis ended on: Wed May 13 14:11:51 2026
 Total elapsed time: < 1 sec

TRIPLE H RANCH - 5-yr. Developed Conditions

Subcatchment Runoff Summary

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Imperv Runoff in	Perv Runoff in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
E-A	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.03	3.49	0.098
E-AA	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.07	7.51	0.098
E-B	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.04	4.82	0.098
E-BB	1.33	0.00	0.00	1.18	0.14	0.00	0.14	0.18	19.84	0.108
E-C	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.04	3.86	0.101
E-CC	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.06	6.62	0.098
E-D	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.10	11.39	0.099
E-DD	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.06	6.72	0.097
E-E	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.10	11.19	0.098
E-EE	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.07	7.79	0.099
E-F	1.33	0.00	0.00	1.18	0.13	0.01	0.14	0.01	0.75	0.106
E-FF	1.33	0.00	0.00	1.21	0.10	0.01	0.11	0.01	1.10	0.086
E-G	1.33	0.00	0.00	1.17	0.14	0.01	0.15	0.02	2.47	0.113
E-GG	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.09	9.42	0.099
E-H	1.33	0.00	0.00	1.18	0.13	0.01	0.14	0.01	0.87	0.104
E-HH	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.07	8.12	0.097
E-I	1.33	0.00	0.00	1.18	0.14	0.01	0.14	0.05	5.92	0.109
E-II	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.06	6.17	0.099
E-J	1.33	0.00	0.00	1.17	0.13	0.03	0.15	0.00	0.27	0.114
E-JJ	1.33	0.00	0.00	1.21	0.10	0.01	0.11	0.01	1.20	0.083
E-K	1.33	0.00	0.00	1.24	0.08	0.01	0.08	0.02	1.96	0.061
E-KK	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.06	6.08	0.099
E-L	1.33	0.00	0.00	1.20	0.11	0.00	0.12	0.08	8.85	0.088
E-LL	1.33	0.00	0.00	1.21	0.10	0.01	0.11	0.02	1.80	0.083

TRIPLE H RANCH - 5-yr. Developed Conditions

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Imperv Runoff in	Perv Runoff in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
E-M	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.07	7.44	0.098
E-N	1.33	0.00	0.00	1.19	0.13	0.01	0.14	0.01	0.87	0.103
E-O	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.06	6.44	0.099
E-P	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.11	11.87	0.098
E-Q	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.09	9.70	0.098
E-R	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.23	25.21	0.097
E-S	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.09	10.40	0.099
E-T1	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.03	3.84	0.098
E-U	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.06	6.61	0.100
E-V	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.03	2.96	0.101
E-W	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.05	5.98	0.099
E-X	1.33	0.00	0.00	1.17	0.14	0.01	0.15	0.03	2.91	0.111
W-G	1.33	0.00	0.00	1.20	0.11	0.00	0.12	0.07	7.57	0.089
E-MM	1.33	0.00	0.00	1.18	0.13	0.02	0.15	0.01	0.51	0.110
E-NN	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.03	3.27	0.100
E-Y	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.02	2.09	0.102
E-Z	1.33	0.00	0.00	1.20	0.11	0.00	0.12	0.07	7.54	0.088
OS-1	1.33	0.00	0.00	1.28	0.04	0.00	0.04	0.01	1.25	0.034
OS-10	1.33	0.00	0.00	1.29	0.03	0.01	0.04	0.00	0.19	0.027
E-OO	1.33	0.00	0.00	1.28	0.03	0.02	0.04	0.00	0.09	0.032
OS-11	1.33	0.00	0.00	1.29	0.03	0.01	0.04	0.00	0.13	0.028
OS-12	1.33	0.00	0.00	1.29	0.03	0.01	0.04	0.00	0.23	0.027
OS-13	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.02	2.68	0.101
OS-14	1.33	0.00	0.00	1.26	0.06	0.01	0.07	0.06	5.97	0.052
OS-2	1.33	0.00	0.00	1.29	0.03	0.01	0.03	0.01	0.99	0.024

TRIPLE H RANCH - 5-yr. Developed Conditions

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Imperv Runoff in	Perv Runoff in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
OS-3	1.33	0.00	0.00	1.28	0.03	0.02	0.04	0.00	0.24	0.032
OS-4	1.33	0.00	0.00	1.26	0.06	0.00	0.06	0.90	95.82	0.048
OS-5	1.33	0.00	0.00	1.30	0.03	0.00	0.03	0.08	8.40	0.020
OS-6	1.33	0.00	0.00	1.29	0.03	0.01	0.04	0.00	0.32	0.027
OS-7	1.33	0.00	0.00	1.30	0.03	0.00	0.03	0.02	1.52	0.022
OS-8	1.33	0.00	0.00	1.28	0.03	0.02	0.05	0.00	0.18	0.034
OS-9	1.33	0.00	0.00	1.29	0.03	0.01	0.03	0.01	0.51	0.026
TANK-SITE	1.33	0.00	0.00	0.65	0.63	0.01	0.64	0.03	3.70	0.485
W-A	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.03	3.55	0.101
W-B	1.33	0.00	0.00	1.19	0.13	0.01	0.14	0.04	3.94	0.102
W-C	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.13	14.64	0.098
W-D	1.33	0.00	0.00	1.19	0.13	0.00	0.13	0.05	6.01	0.098
W-E	1.33	0.00	0.00	1.20	0.11	0.01	0.12	0.04	3.90	0.093
W-F	1.33	0.00	0.00	1.17	0.13	0.02	0.15	0.00	0.43	0.111
E-T2	1.33	0.00	0.00	1.19	0.13	0.01	0.13	0.04	4.21	0.100

TRIPLE H RANCH - 5-yr. Developed Conditions

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-1	JUNCTION	3.55	3.55	0	00:45	0.0329	0.0329	0.000
JW3	JUNCTION	1.25	69.33	0	00:55	0.0121	0.951	0.000
J-W3	JUNCTION	0.00	3.49	0	00:45	0	0.0329	0.000
DP-3	JUNCTION	14.64	18.16	0	00:45	0.132	0.169	0.000
DP-2	JUNCTION	3.94	3.94	0	00:45	0.0369	0.0369	0.000
JW2	JUNCTION	0.99	83.29	0	00:50	0.0109	0.922	0.000
DP-6	JUNCTION	0.75	0.75	0	00:45	0.00723	0.00723	0.000
J23	JUNCTION	11.19	12.37	0	00:45	0.101	0.132	0.000
DP-15	JUNCTION	11.39	23.04	0	00:47	0.103	0.292	0.000
DP-10	JUNCTION	3.86	3.86	0	00:45	0.0355	0.0355	0.000
JW1	JUNCTION	0.24	87.94	0	00:47	0.00358	0.908	0.000
DP-16	JUNCTION	95.82	95.82	0	00:45	0.903	0.903	0.000
DP-11	JUNCTION	3.49	3.49	0	00:45	0.0316	0.0316	0.000
J29	JUNCTION	0.00	0.73	0	00:46	0	0.00721	0.000
J30	JUNCTION	0.00	5.26	0	00:46	0	0.067	0.000
J31	JUNCTION	0.00	25.02	0	00:48	0	0.333	0.000
DP-7	JUNCTION	2.47	2.93	0	00:45	0.0232	0.0305	0.000
J33	JUNCTION	0.00	2.71	0	00:48	0	0.0305	0.000
DP-23	JUNCTION	5.92	5.92	0	00:45	0.0537	0.0537	0.000
J35	JUNCTION	0.00	0.00	0	00:00	0	0	0.000
J36	JUNCTION	0.00	0.00	0	00:00	0	0	0.000
J38	JUNCTION	0.00	3.42	0	00:46	0	0.0315	0.000
J39	JUNCTION	0.00	3.19	0	00:47	0	0.0316	0.000
J40	JUNCTION	0.00	3.09	0	00:49	0	0.0316	0.000

TRIPLE H RANCH - 5-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-12	JUNCTION	8.40	8.40	0	00:45	0.0778	0.0778	0.000
DP-13	JUNCTION	4.82	11.90	0	00:46	0.0436	0.122	0.000
J43	JUNCTION	0.00	11.86	0	00:46	0	0.121	0.000
J44	JUNCTION	0.00	11.83	0	00:46	0	0.132	0.000
J45	JUNCTION	0.00	24.85	0	00:49	0	0.333	0.000
DP-9	JUNCTION	0.87	0.87	0	00:45	0.00821	0.00821	0.000
J47	JUNCTION	0.00	0.85	0	00:46	0	0.00819	0.000
DP-8	JUNCTION	0.00	10.75	0	00:50	0	0.132	0.000
J49	JUNCTION	0.00	33.80	0	00:51	0	0.466	0.000
J50	JUNCTION	3.70	3.70	0	00:45	0.0332	0.0332	0.000
J51	JUNCTION	0.00	3.43	0	00:47	0	0.0332	-0.000
DP-14	JUNCTION	0.87	3.44	0	00:51	0.00816	0.0415	0.000
J53	JUNCTION	0.00	3.43	0	00:51	0	0.0414	0.000
DP-18	JUNCTION	0.32	0.32	0	00:45	0.00384	0.00384	0.000
DP-21	JUNCTION	0.00	5.78	0	00:48	0	0.0613	0.000
J56	JUNCTION	0.00	5.78	0	00:48	0	0.0612	-0.000
DP-22	JUNCTION	11.87	14.00	0	00:45	0.107	0.191	0.000
J58	JUNCTION	0.00	13.76	0	00:46	0	0.19	0.000
DP-20	JUNCTION	0.18	0.18	0	00:45	0.00284	0.00284	0.000
J61	JUNCTION	0.00	0.17	0	01:01	0	0.00285	0.000
J62	JUNCTION	6.44	6.48	0	00:45	0.0584	0.0613	0.000
DP-36	JUNCTION	5.97	6.10	0	00:45	0.0565	0.0618	0.000
J64	JUNCTION	0.51	0.51	0	00:45	0.00518	0.00518	0.000
DP-42	JUNCTION	19.84	22.43	0	00:45	0.179	0.256	0.000
DP-44	JUNCTION	7.79	30.37	0	00:48	0.0708	0.387	0.000

TRIPLE H RANCH - 5-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-27	JUNCTION	20.10	27.09	0	00:45	0.182	0.373	0.000
DP-35	JUNCTION	2.09	2.09	0	00:45	0.0194	0.0194	0.000
DP-31	JUNCTION	2.68	78.75	0	00:47	0.0247	1.4	0.000
DP-33	JUNCTION	6.61	9.42	0	00:45	0.0605	0.099	0.000
DP-37	JUNCTION	3.27	8.22	0	00:46	0.0301	0.0919	0.000
DP-28	JUNCTION	25.21	31.09	0	01:02	0.229	0.71	0.000
DP-19	JUNCTION	1.52	1.52	0	00:45	0.0156	0.0156	0.000
J74	JUNCTION	0.00	1.68	0	00:47	0	0.0194	0.000
J75	JUNCTION	0.00	5.98	0	00:46	0	0.0565	0.000
J76	JUNCTION	1.96	6.23	0	00:48	0.0183	0.0751	0.000
DP-24	JUNCTION	0.27	0.27	0	00:45	0.0028	0.0028	0.000
J78	JUNCTION	0.00	0.26	0	00:46	0	0.0028	0.000
DP-25	JUNCTION	8.85	13.85	0	00:45	0.0801	0.164	0.000
J80	JUNCTION	7.44	21.11	0	00:45	0.0673	0.234	0.000
J81	JUNCTION	0.00	76.47	0	00:46	0	1.35	0.000
DP-26	JUNCTION	0.23	0.23	0	00:45	0.00285	0.00285	0.000
DP-30	JUNCTION	2.96	77.44	0	00:46	0.0273	1.38	0.000
J82	JUNCTION	0.00	27.05	0	00:46	0	0.372	0.000
DP-29	JUNCTION	3.84	30.67	0	00:46	0.0348	0.407	0.000
DP-32	JUNCTION	4.21	4.21	0	00:45	0.0384	0.0384	0.000
DP-34	JUNCTION	8.88	88.41	0	00:49	0.0814	1.58	0.000
POND1-E-OUTFALL	JUNCTION	0.00	89.14	0	00:50	0	1.6	0.000
J84	JUNCTION	0.00	9.40	0	00:46	0	0.0988	0.000
DP-38	JUNCTION	0.51	0.51	0	00:45	0.00612	0.00612	-0.000
DP-40	JUNCTION	0.19	0.19	0	00:45	0.00235	0.00235	0.000

TRIPLE H RANCH - 5-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-39	JUNCTION	7.51	7.62	0	00:45	0.068	0.0742	0.000
J86	JUNCTION	0.00	7.49	0	00:45	0	0.0741	0.000
DP-41	JUNCTION	0.00	7.32	0	00:47	0	0.0765	0.000
J88	JUNCTION	0.00	7.33	0	00:47	0	0.0764	0.000
J89	JUNCTION	0.00	22.06	0	00:45	0	0.256	0.000
DP-43	JUNCTION	6.62	6.62	0	00:45	0.0599	0.0599	0.000
J91	JUNCTION	0.00	6.52	0	00:45	0	0.0598	0.000
J92	JUNCTION	0.00	30.27	0	00:48	0	0.387	0.000
J93	JUNCTION	6.72	6.72	0	00:45	0.0612	0.0612	0.000
J94	JUNCTION	0.00	5.67	0	00:49	0	0.0614	0.000
DP-46	JUNCTION	9.42	32.26	0	00:51	0.0853	0.473	0.000
J96	JUNCTION	0.00	32.28	0	00:51	0	0.472	0.000
J97	JUNCTION	8.12	9.44	0	00:45	0.0737	0.137	0.000
DP-48	JUNCTION	6.17	41.54	0	00:54	0.0561	0.665	0.000
DP-47	JUNCTION	0.00	8.18	0	00:55	0	0.137	0.000
POND1-E-OUTFALL	JUNCTION	0.00	41.33	0	00:55	0	0.663	0.000
POND1-E-OUTFALL	JUNCTION	0.00	8.21	0	00:47	0	0.0919	0.000
DP-45	JUNCTION	0.13	0.13	0	00:45	0.00169	0.00169	0.000
CREEK-OUTFALL	OUTFALL	8.00	8.00	0	00:45	0.0732	0.0732	0.000
POND2-WEST	OUTFALL	3.90	3.90	0	00:45	0.0368	0.0368	0.000
POND1-EAST	OUTFALL	7.54	130.89	0	00:52	0.0682	2.42	0.000
Out11	OUTFALL	6.08	6.08	0	00:45	0.0552	0.0552	0.000
Out13	OUTFALL	1.20	1.20	0	00:45	0.0114	0.0114	0.000
Out14	OUTFALL	1.80	1.80	0	00:45	0.017	0.017	0.000
Out15	OUTFALL	1.10	1.10	0	00:45	0.0108	0.0108	0.000

TRIPLE H RANCH - 5-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
Out16	OUTFALL	0.09	0.09	0	00:45	0.00139	0.00139	0.000
DP-4-POND1-WEST	OUTFALL	6.01	23.92	0	00:46	0.0543	0.258	0.000
DP-17-CREEK	OUTFALL	0.00	65.08	0	01:00	0	0.953	0.000

TRIPLE H RANCH - 5-yr. Developed Conditions

Outfall Loading Summary

Outfall Node	Flow Frequency %	Average Flow CFS	Maximum Flow CFS	Total Volume 10 ⁶ gal
CREEK-OUTFALL-2	55.69	0.81	8.00	0.073
POND2-WEST	43.47	0.52	3.90	0.037
POND1-EAST	98.47	15.22	130.89	2.421
Out11	54.44	0.63	6.08	0.055
Out13	38.75	0.18	1.20	0.011
Out14	40.28	0.26	1.80	0.017
Out15	37.50	0.18	1.10	0.011
Out16	33.33	0.03	0.09	0.001
DP-4-POND1-WEST	98.47	1.62	23.92	0.258
DP-17-CREEK-OUTFALL-1	89.31	6.61	65.08	0.953

TRIPLE H RANCH - 100-yr. Developed Conditions

Analysis Options

Flow Units CFS
 Process Models:
 Rainfall/Runoff YES
 RDII NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed NO
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method KINWAVE
 Starting Date 08/22/2025 00:00:00
 Ending Date 08/22/2025 06:00:00
 Antecedent Dry Days 0.0
 Report Time Step 00:15:00
 Wet Time Step 00:05:00
 Dry Time Step 01:00:00
 Routing Time Step 30.00 sec

*****	Volume	Depth
Runoff Quantity Continuity	acre-feet	inches
*****	-----	-----
Total Precipitation	339.240	2.751
Evaporation Loss	0.000	0.000
Infiltration Loss	250.641	2.033
Surface Runoff	88.462	0.717
Final Storage	0.671	0.005
Continuity Error (%)	-0.157	

*****	Volume	Volume
Flow Routing Continuity	acre-feet	10^6 gal
*****	-----	-----
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	88.462	28.827
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	82.454	26.869
Flooding Loss	6.229	2.030
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.000	0.000
Final Stored Volume	0.057	0.018

Continuity Error (%) -0.314

 Highest Flow Instability Indexes

 Link CE-7 (2)
 Link C103 (2)
 Link CW-1 (1)
 Link CE-10 (1)
 Link J63' (1)

 Routing Time Step Summary

 Minimum Time Step : 30.00 sec
 Average Time Step : 30.00 sec
 Maximum Time Step : 30.00 sec
 % of Time in Steady State : 0.00
 Average Iterations per Step : 1.63
 % of Steps Not Converging : 0.00

 Subcatchment Runoff Summary

Imperv		Perv		Total	Total	Total	Total
Runoff	Runoff	Total	Total	Peak	Runoff		
Subcatchment	Subcatchment	Precip	Runon	Runoff	Evap		Infil
in	in	in	in	in	in	Coeff	in
		in	10^6 gal	in	in		
				in	in		
				in	in		
E-A		2.75	0.00	0.00			1.80
0.27	0.68	0.95	0.23	11.41	0.347		
E-AA		2.75	0.00	0.00			1.82
0.27	0.66	0.93	0.48	23.83	0.338		
E-B		2.75	0.00	0.00			1.80
0.27	0.68	0.95	0.32	15.60	0.344		
E-BB		2.75	0.00	0.00			1.80
0.30	0.65	0.95	1.19	60.86	0.345		
E-C		2.75	0.00	0.00			1.67
0.27	0.81	1.08	0.29	15.56	0.392		
E-CC		2.75	0.00	0.00			1.82
0.27	0.66	0.93	0.43	21.06	0.339		
E-D		2.75	0.00	0.00			1.76
0.27	0.72	0.99	0.78	39.34	0.361		
E-DD		2.75	0.00	0.00			1.95
0.27	0.52	0.79	0.38	18.65	0.289		

E-E			2.75	0.00	0.00	1.83
0.27	0.65	0.92	0.72	35.17	0.335	
E-EE			2.75	0.00	0.00	1.74
0.27	0.74	1.01	0.54	27.59	0.367	
E-F			2.75	0.00	0.00	1.54
0.27	0.95	1.22	0.06	4.47	0.444	
E-FF			2.75	0.00	0.00	1.59
0.22	0.95	1.17	0.11	7.15	0.424	
E-G			2.75	0.00	0.00	1.56
0.30	0.90	1.20	0.19	12.08	0.435	
E-GG			2.75	0.00	0.00	1.78
0.27	0.70	0.97	0.63	31.35	0.351	
E-H			2.75	0.00	0.00	1.58
0.27	0.91	1.18	0.07	4.48	0.428	
E-HH			2.75	0.00	0.00	1.92
0.27	0.56	0.83	0.47	23.27	0.303	
E-I			2.75	0.00	0.00	1.72
0.30	0.74	1.03	0.38	20.33	0.376	
E-II			2.75	0.00	0.00	1.75
0.27	0.74	1.00	0.43	21.75	0.365	
E-J			2.75	0.00	0.00	1.45
0.27	1.05	1.32	0.02	2.50	0.480	
E-JJ			2.75	0.00	0.00	1.65
0.22	0.89	1.10	0.11	6.34	0.401	
E-K			2.75	0.00	0.00	1.82
0.16	0.77	0.93	0.21	9.02	0.339	
E-KK			2.75	0.00	0.00	1.77
0.27	0.71	0.97	0.41	20.49	0.354	
E-L			2.75	0.00	0.00	1.86
0.24	0.65	0.89	0.61	28.46	0.324	
E-LL			2.75	0.00	0.00	1.67
0.22	0.87	1.08	0.17	9.04	0.394	
E-M			2.75	0.00	0.00	1.82
0.27	0.66	0.93	0.48	23.57	0.338	
E-N			2.75	0.00	0.00	1.59
0.27	0.89	1.16	0.07	4.25	0.422	
E-O			2.75	0.00	0.00	1.77
0.27	0.71	0.98	0.43	21.74	0.355	
E-P			2.75	0.00	0.00	1.88
0.27	0.60	0.87	0.72	35.29	0.317	
E-Q			2.75	0.00	0.00	1.83
0.27	0.65	0.92	0.62	30.42	0.335	
E-R			2.75	0.00	0.00	1.92
0.27	0.56	0.83	1.47	71.91	0.301	
E-S			2.75	0.00	0.00	1.78
0.27	0.70	0.97	0.70	34.68	0.352	
E-T1			2.75	0.00	0.00	1.79
0.27	0.69	0.96	0.25	12.62	0.348	
E-U			2.75	0.00	0.00	1.72
0.27	0.76	1.03	0.47	24.42	0.376	
E-V			2.75	0.00	0.00	1.65
0.27	0.83	1.10	0.22	12.46	0.400	
E-W			2.75	0.00	0.00	1.73
0.27	0.75	1.02	0.42	21.53	0.370	

E-X			2.75	0.00	0.00	1.60
0.30	0.85	1.15	0.21	12.47	0.418	
W-G			2.75	0.00	0.00	1.80
0.24	0.70	0.95	0.55	26.27	0.344	
E-MM			2.75	0.00	0.00	1.48
0.27	1.02	1.29	0.05	4.03	0.468	
E-NN			2.75	0.00	0.00	1.67
0.27	0.81	1.08	0.24	13.14	0.392	
E-Y			2.75	0.00	0.00	1.63
0.27	0.85	1.12	0.16	9.25	0.408	
E-Z			2.75	0.00	0.00	1.86
0.24	0.64	0.88	0.51	24.08	0.321	
OS-1			2.75	0.00	0.00	1.94
0.09	0.73	0.81	0.22	8.25	0.295	
OS-10			2.75	0.00	0.00	1.75
0.05	0.96	1.01	0.07	3.64	0.368	
E-OO			2.75	0.00	0.00	1.65
0.05	1.06	1.11	0.04	2.59	0.405	
OS-11			2.75	0.00	0.00	1.74
0.05	0.97	1.03	0.05	2.68	0.373	
OS-12			2.75	0.00	0.00	1.74
0.05	0.96	1.02	0.08	4.43	0.370	
OS-13			2.75	0.00	0.00	1.67
0.27	0.82	1.09	0.20	10.94	0.395	
OS-14			2.75	0.00	0.00	1.85
0.13	0.77	0.90	0.74	30.26	0.329	
OS-2			2.75	0.00	0.00	1.86
0.05	0.84	0.90	0.30	13.70	0.325	
OS-3			2.75	0.00	0.00	1.65
0.05	1.06	1.11	0.09	6.69	0.405	
OS-4			2.75	0.00	0.00	2.37
0.13	0.25	0.38	5.40	246.13	0.139	
OS-5			2.75	0.00	0.00	2.26
0.05	0.43	0.49	1.41	38.26	0.178	
OS-6			2.75	0.00	0.00	1.76
0.05	0.94	1.00	0.11	5.82	0.363	
OS-7			2.75	0.00	0.00	1.98
0.05	0.72	0.78	0.41	15.24	0.282	
OS-8			2.75	0.00	0.00	1.63
0.05	1.09	1.14	0.07	5.51	0.415	
OS-9			2.75	0.00	0.00	1.78
0.05	0.93	0.98	0.17	9.02	0.357	
TANK-SITE			2.75	0.00	0.00	0.82
1.35	0.57	1.92	0.10	10.33	0.696	
W-A			2.75	0.00	0.00	1.64
0.27	0.85	1.12	0.27	15.53	0.406	
W-B			2.75	0.00	0.00	1.61
0.27	0.88	1.15	0.31	18.58	0.417	
W-C			2.75	0.00	0.00	1.85
0.27	0.63	0.90	0.92	44.90	0.328	
W-D			2.75	0.00	0.00	1.85
0.27	0.63	0.90	0.37	18.30	0.325	
W-E			2.75	0.00	0.00	1.63
0.24	0.89	1.13	0.34	19.59	0.410	

W-F			2.75	0.00	0.00	1.47
0.27	1.02	1.29	0.04	3.51	0.470	
E-T2			2.75	0.00	0.00	1.72
0.27	0.77	1.04	0.30	15.61	0.376	

Node Depth Summary

Reported Max Depth Node Feet	Type	Average Depth Feet	Maximum Depth Feet	Maximum HGL Feet	Time of Max Occurrence days hr:min
1.19	JUNCTION	0.22	1.24	6450.24	0 00:45
1.83	JUNCTION	0.55	2.04	6484.04	0 00:53
1.21	JUNCTION	0.27	1.25	6449.25	0 00:46
2.14	JUNCTION	0.42	2.27	6435.27	0 00:46
1.27	JUNCTION	0.22	1.33	6437.33	0 00:45
1.70	JUNCTION	0.54	2.16	6491.16	0 00:49
0.71	JUNCTION	0.11	0.74	6473.74	0 00:45
1.37	JUNCTION	0.33	1.44	6453.44	0 00:49
1.70	JUNCTION	0.55	1.74	6453.74	0 00:51
1.29	JUNCTION	0.24	1.34	6476.34	0 00:45
1.82	JUNCTION	0.50	2.07	6495.07	0 00:47
2.03	JUNCTION	0.49	2.09	6499.09	0 00:45
0.57	JUNCTION	0.13	0.59	6486.09	0 00:45
0.70	JUNCTION	0.12	0.74	6472.74	0 00:46
1.27	JUNCTION	0.31	1.34	6475.34	0 00:46
1.85	JUNCTION	0.51	1.91	6452.91	0 00:52
1.04	JUNCTION	0.22	1.09	6461.09	0 00:47

J33	JUNCTION	0.24	1.15	6460.15	0	00:49
1.07						
DP-23	JUNCTION	0.29	1.22	6454.22	0	00:45
1.19						
J35	JUNCTION	0.00	0.00	6480.00	0	00:00
0.00						
J36	JUNCTION	0.00	0.00	6479.00	0	00:00
0.00						
J38	JUNCTION	0.27	1.07	6485.57	0	00:46
1.04						
J39	JUNCTION	0.27	1.05	6482.05	0	00:48
0.95						
J40	JUNCTION	0.25	0.95	6480.95	0	00:49
0.86						
DP-12	JUNCTION	0.44	1.24	6501.24	0	01:10
1.22						
DP-13	JUNCTION	0.54	1.81	6495.81	0	00:47
1.79						
J43	JUNCTION	0.56	1.81	6494.81	0	00:48
1.79						
J44	JUNCTION	0.34	1.52	6452.52	0	00:50
1.46						
J45	JUNCTION	0.50	1.91	6451.91	0	00:53
1.86						
DP-9	JUNCTION	0.12	0.74	6449.74	0	00:45
0.71						
J47	JUNCTION	0.14	0.74	6448.74	0	00:46
0.70						
DP-8	JUNCTION	0.36	1.58	6450.58	0	00:55
1.55						
J49	JUNCTION	0.49	1.91	6449.91	0	00:55
1.89						
J50	JUNCTION	0.23	1.33	6505.33	0	00:45
1.30						
J51	JUNCTION	0.23	1.29	6504.79	0	00:47
1.19						
DP-14	JUNCTION	0.22	1.18	6501.18	0	00:50
0.91						
J53	JUNCTION	0.20	1.18	6500.18	0	00:50
0.92						
DP-18	JUNCTION	0.12	0.56	6498.56	0	00:55
0.54						
DP-21	JUNCTION	0.45	1.74	6484.74	0	00:50
1.70						
J56	JUNCTION	0.37	1.70	6483.70	0	00:50
1.63						
DP-22	JUNCTION	0.46	1.57	6466.57	0	01:03
1.56						
J58	JUNCTION	0.58	1.76	6465.76	0	01:03
1.75						
DP-20	JUNCTION	0.10	0.58	6500.58	0	00:50
0.56						
J61	JUNCTION	0.15	0.92	6485.92	0	00:52
0.85						

J62	JUNCTION	0.45	1.75	6485.75	0	00:48
1.69						
DP-36	JUNCTION	0.37	1.46	6408.46	0	00:55
1.43						
J64	JUNCTION	0.10	0.60	6442.60	0	00:45
0.58						
DP-42	JUNCTION	0.51	1.75	6446.75	0	00:55
1.71						
DP-44	JUNCTION	0.43	1.77	6432.77	0	00:50
1.74						
DP-27	JUNCTION	0.62	1.94	6440.94	0	01:03
1.93						
DP-35	JUNCTION	0.11	0.61	6394.61	0	00:45
0.59						
DP-31	JUNCTION	0.77	2.28	6419.28	0	00:46
2.27						
DP-33	JUNCTION	0.33	1.48	6415.48	0	00:47
1.36						
DP-37	JUNCTION	0.38	1.46	6399.46	0	00:56
1.44						
DP-28	JUNCTION	0.65	2.27	6427.27	0	01:04
2.20						
DP-19	JUNCTION	0.26	0.95	6493.95	0	00:55
0.95						
J74	JUNCTION	0.29	1.13	6493.13	0	00:57
1.12						
J75	JUNCTION	0.32	1.36	6453.36	0	00:46
1.30						
J76	JUNCTION	0.34	1.30	6444.30	0	00:50
1.23						
DP-24	JUNCTION	0.09	0.56	6459.56	0	00:45
0.54						
J78	JUNCTION	0.08	0.55	6458.55	0	00:46
0.52						
DP-25	JUNCTION	0.42	1.94	6427.94	0	00:49
1.81						
J80	JUNCTION	0.55	1.99	6426.99	0	00:48
1.92						
J81	JUNCTION	0.94	3.50	6427.50	0	00:45
3.50						
DP-26	JUNCTION	0.08	0.39	6458.39	0	00:55
0.38						
DP-30	JUNCTION	0.77	2.28	6421.28	0	00:45
2.27						
J82	JUNCTION	0.54	1.94	6439.94	0	01:03
1.93						
DP-29	JUNCTION	0.60	2.23	6427.23	0	01:03
2.23						
DP-32	JUNCTION	0.31	1.31	6418.31	0	00:45
1.27						
DP-34	JUNCTION	1.00	3.14	6396.14	0	00:50
3.08						
POND1-E-OUTFALL-NW	JUNCTION	1.11	3.14	6391.14	0	00:50
3.08						

J84	JUNCTION	0.36	1.48	6414.48	0	00:47
1.36						
DP-38	JUNCTION	0.18	0.86	6479.86	0	00:55
0.83						
DP-40	JUNCTION	0.11	0.52	6456.52	0	00:55
0.50						
DP-39	JUNCTION	0.42	1.90	6454.90	0	00:56
1.84						
J86	JUNCTION	0.45	1.90	6453.90	0	00:56
1.85						
DP-41	JUNCTION	0.44	1.74	6451.74	0	00:57
1.72						
J88	JUNCTION	0.47	1.74	6450.74	0	00:57
1.72						
J89	JUNCTION	0.41	1.75	6445.75	0	00:56
1.71						
DP-43	JUNCTION	0.32	1.64	6446.64	0	00:45
1.57						
J91	JUNCTION	0.34	1.62	6445.62	0	00:46
1.55						
J92	JUNCTION	0.43	1.77	6431.77	0	00:50
1.74						
J93	JUNCTION	0.32	1.19	6446.19	0	00:45
1.16						
J94	JUNCTION	0.33	1.12	6431.12	0	00:49
0.99						
DP-46	JUNCTION	0.47	1.88	6405.88	0	00:55
1.86						
J96	JUNCTION	0.47	1.88	6404.88	0	00:55
1.86						
J97	JUNCTION	0.50	1.53	6404.53	0	00:52
1.48						
DP-48	JUNCTION	0.99	4.50	6396.50	0	00:51
4.50						
DP-47	JUNCTION	0.51	1.53	6394.53	0	00:56
1.51						
POND1-E-OUTFALL-NE	JUNCTION	1.00	4.50	6392.50	0	00:55
4.50						
POND1-E-OUTFALL-SW	JUNCTION	0.34	1.30	6389.30	0	00:56
1.28						
DP-45	JUNCTION	0.11	0.53	6438.53	0	00:50
0.50						
CREEK-OUTFALL-2	OUTFALL	0.00	0.00	6414.00	0	00:00
0.00						
POND2-WEST	OUTFALL	0.00	0.00	6429.00	0	00:00
0.00						
POND1-EAST	OUTFALL	1.04	2.68	6388.68	0	00:52
2.66						
Out11	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
Out13	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
Out14	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						

Out15	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
Out16	OUTFALL	0.00	0.00	0.00	0	00:00
0.00						
DP-4-POND1-WEST	OUTFALL	0.47	2.27	6433.27	0	00:46
2.08						
DP-17-CREEK-OUTFALL-1	OUTFALL	0.31	1.15	6419.15	0	00:56
1.10						

Node Inflow Summary

Lateral		Total	Flow	Maximum	Maximum	Time of Max	
Inflow	Inflow	Balance	Lateral	Total	Inflow	Occurrence	
Volume	Volume	Error	Inflow	Inflow			
Node	Node	Type	CFS	CFS	days	hr:min	10^6
gal	10^6 gal	Percent					
DP-1		JUNCTION	15.53	15.53	0	00:45	
0.273	0.273	0.000					
JW3		JUNCTION	8.25	221.26	0	00:53	
0.218	6.04	-0.000					
J-W3		JUNCTION	0.00	15.46	0	00:46	
0	0.273	0.000					
DP-3		JUNCTION	44.90	61.43	0	00:46	
0.918	1.23	0.000					
DP-2		JUNCTION	18.58	18.58	0	00:45	
0.311	0.311	0.000					
JW2		JUNCTION	13.70	238.03	0	00:49	
0.304	5.8	0.000					
DP-6		JUNCTION	4.47	4.47	0	00:45	
0.063	0.063	0.000					
J23		JUNCTION	35.17	40.41	0	00:49	
0.716	0.965	0.000					
DP-15		JUNCTION	39.34	99.95	0	00:51	
0.781	3.03	0.000					
DP-10		JUNCTION	15.56	15.56	0	00:45	
0.287	0.287	0.000					
JW1		JUNCTION	6.69	235.40	0	00:47	
0.0937	5.49	0.000					
DP-16		JUNCTION	246.13	246.13	0	00:45	
5.4	5.4	0.000					
DP-11		JUNCTION	11.41	11.41	0	00:45	
0.23	0.23	0.000					
J29		JUNCTION	0.00	4.47	0	00:46	
0	0.0629	0.000					

J30		JUNCTION	0.00	23.45	0	00:50
0	0.517	0.000				
J31		JUNCTION	0.00	111.98	0	00:52
0	3.19	0.000				
DP-7		JUNCTION	12.08	15.27	0	00:47
0.185	0.248	0.000				
J33		JUNCTION	0.00	15.07	0	00:49
0	0.248	0.000				
DP-23		JUNCTION	20.33	20.33	0	00:45
0.385	0.385	0.000				
J35		JUNCTION	0.00	0.00	0	00:00
0	0	0.000 gal				
J36		JUNCTION	0.00	0.00	0	00:00
0	0	0.000 gal				
J38		JUNCTION	0.00	11.32	0	00:46
0	0.23	-0.000				
J39		JUNCTION	0.00	10.61	0	00:48
0	0.23	0.000				
J40		JUNCTION	0.00	10.47	0	00:49
0	0.23	0.000				
DP-12		JUNCTION	38.26	38.26	0	01:10
1.41	1.41	0.000				
DP-13		JUNCTION	15.60	48.12	0	00:47
0.316	1.73	0.000				
J43		JUNCTION	0.00	48.10	0	00:48
0	1.73	0.000				
J44		JUNCTION	0.00	40.33	0	00:50
0	0.965	-0.000				
J45		JUNCTION	0.00	111.90	0	00:53
0	3.19	0.000				
DP-9		JUNCTION	4.48	4.48	0	00:45
0.0704	0.0704	0.000				
J47		JUNCTION	0.00	4.47	0	00:46
0	0.0703	0.000				
DP-8		JUNCTION	0.00	40.13	0	00:55
0	0.966	0.000				
J49		JUNCTION	0.00	151.16	0	00:55
0	4.16	0.000				
J50		JUNCTION	10.33	10.33	0	00:45
0.0988	0.0988	0.000				
J51		JUNCTION	0.00	9.62	0	00:47
0	0.0989	0.000				
DP-14		JUNCTION	4.25	12.44	0	00:50
0.0694	0.168	0.000				
J53		JUNCTION	0.00	12.43	0	00:50
0	0.168	0.000				
DP-18		JUNCTION	5.82	5.82	0	00:55
0.108	0.108	0.000				
DP-21		JUNCTION	0.00	22.20	0	00:50
0	0.506	0.000				
J56		JUNCTION	0.00	22.18	0	00:50
0	0.506	0.000				
DP-22		JUNCTION	35.29	59.47	0	01:03
0.722	1.76	0.000				

J58		JUNCTION	0.00	59.47	0	01:03
0	1.76	0.000				
DP-20		JUNCTION	5.51	5.51	0	00:50
0.0713	0.0713	0.000				
J61		JUNCTION	0.00	5.45	0	00:52
0	0.0714	0.000				
J62		JUNCTION	21.74	22.56	0	00:48
0.435	0.506	0.000				
DP-36		JUNCTION	30.26	33.47	0	00:55
0.744	0.789	0.000				
J64		JUNCTION	4.03	4.03	0	00:45
0.0454	0.0454	0.000				
DP-42		JUNCTION	60.86	69.02	0	00:55
1.19	1.92	0.000				
DP-44		JUNCTION	27.59	106.04	0	00:50
0.542	2.89	0.000				
DP-27		JUNCTION	65.09	101.01	0	01:03
1.32	3.08	0.000				
DP-35		JUNCTION	9.25	9.25	0	00:45
0.161	0.161	0.000				
DP-31		JUNCTION	10.94	235.29	0	00:46
0.2	9.37	0.000				
DP-33		JUNCTION	24.42	36.34	0	00:47
0.471	0.772	0.000				
DP-37		JUNCTION	13.14	43.92	0	00:56
0.243	1.03	0.000				
DP-28		JUNCTION	71.91	183.60	0	01:04
1.47	5.64	0.000				
DP-19		JUNCTION	15.24	15.24	0	00:55
0.407	0.407	0.000				
J74		JUNCTION	0.00	20.91	0	00:57
0	0.515	0.000				
J75		JUNCTION	0.00	21.77	0	00:46
0	0.409	0.000				
J76		JUNCTION	9.02	27.72	0	00:50
0.21	0.619	0.000				
DP-24		JUNCTION	2.50	2.50	0	00:45
0.0244	0.0244	0.000				
J78		JUNCTION	0.00	2.48	0	00:46
0	0.0244	0.000				
DP-25		JUNCTION	28.46	52.22	0	00:49
0.607	1.3	0.000				
J80		JUNCTION	23.57	75.36	0	00:48
0.479	1.86	0.000				
J81		JUNCTION	0.00	357.53	0	01:03
0	10.8	0.000				
DP-26		JUNCTION	4.43	4.43	0	00:55
0.0801	0.0801	0.000				
DP-30		JUNCTION	12.46	225.07	0	00:45
0.224	9.17	-0.000				
J82		JUNCTION	0.00	101.01	0	01:03
0	3.08	0.000				
DP-29		JUNCTION	12.62	109.34	0	01:03
0.255	3.33	0.000				

DP-32		JUNCTION	15.61	15.61	0	00:45
0.301	0.301	0.000				
DP-34		JUNCTION	33.99	295.44	0	00:50
0.629	10.8	0.000				
POND1-E-OUTFALL-NW		JUNCTION	0.00	303.60	0	00:50
0	10.9	0.000				
J84		JUNCTION	0.00	36.29	0	00:47
0	0.772	0.000				
DP-38		JUNCTION	9.02	9.02	0	00:55
0.173	0.173	0.000				
DP-40		JUNCTION	3.64	3.64	0	00:55
0.066	0.066	0.000				
DP-39		JUNCTION	23.83	25.42	0	00:56
0.485	0.659	0.000				
J86		JUNCTION	0.00	25.42	0	00:56
0	0.659	0.000				
DP-41		JUNCTION	0.00	29.01	0	00:57
0	0.725	0.000				
J88		JUNCTION	0.00	29.01	0	00:57
0	0.724	0.000				
J89		JUNCTION	0.00	68.97	0	00:56
0	1.91	0.000				
DP-43		JUNCTION	21.06	21.06	0	00:45
0.428	0.428	0.000				
J91		JUNCTION	0.00	20.83	0	00:46
0	0.428	0.000				
J92		JUNCTION	0.00	106.06	0	00:50
0	2.88	0.000				
J93		JUNCTION	18.65	18.65	0	00:45
0.377	0.377	-0.000				
J94		JUNCTION	0.00	16.03	0	00:49
0	0.378	0.000				
DP-46		JUNCTION	31.35	128.16	0	00:55
0.63	3.51	-0.000				
J96		JUNCTION	0.00	128.15	0	00:55
0	3.51	-0.000				
J97		JUNCTION	23.27	31.90	0	00:52
0.475	0.901	0.000				
DP-48		JUNCTION	21.75	175.75	0	00:56
0.428	4.84	0.000				
DP-47		JUNCTION	0.00	31.38	0	00:56
0	0.902	0.000				
POND1-E-OUTFALL-NE		JUNCTION	0.00	164.30	0	00:54
0	4.71	0.000				
POND1-E-OUTFALL-SW		JUNCTION	0.00	43.90	0	00:56
0	1.03	0.000				
DP-45		JUNCTION	2.68	2.68	0	00:50
0.0473	0.0473	0.000				
CREEK-OUTFALL-2		OUTFALL	29.79	29.79	0	00:45
0.588	0.588	0.000				
POND2-WEST		OUTFALL	19.59	19.59	0	00:45
0.337	0.337	0.000				
POND1-EAST		OUTFALL	24.08	526.55	0	00:55
0.514	17.2	0.000				

Out11		OUTFALL	20.49	20.49	0	00:45
0.41	0.41	0.000				
Out13		OUTFALL	6.34	6.34	0	00:45
0.114	0.114	0.000				
Out14		OUTFALL	9.04	9.04	0	00:45
0.168	0.168	0.000				
Out15		OUTFALL	7.15	7.15	0	00:45
0.111	0.111	0.000				
Out16		OUTFALL	2.59	2.59	0	00:50
0.0363	0.0363	0.000				
DP-4-POND1-WEST		OUTFALL	18.30	79.94	0	00:46
0.374	1.88	0.000				
DP-17-CREEK-OUTFALL-1		OUTFALL	0.00	214.23	0	00:56
0	6.04	0.000				

Node Flooding Summary

Flooding refers to all water that overflows a node, whether it ponds or not.

Maximum Pounded Volume Node ft ³	Hours Flooded	Maximum Rate CFS	Time of Max Occurrence days hr:min	Total Flood Volume 10 ⁶ gal 1000
J81	0.83	144.92	0 01:03	1.879
0.000				
DP-48	0.38	23.80	0 00:56	0.151
0.000				

Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow CFS	Max Flow CFS	Total Volume 10 ⁶ gal
CREEK-OUTFALL-2	56.39	6.46	29.79	0.588
POND2-WEST	43.89	4.75	19.59	0.337
POND1-EAST	98.47	108.01	526.55	17.184
Out11	55.14	4.61	20.49	0.410
Out13	39.17	1.80	6.34	0.114

Out14	40.83	2.54	9.04	0.168
Out15	37.92	1.81	7.15	0.111
Out16	34.17	0.66	2.59	0.036
DP-4-POND1-WEST	98.47	11.81	79.94	1.878
DP-17-CREEK-OUTFALL-1	92.50	40.42	214.23	6.040

System	59.69	182.85	884.62	26.867

Link Flow Summary

Max/ Full Link Depth	Type	Maximum Flow CFS	Time of Max Occurrence days hr:min	Maximum Veloc ft/sec	Max/ Full Flow	

0.49	CW-1	15.46	0 00:46	6.40	0.49	
0.56	LW-2	11.79	0 01:02	3.58	0.22	
0.37	CE-1	4.47	0 00:46	4.22	0.29	
0.53	CE-4	15.50	0 00:46	5.80	0.56	
0.31	LE-2	4.15	0 00:50	2.70	0.04	
0.00	C25	0.00	0 00:00	0.00	0.00	
0.57	C26	23.19	0 00:53	4.57	0.22	
0.00	C27	0.00	0 00:00	0.00	0.00	
0.54	CE-2	15.07	0 00:49	1.72	0.20	
0.20	CE-5	11.32	0 00:46	3.88	0.08	
0.52	C32	10.61	0 00:48	2.50	0.18	
0.48	C33	10.47	0 00:49	1.91	0.18	
0.46	C34	10.26	0 00:51	3.05	0.13	
0.62	C35	38.21	0 01:11	3.35	0.28	
0.72	CE-6	48.10	0 00:48	6.32	0.87	

0.72	C37	CONDUIT	47.65	0	01:12	5.84	0.41
0.50	CE-7	CONDUIT	99.97	0	00:51	7.00	0.49
0.72	LE-4	CONDUIT	40.33	0	00:50	2.62	0.49
0.76	LE-5	CONDUIT	40.13	0	00:55	2.42	0.55
0.63	CE-3	CONDUIT	40.13	0	00:55	6.12	0.73
0.37	CE-9	CONDUIT	4.47	0	00:46	4.22	0.29
0.96	C43	CONDUIT	111.90	0	00:53	3.31	0.92
0.88	C44	CONDUIT	111.04	0	00:55	2.85	0.80
0.64	C45	CONDUIT	9.62	0	00:47	1.50	0.31
0.47	CE-8	CONDUIT	12.43	0	00:50	5.47	0.45
0.52	C47	CONDUIT	8.66	0	00:50	2.17	0.18
0.39	C48	CONDUIT	12.18	0	00:52	5.04	0.08
0.68	CE-10	CONDUIT	22.18	0	00:50	6.25	0.80
0.60	C50	CONDUIT	22.03	0	00:58	3.82	0.26
0.63	CE-11	CONDUIT	59.47	0	01:03	6.11	0.72
0.29	C52	CONDUIT	5.45	0	00:52	2.19	0.04
0.46	C53	CONDUIT	5.42	0	00:53	1.62	0.12
0.87	J63'	CONDUIT	22.20	0	00:50	1.86	0.69
0.54	C55	CONDUIT	19.29	0	01:14	2.59	0.20
0.27	C56	CONDUIT	3.23	0	00:54	2.89	0.03
0.73	C57	CONDUIT	33.32	0	00:56	3.93	0.43
0.88	C61	CONDUIT	59.23	0	01:06	4.86	0.70
0.93	C70	CONDUIT	142.88	0	01:05	4.50	0.86
0.52	CW-3	CONDUIT	18.14	0	00:46	6.99	0.54
0.76	CW-4	CONDUIT	61.49	0	00:46	10.73	0.92
0.57	LE-3	CONDUIT	14.61	0	00:53	2.86	0.22
0.28	C72	CONDUIT	5.82	0	00:56	2.53	0.03

C73	CONDUIT	15.15	0	00:57	1.68	0.14
0.48						
CE-13	CONDUIT	2.48	0	00:46	2.03	0.03
0.28						
C75	CONDUIT	2.28	0	00:49	2.11	0.03
0.26						
CE-12	CONDUIT	20.20	0	00:46	3.43	0.27
0.61						
C77	CONDUIT	19.35	0	00:50	2.95	0.32
0.65						
C78	CONDUIT	3.59	0	01:00	2.95	0.05
0.32						
C79	CONDUIT	27.71	0	00:50	10.83	0.09
0.40						
CE-14	CONDUIT	52.20	0	00:49	6.39	0.95
0.78						
C80	CONDUIT	4.44	0	00:56	2.95	0.01
0.20						
C81	CONDUIT	75.38	0	00:48	4.74	0.99
1.00						
CE-16	CONDUIT	183.56	0	01:04	6.96	0.75
0.65						
C83	CONDUIT	212.61	0	00:45	5.93	1.00
1.00						
C84	CONDUIT	224.69	0	00:46	5.16	0.57
0.76						
CE-15	CONDUIT	101.01	0	01:03	6.96	0.75
0.65						
C86	CONDUIT	101.01	0	01:03	13.45	0.36
0.69						
CE-17	CONDUIT	109.34	0	01:03	6.47	0.90
0.74						
CE-19	CONDUIT	295.54	0	00:50	21.06	0.62
0.57						
CE-20	CONDUIT	9.23	0	00:46	11.35	0.20
0.31						
C89	CONDUIT	14.23	0	00:49	2.30	0.29
0.63						
C90	CONDUIT	34.70	0	00:51	4.37	0.40
0.71						
C91	CONDUIT	232.85	0	00:50	7.03	0.39
0.63						
CE-18	CONDUIT	36.29	0	00:47	5.99	0.66
0.59						
C92	CONDUIT	302.55	0	00:52	3.36	0.35
0.67						
C93	CONDUIT	8.73	0	00:59	4.08	0.10
0.42						
CE-22	CONDUIT	25.42	0	00:56	6.37	0.92
0.76						
C95	CONDUIT	3.64	0	00:56	1.90	0.03
0.26						
CE-23	CONDUIT	29.01	0	00:57	3.97	0.83
0.70						

C97	CONDUIT	25.38	0	00:57	2.79	0.47
0.75						
C98	CONDUIT	28.74	0	01:01	2.50	0.65
0.85						
CE-25	CONDUIT	20.83	0	00:46	6.21	0.76
0.65						
C100	CONDUIT	19.30	0	00:48	3.80	0.23
0.57						
CE-26	CONDUIT	106.06	0	00:50	6.09	0.66
0.59						
C102	CONDUIT	16.03	0	00:49	3.46	0.21
0.56						
C103	CONDUIT	68.67	0	00:58	4.25	0.53
0.74						
CE-24	CONDUIT	68.97	0	00:56	6.29	0.83
0.70						
C105	CONDUIT	105.07	0	00:58	5.62	0.40
0.62						
C106	CONDUIT	14.66	0	00:52	3.82	0.16
0.49						
CE-27	CONDUIT	128.15	0	00:55	6.89	0.71
0.63						
C107	CONDUIT	127.92	0	00:58	4.80	0.66
0.81						
C108	CONDUIT	31.38	0	00:56	3.42	0.49
0.76						
CE-28	CONDUIT	31.39	0	00:56	5.79	0.57
0.54						
CE-29	CONDUIT	164.30	0	00:54	11.20	1.08
1.00						
C110	CONDUIT	43.90	0	00:56	9.87	0.18
0.53						
C111	CONDUIT	164.44	0	00:55	3.30	0.16
0.50						
C112	CONDUIT	43.79	0	00:58	2.09	0.05
0.32						
C113	CONDUIT	2.48	0	01:01	3.61	0.03
0.25						
C1	CONDUIT	228.97	0	00:47	4.21	0.47
0.67						
C2	CONDUIT	225.56	0	00:49	4.13	0.48
0.67						
C3	CONDUIT	213.24	0	00:53	3.89	0.48
0.67						
C4	CONDUIT	214.23	0	00:56	7.72	0.17
0.38						

 Conduit Surcharge Summary

Hours Capacity Conduit Limited	Hours Full			Hours Above Full
	Both Ends	Upstream	Dnstream	Normal Flow
C83 0.83	0.83	0.83	0.83	0.01
CE-29 0.38	0.38	0.38	0.38	0.11

Analysis begun on: Wed May 13 14:23:17 2026
 Analysis ended on: Wed May 13 14:23:17 2026
 Total elapsed time: < 1 sec

TRIPLE H RANCH - 100-yr. Developed Conditions

Subcatchment Runoff Summary

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Imperv Runoff in	Perv Runoff in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
E-A	2.75	0.00	0.00	1.80	0.27	0.68	0.95	0.23	11.41	0.347
E-AA	2.75	0.00	0.00	1.82	0.27	0.66	0.93	0.48	23.83	0.338
E-B	2.75	0.00	0.00	1.80	0.27	0.68	0.95	0.32	15.60	0.344
E-BB	2.75	0.00	0.00	1.80	0.30	0.65	0.95	1.19	60.86	0.345
E-C	2.75	0.00	0.00	1.67	0.27	0.81	1.08	0.29	15.56	0.392
E-CC	2.75	0.00	0.00	1.82	0.27	0.66	0.93	0.43	21.06	0.339
E-D	2.75	0.00	0.00	1.76	0.27	0.72	0.99	0.78	39.34	0.361
E-DD	2.75	0.00	0.00	1.95	0.27	0.52	0.79	0.38	18.65	0.289
E-E	2.75	0.00	0.00	1.83	0.27	0.65	0.92	0.72	35.17	0.335
E-EE	2.75	0.00	0.00	1.74	0.27	0.74	1.01	0.54	27.59	0.367
E-F	2.75	0.00	0.00	1.54	0.27	0.95	1.22	0.06	4.47	0.444
E-FF	2.75	0.00	0.00	1.59	0.22	0.95	1.17	0.11	7.15	0.424
E-G	2.75	0.00	0.00	1.56	0.30	0.90	1.20	0.19	12.08	0.435
E-GG	2.75	0.00	0.00	1.78	0.27	0.70	0.97	0.63	31.35	0.351
E-H	2.75	0.00	0.00	1.58	0.27	0.91	1.18	0.07	4.48	0.428
E-HH	2.75	0.00	0.00	1.92	0.27	0.56	0.83	0.47	23.27	0.303
E-I	2.75	0.00	0.00	1.72	0.30	0.74	1.03	0.38	20.33	0.376
E-II	2.75	0.00	0.00	1.75	0.27	0.74	1.00	0.43	21.75	0.365
E-J	2.75	0.00	0.00	1.45	0.27	1.05	1.32	0.02	2.50	0.480
E-JJ	2.75	0.00	0.00	1.65	0.22	0.89	1.10	0.11	6.34	0.401
E-K	2.75	0.00	0.00	1.82	0.16	0.77	0.93	0.21	9.02	0.339
E-KK	2.75	0.00	0.00	1.77	0.27	0.71	0.97	0.41	20.49	0.354
E-L	2.75	0.00	0.00	1.86	0.24	0.65	0.89	0.61	28.46	0.324
E-LL	2.75	0.00	0.00	1.67	0.22	0.87	1.08	0.17	9.04	0.394

TRIPLE H RANCH - 100-yr. Developed Conditions

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Imperv Runoff in	Perv Runoff in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
E-M	2.75	0.00	0.00	1.82	0.27	0.66	0.93	0.48	23.57	0.338
E-N	2.75	0.00	0.00	1.59	0.27	0.89	1.16	0.07	4.25	0.422
E-O	2.75	0.00	0.00	1.77	0.27	0.71	0.98	0.43	21.74	0.355
E-P	2.75	0.00	0.00	1.88	0.27	0.60	0.87	0.72	35.29	0.317
E-Q	2.75	0.00	0.00	1.83	0.27	0.65	0.92	0.62	30.42	0.335
E-R	2.75	0.00	0.00	1.92	0.27	0.56	0.83	1.47	71.91	0.301
E-S	2.75	0.00	0.00	1.78	0.27	0.70	0.97	0.70	34.68	0.352
E-T1	2.75	0.00	0.00	1.79	0.27	0.69	0.96	0.25	12.62	0.348
E-U	2.75	0.00	0.00	1.72	0.27	0.76	1.03	0.47	24.42	0.376
E-V	2.75	0.00	0.00	1.65	0.27	0.83	1.10	0.22	12.46	0.400
E-W	2.75	0.00	0.00	1.73	0.27	0.75	1.02	0.42	21.53	0.370
E-X	2.75	0.00	0.00	1.60	0.30	0.85	1.15	0.21	12.47	0.418
W-G	2.75	0.00	0.00	1.80	0.24	0.70	0.95	0.55	26.27	0.344
E-MM	2.75	0.00	0.00	1.48	0.27	1.02	1.29	0.05	4.03	0.468
E-NN	2.75	0.00	0.00	1.67	0.27	0.81	1.08	0.24	13.14	0.392
E-Y	2.75	0.00	0.00	1.63	0.27	0.85	1.12	0.16	9.25	0.408
E-Z	2.75	0.00	0.00	1.86	0.24	0.64	0.88	0.51	24.08	0.321
OS-1	2.75	0.00	0.00	1.94	0.09	0.73	0.81	0.22	8.25	0.295
OS-10	2.75	0.00	0.00	1.75	0.05	0.96	1.01	0.07	3.64	0.368
E-OO	2.75	0.00	0.00	1.65	0.05	1.06	1.11	0.04	2.59	0.405
OS-11	2.75	0.00	0.00	1.74	0.05	0.97	1.03	0.05	2.68	0.373
OS-12	2.75	0.00	0.00	1.74	0.05	0.96	1.02	0.08	4.43	0.370
OS-13	2.75	0.00	0.00	1.67	0.27	0.82	1.09	0.20	10.94	0.395
OS-14	2.75	0.00	0.00	1.85	0.13	0.77	0.90	0.74	30.26	0.329
OS-2	2.75	0.00	0.00	1.86	0.05	0.84	0.90	0.30	13.70	0.325

TRIPLE H RANCH - 100-yr. Developed Conditions

Subcatchment	Total Precip in	Total Runon in	Total Evap in	Total Infil in	Imperv Runoff in	Perv Runoff in	Total Runoff in	Total Runoff 10 ⁶ gal	Peak Runoff CFS	Runoff Coeff
OS-3	2.75	0.00	0.00	1.65	0.05	1.06	1.11	0.09	6.69	0.405
OS-4	2.75	0.00	0.00	2.37	0.13	0.25	0.38	5.40	246.13	0.139
OS-5	2.75	0.00	0.00	2.26	0.05	0.43	0.49	1.41	38.26	0.178
OS-6	2.75	0.00	0.00	1.76	0.05	0.94	1.00	0.11	5.82	0.363
OS-7	2.75	0.00	0.00	1.98	0.05	0.72	0.78	0.41	15.24	0.282
OS-8	2.75	0.00	0.00	1.63	0.05	1.09	1.14	0.07	5.51	0.415
OS-9	2.75	0.00	0.00	1.78	0.05	0.93	0.98	0.17	9.02	0.357
TANK-SITE	2.75	0.00	0.00	0.82	1.35	0.57	1.92	0.10	10.33	0.696
W-A	2.75	0.00	0.00	1.64	0.27	0.85	1.12	0.27	15.53	0.406
W-B	2.75	0.00	0.00	1.61	0.27	0.88	1.15	0.31	18.58	0.417
W-C	2.75	0.00	0.00	1.85	0.27	0.63	0.90	0.92	44.90	0.328
W-D	2.75	0.00	0.00	1.85	0.27	0.63	0.90	0.37	18.30	0.325
W-E	2.75	0.00	0.00	1.63	0.24	0.89	1.13	0.34	19.59	0.410
W-F	2.75	0.00	0.00	1.47	0.27	1.02	1.29	0.04	3.51	0.470
E-T2	2.75	0.00	0.00	1.72	0.27	0.77	1.04	0.30	15.61	0.376

TRIPLE H RANCH - 100-yr. Developed Conditions

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-1	JUNCTION	15.53	15.53	0	00:45	0.273	0.273	0.000
JW3	JUNCTION	8.25	221.26	0	00:53	0.218	6.04	-0.000
J-W3	JUNCTION	0.00	15.46	0	00:46	0	0.273	0.000
DP-3	JUNCTION	44.90	61.43	0	00:46	0.918	1.23	0.000
DP-2	JUNCTION	18.58	18.58	0	00:45	0.311	0.311	0.000
JW2	JUNCTION	13.70	238.03	0	00:49	0.304	5.8	0.000
DP-6	JUNCTION	4.47	4.47	0	00:45	0.063	0.063	0.000
J23	JUNCTION	35.17	40.41	0	00:49	0.716	0.965	0.000
DP-15	JUNCTION	39.34	99.95	0	00:51	0.781	3.03	0.000
DP-10	JUNCTION	15.56	15.56	0	00:45	0.287	0.287	0.000
JW1	JUNCTION	6.69	235.40	0	00:47	0.0937	5.49	0.000
DP-16	JUNCTION	246.13	246.13	0	00:45	5.4	5.4	0.000
DP-11	JUNCTION	11.41	11.41	0	00:45	0.23	0.23	0.000
J29	JUNCTION	0.00	4.47	0	00:46	0	0.0629	0.000
J30	JUNCTION	0.00	23.45	0	00:50	0	0.517	0.000
J31	JUNCTION	0.00	111.98	0	00:52	0	3.19	0.000
DP-7	JUNCTION	12.08	15.27	0	00:47	0.185	0.248	0.000
J33	JUNCTION	0.00	15.07	0	00:49	0	0.248	0.000
DP-23	JUNCTION	20.33	20.33	0	00:45	0.385	0.385	0.000
J35	JUNCTION	0.00	0.00	0	00:00	0	0	0.000
J36	JUNCTION	0.00	0.00	0	00:00	0	0	0.000
J38	JUNCTION	0.00	11.32	0	00:46	0	0.23	-0.000
J39	JUNCTION	0.00	10.61	0	00:48	0	0.23	0.000
J40	JUNCTION	0.00	10.47	0	00:49	0	0.23	0.000

TRIPLE H RANCH - 100-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-12	JUNCTION	38.26	38.26	0	01:10	1.41	1.41	0.000
DP-13	JUNCTION	15.60	48.12	0	00:47	0.316	1.73	0.000
J43	JUNCTION	0.00	48.10	0	00:48	0	1.73	0.000
J44	JUNCTION	0.00	40.33	0	00:50	0	0.965	-0.000
J45	JUNCTION	0.00	111.90	0	00:53	0	3.19	0.000
DP-9	JUNCTION	4.48	4.48	0	00:45	0.0704	0.0704	0.000
J47	JUNCTION	0.00	4.47	0	00:46	0	0.0703	0.000
DP-8	JUNCTION	0.00	40.13	0	00:55	0	0.966	0.000
J49	JUNCTION	0.00	151.16	0	00:55	0	4.16	0.000
J50	JUNCTION	10.33	10.33	0	00:45	0.0988	0.0988	0.000
J51	JUNCTION	0.00	9.62	0	00:47	0	0.0989	0.000
DP-14	JUNCTION	4.25	12.44	0	00:50	0.0694	0.168	0.000
J53	JUNCTION	0.00	12.43	0	00:50	0	0.168	0.000
DP-18	JUNCTION	5.82	5.82	0	00:55	0.108	0.108	0.000
DP-21	JUNCTION	0.00	22.20	0	00:50	0	0.506	0.000
J56	JUNCTION	0.00	22.18	0	00:50	0	0.506	0.000
DP-22	JUNCTION	35.29	59.47	0	01:03	0.722	1.76	0.000
J58	JUNCTION	0.00	59.47	0	01:03	0	1.76	0.000
DP-20	JUNCTION	5.51	5.51	0	00:50	0.0713	0.0713	0.000
J61	JUNCTION	0.00	5.45	0	00:52	0	0.0714	0.000
J62	JUNCTION	21.74	22.56	0	00:48	0.435	0.506	0.000
DP-36	JUNCTION	30.26	33.47	0	00:55	0.744	0.789	0.000
J64	JUNCTION	4.03	4.03	0	00:45	0.0454	0.0454	0.000
DP-42	JUNCTION	60.86	69.02	0	00:55	1.19	1.92	0.000
DP-44	JUNCTION	27.59	106.04	0	00:50	0.542	2.89	0.000

TRIPLE H RANCH - 100-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-27	JUNCTION	65.09	101.01	0	01:03	1.32	3.08	0.000
DP-35	JUNCTION	9.25	9.25	0	00:45	0.161	0.161	0.000
DP-31	JUNCTION	10.94	235.29	0	00:46	0.2	9.37	0.000
DP-33	JUNCTION	24.42	36.34	0	00:47	0.471	0.772	0.000
DP-37	JUNCTION	13.14	43.92	0	00:56	0.243	1.03	0.000
DP-28	JUNCTION	71.91	183.60	0	01:04	1.47	5.64	0.000
DP-19	JUNCTION	15.24	15.24	0	00:55	0.407	0.407	0.000
J74	JUNCTION	0.00	20.91	0	00:57	0	0.515	0.000
J75	JUNCTION	0.00	21.77	0	00:46	0	0.409	0.000
J76	JUNCTION	9.02	27.72	0	00:50	0.21	0.619	0.000
DP-24	JUNCTION	2.50	2.50	0	00:45	0.0244	0.0244	0.000
J78	JUNCTION	0.00	2.48	0	00:46	0	0.0244	0.000
DP-25	JUNCTION	28.46	52.22	0	00:49	0.607	1.3	0.000
J80	JUNCTION	23.57	75.36	0	00:48	0.479	1.86	0.000
J81	JUNCTION	0.00	357.53	0	01:03	0	10.8	0.000
DP-26	JUNCTION	4.43	4.43	0	00:55	0.0801	0.0801	0.000
DP-30	JUNCTION	12.46	225.07	0	00:45	0.224	9.17	-0.000
J82	JUNCTION	0.00	101.01	0	01:03	0	3.08	0.000
DP-29	JUNCTION	12.62	109.34	0	01:03	0.255	3.33	0.000
DP-32	JUNCTION	15.61	15.61	0	00:45	0.301	0.301	0.000
DP-34	JUNCTION	33.99	295.44	0	00:50	0.629	10.8	0.000
POND1-E-OUTFALL	JUNCTION	0.00	303.60	0	00:50	0	10.9	0.000
J84	JUNCTION	0.00	36.29	0	00:47	0	0.772	0.000
DP-38	JUNCTION	9.02	9.02	0	00:55	0.173	0.173	0.000
DP-40	JUNCTION	3.64	3.64	0	00:55	0.066	0.066	0.000

TRIPLE H RANCH - 100-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
DP-39	JUNCTION	23.83	25.42	0	00:56	0.485	0.659	0.000
J86	JUNCTION	0.00	25.42	0	00:56	0	0.659	0.000
DP-41	JUNCTION	0.00	29.01	0	00:57	0	0.725	0.000
J88	JUNCTION	0.00	29.01	0	00:57	0	0.724	0.000
J89	JUNCTION	0.00	68.97	0	00:56	0	1.91	0.000
DP-43	JUNCTION	21.06	21.06	0	00:45	0.428	0.428	0.000
J91	JUNCTION	0.00	20.83	0	00:46	0	0.428	0.000
J92	JUNCTION	0.00	106.06	0	00:50	0	2.88	0.000
J93	JUNCTION	18.65	18.65	0	00:45	0.377	0.377	-0.000
J94	JUNCTION	0.00	16.03	0	00:49	0	0.378	0.000
DP-46	JUNCTION	31.35	128.16	0	00:55	0.63	3.51	-0.000
J96	JUNCTION	0.00	128.15	0	00:55	0	3.51	-0.000
J97	JUNCTION	23.27	31.90	0	00:52	0.475	0.901	0.000
DP-48	JUNCTION	21.75	175.75	0	00:56	0.428	4.84	0.000
DP-47	JUNCTION	0.00	31.38	0	00:56	0	0.902	0.000
POND1-E-OUTFALL	JUNCTION	0.00	164.30	0	00:54	0	4.71	0.000
POND1-E-OUTFALL	JUNCTION	0.00	43.90	0	00:56	0	1.03	0.000
DP-45	JUNCTION	2.68	2.68	0	00:50	0.0473	0.0473	0.000
CREEK-OUTFALL	OUTFALL	29.79	29.79	0	00:45	0.588	0.588	0.000
POND2-WEST	OUTFALL	19.59	19.59	0	00:45	0.337	0.337	0.000
POND1-EAST	OUTFALL	24.08	526.55	0	00:55	0.514	17.2	0.000
Out11	OUTFALL	20.49	20.49	0	00:45	0.41	0.41	0.000
Out13	OUTFALL	6.34	6.34	0	00:45	0.114	0.114	0.000
Out14	OUTFALL	9.04	9.04	0	00:45	0.168	0.168	0.000
Out15	OUTFALL	7.15	7.15	0	00:45	0.111	0.111	0.000

TRIPLE H RANCH - 100-yr. Developed Conditions

Node	Type	Maximum Lateral Inflow CFS	Maximum Total Inflow CFS	Day of Maximum Inflow	Hour of Maximum Inflow	Lateral Inflow Volume 10 ⁶ gal	Total Inflow Volume 10 ⁶ gal	Flow Balance Error %
Out16	OUTFALL	2.59	2.59	0	00:50	0.0363	0.0363	0.000
DP-4-POND1-WEST	OUTFALL	18.30	79.94	0	00:46	0.374	1.88	0.000
DP-17-CREEK	OUTFALL	0.00	214.23	0	00:56	0	6.04	0.000

TRIPLE H RANCH - 100-yr. Developed Conditions

Outfall Loading Summary

Outfall Node	Flow Frequency %	Average Flow CFS	Maximum Flow CFS	Total Volume 10 ⁶ gal
CREEK-OUTFALL-2	56.39	6.46	29.79	0.588
POND2-WEST	43.89	4.75	19.59	0.337
POND1-EAST	98.47	108.01	526.55	17.184
Out11	55.14	4.61	20.49	0.410
Out13	39.17	1.80	6.34	0.114
Out14	40.83	2.54	9.04	0.168
Out15	37.92	1.81	7.15	0.111
Out16	34.17	0.66	2.59	0.036
DP-4-POND1-WEST	98.47	11.81	79.94	1.878
DP-17-CREEK-OUTFALL-2	56.39	40.42	214.23	6.040

Diversion Channel

Project Description	
Friction Method	Manning Formula
Solve For	Normal Depth

Input Data	
Roughness Coefficient	0.035
Channel Slope	0.005 ft/ft
Left Side Slope	4.000 H:V
Right Side Slope	4.000 H:V
Bottom Width	20.00 ft
Discharge	220.00 cfs

Results	
Normal Depth	23.8 in
Flow Area	55.4 ft ²
Wetted Perimeter	36.3 ft
Hydraulic Radius	18.3 in
Top Width	35.86 ft
Critical Depth	16.9 in
Critical Slope	0.017 ft/ft
Velocity	3.97 ft/s
Velocity Head	0.25 ft
Specific Energy	2.23 ft
Froude Number	0.564
Flow Type	Subcritical


GVF Input Data	
Downstream Depth	0.0 in
Length	0.0 ft
Number Of Steps	0

GVF Output Data	
Upstream Depth	0.0 in
Profile Description	N/A
Profile Headloss	0.00 ft
Downstream Velocity	0.00 ft/s
Upstream Velocity	0.00 ft/s
Normal Depth	23.8 in
Critical Depth	16.9 in
Channel Slope	0.005 ft/ft
Critical Slope	0.017 ft/ft

Diversion Channel

Project Description	
Friction Method	Manning Formula
Solve For	Normal Depth

Input Data	
Roughness Coefficient	0.035
Channel Slope	0.005 ft/ft
Normal Depth	23.8 in
Left Side Slope	4.000 H:V
Right Side Slope	4.000 H:V
Bottom Width	20.00 ft
Discharge	220.00 cfs

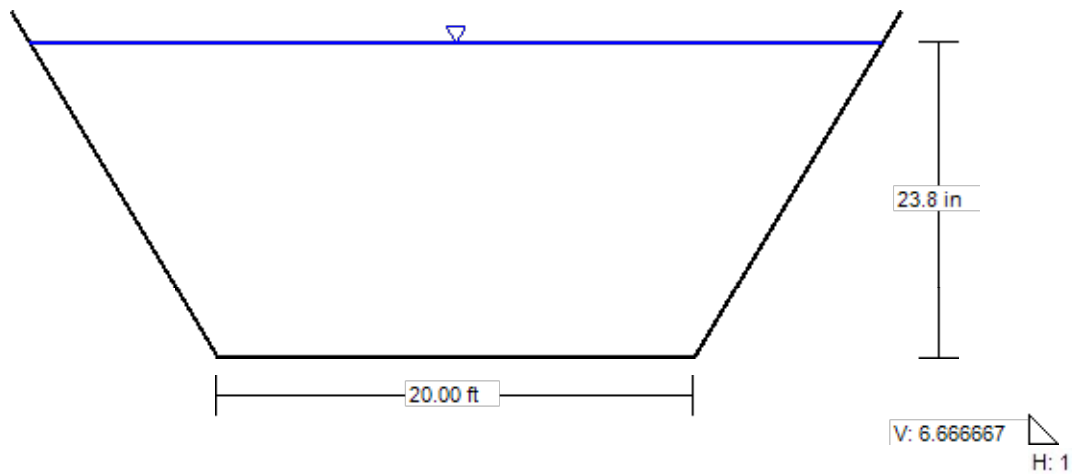


STORMWATER QUALITY CALCULATIONS

EFFECTIVE IMPERVIOUSNESS - POND 1 West

Basin	Acreage	Imp.%
W-A	9.0	10.0%
W-B	10.0	10.0%
W-C	37.5	10.0%
W-D	15.4	10.0%
Total	71.9	10.0%

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.07 (June 2025)

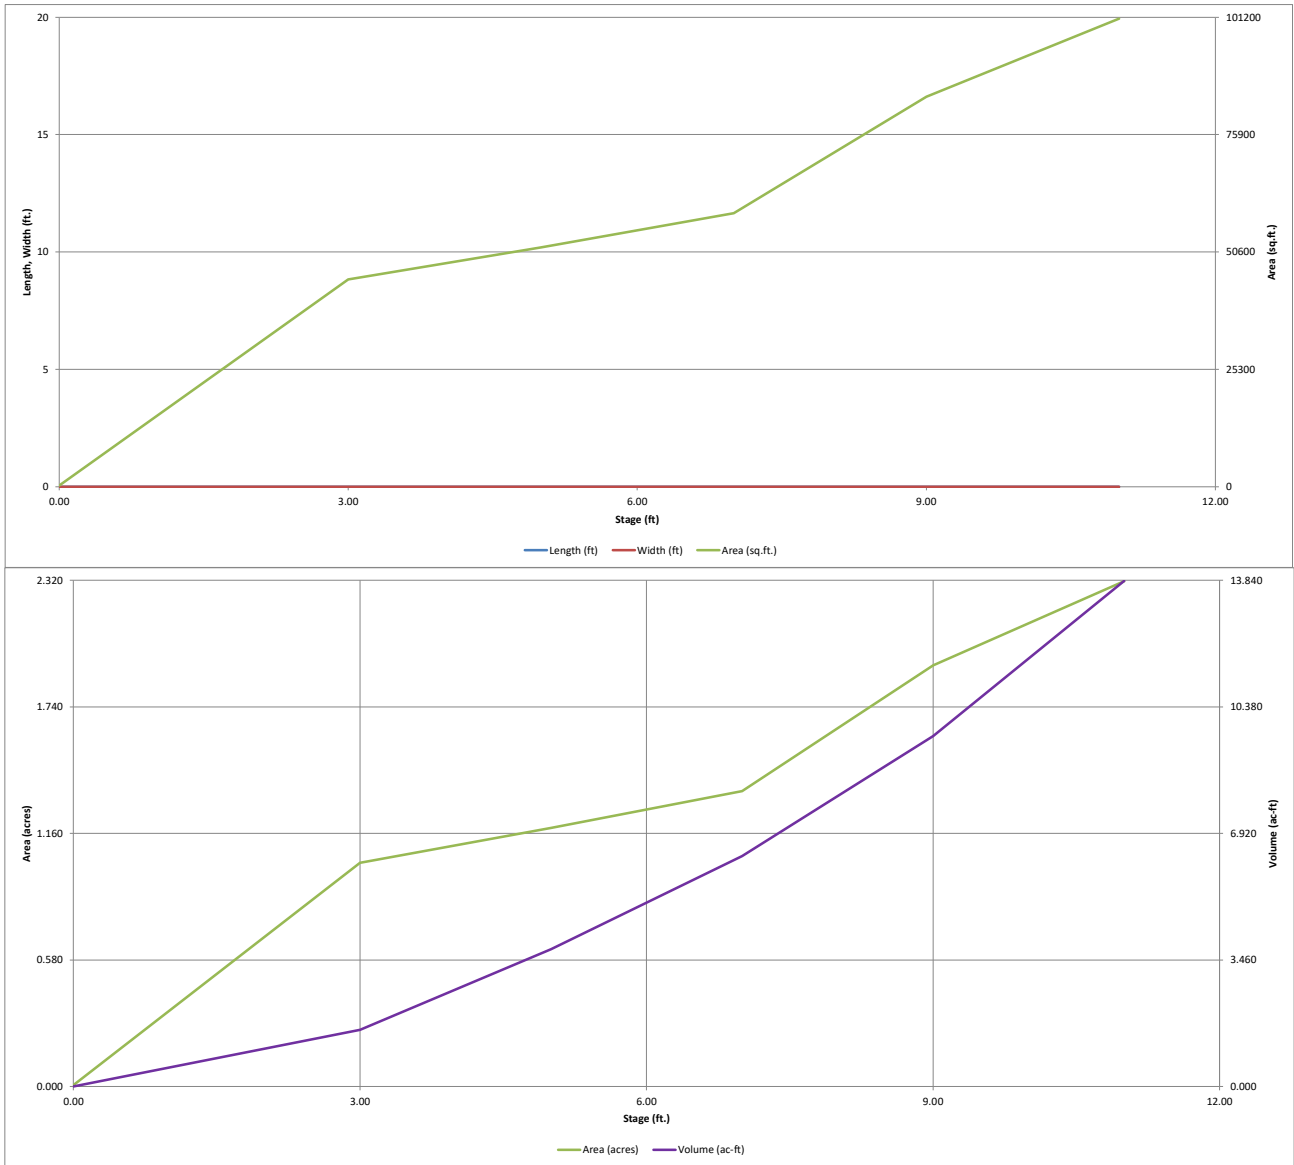


DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.07 (June 2025)

Project: TRIPLE H RANCH PRELIMINARY PLAN - PDR

Basin ID: POND 1 WEST

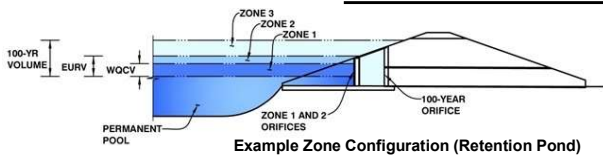

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.52	0.402	Orifice Plate
Zone 2 (EURV)	1.82	0.171	Orifice Plate
Zone 3 (100-year)	3.49	1.480	Weir&Pipe (Restrict)
Total (all zones)		2.053	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration SCM)

Underdrain Orifice Invert Depth =	N/A	ft (distance below the filtration media surface)
Underdrain Orifice Diameter =	N/A	inches

Calculated Parameters for Underdrain

Underdrain Orifice Area =	N/A	ft ²
Underdrain Orifice Centroid =	N/A	feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation SCM)

Centroid of Lowest Orifice =	0.00	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate =	2.00	ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing =	8.00	inches
Orifice Plate: Orifice Area per Row =	N/A	sq. inches

Calculated Parameters for Plate

WQ Orifice Area per Row =	N/A	ft ²
Elliptical Half-Width =	N/A	feet
Elliptical Slot Centroid =	N/A	feet
Elliptical Slot Area =	N/A	ft ²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.70	1.40					
Orifice Area (sq. inches)	2.00	2.84	2.84					
	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected	
Vertical Orifice Area =	N/A	N/A	ft ²
Vertical Orifice Centroid =	N/A	N/A	feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	2.00	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	8.00	N/A	feet
Overflow Weir Grate Slope =	4.00	N/A	H:V
Horiz. Length of Weir Sides =	3.00	N/A	feet
Overflow Grate Type =	Close Mesh Grate	N/A	
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H _u =	2.75	N/A	feet
Overflow Weir Slope Length =	3.09	N/A	feet
Grate Open Area / 100-yr Orifice Area =	3.99	N/A	
Overflow Grate Open Area w/o Debris =	19.57	N/A	ft ²
Overflow Grate Open Area w/ Debris =	9.78	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.50	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	30.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	30.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	4.91	N/A	ft ²
Outlet Orifice Centroid =	1.25	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	3.14	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	5.00	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	25.00	feet
Spillway End Slopes =	3.00	H:V
Freeboard above Max Water Surface =	1.00	feet

Calculated Parameters for Spillway

Spillway Design Flow Depth =	0.82	feet
Stage at Top of Freeboard =	6.82	feet
Basin Area at Top of Freeboard =	1.34	acres
Basin Volume at Top of Freeboard =	6.06	acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	0.96	1.26	1.52	1.92	2.26	2.61	3.54
One-Hour Rainfall Depth (in) =	0.402	0.573	0.196	0.385	0.585	2.531	4.036	6.385	11.618
CUHP Runoff Volume (acre-ft) =	N/A	N/A	0.196	0.385	0.585	2.531	4.036	6.385	11.618
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	0.8	1.8	2.6	22.5	37.1	57.6	103.7
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A							
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.02	0.04	0.31	0.52	0.80	1.44
Peak Inflow Q (cfs) =	N/A	N/A	1.7	3.7	5.4	26.1	40.8	61.5	108.0
Peak Outflow Q (cfs) =	0.2	0.3	0.1	0.2	0.2	10.5	20.6	37.6	70.1
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.1	0.1	0.5	0.6	0.7	0.7
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	0.5	1.0	1.9	2.6
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	49	57	37	50	58	55	47	40	27
Time to Drain 99% of Inflow Volume (hours) =	53	61	39	53	63	67	63	58	48
Maximum Ponding Depth (ft) =	1.52	1.82	0.98	1.41	1.75	2.86	3.30	3.88	5.39
Area at Maximum Ponding Depth (acres) =	0.52	0.63	0.34	0.49	0.60	0.98	1.05	1.10	1.22
Maximum Volume Stored (acre-ft) =	0.403	0.575	0.170	0.347	0.532	1.409	1.850	2.472	4.229

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.07 (June 2025)

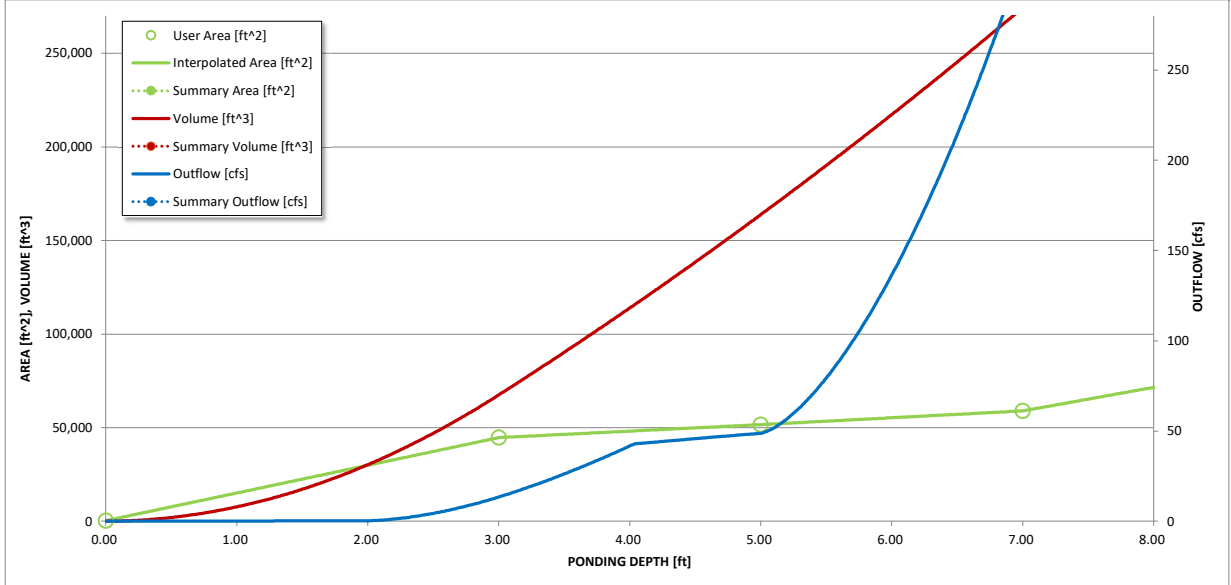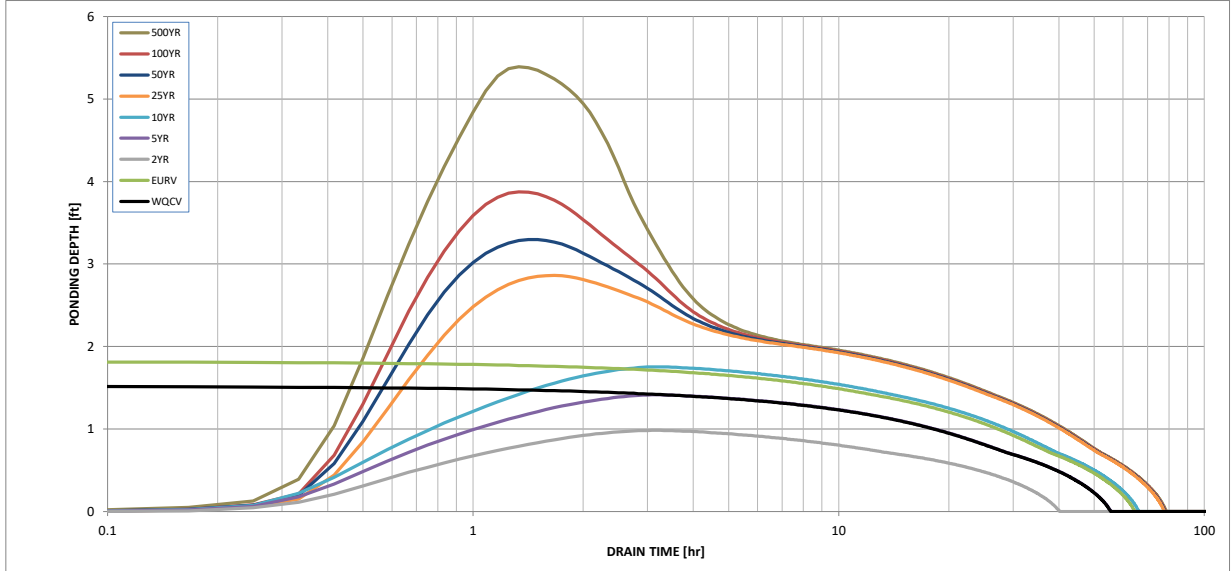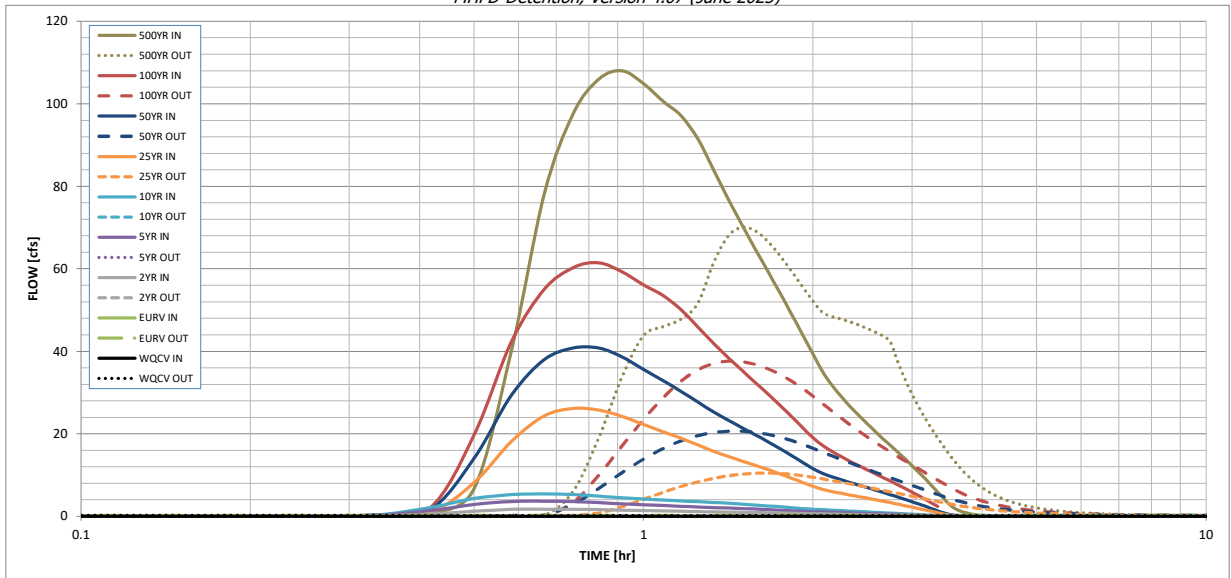

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.


Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.03
	0:15:00	0	0.00	0.03	0.06	0.08	0.06	0.09	0.09	0.17
	0:20:00	0	0.00	0.16	0.24	0.30	0.22	0.29	0.31	0.68
	0:25:00	0	0.00	0.53	1.37	2.13	0.93	1.55	1.96	6.68
	0:30:00	0	0.00	1.23	2.89	4.33	8.18	14.06	19.67	40.50
	0:35:00	0	0.00	1.68	3.60	5.26	18.24	29.48	42.49	78.28
	0:40:00	0	0.00	1.74	3.68	5.41	24.38	38.02	55.05	97.61
	0:45:00	0	0.00	1.71	3.55	5.26	26.12	40.82	60.29	105.98
	0:50:00	0	0.00	1.61	3.30	4.90	25.72	40.77	61.48	108.00
	0:55:00	0	0.00	1.49	3.04	4.51	24.21	38.64	59.26	104.87
	1:00:00	0	0.00	1.40	2.82	4.21	22.24	35.61	56.11	100.61
	1:05:00	0	0.00	1.32	2.62	3.96	20.52	32.90	53.53	97.13
	1:10:00	0	0.00	1.23	2.44	3.73	18.90	30.29	50.11	91.44
	1:15:00	0	0.00	1.15	2.26	3.55	17.27	27.68	45.89	83.95
	1:20:00	0	0.00	1.08	2.12	3.38	15.76	25.29	41.90	76.83
	1:25:00	0	0.00	1.03	2.00	3.17	14.49	23.27	38.42	70.47
	1:30:00	0	0.00	0.97	1.88	2.96	13.38	21.45	35.27	64.61
	1:35:00	0	0.00	0.92	1.76	2.74	12.33	19.72	32.34	59.18
	1:40:00	0	0.00	0.86	1.63	2.52	11.29	18.04	29.57	54.04
	1:45:00	0	0.00	0.81	1.49	2.31	10.28	16.39	26.86	49.05
	1:50:00	0	0.00	0.75	1.36	2.10	9.27	14.76	24.20	44.18
	1:55:00	0	0.00	0.69	1.23	1.90	8.27	13.15	21.60	39.44
	2:00:00	0	0.00	0.64	1.13	1.75	7.29	11.58	19.09	34.98
	2:05:00	0	0.00	0.59	1.06	1.63	6.54	10.42	17.17	31.62
	2:10:00	0	0.00	0.55	0.98	1.51	6.00	9.55	15.70	28.93
	2:15:00	0	0.00	0.51	0.91	1.40	5.56	8.83	14.44	26.56
	2:20:00	0	0.00	0.46	0.83	1.28	5.15	8.17	13.31	24.42
	2:25:00	0	0.00	0.43	0.77	1.18	4.77	7.56	12.26	22.43
	2:30:00	0	0.00	0.39	0.70	1.07	4.39	6.96	11.26	20.57
	2:35:00	0	0.00	0.35	0.64	0.97	4.02	6.38	10.31	18.81
	2:40:00	0	0.00	0.32	0.57	0.88	3.66	5.81	9.41	17.17
	2:45:00	0	0.00	0.29	0.51	0.78	3.31	5.24	8.53	15.55
	2:50:00	0	0.00	0.26	0.45	0.70	2.95	4.68	7.65	13.94
	2:55:00	0	0.00	0.23	0.40	0.61	2.60	4.12	6.77	12.34
	3:00:00	0	0.00	0.20	0.34	0.52	2.25	3.57	5.89	10.73
	3:05:00	0	0.00	0.17	0.28	0.44	1.90	3.01	5.01	9.13
	3:10:00	0	0.00	0.14	0.23	0.36	1.56	2.46	4.14	7.53
	3:15:00	0	0.00	0.11	0.18	0.27	1.21	1.90	3.26	5.94
	3:20:00	0	0.00	0.08	0.12	0.20	0.87	1.35	2.40	4.35
	3:25:00	0	0.00	0.06	0.09	0.14	0.53	0.82	1.55	2.86
	3:30:00	0	0.00	0.05	0.07	0.11	0.29	0.46	0.94	1.84
	3:35:00	0	0.00	0.04	0.06	0.09	0.16	0.27	0.60	1.23
	3:40:00	0	0.00	0.04	0.05	0.08	0.11	0.17	0.39	0.82
	3:45:00	0	0.00	0.03	0.04	0.07	0.08	0.12	0.25	0.54
	3:50:00	0	0.00	0.03	0.04	0.06	0.06	0.08	0.16	0.33
	3:55:00	0	0.00	0.02	0.03	0.04	0.05	0.06	0.09	0.19
	4:00:00	0	0.00	0.02	0.02	0.04	0.03	0.04	0.05	0.10
	4:05:00	0	0.00	0.02	0.02	0.03	0.03	0.03	0.03	0.06
	4:10:00	0	0.00	0.01	0.02	0.02	0.02	0.03	0.02	0.05
	4:15:00	0	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.04
	4:20:00	0	0.00	0.01	0.01	0.01	0.01	0.02	0.01	0.03
	4:25:00	0	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.02
	4:30:00	0	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.02
	4:35:00	0	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01
	4:40:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01
	4:45:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

EFFECTIVE IMPERVIOUSNESS - POND 1 East

Basin	Acreage	Imp. %
OS-4	2.0	2.0%
OS-5	12.0	2.0%
OS-6	4.0	2.0%
OS-7	6.0	2.0%
OS-8	2.3	2.0%
OS-9	6.5	2.0%
OS-10	2.4	2.0%
OS-11	1.7	2.0%
OS-12	2.9	2.0%
OS-13	6.8	11.0%
OS-14	30.3	5.0%
E-A	8.9	2.0%
E-B	12.3	11.0%
E-C	9.8	11.0%
E-D	29.0	11.0%
E-E	28.6	11.0%
E-F	1.9	11.0%
E-G	5.7	11.0%
E-H	2.2	11.0%
E-I	13.7	11.0%
E-J	0.68	11.0%
E-K	8.3	6.0%
E-L	25.1	9.0%
E-M	19.0	11.0%
E-N	2.2	11.0%
E-O	16.4	11.0%
E-P	30.5	11.0%
E-Q	24.8	11.0%
E-R	65.2	11.0%
E-S	26.5	11.0%
E-T1	9.8	11.0%
E-T2	10.7	11.0%
E-U	16.8	11.0%
E-V	7.5	11.0%
E-W	15.2	11.0%
E-X	6.7	11.0%
E-Y	5.3	11.0%
E-Z	21.4	9.0%
E-AA	19.2	11.0%
E-BB	46.2	11.0%
E-CC	16.9	11.0%
E-DD	17.5	11.0%
E-EE	19.8	11.0%
E-GG	24.0	11.0%
E-HH	21.0	11.0%
E-II	15.7	11.0%
E-MM	1.3	11.0%
E-NN	8.3	11.0%
TANK	1.9	50.0%
Total	692.9	10.0%

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.07 (June 2025)

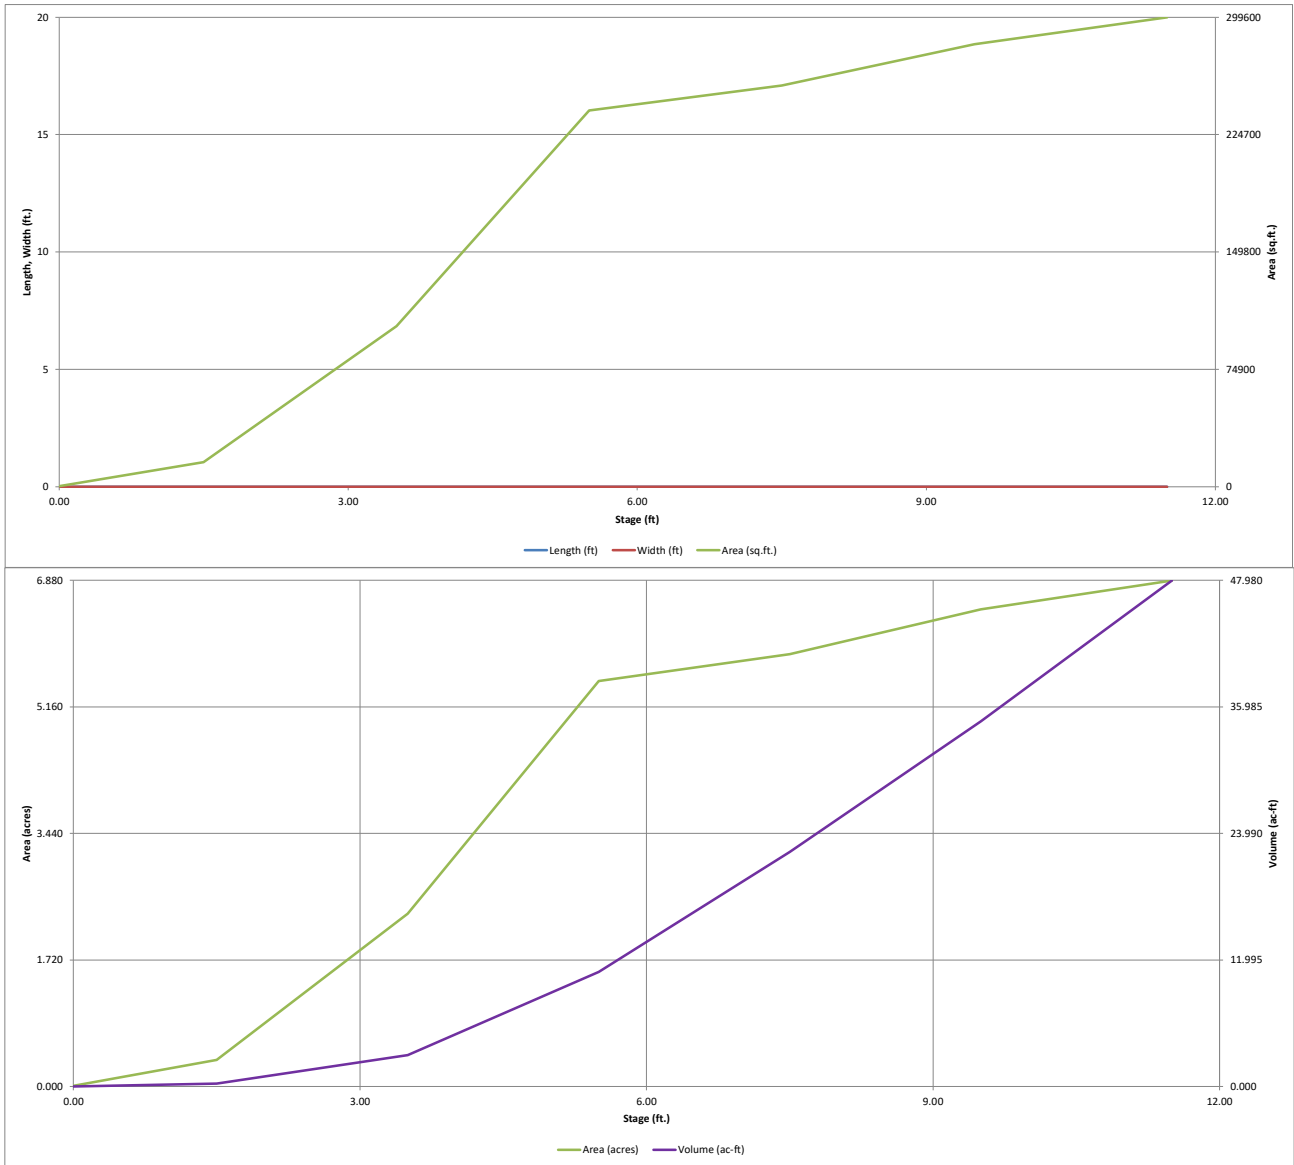


DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.07 (June 2025)

Project: TRIPLE H RANCH PRELIMINARY PLAN - PDR

Basin ID: POND 1 EAST

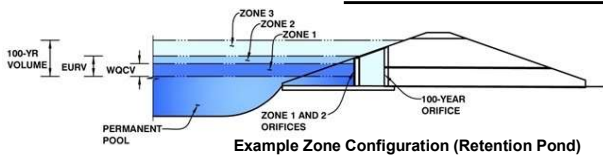

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	3.84	3.869	Orifice Plate
Zone 2 (EURV)	4.34	1.648	Orifice Plate
Zone 3 (100-year)	7.08	14.265	Weir&Pipe (Restrict)
Total (all zones)		19.782	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration SCM)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
 Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain
 Underdrain Orifice Area = ft²
 Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation SCM)

Centroid of Lowest Orifice = 0.00 ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Orifice Plate = 4.50 ft (relative to basin bottom at Stage = 0 ft)
 Orifice Plate: Orifice Vertical Spacing = 10.80 inches
 Orifice Plate: Orifice Area per Row = N/A sq. inches

Calculated Parameters for Plate
 WQ Orifice Area per Row = N/A ft²
 Elliptical Half-Width = N/A feet
 Elliptical Slot Centroid = N/A feet
 Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.90	1.80	2.70	3.60			
Orifice Area (sq. inches)	8.00	9.16	9.16	9.16	9.16			
	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected	
Vertical Orifice Area =	N/A	N/A	ft ²
Vertical Orifice Centroid =	N/A	N/A	feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	4.50	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	24.00	N/A	feet
Overflow Weir Grate Slope =	4.00	N/A	H:V
Horiz. Length of Weir Sides =	4.00	N/A	feet
Overflow Grate Type =	Close Mesh Grate	N/A	
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H _u =	5.50	N/A	feet
Overflow Weir Slope Length =	4.12	N/A	feet
Grate Open Area / 100-yr Orifice Area =	6.54	N/A	
Overflow Grate Open Area w/o Debris =	78.27	N/A	ft ²
Overflow Grate Open Area w/ Debris =	39.14	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.50	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	54.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	38.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	11.96	N/A	ft ²
Outlet Orifice Centroid =	1.77	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	1.99	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = 9.50 ft (relative to basin bottom at Stage = 0 ft)
 Spillway Crest Length = 170.00 feet
 Spillway End Slopes = 3.00 H:V
 Freeboard above Max Water Surface = 1.00 feet

Calculated Parameters for Spillway

Spillway Design Flow Depth =	1.02	feet
Stage at Top of Freeboard =	11.52	feet
Basin Area at Top of Freeboard =	6.88	acres
Basin Volume at Top of Freeboard =	47.96	acre-ft


Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	0.96	1.26	1.52	1.92	2.26	2.61	3.54
One-Hour Rainfall Depth (in) =	3.869	5.517	1.885	3.708	5.637	24.379	38.876	61.505	111.907
CUHP Runoff Volume (acre-ft) =	N/A	N/A	1.885	3.708	5.637	24.379	38.876	61.505	111.907
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	6.6	14.8	22.4	191.0	319.5	500.7	911.8
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A						370.0	
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.02	0.03	0.28	0.46	0.53	1.32
Peak Inflow Q (cfs) =	N/A	N/A	14.8	31.2	46.1	222.0	351.5	535.4	949.4
Peak Outflow Q (cfs) =	2.0	2.3	1.3	1.8	2.2	76.0	139.6	164.5	723.3
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.1	0.1	0.4	0.4	0.4	0.8
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Plate	Overflow Weir 1	Outlet Plate 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	0.9	1.7	2.0	2.2
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	39	47	28	39	48	50	45	40	28
Time to Drain 99% of Inflow Volume (hours) =	43	51	31	43	53	58	56	53	47
Maximum Ponding Depth (ft) =	3.84	4.34	2.80	3.62	4.22	6.16	7.14	9.43	10.54
Area at Maximum Ponding Depth (acres) =	2.89	3.68	1.64	2.53	3.47	5.63	5.81	6.46	6.69
Maximum Volume Stored (acre-ft) =	3.883	5.525	1.573	3.260	5.060	14.533	20.082	34.085	41.385

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.07 (June 2025)

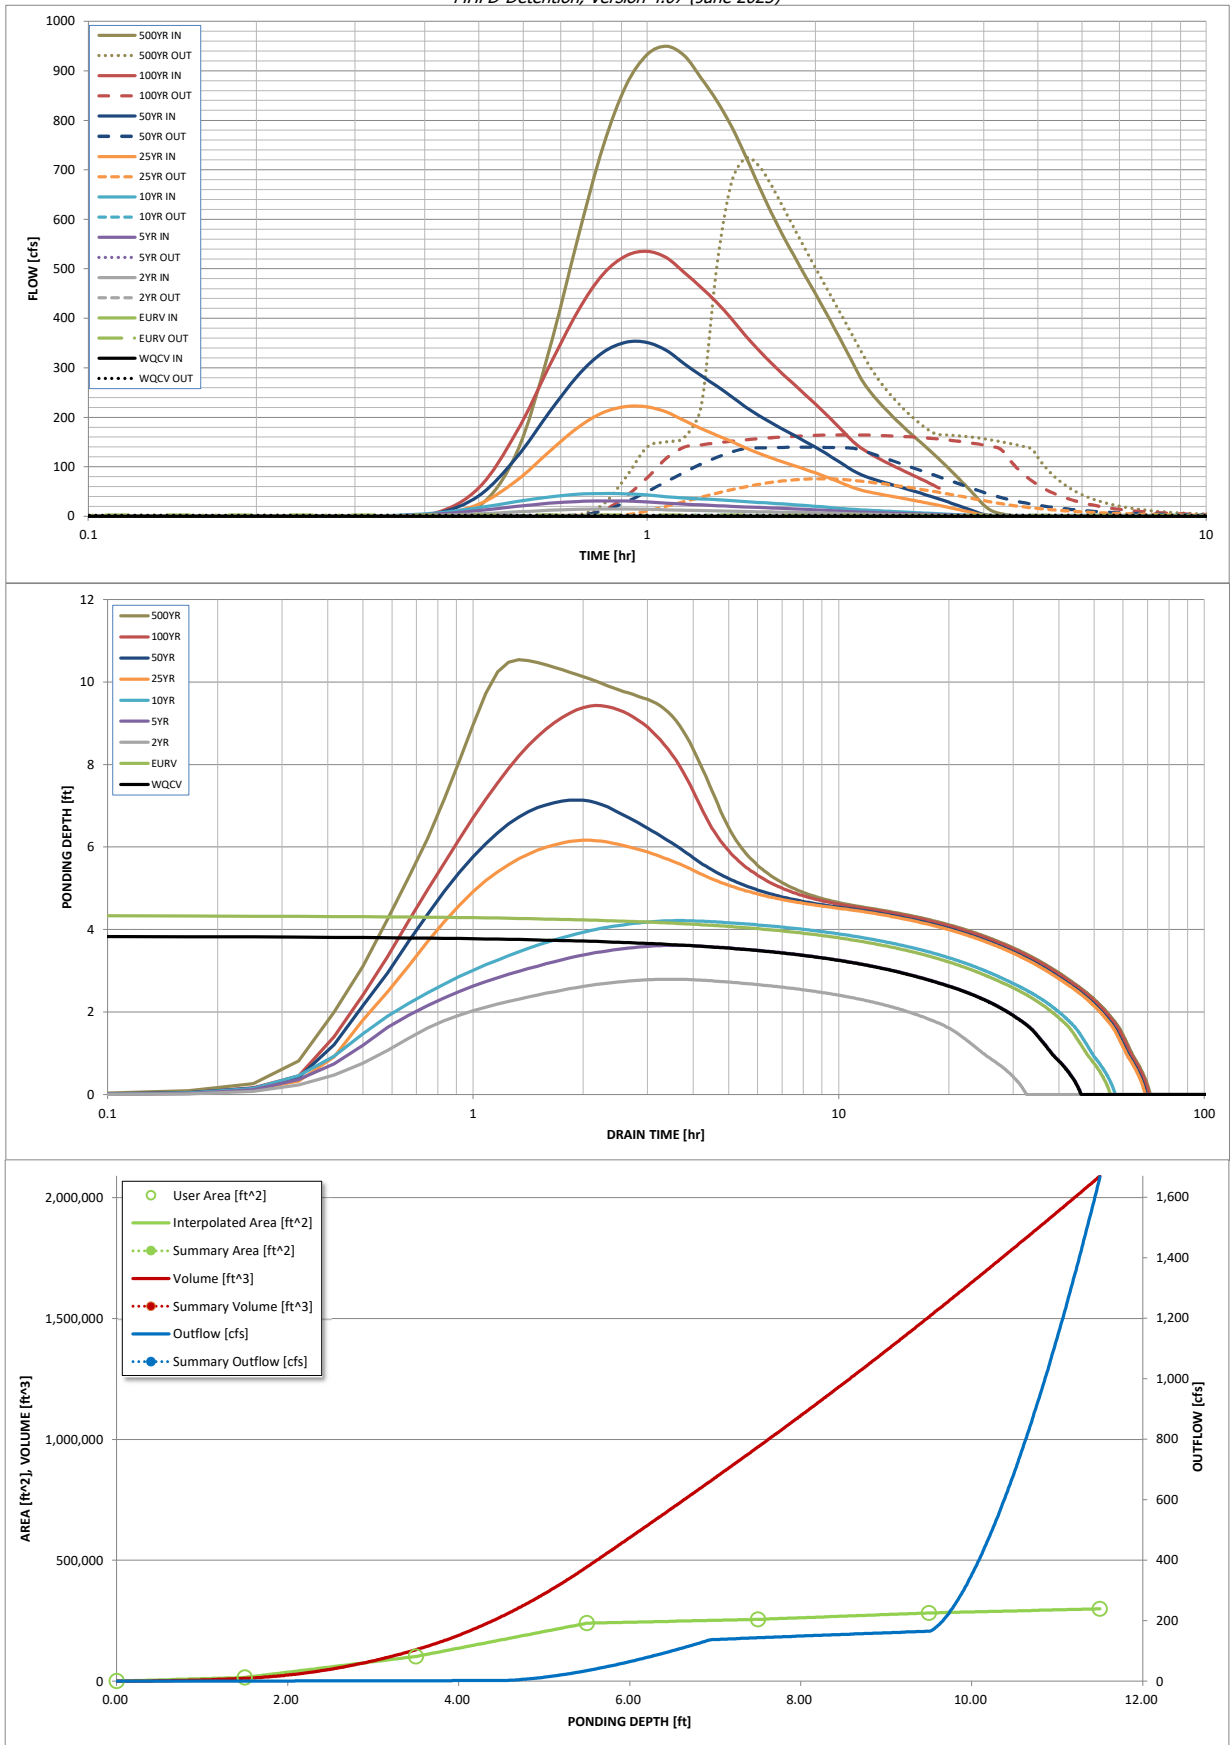

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs


The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0	0.00	0.00	0.00	0.00	0.00	0.02	0.01	0.08
	0:15:00	0	0.00	0.07	0.15	0.20	0.16	0.26	0.25	0.54
	0:20:00	0	0.00	0.47	0.76	0.99	0.75	1.01	1.08	2.32
	0:25:00	0	0.00	1.81	4.26	6.49	3.15	5.01	6.17	19.82
	0:30:00	0	0.00	4.88	11.53	17.54	24.34	41.61	57.60	126.48
	0:35:00	0	0.00	8.75	19.81	29.64	71.57	118.46	169.06	331.20
	0:40:00	0	0.00	11.98	26.26	38.97	129.54	208.27	300.27	557.95
	0:45:00	0	0.00	13.98	29.99	44.38	178.59	283.13	412.72	745.82
	0:50:00	0	0.00	14.83	31.21	46.12	209.41	330.91	488.69	869.97
	0:55:00	0	0.00	14.77	30.71	45.43	221.95	351.48	526.45	932.68
	1:00:00	0	0.00	14.18	29.07	43.03	221.10	351.32	535.39	949.38
	1:05:00	0	0.00	13.23	26.56	39.49	210.40	334.85	522.08	929.90
	1:10:00	0	0.00	12.24	24.56	37.02	193.03	307.92	492.06	885.28
	1:15:00	0	0.00	11.60	23.07	35.19	177.35	284.33	462.34	839.31
	1:20:00	0	0.00	10.93	21.60	33.39	163.78	262.81	431.78	787.18
	1:25:00	0	0.00	10.27	20.12	31.44	151.10	242.07	398.86	728.45
	1:30:00	0	0.00	9.66	18.84	29.65	138.24	221.24	365.21	667.95
	1:35:00	0	0.00	9.19	17.85	28.08	127.20	203.81	335.66	614.75
	1:40:00	0	0.00	8.79	16.95	26.53	118.06	189.12	310.15	567.88
	1:45:00	0	0.00	8.40	16.04	24.95	110.04	175.94	287.27	525.44
	1:50:00	0	0.00	8.01	15.09	23.37	102.43	163.43	266.41	486.79
	1:55:00	0	0.00	7.61	14.13	21.80	94.98	151.35	246.35	449.68
	2:00:00	0	0.00	7.16	13.15	20.26	87.65	139.51	226.80	413.71
	2:05:00	0	0.00	6.67	12.13	18.65	80.30	127.68	207.58	378.50
	2:10:00	0	0.00	6.13	11.06	16.99	72.93	115.83	188.69	344.04
	2:15:00	0	0.00	5.58	9.97	15.30	65.53	103.97	169.89	309.78
	2:20:00	0	0.00	5.07	9.11	14.03	58.25	92.39	151.50	277.13
	2:25:00	0	0.00	4.69	8.47	13.05	52.80	84.07	137.82	253.24
	2:30:00	0	0.00	4.36	7.91	12.17	48.88	77.83	127.32	234.02
	2:35:00	0	0.00	4.06	7.37	11.33	45.74	72.69	118.28	217.08
	2:40:00	0	0.00	3.77	6.86	10.53	42.80	67.92	110.16	201.73
	2:45:00	0	0.00	3.50	6.38	9.77	40.04	63.54	102.65	187.56
	2:50:00	0	0.00	3.23	5.91	9.03	37.34	59.26	95.47	174.16
	2:55:00	0	0.00	2.99	5.45	8.32	34.69	55.05	88.65	161.56
	3:00:00	0	0.00	2.75	5.00	7.63	32.10	50.93	82.20	149.79
	3:05:00	0	0.00	2.52	4.57	6.97	29.54	46.85	75.82	138.12
	3:10:00	0	0.00	2.29	4.15	6.33	27.00	42.82	69.47	126.54
	3:15:00	0	0.00	2.07	3.73	5.71	24.46	38.79	63.14	114.96
	3:20:00	0	0.00	1.85	3.32	5.10	21.94	34.78	56.80	103.40
	3:25:00	0	0.00	1.64	2.92	4.49	19.42	30.77	50.48	91.86
	3:30:00	0	0.00	1.43	2.52	3.88	16.91	26.77	44.16	80.32
	3:35:00	0	0.00	1.22	2.13	3.29	14.40	22.77	37.85	68.80
	3:40:00	0	0.00	1.02	1.74	2.70	11.90	18.79	31.55	57.30
	3:45:00	0	0.00	0.83	1.36	2.12	9.41	14.81	25.26	45.82
	3:50:00	0	0.00	0.64	0.99	1.56	6.93	10.86	18.99	34.40
	3:55:00	0	0.00	0.48	0.67	1.08	4.50	6.99	12.83	23.40
	4:00:00	0	0.00	0.36	0.50	0.84	2.45	3.84	7.78	14.89
	4:05:00	0	0.00	0.31	0.43	0.70	1.36	2.21	4.88	9.89
	4:10:00	0	0.00	0.27	0.37	0.60	0.87	1.39	3.18	6.65
	4:15:00	0	0.00	0.23	0.32	0.50	0.64	0.94	2.05	4.36
	4:20:00	0	0.00	0.20	0.27	0.42	0.47	0.65	1.30	2.74
	4:25:00	0	0.00	0.17	0.23	0.35	0.36	0.48	0.78	1.61
	4:30:00	0	0.00	0.14	0.19	0.28	0.27	0.35	0.42	0.85
	4:35:00	0	0.00	0.12	0.15	0.22	0.21	0.26	0.24	0.49
	4:40:00	0	0.00	0.09	0.12	0.17	0.16	0.20	0.19	0.37
	4:45:00	0	0.00	0.08	0.10	0.13	0.13	0.15	0.15	0.29
	4:50:00	0	0.00	0.06	0.08	0.10	0.10	0.12	0.12	0.23
	4:55:00	0	0.00	0.04	0.06	0.08	0.08	0.09	0.09	0.18
	5:00:00	0	0.00	0.03	0.04	0.06	0.06	0.07	0.07	0.13
	5:05:00	0	0.00	0.02	0.03	0.04	0.04	0.05	0.05	0.09
	5:10:00	0	0.00	0.01	0.02	0.02	0.03	0.03	0.03	0.06
	5:15:00	0	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.03
	5:20:00	0	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.02
	5:25:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

DRAINAGE MAPS

Douglas County

Elbert County

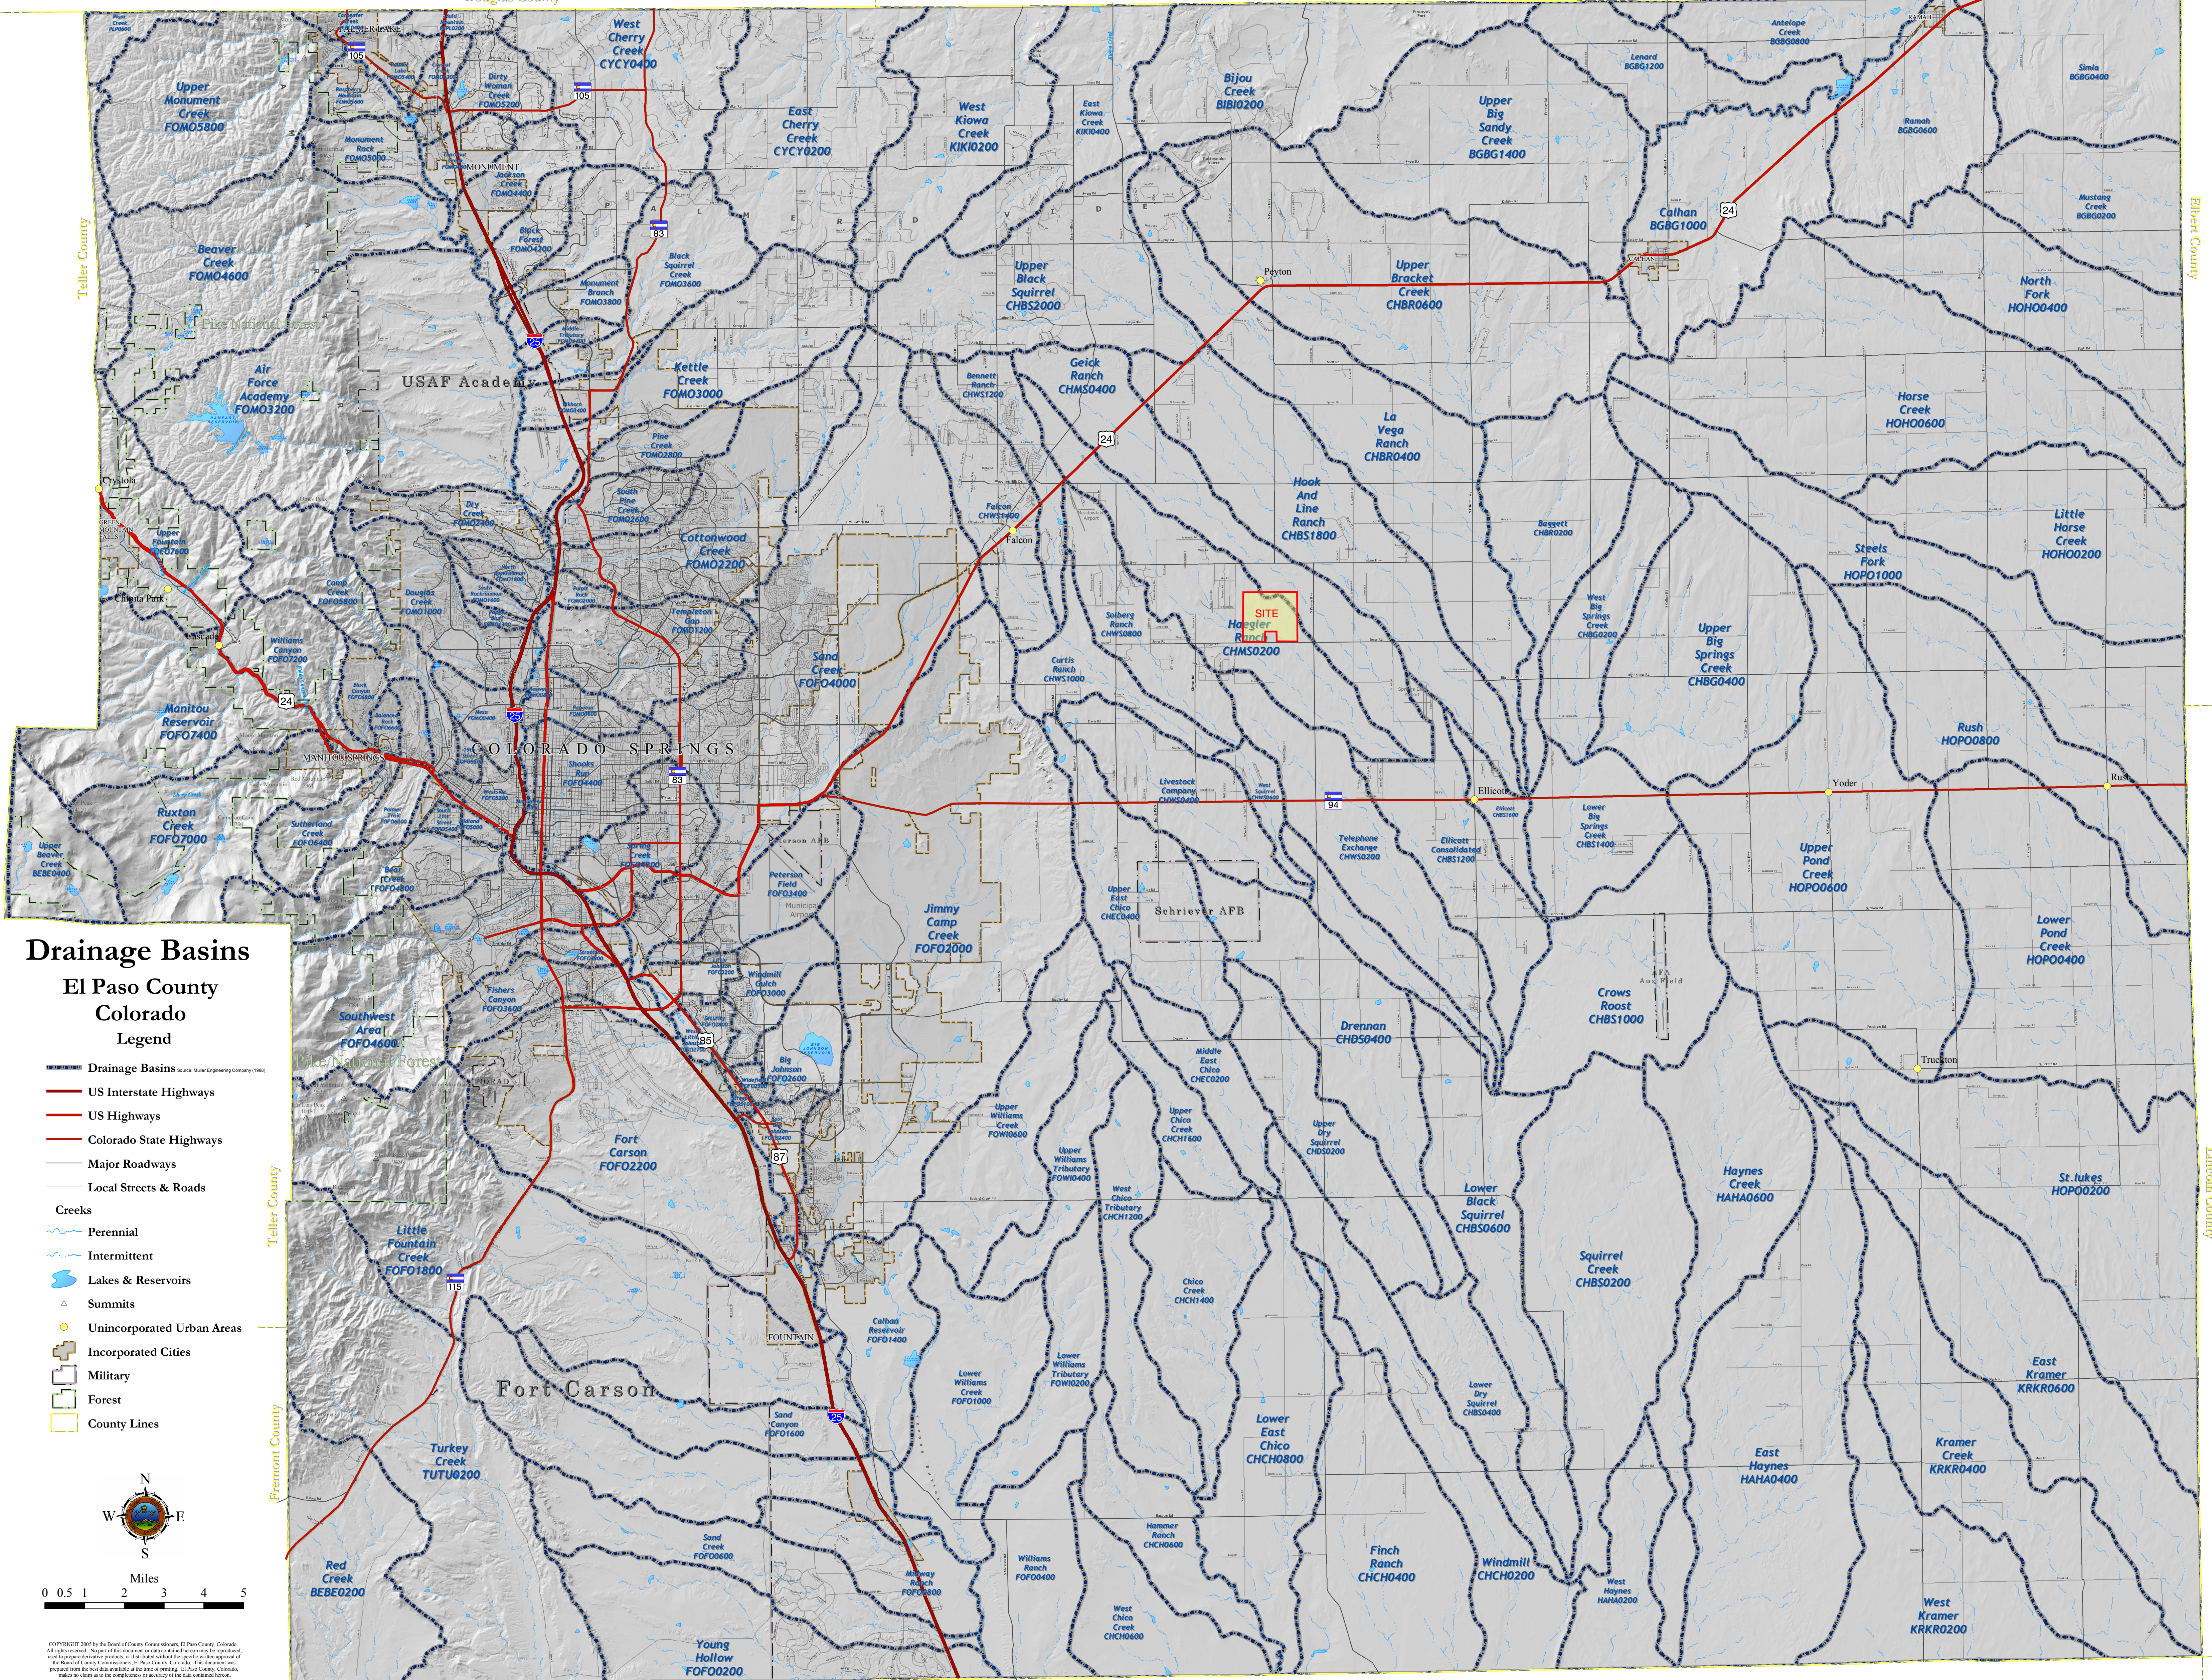

Drainage Basins

El Paso County Colorado Legend

- Drainage Basins (Source: Muler Engineering Company 1986)
- US Interstate Highways
- US Highways
- Colorado State Highways
- Major Roadways
- Local Streets & Roads
- Creeks**
- Perennial
- Intermittent
- Lakes & Reservoirs
- Summits
- Unincorporated Urban Areas
- Incorporated Cities
- Military
- Forest
- County Lines



Copyright 2007 by the Board of County Commissioners, El Paso County, Colorado. All rights reserved. No part of this document or data contained herein may be reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying, recording, or by any information storage and retrieval system, without the prior written permission of the Board of County Commissioners, El Paso County, Colorado. This document was prepared from the best data available at the time of printing. El Paso County, Colorado, makes no claim as to the completeness or accuracy of the data contained herein.

Teller County

Teller County

Fremont County


Elbert County

Lincoln County


Pueblo County

FIGURE 4-4 SHEET 2

OFF-SITE DRAINAGE MAP

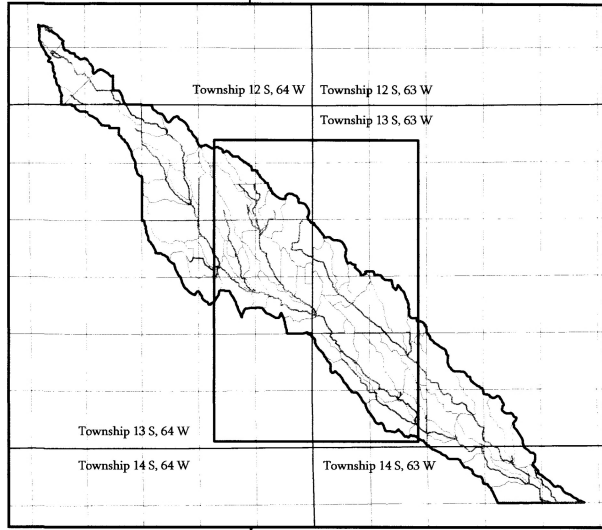

- - JUNCTIONS
- JHR0025 - JUNCTION IDENTIFIERS
- (with number) - SUBBASIN IDENTIFIERS
- (with wavy line) - REACHES
- (with wavy line and dots) - POTENTIAL WETLANDS
- (with thick line) - HAEGLER RANCH BASIN BOUNDARY
- (with thin line) - SUBBASIN BOUNDARIES

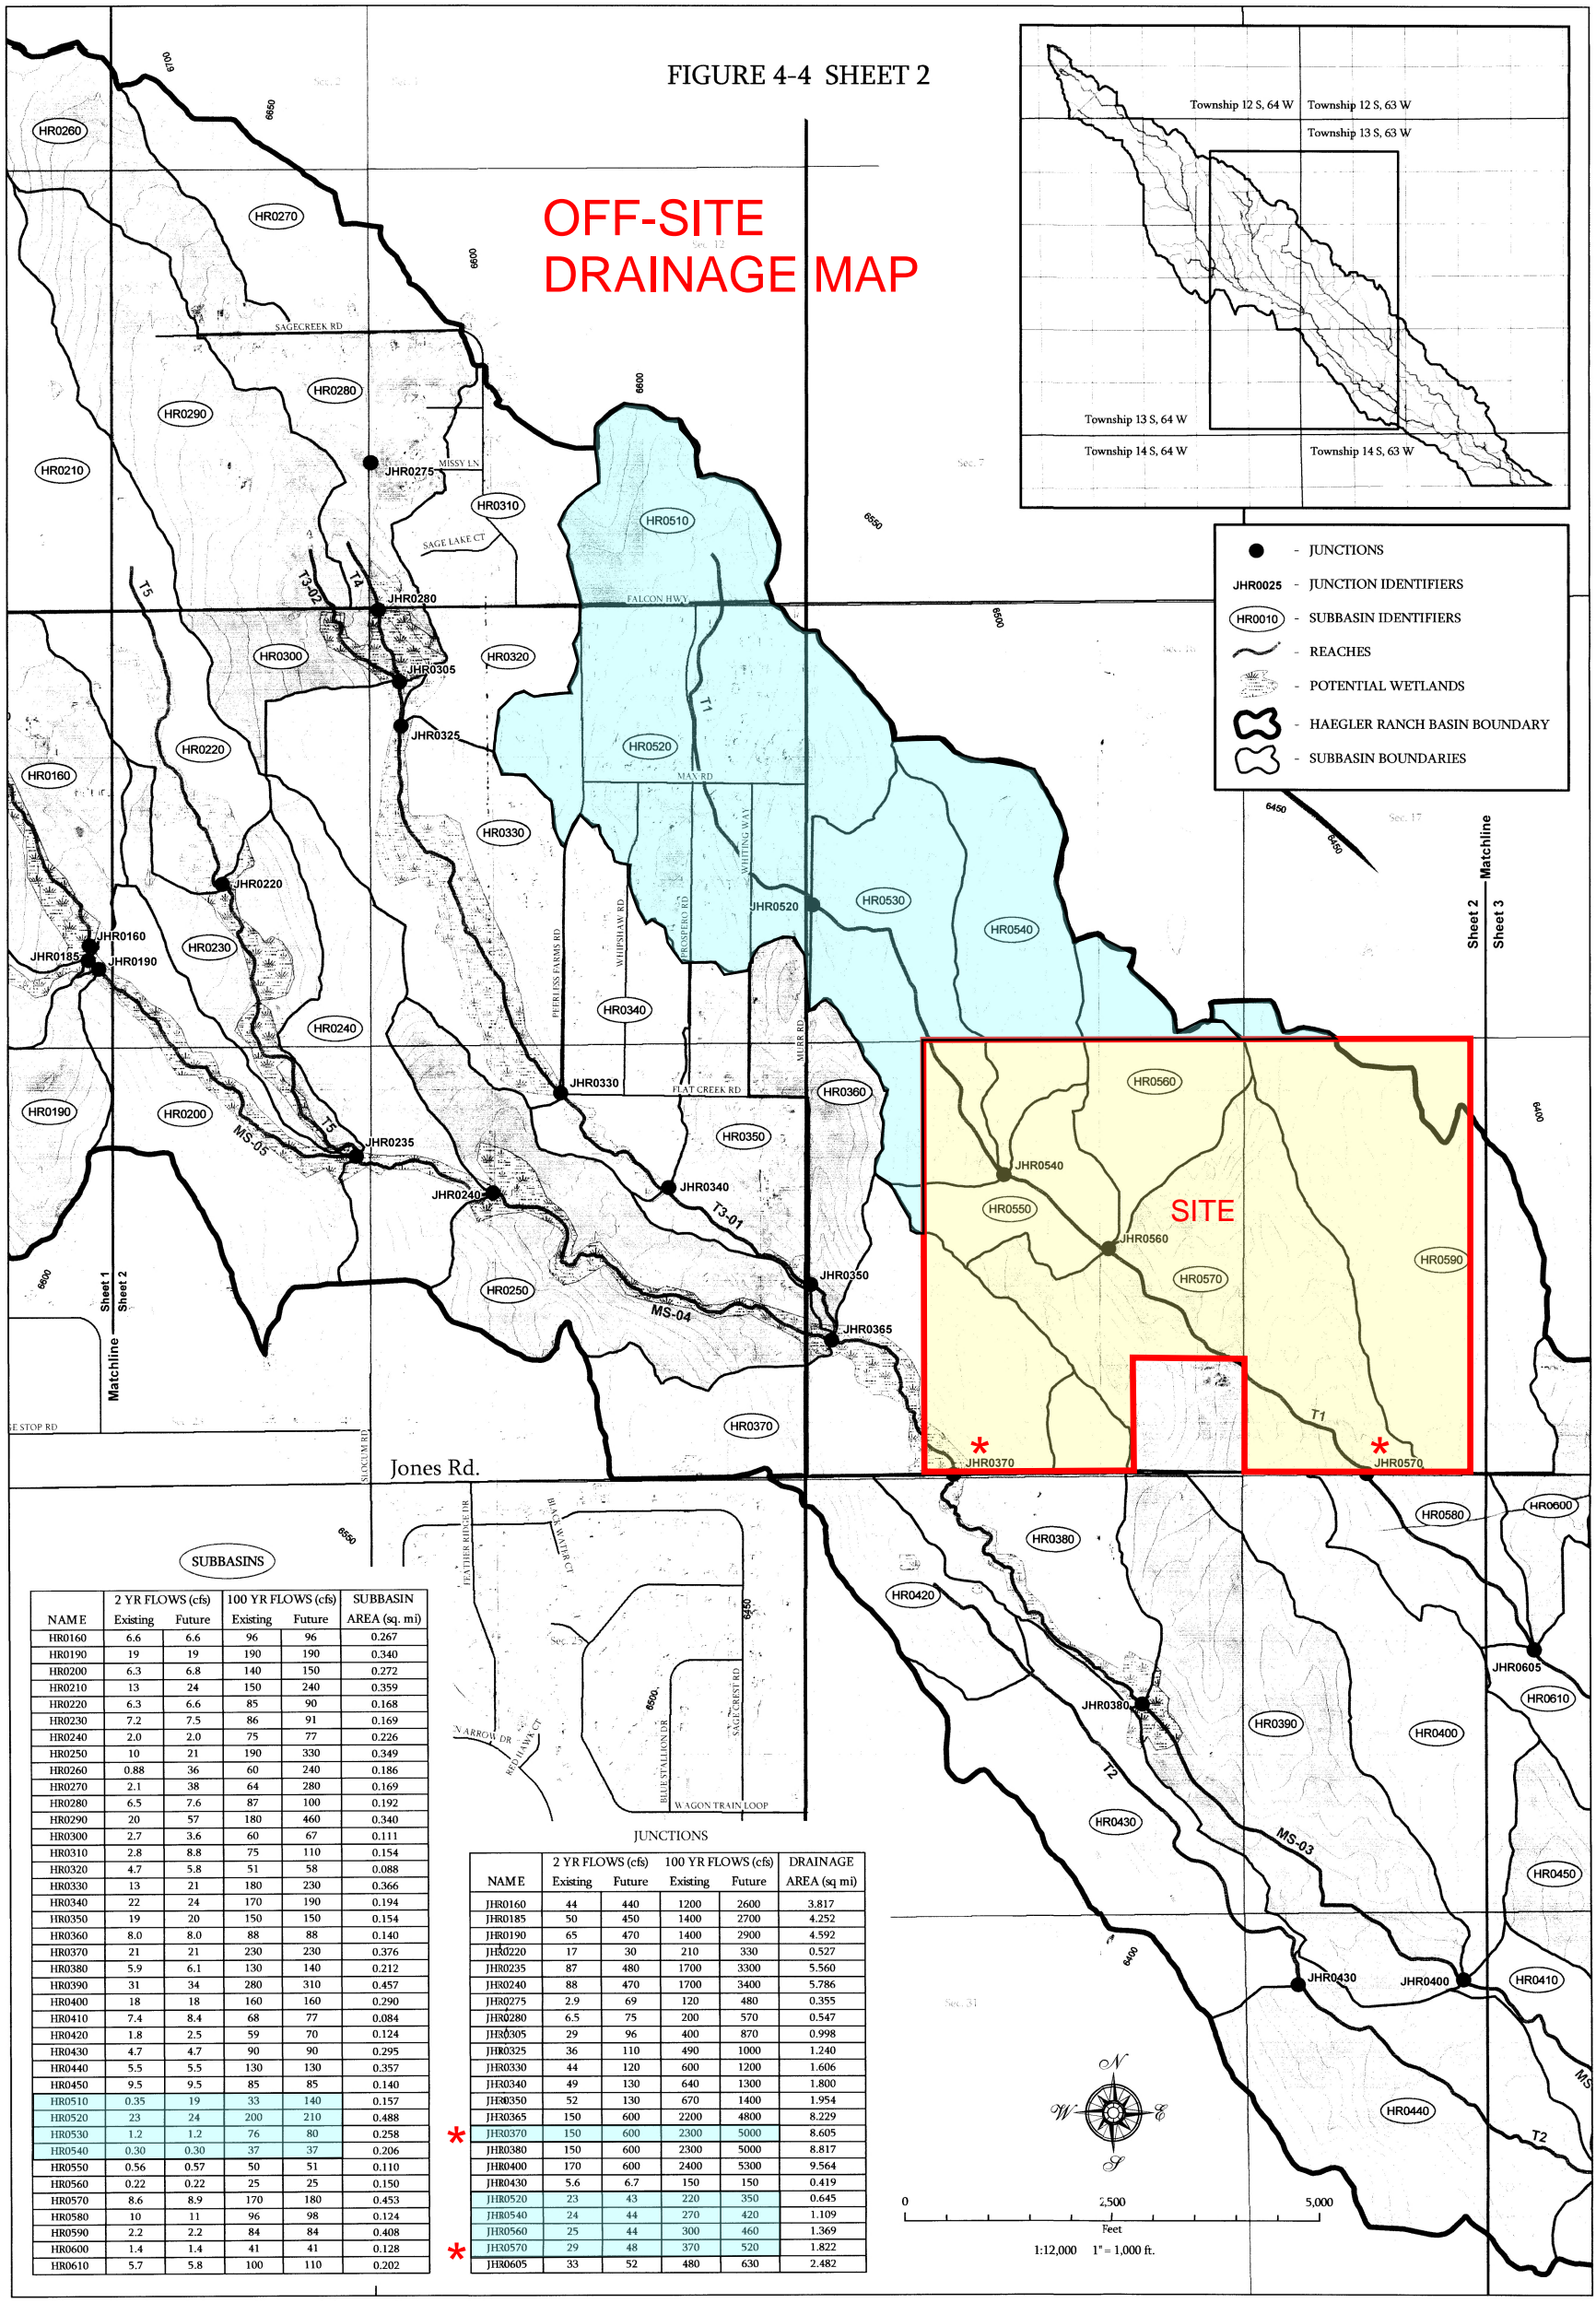


SUBBASINS

NAME	2 YR FLOWS (cfs)		100 YR FLOWS (cfs)		SUBBASIN AREA (sq. m)
	Existing	Future	Existing	Future	
HR0160	6.6	6.6	96	96	0.267
HR0190	19	19	190	190	0.340
HR0200	6.3	6.8	140	150	0.272
HR0210	13	24	150	240	0.359
HR0220	6.3	6.6	85	90	0.168
HR0230	7.2	7.5	86	91	0.169
HR0240	2.0	2.0	75	77	0.226
HR0250	10	21	190	330	0.349
HR0260	0.88	36	60	240	0.186
HR0270	2.1	38	64	280	0.169
HR0280	6.5	7.6	87	100	0.192
HR0290	20	57	180	460	0.340
HR0300	2.7	3.6	60	67	0.111
HR0310	2.8	8.8	75	110	0.154
HR0320	4.7	5.8	51	58	0.088
HR0330	13	21	180	230	0.366
HR0340	22	24	170	190	0.194
HR0350	19	20	150	150	0.154
HR0360	8.0	8.0	88	88	0.140
HR0370	21	21	230	230	0.376
HR0380	5.9	6.1	130	140	0.212
HR0390	31	34	280	310	0.457
HR0400	18	18	160	160	0.290
HR0410	7.4	8.4	68	77	0.084
HR0420	1.8	2.5	59	70	0.124
HR0430	4.7	4.7	90	90	0.295
HR0440	5.5	5.5	130	130	0.357
HR0450	9.5	9.5	85	85	0.140
HR0510	0.35	19	33	140	0.157
HR0520	23	24	200	210	0.488
HR0530	1.2	1.2	76	80	0.258
HR0540	0.30	0.30	37	37	0.206
HR0550	0.56	0.57	50	51	0.110
HR0560	0.22	0.22	25	25	0.150
HR0570	8.6	8.9	170	180	0.453
HR0580	10	11	96	98	0.124
HR0590	2.2	2.2	84	84	0.408
HR0600	1.4	1.4	41	41	0.128
HR0610	5.7	5.8	100	110	0.202

JUNCTIONS

NAME	2 YR FLOWS (cfs)		100 YR FLOWS (cfs)		DRAINAGE AREA (sq. m)
	Existing	Future	Existing	Future	
JHR0160	44	440	1200	2600	3.817
JHR0185	50	450	1400	2700	4.252
JHR0190	65	470	1400	2900	4.592
JHR0220	17	30	210	330	0.527
JHR0235	87	480	1700	3300	5.560
JHR0240	88	470	1700	3400	5.786
JHR0275	2.9	69	120	480	0.355
JHR0280	6.5	75	200	570	0.547
JHR0305	29	96	400	870	0.998
JHR0325	36	110	490	1000	1.240
JHR0330	44	120	600	1200	1.606
JHR0340	49	130	640	1300	1.800
JHR0350	52	130	670	1400	1.954
JHR0365	150	600	2200	4800	8.229
JHR0370	150	600	2300	5000	8.605
JHR0380	150	600	2300	5000	8.817
JHR0400	170	600	2400	5300	9.564
JHR0430	5.6	6.7	150	150	0.419
JHR0520	23	43	220	350	0.645
JHR0540	24	44	270	420	1.109
JHR0560	25	44	300	460	1.369
JHR0570	29	48	370	520	1.822
JHR0605	33	52	480	630	2.482




0 2,500 5,000
Feet
1:12,000 1" = 1,000 ft.



HAEGLER RANCH DRAINAGE BASIN EXISTING AND FUTURE CONDITIONS HYDROLOGIC MODEL

TRIPLE H RANCH - PRELIMINARY PLAN

PRELIMINARY DRAINAGE REPORT PRE-DEVELOPED CONDITIONS

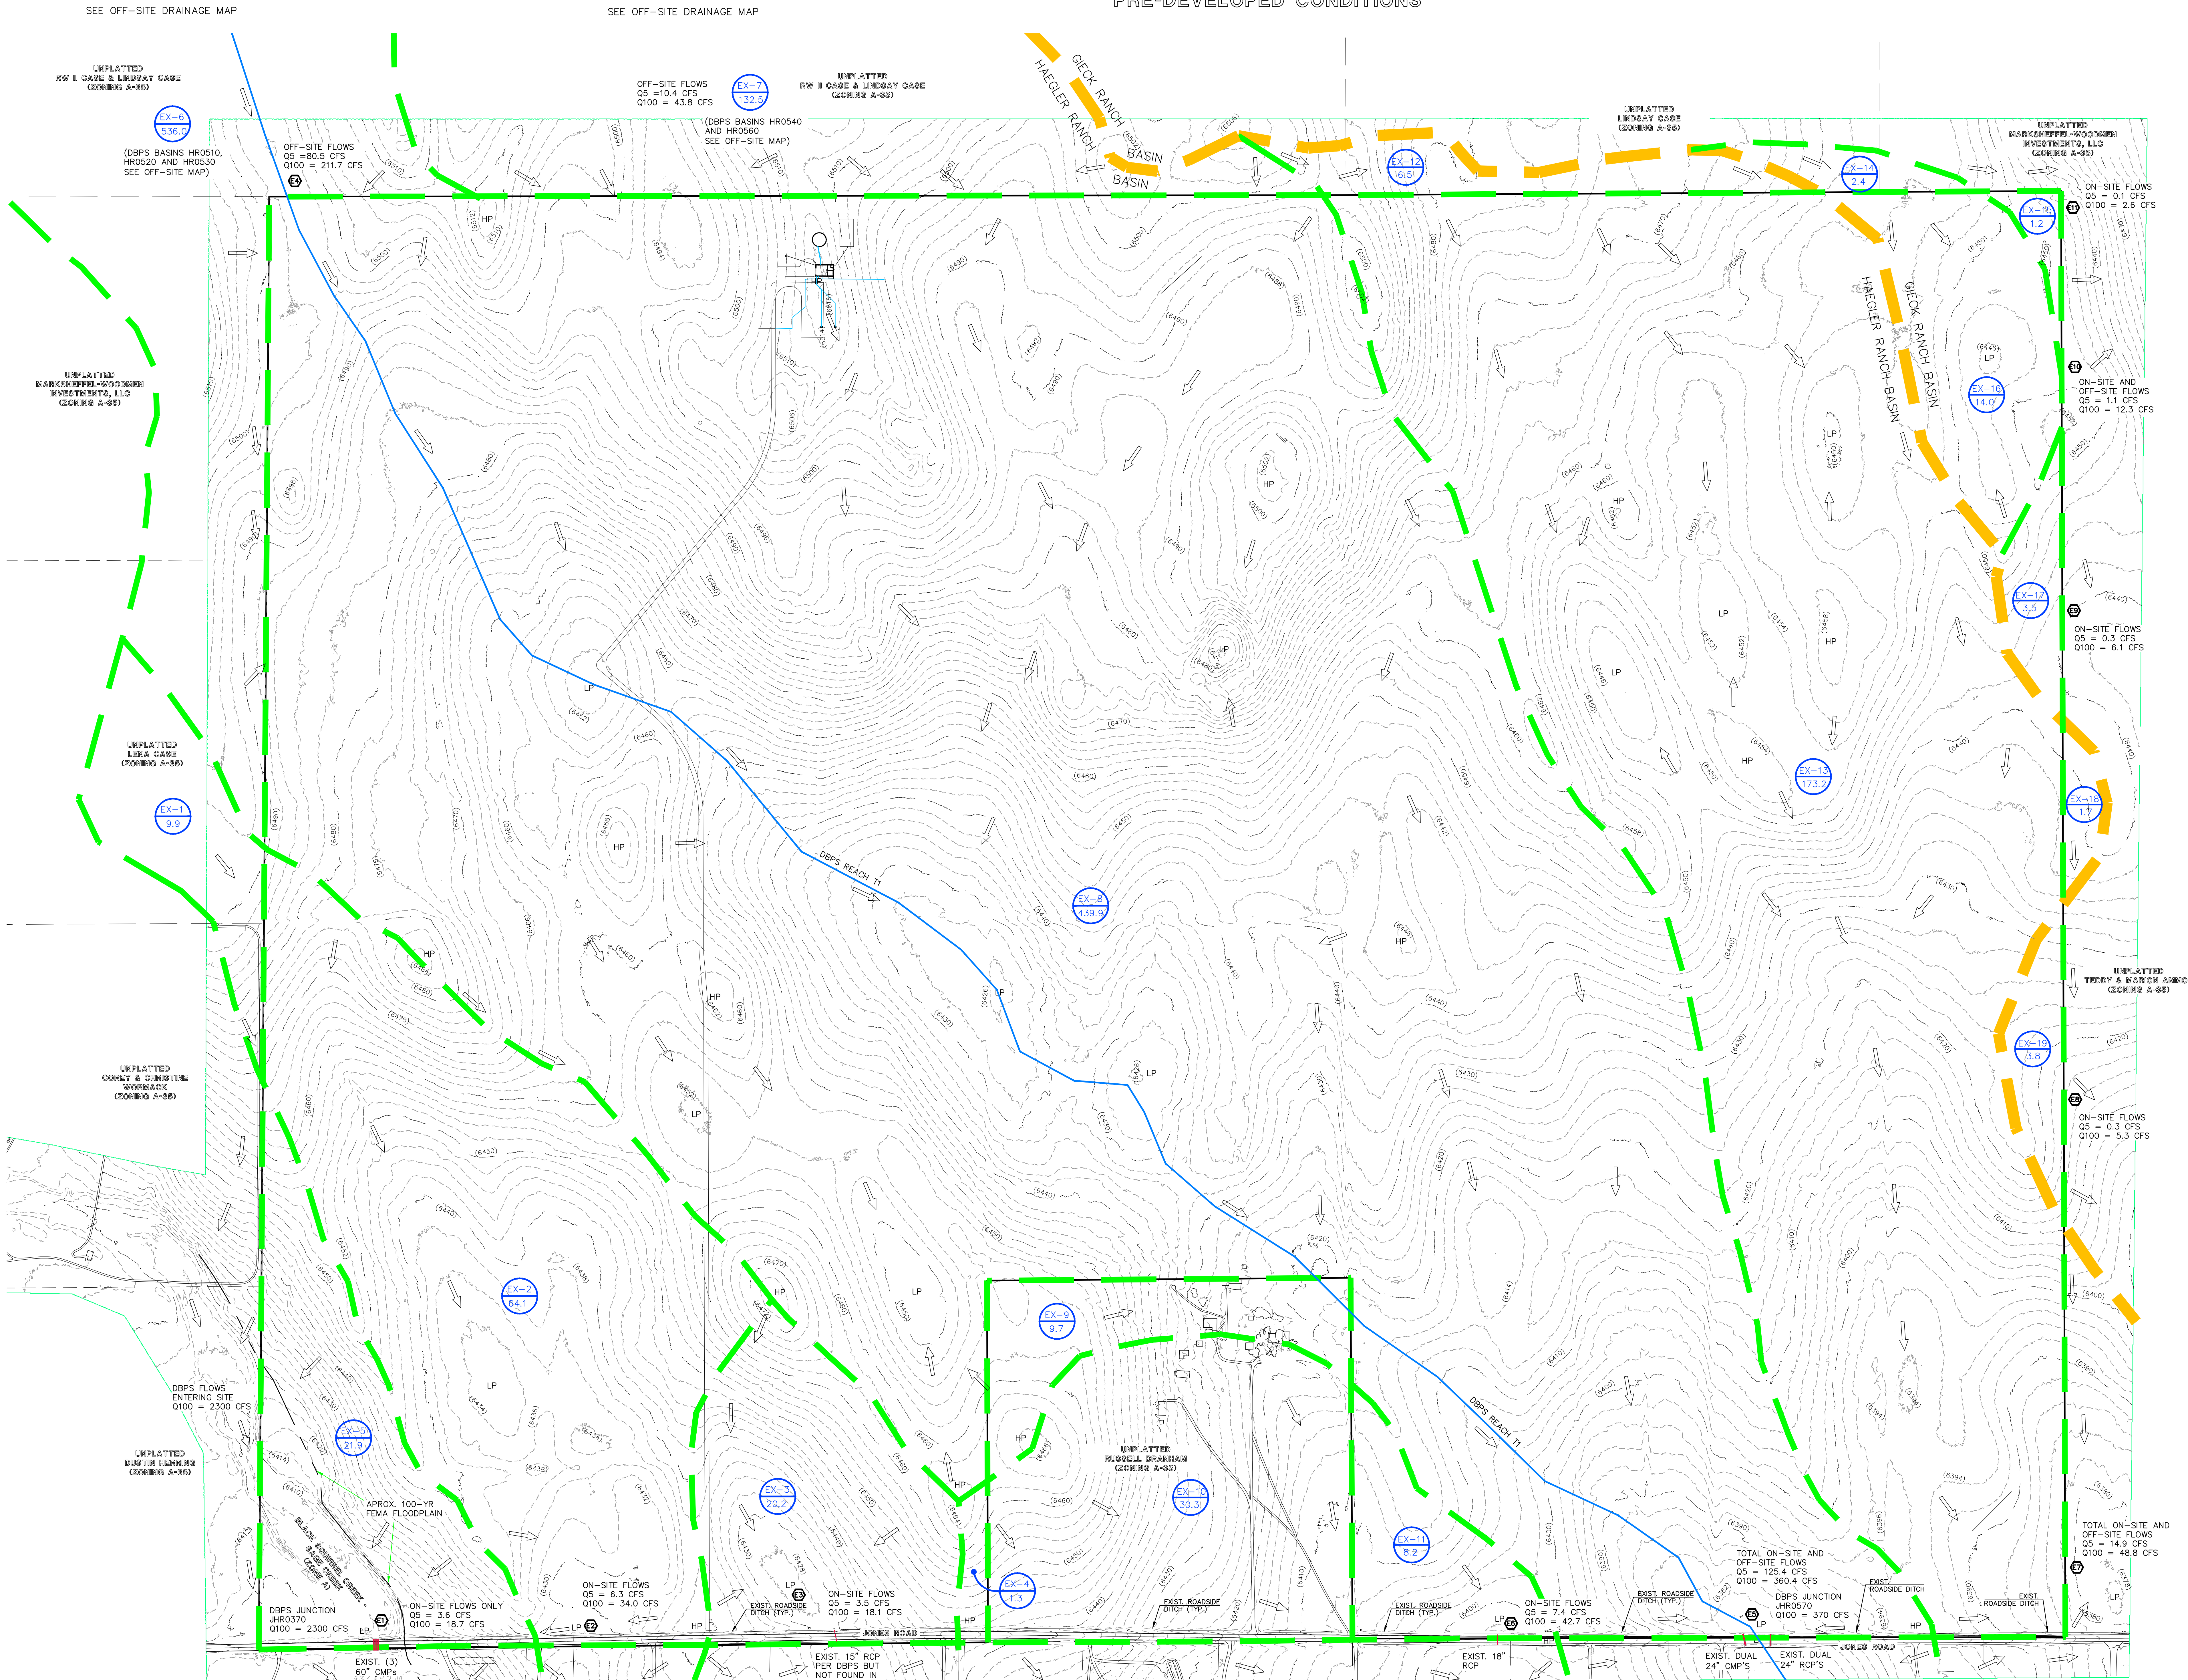


SUBCATCHMENT OUTPUT FLOW DATA

Subcatchment	Area (Ac)	Width (Ft)	Slope Sw (%)	Imperv. (%)	5-YR. Pro (cfs)	100-YR. Pro (cfs)
EX-1	9.9	787	1.05	3.2	1.3	8.3
EX-2	84.1	1746	1.67	2.5	6.3	27.7
EX-3	20.2	1157	2.29	4.4	3.5	18.1
EX-4	1.3	284	4.76	6.5	0.3	3.7
EX-5	21.9	1237	2.09	4.2	3.6	18.7
EX-6	596	6089	1.13	4	80.5	211.7
EX-7	132.5	3042	1.21	2	10.4	43.8
EX-8	439.9	4868	1.36	2	34.4	106.6
EX-9	9.7	541	3.78	5.2	2.0	10.3
EX-10	30.3	2034	2.2	5.2	6.2	30.5
EX-11	8.2	952	1.28	6.2	2.0	10.4
EX-12	6.5	782	2.19	2	0.5	9.0
EX-13	173.2	2202	1.72	2.2	14.9	48.8
EX-14	2.4	384	1.88	2	0.2	3.6
EX-15	1.2	416	1.1	2	0.1	2.8
EX-16	14	1196	0.53	2	1.1	9.2
EX-17	3.5	955	0.9	2	0.3	6.1
EX-18	1.7	571	0.43	2	0.1	2.7
EX-19	3.8	496	1.93	2	0.3	5.3

DESIGN POINT FLOW DATA

Design Point	5-YR. Pro (cfs)	100-YR. Pro (cfs)
E1	3.6	18.7
E2	6.3	34.0
E3	3.5	18.1
E4	80.5	211.7
E5	125.4	360.4
E6	7.4	42.7
E7	14.9	48.8
E8	0.3	5.3
E9	0.3	6.1
E10	1.1	12.3
E11	0.1	2.6

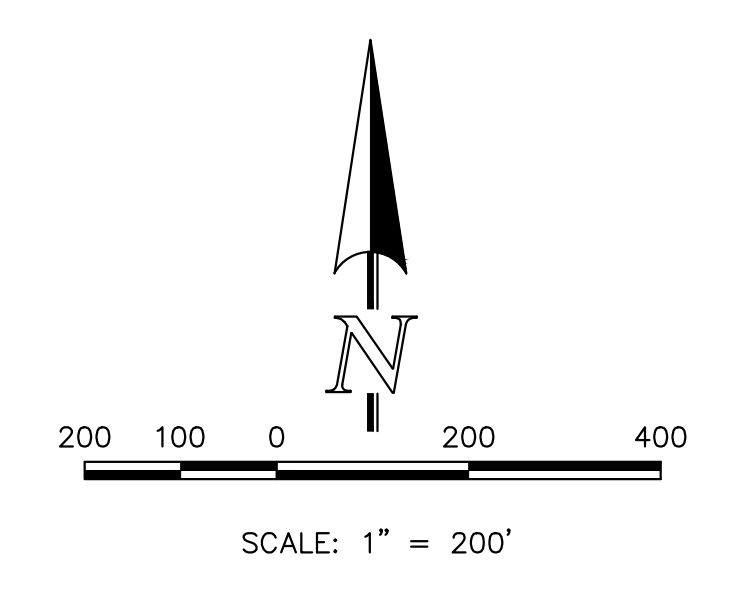

LEGEND

DESCRIPTION	SYMBOL
EXISTING GROUND CONTOUR	6910
PROPOSED FINISHED CONTOUR	6910
SUB-BASIN BOUNDARY	---
DESIGN POINT	EX-10
BASIN IDENTIFIER	---
AREA IN ACRES	---
EXISTING DIRECTION OF FLOW	→
EXISTING STORM SEWER	---
DBPS REACH TI	---

TRIPLE H RANCH - PRELIM. PLAN
PRELIMINARY DRAINAGE REPORT
PRE-DEVELOPED CONDITIONS
2604.00
SHEET 1 OF 2



619 N. Cascade Avenue, Suite 200
Colorado Springs, Colorado 80903
(719)785-0790
(719)785-0799 (Fax)

