



## PRELIMINARY DRAINAGE REPORT

### **FALCON MEADOWS AT BENT GRASS EARLY GRADING FOR A PORTION OF FALCON MEADOWS**

El Paso County, Colorado

---

PREPARED FOR:  
**Challenger Homes**  
**8605 Explorer Dr., Suite 250**  
**Colorado Springs, CO 80920**

PREPARED BY:  
**Galloway & Company, Inc.**  
**1155 Kelly Johnson Blvd., Suite 305**  
**Colorado Springs, CO 80920**

DATE:  
**April 2021**  
**Revised May 2021**  
**Revised May 21, 2021**

**CDR-21-004**  
**PUDSP-20-005**



**ENGINEER'S STATEMENT**

*The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.*

\_\_\_\_\_  
Charlene Durham, P.E. #36727  
For and on behalf of Galloway & Company, Inc.



**DEVELOPER'S CERTIFICATION**

*I, The developer, have read and will comply with all of the requirements specified in this drainage report and plan.*

By: \_\_\_\_\_

2/19/21  
\_\_\_\_\_  
Date

Address: Challenger Homes  
8605 Explorer Dr., Suite 250  
Colorado Springs, CO 80920

By: \_\_\_\_\_

2/19/21  
\_\_\_\_\_  
Date

Address: Better Land LLC  
8605 Explorer Dr., Suite 250  
Colorado Springs, CO 80920

**EL PASO COUNTY CERTIFICATION**

*Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.*

\_\_\_\_\_  
Jennifer Irvine, P.E.  
County Engineer/ECM Administrator

Conditions:

**APPROVED**  
**Engineering Department**

05/27/2021 3:06:42 PM  
dsdnijkamp

EPC Planning & Community  
Development Department

## TABLE OF CONTENTS

I.	Purpose .....	1
II.	General Description .....	1
III.	Previous Reports .....	1
IV.	Drainage Criteria .....	2
V.	Existing Drainage Conditions .....	2
VI.	Four Step Process .....	5
	1. Employ Runoff Reduction Practices .....	5
	2. Stabilize Drainageways.....	5
	3. Provide Water Quality Capture Volume (WQCV).....	6
	4. Consider Need for Industrial and Commercial BMPs.....	6
VII.	Proposed Drainage Conditions.....	6
VIII.	Storm Sewer System (FOR INFORMATION ONLY) .....	9
IX.	Proposed Water Quality Detention Ponds.....	9
X.	Proposed Channel Improvements .....	10
XI.	Maintenance (FOR INFORMATION ONLY) .....	10
XII.	Wetlands Mitigation.....	11
XIII.	Floodplain Statement .....	11
XIV.	Drainage Fees .....	11
XV.	Conclusion .....	11
XVI.	References .....	11

### Appendices:

- A. Exhibits and Figures
- B. Hydrologic Computations
- C. Hydraulic Computations
- D. Drainage Maps & Water Quality Plan

## I. Purpose

The purpose of this Preliminary Drainage Report is to identify on and offsite drainage patterns, locate and identify tributary or downstream drainage features and facilities that impact the site, and to identify which types of drainage facilities will be needed and where they will be located. This report will remain in general compliance with the MDDP submitted for review in January for the site prepared by Galloway & Company.

## II. General Description

The future project is a single-family residential development located in the Falcon area of El Paso County, Colorado. The site is located in the Northwest  $\frac{1}{4}$  and Southwest  $\frac{1}{4}$  of Section 1, Township 13S, Range 65W, of the Sixth Principal Meridian, County of El Paso, State of Colorado. The subject property is bounded by Bent Grass Meadows Filing No.2 to the east, Latigo Business Center Filing No. 1 to the south, The Meadows Filings No. 1 & 2 to the west, and The Meadows Filing No. 3 to the north. A Vicinity Map is included in Appendix A.

The existing soil types within the proposed site as determined by the NRCS Web Soil Survey for El Paso County Area consist of Columbine gravelly sandy loam, Blakeland-Fluvaquentic Haplaquolls, and Blakeland loamy sand. All soils are defined as having a hydrologic soil group of A. See the soils map included in Appendix A.

## III. Previous Reports

The proposed site has been included in multiple drainage studies in the past. The following is a composite list of the existing reports pertaining to this site analysis.

1. *Falcon Drainage Basin Planning Study*, by Matrix Design Group, September 2015.
2. *Master Development Drainage Plan – Bent Grass Residential Subdivision*, by Galloway & Company, *Revision in Progress per Meridian Road Intersection Comments*.
3. *Master Development Drainage Plan and Preliminary Drainage Plan – Bent Grass Subdivision*, by Kiowa Engineering Corporation, December 2006.
4. *Final Drainage Report for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2014.
5. *Final Drainage Report Addendum for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2015.
6. *Master Development Drainage Plan for The Ranch*, by Classic Consulting Engineers & Surveyors, LLC, November 2018.
7. *Falcon Highlands Master Development Drainage Plan & Preliminary Drainage Report & Final Drainage Report for Filing 1*, by URS, January 2005.
8. *Final Drainage Report and Erosion Control Plan – Latigo Business Center Filing No. 1 A Re-subdivision of a Portion of Latigo Business and Research Center Filing No. 1*, by Kiowa Engineering Corporation, November 2004.
9. *Final Drainage Letter Report for Lot 1, Latigo Business Center Filing No. 1*, by Colorado Design Concepts, April 2005.
10. *Final Drainage and Erosion Control for The Meadows Filing Three Subdivision*, by LADD Engineering, July 2000.
11. *Final Drainage Report for Bent Grass Residential (Filing No. 2)*, by Galloway & Company, May 2020.



## IV. Drainage Criteria

Hydrology calculations were performed using the City of Colorado Springs/El Paso County Drainage Criteria Manual, as revised in November 1991 and October 1994 with County adopted Chapter 6 and Section 3.2.1 of Chapter 13 of the City of Colorado Springs/El Paso County Drainage Criteria Manual as revised in May 2014.

The drainage calculations were based on the criteria manual Figure 6-5 and IDF equations to determine the intensity and are listed in Table 1 below.

**Table 1 - Precipitation Data**

Return Period	One Hour Depth (in).	Intensity (in/hr)
5-year	1.50	5.17
100-year	2.52	8.68

The rational method was used to calculate peak flows as the tributary areas are less than 100 acres. The rational method has been proven to be accurate for basins of this size and is based on the following formula:

$$Q = CIA$$

Where:

Q = Peak Discharge (cfs)

C = Runoff Coefficient

I = Runoff intensity (inches/hour)

A = Drainage area (acres)

The runoff coefficients are calculated based on land use, percent imperviousness, and design storm for each basin, as shown in the drainage criteria manual (Table 6-6). Composite percent impervious and C values were calculated using the residential, streets, roofs, and lawns coefficients found in Table 6-6 of the manual.

The 100-year event was used as the major storm event. The 5-year event was used as the minor event.

The UD-Detention v3.07 spreadsheet was utilized for the design of the proposed on-site water quality pond, Pond (South).

## V. Existing Drainage Conditions

The site is contained fully within one major drainage basin; the West Falcon Tributary. The site generally drains from north to south with an average slope of 2% outside of the channel. The rational method was used to analyze the individual basins within the site because their size permits it.

In addition to the DBPS, The Ranch MDDP to the north and west of the site has revisited their existing conditions as well as existing conditions from the site directly to the north of them. Several detention

ponds have been created within the Paint Brush Hills Subdivision which revise the offsite flow entering the site within the major drainageway. This is taken into account with The Ranch MDDP. While The Ranch is still in design stage, they are proposing detention ponds within their site to release at historic rates. This will revise the flow rates in their designed section of the RWT204 channel rates that are lower than those identified within the DBPS. An updated HEC-HMS model was submitted with the MDDP.

Per the DBPS the site lies within the basins, WT200, WT210, and WT220. These basins connect to channel reaches RWT202, RWT204, and RWT210. Both the RWT204 and RWT210 sections of channel currently exist and appear as a drainageway when visiting the site. With Bent Grass Filing No. 2, Reach RWT202 from Basin WT200 was “relocated and improved”. The channel reach is now along the north border of the Bent Grass property and drains towards the east, where it combines with channel reach RWT204. The channel is a 26-ft bottom trapezoidal section with 4:1 side slope and a longitudinal slope of 1.00%. The flows shown for basin WT200 and reaches RWT202 and RWT204, shown throughout the report, are the developed DBPS flows from the approved Matrix report.

A historic basin map has been prepared for this site to analyze the existing basins as well as the offsite basins contributing to the site. The historic map is included in Appendix D and basins are described below.

**Basin EX-1** (1.19 AC,  $Q_5 = 0.4$  cfs,  $Q_{100} = 2.5$  cfs): is associated with the northeastern portion of the proposed site east of the existing channel. The basin is currently undeveloped. Runoff from the basin generally flows to the southwest, into Basin EX-2 at **DP 4**.

**Basin EX-2** (1.56 AC,  $Q_5 = 0.5$  cfs,  $Q_{100} = 3.7$  cfs): is along the eastern boundary portion of the proposed site and is south of Basin EX-1, east of the existing channel. The basin is currently undeveloped and receives flows from Basins OS-4 & OS-5. Runoff from the basin generally flows to the southeast into Basin EX-3 at **DP 5** combined with flows from **DP 1, 2, & 4**.

**Basin EX-3** (0.62 AC,  $Q_5 = 0.2$  cfs,  $Q_{100} = 1.5$  cfs): is along the eastern boundary of the proposed site south of Basin EX-2 and east of the existing channel. The basin currently contains an existing WQCV pond created as part of Bent Grass Residential Filing No. 2. This basin receives flows from **DP 5** and **DP 3**.

**Basin EX-4** (12.49 AC,  $Q_5 = 3.7$  cfs,  $Q_{100} = 25.1$  cfs): is located along the northern boundary, just south of the swale built with Bent Grass Meadows Drive and west of the existing channel. The basin is currently undeveloped. Runoff from the basin generally flows to the south onto Bent Grass Meadows Drive at **DP 6**. From there, it flows via curb & gutter to the east into an existing sump inlet, ultimately discharging into the existing WQCV pond located in Basin EX-3.

**Basin EX-5** (5.15 AC,  $Q_5 = 1.6$  cfs,  $Q_{100} = 10.6$  cfs): is west of Basin EX-4 and north of Bent Grass Meadows Drive. The basin is currently undeveloped. Runoff from the basin generally flows to the south onto Bent Grass Meadows Drive at **DP 7**. From there, it flows via curb & gutter to the east into an existing sump inlet, ultimately discharging into the existing WQCV pond located in Basin EX-3.

**Basin EX-6** (9.53 AC,  $Q_5 = 2.7$  cfs,  $Q_{100} = 17.8$  cfs): is along the west boundary of the site. The basin is currently undeveloped and receives off-site flows from Basins OS-2 & OS-3. Runoff from the basin generally flows to the south into the existing drainage ditch entering an existing inlet at **DP 11** and flowing under Bent Grass Meadows Drive and discharging into an existing drainage swale in Basin EX-8.

**Basin EX-7** (9.16 AC,  $Q_5 = 2.8$  cfs,  $Q_{100} = 18.9$  cfs): is north & west of Bent Grass Meadows Drive, between Basins EX-5 & EX-6. The basin is currently undeveloped. Runoff from the basin generally flows to the southeast into Bent Grass Meadows Drive at **DP 8**. From there, it flows via curb & gutter to the south into an existing sump inlet, ultimately discharging into the existing sediment pond located in Basin EX-8.

**Basin EX-8** (21.3 AC,  $Q_5 = 6.6$  cfs,  $Q_{100} = 43.9$  cfs): is a portion of the site south and east of Bent Grass Meadows Drive, north of the south property line and west of Bent Grass Filing No. 2. The basin is currently undeveloped and contains two drainage ditches, a sediment pond, and a portion of the creek associated with Basin WT200 from the Falcon DBPS. Runoff from the basin generally flows to the southeast into the existing channel.

**Basin OS-1** (32.28 AC,  $Q_5 = 15.1$  cfs,  $Q_{100} = 65.1$  cfs) is associated with The Meadows Filing No. 3 lots 14, 15, 16, and 17. Runoff from this basin sheet flows to the northern property line of the site and then flow, via an existing drainage ditch, into the existing channel associated with Basin WT200 from the Falcon DBPS.

**Basin OS-2** (20.08 AC,  $Q_5 = 9.0$  cfs,  $Q_{100} = 43.4$  cfs) is associated with The Meadows Filing No. 1 lots 1, 2, 3, 4, 5, and 6. Runoff from this basin sheet flows from the northwest to the southeast, crossing the west property line of the site at **DP 9**. The runoff will continue to sheet flow through Basin EX-6 to the south until entering the existing drainage swale on the southern boundary of Basin EX-6 at **DP 11**.

**Basin OS-3** (10.62 AC,  $Q_5 = 4.7$  cfs,  $Q_{100} = 22.7$  cfs) is associated with The Meadows Filing No. 1 lot 11 and The Meadows Filing No. 2 Lots 1 & 2. Runoff from this basin sheet flows from the northwest to the southeast, crossing the west property line of the site at **DP 10**. The runoff will continue to sheet flow through Basin EX-6 to the south until entering the existing drainage ditch on the southern boundary of Basin EX-6 at **DP 11**.

**Basin OS-4** (4.46 AC,  $Q_5 = 5.6$  cfs,  $Q_{100} = 14.0$  cfs) is associated with The Bent Grass Residential Filing No. 2, lots 152-160, lots 163-168, Tract D, and portions of Thedford Court & Willmore Drive. Runoff from this basin flows via curb & gutter south on Thedford Court then continues flowing west along the northern curb & gutter along Willmore Drive before discharging into southeast corner of Basin EX-2 at **DP 1**.

**Basin OS-5** (0.46 AC,  $Q_5 = 1.1$  cfs,  $Q_{100} = 2.3$  cfs): is associated with The Bent Grass Residential Filing No. 2, lots 161 & 162 along with a portion of Silky Thread Road. Runoff from this basin generally flows to the west via curb & gutter along Silky Thread Road before discharging into the northeast corner of Basin EX-2 at **DP 2**.

**Basin OS-6** (1.17 AC,  $Q_5 = 2.0$  cfs,  $Q_{100} = 4.3$  cfs): is associated with The Bent Grass Residential Filing No. 2, the northern halves of Lots 170-178 and a portion of the southern side of Willmore Drive. Runoff from this basin generally flows to the west via curb & gutter along Willmore Drive before discharging into the northeast corner of Basin EX-3 at **DP 3**.

- Basins E-1 thru E-5 are basins from the Bent Grass Filing No. 2 report, which are within the Falcon Meadows project area. The basins were “developed” as part of the Filing No. 2 project and retain the same basin and flow characteristics. Brief summaries from the Filing No. 2 report are included here for reference.

**Basin E-1** (1.71 AC,  $Q_5 = 3.6$  cfs,  $Q_{100} = 7.7$  cfs): a basin that is east of Falcon Meadows and encompasses the north portion of Bent Grass Meadows Drive. A high point on the far East of the basin at the near the Filing No. 2 boundary, forces water to flow to a low point at **DP-8**, which represents an existing 20' CDOT Type R sump inlet, which conveys stormwater via proposed 36" RCP storm sewer to the existing Filing No. 2 north water quality detention pond. Emergency overflow will spill over the crown of the road and enter into an existing 10' CDOT Type R sump inlet on the south side of Bent Grass Meadows Drive.

**Basin E-2** (0.68 AC, Q5 = 2.4 cfs, Q100 = 4.6 cfs): a basin that is in west of Basin E-1 and encompasses a portion of the north section Bent Grass Meadows Drive. A high point on the far West of the basin forces water to flow to a low point at **DP-8**, which represents an existing 20' CDOT Type R sump inlet, which conveys stormwater via a proposed 36" RCP storm sewer to the existing Filing No. 2 north water quality detention pond. Emergency overflow will spill over the crown of the road and enter into an existing 10' CDOT Type R sump inlet on the south side of Bent Grass Meadows Drive.

**Basin E-3** (0.78 AC, Q5 = 2.9 cfs, Q100 = 5.3 cfs): a basin that is south of Basin E-2 and encompasses a portion of the south half of Bent Grass Meadows Drive. A high point on the far West of the basin forces water to flow to a low point, which is an existing 10' CDOT Type R sump inlet, which conveys stormwater via an existing 24" storm sewer to **DP-8**. This inlet receives emergency overflow from DP-8.

**Basin E-4** (0.91 AC, Q5 = 3.0 cfs, Q100 = 5.7 cfs): a basin that is in the Southwest area of the Bent Grass Filing No. 2 site and encompasses a portion of the north and west sections of Bent Grass Meadows Drive. Runoff from this basin is captured by existing curb and gutter and then routed South where the 5 yr. and 100 yr. flows will be captured by an existing 25' CDOT Type R (1-10' and 1-15' inlet) on-grade inlet, **DP-24**. Captured flow will be routed by a 24" RCP storm drain piped to DP-25. A temporary water quality facility will treat this flow for the Bent Grass Filing No. 2 development and will remain in place until further development occurs.

**Basin E-5** (0.89 AC, Q5 = 3.3 cfs, Q100 = 6.1 cfs): a basin that is in the Southwest area of the site and encompasses a portion of south and east sections Bent Grass Meadows Drive. Runoff from this basin is captured by existing curb and gutter and then routed South where the 5 yr. and 100 yr. flows will be captured by a proposed 25' CDOT Type R (1-10' and 1-15' inlet) on-grade inlet, **DP-25**. Captured flow will be routed by a 24" RCP storm drain piped to an outfall at DP-26, where a temporary sediment basin will provide water quality for the basin. Flows will then be routed East by Existing Swale – F until out-falling into RWT210.

**Design Point CC** is the location in channel reach RWT210, where flows exit the Bent Grass Site, including the offsite flows from RWT202, RWT204 and WT200. The minor flow is 272.5 cfs and the major flow is 1209.6 cfs based on the rational flows. The MDDP has minor flows exiting the site of 269 cfs and major flow of 1041 cfs based on SCS calculations in the HEC-HMS model.

## VI. Four Step Process

The Four Step Process is used to minimize the adverse impacts of urbanization and is a vital component of developing a balanced, sustainable project. Below identifies the approach to the four-step process:

### 1. Employ Runoff Reduction Practices

This step uses low impact development (LID) practices to reduce runoff at the source. Generally, rather than creating point discharges that are directly connected to impervious areas runoff is routed through pervious areas to promote infiltration. The Impervious Reduction Factor (IRF) method was used and calculations can be found in Appendix B.

### 2. Stabilize Drainageways

This step implements stabilization to channels to accommodate developed flows while protecting infrastructure and controlling sediment loading from erosion in the drainageways. Erosion protection in the form of riprap pads at all outfall points to the channel to prevent scouring of the channel from

point discharges. A HEC-RAS model will be created and used to evaluate the stability of the existing and proposed channels as part of the Final Drainage Report for the next phase of the site.

### **3. Provide Water Quality Capture Volume (WQCV)**

This step utilizes formalized water quality capture volume to slow the release of runoff from the site. The EURV volume will release in 72 hours, while the WQCV will release in no less than 40 hours. On-site water quality control volume detention ponds will provide water quality treatment for all but 0.86 acres of the developed areas, prior to the runoff being released into the channel. For this area of the project, maintenance access could not be obtained if a swale was utilized, therefore the basin is being allowed to release directly to the channel. Per conversations with County staff, this is acceptable. Refer to WQCV Plan in Appendix D.

### **4. Consider Need for Industrial and Commercial BMPs**

As this project as all residential development and no commercial or industrial development is proposed, there will be no need for any specialized BMPs which would be associated with an industrial or commercial site.

## **VII. Proposed Drainage Conditions**

There have been very minor changes to the overall Falcon Area Basin delineation with the proposed condition. This will be discussed with the individual basins. All necessary calculations can be found within the appendices of the report.

According to the DBPS, there are two channels that run through the site. As was discussed within the Existing Conditions portion of the report both the RWT202 and RWT204 run through the site. In the Bent Grass Filing No. 2 report & CD's, the RWT202 channel was rerouted to run along the north boundary & combine with the existing RWT204 channel. The proposed development will drain to the RWT204 channel, which becomes RWT210 south of Bent Grass Meadows Drive.

The site will provide one WQCV Detention Pond, South Pond, to provide water quality treatment prior to discharging the runoff directly into the West Tributary channel RWT204 - RWT210. This location will have a temporary sediment basin (Temporary Basin South), until the full EDB WQ structure is built with Falcon Meadows Filing No. 1.

As has been mentioned previously, the site is proposed to be single family residential. The site has been designed to provide a large lot buffer between the existing large lots to the north and west of the site and the proposed site. Beyond this buffer, the remainder of the site is smaller, approximately 1/8 acre lots.

**Basin OS-1** (32.28 AC, Q5 = 15.1 cfs, Q100 = 65.1 cfs) is associated with The Meadows Filing No. 3 lots 14, 15, 16, and 17. Runoff from this basin sheet flows to the northern property line of the site and then flows, via an existing drainage swale, into the existing channel reach RWT204 from the Falcon DBPS at **DP 21**.

**Basin OS-4** (4.46 AC, Q5 = 5.6 cfs, Q100 = 14.0 cfs) is associated with The Bent Grass Residential Filing No. 2, lots 152-160, lots 163-168, Tract D, and portions of Thedford Court & Willmore Drive. Runoff from this basin flows via curb & gutter south on Thedford Court then continues flowing west along the northern curb & gutter along Willmore Drive before discharging into Basin EX-2 at **DP 3**.

**Basin OS-5** (0.46 AC,  $Q_5 = 1.1$  cfs,  $Q_{100} = 2.3$  cfs): is associated with The Bent Grass Residential Filing No. 2, lots 161 & 162 along with a portion of Silky Thread Road. Runoff from this basin generally flows to the west via curb & gutter along Silky Thread Road before discharging into Basin EX-2 at **DP 2**.

**Basin OS-6** (1.17 AC,  $Q_5 = 2.0$  cfs,  $Q_{100} = 4.3$  cfs): is associated with The Bent Grass Residential Filing No. 2, the northern halves of Lots 170-178 and a portion of the southern side of Willmore Drive. Runoff from this basin generally flows to the west via curb & gutter along Willmore Drive before discharging into Basin EX-2 at **DP 3**.

**Basin EX-1** (1.19 AC,  $Q_5 = 0.4$  cfs,  $Q_{100} = 2.5$  cfs): is associated with the northeastern portion of the proposed site east of the existing channel. The basin is currently undeveloped. Runoff from the basin generally flows to the southwest, into Basin EX-2 at **DP 2**.

**Basin EX-2** (1.56 AC,  $Q_5 = 0.5$  cfs,  $Q_{100} = 3.7$  cfs): is along the eastern boundary portion of the proposed site and is south of Basin EX-1, east of the existing channel. The basin is currently undeveloped and receives flows from Basins EX-1, OS-4 & OS-5. Runoff from the basin generally flows to the southeast into Basin EX-3 at **DP 3**.

**Basin EX-3** (0.62 AC,  $Q_5 = 0.2$  cfs,  $Q_{100} = 1.5$  cfs): is along the eastern boundary of the proposed site south of Basin EX-2 and east of the existing channel. The basin currently contains an existing WQCV pond created as part of Bent Grass Residential Filing No. 2. This basin receives flows from **DP 1** and **DP 3**.

**Basin EX-4** (16.80 AC,  $Q_5 = 5.1$  cfs,  $Q_{100} = 34.3$  cfs): is associated with an area south of the north property line and west of the existing channel. Under early grading conditions this basin will sheet flow to the southeast until it releases into the existing drainage channel. Upon development of Falcon Meadows, this area will be treated prior to entering the channel.

**Basin EX-5** (1.11 AC,  $Q_5 = 0.4$  cfs,  $Q_{100} = 2.5$  cfs): is a small basin along the west side of Bent Grass Meadows Drive. Flow will be intercepted by Bent Grass Meadows Drive and conveyed to the east via curb and gutter to an existing CDOT Type R inlet at **DP 8**. This flow will release into the existing BG North pond for WQ treatment.

**Basin EX-6** (16.60 AC,  $Q_5 = 4.7$  cfs,  $Q_{100} = 31.9$  cfs): is along the western boundary of the Falcon Meadows. Basin will be intercepted by an existing swale, Swale E, which conveys flows to a CDOT area inlet at **DP 11**. Flows will then be conveyed to the existing sediment basin.

**Basin EX-7** (1.72 AC,  $Q_5 = 0.5$  cfs,  $Q_{100} = 3.3$  cfs): is a basin along the west side of Bent Grass Meadows Drive, south of Basin EX-5. Flows will be intercepted by Bent Grass Meadows Drive and conveyed curb and gutter to the south to an existing CDOT Type R inlet at **DP 24**. Flows will be treated by the existing interim sediment basin along Bent Grass Meadows Drive.

**Basin B-1** (5.62 AC,  $Q_5 = 1.5$  cfs,  $Q_{100} = 10.1$  cfs): a basin that is in the north-center of the site and encompasses the existing rerouted channel RWT202 and existing improved channel RWT204. Flows will sheet flow into the existing channel where they will then be conveyed to **DP AA**.

**Basin OS-2** (20.07 AC,  $Q_5 = 9.0$  cfs,  $Q_{100} = 43.4$  cfs): is associated with The Meadows Filing No. 1 lots 1, 2, 3, 4, 5, and 6. Runoff from this basin sheet flows from the northwest to the southeast, crossing the west property line of the site at **DP 9**. Flows will then be conveyed via a proposed drainage swale to the south where it will enter Basin D-3 and tie-into the existing drainage swale along the southern boundary of Basin D-3. It will then continue flowing east before entering an existing area inlet at **DP 11** where it will be piped, ultimately outfalling into the proposed south WQCV pond at **DP 30**.



**Basin OS-3** (10.61 AC, Q5 = 4.7 cfs, Q100 = 24.3 cfs): is associated with The Meadows Filing No. 1 lot 11 and The Meadows Filing No. 2 Lots 1 & 2. Runoff from this basin sheet flows from the northwest to the southeast, crossing the west property line of the site into Basin D-3 at **DP 10**. Flows will then be conveyed via an existing drainage swale to the east where it will enter an existing area inlet at **DP 11** where it will be piped, ultimately outfalling into the proposed south WQCV pond at **DP 30**.

**Basin D-4** (2.11 AC, Q5 = 8.1 cfs, Q100 = 14.6 cfs): a basin that is east of Bent Grass Meadows Drive. It encompasses single-family residential lots, Rowena Way, & portions of Linley Way, Jayla Trail, and Henzlee Place. Runoff will flow from each lot onto the proposed public R.O.W. where proposed mountable curb and gutter will convey flows to **DP 17**. Overflow from this 30' inlet would be to overtop the curb and then continue via a proposed swale, following the same path as the proposed pipe, to the east until flows are released into the proposed south water quality pond. Flows will then enter a proposed sump CDOT Type 'R' inlet where it will then be piped and ultimately outfall in the proposed south WQCV pond at **DP 31**.

**Basin D-5** (1.08 AC, Q5 = 2.2 cfs, Q100 = 4.6 cfs): a basin that is located at the southwest corner of Bent Grass Meadows Drive and Henzlee Place. It includes residential lots, as well as a portion of the north half of Nico Way and west half of Henzlee Place. Flows will be directed towards the public R.O.W. where proposed curb and gutter will convey flows to the south along Henzlee Place to **DP 18**. Flows will then enter a proposed 30' CDOT Type 'R' inlet where it will then be piped and ultimately outfall in the proposed south WQCV pond at **DP 31**.

**Basin D-6** (4.01 AC, Q5 = 8.2 cfs, Q100 = 17.2 cfs): a basin that is south of Basin D-5 & east of Basin D-4. It encompasses single-family residential lots & half of Linley Way, Jayla Trail, Henzlee Place, & Nico Way. Runoff will flow from each lot onto the proposed public R.O.W. where proposed mountable curb and gutter will convey flows to **DP 18**. Flows will then enter a proposed sump CDOT Type 'R' inlet where it will then be piped and ultimately outfall in the proposed south WQCV pond at **DP 31**.

**Basin D-7** (4.42 AC, Q5 = 2.9 cfs, Q100 = 11.3 cfs): a basin that is in the south end of the site, east of Bent Grass Meadows Drive & west of the existing channel. It encompasses the back half of several single-family residential lots as well as the proposed south WQCV pond. Runoff will flow, via sheet flow, until it enters a temporary drainage swale and is conveyed to the proposed south WQCV pond or will directly flow into the proposed south WQCV pond.

**Basin D-8** (2.74 AC, Q5 = 0.9 cfs, Q100 = 6.0 cfs): a basin that is west of the existing channel & south of Bent Grass Meadows Drive. It encompasses the back half of single-family residential lots. Runoff will flow from each lot and discharge into the existing channel. Upon development of the site, this basin will be directed, via a drainage swale, to the proposed south WQ pond.

**Basin D-9** (3.20 AC, Q5 = 1.7 cfs, Q100 = 7.5 cfs): a basin that is located at the northeast corner of Bent Grass Meadows Drive and the south property line. Basin consists of an existing temporary sediment basin and drainage swale, Swale F. Flows from this basin will combine with DP 11 and convey flows to the drainage channel. Upon development of Falcon Meadows Filing No. 1, this flow will be re-routed to be treated through the proposed South WQ pond facility.

**Basin B-2** (1.17 AC, Q5 = 0.4 cfs, Q100 = 2.4 cfs): a basin that is in the south area of the site and encompasses the existing channel RWT210. Flows will sheet flow into the existing channel where they will then be conveyed to **DP CC** exiting the site.

Basins E-1 thru E-5 are the same as discussed under the Existing Conditions Section, as these basins represent the already built Bent Grass Meadows Drive through the proposed site.

Basin RWT202 (1574.4 AC, Q5 = 200 cfs, Q100 = 1000 cfs), RWT204 (38.4 AC, Q5 = 7 cfs, Q100 = 43 cfs) and WT200 (192 AC, Q5 = 52 cfs, Q100 = 190 cfs) represent larger offsite basins to the north of the proposed project. These areas were studied as part of the Falcon Basin DBPS prepared by Matrix and were also part of the Bent Grass MDDP, submitted for review in January. There have been no changes to these basins as they represent final developed offsite flows. **DP 21** is the routing of all these flows as they enter the Bent Grass property at the north. 5-year flow is 277.8 cfs and 100-year flow is 1226.8 cfs.

**Design Point CC** is the location in channel reach RWT210, where flows exit the Bent Grass Site, including the offsite flows from RWT202, RWT204 and WT200. The minor flows are 271.4 cfs and the major flows are 1183.5 cfs. The DBPS HEC-HMS model has a 100-year developed flow of 1200 cfs in channel reach RWT210, which is the location where flows exit the Bent Grass property.

## VIII. Storm Sewer System (FOR INFORMATION ONLY)

All development is anticipated to be urban and will include storm sewer & street inlets. Storm sewers collect storm water runoff and convey the water to water quality facilities prior to discharging. Storm sewer systems will be designed to the 100-year storm and checked with the 5-year storm. Inlets will be placed at sump areas and intersections where street flow is larger than street capacity. UDFCD Inlet spreadsheet has been used to determine the size of all at-grade and sump inlets. There will be a minimum of 3 proposed storm systems within the site. One will collect flows on the north and east side of the project, prior to entering Bent Grass Meadows Drive. Intercepted flows will be released into the Bent Grass Filing No. 2 existing North water quality pond. Any bypass flows will travel west in Bent Grass Meadows Drive to an existing storm system in the roadway.

The second system will collect the north and west portion of the site, intercepting flows prior to entering Bent Grass Meadows Drive. These flows will be released into the proposed North water quality pond. Any flows bypassed from the storm system will enter Bent Grass Meadows Drive and travel east to the existing storm sewer system and enter the existing Bent Grass Residential Filing No. 2 North pond.

The final proposed system will be designed for the remaining south and west portion of the project. Flows intercepted by inlets will be released into the proposed South water quality pond. The system will consist of reinforced concrete pipes, CDOT Type R & Area Type C & D inlets.

Final drainage report will include details concerning inlet location, street capacity, storm sewer sizing, outlet protection and location.

## IX. Proposed Water Quality Detention Ponds

Two Water Quality Capture Volume Detention Ponds will be provided for the proposed site. One will be provided for the area north of Bent Grass Meadows Drive (future construction) and the other will be provided for the area to the south. The south pond temporary sedimentation basin will be constructed in conformance with water quality requirements with the early grading. Both ponds are private and will be maintained by Bent Grass Metro District. These detention ponds will only provide water quality. The EURV and 100-year volumes will be conveyed via the emergency overflow weir, which will be lined. The water quality volume release will be controlled with an orifice plate that will release in 40 hours. Outlet structures, forebays, trickle channels, etc. will be designed with the final drainage report during final plat.



The required WQCV volume of the North & South pond are 0.289 acre-feet & 0.875 acre-feet, relatively. The north water quality pond will release into RWT204 and the south will release into RWT210. Initial sizing of the ponds has been provided in Appendix C. With the Falcon Meadows development, there have been minor drainage revisions to flows being routed to the existing Bent Grass North Pond. The required WQCV volume increased to 0.378 ac-ft. The existing pond has more than adequate volume to handle this increase. Refer to Appendix C for analysis of the existing pond.

## **X. Proposed Channel Improvements**

The channel design is anticipated to have a series of Grouted Sloping Boulder Drops within it. Final design and details of the channel and associated structures will be provided with the corresponding Final Drainage Reports.

Riprap protection will be provided at the individual outfalls from the site into the channel to prevent scouring from the point discharges if velocity constraints are not met.

Improvements to the existing channel are outlined in the Master Development Drainage Plan for Bent Grass Residential Subdivision (MDDP). As part of this development, improvements outlined in the MDDP for the existing channel will be implemented. At this time, it is assumed that the DBPS recommended channel improvements will be sufficient to handle the final developed channel flow. At the time of final design of the channel, if it is determined that additional improvements are necessary, they will be designed at that time and will be incorporated into the corresponding Final Drainage Report for the channel improvements.

For channel improvements offsite of the Bent Grass property, specifically south of the development, it is determined that the developer will build the remaining channel improvements to Woodmen Road, if after a pre-determined amount of the time, the current property owners have not initiated any of the improvements themselves. Or the developer may work with the current property owners to reach a pre-approved agreement on design/construction, costs and timing of these channel improvements, which would need to be "in-place" prior to the approval for the first plat of the Falcon Meadows at Bent Grass development. An agreement and schedule will be in place prior to approval of Falcon Meadows at Bent Grass Filing No. 1.

## **XI. Maintenance (FOR INFORMATION ONLY)**

The proposed channels are to be public facilities. A buffer has been provided along the north boundary of the site between the rerouted channel RWT202 and the back of the proposed lots. After completion of construction and upon the Board of County Commissioners acceptance the West Tributary channel is anticipated to be owned and maintained by El Paso County along with all drainage facilities within the public Right-of-Way. Swale D, which is located along the west property line, will run through a proposed tract through the back of several residential lots. The swale will be maintained by the Bent Grass Metro District.

The existing swale along the north property line, built as part of Bent Grass Filing No. 2, will have a maintenance access road constructed beginning at the north end of the Lemon Grass Road cul-de sac to be maintained by the district.

## **XII. Wetlands Mitigation**

No wetlands are located on site.

## **XIII. Floodplain Statement**

A portion of the project site lies within Zone AE Special Flood Hazard Area as defined by the FIRM Map number 08041C0553G effective December 7, 2018. A copy of the FIRM Panel is included in Appendix A.

The portion of channel that has a floodplain designation is only the RWT210 and RWT204 portions of the channel. It is unknown why the western channel, RWT202 is unmapped since it is the larger contributor regarding flow rates. Discussions have occurred with PPRBD and a no rise certificate will be required for the existing channel. Models have been obtained from FEMA which show that the FEMA discharges are higher than the DBPS. Therefore, the culvert crossing at Bent Grass Meadows Parkway has been sized per the FEMA flows and not the DBPS. The no rise certification will be provided under a separate report.

The focus of the early site grading will be located south of Bent Grass Meadows Drive. The grading will maintain 50 feet from the northern property line and the channel to the east.

## **XIV. Drainage Fees**

Falcon Basin is part of the El Paso County drainage basin fee program all applicable fees will be presented in the final drainage report.

A presentation of accurate, complete, and current estimate of cost for proposed facilities will be presented with the final drainage report.

## **XV. Conclusion**

The Falcon Meadows at Bent Grass residential subdivision lies within the West Tributary of the Falcon Area Watershed. Recommendations are made within this report to establish and stabilize multiple drainageways through the project site. Water quality for the overall PUDSP site is provided in two on-site WQCV ponds, North Pond & South Pond. All drainage facilities within this report were sized according to the El Paso County Drainage Criteria Manuals. The West Tributary channel segment is proposed to be publicly owned and maintained and shall be the responsibility of El Paso County upon completion of the required improvements. The two WQCV ponds and all of the swales will be maintained by Bent Grass Metro District. A Final Drainage Report will be submitted along with the final plat and construction drawings. Early grading will not cause adverse impacts to downstream properties and future development will implement the channel improvements mentioned, as finalized in the Final Drainage Report.

## **XVI. References**

1. *City of Colorado Springs/County of El Paso Drainage Criteria Manual*, October 1991.
2. *Drainage Criteria Manual, Volume 2*, City of Colorado Springs, November 2002.
3. *Urban Storm Drainage Criteria Manual*, Urban Drainage and Flood Control District, January 2016 (with current revisions).
4. *Falcon Drainage Basin Planning Study*, by Matrix Design Group, September 2015.
5. *Master Development Drainage Plan and Preliminary Drainage Plan – Bent Grass Subdivision*, by Kiowa Engineering Corporation, December 2006.

6. *Final Drainage Report for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2014.
7. *Final Drainage Report Addendum for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2015.
8. *Master Development Drainage Plan for The Ranch*, by Classic Consulting Engineers & Surveyors, LLC, November 2018.
9. *Falcon Highlands Master Development Drainage Plan & Preliminary Drainage Report & Final Drainage Report for Filing 1*, by URS, January 2005.
10. *Final Drainage Report and Erosion Control Plan – Latigo Business Center Filing No. 1 A Re-subdivision of a Portion of Latigo Business and Research Center Filing No. 1*, by Kiowa Engineering Corporation, November 2004.
11. *Final Drainage Report for Bent Grass Residential (Filing No. 2)*, by Galloway & Company, May 2020.

**APPENDIX A**  
**Exhibits and Figures**





# FALCON MEADOWS AT BENT GRASS

BENT GRASS MEADOWS DRIVE

SCALE: 1"=2,000'

## VICINITY MAP

Project No: CLH000017.20

Drawn By: TJE

Checked By: CMD


Date: 06/19/2020

**Galloway**


1155 Kelly Johnson Blvd., Suite 305  
Colorado Springs, CO 80920  
719.900.7220 • [GallowayUS.com](http://GallowayUS.com)



# Hydrologic Soil Group—El Paso County Area, Colorado

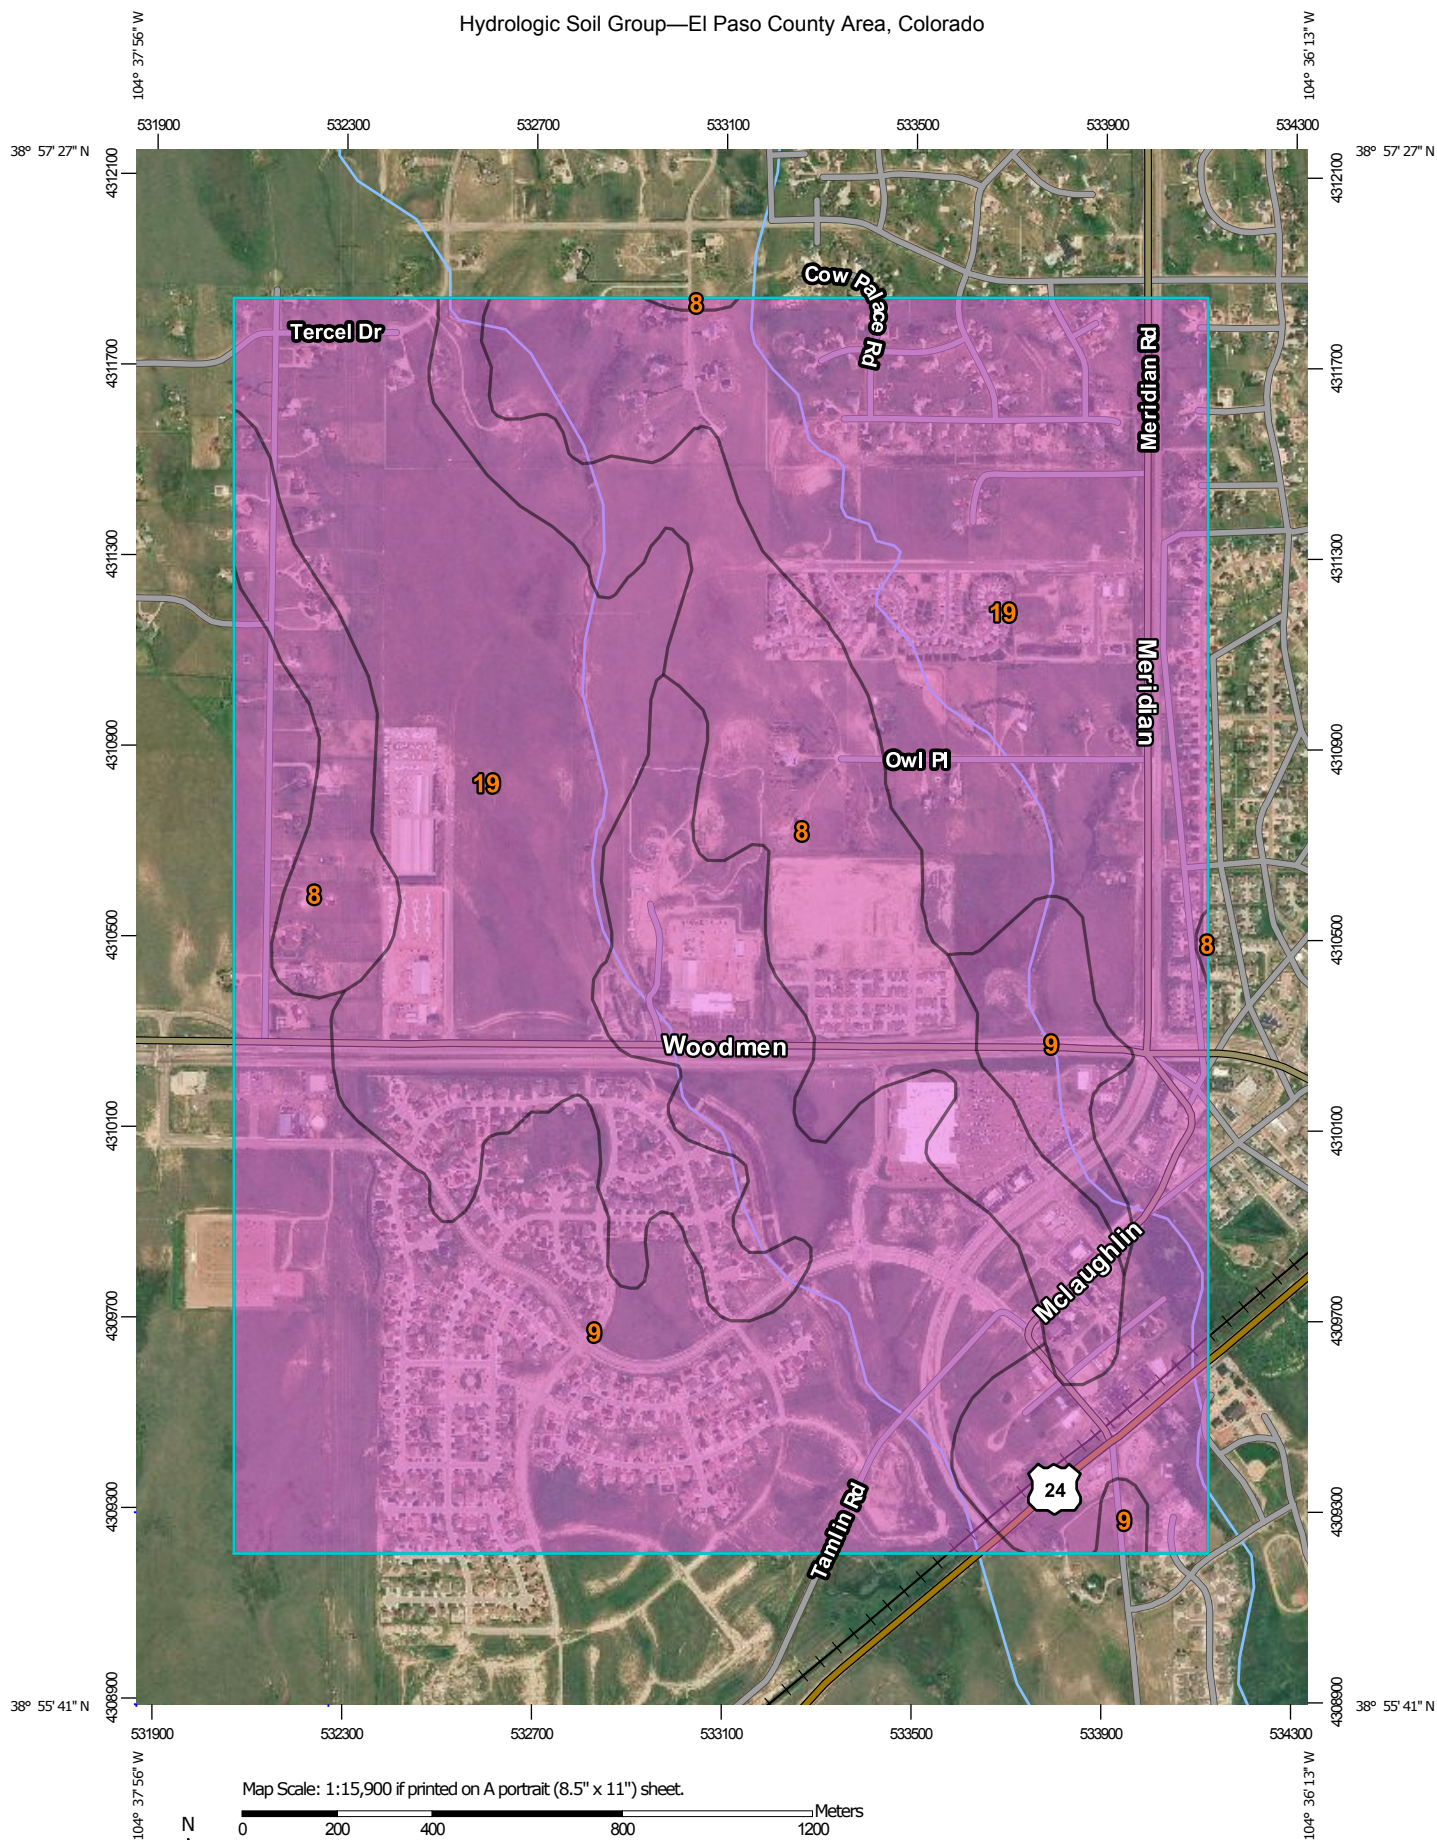

Map Scale: 1:15,900 if printed on A portrait (8.5" x 11") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84



**Natural Resources  
Conservation Service**

Web Soil Survey  
National Cooperative Soil Survey

4/2/2019  
Page 1 of 4


## MAP LEGEND

### Area of Interest (AOI)









 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons





 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines


 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points

 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available


### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado

Survey Area Data: Version 16, Sep 10, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 7, 2016—Aug 17, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	A	214.3	16.0%
9	Blakeland-Fluvaquentic Haplaquolls	A	465.8	34.7%
19	Columbine gravelly sandy loam, 0 to 3 percent slopes	A	662.6	49.3%
<b>Totals for Area of Interest</b>			<b>1,342.6</b>	<b>100.0%</b>

## Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.



## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Higher

## NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The **community map repository** should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

**Coastal Base Flood Elevations** shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the **same vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services  
NOAA, NIMS12  
National Geodetic Survey  
SSMC-3, #9202  
1315 East-West Highway  
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

**Base Map** information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations** and **floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

**Corporate limits** shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.


Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9820 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp>.

El Paso County Vertical Datum Offset Table

Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	

Panel Location Map

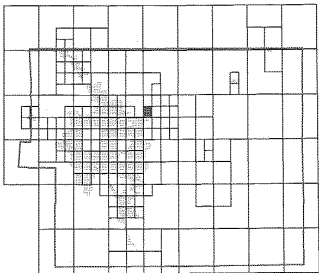

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).



Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

## LEGEND

SPECIAL FLOOD HAZARD AREAS (SFHAs) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

**ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

**ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.

**ZONE D** Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- Floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary

Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.

Base Flood Elevation line and value; elevation in feet\*

Base Flood Elevation value where uniform within zone; elevation in feet\*

\* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

Cross section line

Transect line

Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)

1000-meter Universal Transverse Mercator grid ticks, zone 13

5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPS ZONE 0502), Lambert Conformal Conic Projection

Bench mark (see explanation in Notes to Users section of this FIRM panel)

River Mile

MAP REPOSITORIES

Refer to Map Repositories list on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL

DECEMBER 7, 2018: to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

MAP SCALE 1" = 500'

# FALCON DRAINAGE BASIN PLANNING STUDY

## SELECTED PLAN REPORT

### FINAL - SEPTEMBER 2015

Prepared for:



El Paso County Public Services Department  
3275 Akers Drive  
Colorado Springs, CO 80922

Prepared By:




Matrix Design Group  
2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920


Matrix Project No. 10.122.003



FILE: G:\gis\_projects\Falcon\_Creek\_DBPS\active\apps\20110613\basin\_map.mxd, 8/29/2011, wilson\_wheeler

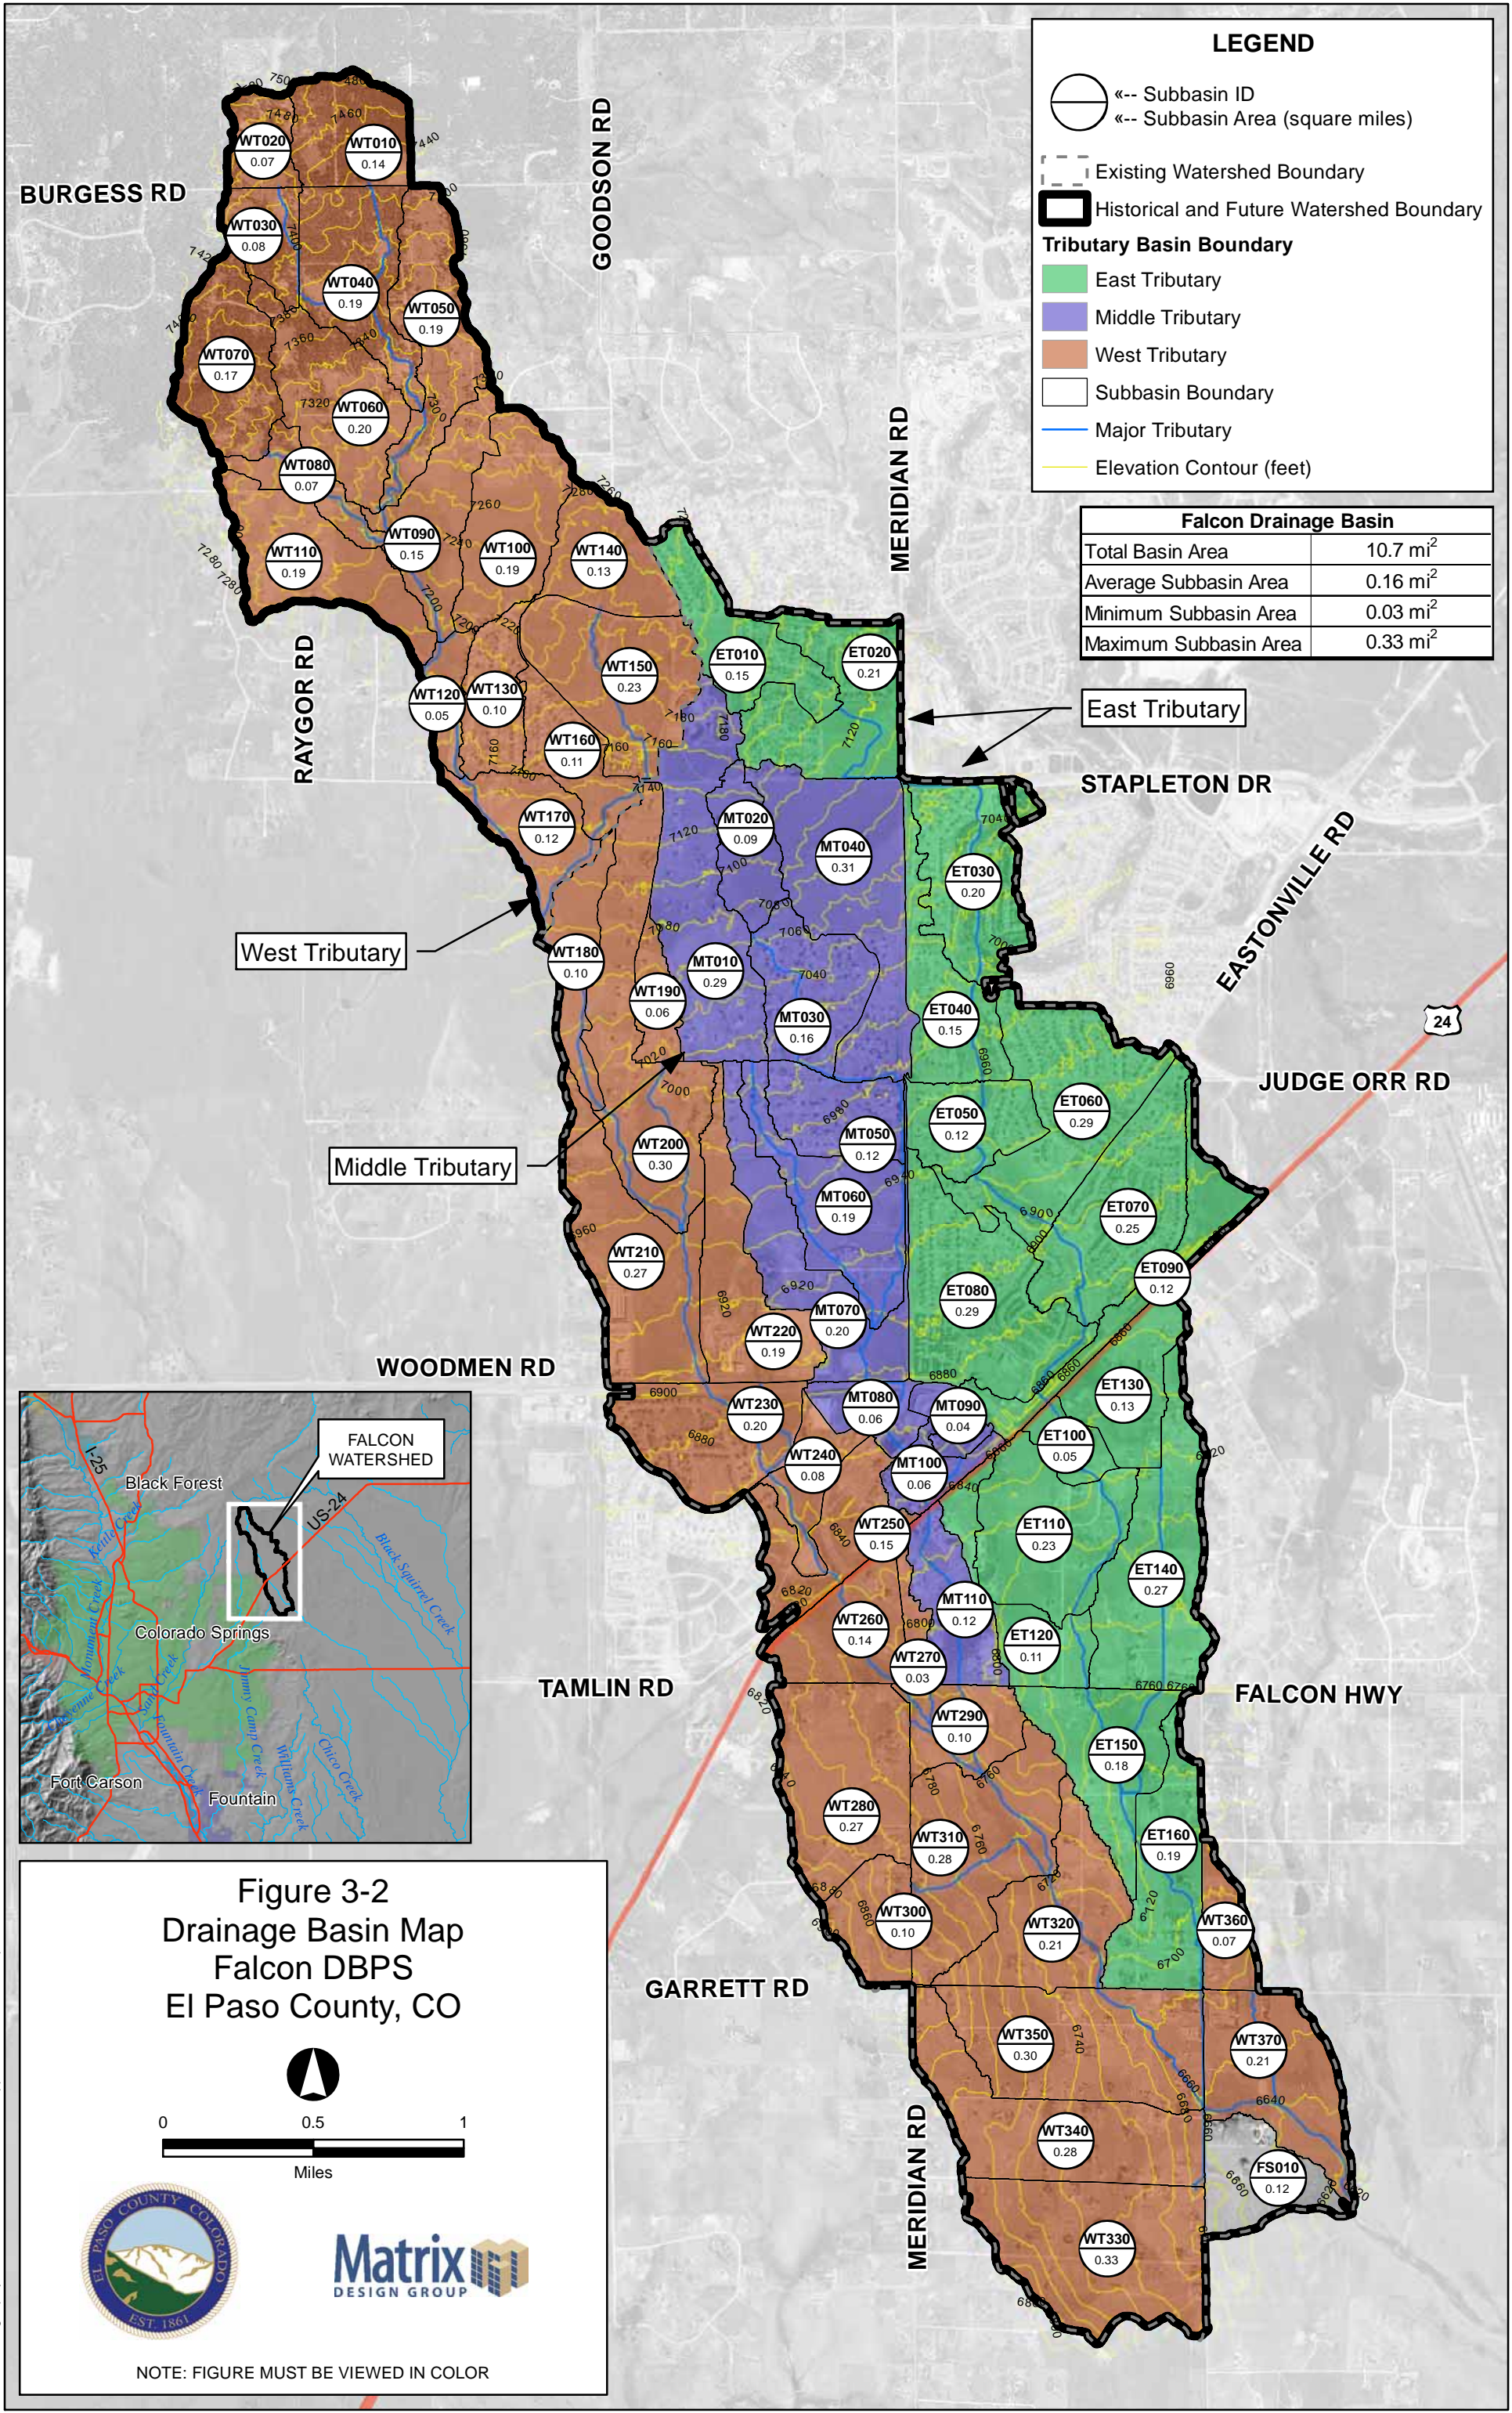



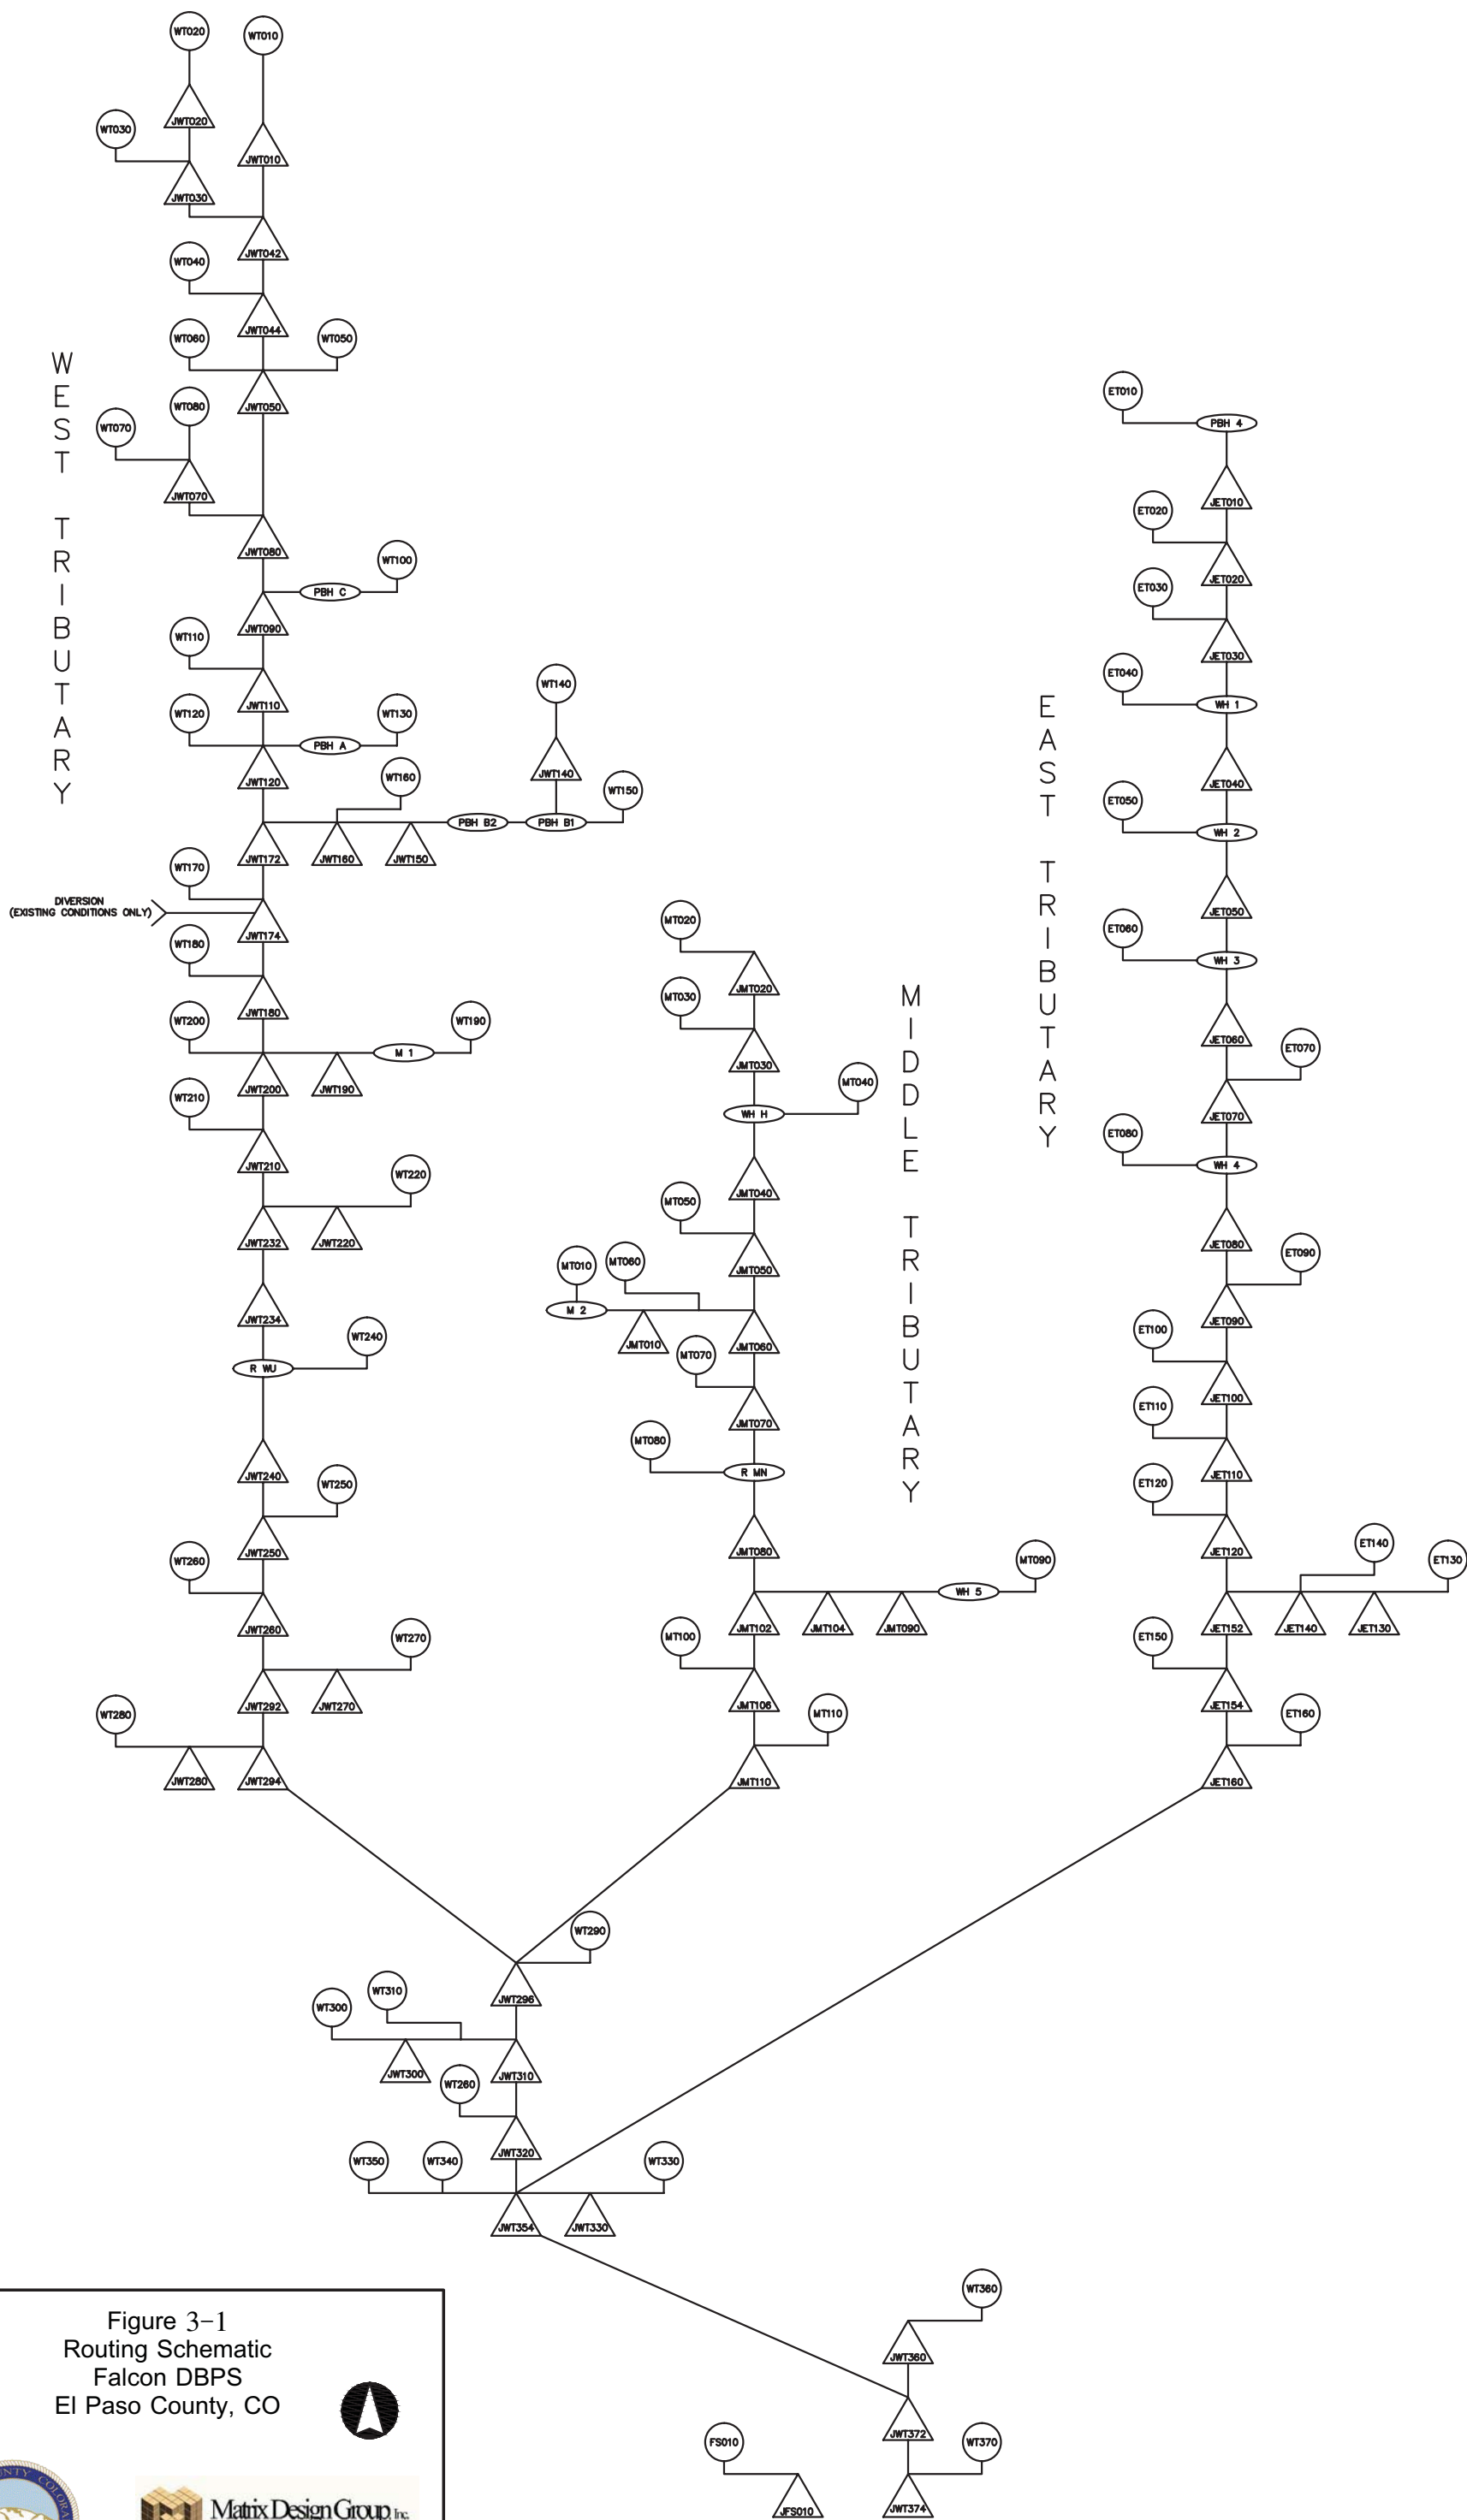

DRAWING NOT TO SCALE



BURGESS RD

GOODSON RD

STAPLETON DR

EASTONVILLE RD

JUDGE ORR RD

WOODMEN RD

TAMLIN RD

GARRETT RD

MERIDIAN RD

FALCON HWY

Sub Regional Detention Alternative <sup>1</sup>						
Pond		Q <sub>2</sub> In (cfs)	Q <sub>2</sub> Out (cfs)	Q <sub>100</sub> In (cfs)	Q <sub>100</sub> Out (cfs)	Required Volume (AF) <sup>2</sup>
Paint Brush Hills Pond #4	PBH 4	38	29	200	150	1.34
Paint Brush Hills Pond A	PBH A	35	7	170	140	2.62
Paint Brush Hills Pond B1	PBH B1	80	51	420	270	9.17
Paint Brush Hills Pond B2	PBH B2	51	10	270	180	12.09
Paint Brush Hills Pond C	PBH C	56	3	300	140	6.77
Regional Pond MN	R MN	65	32	850	820	7.53
Regional Pond R1	R R1	110	77	1,600	1,500	25.00
Regional Pond R2	R R2	140	140	2,100	2,100	7.90
Regional Pond WU South	R WU	47	22	1,070	930	39.54
Sub Regional Pond SR1	SR 1	54	42	610	510	11.03
Sub Regional Pond SR2	SR 2	65	65	840	840	2.05
Sub Regional Pond SR3	SR 3	72	72	910	910	1.03
Sub Regional Pond SR4	SR 4	130	27	1,000	730	19.37
Sub Regional Pond SR6	SR 6	74	9	390	200	11.82
The Meadows Pond #1	M 1	11	0	75	2	3.25
The Meadows Pond #2	M 2	28	5	210	99	7.94
Woodmen Hills Pond #1 North	WH 1N	65	61	390	260	7.13
Woodmen Hills Pond #1 South	WH 1S	61	10	260	260	8.78
Woodmen Hills Pond #2	WH 2	37	10	270	250	9.18
Woodmen Hills Pond #3	WH 3	105	13	530	360	8.35
Woodmen Hills Pond #4	WH 4	110	15	790	260	40.45
Woodmen Hills Pond #5	WH 5	40	1	130	19	4.10
Woodmen Hills Pond H	WH H	140	110	750	750	2.66

Notes


1: Represents future hydrology with retrofit existing detention ponds and 5 new subregional detention ponds

2: Required volume to highest WSE


Reach Alternative	Total (ft)
Protect In Place	30,066
Natural Channel Design	32,359
Small Drop Structures w/ Toe Protection	76,812
Large Drop Structures w/ Toe Protection	0

LEGEND


Detention Pond




 Existing




 Proposed




 Existing Watershed Boundary




 Historical and Future Watershed Boundary




 Tributary Basin Boundary



 Subbasin Boundary




 Major Tributary




 Immediate Action Required to Preserve Existing Condition


Reach Alternative



 Protect In Place




 Natural Channel Design



 Small Drop Structures w/ Toe Protection

Figure 5-3  
Sub-Regional Detention Alternative  
Falcon DBPS  
El Paso County, CO

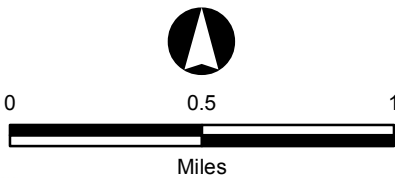


NOTE: FIGURE MUST BE VIEWED IN COLOR



LOT 1



DESIGN POINT	CONTRIBUTING BASINS	TIME OF CONCENTRATION (MINUTES)	Q <sub>5</sub> (CFS)	Q <sub>100</sub> (CFS)
1	DPF-1	22.6	4.1	10.1
2	BASIN 2	5.0	1.2	2.2
3	BASIN 1, BASIN 2	5.2	3.8	7.4
4	DP-3, BASIN 3	5.3	5.6	10.7
5	DP-4, BASIN 6	7.3	6.7	12.9
6	DPF-2	17.5	0.2	0.5
7	DP-6, BASIN 4	7.1	12.5	23.2
8	BASIN 5	5.0	13.6	25.1
9	BASIN 7	6.4	1.0	2.1
10	DP-9, DP-7	7.4	30.9	57.8
11	DP-10, BASIN 7	7.4	31.8	59.6

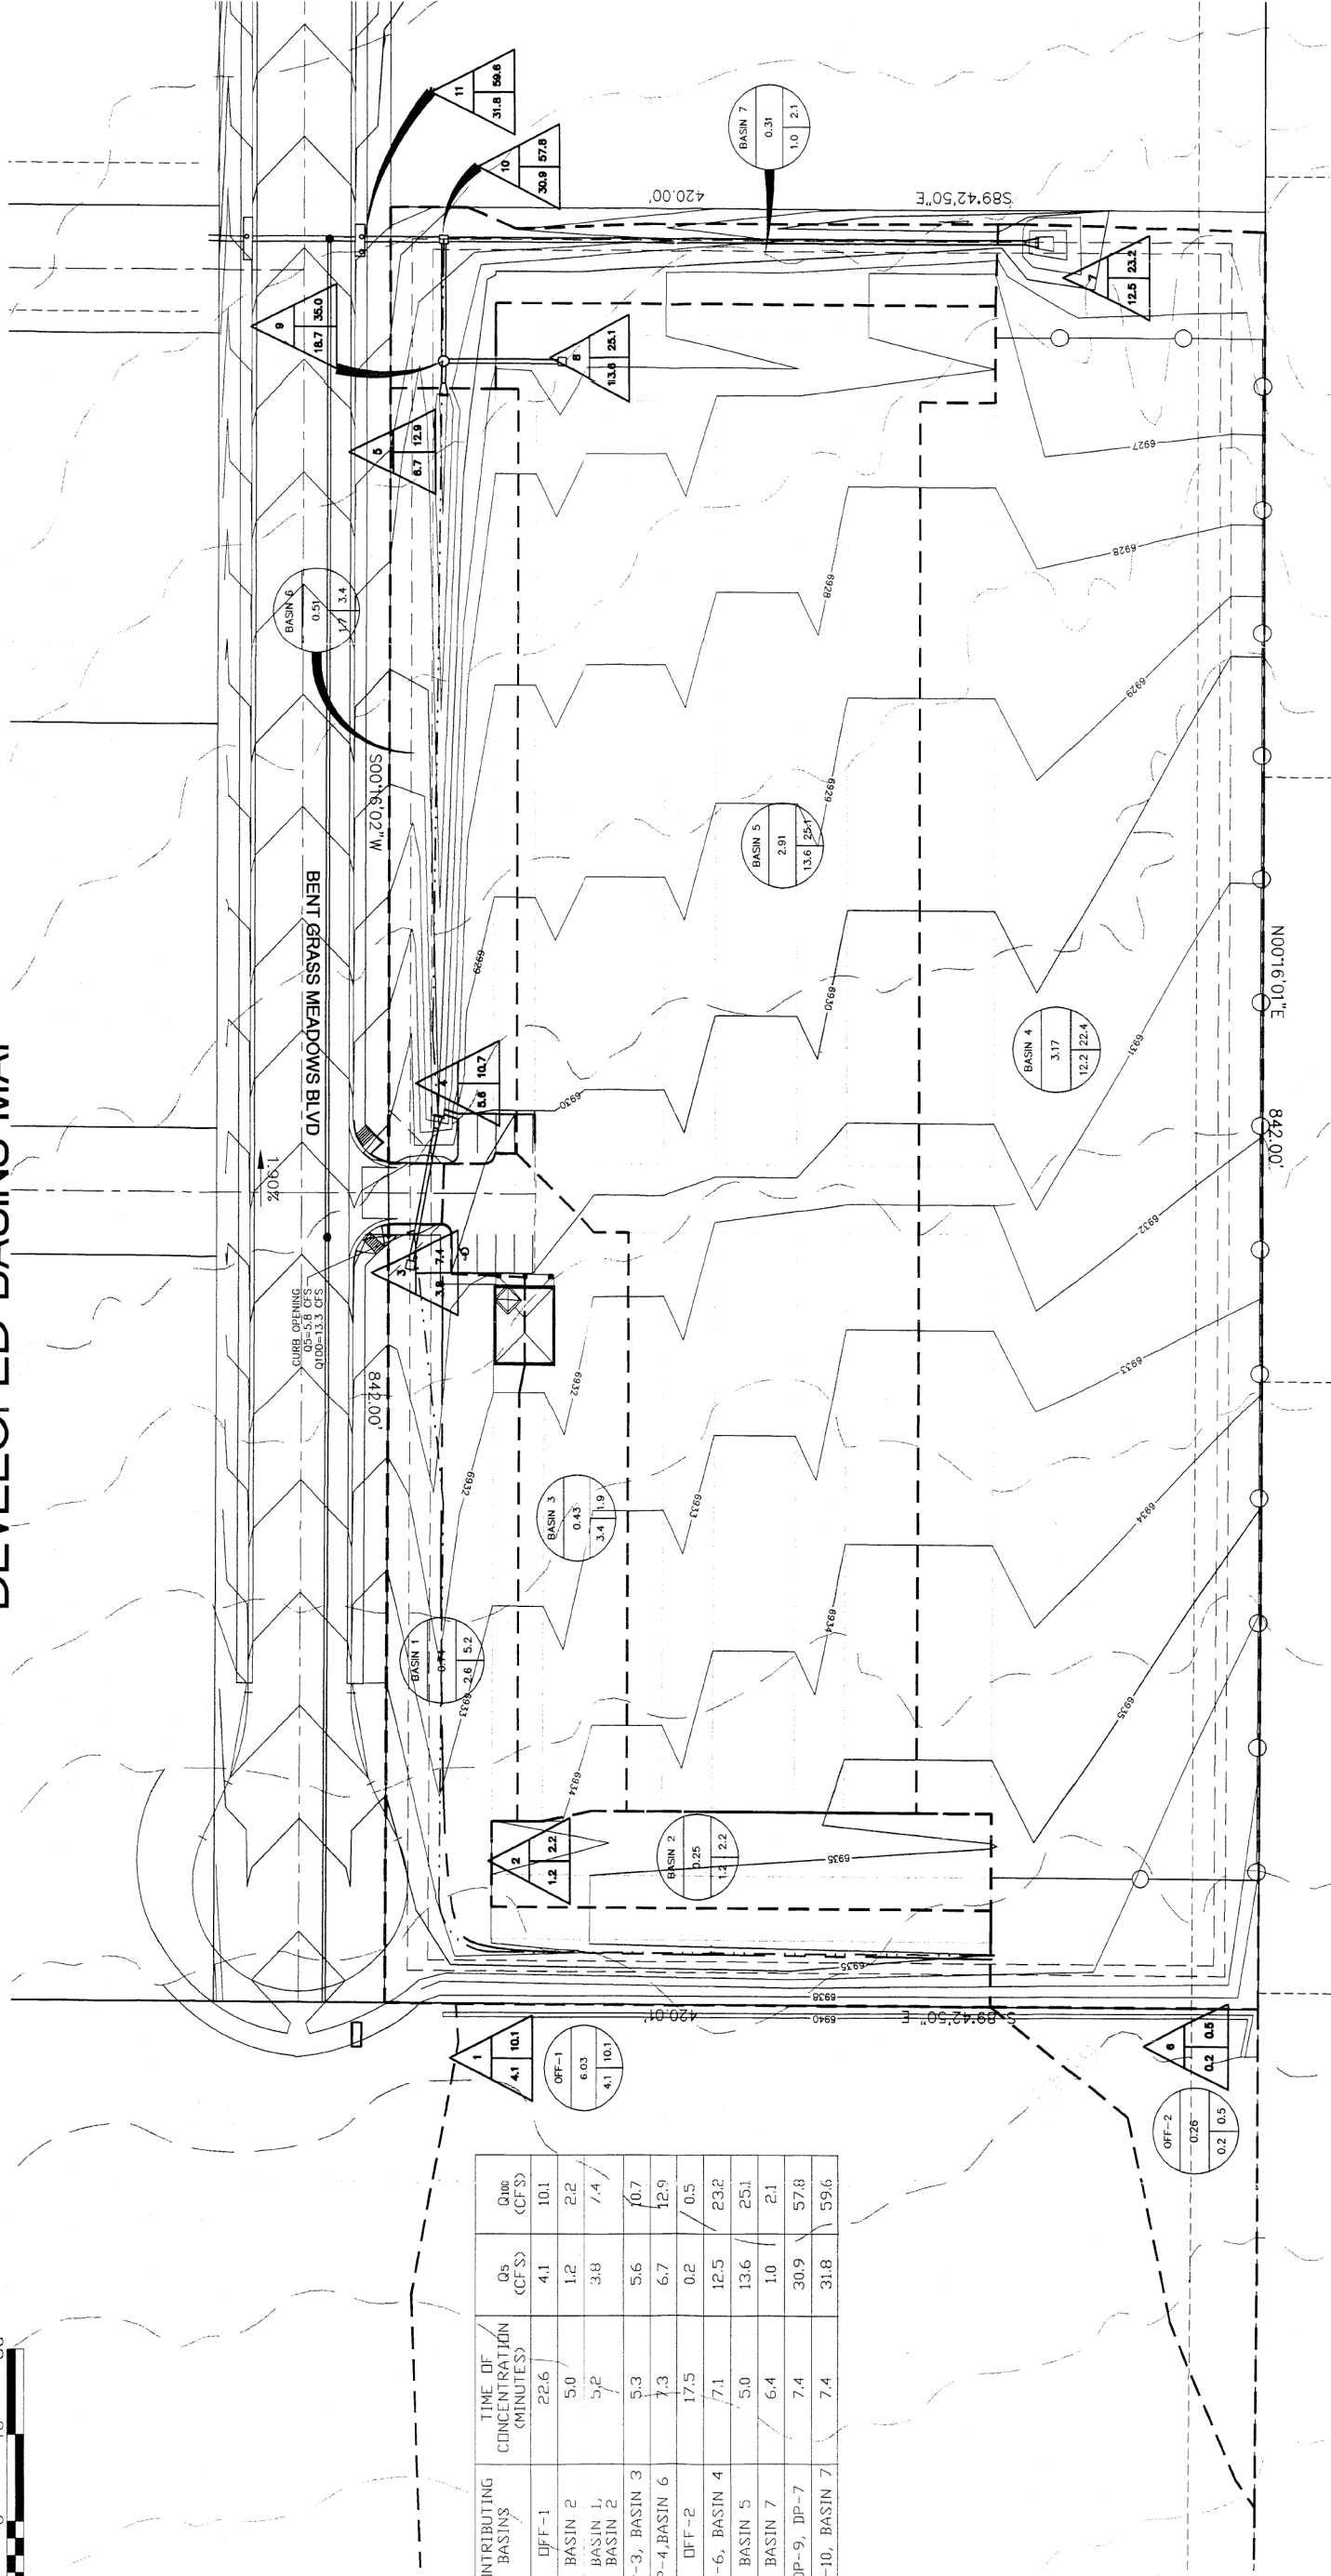

REVISIONS:		ENGINEER:	
NO.	DESCRIPTION	DESIGNED BY: DC	DATE: 7/17/04
		DRAWN BY: DC	DATE: 7/17/04
		CHECKED BY: XXX	DATE: XX/XX/XX
		48 HOURS BEFORE YOU DIG, CALL UTILITY LOCATORS 1-800-922-1987 (CALL LOCATOR PER LIST OF UTILITY COMPANIES)	

ENGINEER: \_\_\_\_\_  
DESIGNED BY: DC DATE: 7/17/04  
DRAWN BY: DC DATE: 7/17/04  
CHECKED BY: XXX DATE: XX/XX/XX

48 HOURS BEFORE YOU DIG,  
CALL UTILITY LOCATORS  
1-800-922-1987  
(SEE COVER FOR LIST OF UTILITY CONTACTS)

PROJECT LATIGO BUSINESS CENTER LOT 1  
SHEET TITLE NA  
FROM \_\_\_\_\_ TO \_\_\_\_\_  
JOB NO. 2004-1 SHEET 2 OF \_\_\_\_\_

**APPENDIX B**  
**Hydrologic Computations**



## Site-Level Low Impact Development (LID) Design Effective Impervious Calculator

### LID Credit by Impervious Reduction Factor (IRF) Method

UD-BMP (Version 3.06, November 2016)

User Input

Calculated cells

---Design Storm: 1-Hour Rain Depth	WQCV Event	0.60	inches
---Minor Storm: 1-Hour Rain Depth	5-Year Event	1.50	inches
---Major Storm: 1-Hour Rain Depth	100-Year Event	2.52	inches
Optional User Defined Storm	CUHP		
(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm	100-Year Event		

Max Intensity for Optional User Defined Storm

0

Designer: CMWJ

Company: Galloway &amp; Co.

Date: February 9, 2021

Project: Falcon Meadows at Bent Grass

Location: North WQ Pond

## SITE INFORMATION (USER-INPUT)

Sub-basin Identifier	C																
Receiving Pervious Area Soil Type	Sandy Loam																
Total Area (ac., Sum of DCIA, UIA, RPA, & SPA)	13.580																
Directly Connected Impervious Area (DCIA, acres)	5.300																
Unconnected Impervious Area (UIA, acres)	2.900																
Receiving Pervious Area (RPA, acres)	0.000																
Separate Pervious Area (SPA, acres)	5.380																
RPA Treatment Type: Conveyance (C), Volume (V), or Permeable Pavement (PP)	C																

## CALCULATED RESULTS (OUTPUT)

Total Calculated Area (ac, check against input)	13.580																
Directly Connected Impervious Area (DCIA, %)	39.0%																
Unconnected Impervious Area (UIA, %)	21.4%																
Receiving Pervious Area (RPA, %)	0.0%																
Separate Pervious Area (SPA, %)	39.6%																
$A_u$ (RPA / UIA)	0.000																
$I_u$ Check	1.000																
$f / I$ for WQCV Event:	1.7																
$f / I$ for 5-Year Event:	0.5																
$f / I$ for 100-Year Event:	0.3																
<b><math>f / I</math> for Optional User Defined Storm CUHP:</b>																	
IRF for WQCV Event:	1.00																
IRF for 5-Year Event:	1.00																
IRF for 100-Year Event:	1.00																
<b>IRF for Optional User Defined Storm CUHP:</b>																	
Total Site Imperviousness: $I_{total}$	60.4%																
Effective Imperviousness for WQCV Event:	60.4%																
Effective Imperviousness for 5-Year Event:	60.4%																
Effective Imperviousness for 100-Year Event:	60.4%																
<b>Effective Imperviousness for Optional User Defined Storm CUHP:</b>																	

## LID / EFFECTIVE IMPERVIOUSNESS CREDITS

WQCV Event CREDIT: Reduce Detention By:	0.0%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
This line only for 10-Year Event	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
100-Year Event CREDIT*: Reduce Detention By:	0.0%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
User Defined CUHP CREDIT: Reduce Detention By:																	

Total Site Imperviousness:	60.4%
Total Site Effective Imperviousness for WQCV Event:	60.4%
Total Site Effective Imperviousness for 5-Year Event:	60.4%
Total Site Effective Imperviousness for 100-Year Event:	60.4%
Total Site Effective Imperviousness for Optional User Defined Storm CUHP:	

Notes:

\* Use Green-Ampt average infiltration rate values from Table 3-3.

\*\* Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.

\*\*\* Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposed

## Site-Level Low Impact Development (LID) Design Effective Impervious Calculator

### LID Credit by Impervious Reduction Factor (IRF) Method

UD-BMP (Version 3.06, November 2016)

User Input

Calculated cells

---Design Storm: 1-Hour Rain Depth	WQCV Event	0.60	inches
---Minor Storm: 1-Hour Rain Depth	5-Year Event	1.50	inches
---Major Storm: 1-Hour Rain Depth	100-Year Event	2.52	inches
Optional User Defined Storm	CUHP		
(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm	100-Year Event		

Max Intensity for Optional User Defined Storm

0

Designer: CMWJ

Company: Galloway &amp; Co.

Date: February 9, 2021

Project: Falcon Meadows at Bent Grass

Location: South WQ Pond

## SITE INFORMATION (USER-INPUT)

Sub-basin Identifier	D	E	Off Site														
Receiving Pervious Area Soil Type	Sandy Loam	Sandy Loam	Sandy Loam														
Total Area (ac., Sum of DCIA, UIA, RPA, & SPA)	35.330	1.800	30.680														
Directly Connected Impervious Area (DCIA, acres)	11.900	1.800	2.400														
Unconnected Impervious Area (UIA, acres)	4.900	0.000	0.000														
Receiving Pervious Area (RPA, acres)	0.000	0.000	0.000														
Separate Pervious Area (SPA, acres)	18.530	0.000	28.280														
RPA Treatment Type: Conveyance (C), Volume (V), or Permeable Pavement (PP)	C	C	C														

## CALCULATED RESULTS (OUTPUT)

Total Calculated Area (ac, check against input)	35.330	1.800	30.680														
Directly Connected Impervious Area (DCIA, %)	33.7%	100.0%	7.8%														
Unconnected Impervious Area (UIA, %)	13.9%	0.0%	0.0%														
Receiving Pervious Area (RPA, %)	0.0%	0.0%	0.0%														
Separate Pervious Area (SPA, %)	52.4%	0.0%	92.2%														
A <sub>u</sub> (RPA / UIA)	0.000	0.000	0.000														
I <sub>u</sub> Check	1.000	1.000	1.000														
f / I for WQCV Event:	1.7	1.7	1.7														
f / I for 5-Year Event:	0.5	0.5	0.5														
f / I for 100-Year Event:	0.3	0.3	0.3														
f / I for Optional User Defined Storm CUHP:																	
IRF for WQCV Event:	1.00	1.00	1.00														
IRF for 5-Year Event:	1.00	1.00	1.00														
IRF for 100-Year Event:	1.00	1.00	1.00														
IRF for Optional User Defined Storm CUHP:																	
Total Site Imperviousness: I <sub>total</sub>	47.6%	100.0%	7.8%														
Effective Imperviousness for WQCV Event:	47.6%	100.0%	7.8%														
Effective Imperviousness for 5-Year Event:	47.6%	100.0%	7.8%														
Effective Imperviousness for 100-Year Event:	47.6%	100.0%	7.8%														
Effective Imperviousness for Optional User Defined Storm CUHP:																	

## LID / EFFECTIVE IMPERVIOUSNESS CREDITS

WQCV Event CREDIT: Reduce Detention By:	0.0%	0.0%	0.0%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
This line only for 10-Year Event	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
100-Year Event CREDIT*: Reduce Detention By:	0.0%	0.0%	0.0%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
User Defined CUHP CREDIT: Reduce Detention By:																	

Total Site Imperviousness:	31.0%
Total Site Effective Imperviousness for WQCV Event:	31.0%
Total Site Effective Imperviousness for 5-Year Event:	31.0%
Total Site Effective Imperviousness for 100-Year Event:	31.0%
Total Site Effective Imperviousness for Optional User Defined Storm CUHP:	

Notes:

\* Use Green-Ampt average infiltration rate values from Table 3-3.

\*\* Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.

\*\*\* Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposed

## Historic Computations

## COMPOSITE % IMPERVIOUS CALCULATIONS: HISTORIC

**Subdivision:** Falcon Meadows at Bent Grass

**Location:** CO, Colorado Springs

**Project Name:** Falcon Meadows at Bent Grass

**Project No.:** CLH000017.20

**Calculated By:** CMWJ

**Checked By:** \_\_\_\_\_

**Date:** 4/15/21

Basin ID	Total Area (ac)	Paved/Dirt Roads			Lawns			Roofs			Basins Total Weighted % Imp.
		% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	
A-1	5.42	100	0.16	3.00	2	5.26	1.90	90	0.00	0.00	4.9
A-2	18.00	100	0.00	0.00	2	18.00	2.00	90	0.00	0.00	2.0
A-3	19.59	100	0.00	0.00	2	19.59	2.00	90	0.00	0.00	2.0
A-4	23.81	100	0.57	2.40	2	23.12	1.90	90	0.12	0.50	4.8
B-1	32.53	100	0.00	0.00	2	32.53	2.00	90	0.00	0.00	2.0
B-2	4.51	100	0.00	0.00	2	4.51	2.00	90	0.00	0.00	2.0
B-3	16.18	100	1.00	6.20	2	15.18	1.90	90	0.00	0.00	8.1
OS-1	22.89	100	0.84	3.70	2	21.48	1.90	90	0.57	2.20	7.8
OS-2	9.26	100	2.00	21.60	2	6.63	1.40	90	0.63	6.10	29.1
OS-4	30.69	100	1.42	4.60	2	28.41	1.90	90	0.86	2.50	9.0
OS-5	18.11	100	0.17	0.90	2	17.72	2.00	90	0.22	1.10	4.0
OS-6	5.70	100	0.00	0.00	2	5.70	2.00	90	0.00	0.00	2.0

## COMPOSITE RUNOFF COEFFICIENT CALCULATIONS: HISTORIC

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017.20  
**Calculated By:** CMWJ  
**Checked By:** \_\_\_\_\_  
**Date:** 4/15/21

Basin ID	Total Area (ac)	Paved Roads			Lawns/Undeveloped			Roofs			Composite C <sub>5</sub>	Composite C <sub>100</sub>
		C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)		
A-1	5.42	0.90	0.96	0.16	0.09	0.36	5.26	0.73	0.81	0.00	0.11	0.38
A-2	18.00	0.90	0.96	0.00	0.09	0.36	18.00	0.73	0.81	0.00	0.09	0.36
A-3	19.59	0.90	0.96	0.00	0.09	0.36	19.59	0.73	0.81	0.00	0.09	0.36
A-4	23.81	0.90	0.96	0.57	0.09	0.36	23.12	0.73	0.81	0.12	0.11	0.38
B-1	32.53	0.90	0.96	0.00	0.09	0.36	32.53	0.73	0.81	0.00	0.09	0.36
B-2	4.51	0.90	0.96	0.00	0.09	0.36	4.51	0.73	0.81	0.00	0.09	0.36
B-3	16.18	0.90	0.96	1.00	0.09	0.36	15.18	0.73	0.81	0.00	0.14	0.40
OS-1	22.89	0.90	0.96	0.84	0.09	0.36	21.48	0.73	0.81	0.57	0.14	0.39
OS-2	9.26	0.90	0.96	2.00	0.09	0.36	6.63	0.73	0.81	0.63	0.31	0.52
OS-4	30.69	0.90	0.96	1.42	0.09	0.36	28.41	0.73	0.81	0.86	0.15	0.40
OS-5	18.11	0.90	0.96	0.17	0.09	0.36	17.72	0.73	0.81	0.22	0.11	0.37
OS-6	5.70	0.90	0.96	0.00	0.09	0.36	5.70	0.73	0.81	0.00	0.09	0.36

*C values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1. (Referencing UDFCD 2001)*

# STANDARD FORM SF-2: HISTORIC TIME OF CONCENTRATION

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017.20  
**Calculated By:** CMWJ  
**Checked By:** \_\_\_\_\_  
**Date:** 4/15/21

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					Tc CHECK			FINAL
DATA						(T <sub>i</sub> )			(T <sub>i</sub> )					(URBANIZED BASINS)			
BASIN ID	D.A. (AC)	Hydrologic Soils Group	Impervious (%)	C <sub>100</sub>	C <sub>5</sub>	L (FT)	S (%)	T <sub>i</sub> (MIN)	L (FT)	S (%)	C <sub>v</sub>	VEL. (FPS)	T <sub>i</sub> (MIN)	COMP. T <sub>c</sub> (MIN)	TOTAL LENGTH(FT)	Urbanized T <sub>c</sub> (MIN)	
A-1	5.42	A	4.90	0.38	0.11	300	2.5	22.9	466	2.5	15.0	2.4	3.3	26.2	766.0	14.3	14.3
A-2	18.00	A	2.00	0.36	0.09	300	2.4	23.9	1130	2.0	15.0	2.1	8.9	32.8	1430.0	17.9	17.9
A-3	19.59	A	2.00	0.36	0.09	300	2.7	23.0	760	2.7	15.0	2.5	5.1	28.1	1060.0	15.9	15.9
A-4	23.81	A	4.80	0.38	0.11	300	2.0	24.9	1500	2.0	15.0	2.1	11.8	36.6	1800.0	20.0	20.0
B-1	32.53	A	2.00	0.36	0.09	300	2.6	23.3	1100	2.6	15.0	2.4	7.6	30.9	1400.0	17.8	17.8
B-2	4.51	A	2.00	0.36	0.09	300	3.0	22.2	323	5.0	15.0	3.4	1.6	23.8	623.0	13.5	13.5
B-3	16.18	A	8.10	0.40	0.14	300	2.9	21.4	780	2.9	15.0	2.6	5.1	26.4	1080.0	16.0	16.0
OS-1	22.89	A	7.80	0.39	0.14	300	2.5	22.5	1420	2.5	15.0	2.4	10.0	32.5	1720.0	19.6	19.6
OS-2	9.26	A	29.10	0.52	0.31	300	2.3	19.0	1400	2.0	15.0	2.1	11.0	30.0	1700.0	19.4	19.4
OS-4	30.69	A	9.00	0.40	0.15	300	2.3	22.9	2600	2.3	15.0	2.3	19.0	42.0	2900.0	26.1	26.1
OS-5	18.11	A	4.00	0.37	0.11	300	2.5	23.2	1460	3.0	15.0	2.6	9.4	32.6	1760.0	19.8	19.8
OS-6	5.70	A	2.00	0.36	0.09	300	2.0	25.4	400	2.0	15.0	2.1	3.1	28.6	700.0	13.9	13.9

**NOTES:**

$T_i = (0.395 * (1.1 - C_5) * (L)^{0.5}) / ((S)^{0.33})$ , S in ft/ft

$T_p = L / 60V$  (Velocity From Fig. 501)

Velocity  $V = C_v * S^{0.5}$ , S in ft/ft

$T_c \text{ Check} = 10 + L / 180$

For Urbanized basins a minimum  $T_c$  of 5.0 minutes is required.

For non-urbanized basins a minimum  $T_c$  of 10.0 minutes is required

**STANDARD FORM SF-3: HISTORIC  
STORM DRAINAGE SYSTEM DESIGN  
(RATIONAL METHOD PROCEDURE)**

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 5-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017.20  
**Calculated By:** CMWJ  
**Checked By:** \_\_\_\_\_  
**Date:** 4/15/21

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		WT200	192.00						37.8	24.41	2.13	52.0									From Falcon DBPS by Matrix
		OS-1	22.89	0.14	19.6	3.11	3.12	9.7													
		A-1	5.42	0.11	14.3	0.62	3.60	2.2													
	1								19.6	3.73	3.12	11.6									Total flow going offsite to Bent Grass F1 Residential
		OS-2	9.26	0.31	19.4	2.86	3.13	9.0													
		A-2	18.00	0.09	17.9	1.62	3.25	5.3													
	2								19.4	4.48	3.13	14.0									Total Flow entering Junction of RWT202&204
	3	A-3	19.59	0.09	15.9	1.76	3.43	6.0													
		OS-4	30.69	0.15	26.1	4.46	2.69	12.0													
		A-4	23.81	0.11	20.0	2.68	3.09	8.3													
	4								26.1	7.14	2.69	19.2									
	5	B-1	32.53	0.09	17.8	2.93	3.27	9.6													
	6	B-2	4.51	0.09	13.5	0.41	3.68	1.5													
	7	B-3	16.18	0.14	16.0	2.27	3.42	7.8													
	8							29.0													Reach RWT204 & Basin WT200 - Per Matrix DBPS Existing Hydrology
	9							0.0													RWT202 - Per Matrix DBPS Existing Hydrology
	10							14.0													RWT210 - Per Matrix DBPS Existing Hydrology
	20							98.1													Flows into Basin OS-5 from Bent Grass Filing No. 3
		OS-5	18.11	0.11	19.8	1.91	3.11	5.9													
	11											104.0									Flows into Basin OS-6
		OS-6	5.70	0.09	13.9	0.51	3.64	1.9													
	12											105.9									Existing Sediment Pond in Basin and then flows to Bent Grass Meadows Drive

**STANDARD FORM SF-3: HISTORIC  
STORM DRAINAGE SYSTEM DESIGN  
(RATIONAL METHOD PROCEDURE)**

**Subdivision:** Falcon Meadows at Bent Grass

**Location:** CO, Colorado Springs

**Design Storm:** 100-Year

**Project Name:** Falcon Meadows at Bent Grass

**Project No.:** CLH000017.20

**Calculated By:** CMWJ

**Checked By:**

**Date:** 4/15/21

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		WT200	192.00						37.8	53.07	3.58	190.0									From Falcon DBPS by Matrix
		OS-1	22.89	0.39	19.6	9.00	5.24	47.2													
		A-1	5.42	0.38	14.3	2.05	6.04	12.4													
	1								19.6	11.05	5.24	57.9									Total flow going offsite to Bent Grass F1 Residential
		OS-2	9.26	0.52	19.4	4.82	5.26	25.4													
		A-2	18.00	0.36	17.9	6.48	5.46	35.4													
	2								19.4	11.30	5.26	59.4									Total Flow entering Junction of RWT202&204
	3	A-3	19.59	0.36	15.9	7.05	5.77	40.7													
		OS-4	30.69	0.40	26.1	12.29	4.51	55.4													
		A-4	23.81	0.38	20.0	8.97	5.19	46.6													
	4								26.1	21.26	4.51	95.9									
	5	B-1	32.53	0.36	17.8	11.71	5.48	64.2													
	6	B-2	4.51	0.36	13.5	1.62	6.18	10.0													
	7	B-3	16.18	0.40	16.0	6.42	5.75	36.9													
	8							233.0													Reach RWT204 & Basin WT200 - Per Matrix DBPS Existing Hydrology
	9							770													RWT202 - Per Matrix DBPS Existing Hydrology
	10							880													RWT210 - Per Matrix DBPS Existing Hydrology
	20							226													Flows into Basin OS-5 from Bent Grass Filing No. 3
		OS-5	18.11	0.37	19.8	6.72	5.21	35.0													
	11											261.0									Flows into Basin OS-6
		OS-6	5.70	0.36	13.9	2.05	6.10	12.5													
	12											273.5									Existing Sediment Pond in Basin and then flows to Bent Grass Meadows Drive



## **Existing/Current Computations**

COMPOSITE RUNOFF COEFFICIENT CALCULATIONS: EXISTING/CURRENT

Subdivision: Falcon Meadows at Bent Grass  
Location: CO, Colorado Springs

Project Name: Falcon Meadows at Bent Grass  
Project No.: CLH000017  
Calculated By: TJE  
Checked By: CMD  
Date: 6/19/20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
Basin ID	Total Area (ac)	Paved/Gravel Roads			Lawns/Undeveloped			Roofs			Residential - 1/8 Acre			Residential - 1/4 Acre			Residential - 1/3 Acre			Residential - 1/2 Acre			Residential - 1 Acre			Composite C <sub>5</sub>	Composite C <sub>100</sub>
		C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)		
EX-1	1.19	0.90	0.96	0.00	0.09	0.36	1.19	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-2	1.56	0.90	0.96	0.00	0.09	0.36	1.56	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-3	0.62	0.90	0.96	0.00	0.09	0.36	0.62	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-4	12.49	0.90	0.96	0.00	0.09	0.36	12.49	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-5	5.15	0.90	0.96	0.00	0.09	0.36	5.15	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-6	9.53	0.90	0.96	0.00	0.09	0.36	9.53	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-7	9.16	0.90	0.96	0.00	0.09	0.36	9.16	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-8	21.30	0.90	0.96	0.00	0.09	0.36	21.30	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
OS-1	32.28	0.90	0.96	2.15	0.09	0.36	29.25	0.73	0.81	0.88	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.16	0.41
OS-2	20.08	0.90	0.96	0.90	0.09	0.36	18.62	0.73	0.81	0.56	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.14	0.40
OS-3	10.62	0.90	0.96	0.48	0.09	0.36	9.84	0.73	0.81	0.30	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.14	0.40
OS-4	4.46	0.90	0.96	0.00	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	2.28	0.30	0.50	1.46	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.72	0.36	0.54
OS-5	0.46	0.90	0.96	0.00	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	0.46	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.45	0.59
OS-6	1.17	0.90	0.96	0.00	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	1.17	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.45	0.59
C-8	0.42	0.90	0.96	0.00	0.09	0.36	0.42	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
E-1	1.71	0.90	0.96	0.78	0.09	0.36	0.23	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.70	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.55	0.69
E-2	0.68	0.90	0.96	0.56	0.09	0.36	0.12	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.76	0.85
E-3	0.78	0.90	0.96	0.69	0.09	0.36	0.09	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.81	0.89
E-4	0.91	0.90	0.96	0.73	0.09	0.36	0.18	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.74	0.84
E-5	0.89	0.90	0.96	0.79	0.09	0.36	0.10	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.81	0.89
I-1	0.31	0.90	0.96	0.22	0.09	0.36	0.09	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.66	0.79

Lot Type Identification:	
Lot Size (SF)	Lot Size (Acre)
0 - 8,167	</= 1/8 Acre
8,168 - 12,704	1/4 Acre
12,705 - 18,149	1/3 Acre
18,150 - 32,670	1/2 Acre
32,671 - 43,560	1 Acre

NOTES:  
C values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1. CH. 6 (Referencing UDFCD 2001)  
Coefficients use HSG A&B soils - Refer to "Appendix A: Exhibits and Figures" for soil map

COMPOSITE % IMPERVIOUS CALCULATIONS: EXISTING/CURRENT

Subdivision: Falcon Meadows at Bent Grass

Location: CO, Colorado Springs

Project Name: Falcon Meadows at Bent Grass

Project No.: CLH000017

Calculated By: TJE

Checked By: CMD

Date: 6/19/20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27
Basin ID	Total Area (ac)	Paved/Gravel Roads			Lawns/Undeveloped			Roofs			Residential - 1/8 Acre			Residential - 1/4 Acre			Residential - 1/3 Acre			Residential - 1/2 Acre			Residential - 1 Acre			Basins Total Weighted % Imp.
		% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	
EX-1	1.19	100	0.00	0.0	2	1.19	2.0	2	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-2	1.56	100	0.00	0.0	2	1.56	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-3	0.62	100	0.00	0.0	2	0.62	2.0	1	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-4	12.49	100	0.00	0.0	2	12.49	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-5	5.15	100	0.00	0.0	2	5.15	2.0	10	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-6	9.53	100	0.00	0.0	2	9.53	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-7	9.16	100	0.00	0.0	2	9.16	2.0	18	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-8	21.30	100	0.00	0.0	2	21.30	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
OS-1	32.28	100	2.15	6.7	2	29.25	1.8	90	0.88	2.5	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	11.0
OS-2	20.08	80	0.90	3.6	2	18.62	1.9	90	0.56	2.5	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	8.0
OS-3	10.62	80	0.48	3.6	2	9.84	1.9	19	0.30	0.5	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	6.0
OS-4	4.46	100	0.00	0.0	2	0.00	0.0	90	0.00	0.0	65.0	2.28	33.2	40	1.46	13.1	30	0.00	0.0	25	0.00	0.0	20	0.72	3.2	49.5
OS-5	0.46	100	0.00	0.0	2	0.00	0.0	90	0.00	0.0	65.0	0.46	65.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	65.0
OS-6	1.17	100	0.00	0.0	2	0.00	0.0	90	0.00	0.0	65.0	1.17	65.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	65.0
C-8	0.42	100	0.00	0.0	2	0.42	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
E-1	1.71	100	0.78	45.6	2	0.23	0.3	90	0.00	0.0	65.0	0.00	0.0	40	0.70	16.4	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	62.3
E-2	0.68	100	0.56	82.4	2	0.12	0.4	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	82.8
E-3	0.78	100	0.69	88.5	2	0.09	0.2	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	88.7
E-4	0.91	100	0.73	80.2	2	0.18	0.4	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	80.6
E-5	0.89	100	0.79	88.8	2	0.10	0.2	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	89.0
I-1	0.31	100	0.22	71.0	2	0.09	0.6	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	71.6

Lot Type Identification:

Lot Size (SF)	Lot Size (Acre)
0 - 8,167	1/8 Acre
8,168 - 12,704	1/4 Acre
12,705 - 18,149	1/3 Acre
18,150 - 32,670	1/2 Acre
32,671 - 43,560	1 Acre

NOTES:

% Impervious values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1. CH. 6 (Referencing UDFCD 2001)

# STANDARD FORM SF-2

## TIME OF CONCENTRATION: EXISTING/CURRENT

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME						Tc CHECK		
DATA						(T <sub>i</sub> )			(T <sub>t</sub> )						(URBANIZED BASINS)		
BASIN ID	D.A. (AC)	Hydrologic Soils Group	Impervious (%)	C <sub>s</sub>	C <sub>100</sub>	L (FT)	S (%)	T <sub>i</sub> (MIN)	L (FT)	S (%)	C <sub>v</sub>	VEL. (FPS)	T <sub>t</sub> (MIN)	COMP. T <sub>c</sub> (MIN)	TOTAL LENGTH(FT)	Urbanized T <sub>c</sub> (MIN)	FINAL T <sub>c</sub> (MIN)
EX-1	1.19	A	2.0	0.09	0.36	300	2.7	23.0	690	2.7	15	2.5	4.7	27.7	990.0	15.5	15.5
EX-2	1.56	A	2.0	0.09	0.36	200	2.7	18.8	100	2.7	15	2.5	0.7	19.5	300.0	11.7	11.7
EX-3	0.62	A	2.0	0.09	0.36	100	5.0	10.8	30	2.7	15	2.5	0.2	11.0	130.0	10.7	10.7
EX-4	12.49	A	2.0	0.09	0.36	100	2.7	13.3	1180	2.7	15	2.5	8.0	21.3	1280.0	17.1	17.1
EX-5	5.15	A	2.0	0.09	0.36	100	2.7	13.3	1000	2.7	15	2.5	6.8	20.0	1100.0	16.1	16.1
EX-6	9.53	A	2.0	0.09	0.36	100	2.7	13.3	1700	2.7	15	2.5	11.5	24.8	1800.0	20.0	20.0
EX-7	9.16	A	2.0	0.09	0.36	90	2.7	12.6	1020	2.7	15	2.5	6.9	19.5	1110.0	16.2	16.2
EX-8	21.30	A	2.0	0.09	0.36	100	2.7	13.3	996	2.7	15	2.5	6.7	20.0	1095.5	16.1	16.1
OS-1	32.28	A	11.0	0.16	0.41	100	2.4	12.9	2100	2.2	15	2.2	15.7	28.6	2200.0	22.2	22.2
OS-2	20.08	A	8.0	0.14	0.40	100	2.3	13.3	1400	2.3	15	2.3	10.3	23.6	1500.0	18.3	18.3
OS-3	10.62	A	8.0	0.14	0.40	100	2.0	14.0	1500	2.0	15	2.1	11.8	25.7	1600.0	18.9	18.9
OS-4	4.46	A	49.5	0.36	0.54	100	2.0	10.8	910	1.2	20	2.2	6.9	17.7	1010.0	15.6	15.6
OS-5	0.46	A	65.0	0.45	0.59	15	2.0	3.7	190	1.0	20	2.0	1.6	5.2	205.0	11.1	5.2
OS-6	1.17	A	65.0	0.45	0.59	85	0.2	18.7	430	0.9	20	1.9	3.9	22.6	515.0	12.9	12.9
C-8	0.42	A	2.0	0.09	0.36	100	2.5	13.6	170	2.5	15	2.4	1.2	14.8	270.0	11.5	11.5
E-1	1.71	A	62.3	0.55	0.69	25	2.0	4.0	940	1.0	20	2.0	7.8	11.8	965.0	15.4	11.8
E-2	0.68	A	82.8	0.76	0.85	25	2.0	2.5	665	1.6	20	2.5	4.4	6.9	690.0	13.8	6.9
E-3	0.78	A	88.7	0.81	0.89	25	2.0	2.1	632	1.0	20	2.0	5.3	7.4	657.0	13.7	7.4
E-4	0.91	A	80.6	0.74	0.84	25	2.0	2.6	913	2.0	20	2.8	5.4	8.0	938.0	15.2	8.0
E-5	0.89	A	89.0	0.81	0.89	25	2.0	2.1	903	2.1	20	2.9	5.2	7.3	928.0	15.2	7.3
I-1	0.31	A	71.6	0.66	0.79	25	2.0	3.2	135	2.0	20	2.8	0.8	4.0	160.0	10.9	5.0

### NOTES:

$T_i = (0.395 * (1.1 - C_s) * (L)^{0.5}) / ((S)^{0.33})$ , S in ft/ft

$T_t = L / 60V$  (Velocity From Fig. 501)

Velocity  $V = C_v * S^{0.5}$ , S in ft/ft

$T_c \text{ Check} = 10 + L / 180$

For Urbanized basins a minimum  $T_c$  of 5.0 minutes is required.

For non-urbanized basins a minimum  $T_c$  of 10.0 minutes is required

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN: EXISTING/CURRENT**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 5-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C <sup>u</sup> A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C <sup>u</sup> A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		RWT202	1574.40						46.6	120.88	1.82	220.0									From Falcon DBPS by Matrix
		RWT204	38.40						11.37	1.78	3.94	7.0									From Falcon DBPS by Matrix
		WT200	192.00						37.8	24.41	2.13	52.0									From Falcon DBPS by Matrix
		OS-1	32.28	0.16	22.2	5.16	2.93	15.1													Existing off-site flows into creek via existing swale.
	12								46.6	152.23	1.82	277.1						850	5.0	2.8	Combine Offsite basins entering site at north property line (RWT202, RWT204, WT200 & OS-1)
	1	OS-4	4.46	0.36	15.6	1.61	3.46	5.6					1.2	5.6				910	2.2	6.9	Flows from Basin B-1 of Bent Grass Filing No. 2 FDR.
	2	OS-5	0.46	0.45	5.2	0.21	5.10	1.1					1	1.1				190	2.0	1.6	Flows from Basin B-2 of Bent Grass Filing No. 2 FDR
	3	OS-6	1.17	0.45	12.9	0.53	3.75	2.0					0.86	2.0				430	1.9	3.9	Flows from Basin B-3 of Bent Grass Filing No. 2 FDR.
	4	EX-1	1.19	0.09	15.5	0.11	3.47	0.4													
		EX-2	1.56	0.09	11.7	0.14	3.90	0.5													
	5	EX-3	0.62	0.09	10.7	0.06	4.02	0.2	15.6	2.60	3.46	9.0									Total flows to DP 5 discharging into existing WQCV Pond.
																					Existing WQCV Pond.
	6	EX-4	12.49	0.09	17.1	1.12	3.32	3.7													
		EX-5	5.15	0.09	16.1	0.46	3.41	1.6													
	7								17.1	1.58	3.32	5.2									Total flow from DP 6 & EX-5 flowing onto Bent Grass Meadows Drive.
	8	EX-7	9.16	0.09	16.2	0.82	3.41	2.8													Flows from DP 8 go off-site into Bent Grass Meadows Drive.
	9	OS-2	20.08	0.14	18.3	2.81	3.22	9.0													Flow obtained from Bent Grass Filing No. 2 FDR.
	10	OS-3	10.62	0.14	18.9	1.49	3.18	4.7													Flow obtained from Bent Grass Filing No. 2 FDR.
		EX-6	9.53	0.09	20.0	0.86	3.09	2.7													
	11								20.0	5.16	3.09	15.9									Total flows entering existing inlet at DP 11. (Basins OS-2, OS-3 & EX-6)
		EX-8	21.30	0.09	16.1	1.92	3.42	6.6													Existing flows from basin discharge into creek.
		E-1	1.71	0.55	11.8	0.94	3.88	3.6													Existing Basin from Filing No. 2(East side of BGMD)
		E-2	0.68	0.76	6.9	0.52	4.70	2.4													Existing Basin from Filing No. 2(West side of BGMD)
	4X								17.3	2.60	3.31	8.6									DP-4 from Bent Grass Filing No. 2 FDR (
	21								17.3	5.18	3.31	17.1									Combine Basins Ex-4, E-1 & E-2 at Existing Inlet from Bent Grass Filing No. 2 FDR
	15A								5.0	2.42	5.17	12.5									Release Rate from Ex WQCV Pond North in Bent Grass Filing No.2 FDR
		E-3	0.78	0.81	7.4	0.63	4.59	2.9													
	AA								49.4	155.28	1.73	268.6						900	5.0	3.0	Combine Basins E-3 w/Design Points 12 & 15A
		E-4	0.91	0.74	8.0	0.67	4.46	3.0													

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN: EXISTING/CURRENT**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 5-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C* A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C* A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		E-5	0.89	0.81	7.3	0.72	4.60	3.3													
		I-1	0.31	0.66	5.0	0.20	5.17	1.0													
	26								20.0	6.75	3.09	20.9									Combine Basins E-4, E-5 & I-1 w/DP 11 at Existing Inlet from Bent Grass Filing No. 2 FDR
	20B								5.0	4.10	5.17	21.2									Release Rate from Ex WQCV Pond South in Bent Grass Filing No. FDR
		C-8	0.42	0.09	11.5	0.04	3.92	0.2													
	CC								52.4	166.17	1.64	272.5									Flows exiting site - Combined flows from Basin C-8 w/Design Points AA, 26 & 20B

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN: EXISTING/CURRENT**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 100-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*VA (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*VA (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		RWT202	1574.40						46.6	327.87	3.05	1000.0									From Falcon DBPS by Matrix
		RWT204	38.40						11.4	6.51	6.61	43.0									From Falcon DBPS by Matrix
		WT200	192.00						37.8	53.07	3.58	190.0									From Falcon DBPS by Matrix
		OS-1	32.28	0.41	22.2	13.23	4.92	65.1													Existing off-site flows into creek via existing swale.
	12								46.6	400.68	3.05	1222.1						850	5.0	2.8	Combine Offsite basins entering site at north property line (RWT202, RWT204, WT200 & OS-1)
	1	OS-4	4.46	0.54	15.6	2.41	5.81	14.0					1.2	14.0				910	2.2	6.9	Flow obtained from Bent Grass Filing No. 2 FDR.
	2	OS-5	0.46	0.59	5.2	0.27	8.56	2.3					1	2.3				190	2.0	1.6	Flow obtained from Bent Grass Filing No. 2 FDR.
	3	OS-6	1.17	0.59	12.9	0.69	6.30	4.3					0.86	4.3				430	1.9	3.9	Flow obtained from Bent Grass Filing No. 2 FDR.
	4	EX-1	1.19	0.36	15.5	0.43	5.83	2.5													
	5	EX-2	1.56	0.36	11.7	0.56	6.54	3.7	15.6	4.36	5.81	25.3									Total flows to DP 5 discharging into existing WQCV Pond.
		EX-3	0.62	0.36	10.7	0.22	6.76	1.5													Existing WQCV Pond.
	6	EX-4	12.49	0.36	17.1	4.50	5.58	25.1													
	7	EX-5	5.15	0.36	16.1	1.85	5.73	10.6	17.1	6.35	5.58	35.4									Total flow from DP 6 & EX-5 flowing onto Bent Grass Meadows Drive.
	8	EX-7	9.16	0.36	16.2	3.30	5.72	18.9													Flows from DP 8 go off-site into Bent Grass Meadows Drive.
	9	OS-2	20.08	0.40	18.3	8.03	5.41	43.4													Flow obtained from Bent Grass Filing No. 2 FDR.
	10	OS-3	10.62	0.40	18.9	4.25	5.33	22.7													Flow obtained from Bent Grass Filing No. 2 FDR.
	11	EX-6	9.53	0.36	20.0	3.43	5.19	17.8	20.0	15.71	5.19	81.5									Total flows entering existing inlet at DP 11. (Basins OS-2, OS-3 & EX-6)
		EX-8	21.30	0.36	16.1	7.67	5.73	43.9													Existing flows from basin discharge into creek.
		E-1	1.71	0.69	11.8	1.18	6.51	7.7													
		E-2	0.68	0.85	6.9	0.58	7.89	4.6													
	4X								17.3	4.03	5.55	22.4									DP-4 from Bent Grass Filing No. 2 FDR (
	21								17.3	10.29	5.55	57.1									Combine Basins Ex-4, E-1 & E-2 at Existing Inlet from Bent Grass Filing No. 2 FDR
	15A								45.0	11.78	3.14	37.0									Release Rate from WQCV Pond North in Bent Grass Filing No. FDR
		E-3	0.78	0.89	7.4	0.69	7.70	5.3													
	AA								49.4	413.15	2.91	1202.3						900	5.0	3.0	Combine Basin E-3 w/Design Points 12, & 15A
		E-4	0.91	0.84	8.0	0.76	7.50	5.7													

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN: EXISTING/CURRENT**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 100-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C* <i>A</i> (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C* <i>A</i> (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		E-5	0.89	0.89	7.3	0.79	7.73	6.1													
		I-1	0.31	0.79	5.0	0.24	8.68	2.1													
	26								20.0	17.50	3.09	54.1									Combine Basins E-4, E-5 & I-1 w/DP 11 at Existing Inlet from Bent Grass Filing No. 2 FDR
	20B								5.0	7.48	8.68	64.9									Release Rate from WQCV Pond South in Bent Grass Filing No. FDR
		C-8	0.42	0.36	11.5	0.15	6.58	1.0													
	CC								52.4	438.28	2.76	1209.6									Flows exiting site - Combined flows from Basin C-8 w/Design Points AA, 26 & 20B



## Proposed Computations

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27
Basin ID	Total Area (ac)	Paved/Gravel Roads			Lawns/Undeveloped			Roofs			Residential - 1/8 Acre			Residential - 1/4 Acre			Residential - 1/3 Acre			Residential - 1/2 Acre			Residential - 1 Acre			Basins Total Weighted % Imp.
		% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	
EX-1	1.19	100	0.00	0.0	2	1.19	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-2	1.56	100	0.00	0.0	2	1.56	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-3	0.62	100	0.00	0.0	2	0.62	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-4	16.80	100	0.00	0.0	2	16.80	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-5	1.11	100	0.00	0.0	2	1.11	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-6	16.60	100	0.00	0.0	2	16.80	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
EX-7	1.72	100	0.00	0.0	2	1.72	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
B-1	5.62	100	0.00	0.0	2	5.62	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
B-2	4.16	100	0.00	0.0	2	4.16	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
D-4	2.11	100	2.11	100.0	2	0.00	0.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	100.0
D-5	1.08	100	0.22	20.4	2	0.11	0.2	90	0.00	0.0	65.0	0.75	45.1	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	65.7
D-6	4.01	100	0.91	22.7	2	0.09	0.0	90	0.00	0.0	65.0	3.01	48.8	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	71.5
D-7	4.42	100	0.00	0.0	2	3.32	1.5	90	0.00	0.0	65.0	1.11	16.3	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	17.8
D-8	2.74	100	0.00	0.0	2	2.74	2.0	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	2.0
D-9	3.20	100	0.00	0.0	2	2.56	1.6	90	0.00	0.0	65.0	0.64	13.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	14.6
E-1	1.71	100	0.78	45.6	2	0.23	0.3	90	0.00	0.0	65.0	0.00	0.0	40	0.70	16.4	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	62.3
E-2	0.68	100	0.56	82.4	2	0.12	0.4	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	82.8
E-3	0.78	100	0.69	88.5	2	0.09	0.2	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	88.7
E-4	0.91	100	0.73	80.2	2	0.18	0.4	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	80.6
E-5	0.89	100	0.79	88.8	2	0.10	0.2	90	0.00	0.0	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	89.0
OS-1	32.28	100	2.15	6.7	2	29.25	1.8	90	0.88	2.5	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	11.0
OS-2	20.07	80	0.90	3.6	2	18.62	1.9	90	0.56	2.5	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	8.0
OS-3	10.61	80	0.48	3.6	2	9.84	1.9	90	0.30	2.5	65.0	0.00	0.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	8.0
OS-4	4.46	100	0.00	0.0	2	0.00	0.0	90	0.00	0.0	65.0	2.28	33.2	40	1.46	13.1	30	0.00	0.0	25	0.00	0.0	20	0.72	3.2	49.5
OS-5	0.46	100	0.00	0.0	2	0.00	0.0	90	0.00	0.0	65.0	0.46	65.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	65.0
OS-6	1.17	100	0.00	0.0	2	0.00	0.0	90	0.00	0.0	65.0	1.17	65.0	40	0.00	0.0	30	0.00	0.0	25	0.00	0.0	20	0.00	0.0	65.0

Lot Type Identification:	
Lot Size (SF)	Lot Size (Acre)
0 - 8,167	1/8 Acre
8,168 - 12,704	1/4 Acre
12,705 - 18,149	1/3 Acre
18,150 - 32,670	1/2 Acre
32,671 - 43,560	1 Acre

NOTES:  
% Impervious values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1. CH. 6 (Referencing UDFCD 2001)

COMPOSITE RUNOFF COEFFICIENT CALCULATIONS: PROPOSED

Subdivision: Falcon Meadows at Bent Grass  
Location: CO, Colorado Springs

Project Name: Falcon Meadows at Bent Grass  
Project No.: CLH000017  
Calculated By: TJE  
Checked By: CMD  
Date: 6/19/20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28
Basin ID	Total Area (ac)	Paved/Gravel Roads			Lawns/Undeveloped			Roofs			Residential - 1/8 Acre			Residential - 1/4 Acre			Residential - 1/3 Acre			Residential - 1/2 Acre			Residential - 1 Acre			Composite C <sub>s</sub>	Composite C <sub>100</sub>
		C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)		
EX-1	1.19	0.90	0.96	0.00	0.09	0.36	1.19	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-2	1.56	0.90	0.96	0.00	0.09	0.36	1.56	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-3	0.62	0.90	0.96	0.00	0.09	0.36	0.62	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-4	16.80	0.90	0.96	0.00	0.09	0.36	16.80	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-5	1.11	0.90	0.96	0.00	0.09	0.36	1.11	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-6	16.60	0.90	0.96	0.00	0.09	0.36	16.80	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
EX-7	1.72	0.90	0.96	0.00	0.09	0.36	1.72	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
B-1	5.62	0.90	0.96	0.00	0.09	0.36	5.62	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
B-2	4.16	0.90	0.96	0.00	0.09	0.36	4.16	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
D-4	2.11	0.90	0.96	2.11	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.90	0.96
D-5	1.08	0.90	0.96	0.22	0.09	0.36	0.11	0.73	0.81	0.00	0.45	0.59	0.75	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.51	0.64
D-6	4.01	0.90	0.96	0.91	0.09	0.36	0.09	0.73	0.81	0.00	0.45	0.59	3.01	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.54	0.67
D-7	4.42	0.90	0.96	0.00	0.09	0.36	3.32	0.73	0.81	0.00	0.45	0.59	1.11	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.18	0.42
D-8	2.74	0.90	0.96	0.00	0.09	0.36	2.74	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.09	0.36
D-9	3.20	0.90	0.96	0.00	0.09	0.36	2.56	0.73	0.81	0.00	0.45	0.59	0.64	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.16	0.41
E-1	1.71	0.90	0.96	0.78	0.09	0.36	0.23	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.70	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.55	0.69
E-2	0.68	0.90	0.96	0.56	0.09	0.36	0.12	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.76	0.85
E-3	0.78	0.90	0.96	0.69	0.09	0.36	0.09	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.81	0.89
E-4	0.91	0.90	0.96	0.73	0.09	0.36	0.18	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.74	0.84
E-5	0.89	0.90	0.96	0.79	0.09	0.36	0.10	0.73	0.81	0.00	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.81	0.89
OS-1	32.28	0.90	0.96	2.15	0.09	0.36	29.25	0.73	0.81	0.88	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.16	0.41
OS-2	20.07	0.90	0.96	0.90	0.09	0.36	18.62	0.73	0.81	0.56	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.14	0.40
OS-3	10.61	0.90	0.96	0.48	0.09	0.36	9.84	0.73	0.81	0.30	0.45	0.59	0.00	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.14	0.40
OS-4	4.46	0.90	0.96	0.00	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	2.28	0.30	0.50	1.46	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.72	0.36	0.54
OS-5	0.46	0.90	0.96	0.00	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	0.46	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.45	0.59
OS-6	1.17	0.90	0.96	0.00	0.09	0.36	0.00	0.73	0.81	0.00	0.45	0.59	1.17	0.30	0.50	0.00	0.25	0.47	0.00	0.22	0.46	0.00	0.20	0.44	0.00	0.45	0.59

Lot Type Identification:	
Lot Size (SF)	Lot Size (Acre)
0 - 8,167	<1/8 Acre
8,168 - 12,704	1/4 Acre
12,705 - 18,149	1/3 Acre
18,150 - 32,670	1/2 Acre
32,671 - 43,560	1 Acre

NOTES:  
C values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1. CH. 6 (Referencing UDFCD 2001)  
Coefficients use HSG A&B soils - Refer to "Appendix A: Exhibits and Figures" for soil map

# STANDARD FORM SF-2: PROPOSED TIME OF CONCENTRATION

**Subdivision:** Falcon Meadows at Bent Grass

**Location:** CO, Colorado Springs

**Project Name:** Falcon Meadows at Bent Grass

**Project No.:** CLH000017

**Calculated By:** TJE

**Checked By:** CMD

**Date:** 6/19/20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					Tc CHECK			FINAL
DATA						(T <sub>i</sub> )			(T <sub>t</sub> )					(URBANIZED BASINS)			
BASIN ID	D.A. (AC)	Hydrologic Soils Group	Impervious (%)	C <sub>5</sub>	C <sub>100</sub>	L (FT)	S (%)	T <sub>i</sub> (MIN)	L (FT)	S (%)	C <sub>v</sub>	VEL. (FPS)	T <sub>t</sub> (MIN)	COMP. T <sub>c</sub> (MIN)	TOTAL LENGTH(FT)	Urbanized T <sub>c</sub> (MIN)	
EX-1	1.19	A	2.0	0.09	0.36	300	2.7	23.0	690	2.7	15	2.5	4.7	27.7	990.0	15.5	15.5
EX-2	1.56	A	2.0	0.09	0.36	200	2.7	18.8	100	2.7	15	2.5	0.7	19.5	300.0	11.7	11.7
EX-3	0.62	A	2.0	0.09	0.36	100	5.0	10.8	30	2.7	15	2.5	0.2	11.0	130.0	10.7	10.7
EX-4	16.80	A	2.0	0.09	0.36	300	2.6	23.3	875	2.7	15	2.5	5.9	29.2	1175.0	16.5	16.5
EX-5	1.11	A	2.0	0.09	0.36	300	2.5	23.6	310	1.2	20	2.2	2.4	26.0	610.0	13.4	13.4
EX-6	16.60	A	2.0	0.09	0.36	300	2.2	24.6	1305	2.0	15	2.1	10.3	34.9	1605.0	18.9	18.9
EX-7	1.72	A	2.0	0.09	0.36	300	2.8	22.7	1275	1.1	20	2.1	10.1	32.9	1575.0	18.8	18.8
B-1	5.62	A	2.0	0.09	0.36	90	6.4	9.5	2000	1.7	15	2.0	17.0	26.5	2090.0	21.6	21.6
B-2	1.17	A	2.0	0.09	0.36	160	11.0	10.5	920	1.6	15	1.9	8.1	18.6	1080.0	16.0	16.0
D-4	2.11	A	100.0	0.90	0.96	10	2.0	0.9	980	1.0	20	2.0	8.2	9.1	990.0	15.5	9.1
D-5	1.08	A	65.7	0.51	0.64	100	2.0	8.6	300	1.1	20	2.1	2.4	11.0	400.0	12.2	11.0
D-6	4.01	A	71.5	0.54	0.67	45	2.0	5.5	835	1.0	20	2.0	7.0	12.4	880.0	14.9	12.4
D-7	4.42	A	17.8	0.18	0.42	200	1.7	20.0	550	1.6	15	1.9	4.8	24.8	750.0	14.2	14.2
D-8	2.74	A	2.0	0.09	0.36	125	3.7	13.4	600	1.0	15	1.5	6.7	20.0	725.0	14.0	14.0
D-9	3.20	A	14.6	0.16	0.41	40	25.0	3.7	1315	1.4	15	1.8	12.3	16.1	1355.0	17.5	16.1
E-1	1.71	A	62.3	0.55	0.69	25	2.0	4.0	940	1.0	20	2.0	7.8	11.8	965.0	15.4	11.8
E-2	0.68	A	82.8	0.76	0.85	25	2.0	2.5	665	1.6	20	2.5	4.4	6.9	690.0	13.8	6.9
E-3	0.78	A	88.7	0.81	0.89	25	2.0	2.1	632	1.0	20	2.0	5.3	7.4	657.0	13.7	7.4
E-4	0.91	A	80.6	0.74	0.84	25	2.0	2.6	913	2.0	20	2.8	5.4	8.0	938.0	15.2	8.0
E-5	0.89	A	89.0	0.81	0.89	25	2.0	2.1	903	2.1	20	2.9	5.2	7.3	928.0	15.2	7.3
OS-1	32.28	A	11.0	0.16	0.41	100	2.4	12.9	2100	2.2	15	2.2	15.7	28.6	2200.0	22.2	22.2
OS-2	20.07	A	8.0	0.14	0.40	100	2.3	13.3	1400	2.3	15	2.3	10.3	23.6	1500.0	18.3	18.3
OS-3	10.61	A	8.0	0.14	0.40	100	2.0	14.0	1500	2.0	15	2.1	11.8	25.7	1600.0	18.9	18.9
OS-4	4.46	A	49.5	0.36	0.54	100	2.0	10.8	910	1.2	20	2.2	6.9	17.7	1010.0	15.6	15.6
OS-5	0.46	A	65.0	0.45	0.59	15	2.0	3.7	190	1.0	20	2.0	1.6	5.2	205.0	11.1	5.2
OS-6	1.17	A	65.0	0.45	0.59	85	0.2	18.7	430	0.9	20	1.9	3.8	22.5	515.0	12.9	12.9

## NOTES:

$T_i = (0.395 * (1.1 - C_s) * (L)^{0.5}) / ((S)^{0.33})$ , S in ft/ft

$T_t = L / 60V$  (Velocity From Fig. 501)

Velocity  $V = C_v * S^{0.5}$ , S in ft/ft

$T_c \text{ Check} = 10 + L / 180$

For Urbanized basins a minimum  $T_c$  of 5.0 minutes is required.

For non-urbanized basins a minimum  $T_c$  of 10.0 minutes is required

**STANDARD FORM SF-3: PROPOSED  
STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 5-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C* A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C* A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		RWT202	1574.40						46.6	120.88	1.82	220.0									From Falcon DBPS by Matrix
		RWT204	38.40						11.37	1.78	3.94	7.0									From Falcon DBPS by Matrix
		WT200	192.00						37.8	24.41	2.13	52.0									From Falcon DBPS by Matrix
		OS-1	32.28	0.16	22.2	5.16	2.93	15.1													Flows obtained from Bent Grass Filing No. 2 FDR. Q=65.1 CFS
		OS-4	4.46	0.36	15.6	1.61	3.46	5.6					1.2	5.6				910	2.2	6.9	Flows from Basin B-1 of Bent Grass Filing No. 2 FDR.
		OS-5	0.46	0.45	5.2	0.21	5.10	1.1					1	1.1				190	2.0	1.6	Flows from Basin B-2 of Bent Grass Filing No. 2 FDR
		OS-6	1.17	0.45	12.9	0.53	3.75	2.0					0.9	2.0				430	1.9	3.8	Flows from Basin B-3 of Bent Grass Filing No. 2 FDR.
		EX-1	1.19	0.09	15.5	0.11	3.47	0.4													
		EX-2	1.56	0.09	11.7	0.14	3.90	0.5													
		EX-3	0.62	0.09	10.7	0.06	4.02	0.2													
		EX-4	16.80	0.09	16.5	1.51	3.38	5.1													
		EX-5	1.11	0.09	13.4	0.10	3.69	0.4													
		EX-6	16.60	0.09	18.9	1.49	3.17	4.7													
		EX-7	1.72	0.09	18.8	0.15	3.19	0.5													
		E-1	1.71	0.55	11.8	0.94	3.88	3.6													Ex Basin from Filing No. 2(East side of BGMD)
		E-2	0.68	0.76	6.9	0.52	4.70	2.4													Ex Basin from Filing No. 2(West side of BGMD)
		B-1	5.62	0.09	21.6	0.51	2.97	1.5													
		OS-2	20.07	0.14	18.3	2.81	3.22	9.0													Overland flow into Basin D-3. Flow obtained from Bent Grass Filing No. 2 FDR
		OS-3	10.61	0.14	18.9	1.49	3.18	4.7													Offsite flow into Basin D-3. Flow obtained from Bent Grass Filing No. 2 FDR
		D-4	2.11	0.90	9.1	1.90	4.27	8.1					1	8.1				980	2.0	8.2	Flow into proposed inlet.
		D-5	1.08	0.51	11.0	0.55	3.99	2.2					1.1	2.2				300	2.1	2.4	
		D-6	4.01	0.54	12.4	2.17	3.80	8.2					1	8.2				835	2.0	7.0	
		E-4	0.91	0.74	8.0	0.67	4.46	3.0													Flow into Ex inlet.
		E-5	0.89	0.81	7.3	0.72	4.60	3.3													Flow into Ex inlet.
		D-7	4.42	0.18	14.2	0.80	3.61	2.9													Flow into temporary swale to sediment basin
		D-8	2.74	0.09	14.0	0.25	3.62	0.9													
		D-9	3.20	0.16	16.1	0.51	3.42	1.7													Flow into Existing Swale F
		E-3	0.78	0.81	7.4	0.63	4.59	2.9													Flow into Ex Inlet in BGMD (South Side)
		B-2	1.17	0.09	16.0	0.11	3.42	0.4													

**STANDARD FORM SF-3: PROPOSED**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 100-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		RWT202	1574.40						46.6	327.87	3.05	1000.0									From Falcon DBPS by Matrix
		RWT204	38.40						11.4	6.52	6.60	43.0									From Falcon DBPS by Matrix
		WT200	192.00						37.8	53.07	3.58	190.0									From Falcon DBPS by Matrix
		OS-1	32.28	0.41	22.2	13.23	4.92	65.1													Flows obtained from Bent Grass Filing No. 2 FDR. Q=65.1 CFS
		OS-4	4.46	0.54	15.6	2.41	5.81	14.0					1.2	14.0				910	2.2	6.9	Flows from Basin B-1 of Bent Grass Filing No. 2 FDR.
		OS-5	0.46	0.59	5.2	0.27	8.56	2.3					1	2.3				190	2.0	1.6	Flows from Basin B-2 of Bent Grass Filing No. 2 FDR
		OS-6	1.17	0.59	12.9	0.69	6.30	4.3					0.9	4.3				430	1.9	3.8	Flows from Basin B-3 of Bent Grass Filing No. 2 FDR.
		A-1	2.16	0.79	10.3	1.71	6.87	11.7					2.5	11.7				765	3.2	4.0	
		A-4	0.82	0.36	5.0	0.30	8.68	2.6													Existing North WQ Pond Bent Grass Filing No. 2
		A-3	0.92	0.78	8.9	0.72	7.21	5.2					2.5	5.2				735	3.2	3.9	Flow into proposed inlet.
		A-2	0.86	0.59	5.0	0.51	8.68	4.4													Releases directly to Channel
		C-4	4.70	0.53	5.5	2.49	8.44	21.0					2.5	21.0				575	3.2	3.0	Flow into Ex inlet in BGMD at DP 8
		E-1	1.71	0.69	11.8	1.18	6.51	7.7	11.8	1.18	6.51	7.7									Ex Basin from Filing No. 2(East side of BGMD)
		E-2	0.68	0.85	6.9	0.58	7.89	4.6													Ex Basin from Filing No. 2(West side of BGMD)
		B-1	4.32	0.36	21.6	1.56	4.99	7.8													
		C-6	1.37	0.54	10.3	0.74	6.87	5.1													
		C-2	1.11	0.65	5.0	0.72	8.68	6.2					4	6.25				380	4.0	1.583	Flow into proposed inlet.
		C-1	9.07	0.65	13.9	5.90	6.11	36.0					2.25	36.05				1160	3.0	6.4	Flow into proposed inlet.
		C-3	1.52	0.82	6.7	1.25	7.95	9.9					2.5	9.9				945	3.2	5.0	
		C-5	0.51	0.36	5.0	0.18	8.68	1.6													North Pond
		OS-2	20.07	0.40	18.3	8.03	5.41	43.4													Overland flow into Basin D-3. Flow obtained from Bent Grass Filing No. 2 FDR
		OS-3	10.61	0.40	18.9	4.24	5.33	24.3													Offsite flow into Basin D-3. Flow obtained from Bent Grass Filing No. 2 FDR
		D-3	2.93	0.34	21.0	1.00	5.06	5.1	21.0	9.88	5.06	50.0									Flows conveyed via existing ditch into proposed area inlet. Total flow from Basins OS-2, OS-3 & D-3 to existing area inlet at DP 11
		D-2	6.72	0.69	12.4	4.64	6.39	29.6					1.3	29.65				1355	2.3	9.9	Flow into proposed inlet. Piped to DP 14.
		D-1	8.13	0.58	21.1	4.72	5.05	23.8					1.3	23.8				1900	2.3	13.9	Combined flows from D-1 into proposed inlet.
		D-4	4.38	0.66	16.0	2.89	5.75	16.6					1	16.6				980	2.0	8.2	Flow into proposed inlet.
		D-5	1.08	0.64	11.0	0.69	6.70	4.6					1.1	4.6				300	2.1	2.4	
		D-6	4.01	0.67	12.4	2.69	6.39	17.2					1	17.2				835	2.0	7.0	
		E-4	0.91	0.84	8.0	0.76	7.50	5.7					2	5.7				913	2.8	5.4	Flow into Ex inlet.
		E-5	0.89	0.89	7.3	0.79	7.73	6.1					2.1	6.1				903	2.9	5.2	Flow into Ex inlet.

**STANDARD FORM SF-3: PROPOSED**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs  
**Design Storm:** 100-Year

**Project Name:** Falcon Meadows at Bent Grass  
**Project No.:** CLH000017  
**Calculated By:** TJE  
**Checked By:** CMD  
**Date:** 6/19/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
		I-1	0.31	0.79	5.0	0.24	8.68	2.1					2	2.1				135	2.8	0.8	Flow into Ex inlet.
		D-7	6.39	0.39	14.8	2.49	5.94	14.8													
		D-8	1.69	0.44	14.0	0.74	6.08	4.5													Flow in Swale C (Basin D-8) into proposed south pond
		E-3	0.78	0.89	7.4	0.69	7.70	5.3					1	5.3				632	2.0	5.3	Flow into Ex Inlet in BGMD (South Side)
		B-2	1.17	0.38	16.0	0.44	5.75	2.5													

BENT GRASS/MERIDIAN ROAD - PDR  
SURFACE ROUTING - PROPOSED CONDITIONS

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS		NOTES
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)	
	RWT202	124.80	324.77	46.6	1.8	3.1	220.0	1000.0	
		TRAVEL TIME							
		124.80	324.77	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				5.0	0.0	46.6			
	RWT204	1.83	6.43	11.4	3.8	6.7	7.0	43.0	
		TRAVEL TIME							
		1.83	6.43	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				5.0	0.0	11.4			
	WT200	25.81	54.00	37.8	2.0	3.5	52.0	190.0	
		TRAVEL TIME							
		25.81	54.00	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				5.0	0.0	37.8			
	OS-1	5.16	13.23	22.2	2.8	4.8	14.2	63.6	
		TRAVEL TIME							
		5.16	13.23	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				5.0	0.0	22.2			
21	RWT202 RWT204 WT200 OS-1	124.80	324.77	46.6	1.8	3.1	277.8	1226.8	Combine all offsite flows entering site @ North Property Line
		1.83	6.43						
		25.81	54.00						
		5.16	13.23	TRAVEL TIME					
		157.60	398.43	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
			Channel	850	4.0	3.5	50.1		
2	EX-1	0.11	0.43	15.5	3.3	5.8	0.4	2.5	
		TRAVEL TIME							
		0.11	0.43	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
			Swale	200	3.2	1.0	16.5		
1	OS-5 DP 2	0.21	0.27	16.5	3.2	5.6	1.0	3.9	
		0.11	0.43	TRAVEL TIME					
		0.32	0.70	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
			SWALE	55	3.2	0.3	16.8		
3	OS-6 OS-4 EX-2	0.53	0.69	16.8	3.2	5.6	7.3	20.4	
		1.61	2.41						
		0.14	0.56	TRAVEL TIME					
		2.28	3.66	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
			SWALE	115	3.2	0.6	17.4		
6	DP 1 DP 3 EX-3	0.32	0.70	17.4	3.1	5.5	8.3	25.0	EX BG FIL NO. 2 WQ POND
		2.28	3.66						
		0.06	0.22	TRAVEL TIME					
		2.66	4.58	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				2.0	0.0	17.4			
15A	EX NORTH WQ POND RELEASE	2.35	4.08	5.0	5.2	9.1	12.2	37.0	
		TRAVEL TIME							
		2.35	4.08	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				2.6	0.0	5.0			



DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS		NOTES
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)	
7	E-3	0.63	0.69	7.4	4.6	8.0	2.9	5.5	EX SUMP INLET
				TRAVEL TIME					
		0.63	0.69	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						2.6	0.0	7.4	
8	E-1 E-2 EX-5 FB DP 5	0.94	1.18	11.8	3.8	6.6	5.9	22.6	EX SUMP INLET
		0.52	0.58						
		0.10	0.40						
		0.00	1.28	TRAVEL TIME					
		1.56	3.44	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						2.6	0.0	11.8	
AA	DP 21 B-1 EX-4 DP 8 DP 15A	157.60	398.43	50.1	1.7	2.9	270.8	1203.2	CHANNEL FLOW & EX BOX CULVERTS @ BGMD
		0.51	2.02						
		1.51	6.05						
		1.56	3.44	TRAVEL TIME					
		2.35	4.08						
		161.18	409.94	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				CHANNEL	900	5.0	3.0	53.1	
		9	OS-2	2.81	8.03	18.3	3.1	5.3	
TRAVEL TIME									
2.81	8.03			Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				SWALE	1150	5.6	3.4	21.8	
10	OS-3	1.49	4.24	18.9	3.0	5.2	4.5	22.2	
		TRAVEL TIME							
		1.49	4.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				SWALE	3.33	6.1	0.0	18.9	
11	EX-6 DP 9 DP 10	1.49	5.98	21.8	2.8	4.9	16.1	88.8	AREA INLET
		2.81	8.03						
		1.49	4.24	TRAVEL TIME					
		5.79	18.25	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						6.0	0.0	21.8	
17	D-4	1.90	2.03	9.1	4.2	7.4	8.0	14.9	SUMP INLET
		TRAVEL TIME							
		1.90	2.03	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						6.1	0.0	9.1	
18	D-5 D-6	0.55	0.69	12.4	3.7	6.4	10.0	21.8	SUMP INLET
		2.17	2.69	TRAVEL TIME					
		2.72	3.38	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						6.2	0.0	12.4	
31	DP 17 DP 18	1.90	2.03	12.4	3.7	6.4	17.0	34.8	FLOW INTO PR SOUTH WQ POND
		2.72	3.38	TRAVEL TIME					
		4.62	5.41	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
						6.0	0.0	12.4	
24	E-4 EX-7	0.67	0.76	7.3	4.6	8.0	11.8	22.3	EX @ GRADE INLET
		1.90	2.03						
		TRAVEL TIME							
		2.57	2.79	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)	
				2.6	0.0	7.3			

DESIGN POINT	CONTRIBUTING BASINS	CA (equivalent)		Tc (min.)	INTENSITY		TOTAL FLOWS		NOTES	
		CA(5)	CA(100)		I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)		
25	E-5 FB DP 24	0.72	0.79	7.3	4.6	8.0	3.3	9.9	EX @ GRADE INLET	
		0.00	0.45	TRAVEL TIME						
		0.72	1.24	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
					2.6	0.0	7.3			
26	DP 24 DP 25	2.57	2.79	7.3	4.6	8.0	15.1	32.2	FLOWS INTO SWALE F	
		0.72	1.24	TRAVEL TIME						
		3.29	4.03	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
			SWALE	740	3.5	3.5	10.8			
30	D-7	0.80	1.86	14.2	3.5	6.1	2.8	11.3	FLOW INTO PR SOUTH WQ POND	
				TRAVEL TIME						
		0.80	1.86	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
						2.6	0.0	14.2		
20	DP 30 DP 31	0.80	1.86	12.4	3.7	6.4	20.0	46.8	TOTAL FLOW INTO PR SOUTH WQ POND	
		4.62	5.41	TRAVEL TIME						
		5.42	7.27	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
						2.6	0.0	12.4		
20A	PR SOUTH WQ POND RELEASE	2.58	5.79	5.0	5.2	9.1	13.4	52.5		
				TRAVEL TIME						
		2.58	5.79	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
						2.6	0.0	5.0		
20B	EX SOUTH WQ POND RELEASE	4.11	7.28	5.0	5.2	9.1	21.3	66.0		
				TRAVEL TIME						
		4.11	7.28	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
						2.6	0.0	5.0		
CC	B-2 D-9 D-8 DP 26 DP AA DP 20A DP 20B	0.11	0.42	53.1	1.6	2.8	278.2	1213.8	FLOWS EXITING SITE IN CHANNEL	
		0.51	1.31							
		0.25	0.99							
		3.29	4.03							
		161.18	409.94							
		2.58	5.79							
		4.11	7.28	TRAVEL TIME						
		172.03	429.76	Type/flow	Length (ft)	Velocity (fps)	d. Time (min)	T. Time (min)		
				2.6	0.0	53.1				

**APPENDIX C**  
**Hydraulic Computations**

## Swale Calculations

## Worksheet for Swale - A

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.030	
Channel Slope	0.02580	ft/ft
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Discharge	5.20	ft <sup>3</sup> /s

### Results

Normal Depth	0.61	ft
Flow Area	1.48	ft <sup>2</sup>
Wetted Perimeter	5.01	ft
Hydraulic Radius	0.29	ft
Top Width	4.86	ft
Critical Depth	0.64	ft
Critical Slope	0.01999	ft/ft
Velocity	3.52	ft/s
Velocity Head	0.19	ft
Specific Energy	0.80	ft
Froude Number	1.13	
Flow Type	Supercritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.61	ft
Critical Depth	0.64	ft
Channel Slope	0.02580	ft/ft
Critical Slope	0.01999	ft/ft

## Worksheet for Swale - C

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.030	
Channel Slope	0.02400	ft/ft
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Bottom Width	1.00	ft
Discharge	4.50	ft <sup>3</sup> /s

### Results

Normal Depth	0.47	ft
Flow Area	1.37	ft <sup>2</sup>
Wetted Perimeter	4.91	ft
Hydraulic Radius	0.28	ft
Top Width	4.79	ft
Critical Depth	0.49	ft
Critical Slope	0.02033	ft/ft
Velocity	3.28	ft/s
Velocity Head	0.17	ft
Specific Energy	0.64	ft
Froude Number	1.08	
Flow Type	Supercritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.47	ft
Critical Depth	0.49	ft
Channel Slope	0.02400	ft/ft
Critical Slope	0.02033	ft/ft

## Worksheet for Swale - D

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.030	
Channel Slope	0.02000	ft/ft
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Bottom Width	2.00	ft
Discharge	50.00	ft³/s

### Results

Normal Depth	1.26	ft
Flow Area	8.91	ft²
Wetted Perimeter	12.42	ft
Hydraulic Radius	0.72	ft
Top Width	12.10	ft
Critical Depth	1.35	ft
Critical Slope	0.01474	ft/ft
Velocity	5.61	ft/s
Velocity Head	0.49	ft
Specific Energy	1.75	ft
Froude Number	1.15	
Flow Type	Supercritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	1.26	ft
Critical Depth	1.35	ft
Channel Slope	0.02000	ft/ft
Critical Slope	0.01474	ft/ft

## Worksheet for Swale - E

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.030	
Channel Slope	0.00500	ft/ft
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Bottom Width	3.00	ft
Discharge	64.50	ft³/s

### Results

Normal Depth	1.79	ft
Flow Area	18.15	ft²
Wetted Perimeter	17.74	ft
Hydraulic Radius	1.02	ft
Top Width	17.30	ft
Critical Depth	1.42	ft
Critical Slope	0.01426	ft/ft
Velocity	3.55	ft/s
Velocity Head	0.20	ft
Specific Energy	1.98	ft
Froude Number	0.61	
Flow Type	Subcritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	1.79	ft
Critical Depth	1.42	ft
Channel Slope	0.00500	ft/ft
Critical Slope	0.01426	ft/ft



## Worksheet for Swale - F

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.030	
Channel Slope	0.01000	ft/ft
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Bottom Width	6.00	ft
Discharge	32.40	ft³/s

### Results

Normal Depth	0.91	ft
Flow Area	8.73	ft²
Wetted Perimeter	13.48	ft
Hydraulic Radius	0.65	ft
Top Width	13.26	ft
Critical Depth	0.80	ft
Critical Slope	0.01592	ft/ft
Velocity	3.71	ft/s
Velocity Head	0.21	ft
Specific Energy	1.12	ft
Froude Number	0.81	
Flow Type	Subcritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.91	ft
Critical Depth	0.80	ft
Channel Slope	0.01000	ft/ft
Critical Slope	0.01592	ft/ft

## Worksheet for Temporary Swale

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.030	
Channel Slope	0.01660	ft/ft
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Bottom Width	0.00	ft
Discharge	14.80	ft <sup>3</sup> /s

### Results

Normal Depth	0.98	ft
Flow Area	3.82	ft <sup>2</sup>
Wetted Perimeter	8.05	ft
Hydraulic Radius	0.47	ft
Top Width	7.81	ft
Critical Depth	0.97	ft
Critical Slope	0.01739	ft/ft
Velocity	3.88	ft/s
Velocity Head	0.23	ft
Specific Energy	1.21	ft
Froude Number	0.98	
Flow Type	Subcritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.98	ft
Critical Depth	0.97	ft
Channel Slope	0.01660	ft/ft

---

## Worksheet for Temporary Swale

---

### GVF Output Data


Critical Slope 0.01739 ft/ft

## **Inlet Calculations**

(FOR INFORMATION ONLY - NOT  
PART OF THE EARLY GRADING)

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

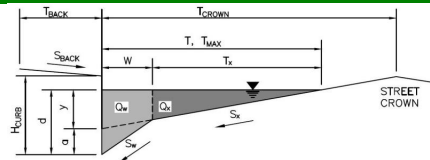Project: **Falcon Meadows at Bent Grass**Inlet ID: **DP 8 - Existing Sump Inlet (BG Filing No. 2)****Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Check boxes are not applicable in SUMP conditions

**MINOR STORM** Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} =$  14.0 ft  
 $S_{BACK} =$  0.020 ft/ft  
 $n_{BACK} =$  0.013

$H_{CURB} =$  6.00 inches  
 $T_{CROWN} =$  26.0 ft  
 $W =$  2.00 ft  
 $S_x =$  0.020 ft/ft  
 $S_W =$  0.083 ft/ft  
 $S_o =$  0.000 ft/ft  
 $n_{STREET} =$  0.016

	Minor Storm	Major Storm
$T_{MAX} =$	18.0	26.0
$d_{MAX} =$	6.0	12.0

inches


$Q_{allow} =$ 

Minor Storm	Major Storm
SUMP	SUMP

 cfs

# INLET IN A SUMP OR SAG LOCATION


Version 4.06 Released August 2018

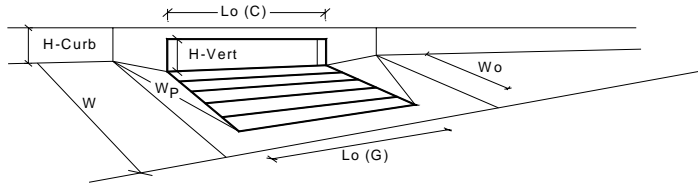

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a <sub>local</sub> =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	2	2	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	6.0	12.0	inches
<b>Grate Information</b>			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L <sub>o</sub> (G) =	N/A	N/A	feet
Width of a Unit Grate		W <sub>o</sub> =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A <sub>ratio</sub> =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C <sub>l</sub> (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C <sub>w</sub> (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C <sub>o</sub> (G) =	N/A	N/A	
<b>Curb Opening Information</b>			MINOR	MAJOR	
Length of a Unit Curb Opening		L <sub>o</sub> (C) =	10.00	10.00	feet
Height of Vertical Curb Opening in Inches		H <sub>vert</sub> =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H <sub>throat</sub> =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W <sub>p</sub> =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C <sub>l</sub> (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C <sub>w</sub> (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C <sub>o</sub> (C) =	0.67	0.67	
<b>Low Head Performance Reduction (Calculated)</b>			MINOR	MAJOR	
Depth for Grate Midwidth		d <sub>Grate</sub> =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d <sub>Curb</sub> =	0.33	0.83	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF <sub>Combination</sub> =	0.57	1.00	
Curb Opening Performance Reduction Factor for Long Inlets		RF <sub>Curb</sub> =	0.79	1.00	
Grated Inlet Performance Reduction Factor for Long Inlets		RF <sub>Grate</sub> =	N/A	N/A	
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>			MINOR	MAJOR	
		Q <sub>a</sub> =	14.4	52.7	cfs
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q <sub>PEAK REQUIRED</sub> =	11.5	36.4	cfs

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

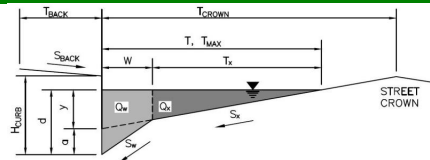Project: **Falcon Meadows at Bent Grass**Inlet ID: **DP 5 - At Grade Inlet****Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 8.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 16.5$  ft  
 $W = 2.00$  ft  
 $S_x = 0.020$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_o = 0.051$  ft/ft  
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	7.0	16.5	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes


**MINOR STORM** Allowable Capacity is based on Spread Criterion**MAJOR STORM** Allowable Capacity is based on Spread Criterion

	Minor Storm	Major Storm	
$Q_{allow} =$	3.4	22.8	cfs

**WARNING: MINOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'****Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'**

# INLET ON A CONTINUOUS GRADE

Version 4.06 Released August 2018

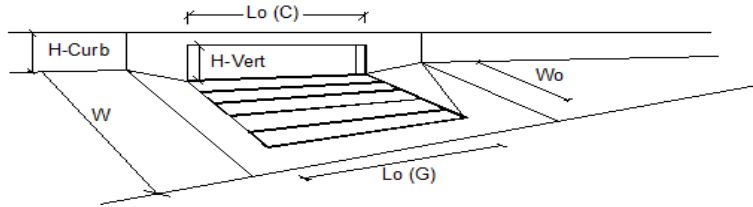

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		$a_{LOCAL} =$	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)		$L_o =$	10.00	10.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		$W_o =$	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_r G =$	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_r C =$	0.10	0.10	
<b>Street Hydraulics: WARNING: Q &gt; ALLOWABLE Q FOR MINOR STORM</b>					
Total Inlet Interception Capacity		Q =	3.6	9.2	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		$Q_b =$	0.0	7.3	cfs
Capture Percentage = $Q_i/Q_o =$		C% =	100	56	%



**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Falcon Meadows at Bent Grass

Inlet ID:

DP 12 - At Grade Inlet

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} =$  8.0 ft  
 $S_{BACK} =$  0.020 ft/ft  
 $n_{BACK} =$  0.016

$H_{CURB} =$  6.00 inches  
 $T_{CROWN} =$  16.5 ft  
 $W =$  2.00 ft  
 $S_x =$  0.020 ft/ft  
 $S_W =$  0.083 ft/ft  
 $S_O =$  0.013 ft/ft  
 $n_{STREET} =$  0.013

	Minor Storm	Major Storm	
$T_{MAX} =$	7.0	16.5	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion

$Q_{allow} =$ 


Minor Storm	Major Storm	
2.1	14.2	cfs

WARNING: MINOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'

WARNING: MAJOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'

## INLET ON A CONTINUOUS GRADE

Version 4.06 Released August 2018

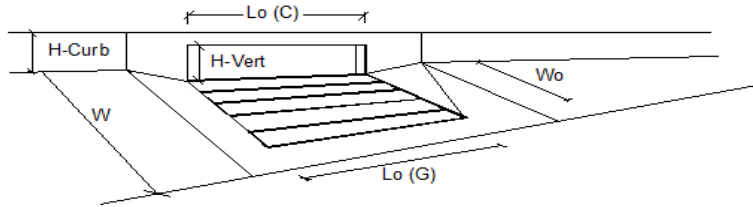

Design Information (Input)	CDOT Type R Curb Opening	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')		$a_{LOCAL} =$	3.0	3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)		$N_o =$	1	1
Length of a Single Unit Inlet (Grate or Curb Opening)		$L_o =$	15.00	15.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		$W_o =$	N/A	N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_r G =$	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_r C =$	0.10	0.10
<b>Street Hydraulics: WARNING: Q &gt; ALLOWABLE Q FOR MINOR &amp; MAJOR STORM</b>				
Total Inlet Interception Capacity		$Q =$	8.7	16.3 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		$Q_b =$	1.0	14.9 cfs
Capture Percentage = $Q_i/Q_o =$		$C\% =$	90	52 %

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Falcon Meadows at Bent Grass

Inlet ID:

DP 14 - At Grade Inlet

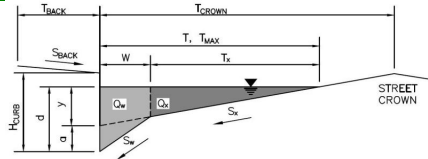**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 8.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 16.5$  ft  
 $W = 2.00$  ft  
 $S_x = 0.020$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_o = 0.013$  ft/ft  
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	7.0	16.5	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion

$Q_{allow} =$


	Minor Storm	Major Storm	
	1.7	11.5	cfs

WARNING: MINOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'

WARNING: MAJOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'

## INLET ON A CONTINUOUS GRADE

Version 4.06 Released August 2018

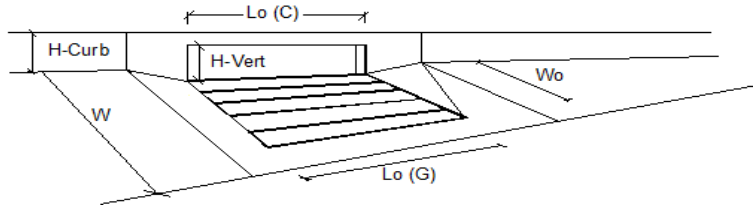

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0
Total Number of Units in the Inlet (Grate or Curb Opening)	1	1
Length of a Single Unit Inlet (Grate or Curb Opening)	15.00	15.00
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
<b>Street Hydraulics: WARNING: Q &gt; ALLOWABLE Q FOR MINOR &amp; MAJOR STORM</b>		
Total Inlet Interception Capacity	11.3	16.8
Total Inlet Carry-Over Flow (flow bypassing inlet)	2.6	13.1
Capture Percentage = $Q_i/Q_o$ =	82	56

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Falcon Meadows at Bent Grass

Inlet ID:

DP 15 - At Grade Inlet

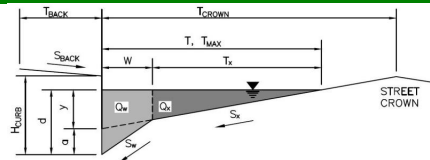**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 8.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.016$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 16.5$  ft  
 $W = 2.00$  ft  
 $S_x = 0.020$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_o = 0.013$  ft/ft  
 $n_{STREET} = 0.013$

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	7.0	16.5	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	2.1	14.2	cfs

WARNING: MINOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'

WARNING: MAJOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'

## INLET ON A CONTINUOUS GRADE

Version 4.06 Released August 2018

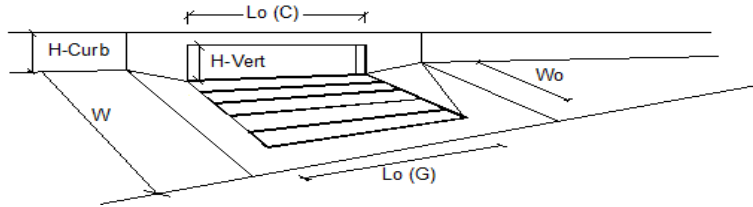

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0
Total Number of Units in the Inlet (Grate or Curb Opening)	1	1
Length of a Single Unit Inlet (Grate or Curb Opening)	15.00	15.00
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
<b>Street Hydraulics: WARNING: Q &gt; ALLOWABLE Q FOR MINOR &amp; MAJOR STORM</b>		
Total Inlet Interception Capacity	13.2	19.0
Total Inlet Carry-Over Flow (flow bypassing inlet)	6.9	24.7
Capture Percentage = $Q_i/Q_o$ =	66	43




**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: **Falcon Meadows at Bent Grass**

Inlet ID: **DP 16 - At Grade Inlet**

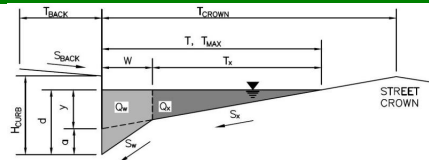**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 8.0$  ft

$S_{BACK} = 0.020$  ft/ft

$n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches

$T_{CROWN} = 16.5$  ft

$W = 2.00$  ft

$S_x = 0.020$  ft/ft

$S_w = 0.083$  ft/ft

$S_o = 0.013$  ft/ft

$n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	7.0	16.5	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes


**MINOR STORM** Allowable Capacity is based on Spread Criterion**MAJOR STORM** Allowable Capacity is based on Spread Criterion

	Minor Storm	Major Storm	
$Q_{allow} =$	1.7	11.5	cfs

**WARNING: MINOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'****WARNING: MAJOR STORM max. allowable capacity is less than the design flow given on sheet 'Inlet Management'**

## INLET ON A CONTINUOUS GRADE

Version 4.06 Released August 2018

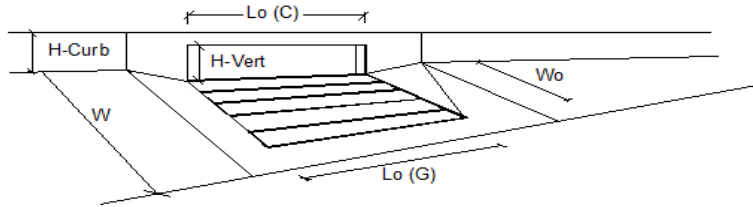


Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0
Total Number of Units in the Inlet (Grate or Curb Opening)	1	1
Length of a Single Unit Inlet (Grate or Curb Opening)	10.00	10.00
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
<b>Street Hydraulics: WARNING: Q &gt; ALLOWABLE Q FOR MINOR &amp; MAJOR STORM</b>		
Total Inlet Interception Capacity	7.8	12.7
Total Inlet Carry-Over Flow (flow bypassing inlet)	4.2	23.7
Capture Percentage = $Q_i/Q_o$ =	65	35

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: **Falcon Meadows at Bent Grass**

Inlet ID: **DP 17 - Sump Inlet**

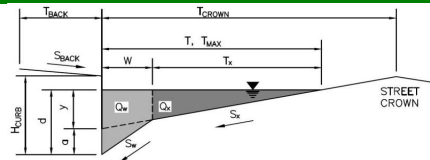**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Check boxes are not applicable in SUMP conditions

**MINOR STORM** Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 8.0$  ft

$S_{BACK} = 0.020$  ft/ft

$n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches

$T_{CROWN} = 16.5$  ft

$W = 2.00$  ft

$S_x = 0.020$  ft/ft

$S_w = 0.083$  ft/ft

$S_o = 0.000$  ft/ft

$n_{STREET} = 0.016$

	Minor Storm	Major Storm
$T_{MAX} =$	7.0	16.5
$d_{MAX} =$	6.0	12.0


inches

	Minor Storm	Major Storm
$Q_{allow} =$	SUMP	SUMP

cfs

# INLET IN A SUMP OR SAG LOCATION

Version 4.06 Released August 2018

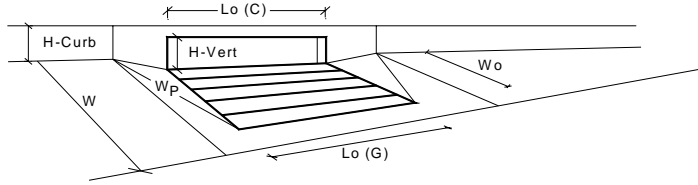


Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a <sub>local</sub> =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	2	2	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	4.4	5.7	inches
<b>Grate Information</b>			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L <sub>o</sub> (G) =	N/A	N/A	feet
Width of a Unit Grate		W <sub>o</sub> =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A <sub>ratio</sub> =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C <sub>l</sub> (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C <sub>w</sub> (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C <sub>o</sub> (G) =	N/A	N/A	
<b>Curb Opening Information</b>			MINOR	MAJOR	
Length of a Unit Curb Opening		L <sub>o</sub> (C) =	15.00	15.00	feet
Height of Vertical Curb Opening in Inches		H <sub>vert</sub> =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H <sub>throat</sub> =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W <sub>p</sub> =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C <sub>l</sub> (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C <sub>w</sub> (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C <sub>o</sub> (C) =	0.67	0.67	
<b>Low Head Performance Reduction (Calculated)</b>			MINOR	MAJOR	
Depth for Grate Midwidth		d <sub>Grate</sub> =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d <sub>Curb</sub> =	0.20	0.31	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF <sub>Combination</sub> =	0.42	0.54	
Curb Opening Performance Reduction Factor for Long Inlets		RF <sub>Curb</sub> =	0.67	0.77	
Grated Inlet Performance Reduction Factor for Long Inlets		RF <sub>Grate</sub> =	N/A	N/A	
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>			MINOR	MAJOR	
		Q <sub>a</sub> =	7.9	17.3	cfs
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q <sub>PEAK REQUIRED</sub> =	7.5	16.5	cfs

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: **Falcon Meadows at Bent Grass**

Inlet ID: **DP 18 - Sump Inlet**

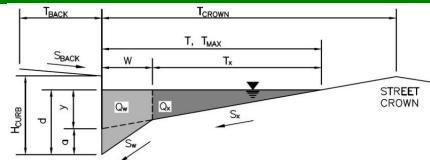**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Check boxes are not applicable in SUMP conditions

**MINOR STORM** Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 8.0$  ft

$S_{BACK} = 0.020$  ft/ft

$n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches

$T_{CROWN} = 16.5$  ft

$W = 2.00$  ft

$S_x = 0.020$  ft/ft

$S_w = 0.083$  ft/ft

$S_o = 0.000$  ft/ft

$n_{STREET} = 0.016$


	Minor Storm	Major Storm	
$T_{MAX} =$	7.0	16.5	ft
$d_{MAX} =$	6.0	6.0	inches

☐ ☐

	Minor Storm	Major Storm	
$Q_{allow} =$	SUMP	SUMP	cfs

# INLET IN A SUMP OR SAG LOCATION


Version 4.06 Released August 2018

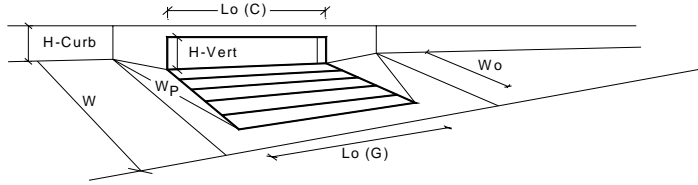

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a <sub>local</sub> =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	2	2	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	4.8	6.0	inches
<b>Grate Information</b>			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L <sub>o</sub> (G) =	N/A	N/A	feet
Width of a Unit Grate		W <sub>o</sub> =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A <sub>ratio</sub> =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C <sub>l</sub> (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C <sub>w</sub> (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C <sub>o</sub> (G) =	N/A	N/A	
<b>Curb Opening Information</b>			MINOR	MAJOR	
Length of a Unit Curb Opening		L <sub>o</sub> (C) =	15.00	15.00	feet
Height of Vertical Curb Opening in Inches		H <sub>vert</sub> =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H <sub>throat</sub> =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W <sub>p</sub> =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C <sub>l</sub> (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C <sub>w</sub> (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C <sub>o</sub> (C) =	0.67	0.67	
<b>Low Head Performance Reduction (Calculated)</b>			MINOR	MAJOR	
Depth for Grate Midwidth		d <sub>Grate</sub> =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d <sub>Curb</sub> =	0.23	0.33	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF <sub>Combination</sub> =	0.45	0.57	
Curb Opening Performance Reduction Factor for Long Inlets		RF <sub>Curb</sub> =	0.70	0.79	
Grated Inlet Performance Reduction Factor for Long Inlets		RF <sub>Grate</sub> =	N/A	N/A	
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>			MINOR	MAJOR	
		Q <sub>a</sub> =	10.4	19.9	cfs
<b>WARNING: Inlet Capacity less than Q Peak for Major Storm</b>		Q <sub>PEAK REQUIRED</sub> =	10.0	21.8	cfs

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

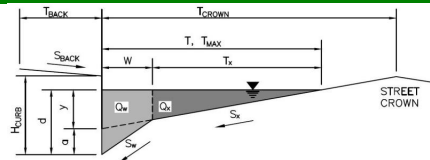Project: **Falcon Meadows at Bent Grass**Inlet ID: **DP 24 - Existing At Grade Inlet (BG Filing No. 2)****Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 14.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 26.0$  ft  
 $W = 2.00$  ft  
 $S_x = 0.020$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_o = 0.028$  ft/ft  
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	26.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

**MINOR STORM Allowable Capacity is based on Depth Criterion****MAJOR STORM Allowable Capacity is based on Spread Criterion**

$Q_{allow} =$ 

Minor Storm	Major Storm	
18.1	55.5	cfs


Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'



# INLET ON A CONTINUOUS GRADE


Version 4.06 Released August 2018

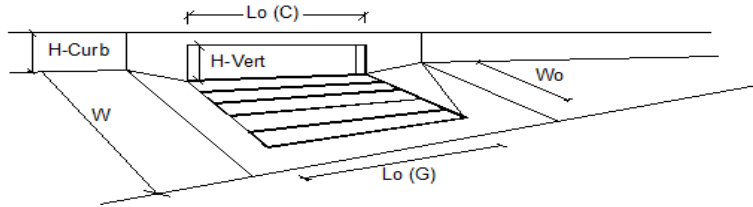

Design Information (Input)		MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening
Local Depression (additional to continuous gutter depression 'a')		$a_{LOCAL} =$	3.0 3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)		$N_o =$	1 1
Length of a Single Unit Inlet (Grate or Curb Opening)		$L_o =$	25.00 25.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		$W_o =$	N/A N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_r G =$	N/A N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_r C =$	0.10 0.10
<b>Street Hydraulics: OK - <math>Q &lt; \text{Allowable Street Capacity}</math></b>		MINOR	MAJOR
Total Inlet Interception Capacity		$Q =$	5.9 23.4 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		$Q_b =$	0.0 3.6 cfs
Capture Percentage = $Q_i/Q_o =$		$C\% =$	100 87 %

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

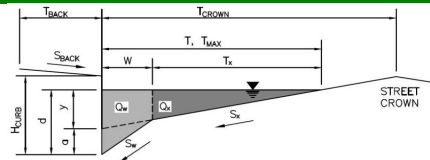Project: **Falcon Meadows at Bent Grass**Inlet ID: **DP 25 - Existing At Grade Inlet (BG Filing No. 2)****Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 14.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 26.0$  ft  
 $W = 2.00$  ft  
 $S_x = 0.020$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_o = 0.028$  ft/ft  
 $n_{STREET} = 0.013$

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	26.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

**MINOR STORM** Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	22.2	68.2	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

# INLET ON A CONTINUOUS GRADE


Version 4.06 Released August 2018

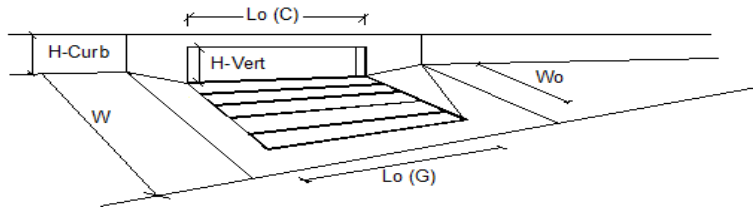

Design Information (Input)		MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening
Local Depression (additional to continuous gutter depression 'a')		$a_{LOCAL} =$	3.0 3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)		$N_o =$	1 1
Length of a Single Unit Inlet (Grate or Curb Opening)		$L_o =$	25.00 25.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		$W_o =$	N/A N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_F G =$	N/A N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_F C =$	0.10 0.10
<b>Street Hydraulics: OK - <math>Q &lt; \text{Allowable Street Capacity}</math></b>		MINOR	MAJOR
Total Inlet Interception Capacity		$Q =$	3.3 9.9 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		$Q_b =$	0.0 0.0 cfs
Capture Percentage = $Q_i/Q_o =$		$C\% =$	100 100 %

# AREA INLET IN A SWALE

Falcon Meadows at Bent Grass  
DP 11 - Type D Area Inlet (Relocated)

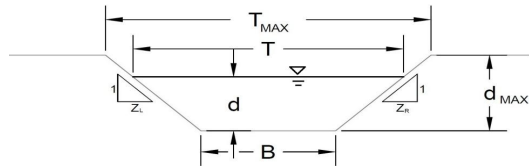

This worksheet uses the NRCS  
vegetal retardance method to  
determine Manning's n.

For more information see  
Section 7.2.3 of the USDCM.

## Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity ( $V_{MAX}$ )	Max Froude No. ( $F_{MAX}$ )
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D or E

n =	0.030	
$S_0$ =	0.0050	ft/ft
B =	3.00	ft
Z1 =	4.00	ft/ft
Z2 =	4.00	ft/ft

Choose One:

- ☐ Non-Cohesive  
☐ Cohesive  
☐ Paved

Max. Allowable Top Width of Channel for Minor & Major Storm

Max. Allowable Water Depth in Channel for Minor & Major Storm

	Minor Storm	Major Storm	
$T_{MAX}$ =	11.00	18.00	feet
$d_{MAX}$ =	1.00	2.00	feet

## Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Top Width Criterion

	Minor Storm	Major Storm	
$Q_{allow}$ =	17.9	72.2	cfs
$d_{allow}$ =	1.00	1.88	ft

## Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth


$Q_c$ =	13.8	64.5	cfs
d =	0.88	1.79	feet

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

# AREA INLET IN A SWALE

Falcon Meadows at Bent Grass  
DP 11 - Type D Area Inlet (Relocated)

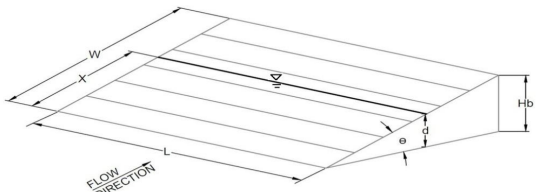
Inlet Design Information (Input)													
Type of Inlet	CDOT TYPE D (Parallel & Depressed)												
Inlet Type =	CDOT TYPE D (Parallel & Depressed)												
Angle of Inclined Grate (must be <= 30 degrees)	$\theta = 25.00$ degrees												
Width of Grate	$W = 6.00$ feet												
Length of Grate	$L = 3.00$ feet												
Open Area Ratio	$A_{\text{RATIO}} = 0.70$												
Height of Inclined Grate	$H_B = 1.27$ feet												
Clogging Factor	$C_1 = 0.38$												
Grate Discharge Coefficient	$C_d = 0.63$												
Orifice Coefficient	$C_o = 0.42$												
Weir Coefficient	$C_w = 1.34$												
													
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	<table border="1"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> </tr> </thead> <tbody> <tr> <td><math>d =</math></td> <td>1.88</td> <td>2.79</td> </tr> </tbody> </table>		MINOR	MAJOR	$d =$	1.88	2.79						
	MINOR	MAJOR											
$d =$	1.88	2.79											
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>	<table border="1"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> </tr> </thead> <tbody> <tr> <td><math>Q_a =</math></td> <td>44.1</td> <td>57.2</td> </tr> <tr> <td>Bypassed Flow, <math>Q_b =</math></td> <td>0.0</td> <td>7.3</td> </tr> <tr> <td>Capture Percentage = <math>Q_a/Q_o = C\%</math></td> <td>100</td> <td>89</td> </tr> </tbody> </table>		MINOR	MAJOR	$Q_a =$	44.1	57.2	Bypassed Flow, $Q_b =$	0.0	7.3	Capture Percentage = $Q_a/Q_o = C\%$	100	89
	MINOR	MAJOR											
$Q_a =$	44.1	57.2											
Bypassed Flow, $Q_b =$	0.0	7.3											
Capture Percentage = $Q_a/Q_o = C\%$	100	89											

Warning 04: Froude No. exceeds USDCM Volume I recommendation.

# AREA INLET IN A SWALE

Falcon Meadows at Bent Grass

DP 19 - Type C Area Inlet

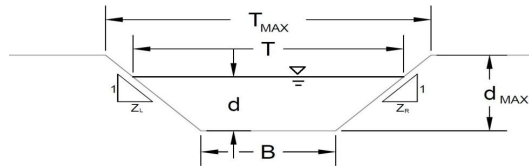

This worksheet uses the NRCS  
vegetal retardance method to  
determine Manning's n.

For more information see  
Section 7.2.3 of the USDCM.

## Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity ( $V_{MAX}$ )	Max Froude No. ( $F_{MAX}$ )
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D or E

n =	0.030	
$S_0$ =	0.0260	ft/ft
B =	0.00	ft
Z1 =	4.00	ft/ft
Z2 =	4.00	ft/ft

Choose One:

- ☒ Non-Cohesive  
☐ Cohesive  
☐ Paved

Max. Allowable Top Width of Channel for Minor &amp; Major Storm

Max. Allowable Water Depth in Channel for Minor &amp; Major Storm

	Minor Storm	Major Storm	
$T_{MAX}$ =	16.00	16.00	feet
$d_{MAX}$ =	1.00	1.00	feet

## Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
$Q_{allow}$ =	19.8	19.8	cfs
$d_{allow}$ =	1.00	1.00	ft

## Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

$Q_o$ =	2.0	5.2	cfs
d =	0.42	0.61	feet


Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

# AREA INLET IN A SWALE

Falcon Meadows at Bent Grass


DP 19 - Type C Area Inlet

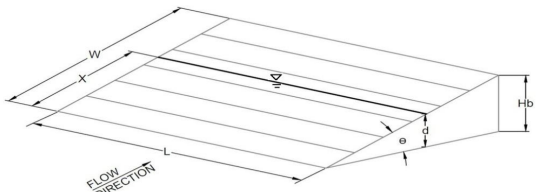Inlet Design Information (Input)	
Type of Inlet	CDOT Type C
Inlet Type =	CDOT Type C
Angle of Inclined Grate (must be <= 30 degrees)	$\theta = 0.00$ degrees
Width of Grate	$W = 3.00$ feet
Length of Grate	$L = 3.00$ feet
Open Area Ratio	$A_{\text{RATIO}} = 0.70$
Height of Inclined Grate	$H_B = 0.00$ feet
Clogging Factor	$C_1 = 0.50$
Grate Discharge Coefficient	$C_d = 0.96$
Orifice Coefficient	$C_o = 0.64$
Weir Coefficient	$C_w = 2.05$
	
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	$d = 0.42$ MINOR
	$d = 0.61$ MAJOR
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>	$Q_a = 5.1$ cfs
	$Q_b = 0.0$ cfs
	$Q_c = 0.0$ cfs
	$Q_d = 0.0$ cfs
	$Q_e = 0.0$ cfs
	$Q_f = 0.0$ cfs
	$Q_g = 0.0$ cfs
	$Q_h = 0.0$ cfs
	$Q_i = 0.0$ cfs
	$Q_j = 0.0$ cfs
	$Q_k = 0.0$ cfs
	$Q_l = 0.0$ cfs
	$Q_m = 0.0$ cfs
	$Q_n = 0.0$ cfs
	$Q_o = 0.0$ cfs
	$Q_p = 0.0$ cfs
	$Q_q = 0.0$ cfs
	$Q_r = 0.0$ cfs
	$Q_s = 0.0$ cfs
	$Q_t = 0.0$ cfs
	$Q_u = 0.0$ cfs
	$Q_v = 0.0$ cfs
	$Q_w = 0.0$ cfs
	$Q_x = 0.0$ cfs
	$Q_y = 0.0$ cfs
	$Q_z = 0.0$ cfs
	$Q_{aa} = 0.0$ cfs
	$Q_{ab} = 0.0$ cfs
	$Q_{ac} = 0.0$ cfs
	$Q_{ad} = 0.0$ cfs
	$Q_{ae} = 0.0$ cfs
	$Q_{af} = 0.0$ cfs
	$Q_{ag} = 0.0$ cfs
	$Q_{ah} = 0.0$ cfs
	$Q_{ai} = 0.0$ cfs
	$Q_{aj} = 0.0$ cfs
	$Q_{ak} = 0.0$ cfs
	$Q_{al} = 0.0$ cfs
	$Q_{am} = 0.0$ cfs
	$Q_{an} = 0.0$ cfs
	$Q_{ao} = 0.0$ cfs
	$Q_{ap} = 0.0$ cfs
	$Q_{aq} = 0.0$ cfs
	$Q_{ar} = 0.0$ cfs
	$Q_{as} = 0.0$ cfs
	$Q_{at} = 0.0$ cfs
	$Q_{au} = 0.0$ cfs
	$Q_{av} = 0.0$ cfs
	$Q_{aw} = 0.0$ cfs
	$Q_{ax} = 0.0$ cfs
	$Q_{ay} = 0.0$ cfs
	$Q_{az} = 0.0$ cfs
	$Q_{ba} = 0.0$ cfs
	$Q_{bb} = 0.0$ cfs
	$Q_{bc} = 0.0$ cfs
	$Q_{bd} = 0.0$ cfs
	$Q_{be} = 0.0$ cfs
	$Q_{bf} = 0.0$ cfs
	$Q_{bg} = 0.0$ cfs
	$Q_{bh} = 0.0$ cfs
	$Q_{bi} = 0.0$ cfs
	$Q_{bj} = 0.0$ cfs
	$Q_{bk} = 0.0$ cfs
	$Q_{bl} = 0.0$ cfs
	$Q_{bm} = 0.0$ cfs
	$Q_{bn} = 0.0$ cfs
	$Q_{bo} = 0.0$ cfs
	$Q_{bp} = 0.0$ cfs
	$Q_{bq} = 0.0$ cfs
	$Q_{br} = 0.0$ cfs
	$Q_{bs} = 0.0$ cfs
	$Q_{bt} = 0.0$ cfs
	$Q_{bu} = 0.0$ cfs
	$Q_{bv} = 0.0$ cfs
	$Q_{bw} = 0.0$ cfs
	$Q_{bx} = 0.0$ cfs
	$Q_{by} = 0.0$ cfs
	$Q_{bz} = 0.0$ cfs
	$Q_{ca} = 0.0$ cfs
	$Q_{cb} = 0.0$ cfs
	$Q_{cc} = 0.0$ cfs
	$Q_{cd} = 0.0$ cfs
	$Q_{ce} = 0.0$ cfs
	$Q_{cf} = 0.0$ cfs
	$Q_{cg} = 0.0$ cfs
	$Q_{ch} = 0.0$ cfs
	$Q_{ci} = 0.0$ cfs
	$Q_{cj} = 0.0$ cfs
	$Q_{ck} = 0.0$ cfs
	$Q_{cl} = 0.0$ cfs
	$Q_{cm} = 0.0$ cfs
	$Q_{cn} = 0.0$ cfs
	$Q_{co} = 0.0$ cfs
	$Q_{cp} = 0.0$ cfs
	$Q_{cq} = 0.0$ cfs
	$Q_{cr} = 0.0$ cfs
	$Q_{cs} = 0.0$ cfs
	$Q_{ct} = 0.0$ cfs
	$Q_{cu} = 0.0$ cfs
	$Q_{cv} = 0.0$ cfs
	$Q_{cw} = 0.0$ cfs
	$Q_{cx} = 0.0$ cfs
	$Q_{cy} = 0.0$ cfs
	$Q_{cz} = 0.0$ cfs
	$Q_{da} = 0.0$ cfs
	$Q_{db} = 0.0$ cfs
	$Q_{dc} = 0.0$ cfs
	$Q_{dd} = 0.0$ cfs
	$Q_{de} = 0.0$ cfs
	$Q_{df} = 0.0$ cfs
	$Q_{dg} = 0.0$ cfs
	$Q_{dh} = 0.0$ cfs
	$Q_{di} = 0.0$ cfs
	$Q_{dj} = 0.0$ cfs
	$Q_{dk} = 0.0$ cfs
	$Q_{dl} = 0.0$ cfs
	$Q_{dm} = 0.0$ cfs
	$Q_{dn} = 0.0$ cfs
	$Q_{do} = 0.0$ cfs
	$Q_{dp} = 0.0$ cfs
	$Q_{dq} = 0.0$ cfs
	$Q_{dr} = 0.0$ cfs
	$Q_{ds} = 0.0$ cfs
	$Q_{dt} = 0.0$ cfs
	$Q_{du} = 0.0$ cfs
	$Q_{dv} = 0.0$ cfs
	$Q_{dw} = 0.0$ cfs
	$Q_{dx} = 0.0$ cfs
	$Q_{dy} = 0.0$ cfs
	$Q_{dz} = 0.0$ cfs
	$Q_{ea} = 0.0$ cfs
	$Q_{eb} = 0.0$ cfs
	$Q_{ec} = 0.0$ cfs
	$Q_{ed} = 0.0$ cfs
	$Q_{ee} = 0.0$ cfs
	$Q_{ef} = 0.0$ cfs
	$Q_{eg} = 0.0$ cfs
	$Q_{eh} = 0.0$ cfs
	$Q_{ei} = 0.0$ cfs
	$Q_{ej} = 0.0$ cfs
	$Q_{ek} = 0.0$ cfs
	$Q_{el} = 0.0$ cfs
	$Q_{em} = 0.0$ cfs
	$Q_{en} = 0.0$ cfs
	$Q_{eo} = 0.0$ cfs
	$Q_{ep} = 0.0$ cfs
	$Q_{eq} = 0.0$ cfs
	$Q_{er} = 0.0$ cfs
	$Q_{es} = 0.0$ cfs
	$Q_{et} = 0.0$ cfs
	$Q_{eu} = 0.0$ cfs
	$Q_{ev} = 0.0$ cfs
	$Q_{ew} = 0.0$ cfs
	$Q_{ex} = 0.0$ cfs
	$Q_{ey} = 0.0$ cfs
	$Q_{ez} = 0.0$ cfs
	$Q_{fa} = 0.0$ cfs
	$Q_{fb} = 0.0$ cfs
	$Q_{fc} = 0.0$ cfs
	$Q_{fd} = 0.0$ cfs
	$Q_{fe} = 0.0$ cfs
	$Q_{ff} = 0.0$ cfs
	$Q_{fg} = 0.0$ cfs
	$Q_{fh} = 0.0$ cfs
	$Q_{fi} = 0.0$ cfs
	$Q_{fj} = 0.0$ cfs
	$Q_{fk} = 0.0$ cfs
	$Q_{fl} = 0.0$ cfs
	$Q_{fm} = 0.0$ cfs
	$Q_{fn} = 0.0$ cfs
	$Q_{fo} = 0.0$ cfs
	$Q_{fp} = 0.0$ cfs
	$Q_{fq} = 0.0$ cfs
	$Q_{fr} = 0.0$ cfs
	$Q_{fs} = 0.0$ cfs
	$Q_{ft} = 0.0$ cfs
	$Q_{fu} = 0.0$ cfs
	$Q_{fv} = 0.0$ cfs
	$Q_{fw} = 0.0$ cfs
	$Q_{fx} = 0.0$ cfs
	$Q_{fy} = 0.0$ cfs
	$Q_{fz} = 0.0$ cfs
	$Q_{ga} = 0.0$ cfs
	$Q_{gb} = 0.0$ cfs
	$Q_{gc} = 0.0$ cfs
	$Q_{gd} = 0.0$ cfs
	$Q_{ge} = 0.0$ cfs
	$Q_{gf} = 0.0$ cfs
	$Q_{gg} = 0.0$ cfs
	$Q_{gh} = 0.0$ cfs
	$Q_{gi} = 0.0$ cfs
	$Q_{gj} = 0.0$ cfs
	$Q_{gk} = 0.0$ cfs
	$Q_{gl} = 0.0$ cfs
	$Q_{gm} = 0.0$ cfs
	$Q_{gn} = 0.0$ cfs
	$Q_{go} = 0.0$ cfs
	$Q_{gp} = 0.0$ cfs
	$Q_{gq} = 0.0$ cfs
	$Q_{gr} = 0.0$ cfs
	$Q_{gs} = 0.0$ cfs
	$Q_{gt} = 0.0$ cfs
	$Q_{gu} = 0.0$ cfs
	$Q_{gv} = 0.0$ cfs
	$Q_{gw} = 0.0$ cfs
	$Q_{gx} = 0.0$ cfs
	$Q_{gy} = 0.0$ cfs
	$Q_{gz} = 0.0$ cfs
	$Q_{ha} = 0.0$ cfs
	$Q_{hb} = 0.0$ cfs
	$Q_{hc} = 0.0$ cfs
	$Q_{hd} = 0.0$ cfs
	$Q_{he} = 0.0$ cfs
	$Q_{hf} = 0.0$ cfs
	$Q_{hg} = 0.0$ cfs
	$Q_{hh} = 0.0$ cfs
	$Q_{hi} = 0.0$ cfs
	$Q_{hj} = 0.0$ cfs
	$Q_{hk} = 0.0$ cfs
	$Q_{hl} = 0.0$ cfs
	$Q_{hm} = 0.0$ cfs
	$Q_{hn} = 0.0$ cfs
	$Q_{ho} = 0.0$ cfs
	$Q_{hp} = 0.0$ cfs
	$Q_{hq} = 0.0$ cfs
	$Q_{hr} = 0.0$ cfs
	$Q_{hs} = 0.0$ cfs
	$Q_{ht} = 0.0$ cfs
	$Q_{hu} = 0.0$ cfs
	$Q_{hv} = 0.0$ cfs
	$Q_{hw} = 0.0$ cfs
	$Q_{hx} = 0.0$ cfs
	$Q_{hy} = 0.0$ cfs
	$Q_{hz} = 0.0$ cfs
	$Q_{ia} = 0.0$ cfs
	$Q_{ib} = 0.0$ cfs
	$Q_{ic} = 0.0$ cfs
	$Q_{id} = 0.0$ cfs
	$Q_{ie} = 0.0$ cfs
	$Q_{if} = 0.0$ cfs
	$Q_{ig} = 0.0$ cfs
	$Q_{ih} = 0.0$ cfs
	$Q_{ii} = 0.0$ cfs
	$Q_{ij} = 0.0$ cfs
	$Q_{ik} = 0.0$ cfs
	$Q_{il} = 0.0$ cfs
	$Q_{im} = 0.0$ cfs
	$Q_{in} = 0.0$ cfs
	$Q_{io} = 0.0$ cfs
	$Q_{ip} = 0.0$ cfs
	$Q_{iq} = 0.0$ cfs
	$Q_{ir} = 0.0$ cfs
	$Q_{is} = 0.0$ cfs
	$Q_{it} = 0.0$ cfs
	$Q_{iu} = 0.0$ cfs
	$Q_{iv} = 0.0$ cfs
	$Q_{iw} = 0.0$ cfs
	$Q_{ix} = 0.0$ cfs
	$Q_{iy} = 0.0$ cfs
	$Q_{iz} = 0.0$ cfs
	$Q_{ja} = 0.0$ cfs
	$Q_{jb} = 0.0$ cfs
	$Q_{jc} = 0.0$ cfs
	$Q_{jd} = 0.0$ cfs
	$Q_{je} = 0.0$ cfs
	$Q_{jf} = 0.0$ cfs
	$Q_{jg} = 0.0$ cfs
	$Q_{jh} = 0.0$ cfs
	$Q_{ji} = 0.0$ cfs
	$Q_{jj} = 0.0$ cfs
	$Q_{jk} = 0.0$ cfs
	$Q_{jl} = 0.0$ cfs
	$Q_{jm} = 0.0$ cfs
	$Q_{jn} = 0.0$ cfs
	$Q_{jo} = 0.0$ cfs
	$Q_{jp} = 0.0$ cfs
	$Q_{jq} = 0.0$ cfs
	$Q_{jr} = 0.0$ cfs
	$Q_{js} = 0.0$ cfs
	$Q_{jt} = 0.0$ cfs
	$Q_{ju} = 0.0$ cfs
	$Q_{jv} = 0.0$ cfs
	$Q_{jw} = 0.0$ cfs
	$Q_{jx} = 0.0$ cfs
	$Q_{jy} = 0.0$ cfs
	$Q_{jz} = 0.0$ cfs
	$Q_{ka} = 0.0$ cfs
	$Q_{kb} = 0.0$ cfs
	$Q_{kc} = 0.0$ cfs
	$Q_{kd} = 0.0$ cfs
	$Q_{ke} = 0.0$ cfs
	$Q_{kf} = 0.0$ cfs
	$Q_{kg} = 0.0$ cfs
	$Q_{kh} = 0.0$ cfs
	$Q_{ki} = 0.0$ cfs
	$Q_{kj} = 0.0$ cfs
	$Q_{kk} = 0.0$ cfs
	$Q_{kl} = 0.0$ cfs
	$Q_{km} = 0.0$ cfs
	$Q_{kn} = 0.0$ cfs
	$Q_{ko} = 0.0$ cfs
	$Q_{kp} = 0.0$ cfs
	$Q_{kq} = 0.0$ cfs
	$Q_{kr} = 0.0$ cfs
	$Q_{ks} = 0.0$ cfs
	$Q_{kt} = 0.0$ cfs
	$Q_{ku} = 0.0$ cfs
	$Q_{kv} = 0.0$ cfs
	$Q_{kw} = 0.0$ cfs
	$Q_{kx} = 0.0$ cfs
	$Q_{ky} = 0.0$ cfs
	$Q_{kz} = 0.0$ cfs
	$Q_{la} = 0.0$ cfs
	$Q_{lb} = 0.0$ cfs
	$Q_{lc} = 0.0$ cfs
	$Q_{ld} = 0.0$ cfs
	$Q_{le} = 0.0$ cfs
	$Q_{lf} = 0.0$ cfs
	$Q_{lg} = 0.0$ cfs
	$Q_{lh} = 0.0$ cfs
	$Q_{li} = 0.0$ cfs
	$Q_{lj} = 0.0$ cfs
	$Q_{lk} = 0.0$ cfs
	$Q_{ll} = 0.0$ cfs
	$Q_{lm} = 0.0$ cfs
	$Q_{ln} = 0.0$ cfs
	$Q_{lo} = 0.0$ cfs
	$Q_{lp} = 0.0$ cfs
	$Q_{lq} = 0.0$ cfs
	$Q_{lr} = 0.0$ cfs
	$Q_{ls} = 0.0$ cfs
	$Q_{lt} = 0.0$ cfs
	$Q_{lu} = 0.0$ cfs
	$Q_{lv} = 0.0$ cfs
	$Q_{lw} = 0.0$ cfs
	$Q_{lx} = 0.0$ cfs
	$Q_{ly} = 0.0$ cfs
	$Q_{lz} = 0.0$ cfs
	$Q_{ma} = 0.0$ cfs
	$Q_{mb} = 0.0$ cfs
	$Q_{mc} = 0.0$ cfs
	$Q_{md} = 0.0$ cfs



**StormCAD**

# BG Filing No. 3 Storm

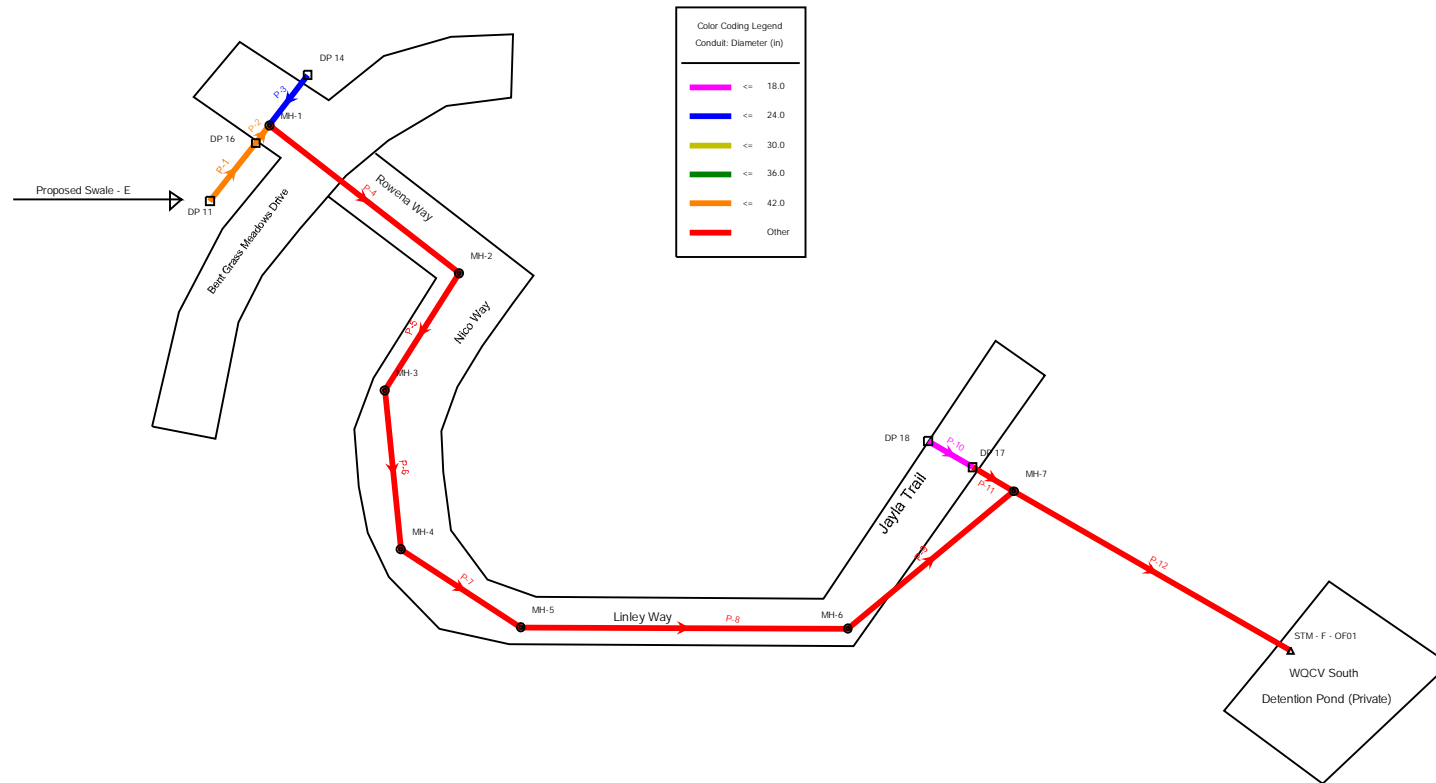

BG Filing No. 3 Storm  
FlexTable: Conduit Table  
Active Scenario: 100 YR

Label	Start Node	Stop Node	Length (User Defined) (ft)	Diameter (in)	Manning's n	Capacity (Full Flow) (cfs)	Flow (cfs)	Velocity (ft/s)	Elevation Ground (Start) (ft)	Invert (Start) (ft)	Hydraulic Grade Line (In) (ft)	Elevation Ground (Stop) (ft)	Invert (Stop) (ft)	Hydraulic Grade Line (Out) (ft)	Slope (Calculated) (ft/ft)
P-12	MH-7	Outfall	296.0	54.0	0.013	139.06	129.11	9.93	6,941.75	6,927.48	6,930.91	6,929.00	6,926.00	6,929.34	0.005
P-1	DP 11	DP 16	96.5	42.0	0.013	97.69	56.02	10.50	6,945.00	6,940.50	6,943.92	6,948.24	6,939.59	6,943.63	0.009
P-2	DP 16	MH-1	5.0	42.0	0.013	100.60	86.57	9.00	6,948.24	6,939.29	6,943.00	6,947.98	6,939.24	6,942.97	0.010
P-3	DP 14	MH-1	27.5	24.0	0.013	48.44	24.85	15.52	6,948.24	6,942.50	6,944.26	6,947.98	6,941.24	6,942.46	0.046
P-4	MH-1	MH-2	211.5	48.0	0.013	142.80	106.07	12.45	6,947.98	6,938.74	6,941.86	6,946.72	6,936.65	6,940.56	0.010
P-5	MH-2	MH-3	132.1	48.0	0.013	143.59	105.37	12.49	6,946.72	6,936.35	6,939.46	6,945.39	6,935.03	6,938.93	0.010
P-6	MH-3	MH-4	75.2	48.0	0.013	142.45	104.93	12.40	6,945.39	6,934.73	6,937.83	6,944.74	6,933.99	6,937.91	0.010
P-7	MH-4	MH-5	61.2	48.0	0.013	143.39	104.68	12.45	6,944.74	6,933.69	6,936.88	6,944.50	6,933.08	6,936.97	0.010
P-8	MH-5	MH-6	235.3	48.0	0.013	159.45	104.48	13.53	6,944.50	6,932.78	6,935.88	6,942.08	6,929.88	6,933.75	0.012
P-9	MH-6	MH-7	119.8	48.0	0.013	166.03	103.76	13.94	6,942.08	6,929.58	6,932.66	6,941.75	6,927.98	6,932.13	0.013
P-10	DP 18	DP 17	35.0	18.0	0.013	13.75	13.85	7.83	6,941.57	6,931.23	6,932.82	6,941.57	6,930.63	6,932.21	0.017
P-11	DP 17	MH-7	9.2	48.0	0.013	105.77	29.99	2.39	6,941.57	6,928.13	6,932.14	6,941.75	6,928.08	6,932.13	0.005


BG Filing No. 3 Storm  
FlexTable: Manhole Table  
Active Scenario: 100 YR

Label	Elevation (Rim) (ft)	Headloss Coefficient (Standard)	Headloss Method	Headloss (ft)	Hydraulic Grade Line (Out) (ft)	Hydraulic Grade Line (In) (ft)	Energy Grade Line (In) (ft)	Energy Grade Line (Out) (ft)	Diameter (in)
MH-1	6,947.98	0.700	Standard	1.11	6,941.86	6,942.97	6,945.35	6,943.44	84.0
MH-2	6,946.72	0.700	Standard	1.10	6,939.46	6,940.56	6,941.68	6,941.03	96.0
MH-3	6,945.39	0.700	Standard	1.10	6,937.83	6,938.93	6,940.04	6,939.40	96.0
MH-4	6,944.74	0.700	Standard	1.03	6,936.88	6,937.91	6,939.01	6,938.36	96.0
MH-5	6,944.50	0.700	Standard	1.09	6,935.88	6,936.97	6,938.06	6,937.43	96.0
MH-6	6,942.08	0.700	Standard	1.08	6,932.66	6,933.75	6,934.84	6,934.21	96.0
MH-7	6,941.75	0.800	Standard	1.23	6,930.91	6,932.13	6,933.19	6,932.44	96.0


BG Filing No. 3 Storm  
FlexTable: Outfall Table  
Active Scenario: 100 YR

Label	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Boundary Condition Type	Elevation (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Energy Grade Line (ft)	Flow (Total Out) (cfs)
Outfall	6,929.00	6,926.00	User Defined Tailwater	6,928.46	6,929.34	6,929.34	127.58

BG Filing No. 3 Storm  
Profile Report  
Engineering Profile - Profile - 1 (BG Filing 3 StormCAD.stsw)  
Active Scenario: 100 YR

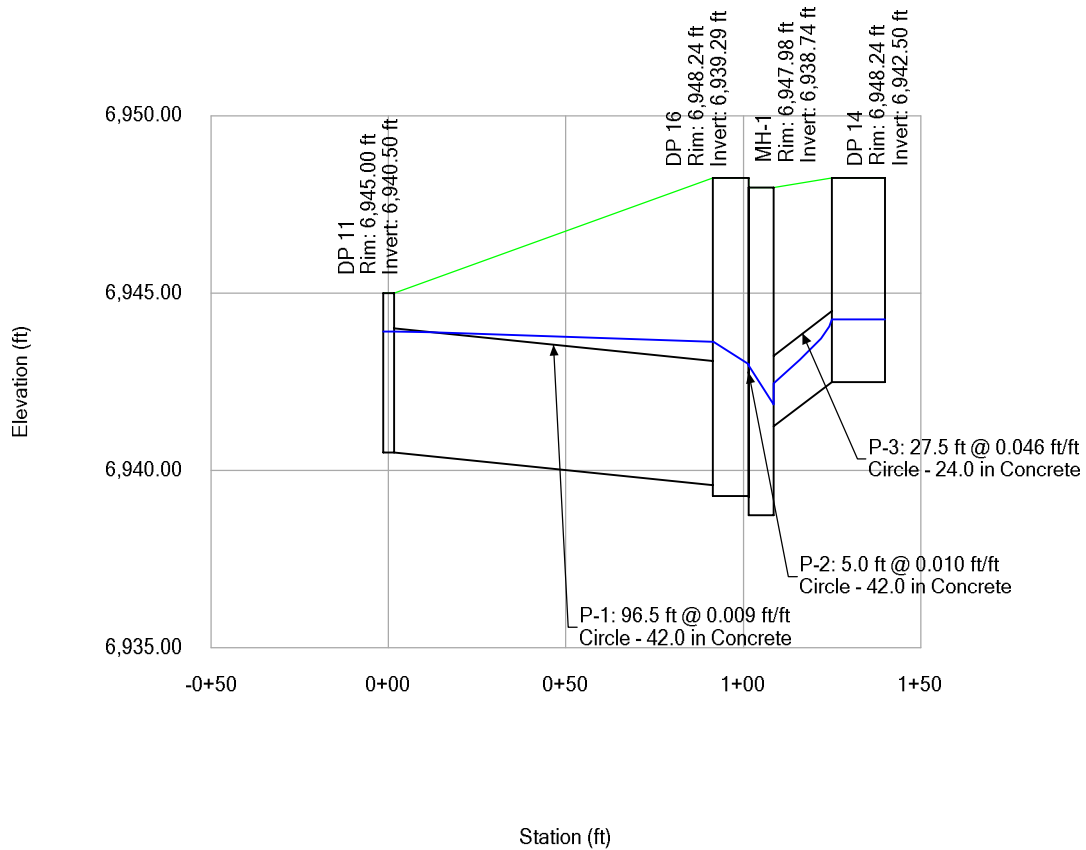


# BG Filing No. 3 Storm Profile Report Engineering Profile - Profile - 2 (BG Filing 3 StormCAD.stsw) Active Scenario: 100 YR

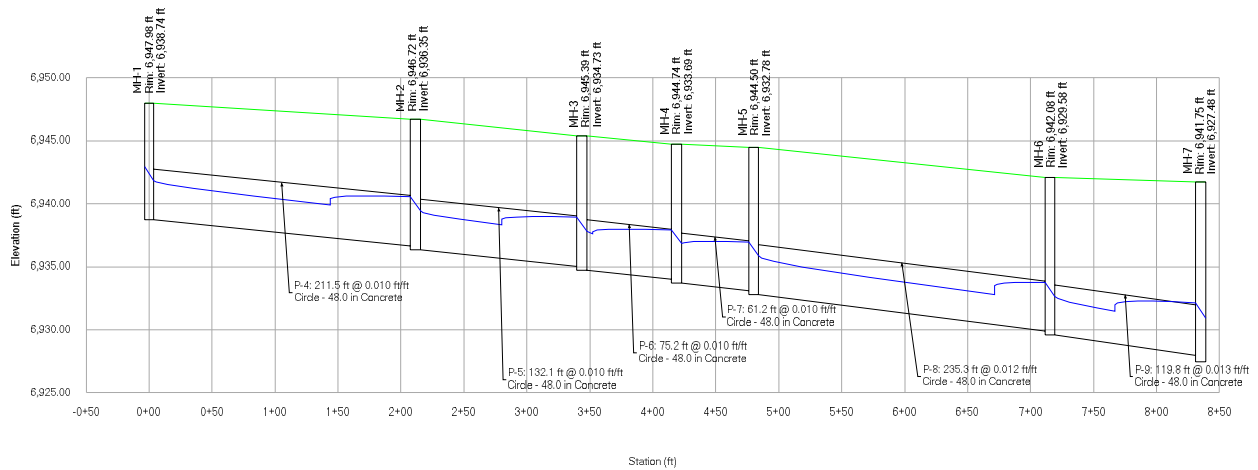



# BG Filing No. 3 Storm Profile Report Engineering Profile - Profile - 3 (BG Filing 3 StormCAD.stsw) Active Scenario: 100 YR

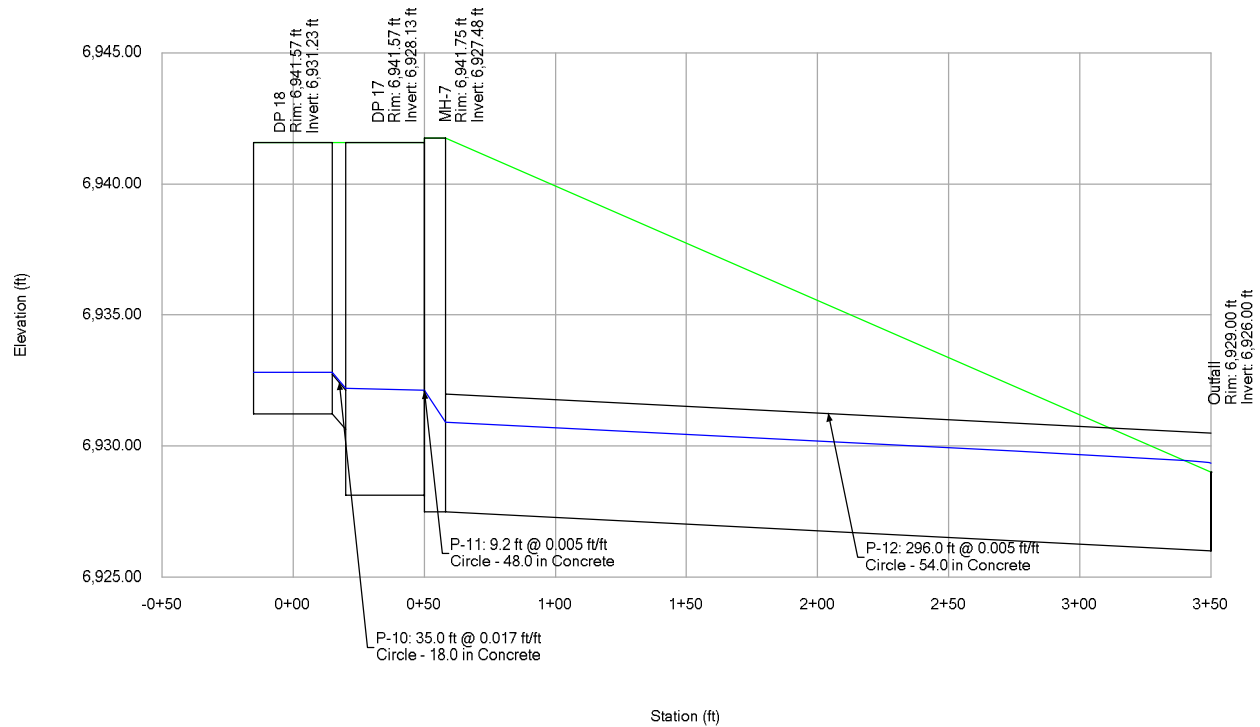

BG Filing No. 3 Storm  
FlexTable: Conduit Table  
Active Scenario: 5 YR

Label	Start Node	Stop Node	Length (User Defined) (ft)	Diameter (in)	Manning's n	Capacity (Full Flow) (cfs)	Flow (cfs)	Velocity (ft/s)	Elevation Ground (Start) (ft)	Invert (Start) (ft)	Hydraulic Grade Line (In) (ft)	Elevation Ground (Stop) (ft)	Invert (Stop) (ft)	Hydraulic Grade Line (Out) (ft)	Slope (Calculated) (ft/ft)
P-12	MH-7	Outfall	296.0	54.0	0.013	139.06	38.32	7.47	6,941.75	6,927.48	6,929.26	6,929.00	6,926.00	6,927.61	0.005
P-1	DP 11	DP 16	96.5	42.0	0.013	97.69	11.00	6.72	6,945.00	6,940.50	6,941.50	6,948.24	6,939.59	6,940.93	0.009
P-2	DP 16	MH-1	5.0	42.0	0.013	100.60	20.45	8.20	6,948.24	6,939.29	6,940.68	6,947.98	6,939.24	6,940.74	0.010
P-3	DP 14	MH-1	27.5	24.0	0.013	48.44	10.55	12.33	6,948.24	6,942.50	6,943.66	6,947.98	6,941.24	6,941.96	0.046
P-4	MH-1	MH-2	211.5	48.0	0.013	142.80	28.71	8.89	6,947.98	6,938.74	6,940.33	6,946.72	6,936.65	6,938.34	0.010
P-5	MH-2	MH-3	132.1	48.0	0.013	143.59	28.45	8.90	6,946.72	6,936.35	6,937.93	6,945.39	6,935.03	6,936.72	0.010
P-6	MH-3	MH-4	75.2	48.0	0.013	142.45	28.28	8.83	6,945.39	6,934.73	6,936.31	6,944.74	6,933.99	6,935.67	0.010
P-7	MH-4	MH-5	61.2	48.0	0.013	143.39	28.19	8.87	6,944.74	6,933.69	6,935.26	6,944.50	6,933.08	6,934.76	0.010
P-8	MH-5	MH-6	235.3	48.0	0.013	159.45	28.11	9.56	6,944.50	6,932.78	6,934.35	6,942.08	6,929.88	6,931.55	0.012
P-9	MH-6	MH-7	119.8	48.0	0.013	166.03	27.84	9.81	6,942.08	6,929.58	6,931.14	6,941.75	6,927.98	6,929.79	0.013
P-10	DP 18	DP 17	35.0	18.0	0.013	13.75	5.72	7.42	6,941.57	6,931.23	6,932.15	6,941.57	6,930.63	6,931.33	0.017
P-11	DP 17	MH-7	9.2	48.0	0.013	105.77	12.53	5.65	6,941.57	6,928.13	6,929.79	6,941.75	6,928.08	6,929.79	0.005


BG Filing No. 3 Storm  
FlexTable: Manhole Table  
Active Scenario: 5 YR

Label	Elevation (Rim) (ft)	Headloss Coefficient (Standard)	Headloss Method	Headloss (ft)	Hydraulic Grade Line (Out) (ft)	Hydraulic Grade Line (In) (ft)	Energy Grade Line (In) (ft)	Energy Grade Line (Out) (ft)	Diameter (in)
MH-1	6,947.98	0.700	Standard	0.42	6,940.33	6,940.74	6,941.16	6,940.92	84.0
MH-2	6,946.72	0.700	Standard	0.41	6,937.93	6,938.34	6,938.84	6,938.52	96.0
MH-3	6,945.39	0.700	Standard	0.41	6,936.31	6,936.72	6,937.21	6,936.89	96.0
MH-4	6,944.74	0.700	Standard	0.41	6,935.26	6,935.67	6,936.17	6,935.85	96.0
MH-5	6,944.50	0.700	Standard	0.41	6,934.35	6,934.76	6,935.25	6,934.94	96.0
MH-6	6,942.08	0.700	Standard	0.41	6,931.14	6,931.55	6,932.05	6,931.73	96.0
MH-7	6,941.75	0.800	Standard	0.53	6,929.26	6,929.79	6,930.19	6,929.93	96.0


BG Filing No. 3 Storm  
FlexTable: Outfall Table  
Active Scenario: 5 YR

Label	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Boundary Condition Type	Elevation (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Energy Grade Line (ft)	Flow (Total Out) (cfs)
Outfall	6,929.00	6,926.00	User Defined Tailwater	6,926.78	6,927.61	6,927.61	37.71


BG Filing No. 3 Storm  
Profile Report  
Engineering Profile - Profile - 1 (BG Filing 3 StormCAD.stsw)  
Active Scenario: 5 YR

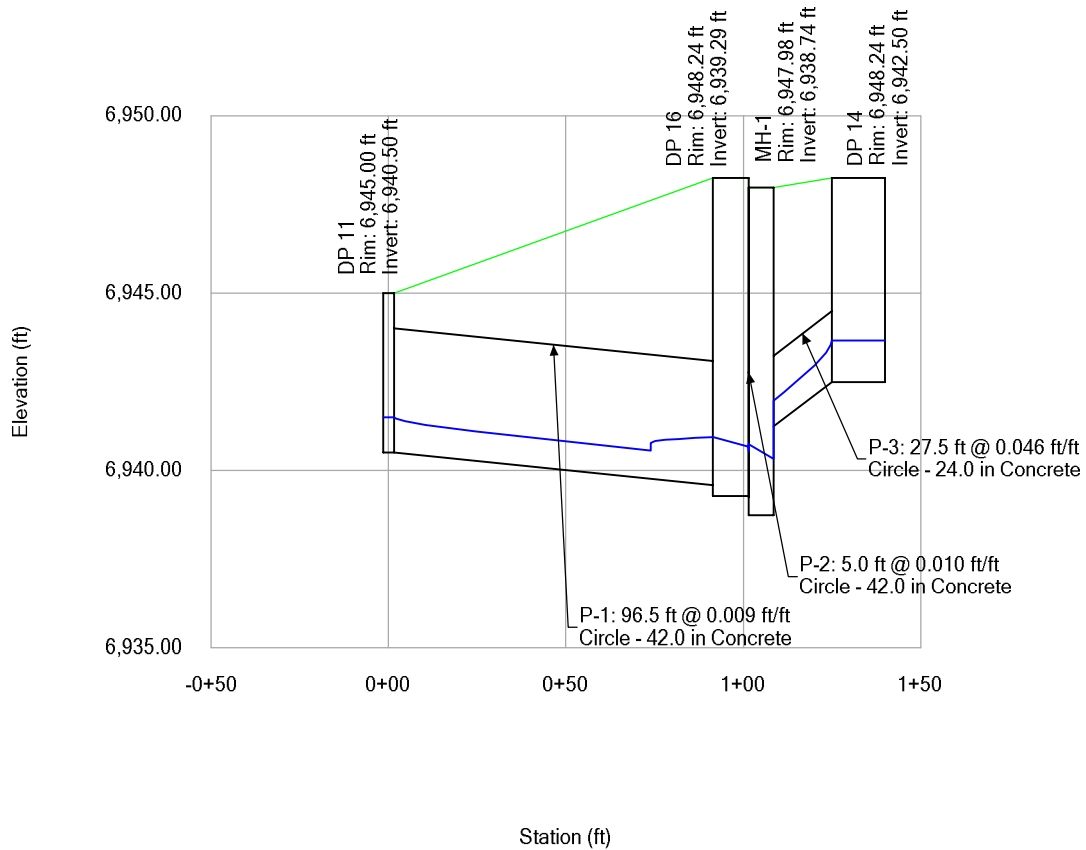

# BG Filing No. 3 Storm Profile Report Engineering Profile - Profile - 2 (BG Filing 3 StormCAD.stsw) Active Scenario: 5 YR

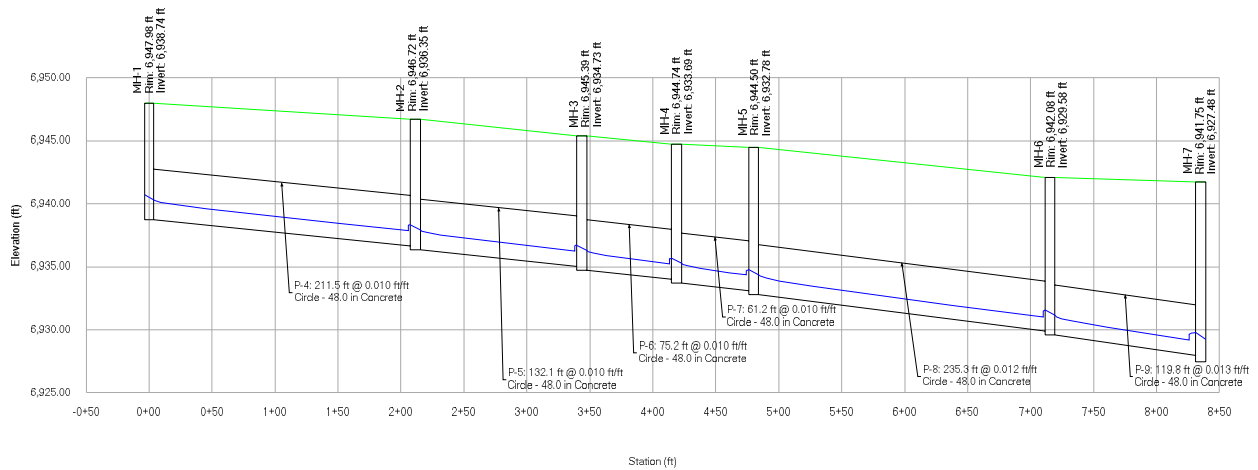


# BG Filing No. 3 Storm Profile Report Engineering Profile - Profile - 3 (BG Filing 3 StormCAD.stsw) Active Scenario: 5 YR

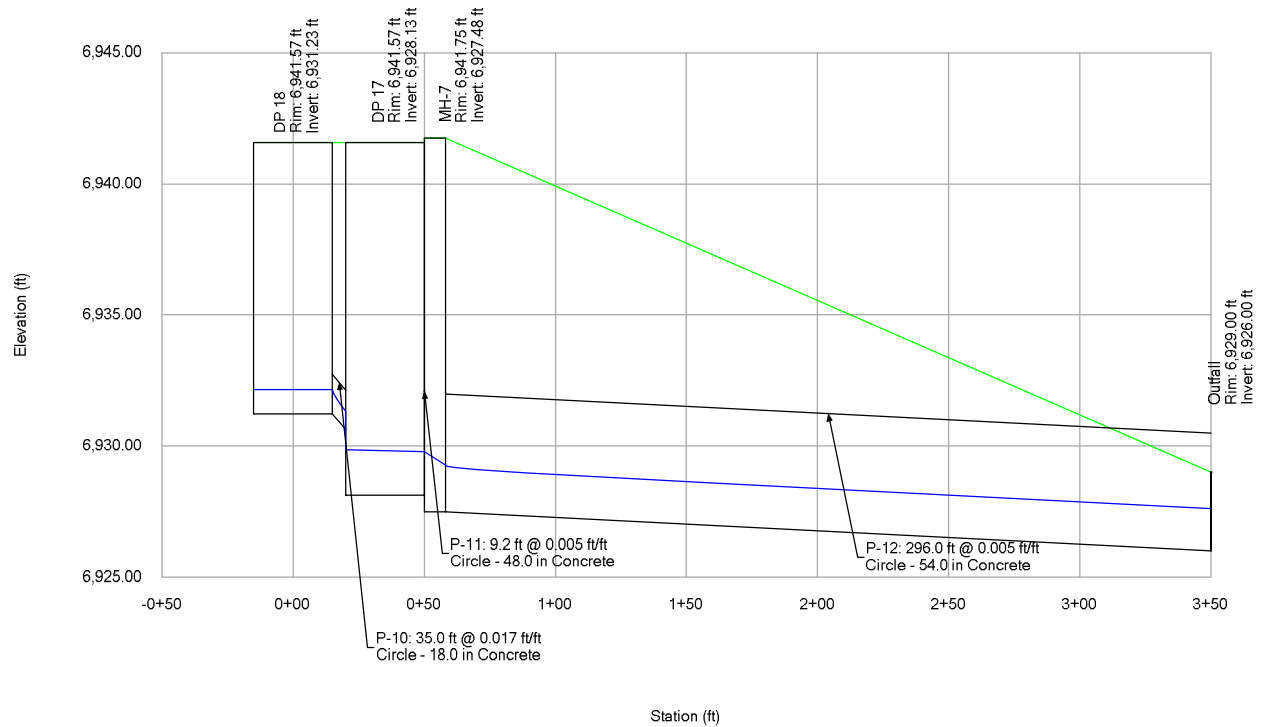

## Pond Calculations



MHFD-Detention, Version 4.04 (February 2021)

Basin ID: Interim (Existing) Sed Basin @ Bent Grass Meadows Drive - Drain Time Analysis

Selected BMP Type =	EDB	
Watershed Area =	49.08	acres
Watershed Length =	2,100	ft
Watershed Length to Centroid =	500	ft
Watershed Slope =	0.025	ft/ft
Watershed Imperviousness =	8.80%	percent
Percentage Hydrologic Soil Group A =	100.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths = User Input		

### Optional User Overrides

Water Quality Capture Volume (WQCV) =	0.246	acre-feet
Excess Urban Runoff Volume (EURV) =	0.306	acre-feet
2-yr Runoff Volume ( $P1 = 1.19 \text{ in.}$ ) =	0.000	acre-feet
5-yr Runoff Volume ( $P1 = 1.5 \text{ in.}$ ) =	0.000	acre-feet
10-yr Runoff Volume ( $P1 = 1.75 \text{ in.}$ ) =	0.000	acre-feet
25-yr Runoff Volume ( $P1 = 2 \text{ in.}$ ) =	0.000	acre-feet
50-yr Runoff Volume ( $P1 = 2.25 \text{ in.}$ ) =	0.000	acre-feet
100-yr Runoff Volume ( $P1 = 2.52 \text{ in.}$ ) =	0.000	acre-feet
500-yr Runoff Volume ( $P1 = 3.68 \text{ in.}$ ) =	0.000	acre-feet
Approximate 2-yr Detention Volume =	0.182	acre-feet
Approximate 5-yr Detention Volume =	0.251	acre-feet
Approximate 10-yr Detention Volume =	0.333	acre-feet
Approximate 25-yr Detention Volume =	0.454	acre-feet
Approximate 50-yr Detention Volume =	0.629	acre-feet
Approximate 100-yr Detention Volume =	1.066	acre-feet

Zone 1 Volume (WCV <sub>1</sub> )	=	0.246	acre-feet
Select Zone 2 Storage Volume (Optional)	=		acre-feet
Select Zone 3 Storage Volume (Optional)	=		acre-feet
Total Detention Basin Volume	=	0.246	acre-feet
Initial Surcharge Volume (ISV)	=	user	ft <sup>3</sup>
Initial Surcharge Depth (ISD)	=	user	ft
Total Available Detention Depth (H <sub>total</sub> )	=	user	ft
Depth of Trickle Channel (H <sub>TC</sub> )	=	user	ft
Slope of Trickle Channel (S <sub>TC</sub> )	=	user	ft/ft
Slopes of Main Basin Sides (S <sub>main</sub> )	=	user	H:V
Basin Length-to-Width Ratio (R <sub>L/W</sub> )	=	user	


Total detention volume is less than 100-year volume.

Initial Surcharge Area ( $A_{ISV}$ )	=	user	ft <sup>2</sup>
Surcharge Volume Length ( $L_{ISV}$ )	=	user	ft
Surcharge Volume Width ( $W_{ISV}$ )	=	user	ft
Depth of Basin Floor ( $H_{FLOOR}$ )	=	user	ft
Length of Basin Floor ( $L_{FLOOR}$ )	=	user	ft
Width of Basin Floor ( $W_{FLOOR}$ )	=	user	ft
Area of Basin Floor ( $A_{FLOOR}$ )	=	user	ft <sup>2</sup>
Volume of Basin Floor ( $V_{FLOOR}$ )	=	user	ft <sup>3</sup>
Depth of Main Basin ( $H_{MAIN}$ )	=	user	ft
Length of Main Basin ( $L_{MAIN}$ )	=	user	ft
Width of Main Basin ( $W_{MAIN}$ )	=	user	ft
Area of Main Basin ( $A_{MAIN}$ )	=	user	ft <sup>2</sup>
Volume of Main Basin ( $V_{MAIN}$ )	=	user	ft <sup>3</sup>
Calculated Total Basin Volume ( $V_{TOTAL}$ )	=	USER	acre-feet

[illegible]

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Defention, Version 4.04 (February 2021)

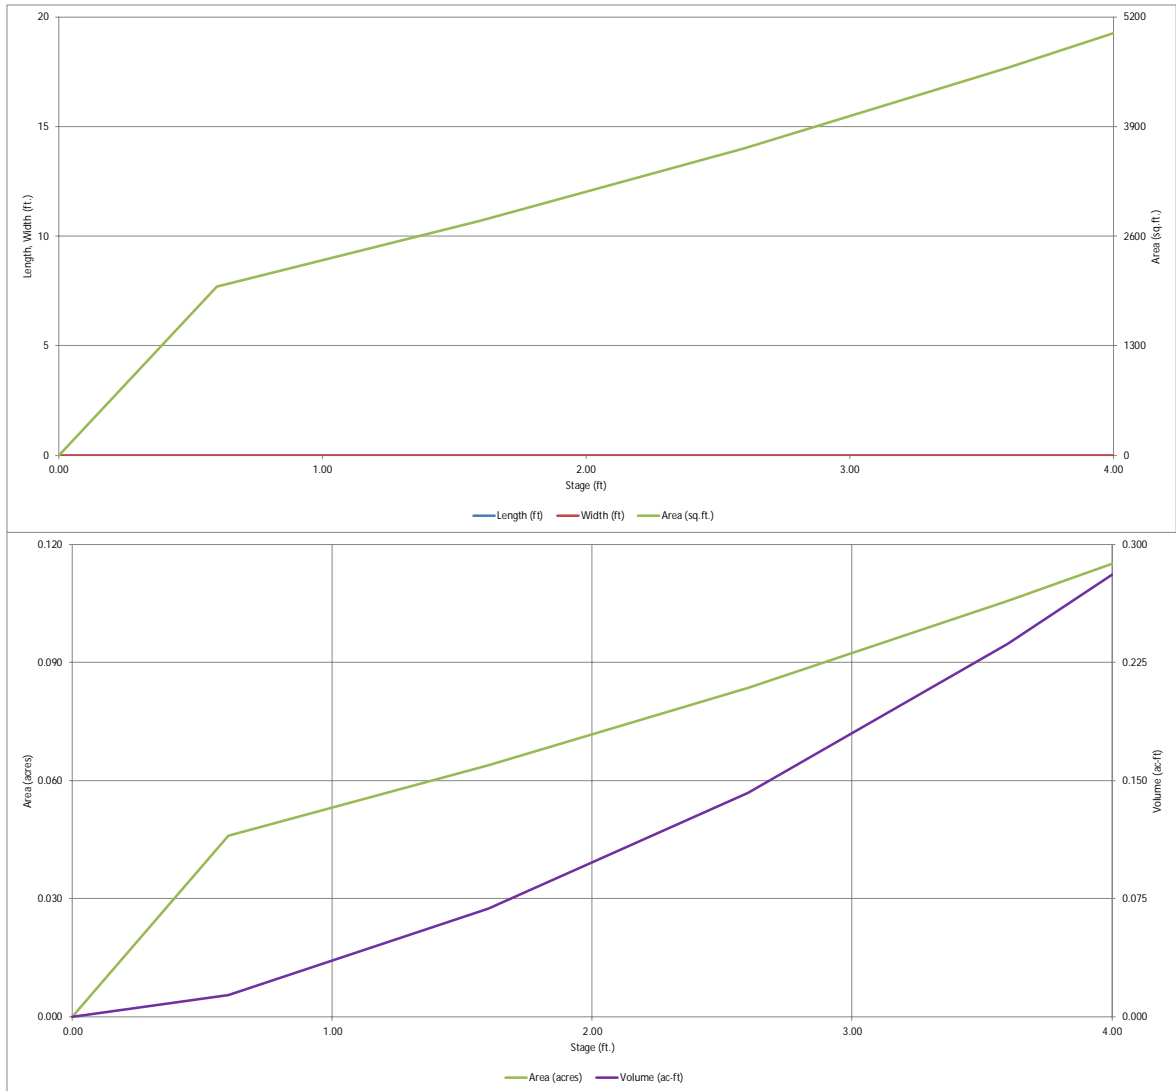


# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-DETENTION, Version 4.04 (February 2021)

Project: Falcon Meadows at Bent Grass

Basin ID: Interim (Existing) Sed Basin @ Bent Grass Meadows Drive - Drain Time Analysis

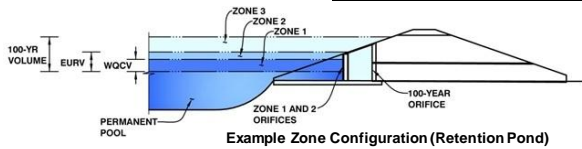

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	3.69	0.246	Orifice Plate
Zone 2			
Zone 3			
Total (all zones)		0.246	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =	N/A	ft (distance below the filtration media surface)
Underdrain Orifice Diameter =	N/A	inches

Calculated Parameters for Underdrain	
Underdrain Orifice Area =	N/A ft <sup>2</sup>
Underdrain Orifice Centroid =	N/A feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =	0.00	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate =	3.00	ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing =	N/A	inches
Orifice Plate: Orifice Area per Row =	N/A	inches

Calculated Parameters for Plate	
WO Orifice Area per Row =	N/A ft <sup>2</sup>
Elliptical Half-Width =	N/A feet
Elliptical Slot Centroid =	N/A feet
Elliptical Slot Area =	N/A ft <sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.25	1.58	1.92	2.25	2.58	2.92	
Orifice Area (sq. inches)	0.56	2.22	2.22	2.22	2.22	2.22	2.22	

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =			ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =			ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =			inches

Calculated Parameters for Vertical Orifice		
	Not Selected	Not Selected
Vertical Orifice Area =		ft <sup>2</sup>
Vertical Orifice Centroid =		feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Gate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

	Not Selected	Not Selected	
Overflow Weir Front Edge Height, H <sub>o</sub> =	3.00		ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	1.00		feet
Overflow Weir Gate Slope =	0.00		H:V
Horiz. Length of Weir Sides =	1.00		feet
Overflow Gate Type =	No Gate		
Debris Clogging % =	50%		%

Type)		Calculated Parameters for Overflow Weir		
		Not Selected	Not Selected	
ft)	Height of Gate Upper Edge, $H_1$ =	3.00		feet
	Overflow Weir Slope Length =	1.00		feet
	Gate Open Area / 100-yr Orifice Area =			
	Overflow Gate Open Area w/o Debris =	1.00		ft <sup>2</sup>
	Overflow Gate Open Area w/ Debris =	0.50		ft <sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Not Selected	Not Selected	
Depth to Invert of Outlet Pipe =			ft (distance below basin bottom at Stage = 0 ft)
Circular Orifice Diameter =			inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate			
	Not Selected	Not Selected	
1st Stage = 0 ft)	Outlet Orifice Area =		ft <sup>2</sup>
	Outlet Orifice Centroid =		feet
	Half-Central Angle of Restrictor Plate on Pipe =	N/A	N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	3.00	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	18.00	feet
Spillway End Slopes =	3.00	H:V
Freeboard above Max Water Surface =	0.00	feet

Calculated Parameters for Spillway		
Spillway Design Flow Depth=	0.84	feet
Stage at Top of Freeboard =	3.84	feet
Basin Area at Top of Freeboard =	0.11	acres
Basin Volume at Top of Freeboard =	0.26	acre-ft




## Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period									
One-Hour Rainfall Depth (in)	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.68
CUHP Runoff Volume (acre-ft)	0.246	0.306	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.148	0.258	0.349	0.994	1.653	2.576	6.681
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.0	0.0	0.0	0.0	0.0	0.0	0.0
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Peak Inflow Q (cfs)	N/A	N/A	2.4	4.6	6.2	18.3	30.4	46.3	107.5
Peak Outflow Q (cfs)	11.3	23.0	0.2	1.3	3.4	18.1	36.9	51.1	64.4
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!
Structure Controlling Flow	Spillway	Plate	Plate	Spillway	Spillway	Spillway	Spillway	Spillway	N/A
Max Velocity through Gate 1 (fps)	-0.59	N/A	N/A	-0.4	-0.5	-0.5	-0.6	-0.6	-0.6
Max Velocity through Gate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	41	40	44	42	40	25	13	8	2
Time to Drain 99% of Inflow Volume (hours)	46	45	47	48	47	40	35	28	10
Maximum Ponding Depth (ft)	3.69	2.65	2.35	3.06	3.13	3.43	3.69	3.86	4.00
Area at Maximum Ponding Depth (acres)	0.11	0.08	0.08	0.09	0.10	0.10	0.11	0.11	0.12
Maximum Volume Stored (acre-ft)	0.247	0.147	0.121	0.182	0.190	0.218	0.247	0.265	0.281

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

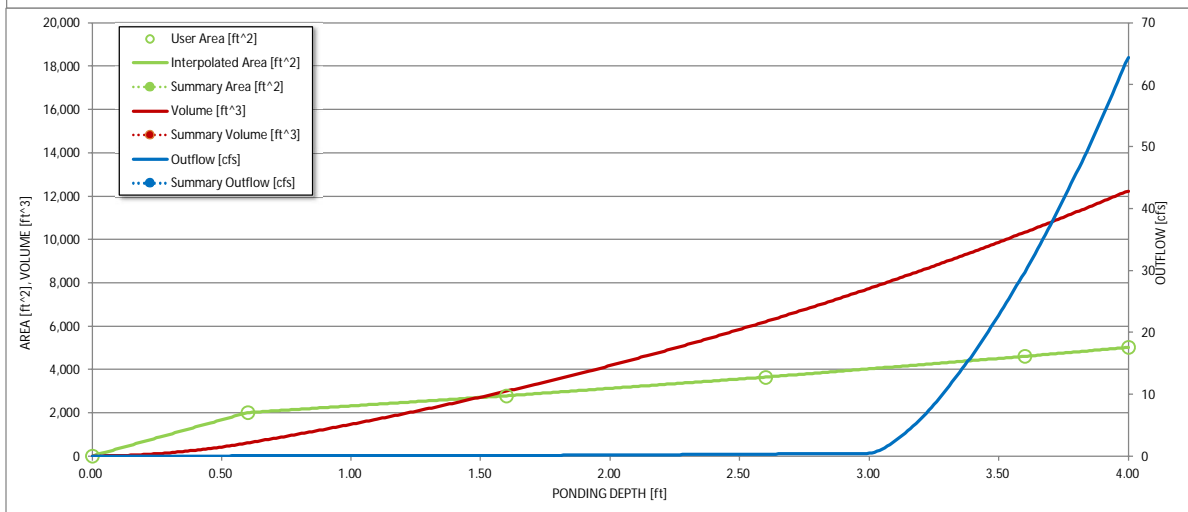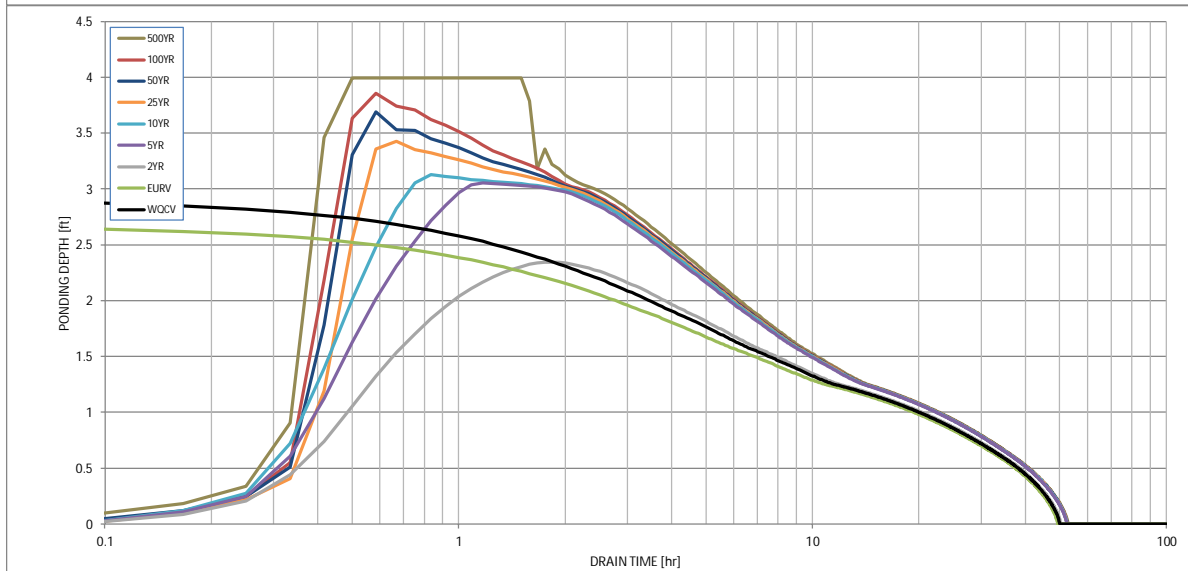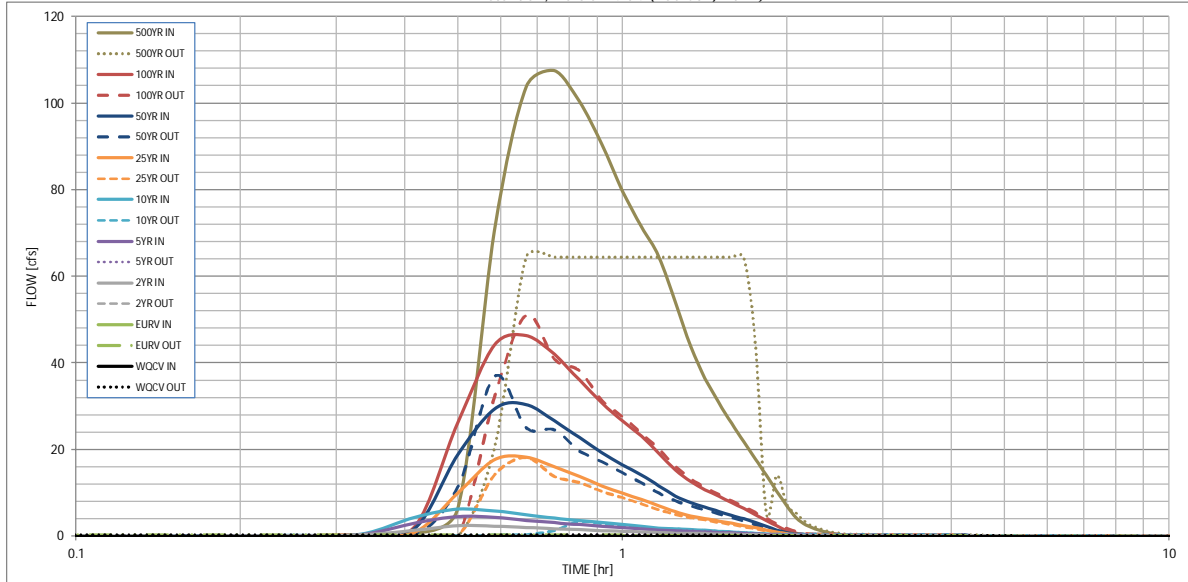

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_


## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.06
	0:15:00	0.00	0.00	0.09	0.14	0.18	0.12	0.15	0.15	0.28
	0:20:00	0.00	0.00	0.33	0.44	0.52	0.33	0.38	0.41	0.65
	0:25:00	0.00	0.00	1.37	3.03	4.40	1.02	1.85	2.37	6.44
	0:30:00	0.00	0.00	2.42	4.57	6.22	10.02	18.86	26.26	70.50
	0:35:00	0.00	0.00	2.37	4.30	5.85	17.66	29.42	44.17	103.83
	0:40:00	0.00	0.00	2.07	3.67	4.98	18.26	30.45	46.28	107.49
	0:45:00	0.00	0.00	1.77	3.11	4.21	16.02	26.64	42.03	100.44
	0:50:00	0.00	0.00	1.53	2.68	3.59	13.82	22.83	36.12	90.56
	0:55:00	0.00	0.00	1.34	2.33	3.12	11.67	19.30	30.80	79.79
	1:00:00	0.00	0.00	1.17	2.01	2.69	9.96	16.52	26.64	71.45
	1:05:00	0.00	0.00	1.01	1.71	2.27	8.52	14.13	23.10	64.52
	1:10:00	0.00	0.00	0.85	1.42	1.88	7.06	11.65	19.11	54.02
	1:15:00	0.00	0.00	0.74	1.24	1.69	5.67	9.31	15.29	43.80
	1:20:00	0.00	0.00	0.67	1.12	1.53	4.71	7.77	12.63	36.51
	1:25:00	0.00	0.00	0.60	1.00	1.36	4.09	6.69	10.79	30.90
	1:30:00	0.00	0.00	0.54	0.88	1.18	3.53	5.76	9.23	26.12
	1:35:00	0.00	0.00	0.48	0.77	1.01	3.00	4.87	7.79	21.86
	1:40:00	0.00	0.00	0.41	0.64	0.84	2.49	4.00	6.39	17.88
	1:45:00	0.00	0.00	0.35	0.51	0.67	1.98	3.15	5.02	14.06
	1:50:00	0.00	0.00	0.29	0.39	0.51	1.48	2.30	3.68	10.42
	1:55:00	0.00	0.00	0.23	0.29	0.38	1.00	1.48	2.39	7.02
	2:00:00	0.00	0.00	0.19	0.25	0.32	0.58	0.80	1.29	4.20
	2:05:00	0.00	0.00	0.16	0.20	0.27	0.34	0.45	0.70	2.66
	2:10:00	0.00	0.00	0.13	0.17	0.22	0.24	0.30	0.44	1.75
	2:15:00	0.00	0.00	0.10	0.13	0.18	0.18	0.22	0.29	1.13
	2:20:00	0.00	0.00	0.08	0.11	0.14	0.14	0.16	0.21	0.72
	2:25:00	0.00	0.00	0.07	0.09	0.11	0.11	0.13	0.14	0.42
	2:30:00	0.00	0.00	0.05	0.07	0.09	0.08	0.09	0.10	0.22
	2:35:00	0.00	0.00	0.04	0.05	0.07	0.06	0.07	0.07	0.11
	2:40:00	0.00	0.00	0.03	0.04	0.05	0.05	0.05	0.05	0.08
	2:45:00	0.00	0.00	0.03	0.03	0.04	0.04	0.04	0.04	0.06
	2:50:00	0.00	0.00	0.02	0.02	0.03	0.03	0.03	0.03	0.05
	2:55:00	0.00	0.00	0.01	0.02	0.02	0.02	0.03	0.02	0.04
	3:00:00	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.03
	3:05:00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.02
	3:10:00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.01
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

MHFD-Detention, Version 4.04 (February 2021)

Basin ID: Sed Basin in South WQ Pond area - Drain Time Analysis



Selected BMP Type =	EDB	
Watershed Area =	11.62	acres
Watershed Length =	2,000	ft
Watershed Length to Centroid =	1,300	ft
Watershed Slope =	0.030	ft/ft
Watershed Imperviousness =	55.70%	percent
Percentage Hydrologic Soil Group A =	100.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths = User Input		

### Optional User Overrides

Water Quality Capture Volume (WQCV) =	0.215	acre-feet
Excess Urban Runoff Volume (EURV) =	0.769	acre-feet
2-yr Runoff Volume ( $P1 = 1.19 \text{ in.}$ ) =	0.576	acre-feet
5-yr Runoff Volume ( $P1 = 1.5 \text{ in.}$ ) =	0.762	acre-feet
10-yr Runoff Volume ( $P1 = 1.75 \text{ in.}$ ) =	0.910	acre-feet
25-yr Runoff Volume ( $P1 = 2 \text{ in.}$ ) =	1.126	acre-feet
50-yr Runoff Volume ( $P1 = 2.25 \text{ in.}$ ) =	1.337	acre-feet
100-yr Runoff Volume ( $P1 = 2.52 \text{ in.}$ ) =	1.601	acre-feet
500-yr Runoff Volume ( $P1 = 3.68 \text{ in.}$ ) =	2.702	acre-feet
Approximate 2-yr Detention Volume =	0.497	acre-feet
Approximate 5-yr Detention Volume =	0.652	acre-feet
Approximate 10-yr Detention Volume =	0.792	acre-feet
Approximate 25-yr Detention Volume =	0.962	acre-feet
Approximate 50-yr Detention Volume =	1.068	acre-feet
Approximate 100-yr Detention Volume =	1.189	acre-feet

Zone 1 Volume (WCV <sub>1</sub> )	=	0.215	acre-feet
Select Zone 2 Storage Volume (Optional)	=		acre-feet
Select Zone 3 Storage Volume (Optional)	=		acre-feet
Total Detention Basin Volume	=	0.215	acre-feet
Initial Surcharge Volume (ISV)	=	user	ft <sup>3</sup>
Initial Surcharge Depth (ISD)	=	user	ft
Total Available Detention Depth (H <sub>total</sub> )	=	user	ft
Depth of Trickle Channel (H <sub>TC</sub> )	=	user	ft
Slope of Trickle Channel (S <sub>TC</sub> )	=	user	ft/ft
Slopes of Main Basin Sides (S <sub>main</sub> )	=	user	H:V
Basin Length-to-Width Ratio (R <sub>L/W</sub> )	=	user	


Total detention volume is less than 100-year volume.

Initial Surcharge Area ( $A_{ISV}$ )	=	user	ft <sup>2</sup>
Surcharge Volume Length ( $L_{ISV}$ )	=	user	ft
Surcharge Volume Width ( $W_{ISV}$ )	=	user	ft
Depth of Basin Floor ( $H_{FLOOR}$ )	=	user	ft
Length of Basin Floor ( $L_{FLOOR}$ )	=	user	ft
Width of Basin Floor ( $W_{FLOOR}$ )	=	user	ft
Area of Basin Floor ( $A_{FLOOR}$ )	=	user	ft <sup>2</sup>
Volume of Basin Floor ( $V_{FLOOR}$ )	=	user	ft <sup>3</sup>
Depth of Main Basin ( $H_{MAIN}$ )	=	user	ft
Length of Main Basin ( $L_{MAIN}$ )	=	user	ft
Width of Main Basin ( $W_{MAIN}$ )	=	user	ft
Area of Main Basin ( $A_{MAIN}$ )	=	user	ft <sup>2</sup>
Volume of Main Basin ( $V_{MAIN}$ )	=	user	ft <sup>3</sup>
Calculated Total Basin Volume ( $V_{TOTAL}$ )	=	USER	acre-feet

[illegible]

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.04 (February 2021)

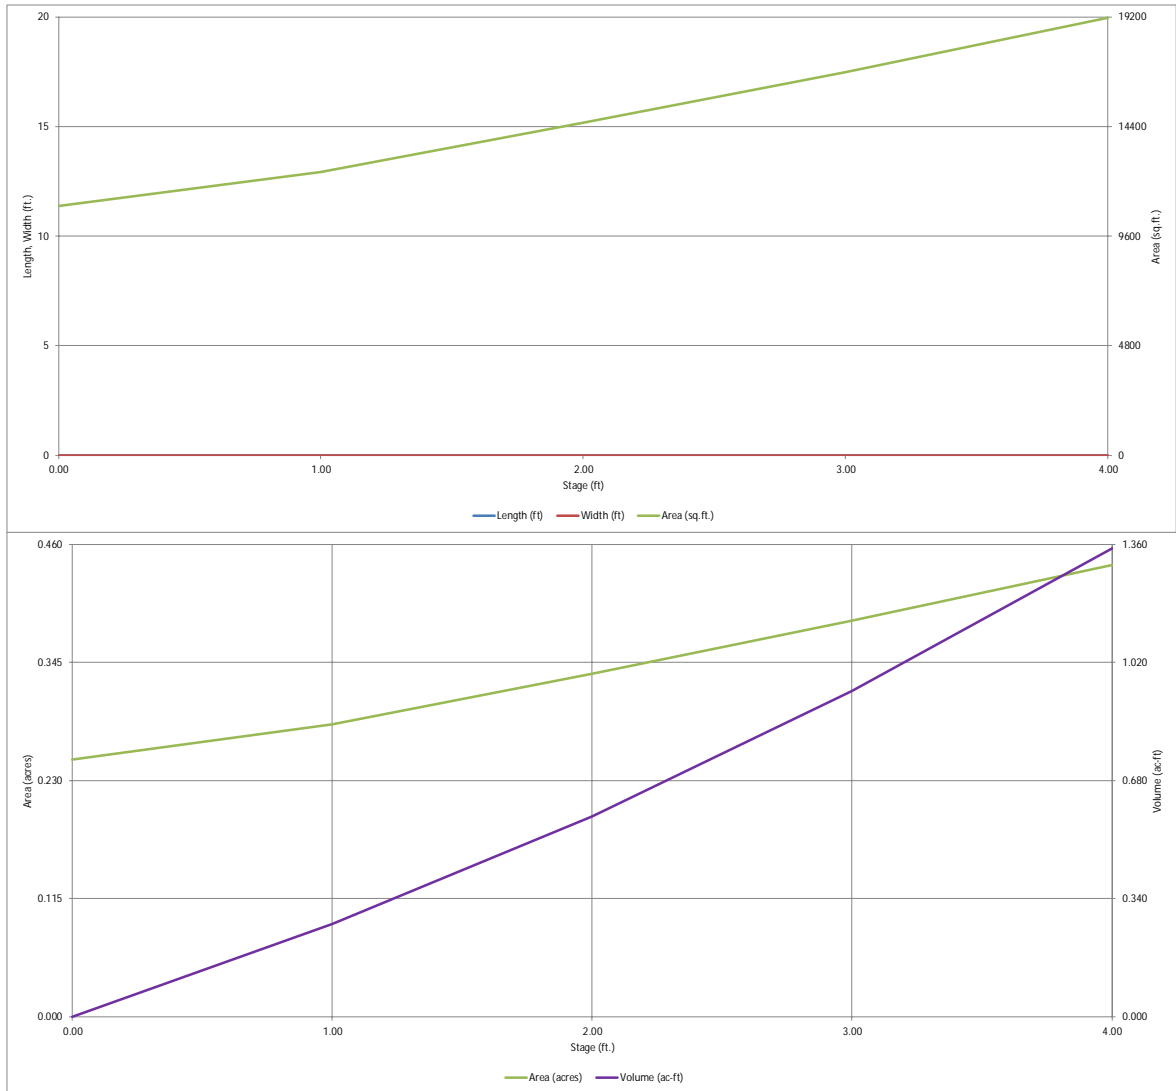


# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-DETENTION, Version 4.04 (February 2021)

Project: Falcon Meadows at Bent Grass

Basin ID: Sed Basin in South WQ Pond area - Drain Time Analysis

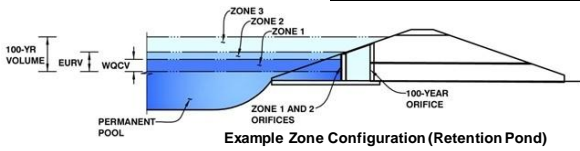

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	0.82	0.215	Orifice Plate
Zone 2			
Zone 3			
Total (all zones)		0.215	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =	N/A	ft (distance below the filtration media surface)
Underdrain Orifice Diameter =	N/A	inches

Calculated Parameters for Underdrain	
Underdrain Orifice Area =	N/A ft <sup>2</sup>
Underdrain Orifice Centroid =	N/A feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =	0.00	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate =	3.00	ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing =	N/A	inches
Orifice Plate: Orifice Area per Row =	N/A	inches

Calculated Parameters for Plate	
WQ Orifice Area per Row =	N/A ft <sup>2</sup>
Elliptical Half-Width =	N/A feet
Elliptical Slot Centroid =	N/A feet
Elliptical Slot Area =	N/A ft <sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.50	1.00	1.25	1.55	1.85	2.15	2.45
Orifice Area (sq. inches)	2.95	2.95	2.95	1.48	1.48	1.48	1.48	1.48

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)	2.75							
Orifice Area (sq. inches)	1.48							

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =			ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =			ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =			inches

Calculated Parameters for Vertical Orifice		
	Not Selected	Not Selected
Vertical Orifice Area =		ft <sup>2</sup>
Vertical Orifice Centroid =		feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

	Not Selected	Not Selected	
Overflow Weir Front Edge Height, Ho =	3.00		ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	1.00		feet
Overflow Weir Grate Slope =	0.00		H:V
Horiz. Length of Weir Sides =	1.00		feet
Overflow Grate Type =	No Grate		
Debris Clogging % =	50%		%

		Calculated Parameters for Overflow Weir		
		Not Selected	Not Selected	
ft)	Height of Grate Upper Edge, $H_1$ =	3.00		feet
	Overflow Weir Slope Length =	1.00		feet
	Grate Open Area / 100-yr Orifice Area =			
	Overflow Grate Open Area w/o Debris =	1.00		ft <sup>2</sup>
	Overflow Grate Open Area w/ Debris =	0.50		ft <sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Not Selected	Not Selected	
Depth to Invert of Outlet Pipe =			ft (distance below basin bottom at Stage = 0 ft)
Circular Orifice Diameter =			inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate			
		Not Selected	Not Selected
at Stage = 0 ft)	Outlet Orifice Area =		ft <sup>2</sup>
	Outlet Orifice Centroid =		feet
	Half-Central Angle of Restrictor Plate on Pipe =	N/A	N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	3.00	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	22.00	feet
Spillway End Slopes =	3.00	H:V
Freeboard above Max Water Surface =	0.00	feet

Calculated Parameters for Spillway		
Spillway Design Flow Depth=	0.67	feet
Stage at Top of Freeboard =	3.67	feet
Basin Area at Top of Freeboard =	0.42	acres
Basin Volume at Top of Freeboard =	1.21	acre-ft

## Routed Hydrograph Results




The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.68
One-Hour Rainfall Depth (in)	N/A	N/A	0.576	0.762	0.910	1.126	1.337	1.601	2.702
CUHP Runoff Volume (acre-ft)	N/A	N/A	0.576	0.762	0.910	1.126	1.337	1.601	2.702
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.0	0.1	0.1	1.1	2.3	3.8	10.2
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.0	0.1	0.1	1.1	2.3	3.8	10.2
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.00	0.01	0.01	0.10	0.20	0.33	0.88
Peak Inflow Q (cfs)	N/A	N/A	5.4	7.1	8.4	11.7	14.2	17.2	29.2
Peak Outflow Q (cfs)	0.1	0.6	0.4	0.5	0.6	2.2	4.9	8.4	23.0
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	6.1	5.2	1.9	2.2	2.2	2.3
Structure Controlling Flow	Plate	Plate	Plate	Plate	Plate	Spillway	Spillway	Spillway	Spillway
Max Velocity through Grate 1 (fps)	N/A	N/A	N/A	N/A	N/A	-0.8	-0.8	-0.8	-0.9
Max Velocity through Grate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	44	56	55	57	58	58	56	54	46
Time to Drain 99% of Inflow Volume (hours)	48	64	62	65	67	68	67	65	61
Maximum Ponding Depth (ft)	0.82	2.56	1.80	2.29	2.65	3.07	3.15	3.22	3.44
Area at Maximum Ponding Depth (acres)	0.28	0.36	0.32	0.35	0.37	0.39	0.39	0.40	0.41
Maximum Volume Stored (acre-ft)	0.217	0.772	0.511	0.673	0.802	0.964	0.992	1.019	1.112



# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

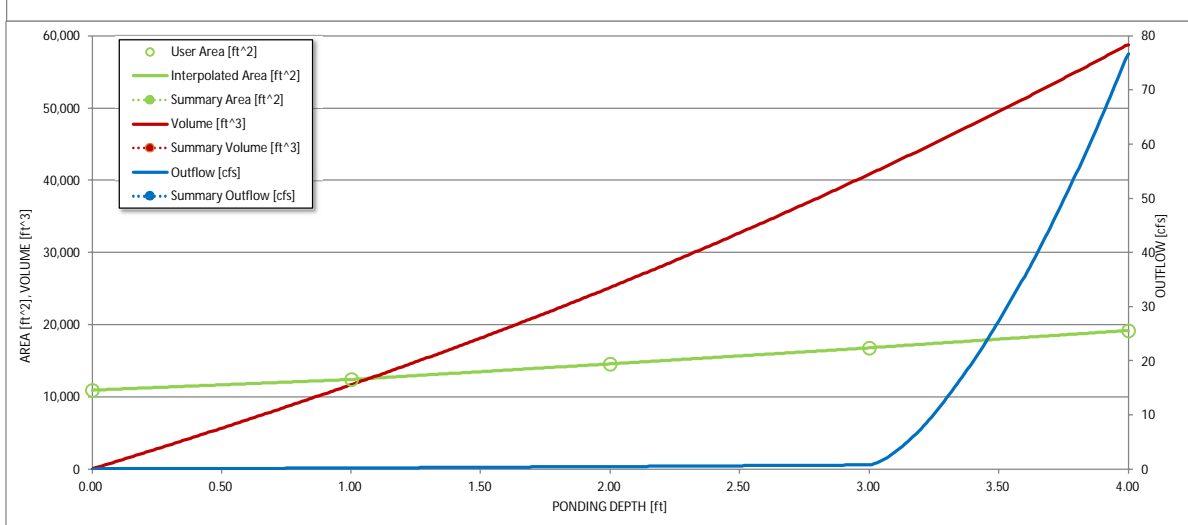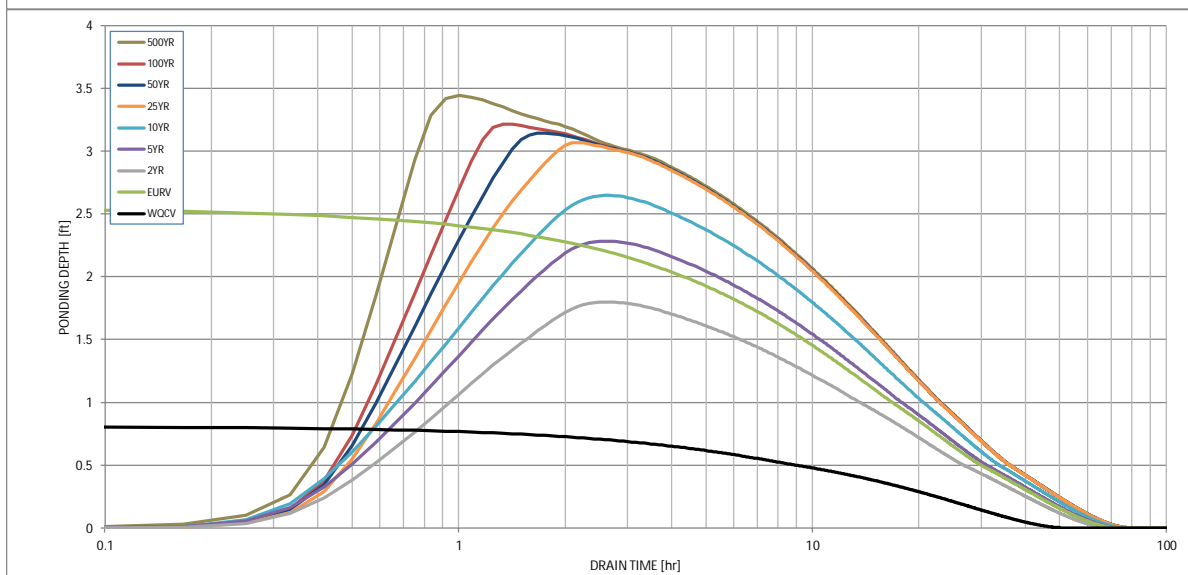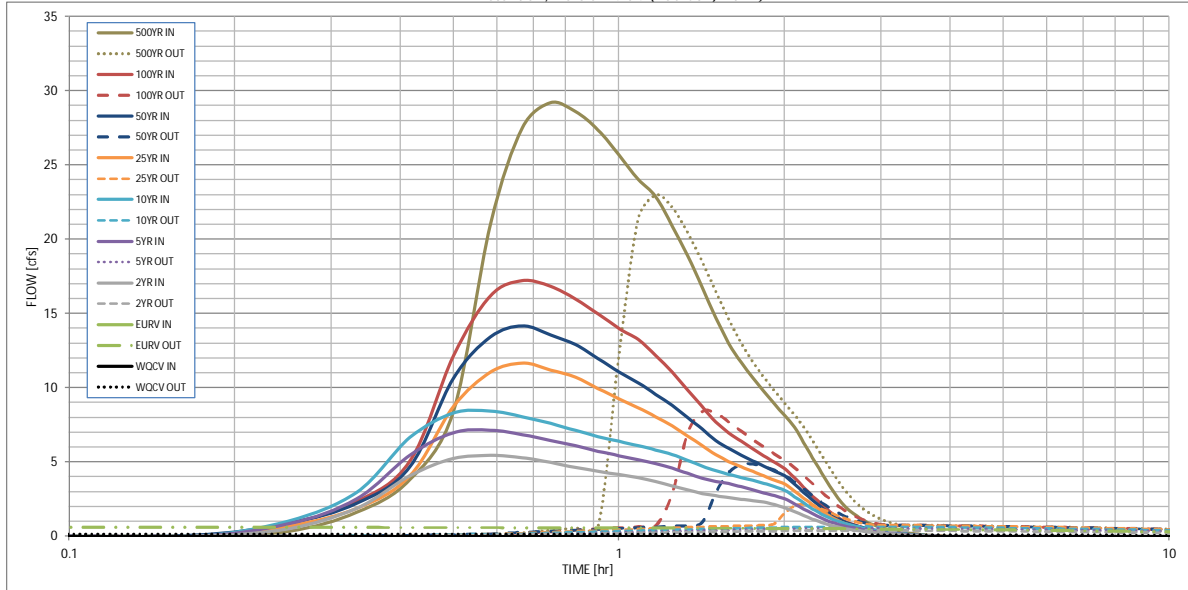

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.06	0.01	0.35
	0:15:00	0.00	0.00	0.51	0.83	1.03	0.70	0.88	0.85	1.61
	0:20:00	0.00	0.00	1.90	2.52	2.98	1.89	2.23	2.36	3.81
	0:25:00	0.00	0.00	4.07	5.48	6.66	4.07	4.68	5.06	8.38
	0:30:00	0.00	0.00	5.25	6.99	8.31	8.75	10.65	12.15	21.03
	0:35:00	0.00	0.00	5.44	7.15	8.44	11.05	13.42	16.20	27.53
	0:40:00	0.00	0.00	5.31	6.86	8.06	11.67	14.18	17.21	29.20
	0:45:00	0.00	0.00	4.97	6.46	7.61	11.21	13.57	16.83	28.62
	0:50:00	0.00	0.00	4.65	6.11	7.14	10.71	12.93	15.99	27.37
	0:55:00	0.00	0.00	4.37	5.74	6.72	9.96	11.97	14.97	25.66
	1:00:00	0.00	0.00	4.15	5.44	6.40	9.25	11.06	14.00	24.05
	1:05:00	0.00	0.00	3.96	5.17	6.11	8.67	10.34	13.26	22.88
	1:10:00	0.00	0.00	3.68	4.91	5.82	8.05	9.57	12.17	20.91
	1:15:00	0.00	0.00	3.40	4.58	5.51	7.44	8.82	11.06	18.91
	1:20:00	0.00	0.00	3.12	4.23	5.14	6.76	7.99	9.85	16.75
	1:25:00	0.00	0.00	2.89	3.93	4.72	6.12	7.21	8.72	14.75
	1:30:00	0.00	0.00	2.73	3.72	4.42	5.50	6.46	7.72	13.00
	1:35:00	0.00	0.00	2.61	3.56	4.18	5.05	5.92	6.99	11.72
	1:40:00	0.00	0.00	2.50	3.34	3.97	4.68	5.48	6.41	10.68
	1:45:00	0.00	0.00	2.40	3.13	3.76	4.36	5.09	5.90	9.76
	1:50:00	0.00	0.00	2.31	2.93	3.57	4.07	4.74	5.43	8.92
	1:55:00	0.00	0.00	2.12	2.74	3.36	3.79	4.40	4.99	8.13
	2:00:00	0.00	0.00	1.94	2.53	3.10	3.52	4.07	4.56	7.37
	2:05:00	0.00	0.00	1.67	2.19	2.68	3.05	3.52	3.93	6.32
	2:10:00	0.00	0.00	1.41	1.85	2.26	2.58	2.97	3.31	5.30
	2:15:00	0.00	0.00	1.17	1.53	1.86	2.13	2.44	2.71	4.31
	2:20:00	0.00	0.00	0.95	1.24	1.51	1.72	1.96	2.16	3.41
	2:25:00	0.00	0.00	0.76	1.00	1.23	1.35	1.53	1.67	2.59
	2:30:00	0.00	0.00	0.63	0.82	1.02	1.05	1.19	1.27	1.96
	2:35:00	0.00	0.00	0.52	0.69	0.86	0.85	0.95	0.99	1.53
	2:40:00	0.00	0.00	0.44	0.58	0.72	0.69	0.77	0.79	1.21
	2:45:00	0.00	0.00	0.36	0.48	0.60	0.56	0.63	0.63	0.95
	2:50:00	0.00	0.00	0.30	0.40	0.50	0.46	0.51	0.50	0.74
	2:55:00	0.00	0.00	0.25	0.33	0.41	0.37	0.42	0.40	0.58
	3:00:00	0.00	0.00	0.21	0.27	0.33	0.30	0.34	0.32	0.46
	3:05:00	0.00	0.00	0.17	0.22	0.27	0.25	0.28	0.26	0.37
	3:10:00	0.00	0.00	0.14	0.18	0.22	0.20	0.22	0.21	0.30
	3:15:00	0.00	0.00	0.11	0.14	0.18	0.16	0.18	0.17	0.24
	3:20:00	0.00	0.00	0.09	0.11	0.14	0.13	0.14	0.13	0.19
	3:25:00	0.00	0.00	0.07	0.08	0.11	0.10	0.11	0.10	0.15
	3:30:00	0.00	0.00	0.05	0.06	0.08	0.07	0.08	0.08	0.11
	3:35:00	0.00	0.00	0.03	0.04	0.05	0.05	0.06	0.05	0.07
	3:40:00	0.00	0.00	0.02	0.03	0.04	0.03	0.04	0.03	0.05
	3:45:00	0.00	0.00	0.01	0.02	0.02	0.02	0.02	0.02	0.03
	3:50:00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

# Detention Pond Tributary Areas

**Subdivision:** Falcon Meadows at Bent Grass  
**Location:** CO, Colorado Springs

**Project Name:** Falcon Meadows at Bent Grass

**Project No.:** CLH000017

**Calculated By:** TJE

**Checked By:** CMD

**Date:** 6/19/20

## Pond (North)

Basin	Area	% Imp
C-1	9.07	65
C-2	1.11	58
C-3	1.52	86.6
C-5	0.51	2
C-6	1.37	51.2
<b>Total</b>	<b>13.58</b>	<b>63.1</b>


## Pond (South)

Basin	Area	% Imp
D-1	8.13	49.7
D-2	6.72	69.9
D-3	2.93	31.7
D-4	4.38	65.4
D-5	1.08	65.7
D-6	4.01	71.5
D-7	6.39	9.8
D-8	1.69	22.8
E-4	0.91	80.6
E-5	0.89	89
OS-2	20.07	8
OS-3	10.61	8
<b>Total</b>	<b>67.81</b>	<b>31.1</b>

## Existing Pond (North) - Bent Grass Residential Filing No. 1


Basin	Area	% Imp
E-1	1.71	62.3
E-2	0.68	82.8
E-3	0.78	88.7
OS-4	4.46	49.5
OS-5	0.46	65
OS-6	1.17	65
A-1	2.16	68.1
A-3	0.92	70.2
A-4	0.82	2
Basins from BG Filing No. 2 (A-1 thru A-4)	7.70	46
<b>Total</b>	<b>20.86</b>	<b>54.0</b>

MHFD-Detention, Version 4.03 (May 2020)

Basin ID: Ex WQCV Pond - North

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

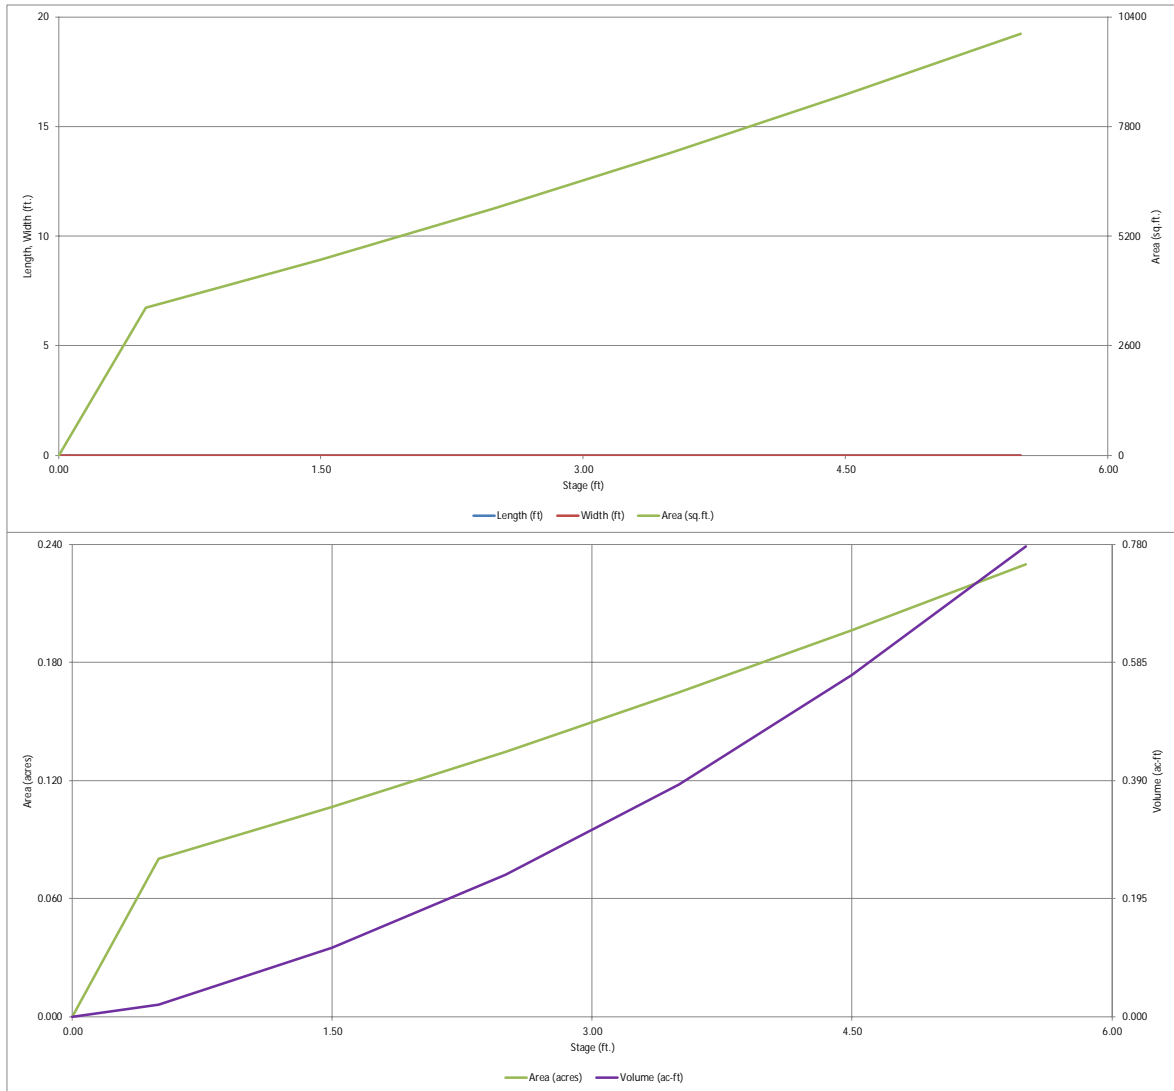


# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

Project: Bent Grass Residential Filing No. 2

Basin ID: Ex WQCV Pond - North

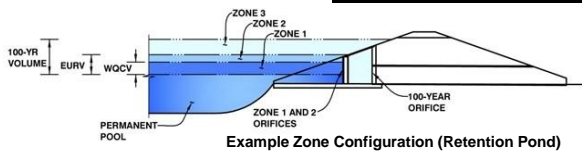

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	3.47	0.378	Orifice Plate
Zone 2			
Zone 3			
Total (all zones)		0.378	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain  
Underdrain Orifice Area =  ft<sup>2</sup>  
Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =  0.00 ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Orifice Plate =  3.10 ft (relative to basin bottom at Stage = 0 ft)  
Orifice Plate: Orifice Vertical Spacing =  12.00 inches  
Orifice Plate: Orifice Area per Row =  1.66 sq. inches (diameter = 1-7/16 inches)

Calculated Parameters for Plate  
WQ Orifice Area per Row =  1.153E-02 ft<sup>2</sup>  
Elliptical Half-Width =  N/A feet  
Elliptical Slot Centroid =  N/A feet  
Elliptical Slot Area =  N/A ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.00	2.00	3.00				
Orifice Area (sq. inches)	1.66	1.66	1.66					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice =  Not Selected  Not Selected ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Vertical Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
Vertical Orifice Diameter =  inches

Calculated Parameters for Vertical Orifice  
Vertical Orifice Area =  Not Selected  Not Selected ft<sup>2</sup>  
Vertical Orifice Centroid =  Not Selected  Not Selected feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe)

Overflow Weir Front Edge Height, H<sub>o</sub> =  Not Selected  Not Selected ft (relative to basin bottom at Stage = 0 ft)  
Overflow Weir Front Edge Length =  feet  
Overflow Weir Grate Slope =  H:V  
Horiz. Length of Weir Sides =  feet  
Overflow Grate Open Area % =  %  
Debris Clogging % =  %

Calculated Parameters for Overflow Weir  
Height of Grate Upper Edge, H<sub>i</sub> =  Not Selected  Not Selected feet  
Overflow Weir Slope Length =  feet  
Grate Open Area / 100-yr Orifice Area =   
Overflow Grate Open Area w/o Debris =  ft<sup>2</sup>  
Overflow Grate Open Area w/ Debris =  ft<sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe =  Not Selected  Not Selected ft (distance below basin bottom at Stage = 0 ft)  
Circular Orifice Diameter =  inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate  
Outlet Orifice Area =  Not Selected  Not Selected ft<sup>2</sup>  
Outlet Orifice Centroid =  Not Selected  Not Selected feet  
Half-Central Angle of Restrictor Plate on Pipe =  N/A  N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =  3.25 ft (relative to basin bottom at Stage = 0 ft)  
Spillway Crest Length =  40.00 feet  
Spillway End Slopes =  4.00 H:V  
Freeboard above Max Water Surface =  1.00 feet

Calculated Parameters for Spillway  
Spillway Design Flow Depth =  0.45 feet  
Stage at Top of Freeboard =  4.70 feet  
Basin Area at Top of Freeboard =  0.20 acres  
Basin Volume at Top of Freeboard =  0.60 acre-ft




## Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period									
One-Hour Rainfall Depth (in)	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.68
CUHP Runoff Volume (acre-ft)	0.378	1.327	0.000	0.000	0.000	0.000	0.000	0.000	0.000
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.993	1.315	1.572	1.954	2.328	2.799	4.756
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.0	0.0	0.0	0.0	0.0	0.0	0.0
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Peak Inflow Q (cfs)	N/A	N/A	12.1	16.2	19.2	25.7	31.3	38.2	65.4
Peak Outflow Q (cfs)	4.8	214.4	10.3	14.3	21.1	31.4	38.8	45.0	79.7
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!	#DIV/0!
Structure Controlling Flow	Spillway	Plate	Spillway	Spillway	Spillway	Spillway	Spillway	Spillway	Spillway
Max Velocity through Gate 1 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Max Velocity through Gate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	37	>120	34	32	30	27	25	23	16
Time to Drain 99% of Inflow Volume (hours)	40	>120	41	40	39	38	36	35	30
Maximum Ponding Depth (ft)	3.47	0.00	3.44	3.49	3.56	3.65	3.71	3.75	3.98
Area at Maximum Ponding Depth (acres)	0.16	0.00	0.16	0.16	0.17	0.17	0.17	0.17	0.18
Maximum Volume Stored (acre-ft)	0.379	0.000	0.372	0.380	0.392	0.407	0.417	0.426	0.466

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

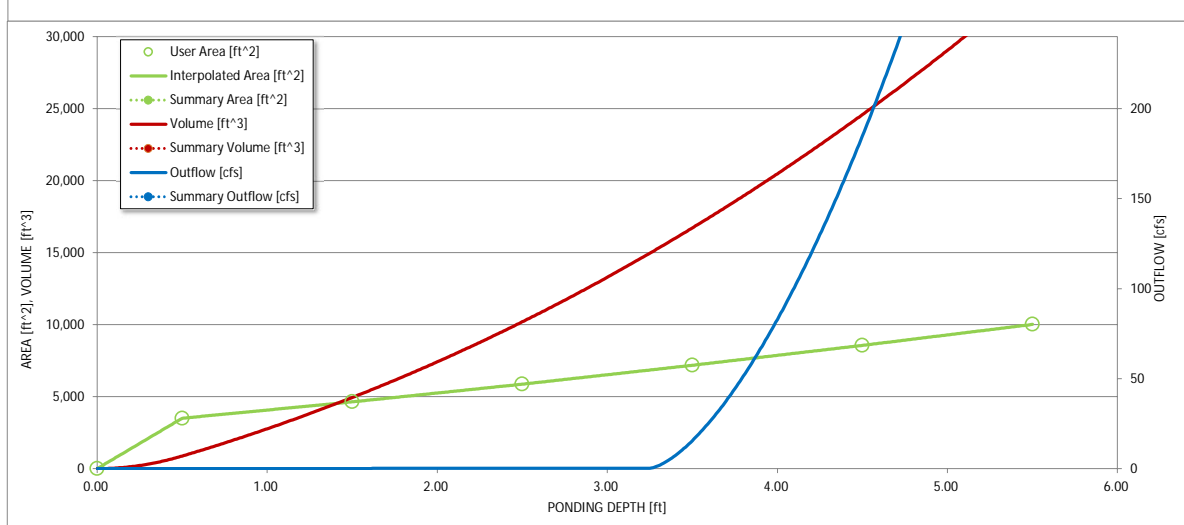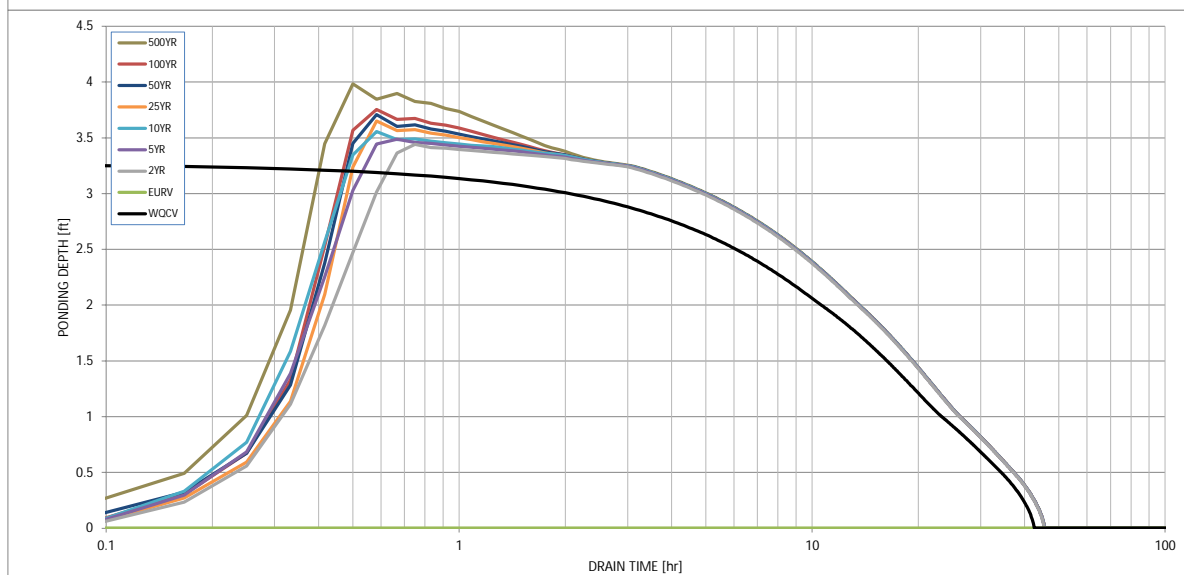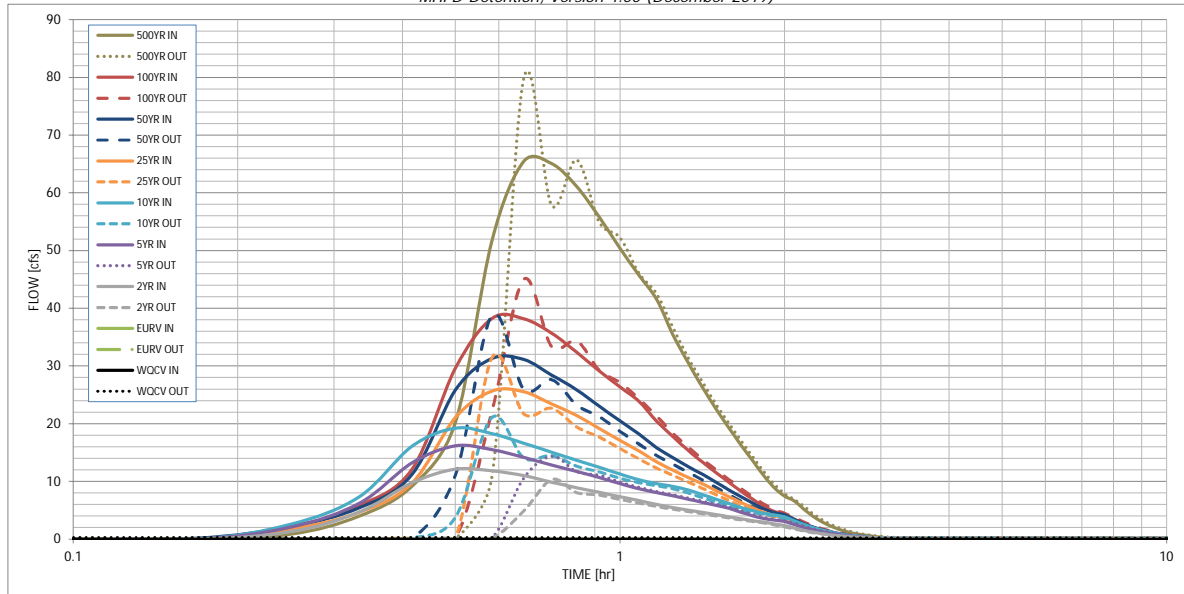

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.15	0.01	0.87
	0:15:00	0.00	0.00	1.28	2.08	2.58	1.74	2.19	2.13	3.98
	0:20:00	0.00	0.00	4.68	6.18	7.30	4.63	5.42	5.79	9.20
	0:25:00	0.00	0.00	9.77	13.20	16.08	9.72	11.20	12.14	20.16
	0:30:00	0.00	0.00	12.12	16.17	19.24	21.06	25.80	29.60	51.77
	0:35:00	0.00	0.00	11.83	15.50	18.25	25.66	31.32	38.24	65.42
	0:40:00	0.00	0.00	10.99	14.16	16.62	25.52	31.12	38.17	65.04
	0:45:00	0.00	0.00	9.86	12.81	15.07	23.40	28.44	35.69	61.13
	0:50:00	0.00	0.00	8.91	11.74	13.69	21.42	25.89	32.38	55.81
	0:55:00	0.00	0.00	8.10	10.65	12.44	19.16	23.04	29.12	50.39
	1:00:00	0.00	0.00	7.33	9.61	11.28	17.10	20.47	26.35	45.73
	1:05:00	0.00	0.00	6.68	8.71	10.27	15.28	18.21	23.86	41.57
	1:10:00	0.00	0.00	6.00	8.07	9.60	13.38	15.84	20.46	35.39
	1:15:00	0.00	0.00	5.47	7.50	9.14	11.95	14.10	17.75	30.55
	1:20:00	0.00	0.00	5.03	6.92	8.51	10.68	12.55	15.37	26.26
	1:25:00	0.00	0.00	4.63	6.37	7.70	9.57	11.21	13.31	22.52
	1:30:00	0.00	0.00	4.25	5.85	6.92	8.42	9.83	11.51	19.28
	1:35:00	0.00	0.00	3.87	5.34	6.18	7.34	8.53	9.84	16.29
	1:40:00	0.00	0.00	3.50	4.66	5.49	6.34	7.32	8.29	13.53
	1:45:00	0.00	0.00	3.18	4.04	4.90	5.42	6.22	6.88	11.02
	1:50:00	0.00	0.00	2.95	3.58	4.48	4.64	5.26	5.67	8.89
	1:55:00	0.00	0.00	2.62	3.30	4.19	4.07	4.60	4.80	7.46
	2:00:00	0.00	0.00	2.35	3.07	3.87	3.75	4.22	4.31	6.62
	2:05:00	0.00	0.00	1.93	2.52	3.18	3.05	3.43	3.44	5.23
	2:10:00	0.00	0.00	1.54	2.02	2.55	2.41	2.71	2.68	4.02
	2:15:00	0.00	0.00	1.24	1.61	2.04	1.91	2.14	2.08	3.09
	2:20:00	0.00	0.00	0.98	1.28	1.62	1.50	1.68	1.60	2.35
	2:25:00	0.00	0.00	0.77	1.02	1.28	1.18	1.32	1.24	1.79
	2:30:00	0.00	0.00	0.61	0.79	0.99	0.92	1.02	0.95	1.37
	2:35:00	0.00	0.00	0.48	0.61	0.76	0.70	0.78	0.73	1.05
	2:40:00	0.00	0.00	0.37	0.46	0.58	0.54	0.60	0.56	0.81
	2:45:00	0.00	0.00	0.28	0.35	0.45	0.42	0.46	0.44	0.63
	2:50:00	0.00	0.00	0.21	0.27	0.34	0.32	0.35	0.34	0.48
	2:55:00	0.00	0.00	0.15	0.19	0.25	0.23	0.26	0.25	0.35
	3:00:00	0.00	0.00	0.10	0.13	0.17	0.16	0.18	0.17	0.24
	3:05:00	0.00	0.00	0.06	0.08	0.11	0.10	0.12	0.11	0.15
	3:10:00	0.00	0.00	0.03	0.05	0.06	0.06	0.06	0.06	0.08
	3:15:00	0.00	0.00	0.01	0.02	0.03	0.03	0.03	0.03	0.03
	3:20:00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00



## DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)


### Summary Stage-Area-Volume-Discharge Relationships

The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

[illegible]

MHFD-Detention, Version 4.03 (May 2020)

Basin ID: WQCV Pond - North

Selected BMP Type =	EDB	
Watershed Area =	13.58	acres
Watershed Length =	1.275	ft
Watershed Length to Centroid =	750	ft
Watershed Slope =	0.030	ft/ft
Watershed Imperviousness =	63.10%	percent
Percentage Hydrologic Soil Group A =	100.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths =	User Input	

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.


Water Quality Capture Volume (WQCV) =	0.280	acre-feet
Excess Urban Runoff Volume (EURV) =	1.055	acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =		acre-feet
5-yr Runoff Volume (P1 = 1.5 in.) =		acre-feet
10-yr Runoff Volume (P1 = 1.75 in.) =		acre-feet
25-yr Runoff Volume (P1 = 2 in.) =		acre-feet
50-yr Runoff Volume (P1 = 2.25 in.) =		acre-feet
100-yr Runoff Volume (P1 = 2.52 in.) =		acre-feet
500-yr Runoff Volume (P1 = 3.68 in.) =		acre-feet
Approximate 2-yr Detention Volume =		acre-feet
Approximate 5-yr Detention Volume =		acre-feet
Approximate 10-yr Detention Volume =		acre-feet
Approximate 25-yr Detention Volume =		acre-feet
Approximate 50-yr Detention Volume =		acre-feet
Approximate 100-yr Detention Volume =		acre-feet

Select Zone 1 Storage Volume (Required)		acre-feet
Select Zone 2 Storage Volume (Optional)		acre-feet
Select Zone 3 Storage Volume (Optional)		acre-feet
Total Detention Basin Volume		acre-feet
Initial Surcharge Depth (ISV)	user	ft <sup>3</sup>
Initial Surcharge Depth (ISD)		ft
Total Available Detention Depth (H <sub>total</sub> )	user	ft
Depth of Trickle Channel (H <sub>tr</sub> )	user	ft
Slope of Trickle Channel (S <sub>tr</sub> )	user	ft/ft
Slopes of Main Basin Sides (S <sub>main</sub> )	user	H:V
Basin Length-to-Width Ratio (R <sub>LW</sub> )	user	
Initial Surcharge Area (A <sub>ISV</sub> )		ft <sup>2</sup>
Surcharge Volume Length (L <sub>ISV</sub> )	user	ft
Surcharge Volume Width (W <sub>ISV</sub> )	user	ft
Depth of Basin Floor (H <sub>f1,000</sub> )	user	ft
Length of Basin Floor (L <sub>f1,000</sub> )	user	ft
Width of Basin Floor (W <sub>f1,000</sub> )	user	ft
Area of Basin Floor (A <sub>f1,000</sub> )	user	ft <sup>2</sup>
Volume of Basin Floor (V <sub>f1,000</sub> )	user	ft <sup>3</sup>
Depth of Main Basin (H <sub>main</sub> )	user	ft
Length of Main Basin (L <sub>main</sub> )	user	ft
Width of Main Basin (W <sub>main</sub> )	user	ft
Area of Main Basin (A <sub>main</sub> )	user	ft <sup>2</sup>
Volume of Main Basin (V <sub>main</sub> )	user	ft <sup>3</sup>
Calculated Total Basin Volume (V <sub>total</sub> )	user	acre-feet

[illegible]

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER


MHFD-Detention, Version 4.03 (May 2020)

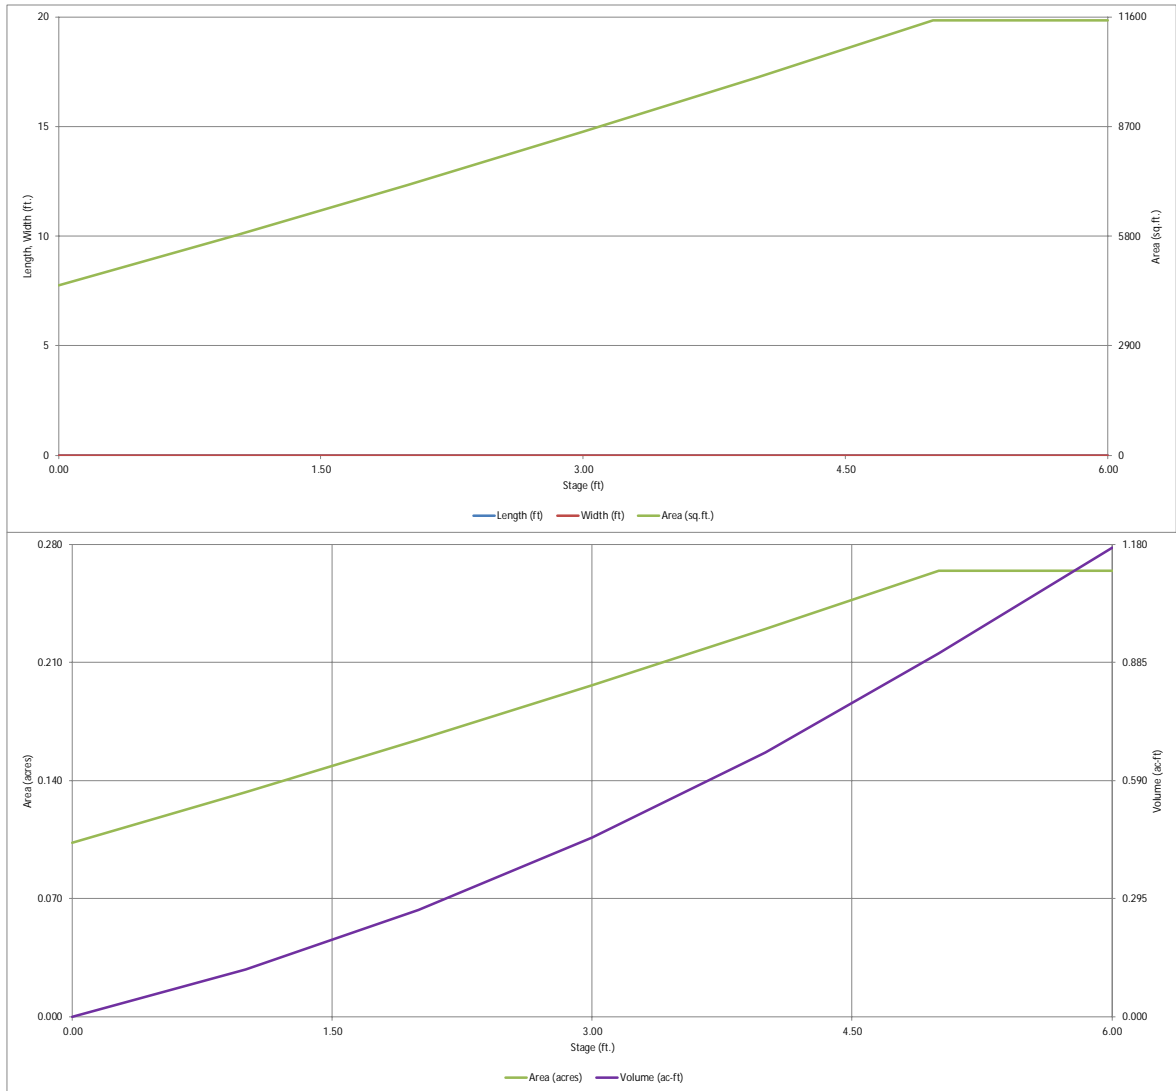

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

Project: Falcon Meadows at Bent Grass  
Basin ID: WQCV Pond - North

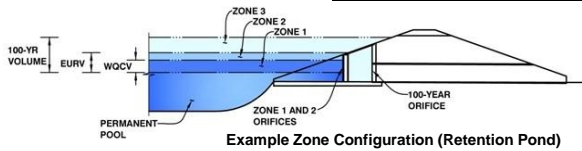

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.14	0.289	Orifice Plate
Zone 2			
Zone 3			
Total (all zones)		0.289	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain  
Underdrain Orifice Area =  ft<sup>2</sup>  
Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =  0.00 ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Orifice Plate =  1.94 ft (relative to basin bottom at Stage = 0 ft)  
Orifice Plate: Orifice Vertical Spacing =  9.00 inches  
Orifice Plate: Orifice Area per Row =  1.92 sq. inches (diameter = 1-9/16 inches)

Calculated Parameters for Plate  
WQ Orifice Area per Row =  1.332E-02 ft<sup>2</sup>  
Elliptical Half-Width =  N/A feet  
Elliptical Slot Centroid =  N/A feet  
Elliptical Slot Area =  N/A ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.80	1.60					
Orifice Area (sq. inches)	1.92	1.92	1.92					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice =  Not Selected  Not Selected ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Vertical Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
Vertical Orifice Diameter =  inches

Calculated Parameters for Vertical Orifice  
Vertical Orifice Area =  Not Selected  Not Selected ft<sup>2</sup>  
Vertical Orifice Centroid =  feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe)

Overflow Weir Front Edge Height, H<sub>o</sub> =  4.50 ft (relative to basin bottom at Stage = 0 ft)  
Overflow Weir Front Edge Length =  6.00 feet  
Overflow Weir Grate Slope =  0.00 H:V  
Horiz. Length of Weir Sides =  3.00 feet  
Overflow Grate Open Area % =  70% %, grate open area/total area  
Debris Clogging % =  50% %

Calculated Parameters for Overflow Weir  
Height of Grate Upper Edge, H<sub>i</sub> =  4.50 feet  
Overflow Weir Slope Length =  3.00 feet  
Grate Open Area / 100-yr Orifice Area =  7.13  
Overflow Grate Open Area w/o Debris =  12.60 ft<sup>2</sup>  
Overflow Grate Open Area w/ Debris =  6.30 ft<sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe =  2.50 ft (distance below basin bottom at Stage = 0 ft)  
Circular Orifice Diameter =  18.00 inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate  
Outlet Orifice Area =  1.77 ft<sup>2</sup>  
Outlet Orifice Centroid =  0.75 feet  
Half-Central Angle of Restrictor Plate on Pipe =  N/A  N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =  5.75 ft (relative to basin bottom at Stage = 0 ft)  
Spillway Crest Length =  50.00 feet  
Spillway End Slopes =  4.00 H:V  
Freeboard above Max Water Surface =  0.00 feet

Calculated Parameters for Spillway  
Spillway Design Flow Depth =  0.37 feet  
Stage at Top of Freeboard =  6.12 feet  
Basin Area at Top of Freeboard =  0.26 acres  
Basin Volume at Top of Freeboard =  1.17 acre-ft




## Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period									
One-Hour Rainfall Depth (in)	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.68
CUHP Runoff Volume (acre-ft)	0.289	1.093	0.798	1.048	1.248	1.513	1.774	2.092	3.418
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.798	1.048	1.248	1.513	1.774	2.092	3.418
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.1	0.2	0.3	2.3	4.6	7.6	19.6
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.01	0.01	0.02	0.17	0.33	0.54	1.40
Peak Inflow Q (cfs)	N/A	N/A	12.2	16.0	18.7	24.1	28.7	34.7	56.9
Peak Outflow Q (cfs)	0.2	22.8	0.4	3.3	6.0	11.5	16.4	22.4	42.7
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	18.3	24.1	5.0	3.5	3.0	2.2
Structure Controlling Flow	Plate	Outlet Plate 1	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	N/A
Max Velocity through Gate 1 (fps)	N/A	1.81	N/A	0.2	0.5	0.9	1.3	1.7	1.8
Max Velocity through Gate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	45	56	58	57	55	53	51	48	40
Time to Drain 99% of Inflow Volume (hours)	50	65	67	66	65	64	63	61	56
Maximum Ponding Depth (ft)	2.14	5.71	4.34	4.68	4.78	4.93	5.05	5.21	6.00
Area at Maximum Ponding Depth (acres)	0.17	0.26	0.24	0.25	0.26	0.26	0.26	0.26	0.26
Maximum Volume Stored (acre-ft)	0.290	1.095	0.741	0.822	0.848	0.889	0.921	0.960	1.172

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

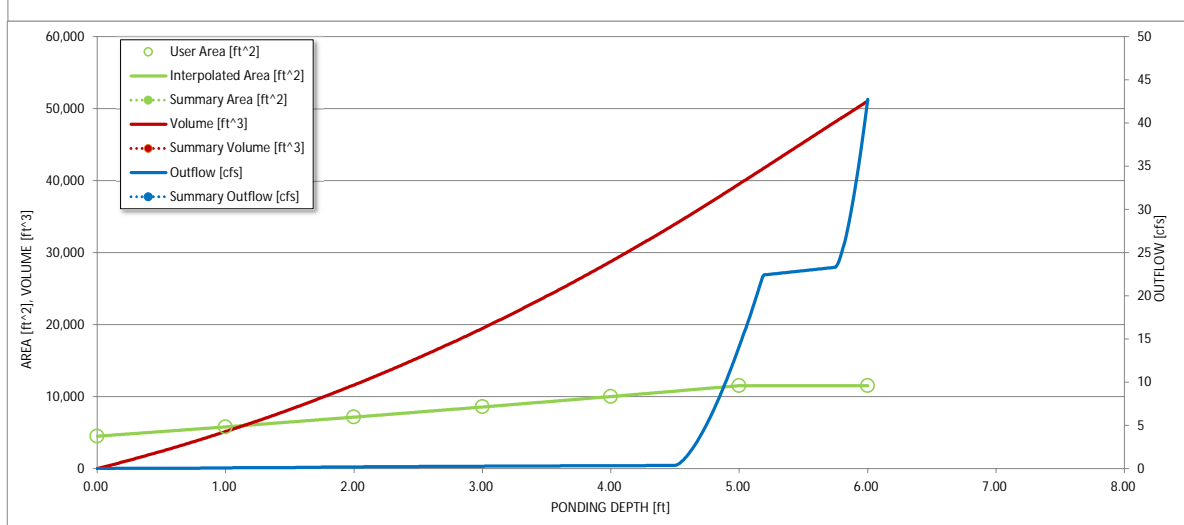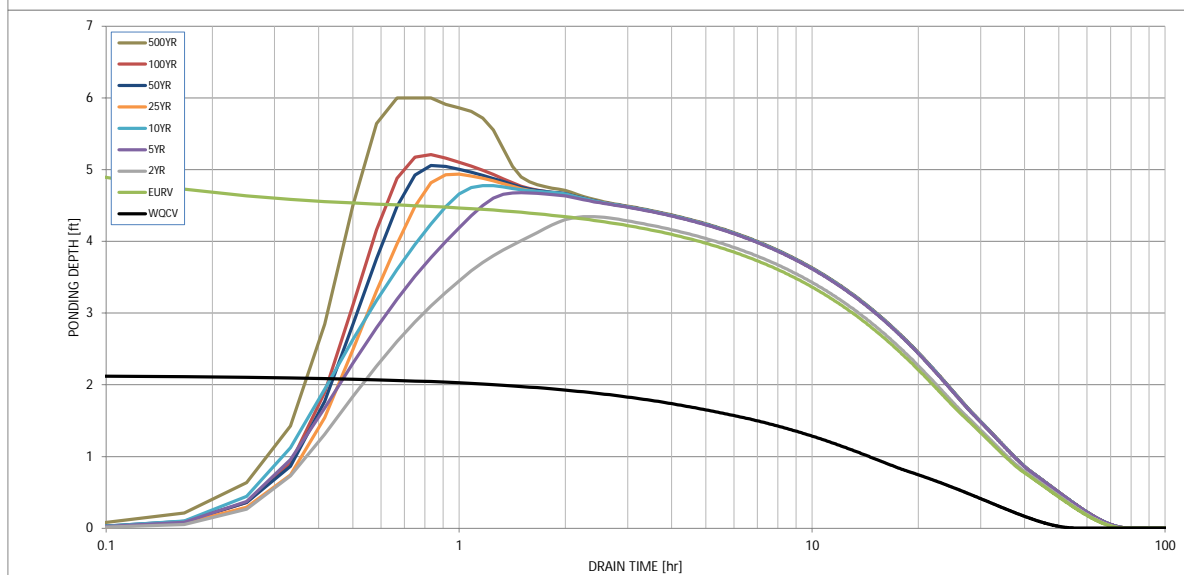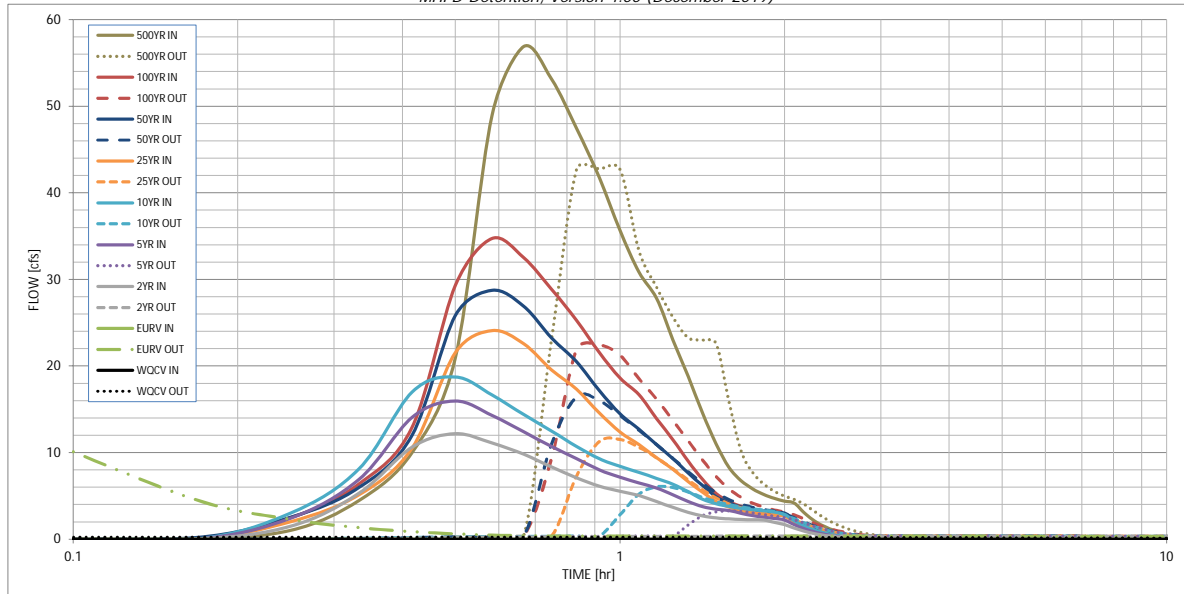

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.17	0.02	1.01
	0:15:00	0.00	0.00	1.50	2.44	3.03	2.03	2.53	2.48	4.48
	0:20:00	0.00	0.00	5.29	6.91	8.12	5.12	5.96	6.40	10.00
	0:25:00	0.00	0.00	10.64	14.07	16.97	10.53	12.01	12.91	20.90
	0:30:00	0.00	0.00	12.18	15.95	18.74	21.53	25.83	29.30	48.97
	0:35:00	0.00	0.00	11.09	14.29	16.64	24.08	28.74	34.73	56.89
	0:40:00	0.00	0.00	9.81	12.39	14.38	22.55	26.89	32.49	53.12
	0:45:00	0.00	0.00	8.34	10.69	12.49	19.55	23.23	28.86	47.44
	0:50:00	0.00	0.00	7.09	9.29	10.70	17.30	20.48	25.25	41.77
	0:55:00	0.00	0.00	6.13	8.01	9.29	14.58	17.16	21.56	35.66
	1:00:00	0.00	0.00	5.51	7.16	8.40	12.38	14.47	18.60	30.85
	1:05:00	0.00	0.00	5.03	6.51	7.70	10.91	12.71	16.68	27.81
	1:10:00	0.00	0.00	4.33	5.89	7.02	9.41	10.91	13.93	23.01
	1:15:00	0.00	0.00	3.67	5.12	6.33	8.07	9.32	11.49	18.79
	1:20:00	0.00	0.00	3.09	4.34	5.47	6.64	7.63	9.00	14.56
	1:25:00	0.00	0.00	2.67	3.77	4.60	5.43	6.19	6.90	11.00
	1:30:00	0.00	0.00	2.45	3.47	4.09	4.34	4.92	5.28	8.31
	1:35:00	0.00	0.00	2.34	3.31	3.78	3.70	4.18	4.34	6.75
	1:40:00	0.00	0.00	2.27	2.98	3.56	3.31	3.73	3.79	5.81
	1:45:00	0.00	0.00	2.23	2.72	3.39	3.05	3.44	3.41	5.15
	1:50:00	0.00	0.00	2.20	2.53	3.28	2.87	3.23	3.16	4.71
	1:55:00	0.00	0.00	1.93	2.39	3.12	2.76	3.10	2.97	4.39
	2:00:00	0.00	0.00	1.70	2.22	2.84	2.67	3.00	2.85	4.17
	2:05:00	0.00	0.00	1.28	1.67	2.14	2.02	2.27	2.13	3.11
	2:10:00	0.00	0.00	0.95	1.23	1.56	1.47	1.66	1.56	2.27
	2:15:00	0.00	0.00	0.69	0.90	1.14	1.08	1.21	1.14	1.66
	2:20:00	0.00	0.00	0.50	0.65	0.82	0.78	0.88	0.84	1.22
	2:25:00	0.00	0.00	0.36	0.45	0.59	0.56	0.62	0.60	0.86
	2:30:00	0.00	0.00	0.25	0.31	0.41	0.39	0.44	0.42	0.61
	2:35:00	0.00	0.00	0.17	0.22	0.29	0.28	0.31	0.30	0.43
	2:40:00	0.00	0.00	0.10	0.14	0.18	0.18	0.20	0.19	0.28
	2:45:00	0.00	0.00	0.05	0.08	0.10	0.11	0.12	0.11	0.16
	2:50:00	0.00	0.00	0.02	0.04	0.05	0.05	0.06	0.05	0.08
	2:55:00	0.00	0.00	0.01	0.01	0.01	0.02	0.02	0.02	0.02
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

## DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)


### Summary Stage-Area-Volume-Discharge Relationships

The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

[illegible]

MHFD-Detention, Version 4.03 (May 2020)


Basin ID: WQCV Pond - South (FUTURE)

## 5/21/2021, 10:23 AM



# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

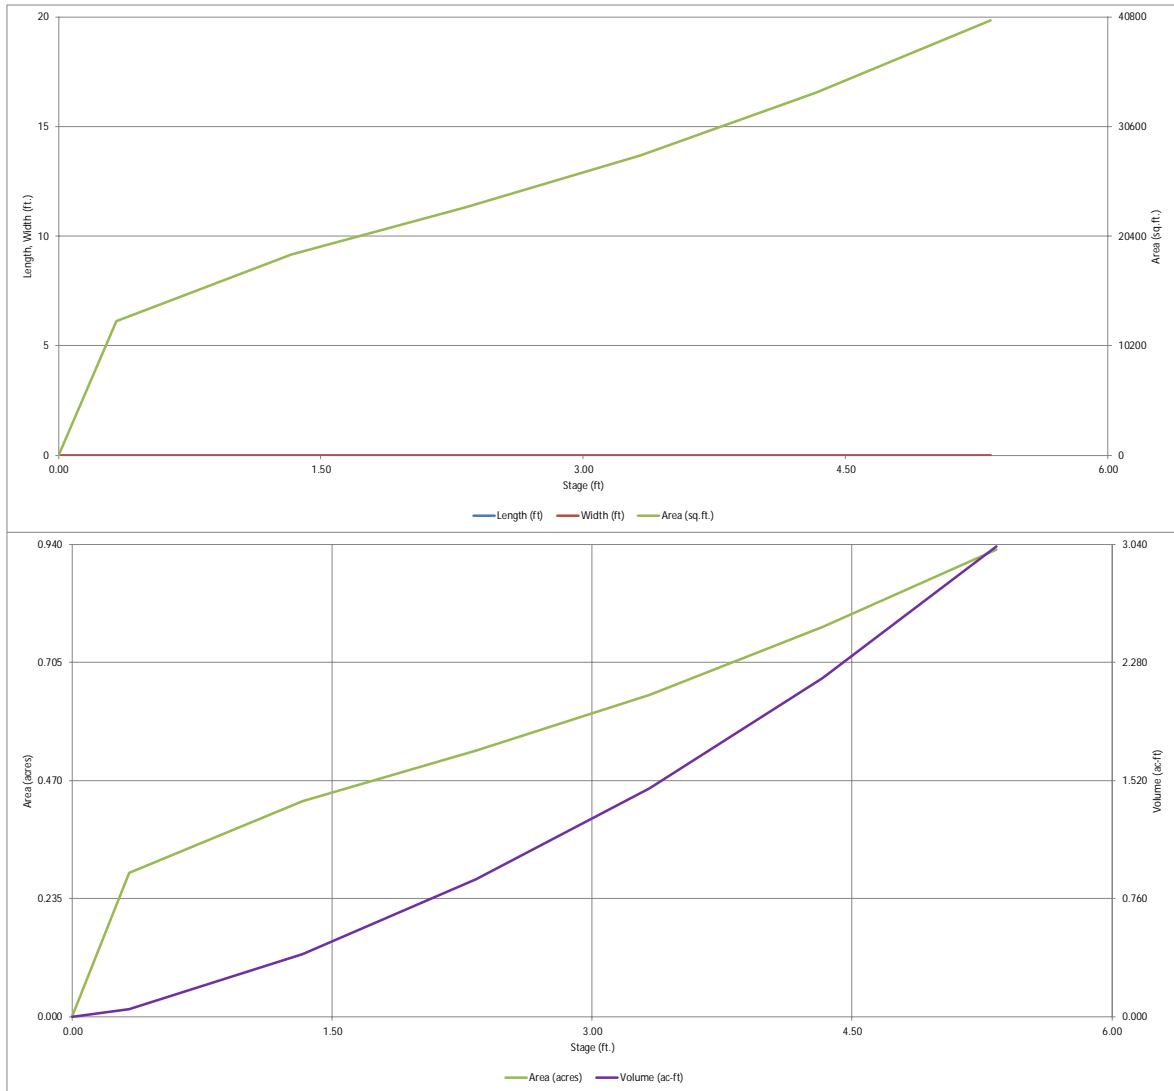


# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

Project: Falcon Meadows at Bent Grass

Basin ID: WQCV Pond - South (FUTURE)

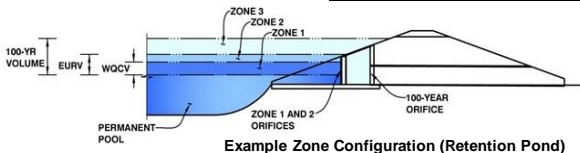

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.32	0.875	Orifice Plate
Zone 2			
Zone 3			
Total (all zones)		0.875	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain

Underdrain Orifice Area =  ft<sup>2</sup>  
Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Calculated Parameters for Plate

Invert of Lowest Orifice =  0.00 ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Orifice Plate =  2.32 ft (relative to basin bottom at Stage = 0 ft)  
Orifice Plate: Orifice Vertical Spacing =  9.00 inches  
Orifice Plate: Orifice Area per Row =  5.00 sq. inches (use rectangular openings)

WO Orifice Area per Row =  3.472E-02 ft<sup>2</sup>  
Elliptical Half-Width =  N/A feet  
Elliptical Slot Centroid =  N/A feet  
Elliptical Slot Area =  N/A ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.80	1.60					
Orifice Area (sq. inches)	5.00	5.00	5.00					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Calculated Parameters for Vertical Orifice

Invert of Vertical Orifice =  Not Selected  Not Selected ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Vertical Orifice =  4.27 ft (relative to basin bottom at Stage = 0 ft)  
Vertical Orifice Diameter or Height =  2.00 inches  
Vertical Orifice Width =  4.00 inches

Vertical Orifice Area =  Not Selected  Not Selected ft<sup>2</sup>  
Vertical Orifice Centroid =  0.06  Not Selected feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

Calculated Parameters for Overflow Weir

Overflow Weir Front Edge Height, H<sub>o</sub> =  Not Selected  Not Selected ft (relative to basin bottom at Stage = 0 ft)  
Overflow Weir Front Edge Length =  7.00 feet  
Overflow Weir Grate Slope =  0.00 H:V  
Horiz. Length of Weir Sides =  7.00 feet  
Overflow Grate Open Area % =  70% % , grate open area/total area  
Debris Clogging % =  50% %

Height of Grate Upper Edge, H<sub>i</sub> =  Not Selected  Not Selected feet  
Overflow Weir Slope Length =  7.00 feet  
Grate Open Area / 100-yr Orifice Area =  6.99  
Overflow Grate Open Area w/o Debris =  34.30 ft<sup>2</sup>  
Overflow Grate Open Area w/ Debris =  17.15 ft<sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

Depth to Invert of Outlet Pipe =  Not Selected  Not Selected ft (distance below basin bottom at Stage = 0 ft)  
Circular Orifice Diameter =  30.00 inches

Outlet Orifice Area =  Not Selected  Not Selected ft<sup>2</sup>  
Outlet Orifice Centroid =  1.25 feet  
Half-Central Angle of Restrictor Plate on Pipe =  N/A  N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Calculated Parameters for Spillway

Spillway Invert Stage =  4.33 ft (relative to basin bottom at Stage = 0 ft)  
Spillway Crest Length =  20.00 feet  
Spillway End Slopes =  4.00 H:V  
Freeboard above Max Water Surface =  0.00 feet

Spillway Design Flow Depth =  1.00 feet  
Stage at Top of Freeboard =  5.33 feet  
Basin Area at Top of Freeboard =  0.93 acres  
Basin Volume at Top of Freeboard =  3.03 acre-ft


## Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.68
One-Hour Rainfall Depth (in) =									
CUHP Runoff Volume (acre-ft) =	0.875	2.129	1.505	2.066	2.534	3.682	4.754	6.187	12.228
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	1.505	2.066	2.534	3.682	4.754	6.187	12.228
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A	0.4	0.8	1.1	10.1	20.3	33.7	87.9
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.01	0.02	0.15	0.30	0.50	1.30
Peak Inflow Q (cfs) =	N/A	N/A	14.2	19.8	24.5	40.0	53.5	70.5	139.1
Peak Outflow Q (cfs) =	0.6	54.2	5.4	10.5	14.9	29.5	42.6	52.5	117.4
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	13.4	13.6	2.9	2.1	1.6	1.3
Structure Controlling Flow =	Plate	Outlet Plate 1	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	1.58	0.13	0.3	0.4	0.8	1.2	1.5	1.7
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	40	39	43	41	40	36	33	29	20
Time to Drain 99% of Inflow Volume (hours) =	43	44	48	47	46	45	43	41	35
Maximum Ponding Depth (ft) =	2.32	4.27	2.68	2.79	2.88	3.11	3.28	3.68	5.22
Area at Maximum Ponding Depth (acres) =	0.53	0.77	0.57	0.58	0.59	0.62	0.63	0.69	0.91
Maximum Volume Stored (acre-ft) =	0.879	2.131	1.071	1.140	1.186	1.325	1.431	1.702	2.920

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

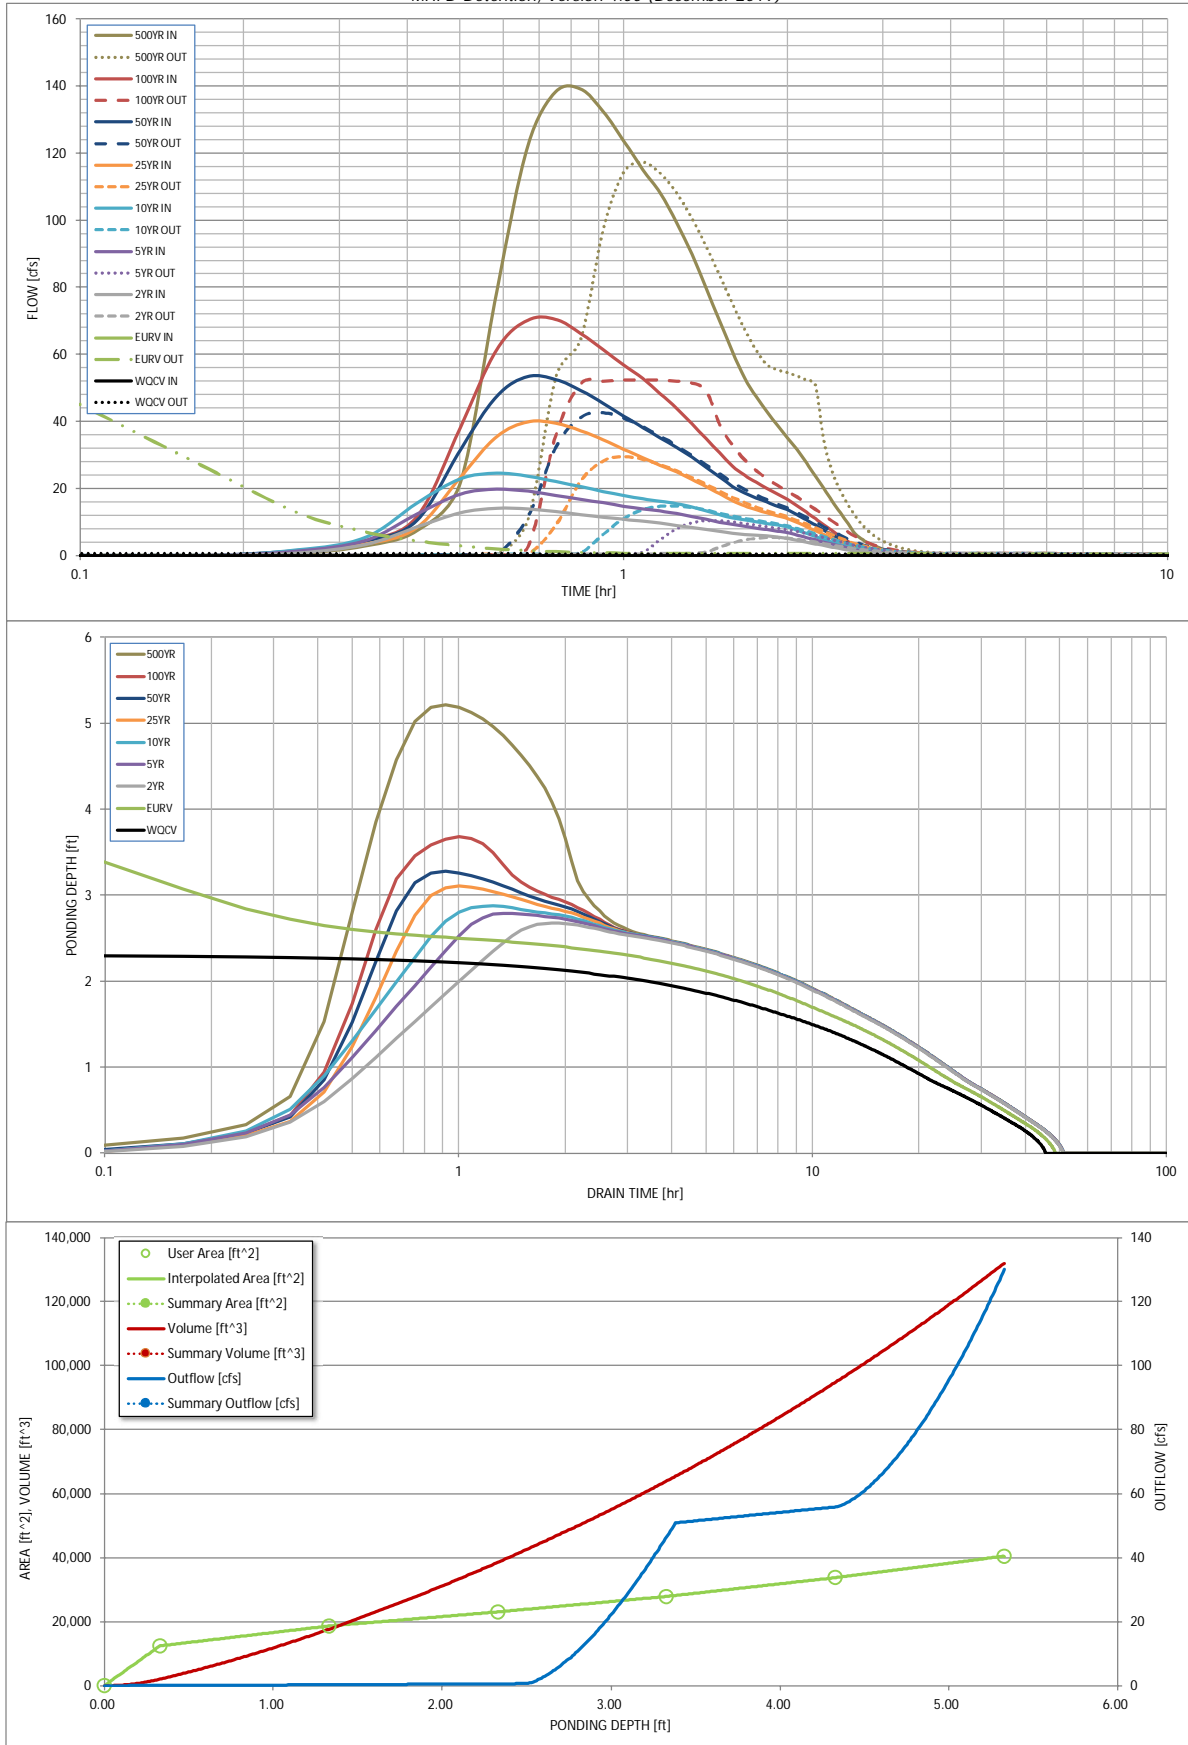

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename:

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
Time Interval	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00_min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.10	0.01	0.59
	0:15:00	0.00	0.00	0.82	1.33	1.68	1.15	1.49	1.43	2.94
	0:20:00	0.00	0.00	3.31	4.46	5.38	3.48	4.16	4.41	7.54
	0:25:00	0.00	0.00	8.52	12.38	15.72	8.33	10.47	11.64	21.68
	0:30:00	0.00	0.00	12.87	18.35	22.89	23.38	31.58	38.24	78.79
	0:35:00	0.00	0.00	14.18	19.80	24.53	35.51	47.58	61.50	122.54
	0:40:00	0.00	0.00	14.01	19.26	23.75	39.96	53.46	70.31	138.42
	0:45:00	0.00	0.00	13.15	17.98	22.07	39.46	52.54	70.46	139.10
	0:50:00	0.00	0.00	12.26	16.84	20.54	37.27	49.25	66.30	132.38
	0:55:00	0.00	0.00	11.49	15.78	19.17	34.51	45.42	61.40	123.70
	1:00:00	0.00	0.00	10.79	14.75	17.89	31.73	41.60	56.82	115.12
	1:05:00	0.00	0.00	10.25	13.95	16.97	29.26	38.26	52.79	108.14
	1:10:00	0.00	0.00	9.67	13.28	16.21	27.00	35.18	48.39	99.33
	1:15:00	0.00	0.00	9.04	12.54	15.48	24.92	32.32	43.94	89.83
	1:20:00	0.00	0.00	8.40	11.69	14.51	22.77	29.35	39.37	79.84
	1:25:00	0.00	0.00	7.77	10.81	13.33	20.60	26.39	34.89	70.03
	1:30:00	0.00	0.00	7.18	9.98	12.17	18.46	23.46	30.66	60.90
	1:35:00	0.00	0.00	6.69	9.30	11.24	16.42	20.71	26.75	53.09
	1:40:00	0.00	0.00	6.36	8.74	10.61	14.85	18.72	23.97	47.45
	1:45:00	0.00	0.00	6.12	8.24	10.08	13.70	17.22	21.88	42.89
	1:50:00	0.00	0.00	5.90	7.77	9.60	12.74	15.95	20.06	38.83
	1:55:00	0.00	0.00	5.55	7.32	9.09	11.86	14.77	18.39	35.11
	2:00:00	0.00	0.00	5.15	6.87	8.50	11.04	13.66	16.80	31.60
	2:05:00	0.00	0.00	4.62	6.19	7.62	9.91	12.20	14.90	27.69
	2:10:00	0.00	0.00	4.06	5.44	6.65	8.67	10.62	12.93	23.76
	2:15:00	0.00	0.00	3.52	4.71	5.72	7.47	9.08	11.03	19.98
	2:20:00	0.00	0.00	3.02	4.03	4.85	6.31	7.61	9.19	16.32
	2:25:00	0.00	0.00	2.55	3.39	4.04	5.22	6.21	7.43	12.82
	2:30:00	0.00	0.00	2.11	2.79	3.29	4.19	4.89	5.74	9.47
	2:35:00	0.00	0.00	1.69	2.23	2.62	3.23	3.66	4.18	6.51
	2:40:00	0.00	0.00	1.34	1.75	2.10	2.38	2.64	2.94	4.74
	2:45:00	0.00	0.00	1.09	1.43	1.75	1.81	2.01	2.17	3.56
	2:50:00	0.00	0.00	0.91	1.21	1.47	1.43	1.59	1.67	2.67
	2:55:00	0.00	0.00	0.77	1.02	1.24	1.16	1.28	1.30	2.01
	3:00:00	0.00	0.00	0.65	0.85	1.04	0.94	1.03	1.01	1.50
	3:05:00	0.00	0.00	0.54	0.71	0.87	0.77	0.84	0.79	1.12
	3:10:00	0.00	0.00	0.46	0.60	0.72	0.63	0.69	0.63	0.85
	3:15:00	0.00	0.00	0.38	0.50	0.60	0.52	0.56	0.50	0.68
	3:20:00	0.00	0.00	0.32	0.41	0.49	0.42	0.45	0.41	0.55
	3:25:00	0.00	0.00	0.26	0.33	0.39	0.34	0.36	0.33	0.44
	3:30:00	0.00	0.00	0.21	0.26	0.31	0.27	0.29	0.26	0.34
	3:35:00	0.00	0.00	0.16	0.21	0.24	0.21	0.22	0.20	0.25
	3:40:00	0.00	0.00	0.12	0.16	0.18	0.16	0.16	0.15	0.18
	3:45:00	0.00	0.00	0.09	0.11	0.13	0.11	0.12	0.10	0.12
	3:50:00	0.00	0.00	0.06	0.08	0.09	0.08	0.08	0.07	0.07
	3:55:00	0.00	0.00	0.04	0.05	0.06	0.05	0.05	0.04	0.04
	4:00:00	0.00	0.00	0.02	0.03	0.03	0.02	0.02	0.02	0.01
	4:05:00	0.00	0.00	0.01	0.02	0.01	0.01	0.01	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.01	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

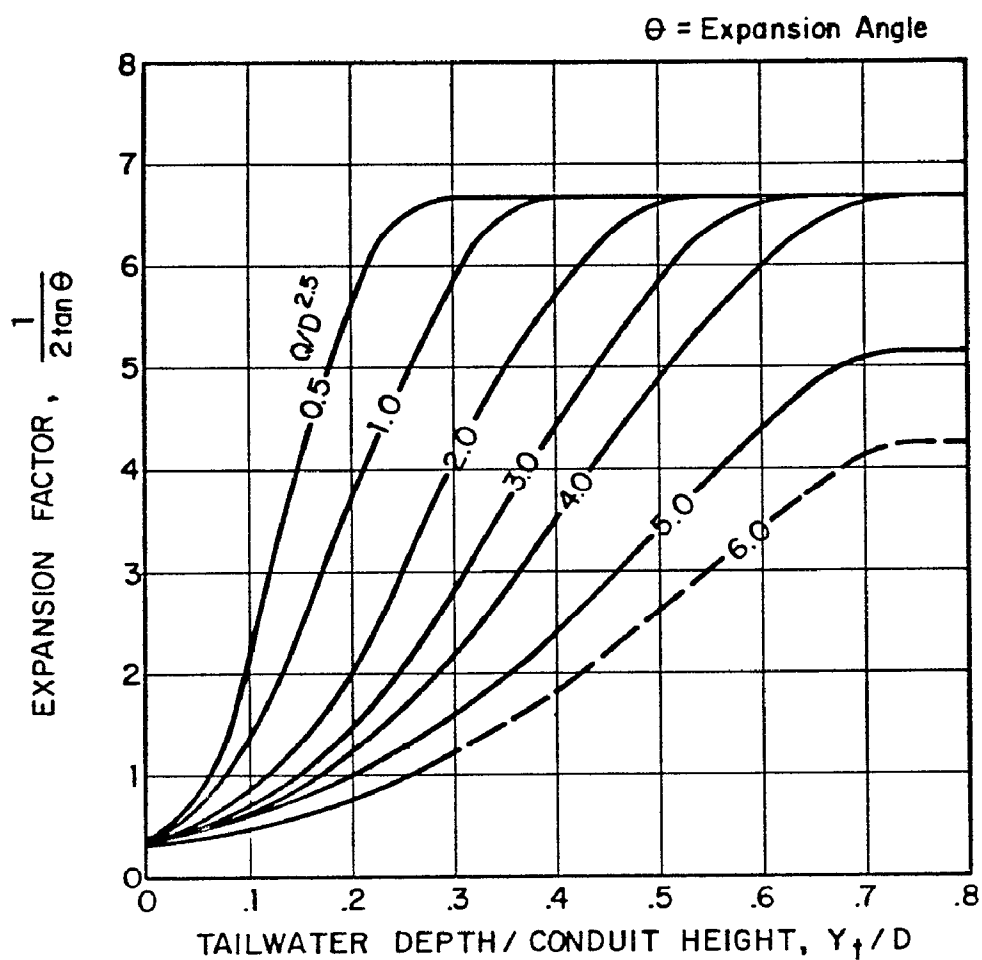


Figure 9-35. Expansion factor for circular conduits


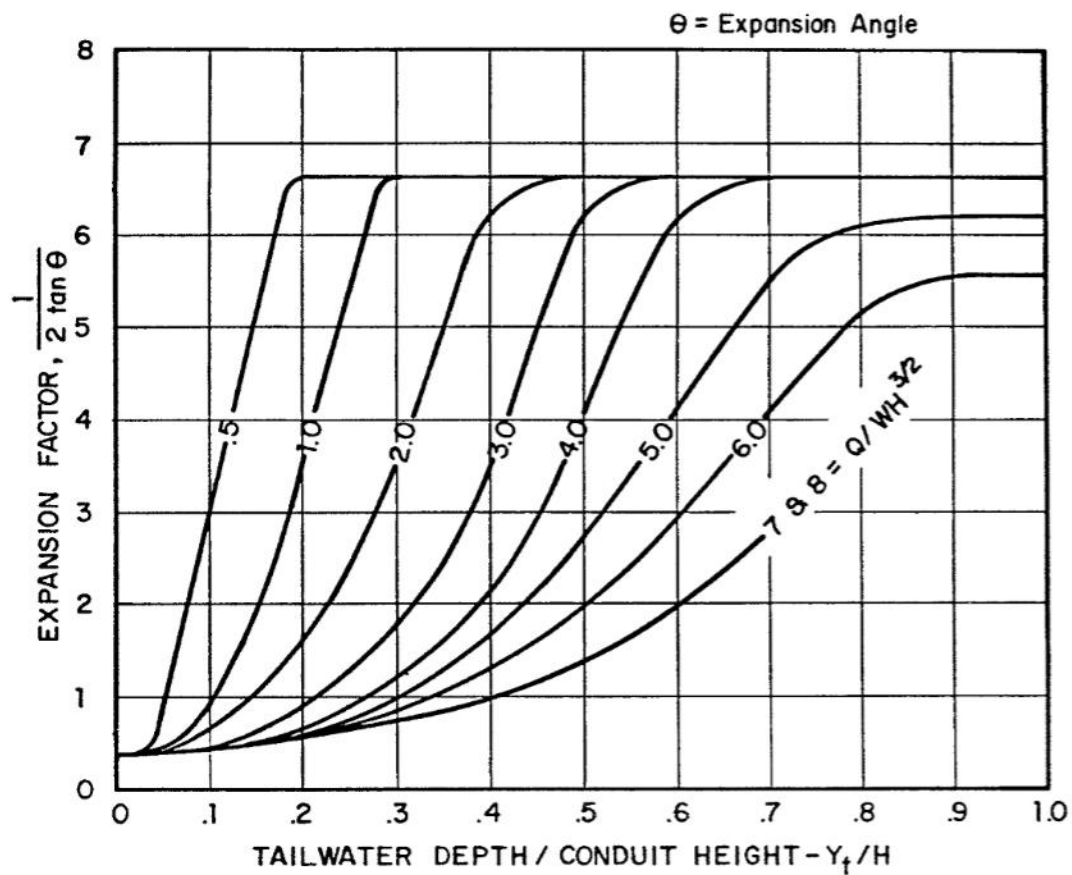


Figure 9-36. Expansion factor for rectangular conduits


**APPENDIX D**  
**Drainage Maps**



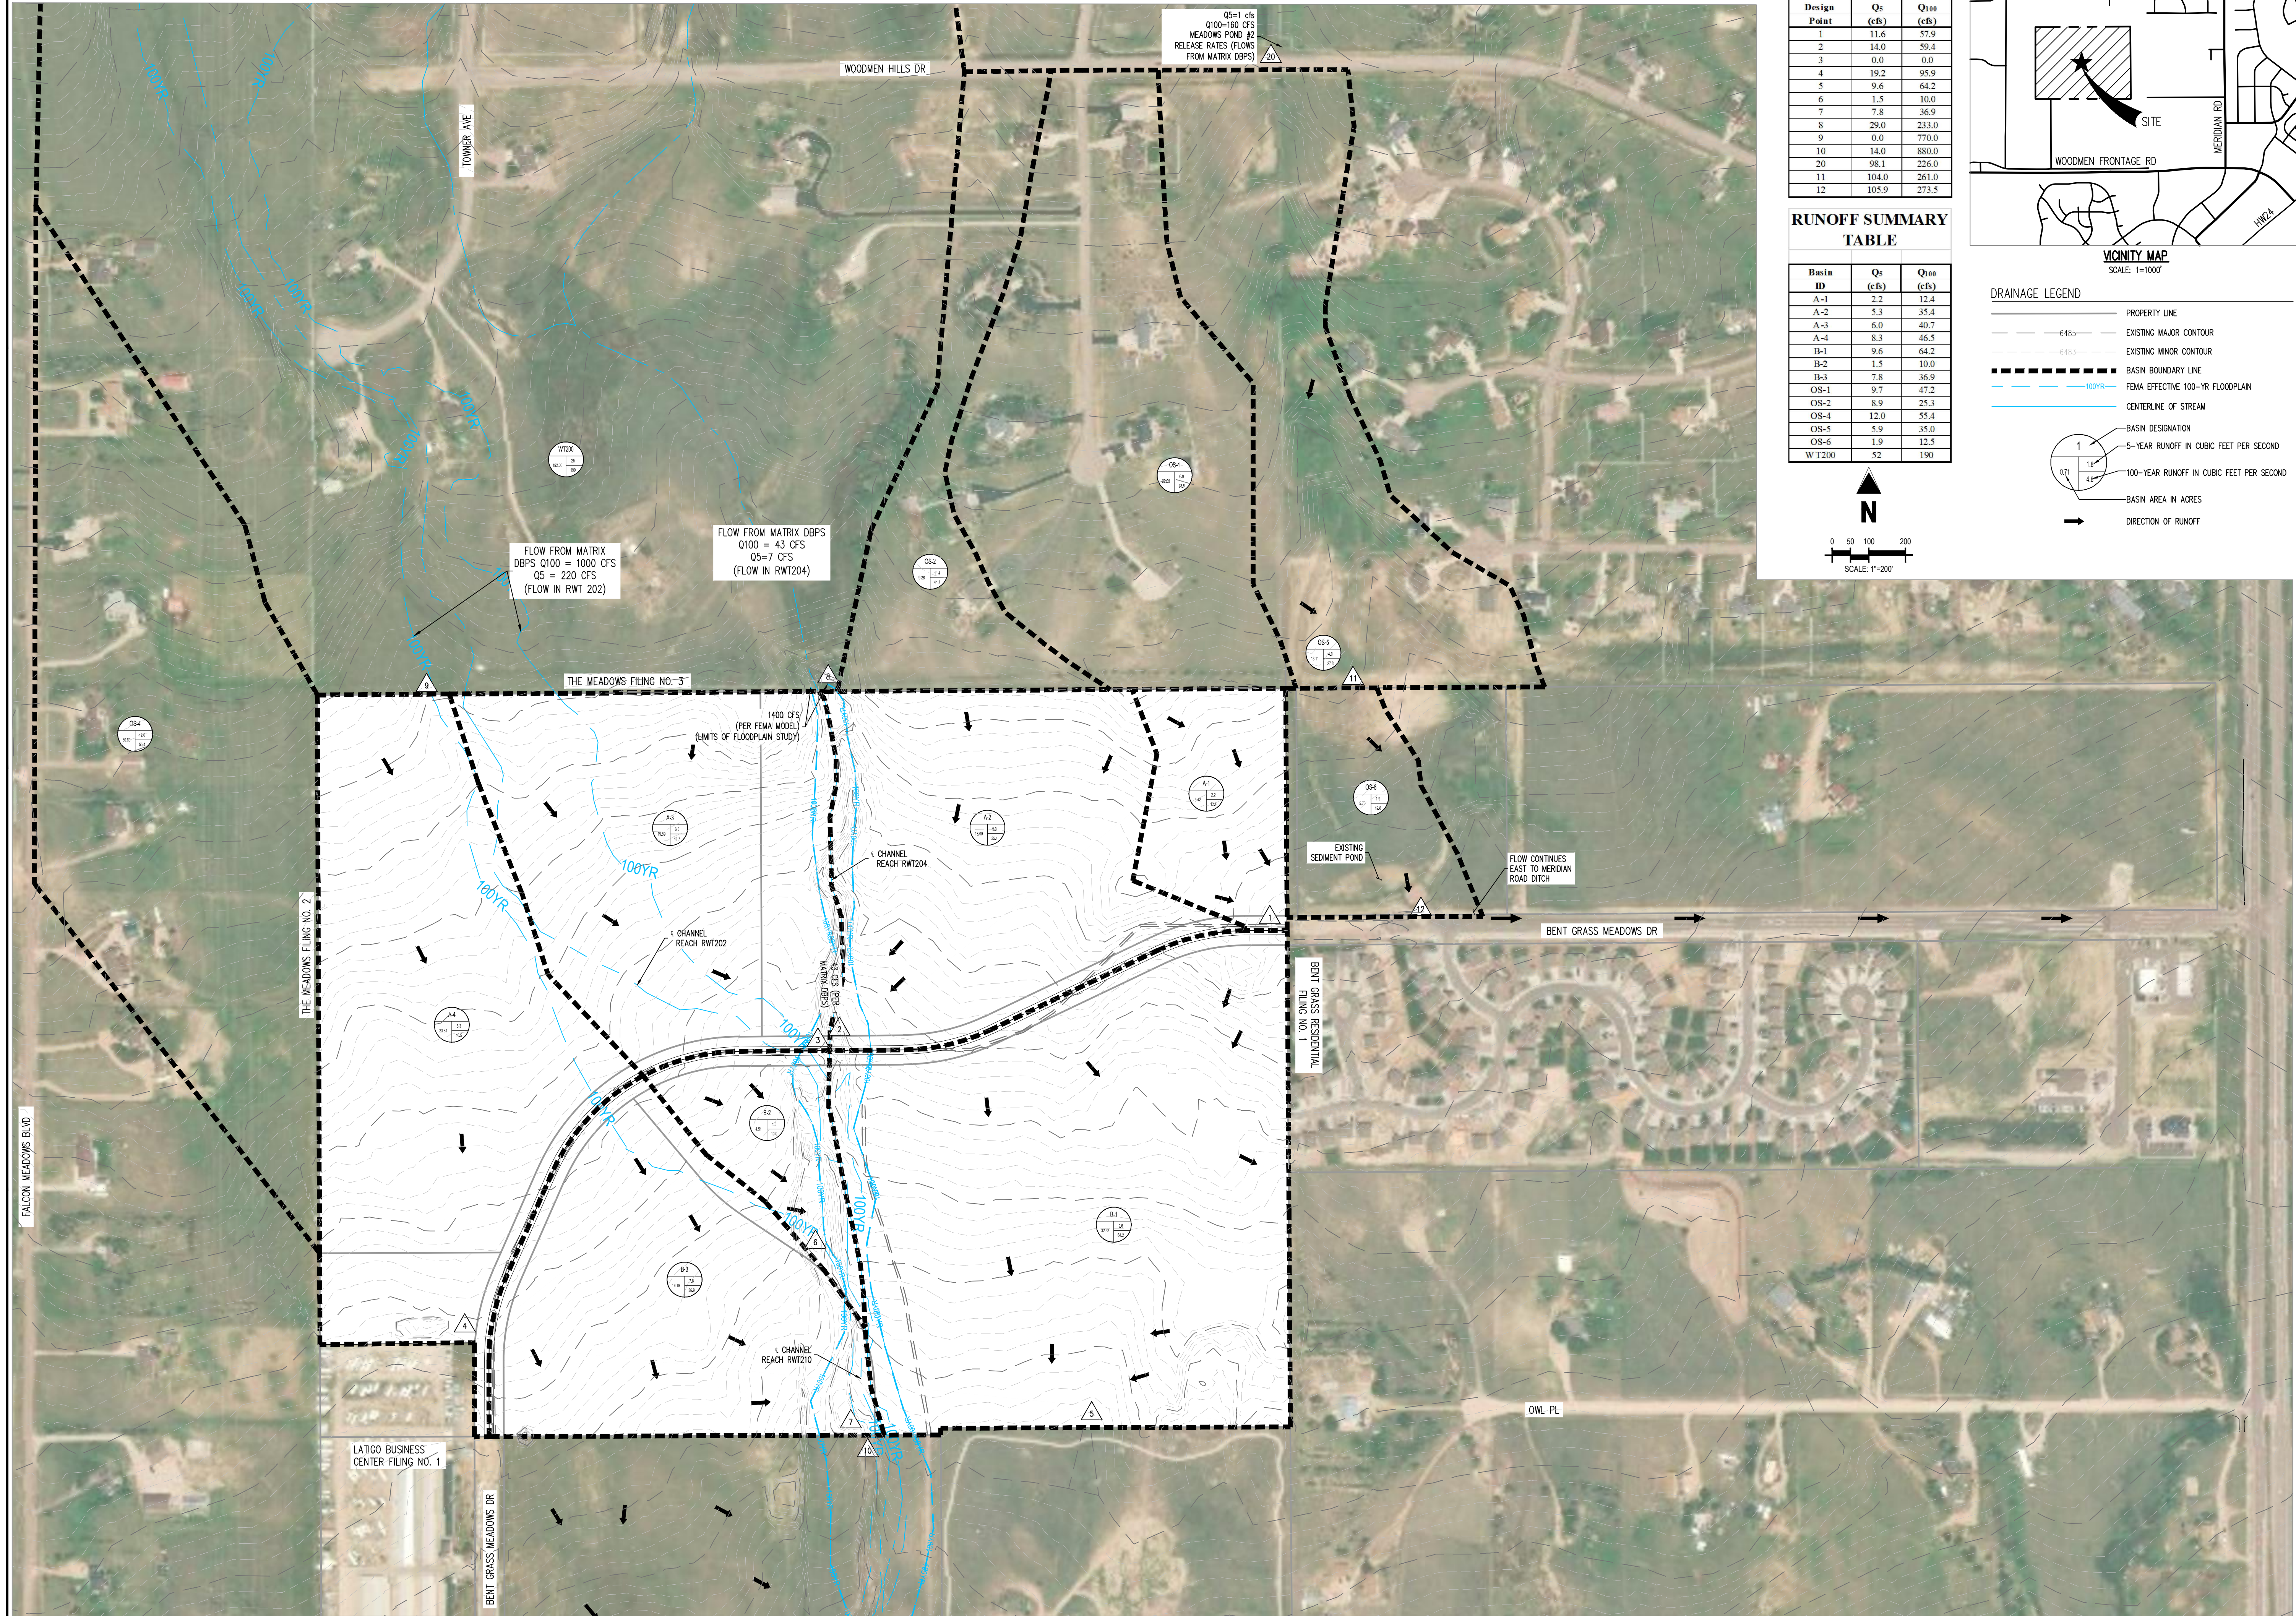

### DESIGN POINT SUMMARY TABLE

## RUNOFF SUMMARY TABLE

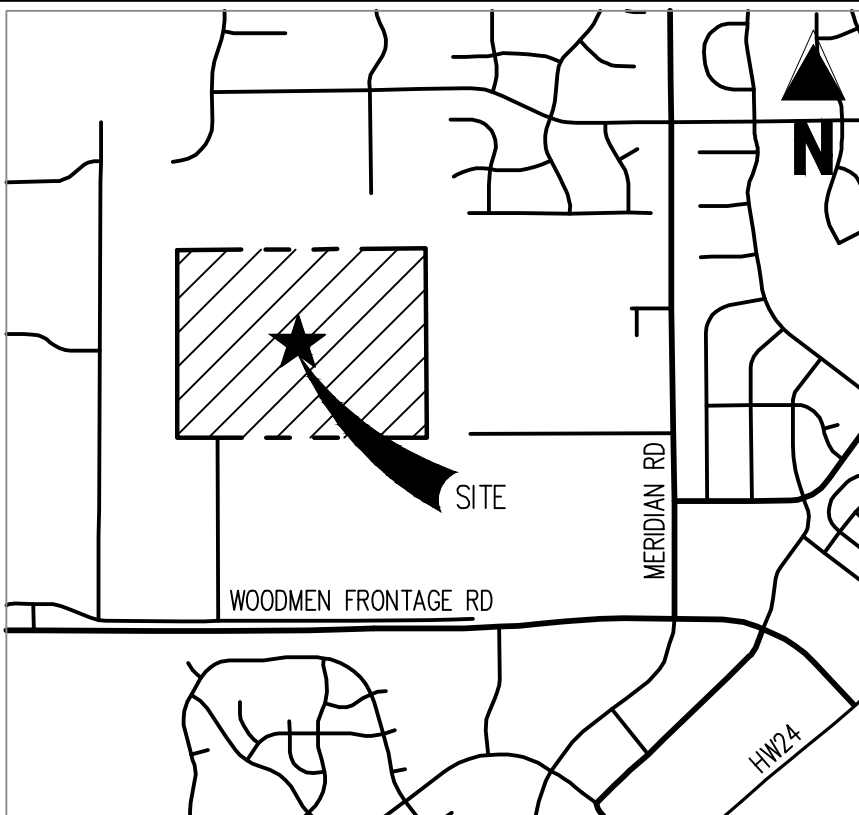

**Galloway**

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE  
AND ARE THE PROPERTY OF GALLOWAY, AND MAY  
NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED  
WITHOUT THE WRITTEN CONSENT OF GALLOWAY.  
COPYRIGHTS AND INFRINGEMENTS WILL BE  
ENFORCED AND PROSECUTED.

# CHALLENGER HOMES

PRELIMINARY DRAINAGE REPORT  
FALCON MEADOWS AT BENT GRASS  
FOR  
CHALLENGER COMMUNITIES, LLC  
  
BENT GRASS MEADOWS DRIVE & MERDIAN ROAD  
FALCON, CO 80831 - EL PASO COUNTY

[illegible]

Project No:	CLH000014.20
Drawn By:	CMWJ
Checked By:	SMB
Date:	OCTOBER 2019


HISTORIC DRAINAGE MAP

DR-1








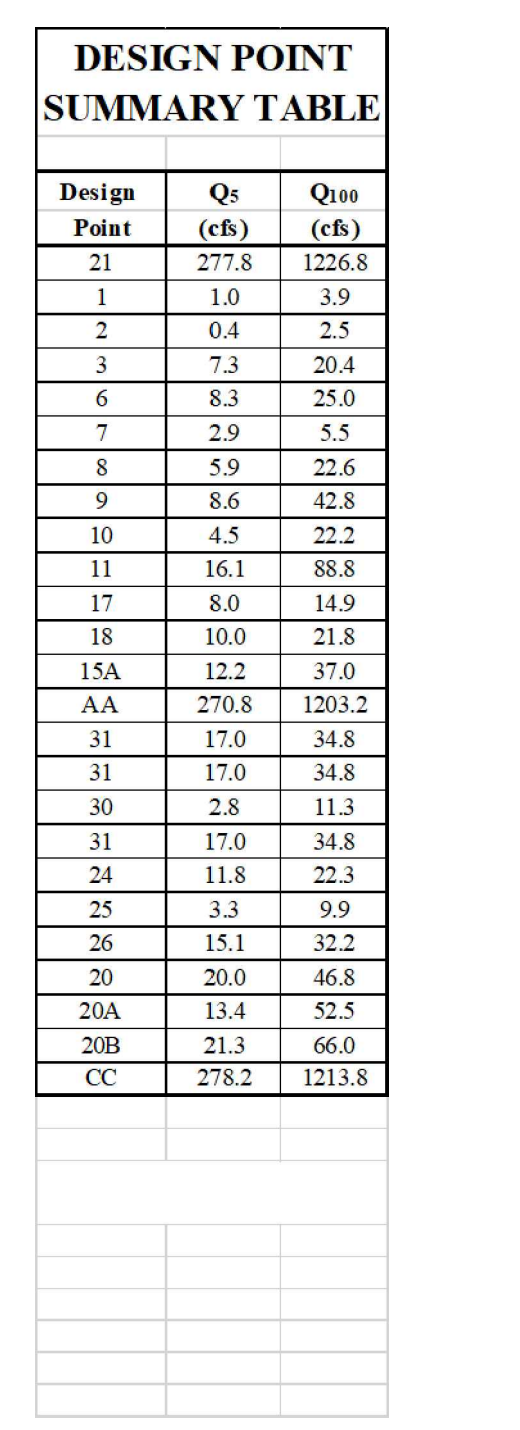



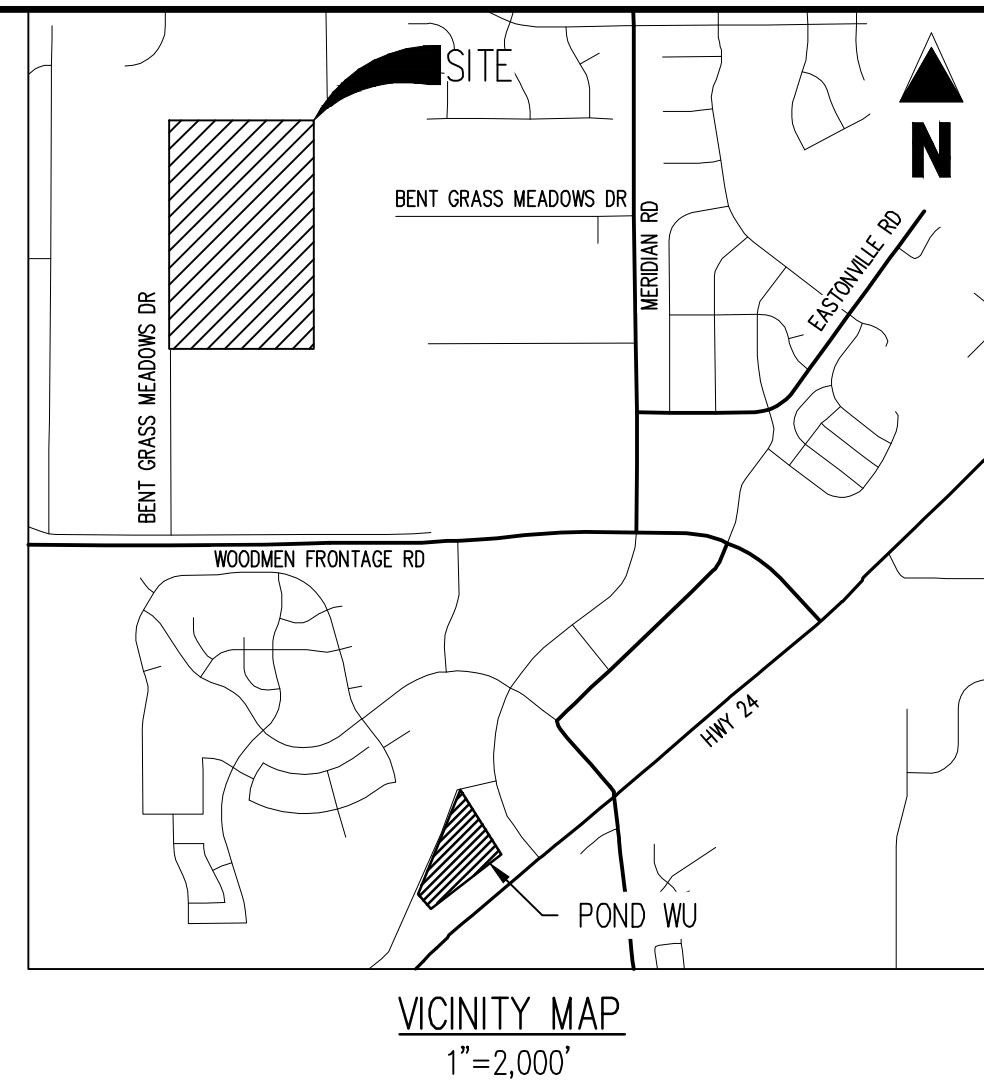

1155 Kelly Johnson Blvd., Suite 305  
Colorado Springs, CO 80920  
719.900.7220  
[GallowayUS.com](http://GallowayUS.com)

**PRELIMINARY**  
NOT FOR BIDDING  
NOT FOR CONSTRUCTION

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE  
AND ARE THE PROPERTY OF GALLOWAY, AND MAY  
NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED  
WITHOUT THE WRITTEN CONSENT OF GALLOWAY.  
COPYRIGHTS AND INFRINGEMENTS WILL BE  
ENFORCED AND PROSECUTED.

# CHALLENGER HOMES

PRELIMINARY DRAINAGE REPORT  
FOR EARLY GRADING  
FALCON MEADOWS AT BENT GRASS  
CHALLENGER COMMUNITIES, LLC  
  
BENT GRASS MEADOWS DRIVE & MERDIAN ROAD  
FALCON, CO 80831 - EL PASO COUNTY

DESIGN POINT SUMMARY TABLE		
Design Point	Q <sub>2</sub> (cfs)	Q <sub>90</sub> (cfs)
21	277.8	1226.8
1	1.0	3.9
2	0.4	2.5
3	7.3	20.4
6	8.3	25.0
7	2.9	5.5
8	5.9	22.6
9	8.6	42.8
10	4.5	22.2
11	16.1	88.8
17	8.0	14.9
18	10.0	21.8
15A	12.2	37.0
AA	270.8	1203.2
31	17.0	34.8
31	17.0	34.8
30	2.8	11.3
31	17.0	34.8
24	11.8	22.3
25	3.3	9.9
26	15.1	32.2
20	20.0	46.8
20A	13.4	52.5
20B	21.3	66.0
CC	278.2	1213.8

[illegible]

Project No:	CLH000017
Drawn By:	CMW
Checked By:	RGE
Date:	08/05/2020

## PROPOSED DRAINAGE MAP



# DR-3

4 | Challenger Horner Inc/CO, 3 | Paso County-CO, 1000017-Bent Grass West, PUD'S Permit Const Doc#03 04 Grading-Drainage Studies, 04 2 Proposed Drainage Reports-Hillary Grading, PDRDesign/Drawings/C, H17, PDR-DR 8086-EL(CR day) - Charlene Durham - 6/21/2021







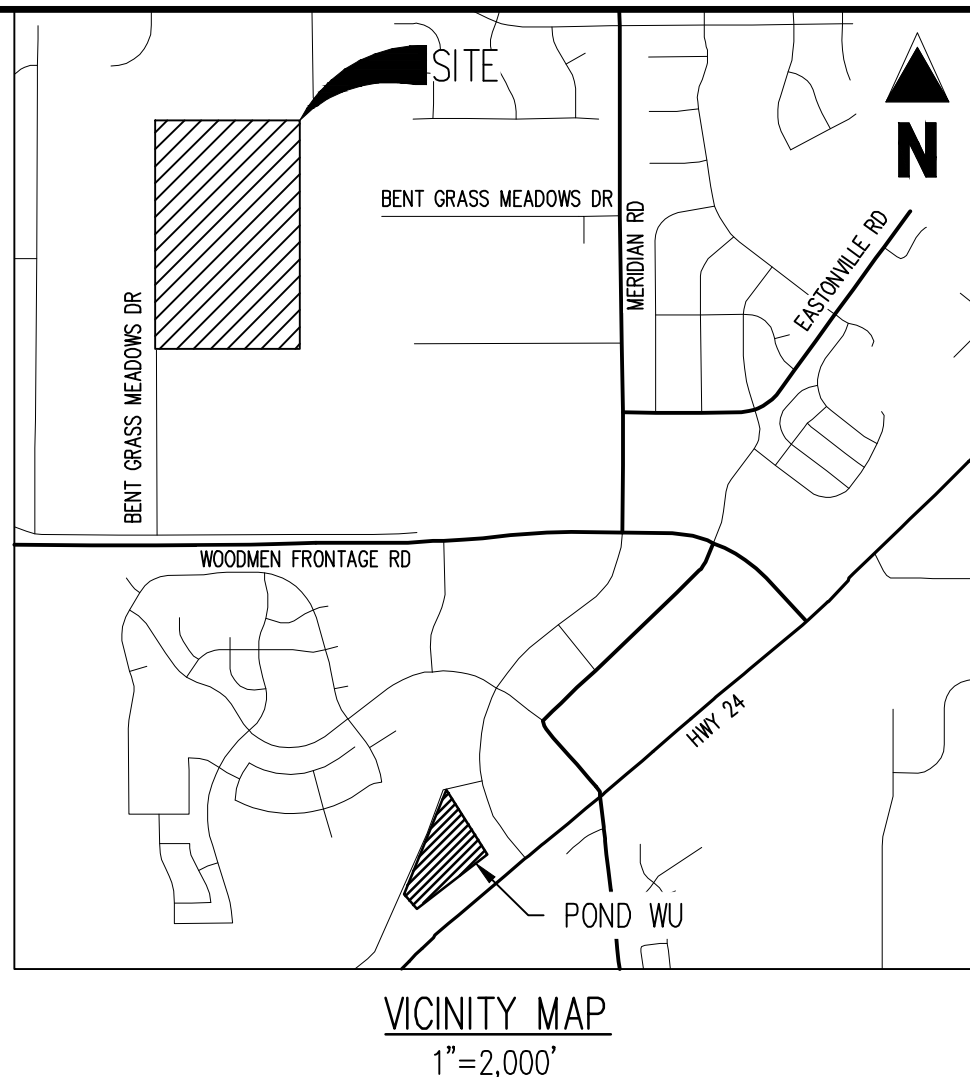

### DRAINAGE LEGEND

- 
- Figure 1 is a legend titled "Symbols and Abbreviations" that defines various symbols used in the manual. The symbols are listed on the left, and their corresponding descriptions are on the right.
- PROPERTY LINE**: A solid black line.
  - EXISTING MAJOR CONTOUR**: A dashed line with the number 6480.
  - EXISTING MINOR CONTOUR**: A dashed line with the number 6482.
  - PROPOSED MAJOR CONTOUR**: A solid line with the number 6480.
  - PROPOSED MINOR CONTOUR**: A solid line with the number 6482.
  - Basin Boundary Line**: A thick red dashed line.
  - DRAINAGE TRAVEL PATH**: A line with arrows pointing in the direction of flow.
  - FEMA EFFECTIVE 100-YR FLOODPLAIN**: A blue line with the text "100YR" above it.
  - FEMA EFFECTIVE 100-YR FLOODPLAIN**: A blue line with a blue arrow pointing to it.
  - CENTERLINE OF STREAM**: A blue line with a blue arrow pointing to it.
  - EXISTING RIPRAP**: A rectangular area filled with a pattern of small circles.
  - PROPOSED RIPRAP**: A rectangular area filled with a pattern of small circles.
  - PROPOSED ACCESS**: A rectangular area filled with a pattern of small circles.
  - Basin Designation**: A circle with the number 1 inside.
  - 5-YEAR RUNOFF IN CUBIC FEET PER SECOND**: A circle with the number 1.8 inside.
  - 100-YEAR RUNOFF IN CUBIC FEET PER SECOND**: A circle with the number 4.6 inside.
  - Basin Area in Acres**: A circle with the number 0.71 inside.
  - Design Point**: A triangle with the number 1 inside.
  - DIRECTION OF RUNOFF**: A black arrow pointing to the right.

Basin ID	Aren (acres)	Qc (cfs)	Q <sub>100</sub> (cfs)
RW T202 (DBPS Flow)	1574.40	220.0	1000.0
RW T204 (DBPS Flow)	38.40	7.0	43.0
W T200 (DBPS Flow)	192.00	52.0	190.0
EX-1	1.19	0.4	2.5
EX-2	1.56	0.5	3.7
EX-3	0.62	0.2	1.5
EX-4	16.80	5.1	34.3
EX-5	1.11	0.4	2.5
EX-6	16.60	4.7	31.9
EX-7	1.72	0.5	3.3
B-1	5.62	1.5	10.1
B-2	1.17	0.4	2.4
D-4	2.11	8.1	14.6
D-5	1.08	2.2	4.6
D-6	4.01	8.2	17.2
D-7	4.42	2.9	11.3
D-8	2.74	0.9	6.0
D-9	3.20	1.7	7.5
OS-1	32.28	15.1	65.1
OS-2	20.07	9.0	43.4
OS-3	10.61	4.7	24.3
OS-4	4.46	5.6	14.0
OS-5	0.46	1.1	2.3
OS-6	1.17	2.0	4.3
E-1	1.71	3.6	7.7
E-2	0.62	2.9	5.6
E-3	0.78	2.9	5.3
E-4	0.91	3.0	5.7
E-5	0.89	3.3	6.1

DESIGN POINT SUMMARY TABLE		
Design Point	Q <sub>s</sub> (cfs)	Q <sub>100</sub> (cfs)
21	277.8	1226.8
1	1.0	3.9
2	0.4	2.5
3	7.3	20.4
6	8.3	25.0
7	2.9	5.5
8	5.9	22.6
9	8.6	42.8
10	4.5	22.2
11	16.1	88.8
17	8.0	21.9
18	10.0	14.8
15A	12.2	37.0
AA	270.8	1202.2
31	17.0	34.8
31	17.0	34.8
30	2.8	11.3
31	17.0	34.8
24	11.8	22.3
25	3.3	9.9
26	15.1	32.2
20	20.0	46.8
20A	13.4	52.5
20B	21.3	66.0
CC	278.2	1213.8

#	Date	Issue / Description	Init.
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			
21			
22			
23			
24			
25			
26			
27			
28			
29			
30			
31			
32			
33			
34			
35			
36			
37			
38			
39			
40			
41			
42			
43			
44			
45			
46			
47			
48			
49			
50			
51			
52			
53			
54			
55			
56			
57			
58			
59			
60			
61			
62			
63			
64			
65			
66			
67			
68			
69			
70			
71			
72			
73			
74			
75			
76			
77			
78			
79			
80			
81			
82			
83			
84			
85			
86			
87			
88			
89			
90			
91			
92			
93			
94			
95			
96			
97			
98			
99			
100			

Project No:	CLH000017
Drawn By:	CMWJ
Checked By:	RGD
Date:	08/05/2020

# PROPOSED DRAINAGE MAP

DR-5







**Channel P&P's and Details**

(FOR INFORMATION ONLY - NOT  
PART OF THE EARLY GRADING)
















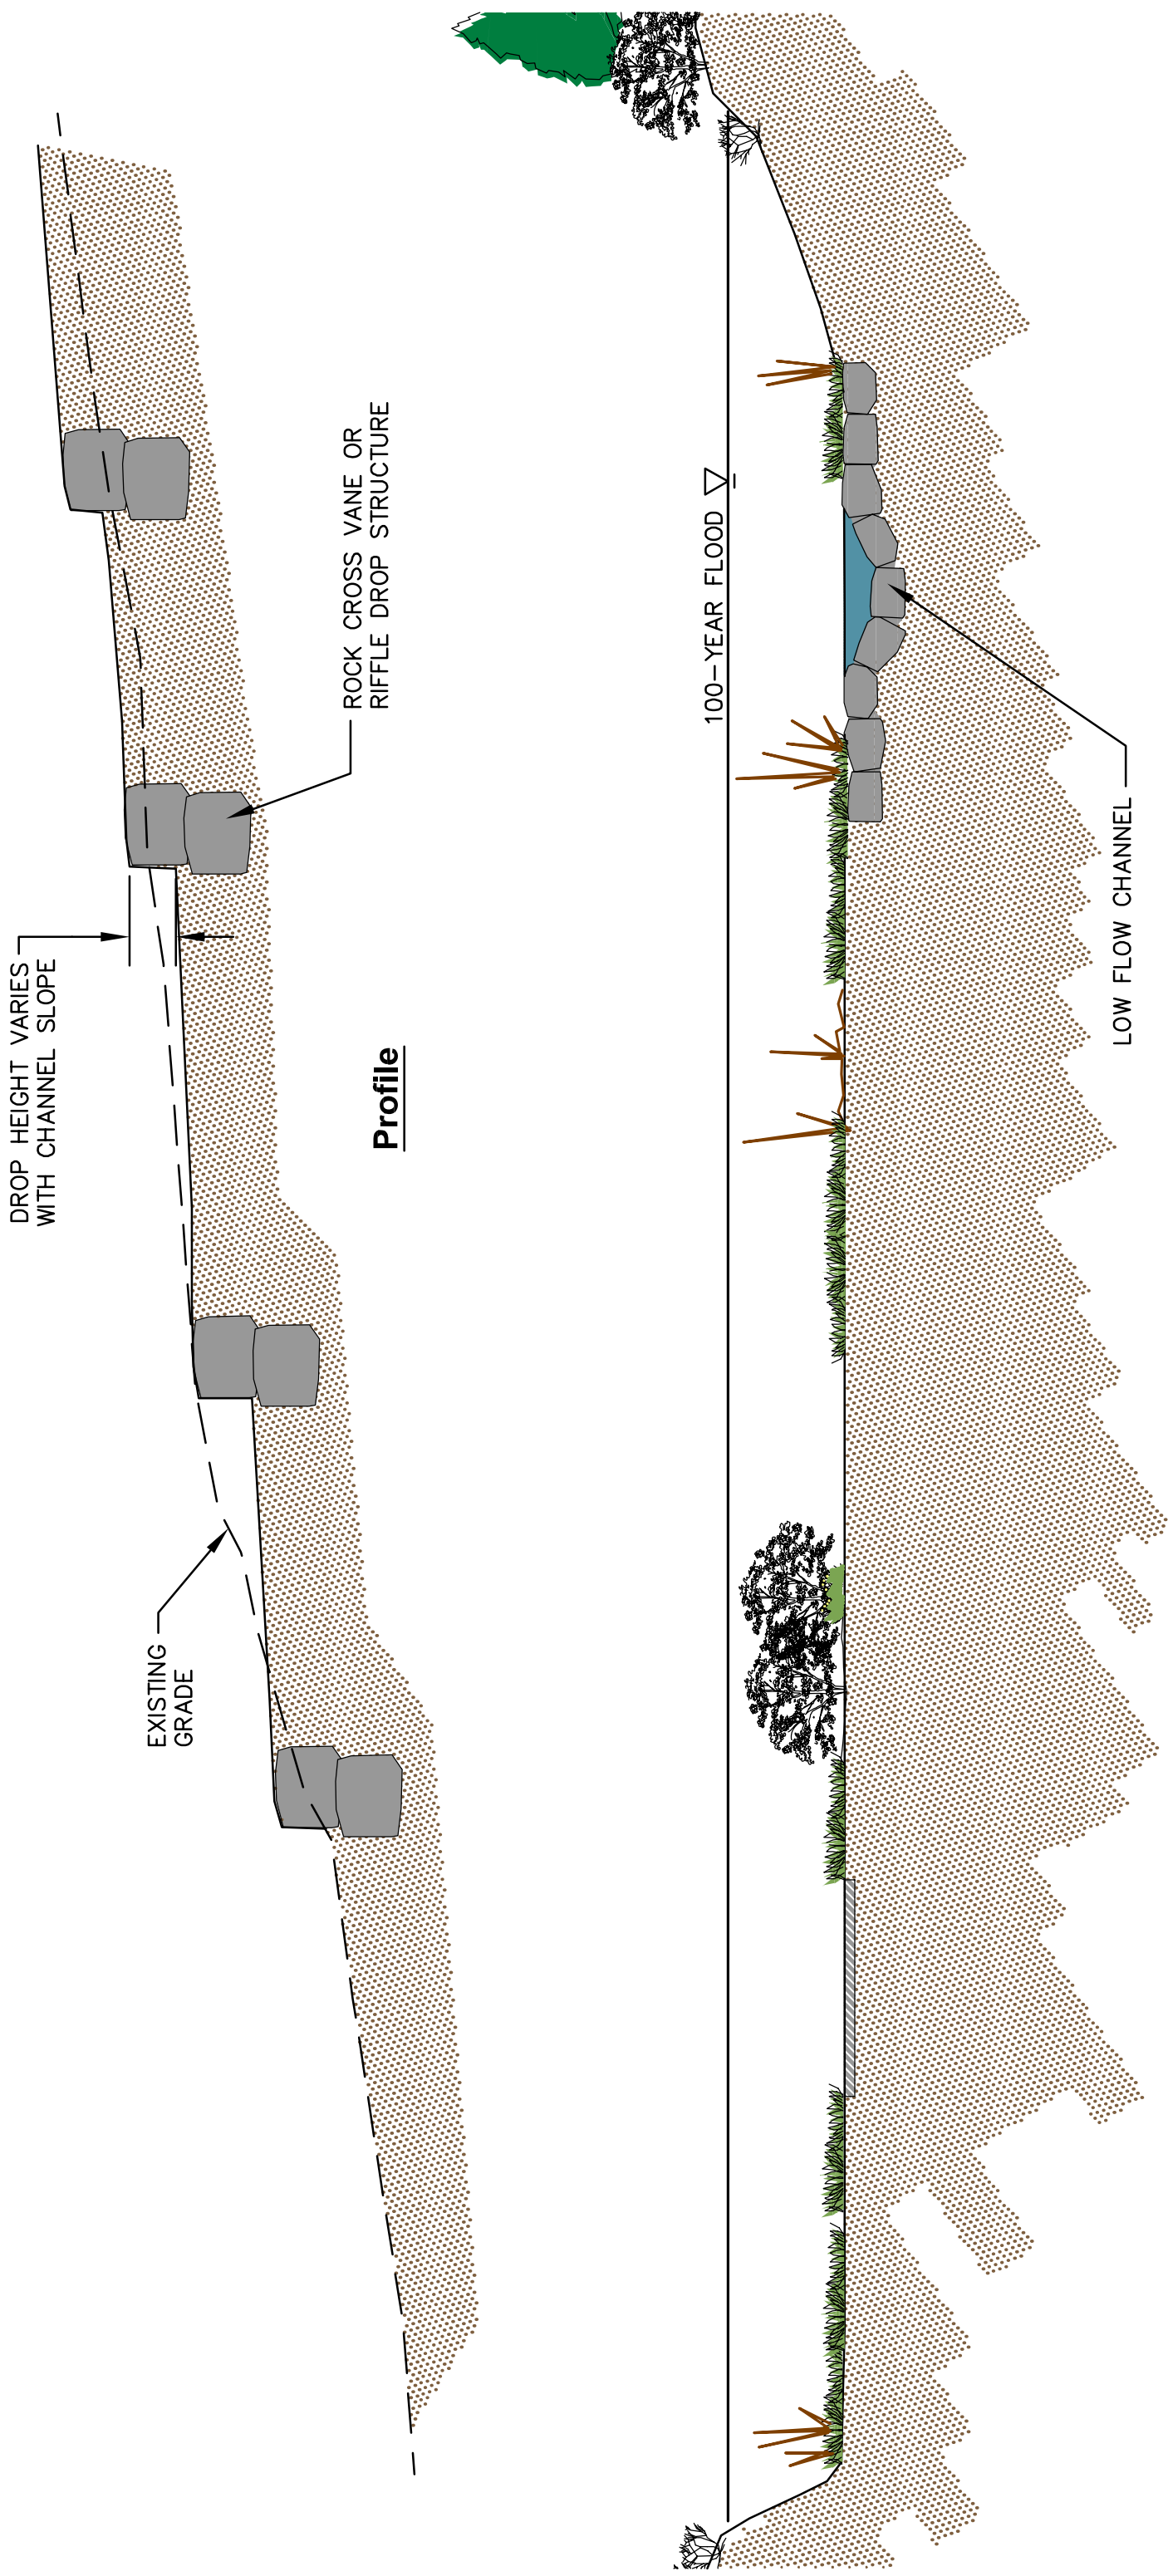



NAME: S:\10.122.003 (Falcon DBPS)\DWG\Channel\_sec-pro\_exhibit.dwg  
PCP: Matrix.cdb  
PLOT DATE: Wed Dec 21, 2011 3:03pm




2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920  
Phone 719-575-0100  
Fax 719-575-0208



## Natural Channel with Grade Control Structures

Figure 5-4



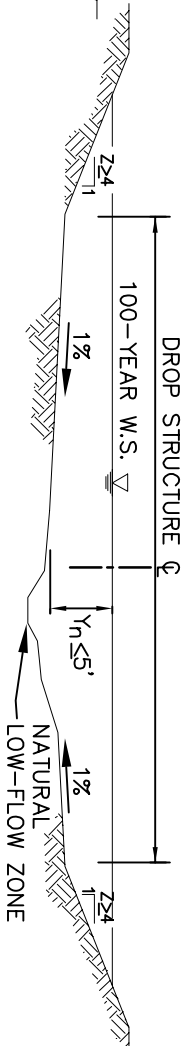


### TYPICAL CHANNEL SECTION (UPSTREAM AND DOWNSTREAM OF DROP)


REACH	CREST WIDTH (FT)
RET020	18
RET030	21
RET040	23
RET100	28
RET110	28
RET150	29
RET156	30
RET162	30
RMTO50	23
RMTO62	20
RMTO64	24
RMTO80	27
RMTO92	15
RMTO94	27
RMTO98	27
RMTO99	27
RMTO102	27
RMTO104	27
RMTO106	27
RMTO110	27
RMTO112	27
RMTO114	27
RMTO116	27
RMTO118	27
RMTO120	27
RMTO122	27
RMTO124	27
RMTO126	27
RMTO128	27
RMTO130	27
RMTO132	27
RMTO134	27
RMTO136	27
RMTO138	27
RMTO140	27
RMTO142	27
RMTO144	27
RMTO146	27
RMTO148	27
RMTO150	27
RMTO152	27
RMTO154	27
RMTO156	27
RMTO158	27
RMTO160	27
RMTO162	27
RMTO164	27
RMTO166	27
RMTO168	27
RMTO170	27
RMTO172	27
RMTO174	27
RMTO176	27
RMTO178	27
RMTO180	27
RMTO182	27
RMTO184	27
RMTO186	27
RMTO188	27
RMTO190	27
RMTO192	27
RMTO194	27
RMTO196	27
RMTO198	27
RMTO200	27
RMTO202	27
RMTO204	27
RMTO206	27
RMTO208	27
RMTO210	27
RMTO212	27
RMTO214	27
RMTO216	27
RMTO218	27
RMTO220	27
RMTO222	27
RMTO224	27
RMTO226	27
RMTO228	27
RMTO230	27
RMTO232	27
RMTO234	27
RMTO236	27
RMTO238	27
RMTO240	27
RMTO242	27
RMTO244	27
RMTO246	27
RMTO248	27
RMTO250	27
RMTO252	27
RMTO254	27
RMTO256	27
RMTO258	27
RMTO260	27
RMTO262	27
RMTO264	27
RMTO266	27
RMTO268	27
RMTO270	27
RMTO272	27
RMTO274	27
RMTO276	27
RMTO278	27
RMTO280	27
RMTO282	27
RMTO284	27
RMTO286	27
RMTO288	27
RMTO290	27
RMTO292	27
RMTO294	27
RMTO296	27
RMTO298	27
RMTO300	27
RMTO302	27
RMTO304	27
RMTO306	27
RMTO308	27
RMTO310	27
RMTO312	27
RMTO314	27
RMTO316	27
RMTO318	27
RMTO320	27
RMTO322	27
RMTO324	27
RMTO326	27
RMTO328	27
RMTO330	27
RMTO332	27
RMTO334	27
RMTO336	27
RMTO338	27
RMTO340	27
RMTO342	27
RMTO344	27
RMTO346	27
RMTO348	27
RMTO350	27
RMTO352	27
RMTO354	27
RMTO356	27
RMTO358	27
RMTO360	27
RMTO362	27
RMTO364	27
RMTO366	27
RMTO368	27
RMTO370	27
RMTO372	27




CONSTRUCTED GROUDED SLOPING BOULDER  
DROP STRUCTURE

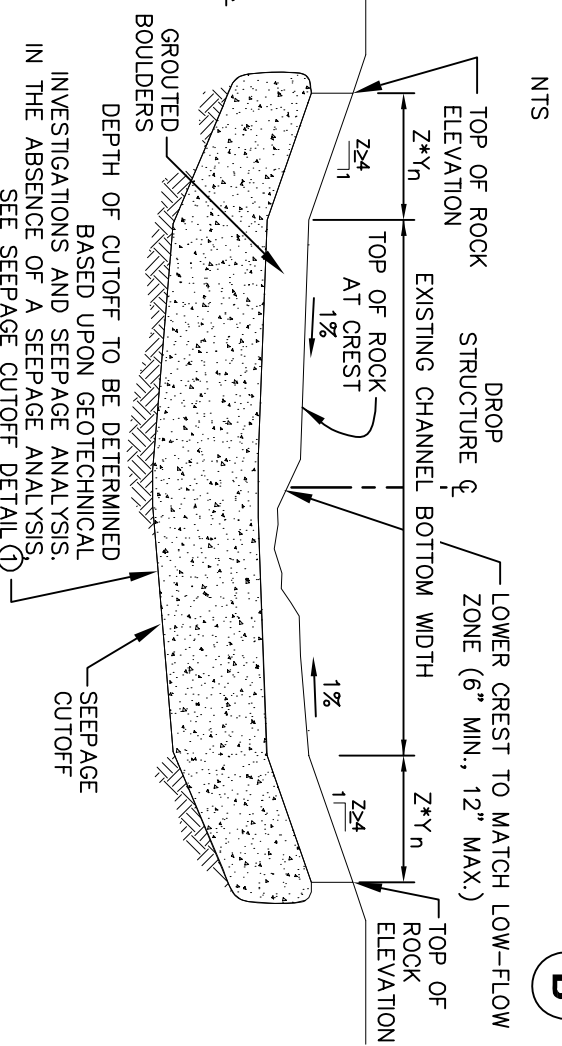


### SEEPAGE CUTOFF SECTION

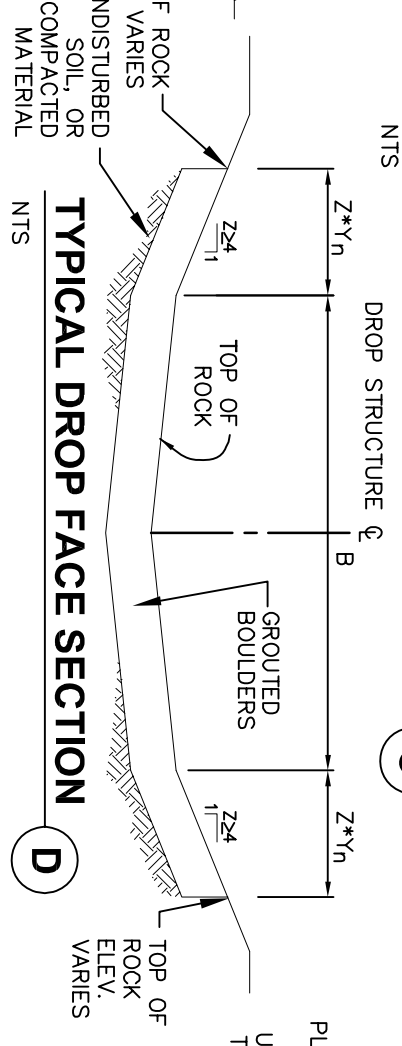


### TYPICAL DROP FACE SECTION

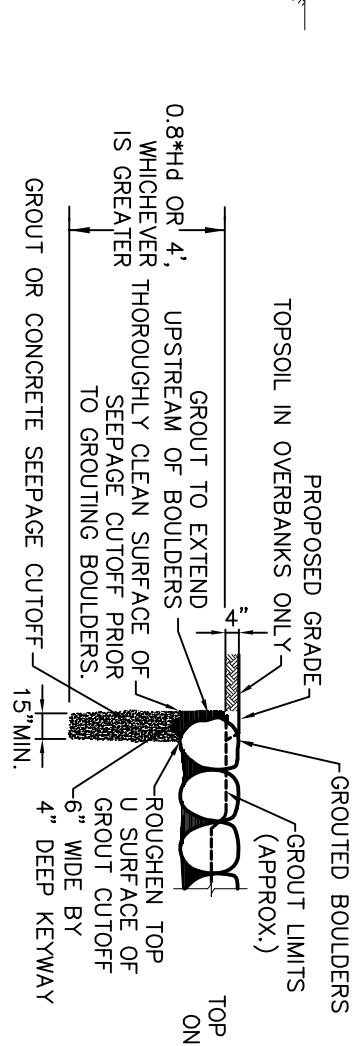


### SEEPAGE CUTOFF DETAIL

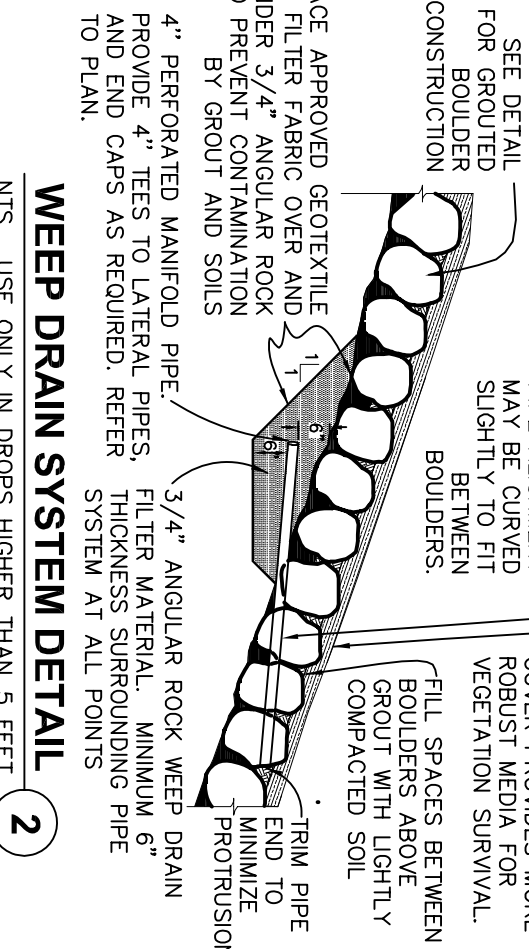


### WEEP DRAIN SYSTEM DETAIL

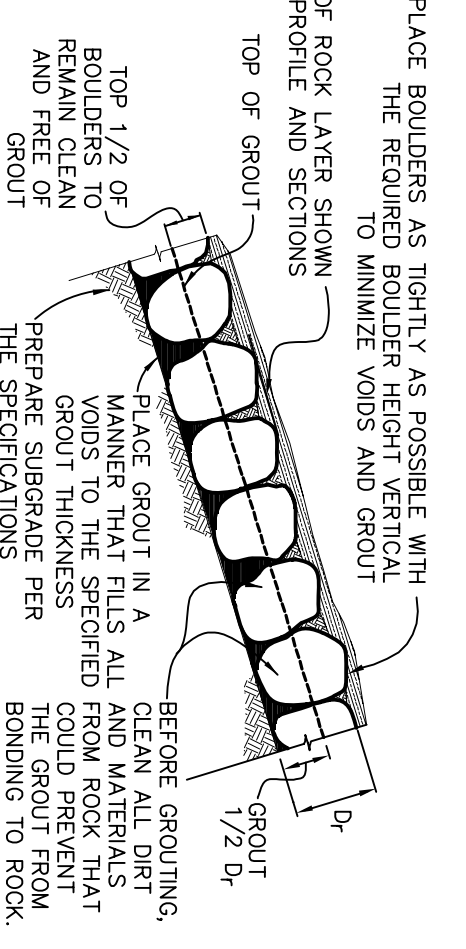

### GROUDED BOULDER PLACEMENT DETAIL

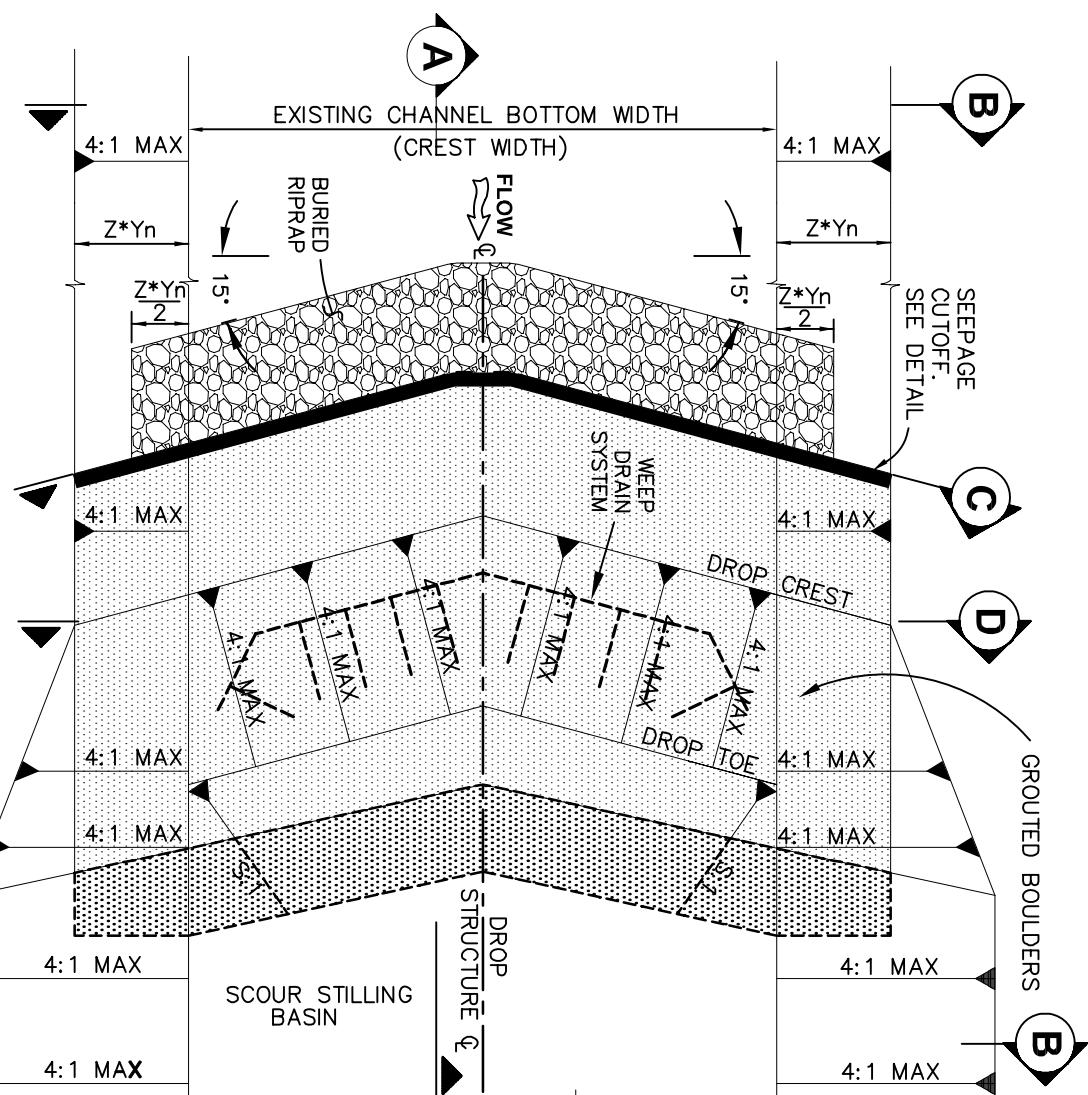

### DROP STRUCTURE PLAN

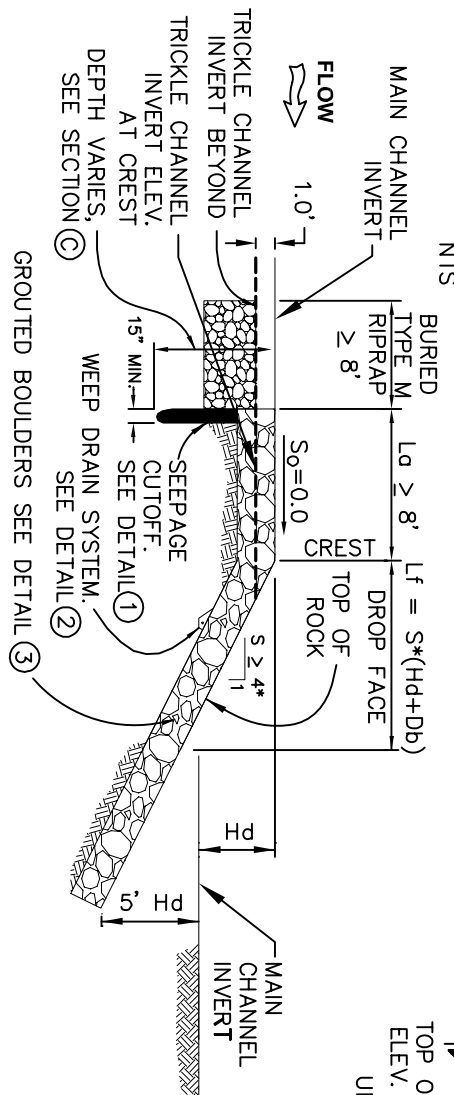

### DROP STRUCTURE PROFILE



**Matrix**  
DESIGN GROUP

2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920  
Phone 719-575-0100  
Fax 719-575-0208

## TYPICAL GROUDED SLOPING (GSB) BOULDER DROP STRUCTURE

NOT FOR CONSTRUCTION




- NOTES:
- 1.) REACHES THAT ARE CURRENTLY DEGRADED MUST BE FILLED TO THE EXISTING FLOODPLAIN ELEVATION. THE LOW FLOW CHANNEL SHALL THEN BE CUT OUT OF THE FILL MATERIAL.
  - 2.) DIMENSIONS SHOWN ARE TYPICAL AND VARY WITH THE LOW FLOW CHANNEL WIDTH.
  - 3.) ALL CHANNEL CROSS-SECTIONS SHALL HAVE A LOW FLOW FLOOD WIDTH TO DEPTH RATIO (W/D) OF 23.
  - 4.) CHANNEL CAPACITY VARIES WITH THE LOW FLOW CHANNEL WIDTH AND SLOPE.
  - 5.) THESE CROSS-SECTIONS SHALL ONLY BE APPLIED TO "NATURAL CHANNEL DESIGN" REACHES.





BEFORE NATURAL  
CHANNEL CONSTRUCTION



AFTER NATURAL  
CHANNEL CONSTRUCTION

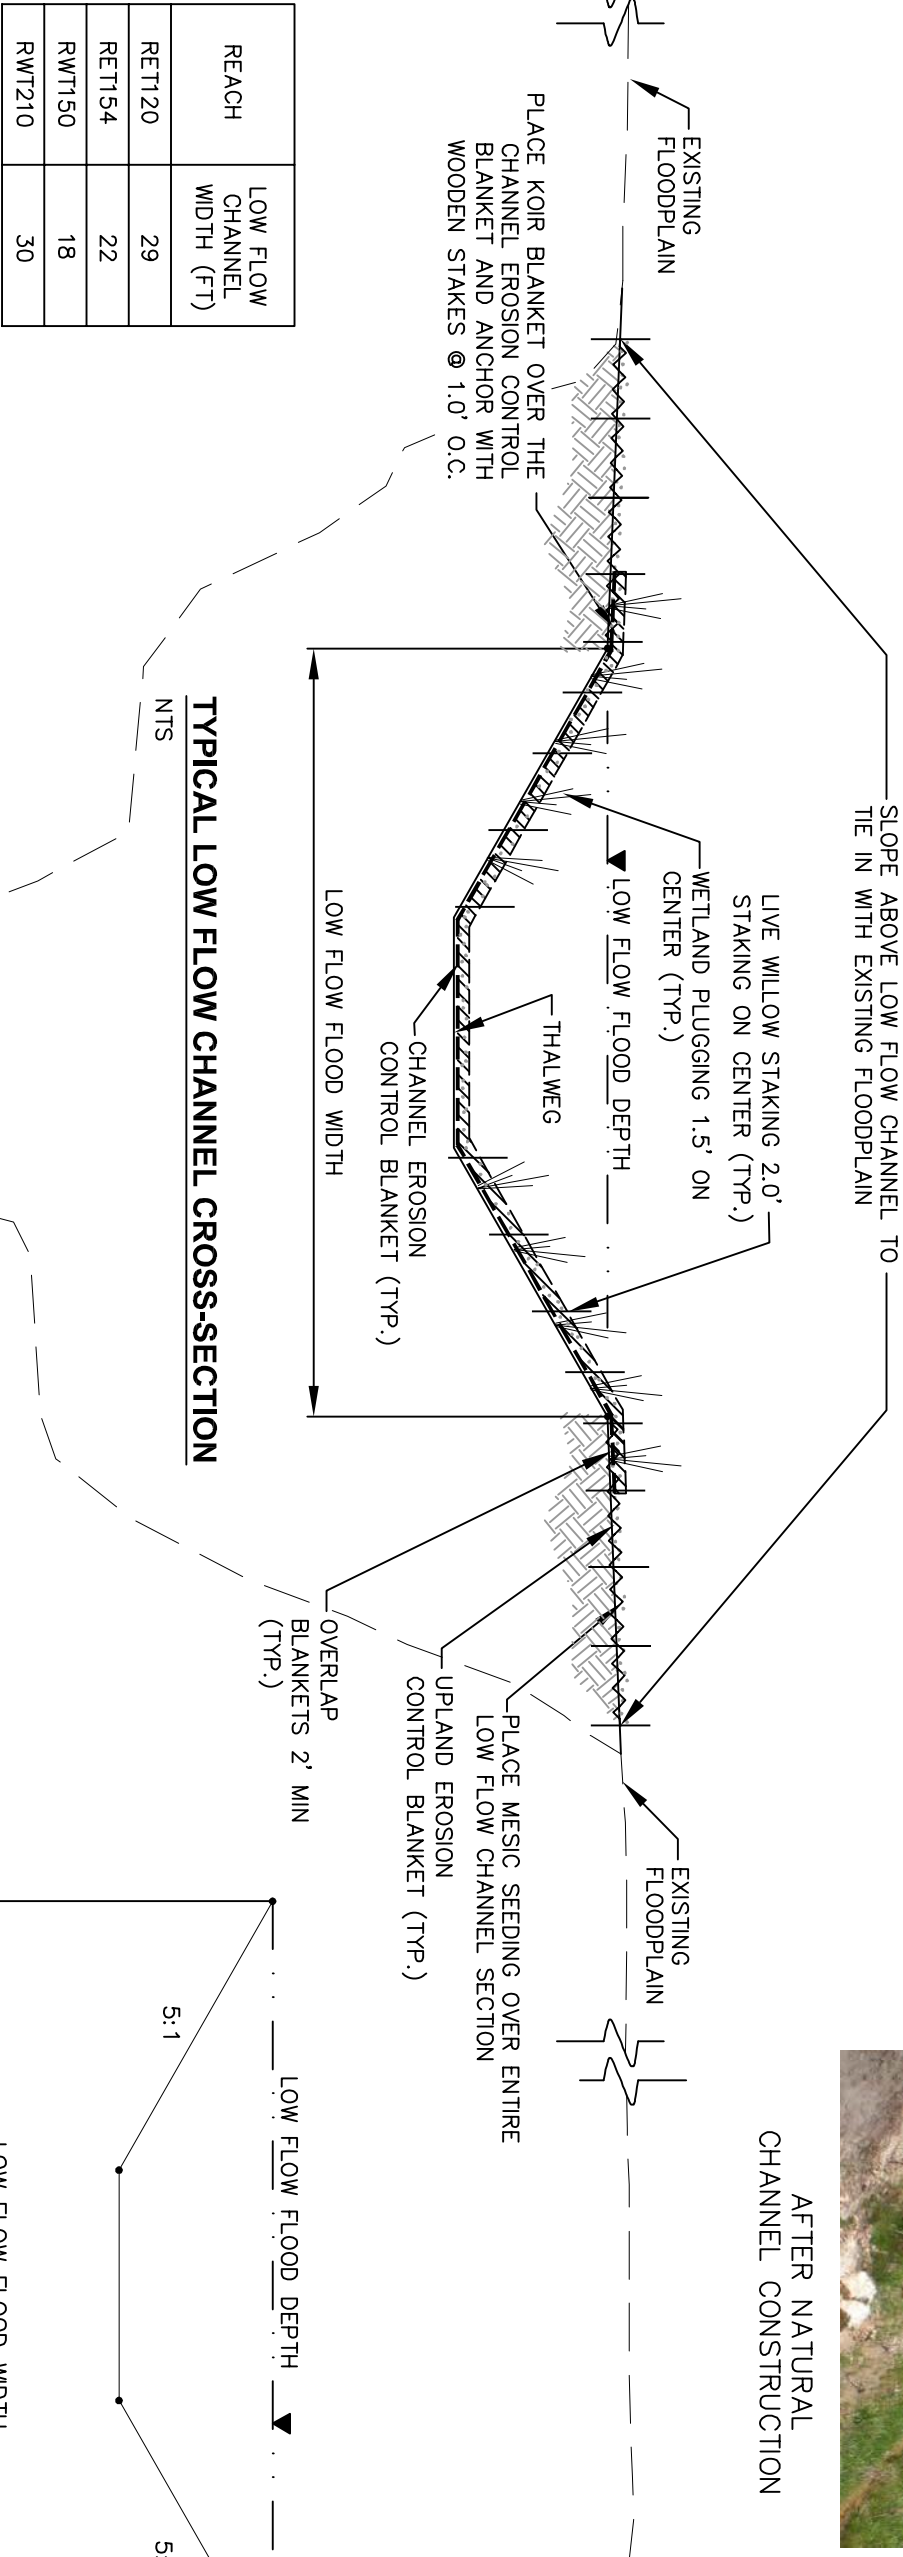

REACH	LOW FLOW CHANNEL WIDTH (FT)
RET120	29
RET154	22
RWT150	18
RWT210	30

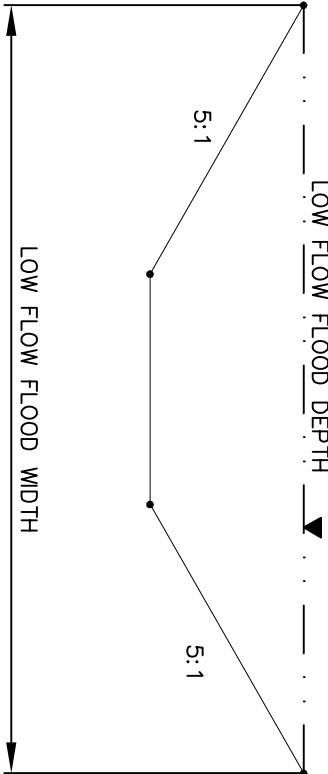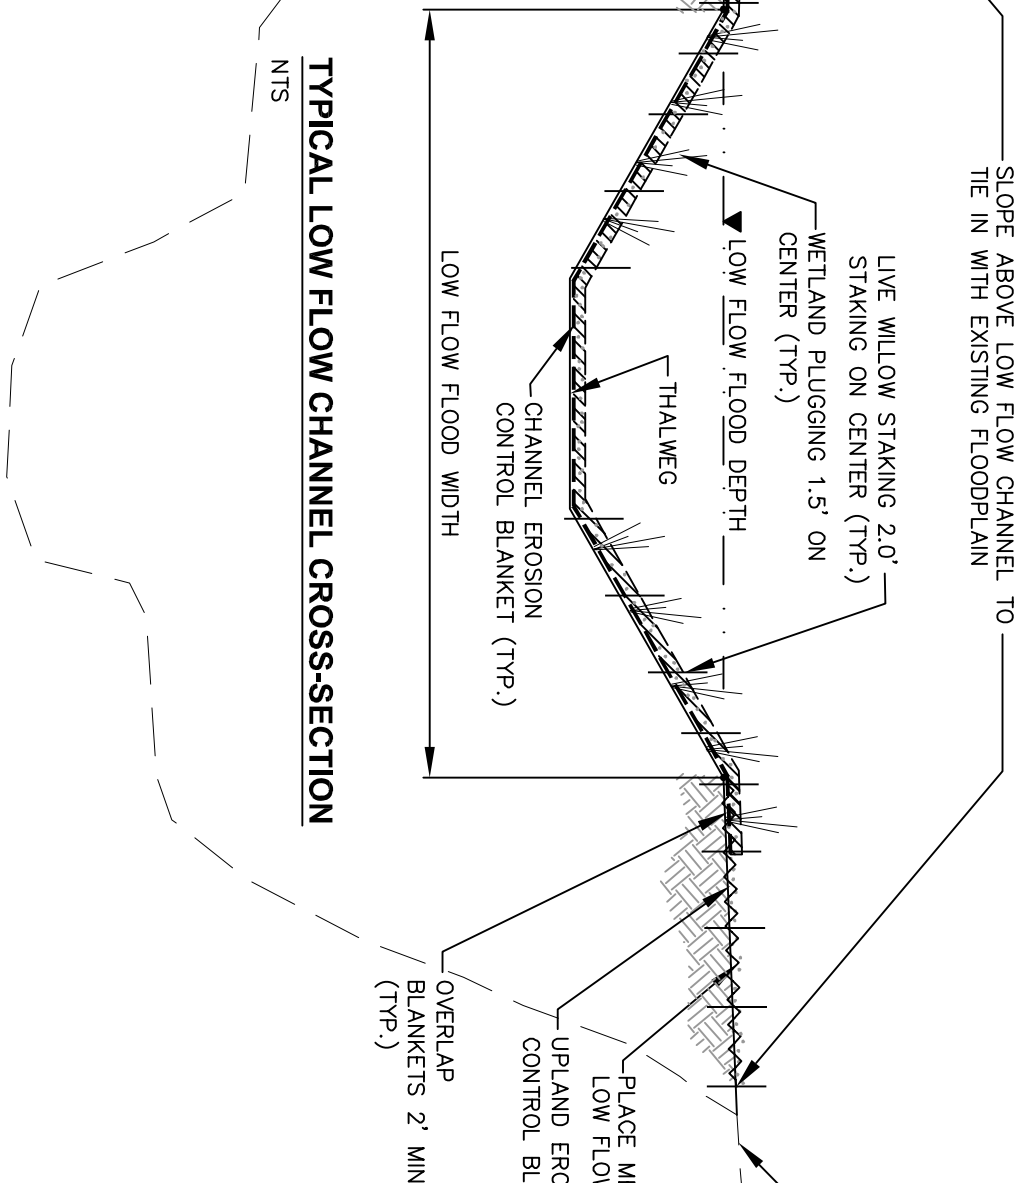

2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920  
Phone 719-575-0100  
Fax 719-575-0208

NAME: S:\10122003 (Falcon DBPS)\DWG\XSEC-RCVANE-ROSEamb1.dwg  
POP: Morkacib  
PLOT DATE: Tue Jun 18, 2013 11:46pm

# TYPICAL NATURAL CHANNEL CROSS-SECTIONS


## FOR USE IN NATURAL CHANNEL DESIGN REACHES

NOT FOR CONSTRUCTION





CONSTRUCTED RIFFLE DROP STRUCTURE

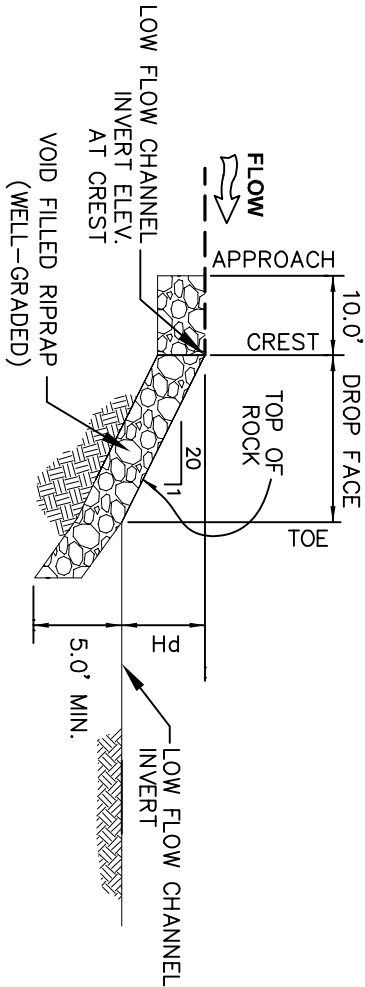


NOTE:  
REFER TO EROSION CONTROL  
BLANKET DETAIL FOR  
BLANKET INSTALLATION.

**A**

**RIFFLE DROP STRUCTURE PROFILE**

NTS

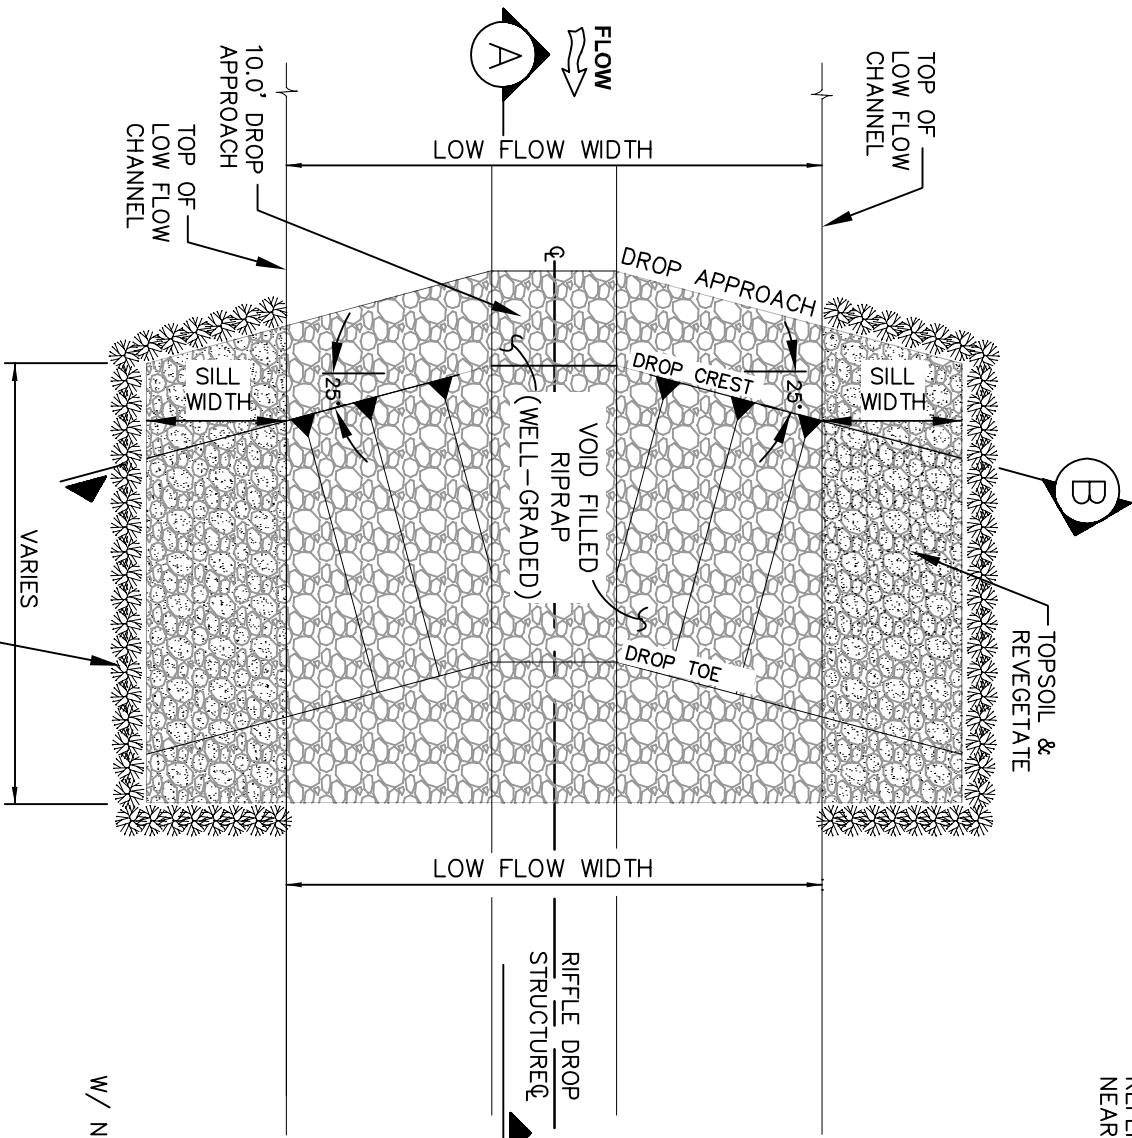


IF ACCESS OR AVAILABILITY PRECLUDES \*  
LIVE WILLOW TRANSPLANTS, PLACE  
CONTINUOUS LAYER OF WILLOW STAKES  
VERTICALLY IN SILL TRENCH  
PRIOR TO BACKFILL

**RIFFLE DROP STRUCTURE PLAN**

NTS

REACH	LOW FLOW CHANNEL WIDTH (FT)
RET1120	29
RET1154	22
RWT150	18
RWT210	30

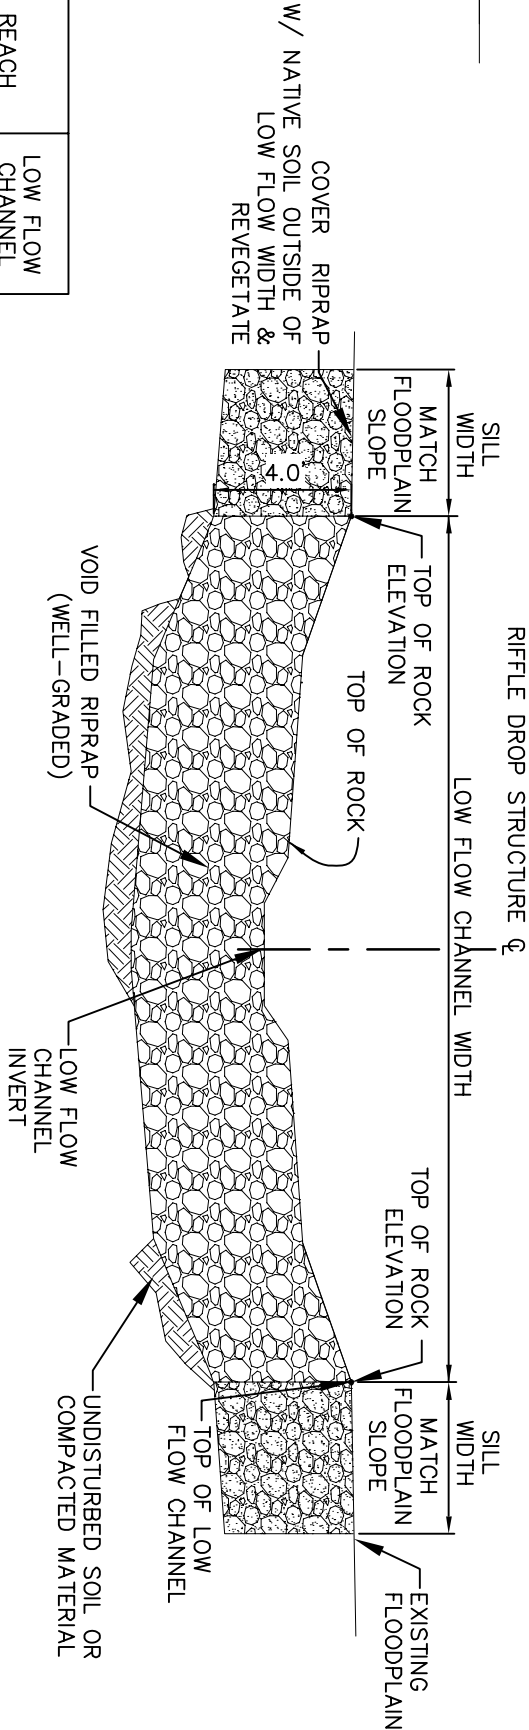

**B**

**RIFFLE DROP STRUCTURE SECTION**

NTS

**TYPICAL RIFFLE DROP STRUCTURE**  
**FOR USE IN NATURAL CHANNEL DESIGN REACHES**

NOT FOR CONSTRUCTION



2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920  
Phone 719-575-0100  
Fax 719-575-0208

NAME: S:\101222003 (Falcon DBPS)\DWG\XSEC-RCVME-R05seabld.dwg  
PLOT: Workx.ctb  
PLOT DATE: Tue Jun 18, 2013 11:49pm



★ IF ACCESS PRECLUDES LIVE WILLOW TRANSPLANTS LIVE STAKE AT 1.0' ON CENTER AROUND UPPER VANE ARM AND SILL.

POSITION AT PT AS APPLICABLE ACCORDING TO STRUCTURE LOCATION

GEOTEXTILE BLANKET

USE NATIVE CHANNEL BED MATERIAL FILL LEVEL W/ TOP OF VANE ARM AND SLOPING TO LOW FLOW WIDTH

EXCAVATE SCOUR POOL

SILL WIDTH 'A'

POSITION AT PC AS APPLICABLE ACCORDING TO STRUCTURE LOCATION


LIVE WILLOW ★ TRANSPLANTS ALONG SILL

BURIED SILL BOULDERS (TYP.)

PLACE SOIL AND SEED FILLED BURLAP SACKS ALONG SILL ARMS.

### PLAN VIEW

NTS

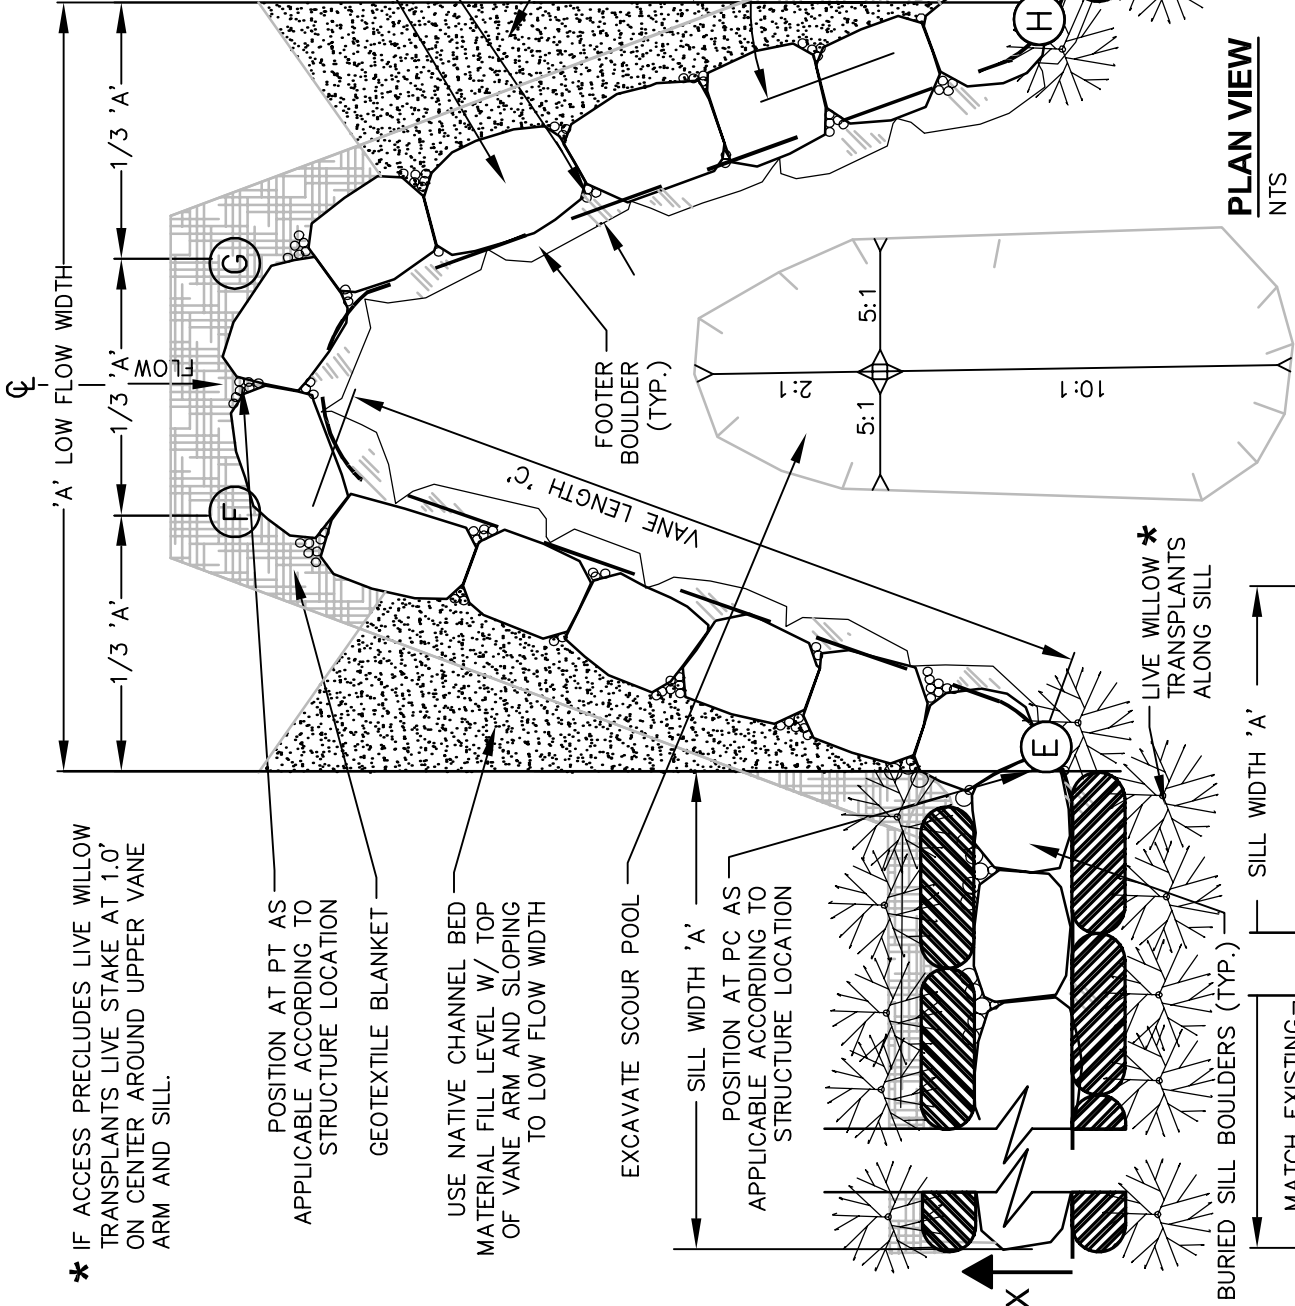


### NOTES:

- 1.) REACHES THAT ARE CURRENTLY DEGRADED MUST BE FILLED TO THE EXISTING FLOODPLAIN ELEVATION. THE ROCK CROSS VANE SHALL THEN BE CONSTRUCTED IN COMPACTED FILL MATERIAL.
- 2.) BOULDERS SHALL BE BLOCK SHAPED ACCORDING TO SPECIFICATIONS (NOT ANGULAR).
- 3.) SURFACE BOULDERS SHALL BE IN COMPRESSION W/ FOOTER BOULDERS IN THE DOWNSTREAM DIRECTION.

### NOTE:


- (E) AND (H) LOW FLOW FLOOD ELEVATION
- (F) AND (G) MARK VANE ELEVATION AT HEAD OF VANE

CONSTRUCTED ROCK CROSS VANE

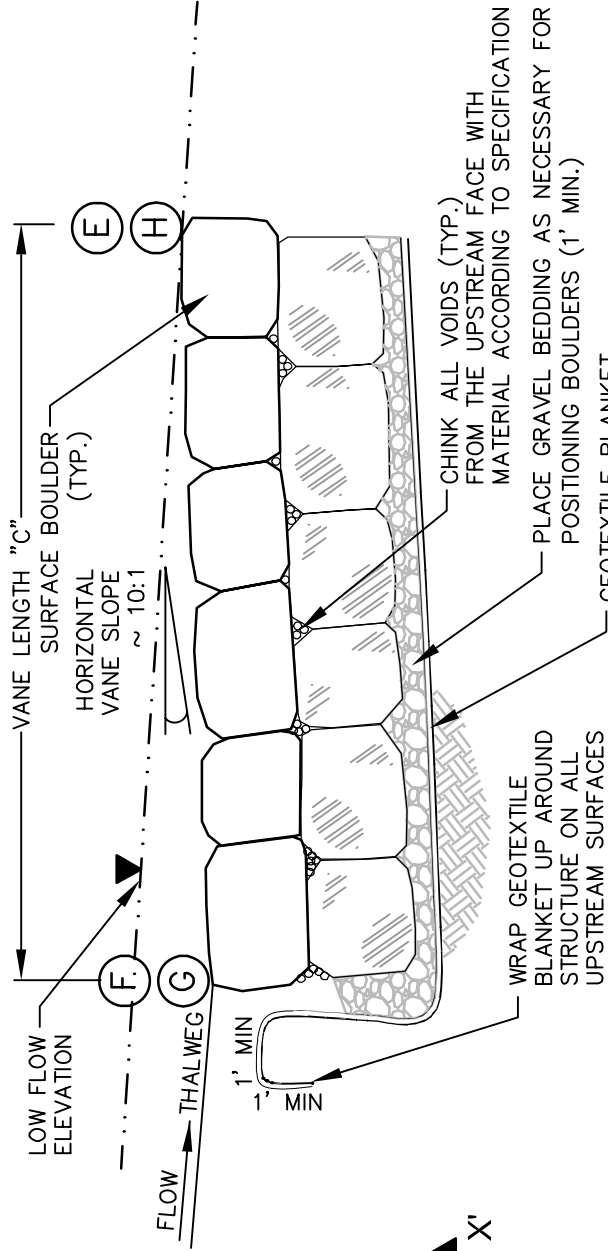

### CROSS VANE LONGITUDINAL PROFILE ALONG VANE

NTS

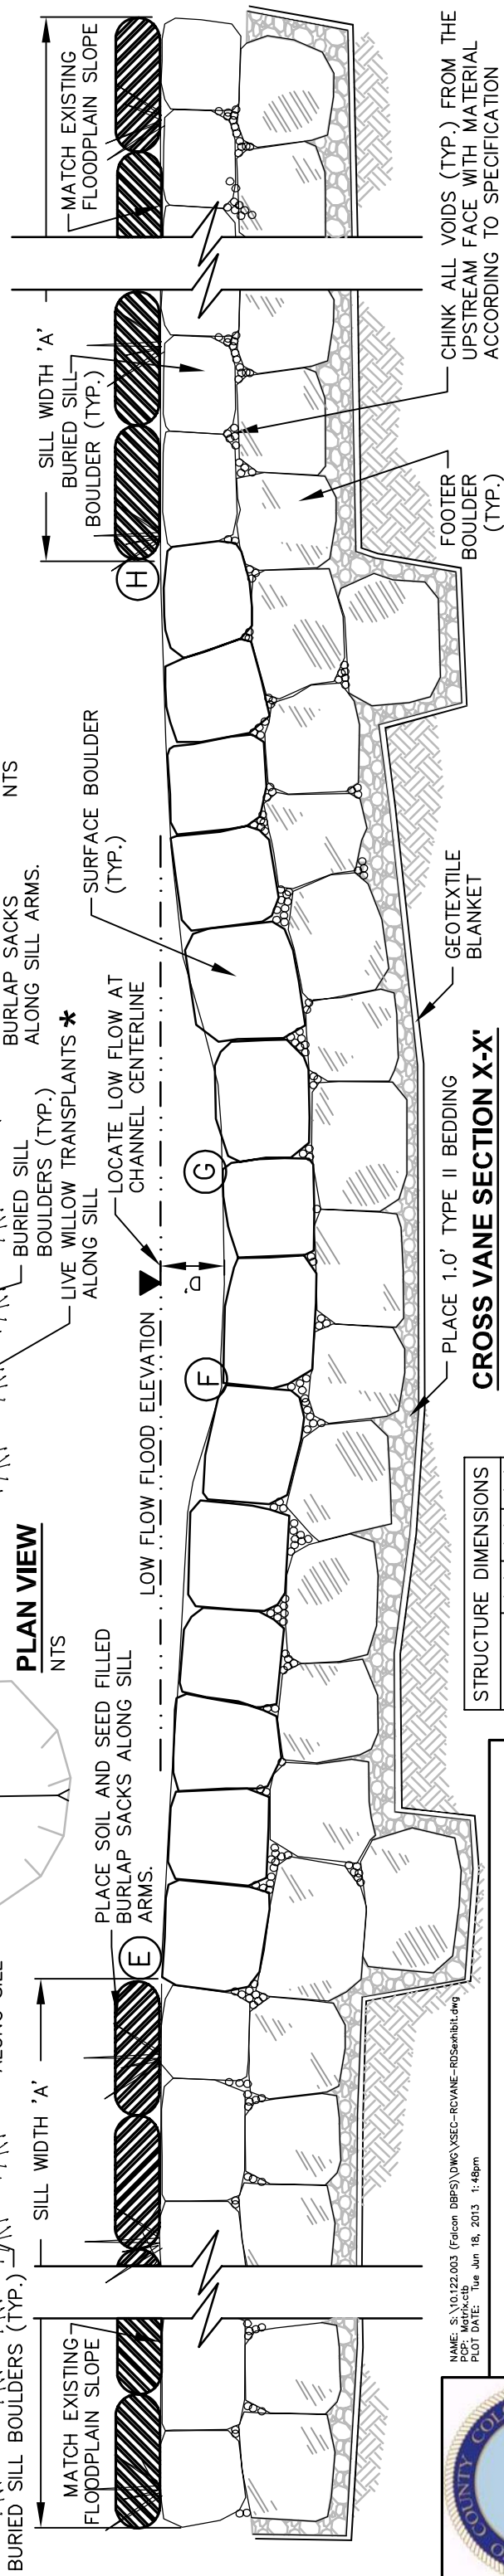

STRUCTURE DIMENSIONS				
REACH	'A'	'C'	'D'	
RET120	29'	26'	1.3'	
RET154	22'	20'	1.0'	
RWT150	18'	16'	0.8'	
RWT210	30'	26'	1.3'	

NAME: S:\10122.003 (Falcon DBPS)\DWG\XSEC-RCVANE-RDsexhibit.dwg  
PCP: Matrix.ctb  
PLOT DATE: Tue Jun 18, 2013 1:48pm



**Matrix**  
DESIGN GROUP

2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920  
Phone 719-575-0100  
Fax 719-575-0208

## TYPICAL ROCK CROSS VANE DETAILS

### FOR USE IN NATURAL CHANNEL DESIGN REACHES

NOT FOR CONSTRUCTION




EXISTING GRADE

FLOW

GROUTED SLOPING BOULDER  
DROP STRUCTURE

GROUTED SLOPING BOULDER  
DROP STRUCTURE

Profile

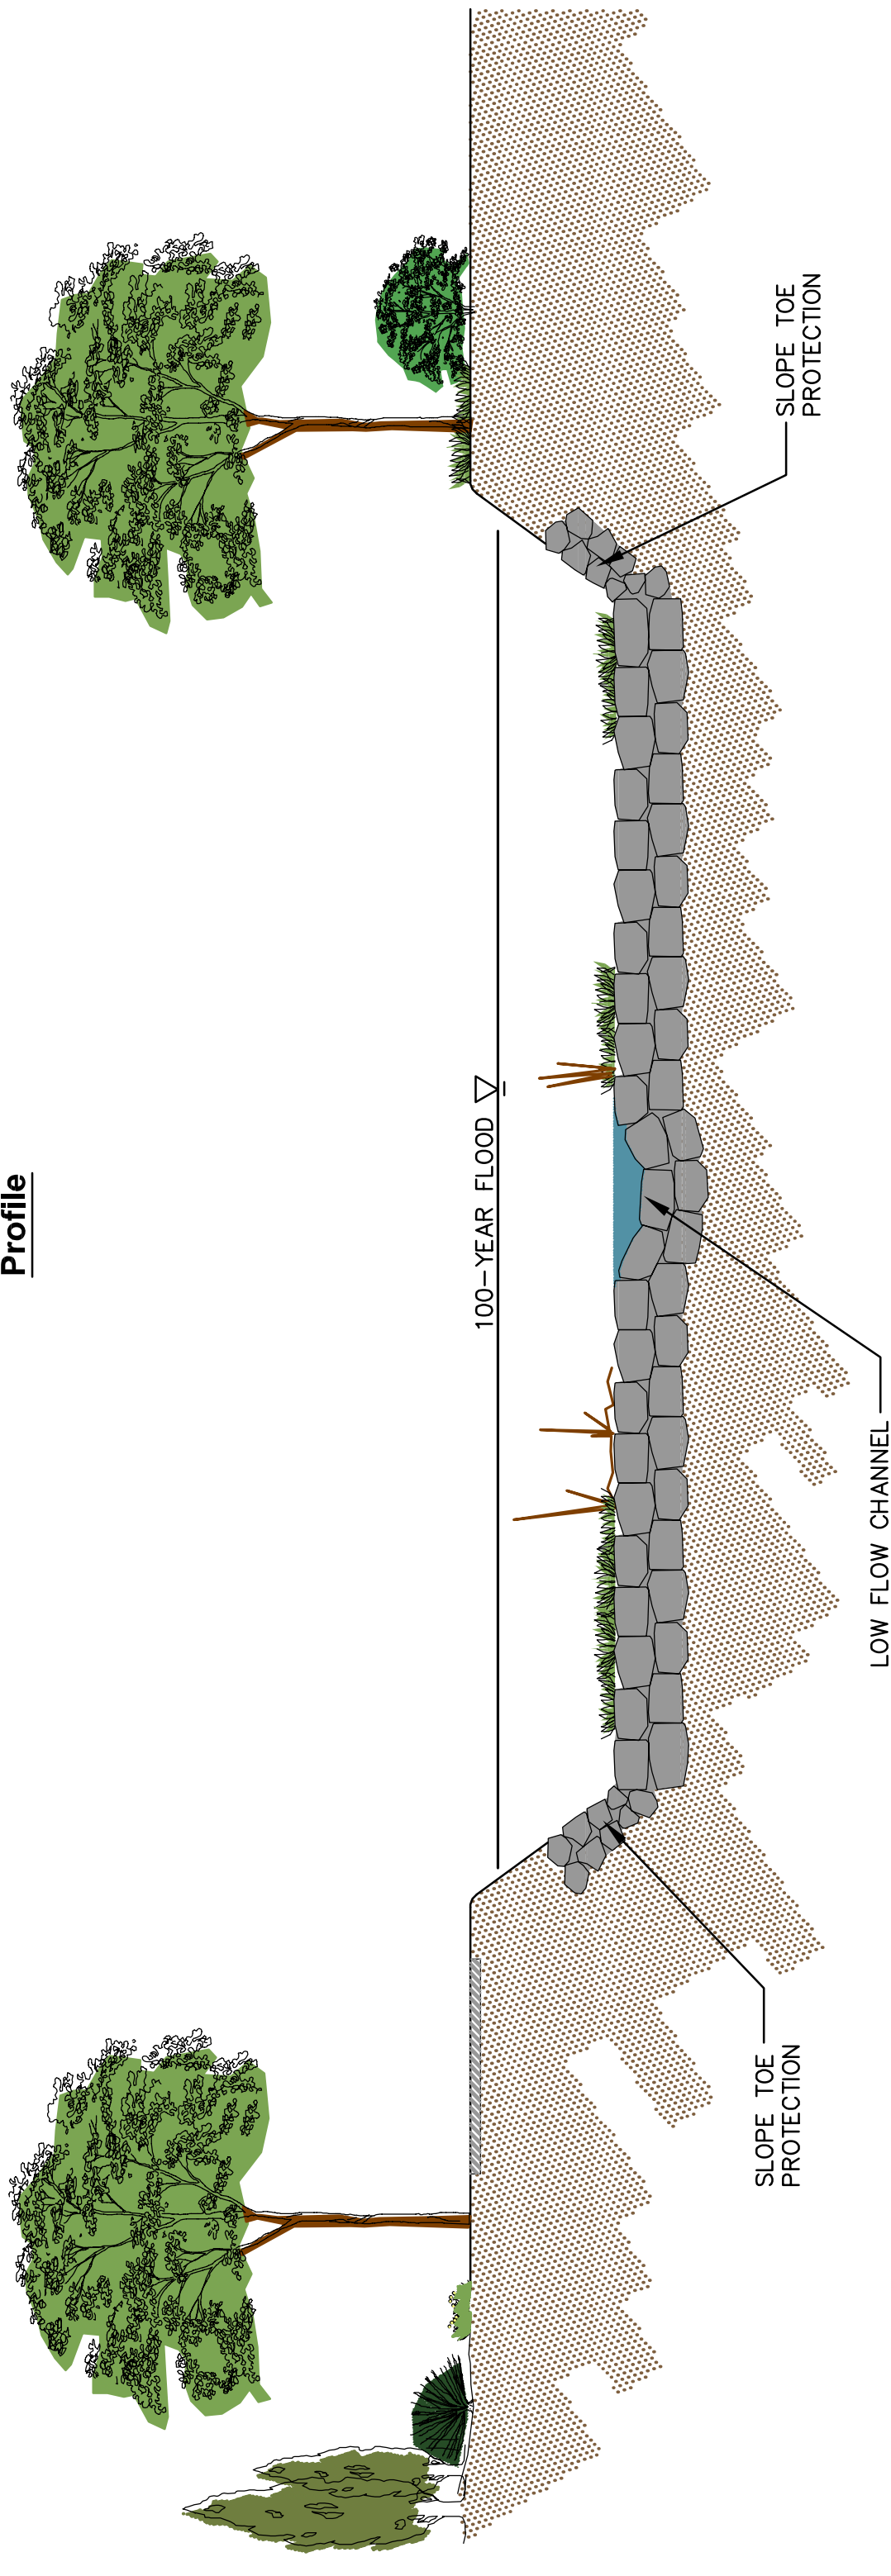

NAME: S:\10.122.003 (Falcon DBPS)\DMC\Channel\_sec-pro\_exhibit.dwg  
PCP: Matrix.ctb  
PLOT DATE: Wed Dec 21, 2011 3:03pm

Section

## Small Drop Structures with Toe Protection



2435 Research Parkway, Suite 300  
Colorado Springs, CO 80920  
Phone 719-575-0100  
Fax 719-575-0208



Figure 5-5