

FINAL DRAINAGE PLAN

LORSON RANCH EAST FILING NO. 1

MARCH 1, 2018

SF-18XXX

008

Prepared for:

Lorson, LLC
212 N. Wahsatch Ave, Suite 301
Colorado Springs, Colorado 80903
(719) 635-3200

Prepared by:

Core Engineering Group, LLC
15004 1ST Avenue South
Burnsville, MN 55306
(719) 570-1100

Project No. 100.042



CORE
ENGINEERING GROUP

TABLE OF CONTENTS

<i>ENGINEER'S STATEMENT</i>	1
<i>OWNER'S STATEMENT</i>	1
<i>FLOODPLAIN STATEMENT</i>	1
<i>1.0 LOCATION and DESCRIPTION</i>	2
<i>2.0 DRAINAGE CRITERIA</i>	2
<i>3.0 EXISTING HYDROLOGICAL CONDITIONS</i>	3
<i>4.0 DEVELOPED HYDROLOGICAL CONDITIONS</i>	4
<i>5.0 HYDRAULIC SUMMARY</i>	8
<i>6.0 DETENTION and WATER QUALITY PONDS</i>	20
<i>7.0 DRAINAGE and BRIDGE FEES</i>	22
<i>8.0 FOUR STEP PROCESS</i>	23
<i>9.0 CONCLUSIONS</i>	24
<i>10.0 REFERENCES</i>	24

APPENDIX A

VICINITY MAP, SCS SOILS INFORMATION, FEMA FIRM MAP

APPENDIX B

HYDROLOGY CALCULATIONS

APPENDIX C

HYDRAULIC CALCULATIONS

APPENDIX D

POND AND HYDRAFLOW CALCULATIONS

APPENDIX E

STORM SEWER SCHEMATIC and HYDRAFLOW STORM SEWER CALCS

BACK POCKET

EXISTING CONDITIONS DRAINAGE MAP – from Lorson East MDDP

OVERALL DEVELOPED CONDITIONS DRAINAGE MAP

DEVELOPED CONDITIONS DRAINAGE MAPS

POND C5 AND D2 FULL SPECTRUM OUTLET STRUCTURES

ENGINEER'S STATEMENT

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by El Paso County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.

Richard L. Schindler, P.E. #33997

Date

For and on Behalf of Core Engineering Group, LLC

OWNER'S STATEMENT

I, the Owner, have read and will comply with all the requirements specified in the drainage report and plan.

Lorson, LLC

Date

By
Jeff Mark

Title
Manager

Address
212 N. Wahsatch Avenue, Suite 301, Colorado Springs, CO 80903

FLOODPLAIN STATEMENT

To the best of my knowledge and belief, this development is located within a designated floodplain as shown on Flood Insurance Rate Map Panel No. 08041C0957 F and 08041C1000 F, dated March 17, 1997 and modified by modified per LOMR Case No. 14-08-0534P. (See Appendix A, FEMA FIRM Exhibit)

Richard L. Schindler, #33997

Date

EL PASO COUNTY

Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual, Volume 1 and 2, and Engineering Criteria Manual, As Amended.

Jennifer Irvine
County Engineer/ECM Administrator

Date

Conditions: _____

1.0 LOCATION and DESCRIPTION

Lorson Ranch East is located east of the East Tributary of Jimmy Camp Creek. The site is located on approximately 126.25 acres of vacant land. This project will develop this site into single-family residential developments. This plat does include a school site but it is offsite and is only platted as a tract of land. Future development of the school site will require it's own final drainage report. The land for the residential lots is currently owned by Lorson LLC or its nominees for Lorson Ranch.

The site is located in the West 1/2 of Sections 14 & 23, South 1/2 of Section 13, and the North 1/2 of Section 24, Township 15 South and Range 65 West of the 6th Principal Meridian. The property is bounded on the north by Fontaine Boulevard, on the east by Lamprey Drive, on the west by The East Tributary of Jimmy Camp Creek, and the south by Lorson Boulevard. For reference, a vicinity map is included in Appendix A of this report.

Address improvements north of Fontaine.

Conformance with applicable Drainage Basin Planning Studies

There is an existing (unapproved) DBPS for Jimmy Camp Creek prepared by Wilson & Company in 1987, and is referenced in this report. The only major drainage improvements for this study area according to the 1987 Wilson study was the reconstruction of the East Tributary of Jimmy Camp Creek (East Tributary). In 2014 a portion of the East Tributary was reconstructed from Fontaine Boulevard south 2,800 feet in accordance with the 1987 study. This section of the East Tributary included a trapezoidal channel section with 6:1 side slopes and a sand bottom. On March 9, 2015 a new DBPS for Jimmy Camp Creek and the East Tributary was completed by Kiowa Engineering. The Kiowa Engineering DBPS for Jimmy Camp Creek has not been adopted by El Paso County but is allowed for concept design. The concept design includes the East Tributary armoring concept and the full spectrum detention pond requirements. The Kiowa DBPS did not calculate drainage fees so current El Paso County drainage/bridge fees apply to this development. Channel improvements in the East Tributary within this final plat limits were constructed in 2014.

and PDR

south of Fontaine Blvd.

and PDR

Conformance with Lorson East MDDP by Core Engineering Group

Core Engineering Group has an approved MDDP for Lorson East which covers this final plat area and the East Tributary. This FDR conforms to the MDDP for Lorson East and is referenced in this report. The major infrastructure to be constructed in this PDR site includes the forebays for Detention/WQ Ponds C5 and D2. Ponds C5 and D2 were constructed in the Early Grading Plans for Lorson Ranch East under PUDSP-16-003.

graded (?)

final plat

Lorson Ranch East is located within the "**Jimmy Camp Creek Drainage Basin**", which is a fee basin in El Paso County.

address bridges

2.0 DRAINAGE CRITERIA

The supporting drainage design and calculations were performed in accordance with the City of Colorado Springs and El Paso County "Drainage Criteria Manual (DCM)", dated November, 1991, the El Paso County "Engineering Criteria Manual", Chapter 6 and Section 3.2.1 Chapter 13 of the City of Colorado Springs Drainage Criteria Manual dated May 2014, and the UDFCD "Urban Storm Drainage Criteria Manual" Volumes 1, 2 and 3 for inlet sizing and full spectrum ponds. No deviations from these published criteria are requested for this site.

The Rational Method as outlined in Section 6.3.0 of the May 2014 "Drainage Criteria Manual" and in Section 3.2.8.F of the El Paso County "Engineering Criteria Manual" was used for basins less than 130 acres to determine the rainfall and runoff conditions for the proposed development of the site. The runoff rates for the 5-year initial storm and 100-year major design storm were calculated.

Current updates to the Drainage Criteria manual for El Paso County states the if detention is necessary, Full Spectrum Detention will be included in the design, based on this criteria, Full Spectrum

Detention will be required for this development. The ponds were graded under PUDSP-16-003 and this plat will construct the forebays and outlet structure.

(prior to early grading)

3.0 EXISTING HYDROLOGICAL CONDITIONS

The site is currently undeveloped with native vegetation (grass with no shrubs) and moderate to steep slopes in a westerly direction the East Tributary of Jimmy Camp Creek.

The Soil Conservation Service (SCS) classifies the soils within the Lorson Ranch East property as Manzanola clay loam; Nelson-Tassel fine Sandy loam; Razor clay loam; and Wiley silt loam [3]. The sandy and silty loams are considered hydrologic soil group B soils with moderate to moderately rapid permeability. The Midway and Razor clay loams are considered hydrologic soil group C soils with slow permeability. All of these soils are susceptible to erosion by wind and water, have low bearing strength, moderate shrink-swell potential, and high frost heave potential (see table 3.1 below). The clay loams are difficult to vegetate and comprise of a small portion of the study area. These soils can be mitigated easily by limiting their use as topsoil since they comprise of a small portion of the study area. Weathered bedrock will be encountered beneath some of the site but it can be excavated using conventional techniques.

Table 3.1: SCS Soils Survey

Soil	Hydro. Group	Shrink/Swell Potential	Permeability	Surface Runoff Potential	Erosion Hazard
52-Manzanola Clay Loam	C	High	Slow	Medium	Moderate
56-Nelson – Tassel Fine Sandy Loam	B	Moderate	Moderately Rapid	Slow	Moderate
75-Razor Clay Loam	C	High	Slow	Medium	Moderate
108-Wiley Silt Loam	B	Moderate	Moderate	Medium	Moderate

Excerpts from the SCS “Soil Survey of El Paso County Area, Colorado” [2] are provided in **Appendix A** for further reference.

For the purpose of preparing hydrologic calculations for this report, the soil of each basin are assumed to be wholly comprised of the majority soil hydrologic group.

An existing electrical easement, within existing transmission towers, is adjacent to this site on the east side of this portion of the development and will be set aside as open space in the future. It is the intent of this drainage report to utilize some of the open space under the towers for detention of storm flows.

The FMIC (irrigation canal) that runs parallel with the East Tributary through this site was decommissioned in 2006 and will be filled in during the early grading process. For the purpose of existing drainage calculations the canal was ignored and all flow was assumed to flow to the East Tributary.

Portions of the site are located within the delineated 100-year floodplain of the East Tributary of Jimmy Camp Creek per the Federal Emergency Management Agency (FEMA) Flood Rate Insurance Map (FIRM) number 08041C0957 F & 08041C1000 F, effective 17 March 1997 [2]. Floodplain along the East Tributary was modified per LOMR Case No. 14-08-0534P (see appendix). Floodplain designations include Zone AE and Zone X within the property boundary. A portion of this map is provided in **Appendix A** for reference. A CLOMR for the creek and bridge construction which includes grading to remove some areas from the current floodplain is currently submitted to FEMA under Case No. 17-08-1043R.

north of Fontaine Blvd.

The existing basins for this large site were taken from the Lorson Ranch East MDDP East of the East Tributary. A map from the MDDP has been included in the appendix.

Overall Basin EX-C flows to Design Point 2

This is the largest existing basin at 452.97 acres which includes approximately the northern half of the site. This basin is an overall existing basin including Basins EX-C1 to EX-C10. There are two offsite basins (OS-C6.1 and OS-C5.1) which flow onto the site from the north and east and are included in the flow at Design Point 2. Under existing conditions, this basin contributes 141.0 cfs and 458.0 cfs for the 5-year and 100-year events respectively at Design Point 2. Design Point 2 is located at the East Tributary and all flow is routed to the East Tributary in an existing swale that is eroded and is not armored.

Overall Basin EX-D flows to Design Point 3

Overall Basin EX-D is located adjacent to and southwest of Basin Ex-C and is 109.55 acres in size. This basin is an overall existing on-site basin. The existing runoff of 29.7cfs and 166.5cfs for the 5-year and 100-year events at Design Point 3 respectively and flows directly overland into the East Tributary.

Address early grading and conditions when that is complete.

This report should pick up from there.

4.0 DEVELOPED HYDROLOGICAL CONDITIONS

Hydrology for the **Lorson Ranch East** drainage report was based on the City of Colorado Springs/El Paso County Drainage Criteria. Sub-basins that lie within this project were determined and the 5-year and 100-year peak discharges for the developed conditions have been presented in this report. Based on these flows, storm inlets will be added when the street capacity is exceeded.

Soil type C/D has been assumed for the hydrologic conditions because mass grading will occur and soil types will be moved around. This approach will provide a more conservative approach to designing the storm sewer infrastructure. See Appendix A for SCS Soils Map.

The time of concentration for each basin and sub-basin was developed using an overland, ditch, street and pipe flow components. The maximum overland flow length for developed conditions was limited to 100 feet. Travel time velocities ranged from 2 to 6 feet per second. The travel time calculations are included in the back of this report.

Runoff coefficients for the various land uses were obtained from the City of Colorado Springs/El Paso County Drainage Criteria Manual.

Add: "update (see

Appendix B)"

The hydrology analysis necessary for sizing the storm sewer system is preliminary only and will be finalized when the construction documents are prepared.

Drainage concepts for each of the basins are briefly discussed as follow:

This is the FDR!

Overall Basin C

Overall Basin C includes all of the "C" basins that drain to Pond C5. This basin was included to provide sizing data to design Pond C5 WQ and EURV in the full spectrum worksheets. The total size of this basin is 171 acres and comprises of residential development. There is runoff from a future school site which has been included for water quality in Pond C5. The future school site will be required to detain

Address interim condition offsite flows and future conditions.

and offsite undeveloped areas (EX1-EX3?)

runoff to existing flow rates to several storm outfall points provided on Lamprey Drive and Fontaine Boulevard. This basin has been studied in the Final Drainage Report for Fontaine Boulevard and is not included.

Overall Basin D

Overall Basin D includes all of the "D" basins that drain to Pond D2. This basin was included to provide sizing data to design Pond D2 in the full spectrum worksheets. The total size of this basin is 89 acres and comprises of residential development.

Address sub-basin D1-ex

Include

Basin C15.14 - See Fontaine FDR for this design.

These basins consist of runoff from residential development and Lamprey Drive. Runoff will be directed north to Design Point 29 in curb/gutter where it will be collected by a Type R inlet on Lamprey Drive. The developed flow from this basin is 2.9cfs and 6.4cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Include

Basin C15.15 - See Fontaine FDR for this design.

These basins consist of runoff from residential development and Lamprey Drive. Runoff will be directed north to Design Point 30 in curb/gutter where it will be collected by a Type R inlet on Lamprey Drive. The developed flow from this basin is 7.2cfs and 16.0cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.1

Basin C17.1 consists of residential development located in Weiser and Matta Drives. Runoff is directed northwest in curb/gutter to Design Point 38 to a proposed Type "R" inlet in Matta Drive. The peak developed flow from this basin is 5.9cfs and 13.2cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.1a

Basin C17.1a consists of residential development located in Weiser, Pigeon, and Aliso Drives. Runoff is directed north in curb/gutter to Design Point 28 to a proposed Type "R" inlet in Weiser Drive. The peak developed flow from this basin is 5.3cfs and 11.8cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.2

Basin C17.2 consists of residential development located in Chaplin, Pigeon, Aliso, and Matta Drives. Runoff is directed north in curb/gutter to Design Point 39 to a proposed Type "R" inlet in Matta Drive. The peak developed flow from this basin is 8.6cfs and 19.1cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.3

Basin C17.3 consists of residential development located in Lamine and Matta Drives. Runoff is directed north in curb/gutter to Design Point 40 to a proposed Type "R" inlet in Lamine Drive. The peak developed flow from this basin is 4.5cfs and 10.0cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.4

Basin C17.4 consists of residential development located in Matta Drive. Runoff is directed west in curb/gutter to Design Point 40 to a proposed Type "R" inlet in Lamine Drive. The peak developed flow from this basin is 3.2cfs and 7.1cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.5

Basin C17.5 consists of residential development and Fontaine Boulevard. Runoff is directed west in curb/gutter to Design Point 40 to a proposed Type "R" inlet in Lamine Drive. The peak developed flow

from this basin is 6.7cfs and 22.1cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.6

Basin C17.6 consists of residential development located in Lamine Drive. Runoff is directed north in curb/gutter to Design Point 41 to a proposed Type “R” inlet in Lamine Drive. The peak developed flow from this basin is 1.9cfs and 6.1cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.7

Basin C17.7 consists of backyards of houses on Lamine Drive, East Tributary, and open space. Runoff is directed overland to the East Tributary. See Section 6.0 for water quality discussions for backyards. See the appendix for detailed calculations.

Basin C17.8

Basin C17.8 consists of residential development and Fontaine Boulevard on the north side. Runoff is directed west in curb/gutter to Design Point 42 to a proposed Type “R” inlet in Fontaine Boulevard. The peak developed flow from this basin is 3.2cfs and 7.2cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin C17.9

Basin C17.9 consists of existing residential development in Meadows 3 and Fontaine Boulevard. Runoff is directed in curb/gutter to Design Point 47 to a proposed Type “R” inlet in Fontaine Boulevard on the south side. The peak developed flow from this basin is 7.8cfs and 13.9cfs for the 5/100-year storm event. See the appendix for detailed calculations. This basin will flow north to existing Pond B1. Pond B1 has been sized for this flow per the Pioneer Landing Filing No. 2 Final drainage report.

Basin C17.10

Basin C17.10 consists of existing residential development in Pioneer Landing and Fontaine Boulevard. Runoff is directed in curb/gutter to Design Point 48 to a proposed Type “R” inlet in Fontaine Boulevard on the north side. The peak developed flow from this basin is 8.9cfs and 16.0cfs for the 5/100-year storm event. See the appendix for detailed calculations. This basin will flow north to existing Pond B1. Pond B1 has been sized for this flow per the Pioneer Landing Filing No. 2 final drainage report.

Basin D1.1 & D1.2

Basin D1.1 & D1.2 consists of residential development, Saco Drive, Weiser Drive, and Lamprey Drive. Runoff is directed south and west in curb/gutter to Design Point 50 to a proposed Type “R” inlet in Saco Drive on the south side. See the appendix for detailed calculations.

provide flows

Basin D1.3

Basin D1.3 consists of residential development, Saco Drive, and Lamine Drive. Runoff is directed west and north in curb/gutter to Design Point 56 to a proposed Type “R” inlet in Lamine Drive. See the appendix for detailed calculations. The peak developed flow from this basin is 1.7cfs and 3.8cfs for the 5/100-year storm event.

Basin D1.4 & D1.5

Basin D1.4 & D1.5 consists of residential development. Runoff is directed south in curb/gutter to Design Point 52 in Chaplin Drive. See the appendix for detailed calculations.

provide flows

Basin D1.6

Basin D1.6 consists of residential development, Yuba Drive, and Chaplin Drive. Runoff is directed south and west in curb/gutter to Design Point 53 to a proposed Type “R” inlet in Yuba Drive. See the appendix for detailed calculations. The peak developed flow from this basin is 8.4cfs and 18.7cfs for the 5/100-year storm event.

Basin D1.7

Basin D1.7 consists of residential development and Lamine Drive. Runoff is directed south in curb/gutter to Design Point 54 in Lamine Drive. See the appendix for detailed calculations. The peak developed flow from this basin is 7.0cfs and 15.5cfs for the 5/100-year storm event.

Basin D1.8

Basin D1.8 consists of residential development, Chaplin Drive, and Yuba Drive. Runoff is directed south and west in curb/gutter to Design Point 53 in Yuba Drive. See the appendix for detailed calculations. The peak developed flow from this basin is 3.2cfs and 7.1cfs for the 5/100-year storm event.

Basin D1.9 & D1.10

Basin D1.9 & D1.10 consists of residential development, Saco Drive, Lamine Drive, and Yuba Drive. Runoff is directed west in curb/gutter to Design Point 55 in Lamine Drive. See the appendix for detailed calculations.

provide flows

Basin D1.11

Basin D1.11 consists of residential development and Lamine Drive. Runoff is directed south in curb/gutter to Design Point 56 to a proposed Type "R" inlet in Lamine Drive. See the appendix for detailed calculations. The peak developed flow from this basin is 2.6cfs and 5.8cfs for the 5/100-year storm event.

Basin D1.12

Basin D1.12 consists of residential development and Pond D2. Runoff is directly tributary to Pond D2. See the appendix for detailed calculations. The peak developed flow from this basin is 3.9 cfs and 15.4cfs for the 5/100-year storm event.

Address interim and future conditions flows and conveyances for each of the basins below.

Basin D2.1 & D2.3

Basin D2.1 & D2.3 consists of residential development, open space under the electric easement, Vedder Drive, Lamprey Drive, and Lorson Boulevard. Runoff is directed south and west in curb/gutter to Design Point 59d in Lamprey Drive. See the appendix for detailed calculations.

provide flows

Basin D2.2

Basin D2.2 consists of residential development and Tillamook Drive. Runoff is directed south in curb/gutter to Design Point 59a. See the appendix for detailed calculations. The peak developed flow from this basin is 2.1cfs and 4.7cfs for the 5/100-year storm event.

Basin D2.4

Basin D2.4 consists of residential development, Lorson Boulevard, and open space area under the electric easement. Runoff is directed west in curb/gutter in Lorson Boulevard to Design Point 59f. See the appendix for detailed calculations. The peak developed flow from this basin is 3.6cfs and 11.9cfs for the 5/100-year storm event.

Basin D2.5

Basin D2.5 consists of residential development, Skuna Drive, and Witcher Drive. Runoff is directed north in curb/gutter to Lorson Boulevard to Design Point 59f. See the appendix for detailed calculations. The peak developed flow from this basin is 8.8cfs and 19.6cfs for the 5/100-year storm event.

Basin D2.6 & D2.7

Basin D2.6 & D2.7 consists of residential development, Skuna Drive, Abita Drive, Witcher Drive, and Yocona Drive. Runoff is directed west in curb/gutter to Design Point 61 in Witcher Drive. See the appendix for detailed calculations.

Basin D2.8

Basin D2.8 consists of residential development, Volga Drive, and Witcher Drive. Runoff is directed west and south in curb/gutter to Design Point 62 in Volga Drive. The peak developed flow from this basin is 7.7cfs and 17.2cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin D2.9

Basin D2.9 consists of residential development, Volga Drive, Trappe Drive, and Witcher Drive. Runoff is directed west and north in curb/gutter to Design Point 60 in Trappe Drive. The peak developed flow from this basin is 5.5cfs and 12.2cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin D2.10

Basin D2.10 consists of Trappe Drive and adjacent areas. Runoff is directed north in curb/gutter in Trappe Drive to Design Point 64. See the appendix for detailed calculations. The peak developed flow from this basin is 1.9cfs and 5.0cfs for the 5/100-year storm event.

Basin D2.11

Basin D2.11 consists of runoff from Lorson Boulevard on the south side. Runoff is directed west in curb/gutter to Design Point 65a in Lorson Boulevard. The peak developed flow from this basin is 2.0cfs and 3.6cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin D2.12

Basin D2.12 consists of runoff from residential development and Lorson Boulevard on the south side. Runoff is directed west in curb/gutter to Design Point 60 in Trappe Drive. The peak developed flow from this basin is 5.4cfs and 12.0cfs for the 5/100-year storm event. See the appendix for detailed calculations.

Basin D2.13

Basin D2.13 consists of runoff from Lorson Boulevard on the north side. Runoff is directed west in curb/gutter to Design Point 65b in Lorson Boulevard. The peak developed flow from this basin is 4.0cfs and 9.0cfs for the 5/100-year storm event. See the appendix for detailed calculations.

See the Developed Conditions Hydrology Calculations in the back of this report and the Developed Conditions Drainage Map (Map Pocket) for the 5-year and 100-year storm event amounts.

5.0 HYDRAULIC SUMMARY

The sizing of the hydraulic structures and detentions ponds were prepared by using the *StormSewers* and *Hydrographs* computer software programs developed by Intellisolve, which conforms to the methods outlined in the "City of Colorado Springs/El Paso County Drainage Criteria Manual". Street capacities and Inlets were sized by Denver Urban Drainage's xcel spreadsheet UD-Inlet.

It is the intent of this drainage report to use the proposed curb/gutter and storm sewer in the streets to convey runoff to detention and water quality ponds then to the East Tributary of Jimmy Camp Creek. Inlet size and location are preliminary only as shown on the storm sewer layout in the appendix. See Appendix C for detailed hydraulic calculations and the storm sewer model.

Table 1: Street Capacities (100-year capacity is only ½ of street)

Street Slope	Residential Local		Residential Collector		Principal Arterial	
	5-year	100-year	5-year	100-year	5-year	100-year
0.5%	6.3	26.4	9.7	29.3	9.5	28.5
0.6%	6.9	28.9	10.6	32.1	10.4	31.2

0.7%	7.5	31.2	11.5	34.6	11.2	33.7
0.8%	8.0	33.4	12.3	37.0	12.0	36.0
0.9%	8.5	35.4	13.0	39.3	12.7	38.2
1.0%	9.0	37.3	13.7	41.4	13.4	40.2
1.4%	10.5	44.1	16.2	49.0	15.9	47.6
1.8%	12.0	45.4	18.4	50.4	18.0	50.4
2.2%	13.3	42.8	19.4	47.5	19.5	47.5
2.6%	14.4	40.7	18.5	45.1	18.5	45.1
3.0%	15.5	39.0	17.7	43.2	17.8	43.2
3.5%	16.7	37.2	16.9	41.3	17.0	41.3
4.0%	17.9	35.7	16.2	39.7	16.3	29.7
4.5%	19.0	34.5	15.7	38.3	15.7	38.3
5.0%	19.9	33.4	15.2	37.1	15.2	37.1

Note: all flows are in cfs (cubic feet per second)

It is the intent of this report to construct inlets on Fontaine Boulevard located at the ultimate 4-lane curb location so reconstruction of inlets will not be necessary when Fontaine is widened.

Design Point 28

Design Point 28 is located on Weiser Drive north of Pigeon Drive.

(5-year storm)

Tributary Basins: C17.1a

Upstream flowby:

Inlet/MH Number: Inlet DP28

Total Street Flow: 5.3cfs

Flow Intercepted: 5.3cfs

Inlet Size: 15' type R, on-grade

Flow Bypassed:

Street Capacity: Street slope = 1.0%, capacity = 9.0cfs, okay

(100-year storm)

Tributary Basins: C17.1a

Upstream flowby:

Inlet/MH Number: Inlet DP28

Total Street Flow: 11.56cfs

Flow Intercepted: 10.36cfs

Inlet Size: 15' type R, on-grade

Flow Bypassed: 1.2cfs to Inlet DP38

Street Capacity: Street slope = 1.0%, capacity = 37.3cfs (half street) is okay

Design Point 38

Design Point 38 is located in the SE corner of Chaplin Drive and Matta Drive.

(5-year storm)

Tributary Basins: C17.1

Upstream flowby:

Inlet/MH Number: Inlet DP38

Total Street Flow: 5.9cfs

Flow Intercepted: 5.9cfs

Inlet Size: 15' type R, on-grade

Flow Bypassed:

Street Capacity: Street slope = 1.0%, capacity = 9.0cfs is okay

(100-year storm)

Tributary Basins: C17.1

Upstream flowby: 1.2cfs

Inlet/MH Number: Inlet DP39

Total Street Flow: 14.43cfs

Flow Intercepted: 11.83cfs

Inlet Size: 15' type R, on-grade

Flow Bypassed: 2.6cfs to Inlet DP39

Street Capacity: Street slope = 1.0%, capacity = 37.3cfs (half street) is okay

Design Point 39

Design Point 39 is located in the SW corner of Chaplin Drive and Matta Drive.

(5-year storm)

Tributary Basins: C17.2

Upstream flowby:

Inlet/MH Number: Inlet DP39

Total Street Flow: 8.61cfs

Flow Intercepted: 8.41cfs

Inlet Size: 15' type R, on-grade

Flow Bypassed: 0.2cfs to Inlet DP40

Street Capacity: Street slope = 3.5%, capacity = 16.7cfs is okay

(100-year storm)

Tributary Basins: C17.2

Upstream flowby: 24.0cfs

Inlet/MH Number: Inlet DP39

Total Street Flow: 21.53cfs

Flow Intercepted: 14.93cfs

Inlet Size: 15' type R, on-grade

Flow Bypassed: 6.6cfs to Inlet DP40

Street Capacity: Street slope = 3.5%, capacity = 37.2cfs (half street) is okay

Design Point 50

Design Point 50 is located on the south side of Saco Drive just east of Willapa Drive.

(5-year storm)

Tributary Basins: D1.1 & D1.2
Upstream flowby:

Inlet/MH Number: Inlet DP50
Total Street Flow: 10.01cfs

Flow Intercepted: 7.34cfs
Inlet Size: 10' type R, on-grade

Flow Bypassed: 2.7cfs to DP56

Street Capacity: Street slope = 2.2%, capacity = 13.3cfs is okay

(100-year storm)

Tributary Basins: D1.1 & D1.2
Upstream flowby:

Inlet/MH Number: Inlet DP50
Total Street Flow: 22.27cfs

Flow Intercepted: 10.77cfs
Inlet Size: 10' type R, on-grade

Flow Bypassed: 11.5cfs to DP56

Street Capacity: Street slope = 2.2%, capacity = 42.8cfs (half street) is okay

Design Point 51

Design Point 51 is located downstream of Design Point 50 in Saco Drive just west of Willapa Drive and is the flow in the storm sewer. The total flow in the storm sewer (Line 3) is 14.68cfs/21.60cfs in the 5/100-year storm events in the storm sewer.

Design Point 52

Design Point 52 is located on the east side of Chaplin Drive north of Yuba Drive

(5-year storm)

Tributary Basins: D1.4+D1.5
Upstream flowby:

Inlet/MH Number: Inlet DP52
Total Street Flow: 15.44cfs

Flow Intercepted: 12.44cfs
Inlet Size: 15' type R, on-grade

Flow Bypassed: 3.0cfs to DP53

Street Capacity: Street slope = 3.8%, capacity = 16.9cfs is okay

(100-year storm)

Tributary Basins: D1.4+D1.5
Upstream flowby:

Inlet/MH Number: Inlet DP52
Total Street Flow: 34.7cfs

Flow Intercepted: 18.8cfs
Inlet Size: 15' type R, on-grade

Flow Bypassed: 15.9cfs to DP53

Street Capacity: Street slope = 3.8%, capacity = 36cfs (half street) is okay

Design Point 53

Design Point 53 is located at Chaplin Drive and Yuba Drive on the north side of the street.

(5-year storm)

Tributary Basins: D1.6, D1.8
Upstream flowby: 3.0cfs

Inlet/MH Number: Inlet DP53
Total Street Flow: 14.65cfs

Flow Intercepted: 14.05cfs
Inlet Size: 20' type R, on-grade

Flow Bypassed: 0.6cfs to DP-55

Street Capacity: Street slope = 3.5%, capacity = 16.7cfs, okay

(100-year storm)

Tributary Basins: D1.6, D1.8
Upstream flowby: 15.9cfs

Inlet/MH Number: Inlet DP53
Total Street Flow: 41.47cfs

Flow Intercepted: 25.97cfs
Inlet Size: 20' type R, on-grade

Flow Bypassed: 15.50cfs to DP55

Street Capacity: Street slope = 3.5%, capacity = 37.2cfs (half street) flow tops crown

Design Point 54

Design Point 54 is located at Lamine Drive and Yuba Drive on the northeast corner

(5-year storm)

Tributary Basins: D1.7
Upstream flowby:

Inlet/MH Number: Inlet DP54
Total Street Flow: 7.26cfs

Flow Intercepted: 7.26cfs
Inlet Size: 15' type R, on-grade

Flow Bypassed:

Street Capacity: Street slope = 1.2%, capacity = 10 cfs, okay

(100-year storm)

Tributary Basins: D1.7
Upstream flowby:

Inlet/MH Number: Inlet DP54
Total Street Flow: 15.5cfs

Flow Intercepted: 12.6cfs
Inlet Size: 15' type R, on-grade

Flow Bypassed: 3.0cfs to DP55

Street Capacity: Street slope = 1.2%, capacity = 37cfs (half street)

Design Point 55a

Design Point 55a is located on the north side of Saco Drive west of Willapa Drive

(5-year storm)

Tributary Basins: D1.10

Upstream flowby:

Inlet/MH Number: Inlet DP55a

Total Street Flow: 10.18cfs

Flow Intercepted: 7.38cfs

Inlet Size: 10' type R, on-grade

Flow Bypassed: 2.8cfs to DP55

Street Capacity: Street slope = 2.5%, capacity = 14.0cfs, okay

(100-year storm)

Tributary Basins: D1.10

Upstream flowby:

Inlet/MH Number: Inlet DP55a

Total Street Flow: 22.63cfs

Flow Intercepted: 10.83cfs

Inlet Size: 10' type R, on-grade

Flow Bypassed: 11.80cfs to DP55

Street Capacity: Street slope = 2.5%, capacity = 40.0cfs (half street) is okay

Design Point 55

Design Point 55 is located on the east side of Lamine Drive at a low point south of Yuba Drive.

(5-year storm)

Tributary Basins: D1.9

Upstream flowby: 3.7cfs

Inlet/MH Number: Inlet DP55

Total Street Flow: 7.8cfs

Flow Intercepted: 7.8cfs

Inlet Size: 25' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 1.9%, capacity = 12.0cfs, okay

(100-year storm)

Tributary Basins: D1.9

Upstream flowby: 30.8cfs

Inlet/MH Number: Inlet DP55

Total Street Flow: 40.0cfs

Flow Intercepted: 31.7cfs

Inlet Size: 25' type R, sump

Flow Bypassed: 8.3cfs to Inlet DP56

Street Capacity: Street slope = 1.9%, capacity = 45cfs (half street) is okay

Design Point 56

Design Point 56 is located on the west side of Lamine Drive at a low point south of Yuba Drive..

(5-year storm)

Tributary Basins: D1.11

Upstream flowby: 2.7cfs

Inlet/MH Number: Inlet DP56

Total Street Flow: 7.2cfs

Flow Intercepted: 7.2cfs

Inlet Size: 25' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 1.9%, capacity = 12.0cfs, okay

(100-year storm)

Tributary Basins: D1.11

Upstream flowby: 19.8cfs

Inlet/MH Number: Inlet DP56

Total Street Flow: 29.7cfs

Flow Intercepted: 29.7cfs

Inlet Size: 25' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 1.9%, capacity = 45cfs (half street) is okay

The trapezoidal overflow swale between the lots is sized for 150cfs, 2.0' deep, 4:1 side slopes, 8' wide bottom, 2% slope, velocity of 8.38cfs, and has a flow depth of 1.34 feet.

Design Point 57

Design Point 57 is located in a low point in Lamine Drive south of Yuba and is the flow in the pipe to Pond D2 from Lamine Drive. The total pipe flow is 63.6cfs/122cfs in the 5/100 year storm events.

Design Point 58

Design Point 58 is the total flow into Pond D2. The total pond inflow is 118.2cfs/277.1cfs in the 5/100-year storm events taken from the full spectrum worksheets.

Design Point 58a

Design Point 58a flow is from Pond D2 which is modeled in the full spectrum excel worksheets. The release rates are directly from the spreadsheet and are less than the existing. There are no ponds in series for this basin. The total pond out flow is 12.5cfs/132.cfs in the 5/100-year storm events from the full spectrum excel worksheets and complies with discharge similar to existing conditions. See Pond D2 for more information.

Design Point 59a

Design Point 59a is located at the south end of future Tillamook Drive in a cul-de-sac

(5-year storm)

Tributary Basins: D2.2
Upstream flowby:

Inlet/MH Number: Inlet DP59a
Total Street Flow: 2.2cfs

Flow Intercepted: 2.2cfs
Inlet Size: 5' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 1.0%, capacity = 9.0cfs, okay

(100-year storm)

Tributary Basins: D2.2
Upstream flowby:

Inlet/MH Number: Inlet DP59a
Total Street Flow: 4.8cfs

Flow Intercepted: 4.8cfs
Inlet Size: 5' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 1.0%, capacity = 37.3cfs (half street) is okay

Design Point 59b

Design Point 59b is located south of Lorson Boulevard under the electric easement and is the flow in the pipe from future Basin D1. The total future pipe flow (Line 27) is 23cfs/60cfs in the 5/100-year storm events.

Design Point 59c

Design Point 59c is located east of Lorson Boulevard and Lamprey Drive and is the flow in the pipe to Design Point 59e. The total pipe flow is 25.7cfs/75.4cfs in the 5/100 year storm events.

Design Point 59d

Design Point 59d is located in the northeast corner of Lorson Boulevard and Lamprey Drive.

(5-year storm)

Tributary Basins: D2.1 & D2.3
Upstream flowby:

Inlet/MH Number: Inlet DP59d
Total Street Flow: 10.7cfs

Flow Intercepted: 10.7cfs
Inlet Size: 15' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 0.7%, capacity = 11.5cfs, okay

(100-year storm)

Tributary Basins: D2.1 & D2.3
Upstream flowby:

Inlet/MH Number: Inlet DP59d
Total Street Flow: 23.7cfs

Flow Intercepted: 20.3cfs
Inlet Size: 15' type R, sump

Flow Bypassed: 3.7cfs to Inlet DP65b

Street Capacity: Street slope = 0.7%, capacity = 34.6cfs (half street) is okay

Design Point 59e

Design Point 59e is located west of Lorson Boulevard and Lamprey Drive and is the flow in the pipe (Line 24) in Lorson Boulevard flowing west to Trappe Drive. The total pipe flow is 36.4cfs/93.2cfs in the 5/100 year storm events.

Design Point 59f

Design Point 59f is located at the SW corner of Lorson Boulevard and Skuna Drive.

(5-year storm)

Tributary Basins: D2.4 & D2.5
Upstream flowby:

Inlet/MH Number: Inlet DP59f
Total Street Flow: 13.68cfs

Flow Intercepted: 8.58cfs
Inlet Size: 10' type R, on-grade

Flow Bypassed: 5.1cfs to Inlet DP60

Street Capacity: Street slope = 1.9%, capacity Lorson Blvd.= 18.4cfs, okay

(100-year storm)

Tributary Basins: D2.4 & D2.5
Upstream flowby:

Inlet/MH Number: Inlet DP59f
Total Street Flow: 30.47cfs

Flow Intercepted: 12.37cfs
Inlet Size: 10' type R, on-grade

Flow Bypassed: 18.1cfs to Inlet DP60

Street Capacity: Street slope = 1.9%, capacity Lorson Blvd. = 50.4cfs (half street) is okay

Design Point 59g

Design Point 59g is located on Lorson Boulevard west of Skuna Drive and is the flow in the pipe (Line 23) in Lorson Boulevard flowing west to Trappe Drive. The total pipe flow is 45.0cfs/104.2cfs in the 5/100 year storm events.

Design Point 60

Design Point 60 is located in the SE corner of Lorson Boulevard and Trappe Drive

(5-year storm)

Tributary Basins: D2.9, D2.12
Upstream flowby: 5.1cfs

Inlet/MH Number: Inlet DP60
Total Street Flow: 15.8cfs

Flow Intercepted: 15.8cfs
Inlet Size: 25' type R, sump

Flow Bypassed:

Street Capacity: Street slope = 1.8%, capacity = 18.4cfs, okay

(100-year storm)

Tributary Basins: D2.9, D2.12
Upstream flowby: 32.1cfs

Inlet/MH Number: Inlet DP60
Total Street Flow: 55.9cfs

Flow Intercepted: 31.7cfs
Inlet Size: 25' type R, sump

Flow Bypassed: 24.2cfs to Design Point 64

Street Capacity: Street slope = 1.8%, capacity = 50.4cfs (half street) is okay since half is from Lorson Blvd and half is from Trappe Drive.

Design Point 61

Design Point 61 is located on Witcher Drive just west of Yocona Drive.

<u>(5-year storm)</u>	
Tributary Basins: D2.6 & D2.7	Inlet/MH Number: Inlet DP61
Upstream flowby:	Total Street Flow: 10.57cfs
Flow Intercepted: 7.57cfs	Flow Bypassed: 3.0cfs to Design Point 62
Inlet Size: 10' type R, on-grade	
Street Capacity: Street slope = 3.1%, capacity = 15.5cfs, okay	
<u>(100-year storm)</u>	
Tributary Basins: D2.6 & D2.7	Inlet/MH Number: Inlet DP61
Upstream flowby:	Total Street Flow: 23.68cfs
Flow Intercepted: 11.07cfs	Flow Bypassed: 12.6cfs to Design Point 62
Inlet Size: 10' type R, on-grade	
Street Capacity: Street slope = 3.1%, capacity = 39.0cfs (half street) is okay	

Design Point 62

Design Point 62 is located on the east side of Volga Drive at Magothy Drive.

<u>(5-year storm)</u>	
Tributary Basins: D2.8	Inlet/MH Number: Inlet DP62
Upstream flowby:	Total Street Flow: 10.1cfs
Flow Intercepted: 10.1cfs	Flow Bypassed:
Inlet Size: 10' type R, sump	
Street Capacity: Street slope = 1.0%, capacity = 9.0cfs, okay	
<u>(100-year storm)</u>	
Tributary Basins: D2.8	Inlet/MH Number: Inlet DP62
Upstream flowby:	Total Street Flow: 30.3cfs
Flow Intercepted: 16.3cfs	Flow Bypassed: 14.0cfs to Design Point 60
Inlet Size: 10' type R, sump	
Street Capacity: Street slope = 1.0%, capacity = 37.3cfs (half street) is okay	

Design Point 63

Design Point 63 is located in the SE corner of Magothy Drive and Volga Drive and is the flow in the pipe (Line 35) in Magothy Drive flowing west to Trappe Drive. The total pipe flow is 17.67cfs/27.38cfs in the 5/100 year storm events.

Design Point 64

Design Point 64 is located in the SW corner of Lorson Boulevard and Trappe Drive

<u>(5-year storm)</u>	
Tributary Basins: D2.10	Inlet/MH Number: Inlet DP64
Upstream flowby:	Total Street Flow: 3.2cfs
Flow Intercepted: 3.2cfs	Flow Bypassed:
Inlet Size: 25' type R, sump	
Street Capacity: Street slope = 1.8%, capacity = 18.4cfs, okay	
<u>(100-year storm)</u>	
Tributary Basins: D2.10	Inlet/MH Number: Inlet DP64
Upstream flowby: 24.2cfs	Total Street Flow: 29.2cfs
Flow Intercepted: 29.2cfs	Flow Bypassed:
Inlet Size: 25' type R, sump	
Street Capacity: Street slope = 1.8%, capacity = 50.4cfs, okay	

Design Point 65

Design Point 65 is located at the SW corner of Lorson Boulevard and Trappe Drive and is the flow in the pipe north (Line 30) to Design Point 65c. The total pipe flow is 36.60cfs/88.3cfs in the 5/100 year storm events.

Design Point 65a

Design Point 65a is located on the south side of Lorson Boulevard west of Trappe Drive

<u>(5-year storm)</u>	
Tributary Basins: D2.11	Inlet/MH Number: Inlet DP65a
Upstream flowby:	Total Street Flow: 2.0cfs
Flow Intercepted: 2.0cfs	Flow Bypassed:
Inlet Size: 5' type R, sump	
Street Capacity: Street slope = 0.66%, capacity = 10.6 cfs, okay	
<u>(100-year storm)</u>	
Tributary Basins: D2.11	Inlet/MH Number: Inlet DP65a
Upstream flowby:	Total Street Flow: 3.6cfs
Flow Intercepted: 3.6cfs	Flow Bypassed:
Inlet Size: 5' type R, sump	
Street Capacity: Street slope = 0.66%, capacity = 32.1cfs (half street) is okay	

Design Point 65b

Design Point 65b is located on the north side of Lorson Boulevard west of Trappe Drive

<u>(5-year storm)</u>	
Tributary Basins: D2.13	Inlet/MH Number: Inlet DP65b
Upstream flowby:	Total Street Flow: 4.2cfs
Flow Intercepted: 4.2cfs	Flow Bypassed:
Inlet Size: 5' type R, sump	
Street Capacity: Street slope = 0.66%, capacity = 10.6cfs, okay	
<u>(100-year storm)</u>	
Tributary Basins: D2.13	Inlet/MH Number: Inlet DP65b
Upstream flowby: 3.7cfs	Total Street Flow: 12.7cfs
Flow Intercepted: 12.7cfs	Flow Bypassed:
Inlet Size: 5' type R, sump	
Street Capacity: Street slope = 0.66%, capacity = 32.1cfs (half street) is okay	

Design Point 65c

Design Point 65c is located west of Lorson Boulevard and Trappe Drive and is the flow in the pipe (Line 17) north to Pond D2. The total pipe flow is 88.3cfs/174.2cfs in the 5/100 year storm events.

Design Point 70 and 71

Design Point 70 is located on the north side of Lorson Boulevard east of Stingray Lane. Flow at this design point is half of Basin B7.1 which was taken from the Meadows No. 3 final drainage report. The flow captured in the 10' type R inlets is 9.3cfs/19.1cfs in the 5/100 year storm events. This amount was rounded up to 10cfs/20cfs in the 5/100yr storm events. Each inlet will capture half of the total flow.

Design Point 72

Design Point 72 is located on Lorson Boulevard west of Stingray Lane and is the flow in the pipe. The total pipe flow is 10cfs/20cfs in the 5/100 year storm events which matches the allowable flow rate per the Meadows Filing No. 3 final drainage report. Water quality and detention for this basin was also provided by The Meadows Filing No. 3 final drainage report.

This needs to be designed and modeled completely for the interim condition. Provide calculations for both interim (Filing 1 plus undeveloped offsite) and ultimate conditions.

6.0 DETENTION AND WATER QUALITY PONDS

Detention and Storm Water Quality for Lorson Ranch East is required per El Paso County criteria. We have implemented the Full Spectrum approach for detention for Lorson Ranch East per the Denver Urban Drainage Districts specifications. There are two permanent full spectrum ponds proposed for this development. The two full spectrum ponds (Pond C5 and Pond D2) and one interim pond (Interim Pond E2) incorporate storm water quality features and comply with the Lorson Ranch East MDDP. These two ponds have been sized, graded, access roads, outlet pipes, overflow structures are provided with the Lorson Ranch East Early Grading. This final drainage report provides design information for the construction drawings on the outlet structure, trickle channel, and the forebays.

Full Spectrum Pond Construction Requirements

Design calculations for full spectrum Ponds C5 and D2 are included in this report. Rough grading of the ponds is shown on the Early Grading plans for Lorson Ranch East at this time in the Preliminary Plan submittal. The final design will include a 10' wide gravel access road on a 15' wide bench at a maximum 10% slope to the pond bottom. The final design of the full spectrum ponds consists of an outlet structure, storm sewer outfall to the East Tributary, concrete low flow channels, sediment forebays, and overflow weirs to the East Tributary. Soil borings, embankment, slope, and compaction requirements for detention ponds can be found in the geotechnical report for the Lorson Ranch East prepared by RMG.

Is this pond really necessary for Filing 1? Include details in report if so.

Detention Pond C5 (Full Spectrum and Hydraflow Design)

This is an on-site permanent full spectrum detention pond that includes water quality and discharges directly into the East Tributary. Pond C5 is designed in the UDCF Full Spectrum spreadsheets for Water Quality and EURV volumes only. The 5-year and 100-year flow rates are taken from the Lorson East MDDP and have been modeled in a hydraulic modeling software. See MDDP (Table 6.2) for pre/post development release rates into the East Tributary at this location. Pond C5 is required to release runoff (5-yr/100-yr) so it closely mimics the pre-developed flow rates into the East Tributary. The outlet structure is a triple CDOT type D outlet in parallel and the overflow spillway is a wier set slightly above the outlet structure so it releases the 5yr/100yr storm events quickly to match pre-developed rates. The full spectrum print outs are in the appendix of this report. See map in appendix for watershed areas.

Provide undeveloped/developed area for interim condiiton.

- Watershed Ares: 171 acres
- Watershed Imperviousness: 63%
- Hydrologic Soils Group C/D
- Forebay: 3.51ac-ft (see spreadsheet in appendix) divided between two forebays
- Zone 1 WQCV: 3.298ac-ft, WSEL: 5709.92
- Zone 2 EURV: 9.524ac-ft, WSEL: 5712.27, Top outlet structure set at 5712.60, 3'x18' triple CDOT Type D outlets in parallel.
- (5-yr): 13.06ac-ft, WSEL: 5713.49, 126.3cfs (hydraflow)
- Zone 3 (100-yr): 15.86ac-ft, WSEL: 5714.42, 453.2cfs (hydraflow)
- Pipe Outlet: 48" RCP at 0.5%
- Overflow Spillway: 52' wide bottom, elevation=5713, 4:1 side slopes, flow depth=2.0' at 519cfs inflow, 1' freeboard
- Pre-development release rate into East Tributary=141cfs/458cfs in the 5yr/100 yr storm at this pond outfall (Design Pt. 2, Table 6.2 in MDDP). See Design Point 46 for discussion on flows in creek from this pond
- Pond Bottom Elevation: 5706.00

Design: Composite, WQ/EURV by Full Spectrum Excel Worksheets, 5/100yr by Hydraflow

	WQ	EURV	5-yr	100-yr
Peak Inflow	63.1cfs	181.4cfs	167.5cfs	519.1cfs
Peak Outflow	1.4cfs	7.3cfs	126.3cfs	453.2cfs
Ponding Depth	3.92ft	6.27ft	7.49ft	8.42ft
Stored Volume	3.29ac-ft	9.52ac-ft	13.01ac-ft	15.86ac-ft
Spillway Stage	7.00ft, 52' wide			
Structure Type:	3'x18' flat top outlet structure (cdot type d) with top at stage 6.60ft			

? Explain.

Detention Pond D2 (Full Spectrum Design)

This is an on-site permanent full spectrum detention pond that includes water quality and discharges directly into the East Tributary. Pond D2 is designed using only the UDCF Full Spectrum spreadsheets and does not include any upstream pond flows. The outlet structure is a standard 4'x20' full spectrum sloped outlet structure and the overflow spillway is a weir set above the outlet structure designed by the full spectrum spreadsheets to match pre-developed rates. The full spectrum print outs are in the appendix of this report. See map in appendix for watershed areas.

- Watershed Ares: 89 acres
- Watershed Imperviousness: 55%
- Hydrologic Soils Group C/D
- Forebay: 1.635ac-ft (see spreadsheet in appendix) divided between two forebays
- Zone 1 WQCV: 1.53ac-ft, WSEL: 5697.52
- Zone 2 EURV: 3.95ac-ft, WSEL: 5699.14, Top EURV set at 5699.60, 4'x20' outlet with 10:1 slope, 8.9cfs
- (5-yr): 5.13ac-ft, WSEL: 5699.81, 12.5cfs
- Zone 3 (100-yr): 8.73ac-ft, WSEL: 5701.68, 132cfs
- Pipe Outlet: 54" RCP at 0.5% with no restrictor plate
- Overflow Spillway: 30' wide bottom, elevation=5702.00, 4:1 side slopes, flow depth=1.64' at 277.1cfs
- Pre-development release rate into creek compliance from full spectrum pond spreadsheets
- Pond Bottom Elevation: 5695.00

Provide interim and ultimate modeling and narrative.

Design: Full Spectrum Excel Worksheets Only

	WQ	EURV	5-yr	100-yr
Peak Inflow	32.1cfs	90.1cfs	118.2cfs	277.1cfs
Peak Outflow	0.6cfs	8.9cfs	12.6cfs	132cfs
Ponding Depth	2.73ft	4.14ft	4.81ft	6.68ft
Stored Volume	1.53ac-ft	3.95ac-ft	5.13ac-ft	8.73ac-ft
Spillway Stage	7.00ft, 30' wide			
Structure Type:	4'x20' outlet structure with 10:1 slopes. Top at stage 6.60ft			

Is this buffer to be constructed and maintained in accordance with DCM2?

Water Quality Design

Water quality will be provided by the two permanent extended detention basins for 98.42% of the 126.25-acre site. Approximately 1.58% of the total 126.25-acre final plat area consists of backyards that drain directly to the East Tributary over a grass buffer. Final platting of these areas includes a deviation from county criteria and a grass buffer bmp. Water Quality for the “C” and “D” basins is provided by the two on-site full spectrum ponds Pond C5 and Pond D2.

7.0 DRAINAGE AND BRIDGE FEES

Lorson Ranch East is located within the Jimmy Camp Creek drainage basin which is currently a fee basin in El Paso County. Current El Paso County regulations require drainage and bridge fees to be paid for platting of land as part of the plat recordation process.

Lorson Ranch Metro District will compile and submit to the county on a yearly basis the Drainage and bridge fees for the approved plats, and shall show all credits they have received for the same yearly time frame.

Lorson East Filing No. 1 contains 126.25 acres. The 126.25 acres will be assessed Drainage, Bridge and Surety fees. The 2018 drainage fees are \$17,197, bridge fees are \$804 and Drainage Surety fees are \$7,285 per impervious acre per Resolution 17-348. The drainage and bridge fees are calculated when the final plat is submitted. The fees are due at plat recordation. The following table details the drainage fees for the platted area.

re-calculate

Table 1: Drainage/Bridge Fees

Type of Land Use	Total Area (ac)	Imperviousness	Drainage Fee	Bridge Fee	Surety Fee
Residential Area	99.51	55%	\$941,200	\$44,003	\$398,711
Open Space, Landscape Tracts, Detention Ponds, Jimmy Camp Creek	26.74	2%	\$9,196	\$430	\$3,896
Total			\$950,396	\$44,433	\$402,607

Table 7.1: Public Drainage Facility Costs (non-reimbursable)

Item	Quantity	Unit	Unit Cost	Item Total
Rip Rap	100	CY	\$50/CY	\$5,000
Inlets/Manholes	34	EA	\$3000/EA	\$102,000
18" Storm	570	LF	\$35	\$19,950
24" Storm	1263	LF	\$40	\$50,520
30" Storm	260	LF	\$45	\$11,700
36" Storm	1840	LF	\$55	\$101,200
42" Storm	52	LF	\$65	\$3,380

48" Storm	270	LF	\$85	\$22,950
			Subtotal	\$316,700
			Eng/Cont (15%)	\$47,505
			Total Est. Cost	\$364,205

Table 7.2: Lorson Ranch Metro District Drainage Facility Costs (non-reimbursable)

Item	Quantity	Unit	Unit Cost	Item Total
Full Spectrum Ponds and Outlet	2	LS	\$150,000	\$300,000
			Subtotal	\$300,000
			Eng/Cont (15%)	\$45,000
			Total Est. Cost	\$345,000

8.0 FOUR STEP PROCESS

The site has been developed to minimize wherever possible the rate of developed runoff that will leave the site and to provide water quality management for the runoff produced by the site as proposed on the development plan. The following four step process should be considered and incorporated into the storm water collection system and storage facilities where applicable.

Step 1: Employ Runoff Reduction Practices

Lorson Ranch East Filing No. 1 has employed several methods of reducing runoff.

- The street configuration was laid out to minimize the length of streets. Many streets are straight and perpendicular resulting in lots with less wasted space.
- East Tributary of Jimmy Camp Creek with a natural sand bottom and vegetated slopes has been preserved through this site
- Lots on the west side of the site discharge runoff westward over an open space buffer prior to discharge into the creek
- A buffer tract has been added along the SDS watermain easement which reduces impervious areas
- Construct Full Spectrum Detention Pond C5 and D2. The full spectrum detention mimics existing storm discharges

Step 2: Implement BMP's that Slowly Release the Water Quality Capture Volume

Treatment and slow release of the water quality capture volume (WQCV) is required. Lorson Ranch East Filing No. 1 will construct two full spectrum stormwater detention pond which includes Water Quality Volumes and WQ outlet structures.

Step 3: Stabilize Drainageways

East Tributary of Jimmy Camp Creek is a major drainageway located within this site. In 2014 the East Tributary of JCC was reconstructed and stabilized per county criteria. The design included a natural sand bottom and armored sides.

Step 4: Implement Site Specific & Source Control BMP's

There are no potential sources of contaminants that could be introduced to the County's MS4. During construction source control will be provided with the proper installation of erosion control BMPs to limit erosion and transport of sediment. Area disturbed by construction will be seeded and mulched. Cut and fill slopes will be reseeded, and the slopes equal to or greater than three-to-one will be protected with erosion control fabric. Silt fences will be placed at the bottom of re-vegetated and rough graded slopes. Inlet protection will be used around proposed inlets. In addition, temporary sediment basins will be constructed so runoff will be treated prior to discharge. Construction BMPs in the form of vehicle tracking control, sediment basins, concrete washout area, rock socks, buffers, and silt fences will be utilized to protect receiving waters.

9.0 CONCLUSIONS

This drainage report has been prepared in accordance with the City of Colorado Springs/El Paso County Drainage Criteria Manual. The proposed development and drainage infrastructure will not cause adverse impacts to adjacent properties or properties located downstream. Several key aspects of the development discussed above are summarized as follows:


- Developed runoff will be conveyed via curb/gutter and storm sewer facilities
- The East Tributary of Jimmy Camp Creek has been reconstructed within this study area
- Bridges over the East Tributary will be required at Lorson Boulevard and Fontaine Boulevard and have been previously designed by Kiowa Engineering providing access to this site.
- Detention and water quality for this site area will be provided in two permanent ponds

10.0 REFERENCES

1. City of Colorado Springs/El Paso County Drainage Criteria Manual DCM, dated November, 1991
2. Soil Survey of El Paso County Area, Colorado by USDA, SCS
3. Jimmy Camp Creek Drainage Basin Planning Study, Dated March 9, 2015, by Kiowa Engineering Corporation
4. City of Colorado Springs "Drainage Criteria Manual, Volume 2
5. El Paso County "Engineering Criteria Manual"
6. Lorson Ranch East MDDP, June 30, 2017 by Core Engineering.
7. Final Drainage Report for Fontaine Boulevard, Old Glory Drive, and Marksheffel Road Phase 1 Improvements, Dated February 6, 2006, Revised September 7, 2006, by Pentacor Engineering.
8. Final construction plans "Fontaine Boulevard and East Fork Jimmy Camp Creek Channel Design", Dated March 10, 2017, by Kiowa Engineering Corporation
9. El Paso County Resolution #15-042, El Paso County adoption of Chapter 6 and Section 3.2.1 of the City of Colorado Springs Drainage Criteria Manual dated May, 2014.
10. Kiowa Engineering Corporation "Final Bridge and Channel Design Report, CDR 16-009" revised August 24, 2017
11. Lorson Ranch East MDDP prepared by Core Engineering Group, dated November 27, 2017
12. Lorson Ranch East PDR prepared by Core Engineering Group, dated December 18, 2017
13. Final Drainage Report for Fontaine Boulevard prepared by Core Engineering Group, Reference CDR183, dated December 20, 2017

[Address maintenance access to EFJCC.](#)

APPENDIX A – VICINTIY MAP, SOILS MAP, FEMA MAP

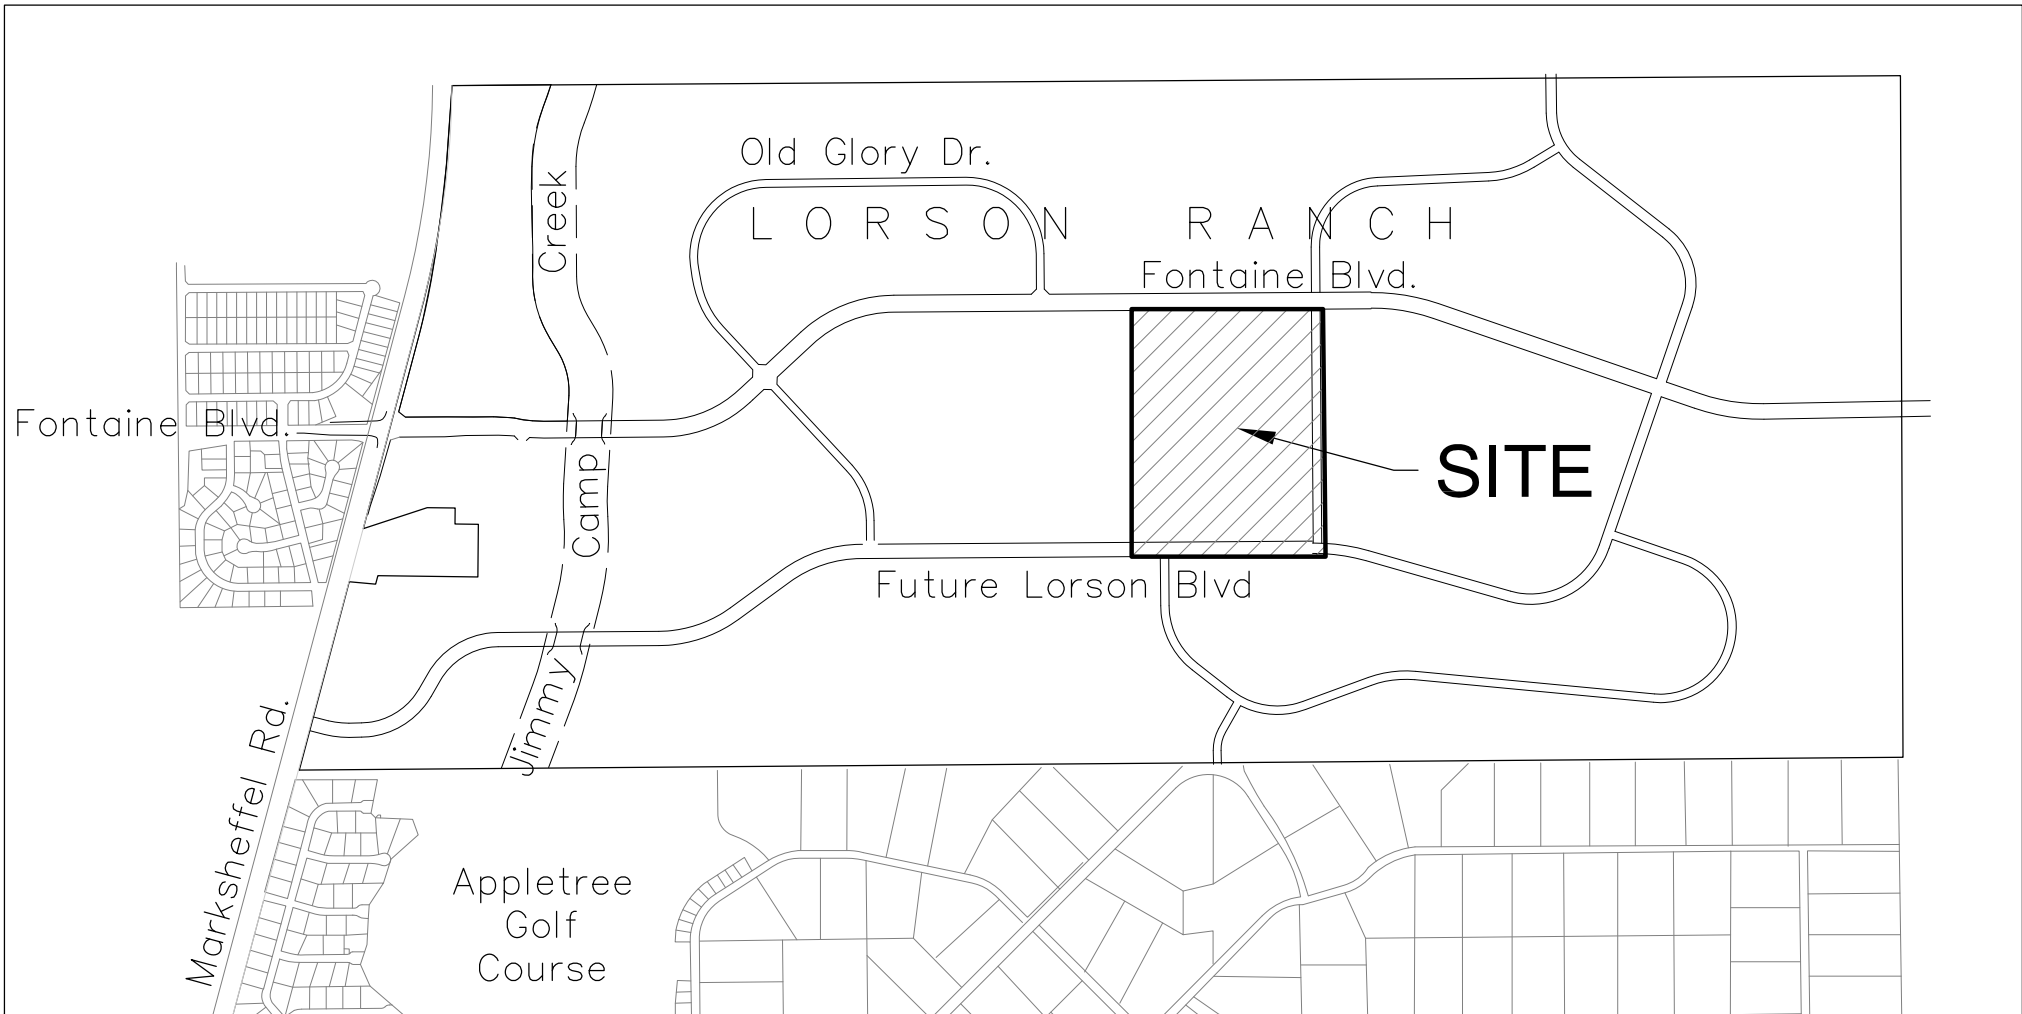


VICINITY MAP
NO SCALE

LORSON RANCH EAST FILING NO. 1

Soil Map—El Paso County Area, Colorado
(LORSON RANCH EAST)

FDR SITE

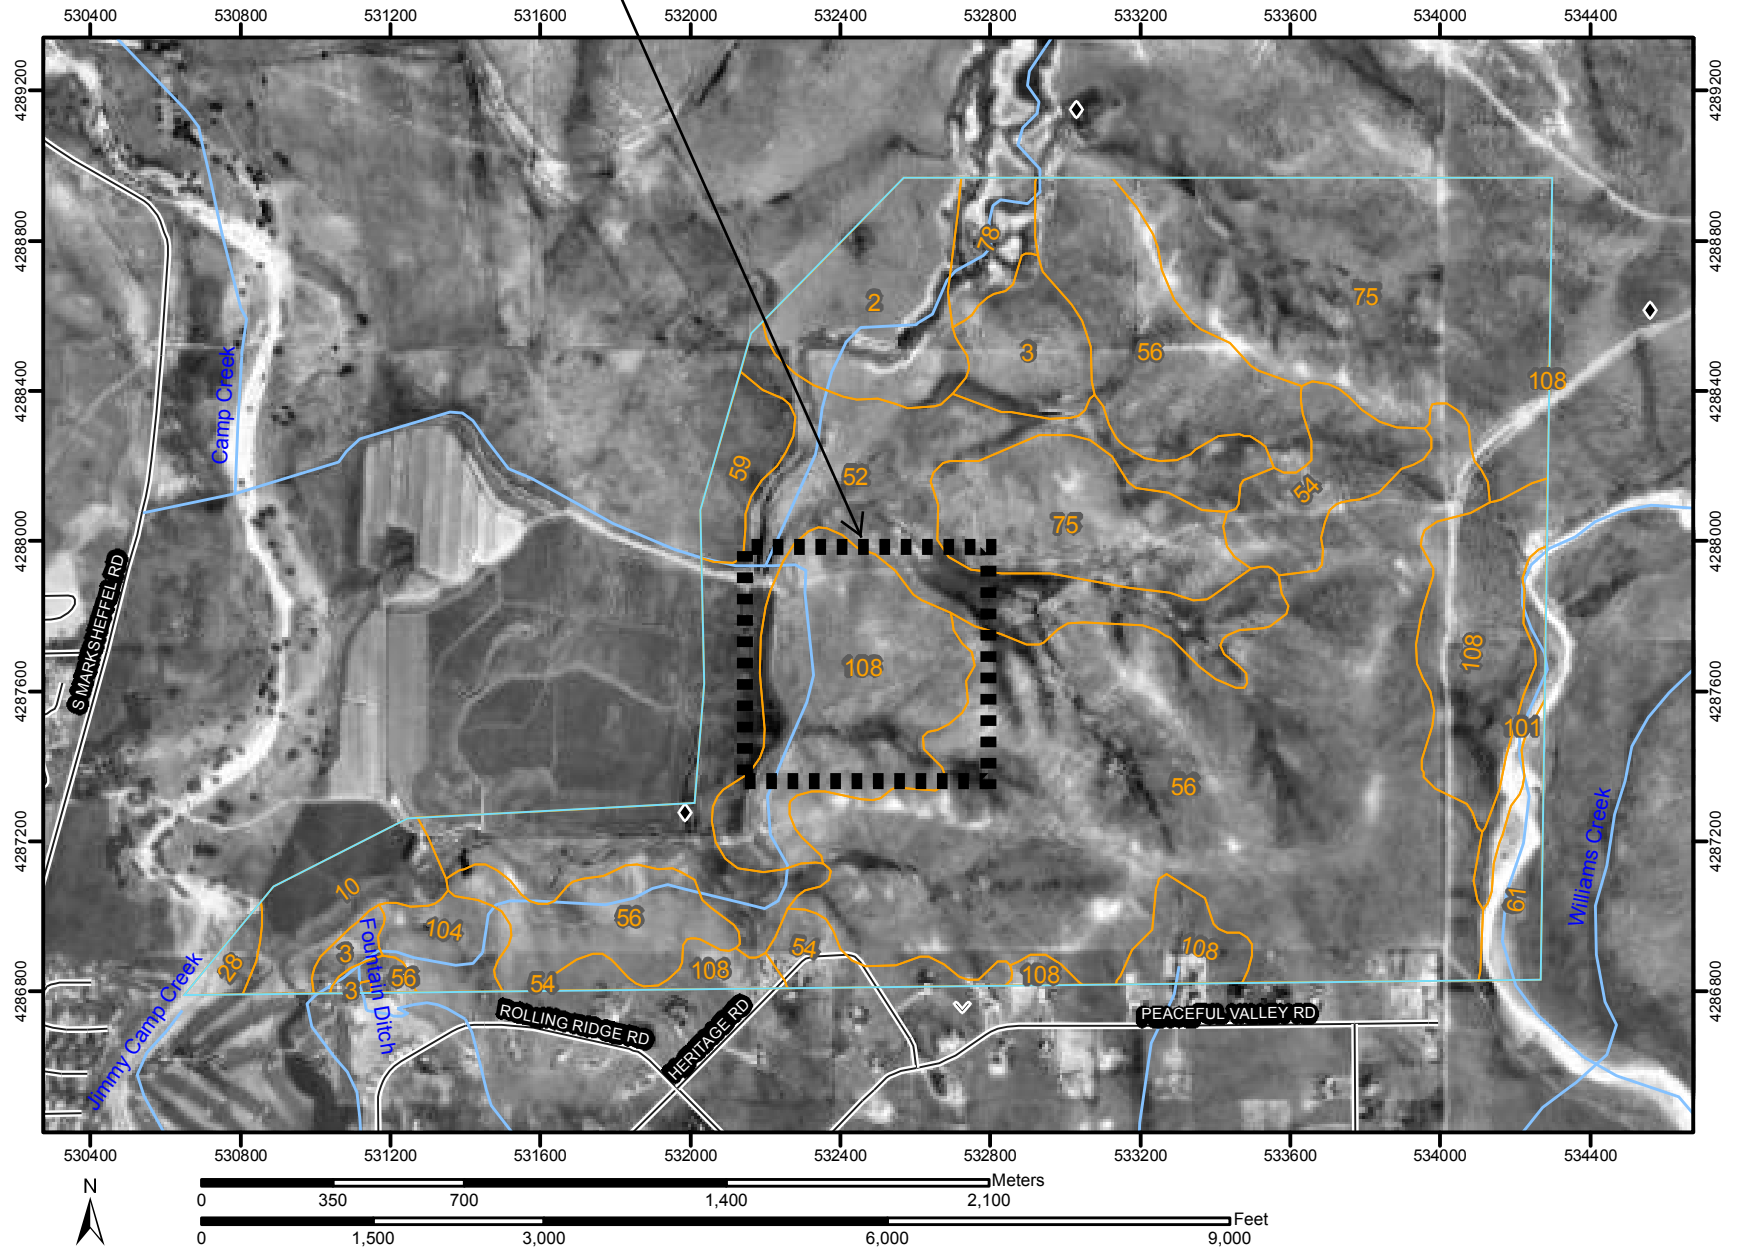

Soil Map—El Paso County Area, Colorado
(LORSON RANCH EAST)

MAP LEGEND






















Area of Interest (AOI)




 Area of Interest (AOI)

Soils



 Soil Map Units

Special Point Features

-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot
-  Spoil Area
-  Stony Spot



-  Very Stony Spot
-  Wet Spot
-  Other

Special Line Features



-  Gully
-  Short Steep Slope
-  Other

Political Features

Municipalities

-  Cities
-  Urban Areas






Water Features

-  Oceans
-  Streams and Canals

Transportation

-  Rails

Roads

-  Interstate Highways
-  US Routes
-  State Highways
-  Local Roads
-  Other Roads

MAP INFORMATION

Original soil survey map sheets were prepared at publication scale. Viewing scale and printing scale, however, may vary from the original. Please rely on the bar scale on each map sheet for proper map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL: <http://websoilsurvey.nrcs.usda.gov>
Coordinate System: UTM Zone 13N

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.


Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 5, Jan 15, 2008

Date(s) aerial images were photographed: 1999

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

El Paso County Area, Colorado (CO625)			
Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
2	Ascalon sandy loam, 1 to 3 percent slopes	54.4	4.2%
3	Ascalon sandy loam, 3 to 9 percent slopes	32.6	2.5%
10	Blendon sandy loam, 0 to 3 percent slopes	29.0	2.2%
28	Ellicott loamy coarse sand, 0 to 5 percent slopes	5.5	0.4%
52	Manzanola clay loam, 1 to 3 percent slopes	180.3	14.0%
54	Midway clay loam, 3 to 25 percent slopes	46.2	3.6%
56	Nelson-Tassel fine sandy loams, 3 to 18 percent slopes	476.6	37.0%
59	Nunn clay loam, 0 to 3 percent slopes	16.8	1.3%
61	Olney sandy loam, 3 to 5 percent slopes	18.8	1.5%
75	Razor-Midway complex	213.9	16.6%
78	Sampson loam, 0 to 3 percent slopes	16.4	1.3%
101	Ustic Torrifluvents, loamy	11.3	0.9%
104	Vona sandy loam, 1 to 3 percent slopes	17.4	1.4%
108	Wiley silt loam, 3 to 9 percent slopes	170.2	13.2%
Totals for Area of Interest (AOI)		1,289.3	100.0%

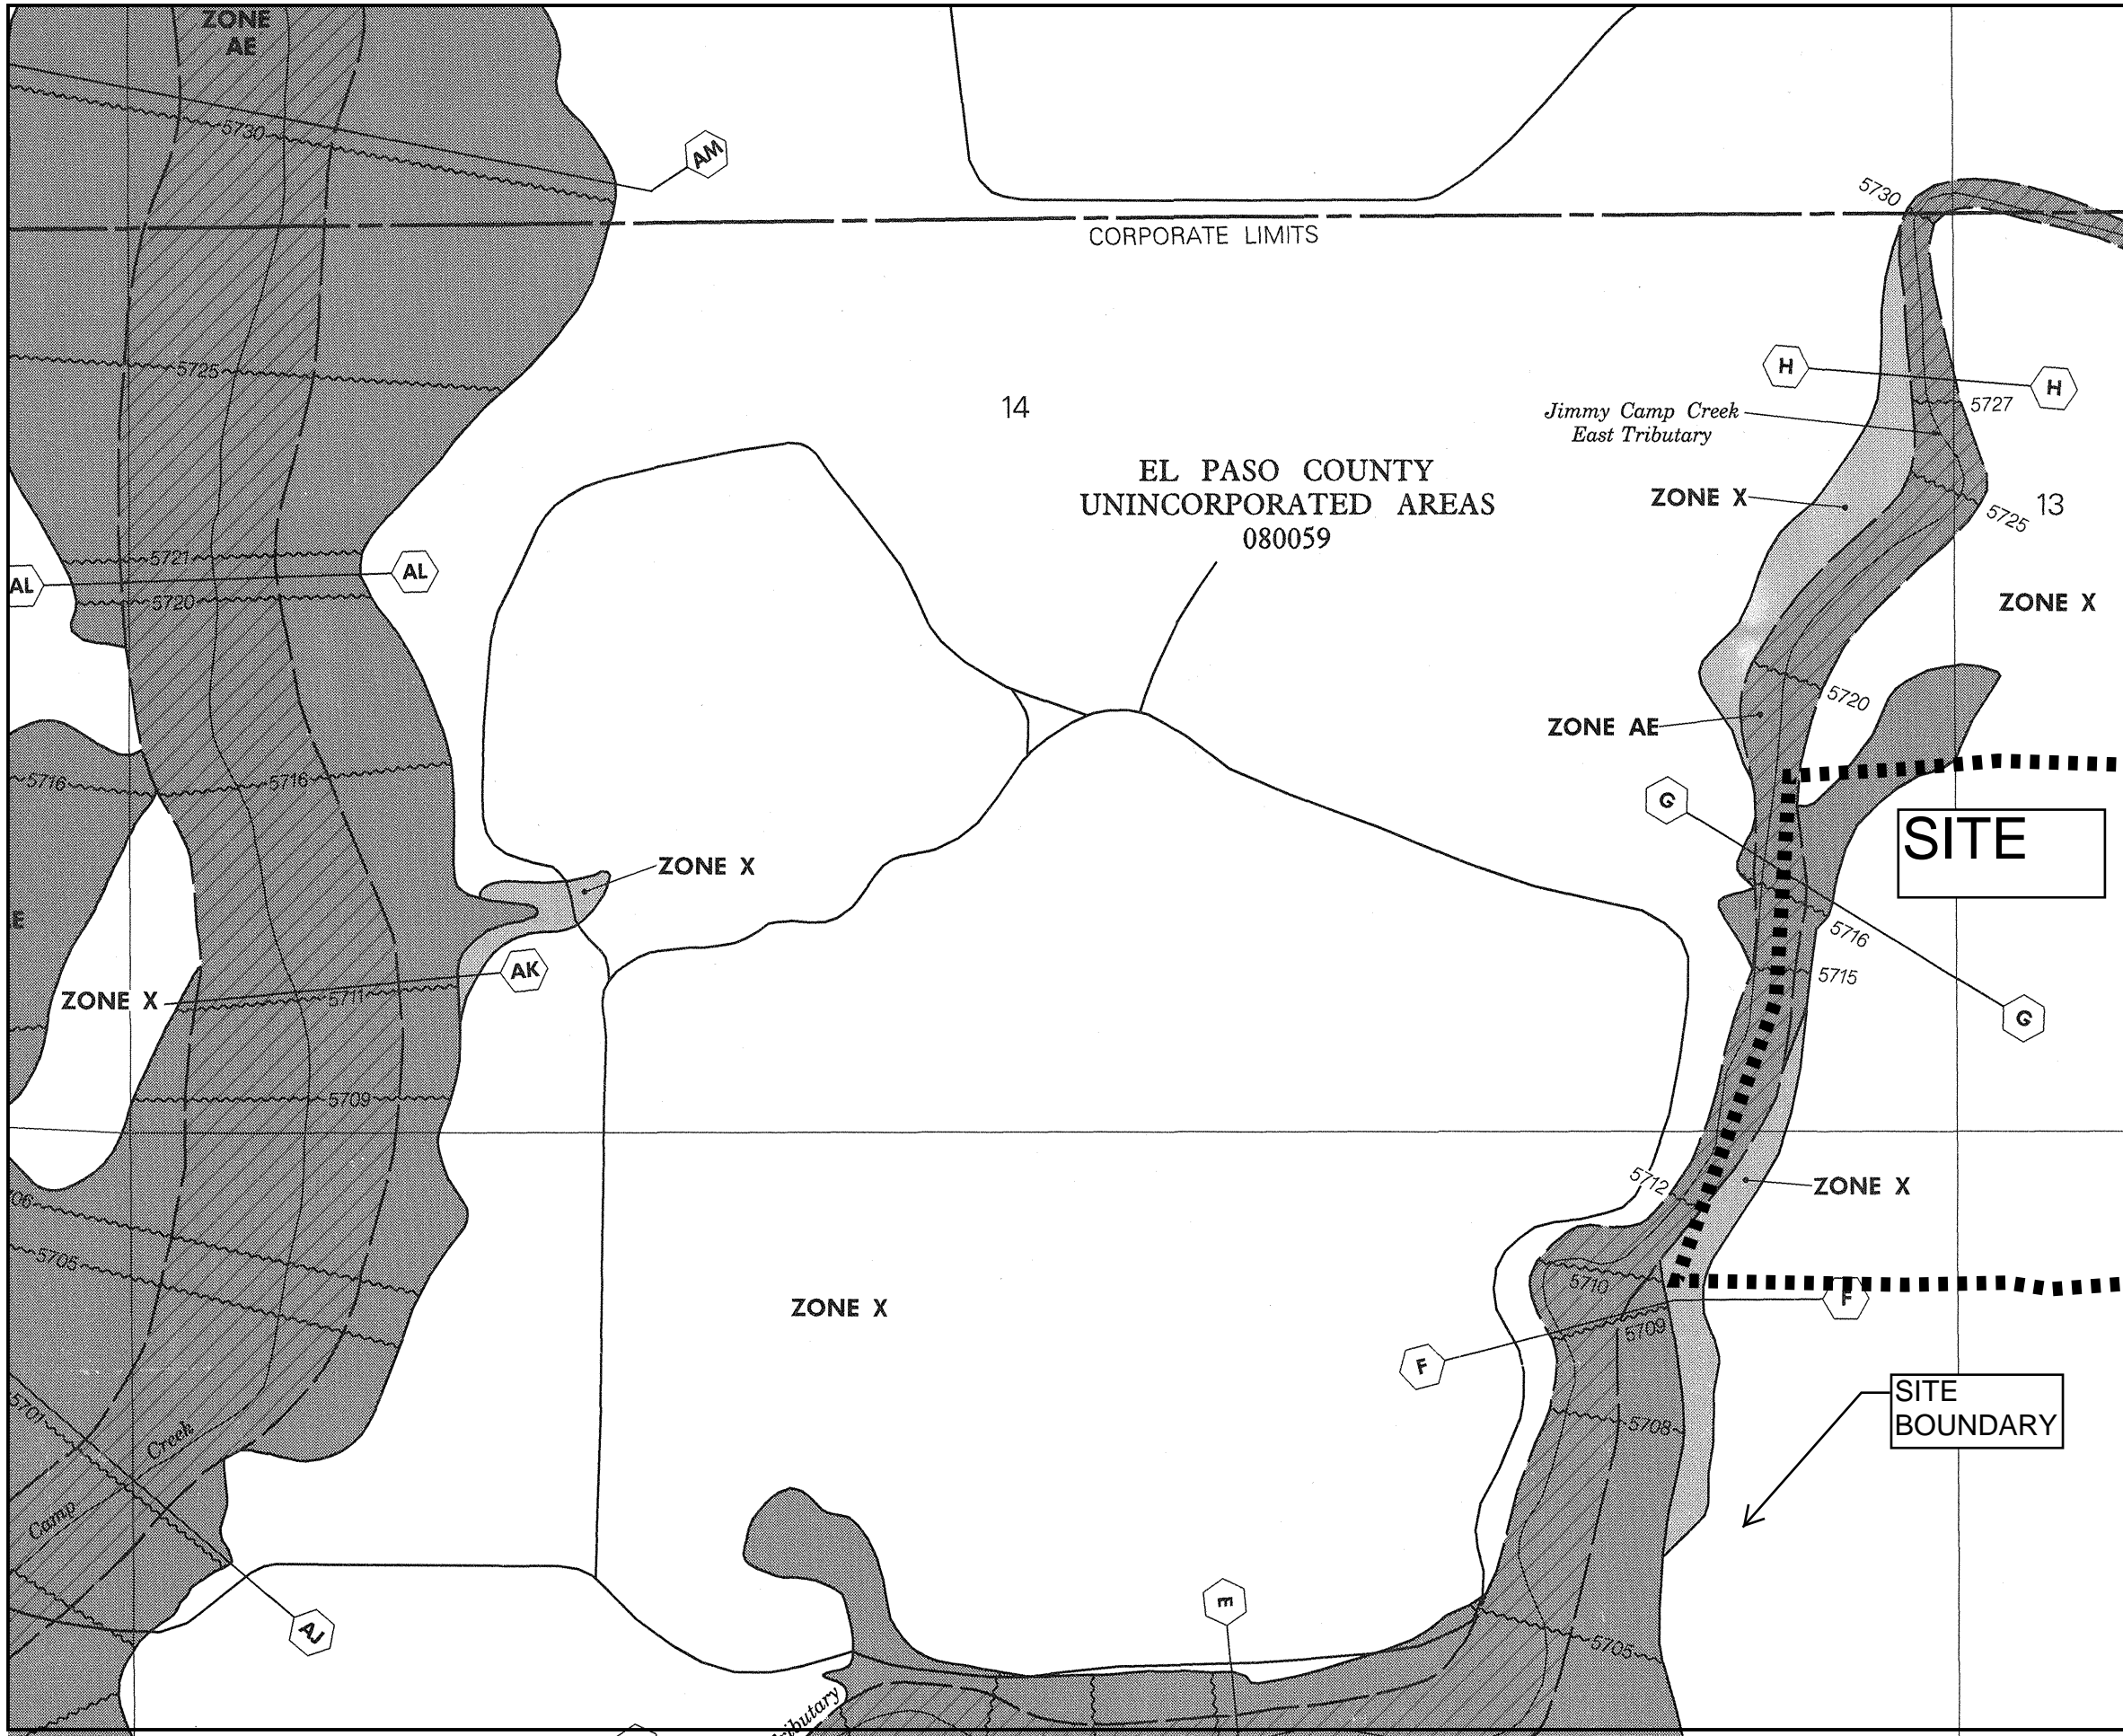

APPROXIMATE SCALE IN FEET
 500 0 500

NATIONAL FLOOD INSURANCE PROGRAM

**FIRM
 FLOOD INSURANCE RATE MAP**

**EL PASO COUNTY,
 COLORADO AND
 INCORPORATED AREAS**

PANEL 957 OF 1300
 (SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	080060	0957	F
EL PASO COUNTY, UNINCORPORATED AREAS	080059	0957	F
FOUNTAIN, CITY OF	080061	0957	F

**MAP NUMBER
 08041C0957 F**

**EFFECTIVE DATE:
 MARCH 17, 1997**






Federal Emergency Management Agency

JOINS PANEL 1000


This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at www.msc.fema.gov

Legend

-  1% annual chance (100-Year) Floodplain
-  1% annual chance (100-Year) Floodway
-  0.2% annual chance (500-Year) Floodplain



APPROXIMATE SCALE IN FEET



NATIONAL FLOOD INSURANCE PROGRAM

FIRM
FLOOD INSURANCE RATE MAP

EL PASO COUNTY,
COLORADO AND
INCORPORATED AREAS

**REVISED TO
REFLECT LOMR
EFFECTIVE: January 29, 2015**

PANEL 957 OF 1300

(SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	080060	0957	F
EL PASO COUNTY UNINCORPORATED AREAS	080059	0957	F
FOUNTAIN, CITY OF	080061	0957	F

MAP NUMBER
08041C0957 F

EFFECTIVE DATE:
MARCH 17, 1997



Federal Emergency Management Agency

JOINS PANEL 0769

104°37'30"
38°45'00"

NOTE: MAP AREA SHOWN ON THIS
PANEL IS LOCATED WITHIN TOWNSHIP
15 SOUTH, RANGE 65 WEST.

CITY OF
COLORADO SPRINGS
080060

Jimmy Camp Creek
East Tributary

REVISED
AREA

ZONE AE

SITE

SITE
BOUNDARY

AREA REVISED BY LOMR
DATED AUGUST 29, 2007.

EL PASO COUNTY
UNINCORPORATED AREAS
080059

PROFILE
BASELINE

ZONE AE

ZONE
AE


D

E

F

E

JOINS PANEL 1000

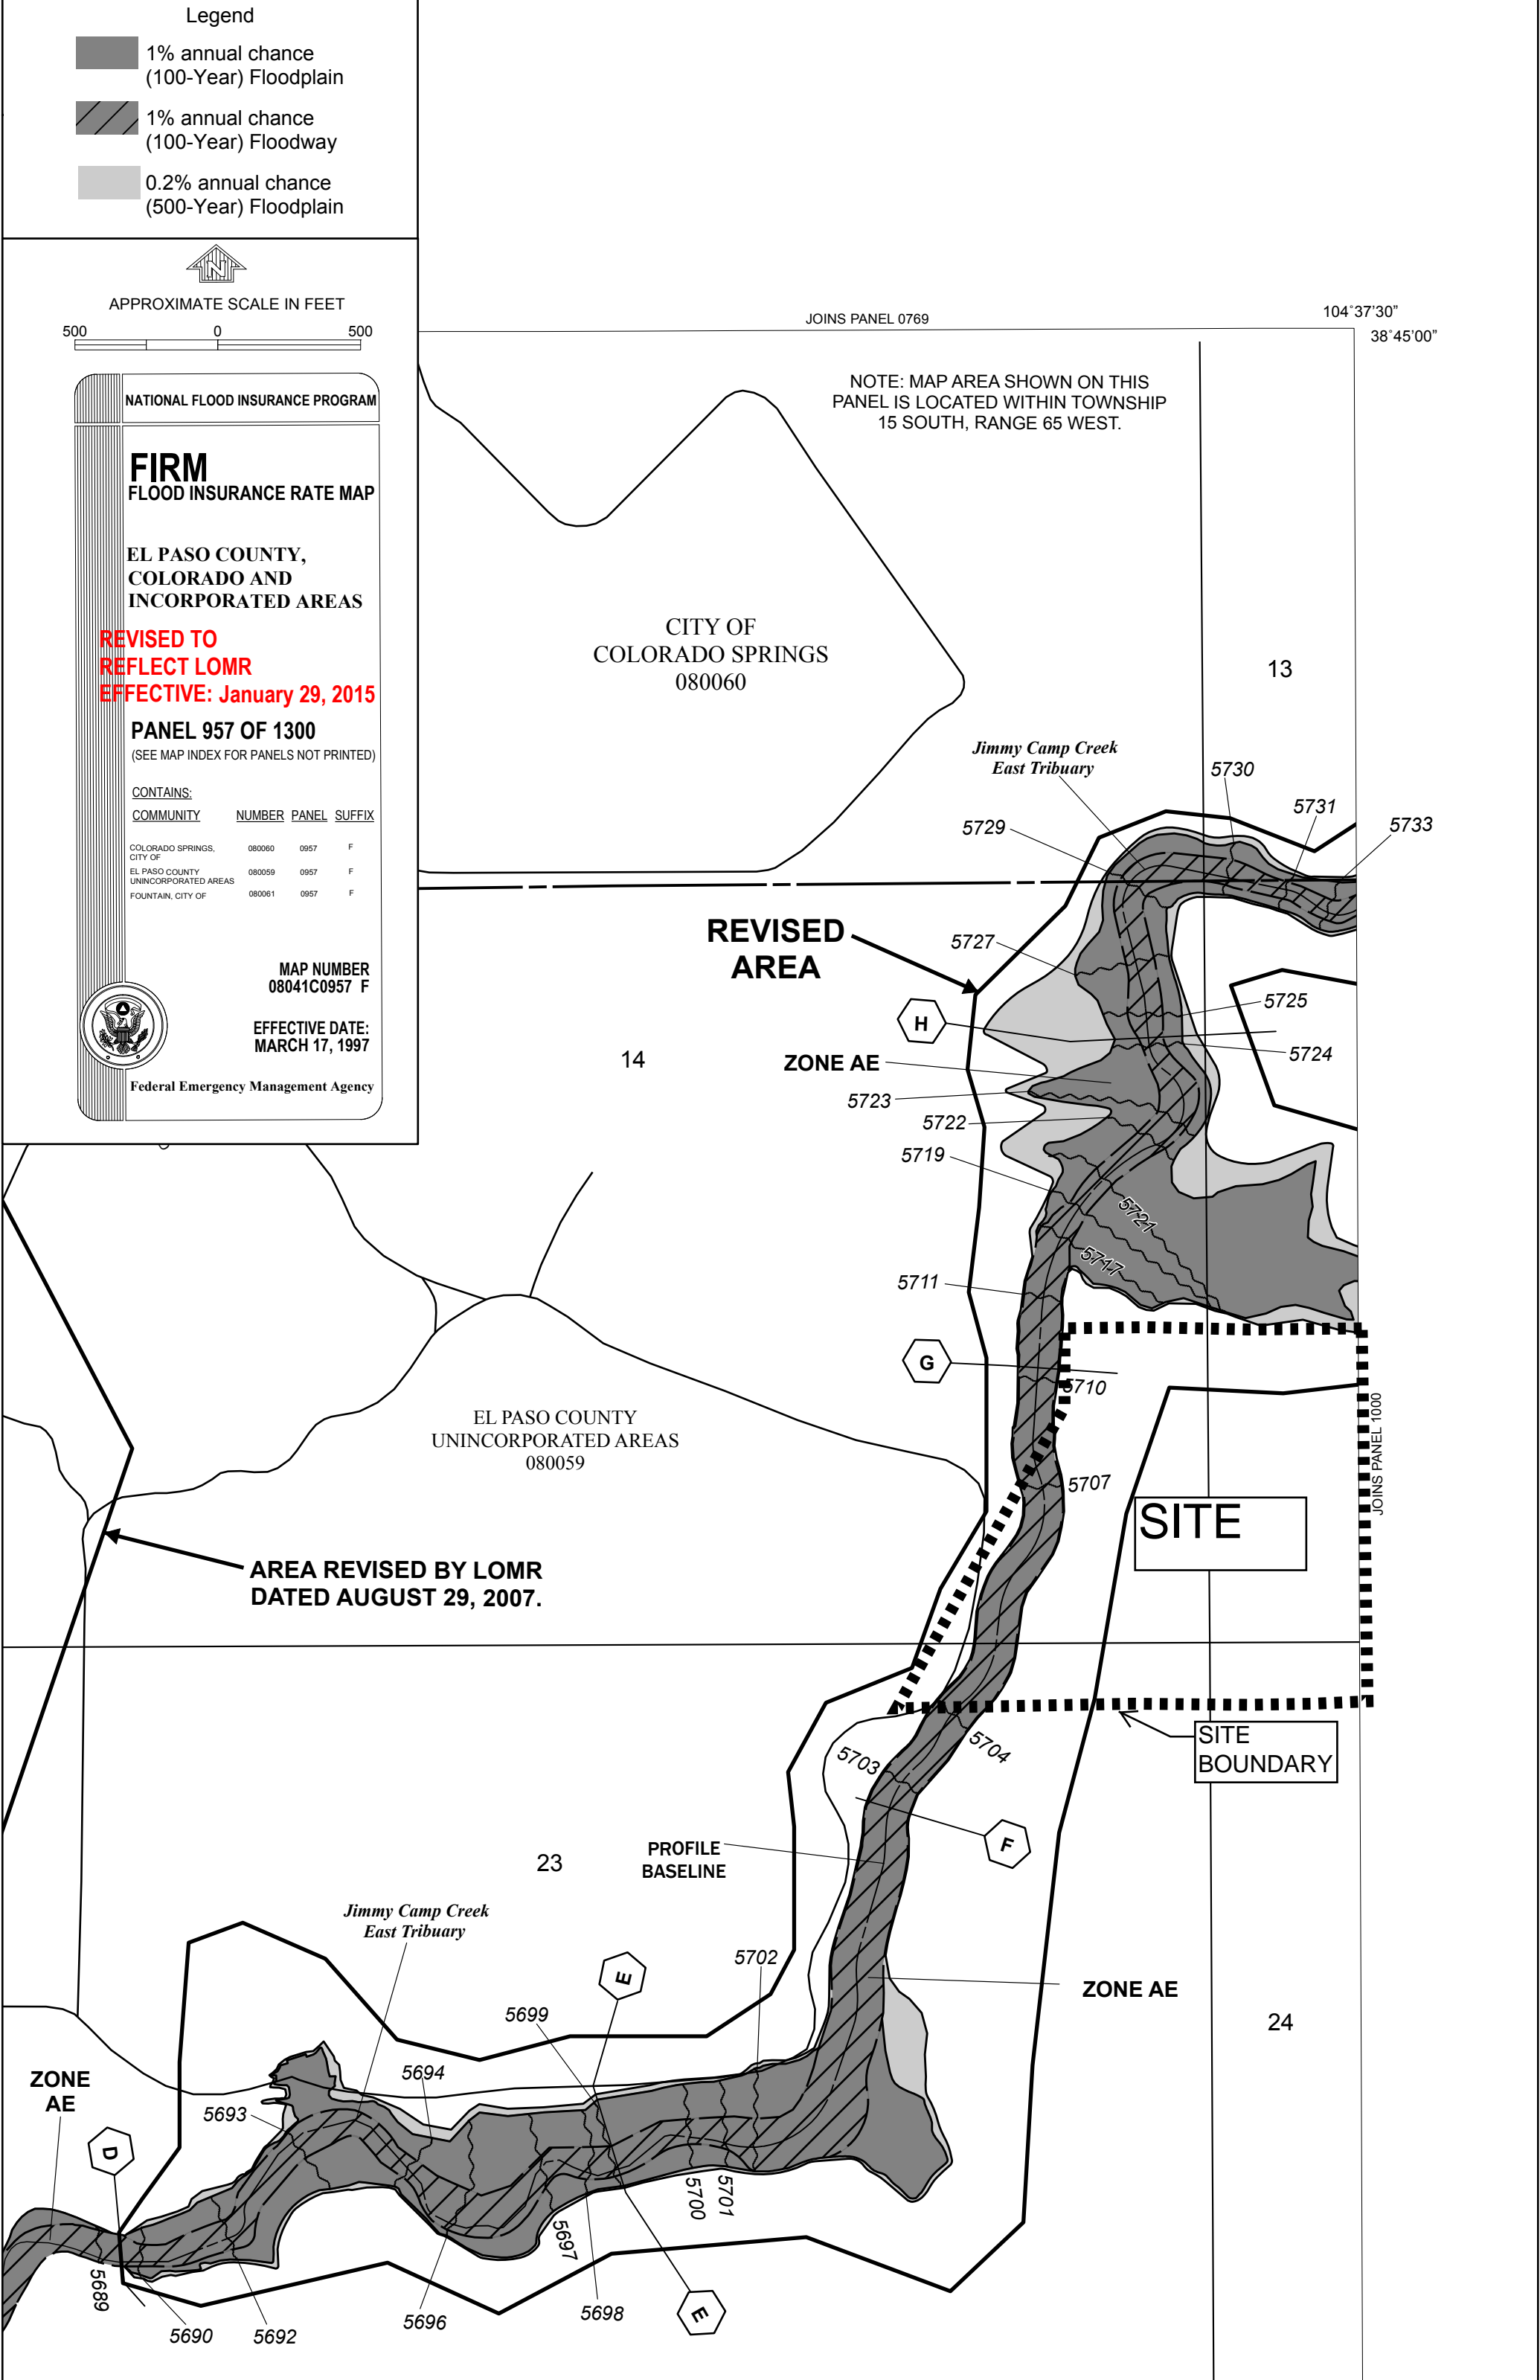

APPENDIX B – HYDROLOGY CALCULATIONS

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries													
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds													
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas													
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks													
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs													
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns													
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_t) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_t) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.



Standard Form SF-2. Storm Drainage System Design (Rational Method Procedure)

Calculated By: Leonard Beasley
 Date: June, 2017
 Checked By: Leonard Beasley

Job No: 100.013
 Project: Lorson Ranch East MDDP
 Design Storm: **5 - Year Event, Existing Conditions**

Street or Basin	Design Point	Direct Runoff							Total Runoff			Street		Pipe			Travel Time			Remarks	
		Area Design	Area (A)	Runoff Coeff. (C)	t_c	CA	i	Q	t_c	$\Sigma (CA)$	i	Q	Slope	Street Flow	Design Flow	Slope	Pipe Size	Length	Velocity		t_t
			ac.		min.		in/hr	cfs	min		in/hr	cfs	%	cfs	cfs	%	in	ft	ft/sec		min
EX-A1			4.28	0.08	18.6	0.34	3.20	1.1													
EX-C	DP-2		452.97	CN = 67						SCS =	141.0										
EX-D	DP-3		109.55	0.12	34.7	13.15	2.26	29.7													
EX-E	DP-4		187.30	CN = 73						SCS =	100.0										



Standard Form SF-2. Storm Drainage System Design (Rational Method Procedure)

Calculated By: Leonard Beasley
 Date: April 28, 2016
 Checked By: Leonard Beasley

Job No: 100.013
 Project: Lorson Ranch East MDDP
 Design Storm: **100 - Year Event, Existing Conditions**

Street or Basin	Design Point	Area Design	Direct Runoff						Total Runoff			Street		Pipe			Travel Time			Remarks	
			Area (A)	Runoff Coeff. (C)	t _c	CA	i	Q	t _c	Σ (CA)	i	Q	Slope	Street Flow	Design Flow	Slope	Pipe Size	Length	Velocity		t _t
			ac.		min.		in/hr	cfs	min		in/hr	cfs	%	cfs	cfs	%	in	ft	ft/sec		min
EX-A1			4.28	0.35	18.6	1.50	5.37	8.0													
EX-C	DP-2		452.97	CN = 67						SCS =	458.0										
EX-D	DP-3		109.55	0.40	34.7	43.82	3.80	166.5													
EX-E	DP-4		187.30	CN = 73						SCS =	280.0										

Hydrograph Plot

Hydraflow Hydrographs by Intelisolve

Monday, Jun 5 2017, 4:1 PM


Hyd. No. 1

EX-C

Hydrograph type = SCS Runoff
Storm frequency = 5 yrs
Drainage area = 452.970 ac
Basin Slope = 0.0 %
Tc method = USER
Total precip. = 2.80 in
Storm duration = CSpring_IIA-6min.cds

Peak discharge = 140.99 cfs
Time interval = 6 min
Curve number = 69
Hydraulic length = 7400 ft
Time of conc. (Tc) = 49.50 min
Distribution = Custom
Shape factor = 484

Hydrograph Volume = 905,484 cuft

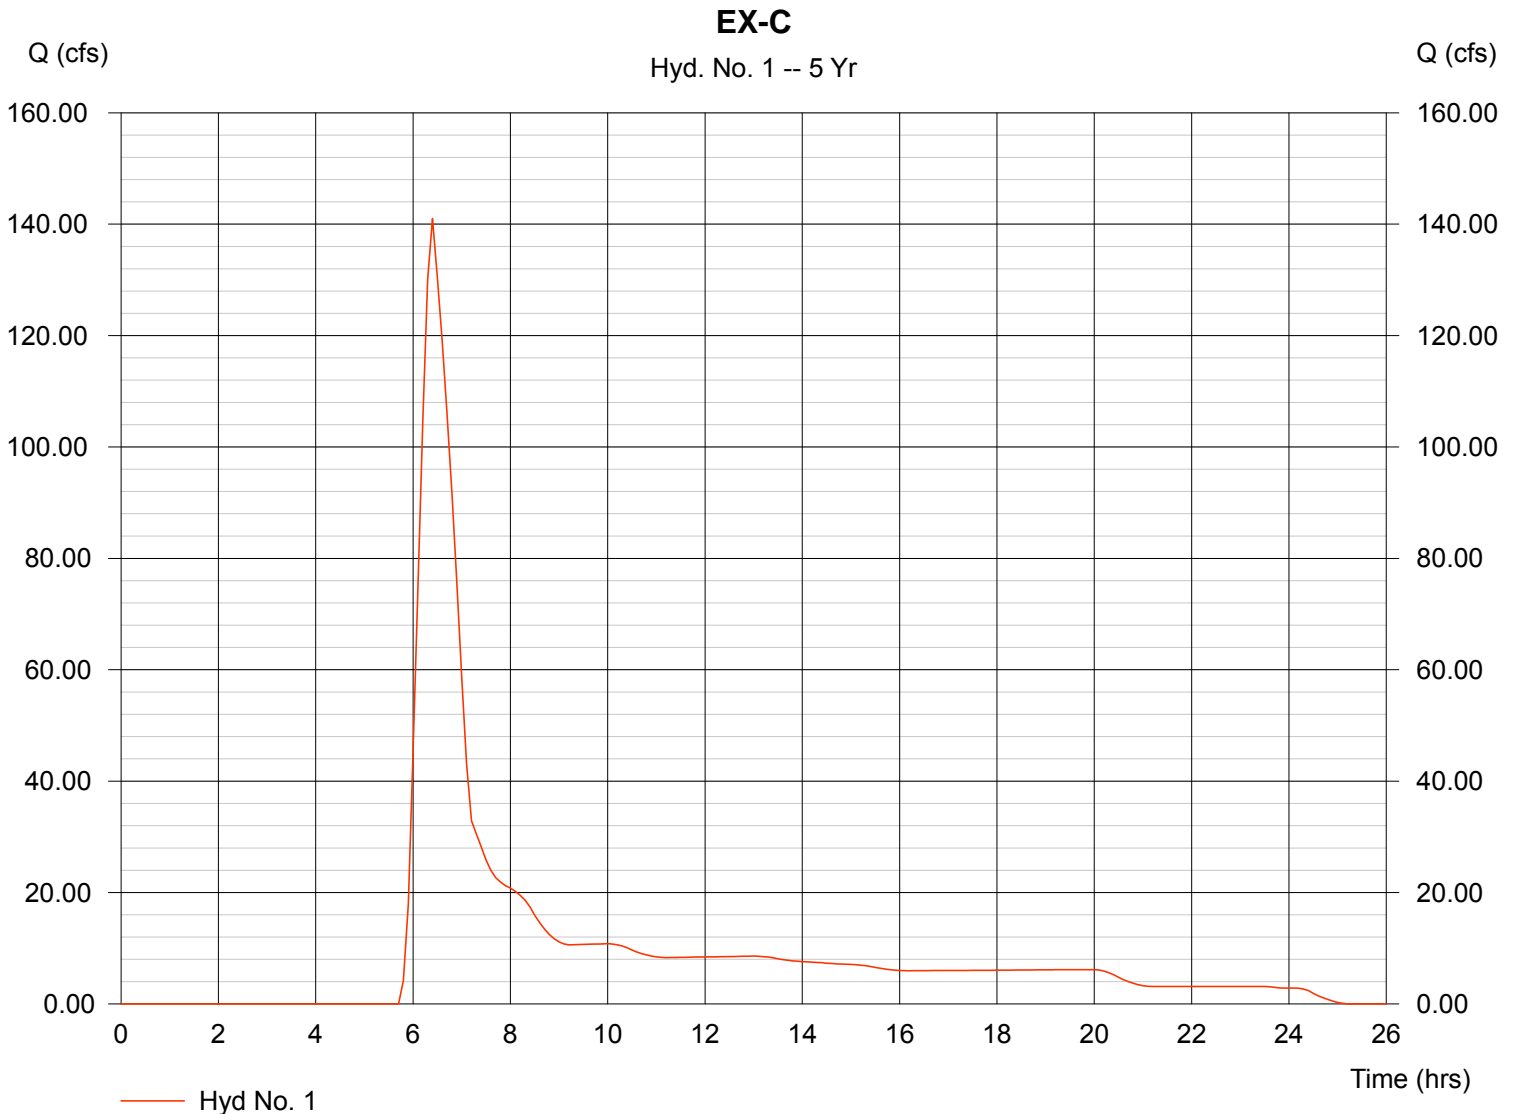

Hydrograph Plot


Hyd. No. 1

EX-C

Hydrograph type = SCS Runoff
Storm frequency = 100 yrs
Drainage area = 452.970 ac
Basin Slope = 0.0 %
Tc method = USER
Total precip. = 4.40 in
Storm duration = CSpring_IIA-6min.cds

Peak discharge = 458.13 cfs
Time interval = 6 min
Curve number = 69
Hydraulic length = 7400 ft
Time of conc. (Tc) = 49.50 min
Distribution = Custom
Shape factor = 484

Hydrograph Volume = 2,456,980 cuft

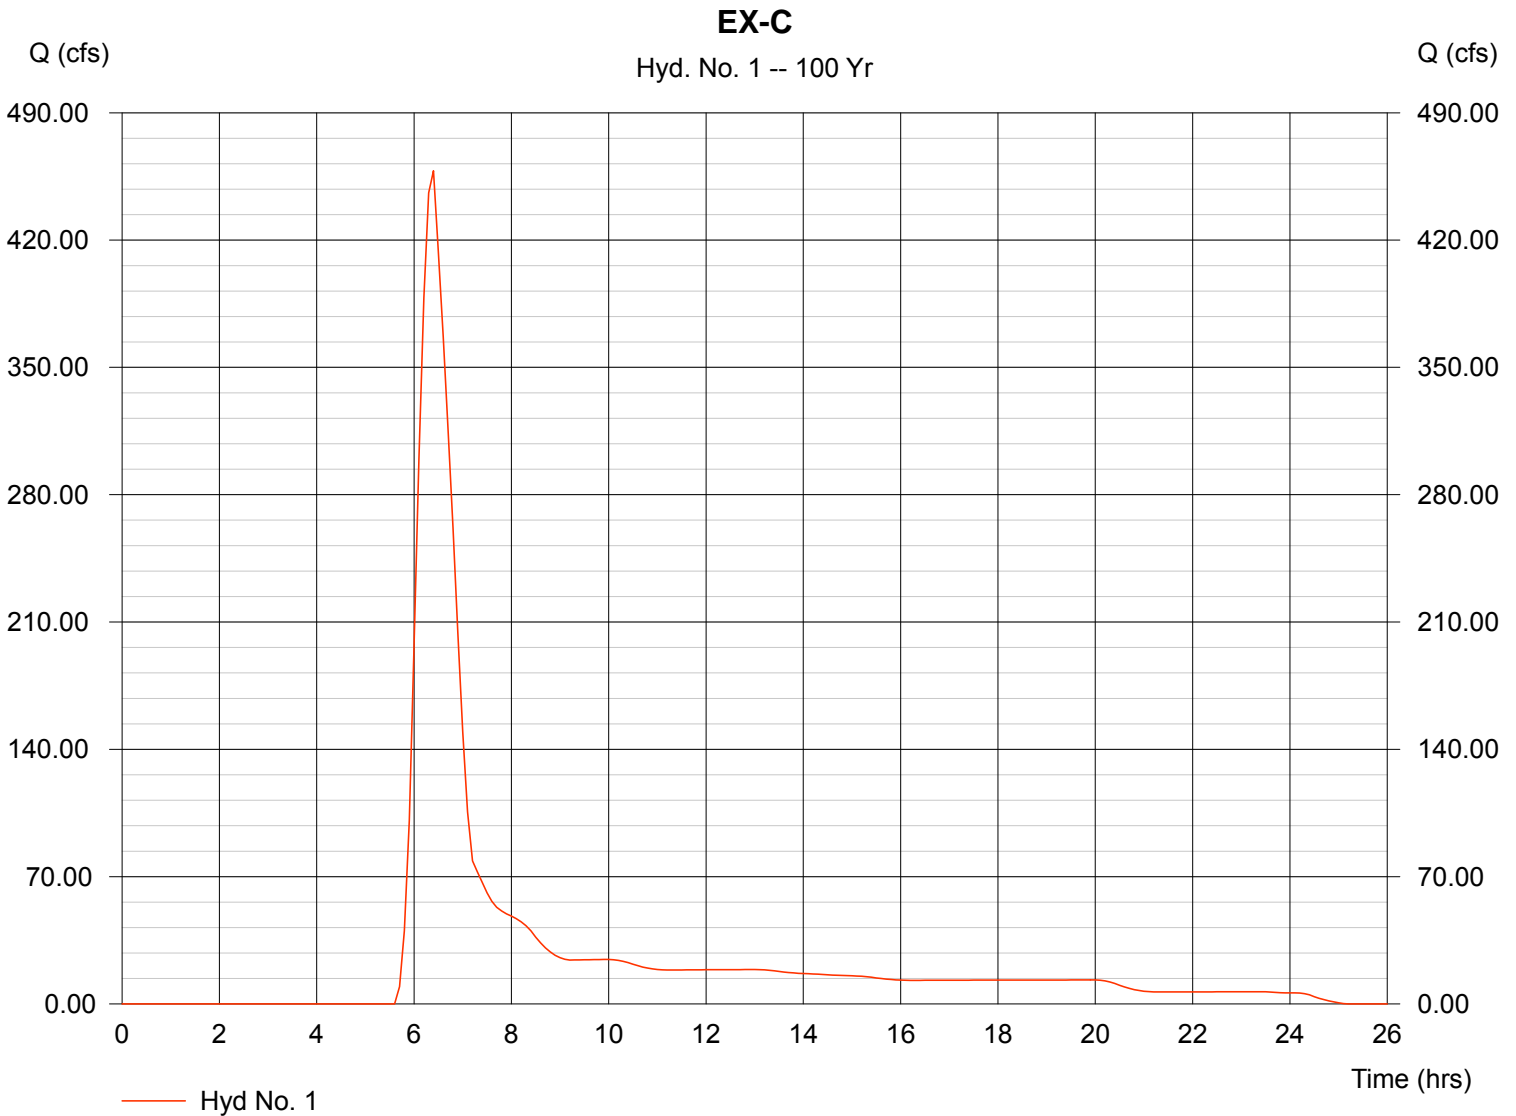



Standard Form SF-2. Storm Drainage System Design (Rational Method Procedure)

Calculated By: Leonard Beasley
 Date: August 16, 2016, June 30, 2017
 Checked By: Leonard Beasley

Job No: 100.040
 Project: Lorson Ranch East Preliminary Drainage
 Design Storm: **5 - Year Event, Proposed Conditions**

Street or Basin	Design Point	Direct Runoff							Total Runoff			Street		Pipe			Travel Time			Remarks	
		Area Design	Area (A)	Runoff Coeff. (C)	t_c	CA	i	Q	t_c	$\Sigma (CA)$	i	Q	Slope	Street Flow	Design Flow	Slope	Pipe Size	Length	Velocity		t
			ac.		min.		in/hr	cfs	min		in/hr	cfs	%	cfs	cfs	%	in	ft	ft/sec		min
C17.1a			2.81	0.49	12.11	1.38	3.84	5.3													
C17.1			2.68	0.49	7.69	1.31	4.52	5.9													
C17.2			4.11	0.49	9.19	2.01	4.26	8.6													
C17.3			2.21	0.49	9.78	1.08	4.16	4.5													
C17.4			1.98	0.49	17.58	0.97	3.28	3.2													
C17.5			3.72	0.49	13.41	1.82	3.69	6.7													
C17.6			1.04	0.49	13.89	0.51	3.64	1.9													
C17.7			2.68	0.49	7.62	1.31	4.54	6.0													
C17.7-2 yr storm			2.68	0.04	7.62	0.11	4.54	0.5													
C17.8			1.52	0.55	12.41	0.84	3.81	3.2													
C17.9			1.73	0.90	5.65	1.56	4.99	7.8													
C17.10			2.34	0.90	9.34	2.11	4.23	8.9													
D1.1			5.09	0.49	18.38	2.49	3.22	8.0													
D1.2			1.10	0.49	6.86	0.54	4.69	2.5													
D1.3			0.86	0.49	10.65	0.42	4.03	1.7													
D1.4			2.80	0.49	12.39	1.37	3.81	5.2													
D1.5			5.15	0.49	9.43	2.52	4.22	10.6													
D1.6			5.10	0.49	16.74	2.50	3.36	8.4													
D1.7			3.50	0.49	10.40	1.72	4.07	7.0													
D1.8			1.70	0.49	12.37	0.83	3.81	3.2													
D1.9			2.20	0.49	12.70	1.08	3.77	4.1													
D1.10			5.50	0.49	13.39	2.70	3.69	9.9													
D1.11			1.40	0.49	12.38	0.69	3.81	2.6													
D1.12			4.45	0.24	14.08	1.07	3.62	3.9													
D2.1			3.14	0.49	14.87	1.54	3.53	5.4													
D2.2			1.11	0.49	11.93	0.54	3.86	2.1													
D2.3			2.80	0.27	14.09	0.76	3.61	2.7													
D2.4			3.33	0.29	13.48	0.97	3.68	3.6													
D2.5			3.93	0.49	7.40	1.93	4.58	8.8													
D2.6			2.13	0.49	10.37	1.04	4.07	4.3													
D2.7			2.98	0.49	7.22	1.46	4.62	6.7													



Standard Form SF-2. Storm Drainage System Design (Rational Method Procedure)

Calculated By: Leonard Beasley
Date: August 16, 2016, June 30, 2017
Checked By: Leonard Beasley

Job No: 100.040
Project: Lorson Ranch East Preliminary Drainage
Design Storm: 5 - Year Event, Proposed Conditions

Table with columns: Street or Basin, Design Point, Direct Runoff (Area Design, Area (A), Runoff Coeff. (C), tc, CA, i, Q), Total Runoff (tc, Σ(CA), i, Q), Street (Slope, Street Flow), Pipe (Design Flow, Slope, Pipe Size), Travel Time (Length, Velocity, tt), and Remarks.

Standard Form SF-2. Storm Drainage System Design (Rational Method Procedure)

Calculated By: Leonard Beasley
 Date: August 16, 2016, June 30, 2017
 Checked By: Leonard Beasley

Job No: 100.040
 Project: Lorson Ranch East Preliminary Drainage
 Design Storm: **100 - Year Event, Proposed Conditions**

Street or Basin	Design Point	Direct Runoff							Total Runoff			Street		Pipe			Travel Time		Remarks		
		Area Design	Area (A)	Runoff Coef. (C)	t_c	CA	i	Q	t_c	$\Sigma(CA)$	i	Q	Slope	Street Flow	Design Flow	Slope	Pipe Size	Length		Velocity	t
			ac.		min.		in/hr	cfs	min		in/hr	cfs	%	cfs	cfs	%	in	ft		ft/sec	min
C15.14			1.32	0.65	8.11	0.86	7.46	6.4													
C15.15			4.02	0.65	13.72	2.61	6.14	16.0													
C17.1a			2.81	0.65	12.11	1.83	6.45	11.8													
C17.1			2.68	0.65	7.69	1.74	7.59	13.2													
C17.2			4.11	0.65	9.19	2.67	7.15	19.1													
C17.3			2.21	0.65	9.78	1.44	6.99	10.0													
C17.4			1.98	0.65	17.58	1.29	5.51	7.1													
C17.5			3.72	0.96	13.41	3.57	6.19	22.1													
C17.6			1.04	0.96	13.89	1.00	6.10	6.1													
C17.7			2.68	0.65	7.62	1.74	7.62	13.3													
C17.8			1.52	0.74	12.41	1.12	6.39	7.2													
C17.9			1.73	0.96	5.65	1.66	8.37	13.9													
C17.10			2.34	0.96	9.34	2.25	7.10	16.0													
D1.1			5.09	0.65	18.38	3.31	5.40	17.9													
D1.2			1.10	0.65	6.86	0.72	7.88	5.6													
D1.3			0.86	0.65	10.65	0.56	6.77	3.8													
D1.4			2.80	0.65	12.39	1.82	6.39	11.6													
D1.5			5.15	0.65	9.43	3.35	7.08	23.7													
D1.6			5.10	0.65	16.74	3.32	5.63	18.7													
D1.7			3.50	0.65	10.40	2.28	6.83	15.5													
D1.8			1.70	0.65	12.37	1.11	6.40	7.1													
D1.9			2.20	0.65	12.70	1.43	6.33	9.1													
D1.10			5.50	0.65	13.39	3.58	6.20	22.2													
D1.11			1.40	0.65	12.38	0.91	6.39	5.8													
D1.12			4.45	0.57	14.08	2.54	6.07	15.4													
D2.1			3.14	0.65	14.87	2.04	5.93	12.1													
D2.2			1.11	0.65	11.93	0.72	6.49	4.7													
D2.3			2.80	0.57	14.09	1.60	6.07	9.7													

Calculated By: Leonard Beasley
 Date: August 16, 2016, June 30, 2017
 Checked By: Leonard Beasley

Job No: 100.040
 Project: Lorson Ranch East Preliminary Drainage
 Design Storm: **100 - Year Event, Proposed Conditions**

Street or Basin	Design Point	Direct Runoff							Total Runoff			Street		Pipe			Travel Time			Remarks	
		Area Design	Area (A)	Runoff Coeff. (C)	t_c	CA	i	Q	t_c	$\Sigma(CA)$	i	Q	Slope	Street Flow	Design Flow	Slope	Pipe Size	Length	Velocity		t
			ac.		min.		in/hr	cfs	min		in/hr	cfs	%	cfs	cfs	%	in	ft	ft/sec		min
D2.4			3.33	0.58	13.48	1.93	6.18	11.9													
D2.5			3.93	0.65	7.40	2.55	7.69	19.6													
D2.6			2.13	0.65	10.37	1.38	6.84	9.5													
D2.7			2.98	0.65	7.22	1.94	7.75	15.0													
D2.8			3.70	0.65	9.24	2.41	7.13	17.2													
D2.9			3.15	0.65	14.83	2.05	5.94	12.2													
D2.10			0.80	0.90	6.24	0.72	8.12	5.8													
D2.11			0.40	0.96	3.68	0.38	9.45	3.6													
D2.12			2.78	0.65	11.27	1.81	6.63	12.0													
D2.13			2.51	0.65	17.67	1.63	5.50	9.0													

Provide interim off-site basin calculations.



Standard Form SF-1. Time of Concentration-Proposed

Calculated By: Leonard Beasley
 Date: August 16, 2016, June 30, 2017
 Checked By: Leonard Beasley

Job No: 100.040
 Project: Lorson Ranch East Preliminary Drainage

Sub-Basin Data				Initial Overland Time (t _i)				Travel Time (t _t)					t _c Check (urbanized Basins)		Final t _c
BASIN or DESIGN	C _s	AREA (A) acres	NRCS Convey.	LENGTH (L) feet	SLOPE (S) %	VELOCITY (V) ft/sec	t _i minutes	LENGTH (L) feet	SLOPE (S) %	VELOCITY (V) ft/sec	t _t minutes	Computed t _c Minutes	TOTAL LENGTH (L) feet	Regional t _c tc=(L/180)+10 minutes	USDCM Recommended tc=ti+tt (min)
C15.4	0.49	1.25	15.0	91.00	7.14%	0.28	5.49	100.0	2.60%	1.41	1.18				
			20.0					406.0	2.02%	2.84	2.38	9.05	597.00	13.32	9.05
C15.5	0.49	2.90	20.0	35.00	2.00%	0.11	5.18	979.0	3.04%	3.49	4.68	9.86	1014.00	15.63	9.86
C15.6	0.49	1.80	15.0	59.00	1.36%	0.13	7.64	100.0	2.00%	2.12	0.79				
			20.0					731.0	1.87%	2.73	4.45	12.88	890.00	14.94	12.88
C15.7	0.49	2.07	20.0	39.00	2.05%	0.12	5.43	966.0	1.63%	2.55	6.31	11.73	1005.00	15.58	11.73
C15.8	0.40	3.76	15.0	100.00	7.00%	0.25	6.65	89.0	11.35%	5.05	0.29				
			15.0					463.0	0.60%	1.16	6.64				
			20.0					240.0	1.08%	2.08	1.92	15.51	892.00	14.96	15.51
C15.9	0.49	2.27	15.0	53.00	1.20%	0.12	7.55	96.0	3.02%	2.61	0.61				
			20.0					8.6	1.61%	2.54	0.06	8.22	157.55	10.88	8.22
C15.10	0.49	0.60	15.0	100.00	2.20%	0.20	8.49	37.0	2.20%	2.22	0.28				
			20.0					160.0	1.51%	2.46	1.09	9.85	297.00	11.65	9.85
C15.11	0.49	3.20	20.0	74.00	4.19%	0.21	5.90	1105.0	2.63%	3.24	5.68	11.58	1179.00	16.55	11.58
C15.12	0.49	0.61	15.0	100.00	2.16%	0.20	8.54	34.0	2.16%	2.20	0.26				
			20.0					321.0	1.00%	2.00	2.68	11.47	455.00	12.53	11.47
C15.13	0.49	2.35	20.0	52.00	2.12%	0.14	6.20	967.0	2.32%	3.05	5.29	11.49	1019.00	15.66	11.49
C15.14	0.49	1.32	20.0	33.00	1.82%	0.11	5.19	595.0	2.89%	3.40	2.92	8.11	628.00	13.49	8.11
C15.15	0.49	4.02	20.0	100.00	2.88%	0.21	7.77	1111.0	2.42%	3.11	5.95	13.72	1211.00	16.73	13.72
C17.1a	0.49	2.81	20.0	90.00	2.00%	0.18	8.31	733.0	2.58%	3.21	3.80	12.11	823.00	14.57	12.11
C17.1	0.49	2.68	15.0	28.00	18.57%	0.21	2.22	160.0	2.88%	2.55	1.05				
			20.0					530.0	1.00%	2.00	4.42	7.69	718.00	13.99	7.69
C17.2	0.49	4.11	20.0	33.00	2.00%	0.11	5.03	903.0	3.27%	3.62	4.16	9.19	936.00	15.20	9.19
C17.3	0.49	2.21	15.0	100.00	8.40%	0.31	5.46	152.0	4.47%	3.17	0.80				
			20.0					416.0	0.97%	1.97	3.52	9.78	668.00	13.71	9.78
C17.4	0.49	1.98	20.0	36.00	2.00%	0.11	5.26	1579.0	1.14%	2.14	12.32	17.58	1615.00	18.97	17.58
C17.5	0.49	3.72	15.0	66.00	7.73%	0.24	4.56	77.0	4.63%	3.23	0.40				
			20.0					1050.0	1.07%	2.07	8.46	13.41	1193.00	16.63	13.41
C17.6	0.49	1.04	20.0	94.00	1.06%	0.15	10.47	527.0	1.65%	2.57	3.42	13.89	621.00	13.45	13.89
C17.7	0.49	2.68	15.0	90.00	4.44%	0.23	6.39	107.0	0.93%	1.45	1.23	7.62	197.00	11.09	7.62
C17.8	0.55	1.52	20.0	100.00	3.00%	0.24	6.91	643.0	0.95%	1.95	5.50	12.41	743.00	14.13	12.41
C17.9	0.90	1.73	20.0	31.00	2.00%	0.32	1.60	464.0	0.91%	1.91	4.05	5.65	495.00	12.75	5.65
C17.10	0.90	2.34	20.0	45.00	2.00%	0.39	1.93	723.0	0.66%	1.62	7.42	9.34	768.00	14.27	9.34
D1.1	0.49	5.09	20.0	100.00	1.50%	0.17	9.63	1484.0	2.00%	2.83	8.74	18.38	1584.00	18.80	18.38
D1.2	0.49	1.10	15.0	65.00	7.85%	0.24	4.50	81.0	2.72%	2.47	0.55				



Standard Form SF-1. Time of Concentration-Proposed

Calculated By: Leonard Beasley
 Date: August 16, 2016, June 30, 2017
 Checked By: Leonard Beasley

Job No: 100.040
 Project: Lorson Ranch East Preliminary Drainage

Sub-Basin Data				Initial Overland Time (t _i)				Travel Time (t _t)					t _c Check (urbanized Basins)		Final t _c
BASIN or DESIGN	C _s	AREA (A) acres	NRCS Convey.	LENGTH (L) feet	SLOPE (S) %	VELOCITY (V) ft/sec	t _i minutes	LENGTH (L) feet	SLOPE (S) %	VELOCITY (V) ft/sec	t _t minutes	Computed t _c Minutes	TOTAL LENGTH (L) feet	Regional t _c =(L/180)+10 minutes	USDCM Recommended t _c =t _i +t _t (min)
			20.0					309.0	2.01%	2.84	1.82	6.86	455.00	12.53	6.86
D1.3	0.49	0.86	20.0	100.00	2.60%	0.21	8.03	420.0	1.79%	2.68	2.62	10.65	520.00	12.89	10.65
D1.4	0.49	2.80	15.0	100.00	1.60%	0.18	9.43	33.0	2.42%	2.33	0.24				
			20.0					582.0	3.18%	3.57	2.72	12.39	715.00	13.97	12.39
D1.5	0.49	5.15	20.0	36.00	4.22%	0.15	4.11	1132.0	3.14%	3.54	5.32	9.43	1168.00	16.49	9.43
D1.6	0.49	5.10	20.0	90.00	1.44%	0.16	9.26	1421.0	2.51%	3.17	7.47	16.74	1511.00	18.39	16.74
D1.7	0.49	3.50	15.0	90.00	12.33%	0.33	4.56	107.0	3.74%	2.90	0.61				
			20.0					781.0	1.55%	2.49	5.23	10.40	978.00	15.43	10.40
D1.8	0.49	1.70	20.0	45.00	1.11%	0.11	7.14	1004.0	2.56%	3.20	5.23	12.37	1049.00	15.83	12.37
D1.9	0.49	2.20	20.0	50.00	2.00%	0.13	6.20	1265.0	2.63%	3.24	6.50	12.70	1315.00	17.31	12.70
D1.10	0.49	5.50	20.0	47.00	2.49%	0.14	5.59	1460.0	2.43%	3.12	7.80	13.39	1507.00	18.37	13.39
D1.11	0.49	1.40	20.0	50.00	2.00%	0.13	6.20	951.0	1.64%	2.56	6.19	12.38	1001.00	15.56	12.38
D1.12	0.24	4.45	15.0	95.00	7.16%	0.20	7.90	177.0	6.78%	3.91	0.76				
			15.0					463.0	0.50%	1.06	7.28	15.93	735.00	14.08	14.08
D2.1	0.49	3.14	15.0	100.00	2.32%	0.20	8.34	90.0	2.32%	2.28	0.66				
			20.0					897.0	1.62%	2.55	5.87	14.87	1087.00	16.04	14.87
D2.2	0.49	1.11	15.0	100.00	1.70%	0.18	9.24	167.0	3.47%	2.79	1.00				
			20.0					218.0	1.15%	2.14	1.69	11.93	485.00	12.69	11.93
D2.3	0.27	2.80	15.0	100.00	2.10%	0.14	11.73	344.0	4.77%	3.28	1.75				
			20.0					292.0	3.20%	3.58	1.36	14.84	736.00	14.09	14.09
D2.4	0.29	3.33	15.0	100.00	4.50%	0.19	8.90	386.0	6.30%	3.76	1.71				
			20.0					487.0	2.00%	2.83	2.87	13.48	973.00	15.41	13.48
D2.5	0.49	3.93	15.0	61.00	14.75%	0.29	3.54	219.0	2.19%	2.22	1.64				
			20.0					447.0	2.82%	3.36	2.22	7.40	727.00	14.04	7.40
D2.6	0.49	2.13	15.0	100.00	3.00%	0.22	7.66	20.0	2.50%	2.37	0.14				
			20.0					528.0	2.94%	3.43	2.57	10.37	648.00	13.60	10.37
D2.7	0.49	2.98	20.0	25.00	2.00%	0.10	4.38	631.0	3.44%	3.71	2.84	7.22	656.00	13.64	7.22
D2.8	0.49	3.70	15.0	35.00	15.71%	0.22	2.63	162.0	2.34%	2.29	1.18				
			20.0					665.0	1.04%	2.04	5.43	9.24	862.00	14.79	9.24
D2.9	0.49	3.15	20.0	75.00	1.87%	0.16	7.76	1342.0	2.50%	3.16	7.07	14.83	1417.00	17.87	14.83
D2.10	0.49	0.80	20.0	17.00	2.00%	0.08	3.61	392.0	1.54%	2.48	2.63	6.24	409.00	12.27	6.24
D2.11	0.90	0.40	20.0	10.00	2.00%	0.18	0.91	278.0	0.70%	1.67	2.77	3.68	288.00	11.60	3.68
D2.12	0.49	2.78	20.0	100.00	5.20%	0.26	6.39	1009.0	2.97%	3.45	4.88	11.27	1109.00	16.16	11.27
D2.13	0.49	2.51	20.0	20.00	2.00%	0.09	3.92	2334.0	2.00%	2.83	13.75	17.67	2354.00	23.08	17.67

APPENDIX C – HYDRAULIC CALCULATIONS

Channel Report

Hydraflow Express by Intelisolve

Wednesday, Mar 8 2017, 6:4 AM

Lamine low point to Pond D2 Overflow Swale - Design Point 56

Trapezoidal


Bottom Width (ft) = 8.00
Side Slope (z:1) = 4.00
Total Depth (ft) = 2.50
Invert Elev (ft) = 100.00
Slope (%) = 2.00
N-Value = 0.024

Highlighted

Depth (ft) = 1.34
Q (cfs) = 150.00
Area (sqft) = 17.90
Velocity (ft/s) = 8.38
Wetted Perim (ft) = 19.05
Crit Depth, Y_c (ft) = 1.68
Top Width (ft) = 18.72
EGL (ft) = 2.43


Calculations

Compute by: Known Q
Known Q (cfs) = 150.00

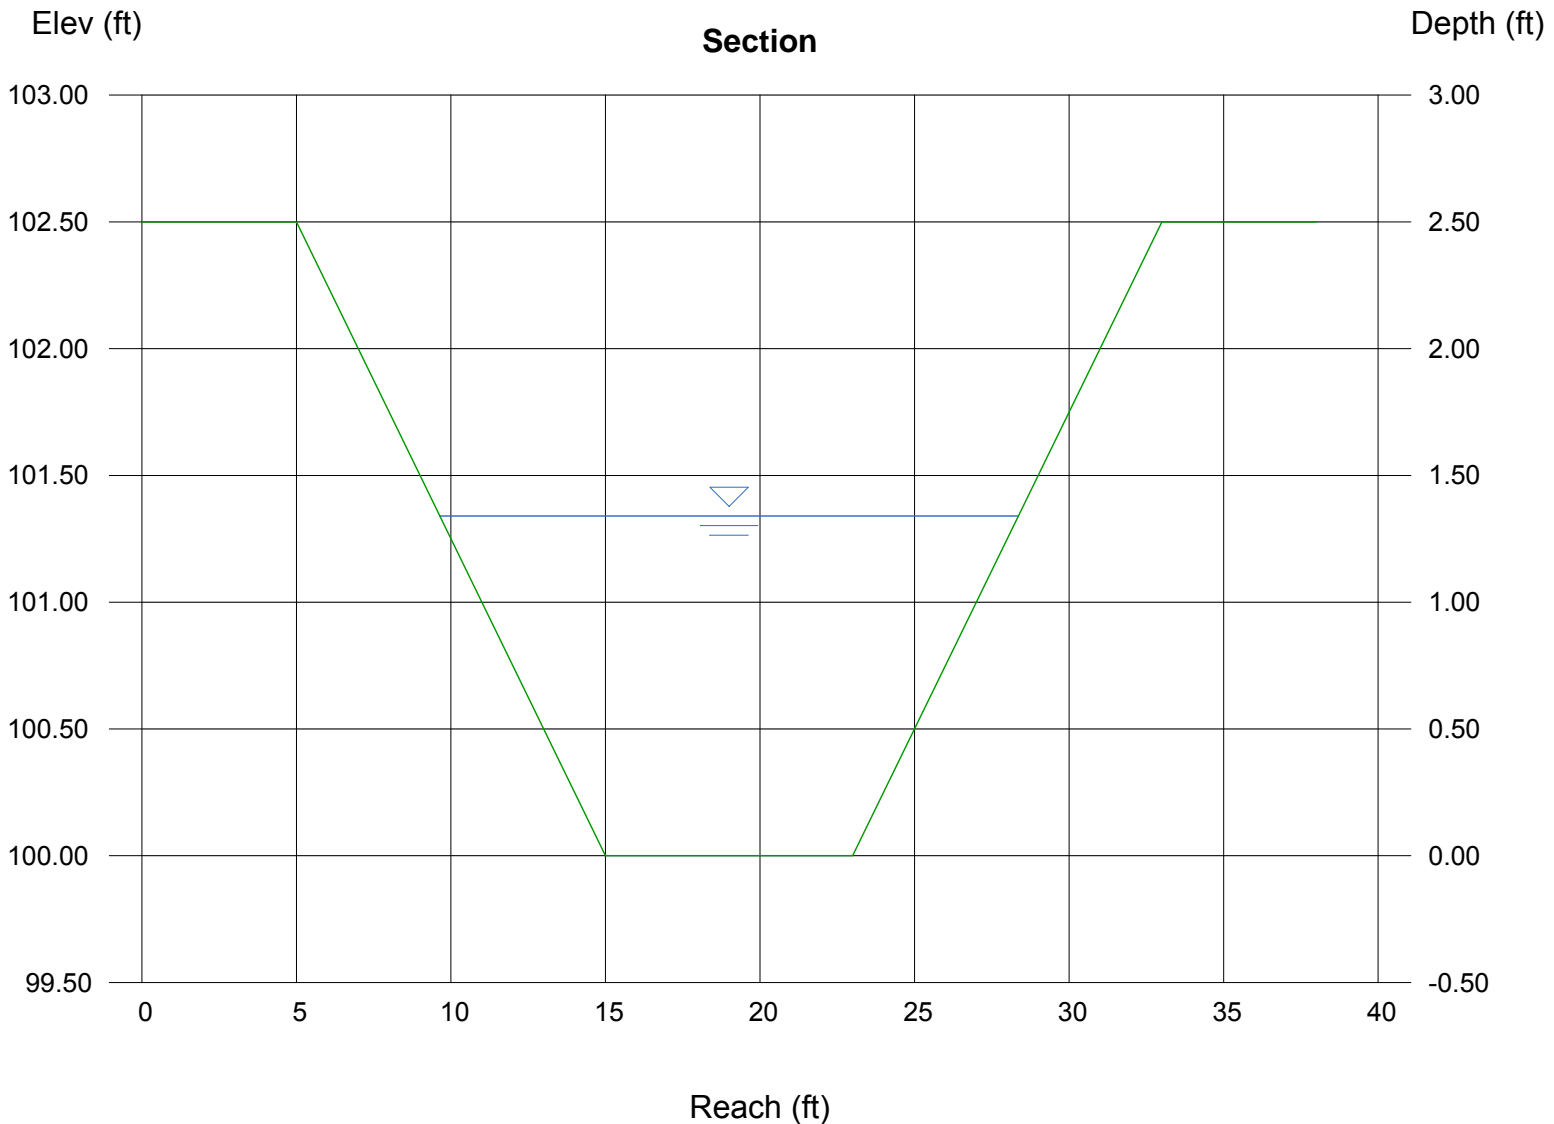

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-28 (Basin C17.1a)

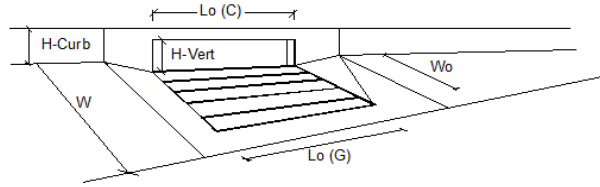

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{LOCAL} = 3.0$	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	$N_o = 1$	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	$L_o = 15.00$	15.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	$W_o = N/A$	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r-G = N/A$	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r-C = 0.10$	0.10	
Street Hydraulics: OK - $Q <$ maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	$Q_o = 5.3$	11.5	cfs
Water Spread Width	$T = 10.8$	15.1	ft
Water Depth at Flowline (outside of local depression)	$d = 4.1$	5.1	inches
Water Depth at Street Crown (or at T_{MAX})	$d_{CROWN} = 0.0$	0.0	inches
Ratio of Gutter Flow to Design Flow	$E_o = 0.541$	0.396	
Discharge outside the Gutter Section W, carried in Section T_x	$Q_x = 2.4$	7.0	cfs
Discharge within the Gutter Section W	$Q_w = 2.9$	4.6	cfs
Discharge Behind the Curb Face	$Q_{BACK} = 0.0$	0.0	cfs
Flow Area within the Gutter Section W	$A_w = 1.29$	2.39	sq ft
Velocity within the Gutter Section W	$V_w = 4.1$	4.8	fps
Water Depth for Design Condition	$d_{LOCAL} = 7.1$	8.1	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	$L = N/A$	N/A	ft
Ratio of Grate Flow to Design Flow	$E_{o-GRATE} = N/A$	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Interception Capacity	$Q_i = N/A$	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	$GrateCoef = N/A$	N/A	
Clogging Factor for Multiple-unit Grate Inlet	$GrateClog = N/A$	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	$L_e = N/A$	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Actual Interception Capacity	$Q_a = N/A$	N/A	cfs
Carry-Over Flow = $Q_o - Q_a$ (to be applied to curb opening or next d/s inlet)	$Q_b = N/A$	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S_e (based on grate carry-over)	$S_e = 0.122$	0.094	ft/ft
Required Length L_T to Have 100% Interception	$L_T = 12.04$	20.09	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L , L_T)	$L = 12.04$	15.00	ft
Interception Capacity	$Q_i = 5.3$	10.5	cfs
Under Clogging Condition			
Clogging Coefficient	$CurbCoef = 1.31$	1.31	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	$CurbClog = 0.04$	0.04	
Effective (Unclogged) Length	$L_e = 13.03$	13.03	ft
Actual Interception Capacity	$Q_a = 5.3$	10.4	cfs
Carry-Over Flow = $Q_o - Q_a$	$Q_b = 0.0$	1.2	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	$Q = 5.30$	10.36	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	$Q_b = 0.0$	1.2	cfs
Capture Percentage = $Q_i/Q_o =$	$C\% = 100$	90	%

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-38 (Basin C17.1+bypass from Inlet DP-28)

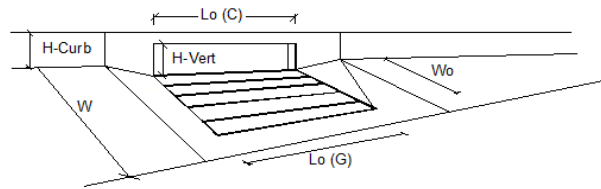

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type = CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{LOCAL} = 3.0$	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No = 1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	$L_o = 15.00$	15.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	$W_o = N/A$	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r-G = N/A$	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r-C = 0.10$	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	$Q_o = 5.9$	14.4	cfs
Water Spread Width	T = 13.6	17.0	ft
Water Depth at Flowline (outside of local depression)	d = 4.8	6.2	inches
Water Depth at Street Crown (or at T_{MAX})	$d_{CROWN} = 0.0$	0.6	inches
Ratio of Gutter Flow to Design Flow	$E_o = 0.437$	0.304	
Discharge outside the Gutter Section W, carried in Section T_x	$Q_x = 3.3$	10.0	cfs
Discharge within the Gutter Section W	$Q_w = 2.6$	4.4	cfs
Discharge Behind the Curb Face	$Q_{BACK} = 0.0$	0.0	cfs
Flow Area within the Gutter Section W	$A_w = 1.98$	3.91	sq ft
Velocity within the Gutter Section W	$V_w = 3.0$	3.7	fps
Water Depth for Design Condition	$d_{LOCAL} = 7.8$	9.2	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	L = N/A	N/A	ft
Ratio of Grate Flow to Design Flow	$E_{o-GRATE} = N/A$	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Interception Capacity	$Q_i = N/A$	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	GrateCoef = N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	GrateClog = N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	$L_e = N/A$	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Actual Interception Capacity	$Q_a = N/A$	N/A	cfs
Carry-Over Flow = $Q_o - Q_a$ (to be applied to curb opening or next d/s inlet)	$Q_b = N/A$	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S_e (based on grate carry-over)	$S_e = 0.102$	0.077	ft/ft
Required Length L_T to Have 100% Interception	$L_T = 13.12$	23.51	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L_e, L_T)	L = 13.12	15.00	ft
Interception Capacity	$Q_i = 5.9$	12.1	cfs
Under Clogging Condition			
Clogging Coefficient	CurbCoef = 1.31	1.31	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	CurbClog = 0.04	0.04	
Effective (Unclogged) Length	$L_e = 13.03$	13.03	ft
Actual Interception Capacity	$Q_a = 5.9$	11.8	cfs
Carry-Over Flow = $Q_o - Q_a$	$Q_b = 0.0$	2.6	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	Q = 5.90	11.83	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	$Q_b = 0.0$	2.6	cfs
Capture Percentage = $Q_i/Q_o =$	C% = 100	82	%

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-39 (Basin C17.2+bypass from Inlet DP-38)

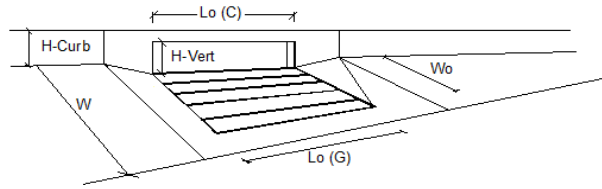

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	15.00	15.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	8.6	21.6	cfs
Water Spread Width	12.5	17.0	ft
Water Depth at Flowline (outside of local depression)	4.5	5.9	inches
Water Depth at Street Crown (or at T _{max})	0.0	0.3	inches
Ratio of Gutter Flow to Design Flow	0.473	0.326	
Discharge outside the Gutter Section W, carried in Section T _x	4.5	14.5	cfs
Discharge within the Gutter Section W	4.1	7.0	cfs
Discharge Behind the Curb Face	0.0	0.0	cfs
Flow Area within the Gutter Section W	1.69	3.45	sq ft
Velocity within the Gutter Section W	5.1	6.2	fps
Water Depth for Design Condition	7.5	8.9	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	N/A	N/A	ft
Ratio of Grate Flow to Design Flow	N/A	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	N/A	N/A	fps
Interception Rate of Frontal Flow	N/A	N/A	
Interception Rate of Side Flow	N/A	N/A	
Interception Capacity	N/A	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	N/A	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	N/A	N/A	fps
Interception Rate of Frontal Flow	N/A	N/A	
Interception Rate of Side Flow	N/A	N/A	
Actual Interception Capacity	N/A	N/A	cfs
Carry-Over Flow = Q _c -Q _a (to be applied to curb opening or next d/s inlet)	N/A	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S _e (based on grate carry-over)	0.109	0.081	ft/ft
Required Length L _T to Have 100% Interception	16.50	30.17	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L, L _T)	15.00	15.00	ft
Interception Capacity	8.5	15.3	cfs
Under Clogging Condition			
Clogging Coefficient	1.31	1.31	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	0.04	0.04	
Effective (Unclogged) Length	13.03	13.03	ft
Actual Interception Capacity	8.4	14.9	cfs
Carry-Over Flow = Q _{b(GRATE)} -Q _a	0.2	6.6	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	8.41	14.93	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	0.2	6.6	cfs
Capture Percentage = Q _i /Q _o =	98	69	%

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-50 (Basins D1.1+D1.2)

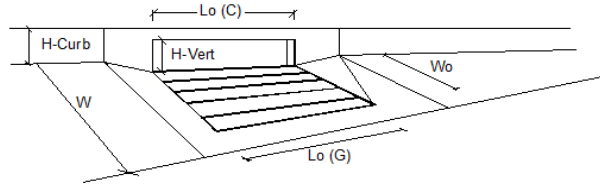

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type = CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	a _{LOCAL} = 3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No = 1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	L _o = 10.00	10.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	W _o = N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	C _{r-G} = N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	C _{r-C} = 0.10	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	Q _o = 10.1	22.3	cfs
Water Spread Width	T = 14.6	17.0	ft
Water Depth at Flowline (outside of local depression)	d = 5.0	6.4	inches
Water Depth at Street Crown (or at T _{max})	d _{CROWN} = 0.0	0.8	inches
Ratio of Gutter Flow to Design Flow	E _o = 0.408	0.296	
Discharge outside the Gutter Section W, carried in Section T _x	Q _x = 6.0	15.7	cfs
Discharge within the Gutter Section W	Q _w = 4.1	6.6	cfs
Discharge Behind the Curb Face	Q _{BACK} = 0.0	0.0	cfs
Flow Area within the Gutter Section W	A _w = 2.25	4.09	sq ft
Velocity within the Gutter Section W	V _w = 4.5	5.5	fps
Water Depth for Design Condition	d _{LOCAL} = 8.0	9.4	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	L = N/A	N/A	ft
Ratio of Grate Flow to Design Flow	E _{o-GRATE} = N/A	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	V _o = N/A	N/A	fps
Interception Rate of Frontal Flow	R _f = N/A	N/A	
Interception Rate of Side Flow	R _s = N/A	N/A	
Interception Capacity	Q _i = N/A	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	GrateCoef = N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	GrateClog = N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	L _e = N/A	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	V _o = N/A	N/A	fps
Interception Rate of Frontal Flow	R _f = N/A	N/A	
Interception Rate of Side Flow	R _s = N/A	N/A	
Actual Interception Capacity	Q _a = N/A	N/A	cfs
Carry-Over Flow = Q_o - Q_a (to be applied to curb opening or next d/s inlet)	Q _b = N/A	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S _e (based on grate carry-over)	S _e = 0.097	0.076	ft/ft
Required Length L _T to Have 100% Interception	L _T = 18.43	30.94	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L _e , L _T)	L = 10.00	10.00	ft
Interception Capacity	Q _i = 7.6	11.2	cfs
Under Clogging Condition			
Clogging Coefficient	CurbCoef = 1.25	1.25	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	CurbClog = 0.06	0.06	
Effective (Unclogged) Length	L _e = 8.75	8.75	ft
Actual Interception Capacity	Q _a = 7.3	10.8	cfs
Carry-Over Flow = Q_o(GRATE) - Q_a	Q _b = 2.7	11.5	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	Q = 7.34	10.77	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	Q _b = 2.7	11.5	cfs
Capture Percentage = Q_i/Q_o =	C% = 73	48	%

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-52 (Basin D1.4+D1.5)

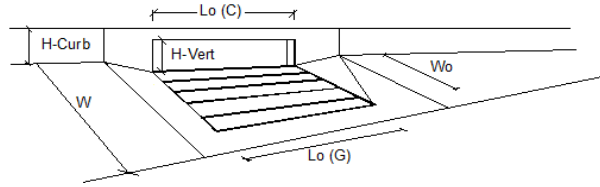

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	15.00	15.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10	
Street Hydraulics: WARNING: Q > ALLOWABLE Q FOR MAJOR STORM			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	15.5	34.7	cfs
Water Spread Width	16.5	17.0	ft
Water Depth at Flowline (outside of local depression)	5.5	7.0	inches
Water Depth at Street Crown (or at T_{max})	0.0	1.4	inches
Ratio of Gutter Flow to Design Flow	0.362	0.265	
Discharge outside the Gutter Section W, carried in Section T_x	9.9	25.2	cfs
Discharge within the Gutter Section W	5.6	9.1	cfs
Discharge Behind the Curb Face	0.0	0.4	cfs
Flow Area within the Gutter Section W	2.85	5.00	sq ft
Velocity within the Gutter Section W	5.4	6.9	fps
Water Depth for Design Condition	8.5	10.0	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	N/A	N/A	ft
Ratio of Grate Flow to Design Flow	N/A	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	N/A	N/A	fps
Interception Rate of Frontal Flow	N/A	N/A	
Interception Rate of Side Flow	N/A	N/A	
Interception Capacity	N/A	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	N/A	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	N/A	N/A	fps
Interception Rate of Frontal Flow	N/A	N/A	
Interception Rate of Side Flow	N/A	N/A	
Actual Interception Capacity	N/A	N/A	cfs
Carry-Over Flow = $Q_c - Q_a$ (to be applied to curb opening or next d/s inlet)	N/A	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S_e (based on grate carry-over)	0.088	0.070	ft/ft
Required Length L_T to Have 100% Interception	24.34	40.62	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L, L_T)	15.00	15.00	ft
Interception Capacity	12.7	19.3	cfs
Under Clogging Condition			
Clogging Coefficient	1.31	1.31	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	0.04	0.04	
Effective (Unclogged) Length	13.03	13.03	ft
Actual Interception Capacity	12.4	18.8	cfs
Carry-Over Flow = $Q_{b(GRATE)} - Q_a$	3.0	15.9	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	12.44	18.80	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	3.0	15.9	cfs
Capture Percentage = Q_c/Q_o	80	54	%

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-53 (Basin D1.6+D1.8+bypass from Inlet DP-52)

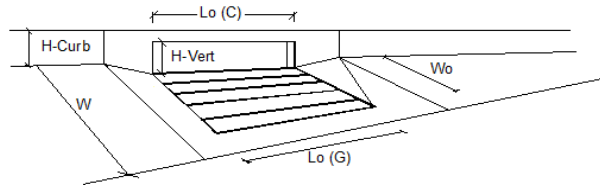

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type = CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	a _{LOCAL} = 3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No = 1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	L _o = 20.00	20.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	W _o = N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	C _{r-G} = N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	C _{r-C} = 0.10	0.10	
Street Hydraulics: WARNING: Q > ALLOWABLE Q FOR MAJOR STORM			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	Q _o = 14.6	41.5	cfs
Water Spread Width	T = 15.6	17.0	ft
Water Depth at Flowline (outside of local depression)	d = 5.3	7.2	inches
Water Depth at Street Crown (or at T _{max})	d _{CROWN} = 0.0	1.6	inches
Ratio of Gutter Flow to Design Flow	E _o = 0.382	0.256	
Discharge outside the Gutter Section W, carried in Section T _x	Q _x = 9.1	30.3	cfs
Discharge within the Gutter Section W	Q _w = 5.6	10.4	cfs
Discharge Behind the Curb Face	Q _{BACK} = 0.0	0.8	cfs
Flow Area within the Gutter Section W	A _w = 2.57	5.32	sq ft
Velocity within the Gutter Section W	V _w = 5.7	7.7	fps
Water Depth for Design Condition	d _{LOCAL} = 8.3	10.2	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	L = N/A	N/A	ft
Ratio of Grate Flow to Design Flow	E _{o-GRATE} = N/A	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	V _o = N/A	N/A	fps
Interception Rate of Frontal Flow	R _f = N/A	N/A	
Interception Rate of Side Flow	R _s = N/A	N/A	
Interception Capacity	Q _i = N/A	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	GrateCoef = N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	GrateClog = N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	L _e = N/A	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	V _o = N/A	N/A	fps
Interception Rate of Frontal Flow	R _f = N/A	N/A	
Interception Rate of Side Flow	R _s = N/A	N/A	
Actual Interception Capacity	Q _a = N/A	N/A	cfs
Carry-Over Flow = Q_o - Q_a (to be applied to curb opening or next d/s inlet)	Q _b = N/A	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S _e (based on grate carry-over)	S _e = 0.092	0.068	ft/ft
Required Length L _T to Have 100% Interception	L _T = 23.41	45.23	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L _e , L _T)	L = 20.00	20.00	ft
Interception Capacity	Q _i = 14.2	26.5	cfs
Under Clogging Condition			
Clogging Coefficient	CurbCoef = 1.33	1.33	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	CurbClog = 0.03	0.03	
Effective (Unclogged) Length	L _e = 17.34	17.34	ft
Actual Interception Capacity	Q _a = 14.0	26.0	cfs
Carry-Over Flow = Q_o(GRATE) - Q_a	Q _b = 0.6	15.5	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	Q = 14.05	25.97	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	Q _b = 0.6	15.5	cfs
Capture Percentage = Q_i/Q_o =	C% = 96	63	%

INLET ON A CONTINUOUS GRADE


Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-54 (Basin D1.7)

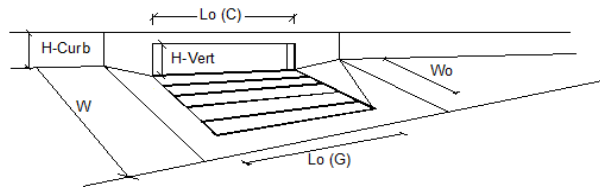

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type = CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{LOCAL} = 3.0$	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No = 1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	$L_o = 15.00$	15.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	$W_o = N/A$	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r-G = N/A$	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r-C = 0.10$	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	$Q_o = 7.3$	16.1	cfs
Water Spread Width	$T = 14.6$	17.0	ft
Water Depth at Flowline (outside of local depression)	$d = 5.0$	6.4	inches
Water Depth at Street Crown (or at T_{MAX})	$d_{CROWN} = 0.0$	0.8	inches
Ratio of Gutter Flow to Design Flow	$E_o = 0.408$	0.296	
Discharge outside the Gutter Section W, carried in Section T_x	$Q_x = 4.3$	11.3	cfs
Discharge within the Gutter Section W	$Q_w = 3.0$	4.8	cfs
Discharge Behind the Curb Face	$Q_{BACK} = 0.0$	0.0	cfs
Flow Area within the Gutter Section W	$A_w = 2.26$	4.09	sq ft
Velocity within the Gutter Section W	$V_w = 3.2$	3.9	fps
Water Depth for Design Condition	$d_{LOCAL} = 8.0$	9.4	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	$L = N/A$	N/A	ft
Ratio of Grate Flow to Design Flow	$E_{o-GRATE} = N/A$	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Interception Capacity	$Q_i = N/A$	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	$GrateCoef = N/A$	N/A	
Clogging Factor for Multiple-unit Grate Inlet	$GrateClog = N/A$	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	$L_e = N/A$	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Actual Interception Capacity	$Q_a = N/A$	N/A	cfs
Carry-Over Flow = $Q_o - Q_a$ (to be applied to curb opening or next d/s inlet)	$Q_b = N/A$	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S_e (based on grate carry-over)	$S_e = 0.097$	0.076	ft/ft
Required Length L_T to Have 100% Interception	$L_T = 15.05$	25.23	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L , L_T)	$L = 15.00$	15.00	ft
Interception Capacity	$Q_i = 7.3$	12.9	cfs
Under Clogging Condition			
Clogging Coefficient	$CurbCoef = 1.31$	1.31	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	$CurbClog = 0.04$	0.04	
Effective (Unclogged) Length	$L_e = 13.03$	13.03	ft
Actual Interception Capacity	$Q_a = 7.3$	12.6	cfs
Carry-Over Flow = $Q_o - Q_a$	$Q_b = 0.0$	3.5	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	$Q = 7.26$	12.63	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	$Q_b = 0.0$	3.5	cfs
Capture Percentage = $Q_i/Q_o =$	$C\% = 100$	78	%

INLET ON A CONTINUOUS GRADE

Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-55a (Basin D1.10)

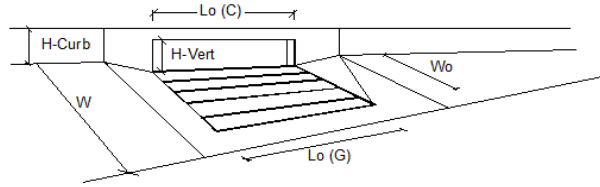

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{LOCAL} = 3.0$	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	$N_o = 1$	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	$L_o = 10.00$	10.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	$W_o = N/A$	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r-G = N/A$	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r-C = 0.10$	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	$Q_o = 10.2$	22.6	cfs
Water Spread Width	$T = 14.7$	17.0	ft
Water Depth at Flowline (outside of local depression)	$d = 5.0$	6.4	inches
Water Depth at Street Crown (or at T_{MAX})	$d_{CROWN} = 0.0$	0.8	inches
Ratio of Gutter Flow to Design Flow	$E_o = 0.406$	0.295	
Discharge outside the Gutter Section W, carried in Section T_x	$Q_x = 6.1$	15.9	cfs
Discharge within the Gutter Section W	$Q_w = 4.1$	6.7	cfs
Discharge Behind the Curb Face	$Q_{BACK} = 0.0$	0.0	cfs
Flow Area within the Gutter Section W	$A_w = 2.28$	4.13	sq ft
Velocity within the Gutter Section W	$V_w = 4.5$	5.5	fps
Water Depth for Design Condition	$d_{LOCAL} = 8.0$	9.4	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	$L = N/A$	N/A	ft
Ratio of Grate Flow to Design Flow	$E_{o-GRATE} = N/A$	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Interception Capacity	$Q_i = N/A$	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	$GrateCoef = N/A$	N/A	
Clogging Factor for Multiple-unit Grate Inlet	$GrateClog = N/A$	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	$L_e = N/A$	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Actual Interception Capacity	$Q_a = N/A$	N/A	cfs
Carry-Over Flow = $Q_o - Q_a$ (to be applied to curb opening or next d/s inlet)	$Q_b = N/A$	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S_e (based on grate carry-over)	$S_e = 0.096$	0.075	ft/ft
Required Length L_T to Have 100% Interception	$L_T = 18.57$	31.20	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L , L_T)	$L = 10.00$	10.00	ft
Interception Capacity	$Q_i = 7.6$	11.3	cfs
Under Clogging Condition			
Clogging Coefficient	$CurbCoef = 1.25$	1.25	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	$CurbClog = 0.06$	0.06	
Effective (Unclogged) Length	$L_e = 8.75$	8.75	ft
Actual Interception Capacity	$Q_a = 7.4$	10.8	cfs
Carry-Over Flow = $Q_o - Q_a$	$Q_b = 2.8$	11.8	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	$Q = 7.38$	10.83	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	$Q_b = 2.8$	11.8	cfs
Capture Percentage = $Q_i/Q_o =$	$C\% = 72$	48	%


INLET IN A SUMP OR SAG LOCATION

Project =

Lorson East Prelim Plan #100.040

Inlet ID =

Inlet DP-55 (Basin D1.9+bypass from Inlet DP55a+bypass from Inlet DP53)

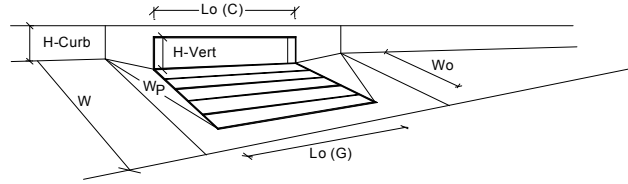

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{local} = 3.00$	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	$N_o = 1$	1	
Water Depth at Flowline (outside of local depression)	Ponding Depth = 6.5	8.0	inches <input checked="" type="checkbox"/> Override Depths
Grate Information			
Length of a Unit Grate	$L_o (G) = N/A$	N/A	feet
Width of a Unit Grate	$W_o = N/A$	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	$A_{ratio} = N/A$	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	$C_r (G) = N/A$	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	$C_w (G) = N/A$	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	$C_o (G) = N/A$	N/A	
Curb Opening Information			
Length of a Unit Curb Opening	$L_o (C) = 25.00$	25.00	feet
Height of Vertical Curb Opening in Inches	$H_{vert} = 6.00$	6.00	inches
Height of Curb Orifice Throat in Inches	$H_{throat} = 6.00$	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	$\theta = 63.40$	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	$W_p = 2.00$	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	$C_r (C) = 0.10$	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	$C_w (C) = 3.60$	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	$C_o (C) = 0.67$	0.67	
Grate Flow Analysis (Calculated)			
Clogging Coefficient for Multiple Units	Coef = N/A	N/A	
Clogging Factor for Multiple Units	Clog = N/A	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	$Q_{wi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{wa} = N/A$	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	$Q_{oi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{oa} = N/A$	N/A	cfs
Grate Capacity as Mixed Flow			
Interception without Clogging	$Q_{mi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{ma} = N/A$	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	$Q_{Grate} = N/A$	N/A	cfs
Curb Opening Flow Analysis (Calculated)			
Clogging Coefficient for Multiple Units	Coef = 1.33	1.33	
Clogging Factor for Multiple Units	Clog = 0.03	0.03	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	$Q_{wi} = 19.14$	32.57	cfs
Interception with Clogging	$Q_{wa} = 18.63$	31.70	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	$Q_{oi} = 50.55$	55.95	cfs
Interception with Clogging	$Q_{oa} = 49.20$	54.47	cfs
Curb Opening Capacity as Mixed Flow			
Interception without Clogging	$Q_{mi} = 28.92$	39.70	cfs
Interception with Clogging	$Q_{ma} = 28.16$	38.64	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	$Q_{curb} = 18.63$	31.70	cfs
Resultant Street Conditions			
Total Inlet Length	$L = 25.00$	25.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	$T = 20.7$	27.0	ft.>T-Crown
Resultant Flow Depth at Street Crown	$d_{CROWN} = 0.9$	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)			
	$Q_a = 18.6$	31.7	cfs
WARNING: Inlet Capacity less than Q Peak for MAJOR Storm	$Q_{PEAK REQUIRED} = 7.8$	40.0	cfs


INLET IN A SUMP OR SAG LOCATION

Project =

Lorson East Prelim Plan #100.040

Inlet ID =


Inlet DP-56 (Basin D1.11+bypass from Inlet DP50) +bypass from Inlet DP-55 in 100yr

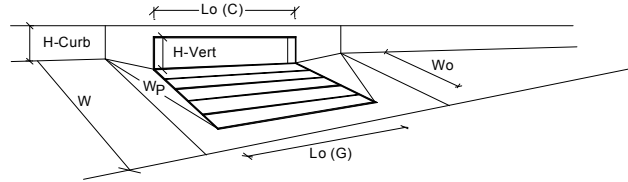

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow)	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.5	8.0	inches
Grate Information	MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
Curb Opening Information	MINOR	MAJOR	
Length of a Unit Curb Opening	25.00	25.00	feet
Height of Vertical Curb Opening in Inches	6.00	6.00	inches
Height of Curb Orifice Throat in Inches	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
Grate Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	N/A	N/A	
Clogging Factor for Multiple Units	N/A	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	N/A	N/A	cfs
Interception with Clogging	N/A	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	N/A	N/A	cfs
Interception with Clogging	N/A	N/A	cfs
Grate Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	N/A	N/A	cfs
Interception with Clogging	N/A	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	N/A	N/A	cfs
Curb Opening Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	1.33	1.33	
Clogging Factor for Multiple Units	0.03	0.03	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	19.14	32.57	cfs
Interception with Clogging	18.63	31.70	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	50.55	55.95	cfs
Interception with Clogging	49.20	54.47	cfs
Curb Opening Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	28.92	39.70	cfs
Interception with Clogging	28.16	38.64	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	18.63	31.70	cfs
Resultant Street Conditions	MINOR	MAJOR	
Total Inlet Length	25.00	25.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	20.7	27.0	ft.>T-Crown
Resultant Flow Depth at Street Crown	0.9	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)	18.6	31.7	cfs
Inlet Capacity IS GOOD for Minor and Major Storms (>Q PEAK)	7.2	29.7	cfs

INLET IN A SUMP OR SAG LOCATION


Project = **Lorson East Prelim Plan #100.040**
 Inlet ID = **Inlet DP-59a (Basin D2.2)**

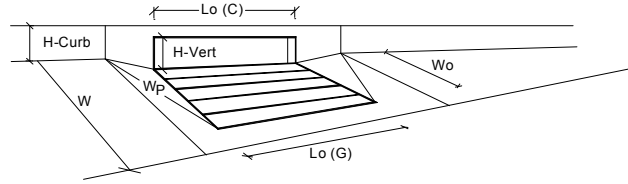

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{local} = 3.00$	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	$N_o = 1$	1	
Water Depth at Flowline (outside of local depression)	Ponding Depth = 6.5	8.0	inches <input checked="" type="checkbox"/> Override Depths
Grate Information	MINOR	MAJOR	
Length of a Unit Grate	$L_o (G) = N/A$	N/A	feet
Width of a Unit Grate	$W_o = N/A$	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	$A_{ratio} = N/A$	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	$C_r (G) = N/A$	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	$C_w (G) = N/A$	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	$C_o (G) = N/A$	N/A	
Curb Opening Information	MINOR	MAJOR	
Length of a Unit Curb Opening	$L_o (C) = 5.00$	5.00	feet
Height of Vertical Curb Opening in Inches	$H_{vert} = 6.00$	6.00	inches
Height of Curb Orifice Throat in Inches	$H_{throat} = 6.00$	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	$\theta = 63.40$	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	$W_p = 2.00$	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	$C_r (C) = 0.10$	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	$C_w (C) = 3.60$	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	$C_o (C) = 0.67$	0.67	
Grate Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	$Coef = N/A$	N/A	
Clogging Factor for Multiple Units	$Clog = N/A$	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{wi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{wa} = N/A$	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{oi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{oa} = N/A$	N/A	cfs
Grate Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	$Q_{mi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{ma} = N/A$	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	$Q_{Grate} = N/A$	N/A	cfs
Curb Opening Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	$Coef = 1.00$	1.00	
Clogging Factor for Multiple Units	$Clog = 0.10$	0.10	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{wi} = 7.06$	10.97	cfs
Interception with Clogging	$Q_{wa} = 6.35$	9.87	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{oi} = 10.11$	11.19	cfs
Interception with Clogging	$Q_{oa} = 9.10$	10.07	cfs
Curb Opening Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	$Q_{mi} = 7.86$	10.30	cfs
Interception with Clogging	$Q_{ma} = 7.07$	9.27	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	$Q_{Curb} = 6.35$	9.27	cfs
Resultant Street Conditions	MINOR	MAJOR	
Total Inlet Length	$L = 5.00$	5.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	$T = 20.7$	27.0	ft. > T-Crown
Resultant Flow Depth at Street Crown	$d_{CROWN} = 0.9$	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)	$Q_a = 6.4$	9.3	cfs
Inlet Capacity IS GOOD for Minor and Major Storms (>Q PEAK)	$Q_{PEAK REQUIRED} = 2.2$	4.8	cfs

INLET IN A SUMP OR SAG LOCATION


Project = **Lorson East Prelim Plan #100.040**
 Inlet ID = **Inlet DP-59d (Basin D2.1+D2.3)**

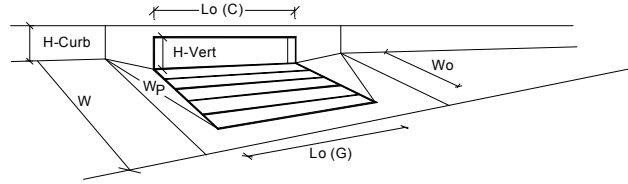

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	a _{local} = 3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	No = 1	1	
Water Depth at Flowline (outside of local depression)	Ponding Depth = 6.5	8.0	inches
Grate Information			
Length of a Unit Grate	L _o (G) = N/A	N/A	feet
Width of a Unit Grate	W _g = N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	A _{ratio} = N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	C _r (G) = N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	C _w (G) = N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	C _o (G) = N/A	N/A	
Curb Opening Information			
Length of a Unit Curb Opening	L _o (C) = 15.00	15.00	feet
Height of Vertical Curb Opening in Inches	H _{vert} = 6.00	6.00	inches
Height of Curb Orifice Throat in Inches	H _{throat} = 6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	Theta = 63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	W _p = 2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	C _r (C) = 0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	C _w (C) = 3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	C _o (C) = 0.67	0.67	
Grate Flow Analysis (Calculated)			
Clogging Coefficient for Multiple Units	Coef = N/A	N/A	
Clogging Factor for Multiple Units	Clog = N/A	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{wi} = N/A	N/A	cfs
Interception with Clogging	Q _{wa} = N/A	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{oi} = N/A	N/A	cfs
Interception with Clogging	Q _{oa} = N/A	N/A	cfs
Grate Capacity as Mixed Flow			
Interception without Clogging	Q _{mi} = N/A	N/A	cfs
Interception with Clogging	Q _{ma} = N/A	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	Q _{Grate} = N/A	N/A	cfs
Curb Opening Flow Analysis (Calculated)			
Clogging Coefficient for Multiple Units	Coef = 1.31	1.31	
Clogging Factor for Multiple Units	Clog = 0.04	0.04	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{wi} = 12.45	21.18	cfs
Interception with Clogging	Q _{wa} = 11.90	20.25	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{oi} = 30.33	33.57	cfs
Interception with Clogging	Q _{oa} = 29.00	32.11	cfs
Curb Opening Capacity as Mixed Flow			
Interception without Clogging	Q _{mi} = 18.07	24.80	cfs
Interception with Clogging	Q _{ma} = 17.28	23.72	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	Q _{curb} = 11.90	20.25	cfs
Resultant Street Conditions			
Total Inlet Length	L = 15.00	15.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	T = 20.7	27.0	ft.>T-Crown
Resultant Flow Depth at Street Crown	d _{CROWN} = 0.9	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)			
	Q _a = 11.9	20.3	cfs
WARNING: Inlet Capacity less than Q Peak for MAJOR Storm	Q _{PEAK REQUIRED} = 10.7	23.7	cfs

INLET ON A CONTINUOUS GRADE

Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-59f (Basins D2.4+D2.5)

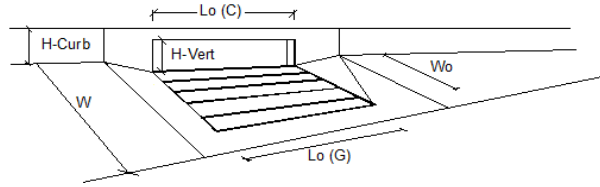


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type = CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{LOCAL} = 3.0$	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No = 1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	$L_o = 10.00$	10.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	$W_o = N/A$	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r-G = N/A$	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r-C = 0.10$	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	$Q_o = 13.6$	30.5	cfs
Water Spread Width	T = 15.8	17.0	ft
Water Depth at Flowline (outside of local depression)	d = 5.3	6.8	inches
Water Depth at Street Crown (or at T_{MAX})	$d_{CROWN} = 0.0$	1.2	inches
Ratio of Gutter Flow to Design Flow	$E_o = 0.378$	0.275	
Discharge outside the Gutter Section W, carried in Section T_x	$Q_x = 8.5$	22.0	cfs
Discharge within the Gutter Section W	$Q_w = 5.2$	8.3	cfs
Discharge Behind the Curb Face	$Q_{BACK} = 0.0$	0.2	cfs
Flow Area within the Gutter Section W	$A_w = 2.61$	4.66	sq ft
Velocity within the Gutter Section W	$V_w = 5.2$	6.5	fps
Water Depth for Design Condition	$d_{LOCAL} = 8.3$	9.8	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	L = N/A	N/A	ft
Ratio of Grate Flow to Design Flow	$E_{o-GRATE} = N/A$	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Interception Capacity	$Q_i = N/A$	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	GrateCoef = N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	GrateClog = N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	$L_e = N/A$	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	$V_o = N/A$	N/A	fps
Interception Rate of Frontal Flow	$R_f = N/A$	N/A	
Interception Rate of Side Flow	$R_x = N/A$	N/A	
Actual Interception Capacity	$Q_a = N/A$	N/A	cfs
Carry-Over Flow = $Q_o - Q_a$ (to be applied to curb opening or next d/s inlet)	$Q_b = N/A$	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S_e (based on grate carry-over)	$S_e = 0.091$	0.072	ft/ft
Required Length L_T to Have 100% Interception	$L_T = 22.42$	37.58	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L, L_T)	L = 10.00	10.00	ft
Interception Capacity	$Q_i = 8.9$	12.9	cfs
Under Clogging Condition			
Clogging Coefficient	CurbCoef = 1.25	1.25	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	CurbClog = 0.06	0.06	
Effective (Unclogged) Length	$L_e = 8.75$	8.75	ft
Actual Interception Capacity	$Q_a = 8.6$	12.4	cfs
Carry-Over Flow = $Q_o - Q_a$	$Q_b = 5.1$	18.1	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	Q = 8.58	12.37	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	$Q_b = 5.1$	18.1	cfs
Capture Percentage = $Q_i/Q_o =$	C% = 63	41	%

INLET IN A SUMP OR SAG LOCATION

Project = **Lorson East Prelim Plan #100.040**


Inlet ID = **Inlet DP-60 (Basin D2.9+D2.12+bypass from Inlet DP59f)+bypass from Inlet DP62 in 100year**

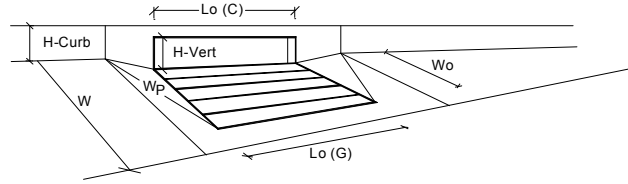

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	a _{local} = 3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	No = 1	1	
Water Depth at Flowline (outside of local depression)	Ponding Depth = 6.5 8.0		inches
Grate Information			
Length of a Unit Grate	L _o (G) = N/A N/A		feet
Width of a Unit Grate	W _g = N/A N/A		feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	A _{ratio} = N/A N/A		
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	C _r (G) = N/A N/A		
Grate Weir Coefficient (typical value 2.15 - 3.60)	C _w (G) = N/A N/A		
Grate Orifice Coefficient (typical value 0.60 - 0.80)	C _o (G) = N/A N/A		
Curb Opening Information			
Length of a Unit Curb Opening	L _o (C) = 25.00 25.00		feet
Height of Vertical Curb Opening in Inches	H _{vert} = 6.00 6.00		inches
Height of Curb Orifice Throat in Inches	H _{throat} = 6.00 6.00		inches
Angle of Throat (see USDCM Figure ST-5)	Theta = 63.40 63.40		degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	W _p = 2.00 2.00		feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	C _r (C) = 0.10 0.10		
Curb Opening Weir Coefficient (typical value 2.3-3.7)	C _w (C) = 3.60 3.60		
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	C _o (C) = 0.67 0.67		
Grate Flow Analysis (Calculated)			
Clogging Coefficient for Multiple Units	Coef = N/A N/A		
Clogging Factor for Multiple Units	Clog = N/A N/A		
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{wi} = N/A N/A		cfs
Interception with Clogging	Q _{wa} = N/A N/A		cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{oi} = N/A N/A		cfs
Interception with Clogging	Q _{oa} = N/A N/A		cfs
Grate Capacity as Mixed Flow			
Interception without Clogging	Q _{mi} = N/A N/A		cfs
Interception with Clogging	Q _{ma} = N/A N/A		cfs
Resulting Grate Capacity (assumes clogged condition)	Q _{Grate} = N/A N/A		cfs
Curb Opening Flow Analysis (Calculated)			
Clogging Coefficient for Multiple Units	Coef = 1.33 1.33		
Clogging Factor for Multiple Units	Clog = 0.03 0.03		
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{wi} = 19.14 32.57		cfs
Interception with Clogging	Q _{wa} = 18.63 31.70		cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)			
Interception without Clogging	Q _{oi} = 50.55 55.95		cfs
Interception with Clogging	Q _{oa} = 49.20 54.47		cfs
Curb Opening Capacity as Mixed Flow			
Interception without Clogging	Q _{mi} = 28.92 39.70		cfs
Interception with Clogging	Q _{ma} = 28.16 38.64		cfs
Resulting Curb Opening Capacity (assumes clogged condition)	Q _{curb} = 18.63 31.70		cfs
Resultant Street Conditions			
Total Inlet Length	L = 25.00 25.00		feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	T = 20.7 27.0		ft.>T-Crown
Resultant Flow Depth at Street Crown	d _{CROWN} = 0.9 2.4		inches
Total Inlet Interception Capacity (assumes clogged condition)			
	Q _a = 18.6 31.7		cfs
WARNING: Inlet Capacity less than Q Peak for MAJOR Storm	Q _{PEAK REQUIRED} = 15.8 55.9		cfs

INLET ON A CONTINUOUS GRADE

Project: Lorson East Prelim Plan #100.040
 Inlet ID: Inlet DP-61 (Basins D2.6+D2.7)

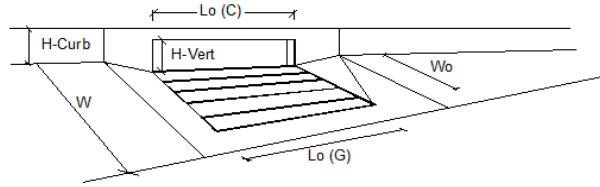


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	10.00	10.00	ft
Width of a Unit Grate (cannot be greater than W from Q-Allow)	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10	
Street Hydraulics: OK - Q < maximum allowable from sheet 'Q-Allow'			
	MINOR	MAJOR	
Design Discharge for Half of Street (from Sheet Q-Peak)	10.6	23.6	cfs
Water Spread Width	14.0	17.0	ft
Water Depth at Flowline (outside of local depression)	4.9	6.2	inches
Water Depth at Street Crown (or at T _{max})	0.0	0.6	inches
Ratio of Gutter Flow to Design Flow	0.424	0.307	
Discharge outside the Gutter Section W, carried in Section T _x	6.1	16.4	cfs
Discharge within the Gutter Section W	4.5	7.3	cfs
Discharge Behind the Curb Face	0.0	0.0	cfs
Flow Area within the Gutter Section W	2.09	3.85	sq ft
Velocity within the Gutter Section W	5.1	6.1	fps
Water Depth for Design Condition	7.9	9.2	inches
Grate Analysis (Calculated)			
	MINOR	MAJOR	
Total Length of Inlet Grate Opening	N/A	N/A	ft
Ratio of Grate Flow to Design Flow	N/A	N/A	
Under No-Clogging Condition			
Minimum Velocity Where Grate Splash-Over Begins	N/A	N/A	fps
Interception Rate of Frontal Flow	N/A	N/A	
Interception Rate of Side Flow	N/A	N/A	
Interception Capacity	N/A	N/A	cfs
Under Clogging Condition			
Clogging Coefficient for Multiple-unit Grate Inlet	N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	N/A	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	N/A	N/A	fps
Interception Rate of Frontal Flow	N/A	N/A	
Interception Rate of Side Flow	N/A	N/A	
Actual Interception Capacity	N/A	N/A	cfs
Carry-Over Flow = Q_c - Q_a (to be applied to curb opening or next d/s inlet)	N/A	N/A	cfs
Curb or Slotted Inlet Opening Analysis (Calculated)			
	MINOR	MAJOR	
Equivalent Slope S _e (based on grate carry-over)	0.100	0.078	ft/ft
Required Length L _T to Have 100% Interception	19.00	32.06	ft
Under No-Clogging Condition			
Effective Length of Curb Opening or Slotted Inlet (minimum of L _c , L _T)	10.00	10.00	ft
Interception Capacity	7.9	11.6	cfs
Under Clogging Condition			
Clogging Coefficient	1.25	1.25	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	0.06	0.06	
Effective (Unclogged) Length	8.75	8.75	ft
Actual Interception Capacity	7.6	11.1	cfs
Carry-Over Flow = Q_{b(GRATE)} - Q_a	3.0	12.6	cfs
Summary			
	MINOR	MAJOR	
Total Inlet Interception Capacity	7.57	11.08	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	3.0	12.6	cfs
Capture Percentage = Q_i/Q_o =	71	47	%

INLET IN A SUMP OR SAG LOCATION

Project = **Lorson East Prelim Plan #100.040**


Inlet ID = **Inlet DP-62 (Basin D2.8+by-pass from Inlet DP61)**

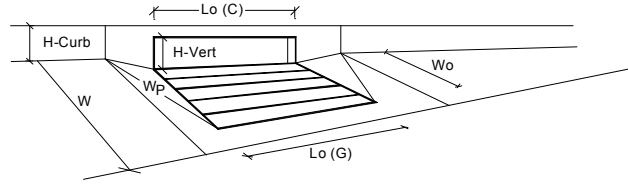

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.5	8.0	inches
Grate Information	MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
Curb Opening Information	MINOR	MAJOR	
Length of a Unit Curb Opening	10.00	10.00	feet
Height of Vertical Curb Opening in Inches	6.00	6.00	inches
Height of Curb Orifice Throat in Inches	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
Grate Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	N/A	N/A	
Clogging Factor for Multiple Units	N/A	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	N/A	N/A	cfs
Interception with Clogging	N/A	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	N/A	N/A	cfs
Interception with Clogging	N/A	N/A	cfs
Grate Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	N/A	N/A	cfs
Interception with Clogging	N/A	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	N/A	N/A	cfs
Curb Opening Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	1.25	1.25	
Clogging Factor for Multiple Units	0.06	0.06	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	10.72	17.34	cfs
Interception with Clogging	10.05	16.26	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	20.22	22.38	cfs
Interception with Clogging	18.96	20.98	cfs
Curb Opening Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	13.69	18.32	cfs
Interception with Clogging	12.84	17.18	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	10.05	16.26	cfs
Resultant Street Conditions	MINOR	MAJOR	
Total Inlet Length	10.00	10.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	20.7	27.0	ft.>T-Crown
Resultant Flow Depth at Street Crown	0.9	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)	10.1	16.3	cfs
WARNING: Inlet Capacity less than Q Peak for Minor and Major Storms	11.1	30.3	cfs
	<small>Q PEAK REQUIRED</small>		

INLET IN A SUMP OR SAG LOCATION


Project = **Lorson East Prelim Plan #100.040**
 Inlet ID = **Inlet DP-64 (Basin D2.10+bypass from Inlet DP60 in 100 year)**

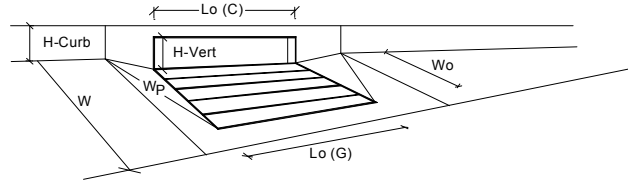

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	a _{local} = 3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	No = 1	1	
Water Depth at Flowline (outside of local depression)	Ponding Depth = 6.5	8.0	inches <input checked="" type="checkbox"/> Override Depths
Grate Information	MINOR	MAJOR	
Length of a Unit Grate	L _o (G) = N/A	N/A	feet
Width of a Unit Grate	W _g = N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	A _{ratio} = N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	C _r (G) = N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	C _w (G) = N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	C _o (G) = N/A	N/A	
Curb Opening Information	MINOR	MAJOR	
Length of a Unit Curb Opening	L _o (C) = 25.00	25.00	feet
Height of Vertical Curb Opening in Inches	H _{vert} = 6.00	6.00	inches
Height of Curb Orifice Throat in Inches	H _{throat} = 6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	Theta = 63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	W _p = 2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	C _r (C) = 0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	C _w (C) = 3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	C _o (C) = 0.67	0.67	
Grate Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	Coef = N/A	N/A	
Clogging Factor for Multiple Units	Clog = N/A	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	Q _{wi} = N/A	N/A	cfs
Interception with Clogging	Q _{wc} = N/A	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	Q _{oi} = N/A	N/A	cfs
Interception with Clogging	Q _{oc} = N/A	N/A	cfs
Grate Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	Q _{mi} = N/A	N/A	cfs
Interception with Clogging	Q _{mc} = N/A	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	Q _{Grate} = N/A	N/A	cfs
Curb Opening Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	Coef = 1.33	1.33	
Clogging Factor for Multiple Units	Clog = 0.03	0.03	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	Q _{wi} = 19.14	32.57	cfs
Interception with Clogging	Q _{wc} = 18.63	31.70	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	Q _{oi} = 50.55	55.95	cfs
Interception with Clogging	Q _{oc} = 49.20	54.47	cfs
Curb Opening Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	Q _{mi} = 28.92	39.70	cfs
Interception with Clogging	Q _{mc} = 28.16	38.64	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	Q _{Curb} = 18.63	31.70	cfs
Resultant Street Conditions	MINOR	MAJOR	
Total Inlet Length	L = 25.00	25.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	T = 20.7	27.0	ft.>T-Crown
Resultant Flow Depth at Street Crown	d _{CROWN} = 0.9	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)	Q _a = 18.6	31.7	cfs
Inlet Capacity IS GOOD for Minor and Major Storms (>Q PEAK)	Q _{PEAK REQUIRED} = 3.2	29.2	cfs

INLET IN A SUMP OR SAG LOCATION


Project = **Lorson East Prelim Plan #100.040**
 Inlet ID = **Inlet DP-65a (Basin D2.11)**

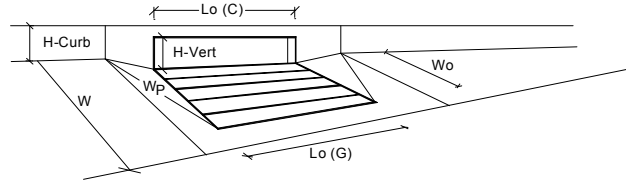

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	$a_{local} = 3.00$	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	$N_o = 1$	1	
Water Depth at Flowline (outside of local depression)	Ponding Depth = 6.5	8.0	inches <input checked="" type="checkbox"/> Override Depths
Grate Information	MINOR	MAJOR	
Length of a Unit Grate	$L_o (G) = N/A$	N/A	feet
Width of a Unit Grate	$W_o = N/A$	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	$A_{ratio} = N/A$	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	$C_r (G) = N/A$	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	$C_w (G) = N/A$	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	$C_o (G) = N/A$	N/A	
Curb Opening Information	MINOR	MAJOR	
Length of a Unit Curb Opening	$L_o (C) = 5.00$	5.00	feet
Height of Vertical Curb Opening in Inches	$H_{vert} = 6.00$	6.00	inches
Height of Curb Orifice Throat in Inches	$H_{throat} = 6.00$	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	$\theta = 63.40$	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	$W_p = 2.00$	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	$C_r (C) = 0.10$	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	$C_w (C) = 3.60$	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	$C_o (C) = 0.67$	0.67	
Grate Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	$Coef = N/A$	N/A	
Clogging Factor for Multiple Units	$Clog = N/A$	N/A	
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{wi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{wa} = N/A$	N/A	cfs
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{oi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{oa} = N/A$	N/A	cfs
Grate Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	$Q_{mi} = N/A$	N/A	cfs
Interception with Clogging	$Q_{ma} = N/A$	N/A	cfs
Resulting Grate Capacity (assumes clogged condition)	$Q_{Grate} = N/A$	N/A	cfs
Curb Opening Flow Analysis (Calculated)	MINOR	MAJOR	
Clogging Coefficient for Multiple Units	$Coef = 1.00$	1.00	
Clogging Factor for Multiple Units	$Clog = 0.10$	0.10	
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{wi} = 7.06$	10.97	cfs
Interception with Clogging	$Q_{wa} = 6.35$	9.87	cfs
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)	MINOR	MAJOR	
Interception without Clogging	$Q_{oi} = 10.11$	11.19	cfs
Interception with Clogging	$Q_{oa} = 9.10$	10.07	cfs
Curb Opening Capacity as Mixed Flow	MINOR	MAJOR	
Interception without Clogging	$Q_{mi} = 7.86$	10.30	cfs
Interception with Clogging	$Q_{ma} = 7.07$	9.27	cfs
Resulting Curb Opening Capacity (assumes clogged condition)	$Q_{Curb} = 6.35$	9.27	cfs
Resultant Street Conditions	MINOR	MAJOR	
Total Inlet Length	$L = 5.00$	5.00	feet
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	$T = 20.7$	27.0	ft. > T-Crown
Resultant Flow Depth at Street Crown	$d_{CROWN} = 0.9$	2.4	inches
Total Inlet Interception Capacity (assumes clogged condition)	$Q_a = 6.4$	9.3	cfs
Inlet Capacity IS GOOD for Minor and Major Storms (>Q PEAK)	$Q_{PEAK REQUIRED} = 2.0$	4.0	cfs

INLET IN A SUMP OR SAG LOCATION

Project = **Lorson East Prelim Plan #100.040**
 Inlet ID = **Inlet DP-65b (Basin D2.13)+bypass from Inlet DP59d in 100 year**

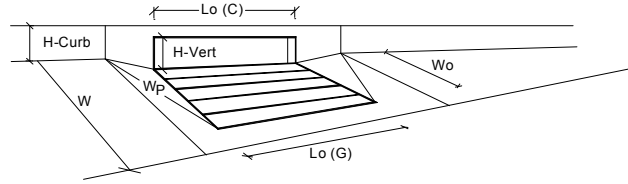

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	Inlet Type =	CDOT Type R Curb Opening			
Local Depression (additional to continuous gutter depression 'a' from 'Q-Allow')	a_{local} =	3.00	3.00	inches	
Number of Unit Inlets (Grate or Curb Opening)	No =	1	1		
Water Depth at Flowline (outside of local depression)	Ponding Depth =	6.5	8.0	inches	<input checked="" type="checkbox"/> Override Depths
Grate Information		MINOR		MAJOR	
Length of a Unit Grate	$L_o (G)$ =	N/A	N/A	feet	
Width of a Unit Grate	W_g =	N/A	N/A	feet	
Area Opening Ratio for a Grate (typical values 0.15-0.90)	A_{ratio} =	N/A	N/A		
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	$C_r (G)$ =	N/A	N/A		
Grate Weir Coefficient (typical value 2.15 - 3.60)	$C_w (G)$ =	N/A	N/A		
Grate Orifice Coefficient (typical value 0.60 - 0.80)	$C_o (G)$ =	N/A	N/A		
Curb Opening Information		MINOR		MAJOR	
Length of a Unit Curb Opening	$L_o (C)$ =	10.00	10.00	feet	
Height of Vertical Curb Opening in Inches	H_{vert} =	6.00	6.00	inches	
Height of Curb Orifice Throat in Inches	H_{throat} =	6.00	6.00	inches	
Angle of Throat (see USDCM Figure ST-5)	Theta =	63.40	63.40	degrees	
Side Width for Depression Pan (typically the gutter width of 2 feet)	W_p =	2.00	2.00	feet	
Clogging Factor for a Single Curb Opening (typical value 0.10)	$C_r (C)$ =	0.10	0.10		
Curb Opening Weir Coefficient (typical value 2.3-3.7)	$C_w (C)$ =	3.60	3.60		
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	$C_o (C)$ =	0.67	0.67		
Grate Flow Analysis (Calculated)		MINOR		MAJOR	
Clogging Coefficient for Multiple Units	Coef =	N/A	N/A		
Clogging Factor for Multiple Units	Clog =	N/A	N/A		
Grate Capacity as a Weir (based on UDFCD - CSU 2010 Study)		MINOR		MAJOR	
Interception without Clogging	Q_{wi} =	N/A	N/A	cfs	
Interception with Clogging	Q_{wa} =	N/A	N/A	cfs	
Grate Capacity as an Orifice (based on UDFCD - CSU 2010 Study)		MINOR		MAJOR	
Interception without Clogging	Q_{oi} =	N/A	N/A	cfs	
Interception with Clogging	Q_{oa} =	N/A	N/A	cfs	
Grate Capacity as Mixed Flow		MINOR		MAJOR	
Interception without Clogging	Q_{mi} =	N/A	N/A	cfs	
Interception with Clogging	Q_{ma} =	N/A	N/A	cfs	
Resulting Grate Capacity (assumes clogged condition)	Q_{Grate} =	N/A	N/A	cfs	
Curb Opening Flow Analysis (Calculated)		MINOR		MAJOR	
Clogging Coefficient for Multiple Units	Coef =	1.25	1.25		
Clogging Factor for Multiple Units	Clog =	0.06	0.06		
Curb Opening as a Weir (based on UDFCD - CSU 2010 Study)		MINOR		MAJOR	
Interception without Clogging	Q_{wi} =	10.72	17.34	cfs	
Interception with Clogging	Q_{wa} =	10.05	16.26	cfs	
Curb Opening as an Orifice (based on UDFCD - CSU 2010 Study)		MINOR		MAJOR	
Interception without Clogging	Q_{oi} =	20.22	22.38	cfs	
Interception with Clogging	Q_{oa} =	18.96	20.98	cfs	
Curb Opening Capacity as Mixed Flow		MINOR		MAJOR	
Interception without Clogging	Q_{mi} =	13.69	18.32	cfs	
Interception with Clogging	Q_{ma} =	12.84	17.18	cfs	
Resulting Curb Opening Capacity (assumes clogged condition)	Q_{curb} =	10.05	16.26	cfs	
Resultant Street Conditions		MINOR		MAJOR	
Total Inlet Length	L =	10.00	10.00	feet	
Resultant Street Flow Spread (based on sheet Q-Allow geometry)	T =	20.7	27.0	ft.>T-Crown	
Resultant Flow Depth at Street Crown	d_{CROWN} =	0.9	2.4	inches	
Total Inlet Interception Capacity (assumes clogged condition)		MINOR		MAJOR	
	Q_a =	10.1	16.3	cfs	
Inlet Capacity IS GOOD for Minor and Major Storms (>Q PEAK)	$Q_{PEAK REQUIRED}$ =	4.2	12.7	cfs	

APPENDIX D – POND AND ROUTING CALCULATIONS

Design Procedure Form: Grass Buffer (GB)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 1

Designer: _____
Company: Core Engineering Group
Date: February 27, 2018
Project: Lorson Ranch East Filing No. 1
Location: Lorson Ranch

1. Design Discharge A) 2-Year Peak Flow Rate of the Area Draining to the Grass Buffer	$Q_2 = \underline{0.5} \text{ cfs}$
2. Minimum Width of Grass Buffer	$W_G = \underline{10} \text{ ft}$
3. Length of Grass Buffer (14' or greater recommended)	$L_G = \underline{14} \text{ ft}$
4. Buffer Slope (in the direction of flow, not to exceed 0.1 ft / ft)	$S_G = \underline{0.100} \text{ ft / ft}$
5. Flow Characteristics (sheet or concentrated) A) Does runoff flow into the grass buffer across the entire width of the buffer? B) Watershed Flow Length C) Interface Slope (normal to flow) D) Type of Flow Sheet Flow: $F_L * S_i \leq 1$ Concentrated Flow: $F_L * S_i > 1$	<div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> Choose One <input checked="" type="radio"/> Yes <input type="radio"/> No </div> $F_L = \underline{60} \text{ ft}$ $S_i = \underline{0.002} \text{ ft / ft}$ <div style="background-color: #e0ffe0; padding: 2px; text-align: center; margin-top: 5px;"> SHEET FLOW </div>
6. Flow Distribution for Concentrated Flows	<div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> Choose One <input checked="" type="radio"/> None (sheet flow) <input type="radio"/> Slotted Curbing <input type="radio"/> Level Spreader <input type="radio"/> Other (Explain): </div> _____ _____
7. Soil Preparation (Describe soil amendment)	<u>4" topsoil</u> _____ _____
8. Vegetation (Check the type used or describe "Other")	<div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> Choose One <input checked="" type="radio"/> Existing Xeric Turf Grass <input type="radio"/> Irrigated Turf Grass <input type="radio"/> Other (Explain): </div> _____ _____
9. Irrigation (*Select None if existing buffer area has 80% vegetation AND will not be disturbed during construction.)	<div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> Choose One <input type="radio"/> Temporary <input type="radio"/> Permanent <input checked="" type="radio"/> None* </div>
10. Outflow Collection (Check the type used or describe "Other")	<div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> Choose One <input type="radio"/> Grass Swale <input type="radio"/> Street Gutter <input type="radio"/> Storm Sewer Inlet <input checked="" type="radio"/> Other (Explain): </div> <u>Etrib of Jimmy Camp Creek</u> _____ _____
Notes: _____ _____ _____	

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 4

Designer: Richard Schindler
Company: Core Engineering Group
Date: February 13, 2018
Project: Lorson Ranch East PDR - Pond c5 forebay design
Location: Pond C5 forebay design (split forebay in two parts)

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, I_a</p> <p>B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time ($V_{DESIGN} = (1.0 * (0.91 * I_a^3 - 1.19 * I_a^2 + 0.78 * I_a) / 12 * Area)$)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume ($V_{WQCV\ OTHER} = (d_b * (V_{DESIGN} / 0.43))$)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) Predominant Watershed NRCS Soil Group</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume For HSG A: $EURV_A = 1.68 * i^{1.28}$ For HSG B: $EURV_B = 1.36 * i^{1.08}$ For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$ </p>	<p>$I_a =$ <u>63.0</u> %</p> <p>$i =$ <u>0.630</u></p> <p>Area = <u>171.000</u> ac</p> <p>$d_b =$ _____ in</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> <p>Choose One</p> <p><input checked="" type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input type="radio"/> Excess Urban Runoff Volume (EURV)</p> </div> <p>$V_{DESIGN} =$ <u>3.515</u> ac-ft</p> <p>$V_{DESIGN\ OTHER} =$ _____ ac-ft</p> <p>$V_{DESIGN\ USER} =$ <u>3.300</u> ac-ft</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> <p>Choose One</p> <p><input type="radio"/> A</p> <p><input type="radio"/> B</p> <p><input type="radio"/> C / D</p> </div> <p style="color: blue; font-size: small;">WQCV selected. Soil group not required.</p> <p>EURV = _____ ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <u>2.0</u> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <u>0.33</u> ft / ft TOO STEEP (< 3)</p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<hr/> <hr/> <hr/> <hr/>

Design Procedure Form: Extended Detention Basin (EDB)

Designer: Richard Schindler
Company: Core Engineering Group
Date: February 13, 2018
Project: Lorson Ranch East PDR - Pond c5 forebay design
Location: Pond C5 forebay design (split forebay in two parts)

<p>5. Forebay</p> <p>A) Minimum Forebay Volume ($V_{FMIN} = 3\%$ of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth ($D_F = 30$ inch maximum)</p> <p>D) Forebay Discharge</p> <p style="padding-left: 40px;">i) Undetained 100-year Peak Discharge</p> <p style="padding-left: 40px;">ii) Forebay Discharge Design Flow ($Q_F = 0.02 * Q_{100}$)</p> <p>E) Forebay Discharge Design</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p>$V_{FMIN} = 0.099$ ac-ft</p> <p>$V_F = 0.150$ ac-ft</p> <p>$D_F = 30.0$ in</p> <p>$Q_{100} = 484.00$ cfs</p> <p>$Q_F = 9.68$ cfs</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> Choose One <input type="radio"/> Berm With Pipe <input checked="" type="radio"/> Wall with Rect. Notch <input type="radio"/> Wall with V-Notch Weir </div> <p>Calculated $D_p =$ in</p> <p>Calculated $W_N = 14.8$ in</p>
<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> Choose One <input checked="" type="radio"/> Concrete <input type="radio"/> Soft Bottom </div> <p>$S = 0.0040$ ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-feet minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>$D_M = 2.5$ ft</p> <p>$A_M = 88$ sq ft</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> Choose One <input checked="" type="radio"/> Orifice Plate <input type="radio"/> Other (Describe): </div> <hr style="border: 0; border-top: 1px solid black; margin: 5px 0;"/> <hr style="border: 0; border-top: 1px solid black; margin: 5px 0;"/> <hr style="border: 0; border-top: 1px solid black; margin: 5px 0;"/> <p>$D_{orifice} = 3.03$ inches</p> <p>$A_{ot} = 27.63$ square inches</p>

Design Procedure Form: Extended Detention Basin (EDB)

Designer: Richard Schindler
Company: Core Engineering Group
Date: February 13, 2018
Project: Lorson Ranch East PDR - Pond c5 forebay design
Location: Pond C5 forebay design (split forebay in two parts)


<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>$D_{IS} =$ <u>4</u> in</p> <p>$V_{IS} =$ <u>431.2</u> cu ft</p> <p>$V_s =$ <u>29.3</u> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: $A_t = A_{tot} * 38.5 * (e^{-0.095D})$</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open are to the total screen are for the material specified.)</p> <p>Other (Y/N): <u>Y</u></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening ($W_{opening}$) (Minimum of 12 inches is recommended)</p>	<p>$A_t =$ <u>798</u> square inches</p> <p><u>Other (Please describe below)</u></p> <p><u>stainless steel wellscreen</u></p> <p>User Ratio = <u>0.6</u></p> <p>$A_{total} =$ <u>1329</u> sq. in. Based on type 'Other' screen ratio</p> <p>$H =$ <u>3</u> feet</p> <p>$H_{TR} =$ <u>64</u> inches</p> <p>$W_{opening} =$ <u>20.8</u> inches</p>

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: Lorson East MDDP (100.013)

Basin ID: Pond C5



Example Zone Configuration (Retention Pond)

Required Volume Calculation

Selected BMP Type =	EDB	
Watershed Area =	171.00	acres
Watershed Length =	3,200	ft
Watershed Slope =	0.018	ft/ft
Watershed Imperviousness =	63.00%	percent
Percentage Hydrologic Soil Group A =	0.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Groups C/D =	100.0%	percent
Desired WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths =	Denver - Capitol Building	
Water Quality Capture Volume (WQCV) =	3,515	acre-feet
Excess Urban Runoff Volume (EURV) =	10,382	acre-feet
2-yr Runoff Volume (P1 = 1.16 in.) =	9,641	acre-feet
5-yr Runoff Volume (P1 = 1.44 in.) =	13,459	acre-feet
10-yr Runoff Volume (P1 = 1.68 in.) =	16,659	acre-feet
25-yr Runoff Volume (P1 = 1.92 in.) =	21,433	acre-feet
50-yr Runoff Volume (P1 = 2.16 in.) =	25,205	acre-feet
100-yr Runoff Volume (P1 = 2.42 in.) =	29,878	acre-feet
500-yr Runoff Volume (P1 = 3.14 in.) =	41,092	acre-feet
Approximate 2-yr Detention Volume =	9,045	acre-feet
Approximate 5-yr Detention Volume =	12,678	acre-feet
Approximate 10-yr Detention Volume =	14,486	acre-feet
Approximate 25-yr Detention Volume =	15,477	acre-feet
Approximate 50-yr Detention Volume =	15,943	acre-feet
Approximate 100-yr Detention Volume =	17,508	acre-feet

Optional User Override 1-hr Precipitation	
1.16	inches
1.44	inches
1.68	inches
1.92	inches
2.16	inches
2.42	inches
	inches

Stage-Storage Calculation

Zone 1 Volume (WQCV) =	3,515	acre-feet
Zone 2 Volume (EURV - Zone 1) =	6,868	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	7,126	acre-feet
Total Detention Basin Volume =	17,508	acre-feet
Initial Surcharge Volume (SV) =	user	ft ³
Initial Surcharge Depth (SD) =	user	ft
Total Available Detention Depth (H _{total}) =	user	ft
Depth of Trickle Channel (H _{TC}) =	user	ft
Slope of Trickle Channel (S _{TC}) =	user	ft/ft
Slopes of Main Basin Sides (S _{main}) =	user	H:V
Basin Length-to-Width Ratio (R _{L/W}) =	user	
Initial Surcharge Area (A _{sv}) =	user	ft ²
Surcharge Volume Length (L _{sv}) =	user	ft
Surcharge Volume Width (W _{sv}) =	user	ft
Depth of Basin Floor (H _{u,000}) =	user	ft
Length of Basin Floor (L _{u,000}) =	user	ft
Width of Basin Floor (W _{u,000}) =	user	ft
Area of Basin Floor (A _{u,000}) =	user	ft ²
Volume of Basin Floor (V _{u,000}) =	user	ft ³
Depth of Main Basin (H _{main}) =	user	ft
Length of Main Basin (L _{main}) =	user	ft
Width of Main Basin (W _{main}) =	user	ft
Area of Main Basin (A _{main}) =	user	ft ²
Volume of Main Basin (V _{main}) =	user	ft ³
Calculated Total Basin Volume (V _{total}) =	user	acre-feet

Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Optional Override Area (ft ²)	Area (acre)	Volume (ft ³)	Volume (ac-ft)
Top of Micropool	--	0.00	--	--	--	50	0.001		
5706.33	--	0.33	--	--	--	100	0.002	24	0.001
5707	--	1.00	--	--	--	1,000	0.023	383	0.009
5708	--	2.00	--	--	--	18,898	0.434	10,154	0.233
5709	--	3.00	--	--	--	77,432	1.778	58,507	1.343
5710	--	4.00	--	--	--	110,270	2.531	152,358	3.498
5711	--	5.00	--	--	--	115,455	2.650	265,220	6.089
5712	--	6.00	--	--	--	120,720	2.771	383,308	8.800
5713	--	7.00	--	--	--	126,045	2.894	506,690	11.632
5714	--	8.00	--	--	--	131,696	3.023	635,561	14.590
5715	--	9.00	--	--	--	136,745	3.139	769,781	17.672
5716	--	10.00	--	--	--	141,857	3.257	909,082	20.870


why not?

Detention Basin Outlet Structure Design

Project: **Lorson East MDDP (100.013)**

Basin ID: **Pond C5 (only used for WQCV and EURV) Do not use for 2-100-yr Storm Event!!!!!!**

UD-Detention_Version 3.07 (February 2017)

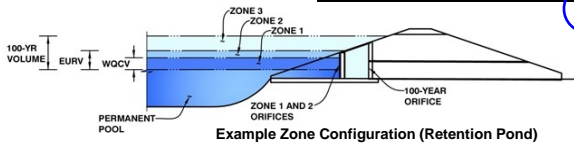

Example Zone Configuration (Retention Pond)

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	4.01	3.515	Orifice Plate
Zone 2 (EURV)	6.57	6.868	Rectangular Orifice
Zone 3 (100-year)	8.95	7.126	Weir&Pipe (Restrict)
Total		17.508	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = inches
Orifice Plate: Orifice Area per Row = sq. inches (use rectangular openings)

Calculated Parameters for Plate

WQ Orifice Area per Row = ft²
Elliptical Half-Width = feet
Elliptical Slot Centroid = feet
Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.34	2.67					
Orifice Area (sq. inches)	9.21	9.21	9.21					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Zone 2 Rectangular	Not Selected	
Invert of Vertical Orifice =	4.01	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	6.57	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Height =	6.00	N/A	inches
Vertical Orifice Width =	18.68		inches

Calculated Parameters for Vertical Orifice

	Zone 2 Rectangular	Not Selected	
Vertical Orifice Area =	0.78	N/A	ft ²
Vertical Orifice Centroid =	0.25	N/A	feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	6.60	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	18.00	N/A	feet
Overflow Weir Slope =	0.00	N/A	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	3.00	N/A	feet
Overflow Grate Open Area % =	85%	N/A	%, grate open area/total area
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H ₁ =	6.60	N/A	feet
Over Flow Weir Slope Length =	3.00	N/A	feet
Grate Open Area / 100-yr Orifice Area =	3.65	N/A	should be ≥ 4
Overflow Grate Open Area w/o Debris =	45.90	N/A	ft ²
Overflow Grate Open Area w/ Debris =	22.95	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.00	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	48.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	48.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	12.57	N/A	ft ²
Outlet Orifice Centroid =	2.00	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	3.14	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = feet
Spillway End Slopes = H:V
Freeboard above Max Water Surface = feet

Calculated Parameters for Spillway




Spillway Design Flow Depth = feet
Stage at Top of Freeboard = feet
Basin Area at Top of Freeboard = acres

Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.16	1.44	1.68	1.92	2.16	2.42	3.14
Calculated Runoff Volume (acre-ft) =	3.515	10.382	9.641	13.459	16.659	21.433	25.205	29.878	41.092
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	3.517	10.386	6.877	8.575	17.689	26.716	34.728	37.807	0.000
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.02	0.14	0.37	0.85	1.12	1.46	2.19
Predevelopment Peak Q (cfs) =	0.0	0.0	2.8	23.2	63.2	145.3	191.8	249.0	374.8
Peak Inflow Q (cfs) =	63.1	181.4	138.8	167.5	301.0	385.7	450.0	519.1	0.0
Peak Outflow Q (cfs) =	1.4	7.3	5.1	6.2	82.7	147.9	161.2	162.7	
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.3	1.3	1.0	0.8	0.7	
Structure Controlling Flow =	Plate	Vertical Orifice 1	Vertical Orifice 1	Vertical Orifice 1	Overflow Grate 1	Outlet Plate 1	Outlet Plate 1	Outlet Plate 1	
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	1.6	3.0	3.3	3.3	
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Time to Drain 97% of Inflow Volume (hours) =	38	54	50	52	54	50	48	47	
Time to Drain 99% of Inflow Volume (hours) =	40	58	52	55	59	59	58	57	
Maximum Ponding Depth (ft) =	3.92	6.27	5.05	5.58	7.37	7.98	9.10	9.23	
Area at Maximum Ponding Depth (acres) =	2.47	2.80	2.66	2.72	2.94	3.02	3.15	3.17	
Maximum Volume Stored (acre-ft) =	3.298	9.524	6.195	7.619	12.682	14.500	17.986	18.365	

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

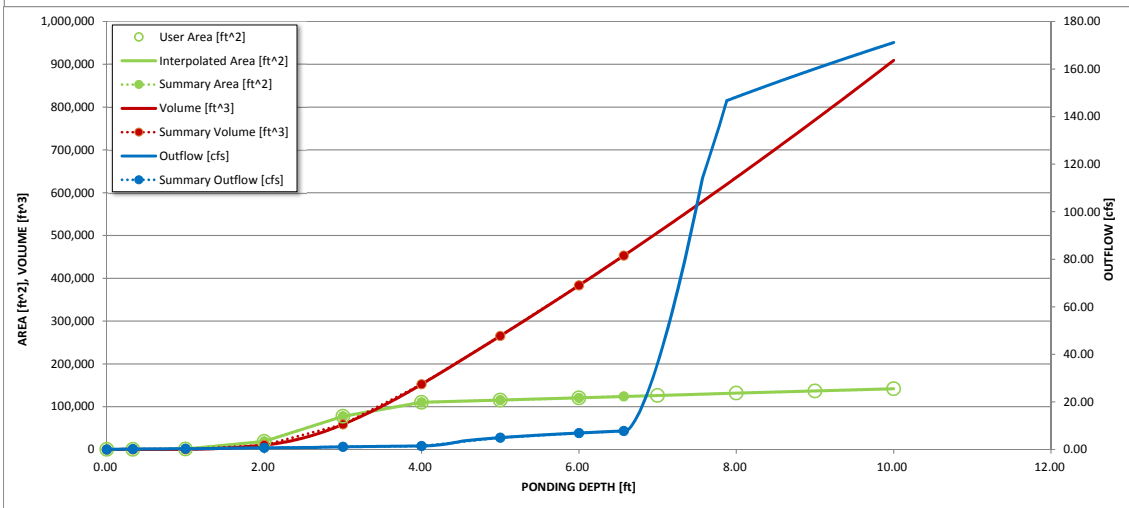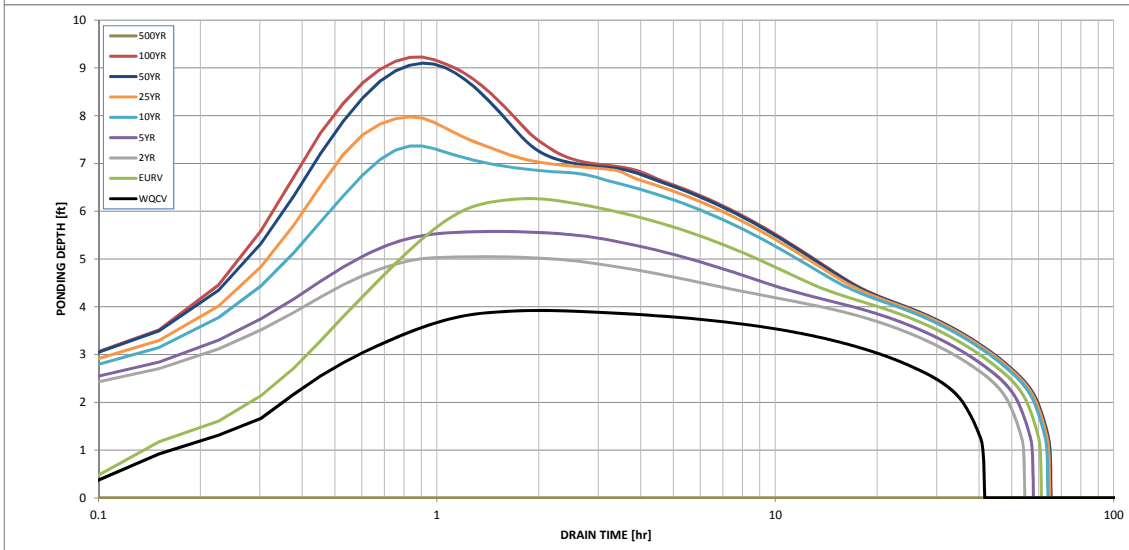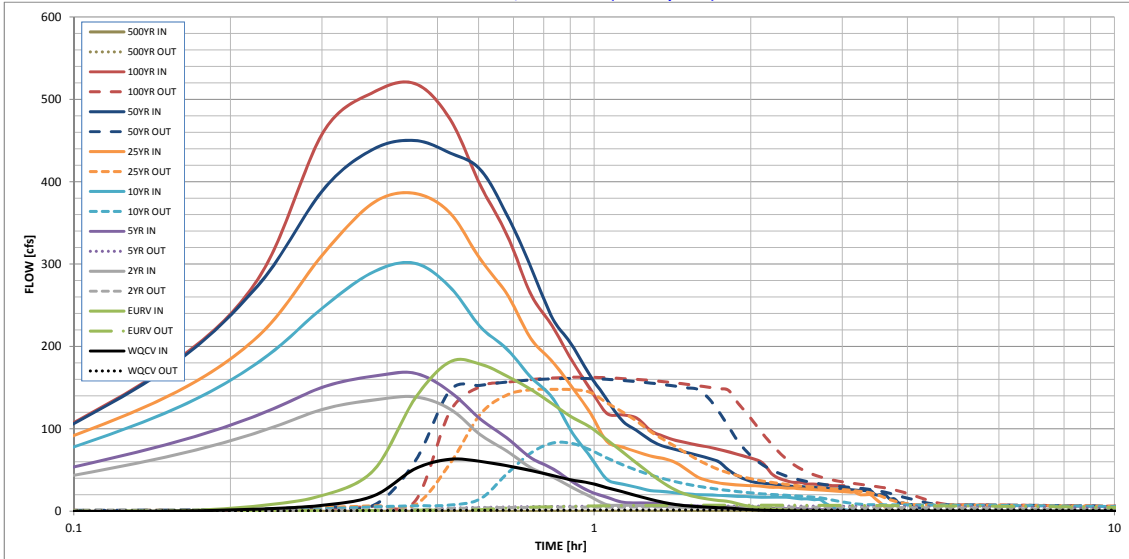

S-A-V-D Chart Axis Override

	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

Weir Report

Pond C5 Spillway - btm=5713.00

Trapezoidal Weir


Crest = Sharp
Bottom Length (ft) = 52.00
Total Depth (ft) = 4.00
Side Slope (z:1) = 4.00

Highlighted

Depth (ft) = 1.83
Q (cfs) = 443.00
Area (sqft) = 108.56
Velocity (ft/s) = 4.08
Top Width (ft) = 66.64

Calculations

Weir Coeff. Cw = 3.10
Compute by: Known Q
Known Q (cfs) = 443.00

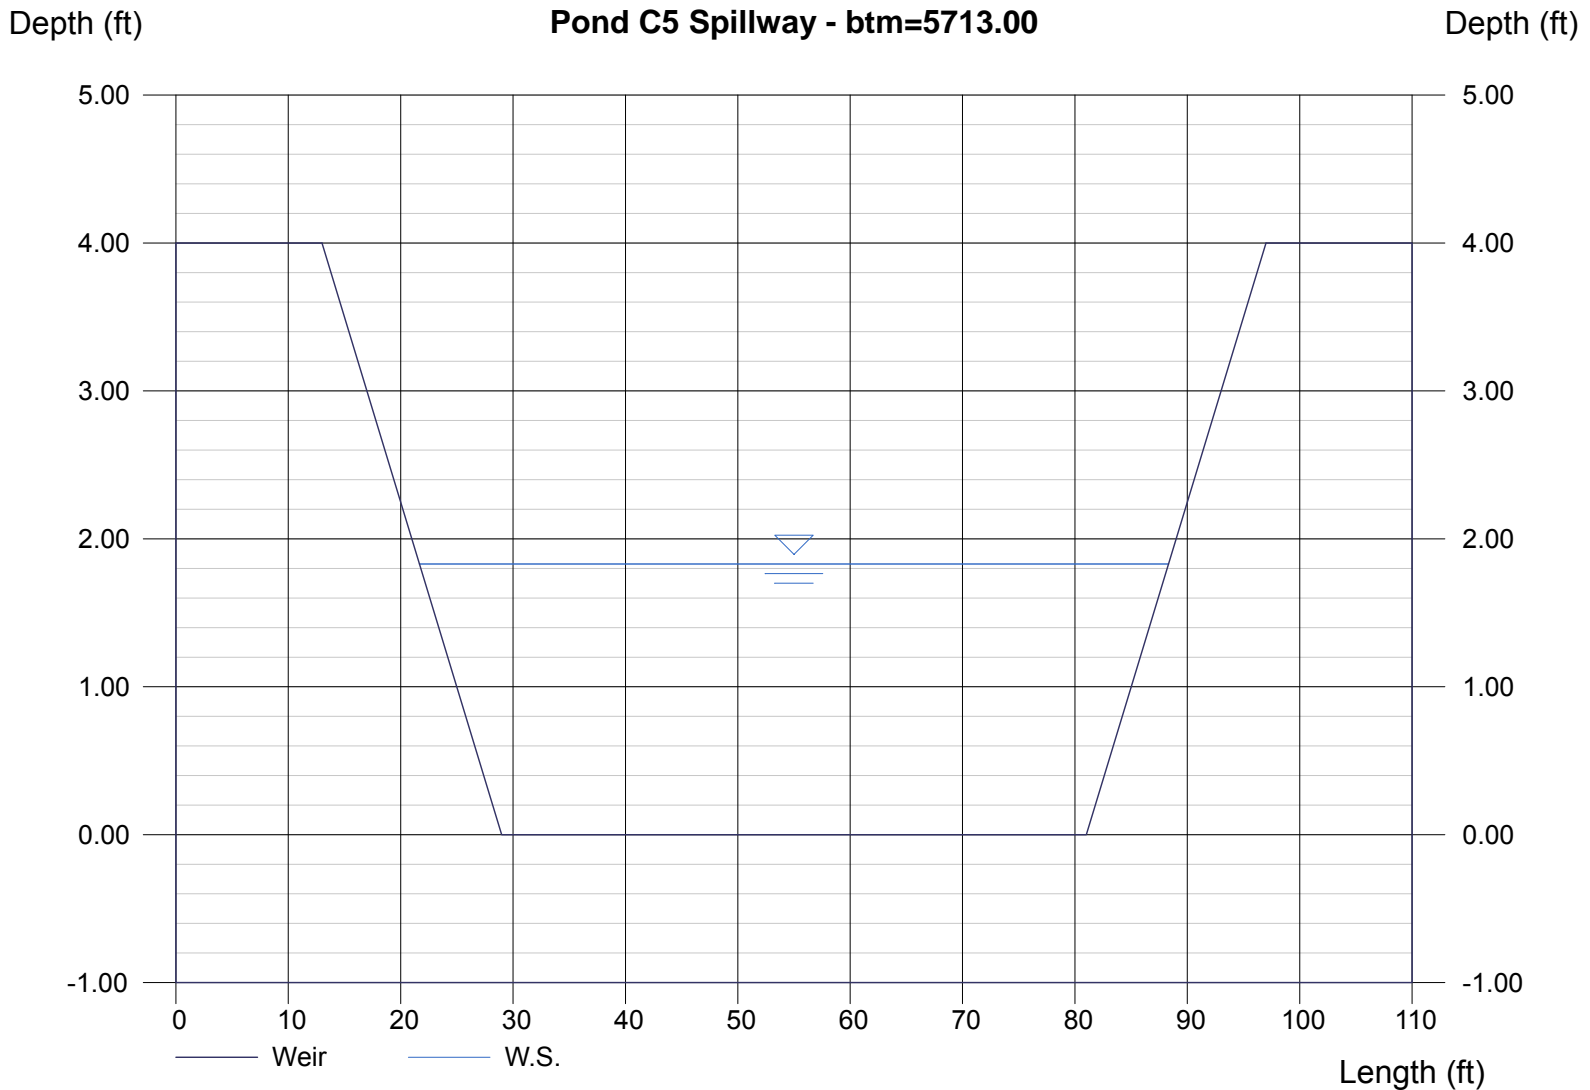


Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: **Lorson Ranch East MDDP**

Basin ID: **Pond D2 - Lorson Blvd at East Tributary of JCC**

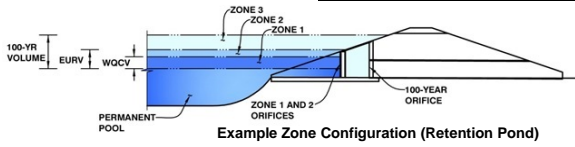

Example Zone Configuration (Retention Pond)

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.79	1.635	Orifice Plate
Zone 2 (EURV)	4.55	3.032	Rectangular Orifice
Zone 3 (100-year)	6.45	3.595	Weir&Pipe (Restrict)
		8.261	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =	N/A	ft (distance below the filtration media surface)
Underdrain Orifice Diameter =	N/A	inches

Calculated Parameters for Underdrain

Underdrain Orifice Area =	N/A	ft ²
Underdrain Orifice Centroid =	N/A	feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =	0.00	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate =	2.80	ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing =	9.00	inches
Orifice Plate: Orifice Area per Row =	4.20	sq. inches (use rectangular openings)

Calculated Parameters for Plate

WQ Orifice Area per Row =	2.917E-02	ft ²
Elliptical Half-Width =	N/A	feet
Elliptical Slot Centroid =	N/A	feet
Elliptical Slot Area =	N/A	ft ²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.60	1.20					
Orifice Area (sq. inches)	4.20	4.20	4.20					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Zone 2 Rectangular	Not Selected	
Invert of Vertical Orifice =	2.79	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	4.55	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Height =	10.00	N/A	inches
Vertical Orifice Width =	25.21		inches

Calculated Parameters for Vertical Orifice

	Zone 2 Rectangular	Not Selected	
Vertical Orifice Area =	1.75	N/A	ft ²
Vertical Orifice Centroid =	0.42	N/A	feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	4.60	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	4.00	N/A	feet
Overflow Weir Slope =	10.00	N/A	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	20.00	N/A	feet
Overflow Grate Open Area % =	70%	N/A	%, grate open area/total area
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H ₁ =	6.60	N/A	feet
Over Flow Weir Slope Length =	20.10	N/A	feet
Grate Open Area / 100-yr Orifice Area =	3.54	N/A	should be ≥ 4
Overflow Grate Open Area w/o Debris =	56.28	N/A	ft ²
Overflow Grate Open Area w/ Debris =	28.14	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.00	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	54.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	54.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	15.90	N/A	ft ²
Outlet Orifice Centroid =	2.25	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	3.14	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	7.00	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	30.00	feet
Spillway End Slopes =	4.00	H:V
Freeboard above Max Water Surface =	3.00	feet

Calculated Parameters for Spillway

Spillway Design Flow Depth =	1.64	feet
Stage at Top of Freeboard =	11.64	feet
Basin Area at Top of Freeboard =	2.43	acres

Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period									
One-Hour Rainfall Depth (in)	0.53	1.07	1.16	1.44	1.68	1.92	2.16	2.42	0.00
Calculated Runoff Volume (acre-ft)	1.635	4.666	4.303	6.164	7.797	10.390	12.380	14.861	0.000
OPTIONAL Override Runoff Volume (acre-ft)									
Inflow Hydrograph Volume (acre-ft)	1.632	4.661	4.297	6.155	7.781	10.375	12.358	14.837	#N/A
Predevelopment Unit Peak Flow, q (cfs/acre)	0.00	0.00	0.02	0.15	0.41	0.93	1.23	1.59	0.00
Predevelopment Peak Q (cfs)	0.0	0.0	1.6	13.5	36.4	82.9	109.4	141.5	0.0
Peak Inflow Q (cfs)	32.1	90.1	83.2	118.2	148.6	196.4	232.5	277.1	#N/A
Peak Outflow Q (cfs)	0.6	8.9	8.2	12.5	26.2	60.9	91.6	131.5	#N/A
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	0.9	0.7	0.7	0.8	0.9	#N/A
Structure Controlling Flow	Plate	Vertical Orifice 1	Vertical Orifice 1	Overflow Grate 1	Overflow Grate 1	Overflow Grate 1	Overflow Grate 1	Overflow Grate 1	#N/A
Max Velocity through Grate 1 (fps)	N/A	N/A	N/A	0.0	0.2	0.8	1.3	2.0	#N/A
Max Velocity through Grate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	#N/A
Time to Drain 97% of Inflow Volume (hours)	39	49	49	49	48	46	44	42	#N/A
Time to Drain 99% of Inflow Volume (hours)	40	52	52	53	53	52	52	51	#N/A
Maximum Ponding Depth (ft)	2.73	4.14	3.98	4.81	5.37	5.99	6.33	6.68	#N/A
Area at Maximum Ponding Depth (acres)	1.52	1.77	1.76	1.83	1.88	1.94	1.97	2.00	#N/A
Maximum Volume Stored (acre-ft)	1.536	3.945	3.645	5.133	6.191	7.356	8.040	8.735	#N/A

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 4

Designer: Richard Schindler
Company: Core Engineering Group
Date: February 13, 2018
Project: Lorson Ranch East PDR - Pond D2 forebay design
Location: _____

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, I_a</p> <p>B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time ($V_{DESIGN} = (1.0 * (0.91 * I^3 - 1.19 * I^2 + 0.78 * I) / 12 * Area)$)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume ($V_{WQCV\ OTHER} = (d_6 * (V_{DESIGN} / 0.43))$)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) Predominant Watershed NRCS Soil Group</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume For HSG A: $EURV_A = 1.68 * i^{1.28}$ For HSG B: $EURV_B = 1.36 * i^{1.08}$ For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$ </p>	<p>$I_a =$ <u>55.0</u> %</p> <p>$i =$ <u>0.550</u></p> <p>Area = <u>89.000</u> ac</p> <p>$d_6 =$ _____ in</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> <p>Choose One</p> <p><input checked="" type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input type="radio"/> Excess Urban Runoff Volume (EURV)</p> </div> <p>$V_{DESIGN} =$ <u>1.635</u> ac-ft</p> <p>$V_{DESIGN\ OTHER} =$ _____ ac-ft</p> <p>$V_{DESIGN\ USER} =$ <u>1.390</u> ac-ft</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> <p>Choose One</p> <p><input type="radio"/> A</p> <p><input type="radio"/> B</p> <p><input type="radio"/> C / D</p> </div> <p style="color: blue; font-size: small;">WQCV selected. Soil group not required.</p> <p>EURV = _____ ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <u>2.0</u> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <u>0.33</u> ft / ft TOO STEEP (< 3)</p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>

Design Procedure Form: Extended Detention Basin (EDB)

Designer: Richard Schindler
Company: Core Engineering Group
Date: February 13, 2018
Project: Lorson Ranch East PDR - Pond D2 forebay design
Location: _____

<p>5. Forebay</p> <p>A) Minimum Forebay Volume ($V_{FMIN} =$ <u>3%</u> of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth ($D_F =$ <u>30</u> inch maximum)</p> <p>D) Forebay Discharge</p> <p style="margin-left: 40px;">i) Undetained 100-year Peak Discharge</p> <p style="margin-left: 40px;">ii) Forebay Discharge Design Flow ($Q_F = 0.02 * Q_{100}$)</p> <p>E) Forebay Discharge Design</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p>$V_{FMIN} =$ <u>0.042</u> ac-ft</p> <p>$V_F =$ <u>0.045</u> ac-ft</p> <p>$D_F =$ <u>30.0</u> in</p> <p>$Q_{100} =$ <u>243.00</u> cfs</p> <p>$Q_F =$ <u>4.86</u> cfs</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> Choose One <input type="radio"/> Berm With Pipe <input checked="" type="radio"/> Wall with Rect. Notch <input type="radio"/> Wall with V-Notch Weir </div> <p>Calculated $D_p =$ <u> </u> in</p> <p>Calculated $W_N =$ <u>10.4</u> in</p>
<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> Choose One <input checked="" type="radio"/> Concrete <input type="radio"/> Soft Bottom </div> <p>$S =$ <u>0.0050</u> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-feet minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>$D_M =$ <u>2.5</u> ft</p> <p>$A_M =$ <u>121</u> sq ft</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> Choose One <input checked="" type="radio"/> Orifice Plate <input type="radio"/> Other (Describe): _____ </div> <hr/> <hr/> <p>$D_{orifice} =$ <u>3.05</u> inches</p> <p>$A_{ot} =$ <u>26.85</u> square inches</p>

Design Procedure Form: Extended Detention Basin (EDB)

Designer: Richard Schindler
Company: Core Engineering Group
Date: February 13, 2018
Project: Lorson Ranch East PDR - Pond D2 forebay design
Location: _____

<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>$D_{IS} =$ <u>4</u> in</p> <p>$V_{IS} =$ <u>181.6</u> cu ft</p> <p>$V_s =$ <u>40.3</u> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: $A_t = A_{ot} * 38.5 * (e^{-0.095D})$</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open are to the total screen are for the material specified.)</p> <p style="padding-left: 40px;">Other (Y/N): <u>Y</u></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening ($W_{opening}$) (Minimum of 12 inches is recommended)</p>	<p>$A_t =$ <u>774</u> square inches</p> <p style="background-color: #e0ffe0; padding: 2px;"><i>Other (Please describe below)</i></p> <p><u>well screen stainless steel</u></p> <p>_____</p> <p>_____</p> <p>User Ratio = <u>0.6</u></p> <p>$A_{total} =$ <u>1289</u> sq. in. Based on type 'Other' screen ratio</p> <p>$H =$ <u>2.7</u> feet</p> <p>$H_{TR} =$ <u>60.4</u> inches</p> <p>$W_{opening} =$ <u>21.3</u> inches</p>

Weir Report

Pond D2 Spillway - btm=5702.00

Trapezoidal Weir

Crest = Sharp
Bottom Length (ft) = 30.00
Total Depth (ft) = 4.00
Side Slope (z:1) = 4.00

Highlighted

Depth (ft) = 1.84
Q (cfs) = 277.10
Area (sqft) = 68.74
Velocity (ft/s) = 4.03
Top Width (ft) = 44.72


Calculations

Weir Coeff. Cw = 3.10
Compute by: Known Q
Known Q (cfs) = 277.10



Provide for all storm systems serving Filing No. 1, including interim conditions accommodating offsite flows.

Hydraflow Plan View

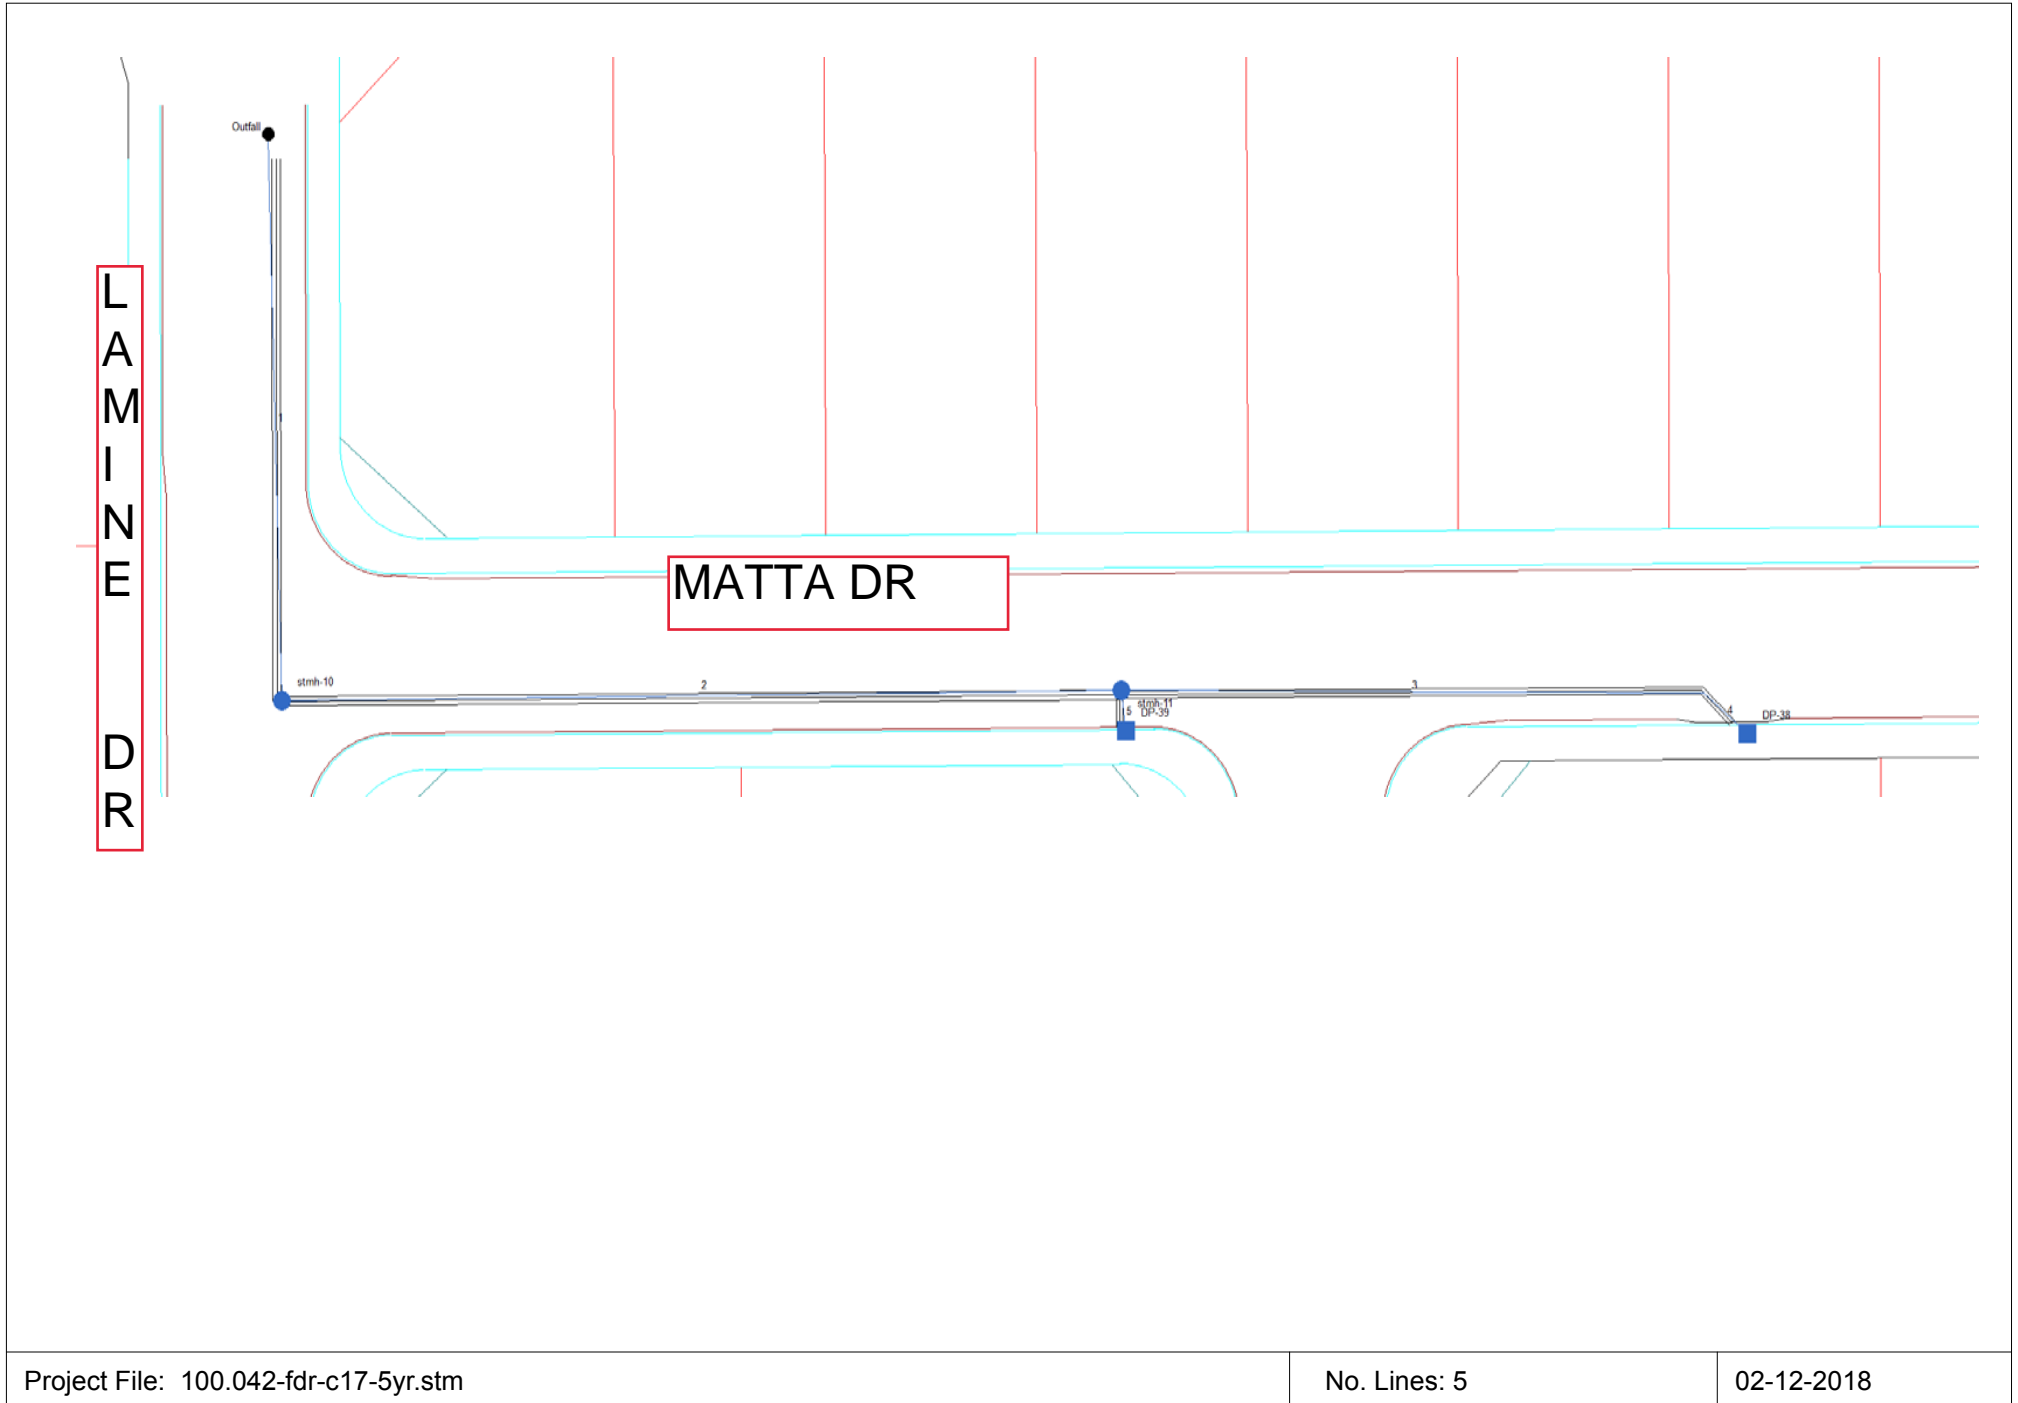

Project File: 100.042-fdr-c17-5yr.stm

No. Lines: 5

02-12-2018

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line size (in)	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line slope (%)	HGL down (ft)	HGL up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns line No.
1		13.91	24 c	122.5	5713.91	5716.81	2.367	5715.26	5718.13	n/a	5718.13 j	End
2		13.97	24 c	199.0	5717.11	5722.80	2.860	5718.44	5724.12	n/a	5724.12 j	1
3		5.88	18 c	137.9	5724.70	5726.36	1.203	5725.46	5727.29	0.12	5727.29	2
4		5.91	18 c	13.6	5726.36	5726.48	0.886	5727.52	5727.50	0.03	5727.53	3
5		8.43	18 c	8.8	5723.80	5724.01	2.382	5724.57*	5725.68*	0.11	5725.79	2

Project File: 100.042-fdr-c17-5yr.stm	Number of lines: 5	Run Date: 02-12-2018
---------------------------------------	--------------------	----------------------


NOTES: c = cir; e = ellip; b = box; Return period = 5 Yrs. ; *Surcharged (HGL above crown). ; j - Line contains hyd. jump.

Storm Sewer Summary Report


Line No.	Line ID	Flow rate (cfs)	Line size (in)	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line slope (%)	HGL down (ft)	HGL up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns line No.
1		26.76	24 c	122.5	5713.91	5716.81	2.367	5715.72	5718.62	n/a	5718.62 j	End
2		26.76	24 c	199.0	5717.11	5722.80	2.860	5718.74	5724.61	0.37	5724.61	1
3		11.83	18 c	137.9	5724.70	5726.36	1.203	5725.97	5727.86	0.21	5728.07	2
4		11.83	18 c	13.6	5726.36	5726.48	0.886	5728.07*	5728.24*	0.07	5728.31	3
5		14.93	18 c	8.8	5723.80	5724.01	2.382	5724.94*	5725.70*	0.33	5726.04	2

Project File: 100.042-fdr-c17-100yr.stm	Number of lines: 5	Run Date: 02-12-2018
---	--------------------	----------------------

NOTES: c = cir; e = ellip; b = box; Return period = 100 Yrs. ; *Surcharged (HGL above crown). ; j - Line contains hyd. jump.

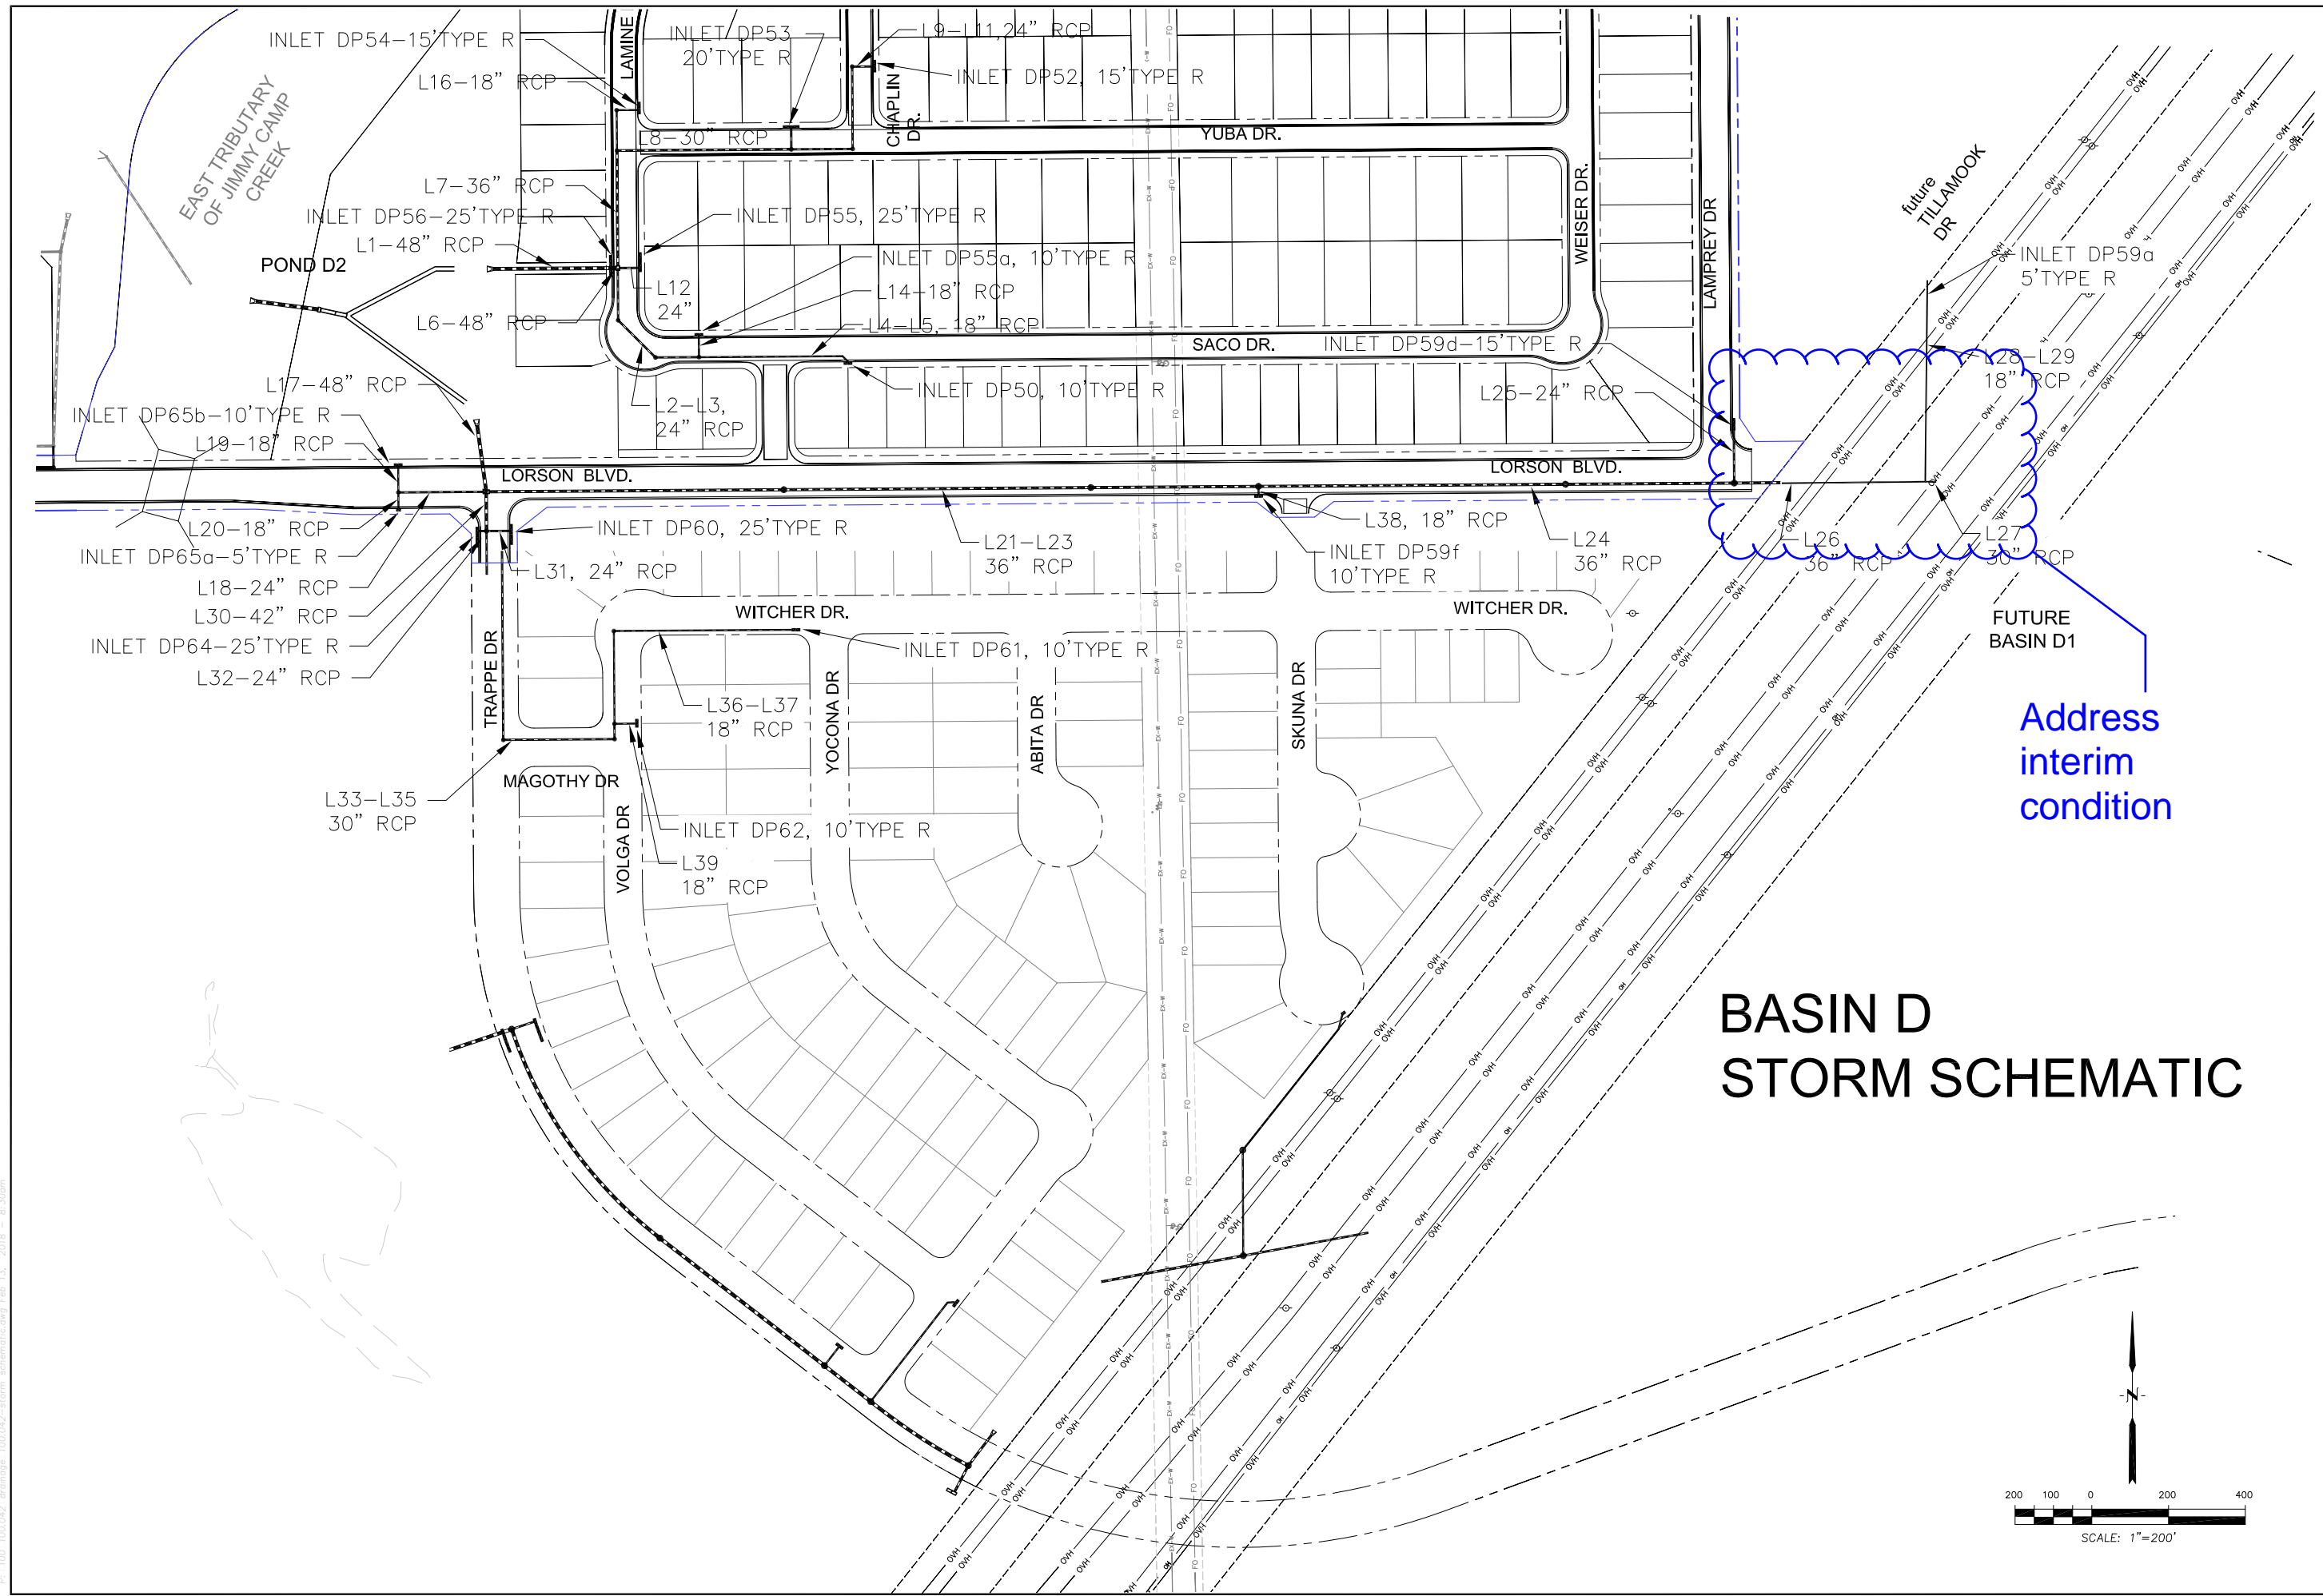

BASIN D STORM SCHEMATIC

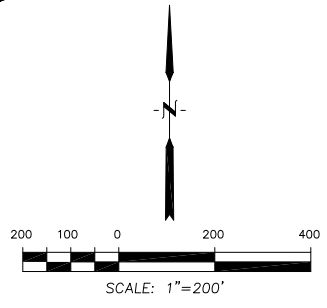

<p>CORE ENGINEERING GROUP 15004 1ST AVE. S. BURNSVILLE, MN 55306 PH: 719.570.1100 CONTACT: RICHARD L. SCHINDLER, P.E. EMAIL: Rich@cegi.com</p>	
DATE	
DESCRIPTION	
NO.	
PROJECT:	<p>LORSON RANCH EAST EAST OF EAST TRIBUTARY EL PASO COUNTY, COLORADO</p>
PREPARED FOR:	<p>LORSON, LLC 212 N. WAHSATCH AVE., SUITE 301 COLORADO SPRINGS, COLORADO 80903 CONTACT: JEFF MARK</p>
DRAWN:	RLS
DESIGNED:	LAB
CHECKED:	LAB
<p>STORM SEWER SCHEMATIC BASIN D LORSON RANCH EAST</p>	
DATE	MARCH 1, 2018
PROJECT NO.	100.042
SHEET NUMBER	1
TOTAL SHEETS:	1

P: 100.100.042_schematic - 100.042-storm_schematic.dwg, Feb. 13, 2018, 8:30am

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line size (in)	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line slope (%)	HGL down (ft)	HGL up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns line No.
1	L1	63.59	48 c	151.0	5697.00	5702.09	3.371	5699.36	5704.45	n/a	5704.45	End
2	L2	14.68	24 c	134.6	5706.29	5708.14	1.376	5707.35	5709.50	n/a	5709.50	1
3	L3	14.68	24 c	64.8	5708.24	5709.42	1.819	5709.81	5710.78	n/a	5710.78 j	2
4	L4	7.34	18 c	186.0	5710.17	5715.01	2.602	5711.16	5716.04	0.10	5716.04	3
5	L5	7.34	18 c	10.0	5715.11	5715.38	2.700	5716.27	5716.41	0.45	5716.41	4
6	L6	41.62	48 c	9.0	5702.59	5704.23	18.224	5705.34	5706.14	0.31	5706.14	1
7	L7	33.79	36 c	147.3	5705.33	5707.67	1.588	5706.65	5709.52	0.34	5709.52	6
8	L8	26.49	30 c	226.5	5708.37	5713.87	2.428	5709.91	5715.59	0.25	5715.59	7
9	L9	12.44	24 c	78.4	5714.92	5718.39	4.425	5716.19	5719.64	n/a	5719.64 j	8
10	L10	12.44	24 c	83.9	5718.68	5720.50	2.168	5719.96	5721.75	n/a	5721.75 j	9
11	L11	12.44	24 c	24.9	5720.70	5721.08	1.525	5722.07	5722.33	n/a	5722.33	10
12	L12	7.83	24 c	25.3	5706.33	5707.11	3.087	5706.93	5708.71	0.00	5708.71	6
13	L13	7.29	30 c	6.0	5707.13	5707.37	4.004	5707.63	5709.37	0.00	5709.37	1
14	L14	7.34	18 c	26.6	5710.44	5710.86	1.577	5711.24	5712.07	0.32	5712.39	3
15	L15	14.05	24 c	29.2	5715.08	5716.06	3.360	5716.12	5717.39	0.00	5717.39	8
16	L16	7.30	18 c	58.9	5709.75	5710.83	1.832	5710.51	5711.86	n/a	5711.86	7
17	L17	87.73	48 c	100.0	5697.00	5699.50	2.500	5699.78	5702.27	0.56	5702.27	End
18	L18	6.17	18 c	101.3	5701.90	5702.93	1.017	5703.47	5703.88	n/a	5703.88 j	17
19	L19	4.16	18 c	30.6	5703.13	5703.45	1.048	5704.22	5704.23	n/a	5704.23 j	18
20	L20	2.00	18 c	20.0	5703.33	5703.73	2.000	5704.29	5704.27	n/a	5704.27 j	18
21	L21	44.98	36 c	403.4	5700.75	5715.00	3.533	5703.03	5717.14	n/a	5717.14 j	17
22	L22	44.98	36 c	400.0	5715.30	5725.70	2.600	5717.59	5727.84	n/a	5727.84 j	21
23	L23	44.98	36 c	217.3	5726.00	5732.00	2.762	5728.29	5734.14	n/a	5734.14 j	22
24	L24	36.40	36 c	621.3	5732.00	5743.26	1.812	5734.81	5745.18	n/a	5745.18 j	23
25	L25	10.66	24 c	67.0	5745.16	5745.96	1.192	5746.08	5747.12	n/a	5747.12	24
26	L26	25.74	36 c	248.8	5743.86	5748.50	1.865	5745.88	5750.12	n/a	5750.12 j	24
27	L27	23.56	30 c	19.8	5749.50	5749.69	0.962	5750.88	5751.60	0.00	5751.60	26
28	L28	2.19	18 c	249.0	5752.72	5762.38	3.879	5753.05	5762.94	n/a	5762.94	26
29	L29	2.19	18 c	10.0	5762.38	5762.68	3.003	5763.12	5763.25	n/a	5763.25 j	28
30	L30	36.58	42 c	53.0	5700.23	5701.27	1.962	5703.43	5703.12	n/a	5703.12	17
31	L31	15.76	24 c	28.1	5702.57	5703.37	2.852	5703.51	5705.36	0.00	5705.36	30
32	L32	3.15	24 c	12.5	5702.97	5703.53	4.493	5703.89	5704.16	n/a	5704.16 j	30

Lorson East fdr-D Basins-5yr

Number of lines: 39

Run Date: 02-13-2018

NOTES: c = cir; e = ellip; b = box; Return period = 5 Yrs. ; j - Line contains hyd. jump.

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line size (in)	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line slope (%)	HGL down (ft)	HGL up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns line No.
33	L33	17.67	24 c	273.9	5702.93	5707.47	1.658	5704.06	5708.96	0.31	5708.96	30
34	L34	17.67	24 c	145.5	5707.81	5710.70	1.987	5709.24	5712.19	0.31	5712.19	33
35	L35	17.67	24 c	19.4	5711.00	5711.30	1.548	5712.47	5712.79	0.31	5712.79	34
36	L36	7.57	18 c	120.7	5711.80	5713.30	1.242	5713.27	5714.35	n/a	5714.35 j	35
37	L37	7.57	18 c	219.8	5713.60	5719.23	2.562	5714.58	5720.28	0.00	5720.28	36
38	L38	8.58	18 c	13.6	5733.60	5733.93	2.430	5734.85	5735.05	0.00	5735.05	23
39	L39	10.10	18 c	28.3	5711.80	5712.09	1.023	5713.05	5713.31	0.00	5713.31	35

Lorson East fdr-D Basins-5yr	Number of lines: 39	Run Date: 02-13-2018
-------------------------------------	---------------------	----------------------

NOTES: c = cir; e = ellip; b = box; Return period = 5 Yrs. ; j - Line contains hyd. jump.

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line size (in)	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line slope (%)	HGL down (ft)	HGL up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns line No.
1	L1	122.0	48 c	141.4	5697.00	5702.09	3.601	5700.27	5705.36	0.77	5705.36	End
2	L2	21.57	24 c	134.2	5706.09	5707.84	1.304	5707.49	5709.49	0.19	5709.49	1
3	L3	21.60	24 c	61.7	5708.24	5709.42	1.910	5709.70	5711.07	0.28	5711.07	2
4	L4	10.76	18 c	186.4	5710.17	5715.01	2.597	5711.44	5716.26	n/a	5716.26 j	3
5	L5	10.77	18 c	10.0	5715.11	5715.38	2.700	5716.41	5716.63	0.65	5716.63	4
6	L6	109.9	48 c	8.5	5702.59	5704.23	19.305	5706.08	5707.33	n/a	5707.33	1
7	L7	57.07	36 c	146.7	5705.33	5707.67	1.594	5708.03	5710.08	n/a	5710.08	6
8	L8	44.73	30 c	226.5	5708.37	5713.87	2.428	5710.15	5716.10	n/a	5716.10	7
9	L9	18.65	24 c	78.4	5714.92	5718.39	4.425	5717.01	5719.92	n/a	5719.92 j	8
10	L10	18.77	24 c	83.9	5718.68	5720.50	2.168	5720.18	5722.04	0.25	5722.04	9
11	L11	18.80	24 c	24.9	5720.70	5720.98	1.123	5722.30	5722.52	0.00	5722.52	10
12	L12	31.70	24 c	25.6	5706.33	5707.11	3.051	5707.69*	5709.78*	0.00	5709.78	6
13	L13	29.70	30 c	6.0	5707.13	5707.37	4.004	5708.17*	5711.41*	0.00	5711.41	1
14	L14	10.83	18 c	26.6	5710.44	5710.86	1.577	5711.48	5712.28	0.55	5712.83	3
15	L15	25.53	24 c	29.2	5715.08	5716.06	3.360	5716.53	5717.84	0.00	5717.84	8
16	L16	12.63	18 c	58.9	5709.75	5710.83	1.832	5710.85	5712.17	0.00	5712.17	7
17	L17	173.6	48 c	100.0	5697.00	5699.50	2.500	5700.75	5703.25	1.25	5703.25	End
18	L18	15.99	24 c	101.3	5701.50	5702.63	1.115	5705.97*	5706.48*	0.16	5706.64	17
19	L19	12.70	18 c	30.6	5702.93	5703.25	1.046	5706.64*	5707.09*	0.00	5707.09	18
20	L20	3.59	18 c	20.0	5702.93	5703.33	2.000	5706.98*	5707.00*	0.00	5707.00	18
21	L21	103.3	36 c	400.0	5700.75	5715.00	3.563	5703.25	5717.91	n/a	5717.91	17
22	L22	103.9	36 c	400.0	5715.30	5725.70	2.600	5717.93	5728.61	0.00	5728.61	21
23	L23	104.2	36 c	217.3	5726.00	5732.00	2.762	5728.65	5734.91	1.03	5734.91	22
24	L24	93.04	36 c	621.3	5732.00	5743.26	1.812	5735.66*	5747.75*	1.08	5748.83	23
25	L25	20.30	24 c	67.0	5745.06	5745.96	1.343	5750.87*	5751.41*	0.00	5751.41	24
26	L26	75.38	36 c	251.2	5744.56	5749.20	1.847	5749.75*	5752.96*	0.53	5753.49	24
27	L27	60.85	30 c	27.3	5750.00	5750.49	1.793	5753.49*	5754.10*	0.00	5754.10	26
28	L28	4.84	18 c	249.0	5752.72	5762.38	3.879	5755.15	5763.22	n/a	5763.22 j	26
29	L29	4.85	18 c	10.0	5762.38	5762.68	3.003	5763.45	5763.52	n/a	5763.52 j	28
30	L30	88.30	42 c	53.7	5700.23	5701.27	1.935	5705.07*	5705.48*	0.52	5706.01	17
31	L31	31.70	24 c	28.1	5702.97	5703.77	2.843	5706.01*	5706.56*	0.00	5706.56	30
32	L32	29.20	24 c	13.0	5702.97	5703.48	3.934	5706.01*	5706.22*	0.40	5706.63	30

Lorson East fdr- D Basins-100y

Number of lines: 39

Run Date: 02-13-2018

NOTES: c = cir; e = ellip; b = box; Return period = 100 Yrs. ; *Surcharged (HGL above crown). ; j - Line contains hyd. jump.

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line size (in)	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line slope (%)	HGL down (ft)	HGL up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns line No.
33	L33	27.33	24 c	272.5	5702.98	5707.49	1.655	5706.14*	5710.12*	0.35	5710.47	30
34	L34	27.37	24 c	144.3	5707.81	5710.40	1.795	5710.47*	5712.58*	0.35	5712.94	33
35	L35	27.38	24 c	19.4	5710.70	5711.20	2.581	5712.94	5713.20	0.47	5713.67	34
36	L36	11.08	18 c	120.7	5711.70	5714.00	1.905	5714.24	5715.46	0.19	5715.65	35
37	L37	11.08	18 c	219.8	5714.20	5719.23	2.288	5715.66	5720.50	n/a	5720.50 j	36
38	L38	12.37	18 c	13.6	5733.60	5733.93	2.430	5737.59*	5737.78*	0.00	5737.78	23
39	L39	16.30	18 c	28.3	5711.80	5712.09	1.023	5713.67*	5714.35*	0.00	5714.35	35

Lorson East fdr- D Basins-100y	Number of lines: 39	Run Date: 02-13-2018
---------------------------------------	---------------------	----------------------

NOTES: c = cir; e = ellip; b = box; Return period = 100 Yrs. ; *Surcharged (HGL above crown). ; j - Line contains hyd. jump.

APPENDIX F –INTERIM POND CALCULATIONS BY HYDRAFLOW

Weir Report

POND C5 EMERGENCY OVERFLOW - 510cfs

Trapezoidal Weir


Crest = Sharp
Bottom Length (ft) = 52.00
Total Depth (ft) = 3.00
Side Slope (z:1) = 4.00

Highlighted

Depth (ft) = 2.00
Q (cfs) = 510.00
Area (sqft) = 120.00
Velocity (ft/s) = 4.25
Top Width (ft) = 68.00

Calculations

Weir Coeff. Cw = 3.10
Compute by: Known Q
Known Q (cfs) = 510.00

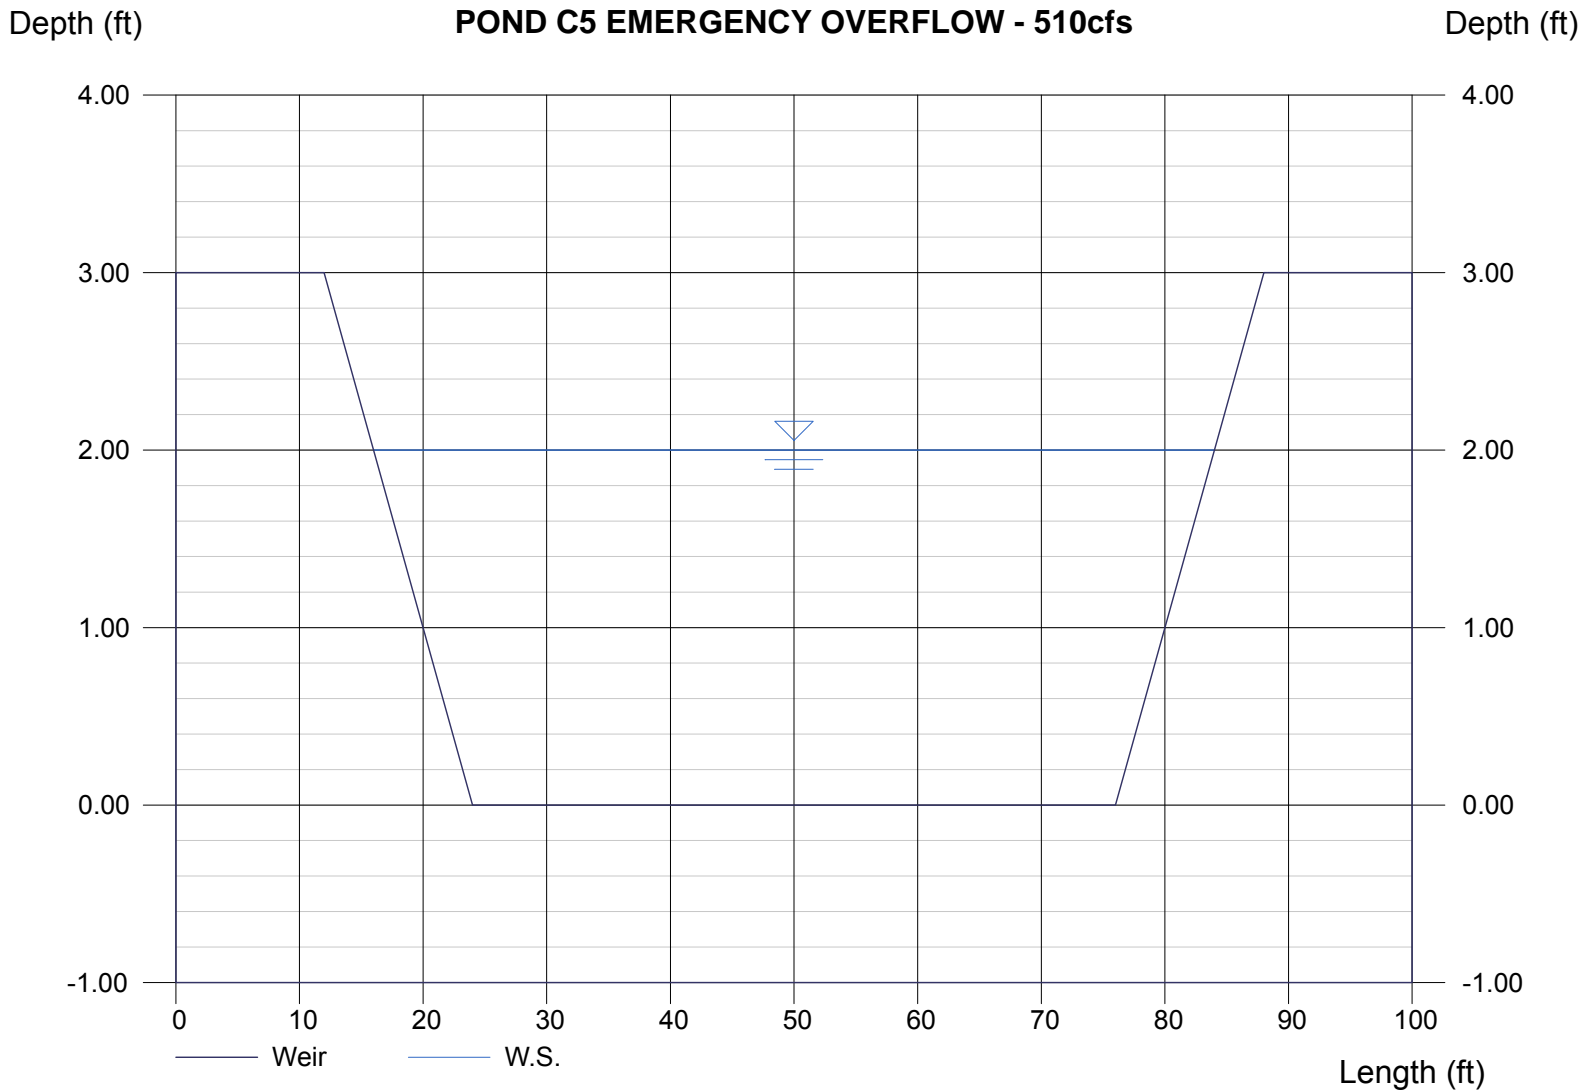

MAP POCKET


DESIGN POINT SUMMARY TABLE								
DESIGN POINT	Basin	Drainage Area (AC)	Runoff 2 Yr (CFS)	Runoff 5 Yr (CFS)	Runoff 10 Yr (CFS)	Runoff 25 Yr (CFS)	Runoff 50 Yr (CFS)	Runoff 100 Yr (CFS)
1	EX-B	20.06		10.5				58.8
2	EX-C*	452.97	17.1	141.0	189.0	263.8	368.7	458.0
3	EX-D	109.55		29.7				166.5
4	EX-E*	187.30	22.4	104.0	135.4	179.3	237.6	286.0
5	EX-F	39.85		19.3				113.7
6	EX-G	14.91		7.9				44.1
7	EX-H	28.13		12.3				73.2
8	EX-I	32.92		12.4				74.1
9	EX-J	25.78		9.0				55.9
10	EX-K	7.57		2.1				15.2

* 2, 10, 25, 50-YEAR STORMS USED TO COMPARE EXISTING-DEVELOPED AT ETRIB

EAST TRIBUTARY FEMA FLOW DATA		EAST TRIBUTARY DBPS FLOW DATA		
DESIGN POINT	Runoff 10 Yr (CFS)	Runoff 100 Yr (CFS)	Runoff 2 Yr (CFS)	Runoff 100 Yr (CFS)
ET1	2400	4750	100	4220
ET2	2600	5200	110	4530
ET3	2800	5500	110	4570
ET4	2800	5500	120	4600

LEGEND

- BASIN BOUNDARY-MAJOR
- BASIN BOUNDARY-MINOR
- BASIN DESIGN POINT
- BASIN I.D. ACREAGE 5 YR/100 YR CFS
- DIRECTION OF FLOW
- EXISTING CONTOUR
- TIME OF CONCENTRATION
- 100-YR FLOODPLAIN

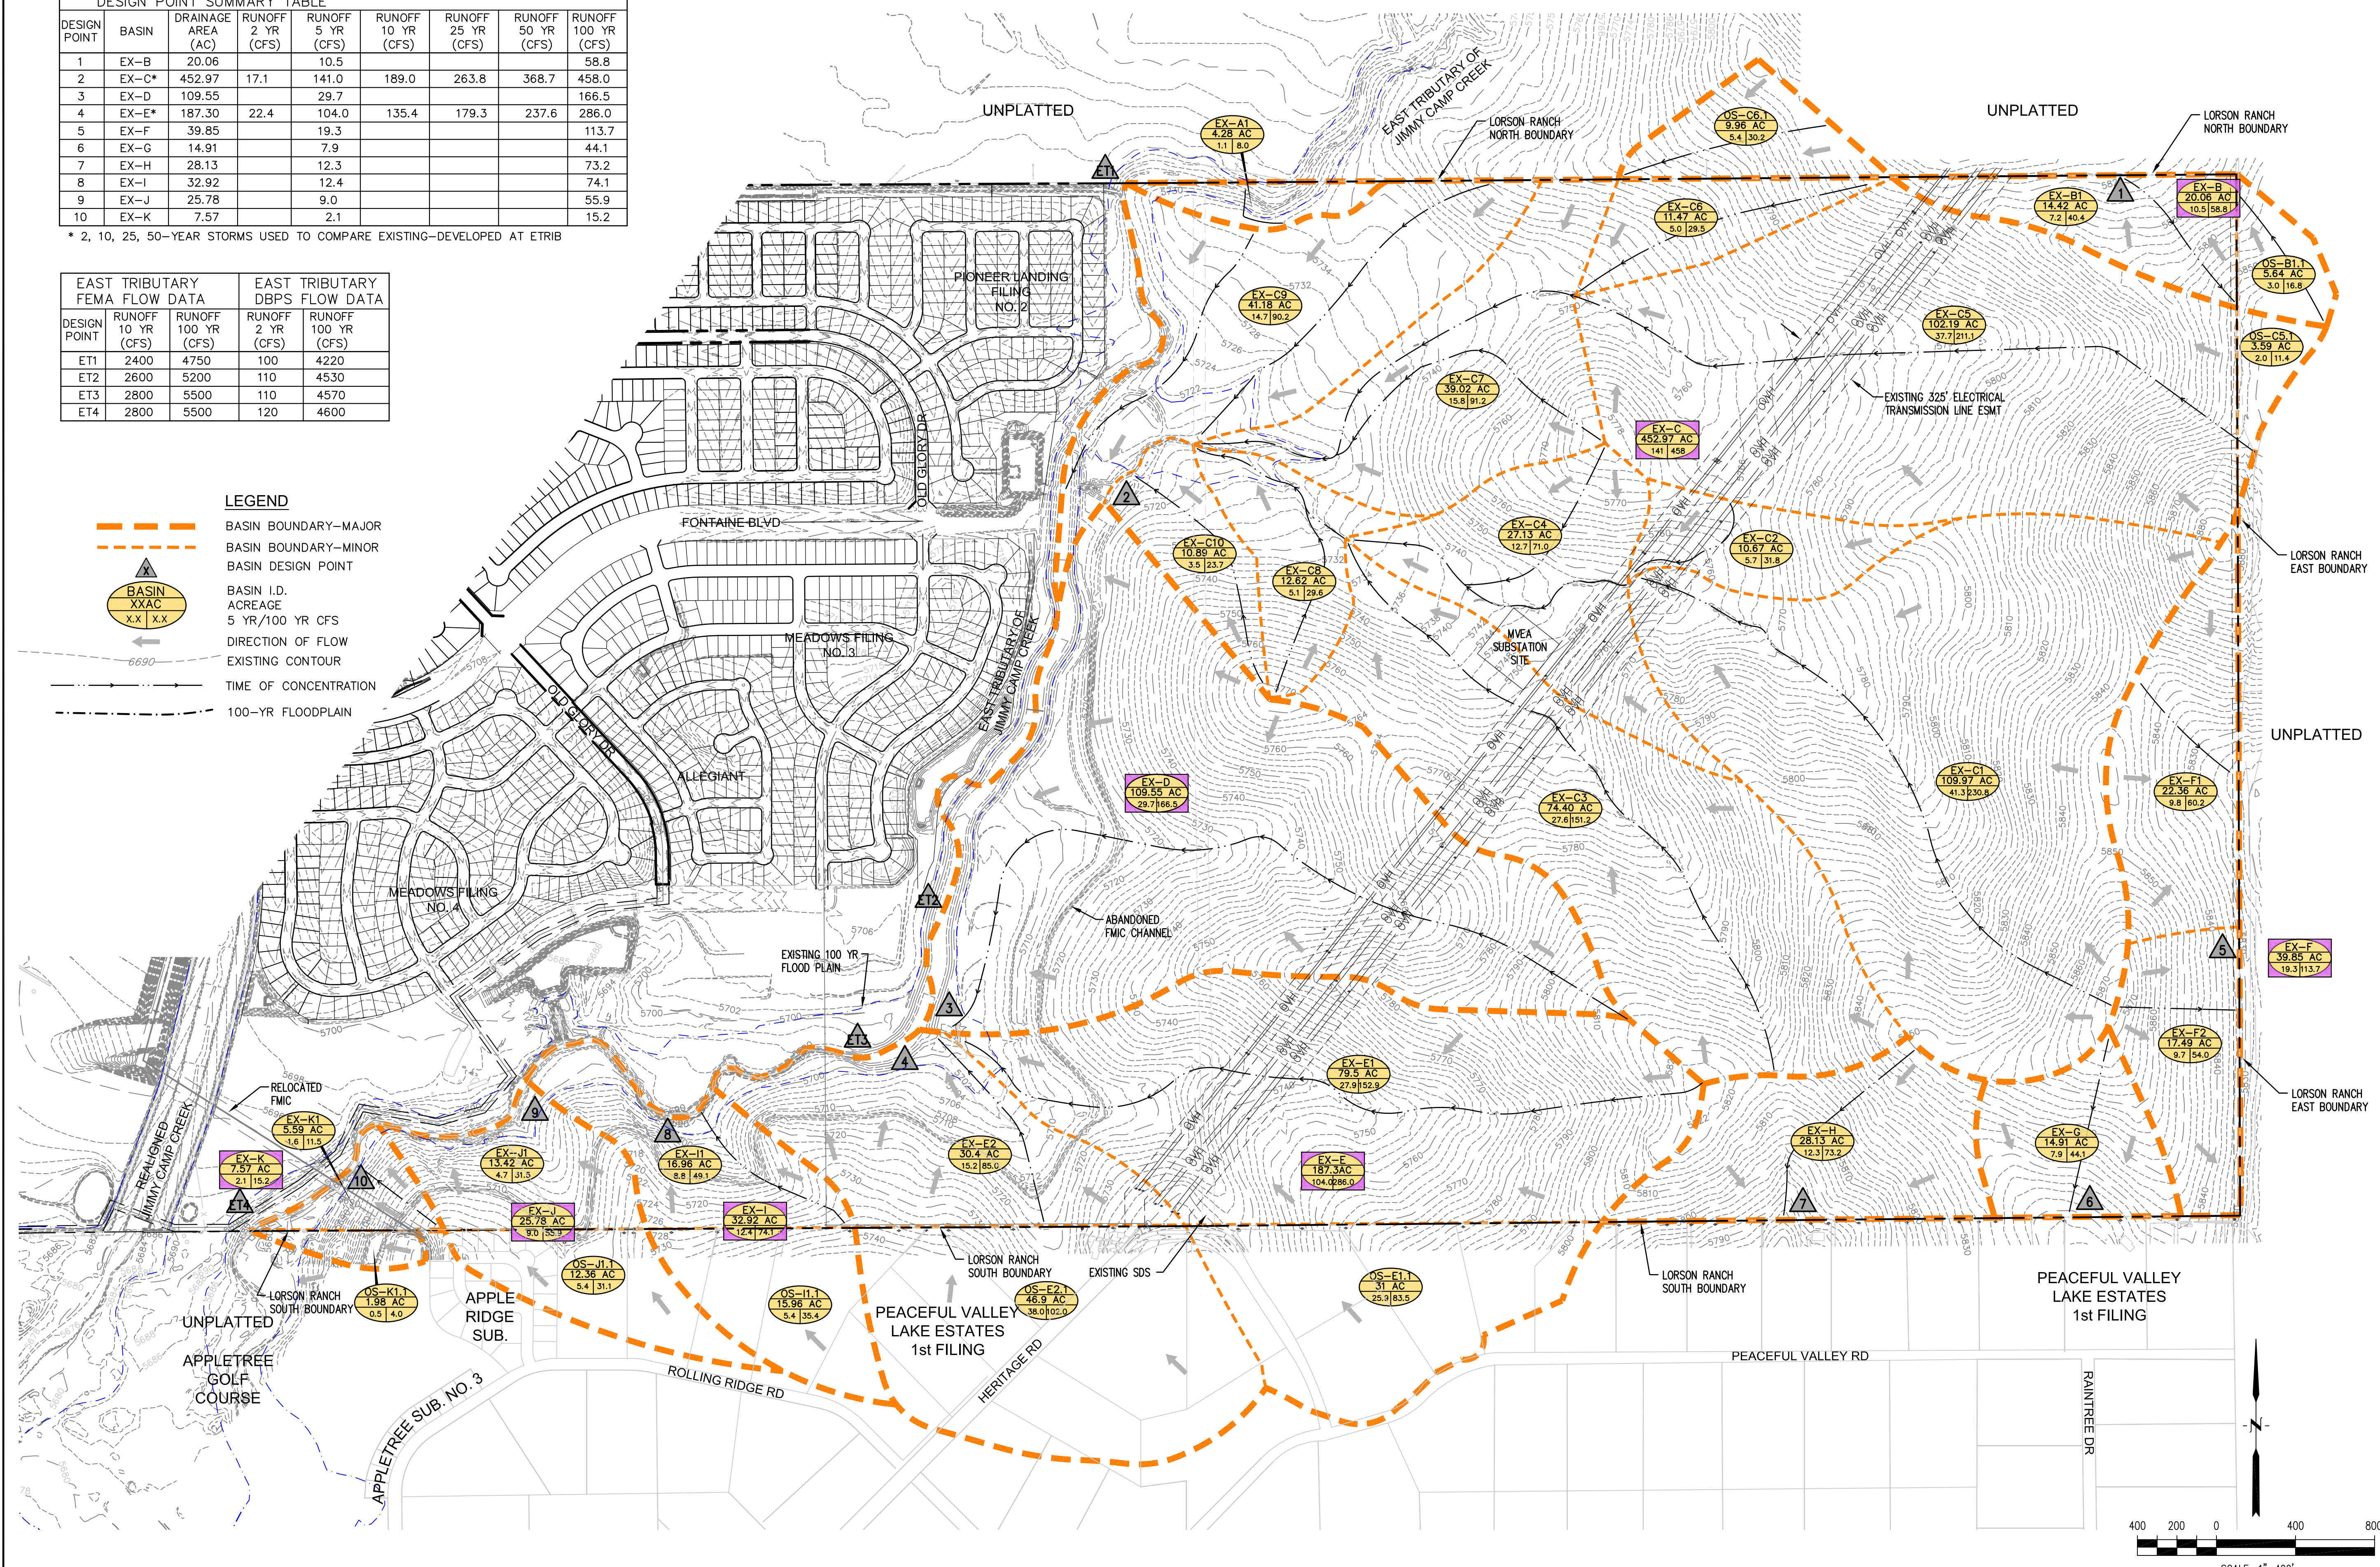


CORE ENGINEERING GROUP
 15004 1ST AVENUE S.
 P.O. BOX 100
 CONTACT: RICHARD L. SCHINDLER, P.E.
 EMAIL: Rich@cegi.com

DATE: _____
 DESCRIPTION: _____
 NO. _____
 PROJECT: **LORSON RANCH EAST MDDP**
 PREPARED FOR: **LORSON LLC**
 212 NORTH WAHATCH AVE, SUITE 301
 COLORADO SPRINGS, COLORADO 80903 (719) 635-3200
 CONTACT: JEFF MARK

EXISTING CONDITIONS
LORSON RANCH EAST MDDP
EAST OF ETRIB OF JIMMY CAMP CREEK

DATE: NOV, 2017
 PROJECT NO. 100.013
 SHEET NUMBER 1
 TOTAL SHEETS: 1

LEGEND

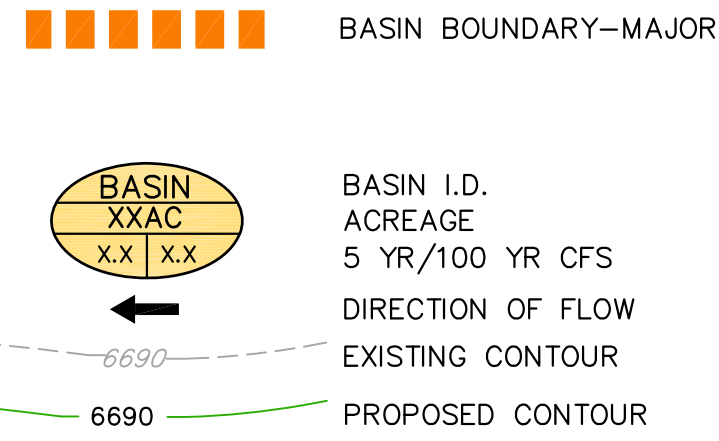

EXISTING VERSUSES DEVELOPED FLOW AT OUTFLOWS TO ETRIB				
DESIGN POINT	EXISTING RUNOFF 5 YR (CFS)	EXISTING RUNOFF 100 YR (CFS)	DEVELOPED RUNOFF 5 YR (CFS)	DEVELOPED RUNOFF 100 YR (CFS)
46	141	458	121	443
58a	29.7	166.5	8.8	133.6

DATA FROM LORSON EAST MDDP

LORSON RANCH EAST FILING NO. 1
FINAL PLAT SITE AREA

NOTE: Add storm drain linetypes.

1. OVERALL BASIN "C" FLOWS TO FULL SPECTRUM DETENTION POND C5. SEE LORSON RANCH EAST MDDP AND PDR FOR POND CALCULATIONS.

2. SEE FONTAINE BLVD. FDR (CDR183) FOR BASIN "C" FLOWS INCLUDING TRUNK STORM SEWER LINES AND EXISTING FLOWS TO FONTAINE BLVD.



3. OVERALL BASIN "D" FLOWS TO FULL SPECTRUM DETENTION POND D2. SEE LORSON RANCH EAST MDDP AND PDR FOR POND CALCULATIONS

Include in this report as if that report doesn't exist. (See comment 1.a on that project.)

Label bridges and provide channel design points and flows.

Show storm sewer

Where is boundary (aren't basins EX1 through EX3 included)?

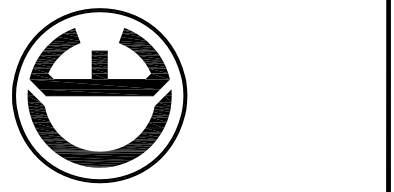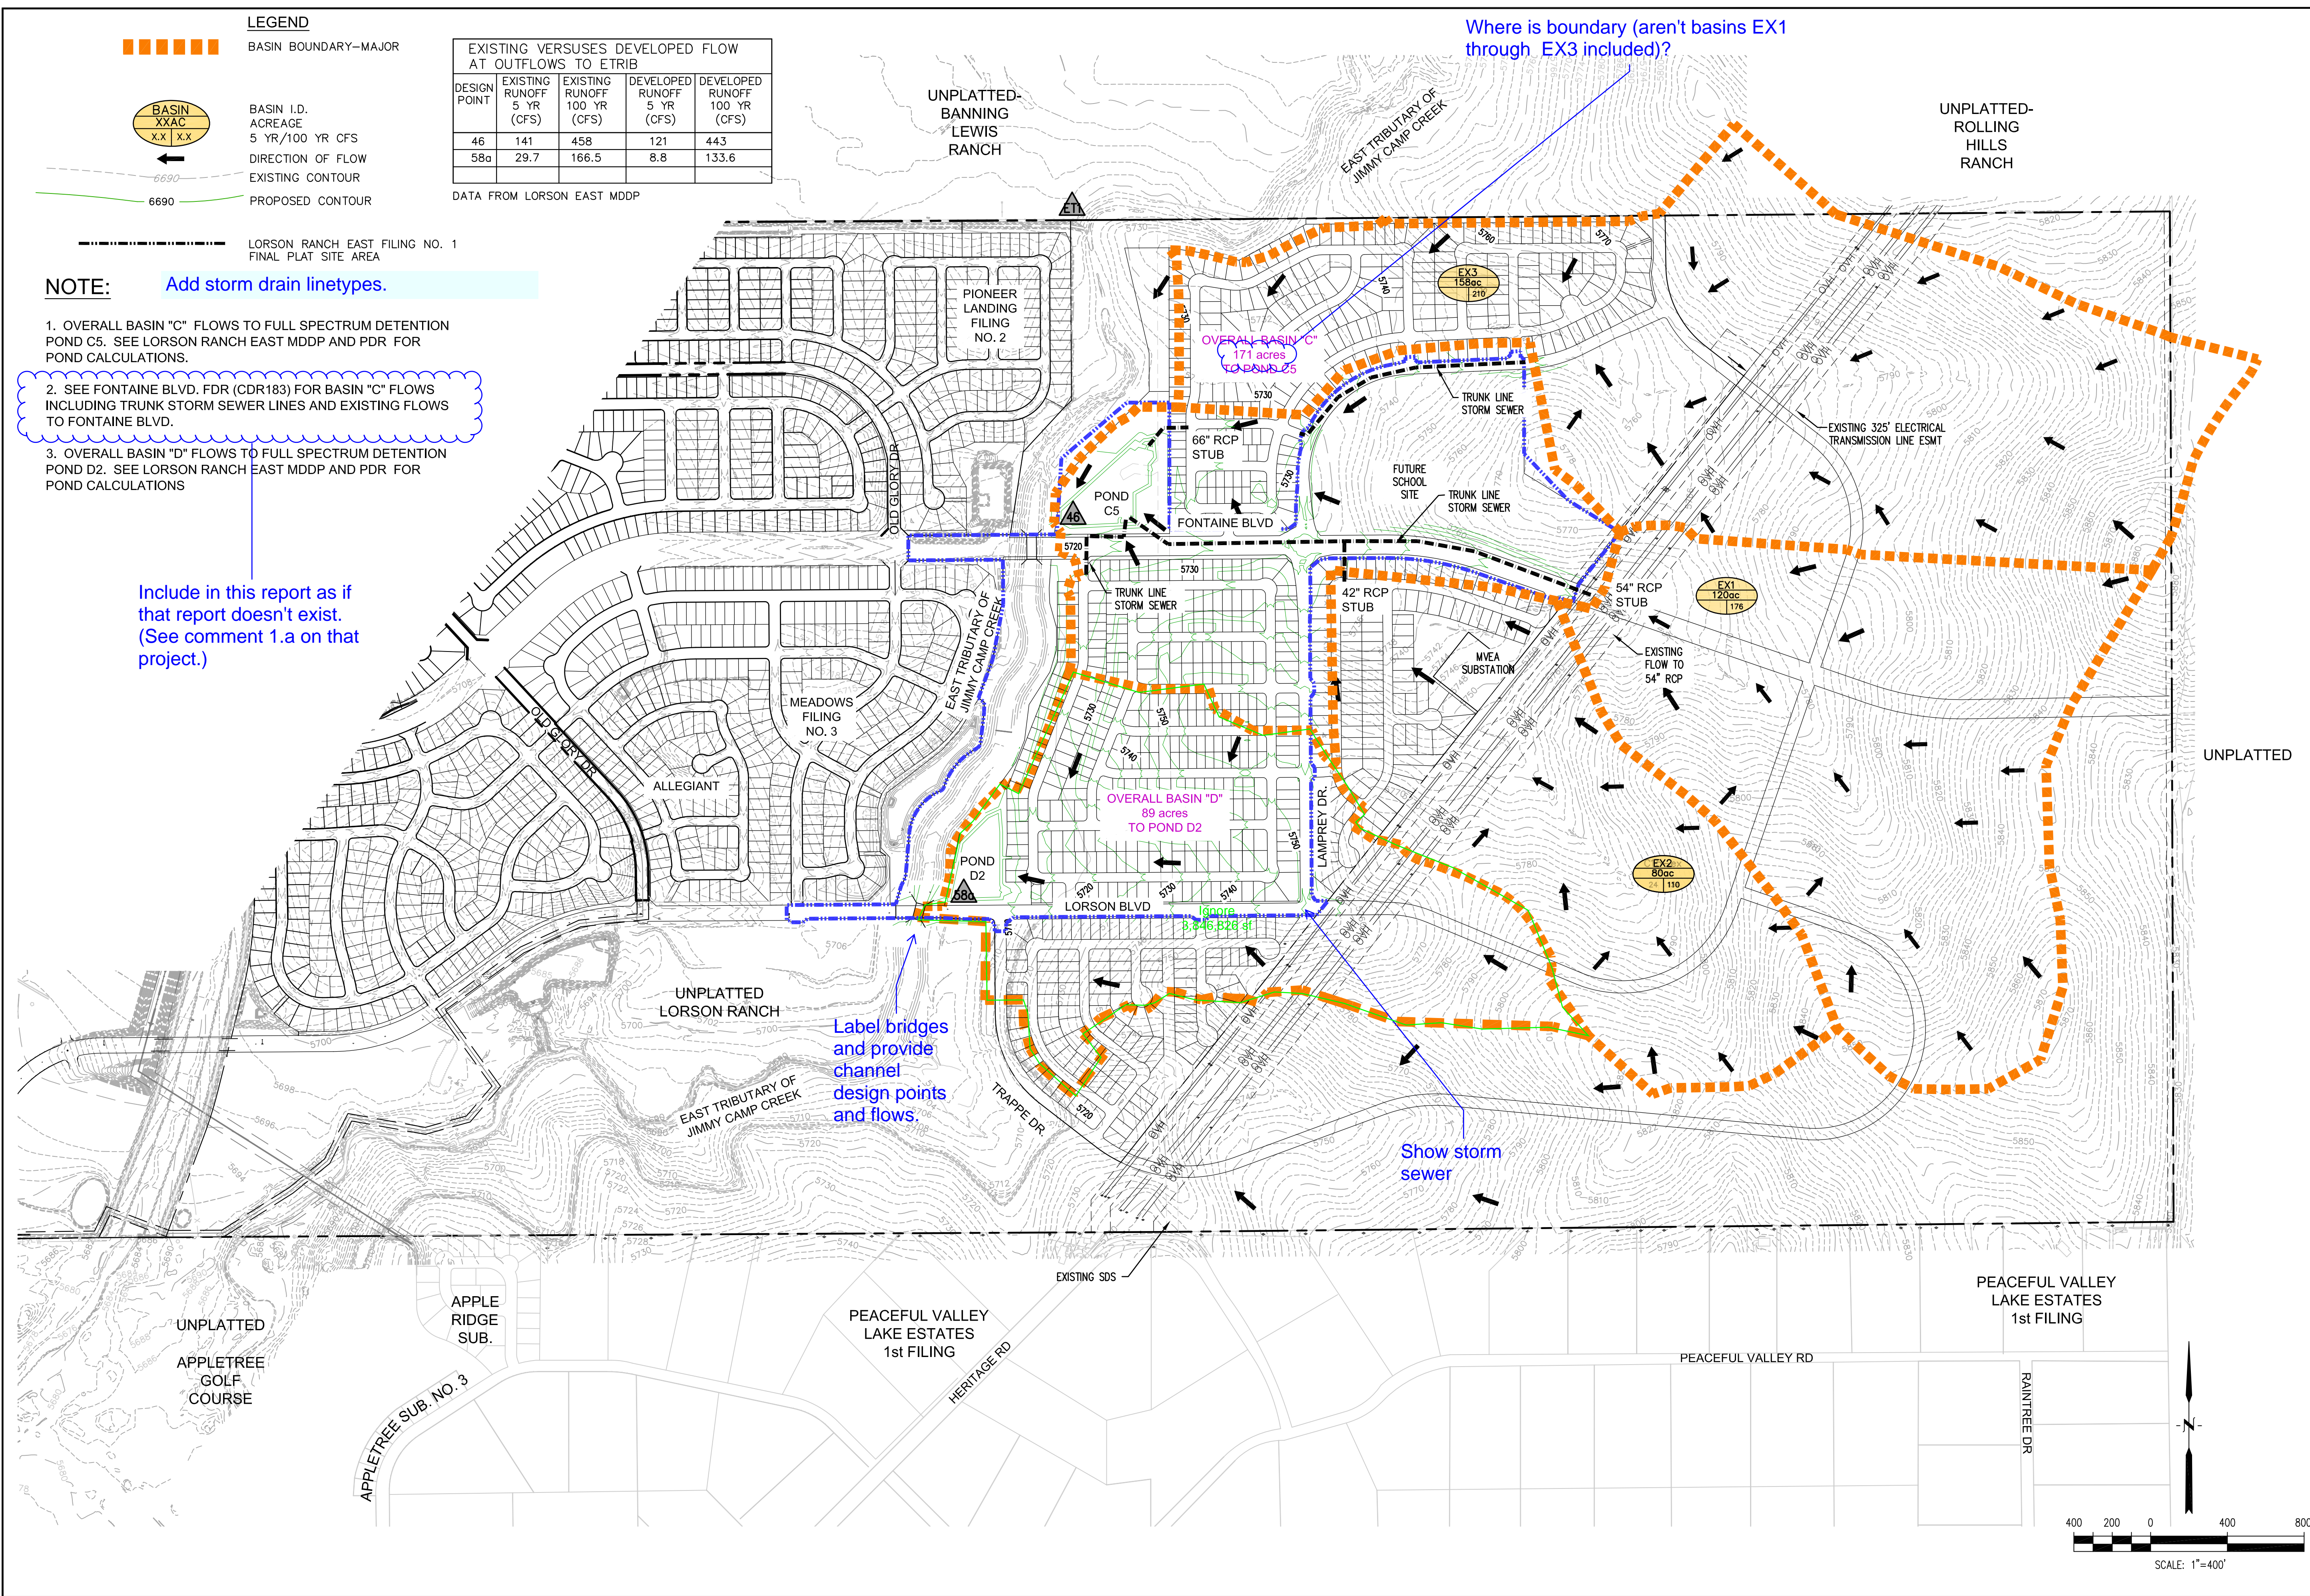


LEGEND

- DRAINAGE MAJOR BASIN BOUNDARY
- DRAINAGE MINOR BASIN BOUNDARY (OFF-SITE)
- SITE BOUNDARY
- BASIN I.D.
ACREAGE
5 YR/100 YR CFS
- DIRECTION OF FLOW
- EXISTING CONTOUR
- PROPOSED CONTOUR
- HP
LP
- TIME OF CONCENTRATION
- 100-YR FLOODPLAIN (FEMA)


RUNOFF SUMMARY

DESIGN POINT	5 YEAR	100 YEAR	NOTES
28	5.3	11.56	STREET FLOW-SEE FONTAINE FDR
29	8.6	20.8	STREET FLOW-SEE FONTAINE FDR
30	7.2	20.1	STREET FLOW-SEE FONTAINE FDR
38	5.9	14.43	STREET FLOW
39	8.61	21.53	STREET FLOW
40	12.9	39.4	STREET FLOW-SEE FONTAINE FDR
41	2.0	19.3	STREET FLOW-SEE FONTAINE FDR
52	15.44	34.7	STREET FLOW
53	14.65	41.47	STREET FLOW
54	7.26	15.5	STREET FLOW
55a	10.18	22.63	STREET FLOW
55	7.8	40.0	STREET FLOW
56	7.2	29.7	STREET FLOW
59a	2.2	4.8	STREET FLOW

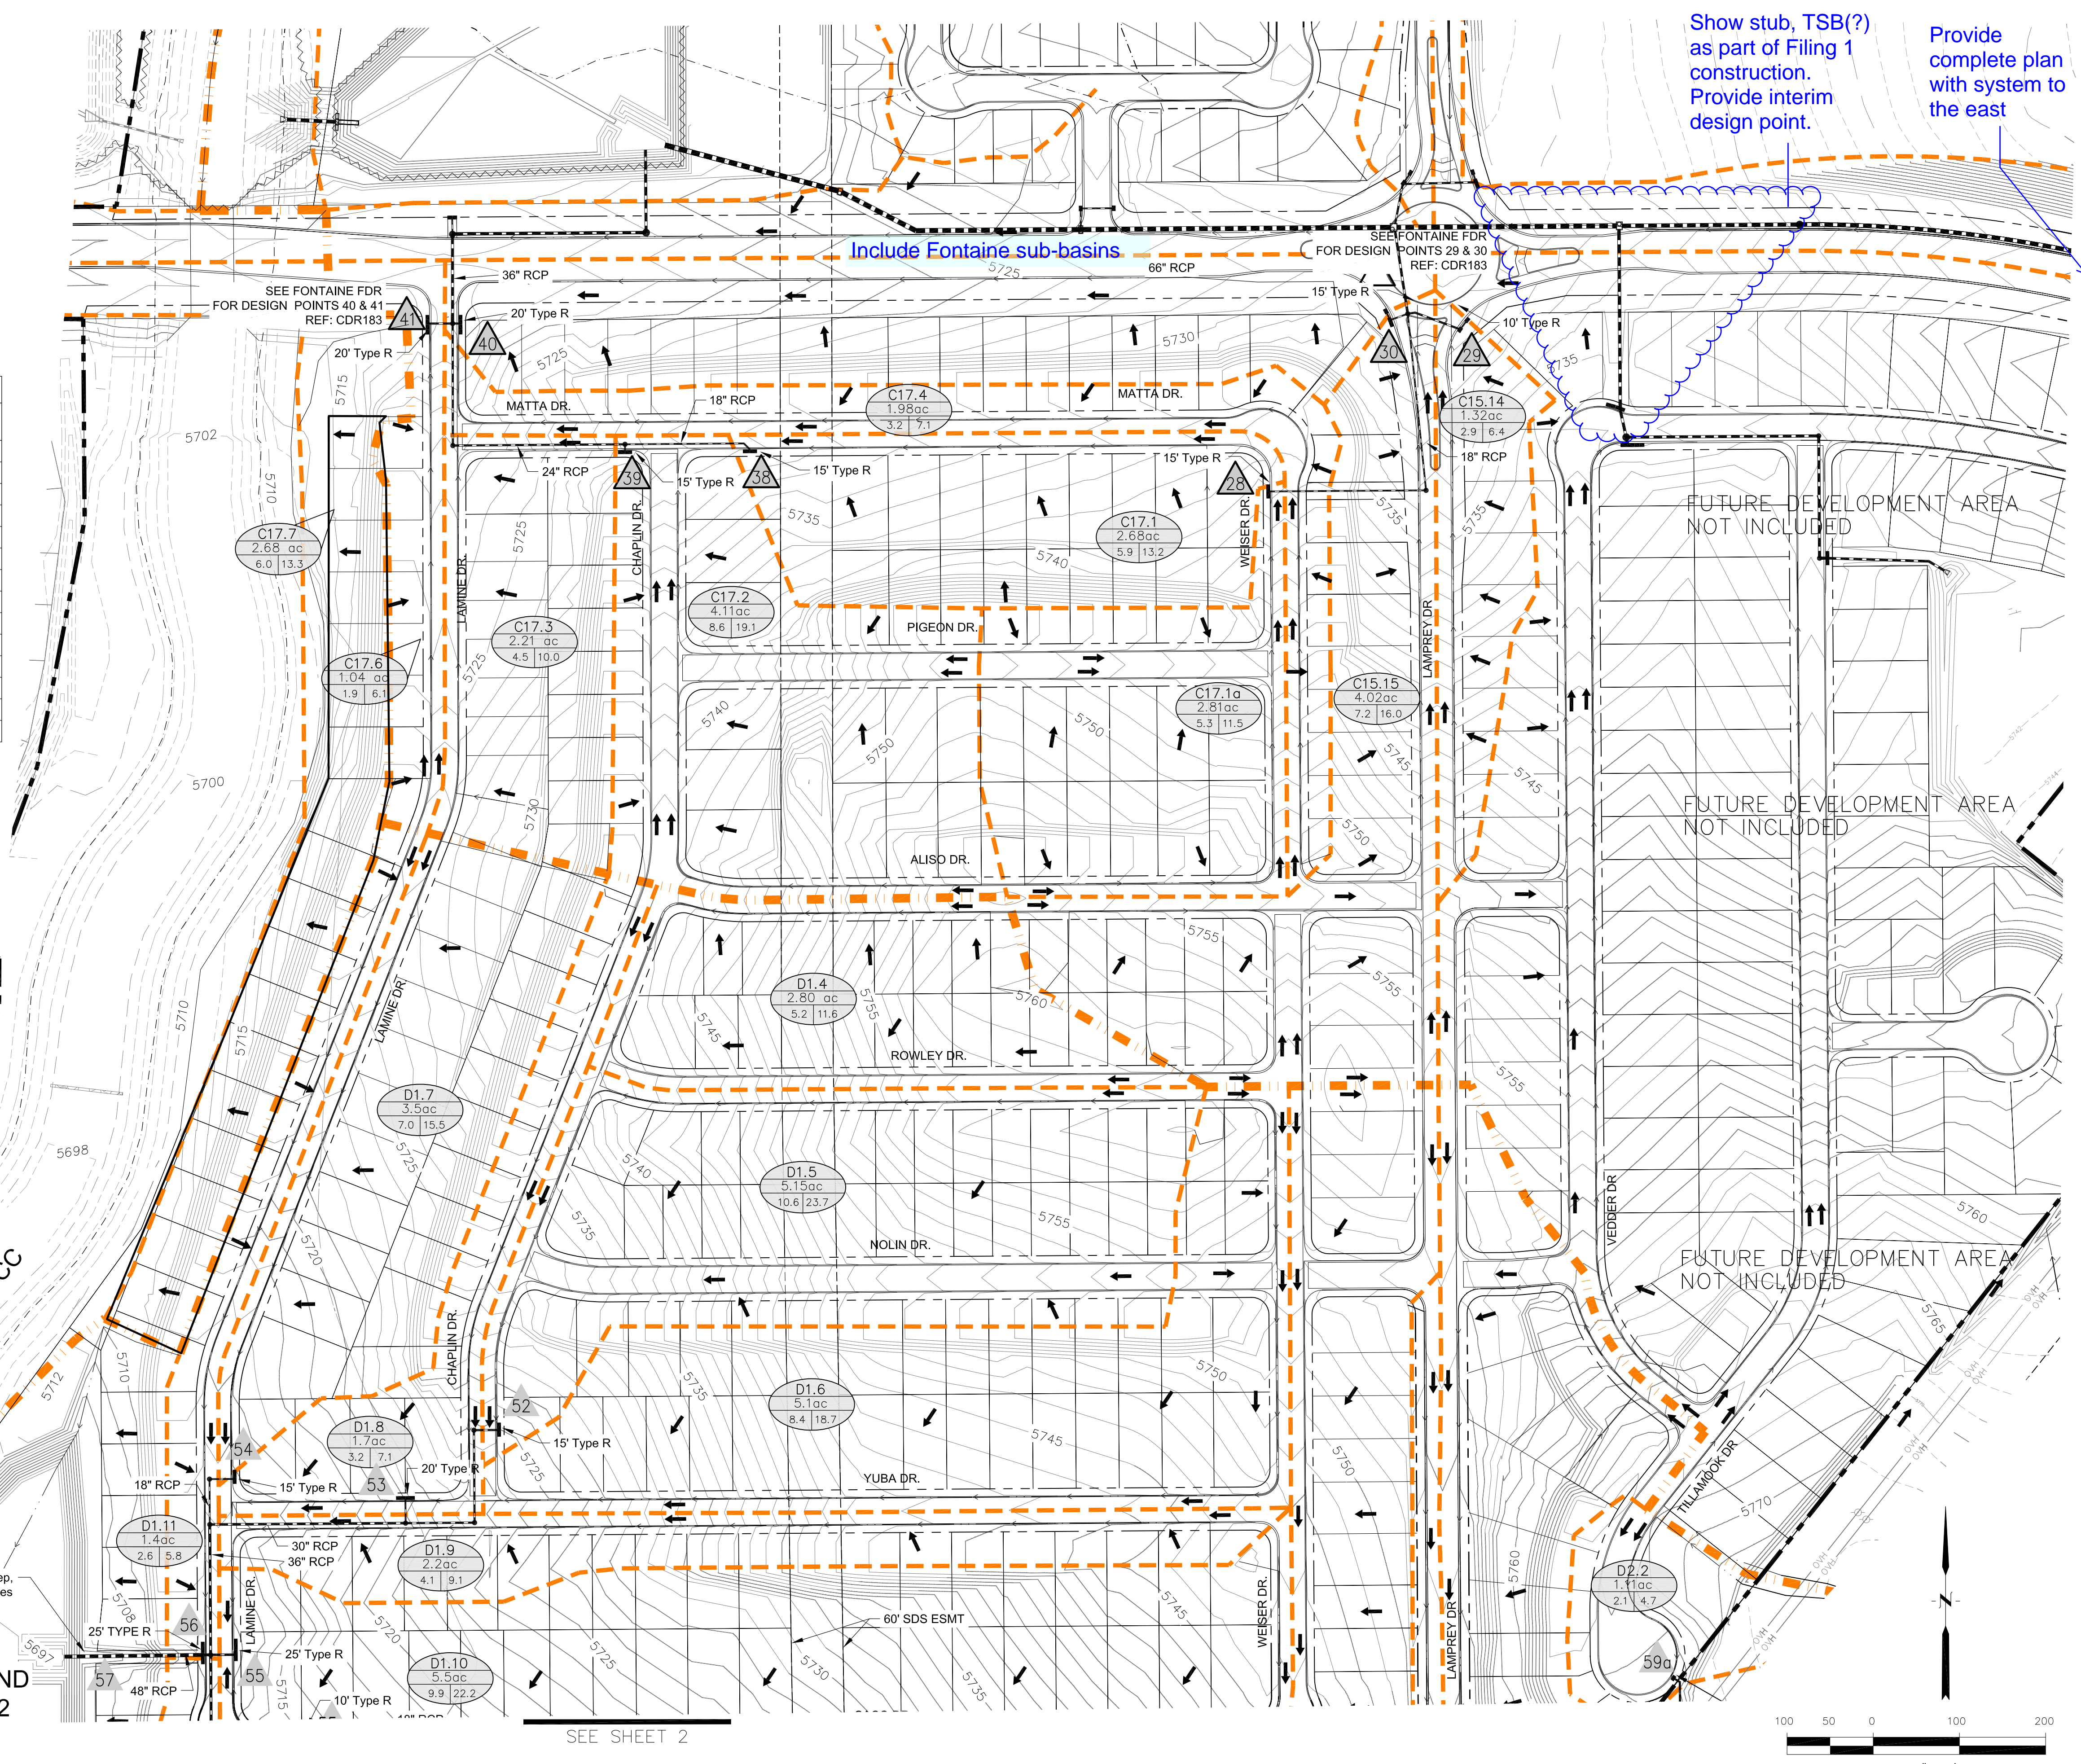


Show stub, TSB(?) as part of Filing 1 construction. Provide interim design point.

Provide complete plan with system to the east

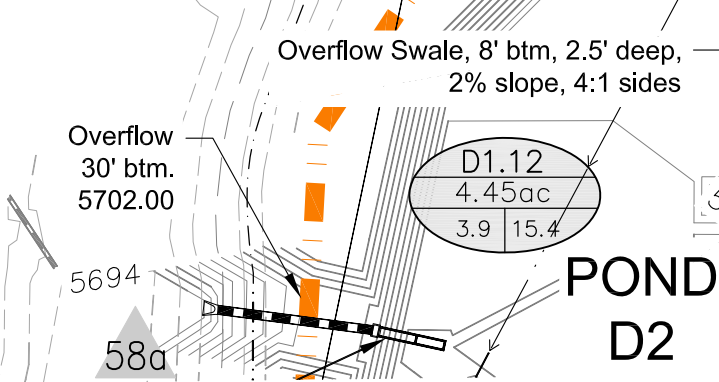

SEE SHEET 2

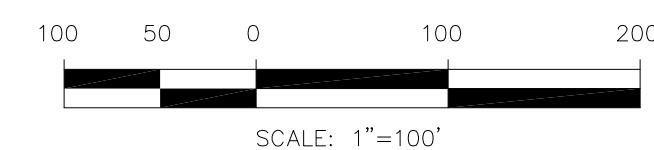

CORE ENGINEERING GROUP
 15004 1ST AVE. S.
 BURNSVILLE, MN 55306
 PH: 719.570.1100
 CONTACT: RICHARD L. SCHINDLER, P.E.
 EMAIL: Rich@cegi.com

DATE: _____
 DESCRIPTION: _____
 NO. _____
 DRAWN: RLS
 DESIGNED: LAB
 CHECKED: LAB

PREPARED FOR:
LORSON, LLC
 212 N. WASSATCH AVE. SUITE 301
 COLORADO SPRING, COLORADO 80903
 CONTACT: JEFF MARK

PROJECT:
LORSON RANCH EAST
 FONTAINE BLVD. EAST PRIBRARY OF JCC
 EL PASO COUNTY, COLORADO


DEVELOPED CONDITIONS
LORSON RANCH EAST FILING NO. 1

DATE
MARCH 1, 2018

PROJECT NO.
100.042

SHEET NUMBER
1

TOTAL SHEETS: **2**

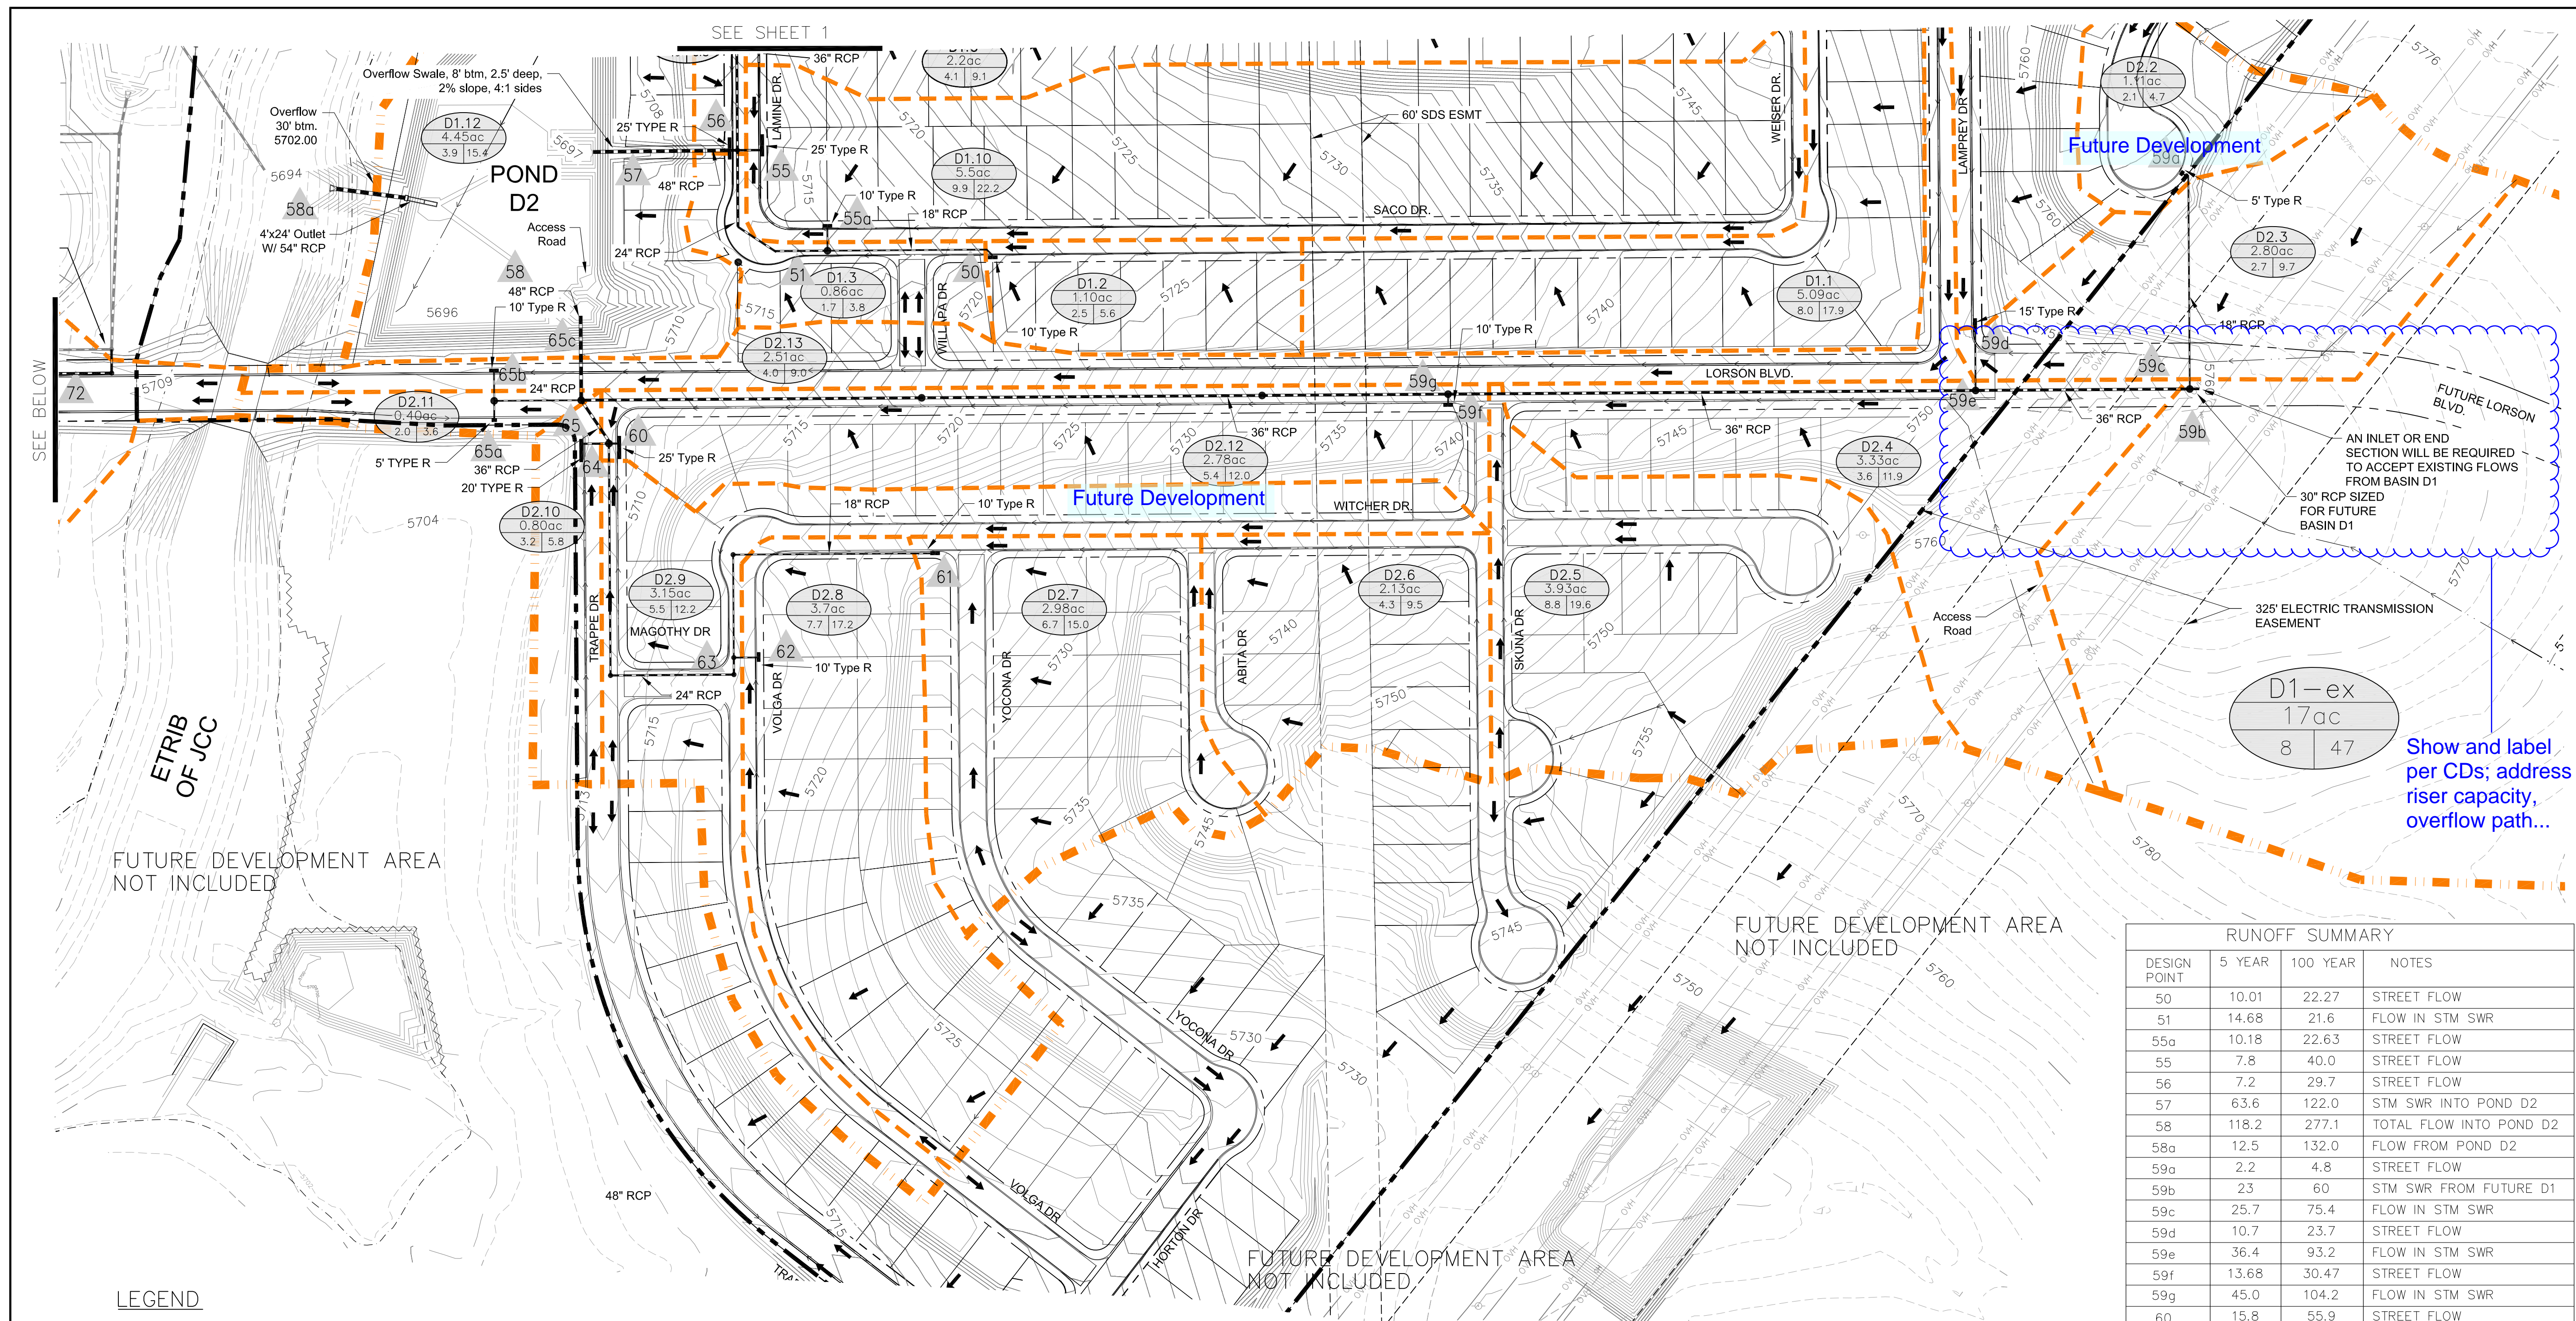


LEGEND

- DRAINAGE MAJOR BASIN BOUNDARY
- - - DRAINAGE MINOR BASIN BOUNDARY (OFF-SITE)
- - - SITE BOUNDARY

	BASIN I.D.
XX AC	ACREAGE
X.X X.X	5 YR/100 YR CFS
	DIRECTION OF FLOW
6690	EXISTING CONTOUR
6670	PROPOSED CONTOUR
HP	HIGH POINT
LP	LOW POINT

TIME OF CONCENTRATION
100-YR FLOODPLAIN (FEMA)

SCALE: 1"=100'

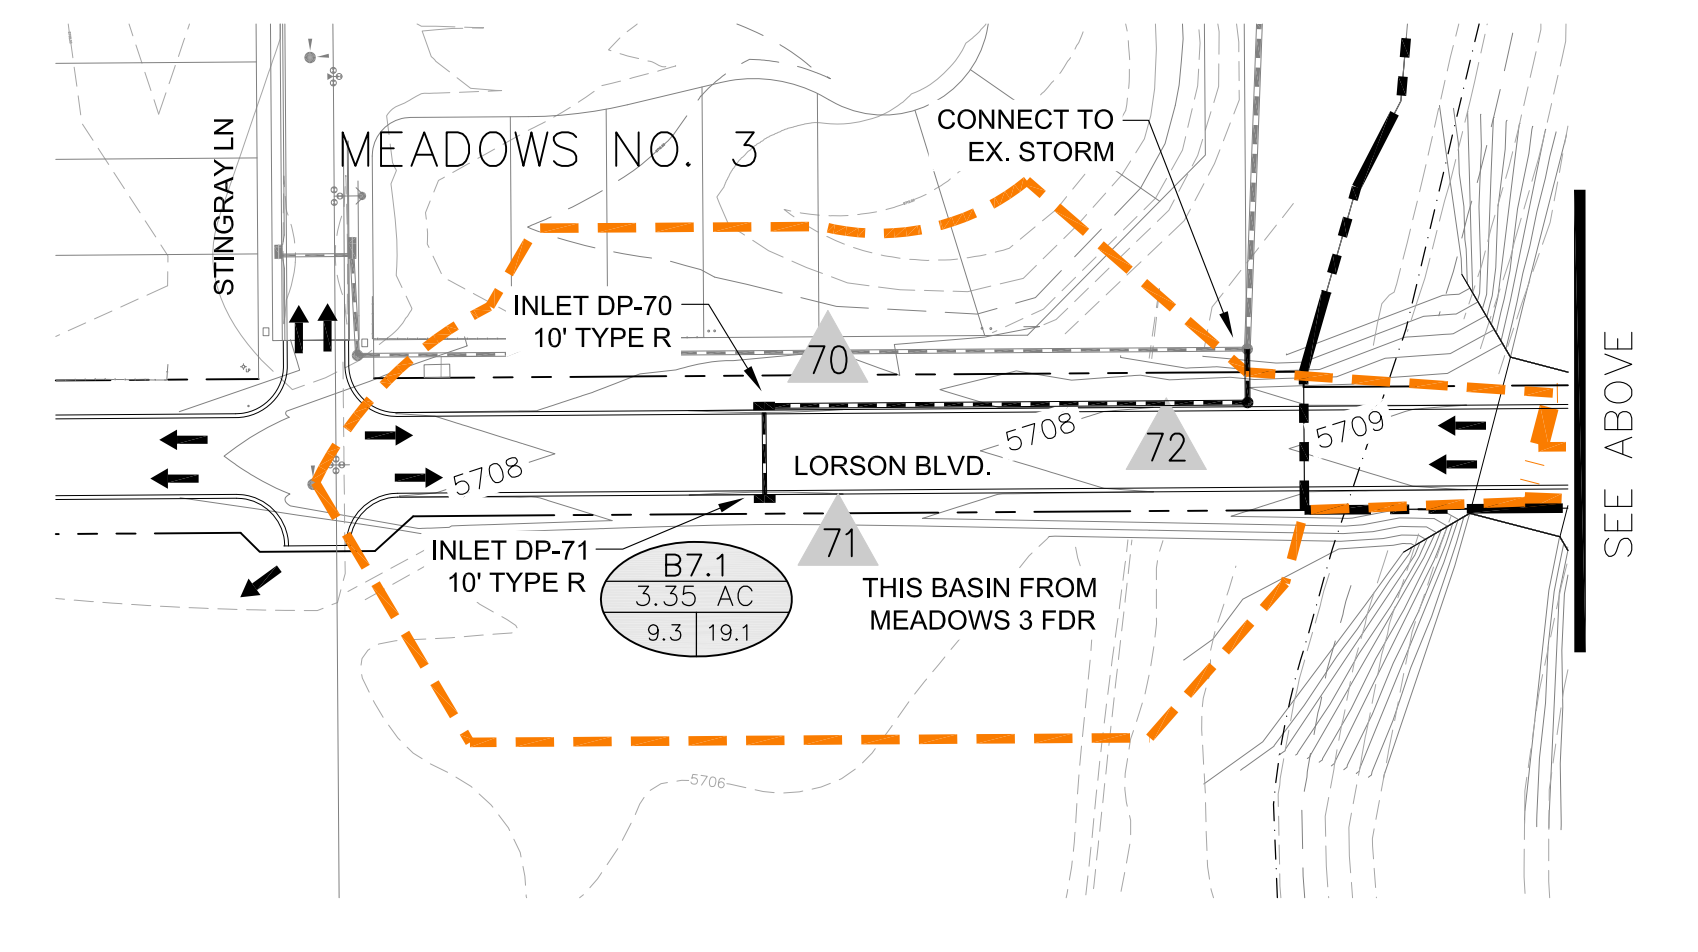

RUNOFF SUMMARY			
DESIGN POINT	5 YEAR	100 YEAR	NOTES
50	10.01	22.27	STREET FLOW
51	14.68	21.6	FLOW IN STM SWR
55a	10.18	22.63	STREET FLOW
55	7.8	40.0	STREET FLOW
56	7.2	29.7	STREET FLOW
57	63.6	122.0	STM SWR INTO POND D2
58	118.2	277.1	TOTAL FLOW INTO POND D2
58a	12.5	132.0	FLOW FROM POND D2
59a	2.2	4.8	STREET FLOW
59b	23	60	STM SWR FROM FUTURE D1
59c	25.7	75.4	FLOW IN STM SWR
59d	10.7	23.7	STREET FLOW
59e	36.4	93.2	FLOW IN STM SWR
59f	13.68	30.47	STREET FLOW
59g	45.0	104.2	FLOW IN STM SWR
60	15.8	55.9	STREET FLOW
61	10.57	23.68	STREET FLOW
62	10.1	30.3	STREET FLOW
63	17.67	27.38	FLOW IN STM SWR
64	3.2	29.2	STREET FLOW
65	36.60	88.30	FLOW IN STM SWR
65a	2.0	3.6	STREET FLOW
65b	4.2	12.7	STREET FLOW
65c	88.3	174.2	STM SWR INTO POND D2
70	5	10	STREET FLOW
71	5	10	STREET FLOW
72	10	20	FLOW IN STM SWR

Show and label per CD's; address riser capacity, overflow path...

CORE ENGINEERING GROUP
 15004 1ST AVE. S.
 BURNSVILLE, MN 55306
 PH: 719.570.1100
 CONTACT: RICHARD L. SCHINDLER, P.E.
 EMAIL: Rich@cegroup.com

DATE

DESCRIPTION

NO.

DATE

DESCRIPTION

NO.

PREPARED FOR:
LORSON, LLC
 212 N. WASHBACH AVE. SUITE 301
 COLORADO SPRING, COLORADO 80903
 CONTACT: JEFF MARK

PROJECT:
LORSON RANCH EAST
 FONTAINE BLVD. EAST PRIBRARY OF JCC
 EL PASO COUNTY, COLORADO

DRAWN: RLS
 DESIGNED: LAB
 CHECKED: LAB

DEVELOPED CONDITIONS
 DRAINAGE PLAN
LORSON RANCH EAST FILING NO. 1







DATE
MARCH 1, 2018

PROJECT NO.
100.042

SHEET NUMBER
2


TOTAL SHEETS: **2**



NOTE:
AFTER CONCRETE STRUCTURE HAS BEEN POURED
ALL GRATE DIMENSIONS SHALL BE FIELD VERIFIED
PRIOR TO GRATE CONSTRUCTION

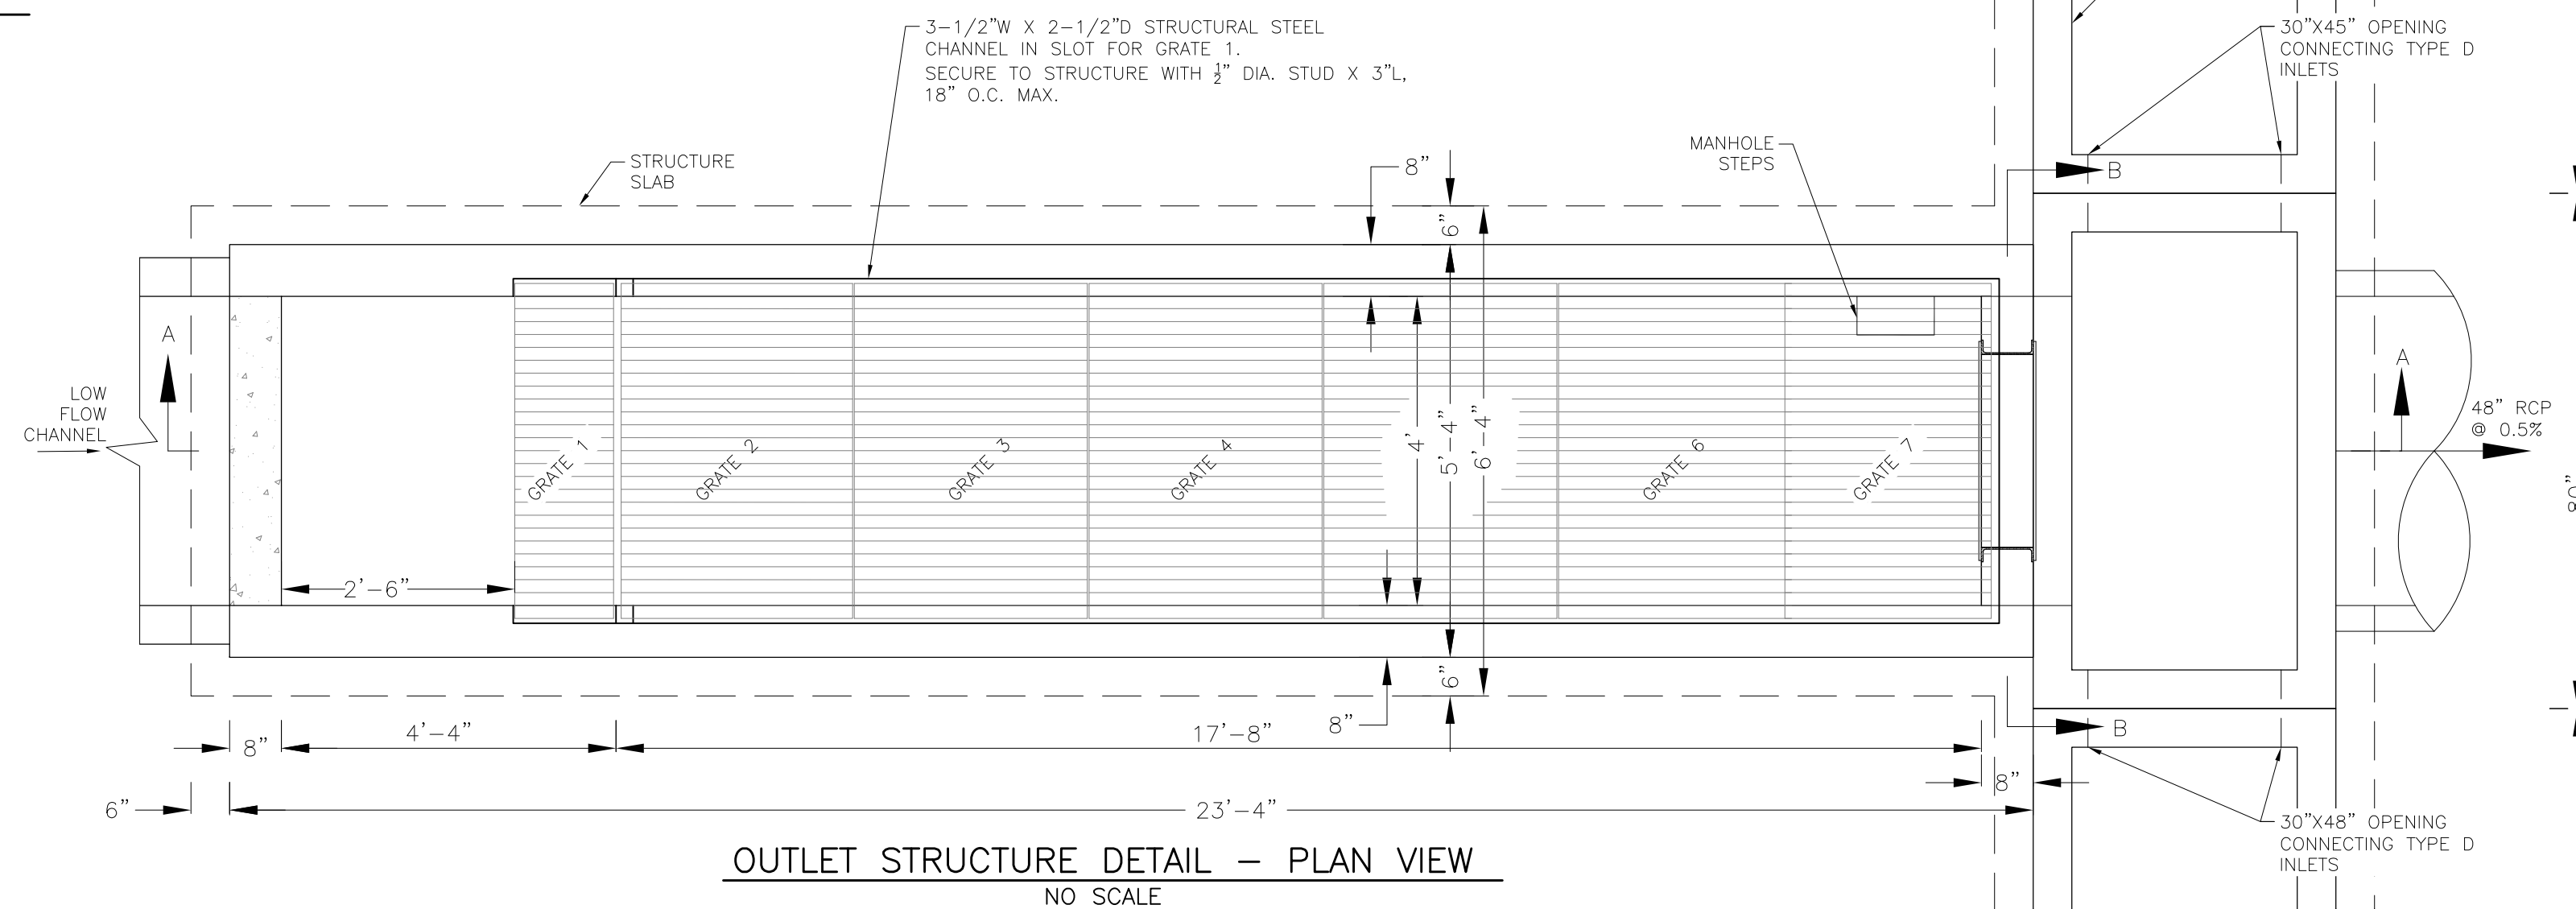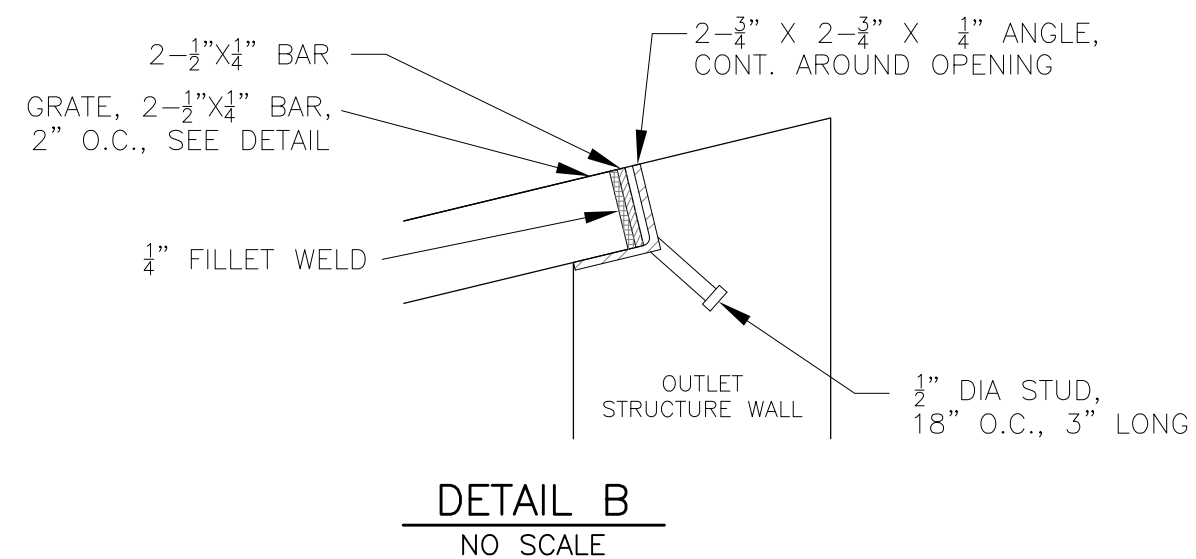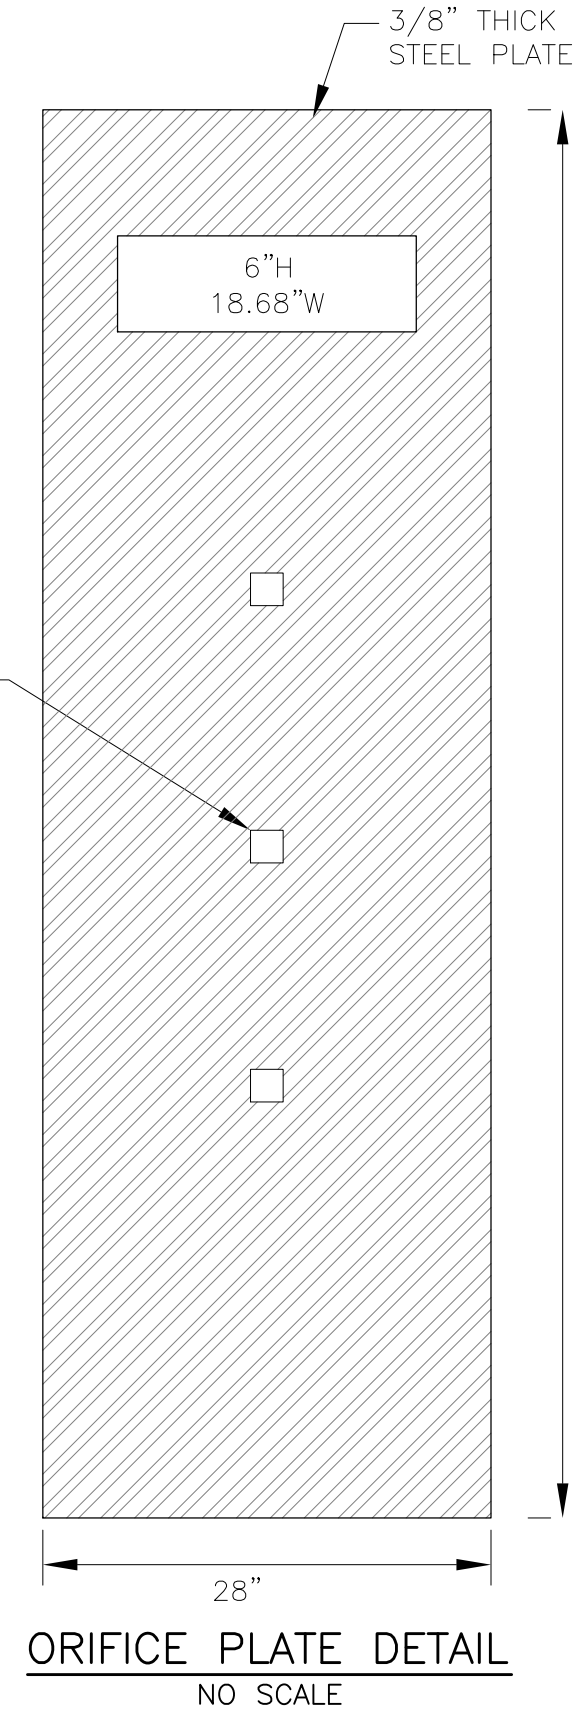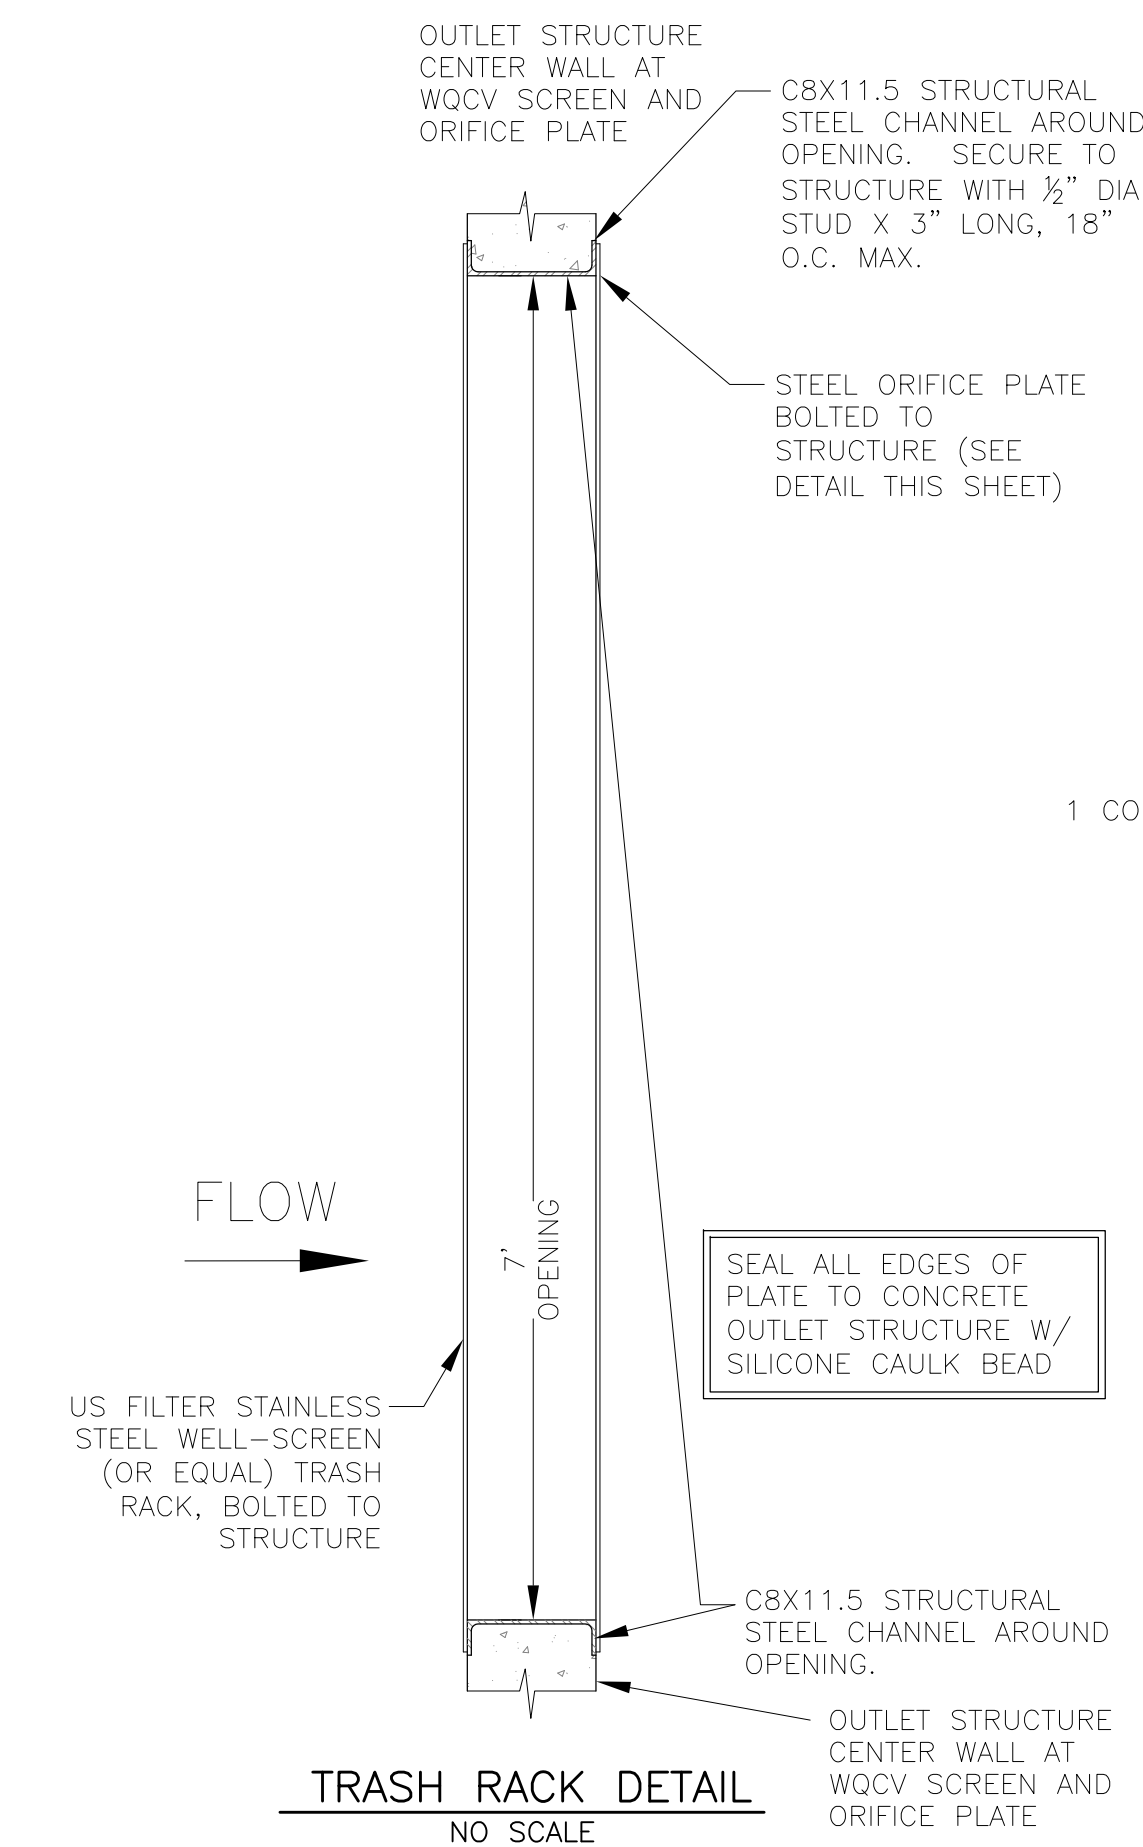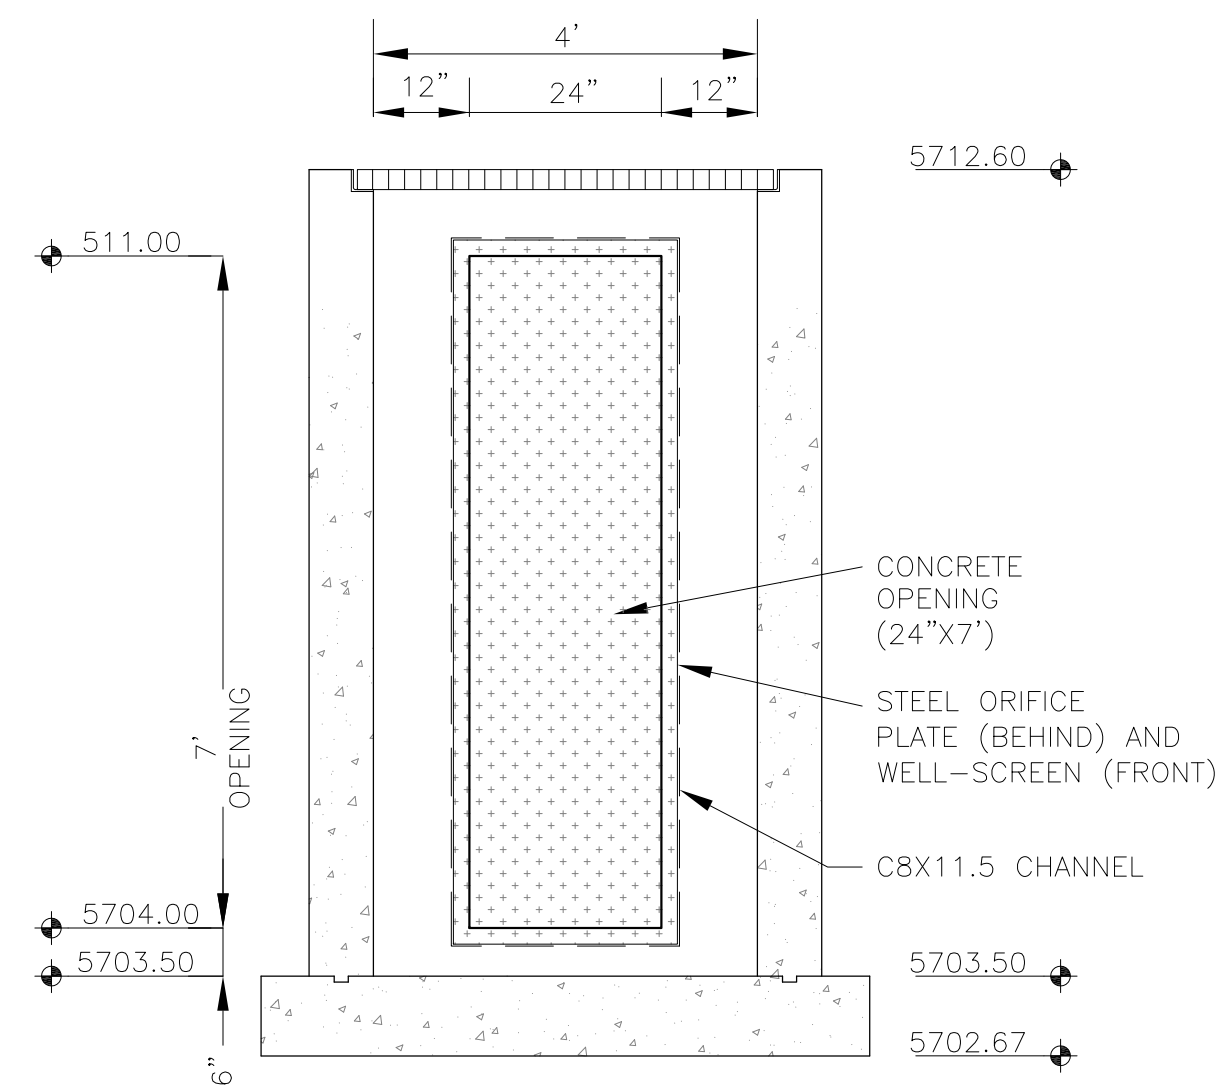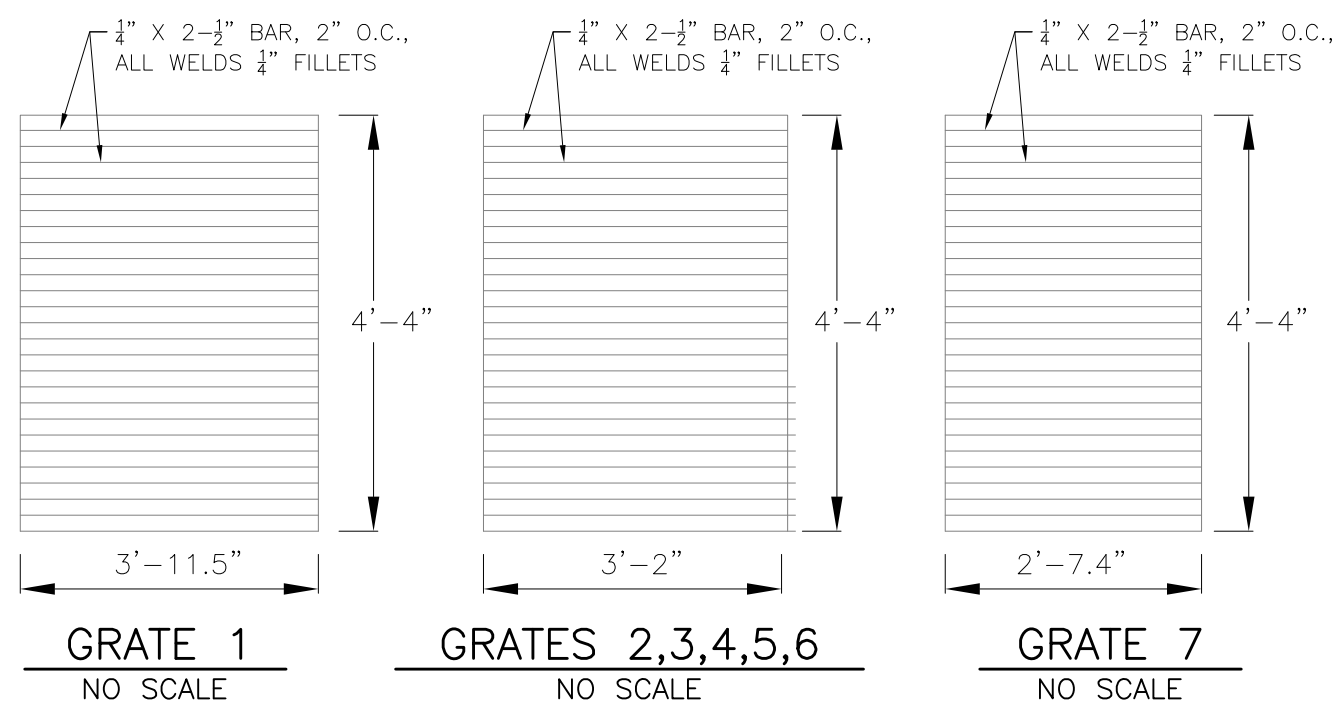






OUTLET STRUCTURE, FOREBAY, AND DRAIN CHANNEL NOTES:

- PRIOR TO CONSTRUCTION, CONTRACTOR SHALL PROVIDE SHOP DRAWINGS FOR ALL COMPONENTS OF THE OUTLET STRUCTURE.
 - GRADE 60 REINFORCING STEEL REQUIRED. SEE TABLE FOR THE MINIMUM LAP SPLICE LENGTH FOR REINFORCING BARS. ALL REINFORCING STEEL SHALL HAVE A TWO-INCH MINIMUM CLEARANCE FROM EDGE OF CONCRETE, UNLESS OTHERWISE NOTED.
- | BAR SIZE | #4 | #5 | #6 |
|--------------------|-------|-------|-------|
| MIN. SPLICE LENGTH | 1'-3" | 1'-7" | 2'-0" |
- CONCRETE FOR THE OUTLET STRUCTURE AND FOREBAY SHALL BE CDOT CLASS D CONCRETE.
 - CONCRETE FOR DRAIN CHANNELS SHALL BE CDOT CLASS B CONCRETE
 - EXPANSION JOINT MATERIAL SHALL MEET AASHTO SPECIFICATION M-213. EXPANSION JOINT MATERIAL SHALL BE 3/4" THICK, SHALL EXTEND THE FULL DEPTH OF CONTACT SURFACE AND THE JOINT SHALL BE SEALED, REFER TO DETAILS.
 - ALL EXPOSED CONCRETE CORNERS SHALL HAVE A 3/8" CHAMFER UNLESS OTHERWISE NOTED.
 - SUBGRADE TO BE 12" THICK CLEAN FILL COMPACTED TO 95% STANDARD PROCTOR DENSITY PER ASTM M698 UNDER STRUCTURE.
 - REFER TO SHEET XX FOR PRESEDIMENTATION/FOREBAY DESIGN.
 - ENGINEER SHALL BE NOTIFIED PRIOR TO BEGINNING CONSTRUCTION OF OUTLET STRUCTURE TO SCHEDULE OBSERVATION VISITS FOR STRUCTURES.

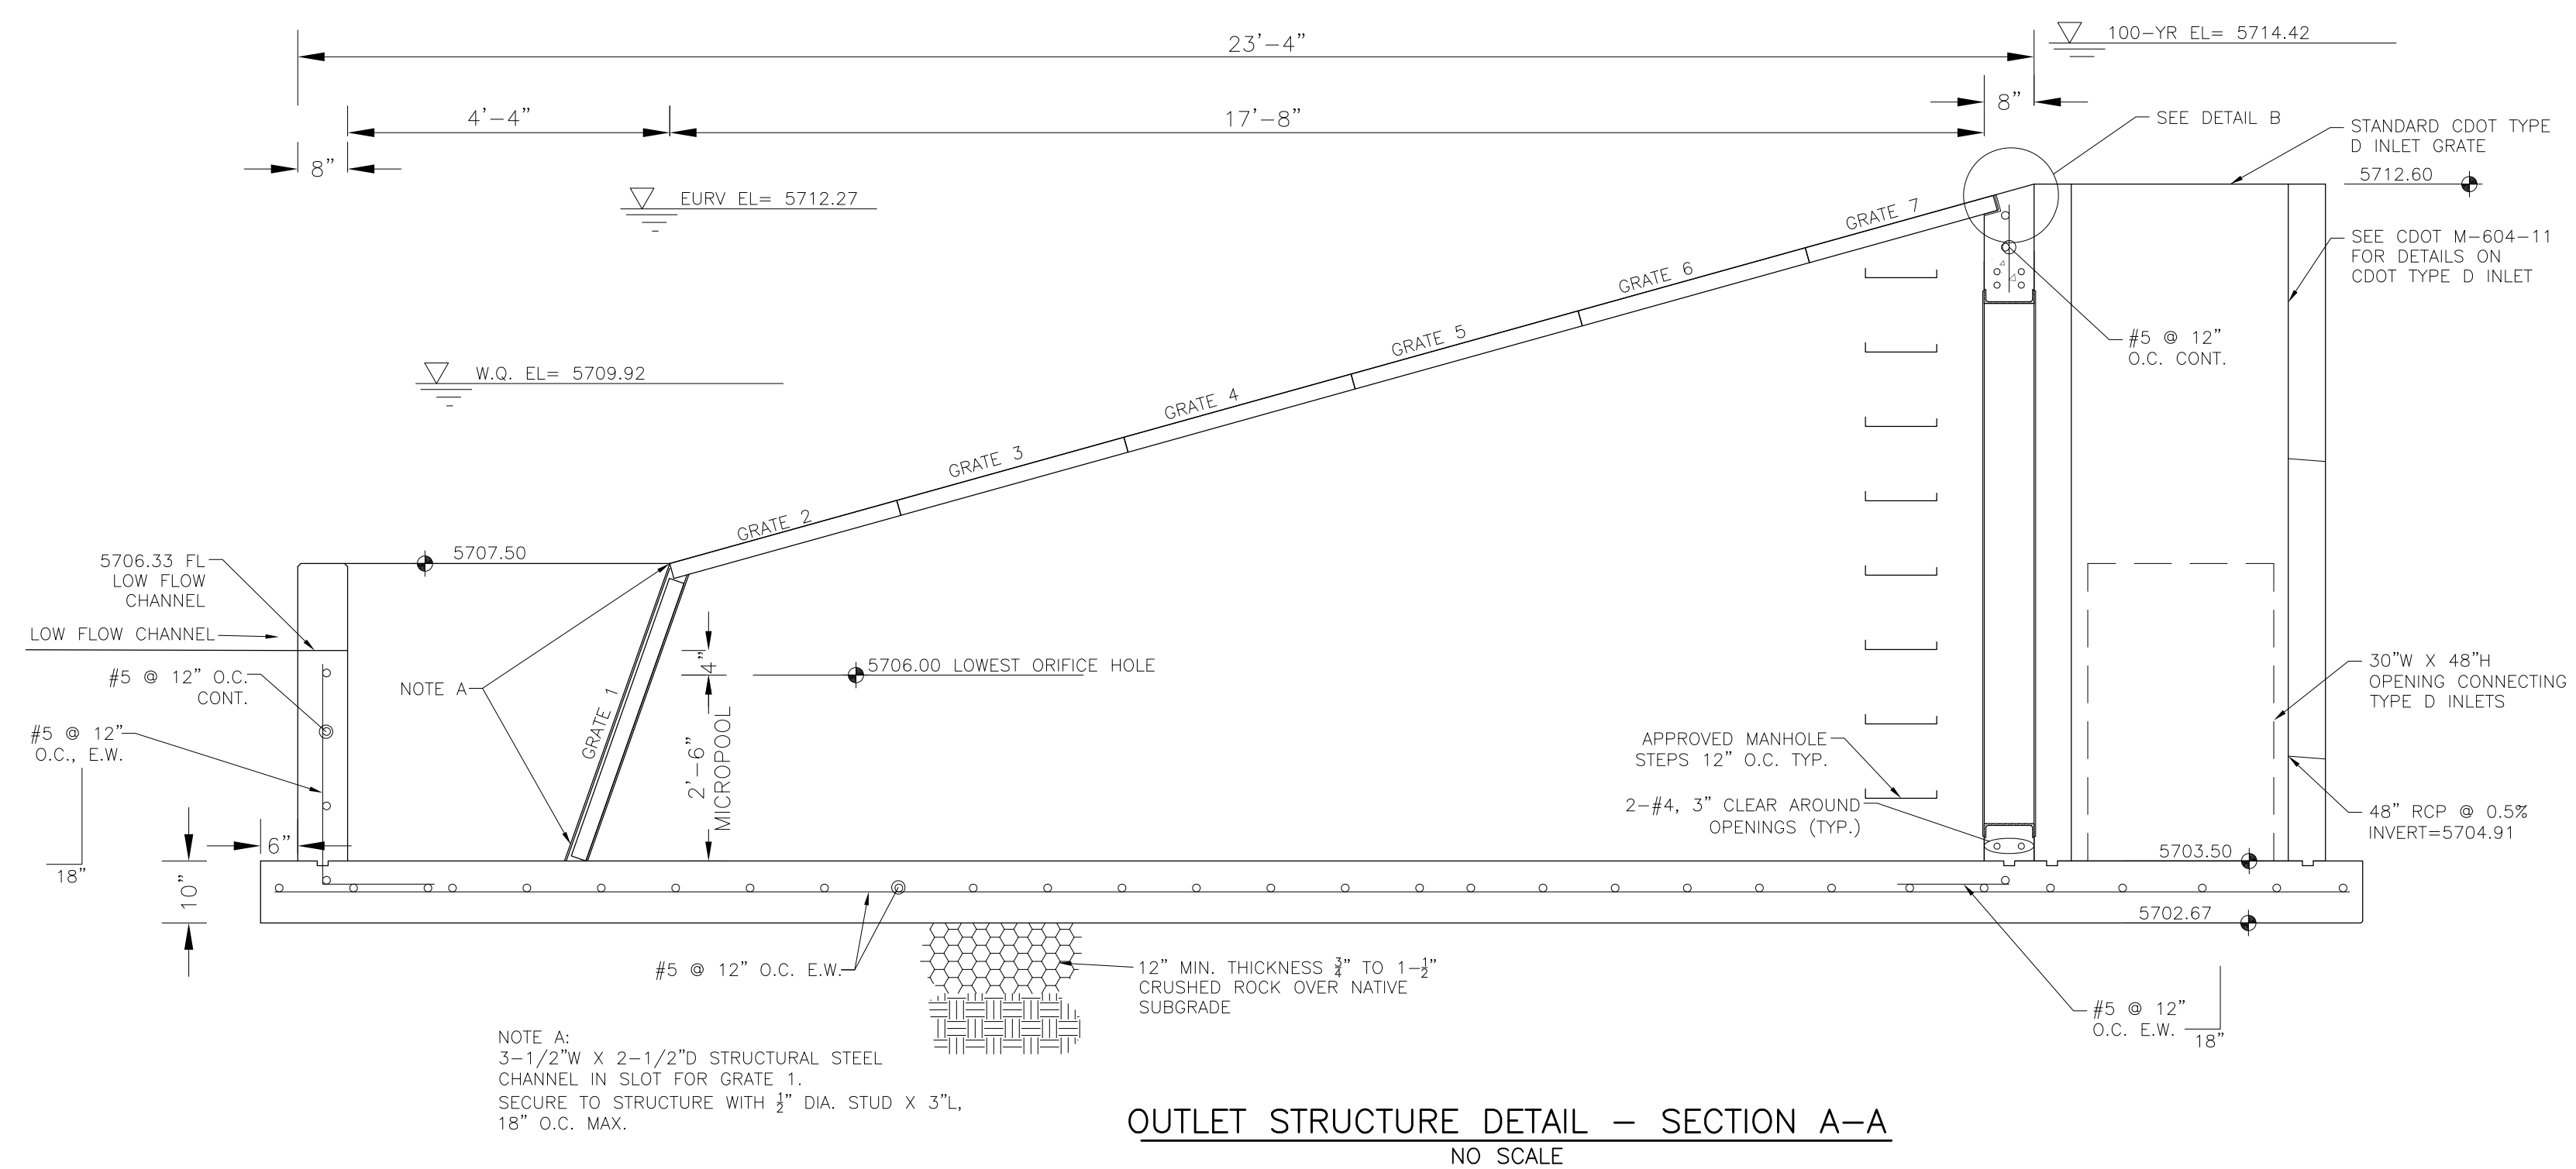

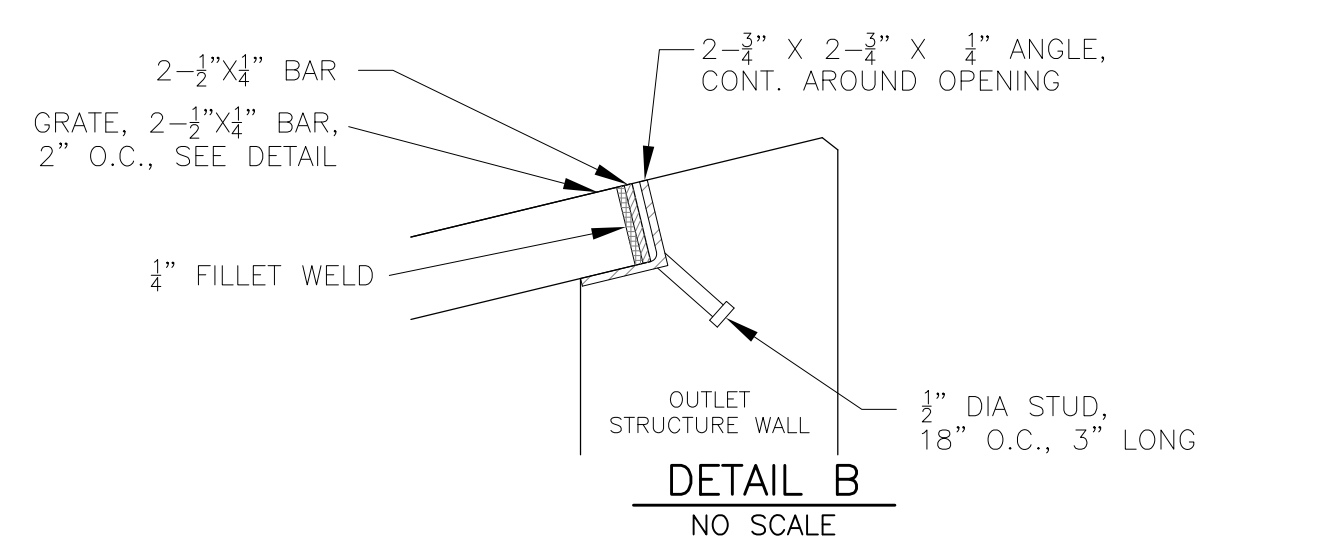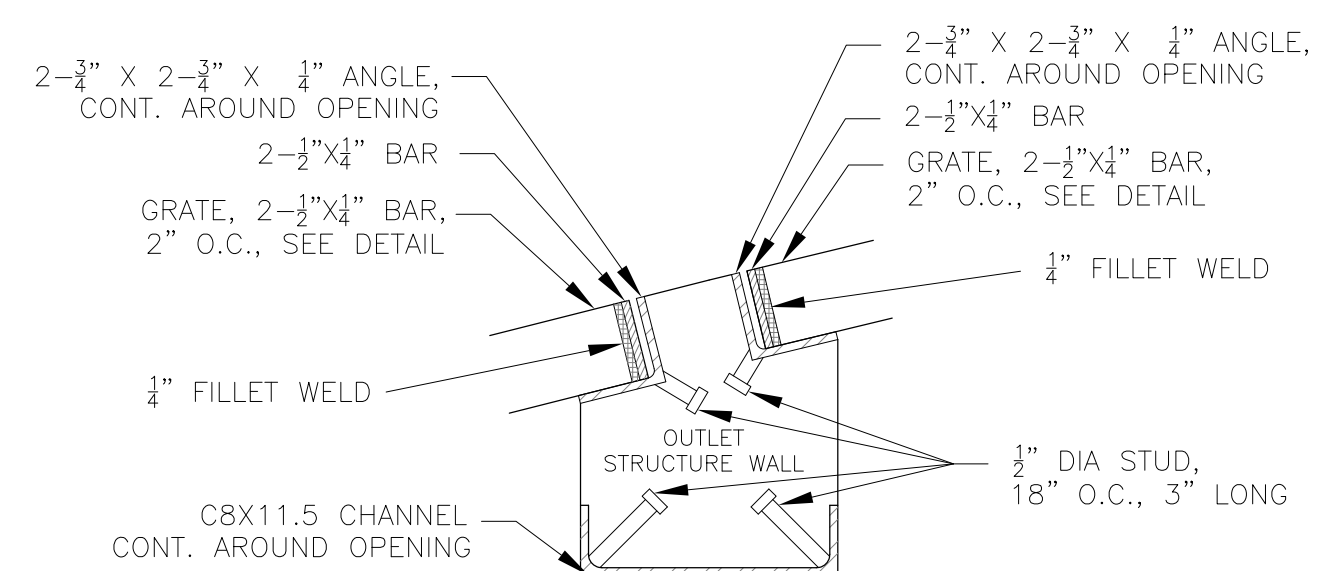


NOTE:
AFTER CONCRETE STRUCTURE HAS BEEN POURED
ALL GRATE DIMENSIONS SHALL BE FIELD VERIFIED
PRIOR TO GRATE CONSTRUCTION

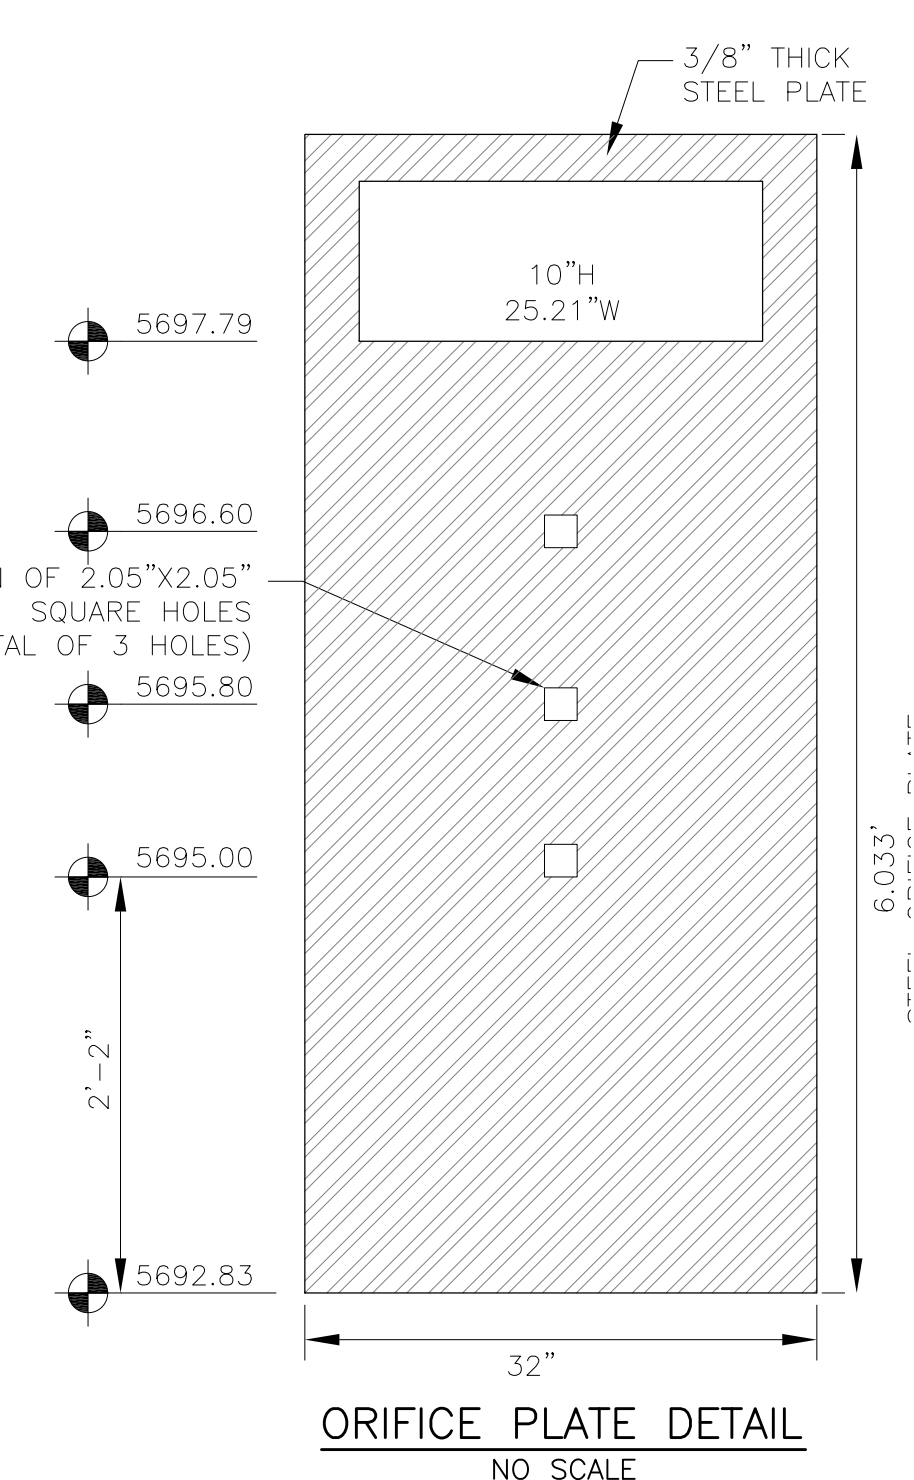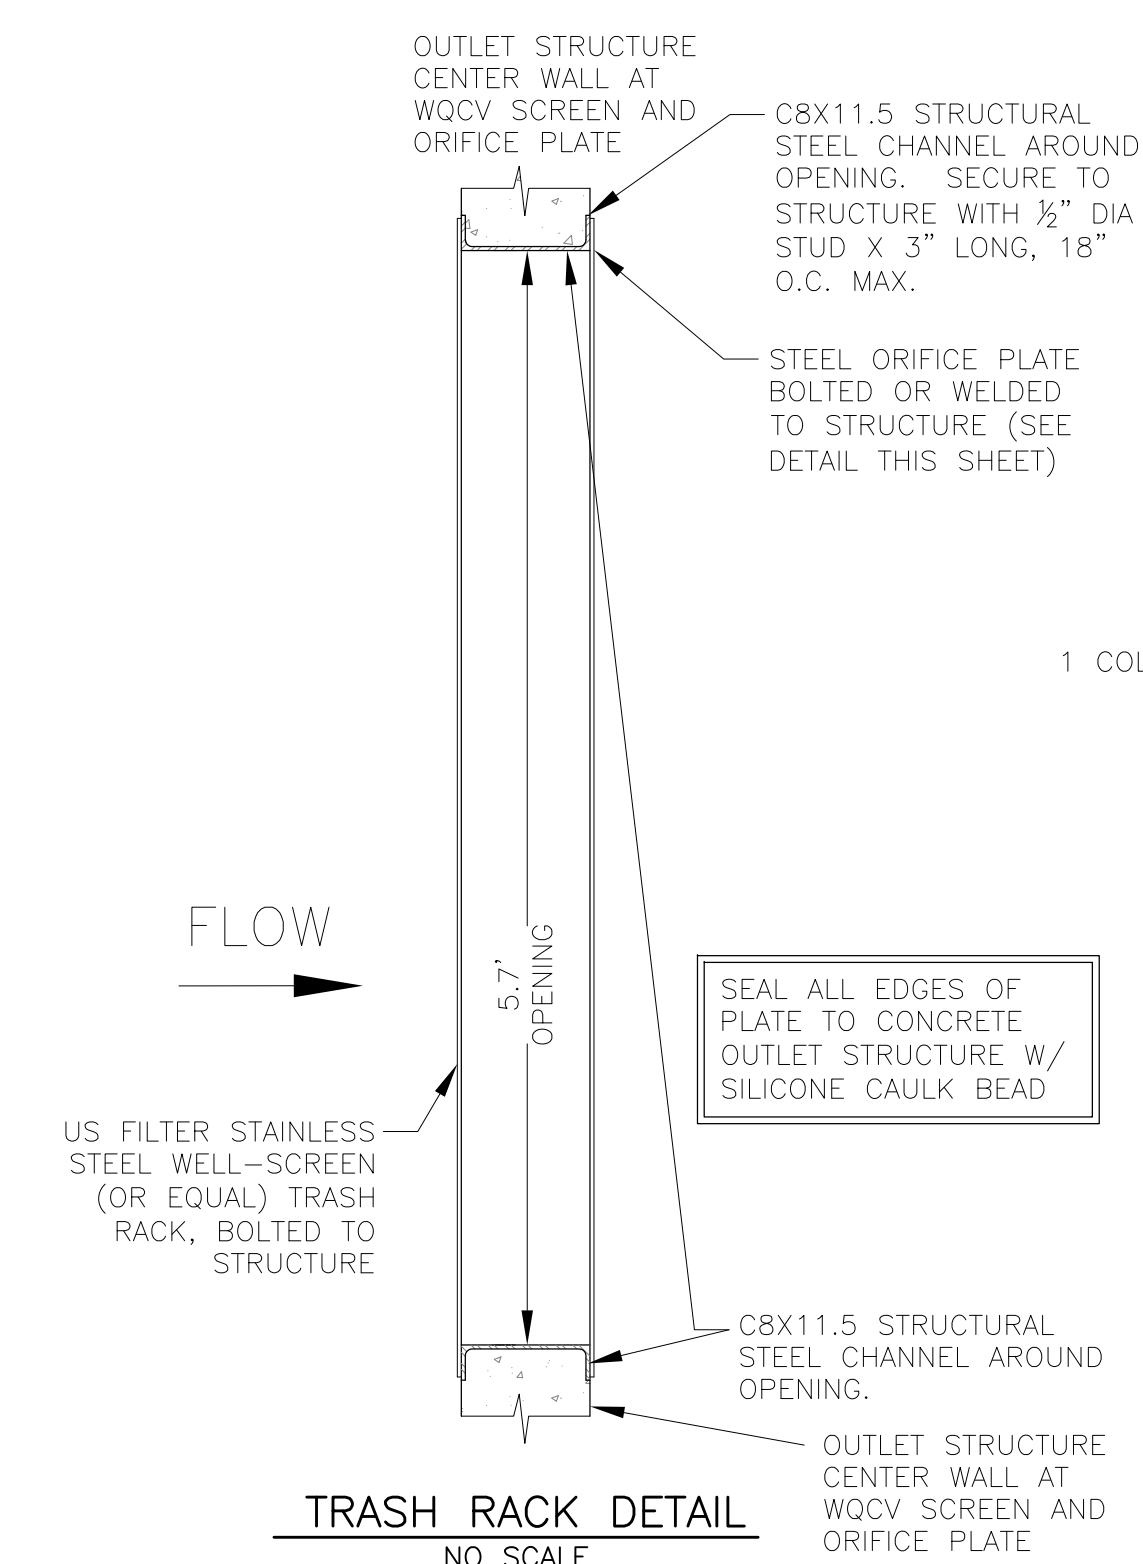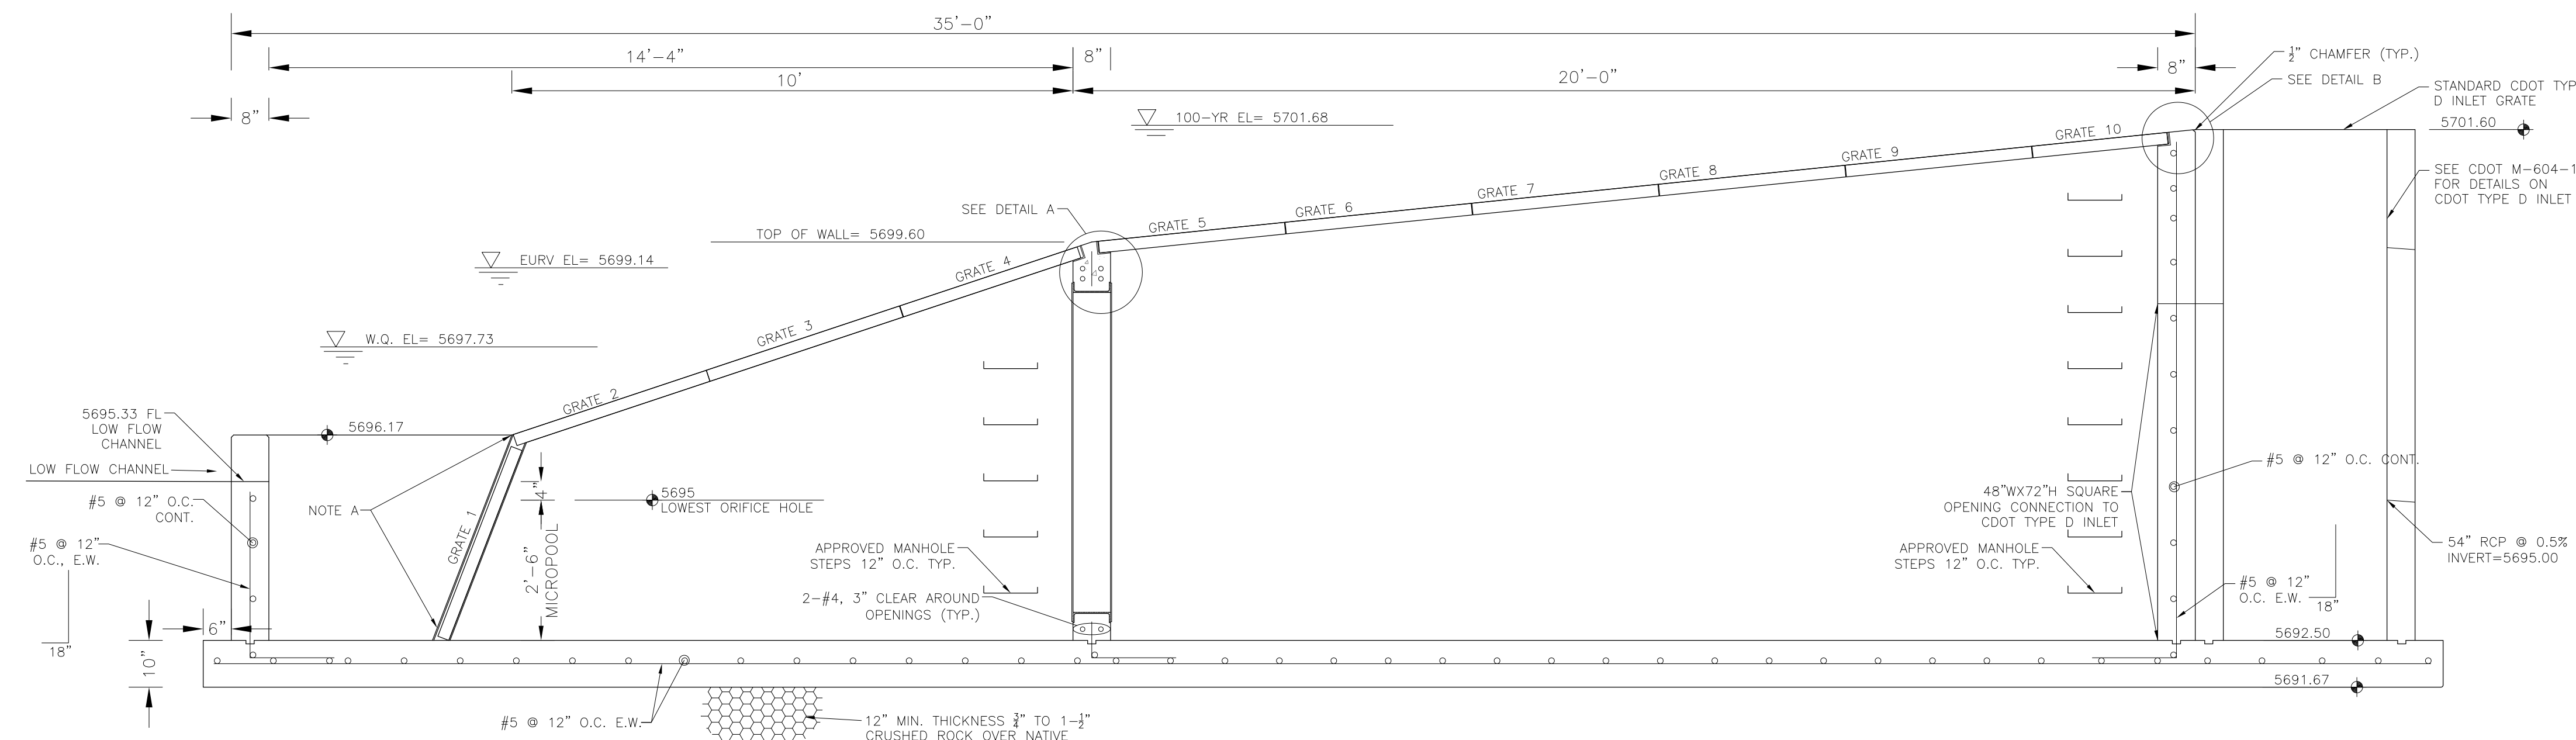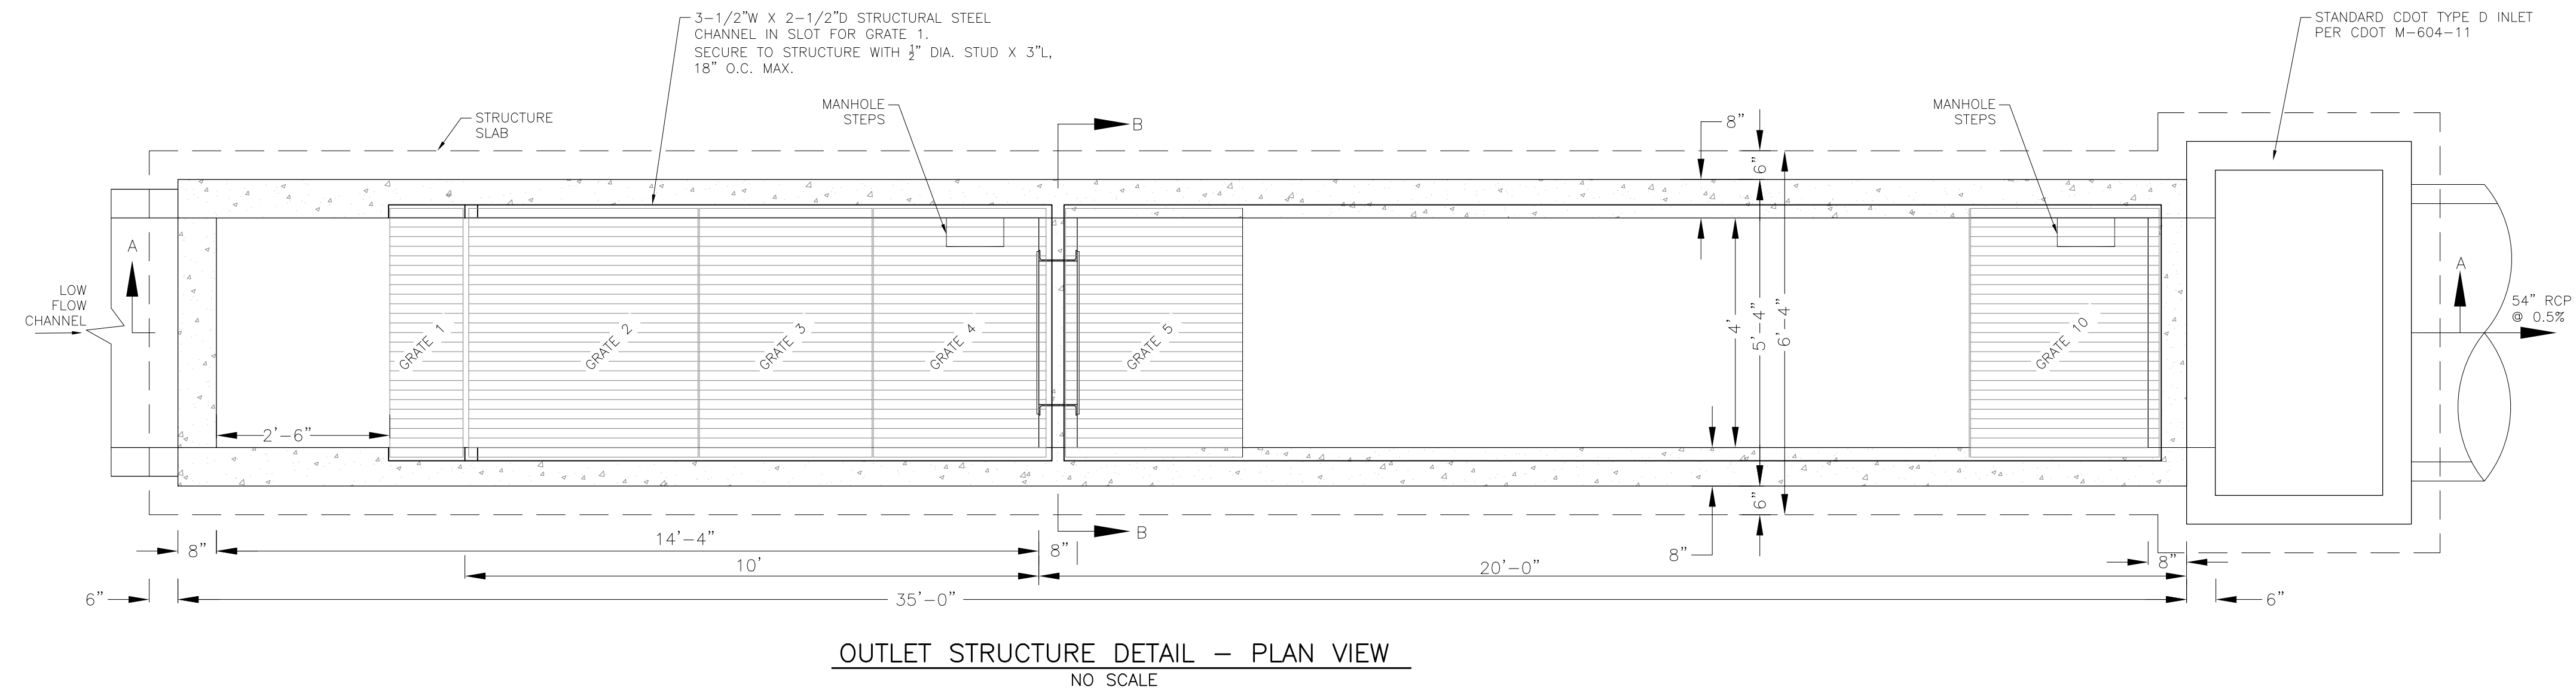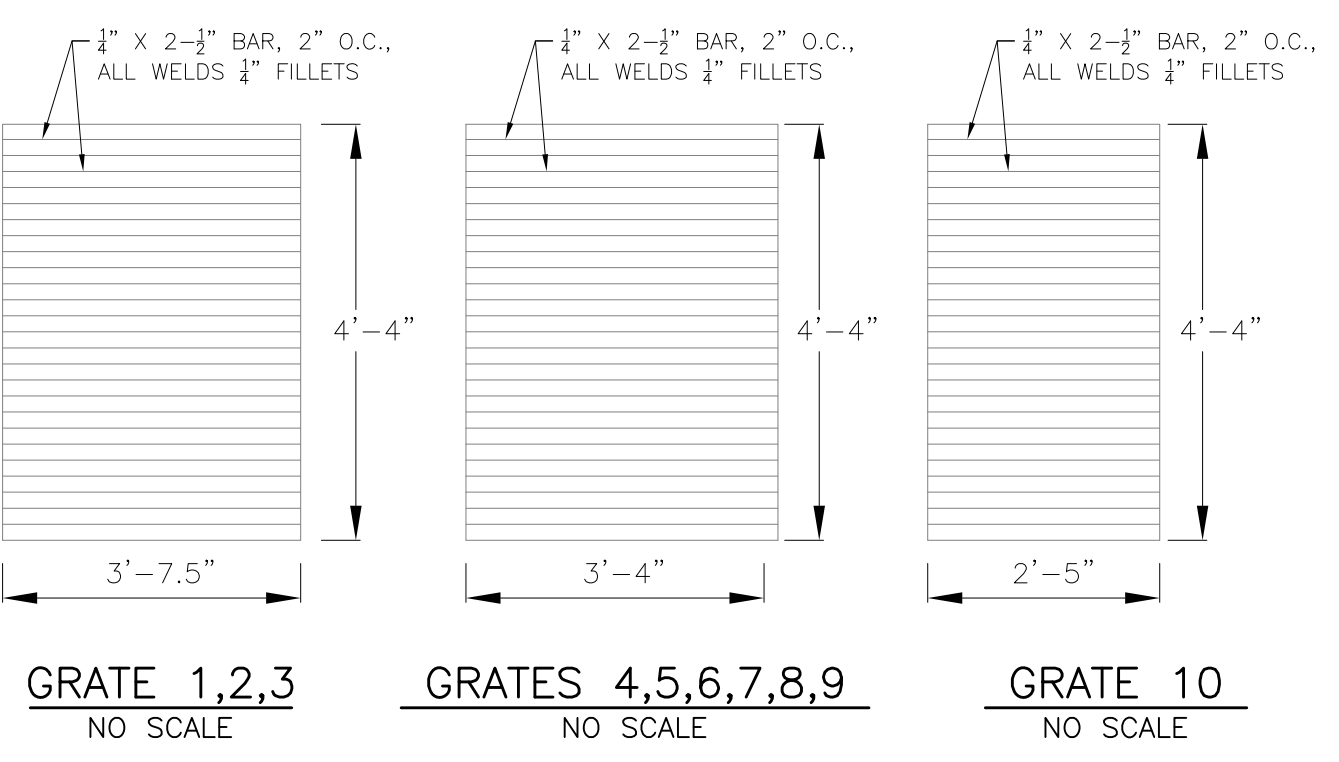


OUTLET STRUCTURE, FOREBAY, AND DRAIN CHANNEL NOTES:

- PRIOR TO CONSTRUCTION, CONTRACTOR SHALL PROVIDE SHOP DRAWINGS FOR ALL COMPONENTS OF THE OUTLET STRUCTURE.
 - GRADE 60 REINFORCING STEEL REQUIRED. SEE TABLE FOR THE MINIMUM LAP SPLICE LENGTH FOR REINFORCING BARS. ALL REINFORCING STEEL SHALL HAVE A TWO-INCH MINIMUM CLEARANCE FROM EDGE OF CONCRETE, UNLESS OTHERWISE NOTED.
- | BAR SIZE | #4 | #5 | #6 |
|--------------------|-------|-------|-------|
| MIN. SPLICE LENGTH | 1'-3" | 1'-7" | 2'-0" |
- CONCRETE FOR THE OUTLET STRUCTURE AND FOREBAY SHALL BE CDOT CLASS D CONCRETE.
 - CONCRETE FOR DRAIN CHANNELS SHALL BE CDOT CLASS B CONCRETE
 - EXPANSION JOINT MATERIAL SHALL MEET AASHTO SPECIFICATION M-213. EXPANSION JOINT MATERIAL SHALL BE 1/2" THICK, SHALL EXTEND THE FULL DEPTH OF CONTACT SURFACE AND THE JOINT SHALL BE SEALED, REFER TO DETAILS.
 - ALL EXPOSED CONCRETE CORNERS SHALL HAVE A 3/8" CHAMFER UNLESS OTHERWISE NOTED.
 - SUBGRADE TO BE 12" THICK CLEAN FILL COMPACTED TO 95% STANDARD PROCTOR DENSITY PER ASTM M698 UNDER STRUCTURE.
 - REFER TO SHEET XX FOR PRESEDIMENTATION/FOREBAY DESIGN.
 - ENGINEER SHALL BE NOTIFIED PRIOR TO BEGINNING CONSTRUCTION OF OUTLET STRUCTURE TO SCHEDULE OBSERVATION VISITS FOR STRUCTURES.

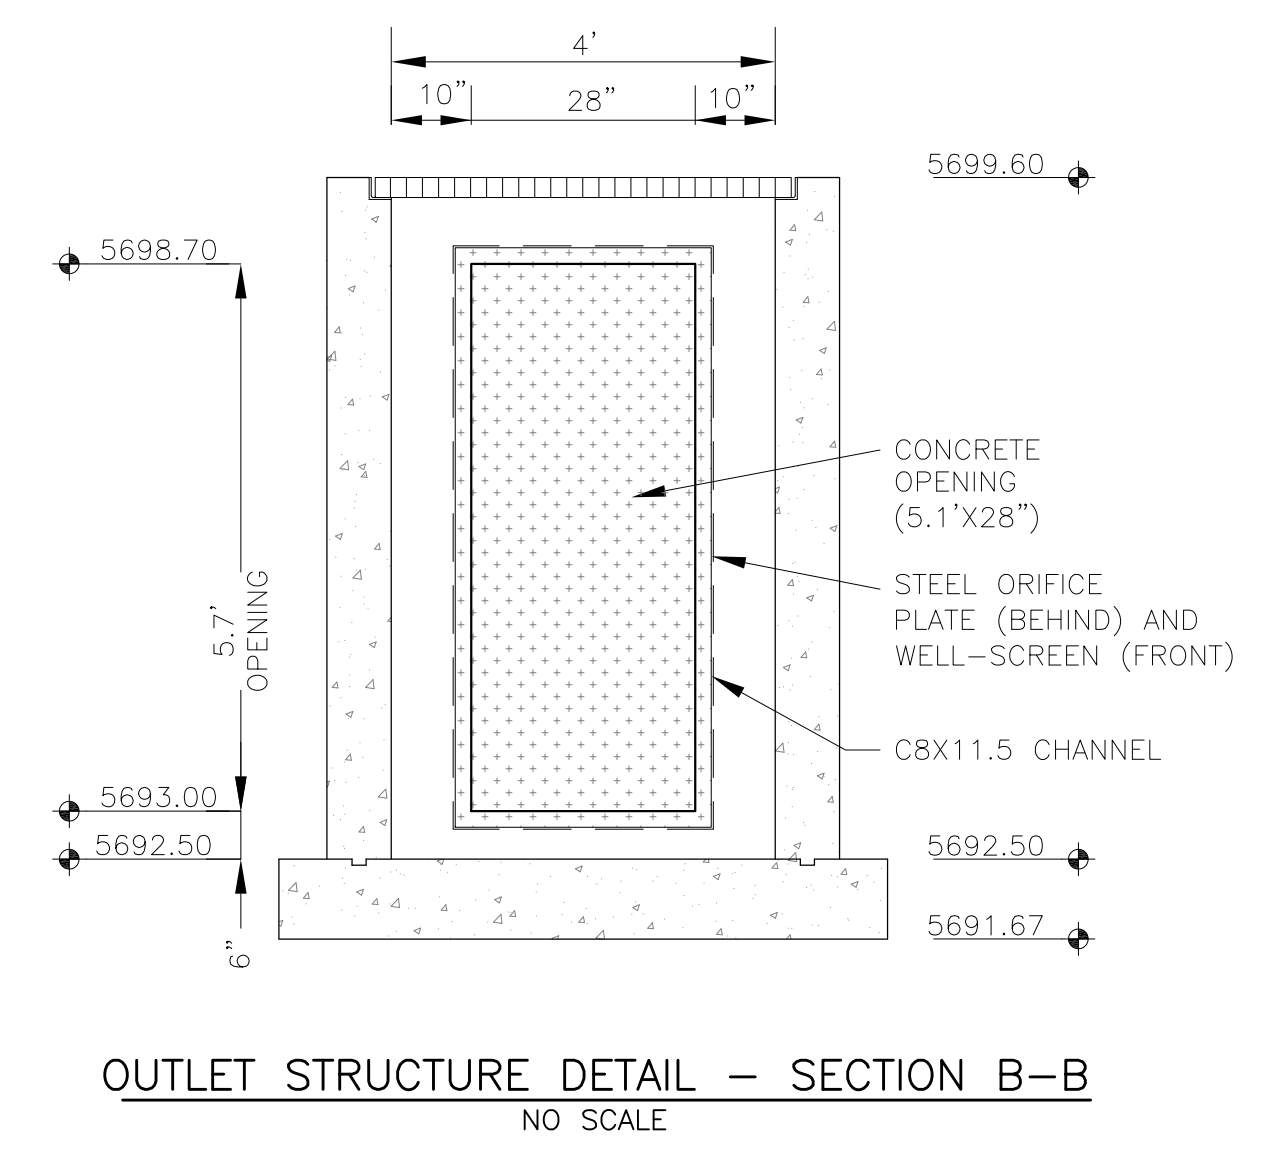


Markup Summary

RSchindler (10)




Subject: Callout
Page Label: 29
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: RSchindler
Date: 2/13/2018 10:24:25 AM
Color: ■

FDR SITE




Subject: Rectangle
Page Label: 29
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: RSchindler
Date: 2/13/2018 10:24:14 AM
Color: ■




Subject: Callout
Page Label: 32
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: RSchindler
Date: 6/28/2017 8:49:26 AM
Color: ■

SITE
BOUNDARY




Subject: Polygonal Line
Page Label: 32
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: RSchindler
Date: 2/13/2018 1:15:08 PM
Color: ■




Subject: Text Box
Page Label: 32
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: RSchindler
Date: 6/28/2017 8:48:07 AM
Color: ■

SITE




Subject: Callout
Page Label: 33
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: RSchindler
Date: 2/13/2018 1:16:57 PM
Color: ■

SITE
BOUNDARY



Subject: Polygonal Line
 Page Label: 33
 Lock: Unlocked
 Status:
 Checkmark: Unchecked
 Author: RSchindler
 Date: 2/13/2018 1:16:50 PM
 Color: ■




Subject: Text Box
 Page Label: 33
 Lock: Unlocked
 Status:
 Checkmark: Unchecked
 Author: RSchindler
 Date: 6/28/2017 8:52:33 AM
 Color: ■

SITE



Subject: Text Box
 Page Label: 85
 Lock: Unlocked
 Status:
 Checkmark: Unchecked
 Author: RSchindler
 Date: 2/13/2018 7:39:58 AM
 Color: ■

MATTA DR



Subject: Text Box
 Page Label: 85
 Lock: Unlocked
 Status:
 Checkmark: Unchecked
 Author: RSchindler
 Date: 2/13/2018 7:40:54 AM
 Color: ■

LAMINE

DR

dsdrice (59)




Subject: Cloud+
 Page Label: 1
 Lock: Unlocked
 Status:
 Checkmark: Unchecked
 Author: dsdrice
 Date: 4/11/2018 9:46:58 AM
 Color: ■

008

and is reter
 ie fore days
 grading Pla


Subject: Delete
 Page Label: 4
 Lock: Unlocked
 Status:
 Checkmark: Unchecked
 Author: dsdrice
 Date: 4/11/2018 10:39:49 AM
 Color: ■

Delete




Subject: Callout
Page Label: 4
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/11/2018 10:42:05 AM
Color: ■

Address improvements north of Fontaine.




Subject: Callout
Page Label: 4
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/11/2018 10:37:32 AM
Color: ■

and PDR




Subject: Cloud+
Page Label: 4
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/11/2018 10:43:42 AM
Color: ■

graded (?)




Subject: Callout
Page Label: 4
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/11/2018 10:36:57 AM
Color: ■

south of Fontaine Blvd.



Subject: Highlight
Page Label: 4
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/11/2018 10:49:56 AM
Color: ■

Delete



Subject: Cloud+
Page Label: 4
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/11/2018 10:39:08 AM
Color: ■

final plat

sewer main outlet points provided on Lamprey Drive and Chaplin Drive. The proposed sewer system for Chapter Drive and Chaplin Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing.

Subject: Callout
Page Label: 7
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:27:11 PM
Color: ■

Address sub-basin D1-ex

need to verify flow rates to include sewer flow rates provided on Chapter Drive and Chaplin Drive. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing.

Subject: Cloud+
Page Label: 7
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:04:46 PM
Color: ■

Include

need to verify flow rates to include sewer flow rates provided on Chapter Drive and Chaplin Drive. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing.

Subject: Cloud+
Page Label: 7
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 4:19:28 PM
Color: ■

include in this report also

need to verify flow rates to include sewer flow rates provided on Chapter Drive and Chaplin Drive. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing. The sewer system for Chapter Drive is shown in the attached drawing.

Subject: Cloud+
Page Label: 7
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:05:17 PM
Color: ■

Include

rive, Weiser Drive, and Lamprey C
50 to a proposed Type "R" inlet in
ns. [provide flows](#)

Subject: Text Box
Page Label: 8
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:15:31 PM
Color: ■

provide flows

off is directed south in curb/gutter to
calculations. [provide flows](#)


Subject: Text Box
Page Label: 8
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:14:50 PM
Color: ■

provide flows

nd Chaplin Drive. Runoff is directed
Type "R" inlet in Yuba Drive. See the
on this basin is 8.4cfs and 18.7cfs for

3. Lamine Drive, and Yuba Drive.
ive. See the appendix for detailed
provide flows


ve. Runoff is directed south in
line Drive. See the appendix for
3cfs and 5.8cfs for the 5/100-year

Subject: Text Box
Page Label: 9
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:15:44 PM
Color: 


provide flows

it,



Subject: Highlight
Page Label: 9
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:16:31 PM
Color: 


1. Address interim and future conditions flows and conveyances for each of the basins below.

Subject: Text Box
Page Label: 9
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:28:27 PM
Color: 

Address interim and future conditions flows and conveyances for each of the basins below.

for the electric easement,
th and west in curb/gutter
ons. provide flows


noff is directed south in
The peak developed flow

Subject: Text Box
Page Label: 9
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:17:06 PM
Color: 


provide flows

in
fs



Subject: Highlight
Page Label: 10
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:24:13 PM
Color: 



Subject: Highlight
Page Label: 10
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:55:58 PM
Color: 

letter panel that includes water quality and discharge
signed using only the VDCP Full Spectrum approach
in the context of the VDCP Full Spectrum approach
in a letter and review the model structure designed by the
contractor. The full spectrum approach will be in the
contractor's letter.

**Provide interim and ultimate
modeling and narrative.**

will in separate (draft) document and develop
5837.02
5837.04. Top EIR/TV set at 5837.02-4/2017 under with
- 12.5th
- 2017.08.13.2018
1-16-2018/2018
www.washingtonstate.gov

Subject: Text Box
Page Label: 23
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 3:46:36 PM
Color: ■

Provide interim and ultimate modeling and narrative.

will in separate (draft) document and develop
5837.02
5837.04. Top EIR/TV set at 5837.02-4/2017 under with
- 12.5th
- 2017.08.13.2018
1-16-2018/2018
www.washingtonstate.gov

Modeling Approach	Modeling Approach	Modeling Approach	Modeling Approach	Modeling Approach
1	2	3	4	5
6	7	8	9	10
11	12	13	14	15
16	17	18	19	20
21	22	23	24	25
26	27	28	29	30
31	32	33	34	35
36	37	38	39	40
41	42	43	44	45
46	47	48	49	50
51	52	53	54	55
56	57	58	59	60
61	62	63	64	65
66	67	68	69	70
71	72	73	74	75
76	77	78	79	80
81	82	83	84	85
86	87	88	89	90
91	92	93	94	95
96	97	98	99	100

Subject: Cloud+
Page Label: 24
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 12:45:52 PM
Color: ■

re-calculate

is this buffer to be constructed and
maintained in accordance with
VDCP

will in separate (draft) document and develop
5837.02
5837.04. Top EIR/TV set at 5837.02-4/2017 under with
- 12.5th
- 2017.08.13.2018
1-16-2018/2018
www.washingtonstate.gov

Subject: Callout
Page Label: 24
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 2:56:58 PM
Color: ■

Is this buffer to be constructed and maintained in accordance with DCM2?

is this buffer to be constructed and
maintained in accordance with
VDCP

will in separate (draft) document and develop
5837.02
5837.04. Top EIR/TV set at 5837.02-4/2017 under with
- 12.5th
- 2017.08.13.2018
1-16-2018/2018
www.washingtonstate.gov

Subject: Text Box
Page Label: 26
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 2:58:04 PM
Color: ■

Address maintenance access to EFJCC.

is this buffer to be constructed and
maintained in accordance with
VDCP

Modeling Approach	Modeling Approach	Modeling Approach	Modeling Approach	Modeling Approach
1	2	3	4	5
6	7	8	9	10
11	12	13	14	15
16	17	18	19	20
21	22	23	24	25
26	27	28	29	30
31	32	33	34	35
36	37	38	39	40
41	42	43	44	45
46	47	48	49	50
51	52	53	54	55
56	57	58	59	60
61	62	63	64	65
66	67	68	69	70
71	72	73	74	75
76	77	78	79	80
81	82	83	84	85
86	87	88	89	90
91	92	93	94	95
96	97	98	99	100

Subject: Text Box
Page Label: 43
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 3:02:10 PM
Color: ■

Provide interim off-site basin calculations.



Subject: Highlight
Page Label: 73
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 3:35:15 PM
Color: ■




Subject: Cloud+
Page Label: 73
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 3:21:31 PM
Color: ■

why not?



Subject: Text Box
Page Label: 84
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 4:05:49 PM
Color: ■

Provide for all storm systems serving Filing No. 1, including interim conditions accommodating offsite flows.



Subject: Cloud+
Page Label: 88
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 4:03:41 PM
Color: ■

Address interim condition




Subject: Cloud+
Page Label: 97
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 11:47:04 AM
Color: ■

Include in this report as if that report doesn't exist. (See comment 1.a on that project.)




Subject: Cloud+
Page Label: 97
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 3:59:03 PM
Color: ■

Where is boundary (aren't basins EX1 through EX3 included)?



Subject: Callout
Page Label: 97
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 11:30:38 AM
Color: ■

Show storm sewer



Subject: Callout
Page Label: 97
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 3:59:54 PM
Color: ■

Label bridges and provide channel design points and flows.




Subject: Text Box
Page Label: 97
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 4:00:48 PM
Color: ■

Add storm drain linetypes.




Subject: Area Measurement
Page Label: 97
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 3:55:58 PM
Color: ■

3,846,826 sf




Subject: Text Box
Page Label: 98
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 4:37:50 PM
Color: ■

Include Fontaine sub-basins




Subject: Callout
Page Label: 98
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 11:35:27 AM
Color: ■

Provide complete plan with system to the east



Subject: Cloud+
Page Label: 98
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/13/2018 11:32:38 AM
Color: ■

Show stub, TSB(?) as part of Filing 1 construction.
Provide interim design point.



Subject: Text Box
Page Label: 99
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:29:32 PM
Color: ■

Future Development



Subject: Text Box
Page Label: 99
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:29:45 PM
Color: ■

Future Development



Subject: Cloud+
Page Label: 99
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: dsdrice
Date: 4/15/2018 1:48:02 PM
Color: ■

Show and label per CDs; address riser capacity, overflow path...

alex.dabdub (2)

January 29,
2015
. 957 OF 1300
INDEX FOR PANELS NOT PRINTED)

Subject: Text Box
Page Label: 33
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: alex.dabdub
Date: 9/16/2014 1:47:49 PM
Color: ■

January 29, 2015



Subject: LOMR Stamp
Page Label: 33
Lock: Unlocked
Status:
Checkmark: Unchecked
Author: alex.dabdub
Date: 9/16/2014 1:47:49 PM
Color: ■