

LOT 8 AKERS ACRES

EL PASO COUNTY, CO
FINAL DRAINAGE REPORT

Submittal Date: Issued for Review July 27, 2018
Revision Date: December 10, 2018
Revision Date: March 8, 2019
Revision Date: May 3, 2019

OWNER/APPLICANT

ABC SUPPLY CO
2675 Akers Dr
Colorado Springs, CO 80922-1502
Phone 719-380-9911
Fax 719-380-9907

CONSULTANT

Obering, Wurth & Associates
Consulting Civil Engineers
Professional Land Surveyors
1046 Elkton Drive
Colorado Springs, Colorado 80907
Phone 719-531-6200
Fax 719-531-6266
email: owacivil1@mindspring.com

OWA Project No. 18022
PCD File No. PPR1848

TABLE OF CONTENTS

TABLE OF CONTENTS..... 2

CERTIFICATIONS 3

FLOODPLAIN STATEMENT..... 4

INTRODUCTION 5

GENERAL PROPERTY DESCRIPTION 5

EXISTING DRAINAGE CHARACTERISTICS..... 6

PROPOSED DRAINAGE CHARACTERISTICS..... 7

EROSION CONTROL 9

DRAINAGE FEES 9

CONCLUSION..... 10

APPENDICES 12

VICINITY AND LOCATION MAPS..... 13

RATIONAL METHOD CALCULATIONS 14

INLET & STORM DRAIN CALCULATIONS..... 15

FULL SPECTRUM DETENTION CALCULATIONS 16

SOIL REPORT & MAP..... 17

FLOOD PLAIN MAP..... 18

DRAINAGE AND GRADING PLAN..... 19

CERTIFICATIONS

Design Engineer's Statement:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Name

Date

Owner/Developer's Statement:

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

By
Title
Address

Date

El Paso County:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Name:
Jennifer Irvine, P.E.
County Engineer/ECM Administrator
Conditions:

Date

Obering, Wurth & Associates
Consulting Civil Engineers
Professional Land Surveyors

1046 Elkton Drive ° Colorado Springs, Colorado ° 80907 ° Phone 719-531-6200 ° Fax 719-531-6266

Drainage Report for
Lot 8 Akers Acres

Project No. 18022

FLOODPLAIN STATEMENT

To the best of my knowledge and belief, Lot 8 Akers Acres is not located within a designated 100 year floodplain as shown on FIRM map number 08041CO756-G (effective date December 7, 2018). A copy of a portion of the FIRM map is included as an attachment to this report.

Roland G. Obering, P.E. & P.L.S Colorado 13226

INTRODUCTION

This report is not based on any previous know drainage studies. The goal of the project is to add an approximate 300' x 300' asphalt yard directly to the east of the existing building.

The purpose of the following Final Drainage Report (FDR) is to present drainage improvements for Lot 8 Akers Acres. Final design and sizing of structures is presented in this document. Drainage improvements will include conveyance by a gutter that bisects the proposed asphalt into a proposed curb opening inlet, then outfalling into a full spectrum water quality pond on the east. This report encompasses approximately 2.23 acres for the yard addition, and 0.32 acres ending up in the pond including the pond itself. The Lot 8 Akers Acres FDR is limited to the hydrology and hydraulics as it is routed through the proposed yard. Historically this runoff is routed to the Sand Creek East Fork Subtributary.

This report includes an analysis of the proposed storm system, including the gutter, an inlet and storm pipe. Also, the design for the full spectrum detention pond is presented.

The area of study is bounded by Asphalt Recovery Specialists to the north, Akers Drive to the west, vacant land and Constitution Avenue to the south and Marksheffel Road to the east.

GENERAL PROPERTY DESCRIPTION

The proposed Lot 8 Akers Acres is approximately 9.33 acres in total and is located within Section 32, Township 13 South, Range 65 West of the 6th Principal Meridian.

The proposed site is zoned in the El Paso County as "M"-Industrial (obsolete).

The topography of the surrounding area is typical of a high desert, short prairie grass with slopes generally at 1% to 3%. The area generally sheet flows to the east or south across the vacant site to the edges of the site where the slopes become steeper. From there the runoff is directed into

roadway drainage systems along Marksheffel and Constitution. At its closest point, Sand Creek East Fork Subtributary is approximately 700' from the site.

The Lot 8 Akers Acres is located in the Sand Creek Street Drainage Basin. This basin has been studied.

The development area is located in El Paso County, Colorado along the west side of Marksheffel Road, north of Constitution Avenue and east of Akers Drive. Specifically, the area of study is bounded by Asphalt Recovery Specialists to the north, Akers Drive to the west, vacant land and Constitution Avenue to the south and Marksheffel Road to the east.

The Flood Insurance Rate Map (FIRM No. 08041CO756-G ((effective date December 7, 2018)) indicates that there is not a floodplain on the proposed site. The closest floodplain shown is approximately 700' to the east of the site. This floodplain is designated as "Zone X", which identifies the area as an area of a 500-year flood, area of 100-year flooding with an average depth less than 1 foot or a drainage area less than 1 square mile, or an area protected by levees from a 100-year flood. FEMA does not require any modifications to the floodplain maps when construction is located in this zone area.

Soil Conservation Service soil survey records indicate the project area is covered by soils classified in the Blakeland loamy sand, 1 to 9 percent slopes and the Blendon sandy loam, 0 to 3 percent slopes series, which are categorized in the Hydrological Group A and B, respectively. Please see the attached Soil Report for more information.

EXISTING DRAINAGE CHARACTERISTICS

The existing site is covered with grasses, dirt-graded areas, asphalt and buildings. The area on which the proposed asphalt lot will sit is covered with dirt-graded areas and asphalt. Slopes in this vicinity range from approximately 1% to 3% and generally falls from the north to the

southeast via sheet flow. The runoff continues to travel offsite toward Marksheffel Road and Constitution Avenues, where it is intercepted each roadway's storm system.

Pre-development peak flows and volumes for the proposed pond are derived from the Urban Drainage and Flood Control District's UD Detention version 3.07. The program requires the input of watershed area, slope, length, imperviousness and percentage of each hydrologic soils group. Output from the program includes peak existing flows for the WQV, EURV, 2YR, 5YR, 10YR, 25YR, 50YR, 100YR and 500YR storms. The pre-development runoff rates for the 5 and 100 year storms are 0.01 cfs and 1.01 cfs respectfully. This is summarized on the page entitled "Detention Basin Outlet Structure Design", at the bottom in the table entitled "Routed Hydrograph Results."

PROPOSED DRAINAGE CHARACTERISTICS

For the developed condition, the site will include the 2.23 acres of paved storage yard and the 0.32 acres including the pond footprint. Runoff from the 2.23 acres will be collected in a gutter system, to a curb opening inlets, through HDDP pipes and oufalling into a full spectrum detention pond east of the site. Runoff from the 0.32 acres will drain to pond via overland flow.

See the attached sheet C2: "Grading and Drainage Plan" later in this report for more information including sub-basin areas, storm drain layout, and proposed grading.

For the other hydrologic calculations including those for inlets, pipes and gutters, the Rational Method is used, consistent with the El Paso County requirements. This results in the peak discharge rates from the proposed yard into proposed structures A5 at $Q_5=5.3$ cfs/ $Q_{100}=9.5$ cfs and A6 at $Q_5=4.6$ cfs/ $Q_{100}=8.2$ cfs. For more information see the "Hydrologic Summary" in the Appendix.

For the proposed full spectrum detention pond, proposed peak discharge rates are calculated from UD Detention version 3.04. The proposed runoff rates for the 5 and 100 year storms are 4.6 cfs and 8.1 cfs respectively. This is summarized on the page entitled "Detention Basin Outlet Structure Design", at the bottom in the table entitled "Routed Hydrograph Results."

DETENTION

A full-spectrum pond will be constructed as part of the project to provide water quality (WQCV & EURV) and attenuate peak flows from the ultimate developed condition. The pond will include the construction of an approximately 10' high embankment, a trickle channel, and excavation to achieve the desired storage. The outlet structure will consist of a rectangular concrete riser, with orifice plate and three round orifices, and overflow grate discharging into an 18" HDDP. A 3' emergency spillway will be also formed into the embankment. The pond will contain 0.47 ac-ft of detention volume for the 100-year storm.

It is noted that this pond will act as a temporary sediment basin during construction.

UD-Dentention_v304 shows the 5 and 100 year storms through the proposed pond yields 0.1 cfs and 0.8 cfs for the 5 and 100-year storms, respectively. See the attached UDFCD drainage calculations for further detail. This is summarized on the page entitled "Detention Basin Outlet Design", at the bottom in the table entitled "Routed Hydrograph Results."

Comparing the existing and proposed discharge rates indicates that proposed outflow from the pond will be less than existing runoff values for all storms but the 5, 10 and 25 year events. However, both the pre-development inflows and peak outflows are extremely low. See "Routed Hydrograph Results" on the Detention Basis Outlet Structure Design worksheet.

The pond will be privately owned and maintained by the property owner. Maintenance access will be provided via a graded ramp to the bottom of the pond from the proposed asphalt storage yard.

EROSION CONTROL

During construction, best management practices for erosion control will be employed based on the El Paso County criteria and the erosion control plans.

The detention pond will be configured to act as a temporary sediment basin during construction. Upon adequate site stabilization, the pond will be converted for use as a full spectrum detention water quality pond.

Silt fencing and vehicle-tracking controls will be in place to minimize erosion from the site. Silt fencing will be placed along the downsloping portions of the site. This will prevent suspended sediment from leaving the site during construction. Silt fencing is to remain in place until landscaping and vegetation is reestablished after completion of construction.

Best erosion control practices will be utilized as deemed necessary by the Contractor or Engineer and are not limited to the measures described above.

DRAINAGE FEES

No fees have been paid for this property. Drainage fees are not due with this application because it is not a final plat application.

CONCLUSION

The proposed drainage design for the Lot 8 Akers Acres will be effective to convey and control storm runoff. With the detention provided, there should be no anticipated adverse effects to downstream properties. This final drainage report for the site is in accordance with Section 4.4 of the Drainage Criteria manual. The following pages include calculations and drainage maps in support of the design.

Section I.7.2 of the Engineering Criteria Manual discusses BMP selections. The selection of appropriate BMPs is based on the characteristics of the site and potential pollutants. The Four-Step Process provides a method of going through the selection process. The four step process states *All sites defined as "New Development and Significant Redevelopment" and all stormwater quality detention, as listed above in Section I.7.1.B shall address stormwater quality by providing the WQCV.* The new storage lot will be collected on the east side in two sag inlets and directed to the full spectrum extended detention basin (EDB). The EDB is mentioned in Step 3 of the selection process , which is to provide water quality capture volume (WQCV). See the details on the Grading and Erosion Control Plans for the EDB details.

Step 1 of the selection process is employ runoff reduction practices and “minimizing directly connected impervious areas” (MDCIA). The principal behind MDCIA is twofold -- to reduce impervious areas and to route runoff from impervious surfaces over grassy areas to slow down runoff and promote infiltration. The use of grass swales instead of storm sewers, like grass buffers, slows down runoff and promotes infiltration, also reducing effective imperviousness. It also may reduce the size and cost of downstream storm sewers and detention. The ABC site uses various landscape unpaved areas to slow down runoff and promote infiltration. These have previously constructed towards the front of the building and are not part of this proposed work.

Step 2 of the four step selection process will stabilize drainage ways. Within drainage ways, natural and manmade, erosion can be a major source of sediment and associated constituents, such as phosphorus. Natural drainage ways are often subject to bed and bank erosion when urbanizing areas increase the frequency, rate, and volume of runoff. Therefore, drainage ways are required to be stabilized. The outlet channel from the EDB will be stabilized with riprap and filter fabric. See the details on the Grading and Erosion Control Plans. Along the north side of the building no formal swale exists, though it is drained by existing yard inlets. The area of this is extremely minimal.

← Please provide step 3

Step 4 of the four step selection process considers the need for industrial and commercial BMPs. If a new development or significant redevelopment activity is planned for an industrial or commercial site, the need for specialized BMPs must be considered. Two approaches are covering of storage/handling areas, and spill containment and control. Since this site will only store building materials such as siding, no spill containment measures are proposed.


There will be small areas of fill from which stormwater is not treated. This is because it is physically impossible to treat these areas in the selected BMP. As such, a deviation to the MS4 Permit of requiring all areas to be treated is being submitted concurrently with this report. Part 1 section E.4.a.iv.(A).1 defines the situation where this deviation is appropriate.

It is a deviation from the El Paso County Engineering Criteria Manual. Please revise.

MS4 permit(modification 4) part 1 section.....


APPENDICES

VICINITY AND LOCATION MAPS

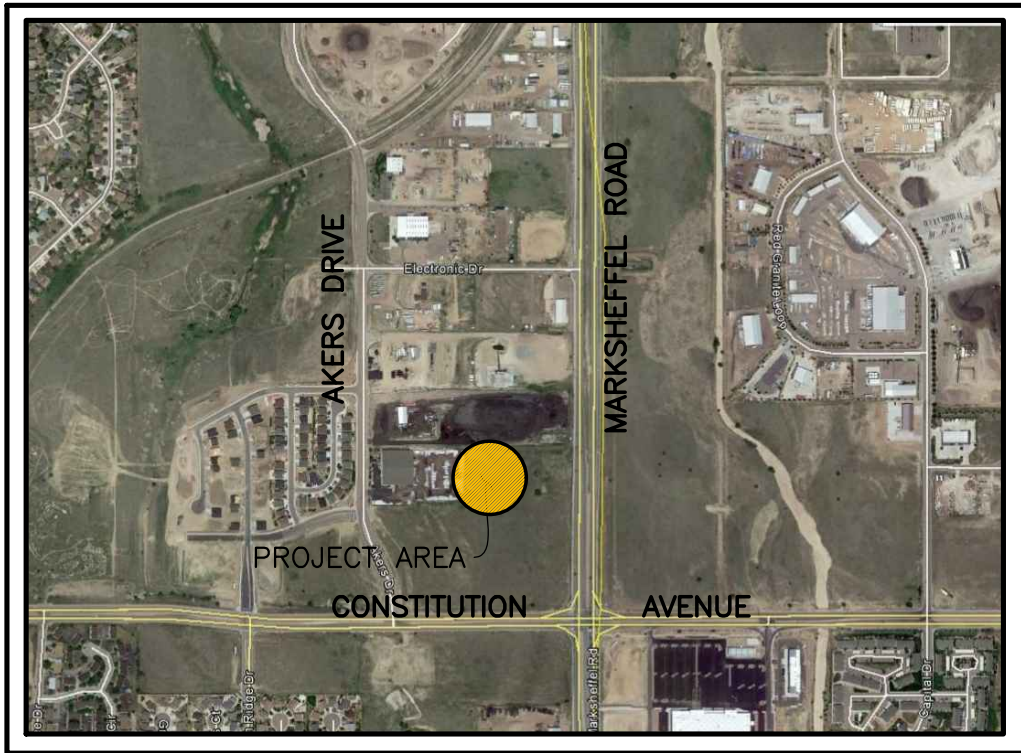

VICINITY MAP

NTS

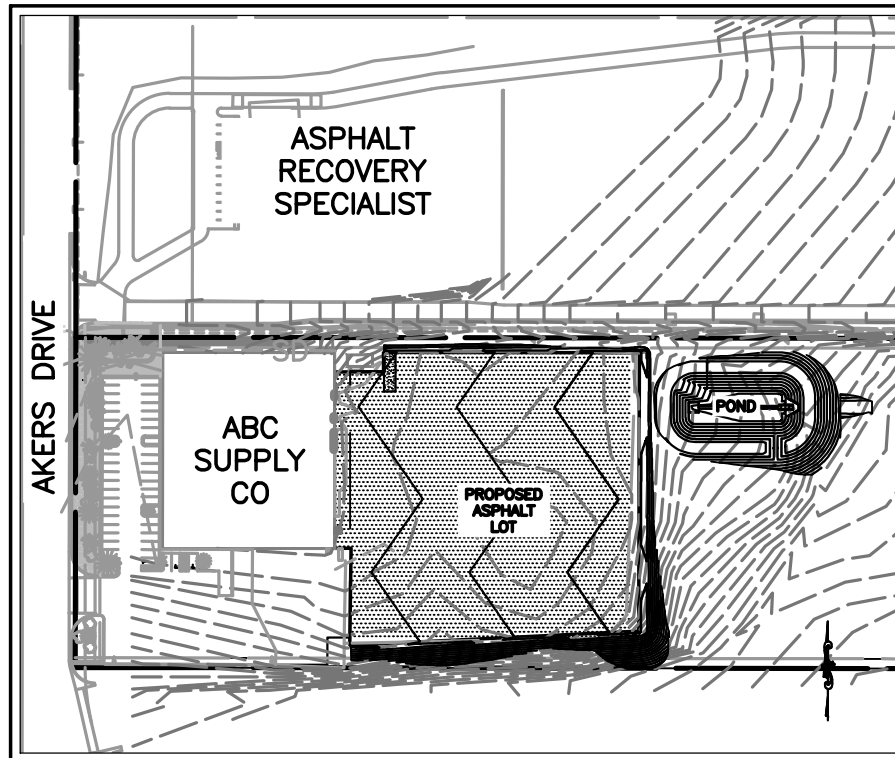

LOCATION MAP

NTS

VICINITY AND LOCATION MAPS

RATIONAL METHOD CALCULATIONS

Hydrologic Summary-Rational Method

Lot 8 Akers Acres Proposed Conditions

Basin	Area	Tc	C5	C100	I5	I100	Q5	Q100
To Inlet A5	1.20	5.00	0.85	0.90	5.20	8.80	5.30	9.50
To Inlet A6	1.03	5.00	0.85	0.90	5.20	8.80	4.55	8.16
Directly to Pond	0.32	5.00	0.59	0.70	5.20	8.80	0.98	1.97
Total	2.55							



Time of Concentration


Lot 8 Akers Acres Proposed Conditions

Per criteria, Cv value for paved areas is 20. Additionally the length of overland for urban land uses is 100' max. I understand that it will not change the end result.

DESIGN POINT	OVERLAND FLOW						TRAVEL TIME									
	C5	D _{OVERLAND}	ELEV _{UPPER} OVERLAND PATH	ELEV _{LOWER} OVERLAND PATH	S _{OVERLAND}	T _{iOVERLAND}	L _{TOTAL FLOW PATH}	L _{CHANNEL FLOW PATH}	ELEV _{UPPER} CHANNEL PATH	ELEV _{LOWER} CHANNEL PATH	H	S0	Cv	V	Tt	TC
		FT	FT	FT	%	MIN	FT	FT	FT	FT	FT	%		FPS	MIN	MIN
To Inlet A5	0.85	170.00	6482.00	6480.00	1	1.22	228.00	58.00	6480.00	6479.00	1.00	1.72%	5.0	0.66	1.47	5.00
To Inlet A6	0.85	170.00	6482.00	6480.00	1	1.22	228.00	58.00	6480.00	6479.00	1.00	1.72%	5.0	0.66	1.47	5.00
Directly to Pond	0.59	132.00	6480.00	6469.00	8	1.15	200.00	68.00	6469.00	6466.20	2.80	4.12%	5.0	1.01	1.12	5.00



Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

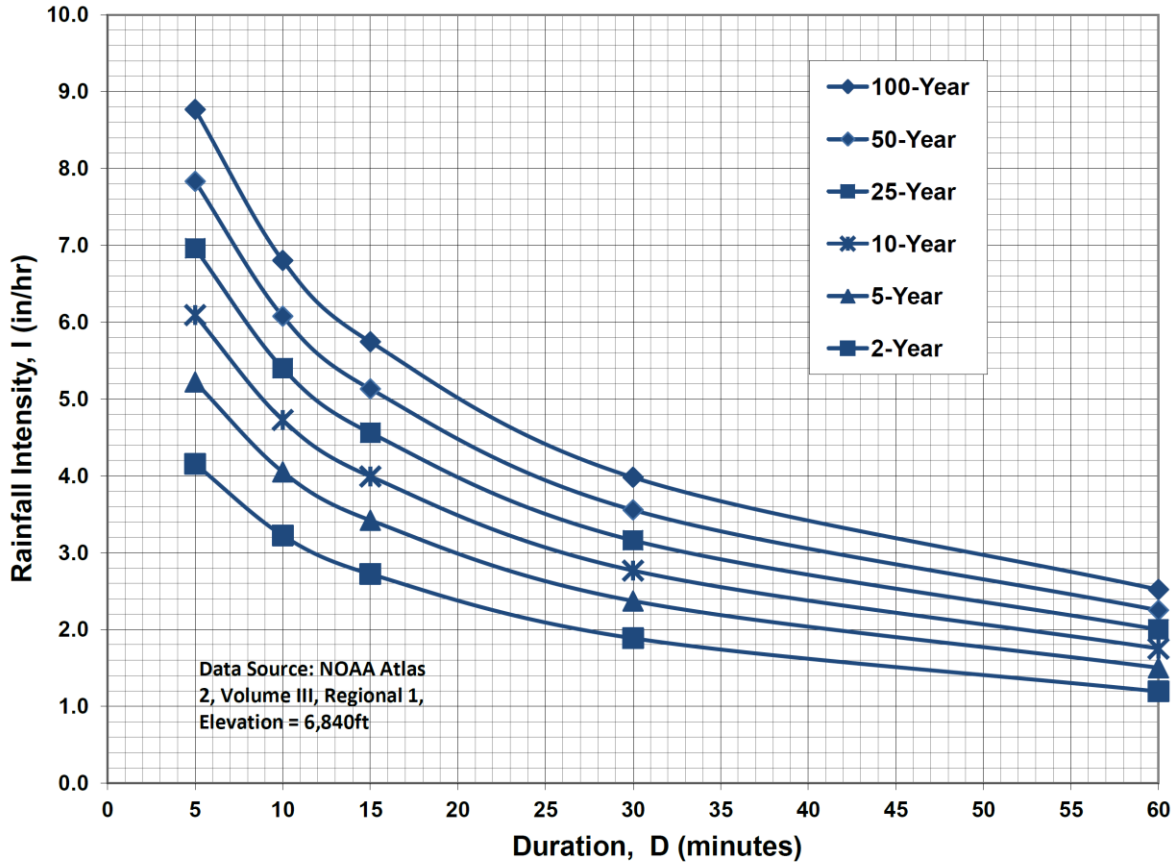

IDF Equations

$$I_{100} = -2.52 \ln(xD) + 12.735$$

$$I_{50} = -2.25 \ln(xD) + 11.375$$

$$I_{25} = -2.00 \ln(xD) + 10.111$$

$$I_{10} = -1.75 \ln(xD) + 8.847$$

$$I_5 = -1.50 \ln(xD) + 7.583$$

$$I_2 = -1.19 \ln(xD) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_t) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_t) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

INLET & STORM DRAIN CALCULATIONS

FULL SPECTRUM DETENTION CALCULATIONS

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

Designer: CLD
Company: OWA
Date: April 30, 2019
Project: Akers Acres Lot 8
Location: ABC Supply CO

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, I_b</p> <p>B) Tributary Area's Imperviousness Ratio ($i = I_b / 100$)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time ($V_{DESIGN} = (1.0 * (0.91 * I_b^3 - 1.19 * I_b^2 + 0.78 * i) / 12 * Area)$)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume ($V_{WQCV\ OTHER} = (d_e * V_{DESIGN} / 0.43)$)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) NRCS Hydrologic Soil Groups of Tributary Watershed i) Percentage of Watershed consisting of Type A Soils ii) Percentage of Watershed consisting of Type B Soils iii) Percentage of Watershed consisting of Type C/D Soils</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume For HSG A: $EURV_A = 1.68 * i^{1.28}$ For HSG B: $EURV_B = 1.36 * i^{1.08}$ For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$</p> <p>K) User Input of Excess Urban Runoff Volume (EURV) Design Volume (Only if a different EURV Design Volume is desired)</p>	<p>$I_b =$ <input type="text" value="97.0"/> %</p> <p>$i =$ <input type="text" value="0.970"/></p> <p>Area = <input type="text" value="2.550"/> ac</p> <p>$d_e =$ <input type="text" value=""/></p> <p>Choose One</p> <p><input type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input checked="" type="radio"/> Excess Urban Runoff Volume (EURV)</p> <p>$V_{DESIGN} =$ <input type="text" value="0.099"/> ac-ft</p> <p>$V_{DESIGN\ OTHER} =$ <input type="text" value=""/> ac-ft</p> <p>$V_{DESIGN\ USER} =$ <input type="text" value=""/> ac-ft</p> <p>HSG A = <input type="text" value="100"/> %</p> <p>HSG B = <input type="text" value="0"/> %</p> <p>HSG C/D = <input type="text" value="0"/> %</p> <p>$EURV_{DESIGN} =$ <input type="text" value="0.343"/> ac-ft</p> <p>$EURV_{DESIGN\ USER} =$ <input type="text" value=""/> ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <input type="text" value="4.0"/> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <input type="text" value="4.00"/> ft / ft</p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<p><u>Forebay</u></p> <hr/> <hr/> <hr/>
<p>5. Forebay</p> <p>A) Minimum Forebay Volume ($V_{FMIN} =$ <input type="text" value="2"/> % of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth ($D_F =$ <input type="text" value="18"/> inch maximum)</p> <p>D) Forebay Discharge</p> <p>i) Undetained 100-year Peak Discharge</p> <p>ii) Forebay Discharge Design Flow ($Q_F = 0.02 * Q_{100}$)</p> <p>E) Forebay Discharge Design</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p>$V_{FMIN} =$ <input type="text" value="0.002"/> ac-ft</p> <p>$V_F =$ <input type="text" value="0.002"/> ac-ft</p> <p>$D_F =$ <input type="text" value="6.0"/> in</p> <p>$Q_{100} =$ <input type="text" value="8.10"/> cfs</p> <p>$Q_F =$ <input type="text" value="0.16"/> cfs</p> <p>Choose One</p> <p><input type="radio"/> Berm With Pipe</p> <p><input checked="" type="radio"/> Wall with Rect. Notch</p> <p><input type="radio"/> Wall with V-Notch Weir</p> <p style="color: blue;">Flow too small for berm w/ pipe</p> <p>Calculated $D_p =$ <input type="text" value=""/> in</p> <p>Calculated $W_N =$ <input type="text" value="2.9"/> in</p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 2 of 3

Designer: CLD
Company: OWA
Date: April 30, 2019
Project: Akers Acres Lot 8
Location: ABC Supply CO

<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<p>Choose One</p> <p><input checked="" type="radio"/> Concrete</p> <p><input type="radio"/> Soft Bottom</p> <p>S = <input type="text" value="0.0100"/> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>D_{mi} = <input type="text" value="2.5"/> ft</p> <p>A_{mi} = <input type="text" value="16"/> sq ft</p> <p>Choose One</p> <p><input checked="" type="radio"/> Orifice Plate</p> <p><input type="radio"/> Other (Describe):</p> <hr/> <hr/> <hr/> <p>D_{orifice} = <input type="text" value="0.30"/> inches</p> <p>A_{or} = <input type="text" value="2.75"/> square inches</p>
<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>D_{is} = <input type="text" value="4"/> in</p> <p>V_{is} = <input type="text"/> cu ft</p> <p>V_s = <input type="text" value="5.3"/> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: A_i = A_{sr} * 38.5*(e^{-0.085D})</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open are to the total screen are for the material specified.)</p> <p style="text-align: center;">Other (Y/N): <input type="text" value="N"/></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening (W_{opening}) (Minimum of 12 inches is recommended)</p>	<p>A_i = <input type="text" value="103"/> square inches</p> <p style="border: 1px solid black; padding: 2px; text-align: center;">S.S. Well Screen with 60% Open Area</p> <hr/> <hr/> <hr/> <p>User Ratio = <input type="text"/></p> <p>A_{total} = <input type="text" value="172"/> sq. in.</p> <p>H = <input type="text" value="5"/> feet</p> <p>H_{TR} = <input type="text" value="88"/> inches</p> <p>W_{opening} = <input type="text" value="12.0"/> inches VALUE LESS THAN RECOMMENDED MIN. WIDTH. WIDTH HAS BEEN SET TO 12 INCHES.</p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 3 of 3

Designer: CLD
 Company: OWA
 Date: April 30, 2019
 Project: Akers Acres Lot 8
 Location: ABC Supply CO

<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Emergency spillway has 6" compacted fill over 12" riprap TY VL over 12" granular bedding TY 2</p> <hr/> <p>Ze = <input type="text" value="4.00"/> ft / ft</p>
<p>11. Vegetation</p>	<p>Choose One</p> <p><input type="radio"/> Irrigated</p> <p><input checked="" type="radio"/> Not Irrigated</p>
<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<p><u>Access ramp provided in NW corner. Equipment access bottom of pond to clean sediment and debris.</u></p> <hr/> <hr/> <hr/> <hr/>


Notes: _____

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: _____

Basin ID: _____

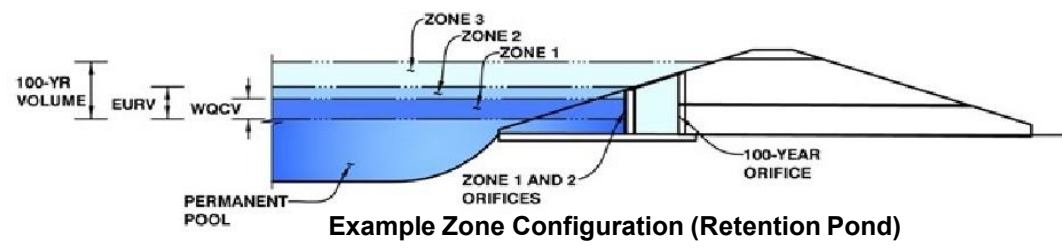

Required Volume Calculation

Selected BMP Type =	EDB	
Watershed Area =	2.55	acres
Watershed Length =	462	ft
Watershed Slope =	0.010	ft/ft
Watershed Imperviousness =	96.00%	percent
Percentage Hydrologic Soil Group A =	100.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Desired WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths =	User Input	
Water Quality Capture Volume (WQCV) =	0.097	acre-feet
Excess Urban Runoff Volume (EURV) =	0.339	acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =	0.236	acre-feet
5-yr Runoff Volume (P1 = 1.5 in.) =	0.305	acre-feet
10-yr Runoff Volume (P1 = 1.75 in.) =	0.365	acre-feet
25-yr Runoff Volume (P1 = 2 in.) =	0.424	acre-feet
50-yr Runoff Volume (P1 = 2.25 in.) =	0.474	acre-feet
100-yr Runoff Volume (P1 = 2.52 in.) =	0.539	acre-feet
500-yr Runoff Volume (P1 = 3.29 in.) =	0.717	acre-feet
Approximate 2-yr Detention Volume =	0.224	acre-feet
Approximate 5-yr Detention Volume =	0.290	acre-feet
Approximate 10-yr Detention Volume =	0.343	acre-feet
Approximate 25-yr Detention Volume =	0.403	acre-feet
Approximate 50-yr Detention Volume =	0.438	acre-feet
Approximate 100-yr Detention Volume =	0.467	acre-feet

Optional User Override 1-hr Precipitation	1.19	inches
	1.50	inches
	1.75	inches
	2.00	inches
	2.25	inches
	2.52	inches
	3.29	inches

Stage-Storage Calculation

Zone 1 Volume (WQCV) =	0.097	acre-feet
Zone 2 Volume (EURV - Zone 1) =	0.242	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.128	acre-feet
Total Detention Basin Volume =	0.467	acre-feet
Initial Surcharge Volume (ISV) =	13	ft ³
Initial Surcharge Depth (ISD) =	0.50	ft
Total Available Detention Depth (H _{total}) =	6.00	ft
Depth of Trickle Channel (H _{TC}) =	0.50	ft
Slope of Trickle Channel (S _{TC}) =	0.010	ft/ft
Slopes of Main Basin Sides (S _{main}) =	3	H:V
Basin Length-to-Width Ratio (R _{L/W}) =	4	
Initial Surcharge Area (A _{ISV}) =	25	ft ²
Surcharge Volume Length (L _{ISV}) =	5.0	ft
Surcharge Volume Width (W _{ISV}) =	5.0	ft
Depth of Basin Floor (H _{FLOOR}) =	0.96	ft
Length of Basin Floor (L _{FLOOR}) =	103.4	ft
Width of Basin Floor (W _{FLOOR}) =	28.9	ft
Area of Basin Floor (A _{FLOOR}) =	2,990	ft ²
Volume of Basin Floor (V _{FLOOR}) =	1,048	ft ³
Depth of Main Basin (H _{MAIN}) =	4.04	ft
Length of Main Basin (L _{MAIN}) =	127.7	ft
Width of Main Basin (W _{MAIN}) =	53.2	ft
Area of Main Basin (A _{MAIN}) =	6,791	ft ²
Volume of Main Basin (V _{MAIN}) =	19,264	ft ³
Calculated Total Basin Volume (V _{total}) =	0.467	acre-feet


Depth Increment = 0.1 ft		Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Optional Override Area (ft ²)	Area (acre)	Volume (ft ³)	Volume (ac-ft)
Top of Micropool		0.00	5.0	5.0	25		0.001		
ISV		0.50	5.0	5.0	25		0.001	12	0.000
		0.60	5.0	5.0	25		0.001	15	0.000
		0.70	5.0	5.0	25		0.001	18	0.000
		0.80	5.0	5.0	25		0.001	20	0.000
		0.90	5.0	5.0	25		0.001	23	0.001
		1.00	5.0	5.0	25		0.001	25	0.001
		1.10	14.3	7.3	104		0.002	31	0.001
		1.20	24.6	9.8	241		0.006	48	0.001
		1.30	34.9	12.3	429		0.010	81	0.002
		1.40	45.2	14.8	669		0.015	135	0.003
		1.50	55.5	17.3	960		0.022	216	0.005
		1.60	65.8	19.8	1,302		0.030	329	0.008
		1.70	76.1	22.3	1,696		0.039	478	0.011
		1.80	86.4	24.8	2,142		0.049	670	0.015
		1.90	96.7	27.3	2,639		0.061	909	0.021
Floor		1.96	102.9	28.8	2,962		0.068	1,076	0.025
		2.00	103.6	29.1	3,018		0.069	1,196	0.027
		2.10	104.3	29.8	3,106		0.071	1,533	0.035
		2.20	104.9	30.4	3,187		0.073	1,848	0.042
		2.30	105.5	31.0	3,269		0.075	2,171	0.050
		2.40	106.1	31.6	3,351		0.077	2,502	0.057
		2.50	106.7	32.2	3,434		0.079	2,841	0.065
		2.60	107.3	32.8	3,517		0.081	3,188	0.073
		2.70	107.9	33.4	3,602		0.083	3,544	0.081
		2.80	108.5	34.0	3,687		0.085	3,909	0.090
Zone 1 (WQCV)		2.89	109.0	34.5	3,764		0.086	4,244	0.097
		2.90	109.1	34.6	3,773		0.087	4,282	0.098
		3.00	109.7	35.2	3,859		0.089	4,663	0.107
		3.10	110.3	35.8	3,947		0.091	5,054	0.116
		3.20	110.9	36.4	4,035		0.093	5,453	0.125
		3.30	111.5	37.0	4,123		0.095	5,861	0.135
		3.40	112.1	37.6	4,213		0.097	6,277	0.144
		3.50	112.7	38.2	4,303		0.099	6,703	0.154
		3.60	113.3	38.8	4,394		0.101	7,138	0.164
		3.70	113.9	39.4	4,485		0.103	7,582	0.174
		3.80	114.5	40.0	4,578		0.105	8,035	0.184
		3.90	115.1	40.6	4,671		0.107	8,498	0.195
		4.00	115.7	41.2	4,765		0.109	8,969	0.206
		4.10	116.3	41.8	4,859		0.112	9,451	0.217
		4.20	116.9	42.4	4,954		0.114	9,941	0.228
		4.30	117.5	43.0	5,050		0.116	10,441	0.240
		4.40	118.1	43.6	5,147		0.118	10,951	0.251
		4.50	118.7	44.2	5,244		0.120	11,471	0.263
		4.60	119.3	44.8	5,342		0.123	12,000	0.275
		4.70	119.9	45.4	5,441		0.125	12,539	0.288
		4.80	120.5	46.0	5,541		0.127	13,088	0.300
		4.90	121.1	46.6	5,641		0.129	13,647	0.313
		5.00	121.7	47.2	5,742		0.132	14,217	0.326
Zone 2 (EURV)		5.10	122.3	47.8	5,843		0.134	14,796	0.340
		5.20	122.9	48.4	5,946		0.136	15,385	0.353
		5.30	123.5	49.0	6,049		0.139	15,985	0.367
		5.40	124.1	49.6	6,153		0.141	16,595	0.381
		5.50	124.7	50.2	6,257		0.144	17,216	0.395
		5.60	125.3	50.8	6,363		0.146	17,847	0.410
		5.70	125.9	51.4	6,469		0.149	18,488	0.424
		5.80	126.5	52.0	6,575		0.151	19,140	0.439
		5.90	127.1	52.6	6,683		0.153	19,803	0.455
Zone 3 (100-year)		5.98	127.6	53.1	6,769		0.155	20,341	0.467
		6.00	127.7	53.2	6,791		0.156	20,477	0.470
		6.10	128.3	53.8	6,900		0.158	21,161	0.486
		6.20	128.9	54.4	7,009		0.161	21,857	0.502
		6.30	129.5	55.0	7,120		0.163	22,563	0.518
		6.40	130.1	55.6	7,231		0.166	23,281	0.534
		6.50	130.7	56.2	7,343		0.169	24,010	0.551
		6.60	131.3	56.8	7,455		0.171	24,749	0.568
		6.70	131.9	57.4	7,568		0.174	25,501	0.585
		6.80	132.5	58.0	7,682		0.176	26,263	0.603
		6.90	133.1	58.6	7,797		0.179	27,037	0.621
		7.00	133.7	59.2	7,912		0.182	27,823	0.639
		7.10	134.3	59.8	8,028		0.184	28,620	0.657
		7.20	134.9	60.4	8,145		0.187	29,428	0.676
		7.30	135.5	61.0	8,263		0.190	30,249	0.694
		7.40	136.1	61.6	8,381		0.192	31,081	0.714
		7.50	136.7	62.2	8,500		0.195	31,925	0.733
		7.60	137.3	62.8	8,620		0.198	32,781	0.753
		7.70	137.9	63.4	8,740		0.201	33,649	0.772
		7.80	138.5	64.0	8,861		0.203	34,529	0.793
		7.90	139.1	64.6	8,983		0.206	35,421	0.813
		8.00	139.7	65.2	9,105		0.209	36,325	0.834
		8.10	140.3	65.8	9,229		0.212	37,242	0.855
		8.20	140.9	66.4	9,353		0.215	38,171	0.876
		8.30	141.5	67.0	9,477		0.218	39,113	0.898
		8.40	142.1	67.6	9,603		0.220	40,067	0.920
		8.50	142.7	68.2	9,729		0.223	41,033	0.942
		8.60	143.3	68.8	9,856		0.226	42,012	0.964
		8.70	143.9	69.4	9,984		0.229	43,004	0.987
		8.80	144.5	70.0	10,112		0.232	44,009	1.010
		8.90	145.1	70.6	10,241		0.235	45,027	1.034
		9.00	145.7	71.2	10,371		0.238	46,057	1.057
		9.10	146.3	71.8	10,501		0.241	47,101	1.081
		9.20	146.9	72.4	10,632		0.244	48,158	1.106
		9.30	147.5	73.0	10,764		0.247	49,227	1.130
		9.40	148.1	73.6	10,897		0.250	50,310	1.155
		9.50	148.7	74.2	11,030		0.253	51,407	1.180
		9.60	149.3	74					

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: _____

Basin ID: _____

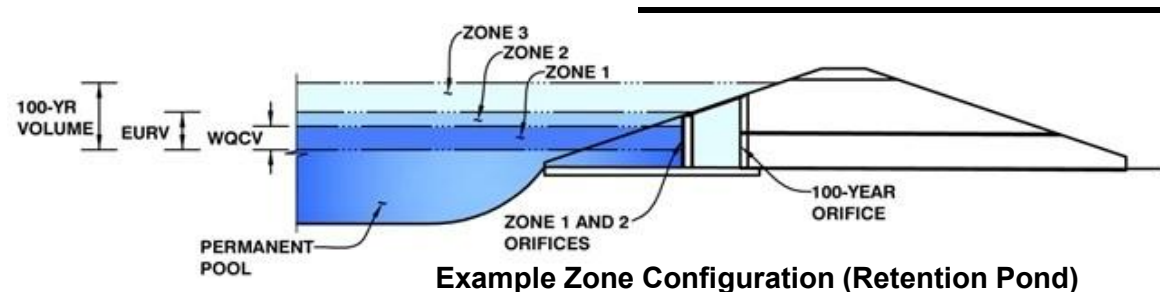

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.89	0.097	Orifice Plate
Zone 2 (EURV)	5.10	0.242	Orifice Plate
Zone 3 (100-year)	5.98	0.128	Weir&Pipe (Rect.)
		0.467	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
 Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
 Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
 Orifice Plate: Orifice Vertical Spacing = inches
 Orifice Plate: Orifice Area per Row = inches

Calculated Parameters for Plate

WQ Orifice Area per Row = ft²
 Elliptical Half-Width = feet
 Elliptical Slot Centroid = feet
 Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.70	3.40	5.10				
Orifice Area (sq. inches)	0.30	0.75	1.70	2.00				
Diameter (in)	10/16	1	1 8/16	1 10/16				
	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice = ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Vertical Orifice = ft (relative to basin bottom at Stage = 0 ft)
 Vertical Orifice Diameter = inches

Calculated Parameters for Vertical Orifice

Vertical Orifice Area = ft²
 Vertical Orifice Centroid = feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

Overflow Weir Front Edge Height, H_o = ft (relative to basin bottom at Stage = 0 ft)
 Overflow Weir Front Edge Length = feet
 Overflow Weir Slope = H:V (enter zero for flat grate)
 Horiz. Length of Weir Sides = feet
 Overflow Grate Open Area % = %
 Debris Clogging % = %

Calculated Parameters for Overflow Weir

Height of Grate Upper Edge, H_g = feet
 Over Flow Weir Slope Length = feet
 Grate Open Area / 100-yr Orifice Area = should be ≥ 4
 Overflow Grate Open Area w/o Debris = ft²
 Overflow Grate Open Area w/ Debris = ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe = ft (distance below basin bottom at Stage = 0 ft)
 Rectangular Orifice Width = inches
 Rectangular Orifice Height = inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

Outlet Orifice Area = ft²
 Outlet Orifice Centroid = feet
 Half-Central Angle of Restrictor Plate on Pipe = radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = ft (relative to basin bottom at Stage = 0 ft)
 Spillway Crest Length = feet
 Spillway End Slopes = H:V
 Freeboard above Max Water Surface = feet

Calculated Parameters for Spillway

Spillway Design Flow Depth = feet
 Stage at Top of Freeboard = feet
 Basin Area at Top of Freeboard = acres

Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.29
Calculated Runoff Volume (acre-ft) =	0.097	0.339	0.236	0.305	0.365	0.424	0.474	0.539	0.717
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.097	0.339	0.235	0.304	0.365	0.424	0.474	0.539	0.716
Predevelopment Unit Peak Flow, q (cfs/acre) =	-	-	0.001	0.005	0.010	0.023	0.174	0.422	1.010
Predevelopment Peak Q (cfs) =	0.000	0.000	0.002	0.012	0.027	0.058	0.443	1.077	2.576
Peak Inflow Q (cfs) =	1.5	5.2	3.6	4.6	5.5	6.4	7.2	8.1	10.8
Peak Outflow Q (cfs) =	0.0	0.1	0.1	0.1	0.2	0.2	0.3	0.8	2.7
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	11.2	5.7	3.4	0.6	0.7	1.1
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Plate	Plate	Overflow Grate 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	0.0	0.1	0.1
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	40	68	61	66	69	71	73	72	70
Time to Drain 99% of Inflow Volume (hours) =	42	74	66	72	76	79	81	81	80
Maximum Ponding Depth (ft) =	2.80	4.94	4.12	4.68	5.12	5.51	5.82	6.02	6.60
Area at Maximum Ponding Depth (acres) =	0.08	0.13	0.11	0.12	0.13	0.14	0.15	0.16	0.17
Maximum Volume Stored (acre-ft) =	0.089	0.317	0.219	0.284	0.342	0.395	0.441	0.472	0.566

SOIL REPORT & MAP



United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for El Paso County Area, Colorado



Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
El Paso County Area, Colorado.....	13
8—Blakeland loamy sand, 1 to 9 percent slopes.....	13
10—Blendon sandy loam, 0 to 3 percent slopes.....	14
References	16

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

Soil Map


The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



Soil Map may not be valid at this scale.

Map Scale: 1:2,040 if printed on A landscape (11" x 8.5") sheet.




Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)




















Soils







 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

Special Point Features






-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features


Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 15, Oct 10, 2017

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 3, 2014—Jun 17, 2014

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	9.0	82.9%
10	Blendon sandy loam, 0 to 3 percent slopes	1.9	17.1%
Totals for Area of Interest		10.8	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however,

Custom Soil Resource Report

onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

El Paso County Area, Colorado

8—Blakeland loamy sand, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 369v
Elevation: 4,600 to 5,800 feet
Mean annual precipitation: 14 to 16 inches
Mean annual air temperature: 46 to 48 degrees F
Frost-free period: 125 to 145 days
Farmland classification: Not prime farmland

Map Unit Composition

Blakeland and similar soils: 85 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blakeland

Setting

Landform: Flats, hills
Landform position (three-dimensional): Side slope, talf
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Alluvium derived from sedimentary rock and/or eolian deposits
derived from sedimentary rock

Typical profile

A - 0 to 11 inches: loamy sand
AC - 11 to 27 inches: loamy sand
C - 27 to 60 inches: sand

Properties and qualities

Slope: 1 to 9 percent
Depth to restrictive feature: More than 80 inches
Natural drainage class: Somewhat excessively drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95
to 19.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum in profile: 5 percent
Available water storage in profile: Low (about 4.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: A
Ecological site: Sandy Foothill (R049BY210CO)
Hydric soil rating: No

Minor Components

Other soils

Percent of map unit:
Hydric soil rating: No

Pleasant

Percent of map unit:

Landform: Depressions

Hydric soil rating: Yes

10—Blendon sandy loam, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 3671

Elevation: 6,000 to 6,800 feet

Mean annual precipitation: 14 to 16 inches

Mean annual air temperature: 46 to 48 degrees F

Frost-free period: 125 to 145 days

Farmland classification: Not prime farmland

Map Unit Composition

Blendon and similar soils: 85 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blendon

Setting

Landform: Alluvial fans, terraces

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Sandy alluvium derived from arkose

Typical profile

A - 0 to 10 inches: sandy loam

Bw - 10 to 36 inches: sandy loam

C - 36 to 60 inches: gravelly sandy loam

Properties and qualities

Slope: 0 to 3 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high (0.60 to 2.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum in profile: 2 percent

Available water storage in profile: Moderate (about 6.2 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 3e

Hydrologic Soil Group: B

Ecological site: Sandy Foothill (R049BY210CO)

Custom Soil Resource Report

Hydric soil rating: No

Minor Components

Other soils

Percent of map unit:

Hydric soil rating: No

Pleasant

Percent of map unit:

Landform: Depressions

Hydric soil rating: Yes

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

FLOOD PLAIN MAP

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
 NOAA, NINGS12
 National Geodetic Survey
 SSMC-3, #9202
 1315 East-West Highway
 Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.


Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp>.

El Paso County Vertical Datum Offset Table

Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


Panel Location Map

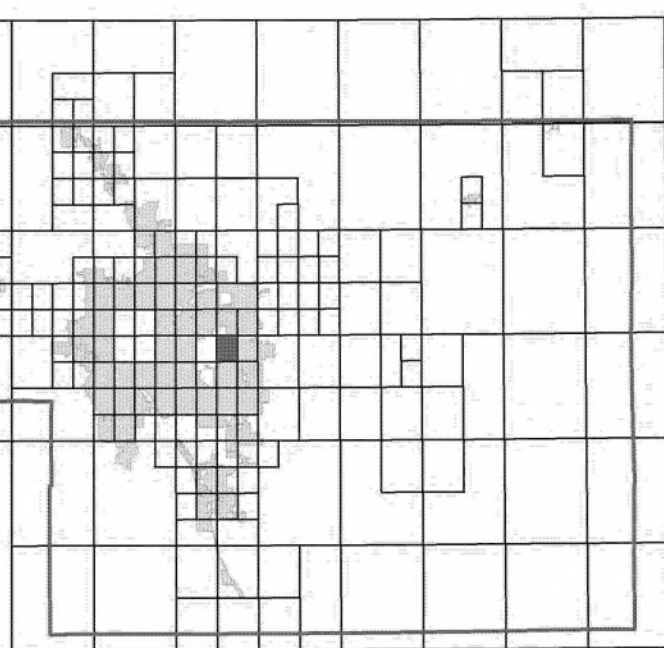

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).




Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

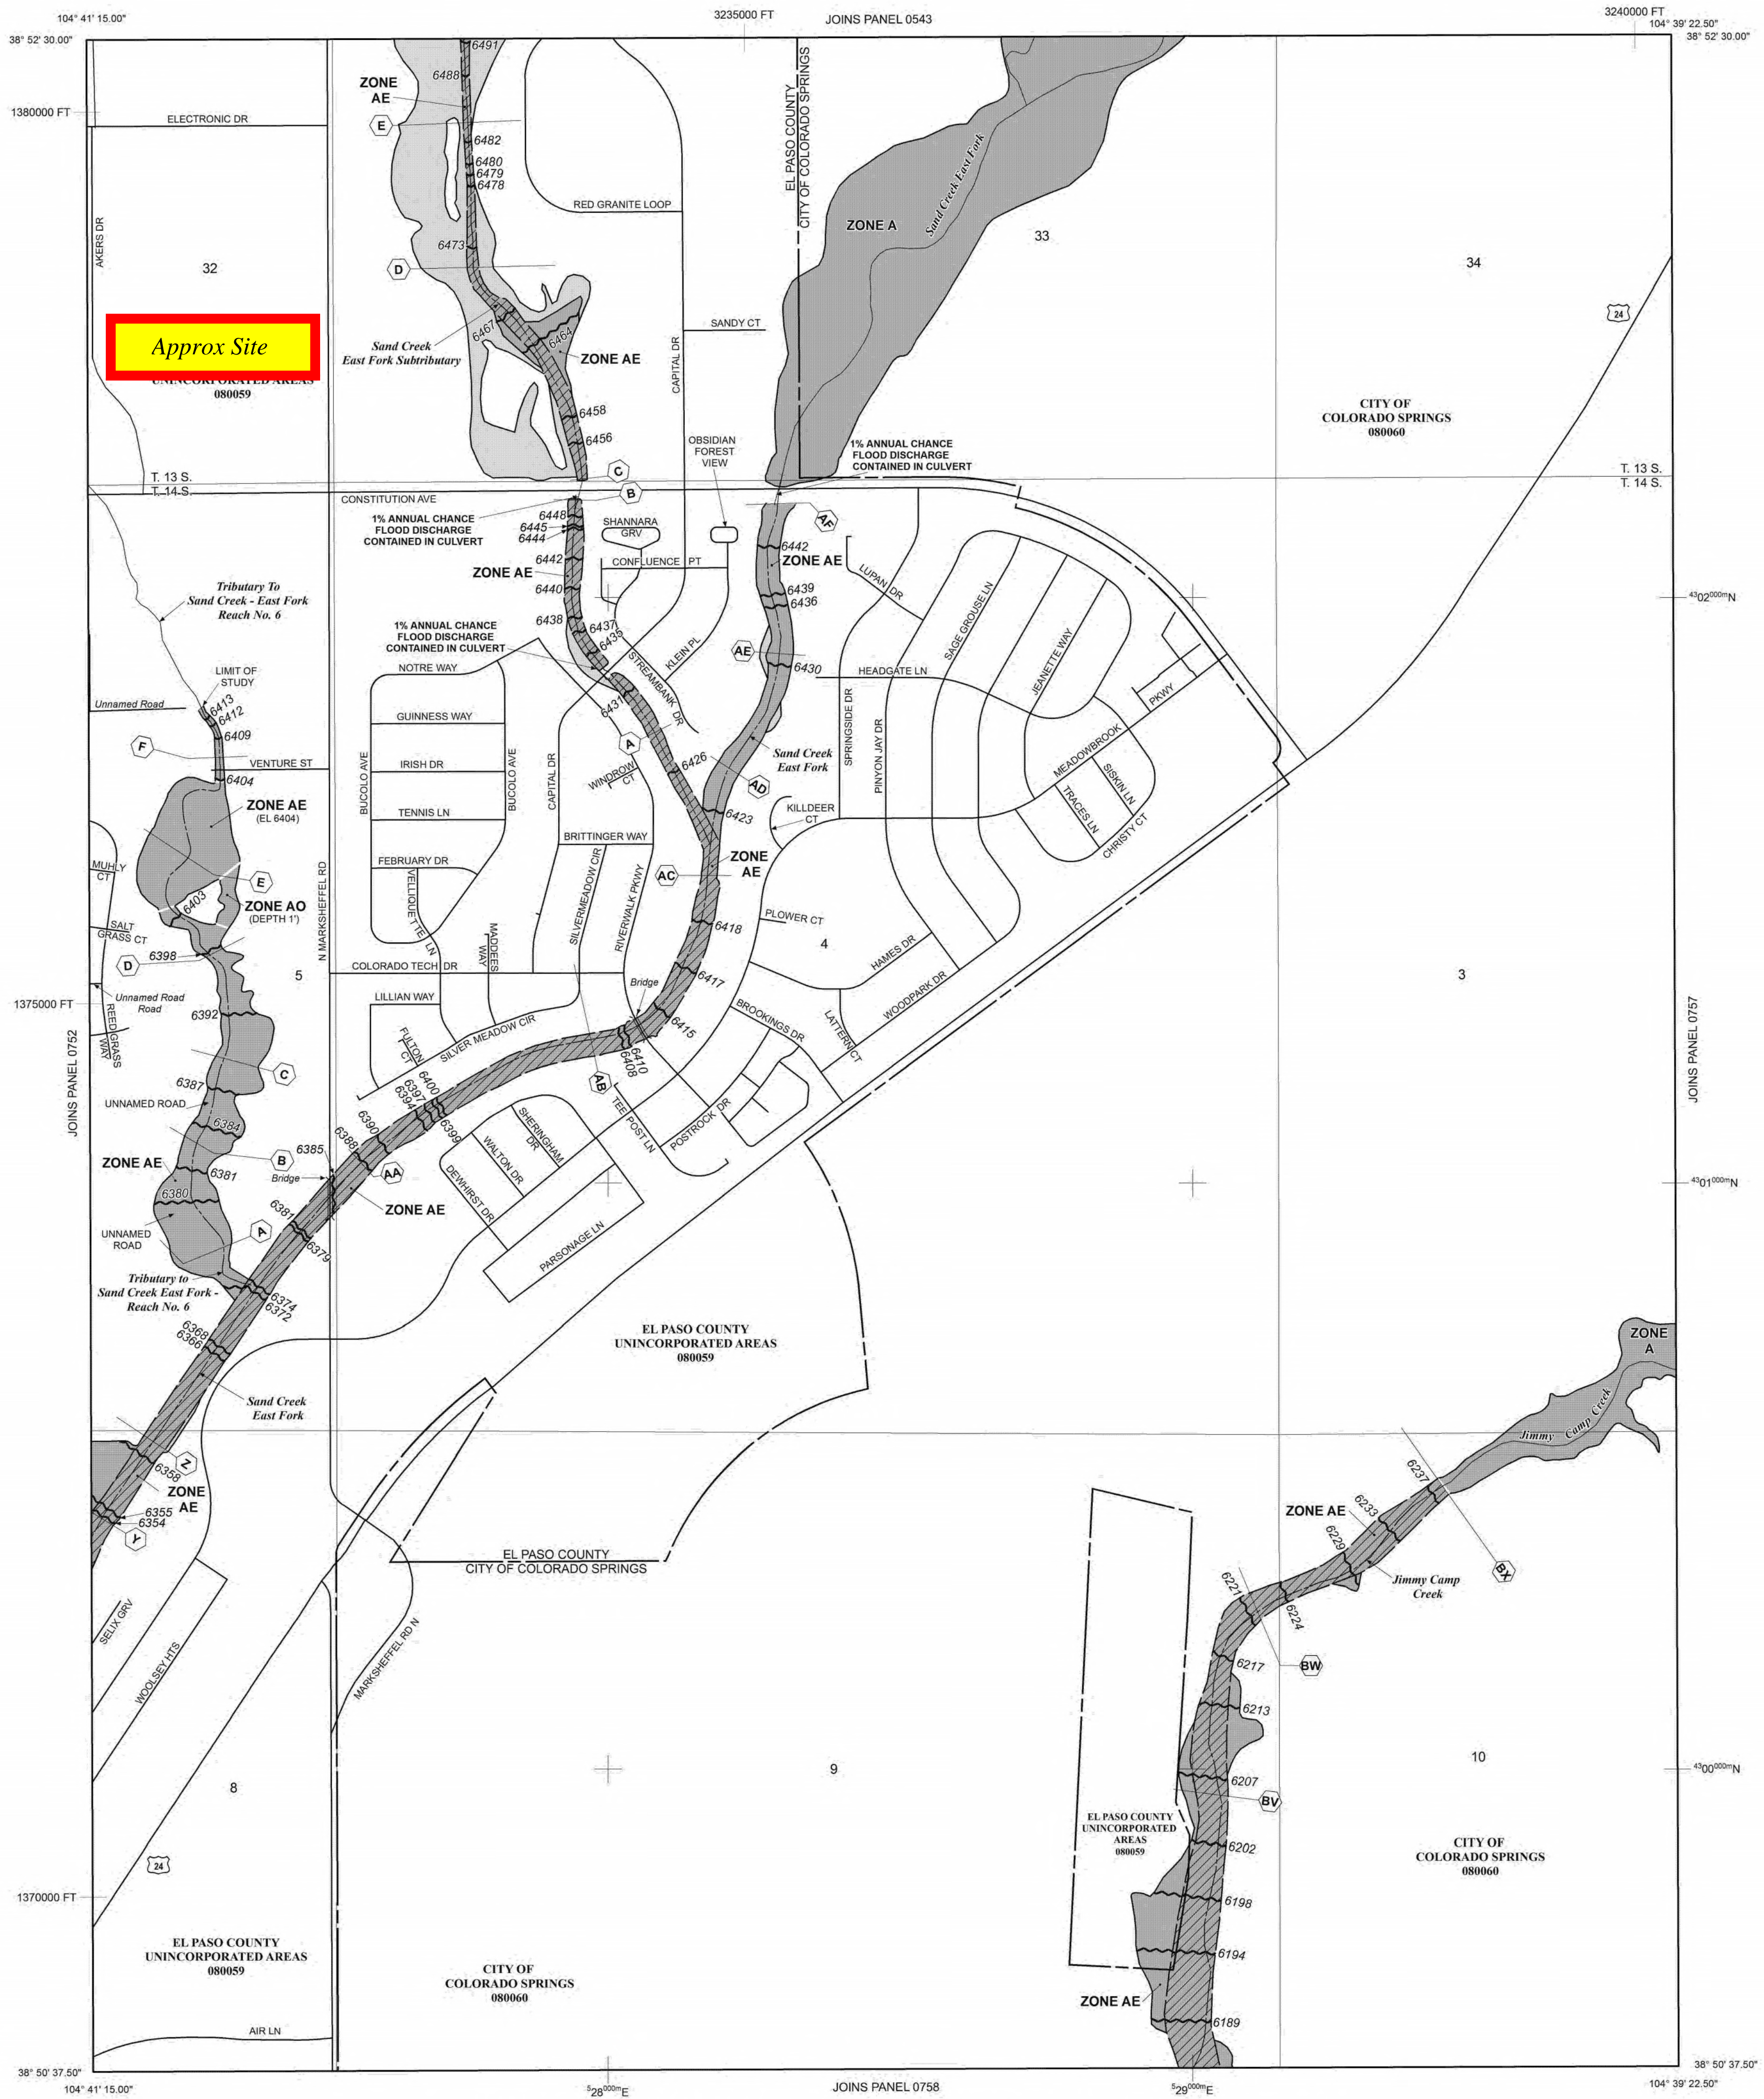

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN TOWNSHIP 13 SOUTH, RANGE 65 WEST, AND TOWNSHIP 14 SOUTH, RANGE 65 WEST.

LEGEND

- SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD
- The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equalled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.
- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently decreed. ZONE AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.
- FLOODWAY AREAS IN ZONE AE
- The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.
- OTHER FLOOD AREAS**
- ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot, or with drainage areas less than 1 square mile, and areas protected by levees from 1% annual chance flood.
- OTHER AREAS**
- ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.
- ZONE D** Areas in which flood hazards are undetermined, but possible.
- COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS
- OTHERWISE PROTECTED AREAS (OPAs)
- CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.
- Floodplain boundary
- Floodway boundary
- Zone D Boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.
- Base Flood Elevation line and value; elevation in feet* (EL 987)
- Cross section line
- Transsect line
- Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
- 1000-meter Universal Transverse Mercator grid ticks, zone 13
- 5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 0502), Lambert Conformal Conic Projection
- Bench mark (see explanation in Notes to Users section of this FIRM panel)
- River Mile
- MAP REPOSITORIES**
 Refer to Map Repository list on Map Index
- EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP**
 MARCH 17, 1997
- EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL**
 DECEMBER 7, 2018 - to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.
- For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.
- To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

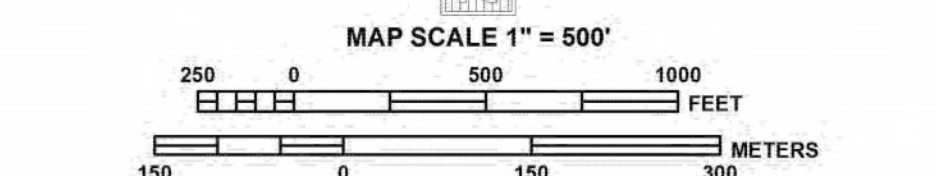

NFP

PANEL 0756G

FIRM

FLOOD INSURANCE RATE MAP

EL PASO COUNTY, COLORADO AND INCORPORATED AREAS

PANEL 756 OF 1300

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	08060	0756	G
EL PASO COUNTY	08059	0756	G



Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.

MAP NUMBER 08041C0756G

MAP REVISED DECEMBER 7, 2018

Federal Emergency Management Agency

DRAINAGE AND GRADING PLAN

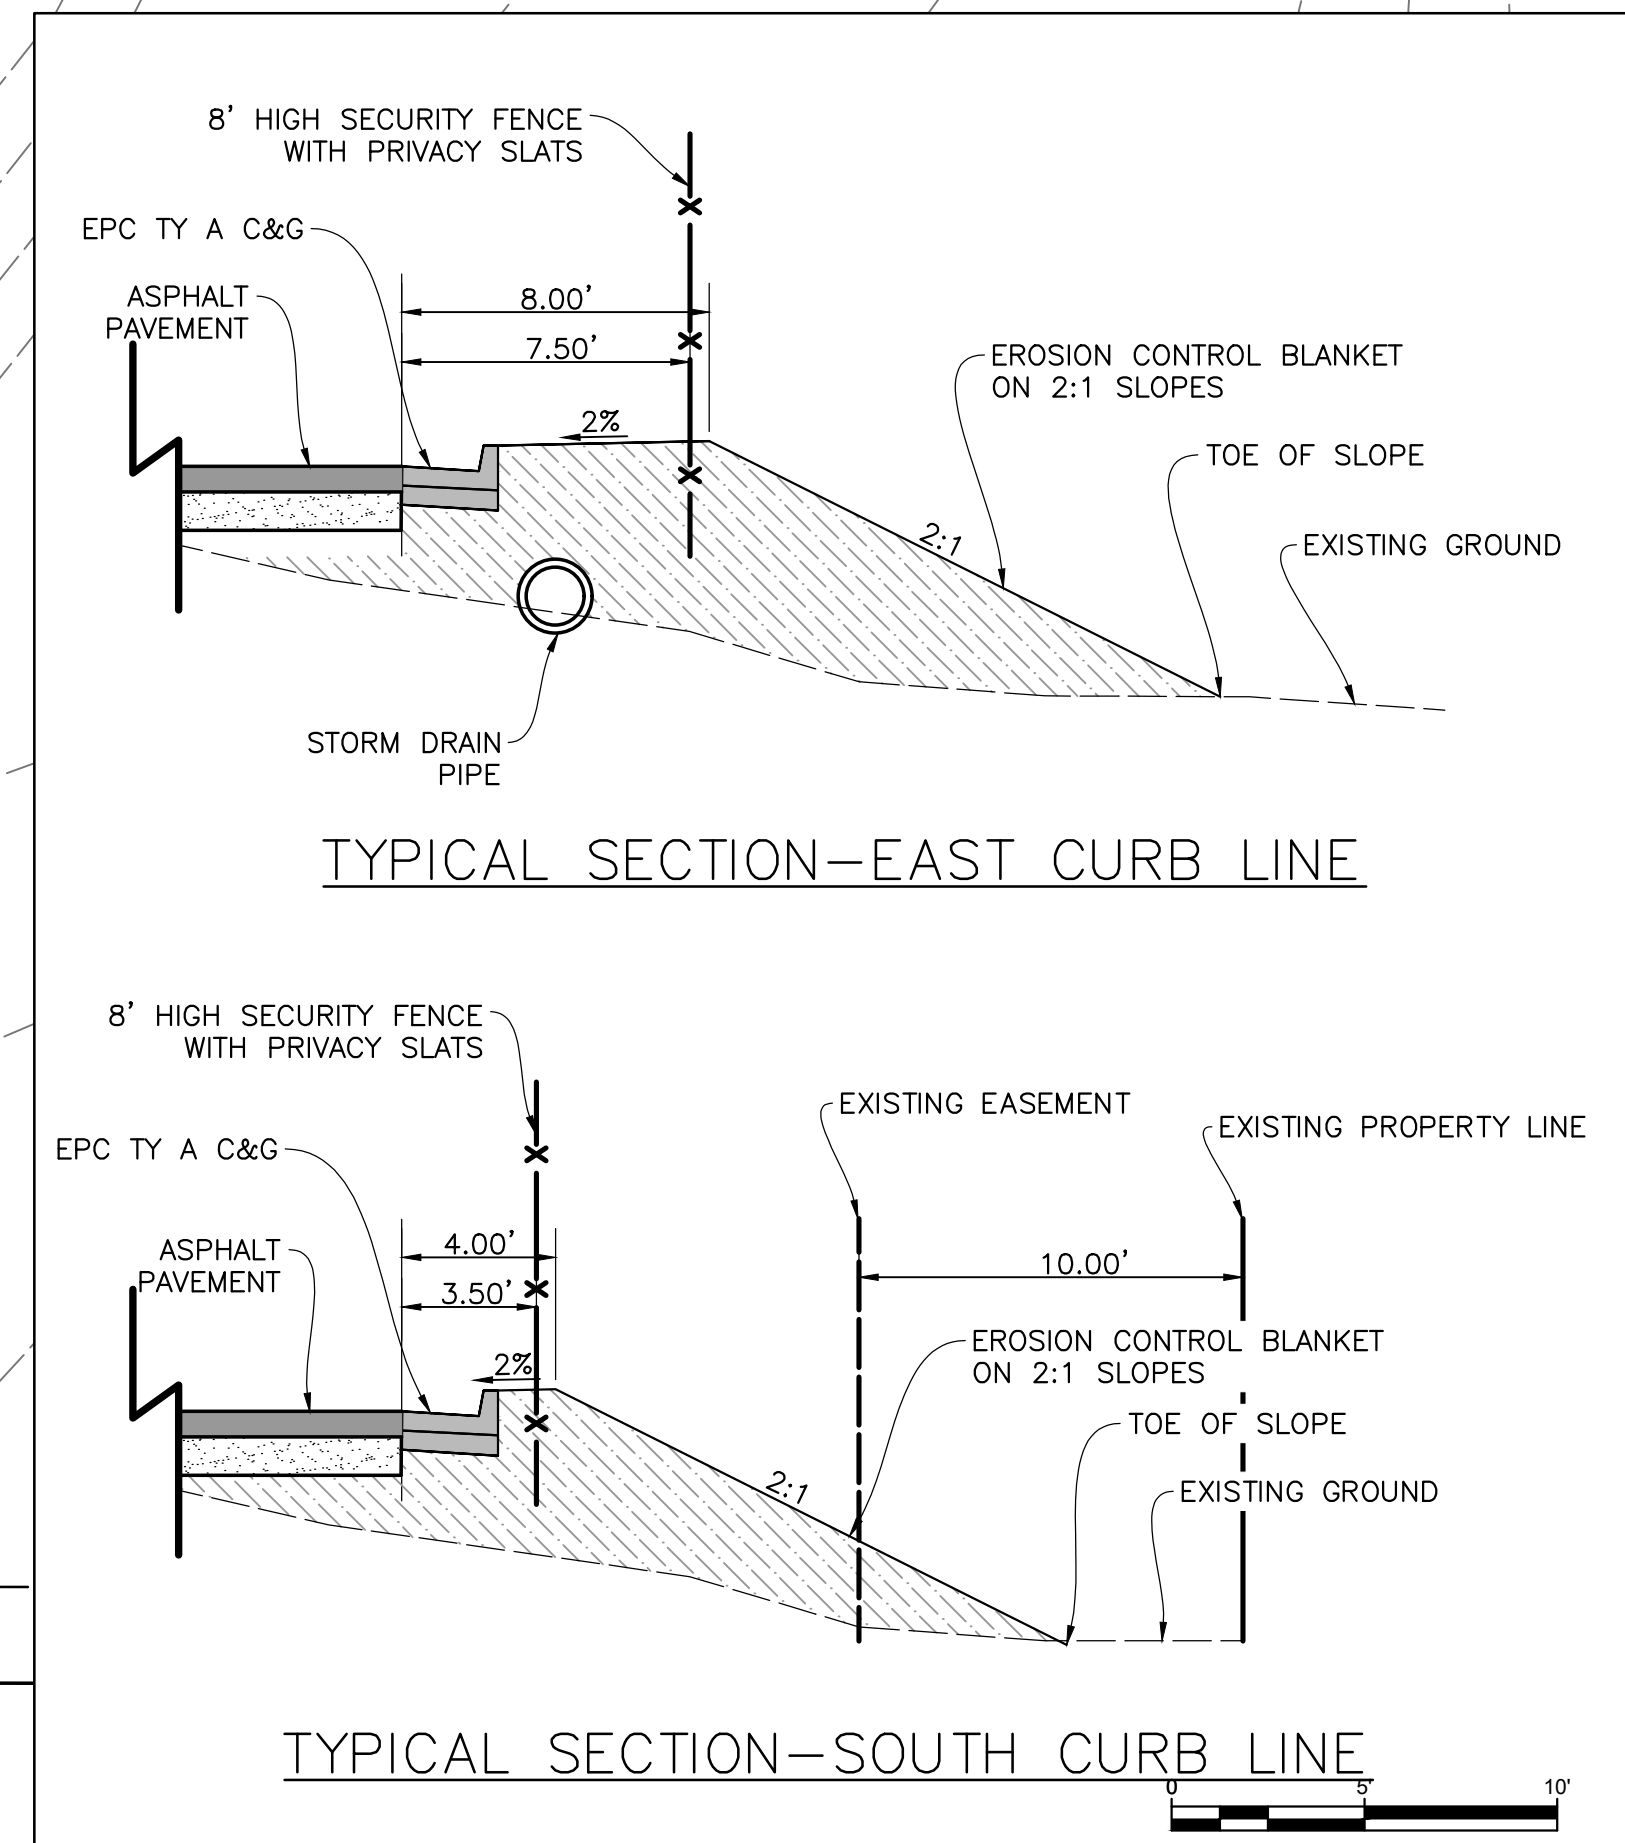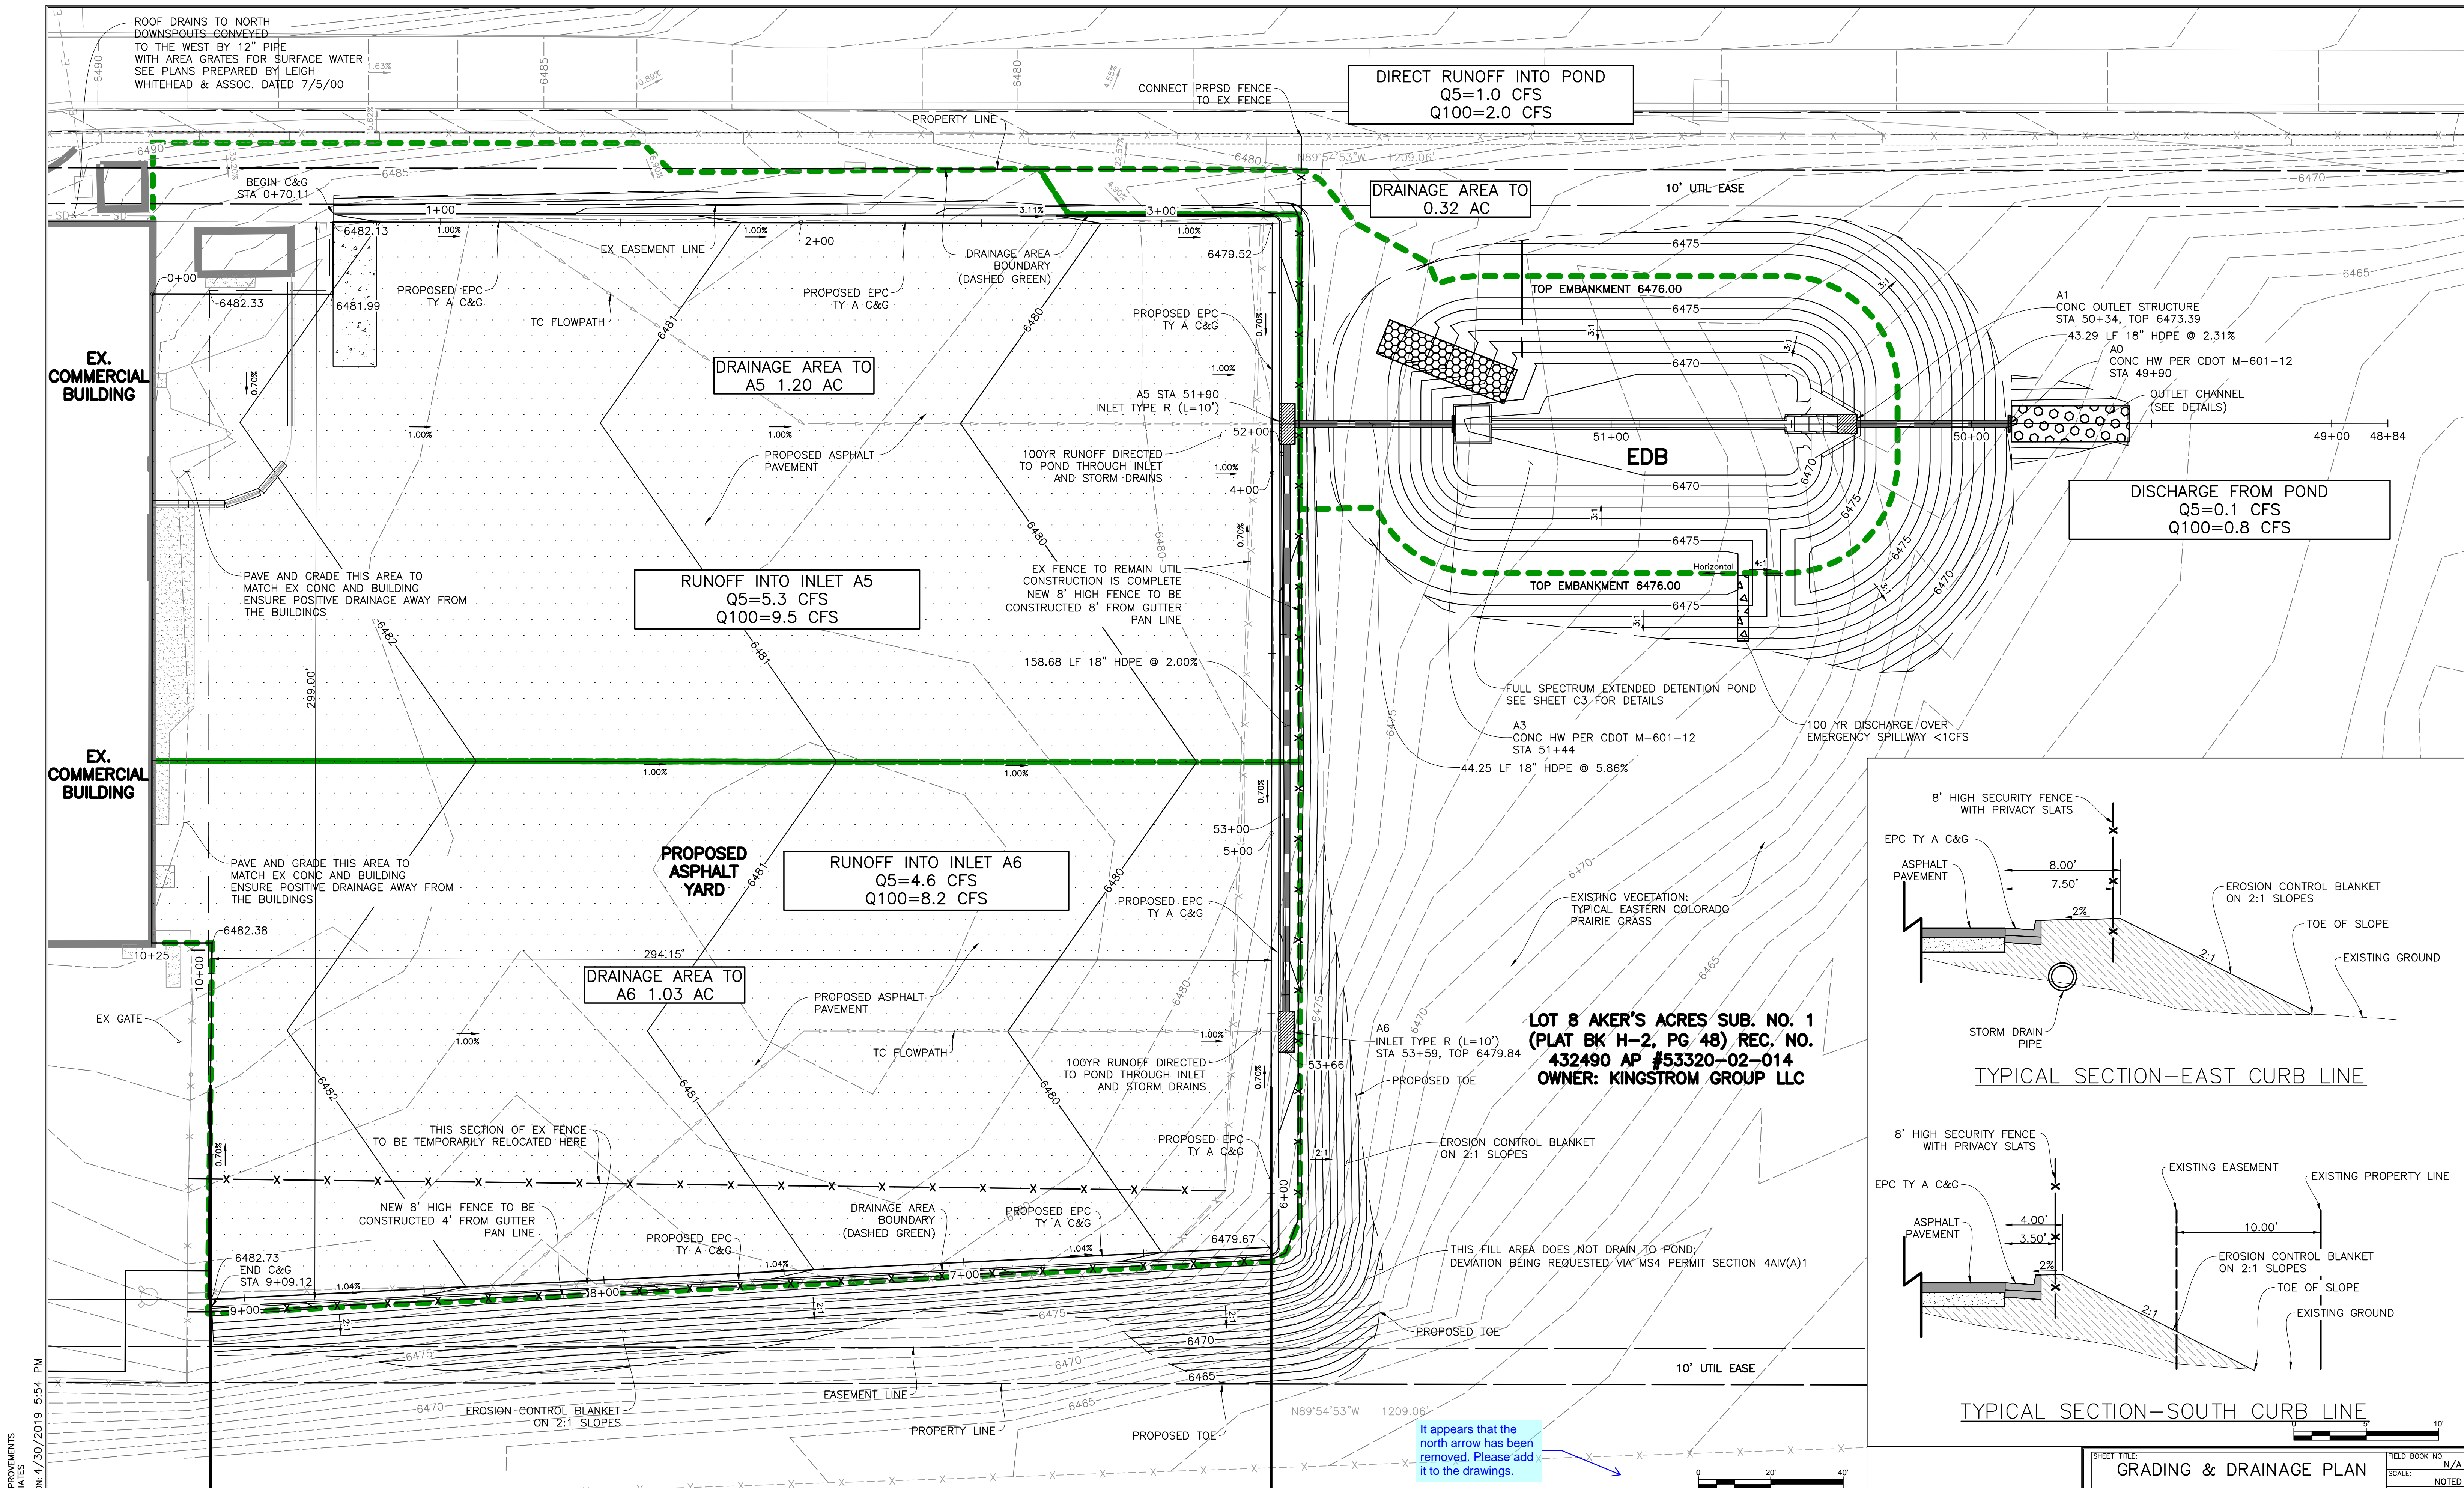

It appears that the north arrow has been removed. Please add it to the drawings.

LOT 8 AKER'S ACRES SUB. NO. 1
(PLAT BK H-2, PG 48) REC. NO.
432490 AP #53320-02-014
OWNER: KINGSTROM GROUP LLC

ISSUED FOR REVIEW
MAY 3, 2019


PROJECT NAME: STAGE CO DRAINAGE IMPROVEMENTS
 CLIENT: KINGSTROM GROUP LLC, WURTH & ASSOCIATES
 PROJECT NO: 18020 UPDATED VERSION: 4/30/2019 5:54 PM

REVIEWED FOR CONSTRUCTION:
 BY: _____
 DATE: _____

SCALE:
 HORIZONTAL: NOTED
 VERTICAL: _____
 BENCHMARK: _____

NO.	DATE	DESCRIPTION	BY

THIS DOCUMENT IS THE EXCLUSIVE PROPERTY OF OBERING, WURTH & ASSOCIATES. ANY REPRODUCTION, MODIFICATION OR USE OF THIS DOCUMENT FOR OTHER THAN ITS ORIGINAL INTENT WITHOUT PRIOR CONSENT OF OBERING WURTH AND ASSOCIATES IS PROHIBITED.

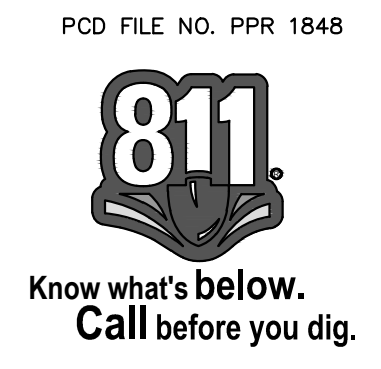

SHEET TITLE: GRADING & DRAINAGE PLAN		FIELD BOOK NO.: N/A
PROJECT: LOT 8 AKER'S ACRES COLORADO SPRINGS, COLORADO GRADING & DRAINAGE IMPROVEMENTS		SCALE: NOTED
DATE: 	DESIGNED BY: CLD	CHECKED BY: RGO
PREPARED BY: Obering, Wurth & Associates Consulting Civil Engineers Professional Land Surveyors	DRAWN BY: CLD	PROJECT NO.: 18022
1042 Elkton Drive Colorado Springs, Colorado Phone (719) 531-8200 - Fax (719) 531-6286 E-mail Address: owacivil@mindspring.com	SHEET NO.: C2	OF 8 SHEETS

Markup Summary

12/4/2018 2:02:47 PM (1)

Inlet Report
Q5

Page Label: 22
Subject: Typewriter
Author: CD CIVIL
Date: 12/4/2018 2:02:47 PM
Color: ■

Inlet Report Q5

12/4/2018 2:02:49 PM (1)

|

Page Label: 22
Subject: Typewriter
Author: CD CIVIL
Date: 12/4/2018 2:02:49 PM
Color: ■

12/4/2018 2:03:08 PM (1)

Inlet Report
Q100

Page Label: 22
Subject: Typewriter
Author: CD CIVIL
Date: 12/4/2018 2:03:08 PM
Color: ■

Inlet Report Q100

12/4/2018 2:03:52 PM (1)

Pipe Report
Q5

Page Label: 23
Subject: Typewriter
Author: CD CIVIL
Date: 12/4/2018 2:03:52 PM
Color: ■

Pipe Report Q5

12/4/2018 2:03:54 PM (1)

|

Page Label: 23
Subject: Typewriter
Author: CD CIVIL
Date: 12/4/2018 2:03:54 PM
Color: ■

12/4/2018 2:04:04 PM (1)

Pipe Report
Q100

Page Label: 23
Subject: Typewriter
Author: CD CIVIL
Date: 12/4/2018 2:04:04 PM
Color: ■

Pipe Report Q100

3/9/2019 7:45:59 AM (1)


Approx
Site

EL PASO COUNTY
UNINCORPORATED AREAS

Page Label: 49
Subject: Typewriter
Author: CD CIVIL
Date: 3/9/2019 7:45:59 AM
Color: ■

Approx Site

3/9/2019 7:46:15 AM (1)



Page Label: 49
Subject: Rectangle
Author: CD CIVIL
Date: 3/9/2019 7:46:15 AM
Color: ■


3/9/2019 7:46:28 AM (1)



Page Label: 49
Subject: Typewriter
Author: CD CIVIL
Date: 3/9/2019 7:46:28 AM
Color: ■


Approx Site

4/30/2019 8:48:45 PM (1)




Page Label: 22
Subject: Placed Image
Author: CD CIVIL
Date: 4/30/2019 8:48:45 PM
Color: ■

4/30/2019 8:49:44 PM (1)




Page Label: 23
Subject: Placed Image
Author: CD CIVIL
Date: 4/30/2019 8:49:44 PM
Color: ■

4/30/2019 8:50:34 PM (1)



Page Label: 22
Subject: Placed Image
Author: CD CIVIL
Date: 4/30/2019 8:50:34 PM
Color: ■

4/30/2019 8:51:00 PM (1)



Page Label: 23
Subject: Placed Image
Author: CD CIVIL
Date: 4/30/2019 8:51:00 PM
Color: ■


5/20/2019 10:25:52 AM (1)



Page Label: 18
Subject: Callout
Author: Daniel Torres
Date: 5/20/2019 10:25:52 AM
Color: ■

Per criteria, Cv value for paved areas is 20. Additionally the length of overland for urban land uses is 100' max. I understand that it will not change the end result.

5/20/2019 2:02:03 PM (1)



Page Label: 11
Subject: Callout
Author: Daniel Torres
Date: 5/20/2019 2:02:03 PM
Color: ■

MS4 permit(modification 4) part 1 section.....

5/20/2019 8:58:11 AM (1)

increase the frequency, rate, and volume of runoff. Then we establish. The water channel from the EDR will be stable; the details on the Grading and Erosion Control Plans. As formal swale exists, though it is drained by existing yard in usual.
Please provide step 3.
step selection process considers the need for industrial an adjacent or significant redevelopment activity is planned, the need for specialized BMPs must be considered. Surface runoff areas and soil contamination and control. See

Page Label: 11
Subject: Callout
Author: Daniel Torres
Date: 5/20/2019 8:58:11 AM
Color: ■

Please provide step 3

5/20/2019 9:01:13 AM (1)

use it is
the MS4
+ Part 1

Page Label: 11
Subject: Highlight
Author: Daniel Torres
Date: 5/20/2019 9:01:13 AM
Color: ■

MS4

5/20/2019 9:01:17 AM (1)

physically
Permit of
section F.4

Page Label: 11
Subject: Highlight
Author: Daniel Torres
Date: 5/20/2019 9:01:17 AM
Color: ■

Permit

5/20/2019 9:01:45 AM (1)

physically impossible to treat these areas in the sub-
drainage of existing all areas to be treated to bring in
to 4.4.1(A) (1) define the situation where this
is a deviation from
the El Paso County
Engineering Criteria
Manual. Please
revise.

Page Label: 11
Subject: Callout
Author: Daniel Torres
Date: 5/20/2019 9:01:45 AM
Color: ■

It is a deviation from the El Paso County Engineering Criteria Manual. Please revise.

5/20/2019 9:05:31 AM (1)

1509.000
It appears that the north arrow has been removed. (removed, please add it to the drawings.)
SCALE: HORIZONTAL: 1"=40'-0" VERTICAL: 1"=10'-0"
REVISIONS: [table with 2 columns: NO., DATE, BY]

Page Label: 51
Subject: Callout
Author: Daniel Torres
Date: 5/20/2019 9:05:31 AM
Color: ■

It appears that the north arrow has been removed. Please add it to the drawings.