

**PRELIMINARY DRAINAGE REPORT  
FOR  
SOLACE APARTMENTS**

**Prepared For:  
Jackson Dearborn Partners  
404 S. Wells Street, Suite 400  
Chicago, IL 60607  
(734) 216-2577**

**June 30, 2020  
Project No. 25174.00**

**Prepared By:  
JR Engineering, LLC  
5475 Tech Center Drive  
Colorado Springs, CO 80919  
719-593-2593**

**PCD File No. SP201**

**ENGINEER'S STATEMENT:**

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by El Paso County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.

\_\_\_\_\_  
Mike Bramlett, Colorado P.E. # 32314  
For and On Behalf of JR Engineering, LLC

\_\_\_\_\_  
Date

**DEVELOPER'S STATEMENT:**

I, the developer, have read and will comply with all of the requirements specified in this drainage report and plan.

Business Name: Jackson Dearborn Partners

By: \_\_\_\_\_

Title: \_\_\_\_\_

Address: 404 S. Wells Street  
Chicago, IL 60607

**El Paso County:**

Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual, Volumes 1 and 2 and Engineering Criteria Manual, as amended.

\_\_\_\_\_  
Jennifer Irvine, P.E.  
County Engineer/ ECM Administrator

\_\_\_\_\_  
Date

Conditions:



# CONTENTS

---

<b>PURPOSE.....</b>	<b>1</b>
<b>GENERAL LOCATION AND DESCRIPTION.....</b>	<b>1</b>
LOCATION.....	1
DESCRIPTION OF PROPERTY.....	2
FLOODPLAIN STATEMENT.....	2
<b>DRAINAGE BASINS AND SUBBASINS.....</b>	<b>2</b>
EXISTING MAJOR BASIN DESCRIPTIONS.....	2
EXISTING SUB-BASIN DRAINAGE.....	3
PROPOSED SUB-BASIN DRAINAGE.....	5
EXISTING MAJOR DRAINAGEWAY – SAND CREEK.....	6
<b>DRAINAGE DESIGN CRITERIA.....</b>	<b>7</b>
DEVELOPMENT CRITERIA REFERENCE.....	7
HYDROLOGIC CRITERIA.....	7
HYDRAULIC CRITERIA.....	7
<b>DRAINAGE FACILITY DESIGN.....</b>	<b>7</b>
GENERAL CONCEPT.....	7
SPECIFIC DETAILS.....	8
<i>Four Step Process to Minimize Adverse Impacts of Urbanization</i> .....	8
<i>Water Quality</i> .....	8
<i>Erosion Control Plan</i> .....	9
<i>Operation &amp; Maintenance</i> .....	9
<i>Drainage &amp; Bridge Fees</i> .....	9
<b>SUMMARY.....</b>	<b>10</b>
<b>REFERENCES:.....</b>	<b>11</b>

## APPENDICES

- A. Figures and Exhibits
- B. Hydrologic/Hydraulic Calculations
- C. Detention and Water Quality Calculations
- D. Reference Materials
- E. Drainage Maps



## PURPOSE

---

This document is the Preliminary Drainage report for the Solace Apartments. The purpose of this report is to:

1. Identify on-site and off-site drainage patterns.
2. Recommend storm water facilities to collect and convey storm runoff from the proposed development to appropriate discharge and/or detention locations.
3. Recommend water quality and detention facilities to control discharge release rates to below historic.
4. Demonstrate compliance with surrounding major drainage basin planning studies, master development drainage plans and flood insurance studies.

## GENERAL LOCATION AND DESCRIPTION

---

### Location

The proposed Solace Apartments, known as “Solace” from herein, is a parcel of land located in Section 7, Township 14 South, Range 65 West of the 6<sup>th</sup> Principal Meridian in El Paso County, Colorado. Solace is a 28.99 acre, urban, multifamily-development and is comprised of 16 apartment dwellings and associated infrastructure. Solace will be split into two phases for construction, lot 1 (phase 1) contains most of the site with lot 2 (phase 2) containing the northern most section of the development. See appendix A for a site plan exhibit showing the Solace phasing. Solace is bound by existing industrial developments to the North and vacant land to the West. Galley Road bounds the property to the south and existing light industrial businesses to the east. A vicinity map of the area is presented in Appendix A.

Currently, there is one major Drainageway that runs along Solace: Sand Creek (Center Tributary) Drainageway. This Drainageway was analyzed, both hydrologically and hydraulically, in the following reports:

- Sand Creek Drainage Basin Planning Study (KEC), January 1993.
- Flood Insurance Study– El Paso County, Colorado & Incorporated Areas Vol 7 of 8, December 2018.
- Sand Creek channel Improvement Design Report for Solace Apartments (JR), December 2019.
- LOMR- Case No. 05-08-0368P Federal Emergency Management Agency, May 23, 2007.

The impact of this Drainageway and planning studies on the proposed development will be discussed later in the report.

## Description of Property

Solace is currently unoccupied and undeveloped. The existing ground cover is sparse vegetation and open space, typical of a Colorado rolling range land condition. In general, Solace slopes from northwest to southeast.

Per an NRCS web soil survey of the area, Solace is made up of Type B soils with a very small percentage of Type A in the northwest corner of the property. This Type B soil is a Blendon sandy loam. This soil type has a moderate infiltration rate when thoroughly wet. It also consists of moderately deep or deep, moderately well drained or well drained soil. A soil survey map has been presented in Appendix A.

## Floodplain Statement

Based on the FEMA FIRM Maps number 08041C0751G and 08041C0752G, dated December 7, 2018, a portion of the existing drainage way lies within Zone AE and Zone X. Zone AE is defined as area subject to inundation by the 1-percent-annual-chance flood event. Zone X is defined as area outside the Special Flood Hazard Area (SFHA) and higher than the elevation of the 0.2-percent-annual-chance (or 500-year) flood. The FIRM Maps have been presented in Appendix A.

## DRAINAGE BASINS AND SUB-BASINS

---

### Existing Major Basin Descriptions

Solace lies within Sand Creek Drainage Basin based on the “*Sand Creek Drainage Basin Planning Study*” prepared by Kiowa Engineering in January 1993.

The Sand Creek Drainage Basin covers approximately 54 square miles in unincorporated El Paso County, CO. The Sand Creek Drainage Basin is tributary to Fountain Creek. In its existing condition, the basin is comprised of rolling rangeland with fair to good vegetative cover associated with Colorado’s semi-arid climate. The natural Drainage way within the site limits is typically deep and narrow with a well-defined flow path in most areas. Anticipated land use for the basin includes multifamily residential and open space.

As part of its drainage research, JR Engineering reviewed the following drainage studies, reports and LOMRs:

- Sand Creek Drainage Basin Planning Study prepared by Kiowa Engineering Corporation in January 1993.
- Flood Insurance Study– El Paso County, Colorado, & Incorporated Areas Vol 7, December 2018.
- LOMR- Case No. 05-08-0368P Federal Emergency Management Agency, May 23, 2007.
- Sand Creek channel Improvement Design Report for Solace Apartments (JR), December 2019

The *Sand Creek Drainage Basin Planning Study* was used to establish a stormwater management plan for the existing and future stormwater infrastructure needs within the Sand Creek Drainage Basin. Based on provided drainage maps and analysis, in its existing condition, the Sand Creek Drainageway contains a 100-year flow of 720-960 cfs along Solace's east property line. The major Sand Creek Drainageway conveys the stormwater south along the eastern property line where it ultimately outfalls into the Fountain Creek. JR Engineering has performed checks on these flow rates to verify their validity. Basin calculations show that the 720-960 cfs are still valid for this existing condition.

FEMA prepared a revised FIS for El Paso County Colorado, Volume 7 of 8, dated December 7, 2018. The effective floodplain for the site is shown on the FIRM 08041C0752G, revised to reflect LOMR, dated December 7, 2018. The study area of the FIS where the Sand Creek Drainageway crosses Galley Road, was found to overtop the culverts and flow onto the road. According to the FIS, this crossing has a 10% annual chance of flooding and is located in Zone AE of the FIRM. The *Sand Creek Drainage Basin LOMR* was executed on May 23, 2007. The LOMR revised the flood zone or the area south of Galley Road. See FIRM Map Panel 08041C0752G for limits of LOMR study and revised flood zones, presented in Appendix D.

## Existing Sub-basin Drainage

On-site, existing basin drainage patterns are generally from northwest to southeast by way of on-site swales. Existing on-site areas flow directly into the Sand Creek Drainageway. For this development, the existing onsite drainage has been broken into Basin A and Basin B. All existing basins that are offsite are represented by Basin OS. All basin delineation for the existing condition can be found in the existing drainage map located in Appendix E.

Basin A contains a total of 23.98 acres and is broken down into three sub-basins: A1, A2, and A3. This basin represents a majority of the proposed development and is comprised solely of undeveloped land. Flows from this basin are tributary to the Sand Creek Drainageway in the existing condition.

Sub-basin A1 ( $Q_5=3.1$  cfs,  $Q_{100}=21.0$  cfs) is 14.75 acres of undeveloped land, and represents the easternmost portion of the site that is adjacent to the Sand Creek Drainageway. Storm runoff from this sub-basin flows southeast, via overland flow, directly into the Sand Creek Drainageway at Design Point 1.

Sub-basin A2 ( $Q_5=0.9$  cfs,  $Q_{100}=6.2$  cfs) is 3.79 acres and represents the undeveloped land in the center of the development. Storm runoff from this sub-basin flows south (Design Point 2), via overland flow, directly onto Galley Road. From here, flows are conveyed east in the existing curb and gutter into the Sand Creek Drainageway.

Sub-basin A3 ( $Q_5=1.4$  cfs,  $Q_{100}=9.5$  cfs) is 5.44 Acres and represents the undeveloped land on the southern property line of the development. Storm runoff from this sub basin flows south (Design

Point 3), via overland flow, directly onto Galley Road. From here, flows are conveyed east via the existing curb and gutter to the Sand Creek Drainageway.

Sub-basin B1 ( $Q_5=1.3$  cfs,  $Q_{100}=9.0$  cfs) Sub-basin B1 consists of 4.84 acres of undeveloped land that drains overland to the southwest (Design Point 4) and offsite where it ultimately outfalls into an existing retention pond on the northeast corner of the intersection of Galley Road and Powers Blvd. This basin represents the westernmost portion of the site.

Basin OS consists of Sub-Basins OS1-OS2 combining for a total of 26.66 acres. This basin represents the developed land located to the north of the proposed development's property line, where the site ties in to Paonia Street. These sub-basins are primarily light industrial sites, and stormwater runoff is conveyed via overland flow and local roads.

Sub-basin OS1 ( $Q_5=36.7$  cfs,  $Q_{100}=73.1$  cfs) consists of the existing Paonia Street and the existing light industrial properties located just north of the site. In the existing condition, a portion of runoff from this sub-basin is captured by an existing concrete line channel. The remaining runoff flows onsite into the second drainageway where it ultimately outfalls into Sand Creek Center Tributary at Galley Road. In the proposed condition, the runoff will be captured by the existing concrete channel and a proposed overflow channel at the north property line (Design Point 4) to prevent any offsite flows from entering the property. Once this existing flow has been captured, the runoff will be conveyed directly into the existing Sand Creek Drainageway at Design Point 1.1. Capturing this flow and draining it directly into the Sand Creek Drainageway will cause a slight change in the existing drainage patterns. A portion of this flow will no longer enter the existing second drainageway along the proposed Paonia Street alignment. Instead, this entire flow will enter the Sand Creek Drainageway near the north property line at Design Point 1.1. In order to accommodate this change, rip rap shall be utilized to prevent channel erosion around the outfall location. The channel bottom shall also be widened to give the drainageway adequate capacity. A typical cross section of the channel can also be found on the drainage map in Appendix E. Channel analysis and weir calculations can be found in the *Sand Creek – Center Tributary Channel Analysis Report for Solace Apartments*, prepared by JR Engineering in May 2020.

Sub-basin OS2 ( $Q_5=21.3$  cfs,  $Q_{100}=42.5$  cfs) consists of the existing Ainsworth Street and the existing light industrial properties located just east of Ainsworth Street. Runoff from this sub-basin is captured by an existing swale along N. Powers Boulevard. The Solace Apartment site has a 5' berm that is proposed along the northern property line. This berm will prevent any drainage from this basin to reach the site, and will utilize an onsite conveyance swale located at the toe of the berm to convey flow west to Design Point 5 per historic conditions.

Flows within the Sand Creek Drainageway are represented by Design Points 1.0-1.3. Flows for these design points were taken directly from the *Sand Creek Drainage Basin Planning Study*. These flows were used in the development of the HEC-RAS model to show the 100-year capacity of the drainageway in the existing condition. 5-year storm data was not presented in these studies; however

Preliminary Drainage Report  
Solace Apartments

Be sure the flow matches what is indicated in the channel analysis. The channel analysis indicates 213 cfs

the analysis for the 5-year storm event will be completed with the final drainage report. Design Point 1.0 ( $Q_{100}=760$  cfs) represents the flows in the drainageway prior to entering the site boundary. Design Point 1.1 ( $Q_{100}=720$  cfs) represents the flow in the drainageway after the flows from Basin OS1 enter the channel. Design Point 1.2 ( $Q_{100}=960$  cfs) represents the area where flows enter the drainageway from developments and roads located to the east of the site. Design Point 1.3 ( $Q_{100}=1340$  cfs) represents the flows at the Galley Road crossing. This flow was used to analyze the overtopping of Galley Road and the existing weir structure on the south side of the road. Design Point 1.4 ( $Q_{100}=211$  cfs) represents the offsite flows entering the existing Paonia Street just north of the site. This flow will combine with flows from Basin OS1 where some of the flows will be captured by an existing concrete channel and the rest outfalls in the second creek located onsite. Lastly, design points 1.5 and 1.6 represent the split flows in this existing condition. In the proposed condition, flows from this Design Point will be diverted to an existing concrete channel and a proposed overflow channel located at the northeast property corner (Proposed Design Point 4) where it will outfall directly into Sand Creek.

Please see comment in the channel analysis report and revise accordingly.

## Proposed Sub-basin Drainage

The proposed Solace basin delineation is as follows;

Sub-basin A1 ( $Q_5=15.3$  cfs,  $Q_{100}=36.3$  cfs) contains a total of 9.13 acres. This basin represents the north eastern portion of the proposed development. This basin is primarily multi-family residential and minor open space. Stormwater runoff from this basin is conveyed via private streets, where it is captured via a series of on-grade and sump inlets. Runoff is then piped to a proposed onsite Pond A (Design Point 1). From the detention pond, the treated flows are then released directly into the Sand Creek Drainageway below historic rates at Design Point 1.2.

Basin B consists of Sub-Basins B1-B2 combining for a total of 18.52 acres. This basin represents the south western portion of the proposed development. This basin is primarily multifamily residential and minor open space, and stormwater runoff is conveyed via private streets. Runoff is captured via a series of on-grade and sump inlets. Runoff is then piped to a proposed onsite Pond B. From the detention pond, the treated flows are then released directly into the Sand Creek Drainageway at below historic rates.

Sub-basin B1 ( $Q_5=21.2$  cfs,  $Q_{100}=50.0$  cfs) consists of the western most portion of the development and the proposed Pond B. This basin is primarily multifamily residential and minor open space. Runoff from this sub-basin will be captured by the proposed storm sewer infrastructure, where it will outfall into the proposed Pond B at Design Point 2. Treated flows from Sub-basin B1 will then outfall into the Sand Creek Drainageway at Design Point 1.3.

Sub-basin B2 ( $Q_5=1.3$  cfs,  $Q_{100}=4.6$  cfs) consists of the southernmost portion of the development. This basin is primarily multifamily residential and minor open space. Runoff from this sub-basin will be captured by the proposed storm sewer infrastructure, where it will outfall into the proposed



Pond B at Design Point 3. Treated flows from Sub-basin B2 will then outfall into the Sand Creek Drainageway at Design Point 1.3 along with the treated flows from Sub-basin B1.

Sub-basin C1 ( $Q_5=0.6$  cfs,  $Q_{100}=1.9$  cfs) contains a total of 0.65 acres. This basin represents the southernmost portion of the proposed development. This basin is primarily proposed roadway and minor open space. Stormwater runoff from this basin is conveyed via proposed curb and gutter to a proposed crossspan (Design Point 7) at the intersection of Paonia Street and Galley Road. Runoff is then conveyed east by the existing curb and gutter in Galley Road to the Sand Creek Drainageway, per historic conditions.

design point 6 is shown on the drainage plan. Revise accordingly.

A summary table of proposed basin parameters and flow rates is presented in Appendix B. A more detailed breakdown of drainage basins, runoff calculations & Design Points will be provided in the final drainage report. The final report will also provide the design for the Full-Spectrum Detention/Water Quality Ponds required for the site.

See Table 3 below for the proposed pond parameters.

Table 3: Pond Summary

Tributary Sub-Basin	Pond Name	Tributary Acres	Comp. % Imperv.	WQ Volume (ac-ft)	Total Detention Volume (ac-ft)	Provided Volume (ac-ft)
A	POND A	9.13	44.5	0.146	0.786	2.453
B	POND B	17.84	42.9	0.279	1.496	4.465

#### Existing Major Drainageway – Sand Creek

The Sand Creek channel conveys an existing 720-960 cfs along the sites eastern property line. In order to maintain the drainage patterns on the site, 2 detention ponds have been proposed to release developed flows, at or below historic rates. Based on the results of the *Sand Creek – Center Tributary Channel Analysis Report for Solace Apartments*, prepared by JR Engineering in May 2020, the existing channel sections will need protection from erosion as a result of the Solace development. This report analyzed the existing conditions to ensure that the Sand Creek channel is stable and velocities do not exceed allowable limits. Based on the results of this report, it was found that the channel in its current conditions is inadequate, as velocities in the channel exceeded allowable limits and overtopping occurs at the Galley Road. The report recommended several improvements to ensure channel stability, including channel lining such as riprap to protect from the high velocities, widening the channel to increase capacity and decrease velocity & adding check/ drop structures to reduce velocities. The report also indicates that improvements will be necessary to address the overtopping at the Galley Road crossing. An existing overflow structure is currently in place to convey any overtopping flows, but does not have adequate capacity. Further discussion with the county engineer about potential solutions and timelines will be necessary. Channel hydraulic analysis sheets are

presented in Appendix B of the aforementioned report. A drainage map for the Solace site can be found in Appendix E.

## DRAINAGE DESIGN CRITERIA

---

### Development Criteria Reference

Storm drainage analysis and design criteria for the project were taken from the “*City of Colorado Spring/El Paso County Drainage Criteria Manual*” Volumes 1 and 2 (EPCDCM), dated October 12, 1994, the “*Urban Storm Drainage Criteria Manual*” Volumes 1 - 3 (USDCM) and Chapter 6 and Section 3.2.1 of Chapter 13 of the “*Colorado Springs Drainage Criteria Manual (CCSDCM)*”, dated May 2014, as adopted by El Paso County.

### Hydrologic Criteria

All hydrologic data was obtained from the “*El Paso Drainage Criteria Manual*” Volumes 1 and 2, and the “*Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual*” Volumes 1, 2, and 3. Onsite drainage improvements were designed based on the 5 year (minor) storm event and the 100-year (major) storm event. Rational Method calculations were prepared, in accordance with Chapter 6, Section 3.0 of the EPCDCM, for the sub-basins that directly impact the sizing of the proposed storm sewer outfalls. Rational method calculations are presented in Appendix B.

Mile High Flood District’s MHFD-Detention, Version 4.00 workbook was used for pond sizing. Required detention volumes and allowable release rates were designed per USDCM and CCS/EPCDCM. Pond sizing spreadsheets are presented in Appendix C.

### Hydraulic Criteria

GeoHECRAS was used as the primary analysis method for the site in the *Sand Creek – Center Tributary Channel Analysis Report for Solace Apartments*. GeoHECRAS was used to model existing flows within the Sand Creek Drainageway. This model was used to verify flood plains and analyze any overtopping that may occur within the project site. The 100-year water surface profiles for the model were analyzed from the north property line of the site to the area just south of the Galley Road Crossing.

## DRAINAGE FACILITY DESIGN

---

### General Concept

The proposed stormwater conveyance system was designed to convey the developed Solace runoff to two proposed full spectrum water quality and detention ponds via private storm sewer. The proposed ponds were designed to release at less than historic rates to minimize adverse impacts downstream. Treated water will outfall directly into the Sand Creek Drainageway, where it will eventually outfall into Fountain Creek. The current site will be constructed in 2 phases. Both of the proposed ponds will be designed and constructed with the Phase 1 improvements along with the storm sewer within

Your response to the previous review comment regarding the potential backflow effect indicates that the pond bottoms are at a higher elevation than the channel bottom and that if necessary backflow devices can be installed once final design is completed. Please include these statements in your narrative.

Paonia Street. A proposed drainage map is presented in Appendix E showing locations of the pond and channel outfall locations and improvements.

## Specific Details

### ***Four Step Process to Minimize Adverse Impacts of Urbanization***

In accordance with the El Paso County Drainage Criteria Manual Volume 2, this site has implemented the four step process to minimize adverse impacts of urbanization. The four step process includes reducing runoff volumes, stabilizing drainageways, treating the water quality capture volume (WQCV), and consider the need for Industrial Commercial BMP's.

**Step 1, Reducing Runoff Volumes:** The development of the project site is a proposed multifamily development with open spaces and lawn areas interspersed within the development which helps disconnect impervious areas and reduce runoff volumes.

**Step 2, Stabilize Drainageways:** Solace utilizes private storm sewer throughout the project site. This private storm sewer directs the on-site development flows to the multiple detention ponds within the project that release at or below historic rates into the Sand Creek Drainageway. Sand Creek (Center Tributary) Drainageway is stabilized downstream of the development, however additional stabilization measures shall be implemented to prevent any negative impacts to the drainageway. Drop structures will be added in order to reduce the slope of the channel, and riprap will be utilized to prevent any erosion. An energy dissipation structure will be utilized for the offsite flows from Sub-basin OS1 (Design Point 4) to reduce flow velocities prior to entering the channel. A detail for the proposed energy dissipation structure can be found in Appendix D. The proposed reduction in released flows compared to the pre-developed flows, will also prevent any negative impacts to developments downstream.

**Step 3, Provide WQCV:** Runoff from this development is treated through capture and slow release of the WQCV in multiple full spectrum water quality and detention ponds that are designed per current El Paso County drainage criteria for Extended Detention Basins (EDB). These ponds will facilitate pollutant removal for the site, while also reducing peak stormwater rates into the Sand Creek Drainageway.

**Step 4, Consider the need for Industrial and Commercial BMP's:** No industrial or commercial uses are proposed within this development. However, a site specific storm water quality and erosion control plan and narrative will be prepared in conjunction with the final drainage report. Site specific temporary source control BMPs as well as permanent BMP's will be detailed in this plan and narrative to protect receiving waters.

### ***Water Quality***

In accordance with Section 13.3.2.1 of the CCS/EPCDCM, full spectrum water quality and detention are provided for all developed basins. Outlet structure release rates shall be limited to less than

historic rates to minimize adverse impacts to downstream stormwater facilities. Complete pond and outlet structure designs shall be completed with the final drainage report.

***Erosion Control Plan***

The El Paso County Drainage Criteria Manual specifies an Erosion Control Plan and associated cost estimate must be submitted with each Final Drainage Report. The Erosion Control Plan for Solace will be submitted once the preliminary phase for Solace is complete.

***Operation & Maintenance***

In order to ensure the function and effectiveness of the stormwater infrastructure, maintenance activities such as inspection, routine maintenance, restorative maintenance, rehabilitation and repair, are required. All proposed drainage structures within the any platted County ROW will be owned and maintained by El Paso County. All proposed drainage structures within the property or tracts will be owned and maintained by the property owner. Vegetation in the natural and improved portions of Sand Creek Drainageway is the responsibility of El Paso County. This includes all mowing, seeding and weed control activities. An Inspection & Maintenance Plan will be submitted concurrently with the final drainage report that details the required maintenance activities and intervals to ensure proper function of all stormwater infrastructure in the future. The full spectrum detention ponds will be owned & maintained by the property owner.

***Drainage & Bridge Fees***

The site lies within the Sand Creek Drainage Basin. A conceptual estimate is presented below, exact fees to be determined at time of final plat.

2020 DRAINAGE AND BRIDGE FEES – Solace Apartments				
Impervious Acres (ac)	Drainage Fee (Per Imp. Acre)	Bridge Fee (Per Imp. Acre)	Solace Drainage Fee	Solace Bridge Fee
12.26	\$19,698	\$8,057	\$241,498	\$98,779

The Solace development will receive full credit for any channel improvements indicated in the Sand Creek DBPS. From the *Sand Creek (Center Tributary) Channel Analysis*, by JR Engineering, the preliminary estimated channel improvements will cost \$554,950. Per the Sand Creek Drainage Basin Planning Study, the Center Tributary has proposed crossing improvements at Terminal Avenue and Omaha Boulevard. Both of these crossing were estimated to be \$72,000. Crossing improvements were also proposed at W. Frontage Road for \$106,200, US 24 Bypass for \$211,500, E. Frontage Road for \$84,600, Bijou Street for \$84,600, Platte Avenue for \$169,200, & Galley Road for \$90,000. These estimates provide costs for the storm sewer required to replace the existing infrastructure at these locations. The Galley Road crossing estimate reflects upsizing the existing culverts to 5’x 8’ concrete box structures. These estimates can be found in Appendix D. Based on these estimated costs, it is presumed that no drainage basin fees will be necessary.

## SUMMARY

---

The proposed development remains consistent with pre-development drainage conditions with the construction of the recommended drainage improvements, including storm sewer, detention ponds and existing drainageways. The proposed development will not adversely affect the offsite major Drainageways or surrounding development. In order to safely convey flows through the Sand Creek Drainageway, channel improvements will be necessary to ensure channel stability and prevent channel degradation. Riprap will be required to armor the channel and stabilize the slopes during a major storm event. These improvements will ensure the drainageway functions properly as a primary drainage conveyance system for the Solace Apartments. These improvements to the Sand Creek Drainageway will be implemented with the final drainage report. This preliminary report meets the latest El Paso County Drainage Criteria requirements for this site.

## REFERENCES:


---

1. El Paso County Drainage Criteria Manual Volume 1, El Paso County, CO, 1994.
2. Urban Storm Drainage Criteria Manual, Urban Drainage and Flood Control District, Latest Revision.
3. Flood Insurance Study- El Paso County, Colorado & Incorporated Areas Vol 7 of 8, Federal Emergency Management Agency, December 7, 2018.
4. Sand Creek Drainage Basin Planning Study, Kiowa Engineering, January 1993.
5. Sand Creek Drainage Basin LOMR, Federal Emergency Management Agency, May 23, 2007.
6. Sand Creek - Center Tributary Channel Analysis Report for Solace Apartments, JR Engineering, May, 2020

**APPENDIX A**

**FIGURES AND EXHIBITS**

X:\2510000.all\2517400\Drawings\Blocks\Vicinity Map - Drainage.dwg, 8.5x11 Portrait, 12/17/2019 11:14:34 AM, PhillipsJ

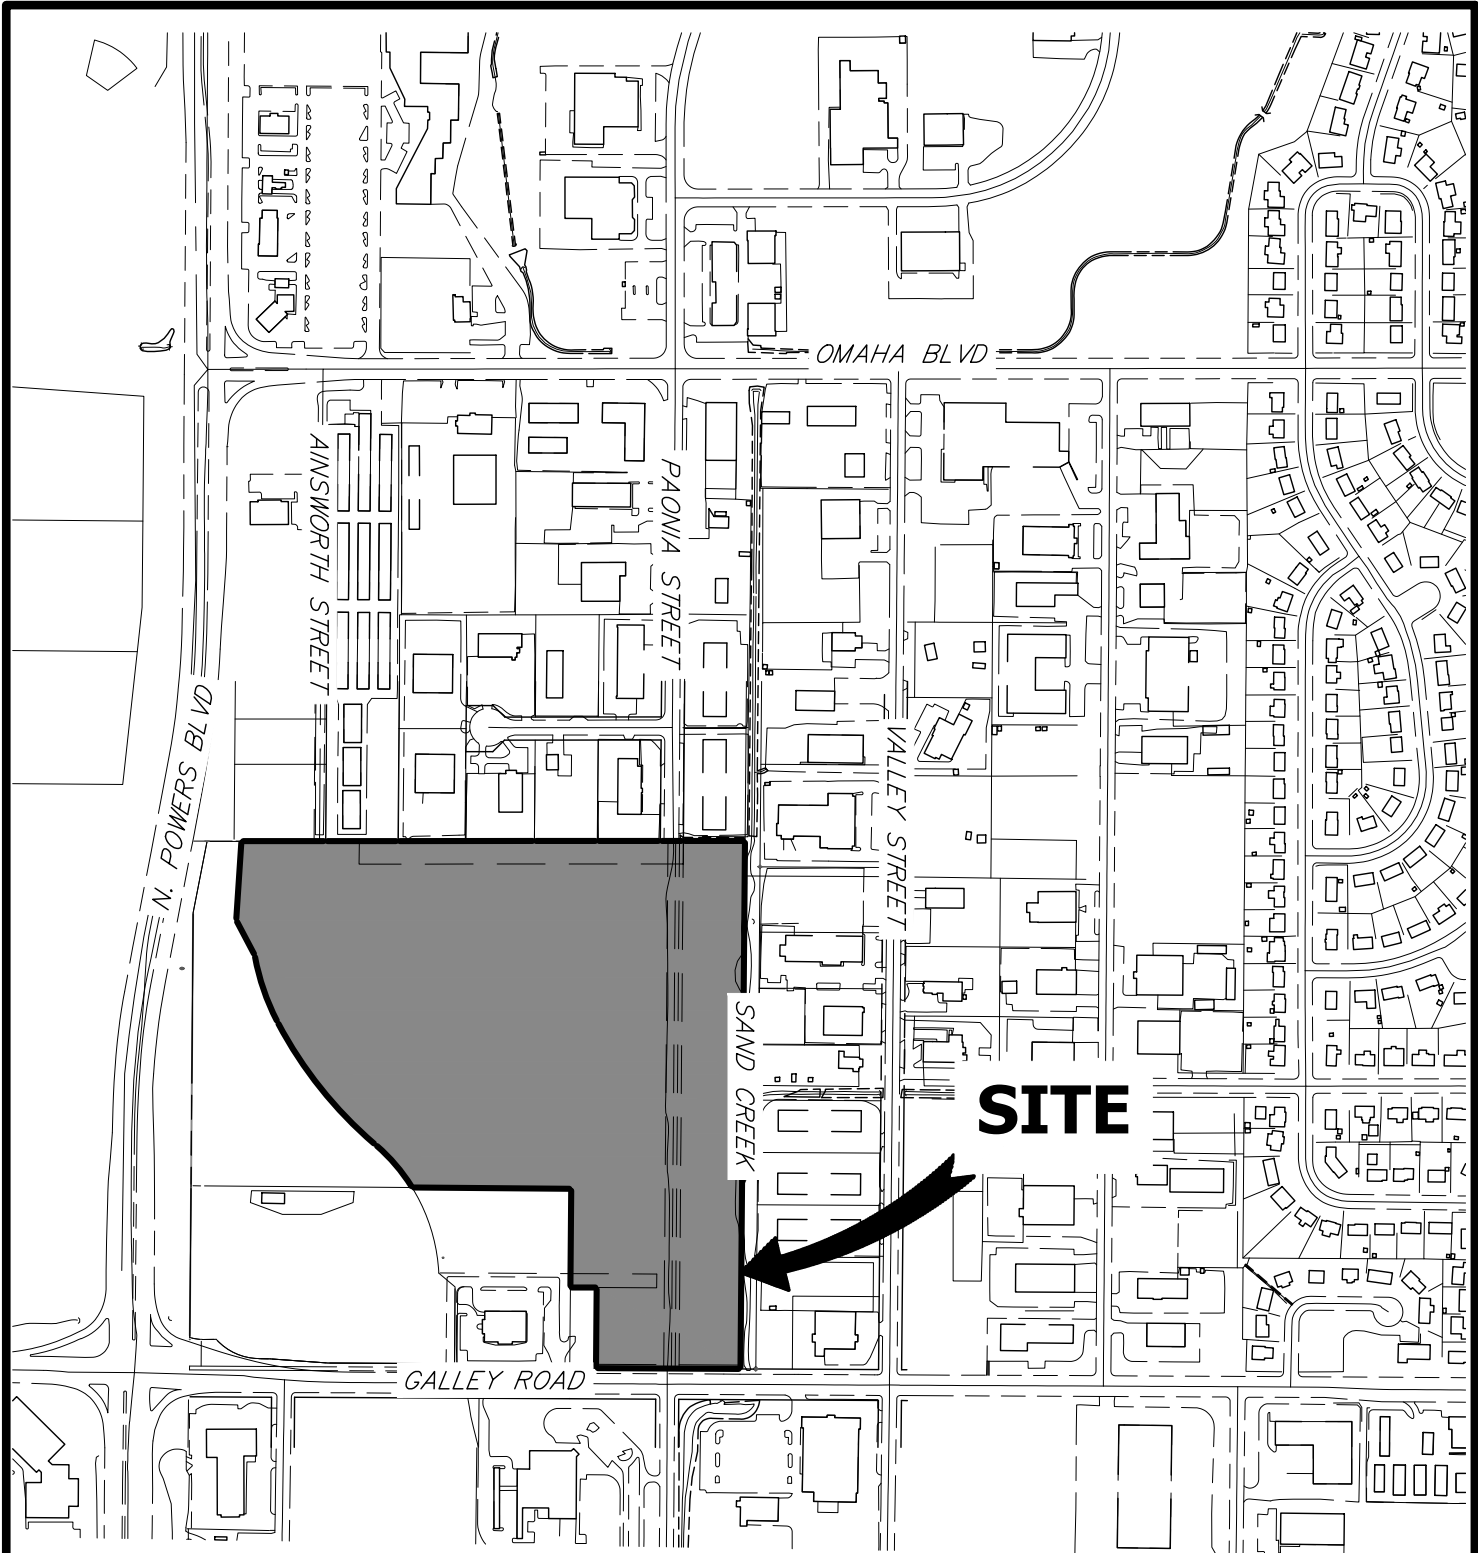

**SITE**



ORIGINAL SCALE: 1" = 500'


VICINITY MAP  
 SOLACE APARTMENTS  
 JOB NO. 15504.03  
 4/27/2018




Centennial 303-740-9393 • Colorado Springs 719-593-2593  
 Fort Collins 970-491-9888 • www.jrengineering.com



Hydrologic Soil Group—El Paso County Area, Colorado

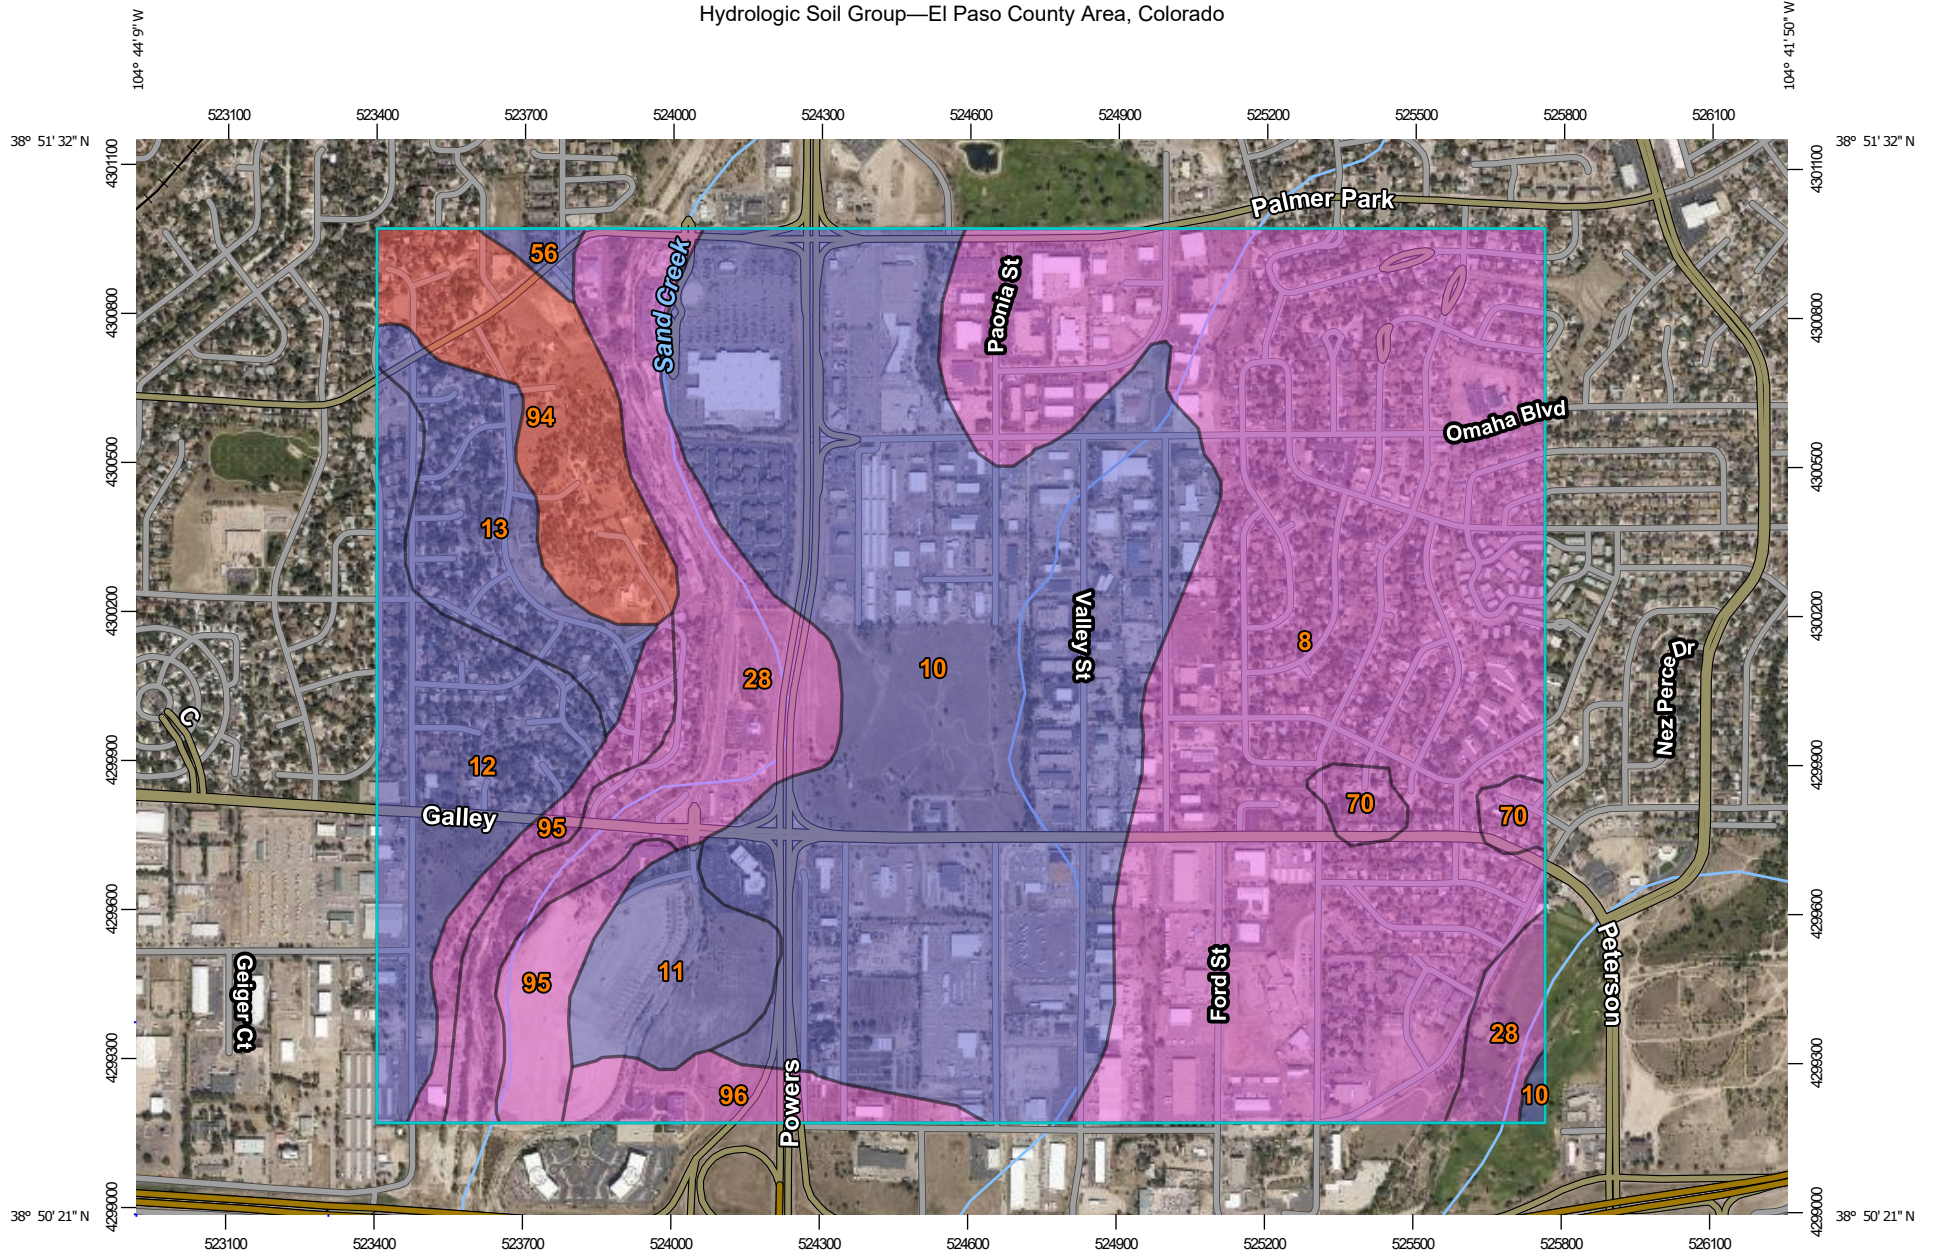

Map Scale: 1:15,300 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84



### MAP LEGEND

**Area of Interest (AOI)**









 Area of Interest (AOI)

**Soils**

**Soil Rating Polygons**





-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

**Soil Rating Lines**

-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

**Soil Rating Points**



-  A
-  A/D
-  B
-  B/D

-  C
-  C/D
-  D
-  Not rated or not available


**Water Features**

 Streams and Canals

**Transportation**

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

**Background**

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 17, Sep 13, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 19, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	A	373.7	35.4%
10	Blendon sandy loam, 0 to 3 percent slopes	B	321.4	30.5%
11	Bresser sandy loam, cool, 0 to 3 percent slopes	B	31.9	3.0%
12	Bresser sandy loam, cool, 3 to 5 percent slopes	B	69.8	6.6%
13	Bresser sandy loam, cool, 5 to 9 percent slopes	B	41.4	3.9%
28	Ellicott loamy coarse sand, 0 to 5 percent slopes	A	96.1	9.1%
56	Nelson-Tassel fine sandy loams, 3 to 18 percent slopes	B	3.7	0.3%
70	Pits, gravel	A	10.3	1.0%
94	Travessilla-Rock outcrop complex, 8 to 90 percent slopes	D	51.5	4.9%
95	Truckton loamy sand, 1 to 9 percent slopes	A	35.7	3.4%
96	Truckton sandy loam, 0 to 3 percent slopes	A	19.7	1.9%
<b>Totals for Area of Interest</b>			<b>1,055.2</b>	<b>100.0%</b>

## Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.


## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Higher

S  
P  
R  
I  
N  
G  
S  
  
E  
D

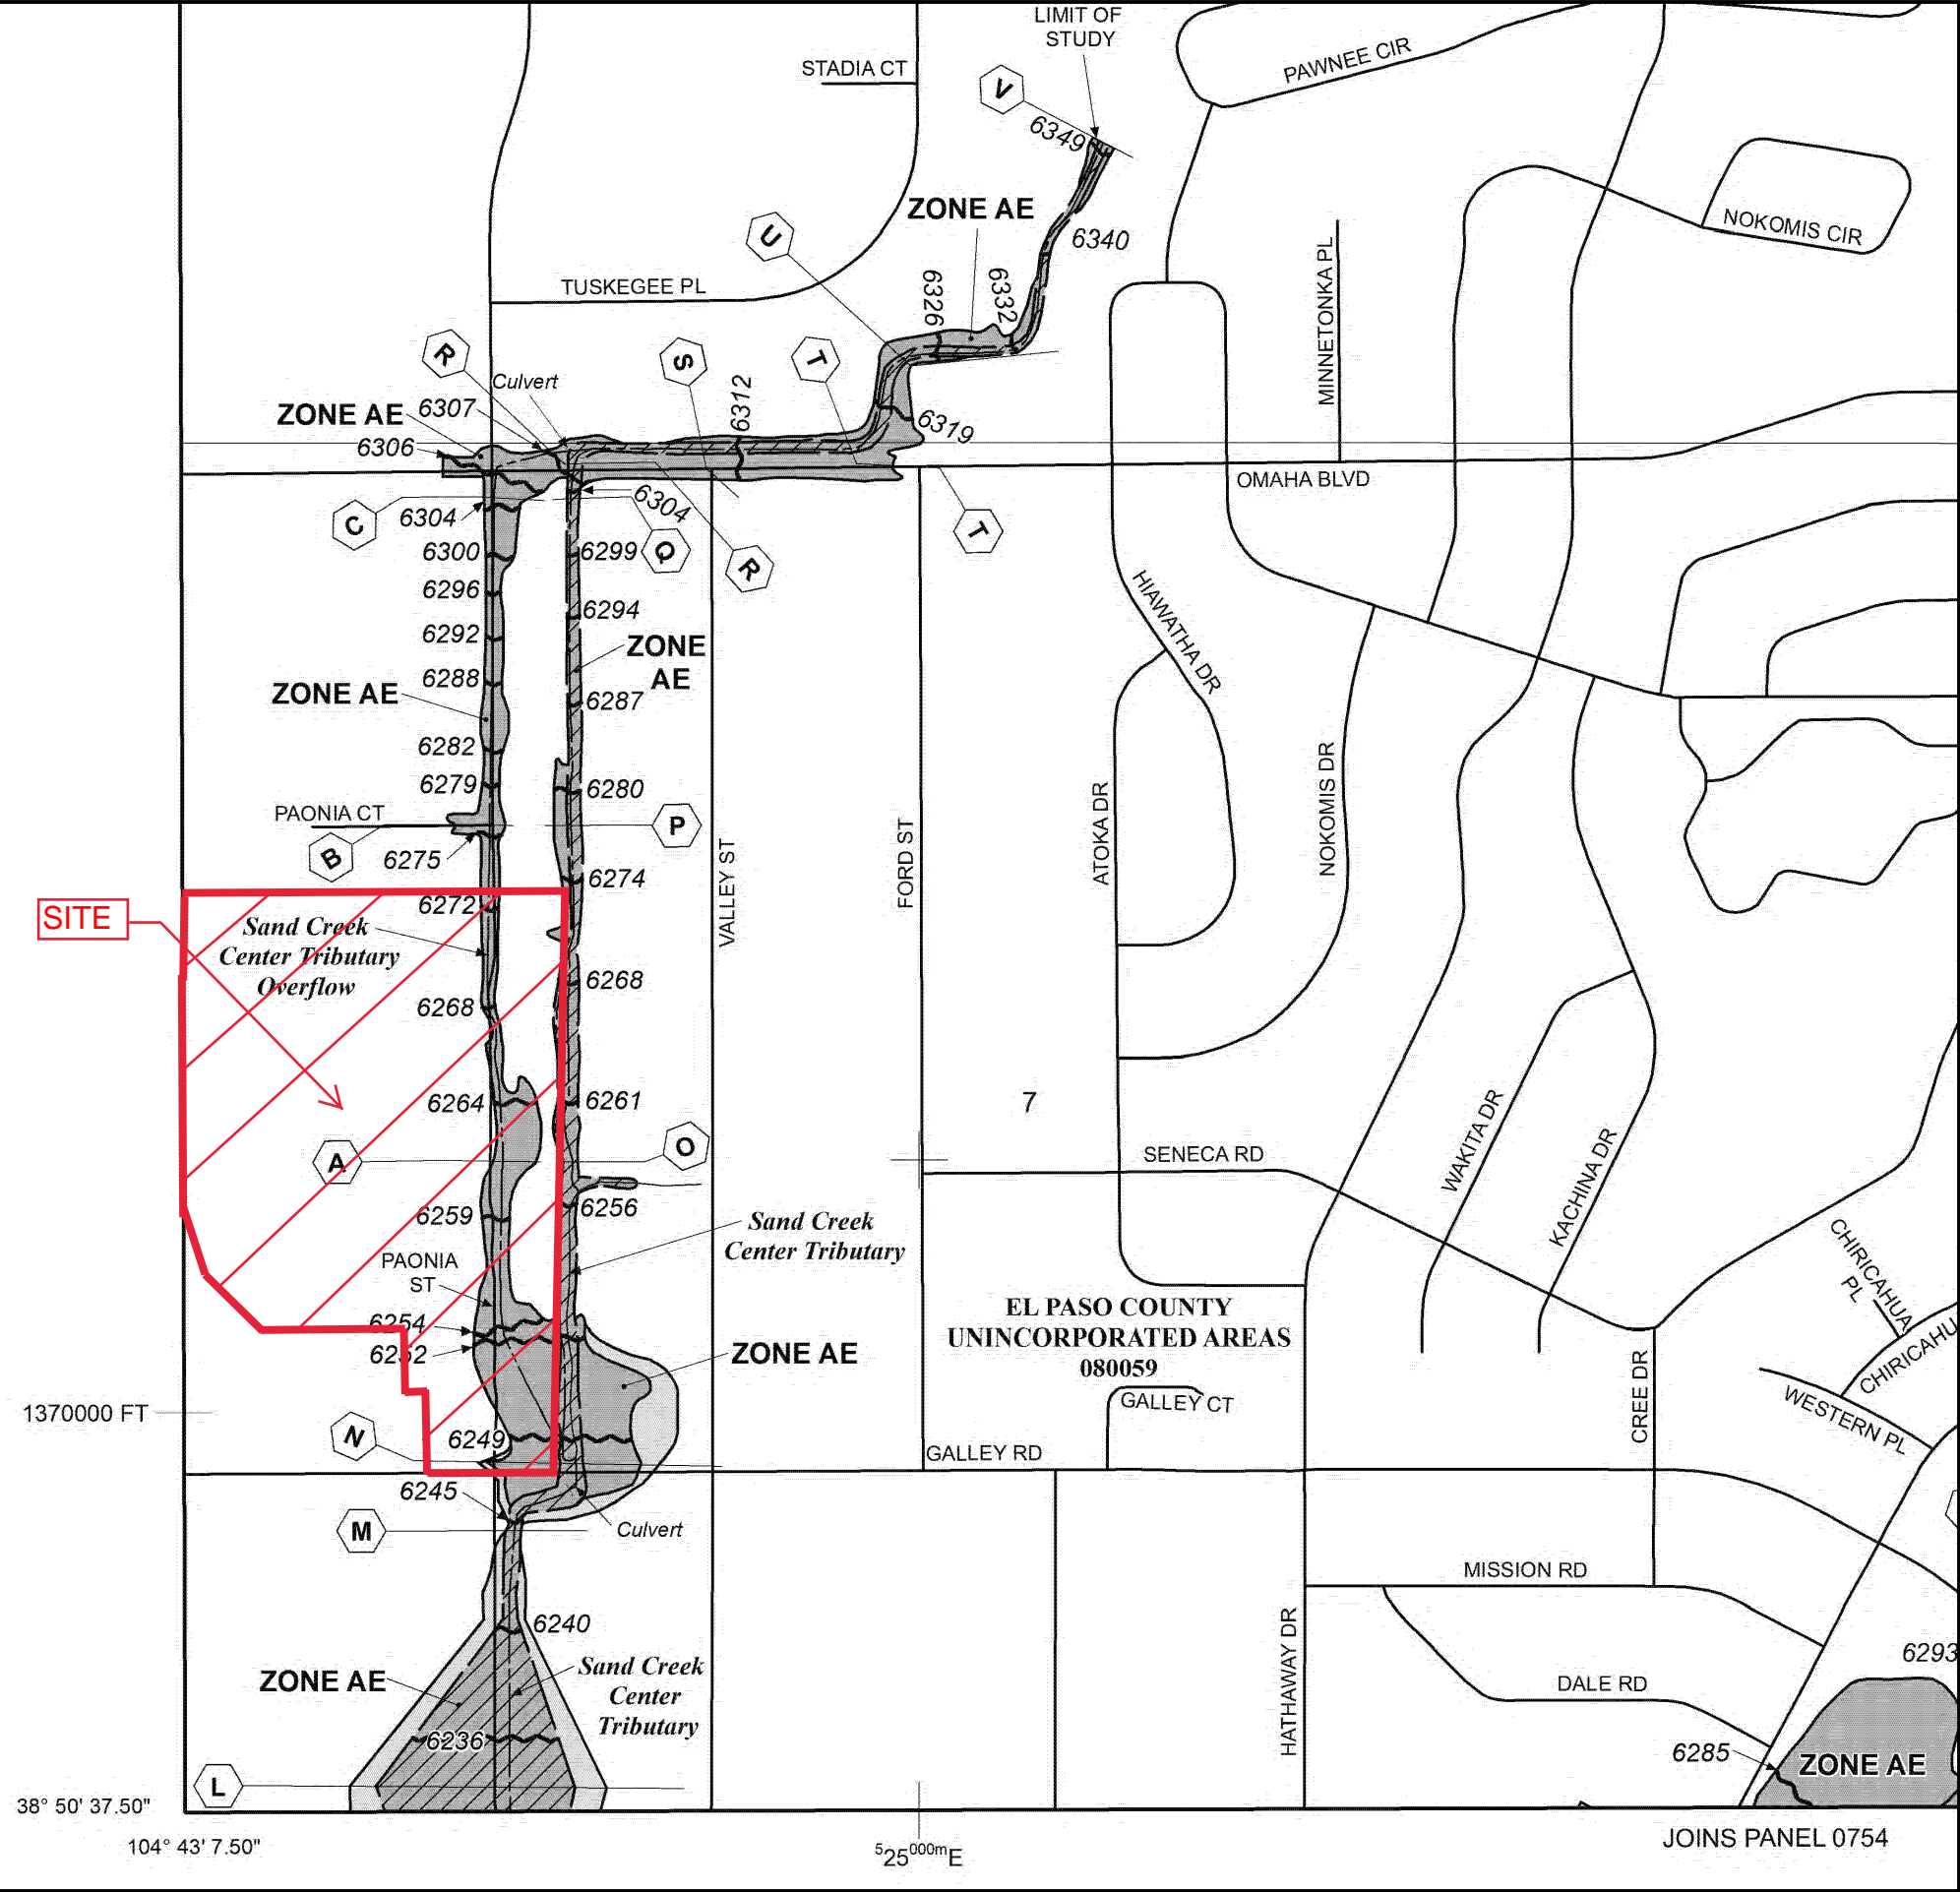

1370000 FT

38° 50' 37.50"

104° 43' 7.50"

5'25"000m E

JOINS PANEL 0754



MAP SCALE 1" = 500'



PANEL 0752G

**FIRM**  
**FLOOD INSURANCE RATE MAP**  
**EL PASO COUNTY,**  
**COLORADO**  
**AND INCORPORATED AREAS**

**PANEL 752 OF 1300**  
 (SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	080060	0752	G
EL PASO COUNTY	080059	0752	G

Notice to User: The Map Number shown below should be used when placing map orders; the Community Number shown above should be used on insurance applications for the subject community.



**MAP NUMBER**  
**08041C0752G**

**MAP REVISED**  
**DECEMBER 7, 2018**

Federal Emergency Management Agency

This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at [www.msc.fema.gov](http://www.msc.fema.gov)

**NOTES TO USERS**

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

**Coastal Base Flood Elevations** shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services  
 NOAA, NINGS12  
 National Geodetic Survey  
 SSMC-3, #9202  
 1315 East-West Highway  
 Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

**Base Map** information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

**Corporate limits** shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.


Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FIMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp>.

**El Paso County Vertical Datum Offset Table**

Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


**Panel Location Map**

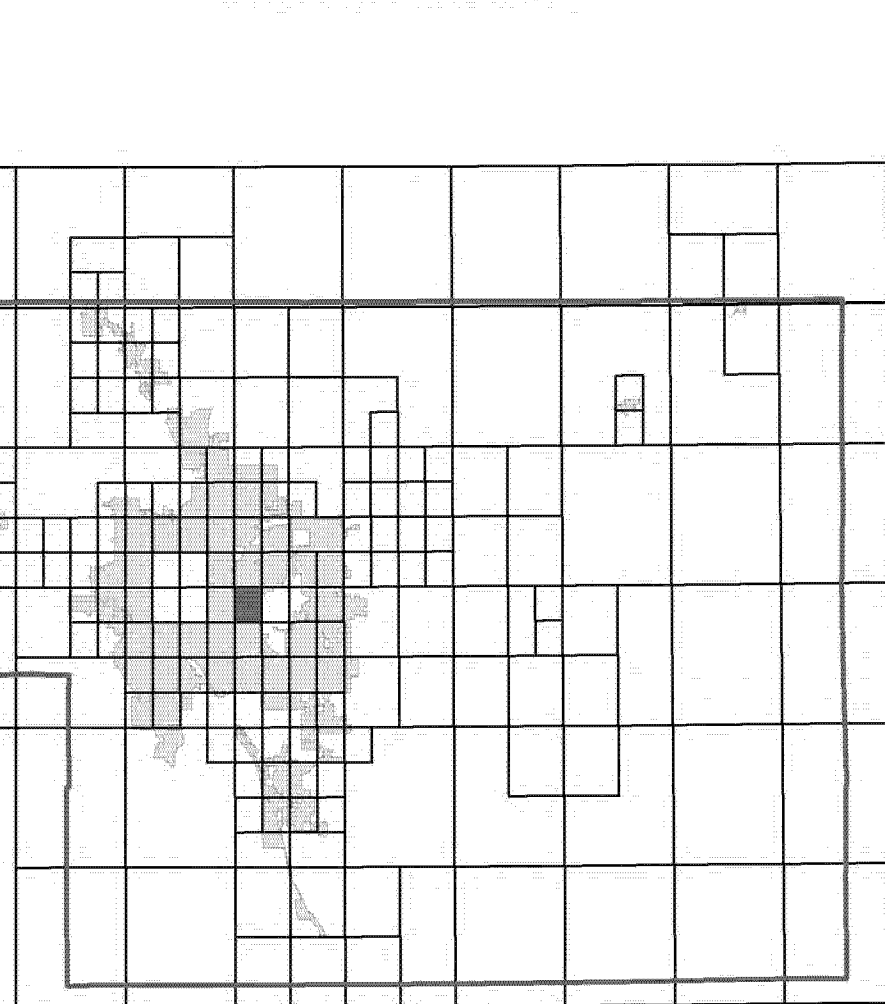

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).



Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

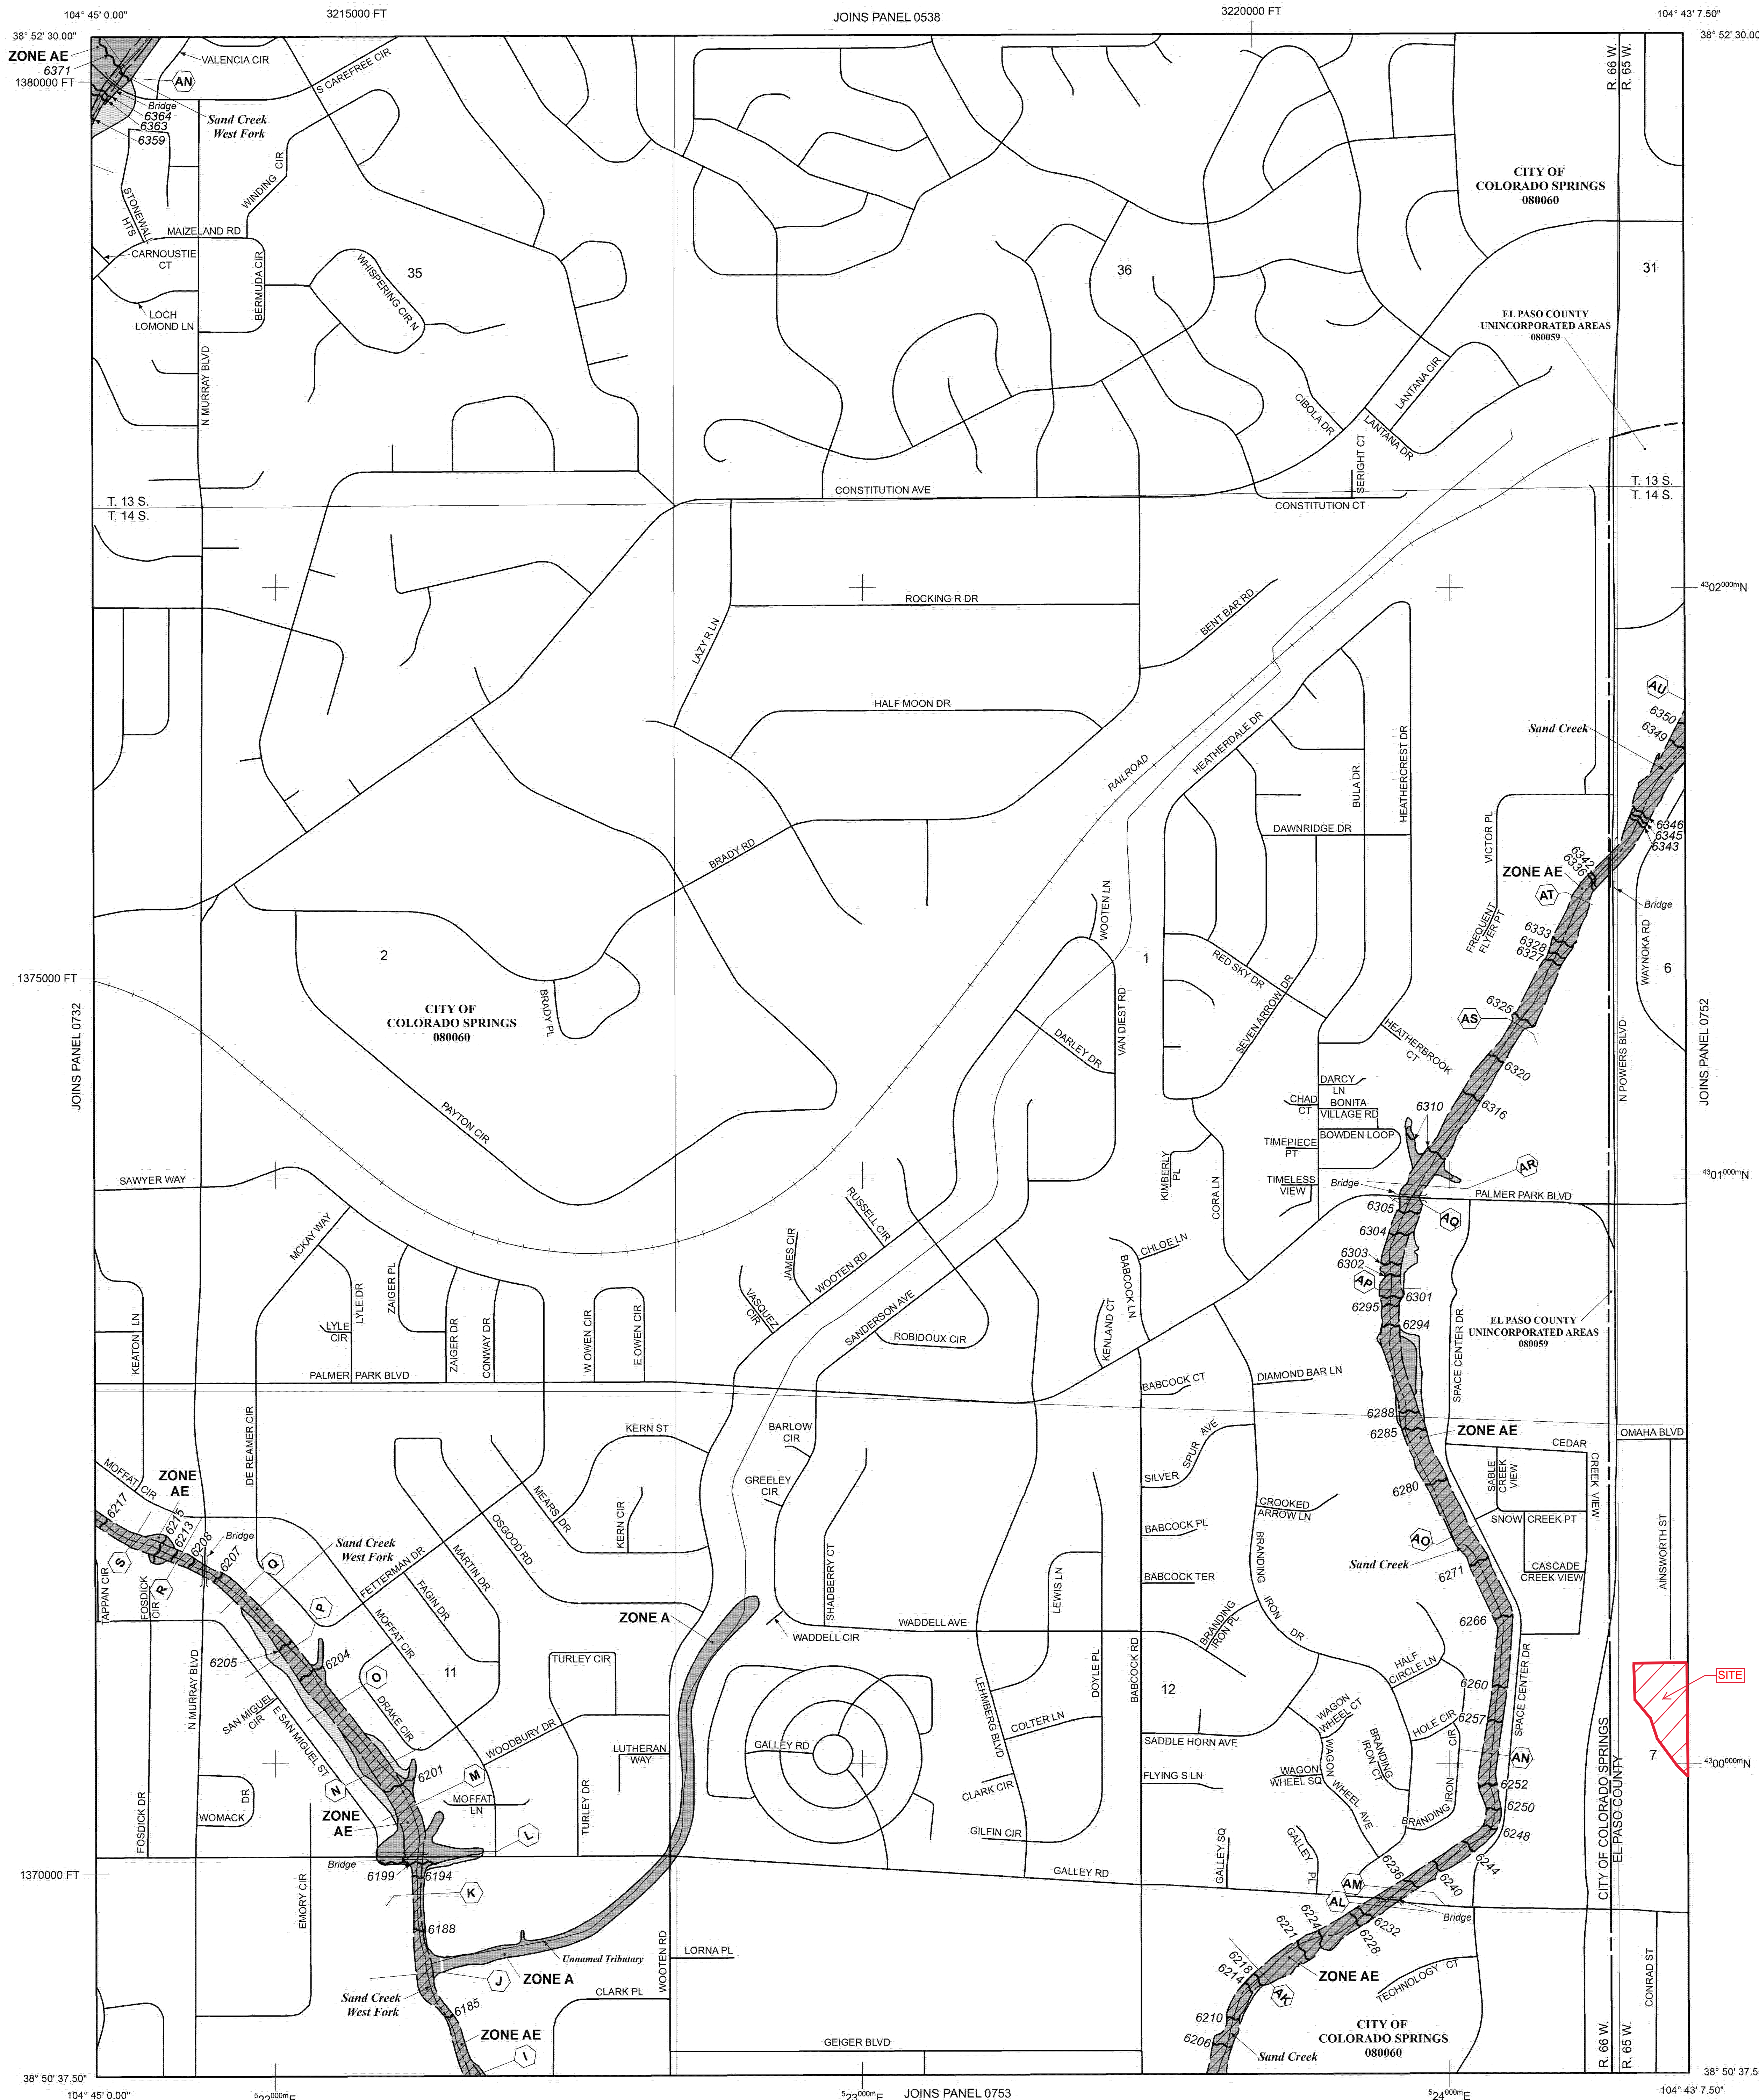

**LEGEND**

**SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD**

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equalled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently decommissioned. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

**FLOODWAY AREAS IN ZONE AE**

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

**OTHER FLOOD AREAS**

**ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot, or with drainage areas less than 1 square mile, and areas protected by levees from 1% annual chance flood.

**OTHER AREAS**

**ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.

**ZONE D** Areas in which flood hazards are undetermined, but possible.

**COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS**

**OTHERWISE PROTECTED AREAS (OPAs)**

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- Floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary

Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.

513 Base Flood Elevation line and value; elevation in feet\* (EL 987)

Base Flood Elevation value where uniform within zone; elevation in feet\* (EL 987)

\* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

A-A Cross section line

23-23 Transsect line

97° 07' 30.00" 32° 22' 30.00" Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)

4750000N 1000-meter Universal Transverse Mercator grid ticks, zone 13

6000000 FT 5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 0902), Lambert Conformal Conic Projection

DX5510 Bench mark (see explanation in Notes to Users section of this FIRM panel)

M1.5 River Mile

MAP REPOSITORIES Refer to Map Repositories list on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP MARCH 17, 1997

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL DECEMBER 7, 2018 - to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

MAP SCALE 1" = 500'

250 0 500 1000 FEET

150 0 150 300 METERS

**NFP** PANEL 0751G

**FIRM**  
**FLOOD INSURANCE RATE MAP**  
**EL PASO COUNTY, COLORADO AND INCORPORATED AREAS**

PANEL 751 OF 1300  
 (SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	08060	0751	G
EL PASO COUNTY	08059	0751	G

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.

**MAP NUMBER 08041C0751G**

**MAP REVISED DECEMBER 7, 2018**

**Federal Emergency Management Agency**

**APPENDIX B**

**HYDROLOGIC/ HYDRAULIC CALCULATIONS**

## COMPOSITE % IMPERVIOUS & COMPOSITE RUNOFF COEFFICIENT CALCULATIONS

Subdivision: Solace (Existing Condition)  
 Location: El Paso County

Project Name: Solace Apartments  
 Project No.: 25174.00  
 Calculated By: JBP  
 Checked By: \_\_\_\_\_  
 Date: 6/29/20

Basin ID	Total Area (ac)	Streets (100% Impervious)				Roofs (90% Impervious)				Light Industrial (80% Impervious)				Undeveloped (2% Impervious)				Basins Total Weighted C		Basins Total Weighted % Imp.
		C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	
A1	14.75	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.59	0.70	0.00	0.0%	0.09	0.36	14.75	2.0%	0.09	0.36	2.0%
A2	3.79	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.59	0.70	0.00	0.0%	0.09	0.36	3.79	2.0%	0.09	0.36	2.0%
A3	5.44	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.59	0.70	0.00	0.0%	0.09	0.36	5.44	2.0%	0.09	0.36	2.0%
B1	4.84	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.59	0.70	0.00	0.0%	0.09	0.36	4.84	2.0%	0.09	0.36	2.0%
OS1	17.73	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.59	0.70	17.73	80.0%	0.09	0.36	0.00	2.0%	0.59	0.70	80.0%
OS2	8.93	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.73	0.81	8.93	90.0%	0.09	0.36	0.00	2.0%	0.73	0.81	90.0%
TOTAL (A1-B1)	28.82																			2.0%
TOTAL (OS1-OS3)	26.66																			83.3%
TOTAL	55.48																			41.1%



## STANDARD FORM SF-2 TIME OF CONCENTRATION

Subdivision: Solace (Existing Condition)  
Location: El Paso County

Project Name: Solace Apartments  
Project No.: 25174.00  
Calculated By: JBP  
Checked By:  
Date: 6/29/20

SUB-BASIN DATA						INITIAL/OVERLAND (T <sub>i</sub> )			TRAVEL TIME (T <sub>t</sub> )					t <sub>c</sub> CHECK (URBANIZED BASINS)			FINAL	
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C <sub>5</sub>	C <sub>100</sub>	L (ft)	S <sub>o</sub> (%)	t <sub>i</sub> (min)	L <sub>t</sub> (ft)	S <sub>t</sub> (%)	K	VEL. (ft/s)	t <sub>t</sub> (min)	COMP. t <sub>c</sub> (min)	TOTAL LENGTH (ft)	Urbanized t <sub>c</sub> (min)	t <sub>c</sub> (min)	
A1	14.75	B	2%	0.09	0.36	100	2.4%	13.7	1119	2.0%	7.0	1.0	18.8	32.5	1219.0	39.9	32.5	
A2	3.79	B	2%	0.09	0.36	100	2.0%	14.5	611	1.8%	7.0	0.9	10.8	25.4	711.0	33.8	25.4	
A3	5.44	B	2%	0.09	0.36	100	1.8%	15.0	444	1.9%	7.0	1.0	7.7	22.7	544.0	31.4	22.7	
B1	4.84	B	2%	0.09	0.36	100	3.0%	12.7	351	1.2%	7.0	0.8	7.6	20.3	451.0	31.4	20.3	
OS1	17.73	B	80%	0.59	0.70	100	1.9%	7.5	1236	1.8%	20.0	2.7	7.7	15.1	1336.0	20.0	15.1	
OS2	8.93	B	90%	0.73	0.81	100	2.1%	5.2	415	1.9%	15.0	2.1	3.3	8.6	515.0	13.0	8.6	

**NOTES:**

$$t_c = t_i + t_t$$

Where:

t<sub>c</sub> = computed time of concentration (minutes)

t<sub>i</sub> = overland (initial) flow time (minutes)

t<sub>t</sub> = channelized flow time (minutes).

$$t_t = \frac{L_t}{60K\sqrt{S_o}} = \frac{L_t}{60V_t}$$

Where:

t<sub>t</sub> = channelized flow time (travel time, min)

L<sub>t</sub> = waterway length (ft)

S<sub>o</sub> = waterway slope (ft/ft)

V<sub>t</sub> = travel time velocity (ft/sec) = K√S<sub>o</sub>

K = NRCS conveyance factor (see Table 6-2).

Equation 6-2

$$t_i = \frac{0.395(1.1 - C_2)\sqrt{L_i}}{S_o^{0.333}}$$

Where:

t<sub>i</sub> = overland (initial) flow time (minutes)

C<sub>2</sub> = runoff coefficient for 5-year frequency (from Table 6-4)

L<sub>i</sub> = length of overland flow (ft)

S<sub>o</sub> = average slope along the overland flow path (ft/ft).

Equation 6-4

$$t_t = (26 - 17i) + \frac{L_t}{60(14i + 9)\sqrt{S_t}}$$

Where:

t<sub>t</sub> = minimum time of concentration for first design point when less than t<sub>c</sub> from Equation 6-1.

L<sub>t</sub> = length of channelized flow path (ft)

i = imperviousness (expressed as a decimal)

S<sub>t</sub> = slope of the channelized flow path (ft/ft).

Equation 6-3

**Table 6-2. NRCS Conveyance factors, K**

Type of Land Surface	Conveyance Factor, K
Heavy meadow	2.5
Tillage/field	5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

Equation 6-5

Use a minimum t<sub>c</sub> value of 5 minutes for urbanized areas and a minimum t<sub>c</sub> value of 10 minutes for areas that are not considered urban. Use minimum values even when calculations result in a lesser time of concentration.

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

Subdivision: Solace (Existing Condition)  
Location: El Paso County  
Design Storm: 5-Year

Project Name: Solace Apartments  
Project No.: 25174.00  
Calculated By: JBP  
Checked By:  
Date: 6/29/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE				TRAVEL TIME			REMARKS	
		Basin ID	Area (Ac)	Runoff Coeff.	t <sub>c</sub> (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t <sub>c</sub> (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q <sub>street/swale</sub> (cfs)	C*A (ac)	Slope (%)	Q <sub>pipe</sub> (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t <sub>t</sub> (min)		
	1	A1	14.75	0.09	32.5	1.33	2.36	3.1					3.1	1.33	0.7									Surface runoff from existing basin A1, Surface flow into Sand Creek Drainageway at DP 1
	2	A2	3.79	0.09	25.4	0.34	2.73	0.9					0.9	0.34	2.0									Surface runoff from Basin A2 Surface flow offsite to the south at DP 2
	3	A3	5.44	0.09	22.7	0.49	2.90	1.4					1.4	0.49	2.5									Surface runoff from Basin A3 Surface flow offsite to the south at DP 3
	4	B1	4.84	0.09	20.3	0.44	3.07	1.3					1.3	0.44	1.0									Surface runoff from Basin B1 Surface flow offsite to the southwest at DP 4
	5	OS1	17.73	0.59	15.1	10.46	3.51	36.7					36.7	10.46	1.78					200	2.0	1.7	Surface runoff from Basin OS1, captured by existing concrete channel at DP 5 Channel conveyance to Sand Creek at DP 1.1	
	6	OS2	8.93	0.73	8.6	6.52	4.36	28.4					28.4	6.52	3.2					147	2.7	0.9	Surface runoff from Basin OS2 diverted to swale west of site at DP 6	
	1.0	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.	
	1.1	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.	
	1.2	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.	
	1.3	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.	
	1.4	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the LOMR for Sand Creek Center Tributary.	
	1.5	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.	
	1.6	-	-	-	-	-	-	-															5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.	

Notes:  
Street and Pipe C\*A values are determined by Q/i using the catchment's intensity value.  
All pipes are private and RCP unless otherwise noted. Pipe size shown in table column.

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

Subdivision: Solace (Existing Condition)  
Location: El Paso County  
Design Storm: 100-Year

Project Name: Solace Apartments  
Project No.: 25174.00  
Calculated By: JBP  
Checked By:  
Date: 6/29/20

Description	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE				TRAVEL TIME			REMARKS	
		Basin ID	Area (ac)	Runoff Coeff.	t <sub>c</sub> (min)	C*A (ac)	I (in/hr)	Q (cfs)	t <sub>c</sub> (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q <sub>street/swale</sub> (cfs)	C*A (ac)	Slope (%)	Q <sub>pipe</sub> (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t <sub>t</sub> (min)		
	1	A1	14.75	0.36	32.5	5.31	3.96	21.0					21.0	5.31	0.7									Surface runoff from existing basin A1, Surface flow into Sand Creek Drainageway at DP 1
	2	A2	3.79	0.36	25.4	1.36	4.59	6.2					6.2	1.36	2.0									Surface runoff from Basin A2 Surface flow offsite to the south at DP 2
	3	A3	5.44	0.36	22.7	1.96	4.87	9.5					9.5	1.96	2.5									Surface runoff from Basin A3 Surface flow offsite to the south at DP 3
	4	B1	4.84	0.36	20.3	1.74	5.15	9.0					9.0	1.74	1.0									Surface runoff from Basin B1 Surface flow offsite to the southwest at DP 4
	5	OS1	17.73	0.70	15.1	12.41	5.89	73.1				286.1	286.1		1.78					200	2.0	1.7		Surface runoff from Basin OS1 & DP 1.4, captured by existing concrete channel at DP 5 Street conveyance to DP 5, flow split to DP 1.5 & DP 1.6
	6	OS2	8.93	0.81	8.6	7.23	7.32	52.9				52.9	52.9	7.23	3.2					147	2.7	0.9		Surface runoff from Basin OS2 diverted to swale west of site at DP 6
	1.0	-	-	-	-	-	-	760.0				760.0	760.0											Flow taken directly from the Sand Creek Drainage Basin Planning Study
	1.1	-	-	-	-	-	-	720.0				720.0	720.0											Flow taken directly from the Sand Creek Drainage Basin Planning Study
	1.2	-	-	-	-	-	-	960.0				960.0	960.0											Flow taken directly from the Sand Creek Drainage Basin Planning Study
	1.3	-	-	-	-	-	-	1340.0				1340.0	1340.0											Flow taken directly from the Sand Creek Drainage Basin Planning Study
	1.4	-	-	-	-	-	-	213.0				213.0	213.0											Flow taken directly from the LOMR for Sand Creek Center Tributary Street conveyance to DP 5
	1.5											244.0	244.0											Second Draiangeway Channel conveyance to Sand Creek at DP 1
	1.6											42.1	42.1											Existing Concrete Channel Channel conveyance to Sand Creek at DP 1.1

Notes:  
Street and Pipe C\*A values are determined by Q/i using the catchment's intensity value.  
All pipes are private and RCP unless otherwise noted. Pipe size shown in table column.

## COMPOSITE % IMPERVIOUS & COMPOSITE RUNOFF COEFFICIENT CALCULATIONS

Subdivision: Solace  
 Location: El Paso County

Project Name: Solace Apartments  
 Project No.: 25174.00  
 Calculated By: JBP  
 Checked By: \_\_\_\_\_  
 Date: 6/26/20

Basin ID	Total Area (ac)	Streets (100% Impervious)				Roofs (90% Impervious)				Light Industrial (80% Impervious)				Lawns (0% Impervious)				Basins Total Weighted C		Basins Total Weighted % Imp.
		C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	Weighted % Imp.	C <sub>5</sub>	C <sub>100</sub>	
A1	9.13	0.90	0.96	2.61	28.6%	0.73	0.81	1.61	15.9%	0.59	0.70	0.00	0.0%	0.08	0.35	4.91	0.0%	0.43	0.61	44.5%
B1	16.23	0.90	0.96	3.66	22.6%	0.73	0.81	4.13	22.9%	0.59	0.70	0.00	0.0%	0.08	0.35	8.44	0.0%	0.43	0.60	45.5%
B2	1.61	0.90	0.96	0.27	16.8%	0.73	0.81	0.00	0.0%	0.59	0.70	0.00	0.0%	0.08	0.35	1.34	0.0%	0.22	0.45	16.8%
C1	0.65	0.90	0.96	0.13	20.0%	0.73	0.81	0.00	0.0%	0.59	0.70	0.00	0.0%	0.08	0.35	0.52	0.0%	0.24	0.47	20.0%
OS1	17.73	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.59	0.70	17.73	80.0%	0.08	0.35	0.00	0.0%	0.59	0.70	80.0%
OS2	8.93	0.90	0.96	0.00	0.0%	0.73	0.81	0.00	0.0%	0.73	0.81	8.93	90.0%	0.08	0.35	0.00	0.0%	0.73	0.81	90.0%
TOTAL (A1-C1)	27.62																			42.9%
TOTAL (OS1-OS2)	26.66																			83.3%
TOTAL	54.28																			62.7%

## STANDARD FORM SF-2 TIME OF CONCENTRATION

Subdivision: Solace \_\_\_\_\_  
Location: El Paso County \_\_\_\_\_

Project Name: Solace Apartments \_\_\_\_\_  
Project No.: 25174.00 \_\_\_\_\_  
Calculated By: JBP \_\_\_\_\_  
Checked By: \_\_\_\_\_  
Date: 6/26/20 \_\_\_\_\_

SUB-BASIN DATA						INITIAL/OVERLAND (Ti)			TRAVEL TIME (Ti)					tc CHECK (URBANIZED BASINS)			FINAL	
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C <sub>5</sub>	C <sub>100</sub>	L (ft)	S <sub>o</sub> (%)	t <sub>i</sub> (min)	L <sub>t</sub> (ft)	S <sub>t</sub> (%)	K	VEL. (ft/s)	t <sub>t</sub> (min)	COMP. t <sub>c</sub> (min)	TOTAL LENGTH (ft)	Urbanized t <sub>c</sub> (min)	t <sub>c</sub> (min)	
A1	9.13	B	44%	0.43	0.61	100	4.9%	7.2	689	1.7%	20.0	2.6	4.4	11.6	789.0	24.2	11.6	
B1	16.23	B	45%	0.43	0.60	100	4.4%	7.4	1592	1.0%	20.0	2.0	13.3	20.7	1692.0	35.5	20.7	
B2	1.61	B	17%	0.22	0.45	100	3.3%	10.8	273	1.0%	20.0	2.0	2.3	13.0	373.0	27.2	13.0	
C1	0.65	B	20%	0.24	0.47	100	1.8%	12.8	114	1.0%	20.0	2.0	1.0	13.8	214.0	24.2	13.8	
OS1	17.73	B	80%	0.59	0.70	100	1.9%	7.5	1236	1.8%	20.0	2.7	7.7	15.1	1336.0	20.0	15.1	
OS2	8.93	B	90%	0.73	0.81	100	2.1%	5.2	415	1.9%	15.0	2.1	3.3	8.6	515.0	13.0	8.6	

**NOTES:**

$$t_c = t_i + t_t$$

Where:  
*t<sub>c</sub>* = computed time of concentration (minutes)  
*t<sub>i</sub>* = overland (initial) flow time (minutes)  
*t<sub>t</sub>* = channelized flow time (minutes).

$$t_t = \frac{L_t}{60K\sqrt{S_o}} = \frac{L_t}{60V_t}$$

Where:  
*t<sub>t</sub>* = channelized flow time (travel time, min)  
*L<sub>t</sub>* = waterway length (ft)  
*S<sub>o</sub>* = waterway slope (ft/ft)  
*V<sub>t</sub>* = travel time velocity (ft/sec) = K√*S<sub>o</sub>*  
*K* = NRCS conveyance factor (see Table 6-2).

Equation 6-2 
$$t_i = \frac{0.395(1.1 - C_2)\sqrt{L_i}}{S_o^{0.33}}$$

Where:  
*t<sub>i</sub>* = overland (initial) flow time (minutes)  
*C<sub>2</sub>* = runoff coefficient for 5-year frequency (from Table 6-4)  
*L<sub>i</sub>* = length of overland flow (ft)  
*S<sub>o</sub>* = average slope along the overland flow path (ft/ft).

Equation 6-4 
$$t_t = (26 - 17i) + \frac{L_t}{60(14i + 9)\sqrt{S_t}}$$

Where:  
*t<sub>t</sub>* = minimum time of concentration for first design point when less than *t<sub>c</sub>* from Equation 6-1.  
*L<sub>t</sub>* = length of channelized flow path (ft)  
*i* = imperviousness (expressed as a decimal)  
*S<sub>t</sub>* = slope of the channelized flow path (ft/ft).

Equation 6-3

Equation 6-5

Type of Land Surface	Conveyance Factor, K
Heavy meadow	2.5
Tillage/field	5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

Use a minimum *t<sub>c</sub>* value of 5 minutes for urbanized areas and a minimum *t<sub>c</sub>* value of 10 minutes for areas that are not considered urban. Use minimum values even when calculations result in a lesser time of concentration.

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN**  
**(RATIONAL METHOD PROCEDURE)**

ubdivision: Solace \_\_\_\_\_  
 Location: El Paso County \_\_\_\_\_  
 sign Storm: 5-Year \_\_\_\_\_

Project Name: Solace Apartments \_\_\_\_\_  
 Project No.: 25174.00 \_\_\_\_\_  
 Calculated By: JBP \_\_\_\_\_  
 Checked By: \_\_\_\_\_  
 Date: 6/26/20 \_\_\_\_\_

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	t <sub>c</sub> (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t <sub>c</sub> (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q <sub>street/swale</sub> (cfs)	C*A (ac)	Slope (%)	Q <sub>pipe</sub> (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	
	1	A1	9.13	0.43	11.6	3.92	3.91	15.3							15.3	3.92	0.5	48	20	5.8	0.1	Surface runoff from Basin A1, transported by Storm Infrastructure to North Detention Pond at DP 1
	2	B1	16.23	0.43	20.7	6.98	3.04	21.2							21.2	6.98	0.5	42	17	6.5	0.0	Surface runoff from Basin B1, transported by Storm Infrastructure to South Detention Pond at DP 2
	3	B2	1.61	0.22	13.0	0.35	3.73	1.3							1.3	0.35	1.0	18	17	4.0	0.1	Surface runoff from Basin B2, transported by Storm Infrastructure to South Detention Pond at DP 3
	4	OS1	17.73	0.59	15.1	10.46	3.51	36.7							36.7	10.46	1.0	36	225	9.7	0.4	Surface runoff from Basin OS1, captured by existing concrete channel and proposed overflow channel at DP 4 Channel conveyance to Sand Creek at DP 1.1
	5	OS2	8.93	0.73	8.6	6.52	4.36	28.4				28.4	6.52	3.2					147	2.7	0.9	Surface runoff from Basin OS2 diverted to swale west of site at DP 5
	6	C1	0.65	0.24	13.8	0.16	3.65	0.6				0.6	0.16	0.53					202	1.5	2.3	Surface runoff from Basin C1 Captured by proposed concrete pan at DP 6 and conveyed west along Galley Road per historic condition.
	1.0	-	-	-	-	-	-	-														5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.
	1.1	-	-	-	-	-	-	-														5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.
	1.2	-	-	-	-	-	-	-														5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.
	1.3	-	-	-	-	-	-	-														5-Year Flows were not analyzed as part of the Sand Creek Drainage Basin Planning Study.
	1.4	-	-	-	-	-	-	-														5-Year Flows were not analyzed as part of the LOMR for Sand Creek Center Tributary.

Notes:  
 Street and Pipe C\*A values are determined by Q/I using the catchment's intensity value.  
 All pipes are private and RCP unless otherwise noted. Pipe size shown in table column.

STANDARD FORM SF-3  
STORM DRAINAGE SYSTEM DESIGN  
(RATIONAL METHOD PROCEDURE)

Subdivision: Solace  
Location: El Paso County  
Design Storm: 100-Year

Project Name: Solace Apartments  
Project No.: 25174.00  
Calculated By: JBP  
Checked By:  
Date: 6/26/20

Description	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t <sub>c</sub> (min)	C*A (ac)	I (in/hr)	Q (cfs)	t <sub>c</sub> (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q <sub>street/swale</sub> (cfs)	C*A (ac)	Slope (%)	Q <sub>pipe</sub> (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t <sub>c</sub> (min)	
	1	A1	9.13	0.61	11.6	5.53	6.56	36.3							36.3	5.53	0.5	48	20	7.4	0.0	Surface runoff from Basin A1, transported by Storm Infrastructure to North Detention Pond at DP 1	
	2	B1	16.23	0.60	20.7	9.81	5.10	50.0							50.0	9.81	0.5	42	17	8.0	0.0	Surface runoff from Basin B1, transported by Storm Infrastructure to South Detention Pond at DP 2	
	3	B2	1.61	0.45	13.0	0.73	6.27	4.6							4.6	0.73	1.0	18	17	5.7	0.1	Surface runoff from Basin B2, transported by Storm Infrastructure to South Detention Pond at DP 3	
	4	OS1	17.73	0.70	15.1	12.41	5.89	73.1			286.1	286.1	1.78						200	2.0	1.7	Surface runoff from Basin OS1 & DP 1.4, captured by existing concrete channel and proposed overflow channel at DP 4 Channel conveyance to Sand Creek at DP 1.1	
	5	OS2	8.93	0.81	8.6	7.23	7.32	52.9				52.9	7.23	3.2					147	2.7	0.9	Surface runoff from Basin OS2 diverted to swale west of site at DP 5	
	6	C1	0.65	0.47	13.8	0.31	6.12	1.9				1.9	0.31	0.53					202	1.5	2.3	Surface runoff from Basin C1 Captured by proposed concrete pan at DP 6 and conveyed west along Galley Road per historic condition.	
	1.0	-	-	-	-	-	-	760.0				760.0										Flow taken directly from the Sand Creek Drainage Basin Planning Study	
	1.1	-	-	-	-	-	-	720.0				720.0										Flow taken directly from the Sand Creek Drainage Basin Planning Study	
	1.2	-	-	-	-	-	-	960.0				960.0										Flow taken directly from the Sand Creek Drainage Basin Planning Study	
	1.3	-	-	-	-	-	-	1340.0				1340.0										Flow taken directly from the Sand Creek Drainage Basin Planning Study	
	1.4	-	-	-	-	-	-	213.0				213.0										Flow taken directly from the LOMR for Sand Creek Center Tributary Channel conveyance to Sand Creek at DP 4	

Notes:  
Street and Pipe C\*A values are determined by Q/i using the catchment's intensity value.  
All pipes are private and RCP unless otherwise noted. Pipe size shown in table column.

**APPENDIX C**

**WATER QUALITY AND DETENTION CALCULATIONS**




# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-*Detention, Version 4.00 (December 2019)*

Project: Solace Apartments

Basin ID: Pond A



### Watershed Information

Selected BMP Type =	EDB
Watershed Area =	9.13 acres
Watershed Length =	800 ft
Watershed Length to Centroid =	350 ft
Watershed Slope =	0.020 ft/ft
Watershed Imperviousness =	44.50% percent
Percentage Hydrologic Soil Group A =	1.0% percent
Percentage Hydrologic Soil Group B =	99.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQC Drain Time =	40.0 hours
Location for 1-hr Rainfall Depths =	User Input

After providing required inputs above including 1-hour rainfall depths, click "Run CUHP" to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Water Quality Capture Volume (WOCV) =			Optional User Overrides		
WOCV =	0.146	acre-feet			
Excess Urban Runoff Volume (EURV) =	0.431	acre-feet			
2-yr Runoff Volume (P1 = 1.19 in.) =	0.402	acre-feet	1.19	inches	
5-yr Runoff Volume (P1 = 1.5 in.) =	0.588	acre-feet	1.50	inches	
10-yr Runoff Volume (P1 = 1.75 in.) =	0.752	acre-feet	1.75	inches	
25-yr Runoff Volume (P1 = 2 in.) =	0.984	acre-feet	2.00	inches	
50-yr Runoff Volume (P1 = 2.25 in.) =	1.166	acre-feet	2.25	inches	
100-yr Runoff Volume (P1 = 2.52 in.) =	1.402	acre-feet	2.52	inches	
500-yr Runoff Volume (P1 = 3.14 in.) =	1.873	acre-feet			
Approximate 2-yr Detention Volume =	0.320	acre-feet			
Approximate 5-yr Detention Volume =	0.443	acre-feet			
Approximate 10-yr Detention Volume =	0.598	acre-feet			
Approximate 25-yr Detention Volume =	0.662	acre-feet			
Approximate 50-yr Detention Volume =	0.694	acre-feet			
Approximate 100-yr Detention Volume =	0.786	acre-feet			



### Define Zones and Basin Geometry

Zone 1 Volume (WOCV) =	0.146	acre-feet
Zone 2 Volume (EURV - Zone 1) =	0.285	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.355	acre-feet
Total Detention Basin Volume =	0.786	acre-feet
Initial Surcharge Volume (ISV) =	user	ft <sup>3</sup>
Initial Surcharge Depth (ISD) =	user	ft
Total Available Detention Depth (H <sub>total</sub> ) =	user	ft
Depth of Trickle Channel (H <sub>TC</sub> ) =	user	ft
Slope of Trickle Channel (S <sub>TC</sub> ) =	user	ft/ft
Slopes of Main Basin Sides (S <sub>main</sub> ) =	user	H:V
Basin Length-to-Width Ratio (R <sub>L/W</sub> ) =	user	
Initial Surcharge Area (A <sub>ISV</sub> ) =	user	ft <sup>2</sup>
Surcharge Volume Length (L <sub>ISV</sub> ) =	user	ft
Surcharge Volume Width (W <sub>ISV</sub> ) =	user	ft
Depth of Basin Floor (H <sub>FLOOR</sub> ) =	user	ft
Length of Basin Floor (L <sub>FLOOR</sub> ) =	user	ft
Width of Basin Floor (W <sub>FLOOR</sub> ) =	user	ft
Area of Basin Floor (A <sub>FLOOR</sub> ) =	user	ft <sup>2</sup>
Volume of Basin Floor (V <sub>FLOOR</sub> ) =	user	ft <sup>3</sup>
Depth of Main Basin (H <sub>MAIN</sub> ) =	user	ft
Length of Main Basin (L <sub>MAIN</sub> ) =	user	ft
Width of Main Basin (W <sub>MAIN</sub> ) =	user	ft
Area of Main Basin (A <sub>MAIN</sub> ) =	user	ft <sup>2</sup>
Volume of Main Basin (V <sub>MAIN</sub> ) =	user	ft <sup>3</sup>
Calculated Total Basin Volume (V <sub>total</sub> ) =	USER	acre-feet

Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft <sup>2</sup> )	Optional Override Area (ft <sup>2</sup> )	Area (acre)	Volume (ft <sup>3</sup> )	Volume (ac-ft)
Top of Micropool	--	0.00	--	--	--	3,416	0.078		
ELEV: 6254.00	--	1.00	--	--	--	7,602	0.175	5,509	0.126
ELEV: 6255.00	--	2.00	--	--	--	11,378	0.261	14,999	0.344
ELEV: 6256.00	--	3.00	--	--	--	14,249	0.327	27,812	0.638
ELEV: 6257.00	--	4.00	--	--	--	16,917	0.388	43,395	0.996
ELEV: 6258.00	--	5.00	--	--	--	19,685	0.452	61,696	1.416
ELEV: 6259.00	--	6.00	--	--	--	22,554	0.518	82,816	1.901
ELEV: 6260.00	--	7.00	--	--	--	25,523	0.586	106,854	2.453

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

*MHFD-Detention, Version 4.00 (December 2019)*

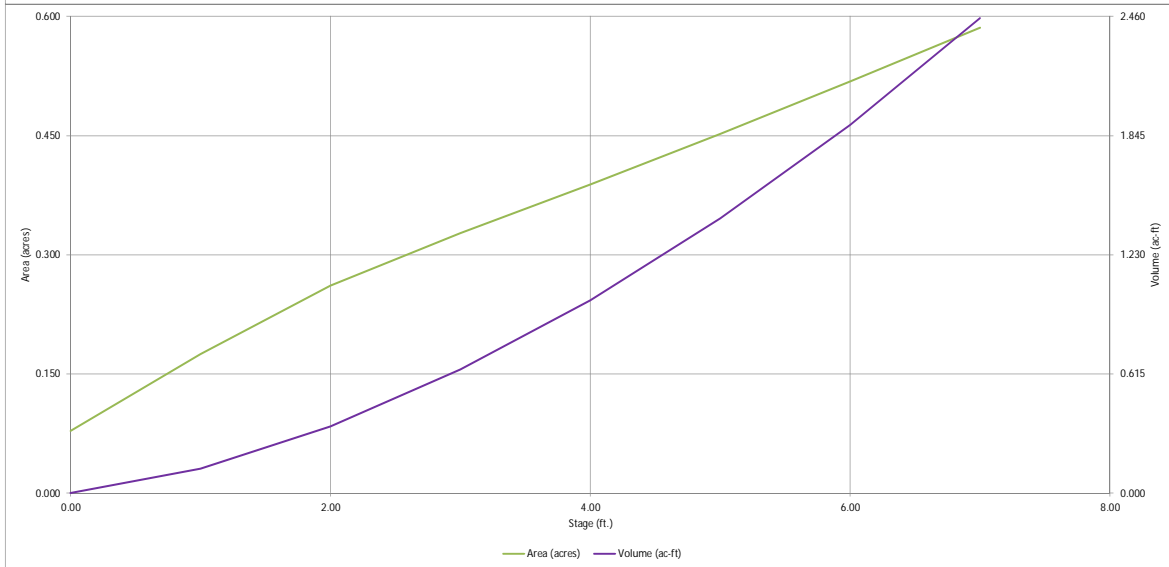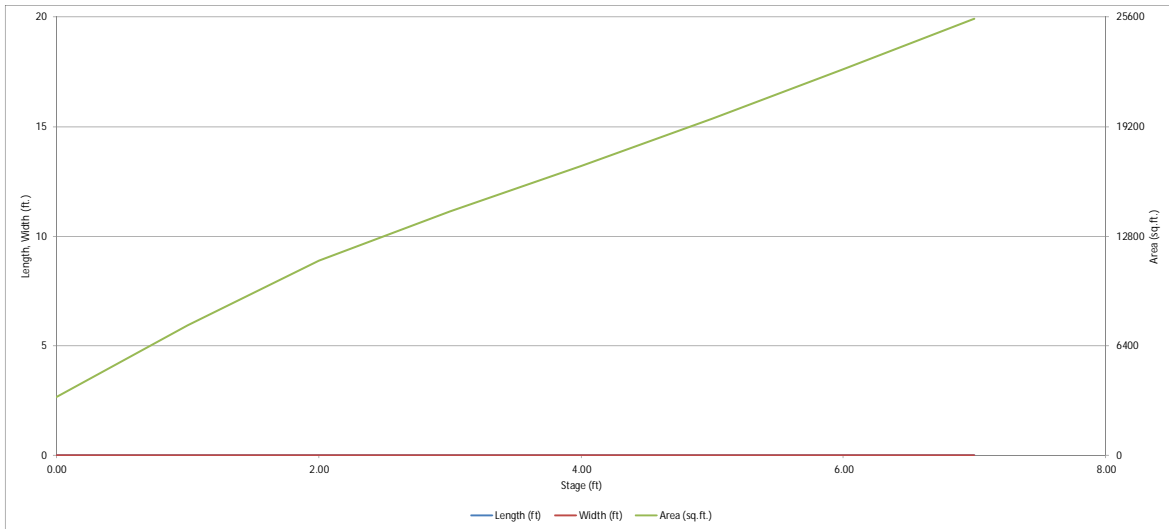


**DETENTION BASIN STAGE-STORAGE TABLE BUILDER**

MHFD-Detention, Version 4.00 (December 2019)

Project: Solace Apartments

Basin ID: Pond B



**Watershed Information**

Selected BMP Type =	<b>EDB</b>	
Watershed Area =	17.84	acres
Watershed Length =	1,800	ft
Watershed Length to Centroid =	780	ft
Watershed Slope =	0.014	ft/ft
Watershed Imperviousness =	42.90%	percent
Percentage Hydrologic Soil Group A =	1.0%	percent
Percentage Hydrologic Soil Group B =	99.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths = User Input		

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

**Optional User Overrides**

Water Quality Capture Volume (WQCV) =	0.279	acre-feet	
Excess Urban Runoff Volume (EURV) =	0.809	acre-feet	
2-yr Runoff Volume (P1 = 1.19 in.) =	0.784	acre-feet	1.19 inches
5-yr Runoff Volume (P1 = 1.5 in.) =	1.155	acre-feet	1.50 inches
10-yr Runoff Volume (P1 = 1.75 in.) =	1.486	acre-feet	1.75 inches
25-yr Runoff Volume (P1 = 2 in.) =	1.956	acre-feet	2.00 inches
50-yr Runoff Volume (P1 = 2.25 in.) =	2.324	acre-feet	2.25 inches
100-yr Runoff Volume (P1 = 2.52 in.) =	2.802	acre-feet	2.52 inches
500-yr Runoff Volume (P1 = 3.14 in.) =	3.755	acre-feet	
Approximate 2-yr Detention Volume =	0.600	acre-feet	
Approximate 5-yr Detention Volume =	0.832	acre-feet	
Approximate 10-yr Detention Volume =	1.130	acre-feet	
Approximate 25-yr Detention Volume =	1.255	acre-feet	
Approximate 50-yr Detention Volume =	1.316	acre-feet	
Approximate 100-yr Detention Volume =	1.496	acre-feet	



**Define Zones and Basin Geometry**

Zone 1 Volume (WQCV) =	0.279	acre-feet	
Zone 2 Volume (EURV - Zone 1) =	0.530	acre-feet	
Zone 3 Volume (100-year - Zones 1 & 2) =	0.688	acre-feet	
Total Detention Basin Volume =	1.496	acre-feet	
Initial Surcharge Volume (ISV) =	user	ft <sup>3</sup>	
Initial Surcharge Depth (ISD) =	user	ft	
Total Available Detention Depth (H <sub>total</sub> ) =	user	ft	
Depth of Trickle Channel (H <sub>TC</sub> ) =	user	ft	
Slope of Trickle Channel (S <sub>TC</sub> ) =	user	ft/ft	
Slopes of Main Basin Sides (S <sub>main</sub> ) =	user	H:V	
Basin Length-to-Width Ratio (R <sub>L/W</sub> ) =	user		
Initial Surcharge Area (A <sub>ISV</sub> ) =	user	ft <sup>2</sup>	
Surcharge Volume Length (L <sub>ISV</sub> ) =	user	ft	
Surcharge Volume Width (W <sub>ISV</sub> ) =	user	ft	
Depth of Basin Floor (H <sub>FLOOR</sub> ) =	user	ft	
Length of Basin Floor (L <sub>FLOOR</sub> ) =	user	ft	
Width of Basin Floor (W <sub>FLOOR</sub> ) =	user	ft	
Area of Basin Floor (A <sub>FLOOR</sub> ) =	user	ft <sup>2</sup>	
Volume of Basin Floor (V <sub>FLOOR</sub> ) =	user	ft <sup>3</sup>	
Depth of Main Basin (H <sub>MAIN</sub> ) =	user	ft	
Length of Main Basin (L <sub>MAIN</sub> ) =	user	ft	
Width of Main Basin (W <sub>MAIN</sub> ) =	user	ft	
Area of Main Basin (A <sub>MAIN</sub> ) =	user	ft <sup>2</sup>	
Volume of Main Basin (V <sub>MAIN</sub> ) =	user	ft <sup>3</sup>	
Calculated Total Basin Volume (V <sub>total</sub> ) =	user	acre-feet	

Depth Increment =		ft									
Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft <sup>2</sup> )	Optional Override Area (ft <sup>2</sup> )	Area (acre)	Volume (ft <sup>3</sup> )	Volume (ac-ft)		
Top of Micropool	--	0.00	--	--	--	7,580	0.174				
ELEV: 6245.00	--	1.00	--	--	--	20,477	0.470	14,028	0.322		
ELEV: 6246.00	--	2.00	--	--	--	30,713	0.705	39,623	0.910		
ELEV: 6247.00	--	3.00	--	--	--	35,569	0.817	72,764	1.670		
ELEV: 6248.00	--	4.00	--	--	--	39,416	0.905	110,257	2.531		
ELEV: 6249.00	--	5.00	--	--	--	43,363	0.995	151,646	3.481		
ELEV: 6250.00	--	6.00	--	--	--	42,375	0.973	194,515	4.465		

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

*MHFD-Detention, Version 4.00 (December 2019)*

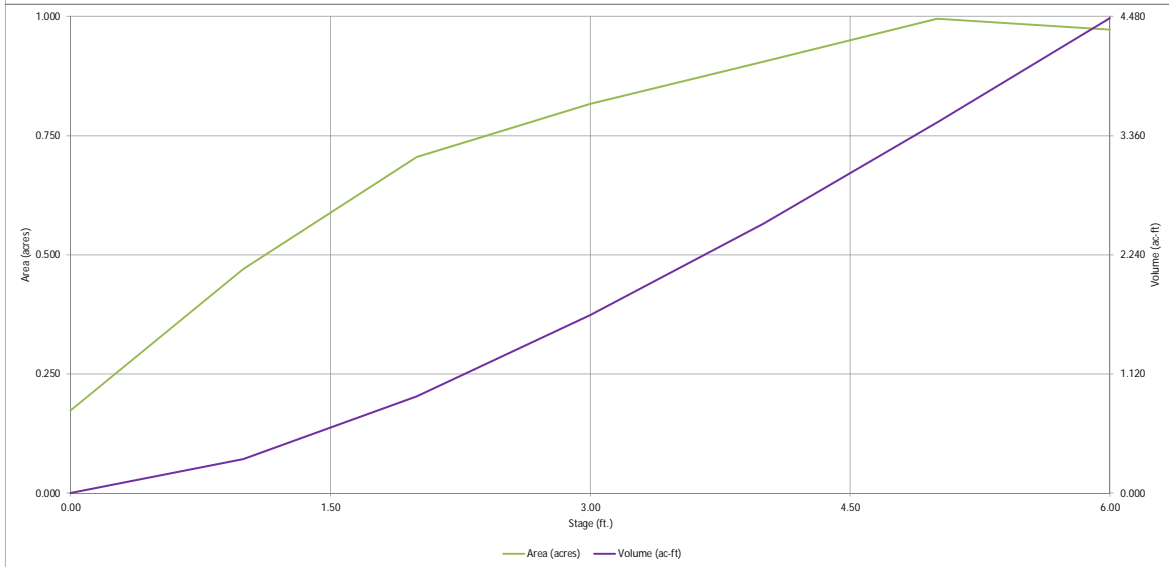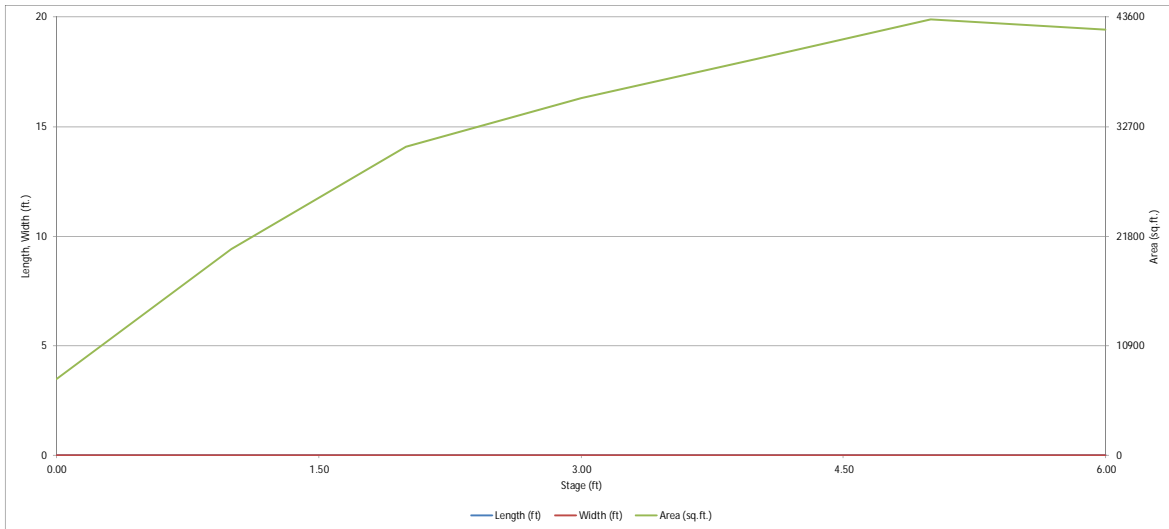

**APPENDIX D**

**REFERENCE MATERIALS**



# Federal Emergency Management Agency

Washington, D.C. 20472

JAN 30 2007

CERTIFIED MAIL  
RETURN RECEIPT REQUESTED

The Honorable Sallie Clark  
Chair, El Paso County  
Board of Commissioners  
27 East Vermijo Avenue  
Colorado Springs, CO 80903

IN REPLY REFER TO:

Case No.: 05-08-0368P  
Community Name: El Paso County, CO  
Community No.: 080059  
Effective Date of  
This Revision: **MAY 23 2007**

Dear Ms. Clark:

The Flood Insurance Study report and Flood Insurance Rate Map for your community have been revised by this Letter of Map Revision (LOMR). Please use the enclosed annotated map panel(s) revised by this LOMR for floodplain management purposes and for all flood insurance policies and renewals issued in your community.

Additional documents are enclosed which provide information regarding this LOMR. Please see the List of Enclosures below to determine which documents are included. Other attachments specific to this request may be included as referenced in the Determination Document. If you have any questions regarding floodplain management regulations for your community or the National Flood Insurance Program (NFIP) in general, please contact the Consultation Coordination Officer for your community. If you have any technical questions regarding this LOMR, please contact the Director, Federal Insurance and Mitigation Division of the Department of Homeland Security's Federal Emergency Management Agency (FEMA) in Denver, Colorado, at (303) 235-4830, or the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP). Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Sincerely,

Patrick, F. Sacbibit, P.E., CFM, Project Engineer  
Engineering Management Section  
Mitigation Division

For: William R. Blanton Jr., CFM, Chief  
Engineering Management Section  
Mitigation Division

List of Enclosures:

Letter of Map Revision Determination Document  
Annotated Flood Insurance Rate Map  
Annotated Flood Insurance Study Report

cc: The Honorable Lionel Rivera  
Mayor, City of Colorado Springs

Regional Floodplain Administrator  
Pikes Peak Regional Building Department

J. F. Sato and Associates, Inc.

Engineering and Surveying, Inc.



# Federal Emergency Management Agency

Washington, D.C. 20472

## LETTER OF MAP REVISION DETERMINATION DOCUMENT

COMMUNITY AND REVISION INFORMATION		PROJECT DESCRIPTION	BASIS OF REQUEST
COMMUNITY	El Paso County Colorado (Unincorporated Areas)	CHANNELIZATION CULVERT	FLOODWAY HYDRAULIC ANALYSIS NEW TOPOGRAPHIC DATA BASEMAP CHANGES
	COMMUNITY NO.: 080059		
IDENTIFIER	Sand Creek Center Tributary and East Fork LOMR	APPROXIMATE LATITUDE & LONGITUDE: 38.846, -104.720 SOURCE: USGS QUADRANGLE      DATUM: NAD 27	
ANNOTATED MAPPING ENCLOSURES		ANNOTATED STUDY ENCLOSURES	
TYPE: FIRM*	NO.: 08041C0752 F      DATE: March 17, 1997	DATE OF EFFECTIVE FLOOD INSURANCE STUDY: August 23, 1999	
TYPE: FIRM	NO.: 08041C0753 F      DATE: March 17, 1997	PROFILE(S): 206P	
TYPE: FIRM	NO.: 08041C0754 F      DATE: March 17, 1997	FLOODWAY DATA TABLE: 5	

Enclosures reflect changes to flooding sources affected by this revision.

\* FIRM - Flood Insurance Rate Map; \*\* FBFM - Flood Boundary and Floodway Map; \*\*\* FHBM - Flood Hazard Boundary Map

### FLOODING SOURCE(S) & REVISED REACH(ES)

Sand Creek Center Tributary – from approximately 1,350 feet upstream of East Frontage Road to just upstream of Galley Road

### SUMMARY OF REVISIONS

Flooding Source	Effective Flooding	Revised Flooding	Increases	Decreases
Sand Creek Center Tributary	Zone AE	Zone AE	YES	YES
	Floodway	Floodway	YES	YES
	BFES*	BFES	NONE	YES
	Zone X (shaded)	Zone X (shaded)	YES	YES

\* BFES - Base Flood Elevations

### DETERMINATION

This document provides the determination from the Department of Homeland Security's Federal Emergency Management Agency (FEMA) regarding a request for a Letter of Map Revision (LOMR) for the area described above. Using the information submitted, we have determined that a revision to the flood hazards depicted in the Flood Insurance Study (FIS) report and/or National Flood Insurance Program (NFIP) map is warranted. This document revises the effective NFIP map, as indicated in the attached documentation. Please use the enclosed annotated map panels revised by this LOMR for floodplain management purposes and for all flood insurance policies and renewals in your community.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Patrick F. Sacbibit, P.E., CFM, Project Engineer  
Engineering Management Section  
Mitigation Division



Federal Emergency Management Agency  
Washington, D.C. 20472

**LETTER OF MAP REVISION  
DETERMINATION DOCUMENT (CONTINUED)**

**OTHER COMMUNITIES AFFECTED BY THIS REVISION**

**CID Number:** 080060      **Name:** City of Colorado Springs, Colorado

**AFFECTED MAP PANELS**

TYPE: FIRM      NO.: 08041C0753 F      DATE: March 17, 1997  
TYPE: FIRM      NO.: 08041C0754 F      DATE: March 17, 1997

**AFFECTED PORTIONS OF THE FLOOD INSURANCE STUDY REPORT**

DATE OF EFFECTIVE FLOOD INSURANCE STUDY: August 23, 1999  
PROFILE(S): 205P, 206P, 209P, and 210P  
FLOODWAY DATA TABLE: 5

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional Information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Patrick F. Sacbbit, P.E., CFM, Project Engineer  
Engineering Management Section  
Mitigation Division





# Federal Emergency Management Agency

Washington, D.C. 20472

## LETTER OF MAP REVISION DETERMINATION DOCUMENT (CONTINUED)

### COMMUNITY INFORMATION

#### APPLICABLE NFIP REGULATIONS/COMMUNITY OBLIGATION

We have made this determination pursuant to Section 206 of the Flood Disaster Protection Act of 1973 (P.L. 93-234) and in accordance with the National Flood Insurance Act of 1968, as amended (Title XIII of the Housing and Urban Development Act of 1968, P.L. 90-448), 42 U.S.C. 4001-4128, and 44 CFR Part 65. Pursuant to Section 1361 of the National Flood Insurance Act of 1968, as amended, communities participating in the NFIP are required to adopt and enforce floodplain management regulations that meet or exceed NFIP criteria. These criteria, including adoption of the FIS report and FIRM, and the modifications made by this LOMR, are the minimum requirements for continued NFIP participation and do not supersede more stringent State/Commonwealth or local requirements to which the regulations apply.

We provide the floodway designation to your community as a tool to regulate floodplain development. Therefore, the floodway revision we have described in this letter, while acceptable to us, must also be acceptable to your community and adopted by appropriate community action, as specified in Paragraph 60.3(d) of the NFIP regulations.

NFIP regulations Subparagraph 60.3(b)(7) requires communities to ensure that the flood-carrying capacity within the altered or relocated portion of any watercourse is maintained. This provision is incorporated into your community's existing floodplain management ordinances; therefore, responsibility for maintenance of the altered or relocated watercourse, including any related appurtenances such as bridges, culverts, and other drainage structures, rests with your community. We may request that your community submit a description and schedule of maintenance activities necessary to ensure this requirement.

#### COMMUNITY REMINDERS

We based this determination on the 1-percent-annual-chance flood discharges computed in the FIS for your community without considering subsequent changes in watershed characteristics that could increase flood discharges. Future development of projects upstream could cause increased flood discharges, which could cause increased flood hazards. A comprehensive restudy of your community's flood hazards would consider the cumulative effects of development on flood discharges subsequent to the publication of the FIS report for your community and could, therefore, establish greater flood hazards in this area.

Your community must regulate all proposed floodplain development and ensure that permits required by Federal and/or State/Commonwealth law have been obtained. State/Commonwealth or community officials, based on knowledge of local conditions and in the interest of safety, may set higher standards for construction or may limit development in floodplain areas. If your State/Commonwealth or community has adopted more restrictive or comprehensive floodplain management criteria, those criteria take precedence over the minimum NFIP requirements.

We will not print and distribute this LOMR to primary users, such as local insurance agents or mortgage lenders; instead, the community will serve as a repository for the new data. We encourage you to disseminate the information in this LOMR by preparing a news release for publication in your community's newspaper that describes the revision and explains how your community will provide the data and help interpret the NFIP maps. In that way, interested persons, such as property owners, insurance agents, and mortgage lenders, can benefit from the information.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional Information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

A handwritten signature in black ink, appearing to read "P. Sacbibit".

Patrick F. Sacbibit, P.E., CFM, Project Engineer  
Engineering Management Section  
Mitigation Division



Federal Emergency Management Agency  
Washington, D.C. 20472

**LETTER OF MAP REVISION  
DETERMINATION DOCUMENT (CONTINUED)**

We have designated a Consultation Coordination Officer (CCO) to assist your community. The CCO will be the primary liaison between your community and FEMA. For information regarding your CCO, please contact:

Ms. Jeanine D. Petterson  
Director, Federal Insurance and Mitigation Division  
Federal Emergency Management Agency, Region VIII  
Denver Federal Center, Building 710  
P.O. Box 25267  
Denver, CO 80225-0267  
(303) 235-4830

**STATUS OF THE COMMUNITY NFIP MAPS**

We will not physically revise and republish the FIRM and FIS report for your community to reflect the modifications made by this LOMR at this time. When changes to the previously cited FIRM panel(s) and FIS report warrant physical revision and republication in the future, we will incorporate the modifications made by this LOMR at that time.

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

A handwritten signature in black ink, appearing to read "P. Sacbibit".

Patrick F. Sacbibit, P.E., CFM, Project Engineer  
Engineering Management Section  
Mitigation Division



Federal Emergency Management Agency  
Washington, D.C. 20472

LETTER OF MAP REVISION  
DETERMINATION DOCUMENT (CONTINUED)

PUBLIC NOTIFICATION OF REVISION

PUBLIC NOTIFICATION

FLOODING SOURCE	LOCATION OF REFERENCED ELEVATION	BFE (FEET NGVD 29)		MAP PANEL NUMBER(S)
		EFFECTIVE	REVISED	
Sand Creek Center Tributary	Approximately 1,350 feet upstream of East Frontage Road	6,170	6,165	08041C0753 F
	Just downstream of Terminal Avenue	6,216	6,213	08041C0754 F

Within 90 days of the second publication in the local newspaper, a citizen may request that we reconsider this determination. Any request for reconsideration must be based on scientific or technical data. Therefore, this letter will be effective only after the 90-day appeal period has elapsed and we have resolved any appeals that we receive during this appeal period. Until this LOMR is effective, the revised BFEs presented in this LOMR may be changed.

A notice of changes will be published in the *Federal Register*. This information also will be published in your local newspaper on or about the dates listed below.

LOCAL NEWSPAPER      Name: *El Paso County News*  
                                          Dates: 02/14/2007      02/21/2007

This determination is based on the flood data presently available. The enclosed documents provide additional information regarding this determination. If you have any questions about this document, please contact the FEMA Map Assistance Center toll free at 1-877-336-2627 (1-877-FEMA MAP) or by letter addressed to the LOMR Depot, 3601 Eisenhower Avenue, Alexandria, VA 22304. Additional information about the NFIP is available on our website at <http://www.fema.gov/nfip>.

Patrick F. Sacbibit, P.E., CFM, Project Engineer  
Engineering Management Section  
Mitigation Division

CHANGES ARE MADE IN DETERMINATIONS OF BASE FLOOD ELEVATIONS FOR THE CITY OF COLORADO SPRINGS AND THE UNINCORPORATED AREAS OF EL PASO COUNTY, COLORADO, UNDER THE NATIONAL FLOOD INSURANCE PROGRAM

On March 17, 1997, the Department of Homeland Security's Federal Emergency Management Agency identified Special Flood Hazard Areas (SFHAs) in the City of Colorado Springs and in the unincorporated areas of El Paso County, Colorado, through issuance of a Flood Insurance Rate Map (FIRM). The Mitigation Division has determined that modification of the elevations of the flood having a 1-percent chance of being equaled or exceeded in any given year (base flood) for certain locations in these communities is appropriate. The modified Base Flood Elevations (BFEs) revise the FIRM for the communities.

The changes are being made pursuant to Section 206 of the Flood Disaster Protection Act of 1973 (Public Law 93-234) and are in accordance with the National Flood Insurance Act of 1968, as amended (Title XIII of the Housing and Urban Development Act of 1968, Public Law 90-448), 42 U.S.C. 4001-4128, and 44 CFR Part 65.

A hydraulic analysis was performed to incorporate new topographic data for Sand Creek Center Tributary from just upstream of Airport Road to just upstream of Galley Road and for Sand Creek East Fork from approximately 970 feet downstream of Powers Boulevard to just downstream of Stewart Avenue. This has resulted in a revised delineation of the regulatory floodway, increases and decreases in SFHA width, and increased and decreased BFEs for both aforementioned flooding sources. The table below indicates existing and modified BFEs for selected locations along the affected lengths of the flooding source(s) cited above.

Location	Existing BFE (feet)*	Modified BFE (feet)*
Sand Creek Center Tributary:		
<sup>1</sup> Approximately 150 feet upstream of Airport Road	6,109	6,108
<sup>1</sup> Approximately 1,250 feet upstream of East Frontage Road	6,168	6,164
<sup>2</sup> Approximately 1,350 feet upstream of East Frontage Road	6,170	6,165
<sup>2</sup> Just downstream of Terminal Avenue	6,216	6,213
Sand Creek East Fork:		
<sup>1</sup> Approximately 810 feet downstream of Powers Boulevard	6,099	6,096
<sup>1</sup> Approximately 140 feet downstream of Stewart Avenue	6,206	6,205

\*National Geodetic Vertical Datum, rounded to nearest whole foot

<sup>1</sup>City of Colorado Springs

<sup>2</sup>Unincorporated areas of El Paso County

Under the above-mentioned Acts of 1968 and 1973, the Mitigation Division must develop criteria for floodplain management. To participate in the National Flood Insurance Program (NFIP), the community must use the modified BFEs to administer the floodplain management measures of the NFIP. These modified BFEs will also be used to calculate the appropriate flood insurance premium rates for new buildings and their contents and for the second layer of insurance on existing buildings and contents.

Upon the second publication of notice of these changes in this newspaper, any person has 90 days in which he or she can request, through the Chief Executive Officer of the community, that the Mitigation Division reconsider the determination. Any request for reconsideration must be based on knowledge of

changed conditions or new scientific or technical data. All interested parties are on notice that until the 90-day period elapses, the Mitigation Division's determination to modify the BFEs may itself be changed.

Any person having knowledge or wishing to comment on these changes should immediately notify:

The Honorable Sallie Clark  
Chair, El Paso County  
Board of Commissioners  
27 East Vermijo Avenue  
Colorado Springs, CO 80903

OR

The Honorable Lionel Rivera  
Mayor, City of Colorado Springs  
P.O. Box 1575  
Colorado Springs, CO 80901

---

FLOODING SOURCE		FLOODWAY			BASE FLOOD WATER SURFACE ELEVATION			INCREASE
CROSS SECTION	DISTANCE <sup>1</sup>	WIDTH (FEET)	SECTION AREA (SQ. FEET)	MEAN VELOCITY (FEET PER SECOND)	REGULATORY	WITHOUT FLOODWAY	WITH FLOODWAY	
					FEET (NGVD)			
Sand Creek East Fork	1,100	100	455	11.9	6,038.7	6,038.7	6,038.7	0.0
	2,400	100	446	12.2	6,054.3	6,054.3	6,054.3	0.0
	3,330	100	450	12.0	6,069.9	6,069.9	6,069.9	0.0
	4,240	100	449	12.1	6,085.1	6,085.1	6,085.1	0.0
	4,870	102	446	12.0	6,095.1	6,095.1	6,095.1	0.0
	6,188	70	489	10.9	6,118.5	6,118.5	6,118.5	0.0
	7,403	71	396	13.5	6,136.0	6,136.0	6,136.0	0.0
	7,931	148	507	10.5	6,158.8	6,158.8	6,158.8	0.0
	8,943	98	444	12.0	6,169.0	6,169.0	6,169.0	0.0
	9,666	86	423	12.6	6,177.0	6,177.0	6,177.0	0.0
	10,721	81	415	12.8	6,193.3	6,193.3	6,193.3	0.0
	11,347	166	526	10.1	6,207.3	6,207.3	6,207.3	0.0
	11,375	173	632	8.4	6,207.9	6,207.9	6,207.9	0.0
	12,610	367	699	7.6	6,228.8	6,228.8	6,228.8	0.1
	13,720	188	570	10.0	6,241.7	6,241.7	6,241.7	0.0
	14,805	125	479	11.1	6,257.9	6,257.9	6,257.9	0.0
	14,885	125	601	8.9	6,259.9	6,259.9	6,259.9	1.0
	15,850	228	582	9.2	6,268.7	6,268.7	6,268.7	0.0
	16,325	300	678	7.9	6,277.3	6,277.3	6,277.3	0.2
	16,995	321	690	7.7	6,291.4	6,291.4	6,292.0	0.6
	17,065	326	667	8.0	6,291.4	6,291.4	6,292.1	0.7
	17,915	388	1,598	3.3	6,293.4	6,293.4	6,294.0	0.6
	18,995	367	683	7.8	6,307.2	6,307.2	6,307.6	0.4
	20,525	413	706	7.5	6,326.4	6,326.4	6,327.1	0.7
	22,125	255	620	8.6	6,348.7	6,348.7	6,348.8	0.1
	23,105	397	706	7.6	6,359.9	6,359.9	6,359.9	0.0
24,835	431	705	7.4	6,383.7	6,383.7	6,383.7	0.0	
26,505	353	667	7.8	6,401.0	6,401.0	6,401.5	0.5	

Revised Data

Revised by LOMR dated OCT 07 2004

<sup>1</sup> Feet above confluence with Sand Creek

FEDERAL EMERGENCY MANAGEMENT AGENCY  
**EL PASO COUNTY, CO**  
**AND INCORPORATED AREAS**

FLOODWAY DATA

**SAND CREEK EAST FORK**

TABLE 5


FLOODING SOURCE		FLOODWAY				BASE FLOOD WATER SURFACE ELEVATION		
CROSS SECTION	DISTANCE <sup>1</sup>	WIDTH (FEET)	SECTION AREA (SQUARE FEET)	MEAN VELOCITY (FEET PER SECOND)	REGULATORY	WITHOUT FLOODWAY FEET (NGVD)	WITH FLOODWAY FEET (NGVD)	INCREASE
Sand Creek Center Tributary								
A	940	40	92	8.6	6,106.5	6,106.5	6,106.5	0.0
B	990	40	118	6.7	6,107.2	6,107.2	6,107.2	0.0
C	2,238	91	120	6.6	6,120.2	6,120.2	6,120.2	0.0
D	3,948	46	95	8.0	6,138.3	6,138.3	6,138.3	0.0
E	4,547	170	159	4.8	6,147.4	6,147.4	6,147.4	0.0
F	5,539	52	97	7.8	6,156.8	6,156.8	6,156.8	0.0
G	7,191	63	104	7.3	6,176.2	6,176.2	6,176.2	0.0
H	7,940	52	00	7.8	6,189.6	6,189.6	6,189.6	0.0
I	8,527	40		7.8	6,197.6	6,197.6	6,197.6	0.0
J	9,366	17	42	9.0	6,213.4	6,213.4	6,213.4	0.0
K	10,055	232	278	4.0	6,221.9	6,221.9	6,221.9	0.0
L	10,627	539	469	2.4	6,230.6	6,230.6	6,230.6	0.0
M	11,321	31	79	9.1	6,241.1	6,241.1	6,241.1	0.0
N	11,648	60	99	7.3	6,244.6	6,244.6	6,244.6	0.8
O	12,840	29	85	9.6	6,253.8	6,253.8	6,253.8	0.0
P	13,730	27	83	9.9	6,273.6	6,273.6	6,273.6	0.0
Q	14,592	26	68	9.3	6,299.7	6,299.7	6,299.7	0.0
R	14,670	40	61	6.9	6,304.2	6,304.2	6,305.2	1.0
S	15,050	20	63	10.1	6,307.6	6,307.6	6,308.1	0.5
T	15,460	25	68	9.5	6,310.8	6,310.8	6,311.4	0.6
U	15,750	20	41	7.8	6,319.6	6,319.6	6,319.6	0.0
V	16,670	20	39	8.1	6,346.0	6,346.0	6,346.0	0.0

Revised Data

Flow rate = 792 cfs

Flow rate = 822 cfs


<sup>1</sup> Feet Above confluence with Sand Creek East Fork

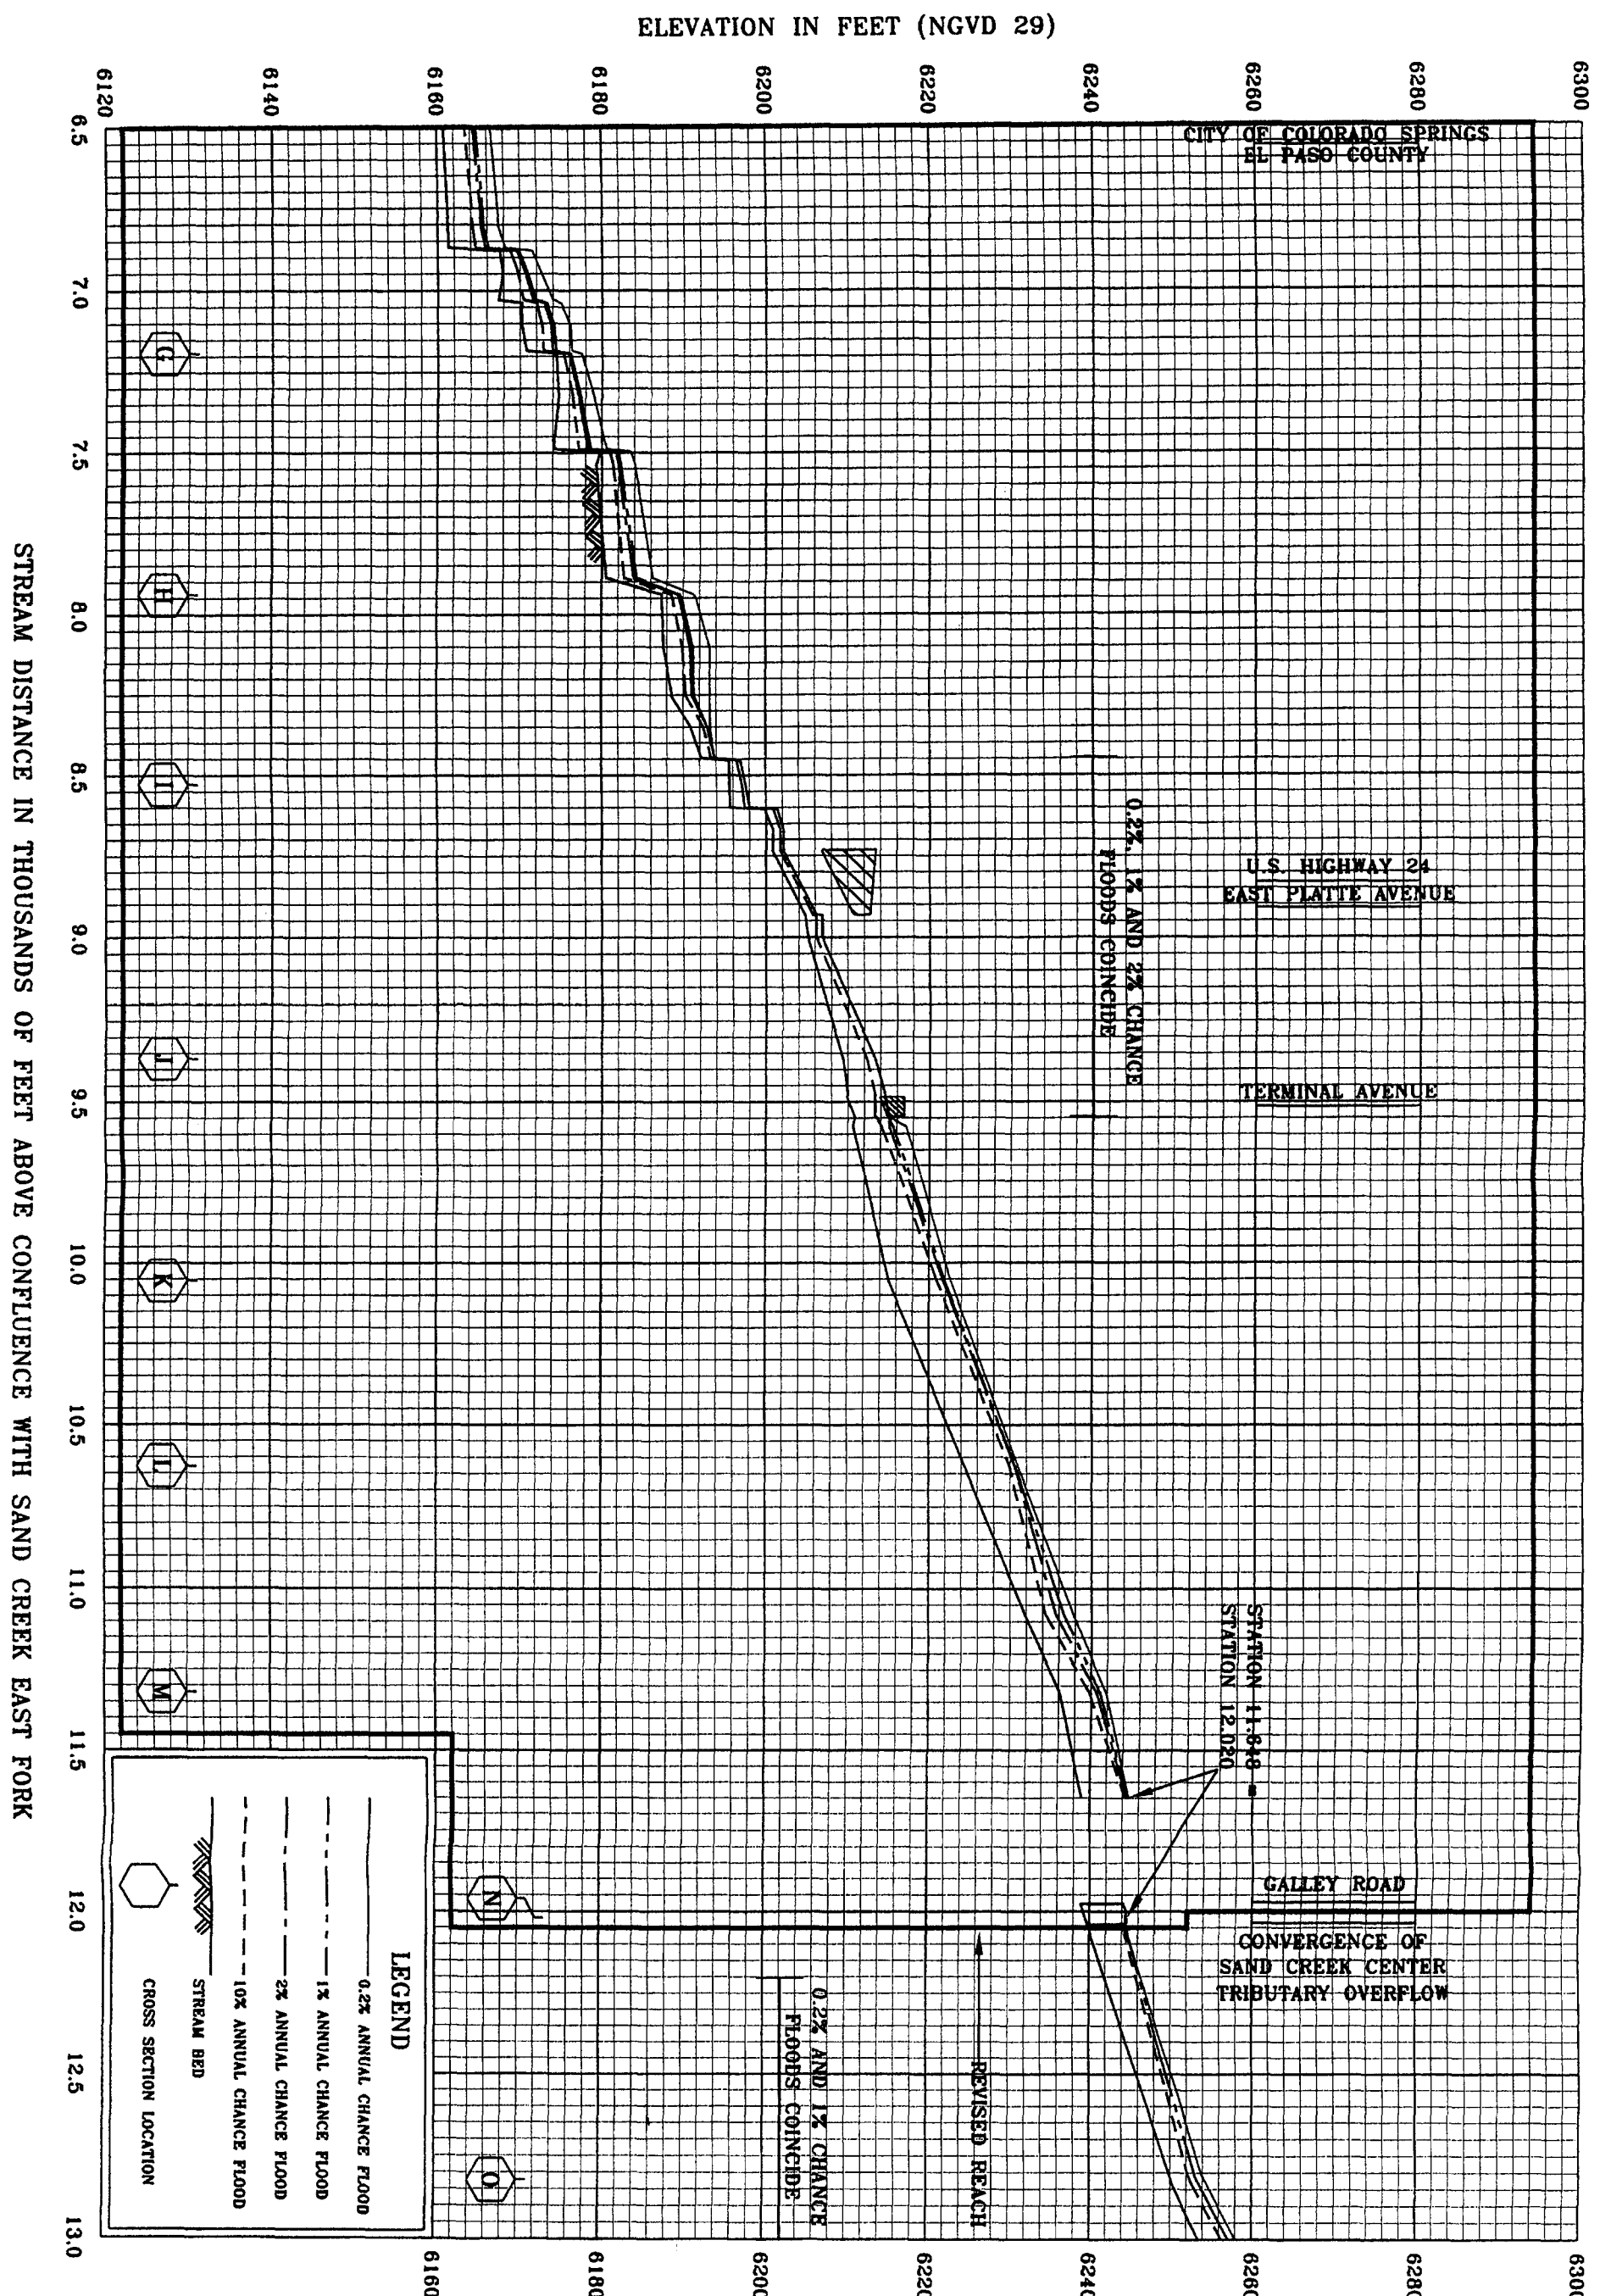




38°50'37"

104°43'07"

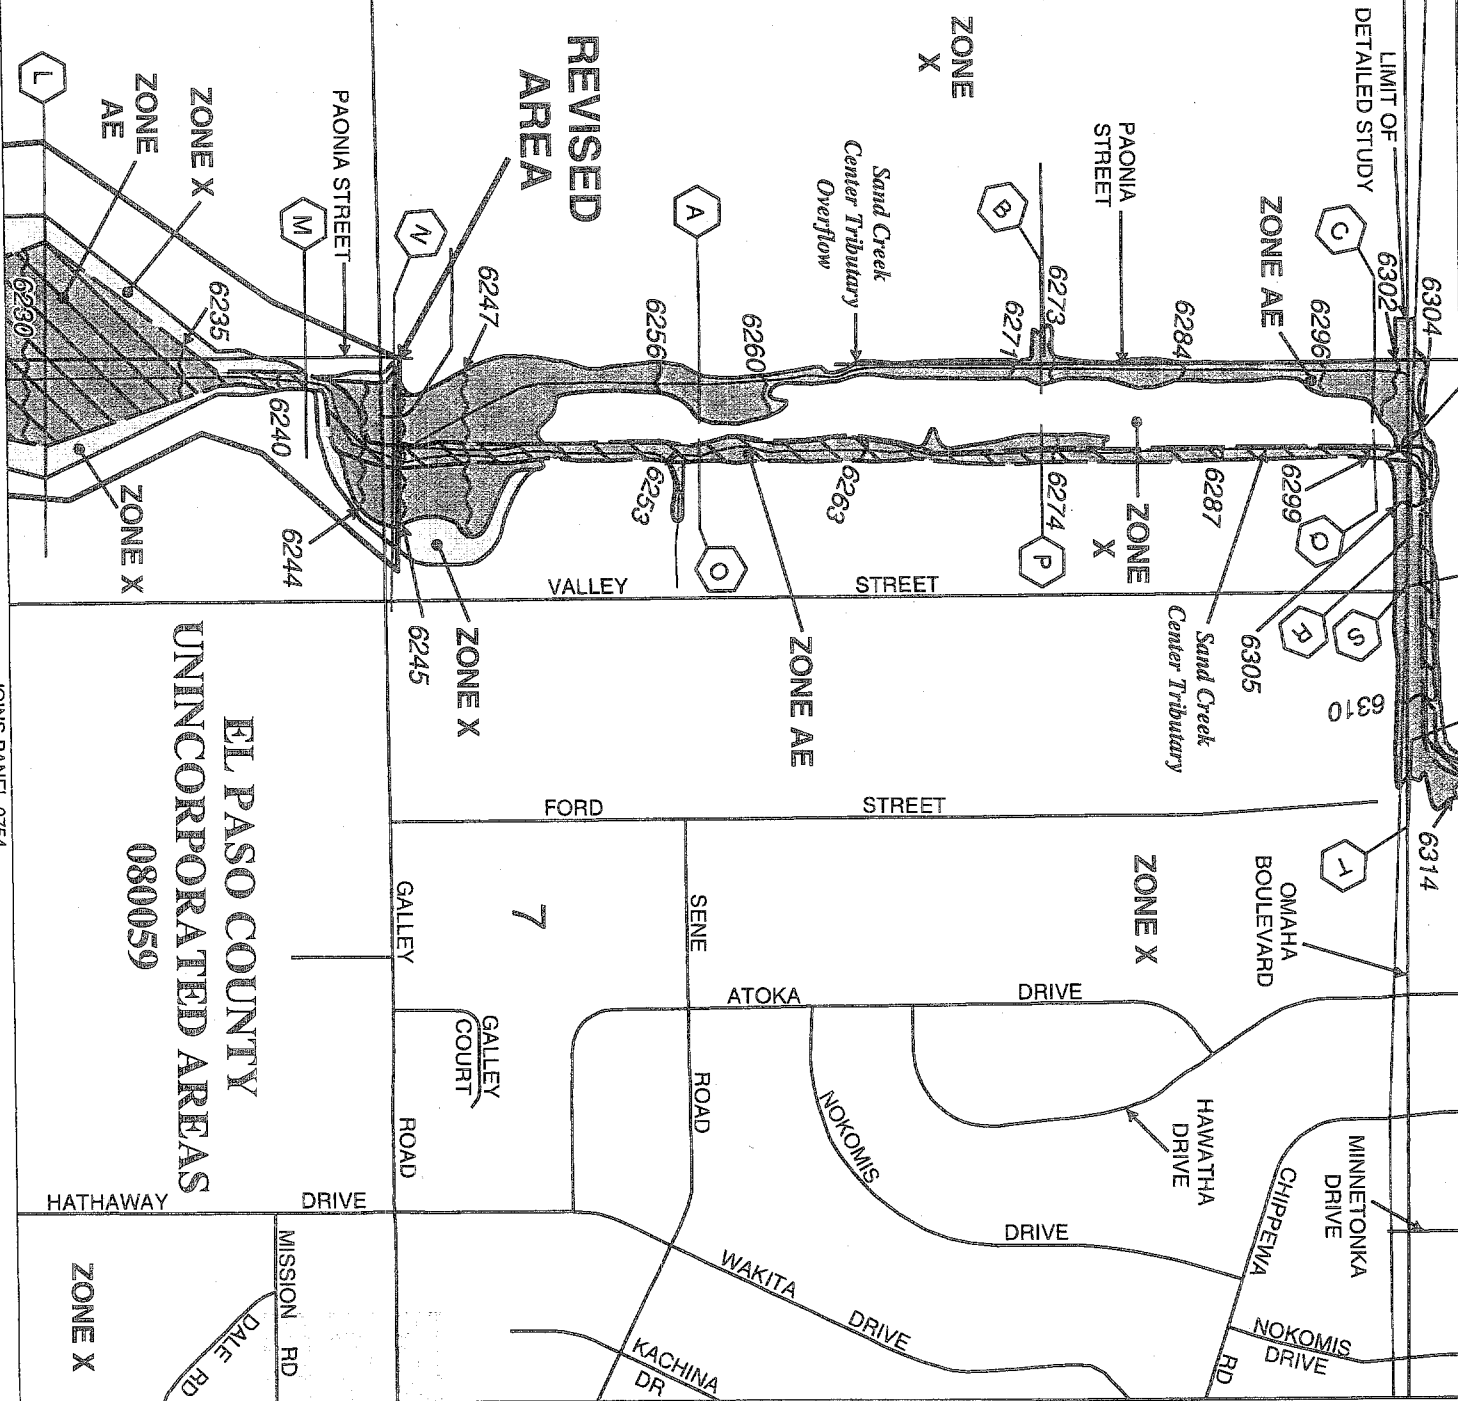

EL PASO COUNTY  
UNINCORPORATED AREAS  
080059



APPROXIMATE SCALE IN FEET



NATIONAL FLOOD INSURANCE PROGRAM

**FIRM**  
FLOOD INSURANCE RATE MAP

EL PASO COUNTY,  
COLORADO AND  
UNINCORPORATED AREAS

**PANEL 752 OF 1300**  
(SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:  
COMMUNITY NUMBER PANEL SUFFIX  
COLORADO SPRINGS, CITY OF 080059 0752 F  
EL PASO COUNTY UNINCORPORATED AREAS 080059 0752 F






MAP NUMBER  
08041C0752 F  
EFFECTIVE DATE:  
MARCH 17, 1997

Federal Emergency Management Agency

MAY 29 2007


**EL PASO COUNTY  
UNINCORPORATED AREAS  
080059**

Legend

-  1% annual chance (100-Year) Floodplain
-  1% annual chance (100-Year) Floodway
-  0.2% annual chance (500-Year) Floodplain



APPROXIMATE SCALE IN FEET



NATIONAL FLOOD INSURANCE PROGRAM

**FIRM  
FLOOD INSURANCE RATE MAP**

**EL PASO COUNTY,  
COLORADO  
AND INCORPORATED AREAS**

**PANEL 753 OF 1300  
(SEE MAP INDEX FOR PANELS NOT PRINTED)**

CONTAINS:  
COMMUNITY NUMBER PANEL SUFFIX

COLORADO SPRINGS, CITY OF	080060	0753	F
EL PASO COUNTY, UNINCORPORATED AREAS	080059	0753	F


REVISED TO  
REFLECT LOMR  
EFFECTIVE MAY 23 2007

MAP NUMBER  
08041C0753 F

EFFECTIVE DATE:  
MARCH 17, 1997



Federal Emergency Management Agency

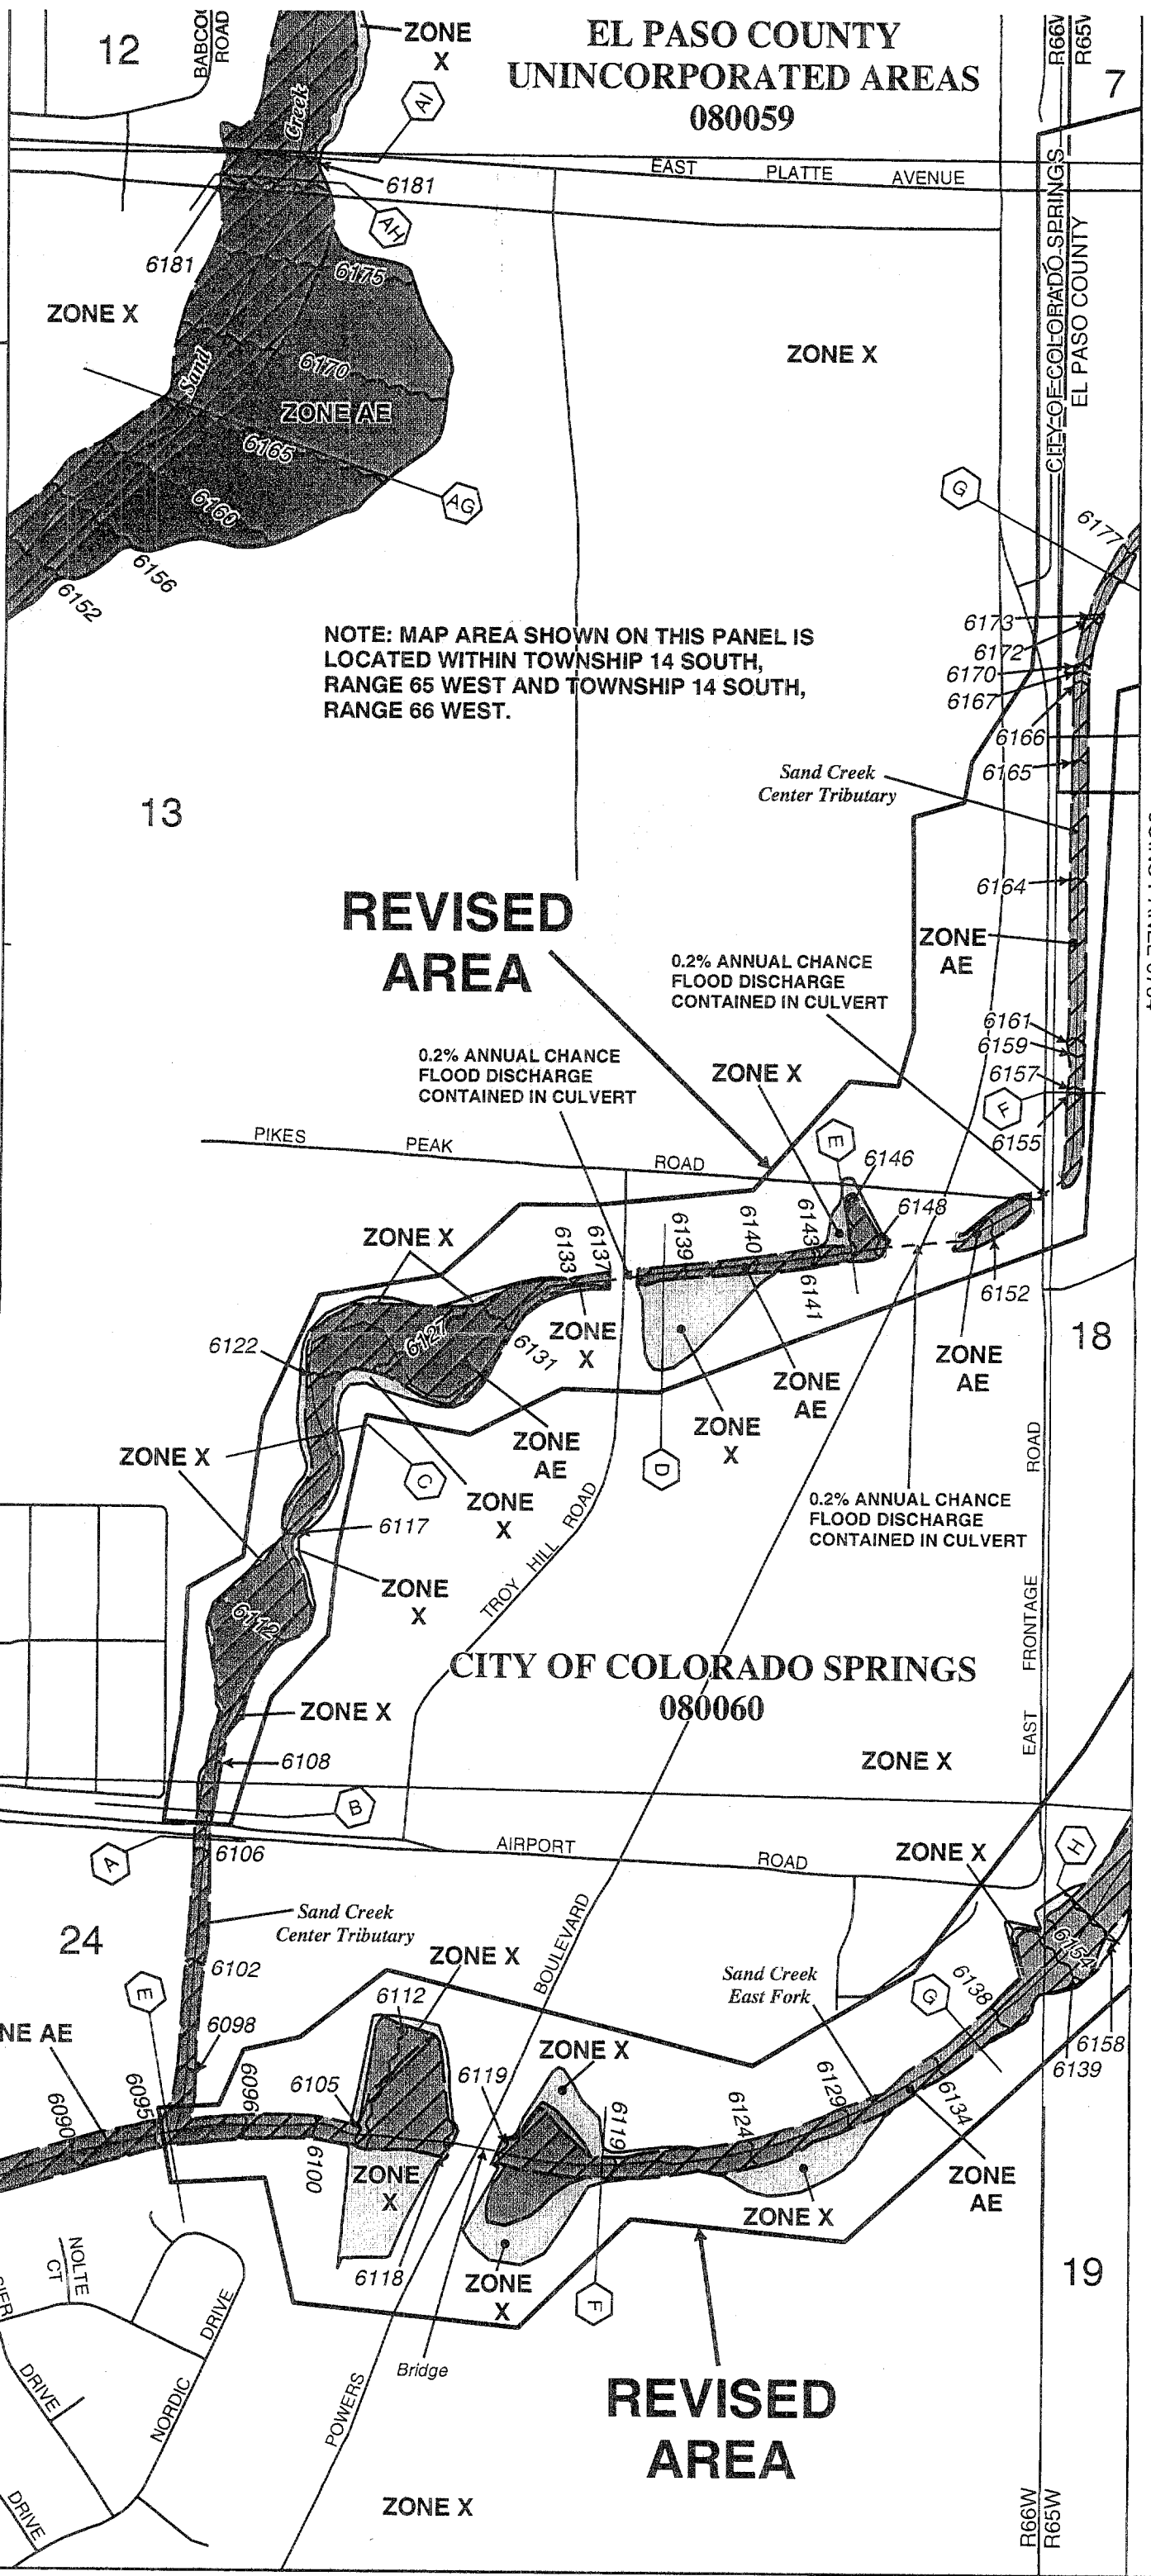

NOTE: MAP AREA SHOWN ON THIS PANEL IS  
LOCATED WITHIN TOWNSHIP 14 SOUTH,  
RANGE 65 WEST AND TOWNSHIP 14 SOUTH,  
RANGE 66 WEST.

**REVISED  
AREA**

0.2% ANNUAL CHANCE  
FLOOD DISCHARGE  
CONTAINED IN CULVERT

0.2% ANNUAL CHANCE  
FLOOD DISCHARGE  
CONTAINED IN CULVERT

0.2% ANNUAL CHANCE  
FLOOD DISCHARGE  
CONTAINED IN CULVERT

**CITY OF COLORADO SPRINGS  
080060**

**REVISED  
AREA**




JOINS PANEL 0754

R66W  
R65W

104°43'07"  
38°50'37"

JOINS PANEL 0752

# EL PASO COUNTY UNINCORPORATED AREAS 080059

- Legend
-  1% annual chance (100-Year) Floodplain
  -  1% annual chance (100-Year) Floodway
  -  0.2% annual chance (500-Year) Floodplain



APPROXIMATE SCALE IN FEET  
500 0 500

NATIONAL FLOOD INSURANCE PROGRAM

## FIRM FLOOD INSURANCE RATE MAP

EL PASO COUNTY,  
COLORADO  
AND INCORPORATED AREAS

PANEL 754 OF 1300  
(SEE MAP INDEX FOR PANELS NOT PRINTED)

CONTAINS:  
COMMUNITY NUMBER PANEL SUFFIX


COLORADO SPRINGS, CITY OF 080060 0754 F  
EL PASO COUNTY, UNINCORPORATED AREAS 080059 0754 F

REVISED TO  
REFLECT LOMR  
EFFECTIVE MAY 23 2007

MAP NUMBER  
08041C0754 F  
EFFECTIVE DATE:  
MARCH 17, 1997



Federal Emergency Management Agency

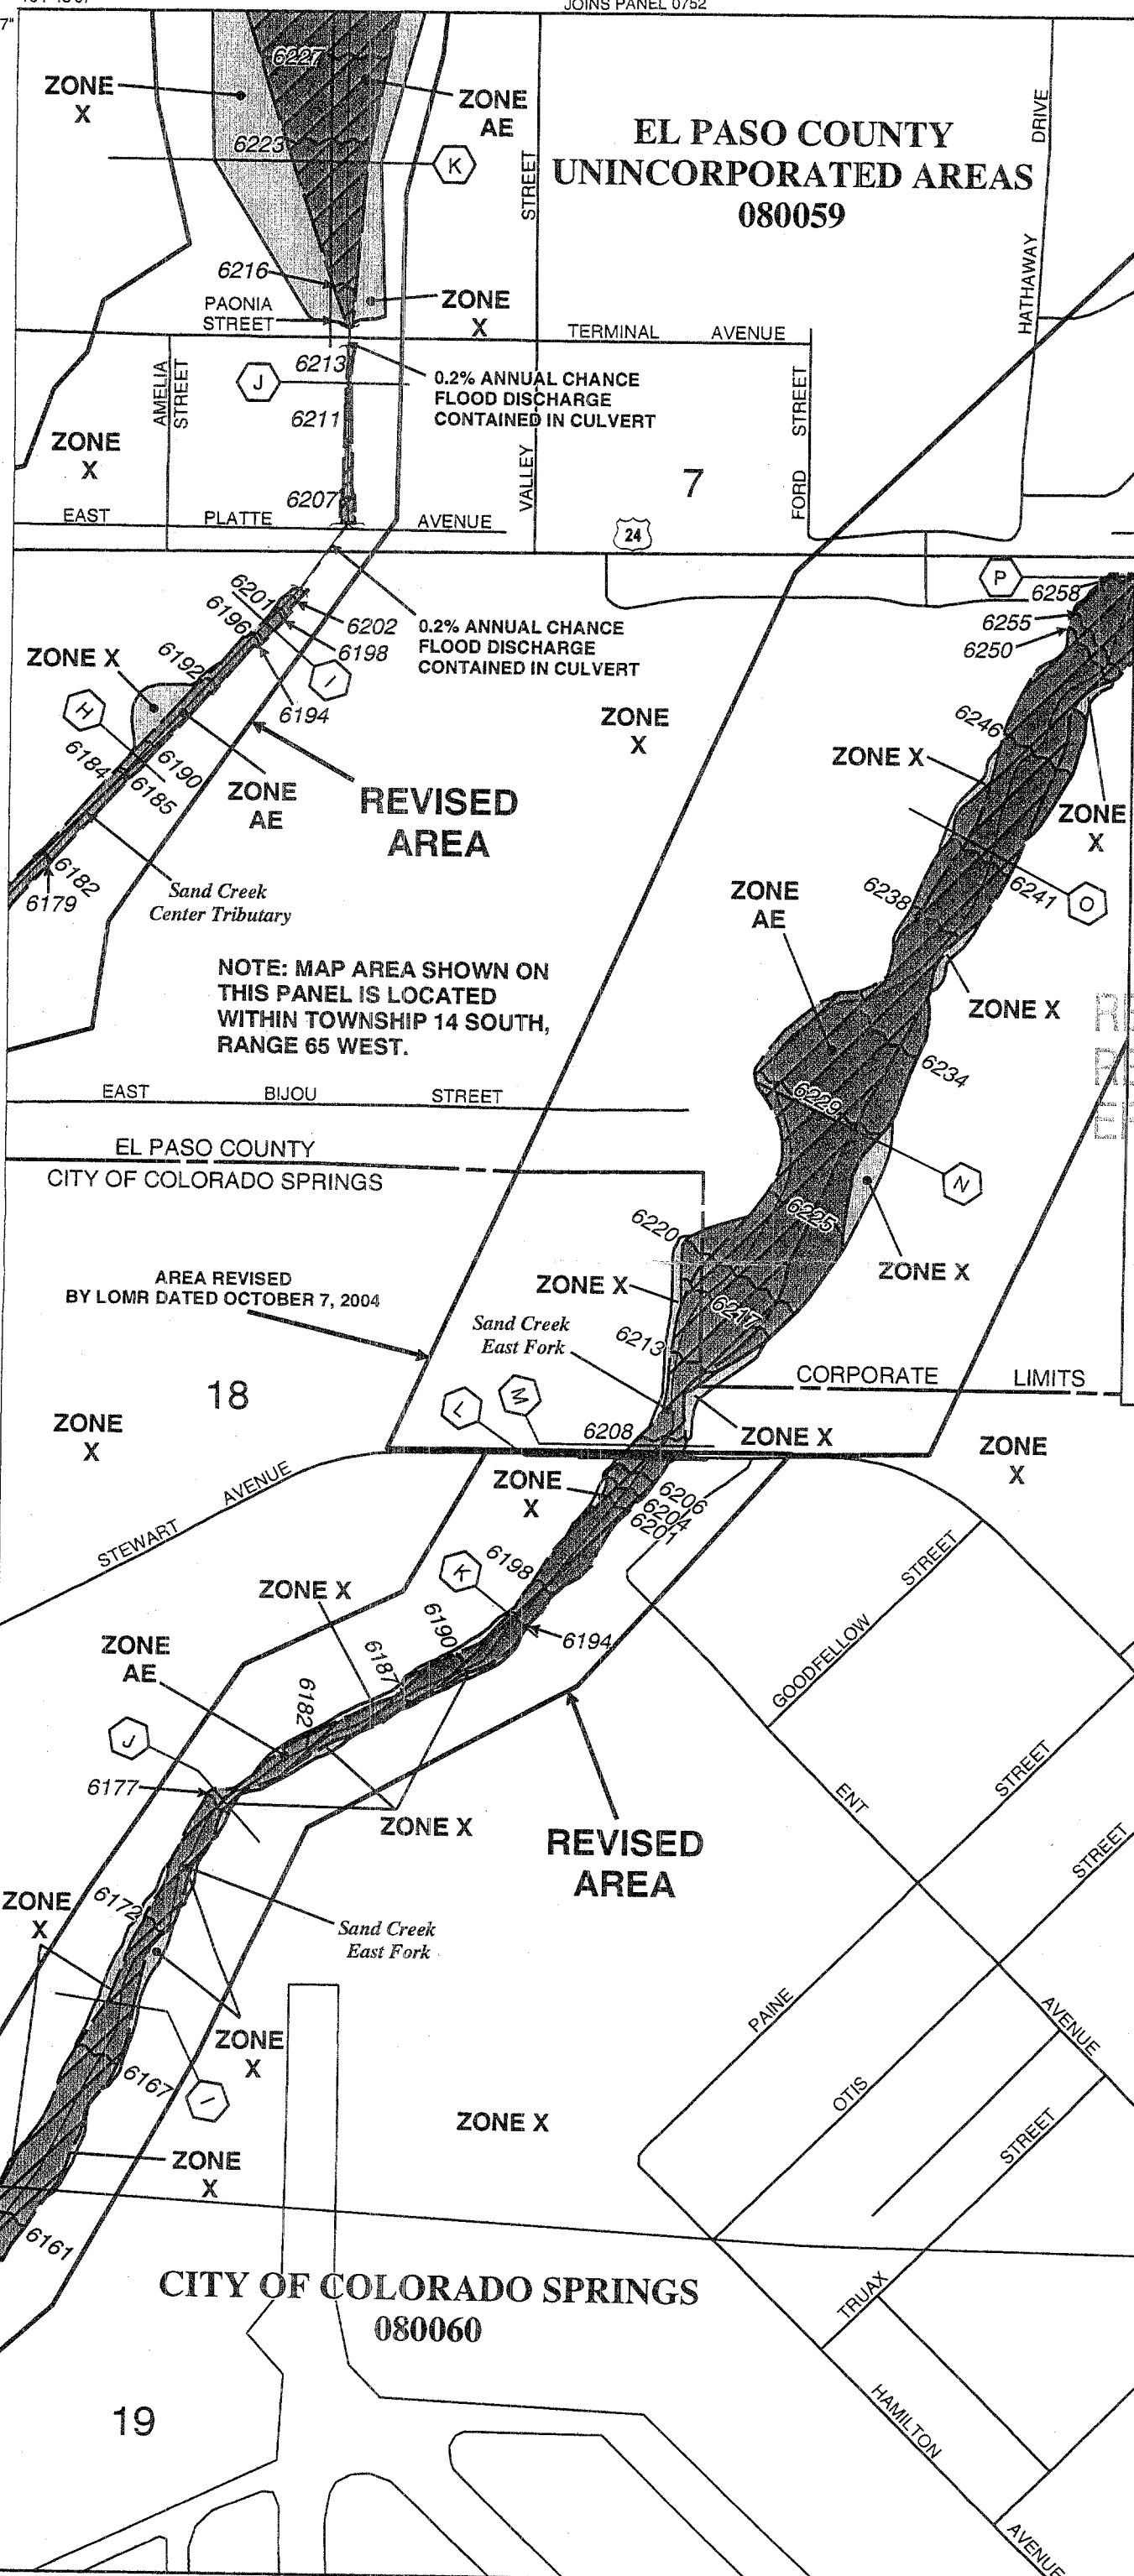

NOTE: MAP AREA SHOWN ON  
THIS PANEL IS LOCATED  
WITHIN TOWNSHIP 14 SOUTH,  
RANGE 65 WEST.

AREA REVISED  
BY LOMR DATED OCTOBER 7, 2004

REVISED  
AREA


CITY OF COLORADO SPRINGS  
080060

JOINS PANEL 0753

**SAND CREEK DRAINAGE BASIN PLANNING STUDY**

**PRELIMINARY DESIGN REPORT**

**CITY OF COLORADO SPRINGS, EL PASO COUNTY, COLORADO**

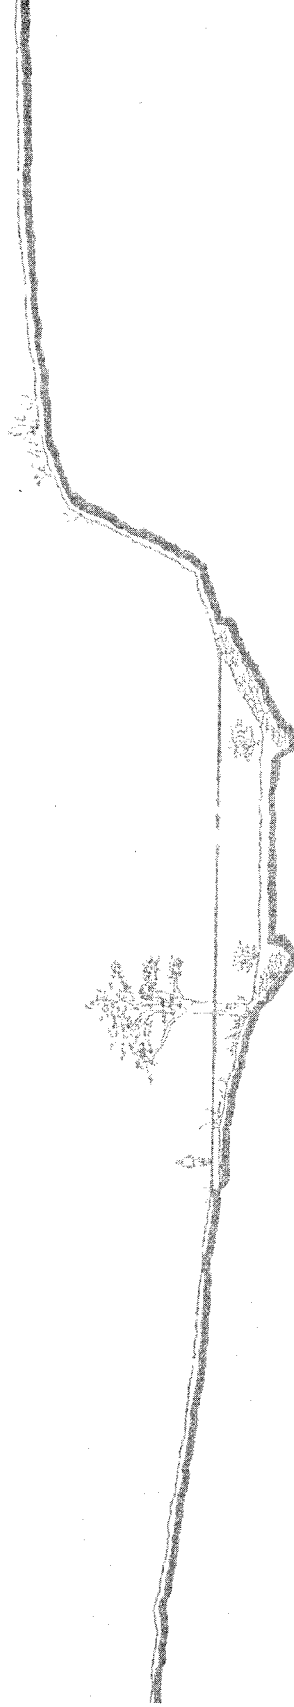

**PREPARED FOR:**

City of Colorado Springs  
Department of Comprehensive Planning, Development and Finance  
Engineering Division  
30 S. Nevada  
Colorado Springs, Colorado 80903

**PREPARED BY:**

Kowa Engineering Corporation  
1011 North Weber  
Colorado Springs, CO 80903

SAND CREEK  
DRAINAGE BASIN PLANNING STUDY  
PRELIMINARY DESIGN REPORT

Prepared for:

City of Colorado Springs  
Department of Comprehensive Planning, Development And Finance  
Engineering Division - MAIL CODE 435  
P.O. Box 1575  
Colorado Springs, CO 80901-1575

Prepared by:

Kiowa Engineering Corporation  
1001 North Weber #200  
Colorado Springs, CO 80903

KIOWA Project No. 90.04.09  
R185

JANUARY 1993  
Revised APRIL 1993  
Revised FEBRUARY 1995  
Revised APRIL 1995  
Revised OCTOBER 1995  
Revised March 1996

TABLE OF CONTENTS

	Page	Conclusions
LIST OF TABLES	ii	
LIST OF FIGURES	iii	
RESOLUTION OF ADOPTION AND ENGINEER'S STATEMENT	iv	
I. INTRODUCTION		
Authorization	1	
Purpose and Scope	1	
Summary of Data Obtained	1	
Mapping and Surveying	2	
Project Coordination	2	
Acknowledgements	3	
II. STUDY AREA DESCRIPTION		
Basin Description	4	
Climate	4	
Soils and Geology	4	
Property Ownership and Impervious Land Densities	4	
Park Land and Open Space	5	
III. HYDROLOGIC ANALYSIS		
Runoff Model	8	
Basin Characteristics	8	
Previous Studies	8	
Impervious Land Density	8	
Design Rainfall	9	
Hydrologic Modeling	9	
Results	9	
IV. HYDRAULIC ANALYSIS AND FLOOD PLAIN DESCRIPTION		
Reach Delineation	18	
Flood History	18	
Hydraulic Structure Inventory	19	
Flood Plains	19	
V. EVALUATION OF CONCEPTUAL ALTERNATIVES		
Introduction	31	
Evaluation Parameters	31	
Environmental Review of Mainstem Sand Creek Basin	31	
Environmental Review for the East Fork Sand Creek Drainage Basin	32	
Summary of Drainageway Habitat Zones	33	
Preliminary Matrix of Conceptual Alternatives	33	
Drainageway System Alternatives	33	
VI. DEVELOPMENT OF ALTERNATIVES AND RECOMMENDED PLAN		
Channel Alternatives	38	
Impact Upon Habitat	39	
Development of Recommended Plan	40	
Discussion of Recommended Plan	40	
VII. PRELIMINARY DESIGN		
Criteria	51	
Hydrology	51	
Channels	51	
Drop Structures and Check Structures	52	
Detention	52	
Water Quality	52	
Trails	53	
Maintenance and Revegetation	53	
Right-of-Way	53	
Roadway Bridge and Culvert Replacements	53	
Erosion and Sedimentation Control	54	
General	54	
VIII. PLAN IMPLEMENTATION		
General	58	
Cost Estimate	58	
Unplanted Acreage	58	
Drainage and Bridge Fee Calculations	59	
APPENDIX A:		
Project Correspondence		
PRELIMINARY DESIGN DRAWINGS, PLAN, PROFILES AND DETAILS		

## LIST OF TABLES

	<u>Page</u>	<u>Page</u>	
Table III-1	Percent Impervious Values	10	
Table III-2	Summary of Peak Discharges - 24-Hour Duration Storm, Baseline Conditions	10	
Table IV-1	Summary of Hydraulic Structures - Crossings	20-25	
Table IV-2	Summary of Hydraulic Structures - Channels	26-29	
Table V-1	Summary of Wildlife Habitat Acreages	35	
Table VI-1	Matrix of Channel Alternatives	43	
Table VI-2	Evaluation of Conceptual Channel Alternatives Floodplain Preservation	44	
Table VI-3	Evaluation of Conceptual Channel Alternatives Channelization	45	
Table VI-4	Evaluation of Conceptual Channel Alternatives Selective Drainageway Improvements	46	
Table VI-5	Evaluation of Conceptual Channel Alternatives West Fork Sand Creek	47	
Table VI-6	Evaluation of Conceptual Channel Alternatives Center Tributary Sand Creek	48	
Table VI-7	Matrix of Recommended Channel Alternatives	49	
Table VII-1	Summary of Peak Discharges Selected Detention Alternative	55	
Table VII-2	Regional Detention Basin Water Quality Storage Requirements	56	
Table VIII-1	Unit Construction Costs	60	
Table VIII-2	Drainageway Conveyance Cost Estimate	61-71	
Table VIII-3	Tributary Drainageway Conveyance Cost Estimate	72-75	
Table VIII-4	Roadway Culvert Crossing Cost Estimate	76-79	
	Table VIII-5	Detention Basin Cost Estimate	80-81
	Table VIII-6	Miscellaneous Drainageway Cost Estimate	82
	Table VIII-7	Bridge Crossing Cost Estimate	83-84
	Table VIII-8	Drainage Basin Fee Estimation	85
	Table VIII-9	City Bridge Fee Calculation	86
	Table VIII-10	County Bridge Fee Calculation	86
	Table VIII-11	Regional Detention Basin Land Fee Calculation	87
	Table VIII-12	Regional Detention Basin Capital Cost Fee Calculation	87

## LIST OF FIGURES

	<u>Page</u>
Figure II-1	5
Vicinity Map	
Figure II-2	6
Hydrologic Soils Map	
Figure II-3	7
Proposed Land Use	
Figure III-1	11
Regional Sub-Basins	
Figure III-2	12
Flood Discharge Profile - Mainstem Sand Creek	
Figure III-3	13
Flood Discharge Profile - Center Tributary Sand Creek	
Figure III-4	14
Flood Discharge Profile - West Fork Sand Creek	
Figure III-5	15
Flood Discharge Profile - East Fork Sand Creek	
Figure III-6	16
Flood Discharge Profile - East Fork Sub-tributary	
Figure III-7	17
Flood Discharge Profile - East and West Bierstadt Creeks	
Figure IV-1	30
Reach Delineations	
Figure V-1	36
Detention Basin Alternatives, Sand Creek	
Figure V-2	37
Detention Basin Alternatives, East Fork Sand Creek	
Figure VI-1	50
Channel Alternatives, East Fork Sand Creek	
Figure VII-1	57
Water Quality Pond Capture Volumes	



Resolution No. 189-95

**A RESOLUTION ADOPTING THE SAND CREEK DRAINAGE BASIN PLANNING STUDY AND ESTABLISHING A DRAINAGE FEE, A DETENTION POND CAPITAL FEE, A DETENTION POND LAND FEE, AND AN ARTERIAL BRIDGE FEE FOR THE BASIN.**

WHEREAS, the City Engineering Division of the City of Colorado Springs Department of Planning and Development has reviewed the Sand Creek Drainage Basin Planning Study as prepared by Kiowa Engineering Corporation, Colorado Springs, Colorado dated November 2, 1995, and

WHEREAS, the City/County Drainage Board has recommended approval of the above study at their November 2, 1995, meeting;

WHEREAS, the Sand Creek Drainage Basin includes unplatted land within the City limits;

NOW THEREFORE, BE IT RESOLVED by the City Council of the City of Colorado Springs:


Section 1. That the Sand Creek Drainage Basin Planning Study, dated November 1995, by Kiowa Engineering Corporation is adopted for use. City Engineering will utilize that study to assist in evaluating subdivision drainage reports.

Section 2. That a Sand Creek Drainage Basin Fee be established as \$4,895/acre, that a Sand Creek Detention Pond Capital Fee be established as \$1,213/acre, that a Sand Creek Detention Pond Land Fee be established as \$167/acre, and that a Sand Creek Arterial Bridge Fee be established as \$323/acre, as part of.

Dated at Colorado Springs, Colorado, this \_\_\_\_\_ 28th \_\_\_\_\_ day of \_\_\_\_\_ November \_\_\_\_\_, 1995.

  
Mayor



ATTEST:

  
City Clerk

**ENGINEER'S STATEMENT:**

The attached SAND CREEK DRAINAGE BASIN PLANNING STUDY report was prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the City for drainage reports. I accept responsibility for any liability caused by any negligent acts, errors and omissions on my part in preparing this report.

Kiowa Engineering Corporation, 1011 North Weber St., Suite 200, Colorado Springs, CO 80903

  
  
Registered Engineer No. 10530  
Date: 7/26/96

## I. INTRODUCTION

### Authorization

The preliminary design of the drainageway and roadway crossing facilities within the Sand Creek Drainage Basin was authorized under the terms of Agreement Number 90-85 between the City of Colorado Springs (City) and Kiowa Engineering Corporation. The agreement was approved by the Colorado Springs City Council, April 10, 1990. Subsequent to this agreement, a change order to the contract to allow for the inclusion of technical information contained in the draft East Fork Sand Creek Drainage Basin Planning Study was approved July, 1993.

### Purpose and Scope

The purpose of the study is to identify feasible stormwater management plans to satisfy the existing and future needs within the Sand Creek Drainage Basin. The Sand Creek basin is to be referred to throughout this study and is inclusive of the Sand Creek mainstem and East Fork Sand Creek watersheds. The specific scope of work for this study included the following tasks:

1. Meet with the City to: insure compliance with the services required by this agreement, obtain existing data and general information from participating entities, solicit desires of participating entities and other interested agencies or groups in order to develop alternate plans, procure current information relative to development plans in the basin, procure information relative to right-of-way limitations, proposed stormwater projects, potential hazards due to flooding, and avoid duplication of effort whenever possible by utilizing existing information available from other agencies.
2. Contact the City, County, individuals, and other agencies who have knowledge and/or interest in the study area.
3. Utilize City policies and criteria and applicable information wherever possible.
4. Perform hydraulic and hydrologic analyses within the study area.
5. Identify environmental setting of basin.
6. Identify existing and potential drainage and/or flooding problems.
7. Develop improvement alternatives to reduce existing and potential flooding problems, and to mitigate the impact of stormwater runoff upon environmentally significant areas along the drainageway(s).
8. Examine the operation and maintenance aspects of feasible alternatives.

9. Conduct an economic analysis of each alternative.
10. Recommend and prepare a preliminary design for a selected alternative plan.
11. Develop drainage and bridge fees for the basin.
12. Prepare a written report discussing all items examined in the study.
13. Conduct presentations to public and private entities in order to define project goals, and to involve agencies with specific interest to help define feasible alternatives.

### Summary of Data Obtained

Listed below are the technical reports collected for the review as part of preparing this study:

1. Soil Survey for El Paso County, Colorado, dated June 1981.
2. "City of Colorado Springs/El Paso County Drainage Criteria Manual", prepared by City of Colorado Springs, El Paso County, and HDR Infrastructure, Inc., dated May 1987.
3. "Flood Insurance Studies for Colorado Springs, and El Paso County, Colorado", prepared by the Federal Emergency Management Agency (FEMA), revised 1989.
4. Flood Insurance Restudy, Hydrology Report and Hydrologic Analyses, prepared by RCI, Inc., 1989.
5. Sand Creek Drainage Basin Planning Study prepared by Simons, Li & Associates, Inc., dated July, 1985.
6. Flood Hazard Analysis, Sand Creek, City of Colorado Springs and El Paso County, Colorado, prepared by the Soil Conservation Service, dated December, 1973.
7. Banning-Lewis Ranch Master Drainage Plan, prepared by MSM Consultants, Inc., dated June 1981.
8. Sand Creek Drainage Basin Study, prepared by United Planning and Engineering Company, October, 1977.
9. Draft East Fork Sand Creek Drainage Basin Planning Study, prepared by Kiowa Engineering Corporation, January, 1989.
10. Drainage Basin Inventory, Sand Creek Drainage Basin, prepared by Oliver E. Watts, P.E., June 1990.

In addition to the above listed reports there were a number of drainage study reports, sketch plans, preliminary and final design drawings, land use and zoning maps, development

plans, and existing drainage facility maps that were collected from the City, County, and other local agencies.

Reports which were prepared previous to the preliminary design report include the "Sand Creek Drainage Basin Planning Study Hydrology Report," and the "Sand Creek Drainage Basin Planning Study Development of Alternatives Report." These reports were prepared as part of the overall planning effort and have been referred to throughout this report. The Hydrology Report summarized peak flow data for existing and future basin development conditions without improvements in the basin, and established the base line hydrologic conditions from which the alternative planning then proceeded. The Development of Alternatives report evaluated the various combinations of drainageway improvements for the basin, taking into account environmental, cost, construction, right-of-way, maintenance and implementation factors for each feasible alternate plan. These reports are on file with the City Engineering Division, as well as technical addenda for each report. Both of these reports covered only the mainstem of the Sand Creek Basin. The similar information prepared for the draft East Fork Sand Creek Drainage Basin Planning Study has been summarized in this preliminary design report.

#### Mapping and Surveying

Mapping used in the planning effort for the mainstem of Sand Creek consisted of USGS 7-1/2 minute quadrangles, and 2-foot contour interval, 1-inch to 200-foot scale planimetric topographic maps. For the area of the basin north of Woodmen Road, aerial topographic mapping was compiled in May 1990. For the balance of the basin, the City of Colorado Springs Department of Public Utilities provided topographic mapping compiled from aerial photographs dated 1989. This mapping has been prepared as part of the Facility Inventory Management System (FIMS). The aerial topographic mapping was used in the drainage inventory, hydrologic/hydraulic analyses, and in the alternative planning phases of this project. All topographic mapping was based upon USGS vertical datum.

For the East Fork Sand Creek basin, mapping from the FIMS office and two-foot contour interval topography prepared in 1987 for the Banning-Lewis Ranch property were used in the preparation of the preliminary design. Where topographic mapping was not available, USGS quadrangle maps were used.

Stream cross-section data was obtained from the aerial mapping described above. These sections were verified against the cross-sections compiled in the 1986 City of Colorado Springs Flood Insurance Study (FIS), wherever possible.

Drainageway site inspections were conducted throughout the study area, and photographs were taken documenting the key drainage features.

#### The following general conditions have been placed upon the use of the FIMS topographic mapping:

-- Use of these products is restricted to the project for which the FIMS products are provided.

-- Only the body content found within the headline of the borrowed maps may appear in any report/publication developed for your study. Also, the labeling that appears on any photographs provided shall not appear in any such report/publication.

-- All FIMS' products provided to contractors involved in the subject study shall be retrieved by your department upon conclusion of the study and either returned to FIMS or destroyed.

-- The report(s) developed in which the FIMS' products are used shall include the following disclaimer statement:

"The maps and photographs included in this report were developed for purposes of the Colorado Springs Department of Utilities and are for internal use only. The Colorado Springs Department of Utilities makes no warranty, expressed or implied, as to the completeness, accuracy, or content of such products or any reproductions thereof. Any other use is not recommended and occurs at the risk of the user; such user is solely responsible and/or liable for the use of such products.

Original maps and photographs are the property of the Colorado Springs Department of Utilities. All rights are reserved. These maps and photographs or any associated record may not, wholly or in part, be reproduced, stored, or transmitted in any form or by any means, electronic, mechanical, photocopying, or otherwise, without the express prior written permission of the Colorado Springs Department of Utilities.

Regardless of the existence of purpoed copies of these official maps and photographs which may from time to time be made or published, there is only one set of official maps and photographs, which are those kept and maintained by the Colorado Springs Department of Utilities."

#### Project Coordination

Throughout the course of the study, meetings were held with representatives of City, County, State, and Federal agencies with an interest in drainageway planning in general. The primary reason for the coordination effort was to obtain technical information and to identify concerns with regard to the development of drainageway facilities within the basin. During the course of preparing the Development of Alternatives report, the planning constraints and concepts were discussed with the agencies and interested individuals and their input used to refine the feasible alternatives and to eventually identify a recommended drainageway plan for further design evaluation. The complete mailing list and project correspondence is contained in Appendix A of this report.

Coordination with a similar list of agencies and individuals was conducted during the preparation of the draft East Fork Sand Creek Drainage Basin Planning study. This study was authorized and conducted for Artes Properties, Inc. Meetings with state and federal agencies, the City and the County were involved in a series of meetings during the development of the alternative planning concepts and the preliminary design for the East Fork Sand Creek basin.

#### Acknowledgements

During the preparation of the study, several government agencies and interested individuals were routinely involved in the coordination activities. Representatives from the Colorado Division of Wildlife, U.S. Army Corps of Engineers (COE), and various City Departments provided valuable commentary during the development of the alternative plans. A listing of the individuals and agencies routinely coordinated with during the study has been presented below:

<u>Name</u>	<u>Agency</u>
Alan Morrice	El Paso County Department of Public Works
John Fisher	El Paso County Land Use Department
Sue Johnson	El Paso County Parks Department
Rick O'Connor	El Paso County Planning Department
Hugh King	City of Colorado Springs Street Division
Gary Haynes	City Engineering Division
Bruce Thorson	City Engineering Division
Ken Sampley	City Engineering Division
Steve Jacobsen	City Engineering Division
Christine Lytle	City Engineering Division
Bruce Goforth	Colorado Division of Wildlife
Dan Bunting	Regional Building Department
Sarah Fowler	Environmental Protection Agency
John Liou	Federal Emergency Management Agency
Dave Frick	RCI, Inc., Fort Collins, Colorado
Bill Noonan	U.S. Fish and Wildlife
Anita Culp	U.S. Army Corps of Engineers
John Maynard	Aiken/Audobon Society
John Covert	Palmer Foundation
Peter Kernikump	City Planning Department
Jim Rees	Department of Planning and Development
Fred Mais	City Parks and Recreation
Diana Medina	City of Colorado Springs
Dan Tippie	Department of Public Utilities Gas Division
Russ Nicklin	City of Colorado Springs
Wes Tyson	Department of Public Utilities Wastewater Division
	Department of Public Utilities Water Division
	City Attorney's Office

## II. STUDY AREA DESCRIPTION

The Sand Creek drainage basin is a left-bank tributary to the Fountain Creek lying in the west-central portions of El Paso County. Sand Creek's drainage area at Fountain Creek is approximately 54 square miles of which approximately 18.8 square miles are inside the City of Colorado Springs corporate limits. The basin is divided into five major sub-basins, the Sand Creek mainstem, the East Fork Sand Creek, the Central Tributary to East Fork, the West Fork, and the East Fork Subtributary. Figure II-1 shows the location of the Sand Creek basin.

### Basin Description

The Sand Creek basin covers a total of 54 square miles in unincorporated El Paso County and Colorado Springs, Colorado. Of this total, approximately 28 square miles is encompassed by the Sand Creek basin, and 26 square miles for the East Fork Sand Creek basin. The basin trends in generally a south to southwesterly direction, entering the Fountain Creek approximately two miles upstream of the Academy Boulevard bridge over Fountain Creek. Two main tributaries drain the basin, those being the mainstem of Sand Creek and East Fork Sand Creek. Development presence is most evident along the mainstem. At this time, approximately 25 percent of the basin is developed. This alternative evaluation focuses upon the Sand Creek basin only.

The maximum basin elevation is approximately 7,620 feet above mean sea level, and falls to approximately 5,790 feet at the confluence with Fountain Creek. The headwaters of the basin originate in the conifer covered areas of The Black Forest. The middle eastern portions of the basin are typified by rolling range land with fair to good vegetative cover associated with semi-arid climates.

### Climate

This area of El Paso County can be described, in general as high plains, with total precipitation amounts typical of a semi-arid region. Winters are generally cold and dry. Precipitation ranges from 14 to 16 inches per year, with the majority of this precipitation occurring in spring and summer in the form of rainfall. Thunderstorms are common during the summer months, and are typified by quick-moving low pressure cells which draw moisture from the Gulf of Mexico into the region. Average temperatures range from about 30°F in the winter

to 75° in the summer. The relative humidity ranges from about 25 percent in the summer to 45 percent in the winter.

### Soils and Geology

Soils within the Sand Creek basin vary between soil types A through D, as identified by the U. S. Department of Agriculture, Soil Conservation Service. The predominant soil groupings are in the Truckton and Bresser soil associations. The soils consist of deep, well drained soils that formed in alluvium and residuum, derived from sedimentary rock. The soils have high to moderate infiltration rates, and are extremely susceptible to wind and water erosion where poor vegetation cover exists. In undeveloped areas, the predominance of Type A and B soils give this basin a lower runoff per unit area as compared to basins with soils dominated by Types C and D. Presented on Figure II-2 is the Hydrologic Soil distribution map for the Sand Creek basin.

### Property Ownership and Impervious Land Densities

Property ownership along the major drainageway within the Sand Creek basin vary from public to private. Along the developed reaches, drainage right-of-ways and greenbelts have been dedicated during the development of the adjacent residential and commercial land. Where development has not occurred, the drainageways remain under private ownership with no delineated drainage right-of-way or easements. There are several public parks which abut the mainstem of Sand Creek. Roadway and utility easements abutting or crossing the major drainageways occur most frequently in the developed portions of the basin.


Land use information for the existing and future conditions were reviewed as part of the planning effort. This information is used in the hydrologic analysis to predict runoff rates and volumes for the purposes of facility evaluation. The identification of land uses abutting the drainageways is also useful in the identification of feasible plans for stabilization and aesthetic treatment of the creek. Presented on Figure II-3 is the proposed land use map used in the evaluation of impervious land densities discussed in the hydrologic section of this report. Figure II-3 is not intended to reflect the future zoning or land use policies of the City or the County.

The land use information within the Banning-Lewis Ranch property was obtained from Aries Properties during the time the draft East Fork Sand Creek Drainage Basin Planning Study was being prepared. The land use information was again reviewed with the City of Colorado Springs Department of Planning and was found to be appropriate for use in the estimation of hydrology for the East Fork Basin. The location of future arterial streets and roadways within


the Banning Lewis property were obtained from the Banning-Lewis Ranch master plan. The location of roadways offsite from the Banning Lewis-Ranch were obtained from the El Paso County Major Transportation Plan dated 1988.


#### **Park Land and Open Space**

An inventory of park land and public open space was prepared. Many times, the combination of the drainageway and adjacent park lands can be used to visually extend the limits of a park or open space. The drainageway can also act to link parks and other land uses within the basin if multiple use trails are incorporated into the channel section(s). The Sand Creek drainageway has been identified as a major trail corridor within the City of Colorado Springs Trails Plan. Park land designated within the Banning-Lewis Ranch master plan were taken into account during the siting of stormwater facilities within the Banning-Lewis property.

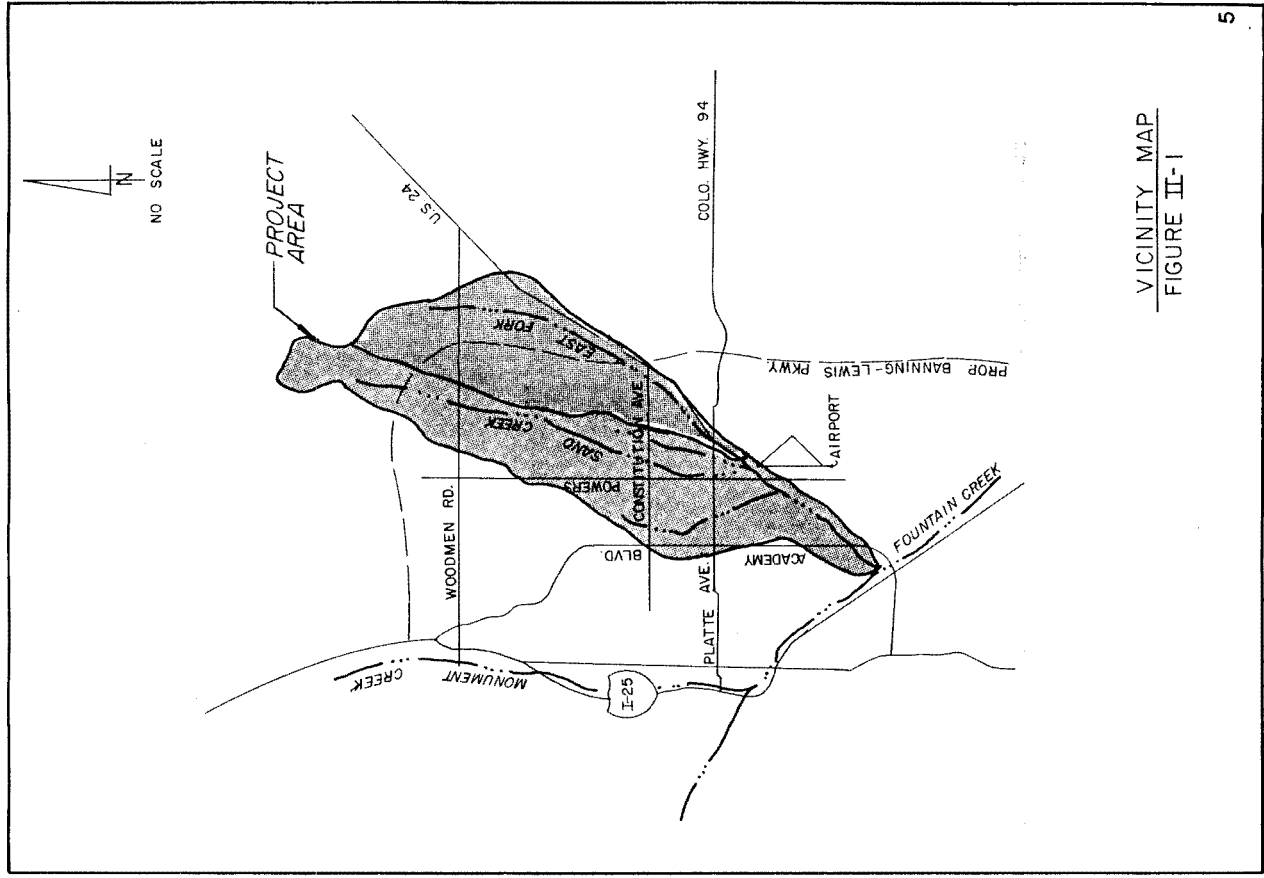

VICINITY MAP  
FIGURE II-1

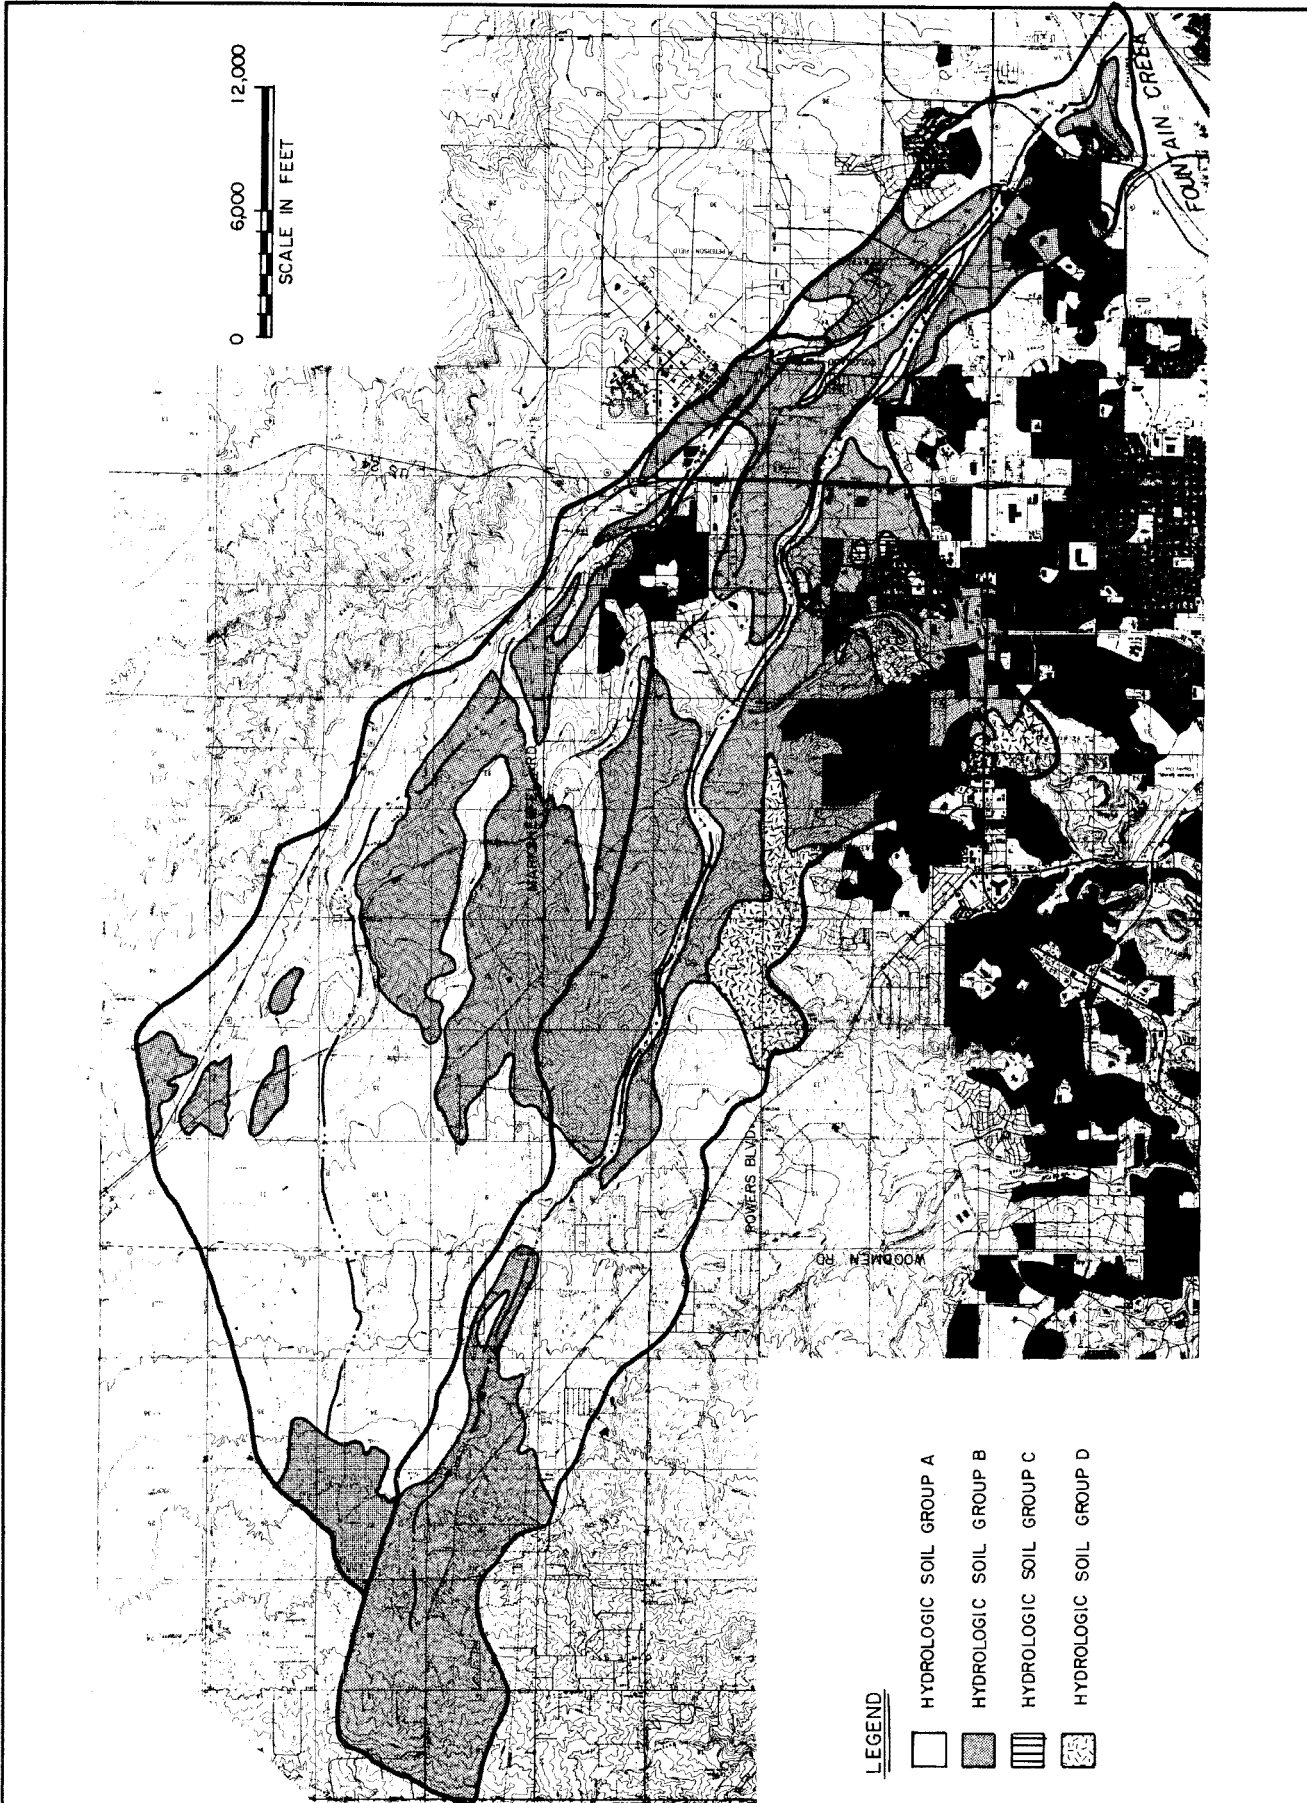

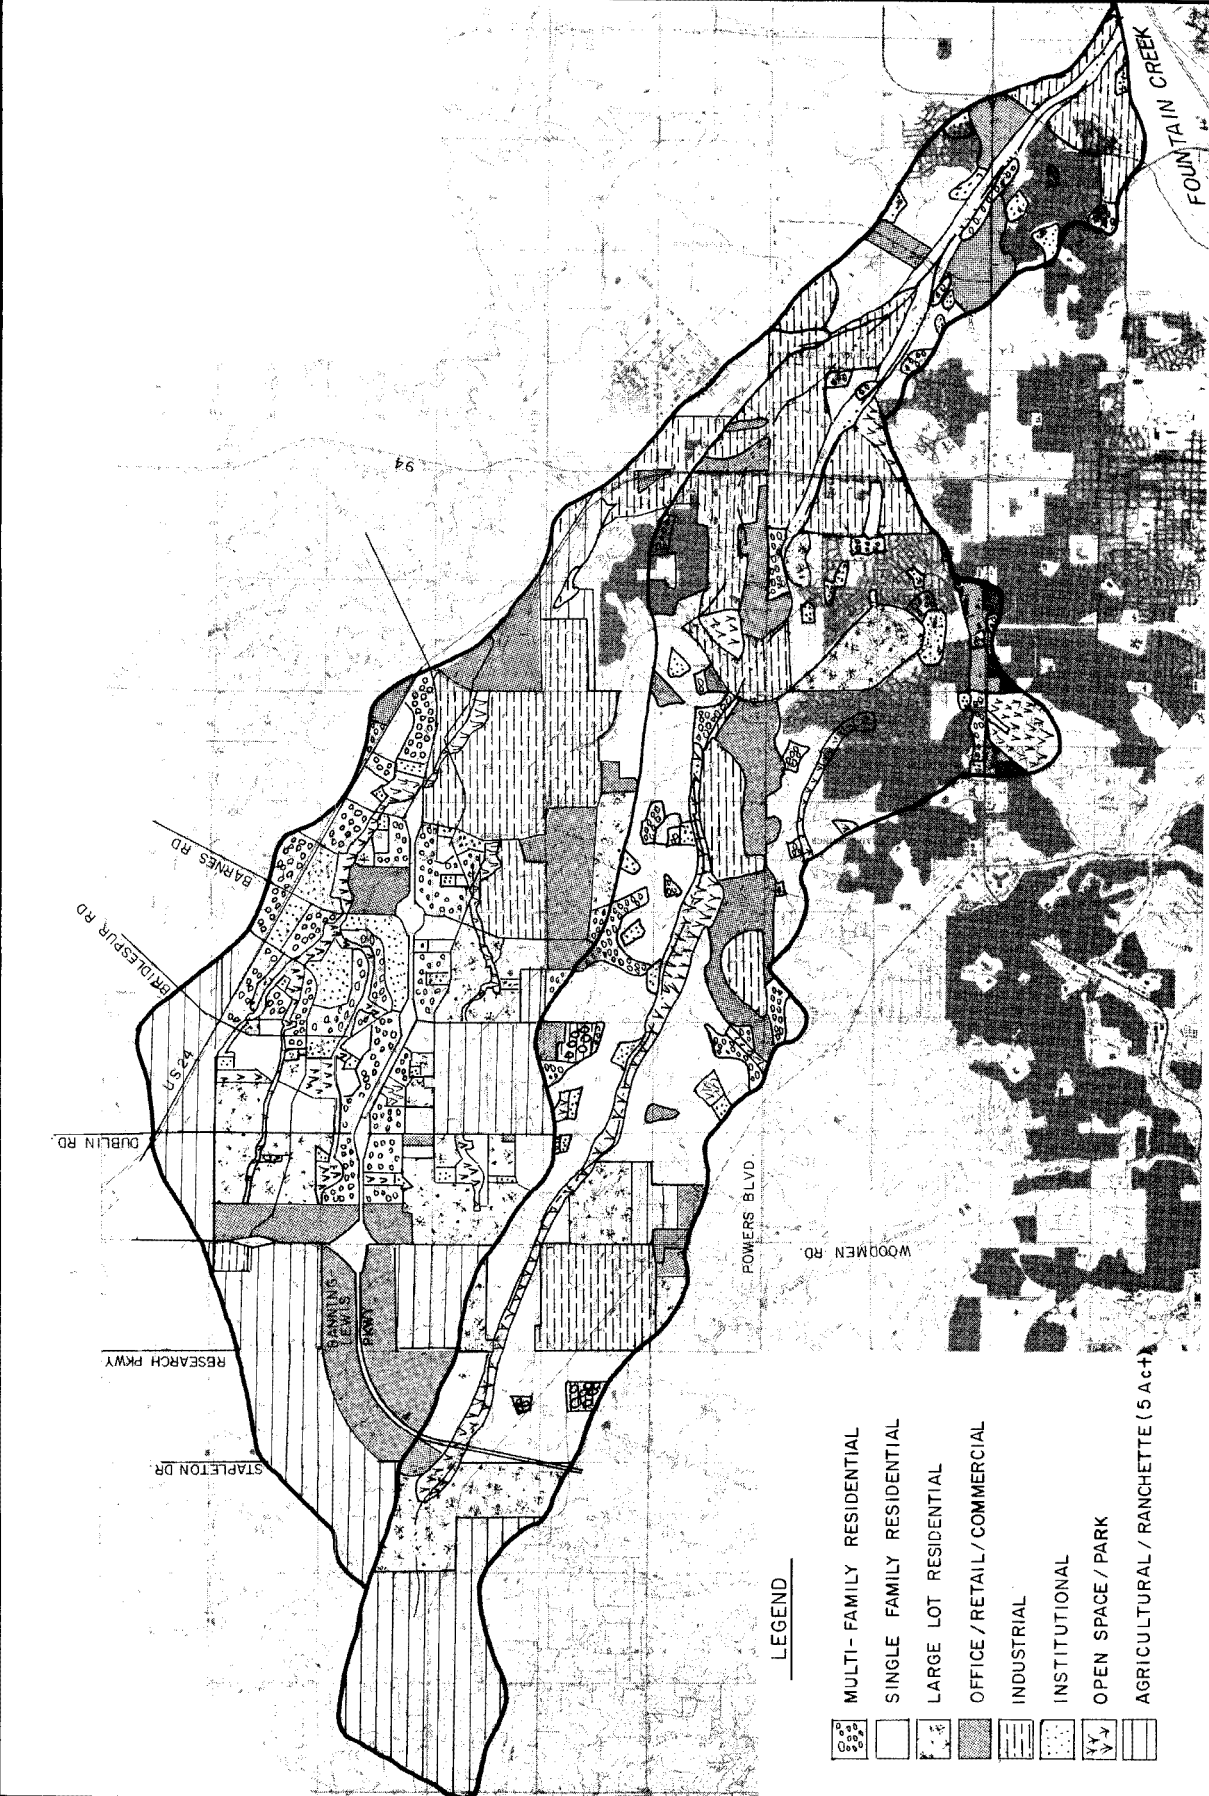

LEGEND



- MULTI-FAMILY RESIDENTIAL
- SINGLE FAMILY RESIDENTIAL
- LARGE LOT RESIDENTIAL
- OFFICE / RETAIL / COMMERCIAL
- INDUSTRIAL
- INSTITUTIONAL
- OPEN SPACE / PARK
- AGRICULTURAL / RANCHETTE (5 ac+)



THIS DRAWING IS A MASTER PLANNING SHEET REPRESENTING PRELIMINARY AND CONCEPTUAL ENGINEERING. IT SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES.

CHANNEL IMPROVEMENTS		CHANNEL TYPE
SEGMENT NO.	BOTTOM WIDTH (FT)	
145	16	100-YEAR CONC. CHANNEL, 4' DEPTH
146-1	10	
146-2	N/A	EXISTING CHANNEL TO REMAIN

FOR PROFILE SEE SHEETS CTP-2 AND CTP-3

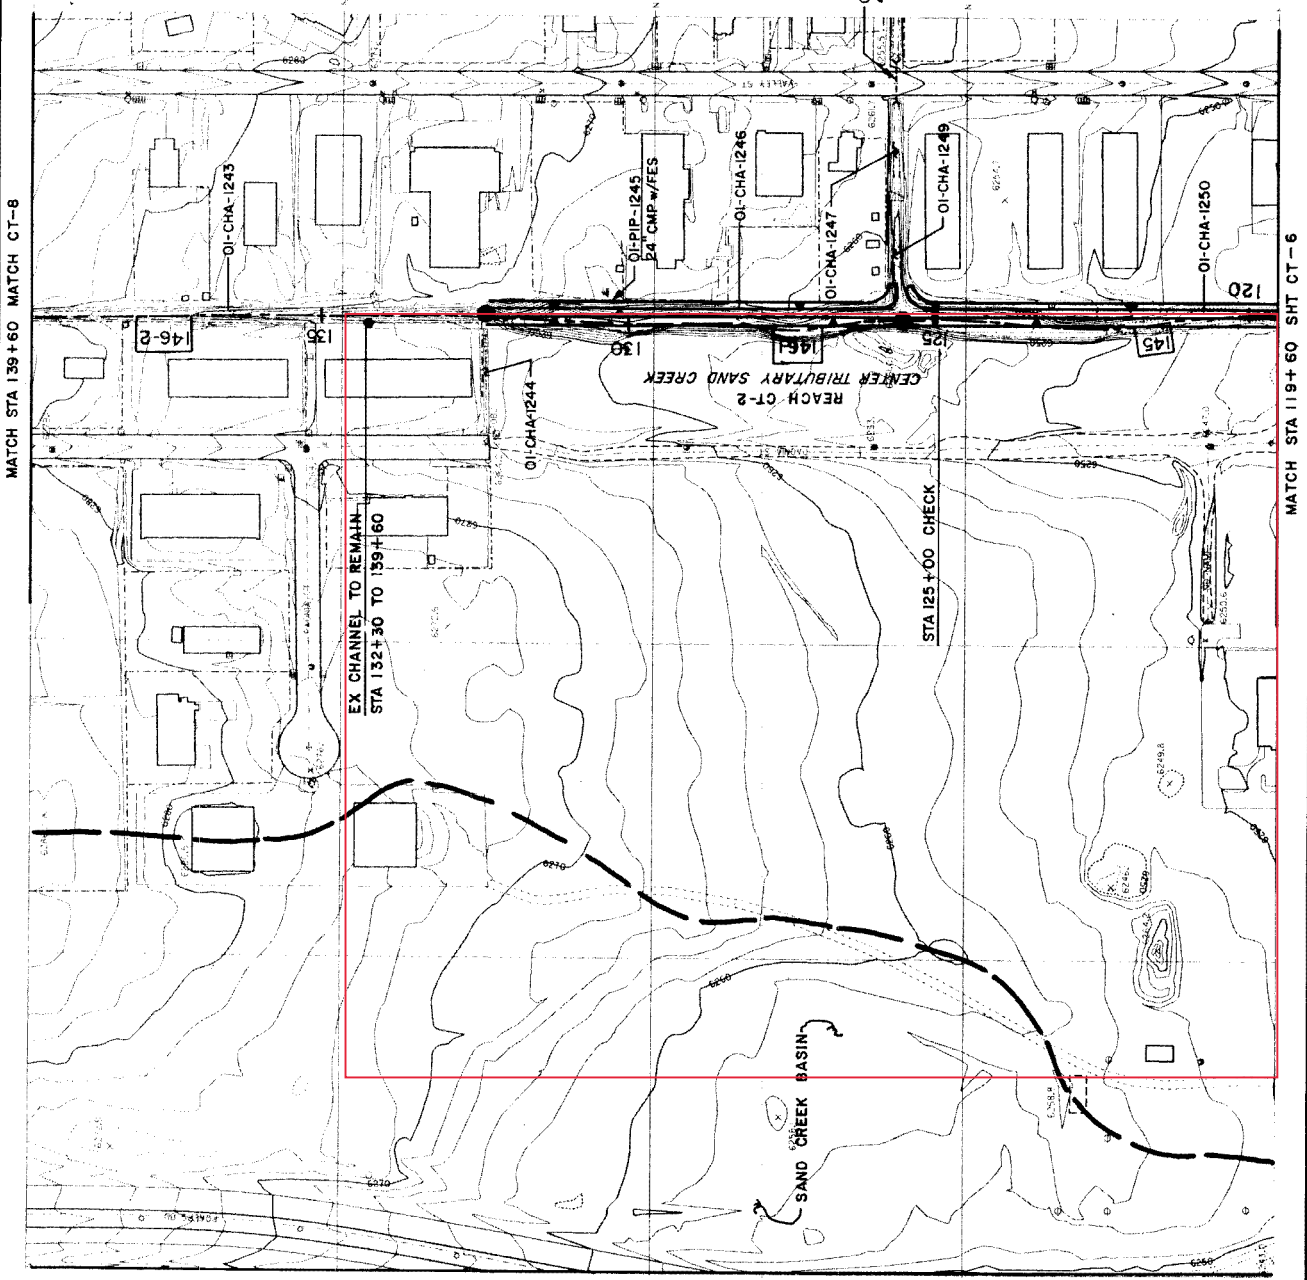


Kiowa Engineering Corporation  
 419 W. Blou Street  
 Colorado Springs, Colorado  
 80905-1308



**SAND CREEK DRAINAGE  
 BASIN PLANNING STUDY  
 PRELIMINARY DESIGN PLANS**

Project No. 90-04-09  
 Date: 9/7/92  
 Designer: EAW  
 Checker: DMW  
 Rev: 1

**CT-7**



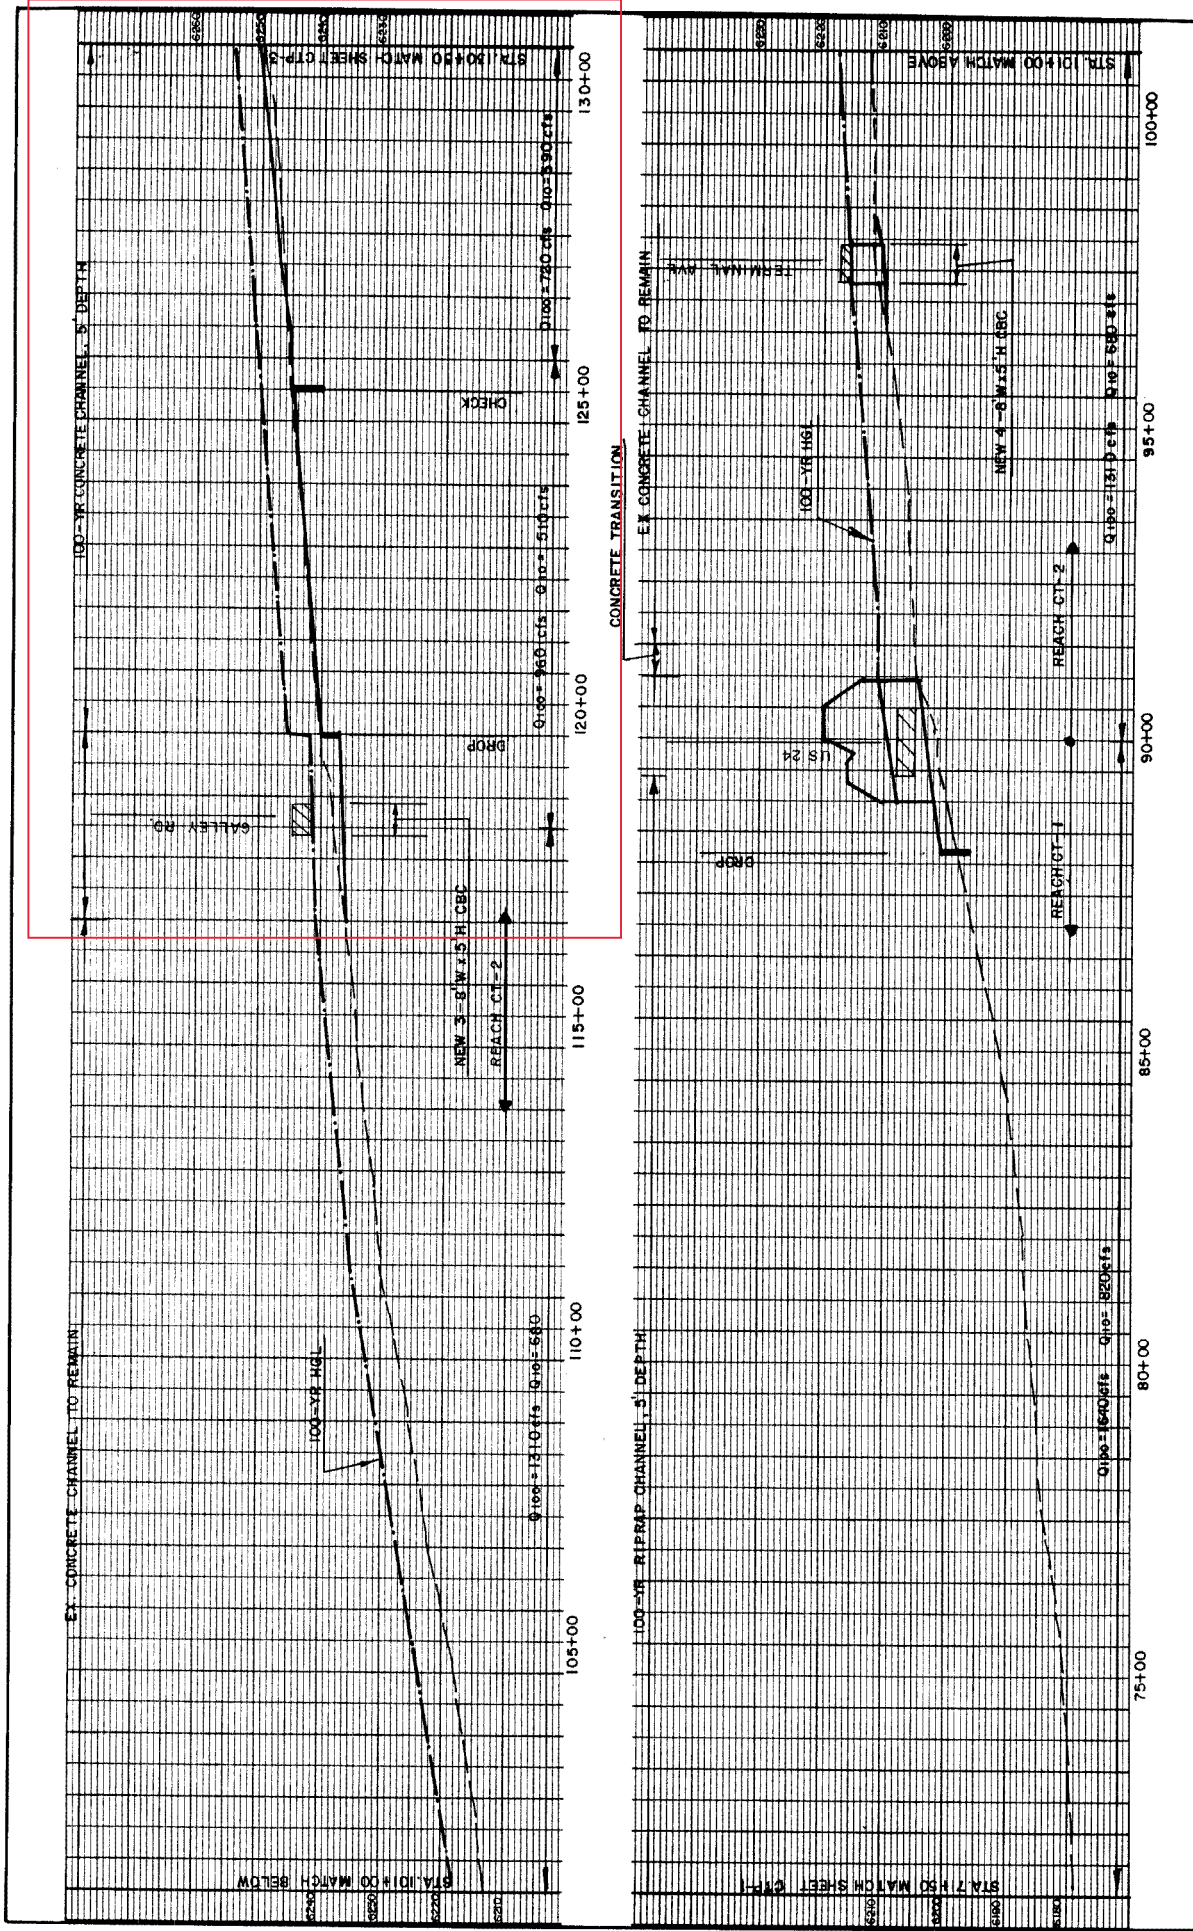

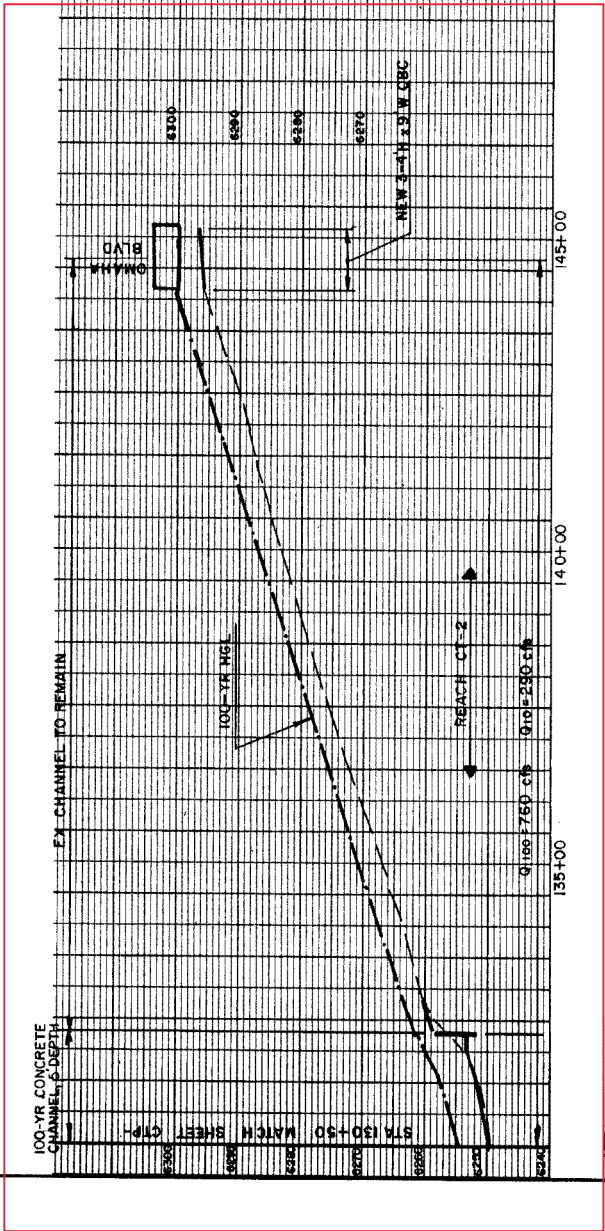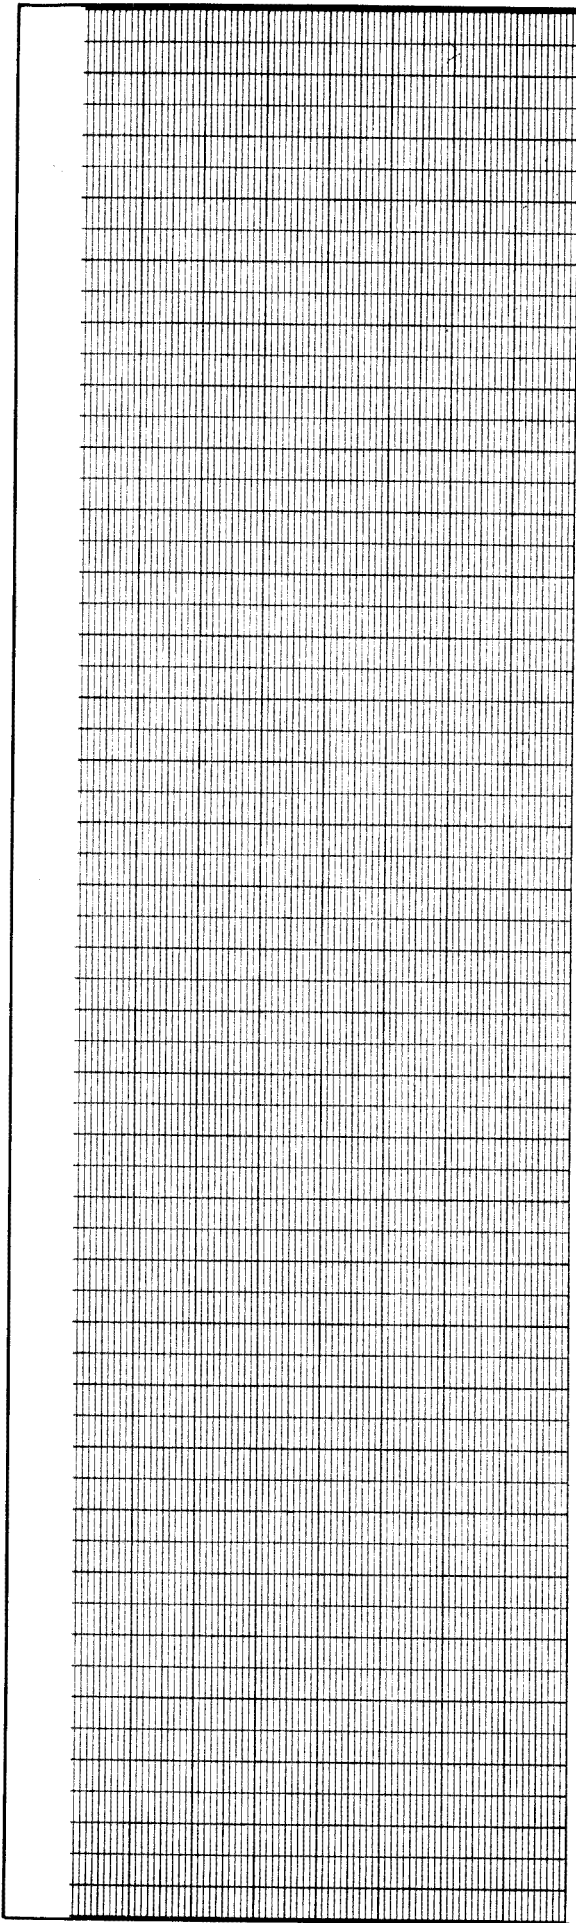

Kiowa Engineering Corporation	SAND CREEK DRAINAGE BASIN PLANNING STUDY PRELIMINARY DESIGN PROFILES	CITY OF COLORADO SPRINGS EL PASO COUNTY, COLORADO
CENTER TRIBUTARY SAND CREEK Station 130+50 to 144+50		

DESIGNED: AW DATE: 7/92  
 CHECKED: EAK DATE: 7/92  
 REVISION: \_\_\_\_\_ DATE: \_\_\_\_\_

CTP-3

TABLE VIII-4: SAND CREEK DRAINAGE BASIN PLANNING STUDY  
ROADWAY CULVERT CROSSING COST ESTIMATE

SAND CREEK BASINS									
ROADWAY	REACH NUMBER	DRAINAGEWAY SEGMENT	CROSSING TYPE	LENGTH	UNIT	UNIT COST	TOTAL COST	TOTAL REIMBURSABLE COST	TOTAL COST
BANNING-LEWIS PRKW	SC-8	186	6'Hx10'W CBC	120	LF	\$390	\$46,800	\$46,800	\$46,800
ARROYO LANE	SC-9	171	6'Hx12'W CBC	80	LF	\$510	\$40,800	\$0	\$40,800
VOLLMER ROAD	SC-8	169	60-INCH CMP	80	LF	\$120	\$9,600	\$0	\$9,600
"	SC-9	173	"	80	LF	\$120	\$9,600	\$0	\$9,600
BURGESS ROAD	SC-9	176	42-INCH CMP	80	LF	\$75	\$6,000	\$0	\$6,000
"	SC-9	178	2-42-INCH CMP	80	LF	\$150	\$12,000	\$0	\$12,000
CENTER TRIBUTARY									
TERMINAL AVENUE	CT-2	144	4-5'Hx8'W CBC	60	LF	\$1,200	\$72,000	\$0	\$72,000
OMAHA BOULEVARD	CT-2	146-2	3-4'Hx9'W CBC	80	LF	\$900	\$72,000	\$0	\$72,000
WEST FORK SAND CREEK									
WOOTEN ROAD	WF-1	153	2-4'Hx6'W CBC	100	LF	\$480	\$48,000	\$0	\$48,000
EDISON AVENUE	WF-1	153	2-4'Hx6'W CBC	60	LF	\$240	\$14,400	\$0	\$14,400
PALMER PARK BLVD.	WF-1	154-2	2-4'Hx10'W CBC	80	LF	\$540	\$43,200	\$0	\$43,200
CHICAGO RIVER	WF-1	165-1	4'Hx8'W CBC	220	LF	\$270	\$59,400	\$0	\$59,400
HALF MOON DRIVE	WF-1	165-2	4'Hx6'W CBC	60	LF	\$240	\$14,400	\$0	\$14,400

TOTAL CULVERT CONSTRUCTION COSTS, SAND CREEK \$1,902,600 \$1,111,000

Table VIII-7:  
SAND CREEK DRAINAGE BASIN PLANNING STUDY  
BRIDGE CROSSING COST ESTIMATE  
SAND CREEK DRAINAGE BASINS

ROADWAY	REACH NUMBER	DRAINAGEWAY SEGMENT	CROSSING TYPE	JURISDICTION CITY	COUNTY	SIZE	UNIT	UNIT COST	TOTAL COST COUNTY	TOTAL COST CITY
SAND CREEK										
CHELTON ROAD	SC-1	115	210' TWO-SPAN BRIDGE	X		16800	SF	\$80	\$0	\$1,344,000
STEFSON HILLS BLVD.	SC-6	130	3-8'Hx10'W CBC	X		200	LF	\$1,110	\$0	\$222,000
JEREMIAH SMITH RD.	SC-6	137	3-8'Hx10'W CBC	X		60	LF	\$1,110	\$0	\$66,600
PETERSON ROAD	SC-6	141	80' CLEAR SPAN BRIDGE	X		6400	SF	\$80	\$0	\$512,000
DUBLIN BOULEVARD	SC-7	141	80' CLEAR SPAN BRIDGE	X		6400	SF	\$80	\$0	\$512,000
MARKSHEFFEL ROAD	SC-8	151	3-10'Hx10'W CBC	X		80	LF	\$1,260	\$100,800	\$0
RESEARCH PARKWAY	SC-8	163	4-8'Hx10'W CBC	X		80	LF	\$1,560	\$124,800	\$0
BANNING-LEWIS PKWY	SC-8	187	4-8'Hx10'W CBC	X		80	LF	\$1,560	\$124,800	\$0
CENTER TRIBUTARY										
W. FRONTAGE ROAD	CT-1	142	3-6'Hx16'W CBC	X		60	LF	\$1,770	\$106,200	\$0
US 24 BYPASS	CT-1	142	3-6'Hx16'W CBC	X		150	LF	\$1,410	\$211,500	\$0
E. FRONTAGE RD, US 24	CT-1	142	3-6'Hx16'W CBC	X		60	LF	\$1,410	\$84,600	\$0
BIOU STREET, US 24	CT-1	142	3-6'Hx16'W CBC	X		60	LF	\$1,410	\$84,600	\$0
PLATIE AVENUE, US 24	CT-2	142	3-6'Hx16'W CBC	X		120	LF	\$1,410	\$169,200	\$0
GALLEY ROAD	CT-4	144	3-5'Hx8'W CBC	X		100	LF	\$900	\$90,000	\$0
WEST FORK SAND CREEK										
GALLEY ROAD	WF-2	155	54' CLEAR SPAN BRIDGE	X		5130	SF	\$80	\$0	\$410,400
PALMER PARK BLVD.	WF-2	156	54' CLEAR SPAN BRIDGE	X		5130	SF	\$80	\$0	\$410,400
CONSTITUTION AVE.	WF-3	159	40' CLEAR SPAN BRIDGE	X		3200	SF	\$80	\$0	\$256,000
MAIZELAND ROAD	WF-3	170	30' CLEAR SPAN BRIDGE	X		2400	SF	\$80	\$0	\$192,000
SO. CAREFREE	WF-3	170	2-6'Hx15'W CBC	X		80	LF	\$1,200	\$0	\$96,000


TOTAL BRIDGE CONSTRUCTION COSTS, SAND CREEK \$1,096,500 \$4,021,400

# FLOOD INSURANCE STUDY



## EL PASO COUNTY, COLORADO, AND INCORPORATED AREAS

El Paso County

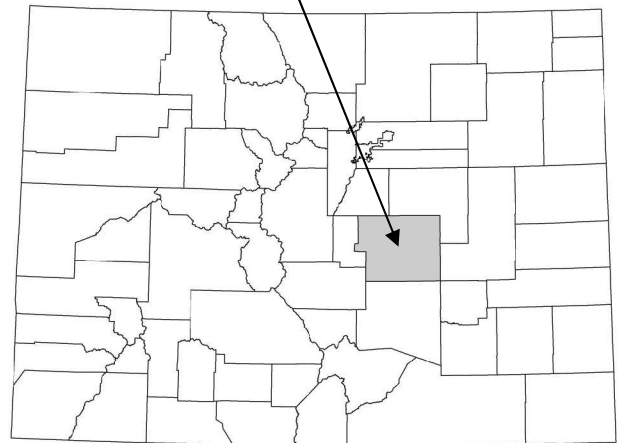

COMMUNITY NAME	COMMUNITY NUMBER
CALHAN, TOWN OF	080192
COLORADO SPRINGS, CITY OF	080060
EL PASO COUNTY (UNINCORPORATED AREAS)	080059
FOUNTAIN, CITY OF	080061
GREEN MOUNTAIN FALLS, TOWN OF	080062
MANITOU SPRINGS, CITY OF	080063
MONUMENT, TOWN OF	080064
PALMER LAKE, TOWN OF	080065
RAMAH, TOWN OF	080066

Revised: December 7, 2018



Federal Emergency Management Agency

FLOOD INSURANCE STUDY NUMBER  
08041CV007A

NOTICE TO  
FLOOD INSURANCE STUDY USERS

Communities participating in the National Flood Insurance Program have established repositories of flood hazard data for floodplain management and flood insurance purposes. This Flood Insurance Study (FIS) report may not contain all data available within the repository. It is advisable to contact the community repository for any additional data.

Part or all of this FIS report may be revised and republished at any time. In addition, part of this FIS report may be revised by the Letter of Map Revision process, which does not involve republication or redistribution of the FIS report. It is, therefore, the responsibility of the user to consult with community officials and to check the community repository to obtain the most current FIS report components.

This FIS report was revised on December 7, 2018. Users should refer to Section 10.0, Revisions Description, for further information. Section 10.0 is intended to present the most up-to-date information for specific portions of this FIS report. Therefore, users of this report should be aware that the information presented in Section 10.0 superseded information in Sections 1.0 through 9.0 of this FIS report.


Initial Countywide FIS Report Effective Date: March 17, 1997

First Revised Countywide FIS Report Effective Date: August 23, 1999 - to add base flood elevations, to add special flood hazard areas, and to change special flood hazard areas.

Second Revised Countywide FIS Report Effective Date: December 7, 2018 - to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.



FLOOD PROFILES

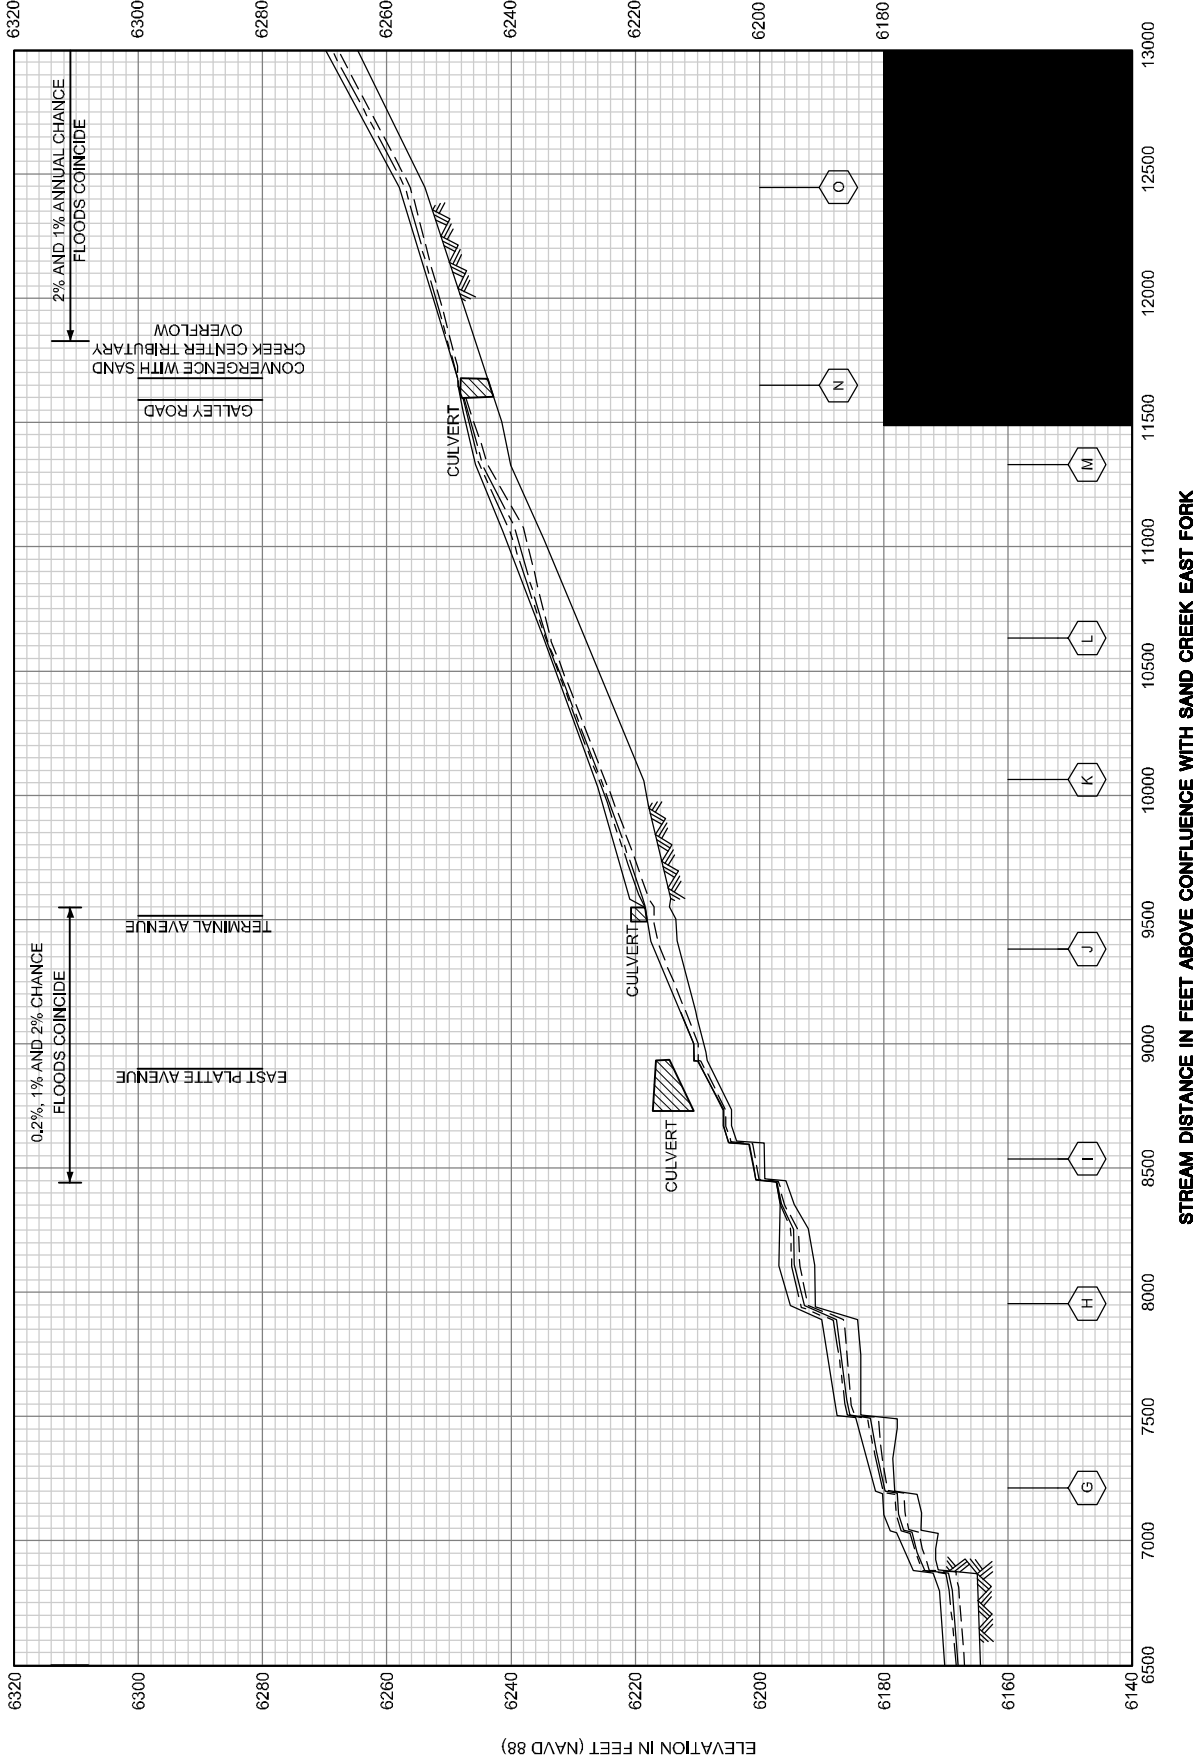

**SAND CREEK - CENTER TRIBUTARY  
CHANNEL ANALYSIS REPORT  
FOR  
SOLACE APARTMENTS**

**Prepared For:  
Jackson Dearborn Partners  
404 S. Wells Street, Suite 400  
Chicago, IL 60607  
(734) 216-2577**

**June 30, 2020  
Project No. 25174.00**

**Prepared By:  
JR Engineering, LLC  
5475 Tech Center Drive  
Colorado Springs, CO 80919  
719-593-2593**

**PCD File NO. SP201**

# CONTENTS

---

<b>OVERVIEW</b> .....	<b>3</b>
<b>GENERAL LOCATION AND DESCRIPTION</b> .....	<b>3</b>
LOCATION.....	3
DESCRIPTION OF PROPERTY .....	3
FLOODPLAIN STATEMENT.....	3
<b>PREVIOUS SAND CREEK STUDIES</b> .....	<b>3</b>
<b>DRAINAGE DESIGN CRITERIA</b> .....	<b>8</b>
DEVELOPMENT CRITERIA REFERENCE .....	8
HYDROLOGIC CRITERIA.....	8
HYDRAULIC CRITERIA.....	8
<b>SUMMARY</b> .....	<b>8</b>
<b>REFERENCES:</b> .....	<b>10</b>

## APPENDICES

- A. Figures and Exhibits
- B. Hydraulic Calculations
- C. Reference Material

# OVERVIEW

---

This report was prepared to provide design information for the existing Sand Creek -Center Tributary Drainageway as part of the Solace Apartment development. This document is the Channel Analysis report for the Solace Apartments. The Sand Creek-Center Tributary Drainageway has been studied as part of a Flood Insurance Study (FIS) for El Paso County Colorado, Volume 7 of 8, revised December 7, 2018 and Sand Creek Drainage Basin Planning Study, dated January 1993. Existing flow rates from the Sand Creek Planning Study were used as the basis for the design of the existing channel condition.

## GENERAL LOCATION AND DESCRIPTION

---

### Location

The proposed Solace Apartments, known as “Solace” from herein, is a parcel of land located in Section 7, Township 14 South, Range 65 West of the 6<sup>th</sup> Principal Meridian in El Paso County, Colorado. Solace is a 28.99 acre, urban, multifamily-development and is comprised of 16 apartment buildings and associated infrastructure. Solace is bound by existing industrial developments to the North and vacant land to the West. Galley Road bounds the property to the south and existing light industrial businesses to the east. A vicinity map of the area is presented in Appendix A.

### Description of Property

Solace is currently unoccupied and undeveloped. The existing ground cover is sparse vegetation and open space, typical of a Colorado rolling range land condition. In general, Solace slopes from northwest to southeast. The existing conditions of the Sand Creek -Center Tributary Drainageway on the site are heavily wooded for the length of the channel throughout the Solace site.

Per an NRCS web soil survey of the area, Solace is made up of Type B soils with a very small percentage of Type A in the northwest corner of the property. This Type B soil is a blendon sandy loam. This soil type has a moderate infiltration rate when thoroughly wet. It also consists of moderately deep or deep, moderately well drained or well drained soil. A soil survey map has been presented in Appendix A.

### Floodplain Statement

Based on the FEMA FIRM Map numbers 08041C0751G & 08041C0752G, dated December 7, 2018, a portion of the existing drainageway lies within Zone AE and Zone X. Zone AE is defined as area subject to inundation by the 1-percent-annual-chance flood event and is a flood hazard area. Zone X is defined as area outside the Special Flood Hazard Area (SFHA) and higher than the elevation of the 0.2-percent-annual-chance (or 500-year) flood. The FIRM Map has been presented in Appendix A. Currently a portion of the Solace site lies within Zone AE at the extension of Paonia Street to Galley Road, as seen in FEMA FIRM Map number 08041C0752G.

## PREVIOUS SAND CREEK STUDIES

---

Solace lies within Sand Creek Drainage Basin based on the “*Sand Creek Drainage Basin Planning Study*” prepared by Kiowa Engineering in January 1993.

The Sand Creek Drainage Basin covers approximately 54 square miles in unincorporated El Paso County, CO. The Sand Creek Drainage Basin is tributary to Fountain Creek. In its existing condition, the basin is comprised of developed land with the exception of the Solace Parcel which is comprised of rolling rangeland with fair to good vegetative cover associated with Colorado’s semi-arid climate. The natural Drainageway within the site limits is typically deep and narrow with a well-defined flow path in most areas. Anticipated land use for the Solace parcel includes multifamily residential and open space.

As part of its drainage research, JR Engineering reviewed the following drainage studies, reports and LOMRs:

- Sand Creek Drainage Basin Planning Study prepared by Kiowa Engineering Corporation in January 1993.
- Flood Insurance Study– El Paso County, Colorado & Incorporated Areas Vol 7 of 8, December 2018.
- LOMR- Case No. 05-08-0368P Federal Emergency Management Agency, May 23, 2007.

The *Sand Creek Drainage Basin Planning Study* was used to establish a stormwater management plan for the existing and future stormwater infrastructure needs within the Sand Creek Drainage Basin. The *Sand Creek Drainage Basin Planning Study* conducted a hydrologic analysis using a runoff model named the Soil Conservation Service (SCS) Computer Program for the Project Formulation Hydrology (TR20). Based on provided drainage maps and analysis, in its existing condition, the Sand Creek-Center Tributary Drainageway contains a 100-year flow of 720 cfs at upstream station 1053 then jumps to 960 cfs at station 1030 in Sand Creek along Solace’s east property line. The flow then changes again at station 1014, to a value of 956 cfs, where the flow from the secondary drainageway on Paonia Street converges with the Sand Creek Drainageway, this flow was based on JR Engineering analysis. These flows were used in the model as they were depicted as being the flows present in the project section of the Sand Creek Tributary Drainageway as called out in *Sand Creek Drainage Basin Planning Study*. The major Sand Creek-Center Tributary Drainageway conveys the stormwater south along the eastern property line where it ultimately outfalls into the Fountain Creek. JR Engineering also performed a hydrologic analysis to determine the flows in the Sand Creek-Center Tributary Drainageway and arrived at similar results to those shown in the *Sand Creek Drainage Basin Planning Study*, thus verifying the validity of these flows. These basin calculations show that the 720-960 cfs, based on the *Sand Creek Drainage Basin Planning Study*, are still valid for this existing condition, a summary table of the flows in the Sand Creek Drainageway based on various studies can be found below.

SOLACE APARTMENTS		
Sand Creek Center Tributary Flow Summary Table		
Report/Study	Location	Flow (cfs)
<i>Sand Creek DBPS, Kiowa Engineering, Rev. March 1996, Table III-2</i>	DP 45, @ Galley Rd. Crossing	1,340
<i>Sand Creek DBPS, Kiowa Engineering, Rev. March 1996, CTP-2</i>	@ STA 125+00	960
<i>Sand Creek DBPS, Kiowa Engineering, Rev. March 1996, CTP-2</i>	@ STA 132+30	720
<i>Flood Insurance Study, El Paso County, Rev. December 7, 2018</i>	Section N, @ Galley Road	723
<i>JR Engineering October 2019</i>	@ Galley Road	956

FEMA prepared a revised FIS for El Paso County Colorado, Volume 7 of 8, dated December 7, 2018. The effective floodplain for the site is shown on the FIRM 08041C0752G, revised to reflect LOMR, dated May 23, 2007. The study area of the FIS where the Sand Creek Drainageway crosses Galley Road, was found to overtop the culverts and flow onto the road. According to the FIS, this crossing has a 10% annual chance of flooding and is located in Zone AE of the FIRM. This location is a Special Flood Hazard Area (SFHA) inundated by the 100-year flood, Zone AE (base flood elevations determined). The *Sand Creek Drainage Basin LOMR* was executed on May 23, 2007. The LOMR revised the flood zone on the area south of Galley Road. See FIRM Map Panel 08041C0752G for limits of LOMR study and revised flood zones, presented in Appendix C.

To the west of the Sand Creek-Center Tributary Drainageway is a secondary Drainageway that captures the flow coming from the west side of Paonia Street. This drainage way is located at the proposed extension of Paonia Street to meet Galley Road. The flows created by the secondary drainageway and the development north of the site will be captured on the Solace site, and transported to the Sand Creek-Center Tributary Drainageway. According to *Sand Creek Drainage Basin LOMR*, the flow present in this secondary drainageway in a 1-percent-annual-chance flood event is 213 cfs. This was calculated by use of the LOMR maps, and evaluating the difference in flow as the Sand Creek Center Tributary Drainageway splits as it crosses Omaha Boulevard. Section R of the FEMA Map Panel 08041C0752G, shows the split as the flow present in the channel drops to 421 cfs from 634 cfs at section S just upstream. The difference in these flows is 213 cfs this flow is assumed to overtop the road at Omaha Boulevard crossing structure, and travel west to Paonia Street and is routed south in the Sand Creek Center Tributary onto the Solace site. Just north of the Solace site, exist a concrete channel that diverts flows present on the east side of Paonia in to the creek, however the size of this channel will not convey all flows present in Paonia to the Sand Creek-Center Tributary Drainageway, therefore improvements are necessary to mitigate the offsite flows. To mitigate offsite flows from coming onto the site, the future Paonia Street will be graded with a super elevation that will direct the majority of the flows present on Paonia towards the east side of the road. These flows will be captured in a spillway adjacent to the road that will route them into the existing

Sand Creek-Center Tributary Drainageway. The spillway is a 50'-80' wide riprap lined channel that will safely direct flows off Paonia Street and into the existing drainageway. Flow calculations for the overflow can be found in Appendix B, along with flow capacity calculations for existing Paonia Street & existing concrete channel north of the site. In addition to the spillway, an inlet has been proposed at the northern property line to capture offsite flows coming from the northern developments along the west side of existing Paonia Street. This inlet will only capture gutter flows traveling down the west side of Paonia Street from the northern development and the existing secondary drainage way for the Sand Creek Drainageway that will become the extension of Paonia Street. The proposed inlet and storm sewer will convey the captured flows to an onsite detention pond and ultimately outfall to the Sand Creek Drainageway. This outfall will incorporate an energy dissipation structure that utilizes grouted boulders in order to reduce the velocities of the flows prior to entering the drainageway. This energy dissipation structure will prevent erosion and any other negative impacts to the drainageway.

### Channel Deficiencies

The *Sand Creek Drainage Basin Planning Study* performed a hydraulic analysis of the Sand Creek-Center Tributary Drainageway between Galley Road and Paonia Street, and an analysis of the crossing structure for Sand Creek at Galley Road. For the crossing structure at Galley Road they determined that the existing crossing structures were inadequate for the demands of the Drainageway and would require improvements to expand the capacity of these structures. These results can be seen in Table IV-1 Summary of Hydraulic Structures – Crossings: Sand Creek Drainage Basin Planning Study shown below. The Study proposed improvements to the existing crossing structures by replacing them with 3-8'Wx 5'H Concrete Box Culverts.

LOCATION	REACH #	SIZE	TYPE	CAPACITY EXISTING	CAPACITY FUTURE (1)	COMMENTS
Airport Road	CT-1	5-6'x8'	BOX CULVERT	ADEQUATE	ADEQUATE	
Pikes Peak Ave.	CT-1	NONE		INADEQUATE	INADEQUATE	POWERS BLVD. OVERTOPPED FREQUENTLY BETWEEN BIJOU ST. AND PIKES PEAK AVE.
Powers Blvd.	CT-1	VARIOUS	METAL PIPE	INADEQUATE	INADEQUATE	
Platte Ave (US 24)	CT-1	8'x4'	BOX CULVERT	INADEQUATE	INADEQUATE	APPROACH CHANNEL IN NEED OF REALIGNMENT
Terminal Avenue	CT-2	2-4'x8'	BOX CULVERT	INADEQUATE	INADEQUATE	
Galley Road	CT-2	3-42"x72"	METAL ARCH PIPE	INADEQUATE	INADEQUATE	
Omaha Boulevard	CT-2	2-36"x57"	METAL ARCH PIPE	INADEQUATE	INADEQUATE	

The study also found the existing channel for the Sand Creek-Center Tributary Drainageway between Galley Road and Paonia Street to be inadequate for the given flow rate. The report says that the existing channel has limited maintenance access, leading to the channel degrading and being filled with obstructions. Those findings can be seen in Table IV-2 Summary of Hydraulic Structures – Channels: Sand Creek Drainage Basin Planning Study. The *Sand Creek Drainage*

Basin Planning Study recommended improvements to the existing channel by lining the channel with concrete.

LOCATION FROM / TO	REACH #	DIMENSIONS			TYPE	CAPACITY (1)		COMMENTS
		TW (ft)	SS	DEPTH (ft)		ADQ	INADQ	
CENTER TRIBUTARY								
East Fork Sand Creek to Airport Road	CT-1	45	2:1	6	Riprap lined trapezoidal channel	X	X	Riprap has failed or is non-existent along some portions of this segment of the Center Tributary
Pikes Peak to Bijou St.	CT-1			N/A	Rubble lined ditches along Powers Blvd.			Flow passes over and along Powers Blvd. street section on a frequent basis. Road closures common.
Bijou St. to Platte Ave.	CT-1			N/A	Unlined, natural.			Overbanks vegetated, channel dry with sand invert, no vegetation. Channel eroded at outlet of US24 culvert.
Platte Ave. to Terminal Ave.	CT-2	15-25	1:1	4-6	Trapezoidal concrete lined.	X		Channel has adequate capacity.
Terminal Avenue to Galley Road	CT-2	21	1:1	5	Trapezoidal concrete lined.	X		Channel has adequate capacity.
Galley Road to Paonia Ct. (ext)	CT-2	30-40	varies	4-5	Unimproved segment.		X	Channel is degraded and filled with debris. Poor maintenance access.
Paonia Ct. to Cheaha Rivd.	CT-2	21	1:1	5	Trapezoidal concrete lined channel.	X		Maintenance access poor. Debris and trash in channel.

The GeoHecRas model results completed with this report contain similar findings to those in the drainage basin planning study. This model was based on the existing channel conditions; a model will be created for the sites proposed conditions in the final drainage report. Average velocities of 10-12 fps for a majority of the channel reach exceed allowable limits for an unprotected channel. The current Galley road crossing structures lack of capacity also leads to overtopping of the road during these events. This report confirms that both this Sand Creek channel reach and Galley Road crossing structures are inadequate for the 100-yr storm event.

## Channel Improvement Recommendations

The Sand Creek Drainage Basin Planning Study (DBPS) concluded that the Sand Creek-Center Tributary Drainageway channel, in its current state, is inadequate to handle the historical flows tributary to the channel. This report falls in line, indicating that improvements shall be made to the channel in order to provide adequate capacity and prevent erosion. In the DBPS improvements are also designated for the crossing structures at Galley Road to provide adequate capacity and prevent overtopping of the

road. Upon further investigation, this report found that overtopping of Galley Road appears to be addressed via the overflow structure and associate downstream bank protections shown in



Figure 1: Existing Drainage Structures at Galley Road (Viewed from South)



Figure 1. This weir was analyzed to determine the effectiveness to safely pass overtopping flows. From the HEC-RAS model, it was determined that approximately 581 cfs overtops the roadway during a 100-year event. The weir in its current configuration could only adequately pass approximately 40 cfs of this flow. On the north side of the Galley road crossing, there is a section of roadway without curb & gutter; this allows the water transported along the north half of galley road to directly flow into the Sand Creek Center Tributary Drainageway. A picture of this curb opening is shown below in figure 2.



Figure 2: Curb Opening on North Half of the Galley Road Crossing  
(Looking to the North)

This analysis notes existing overtopping, further discussion with the county engineer to discuss potential solutions is recommended. One possible solution is that the existing culverts be replaced to prevent overtopping at Galley Road by upsizing to a larger culvert(s). Ultimately, culvert improvements will be necessary when the County deems the historic overtopping of Galley Road above acceptable tolerance. Currently, no adjacent structures are impacted by this overtopping. Weir calculations can be found in the appendix.

Based upon the findings to the *Sand Creek Drainage Basin Planning Study* and the conforming GeoHecRas modeling contained in this report, potential recommended channel improvements include:

- Widening of the channel west bank to reduce flow depth, thus corresponding velocities
- Lining portions of the channel with riprap or other protective surfaces
- Adding check structures and potentially drop structures to reduce channel grade, a conceptual profile can be seen in Appendix A.
- Replacing existing culverts at Galley Road to prevent roadway overtopping

Stable slopes of 1% were chosen for the channel based on stable slope specified by the *The Sand Creek Drainage Basin Planning Study (DBPS.)*

## CONCEPT COST ESTIMATE

---

Below is Conceptual Cost Estimate for the proposed channel improvements to the Sand Creek-Center Tributary Drainageway.

**Table 3: Cost Opinion-Public Reimbursable**

<b>PUBLIC DRAINAGE FACILITIES</b>				
<b>Item</b>	<b>Quantity</b>	<b>Unit</b>	<b>Unit Price</b>	<b>Extended Cost</b>
Clearing & Grubbing	2	AC	\$5,000.00	\$10,000.00
Channel Widening Earthwork (Cut)	7000	CY	\$3.00	\$21,000.00
Riprap Lining (Type M)	5100	CY	\$85.00	\$433,500.00
Drop Structures	2	EA	\$20,000.00	\$40,000.00
			Sub-Total	\$504,500.00
			10% Eng. And Contingency	\$50,450.00
			Grand Total	\$554,950.00

## DRAINAGE DESIGN CRITERIA

---

### Development Criteria Reference

Storm drainage analysis techniques were taken from the “*City of Colorado Spring/El Paso County Drainage Criteria Manual*” Volumes 1 and 2 (EPCDCM), dated October 12, 1994, the “*Urban Storm Drainage Criteria Manual*” Volumes 1 - 3 (USDGM) and Chapter 6 and Section 3.2.1 of Chapter 13 of the “*Colorado Springs Drainage Criteria Manual (CCSDCM)*”, dated May 2014, as adopted by El Paso County.

### Hydrologic Criteria

The hydrologic analysis for this project is based on the *Sand Creek Drainage Basin Planning Study*. The flow rates for the 100-yr storm event were taken from sheets CTP-2 & CTP-3 of this study. The Baseline Flows from the *Sand Creek Drainage Basin Planning Study* are included in Appendix C.

### Hydraulic Criteria

GeoHecRas was used as the primary analysis method for the site. GeoHecRas was used to model existing flows within the Sand Creek-Center Tributary Drainageway. This model was used to verify flood plains and analyze any overtopping that may occur within the project site. The 100-year water surface profiles for the model were analyzed from the north property line of the site to the area 100 feet south of the Galley Road Crossing. Hydraulic computations for the models are contained in Appendix B. In the model the value for the roughness coefficient (n) were based upon those shown in

Table 12-2 of the City of Colorado Springs Drainage Criteria Manual, Volume 1. The manning's roughness coefficient for the sides of the channel was evaluated as  $n = 0.05$ , as the channel sides are most closely categorized as sluggish reaches with weeds, the minimum value of  $n$  was taken. For the bottom of the channel a manning's roughness coefficient value of  $n = 0.025$ , as the existing channel bottom being very clear and free of plants or other debris, the minimum value of  $n$  was taken. Table 12-2 highlights the manning values used for the model. The channel was analyzed as a winding channel in the GeoHecRas model.

**Table 12-2. Roughness Coefficients**

Channel Description	Roughness Coefficient (n)		
	Minimum	Typical	Maximum
Natural Streams (top width at flood stage <100 feet			
1. Streams on Plain			
a. Clean, straight, full stage, no rifts or deep pools	0.025	0.030	0.033
b. Same as above, but more stones and weeds	0.030	0.035	0.040
c. Clean, winding, some pools and shoals	0.033	0.040	0.045
d. Same as above, but some weeds and stones	0.035	0.045	0.050
e. Same as above, lower stages, more ineffective slopes and sections	0.040	0.048	0.055
f. Same as c, but more stones	0.045	0.050	0.060
g. Sluggish reaches, weedy, deep pools	0.050	0.070	0.080
h. Very weedy reaches, deep pools, or floodways with heavy stand of timber and underbrush	0.075	0.100	0.150
2. Mountain Streams, no vegetation in channel, banks usually steep, trees and brush along banks submerged at high stages			
a. Bottom: gravels, cobbles, and few boulders	See Jarrett's equation*		
b. Bottom: cobbles with large boulders			

The flows in the channel, upstream and downstream of the Solace site, were determined using the sheet CTP-2 of the *Sand Creek Drainage Basin Planning Study*, with the flow 720 cfs being used at the upstream end of the channel till river station 1031 where the flow changes to 960 cfs, and once again at the Galley Road crossing to 1340 cfs. These can be seen in the GeoHecRas output table. Geometry of the channel and the crossing structure at Galley Road was determined from survey conducted by JR Engineering's internal survey department. The Galley road crossing structure was modeled in the GeoHecRas model; its geometric parameters were determined using survey obtained data to the crossing. The sizes of the 48" CMP culverts in the crossing were also determined from survey data.

## SUMMARY

This analysis of the Sand Creek-Center Tributary Drainageway remains consistent with previous studies. Velocities in the drainageway are of concern and require channel improvements, such as widening and riprap lining to ensure the Sand Creek Drainageway remains stable during a 100-yr event. This report meets the latest El Paso County Drainage Criteria requirements for this site. The results of JR Engineering's GeoHecRas model for the channel appear accurate as the water surface elevations of the channel matchup very closely to the elevations called out in the FEMA FIS along

the channel. The overtopping elevation at Galley Road shown in the model matches the elevation shown in the FEMA floodplain map of 6249, showing that the GeoHecRas model results are valid.

## REFERENCES:

---


1. El Paso County Drainage Criteria Manual Volume 1, El Paso County, CO, 1994.
2. Urban Storm Drainage Criteria Manual, Urban Drainage and Flood Control District, Latest Revision.
3. Flood Insurance Study- El Paso County, Colorado & Incorporated Areas Vol 7 of 8, Federal Emergency Management Agency, December 7, 2018.
4. Sand Creek Drainage Basin Planning Study, Kiowa Engineering, January 1993.
5. Sand Creek Drainage Basin LOMR, Federal Emergency Management Agency, May 23, 2007.

HEC-RAS Plan: Default Scenario River: Channel 01 Reach: CH01 Profile: Sand Creek

Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chl
CH01	1053	Sand Creek	760.00	6265.00	6269.26	6269.26	6270.04	0.003762	8.51	179.27	110.42	0.77
CH01	1052	Sand Creek	760.00	6258.00	6262.11	6262.11	6263.78	0.005804	10.49	77.83	25.50	0.96
CH01	1051	Sand Creek	760.00	6257.00	6261.64	6261.64	6263.29	0.006883	10.30	74.47	24.12	0.98
CH01	1050	Sand Creek	760.00	6257.00	6261.55	6261.55	6263.17	0.005614	10.36	81.50	27.77	0.96
CH01	1049	Sand Creek	760.00	6257.00	6260.93	6260.93	6262.50	0.005917	10.15	80.51	28.71	0.97
CH01	1048	Sand Creek	760.00	6255.00	6259.52	6259.52	6261.19	0.005730	10.51	80.21	27.19	0.97
CH01	1047	Sand Creek	760.00	6254.00	6258.20	6258.20	6259.83	0.006013	10.34	79.30	27.50	0.98
CH01	1046	Sand Creek	760.00	6253.00	6257.62	6257.33	6258.86	0.004369	9.10	93.85	32.59	0.85
CH01	1045	Sand Creek	760.00	6253.00	6257.94		6258.62	0.002044	6.71	123.65	36.54	0.59
CH01	1044	Sand Creek	760.00	6252.00	6258.04		6258.47	0.000942	5.39	158.77	38.15	0.42
CH01	1043	Sand Creek	760.00	6252.00	6258.17		6258.40	0.000450	3.84	219.34	49.10	0.29
CH01	1042	Sand Creek	760.00	6252.00	6258.25		6258.35	0.000192	2.60	333.13	72.33	0.19
CH01	1041	Sand Creek	760.00	6251.00	6258.15	6254.86	6258.33	0.000342	3.46	250.00	54.53	0.26
CH01	1040	Sand Creek	760.00	6251.00	6257.48		6258.25	0.001509	7.34	129.48	31.17	0.53
CH01	1039	Sand Creek	720.00	6250.00	6256.03	6256.03	6258.09	0.005145	12.17	78.63	22.88	0.93
CH01	1038	Sand Creek	720.00	6250.00	6254.65	6254.65	6256.48	0.005632	11.04	74.30	23.99	0.96
CH01	1037	Sand Creek	720.00	6249.00	6254.26	6254.26	6256.12	0.005266	11.39	78.61	25.24	0.94
CH01	1036	Sand Creek	720.00	6249.00	6254.18	6253.87	6255.67	0.004153	10.16	86.85	27.64	0.84
CH01	1035	Sand Creek	720.00	6248.00	6254.49		6255.37	0.001997	8.12	123.42	33.33	0.60
CH01	1034	Sand Creek	720.00	6248.00	6253.87	6253.37	6255.23	0.003530	9.97	96.29	27.50	0.78
CH01	1033	Sand Creek	720.00	6248.00	6253.90	6253.27	6255.15	0.003218	9.54	100.27	28.48	0.75
CH01	1032	Sand Creek	720.00	6248.00	6254.02	6252.85	6254.99	0.002212	8.21	107.83	28.30	0.63
CH01	1031	Sand Creek	720.00	6247.00	6252.93	6252.93	6254.82	0.005902	11.67	81.05	24.65	0.92
CH01	1030	Sand Creek	960.00	6247.00	6253.53		6254.38	0.001956	8.14	169.51	45.64	0.61
CH01	1029	Sand Creek	960.00	6247.00	6253.61		6254.29	0.001452	7.08	180.40	43.93	0.52
CH01	1028	Sand Creek	960.00	6247.00	6253.63	6251.57	6254.24	0.001217	6.58	184.56	43.62	0.48
CH01	1027	Sand Creek	960.00	6247.00	6253.56		6254.17	0.001232	7.01	201.11	46.32	0.50
CH01	1026	Sand Creek	960.00	6247.00	6253.62		6254.11	0.000969	5.82	199.63	47.17	0.43
CH01	1025	Sand Creek	960.00	6247.00	6253.70	6250.88	6254.05	0.000644	4.85	227.01	48.43	0.35
CH01	1024	Sand Creek	960.00	6246.00	6253.67	6250.42	6254.02	0.000576	4.98	235.21	46.35	0.34
CH01	1023	Sand Creek	960.00	6246.00	6253.62	6250.47	6254.01	0.000626	5.21	225.63	43.80	0.35
CH01	1022	Sand Creek	960.00	6246.00	6253.61		6254.00	0.000607	5.19	221.85	41.91	0.35
CH01	1021	Sand Creek	960.00	6246.00	6253.17		6253.94	0.001350	7.37	164.92	36.16	0.51
CH01	1020	Sand Creek	960.00	6246.00	6252.32	6251.61	6253.82	0.003159	10.30	118.91	30.63	0.76
CH01	1019	Sand Creek	960.00	6246.00	6252.49	6251.34	6253.62	0.002313	9.03	140.23	36.35	0.66
CH01	1018	Sand Creek	960.00	6246.00	6251.44	6251.44	6253.45	0.004819	12.21	109.12	31.63	0.94
CH01	1017	Sand Creek	960.00	6245.00	6251.26	6250.03	6252.37	0.002324	8.73	133.16	32.49	0.65
CH01	1016	Sand Creek	960.00	6245.00	6250.14	6250.14	6252.15	0.005299	11.66	96.28	28.21	0.95
CH01	1015	Sand Creek	960.00	6244.00	6250.38	6248.09	6250.77	0.000839	5.11	215.92	53.82	0.39
CH01	1014	Sand Creek	956.00	6244.00	6250.35	6248.71	6250.72	0.000950	5.78	370.06	207.76	0.42
CH01	1013	Sand Creek	956.00	6244.00	6249.89	6249.89	6250.66	0.001931	8.21	274.84	196.01	0.61
CH01	1012	Sand Creek	956.00	6244.00	6248.95	6248.95	6251.16	0.005865	12.67	104.90	38.16	1.02
CH01	1011	Sand Creek	956.00	6244.00	6249.28	6249.28	6250.05	0.002387	8.46	279.17	203.66	0.66
CH01	1010	Sand Creek	956.00	6244.00	6249.16	6249.16	6249.97	0.002504	8.54	254.79	169.44	0.67
CH01	1009	Sand Creek	956.00	6242.00	6249.14	6247.90	6249.85	0.001612	7.93	276.71	166.57	0.55
CH01	1008	Sand Creek	956.00	6242.00	6247.80	6247.80	6249.73	0.004748	11.73	106.54	31.47	0.91
CH01	1007	Sand Creek	956.00	6242.00	6248.22	6247.39	6249.22	0.002263	9.17	222.13	127.82	0.66
CH01	1006	Sand Creek	956.00	6242.00	6248.59	6247.92	6249.01	0.001105	6.67	368.21	181.76	0.46
CH01	1005	Sand Creek	956.00	6242.00	6248.64	6246.43	6248.97	0.000738	5.28	352.19	168.51	0.38
CH01	1004	Sand Creek	956.00	6242.00	6248.76	6245.39	6248.91	0.000242	3.31	399.38	160.30	0.22
CH01	1003.56		Culvert									
CH01	1003	Sand Creek	956.00	6239.00	6244.43	6242.22	6244.82	0.000233	4.99	191.73	160.51	0.40
CH01	1002	Sand Creek	956.00	6240.00	6243.32	6243.32	6244.68	0.001891	9.35	102.20	38.15	1.01
CH01	1001	Sand Creek	956.00	6239.00	6242.61	6242.61	6244.01	0.001806	9.51	100.52	34.95	0.99
CH01	1000	Sand Creek	956.00	6239.00	6242.44	6242.44	6243.85	0.001879	9.55	100.10	35.71	1.01

HEC-RAS Model Plan: Default Scenario 5/1/2020


Channel 01 CH01

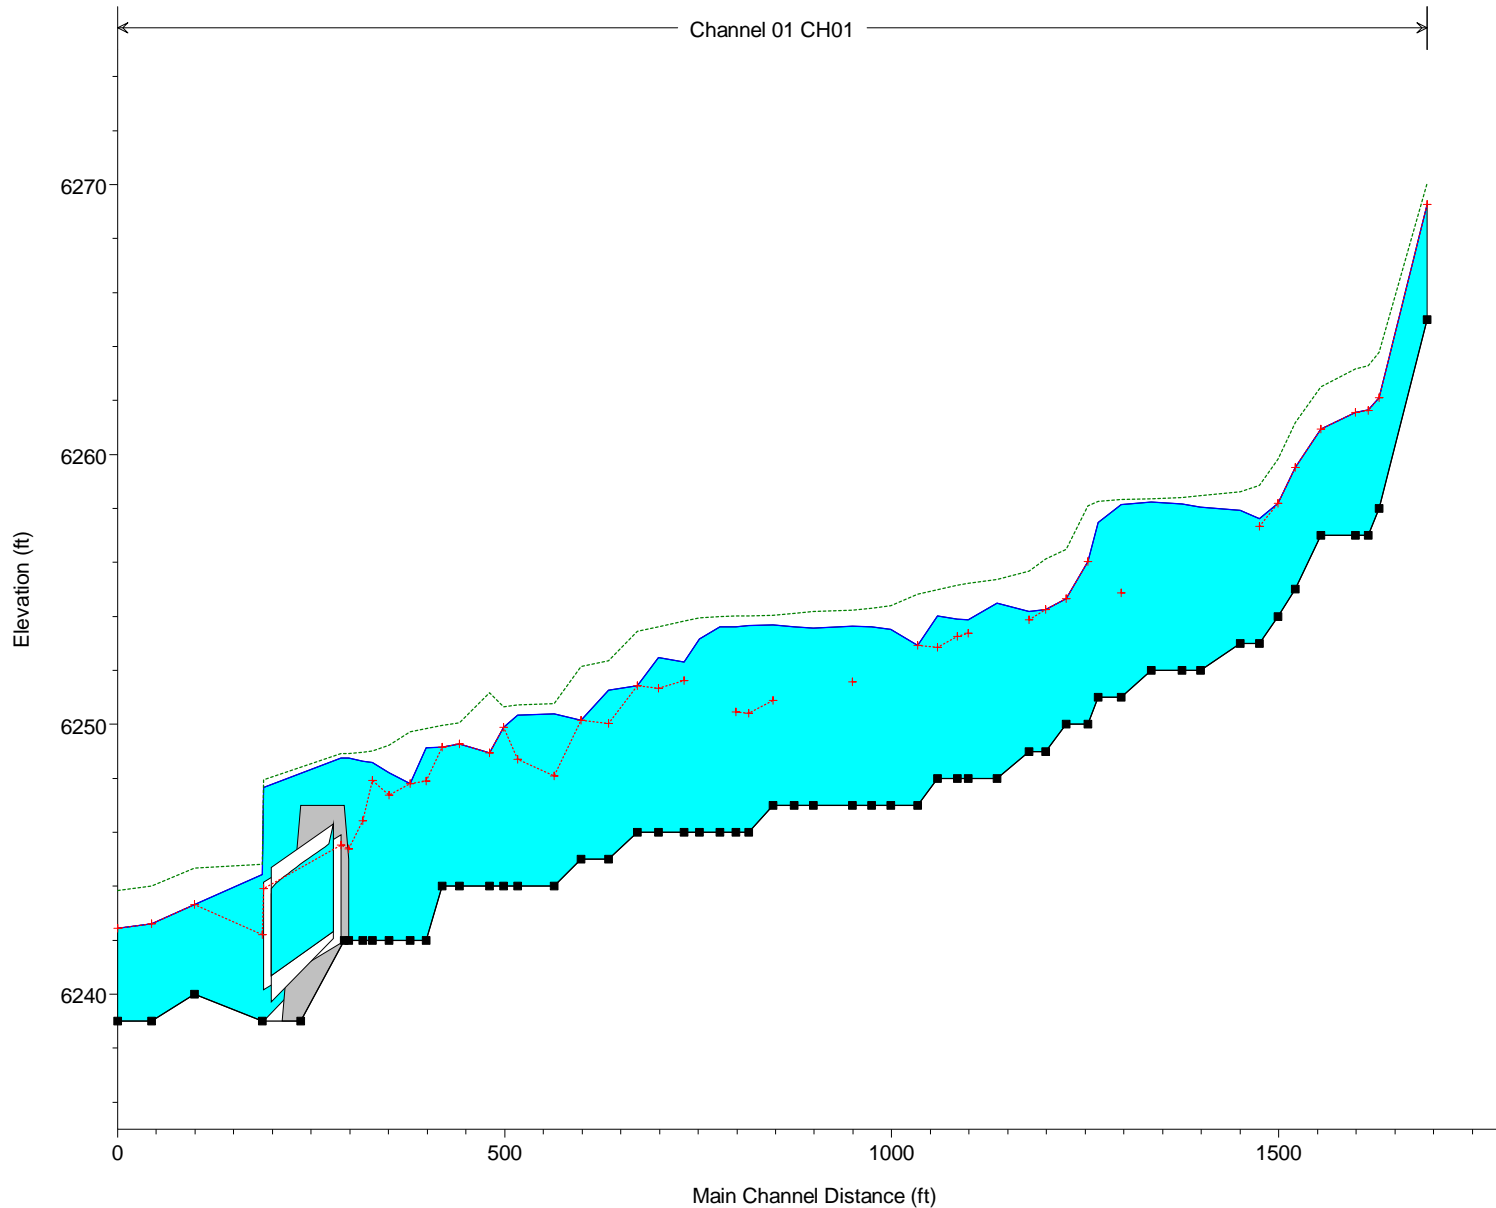

Legend	
EG Sand Creek	(Green dashed line)
WS Sand Creek	(Blue solid line)
Crit Sand Creek	(Red dotted line with '+')
Ground	(Black stepped line with squares)
Left Levee	(None)
Right Levee	(None)


HEC-RAS Model Plan: Default Scenario 5/1/2020

RS = 1053

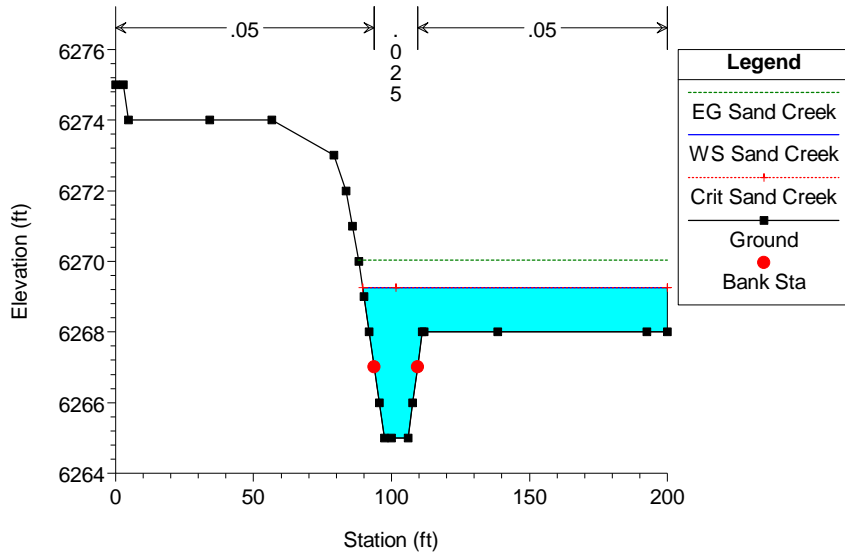


HEC-RAS Model Plan: Default Scenario 5/1/2020

RS = 1052

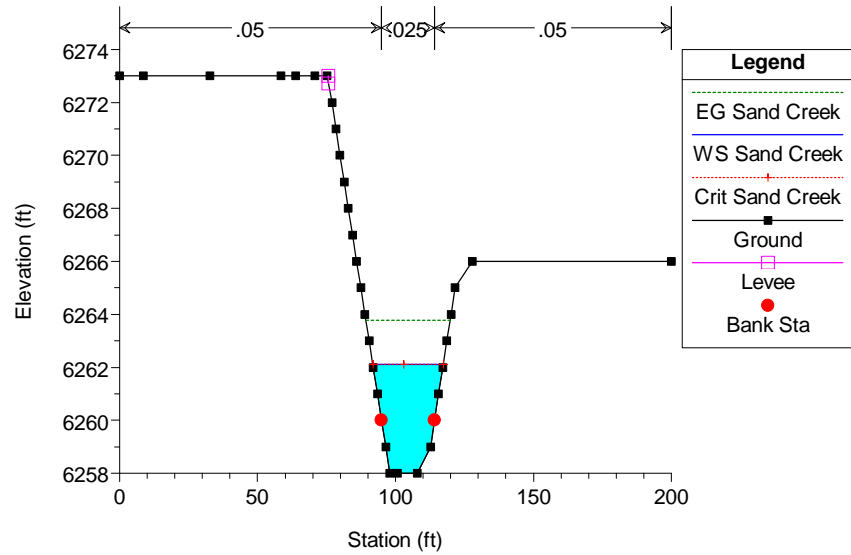


HEC-RAS Model Plan: Default Scenario 5/1/2020


RS = 1051

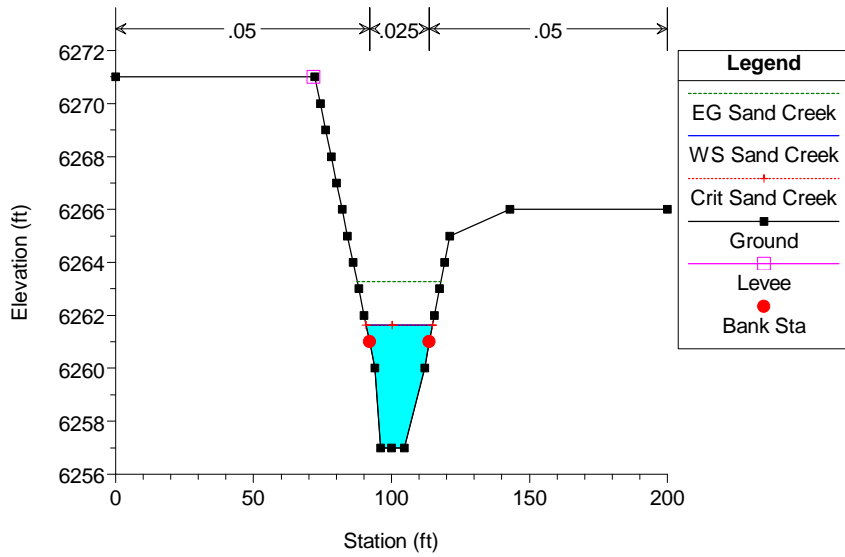

HEC-RAS Model Plan: Default Scenario 5/1/2020


RS = 1050

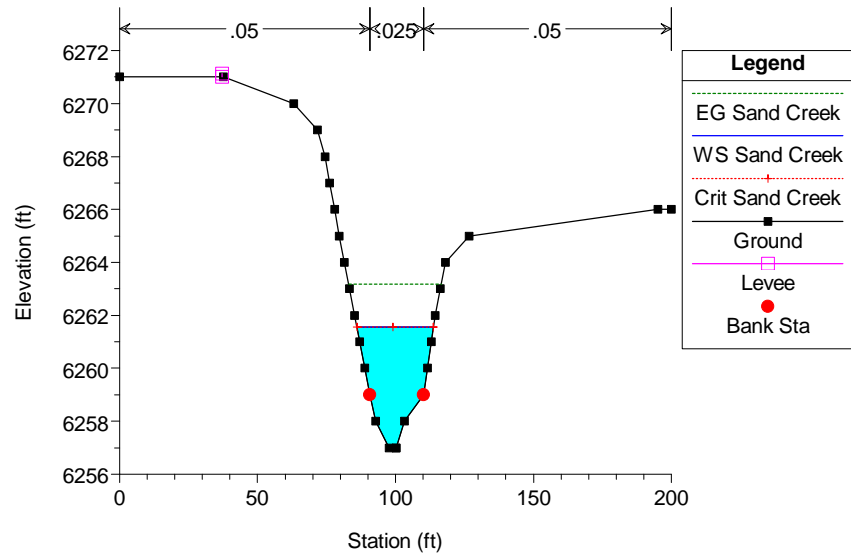

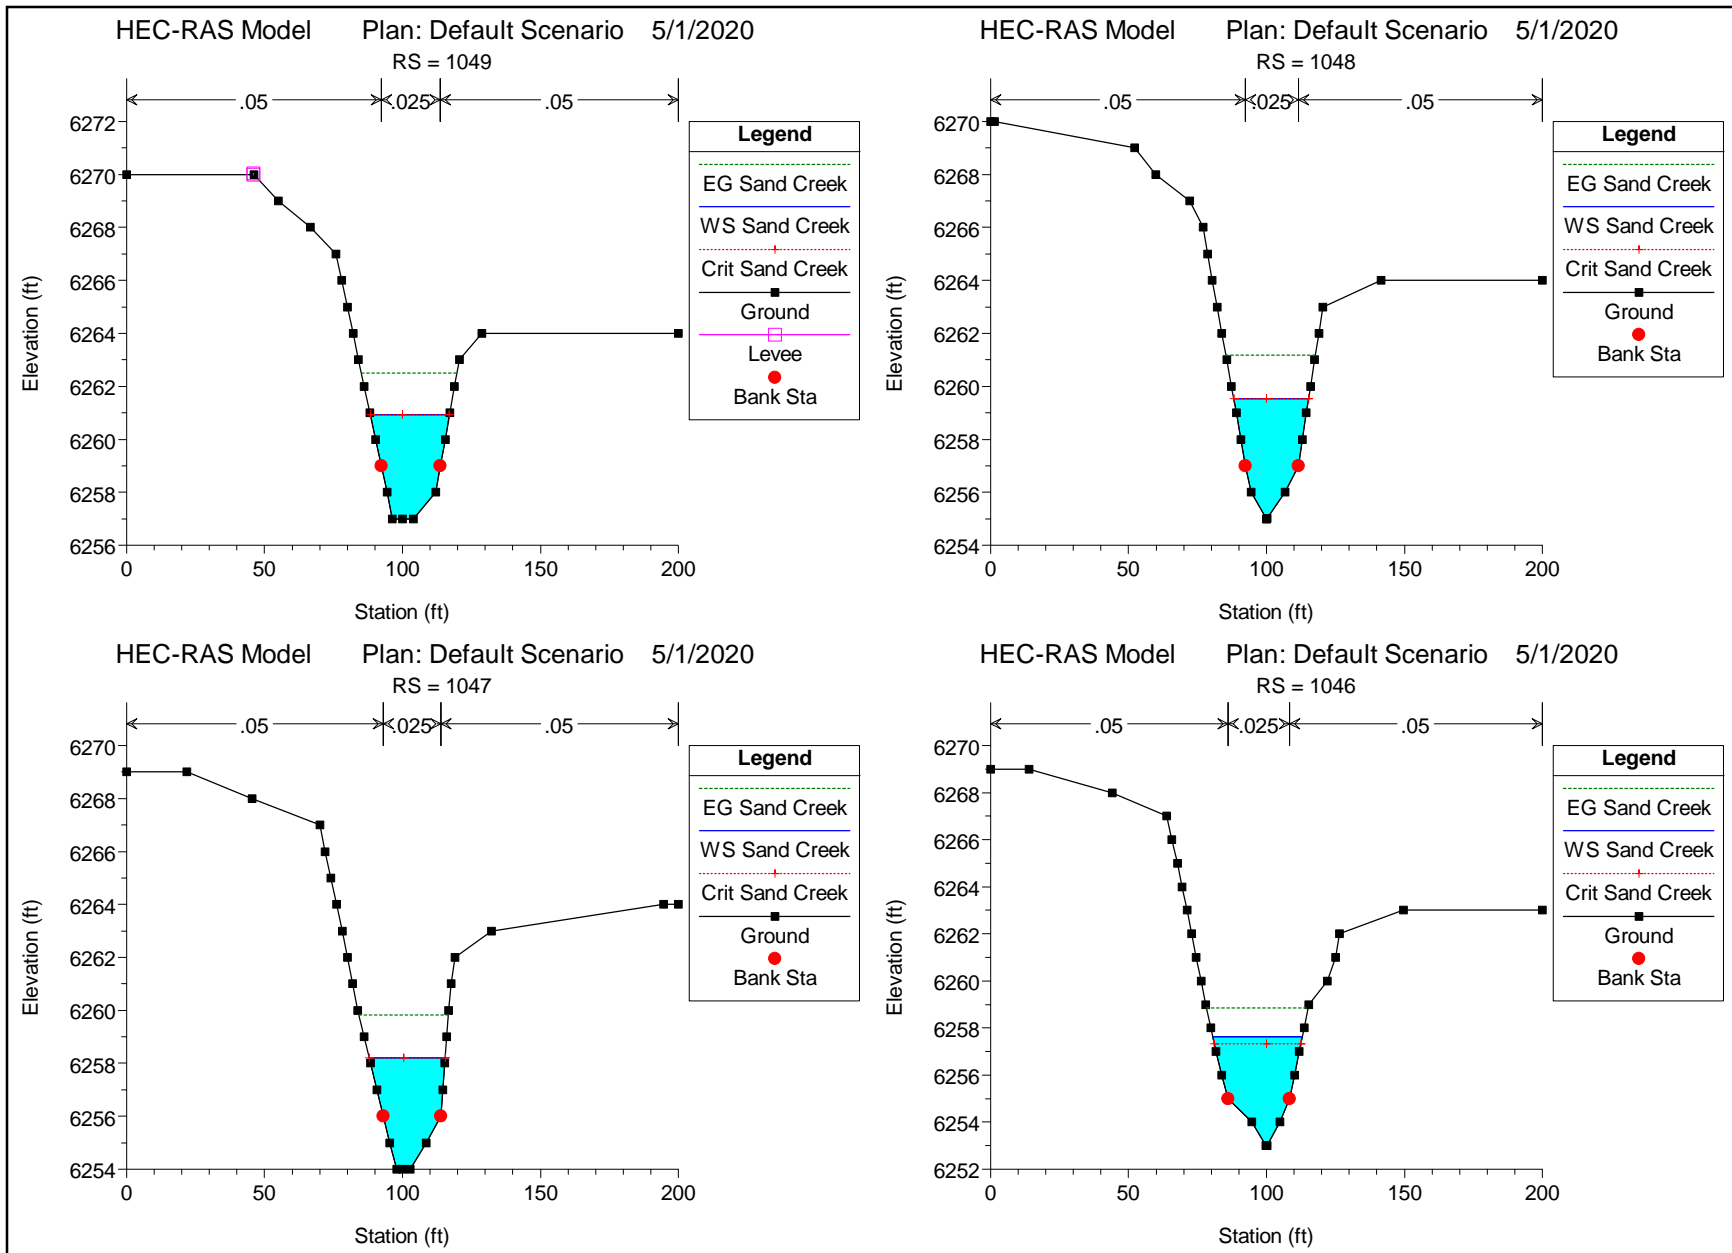





HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1045

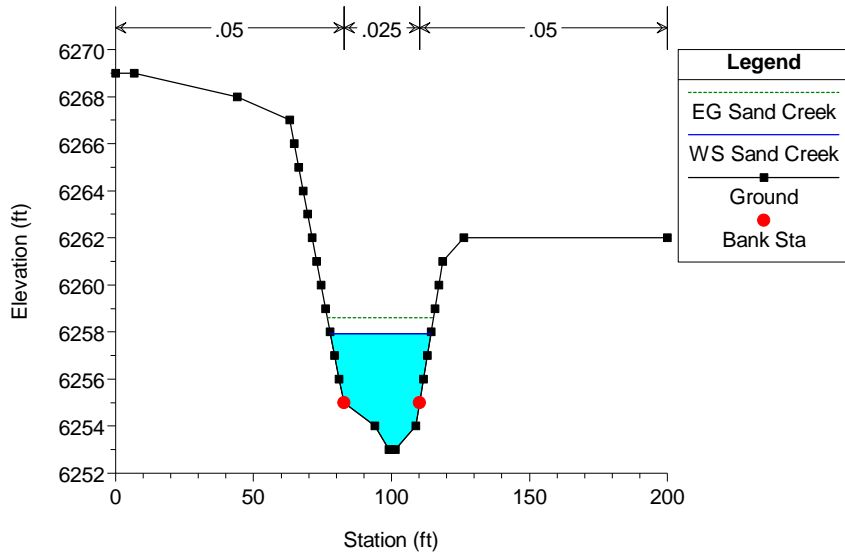


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1044

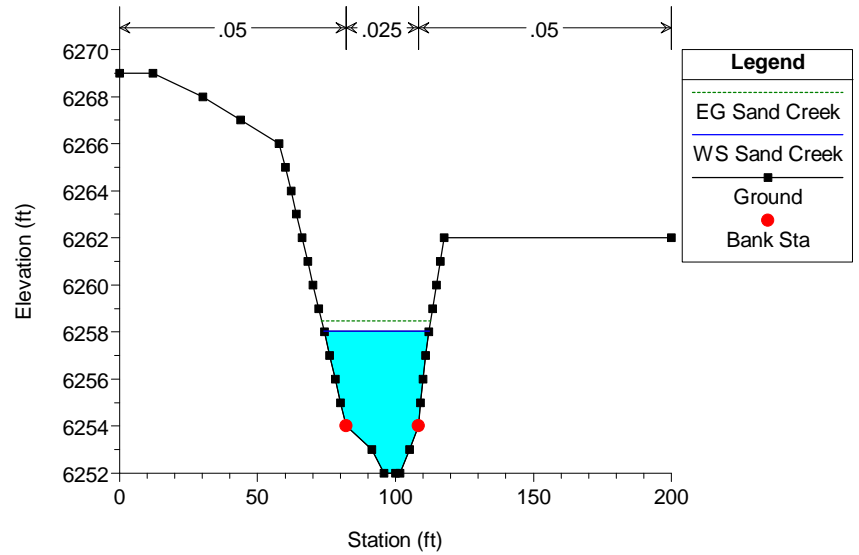






HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1043

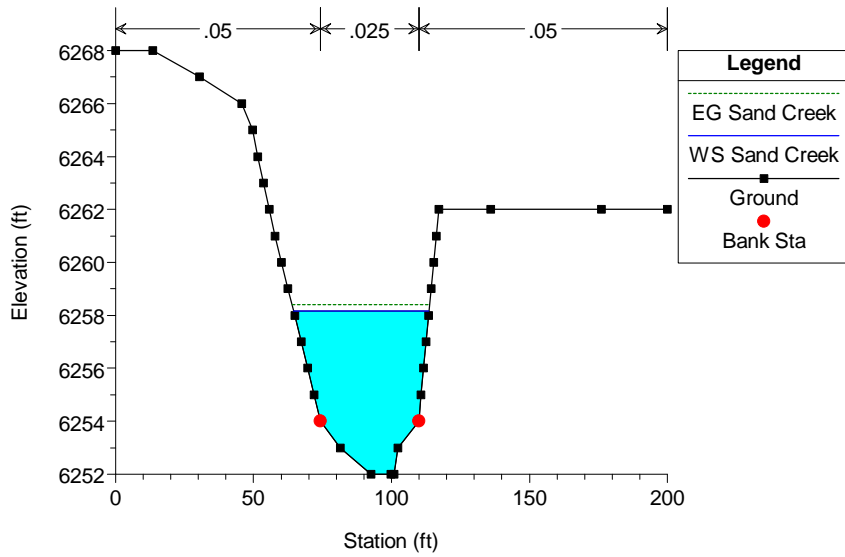


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1042

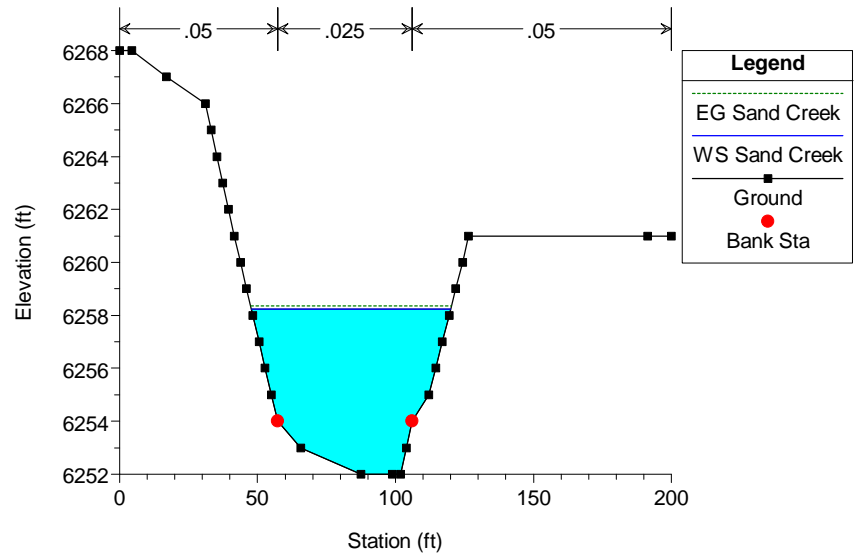


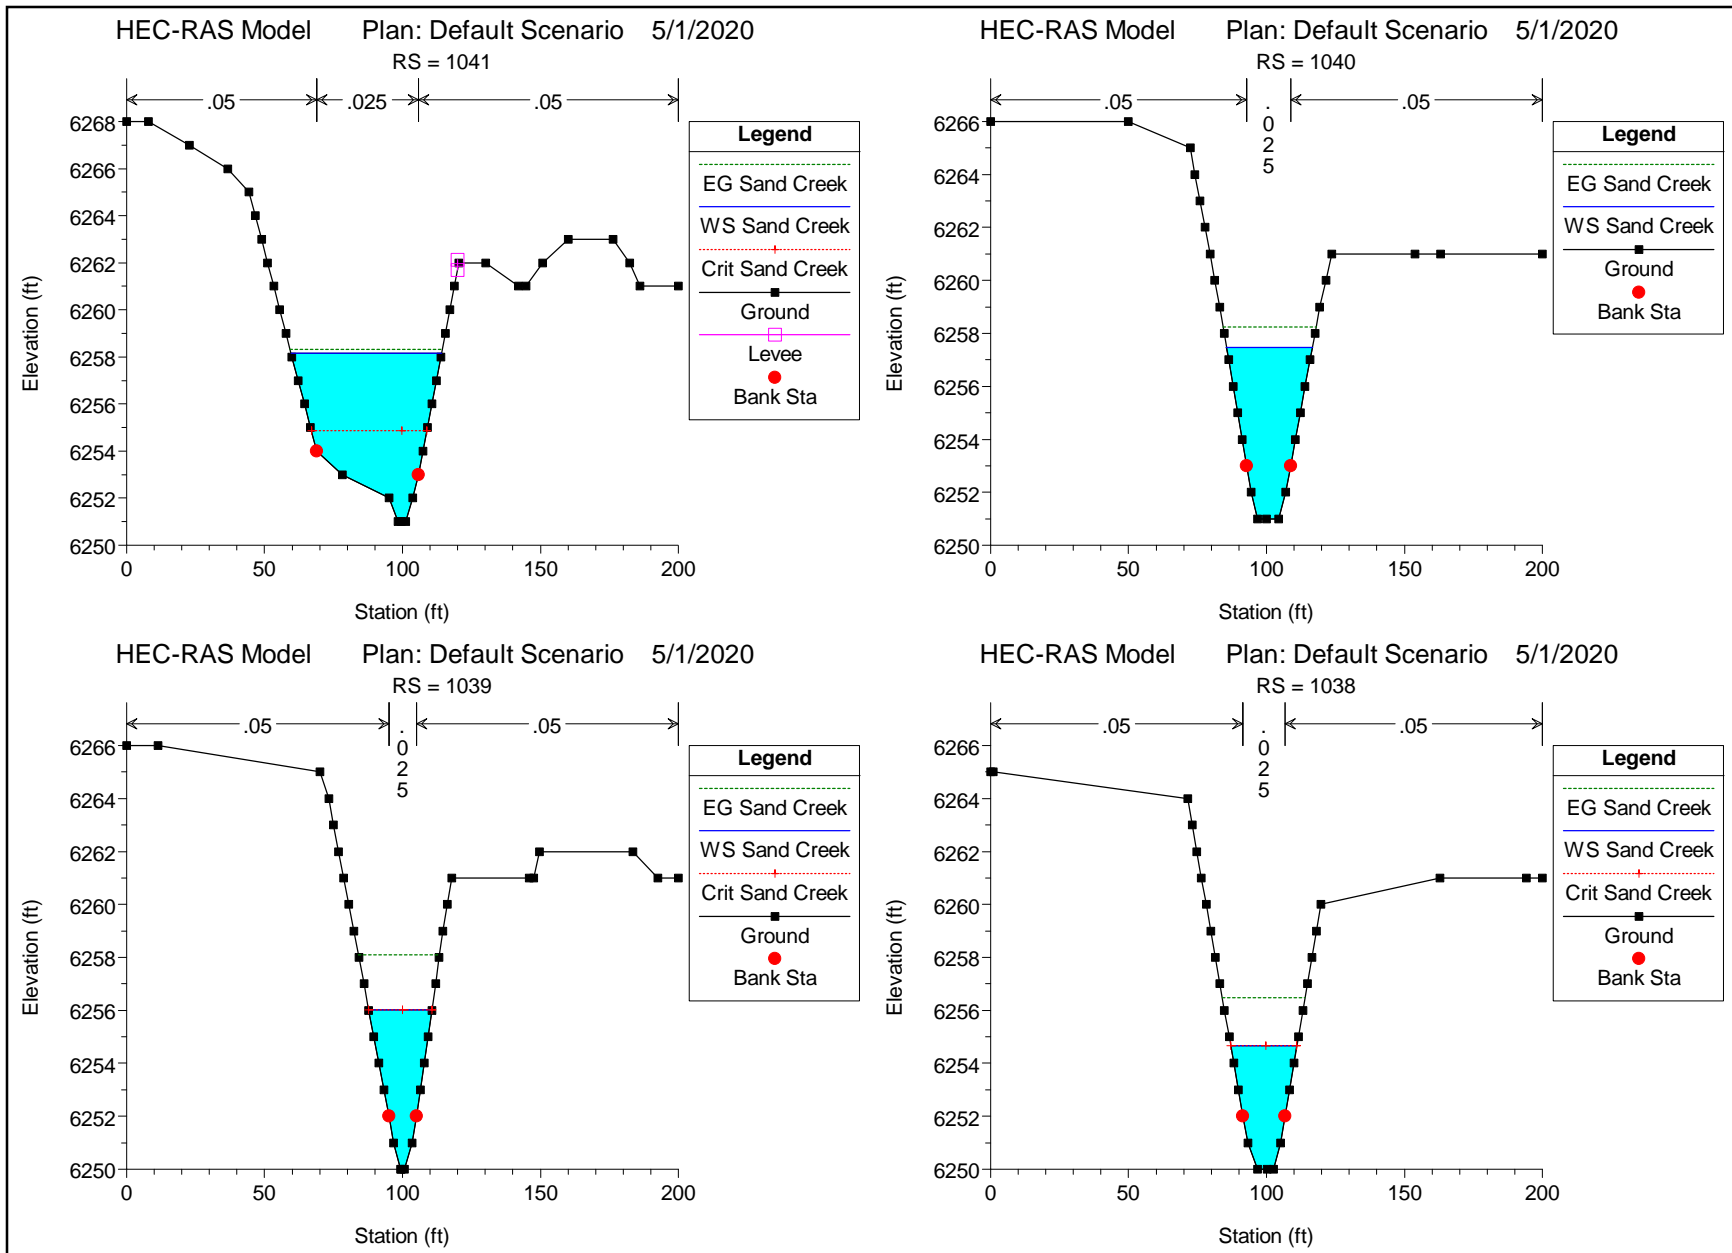

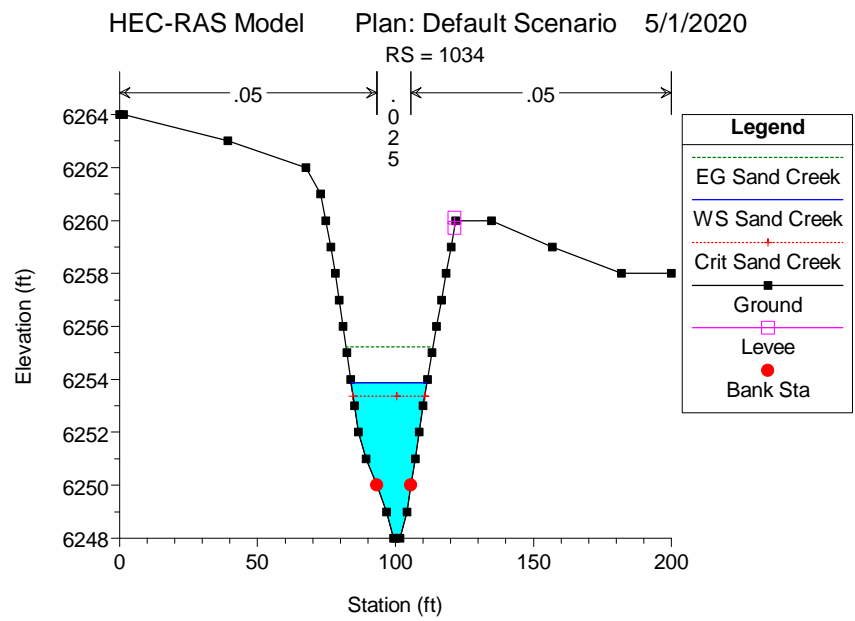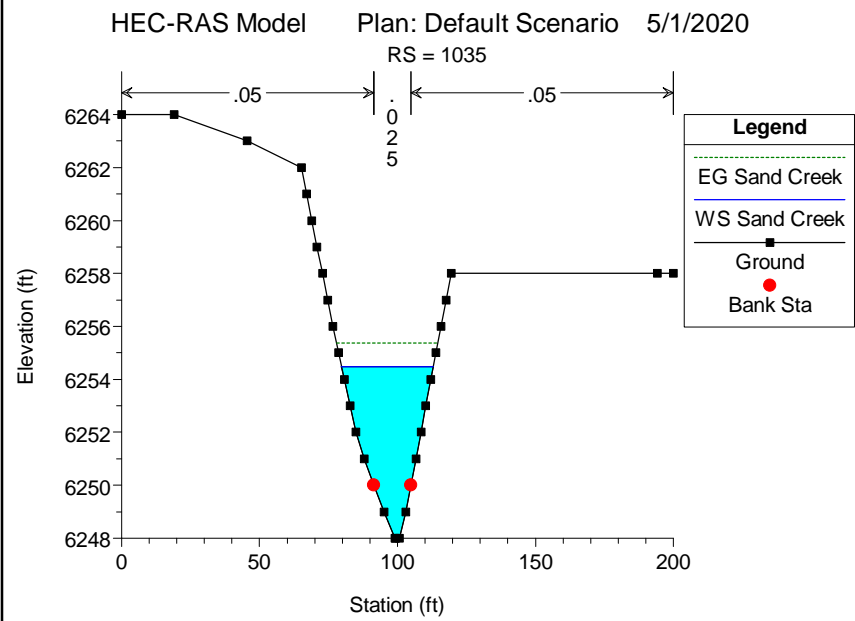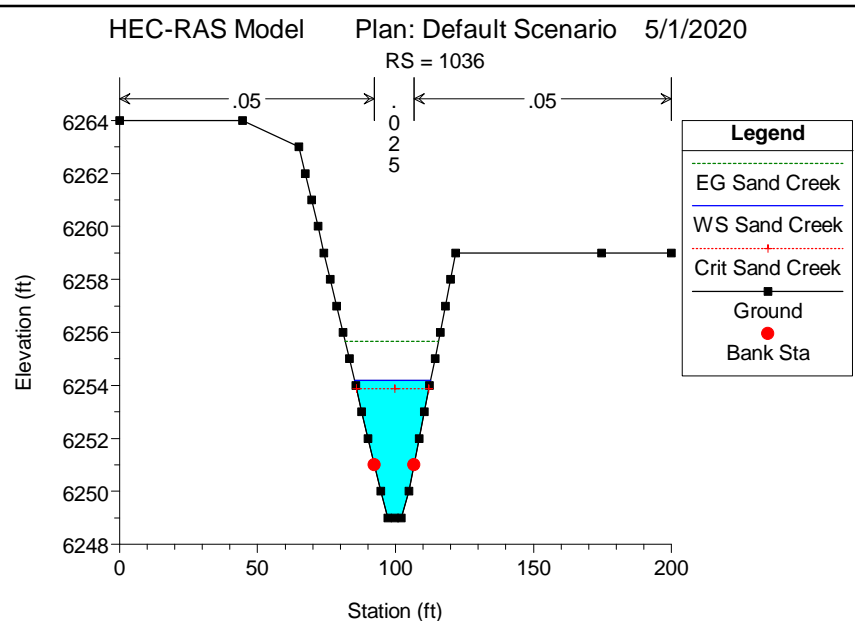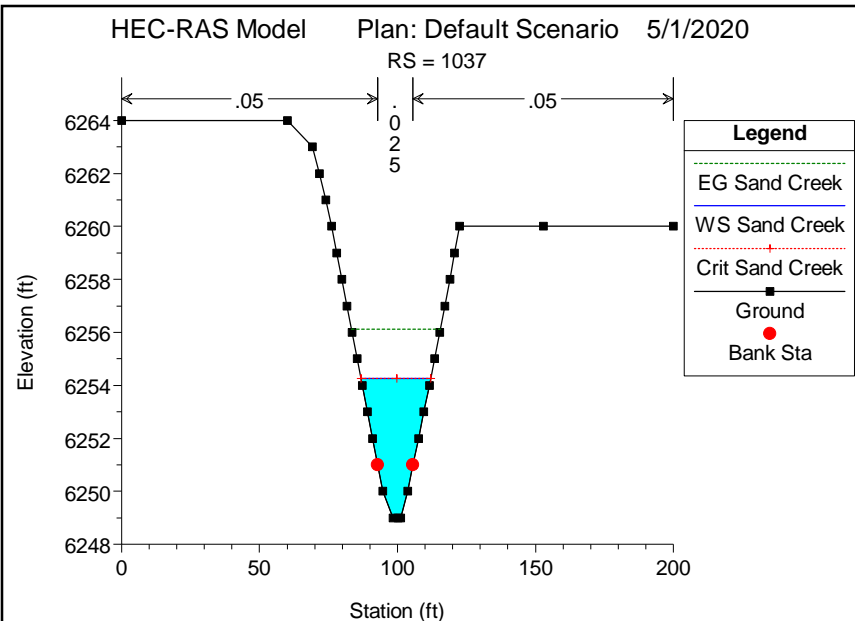


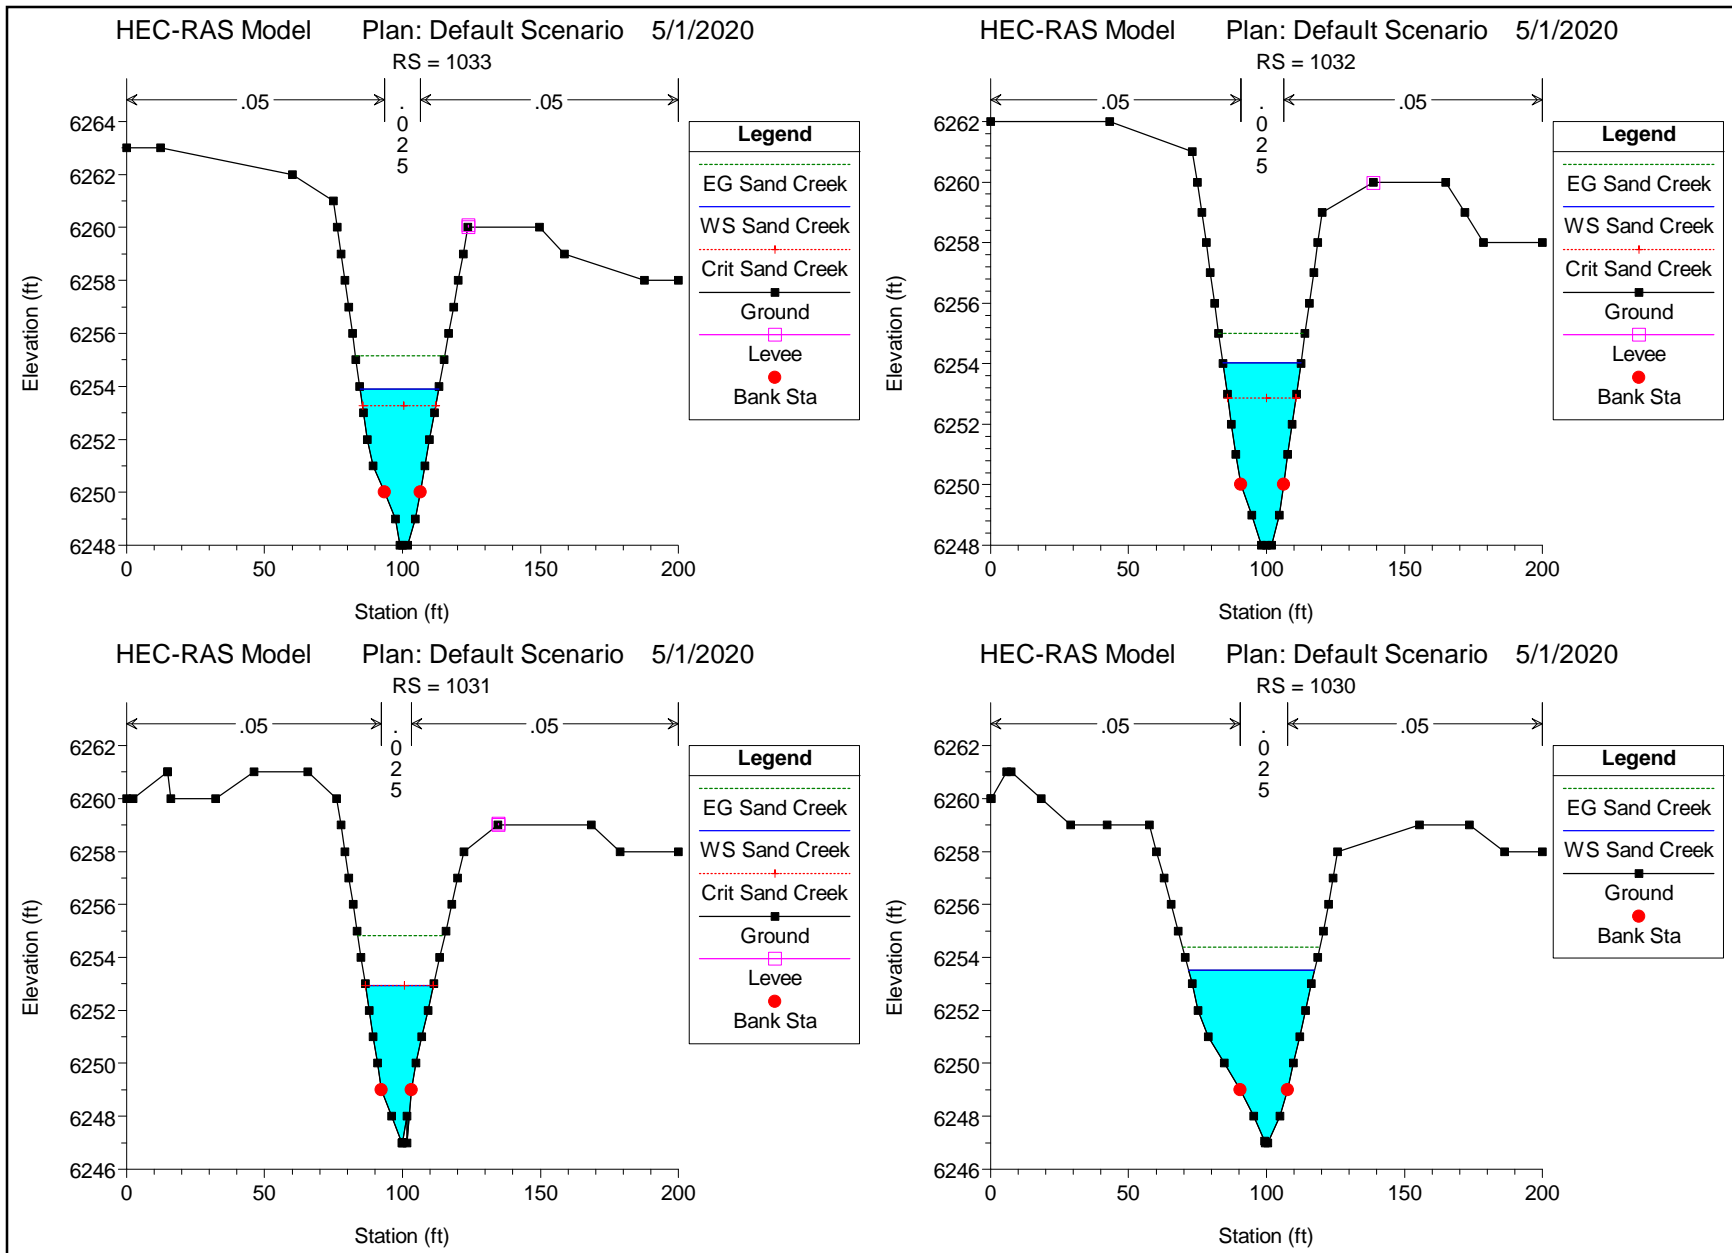


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1029

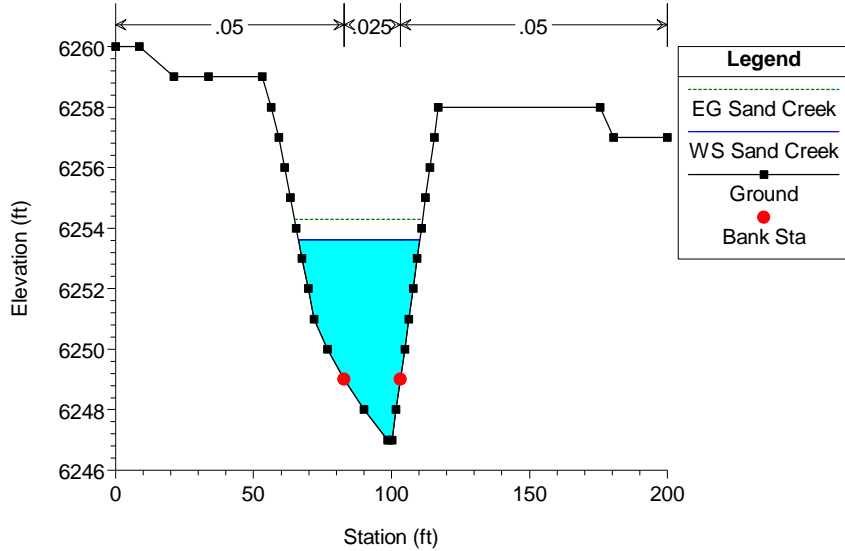


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1028

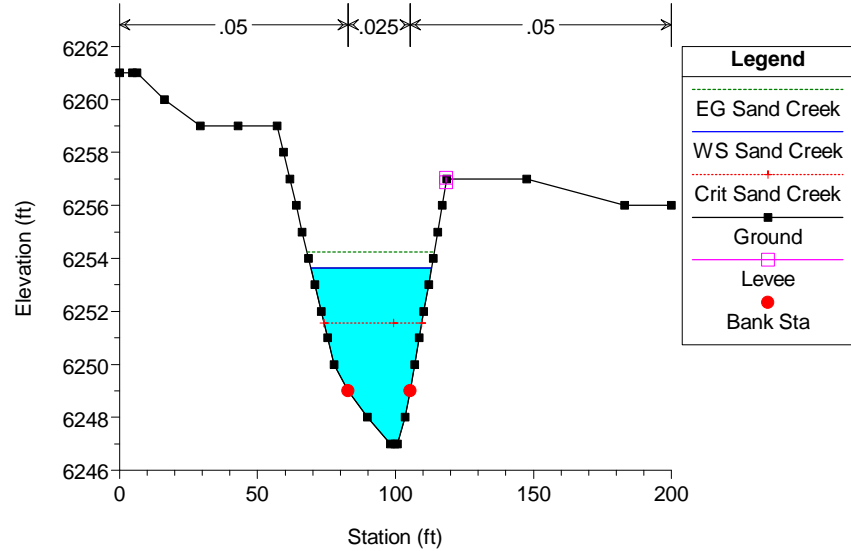


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1027

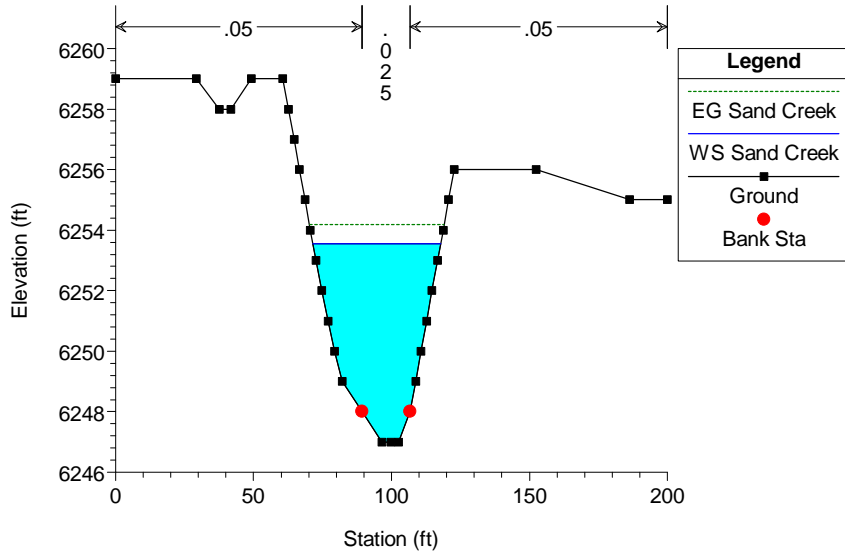


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1026

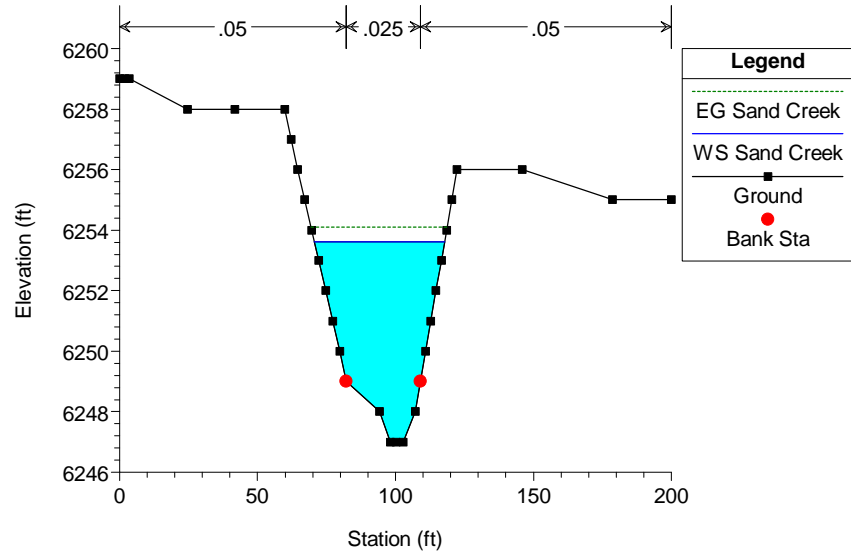


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1025

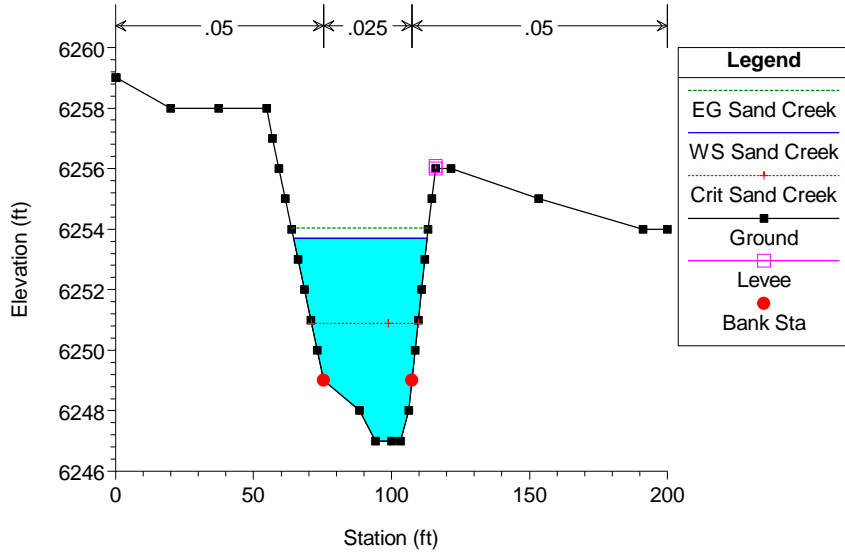


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1024

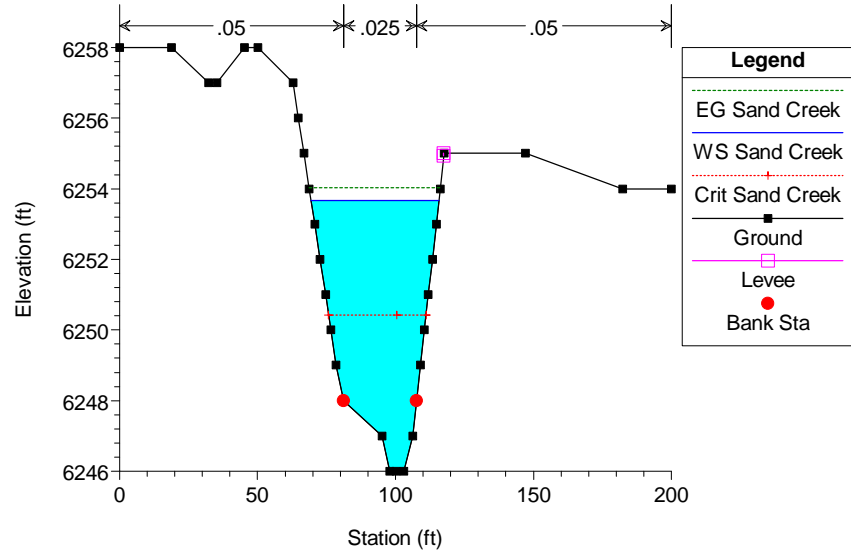

HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1023

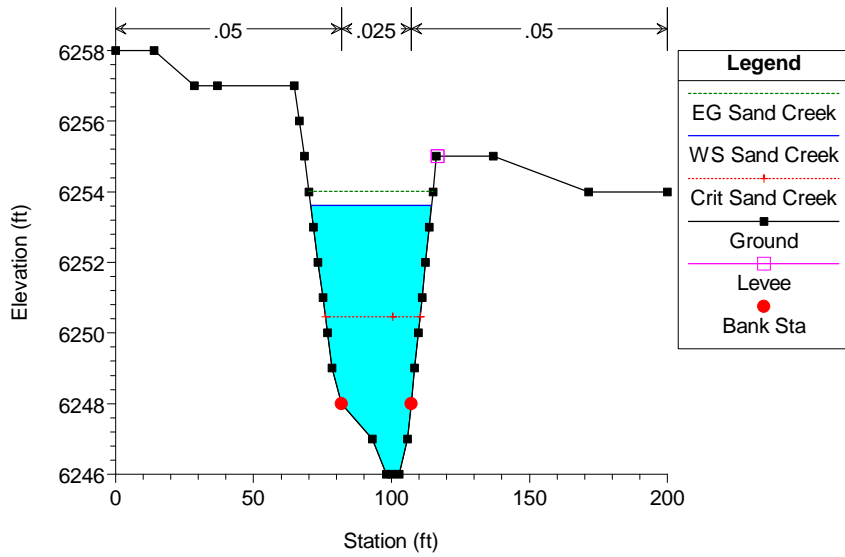


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1022

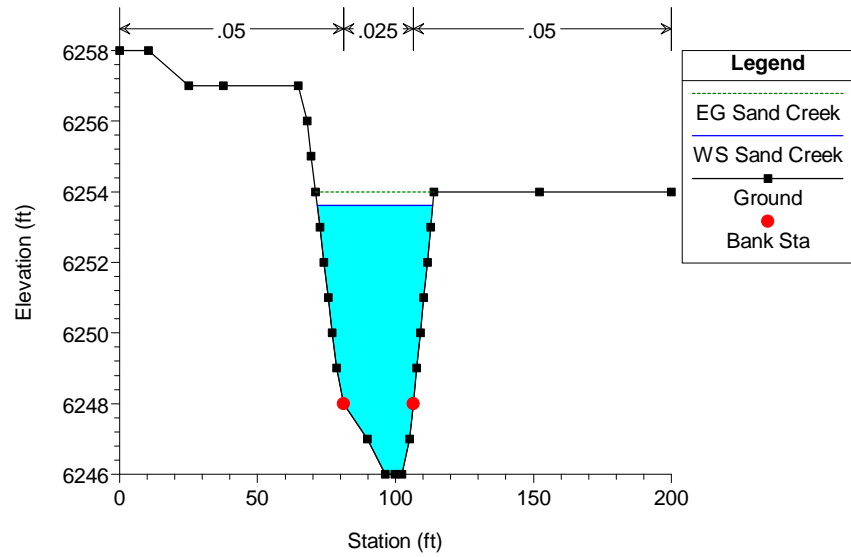


HEC-RAS Model Plan: Default Scenario 5/1/2020

RS = 1021

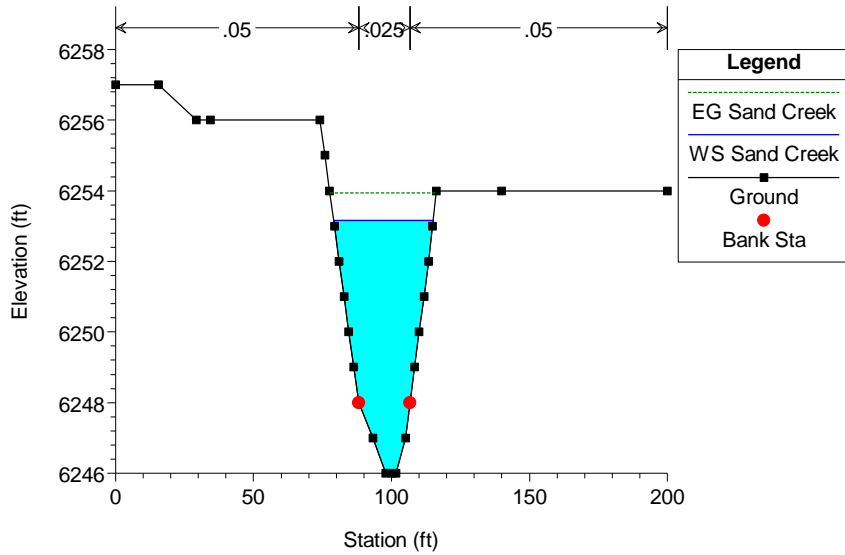


HEC-RAS Model Plan: Default Scenario 5/1/2020

RS = 1020

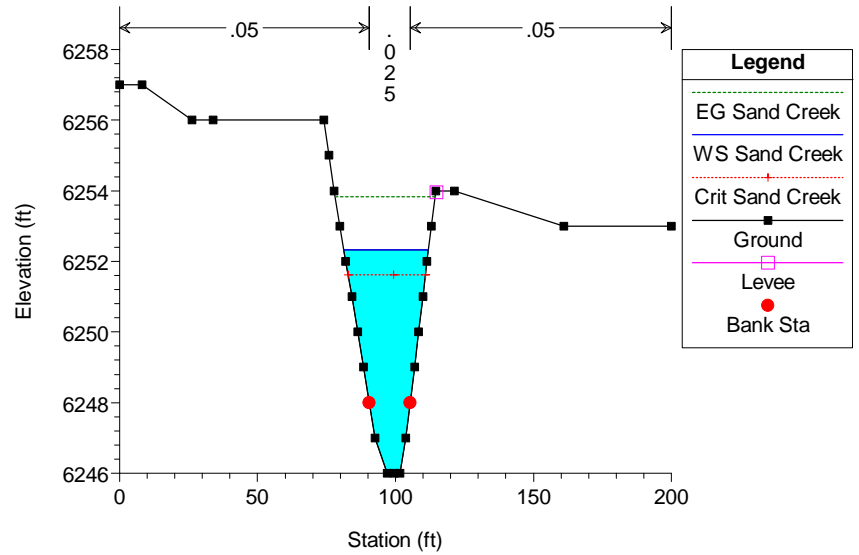


HEC-RAS Model Plan: Default Scenario 5/1/2020





RS = 1019

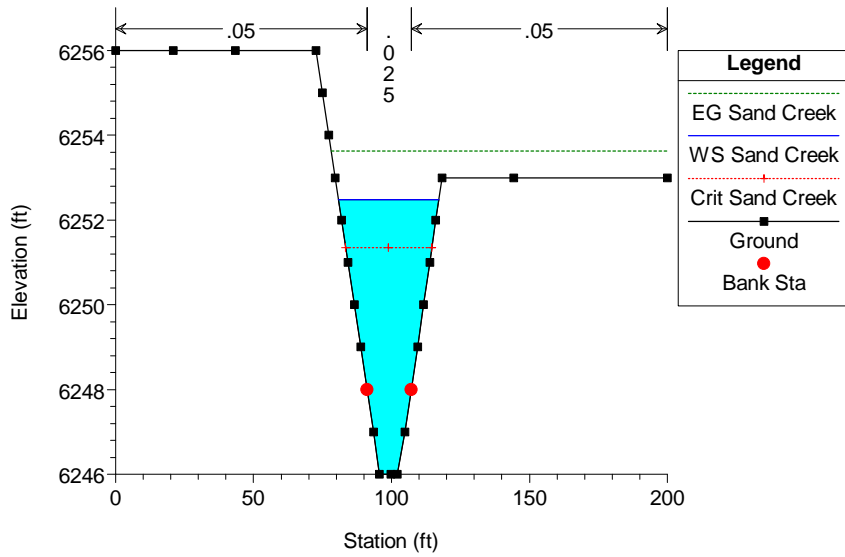

HEC-RAS Model Plan: Default Scenario 5/1/2020


RS = 1018

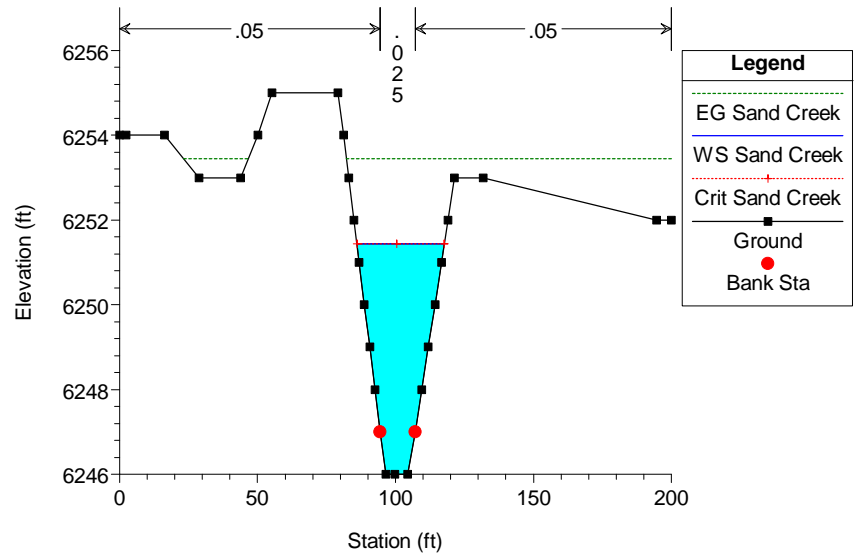

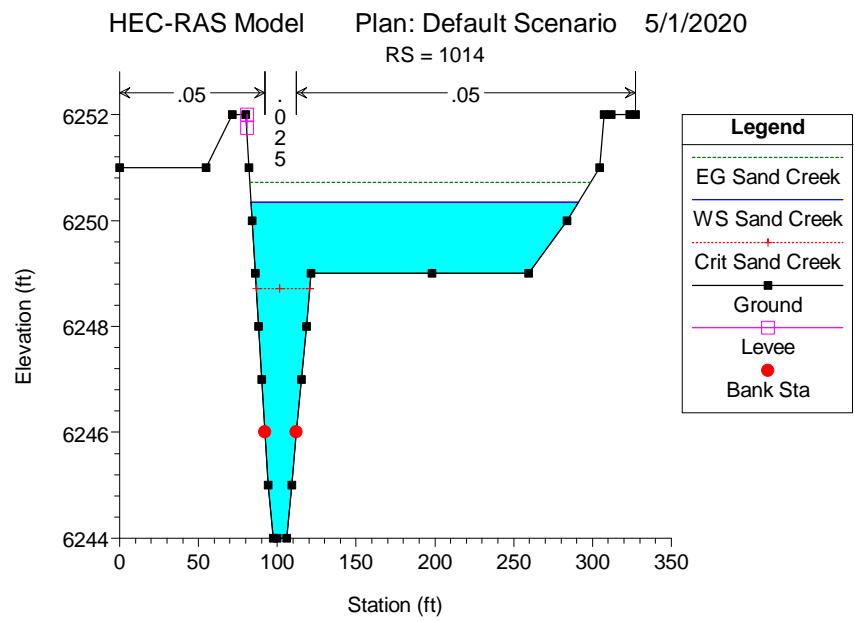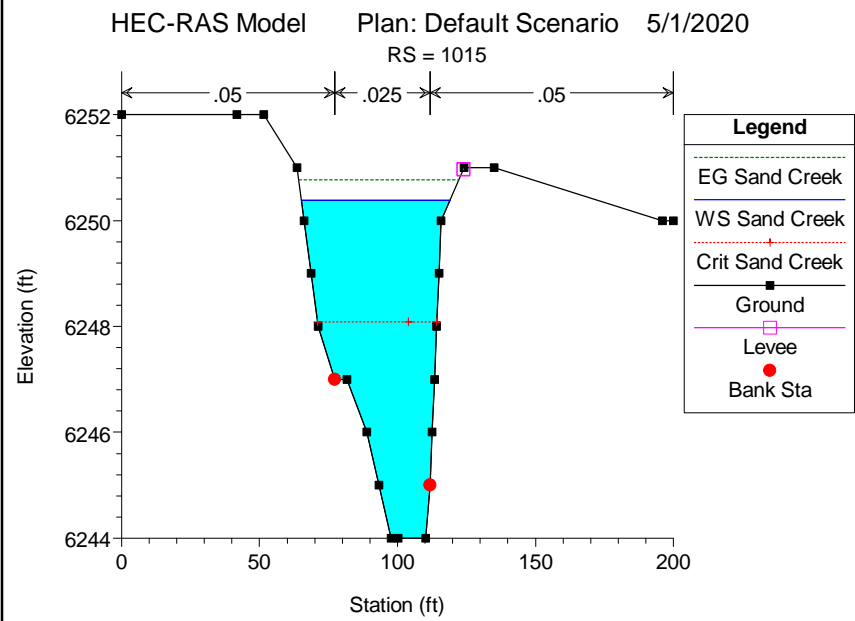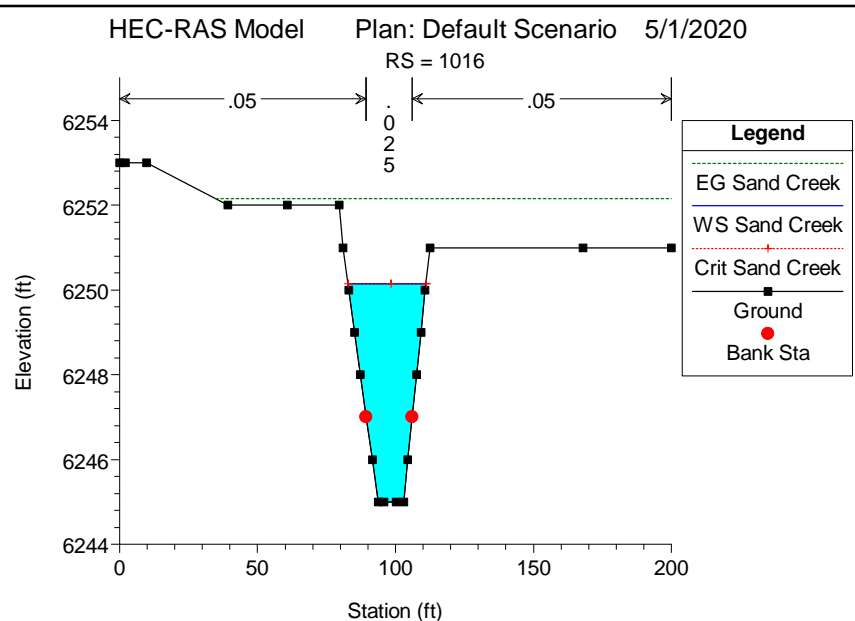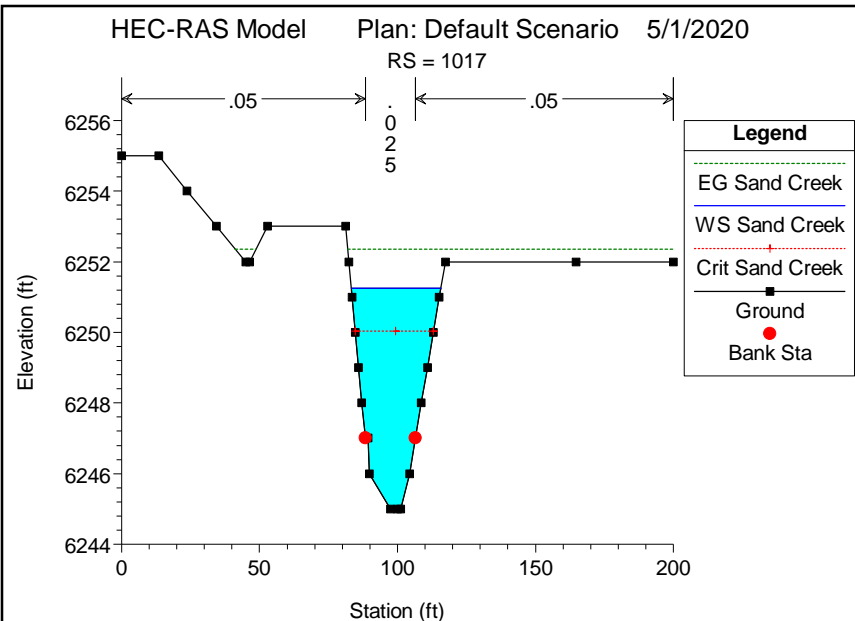





HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1013

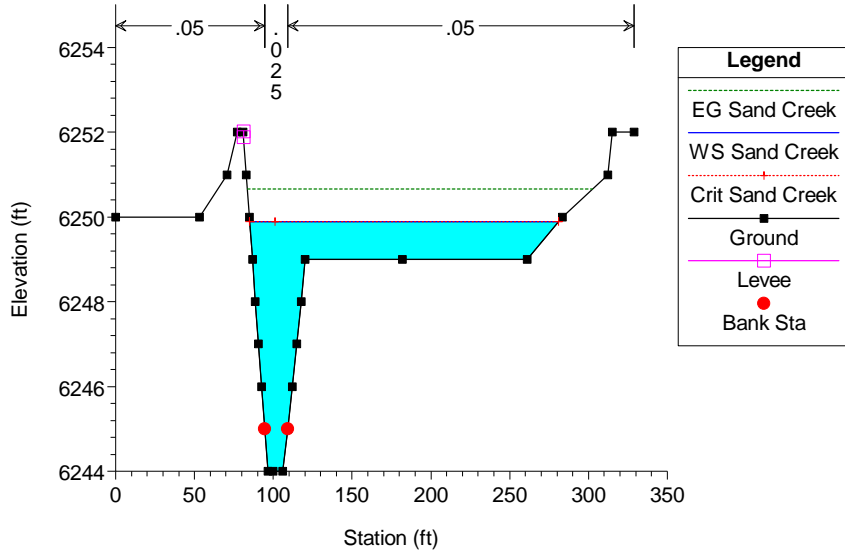


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1012

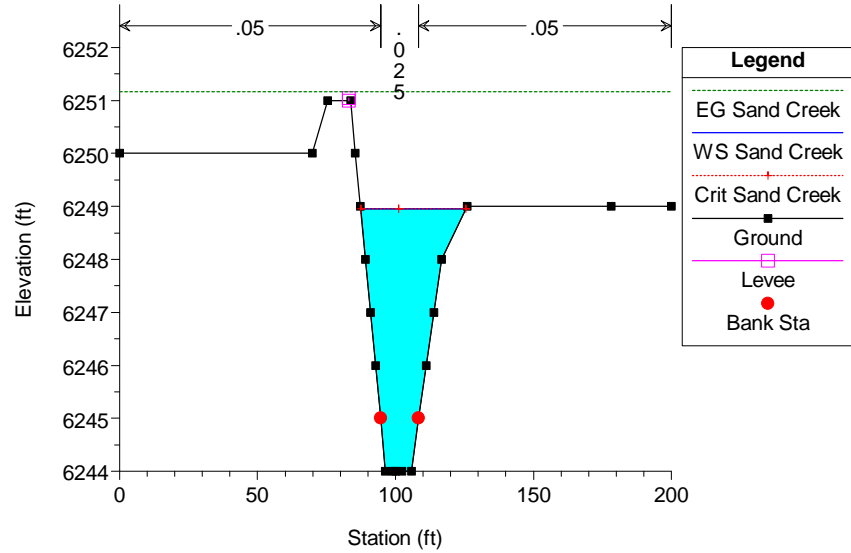


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1011

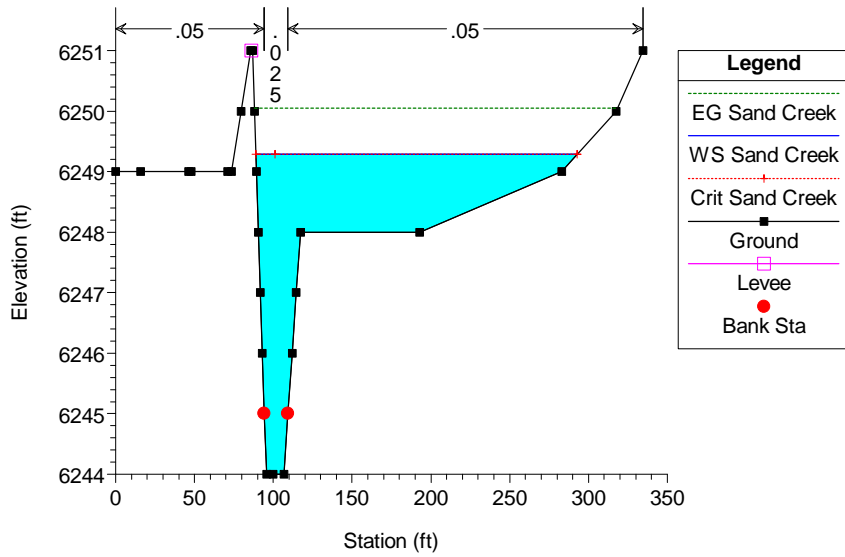


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1010

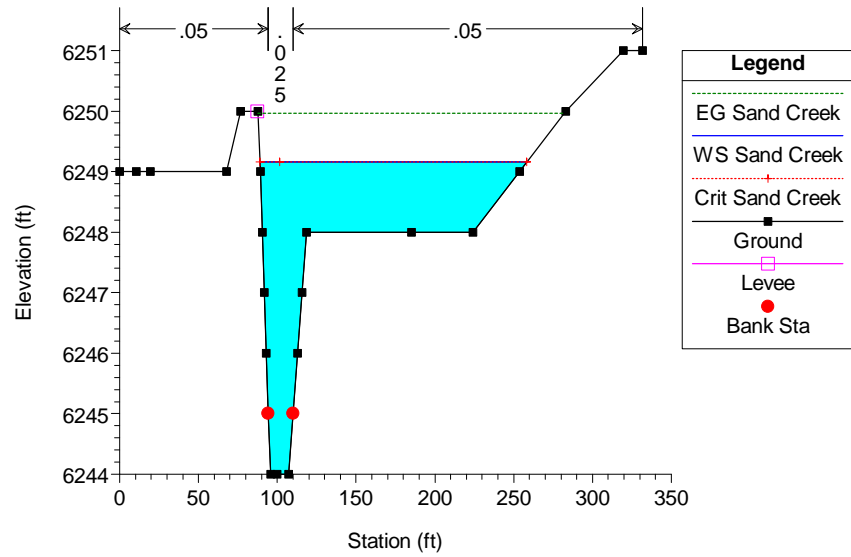


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1009

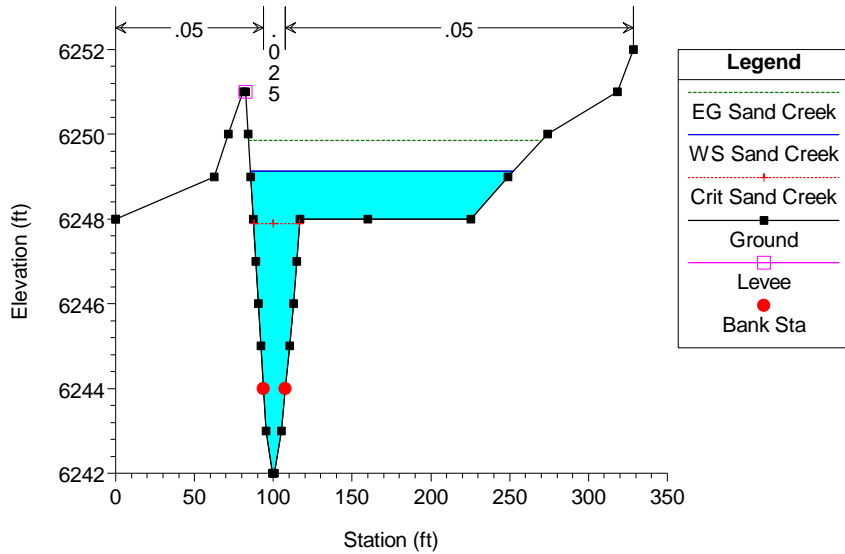


HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1008




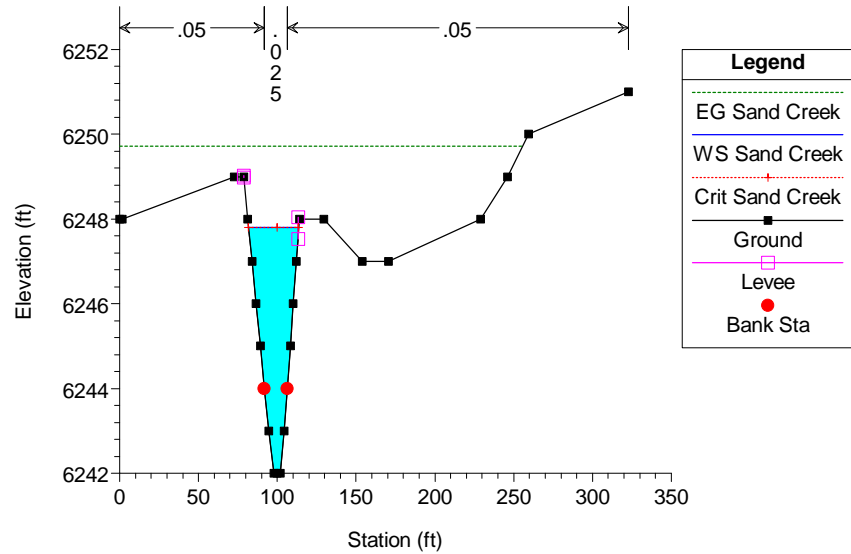






HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1007

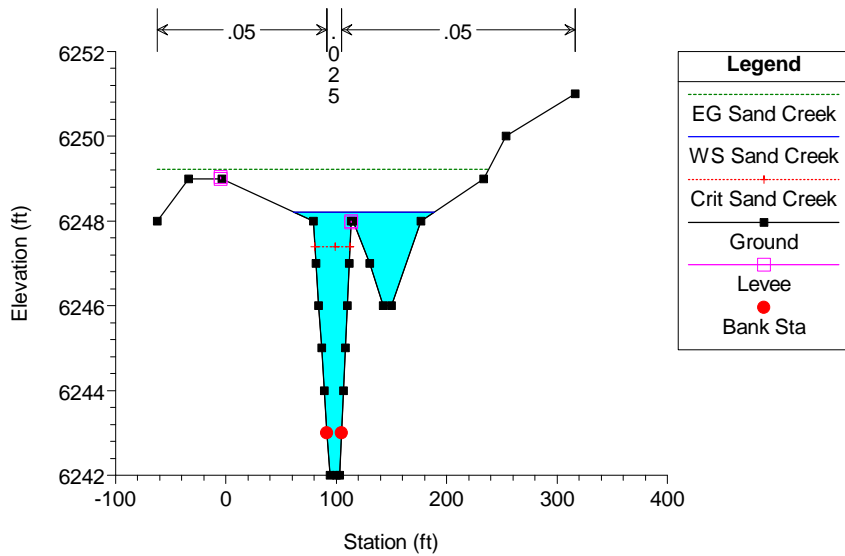

HEC-RAS Model Plan: Default Scenario 5/1/2020  
RS = 1006

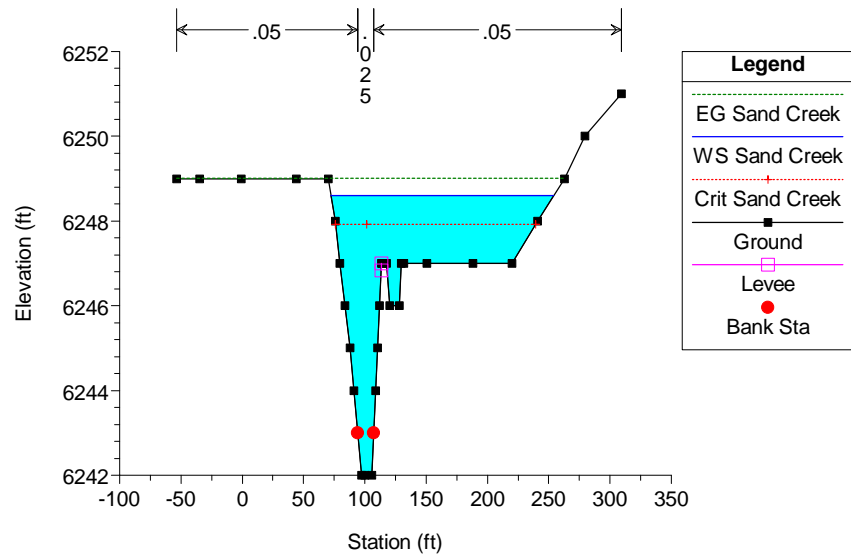


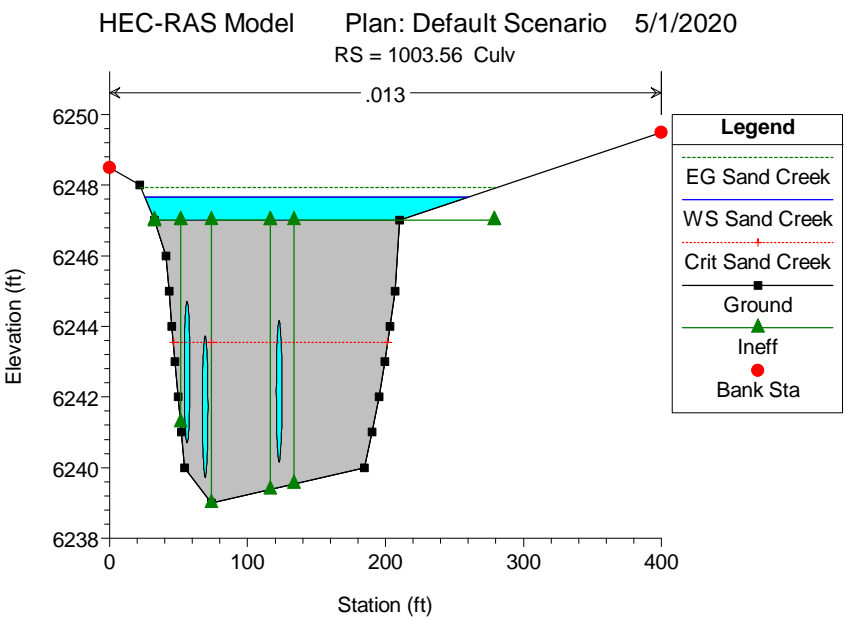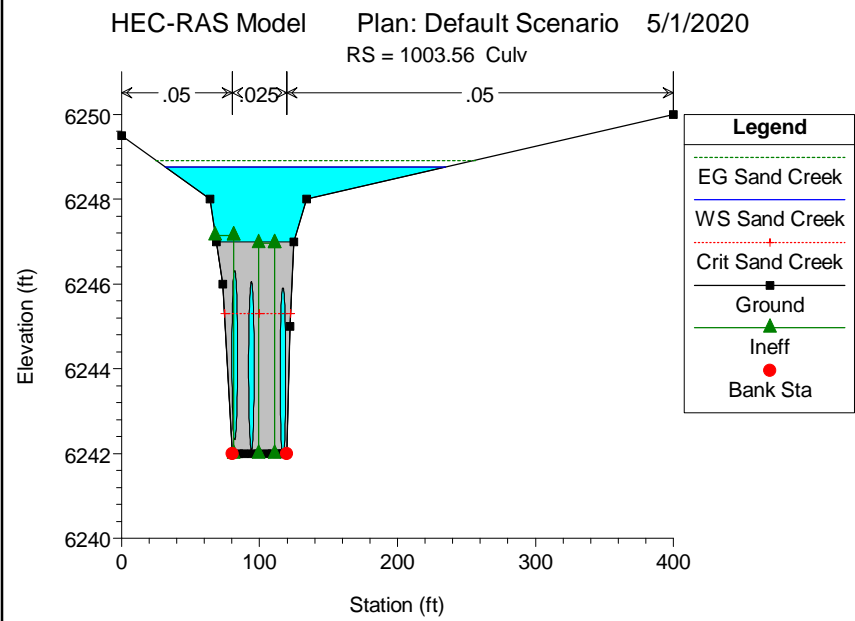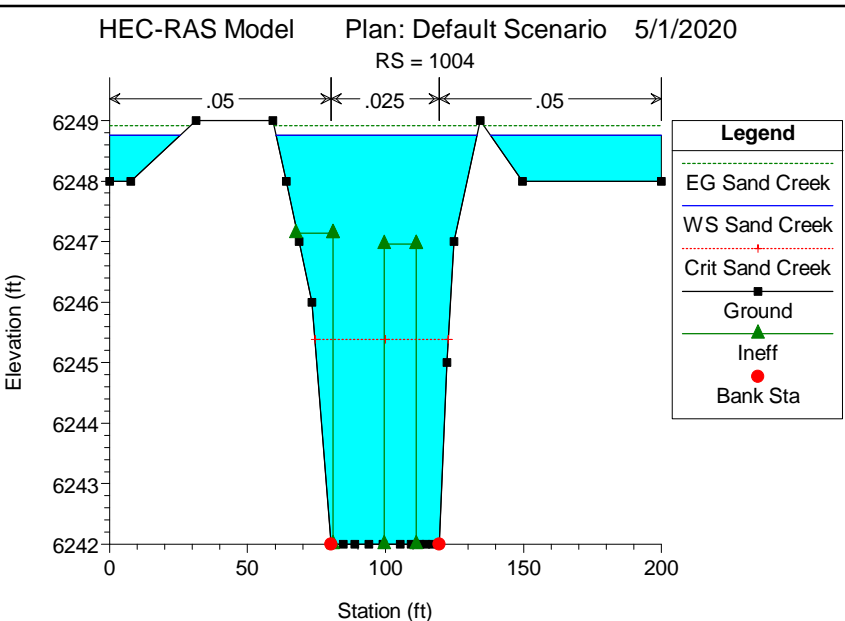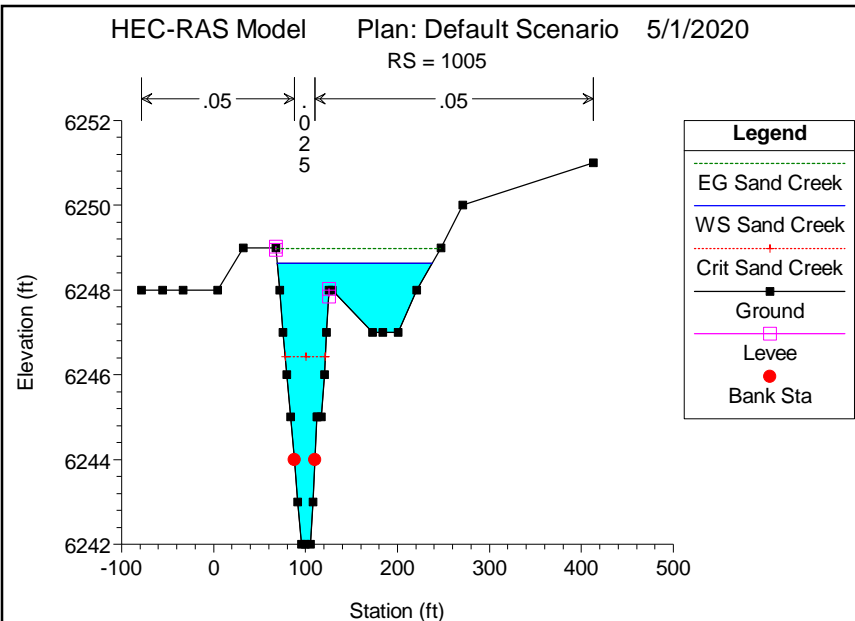

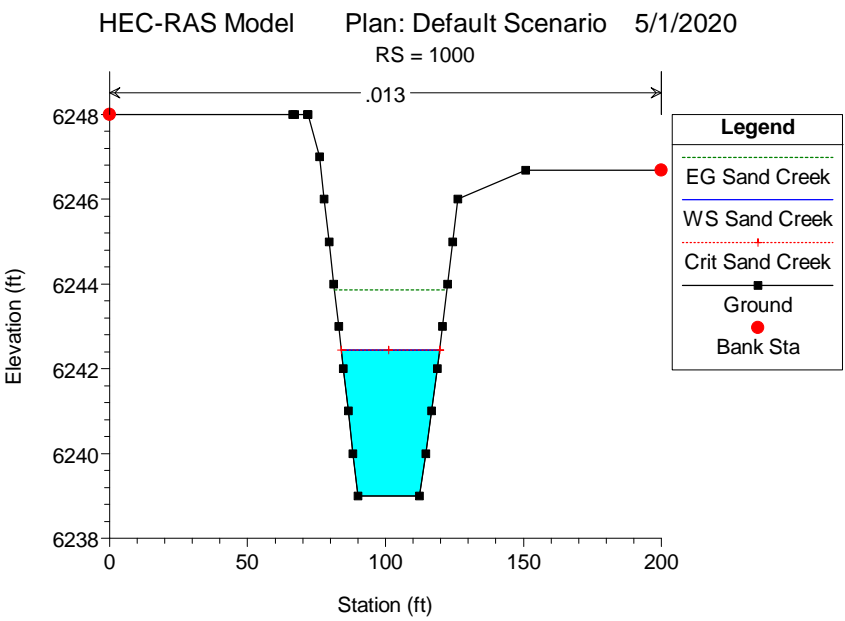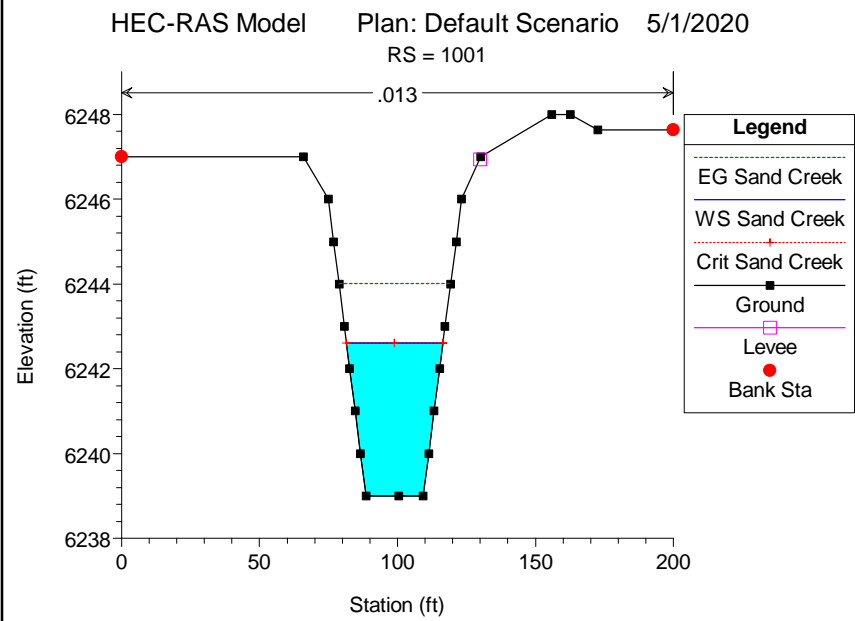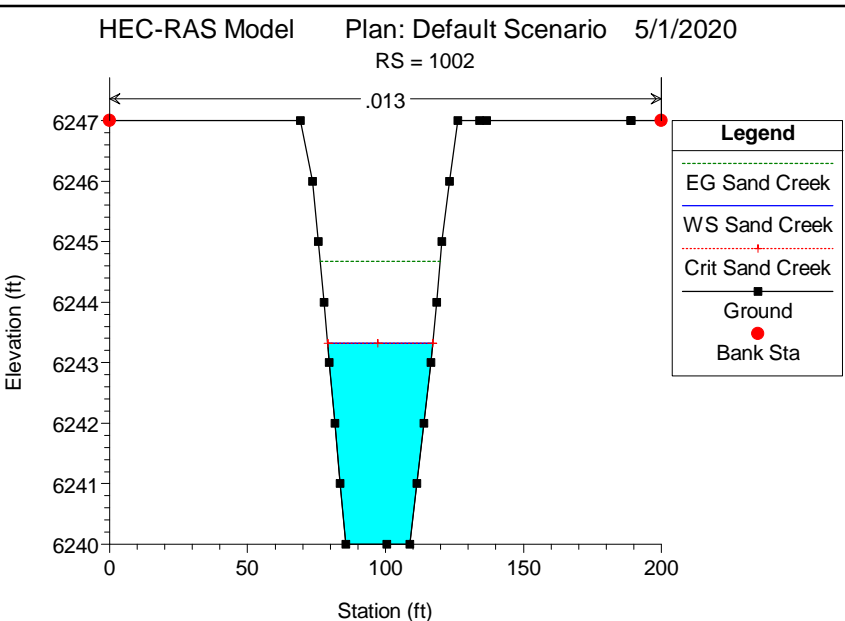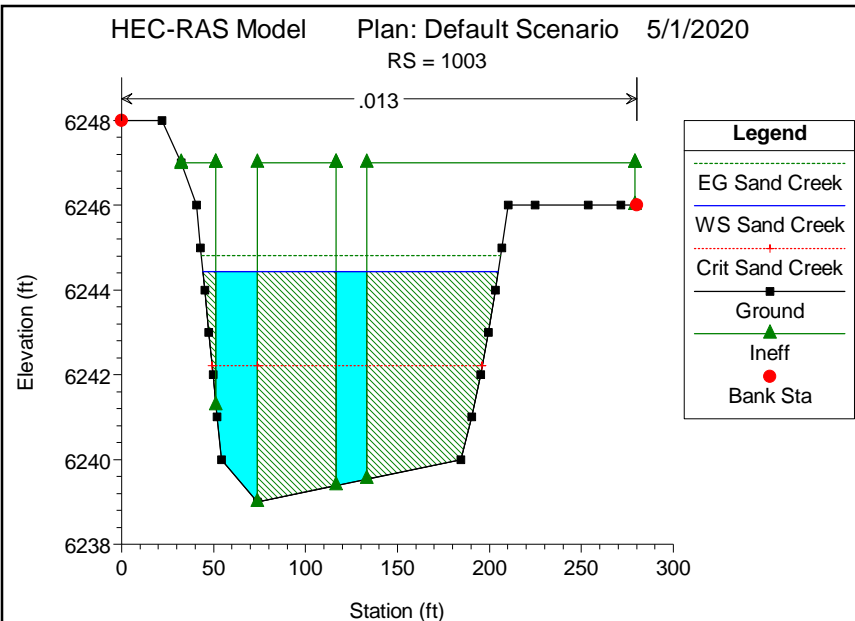





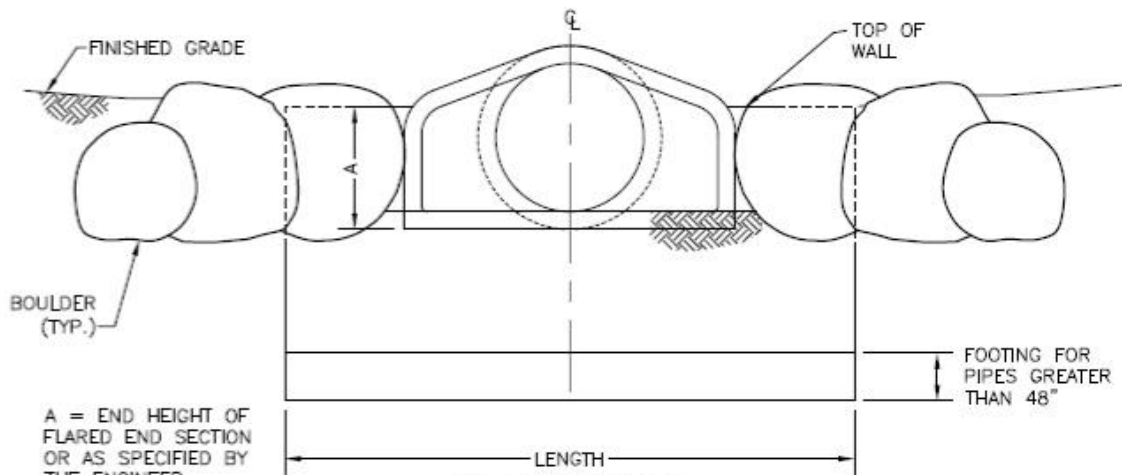


**ELEVATION VIEW**

**NOTES:**

1. IT IS THE DESIGN ENGINEER'S RESPONSIBILITY TO EVALUATE THE SITE CONDITIONS AND PROVIDE FINAL DESIGN OF BOULDER SIZES AND PLACEMENT, HEADWALL, FOOTING, REINFORCING STEEL AND FILLING OF VOIDS WITH GROUT OR ROCK.

2. INSTALL JOINT FASTENERS TO JOINT IMMEDIATELY UPSTREAM OF OUTLET. LOCATE AT 10-O'CLOCK AND 2-O'CLOCK. TRIM THREAD FLUSH WITH INTERIOR BOLTS.

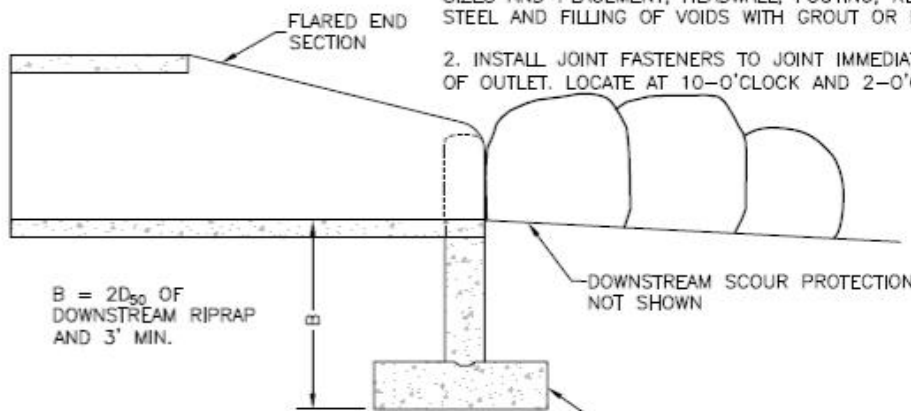


**PROFILE**

**TOEWALL DESIGN TABLE**

PIPE SIZE	LENGTH, MIN.
18"	7'-0"
24"	8'-0"
30"	10'-0"
36"	12'-0"
42"	12'-6"
48"	13'-0"
54"	13'-6"
60"	14'-0"
66"	14'-6"
72"	15'-0"

**Figure 9-30. Flared end section (FES) headwall concept**

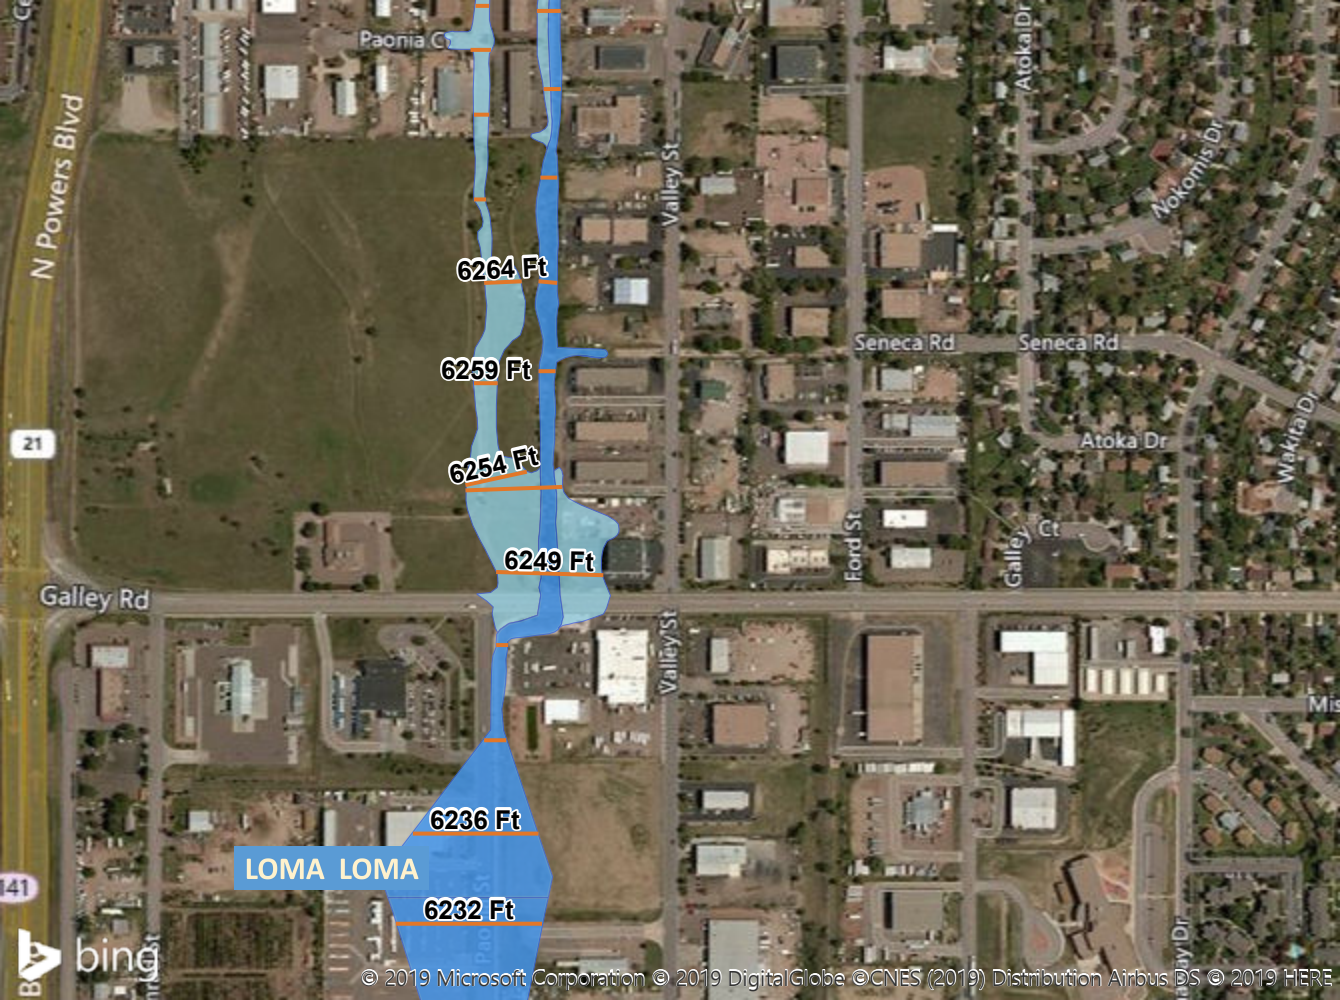

Paonia Ct

N Powers Blvd

21

6264 Ft

6259 Ft

6254 Ft

6249 Ft

6236 Ft

LOMA LOMA

6232 Ft

Valley St

Seneca Rd

Seneca Rd

Atoka Dr

Nokomis Dr

Atoka Dr

Wakita Dr

Ford St

Galley Ct

Galley Rd

Valley St

Mis

141

bing



# Channel Report

## Ex. Concrete Channel

### Trapezoidal


Bottom Width (ft) = 3.50  
Side Slopes (z:1) = 1.33, 1.53  
Total Depth (ft) = 1.75  
Invert Elev (ft) = 6267.00  
Slope (%) = 1.41  
N-Value = 0.013

### Highlighted

Depth (ft) = 0.88  
Q (cfs) = 42.08  
Area (sqft) = 4.19  
Velocity (ft/s) = 10.05  
Wetted Perim (ft) = 6.57  
Crit Depth, Yc (ft) = 1.37  
Top Width (ft) = 6.02  
EGL (ft) = 2.45

### Calculations

Compute by: Known Depth  
Known Depth (ft) = 0.88

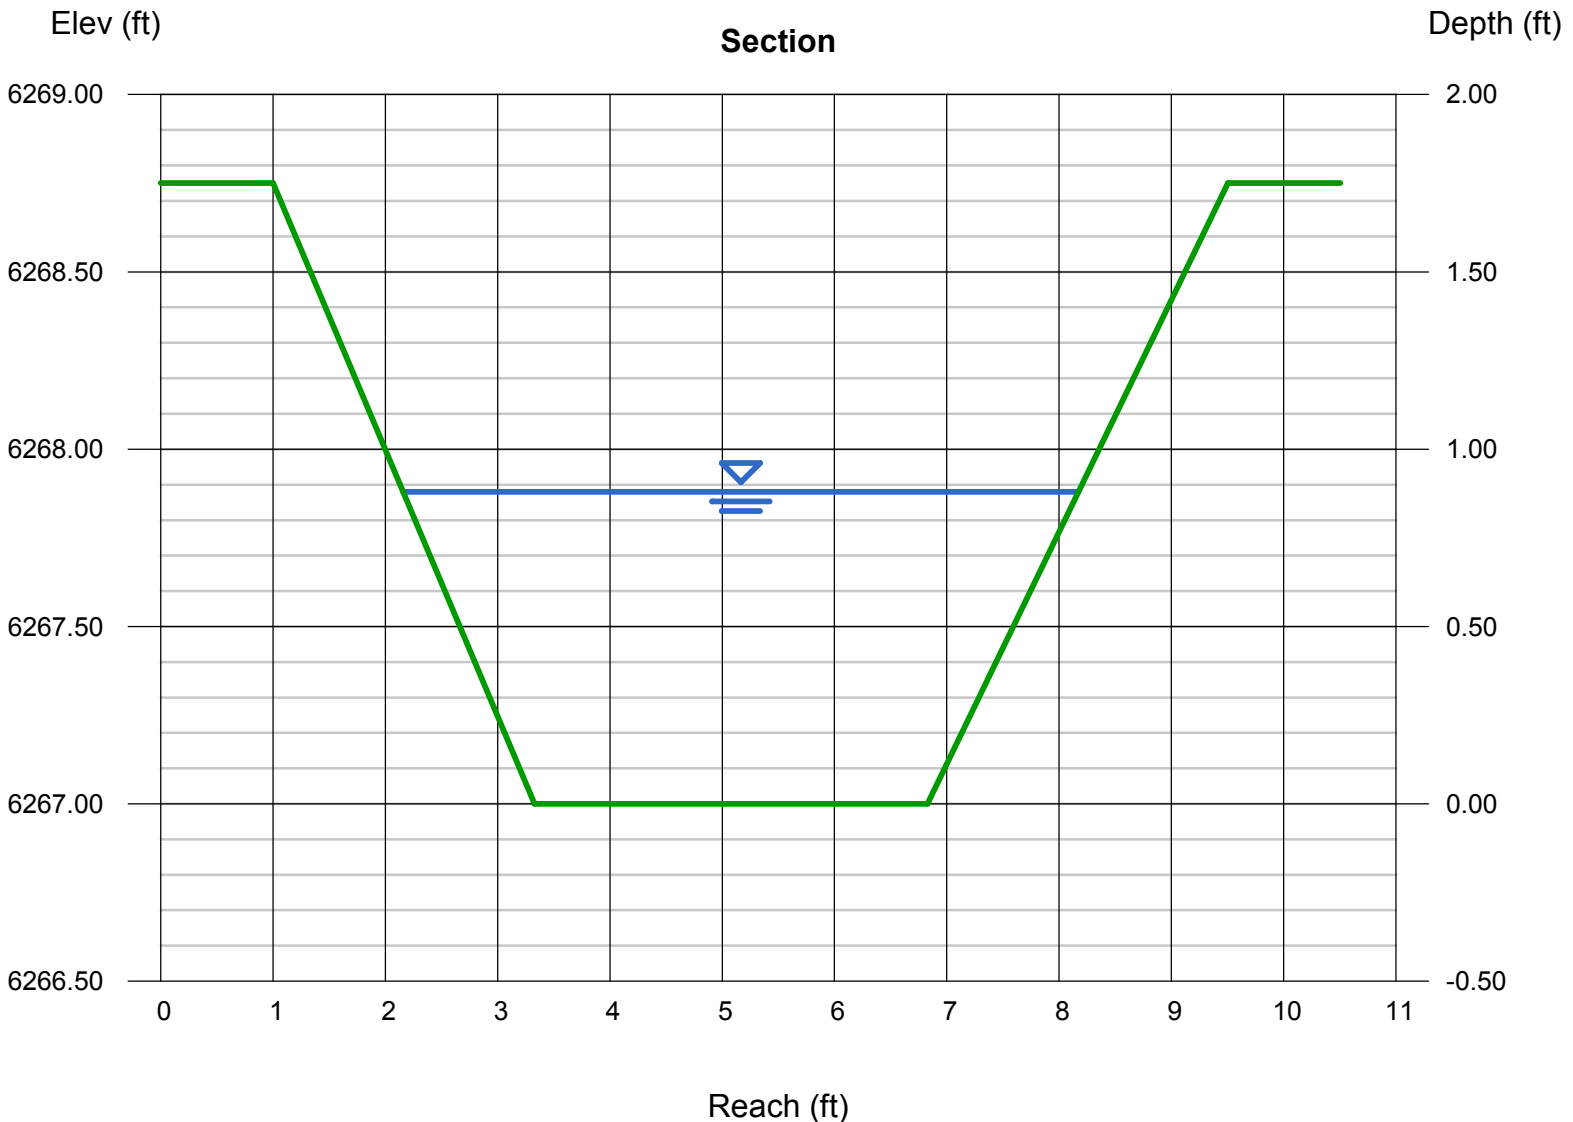

# Channel Report

## Overflow Channel

### Trapezoidal


Bottom Width (ft) = 80.00  
Side Slopes (z:1) = 6.80, 6.80  
Total Depth (ft) = 0.50  
Invert Elev (ft) = 6265.66  
Slope (%) = 1.68  
N-Value = 0.017

### Highlighted

Depth (ft) = 0.50  
Q (cfs) = 289.57  
Area (sqft) = 41.70  
Velocity (ft/s) = 6.94  
Wetted Perim (ft) = 86.87  
Crit Depth, Yc (ft) = 0.50  
Top Width (ft) = 86.80  
EGL (ft) = 1.25

### Calculations

Compute by: Q vs Depth  
No. Increments = 10

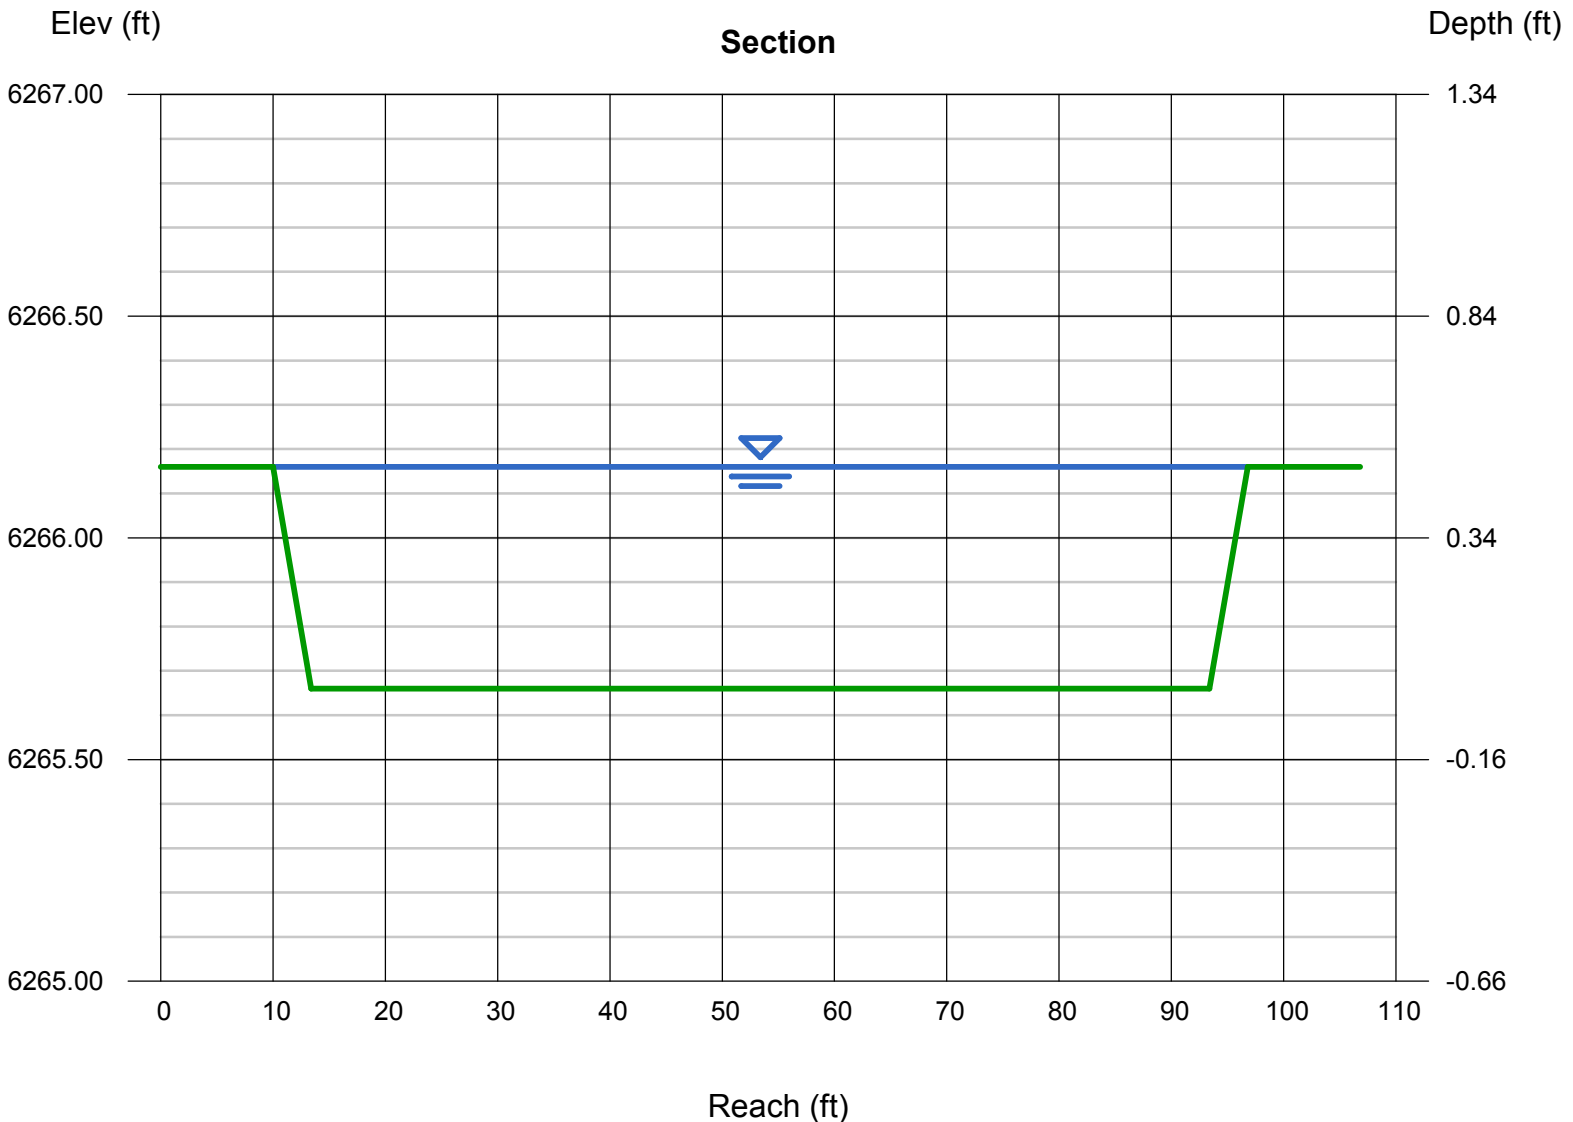

# Channel Report

## Overflow Channel

### Trapezoidal


Bottom Width (ft) = 50.00  
Side Slopes (z:1) = 6.80, 6.80  
Total Depth (ft) = 1.00  
Invert Elev (ft) = 6265.66  
Slope (%) = 1.68  
N-Value = 0.033

### Highlighted

Depth (ft) = 1.00  
Q (cfs) = 306.96  
Area (sqft) = 56.80  
Velocity (ft/s) = 5.40  
Wetted Perim (ft) = 63.75  
Crit Depth, Yc (ft) = 1.00  
Top Width (ft) = 63.60  
EGL (ft) = 1.45

### Calculations

Compute by: Q vs Depth  
No. Increments = 10

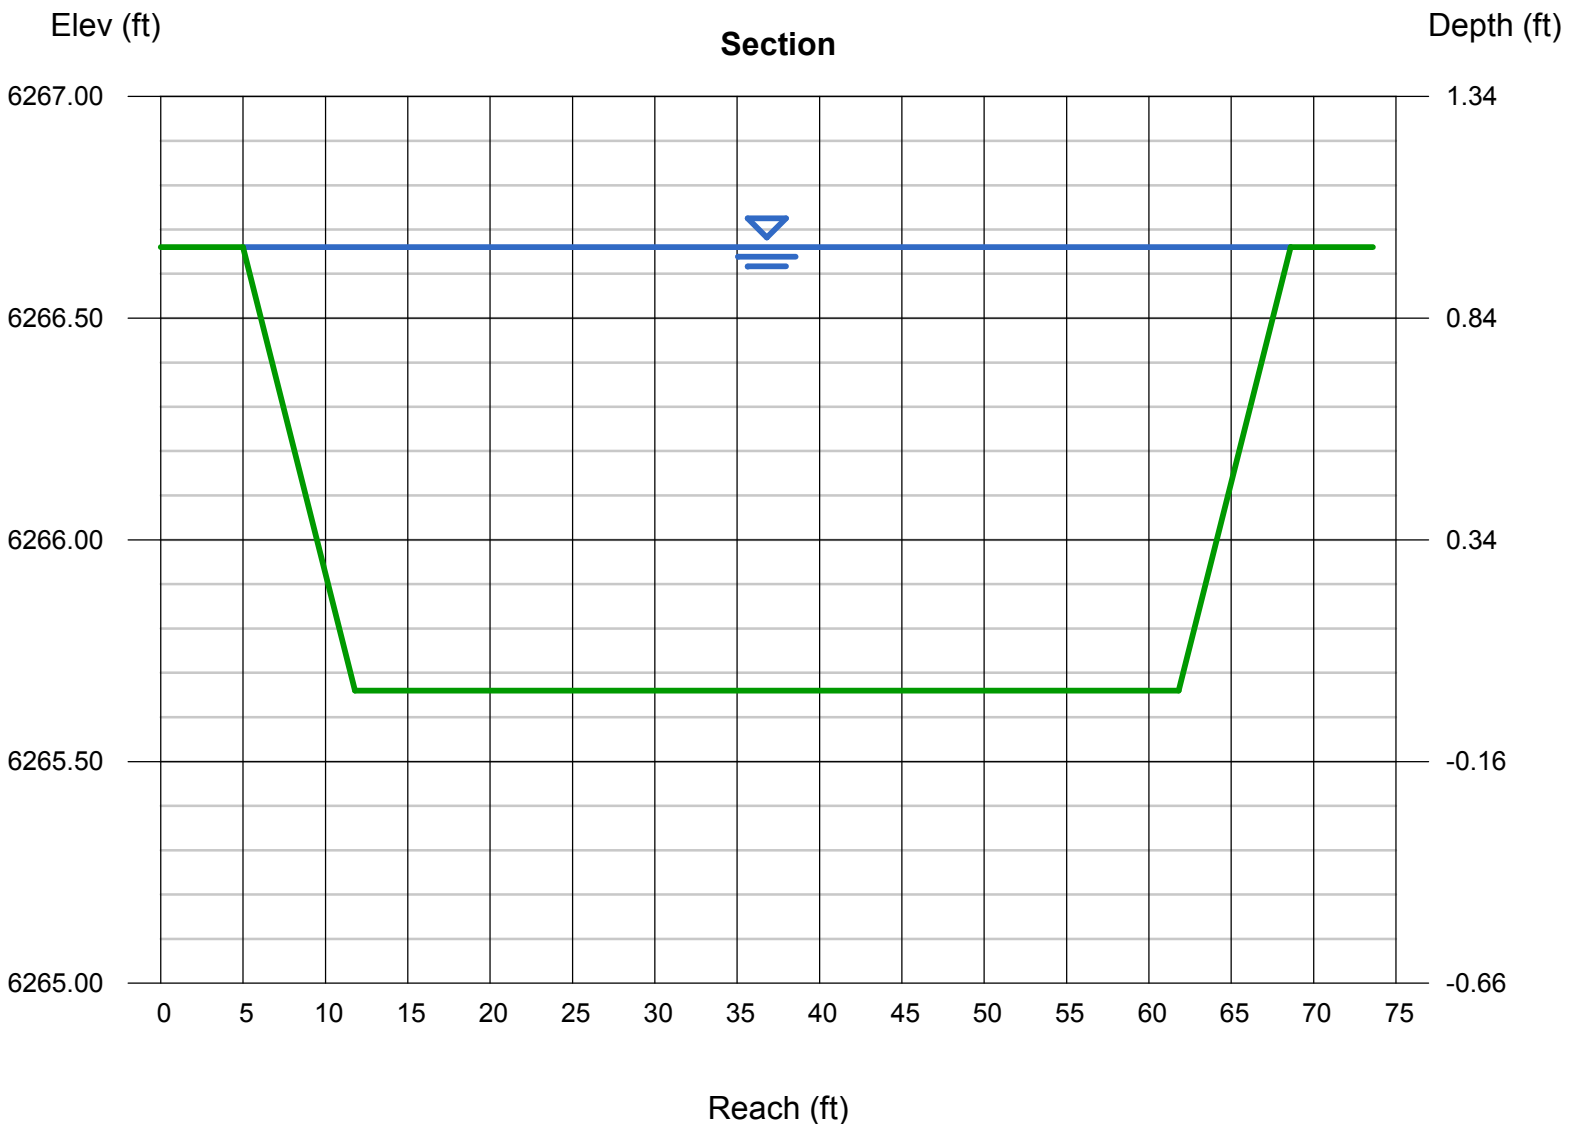

# Channel Report

## Paonia Street Ex.

### User-defined

Invert Elev (ft) = 6271.04  
Slope (%) = 1.00  
N-Value = 0.016

### Highlighted


Depth (ft) = 0.89  
Q (cfs) = 211.00  
Area (sqft) = 35.88  
Velocity (ft/s) = 5.88  
Wetted Perim (ft) = 69.60  
Crit Depth, Yc (ft) = 1.05  
Top Width (ft) = 69.57  
EGL (ft) = 1.43

### Calculations


Compute by: Known Q  
Known Q (cfs) = 211.00

### (Sta, El, n)-(Sta, El, n)...

(0.00, 6273.30)-(48.06, 6271.58, 0.016)-(86.95, 6271.04, 0.016)-(95.27, 6271.26, 0.016)-(99.33, 6271.58, 0.016)-(135.09, 6273.05, 0.016)

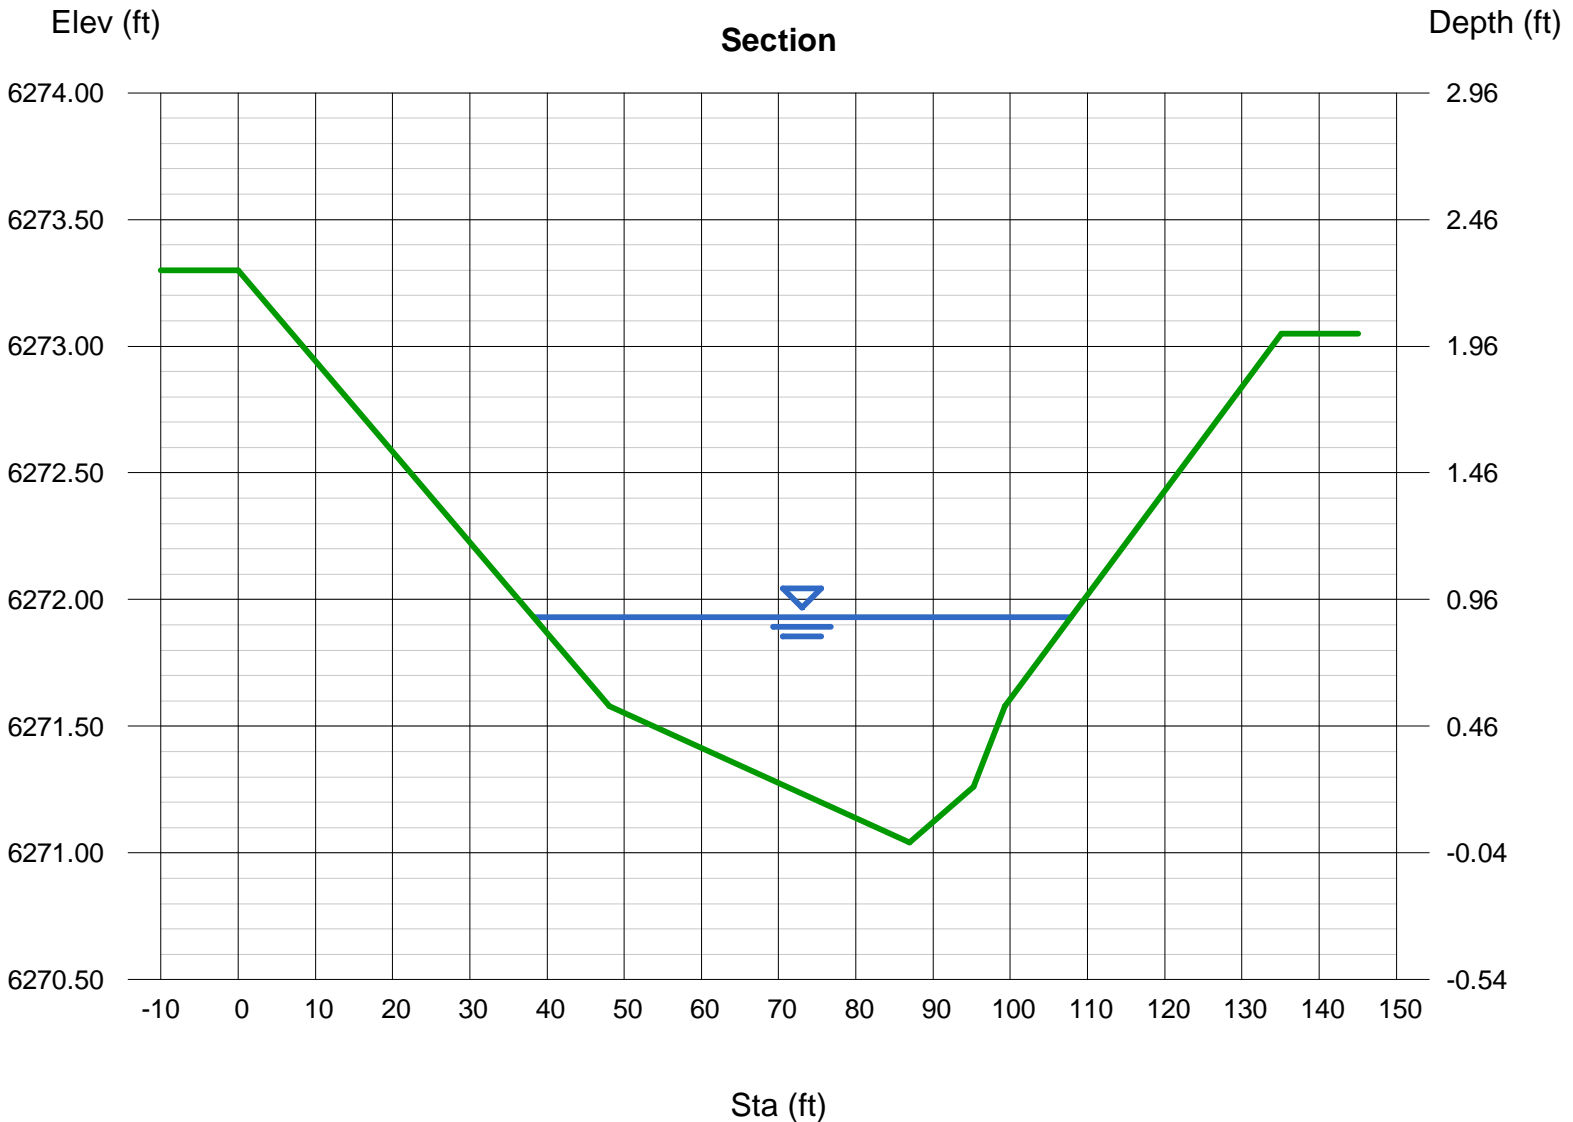

**APPENDIX E**  
**DRAINAGE MAPS & PLANS**

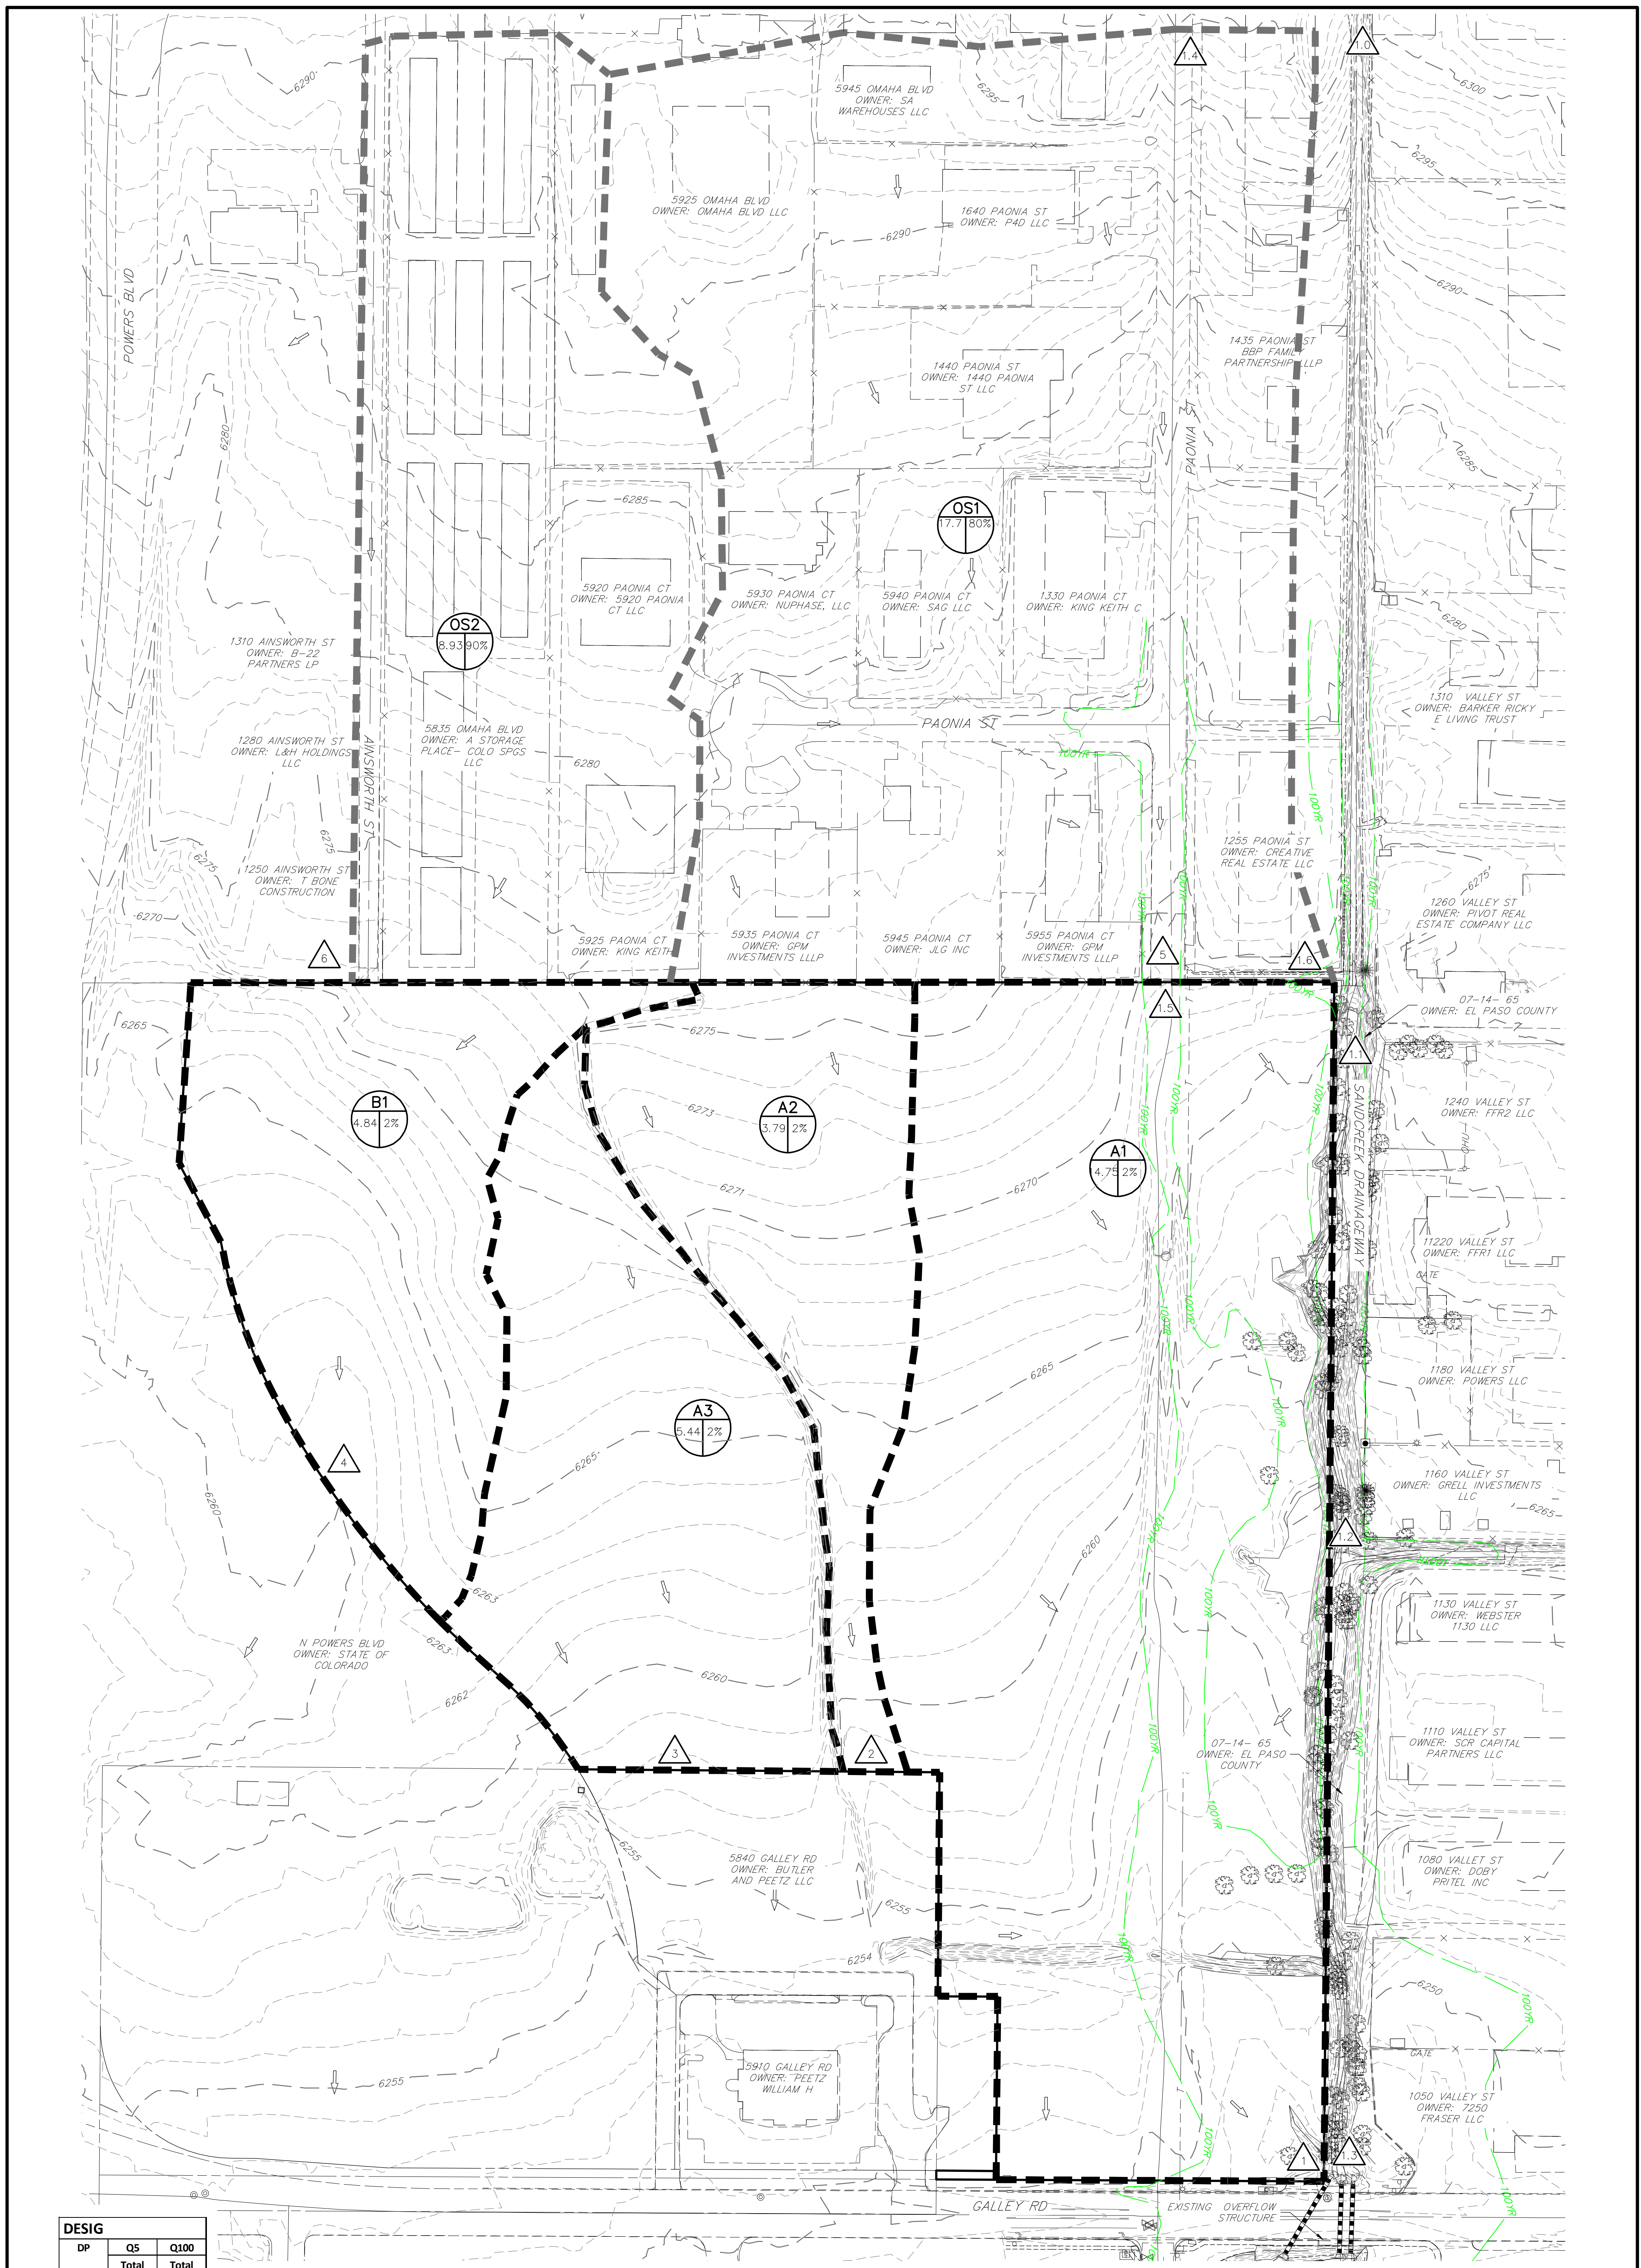


DESIG	DESIGN	
	Q5	Q100
DP	Total	Total
1	3.1	21.0
2	0.9	6.2
3	1.4	9.5
4	1.3	9.0
5	36.7	286.1
6	28.4	52.9
1.0	-	760.0
1.1	-	720.0
1.2	-	960.0
1.3	-	1340.0
1.4	-	213.0
1.5	-	244.0
1.6	-	42.1

BASIN SUMMARY TABLE							
Tributary Sub-basin	Area (acres)	Percent Impervious	C <sub>s</sub>	C <sub>100</sub>	t <sub>c</sub> (min)	Q <sub>c</sub> (cfs)	Q <sub>100</sub> (cfs)
A1	14.75	2%	0.09	0.36	32.5	3.1	21.0
A2	3.79	2%	0.09	0.36	25.4	0.9	6.2
A3	5.44	2%	0.09	0.36	22.7	1.4	9.5
B1	4.84	2%	0.09	0.36	20.3	1.3	9.0
OS1	17.73	80%	0.59	0.70	15.1	36.7	73.1
OS2	8.93	90%	0.73	0.81	8.6	28.4	52.9

**LEGEND:**

- 6200 — EXISTING MAJOR CONTOUR
- - - EXISTING MINOR CONTOUR
- - - DRAINAGE BASIN
- (A) (B) (C) A = BASIN DESIGNATION  
B = AREA IN ACRES  
C = PERCENT IMPERVIOUS
- △ DESIGN POINT
- HP HIGH POINT
- LP LOW POINT
- ← EXISTING DRAINAGE ARROW

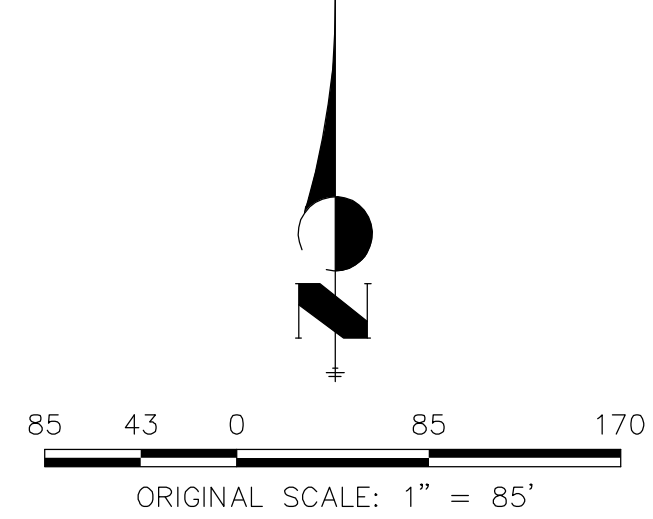

EXISTING DRAINAGE MAP  
 SOLACE APARTMENTS  
 JOB NO. 25174.00  
 6/29/20  
 SHEET 1 OF 1

**J-R ENGINEERING**  
 A Westrian Company

Centennial 303-740-9393 • Colorado Springs 719-593-2593  
 Fort Collins 970-491-9888 • www.jrengineering.com

**DESIGN POINT**



DP	Q5	Q100
	Total	Total
1	15.3	36.3
2	21.2	50.0
3	1.3	4.6
4	36.7	286.1
5	28.4	52.9
6	0.6	1.9
1.0	-	760.0
1.1	-	720.0
1.2	-	960.0
1.3	-	1340.0
1.4	-	213.0

**BASIN SUMMARY TABLE**

Tributary Sub-basin	Area (acres)	Percent Impervious	C <sub>s</sub>	C <sub>100</sub>	t <sub>c</sub> (min)	Q <sub>s</sub> (cfs)	Q <sub>100</sub> (cfs)
A1	9.13	44%	0.43	0.61	11.6	15.3	36.3
B1	16.23	45%	0.43	0.60	20.7	21.2	50.0
B2	1.61	17%	0.22	0.45	13.0	1.3	4.6
C1	0.65	20%	0.24	0.47	13.8	0.6	1.9
OS1	17.73	80%	0.59	0.70	15.1	36.7	73.1
OS2	8.93	90%	0.73	0.81	8.6	28.4	52.9

**LEGEND:**

- PROPOSED STORM SEWER
- PROPOSED MAJOR CONTOUR
- PROPOSED MINOR CONTOUR
- EXISTING MAJOR CONTOUR
- EXISTING MINOR CONTOUR
- DRAINAGE BASIN
- A = BASIN DESIGNATION  
B = AREA IN ACRES  
C = PERCENT IMPERVIOUS
- DESIGN POINT
- HIGH POINT
- LOW POINT
- DRAINAGE ARROW
- EXISTING DRAINAGE ARROW

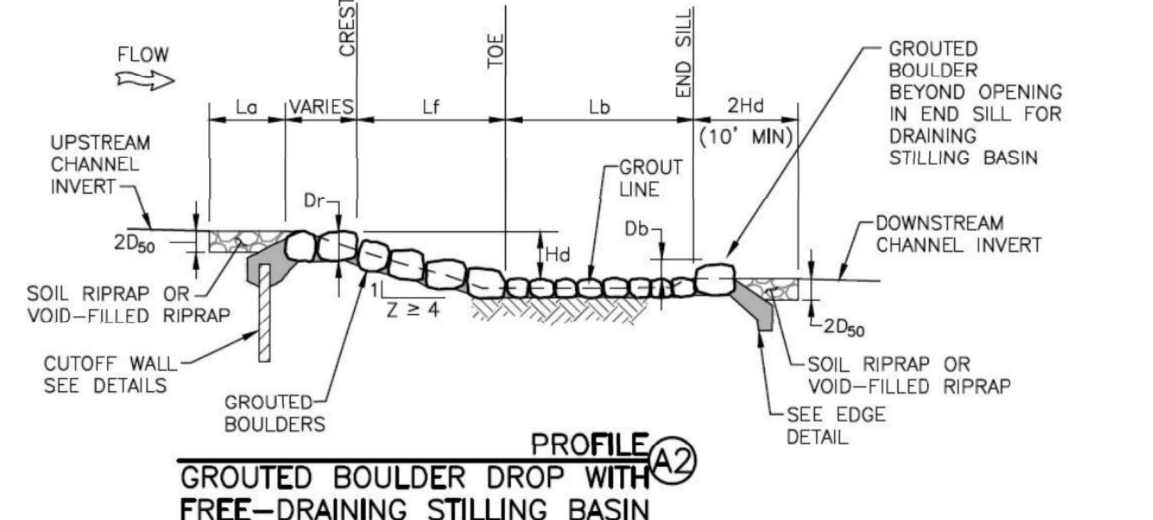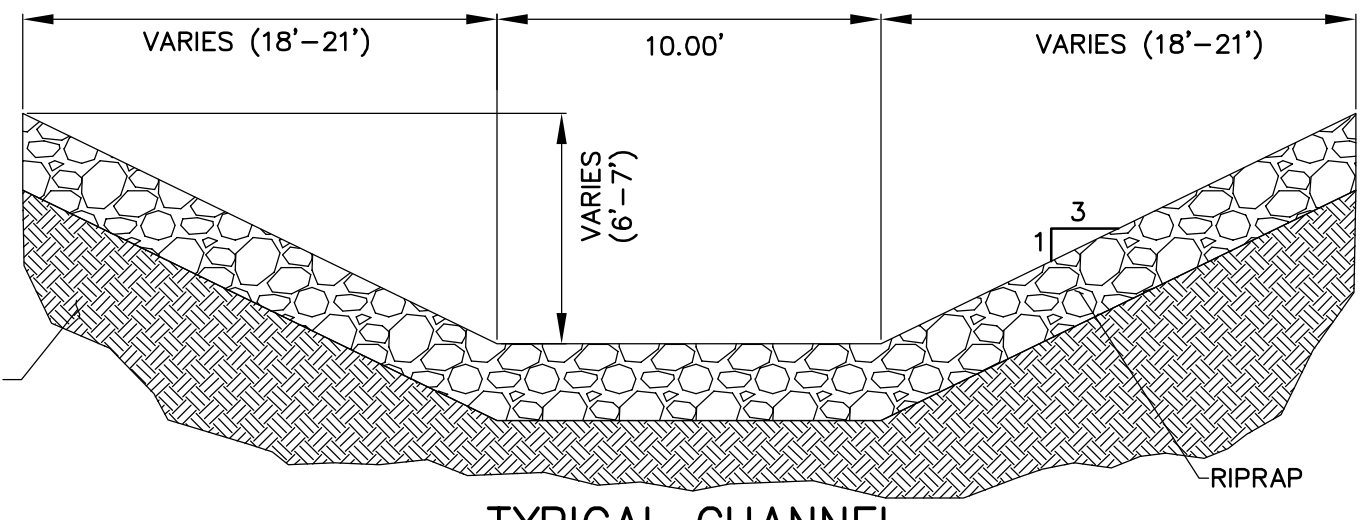

DETENTION POND A  
REQUIRED: 0.838 AC-FT  
REQUIRED DEPTH: 3.1'  
PROVIDED: 1.416 AC-FT  
PROVIDED DEPTH: 6'  
Q<sub>s in</sub> = 15.3 CFS Q<sub>100 in</sub> = 36.3 CFS  
Q<sub>s out</sub> = 2.8 CFS Q<sub>100 out</sub> = 18.9 CFS

DETENTION POND B  
REQUIRED: 1.641 AC-FT  
REQUIRED DEPTH: 3'  
PROVIDED: 2.531 AC-FT  
PROVIDED DEPTH: 4'  
Q<sub>s in</sub> = 22.5 CFS Q<sub>100 in</sub> = 54.6 CFS  
Q<sub>s out</sub> = 3.2 CFS Q<sub>100 out</sub> = 22.2 CFS

See comment on the channel analysis and revise accordingly

see comments on the channel analysis and revise accordingly

DRAINAGE MAP  
SOLACE APARTMENTS  
JOB NO. 25174.00  
6/26/20  
SHEET 1 OF 1



Centennial 303-740-9393 • Colorado Springs 719-593-2593  
Fort Collins 970-491-9888 • www.jrengineering.com