



Know what's below. Call before you dig.

THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

# HAY CREEK VALLEY

## EL PASO COUNTY, COLORADO

### FINAL GRADING & EROSION CONTROL PLANS

MAY 2024


INDEX OF SHEETS		SHEET No.
TS01	TITLE SHEET	01
GN01	KEY MAP	02
GN02	GENERAL NOTES	03
GEC01-GEC06	GRADING & EROSION CONTROL PLAN	04-09
ECN01-ECN03	DETAILS	10-12

#### AGENCY CONTACT INFO

OWNER/DEVELOPER	VIEW HOMES, INC. 555 MIDDLE CREEK PARKWAY, SUITE 500 COLORADO SPRINGS, CO 80921 TIM BUSCHAR, (719)-382-9433
CIVIL ENGINEER	MATRIX DESIGN GROUP 2435 RESEARCH PARKWAY, SUITE 300 COLORADO SPRINGS, CO 80920 (719)-575-0100
ELECTRIC	MOUNTAIN VIEW ELECTRIC ASSOCIATION 15706 JACKSON CREEK PARKWAY, SUITE 100 MONUMENT, CO 80132 GINA PERRY, (719) 494-2636
GAS	BLACK HILLS ENERGY 105 S VICTORIA AVENUE PUEBLO, CO 81003 (800) 303-0752
ENGINEERING	EL PASO COUNTY PUBLIC WORKS DEPARTMENT 3275 AKERS DRIVE COLORADO SPRINGS, CO 80922 (719) 520-6460
TRAFFIC	EL PASO COUNTY PUBLIC WORKS DEPARTMENT 3275 AKERS DRIVE COLORADO SPRINGS, CO 80922 (719) 520-6460
DRAINAGE	EL PASO COUNTY PUBLIC WORKS DEPARTMENT 3275 AKERS DRIVE COLORADO SPRINGS, CO 80922 (719) 520-6460
FIRE DEPARTMENT	MONUMENT FIRE DISTRICT 16055 OLD FOREST POINT, SUITE 102 MONUMENT, CO 80132 (719)-484-0911



SITE MAP  
1" = 500'

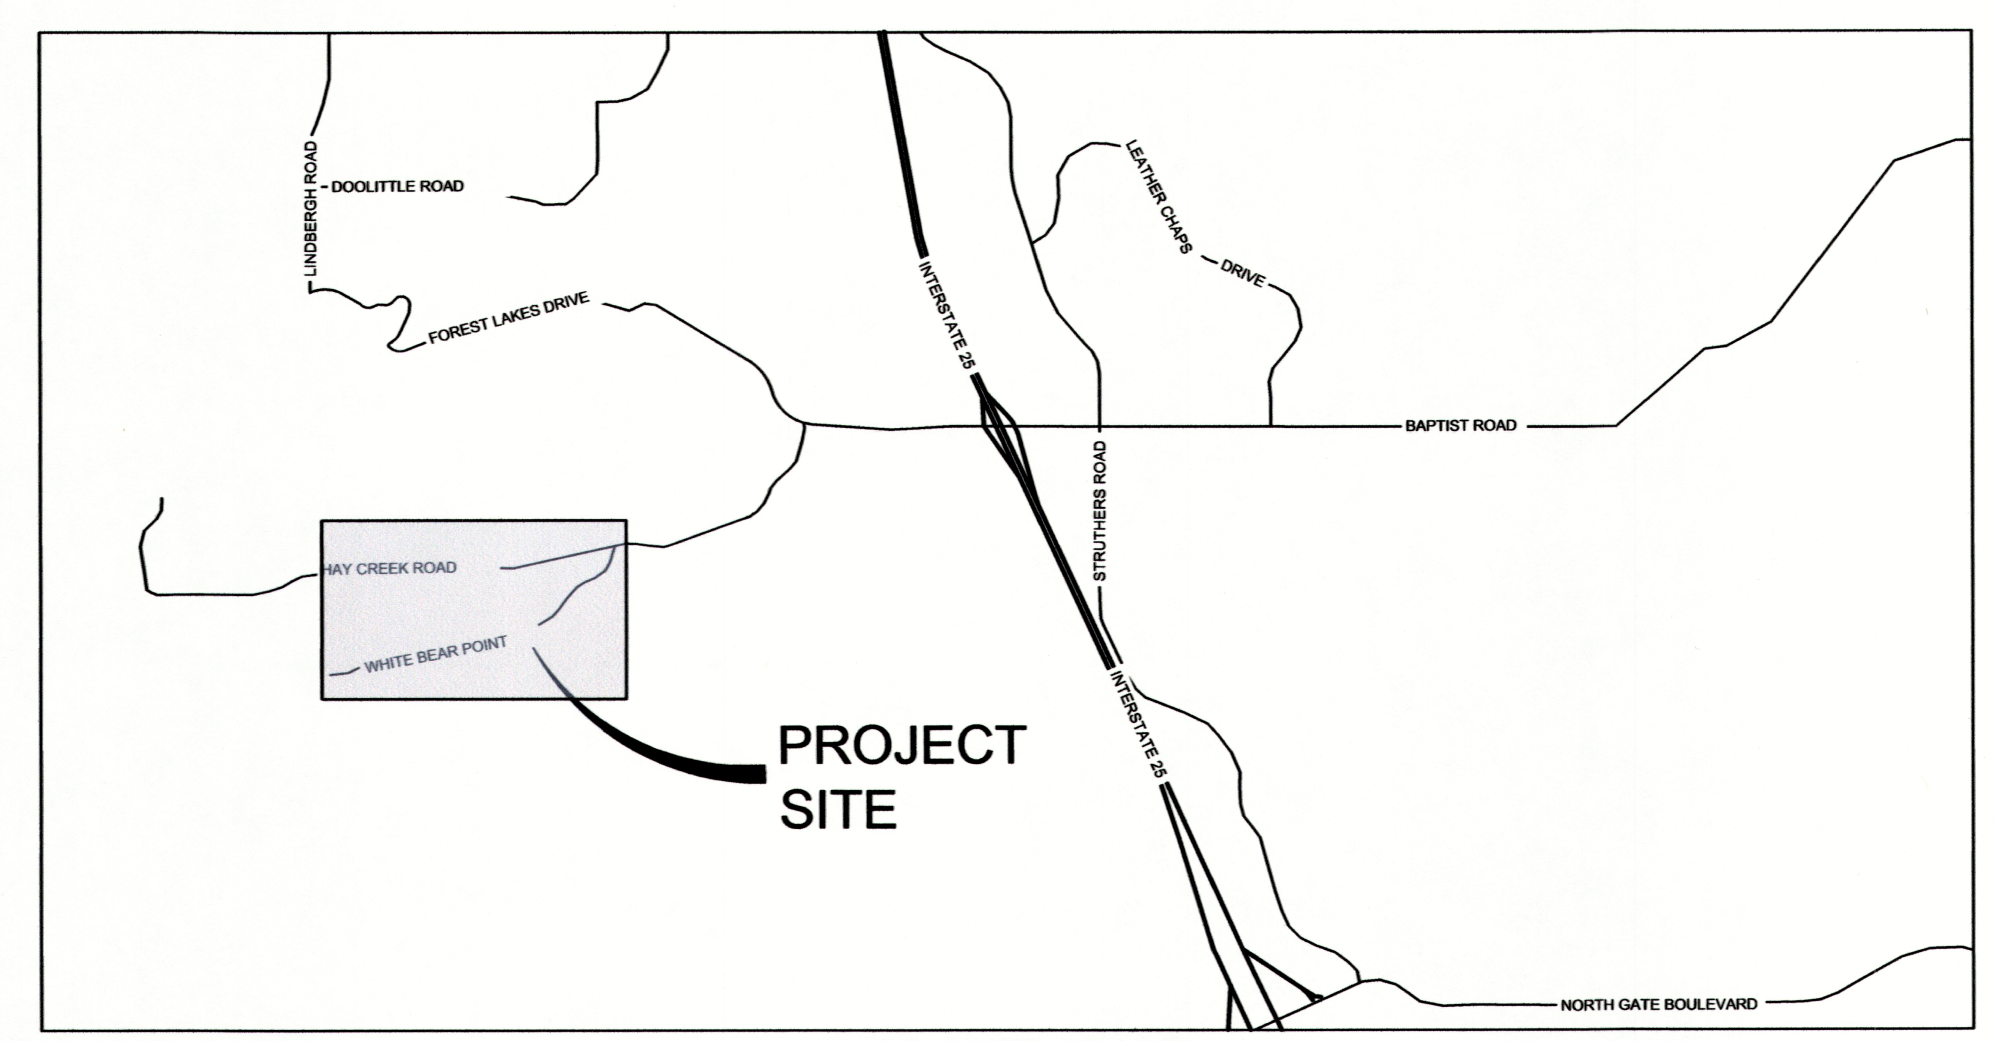

VICINITY MAP  
N.T.S.

#### OWNER/DEVELOPER'S STATEMENT:

I, THE OWNER/DEVELOPER HAVE READ AND WILL COMPLY WITH THE REQUIREMENTS OF THE GRADING AND EROSION CONTROL PLAN.

NAME: *Tim Buschar*

DATE: 5/10/24

TIM BUSCHAR, (719)-382-9433  
VIEW HOMES, INC.  
555 MIDDLE CREEK PARKWAY, SUITE 500  
COLORADO SPRINGS, CO 80921

#### DESIGN ENGINEER'S STATEMENT:

THIS GRADING AND EROSION CONTROL PLAN WAS PREPARED UNDER MY DIRECTION AND SUPERVISION AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF. SAID PLAN HAS BEEN PREPARED ACCORDING TO THE CRITERIA ESTABLISHED BY THE COUNTY FOR GRADING AND EROSION CONTROL PLANS. I ACCEPT RESPONSIBILITY FOR ANY LIABILITY CAUSED BY ANY NEGLIGENT ACTS, ERRORS OR OMISSIONS ON MY PART IN PREPARING THIS PLAN.

BY: *Jeffrey A. Odor*

DATE: 5/28/2024

JEFFREY A. ODOR, PE #39265  
FOR AND ON BEHALF OF MATRIX DESIGN GROUP, INC.

#### EL PASO COUNTY:

COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH COUNTY DESIGN CRITERIA. THE COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSIONS, AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED AT THE JOB SITE. THE COUNTY THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT.

FILED IN ACCORDANCE WITH THE REQUIREMENTS OF THE EL PASO COUNTY LAND DEVELOPMENT CODE, DRAINAGE CRITERIA MANUAL VOLUMES 1 AND 2, AND ENGINEERING CRITERIA MANUAL, AS AMENDED.

IN ACCORDANCE WITH ECM SECTION 1.12, THESE CONSTRUCTION DOCUMENTS WILL BE VALID FOR CONSTRUCTION FOR A PERIOD OF 2 YEARS FROM THE DATE SIGNED BY THE EL PASO COUNTY ENGINEER. IF CONSTRUCTION HAS NOT STARTED WITHIN THOSE 2 YEARS, THE PLANS WILL NEED TO BE RESUBMITTED FOR APPROVAL, INCLUDING PAYMENT OF REVIEW FEES AT THE PLANNING AND COMMUNITY DEVELOPMENT DIRECTOR'S DISCRETION.

JOSHUA PALMER, P.E.  
COUNTY ENGINEER / ECM ADMINISTRATOR


DATE: 07/02/2024

PCD FILE #: SF2324

REFERENCE DRAWINGS	No.	DATE	DESCRIPTION	BY
X-TITLE-CD				
X-886-PR-SITE				
FEMA_X3				
X-886-066-EX-MAP-1				
164022-01 Hay Creek Road BNEY				
X-886-ALTA-SURVEY				
Hay Creek BFEs				

COMPUTER FILE MANAGEMENT	
FILE NAME:	S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\TS01.dwg
CTB FILE:	Matrix.ctb
PLOT DATE:	1/26/2024 3:01 PM
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.	

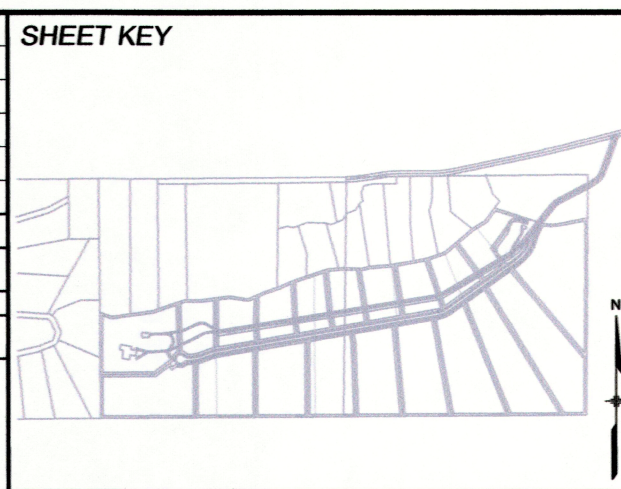

**BENCHMARK**  
PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PLS25955 C1/4 S22 T15S, R65W 1999, "AND THE WESTERLY END BY A2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T15S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:  
**Matrix**  
Excellence by Design





HAY CREEK VALLEY	
EL PASO COUNTY, COLORADO FINAL GRADING & EROSION CONTROL PLANS	
TITLE SHEET	
DESIGNED BY: CVW	SCALE: N/A
DRAWN BY: CWW	HORIZ: N/A
CHECKED BY: JAO	VERT: N/A
DATE ISSUED: MAY 2024	DRAWING No. TS01
SHEET 01	OF 12




Know what's below.  
Call before you dig.

THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

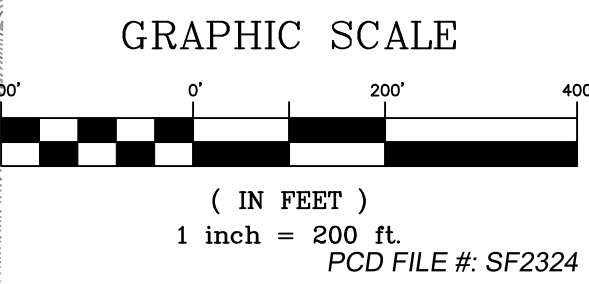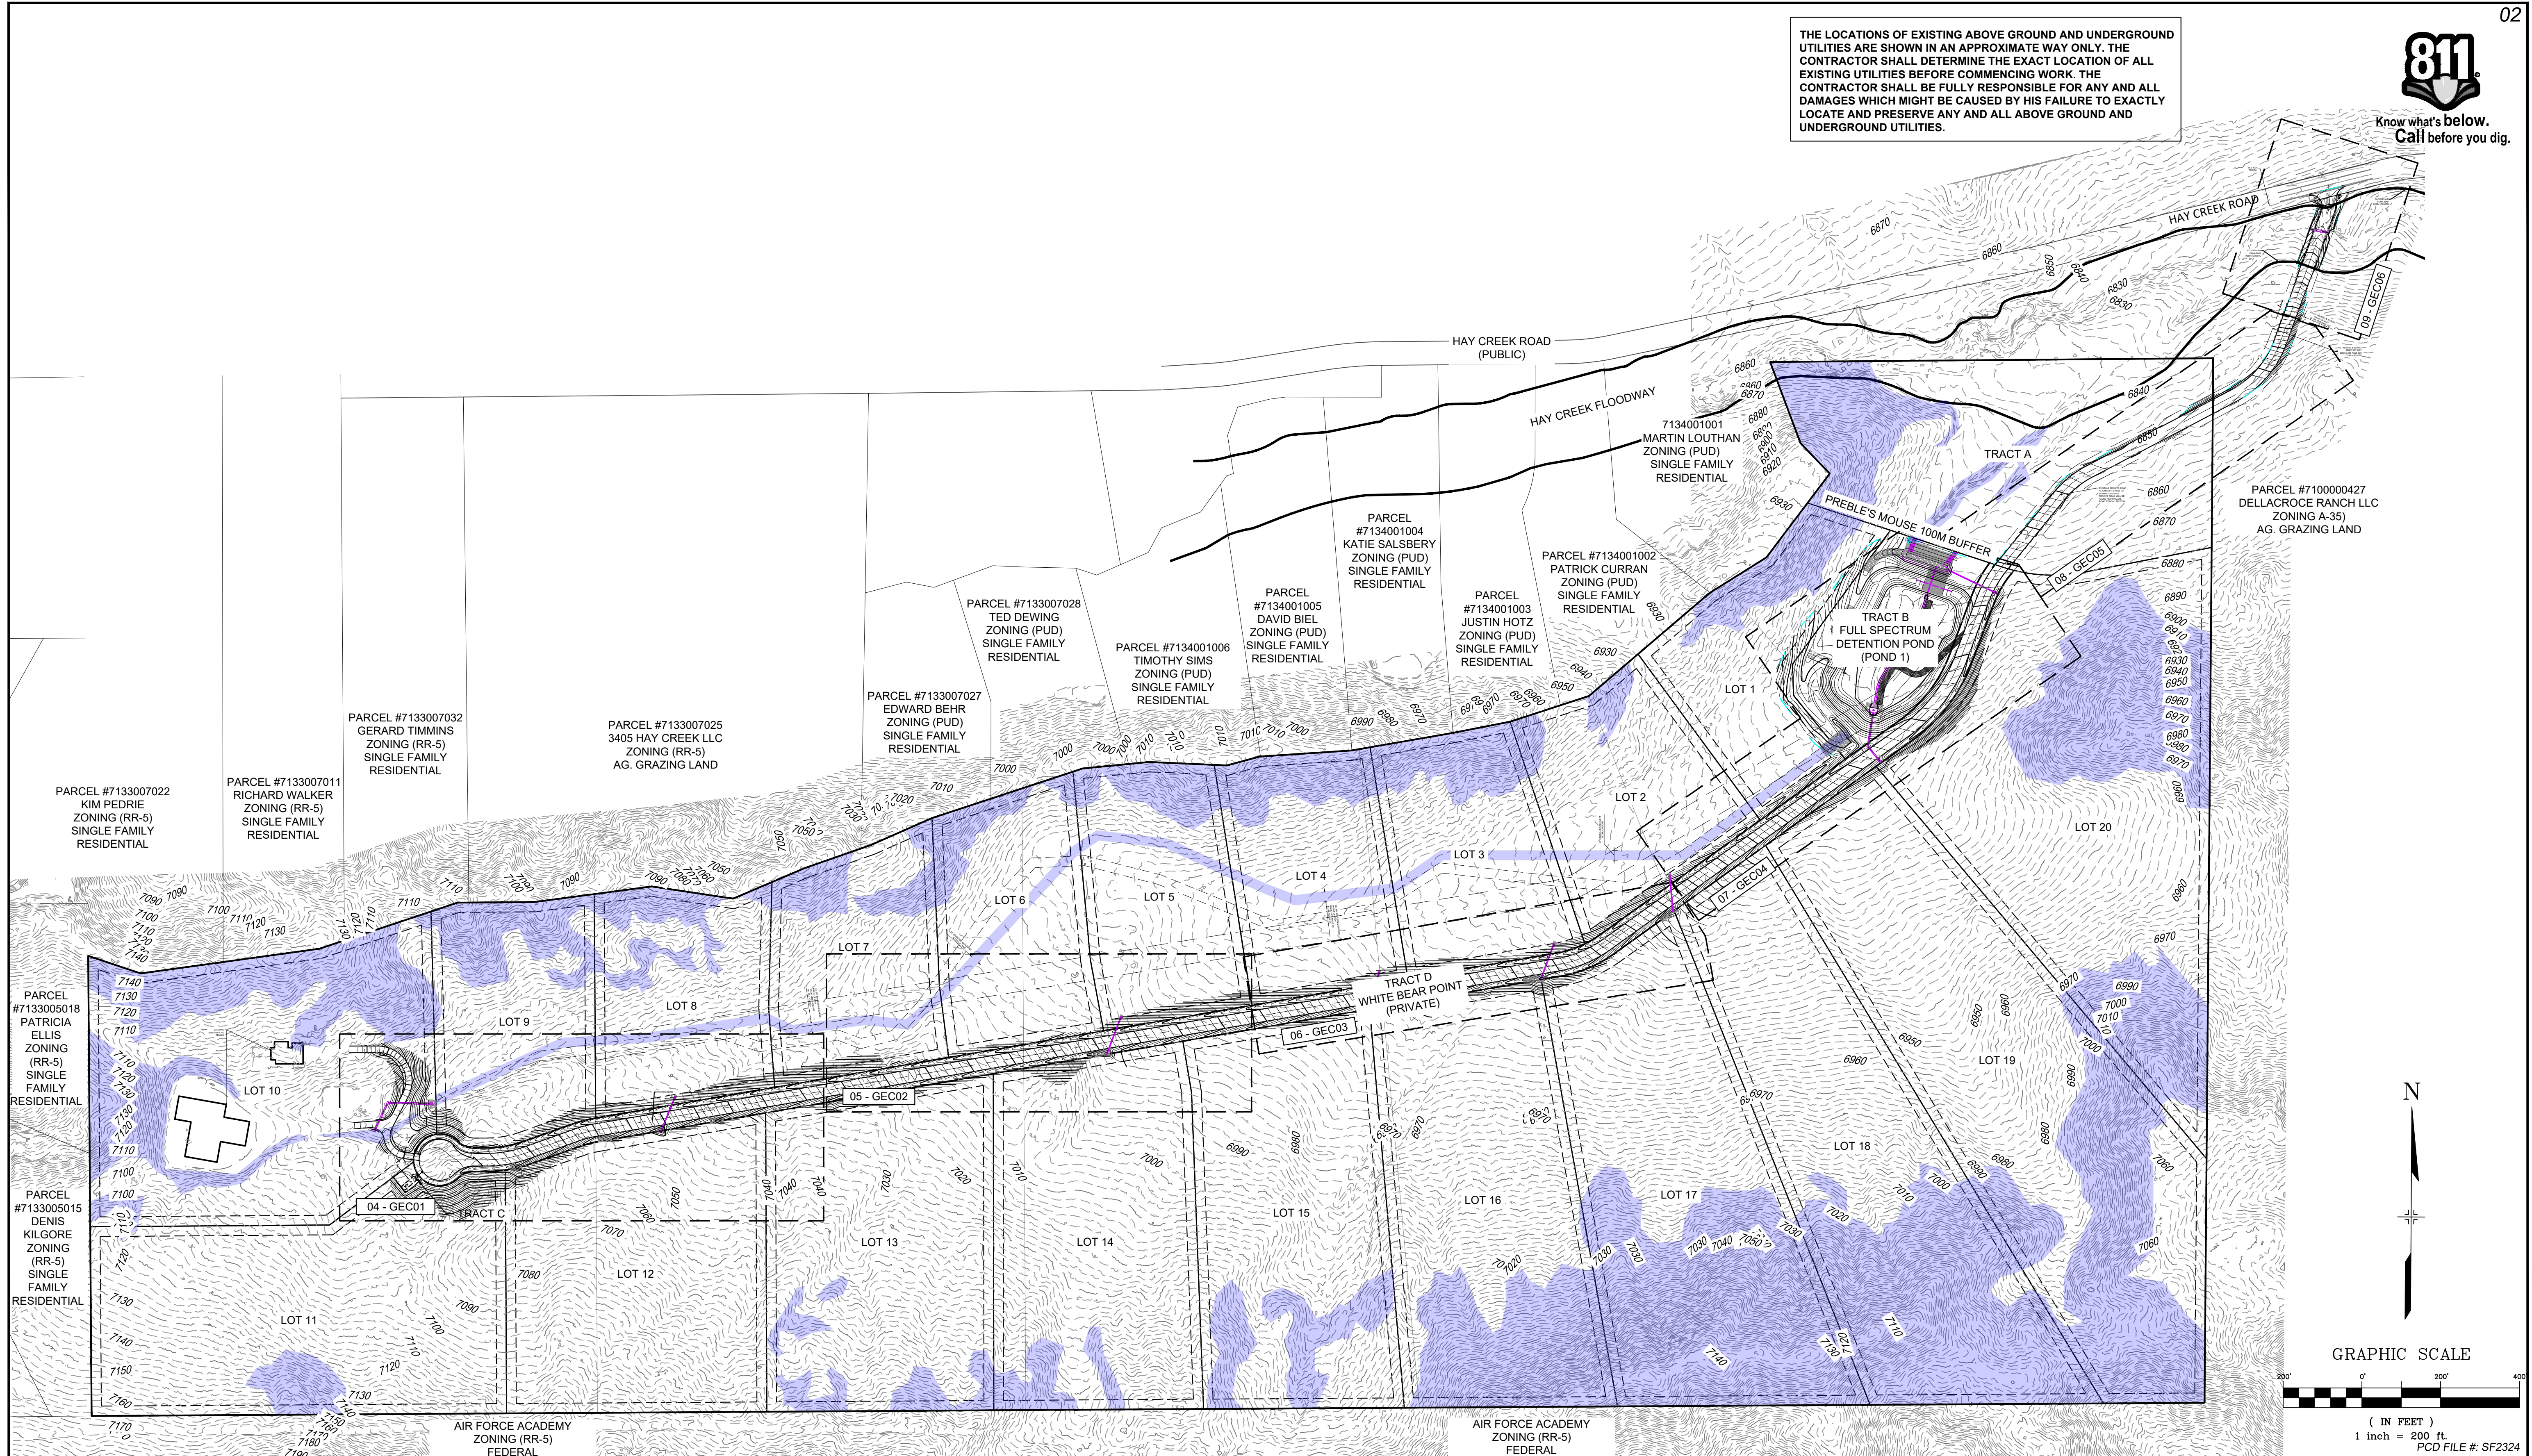


No.	DATE	DESCRIPTION	BY
COMPUTER FILE MANAGEMENT			
FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\TS01.dwg			
CTB FILE: Matrix.ctb			
PLOT DATE: 5/29/2024 9:35 AM			
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.			

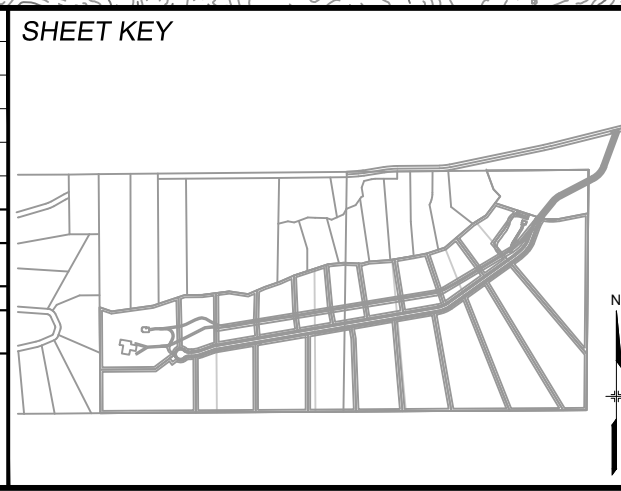

**BENCHMARK**  
PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PLS25955 C1/4 S22 T16S, R65W 1999, "AND THE WESTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T15S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

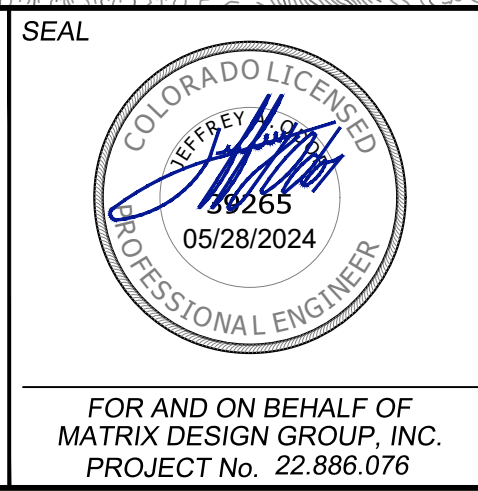

**HAY CREEK VALLEY**  
EL PASO COUNTY, COLORADO  
FINAL GRADING & EROSION CONTROL PLANS

**KEY MAP**

DESIGNED BY: CVW	SCALE: 1"=200'	DATE ISSUED: MAY 2024	DRAWING No. GN01
DRAWN BY: CVW	HORIZ. N/A	SHEET 02 OF 12	
CHECKED BY: JAO	VERT. N/A		

FOR AND ON BEHALF OF MATRIX DESIGN GROUP, INC. PROJECT No. 22.886.076



Know what's below. Call before you dig.

GENERAL CONSTRUCTION NOTES:

- STORMWATER DISCHARGES FROM CONSTRUCTION SITES SHALL NOT CAUSE OR THREATEN TO CAUSE POLLUTION, CONTAMINATION, OR DEGRADATION OF STATE WATERS. ALL WORK AND EARTH DISTURBANCE SHALL BE DONE IN A MANNER THAT MINIMIZES POLLUTION OF ANY ON-SITE OR OFF-SITE WATERS, INCLUDING WETLANDS.
- NOTWITHSTANDING ANYTHING DEPICTED IN THESE PLANS IN WORDS OR GRAPHIC REPRESENTATION, ALL DESIGN AND CONSTRUCTION RELATED TO ROADS, STORM DRAINAGE AND EROSION CONTROL SHALL CONFORM TO THE STANDARDS AND REQUIREMENTS OF THE MOST RECENT VERSION OF THE RELEVANT ADOPTED EL PASO COUNTY STANDARDS, INCLUDING THE LAND DEVELOPMENT CODE, THE ENGINEERING CRITERIA MANUAL, THE DRAINAGE CRITERIA MANUAL, AND THE DRAINAGE CRITERIA MANUAL VOLUME 2. ANY DEVIATIONS FROM REGULATIONS AND STANDARDS MUST BE REQUESTED, AND APPROVED, IN WRITING.
- A SEPARATE STORMWATER MANAGEMENT PLAN (SMWP) FOR THIS PROJECT SHALL BE COMPLETED AND AN EROSION AND STORMWATER QUALITY CONTROL PERMIT (ESQCP) ISSUED PRIOR TO COMMENCING CONSTRUCTION. MANAGEMENT OF THE SWMP DURING CONSTRUCTION IS THE RESPONSIBILITY OF THE DESIGNATED QUALIFIED STORMWATER MANAGER OR CERTIFIED EROSION CONTROL INSPECTOR. THE SWMP SHALL BE LOCATED ON SITE AT ALL TIMES DURING CONSTRUCTION AND SHALL BE KEPT UP TO DATE WITH WORK PROGRESS AND CHANGES IN THE FIELD.
- ONCE THE ESQCP IS APPROVED AND A "NOTICE TO PROCEED" HAS BEEN ISSUED, THE CONTRACTOR MAY INSTALL THE INITIAL STAGE EROSION AND SEDIMENT CONTROL MEASURES AS INDICATED ON THE APPROVED GEC. A PRECONSTRUCTION MEETING BETWEEN THE CONTRACTOR, ENGINEER, AND EL PASO COUNTY WILL BE HELD PRIOR TO ANY CONSTRUCTION. IT IS THE RESPONSIBILITY OF THE APPLICANT TO COORDINATE THE MEETING TIME AND PLACE WITH COUNTY STAFF.
- CONTROL MEASURES MUST BE INSTALLED PRIOR TO COMMENCEMENT OF ACTIVITIES THAT COULD CONTRIBUTE POLLUTANTS TO STORMWATER. CONTROL MEASURES FOR ALL SLOPES, CHANNELS, DITCHES, AND DISTURBED LAND AREAS SHALL BE INSTALLED IMMEDIATELY UPON COMPLETION OF THE DISTURBANCE.
- ALL TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES SHALL BE MAINTAINED AND REMAIN IN EFFECTIVE OPERATING CONDITION UNTIL PERMANENT SOIL EROSION CONTROL MEASURES ARE IMPLEMENTED AND FINAL STABILIZATION IS ESTABLISHED. ALL PERSONS ENGAGED IN LAND DISTURBANCE ACTIVITIES SHALL ASSESS THE ADEQUACY OF CONTROL MEASURES AT THE SITE AND IDENTIFY IF CHANGES TO THOSE CONTROL MEASURES ARE NEEDED TO ENSURE THE CONTINUED EFFECTIVE PERFORMANCE OF THE CONTROL MEASURES. ALL CHANGES TO TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES MUST BE INCORPORATED INTO THE STORMWATER MANAGEMENT PLAN.
- TEMPORARY STABILIZATION SHALL BE IMPLEMENTED ON DISTURBED AREAS AND STOCKPILES WHERE GROUND DISTURBING CONSTRUCTION ACTIVITY HAS PERMANENTLY CEASED OR TEMPORARILY CEASED FOR LONGER THAN 14 DAYS.
- FINAL STABILIZATION MUST BE IMPLEMENTED AT ALL APPLICABLE CONSTRUCTION SITES. FINAL STABILIZATION IS ACHIEVED WHEN ALL GROUND DISTURBING ACTIVITIES ARE COMPLETE AND ALL DISTURBED AREAS EITHER HAVE A UNIFORM VEGETATIVE COVER WITH INDIVIDUAL PLANT DENSITY OF 70 PERCENT OF PRE-DISTURBANCE LEVELS ESTABLISHED OR EQUIVALENT PERMANENT ALTERNATIVE STABILIZATION METHOD IS IMPLEMENTED. ALL TEMPORARY SEDIMENT AND EROSION CONTROL MEASURES SHALL BE REMOVED UPON FINAL STABILIZATION AND BEFORE PERMIT CLOSURE.
- ALL PERMANENT STORMWATER MANAGEMENT FACILITIES SHALL BE INSTALLED AS DESIGNED IN THE APPROVED PLANS. ANY PROPOSED CHANGES THAT EFFECT THE DESIGN OR FUNCTION OF PERMANENT STORMWATER MANAGEMENT STRUCTURES MUST BE APPROVED BY THE ECM ADMINISTRATOR PRIOR TO IMPLEMENTATION.
- EARTH DISTURBANCES SHALL BE CONDUCTED IN SUCH A MANNER SO AS TO EFFECTIVELY MINIMIZE ACCELERATED SOIL EROSION AND RESULTING SEDIMENTATION. ALL DISTURBANCES SHALL BE DESIGNED, CONSTRUCTED, AND COMPLETED SO THAT THE EXPOSED AREA OF ANY DISTURBED LAND SHALL BE LIMITED TO THE SHORTEST PRACTICAL PERIOD OF TIME. PRE-EXISTING VEGETATION SHALL BE PROTECTED AND MAINTAINED WITHIN 50 HORIZONTAL FEET OF A WATERS OF THE STATE UNLESS SHOWN TO BE INFEASIBLE AND SPECIFICALLY REQUESTED AND APPROVED.
- COMPACTION OF SOIL MUST BE PREVENTED IN AREAS DESIGNATED FOR INFILTRATION CONTROL MEASURES OR WHERE FINAL STABILIZATION WILL BE ACHIEVED BY VEGETATIVE COVER. AREAS

- DESIGNATED FOR INFILTRATION CONTROL MEASURES SHALL ALSO BE PROTECTED FROM SEDIMENTATION DURING CONSTRUCTION UNTIL FINAL STABILIZATION IS ACHIEVED. IF COMPACTION PREVENTION IS NOT FEASIBLE DUE TO SITE CONSTRAINTS, ALL AREAS DESIGNATED FOR INFILTRATION AND VEGETATION CONTROL MEASURES MUST BE LOOSENED PRIOR TO INSTALLATION OF THE CONTROL MEASURE(S).
- ANY TEMPORARY OR PERMANENT FACILITY DESIGNED AND CONSTRUCTED FOR THE CONVEYANCE OF STORMWATER AROUND, THROUGH, OR FROM THE EARTH DISTURBANCE AREA SHALL BE A STABILIZED CONVEYANCE DESIGNED TO MINIMIZE EROSION AND THE DISCHARGE OF SEDIMENT OFF SITE.
- CONCRETE WASH WATER SHALL BE CONTAINED AND DISPOSED OF IN ACCORDANCE WITH THE SWMP. NO WASH WATER SHALL BE DISCHARGED TO OR ALLOWED TO ENTER STATE WATERS, INCLUDING ANY SURFACE OR SUBSURFACE STORM DRAINAGE SYSTEM OR FACILITIES. CONCRETE WASHOUTS SHALL NOT BE LOCATED IN AN AREA WHERE SHALLOW GROUNDWATER MAY BE PRESENT, OR WITHIN 50 FEET OF A SURFACE WATER BODY, CREEK OR STREAM.
- DURING DEWATERING OPERATIONS OF UNCONTAMINATED GROUND WATER MAY BE DISCHARGED ON SITE, BUT SHALL NOT LEAVE THE SITE IN THE FORM OF SURFACE RUNOFF UNLESS AN APPROVED STATE DEWATERING PERMIT IS IN PLACE.
- EROSION CONTROL BLANKETING OR OTHER PROTECTIVE COVERING SHALL BE USED ON SLOPES STEEPER THAN 3:1.
- CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL WASTES FROM THE CONSTRUCTION SITE FOR DISPOSAL IN ACCORDANCE WITH LOCAL AND STATE REGULATORY REQUIREMENTS. NO CONSTRUCTION DEBRIS, TREE SLASH, BUILDING MATERIAL WASTES OR UNUSED BUILDING MATERIALS SHALL BE BURIED, DUMPED, OR DISCHARGED AT THE SITE.
- WASTE MATERIALS SHALL NOT BE TEMPORARILY PLACED OR STORED IN THE STREET, ALLEY, OR OTHER PUBLIC WAY, UNLESS IN ACCORDANCE WITH AN APPROVED TRAFFIC CONTROL PLAN. CONTROL MEASURES MAY BE REQUIRED BY EL PASO COUNTY ENGINEERING IF DEEMED NECESSARY, BASED ON SPECIFIC CONDITIONS AND CIRCUMSTANCES.
- TRACKING OF SOILS AND CONSTRUCTION DEBRIS OFF-SITE SHALL BE MINIMIZED. MATERIALS TRACKED OFF-SITE SHALL BE CLEANED UP AND PROPERLY DISPOSED OF IMMEDIATELY.
- THE OWNER/DEVELOPER SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL CONSTRUCTION DEBRIS, DIRT, TRASH, ROCK, SEDIMENT, SOIL, AND SAND THAT MAY ACCUMULATE IN ROADS, STORM DRAINS AND OTHER DRAINAGE CONVEYANCE SYSTEMS AND STORMWATER APPURTENANCES AS A RESULT OF SITE DEVELOPMENT.
- THE QUANTITY OF MATERIALS STORED ON THE PROJECT SITE SHALL BE LIMITED, AS MUCH AS PRACTICAL, TO THAT QUANTITY REQUIRED TO PERFORM THE WORK IN AN ORDERLY SEQUENCE. ALL MATERIALS STORED ON-SITE SHALL BE STORED IN A NEAT, ORDERLY MANNER, IN THEIR ORIGINAL CONTAINERS, WITH ORIGINAL MANUFACTURER'S LABELS.
- NO CHEMICAL(S) HAVING THE POTENTIAL TO BE RELEASED IN STORMWATER ARE TO BE STORED OR USED ONSITE UNLESS PERMISSION FOR THE USE OF SUCH CHEMICAL(S) IS GRANTED IN WRITING BY THE ECM ADMINISTRATOR. IN GRANTING APPROVAL FOR THE USE OF SUCH CHEMICAL(S), SPECIAL CONDITIONS AND MONITORING MAY BE REQUIRED.
- BULK STORAGE OF ALLOWED PETROLEUM PRODUCTS OR OTHER ALLOWED LIQUID CHEMICALS IN EXCESS OF 55 GALLONS SHALL REQUIRE ADEQUATE SECONDARY CONTAINMENT PROTECTION TO CONTAIN ALL SPILLS ONSITE AND TO PREVENT ANY SPILLED MATERIALS FROM ENTERING STATE WATERS, ANY SURFACE OR SUBSURFACE STORM DRAINAGE SYSTEM OR OTHER FACILITIES.
- NO PERSON SHALL CAUSE THE IMPEDIMENT OF STORMWATER FLOW IN THE CURB AND GUTTER OR DITCH EXCEPT WITH APPROVED SEDIMENT CONTROL MEASURES.
- OWNER/DEVELOPER AND THEIR AGENTS SHALL COMPLY WITH THE "COLORADO WATER QUALITY CONTROL ACT" (TITLE 25, ARTICLE 8, CRS), AND THE "CLEAN WATER ACT" (33 USC 1344), IN ADDITION TO THE REQUIREMENTS OF THE LAND DEVELOPMENT CODE, DCM VOLUME II AND THE ECM APPENDIX I. ALL APPROPRIATE PERMITS MUST BE OBTAINED BY THE CONTRACTOR PRIOR TO CONSTRUCTION (1041, NPDES, FLOODPLAIN, 404, FUGITIVE DUST, ETC.). IN THE EVENT OF CONFLICTS BETWEEN THESE REQUIREMENTS AND OTHER LAWS, RULES, OR REGULATIONS OF OTHER FEDERAL, STATE, LOCAL, OR COUNTY AGENCIES, THE MOST RESTRICTIVE LAWS, RULES, OR REGULATIONS SHALL APPLY.

- ALL CONSTRUCTION TRAFFIC MUST ENTER/EXIT THE SITE ONLY AT APPROVED CONSTRUCTION ACCESS POINTS.
- PRIOR TO CONSTRUCTION THE PERMITTEE SHALL VERIFY THE LOCATION OF EXISTING UTILITIES.
- A WATER SOURCE SHALL BE AVAILABLE ON SITE DURING EARTHWORK OPERATIONS AND SHALL BE UTILIZED AS REQUIRED TO MINIMIZE DUST FROM EARTHWORK EQUIPMENT AND WIND.

THE SOILS REPORT FOR THIS SITE HAS BEEN PREPARED BY CTL THOMPSON, DATED SEPTEMBER 19, 2023, AND SHALL BE CONSIDERED A PART OF THESE PLANS.

AT LEAST TEN (10) DAYS PRIOR TO THE ANTICIPATED START OF CONSTRUCTION, FOR PROJECTS THAT WILL DISTURB ONE (1) ACRE OR MORE, THE OWNER OR OPERATOR OF CONSTRUCTION ACTIVITY SHALL SUBMIT A PERMIT APPLICATION FOR STORMWATER DISCHARGE TO THE COLORADO DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT, WATER QUALITY DIVISION. THE APPLICATION CONTAINS CERTIFICATION OF COMPLETION OF A STORMWATER MANAGEMENT PLAN (SWMP), OF WHICH THIS GRADING AND EROSION CONTROL PLAN MAY BE A PART. FOR INFORMATION OR APPLICATION MATERIALS CONTACT:

COLORADO DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT  
WATER QUALITY CONTROL DIVISION  
WQCD - PERMITS  
4300 CHERRY CREEK DRIVE SOUTH  
DENVER, CO 80246-1530  
ATTN: PERMITS UNIT

NRCS SOIL SURVEY FOR EL PASO COUNTY

SOIL ID NO.	SOIL TYPE	HYDROLOGIC CLASSIFICATION
38	JARRE-TECOLOTE COMPLEX (8%-65% SLOPES)	B
71	PRING COARSE SANDY LOAM (3%-8% SLOPES)	B
93	TOMAH-CROWFOOT COMPLEX (8%-15% SLOPES)	B

**TIMING**  
ANTICIPATED STARTING AND COMPLETION TIME PERIOD OF SITE GRADING:  
WINTER 2024 THRU FALL 2024  
  
EXPECTED DATE ON WHICH THE FINAL STABILIZATION WILL BE COMPLETED:  
FALL 2024

**AREAS**  
TOTAL DISTURBED AREA: 17.28 ACRES


**RECEIVING WATERS**  
NAME OF RECEIVING WATERS  
HAY CREEK (ULTIMATE)

**ENGINEER'S NOTES:**  
THE EXISTING VEGETATION CONSISTS OF MODERATELY DENSE NATIVE GRASSES AND SHRUBS. BASED ON SITE VISITS AND A REVIEW OF AERIAL PHOTOGRAPHY, THE VEGETATIVE COVER AT HAY CREEK VALLEY IS APPROXIMATELY 80%.

**ABBREVIATIONS**


BOW	BOTTOM OF WALL	PL	PROPERTY LINE
EL	ELEVATION	PSI	POUNDS PER SQUARE INCH
EX	EXISTING	RCP	REINFORCED CONCRETE PIPE
HORIZ	HORIZONTAL	SHLDR	SHOULDER
INV	INVERT	TOW	TOP OF WALL
MIN	MINIMUM	TYP	TYPICAL
N,S,E,W	NORTH,SOUTH,EAST,WEST		

TYPICAL ROADWAY CROSS SECTIONS

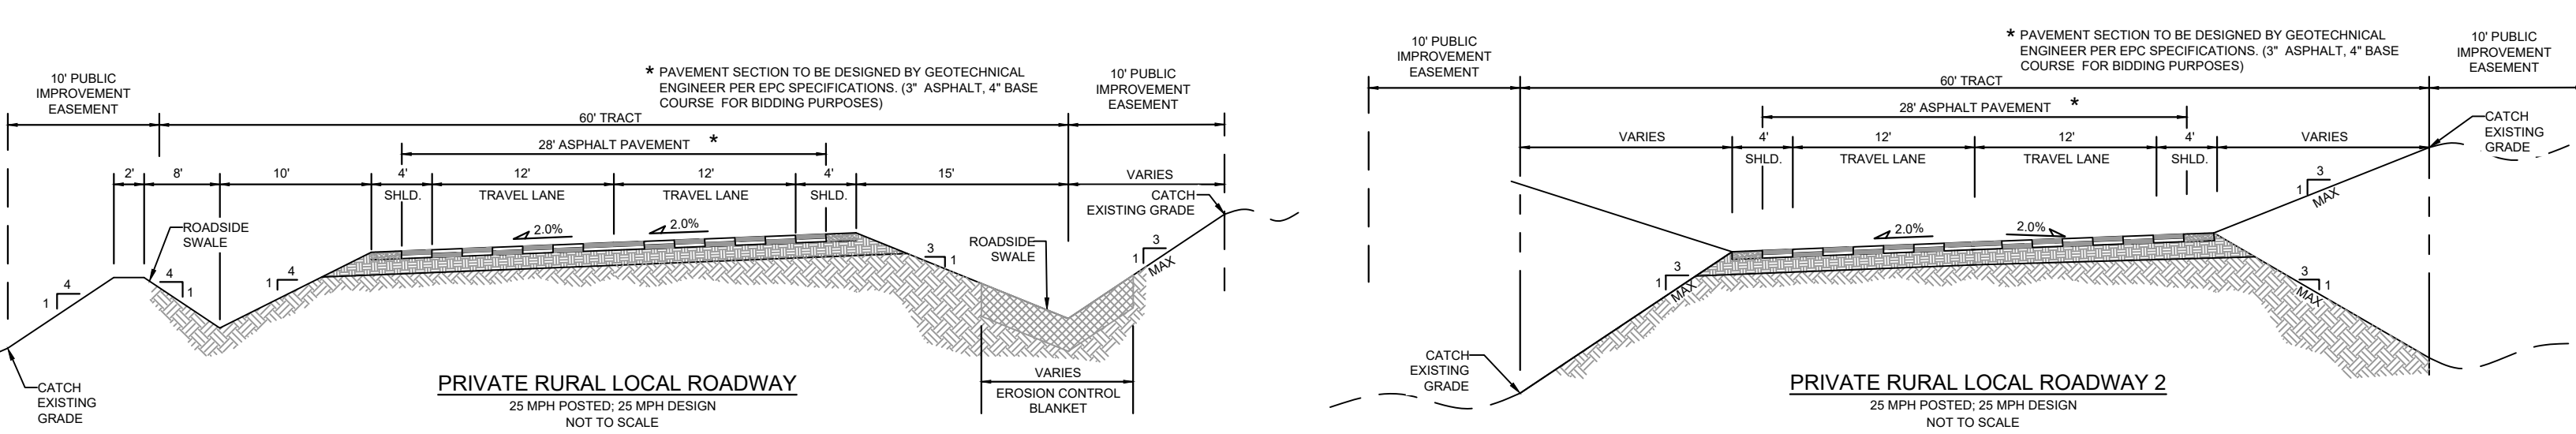

PCD FILE #: SF2324

No.	DATE	DESCRIPTION	BY
REVISIONS			
COMPUTER FILE MANAGEMENT			
FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\TS01.dwg			
CTB FILE: Matrix.ctb			
PLOT DATE: 5/29/2024 9:35 AM			
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.			

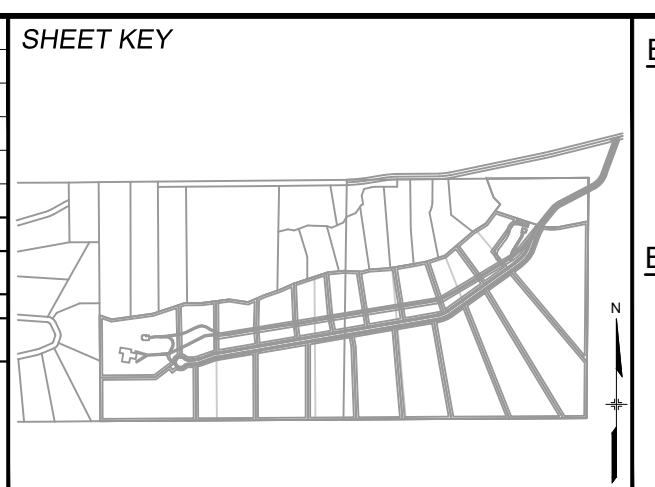

**BENCHMARK**  
PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PL252955 C1/4 S22 T16S, R65W 1999, "AND THE WESTERLY END BY A2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T16S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:

Excellence by Design

SEAL

**HAY CREEK VALLEY**

EL PASO COUNTY, COLORADO  
FINAL GRADING & EROSION CONTROL PLANS


**GENERAL NOTES**

DESIGNED BY:	CVW	SCALE:	HORIZ N/A	DATE ISSUED:	MAY 2024	DRAWING No.	GN02
DRAWN BY:	CVW	CHECKED BY:	JAO	SHEET:	03 OF 12		



Know what's below. Call before you dig.

THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

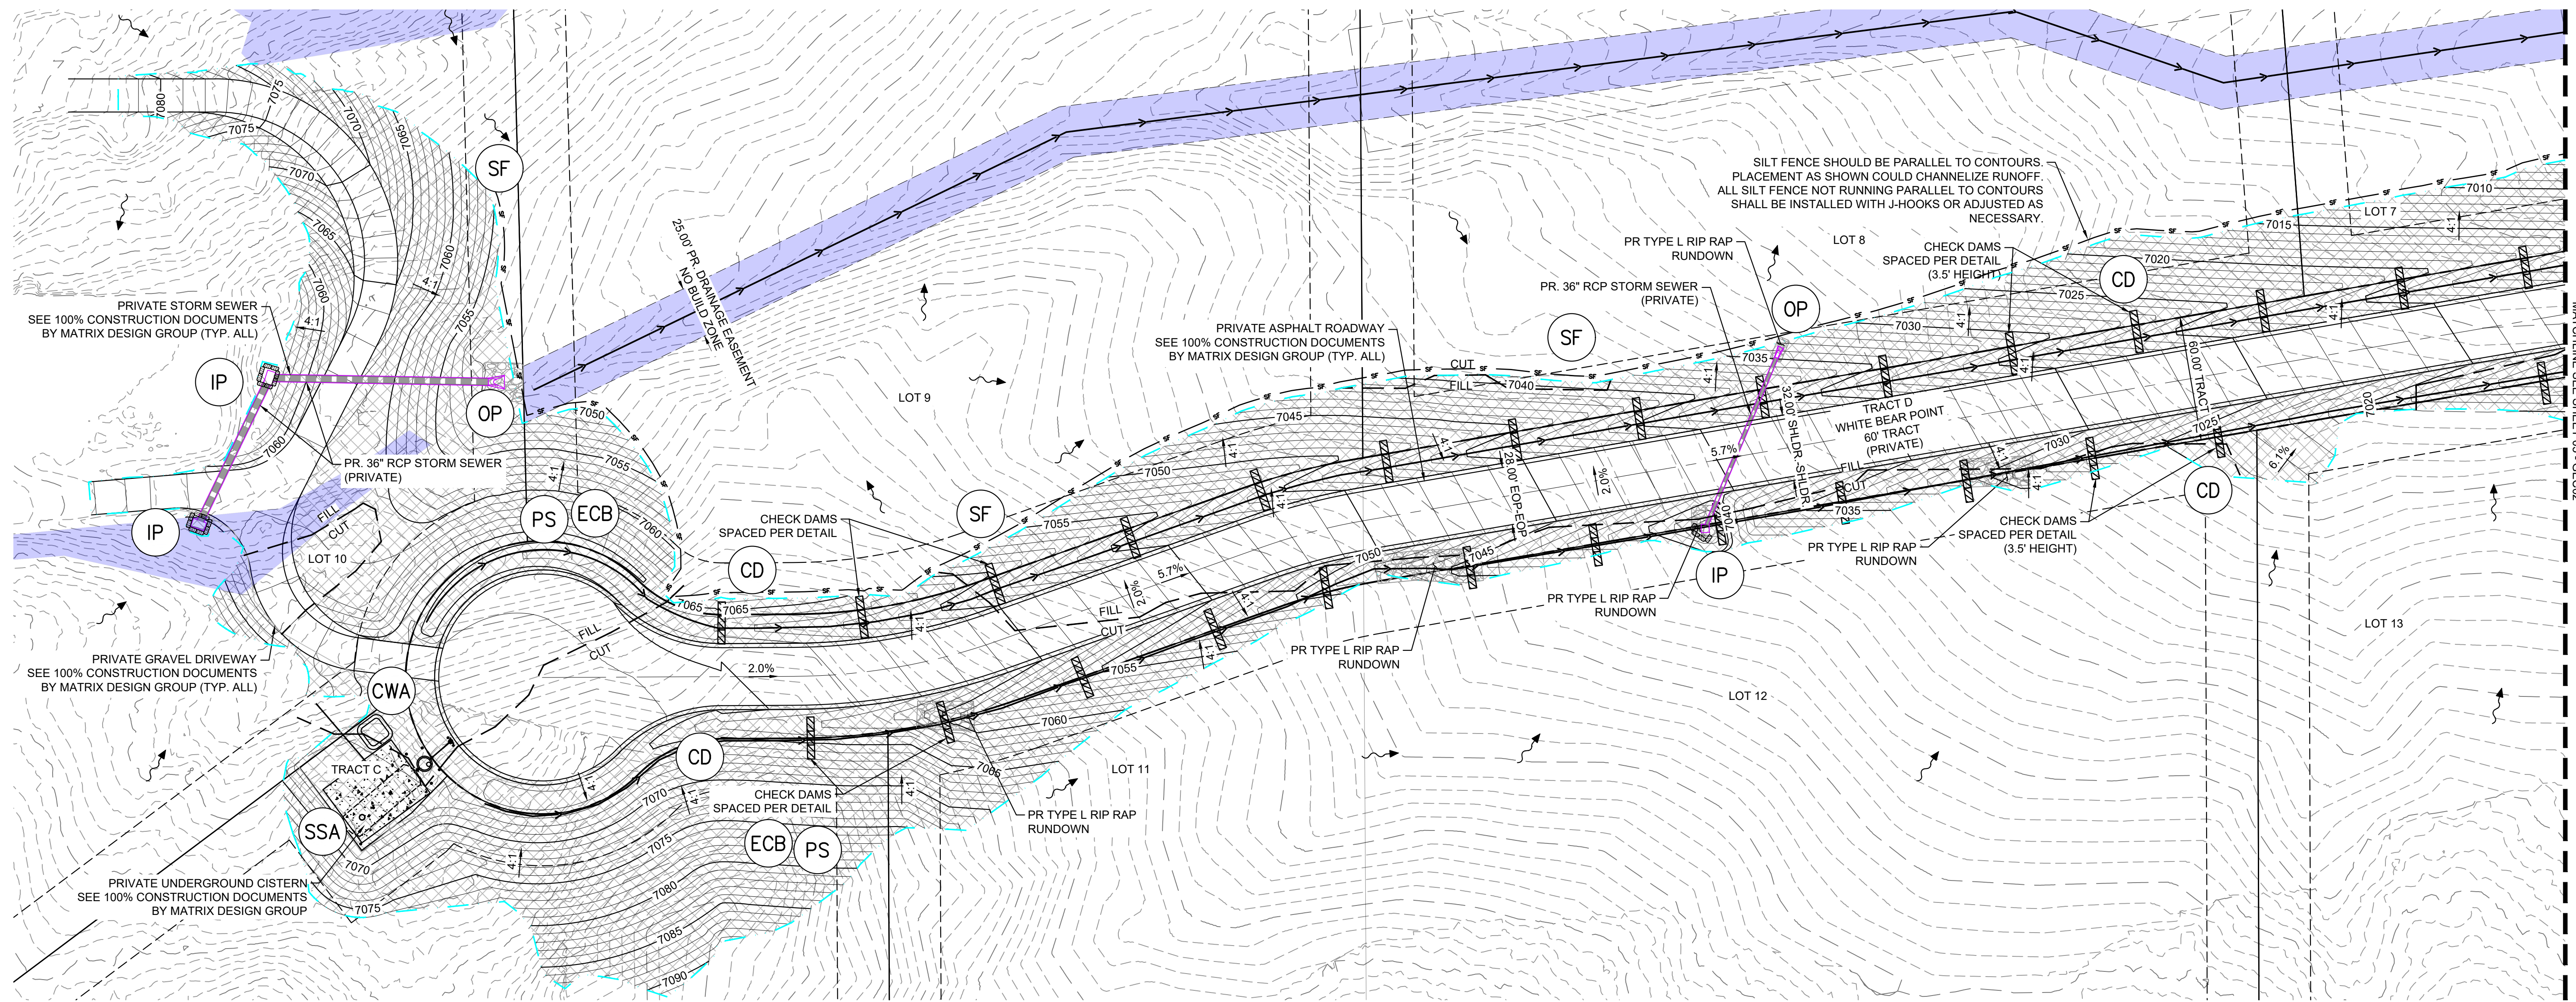


EROSION CONTROL LEGEND

Table with 2 columns: BMP SEQUENCING (INITIAL, INTERIM, FINAL) and descriptions of measures like silting fences, check dams, and permanent seeding.

Legend symbols for various erosion control features: PS (Permanent Seeding), SF (Silt Fence), ECB (Erosion Control Blanket), OP (Outlet Protection), IP (Inlet Protection), VTC (Vehicle Tracking Control), CD (Check Dam), MU (Mulching), TSB (Temporary Sediment Basin), CWA (Concrete Washout), SSA (Stockpile Management), HP (High Point), LP (Low Point), and various line styles for contours and boundaries.


NOTES: 1. SEE CHECK DAM (CD) DETAIL EC-12 ON SHEET ECN01 FOR SPACING. 2. ALL EROSION CONTROL BLANKET SHALL BE INSPECTED 24-MONTHS AFTER INSTALLATION. EROSION CONTROL BLANKET MAY BE REQUIRED TO BE RE-INSTALLED PER MANUFACTURER SPECIFICATIONS.

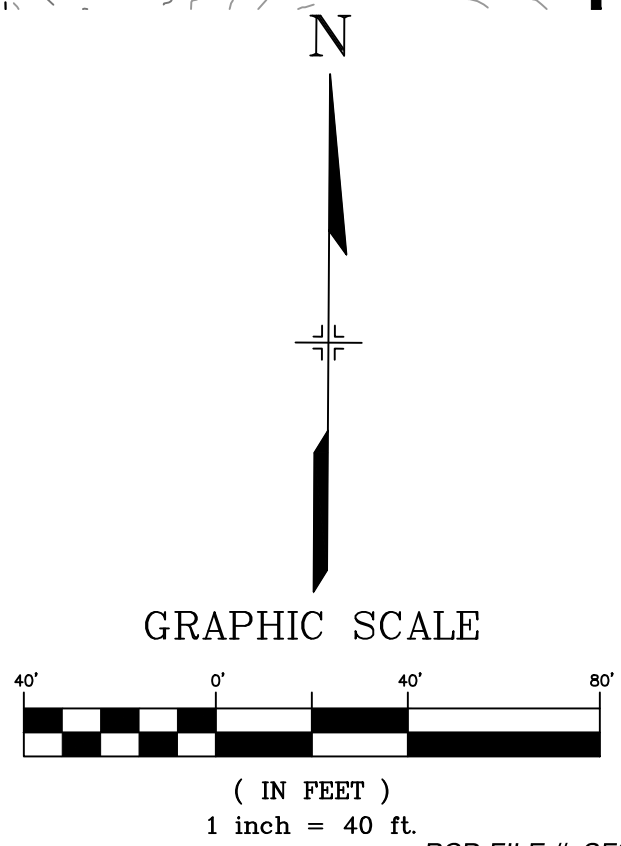

Project information block including: REFERENCE DRAWINGS, SHEET KEY, BENCHMARK (PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS...), BASIS OF BEARING (THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22...), SEAL (Jeffrey A. Jones, Professional Engineer), HAY CREEK VALLEY EL PASO COUNTY, COLORADO FINAL GRADING & EROSION CONTROL PLANS, GRADING & EROSION CONTROL PLAN, and a table for REVISIONS.



THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

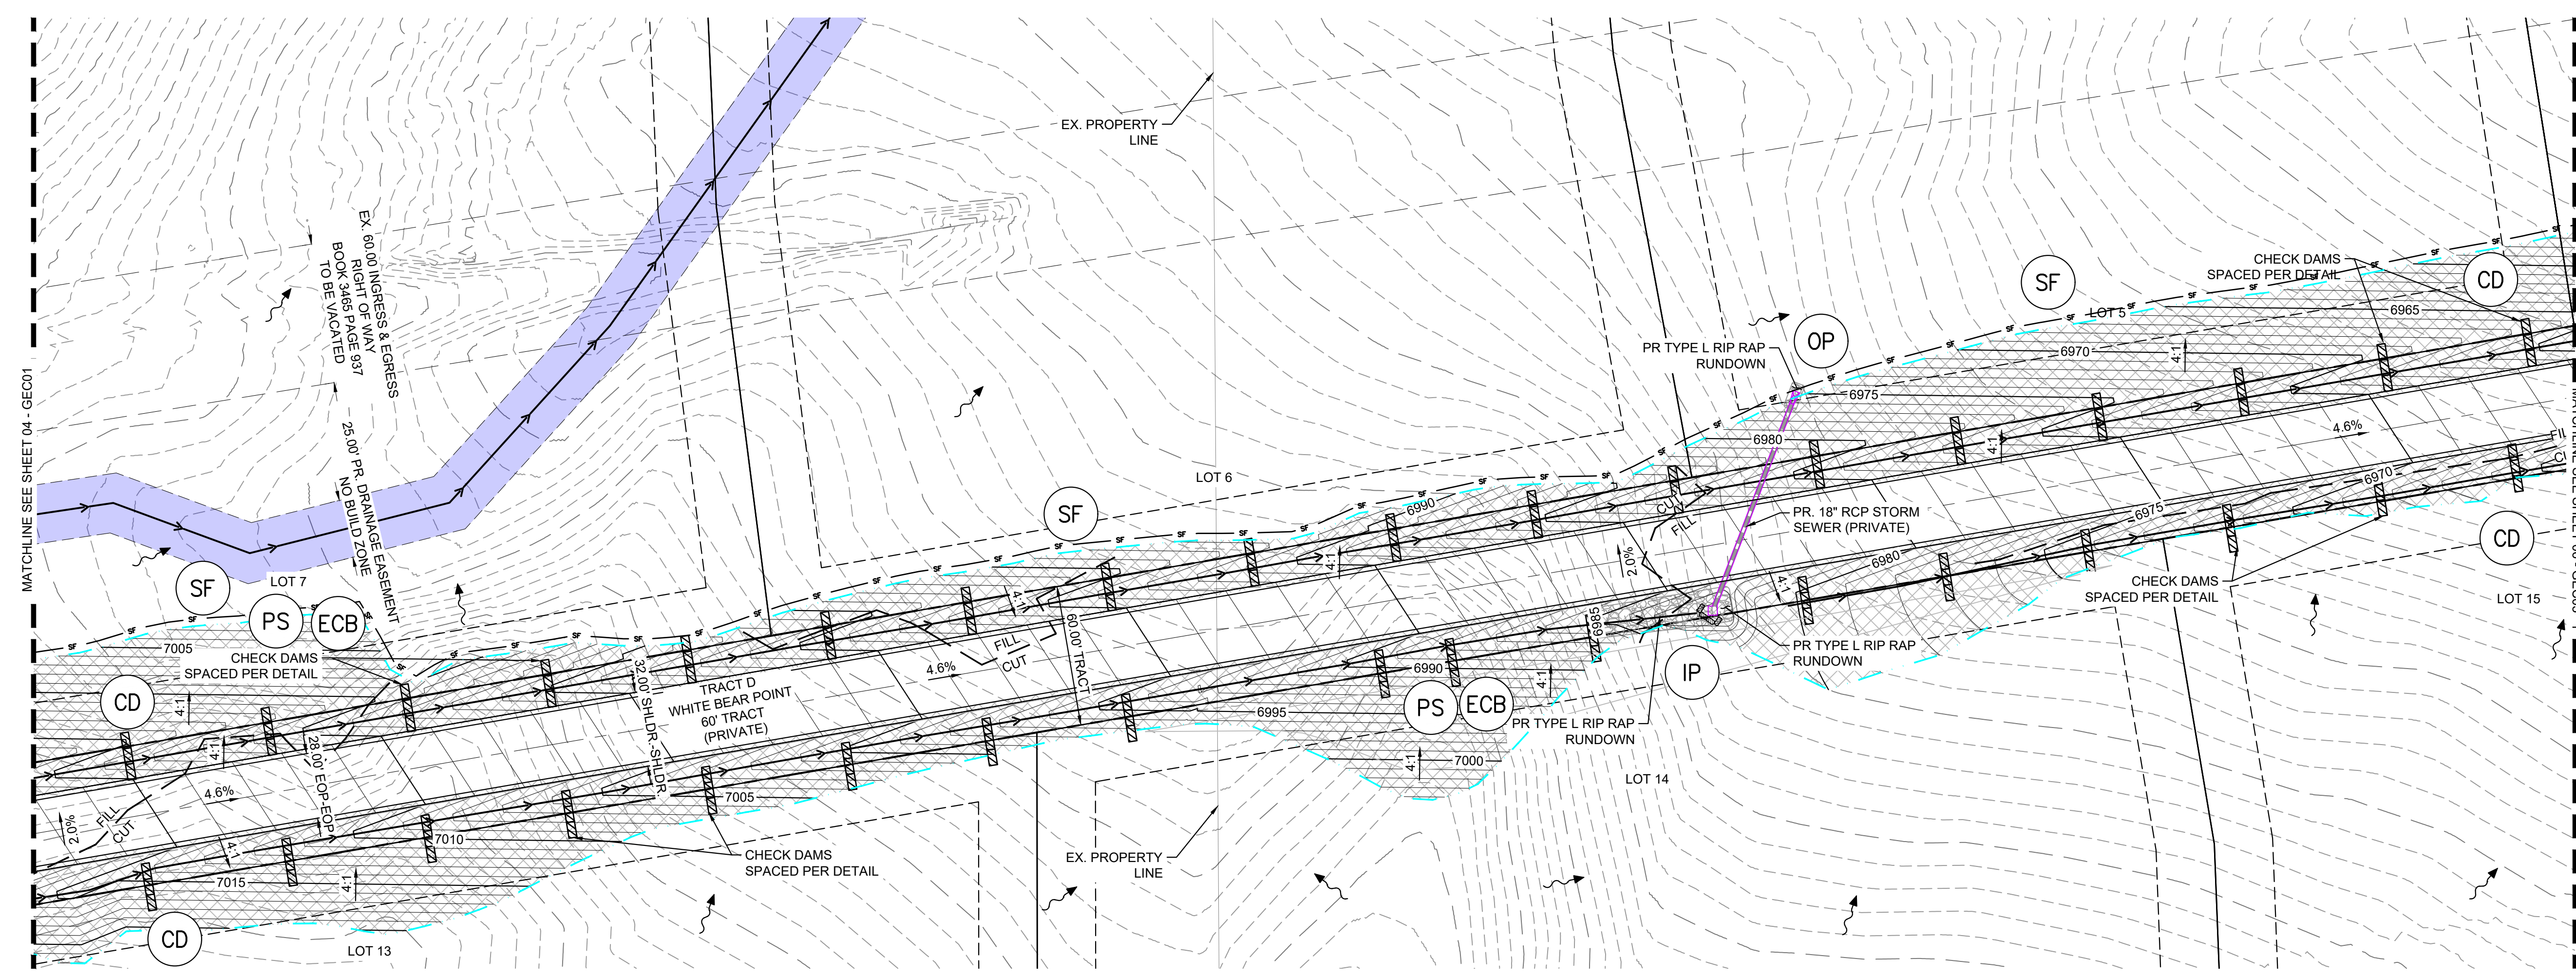

BMP SEQUENCING	
INITIAL	SILT FENCE, VEHICLE TRACKING, TEMP SEDIMENT BASINS
INTERIM	CHECK DAMS, CONCRETE WASHOUT, INLET/OUTLET PROTECTION, STOCKPILES, STAGING, ROUGH CUT STREET CONTROL
FINAL	EROSION CONTROL BLANKETS, SEEDING & MULCHING, PERMANENT CONTROL MEASURE(S)

**NOTES:**  
 1. SEE CHECK DAM (CD) DETAIL EC-12 ON SHEET ECN01 FOR SPACING.  
 2. ALL EROSION CONTROL BLANKET SHALL BE INSPECTED 24-MONTHS AFTER INSTALLATION. EROSION CONTROL BLANKET MAY BE REQUIRED TO BE RE-INSTALLED PER MANUFACTURER SPECIFICATIONS.


### EROSION CONTROL LEGEND

(PS)	PERMANENT SEEDING	(MU)	MULCHING
(SF)	SILT FENCE	(TSB)	TEMPORARY SEDIMENT BASIN
(ECB)	EROSION CONTROL BLANKET	(CWA)	CONCRETE WASHOUT
(OP)	OUTLET PROTECTION	(SSA)	STOCKPILE MANAGEMENT / STABILIZED STAGING AREA
(IP)	INLET PROTECTION	(HP)	HIGH POINT / LOW POINT
(VTC)	VEHICLE TRACKING CONTROL	(LP)	LOW POINT
(RIP)	PROPOSED RIP RAP	(CWA)	CONCRETE WASHOUT
(CD)	CHECK DAM	(SSA)	STOCKPILE MANAGEMENT / STABILIZED STAGING AREA

GRAPHIC SCALE  
( IN FEET )  
1 inch = 40 ft.

NO.	DATE	DESCRIPTION	BY
REVISIONS			

**COMPUTER FILE MANAGEMENT**  
 FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\GEC01.dwg  
 CTB FILE: Matrix.ctb  
 PLOT DATE: 5/29/2024 9:35 AM  
 THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.

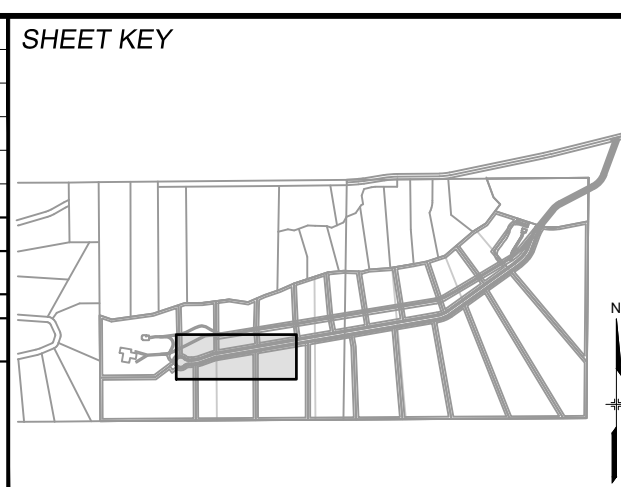

**BENCHMARK**  
 PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
 THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PLS25955 C1/4 S22 T16S, R65W 1999, "AND THE WESTERLY END BY A2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T15S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:

SEAL

**HAY CREEK VALLEY**  
 EL PASO COUNTY, COLORADO  
 FINAL GRADING & EROSION CONTROL PLANS

**GRADING & EROSION CONTROL PLAN**


DESIGNED BY: CVW	SCALE: 1" = 40'	DATE ISSUED: MAY 2024	DRAWING No. GEC02
DRAWN BY: CVW	HORIZ: N/A	SHEET 05 OF 12	
CHECKED BY: JAO	VERT: N/A		

FOR AND ON BEHALF OF MATRIX DESIGN GROUP, INC. PROJECT No. 22.886.076



Know what's below.  
Call before you dig.

THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.


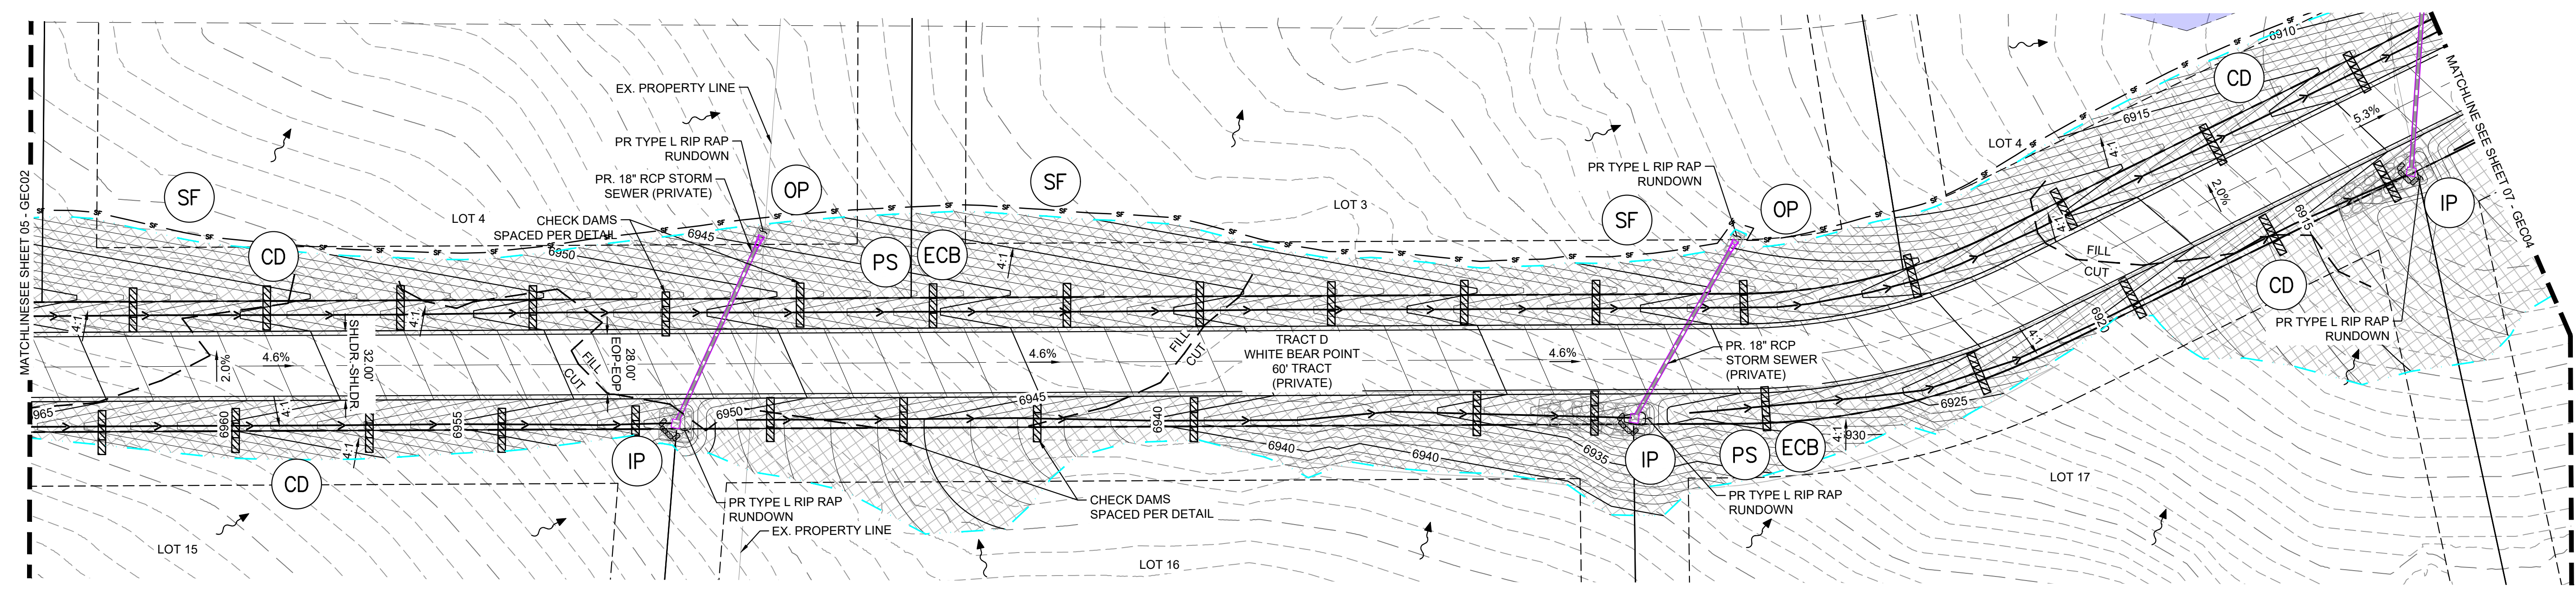


BMP SEQUENCING	
INITIAL	SILT FENCE, VEHICLE TRACKING, TEMP SEDIMENT BASINS
INTERIM	CHECK DAMS, CONCRETE WASHOUT, INLET/OUTLET PROTECTION, STOCKPILES, STAGING, ROUGH CUT STREET CONTROL
FINAL	EROSION CONTROL BLANKETS, SEEDING & MULCHING, PERMANENT CONTROL MEASURE(S)

**NOTES:**  
 1. SEE CHECK DAM (CD) DETAIL EC-12 ON SHEET ECN01 FOR SPACING.  
 2. ALL EROSION CONTROL BLANKET SHALL BE INSPECTED 24-MONTHS AFTER INSTALLATION. EROSION CONTROL BLANKET MAY BE REQUIRED TO BE RE-INSTALLED PER MANUFACTURER SPECIFICATIONS.


**EROSION CONTROL LEGEND**

SF	PERMANENT SEEDING (PS)	MU	MULCHING	5975	EXISTING CONTOURS
SF	SILT FENCE (SF)	TSB	TEMPORARY SEDIMENT BASIN	4:1	DRAINAGE SWALE
ECB	EROSION CONTROL BLANKET (ECB)	CWA	CONCRETE WASHOUT		SLOPE LABEL
OP	OUTLET PROTECTION (OP)	SSA	STOCKPILE MANAGEMENT / STABILIZED STAGING AREA		OVERLAND FLOW
IP	INLET PROTECTION (IP)	HP LP	HIGH POINT / LOW POINT		LIMITS OF DISTURBANCE/ CONSTRUCTION SITE BOUNDARY
VTC	VEHICLE TRACKING CONTROL (VTC)	7050	PROPOSED CONTOURS		PROJECT BOUNDARY LINE
CD	CHECK DAM (CD)		EXISTING FENCE		OVERFLOW ROUTE
			EXISTING STORM DRAIN		CUT/FILL LINE
			PROPOSED STORM DRAIN		100 YEAR FLOODPLAIN BOUNDARY
			NO BUILD ZONE (SLOPE GREATER THAN 29.99 %)		MATCHLINE
					PROPOSED LOT/TRACT LINE
					EASEMENT
					PROPOSED BUILDING SETBACK

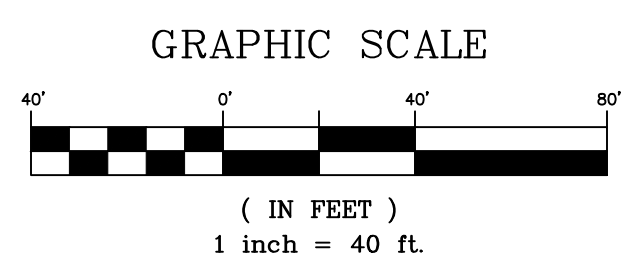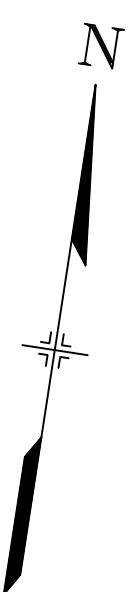

PCD FILE #: SF2324

REFERENCE DRAWINGS	No.	DATE	DESCRIPTION	BY
X-TITLE-CD X-886-PR-SITE FEMA_X3 X-886-066-EX-MAP-1 X-886-ALTA-SURVEY Hay Creek SFES 2023-02-28 TOPO 164022-01 164022-01 Hay Creek Road BENEY				
<b>COMPUTER FILE MANAGEMENT</b>				
FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\GEC01.dwg				
CTB FILE: Matrix.ctb				
PLOT DATE: 5/29/2024 9:35 AM				
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.				

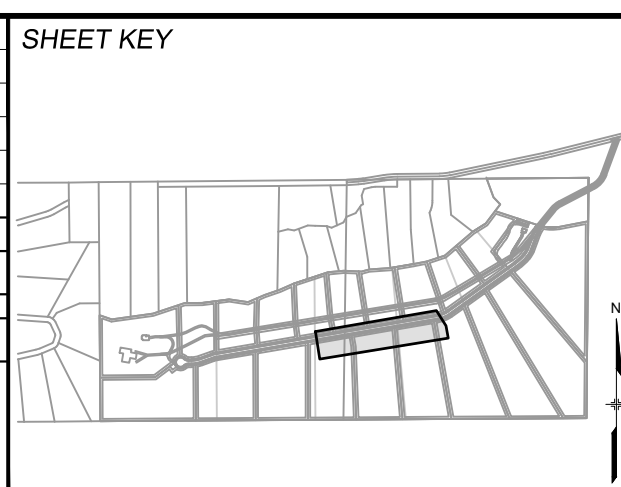

**BENCHMARK**  
 PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
 THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PLS25955 C1/4 S22 T16S, R65W 1999, "AND THE WESTERLY END BY A2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T15S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:

Excellence by Design

SEAL

FOR AND ON BEHALF OF  
 MATRIX DESIGN GROUP, INC.  
 PROJECT No. 22.886.076


**HAY CREEK VALLEY**  
 EL PASO COUNTY, COLORADO  
 FINAL GRADING & EROSION CONTROL PLANS

**GRADING & EROSION CONTROL PLAN**

DESIGNED BY: CVW	SCALE: 1" = 40'	DATE ISSUED: MAY 2024	DRAWING No. GEC03
DRAWN BY: CVW	HORIZ. N/A	SHEET 06 OF 12	
CHECKED BY: JAO	VERT. N/A		



THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

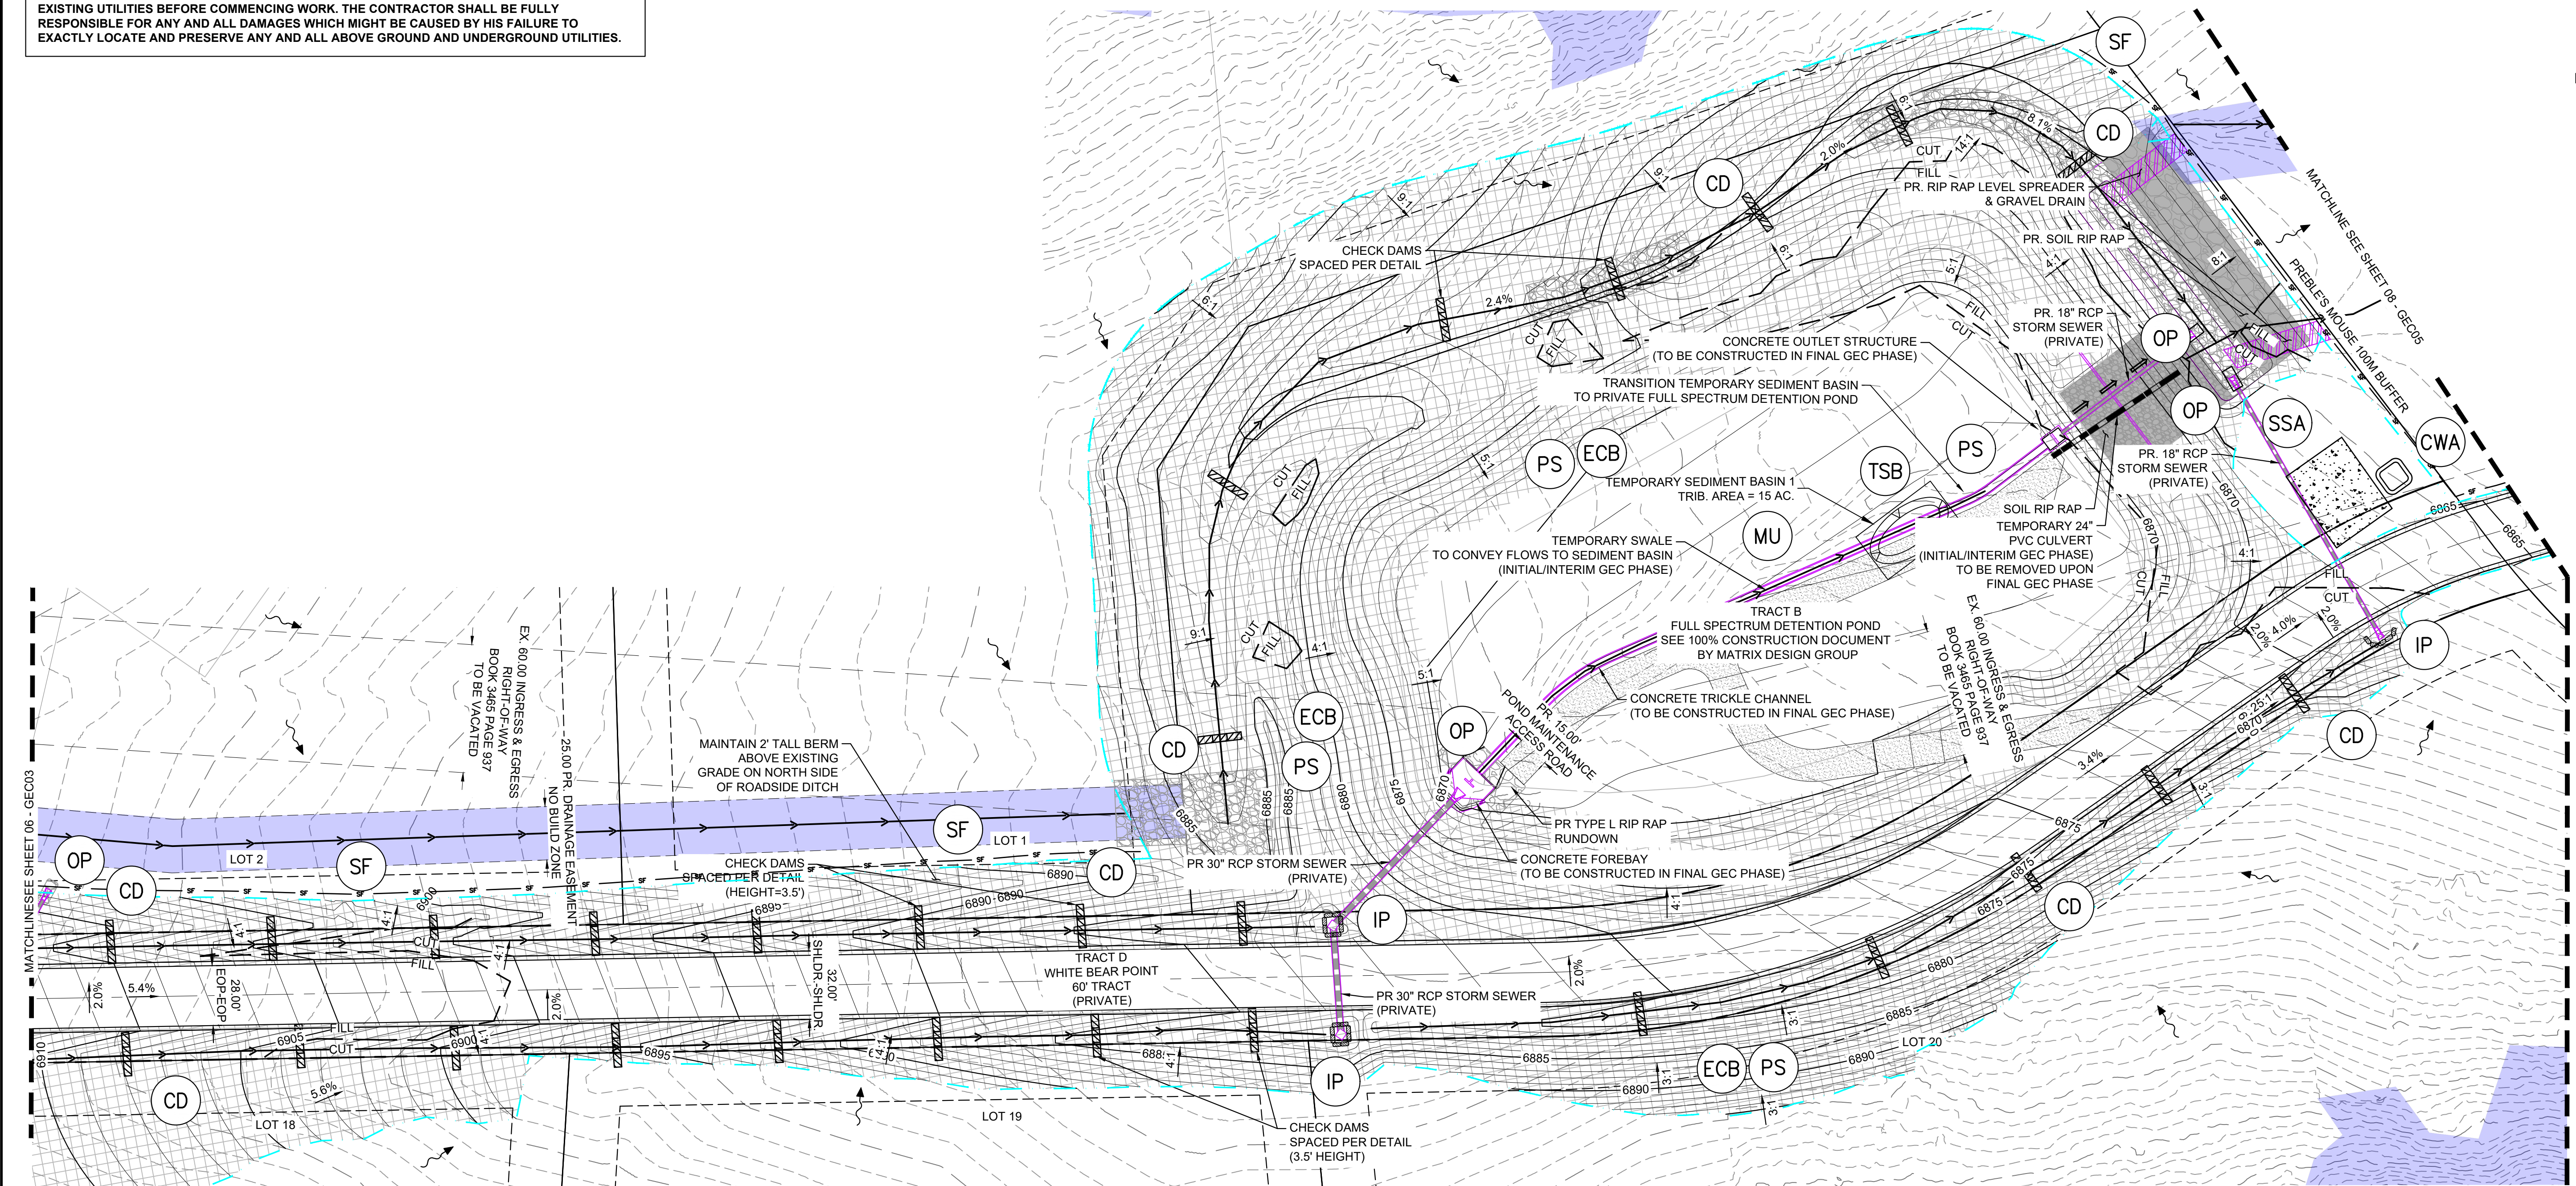



TEMPORARY SEDIMENT BASIN SUMMARY				
ID	BASIN BOTTOM WIDTH (FT)	SPILLWAY CREST LENGTH (FT)	HOLE DIAMETER (IN)	REQUIRED VOLUME (CF)
1	73.25	22	1 3/16	41,070

BMP SEQUENCING	
INITIAL	SILT FENCE, VEHICLE TRACKING, TEMP SEDIMENT BASINS
INTERIM	CHECK DAMS, CONCRETE WASHOUT, INLET/OUTLET PROTECTION, STOCKPILES, STAGING, ROUGH CUT STREET CONTROL
FINAL	EROSION CONTROL BLANKETS, SEEDING & MULCHING, PERMANENT CONTROL MEASURE(S)

NOTES:  
 1. SEE CHECK DAM (CD) DETAIL EC-12 ON SHEET ECN01 FOR SPACING.  
 2. ALL EROSION CONTROL BLANKET SHALL BE INSPECTED 24-MONTHS AFTER INSTALLATION. EROSION CONTROL BLANKET MAY BE REQUIRED TO BE RE-INSTALLED PER MANUFACTURER SPECIFICATIONS.


### EROSION CONTROL LEGEND

PS PERMANENT SEEDING	MULCHING	EXISTING CONTOURS
SILT FENCE	TEMPORARY SEDIMENT BASIN	DRAINAGE SWALE
EROSION CONTROL BLANKET	CONCRETE WASHOUT	OVERLAND FLOW
OUTLET PROTECTION	STOCKPILE MANAGEMENT / STABILIZED STAGING AREA	LIMITS OF DISTURBANCE/ CONSTRUCTION SITE BOUNDARY
INLET PROTECTION	HIGH POINT / LOW POINT	PROJECT BOUNDARY LINE
VEHICLE TRACKING CONTROL	PROPOSED CONTOURS	OVERFLOW ROUTE
PROPOSED RIP RAP	EXISTING FENCE	CUT/FILL LINE
CHECK DAM	PROPOSED STORM DRAIN	100 YEAR FLOODPLAIN BOUNDARY
	NO BUILD ZONE (SLOPE GREATER THAN 29.99%)	MATCHLINE
		PROPOSED LOT/TRACT LINE
		EASEMENT
		PROPOSED BUILDING SETBACK

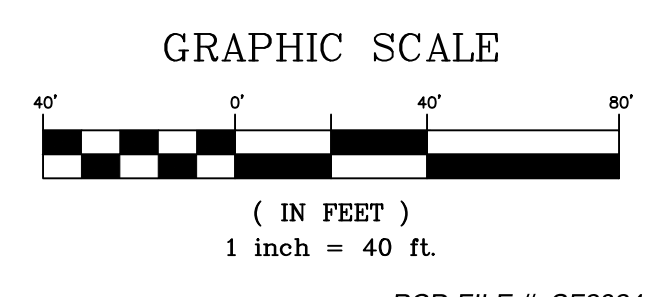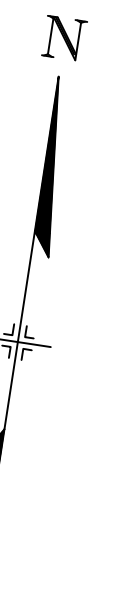

PCD FILE #: SF2324

REFERENCE DRAWINGS	No.	DATE	DESCRIPTION	BY
X-TITLE-CD X-886-PR-SITE FE8A.X3 X-886-066-EX-MAP-1 X-886-ALTA-SURVEY Hay Creek SFE3 2023-02-28 TOPO 164022-01 164022-01 Hay Creek Road BMDY				
<b>COMPUTER FILE MANAGEMENT</b>				
FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\GEC01.dwg				
CTB FILE: Matrix.ctb				
PLOT DATE: 5/29/2024 9:35 AM				
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.				

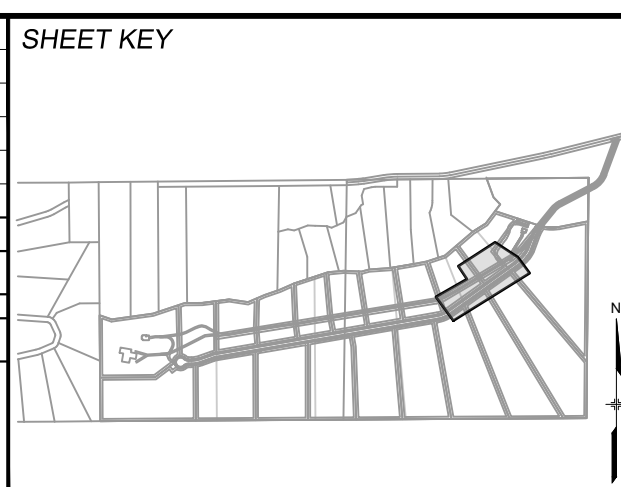

**BENCHMARK**  
 PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
 THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PL325955 C1/4 S22 T16S, R65W 1999," AND THE WESTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T16S, R65W 2000," BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:  
**Matrix**  
 Excellence by Design

SEAL

FOR AND ON BEHALF OF  
 MATRIX DESIGN GROUP, INC.  
 PROJECT No. 22.886.076

**HAY CREEK VALLEY**  
 EL PASO COUNTY, COLORADO  
 FINAL GRADING & EROSION CONTROL PLANS


**GRADING & EROSION CONTROL PLAN**

DESIGNED BY: CVW	SCALE: 1" = 40'	DATE ISSUED: MAY 2024	DRAWING No. GEC04
DRAWN BY: CVW	HORIZ: 1" = 40'	SHEET 07 OF 12	
CHECKED BY: JAO	VERT: N/A		



Know what's below.  
Call before you dig.

THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

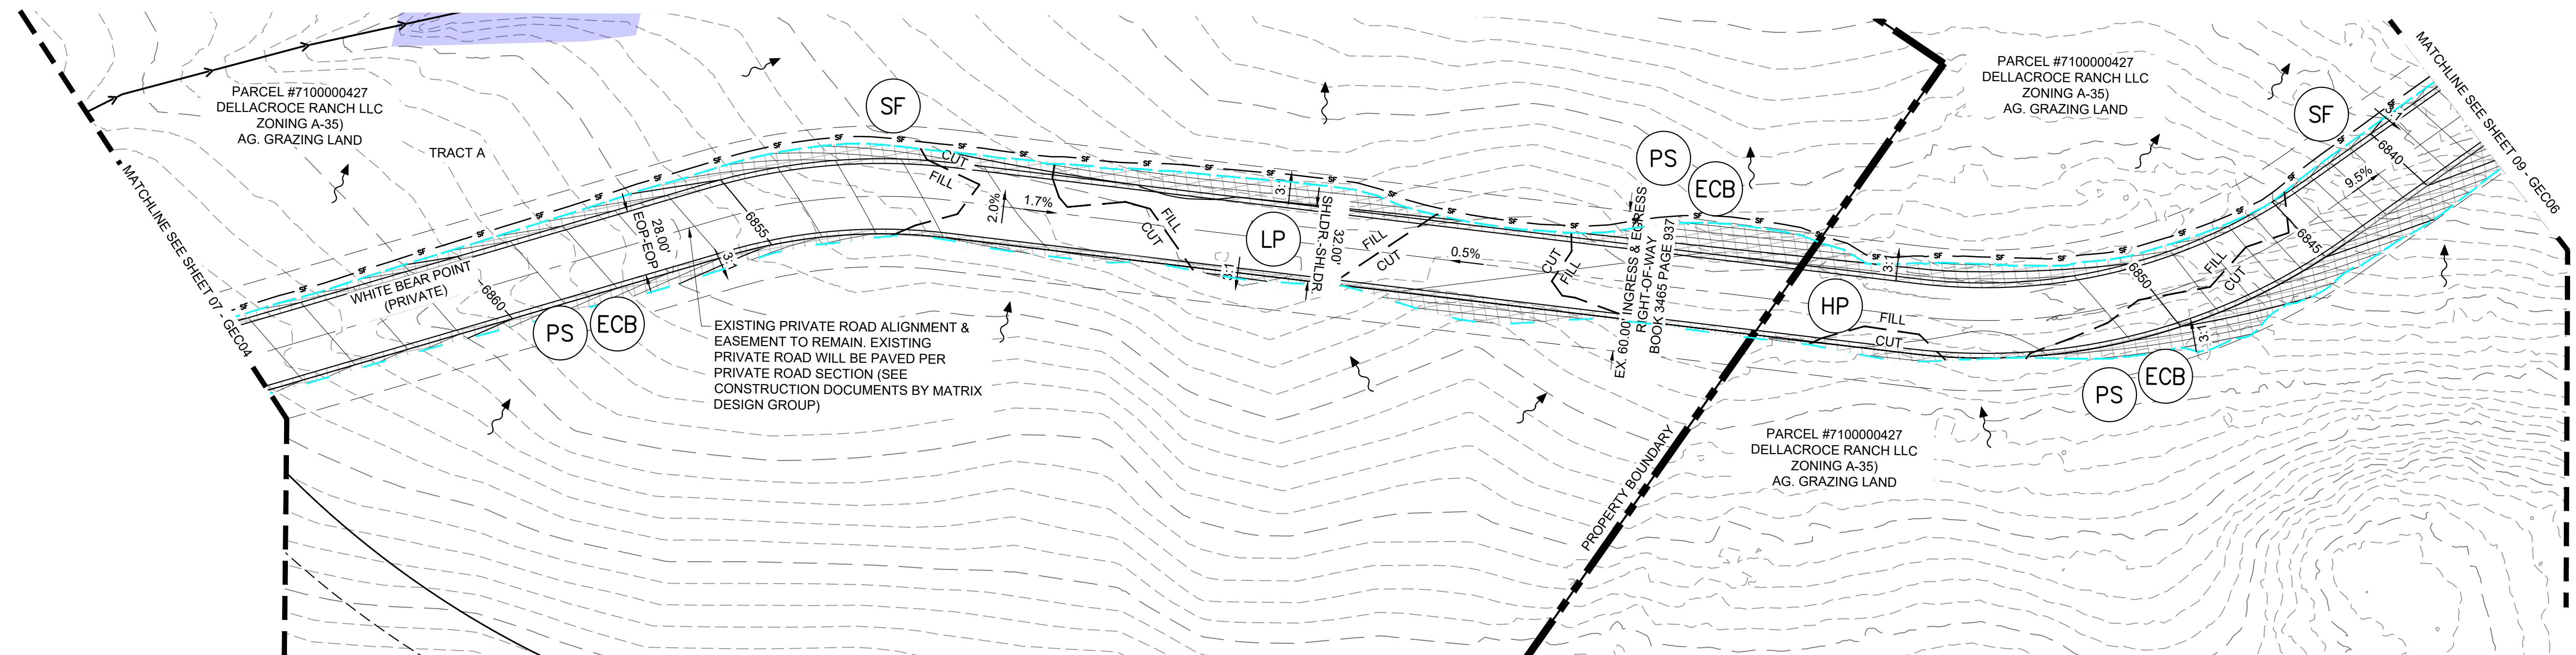


BMP SEQUENCING	
INITIAL	SILT FENCE, VEHICLE TRACKING, TEMP SEDIMENT BASINS
INTERIM	CHECK DAMS, CONCRETE WASHOUT, INLET/OUTLET PROTECTION, STOCKPILES, STAGING, ROUGH CUT STREET CONTROL
FINAL	EROSION CONTROL BLANKETS, SEEDING & MULCHING, PERMANENT CONTROL MEASURE(S)


NOTES:  
 1. SEE CHECK DAM (CD) DETAIL EC-12 ON SHEET ECN01 FOR SPACING.  
 2. ALL EROSION CONTROL BLANKET SHALL BE INSPECTED 24-MONTHS AFTER INSTALLATION. EROSION CONTROL BLANKET MAY BE REQUIRED TO BE RE-INSTALLED PER MANUFACTURER SPECIFICATIONS.

### EROSION CONTROL LEGEND

PS PERMANENT SEEDING	MULCHING	EXISTING CONTOURS
SF SILT FENCE	TEMPORARY SEDIMENT BASIN	DRAINAGE SWALE
ECB EROSION CONTROL BLANKET	CONCRETE WASHOUT	SLOPE LABEL
OP OUTLET PROTECTION	STOCKPILE MANAGEMENT / STABILIZED STAGING AREA	OVERLAND FLOW
IP INLET PROTECTION	HIGH POINT / LOW POINT	LIMITS OF DISTURBANCE/ CONSTRUCTION SITE BOUNDARY
VTC VEHICLE TRACKING CONTROL	PROPOSED CONTOURS	PROJECT BOUNDARY LINE
PROPOSED RIP RAP	EXISTING FENCE	OVERFLOW ROUTE
CD CHECK DAM	EXISTING STORM DRAIN	CUT/FILL LINE
	NO BUILD ZONE (SLOPE GREATER THAN 29.99%)	100 YEAR FLOODPLAIN BOUNDARY
		MATCHLINE
		PROPOSED LOT/TRACT LINE
		EASEMENT
		PROPOSED BUILDING SETBACK

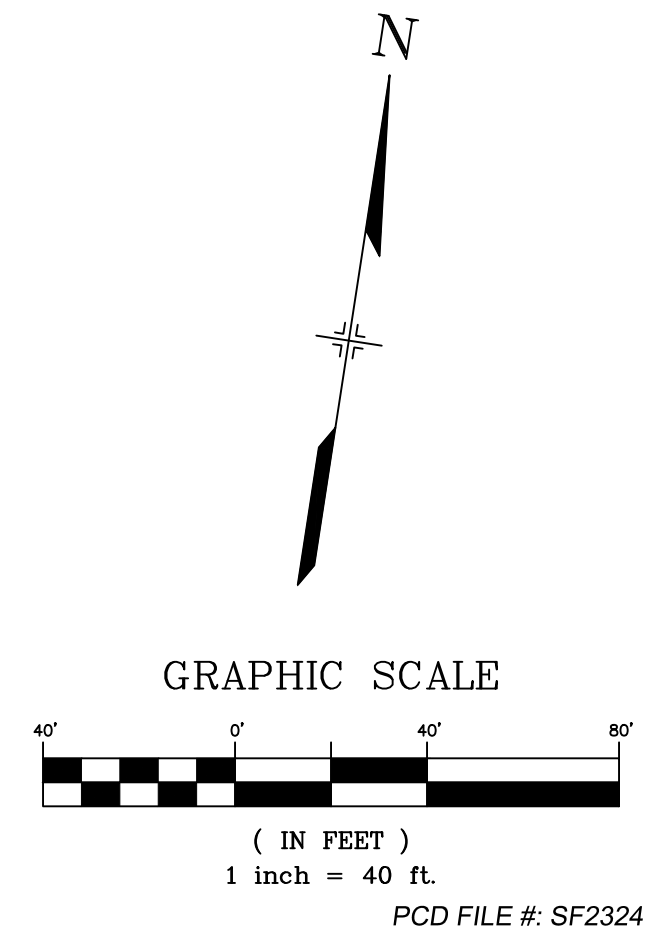

REF. NO.	DATE	DESCRIPTION	BY
COMPUTER FILE MANAGEMENT			
FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\GEC01.dwg			
CTB FILE: Matrix.ctb			
PLOT DATE: 5/29/2024 9:35 AM			
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.			

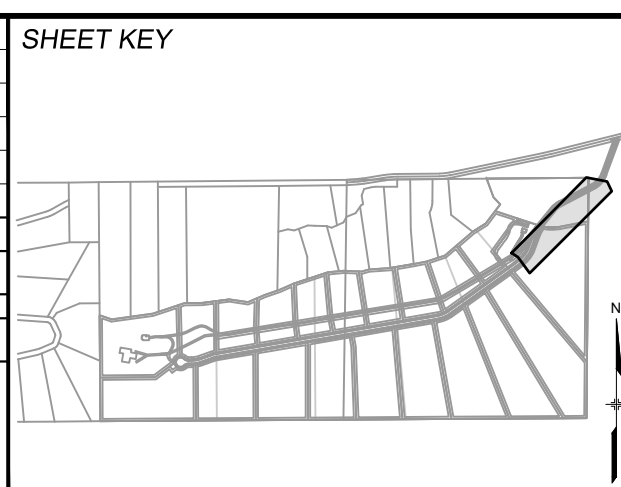

**BENCHMARK**  
 PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
 THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PLS25955 C1/4 S22 T16S, R65W 1999, "AND THE WESTERLY END BY A2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T16S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:  
**Matrix**  
 Excellence by Design

SEAL

**HAY CREEK VALLEY**  
 EL PASO COUNTY, COLORADO  
 FINAL GRADING & EROSION CONTROL PLANS

**GRADING & EROSION CONTROL PLAN**

DESIGNED BY: CVW	SCALE: 1" = 40'	DATE ISSUED: MAY 2024	DRAWING No. GEC05
DRAWN BY: CVW	HORIZ. N/A	SHEET 08 OF 12	
CHECKED BY: JAO	VERT. N/A		


PCD FILE #: SF2324





Know what's below.  
Call before you dig.

THE LOCATIONS OF EXISTING ABOVE GROUND AND UNDERGROUND UTILITIES ARE SHOWN IN AN APPROXIMATE WAY ONLY. THE CONTRACTOR SHALL DETERMINE THE EXACT LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING WORK. THE CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR ANY AND ALL DAMAGES WHICH MIGHT BE CAUSED BY HIS FAILURE TO EXACTLY LOCATE AND PRESERVE ANY AND ALL ABOVE GROUND AND UNDERGROUND UTILITIES.

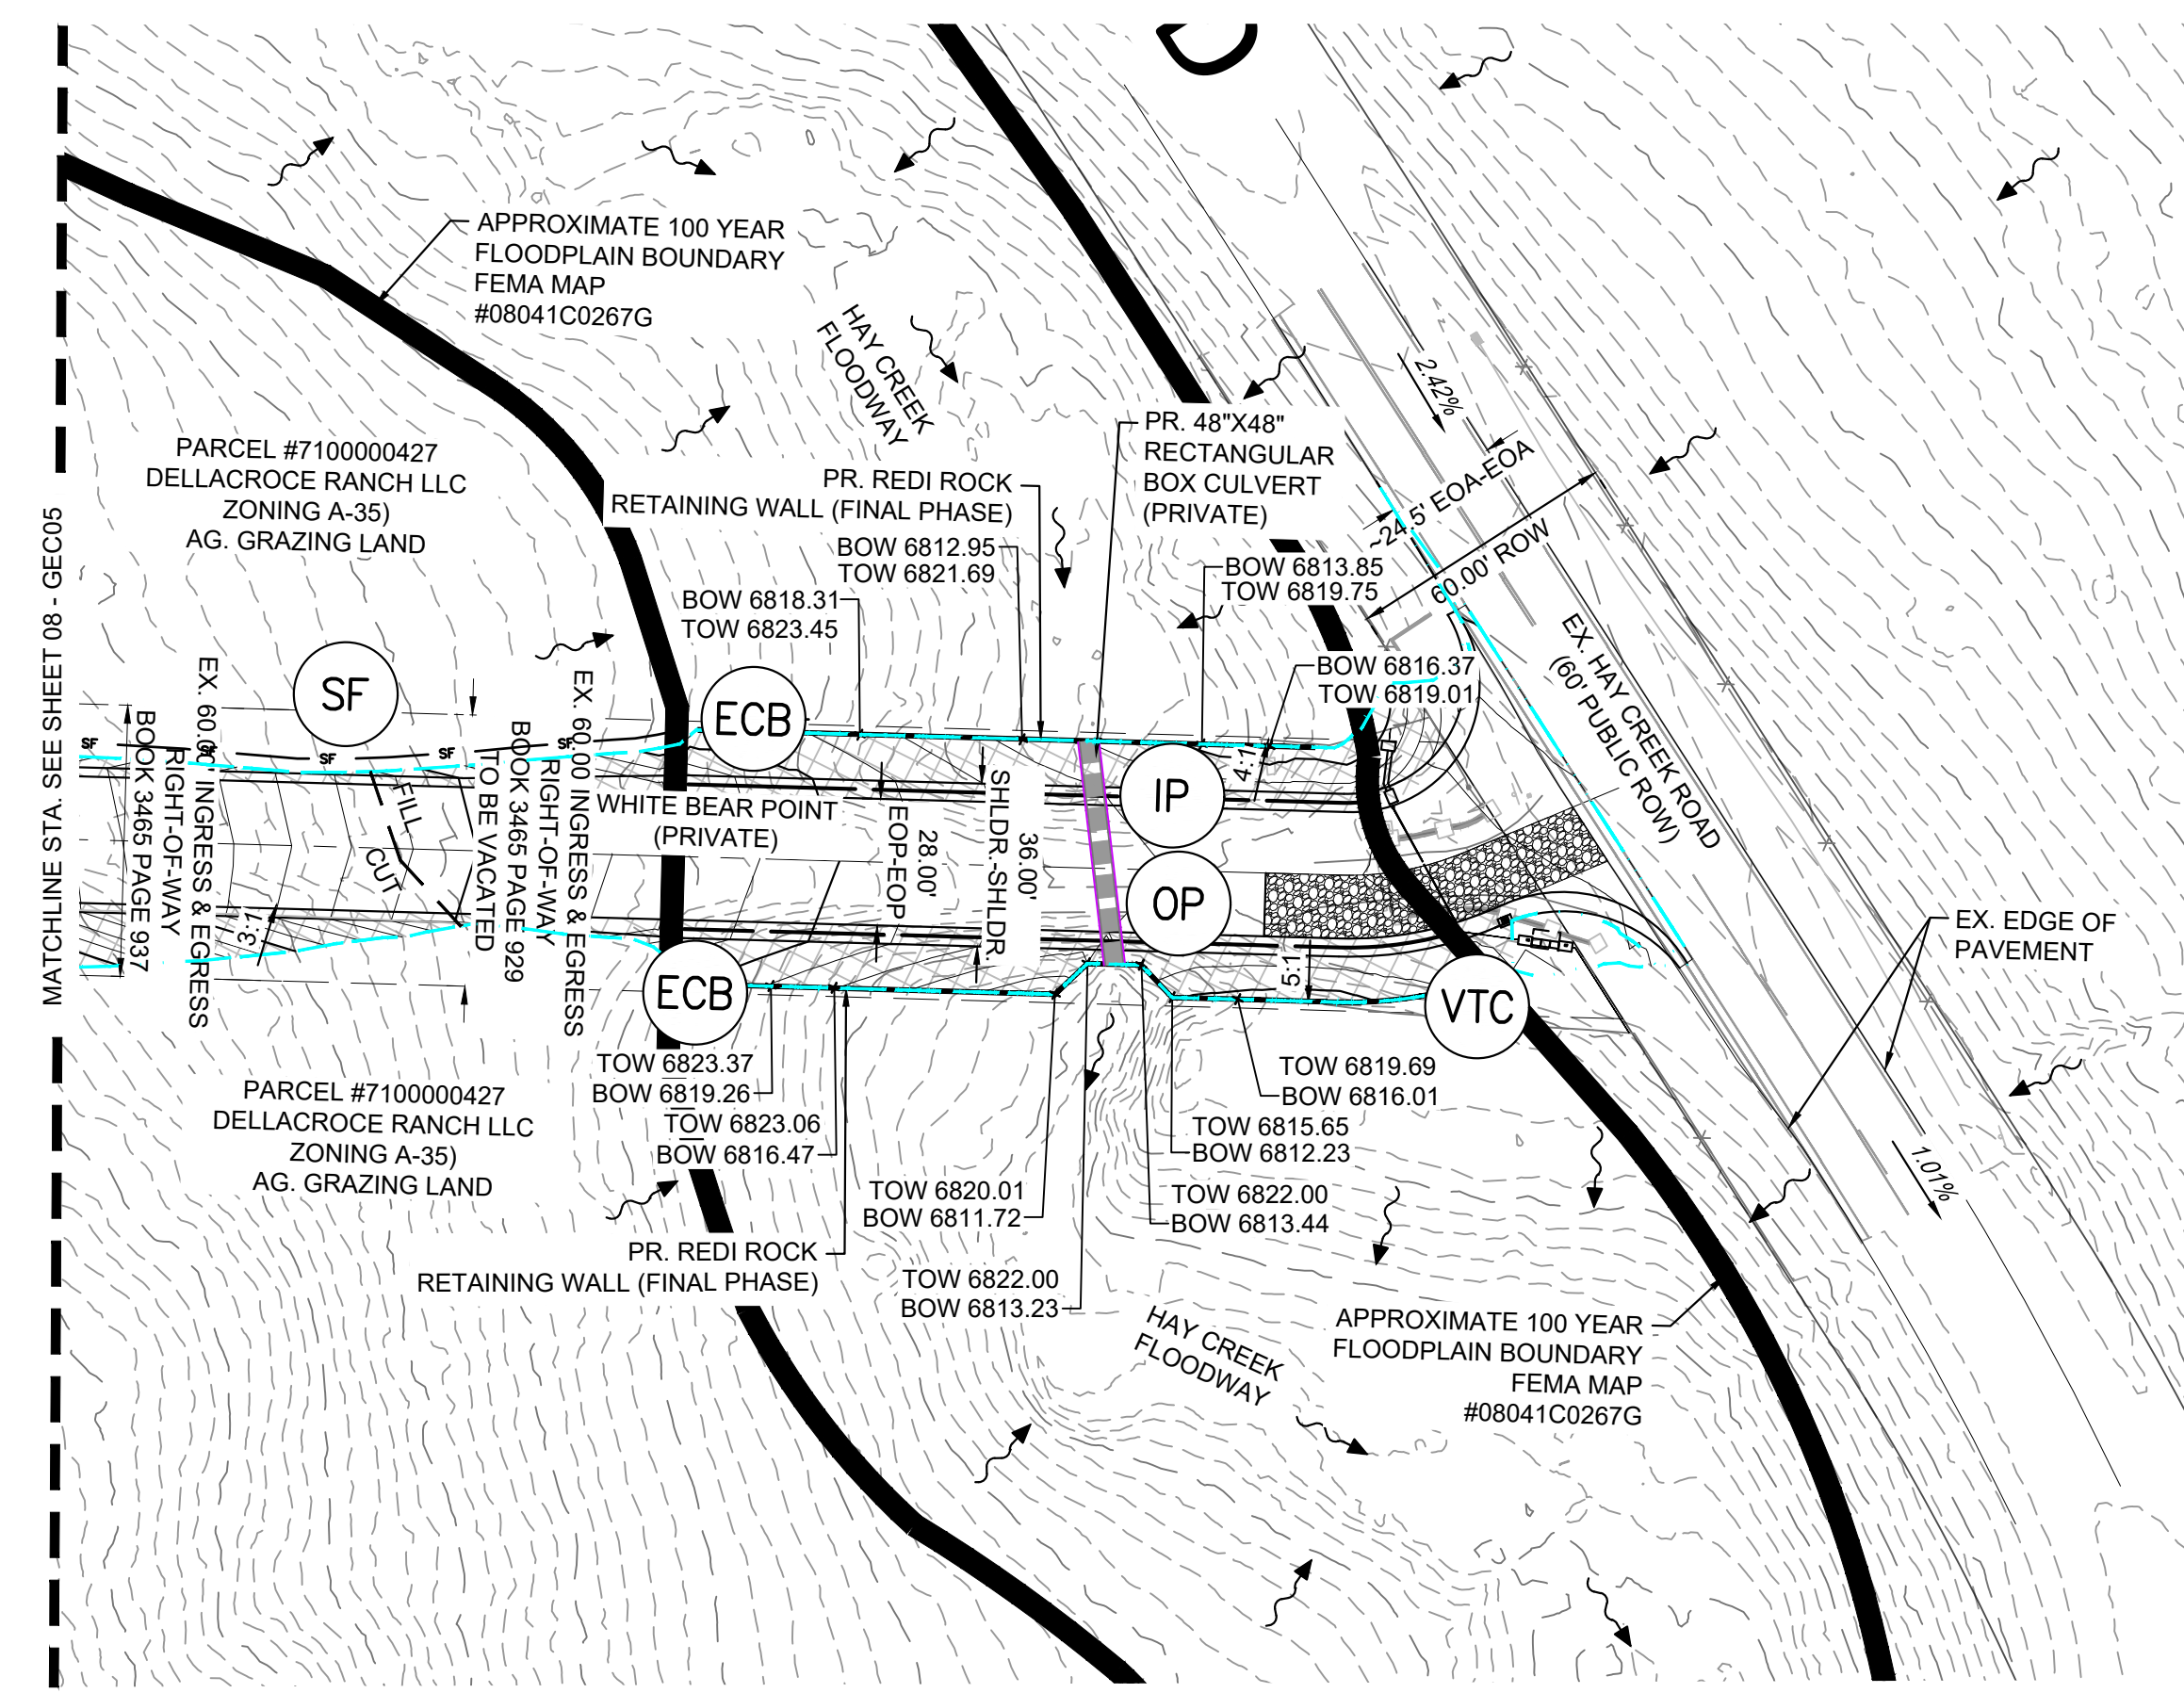


BMP SEQUENCING	
INITIAL	SILT FENCE, VEHICLE TRACKING, TEMP SEDIMENT BASINS
INTERIM	CHECK DAMS, CONCRETE WASHOUT, INLET/OUTLET PROTECTION, STOCKPILES, STAGING, ROUGH CUT STREET CONTROL
FINAL	EROSION CONTROL BLANKETS, SEEDING & MULCHING, PERMANENT CONTROL MEASURE(S)

**NOTES:**  
 1. SEE CHECK DAM (CD) DETAIL EC-12 ON SHEET ECN01 FOR SPACING.  
 2. ALL EROSION CONTROL BLANKET SHALL BE INSPECTED 24-MONTHS AFTER INSTALLATION. EROSION CONTROL BLANKET MAY BE REQUIRED TO BE RE-INSTALLED PER MANUFACTURER SPECIFICATIONS.


### EROSION CONTROL LEGEND

SF	PERMANENT SEEDING	MU	MULCHING
SF	SILT FENCE	TSB	TEMPORARY SEDIMENT BASIN
ECB	EROSION CONTROL BLANKET	CWA	CONCRETE WASHOUT
OP	OUTLET PROTECTION	SSA	STOCKPILE MANAGEMENT / STABILIZED STAGING AREA
IP	INLET PROTECTION	HP	HIGH POINT / LOW POINT
VTC	VEHICLE TRACKING CONTROL	LP	PROPOSED CONTOURS
CD	CHECK DAM		EXISTING FENCE
	PROPOSED RIP RAP		PROPOSED STORM DRAIN
	NO BUILD ZONE (SLOPE GREATER THAN 29.99 %)		NO BUILD ZONE (SLOPE GREATER THAN 29.99 %)

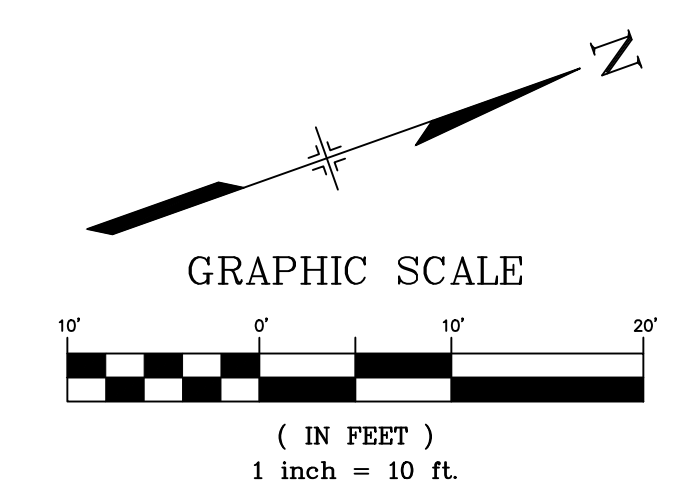

PCD FILE #: SF2324

REF. NO.	DATE	DESCRIPTION	BY
COMPUTER FILE MANAGEMENT			
FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\GEC01.dwg			
CTB FILE: Matrix.ctb			
PLOT DATE: 5/29/2024 9:35 AM			
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.			

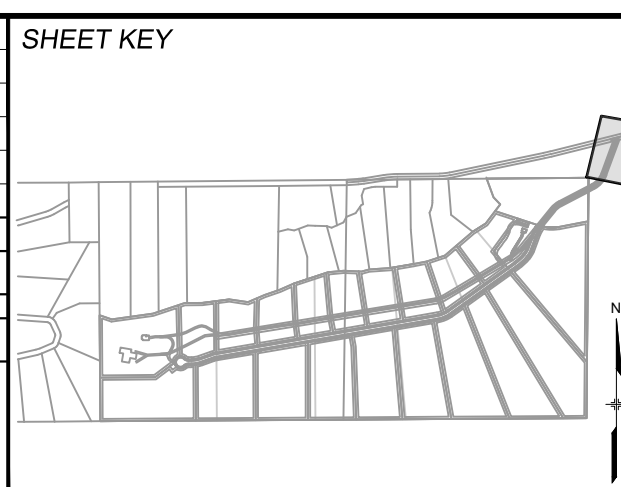

**BENCHMARK**  
 PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**  
 THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 66 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PLS25955 C1/4 S22 T16S, R65W 1999, "AND THE WESTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T15S, R65W 2000, "BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:

Excellence by Design

SEAL

FOR AND ON BEHALF OF  
 MATRIX DESIGN GROUP, INC.  
 PROJECT No. 22.886.076

**HAY CREEK VALLEY**  
 EL PASO COUNTY, COLORADO  
 FINAL GRADING & EROSION CONTROL PLANS

**GRADING & EROSION CONTROL PLAN**

DESIGNED BY: CVW	SCALE: 1" = 40'	DATE ISSUED: MAY 2024	DRAWING No. GEC06
DRAWN BY: CVW	HORIZ. N/A	SHEET 09 OF 12	
CHECKED BY: JAO	VERT. N/A		




Know what's below. Call before you dig.

Rolled Erosion Control Products (RECP) EC-6

Staking patterns are also provided in the design details according to these factors:
• ECB type
• Slope or channel type
For other types of RECPs including TRMs, these design details are intended to serve as general guidelines for design and installation; however, engineers should adhere to manufacturer's installation recommendations.
Maintenance and Removal
Inspection of erosion control blankets and other RECPs include:
• Check for general signs of erosion, including voids beneath the mat. If voids are apparent, fill the void with suitable soil and replace the erosion control blanket, following the appropriate staking pattern.
• Check for damaged or loose stakes and secure loose portions of the blanket.
Erosion control blankets and other RECPs that are biodegradable typically do not need to be removed after construction. If they may be removed, then an alternate soil stabilization method should be installed promptly following removal.
Turf reinforcement mats, although generally resistant to biodegradation, are typically left in place as a dense vegetated cover grows through the turf mats. The turf reinforcement mat provides long-term stability and helps the established vegetation resist erosion forces.


November 2010 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 RECP-5

EC-6 Rolled Erosion Control Products (RECP)

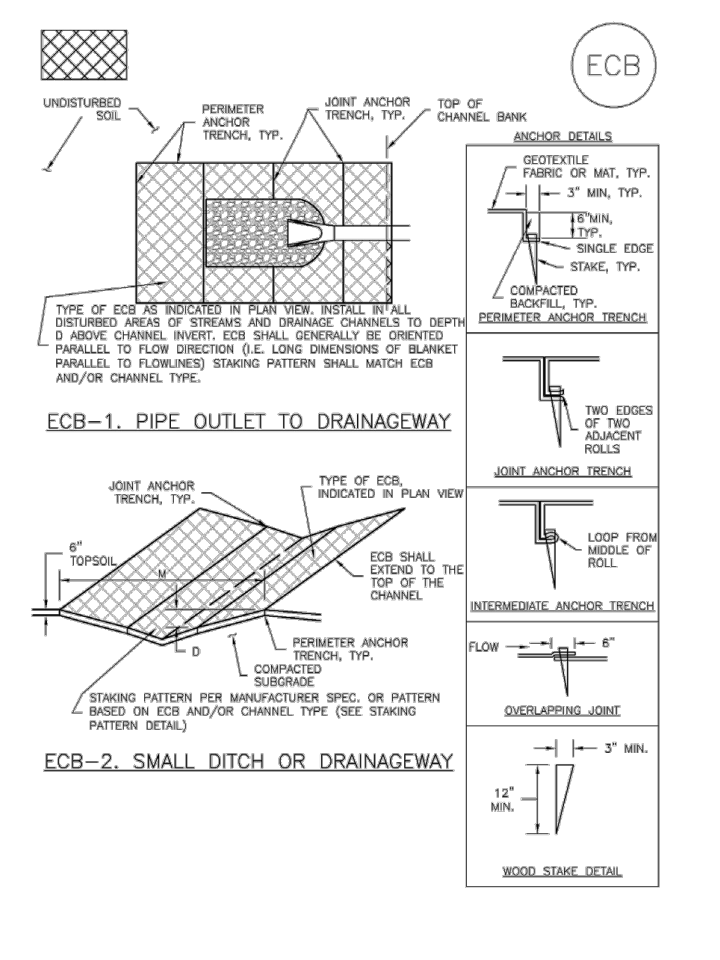

RECP-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Rolled Erosion Control Products (RECP) EC-6

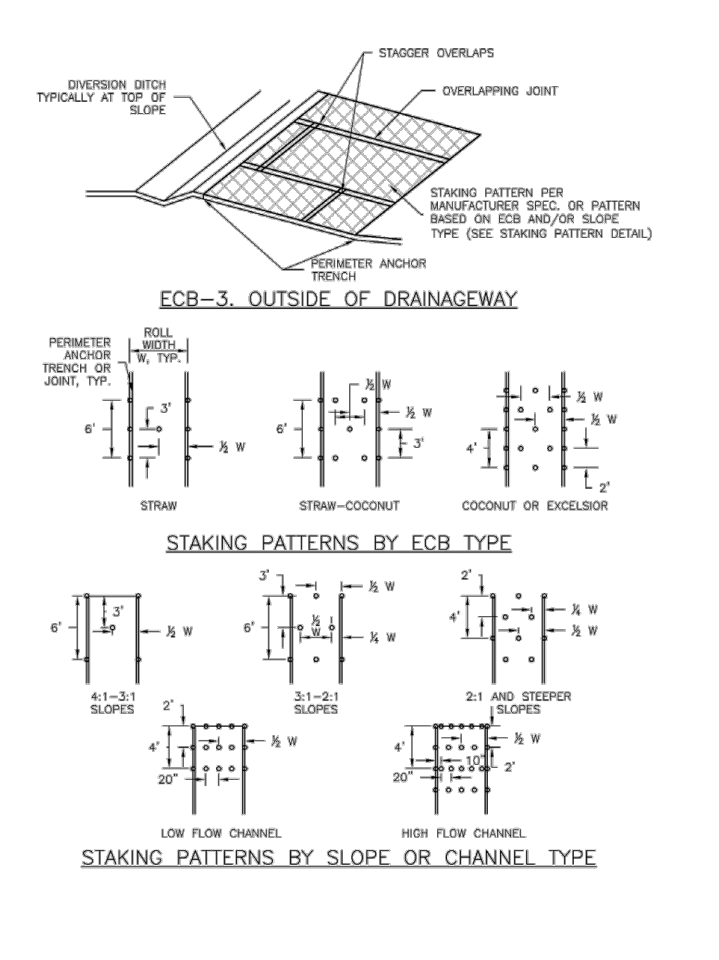

RECP-7 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

EC-6 Rolled Erosion Control Products (RECP)

Table EC-6-1: ERM Material Specifications. Columns: Type, Cocoyut Content, Straw Content, Exclosure Content, Recommended Method. Rows: Straw, Straw-Cocoyut, Cocoyut, Exclosure.


RECP-8 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Rolled Erosion Control Products (RECP) EC-6

Table EC-6-1: ERM Material Specifications. Columns: Type, Cocoyut Content, Straw Content, Exclosure Content, Recommended Method. Rows: Straw, Straw-Cocoyut, Cocoyut, Exclosure.


RECP-9 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

EC-8 Temporary Outlet Protection (TOP)

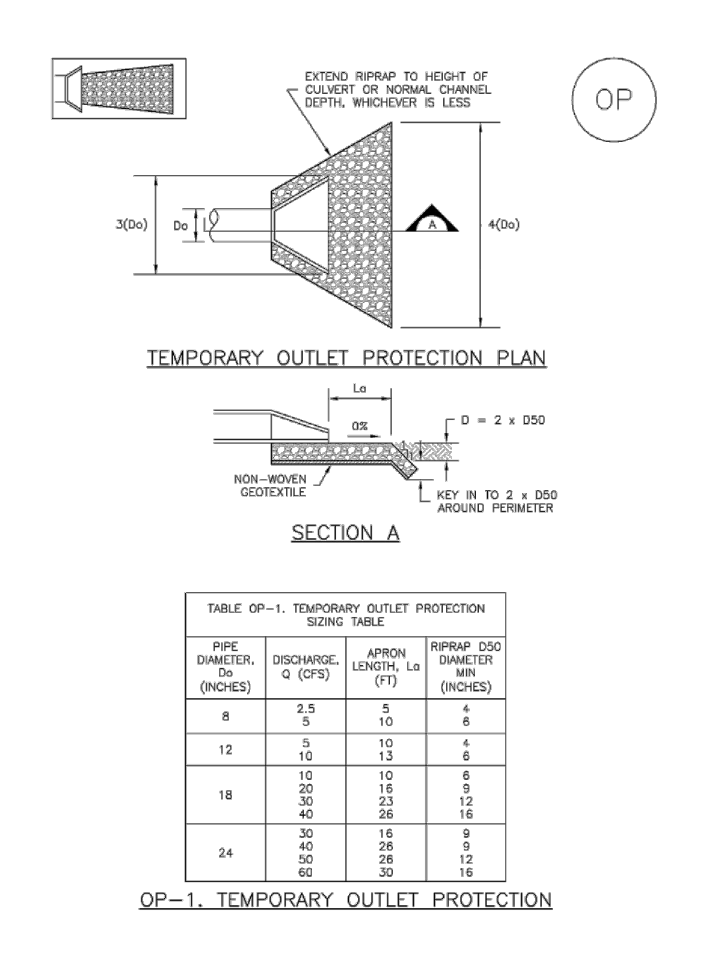


TOP-2 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Temporary Outlet Protection (TOP) EC-8

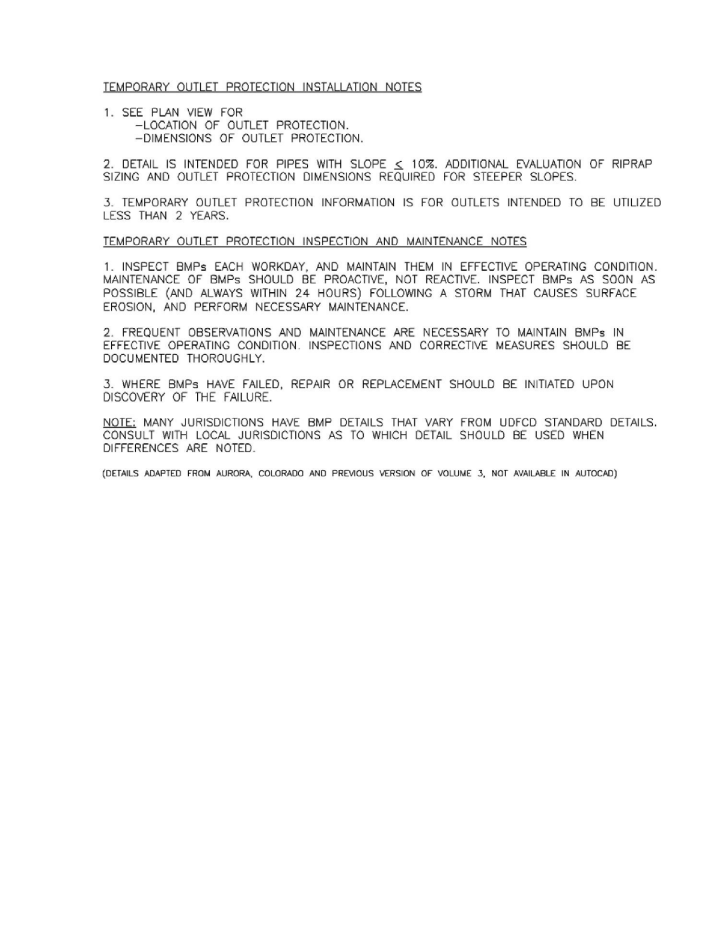


TOP-3 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

EC-9 Rough Cut Street Control (RCS)

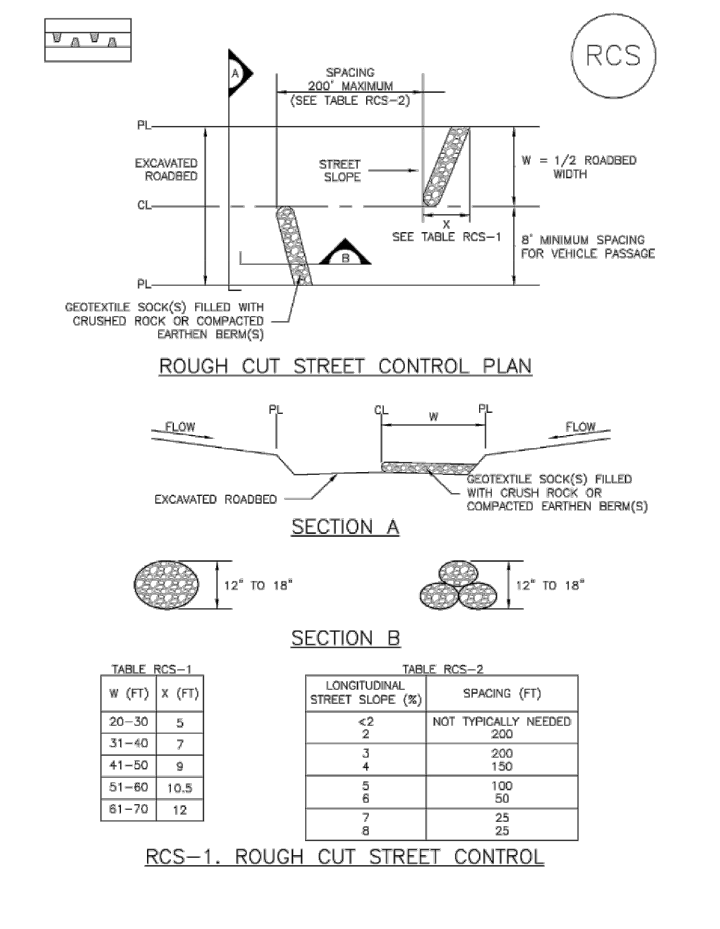


RCS-2 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Rough Cut Street Control (RCS) EC-9

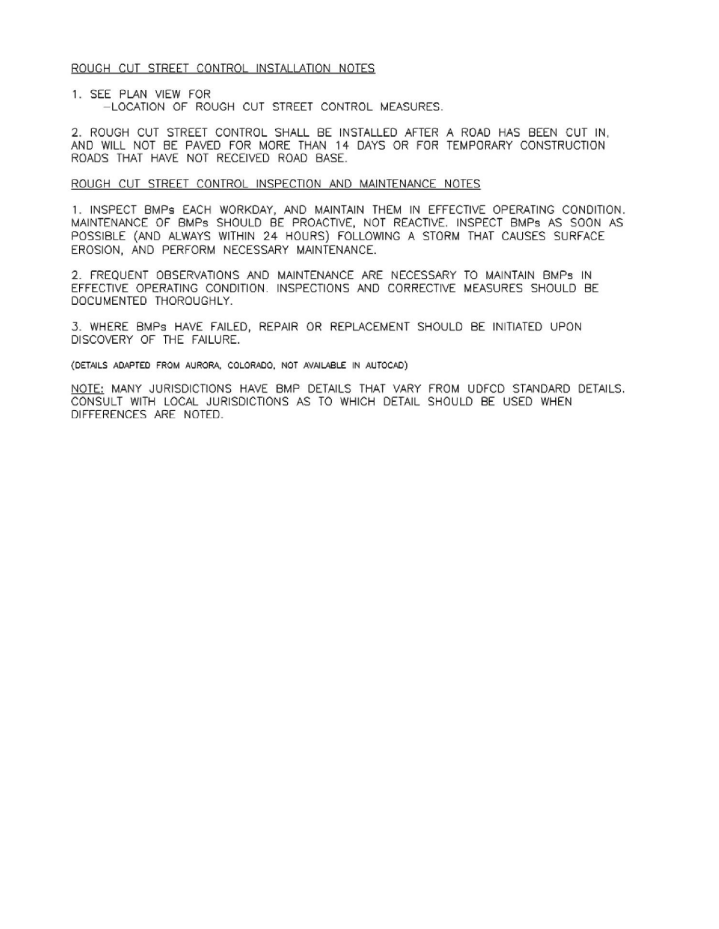


RCS-3 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Concrete Washout Area (CWA) MM-1

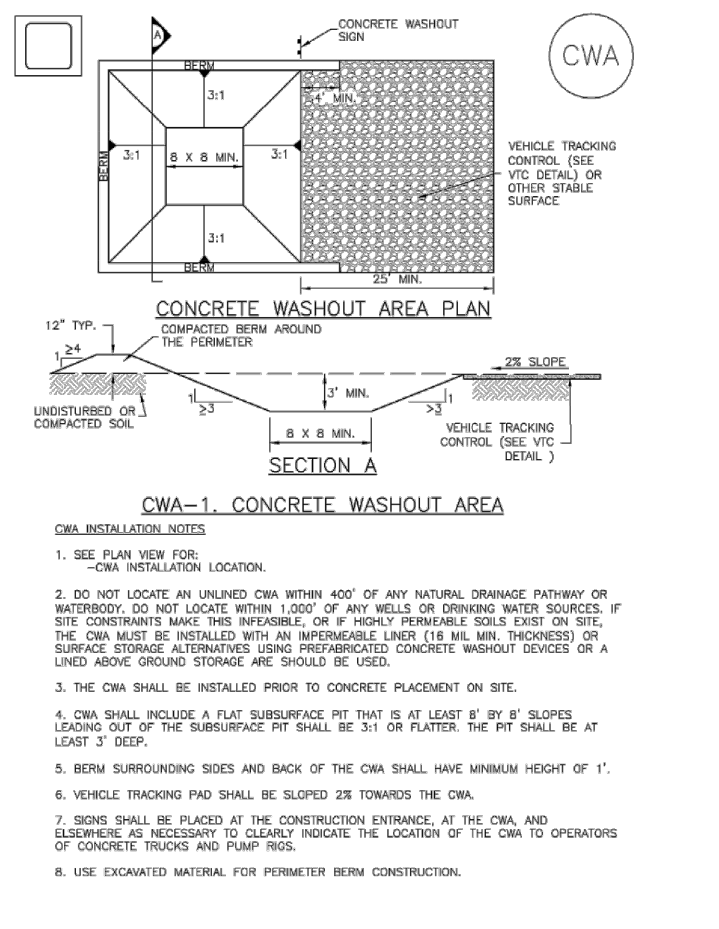


CWA-3 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

MM-1 Concrete Washout Area (CWA)

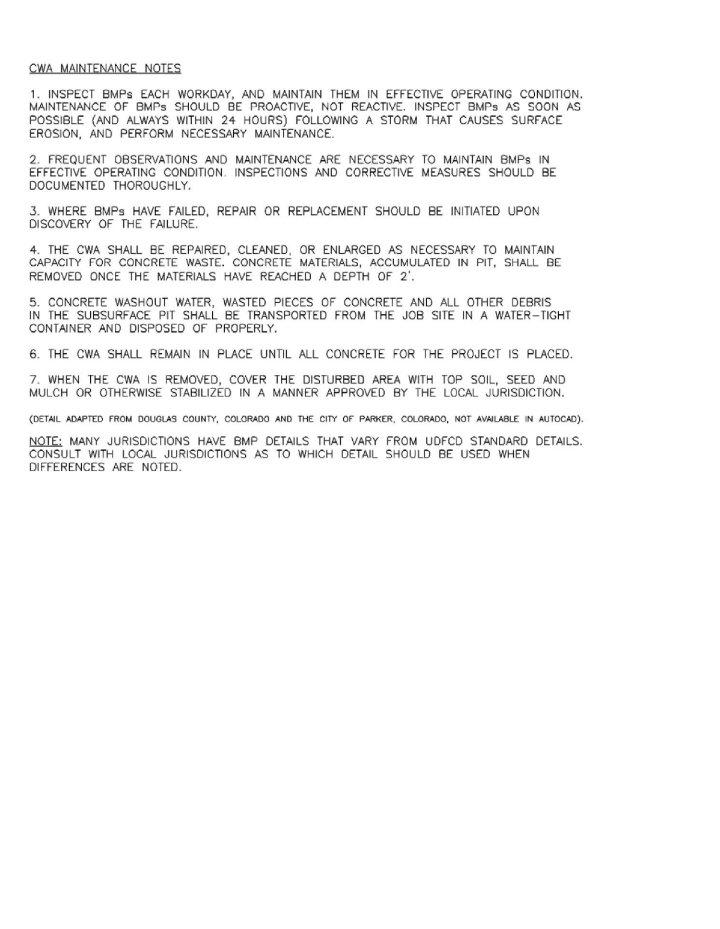


CWA-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Check Dams (CD) EC-12

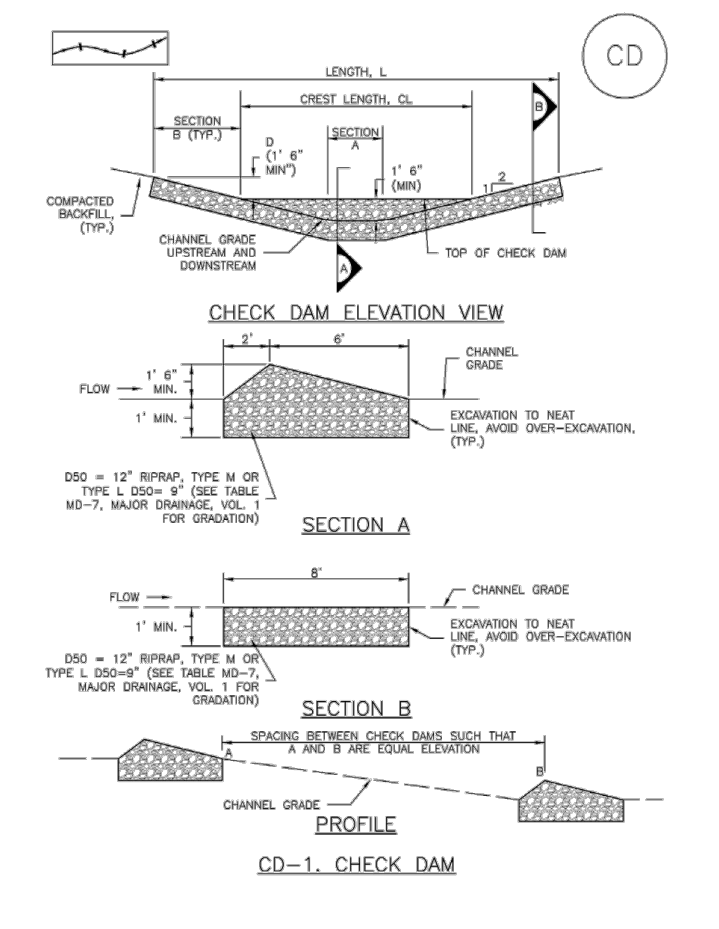


CD-3 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

EC-12 Check Dams (CD)

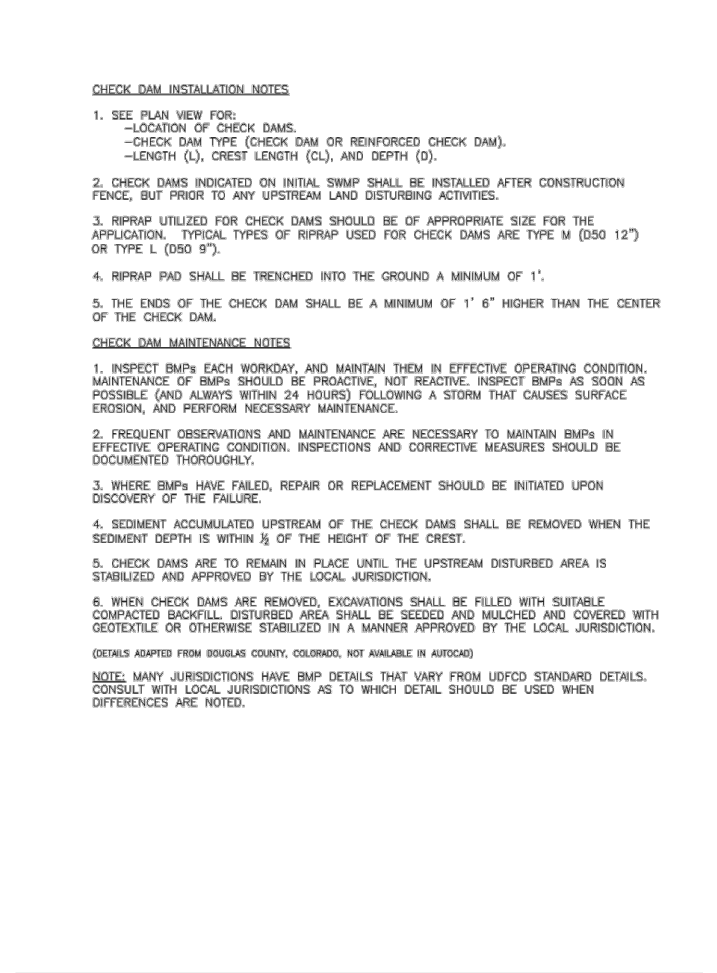


CD-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Check Dams (CD) EC-12

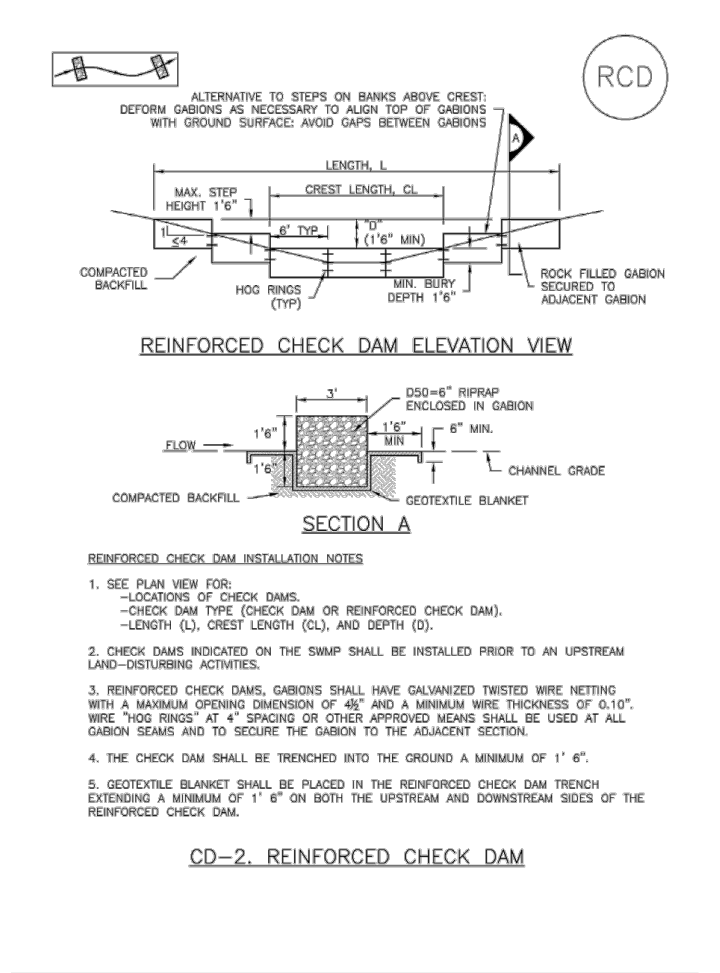


CD-5 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

EC-12 Check Dams (CD)

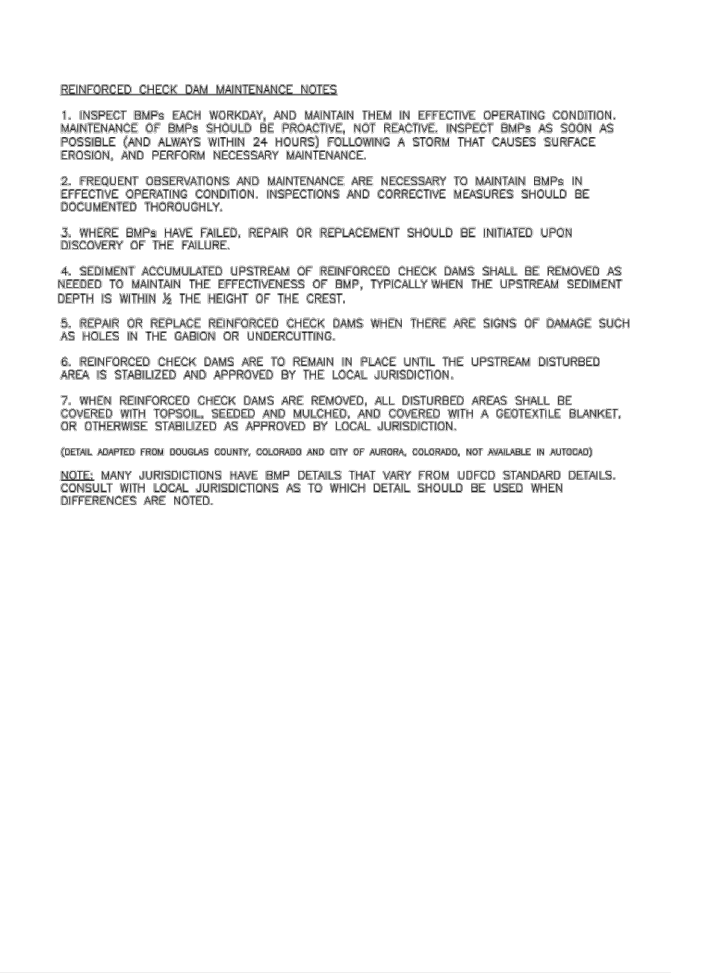


CD-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

Silt Fence (SF) SC-1

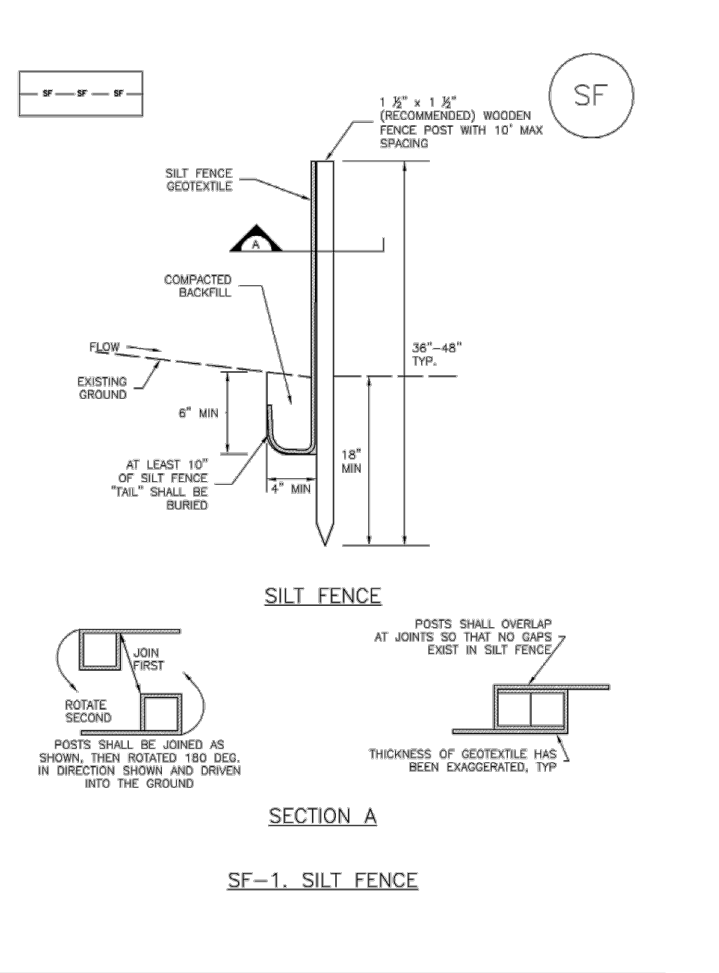

SF-3 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010


SC-1 Silt Fence (SF)

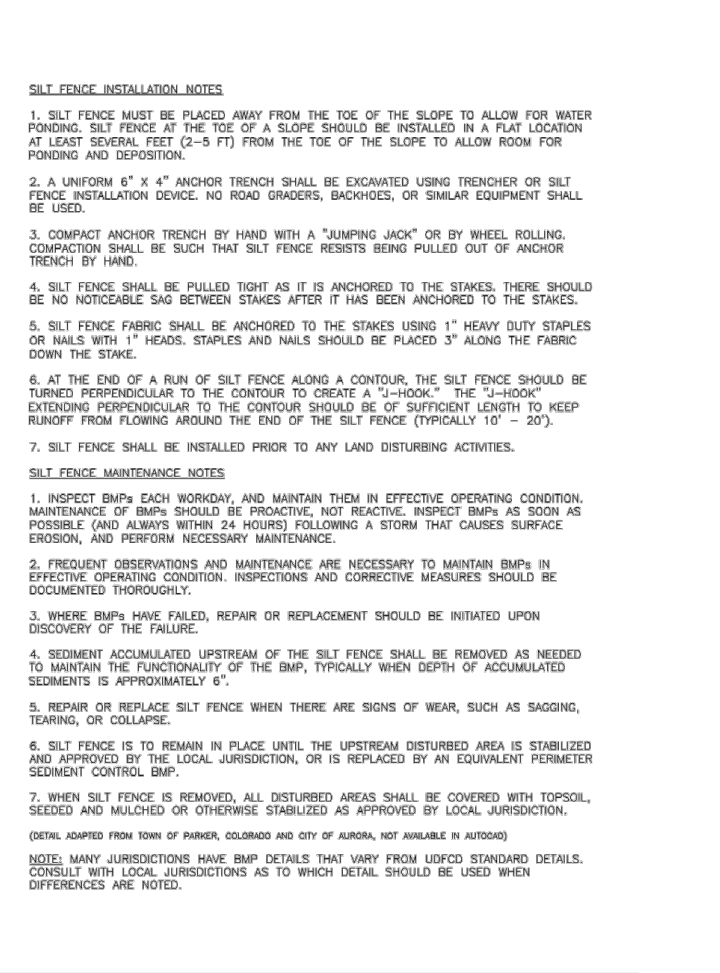

SF-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

REFERENCE DRAWINGS table with columns: No., DATE, DESCRIPTION, REVISIONS.

COMPUTER FILE MANAGEMENT table with columns: FILE NAME, CTB FILE, PLOT DATE.

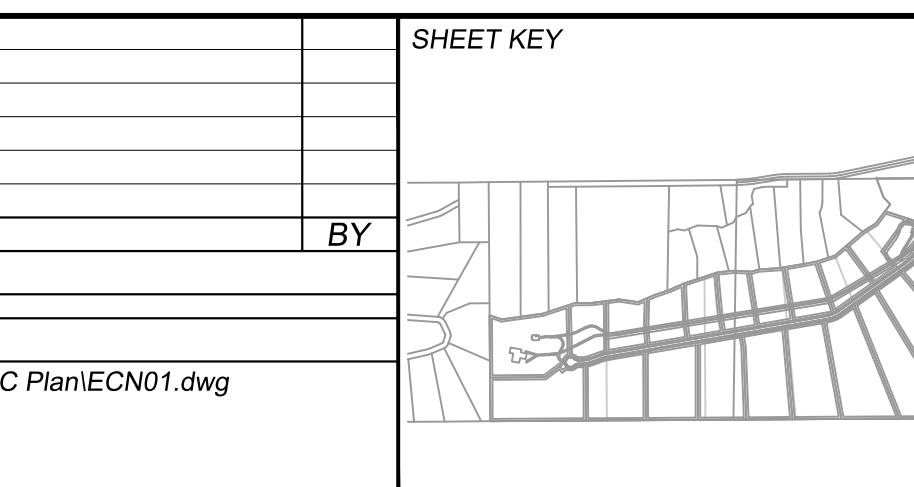

BENCHMARK PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92. BASIS OF BEARING THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED 'NOLTE PL252955 C1/4 S22 T165, R65W 1999, 'AND THE WESTERLY END BY A2-1/2" ALUMINUM CAP STAMPED 'SSS PLS 16154 1/4 S21 S22 T165, R65W 2000, 'BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

Matrix logo and text: EXCELLENCE BY DESIGN. PREPARED BY: Matrix.

SEAL Colorado Licensed Professional Engineer Jeffrey A. Jones, No. 14265, 05/28/2024.

HAY CREEK VALLEY EL PASO COUNTY, COLORADO FINAL GRADING & EROSION CONTROL PLANS DETAILS. DRAWN BY: CVW, CHECKED BY: JAO, SCALE: HORIZ. N/A, VERT. N/A, DATE ISSUED: MAY 2024, SHEET 10 OF 12, DRAWING No. ECN01.



Know what's below. Call before you dig.

**SC-6 Inlet Protection (IP)**

IP-3. Rock Sock Inlet Protection for Sump/Area Inlet  
 IP-4. Silt Fence Inlet Protection for Sump/Area Inlet  
 IP-5. Over-excavation Inlet Protection  
 IP-6. Straw Bale Inlet Protection for Sump/Area Inlet  
 CIP-1. Culvert Inlet Protection

Proprietary inlet protection devices should be installed in accordance with manufacturer specifications. More information is provided below on selecting inlet protection for sump and on-grade locations.

**Inlets Located in a Sump**

When applying inlet protection in sump conditions, it is important that the inlet continue to function during larger runoff events. For each inlet, the maximum height of the protective barrier should be lower than the top of the curb opening to allow overflow into the inlet during larger storms without excessive localized flooding. If the inlet protection height is greater than the curb elevation, particularly if the filter becomes clogged with sediment, runoff will not enter the inlet and may bypass it, possibly causing localized flooding, public safety issues, and downstream erosion and damage from bypassed flows.

Area inlets located in a sump setting can be protected through the use of silt fence, concrete block and rock socks (on gravel surfaces), sediment control logs/curbs embedded in the adjacent soil and stacked around the area inlet (on pervious surfaces), over-excavation around the inlet, and proprietary products providing equivalent functions.

**Inlets Located on a Slope**

For curb and gutter inlets on paved sloping streets, block and rock sock inlet protection is recommended in conjunction with curb socks in the gutter leading to the inlet. For inlets located along unpaved roads, also see the Check Dam Fact Sheet.

**Maintenance and Removal**

Inlet protection inspection frequency. Inspection and maintenance guidance includes:

- Inspect for tears that can result in sediment directly entering the inlet, as well as result in the contents of the BMP (e.g., gravel) washing into the inlet.
- Check for improper installation resulting in unfiltered flows bypassing the BMP and directly entering the inlet or bypassing to an unprotected downstream inlet. For example, silt fence that has not been properly trenched around the inlet can result in flows under the silt fence and directly into the inlet.
- Look for displaced BMPs that no longer protect the inlet. Displacement may occur following heavy rains events that wash away or erode the inlet protection. Traffic or equipment may also crush or displace the BMP.
- Monitor sediment accumulation upstream of the inlet protection.

IP-2 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**Inlet Protection (IP) SC-6**

- Remove sediment accumulation from the area upstream of the inlet protection, as needed to maintain BMP effectiveness, typically when it reaches no more than half the storage capacity of the inlet protection. For silt fence, remove sediment when it accumulates to a depth of no more than 6 inches. Remove sediment accumulation from the area upstream of the inlet protection as needed to maintain the functionality of the BMP.
- Proprietary inlet protection devices should be inspected and maintained in accordance with manufacturer specifications. If proprietary inlet protection devices are used, sediment should be removed in a timely manner to prevent devices from breaking and spilling sediment into the storm drain. Inlet protection must be removed and properly disposed of when the drainage area for the inlet has reached final stabilization.

**Inlets Located in a Sump**

When applying inlet protection in sump conditions, it is important that the inlet continue to function during larger runoff events. For each inlet, the maximum height of the protective barrier should be lower than the top of the curb opening to allow overflow into the inlet during larger storms without excessive localized flooding. If the inlet protection height is greater than the curb elevation, particularly if the filter becomes clogged with sediment, runoff will not enter the inlet and may bypass it, possibly causing localized flooding, public safety issues, and downstream erosion and damage from bypassed flows.

Area inlets located in a sump setting can be protected through the use of silt fence, concrete block and rock socks (on gravel surfaces), sediment control logs/curbs embedded in the adjacent soil and stacked around the area inlet (on pervious surfaces), over-excavation around the inlet, and proprietary products providing equivalent functions.

**Inlets Located on a Slope**

For curb and gutter inlets on paved sloping streets, block and rock sock inlet protection is recommended in conjunction with curb socks in the gutter leading to the inlet. For inlets located along unpaved roads, also see the Check Dam Fact Sheet.

**Maintenance and Removal**

Inlet protection inspection frequency. Inspection and maintenance guidance includes:

- Inspect for tears that can result in sediment directly entering the inlet, as well as result in the contents of the BMP (e.g., gravel) washing into the inlet.
- Check for improper installation resulting in unfiltered flows bypassing the BMP and directly entering the inlet or bypassing to an unprotected downstream inlet. For example, silt fence that has not been properly trenched around the inlet can result in flows under the silt fence and directly into the inlet.
- Look for displaced BMPs that no longer protect the inlet. Displacement may occur following heavy rains events that wash away or erode the inlet protection. Traffic or equipment may also crush or displace the BMP.
- Monitor sediment accumulation upstream of the inlet protection.

IP-2 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**SC-6 Inlet Protection (IP)**

**IP-1. BLOCK AND ROCK SOCK SUMP OR ON GRADE INLET PROTECTION**

**IP-2. CURB ROCK SOCKS UPSTREAM OF INLET PROTECTION**

**IP-3. ROCK SOCK SUMP/AREA INLET PROTECTION**

**IP-4. SILT FENCE FOR SUMP INLET PROTECTION**

**IP-5. OVER-EXCAVATION INLET PROTECTION**

**IP-6. STRAW BALE FOR SUMP INLET PROTECTION**

SC-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**Inlet Protection (IP) SC-6**

**IP-1. BLOCK AND ROCK SOCK SUMP OR ON GRADE INLET PROTECTION**

**IP-2. CURB ROCK SOCKS UPSTREAM OF INLET PROTECTION**

**IP-3. ROCK SOCK SUMP/AREA INLET PROTECTION**

**IP-4. SILT FENCE FOR SUMP INLET PROTECTION**

**IP-5. OVER-EXCAVATION INLET PROTECTION**

**IP-6. STRAW BALE FOR SUMP INLET PROTECTION**

SC-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**SC-6 Inlet Protection (IP)**

**IP-1. BLOCK AND ROCK SOCK SUMP OR ON GRADE INLET PROTECTION**

**IP-2. CURB ROCK SOCKS UPSTREAM OF INLET PROTECTION**

**IP-3. ROCK SOCK SUMP/AREA INLET PROTECTION**

**IP-4. SILT FENCE FOR SUMP INLET PROTECTION**

**IP-5. OVER-EXCAVATION INLET PROTECTION**

**IP-6. STRAW BALE FOR SUMP INLET PROTECTION**

SC-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**Inlet Protection (IP) SC-6**

**CIP-1. CULVERT INLET PROTECTION**

SC-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**SC-6 Inlet Protection (IP)**

**GENERAL INLET PROTECTION INSTALLATION NOTES**

- SEE PLAN VIEW FOR:
  - LOCATION OF INLET PROTECTION (E.P., P.I., P.S., P.A., P.S., P.S.)
- INLET PROTECTION SHALL BE INSTALLED PROPERLY AFTER INLET CONSTRUCTION OR FINISH IS COMPLETE (TYPICALLY WITHIN 24 HOURS). IF A RAINFALL/WINDSTORM EVENT IS FORECAST, INSTALL INLET PROTECTION PRIOR TO ONSET OF RAIN.
- ANY ADJUSTMENTS HAVE BMP DETAILS THAT VARY FROM USDC STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

**SILT FENCE MAINTENANCE NOTES**

- INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
- PROFICIENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
- WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
- SEDIMENT ACCUMULATED UPSTREAM OF INLET PROTECTION SHALL BE REMOVED AS NECESSARY TO MAINTAIN BMP EFFECTIVENESS, TYPICALLY WHEN STORAGE CAPACITY REACHES 50% OF CAPACITY, A DEPTH OF 6" WHEN SILT FENCE IS USED, OR 3" OF THE HEIGHT FOR STRAW BALES.
- INLET PROTECTION IS TO REMAIN IN PLACE UNTIL THE UPSTREAM DISTURBED AREA IS RESTORED TO ORIGINAL CONDITION. UNLESS THE LOCAL JURISDICTION APPROVES EARLIER REMOVAL OF INLET PROTECTION IN SHELTERS.
- WHEN INLET PROTECTION AT AREA INLETS IS REMOVED, THE DISTURBED AREA SHALL BE COVERED WITH TOP SOIL, SEEDS AND MULCHES, OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION.

(DETAILS ADAPTED FROM TABLE OF PAVED ROADS AND OFF OF PAVED, COLORADO, NOT AVAILABLE IN AUTOCAD)

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM USDC STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

NOTE: THE DETAILS INCLUDED WITH THIS FACT SHEET SHOW COMMONLY USED CONVENTIONAL METHODS OF INLET PROTECTION IN THE DENVER METROPOLITAN AREA. THERE ARE MANY ALTERNATIVE METHODS OF INLET PROTECTION. THE MANUFACTURER'S INSTALLATION AND MAINTENANCE INSTRUCTIONS SHOULD BE USED. THE APPROPRIATE DETAIL FROM THE MANUFACTURER'S MANUAL SHOULD BE USED. THE BMP MUST BE INSTALLED AND MAINTAINED AS SHOWN IN THE MANUFACTURER'S MANUAL.

NOTE: SOME MANUFACTURERS DISALLOW OR PREVENT THE USE OF STRAW BALES FOR INLET PROTECTION. CHECK WITH LOCAL JURISDICTION TO DETERMINE IF STRAW BALES FOR INLET PROTECTION IS ACCEPTABLE.

IP-8 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**SC-7 Sediment Basin (SB)**

**Maintenance and Removal**

Drudge sediment from the basin, as needed to maintain BMP effectiveness, typically when the design storage volume is no more than one-third full with sediment.

- Inspect the sediment basin embankments for stability and seepage.
- Inspect the inlet and outlet of the basin, repair damage, and remove debris. Remove, clean and replace the gravel around the outlet on regular basis to remove the accumulated sediment within it and keep the outlet functioning.
- Be aware that removal of a sediment basin may require dewatering and associated permit requirements.
- Do not remove a sediment basin until the upstream area has been stabilized with vegetation.

Final disposition of the sediment basin depends on whether the basin will be converted to a permanent post-construction stormwater basin or whether the basin area will be returned to grade. For basins being converted to permanent detention basins, remove accumulated sediment and recontour the basin and outlet to meet the requirements of the final design for the detention facility. If the sediment basin is not to be used as a permanent detention facility, fill the excavated area with soil and stabilize with vegetation.

SB-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**Sediment Basin (SB) SC-7**

**TABLE SB-1. SIZING INFORMATION FOR STANDARD SEDIMENT BASIN**

Basin Depth (ft)	Basin Length (ft)	Basin Area (sq ft)	Basin Volume (cu ft)
1	12.8	2.8	3.4
2	25.6	5.6	6.8
3	38.4	8.4	10.2
4	51.2	11.2	13.6
5	64.0	14.0	17.0
6	76.8	16.8	20.4
7	89.6	19.6	23.8
8	102.4	22.4	27.2
9	115.2	25.2	30.6
10	128.0	28.0	34.0
11	140.8	30.8	37.4
12	153.6	33.6	40.8
13	166.4	36.4	44.2
14	179.2	39.2	47.6
15	192.0	42.0	51.0
16	204.8	44.8	54.4
17	217.6	47.6	57.8
18	230.4	50.4	61.2
19	243.2	53.2	64.6
20	256.0	56.0	68.0
21	268.8	58.8	71.4
22	281.6	61.6	74.8
23	294.4	64.4	78.2
24	307.2	67.2	81.6
25	320.0	70.0	85.0
26	332.8	72.8	88.4
27	345.6	75.6	91.8
28	358.4	78.4	95.2
29	371.2	81.2	98.6
30	384.0	84.0	102.0
31	396.8	86.8	105.4
32	409.6	89.6	108.8
33	422.4	92.4	112.2
34	435.2	95.2	115.6
35	448.0	98.0	119.0
36	460.8	100.8	122.4
37	473.6	103.6	125.8
38	486.4	106.4	129.2
39	499.2	109.2	132.6
40	512.0	112.0	136.0
41	524.8	114.8	139.4
42	537.6	117.6	142.8
43	550.4	120.4	146.2
44	563.2	123.2	149.6
45	576.0	126.0	153.0
46	588.8	128.8	156.4
47	601.6	131.6	159.8
48	614.4	134.4	163.2
49	627.2	137.2	166.6
50	640.0	140.0	170.0

SB-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**SC-7 Sediment Basin (SB)**

**TABLE SB-1. SIZING INFORMATION FOR STANDARD SEDIMENT BASIN**

Basin Depth (ft)	Basin Length (ft)	Basin Area (sq ft)	Basin Volume (cu ft)
1	12.8	2.8	3.4
2	25.6	5.6	6.8
3	38.4	8.4	10.2
4	51.2	11.2	13.6
5	64.0	14.0	17.0
6	76.8	16.8	20.4
7	89.6	19.6	23.8
8	102.4	22.4	27.2
9	115.2	25.2	30.6
10	128.0	28.0	34.0
11	140.8	30.8	37.4
12	153.6	33.6	40.8
13	166.4	36.4	44.2
14	179.2	39.2	47.6
15	192.0	42.0	51.0
16	204.8	44.8	54.4
17	217.6	47.6	57.8
18	230.4	50.4	61.2
19	243.2	53.2	64.6
20	256.0	56.0	68.0
21	268.8	58.8	71.4
22	281.6	61.6	74.8
23	294.4	64.4	78.2
24	307.2	67.2	81.6
25	320.0	70.0	85.0
26	332.8	72.8	88.4
27	345.6	75.6	91.8
28	358.4	78.4	95.2
29	371.2	81.2	98.6
30	384.0	84.0	102.0
31	396.8	86.8	105.4
32	409.6	89.6	108.8
33	422.4	92.4	112.2
34	435.2	95.2	115.6
35	448.0	98.0	119.0
36	460.8	100.8	122.4
37	473.6	103.6	125.8
38	486.4	106.4	129.2
39	499.2	109.2	132.6
40	512.0	112.0	136.0
41	524.8	114.8	139.4
42	537.6	117.6	142.8
43	550.4	120.4	146.2
44	563.2	123.2	149.6
45	576.0	126.0	153.0
46	588.8	128.8	156.4
47	601.6	131.6	159.8
48	614.4	134.4	163.2
49	627.2	137.2	166.6
50	640.0	140.0	170.0

SB-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**Sediment Basin (SB) SC-7**

**SEDIMENT BASIN MAINTENANCE NOTES**

- INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
- PROFICIENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
- WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
- SEDIMENT ACCUMULATED UPSTREAM OF INLET PROTECTION SHALL BE REMOVED AS NECESSARY TO MAINTAIN BMP EFFECTIVENESS, TYPICALLY WHEN STORAGE CAPACITY REACHES 50% OF CAPACITY (E.G., 3 FEET DEPTH FOR STRAW BALES). THE LOCAL JURISDICTION APPROVES EARLIER REMOVAL OF INLET PROTECTION IN SHELTERS.
- WHEN INLET PROTECTION AT AREA INLETS IS REMOVED, THE DISTURBED AREA SHALL BE COVERED WITH TOP SOIL, SEEDS AND MULCHES, OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION.

(DETAILS ADAPTED FROM DENVER COUNTY, COLORADO, NOT AVAILABLE IN AUTOCAD)

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM USDC STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

SB-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 August 2013

**Vehicle Tracking Control (VTC) SM-4**

**VTC-1. AGGREGATE VEHICLE TRACKING CONTROL**

SM-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**SM-4 Vehicle Tracking Control (VTC)**

**VTC-2. AGGREGATE VEHICLE TRACKING CONTROL WITH WASH RACK**

**VTC-3. VEHICLE TRACKING CONTROL W/ CONSTRUCTION MAT OR TURF REINFORCEMENT MAT (TRM)**

VTC-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**Vehicle Tracking Control (VTC) SM-4**

**VTC-2. AGGREGATE VEHICLE TRACKING CONTROL WITH WASH RACK**

**VTC-3. VEHICLE TRACKING CONTROL W/ CONSTRUCTION MAT OR TURF REINFORCEMENT MAT (TRM)**

VTC-5 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**SM-4 Vehicle Tracking Control (VTC)**

**STABILIZED CONSTRUCTION ENTRANCE/EXIT INSTALLATION NOTES**

- SEE PLAN VIEW FOR:
  - LOCATION OF STABILIZED CONSTRUCTION ENTRANCE/EXIT (WITH/WITHOUT WASH MATS, CONSTRUCTION MAT OR TRM)
- CONSTRUCTION MAT OR TRM STABILIZED CONSTRUCTION ENTRANCES ARE ONLY TO BE USED ON SOFT UNPAVED SURFACES (SPECIALLY WHEN FROM A HOLE TO A HOLE) WHERE THERE WILL BE LIMITED VEHICLE ACCESS.
- A STABILIZED CONSTRUCTION ENTRANCE/EXIT SHALL BE LOCATED AT ALL ACCESS POINTS WHERE VEHICLES ACCESS THE CONSTRUCTION SITE FROM FRESH TOP-OF-WAYS.
- STABILIZED CONSTRUCTION ENTRANCE/EXIT SHALL BE INSTALLED FROM TO ANY LAND DISBURSING ACTIVITIES.
- A NON-WOVEN GEOTEXTILE FABRIC SHALL BE PLACED UNDER THE STABILIZED CONSTRUCTION ENTRANCE/EXIT TO THE PLACEMENT OF ROCK.
- UNLESS OTHERWISE SPECIFIED BY LOCAL JURISDICTION, ROCK SHALL CONSIST OF DOT SPEC. #57, #59 OR #3 CORNER AGGREGATE OR #1 (MINUS) ROCK.

**STABILIZED CONSTRUCTION ENTRANCE/EXIT MAINTENANCE NOTES**

- INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.
- PROFICIENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
- WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.
- ROCK SHALL BE REPLACED OR REGRADED AS NECESSARY TO THE STABILIZED CONSTRUCTION ENTRANCE/EXIT TO MAINTAIN A CONSISTENT DEPTH.
- SEDIMENT TRAPPED ON TOP OF PAVED ROADS IS TO BE REMOVED THROUGHOUT THE DAY AND AT THE END OF THE DAY BY SWEEPING OR BLOWING. SEDIMENT MAY NOT BE REMOVED.

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM USDC STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

(DETAILS ADAPTED FROM DENVER COUNTY, COLORADO, NOT AVAILABLE IN AUTOCAD)

VTC-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**Stabilized Staging Area (SSA) SM-6**

**SSA-1. STABILIZED STAGING AREA**

SM-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**SM-6 Stabilized Staging Area (SSA)**

**STABILIZED STAGING AREA MAINTENANCE NOTES**

- STABILIZED STAGING AREA SHALL BE ENLARGED IF NECESSARY TO CONTAIN PARKING, STORAGE, AND UNPAVED/UNPAVED OPERATIONS.
- THE STABILIZED STAGING AREA SHALL BE REMOVED AT THE END OF CONSTRUCTION. THE CONULAR MATTING SHALL BE REUSED OR, IF APPROVED BY THE LOCAL JURISDICTION, USED ON SITE, AND THE AREA COVERED WITH TOPSOIL, SEEDS AND MULCHES OR OTHERWISE STABILIZED IN A MANNER APPROVED BY LOCAL JURISDICTION.

NOTE: MANY JURISDICTIONS PROHIBIT THE USE OF RECYCLED CONCRETE AS GRANULAR MATERIAL FOR STABILIZED STAGING AREAS. CONSULT WITH LOCAL JURISDICTION FOR RE-USE OF RECYCLED CONCRETE WHEN RE-USE IS PROHIBITED BY LOCAL JURISDICTION.

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM USDC STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

(DETAILS ADAPTED FROM DENVER COUNTY, COLORADO, NOT AVAILABLE IN AUTOCAD)

SM-6 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**Vehicle Tracking Control (VTC) SM-4**

**VTC-1. AGGREGATE VEHICLE TRACKING CONTROL**

SM-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 November 2010

**REFERENCE DRAWINGS**

X-TITLE-CD  
 X-888-FR-SITE  
 FEMA-XS  
 X-888-006-EX-MAP-1  
 164022-01 Hay Creek Road BNSW  
 X-888-ALTA-SURVEY  
 Hay Creek BFEs

No.	DATE	DESCRIPTION
		REVISIONS

**COMPUTER FILE MANAGEMENT**

FILE NAME: S:\22.886.076 Hay Creek-Forest Manor-O'Leary Properties\500 CADD\504 Plan Sets\Construction Plans\GEC Plan\ECN01.dwg  
 CTB FILE: Matrix.ctb  
 PLOT DATE: 5/29/2024 9:35 AM  
 THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.

**SHEET KEY**

**BENCHMARK**

PROJECT ELEVATIONS ARE NAVD 88 ELEVATIONS BASED ON AN OPUS DERIVED ELEVATION ON CONTROL POINT 10, A NO. 5 REBAR HAVING AN ELEVATION OF 5769.92.

**BASIS OF BEARING**

THE SOUTH LINE OF THE NORTHWEST QUARTER OF SECTION 22, TOWNSHIP 15 SOUTH, RANGE 65 WEST OF THE 6TH PRINCIPAL MERIDIAN, COUNTY OF EL PASO, STATE OF COLORADO, BEING MONUMENTED ON THE EASTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "NOLTE PL25955 C1/4 S22 T16S, R65W 1999," AND THE WESTERLY END BY A 2-1/2" ALUMINUM CAP STAMPED "SSS PLS 16154 1/4 S21 S22 T16S, R65W 2000," BEING ASSUMED TO BEAR S89°54'42"W, A DISTANCE OF 2,627.78 FEET.

PREPARED BY:  
  
 Excellence by Design

**SEAL**

**HAY CREEK VALLEY**  
 EL PASO COUNTY, COLORADO  
 FINAL GRADING & EROSION CONTROL PLANS

**DETAILS**

DESIGNED BY:	SCALE:	DATE ISSUED:	
CWV	HORIZ. N/A	MAY 2024	DRAWING No.
DRAWN BY: <td>VERT. N/A</td> <td>11 OF 12</td> <td>ECN02</td>	VERT. N/A	11 OF 12	ECN02
CHECKED BY: <td>JAO</td> <td></td> <td></td>	JAO		

FOR AND ON BEHALF OF  
 MATRIX DESIGN GROUP, INC.  
 PROJECT No. 22.886.076

PCD FILE #: SF2324

PCD FILE #: SF2324



Know what's below. Call before you dig.

Temporary and Permanent Seeding (TS/PS) EC-2

Description

Temporary seeding can be used to stabilize disturbed areas that will be inactive for an extended period. Permanent seeding should be used to stabilize areas at final grade that will not be otherwise stabilized.



Appropriate Uses

When the soil surface is disturbed and will remain inactive for an extended period (typically determined by local government requirements), proactive stabilization measures, including planting a temporary seed mix, should be implemented.

The USDCM Volume 2 Revegetation Chapter contains suggested annual grains and native seed mixes to use for temporary seeding.

Design and Installation

Effective seeding requires proper seedbed preparation, selecting an appropriate seed mixture, using appropriate seeding equipment to ensure proper coverage and density, and protecting seeded areas with mulch or fabric until plants are established.

The USDCM Volume 2 Revegetation Chapter contains detailed seed mixes, soil preparation practices, and seeding and mulching recommendations that should be referenced to supplement this sheet.

Drill seeding is the preferred seeding method. Hydroseeding is not recommended except in areas where steep slopes prevent use of drill seeding equipment, and even in those instances it is preferable to hand seed and mulch.

Temporary and Permanent Seeding

Table with 2 columns: Function, Yes/No. Rows: Erosion Control, Sediment Control, Site/Material Management.

January 2021 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 TS/PS-1

EC-4 Mulching (MU)

- Clean, weed-free and seed-free cereal grain straw should be applied evenly at a rate of 2 tons per acre and must be tacked or fastened by a method suitable for the condition of the site. Straw mulch must be anchored (and not merely placed) on the surface.

Maintenance and Removal

After mulching, the bare ground surface should not be more than 10 percent exposed. Reapply mulch, as needed, to cover bare areas.

MU-2 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 June 2012

EC-2 Temporary and Permanent Seeding (TS/PS)

have low nutrient value, little organic matter content, few soil microorganisms, rooting restrictions, and conditions less conducive to infiltration of precipitation.

Topsoil should be salvaged during grading operations for use and spread on areas to be revegetated later. Topsoil should be viewed as an important resource to be utilized for vegetation establishment.

Where topsoil is not available, subsoils should be amended to provide an appropriate plant-growth medium. Organic matter, such as well-digested compost, can be added to improve soil characteristics.

If the disturbed ground surface is compacted, rip or retille the upper 12 inches of the surface prior to placing topsoil. If adding compost to the existing soil surface, rontilling is necessary.

Prior to seeding, the soil surface should be rough and the seedbed should be firm, but not too loose and conducive to plant growth.

Refer to MHRD's Topsoil Management Guidance for detailed information on topsoil assessment, design, and construction.

Temporary Vegetation

To provide temporary vegetative cover on disturbed areas which will not be paved, built upon, or fully landscaped or worked for an extended period (typically 30 days or more), plant an annual grass appropriate for the time of planting and mulch the planted area.

To provide vegetative cover on disturbed areas that have reached final grade, a perennial grass mix should be established. Permanent seedings should be performed promptly (typically within 14 days) after reaching final grade.

To provide vegetative cover on disturbed areas that have reached final grade, a perennial grass mix should be established. Permanent seedings should be performed promptly (typically within 14 days) after reaching final grade.

TS/PS-2 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 January 2021

Temporary and Permanent Seeding (TS/PS) EC-2

recommendations when specific design guidance for a particular site is not available.

If desired for wildlife habitat or landscape diversity, shrubs such as rubber rabbitbrush (Chrysothamnus nauseosus), foraging salibush (Artemisia canescens) and shunkbrush sumac (Rhus trilobata) could be added to the upland seed mixes at 0.25, 0.5 and 1 pound PLS/acre, respectively.

Timing of seeding is an important aspect of the revegetation process. For upland and riparian areas on the Colorado Front Range, the suitable timing for seeding is from October through May.

Seeding dates for the highest success probability of perennial species along the Front Range are generally in the spring from April through early May and in the fall after the first of September until the ground freezes.

Successful seeding of annual grass resulting in adequate plant growth will usually produce enough dead-plant residue to provide protection from wind and water erosion for an additional year.

Hydraulic seeding may be substituted for drilling only where slopes are steeper than 3:1 or where access limitations exist.

Hydraulic seeding is used, hydraulic mulching should be applied as a separate operation, when practical, to prevent the seeds from being encapsulated in the mulch.

Temporary Vegetation

To provide temporary vegetative cover on disturbed areas which will not be paved, built upon, or fully landscaped or worked for an extended period (typically 30 days or more), plant an annual grass appropriate for the time of planting and mulch the planted area.

To provide vegetative cover on disturbed areas that have reached final grade, a perennial grass mix should be established. Permanent seedings should be performed promptly (typically within 14 days) after reaching final grade.

To provide vegetative cover on disturbed areas that have reached final grade, a perennial grass mix should be established. Permanent seedings should be performed promptly (typically within 14 days) after reaching final grade.

January 2021 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 TS/PS-3

EC-2 Temporary and Permanent Seeding (TS/PS)

Table TS/PS-1. Minimum Drill Seeding Rates for Various Temporary Annual Grasses

Table with 4 columns: Species (Common name), Growth Season, Pounds of Pure Live Seed (PLS)/acre, Planting Depth (inches). Rows 1-9: Oats, Spring wheat, Spring barley, Annual ryegrass, Millet, Winter wheat, Winter barley, Winter rye, Trifolium.

\* Successful seeding of annual grass resulting in adequate plant growth will usually produce enough dead-plant residue to provide protection from wind and water erosion for an additional year.

Hydraulic seeding may be substituted for drilling only where slopes are steeper than 3:1 or where access limitations exist.

Hydraulic seeding is used, hydraulic mulching should be applied as a separate operation, when practical, to prevent the seeds from being encapsulated in the mulch.

See Table TS/PS-2 for seeding dates. Irrigation, if consistently applied, may extend the use of cool season species during the summer months.

Seeding rates should be doubled if seed is broadcast, or increased by 50 percent if done using a Bifloris Drill or by hydraulic seeding.

TS/PS-4 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 January 2021

Temporary and Permanent Seeding (TS/PS) EC-2

Table TS/PS-2. Seeding Dates for Annual and Perennial Grasses

Table with 5 columns: Seeding Dates, Annual Grasses (Warm/Cool), Perennial Grasses (Warm/Cool). Rows: January 1-March 15, March 16-April 30, May 1-May 15, May 16-June 30, July 1-July 15, July 16-August 31, September 1-September 30, October 1-December 31.

Mulch

Cover seeded areas with mulch or an appropriate rolled erosion control product to promote establishment of vegetation. Anchor mulch by crimping, netting or use of a non-toxic tackifier.

Maintenance and Removal

Monitor and observe seeded areas to identify areas of poor growth or areas that fail to germinate. Re seed and mulch these areas, as needed.

If a temporary annual seed was planted, the area should be reseeded with the desired perennial mix when there will be no further work in the area. To minimize competition between annual and perennial species, the annual mix needs time to mature and the before seeding the perennial mix.

An area that has been permanently seeded should have a good stand of vegetation within one growing season if irrigated and within three growing seasons without irrigation in Colorado. Re seed portions of the site that fail to germinate or remain bare after the first growing season.

Seeded areas may require irrigation, particularly during extended dry periods. Targeted weed control may also be necessary.


Protect seeded areas from construction equipment and vehicle access.

January 2021 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 TS/PS-5

Mulching (MU) EC-4

Description

Mulching consists of evenly applying straw, hay, shredded wood mulch, rock, bark or compost to disturbed soils and securing the mulch by crimping, tackifiers, netting or other measures.

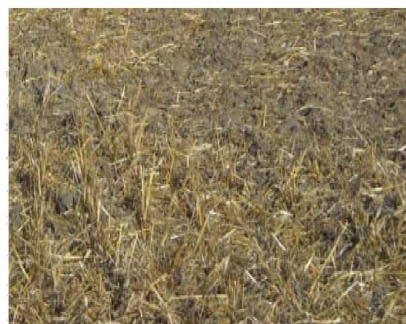

Mulch can be applied either using standard mechanical dry application methods or using hydro mulching equipment that hydraulically applies a slurry of water, wood fiber mulch, and often a tackifier.

Appropriate Uses

Use mulch in conjunction with seeding to help protect the seedbed and stabilize the soil. Mulch can also be used as a temporary cover on low to mild slopes to help temporarily stabilize disturbed areas where growing season constraints prevent effective reseeding.

Standard dry mulching is encouraged in most jurisdictions; however, hydro mulching may not be allowed in certain jurisdictions or may not be allowed near waterways.

Do not apply mulch during windy conditions.

Design and Installation

Prior to mulching, surface-roughen areas by rolling with a crimping or punching type roller or by track walking. Track walking should only be used where other methods are impractical because track walking with heavy equipment typically compacts the soil.

A variety of mulches can be used effectively at construction sites. Consider the following:

Table with 2 columns: Functions, Mulch. Rows: Erosion Control, Sediment Control, Site/Material Management.

June 2012 Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 MU-1

REFERENCE DRAWINGS, SHEET KEY, BENCHMARK, BASIS OF BEARING, PREPARED BY: Matrix, HAY CREEK VALLEY EL PASO COUNTY, COLORADO FINAL GRADING & EROSION CONTROL PLANS DETAILS, FILE NAME, PLOT DATE, DESIGNED BY, SCALE, DATE ISSUED, DRAWING No.