



Entech Engineering
505 Elkon Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 26 **Sample #:** 4340 **Placement Date:** 06/12/2025 **Technician:** Jayce Bamhart **Weather Conditions:** Sunny **Air Temp (°F):** 81
Contractor: Trax Construction **Supplier:** Holcim **Mix Design:** T34592110 **Specified Strength (psi):** 4500
Placement Location: Sidewalk **Location Details:** At the northwest corner of Golden Buffs Drive and Lancelleaf Drive. **Lat/Long:** 38.7280086 / -104.6579441

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
26	140 71399463	7.50	Slump: 3 1/2 Spec: 3 - 5	Result: 5.5 Spec.: 5 - 8	138.4	70	81

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
26 / 14706	7	06/19/2025	3780	Type 2

07/07/2025
Reviewed by: Robert Jaquet, PE



Entech Engineering
505 Elkton Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 25 **Sample #:** 4331 **Placement Date:** 06/11/2025 **Technician:** Michael Cryser **Weather Conditions:** Sunny **Air Temp (°F):** 77
Contractor: Trax Construction **Supplier:** Holcim **Mix Design:** T34592110 **Specified Strength (psi):** 4500
Placement Location: Curb & Gutter **Location Details:** South west corner of Golden Bluffs and Lanceleaf Dr. **Lat/Long:** 38.7284619 / -104.6583314

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
25	349 71399404	4.75	Slump: 3 1/2 Spec: 3 - 5	Result: 7.5 Spec.: 5 - 8	138.0	82	77

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
25 / 15277	7	06/18/2025	2850	Type 5
25 / 15278	28	07/09/2025	3880	Type 1

Average Strength (psi): 7 Day - 2850 psi, 28 Day - 3880 psi

56 Day Breaks will be provided when available.

07/10/2025
Reviewed by: Dylan Cassmann, PE



Entech Engineering
505 Elkton Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 24 Sample #: 4318 Placement Date: 06/10/2025 Technician: Ross Lewis Weather Conditions: Sunny Air Temp (°F): 75

Contractor: Trax Construction Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Sidewalk Location Details: From the northwest corner of Golden Buffs Drive and Ground Cherry Drive, 5 feet north and 10 feet west. Lat/Long: 38.7294575 / -104.8573167

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
24	29 86760490	11.25	Slump: 3 Spec: 3 - 5	Result: 5 Spec.: 5 - 8	140.8	78	75

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
24 / 14646	7	06/17/2025	4090	Type 2
24 / 14647	28	07/08/2025	5100	Type 2
24 / 14648	28	07/08/2025	5160	Type 2
24 / 14649	28	07/08/2025	4900	Type 3

Average Strength (psi): 7 Day - 4090 psi, 28 Day - 5050 psi

07/10/2025

Reviewed by: Dylan Gassmann, PE



Entech Engineering
505 Eklon Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 23 Sample #: 4304 Placement Date: 06/09/2025 Technician: Sam Johnson Weather Conditions: Sunny Air Temp (°F): 68

Contractor: Trax Construction Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Sidewalk Location Details: From the southeast corner of Dwarf Clover Court and Golden Buffs Drive. Lat/Long: 38.727958 / -104.6585859

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
23	25 71399267	7.75	Slump: 4 1/2 Spec: 3 - 5	Result: 5 Spec.: 5 - 8	140.3	69	68

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
23 / 14616	7	06/16/2025	3820	Type 3
23 / 14617	28	07/07/2025	4650	Type 3
23 / 14618	28	07/07/2025	4550	Type 3
23 / 14619	28	07/07/2025	4490	Type 2

Average Strength (psi): 7 Day - 3820 psi, 28 Day - 4560 psi

07/07/2025
Reviewed by: Dylan Gassmann, PE

Set #: 22 **Sample #:** 4275 **Placement Date:** 06/02/2025 **Technician:** Michael Cryser **Weather Conditions:** Sunny **Air Temp (°F):** 74
Contractor: Trax Construction **Supplier:** Holcim **Mix Design:** T34592110 **Specified Strength (psi):** 4500
Placement Location: Sidewalk **Location Details:** At the northeast corner of Golden Buffs Drive and Lanceleaf Drive. **Lat/Long:** 38.7283482 / -104.6579645

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
22	29 86760380	7.50	Slump: 5 Spec: 3 - 5	Result: 5.2 Spec: 5 - 8	142.4	75	74

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
22 / 14462	7	06/09/2025	4820	Type 3
22 / 14463	28	06/30/2025	5750	Type 3
22 / 14464	28	06/30/2025	5630	Type 3
22 / 14465	28	06/30/2025	5280	Type 2

Average Strength (psi): 7 Day - 4820 psi, 28 Day - 5550 psi

07/07/2025
Reviewed by: Robert Jaquet, PE

Set #: 21 Sample #: 4207 Placement Date: 05/22/2025 Technician: Michael Crytser Weather Conditions: Sunny Air Temp (°F): 58

Contractor: Trax Construction Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Sidewalk Location Details: At the northeast corner of Cherry Trail and Golden Buffs Drive. Lat/Long: 38.7293405 / -104.6573228

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
21	54 71398742	10.00	Slump: 5 Spec: 3 - 5	Result: 7 Spec.: 5 - 8	140.8	70	58

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
21 / 14289	7	05/29/2025	3750	Type 2
21 / 14290	28	06/19/2025	4360	Type 2

Average Strength (psi): 7 Day - 3750 psi, 28 Day - 4360 psi

56 Day Breaks will be provided when available.

06/23/2025
Reviewed by: Dylan Gassmann, PE



ENTECH
ENGINEERING, INC.

Entech Engineering
505 Elkon Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 20 **Sample #:** 4186 **Placement Date:** 05/21/2025 **Technician:** Herbert Hafentrichter **Weather Conditions:** Sunny **Air Temp (°F):** 52

Contractor: Trax **Supplier:** Hobas **Mix Design:** T34882110 **Specified Strength (psi):** 4500

Placement Location: Sidewalk **Location Details:** From the northwest corner of Golden Buffs Drive and Pennycress Drive, 40 feet west **Lat/Long:** 38.72674878 / -104.65906466

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
20	26	10.00	Slump: 3 Spec: 2 - 4	Result: 5 Spec: 5 - 8	142.4	77	52

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
20 / 14285	7	05/28/2025	3940	Type 3
20 / 14286	28	06/18/2025	4890	Type 2
20 / 14287	28	06/18/2025	4900	Type 2
20 / 14288	28	06/18/2025	4760	Type 3

Average Strength (psi): 7 Day - 3940 psi, 28 Day - 4850 psi

06/23/2025
Reviewed by: Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 18 **Sample #:** 4156 **Placement Date:** 05/19/2025 **Technician:** Jayce Barnhart **Weather Conditions:** Partly Cloudy **Air Temp (°F):** 58
Contractor: Trax Construction **Supplier:** Holcim **Mix Design:** T34592110 **Specified Strength (psi):** 4500
Placement Location: Curb & Gutter **Location Details:** Directly in front of 9173 Lanceleaf Drive. **Lat/Long:** 38.7286949 / -104.6568821

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
18	388 86760285	6.25	Slump: 3 Spec: 3 - 5	Result: 5.5 Spec.: 5 - 8	142.4	69	58

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
18 / 14193	7	05/26/2025	5010	Type 2
18 / 14194	28	06/16/2025	6000	Type 3
18 / 14195	28	06/16/2025	5870	Type 3
18 / 14196	28	06/16/2025	5920	Type 3

Average Strength (psi): 7 Day - 5010 psi, 28 Day - 5930 psi

06/23/2025
Reviewed by: Dylan Cassmann, PE



Entech Engineering
505 Elton Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F-12
The Glenn at Widefield F-12
Fountain, CO

Set #: 17

Sample #: 4153

Placement Date: 05/17/2025

Technician: Andrew Oswald

Weather Conditions: Sunny

Air Temp (°F): 49

Contractor: Trax Construction

Supplier: Holcim

Mix Design: T34682110

Specified Strength (psi): 4500

Placement Location: Sidewalk

Location Details: From the northwest corner of Golden Buiffs Drive and Lanceleaf Drive, 165 feet north.

Lat/Long: 38.7284956 / -104.6579543

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
17	19 86632866	10.00	Slump: 1 Spec: - 2	Result: 5.8 Spec: 5 - 8	140.4	65	49

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
17 / 14172	7	05/24/2025	4130	Type 2
17 / 14173	28	06/14/2025	4780	Type 3
17 / 14174	28	06/14/2025	4930	Type 3
17 / 14175	28	06/14/2025	5000	Type 2

Average Strength (psi): 7 Day - 4130 psi, 28 Day - 4900 psi

06/23/2025
Reviewed by: Dylan Gassmann, PE



ENTECH
ENGINEERING, INC.

Entech Engineering
505 Elton Dr.
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glenn at Widefield F12
The Glenn at Widefield F12
Fountain, CO

Set #: 16 **Sample #:** 4127 **Placement Date:** 05/14/2025 **Technician:** Herbert Hafenrichter **Weather Conditions:** Sunny **Air Temp (°F):** 76
Contractor: Trax Construction **Supplier:** Hobas **Mix Design:** T34682110 **Specified Strength (psi):** 4500
Placement Location: Sidewalk **Location Details:** From the southwest corner of Golden Buffs Drive and Pennydress Drive, 5 feet west. **Lat/Long:** 38.72888724 / -104.65590091

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
16	35 86760197	12.00	Slump: 1 Spec: 1/2 - 2 1/2	Result: 6 Spec.: 5 - 8	142.0	71	76

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
16 / 14518	7	05/21/2025	4140	Type 5
16 / 14519	28	06/11/2025	5310	Type 2
16 / 14520	28	06/11/2025	5410	Type 3
16 / 14521	28	06/11/2025	5170	Type 3

Average Strength (psi): 7 Day - 4140 psi, 28 Day - 5300 psi

06/18/2025
Reviewed by: Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 15 Sample #: 1509 Placement Date: 06/20/2024 Technician: Jayce Barnhart Weather Conditions: Partly Cloudy Air Temp (°F): 69

Contractor: Pyramid Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Crossspan Location Details: Crossspan across from Lot 74 Lat/Long: 38.7288476 / -104.657936

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
15	353 86755215	9.75	Slump: 4 Spec: 3 - 5	Result: 5 Spec.: 5 - 8	141.6	80	69

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
15 / 5528	7	06/27/2024	4380		Type 3
15 / 5529	28	07/18/2024	4860	OP	Type 3
15 / 5530	28	07/18/2024	5270	OP	Type 2
15 / 5531	28	07/18/2024	5050	OP	Type 3

Average Strength (psi): 7 Day - 4380 psi, 28 Day - 5060 psi

08/02/2024
Reviewed by: Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 14 Sample #: 1495 Placement Date: 06/19/2024 Technician: Ross Lewis Weather Conditions: Cloudy / Rain Air Temp (°F): 52

Contractor: Trax Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Curb & Gutter Location Details: SW corner of Ground Cherry and Golden Buffs Lat/Long: 38.7295553 / -104.6571503

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
14	28 86738517	9.00	Slump: 4 1/2 Spec: 3 - 5	Result: 7 Spec.: 5 - 8	139.8	80	52

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Fracture Pattern
14 / 5479	7	06/26/2024	3620	Type 2
14 / 5480	28	07/17/2024	3920	Type 5
14 / 5482	56	08/14/2024	4340	Type 6
14 / 5481	90	09/17/2024	5200	Type 3

Average Strength (psi): 7 Day - 3620 psi, 28 Day - 3920 psi, 56 Day - 4340 psi, 90 Day - 5200 psi

10/07/2024
Reviewed by: Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 13 Sample #: 1477 Placement Date: 06/18/2024 Technician: Ross Lewis Weather Conditions: Partly Cloudy Air Temp (°F): 71

Contractor: Trax Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Crossspan Location Details: 25' W off NE corner of intersection at Golden Buffs and Lanceleaf Lat/Long: 38.7281056 / -104.6580086


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
13	384 86755186	10.25	Slump: 4 Spec: 2 - 6	Result: 6 Spec.: 5 - 8	0.0	83	71

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
13 / 5332	7	06/25/2024	4050		Type 3
13 / 5333	28	07/16/2024	5690	CP	Type 3
13 / 5334	28	07/16/2024	5420	CP	Type 3
13 / 5335	28	07/16/2024	4960	CP	Type 2

Average Strength (psi): 7 Day - 4050 psi, 28 Day - 5360 psi

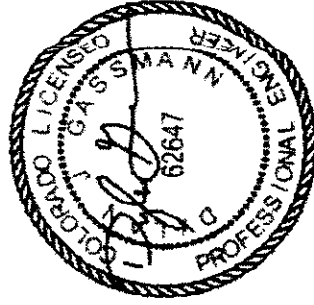

07/16/2024

Digitally Signed by Dylan Gassmann, PE



Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO


Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Placement Location: Curb & Gutter

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
12	26 86755172	8.00	Slump: 3 Spec: 3 - 5	Result: 5.7 Spec.: 5 - 8	141.6	85	85

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
12 / 5242	7	06/24/2024	4480		Type 3
12 / 5243	28	07/15/2024	4690	CP	Type 2
12 / 5244	28	07/15/2024	4790	CP	Type 2
12 / 5245	28	07/15/2024	4650	CP	Type 2

Average Strength (psi): 7 Day - 4480 psi, 28 Day - 4710 psi

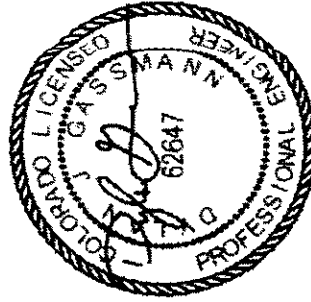

07/16/2024
Digitally Signed by Dylan Gassmann, PE

Concrete Test

**ENTECH**
ENGINEERING, INC.

Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 11 **Sample #:** 1402 **Placement Date:** 06/12/2024 **Technician:** Matt Spring

Contractor: Trax **Supplier:** Holcim **Mix Design:** T34592110

Weather Conditions: Sunny **Air Temp (°F):** 87

Placement Location: Curb & Gutter **Specified Strength (psi):** 4500

Location Details: 5' S and 2' E off SW corner of Golden Buffs and Dwarf Clover **Lat/Long:** 38.7278489 / -104.6598064


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
11	353 86755109	7.00	Slump: 2 Spec: 2 - 4	Result: 5 Spec.: 5 - 8	142.0	88	87

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
11 / 5063	7	06/19/2024	4570		Type 2
11 / 5064	28	07/10/2024	5530	CP	Type 2
11 / 5065	28	07/10/2024	5280	CP	Type 2
11 / 5066	28	07/10/2024	5730	CP	Type 2

Average Strength (psi): 7 Day - 4570 psi, 28 Day - 5510 psi

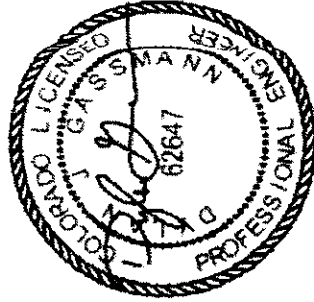

07/16/2024
Digitally Signed by Dylan Gassmann, PE



Entech Engineering
505 Elton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 10 Sample #: 1394 Placement Date: 06/11/2024 Technician: Herbert Hafenrichter Weather Conditions: Sunny Air Temp (°F): 78

Contractor: Trax Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4880

Placement Location: Curb & Gutter Location Details: Southern most drain inlet on Dwarf Clover LatLong: 38.7267882 / -104.6587523


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
10	353 86755085	5.75	Slump: 2 1/2 Spec: 2 - 4	Result: 5.5 Spec: 4.5 - 7.5	142.8	75	78

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
10 / 5030	7	06/18/2024	4170		Type 2
10 / 5031	28	07/09/2024	4930	OP	Type 3
10 / 5032	28	07/09/2024	4590	OP	Type 3
10 / 5033	28	07/09/2024	5010	OP	Type 3

Average Strength (psi): 7 Day - 4170 psi, 28 Day - 4840 psi

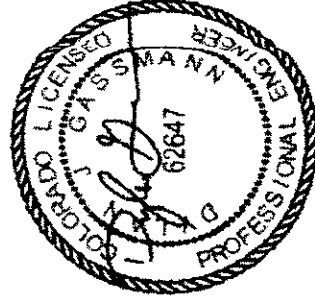

07/16/2024
Digitally Signed by Dylan Gassmann, PE

Set #: 9 **Sample #:** 1374 **Placement Date:** 06/10/2024 **Technician:** Michael Crytser **Weather Conditions:** Cloudy **Air Temp (°F):** 63

Contractor: Trax **Supplier:** Holcim **Mix Design:** T34592110 **Specified Strength (psi):** 4500

Placement Location: Curb & Gutter **Location Details:** In cul-de-sac at GPS coordinates, east bound lane **Lat/Long:** 38.727367 / -104.658602


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
9	70 86755060	6.50	Slump: 4 1/2 Spec: 3 - 5	Result: 6.2 Spec.: 5 - 8	140.1	80	63

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
9 / 4981	7	06/17/2024	4060		Type 3
9 / 4982	28	07/08/2024	4590	CP	Type 2
9 / 4983	28	07/08/2024	4840	CP	Type 3
9 / 4984	28	07/08/2024	4910	CP	Type 3

Average Strength (psi): 7 Day - 4070 psi, 28 Day - 4780 psi

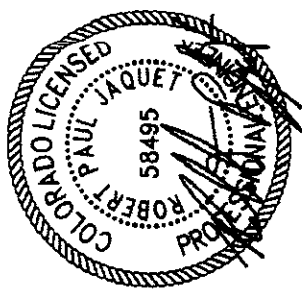

07/09/2024
Digitally Signed by Robert Jaquet, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 8 Sample #: 1358 Placement Date: 06/07/2024 Technician: Ben Westhues Weather Conditions: Sunny / Partly Cloudy Air Temp (°F): 85

Contractor: Trax Supplier: Holcim Mix Design: T34592110 Specified Strength (psi): 4500

Placement Location: Curb & Gutter Location Details: Dwarf Clover Court, 75' South of Golden Buffs Dr. Lat/Long: 38.7266689 / -104.6592405


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
8	77 86755027	8.00	Slump: 4 Spec: 3 - 5	Result: 6 Spec: 5 - 8	140.8	81	85

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
8 / 5380	7	06/14/2024	4630		Type 3
8 / 5381	28	07/05/2024	5160	CP	Type 2
8 / 5382	28	07/05/2024	4750	CP	Type 3
8 / 5383	28	07/05/2024	4660	CP	Type 2

Average Strength (psi): 7 Day - 4630 psi, 28 Day - 4860 psi

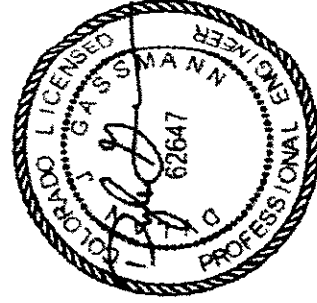

07/08/2024

Digitally Signed by Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 7 Sample #: 1337

Placement Date: 06/06/2024

Technician: Jayce Barnhart

Weather Conditions: Sunny Air Temp (°F): 81

Contractor: Trax

Supplier: Holcim

Mix Design: T34592110

Specified Strength (psi): 4500

Placement Location: Curb & Gutter

Location Details: Crossspan on Dwarf Clover Court

Lat/Long: 38.7284406 / -104.6582066


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
7	8659 86754987	9.25	Slump: 3 1/2 Spec: 3 - 5	Result: 6 Spec: 5 - 8	141.8	84	81

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
7 / 4833	7	06/13/2024	4390		Type 3
7 / 4834	28	07/04/2024	6080	CP	Type 3
7 / 4835	28	07/04/2024	5650	CP	Type 3
7 / 4836	28	07/04/2024	5980	CP	Type 3

Average Strength (psi): 7 Day - 4390 psi, 28 Day - 5900 psi

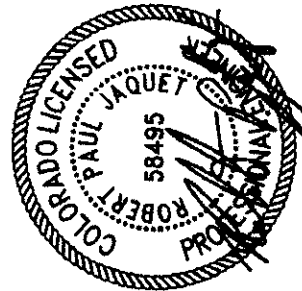

07/09/2024

Digitally Signed by Robert Jaquet, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 6 Sample #: 1320 Placement Date: 06/05/2024 Technician: Ben Westhues

Weather Conditions: Sunny Air Temp (°F): 79

Contractor: Trax

Supplier: Holcim

Mix Design: T34592110

Specified Strength (psi): 4000
4500

Placement Location: Curb & Gutter

Location Details: Lot 86, north side of Lanceleaf Dr. & 35' west of
Pennycress Dr.

Lat/Long: 38.72895 / -104.65606


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
6	65 86754978	7.00	Slump: 3 Spec: 3 - 5	Result: 6 Spec.: 5 - 8	141.6	80	79

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
6 / 5936	7	06/12/2024	3880		Type 2
6 / 5937	28	07/03/2024	5170	OP	Type 3
6 / 5938	28	07/03/2024	5320	OP	Type 3
6 / 5939	28	07/03/2024	5400	OP	Type 3

Average Strength (psi): 7 Day - 3880 psi, 27 Day - 5300 psi

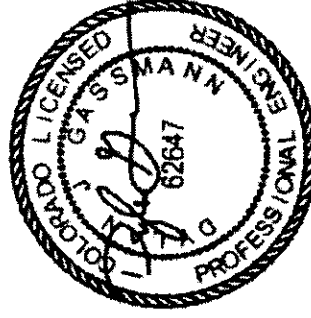

07/08/2024

Digitally Signed by Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 5 Sample #: 1319

Placement Date: 06/04/2024

Technician: Ben Westhues

Weather Conditions: Sunny Air Temp (°F): 76

Contractor: Trax

Supplier: Holcim

Mix Design: T34682110

Specified Strength (psi): ~~4000~~
4500

Placement Location: Curb & Gutter

Location Details: North side of Lanceleaf Dr., Lot 86

Lat/Long: 38.72895 / -104.65615


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
5	388 86754961	11.00	Slump: 1 Spec: 1 - 4	Result: 5.5 Spec.: 5 - 8	141.6	80	76

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
5 / 4688	7	06/11/2024	4510		Type 3
5 / 4689	28	07/02/2024	5400	CP	Type 3
5 / 4690	28	07/02/2024	5680	CP	Type 3
5 / 4691	28	07/02/2024	5490	CP	Type 3

Average Strength (psi): 7 Day - 4510 psi, 28 Day - 5520 psi

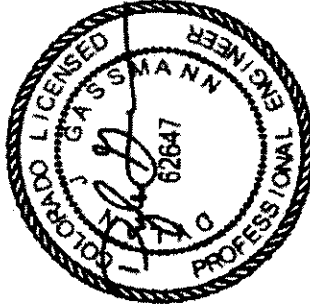

07/08/2024

Digitally Signed by Dylan Gassmann, PE



Entech Engineering
505 Elkon Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F-12
The Glen at Widefield F-12
Fountain, CO

Set #: 4 Sample #: 1318

Placement Date: 06/04/2024

Technician: Ben Westhues

Weather Conditions: Sunny Air Temp (°F): 69

Contractor: Trax

Supplier: Holcim

Mix Design: T34682110

Specified Strength (psi): ~~4000~~
4500

Placement Location: Curb & Gutter

Location Details: North side of Golden Buffs Dr., Lot 1

Lat/Long: 38.72877 / -104.65603


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd ³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft ³)	Concrete Temp (°F)	Air Temp (°F)
4	44 86754947	11.00	Slump: 1 Spec: 1 - 4	Result: 6 Spec.: 5 - 8	141.6	73	69

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
4 / 4678	7	06/11/2024	4490		Type 3
4 / 4679	28	07/02/2024	5280	OP	Type 3
4 / 4680	28	07/02/2024	5140	OP	Type 2
4 / 4681	28	07/02/2024	5220	OP	Type 3

Average Strength (psi): 7 Day - 4490 psi, 28 Day - 5210 psi

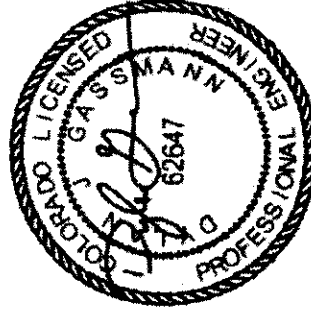

07/08/2024

Digitally Signed by Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 3 Sample #: 1292 Placement Date: 06/03/2024 Technician: Ben Westhues

Weather Conditions: Sunny Air Temp (°F): 83

Contractor: Trax

Supplier: Holcim

Mix Design: T34682110

Specified Strength (psi): 4000

Placement Location: Curb & Gutter

Location Details: From the intersection of Pennycrest Dr. and Lanceleaf Dr.
75' West on the south side of the street.

Lat/Long: 38.72882 / -104.65631


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
3	8 86754938	12.00	Slump: 1 Spec: 1 - 4	Result: 5.5 Spec: 5 - 8	143.2	83	83

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
3 / 4615	7	06/10/2024	4540		Type 2
3 / 4616	28	07/01/2024	5030	CP	Type 3
3 / 4617	28	07/01/2024	5350	CP	Type 3
3 / 4618	28	07/01/2024	5300	CP	Type 2

Average Strength (psi): 7 Day - 4540 psi, 28 Day - 5230 psi

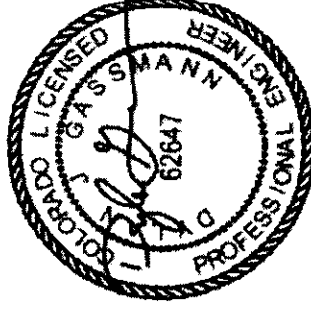

07/02/2024

Digitally Signed by Dylan Gassmann, PE



Entech Engineering
505 Elkton Dr
Colorado Springs, CO 80907
Phone: 719-531-5599

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 2 Sample #: 1291 Placement Date: 06/03/2024 Technician: Ben Westhues

Weather Conditions: Sunny Air Temp (°F): 67

Contractor: Trax

Supplier: Holcim

Mix Design: T34682110

Specified Strength (psi): ~~4000~~
4500

Placement Location: Curb & Gutter

Location Details: From the intersection of Pennycress Dr. and Golden Buffs
Dr. 75' West on the south side of the street.

Lat/Long: 38.72964 / -104.65623


PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
2	84 86754922	11.00	Slump: 1 Spec: 1 - 4	Result: 6 Spec.: 5 - 8	141.6	73	67

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
2 / 4611	7	06/10/2024	5040		Type 3
2 / 4612	28	07/01/2024	5780	CP	Type 3
2 / 4613	28	07/01/2024	5780	CP	Type 3
2 / 4614	28	07/01/2024	5710	CP	Type 3

Average Strength (psi): 7 Day - 5040 psi, 28 Day - 5760 psi

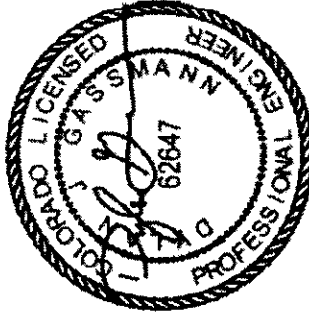

07/02/2024

Digitally Signed by Dylan Gassmann, PE

Concrete Test

Client:

Glen Development Co
3 Widefield Blvd
Colorado Springs, CO 80911

Project:

231853 (231853)
The Glen at Widefield F12
The Glen at Widefield F12
Fountain, CO

Set #: 1 / Sample #: 403 Placement Date: 03/01/2024 Technician: James Royse

Weather Conditions: Sunny Air Temp (°F): 65

Contractor: Frazee Construction

Supplier: SRM

Mix Design: 40022

Specified Strength (psi): ~~4000~~
4500

Placement Location: Inlet Box

Location Details: Inlet @ STA 5+04

Lat/Long: 38.7270949 / -104.6583949

PLACEMENT DATA

Set #	Truck # Ticket #	Load Vol (yd³)	Slump (in)	Air Content (%)	Unit Weight (lb/ft³)	Concrete Temp (°F)	Air Temp (°F)
1	1636 12020690	6.00	Slump: 3 1/2 Spec: 3 - 5	Result: 6 Spec.: 5 - 8	139.3	72	65

STRENGTH DATA

Set / Test	Age (days)	Test Date	Strength (psi)	Remark	Fracture Pattern
1 / 1390	7	03/08/2024	4100		Type 3
1 / 1391	28	03/29/2024	5480	CP	Type 2
1 / 1392	28	03/29/2024	4780	CP	Type 2
1 / 1393	28	03/29/2024	5300	CP	Type 2

Average Strength (psi): 28 Day - 5190 psi