



WATER QUALITY CAPTURE PLAN VOLLMER NORTH

ACCEPTED for FILE
Engineering Review

06/06/2023 1:44:46 PM
Elizabeth Nijkamp, PE
EPC Department of Public Works

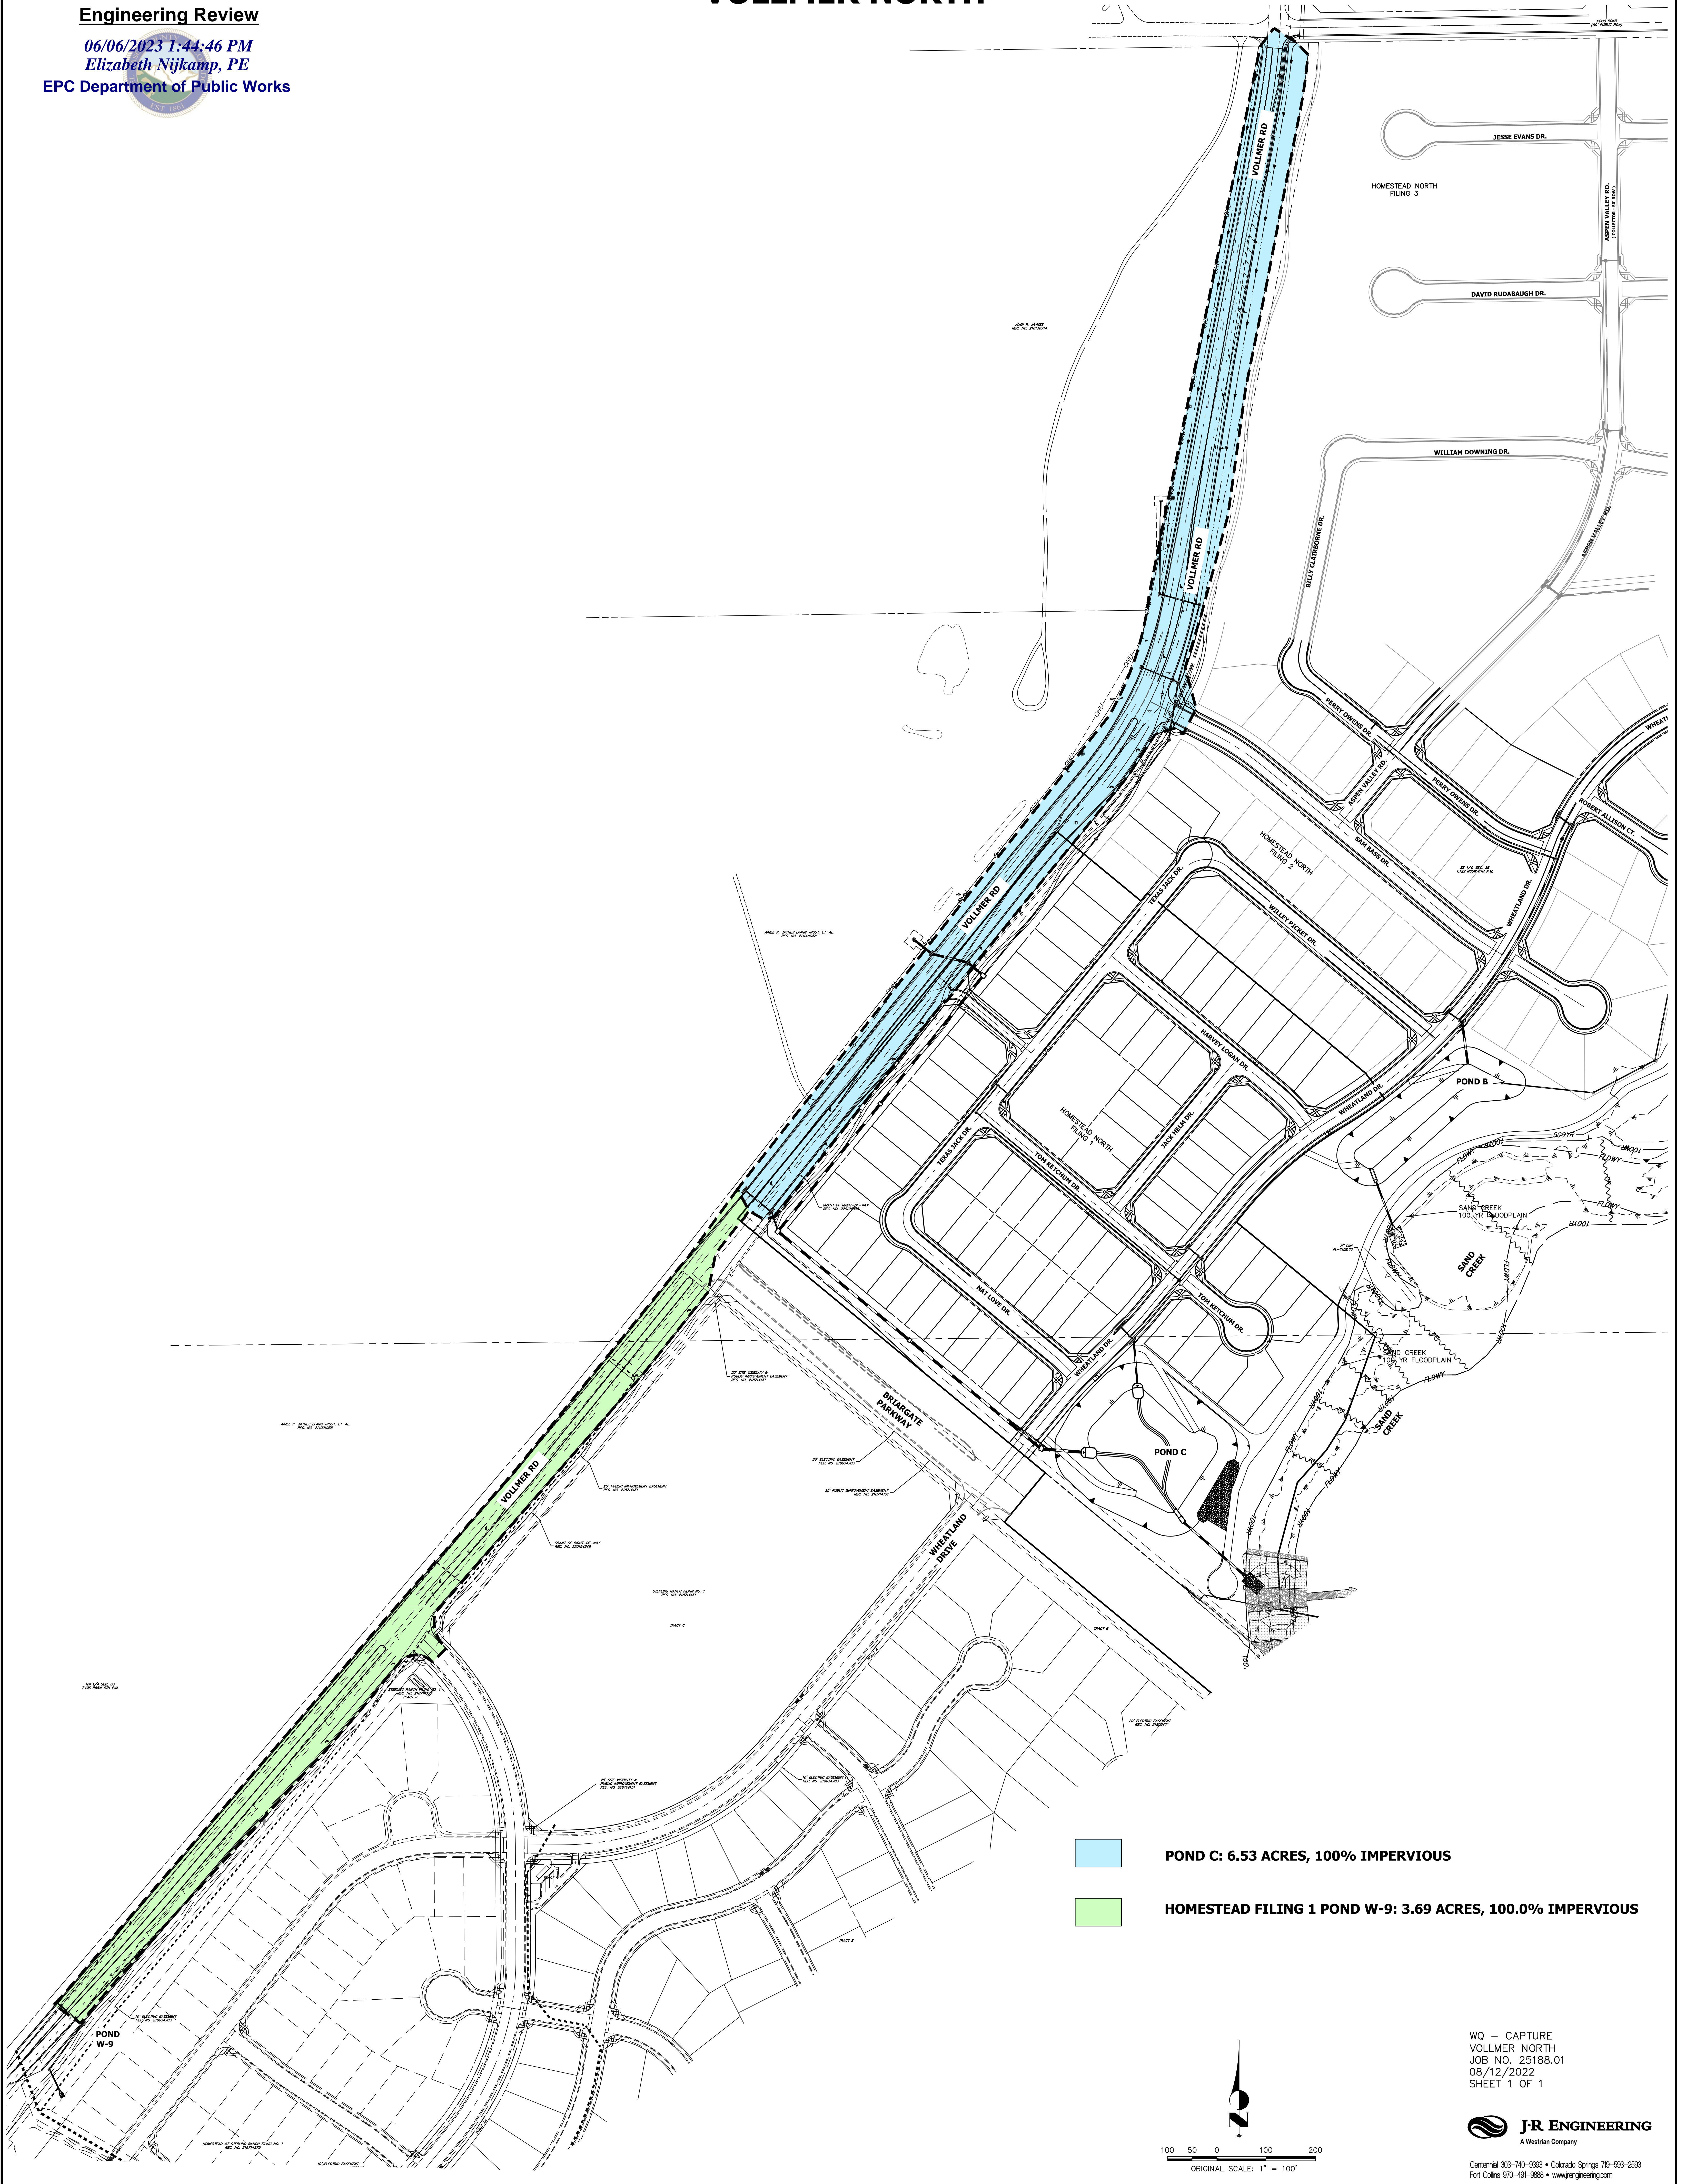

- POND C: 6.53 ACRES, 100% IMPERVIOUS
- HOMESTEAD FILING 1 POND W-9: 3.69 ACRES, 100.0% IMPERVIOUS

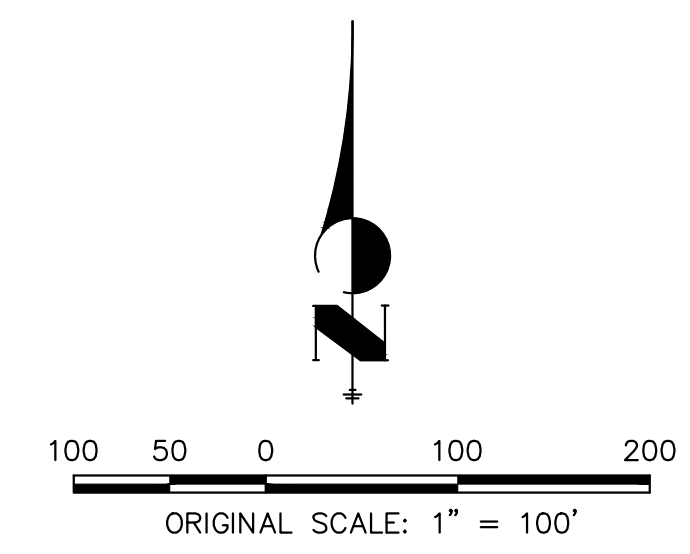

WQ - CAPTURE
VOLLMER NORTH
JOB NO. 25188.01
08/12/2022
SHEET 1 OF 1

JR ENGINEERING
A WestJan Company

Centennial 303-740-9393 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com