

Stormwater Detention and Infiltration Design Data Sheet

SDI-Design Data v2.00, Released January 2020

Stormwater Facility Name: **Pond D**

Facility Location & Jurisdiction: **Grandview Reserve Filing No. 1 | Division: Arkansas | Jurisdiction: El Paso County**

User Input: Watershed Characteristics

Extended Detention Basin (EDB) <input type="button" value="▼"/>		EDB	
Watershed Area =	12.20	acres	
Watershed Length =	1,200	ft	
Watershed Length to Centroid =	600	ft	
Watershed Slope =	0.020	ft/ft	
Watershed Imperviousness =	61.3%	percent	
Percentage Hydrologic Soil Group A =	100.0%	percent	
Percentage Hydrologic Soil Group B =	0.0%	percent	
Percentage Hydrologic Soil Groups C/D =	0.0%	percent	
Target WQCV Drain Time =	40.0	hours	

Location for 1-hr Rainfall Depths (use dropdown):

User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Once CUHP has been run and the Stage-Area-Discharge information has been provided, click 'Process Data' to interpolate the Stage-Area-Volume-Discharge data and generate summary results in the table below. Once this is complete, click 'Print to PDF'.

Update as comments on the drainage report spreadsheets are resolved.



User Defined Stage [ft]	User Defined Area [ft ²]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	72	0.00	0.00
0.50	72	0.50	0.02
1.25	1,150	1.25	0.05
2.25	13,763	2.25	0.09
3.25	15,727	3.25	0.25
4.25	17,699	4.25	0.35
5.25	19,766	5.25	5.67
6.25	22,002	6.25	6.19
6.50	22,565	6.50	6.31
7.25	24,290	7.25	108.77
8.00	26,073	8.00	309.03

After completing and printing this worksheet to a pdf, go to: <https://maperture.digitaldataservices.com/gvh/?viewer=cswdif>
 Create a new stormwater facility, and attach the PDF of this worksheet to that record.

Routed Hydrograph Results

Design Storm Return Period =	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
One-Hour Rainfall Depth =	N/A	1.19	1.50	1.75	2.25	2.52	in
CUHP Runoff Volume =	0.245	0.669	0.880	1.049	1.502	1.777	acre-ft
Inflow Hydrograph Volume =	N/A	0.669	0.880	1.049	1.502	1.777	acre-ft
Time to Drain 97% of Inflow Volume =	36.1	59.3	65.9	68.5	66.8	65.6	hours
Time to Drain 99% of Inflow Volume =	37.7	62.4	69.8	73.0	72.8	72.4	hours
Maximum Ponding Depth =	2.45	3.54	4.06	4.39	4.91	5.28	ft
Maximum Ponded Area =	0.32	0.37	0.40	0.41	0.44	0.46	acres
Maximum Volume Stored =	0.245	0.624	0.827	0.960	1.180	1.348	acre-ft

Stormwater Detention and Infiltration Design Data Sheet

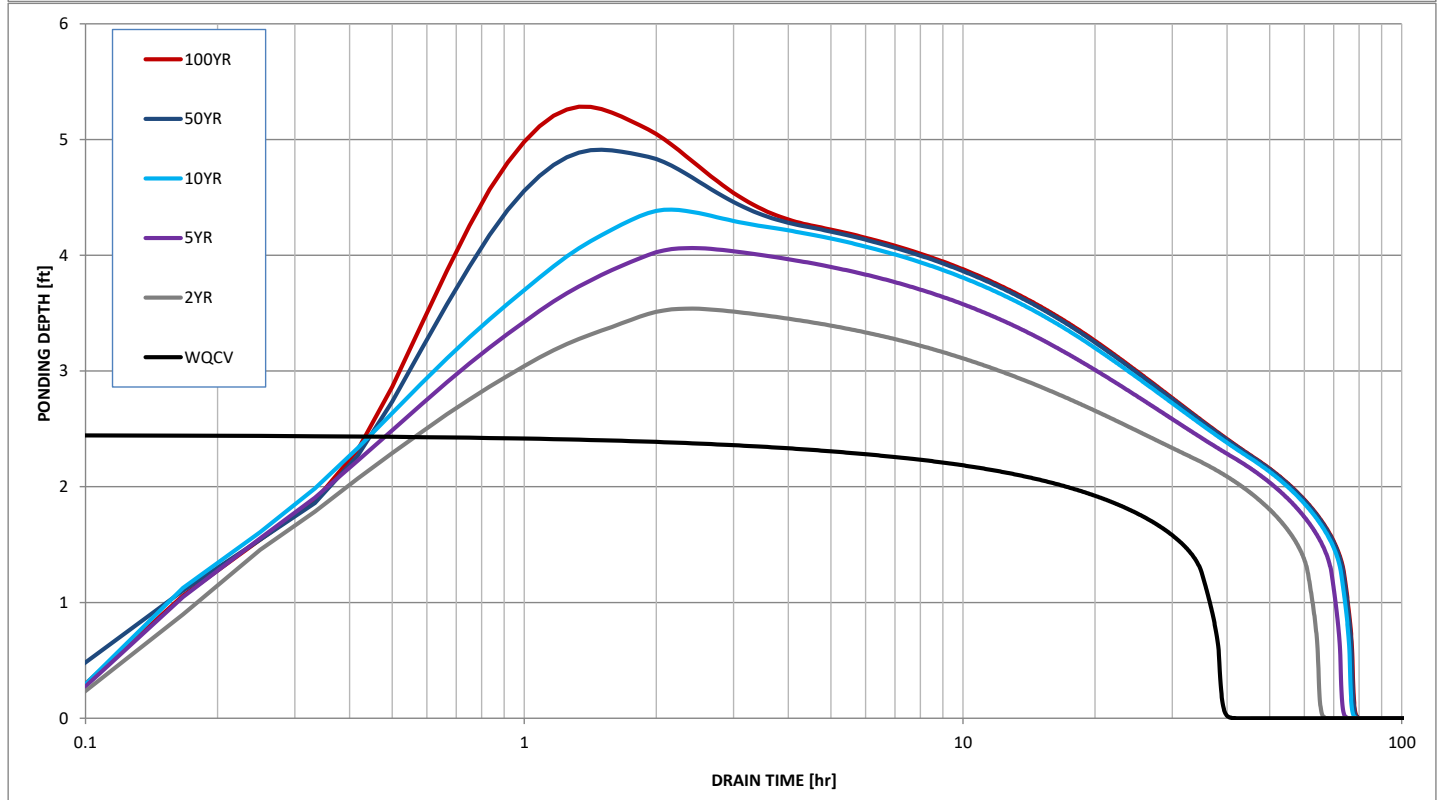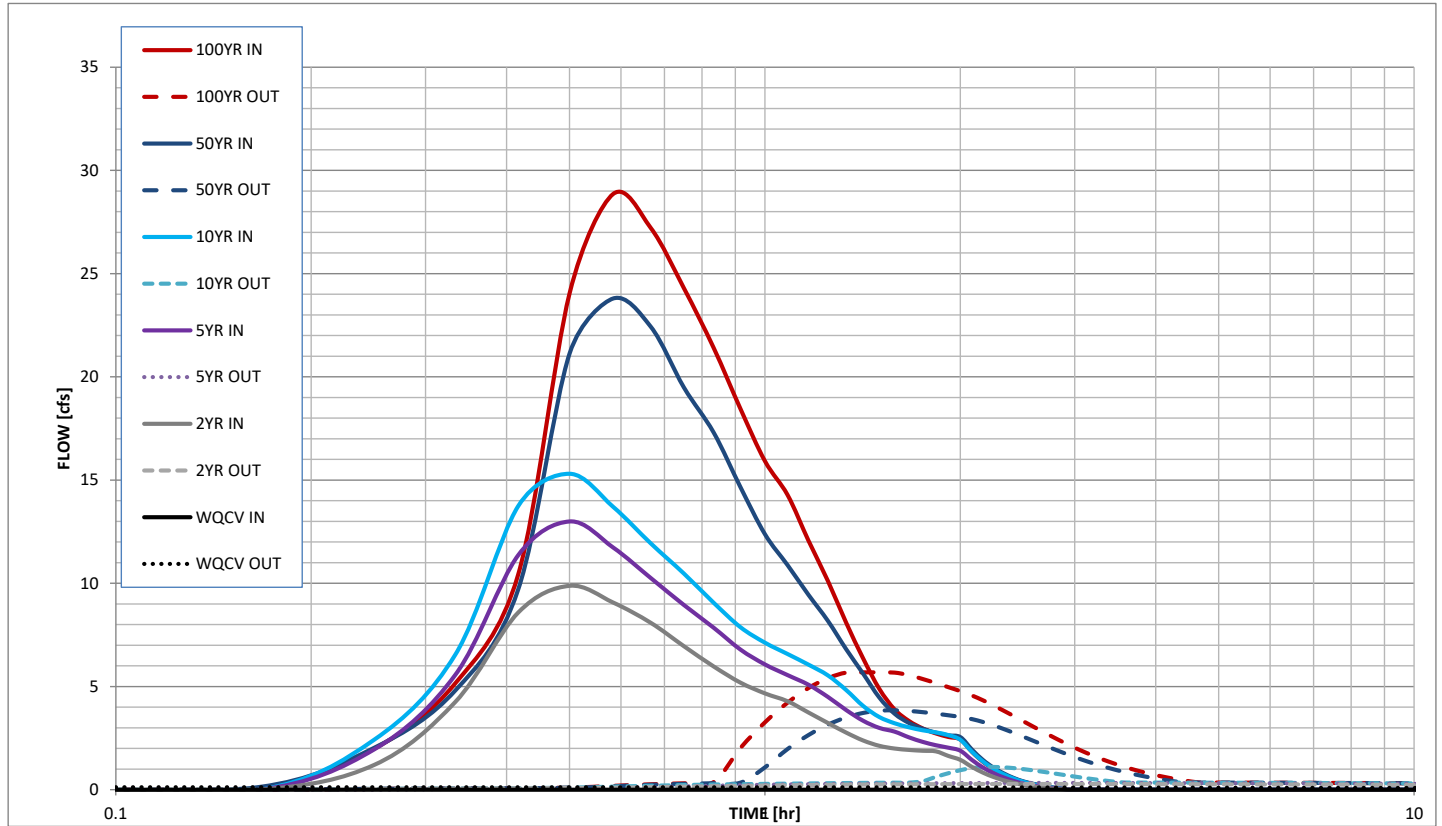

Stormwater Detention and Infiltration Design Data Sheet

SDI-Design Data v2.00, Released January 2020

Stormwater Facility Name: **Pond E**

Facility Location & Jurisdiction: **Grandview Reserve Filing No. 1 | Division: Arkansas | Jurisdiction: El Paso County**

User Input: Watershed Characteristics

Extended Detention Basin (EDB)	▼	EDB
Watershed Area =	21.30	acres
Watershed Length =	1,800	ft
Watershed Length to Centroid =	900	ft
Watershed Slope =	0.020	ft/ft
Watershed Imperviousness =	61.7%	percent
Percentage Hydrologic Soil Group A =	90.0%	percent
Percentage Hydrologic Soil Group B =	10.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent
Target WQCV Drain Time =	40.0	hours

Location for 1-hr Rainfall Depths (use dropdown):

User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Once CUHP has been run and the Stage-Area-Discharge information has been provided, click 'Process Data' to interpolate the Stage-Area-Volume-Discharge data and generate summary results in the table below. Once this is complete, click 'Print to PDF'.

User Defined Stage [ft]	User Defined Area [ft^2]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	90	0.00	0.00
0.75	90	0.75	0.04
1.75	1,116	1.75	0.09
2.75	17,359	2.75	0.14
3.75	27,043	3.75	0.38
4.75	30,550	4.75	0.58
5.75	34,177	5.75	3.45
6.25	35,863	6.25	10.48
6.75	37,928	6.75	76.24
7.75	41,408	7.75	368.84

Update as comments on the drainage report spreadsheets are resolved.

After completing and printing this worksheet to a pdf, go to:
<https://maperture.digitaldataservices.com/gvh/?viewer=cswdif>
 Create a new stormwater facility, and attach the PDF of this worksheet to that record.

Routed Hydrograph Results

Design Storm Return Period =	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
One-Hour Rainfall Depth =	N/A	1.19	1.50	1.75	2.25	2.52	in
CUHP Runoff Volume =	0.430	1.205	1.581	1.882	2.743	3.251	acre-ft
Inflow Hydrograph Volume =	N/A	1.205	1.581	1.882	2.743	3.251	acre-ft
Time to Drain 97% of Inflow Volume =	34.3	56.8	62.9	63.9	63.3	62.0	hours
Time to Drain 99% of Inflow Volume =	35.8	59.8	66.7	68.3	69.4	69.0	hours
Maximum Ponding Depth =	3.21	4.35	4.86	5.17	5.90	6.22	ft
Maximum Poned Area =	0.50	0.67	0.71	0.74	0.80	0.82	acres
Maximum Volume Stored =	0.432	1.123	1.469	1.699	2.256	2.518	acre-ft

Stormwater Detention and Infiltration Design Data Sheet

