

# MASTER DEVELOPMENT DRAINAGE PLAN & FINAL DRAINAGE REPORT

for

## MONUMENT ACADEMY

### Engineering Review

04/05/2019 10:18:02 AM

dsdrice

JeffRice@elpasoco.com

(719) 520-7877


EPC Planning & Community  
Development Department

Prepared for:

**Monument Academy**  
1150 Village Ridge Point  
Monument, CO 80132

February 8, 2019

Prepared by:

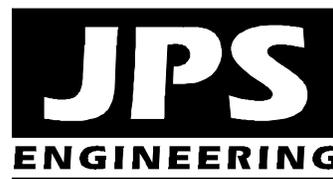

19 E. Willamette Avenue  
Colorado Springs, CO 80903  
(719)-477-9429  
[www.jpsegr.com](http://www.jpsegr.com)

JPS Project No. 040201  
PCD File No. SP-19-  
PPR-19-009

**MONUMENT ACADEMY - FINAL DRAINAGE REPORT**  
**TABLE OF CONTENTS**

	<u>PAGE</u>
EXECUTIVE SUMMARY .....	i
DRAINAGE STATEMENT .....	ii
I. GENERAL LOCATION AND DESCRIPTION .....	1
II. DRAINAGE BASINS AND SUB-BASINS.....	4
III. DRAINAGE DESIGN CRITERIA .....	5
IV. DRAINAGE PLANNING FOUR STEP PROCESS.....	5
V. GENERAL DRAINAGE RECOMMENDATIONS .....	6
VI. DRAINAGE FACILITY DESIGN .....	7
VII. EROSION / SEDIMENT CONTROL .....	13
VIII. COST ESTIMATE AND DRAINAGE FEES.....	13
IX. SUMMARY .....	14

**APPENDICES**

APPENDIX A	Soils Information
APPENDIX B	Hydrologic Calculations
APPENDIX C1	Hydraulic Calculations – Channels
APPENDIX C2	Hydraulic Calculations – Storm Sewer System
APPENDIX D1	Detention Pond Calculations – Pond C14
APPENDIX D2	Detention Pond Calculations – Pond M3
APPENDIX E	Drainage Cost Estimate
APPENDIX F	Figures
Figure A1	Vicinity Map
Figure FM1	Floodplain Map
Figure EX1	Major Basin / Historic Drainage Plan
Figure EX2	Historic Drainage Plan
Figure D1	Developed Drainage Plan
Sheet C2.1	North Site Grading & Erosion Control Plan
Sheet C2.2	South Site Grading & Erosion Control Plan
Sheet C3.1	Detention Pond C14 Plan & Details
Sheet C3.2	Detention Pond M3 Plan & Details

DRAINAGE STATEMENTS

Engineer's Statement:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for liability caused by negligent acts, errors or omissions on my part in preparing this report.

---

John P. Schwab, P.E. #29891

Developer's Statement:

I, the developer have read and will comply with all of the requirements specified in this drainage report and plan.

By:

---

Printed Name: Don Griffin, PhD

Date

Title: Executive Director

Monument Academy  
1150 Village Ridge Point  
Monument, CO 80132

El Paso County's Statement:


Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual, Volumes 1 and 2, and Engineering Criteria Manual as amended.

---

Jennifer Irvine, P.E.  
County Engineer / ECM Administrator

Date

Conditions:



## **MONUMENT ACADEMY FINAL DRAINAGE REPORT - EXECUTIVE SUMMARY**

### **A. Background**

- Monument Academy is planning to construct a new Middle School / High School campus on approximately 21.2 acres of the vacant 64.1-acre parcel at the southeast corner of SH83 and Walker Road.
- 83 Walker LLC has future plans for development of the balance of the property with a mixture of commercial and residential land uses.
- The project site is located near the upstream limit of the West Cherry Creek Drainage Basin, which comprises a total drainage area in excess of 30 square miles.

### **B. General Drainage Plan**

- Developed drainage will be conveyed to suitable outfalls through paved parking areas with curb and gutter, streets with roadside ditches, storm sewer facilities, and drainage channels.
- Developed flows from the site will be detained to historic levels through on-site stormwater detention and water quality ponds.

### **C. Drainage Impacts**

- Drainage facilities will be designed and constructed to El Paso County standards.
- Drainage facilities within public road rights-of-way will be dedicated to the County for maintenance. The proposed stormwater detention ponds will be privately owned and maintained by the Property Owners Association.
- The proposed detention ponds will release historic flows at the downstream property boundaries, ensuring no significant adverse drainage impact on downstream properties.

## **I. GENERAL LOCATION AND DESCRIPTION**

### **A. Background**

Monument Academy is planning to construct a new school campus on a 64.1-acre property located at the southeast corner of State Highway 83 (SH83) and Walker Road in northern of El Paso County, Colorado (see Figure A1, Appendix F). The proposed school site is a vacant, unplatted property (El Paso County Assessor's Parcel No. 61000-00-245). The site is zoned Rural Residential (RR-5), and the proposed school is a permitted use.

Monument Academy is planning to construct the new school campus on approximately 21.2 acres in the northeasterly part of the property. 83 Walker LLC has future plans for development of the balance of the 64.1-acre property with a mixture of commercial and residential land uses. Site development activities will include site grading, utilities, a new school building, internal roads, parking lots, landscaping, and related site improvements.

Monument Academy, a Colorado Charter School authorized by the Lewis-Palmer School District No. 38, desires to construct a new middle/high school serving grades 6-12. The school intends to open in the fall of 2020 with approximately 480 students and anticipates growing its enrollment to 1,000 students at full build out. The school, as proposed, would consist of a two-story building of approximately 55,000 SF built in phase one, and an additional 30,000 SF to be constructed in a future phase. The school will contain all customary program spaces such as academic spaces, athletic and gymnasium spaces, band, vocal music, art, drama and typical support spaces such as administrative and counseling spaces. While most of these functions would be constructed in the first phase, the second phase would likely expand the athletic and performance arts spaces including a multi-purpose performance venue.

In addition to the school functions, the YMCA of the Pikes Peak Region, the largest non-profit community support organization serving El Paso County, proposes to occupy approximately 12,000 SF of phase one space that would be co-located with the school. The YMCA program would consist of athletic spaces such as a healthy living center, group exercise class space, personal training, and other similar functions. As with the school, the YMCA would also require typical support spaces for administrative, child care, and other functions. As with the school, the YMCA envisions constructing their program space in phases, and phase two could include an expanded healthy living center, additional group exercise spaces, and potentially a competition aquatics venue. If all these envisioned uses are eventually constructed, future phases would total approximately 40,000 SF of additional space.

Primary access to the site will be provided by a new roadway extending south from Walker Road into the site. Based on the Traffic Study and coordination with CDOT, a roundabout is proposed at intersection of Walker Road and the new north-south roadway entering the site. An additional right-in; right-out access is planned to extend from State Highway 83 easterly into the site. This access will extend east-west across the property, connecting with the future extension of Pinehurst Circle planned through the adjoining Walden Preserve 2 PUD southeast of the school

site. Both the north-south and east-west access roads will be constructed with the ultimate intention of dedication as public rural collector roadways in conjunction with a future subdivision application.

## **B. Scope**

In support of the El Paso County Site Development Plan and Minor Subdivision Plat submittals for this project, this report is intended to meet the requirements of a Master Development Drainage Plan (MDDP) and Final Drainage Report (FDR) in accordance with El Paso County drainage criteria. This report will provide a summary of site drainage issues impacting the proposed development. The report will analyze impacts from upstream drainage patterns, site-specific developed drainage patterns, and impacts on downstream facilities. This report is based on the guidelines and criteria presented in the City of Colorado Springs and El Paso County “Drainage Criteria Manual.”

This Final Drainage Report provides final drainage analysis and design for the Monument Academy campus and associated public road improvements. Additional Final Drainage Reports will be required in support of detailed development plans for the anticipated future commercial and residential development areas.

## **C. Site Location and Description**

The property is described as the East Half of the Northwest Quarter of Section 15, Township 11 South, Range 66 West of the 6th Principal Meridian, with exceptions as detailed in the legal description. The site has historically been a vacant forest and meadow tract.

The Monument Academy parcel is bordered by Walker Road to the north, State Highway 83 to the west, a rural residential parcel to the south, and the existing Walden Wastewater Treatment Facility to the east. The adjoining property to the north, west, and south is zoned rural residential (RR5).

The east boundary of the site adjoins the Walden Preserve 2 PUD. The Walden Preserve PUD and adjoining Walden Subdivision (Zoned RR1) include a range of 0.5-acre to 1-acre residential lots served by the Walden central water and wastewater systems.

Ground elevations within the parcel range from a low point of approximately 7,365 feet above mean sea level at the southwest corner of the property to a high point of 7,440 feet along the ridge within the site.

Surface drainage from this site flows into tributary channels draining to the main channel of West Cherry Creek. The terrain is rolling with slopes ranging from 1% to 10%. Existing vegetation is typical eastern Colorado prairie grass in the meadow areas and evergreen pines in the forest areas.

#### **D. General Soil Conditions**

According to the Soil Survey of El Paso County prepared by the Soil Conservation Service, the majority of the parcel is classified as “Tomah-Crowfoot” series loamy sands, and characterized as hydrologic soils group B. On-site soils are comprised primarily of the following soil types (see Appendix A):

- Type 26 – “Elbeth sandy loam”: slow to medium surface runoff, moderate erosion hazard (Hydrologic group B)
- Type 71 – “Pring coarse sandy loam”: medium surface runoff, moderate erosion hazard (Hydrologic Group B)
- Type 92 - “Tomah-Crowfoot loamy sands”: slow surface runoff, slight to moderate erosion hazard (Hydrologic Group B)

#### **E. References**

City of Colorado Springs & El Paso County “Drainage Criteria Manual,” revised October 12, 1994.

City of Colorado Springs “Drainage Criteria Manual, Volumes 1 and 2,” revised May, 2014.

CDOT, “CDOT Drainage Design Manual,” July, 1995.

El Paso County “Engineering Criteria Manual,” January 9, 2006.

Guenther Polok, “Drainage Report, Walden III, Filings 5, 6, and 7,” July, 1983.

JPS Engineering, Inc., “Final Drainage Report for Walden Pines Subdivision,” March 24, 2004.

JPS Engineering, Inc., “Final Drainage Report for Walden Preserve 2 Filings No. 1 and 2,” November 13, 2014.

JPS Engineering, Inc., “Final Drainage Report for Walden Preserve Subdivision Filing No. 1,” May 11, 2005.

JPS Engineering, Inc., “Master Development Drainage Plan (MDDP) and Preliminary Drainage Report for Walden Preserve Subdivision,” December 10, 2004.

JPS Engineering, Inc., “Master Development Drainage Plan (MDDP) and Preliminary Drainage Report for Walden Preserve 2 PUD,” September 17, 2014 (approved November 6, 2014).

JPS Engineering, Inc., “Preliminary Drainage Report for Walden Pines Subdivision,” December 29, 2003.

## **II. DRAINAGE BASINS AND SUB-BASINS**

### **A. Major Basin Description**

The proposed development lies within the West Cherry Creek Drainage Basin (CYCY 0400) as classified by El Paso County. Drainage from the east side of this site flows northerly to an eastern tributary of West Cherry Creek, which flows to a confluence with the main channel north of Walker Road. Drainage from the west side of this site flows westerly to several culverts crossing SH83, and then flowing northwesterly to the main channel of West Cherry Creek. Downstream agricultural areas generally drain northerly towards the main channel of West Cherry Creek.

The major drainage basins lying in and around the proposed development are depicted in Figure EX1. The Walden area is located near the southerly limits of the West Cherry Creek Basin, which comprises a total drainage area in excess of 30 square miles.

### **B. Floodplain Impacts**

The proposed development area is located beyond the limits of any 100-year floodplain delineated by the Federal Emergency Management Agency (FEMA). The floodplain limits in the vicinity of the site are shown in Flood Insurance Rate Map (FIRM) Number 08041C0285G dated December 7, 2018, as shown in Figure FM1 (Appendix F). As shown on Figure FM1, the FEMA floodplain limit extends slightly south of Walker Road in the vicinity of the existing culvert crossing east of this site.

### **C. Sub-Basin Description**

The existing drainage basins lying in and around the proposed development are depicted in Figure EX1 and EX2 (Appendix F). The property is located along a ridge, so there are no significant off-site drainage basins impacting the site. The existing on-site topography has been delineated as four drainage basins. Basin C14 drains northeasterly to a tributary channel of West Cherry Creek which crosses Walker Road east of the site. Basins M1-M3 drain westerly to existing culverts crossing SH83 and flowing northwesterly to the main channel of West Cherry Creek.

The developed drainage basins lying within the proposed development are depicted on Figure D1 (Appendix F). The interior site layout has been divided into drainage basins based on the site layout and proposed topography. The natural drainage patterns will be impacted through development by site grading and concentration of runoff in roadside ditches and channels. Developed flows will be routed through on-site stormwater detention ponds designed to release historic flows to the existing downstream culverts.

[See drainage plan redlines.](#)

### III. DRAINAGE DESIGN CRITERIA

#### A. Development Criteria Reference

No Drainage Basin Planning Study (DBPS) has been completed for the West Cherry Creek Drainage Basin. JPS Engineering, Inc. prepared the “Master Development Drainage Plan (MDDP) and Preliminary Drainage Report for Walden Preserve 2 PUD” dated September 17, 2014, which was approved by El Paso County on November 6, 2014 in support of the Walden Preserve 2 PUD and Preliminary Plan.

#### B. Hydrologic Criteria

Recognizing that all tributary drainage basins impacting this site are less than 100 acres, Rational Method procedures were utilized for calculation of peak flows within the on-site drainage basins. Rational Method hydrologic calculations were based on the following assumptions:

- |                                          |                            |             |
|------------------------------------------|----------------------------|-------------|
| • Design storm (minor)                   | 5-year                     |             |
| • Design storm (major)                   | 100-year                   |             |
| • Rainfall Intensities                   | El Paso County I-D-F Curve |             |
| • Hydrologic soil type                   | B                          |             |
|                                          | <u>C5</u>                  | <u>C100</u> |
| • Runoff Coefficients - undeveloped:     |                            |             |
| Existing meadow areas                    | 0.08                       | 0.35        |
| • Runoff Coefficients - developed:       |                            |             |
| Proposed buildings / pavement areas      | 0.90                       | 0.96        |
| Future neighborhood business areas       | 0.49                       | 0.62        |
| Future residential areas (0.5-acre lots) | 0.22                       | 0.46        |
| Future residential areas (1-acre lots)   | 0.20                       | 0.44        |

Hydrologic calculations are detailed in Appendix B, and peak design flows are identified on the drainage plan drawings in Appendix F.

### IV. DRAINAGE PLANNING FOUR STEP PROCESS

El Paso County Drainage Criteria require drainage planning to include a Four Step Process for receiving water protection that focuses on reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing drainageways, and implementing long-term source controls. The Four Step Process is applicable to all new and re-development projects with construction activities that disturb 1 acre or greater or that disturb less than 1 acre but are part of a larger common plan of development. The Four Step Process has been implemented as follows in the planning of this project:

### Step 1: Employ Runoff Reduction Practices

- **Minimize Impacts:** The proposed school development includes significant open space, play areas, and a future athletic field, resulting in a moderate level of impervious site development. The proposed school campus development generates less impervious area and less intensive drainage impacts in comparison to multi-family residential, commercial, or industrial land uses.
- **Minimize Directly Connected Impervious Areas (MDCIA):** The Walden community has developed as a rural residential development with roadside ditches along subdivision roads, providing for impervious areas to drain across pervious areas. Based on the roadside ditches throughout the subdivision, the subdivision is classified as MDCIA Level One.
- **Reduce Pavement Area:** The proposed school site layout has been designed to provide pavement areas as required to meet the functional needs of the school campus while minimizing excessive paved areas.
- **Grass Swales:** The proposed drainage plan incorporates roadside ditches and grass-lined swales in selected locations to encourage stormwater infiltration while providing positive drainage through the site.

### Step 2: Stabilize Drainageways

- Proper erosion control measures will be implemented along the roadside ditches and grass-lined drainage channels to provide stabilized drainageways within the site.

### Step 3: Provide Water Quality Capture Volume (WQCV)

- **Detention Ponds:** The developed site will drain through stormwater detention ponds which will capture and slowly release the WQCV over an extended release period.

### Step 4: Consider Need for Industrial and Commercial BMPs

- No industrial land uses are proposed within this development. Future commercial development areas will need to consider the potential need for Commercial BMPs.
- On-site drainage will be routed through private detention ponds to minimize introduction of contaminants to the County's public drainage system.


## **V. GENERAL DRAINAGE RECOMMENDATIONS**

The developed drainage plan for the site is to provide and maintain positive drainage away from structures and conform to the established drainage patterns for the overall site. JPS Engineering recommends that positive drainage be established and maintained away from all structures within the site in conformance with applicable building codes and geotechnical engineering recommendations.

Site grading and drainage improvements performed as a part of subdivision infrastructure development includes overlot grading and subdivision drainage improvements depicted on the subdivision construction drawings. Individual lot grading is the sole responsibility of the

Address developed areas not treated.

Will LID development features be considered for commercial areas?

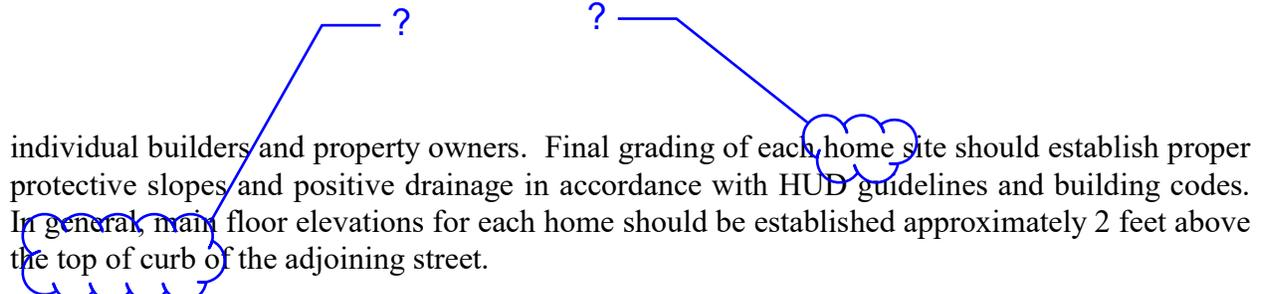

individual builders and property owners. Final grading of each home site should establish proper protective slopes and positive drainage in accordance with HUD guidelines and building codes. In general, main floor elevations for each home should be established approximately 2 feet above the top of curb of the adjoining street.

In general, we recommend a minimum of 6 inches clearance from the top of concrete foundation walls to adjacent finished site grades. Positive drainage slopes should be maintained away from all structures, with a minimum recommended slope of 5 percent for the first 10 feet away from buildings in landscaped areas, a minimum recommended slope of 2 percent for the first 10 feet away from buildings in paved areas, and a minimum slope of 1 percent for paved areas beyond buildings.

## **VI. DRAINAGE FACILITY DESIGN**

### **A. General Concept**

Development of the Monument Academy site will require site grading and paving, resulting in additional impervious areas throughout the site. The general drainage pattern will consist of grading away from building sites to a system of drainage swales, storm sewers, and roadside ditches conveying runoff flows through the site.

The stormwater management concept for the Monument Academy development will be to provide a system of storm sewers, roadside ditches, and grass-lined swales as required to safely convey developed drainage through the site to on-site detention ponds, discharging to the existing natural outfalls. Grading of individual development sites will provide positive drainage away from buildings and direct developed flows into the system of storm sewers, roadside ditches, and drainage swales running through the subdivision.

### **B. Specific Details**

#### **1. Existing Drainage Conditions**

Historic drainage conditions within the site are depicted on Figure EX1 and EX2. The Monument Academy site is located along a north-south ridge along the east side of SH83, so there are no significant off-site drainage basins impacting the site. Surface drainage from the site generally flows northerly to tributary channels feeding into West Cherry Creek.

The northeasterly part of the site has been delineated as Basin C14, which sheet flows northeasterly to Design Point #C14 at the northeast corner of the property, with historic peak flows calculated as  $Q_5 = 3.9$  cfs and  $Q_{100} = 28.9$  cfs. Drainage from Design Point #C14 continues flowing easterly across the adjoining Walden Wastewater Treatment Facility site to an existing culvert crossing Walker Road at the northern boundary of the Walden property. According to the Master Development Drainage Plan for Walden Preserve 2 PUD," historic peak flows at the existing culvert crossing Walker Road have been calculated as  $Q_5 = 222.5$  cfs and  $Q_{100} = 582.9$  cfs (SCS

Address capacity of this culvert and the upstream driveway culvert.

Method), so the contribution of flow from Monument Academy Basin C14 to this design point is negligible.

The westerly and southerly part of the site has been delineated as Basins M1-M4, flowing westerly to existing culverts crossing SH83 and Walker Road. Basin M1 comprises the northwest corner of the property, which sheet flows northwesterly to Design Point #M1, with historic peak flows calculated as  $Q_5 = 1.6$  cfs and  $Q_{100} = 11.5$  cfs. An existing 18-inch CMP culvert conveys the flow from Design Point #M1 northerly across Walker Road.

Basin M3 split for each culvert comprises the middle area on the west side of the property, which sheet flows to existing culverts crossing SH83. Historic peak flows at Design Point #M3 are calculated as  $Q_5 = 4.4$  cfs and  $Q_{100} = 32.1$  cfs. Existing 18-inch CMP and 24-inch CMP culverts convey the flow from Basin M3 westerly across SH83.

Basin M4 comprises the south end of the property, which sheet flows to the southwest corner of the site. Historic peak flows at Design Point #M4 are calculated as  $Q_5 = 4.7$  cfs and  $Q_{100} = 34.5$  cfs. An existing 24-inch CMP culvert conveys the flow from Basin M4 westerly across SH83.

## 2. Developed Drainage Conditions

Address culvert capacity and headwater for each culvert.

As shown on the enclosed Developed Drainage Plan (Figure D1, Appendix F), the property has been delineated as five on-site drainage basins flowing across the property. Developed flows have been calculated based on the impervious areas associated with the proposed building and parking areas and anticipated future land uses.

Hydrologic calculations for the school site are detailed in the attached spreadsheets (Appendix B), and peak flows are identified on Figures EX1 and D1 (Appendix F).

### a) School Campus

The majority of the school site has been delineated as Basins C14 and M2. Basin C14 drains northeasterly across the property to a proposed stormwater detention pond at the northeast corner of the site. Basin M2 drains westerly across the site to a proposed stormwater detention pond along the western boundary of the property.

The proposed school building pad will be graded with protective slopes to provide positive drainage away from the building. Private storm sewer systems will be extended across the parking areas, and site grades around the school campus will slope to storm inlets at selected locations, collecting surface drainage and conveying stormwater to the proposed extended detention basins (EDB).

## Basin C14

The northeasterly part of the developed School Site has been delineated as Basin C14, which will flow northeasterly to Design Point #C14 following historic drainage patterns. Developed peak flows at Design Point #C14 are calculated as  $Q_5 = 15.7$  cfs and  $Q_{100} = 44.8$  cfs. An 18"-24" storm sewer system will collect surface drainage from Basin C14 and convey developed flows northeasterly to Detention Pond C14 at the northeast corner of the site.

Describe pond inflow/outflow and volume attributes.

The east edge of the southerly parking lot will flow northeasterly to Private Storm Inlet C14.1 (10' Type R Inlet) on the east side of the school building. Private Storm Sewer C14.1 (18" HDPE) will convey the flow from Inlet C14.1 northerly to Private Storm Inlet C14.2 at the northeast corner of the northerly parking lot.

Private Storm Sewer C14.2 (24" HDPE) will convey the flow from Inlet C14.2 northerly to Private Inlet C14.3 (Type C) on the north side of the athletic field. Private Storm Sewer C14.3 (24" HDPE) will convey the flow from Inlet C14.3 easterly into Private Detention Pond C14. Stormwater detention and water quality will be provided by routing developed flows through Detention Pond C14.

## Basin M2

The southwesterly part of the developed School Site has been delineated as Basin M2, which flows westerly across the south parking lot to Design Point #M2, with developed peak flows calculated as  $Q_5 = 19.4$  cfs and  $Q_{100} = 40.0$  cfs. An 18"-24" storm sewer system will collect surface drainage from Basin M2 and convey developed flows westerly to a grass-lined channel on the west side of "Road A" flowing to Detention Pond M3 at the western property boundary. While no initial development is proposed within Basin M3, Detention Pond M3 has been sized to account for future commercial development of Basin M3 as well.

for volume requirements (?)

The majority of the east side of the southerly parking lot will flow northwesterly to Inlet M2.1 (10' Type R Inlet) on the south side of the school building. Storm Inlet M2.1 will intercept surface drainage from the southeasterly parking lot, and roof drains from the south side of the building will flow into a roof drain collection line feeding into Storm Sewer M2.1. Private Storm Sewer M2.1 (18" RCP) will convey the flow from Inlet M2.1 to Public Inlet M2.3 (Type D) within the roadside ditch southwest of the school building.

Public Storm Inlet M2.2 will intercept flow from the roadside ditch at the northeast corner of Pinehurst Circle and "Road A", and Public Storm Sewer M2.2 (18" RCP) will convey this flow northerly to the junction Inlet M2.3. Public Storm Sewer M2.3 (30" RCP) will convey the combined flow from Inlet M2.3 westerly across "Road A" to daylight in an open channel flowing northwesterly into Private Detention Pond M3.

Address untreated  
sub-basins/areas.

Stormwater detention and water quality will be provided by routing developed flows through Detention Pond M3.

## **b) Future Development Areas**

### Basin M1

The northwesterly part of the overall site has been delineated as Basin M1, which flows to Design Point #M1 at the northwest corner of the property. Assuming future commercial development characterized as “neighborhood business,” the future developed peak flows at Design Point #M1 are calculated as  $Q_5 = 8.1$  cfs and  $Q_{100} = 17.3$  cfs. A future detention and water quality pond will be required to mitigate developed drainage impacts at Design Point #M1.

There will be no significant developed drainage impact within Basin M1 during the initial phase of Monument Academy site development.

### Basin M3

The central areas on the west side of the property has been delineated as developed Basin M3, which flows westerly to Detention Pond M3. Assuming future commercial development characterized as “neighborhood business,” the future developed peak flows from Basin M3 are calculated as  $Q_5 = 18.8$  cfs and  $Q_{100} = 42.7$  cfs. Flows from Basins B2 and B3 combine at Design Point #M3, with peak flows calculated as  $Q_5 = 38.3$  cfs and  $Q_{100} = 83.0$  cfs. Detention Pond M3 will be constructed with the initial phase of development, so no additional detention will be required for this basin assuming the future development is consistent with the assumptions in this report.

### Basin M4

The south end of the overall site has been delineated as Basin M4, which flows to Design Point #M4 at the southwest corner of the property. Assuming future residential development with a mixture of 0.5-acre to 1-acre lot sizes, the future developed peak flows at Design Point #M4 are calculated as  $Q_5 = 13.9$  cfs and  $Q_{100} = 50.1$  cfs. A future detention and water quality pond will be required to mitigate developed drainage impacts at Design Point #M4.

There will be no significant developed drainage impact within Basin M4 during the initial phase of Monument Academy site development.

Provide calculations for this phase and ultimate development.

### C. Comparison of Developed to Historic Discharges

Based on the hydrologic calculations in Appendix B, the proposed development will result in developed flows exceeding historic flows from the parcel. The increase in developed flows will be mitigated through on-site stormwater detention facilities.

The comparison of developed to historic discharges at key design points is summarized as follows:

Design Point	Historic Flow			Developed Flow			Comparison of Developed to Historic Flow (Q <sub>5%</sub> /Q <sub>100%</sub> )
	Area (ac)	Q <sub>5</sub> (cfs)	Q <sub>100</sub> (cfs)	Area (ac)	Q <sub>5</sub> (cfs)	Q <sub>100</sub> (cfs)	
C14 (developed)	18.3	3.9	28.9	15.9	15.7	44.8	403% / 155% (increase)
C14 (detained)	18.3	3.9	28.9	15.9	0.2	13.3	5% / 46% (decrease)
M3 (developed)	15.0	4.4	32.1	18.8	38.3	83.0	870% / 259% (increase)
M3 (detained)	15.0	4.4	32.1	18.8	0.5	25.6	11% / 80% (decrease)

### D. Detention Ponds

The total developed storm runoff downstream of the site will be maintained at historic levels by routing flows through the proposed detention ponds. Detention Ponds C14 and M3 will be constructed with the initial phase of development, and these ponds have been designed as “full-spectrum” detention ponds to mitigate developed drainage and water quality impacts from the school campus and associated roadway improvements.

The proposed pond outlet structures have been designed as Extended Detention Basins (EDB), providing for a 40-hour release of the WQCV, and outlet structure sizing to maintain maximum allowable release rates from the pond. The detention ponds will have grass-lined bottoms and riprap infiltration zones in front of the pond outlet structures to encourage infiltration of stormwater prior to discharging into the downstream drainage system. Buried riprap spillways will be provided as emergency overflow paths from each pond to the adjoining roadside ditches.

Final pond design calculations utilizing the Denver Urban Drainage and Flood Control District (UDFCD) “UD-Detention\_v3.07” software package are enclosed in Appendix D1 and D2. Design parameters for the detention ponds are summarized as follows:

Pond	Tributary Area (ac)	Percent Impervious (%)	Required 100-Year Detention Volume (ac-ft)	Design Volume (ac-ft)
C14	15.9	27.0%	1.0	1.3
M3	18.8	61.4%	2.1	2.3

Describe how pond outlet structures will be modified with the future development. Analyses for this report should size outlets only for this phase of development.

The proposed detention ponds will be owned and maintained by the Property Owners Association, and maintenance access will be provided from the adjacent parking lots, access drives, and public roads. **State that easements are provided in the PDB/BMP maintenance agreement.**

## **E. On-Site Drainage Facility Design**

Developed sub-basins and proposed drainage improvements are depicted on the enclosed Drainage Plan (Sheet D1). On-site drainage facilities will consist of roadside ditches, grass-lined channels, and culverts. Hydraulic calculations for preliminary sizing of major on-site drainage facilities are enclosed in Appendix C, and design criteria are summarized as follows:

### **1. Culverts**

The internal road system will be graded to drain roadside ditches to low points along the road profile, where cross-culverts will convey developed flows into grass-lined channels following historic drainage paths. Culvert pipes have been specified as reinforced concrete pipe (RCP) with a minimum diameter of 18-inches. Final culvert design calculations were performed utilizing the FHWA HY-8 software package to perform a detailed analysis of inlet and outlet control conditions, meeting El Paso County criteria for allowable headwater depths and overtopping. Riprap outlet protection will be provided at all culverts.

**Provide analyses for all culverts.**

### **2. Open Channels**

Drainage easements will be dedicated along major drainage channels following historic drainage paths through the subdivision. Proposed channel improvements have generally been designed as grass-lined channels designed to convey 100-year flows, with a trapezoidal cross-section, variable bottom width and depth, 4:1 maximum side slopes, one-foot freeboard, and a minimum slope of 0.5 percent.

The proposed drainage channels have been sized utilizing Manning's equation for open channel flow, assuming a friction factor ("n") of 0.030 for dry-land grass channels. Maximum allowable velocities will be evaluated based on El Paso County drainage criteria, typically allowing for a maximum 100-year velocity of 4 feet per second for native grass channels. Erosion control mats have been specified for channel segments with maximum 100-year velocities up to 9 feet per second. The proposed channels will generally be seeded with native grasses for erosion control. Erosion control mats, ditch checks, and/or riprap channel lining will be provided where required based on erosive velocities. Ditch flows will be diverted to drainage channels at the nearest practical location to minimize excessive roadside ditch sizes.

are?

## **F. Analysis of Existing and Proposed Downstream Facilities**

The general concept of the proposed drainage plan is to mitigate developed drainage impacts by routing developed flows through on-site detention ponds. There is no evidence of erosion concerns in the existing natural drainage swales immediately downstream of the site. Recognizing that on-site detention ponds are being constructed to mitigate developed drainage impacts, there is no need for off-site drainage improvements. **Address all culverts.**

## **G. Anticipated Drainage Problems and Solutions**

Stormwater detention ponds have been designed to mitigate the impacts of developed drainage from the Monument Academy project. The overall drainage plan for the subdivision includes a system of storm sewer facilities, roadside ditches, channels, and culverts to convey developed flows through the site. The primary drainage problems anticipated within this development will consist of maintenance of these drainage pipes, channels, culverts, and detention pond facilities. Care will need to be taken to implement proper erosion control measures in the proposed roadside ditches, channels, and swales. **See comment letter.**

Ditches have been designed to meet maximum allowable velocity criteria. Erosion control mats will be installed where necessary to minimize erosion concerns. Proper construction and maintenance of the proposed detention facilities will minimize downstream drainage impacts.

## **VII. EROSION / SEDIMENT CONTROL**

The Contractor will be required to implement Best Management Practices (BMP's) for erosion control through the course of construction. Sediment control measures will include installation of silt fence at the toe of disturbed slopes and hay bales protecting drainage ditches. Cut slopes will be stabilized during excavation as necessary and vegetation will be established for stabilization of disturbed areas as soon as possible. All ditches will be designed to meet El Paso County criteria for slope and velocity.

## **VIII. COST ESTIMATE AND DRAINAGE FEES**

A cost estimate for proposed drainage improvements is enclosed in Appendix E.

The developer will finance all construction costs for proposed roadway and drainage improvements, and public facilities will be owned and maintained by El Paso County upon final acceptance. The proposed detention ponds will be owned and maintained by the Property Owners Association.

This parcel is located in the West Cherry Creek drainage basin. No drainage and bridge fees will be due at time of recordation of the final plat as the subject site is not located in a fee basin.

## **IX. SUMMARY**


The developed drainage patterns associated with the proposed Monument Academy campus and surrounding site development will remain consistent with historic conditions, and new drainage facilities constructed to El Paso County standards will safely convey runoff to suitable outfalls. Developed flows from the site will drain through on-site stormwater detention ponds prior to discharging to the existing downstream drainage system.

The proposed stormwater detention and water quality facilities have been designed to mitigate developed flow impacts and meet the County's stormwater quality requirements. Construction and proper maintenance of the proposed stormwater facilities and detention basins, in conjunction with proper erosion control practices, will ensure that this developed site has no significant adverse drainage impact on downstream or surrounding areas.




**APPENDIX A**  
**SOILS INFORMATION**

Hydrologic Soil Group—El Paso County Area, Colorado  
(Monument Academy Site)

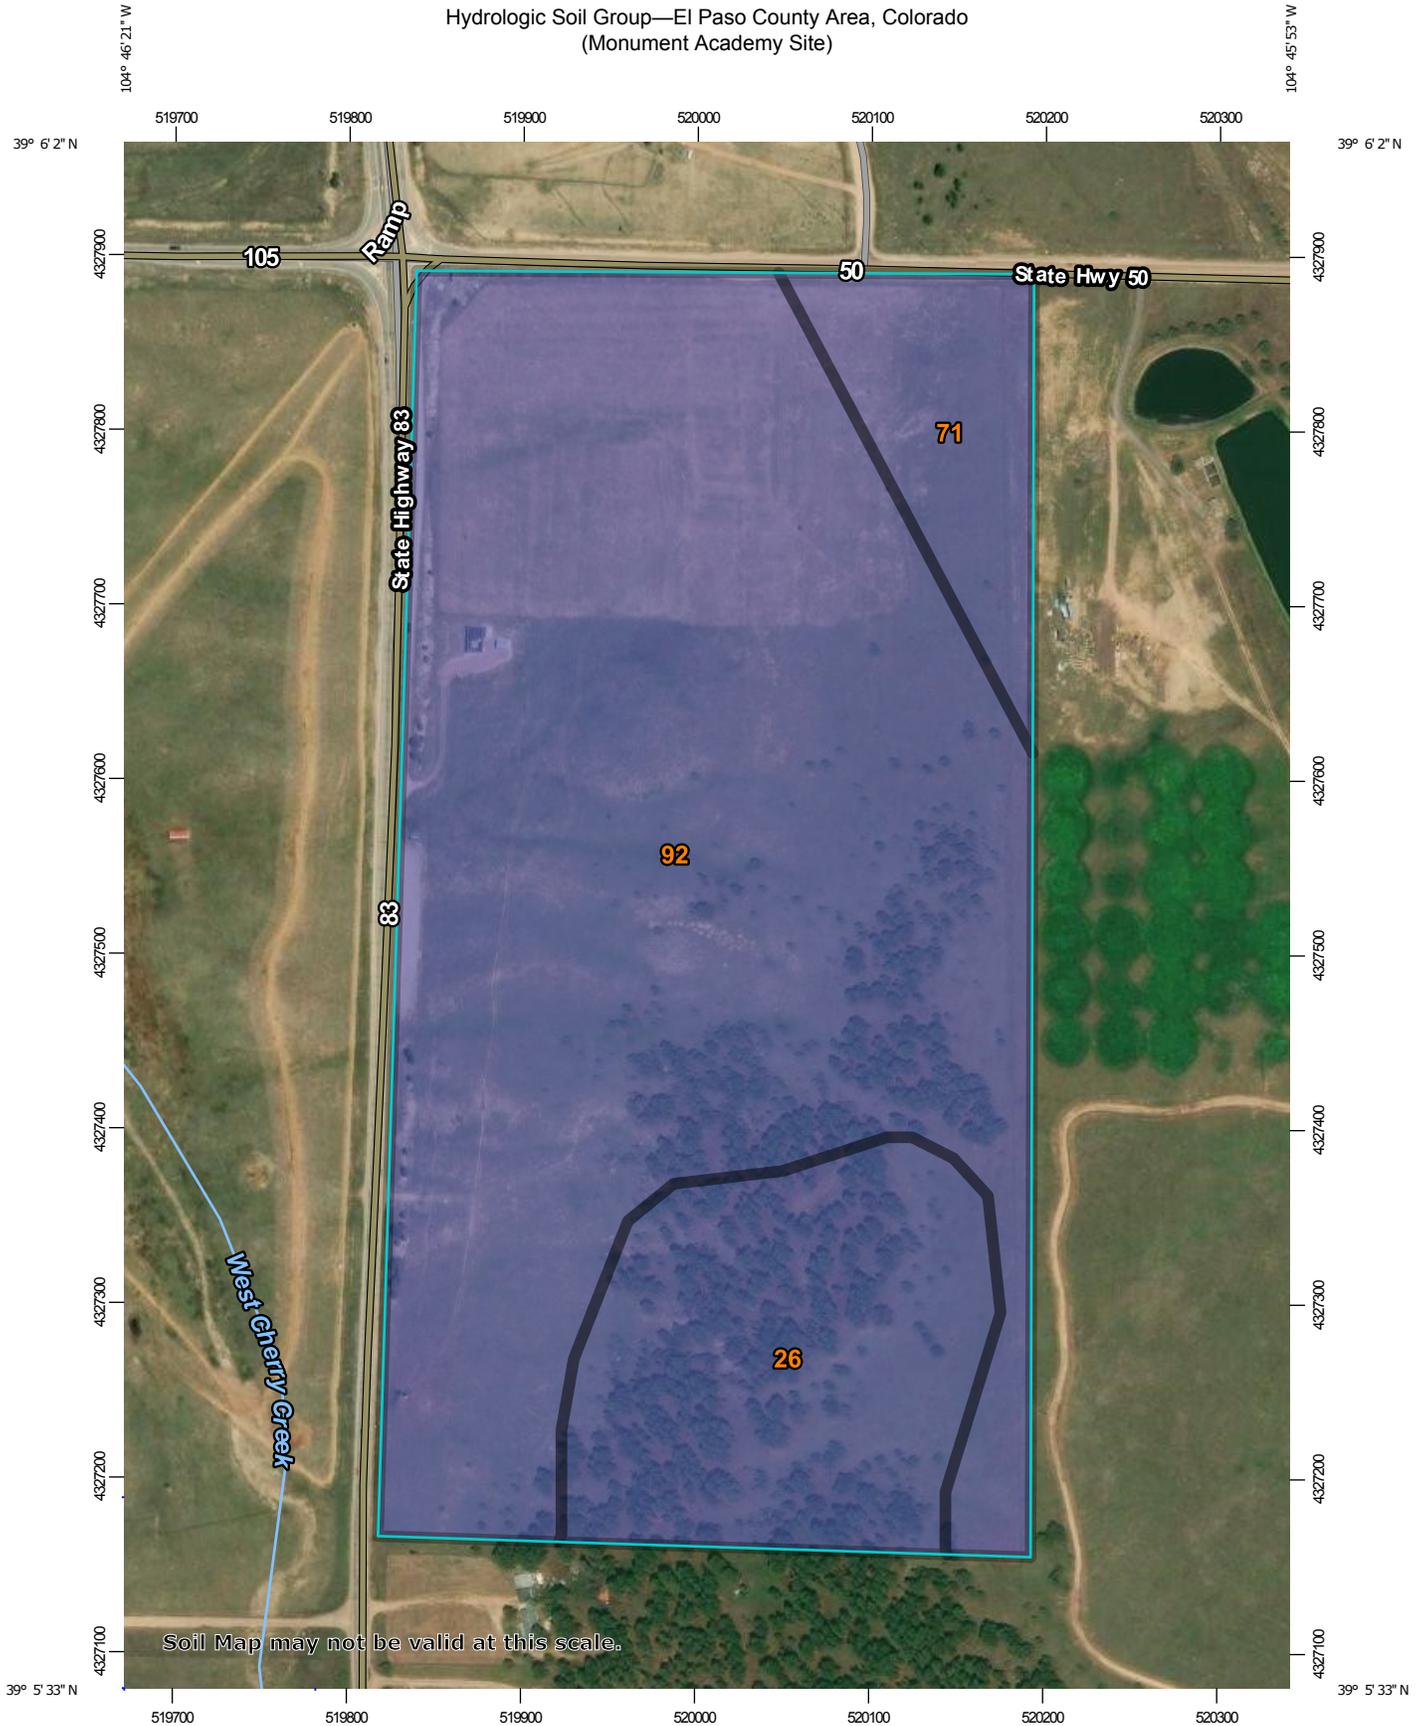

Map Scale: 1:4,320 if printed on A portrait (8.5" x 11") sheet.



## MAP LEGEND

<b>Area of Interest (AOI)</b>	 C
 Area of Interest (AOI)	 C/D
<b>Soils</b>	 D
<b>Soil Rating Polygons</b>	 Not rated or not available
 A	<b>Water Features</b>
 A/D	 Streams and Canals
 B	<b>Transportation</b>
 B/D	 Rails
 C	 Interstate Highways
 C/D	 US Routes
 D	 Major Roads
 Not rated or not available	 Local Roads
<b>Soil Rating Lines</b>	<b>Background</b>
 A	 Aerial Photography
 A/D	
 B	
 B/D	
 C	
 C/D	
 D	
 Not rated or not available	
<b>Soil Rating Points</b>	
 A	
 A/D	
 B	
 B/D	

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
Web Soil Survey URL:  
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
Survey Area Data: Version 16, Sep 10, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jul 4, 2010—Oct 16, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
26	Elbeth sandy loam, 8 to 15 percent slopes	B	12.1	18.4%
71	Pring coarse sandy loam, 3 to 8 percent slopes	B	5.0	7.6%
92	Tomah-Crowfoot loamy sands, 3 to 8 percent slopes	B	48.9	74.1%
<b>Totals for Area of Interest</b>			<b>66.1</b>	<b>100.0%</b>

### Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Higher



United States  
Department of  
Agriculture

**NRCS**

Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for El Paso County Area, Colorado



# Preface

---

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist ([http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2\\_053951](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951)).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

# Contents

---

<b>Preface</b> .....	2
<b>How Soil Surveys Are Made</b> .....	5
<b>Soil Map</b> .....	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
El Paso County Area, Colorado.....	13
26—Elbeth sandy loam, 8 to 15 percent slopes.....	13
71—Pring coarse sandy loam, 3 to 8 percent slopes.....	14
92—Tomah-Crowfoot loamy sands, 3 to 8 percent slopes.....	15
<b>References</b> .....	17

# How Soil Surveys Are Made

---

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

## Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

## Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

# Soil Map


---

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report  
Soil Map



Soil Map may not be valid at this scale.

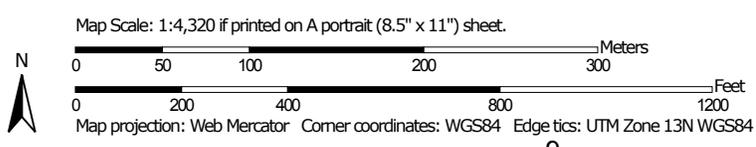

### MAP LEGEND

**Area of Interest (AOI)**

 Area of Interest (AOI)

**Soils**

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

**Special Point Features**

-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features

**Water Features**

 Streams and Canals

**Transportation**

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

**Background**

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 16, Sep 10, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jul 4, 2010—Oct 16, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
26	Elbeth sandy loam, 8 to 15 percent slopes	12.1	18.4%
71	Pring coarse sandy loam, 3 to 8 percent slopes	5.0	7.6%
92	Tomah-Crowfoot loamy sands, 3 to 8 percent slopes	48.9	74.1%
<b>Totals for Area of Interest</b>		<b>66.1</b>	<b>100.0%</b>

## Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or

## Custom Soil Resource Report

landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

## El Paso County Area, Colorado

### 26—Elbeth sandy loam, 8 to 15 percent slopes

#### Map Unit Setting

*National map unit symbol:* 367y  
*Elevation:* 7,300 to 7,600 feet  
*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Elbeth and similar soils:* 85 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Elbeth

##### Setting

*Landform:* Hills  
*Landform position (three-dimensional):* Side slope  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Parent material:* Alluvium derived from arkose

##### Typical profile

*A - 0 to 3 inches:* sandy loam  
*E - 3 to 23 inches:* loamy sand  
*Bt - 23 to 68 inches:* sandy clay loam  
*C - 68 to 74 inches:* sandy clay loam

##### Properties and qualities

*Slope:* 8 to 15 percent  
*Depth to restrictive feature:* More than 80 inches  
*Natural drainage class:* Well drained  
*Runoff class:* Medium  
*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high (0.20 to 0.60 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water storage in profile:* Moderate (about 7.1 inches)

##### Interpretive groups

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 4e  
*Hydrologic Soil Group:* B  
*Hydric soil rating:* No

#### Minor Components

##### Other soils

*Percent of map unit:*  
*Hydric soil rating:* No

##### Pleasant

*Percent of map unit:*  
*Landform:* Depressions  
*Hydric soil rating:* Yes

## 71—Pring coarse sandy loam, 3 to 8 percent slopes

### Map Unit Setting

*National map unit symbol:* 369k  
*Elevation:* 6,800 to 7,600 feet  
*Farmland classification:* Not prime farmland

### Map Unit Composition

*Pring and similar soils:* 85 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

### Description of Pring

#### Setting

*Landform:* Hills  
*Landform position (three-dimensional):* Side slope  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Parent material:* Arkosic alluvium derived from sedimentary rock

#### Typical profile

*A - 0 to 14 inches:* coarse sandy loam  
*C - 14 to 60 inches:* gravelly sandy loam

#### Properties and qualities

*Slope:* 3 to 8 percent  
*Depth to restrictive feature:* More than 80 inches  
*Natural drainage class:* Well drained  
*Runoff class:* Low  
*Capacity of the most limiting layer to transmit water (Ksat):* High (2.00 to 6.00 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water storage in profile:* Low (about 6.0 inches)

#### Interpretive groups

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 3e  
*Hydrologic Soil Group:* B  
*Ecological site:* Loamy Park (R048AY222CO)  
*Hydric soil rating:* No

### Minor Components

#### Pleasant

*Percent of map unit:*  
*Landform:* Depressions  
*Hydric soil rating:* Yes

**Other soils**

*Percent of map unit:*  
*Hydric soil rating:* No

**92—Tomah-Crowfoot loamy sands, 3 to 8 percent slopes**

**Map Unit Setting**

*National map unit symbol:* 36b9  
*Elevation:* 7,300 to 7,600 feet  
*Farmland classification:* Not prime farmland

**Map Unit Composition**

*Tomah and similar soils:* 50 percent  
*Crowfoot and similar soils:* 30 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

**Description of Tomah**

**Setting**

*Landform:* Alluvial fans, hills  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Parent material:* Alluvium derived from arkose and/or residuum weathered from arkose

**Typical profile**

*A - 0 to 10 inches:* loamy sand  
*E - 10 to 22 inches:* coarse sand  
*C - 48 to 60 inches:* coarse sand

**Properties and qualities**

*Slope:* 3 to 8 percent  
*Depth to restrictive feature:* More than 80 inches  
*Natural drainage class:* Well drained  
*Runoff class:* Medium  
*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high (0.60 to 2.00 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water storage in profile:* Very low (about 2.0 inches)

**Interpretive groups**

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 4e  
*Hydrologic Soil Group:* B  
*Ecological site:* Sandy Divide (R049BY216CO)  
*Hydric soil rating:* No

**Description of Crowfoot**

**Setting**

*Landform:* Alluvial fans, hills  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Parent material:* Alluvium

**Typical profile**

*A - 0 to 12 inches:* loamy sand  
*E - 12 to 23 inches:* sand  
*Bt - 23 to 36 inches:* sandy clay loam  
*C - 36 to 60 inches:* coarse sand

**Properties and qualities**

*Slope:* 3 to 8 percent  
*Depth to restrictive feature:* More than 80 inches  
*Natural drainage class:* Well drained  
*Runoff class:* Medium  
*Capacity of the most limiting layer to transmit water (Ksat):* Moderately high to high (0.60 to 2.00 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water storage in profile:* Low (about 4.7 inches)

**Interpretive groups**

*Land capability classification (irrigated):* None specified  
*Land capability classification (nonirrigated):* 4e  
*Hydrologic Soil Group:* B  
*Ecological site:* Sandy Divide (R049BY216CO)  
*Hydric soil rating:* No

**Minor Components**

**Other soils**

*Percent of map unit:*  
*Hydric soil rating:* No

**Pleasant**

*Percent of map unit:*  
*Landform:* Depressions  
*Hydric soil rating:* Yes

# References

---

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_054262](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262)
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053577](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577)
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053580](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580)
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2\\_053374](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374)
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

## Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2\\_054242](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242)

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053624](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624)

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. [http://www.nrcs.usda.gov/Internet/FSE\\_DOCUMENTS/nrcs142p2\\_052290.pdf](http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf)

**APPENDIX B**  
**HYDROLOGIC CALCULATIONS**

**Table 6-6. Runoff Coefficients for Rational Method**

(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

### 3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration ( $t_c$ ) consists of an initial time or overland flow time ( $t_i$ ) plus the travel time ( $t_r$ ) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time ( $t_i$ ) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion ( $t_r$ ) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

$$t_c = t_i + t_t \quad (\text{Eq. 6-7})$$

Where:

$t_c$  = time of concentration (min)

$t_i$  = overland (initial) flow time (min)

$t_t$  = travel time in the ditch, channel, gutter, storm sewer, etc. (min)

### 3.2.1 Overland (Initial) Flow Time

The overland flow time,  $t_i$ , may be calculated using Equation 6-8.

$$t_i = \frac{0.395(1.1 - C_5)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_5$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

**Table 6-7. Conveyance Coefficient,  $C_v$** 

Type of Land Surface	$C_v$
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

\* For buried riprap, select  $C_v$  value based on type of vegetative cover.

The travel time is calculated by dividing the flow distance (in feet) by the velocity calculated using Equation 6-9 and converting units to minutes.

The time of concentration ( $t_c$ ) is then the sum of the overland flow time ( $t_i$ ) and the travel time ( $t_t$ ) per Equation 6-7.

### 3.2.3 First Design Point Time of Concentration in Urban Catchments

Using this procedure, the time of concentration at the first design point (typically the first inlet in the system) in an urbanized catchment should not exceed the time of concentration calculated using Equation 6-10. The first design point is defined as the point where runoff first enters the storm sewer system.

$$t_c = \frac{L}{180} + 10 \quad (\text{Eq. 6-10})$$

Where:

$t_c$  = maximum time of concentration at the first design point in an urban watershed (min)

$L$  = waterway length (ft)

Equation 6-10 was developed using the rainfall-runoff data collected in the Denver region and, in essence, represents regional “calibration” of the Rational Method. Normally, Equation 6-10 will result in a lesser time of concentration at the first design point and will govern in an urbanized watershed. For subsequent design points, the time of concentration is calculated by accumulating the travel times in downstream drainageway reaches.


### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

### 3.2.5 Post-Development Time of Concentration

As Equation 6-8 indicates, the time of concentration is a function of the 5-year runoff coefficient for a drainage basin. Typically, higher levels of imperviousness (higher 5-year runoff coefficients) correspond to shorter times of concentration, and lower levels of imperviousness correspond to longer times of

**Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency**

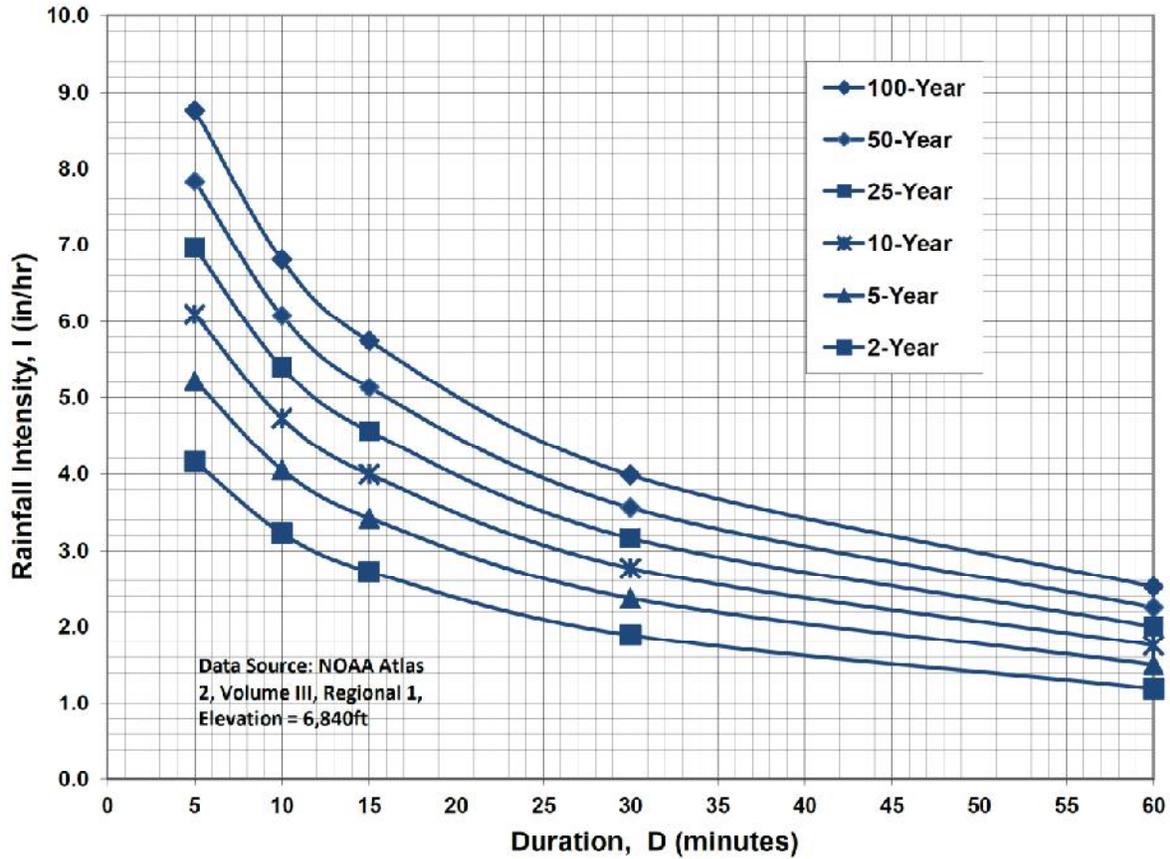

**IDF Equations**

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$

$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$

$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.

MONUMENT ACADEMY  
COMPOSITE RUNOFF COEFFICIENTS

DEVELOPED CONDITIONS										
5-YEAR C VALUES										
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	C	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	C	(AC)	SUB-AREA 3 DEVELOPMENT/ COVER	WEIGHTED C VALUE
C14	15.86	4.29	BUILDING / PAVEMENT	0.90	11.57	LANDSCAPED	0.08			0.302
M1	4.53	4.53	NH BUSINESS	0.49						0.490
M2	7.48	4.78	BUILDING / PAVEMENT	0.90	2.70	LANDSCAPED	0.08			0.604
M3	11.31	9.66	NH BUSINESS	0.49	1.65	POND / LANDSCAPE	0.08			0.430
M2,M3	18.79									0.499
M4	21.78	10.89	RESIDENTIAL-0.5-AC	0.22	10.89	RESIDENTIAL-1-AC	0.2			0.210
100-YEAR C VALUES										
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	C	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	C	(AC)	SUB-AREA 3 DEVELOPMENT/ COVER	WEIGHTED C VALUE
C14	15.86	4.29	BUILDING / PAVEMENT	0.96	11.57	LANDSCAPED	0.35			0.515
M1	4.53	4.53	NH BUSINESS	0.62						0.620
M2	7.48	4.78	BUILDING / PAVEMENT	0.96	2.70	LANDSCAPED	0.35			0.740
M3	11.31	9.66	NH BUSINESS	0.62	1.65	POND / LANDSCAPE	0.35			0.581
M2,M3	18.79									0.644
M4	21.78	10.89	RESIDENTIAL-0.5-AC	0.46	10.89	RESIDENTIAL-1-AC	0.44			0.450

MONUMENT ACADEMY  
RATIONAL METHOD

HISTORIC FLOWS

BASIN	DESIGN POINT	AREA (AC)	C		Overland Flow			Channel flow				TOTAL		INTENSITY <sup>(5)</sup>		PEAK FLOW		
			5-YEAR	100-YEAR	LENGTH (FT)	SLOPE (FT/FT)	T <sub>co</sub> <sup>(1)</sup> (MIN)	CHANNEL LENGTH (FT)	CONVEYANCE COEFFICIENT C	SLOPE (FT/FT)	SCS <sup>(2)</sup> VELOCITY (FT/S)	T <sub>t</sub> <sup>(3)</sup> (MIN)	T <sub>c</sub> <sup>(4)</sup> (MIN)	T <sub>c</sub> <sup>(4)</sup> (MIN)	5-YR (IN/HR)	100-YR (IN/HR)	Q5 <sup>(6)</sup> (CFS)	Q100 <sup>(6)</sup> (CFS)
C14	C14	18.30	0.080	0.350	300	0.050	18.9	1350	15	0.044	3.15	7.2	26.1	2.69	4.52	3.9	28.9	
M1	M1	7.40	0.080	0.350	300	0.023	24.5	480	15	0.060	3.67	2.2	26.7	2.66	4.46	1.6	11.5	
M3	M3	15.00	0.080	0.350	100	0.050	10.9	660	15	0.065	3.82	2.9	13.8	3.65	6.12	4.4	32.1	
M4	M4	21.00	0.080	0.350	300	0.053	18.6	1160	15	0.050	3.35	5.8	24.3	2.80	4.69	4.7	34.5	

DEVELOPED FLOWS

BASIN	DESIGN POINT	AREA (AC)	C		Overland Flow			Channel flow				TOTAL		INTENSITY <sup>(5)</sup>		PEAK FLOW		
			5-YEAR	100-YEAR	LENGTH (FT)	SLOPE (FT/FT)	T <sub>co</sub> <sup>(1)</sup> (MIN)	CHANNEL LENGTH (FT)	CONVEYANCE COEFFICIENT C	SLOPE (FT/FT)	SCS <sup>(2)</sup> VELOCITY (FT/S)	T <sub>t</sub> <sup>(3)</sup> (MIN)	T <sub>c</sub> <sup>(4)</sup> (MIN)	T <sub>c</sub> <sup>(4)</sup> (MIN)	5-YR (IN/HR)	100-YR (IN/HR)	Q5 <sup>(6)</sup> (CFS)	Q100 <sup>(6)</sup> (CFS)
C14	C14	15.86	0.302	0.515	100	0.020	11.6	1550	20	0.044	4.20	6.2	17.8	3.27	5.49	15.7	44.8	
M1	M1	4.53	0.490	0.620	100	0.010	11.2	680	20	0.052	4.56	2.5	13.7	3.66	6.15	8.1	17.3	
M2	M2	7.48	0.604	0.740	100	0.040	5.7	670	20	0.031	3.52	3.2	8.9	4.30	7.23	19.4	40.0	
M3	M3	11.31	0.430	0.581	100	0.020	9.7	600	20	0.053	4.60	2.2	11.9	3.87	6.49	18.8	42.7	
M2,M3	M3	18.79	0.499	0.644			0.0	450	20	0.071	5.33	1.4	10.3	4.08	6.86	38.3	83.0	
M4	M4	21.78	0.210	0.450	100	0.020	12.9	1500	15	0.047	3.25	7.7	20.6	3.04	5.11	13.9	50.1	

1) OVERLAND FLOW T<sub>co</sub> = (0.395\*(1.1-RUNOFF COEFFICIENT)\*(OVERLAND FLOW LENGTH<sup>0.5</sup>)/(SLOPE<sup>0.333</sup>))

2) SCS VELOCITY = C \* ((SLOPE/FT)<sup>0.5</sup>)

C = 2.5 FOR HEAVY MEADOW

C = 5 FOR TILLAGE/FIELD

C = 7 FOR SHORT PASTURE AND LAWNS

C = 10 FOR NEARLY BARE GROUND

C = 15 FOR GRASSED WATERWAY

C = 20 FOR PAVED AREAS AND SHALLOW PAVED SWALES

3) MANNING'S CHANNEL TRAVEL TIME = L/V (WHEN CHANNEL VELOCITY IS KNOWN)

4) T<sub>c</sub> = T<sub>co</sub> + T<sub>t</sub>

\*\*\* IF TOTAL TIME OF CONCENTRATION IS LESS THAN 5 MINUTES, THEN 5 MINUTES IS USED

5) INTENSITY BASED ON I-D-F EQUATIONS IN CITY OF COLORADO SPRINGS DRAINAGE CRITERIA MANUAL

$I_5 = -1.5 * \ln(T_c) + 7.583$

$I_{100} = -2.52 * \ln(T_c) + 12.735$

6) Q = C/A

## **APPENDIX C1**

### **HYDRAULIC CALCULATIONS - CHANNELS**

Also provide for channel downstream of Pond C14.

**ALLOWABLE VELOCITY AND MAXIMUM SHEAR STRESS  
Streambank and Shoreland Protection Code 580**

Type of Treatment	Allowable Shear lb/sq ft	Velocity ft/sec
<b>Brush Mattresses<sup>1</sup></b>		
Staked only w/ rock riprap toe (initial)	0.8 - 4.1	5
Staked only w/ rock riprap toe (grown)	4.0 - 8.0	12
<b>Coir Geotextile Roll<sup>2</sup></b>		
Roll with coir rope mesh staked only without rock riprap toe	0.2 - 0.8	< 5
Roll with Polypropylene rope mesh staked only without rock riprap toe	0.8 - 3.0	< 8
Roll with Polypropylene rope mesh staked and with rock riprap toe	3.0 - 4.0	< 12
<b>Live Fascine<sup>3</sup></b>		
LF Bundle w/ rock riprap toe	2.0 - 3.1	8
<b>Soils<sup>4</sup></b>		
Fine colloidal sand	0.02-0.03	1.5
Sandy loam (noncolloidal)	0.03-0.04	1.75
Alluvial silt (noncolloidal)	0.045-0.05	2
Silty loam (noncolloidal)	0.045-0.05	1.75-2.25
Firm loam	0.075	2.5
Fine gravels	0.075	2.5
Stiff clay	0.26	3-4.5
Alluvial silt (colloidal)	0.26	3.75
Graded loam to cobbles	0.38	3.75
Graded silts to cobbles	0.43	4
Shales and hardpan	0.67	6
<b>Gravel/Cobble<sup>4</sup></b>		
1-inch	0.33	2.5-5
2-inch	0.67	3-6
6-inch	2	4-7.5
12-inch	4	5.5-12
<b>Vegetation<sup>4</sup></b>		
Class A turf (ret class)	3.7	6-8
Class B turf (ret class)	2.1	4-7
Class C turf (ret class)	1	3.5
Retardance Class D	0.6	Design of roadside channels HEC-15
Retardance Class E	0.35	
Long native grasses	1.2-1.7	4-6
Short native and bunch grass	0.7-0.95	3-4

The complete line of RollMax™ products offers a variety of options for both short-term and permanent erosion control needs. Reference the RollMax Products Chart below to find the right solution for your next project.



## RollMax Product Selection Chart

This is not permanent.

	TEMPORARY						
	ERONET					BIONET	
	DS75	DS150	S75	S150	SC150	C125	S75BN
<b>Longevity</b>	45 days	60 days	12 mo.	12 mo.	24 mo.	36 mo.	12 mo.
<b>Applications</b>	Low Flow Channels 4:1-3:1 Slopes	Moderate Flow Channels 3:1-2:1 Slopes	Low Flow Channels 4:1-3:1 Slopes	Moderate Flow Channels 3:1-2:1 Slopes	Medium Flow Channels 2:1-1:1 Slopes	High-Flow Channels 1:1 and Greater Slopes	Low Flow Channels 4:1-3:1 Slopes
<b>Design Permissible Shear Stress</b> lbs/ft <sup>2</sup> (Pa)	Unvegetated 1.55 (74)	Unvegetated 1.75 (84)	Unvegetated 1.55 (74)	Unvegetated 1.75 (84)	Unvegetated 2.00 (96)	Unvegetated 2.25 (108)	Unvegetated 1.60 (76)
<b>Design Permissible Velocity</b> ft/s (m/s)	Unvegetated 5.00 (1.52)	Unvegetated 6.00 (1.52)	Unvegetated 5.00 (1.2)	Unvegetated 6.00 (1.83)	Unvegetated 8.00 (2.44)	Unvegetated 10.00 (3.05)	Unvegetated 5.00 (1.52)
<b>Top Net</b>	Lightweight accelerated photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	Lightweight accelerated photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	Lightweight photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	Lightweight photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	Heavyweight UV-stabilized polypropylene 2.9 lbs/1000 ft <sup>2</sup> (1.47 kg/100 m <sup>2</sup> ) approx wt	Heavyweight UV-stabilized polypropylene 2.9 lbs/1000 ft <sup>2</sup> (1.47 kg/100 m <sup>2</sup> ) approx wt	Leno woven, 100% biodegradable jute fiber 9.30 lbs/1000 ft <sup>2</sup> (4.53 kg/100 m <sup>2</sup> ) approx wt
<b>Center Net</b>	N/A	N/A	N/A	N/A	N/A	N/A	N/A
<b>Fiber Matrix</b>	Straw fiber 0.50 lbs/yd <sup>2</sup> (0.27 kg/m <sup>2</sup> )	Straw fiber 0.50 lbs/yd <sup>2</sup> (0.27 kg/m <sup>2</sup> )	Straw fiber 0.50 lbs/yd <sup>2</sup> (0.27 kg/m <sup>2</sup> )	Straw fiber 0.50 lbs/yd <sup>2</sup> (0.27 kg/m <sup>2</sup> )	Straw/coconut matrix 70% Straw 0.35 lbs/yd <sup>2</sup> (0.19 kg/m <sup>2</sup> ) 30% Coconut 0.15 lbs/yd <sup>2</sup> (0.08 kg/m <sup>2</sup> )	Coconut fiber 0.50 lbs/yd <sup>2</sup> (0.27 kg/m <sup>2</sup> )	Straw fiber 0.50 lbs/yd <sup>2</sup> (0.27 kg/m <sup>2</sup> )
<b>Bottom Net</b>	N/A	Lightweight accelerated photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	N/A	Lightweight photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	Lightweight photodegradable polypropylene 1.50 lbs/1000 ft <sup>2</sup> (0.73 kg/100 m <sup>2</sup> ) approx wt	Heavyweight UV-stabilized polypropylene 2.9 lbs/1000 ft <sup>2</sup> (1.47 kg/100 m <sup>2</sup> ) approx wt	N/A
<b>Thread</b>	Accelerated degradable	Accelerated degradable	Degradable	Degradable	Degradable	UV-stabilized polypropylene	Biodegradable

MONUMENT ACADEMY  
DITCH CALCULATION SUMMARY

PROPOSED ROADSIDE DITCHES

ROADWAY	FROM STA	TO STA	SIDE	PROPOSED SLOPE (%)	SIDE SLOPE (Z)	CHANNEL DEPTH (FT)	FRICTION FACTOR (n)	ROW WIDTH (ft)	BASIN	Q100 FLOW (CFS)	DITCH FLOW % OF BASIN	DITCH FLOW (CFS)	Q100 DEPTH (FT)	Q100 VELOCITY (FT/S)	DITCH LINING
PINEHURST CIRCLE	10+96	16+39	N	8.00	4:1/3:1	2.5	0.030	60	M3	83.0	10	8.3	0.6	6.2	GRASS / ECB
PINEHURST CIRCLE	10+96	16+39	S	8.00	4:1/3:1	2.5	0.030	60	M4	50.1	5	2.5	0.4	4.6	GRASS / ECB
PINEHURST CIRCLE	16+39	17+97	N	4.00	4:1/3:1	2.5	0.030	60	M2	40.0	10	4.0	0.5	4.0	GRASS / ECB
PINEHURST CIRCLE	16+39	17+97	S	4.00	4:1/3:1	2.5	0.030	60	M4	50.1	5	2.5	0.5	3.6	GRASS
PINEHURST CIRCLE	17+97	21+97	N	8.00	4:1/3:1	2.5	0.030	60	M2	40.0	5	2.0	0.4	4.4	GRASS / ECB
PINEHURST CIRCLE	17+97	21+97	S	8.00	4:1/3:1	2.5	0.030	60	M4	50.1	5	2.5	0.4	4.6	GRASS / ECB
PINEHURST CIRCLE	21+97	24+41	N	4.00	4:1/3:1	2.5	0.030	60	C14	44.8	5	2.2	0.4	3.4	GRASS
PINEHURST CIRCLE	21+97	24+41	S	4.00	4:1/3:1	2.5	0.030	60	M4	50.1	5	2.5	0.5	3.6	GRASS
ROAD A	10+00	10+84	E	1.00	4:1/3:1	2.5	0.030	60	M2	40.0	20	8.0	0.9	2.8	GRASS
ROAD A	10+00	10+84	W	1.00	4:1/3:1	2.5	0.030	60	M3	83.0	5	4.2	0.7	2.4	GRASS
ROAD A	10+84	12+50	E	1.00	4:1/3:1	2.5	0.030	60	M2	40.0	10	4.0	0.7	2.4	GRASS
ROAD A	10+84	12+50	W	1.00	4:1/3:1	2.5	0.030	60	M3	83.0	5	4.2	0.7	2.4	GRASS
ROAD A	12+50	13+75	E	1.00	4:1/3:1	2.5	0.030	60	M2	40.0	15	6.0	0.8	2.6	GRASS
ROAD A	12+50	13+75	W	1.00	4:1/3:1	2.5	0.030	60	M3	83.0	5	4.2	0.7	2.4	GRASS
ROAD A	13+75	18+11	E	1.00	4:1/3:1	2.5	0.030	60	M2	40.0	10	4.0	0.7	2.4	GRASS
ROAD A	13+75	18+11	W	1.00	4:1/3:1	2.5	0.030	60	M3	83.0	5	4.2	0.7	2.4	GRASS
ROAD A	18+11	25+60	E	4.00	4:1/3:1	2.5	0.030	60	C14	44.8	10	4.5	0.6	4.1	GRASS / ECB
ROAD A	18+11	25+60	W	4.00	4:1/3:1	2.5	0.030	60	M1	17.3	10	1.7	0.4	3.2	GRASS
ROAD A	25+60	26+00	E	1.00	4:1/3:1	2.5	0.030	60	C14	44.8	20	9.0	0.9	2.9	GRASS
ROAD A	25+60	26+00	W	1.00	4:1/3:1	2.5	0.030	60	M1	17.3	10	1.7	0.5	1.9	GRASS

1) Channel flow calculations based on Manning's Equation

2) n = 0.03 for grass-lined non-irrigated channels

3) Vmax = 4.0 fps for 100-year flows w/ native grass-lined channels (per ECM Table 10-4 & NRCS Companion Document 580-10)

4) Vmax = 8.0 fps for 100-year flows w/ Erosion Control Blankets (Tensar Eronet SC150 or equal)

# Hydraulic Analysis Report

## Project Data

Project Title: Project-MA-Ditches  
Designer: JPS  
Project Date: Tuesday, February 5, 2019  
Project Units: U.S. Customary Units  
Notes:

## Channel Analysis: Pinehurst-1096-1639-N

Notes:

## Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0800 ft/ft  
Manning's n: 0.0300  
Flow: 8.3000 cfs

## Result Parameters

Depth: 0.6170 ft  
Area of Flow: 1.3326 ft<sup>2</sup>  
Wetted Perimeter: 4.4953 ft  
Hydraulic Radius: 0.2964 ft  
Average Velocity: 6.2286 ft/s  
Top Width: 4.3192 ft  
Froude Number: 1.9762  
Critical Depth: 0.8136 ft  
Critical Velocity: 3.5822 ft/s  
Critical Slope: 0.0183 ft/ft  
Critical Top Width: 5.81 ft  
Calculated Max Shear Stress: 3.0802 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 1.4798 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-1096-1639-S

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0800 ft/ft  
Manning's n: 0.0300  
Flow: 2.5000 cfs

### Result Parameters

Depth: 0.3934 ft  
Area of Flow: 0.5418 ft<sup>2</sup>  
Wetted Perimeter: 2.8664 ft  
Hydraulic Radius: 0.1890 ft  
Average Velocity: 4.6143 ft/s  
Top Width: 2.7541 ft  
Froude Number: 1.8334  
Critical Depth: 0.5035 ft  
Critical Velocity: 2.8179 ft/s  
Critical Slope: 0.0215 ft/ft  
Critical Top Width: 3.60 ft  
Calculated Max Shear Stress: 1.9641 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.9436 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-1639-1797-N

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0400 ft/ft  
Manning's n: 0.0300  
Flow: 4.0000 cfs

### Result Parameters

Depth: 0.5344 ft  
Area of Flow: 0.9996 ft<sup>2</sup>  
Wetted Perimeter: 3.8933 ft  
Hydraulic Radius: 0.2567 ft  
Average Velocity: 4.0018 ft/s  
Top Width: 3.7408 ft  
Froude Number: 1.3643  
Critical Depth: 0.6076 ft  
Critical Velocity: 3.0956 ft/s  
Critical Slope: 0.0202 ft/ft  
Critical Top Width: 4.34 ft  
Calculated Max Shear Stress: 1.3339 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.6408 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-1639-1797-S

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0400 ft/ft  
Manning's n: 0.0300  
Flow: 2.5000 cfs

### Result Parameters

Depth: 0.4480 ft  
Area of Flow: 0.7026 ft<sup>2</sup>  
Wetted Perimeter: 3.2642 ft  
Hydraulic Radius: 0.2152 ft  
Average Velocity: 3.5581 ft/s  
Top Width: 3.1363 ft  
Froude Number: 1.3248  
Critical Depth: 0.5035 ft  
Critical Velocity: 2.8179 ft/s  
Critical Slope: 0.0215 ft/ft  
Critical Top Width: 3.60 ft  
Calculated Max Shear Stress: 1.1183 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.5373 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-1797-2197-N

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0800 ft/ft  
Manning's n: 0.0300  
Flow: 2.0000 cfs

### Result Parameters

Depth: 0.3619 ft  
Area of Flow: 0.4583 ft<sup>2</sup>  
Wetted Perimeter: 2.6363 ft  
Hydraulic Radius: 0.1738 ft  
Average Velocity: 4.3640 ft/s  
Top Width: 2.5330 ft  
Froude Number: 1.8080  
Critical Depth: 0.4605 ft  
Critical Velocity: 2.6949 ft/s  
Critical Slope: 0.0221 ft/ft  
Critical Top Width: 3.29 ft  
Calculated Max Shear Stress: 1.8064 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.8678 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-1797-2197-S

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0800 ft/ft  
Manning's n: 0.0300  
Flow: 2.5000 cfs

### Result Parameters

Depth: 0.3934 ft  
Area of Flow: 0.5418 ft<sup>2</sup>  
Wetted Perimeter: 2.8664 ft  
Hydraulic Radius: 0.1890 ft  
Average Velocity: 4.6143 ft/s  
Top Width: 2.7541 ft  
Froude Number: 1.8334  
Critical Depth: 0.5035 ft  
Critical Velocity: 2.8179 ft/s  
Critical Slope: 0.0215 ft/ft  
Critical Top Width: 3.60 ft  
Calculated Max Shear Stress: 1.9641 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.9436 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-2197-2441-N

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0400 ft/ft  
Manning's n: 0.0300  
Flow: 2.2000 cfs

### Result Parameters

Depth: 0.4271 ft  
Area of Flow: 0.6384 ft<sup>2</sup>  
Wetted Perimeter: 3.1114 ft  
Hydraulic Radius: 0.2052 ft  
Average Velocity: 3.4462 ft/s  
Top Width: 2.9895 ft  
Froude Number: 1.3142  
Critical Depth: 0.4784 ft  
Critical Velocity: 2.7468 ft/s  
Critical Slope: 0.0218 ft/ft  
Critical Top Width: 3.42 ft  
Calculated Max Shear Stress: 1.0660 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.5121 lb/ft<sup>2</sup>

## Channel Analysis: Pinehurst-2197-2441-S

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0400 ft/ft  
Manning's n: 0.0300  
Flow: 2.5000 cfs

### Result Parameters

Depth: 0.4480 ft  
Area of Flow: 0.7026 ft<sup>2</sup>  
Wetted Perimeter: 3.2642 ft  
Hydraulic Radius: 0.2152 ft  
Average Velocity: 3.5581 ft/s  
Top Width: 3.1363 ft  
Froude Number: 1.3248  
Critical Depth: 0.5035 ft  
Critical Velocity: 2.8179 ft/s  
Critical Slope: 0.0215 ft/ft  
Critical Top Width: 3.60 ft  
Calculated Max Shear Stress: 1.1183 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.5373 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1000-1084-E

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 8.0000 cfs

### Result Parameters

Depth: 0.8988 ft  
Area of Flow: 2.8272 ft<sup>2</sup>  
Wetted Perimeter: 6.5478 ft  
Hydraulic Radius: 0.4318 ft  
Average Velocity: 2.8297 ft/s  
Top Width: 6.2913 ft  
Froude Number: 0.7439  
Critical Depth: 0.8017 ft  
Critical Velocity: 3.5559 ft/s  
Critical Slope: 0.0184 ft/ft  
Critical Top Width: 5.73 ft  
Calculated Max Shear Stress: 0.5608 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2694 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1000-1084-W

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 4.2000 cfs

### Result Parameters

Depth: 0.7058 ft  
Area of Flow: 1.7437 ft<sup>2</sup>  
Wetted Perimeter: 5.1423 ft  
Hydraulic Radius: 0.3391 ft  
Average Velocity: 2.4087 ft/s  
Top Width: 4.9408 ft  
Froude Number: 0.7145  
Critical Depth: 0.6196 ft  
Critical Velocity: 3.1260 ft/s  
Critical Slope: 0.0200 ft/ft  
Critical Top Width: 4.43 ft  
Calculated Max Shear Stress: 0.4404 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2116 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1084-1250-E

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 4.0000 cfs

### Result Parameters

Depth: 0.6930 ft  
Area of Flow: 1.6811 ft<sup>2</sup>  
Wetted Perimeter: 5.0490 ft  
Hydraulic Radius: 0.3329 ft  
Average Velocity: 2.3795 ft/s  
Top Width: 4.8513 ft  
Froude Number: 0.7123  
Critical Depth: 0.6076 ft  
Critical Velocity: 3.0956 ft/s  
Critical Slope: 0.0202 ft/ft  
Critical Top Width: 4.34 ft  
Calculated Max Shear Stress: 0.4325 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2078 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1084-1250-W

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 4.2000 cfs

### Result Parameters

Depth: 0.7058 ft  
Area of Flow: 1.7437 ft<sup>2</sup>  
Wetted Perimeter: 5.1423 ft  
Hydraulic Radius: 0.3391 ft  
Average Velocity: 2.4087 ft/s  
Top Width: 4.9408 ft  
Froude Number: 0.7145  
Critical Depth: 0.6196 ft  
Critical Velocity: 3.1260 ft/s  
Critical Slope: 0.0200 ft/ft  
Critical Top Width: 4.43 ft  
Calculated Max Shear Stress: 0.4404 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2116 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1250-1375-E

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 6.0000 cfs

### Result Parameters

Depth: 0.8068 ft  
Area of Flow: 2.2785 ft<sup>2</sup>  
Wetted Perimeter: 5.8782 ft  
Hydraulic Radius: 0.3876 ft  
Average Velocity: 2.6333 ft/s  
Top Width: 5.6479 ft  
Froude Number: 0.7306  
Critical Depth: 0.7146 ft  
Critical Velocity: 3.3571 ft/s  
Critical Slope: 0.0191 ft/ft  
Critical Top Width: 5.11 ft  
Calculated Max Shear Stress: 0.5035 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2419 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1250-1375-W

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 4.2000 cfs

### Result Parameters

Depth: 0.7058 ft  
Area of Flow: 1.7437 ft<sup>2</sup>  
Wetted Perimeter: 5.1423 ft  
Hydraulic Radius: 0.3391 ft  
Average Velocity: 2.4087 ft/s  
Top Width: 4.9408 ft  
Froude Number: 0.7145  
Critical Depth: 0.6196 ft  
Critical Velocity: 3.1260 ft/s  
Critical Slope: 0.0200 ft/ft  
Critical Top Width: 4.43 ft  
Calculated Max Shear Stress: 0.4404 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2116 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1375-1811-E

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 4.0000 cfs

### Result Parameters

Depth: 0.6930 ft  
Area of Flow: 1.6811 ft<sup>2</sup>  
Wetted Perimeter: 5.0490 ft  
Hydraulic Radius: 0.3329 ft  
Average Velocity: 2.3795 ft/s  
Top Width: 4.8513 ft  
Froude Number: 0.7123  
Critical Depth: 0.6076 ft  
Critical Velocity: 3.0956 ft/s  
Critical Slope: 0.0202 ft/ft  
Critical Top Width: 4.34 ft  
Calculated Max Shear Stress: 0.4325 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2078 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1375-1811-W

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 4.2000 cfs

### Result Parameters

Depth: 0.7058 ft  
Area of Flow: 1.7437 ft<sup>2</sup>  
Wetted Perimeter: 5.1423 ft  
Hydraulic Radius: 0.3391 ft  
Average Velocity: 2.4087 ft/s  
Top Width: 4.9408 ft  
Froude Number: 0.7145  
Critical Depth: 0.6196 ft  
Critical Velocity: 3.1260 ft/s  
Critical Slope: 0.0200 ft/ft  
Critical Top Width: 4.43 ft  
Calculated Max Shear Stress: 0.4404 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2116 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1811-2560-E

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0400 ft/ft  
Manning's n: 0.0300  
Flow: 4.5000 cfs

### Result Parameters

Depth: 0.5585 ft  
Area of Flow: 1.0919 ft<sup>2</sup>  
Wetted Perimeter: 4.0692 ft  
Hydraulic Radius: 0.2683 ft  
Average Velocity: 4.1214 ft/s  
Top Width: 3.9098 ft  
Froude Number: 1.3744  
Critical Depth: 0.6369 ft  
Critical Velocity: 3.1694 ft/s  
Critical Slope: 0.0199 ft/ft  
Critical Top Width: 4.55 ft  
Calculated Max Shear Stress: 1.3941 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.6697 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-1811-2560-W

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0400 ft/ft  
Manning's n: 0.0300  
Flow: 1.7000 cfs

### Result Parameters

Depth: 0.3877 ft  
Area of Flow: 0.5261 ft<sup>2</sup>  
Wetted Perimeter: 2.8247 ft  
Hydraulic Radius: 0.1863 ft  
Average Velocity: 3.2311 ft/s  
Top Width: 2.7140 ft  
Froude Number: 1.2932  
Critical Depth: 0.4315 ft  
Critical Velocity: 2.6087 ft/s  
Critical Slope: 0.0226 ft/ft  
Critical Top Width: 3.08 ft  
Calculated Max Shear Stress: 0.9677 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.4649 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-2560-2600-E

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 9.0000 cfs

### Result Parameters

Depth: 0.9393 ft  
Area of Flow: 3.0883 ft<sup>2</sup>  
Wetted Perimeter: 6.8435 ft  
Hydraulic Radius: 0.4513 ft  
Average Velocity: 2.9142 ft/s  
Top Width: 6.5754 ft  
Froude Number: 0.7494  
Critical Depth: 0.8404 ft  
Critical Velocity: 3.6407 ft/s  
Critical Slope: 0.0181 ft/ft  
Critical Top Width: 6.01 ft  
Calculated Max Shear Stress: 0.5862 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.2816 lb/ft<sup>2</sup>

## Channel Analysis: Rd-A-2560-2600-W

Notes:

### Input Parameters

Channel Type: Triangular  
Side Slope 1 (Z1): 4.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Longitudinal Slope: 0.0100 ft/ft  
Manning's n: 0.0300  
Flow: 1.7000 cfs

### Result Parameters

Depth: 0.5028 ft  
Area of Flow: 0.8849 ft<sup>2</sup>  
Wetted Perimeter: 3.6632 ft  
Hydraulic Radius: 0.2416 ft  
Average Velocity: 1.9212 ft/s  
Top Width: 3.5197 ft  
Froude Number: 0.6752  
Critical Depth: 0.4315 ft  
Critical Velocity: 2.6087 ft/s  
Critical Slope: 0.0226 ft/ft  
Critical Top Width: 3.08 ft  
Calculated Max Shear Stress: 0.3138 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 0.1507 lb/ft<sup>2</sup>

MONUMENT ACADEMY  
CHANNEL CALCULATIONS  
DEVELOPED FLOWS

PROPOSED CHANNELS

CHANNEL	DESIGN POINT	PROPOSED SLOPE (%)	BOTTOM WIDTH (B, FT)	SIDE SLOPE (Z)	CHANNEL DEPTH (FT)	FRICTION FACTOR (n)	EASEMENT WIDTH (ft)	Q100 FLOW (CFS)	Q100 DEPTH (FT)	Q100 VELOCITY (FT/S)	CHANNEL LINING
M2.3A	M2	7.1	12	4:1	2.0	0.030	30	40.0	0.43	6.86	GRASS / ECB
M2.3B (RR RUNDOWN)	M2	33.3	8	3:1	2.0	0.040	30	40.0	0.47	9.06	RIPRAP

- 1) Channel flow calculations based on Manning's Equation
- 2) Channel depth includes 1' minimum freeboard
- 3) n = 0.03 for grass-lined non-irrigated channels (minimum)
- 4) n = 0.04 for riprap-lined channels
- 5) Vmax = 4.0 fps for 100-year flows w/ native grass-lined channels
- 6) Vmax = 8.0 fps for 100-year flows w/ Erosion Control Blankets (Tensar Eronet SC125 or equal)

# Hydraulic Analysis Report

## Project Data

Project Title: Monument Academy – Drainage Channels

Designer: JPS

Project Date: Thursday, February 7, 2019

Project Units: U.S. Customary Units

Notes:

## Channel Analysis: Channel Analysis - Channel M2.3A

Notes:

## Input Parameters

Channel Type: Trapezoidal

Side Slope 1 (Z1): 4.0000 ft/ft

Side Slope 2 (Z2): 4.0000 ft/ft

Channel Width: 12.0000 ft

Longitudinal Slope: 0.0710 ft/ft

Manning's n: 0.0300

Flow: 40.0000 cfs

## Result Parameters

Depth: 0.4251 ft

Area of Flow: 5.8239 ft<sup>2</sup>

Wetted Perimeter: 15.5054 ft

Hydraulic Radius: 0.3756 ft

Average Velocity: 6.8682 ft/s

Top Width: 15.4007 ft

Froude Number: 1.9683

Critical Depth: 0.6499 ft

Critical Velocity: 4.2160 ft/s

Critical Slope: 0.0162 ft/ft

Critical Top Width: 17.20 ft

Calculated Max Shear Stress: 1.8833 lb/ft<sup>2</sup>

Calculated Avg Shear Stress: 1.6641 lb/ft<sup>2</sup>

## Channel Analysis: Channel Analysis - Channel M2.3B (Rundown)

Notes:

### Input Parameters

Channel Type: Trapezoidal  
Side Slope 1 (Z1): 3.0000 ft/ft  
Side Slope 2 (Z2): 3.0000 ft/ft  
Channel Width: 8.0000 ft  
Longitudinal Slope: 0.2000 ft/ft  
Manning's n: 0.0400  
Lining Type: Rock Riprap - 300 mm (12-inch)  
Flow: 40.0000 cfs

### Result Parameters

Depth: 0.4695 ft  
Area of Flow: 4.4168 ft<sup>2</sup>  
Wetted Perimeter: 10.9691 ft  
Hydraulic Radius: 0.4027 ft  
Average Velocity: 9.0564 ft/s  
Top Width: 10.8167 ft  
Froude Number: 2.4976  
Critical Depth: 0.8242 ft  
Critical Velocity: 4.6343 ft/s  
Critical Slope: 0.0275 ft/ft  
Critical Top Width: 12.95 ft  
Calculated Max Shear Stress: 5.8587 lb/ft<sup>2</sup>  
Calculated Avg Shear Stress: 5.0251 lb/ft<sup>2</sup>

**PROJECT: MONUMENT ACADEMY**  
**CHANNEL: M2.3B (RIPRAP RUNDOWN INTO POND M3)**

**RIPRAP SIZING:**

$$d_{50} > [(VS^{0.17}) / (4.5(Gs - 1)^{0.66})]^2 \quad \text{(USDCEM EQUATION 8-11)}$$

**ASSUMPTIONS:**

V =	9.06 FPS	MEAN CHANNEL VELOCITY
S =	0.2 FT/FT	LONGITUDINAL SLOPE PER CHANNEL PROFILE
Gs =	2.5	SPECIFIC GRAVITY OF STONE
d <sub>50</sub> =		CALCULATED MEAN ROCK SIZE

**CALCULATED RIPRAP SIZE:**

d <sub>50</sub> =	1.37 FT
d <sub>50</sub> =	<b>16.48 INCHES</b>

**SELECTED MEAN RIPRAP SIZE = 18 INCHES (TYPE H RIPRAP)**

## 8.1 Riprap Sizing

Procedures for sizing rock to be used in soil riprap, void-filled riprap, and riprap over bedding are the same.

### 8.1.1 Mild Slope Conditions

When subcritical flow conditions occur and/or slopes are mild (less than 2 percent), UDFCD recommends the following equation (Hughes, et al, 1983):

$$d_{50} \geq \left[ \frac{VS^{0.17}}{4.5(G_s - 1)^{0.66}} \right]^2 \quad \text{Equation 8-11}$$

Where:

V = mean channel velocity (ft/sec)

S = longitudinal channel slope (ft/ft)

$d_{50}$  = mean rock size (ft)

$G_s$  = specific gravity of stone (minimum = 2.50, typically 2.5 to 2.7), Note: In this equation ( $G_s - 1$ ) considers the buoyancy of the water, in that the specific gravity of water is subtracted from the specific gravity of the rock.

Note that Equation 8-11 is applicable for sizing riprap for channel lining with a longitudinal slope of no more than 2%. This equation is not intended for use in sizing riprap for steep slopes (typically in excess of 2 percent), rundowns, or protection downstream of culverts. Information on rundowns is provided in Section 7.0 of the *Hydraulic Structures* chapter of the USDCM, and protection downstream of culverts is discussed in the *Culverts and Bridges* chapter. For channel slopes greater than 2% use one of the methods presented in 8.1.2.

Rock size does not need to be increased for steeper channel side slopes, provided the side slopes are no steeper than 2.5H:1V (UDFCD 1982). Channel side slopes steeper than 2.5H:1V are not recommended because of stability, safety, and maintenance considerations. See Figure 8-34 for riprap placement specifications. At the upstream and downstream termination of a riprap lining, the thickness should be increased 50% for at least 3 feet to prevent undercutting.

### 8.1.2 Steep Slope Conditions

Steep slope rock sizing equations are used for applications where the slope is greater than 2 percent and/or flows are in the supercritical flow regime. The following rock sizing equations may be referred to for riprap design analysis on steep slopes:

- CSU Equation, *Development of Riprap Design Criteria by Riprap Testing in Flumes: Phase II* (prepared by S.R. Abt, et al, Colorado State University, 1988). This method was developed for steep slopes from 2 to 20 percent.
- USDA- Agricultural Research Service Equations, *Design of Rock Chutes* (by K.M. Robinson, et al, USDA- ARS, 1998 Transactions of ASAE) and *An Excel Program to Design Rock Chutes for Grade*

## **APPENDIX C2**

### **HYDRAULIC CALCULATIONS – STORM SEWER SYSTEM**

MONUMENT ACADEMY  
STORM INLET SIZING SUMMARY

INLET	BASIN FLOW				INLET FLOW				INLET CONDITION / TYPE	INLET SIZE	INLET CAPACITY (CFS)
	DP	Q5 FLOW (CFS) <sup>1</sup>	Q100 FLOW (CFS) <sup>a</sup>	INLET FLOW % OF BASIN	Q5 FLOW (CFS)	Q100 FLOW (CFS)	INLET TYPE	INLET SIZE			
M2.1	M2	19.4	40.0	40	7.8	16.0		SUMP TYPE R	10.0	25.5	
M2.2	M2	19.4	40.0	10	1.9	4.0		SUMP TYPE C	SINGLE	7.3	
M2.3	M2	19.4	40.0	50	9.7	20.0		SUMP TYPE D	DOUBLE	23.9	
C14.1	C14	15.7	44.8	15	2.4	6.7		SUMP TYPE R	5.0	12.3	
C14.2	C14	15.7	44.8	35	5.5	15.7		SUMP TYPE R	10.0	25.5	
C14.3	C14	15.7	44.8	30	4.7	13.4		SUMP TYPE C	SINGLE	7.3 <sup>b</sup>	


<sup>a</sup> REFER TO RATIONAL METHOD HYDROLOGY CALCULATIONS FOR CONTRIBUTING BASINS & DEVELOPED FLOW CALCULATIONS

<sup>b</sup> ADDITIONAL INLETS AND DRAIN SYSTEM TO BE PROVIDED WITH ULTIMATE ATHLETIC FIELD CONSTRUCTION

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: **Monument Academy - Inlet C14.1 (Sump Condition)**  
 Inlet ID: **Inlet C14.1**

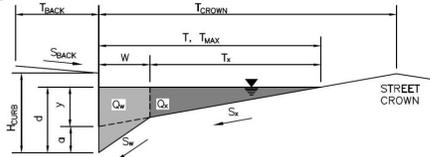

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)  
 Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 4.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 50.0$  ft  
 $W = 2.00$  ft  
 $S_X = 0.020$  ft/ft  
 $S_W = 0.083$  ft/ft  
 $S_D = 0.000$  ft/ft  
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX} =$	50.0	50.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	

**MINOR STORM Allowable Capacity is based on Depth Criterion**  
**MAJOR STORM Allowable Capacity is based on Depth Criterion**


$Q_{allow} =$ 

Minor Storm	Major Storm
SUMP	SUMP

 cfs

## INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

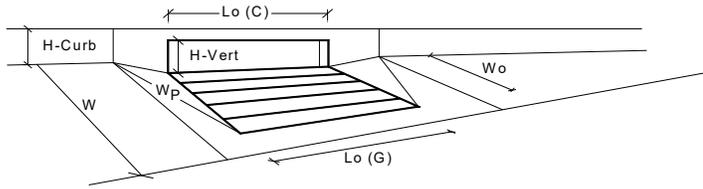


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.0	12.0	inches
<b>Grate Information</b>	MINOR	MAJOR	<input type="checkbox"/> Override Depths
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
<b>Curb Opening Information</b>	MINOR	MAJOR	
Length of a Unit Curb Opening	5.00	5.00	feet
Height of Vertical Curb Opening in Inches	6.00	6.00	inches
Height of Curb Orifice Throat in Inches	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
<b>Low Head Performance Reduction (Calculated)</b>	MINOR	MAJOR	
Depth for Grate Midwidth	N/A	N/A	ft
Depth for Curb Opening Weir Equation	0.33	0.83	ft
Combination Inlet Performance Reduction Factor for Long Inlets	0.77	1.00	
Curb Opening Performance Reduction Factor for Long Inlets	1.00	1.00	
Grated Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>	MINOR	MAJOR	
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)	5.4	12.3	cfs
Q PEAK REQUIRED =	2.4	6.7	cfs

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: **Monument Academy - Inlet C14.2 (Sump Condition)**  
 Inlet ID: **Inlet C14.2**

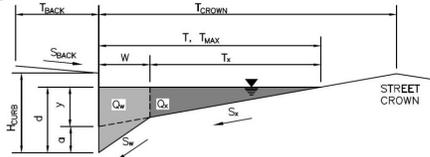

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)  
 Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 4.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 50.0$  ft  
 $W = 2.00$  ft  
 $S_X = 0.020$  ft/ft  
 $S_W = 0.083$  ft/ft  
 $S_D = 0.000$  ft/ft  
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX} =$	50.0	50.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	


**MINOR STORM** Allowable Capacity is based on Depth Criterion  
**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$Q_{allow} =$ 

Minor Storm	Major Storm	
SUMP	SUMP	cfs

## INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

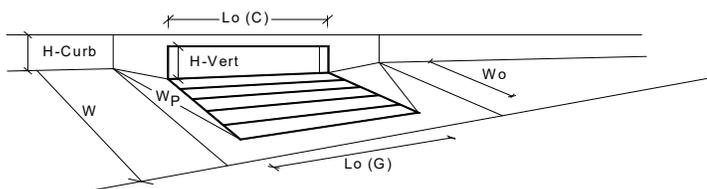


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)			
Number of Unit Inlets (Grate or Curb Opening)			
Water Depth at Flowline (outside of local depression)			
<b>Grate Information</b>			
Length of a Unit Grate			
Width of a Unit Grate			
Area Opening Ratio for a Grate (typical values 0.15-0.90)			
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)			
Grate Weir Coefficient (typical value 2.15 - 3.60)			
Grate Orifice Coefficient (typical value 0.60 - 0.80)			
<b>Curb Opening Information</b>			
Length of a Unit Curb Opening			
Height of Vertical Curb Opening in Inches			
Height of Curb Orifice Throat in Inches			
Angle of Throat (see USDCM Figure ST-5)			
Side Width for Depression Pan (typically the gutter width of 2 feet)			
Clogging Factor for a Single Curb Opening (typical value 0.10)			
Curb Opening Weir Coefficient (typical value 2.3-3.7)			
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)			
<b>Low Head Performance Reduction (Calculated)</b>			
Depth for Grate Midwidth			
Depth for Curb Opening Weir Equation			
Combination Inlet Performance Reduction Factor for Long Inlets			
Curb Opening Performance Reduction Factor for Long Inlets			
Grated Inlet Performance Reduction Factor for Long Inlets			
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>			
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)			
	MINOR	MAJOR	
Type =	CDOT Type R Curb Opening		
$a_{local}$ =	3.00	3.00	inches
No =	1	1	
Ponding Depth =	6.0	12.0	inches
	MINOR	MAJOR	<input type="checkbox"/> Override Depths
$L_o(G)$ =	N/A	N/A	feet
$W_o$ =	N/A	N/A	feet
$A_{ratio}$ =	N/A	N/A	
$C_f(G)$ =	N/A	N/A	
$C_w(G)$ =	N/A	N/A	
$C_o(G)$ =	N/A	N/A	
	MINOR	MAJOR	
$L_o(C)$ =	10.00	10.00	feet
$H_{vert}$ =	6.00	6.00	inches
$H_{throat}$ =	6.00	6.00	inches
Theta =	63.40	63.40	degrees
$W_p$ =	2.00	2.00	feet
$C_f(C)$ =	0.10	0.10	
$C_w(C)$ =	3.60	3.60	
$C_o(C)$ =	0.67	0.67	
	MINOR	MAJOR	
$d_{grate}$ =	N/A	N/A	ft
$d_{curb}$ =	0.33	0.83	ft
RF <sub>Combination</sub> =	0.57	1.00	
RF <sub>Curb</sub> =	0.93	1.00	
RF <sub>Grate</sub> =	N/A	N/A	
	MINOR	MAJOR	
$Q_a$ =	8.3	25.5	cfs
Q <sub>PEAK REQUIRED</sub> =	5.5	15.7	cfs

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: **Monument Academy - Inlet C14.3 (Sump Condition)**  
 Inlet ID: **Inlet C14.3**

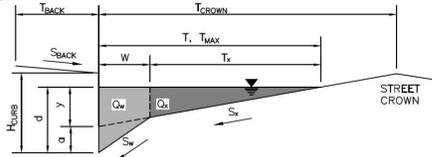

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)  
 Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK}$ =	50.0	ft
$S_{BACK}$ =	0.010	ft/ft
$n_{BACK}$ =	0.020	
$H_{CURB}$ =	0.00	inches
$T_{CROWN}$ =	50.0	ft
W =	3.00	ft
$S_x$ =	0.010	ft/ft
$S_w$ =	0.083	ft/ft
$S_D$ =	0.000	ft/ft
$n_{STREET}$ =	0.020	
$T_{MAX}$ =	50.0	ft
$d_{MAX}$ =	6.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>

Warning 02


Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

**MINOR STORM** Allowable Capacity is based on Depth Criterion  
**MAJOR STORM** Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
$Q_{allow}$ =	SUMP	SUMP	cfs

## INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

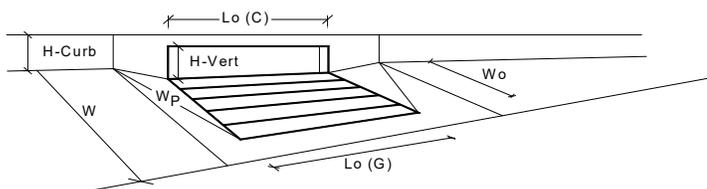

<b>Design Information (Input)</b>	MINOR	MAJOR	
Type of Inlet	CDOT Type C Grate		
Local Depression (additional to continuous gutter depression 'a' from above)	$a_{local} =$	0.00	inches
Number of Unit Inlets (Grate or Curb Opening)	No =	3	
Water Depth at Flowline (outside of local depression)	Ponding Depth =	6.0	inches
<b>Grate Information</b>	MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate	$L_s (G) =$	2.92	feet
Width of a Unit Grate	$W_o =$	2.92	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	$A_{ratio} =$	0.70	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	$C_f (G) =$	0.50	
Grate Weir Coefficient (typical value 2.15 - 3.60)	$C_w (G) =$	2.41	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	$C_o (G) =$	0.67	
<b>Curb Opening Information</b>	MINOR	MAJOR	
Length of a Unit Curb Opening	$L_c (C) =$	N/A	feet
Height of Vertical Curb Opening in Inches	$H_{vert} =$	N/A	inches
Height of Curb Orifice Throat in Inches	$H_{throat} =$	N/A	inches
Angle of Throat (see USDCM Figure ST-5)	Theta =	N/A	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	$W_p =$	N/A	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	$C_f (C) =$	N/A	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	$C_w (C) =$	N/A	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	$C_o (C) =$	N/A	
<b>Low Head Performance Reduction (Calculated)</b>	MINOR	MAJOR	
Depth for Grate Midwidth	$d_{grate} =$	0.379	ft
Depth for Curb Opening Weir Equation	$d_{curb} =$	N/A	ft
Combination Inlet Performance Reduction Factor for Long Inlets	$RF_{combination} =$	N/A	
Curb Opening Performance Reduction Factor for Long Inlets	$RF_{curb} =$	N/A	
Grated Inlet Performance Reduction Factor for Long Inlets	$RF_{grate} =$	0.58	1.00
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>	MINOR	MAJOR	
<b>WARNING: Inlet Capacity less than Q Peak for Minor Storm</b>	$Q_a =$	2.8	cfs
	$Q_{PEAK REQUIRED} =$	4.7	13.4 cfs

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Monument Academy - Inlet M2.1 (Sump Condition)

Inlet ID:

Inlet M2.1

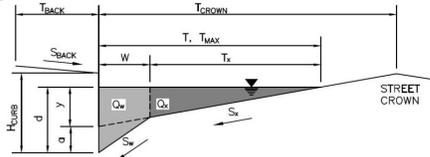

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)  
 Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 4.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.020$   
 $H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 50.0$  ft  
 $W = 2.00$  ft  
 $S_X = 0.020$  ft/ft  
 $S_W = 0.083$  ft/ft  
 $S_D = 0.000$  ft/ft  
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX} =$	50.0	50.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	


**MINOR STORM** Allowable Capacity is based on Depth Criterion  
**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$Q_{allow} =$ 

Minor Storm	Major Storm	
SUMP	SUMP	cfs

## INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

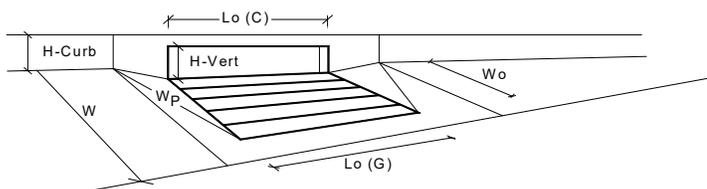

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)			
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.0	12.0	inches
<b>Grate Information</b>	MINOR	MAJOR	<input type="checkbox"/> Override Depths
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
<b>Curb Opening Information</b>	MINOR	MAJOR	
Length of a Unit Curb Opening	10.00	10.00	feet
Height of Vertical Curb Opening in Inches	6.00	6.00	inches
Height of Curb Orifice Throat in Inches	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
<b>Low Head Performance Reduction (Calculated)</b>	MINOR	MAJOR	
Depth for Grate Midwidth	N/A	N/A	ft
Depth for Curb Opening Weir Equation	0.33	0.83	ft
Combination Inlet Performance Reduction Factor for Long Inlets	0.57	1.00	
Curb Opening Performance Reduction Factor for Long Inlets	0.93	1.00	
Grated Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>	MINOR	MAJOR	
<b>Q<sub>a</sub></b>	8.3	25.5	cfs
Q <sub>PEAK REQUIRED</sub>	7.8	16.0	cfs

Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Monument Academy - Inlet M2.2 (Sump Condition)

Inlet ID:

Inlet M2.2

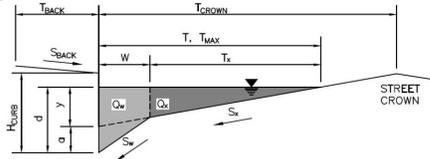

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

$T_{BACK} = 50.0$  ft  
 $S_{BACK} = 0.010$  ft/ft  
 $n_{BACK} = 0.020$

Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$H_{CURB} = 0.00$  inches  
 $T_{CROWN} = 50.0$  ft  
 $W = 2.00$  ft  
 $S_X = 0.010$  ft/ft  
 $S_W = 0.083$  ft/ft  
 $S_D = 0.000$  ft/ft  
 $n_{STREET} = 0.020$

Warning 02

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX} =$	50.0	50.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	


MINOR STORM Allowable Capacity is based on Depth Criterion  
 MAJOR STORM Allowable Capacity is based on Depth Criterion

$Q_{allow} =$ 

Minor Storm	Major Storm	
SUMP	SUMP	cfs

## INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

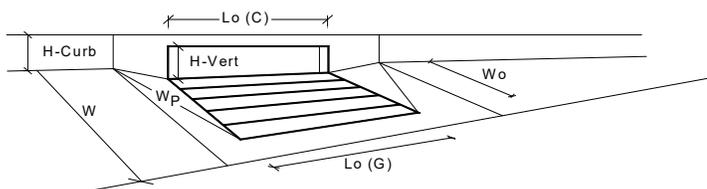

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	CDOT Type C Grate		
Local Depression (additional to continuous gutter depression 'a' from above)	0.00	0.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	6.0	12.0	inches
<b>Grate Information</b>	MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate	2.92	2.92	feet
Width of a Unit Grate	2.92	2.92	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	0.70	0.70	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	0.50	0.50	
Grate Weir Coefficient (typical value 2.15 - 3.60)	2.41	2.41	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	0.67	0.67	
<b>Curb Opening Information</b>	MINOR	MAJOR	
Length of a Unit Curb Opening	N/A	N/A	feet
Height of Vertical Curb Opening in Inches	N/A	N/A	inches
Height of Curb Orifice Throat in Inches	N/A	N/A	inches
Angle of Throat (see USDCM Figure ST-5)	N/A	N/A	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	N/A	N/A	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	N/A	N/A	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	N/A	N/A	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	N/A	N/A	
<b>Low Head Performance Reduction (Calculated)</b>	MINOR	MAJOR	
Depth for Grate Midwidth	0.379	0.879	ft
Depth for Curb Opening Weir Equation	N/A	N/A	ft
Combination Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
Curb Opening Performance Reduction Factor for Long Inlets	N/A	N/A	
Grated Inlet Performance Reduction Factor for Long Inlets	0.95	1.00	
<b>Total Inlet Interception Capacity (assumes clogged condition)</b>	MINOR	MAJOR	
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)	2.0	7.3	cfs
Q PEAK REQUIRED	1.9	4.0	cfs

Warning 5

Warning 5: The width of unit is greater than the gutter width.

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Monument Academy - Inlet M2.3 (Sump Condition)

Inlet ID:

Inlet M2.3

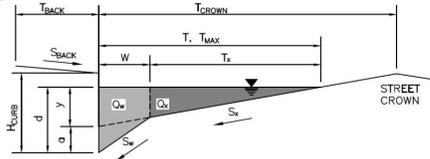

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

$T_{BACK} = 50.0$  ft  
 $S_{BACK} = 0.010$  ft/ft  
 $n_{BACK} = 0.020$

Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$H_{CURB} = 0.00$  inches  
 $T_{CROWN} = 50.0$  ft  
 $W = 3.00$  ft  
 $S_x = 0.010$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_D = 0.000$  ft/ft  
 $n_{STREET} = 0.020$

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX} =$	50.0	50.0	ft
$d_{MAX} =$	6.0	12.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	

Warning 02

MINOR STORM Allowable Capacity is based on Depth Criterion  
 MAJOR STORM Allowable Capacity is based on Depth Criterion

$Q_{allow} =$ 

Minor Storm	Major Storm	
SUMP	SUMP	cfs



## **APPENDIX D1**

### **DETENTION POND CALCULATIONS – POND C14**

Not checked in detail with first review.

MONUMENT ACADEMY										
IMPERVIOUS AREAS										
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	SUB-AREA 3 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	WEIGHTED % IMP
C14	15.86	4.29	BUILDING / PAVEMENT	100	11.57	LANDSCAPED	0			27.049
M1	4.53	4.53	NH BUSINESS	70						70.000
M2	7.48	4.78	BUILDING / PAVEMENT	100	2.70	LANDSCAPED	0			63.904
M3	11.31	9.66	NH BUSINESS	70	1.65	POND / LANDSCAPE	0			59.788
M2,M3	18.79									61.426
M4	21.78	10.89	RESIDENTIAL-0.5-AC	25	10.89	RESIDENTIAL-1-AC	20			22.500




## Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: Walden NW / Monument Academy

Basin ID: C14

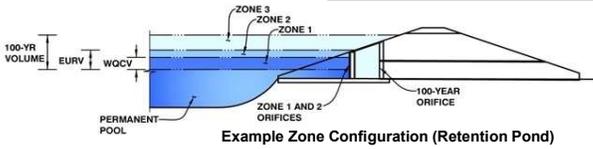

Example Zone Configuration (Retention Pond)

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.90	0.187	Orifice Plate
Zone 2 (EURV)	3.60	0.248	Orifice Plate
Zone 3 (100-year)	5.93	0.552	Weir&Pipe (Restrict)
		0.988	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
 Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain

Underdrain Orifice Area =  ft<sup>2</sup>  
 Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
 Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft)  
 Orifice Plate: Orifice Vertical Spacing =  inches  
 Orifice Plate: Orifice Area per Row =  sq. inches (diameter = 1-3/8 inches)

Calculated Parameters for Plate

WQ Orifice Area per Row =  ft<sup>2</sup>  
 Elliptical Half-Width =  feet  
 Elliptical Slot Centroid =  feet  
 Elliptical Slot Area =  ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.20	2.40					
Orifice Area (sq. inches)	1.49	1.49	1.49					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected
Invert of Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>
Depth at top of Zone using Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>
Vertical Orifice Diameter =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>

ft (relative to basin bottom at Stage = 0 ft)  
 ft (relative to basin bottom at Stage = 0 ft)  
 inches

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected
Vertical Orifice Area =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>
Vertical Orifice Centroid =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>

ft<sup>2</sup>  
 feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected
Overflow Weir Front Edge Height, Ho =	<input type="text" value="5.00"/>	<input type="text" value="N/A"/>
Overflow Weir Front Edge Length =	<input type="text" value="4.00"/>	<input type="text" value="N/A"/>
Overflow Weir Slope =	<input type="text" value="0.00"/>	<input type="text" value="N/A"/>
Horiz. Length of Weir Sides =	<input type="text" value="4.00"/>	<input type="text" value="N/A"/>
Overflow Grate Open Area % =	<input type="text" value="70%"/>	<input type="text" value="N/A"/>
Debris Clogging % =	<input type="text" value="50%"/>	<input type="text" value="N/A"/>

ft (relative to basin bottom at Stage = 0 ft)  
 feet  
 H:V (enter zero for flat grate)  
 feet  
 %, grate open area/total area  
 %

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected
Height of Grate Upper Edge, H <sub>i</sub> =	<input type="text" value="5.00"/>	<input type="text" value="N/A"/>
Over Flow Weir Slope Length =	<input type="text" value="4.00"/>	<input type="text" value="N/A"/>
Grate Open Area / 100-yr Orifice Area =	<input type="text" value="9.90"/>	<input type="text" value="N/A"/>
Overflow Grate Open Area w/o Debris =	<input type="text" value="11.20"/>	<input type="text" value="N/A"/>
Overflow Grate Open Area w/ Debris =	<input type="text" value="5.60"/>	<input type="text" value="N/A"/>

feet  
 feet  
 should be ≥ 4  
 ft<sup>2</sup>  
 ft<sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected
Depth to Invert of Outlet Pipe =	<input type="text" value="0.00"/>	<input type="text" value="N/A"/>
Outlet Pipe Diameter =	<input type="text" value="18.00"/>	<input type="text" value="N/A"/>
Restrictor Plate Height Above Pipe Invert =	<input type="text" value="11.00"/>	<input type="text" value="N/A"/>

ft (distance below basin bottom at Stage = 0 ft)  
 inches  
 inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected
Outlet Orifice Area =	<input type="text" value="1.13"/>	<input type="text" value="N/A"/>
Outlet Orifice Centroid =	<input type="text" value="0.52"/>	<input type="text" value="N/A"/>
Half-Central Angle of Restrictor Plate on Pipe =	<input type="text" value="1.79"/>	<input type="text" value="N/A"/>

ft<sup>2</sup>  
 feet  
 radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =  ft (relative to basin bottom at Stage = 0 ft)  
 Spillway Crest Length =  feet  
 Spillway End Slopes =  H:V  
 Freeboard above Max Water Surface =  feet

Calculated Parameters for Spillway




Spillway Design Flow Depth =  feet  
 Stage at Top of Freeboard =  feet  
 Basin Area at Top of Freeboard =  acres

### Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.14
Calculated Runoff Volume (acre-ft) =	0.187	0.436	0.331	0.475	0.746	1.301	1.662	2.135	3.074
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.187	0.435	0.330	0.474	0.745	1.300	1.661	2.133	3.073
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.01	0.02	0.17	0.58	0.81	1.09	1.62
Predevelopment Peak Q (cfs) =	0.0	0.0	0.2	0.3	2.7	9.2	12.8	17.3	25.7
Peak Inflow Q (cfs) =	2.8	6.5	5.0	7.1	11.1	19.3	24.6	31.5	45.2
Peak Outflow Q (cfs) =	0.1	0.2	0.2	0.2	0.3	9.4	12.4	13.3	27.7
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.8	0.1	1.0	1.0	0.8	1.1
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Plate	Overflow Grate 1	Outlet Plate 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	0.8	1.1	1.2	1.2
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	38	54	49	55	65	62	59	56	49
Time to Drain 99% of Inflow Volume (hours) =	40	57	52	59	70	70	69	67	65
Maximum Ponding Depth (ft) =	1.78	3.40	2.74	3.62	4.85	5.41	5.69	6.45	7.18
Area at Maximum Ponding Depth (acres) =	0.14	0.16	0.14	0.18	0.25	0.27	0.28	0.31	0.34
Maximum Volume Stored (acre-ft) =	0.171	0.403	0.304	0.439	0.698	0.845	0.919	1.145	1.377

# Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

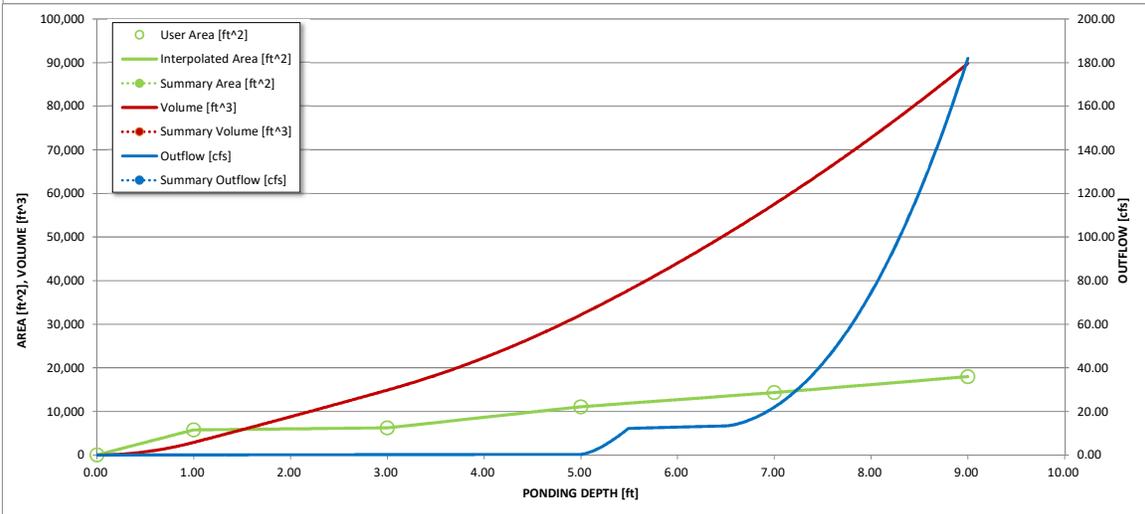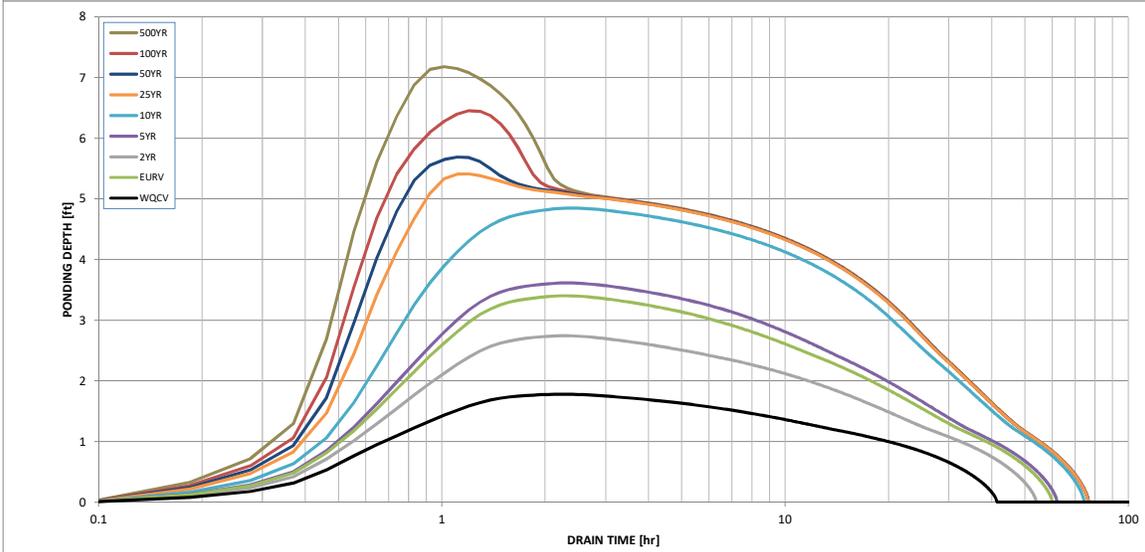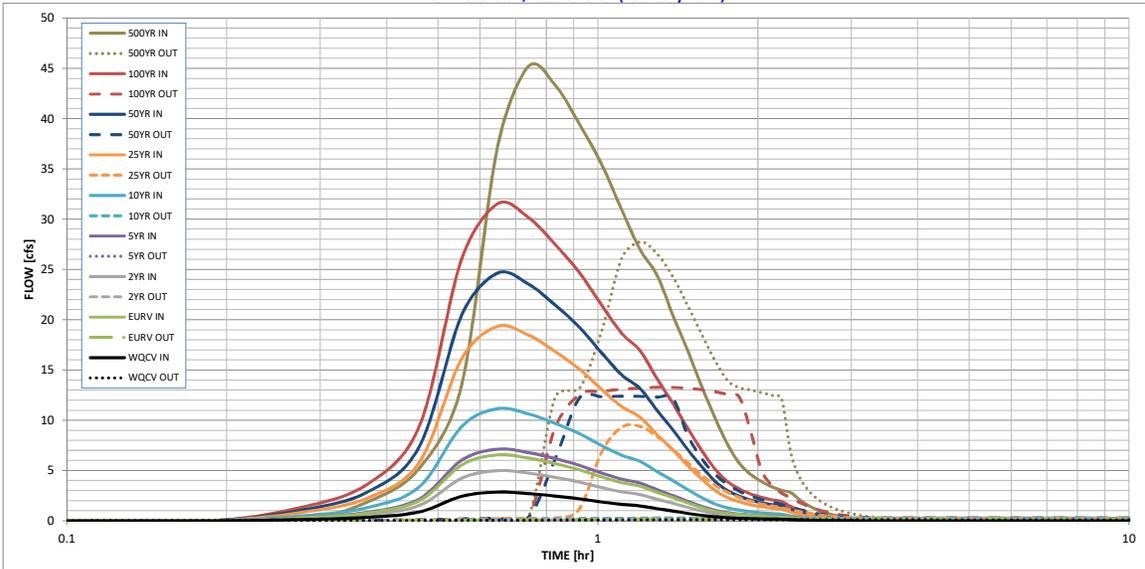

**S-A-V-D Chart Axis Override**

	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			



**Design Procedure Form: Extended Detention Basin (EDB)**

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 4

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND C14

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, <math>I_a</math></p> <p>B) Tributary Area's Imperviousness Ratio (<math>i = I_a / 100</math>)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time (<math>V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)) / 12 * Area</math>)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume (<math>V_{WQCV\ OTHER} = (d_6 * V_{DESIGN} / 0.43)</math>)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) Predominant Watershed NRCS Soil Group</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume                  For HSG A: <math>EURV_A = 1.68 * i^{1.28}</math>                  For HSG B: <math>EURV_B = 1.36 * i^{1.08}</math>                  For HSG C/D: <math>EURV_{C/D} = 1.20 * i^{1.06}</math> </p>	<p><math>I_a =</math> <u>27.0</u> %</p> <p><math>i =</math> <u>0.270</u></p> <p>Area = <u>15.860</u> ac</p> <p><math>d_6 =</math> _____ in</p> <p>Choose One</p> <p><input type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input checked="" type="radio"/> Excess Urban Runoff Volume (EURV)</p> <p><math>V_{DESIGN} =</math> <u>0.187</u> ac-ft</p> <p><math>V_{DESIGN\ OTHER} =</math> _____ ac-ft</p> <p><math>V_{DESIGN\ USER} =</math> _____ ac-ft</p> <p>Choose One</p> <p><input type="radio"/> A</p> <p><input checked="" type="radio"/> B</p> <p><input type="radio"/> C / D</p> <p>EURV = <u>0.437</u> ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <u>2.0</u> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <u>4.00</u> ft / ft</p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<p>Concrete Forebay</p> <p>_____</p> <p>_____</p> <p>_____</p>

**Design Procedure Form: Extended Detention Basin (EDB)**

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND C14

<p>5. Forebay</p> <p>A) Minimum Forebay Volume (<math>V_{MIN} =</math> <u>2%</u> of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth (<math>D_F =</math> <u>18</u> inch maximum)</p> <p>D) Forebay Discharge</p> <p style="padding-left: 20px;">i) Undetained 100-year Peak Discharge</p> <p style="padding-left: 20px;">ii) Forebay Discharge Design Flow (<math>Q_F = 0.02 * Q_{100}</math>)</p> <p>E) Forebay Discharge Design</p> <p style="padding-left: 20px;">Choose One  <input type="radio"/> Berm With Pipe  <input checked="" type="radio"/> Wall with Rect. Notch  <input type="radio"/> Wall with V-Notch Weir</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p><math>V_{MIN} =</math> <u>0.004</u> ac-ft</p> <p><math>V_F =</math> <u>0.005</u> ac-ft</p> <p><math>D_F =</math> <u>18.0</u> in</p> <p><math>Q_{100} =</math> <u>44.80</u> cfs</p> <p><math>Q_F =</math> <u>0.90</u> cfs</p> <p>(flow too small for berm w/ pipe)</p> <p>Calculated <math>D_p =</math> <u>          </u> in</p> <p>Calculated <math>W_N =</math> <u>5.4</u> in</p>
<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<p style="padding-left: 20px;">Choose One  <input checked="" type="radio"/> Concrete  <input type="radio"/> Soft Bottom</p> <p><math>S =</math> <u>0.0050</u> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft<sup>2</sup> minimum)</p> <p>C) Outlet Type</p> <p style="padding-left: 20px;">Choose One  <input checked="" type="radio"/> Orifice Plate  <input type="radio"/> Other (Describe):                  _____                  _____                  _____</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p><math>D_M =</math> <u>2.5</u> ft</p> <p><math>A_M =</math> <u>10</u> sq ft</p> <p><math>D_{orifice} =</math> <u>1.38</u> inches</p> <p><math>A_{ot} =</math> <u>4.47</u> square inches</p>

**Design Procedure Form: Extended Detention Basin (EDB)**

Sheet 3 of 4

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND C14

<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p><math>D_{IS} = 6</math> in</p> <p><math>V_{IS} =</math> <input style="width: 50px;" type="text" value=""/> cu ft</p> <p><math>V_s = 5.0</math> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: <math>A_t = A_{ot} * 38.5 * (e^{-0.095D})</math></p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open are to the total screen are for the material specified.)</p> <p align="center">Other (Y/N): <input style="width: 50px;" type="text" value="N"/></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (<math>H_{TR}</math>)</p> <p>G) Width of Water Quality Screen Opening (<math>W_{opening}</math>) (Minimum of 12 inches is recommended)</p>	<p><math>A_t = 151</math> square inches</p> <p><u>Aluminum Amico-Klemp SR Series with Cross Rods 2" O.C.</u></p> <hr/> <hr/> <p>User Ratio =</p> <p><math>A_{total} = 213</math> sq. in.</p> <p><math>H = 3.6</math> feet</p> <p><math>H_{TR} = 71.2</math> inches</p> <p><math>W_{opening} = 12.0</math> inches</p>

**Design Procedure Form: Extended Detention Basin (EDB)**

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND C14

<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Buried Riprap</p> <hr/> <hr/> <p align="center">4.00</p>
<p>11. Vegetation</p>	<p>Choose One</p> <p><input type="radio"/> Irrigated</p> <p><input checked="" type="radio"/> Not Irrigated</p>
<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<p>Periodic inspection and maintenance by property owner as required</p> <p>Ramp provided for skid-loader access to pond bottom</p> <hr/> <hr/> <hr/> <hr/>
<p>Notes: _____</p> <hr/> <hr/> <hr/>	

**APPENDIX D2**

**DETENTION POND CALCULATIONS – POND M3**


MONUMENT ACADEMY										
IMPERVIOUS AREAS										
BASIN	TOTAL AREA (AC)	(AC)	SUB-AREA 1 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	AREA (AC)	SUB-AREA 2 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	SUB-AREA 3 DEVELOPMENT/ COVER	PERCENT IMPERVIOUS	WEIGHTED % IMP
C14	15.86	4.29	BUILDING / PAVEMENT	100	11.57	LANDSCAPED	0			27.049
M1	4.53	4.53	NH BUSINESS	70						70.000
M2	7.48	4.78	BUILDING / PAVEMENT	100	2.70	LANDSCAPED	0			63.904
M3	11.31	9.66	NH BUSINESS	70	1.65	POND / LANDSCAPE	0			59.788
M2,M3	18.79									61.426
M4	21.78	10.89	RESIDENTIAL-0.5-AC	25	10.89	RESIDENTIAL-1-AC	20			22.500



## Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: Walden NW / Monument Academy  
Basin ID: M3

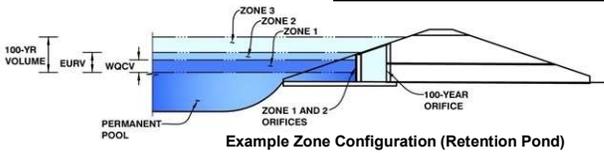

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.09	0.377	Orifice Plate
Zone 2 (EURV)	4.68	0.877	Orifice Plate
Zone 3 (100-year)	6.45	0.796	Weir&Pipe (Restrict)
		2.050	<b>Total</b>

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain

Underdrain Orifice Area =  ft<sup>2</sup>  
Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft)  
Orifice Plate: Orifice Vertical Spacing =  inches  
Orifice Plate: Orifice Area per Row =  inches

Calculated Parameters for Plate

WQ Orifice Area per Row =  ft<sup>2</sup>  
Elliptical Half-Width =  feet  
Elliptical Slot Centroid =  feet  
Elliptical Slot Area =  ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.56	3.12					
Orifice Area (sq. inches)	3.00	3.00	1.77					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected	
Vertical Orifice Area =	N/A	N/A	ft <sup>2</sup>
Vertical Orifice Centroid =	N/A	N/A	feet

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, H <sub>o</sub> =	5.50	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	5.00	N/A	feet
Overflow Weir Slope =	0.00	N/A	H:V (enter zero for flat grate)
Horiz. Length of Weir Sides =	5.00	N/A	feet
Overflow Grate Open Area % =	70%	N/A	% grate open area/total area
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H <sub>t</sub> =	5.50	N/A	feet
Over Flow Weir Slope Length =	5.00	N/A	feet
Grate Open Area / 100-yr Orifice Area =	7.87	N/A	should be ≥ 4
Overflow Grate Open Area w/o Debris =	17.50	N/A	ft <sup>2</sup>
Overflow Grate Open Area w/ Debris =	8.75	N/A	ft <sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.00	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	24.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	16.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	2.22	N/A	ft <sup>2</sup>
Outlet Orifice Centroid =	0.75	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	1.91	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =  ft (relative to basin bottom at Stage = 0 ft)  
Spillway Crest Length =  feet  
Spillway End Slopes =  H:V  
Freeboard above Max Water Surface =  feet

Calculated Parameters for Spillway




Spillway Design Flow Depth =  feet  
Stage at Top of Freeboard =  feet  
Basin Area at Top of Freeboard =  acres

### Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =									
One-Hour Rainfall Depth (in) =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.14
Calculated Runoff Volume (acre-ft) =	0.377	1.254	1.032	1.386	1.800	2.356	2.755	3.279	4.372
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.377	1.254	1.032	1.386	1.800	2.356	2.755	3.280	4.373
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.01	0.02	0.24	0.78	1.07	1.44	2.12
Predevelopment Peak Q (cfs) =	0.0	0.0	0.3	0.5	4.5	14.6	20.2	27.0	39.8
Peak Inflow Q (cfs) =	7.3	23.9	19.7	26.4	34.2	44.6	52.0	61.8	81.9
Peak Outflow Q (cfs) =	0.2	0.5	0.4	0.5	2.4	14.0	22.0	25.6	41.5
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	1.0	0.5	1.0	1.1	0.9	1.0
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Overflow Grate 1	Overflow Grate 1	Overflow Grate 1	Outlet Plate 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	0.1	0.8	1.2	1.4	1.5
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	38	65	60	68	73	71	69	68	64
Time to Drain 99% of Inflow Volume (hours) =	40	70	64	73	79	78	77	77	75
Maximum Ponding Depth (ft) =	1.99	4.53	3.97	4.85	5.62	5.96	6.13	6.45	7.12
Area at Maximum Ponding Depth (acres) =	0.27	0.40	0.37	0.41	0.45	0.47	0.48	0.50	0.54
Maximum Volume Stored (acre-ft) =	0.352	1.195	0.977	1.320	1.658	1.816	1.892	2.049	2.395

# Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

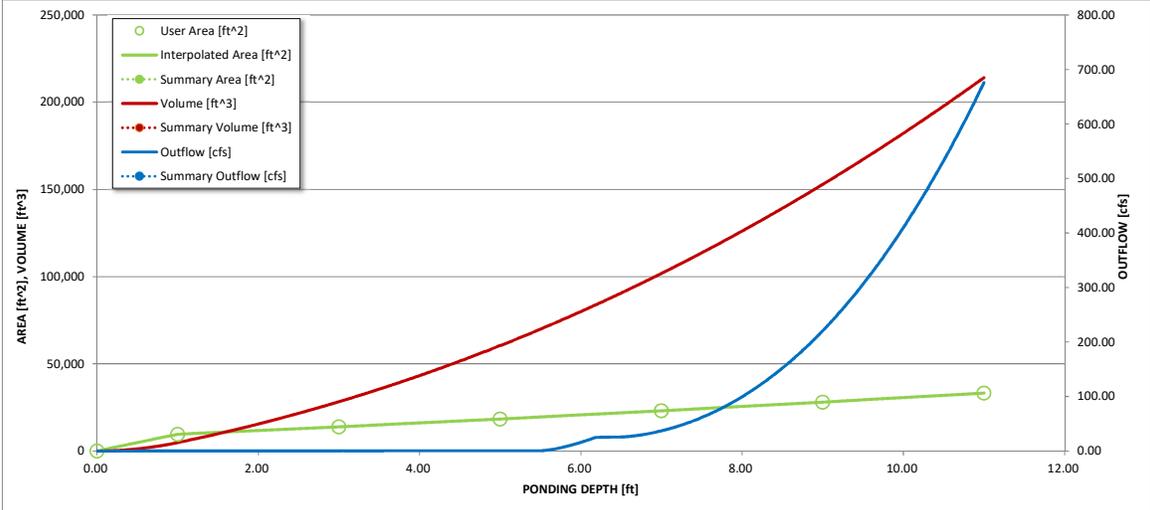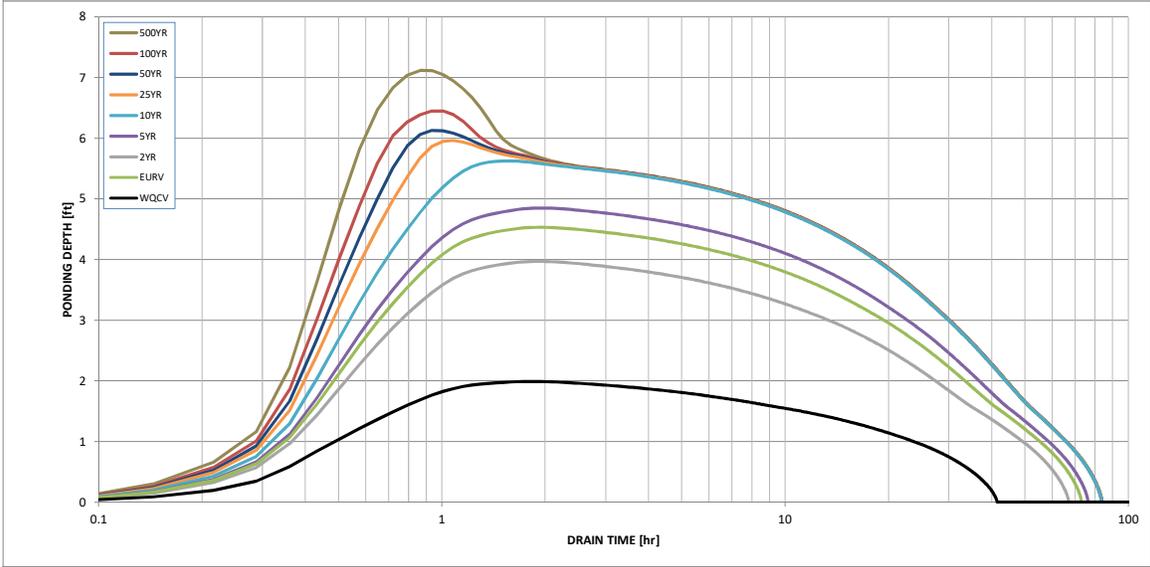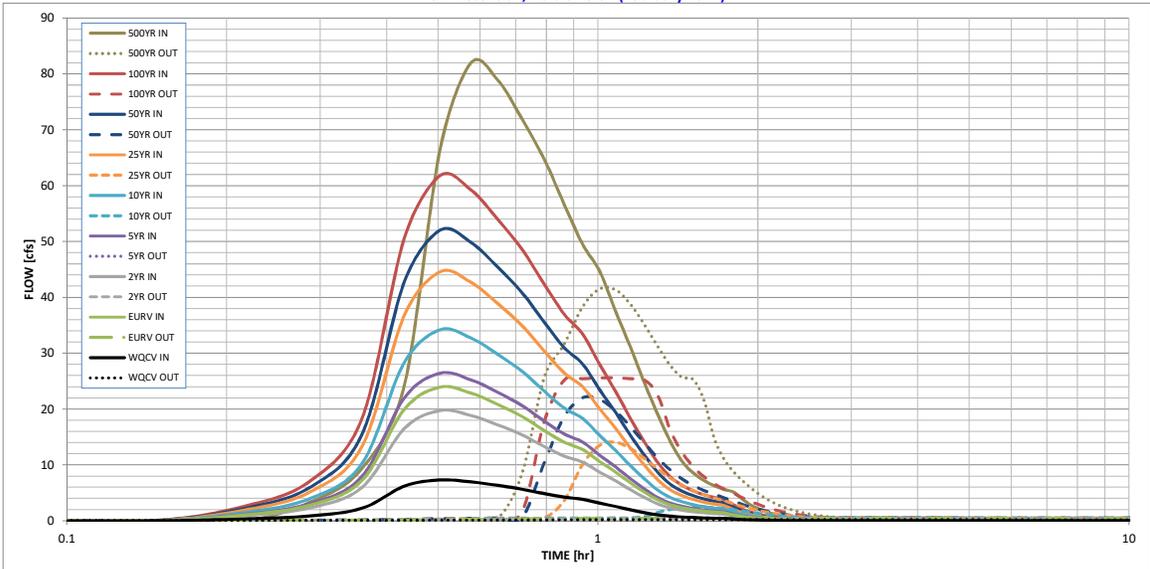

**S-A-V-D Chart Axis Override**

	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			



**Design Procedure Form: Extended Detention Basin (EDB)**

UD-BMP (Version 3.06, November 2016)

Sheet 1 of 4

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND M3

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, <math>I_a</math></p> <p>B) Tributary Area's Imperviousness Ratio (<math>i = I_a / 100</math>)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time (<math>V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)) / 12 * Area</math>)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume (<math>V_{WQCV\ OTHER} = (d_6 * V_{DESIGN} / 0.43)</math>)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) Predominant Watershed NRCS Soil Group</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume                  For HSG A: <math>EURV_A = 1.68 * i^{1.28}</math>                  For HSG B: <math>EURV_B = 1.36 * i^{1.08}</math>                  For HSG C/D: <math>EURV_{C/D} = 1.20 * i^{1.06}</math> </p>	<p><math>I_a =</math> <u>61.4</u> %</p> <p><math>i =</math> <u>0.614</u></p> <p>Area = <u>18.790</u> ac</p> <p><math>d_6 =</math> _____ in</p> <p>Choose One</p> <p><input type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input checked="" type="radio"/> Excess Urban Runoff Volume (EURV)</p> <p><math>V_{DESIGN} =</math> <u>0.377</u> ac-ft</p> <p><math>V_{DESIGN\ OTHER} =</math> _____ ac-ft</p> <p><math>V_{DESIGN\ USER} =</math> _____ ac-ft</p> <p>Choose One</p> <p><input type="radio"/> A</p> <p><input checked="" type="radio"/> B</p> <p><input type="radio"/> C / D</p> <p>EURV = <u>1.257</u> ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <u>4.0</u> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <u>3.00</u> ft / ft</p> <p align="center"><b>DIFFICULT TO MAINTAIN, INCREASE WHERE POSSIBLE</b></p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<p>Concrete Forebay</p> <p>_____</p> <p>_____</p> <p>_____</p>

**Design Procedure Form: Extended Detention Basin (EDB)**

Sheet 2 of 4

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND M3

<p>5. Forebay</p> <p>A) Minimum Forebay Volume (<math>V_{MIN} =</math> <u>3%</u> of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth (<math>D_F =</math> <u>18</u> inch maximum)</p> <p>D) Forebay Discharge</p> <p style="margin-left: 40px;">i) Undetained 100-year Peak Discharge</p> <p style="margin-left: 40px;">ii) Forebay Discharge Design Flow (<math>Q_F = 0.02 * Q_{100}</math>)</p> <p>E) Forebay Discharge Design</p> <p style="margin-left: 40px;">Choose One  <input type="radio"/> Berm With Pipe  <input checked="" type="radio"/> Wall with Rect. Notch  <input type="radio"/> Wall with V-Notch Weir</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p><math>V_{MIN} =</math> <u>0.011</u> ac-ft</p> <p><math>V_F =</math> <u>0.005</u> ac-ft <span style="color: red;">VF &lt; MINIMUM VF</span></p> <p><math>D_F =</math> <u>18.0</u> in</p> <p><math>Q_{100} =</math> <u>41.50</u> cfs</p> <p><math>Q_F =</math> <u>0.83</u> cfs</p> <p style="margin-left: 40px;">(flow too small for berm w/ pipe)</p> <p>Calculated <math>D_p =</math> <u>          </u> in</p> <p>Calculated <math>W_N =</math> <u>5.2</u> in</p>
<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<p style="margin-left: 40px;">Choose One  <input checked="" type="radio"/> Concrete  <input type="radio"/> Soft Bottom</p> <p><math>S =</math> <u>0.0050</u> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft<sup>2</sup> minimum)</p> <p>C) Outlet Type</p> <p style="margin-left: 40px;">Choose One  <input checked="" type="radio"/> Orifice Plate  <input type="radio"/> Other (Describe):                  _____                  _____                  _____</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p><math>D_M =</math> <u>2.5</u> ft</p> <p><math>A_M =</math> <u>10</u> sq ft</p> <p><math>D_{orifice} =</math> <u>1.50</u> inches</p> <p><math>A_{ot} =</math> <u>7.77</u> square inches</p>

**Design Procedure Form: Extended Detention Basin (EDB)**

**Designer:** JPS  
**Company:** JPS  
**Date:** February 6, 2019  
**Project:** WALDEN NW / MONUMENT ACADEMY  
**Location:** DETENTION POND M3

<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p><math>D_{IS} = 6</math> in</p> <p><math>V_{IS} = 49.3</math> cu ft</p> <p><math>V_s = 5.0</math> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: <math>A_t = A_{ot} * 38.5 * (e^{-0.095D})</math></p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open are to the total screen are for the material specified.)</p> <p align="center">Other (Y/N): <b>N</b></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (<math>H_{TR}</math>)</p> <p>G) Width of Water Quality Screen Opening (<math>W_{opening}</math>) (Minimum of 12 inches is recommended)</p>	<p><math>A_t = 259</math> square inches</p> <p><i>Aluminum Amico-Klemp SR Series with Cross Rods 2" O.C.</i></p> <hr/> <hr/> <p>User Ratio =</p> <p><math>A_{total} = 365</math> sq. in.</p> <p><math>H = 4.68</math> feet</p> <p><math>H_{TR} = 84.16</math> inches</p> <p><math>W_{opening} = 12.0</math> inches</p>

Design Procedure Form: Extended Detention Basin (EDB)

Designer: JPS  
Company: JPS  
Date: February 6, 2019  
Project: WALDEN NW / MONUMENT ACADEMY  
Location: DETENTION POND M3

<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p><u>Buried Riprap</u></p> <p>_____</p> <p>_____</p> <p>_____</p>
<p>11. Vegetation</p>	<p>Choose One</p> <p><input type="radio"/> Irrigated</p> <p><input checked="" type="radio"/> Not Irrigated</p>
<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<p><u>Periodic inspection and maintenance by property owner as required</u></p> <p><u>Ramp provided for skid-loader access to pond bottom</u></p> <p>_____</p> <p>_____</p> <p>_____</p>
<p>Notes: _____</p> <p>_____</p> <p>_____</p>	


**APPENDIX E**  
**DRAINAGE COST ESTIMATE**

<b>MONUMENT ACADEMY DRAINAGE IMPROVEMENTS COST ESTIMATE</b>					
Item No.	Description	Quantity	Unit	Unit Cost (\$\$\$)	Total Cost (\$\$\$)
<b>PUBLIC DRAINAGE IMPROVEMENTS (NON-REIMBURSABLE)</b>					
	18" RCP/HDPE Culvert	564	LF	\$69	\$38,916
	30" RCP Culvert	116	LF	\$94	\$10,904
	Grated Inlet, Type C	1	EA	\$3,270	\$3,270
	Grated Inlet, Type D	1	EA	\$3,908	\$3,908
	Riprap (d <sub>50</sub> = 12")	10	CY	\$98	\$980
	<b>SUBTOTAL</b>				<b>\$57,978</b>
	Contingency @ 15%				\$8,697
	<b>TOTAL</b>				<b>\$66,675</b>
<b>PRIVATE DRAINAGE IMPROVEMENTS (NON-REIMBURSABLE)</b>					
	18" HDPE Culvert	911	LF	\$69	\$62,859
	24" HDPE Culvert	891	LF	\$84	\$74,844
	Curb Inlet, 5' Type R	1	EA	\$3,791	\$3,791
	Curb Inlet, 10' Type R	2	EA	\$5,528	\$11,056
	Grated Inlet, Type C	1	EA	\$3,270	\$3,270
	Riprap (d <sub>50</sub> = 12")	10	CY	\$98	\$980
	Channel Lining, RipRap	65	CY	\$98	\$6,370
	Detention Pond Outlet Structure	2	EA	\$8,000	\$16,000
	Detention Pond Spillway	2	EA	\$3,000	\$6,000
	<b>SUBTOTAL</b>				<b>\$185,170</b>
	Contingency @ 15%				\$27,776
	<b>TOTAL</b>				<b>\$212,946</b>
	<b>TOTAL DRAINAGE IMPROVEMENTS</b>				<b>\$279,620</b>
	Note: This estimate does not include costs for street improvements (curb & gutter, crosspans, etc.)				
<p>The cost estimate submitted herein is based on time-honored practices within the construction industry. As such the engineer does not control the cost of labor, materials, equipment or a contractor's method of determining prices and competitive bidding practices or market conditions. The estimate represents our best judgement as design professionals using current information available at the time of the preparation. The engineer cannot guarantee that proposals, bids and/or construction costs will not vary from this cost estimate.</p>					


## **APPENDIX F**

### **FIGURES**

Z:\040201.walden\dwg\civi\WALDEN PRESERVE 2\MONUMENT ACADEMY\FIGURE A1.dwg, 2/8/2019 6:27:56 PM, DWG To PDF.pc3

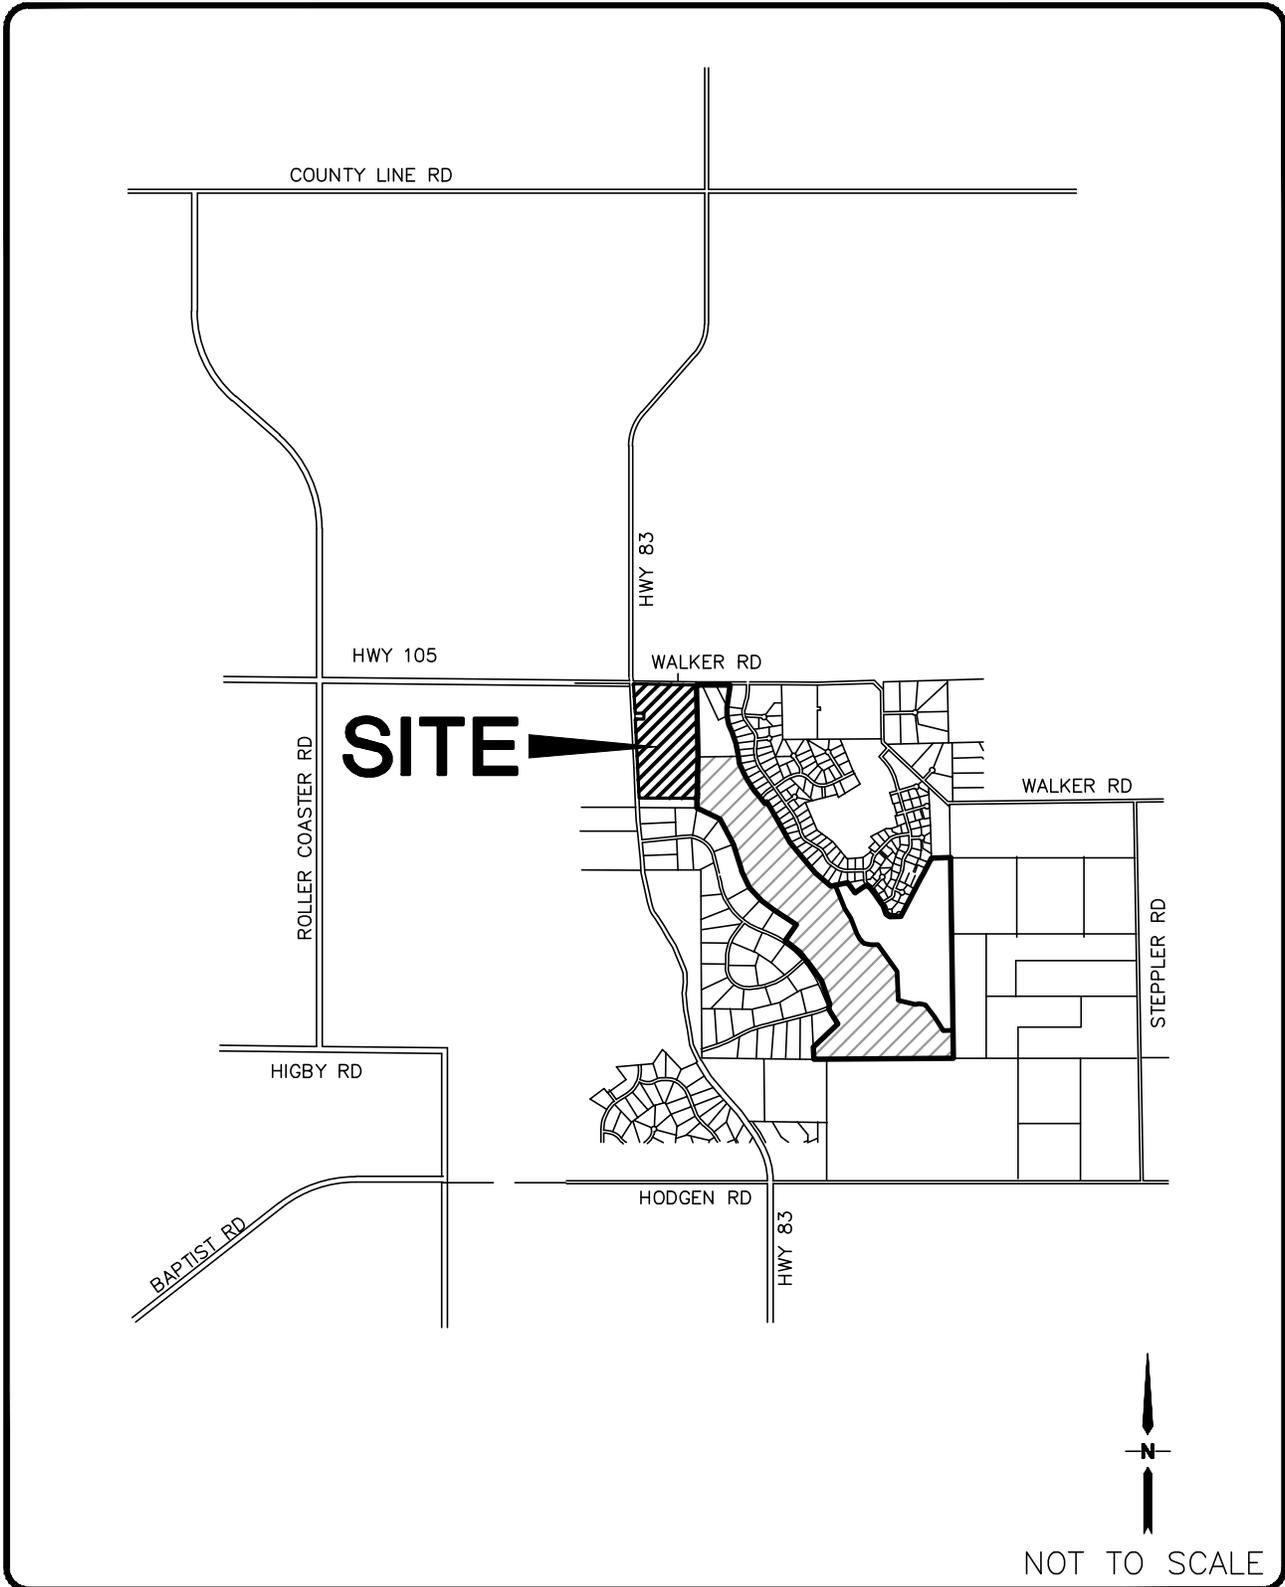

**VICINITY MAP**

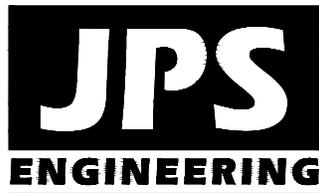


**MONUMENT ACADEMY**

**FIGURE A1**

JPS PROJ NO. 040201


J:\jpsprojects\040201.walden\WALDEN PRESERVE 2\DWG\CIVIL\FP-1.dwg Sep 17, 2014 - 9:41am

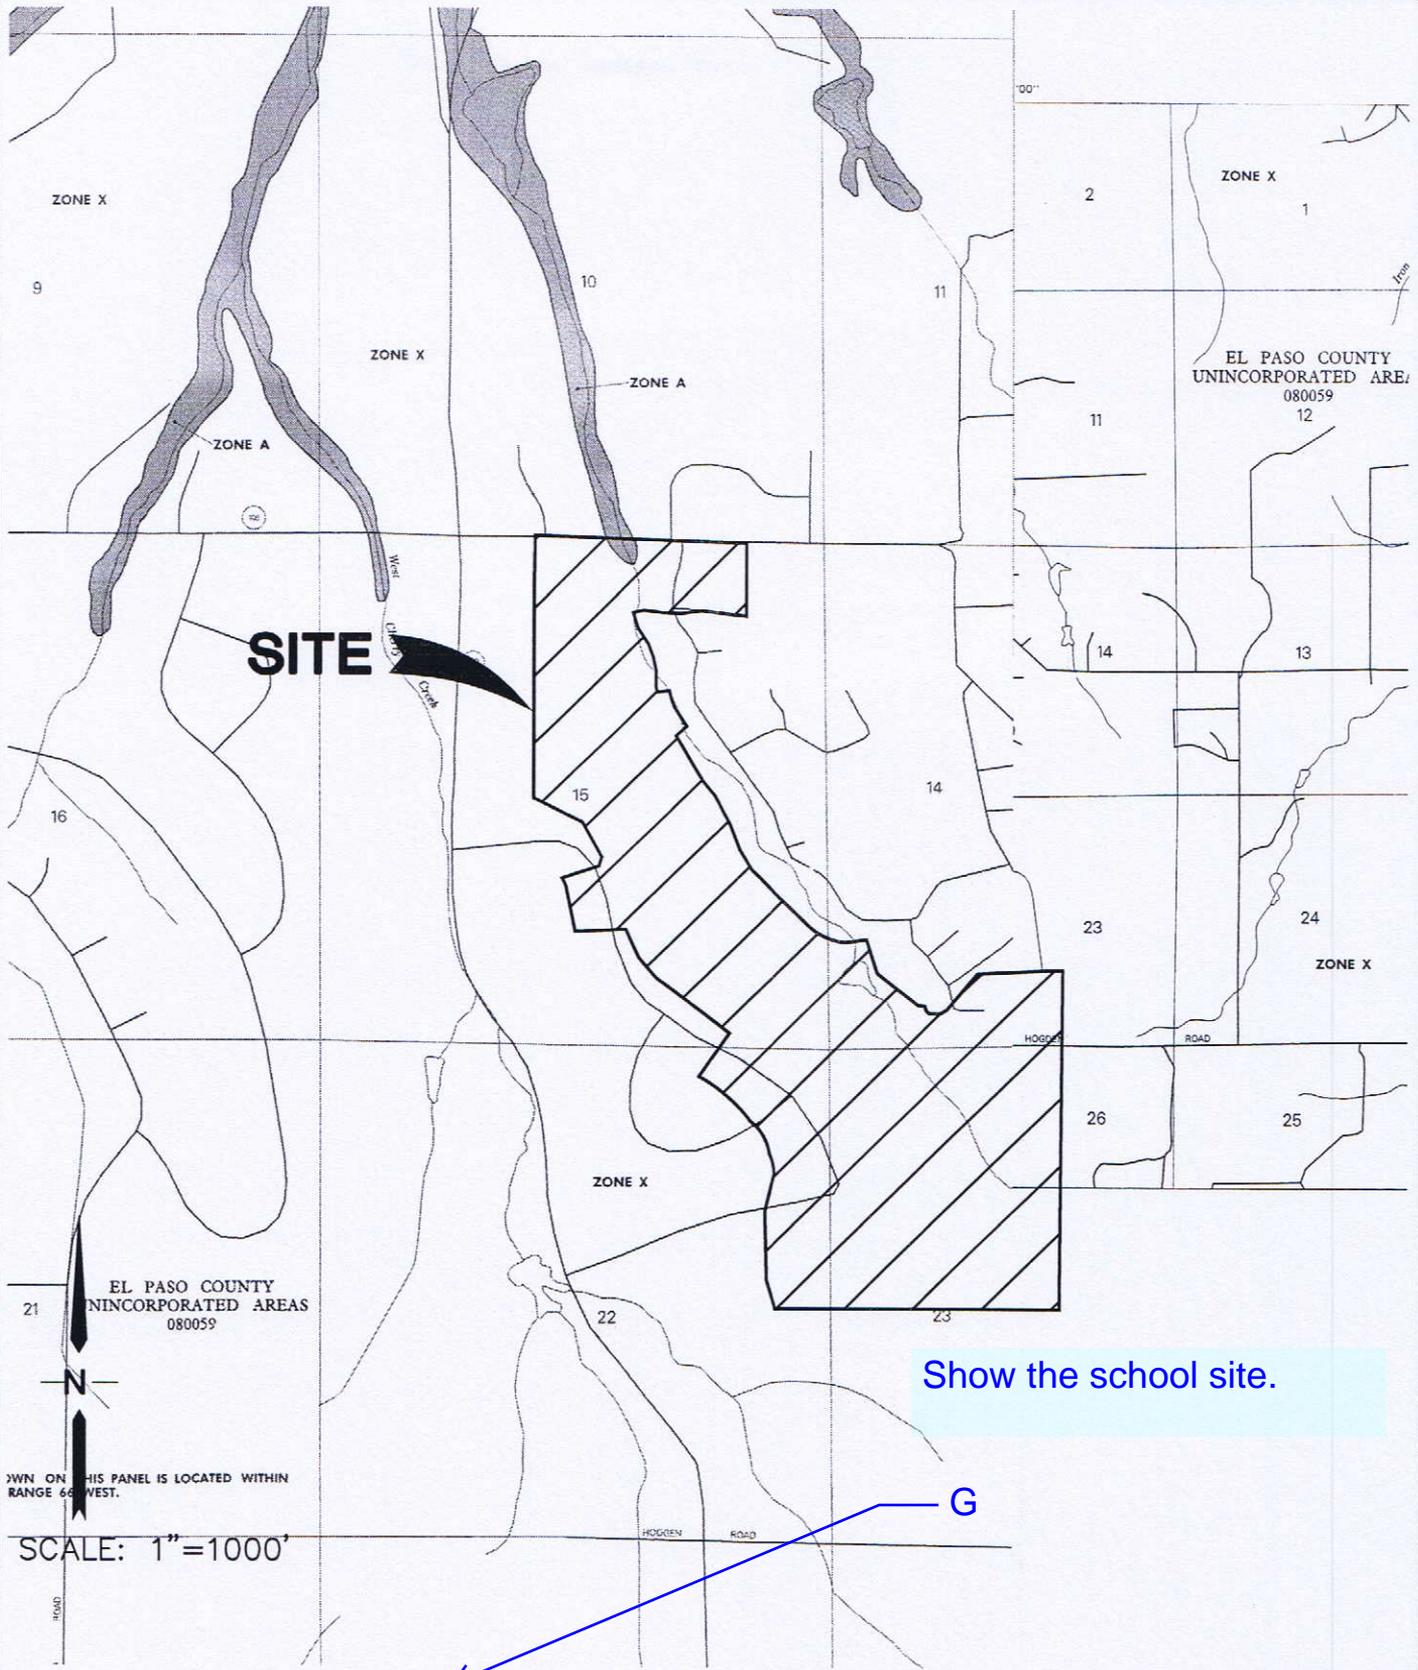

Show the school site.

FIRM PANELS 08041C0285F & 08041C0325F (MARCH 17, 1997)

FLOODPLAIN MAP

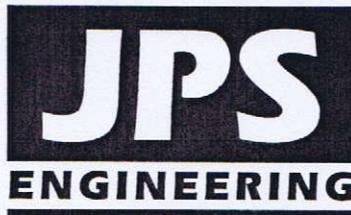

WALDEN PRESERVE

FIGURE FP-1

JPS PROJ NO. 040201

# National Flood Hazard Layer FIRMette



## Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
		Area of Undetermined Flood Hazard Zone D
GENERAL STRUCTURES		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		Cross Sections with 1% Annual Chance Water Surface Elevation
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped




The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards


The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **2/8/2019 at 7:27:28 PM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.


104°46'25.02"W  
39°6'6.61"N

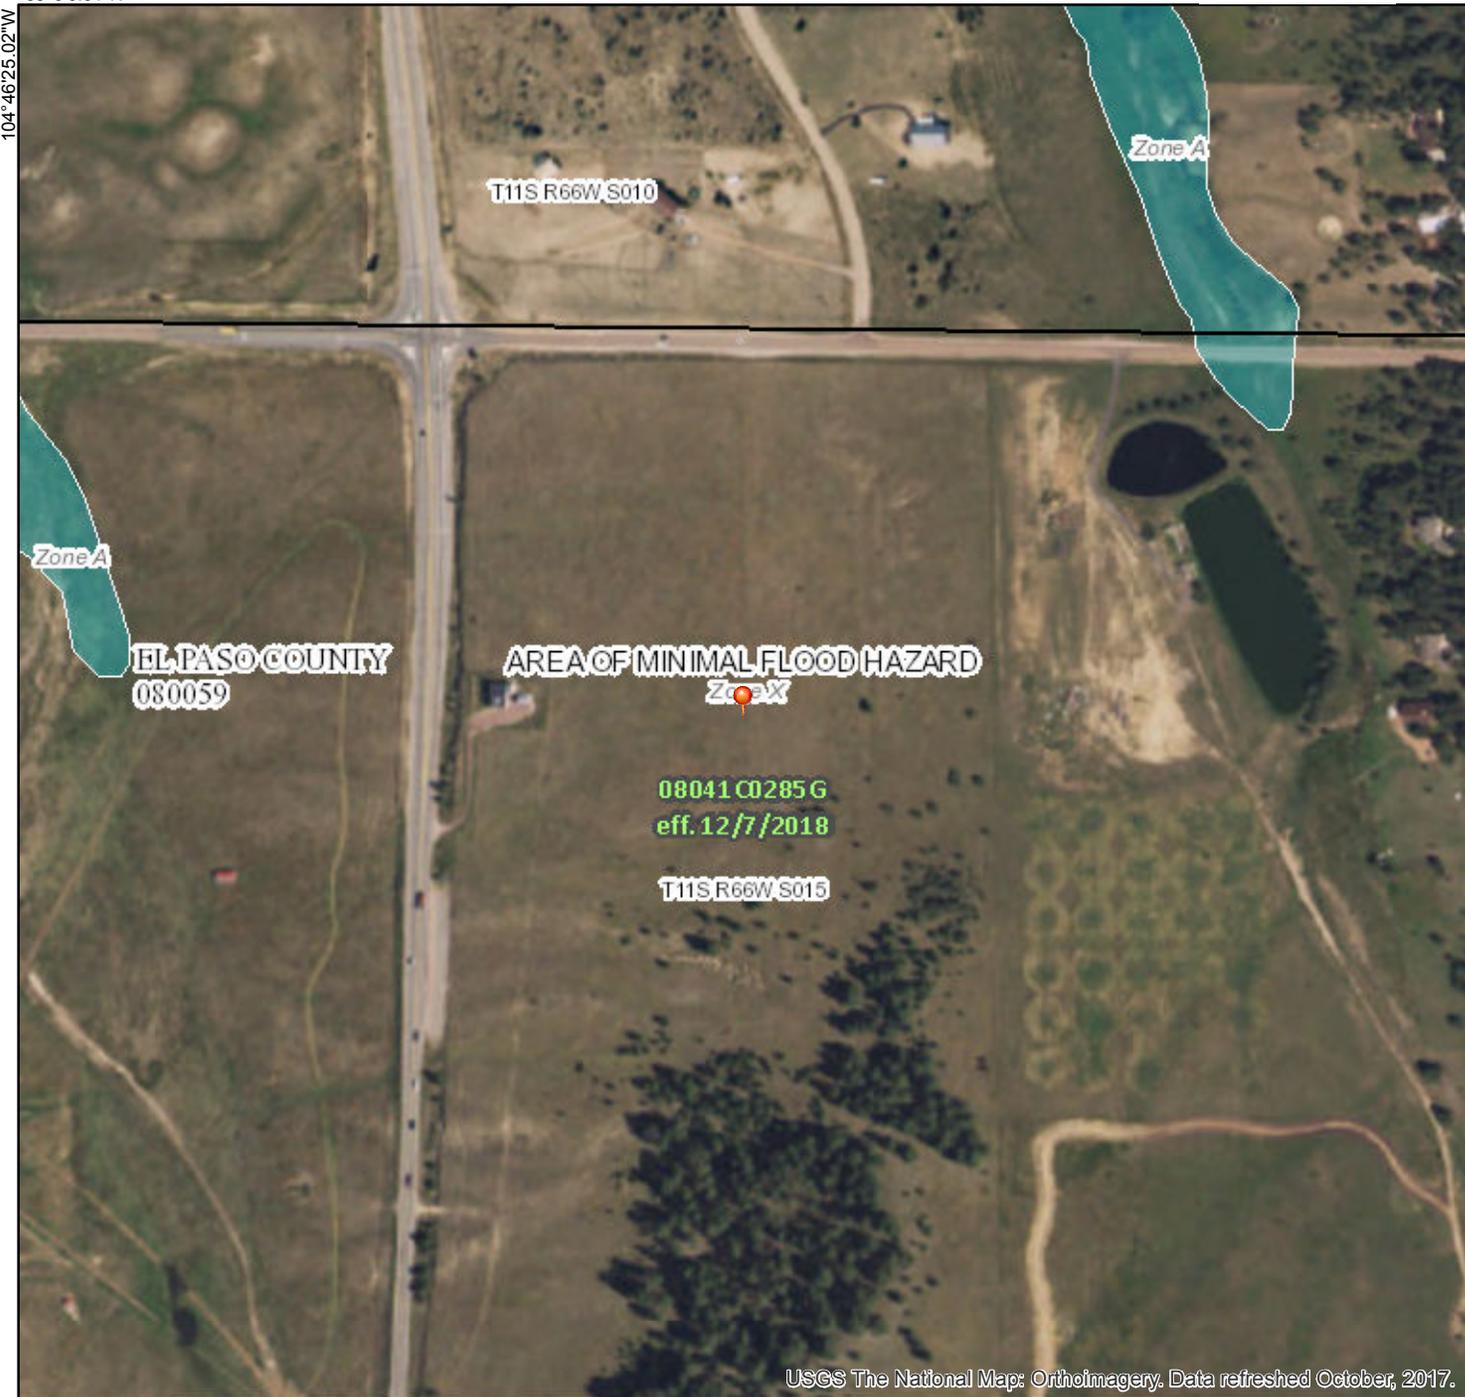



USGS The National Map: Orthoimagery. Data refreshed October, 2017.



39°5'38.69"N  
104°45'47.57"W

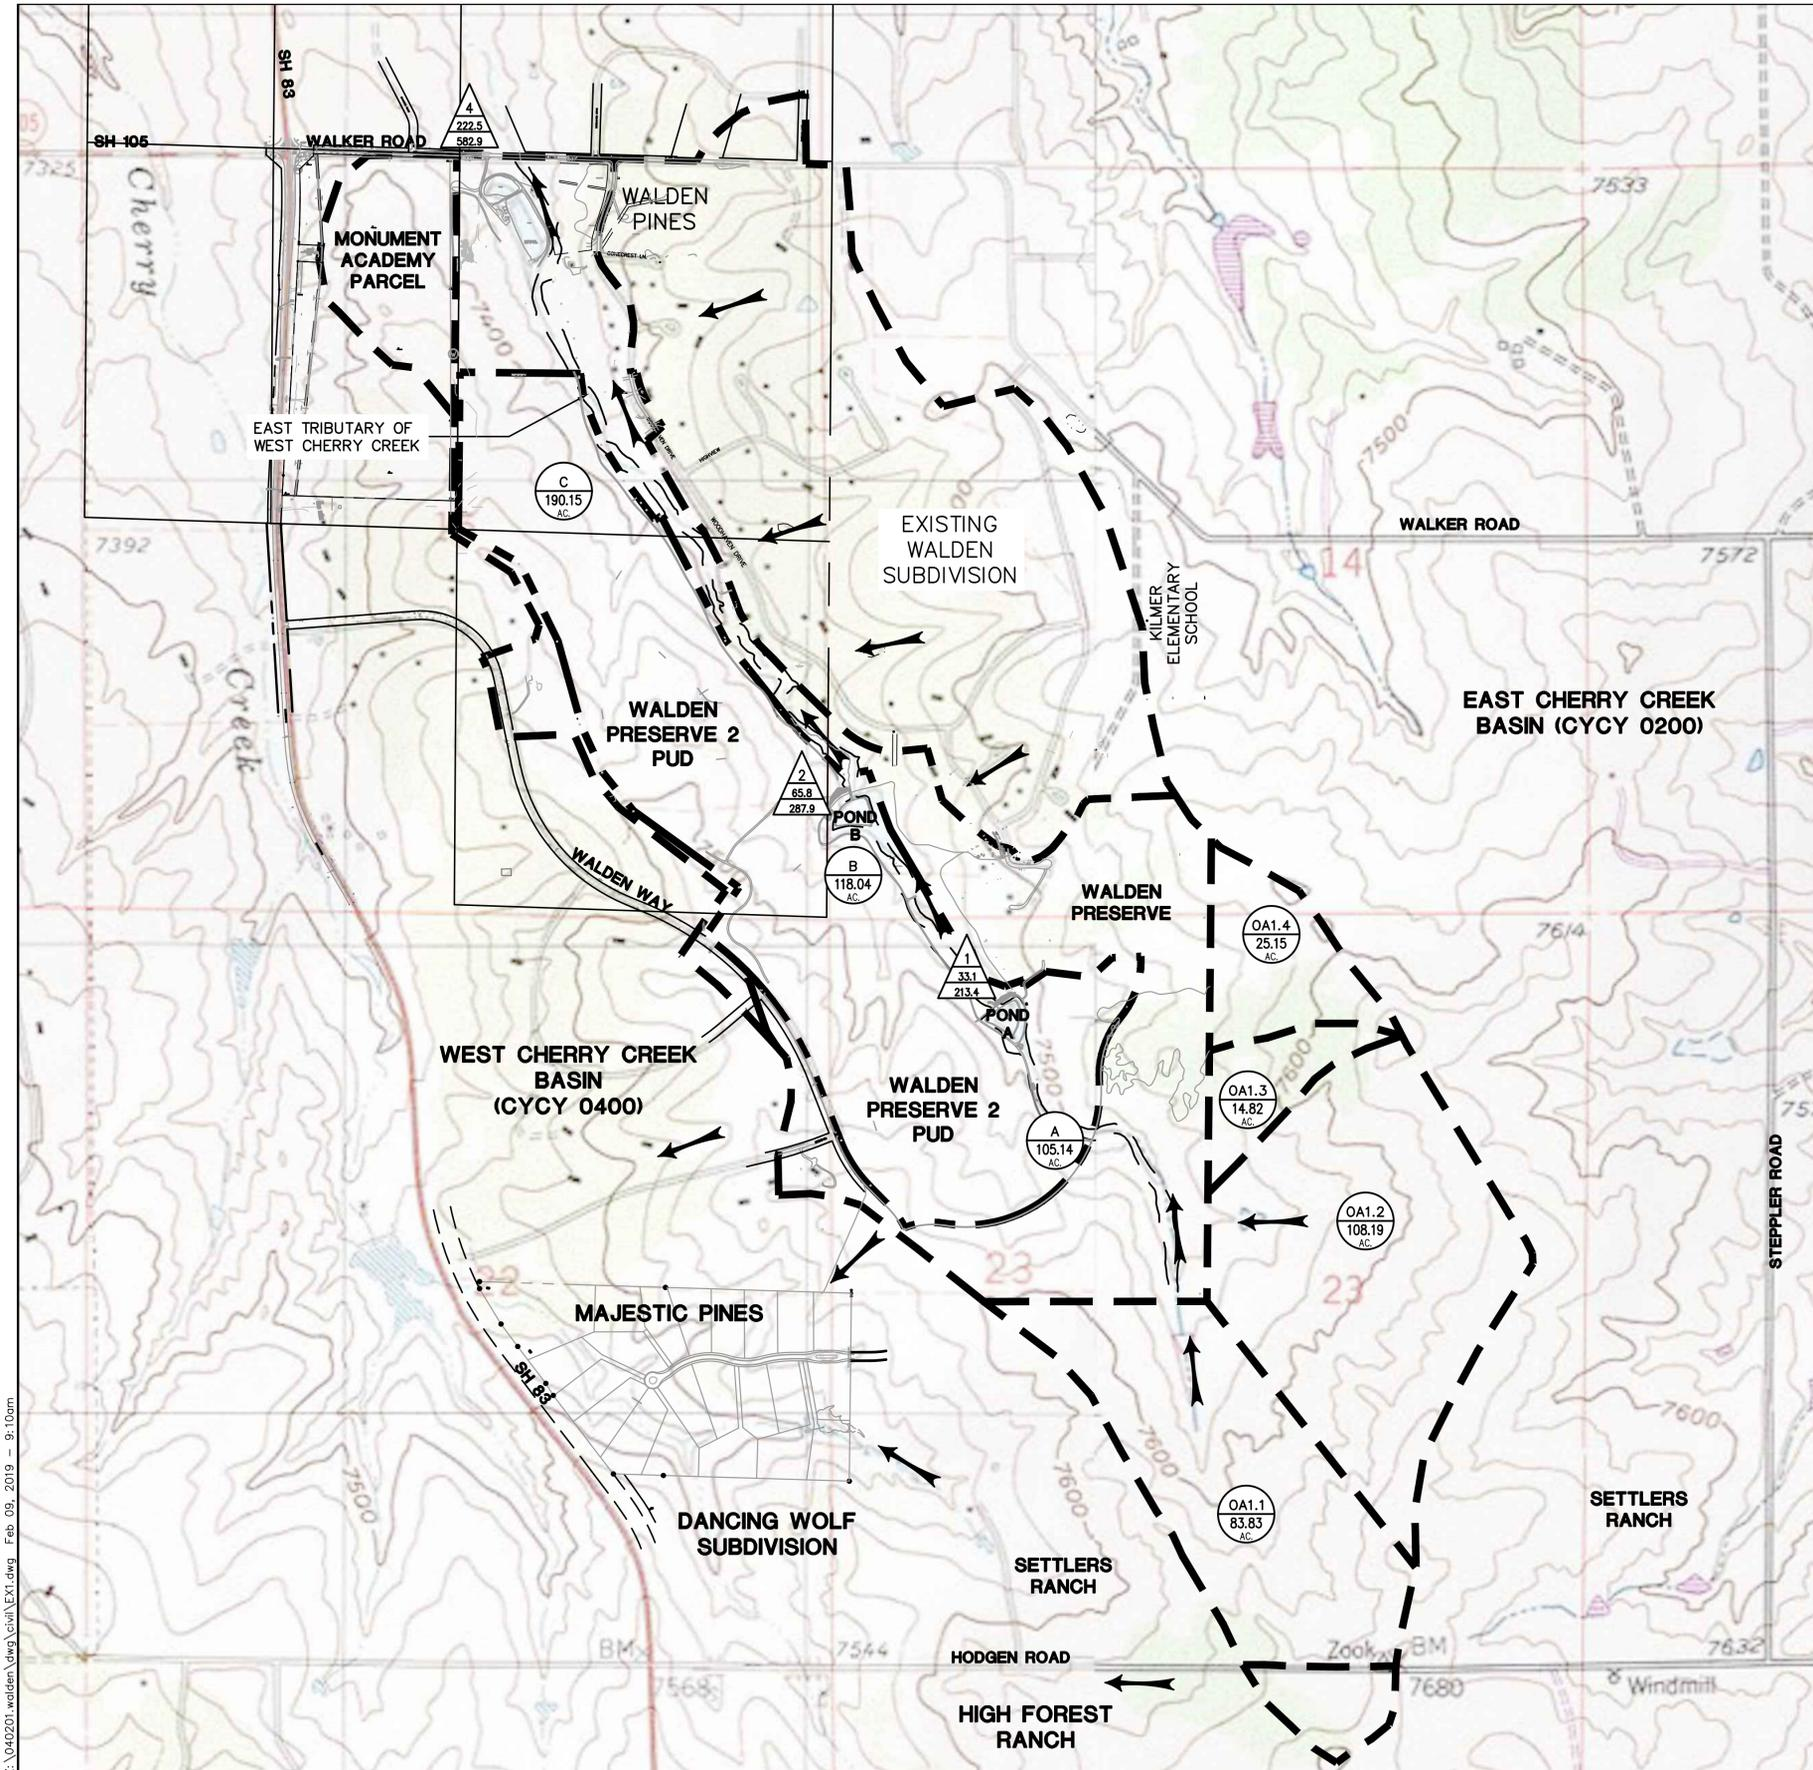

- LEGEND**
- FILING LIMITS
  - MAJOR BASIN BOUNDARY
  - EXISTING CONTOUR
  - FLOWLINE
  - DESIGN POINT
  - Qs (cfs)
  - Q100 (cfs)
  - BASIN DESIGNATION
  - BASIN AREA (ACRES)

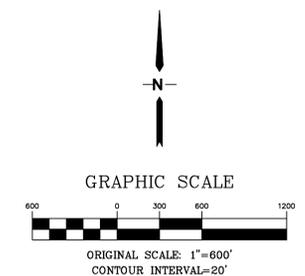

19 E. Willamette Ave.  
 Colorado Springs, CO  
 80903  
 PH: 719-477-9429  
 FAX: 719-471-0766  
 www.jpsegr.com



CALL UTILITY NOTIFICATION  
 CENTER OF COLORADO  
 1-800-922-1987  
 CALL OR VISIT WWW.COCN.COM  
 BEFORE YOU DIG, GRADE, OR EXCAVATE  
 FOR THE MARKING OF UNDERGROUND  
 MEMBER UTILITIES

# WALDEN PRESERVE SUBDIVISION

NO.	REVISION	BY	DATE


## MAJOR BASIN / HISTORIC DRAINAGE PLAN

HORZ. SCALE: 1"=600'	DRAWN: MJP
VERT. SCALE: N/A	DESIGNED: JPS
SURVEYED: PINNACLE	CHECKED: JPS
CREATED: 7/22/02	LAST MODIFIED: 2/08/19
PROJECT NO: 040201	MODIFIED BY: BJJ

SHEET: **EX1**

Z:\040201\walden\dwg\civil\EX1.dwg Feb 09, 2019 9:10am

Z:\040201\walden\_preserve\_2\MONUMENT ACADEMY\EX2.dwg Feb 09, 2019 - 9:42am

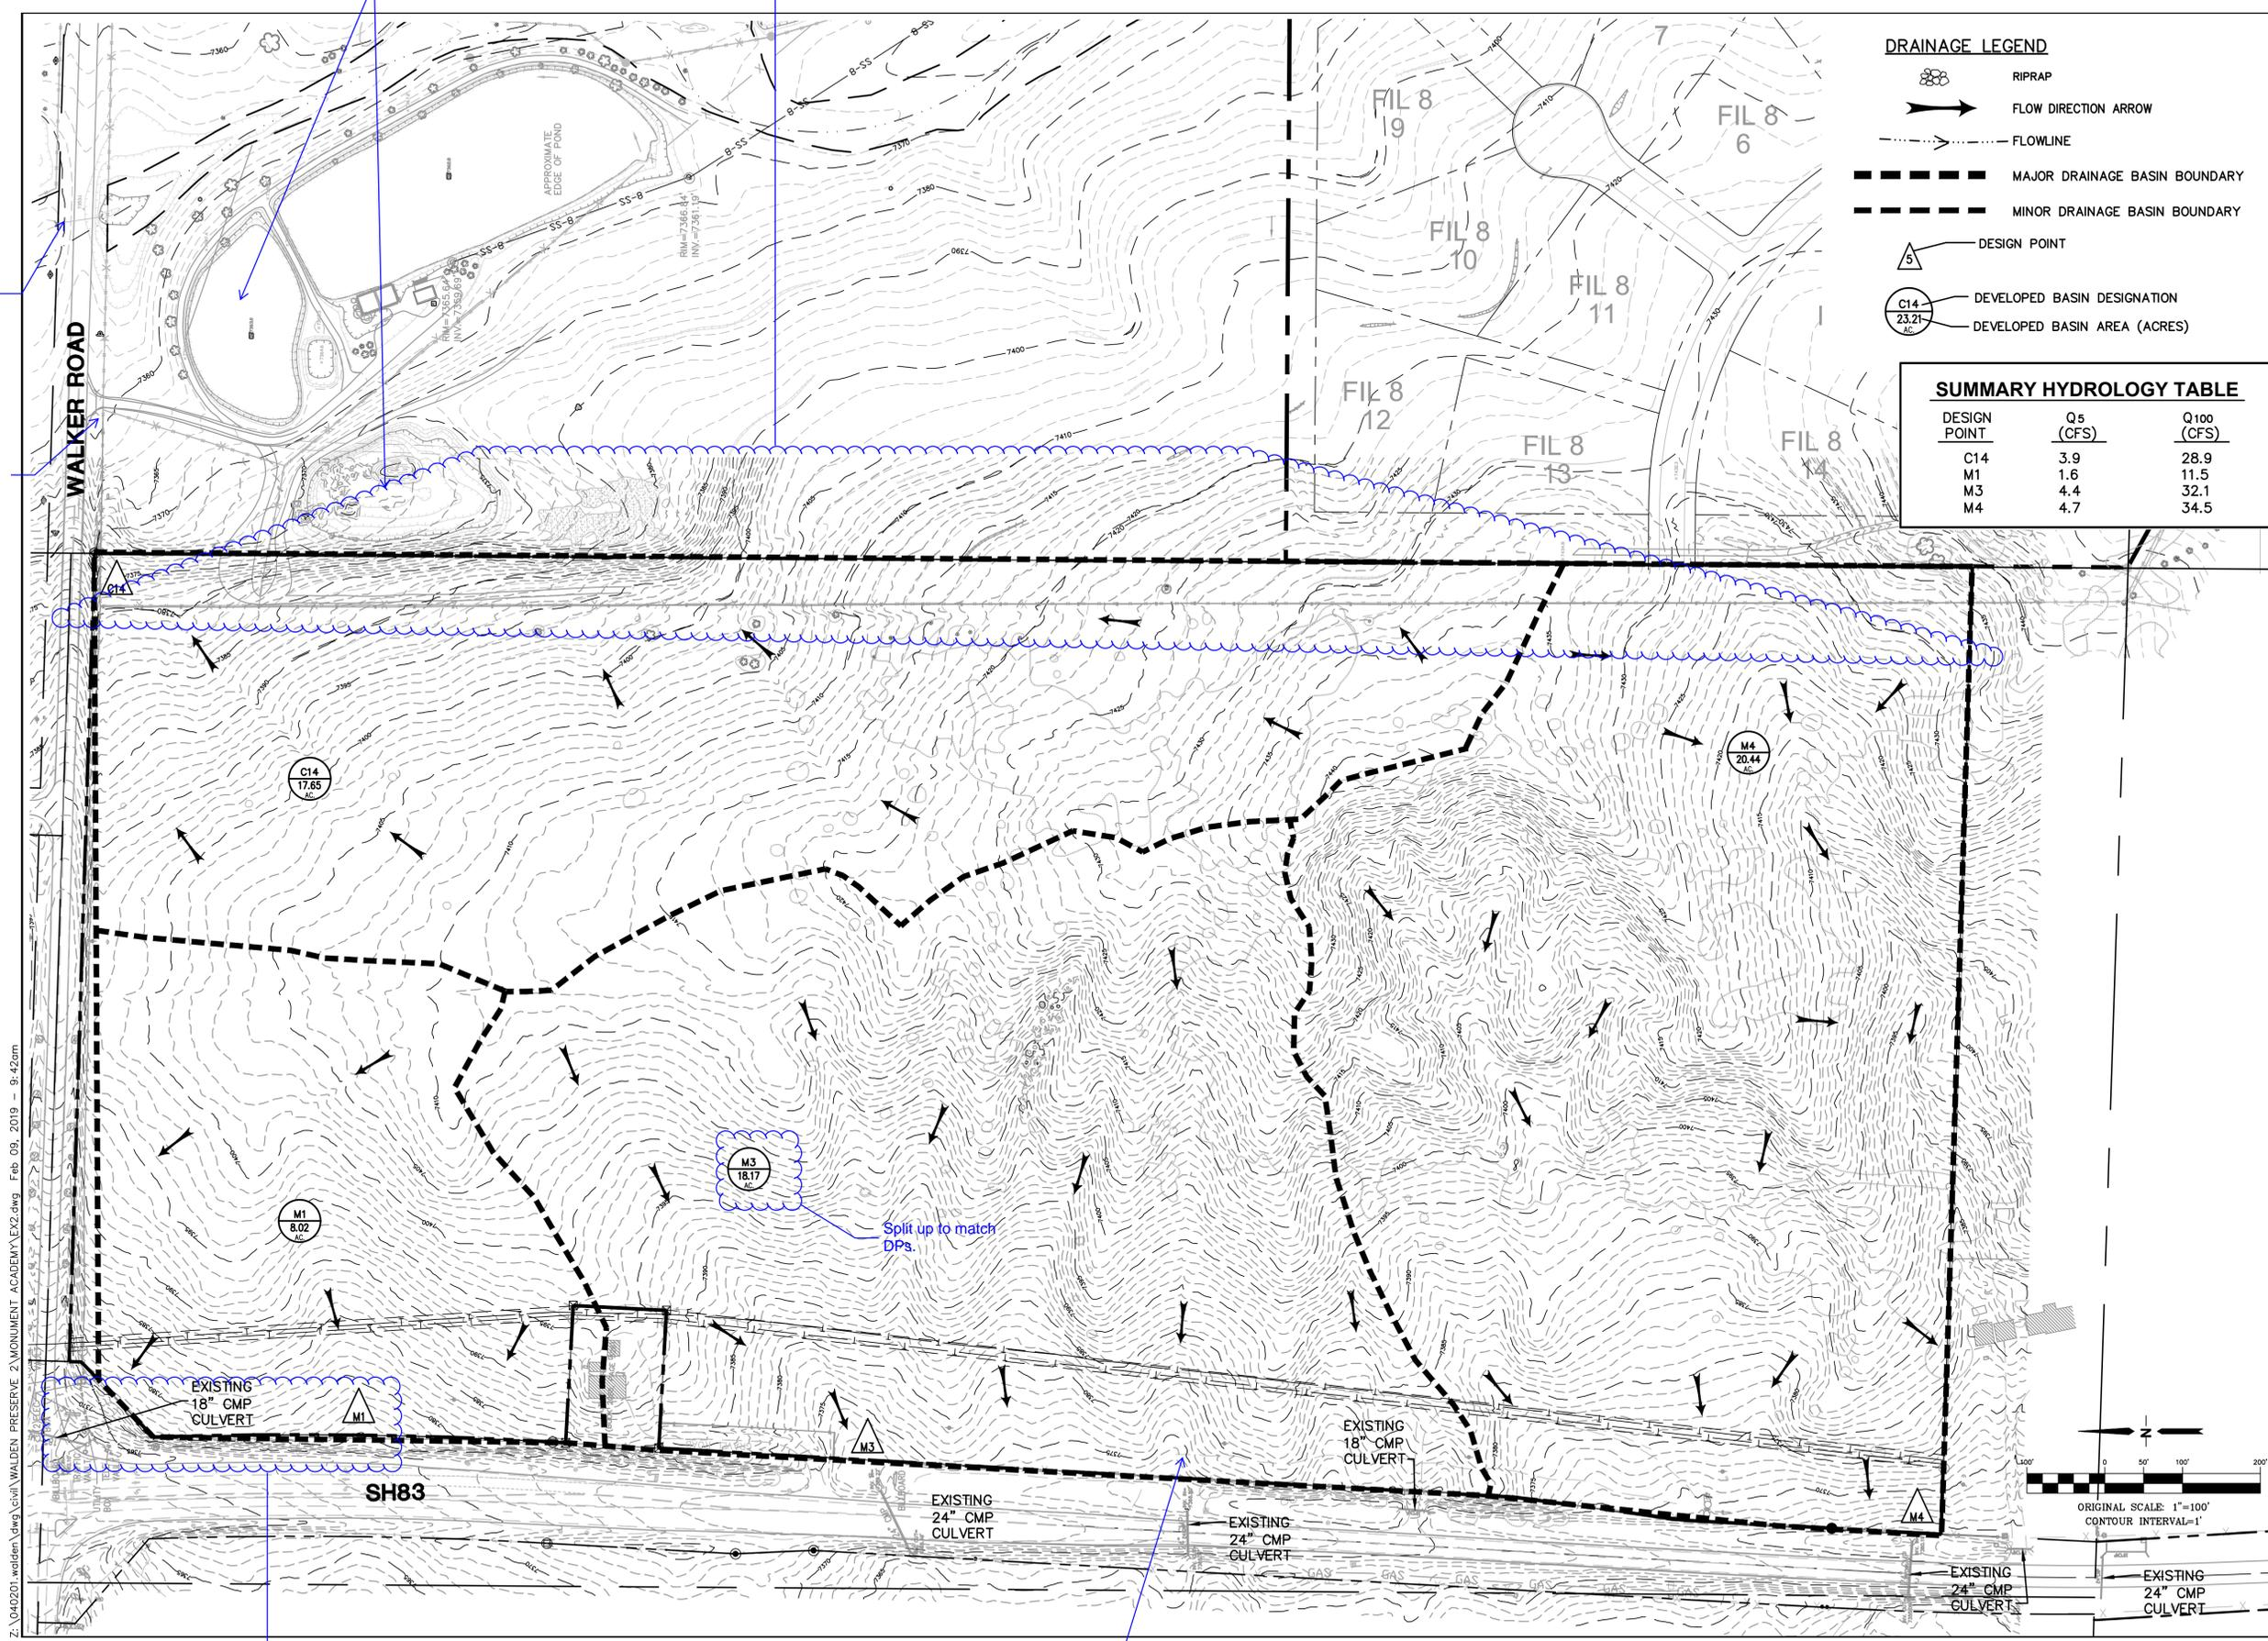


**DRAINAGE LEGEND**

- RIPRAP
- FLOW DIRECTION ARROW
- FLOWLINE
- MAJOR DRAINAGE BASIN BOUNDARY
- MINOR DRAINAGE BASIN BOUNDARY
- DESIGN POINT
- DEVELOPED BASIN DESIGNATION
- DEVELOPED BASIN AREA (ACRES)

**SUMMARY HYDROLOGY TABLE**

DESIGN POINT	Q5 (CFS)	Q100 (CFS)
C14	3.9	28.9
M1	1.6	11.5
M3	4.4	32.1
M4	4.7	34.5



# MONUMENT ACADEMY

## HISTORIC DRAINAGE PLAN

**JPS ENGINEERING**

19 E. Willamette Ave.  
Colorado Springs, CO 80903

PH: 719-477-9429  
FAX: 719-471-0766  
www.jpsegr.com

CALL UTILITY NOTIFICATION CENTER OF COLORADO 1-800-922-1987

CALL COLORADO 800-922-1987 BEFORE YOU DIG, GRADE, OR EXCAVATE FOR THE MARKINGS OF UNDERGROUND MEMBER UTILITIES.

No.	REVISION	BY	DATE

HORZ. SCALE: 1"=100'

VERT. SCALE: N/A

SURVEYED: RAMPART

CREATED: 2/08/19

PROJECT NO: 040201

SHEET: EX2

DRAWN: BJJ

DESIGNED: JPS

CHECKED: JPS

LAST MODIFIED: 2/08/19

MODIFIED BY: BJJ

Label these features

Please tie in existing contours at the property line or whichever is most recent.

Label size, provide analysis.

Provide a design point.

Split up to match DPs.

Provide flow arrows and additional DP(s) if necessary.

Provide design point.

**SUMMARY FLOWS TABLE**

DESIGN POINT	Q5 (CFS)	Q100 (CFS)
C14	3.9	28.9
M1	1.6	11.5
M3	4.4	32.1
M4	4.7	34.5

**SUMMARY HYDROLOGY TABLE**

DESIGN POINT	Q5 (CFS)	Q100 (CFS)
C14	15.7	44.8
M1	8.1	17.3
M2	19.4	40.0
M3	38.3	83.0
M4	13.9	50.1

**DRAINAGE LEGEND**

- RIPRAP
- FLOW DIRECTION ARROW
- FLOWLINE
- MAJOR DRAINAGE BASIN BOUNDARY
- MINOR DRAINAGE BASIN BOUNDARY
- DESIGN POINT
- DEVELOPED BASIN DESIGNATION
- DEVELOPED BASIN AREA (ACRES)


Are these detained flows? Provide comparison of released flows to historic.

BASIN M2	= 7.48 AC.
<b>IMPERVIOUS AREAS:</b>	
SURFACE TYPE	AREA
PARKING PAVEMENT	163,349 SF
BUILDING (ULTIMATE)	44,773 SF
TOTAL	208,122 SF
	= 4.78 AC
	= <b>63.9%</b> IMPERVIOUS
<hr/>	
BASIN C14	= 15.86 AC.
<b>IMPERVIOUS AREAS:</b>	
SURFACE TYPE	AREA
PARKING PAVEMENT	156,063 SF
BUILDING (ULTIMATE)	31,010 SF
TOTAL	187,073 SF
	= 4.29 AC
	= <b>27.0%</b> IMPERVIOUS


Label size, address capacity.

Provide a design point.

Provide water quality BMP

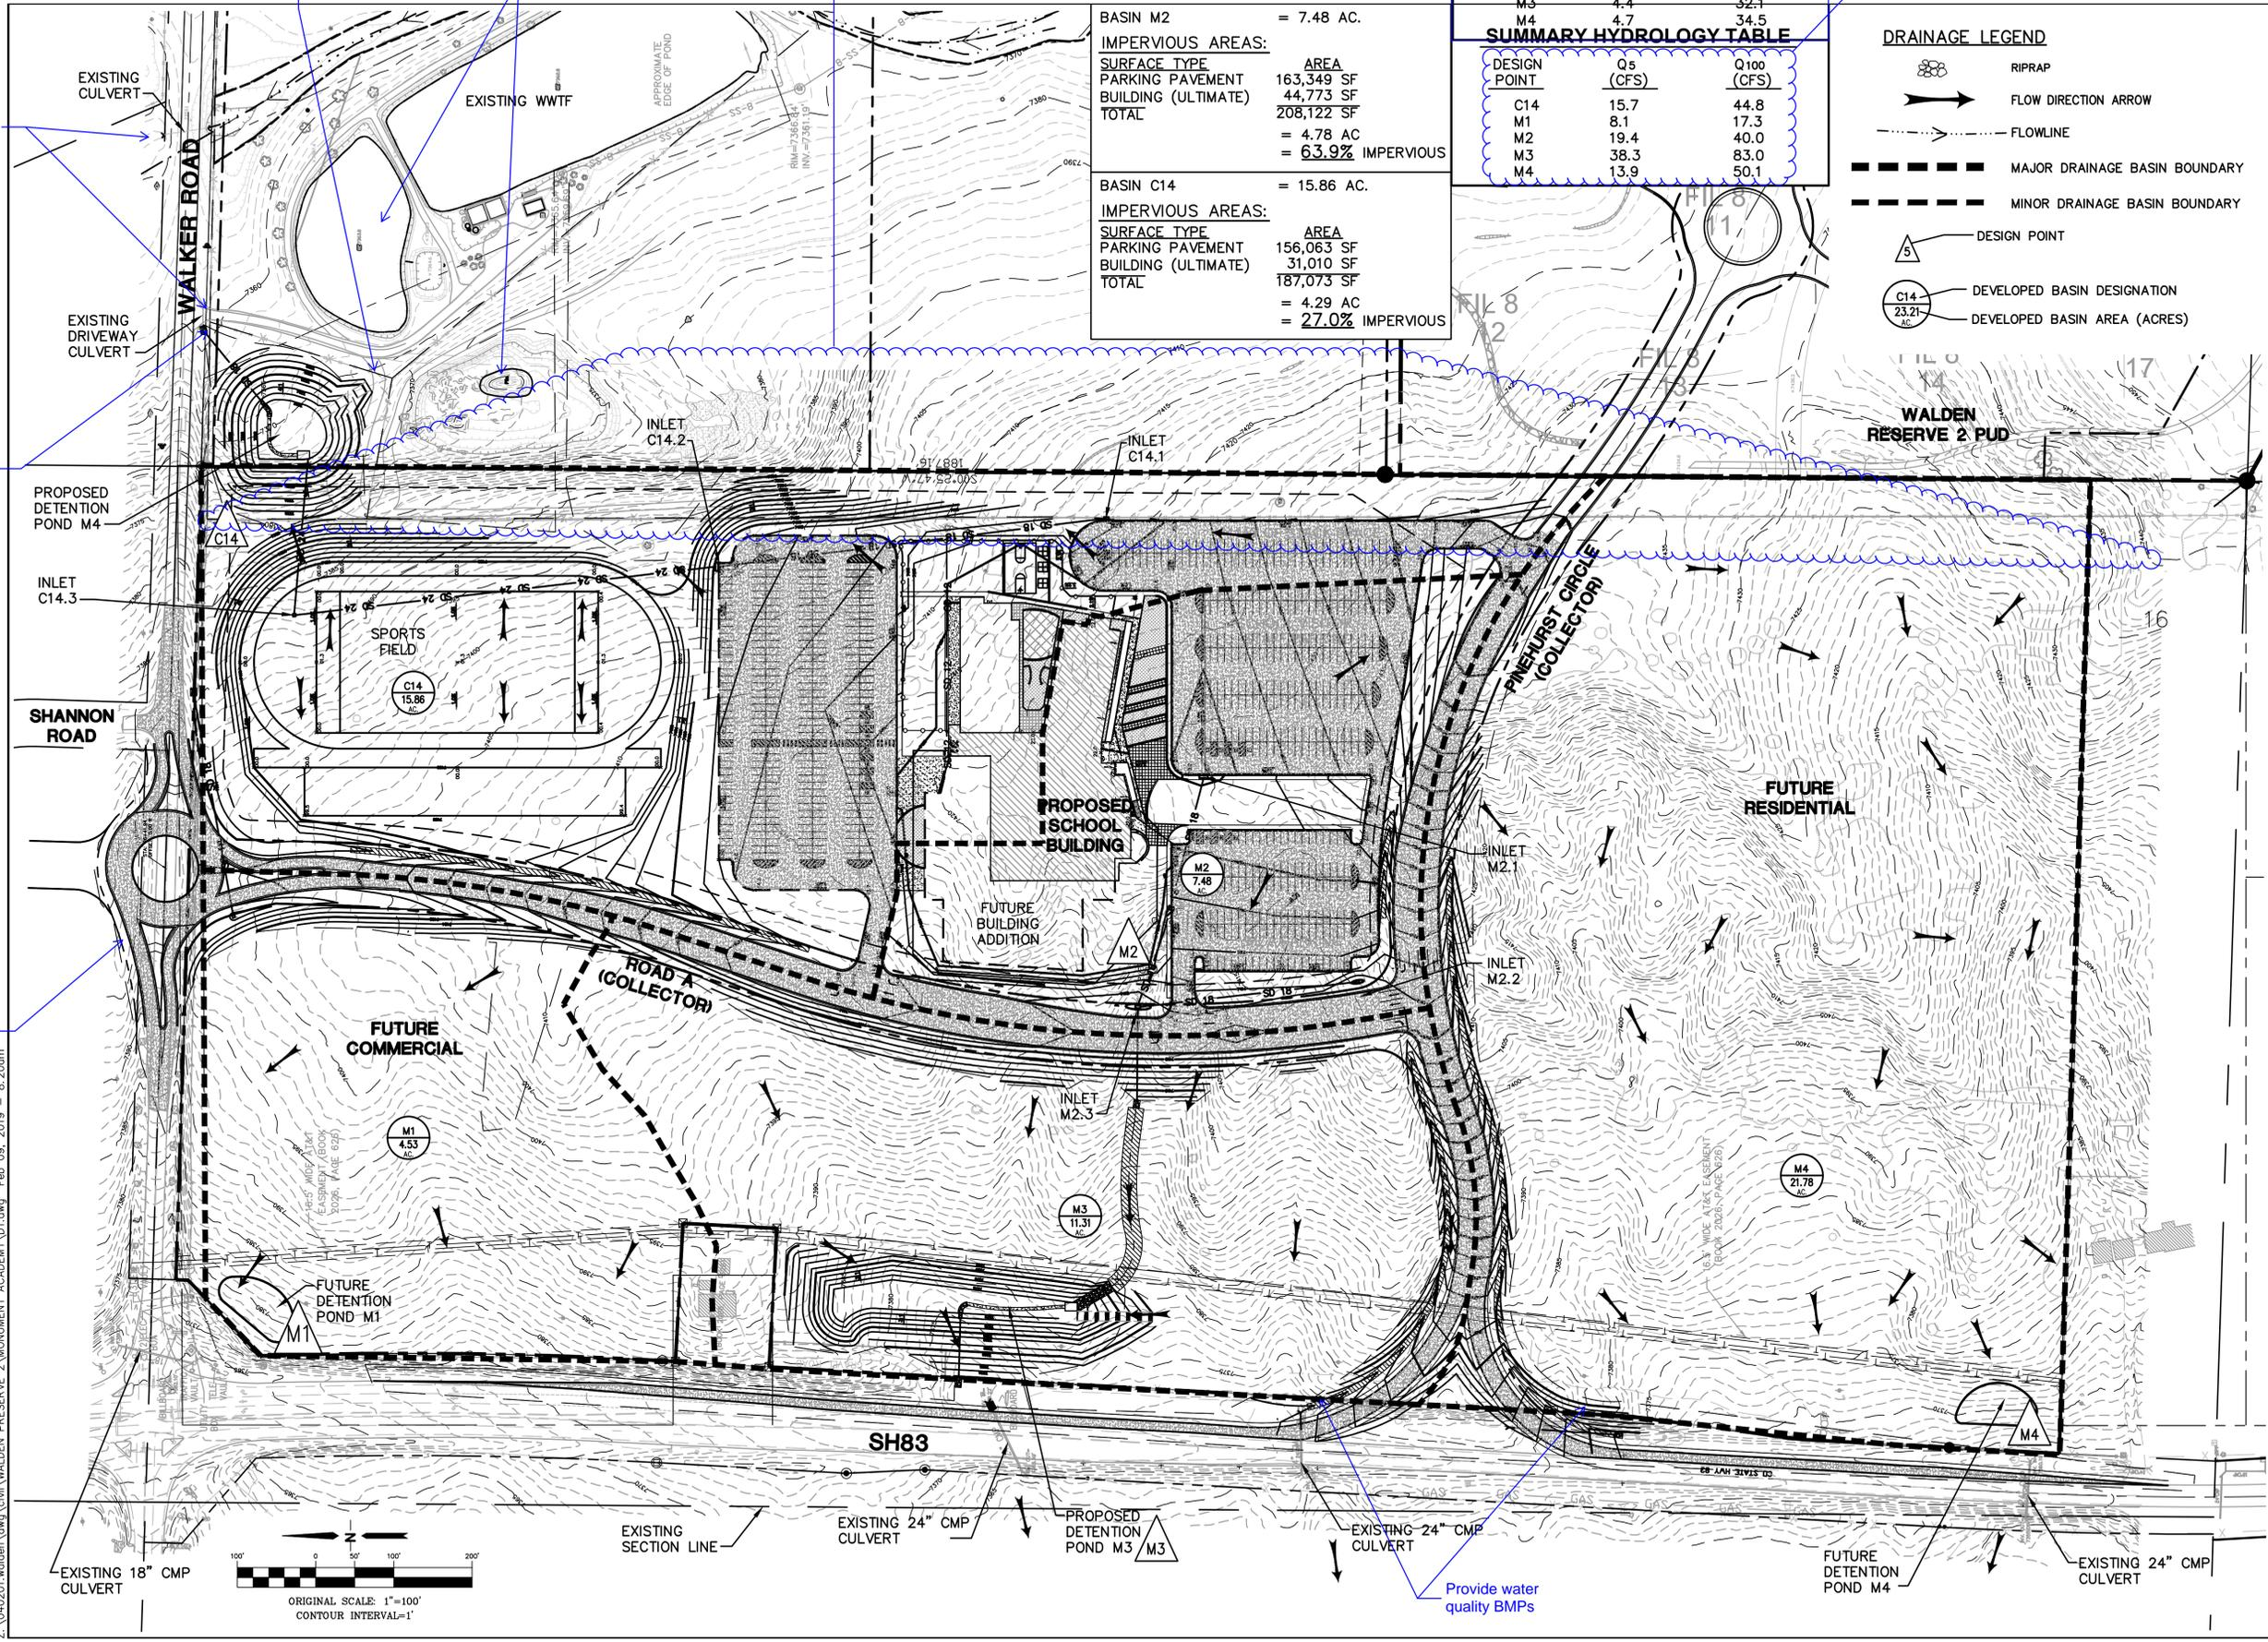

**MONUMENT ACADEMY**



19 E. Willamette Ave.  
Colorado Springs, CO 80903  
PH: 719-477-9429  
FAX: 719-471-0766  
www.jpsegr.com



CALL UTILITY NOTIFICATION CENTER OF COLORADO  
1-800-922-1987  
CALL BEFORE YOU DIG. IN ADVANCE BEFORE YOU DIG, GRADE, OR EXCAVATE FOR THE MARKING OF UNDERGROUND MEMBER UTILITIES.

No.	REVISION	BY	DATE

**DEVELOPED DRAINAGE PLAN**



HORZ. SCALE: 1"=100'	DRAWN: BJJ
VERT. SCALE: N/A	DESIGNED: JPS
SURVEYED: RAMPART	CHECKED: JPS
CREATED: 11/29/18	LAST MODIFIED: 2/08/19
PROJECT NO: 040201	MODIFIED BY: BJJ
SHEET:	

**D1**

Z:\040201\walden\walden\preserve\_2\monument\_academy.dwg Feb 09, 2019 -- 8:20am


MONUMENT  
ACADEMY  
MIDDLE/HIGH  
SCHOOL

DEVELOPMENT PLAN

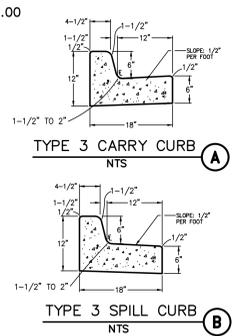

LEGEND

- PROPERTY LINE
- - - EASEMENT
- PROPOSED CONTOUR
- - - EXISTING CONTOUR
- × 99.0 PROPOSED SPOT ELEVATION (FLOWLINE)
- × 99.0 EXIST. SPOT ELEVATION
- SF SILT FENCE
- RR RIPRAP PAD
- VTC VEHICLE TRACKING PAD
- SM SEED & MULCH
- IP INLET PROTECTION
- SB SEDIMENT BASIN
- GB GRASS BUFFER
- EDB EXTENDED DETENTION BASIN
- CWA CONCRETE WASHOUT AREA
- ECB EROSION CONTROL BLANKET DITCH LINING



19 E. Willamette Ave.  
Colorado Springs, CO  
80903  
PH: 719-477-9429  
FAX: 719-471-0766  
www.jpseng.com

OWNERSHIP OF INSTRUMENTS OF SERVICE:  
ALL REPORTS, PLANS, SPECIFICATIONS, COMPUTER FILES, FIELD DATA, NOTES AND OTHER DOCUMENTS AND INSTRUMENTS PREPARED BY DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. THE DESIGN PROFESSIONAL SHALL RETAIN ALL COMMON LAW STATUTORY AND OTHER RESERVED RIGHTS INCLUDING THE COPYRIGHT THEREON.

KEYED NOTES:

- 1 CONTRACTOR MAY WASTE EXCESS CUT MATERIAL OR BORROW SUITABLE FILL MATERIAL FROM THIS AREA. MAINTAIN POSITIVE DRAINAGE & MATCH INTO EXISTING GRADES WITH 3:1 MAX. SLOPE.
- 2 PREPARE AND COMPACT BUILDING FOUNDATION & SLABS PER PROJECT GEOTECHNICAL REPORT
- 3 HEAVY DUTY PAVEMENT:  
5" HBP OVER 5" ABC (REFER TO GEOTECH REPORT)
- 4 LIGHT DUTY PAVEMENT:  
4" HBP OVER 5" ABC (REFER TO GEOTECH REPORT)
- 5 2' CURB CHASE
- 6 BUILDING MATERIAL STORAGE AREA
- 7 TOPSOIL STOCKPILE AREA

NO.	REVISION	BY	DATE
1	SDP SUBMITTAL	JPS	2/08/19

ARCHITECTS AIA  
CRP 100 E. St. Vrain, Suite 300  
Colorado Springs, Colorado 80903

NORTH SITE GRADING & EROSION CONTROL PLAN

SCALE: 1"=50'





DATE: 12/20/18	
DRAWN BY: BJJ	
CHECKED BY: JPS	
REVISED: 2/08/19	

BENCHMARK:  
BENCHMARK 4 BB RESET 1984 NAVD  
88 DATUM ELEV.=7570.80 FOUND  
BRASS CAP IN CONCRETE INT HWY 83  
& HODGEN RD.

MATCH LINE  
SEE SHT. C2.2

MONUMENT  
ACADEMY  
MIDDLE/HIGH  
SCHOOL

DEVELOPMENT PLAN

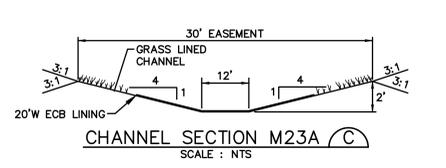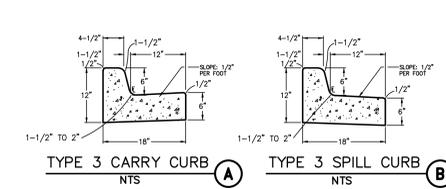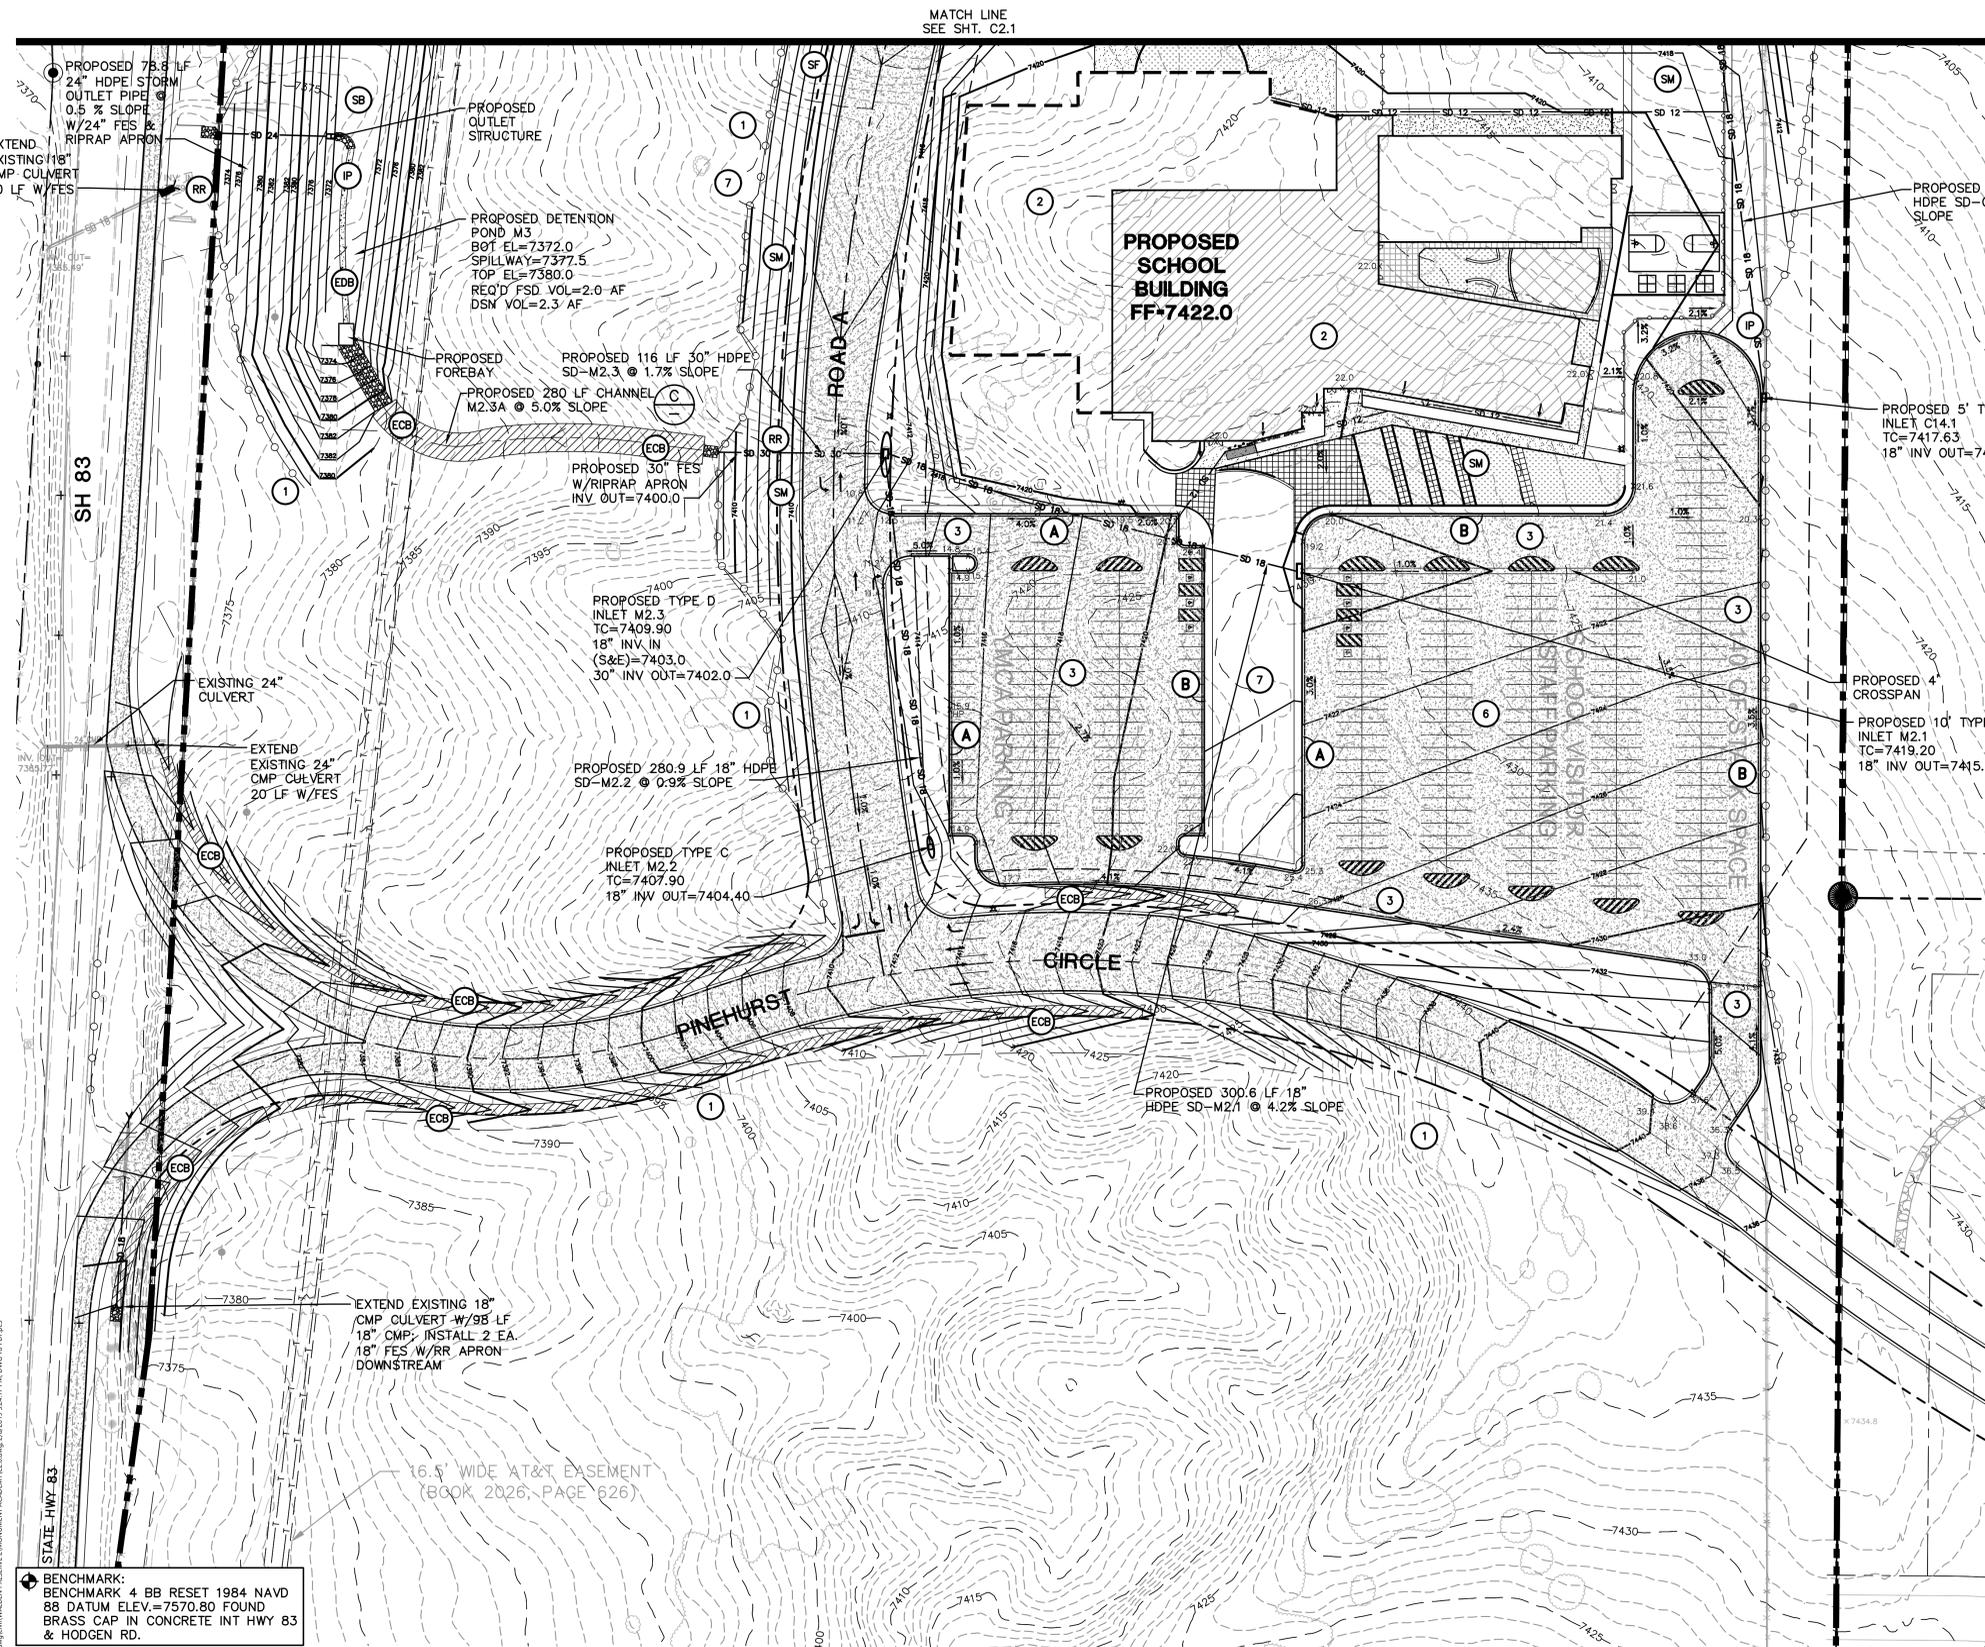


- LEGEND**
- PROPERTY LINE
  - - - EASEMENT
  - PROPOSED CONTOUR
  - - - EXISTING CONTOUR
  - × 99.0 PROPOSED SPOT ELEVATION (FLOWLINE)
  - × 99.0 EXIST. SPOT ELEVATION
  - SF SILT FENCE
  - VTC VEHICLE TRACKING PAD
  - IP INLET PROTECTION
  - GB GRASS BUFFER
  - CWA CONCRETE WASHOUT AREA
  - RR RIPRAP PAD
  - SM SEED & MULCH
  - SB SEDIMENT BASIN
  - EDB EXTENDED DETENTION BASIN
  - ECB EROSION CONTROL BLANKET DITCH LINING

ROOF DRAIN DOWNSPOUTS: INSTALL TRANSITION COUPLINGS & EXTEND 12" PVC STORM DRAIN TO STORM SEWER SYSTEM @ 1.0% MIN. SLOPE UNLESS NOTED OTHERWISE (COORDINATE W/ARCH. & PLUMBING PLANS)

**NOTE:**  
ALL EROSION CONTROL MEASURES SHALL CONFORM TO CITY OF COLORADO SPRINGS DRAINAGE CRITERIA MANUAL, VOLUME 2 REQUIREMENTS.

- KEYED NOTES:**
- 1 CONTRACTOR MAY WASTE EXCESS CUT MATERIAL OR BORROW SUITABLE FILL MATERIAL FROM THIS AREA. MAINTAIN POSITIVE DRAINAGE & MATCH INTO EXISTING GRADES WITH 3:1 MAX. SLOPE.
  - 2 PREPARE AND COMPACT BUILDING FOUNDATION & SLABS PER PROJECT GEOTECHNICAL REPORT
  - 3 HEAVY DUTY PAVEMENT: 5" HBP OVER 5" ABC (REFER TO GEOTECH REPORT)
  - 4 LIGHT DUTY PAVEMENT: 4" HBP OVER 5" ABC (REFER TO GEOTECH REPORT)
  - 5 2' CURB CHASE
  - 6 BUILDING MATERIAL STORAGE AREA
  - 7 TOPSOIL STOCKPILE AREA

NO.	REVISION	BY	DATE
1	SDP SUBMITTAL	JPS	2/08/19



19 E. Willamette Ave.  
Colorado Springs, CO 80903  
PH: 719-477-9429  
FAX: 719-471-0766  
www.jpsegr.com

OWNERSHIP OF INSTRUMENTS OF SERVICE:  
ALL REPORTS, PLANS, SPECIFICATIONS, COMPUTER FILES, FIELD DATA, NOTES AND OTHER DOCUMENTS AND INSTRUMENTS PREPARED BY DESIGN PROFESSIONALS AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. THE DESIGN PROFESSIONAL SHALL RETAIN ALL COMMON LAW STATUTORY AND OTHER RESERVED RIGHTS INCLUDING THE COPYRIGHT THEREON.

ARCHITECTS AIA  
100 E. St. Vrain, Suite 300  
Colorado Springs, Colorado 80903

**SOUTH SITE GRADING & EROSION CONTROL PLAN**  
SCALE: 1"=50'






**NORTH**  
DATE: 12/20/18  
DRAWN BY: BJJ  
CHECKED BY: JPS  
REVISED: 2/08/19

Z:\2002\monument\academy\monument\academy\c2.dwg, 2/8/2019 10:47:11 AM, DWG TO PDF, JPS

**BENCHMARK:**  
BENCHMARK 4 BB RESET 1984 NAVD  
88 DATUM ELEV.=7570.80 FOUND  
BRASS CAP IN CONCRETE INT HWY 83  
& HODGEN RD.


# MONUMENT ACADEMY MIDDLE/HIGH SCHOOL

## DEVELOPMENT PLAN

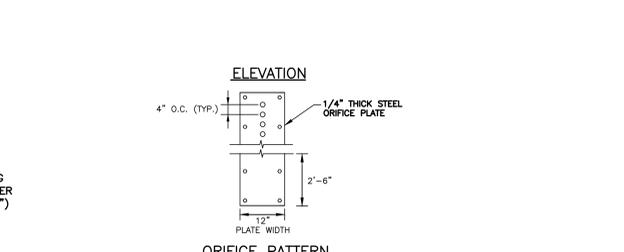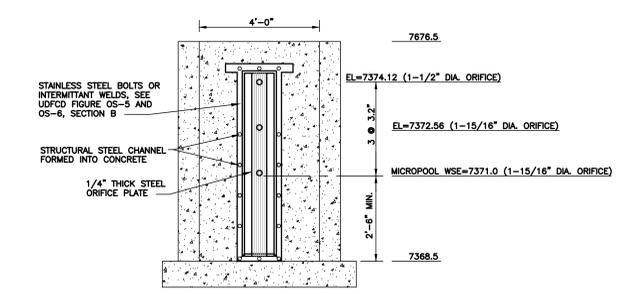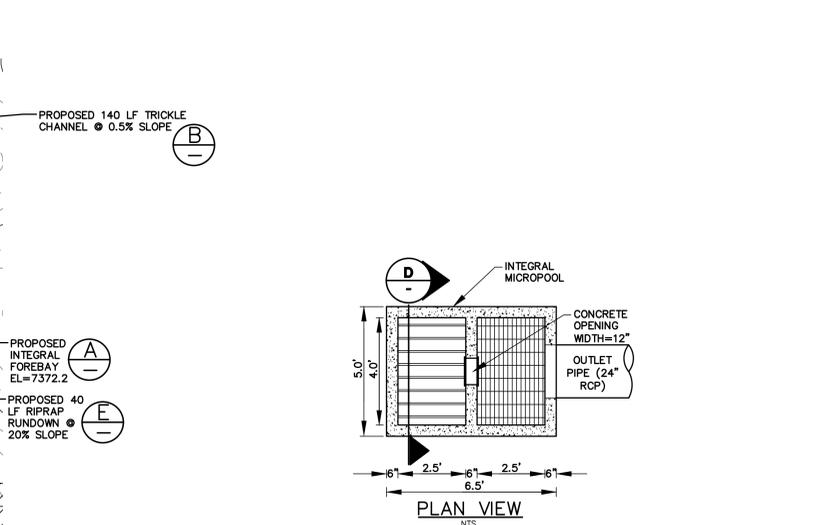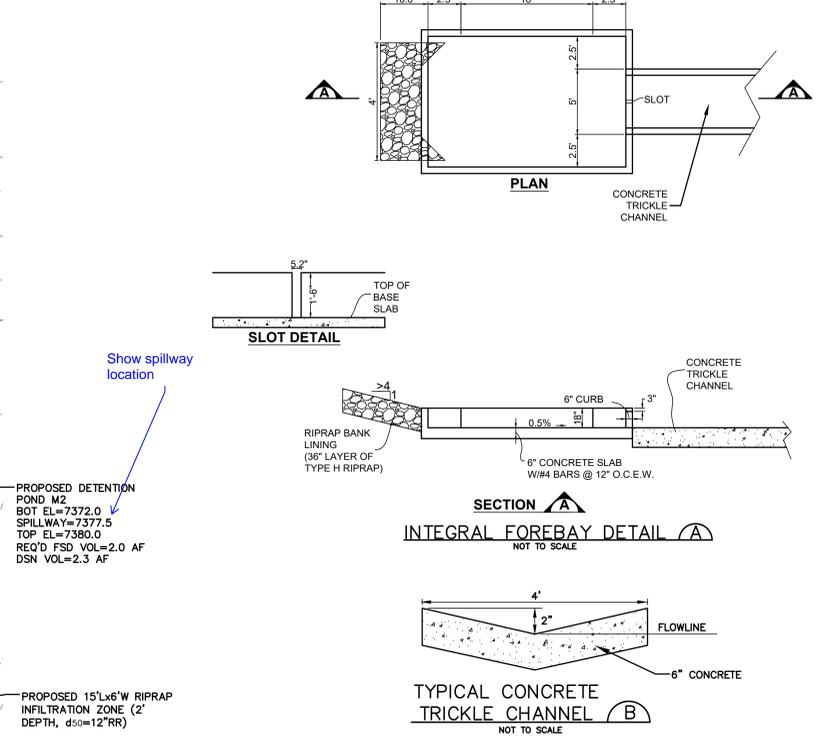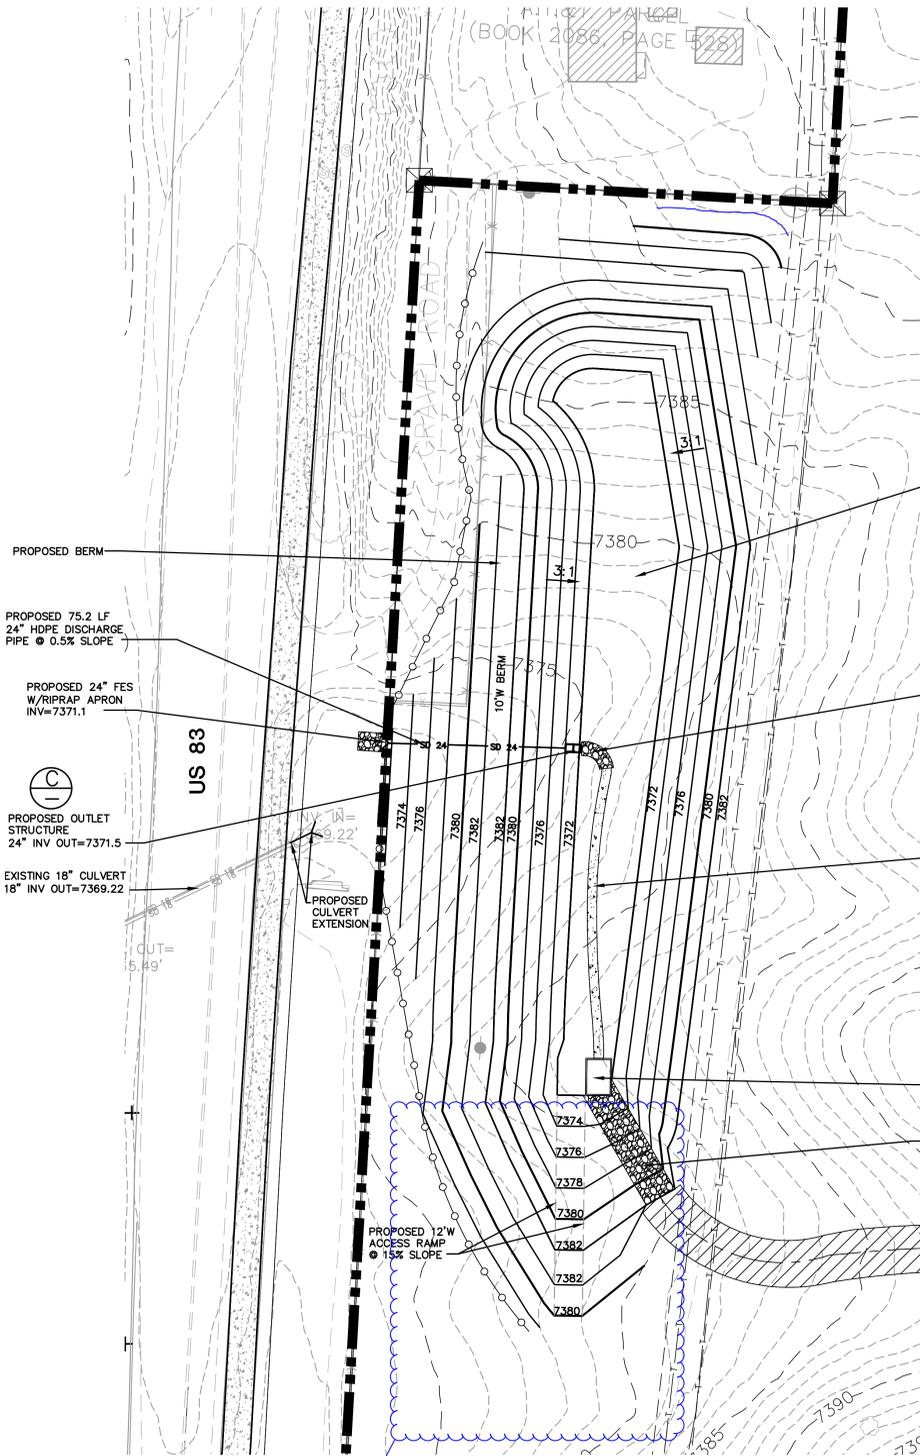

- ORIFICE PLATE NOTES:**
- MINIMIZE THE NUMBER OF COLUMNS.
  - PROVIDE GASKET MATERIAL BETWEEN THE ORIFICE PLATE AND CONCRETE.
  - BOLT PLATE TO CONCRETE 12" MAX. ON CENTER.
- EURV AND WQCV TRASH RACKS:**
- WELL-SCREEN TRASH RACKS (FOR CIRCULAR ORIFICES) SHALL BE STAINLESS STEEL AND SHALL BE ATTACHED BY INTERMITTENT WELDS ALONG THE EDGE OF THE MOUNTING FRAME.
  - STRUCTURAL DESIGN OF TRASH RACKS SHALL BE BASED ON FULL HYDROSTATIC HEAD WITH ZERO HEAD DOWNSTREAM OF THE RACK.
- OVERFLOW TRASH RACKS:**
- ALL TRASH RACKS SHALL BE MOUNTED USING STAINLESS STEEL HARDWARE AND PROVIDED WITH HINGED AND LOCKABLE OR BOLTABLE ACCESS PANELS.
  - TRASH RACKS SHALL BE STAINLESS STEEL, ALUMINUM, OR STEEL. STEEL TRASH RACKS SHALL BE HOT DIP GALVANIZED AND MAY BE HOT POWDER COATED AFTER GALVANIZING.
  - TRASH RACKS SHALL BE DESIGNED SUCH THAT THE DIAGONAL DIMENSION OF EACH OPENING IS SMALLER THAN THE DIAMETER OF THE OUTLET PIPE.
  - STRUCTURAL DESIGN OF TRASH RACKS SHALL BE BASED ON FULL HYDROSTATIC HEAD WITH ZERO HEAD DOWNSTREAM OF THE RACK.

NO.	REVISION	BY	DATE
1	SDP SUBMITTAL	JPS	2/08/19



19 E. Willamette Ave.  
Colorado Springs, CO  
80903  
PH: 719-477-9429  
FAX: 719-471-0766  
www.jpseng.com

OWNERSHIP OF INSTRUMENTS OF SERVICE:  
ALL REPORTS, PLANS, SPECIFICATIONS, COMPUTER FILES, FIELD DATA, NOTES AND OTHER DOCUMENTS AND INSTRUMENTS PREPARED BY DESIGN PROFESSIONAL AS INSTRUMENTS OF SERVICE SHALL REMAIN THE PROPERTY OF THE DESIGN PROFESSIONAL. THE DESIGN PROFESSIONAL SHALL RETAIN ALL COMMON LAW STATUTORY AND OTHER RESERVED RIGHTS INCLUDING THE COPYRIGHT THEREON.

ARCHITECTS AIA  
100 E. St. Vrain, Suite 300  
Colorado Springs, Colorado 80903










### DETENTION POND M3 PLAN & DETAILS

SCALE: AS SHOWN

NORTH	DATE:	12/20/18
	DRAWN BY:	BJJ
	CHECKED BY:	JPS
	REVISED:	2/08/19

# MONUMENT ACADEMY MIDDLE/HIGH SCHOOL

## DEVELOPMENT PLAN

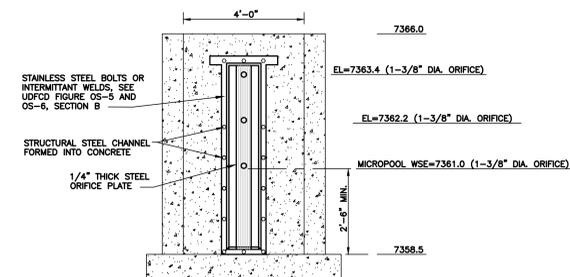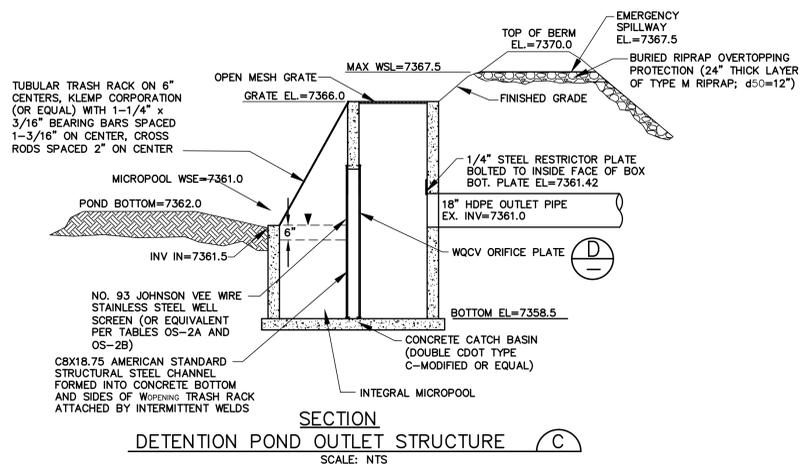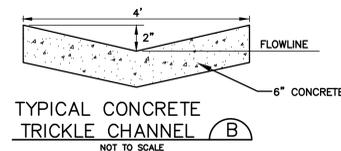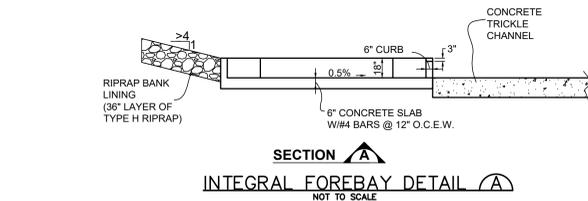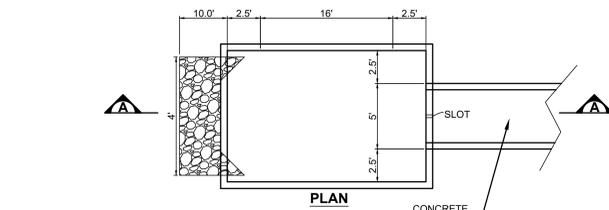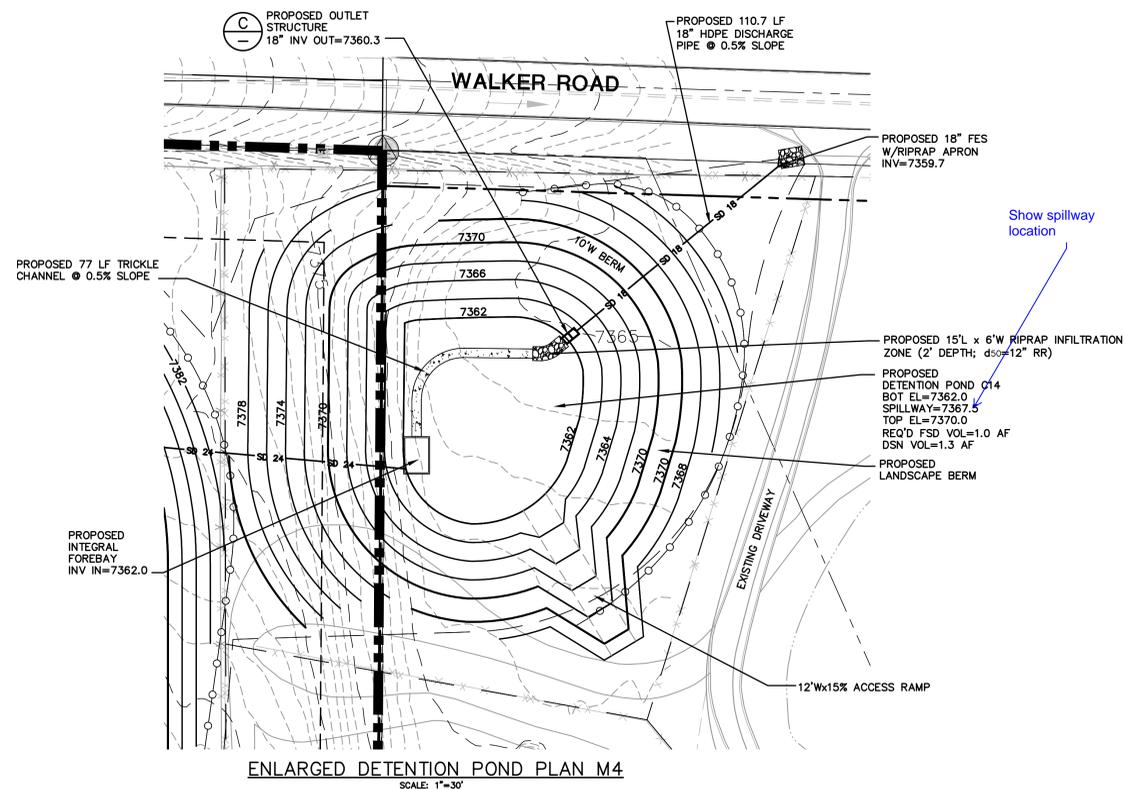

- ORIFICE PLATE NOTES:**
1. MINIMIZE THE NUMBER OF COLUMNS.
  2. PROVIDE GASKET MATERIAL BETWEEN THE ORIFICE PLATE AND CONCRETE.
  3. BOLT PLATE TO CONCRETE 12" MAX. ON CENTER.
- EURV AND WQCV TRASH RACKS:**
1. WELL-SCREEN TRASH RACKS (FOR CIRCULAR ORIFICES) SHALL BE STAINLESS STEEL AND SHALL BE ATTACHED BY INTERMITTENT WELDS ALONG THE EDGE OF THE MOUNTING FRAME.
  2. STRUCTURAL DESIGN OF TRASH RACKS SHALL BE BASED ON FULL HYDROSTATIC HEAD WITH ZERO HEAD DOWNSTREAM OF THE RACK.
- OVERFLOW TRASH RACKS:**
1. ALL TRASH RACKS SHALL BE MOUNTED USING STAINLESS STEEL HARDWARE AND PROVIDED WITH HINGED AND LOCKABLE OR BOLTABLE ACCESS PANELS.
  2. TRASH RACKS SHALL BE STAINLESS STEEL, ALUMINUM, OR STEEL. STEEL TRASH RACKS SHALL BE HOT DIP GALVANIZED AND MAY BE HOT POWDER COATED AFTER GALVANIZING.
  3. TRASH RACKS SHALL BE DESIGNED SUCH THAT THE DIAGONAL DIMENSION OF EACH OPENING IS SMALLER THAN THE DIAMETER