


2024/07/01 9:50 AM By: Ryan Mangino N:\Projects\112 Woodmen Hills\112.126 Theriot Concrete Tank Drawings\Design\112.126_2_Structural_RM.dwg IF BAR DOES NOT MEASURE ONE INCH, SCALE OF THIS DRAWING HAS BEEN ALTERED 1"

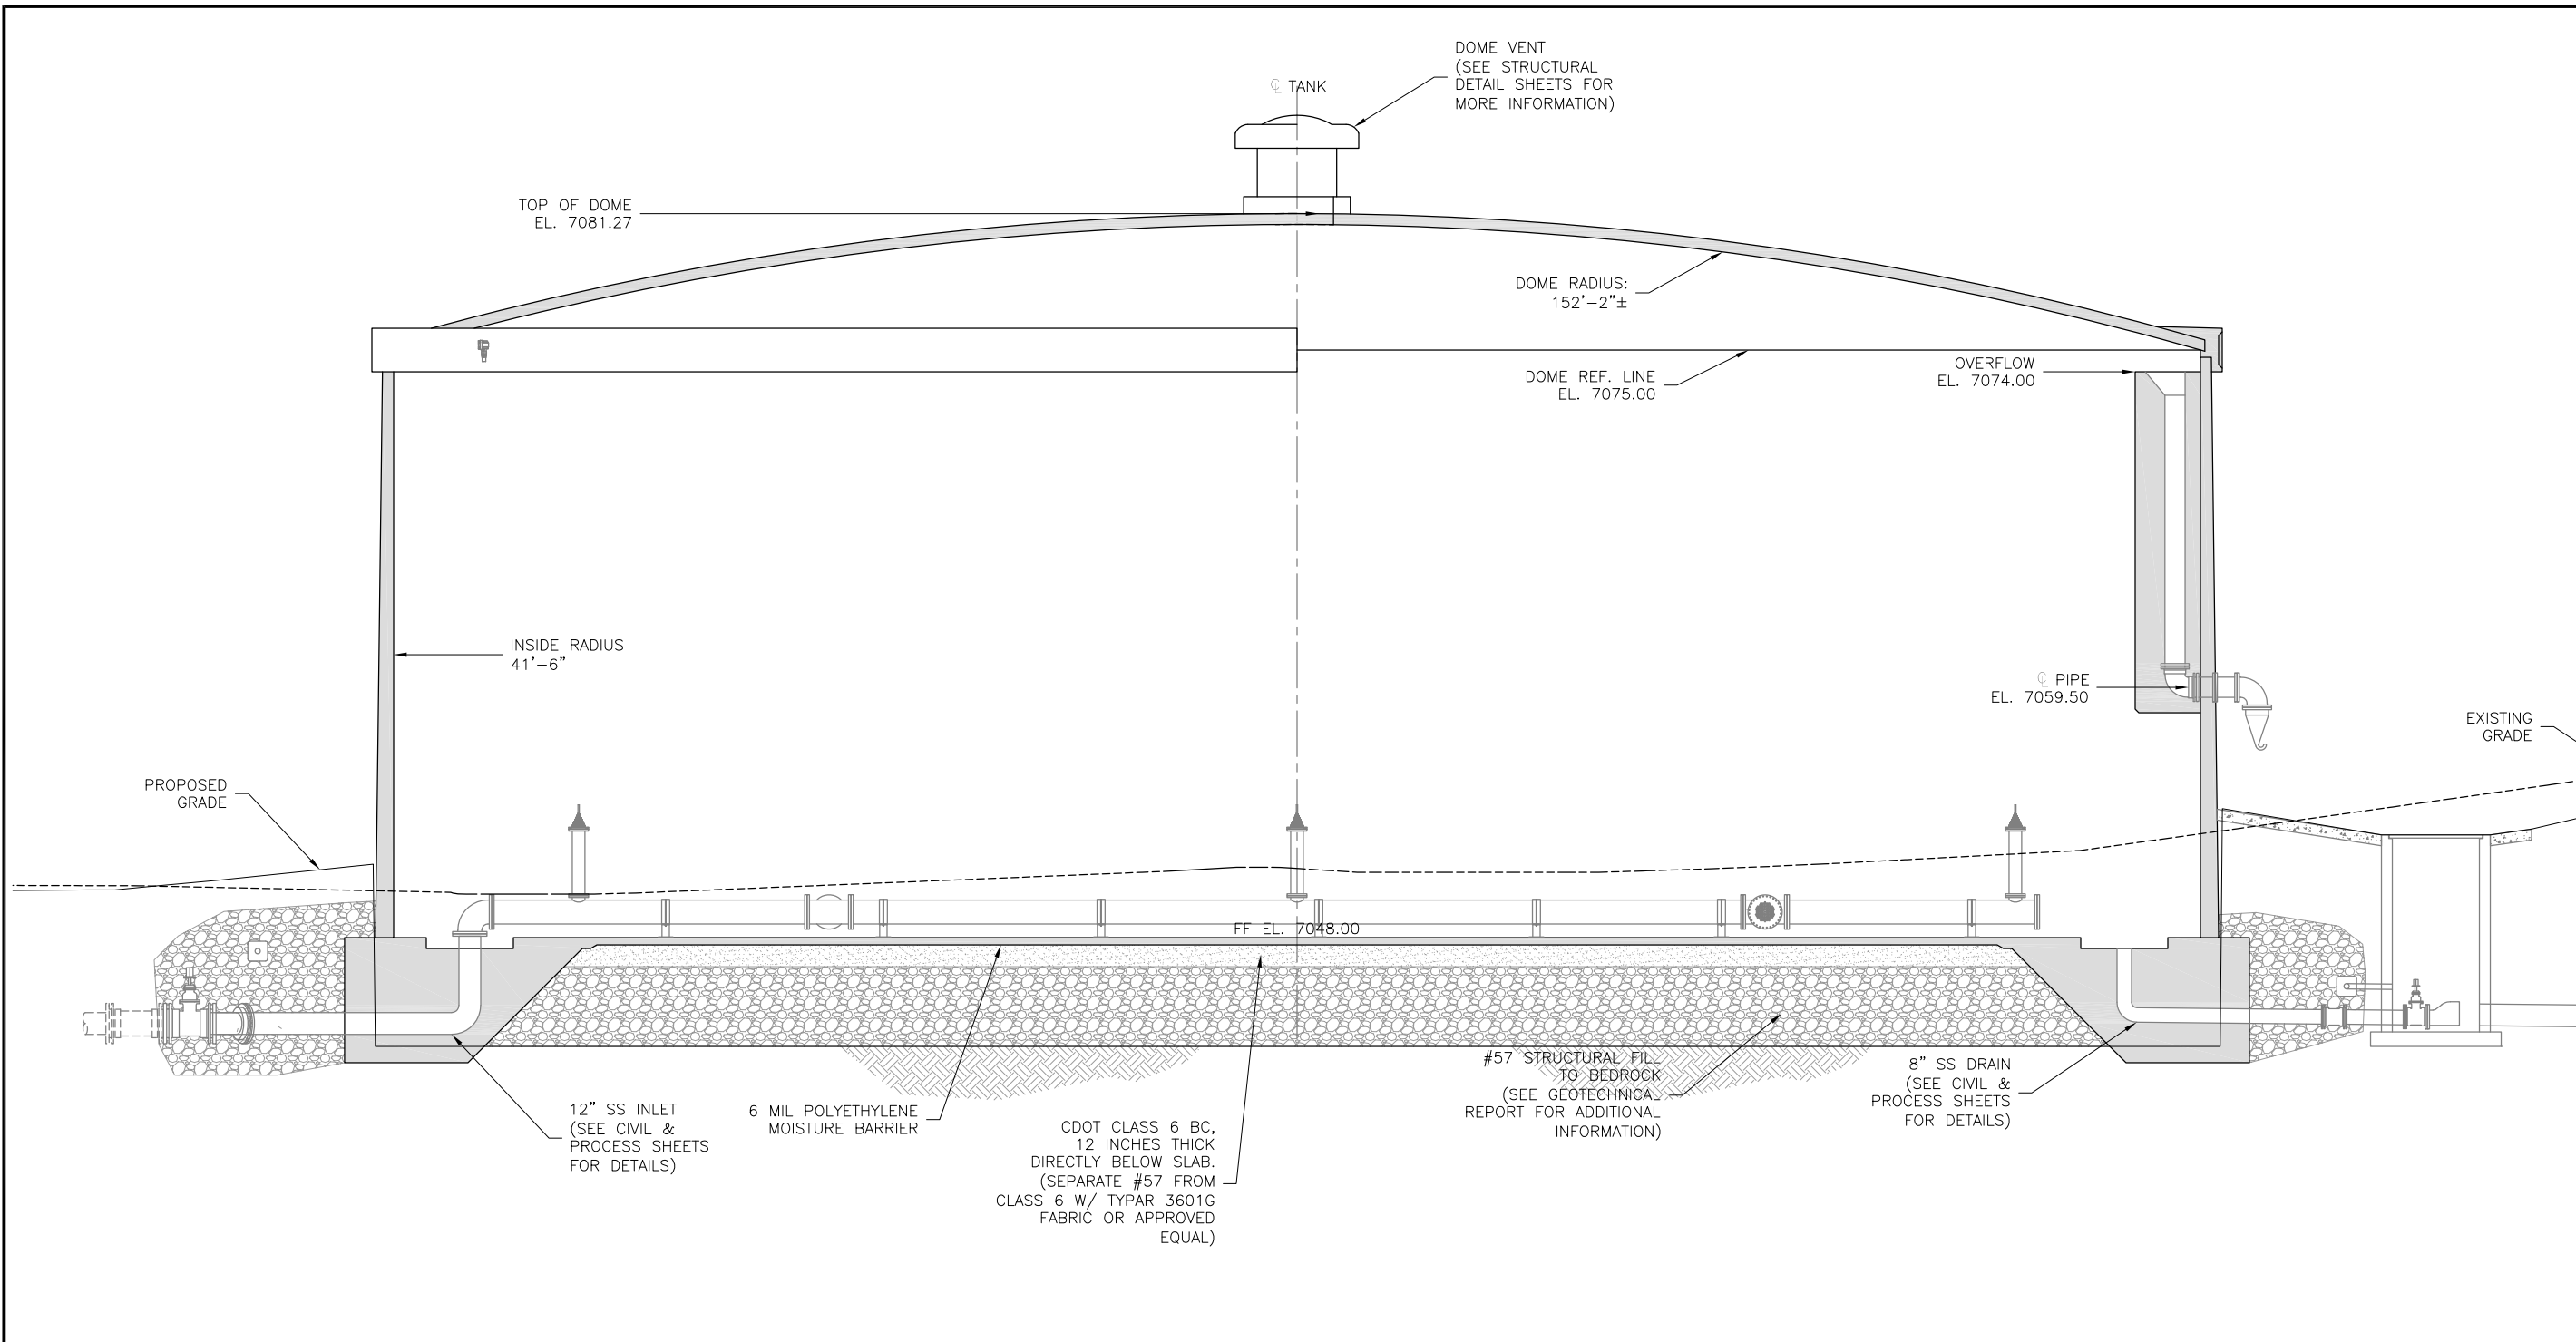

TANK SECTION A
 11x17 SCALE: 1/8" = 1'-0"
 24x24 SCALE: 1/4" = 1'-0"

- NOTES:**
1. REFER TO CONTRACT DOCUMENTS FOR INFORMATION CONCERNING TANK BASE PREPARATION, BACKFILLING, AND SITE GRADING.
 2. GEOTECHNICAL ENGINEER MUST INSPECT AND EVALUATE THE SUB-GRADE PRIOR TO PLACEMENT OF LEVELING BASE TO CONFIRM MINIMUM DESIGN CRITERIA IS BEING MET.
 3. REFER TO GEOTECHNICAL REPORT FOR SUBGRADE/STRUCTURAL FILL.
 4. REFER TO TANK & PIPING SECTION DRAWINGS IN CIVIL SHEETS AND STRUCTURAL DETAIL SHEETS FOR BURIED PIPE PENETRATIONS.

Colorado Springs, CO
 5540 Tech Center Dr., Suite 100
 Colorado Springs, CO 80919
 Phone: 719.227.0072
 www.respec.com

WOODMEN HILLS METROPOLITAN DISTRICT
THERIOT CONCRETE WATER TANK
TANK SECTION

| NO. | REVISIONS DESCRIPTION | BY | APP. | DATE |
|-----|-----------------------|----|------|------|
| 1 | | | | |
| 2 | | | | |
| 3 | | | | |
| 4 | | | | |
| 5 | | | | |
| 6 | | | | |
| 7 | | | | |

100% DESIGN



Proj.#: 112.126
 Date: 07/08/24
 Design: RMM
 Drawn: RMM
 Check: JPM