

**PRELIMINARY DRAINAGE REPORT AND MDDP ADDENDUM
FOR
HOMESTEAD NORTH AT STERLING RANCH PRELIMINARY PLAN**

Engineering Review

01/05/2021 6:22:39 PM

dsdrice
JeffRice@elpasoco.com

(719) 520-7877

EPC Planning & Community
Development Department

Prepared For:

SR Land, LLC

20 Boulder Crescent, Suite 200

Colorado Springs, CO 80903

(719) 491-3024

Cursory comments - see
comment letter also.

**PCD-ENGINEERING REVIEW COMMENTS
IN BLUE BOXES WITH BLUE TEXT**

June 26, 2020

Project No. 25188.00

Prepared By:

JR Engineering, LLC

5475 Tech Center Drive, Suite 235

Colorado Springs, CO 80919

719-593-2593

PCD Filing No.:
SP-20-008

JR RESPONSE: ADDRESSED



JR ENGINEERING

PRELIMINARY DRAINAGE REPORT AND MDDP ADDENDUM FOR
HOMESTEAD NORTH AT STERLING RANCH

June 2020

ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by El Paso County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.

Mike Bramlett, Colorado P.E. 38861
For and On Behalf of JR Engineering, LLC

DEVELOPER'S STATEMENT:

I, the developer, have read and will comply with all of the requirements specified in this drainage report and plan.

Business Name: SR Land, LLC

By: _____

Title: _____

Address: 20 Boulder Crescent, Suite 200
Colorado Springs, CO 80903

El Paso County:

Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual, Volumes 1 and 2 and Engineering Criteria Manual, as amended.

Jennifer Irvine, P.E.
County Engineer/ ECM Administrator

Date

Conditions:

Table of Contents

Purpose	1
General Site Description	1
General Location.....	1
Description of Property	1
Floodplain statement.....	2
Existing Drainage Conditions	2
Major Basin Descriptions	2
Existing Sub-basin Drainage	3
Proposed Drainage Conditions.....	3
Proposed Sub-basin Drainage.....	3
Drainage Design Criteria	7
Development Criteria Reference	7
Hydrologic Criteria.....	7
Hydraulic Criteria.....	7
Drainage Facility Design	8
Four Step Process to Minimize Adverse Impacts of Urbanization	8
Water Quality.....	9
Erosion Control Plan	9
Operation & Maintenance.....	9
Drainage and Bridge Fees.....	9
Summary	10
References.....	11

APPENDIX

- Appendix A – Vicinity Map, Soil Descriptions, FEMA Floodplain Map
- Appendix B – Hydrologic Calculations
- Appendix C – Hydraulic Calculations
- Appendix D – Drainage Maps
- Appendix E – Reference Material

PURPOSE

This document is the Preliminary Drainage Report and MDDP Addendum for Homestead North at Sterling Ranch. The purpose of this report is to identify on-site and off-site drainage patterns, storm sewer, culvert and inlet locations, areas tributary to the site, and to safely route developed storm water to adequate outfall facilities. It is important to note that Homestead North at Sterling Ranch is intended to be constructed in two phases with both phases being evaluated in this report. Assumptions have been made with regards to Phase 2 in order to size and evaluate the site drainage infrastructure. This report will be confirmed or amended in the event that the phase 2 lot configuration has significant changes.

GENERAL SITE DESCRIPTION

GENERAL LOCATION

Homestead North at Sterling Ranch and the undeveloped land to the north (hereby referred to as the “site”) is a proposed development with a total area of approximately 88 acres.

The site is located in the northeast quarter of Section 28, Township 12 South, Range 65 West of the Sixth Principal Meridian in the County of El Paso, State of Colorado, approximately 1.5 miles east of Vollmer Road. The site is bounded by Briargate Parkway to the south, an unplatted vacant residential parcel to the north, and Sand Creek borders the site to east. The parcels are planned to be platted after approval of the Preliminary Plan. Refer to the vicinity map in Appendix A for additional information.

DESCRIPTION OF PROPERTY

The site is currently being designed to accommodate approximately 264 single-family residential lots and development is to be completed in two phases (total 528 lots). The site is comprised of variable sloping grasslands that generally slope(s) downward to the east at 3 to 7% towards the Sand Creek tributary basin.

Soil characteristics are comprised of Type B hydrologic Soil groups. Refer to the soil survey map in Appendix A for additional information.

There are no major drainageways on the site, although a tributary to the Sand Creek basin is immediately to the east of the site. Currently, Kiowa Engineering Corp. is performing studies and plans to address Sand Creek stabilization.

There are no known irrigation facilities located on the project site.

FLOODPLAIN STATEMENT

Based on the FEMA Firm Maps Number 08041C0533G and 08041C0535G revised December 7, 2018, the vast majority of the development is located within Zone X, or areas area outside the Special Flood Hazard Area (SFHA) and higher than the elevation of the 0.2-percent-annual-chance (or 500-year) flood. The eastern property boundary will be platted to the center of Sand creek placing a portion of the site within Zone AE. The area of disturbance for site grading is located outside of the delineated floodway within Zone X. The FEMA map containing the site has been presented in Appendix A.

EXISTING DRAINAGE CONDITIONS

MAJOR BASIN DESCRIPTIONS

The site lies within the Sand Creek Drainage Basin based on the "Sand Creek Drainage Basin Planning Study" (DBPS) completed by Kiowa Engineering Corporation in January 1993, revised March 1996. The Sand Creek Drainage Basin covers approximately 54 square miles and is divided into major sub-basins. The site is within the respective sub-basin is shown in Appendix E.

The Sand Creek DBPS assumed the Homestead North at Sterling Ranch property to have a "large lot residential" use for the majority of the site. However, the proposed Sterling Ranch master plan is a mix of; school, multi-family, single-family, and commercial land uses, resulting in higher runoff. The site generally drains from north to south consisting of rolling hills. Currently, the site is used as pasture land for cattle. Sand Creek is located east of JR RESPONSE: TEXT UPDATED is reach of drainage conveyance is not currently improved. There are a few stock ponds within the creek channel used for cattle watering. Currently, Kiowa is performing studies and plans to address Sand Creek stabilization adjacent to the site.

The proposed drainage on the site closely follows the approved "Master Development Drainage Plan for Sterling Ranch", (MMDP) prepared by M&S Civil Consultants, Inc., dated October 24, 2018. The MMDP "Developed Hydrologic Conditions Map" as shown within Appendix E, shows the estimated detention for the site. The site is tributary to basins SC3-18, SC3-17, and a portion of basin SC-322. Full-spectrum detention in the MMDP was previously analyzed and corresponds to ponds FSD18 and FSD17 for the site. Pond FSD17 is associated with ponds A and B within this report. Pond FSD18 is associated with ponds B and C within this report. The total estimated/projected detention and estimated outflows from the MDDP are shown in Table 1 below.

in the east portion

Table 1.

FSD17						
STORM EVENT (YR)	2	5	10	25	50	100
PEAK INFLOW (CFS)	41.8	59.6	85.2	119.0	149.1	180.6
ALLOWABLE RELEASE (CFS)	0.7	11.1	22.5	52	67.2	86.3
MODELED RELEASE (CFS)	0.7	8.4	22.4	52	67.2	86.1
STORED VOLUME (AC-FT)	2.6	2.6	2.8	3.4	4.0	4.7

FSD18						
STORM EVENT (YR)	2	5	10	25	50	100
PEAK INFLOW (CFS)	49.3	67.1	91.0	121.2	147.3	174
ALLOWABLE RELEASE (CFS)	0.6	9.2	18.4	42.2	54.6	69.9
MODELED RELEASE (CFS)	0.6	6.3	18.4	42.2	54.6	69.6
STORED VOLUME (AC-FT)	3.2	3.2	3.4	4.0	4.7	5.3

please describe a little more here.

The MMDP plans for additional detention to the north of the site as shown in appendix E. No future offsite detention is necessary for the site.

Add a summary sentence stating what is changing from the approved MDDP.

EXISTING SUB-BASIN DRAINAGE

JR RESPONSE: Additional text summarizing MDDP added

The existing / predeveloped condition of the site was analyzed in the MMDP conducted by M&S the existing site corresponds to basin EX-5 as shown in the 2018 Sterling Ranch MMDP, Existing Hydrologic Conditions Map in Appendix E.

Provide detailed analysis of existing conditions

PROPOSED DRAINAGE CONDITIONS

JR RESPONSE: Map of existing conditions provided. Existing basins and flows discussed in this section of the report

PROPOSED SUB-BASIN DRAINAGE

The proposed site was broken up and delineated into three major basins: Basin A (upper-portion), Basin B (mid –portion), and Basin C (lower-portion) of the site. It should be noted that Basin A will be constructed as part of phase 2 of this development and Basins B and C will be constructed as part of Phase 1. Basin A is tributary to Pond A, Basin B is Tributary to Pond B and Basin C is tributary to Pond C. The proposed basin (and sub-basin) delineation is shown on the drainage basin map within Appendix D and is described as follows.

Basin A1 3.51 acres and 56% percent impervious is comprised of single-family residential lots, a local road, and a Cul de Sac. Runoff ($Q_5=7.1$ cfs, $Q_{100}=14.8$ cfs) from this basin drains to design point 1A.

Basin A2 3.18 acres and 57% percent impervious is comprised of single-family residential lots, a local road, and a Cul de Sac. Runoff ($Q_5=6.4$ cfs, $Q_{100}=13.2$ cfs) from this basin drains to design point 2A.

Basin A3 4.58 acres and 53% percent impervious is comprised of single-family residential lots, a local road, and a Cul de Sac. Runoff ($Q_5=8.7$ cfs, $Q_{100}=18.3$ cfs) from this basin drains to design point 3A in confluence with upstream flow from basin A1.

Basin A4 3.82 acres and 54% percent impervious is comprised of single-family residential lots, a local road, and a Cul de Sac. Runoff ($Q_5=7.3$ cfs, $Q_{100}=15.2$ cfs) from this basin drains to design point 4A in confluence with upstream flow from basin A2.

Basin A5 5.46 acres and 51% percent impervious is comprised of single-family residential lots, a local road, and a Cul de Sac. Runoff ($Q_5=10.8$ cfs, $Q_{100}=23.1$ cfs) from this basin drains to design point 5A in confluence with upstream flow from basin A3 and A1.

Basin A6 3.91 acres and 54% percent impervious is comprised of single-family residential lots, a local road, and an urban knuckle. Runoff ($Q_5=10.8$ cfs, $Q_{100}=23.1$ cfs) from this basin drains to design point 6A in confluence with upstream flow from basin A5.

JR RESPONSE: Cul de Sac and Urban Knuckle were switched. Text is now up to date.

Basin A7 1.87 acres and 14% percent impervious is comprised of open grass area, and a portion of a collector road. Runoff ($Q_5=2.3$ cfs, $Q_{100}=7.9$ cfs) from this basin drains to design point 7A a 20' type R sump inlet. The runoff from the sump inlet collects tributary runoff basins A7, A5, A3, and A1.

JR RESPONSE: Residential Road

Basin A8 0.42 acres and 62% percent impervious is comprised of a portion of a collector road. The runoff ($Q_5=2.3$ cfs, $Q_{100}=7.9$ cfs) from this basin drains to design point 8A a 20' type R sump inlet. From here, the runoff flows into detention pond A and then to the 100 year-event area.

JR RESPONSE: Basins areas changed since road alignments changed. Areas have been updated

JR RESPONSE: Changed to (residential road) was a collector now classified as a 50' R.O.W residential road

Basin A9 2.97 acres and 17% percent impervious is comprised of pond A, grass and walk-out lots facing the detention area. Runoff ($Q_5=2.3$ cfs, $Q_{100}=7.9$ cfs) generated in Basin A9 sheet flows into Pond A where it is treated for water-quality and is detained up until the 100 year-event.

Basin B1.1 2.71 acres and 52% percent impervious is comprised of single-family residential lots, a local road and an urban knuckle. The runoff ($Q_5=5.3$ cfs, $Q_{100}=11.1$ cfs) from basin B1.1 drains to design point 1.1B.



Basin B1.2 1.87 acres and 53% percent impervious is comprised of single-family residential lots, a local road and an urban knuckle. The runoff ($Q_5=3.6$ cfs, $Q_{100}=7.6$ cfs) from basin B1.2 drains to design point 1.2B.

Basin B1.3 0.43 acres and 46% percent impervious is comprised of single-family residential lots and a local road. The runoff ($Q_5=0.8$ cfs, $Q_{100}=2.0$ cfs) from basin B1.3 drains to design point 1.3B.

Basin B2 0.83 acres and 62% percent impervious is comprised of the northern portion of a local collector road adjacent to the intersection at Vollmer road. Runoff ($Q_5=2.5$ cfs, $Q_{100}=5.1$ cfs) from **JR RESPONSE: Changed to residential road** th runoff from basin 1B.

Basin B3 0.26 acres and 100% percent impervious is comprised of the southern portion of a local collector road adjacent to the intersection of Vollmer road. Runoff ($Q_5=1.2$ cfs, $Q_{100}=2.2$ cfs) from basin B3 drains to design point 3B.

Basin B4 3.98 acres and 40% percent impervious is comprised of single-family residential lots, a collector road and a Cul de Sac. Runoff ($Q_5=6.8$ cfs, $Q_{100}=16.0$ cfs) from this basin drains to design point **JR RESPONSE: Changed to residential road**

Basin B5 1.75 acres and 58% percent impervious is comprised of single-family residential lots, a collector road, and a Cul de Sac. Runoff ($Q_5=4.4$ cfs, $Q_{100}=9.0$ cfs) from basin B5 drains to design point **JR RESPONSE: Changed to residential road**

Basin B6 3.60 acres and 60% percent impervious is comprised of single-family residential lots and a collector road. Runoff ($Q_5=9.8$ cfs, $Q_{100}=20.2$ cfs) from basin 6B drains to design point 6B. In total, **JR RESPONSE: Changed to residential road** B1, B2, B3, B4, and B6.

Basin B7 1.13 acres and 62% percent impervious is comprised of single-family lots, local roads and a Cul de Sac. Runoff ($Q_5=2.9$ cfs, $Q_{100}=5.8$ cfs) from basin B7 drains to design point B7 in confluence with runoff from B5.

Basin B8 1.76 acres and 59% percent impervious is comprised of single-family lots and a Cul de Sac. Runoff ($Q_5=4.2$ cfs, $Q_{100}=8.6$ cfs) from basin B8 drains to design point B8 in confluence with runoff from basins B8, B7 and B5.

Basin B9 3.79 acres and 64% percent impervious is comprised of single-family lots, local road, collector road and an urban knuckle. Runoff ($Q_5=7.0$ cfs, $Q_{100}=15.0$ cfs) from Basin B9 drains to **JR RESPONSE: CHANGED TO RESIDENTIAL ROAD** the runoff from the sump inlet collects runoff from basins B1, B2, B3, B4, B6 and B9.

JR RESPONSE:
Typo changed to
7B

Basin B10 0.22 acres and 100% percent impervious is comprised of the southeastern side of the collector road. The runoff from this basin drains to design point B10. The total runoff ($Q_5=1.0$ cfs, $Q_{100}=1.8$ cfs) is collected at this site is from basins B7, B8, and B10.

Basin B11 1.75 acres and 2.0% percent impervious is comprised of pond B. Runoff ($Q_5=0.5$ cfs, $Q_{100}=3.4$ cfs) generated in Basin B11 sheet flows into Pond B where it is treated for water-quality and is detained up until the 100 year-event.

Basin C1 2.82 acres and 70% percent impervious is comprised of local roads, single-family lots, and the northwestern side of the collector road. Runoff ($Q_5=5.5$ cfs, $Q_{100}=11.5$ cfs) from basin C1 drains to design point 1C.

Basin C2.1 0.20 acres and 89% percent impervious is comprised of local roads, single-family lots, and the north western side of the collector road. Runoff ($Q_5=0.8$ cfs, $Q_{100}=1.6$ cfs) from basin C2.1 drains to design point 2.1C in confluence with runoff from basin C1.

Basin C2.2 4.69 acres and 73% percent impervious is comprised of local roads, single-family lots, and the north western side of the collector road. Runoff ($Q_5=9.9$ cfs, $Q_{100}=20.3$ cfs) from basin C2.2 drains to design point 2.2C in confluence with bypass runoff from basin C2.3.

Basin C2.3 0.83 ac **JR RESPONSE: Changed to residential road** roads, single-family lots, and the north western side of the collector road. Runoff ($Q_5=2.0$ cfs, $Q_{100}=4.1$ cfs) from basin C2.3 drains to design point 2C in confluence with runoff from basin C1.

Basin C3.1 0.35 acres and 82% percent impervious is comprised of local roads, single-family lots, and the southeastern side of a collector road. Runoff ($Q_5=1.3$ cfs, $Q_{100}=2.6$ cfs) from basin C3.1 drains to design point 3.1C.

Basin C3.2 1.46 acres and 72% percent impervious is comprised of local roads, single-family lots, and the southeastern side of a collector road. Runoff ($Q_5=3.6$ cfs, $Q_{100}=7.4$ cfs) from basin C3.2 drains to design point 3.2C.

Basin C4.1 5.81 acres and 70% percent impervious is comprised of local roads, single-family lots, and the northwestern side of a collector road. Runoff ($Q_5=11.5$ cfs, $Q_{100}=23.9$ cfs) from basin C4.1 drains to design point 4.1C a 20' type R sump inlet. The total runoff from basins C1, C2.1, C2.2, C2.3 and C4.1 is collected within the sump inlet.

DP not shown on pdf page 28 or 30.
Typo? Supposed to be DP 4c?

Basin C4.2 2.58 acres and 69% percent impervious is comprised of local roads, single-family lots and. Runoff ($Q_5=4.4$ cfs, $Q_{100}=9.3$ cfs) from basin C4.2 drains to design point 4.2C a 15' type R inlet.

JR RESPONSE: Changed to 4.1C



Basin C5 0.16 acres and 100% percent impervious is comprised of the northwestern side of a collector road. Runoff ($Q_5=0.7$ cfs, $Q_{100}=1.3$ cfs) from basin C5 drains to design point 5C, a 5' type R sump inlet. Basin C5 collects runoff from basin C3.2 and C5. The runoff from basin C ultimately outfalls into pond C.

Basin C6 2.43 acres and 10% percent impervious is comprised of pond C and some single-family residential area. Runoff ($Q_5=1.6$ cfs, $Q_{100}=8.1$ cfs) generated in Basin B11 sheet flows into Pond C where it is treated for water-quality and is detained up until the 100 year-event.

DRAINAGE DESIGN CRITERIA

Include discussion of design points combined flows, overflow paths and pond release rates and volumes above or add.

DEVELOPMENT CRITERIA REFERENCE

JR RESPONSE: Changed to residential road

Storm drainage analysis and design criteria for this project were taken from the “City of Colorado Springs/El Paso County Drainage Criteria Manual” Volumes 1 and 2 (EPCDCM), dated October 12, 1994, the “Urban Storm Drainage Criteria Manual” Volumes 1 to 3 (USDCM) and Chapter 6 and Section 3.2.1 of Chapter 13 of the “Colorado Springs Drainage Criteria Manual” (CSDCM), dated May 2014, as adopted by El Paso County.

HYDROLOGIC CRITERIA

All hydrologic data was obtained from the “El Paso Drainage Criteria Manual” Volumes 1 and 2, and the “Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual” Volumes 1, 2, and 3. Onsite drainage improvements were designed based on the 5 year (minor) storm event and the 100-year (major) storm event. Runoff was calculated using the Rational Method, and rainfall intensities for the 5-year and the 100-year storm return frequencies were obtained from Table 6-2 of the CSDCM. One hour point rainfall data for the storm events is identified in the chart below. Runoff coefficients were determined based on proposed land use and from data in Table 6-6 from the CSDCM. Time of concentrations were developed using equations from CSDCM. All runoff calculations and applicable charts and graphs are included in the Appendices.

Table 2 - 1-hr Point Rainfall Data

Storm	Rainfall (in.)
5-year	1.50
100-year	2.52

HYDRAULIC CRITERIA

The Rational Method and USDCM’s SF-2 and SF-3 forms were used to determine the runoff from the minor and major storms on the site, and the UDFCD MHFD-Detention v4 03 spreadsheet was



utilized for evaluating proposed detention and water quality pond. Sump and on-grade inlets were sized using UDFCD UD-Inlet v2.07. Manning's equation was used to size the proposed pipes in this report and StormCAD will be used to model the proposed storm sewer system and to analyze the proposed HGL calculations for Construction Drawings.

DRAINAGE FACILITY DESIGN

FOUR STEP PROCESS TO MINIMIZE ADVERSE IMPACTS OF URBANIZATION

In accordance with the El Paso County Drainage Criteria Manual Volume 2, this site has implemented the four step process to minimize adverse impacts of urbanization. The four step process includes reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing drainage ways, and implementing long-term source controls.

Step 1 – Reducing Runoff Volumes: The Homestead North at Sterling Ranch development project consists single -family homes with open spaces and lawn areas interspersed within the development which helps disconnect impervious areas and reduce runoff volumes. Roof drains from the structures will discharge to lawn areas, where feasible, to allow for infiltration and runoff volume reduction.

Step 2 – Stabilize Drainageways: The site lies within the Sand Creek Drainage Basin. Basin and bridge fees will be due at time of platting. These funds will be used for the channel stabilization being designed by Kiowa adjacent to the site and on future projects within the basin to stabilize drainageways. The site does not discharge directly into the open drainageway of Sand Creek, therefore no downstream stabilization will be accomplished with this project.

Step 3 – Treat the WQCV: Water Quality treatment for this site is provided in three proposed full spectrum water quality detention ponds: Pond A, B, and Pond C. The runoff from this site will be collected within inlets and conveyed to the proposed ponds via storm sewer. Upon entrance to the ponds, flows will be captured in a forebay designed to promote settlement of suspended solids. A trickle channel is also incorporated into the ponds to minimize the amount of standing water. The outlet structure has been designed to detain the water quality capture volume (WQCV) for 40 hours, and the extended urban runoff volume (EURV) for 72 hours. All flows released from the ponds will be reduced to less than historic rates.

Revise Step 4. This should be n/a since this is not an industrial or commercial site.

Step 4 – Consider Need for Industrial and Commercial BMPs: BMPs will be utilized to minimize off-site contaminants and to protect the downstream receptors. Temporary source control BMPs that will be implemented include, but are not limited to, silt fencing placed around downstream areas of disturbance, construction vehicle tracking pads at the entrances, designated concrete truck washout basin, designated vehicle fueling areas, covered storage areas, spill containment and control, stormwater storage, stormwater treatment, stormwater storage, stormwater treatment, parking, storm inlets and stormwater storage, stormwater treatment, stormwater storage, stormwater treatment, permanent vegetation.

JR RESPONSE: UPDATED

Step 4: Consider Need for Industrial and Commercial BMPs

If a new development or significant redevelopment activity is planned for an industrial or commercial site, the need for specialized BMPs must be considered. Two approaches are described in the New Development BMP Factsheets:

- Covering of Storage/Handling Areas
- Spill Containment and Control

Other Specialized BMPs may also be required



WATER QUALITY

The site is split into three major basins A, B, and C. Each major basin is serviced by an extended full spectrum water quality / detention pond. All the ponds have been designed per Section 13.3.2.1 of Resolution 15-042 of the El Paso County Drainage Criteria Manual. For additional information on pond storage and outlet characteristics see the MHFD sheets within appendix C.

EROSION CONTROL PLAN

We respectfully request that the Erosion Control Plan and Cost Estimate be submitted in conjunction with the grading and erosion control plan and construction assurances posted prior to obtaining a grading permit.

JR RESPONSE: ADDRESSED

Show all access
roads on the plans.

OPERATION & MAINTENANCE

In order to ensure the function and effectiveness of the stormwater infrastructure, maintenance activities such as inspection, routine maintenance, restorative maintenance, rehabilitation and repair, are required. The property owner shall be responsible for the inspection, maintenance, rehabilitation and repair of stormwater and erosion control facilities located on the property unless another party accepts such responsibility in writing and responsibility is properly assigned through legal documentation. Access is provided from onsite facilities and easements for proposed infrastructure located offsite. We respectfully request that the Operation & Maintenance Manual be submitted in conjunction with the construction documents, prior to obtaining a grading permit.

DRAINAGE AND BRIDGE FEES

The site lies within the Sand Creek Drainage Basin. Anticipated drainage and bridge fees will be provided at time of final drainage report and will be due at time of platting (depending on date of plat submittal):

2020 DRAINAGE AND BRIDGE FEES – STERLING RANCH HOMESTEAD NORTH				
Impervious Acres (ac)	Drainage Fee (Per Imp. Acre)	Bridge Fee (Per Imp. Acre)	Sterling Ranch Drainage Fee	Sterling Ranch Bridge Fee
	\$19,698	\$8,057		

This table is not
needed in a PDR

JR RESPONSE: DELETED

SUMMARY


The proposed Homestead North at Sterling Ranch drainage improvements were designed to meet or exceed the El Paso County Drainage Criteria. The proposed development ponds are designed to release less than MDDP study associated with the subject site. The proposed development will not adversely affect the offsite drainageways or surrounding development. This report is in conformance and meets the latest El Paso County Storm Drainage Criteria requirements for this site.

REFERENCES

1. "El Paso County and City of Colorado Springs Drainage Criteria Manual, Vol I & II".
← **El Paso County ECM, 2019**
2. Urban Storm Drainage Criteria Manual (Volumes 1, 2, and 3), Urban Drainage and Flood Control District, June 2001.
← **El Paso County DCM Vol. 1 Update, 2015**
3. Sand Creek Drainage Basin Planning Study, prepared Kiowa Engineering Corporation, January 1993, revised March 1996.
← **Upper Sand Creek Basin Detention Evaluation Study... (Wilson) ?**
4. "Master Development Drainage Plan for Sterling Ranch", (MMDP) prepared by M&S Civil Consultants, Inc., dated October 24, 2018.
← **TimberRidge PDR/FDR?**
← **Sand Creek Channel Design report and plans (Kiowa, 2021)**

JR RESPONSE: TEXT UPDATED

Appendix A
Vicinity Map, Soil Descriptions, FEMA Floodplain Map

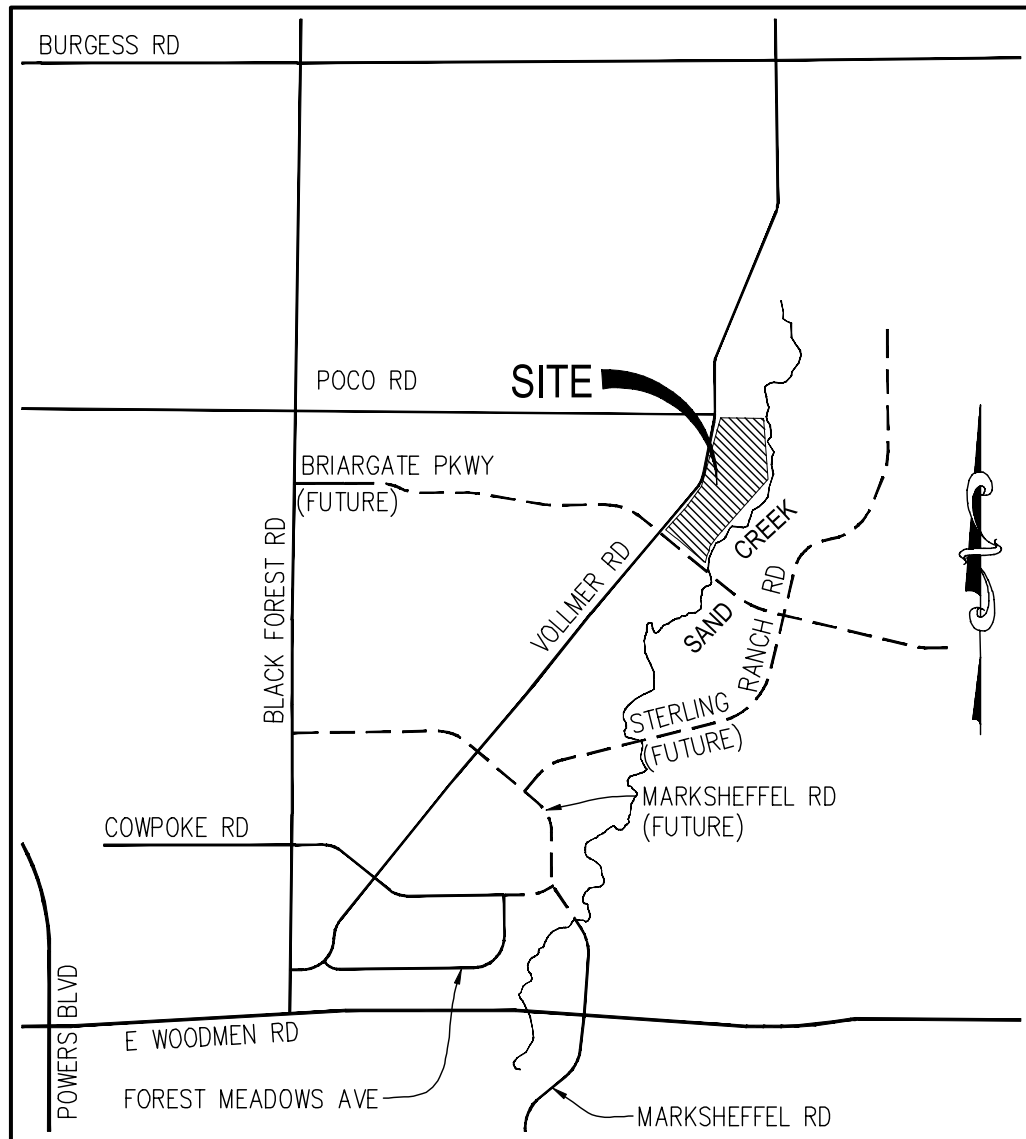

VICINITY MAP

N.T.S.

VICINITY MAP
 HOMESTEAD FIL. 3
 JOB NO. 25188.00
 04/20/20
 SHEET 1 OF 1



J·R ENGINEERING

A Westrian Company


Centennial 303-740-9393 • Colorado Springs 719-593-2593
 Fort Collins 970-491-9888 • www.jrengineering.com

Hydrologic Soil Group—El Paso County Area, Colorado






MAP LEGEND

Area of Interest (AOI)









 Area of Interest (AOI)

Soils

Soil Rating Polygons





 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Lines

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Points






 A
 A/D
 B
 B/D

 C
 C/D
 D
 Not rated or not available

Water Features

 Streams and Canals

Transportation

 Rails
 Interstate Highways
 US Routes
 Major Roads
 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 17, Sep 13, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 8, 2018—May 26, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
71	Pring coarse sandy loam, 3 to 8 percent slopes	B	90.2	100.0%
Totals for Area of Interest			90.2	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where Base Flood Elevations (BFEs) and/or floodways have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the floodways were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by flood control structures. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The projection used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The horizontal datum was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988 (NAVD88). These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, NINGS12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for bench marks shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, and Anderson Consulting Engineers, Inc. These data are current as of 2008.

This map reflects more detailed and up-to-date stream channel configurations and floodplain delineations than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.


Please refer to the separately printed Map Index for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

Contact FEMA Map Service Center (MSC) via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.

If you have questions about this map or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp>.

El Paso County Vertical Datum Offset Table	
Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


Panel Location Map

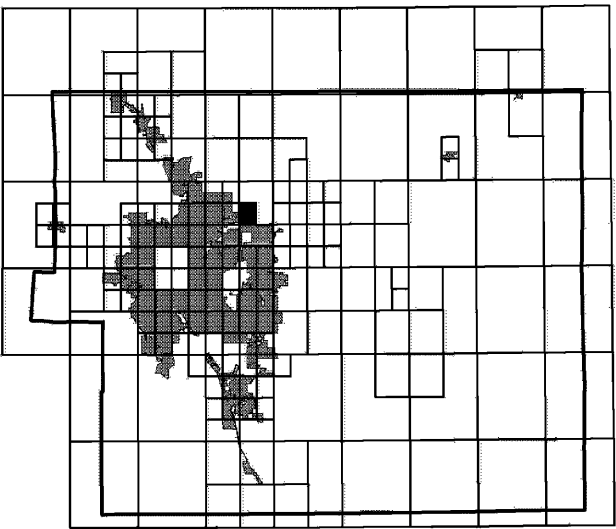

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).



Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

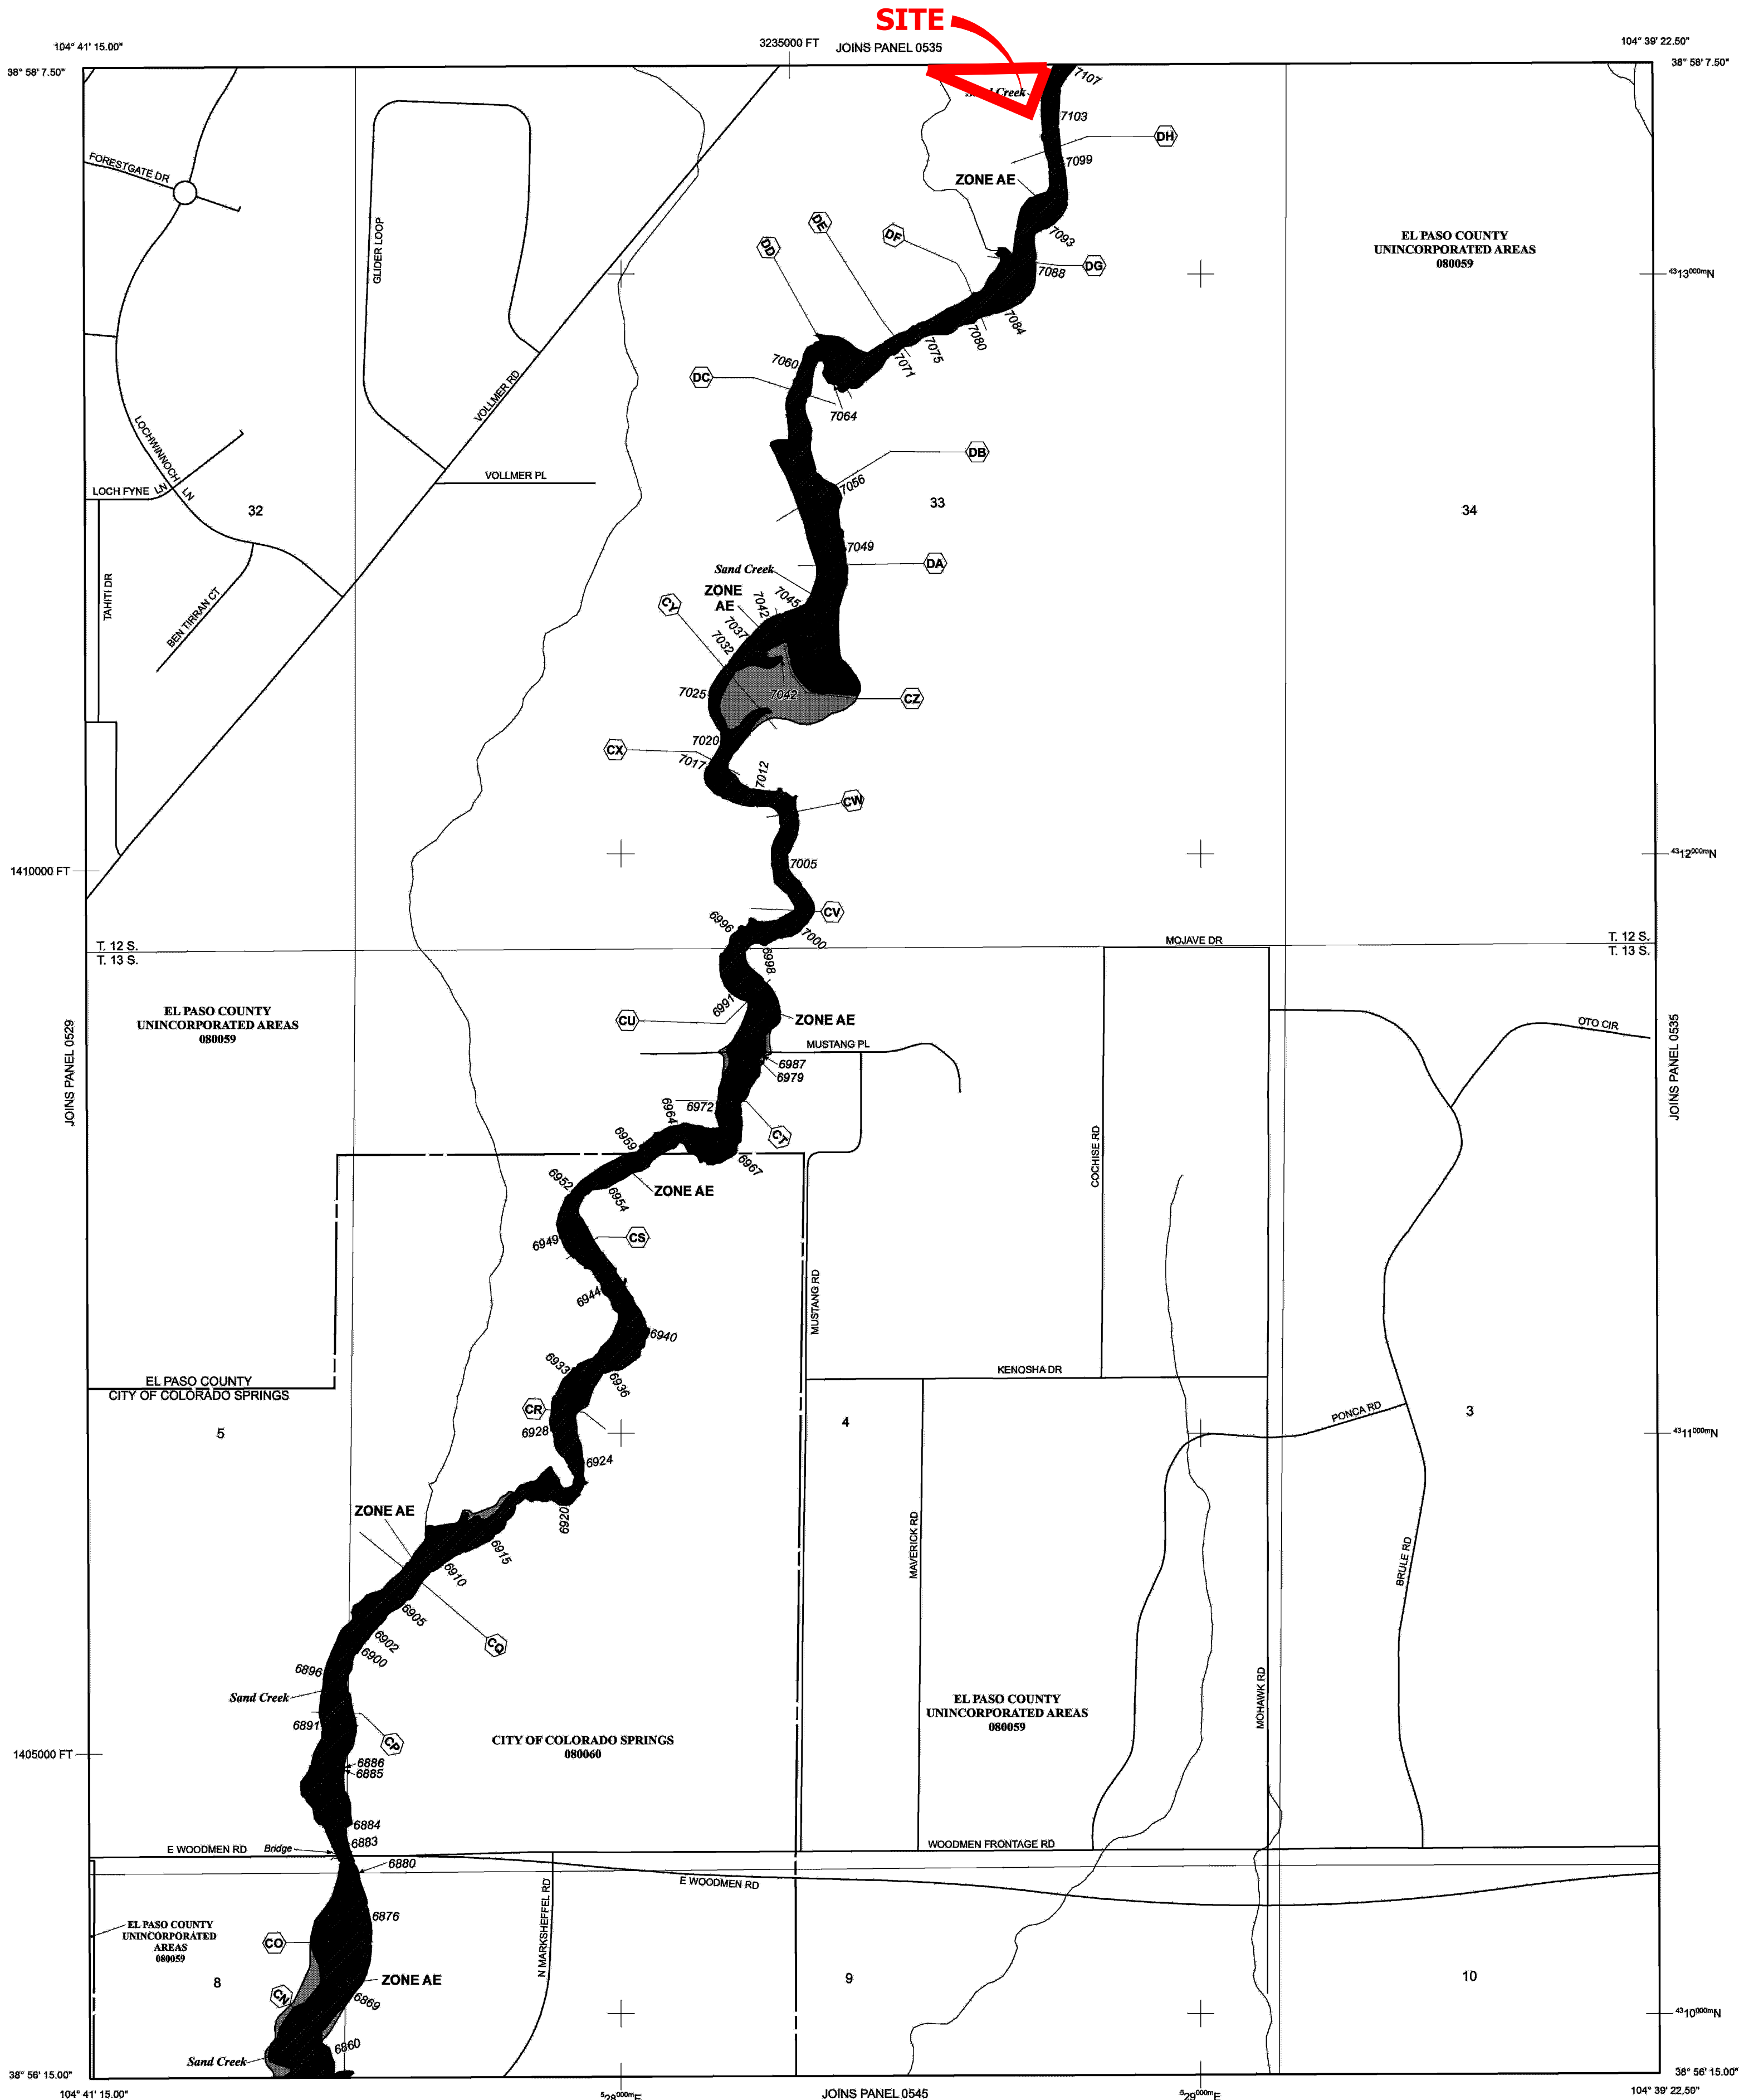

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN TOWNSHIP 12 SOUTH, RANGE 65 WEST, AND TOWNSHIP 13 SOUTH, RANGE 65 WEST.

LEGEND

SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

ZONE A No Base Flood Elevations determined.
ZONE AE Base Flood Elevations determined.
ZONE AH Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.

ZONE AO Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of shallow fan flooding, velocities also determined.

ZONE AR Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently identified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.

ZONE A99 Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.

ZONE V Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.

ZONE VE Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

ZONE X Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

ZONE X Areas determined to be outside the 0.2% annual chance floodplain.

ZONE D Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

Floodplain boundary
Floodway boundary
Zone D Boundary
CBRS and OPA boundary

Boundary dividing Special Flood Hazard areas of different Base Flood Elevations, flood depths or flood velocities.

Base Flood Elevation line and value; elevation in feet*
Base Flood Elevation value where uniform within zone; elevation in feet*

* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

Cross section line

Transect line

Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)

1000-meter Universal Transverse Mercator grid ticks, zone 13

5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 0502), Lambert Conformal Conic Projection

Bench mark (see explanation in Notes to Users section of this FIRM panel)

River Mile


MAP REPOSITORIES
Refer to Map Repositories list on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
MARCH 17, 1997

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL
DECEMBER 7, 2018 - To update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

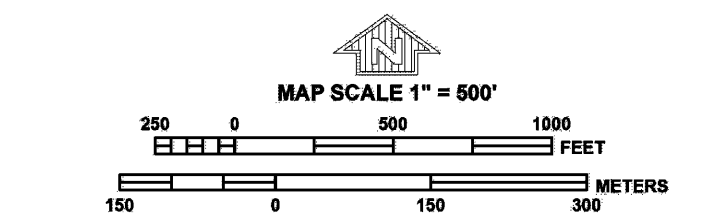

PANEL 0533G

FIRM
FLOOD INSURANCE RATE MAP
EL PASO COUNTY,
COLORADO
AND INCORPORATED AREAS

PANEL 533 OF 1300

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	08030	0531	0
EL PASO COUNTY	08059	0533	0

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.

MAP NUMBER
08041C0533G

MAP REVISED
DECEMBER 7, 2018
Federal Emergency Management Agency

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the **Flood Profiles and Floodway Data** and/or **Summary of Stillwater Elevations** tables contained within the **Flood Insurance Study (FIS)** report that accompanies this **FIRM**. Users should be aware that **BFEs** shown on the **FIRM** represent rounded whole-foot elevations. These **BFEs** are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the **FIS** report should be utilized in conjunction with the **FIRM** for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this **FIRM** should be aware that coastal flood elevations are also provided in the **Summary of Stillwater Elevations** table in the **Flood Insurance Study** report for this jurisdiction. Elevations shown in the **Summary of Stillwater Elevations** table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this **FIRM**.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the **Flood Insurance Study** report for this jurisdiction.

Certain areas not in **Special Flood Hazard Areas** may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the **Flood Insurance Study** report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of **FIRMs** for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this **FIRM**.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, NINGS-12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this **FIRM** was provided in digital format by El Paso County, Colorado Springs Utilities, and Anderson Consulting Engineers, Inc. These data are current as of 2008.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous **FIRM** for this jurisdiction. The floodplains and floodways that were transferred from the previous **FIRM** may have been adjusted to conform to these new stream channel configurations. As a result, the **Flood Profiles and Floodway Data** tables in the **Flood Insurance Study Report** (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the **FIS** report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.


Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a listing of communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this **FIRM**. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.


If you have questions about this map or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp>.

El Paso County Vertical Datum Offset Table	
Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


Panel Location Map

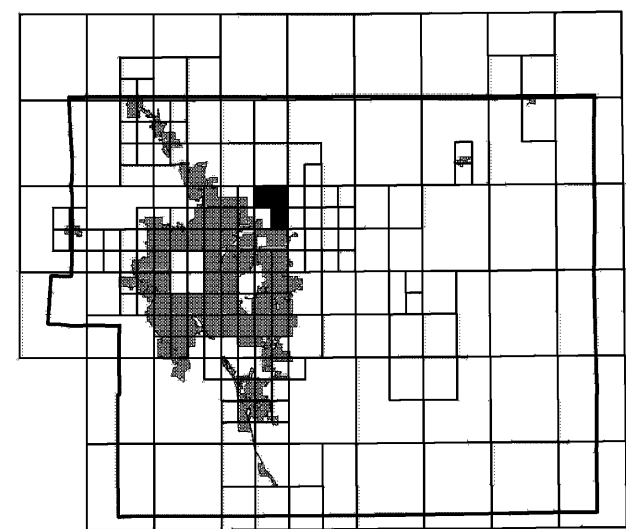

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).



Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

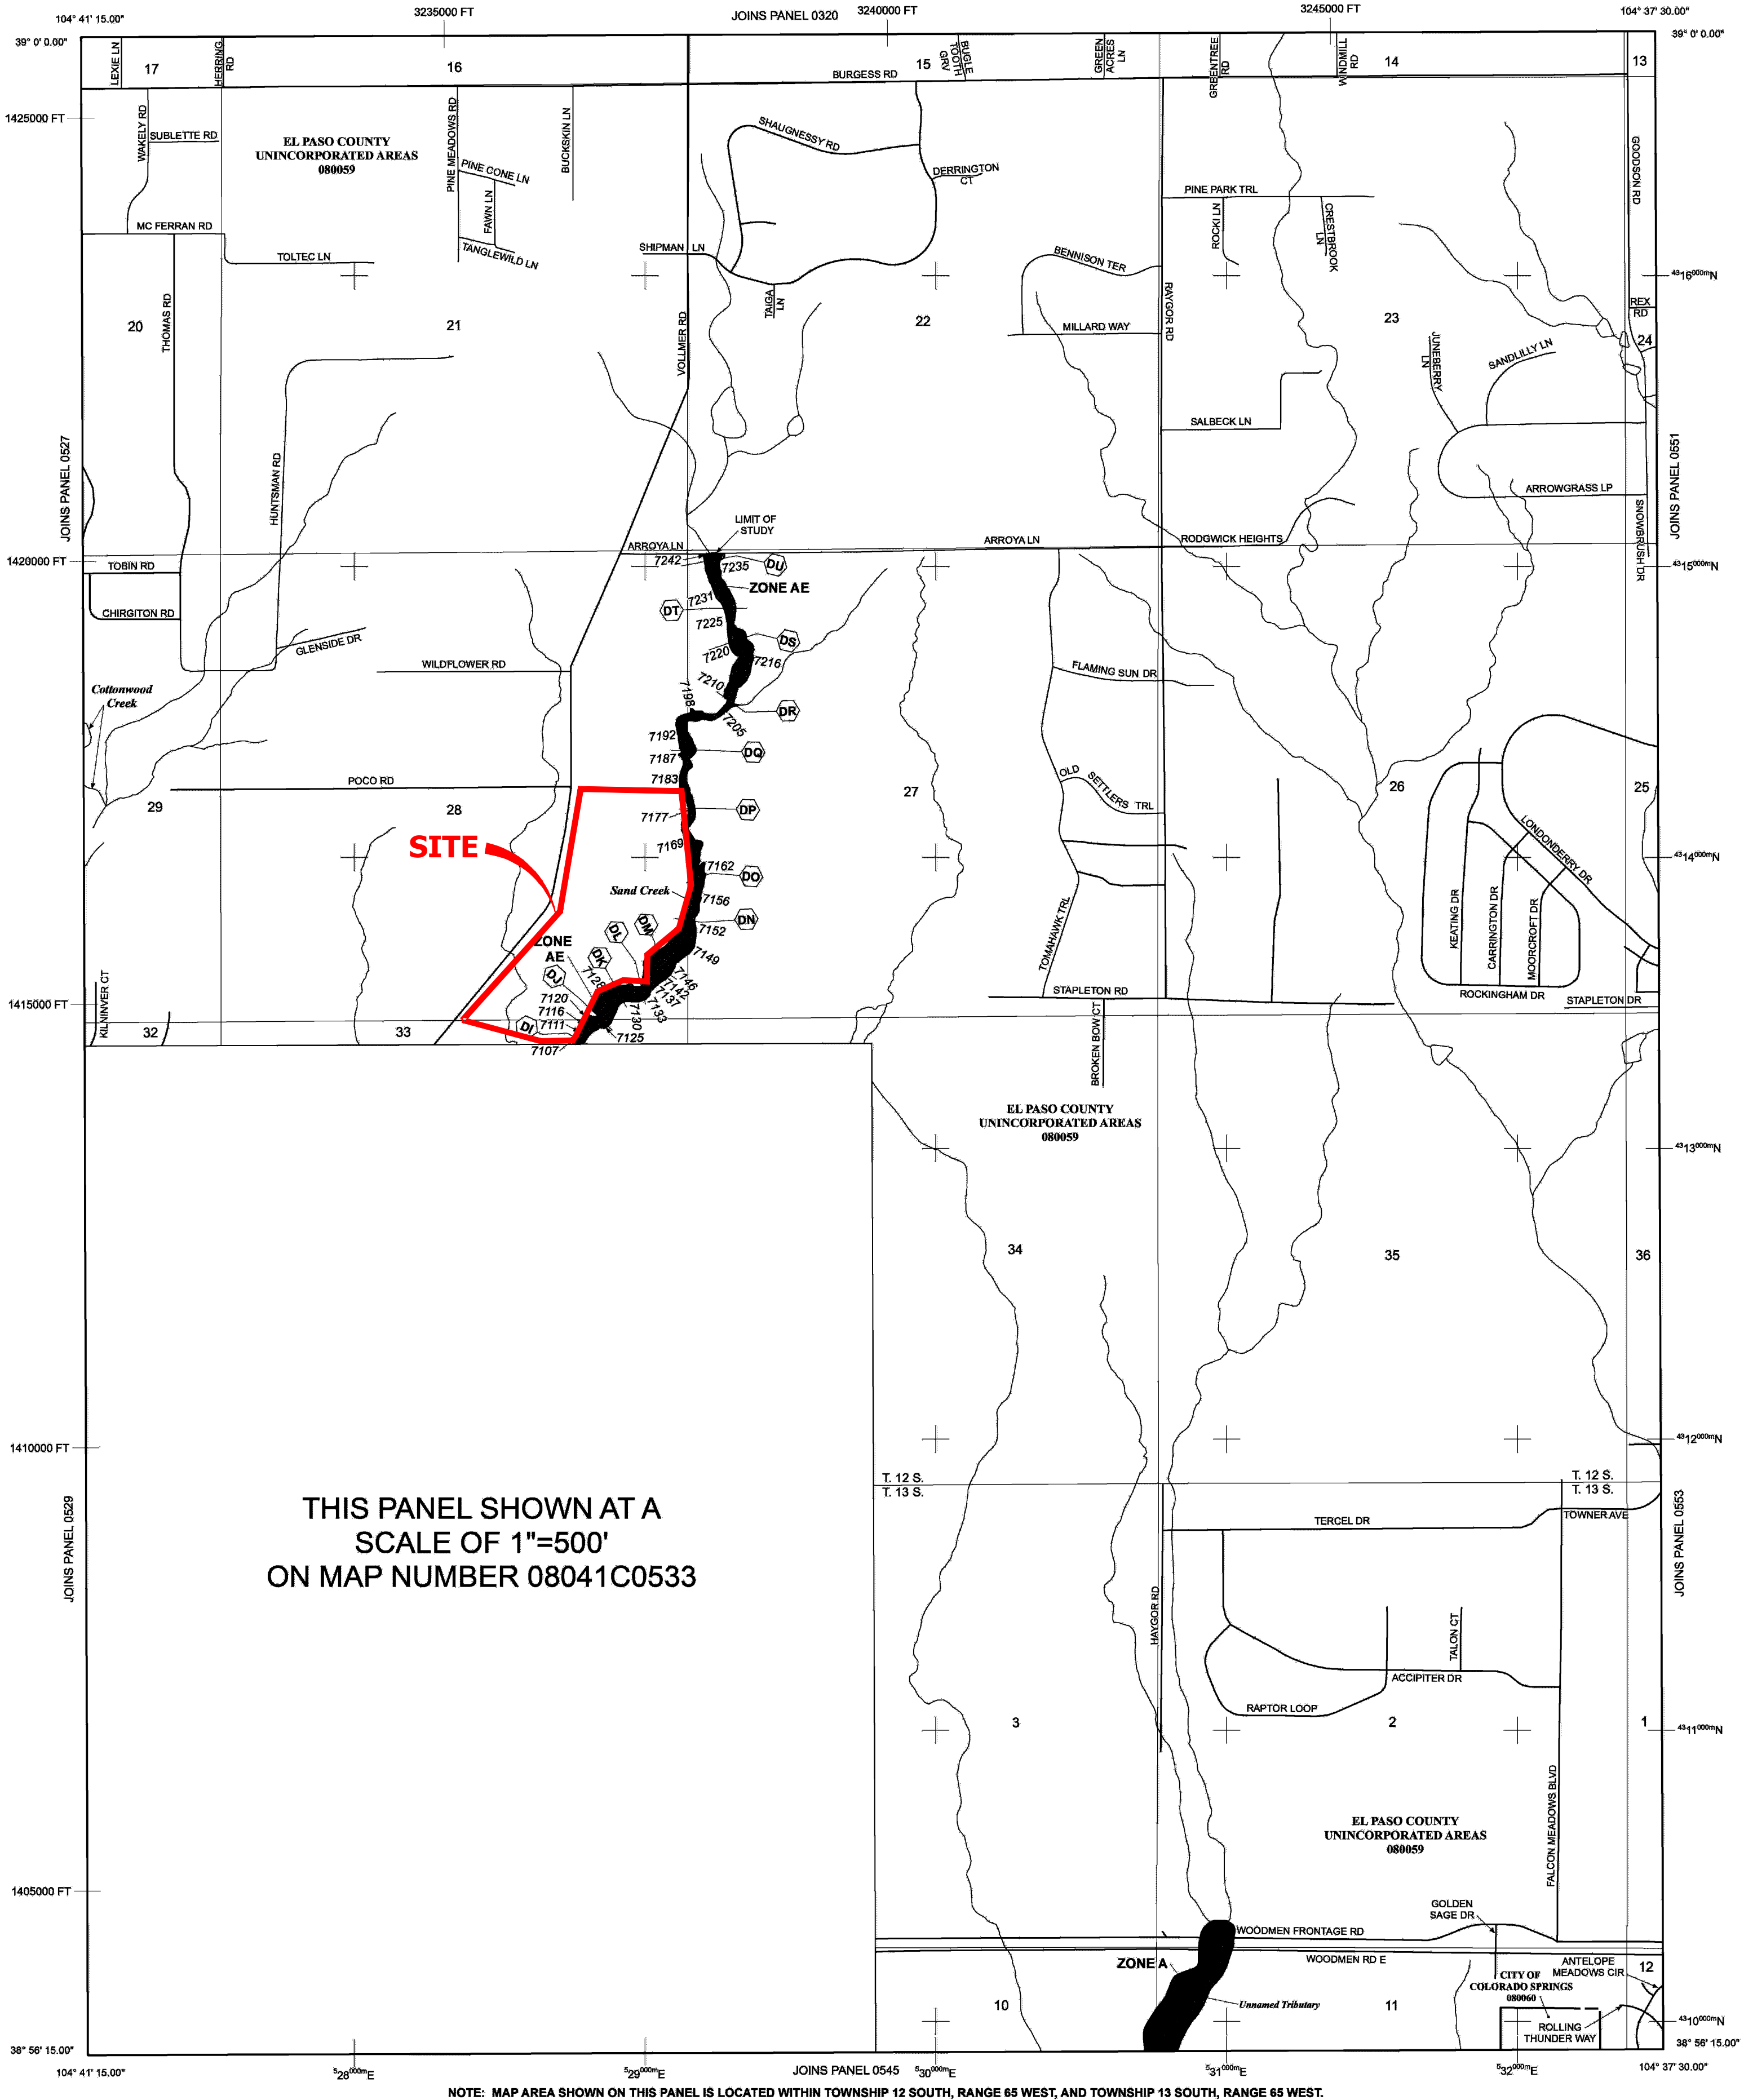

THIS PANEL SHOWN AT A
SCALE OF 1"=500'
ON MAP NUMBER 08041C0533

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN TOWNSHIP 12 SOUTH, RANGE 65 WEST, AND TOWNSHIP 13 SOUTH, RANGE 65 WEST.

LEGEND

SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

ZONE X Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

- ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.
- ZONE D** Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- Floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities
- Base Flood Elevation line and value; elevation in feet*
- Base Flood Elevation value where uniform within zone; elevation in feet*

* Referenced to the North American Vertical Datum of 1988 (NAVD 88)


- Cross section line
- Traverse line
- Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
- 1000-meter Universal Transverse Mercator grid ticks, zone 13
- 5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 0502), Lambert Conformal Conic Projection
- Bench mark (see explanation in Notes to Users section of this FIRM panel)
- River Mile

MAP REPOSITORIES
Refer to Map Repositories list on Map Index
EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
MARCH 17, 1997

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL
DECEMBER 7, 2018 - to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

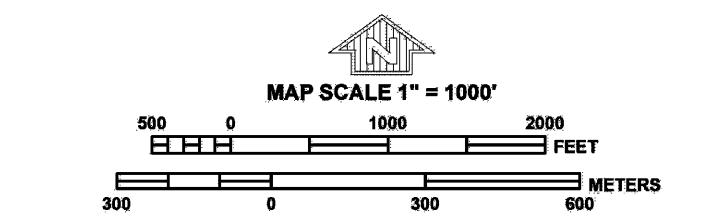

PANEL 0535G

FIRM
FLOOD INSURANCE RATE MAP
EL PASO COUNTY,
COLORADO
AND INCORPORATED AREAS

PANEL 535 OF 1300
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:			
COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS CITY OF	080059	0535	G
EL PASO COUNTY	080059	0535	G

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.

MAP NUMBER
08041C0535G

MAP REVISED
DECEMBER 7, 2018

Federal Emergency Management Agency

Appendix B

Hydrologic Calculations

Provide existing conditions calculations.

JR RESPONSE: Existing Drainage calcs
provided



COMPOSITE % IMPERVIOUS & COMPOSITE RUNOFF COEFFICIENT CALCULATIONS

Subdivision: Homestead Fil. 3
 Location: El Paso County

Project Name: Homestead North
 Project No.: 25188.00
 Calculated By: ARJ
 Checked By:
 Date: 6/25/20

Basin ID	Total Area (ac)	Streets/Paved (100% Impervious)				Residential (45%-65% Impervious)				Lawns (2% Impervious)				Basins Total Weighted C Values		Basins Total Weighted % Imp.
		C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	
A1	3.51	0.90	0.96	0.84	24.0%	0.45	0.59	2.48	31.8%	0.08	0.35	0.18	0.1%	0.54	0.67	55.9%
A2	3.18	0.90	0.96	0.84	26.5%	0.45	0.59	2.12	29.9%	0.08	0.35	0.22	0.1%	0.54	0.67	56.6%
A3	4.58	0.90	0.96	0.79	17.2%	0.45	0.59	3.66	35.9%	0.08	0.35	0.14	0.1%	0.52	0.65	53.2%
A4	3.82	0.90	0.96	0.78	20.3%	0.45	0.59	2.89	34.1%	0.08	0.35	0.15	0.1%	0.53	0.66	54.5%
A5	5.46	0.90	0.96	0.66	12.0%	0.45	0.59	4.70	38.7%	0.08	0.35	0.11	0.0%	0.50	0.63	50.7%
A6	3.91	0.90	0.96	0.66	17.0%	0.45	0.59	3.11	35.7%	0.08	0.35	0.14	0.1%	0.51	0.64	52.8%
A7	1.87	0.90	0.96	0.24	12.7%	0.45	0.59	0.00	0.0%	0.08	0.35	1.63	1.7%	0.18	0.43	14.5%
A8	0.42	0.90	0.96	0.24	58.0%	0.45	0.59	0.03	3.0%	0.08	0.35	0.15	0.7%	0.58	0.72	61.7%
A9	2.97	0.90	0.96	0.00	0.0%	0.45	0.59	1.00	15.2%	0.08	0.35	1.97	1.3%	0.21	0.43	16.5%
Pond A	29.72															47.6%
B1.1	2.71	0.90	0.96	0.39	14.4%	0.45	0.59	2.29	38.0%	0.08	0.35	0.03	0.0%	0.51	0.64	52.4%
B1.2	1.87	0.90	0.96	0.32	17.3%	0.45	0.59	1.48	35.5%	0.08	0.35	0.07	0.1%	0.51	0.65	52.9%
B1.3	0.43	0.90	0.96	0.19	45.0%	0.45	0.59	0.00	0.0%	0.08	0.35	0.24	1.1%	0.45	0.62	46.1%
B2	0.83	0.90	0.96	0.37	44.1%	0.45	0.59	0.32	17.1%	0.08	0.35	0.15	0.4%	0.58	0.71	61.6%
B3	0.26	0.90	0.96	0.26	100.0%	0.45	0.59	0.00	0.0%	0.08	0.35	0.00	0.0%	0.90	0.96	100.0%
B4	3.98	0.90	0.96	0.50	12.7%	0.45	0.59	2.39	27.0%	0.08	0.35	1.09	0.5%	0.41	0.57	40.2%
B5	1.75	0.90	0.96	0.48	27.7%	0.45	0.59	1.19	30.6%	0.08	0.35	0.08	0.1%	0.56	0.68	58.3%
B6	3.60	0.90	0.96	1.33	37.0%	0.45	0.59	1.82	22.8%	0.08	0.35	0.44	0.2%	0.57	0.70	60.0%
B7	1.13	0.90	0.96	0.38	34.1%	0.45	0.59	0.69	27.6%	0.08	0.35	0.05	0.1%	0.59	0.71	61.8%
B8	1.76	0.90	0.96	0.55	31.1%	0.45	0.59	1.07	27.4%	0.08	0.35	0.14	0.2%	0.56	0.69	58.7%
B9	3.79	0.90	0.96	0.82	21.6%	0.45	0.59	2.45	42.0%	0.08	0.35	0.53	0.3%	0.50	0.64	63.8%
B10	0.22	0.90	0.96	0.22	100.0%	0.45	0.59	0.00	0.0%	0.08	0.35	0.00	0.0%	0.90	0.96	100.0%
B11	1.75	0.90	0.96	0.00	0.0%	0.45	0.59	0.00	0.0%	0.08	0.35	1.75	2.0%	0.08	0.35	2.0%
Pond B	24.08															52.2%
C1	2.82	0.90	0.96	0.49	17.4%	0.45	0.59	2.27	52.3%	0.08	0.35	0.06	0.0%	0.52	0.65	69.8%
C2.1	0.20	0.90	0.96	0.18	89.2%	0.45	0.59	0.00	0.0%	0.08	0.35	0.02	0.2%	0.81	0.89	89.4%
C2.2	4.69	0.90	0.96	1.26	26.9%	0.45	0.59	3.33	46.1%	0.08	0.35	0.10	0.0%	0.56	0.68	73.0%
C2.3	0.83	0.90	0.96	0.31	36.8%	0.45	0.59	0.41	32.5%	0.08	0.35	0.11	0.3%	0.57	0.69	69.6%
C3.1	0.35	0.90	0.96	0.29	82.0%	0.45	0.59	0.00	0.0%	0.08	0.35	0.06	0.4%	0.75	0.85	82.3%
C3.2	1.46	0.90	0.96	0.42	28.5%	0.45	0.59	0.96	42.9%	0.08	0.35	0.08	0.1%	0.56	0.68	71.5%
C4.1	5.81	0.90	0.96	0.99	17.0%	0.45	0.59	4.76	53.3%	0.08	0.35	0.06	0.0%	0.52	0.65	70.3%
C4.2	2.58	0.90	0.96	0.34	13.3%	0.45	0.59	2.20	55.4%	0.08	0.35	0.04	0.0%	0.50	0.64	68.8%
C5	0.16	0.90	0.96	0.16	100.0%	0.45	0.59	0.00	0.0%	0.08	0.35	0.00	0.0%	0.90	0.96	100.0%
C6	2.43	0.90	0.96	0.00	0.0%	0.45	0.59	0.32	8.5%	0.08	0.35	2.11	1.7%	0.13	0.38	10.3%
Pond C	21.33															64.5%

STANDARD FORM SF-2 TIME OF CONCENTRATION

Subdivision: Homestead Fil. 3
Location: El Paso County

Project Name: Homestead North
Project No.: 25188.00
Calculated By: ARJ
Checked By:
Date: 6/25/20

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					t _c CHECK			FINAL
DATA						(T _i)			(T _t)					(URBANIZED BASINS)			
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C ₅	C ₁₀₀	L (ft)	S _o (%)	t _i (min)	L _t (ft)	S _t (%)	K	VEL. (ft/s)	t _t (min)	COMP. t _c (min)	TOTAL LENGTH (ft)	Urbanized t _c (min)	
A1	3.51	B	56%	0.54	0.67	150	2.0%	9.9	612	3.0%	20.0	3.5	2.9	12.8	762.0	20.0	12.8
A2	3.18	B	57%	0.54	0.67	150	2.0%	9.8	577	1.7%	20.0	2.6	3.7	13.5	727.0	20.8	13.5
A3	4.58	B	53%	0.52	0.65	150	2.0%	10.3	645	2.9%	20.0	3.4	3.1	13.4	795.0	20.8	13.4
A4	3.82	B	54%	0.53	0.66	150	2.0%	10.1	653	1.9%	20.0	2.8	3.9	14.0	803.0	21.5	14.0
A5	5.46	B	51%	0.50	0.63	187	7.0%	7.9	531	2.1%	20.0	2.9	3.1	10.9	718.0	21.2	10.9
A6	3.91	B	53%	0.51	0.64	230	4.5%	9.8	435	1.6%	20.0	2.6	2.8	12.6	665.0	20.5	12.6
A7	1.87	B	14%	0.18	0.43	240	4.9%	15.2	125	0.6%	20.0	1.5	1.4	16.6	365.0	26.1	16.6
A8	0.42	B	62%	0.58	0.72	9.5	2.0%	2.3	230	1.9%	20.0	2.8	1.4	3.7	239.5	17.1	5.0
A9	2.97	B	17%	0.21	0.43	30	2.0%	7.0	535	0.5%	20.0	1.4	6.3	13.3	565.0	34.3	13.3
B1.1	2.71	B	52%	0.51	0.64	125	2.0%	9.5	610	3.1%	20.0	3.5	2.9	12.4	735.0	20.6	12.4
B1.2	1.87	B	53%	0.51	0.65	150	2.0%	10.3	577	3.4%	20.0	3.7	2.6	12.9	727.0	20.2	12.9
B1.3	0.43	B	46%	0.45	0.62	50	2.0%	6.6	270	2.0%	20.0	2.8	1.6	8.2	320.0	20.2	8.2
B2	0.83	B	62%	0.58	0.71	9.5	2.0%	2.3	368	3.4%	20.0	3.7	1.7	4.0	377.5	17.4	5.0
B3	0.26	B	100%	0.90	0.96	9.5	2.0%	0.9	360	3.7%	20.0	3.9	1.6	2.4	369.5	10.4	5.0
B4	3.98	B	40%	0.41	0.57	25	2.0%	5.0	680	1.6%	20.0	2.5	4.5	9.5	705.0	25.3	9.5
B5	1.75	B	58%	0.56	0.68	25	2.0%	3.9	590	1.6%	20.0	2.6	3.8	7.7	615.0	20.6	7.7
B6	3.60	B	60%	0.57	0.70	9.5	2.0%	2.3	855	3.0%	20.0	3.5	4.1	6.5	864.5	20.5	6.5
B7	1.13	B	62%	0.59	0.71	50	1.0%	6.6	315	1.5%	20.0	2.4	2.1	8.7	365.0	17.9	8.7
B8	1.76	B	59%	0.56	0.69	50	1.0%	6.9	280	1.0%	20.0	2.0	2.4	9.2	330.0	18.8	9.2
B9	3.79	B	64%	0.50	0.64	140	2.0%	10.3	600	2.9%	20.0	3.4	2.9	13.2	740.0	18.4	13.2
B10	0.22	B	100%	0.90	0.96	9.5	2.0%	0.9	200	0.5%	20.0	1.4	2.4	3.3	209.5	11.1	5.0
B11	1.75	B	2%	0.08	0.35	30	2.0%	8.0	250	0.1%	20.0	0.4	9.3	17.3	280.0	45.7	17.3
C1	2.82	B	70%	0.52	0.65	130	2.0%	9.5	690	2.6%	20.0	3.2	3.6	13.0	820.0	17.9	13.0
C2.1	0.20	B	89%	0.81	0.89	7.5	2.0%	1.1	300	1.0%	20.0	2.0	2.5	3.7	307.5	13.2	5.0
C2.2	4.69	B	73%	0.56	0.68	150	2.0%	9.5	630	2.5%	20.0	3.2	3.3	12.8	780.0	17.0	12.8
C2.3	0.83	B	70%	0.57	0.69	100	2.0%	7.7	462	3.3%	20.0	3.6	2.1	9.8	562.0	16.4	9.8
C3.1	0.35	B	82%	0.75	0.85	9.5	2.0%	1.5	460	2.6%	20.0	3.2	2.4	3.9	469.5	14.3	5.0

STANDARD FORM SF-2 TIME OF CONCENTRATION

Subdivision: Homestead Fil. 3
Location: El Paso County

Project Name: Homestead North
Project No.: 25188.00
Calculated By: ARJ
Checked By:
Date: 6/25/20

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					t _c CHECK			FINAL
DATA						(T _i)			(T _t)					(URBANIZED BASINS)			
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C ₅	C ₁₀₀	L (ft)	S _o (%)	t _i (min)	L _t (ft)	S _t (%)	K	VEL. (ft/s)	t _t (min)	COMP. t _c (min)	TOTAL LENGTH (ft)	Urbanized t _c (min)	
C3.2	1.46	B	72%	0.56	0.68	50	2.0%	5.5	365	1.1%	20.0	2.1	2.9	8.4	415.0	16.9	8.4
C4.1	5.81	B	70%	0.52	0.65	150	2.0%	9.5	633	2.8%	20.0	3.3	3.2	12.7	783.0	17.2	12.7
C4.2	2.58	B	69%	0.50	0.64	150	2.0%	10.2	1010	1.7%	20.0	2.6	6.5	16.7	1160.0	20.9	16.7
C5	0.16	B	100%	0.90	0.96	9.5	2.0%	2.6	200	0.6%	20.0	1.5	2.2	4.8	209.5	16.4	5.0
C6	2.43	B	10%	0.13	0.38	15	2.0%	1.1	160	0.5%	20.0	1.4	1.9	3.0	175.0	10.6	5.0

NOTES:

$$t_c = t_i + t_t$$

Equation 6-2

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L_i}}{S_o^{0.33}}$$

Equation 6-3

Table 6-2. NRCS Conveyance factors, K

Type of Land Surface	Conveyance Factor, K
Heavy meadow	2.5
Tillage/field	5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

Where:

t_c = computed time of concentration (minutes)

t_i = overland (initial) flow time (minutes)

t_t = channelized flow time (minutes).

Where:

t_i = overland (initial) flow time (minutes)

C_s = runoff coefficient for 5-year frequency (from Table 6-4)

L_i = length of overland flow (ft)

S_o = average slope along the overland flow path (ft/ft).

$$t_t = \frac{L_t}{60K\sqrt{S_o}} = \frac{L_t}{60V_t}$$

Equation 6-4

$$t_t = (26 - 17i) + \frac{L_t}{60(14i + 9)\sqrt{S_t}}$$

Equation 6-5

Where:

t_t = channelized flow time (travel time, min)

L_t = waterway length (ft)

S_o = waterway slope (ft/ft)

V_t = travel time velocity (ft/sec) = K√S_o

K = NRCS conveyance factor (see Table 6-2).

Where:

t_c = minimum time of concentration for first design point when less than t_c from Equation 6-1.

L_t = length of channelized flow path (ft)

i = imperviousness (expressed as a decimal)

S_t = slope of the channelized flow path (ft/ft).

Use a minimum t_c value of 5 minutes for urbanized areas and a minimum t_c value of 10 minutes for areas that are not considered urban. Use minimum values even when calculations result in a lesser time of concentration.

STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Homestead Fil. 3
 Location: El Paso County
 Design Storm: 5-Year

Project Name: Homestead North
 Project No.: 25188.00
 Calculated By: ARJ
 Checked By:
 Date: 6/25/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	t _c (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street/swale} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	1a	A1	3.51	0.54	12.8	1.89	3.76	7.1					0.00	0	2.84					335	3.4	1.7	On-grade Type R Inlet, Bypass to DP 3a
	3a	A3	4.58	0.52	13.4	2.36	3.69	8.7	14.5	2.36	3.58	8.4	0.20	0.06	2.8					110	3.3	0.5	On-grade Type R Inlet, Bypass to DP 5a
	5a	A5	5.46	0.50	10.9	2.71	3.99	10.8	14.5	2.77	3.58	9.9											Street Flow
	7a	A7	1.87	0.18	16.6	0.34	3.37	1.1	16.6	3.11	3.37	10.5											Flow Confluences at sump inlet
	2a	A2	3.18	0.54	13.5	1.73	3.68	6.4					0.00	0	2.84					335	3.4	1.7	On-grade Type R Inlet, Bypass to DP 4a
	4a	A4	3.82	0.53	14.0	2.01	3.62	7.3	15.2	2.01	3.50	7.0	3.60	1.03	2.8					110	3.3	0.5	On-grade Type R Inlet, Bypass to DP 6a
	6a	A6	3.91	0.51	12.6	2.01	3.78	7.6	15.2	3.04	3.50	10.6											Street Flow
	8a	A8	0.42	0.58	5.0	0.24	5.17	1.2	15.7	3.28	3.45	11.3											Flow Confluences at sump inlet
	9A	A9	2.97	0.21	13.3	0.61	3.70	2.3	16.6	6.38	3.37	21.5											Flows into Pond A. All of Pond A.
	1.1b	B1.1	2.71	0.51	12.4	1.38	3.81	5.3					0.00	0	2.6					210	3.2	1.1	On-grade Type R Inlet, Bypass to DP 2B
	1.2b	B1.2	1.87	0.51	12.9	0.96	3.74	3.6					0.00	0	2.6					235	3.2	1.2	On-grade Type R Inlet, Bypass to DP 2B
	1.3b	B1.3	0.43	0.45	8.2	0.19	4.42	0.8															Street flow
	2b	B2	0.83	0.58	5.0	0.48	5.17	2.5	14.1	0.67	3.61	2.42											Street flow
	3b	B3	0.26	0.90	5.0	0.23	5.17	1.2															Street flow
	4b	B4	3.98	0.41	9.5	1.62	4.21	6.8					0.1	0.02	2.5					340	3.2	1.8	Type R Inlet, Bypass to DP 6B
	6b	B6	3.60	0.57	6.5	2.05	4.79	9.8	14.1	2.97	3.61	10.73											Recives by-pass flows from Basins (B1.1, B1.2 and B4), Direct Runoff from B1.3,B2,B3, and B6
	9b	B9	3.79	0.50	13.2	1.88	3.71	7.0	14.1	3.47	3.61	12.52											Sump inlet Recives by-pass flows from (B1.1, B1.2 and B4) Direct Runoff from B1.3,B2,B3, B6 and B9
	5b	B5	1.75	0.56	7.7	0.98	4.51	4.4															Street flow
	7b	B7	1.13	0.59	8.7	0.66	4.34	2.9	8.7	1.64	4.34	7.1	0.1	0.06	1.6					340	2.5	2.2	On-grade Type R Inlet, Bypass to DP 8B
	8b	B8	1.76	0.56	9.2	0.99	4.25	4.2	10.9	1.05	3.99	4.2											Street Flow, Recives bypass flow from DP 7B
	10b	B10	0.22	0.90	5.0	0.20	5.17	1.0	10.9	1.25	3.99	5.0											Sump inlet revices by-pass flow from 7b and runoff from 5b,8b, and 10b

STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Homestead Fil. 3
Location: El Paso County
Design Storm: 5-Year

Project Name: Homestead North
Project No.: 25188.00
Calculated By: ARJ
Checked By: _____
Date: 6/25/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE			TRAVEL TIME				REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	t _c (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street/swale} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (Inches)	Length (ft)	Velocity (fps)	t _t (min)	
	11b	B11	1.75	0.08	17.3	0.14	3.30	0.5	14.1	4.86	3.61	17.5											Flow confluent into Pond B. All of Basin B
	1c	C1	2.82	0.52	13.0	1.47	3.73	5.5															
	2.3c	C2.3	0.83	0.57	9.8	0.47	4.16	2.0	13.0	1.94	3.73	7.2	0.1	0.03	1.6					185	2.5	1.2	On-Grade Type R Inlet, Street runoff from basin C1 and basin C2.3
	2.1c	C2.1	0.20	0.81	5.0	0.16	5.17	0.8					0.0	0	2.83					630	3.4	3.1	On-Grade Type R Inlet
	2.2c	C2.2	4.69	0.56	12.8	2.64	3.76	9.9	13.0	2.64	3.73	9.8											Runoff from basins 1c, 2.3c, 2.1c and 2.2c
	4.2c	C4.2	2.58	0.50	16.7	1.30	3.36	4.4					0.00	0	2.84					1010	3.4	5.0	On-Grade Type R Inlet, by pass to 4.2c
	4c	C4.1	5.81	0.52	12.7	3.04	3.77	11.5	21.7	5.68	2.97	16.9											Sump Inlet
	3.1c	C3.1	0.35	0.75	5.0	0.26	5.17	1.3					0.00	0	2.84					200	3.4	1.0	On-Grade Type R Inlet, By pass flow to DP 3.2c
	3.2c	C3.2	1.46	0.56	8.4	0.81	4.39	3.6	8.4	0.81	4.39	3.6											Recives by-pass flow from DP 3.1c
	5c	C5	0.16	0.90	5.0	0.14	5.17	0.7	8.4	0.95	4.39	4.2											Sump Inlet
	6c	C6	2.43	0.13	5.0	0.31	5.17	1.6	21.7	6.94	2.97	20.6											Confluent flow for Pond C

Notes:
Street and Pipe C*A values are determined by Q/I using the catchment's intensity value.
All pipes are private and RCP unless otherwise noted. Pipe size shown in table column.

STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Homestead Fil. 3
Location: El Paso County
Design Storm: 100-Year

Project Name: Homestead North
Project No.: 25188.00
Calculated By: ARJ
Checked By:
Date: 6/25/20

Description	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street/swale} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	1a	A1	3.51	0.67	12.8	2.34	6.31	14.8					2.80	0.44	2.84					335	3.4	1.7	On-grade Type R Inlet, Bypass to DP 3a
	3a	A3	4.58	0.65	13.4	2.96	6.19	18.3	14.5	3.40	6.00	20.4	6.10	1.02	2.8					110	3.3	0.5	On-grade Type R Inlet, Bypass to DP 5a
	5a	A5	5.46	0.63	10.9	3.44	6.71	23.1	14.5	4.46	6.00	26.7											Street Flow
	7a	A7	1.87	0.43	16.6	0.80	5.65	4.5	16.6	5.26	5.65	29.7											Flow Confluences at sump inlet
	2a	A2	3.18	0.67	13.5	2.13	6.17	13.2					1.60	0.26	2.84					335	3.4	1.7	On-grade Type R Inlet, Bypass to DP 4a
	4a	A4	3.82	0.66	14.0	2.50	6.08	15.2	15.2	2.76	5.88	16.2	3.60	0.61	2.8					110	3.3	0.5	On-grade Type R Inlet, Bypass to DP 6a
	6a	A6	3.91	0.64	12.6	2.52	6.35	16.0	15.2	3.13	5.88	18.4											Street Flow
	8a	A8	0.42	0.72	5.0	0.30	8.68	2.6	15.7	3.43	5.79	19.9											Flow Confluences at sump inlet
	9A	A9	2.97	0.43	13.3	1.28	6.21	7.9	16.6	8.69	5.65	49.1											Flows into Pond A. All of Pond A.
	1.1b	B1.1	2.71	0.64	12.4	1.74	6.40	11.1					1.50	0.23	2.6					210	3.2	1.1	On-grade Type R Inlet, Bypass to DP 2B
	1.2b	B1.2	1.87	0.65	12.9	1.21	6.29	7.6					0.20	0.03	2.6					235	3.2	1.2	On-grade Type R Inlet, Bypass to DP 2B
	1.3b	B1.3	0.43	0.62	8.2	0.27	7.43	2.0															Street flow
	2b	B2	0.83	0.71	5.0	0.59	8.68	5.1	14.1	1.13	6.06	6.82											Street flow, Recives bypass flow from 1.1b, 1.2b and direct runoff from basin 1.3b
	3b	B3	0.26	0.96	5.0	0.25	8.68	2.2															Street flow
	4b	B4	3.98	0.57	9.5	2.27	7.06	16.0					4.1	0.58	2.5					340	3.2	1.8	Type R Inlet, Bypass to DP 6B
	6b	B6	3.60	0.70	6.5	2.51	8.04	20.2	14.1	4.47	6.06	27.1											Recives by-pass flows from Basins (B1.1, B1.2 and B4), Direct Runoff from B1.3,B2,B3, and B6
	9b	B9	3.79	0.64	13.2	2.41	6.23	15.0	14.1	5.10	6.06	30.9											Sump inlet Recives by-pass flows from (B1.1, B1.2 and B4) Direct Runoff from B1.3,B2,B3, B6 and B9
	5b	B5	1.75	0.68	7.7	1.19	7.58	9.0															Street flow

STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Homestead Fil. 3
Location: El Paso County
Design Storm: 100-Year

Project Name: Homestead North
Project No.: 25188.00
Calculated By: ARJ
Checked By:
Date: 6/25/20

Description	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET/SWALE			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street/swale} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	7b	B7	1.13	0.71	8.7	0.80	7.28	5.8	8.7	1.99	7.28	14.5	3.2	0.44	1.6					340	2.5	2.2	On-grade Type R Inlet, Bypass to DP 8B
	8b	B8	1.76	0.69	9.2	1.21	7.13	8.6	10.9	1.65	6.71	11.1											Street Flow, Recives bypass flow from DP 7B
	10b	B10	0.22	0.96	5.0	0.21	8.68	1.8	10.9	1.86	6.71	12.5											Sump inlet recives by-pass flow from 7b and runoff from 5b,8b, and 10b
	11b	B11	1.75	0.35	17.3	0.61	5.55	3.4	14.1	7.57	6.06	45.9											Flow conflunes into Pond B. All of Basin B
	1c	C1	2.82	0.65	13.0	1.83	6.26	11.5															
	2.3c	C2.3	0.83	0.69	9.8	0.58	6.99	4.1	13.0	2.41	6.26	15.1	3.6	0.57	1.6					185	2.5	1.2	On-Grade Type R Inlet, Street runoff from basin C1 and basin C2.3
	2.1C	C2.1	0.20	0.89	5.0	0.18	8.68	1.6					0.1	0.01	2.83					630	3.4	3.1	On-Grade Type R Inlet
	2.2C	C2.2	4.69	0.68	12.8	3.21	6.32	20.3	13.0	3.22	6.26	20.2											Runoff from basins 1c, 2.3c, 2.1c and 2.2c
	4.2c	C4.2	2.58	0.64	16.7	1.64	5.65	9.3					0.70	0.12	2.84					1010	3.4	5.0	On-Grade Type R Inlet, by pass to 4.2c
	4C	C4.1	5.81	0.65	12.7	3.78	6.33	23.9	21.7	7.13	4.99	35.5											Sump Inlet
	3.1c	C3.1	0.35	0.85	5.0	0.30	8.68	2.6					0.60	0.07	2.84					200	3.4	1.0	On-Grade Type R inlet, By pass flow to DP 3.2c
	3.2c	C3.2	1.46	0.68	8.4	1.00	7.37	7.4	8.4	1.07	7.37	7.9											Recives by-pass flow from DP 3.1c
	5C	C5	0.16	0.96	5.0	0.15	8.68	1.3	8.4	1.22	7.37	9.0											Sump Inlet
	6C	C6	2.43	0.38	5.0	0.93	8.68	8.1	21.7	9.27	4.99	46.2											Conlunced flow for Pond C

Notes:
Street and Pipe C*A values are determined by Q/i using the catchment's intensity value.
All pipes are private and RCP unless otherwise noted. Pipe size shown in table column.

Appendix C


Hydraulic Calculations

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

Project: Homestead North at Sterling Ranch

Basin ID: Pond A



Watershed Information

Selected BMP Type =	EDB
Watershed Area =	29.72 acres
Watershed Length =	1,963 ft
Watershed Length to Centroid =	1,178 ft
Watershed Slope =	0.030 ft/ft
Watershed Imperviousness =	47.60% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depths =	User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Water Quality Capture Volume (WQCV) =	0.495 acre-feet
Excess Urban Runoff Volume (EURV) =	1.506 acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =	1.441 acre-feet
5-yr Runoff Volume (P1 = 1.5 in.) =	2.078 acre-feet
10-yr Runoff Volume (P1 = 1.75 in.) =	2.640 acre-feet
25-yr Runoff Volume (P1 = 2 in.) =	3.407 acre-feet
50-yr Runoff Volume (P1 = 2.25 in.) =	4.023 acre-feet
100-yr Runoff Volume (P1 = 2.52 in.) =	4.809 acre-feet
500-yr Runoff Volume (P1 = 4 in.) =	8.642 acre-feet
Approximate 2-yr Detention Volume =	1.131 acre-feet
Approximate 5-yr Detention Volume =	1.556 acre-feet
Approximate 10-yr Detention Volume =	2.078 acre-feet
Approximate 25-yr Detention Volume =	2.284 acre-feet
Approximate 50-yr Detention Volume =	2.390 acre-feet
Approximate 100-yr Detention Volume =	2.683 acre-feet

Define Zones and Basin Geometry

Zone 1 Volume (WQCV) =	0.495 acre-feet
Zone 2 Volume (EURV - Zone 1) =	1.012 acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	1.177 acre-feet
Total Detention Basin Volume =	2.683 acre-feet
Initial Surge Volume (ISV) =	65 ft ³
Initial Surge Depth (ISD) =	0.50 ft
Total Available Detention Depth (H _{total}) =	5.00 ft
Depth of Trickle Channel (H _{TC}) =	0.50 ft
Slope of Trickle Channel (S _{TC}) =	0.005 ft/ft
Slopes of Main Basin Sides (S _{main}) =	4 ft/V
Basin Length-to-Width Ratio (R _{L/W}) =	2
Initial Surge Area (A _{ISV}) =	129 ft ²
Surge Volume Length (L _{ISV}) =	11.4 ft
Surge Volume Width (W _{ISV}) =	11.4 ft
Depth of Basin Floor (H _{floor}) =	1.17 ft
Length of Basin Floor (L _{floor}) =	250.1 ft
Width of Basin Floor (W _{floor}) =	128.4 ft
Area of Basin Floor (A _{floor}) =	32,100 ft ²
Volume of Basin Floor (V _{floor}) =	13,364 ft ³
Depth of Main Basin (H _{main}) =	2.83 ft
Length of Main Basin (L _{main}) =	272.7 ft
Width of Main Basin (W _{main}) =	151.0 ft
Area of Main Basin (A _{main}) =	41,180 ft ²
Volume of Main Basin (V _{main}) =	103,424 ft ³
Calculated Total Basin Volume (V _{total}) =	2.684 acre-feet

Optional User Overrides

	acre-feet
	acre-feet
1.19	inches
1.50	inches
1.75	inches
2.00	inches
2.25	inches
2.52	inches
4.00	inches


Depth Increment =	0.10	ft								
Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Optional Override Area (ft ²)	Area (acre)	Volume (ft ³)	Volume (ac-ft)	
Top of Micropool	0.00		11.4	11.4	129		0.003			
ISV	0.50		11.4	11.4	129		0.003	65	0.001	
	0.60		11.4	11.4	129		0.003	78	0.002	
	0.70		11.4	11.4	129		0.003	91	0.002	
	0.80		11.4	11.4	129		0.003	103	0.002	
	0.90		11.4	11.4	129		0.003	116	0.003	
	1.00		11.4	11.4	129		0.003	129	0.003	
	1.10		31.8	21.4	679		0.016	166	0.004	
	1.20		52.2	31.4	1,637		0.038	279	0.006	
	1.30		72.6	41.4	3,002		0.069	507	0.012	
	1.40		93.0	51.4	4,776		0.110	893	0.020	
	1.50		113.4	61.4	6,958		0.160	1,476	0.034	
	1.60		133.8	71.4	9,548		0.219	2,298	0.053	
	1.70		154.2	81.4	12,545		0.288	3,399	0.078	
	1.80		174.6	91.4	15,951		0.366	4,821	0.111	
	1.90		195.0	101.4	19,765		0.454	6,603	0.152	
	2.00		215.4	111.4	23,987		0.551	8,787	0.202	
	2.10		235.8	121.4	28,616		0.657	11,414	0.262	
	2.17		250.1	128.4	32,100		0.737	13,538	0.311	
	2.20		250.3	128.6	32,191		0.739	14,502	0.333	
	2.30		251.1	129.4	32,494		0.746	17,736	0.407	
2.40		251.9	130.2	32,799		0.753	21,001	0.482		
Zone 1 (WQCV)	2.42		252.1	130.4	32,861		0.754	21,658	0.497	
	2.50		252.7	131.0	33,106		0.760	24,296	0.558	
	2.60		253.5	131.8	33,413		0.767	27,622	0.634	
	2.70		254.3	132.6	33,722		0.774	30,979	0.711	
	2.80		255.1	133.4	34,032		0.781	34,367	0.789	
	2.90		255.9	134.2	34,344		0.788	37,786	0.867	
	3.00		256.7	135.0	34,657		0.796	41,236	0.947	
	3.10		257.5	135.8	34,971		0.803	44,717	1.027	
	3.20		258.3	136.6	35,286		0.810	48,230	1.107	
	3.30		259.1	137.4	35,602		0.817	51,774	1.189	
	3.40		259.9	138.2	35,920		0.825	55,350	1.271	
	3.50		260.7	139.0	36,239		0.832	58,958	1.353	
	3.60		261.5	139.8	36,560		0.839	62,598	1.437	
	3.69		262.2	140.5	36,849		0.846	65,902	1.513	
	3.70		262.3	140.6	36,882		0.847	66,270	1.521	
	3.80		263.1	141.4	37,204		0.854	69,975	1.606	
	3.90		263.9	142.2	37,529		0.862	73,711	1.692	
	4.00		264.7	143.0	37,854		0.869	77,480	1.779	
	4.10		265.5	143.8	38,181		0.877	81,282	1.866	
	4.20		266.3	144.6	38,509		0.884	85,117	1.954	
	4.30		267.1	145.4	38,839		0.892	88,984	2.043	
	4.40		267.9	146.2	39,169		0.899	92,884	2.132	
	4.50		268.7	147.0	39,501		0.907	96,818	2.223	
	4.60		269.5	147.8	39,834		0.914	100,785	2.314	
	4.70		270.3	148.6	40,169		0.922	104,785	2.406	
	4.80		271.1	149.4	40,505		0.930	108,819	2.498	
	4.90		271.9	150.2	40,842		0.938	112,886	2.592	
	5.00		272.7	151.0	41,180		0.945	116,987	2.686	
	5.10		273.5	151.8	41,520		0.953	121,122	2.781	
	5.20		274.3	152.6	41,860		0.961	125,291	2.876	
	5.30		275.1	153.4	42,203		0.969	129,494	2.973	
	5.40		275.9	154.2	42,546		0.977	133,731	3.070	
	5.50		276.7	155.0	42,891		0.985	138,003	3.168	
	5.60		277.5	155.8	43,237		0.993	142,310	3.267	
	5.70		278.3	156.6	43,584		1.001	146,651	3.367	
	5.80		279.1	157.4	43,933		1.009	151,026	3.467	
	5.90		279.9	158.2	44,282		1.017	155,437	3.568	
	6.00		280.7	159.0	44,634		1.025	159,883	3.670	
	6.10		281.5	159.8	44,986		1.033	164,364	3.773	
	6.20		282.3	160.6	45,340		1.041	168,880	3.877	
	6.30		283.1	161.4	45,695		1.049	173,432	3.981	
	6.40		283.9	162.2	46,051		1.057	178,019	4.087	
	6.50		284.7	163.0	46,408		1.065	182,642	4.193	
	6.60		285.5	163.8	46,767		1.074	187,301	4.300	
	6.70		286.3	164.6	47,127		1.082	191,996	4.408	
	6.80		287.1	165.4	47,489		1.090	196,726	4.516	
	6.90		287.9	166.2	47,851		1.099	201,493	4.626	
	7.00		288.7	167.0	48,215		1.107	206,297	4.736	
	7.10		289.5	167.8	48,580		1.115	211,136	4.847	
	7.20		290.3	168.6	48,947		1.124	216,013	4.959	
	7.30		291.1	169.4	49,315		1.132	220,926	5.072	
	7.40		291.9	170.2	49,684		1.141	225,876	5.185	
	7.50		292.7	171.0	50,054		1.149	230,863	5.300	
	7.60		293.5	171.8	50,426		1.158	235,887	5.415	
	7.70		294.3	172.6	50,798		1.166	240,948	5.531	
	7.80		295.1	173.4	51,173		1.175	246,046	5.648	
	7.90		295.9	174.2	51,548		1.183	251,182	5.766	
	8.00		296.7	175.0	51,925		1.192	256,356	5.885	
	8.10		297.5	175.8	52,303		1.201	261,567	6.005	
	8.20		298.3	176.6	52,682		1.209	266,817	6.125	
	8.30		299.1	177.4	53,063		1.218	272,104	6.247	
	8.40		299.9	178.2	53,445		1.227	277,429	6.369	
	8.50		300.7	179.0	53,828		1.236	282,793	6.492	
	8.60		301.5	179.8	54,212		1.245	288,195	6.616	
	8.70		302.3	180.6	54,598		1.253	293,635	6.741	
	8.80		303.1	181.4	54,985		1.262	299,114	6.867	
	8.90		303.9	182.2	55,373		1.271	304,632	6.993	
	9.00		304.7	183.0	55,762		1.280	310,189	7.121	
	9.10		305.5	183.8	56,153		1.289	315,785	7.249	
	9.20		306.3	184.6	56,545		1.298	321,420	7.378	
	9.30		307.1	185.4	56,939		1.307	327,094	7.509	
	9.40		307.9	186.2	57,333		1.316	332,807	7.640	
	9.50		308.7	187.0	57,729		1.325	338,561	7.772	
	9.60		309.5	187.8	58,126		1.334	344,353	7.905	
	9.70		310.3	188.6	58,525		1.344	350,186	8.039	
	9.80		311.1	189.4	58,925		1.353	356,058	8.174	
	9.90		311.9	190.2	59,326		1.362	361,971	8.310	

JR RESPONSE: ADDED

Provide the FSD summary tables

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

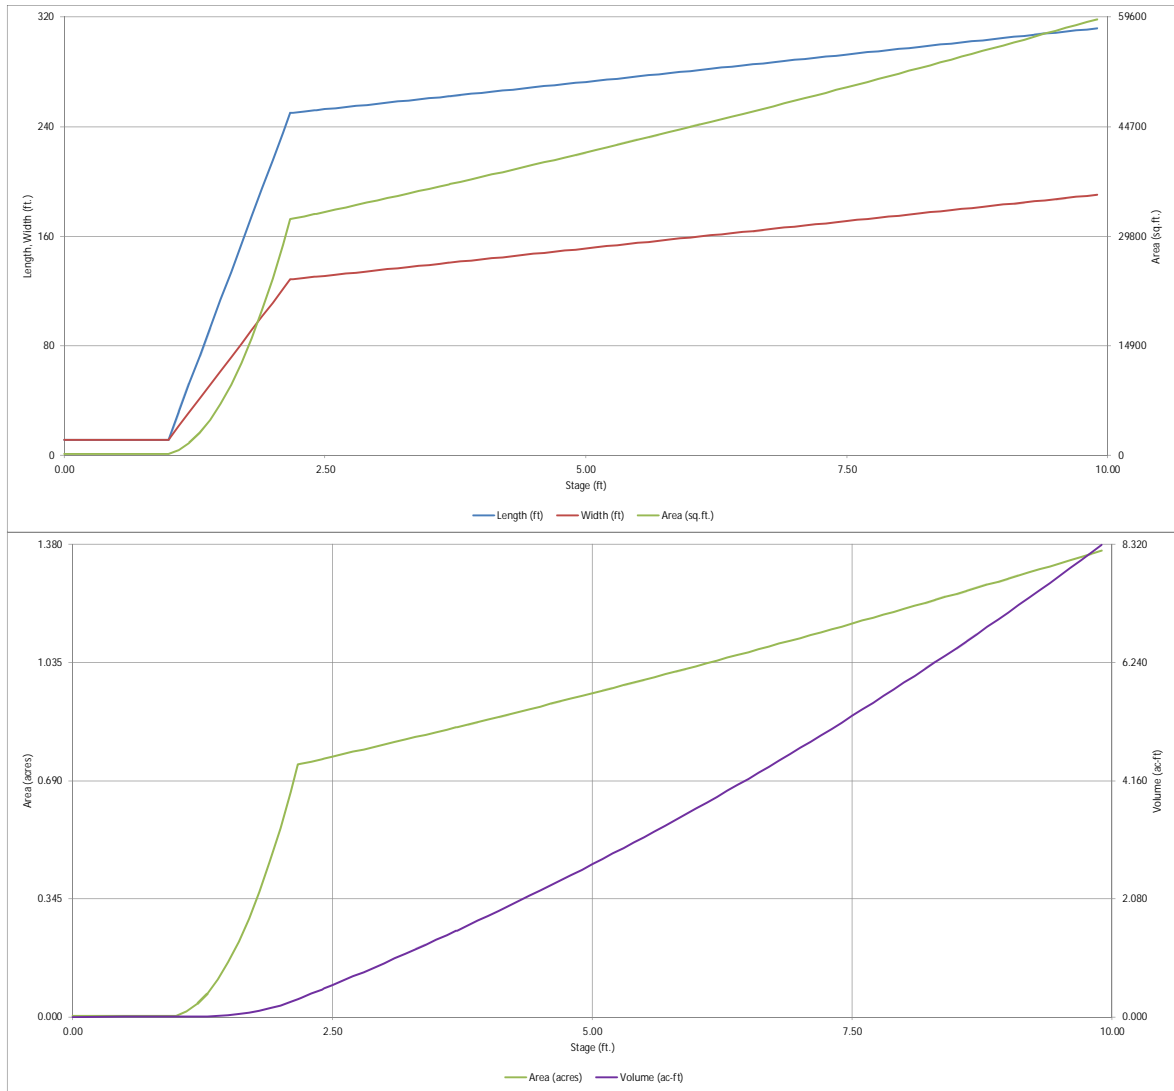


DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

Project: Homestead North at Sterling Ranch

Basin ID: Pond B



Example Zone Configuration (Retention Pond)

Watershed Information

Selected BMP Type =	EDB
Watershed Area =	24.08 acres
Watershed Length =	1,290 ft
Watershed Length to Centroid =	775 ft
Watershed Slope =	0.020 ft/ft
Watershed Imperviousness =	52.20% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depths =	Denver - Capitol Building

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Water Quality Capture Volume (WQCV) =	0.426 acre-feet
Excess Urban Runoff Volume (EURV) =	1.348 acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =	1.265 acre-feet
5-yr Runoff Volume (P1 = 1.5 in.) =	1.793 acre-feet
10-yr Runoff Volume (P1 = 1.75 in.) =	2.255 acre-feet
25-yr Runoff Volume (P1 = 2 in.) =	2.868 acre-feet
50-yr Runoff Volume (P1 = 2.25 in.) =	3.368 acre-feet
100-yr Runoff Volume (P1 = 2.52 in.) =	4.000 acre-feet
500-yr Runoff Volume (P1 = 4 in.) =	7.103 acre-feet
Approximate 2-yr Detention Volume =	1.022 acre-feet
Approximate 5-yr Detention Volume =	1.396 acre-feet
Approximate 10-yr Detention Volume =	1.836 acre-feet
Approximate 25-yr Detention Volume =	2.004 acre-feet
Approximate 50-yr Detention Volume =	2.093 acre-feet
Approximate 100-yr Detention Volume =	2.324 acre-feet

Optional User Overrides

	acre-feet
	acre-feet
1.19	inches
1.50	inches
1.75	inches
2.00	inches
2.25	inches
2.52	inches
4.00	inches


Define Zones and Basin Geometry

Zone 1 Volume (WQCV) =	0.426 acre-feet
Zone 2 Volume (EURV - Zone 1) =	0.922 acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.976 acre-feet
Total Detention Basin Volume =	2.324 acre-feet
Initial Surge Volume (ISV) =	56 ft ³
Initial Surge Depth (ISD) =	0.50 ft
Total Available Detention Depth (H _{total}) =	5.00 ft
Depth of Trickle Channel (H _{TC}) =	0.50 ft
Slope of Trickle Channel (S _{TC}) =	0.010 ft/ft
Slopes of Main Basin Sides (S _{main}) =	4 ft/V
Basin Length-to-Width Ratio (R _{L/W}) =	2
Initial Surge Area (A _{ISV}) =	111 ft ²
Surge Volume Length (L _{ISV}) =	10.6 ft
Surge Volume Width (W _{ISV}) =	10.6 ft
Depth of Basin Floor (H _{floor}) =	2.78 ft
Length of Basin Floor (L _{floor}) =	299.7 ft
Width of Basin Floor (W _{floor}) =	149.6 ft
Area of Basin Floor (A _{floor}) =	44,817 ft ²
Volume of Basin Floor (V _{floor}) =	43,704 ft ³
Depth of Main Basin (H _{main}) =	1.22 ft
Length of Main Basin (L _{main}) =	309.4 ft
Width of Main Basin (W _{main}) =	159.3 ft
Area of Main Basin (A _{main}) =	49,297 ft ²
Volume of Main Basin (V _{main}) =	57,388 ft ³
Calculated Total Basin Volume (V _{total}) =	2.323 acre-feet

Depth Increment =	0.10									
Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Optional Override Area (ft ²)	Area (acre)	Volume (ft ³)	Volume (ac-ft)	
Top of Micropool	0.00		10.6	10.6	111		0.003			
ISV	0.50		10.6	10.6	111		0.003	56	0.001	
	0.60		10.6	10.6	111		0.003	67	0.002	
	0.70		10.6	10.6	111		0.003	78	0.002	
	0.80		10.6	10.6	111		0.003	89	0.002	
	0.90		10.6	10.6	111		0.003	100	0.002	
	1.00		10.6	10.6	111		0.003	111	0.003	
	1.10		21.0	15.6	326		0.007	132	0.003	
	1.20		31.4	20.6	644		0.015	180	0.004	
	1.30		41.8	25.6	1,067		0.024	265	0.006	
	1.40		52.2	30.6	1,593		0.037	397	0.009	
	1.50		62.6	35.6	2,224		0.051	587	0.013	
	1.60		73.0	40.6	2,958		0.068	845	0.019	
	1.70		83.4	45.6	3,797		0.087	1,182	0.027	
	1.80		93.8	50.6	4,739		0.109	1,608	0.037	
	1.90		104.2	55.6	5,786		0.133	2,133	0.049	
	2.00		114.6	60.6	6,937		0.159	2,769	0.064	
	2.10		125.0	65.6	8,191		0.188	3,524	0.081	
	2.20		135.4	70.6	9,550		0.219	4,410	0.101	
	2.30		145.8	75.6	11,012		0.253	5,438	0.125	
	2.40		156.2	80.6	12,579		0.289	6,616	0.152	
	2.50		166.6	85.6	14,249		0.327	7,957	0.183	
	2.60		177.0	90.6	16,024		0.368	9,469	0.217	
	2.70		187.4	95.6	17,902		0.411	11,165	0.256	
	2.80		197.8	100.6	19,885		0.456	13,053	0.300	
	2.90		208.2	105.6	21,971		0.504	15,145	0.348	
	3.00		218.6	110.6	24,162		0.555	17,451	0.401	
	Zone 1 (WQCV)	3.05		223.8	113.1	25,296		0.581	18,687	0.429
		3.10		229.0	115.6	26,456		0.607	19,981	0.459
		3.20		239.4	120.6	28,855		0.662	22,746	0.522
		3.30		249.8	125.6	31,357		0.720	25,755	0.591
3.40			260.2	130.6	33,964		0.780	29,021	0.666	
3.50			270.6	135.6	36,674		0.842	32,552	0.747	
3.60			281.0	140.6	39,489		0.907	36,359	0.835	
3.70			291.4	145.6	42,407		0.974	40,453	0.929	
Floor		3.78		299.7	149.6	44,817		1.029	43,941	1.009
		3.80		299.8	149.7	44,889		1.031	44,838	1.029
	3.90		300.6	150.5	45,249		1.039	49,345	1.133	
	4.00		301.4	151.3	45,611		1.047	53,888	1.237	
	4.10		302.2	152.1	45,974		1.055	58,468	1.342	
	Zone 2 (EURV)	4.11		302.3	152.2	46,010		1.056	58,927	1.353
		4.20		303.0	152.9	46,338		1.064	63,083	1.448
		4.30		303.8	153.7	46,703		1.072	67,735	1.555
		4.40		304.6	154.5	47,070		1.081	72,424	1.663
		4.50		305.4	155.3	47,438		1.089	77,149	1.771
4.60			306.2	156.1	47,807		1.097	81,911	1.880	
4.70			307.0	156.9	48,177		1.106	86,711	1.991	
4.80			307.8	157.7	48,549		1.115	91,547	2.102	
Zone 3 (100-year)		4.90		308.6	158.5	48,922		1.123	96,420	2.214
		5.00		309.4	159.3	49,297		1.132	101,331	2.326
	5.10		310.2	160.1	49,672		1.140	106,280	2.440	
	5.20		311.0	160.9	50,049		1.149	111,266	2.554	
	5.30		311.8	161.7	50,427		1.158	116,290	2.670	
	5.40		312.6	162.5	50,807		1.166	121,351	2.786	
	5.50		313.4	163.3	51,188		1.175	126,451	2.903	
	5.60		314.2	164.1	51,570		1.184	131,589	3.021	
	5.70		315.0	164.9	51,953		1.193	136,765	3.140	
	5.80		315.8	165.7	52,338		1.202	141,980	3.259	
5.90		316.6	166.5	52,723		1.210	147,233	3.380		
6.00		317.4	167.3	53,111		1.219	152,524	3.501		
6.10		318.2	168.1	53,499		1.228	157,855	3.624		
6.20		319.0	168.9	53,889		1.237	163,224	3.747		
6.30		319.8	169.7	54,280		1.246	168,633	3.871		
6.40		320.6	170.5	54,672		1.255	174,080	3.996		
6.50		321.4	171.3	55,066		1.264	179,567	4.122		
6.60		322.2	172.1	55,460		1.273	185,093	4.249		
6.70		323.0	172.9	55,857		1.282	190,659	4.377		
6.80		323.8	173.7	56,254		1.291	196,265	4.506		
6.90		324.6	174.5	56,653		1.301	201,910	4.635		
7.00		325.4	175.3	57,053		1.310	207,595	4.766		
7.10		326.2	176.1	57,454		1.319	213,321	4.897		
7.20		327.0	176.9	57,856		1.328	219,086	5.030		
7.30		327.8	177.7	58,260		1.337	224,892	5.163		
7.40		328.6	178.5	58,665		1.347	230,738	5.297		
7.50		329.4	179.3	59,072		1.356	236,625	5.432		
7.60		330.2	180.1	59,479		1.365	242,553	5.568		
7.70		331.0	180.9	59,888		1.375	248,521	5.705		
7.80		331.8	181.7	60,298		1.384	254,530	5.843		
7.90		332.6	182.5	60,710		1.394	260,581	5.982		
8.00		333.4	183.3	61,123		1.403	266,672	6.122		
8.10		334.2	184.1	61,537		1.413	272,805	6.263		
8.20		335.0	184.9	61,952		1.422	278,980	6.404		
8.30		335.8	185.7	62,369		1.432	285,196	6.547		
8.40		336.6	186.5	62,786		1.441	291,453	6.691		
8.50		337.4	187.3	63,206		1.451	297,753	6.835		
8.60		338.2	188.1	63,626		1.461	304,094	6.981		
8.70		339.0	188.9	64,048		1.470	310,478	7.128		
8.80		339.8	189.7	64,471		1.480	316,904	7.275		
8.90		340.6	190.5	64,895		1.490	323,372	7.424		
9.00		341.4	191.3	65,321		1.500	329,883	7.573		
9.10		342.2	192.1	65,747		1.509	336,436	7.724		
9.20		343.0	192.9	66,175		1.519	343,033	7.875		
9.30		343.8	193.7	66,605		1.529	349,672	8.027		
9.40		344.6	194.5	67,036		1.539	356,354	8.181		
9.50		345.4	195.3	67,468		1.549	363,079	8.335		
9.60		346.2	196.1	67,901		1.559	369,847	8.491		
9.70		347.0	196.9	68,335		1.569	376,659	8.647		
9.80		347.8	197.7	68,771		1.579	383,514	8.804		
9.90		348.6	198.5	69,208		1.589	390,413	8.963		

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

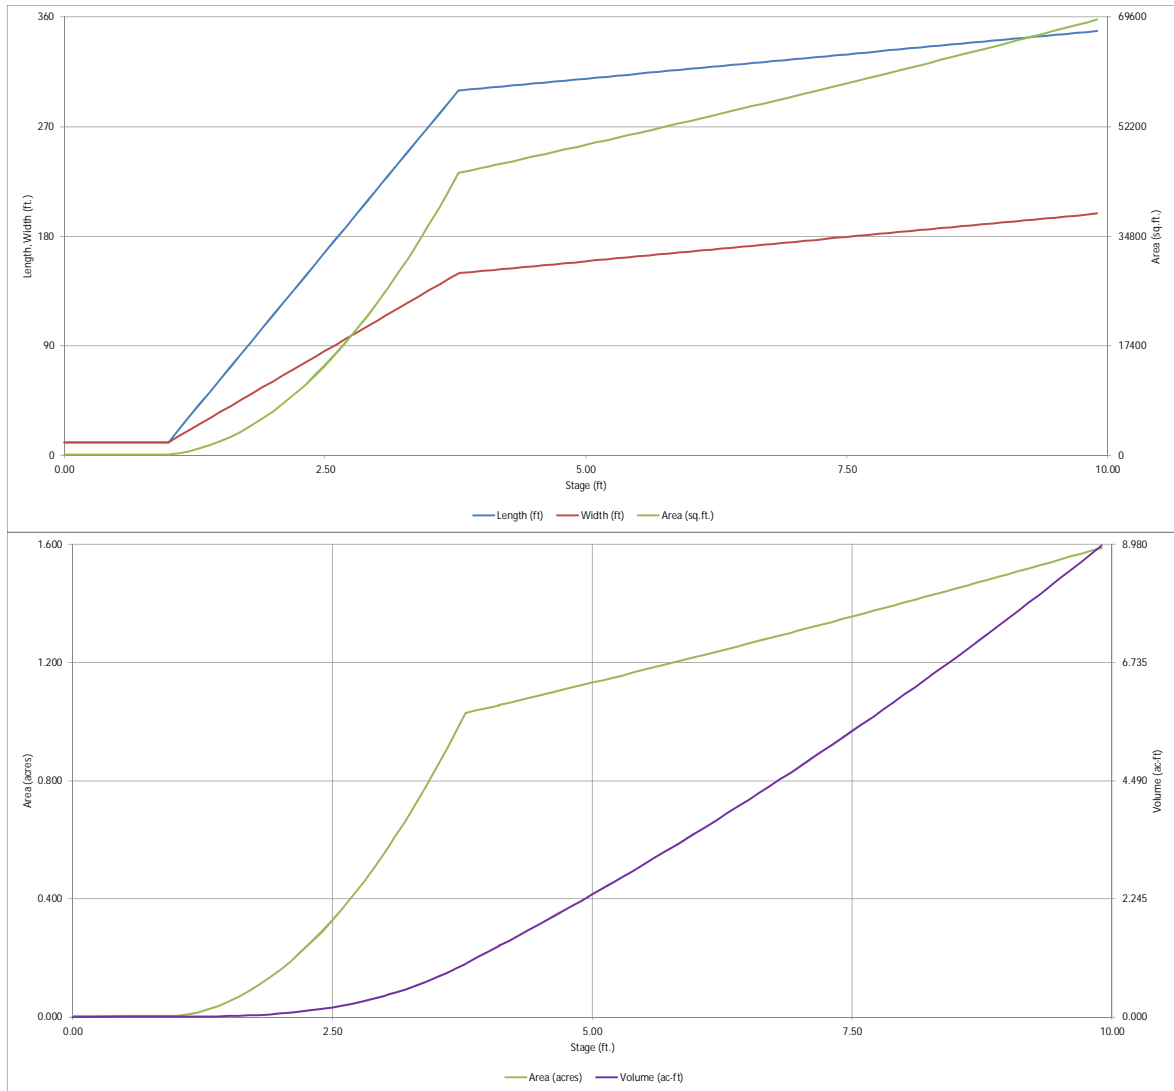


DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

Project: Homestead North at Sterling Ranch

Basin ID: Pond C



Example Zone Configuration (Retention Pond)

Watershed Information

Selected BMP Type =	EDB
Watershed Area =	21.33 acres
Watershed Length =	1,580 ft
Watershed Length to Centroid =	948 ft
Watershed Slope =	0.021 ft/ft
Watershed Imperviousness =	64.50% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depths =	User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Water Quality Capture Volume (WQCV) =	0.448 acre-feet
Excess Urban Runoff Volume (EURV) =	1.501 acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =	1.382 acre-feet
5-yr Runoff Volume (P1 = 1.5 in.) =	1.886 acre-feet
10-yr Runoff Volume (P1 = 1.75 in.) =	2.317 acre-feet
25-yr Runoff Volume (P1 = 2 in.) =	2.844 acre-feet
50-yr Runoff Volume (P1 = 2.25 in.) =	3.299 acre-feet
100-yr Runoff Volume (P1 = 2.52 in.) =	3.851 acre-feet
500-yr Runoff Volume (P1 = 4 in.) =	6.639 acre-feet
Approximate 2-yr Detention Volume =	1.163 acre-feet
Approximate 5-yr Detention Volume =	1.560 acre-feet
Approximate 10-yr Detention Volume =	1.991 acre-feet
Approximate 25-yr Detention Volume =	2.146 acre-feet
Approximate 50-yr Detention Volume =	2.234 acre-feet
Approximate 100-yr Detention Volume =	2.418 acre-feet

Optional User Overrides

acre-feet	acre-feet
acre-feet	acre-feet
inches	inches
inches	inches
inches	inches
inches	inches
inches	inches
inches	inches
inches	inches


Define Zones and Basin Geometry

Zone 1 Volume (WQCV) =	0.448 acre-feet
Zone 2 Volume (EURV - Zone 1) =	1.053 acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.917 acre-feet
Total Detention Basin Volume =	2.418 acre-feet
Initial Surge Volume (ISV) =	59 ft ³
Initial Surge Depth (ISD) =	0.50 ft
Total Available Detention Depth (H _{total}) =	5.00 ft
Depth of Trickle Channel (H _{TC}) =	0.50 ft
Slope of Trickle Channel (S _{TC}) =	0.005 ft/ft
Slopes of Main Basin Sides (S _{main}) =	4 H:V
Basin Length-to-Width Ratio (R _{L/W}) =	2
Initial Surge Area (A _{ISV}) =	117 ft ²
Surge Volume Length (L _{ISV}) =	10.8 ft
Surge Volume Width (W _{ISV}) =	10.8 ft
Depth of Basin Floor (H _{floor}) =	1.09 ft
Length of Basin Floor (L _{floor}) =	233.2 ft
Width of Basin Floor (W _{floor}) =	119.8 ft
Area of Basin Floor (A _{floor}) =	27,941 ft ²
Volume of Basin Floor (V _{floor}) =	10,852 ft ³
Depth of Main Basin (H _{main}) =	2.91 ft
Length of Main Basin (L _{main}) =	256.5 ft
Width of Main Basin (W _{main}) =	143.1 ft
Area of Main Basin (A _{main}) =	36,701 ft ²
Volume of Main Basin (V _{main}) =	93,766 ft ³
Calculated Total Basin Volume (V _{total}) =	2,404 acre-feet

Depth Increment =	0.10								
Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft ²)	Optional Override Area (ft ²)	Area (acre)	Volume (ft ³)	Volume (ac-ft)
Top of Micropool	0.00		10.8	10.8	117		0.003		
ISV	0.50		10.8	10.8	117		0.003	59	0.001
	0.60		10.8	10.8	117		0.003	70	0.002
	0.70		10.8	10.8	117		0.003	82	0.002
	0.80		10.8	10.8	117		0.003	94	0.002
	0.90		10.8	10.8	117		0.003	105	0.002
	1.00		10.8	10.8	117		0.003	117	0.003
	1.10		31.2	20.8	650		0.015	152	0.003
	1.20		51.6	30.8	1,591		0.037	261	0.006
	1.30		72.0	40.8	2,940		0.068	484	0.011
	1.40		92.4	50.8	4,697		0.108	862	0.020
Floor	1.50		112.8	60.8	6,863		0.158	1,437	0.033
	1.60		133.2	70.8	9,436		0.217	2,249	0.052
	1.70		153.6	80.8	12,417		0.285	3,338	0.077
	1.80		174.0	90.8	15,806		0.363	4,746	0.109
	1.90		194.4	100.8	19,603		0.450	6,513	0.150
	2.00		214.8	110.8	23,808		0.547	8,680	0.199
	2.09		233.2	119.8	27,941		0.641	11,006	0.253
	2.10		233.3	119.9	27,969		0.642	11,285	0.259
	2.20		234.1	120.7	28,253		0.649	14,097	0.324
	2.30		234.9	121.5	28,537		0.655	16,936	0.389
Zone 1 (WQCV)	2.40		235.7	122.3	28,823		0.662	19,804	0.455
	2.50		236.5	123.1	29,110		0.668	22,701	0.521
	2.60		237.3	123.9	29,398		0.675	25,626	0.588
	2.70		238.1	124.7	29,688		0.682	28,580	0.656
	2.80		238.9	125.5	29,979		0.688	31,564	0.725
	2.90		239.7	126.3	30,271		0.695	34,576	0.794
	3.00		240.5	127.1	30,564		0.702	37,618	0.864
	3.10		241.3	127.9	30,859		0.708	40,689	0.934
	3.20		242.1	128.7	31,155		0.715	43,790	1.005
	3.30		242.9	129.5	31,452		0.722	46,920	1.077
Zone 2 (EURV)	3.40		243.7	130.3	31,751		0.729	50,080	1.150
	3.50		244.5	131.1	32,050		0.736	53,270	1.223
	3.60		245.3	131.9	32,352		0.743	56,490	1.297
	3.70		246.1	132.7	32,654		0.750	59,740	1.371
	3.80		246.9	133.5	32,958		0.757	63,021	1.447
	3.88		247.5	134.1	33,201		0.762	65,667	1.508
	3.90		247.7	134.3	33,262		0.764	66,332	1.523
	4.00		248.5	135.1	33,569		0.771	69,674	1.599
	4.10		249.3	135.9	33,876		0.778	73,046	1.677
	4.20		250.1	136.7	34,185		0.785	76,449	1.755
Zone 3 (100-year)	4.30		250.9	137.5	34,495		0.792	79,883	1.834
	4.40		251.7	138.3	34,806		0.799	83,348	1.913
	4.50		252.5	139.1	35,119		0.806	86,844	1.994
	4.60		253.3	139.9	35,433		0.813	90,372	2.075
	4.70		254.1	140.7	35,748		0.821	93,931	2.156
	4.80		254.9	141.5	36,065		0.828	97,521	2.239
	4.90		255.7	142.3	36,382		0.835	101,144	2.322
	5.00		256.5	143.1	36,701		0.843	104,798	2.406
	5.02		256.6	143.3	36,765		0.844	105,533	2.423
	5.10		257.3	143.9	37,022		0.850	108,484	2.490
Zone 4 (100-year)	5.20		258.1	144.7	37,343		0.857	112,202	2.576
	5.30		258.9	145.5	37,666		0.865	115,953	2.662
	5.40		259.7	146.3	37,990		0.872	119,735	2.749
	5.50		260.5	147.1	38,316		0.880	123,551	2.836
	5.60		261.3	147.9	38,642		0.887	127,399	2.925
	5.70		262.1	148.7	38,970		0.895	131,279	3.014
	5.80		262.9	149.5	39,299		0.902	135,193	3.104
	5.90		263.7	150.3	39,630		0.910	139,139	3.194
	6.00		264.5	151.1	39,962		0.917	143,119	3.286
	6.10		265.3	151.9	40,295		0.925	147,132	3.378
Zone 5 (100-year)	6.20		266.1	152.7	40,629		0.933	151,178	3.471
	6.30		266.9	153.5	40,965		0.940	155,257	3.564
	6.40		267.7	154.3	41,302		0.948	159,371	3.659
	6.50		268.5	155.1	41,640		0.956	163,518	3.754
	6.60		269.3	155.9	41,980		0.964	167,699	3.850
	6.70		270.1	156.7	42,320		0.972	171,914	3.947
	6.80		270.9	157.5	42,662		0.979	176,163	4.044
	6.90		271.7	158.3	43,006		0.987	180,446	4.142
	7.00		272.5	159.1	43,350		0.995	184,764	4.242
	7.10		273.3	159.9	43,696		1.003	189,116	4.342
Zone 6 (100-year)	7.20		274.1	160.7	44,043		1.011	193,503	4.442
	7.30		274.9	161.5	44,392		1.019	197,925	4.544
	7.40		275.7	162.3	44,742		1.027	202,382	4.646
	7.50		276.5	163.1	45,093		1.035	206,874	4.749
	7.60		277.3	163.9	45,445		1.043	211,400	4.853
	7.70		278.1	164.7	45,799		1.051	215,963	4.958
	7.80		278.9	165.5	46,153		1.060	220,560	5.063
	7.90		279.7	166.3	46,509		1.068	225,193	5.170
	8.00		280.5	167.1	46,867		1.076	229,862	5.277
	8.10		281.3	167.9	47,226		1.084	234,567	5.385
Zone 7 (100-year)	8.20		282.1	168.7	47,586		1.092	239,307	5.494
	8.30		282.9	169.5	47,947		1.101	244,084	5.603
	8.40		283.7	170.3	48,309		1.109	248,897	5.714
	8.50		284.5	171.1	48,673		1.117	253,746	5.825
	8.60		285.3	171.9	49,038		1.126	258,631	5.937
	8.70		286.1	172.7	49,405		1.134	263,554	6.050
	8.80		286.9	173.5	49,772		1.143	268,512	6.164
	8.90		287.7	174.3	50,141		1.151	273,508	6.279
	9.00		288.5	175.1	50,511		1.160	278,541	6.394
	9.10		289.3	175.9	50,883		1.168	283,610	6.511
Zone 8 (100-year)	9.20		290.1	176.7	51,256		1.177	288,717	6.628
	9.30		290.9	177.5	51,630		1.185	293,862	6.746
	9.40		291.7	178.3	52,005		1.194	299,043	6.865
	9.50		292.5	179.1	52,382		1.203	304,263	6.985
	9.60		293.3	179.9	52,760		1.211	309,520	7.106
	9.70		294.1	180.7	53,139		1.220	314,815	7.227
	9.80		294.9	181.5	53,519		1.229	320,147	7.350
	9.90		295.7	182.3	53,901		1.237	325,518	7.473


DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.03 (May 2020)

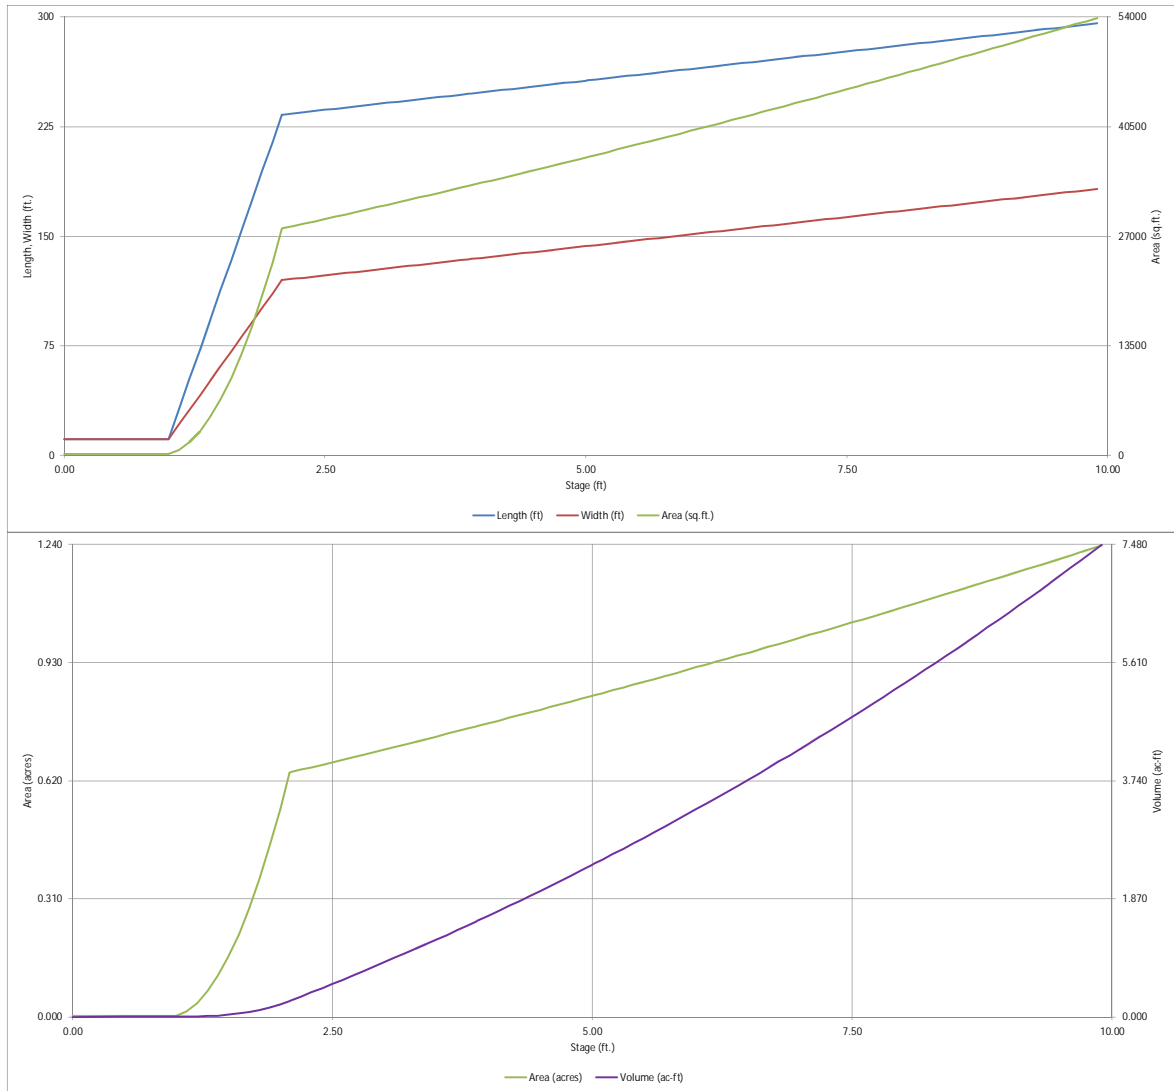


Inlet calculations not checked

Version 4.05 Released March 2017

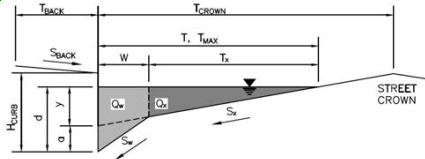ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm) (Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)					
Project:	Homestead North				
Inlet ID:	Inlet DP 4b				
					
Gutter Geometry (Enter data in the blue cells)					
Maximum Allowable Width for Spread Behind Curb	$T_{BACK} =$ <input type="text" value="9.5"/> ft				
Side Slope Behind Curb (leave blank for no conveyance credit behind curb)	$S_{BACK} =$ <input type="text" value="0.020"/> ft/ft				
Manning's Roughness Behind Curb (typically between 0.012 and 0.020)	$n_{BACK} =$ <input type="text" value="0.020"/>				
Height of Curb at Gutter Flow Line	$H_{CURB} =$ <input type="text" value="6.00"/> inches				
Distance from Curb Face to Street Crown	$T_{CROWN} =$ <input type="text" value="18.0"/> ft				
Gutter Width	$W =$ <input type="text" value="1.17"/> ft				
Street Transverse Slope	$S_x =$ <input type="text" value="0.020"/> ft/ft				
Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)	$S_w =$ <input type="text" value="0.083"/> ft/ft				
Street Longitudinal Slope - Enter 0 for sump condition	$S_o =$ <input type="text" value="0.016"/> ft/ft				
Manning's Roughness for Street Section (typically between 0.012 and 0.020)	$n_{STREET} =$ <input type="text" value="0.016"/>				
Max. Allowable Spread for Minor & Major Storm	<table style="width: 100%; border-collapse: collapse;"> <tr> <th style="width: 50%; text-align: center;">Minor Storm</th> <th style="width: 50%; text-align: center;">Major Storm</th> </tr> <tr> <td style="border: 1px solid black; text-align: center;">$T_{MAX} =$ <input type="text" value="18.0"/></td> <td style="border: 1px solid black; text-align: center;"><input type="text" value="18.0"/> ft</td> </tr> </table>	Minor Storm	Major Storm	$T_{MAX} =$ <input type="text" value="18.0"/>	<input type="text" value="18.0"/> ft
Minor Storm	Major Storm				
$T_{MAX} =$ <input type="text" value="18.0"/>	<input type="text" value="18.0"/> ft				
Max. Allowable Depth at Gutter Flowline for Minor & Major Storm	<table style="width: 100%; border-collapse: collapse;"> <tr> <th style="width: 50%; text-align: center;">Minor Storm</th> <th style="width: 50%; text-align: center;">Major Storm</th> </tr> <tr> <td style="border: 1px solid black; text-align: center;">$d_{MAX} =$ <input type="text" value="6.0"/></td> <td style="border: 1px solid black; text-align: center;"><input type="text" value="8.0"/> inches</td> </tr> </table>	Minor Storm	Major Storm	$d_{MAX} =$ <input type="text" value="6.0"/>	<input type="text" value="8.0"/> inches
Minor Storm	Major Storm				
$d_{MAX} =$ <input type="text" value="6.0"/>	<input type="text" value="8.0"/> inches				
Allow Flow Depth at Street Crown (leave blank for no)	<div style="display: flex; align-items: center; gap: 10px;"> <input type="checkbox"/> <input checked="" type="checkbox"/> check = yes </div>				
MINOR STORM Allowable Capacity is based on Spread Criterion MAJOR STORM Allowable Capacity is based on Depth Criterion					
<table style="width: 100%; border-collapse: collapse;"> <tr> <th style="width: 50%; text-align: center;">Minor Storm</th> <th style="width: 50%; text-align: center;">Major Storm</th> </tr> <tr> <td style="border: 1px solid black; text-align: center;">$Q_{allow} =$ <input type="text" value="15.0"/></td> <td style="border: 1px solid black; text-align: center;"><input type="text" value="52.4"/> cfs</td> </tr> </table>		Minor Storm	Major Storm	$Q_{allow} =$ <input type="text" value="15.0"/>	<input type="text" value="52.4"/> cfs
Minor Storm	Major Storm				
$Q_{allow} =$ <input type="text" value="15.0"/>	<input type="text" value="52.4"/> cfs				
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management' Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'					

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

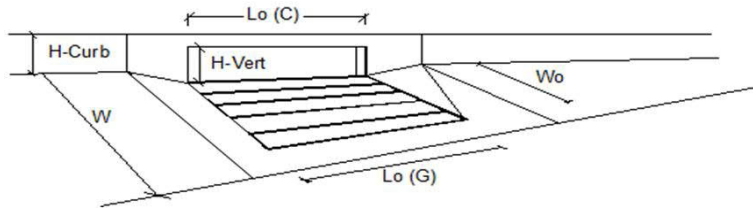

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	3	3	
Length of a Single Unit Inlet (Grate or Curb Opening)		L_o =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_o =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_r G$ =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_r C$ =	0.10	0.10	
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$			MINOR	MAJOR	
Total Inlet Interception Capacity		Q =	6.7	11.9	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.1	4.1	cfs
Capture Percentage = Q_s/Q_o =		$C\%$ =	99	74	%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 9b

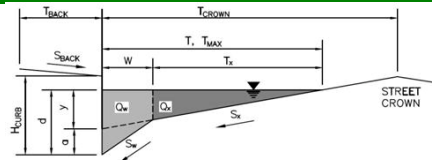**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.000$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm
$T_{MAX} =$	18.0	18.0
$d_{MAX} =$	6.0	8.0

inches


$Q_{allow} =$

	Minor Storm	Major Storm
	SUMP	SUMP

cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

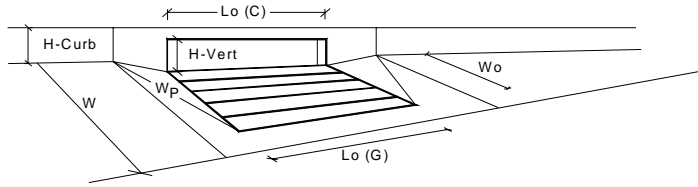

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a _{local} =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	3	3	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	5.8	12.0	inches
Grate Information			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L _o (G) =	N/A	N/A	feet
Width of a Unit Grate		W _o =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A _{ratio} =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C _l (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C _w (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C _o (G) =	N/A	N/A	
Curb Opening Information			MINOR	MAJOR	
Length of a Unit Curb Opening		L _o (C) =	5.00	5.00	feet
Height of Vertical Curb Opening in Inches		H _{vert} =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H _{throat} =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W _p =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C _l (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C _w (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C _o (C) =	0.67	0.67	
Low Head Performance Reduction (Calculated)			MINOR	MAJOR	
Depth for Grate Midwidth		d _{Grate} =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d _{Curb} =	0.32	0.83	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF _{Combination} =	0.55	1.00	
Curb Opening Performance Reduction Factor for Long Inlets		RF _{Curb} =	0.78	1.00	
Grated Inlet Performance Reduction Factor for Long Inlets		RF _{Grate} =	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)			MINOR	MAJOR	
		Q _a =	12.5	39.1	cfs
WARNING: Inlet Capacity less than Q Peak for Minor Storm		Q _{PEAK REQUIRED} =	12.5	30.9	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 7b

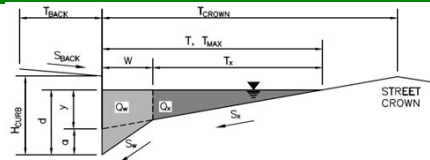**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.016$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input checked="" type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	15.0	52.3	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

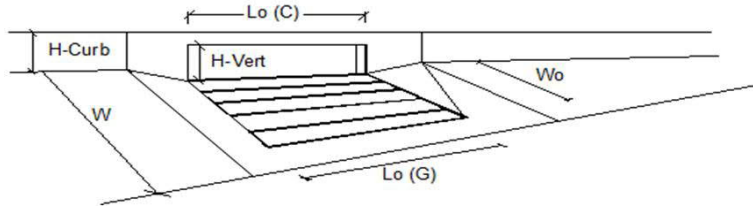

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a _{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	3	3	
Length of a Single Unit Inlet (Grate or Curb Opening)		L _o =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W _o =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		C _T G =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		C _T C =	0.10	0.10	
Street Hydraulics: OK - Q < Allowable Street Capacity			MINOR	MAJOR	
Total Inlet Interception Capacity		Q =	7.0	11.3	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q _b =	0.1	3.2	cfs
Capture Percentage = Q _i /Q _o =		C% =	98	78	%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 10b

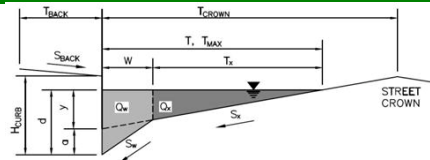**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.000$ ft/ft
 $n_{STREET} = 0.016$


	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches

☐ ☐

	Minor Storm	Major Storm	
$Q_{allow} =$	SUMP	SUMP	cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

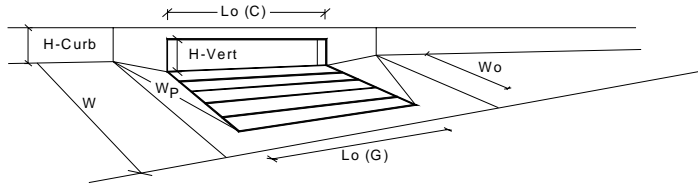

Design Information (Input)		MINOR		MAJOR		
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening			
Local Depression (additional to continuous gutter depression 'a' from above)		a _{local} =	3.00	3.00	inches	
Number of Unit Inlets (Grate or Curb Opening)		No =	3	3		
Water Depth at Flowline (outside of local depression)		Ponding Depth =	5.8	8.0	inches	
Grate Information			MINOR	MAJOR		<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L _o (G) =	N/A	N/A	feet	
Width of a Unit Grate		W _o =	N/A	N/A	feet	
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A _{ratio} =	N/A	N/A		
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C _l (G) =	N/A	N/A		
Grate Weir Coefficient (typical value 2.15 - 3.60)		C _w (G) =	N/A	N/A		
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C _o (G) =	N/A	N/A		
Curb Opening Information			MINOR	MAJOR		
Length of a Unit Curb Opening		L _o (C) =	5.00	5.00	feet	
Height of Vertical Curb Opening in Inches		H _{vert} =	6.00	6.00	inches	
Height of Curb Orifice Throat in Inches		H _{throat} =	6.00	6.00	inches	
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees	
Side Width for Depression Pan (typically the gutter width of 2 feet)		W _p =	2.00	2.00	feet	
Clogging Factor for a Single Curb Opening (typical value 0.10)		C _l (C) =	0.10	0.10		
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C _w (C) =	3.60	3.60		
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C _o (C) =	0.67	0.67		
Low Head Performance Reduction (Calculated)			MINOR	MAJOR		
Depth for Grate Midwidth		d _{grate} =	N/A	N/A	ft	
Depth for Curb Opening Weir Equation		d _{curb} =	0.32	0.50	ft	
Combination Inlet Performance Reduction Factor for Long Inlets		RF _{Combination} =	0.55	0.75		
Curb Opening Performance Reduction Factor for Long Inlets		RF _{Curb} =	0.78	0.89		
Grated Inlet Performance Reduction Factor for Long Inlets		RF _{Grate} =	N/A	N/A		
Total Inlet Interception Capacity (assumes clogged condition)			MINOR	MAJOR		
		Q _a =	12.5	27.9	cfs	
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q _{PEAK REQUIRED} =	5.0	12.5	cfs	

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 2.3C

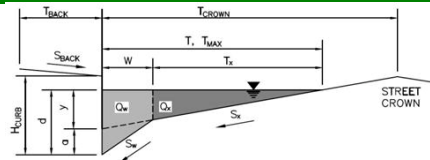**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.027$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	24.2	44.5	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

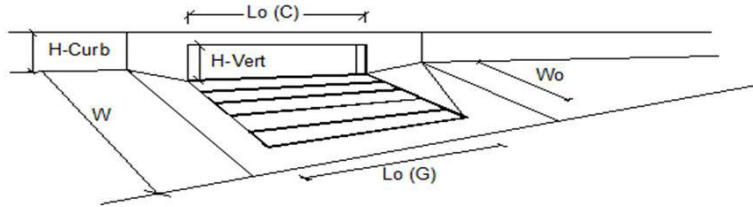

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a _{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	3	3	
Length of a Single Unit Inlet (Grate or Curb Opening)		L _o =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W _o =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		C _T G =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		C _T C =	0.10	0.10	
Street Hydraulics: OK - Q < Allowable Street Capacity			MINOR	MAJOR	
Total Inlet Interception Capacity		Q =	7.2	11.6	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q _b =	0.1	3.6	cfs
Capture Percentage = Q _i /Q _o =		C% =	98	76	%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 2.1C

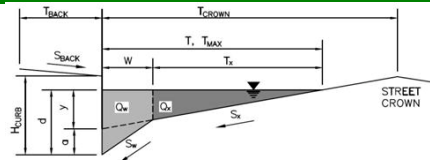**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 7.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.020$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	16.7	16.7	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

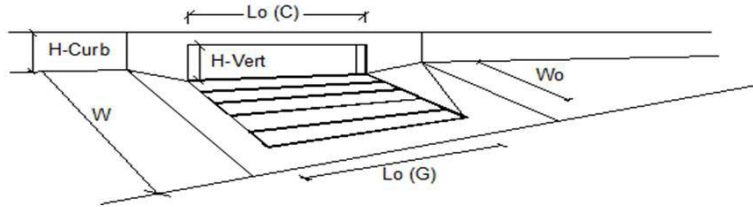

Design Information (Input)	CDOT Type R Curb Opening	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0 3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	1 1
Length of a Single Unit Inlet (Grate or Curb Opening)		L_o =	5.00 5.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_o =	N/A N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_r G$ =	N/A N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_r C$ =	0.10 0.10
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$		MINOR	MAJOR
Total Inlet Interception Capacity		Q =	0.8 1.5 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.0 0.1 cfs
Capture Percentage = Q_i/Q_o =		$C\%$ =	100 91 %

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 4.2C

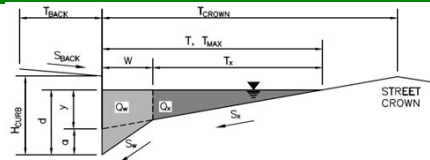**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 7.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.020$ ft/ft
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	16.7	16.7	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

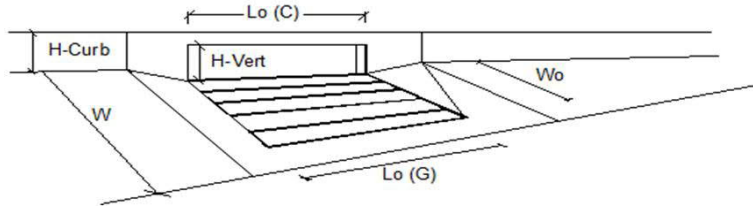

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)	3	3
Length of a Single Unit Inlet (Grate or Curb Opening)	5.00	5.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$		
Total Inlet Interception Capacity	4.4	8.6 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	0.0	0.7 cfs
Capture Percentage = Q_i/Q_o =	100	92 %

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 3.1C

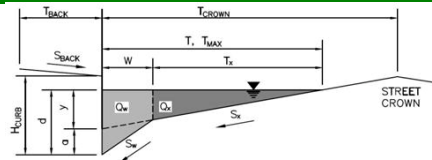**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 2.000$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	6.7	12.3	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

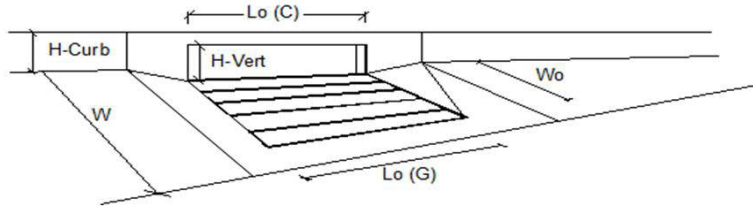

Design Information (Input)	CDOT Type R Curb Opening	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0 3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	1 1
Length of a Single Unit Inlet (Grate or Curb Opening)		L_o =	5.00 5.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_o =	N/A N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_F G$ =	N/A N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_F C$ =	0.10 0.10
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$		MINOR	MAJOR
Total Inlet Interception Capacity		Q =	1.3 2.0 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.0 0.6 cfs
Capture Percentage = Q_i/Q_o =		$C\%$ =	97 79 %

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 4C

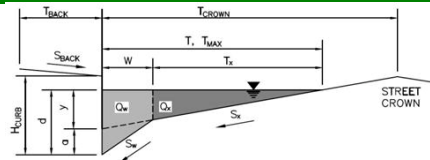**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_X = 0.020$ ft/ft
 $S_W = 0.083$ ft/ft
 $S_O = 0.000$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm
$T_{MAX} =$	18.0	18.0
$d_{MAX} =$	6.0	8.3

☐ ☐


$Q_{allow} =$

	Minor Storm	Major Storm
	SUMP	SUMP

cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

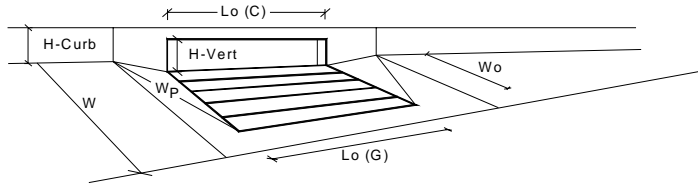

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a _{local} =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	4	4	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	6.0	8.3	inches
Grate Information			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L _o (G) =	N/A	N/A	feet
Width of a Unit Grate		W _o =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A _{ratio} =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C _l (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C _w (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C _o (G) =	N/A	N/A	
Curb Opening Information			MINOR	MAJOR	
Length of a Unit Curb Opening		L _o (C) =	5.00	5.00	feet
Height of Vertical Curb Opening in Inches		H _{vert} =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H _{throat} =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W _p =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C _l (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C _w (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C _o (C) =	0.67	0.67	
Low Head Performance Reduction (Calculated)			MINOR	MAJOR	
Depth for Grate Midwidth		d _{Grate} =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d _{Curb} =	0.33	0.53	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF _{Combination} =	0.57	0.78	
Curb Opening Performance Reduction Factor for Long Inlets		RF _{Curb} =	0.79	0.91	
Grated Inlet Performance Reduction Factor for Long Inlets		RF _{Grate} =	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)			MINOR	MAJOR	
		Q _a =	18.2	39.7	cfs
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q _{PEAK REQUIRED} =	16.9	35.5	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 5C

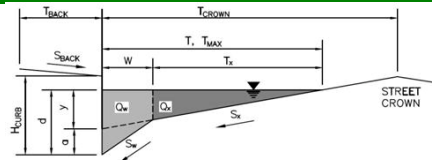**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_X = 0.020$ ft/ft
 $S_W = 0.083$ ft/ft
 $S_O = 0.000$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm
$T_{MAX} =$	18.0	18.0
$d_{MAX} =$	6.0	8.3

inches


$Q_{allow} =$

	Minor Storm	Major Storm
	SUMP	SUMP

cfs

INLET IN A SUMP OR SAG LOCATION


Version 4.05 Released March 2017

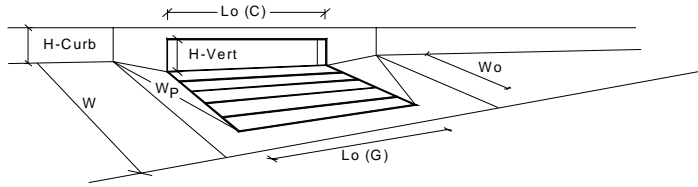

Design Information (Input)		MINOR		MAJOR		
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening			
Local Depression (additional to continuous gutter depression 'a' from above)		a _{local} =	3.00	3.00	inches	
Number of Unit Inlets (Grate or Curb Opening)		No =	2	2		
Water Depth at Flowline (outside of local depression)		Ponding Depth =	5.8	5.8	inches	
Grate Information			MINOR	MAJOR		Override Depths
Length of a Unit Grate		L _o (G) =	N/A	N/A	feet	
Width of a Unit Grate		W _o =	N/A	N/A	feet	
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A _{ratio} =	N/A	N/A		
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C _l (G) =	N/A	N/A		
Grate Weir Coefficient (typical value 2.15 - 3.60)		C _w (G) =	N/A	N/A		
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C _o (G) =	N/A	N/A		
Curb Opening Information			MINOR	MAJOR		
Length of a Unit Curb Opening		L _o (C) =	5.00	5.00	feet	
Height of Vertical Curb Opening in Inches		H _{vert} =	6.00	6.00	inches	
Height of Curb Orifice Throat in Inches		H _{throat} =	6.00	6.00	inches	
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees	
Side Width for Depression Pan (typically the gutter width of 2 feet)		W _p =	2.00	2.00	feet	
Clogging Factor for a Single Curb Opening (typical value 0.10)		C _l (C) =	0.10	0.10		
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C _w (C) =	3.60	3.60		
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C _o (C) =	0.67	0.67		
Low Head Performance Reduction (Calculated)			MINOR	MAJOR		
Depth for Grate Midwidth		d _{grate} =	N/A	N/A	ft	
Depth for Curb Opening Weir Equation		d _{curb} =	0.32	0.32	ft	
Combination Inlet Performance Reduction Factor for Long Inlets		RF _{Combination} =	0.55	0.55		
Curb Opening Performance Reduction Factor for Long Inlets		RF _{Curb} =	0.92	0.92		
Grated Inlet Performance Reduction Factor for Long Inlets		RF _{Grate} =	N/A	N/A		
Total Inlet Interception Capacity (assumes clogged condition)			MINOR	MAJOR		
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q _a =	9.7	9.7	cfs	
		Q _{PEAK REQUIRED} =	4.2	9.0	cfs	

DESIGN PEAK FLOW FOR SWALE OR ONE-HALF OF STREET BY THE RATIONAL METHOD

Project: Homestead North

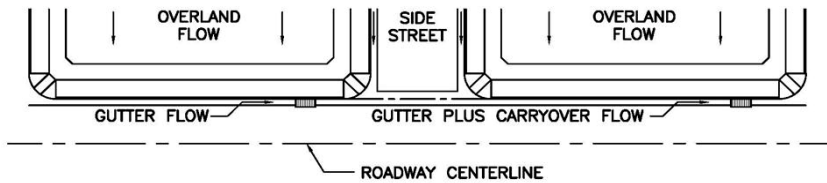

Show Details

Design Flow: ONLY if already determined through other methods: (local peak flow for 1/2 of street OR grass-lined channel):		Minor Storm Major Storm	* Q_{known} = <input type="text"/> <input type="text"/> cfs	<--- FILL IN THIS SECTION OR... FILL IN THE SECTIONS BELOW. <---
* If you enter flows in Row 14, select "Street Inlet" or "Area Inlet" button and then skip the rest of this sheet and click "Add New Inlet" at bottom of sheet.				
Geographic Information: (Enter data in the blue cells):				
Site Type: <input checked="" type="radio"/> Site is Urban <input type="radio"/> Site is Rural	Flows Developed For: <input checked="" type="radio"/> Street Inlet <input type="radio"/> Area Inlet in a Swale	Subcatchment Area = <input type="text"/> Acres Percent Imperviousness = <input type="text"/> % NRCS Soil Type = <input type="text"/> A, B, C, or D		
		Slope (ft/ft) Length (ft) Overland Flow = <input type="text"/> <input type="text"/> Gutter Flow = <input type="text"/> <input type="text"/>		
Rainfall Information: Intensity I (inch/hr) = $C_1 \cdot P_1 / (C_2 + I_c) \wedge C_3$				
		Minor Storm Major Storm		
		Design Storm Return Period, T_r = <input type="text"/> <input type="text"/> years Return Period One-Hour Precipitation, P_1 = <input type="text"/> <input type="text"/> inches C_1 = <input type="text"/> <input type="text"/> C_2 = <input type="text"/> <input type="text"/> C_3 = <input type="text"/> <input type="text"/> User-Defined Storm Runoff Coefficient (leave this blank to accept a calculated value), C = <input type="text"/> <input type="text"/> User-Defined 5-yr. Runoff Coefficient (leave this blank to accept a calculated value), C_5 = <input type="text"/> <input type="text"/> Bypass (Carry-Over) Flow from upstream Subcatchments, Q_b = <input type="text"/> <input type="text"/> cfs		
		Total Design Peak Flow, Q = <input type="text"/> <input type="text"/> cfs		

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Street at DP 5A

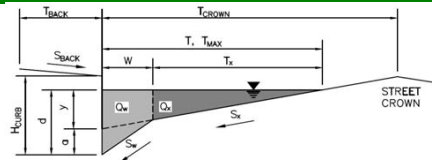**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.002$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.028$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.3	inches
	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	34.9	63.3	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

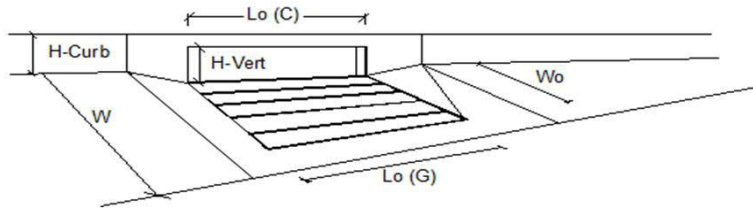

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type =		
Local Depression (additional to continuous gutter depression 'a')	a_{LOCAL} =		inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No =		
Length of a Single Unit Inlet (Grate or Curb Opening)	L_o =		ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)	W_o =		ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r G$ =		
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r C$ =		
Total Inlet Interception Capacity	Q =		cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	Q_b =		cfs
Capture Percentage = Q_a/Q_o =	C% =		%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet 1A

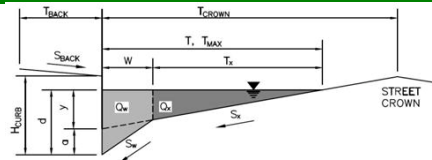**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_X = 0.020$ ft/ft
 $S_W = 0.083$ ft/ft
 $S_O = 0.028$ ft/ft
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM Allowable Capacity is based on Spread Criterion**


	Minor Storm	Major Storm	
$Q_{allow} =$	18.1	21.1	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

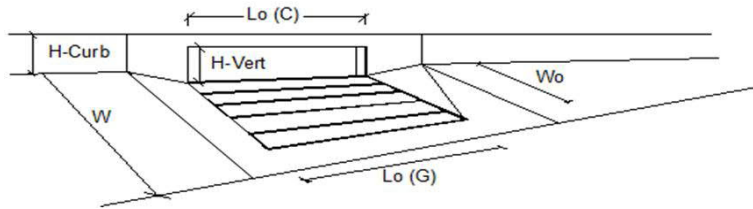

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0 inches
Total Number of Units in the Inlet (Grate or Curb Opening)	3	3
Length of a Single Unit Inlet (Grate or Curb Opening)	5.00	5.00 ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$	MINOR	MAJOR
Total Inlet Interception Capacity	7.1	12.0 cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	0.0	2.8 cfs
Capture Percentage = Q_i/Q_o =	100	81 %

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet 3A

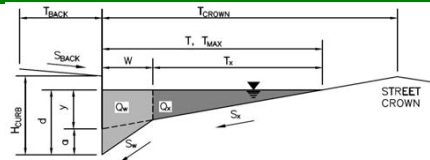**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.028$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	18.1	21.1	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE


Version 4.05 Released March 2017

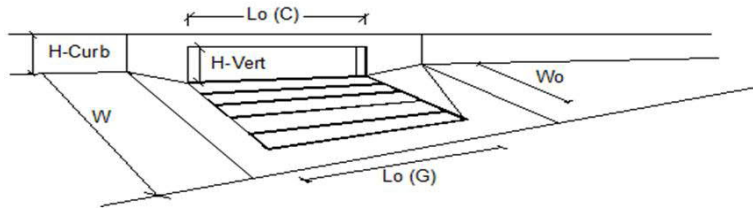

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0
Total Number of Units in the Inlet (Grate or Curb Opening)	3	3
Length of a Single Unit Inlet (Grate or Curb Opening)	5.00	5.00
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
Street Hydraulics: OK - Q < Allowable Street Capacity		
Total Inlet Interception Capacity	8.2	14.3
Total Inlet Carry-Over Flow (flow bypassing inlet)	0.2	6.1
Capture Percentage = Q_i/Q_o =	98	70

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

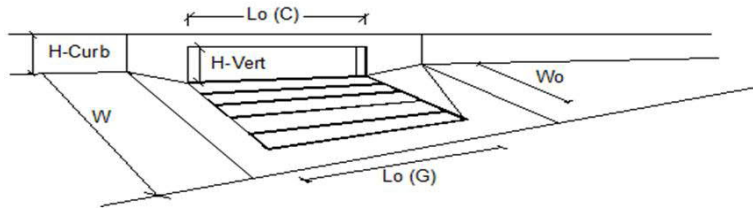

Design Information (Input)	MINOR	MAJOR	
Type of Inlet			
Local Depression (additional to continuous gutter depression 'a')			
Total Number of Units in the Inlet (Grate or Curb Opening)			
Length of a Single Unit Inlet (Grate or Curb Opening)			
Width of a Unit Grate (cannot be greater than W, Gutter Width)			
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)			
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)			
Total Inlet Interception Capacity			
Total Inlet Carry-Over Flow (flow bypassing inlet)			
Capture Percentage = Q_a/Q_o =			

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet 7A

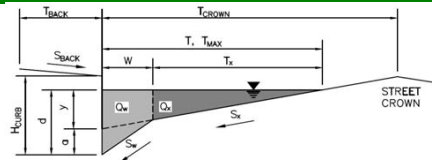**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} =$ 9.5 ft
 $S_{BACK} =$ 0.020 ft/ft
 $n_{BACK} =$ 0.016

$H_{CURB} =$ 6.00 inches
 $T_{CROWN} =$ 18.0 ft
 $W =$ 2.00 ft
 $S_X =$ 0.020 ft/ft
 $S_W =$ 0.083 ft/ft
 $S_O =$ 0.000 ft/ft
 $n_{STREET} =$ 0.016

	Minor Storm	Major Storm
$T_{MAX} =$	18.0	18.0
$d_{MAX} =$	6.0	8.0

inches


$Q_{allow} =$

Minor Storm	Major Storm
SUMP	SUMP

 cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

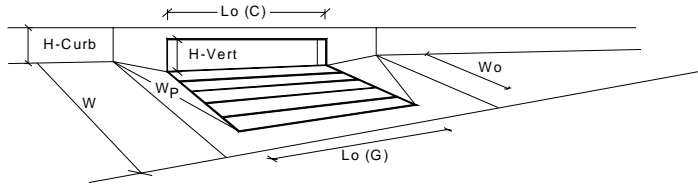

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a _{local} =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	4	4	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	6.0	8.3	inches
Grate Information			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L _o (G) =	N/A	N/A	feet
Width of a Unit Grate		W _o =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A _{ratio} =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C _l (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C _w (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C _o (G) =	N/A	N/A	
Curb Opening Information			MINOR	MAJOR	
Length of a Unit Curb Opening		L _o (C) =	5.00	5.00	feet
Height of Vertical Curb Opening in Inches		H _{vert} =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H _{throat} =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W _p =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C _l (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C _w (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C _o (C) =	0.67	0.67	
Low Head Performance Reduction (Calculated)			MINOR	MAJOR	
Depth for Grate Midwidth		d _{Grate} =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d _{Curb} =	0.33	0.53	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF _{Combination} =	0.57	0.78	
Curb Opening Performance Reduction Factor for Long Inlets		RF _{Curb} =	0.79	0.91	
Grated Inlet Performance Reduction Factor for Long Inlets		RF _{Grate} =	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)			MINOR	MAJOR	
		Q _a =	18.2	39.7	cfs
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q _{PEAK REQUIRED} =	10.5	29.7	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet 2A

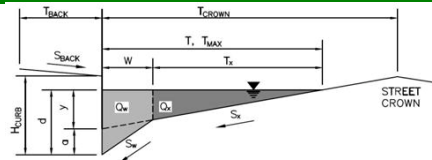**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.016$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.284$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	9.0	18.6	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

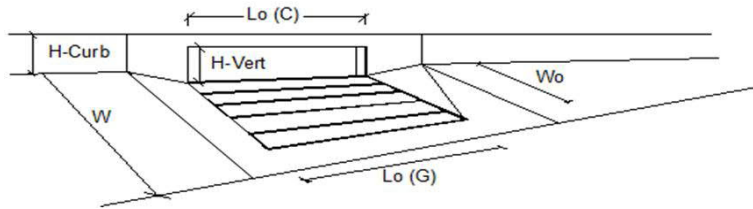

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0
Total Number of Units in the Inlet (Grate or Curb Opening)	3	3
Length of a Single Unit Inlet (Grate or Curb Opening)	5.00	5.00
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
Street Hydraulics: OK - Q < Allowable Street Capacity		
Total Inlet Interception Capacity	6.4	11.5
Total Inlet Carry-Over Flow (flow bypassing inlet)	0.0	1.7
Capture Percentage = Q_i/Q_o =	100	87

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet 4A

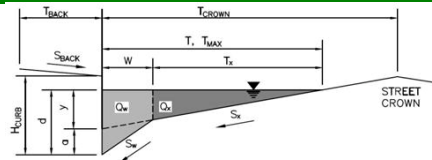**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.028$ ft/ft
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM Allowable Capacity is based on Spread Criterion**


	Minor Storm	Major Storm	
$Q_{allow} =$	18.1	21.0	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

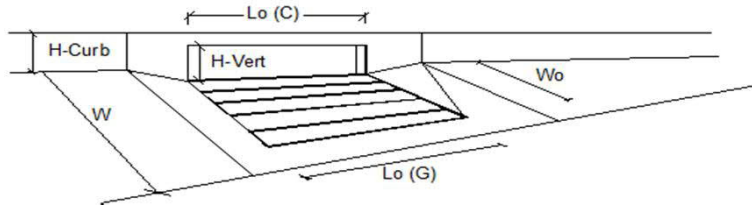

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		N_o =	3	3	
Length of a Single Unit Inlet (Grate or Curb Opening)		L_o =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_o =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_r G$ =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_r C$ =	0.10	0.10	
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$		MINOR		MAJOR	
Total Inlet Interception Capacity		Q =	7.0	12.6	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.0	3.6	cfs
Capture Percentage = $Q_o/Q_o =$		$C\%$ =	100	78	%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Street at DP 6A

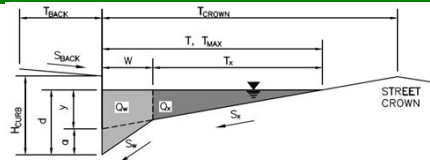**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.002$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.028$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	34.9	57.7	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

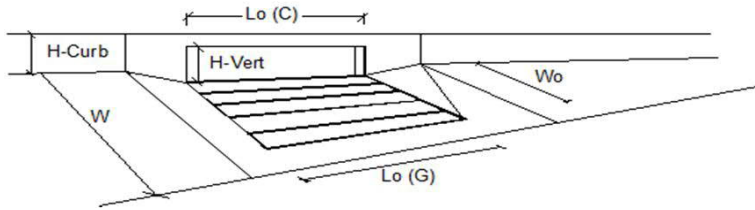

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	<input type="text"/>	Type =			
Local Depression (additional to continuous gutter depression 'a')		a _{LOCAL} =			inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =			
Length of a Single Unit Inlet (Grate or Curb Opening)		L _o =			ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W _o =			ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		C _r G =			
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		C _r C =			
Total Inlet Interception Capacity		MINOR		MAJOR	
		Q =			cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q _b =			cfs
Capture Percentage = Q _i /Q _o =		C% =			%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet 8A

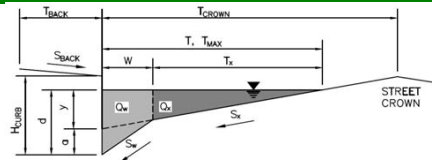**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM** Allowable Capacity is based on Depth Criterion

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.016$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 2.00$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.000$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm
$T_{MAX} =$	18.0	18.0
$d_{MAX} =$	6.0	12.0




$Q_{allow} =$

	Minor Storm	Major Storm
	SUMP	SUMP

cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

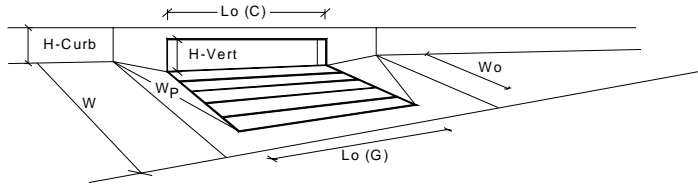

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a' from above)		a _{local} =	3.00	3.00	inches
Number of Unit Inlets (Grate or Curb Opening)		No =	3	3	
Water Depth at Flowline (outside of local depression)		Ponding Depth =	5.8	8.3	inches
Grate Information			MINOR	MAJOR	<input checked="" type="checkbox"/> Override Depths
Length of a Unit Grate		L _o (G) =	N/A	N/A	feet
Width of a Unit Grate		W _o =	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)		A _{ratio} =	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)		C _l (G) =	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)		C _w (G) =	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)		C _o (G) =	N/A	N/A	
Curb Opening Information			MINOR	MAJOR	
Length of a Unit Curb Opening		L _o (C) =	5.00	5.00	feet
Height of Vertical Curb Opening in Inches		H _{vert} =	6.00	6.00	inches
Height of Curb Orifice Throat in Inches		H _{throat} =	6.00	6.00	inches
Angle of Throat (see USDCM Figure ST-5)		Theta =	63.40	63.40	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)		W _p =	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)		C _l (C) =	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)		C _w (C) =	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)		C _o (C) =	0.67	0.67	
Low Head Performance Reduction (Calculated)			MINOR	MAJOR	
Depth for Grate Midwidth		d _{grate} =	N/A	N/A	ft
Depth for Curb Opening Weir Equation		d _{curb} =	0.32	0.53	ft
Combination Inlet Performance Reduction Factor for Long Inlets		RF _{Combination} =	0.55	0.78	
Curb Opening Performance Reduction Factor for Long Inlets		RF _{Curb} =	0.78	0.91	
Grated Inlet Performance Reduction Factor for Long Inlets		RF _{Grate} =	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)			MINOR	MAJOR	
		Q _a =	12.5	29.4	cfs
Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)		Q _{PEAK REQUIRED} =	11.3	19.9	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 1.1B

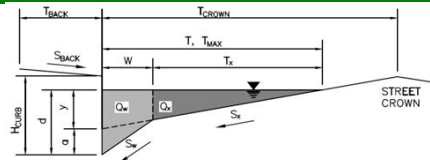**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.026$ ft/ft
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX} =$	18.0	18.0	ft
$d_{MAX} =$	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion**MAJOR STORM Allowable Capacity is based on Spread Criterion**


	Minor Storm	Major Storm	
$Q_{allow} =$	19.1	19.1	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

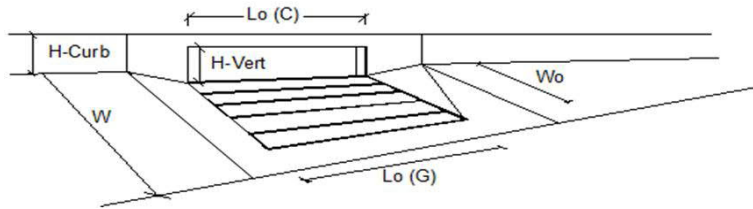

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		No =	3	3	
Length of a Single Unit Inlet (Grate or Curb Opening)		L_o =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_o =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		$C_F G$ =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		$C_F C$ =	0.10	0.10	
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$			MINOR	MAJOR	
Total Inlet Interception Capacity		Q =	5.3	9.6	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.0	1.5	cfs
Capture Percentage = Q_i/Q_o =		$C\%$ =	100	87	%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Homestead North

Inlet ID:

Inlet DP 1.2B

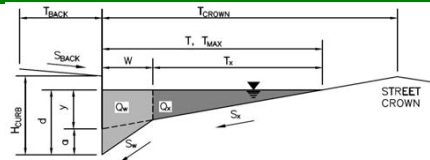**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 9.5$ ft
 $S_{BACK} = 0.020$ ft/ft
 $n_{BACK} = 0.020$

$H_{CURB} = 6.00$ inches
 $T_{CROWN} = 18.0$ ft
 $W = 1.17$ ft
 $S_x = 0.020$ ft/ft
 $S_w = 0.083$ ft/ft
 $S_o = 0.026$ ft/ft
 $n_{STREET} = 0.016$

	Minor Storm	Major Storm	
$T_{MAX} =$	9.5	18.0	ft
$d_{MAX} =$	6.0	8.3	inches
	<input type="checkbox"/>	<input type="checkbox"/>	check = yes

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm	
$Q_{allow} =$	3.7	19.1	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

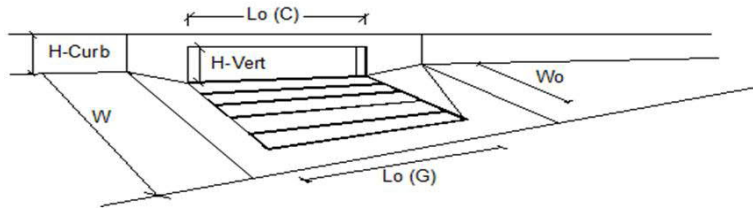

Design Information (Input)	MINOR	MAJOR
Type of Inlet	CDOT Type R Curb Opening	
Local Depression (additional to continuous gutter depression 'a')	3.0	3.0
Total Number of Units in the Inlet (Grate or Curb Opening)	3	3
Length of a Single Unit Inlet (Grate or Curb Opening)	5.00	5.00
Width of a Unit Grate (cannot be greater than W, Gutter Width)	N/A	N/A
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	N/A	N/A
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	0.10	0.10
Street Hydraulics: OK - Q < Allowable Street Capacity		
Total Inlet Interception Capacity	3.6	7.4
Total Inlet Carry-Over Flow (flow bypassing inlet)	0.0	0.2
Capture Percentage = Q_i/Q_o =	100	97

Appendix D

Drainage Maps

Provide existing drainage plan

JR RESPONSE: Existing drainage map
provided



DRAINAGE MAP

JR RESPONSE: Vollmer Road is going to be re-designed to convey offsite runoff. This runoff will not be detained and runoff will outfall directly into the Sand Creek Tributary as shown in the Sterling Ranch MDDP by M&S Engineering dated 2018. The basins adjacent to Vollmer road have been re - delineated to border the R.O.W of Vollmer road. The runoff from Vollmer will not affect the site.

JR RESPONSE: Yes, a ditch will be placed here

JR RESPONSE: This runoff will drain adjacent to Vollmer Road.

If a ditch is being created here provide design

Label culvert and address where flows are going

Show proposed road improvements tying in to existing

JR RESPONSE: Tie in information is now shown in the Drainage map

Show all offsite contributing basins and flows.

JR RESPONSE: Retaining wall is going to be placed here

adjust overlapping text

JR RESPONSE: ADDED

provide overflow route

JR RESPONSE: CHANNEL IMPROVEMENTS SHOWN. IMPROVEMENTS ARE BEING DESIGNED BY KIOWA

Show and label channel improvements or provide a separate plan with that information

JR RESPONSE: Retreat at Timber-ridge Filing 1 is anticipated to be build before the northern half of Homestead North. The line work for Retreat is now shown on the grading plans

contours don't match / missing?

JR RESPONSE: Design point shown on plan w/ runoff from M&S masterplan

JR RESPONSE: GRADING REVISED

is cutting on purpose?


JR RESPONSE: GRADING REVISED

JR RESPONSE: Yes, a wall is going to be built here

Is this slope too steep?

LEGEND

BASIN ID
A: BASIN LABEL
B: AREA
C: C -100 YR
D: C-5 YR



DESIGN POINT

PROPOSED FLOW DIRECTION




BASIN DRAINAGE AREA




EXISTING STORM SEWER




STORM SEWER PROPOSED



PROPOSED R.O.W




PROPOSED PROPERTY LINES




PROPOSED SIDEWALK



EXISTING PROPERTY LINE



ROW EXISTING




FL EXISTING



SIDEWALK EXISTING



DRAINAGE ACCESS & MAINTENANCE EASEMENT



EXISTING

PROPOSED

BASIN SUMMARY TABLE

Tributary Sub-basin	Area (acres)	Percent Impervious	C _s	C ₁₀₀	t _c (min)	Q _s (cfs)	Q ₁₀₀ (cfs)
A1	3.51	56%	0.54	0.67	12.8	7.1	14.8
A2	3.18	57%	0.54	0.67	13.5	6.4	13.2
A3	4.58	53%	0.52	0.65	13.4	8.7	18.3
A4	3.82	54%	0.53	0.66	14.0	7.3	15.2
A5	5.46	51%	0.50	0.63	10.9	10.8	23.1
A6	3.91	53%	0.51	0.64	12.6	7.6	16.0
A7	1.87	14%	0.18	0.43	16.6	1.1	4.5
A8	0.42	62%	0.58	0.72	5.0	1.2	2.6
A9	2.97	17%	0.21	0.43	13.3	2.3	7.9
B1.1	2.71	52%	0.51	0.64	12.4	5.3	11.1
B1.2	1.87	53%	0.51	0.65	12.9	3.6	7.6
B1.3	0.43	46%	0.45	0.62	8.2	0.8	2.0
B2	0.83	62%	0.58	0.71	5.0	2.5	5.1
B3	0.26	100%	0.90	0.96	5.0	1.2	2.2
B4	3.98	40%	0.41	0.57	9.5	6.8	16.0
B5	1.75	58%	0.56	0.68	7.7	4.4	9.0
B6	3.60	60%	0.57	0.70	6.5	9.8	20.2
B7	1.13	62%	0.59	0.71	8.7	2.9	5.8
B8	1.76	59%	0.56	0.69	9.2	4.2	8.6
B9	3.79	64%	0.50	0.64	13.2	7.0	15.0
B10	0.22	100%	0.90	0.96	5.0	1.0	1.8
B11	1.75	2%	0.08	0.35	17.3	0.5	3.4
C1	2.82	70%	0.52	0.65	13.0	5.5	11.5
C2.1	0.20	89%	0.81	0.89	5.0	0.8	1.6
C2.2	4.69	73%	0.56	0.68	12.8	9.9	20.3
C2.3	0.83	70%	0.57	0.69	9.8	2.0	4.1
C3.1	0.35	82%	0.75	0.85	5.0	1.3	2.6
C3.2	1.46	72%	0.56	0.68	8.4	3.6	7.4
C4.1	5.81	70%	0.52	0.65	12.7	11.5	23.9
C4.2	2.58	69%	0.50	0.64	16.7	4.4	9.3
C5	0.16						
C6	2.43						

Also provide design point summary table.

Include the entire preliminary plan boundary. Additional sheets at a closer scale are probably needed

JR RESPONSE: ADDRESS

AGE MAP

HOMESTEAD NORTH

JOB NO. 25188.00

06/25/20

SHEET 1 OF 2

100 50 0 100 200
ORIGINAL SCALE: 1" = 100'


J-R ENGINEERING
A Westrian Company

Centennial 303-740-9993 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com

DRAINAGE MAP

LEGEND

BASIN ID
A: BASIN LABEL
B: AREA
C: C-100 YR
D: C-5 YR



DESIGN POINT
PROPOSED FLOW DIRECTION



BASIN DRAINAGE AREA
EXISTING STORM SEWER
STORM SEWER PROPOSED
PROPOSED R.O.W
PROPOSED PROPERTY LINES
PROPOSED SIDEWALK
EXISTING PROPERTY LINE
ROW EXISTING
FL EXISTING
SIDEWALK EXISTING
DRAINAGE ACCESS & MAINTENANCE EASEMENT

EXISTING

PROPOSED

6100

6100

BASIN SUMMARY TABLE

Tributary Sub-basin	Area (acres)	Percent Impervious	C _s	C ₁₀₀	t _c (min)	Q ₆ (cfs)	Q ₁₀₀ (cfs)
A1	3.51	56%	0.54	0.67	12.8	7.1	14.8
A2	3.18	57%	0.54	0.67	13.5	6.4	13.2
A3	4.58	53%	0.52	0.65	13.4	8.7	18.3
A4	3.82	54%	0.53	0.66	14.0	7.3	15.2
A5	5.46	51%	0.50	0.63	10.9	10.8	23.1
A6	3.91	53%	0.51	0.64	12.6	7.6	16.0
A7	1.87	14%	0.18	0.43	16.6	1.1	4.5
A8	0.42	62%	0.58	0.72	5.0	1.2	2.6
A9	2.97	17%	0.21	0.43	13.3	2.3	7.9
B1.1	2.71	52%	0.51	0.64	12.4	5.3	11.1
B1.2	1.87	53%	0.51	0.65	12.9	3.6	7.6
B1.3	0.43	46%	0.45	0.62	8.2	0.8	2.0
B2	0.83	62%	0.58	0.71	5.0	2.5	5.1
B3	0.26	100%	0.90	0.96	5.0	1.2	2.2
B4	3.98	40%	0.41	0.57	9.5	6.8	16.0
B5	1.75	58%	0.56	0.68	7.7	4.4	9.0
B6	3.60	60%	0.57	0.70	6.5	9.8	20.2
B7	1.13	62%	0.59	0.71	8.7	2.9	5.8
B8	1.76	59%	0.56	0.69	9.2	4.2	8.6
B9	3.79	64%	0.50	0.64	13.2	7.0	15.0
B10	0.22	100%	0.90	0.96	5.0	1.0	1.8
B11	1.75	2%	0.08	0.35	17.3	0.5	3.4
C1	2.82	70%	0.52	0.65	13.0	5.5	11.5
C2.1	0.20	89%	0.81	0.89	5.0	0.8	1.6
C2.2	4.69	73%	0.56	0.68	12.8	9.9	20.3
C2.3	0.83	70%	0.57	0.69	9.8	2.0	4.1
C3.1	0.35	82%	0.75	0.85	5.0	1.3	2.6
C3.2	1.46	72%	0.56	0.68	8.4	3.6	7.4
C4.1	5.81	70%	0.52	0.65	12.7	11.5	23.9
C4.2	2.58	69%	0.50	0.64	16.7	4.4	9.3
C5	0.16	100%	0.90	0.96	5.0	0.7	1.3
C6	2.43	10%	0.13	0.38	5.0	1.6	8.1

DRAINAGE MAP
HOMESTEAD NORTH
JOB NO. 25188.00
06/25/20
SHEET 2 OF 2



Centennial 303-740-9393 Colorado Springs
719-593-2593 Fort Collins 970-491-9888
www.jrengineering.com

100 50 0 100 200
ORIGINAL SCALE: 1" = 100'

Label lots and tracts

JR RESPONSE: LOTS AND TRACTS ARE SHOWN FOR THE PHASE 1 OF THE SUBDIVISION. PHASE 2 WILL BE PLATTED LATER

JR RESPONSE: Vollmer Road is going to be re-designed to convey offsite runoff. This runoff will not be detained and runoff will outfall directly into the Sand Creek Tributary as shown in the Sterling Ranch MDDP by M&S Engineering dated 2018. The basins adjacent to Vollmer road have been re - delineated to border the R.O.W of Vollmer road. The runoff from Vollmer will not affect the site.

Label culvert and address where flows are going

JR RESPONSE: PROPOSED ROAD AND DRAINAGE IMPROVEMENTS ARE NOW SHOWN

Show all proposed road and drainage improvements

JR RESPONSE: ADDRESSED

JR RESPONSE: ADDRESSED

JR RESPONSE: ADDRESSED

JR RESPONSE: Wall is going to be added here

Show grading for the access road/trail

JR RESPONSE: GRADING HAS BEEN ADDED

Clearly show and label wetlands

JR RESPONSE: WETLANDS LABELED AND SHOWN ON PLANS

show maint. access roads to ponds

JR RESPONSE: ADDED

label outfall protection

JR RESPONSE: OUTFALL PROTECTION ADDED

Provide design point for channel

JR RESPONSE: DESIGN POINT ADDED

Address the existing drainageway that diverts flows to Sand Creek

JR RESPONSE: PROPOSED CULVERT DIVERTING FLOW INTO SAND CREEK BASIN NOW SHOWN

SEE SHEET 1


Appendix E

Reference Material

SAND CREEK DRAINAGE BASIN PLANNING STUDY

PRELIMINARY DESIGN REPORT

CITY OF COLORADO SPRINGS, EL PASO COUNTY, COLORADO

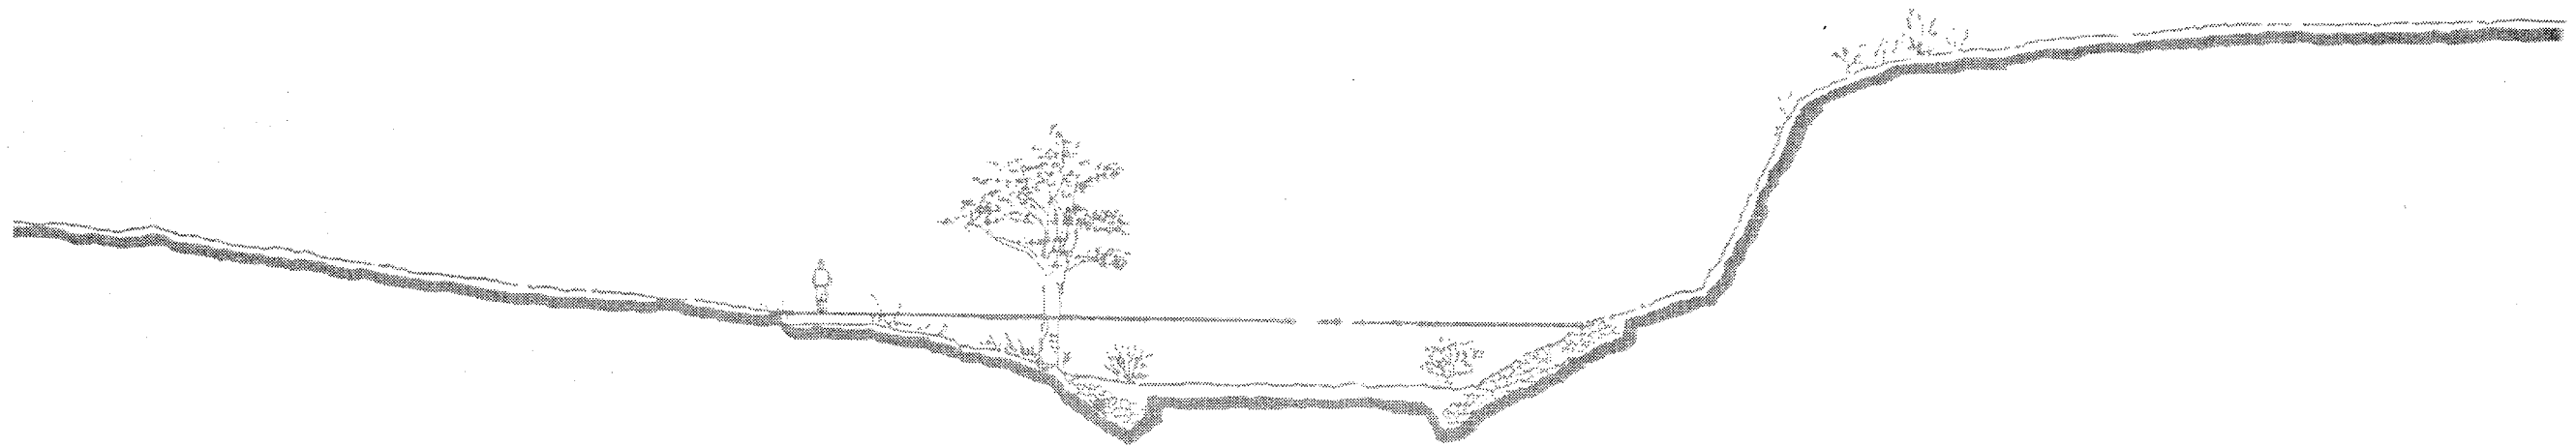

PREPARED FOR:

City of Colorado Springs
Department of Comprehensive Planning, Development and Finance
Engineering Division
30 S. Nevada
Colorado Springs, Colorado 80903

PREPARED BY:

Kiowa Engineering Corporation
1011 North Weber
Colorado Springs, CO 80903

II. STUDY AREA DESCRIPTION

The Sand Creek drainage basin is a left-bank tributary to the Fountain Creek lying in the west-central portions of El Paso County. Sand Creek's drainage area at Fountain Creek is approximately 54 square miles of which approximately 18.8 square miles are inside the City of Colorado Springs corporate limits. The basin is divided into five major sub-basins, the Sand Creek mainstem, the East Fork Sand Creek, the Central Tributary to East Fork, the West Fork, and the East Fork Subtributary. Figure II-1 shows the location of the Sand Creek basin.

Basin Description

The Sand Creek basin covers a total of 54 square miles in unincorporated El Paso County and Colorado Springs, Colorado. Of this total, approximately 28 square miles is encompassed by the Sand Creek basin, and 26 square miles for the East Fork Sand Creek basin. The basin trends in generally a south to southwesterly direction, entering the Fountain Creek approximately two miles upstream of the Academy Boulevard bridge over Fountain Creek. Two main tributaries drain the basin, those being the mainstem of Sand Creek and East Fork Sand Creek. Development presence is most evident along the mainstream. At this time, approximately 25 percent of the basin is developed. This alternative evaluation focuses upon the Sand Creek basin only.

The maximum basin elevation is approximately 7,620 feet above mean sea level, and falls to approximately 5,790 feet at the confluence with Fountain Creek. The headwaters of the basin originate in the conifer covered areas of The Black Forest. The middle eastern portions of the basin are typified by rolling range land with fair to good vegetative cover associated with semi-arid climates.

Climate

This area of El Paso County can be described, in general as high plains, with total precipitation amounts typical of a semi-arid region. Winters are generally cold and dry. Precipitation ranges from 14 to 16 inches per year, with the majority of this precipitation occurring in spring and summer in the form of rainfall. Thunderstorms are common during the summer months, and are typified by quick-moving low pressure cells which draw moisture from the Gulf of Mexico into the region. Average temperatures range from about 30°F in the winter

to 75° in the summer. The relative humidity ranges from about 25 percent in the summer to 45 percent in the winter.

Soils and Geology


Soils within the Sand Creek basin vary between soil types A through D, as identified by the U. S. Department of Agriculture, Soil Conservation Service. The predominant soil groupings are in the Truckton and Bresser soil associations. The soils consist of deep, well drained soils that formed in alluvium and residuum, derived from sedimentary rock. The soils have high to moderate infiltration rates, and are extremely susceptible to wind and water erosion where poor vegetation cover exists. In undeveloped areas, the predominance of Type A and B soils give this basin a lower runoff per unit area as compared to basins with soils dominated by Types C and D. Presented on Figure II-2 is the Hydrologic Soil distribution map for the Sand Creek basin.

Property Ownership and Impervious Land Densities

Property ownership along the major drainageway within the Sand Creek basin vary from public to private. Along the developed reaches, drainage right-of-ways and greenbelts have been dedicated during the development of the adjacent residential and commercial land. Where development has not occurred, the drainageways remain under private ownership with no delineated drainage right-of-way or easements. There are several public parks which abut the mainstem of Sand Creek. Roadway and utility easements abutting or crossing the major drainageways occur most frequently in the developed portions of the basin.

Land use information for the existing and future conditions were reviewed as part of the planning effort. This information is used in the hydrologic analysis to predict runoff rates and volumes for the purposes of facility evaluation. The identification of land uses abutting the drainageways is also useful in the identification of feasible plans for stabilization and aesthetic treatment of the creek. Presented on Figure II-3 is the proposed land use map used in the evaluation of impervious land densities discussed in the hydrologic section of this report. Figure II-3 is not intended to reflect the future zoning or land use policies of the City or the County.

The land use information within the Banning-Lewis Ranch property was obtained from Aries Properties during the time the draft East Fork Sand Creek Drainage Basin Planning Study was being prepared. The land use information was again reviewed with the City of Colorado Springs Department of Planning and was found to be appropriate for use in the estimation of hydrology for the East Fork Basin. The location of future arterial streets and roadways within

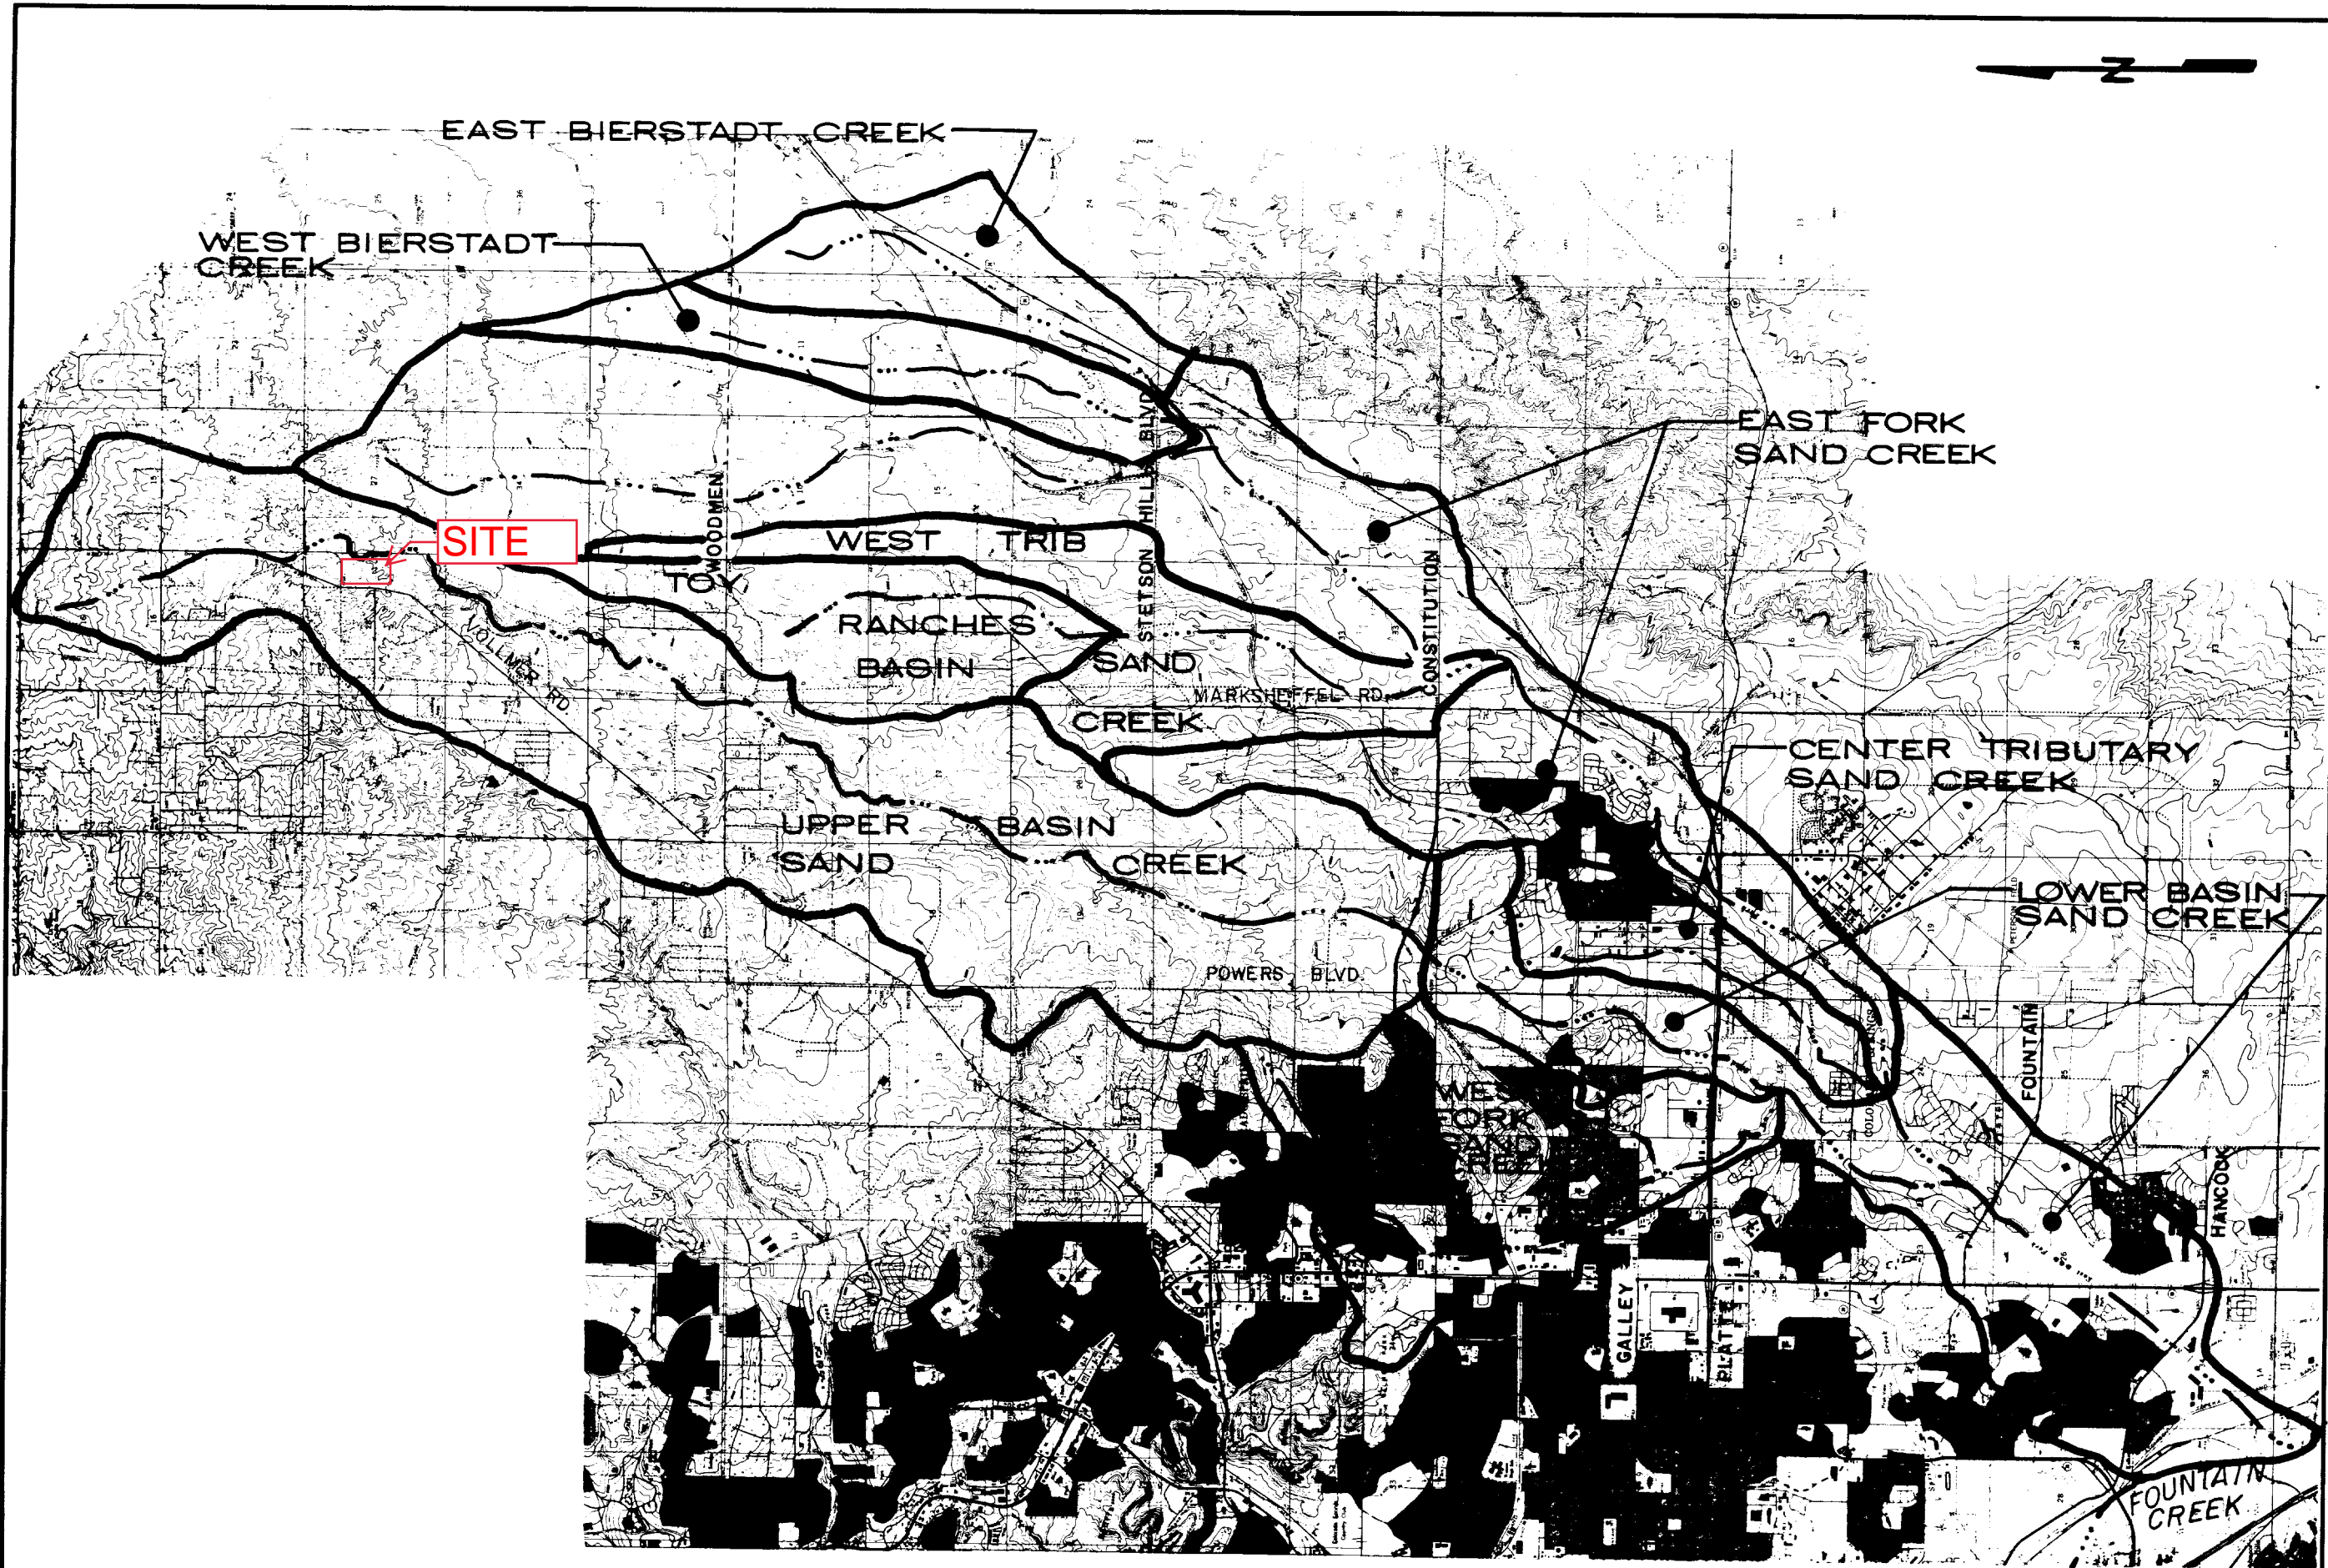


Kiowa Engineering Corporation
419 W. Bijou Street
Colorado Springs, Colorado
80905-1308

SAND CREEK DRAINAGE
BASIN PLANNING STUDY
REGIONAL SUB-BASINS


Project No	90-04-09
Date:	11/90
Design:	
Drawn:	EAK
Check:	
Revisions:	

PRELIMINARY DRAINAGE REPORT AND MDDP ADDENDUM FOR
HOMESTEAD NORTH AT STERLING RANCH

June 2020

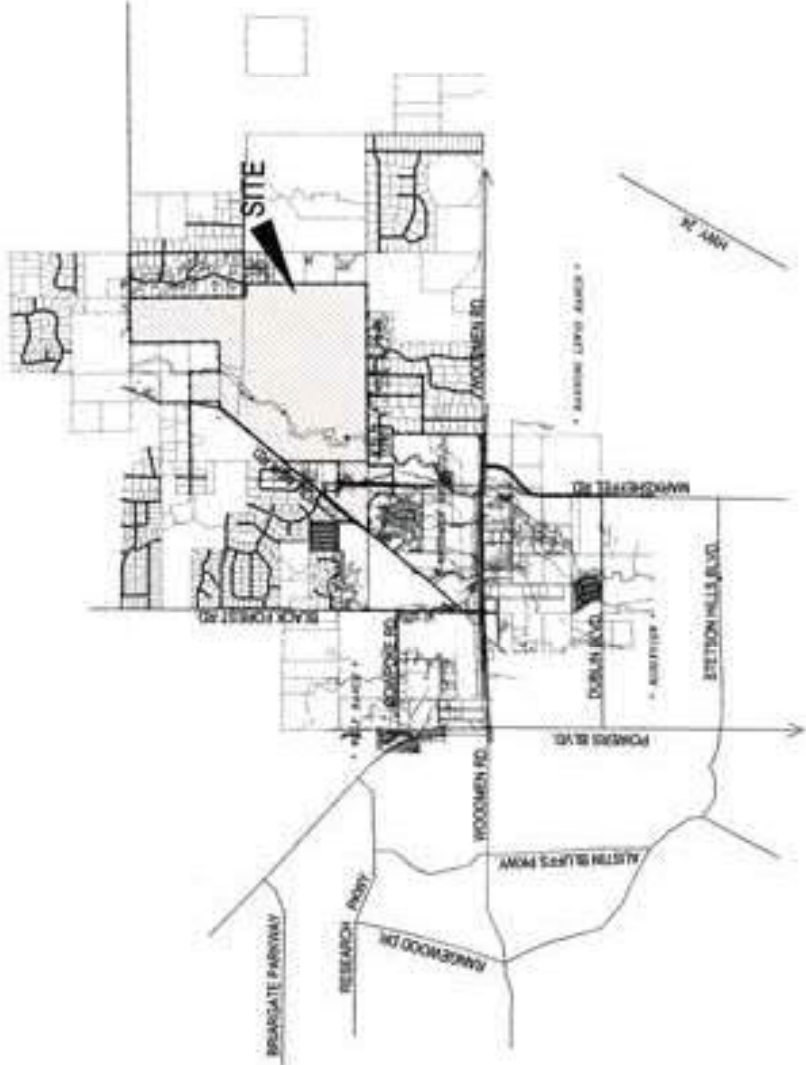

STERLING RANCH
N.T.S.

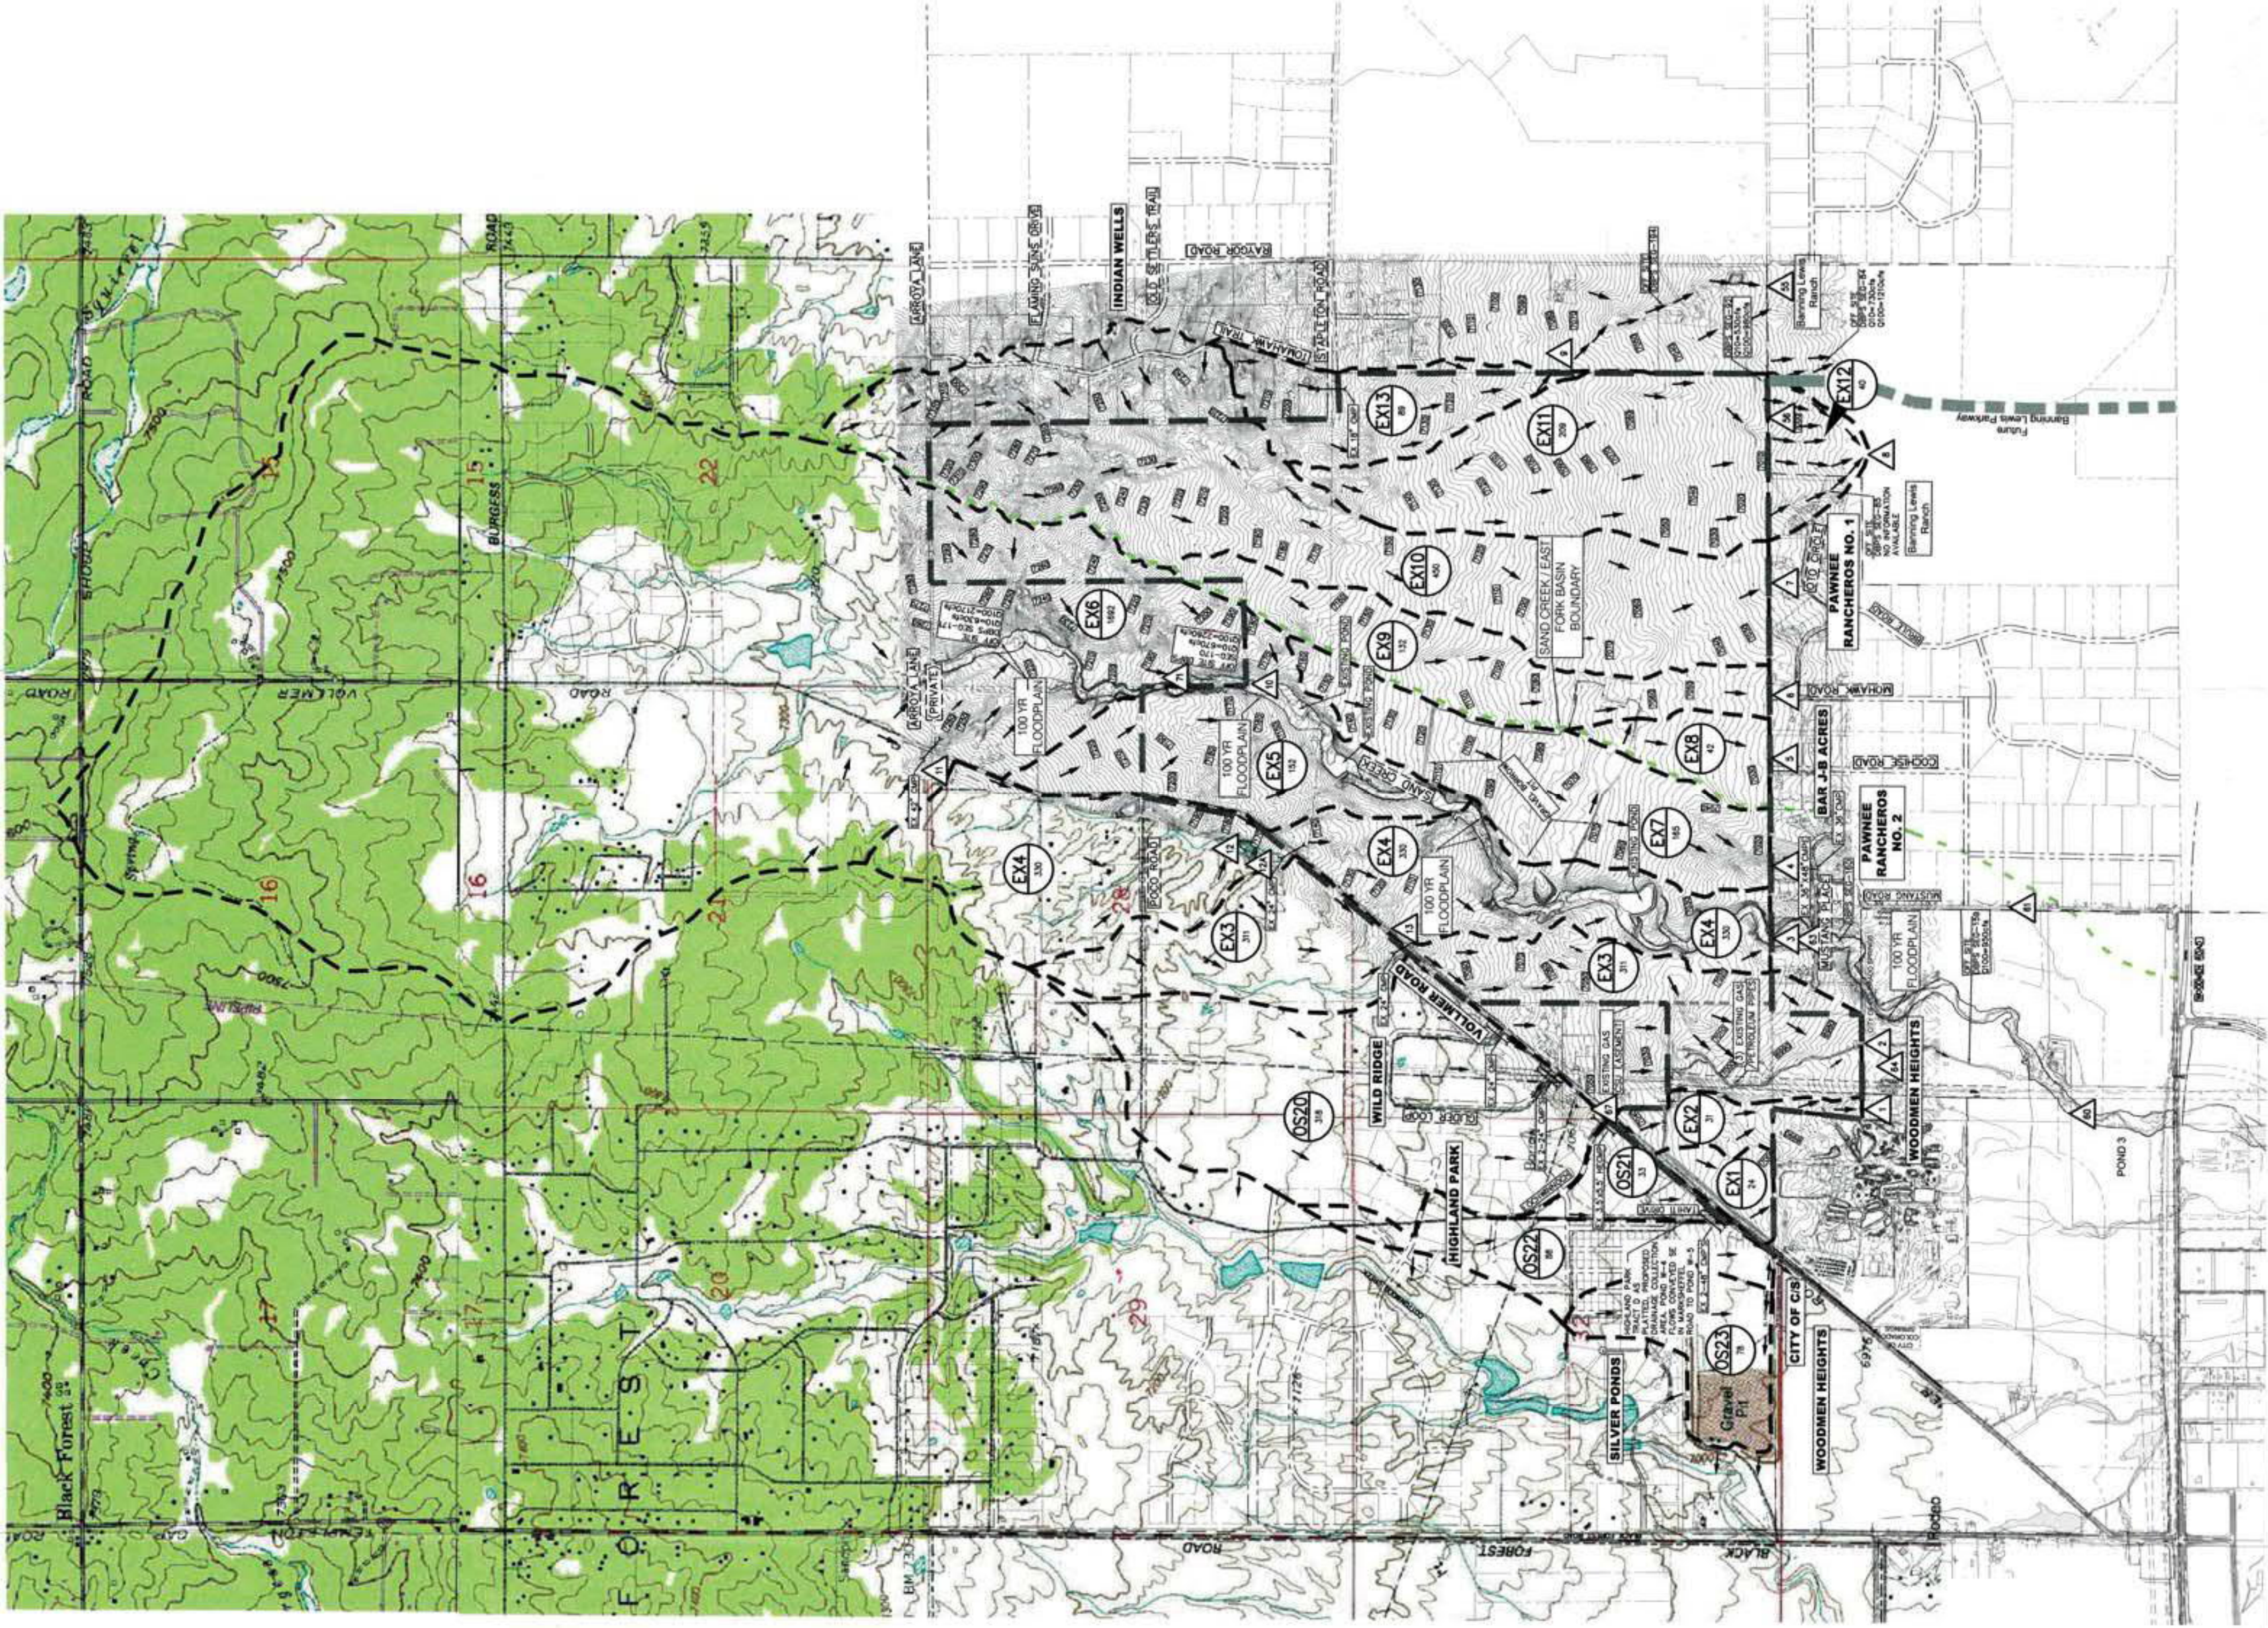

HISTORIC CONDITION

BASIN SUMMARY			
BASIN	AREA (acres)	Q ₁₀ (cfs)	Q ₁₀₀ (cfs)
EX-1	24	3	40
EX-2	31	3	45
EX-3	310	49	341
EX-4	359	71	553
EX-5	1692	116	209
EX-6	105	12	97
EX-7	132	11	94
EX-8	45	48	49
EX-9	209	19	261
EX-10	40	5	63
EX-11	89	8	113
EX-12	318	61	310
EX-13	33	8	38
EX-14	88	18	91
EX-15	78	34	84


* NOTE: BASINS OS-22 & OS-23
NOT PART OF THIS REPORT. FLOWS
FOLLOW HISTORIC PATTERNS ON THE
WESTSIDE OF VOLLMER ROAD.


HISTORIC CONDITION

DESIGN POINTS			
DESIGN POINT	SQ. MI.	Q ₁₀ (cfs)	Q ₁₀₀ (cfs)
1	0.09	5	84
2	0.49	55	465
3	0.52	139	2610
4	0.26	12	197
5	0.07	4	64
6	0.21	11	149
7	0.10	48	474
8	0.39	18	305
9	0.14	6	114
10	2.64	122	2245
11	0.09	5	83
12A	0.07	3	16
12	0.27	10	200
13	0.17	6	130
14	0.17	6	130
15	0.48	55	465
16	0.53	1210	55
17	5.38	2629	80
18	0.38	142	61
19	0.49	115	67

* NOTE: SQ. MI. ARE NOT
CONSTANT AT EACH
DESIGN POINT DP-DBPS
NOTE: DBPS FLOWS ARE
FOR THE EXISTING
CONDITION

NO DATA GIVEN IN DBPS

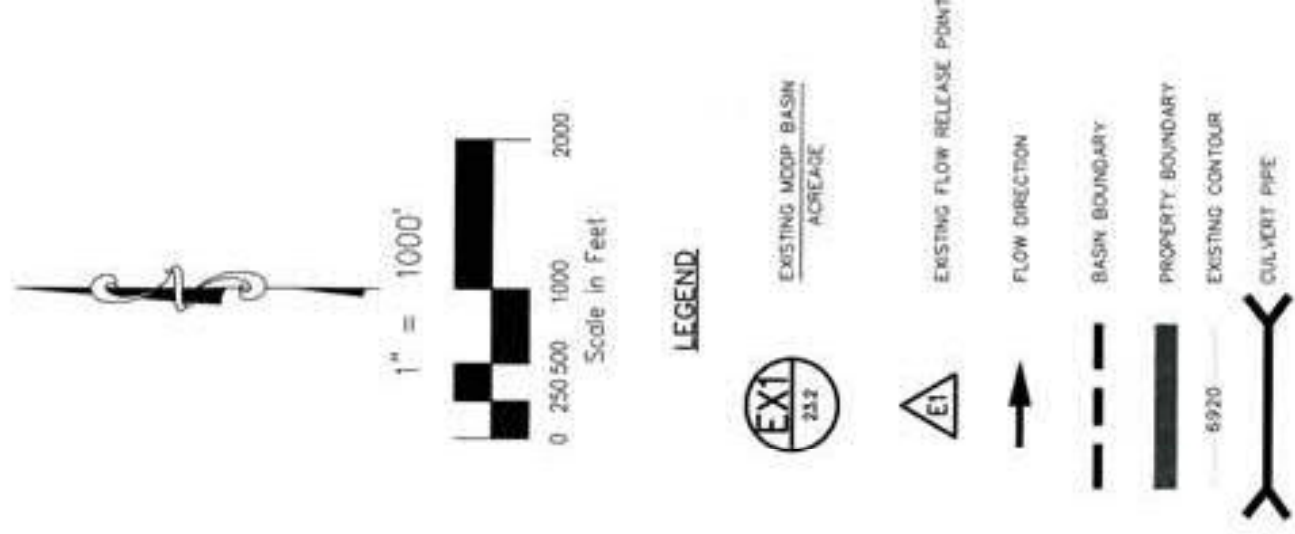

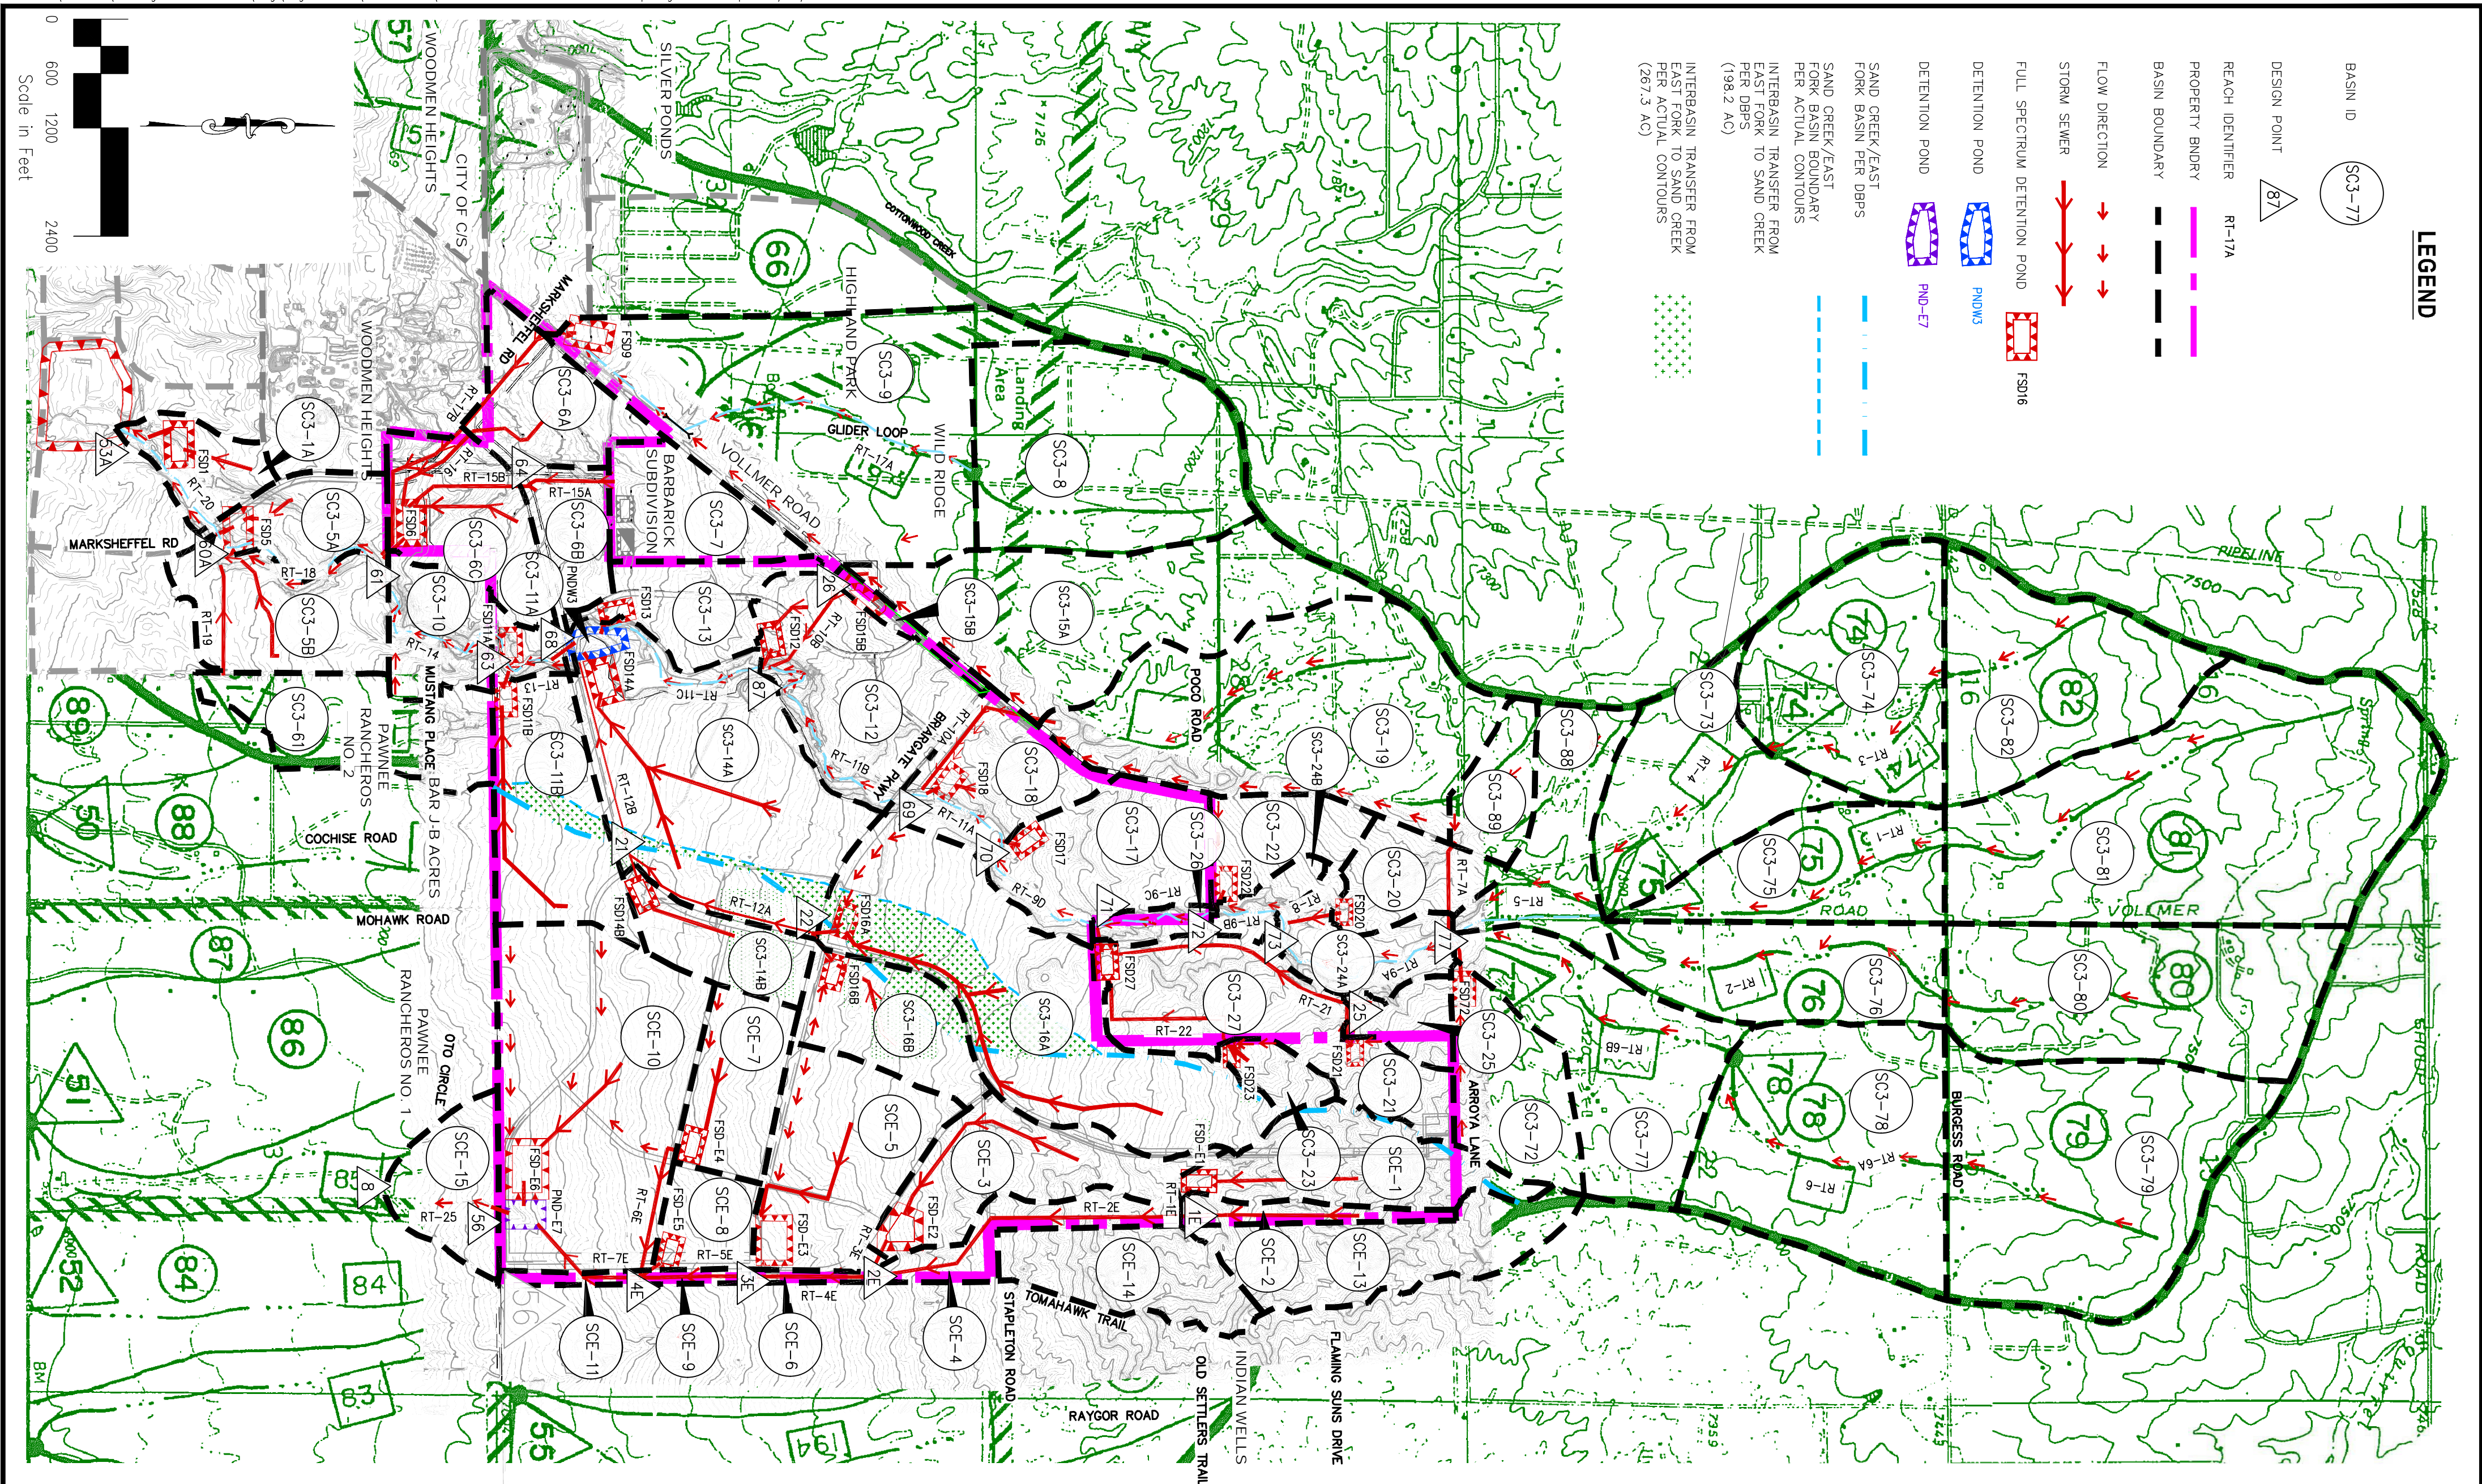

BASIN SUMMARY											
BASIN	CN	AREA acres	Q ₁₀ cfs	Q ₅ cfs	Q ₂ cfs	Q ₁ cfs	Q _{0.5} cfs	Q _{0.2} cfs	Q _{0.1} cfs	Q _{0.05} cfs	Q _{0.02} cfs
SCS-1A	73	27.8	0.044	16.3	23.3	33.0	45.8	57.1	68.9		
SCS-5A	84	39.1	0.061	40.6	53.7	71.0	92.4	110.6	129.1		
SCS-5B	81	63.0	0.098	53.8	73.0	98.5	130.8	158.6	187.0		
SCS-6A	88	49.3	0.077	61.4	79.3	102.2	130.1	153.6	177.1		
SCS-6B	85	30.9	0.048	32.9	43.4	57.0	73.9	88.2	102.7		
SCS-6C	82	58.0	0.091	53.9	72.5	97.1	128.0	154.5	181.5		
SCS-7	88	45.7	0.071	54.0	69.9	90.3	115.2	136.2	157.2		
SCS-8	62	143.4	0.224	25.4	42.1	66.7	100.7	132.3	168.2		
SCS-9	66	217.4	0.340	45.8	71.5	108.6	158.9	204.9	254.0		
SCS-10	63	36.0	0.056	7.6	12.3	19.4	28.1	38.0	47.7		
SCS-11A	70	10.7	0.017	5.3	7.8	10.3	15.9	20.0	24.3		
SCS-11B	80	76.6	0.120	59.4	81.3	110.8	148.1	180.5	213.7		
SCS-12	81	88.2	0.138	77.8	105.6	142.5	189.1	229.1	270.0		
SCS-13	85	41.0	0.064	43.9	57.8	76.0	98.5	117.6	136.9		
SCS-14A	77	164.9	0.258	127.6	173.4	239.8	321.9	393.2	466.3		
SCS-14B	77	34.7	0.054	24.6	33.4	47.4	64.2	79.0	94.1		
SCS-15A	82	139.7	0.218	21.3	35.5	56.3	83.3	112.1	141.0		
SCS-15B	87	146.1	0.263	80.8	143.0	188.2	234.8	292.2	351.8		
SCS-16A	74	168.1	0.263	84.4	124.4	170.0	224.8	282.2	351.8		
SCS-16B	72	50.2	0.080	41.0	53.6	68.5	85.5	110.0	140.6		
SCS-17	81	53.8	0.094	49.3	67.1	91.0	124.2	147.3	174.0		
SCS-18	82	184.0	0.287	28.8	47.7	75.7	114.2	142.3	188.8		
SCS-20	66	23.3	0.033	9.9	15.5	23.6	35.1	45.5	56.6		
SCS-21	66	23.3	0.036	7.0	10.8	16.3	23.7	30.4	37.5		
SCS-22	65	14.5	0.023	5.5	8.8	12.4	18.0	23.0	28.4		
SCS-23A	65	35.7	0.056	13.0	20.4	31.1	45.7	59.0	73.2		
SCS-24B	65	12.2	0.019	3.4	5.3	8.1	11.8	15.2	18.9		
SCS-25	66	19.0	0.030	5.8	8.9	13.4	19.5	25.1	31.0		
SCS-26	63	10.0	0.016	2.5	4.0	6.2	9.2	12.1	15.1		
SCS-27	71	70.0	0.109	35.1	51.2	73.8	103.7	130.3	158.3		
SCS-31	63	65.5	0.102	13.7	22.0	34.4	51.6	67.6	84.8		
SCS-32	64	56.2	0.088	12.8	20.2	31.4	46.7	60.9	76.0		
SCS-33	63	90.0	0.141	16.4	28.4	41.3	62.1	81.3	102.0		
SCS-34	63	119.7	0.187	22.3	36.5	57.3	85.9	112.3	140.7		
SCS-35	63	79.3	0.124	13.1	23.5	33.7	50.5	66.1	82.8		
SCS-36	63	86.4	0.135	14.2	23.1	36.4	54.6	71.4	89.6		
SCS-37	62	106.9	0.167	16.6	27.6	43.8	66.2	87.0	109.4		
SCS-38	63	155.6	0.243	28.1	45.3	70.6	106.2	139.1	174.5		
SCS-39	63	189.0	0.295	34.9	57.0	89.5	134.3	175.6	220.1		
SCS-40	62	147.7	0.231	27.3	44.3	69.6	104.5	136.8	171.4		
SCS-41	62	282.9	0.411	42.6	70.2	111.0	167.4	219.6	275.2		
SCS-42	62	60.6	0.094	17.2	27.8	40.8	58.0	74.0	93.0		
SCS-43	62	27.5	0.043	6.1	10.0	15.9	23.6	30.8	38.6		
SCS-44	65	64.4	0.101	23.3	35.9	53.6	79.1	102.4	127.4		
SCS-45	64	15.0	0.023	4.4	7.0	10.8	15.9	20.7	25.7		
SCS-46	70	67.5	0.105	30.6	49.2	65.9	93.3	118.0	143.9		
SCS-47	70	29.5	0.046	13.3	19.6	28.6	40.6	52.8	67.6		
SCS-48	67	85.5	0.134	13.0	100.4	130.6	169.6	217.4	257.8		
SCS-49	64	3.8	0.006	1.6	2.5	3.7	5.4	7.0	8.6		
SCS-50	89	44.9	0.070	58.9	9.5	96.6	122.2	143.7	165.2		
SCS-51	92	25.5	0.040	38.6	48.4	60.7	75.4	87.7	99.9		
SCS-52	64	4.0	0.006	1.5	2.4	3.6	5.3	6.8	8.5		
SCS-53	81	174.3	0.272	7.6	18.4	19.4	29.1	39.8	46.5		
SCS-54	63	5.8	0.009	2.3	3.3	4.8	7.1	9.3	12.0		
SCS-55	64	78.6	0.123	19.6	31.3	48.7	73.1	95.7	120.0		
SCS-56	63	52.5	0.082	13.2	21.2	33.3	49.9	65.2	81.7		
SCS-57	51	39.7	0.062	2.2	5.1	10.3	17.7	25.1	33.4		

DESIGN POINT SUMMARY											
DESIGN POINT	AREA acres	Q ₁₀ cfs	Q ₅ cfs	Q ₂ cfs	Q ₁ cfs	Q _{0.5} cfs	Q _{0.2} cfs	Q _{0.1} cfs	Q _{0.05} cfs	Q _{0.02} cfs	Q _{0.01} cfs
DP-74	0.371	39.3	65.3	104.8	158.9	209.1	262.8				
DP-75	1.413	141.2	235.1	376.6	566.6	750.9	950.5				
DP-77	2.343	209.9	351.9	580.6	888.6	1188.4	1467.7				
DP-78	0.538	59.7	98.4	154.0	232.6	306.2	385.3				
DP-79	2.471	207.5	354.3	588.5	897.1	1187.2	1506.7				
DP-80	2.543	206.2	354.5	588.5	897.1	1187.2	1506.7				
DP-81	2.757	205.9	348.3	610.5	932.4	1226.9	1612.2				
DP-82	2.867	205.3	348.8	610.4	940.1	1260.6	1656.7				
DP-83	3.594	216.9	374.6	614.9	1072.1	1471.5	1905.9				
DP-84	4.312	214.6	374.5	714.9	1187.6	1674.9	2204.1				
DP-85	0.119	85.9	112.1	145.9	187.5	222.6	258.0				
DP-86	4.448	154.4	201.0	315.7	615.9	1112.1	1385.1				
DP-87	5.356	156.6	223.9	428.0	824.2	1287.3	1620.1				
DP-88	5.316	161.6	224.6	428.0	824.2	1287.3	1620.1				
DP-89	5.661	161.6	224.6	428.0	824.2	1287.3	1620.1				
DP-90	5.661	161.6	224.6	428.0	824.2	1287.3	1620.1				
DP-91	0.636	48.8	76.8	123.0	228.7	319.7	397.1				
DP-92	0.636	48.8	76.8	123.0	228.7	319.7	397.1				
DP-93	0.745	48.1	76.2	122.4	286.9	407.3	534.8				
DP-94	1.017	23.1	35.3	71.5	106.3	152.1	196.4				
DP-95	1.079	23.1	35.3	71.5	106.3	152.1	196.4				
DP-96	0.396	0.6	8.8	17.6	57.1	116.8	174.9				
DP-97	0.342	0.6	8.8	17.6	56.8	105.1	156.4				
DP-98	0.066	5.9	9.1	16.3	35.1	46.4	58.2				
DP-99	0.012	0.1	1.1	3.2	7.3	9.5	12.0				

DESIGN POINT SUMMARY (VOLUME)											
DESIGN POINT	AREA acres	V ₁₀ cu ft	V ₅ cu ft	V ₂ cu ft	V ₁ cu ft	V _{0.5} cu ft	V _{0.2} cu ft	V _{0.1} cu ft	V _{0.05} cu ft	V _{0.02} cu ft	V _{0.01} cu ft
DP-74	0.371	5.9	9.0	13.6	19.8	25.5	31.6				
DP-75	1.413	22.7	34.5	51.7	75.4	97.1	120.5				
DP-77	2.343	37.7	57.4	85.9	125.1	161.1	199.9				
DP-78	0.538	8.5	13.5	20.1	29.3	37.7	46.7				
DP-79	2.471	40.0	60.8	91.0	133.8	170.7	211.7				
DP-80	2.543	41.3	62.9	94.0	136.8	174.5	218.5				
DP-81	2.757	46.3	72.0	104.3	151.3	194.5	240.5				
DP-82	2.867	46.3	72.0	104.3	151.3	194.5	240.5				
DP-83	3.594	57.5	86.1	127.2	183.8	235.3	290.9				
DP-84	4.312	66.5	98.9	145.6	209.1	267.1	329.1				
DP-85	0.119	81.8	123.7	183.9	264.9	338.0	415.8				
DP-86	4.448	119.8	177.0	264.9	398.0	515.1	640.1				
DP-87	5.356	123.5	183.8	264.9	398.0	515.1	640.1				
DP-88	5.316	123.5	183.8	264.9	398.0	515.1	640.1				
DP-89	5.661	123.5	183.8	264.9	398.0	515.1	640.1				
DP-90	5.661	123.5	183.8	264.9	398.0	515.1	640.1				
DP-91	0.636	48.1	76.2	122.4	286.9	407.3	534.8				
DP-92	0.636	48.1	76.2	122.4	286.9	407.3	534.8				
DP-93	0.745	48.1	76.2	122.4	286.9	407.3	534.8				
DP-94	1.017	23.1	35.3	71.5	106.3	152.1	196.4				
DP-95	1.079	23.1	35.3	71.5	106.3	152.1	196.4				
DP-96	0.396	0.6	8.8	17.6	57.1	116.8	174.9				
DP-97	0.342	0.6	8.8	17.6	56.8	105.1	156.4				
DP-98	0.066	5.9	9.1	16.3	35.1	46.4	58.2				
DP-99	0.012	0.1	1.1	3.2	7.3	9.5	12.0				

WATER QUALITY & DETENTION POND SUMMARY											
FSD1	STORM EVENT (YR)	2	5	10	25	50	100				
FSD1	PEAK INFLOW (GFS)	16.3	23.3	33.0	45.8	57.1	68.9				
FSD1	ALLOWABLE RELEASE (GFS)	0.1	1.6	3.2	10.9	17.5	25.5				
FSD1	MODIFIED RELEASE (GFS)	0.1	1.7	3.4	11.7	19.4	28.4				
FSD1	STORAGE VOLUME (AC-FT)	2.4	2.6	3.0	3.6	1.9	2.2				
FSD5	STORM EVENT (YR)	2	5	10	25	50	100				
FSD5	PEAK INFLOW (GFS)	40.6	53.7	71.0	92.4	110.6	129.1				
FSD5	ALLOWABLE RELEASE (GFS)	0.1	1.4	2.6	11.3	30.2	50.2				
FSD5	MODIFIED RELEASE (GFS)	0.1	1.4	2.6	11.2	19.7	30.1				
FSD5	STORAGE VOLUME (AC-FT)	3.0	3.2	3.8	4.1	4.7	5.2				
FSD9	STORM EVENT (YR)	2	5	10	25	50	100				
FSD9	PEAK INFLOW (GFS)	64.6	105.6	168.5	252.3	327.1	410.1				
FSD9	ALLOWABLE RELEASE (GFS)	1.7	7.6	14.6	58.4	96.6	149.7				
FSD9	MODIFIED RELEASE (GFS)	1.7	24.9	49.8	141.1	207.2	289.9				
FSD9	STORAGE VOLUME (AC-FT)	8.7	6.7	9.6	10.8	12.3	13.8				
FSD14	STORM EVENT (YR)	2	5	10	25	50	100				
FSD14	PEAK INFLOW (GFS)	196.5	258.5	339.1	438.7	523.3	608.6				
FSD14	ALLOWABLE RELEASE (GFS)	0.5	7.6	14.6	58.4	96.6	149.7				
FSD14	MODIFIED RELEASE (GFS)	0.5	7.5	14.5	58.2	99.6	149.6				
FSD14	STORAGE VOLUME (AC-FT)	15.5	16.4	18.7	20.8	23.3	26.0				
FSD18	STORM EVENT (YR)	2	5	10	25	50	100				
FSD18	PEAK INFLOW (GFS)	3.3	7.8	11.3	13.9	20.0	24.3				
FSD18	ALLOWABLE RELEASE (GFS)	0.1	0.6	3.2	7.5	9.7	12.4				
FSD18	MODIFIED RELEASE (GFS)	0.2	0.3	3.0	7.5	9.7	12.5				
FSD18	STORAGE VOLUME (AC-FT)	0.3	0.3	0.4	0.4	0.5	0.6				
FSD12	STORM EVENT (YR)	2	5	10	25	50	100				
FSD12	PEAK INFLOW (GFS)	77.8	105.6	164.5	189.1	229.1	270.0				
FSD12	ALLOWABLE RELEASE (GFS)	0.3	4.5	8.7	29.6	47.7	69.6				
FSD12	MODIFIED RELEASE (GFS)	0.3	4.5	8.6	29.5	47.7	69.5				
FSD12	STORAGE VOLUME (AC-FT)	4.8	4.9	5.5	6.4	7.3	8.2				
FSD13	STORM EVENT (YR)	2	5	10	25	50	100				
FSD13	PEAK INFLOW (GFS)	43.9	57.8	76.0	98.5	117.6	136.9				
FSD13	ALLOWABLE RELEASE (GFS)	0.4	6.1	12.3	28.8	37.0	47.6				
FSD13	MODIFIED RELEASE (GFS)	0.4	4.2	12.3	28.6	36.9	47.2				
FSD13	STORAGE VOLUME (AC-FT)	3.1	3.1	3.3	3.8	4.4	5.0				
FSD14A	STORM EVENT (YR)	2	5	10	25	50	100				
FSD14A	PEAK INFLOW (GFS)	127.6	175.4	239.8	321.9	393.2	466.3				
FSD14A	ALLOWABLE RELEASE (GFS)	0.5	7.5	14.4	56.2	95.2	142.4				
FSD14A	MODIFIED RELEASE (GFS)	0.5	7.5	14.4	56.2	95.1	142.2				
FSD14A	STORAGE VOLUME (AC-FT)	9.9	10.6	11.9	13.5	15.3	17.3				
FSD14B	STORM EVENT (YR)	2	5	10	25	50	100				
FSD14B	PEAK INFLOW (GFS)	24.6	34.3	47.4	64.2	79.0	94.1				
FSD14B	ALLOWABLE RELEASE (GFS)	0.0	0.3	0.5	6.7	11.8	19.3				
FSD14B	MODIFIED RELEASE (GFS)	0.0	0.3	0.5	4.5	11.8	19.3				
FSD14B	STORAGE VOLUME (AC-FT)	1.9	2.5	3.3	3.5	3.5	3.8				
FSD15B	STORM EVENT (YR)	2	5	10	25	50	100				
FSD15B	PEAK INFLOW (GFS)	10.8	14.6	18.2	23.3	27.6	31.9				
FSD15B	ALLOWABLE RELEASE (GFS)	0.1	1.6	3.2	7.3	9.5	12.0				
FSD15B	MODIFIED RELEASE (GFS)	0.1	1.1	3.2	7.3	9.5	12.0				
FSD15B	STORAGE VOLUME (AC-FT)	0.6	0.6	0.7	0.8	0.9	1.0				
FSD16A	STORM EVENT (YR)	2	5	10	25	50	100				
FSD16A	PEAK INFLOW (GFS)	84.4	120.4	170.0	234.8	292.2	351.8				
FSD16A	ALLOWABLE RELEASE (GFS)	0.6	8.8	17.3	56.2	86.4	128.3				
FSD16A	MODIFIED RELEASE (GFS)	0.6	8.8	17.3	56.2	86.3	128.3				
FSD16A	STORAGE VOLUME (AC-FT)	7.6	7.7	8.9	10.4	12.1	13.8				
SAND CREEK FLOW COMPARISON CHART											
DESIGN POINT	AREA (sq. mi)	DESCRIPTION									
DP-77	2,343	1468	PROPOSED CONDITION								
	2,91	2262	SAND CREEK DBPS								
		2600	FEMA								
DP-71	2,757	1612	PROPOSED CONDITION								
		2260	SAND CREEK DBPS								
DP-63	4,449	1385	PROPOSED CONDITION								
	4,33	2630	SAND CREEK DBPS								
	5,661	1662	PROPOSED CONDITION								
DP-60A	5,36	3295	SAND CREEK DBPS								
FSCS DBPS DESIGN POINT SUMMARY (PEAK FLOW)											
DBPS DESIGN	AREA (sq. mi)	DESIGN FLOW (cfs)	AREA (sq. mi)	DESIGN FLOW (cfs)	DESIGN FLOW (cfs)	DESIGN FLOW (cfs)					
DP-50	0.32	47.0	193.7	0.32	146.7	320.3					
DP-51 (BASIN 86)	0.33	17.2	74.1	0.32	110.0	233.5					
DP-52	1.67	80.5	485.5	1.67	1207.9	2123.0					
DP-56	0.79	63.6	265.0	0.79	513.0	908.2					
Values reported from SCDBPS (DP 50, 51, 52 Not analyzed as a part of this study)											
DBPS Readout (86Basin)=0.30 to 2.86 cfs (0.100 to 13.2 cfs) (Q1=0.4 to Q99=68.4 cfs)											
(FEMA BASED)											
CIVIL CONSULTANTS, INC.											
20 COLORADO SPRINGS, CO 80903											
PHONE: 719/533-5485											