

**FINAL DRAINAGE REPORT
FOR
PLATTE SELF STORAGE
COLORADO SPRINGS, COLORADO**

NOVEMBER 2024

Prepared For:
RMG – ROCKY MOUNTAIN GROUP
5085 List Drive, #200
Colorado Springs, CO 80919
719.548.0600

Prepared By:
TERRA NOVA ENGINEERING, INC.
721 S. 23RD Street
Colorado Springs, CO 80904
719.635.6422

TNE Job No. 2419.00
County Job No. PPR2418

**FINAL DRAINAGE REPORT
FOR
PLATTE SELF STORAGE
COLORADO SPRINGS, COLORADO**

TABLE OF CONTENTS

Engineer's Statement	Page 3
Purpose	Page 4
General Description	Page 4
Existing Drainage Conditions	Page 5
Proposed Drainage Conditions	Page 7
Hydrologic Calculations	Page 14
Hydraulic Calculations	Page 15
Floodplain Statement	Page 15
Water Quality	Page 15
Construction Cost Opinion	Page 16
Drainage Fees	Page 17
Maintenance	Page 17
Summary	Page 17
Bibliography	Page 18

APPENDICIES

VICINITY MAP

NRCS SOILS MAP

FEMA FIRM MAP

HYDROLOGIC CALCULATIONS

HYDRAULIC CALCULATIONS

DETENTION CALCULATIONS

DRAINAGE PLAN

**FINAL DRAINAGE REPORT
FOR
PLATTE SELF STORAGE
COLORADO SPRINGS, COLORADO**

DESIGN ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Dane Frank, P.E. 50207
On behalf of Terra Nova Engineering, Inc.

Date

OWNER/DEVELOPER'S STATEMENT:

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

Authorized Signature

Date

Printed Name, Title

Business Name

Address

EL PASO COUNTY:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Joshua Palmer, P.E.
County Engineer / ECM Administrator

Date

Conditions:

**FINAL DRAINAGE REPORT
FOR
PLATTE SELF STORAGE
COLORADO SPRINGS, COLORADO**

PURPOSE

The purpose of this Final Drainage Report is to identify and analyze the proposed drainage patterns, determine proposed runoff quantities, size drainage structures for conveyance of developed runoff, and present solutions to drainage impacts on-site and off-site resulting from this development. The site has not previously been platted or studied.

GENERAL DESCRIPTION

This Final Drainage Report (FDR) is an analysis of approximately 17.22 acres of developed land located at 6001 E Platte Ave. The site is currently in use as and landscaping materials yard and is being developed as a mini storage facility. The site is in the northwest quarter of Section 18, Township 14 South, Range 65 West of the 6th Principal Meridian within El Paso County. The parcels are bounded to the north by Motel Road and E Platte Ave, to the east by two unplatted lots, to the south by an unplatted lot and LOT 2 COLORADO SPRINGS AIRPORT FIL NO 1B, and to the west by unplatted lots. (see vicinity map in appendix).

The site lies within the Sand Creek Basin, with storm runoff surface draining west across the site, before flowing onto the neighboring property where Sand Creek East Fork is located.

Soils for this project are delineated by the map in the appendix as Blakeland loamy sand (8), 1 to 9 percent slopes. Soils in the study area are shown as mapped by NRCS in the “Soils Survey of El Paso County Area” and contains soils of Hydrologic Group A.

The site is currently developed with mostly dirt surfaces, some gravel and asphalt areas, and minimal vegetation that is mostly native grasses around the perimeter. The site drains to the west, with an average slope of 6.6%.

EXISTING DRAINAGE CONDITIONS

There are multiple existing buildings, a weight scale, miles of retaining or freestanding walls being used to create material storage areas, and a pond (low area that doesn't drain) on the site. Most of the west side of the site has a berm before an embankment drops down, which results in little runoff leaving the site. The existing pond area is said to be largely paved (unconfirmed), so most runoff would leave the site by evaporation.

There are ten drainage basins, four of which are offsite. See attached Existing Drainage Map in the appendix.

Offsite Basins

Basin OS-Z consists of 6.34 acres of existing dirt and gravel roads (construction yard) located on the eastern adjacent property and its runoff ($Q_5=6.1$ cfs, $Q_{100}=16.7$ cfs) sheet flows west to Design Point Z on the eastern property line of the site. This basin is offsite and runoff flows into Basin EX-C (discussed below).

Basin OS-Y consists of 8.15 acres of existing dirt and gravel roads (construction yard) and undeveloped native grasses located on the eastern adjacent property and its runoff ($Q_5=3.6$ cfs, $Q_{100}=15.4$ cfs) sheet flows southwest to Design Point Y on the eastern property line of the site. This basin is offsite and runoff flows into Basin EX-C (discussed below).

Basin OS-X consists of 1.20 acres of undeveloped native grass area located on the southern adjacent property and its runoff ($Q_5=0.4$ cfs, $Q_{100}=2.3$ cfs) sheet flows north to Design Point X on the southern property line of the site. This basin is offsite and runoff flows into Basin EX-C (discussed below).

Basin OS-W consists of 0.45 acres of undeveloped native grass area and asphalt pavement located on the northern adjacent property and its runoff ($Q_5=0.5$ cfs, $Q_{100}=1.3$ cfs) sheet flows southwest to Design Point W on the northern property line of the site. This basin is offsite and runoff flows into Basin EX-B (discussed below).

Onsite Basins

Basin EX-A consists of 0.3 acres of landscaping areas and buildings located at the north side of the site and its runoff ($Q_5=0.2$ cfs, $Q_{100}=0.8$ cfs) sheet flows west to Design Point A on the northern property line of the site. This basin is offsite and runoff flows into Basin EX-C (discussed below).

Basin EX-B consists of 0.64 acres of landscaping areas, buildings, some pavement, and a swale located on the north side of the site and its runoff ($Q_5=1.1$ cfs, $Q_{100}=2.6$ cfs) sheet flows west to Design Point B, a low point on the northern property line of the site. This basin is onsite and runoff flows into the low point at Design Point B. Once the basin overtops, excess runoff flows north and then west and into Sand Creek.

Basin EX-C consists of 15.4 acres of the bulk of the site and includes buildings, roads, storage areas, and parking areas located central to the site and its runoff ($Q_5=29.0$ cfs, $Q_{100}=65.0$ cfs) sheet flows west to Design Point C at the low point of the existing low area that doesn't drain on the west side of the site.

Basin EX-D consists of 1.05 acres of primarily dirt storage/stockpile area located on the south side of the property and its runoff ($Q_5=0.3$ cfs, $Q_{100}=1.9$ cfs) sheet flows northwest to Design Point D on the eastern property line of the site, indicating that the runoff enters Basin OS-X. The combined flow ($Q_5=0.7$ cfs, $Q_{100}=4.2$ cfs) sheet flows north and into Basin EX-C.

Basin EX-E consists of 0.16 acres of earth embankment located on the west side of the site and its runoff ($Q_5=0.1$ cfs, $Q_{100}=0.5$ cfs) sheet flows west to Design Point E on the western property line of the site. This basin is onsite and runoff flows into Sand Creek.

Basin EX-F consists of 0.23 acres of earth embankment located on the northwest side of the site and its runoff ($Q_5=0.1$ cfs, $Q_{100}=0.7$ cfs) sheet flows northwest to Design Point F on the northwest property line of the site. This basin is onsite and runoff flows into Sand Creek.

PROPOSED DRAINAGE CONDITIONS

Runoff in the developed conditions consists of 14 basins, four of which are offsite. Below is a description of the runoff in the developed conditions and how it will be safely routed, treated and detained. Basins on the west half of the site are proposed as undeveloped, but the proposed detention pond has been sized to account for their future commercial development.

Offsite Basins

Offsite Basins OS-Y, OS-X, & OS-W remain the same as in the existing condition. Offsite Basin OS-Z is broken down into 8 Basins in the proposed conditions. See below for discussions

Onsite Basins

Basin PR-1 consists of 0.07 acres of landscaping area located behind proposed Building B and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.2$ cfs) sheet flows west to Design Point 1 on the northern property line of the site. This basin is onsite and runoff flows into Basin OS-W and into a proposed public 18" RCP culvert under Motel Road, eventually entering Design Point W (discussed in Existing Drainage Conditions).

Basin PR-2 consists of 0.13 acres of landscaping area located behind proposed Build A and its runoff ($Q_5=0.1$ cfs, $Q_{100}=0.4$ cfs) sheet flows northwest to Design Point 2 on the northern property line of the site. This basin is onsite and runoff flows into Basin OS-W and eventually to Design Point W (discussed in Existing Drainage Conditions).

Basin OS-ZA consists of 0.44 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=0.4$ cfs, $Q_{100}=1.1$ cfs) sheet flows west onto Basin PR-10A and is directed to Design Point 10A. Basin PR-10A consists of 0.06 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10A. The combined runoff ($Q_5=0.4$ cfs, $Q_{100}=1.3$ cfs) is captured in an 18" diameter dome inlet and routed south via Pipe Run #14 ($Q_5=0.4$ cfs, $Q_{100}=1.3$ cfs) a proposed private 12" HDPE storm pipe to Design Point 10B.

Basin OS-ZB consists of 0.22 acres of construction yard located on the eastern adjacent property

and its runoff ($Q_5=0.2$ cfs, $Q_{100}=0.6$ cfs) sheet flows west onto Basin PR-10B and is directed to Design Point 10B. Basin PR-10B consists of 0.03 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10B. The combined runoff ($Q_5=0.2$ cfs, $Q_{100}=0.6$ cfs) is captured in an 18" diameter dome inlet and routed south via Pipe Run #15 ($Q_5=0.7$ cfs, $Q_{100}=1.9$ cfs) a proposed private 15" HDPE storm pipe to Design Point 10C.

Basin OS-ZC consists of 0.23 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=0.2$ cfs, $Q_{100}=0.6$ cfs) sheet flows west onto Basin PR-10C and is directed to Design Point 10C. Basin PR-10C consists of 0.04 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10C. The combined runoff ($Q_5=0.2$ cfs, $Q_{100}=0.7$ cfs) is captured in an 18" diameter dome inlet and routed south via Pipe Run #16 ($Q_5=0.9$ cfs, $Q_{100}=2.6$ cfs) a proposed private 15" HDPE storm pipe to Design Point 10D.

Basin OS-ZD consists of 0.86 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=0.8$ cfs, $Q_{100}=2.3$ cfs) sheet flows west onto Basin PR-10D and is directed to Design Point 10D. Basin PR-10D consists of 0.04 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10D. The combined runoff ($Q_5=0.8$ cfs, $Q_{100}=2.4$ cfs) is captured in an 18" diameter dome inlet and routed south via Pipe Run #17 ($Q_5=1.7$ cfs, $Q_{100}=5.0$ cfs) a proposed private 18" HDPE storm pipe to Design Point 10E.

Basin OS-ZH consists of 1.24 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=1.2$ cfs, $Q_{100}=3.3$ cfs) sheet flows west onto Basin PR-10H and is directed to Design Point 10H. Basin PR-10H consists of 0.06 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10H. The combined runoff ($Q_5=1.2$ cfs, $Q_{100}=3.4$ cfs) is captured in an 18" diameter dome inlet and routed north via Pipe Run #18 ($Q_5=1.2$ cfs, $Q_{100}=3.4$ cfs) a proposed private 12" HDPE storm pipe to Design Point 10G.

Basin OS-ZG consists of 0.85 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=0.8$ cfs, $Q_{100}=2.3$ cfs) sheet flows west onto Basin PR-10G and is directed to Design Point 10G. Basin PR-10G consists of 0.05 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10G. The combined runoff ($Q_5=0.8$ cfs, $Q_{100}=2.4$ cfs) is captured in an 18" diameter dome inlet and routed north via Pipe Run #19 ($Q_5=2.0$ cfs, $Q_{100}=5.8$ cfs) a proposed private 15" HDPE storm pipe to Design Point 10F.

Basin OS-ZF consists of 0.56 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=0.5$ cfs, $Q_{100}=1.5$ cfs) sheet flows west onto Basin PR-10F and is directed to Design Point 10F. Basin PR-10F consists of 0.04 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.1$ cfs) is also directed to Design point 10F. The combined runoff ($Q_5=0.6$ cfs, $Q_{100}=1.6$ cfs) is captured in an 18" diameter dome inlet and routed north via Pipe Run #20 ($Q_5=2.6$ cfs, $Q_{100}=7.4$ cfs) a proposed private 15" HDPE storm pipe to Design Point 10E.

In case of failure in any of the inlets for Basins OS-ZA thru OS-ZH, runoff will overtop the high point and be directed to one of the other inlets in the adjacent Basin.

Basin OS-ZE consists of 1.94 acres of construction yard located on the eastern adjacent property and its runoff ($Q_5=1.9$ cfs, $Q_{100}=5.1$ cfs) sheet flows west onto Basin PR-10E and is directed to Design Point 10E. Basin PR-10E consists of 0.09 acres of landscape area along the eastern property line of the site and its runoff ($Q_5=0.0$ cfs, $Q_{100}=0.2$ cfs) is also directed to Design point 10E. The combined runoff ($Q_5=1.9$ cfs, $Q_{100}=5.3$ cfs) is captured in a Type "C" inlet. and routed north via Pipe Run #13 a proposed private 24" RCP storm pipe routes the combined flow ($Q_5=6.2$ cfs, $Q_{100}=17.7$ cfs) of Design Point 10E and Pipe runs #17 & #20 to Design Point 3A. In case of failure in the inlet, runoff will overtop the proposed retaining wall at the west side of the basin and follow drainage patterns as described in Basin PR-3.

Basin PR-3A consists of 1.10 acres consists almost entirely of buildings and pavement central to the site. The runoff ($Q_5=5.0$ cfs, $Q_{100}=8.9$ cfs) flows via concrete cross-pans from the north and south to the center drive aisle. At Design Point 3A, 2 private Type 13 inlets located in the proposed

4' concrete crossspan captures ($Q_5=2.5$ cfs, $Q_{100}=3.4$ cfs), while the flow by ($Q_5=2.5$ cfs, $Q_{100}=5.4$ cfs) continues in the crossspan west to Design Point 3B. Pipe run PR#9 a private 24" RCP routes the combined flow ($Q_5=8.7$ cfs, $Q_{100}=21.1$ cfs) of the captured flow and Pipe Run #13's flow toward Design Point 3B.

Basin PR-3B consists of 1.11 acres consists almost entirely of buildings and pavement central to the site. The runoff ($Q_5=5.0$ cfs, $Q_{100}=8.9$ cfs) flows via concrete cross-pans from the north and south to the center drive aisle. At Design Point 3B ($Q_5=7.5$ cfs, $Q_{100}=14.4$ cfs) the flow by from Design Point 3A and Basin PR-3B 3 private Type 13 inlets located in the proposed 4' concrete crossspan captures ($Q_5=4.0$ cfs, $Q_{100}=5.7$ cfs), while the flow by ($Q_5=4.0$ cfs, $Q_{100}=9.5$ cfs) continues in the crossspan west to Design Point 3C. Pipe run PR#8 a private 30" RCP routes the combined flow ($Q_5=12.5$ cfs, $Q_{100}=26.7$ cfs) of the captured flow and Pipe Run #9's flow toward Design Point 3C.

Basin PR-3C consists of 0.96 acres consists almost entirely of buildings and pavement central to the site. The runoff ($Q_5=4.3$ cfs, $Q_{100}=7.8$ cfs) flows via concrete cross-pans from the north and south to the center drive aisle. At Design Point 3C ($Q_5=8.0$ cfs, $Q_{100}=16.6$ cfs) the flow by from Design Point 3B and Basin PR-3C 3 private Type 13 inlets located in the proposed 4' concrete crossspan captures ($Q_5=4.1$ cfs, $Q_{100}=6.1$ cfs), while the flow by ($Q_5=4.3$ cfs, $Q_{100}=11.1$ cfs) continues in the crossspan west to Design Point 3D. Pipe run PR#7 a private 30" RCP routes the combined flow ($Q_5=16.5$ cfs, $Q_{100}=32.7$ cfs) of the captured flow and Pipe Run #8's flow toward Design Point 3C.

Basin PR-3D consists of 0.97 acres consists almost entirely of buildings and pavement central to the site. The runoff ($Q_5=4.4$ cfs, $Q_{100}=7.8$ cfs) flows via concrete cross-pans from the north and south to the center drive aisle. At Design Point 3D ($Q_5=8.4$ cfs, $Q_{100}=18.4$ cfs) the flow by from Design Point 3C and Basin PR-3D 3 private Type 13 inlets located in the proposed 4' concrete crossspan captures ($Q_5=4.2$ cfs, $Q_{100}=6.5$ cfs), while the flow by ($Q_5=4.5$ cfs, $Q_{100}=12.4$ cfs) continues in the crossspan west to Design Point 3E. Pipe run PR#6 a private 30" RCP routes the combined flow ($Q_5=20.6$ cfs, $Q_{100}=39.0$ cfs) of the captured flow and Pipe Run #7's flow toward a junction with PR#11 (see below for discussion) Design Point 3C.

Basin PR-4 consists of 3.66 acres gravel yard, with the two future canopies included in the drainage calcs, located on the south side of the site and its runoff ($Q_5=8.2$ cfs, $Q_{100}=16.8$ cfs) sheet flows northwest to either Design Point 4, inlet #9, a proposed private 16' D10-R sump inlet, located on the south-central side of the site, or into the concrete cross-pans at the north side of the basin, flows west, and eventually into either Inlet #8, a proposed private CDOT Type 14 sump inlet or Inlet #9. The combined flow ($Q_5=11.8$ cfs, $Q_{100}=32.2$ cfs) from Basin PR-4 and the offsite Basin OS-Y is conveyed via Pipe Run 12, a proposed private 36" RCP, to an inlet junction at Inlet #8, a proposed private CDOT Type 13 inlet. The runoff is then conveyed north via Pipe Run 11, a proposed private 36" RCP, to an inlet junction at Inlet #3. From here the combined flow ($Q_5=32.4$ cfs, $Q_{100}=71.2$ cfs) of Pipe run #6 & #11 is routed west via Pipe Run #5 & #4 private 42" RCPs. If either of these inlets become clogged, runoff will overtop and be collected in the opposite inlet.

Basin PR-3E consists of 1.01 acres consists almost entirely of buildings and pavement central to the site. The runoff ($Q_5=4.5$ cfs, $Q_{100}=8.1$ cfs) flows via concrete cross-pans from the north and south to the center drive aisle. At Design Point 3E ($Q_5=8.8$ cfs, $Q_{100}=20.2$ cfs) the flow by from Design Point 3D and Basin PR-3E a private 20' Type R inlet located in the c&g captures the flow Pipe run PR#4 a private 42" RCP routes the combined flow ($Q_5=32.4$ cfs, $Q_{100}=71.2$ cfs) of the captured flow and Pipe Run #5's a proposed private 42" RCP, to an inlet junction at Inlet #1, a proposed private 20' D10-R sump inlet. The combined runoff ($Q_5=41.2$ cfs, $Q_{100}=91.4$ cfs) is then routed west via Pipe Runs #3 (proposed private 42" RCP), #2 (proposed private 48" RCP), and #1 (proposed private 48" RCP) to the proposed forebay for the proposed Pond 1 (discussed below). If any of these sump inlets become clogged, runoff will continue flowing in the concrete cross-pans until it is collected in the next downstream inlet. If the proposed 20' D10-R sump inlet becomes clogged, runoff will back-up downstream until it is captured in Inlet #2 (see proposed drainage map).

Basin PR-5 consists of 0.56 acres of native grasses and a grass swale located at the south-central side of the site and its runoff ($Q_5=0.1$ cfs, $Q_{100}=0.9$ cfs) is conveyed via grass swale to Design Point 4. This swale also collects flows from Basin OS-X (discussed in Existing Drainage Conditions) in the amount of $Q_5=0.4$ cfs and $Q_{100}=2.3$ cfs. The combined runoff ($Q_5=0.5$ cfs, $Q_{100}=3.3$ cfs) flows over a proposed 1' deep 10'x20' $D_{50}=12$ " riprap pad and into an existing swale

just south of the south-central property line which eventually enters Sand Creek.

Basin PR-6 consists of 6.64 acres of the bulk of the western side of the site including the proposed private Pond 1 EDB (Design Point 6) and its runoff ($Q_5=3.1$ cfs, $Q_{100}=13.1$ cfs) sheet flows west and into the proposed pond. This pond also collects flow from the underground conveyance system from Pipe Run 1, a proposed private 48" RCP, in the amount of $Q_5=41.2$ cfs and $Q_{100}=91.4$ cfs. The combined runoff ($Q_5=44.3$ cfs, $Q_{100}=104.5$ cfs) enters the pond at Design Point 6 where it is treated for water quality and/or detained.

The following basins in the current design contribute flow to Design Point 6: OS-ZA thru OS-ZH, OS-Y, PR-3A thru PR-3E, PR-4, PR-6, & PR-10A thru PR-10H. However, the pond is sized assuming that in the future Basins PR-5, PR-9 & OS-X will be routed to the pond for detention and WQ treatment. Basins OS-Z & OS-Y used actual existing ground cover to calculate impervious area while Basins PR-3, PR-4, & PR-10 used an imperviousness based upon the site development for this SDP and CD's. Basins PR-6, PR-5, & PR-9 assumed an imperviousness of 30%, while offsite Basin OS-X was assumed to be 2%. The 32.68 acres tributary to the EDB have an imperviousness of 38%.

All The combined flow of the currently proposed development and future commercial development will be captured in a 2.283-acre-foot Extended Detention Basin. Runoff entering the pond through the storm sewer system will be routed into a 638 cu-ft concrete lined forebay with a 1.5 feet high concrete cutoff wall. A 3-inch notch in the wall drains the flow to a 2' concrete trickle channel, then the runoff is routed to the 3.0' deep micropool which has a 6" deep initial surcharge area. Based upon this we need a WQCV of 0.475 ac-ft, an EURV volume of 0.851 ac-ft and 100-year volume of 0.957 ac-ft for a total volume needed of 2.283 ac-ft. The bottom of the micropool elevation is at 6199.50 while the top of the ISV elevation is at 6202.50. The bottom of the pond is set at 6202.00 and the top is 6213.00. The WQCV orifice starts at 6202.00 with the first orifice hole having a 1-3/8" diameter. The second orifice hole is set at 6203.70 and is 1-3/16" diameter, and the third one is set 6205.40 with a 1-7/8" diameter hole. The WQCV release is 0.20 cfs with a height of 6206.23. The EURV release is 0.4 cfs and has an elevation of 6208.68. A 4'x4' outlet structure is set at 6210.00. An 18" HDPE storm pipe with no restrictor will release $Q_5=0.4$ cfs and

$Q_{100}=21.6$ cfs discharge to an 8' wide concrete stilling basin at the west property line. The 5-Year and 100-Year HWL are 6208.53 and 6210.86 respectively. The concentrated outflow will dissipate energy by using the standing water in the stilling basin. Runoff will then outfall onto the adjacent property from the stilling basin via sheet flow. This sheet flow matches the existing condition of the existing pond filling up overtopping and sheet flowing west offsite over the existing prairie. The 23' wide emergency spillway is set at 6211.00 and has a flow of 0.69' deep, thus giving a freeboard of 1.31'.

The estimated on-site discharge into Sand Creek in the existing condition is $Q_5=30.8$ cfs and $Q_{100}=71.5$ cfs. The estimated on-site discharge into Sand Creek in the proposed condition is $Q_5=1.2$ cfs and $Q_{100}=26.7$ cfs, indicating a decrease in the discharge rate into Sand Creek of $\%_5=96.1\%$ and $\%_{100}=62.7\%$.

Unresolved:
Include discussion of suitable outfall. Where do these flows go, does it handle flows, even if they are less, etc

Basin PR-7 consists of 0.34 acres of earth embankment located on the northwest side of the site and its runoff ($Q_5=0.2$ cfs, $Q_{100}=1.1$ cfs) sheet flows northwest, off-site, to Design Point 7, indicating that the runoff flows into Sand Creek.

Basin PR-8 consists of 0.30 acres of earth embankment located at the west side of the site, west of the proposed private Pond 1 EDB and its runoff ($Q_5=0.2$ cfs, $Q_{100}=1.0$ cfs) sheet flows west, off-site, to Design Point 8, indicating that the runoff flows into Sand Creek.

Basin PR-9 consists of 0.59 acres of earth embankment and flatter area located at the southwest corner of the site and its runoff ($Q_5=0.2$ cfs, $Q_{100}=1.5$ cfs) sheet flows west, off-site, to Design Point 9, indicating that the runoff flows into Sand Creek.

There is one storm sewer system proposed on the site. This system collects runoff from the drain trench along the east property line and the two curb inlets in the mini-storage area and pipes the runoff to the detention pond. There are a series of area inlets along the storm pipe in the mini-storage area that are not required to capture runoff, but will lessen the surface flow along the central drive aisle. The storm pipes on the west side of the site have been sized to have some extra capacity so that the future commercial development can tie into them as well.

In an effort to protect receiving water and as part of the “four-step process to minimize adverse impacts of urbanization” this site was analyzed in the following manner:

1. Reduce Runoff- There is no runoff reduction in the proposed mini-storage area. The proposed parking area south of the mini-storage has been surfaced with gravel, which will reduce runoff. These items will reduce the volume of runoff using ponding and infiltration. The proposed Extended Detention Basin also significantly reduces the runoff that flows off-site.
2. Stabilize Drainageways- There are no existing or proposed drainageways onsite. The Sand Creek East Fork is located west of the site; however, channel improvements have previously been constructed there.
3. Provide Water Quality Capture Volume (WQCV)- The Extended Detention Basin has been sized and designed to sufficiently capture the required WQCV and slowly release it through the outlet structure, thereby allowing solids and contaminants to settle out. There are a few on-site basins whose runoff is not treated in the proposed EDB. These areas consist mostly of earthen embankment. The runoff from these areas sheet flow over grassed earth, treating the runoff for water quality before it reaches Sand Creek. These areas are excluded per the **ECM 1.7.1.B.7, “sites with land disturbance to undeveloped land that will remain undeveloped”** and **ECM 1.7.1.C.1 - the County may exclude up to 20 percent, not to exceed 1 ac., of the applicable development site area when the County has determined that it is not practicable to capture runoff from portions of the site.**
4. Consider Need for Industrial and Commercial BMPs- The proposed development is an indoor mini storage facility; therefore, no Industrial and Commercial BMPs have been proposed.

HYDROLOGIC CALCULATIONS

Hydrologic calculations were performed using the El Paso County Storm Drainage Design Criteria Manual - Volumes 1 & 2, latest editions. The Rational Method was used to estimate storm water runoff anticipated from design storms with 5-year and 100-year recurrence intervals. The Urban Drainage Criteria Manual was used to calculate the detention and water quality volume.

HYDRAULIC CALCULATIONS

Hydraulic calculations were estimated using the Manning's Formula and the methods described in the El Paso County Storm Drainage Design Criteria Manual – Volumes 1 & 2, latest editions. The pertinent data sheets are included in the appendix of this report.

A culvert is proposed at one of the site entrances. Design calculations have been included for the proposed culvert.

Street runoff capacity calculations for the onsite drive isles have been included.

FLOODPLAIN STATEMENT

No portion of this site is within a designated FEMA floodplain, as determined by FIRM Number 08041C0754 G, dated December 7, 2018 (see appendix).

WATER QUALITY

The proposed Pond 1 detention basin provides water quality treatment for nearly all of the proposed development.

Runoff from basins PR-1, PR-2, PR-5, PR-7, PR-8, and PR-9 are not captured by the proposed detention pond. Basins PR-1 and PR-2 are landscaping areas along the property line with no impervious area. Basin PR-5 is an undeveloped area with a swale that directs offsite flow back offsite, with no impervious area. Basins PR-7 and PR-8 are earth embankments on the downstream edge of the site that drop 10-15 feet in elevation, with no impervious area. Basin PR-9 is part flatter undeveloped area and part earth embankment on the downstream edge of the site that doesn't flow toward the detention pond, with no impervious area. The combined area of these basins is 2.40 acres, with zero impervious area. Exclusions for WQ treatment Basins OS-W and PR-5 are referencing Exemption ECM I.7.1.C.1 - the County may exclude up to 20 percent, not to exceed 1 ac., of the applicable development site area when the County has determined that it is not practicable to capture runoff from portions of the site. 1.00 ac can't drain to the pond due to location and grade impediment. Basins PR-1, PR-2, PR-5, PR-7, PR-8, and PR-9 are using the exclusion of Exemption ECM I.7.1.B.7 - land disturbance to undeveloped land that will remain undeveloped.

1.44 ac will not drain to pond due to location & grade impediments but will remain open & landscape areas. - See the Water Quality Treatment Summary Table & Water Quality Treatment Map for treatment area types and exclusions in the appendix.

CONSTRUCTION COST OPINION

Public Reimbursable

None

Public Non-Reimbursable

None

Private Non-Reimbursable

1. 48" RCP	260 LF	\$ 245	\$ 63,700
2. 42" RCP	80 LF	\$ 201	\$ 16,080
3. 36" RCP	385 LF	\$ 151	\$ 58,135
4. 30" RCP	170 LF	\$ 123	\$ 20,910
5. 24" RCP	115 LF	\$ 98	\$ 11,270
6. 18" HDPE	98 LF	\$ 60	\$ 5,880
7. 15" HDPE	320 LF	\$ 50	\$ 16,000
8. 12" HDPE	148 LF	\$ 40	\$ 5,920
9. 6' Manhole	1 EA	\$ 15,130	\$ 15,130
10. 7' Manhole	1 EA	\$ 15,130	\$ 15,130
9. CDOT Type C Area Inlet	9 EA	\$ 6,037	\$ 54,333
10. 16' D-10-R Curb Inlet	1 EA	\$ 13,835	\$ 13,835
11. 20' D-10-R Curb Inlet	1 EA	\$ 20,000	\$ 20,000
12. 18" Dia Dome Inlets	7 EA	\$ 2,500	\$ 17,500
<u>EDB (Pond 1)</u>			
13. Concrete Forebays	1 EA	\$ 7,000	\$ 7,000
14. Trickle Channel	73 LF	\$ 80	\$ 5,840
15. 4'x4' Outlet Structure	1 EA	\$ 4,000	\$ 4,000
16. Micropool	1 EA	\$ 5,000	\$ 5,000

16. Micropool	1 EA	\$ 5,000	\$ 5,000
17. Pond Earthworks	3,157 CY	\$ 6	\$ 18,942
18. Spillway	1 EA	\$ 7,000	\$ 7,000
19. Reseed/Stabilization	1 EA	\$ 2,000	\$ 2,000
20. Aggregate Base Course	306 CY	\$ 66	\$ 20,196
21. Stilling Basin	1 EA	<u>\$ 5,000</u>	<u>\$ 5,000</u>
			Total \$ 408,801

DRAINAGE FEES

This drainage report is part of a site development application; therefore, no drainage fees are due.

MAINTENANCE

The Extended Detention Basin is private and will be maintained by the property owner. The proposed storm sewers are private and will be maintained by the property owner.

Unresolved:
Provide discussion earlier
in report discussing
suitable outfall location.

SUMMARY

Development of this site will not adversely affect the surrounding development. Site runoff and storm drain appurtenances from the development will not adversely affect the downstream and surrounding developments and will be safely routed to the proposed extended detention basin reduced to the allowable pre-developed rates while slowly treating the water quality capture volume. Runoff from areas of disturbance with no development are being excluded per exemptions and sheet flow offsite in historic paths and rates.

PREPARED BY:
TERRA NOVA ENGINEERING, INC.

Dane Frank, P.E.
Project Engineer

BIBLIOGRAPHY

“Urban Storm Drainage Criteria Manual Volume 1” Prepared by Mile High Flood Control District, Revised August 2018.

“Urban Storm Drainage Criteria Manual Volume 2” Prepared by Mile High Flood Control District, Revised September 2017.

“Urban Storm Drainage Criteria Manual Volume 3” Prepared by Mile High Flood Control District, Revised January 2021.

USDA NRCS Web Soil Survey.

FEMA Flood Insurance Rate Map Dated December 7, 2018.

“Drainage Criteria Manual County of El Paso, Colorado Volume 1” approved October 2018 and prepared by El Paso County

“Drainage Criteria Manual County of El Paso, Colorado Volume 2” approved October 2018 and prepared by El Paso County

“Drainage Criteria Manual County of El Paso, Colorado Volume 1 update Chapter 6” approved October 2018 and prepared by El Paso County

“El Paso County Stormwater Drainage Facilities Maintenance Policy” approved October 2018 and prepared by El Paso County

VICINITY MAP



6001 E Platte Ave Subdivision - Location Map

Image Date Oct 2022



E Platte Ave / HWY 24

Motel Rd

Sand Creek

SITE

Google Earth

700 ft




NRCS SOILS MAP

Soil Map—El Paso County Area, Colorado



Soil Map may not be valid at this scale.

Map Scale: 1:2,120 if printed on A portrait (8.5" x 11") sheet.



MAP LEGEND

Area of Interest (AOI)

Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

Water Features



Streams and Canals

Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

Background



Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 21, Aug 24, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 19, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	16.5	100.0%
Totals for Area of Interest		16.5	100.0%

El Paso County Area, Colorado

8—Blakeland loamy sand, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 369v
Elevation: 4,600 to 5,800 feet
Mean annual precipitation: 14 to 16 inches
Mean annual air temperature: 46 to 48 degrees F
Frost-free period: 125 to 145 days
Farmland classification: Not prime farmland

Map Unit Composition

Blakeland and similar soils: 98 percent
Minor components: 2 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blakeland

Setting

Landform: Hills, flats
Landform position (three-dimensional): Side slope, talf
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Alluvium derived from sedimentary rock and/or eolian deposits derived from sedimentary rock

Typical profile

A - 0 to 11 inches: loamy sand
AC - 11 to 27 inches: loamy sand
C - 27 to 60 inches: sand

Properties and qualities

Slope: 1 to 9 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Somewhat excessively drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95 to 19.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 5 percent
Available water supply, 0 to 60 inches: Low (about 4.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 6e
***Hydrologic Soil Group:* A**
Ecological site: R049XB210CO - Sandy Foothill
Hydric soil rating: No

Minor Components

Other soils

Percent of map unit: 1 percent

Hydric soil rating: No

Pleasant

Percent of map unit: 1 percent

Landform: Depressions

Hydric soil rating: Yes

Data Source Information

Soil Survey Area: El Paso County Area, Colorado

Survey Area Data: Version 21, Aug 24, 2023

FEMA FIRM MAP

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **Footcandle** have been determined, users are encouraged to consult the **Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations** tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only to landward of 0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on the FIRM.

Boundaries of the floodways were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **food control structures**. Refer to section 2.4 "Food Protection Measures" of the Flood Insurance Study report for information on food control structures for this jurisdiction.

The projection used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The horizontal datum was NAD83, GRS80 spheroid. Differences in datum, horizontal projection or UTM zone codes used in the production of FIRAs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and/or elevation referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov> or contact the National Geodetic Survey at the following address:

NGS Information Services
 NOAA, NGS12
 National Geodetic Survey
 SSMC-3, #6202
 1315 East-West Highway
 Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3422 or visit its website at <http://www.ngs.noaa.gov>.

Base Map information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, and Anderson Consulting Group, Inc. These data are current as of 2008.

This map reflects more detailed and up-to-date stream channel configurations and floodplain delineations than those shown on the previous FIRM for this jurisdiction. The floodways and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodway.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or disannexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.


Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by fax at 1-800-368-9620 and its website at <http://www.fema.gov>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA-MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp>.

El Paso County Vertical Datum Offset Table


Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM OR STREAM VERTICAL DATUM CONVERSION INFORMATION.	

Panel Location Map

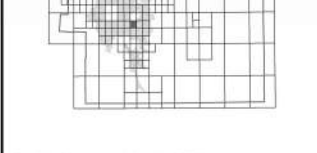

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCBC) and the Federal Emergency Management Agency (FEMA).


Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

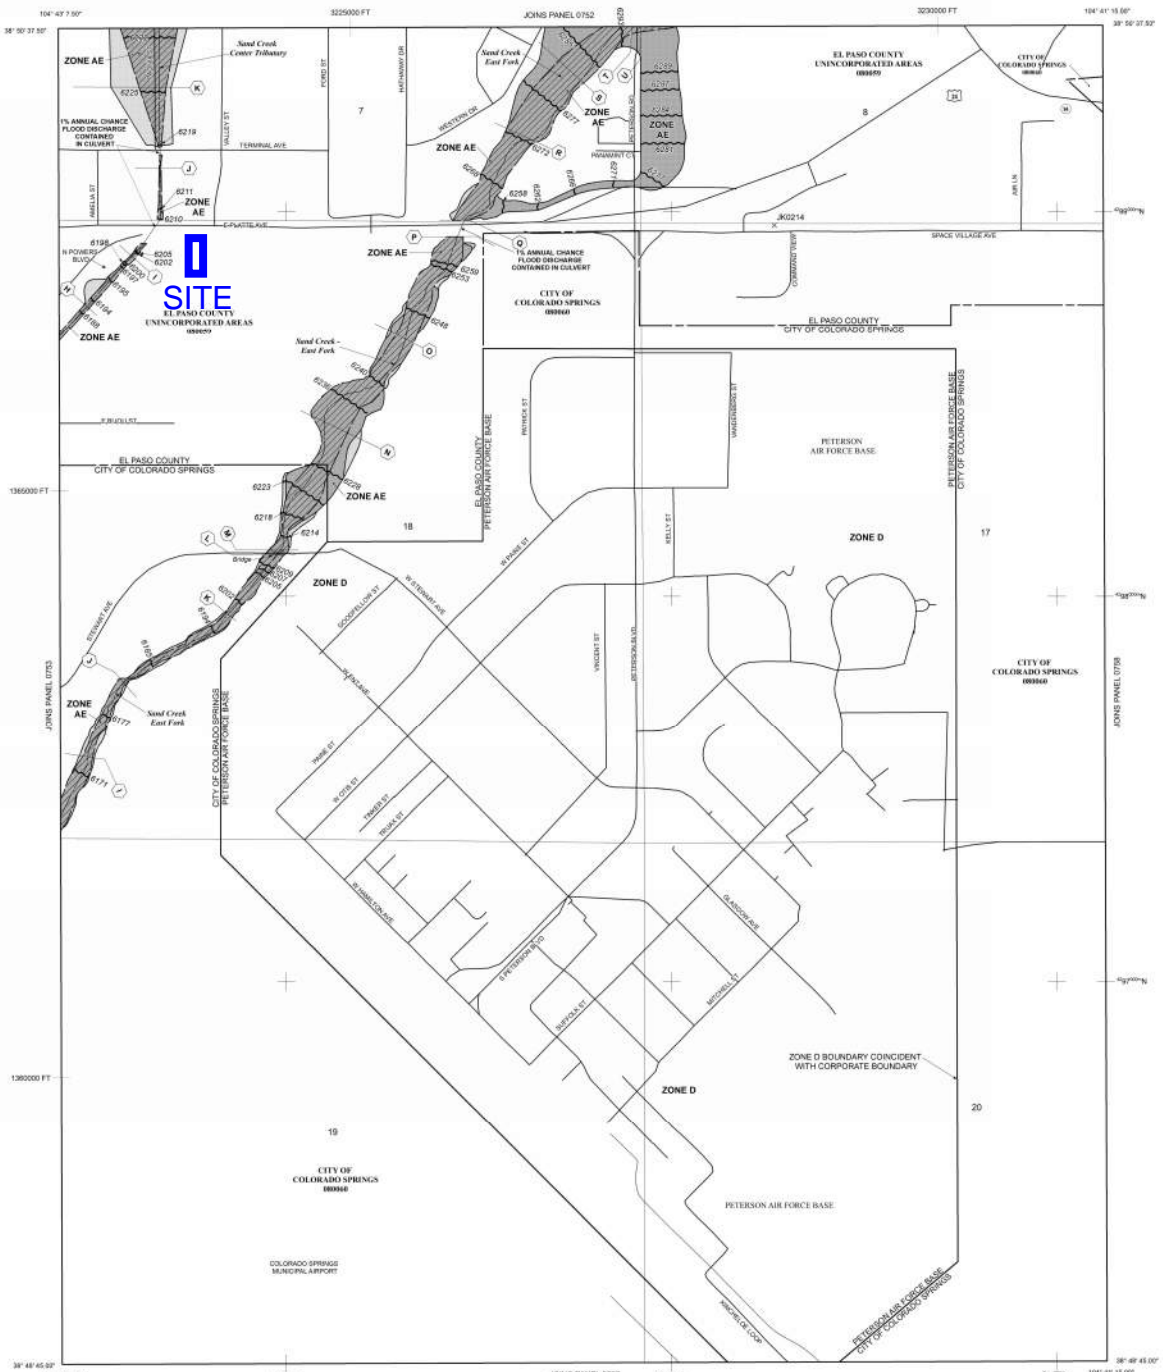

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN TOWNSHIP 14 SOUTH, RANGE 66 WEST.

LEGEND

- SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD**
- ZONE AE** No Base Flood Elevations determined. Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding). Base Flood Elevations determined.
- ZONE AD** Flood depths of 1 to 3 feet (usually areas of ponding); average depths determined. For areas of unusual flat flooring, vehicles also determined.
- ZONE AR** Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently abandoned. Zone AR includes that former flood control system. It is being retained to provide protection from the 1% annual chance flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.
- FLOODWAY AREAS IN ZONE AE**
- OTHER FLOOD AREAS**
- ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depth of 1 foot or less; or 1% annual chance flood with areas less than 1 square mile, and areas protected by levees from 1% annual chance flood.
- OTHER AREAS**
- ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.
- ZONE D** Areas in which flood hazards are undetermined, but possible.
- COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS**
- OTHERWISE PROTECTED AREAS (OPAs)**
- CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.
- Floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary defining Special Flood Hazard Area of different base Flood Elevations, flood depths or flood velocities
- Base Flood Elevation line and value: elevation in feet
- Base Flood Elevation value where uniform within zone; elevation in feet
- Referenced to the North American Vertical Datum of 1988 (NAVD 88)
- Cross section line
- Traverse line
- Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
- 200-meter Universal Transverse Mercator grid lines, zone 13
- 3000-foot grid scale - Colorado State Plane coordinate system, central zone (PROJCS=8302)
- Lambert Conformal Conic Projection
- Bench mark (see explanation in Notes to Users section of this FIS report)
- North pin
- MAP REPOSITORIES: Refer to Map Repository list on Map Index
- EFFECTIVE DATE OF COUNTRYWIDE FLOOD INSURANCE RATE MAP: MARCH 17, 1997
- EFFECTIVE DATES OF REVISIONS TO THIS PANEL: DECEMBER 1, 2018. In order to comply with the National Flood Insurance and Special Flood Hazard Areas, to update map symbols, to add roads and road names, and to incorporate atmospheric model updates to the map.
- The community map repository prior to community redesign, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.
- To determine if flood insurance is available in the community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.



NFP PANEL 0754G

FIRM
 FLOOD INSURANCE RATE MAP
 EL PASO COUNTY,
 COLORADO
 AND INCORPORATED AREAS

PANEL 754 OF 1300
 (SEE MAP INDEX FOR FIRM PANEL LAYOUT)

COMMUNITY	NUMBER	DATE	STATUS
COLORADO SPRINGS CITY OF	0800	07/14	A
EL PASO COUNTY	0800	07/14	A

Revision: This map was revised on 06/13/2020 to make it conform to the current National Flood Insurance Program (NFIP) requirements. The map was revised to include any previous revisions. See the Product User Guide for more information.

Notes to User: The Map Number shown below should be used when ordering this map. The Community Number shown above should be used in insurance applications for the subject community.

MAP NUMBER
08041C0754G

MAP REVISED
DECEMBER 7, 2018

Federal Emergency Management Agency

HYDROLOGIC CALCULATIONS

**PLATTE SELF STORAGE
AREA RUNOFF COEFFICIENT (C) SUMMARY**

EXISTING

BASIN	TOTAL AREA (Acres)	DEVELOPED / IMPERVIOUS			UNDEVELOPED / NON-IMPERVIOUS			WEIGHTED		WEIGHTED CA	
		AREA (Acres)	C ₅	C ₁₀₀	AREA (Acres)	C ₅	C ₁₀₀	C ₅	C ₁₀₀	CA ₅	CA ₁₀₀
<i>OS-Z</i>	6.34	1.90	0.90	0.96	4.44	0.08	0.35	0.33	0.53	2.07	3.38
<i>OS-Y</i>	8.15	0.82	0.90	0.96	7.33	0.08	0.35	0.16	0.41	1.32	3.35
<i>OS-X</i>	1.20	0.02	0.90	0.96	1.18	0.08	0.35	0.09	0.36	0.11	0.43
<i>OS-W</i>	0.45	0.11	0.90	0.96	0.34	0.08	0.35	0.28	0.50	0.13	0.22
<i>EX-A</i>	0.30	0.05	0.90	0.96	0.25	0.08	0.35	0.22	0.45	0.07	0.14
<i>EX-B</i>	0.64	0.29	0.90	0.96	0.35	0.08	0.35	0.45	0.63	0.29	0.40
<i>EX-C</i>	15.4	7.70	0.90	0.96	7.70	0.08	0.35	0.49	0.66	7.55	10.09
<i>EX-D</i>	1.05	0.02	0.90	0.96	1.03	0.08	0.35	0.10	0.36	0.10	0.38
<i>EX-E</i>	0.16	0.00	0.90	0.96	0.16	0.08	0.35	0.08	0.35	0.01	0.06
<i>EX-F</i>	0.23	0.00	0.90	0.96	0.23	0.08	0.35	0.08	0.35	0.02	0.08
Total	33.92	10.91									

Calc:	DLF
Date:	11/8//2024
Checked:	JS

PLATTE SELF STORAGE RUNOFF SUMMARY

EXISTING

BASIN	AREA TOTAL (Acres)	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				T _c	INTENSITY		TOTAL FLOWS	
		C ₅	C ₁₀₀	C ₅	Length (ft)	Slope (ft/ft)	T _t (min)	Length (ft)	Slope (%)	Velocity (fps)	T _t (min)	TOTAL (min)	I ₅ (in/hr)	I ₁₀₀ (in/hr)	Q ₅ (c.f.s.)	Q ₁₀₀ (c.f.s.)
		* For Calcs See Runoff Summary														
<i>OS-Z</i>	6.34	0.33	0.53	0.33	300	0.02	19.3	230	2.0%	1.4	2.7	22.0	2.9	4.9	6.1	16.7
<i>OS-Y</i>	8.15	0.16	0.41	0.16	300	0.03	20.4	505	3.0%	1.7	4.9	25.3	2.7	4.6	3.6	15.4
<i>OS-X</i>	1.20	0.09	0.36	0.09	300	0.05	18.5	0	5.0%	2.2	0.0	18.5	3.2	5.4	0.4	2.3
<i>OS-W</i>	0.45	0.28	0.50	0.28	300	0.07	13.5	160	7.0%	2.6	1.0	14.5	3.6	6.0	0.5	1.3
<i>EX-A</i>	0.30	0.22	0.45	0.22	300	0.07	14.5	0	7.0%	2.6	0.0	14.5	3.6	6.0	0.2	0.8
<i>EX-B</i>	0.64	0.45	0.63	0.45	300	0.07	10.7	250	7.0%	2.6	1.6	12.2	3.8	6.4	1.1	2.6
<i>EX-C</i>	15.4	0.49	0.66	0.49	300	0.07	10.0	330	7.0%	2.6	2.1	12.1	3.8	6.4	29.0	65.0
<i>EX-D</i>	1.05	0.10	0.36	0.10	300	0.03	21.9	40	3.0%	1.7	0.4	22.2	2.9	4.9	0.3	1.9
<i>EX-E</i>	0.16	0.08	0.35	0.08	30	0.40	3.0	0	40.0%	6.3	0.0	5.0	5.2	8.7	0.1	0.5
<i>EX-F</i>	0.23	0.08	0.35	0.08	35	0.24	3.8	0	24.0%	4.9	0.0	5.0	5.2	8.7	0.1	0.7

Calc:	DLF
Date:	11/8//2024
Checked:	JS

PLATTE SELF STORAGE SURFACE ROUTING SUMMARY

EXISTING

<i>Design Point(s)</i>	<i>Contributing Basins</i>	<i>Area (ac)</i>	<i>Flow (cfs)</i>	
			<i>Q₅</i>	<i>Q₁₀₀</i>
<i>Z</i>	OS-Z	6.34	6.1	16.7
<i>Y</i>	OS-Y	8.15	3.6	15.4
<i>X</i>	OS-X & DP D	2.25	0.7	4.2
<i>W</i>	OS-W & DP A	0.75	0.7	2.2
<i>A</i>	EX-A	0.30	0.2	0.8
<i>B</i>	EX-B & DP W	1.39	1.8	4.7
<i>C</i>	EX-C, DP D, DP X, & DP Y	26.85	33.6	86.5
<i>D</i>	EX-D	1.05	0.3	1.9
<i>E</i>	EX-E	0.16	0.1	0.5
<i>F</i>	EX-F	0.23	0.1	0.7

Calc:	DLF
Date:	11/8//2024
Checked:	JS

**PLATTE SELF STORAGE
AREA RUNOFF COEFFICIENT (C) SUMMARY**

PROPOSED

BASIN	TOTAL AREA (Acres)	DEVELOPED / IMPERVIOUS			UNDEVELOPED / NON-IMPERVIOUS			WEIGHTED		WEIGHTED CA	
		AREA (Acres)	C ₅	C ₁₀₀	AREA (Acres)	C ₅	C ₁₀₀	C ₅	C ₁₀₀	CA ₅	CA ₁₀₀
OS-ZA	0.44	0.13	0.90	0.96	0.30	0.08	0.35	0.33	0.53	0.14	0.23
OS-ZB	0.22	0.06	0.90	0.96	0.15	0.08	0.35	0.33	0.53	0.07	0.12
OS-ZC	0.23	0.07	0.90	0.96	0.16	0.08	0.35	0.33	0.53	0.07	0.12
OS-ZD	0.86	0.26	0.90	0.96	0.60	0.08	0.35	0.33	0.53	0.28	0.46
OS-ZE	1.94	0.58	0.90	0.96	1.36	0.08	0.35	0.33	0.53	0.63	1.03
OS-ZF	0.56	0.17	0.90	0.96	0.39	0.08	0.35	0.33	0.53	0.18	0.30
OS-ZG	0.85	0.26	0.90	0.96	0.60	0.08	0.35	0.33	0.53	0.28	0.46
OS-ZH	1.24	0.37	0.90	0.96	0.87	0.08	0.35	0.33	0.53	0.40	0.66
OS-Y	8.15	0.82	0.90	0.96	7.33	0.08	0.35	0.16	0.41	1.32	3.35
OS-X	1.20	0.02	0.90	0.96	1.18	0.08	0.35	0.09	0.36	0.11	0.43
OS-W	0.45	0.11	0.90	0.96	0.34	0.08	0.35	0.28	0.50	0.13	0.22
PR-1	0.07	0.00	0.90	0.96	0.07	0.08	0.35	0.08	0.35	0.01	0.02
PR-2	0.13	0.00	0.90	0.96	0.13	0.08	0.35	0.08	0.35	0.01	0.05
PR-3A	1.10	1.10	0.90	0.96	0.00	0.08	0.35	0.90	0.96	0.99	1.05
PR-3B	1.11	1.11	0.90	0.96	0.00	0.08	0.35	0.90	0.96	1.00	1.06
PR-3C	0.96	0.96	0.90	0.96	0.00	0.08	0.35	0.90	0.96	0.86	0.92
PR-3D	0.97	0.97	0.90	0.96	0.00	0.08	0.35	0.90	0.96	0.87	0.93
PR-3E	1.01	1.01	0.90	0.96	0.00	0.08	0.35	0.90	0.96	0.91	0.97
PR-4	3.66	2.38	0.90	0.96	1.28	0.08	0.35	0.61	0.75	2.24	2.73
PR-5	0.56	0.01	0.90	0.96	0.55	0.08	0.35	0.09	0.36	0.05	0.20
PR-6	6.64	0.66	0.90	0.96	5.98	0.08	0.35	0.16	0.41	1.07	2.73
PR-7	0.34	0.01	0.90	0.96	0.33	0.08	0.35	0.10	0.37	0.04	0.13
PR-8	0.30	0.01	0.90	0.96	0.29	0.08	0.35	0.11	0.37	0.03	0.11
PR-9	0.59	0.01	0.90	0.96	0.58	0.08	0.35	0.09	0.36	0.06	0.21
PR-10A	0.06	0.00	0.90	0.96	0.06	0.08	0.35	0.08	0.35	0.00	0.02
PR-10B	0.03	0.00	0.90	0.96	0.03	0.08	0.35	0.08	0.35	0.00	0.01
PR-10C	0.04	0.00	0.90	0.96	0.04	0.08	0.35	0.08	0.35	0.00	0.01
PR-10D	0.04	0.00	0.90	0.96	0.04	0.08	0.35	0.08	0.35	0.00	0.02
PR-10E	0.09	0.00	0.90	0.96	0.09	0.08	0.35	0.08	0.35	0.01	0.03
PR-10F	0.04	0.00	0.90	0.96	0.04	0.08	0.35	0.08	0.35	0.00	0.01
PR-10G	0.05	0.00	0.90	0.96	0.05	0.08	0.35	0.08	0.35	0.00	0.02
PR-10H	0.06	0.00	0.90	0.96	0.06	0.08	0.35	0.08	0.35	0.00	0.02
Total	33.97	11.07									

Calc:	DLF
Date:	11/8/2024
Checked:	JS

**PLATTE SELF STORAGE
RUNOFF SUMMARY**

PROPOSED

BASIN	AREA TOTAL (Acres)	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				T _c	INTENSITY		TOTAL FLOWS	
		C ₅	C ₁₀₀	C ₅	Length (ft)	Slope (ft/ft)	T _t (min)	Length (ft)	Slope (%)	Velocity (fps)	T _t (min)	TOTAL	I ₅	I ₁₀₀	Q ₅	Q ₁₀₀
		* For Calcs See Runoff Summary										(min)	(in/hr)	(in/hr)	(c.f.s.)	(c.f.s.)
OS-ZA	0.44	0.33	0.53	0.33	300	0.02	19.3	230	2.0%	1.4	2.7	22.0	2.9	4.9	0.4	1.1
OS-ZB	0.22	0.33	0.53	0.33	300	0.02	19.3	231	2.0%	1.4	2.7	22.0	2.9	4.9	0.2	0.6
OS-ZC	0.23	0.33	0.53	0.33	300	0.02	19.3	232	2.0%	1.4	2.7	22.0	2.9	4.9	0.2	0.6
OS-ZD	0.86	0.33	0.53	0.33	300	0.02	19.3	233	2.0%	1.4	2.7	22.0	2.9	4.9	0.8	2.3
OS-ZE	1.94	0.33	0.53	0.33	300	0.02	19.3	234	2.0%	1.4	2.8	22.0	2.9	4.9	1.9	5.1
OS-ZF	0.56	0.33	0.53	0.33	300	0.02	19.3	235	2.0%	1.4	2.8	22.0	2.9	4.9	0.5	1.5
OS-ZG	0.85	0.33	0.53	0.33	300	0.02	19.3	236	2.0%	1.4	2.8	22.0	2.9	4.9	0.8	2.3
OS-ZH	1.24	0.33	0.53	0.33	300	0.02	19.3	237	2.0%	1.4	2.8	22.0	2.9	4.9	1.2	3.3
OS-Y	8.15	0.16	0.41	0.16	300	0.03	20.4	505	3.0%	1.7	4.9	25.3	2.7	4.6	3.6	15.4
OS-X	1.20	0.09	0.36	0.09	300	0.05	18.5	0	5.0%	2.2	0.0	18.5	3.2	5.4	0.4	2.3
OS-W	0.45	0.28	0.50	0.28	300	0.07	13.5	160	7.0%	2.6	1.0	14.5	3.6	6.0	0.5	1.3
PR-1	0.07	0.08	0.35	0.08	100	0.08	9.3	0	8.0%	2.8	0.0	9.3	4.2	7.1	0.0	0.2
PR-2	0.13	0.08	0.35	0.08	45	0.25	4.3	0	25.0%	5.0	0.0	5.0	5.2	8.7	0.1	0.4
PR-3A	1.10	0.90	0.96	0.90	100	0.02	2.9	450	2.0%	2.8	2.7	5.5	5.0	8.4	5.0	8.9
PR-3B	1.11	0.90	0.96	0.90	100	0.02	2.9	451	2.0%	2.8	2.7	5.5	5.0	8.4	5.0	8.9
PR-3C	0.96	0.90	0.96	0.90	100	0.02	2.9	452	2.0%	2.8	2.7	5.5	5.0	8.4	4.3	7.8
PR-3D	0.97	0.90	0.96	0.90	100	0.02	2.9	453	2.0%	2.8	2.7	5.5	5.0	8.4	4.4	7.8
PR-3E	1.01	0.90	0.96	0.90	100	0.02	2.9	454	2.0%	2.8	2.7	5.5	5.0	8.4	4.5	8.1
PR-4	3.66	0.61	0.75	0.61	100	0.02	7.0	400	2.0%	1.0	6.7	13.7	3.7	6.1	8.2	16.8
PR-5	0.56	0.09	0.36	0.09	300	0.02	25.0	0	2.0%	1.0	0.0	25.0	2.8	4.6	0.1	0.9
PR-6	6.64	0.16	0.41	0.16	300	0.02	23.3	0	2.0%	1.0	0.0	23.3	2.9	4.8	3.1	13.1
PR-7	0.34	0.10	0.37	0.10	25	0.33	2.8	0	33.0%	4.0	0.0	5.0	5.2	8.7	0.2	1.1
PR-8	0.30	0.11	0.37	0.11	35	0.33	3.3	0	33.0%	4.0	0.0	5.0	5.2	8.7	0.2	1.0
PR-9	0.59	0.09	0.36	0.09	100	0.06	10.1	0	6.0%	1.7	0.0	10.1	4.1	6.9	0.2	1.5
PR-10A	0.06	0.08	0.35	0.08	100	0.06	10.2	1	1.0%	1.7	0.0	10.2	4.1	6.9	0.0	0.1
PR-10B	0.03	0.08	0.35	0.08	100	0.06	10.2	2	1.0%	1.7	0.0	10.2	4.1	6.9	0.0	0.1
PR-10C	0.04	0.08	0.35	0.08	100	0.06	10.2	3	1.0%	1.7	0.0	10.2	4.1	6.9	0.0	0.1
PR-10D	0.04	0.08	0.35	0.08	100	0.06	10.2	4	1.0%	1.7	0.0	10.2	4.1	6.9	0.0	0.1
PR-10E	0.09	0.08	0.35	0.08	100	0.06	10.2	5	1.0%	1.7	0.0	10.2	4.1	6.9	0.0	0.2
PR-10F	0.04	0.08	0.35	0.08	100	0.06	10.2	6	1.0%	1.7	0.1	10.3	4.1	6.9	0.0	0.1
PR-10G	0.05	0.08	0.35	0.08	100	0.06	10.2	7	1.0%	1.7	0.1	10.3	4.1	6.9	0.0	0.1
PR-10H	0.06	0.08	0.35	0.08	100	0.06	10.2	8	1.0%	1.7	0.1	10.3	4.1	6.9	0.0	0.1

Calc:	DLF
Date:	11/8/2024
Checked:	JS

PLATTE SELF STORAGE SURFACE ROUTING SUMMARY

PROPOSED

<i>Design Point(s)</i>	<i>Contributing Basins</i>	<i>Area (ac)</i>	<i>Flow (cfs)</i>	
			<i>Q₅</i>	<i>Q₁₀₀</i>
1	PR-1	0.07	0.0	0.2
2	PR-2	0.13	0.1	0.4
3A	PR-3A	1.10	5.0	8.9
3B	PR-3B & PR 3A FLOW BY	1.11	7.5	14.4
3C	PR-3C & PR 3B FLOW BY	0.96	8.4	17.2
3D	PR-3D & PR 3C FLOW BY	0.97	8.6	18.9
3E	PR-3E & PR 3D FLOW BY	1.01	9.0	20.6
4	PR-4 & DP Y	11.81	11.8	32.2
5	PR-5 & DP X	1.76	0.5	3.3
6	PR-6 & PR#1	7.74	44.9	105.2
7	PR-7	0.34	0.2	1.1
8	PR-8	0.30	0.2	1.0
9	PR-9	0.59	0.2	1.5
10A	PR-10A & OS-ZA	0.49	0.4	1.3
10B	PR-10B & DP ZB	0.25	0.2	0.6
10C	PR-10C & DP ZC	0.27	0.2	0.7
10D	PR-10D & DP ZD	0.90	0.8	2.4
10E	PR-10E & DP ZE	2.03	1.9	5.3
10F	PR-10F & DP ZF	0.60	0.6	1.6
10G	PR-10G & DP ZG	0.90	0.8	2.4
10H	PR-10H & DP ZH	1.30	1.2	3.4
W	OS-W, DP 1 & DP 2	0.65	0.5	1.9
X	OS-X	1.20	0.4	2.3
Y	OS-Y	8.15	3.6	15.4

Calc:	DLF
Date:	11/8/2024
Checked:	JS

PLATTE SELF STORAGE PIPE ROUTING SUMMARY

<i>Pipe Run</i>	<i>Inlet #</i>	<i>Contributing Flow Sources</i>	<i>5 Year Flow (cfs)</i>	<i>100 Year Flow (cfs)</i>	<i>Slope</i>	<i>Pipe Size & Type</i>	<i>Owner</i>
<i>PR#1</i>	-	PR#2	41.2	91.4	2.7%	48" RCP	PVT
<i>PR#2</i>	-	PR#3	41.2	91.4	2.2%	48" RCP	PVT
<i>PR#3</i>	#1	DP 3E & PR#4	41.2	91.4	2.2%	42" RCP	PVT
<i>PR#4</i>	#2	PR#5	32.4	71.2	1.7%	42" RCP	PVT
<i>PR#5</i>	#3	PR#6 & PR#11	32.4	71.2	2.1%	42" RCP	PVT
<i>PR#6</i>	#4	DP 3D & PR#7	20.6	39.0	5.0%	30" RCP	PVT
<i>PR#7</i>	#5	DP 3C & PR#8	16.5	32.7	1.9%	30" RCP	PVT
<i>PR#8</i>	#6	DP 3B & PR#9	12.5	26.7	1.9%	30" RCP	PVT
<i>PR#9</i>	#7	DP3A & PR#13	8.7	21.1	1.9%	24" RCP	PVT
<i>PR#10</i>	#10	PR#13	6.2	17.7	1.7%	24" RCP	PVT
<i>PR#11</i>	#8	PR#12	11.8	32.2	1.0%	36" RCP	PVT
<i>PR#12</i>	#9	DP 4	11.8	32.2	1.0%	36" RCP	PVT
<i>PR#13</i>	#11	DP 10E & PR#17 & 20	6.2	17.7	1.0%	24" RCP	PVT
<i>PR#14</i>	#12	DP 10A	0.4	1.3	1.0%	12" HDPE	PVT
<i>PR#15</i>	#13	DP 10B & PR#14	0.7	1.9	1.0%	15" HDPE	PVT
<i>PR#16</i>	#14	DP 10C & PR#15	0.9	2.6	1.0%	15" HDPE	PVT
<i>PR#17</i>	#15	DP 10D & PR#16	1.7	5.0	1.0%	18" HDPE	PVT
<i>PR#18</i>	#16	DP 10H	1.2	3.4	1.0%	12" HDPE	PVT
<i>PR#19</i>	#17	DP 10G & PR#18	2.0	5.8	1.0%	15" HDPE	PVT
<i>PR#20</i>	#18	DP 10F & PR#19	2.6	7.4	1.0%	15" HDPE	PVT
<i>PR#90</i>	-	Pond outlet	0.5	11.3	1.4%	18" HDPE	PVT

Calc:	DLF
Date:	11/8/2024
Checked:	JS

PLATTE SELF STORAGE SURFACE ROUTING SUMMARY


Water Quality Treatment Summary Table

Basin ID	Total Area	Total Proposed Disturbed Area	Area Trib to Pond 1	Disturbed Area Treated via Runoff Reduction	Disturbed Area Excluded from WQ per ECM App I.7.1.C.1	Disturbed Area Excluded from WQ per ECM App I.7.1.B.#	Applicable WQ Exclusions (App I.7.1.B.#)
	(ac)	(ac)	(ac)	(ac)	(ac)	(ac)	
OS-ZA	0.44	-	0.44	-	-	-	-
OS-ZB	0.22	-	0.22	-	-	-	-
OS-ZC	0.23	-	0.23	-	-	-	-
OS-ZD	0.86	-	0.86	-	-	-	-
OS-ZE	1.94	-	1.94	-	-	-	-
OS-ZF	0.56	-	0.56	-	-	-	-
OS-ZG	0.85	-	0.85	-	-	-	-
OS-ZH	1.24	-	1.24	-	-	-	-
OS-Y	8.15	-	8.15	-	-	-	-
OS-X	1.20	-	-	-	-	-	-
OS-W	0.45	0.45	-	-	0.45	-	-
PR-1	0.07	0.07	-	-	-	0.07	I.7.1.B.7
PR-2	0.13	0.13	-	-	-	0.13	I.7.1.B.7
PR-3A	1.10	1.10	1.10	-	-	-	-
PR-3B	1.11	1.11	1.11	-	-	-	-
PR-3C	0.96	0.96	0.96	-	-	-	-
PR-3D	0.97	0.97	0.97	-	-	-	-
PR-3E	1.01	1.01	1.01	-	-	-	-
PR-4	3.66	3.66	3.66	-	-	-	-
PR-5	0.56	0.56	-	-	0.55	0.01	I.7.1.B.7
PR-6	6.64	6.64	6.64	-	-	-	-
PR-7	0.34	0.34	-	-	-	0.34	I.7.1.B.7
PR-8	0.30	0.30	-	-	-	0.30	I.7.1.B.7
PR-9	0.59	0.59	-	-	-	0.59	I.7.1.B.7
PR-10A	0.06	0.06	0.06	-	-	-	-
PR-10B	0.03	0.03	0.03	-	-	-	-
PR-10C	0.04	0.04	0.04	-	-	-	-
PR-10D	0.04	0.04	0.04	-	-	-	-
PR-10E	0.09	0.09	0.09	-	-	-	-
PR-10F	0.04	0.04	0.04	-	-	-	-
PR-10G	0.05	0.05	0.05	-	-	-	-
PR-10H	0.06	0.06	0.06	-	-	-	-
TOTALS			30.33		1.00	1.44	
BASINS TRIB TO POND IN FUTURE PR-5, PR-9 & OS-X			2.35				Calc: DLF
AREA TRIB FOR POND DESIGN			32.68				Date: 11/8/2024
							Checked: JS

HYDRAULIC CALCULATIONS

INLETS

Nyloplast 18" Dome Grate Inlet Capacity Chart

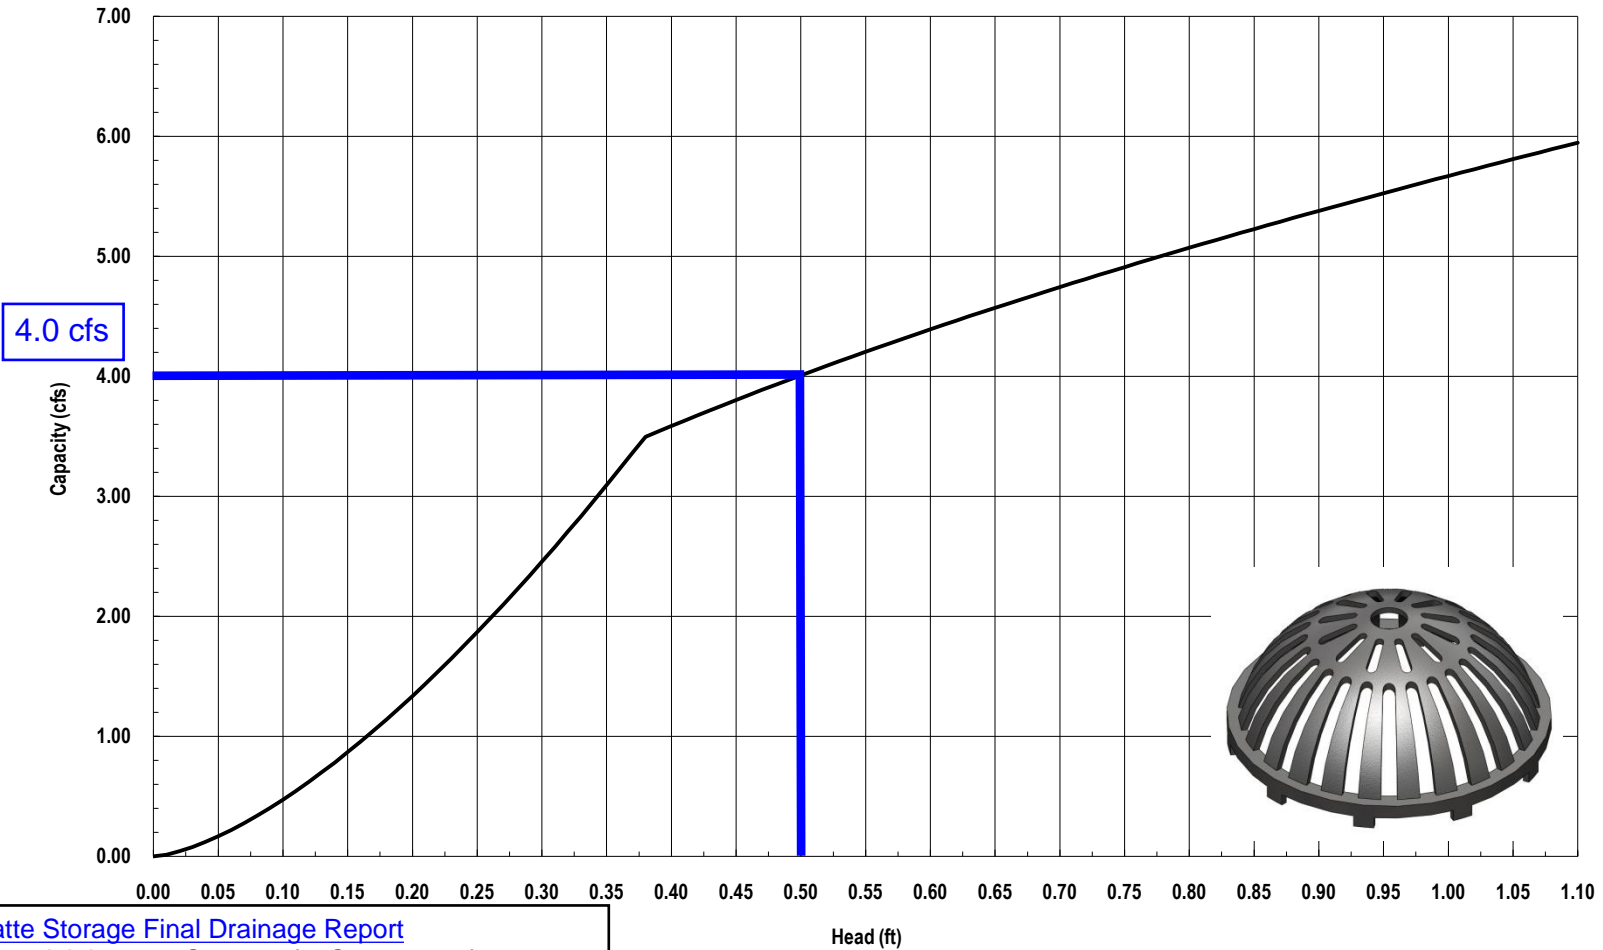

Platte Storage Final Drainage Report

DP 10A Inlet #12: Q5=0.4 cfs; Q100=1.3 cfs
 DP 10B Inlet #13: Q5=0.2 cfs; Q100=0.6 cfs
 DP 10C Inlet #14: Q5=0.2 cfs; Q100=0.7cfs
 DP 10D Inlet #15: Q5=0.8 cfs; Q100=2.4 cfs
 DP 10F Inlet #12: Q5=0.6 cfs; Q100=1.6 cfs
 DP 10G Inlet #12: Q5=0.8 cfs; Q100=2.4 cfs
 DP 10H Inlet #12: Q5=1.2 cfs; Q100=3.4 cfs
 Inlet capacity=4.0 cfs

Thus, each inlet has sufficient capacity.

Head (ft)




3130 Verona Avenue • Buford, GA 30518
 (866) 888-8479 / (770) 932-2443 • Fax: (770) 932-2490
 © Nyloplast Inlet Capacity Charts June 2012

Figure 8-10. Inlet Capacity Chart Sump Conditions, Area (Type C) Inlet

[Platte Storage Final Drainage Report](#)

DP 10E Inlet #11: Q5=1.9 cfs; Q100=5.3 cfs
 Single-grate inlet capacity=6.3 cfs

Thus, inlet has sufficient capacity.

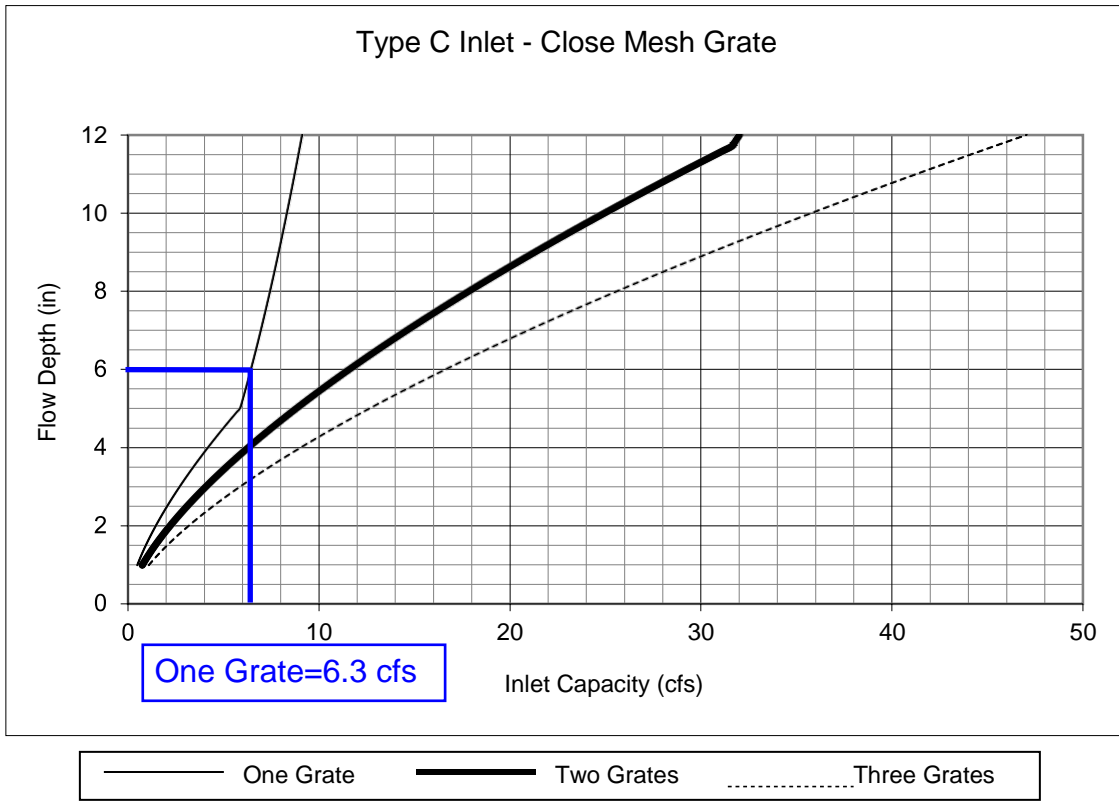

Notes:
 1. The standard inlet parameters must apply to use these charts.

INLET MANAGEMENT

Worksheet Protected

The spreadsheet has Type 13 inlets under the Street inlet section

INLET NAME	DP 3A Inlet #7	DP 3B Inlet #6	DP 3C Inlet #5
Site Type (Urban or Rural)	URBAN	URBAN	URBAN
Inlet Application (Street or Area)	AREA	AREA	AREA
Hydraulic Condition	Swale	Swale	Swale
Inlet Type	User-Defined	User-Defined	User-Defined

USER-DEFINED INPUT

User-Defined Design Flows

Minor Q_{Known} (cfs)	5.0	7.5	8.0
Major Q_{Known} (cfs)	8.9	14.4	16.6

Bypass (Carry-Over) Flow from Upstream Inlets must be organized from upstream (left) to downstream (right) in order for bypass flows to be linked.

Receive Bypass Flow from:	No Bypass Flow Received	No Bypass Flow Received	No Bypass Flow Received
Minor Bypass Flow Received, Q_b (cfs)	0.0	0.0	0.0
Major Bypass Flow Received, Q_b (cfs)	0.0	0.0	0.0

Watershed Characteristics

Subcatchment Area (acres)			
Percent Impervious			
NRCS Soil Type			

Watershed Profile

Overland Slope (ft/ft)			
Overland Length (ft)			
Channel Slope (ft/ft)			
Channel Length (ft)			

Minor Storm Rainfall Input

Design Storm Return Period, T_r (years)			
One-Hour Precipitation, P_1 (inches)			

Major Storm Rainfall Input

Design Storm Return Period, T_r (years)			
One-Hour Precipitation, P_1 (inches)			

CALCULATED OUTPUT

Minor Total Design Peak Flow, Q (cfs)	5.0	7.5	8.0
Major Total Design Peak Flow, Q (cfs)	8.9	14.4	16.6
Minor Flow Bypassed Downstream, Q_b (cfs)	2.5	3.6	4.0
Major Flow Bypassed Downstream, Q_b (cfs)	5.4	8.8	10.6

INLET MANAGEMENT

Worksheet Protected

INLET NAME	DP 3D Inlet #4
Site Type (Urban or Rural)	URBAN
Inlet Application (Street or Area)	AREA
Hydraulic Condition	Swale
Inlet Type	User-Defined

USER-DEFINED INPUT

User-Defined Design Flows	
Minor Q_{Known} (cfs)	8.4
Major Q_{Known} (cfs)	18.4

Bypass (Carry-Over) Flow from Upstream	
Receive Bypass Flow from:	No Bypass Flow Received
Minor Bypass Flow Received, Q_b (cfs)	0.0
Major Bypass Flow Received, Q_b (cfs)	0.0

Watershed Characteristics	
Subcatchment Area (acres)	
Percent Impervious	
NRCS Soil Type	

Watershed Profile	
Overland Slope (ft/ft)	
Overland Length (ft)	
Channel Slope (ft/ft)	
Channel Length (ft)	

Minor Storm Rainfall Input	
Design Storm Return Period, T_r (years)	
One-Hour Precipitation, P_1 (inches)	


Major Storm Rainfall Input	
Design Storm Return Period, T_r (years)	
One-Hour Precipitation, P_1 (inches)	

CALCULATED OUTPUT

Minor Total Design Peak Flow, Q (cfs)	8.4
Major Total Design Peak Flow, Q (cfs)	18.4
Minor Flow Bypassed Downstream, Q_b (cfs)	4.3
Major Flow Bypassed Downstream, Q_b (cfs)	12.0

AREA INLET IN A SWALE

DP 3A Inlet #7

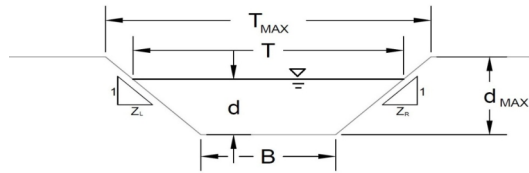

This worksheet uses the NRCS vegetat retardance method to determine Manning's n for grass-lined channels.

An override Manning's n can be entered for other channel materials.

Analysis of Trapezoidal Channel (Grass-Lined uses SCS Method)			A, B, C, D, or E =													
NRCS Vegetal Retardance (A, B, C, D, or E)			n =	0.013												
Manning's n (Leave cell D16 blank to manually enter an n value)			S ₀ =	0.0200 ft/ft												
Channel Invert Slope			B =	0.00 ft												
Bottom Width			Z1 =	24.00 ft/ft												
Left Side Slope			Z2 =	24.00 ft/ft												
Right Side Slope			Choose One: <input type="checkbox"/> Non-Cohesive <input type="checkbox"/> Cohesive <input type="checkbox"/> Paved													
Check one of the following soil types:			<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="width: 30%;">Soil Type:</th> <th style="width: 35%;">Max. Velocity (V_{MAX})</th> <th style="width: 35%;">Max Froude No. (F_{MAX})</th> </tr> </thead> <tbody> <tr> <td>Non-Cohesive</td> <td style="text-align: center;">5.0 fps</td> <td style="text-align: center;">0.60</td> </tr> <tr> <td>Cohesive</td> <td style="text-align: center;">7.0 fps</td> <td style="text-align: center;">0.80</td> </tr> <tr> <td>Paved</td> <td style="text-align: center;">N/A</td> <td style="text-align: center;">N/A</td> </tr> </tbody> </table>		Soil Type:	Max. Velocity (V _{MAX})	Max Froude No. (F _{MAX})	Non-Cohesive	5.0 fps	0.60	Cohesive	7.0 fps	0.80	Paved	N/A	N/A
Soil Type:	Max. Velocity (V _{MAX})	Max Froude No. (F _{MAX})														
Non-Cohesive	5.0 fps	0.60														
Cohesive	7.0 fps	0.80														
Paved	N/A	N/A														
Maximum Allowable Top Width of Channel for Minor & Major Storm			T _{MAX} =	40.00 ft												
Maximum Allowable Water Depth in Channel for Minor & Major Storm			d _{MAX} =	0.50 ft												
Allowable Channel Capacity Based On Channel Geometry			<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="width: 30%;">Minor Storm</th> <th style="width: 30%;">Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>Q_{allow} =</td> <td style="text-align: center;">38.6</td> <td style="text-align: center;">38.6</td> <td style="text-align: center;">cfs</td> </tr> <tr> <td>d_{allow} =</td> <td style="text-align: center;">0.50</td> <td style="text-align: center;">0.50</td> <td style="text-align: center;">ft</td> </tr> </tbody> </table>			Minor Storm	Major Storm		Q _{allow} =	38.6	38.6	cfs	d _{allow} =	0.50	0.50	ft
	Minor Storm	Major Storm														
Q _{allow} =	38.6	38.6	cfs													
d _{allow} =	0.50	0.50	ft													
Water Depth in Channel Based On Design Peak Flow			<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="width: 30%;">Minor Storm</th> <th style="width: 30%;">Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>Q_o =</td> <td style="text-align: center;">5.0</td> <td style="text-align: center;">8.9</td> <td style="text-align: center;">cfs</td> </tr> <tr> <td>d =</td> <td style="text-align: center;">0.23</td> <td style="text-align: center;">0.29</td> <td style="text-align: center;">ft</td> </tr> </tbody> </table>			Minor Storm	Major Storm		Q _o =	5.0	8.9	cfs	d =	0.23	0.29	ft
	Minor Storm	Major Storm														
Q _o =	5.0	8.9	cfs													
d =	0.23	0.29	ft													
<p style="color: red; margin: 0;">Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'</p> <p style="color: red; margin: 0;">Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'</p>																


AREA INLET IN A SWALE

DP 3A Inlet #7

Inlet Design Information (Input)																												
Type of Inlet User-Defined	Inlet Type = User-Defined																											
Angle of Inclined Grate (must be ≤ 30 degrees) Width of Grate Length of Grate Open Area Ratio Height of Inclined Grate Clogging Factor Grate Discharge Coefficient Orifice Coefficient Weir Coefficient	<table style="width: 100%; border-collapse: collapse;"> <tr><td>$\theta =$</td><td style="text-align: center;">0.00</td><td>degrees</td></tr> <tr><td>$W =$</td><td style="text-align: center;">4.00</td><td>ft</td></tr> <tr><td>$L =$</td><td style="text-align: center;">3.33</td><td>ft</td></tr> <tr><td>$A_{RATIO} =$</td><td style="text-align: center;">0.70</td><td></td></tr> <tr><td>$H_B =$</td><td style="text-align: center;">0.00</td><td>ft</td></tr> <tr><td>$C_f =$</td><td style="text-align: center;">0.50</td><td></td></tr> <tr><td>$C_d =$</td><td style="text-align: center;">N/A</td><td></td></tr> <tr><td>$C_o =$</td><td style="text-align: center;">0.64</td><td></td></tr> <tr><td>$C_w =$</td><td style="text-align: center;">2.05</td><td></td></tr> </table>	$\theta =$	0.00	degrees	$W =$	4.00	ft	$L =$	3.33	ft	$A_{RATIO} =$	0.70		$H_B =$	0.00	ft	$C_f =$	0.50		$C_d =$	N/A		$C_o =$	0.64		$C_w =$	2.05	
$\theta =$	0.00	degrees																										
$W =$	4.00	ft																										
$L =$	3.33	ft																										
$A_{RATIO} =$	0.70																											
$H_B =$	0.00	ft																										
$C_f =$	0.50																											
$C_d =$	N/A																											
$C_o =$	0.64																											
$C_w =$	2.05																											
	<table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="text-align: center;">MINOR</th> <th style="text-align: center;">MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td>$d =$</td> <td style="text-align: center;">0.23</td> <td style="text-align: center;">0.29</td> <td></td> </tr> <tr> <td>$Q_a =$</td> <td style="text-align: center;">2.5</td> <td style="text-align: center;">3.4</td> <td>cfs</td> </tr> <tr> <td>$Q_b =$</td> <td style="text-align: center;">2.5</td> <td style="text-align: center;">5.4</td> <td>cfs</td> </tr> <tr> <td>$C\% =$</td> <td style="text-align: center;">50</td> <td style="text-align: center;">39</td> <td>%</td> </tr> </tbody> </table>		MINOR	MAJOR		$d =$	0.23	0.29		$Q_a =$	2.5	3.4	cfs	$Q_b =$	2.5	5.4	cfs	$C\% =$	50	39	%							
	MINOR	MAJOR																										
$d =$	0.23	0.29																										
$Q_a =$	2.5	3.4	cfs																									
$Q_b =$	2.5	5.4	cfs																									
$C\% =$	50	39	%																									
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression) Total Inlet Interception Capacity (assumes clogged condition) Bypassed Flow Capture Percentage = Q_a/Q_o																												

AREA INLET IN A SWALE

DP 3B Inlet #6

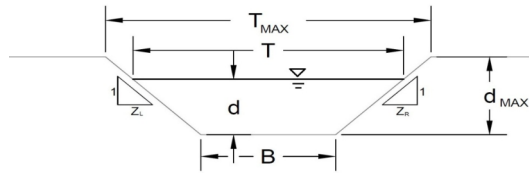

This worksheet uses the NRCS vegetal retardance method to determine Manning's n for grass-lined channels.
An override Manning's n can be entered for other channel materials.

Analysis of Trapezoidal Channel (Grass-Lined uses SCS Method)

NRCS Vegetal Retardance (A, B, C, D, or E) A, B, C, D, or E =

Manning's n (Leave cell D16 blank to manually enter an n value) n = 0.013

Channel Invert Slope S₀ = 0.0200 ft/ft

Bottom Width B = 0.00 ft

Left Side Slope Z₁ = 24.00 ft/ft

Right Side Slope Z₂ = 24.00 ft/ft

Check one of the following soil types:

Soil Type:	Max. Velocity (V _{MAX})	Max Froude No. (F _{MAX})
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

Choose One:

Non-Cohesive

Cohesive

Paved

	Minor Storm	Major Storm	
Maximum Allowable Top Width of Channel for Minor & Major Storm	T_{MAX} = 40.00	40.00	ft
Maximum Allowable Water Depth in Channel for Minor & Major Storm	d_{MAX} = 0.50	0.50	ft

Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
Q _{allow}	38.6	38.6	cfs
d _{allow}	0.50	0.50	ft

Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

	Minor Storm	Major Storm	
Q _o	7.5	14.4	cfs
d	0.27	0.35	ft

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'
Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

AREA INLET IN A SWALE

DP 3B Inlet #6

Inlet Design Information (Input)

Type of Inlet: User-Defined Inlet Type = User-Defined

Angle of Inclined Grate (must be ≤ 30 degrees) $\theta = 0.00$ degrees

Width of Grate $W = 6.00$ ft

Length of Grate $L = 3.33$ ft

Open Area Ratio $A_{RATIO} = 0.70$

Height of Inclined Grate $H_B = 0.00$ ft

Clogging Factor $C_f = 0.50$

Grate Discharge Coefficient $C_d = N/A$

Orifice Coefficient $C_o = 0.64$

Weir Coefficient $C_w = 2.05$

Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)

	MINOR	MAJOR	
$d =$	0.27	0.35	
$Q_a =$	3.8	5.5	cfs
$Q_b =$	3.6	8.8	cfs
$C\% =$	51	39	%


Total Inlet Interception Capacity (assumes clogged condition)

Bypassed Flow

Capture Percentage = Q_a/Q_o

AREA INLET IN A SWALE

DP 3C Inlet #5

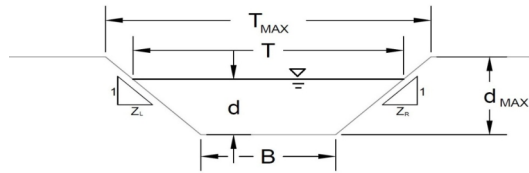

This worksheet uses the NRCS vegetat retardance method to determine Manning's n for grass-lined channels.

An override Manning's n can be entered for other channel materials.

Analysis of Trapezoidal Channel (Grass-Lined uses SCS Method)

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity (V_{MAX})	Max Froude No. (F_{MAX})
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D, or E =

n =	0.013	
S_0 =	0.0200	ft/ft
B =	0.00	ft
Z1 =	24.00	ft/ft
Z2 =	24.00	ft/ft

Choose One:

- Non-Cohesive
 Cohesive
 Paved

Maximum Allowable Top Width of Channel for Minor & Major Storm

Maximum Allowable Water Depth in Channel for Minor & Major Storm

	Minor Storm	Major Storm	
T_{MAX} =	40.00	40.00	ft
d_{MAX} =	0.50	0.50	ft

Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
Q_{allow} =	38.6	38.6	cfs
d_{allow} =	0.50	0.50	ft

Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

Q_o =	8.0	16.6	cfs
d =	0.28	0.36	ft

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'


AREA INLET IN A SWALE

DP 3C Inlet #5

Inlet Design Information (Input)																												
Type of Inlet User-Defined	Inlet Type = User-Defined																											
Angle of Inclined Grate (must be <= 30 degrees) Width of Grate Length of Grate Open Area Ratio Height of Inclined Grate Clogging Factor Grate Discharge Coefficient Orifice Coefficient Weir Coefficient	<table style="width: 100%; border-collapse: collapse;"> <tr><td style="width: 150px;">θ =</td><td style="text-align: center;">0.00</td><td style="width: 50px;">degrees</td></tr> <tr><td>W =</td><td style="text-align: center;">6.00</td><td>ft</td></tr> <tr><td>L =</td><td style="text-align: center;">3.33</td><td>ft</td></tr> <tr><td>A_{RATIO} =</td><td style="text-align: center;">0.70</td><td></td></tr> <tr><td>H_B =</td><td style="text-align: center;">0.00</td><td>ft</td></tr> <tr><td>C_f =</td><td style="text-align: center;">0.50</td><td></td></tr> <tr><td>C_d =</td><td style="text-align: center;">N/A</td><td></td></tr> <tr><td>C_o =</td><td style="text-align: center;">0.64</td><td></td></tr> <tr><td>C_w =</td><td style="text-align: center;">2.05</td><td></td></tr> </table>	θ =	0.00	degrees	W =	6.00	ft	L =	3.33	ft	A_{RATIO} =	0.70		H_B =	0.00	ft	C_f =	0.50		C_d =	N/A		C_o =	0.64		C_w =	2.05	
θ =	0.00	degrees																										
W =	6.00	ft																										
L =	3.33	ft																										
A_{RATIO} =	0.70																											
H_B =	0.00	ft																										
C_f =	0.50																											
C_d =	N/A																											
C_o =	0.64																											
C_w =	2.05																											
	<table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="text-align: center;">MINOR</th> <th style="text-align: center;">MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td>d =</td> <td style="text-align: center;">0.28</td> <td style="text-align: center;">0.36</td> <td></td> </tr> <tr> <td>Q_a =</td> <td style="text-align: center;">4.0</td> <td style="text-align: center;">6.0</td> <td style="text-align: right;">cfs</td> </tr> <tr> <td>Q_b =</td> <td style="text-align: center;">4.0</td> <td style="text-align: center;">10.6</td> <td style="text-align: right;">cfs</td> </tr> <tr> <td>$C\%$ =</td> <td style="text-align: center;">50</td> <td style="text-align: center;">36</td> <td style="text-align: right;">%</td> </tr> </tbody> </table>		MINOR	MAJOR		d =	0.28	0.36		Q_a =	4.0	6.0	cfs	Q_b =	4.0	10.6	cfs	$C\%$ =	50	36	%							
	MINOR	MAJOR																										
d =	0.28	0.36																										
Q_a =	4.0	6.0	cfs																									
Q_b =	4.0	10.6	cfs																									
$C\%$ =	50	36	%																									
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression) Total Inlet Interception Capacity (assumes clogged condition) Bypassed Flow Capture Percentage = Q_a/Q_o																												

AREA INLET IN A SWALE

DP 3D Inlet #4

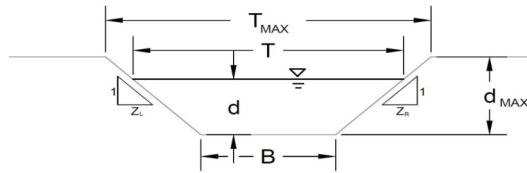

This worksheet uses the NRCS vegetat retardance method to determine Manning's n for grass-lined channels.

An override Manning's n can be entered for other channel materials.

Analysis of Trapezoidal Channel (Grass-Lined uses SCS Method)			A, B, C, D, or E =	
NRCS Vegetal Retardance (A, B, C, D, or E)			n =	0.013
Manning's n (Leave cell D16 blank to manually enter an n value)			S ₀ =	0.0200 ft/ft
Channel Invert Slope			B =	0.00 ft
Bottom Width			Z1 =	24.00 ft/ft
Left Side Slope			Z2 =	24.00 ft/ft
Right Side Slope			Choose One: <input type="checkbox"/> Non-Cohesive <input type="checkbox"/> Cohesive <input type="checkbox"/> Paved	
Check one of the following soil types:			Minor Storm Major Storm	
Soil Type:	Max. Velocity (V _{MAX})	Max Froude No. (F _{MAX})	T _{MAX} =	40.00 ft
Non-Cohesive	5.0 fps	0.60	d _{MAX} =	0.50 ft
Cohesive	7.0 fps	0.80		
Paved	N/A	N/A		
Maximum Allowable Top Width of Channel for Minor & Major Storm				
Maximum Allowable Water Depth in Channel for Minor & Major Storm				
Allowable Channel Capacity Based On Channel Geometry			Minor Storm Major Storm	
MINOR STORM Allowable Capacity is based on Depth Criterion			Q _{allow} =	38.6 cfs
MAJOR STORM Allowable Capacity is based on Depth Criterion			d _{allow} =	0.50 ft
Water Depth in Channel Based On Design Peak Flow				
Design Peak Flow			Q _o =	8.4 cfs
Water Depth			d =	0.28 ft
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management' Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'				

AREA INLET IN A SWALE

DP 3D Inlet #4

Inlet Design Information (Input)

Type of Inlet: User-Defined Inlet Type = User-Defined

Angle of Inclined Grate (must be <= 30 degrees) $\theta = 0.00$ degrees

Width of Grate $W = 6.00$ ft

Length of Grate $L = 3.33$ ft

Open Area Ratio $A_{RATIO} = 0.70$

Height of Inclined Grate $H_B = 0.00$ ft

Clogging Factor $C_f = 0.50$

Grate Discharge Coefficient $C_d = N/A$

Orifice Coefficient $C_o = 0.64$

Weir Coefficient $C_w = 2.05$

Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)


	MINOR	MAJOR	
$d =$	0.28	0.38	
$Q_a =$	4.1	6.4	cfs
$Q_b =$	4.3	12.0	cfs
$C\% =$	49	35	%

Total Inlet Interception Capacity (assumes clogged condition)

Bypassed Flow

Capture Percentage = Q_a/Q_o

Figure 8-11. Inlet Capacity Chart Sump Conditions , Curb Opening (Type R) Inlet

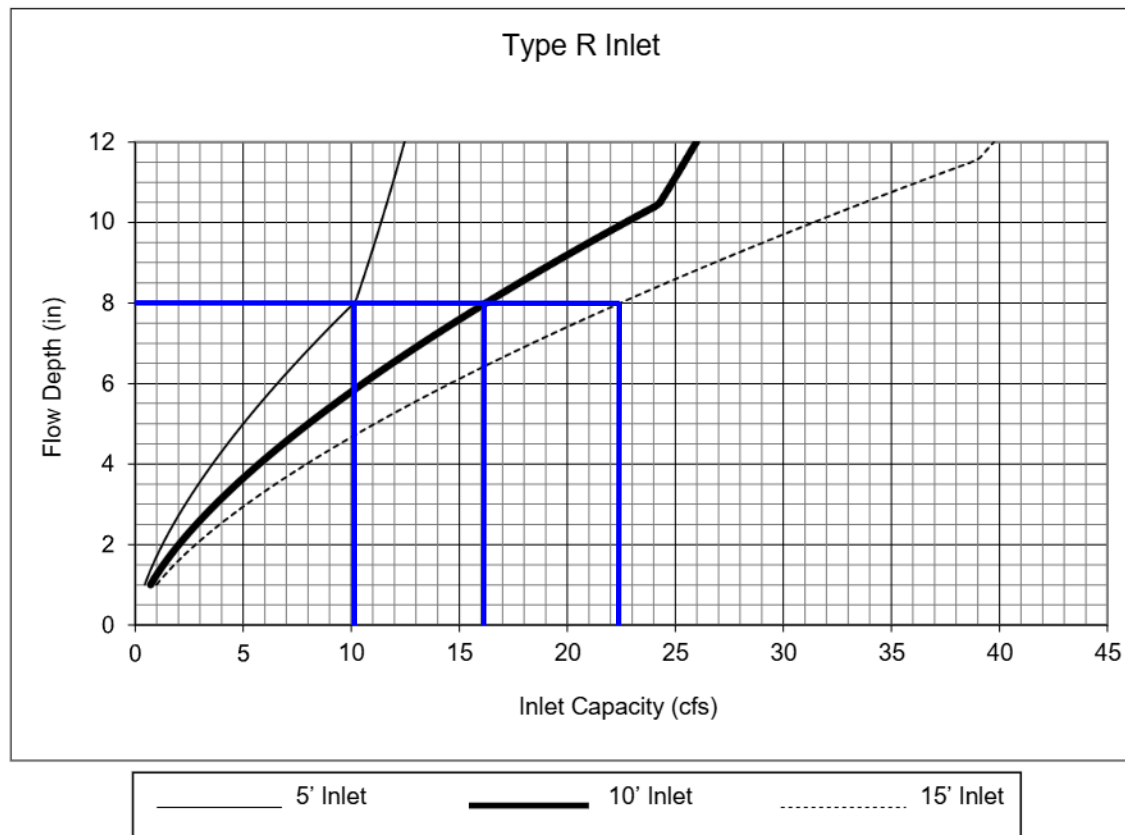

- A 5' inlet has a capacity of 10.1 cfs.
- A 10' inlet has a capacity of 16.0 cfs.
- A 15' inlet has a capacity of 22.5 cfs.
- Combining 5' and 15' inlets would give a capacity of 32.6 cfs for a 20' inlet.

DP 3E (BASIN PR-3E) Q5=8.8 cfs, Q100=20.2 cfs

20' Type R capacity: 32.6 cfs -> Thus, inlet has sufficient capacity.

DP 4 Q5=11.8 cfs, Q100=32.2 cfs

20' Type R capacity: 32.6 cfs -> Thus, inlet has sufficient capacity.

Unresolved:

MHFD Inlet spreadsheet has all inlet types available. Please use that spreadsheet for inlet design of Type R and C inlets .

Notes:

1. The standard inlet parameters must apply to use this chart.

SWALES

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **Platte Self Storage** Location: **Drive Aisles S1 in Basins 3A-3E**
 By: **John F** Date: **11/6/2024**
 Chk By: _____ Date: _____ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

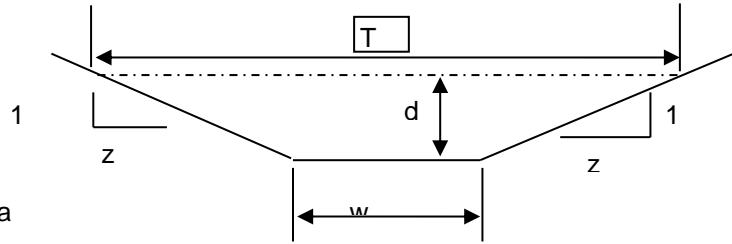

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 14.3
 z (sideslope)= 16
 b (btm width, ft)= 0
 d (depth, ft)= 0.35
 S (slope, ft/ft) 0.01
 n low = 0.013
 n high = 0.013

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.35	1.86	10.63	0.17	3.570899	6.62714	3.570899	6.62714	10.605	0.175

Sc low = 0.0044 Sc high = 0.0044

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0031	0.0057	0.0031	0.0057

Created by: Mike O'Shea

Basins 3A thru 3E flow is split between north of and south of Design Points 3A thru 3E.

Basin 3A Q100=8.9 cfs split =4.5 cfs < 6.63 cfs

Basin 3B Q100=8.9 cfs split =4.5 cfs < 6.63 cfs

Basin 3C Q100=7.8 cfs split =3.9 cfs < 6.63 cfs

Basin 3D Q100=7.8 cfs split =3.9 cfs < 6.63 cfs

Basin 3E Q100=8.1 cfs split =4.1 cfs < 6.63 cfs

Please include back into report design sheet for the swale in the Central Drive Aisle which was in the last submittal.

Which PR-3 Basin? Basins are labeled as PR-3A thru PR-3E.

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **Platte Self Storage** Location: Drive Aisles S2 in Basins PR-3 and PR-4
 By: John F Date: 11/6/2024
 Chk By: Date: version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

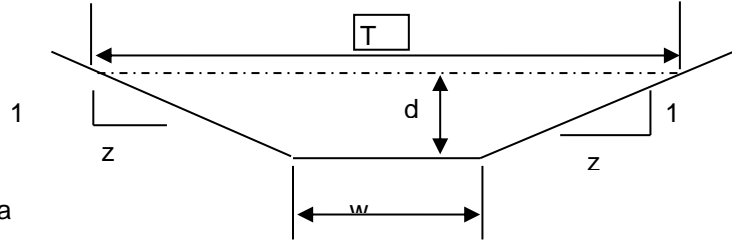

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 50
 z (sideslope)= 50
 b (btm width, ft)= 0
 d (depth, ft)= 0.35
 S (slope, ft/ft) 0.02
 n low = 0.013
 n high = 0.013

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.35	6.13	35.01	0.17	5.05668645	30.9722	5.056686	30.9722	35	0.175

Sc low = 0.0044 Sc high = 0.0044

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0031	0.0057	0.0031	0.0057

Created by: Mike O'Shea

Basin 3 Q100=20.2 cfs < 30.97 cfs

Basin 4 Q100=16.8 cfs < 30.97 cfs

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **Platte Self Storage** Location: **Swale S3 in Basin OS-W**
 By: **John F** Date: **11/6/2024**
 Chk By: _____ Date: _____ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

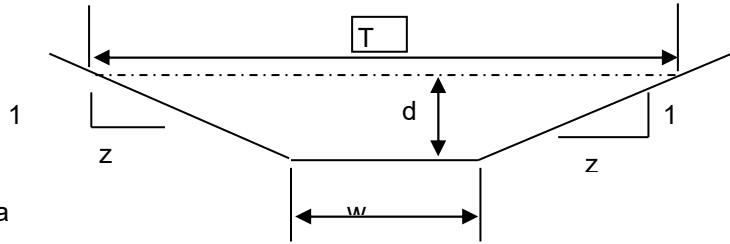

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT	
z (sideslope)=	8
z (sideslope)=	6
b (btm width, ft)=	0
d (depth, ft)=	0.3
S (slope, ft/ft)	0.076
n low =	0.02
n high =	0.03

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.3	0.63	4.24	0.15	5.7426429	3.61787	3.828429	2.41191	4.2	0.150
Sc low =				0.0111	Sc high =		0.0250		
				.7 Sc	1.3 Sc	.7 Sc	1.3 Sc		
				0.0078	0.0144	0.0175	0.0325		

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

Provide a more specific design as it appears velocity could be over allowable.

Created by: Mike O'Shea

Design Point W Q100=1.9 cfs < 2.4 cfs

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **Platte Self Storage** Location: **Swale S4 in Basin PR-5**
 By: **John F** Date: **11/6/2024**
 Chk By: _____ Date: _____ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

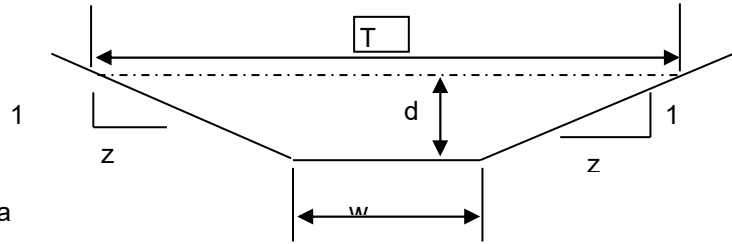

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT	
z (sideslope)=	4
z (sideslope)=	4
b (btm width, ft)=	0
d (depth, ft)=	0.55
S (slope, ft/ft)	0.02
n low =	0.02
n high =	0.03

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.55	1.21	4.54	0.27	4.3544185	5.26885	2.902946	3.51256	4.4	0.275

Sc low = 0.0093 Sc high = 0.0210

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0065	0.0121	0.0147	0.0273

Created by: Mike O'Shea

Design Point 5 Q100=3.3 cfs < 3.5 cfs

SWALE S4 RIP RAP CALCS

Figure 13-12c. Emergency Spillway Protection

Drainage Map has this swale called out as grass. Please verify and update accordingly as to if it is riprap or grass.


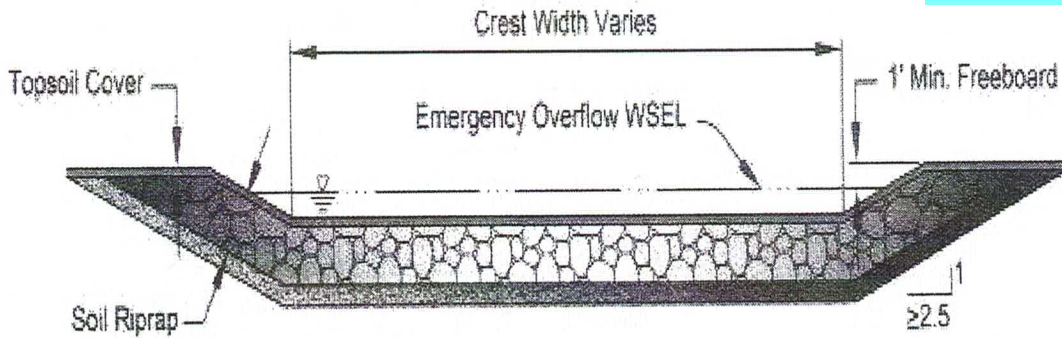


Figure 13-12d. Riprap Types for Emergency Spillway Protection

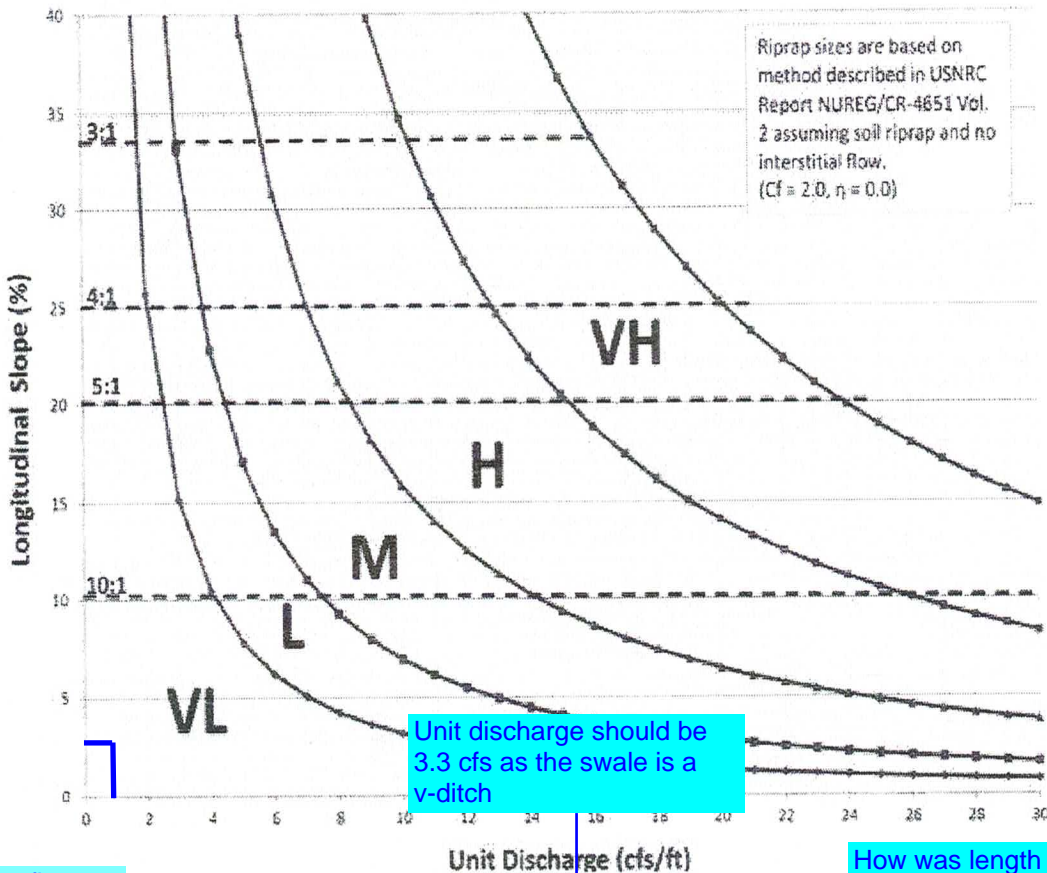

This graph is for the overflow spillways at a pond. Suggest using a riprap rundown spreadsheet instead of this one.

Q100=3.3 CFS
 L=4.4 FT
 UNIT DISCHARGE=0.75
USE TYPE VL D50=6" 8' W x 10' L

How was length and width determined?


CULVERT

CIRCULAR CONDUIT FLOW (Normal & Critical Depth Computation)

Project: **Humphrey Self Storage**

Pipe ID: **18" RCP Culvert**

Include label to indicate which culvert this is.

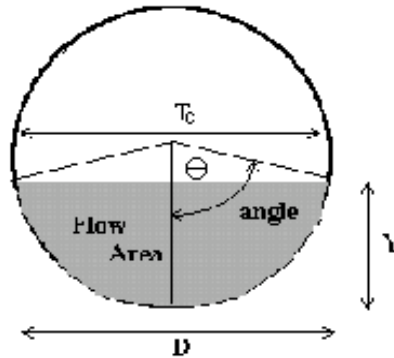

Design Information (Input)

Pipe Invert Slope	So =	0.0220	ft/ft
Pipe Manning's n-value	n =	0.0130	
Pipe Diameter	D =	18.00	inches
Design discharge	Q =	1.30	cfs

Full-flow Capacity (Calculated)

Full-flow area	Af =	1.77	sq ft
Full-flow wetted perimeter	Pf =	4.71	ft
Half Central Angle	Theta =	3.14	radians
Full-flow capacity	Qf =	15.62	cfs

Calculation of Normal Flow Condition

Half Central Angle ($0 < \text{Theta} < 3.14$)	Theta =	0.91	radians
Flow area	An =	0.24	sq ft
Top width	Tn =	1.19	ft
Wetted perimeter	Pn =	1.37	ft
Flow depth	Yn =	0.29	ft
Flow velocity	Vn =	5.36	fps
Discharge	Qn =	1.30	cfs
Percent Full Flow	Flow =	8.3%	of full flow
Normal Depth Froude Number	Fr _n =	2.09	supercritical


Calculation of Critical Flow Condition

Half Central Angle ($0 < \text{Theta-c} < 3.14$)	Theta-c =	1.13	radians
Critical flow area	Ac =	0.41	sq ft
Critical top width	Tc =	1.35	ft
Critical flow depth	Yc =	0.43	ft
Critical flow velocity	Vc =	3.14	fps
Critical Depth Froude Number	Fr _c =	1.00	

Determination of Culvert Headwater and Outlet Protection

Project: **Humphrey Self Storage**

Basin ID: **18" RCP Culvert**

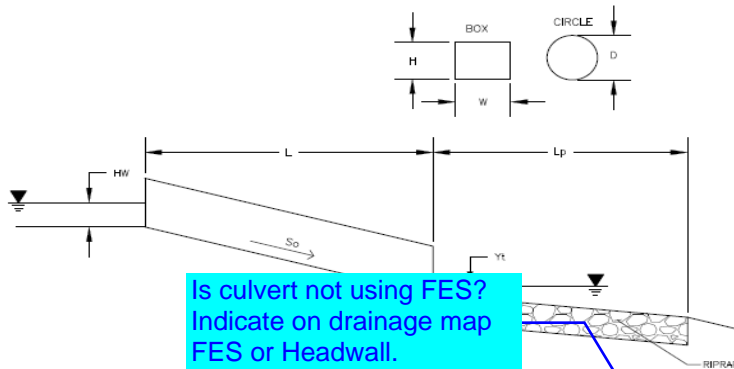

Soil Type:
 Choose One:
 Sandy
 Non-Sandy

Supercritical Flow! Using D_a to calculate protection type.

Design Information (Input):

Design Discharge $Q = 1.3$ cfs

Circular Culvert:
 Barrel Diameter in Inches $D = 18$ inches
 Inlet Edge Type (Choose from pull-down list) Grooved End with Headwall

Box Culvert:
 Barrel Height (Rise) in Feet
 Barrel Width (Span) in Feet
 Inlet Edge Type (Choose from pull-down list)

Number of Barrels $No = 1$
 Inlet Elevation $Elev\ IN = 6240$ ft
 Outlet Elevation **OR** Slope $Elev\ OUT = 6239$ ft
 Culvert Length $L = 46$ ft
 Manning's Roughness $n = 0.013$
 Bend Loss Coefficient $k_b = 0$
 Exit Loss Coefficient $k_x = 1$
 Tailwater Surface Elevation $Elev\ Y_t =$ ft
 Max Allowable Channel Velocity $V = 7$ ft/s

Required Protection (Output):

Tailwater Surface Height $Y_t = 0.60$ ft
 Flow Area at Max Channel Velocity $A_t = 0.19$ ft²
 Culvert Cross Sectional Area Available $A = 1.77$ ft²
 Entrance Loss Coefficient $k_e = 0.20$
 Friction Loss Coefficient $k_f = 0.83$
 Sum of All Losses Coefficients $k_s = 2.03$ ft
 Culvert Normal Depth $Y_n = 0.29$ ft
 Culvert Critical Depth $Y_c = 0.43$ ft

Tailwater Depth for Design $d = 0.96$ ft
 Adjusted Diameter **OR** Adjusted Rise $D_a = 0.90$ ft
 Expansion Factor $1/(2*\tan(\Theta)) = 6.70$
 Flow/Diameter^{2.5} **OR** Flow/(Span * Rise^{1.5}) $Q/D^{2.5} = 0.47$ ft^{0.5}/s
 Froude Number $Fr = 2.08$ Supercritical!
 Tailwater/Adjusted Diameter **OR** Tailwater/Adjusted Rise $Y_t/D = 0.67$


Inlet Control Headwater $HW_i = 0.57$ ft
 Outlet Control Headwater $HW_o = -0.02$ ft
Design Headwater Elevation $HW = 6,240.57$ ft
Headwater/Diameter **OR Headwater/Rise Ratio** $HW/D = 0.38$

Minimum Theoretical Riprap Size $d_{50} = 1$ in
 Nominal Riprap Size $d_{50} = 6$ in
UDFCD Riprap Type $Type = VL$
Length of Protection $L_p = 5$ ft
Width of Protection $T = 3$ ft

Indicate what is being done for supercritical condition. Per criteria, FR # needs to be less than 0.9.

HGL CALCULATIONS

STORM SEWER LAYOUT

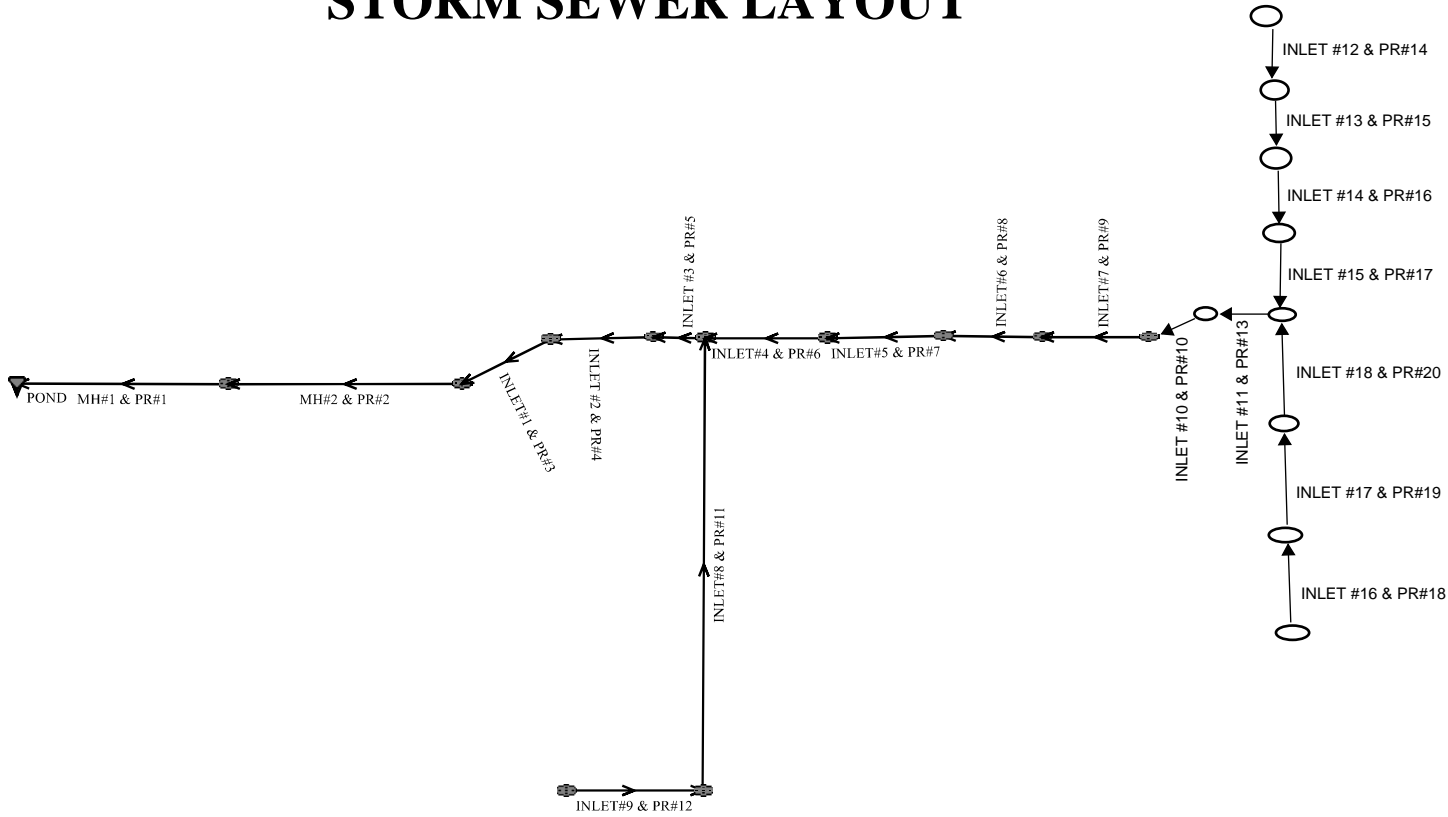

<p>Program: UDSEWER Math Model Interface 2.1.1.4</p> <p>Run Date: 11/7/2024 2:59:57 PM</p>	<h1 style="margin: 0;">UDSewer Results Summary</h1> <p>Project Title: 6001 E Platte Storage - 5 Year Project Description: East System</p> <h2 style="margin: 20px 0 0 0;">5-YEAR</h2>
--	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 5
Rainfall Calculation Method: Formula

One Hour Depth (in): 1.50
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 300
Maximum Urban Overland Len. (ft): 100
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 6.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 3.0

Backwater Calculations:

Tailwater Elevation (ft): 6208.12

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
POND	6211.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MH#1 & PR#1	6220.00	41.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

MH#2 & PR#2	6223.50	41.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#1 & PR#3	6233.50	41.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #2 & PR#4	6234.00	32.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #3 & PR#5	6234.40	32.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#8 & PR#11	6237.45	11.80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#9 & PR#12	6236.85	11.80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#4 & PR#6	6235.60	20.60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#5 & PR#7	6236.80	16.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#6 & PR#8	6238.10	12.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#7 & PR#9	6239.30	8.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#10 & PR#10	6239.85	6.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #11 & PR#13	6250.50	6.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #18 & PR#20	6251.50	2.60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #17 & PR#19	6252.00	2.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #16 & PR#18	6252.50	1.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #15 & PR#17	6251.50	1.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #14 & PR#16	6252.00	0.90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #13 & PR#15	6252.50	0.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #12 & PR#14	6253.00	0.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Manhole Output Summary:

	Local Contribution	Total Design Flow	
--	---------------------------	--------------------------	--

Element Name	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	Comment
POND	0.00	0.00	0.00	0.00	0.00	5.96	6.92	0.15	41.20	
MH#1 & PR#1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	41.20	
MH#2 & PR#2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	41.20	
INLET#1 & PR#3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	41.20	
INLET #2 & PR#4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	32.40	
INLET #3 & PR#5	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	32.40	
INLET#8 & PR#11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	11.80	
INLET#9 & PR#12	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	11.80	
INLET#4 & PR#6	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	20.60	
INLET#5 & PR#7	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	16.50	
INLET#6 & PR#8	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.50	
INLET#7 & PR#9	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.70	
INLET#10 & PR#10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.20	
INLET #11 & PR#13	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.20	
INLET #18 & PR#20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.60	
INLET #17 & PR#19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.00	
INLET #16 & PR#18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	1.20	
INLET #15 & PR#17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	1.70	
INLET #14 & PR#16	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.90	
INLET #13 & PR#15	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.70	
INLET #12 & PR#14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.40	

Sewer Input Summary:

Element Name	Sewer Length (ft)	Elevation			Loss Coefficients			Given Dimensions		
		Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
MH#1 & PR#1	29.50	6205.00	2.7	6205.80	0.013	0.03	0.00	CIRCULAR	48.00 in	48.00 in
MH#2 & PR#2	222.50	6211.11	2.2	6216.00	0.013	0.05	0.00	CIRCULAR	48.00 in	48.00 in
INLET#1 & PR#3	45.00	6216.81	2.2	6217.80	0.013	0.24	0.00	CIRCULAR	42.00 in	42.00 in
INLET #2 & PR#4	24.00	6225.49	1.7	6225.90	0.013	0.24	0.00	CIRCULAR	42.00 in	42.00 in
INLET #3 & PR#5	7.00	6227.00	2.1	6227.15	0.013	0.05	0.00	CIRCULAR	42.00 in	42.00 in
INLET#8 & PR#11	352.00	6227.73	1.0	6231.25	0.013	1.00	0.25	CIRCULAR	36.00 in	36.00 in
INLET#9 & PR#12	31.00	6231.54	1.0	6231.85	0.013	1.00	0.00	CIRCULAR	36.00 in	36.00 in
INLET#4 & PR#6	47.00	6228.15	5.0	6230.50	0.013	0.05	0.00	CIRCULAR	30.00 in	30.00 in
INLET#5 & PR#7	57.00	6230.62	1.9	6231.70	0.013	0.05	0.00	CIRCULAR	30.00 in	30.00 in
INLET#6 & PR#8	62.00	6231.82	1.9	6233.00	0.013	0.05	0.00	CIRCULAR	30.00 in	30.00 in
INLET#7 & PR#9	57.00	6233.62	1.9	6234.70	0.013	0.05	0.00	CIRCULAR	24.00 in	24.00 in
INLET#10 & PR#10	24.00	6234.99	1.7	6235.40	0.013	0.11	0.00	CIRCULAR	24.00 in	24.00 in

INLET #11 & PR#13	32.00	6235.69	1.9	6236.30	0.013	0.11	0.00	CIRCULAR	24.00 in	24.00 in
INLET #18 & PR#20	98.00	6246.72	1.0	6247.70	0.012	1.00	0.00	CIRCULAR	15.00 in	15.00 in
INLET #17 & PR#19	74.00	6247.86	1.0	6248.60	0.012	0.05	0.00	CIRCULAR	15.00 in	15.00 in
INLET #16 & PR#18	74.00	6248.76	1.0	6249.50	0.012	0.05	0.00	CIRCULAR	12.00 in	12.00 in
INLET #15 & PR#17	98.00	6246.32	1.0	6247.30	0.012	1.00	0.00	CIRCULAR	18.00 in	18.00 in
INLET #14 & PR#16	74.00	6247.46	1.0	6248.20	0.012	0.05	0.00	CIRCULAR	15.00 in	15.00 in
INLET #13 & PR#15	74.00	6248.36	1.0	6249.10	0.012	0.05	0.00	CIRCULAR	15.00 in	15.00 in
INLET #12 & PR#14	74.00	6249.26	1.0	6250.00	0.012	0.05	0.00	CIRCULAR	12.00 in	12.00 in

Sewer Flow Summary:

Element Name	Full Flow Capacity		Critical Flow		Normal Flow				Flow (cfs)	Surcharged Length (ft)	Comment
	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition			
MH#1 & PR#1	236.67	18.83	23.00	6.92	13.55	14.14	2.77	Supercritical	41.20	0.00	
MH#2 & PR#2	213.63	17.00	23.00	6.92	14.29	13.14	2.50	Supercritical	41.20	0.00	
INLET#1 & PR#3	149.63	15.55	23.97	7.26	15.06	13.28	2.43	Supercritical	41.20	0.00	
INLET #2 & PR#4	131.53	13.67	21.14	6.68	14.20	11.32	2.15	Supercritical	32.40	0.00	
INLET #3 & PR#5	146.19	15.19	21.14	6.68	13.44	12.21	2.39	Supercritical	32.40	0.00	
INLET#8 & PR#11	66.88	9.46	13.08	5.09	10.24	7.13	1.61	Supercritical	11.80	0.00	
INLET#9 & PR#12	66.88	9.46	13.08	5.09	10.24	7.13	1.61	Supercritical	11.80	0.00	
INLET#4 & PR#6	91.96	18.73	18.50	6.49	9.65	15.10	3.48	Supercritical	20.60	0.00	
INLET#5 & PR#7	56.69	11.55	16.47	5.98	11.08	10.01	2.14	Supercritical	16.50	0.00	
INLET#6 & PR#8	56.69	11.55	14.24	5.44	9.57	9.27	2.15	Supercritical	12.50	0.00	
INLET#7 & PR#9	31.27	9.95	12.62	5.20	8.66	8.52	2.06	Supercritical	8.70	0.00	
INLET#10 & PR#10	29.58	9.41	10.57	4.65	7.46	7.45	1.96	Supercritical	6.20	0.00	

INLET #11 & PR#13	31.27	9.95	10.57	4.65	7.25	7.75	2.07	Supercritical	6.20	0.00	
INLET #18 & PR#20	7.02	5.72	7.75	4.06	6.32	5.29	1.48	Supercritical	2.60	0.00	
INLET #17 & PR#19	7.02	5.72	6.76	3.73	5.48	4.93	1.50	Supercritical	2.00	0.00	
INLET #16 & PR#18	3.87	4.93	5.54	3.38	4.59	4.35	1.44	Supercritical	1.20	0.00	
INLET #15 & PR#17	11.41	6.46	5.88	3.39	4.70	4.64	1.55	Supercritical	1.70	0.00	
INLET #14 & PR#16	7.02	5.72	4.47	2.94	3.63	3.93	1.50	Supercritical	0.90	0.00	
INLET #13 & PR#15	7.02	5.72	3.92	2.74	3.20	3.65	1.49	Supercritical	0.70	0.00	
INLET #12 & PR#14	3.87	4.93	3.14	2.45	2.61	3.18	1.44	Supercritical	0.40	0.00	

- A Froude number of 0 indicates that pressured flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

Element Name	Peak Flow (cfs)	Cross Section	Existing		Calculated		Used			Comment
			Rise	Span	Rise	Span	Rise	Span	Area (ft ²)	
MH#1 & PR#1	41.20	CIRCULAR	48.00 in	48.00 in	27.00 in	27.00 in	48.00 in	48.00 in	12.57	
MH#2 & PR#2	41.20	CIRCULAR	48.00 in	48.00 in	27.00 in	27.00 in	48.00 in	48.00 in	12.57	
INLET#1 & PR#3	41.20	CIRCULAR	42.00 in	42.00 in	27.00 in	27.00 in	42.00 in	42.00 in	9.62	
INLET #2 & PR#4	32.40	CIRCULAR	42.00 in	42.00 in	27.00 in	27.00 in	42.00 in	42.00 in	9.62	
INLET #3 & PR#5	32.40	CIRCULAR	42.00 in	42.00 in	24.00 in	24.00 in	42.00 in	42.00 in	9.62	
INLET#8 & PR#11	11.80	CIRCULAR	36.00 in	36.00 in	21.00 in	21.00 in	36.00 in	36.00 in	7.07	
INLET#9 & PR#12	11.80	CIRCULAR	36.00 in	36.00 in	21.00 in	21.00 in	36.00 in	36.00 in	7.07	
INLET#4 & PR#6	20.60	CIRCULAR	30.00 in	30.00 in	18.00 in	18.00 in	30.00 in	30.00 in	4.91	
INLET#5 & PR#7	16.50	CIRCULAR	30.00 in	30.00 in	21.00 in	21.00 in	30.00 in	30.00 in	4.91	
INLET#6 & PR#8	12.50	CIRCULAR	30.00 in	30.00 in	18.00 in	18.00 in	30.00 in	30.00 in	4.91	
INLET#7 & PR#9	8.70	CIRCULAR	24.00 in	24.00 in	15.00 in	15.00 in	24.00 in	24.00 in	3.14	
INLET#10 & PR#10	6.20	CIRCULAR	24.00 in	24.00 in	15.00 in	15.00 in	24.00 in	24.00 in	3.14	
INLET #11 & PR#13	6.20	CIRCULAR	24.00 in	24.00 in	15.00 in	15.00 in	24.00 in	24.00 in	3.14	
INLET #18 & PR#20	2.60	CIRCULAR	15.00 in	15.00 in	12.00 in	12.00 in	15.00 in	15.00 in	1.23	
INLET #17 & PR#19	2.00	CIRCULAR	15.00 in	15.00 in	12.00 in	12.00 in	15.00 in	15.00 in	1.23	
INLET #16 & PR#18	1.20	CIRCULAR	12.00 in	12.00 in	9.00 in	9.00 in	12.00 in	12.00 in	0.79	
INLET #15 & PR#17	1.70	CIRCULAR	18.00 in	18.00 in	9.00 in	9.00 in	18.00 in	18.00 in	1.77	
INLET #14 & PR#16	0.90	CIRCULAR	15.00 in	15.00 in	9.00 in	9.00 in	15.00 in	15.00 in	1.23	
INLET #13 & PR#15	0.70	CIRCULAR	15.00 in	15.00 in	9.00 in	9.00 in	15.00 in	15.00 in	1.23	

INLET #12 & PR#14	0.40	CIRCULAR	12.00 in	12.00 in	6.00 in	6.00 in	12.00 in	12.00 in	0.79	
-------------------	------	----------	----------	----------	---------	---------	----------	----------	------	--

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 6208.12

Element Name	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
MH#1 & PR#1	6205.00	6205.80	0.00	0.00	6208.12	6209.01	6209.24	0.00	6209.24
MH#2 & PR#2	6211.11	6216.00	0.01	0.00	6212.30	6217.92	6214.98	3.69	6218.66
INLET#1 & PR#3	6216.81	6217.80	0.07	0.00	6218.24	6219.80	6220.16	0.45	6220.62
INLET #2 & PR#4	6225.49	6225.90	0.04	0.00	6226.88	6227.66	6228.18	0.18	6228.35
INLET #3 & PR#5	6227.00	6227.15	0.01	0.00	6228.12	6230.24	6230.44	0.00	6230.44
INLET#8 & PR#11	6227.73	6231.25	0.04	0.17	6230.60	6232.34	6230.65	2.09	6232.74
INLET#9 & PR#12	6231.54	6231.85	0.04	0.00	6232.39	6232.94	6233.18	0.16	6233.34
INLET#4 & PR#6	6228.15	6230.50	0.01	0.00	6230.25	6232.04	6232.50	0.20	6232.69
INLET#5 & PR#7	6230.62	6231.70	0.01	0.00	6232.05	6233.07	6233.10	0.53	6233.63
INLET#6 & PR#8	6231.82	6233.00	0.01	0.00	6233.08	6234.19	6233.95	0.69	6234.65
INLET#7 & PR#9	6233.62	6234.70	0.01	0.00	6234.34	6235.75	6235.47	0.70	6236.17
INLET#10 & PR#10	6234.99	6235.40	0.01	0.00	6235.76	6236.28	6236.48	0.14	6236.62
INLET #11 & PR#13	6235.69	6236.30	0.01	0.00	6236.30	6237.18	6237.23	0.29	6237.52
INLET #18 & PR#20	6246.72	6247.70	0.07	0.00	6247.25	6248.35	6247.68	0.92	6248.60
INLET #17 & PR#19	6247.86	6248.60	0.00	0.00	6248.35	6249.16	6248.69	0.69	6249.38
INLET #16 & PR#18	6248.76	6249.50	0.00	0.00	6249.17	6249.96	6249.44	0.70	6250.14

INLET #15 & PR#17	6246.32	6247.30	0.01	0.00	6246.71	6247.79	6247.04	0.92	6247.97
INLET #14 & PR#16	6247.46	6248.20	0.00	0.00	6247.79	6248.57	6248.00	0.70	6248.71
INLET #13 & PR#15	6248.36	6249.10	0.00	0.00	6248.63	6249.43	6248.83	0.71	6249.54
INLET #12 & PR#14	6249.26	6250.00	0.00	0.00	6249.48	6250.26	6249.63	0.72	6250.35

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * V_{fi} ^ 2/(2*g)
- Lateral loss = V_{fo} ^ 2/(2*g)- Junction Loss K * V_{fi} ^ 2/(2*g).
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft

The minimum trench width is 1.00 ft


Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Downstream			Upstream			Volume (cu. yd)	Comment
					Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)		
MH#1 & PR#1	29.50	5.00	6.00	7.83	8.99	6.91	1.58	25.40	15.12	9.78	136.60	
MH#2 & PR#2	222.50	5.00	6.00	7.83	14.79	9.81	4.48	12.00	8.42	3.08	656.08	
INLET#1 & PR#3	45.00	4.50	6.00	7.25	10.88	7.57	2.82	28.90	16.58	11.83	246.24	
INLET #2 & PR#4	24.00	4.50	6.00	7.25	13.52	8.88	4.13	13.70	8.98	4.23	66.53	
INLET #3 & PR#5	7.00	4.50	6.00	7.25	11.49	7.87	3.12	12.00	8.13	3.38	16.35	
INLET#8 & PR#11	352.00	4.00	6.00	6.67	11.34	7.50	3.34	10.40	7.03	2.87	690.02	
INLET#9 & PR#12	31.00	4.00	6.00	6.67	9.82	6.74	2.58	8.00	5.83	1.67	49.82	
INLET#4 & PR#6	47.00	3.50	6.00	6.08	11.00	7.04	3.46	8.70	5.89	2.31	75.23	
INLET#5 & PR#7	57.00	3.50	6.00	6.08	8.47	5.77	2.19	8.70	5.89	2.31	78.22	
INLET#6 & PR#8	62.00	3.50	6.00	6.08	8.46	5.77	2.19	8.70	5.89	2.31	85.03	
INLET#7 & PR#9	57.00	3.00	4.00	5.50	7.97	5.07	2.23	8.20	5.18	2.35	63.03	
INLET#10 & PR#10	24.00	3.00	4.00	5.50	7.62	4.89	2.06	7.90	5.03	2.20	25.40	
INLET #11 & PR#13	32.00	3.00	4.00	5.50	7.32	4.74	1.91	27.40	14.78	11.95	135.18	
INLET #18 & PR#20	98.00	2.25	4.00	4.63	7.31	4.30	2.34	7.35	4.32	2.36	79.01	
INLET #17 & PR#19	74.00	2.25	4.00	4.63	7.03	4.16	2.20	6.55	3.92	1.96	54.47	
INLET #16 & PR#18	74.00	2.00	4.00	4.33	6.48	3.74	2.07	6.00	3.50	1.83	45.52	
INLET #15 & PR#17	98.00	2.50	4.00	4.92	7.86	4.72	2.47	7.90	4.74	2.49	92.41	

INLET #14 & PR#16	74.00	2.25	4.00	4.63	7.83	4.56	2.60	7.35	4.32	2.36	62.35	
INLET #13 & PR#15	74.00	2.25	4.00	4.63	7.03	4.16	2.20	6.55	3.92	1.96	54.47	
INLET #12 & PR#14	74.00	2.00	4.00	4.33	6.48	3.74	2.07	6.00	3.50	1.83	45.52	


Total earth volume for sewer trenches = 2757 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.
- The sewer wall thickness is equal to: (equivalent diameter in inches/12)+1 inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.


5-YEAR PR 1-13

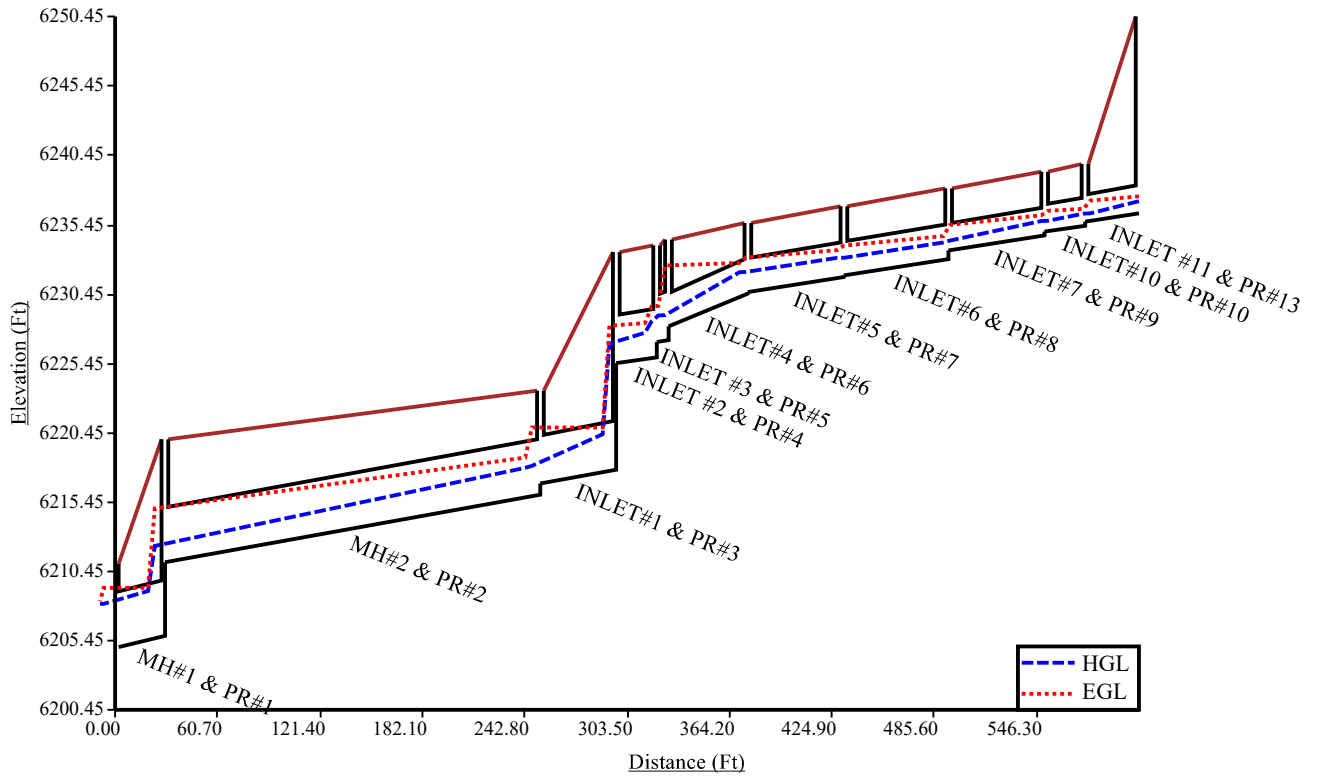


5-YEAR PR 11-12

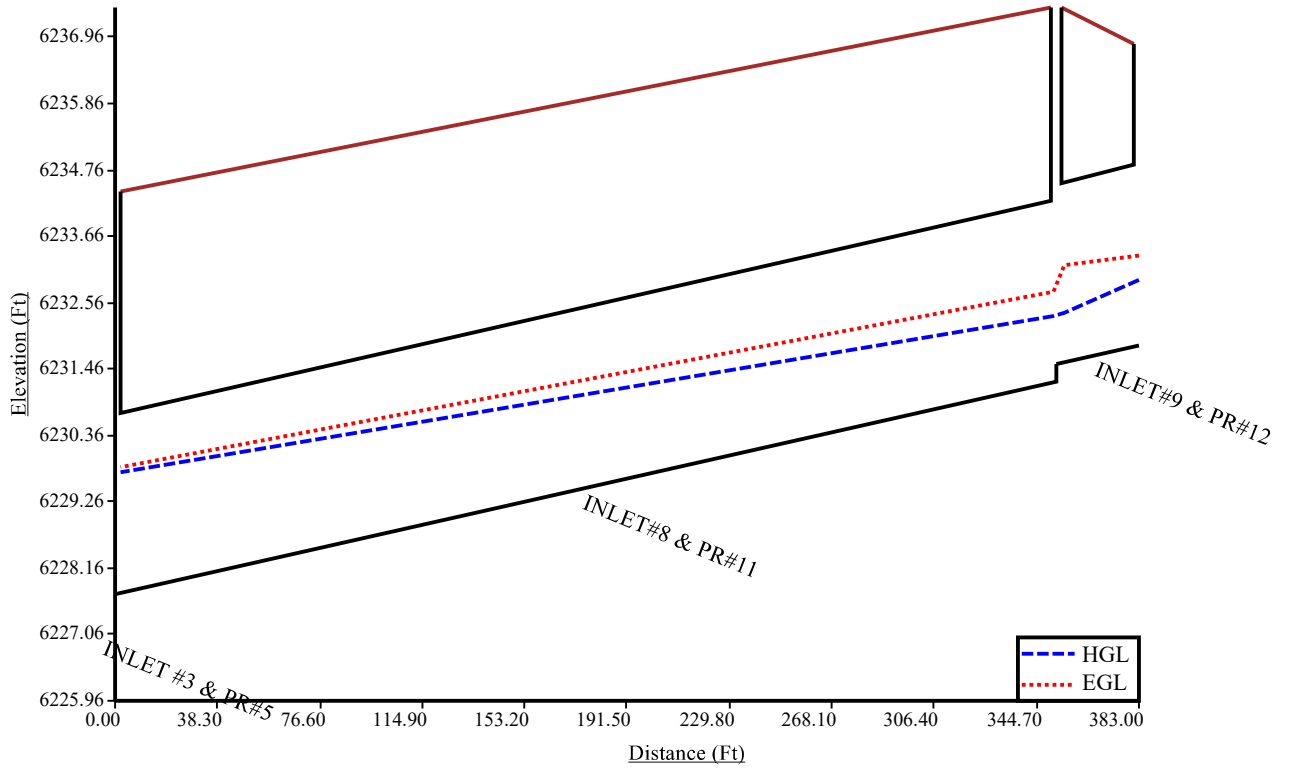

5-YEAR PR 14-17

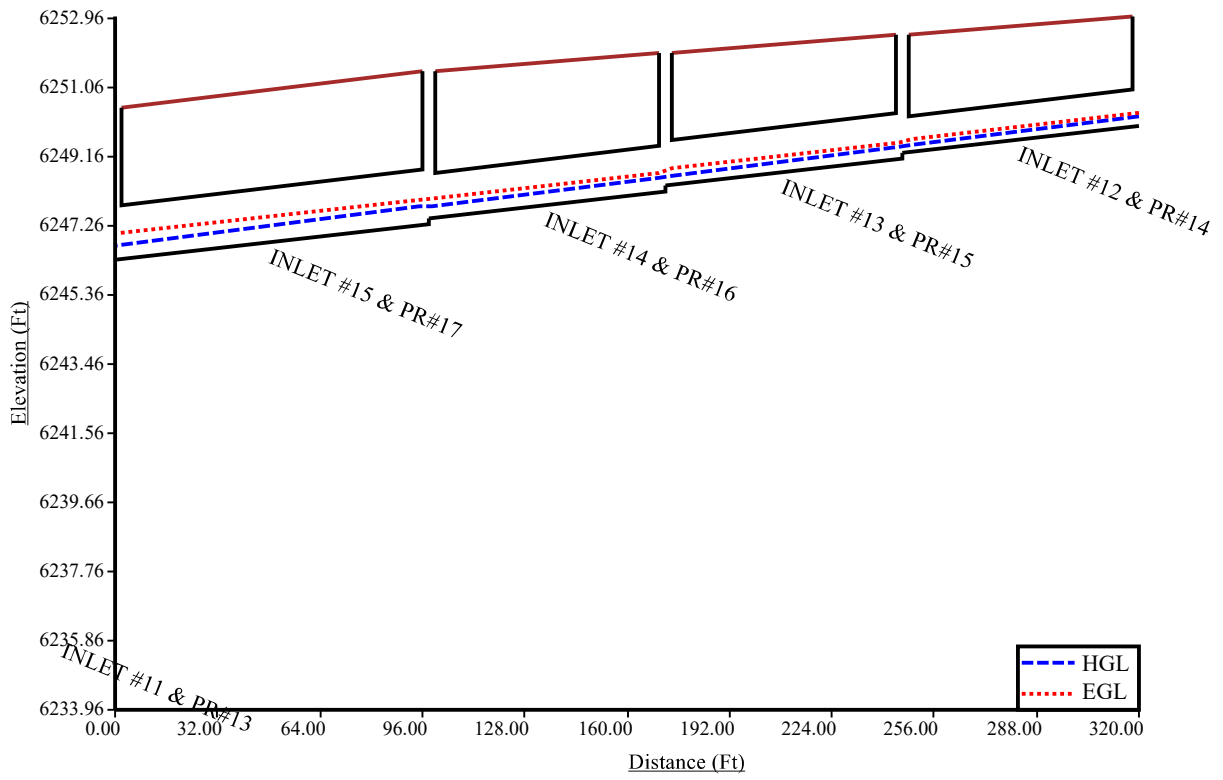

5-YEAR PR 18-20

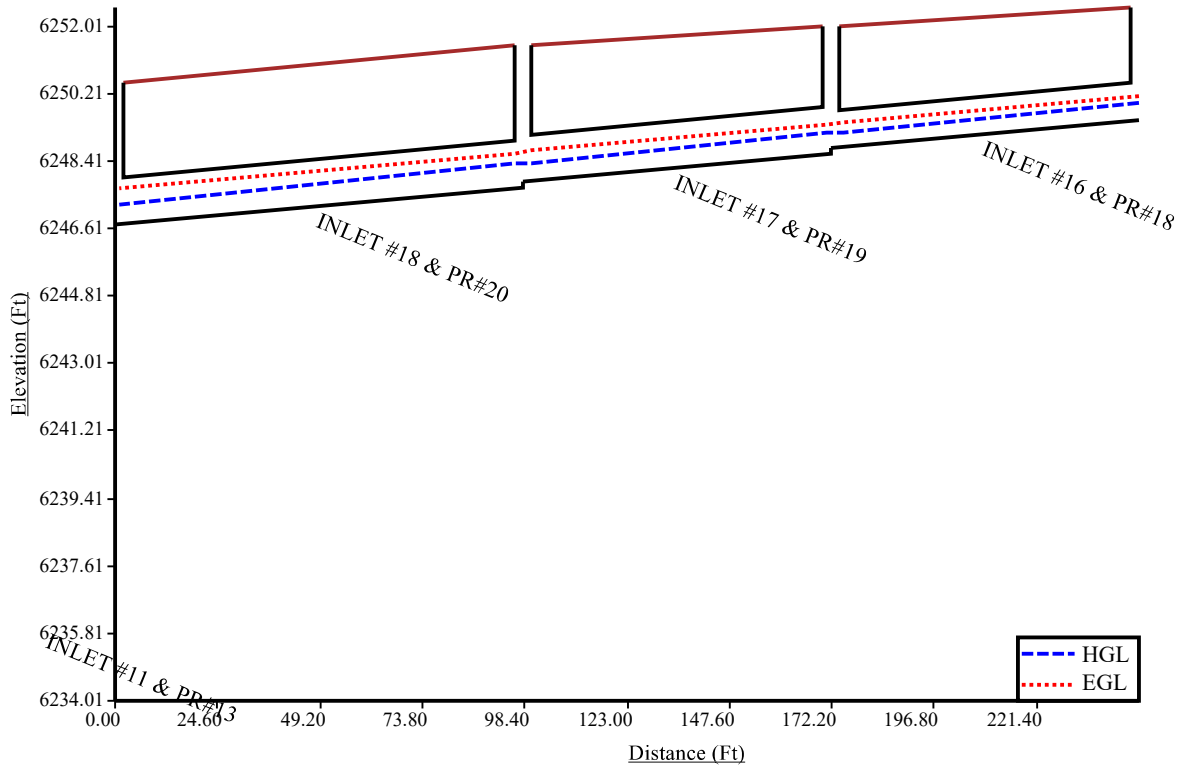

<p>Program: UDSEWER Math Model Interface 2.1.1.4</p> <p>Run Date: 11/7/2024 2:57:55 PM</p>	<h2 style="margin: 0;">UDSewer Results Summary</h2> <p>Project Title: 6001 E Platte Storage - 100 Year Project Description: East System</p> <h1 style="text-align: center; margin-top: 20px;">100-YEAR</h1>
--	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 100
Rainfall Calculation Method: Formula

One Hour Depth (in): 2.52
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 300
Maximum Urban Overland Len. (ft): 100
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 6.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 3.0

Backwater Calculations:

Tailwater Elevation (ft): 6210.54

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
POND	6211.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MH#1 & PR#1	6220.00	91.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

MH#2 & PR#2	6223.50	91.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#1 & PR#3	6233.50	91.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #2 & PR#4	6234.00	71.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #3 & PR#5	6234.40	71.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#8 & PR#11	6237.45	32.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#9 & PR#12	6236.85	32.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#4 & PR#6	6235.60	39.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#5 & PR#7	6236.80	32.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#6 & PR#8	6238.10	26.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#7 & PR#9	6239.30	21.10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET#10 & PR#10	6239.85	17.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #11 & PR#13	6250.50	17.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #18 & PR#20	6251.50	7.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #17 & PR#19	6252.00	5.80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #16 & PR#18	6252.50	3.40	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #15 & PR#17	6251.50	5.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #14 & PR#16	6252.00	2.60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #13 & PR#15	6252.50	1.90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
INLET #12 & PR#14	6253.00	1.30	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Manhole Output Summary:

	Local Contribution	Total Design Flow	
--	---------------------------	--------------------------	--

Element Name	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	Comment
POND	0.00	0.00	0.00	0.00	0.00	7.82	11.69	0.07	91.40	
MH#1 & PR#1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	91.40	
MH#2 & PR#2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	91.40	
INLET#1 & PR#3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	91.40	
INLET #2 & PR#4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	71.20	
INLET #3 & PR#5	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	71.20	
INLET#8 & PR#11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	32.20	
INLET#9 & PR#12	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	32.20	
INLET#4 & PR#6	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	39.00	
INLET#5 & PR#7	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	32.70	
INLET#6 & PR#8	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	26.70	
INLET#7 & PR#9	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	21.10	
INLET#10 & PR#10	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	17.70	
INLET #11 & PR#13	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	17.70	
INLET #18 & PR#20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	7.40	
INLET #17 & PR#19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.80	
INLET #16 & PR#18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.40	
INLET #15 & PR#17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.00	
INLET #14 & PR#16	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.60	
INLET #13 & PR#15	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	1.90	
INLET #12 & PR#14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	1.30	

Sewer Input Summary:

Element Name	Sewer Length (ft)	Elevation			Loss Coefficients			Given Dimensions		
		Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
MH#1 & PR#1	29.50	6205.00	2.7	6205.80	0.013	0.03	0.00	CIRCULAR	48.00 in	48.00 in
MH#2 & PR#2	222.50	6211.11	2.2	6216.00	0.013	0.05	0.00	CIRCULAR	48.00 in	48.00 in
INLET#1 & PR#3	45.00	6216.81	2.2	6217.80	0.013	0.24	0.00	CIRCULAR	42.00 in	42.00 in
INLET #2 & PR#4	24.00	6225.49	1.7	6225.90	0.013	0.24	0.00	CIRCULAR	42.00 in	42.00 in
INLET #3 & PR#5	7.00	6227.00	2.1	6227.15	0.013	0.05	0.00	CIRCULAR	42.00 in	42.00 in
INLET#8 & PR#11	352.00	6227.73	1.0	6231.25	0.013	1.00	0.25	CIRCULAR	36.00 in	36.00 in
INLET#9 & PR#12	31.00	6231.54	1.0	6231.85	0.013	1.00	0.00	CIRCULAR	36.00 in	36.00 in
INLET#4 & PR#6	47.00	6228.15	5.0	6230.50	0.013	0.05	0.00	CIRCULAR	30.00 in	30.00 in
INLET#5 & PR#7	57.00	6230.62	1.9	6231.70	0.013	0.05	0.00	CIRCULAR	30.00 in	30.00 in
INLET#6 & PR#8	62.00	6231.82	1.9	6233.00	0.013	0.05	0.00	CIRCULAR	30.00 in	30.00 in
INLET#7 & PR#9	57.00	6233.62	1.9	6234.70	0.013	0.05	0.00	CIRCULAR	24.00 in	24.00 in
INLET#10 & PR#10	24.00	6234.99	1.7	6235.40	0.013	0.11	0.00	CIRCULAR	24.00 in	24.00 in

INLET #11 & PR#13	32.00	6235.69	1.9	6236.30	0.013	0.11	0.00	CIRCULAR	24.00 in	24.00 in
INLET #18 & PR#20	98.00	6246.72	1.0	6247.70	0.012	1.00	0.00	CIRCULAR	15.00 in	15.00 in
INLET #17 & PR#19	74.00	6247.86	1.0	6248.60	0.012	0.05	0.00	CIRCULAR	15.00 in	15.00 in
INLET #16 & PR#18	74.00	6248.76	1.0	6249.50	0.012	0.05	0.00	CIRCULAR	12.00 in	12.00 in
INLET #15 & PR#17	98.00	6246.32	1.0	6247.30	0.012	1.00	0.00	CIRCULAR	18.00 in	18.00 in
INLET #14 & PR#16	74.00	6247.46	1.0	6248.20	0.012	0.05	0.00	CIRCULAR	15.00 in	15.00 in
INLET #13 & PR#15	74.00	6248.36	1.0	6249.10	0.012	0.05	0.00	CIRCULAR	15.00 in	15.00 in
INLET #12 & PR#14	74.00	6249.26	1.0	6250.00	0.012	0.05	0.00	CIRCULAR	12.00 in	12.00 in

Sewer Flow Summary:

Element Name	Full Flow Capacity		Critical Flow		Normal Flow				Flow (cfs)	Surcharged Length (ft)	Comment
	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition			
MH#1 & PR#1	236.67	18.83	34.78	9.37	20.70	17.62	2.71	Pressurized	91.40	29.50	
MH#2 & PR#2	213.63	17.00	34.78	9.37	21.93	16.34	2.43	Supercritical	91.40	0.00	
INLET#1 & PR#3	149.63	15.55	35.55	10.52	23.71	16.32	2.26	Supercritical	91.40	0.00	
INLET #2 & PR#4	131.53	13.67	31.72	9.13	22.02	13.94	2.03	Supercritical	71.20	0.00	
INLET #3 & PR#5	146.19	15.19	31.72	9.13	20.68	15.09	2.29	Supercritical	71.20	0.00	
INLET#8 & PR#11	66.88	9.46	22.09	7.08	17.61	9.37	1.54	Supercritical Jump	32.20	299.96	
INLET#9 & PR#12	66.88	9.46	22.09	7.08	17.61	9.37	1.54	Supercritical	32.20	0.00	
INLET#4 & PR#6	91.96	18.73	25.28	8.84	13.64	17.96	3.39	Supercritical Jump	39.00	19.82	
INLET#5 & PR#7	56.69	11.55	23.36	7.97	16.35	11.96	2.01	Supercritical	32.70	0.00	
INLET#6 & PR#8	56.69	11.55	21.14	7.22	14.48	11.38	2.07	Supercritical	26.70	0.00	
INLET#7 & PR#9	31.27	9.95	19.74	7.63	14.44	10.68	1.87	Supercritical	21.10	0.00	
INLET#10 & PR#10	29.58	9.41	18.19	6.93	13.38	9.83	1.82	Supercritical	17.70	0.00	

INLET #11 & PR#13	31.27	9.95	18.19	6.93	12.93	10.26	1.94	Supercritical	17.70	0.00	
INLET #18 & PR#20	7.02	5.72	15.00	6.03	15.00	6.03	0.00	Pressurized	7.40	98.00	
INLET #17 & PR#19	7.02	5.72	11.70	5.65	10.40	6.39	1.27	Supercritical Jump	5.80	58.43	
INLET #16 & PR#18	3.87	4.93	9.46	5.12	8.72	5.56	1.18	Supercritical Jump	3.40	14.81	
INLET #15 & PR#17	11.41	6.46	10.32	4.77	8.34	6.24	1.50	Supercritical	5.00	0.00	
INLET #14 & PR#16	7.02	5.72	7.75	4.06	6.32	5.29	1.48	Supercritical	2.60	0.00	
INLET #13 & PR#15	7.02	5.72	6.58	3.67	5.33	4.86	1.50	Supercritical	1.90	0.00	
INLET #12 & PR#14	3.87	4.93	5.78	3.47	4.79	4.44	1.43	Supercritical	1.30	0.00	

- A Froude number of 0 indicates that pressured flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

			Existing		Calculated		Used			
Element Name	Peak Flow (cfs)	Cross Section	Rise	Span	Rise	Span	Rise	Span	Area (ft ²)	Comment
MH#1 & PR#1	91.40	CIRCULAR	48.00 in	48.00 in	36.00 in	36.00 in	48.00 in	48.00 in	12.57	
MH#2 & PR#2	91.40	CIRCULAR	48.00 in	48.00 in	36.00 in	36.00 in	48.00 in	48.00 in	12.57	
INLET#1 & PR#3	91.40	CIRCULAR	42.00 in	42.00 in	36.00 in	36.00 in	42.00 in	42.00 in	9.62	
INLET #2 & PR#4	71.20	CIRCULAR	42.00 in	42.00 in	36.00 in	36.00 in	42.00 in	42.00 in	9.62	
INLET #3 & PR#5	71.20	CIRCULAR	42.00 in	42.00 in	33.00 in	33.00 in	42.00 in	42.00 in	9.62	
INLET#8 & PR#11	32.20	CIRCULAR	36.00 in	36.00 in	30.00 in	30.00 in	36.00 in	36.00 in	7.07	
INLET#9 & PR#12	32.20	CIRCULAR	36.00 in	36.00 in	30.00 in	30.00 in	36.00 in	36.00 in	7.07	
INLET#4 & PR#6	39.00	CIRCULAR	30.00 in	30.00 in	24.00 in	24.00 in	30.00 in	30.00 in	4.91	
INLET#5 & PR#7	32.70	CIRCULAR	30.00 in	30.00 in	27.00 in	27.00 in	30.00 in	30.00 in	4.91	
INLET#6 & PR#8	26.70	CIRCULAR	30.00 in	30.00 in	24.00 in	24.00 in	30.00 in	30.00 in	4.91	
INLET#7 & PR#9	21.10	CIRCULAR	24.00 in	24.00 in	21.00 in	21.00 in	24.00 in	24.00 in	3.14	

INLET#10 & PR#10	17.70	CIRCULAR	24.00 in	24.00 in	21.00 in	21.00 in	24.00 in	24.00 in	3.14	
INLET #11 & PR#13	17.70	CIRCULAR	24.00 in	24.00 in	21.00 in	21.00 in	24.00 in	24.00 in	3.14	
INLET #18 & PR#20	7.40	CIRCULAR	15.00 in	15.00 in	18.00 in	18.00 in	15.00 in	15.00 in	1.23	Existing height is smaller than the suggested height. Existing width is smaller than the suggested width. Exceeds max. Depth/Rise
INLET #17 & PR#19	5.80	CIRCULAR	15.00 in	15.00 in	15.00 in	15.00 in	15.00 in	15.00 in	1.23	
INLET #16 & PR#18	3.40	CIRCULAR	12.00 in	12.00 in	12.00 in	12.00 in	12.00 in	12.00 in		Address this comment
INLET #15 & PR#17	5.00	CIRCULAR	18.00 in	18.00 in	15.00 in	15.00 in	18.00 in	18.00 in	1.77	
INLET #14 & PR#16	2.60	CIRCULAR	15.00 in	15.00 in	12.00 in	12.00 in	15.00 in	15.00 in	1.23	
INLET #13 & PR#15	1.90	CIRCULAR	15.00 in	15.00 in	12.00 in	12.00 in	15.00 in	15.00 in	1.23	
INLET #12 & PR#14	1.30	CIRCULAR	12.00 in	12.00 in	9.00 in	9.00 in	12.00 in	12.00 in	0.79	

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 6210.54

Element Name	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
MH#1 & PR#1	6205.00	6205.80	0.00	0.00	6210.54	6210.66	6211.36	0.12	6211.48
MH#2 & PR#2	6211.11	6216.00	0.04	0.00	6212.93	6218.90	6217.08	3.18	6220.26
INLET#1 & PR#3	6216.81	6217.80	0.34	0.00	6219.23	6221.52	6222.92	0.00	6222.92
INLET #2 & PR#4	6225.49	6225.90	0.20	0.00	6227.33	6229.49	6230.34	0.00	6230.34

INLET #3 & PR#5	6227.00	6227.15	0.04	0.00	6229.54	6231.41	6232.26	0.00	6232.26
INLET#8 & PR#11	6227.73	6231.25	0.32	0.77	6233.03	6233.59	6233.36	0.70	6234.05
INLET#9 & PR#12	6231.54	6231.85	0.32	0.00	6233.93	6233.93	6234.37	0.15	6234.52
INLET#4 & PR#6	6228.15	6230.50	0.05	0.00	6231.46	6232.61	6232.44	1.38	6233.82
INLET#5 & PR#7	6230.62	6231.70	0.03	0.00	6232.64	6233.65	6234.20	0.43	6234.63
INLET#6 & PR#8	6231.82	6233.00	0.02	0.00	6233.67	6234.76	6235.04	0.53	6235.57
INLET#7 & PR#9	6233.62	6234.70	0.04	0.00	6234.82	6236.34	6236.59	0.66	6237.25
INLET#10 & PR#10	6234.99	6235.40	0.05	0.00	6236.40	6236.92	6237.61	0.05	6237.66
INLET #11 & PR#13	6235.69	6236.30	0.05	0.00	6236.97	6237.82	6238.40	0.16	6238.56
INLET #18 & PR#20	6246.72	6247.70	0.56	0.00	6247.97	6249.06	6248.53	1.09	6249.62
INLET #17 & PR#19	6247.86	6248.60	0.02	0.00	6249.30	6249.57	6249.64	0.43	6250.07
INLET #16 & PR#18	6248.76	6249.50	0.01	0.00	6249.79	6250.29	6250.08	0.61	6250.70
INLET #15 & PR#17	6246.32	6247.30	0.12	0.00	6247.01	6248.16	6247.62	0.89	6248.51
INLET #14 & PR#16	6247.46	6248.20	0.00	0.00	6248.41	6248.85	6248.52	0.59	6249.10
INLET #13 & PR#15	6248.36	6249.10	0.00	0.00	6248.85	6249.65	6249.17	0.69	6249.86
INLET #12 & PR#14	6249.26	6250.00	0.00	0.00	6249.66	6250.48	6249.97	0.70	6250.67

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * V_{fi} ^ 2/(2*g)
- Lateral loss = V_{fo} ^ 2/(2*g)- Junction Loss K * V_{fi} ^ 2/(2*g).
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft

The minimum trench width is 1.00 ft


Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Downstream			Upstream			Volume (cu. yd)	Comment
					Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)		
MH#1 & PR#1	29.50	5.00	6.00	7.83	8.99	6.91	1.58	25.40	15.12	9.78	136.60	

MH#2 & PR#2	222.50	5.00	6.00	7.83	14.79	9.81	4.48	12.00	8.42	3.08	656.08	
INLET#1 & PR#3	45.00	4.50	6.00	7.25	10.88	7.57	2.82	28.90	16.58	11.83	246.24	
INLET #2 & PR#4	24.00	4.50	6.00	7.25	13.52	8.88	4.13	13.70	8.98	4.23	66.53	
INLET #3 & PR#5	7.00	4.50	6.00	7.25	11.49	7.87	3.12	12.00	8.13	3.38	16.35	
INLET#8 & PR#11	352.00	4.00	6.00	6.67	11.34	7.50	3.34	10.40	7.03	2.87	690.02	
INLET#9 & PR#12	31.00	4.00	6.00	6.67	9.82	6.74	2.58	8.00	5.83	1.67	49.82	
INLET#4 & PR#6	47.00	3.50	6.00	6.08	11.00	7.04	3.46	8.70	5.89	2.31	75.23	
INLET#5 & PR#7	57.00	3.50	6.00	6.08	8.47	5.77	2.19	8.70	5.89	2.31	78.22	
INLET#6 & PR#8	62.00	3.50	6.00	6.08	8.46	5.77	2.19	8.70	5.89	2.31	85.03	
INLET#7 & PR#9	57.00	3.00	4.00	5.50	7.97	5.07	2.23	8.20	5.18	2.35	63.03	
INLET#10 & PR#10	24.00	3.00	4.00	5.50	7.62	4.89	2.06	7.90	5.03	2.20	25.40	
INLET #11 & PR#13	32.00	3.00	4.00	5.50	7.32	4.74	1.91	27.40	14.78	11.95	135.18	
INLET #18 & PR#20	98.00	2.25	4.00	4.63	7.31	4.30	2.34	7.35	4.32	2.36	79.01	
INLET #17 & PR#19	74.00	2.25	4.00	4.63	7.03	4.16	2.20	6.55	3.92	1.96	54.47	
INLET #16 & PR#18	74.00	2.00	4.00	4.33	6.48	3.74	2.07	6.00	3.50	1.83	45.52	
INLET #15 & PR#17	98.00	2.50	4.00	4.92	7.86	4.72	2.47	7.90	4.74	2.49	92.41	
INLET #14 & PR#16	74.00	2.25	4.00	4.63	7.83	4.56	2.60	7.35	4.32	2.36	62.35	
INLET #13 & PR#15	74.00	2.25	4.00	4.63	7.03	4.16	2.20	6.55	3.92	1.96	54.47	
INLET #12 & PR#14	74.00	2.00	4.00	4.33	6.48	3.74	2.07	6.00	3.50	1.83	45.52	


Total earth volume for sewer trenches = 2757 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.
- The sewer wall thickness is equal to: $(\text{equivalent diameter in inches}/12)+1$ inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.


100-YEAR PR 1 - PR 13

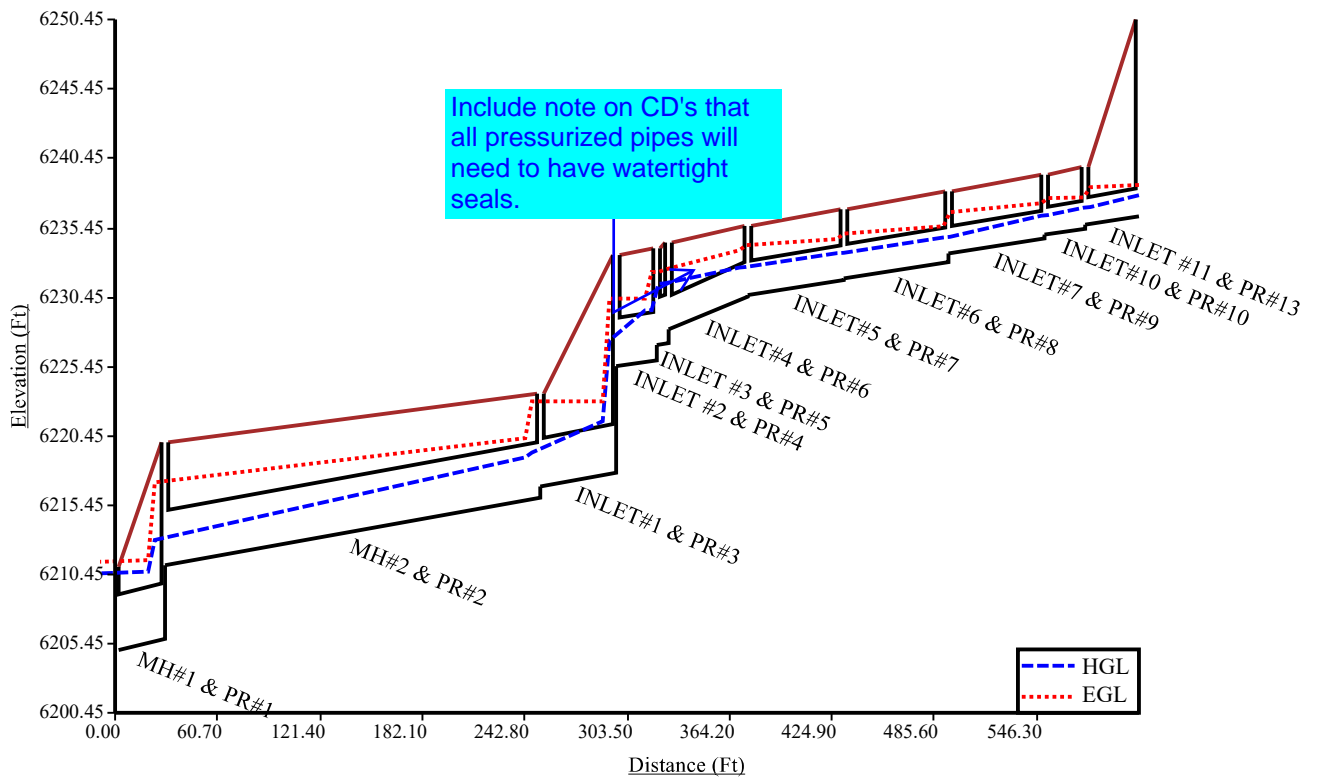


100-YEAR PR 11-12

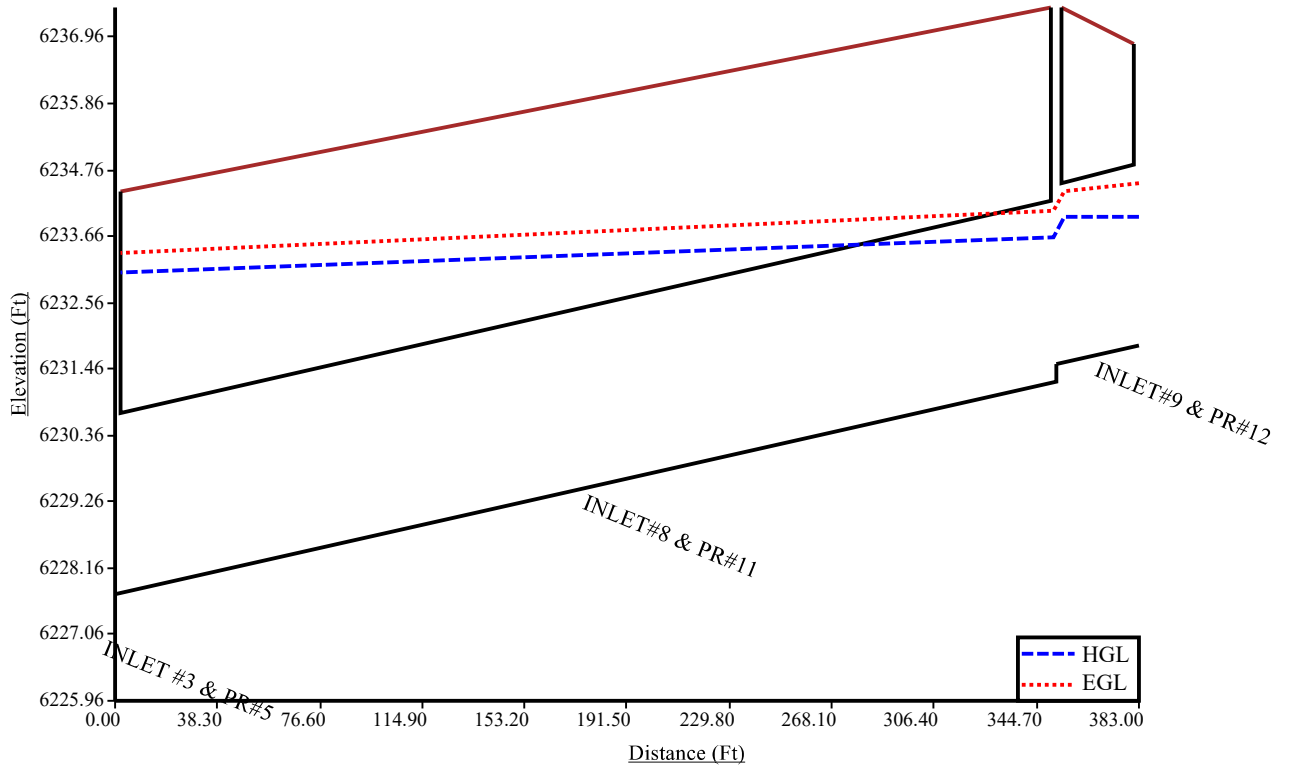

100-YEAR PR 14-17

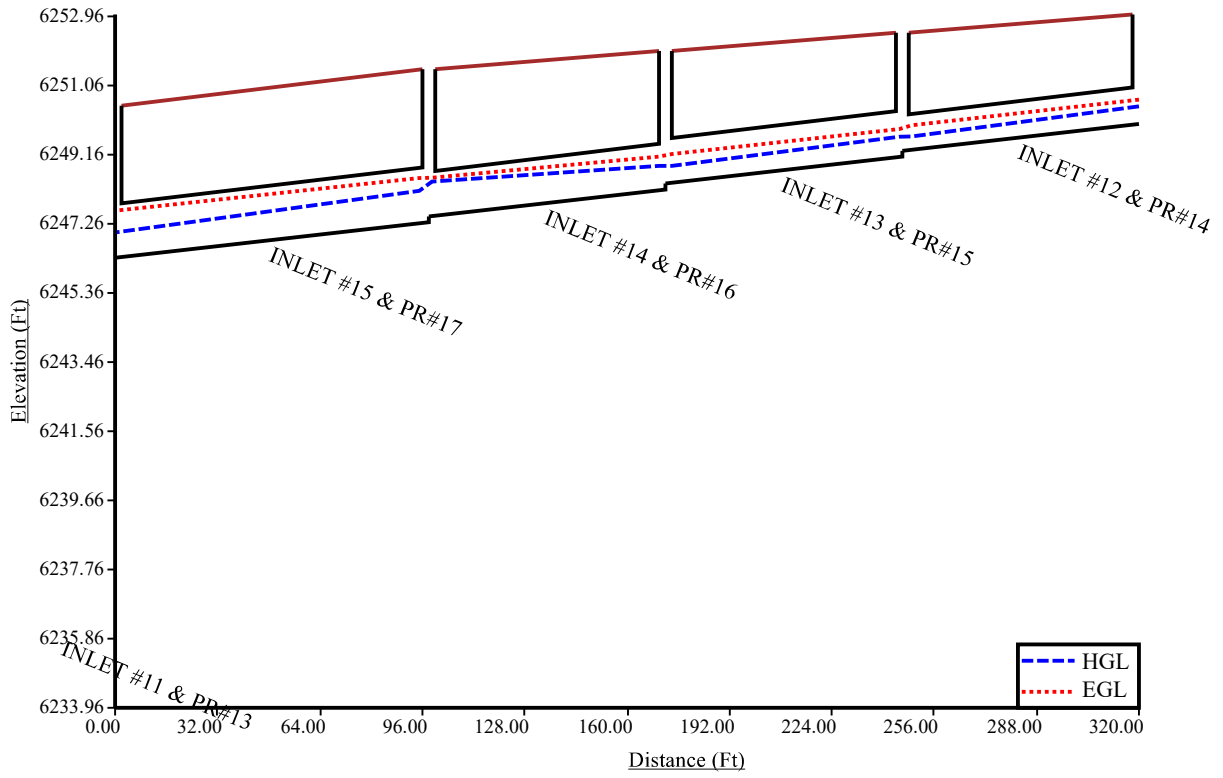

100-YEAR PR 18-20

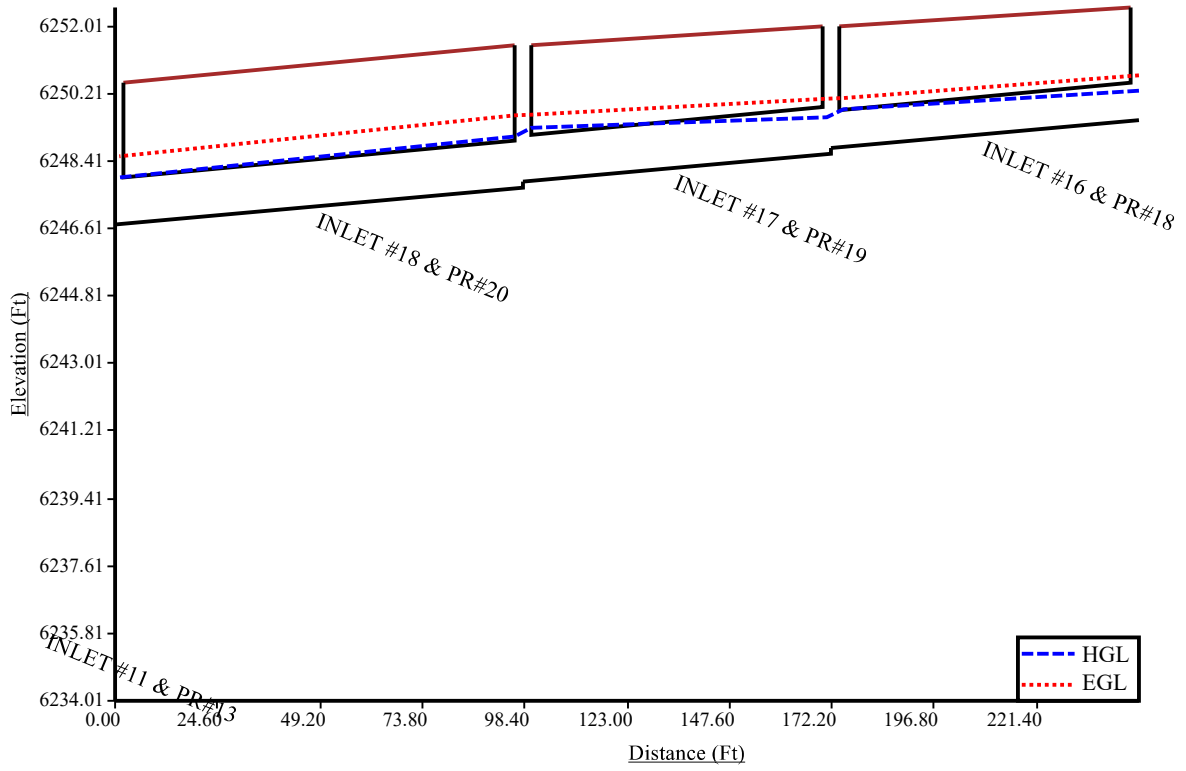

POND OUTLET



<p>Program: UDSEWER Math Model Interface 2.1.1.4</p> <p>Run Date: 11/7/2024 9:53:20 AM</p>	<h1 style="margin: 0;">UDSewer Results Summary</h1> <p>Project Title: 6001 E Platte Storage - 5 Year Project Description: Pond Outlet System</p> <h2 style="margin: 20px 0 0 0;">5-YEAR</h2>
--	--

System Input Summary

Rainfall Parameters

Rainfall Return Period: 5
Rainfall Calculation Method: Formula

One Hour Depth (in): 1.50
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 300
Maximum Urban Overland Len. (ft): 100
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 6.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 3.0

Backwater Calculations:

Tailwater Elevation (ft): 6202.50

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
STILLING BASIN	6201.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

POND OUTLET & PR#90	6209.00	0.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
---------------------	---------	------	------	------	------	------	------	------	------	------

Manhole Output Summary:

Element Name	Local Contribution					Total Design Flow				Comment
	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	
STILLING BASIN	0.00	0.00	0.00	0.00	0.00	0.11	6.22	1.63	0.70	Surface Water Present (Upstream)
POND OUTLET & PR#90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.70	Surface Water Present (Downstream)

Sewer Input Summary:

Element Name	Sewer Length (ft)	Elevation			Loss Coefficients			Given Dimensions		
		Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
POND OUTLET & PR#90	38.63	6201.00	1.3	6201.50	0.012	0.03	0.00	CIRCULAR	18.00 in	18.00 in

Sewer Flow Summary:

Element Name	Full Flow Capacity		Critical Flow		Normal Flow				Flow (cfs)	Surcharged Length (ft)	Comment
	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition			
POND OUTLET & PR#90	13.01	7.36	3.73	2.65	2.84	3.92	1.71	Supercritical Jump	0.70	0.17	

- A Froude number of 0 indicates that pressured flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

Element Name	Peak Flow (cfs)	Cross Section	Existing		Calculated		Used			Comment
			Rise	Span	Rise	Span	Rise	Span	Area (ft^2)	
POND OUTLET & PR#90	0.70	CIRCULAR	18.00 in	18.00 in	9.00 in	9.00 in	18.00 in	18.00 in	1.77	

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 6202.50

Element Name	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
POND OUTLET & PR#90	6201.00	6201.50	0.00	0.00	6202.50	6202.50	6202.50	0.00	6202.50

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * V_{fi} ^ 2 / (2 * g)
- Lateral loss = V_{fo} ^ 2 / (2 * g) - Junction Loss K * V_{fi} ^ 2 / (2 * g).
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft


The minimum trench width is 1.00 ft

Element Name	Length (ft)	Wall (in)	Bedding (in)	Downstream				Upstream			Volume (cu. yd)	Comment
				Bottom Width (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)		
POND OUTLET & PR#90	38.63	2.50	4.00	4.92	0.00	0.54	0.00	14.50	8.04	5.79	46.62	Sewer Too Shallow

Total earth volume for sewer trenches = 47 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.
- The sewer wall thickness is equal to: (equivalent diameter in inches / 12) + 1 inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.

5-YEAR Pond Outlet

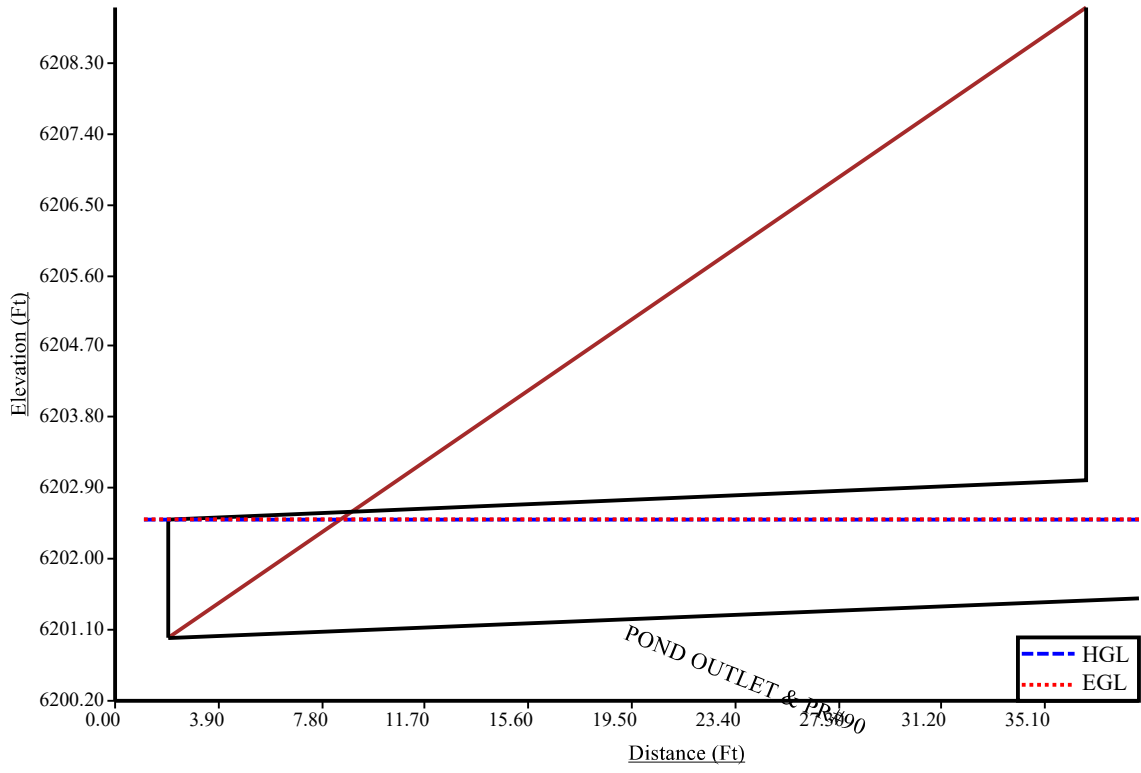

Program: UDSEWER Math Model Interface 2.1.1.4 Run Date: 11/7/2024 9:57:43 AM	<h1 style="margin: 0;">UDSewer Results Summary</h1> <p style="margin: 5px 0;">Project Title: 6001 E Platte Storage - 100 Year</p> <p style="margin: 5px 0;">Project Description: Pond Outlet System</p> <h2 style="margin: 20px 0 0 0;">100-YEAR</h2>
--	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 100
Rainfall Calculation Method: Formula

One Hour Depth (in): 2.52
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 300
Maximum Urban Overland Len. (ft): 100
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 6.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 3.0

Backwater Calculations:

Tailwater Elevation (ft): 6202.50

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
STILLING BASIN	6201.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

POND OUTLET & PR#90	6209.00	21.60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
---------------------------	---------	-------	------	------	------	------	------	------	------	------

Manhole Output Summary:

Element Name	Local Contribution					Total Design Flow				Comment
	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	
STILLING BASIN	0.00	0.00	0.00	0.00	0.00	1.85	11.71	0.05	21.60	Surface Water Present (Upstream)
POND OUTLET & PR#90	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	21.60	Surface Water Present (Downstream)

Sewer Input Summary:

Element Name	Sewer Length (ft)	Elevation			Loss Coefficients			Given Dimensions		
		Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
POND OUTLET & PR#90	38.63	6201.00	1.3	6201.50	0.012	0.03	0.00	CIRCULAR	18.00 in	18.00 in

Sewer Flow Summary:

Element Name	Full Flow Capacity		Critical Flow		Normal Flow				Flow (cfs)	Surcharged Length (ft)	Comment
	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition			
POND OUTLET & PR#90	13.01	7.36	18.00	12.22	18.00	12.22	0.00	Pressurized	21.60	38.63	

- A Froude number of 0 indicates that pressured flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

Element Name	Peak Flow (cfs)	Cross Section	Existing		Calculated		Used			Comment
			Rise	Span	Rise	Span	Rise	Span	Area (ft^2)	

POND OUTLET & PR#90	21.60	CIRCULAR	18.00 in	18.00 in	24.00 in	24.00 in	18.00 in	18.00 in	1.77	Existing height is smaller than the suggested height. Existing width is smaller than the suggested width. Exceeds max. Depth/Rise
---------------------	-------	----------	----------	----------	----------	----------	----------	----------	------	---

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 6202.50

Element Name	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
POND OUTLET & PR#90	6201.00	6201.50	0.00	0.00	6202.50	6203.88	6204.82	1.38	6206.20

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * V_{fi} ^ 2 / (2 * g)
- Lateral loss = V_{fo} ^ 2 / (2 * g) - Junction Loss K * V_{fi} ^ 2 / (2 * g).
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft


The minimum trench width is 1.00 ft

Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Downstream			Upstream			Volume (cu. yd)	Comment
					Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)		
POND OUTLET & PR#90	38.63	2.50	4.00	4.92	0.00	0.54	0.00	14.50	8.04	5.79	46.62	Sewer Too Shallow

Total earth volume for sewer trenches = 47 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.

100-YEAR Pond Outlet

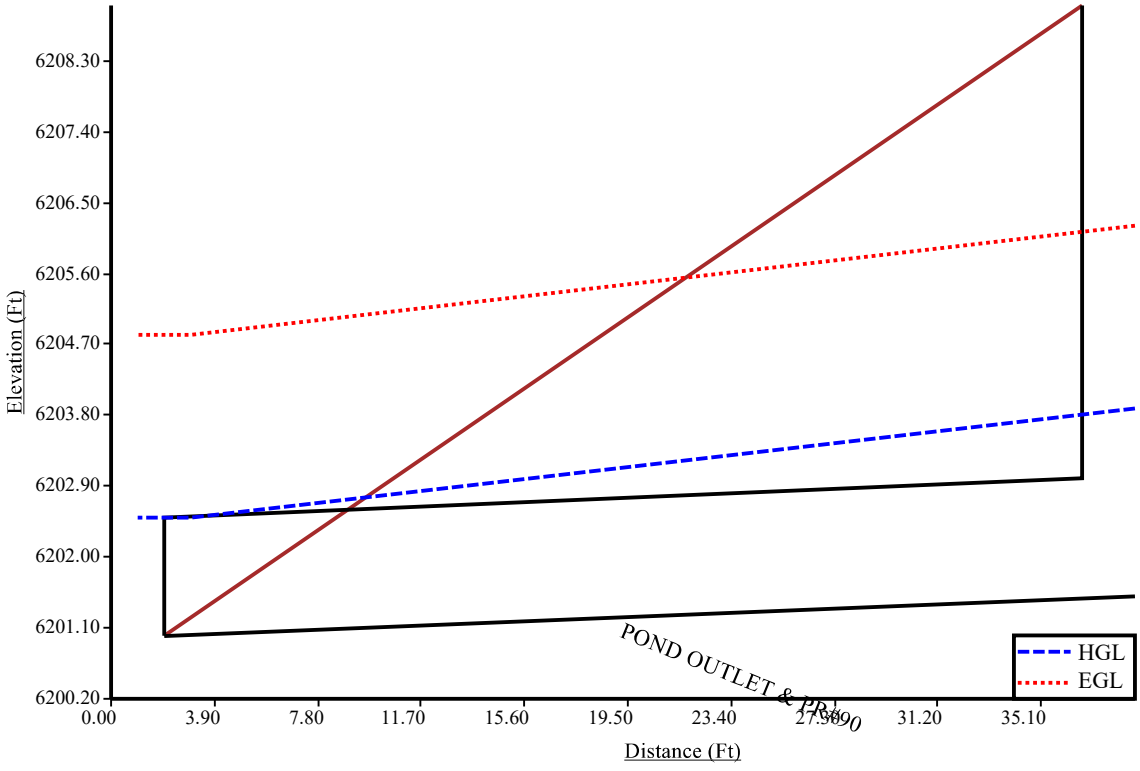

DETENTION CALCULATIONS


PLATTE SELF STORAGE SURFACE ROUTING SUMMARY

Water Quality Treatment Summary Table

Basin ID	Total Area	Total Proposed Disturbed Area	Area Trib to Pond 1	Disturbed Area Treated via Runoff Reduction	Disturbed Area Excluded from WQ per ECM App I.7.1.C.1	Disturbed Area Excluded from WQ per ECM App I.7.1.B.#	Applicable WQ Exclusions (App I.7.1.B.#)
	(ac)	(ac)	(ac)	(ac)	(ac)	(ac)	
OS-ZA	0.44	-	0.44	-	-	-	-
OS-ZB	0.22	-	0.22	-	-	-	-
OS-ZC	0.23	-	0.23	-	-	-	-
OS-ZD	0.86	-	0.86	-	-	-	-
OS-ZE	1.94	-	1.94	-	-	-	-
OS-ZF	0.56	-	0.56	-	-	-	-
OS-ZG	0.85	-	0.85	-	-	-	-
OS-ZH	1.24	-	1.24	-	-	-	-
OS-Y	8.15	-	8.15	-	-	-	-
OS-X	1.20	-	-	-	-	-	-
OS-W	0.45	0.45	-	-	0.45	-	-
PR-1	0.07	0.07	-	-	-	0.07	I.7.1.B.7
PR-2	0.13	0.13	-	-	-	0.13	I.7.1.B.7
PR-3A	1.10	1.10	1.10	-	-	-	-
PR-3B	1.11	1.11	1.11	-	-	-	-
PR-3C	0.96	0.96	0.96	-	-	-	-
PR-3D	0.97	0.97	0.97	-	-	-	-
PR-3E	1.01	1.01	1.01	-	-	-	-
PR-4	3.66	3.66	3.66	-	-	-	-
PR-5	0.56	0.56	-	-	0.55	0.01	I.7.1.B.7
PR-6	6.64	6.64	6.64	-	-	-	-
PR-7	0.34	0.34	-	-	-	0.34	I.7.1.B.7
PR-8	0.30	0.30	-	-	-	0.30	I.7.1.B.7
PR-9	0.59	0.59	-	-	-	0.59	I.7.1.B.7
PR-10A	0.06	0.06	0.06	-	-	-	-
PR-10B	0.03	0.03	0.03	-	-	-	-
PR-10C	0.04	0.04	0.04	-	-	-	-
PR-10D	0.04	0.04	0.04	-	-	-	-
PR-10E	0.09	0.09	0.09	-	-	-	-
PR-10F	0.04	0.04	0.04	-	-	-	-
PR-10G	0.05	0.05	0.05	-	-	-	-
PR-10H	0.06	0.06	0.06	-	-	-	-
TOTALS			30.33		1.00	1.44	
BASINS TRIB TO POND IN FUTURE PR-5, PR-9 & OS-X			2.35				Calc: DLF
AREA TRIB FOR POND DESIGN			32.68				Date: 11/8/2024
							Checked: JS

DETENTION BASIN STAGE-STORAGE TABLE BUILDER


MHFD-Detention, Version 4.04 (February 2021)

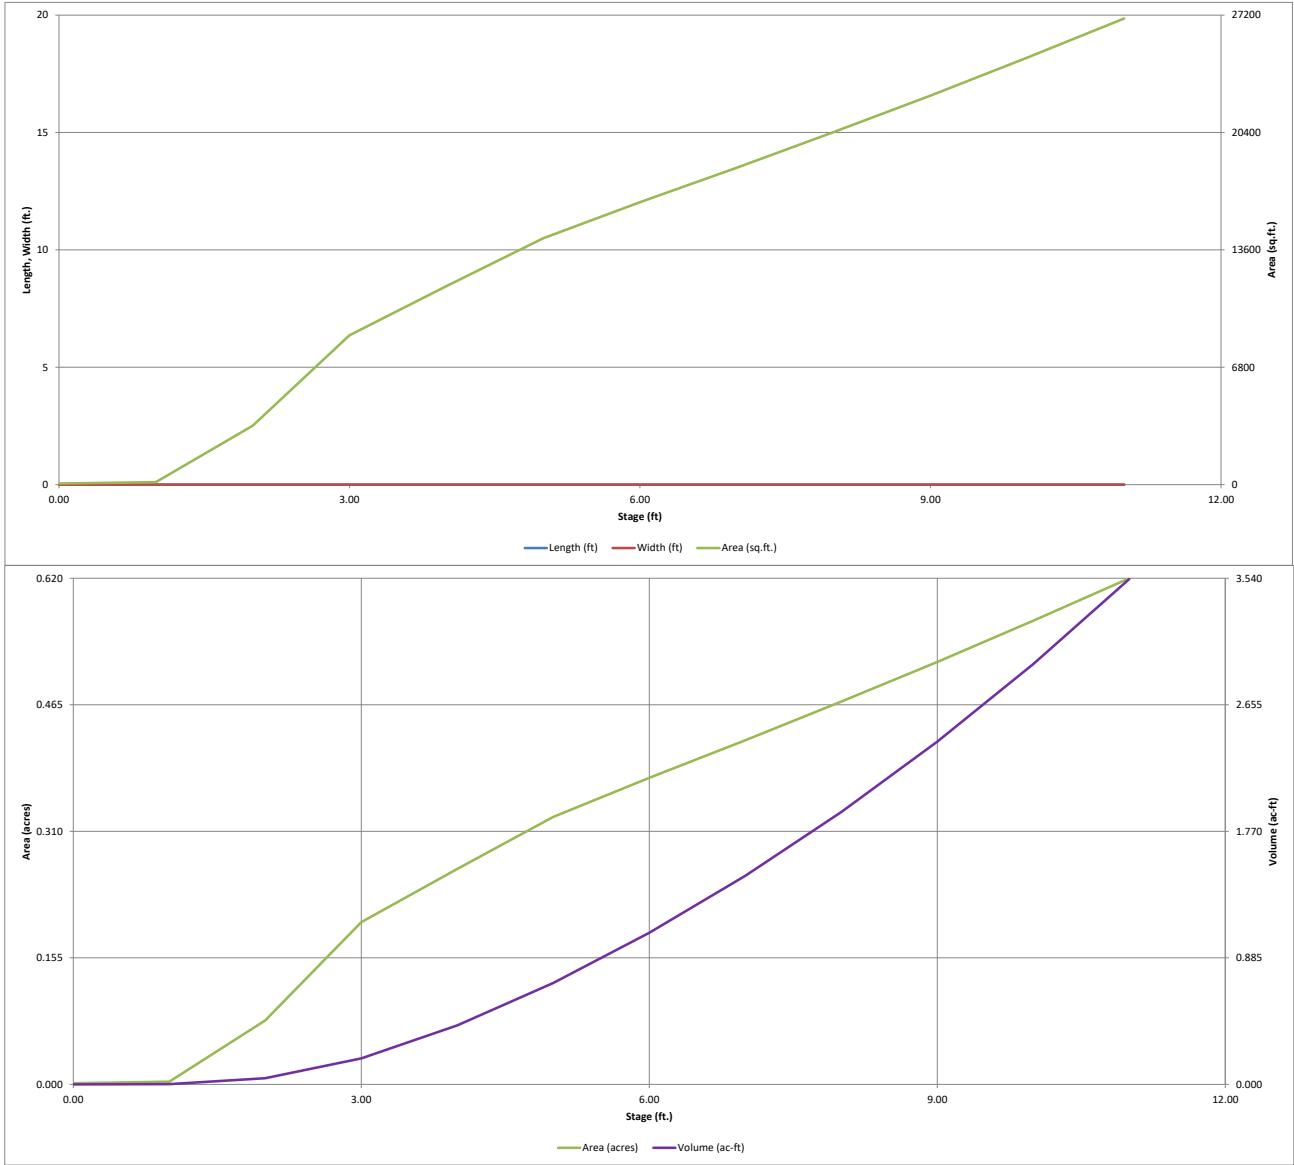

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

Project: Platte Self Storage
Basin ID: Private EDB Pond 1

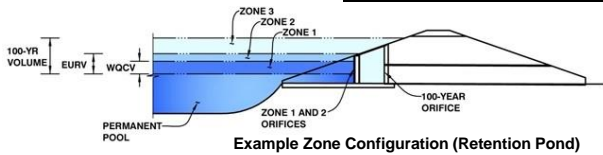

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	4.23	0.475	Orifice Plate
Zone 2 (EURV)	6.68	0.851	Orifice Plate
Zone 3 (100-year)	8.78	0.957	Weir&Pipe (Restrict)
Total (all zones)		2.283	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
 Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain
 Underdrain Orifice Area = ft²
 Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
 Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
 Orifice Plate: Orifice Vertical Spacing = inches
 Orifice Plate: Orifice Area per Row = inches

Calculated Parameters for Plate
 WQ Orifice Area per Row = ft²
 Elliptical Half-Width = feet
 Elliptical Slot Centroid = feet
 Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.70	3.40					
Orifice Area (sq. inches)	1.50	1.10	2.75					
	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected	
Vertical Orifice Area =	N/A	N/A	ft ²
Vertical Orifice Centroid =	N/A	N/A	feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe).

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	8.00	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	4.00	N/A	feet
Overflow Weir Grate Slope =	0.00	N/A	H:V
Horiz. Length of Weir Sides =	4.00	N/A	feet
Overflow Grate Type =	Close Mesh Grate	N/A	
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H _u =	8.00	N/A	feet
Overflow Weir Slope Length =	4.00	N/A	feet
Grate Open Area / 100-yr Orifice Area =	7.16	N/A	
Overflow Grate Open Area w/o Debris =	12.66	N/A	ft ²
Overflow Grate Open Area w/ Debris =	6.33	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.50	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	18.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	18.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	1.77	N/A	ft ²
Outlet Orifice Centroid =	0.75	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	3.14	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	9.00	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	23.00	feet
Spillway End Slopes =	4.00	H:V
Freeboard above Max Water Surface =	1.00	feet

Calculated Parameters for Spillway

Spillway Design Flow Depth =	0.69	feet
Stage at Top of Freeboard =	10.69	feet
Basin Area at Top of Freeboard =	0.60	acres
Basin Volume at Top of Freeboard =	3.34	acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
One-Hour Rainfall Depth (in) =	0.475	1.326	0.986	1.333	1.608	2.161	2.693	3.393	4.538
CUHP Runoff Volume (acre-ft) =	N/A	N/A	0.986	1.333	1.608	2.161	2.693	3.393	4.538
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	0.3	0.6	0.8	7.3	14.4	23.6	37.6
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A							
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.02	0.02	0.22	0.44	0.72	1.15
Peak Inflow Q (cfs) =	N/A	N/A	14.5	20.0	24.3	35.7	45.9	59.2	79.4
Peak Outflow Q (cfs) =	0.2	0.4	0.3	0.4	0.4	2.6	9.9	21.6	39.9
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.7	0.5	0.4	0.7	0.9	1.1
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Spillway
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	0.2	0.7	1.7	2.0
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	39	68	58	69	76	85	84	81	78
Time to Drain 99% of Inflow Volume (hours) =	41	72	62	73	81	91	90	89	88
Maximum Ponding Depth (ft) =	4.23	6.68	5.64	6.53	7.18	8.19	8.50	8.86	9.34
Area at Maximum Ponding Depth (acres) =	0.28	0.41	0.36	0.40	0.43	0.48	0.49	0.51	0.53
Maximum Volume Stored (acre-ft) =	0.476	1.327	0.929	1.266	1.536	1.990	2.145	2.321	2.571

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.04 (February 2021)

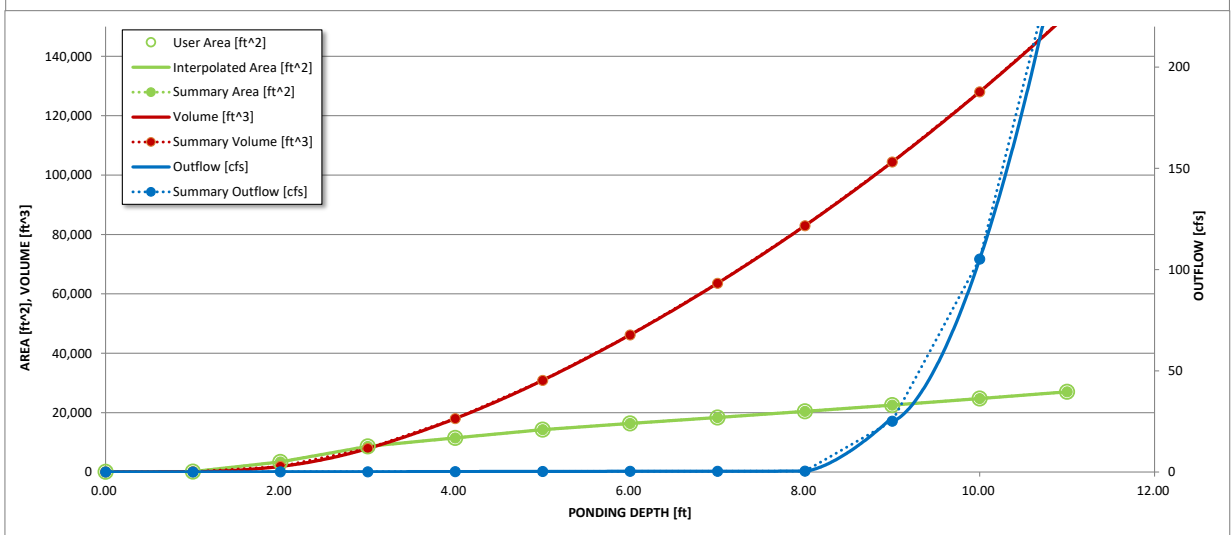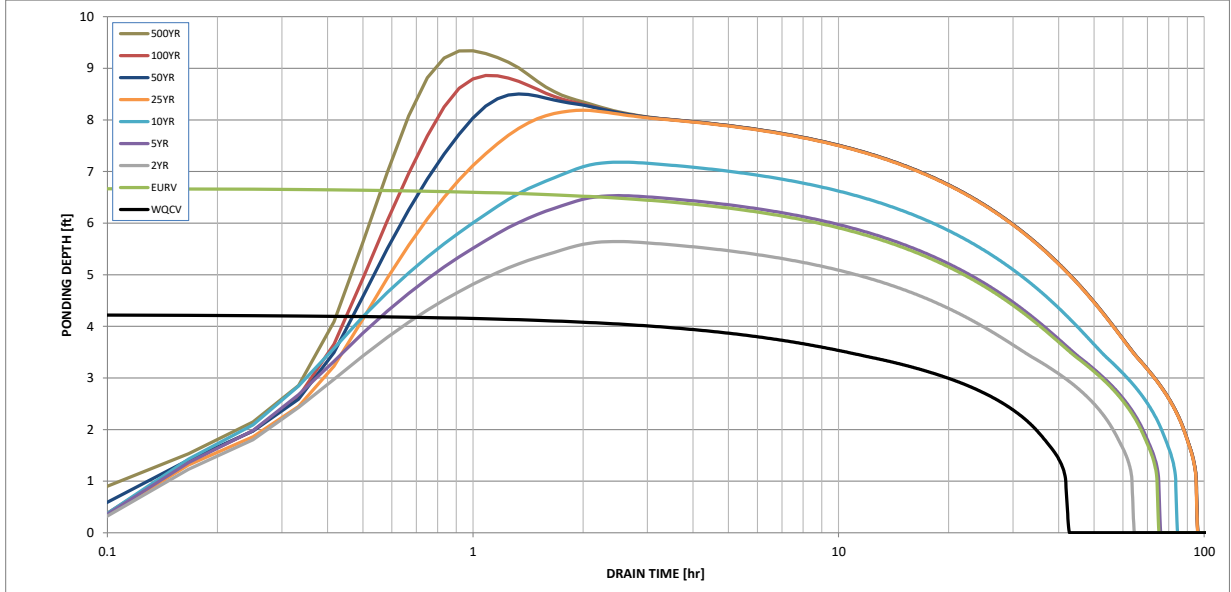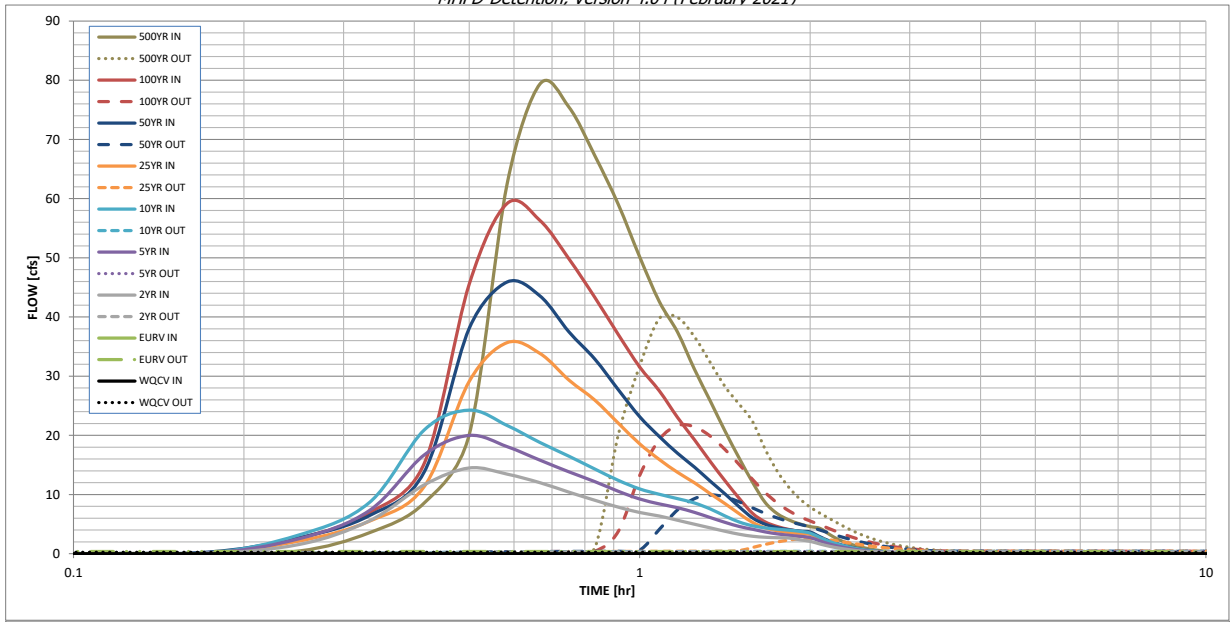

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.18	0.02	0.46
	0:15:00	0.00	0.00	1.56	2.53	3.16	2.14	2.69	2.64	3.55
	0:20:00	0.00	0.00	5.57	7.31	8.67	5.51	6.45	6.93	8.60
	0:25:00	0.00	0.00	11.66	16.72	20.93	11.39	13.87	15.32	20.12
	0:30:00	0.00	0.00	14.49	19.99	24.26	29.11	38.08	45.54	62.47
	0:35:00	0.00	0.00	13.45	18.09	21.67	35.66	45.91	59.18	79.36
	0:40:00	0.00	0.00	12.00	15.81	18.79	33.83	43.55	56.30	75.46
	0:45:00	0.00	0.00	10.40	13.83	16.48	29.34	37.49	49.82	67.25
	0:50:00	0.00	0.00	9.03	12.18	14.31	25.95	32.89	43.31	59.03
	0:55:00	0.00	0.00	7.87	10.55	12.40	22.06	27.72	37.04	50.16
	1:00:00	0.00	0.00	6.97	9.25	10.95	18.57	23.16	31.56	42.59
	1:05:00	0.00	0.00	6.37	8.42	10.04	15.92	19.79	27.51	37.43
	1:10:00	0.00	0.00	5.65	7.77	9.30	13.75	16.97	23.02	31.14
	1:15:00	0.00	0.00	4.98	6.98	8.57	11.98	14.63	19.24	25.77
	1:20:00	0.00	0.00	4.36	6.10	7.55	10.12	12.24	15.55	20.63
	1:25:00	0.00	0.00	3.78	5.28	6.36	8.43	10.06	12.27	16.10
	1:30:00	0.00	0.00	3.29	4.60	5.35	6.74	7.90	9.33	12.04
	1:35:00	0.00	0.00	2.95	4.13	4.71	5.28	6.04	6.81	8.64
	1:40:00	0.00	0.00	2.78	3.68	4.37	4.38	4.97	5.36	6.77
	1:45:00	0.00	0.00	2.70	3.35	4.14	3.88	4.39	4.60	5.72
	1:50:00	0.00	0.00	2.65	3.12	3.98	3.59	4.05	4.11	5.04
	1:55:00	0.00	0.00	2.36	2.94	3.79	3.39	3.82	3.78	4.59
	2:00:00	0.00	0.00	2.10	2.73	3.48	3.26	3.67	3.55	4.27
	2:05:00	0.00	0.00	1.64	2.14	2.71	2.54	2.85	2.70	3.22
	2:10:00	0.00	0.00	1.25	1.62	2.05	1.91	2.13	1.99	2.35
	2:15:00	0.00	0.00	0.95	1.23	1.55	1.44	1.60	1.49	1.76
	2:20:00	0.00	0.00	0.72	0.93	1.16	1.08	1.20	1.12	1.32
	2:25:00	0.00	0.00	0.54	0.69	0.86	0.80	0.88	0.83	0.98
	2:30:00	0.00	0.00	0.40	0.50	0.63	0.58	0.64	0.61	0.71
	2:35:00	0.00	0.00	0.29	0.36	0.46	0.42	0.47	0.44	0.52
	2:40:00	0.00	0.00	0.20	0.26	0.33	0.31	0.34	0.32	0.37
	2:45:00	0.00	0.00	0.13	0.17	0.22	0.21	0.23	0.21	0.24
	2:50:00	0.00	0.00	0.08	0.11	0.13	0.13	0.14	0.13	0.15
	2:55:00	0.00	0.00	0.04	0.06	0.07	0.07	0.07	0.06	0.07
	3:00:00	0.00	0.00	0.02	0.03	0.03	0.03	0.03	0.02	0.02
	3:05:00	0.00	0.00	0.00	0.01	0.01	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Stormwater Detention and Infiltration Design Data Sheet

Workbook Protected

Worksheet Protected

Stormwater Facility Name: Platte Self Storage EDB

Facility Location & Jurisdiction: 6001 E Platte Ave, El Paso County

User Input: Watershed Characteristics

Watershed Slope =	0.035	ft/ft
Watershed Length =	1610	ft
Watershed Area =	32.68	acres
Watershed Imperviousness =	38.0%	percent
Percentage Hydrologic Soil Group A =	100.0%	percent
Percentage Hydrologic Soil Group B =	0.0%	percent
Percentage Hydrologic Soil Groups C/D =	0.0%	percent

Location for 1-hr Rainfall Depths (use dropdown):

User Input ▼

WQCV Treatment Method = Extended Detention ▼



User Defined Stage [ft]	User Defined Area [ft^2]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	63	0.00	0.00
1.00	148	1.00	0.05
2.00	3,413	2.00	0.09
3.00	8,656	3.00	0.13
4.00	11,501	4.00	0.23
5.00	14,272	5.00	0.30
6.00	16,360	6.00	0.35
7.00	18,366	7.00	0.39
8.00	20,424	8.00	0.43
9.00	22,541	9.00	25.17
10.00	24,740	10.00	105.17
11.00	27,005	11.00	277.37

After completing and printing this worksheet to a pdf, go to: <https://maperture.digitaldataservices.com/gvh/?viewer=cswdif> create a new stormwater facility, and attach the pdf of this worksheet to that record.

Routed Hydrograph Results

	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
Design Storm Return Period =							
One-Hour Rainfall Depth =	0.53	1.19	1.50	1.75	2.00	2.52	in
Calculated Runoff Volume =	0.475	0.897	1.188	1.480	2.217	3.233	acre-ft
OPTIONAL Override Runoff Volume =							acre-ft
Inflow Hydrograph Volume =	0.475	0.896	1.187	1.480	2.216	3.232	acre-ft
Time to Drain 97% of Inflow Volume =	39.0	54.8	63.8	71.9	83.6	80.2	hours
Time to Drain 99% of Inflow Volume =	40.8	57.8	67.5	76.3	89.5	88.2	hours
Maximum Ponding Depth =	4.12	5.43	6.21	6.92	8.17	8.83	ft
Maximum Ponded Area =	0.27	0.35	0.38	0.42	0.48	0.51	acres
Maximum Volume Stored =	0.444	0.851	1.136	1.422	1.980	2.304	acre-ft

Stormwater Detention and Infiltration Design Data Sheet

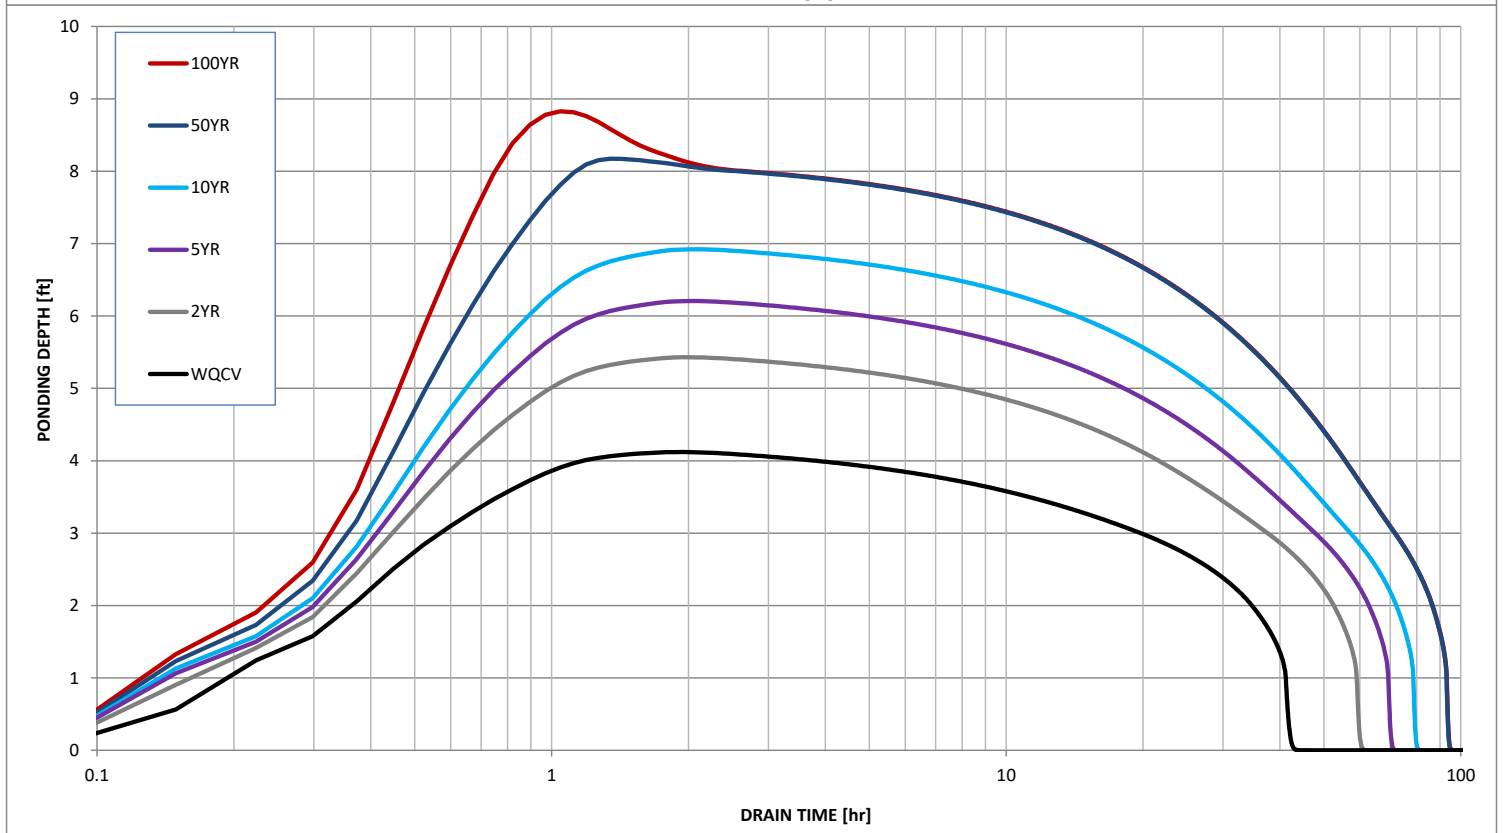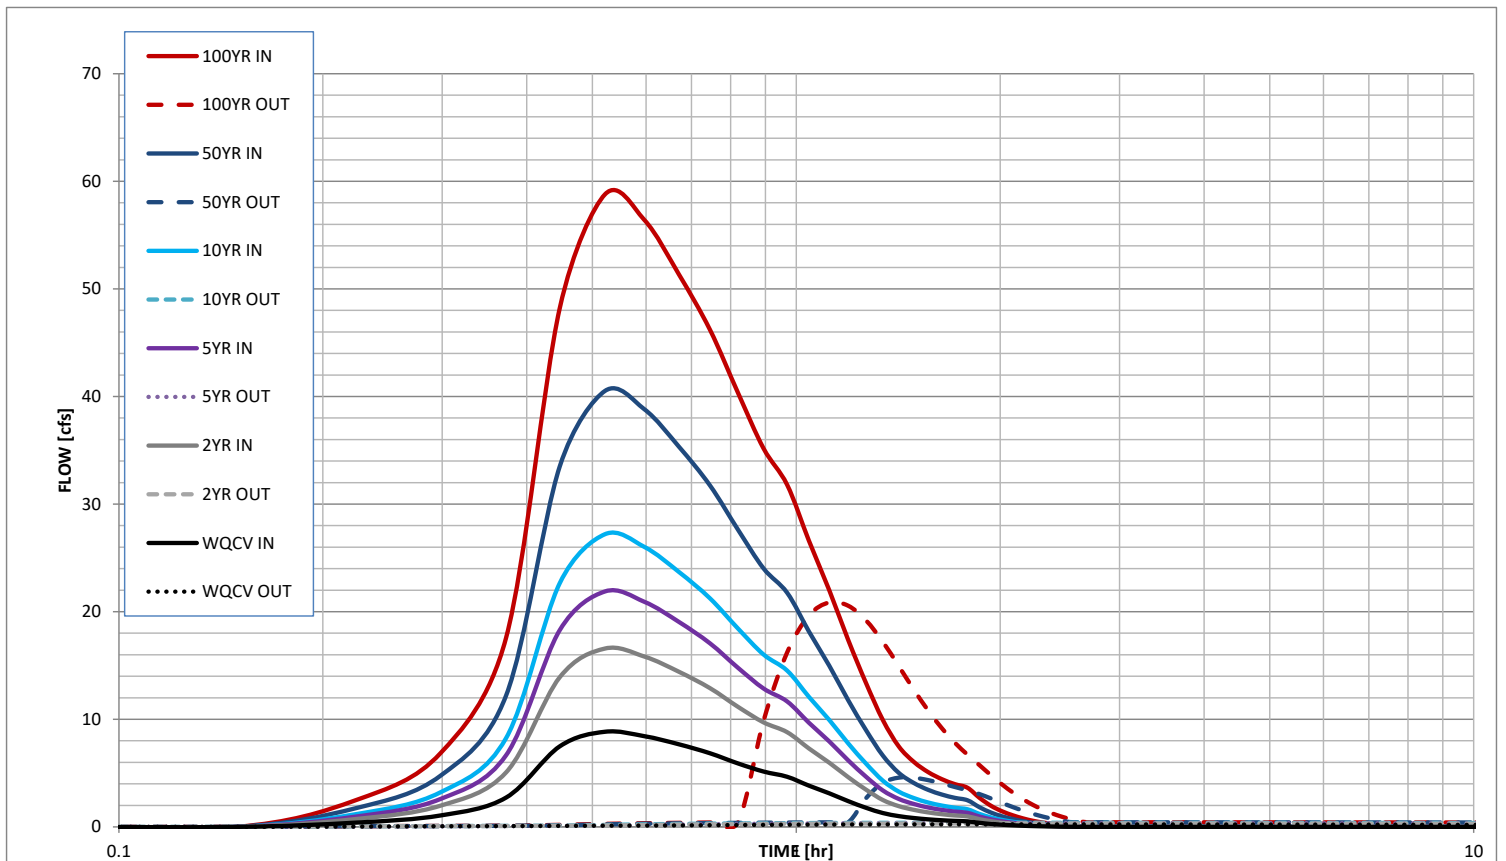

Forebay Wall Notch

Notch to releae 2% of the undetained 100-year peak discharge.

$$\begin{aligned} 100\text{-y peak discharge} &= 21.6 \text{ cfs} \\ 2.0\% &= 0.43 \text{ cfs} \end{aligned}$$

The general form of the equation for horizontal crested weirs is $Q = CLH^{3/2}$ where:

Q = Weir flow discharge (cfs)	0.43	
C = Weir flow coefficient	3.4	
H = Depth of flow over the weir (ft)	1.50	Opening Height
L = Length of the weir (ft)	0.07	Length
L = Length of the weir (in)	0.8	

Minimim notch length is 3" per standards

Notch to releae 2% of the undetained 100-year peak discharge is 3" wide by 18" high (min allowed)

MANNING'S EQUATION for OPEN CHANNEL FLOW

Project: **Platte Self Storage** Location: **2' TRICKEL CHANNEL**
 By: **JS** Date: **4/29/2024**
 Chk By: **DF** Date: **4/29/2024** version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

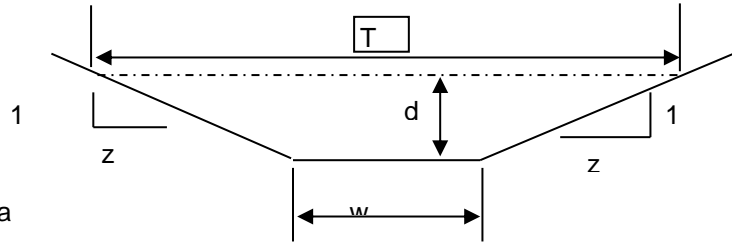

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 0
 z (sideslope)= 0
 b (btm width, ft)= 2
 d (depth, ft)= 0.5
 S (slope, ft/ft) 0.01
 n low = 0.013
 n high = 0.013

Clear Data
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.5	1.00	3.00	0.33	5.49513943	5.49514	5.495139	5.49514	2	0.500

Sc low = 0.0053 Sc high = 0.0053

s_c = critical slope ft / ft

T = top width of the stream

d_m = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0037	0.0069	0.0037	0.0069

STILLING BASIN CALCULATIONS

PLATTE SELF-STORAGE
 Calc: JS; Checked: DLF; Date: 11/11/2024

In non-cohesive soil channels and channels where future degradation is expected, especially where there is no drop structure immediately downstream, it is generally recommended that the stilling basin be eliminated and the sloping face extended five feet below the downstream future channel invert elevation (after accounting for future streambed degradation). A scour hole will form naturally downstream of a structure in non-cohesive soils and construction of a hard basin is an unnecessary cost. Additionally, a hard basin would be at risk for undermining. See Figure 9-12 for the profile of the GSB and Figure 9-17 for that of an SC in this configuration. In some cases, the structure may have a net drop height of zero immediately after construction, but is designed with a long-term net height of 3 to 5 feet to accommodate future lowering of the channel invert.

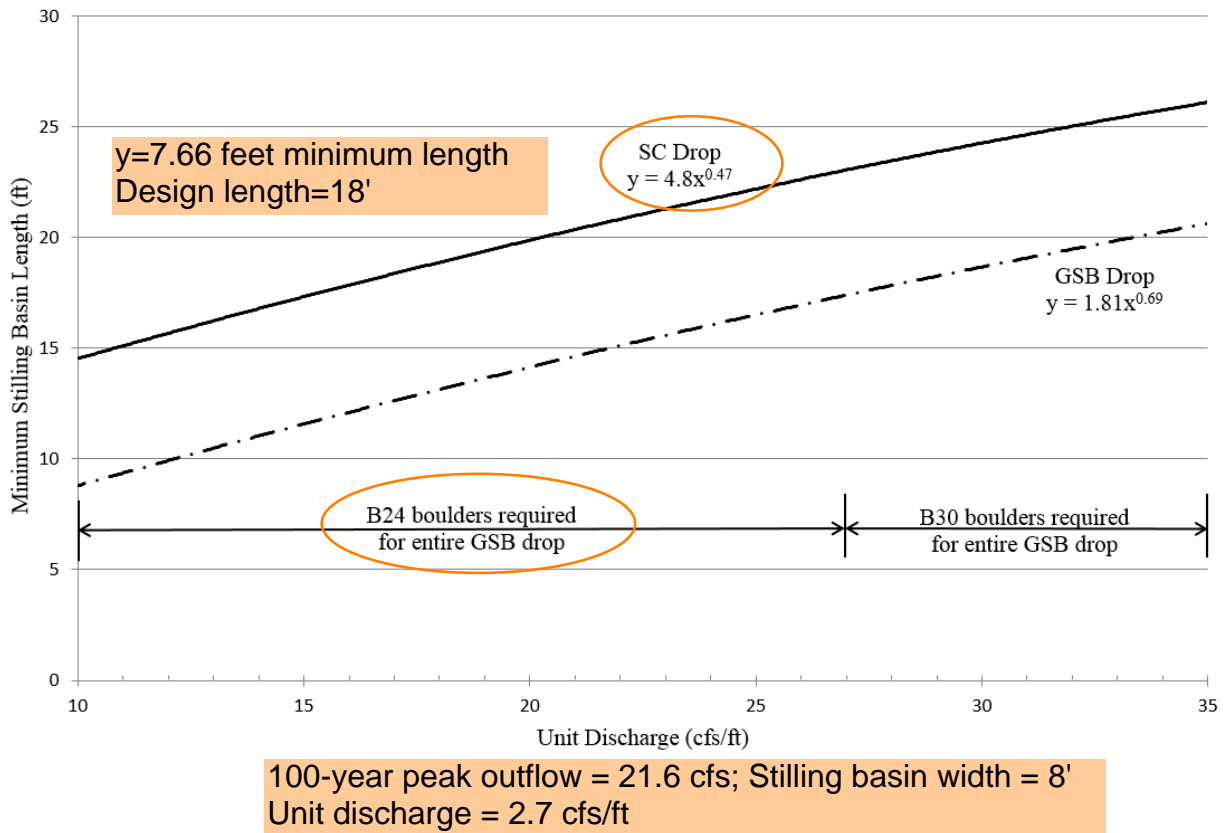


Figure 9-1. Stilling basin length based on unit discharge (for simplified design procedure)

2.2.6 Seepage Analysis and Cutoff Wall Design

The simplified drop structure design only applies to drops with cutoffs located in cohesive soils. Therefore, it is necessary to determine surface and subsurface soil conditions in the vicinity of a proposed drop structure prior to being able to use the simplified approach for cutoff design. For a drop structure constructed in cohesive soils meeting all requirements of a simplified design, the cutoff wall must be a minimum of six feet deep for concrete and ten feet deep for sheet pile.

If a proposed drop structure meets the requirements of the simplified approach, but is located in non-cohesive soils, guidance on determining the required cutoff wall depth is described in Section 2.4.

DRAINAGE MAPS


Note: The County wouldn't allow EDB Plans to be included in this report.

PLATTE SELF STORAGE

SITE DEVELOPMENT PLAN

EXISTING DRAINAGE MAP

NOVEMBER 2024

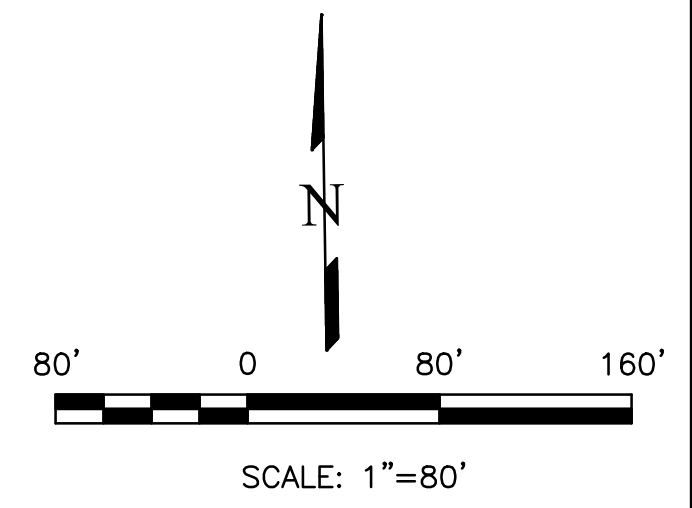

LEGEND

- BASIN DESIGNATION
AREA IN BASIN (AC)
PERCENT IMPERVIOUS
- DESIGN POINT
- BASIN BOUNDARY
- EXISTING 1' CONTOUR
- GROUND SURFACE FLOW DIRECTION
- ROAD AND DITCH FLOW DIRECTION
- TIME OF CONCENTRATION PATH

NOTES

1. BROWN GROUND SURFACE CONTOURS ARE LIDAR DATA DOWNLOADED FROM THE COLORADO HAZARD MAPPING & RISK MAP PORTAL, DATA SET: 2018 3DEP EAST CO EL PASO. THIS DATA IS APPROXIMATE. LIDAR DATA IS FROM 2018 AND AT 2' INTERVALS.
2. THE EXISTING SITE IS A LANDSCAPING MATERIALS YARD. GROUND SURFACES ARE DIRT, GRAVEL, AND ASPHALT. THE EDGE OF ASPHALT IS OFTEN COVERED BY DIRT/GRAVEL AND IT'S EXTENTS ARE ONLY ROUGHLY KNOWN.


BASIN SUMMARY

BASIN	AREA TOTAL		WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				TC	INTENSITY	TOTAL FLOWS			
	CS	C100	CS	C100	Length	Slope	Tc	Length	Slope	Velocity	Tc	TOTAL			IS	T100	Q5	Q100
OS-Z	6.34	0.33	0.53	0.33	300	0.02	19.2	230	2.0%	1.4	2.7	22.0	2.9	4.9	6.1	16.7		
OS-Y	8.15	0.16	0.41	0.16	300	0.03	20.4	505	3.0%	1.7	4.9	25.3	2.7	4.6	3.6	15.4		
OS-X	1.20	0.09	0.36	0.09	300	0.05	18.5	0	5.0%	2.2	0.0	18.5	3.2	5.4	0.4	2.3		
OS-W	0.45	0.28	0.50	0.28	300	0.07	13.5	160	7.0%	2.6	1.0	14.5	3.6	6.0	0.5	1.3		
EX-A	0.30	0.22	0.45	0.22	300	0.07	14.5	0	7.0%	2.6	0.0	14.5	3.6	6.0	0.2	0.8		
EX-B	0.64	0.45	0.63	0.45	300	0.07	10.7	250	7.0%	2.6	1.6	12.2	3.8	6.4	1.1	2.6		
EX-C	15.4	0.49	0.66	0.49	300	0.07	10.0	330	7.0%	2.6	2.1	12.1	3.8	6.4	29.0	65.0		
EX-D	1.05	0.10	0.36	0.10	300	0.03	21.9	40	3.0%	1.7	0.4	22.2	2.9	4.9	0.3	1.9		
EX-E	0.16	0.08	0.35	0.08	30	0.40	3.0	0	40.0%	6.3	0.0	5.0	5.2	8.7	0.1	0.5		
EX-F	0.23	0.08	0.35	0.08	35	0.24	3.8	0	24.0%	4.9	0.0	5.0	5.2	8.7	0.1	0.7		

DESIGN POINT SUMMARY


Design Point(s)	Contributing Basins	Area (ac)	Flow (cfs)	
			Q5	Q100
Z	OS-Z	6.34	6.1	16.7
Y	OS-Y	8.15	3.6	15.4
X	OS-X & DP D	2.25	0.7	4.2
W	OS-W & DP A	0.75	0.7	2.2
A	EX-A	0.30	0.2	0.8
B	EX-B & DP W	1.39	1.8	4.7
C	EX-C, DP D, DP X, & DP Y	26.85	33.6	86.5
D	EX-D	1.05	0.3	1.9
E	EX-E	0.16	0.1	0.5
F	EX-F	0.23	0.1	0.7

Show and label Base Flood Elevations in floodplain

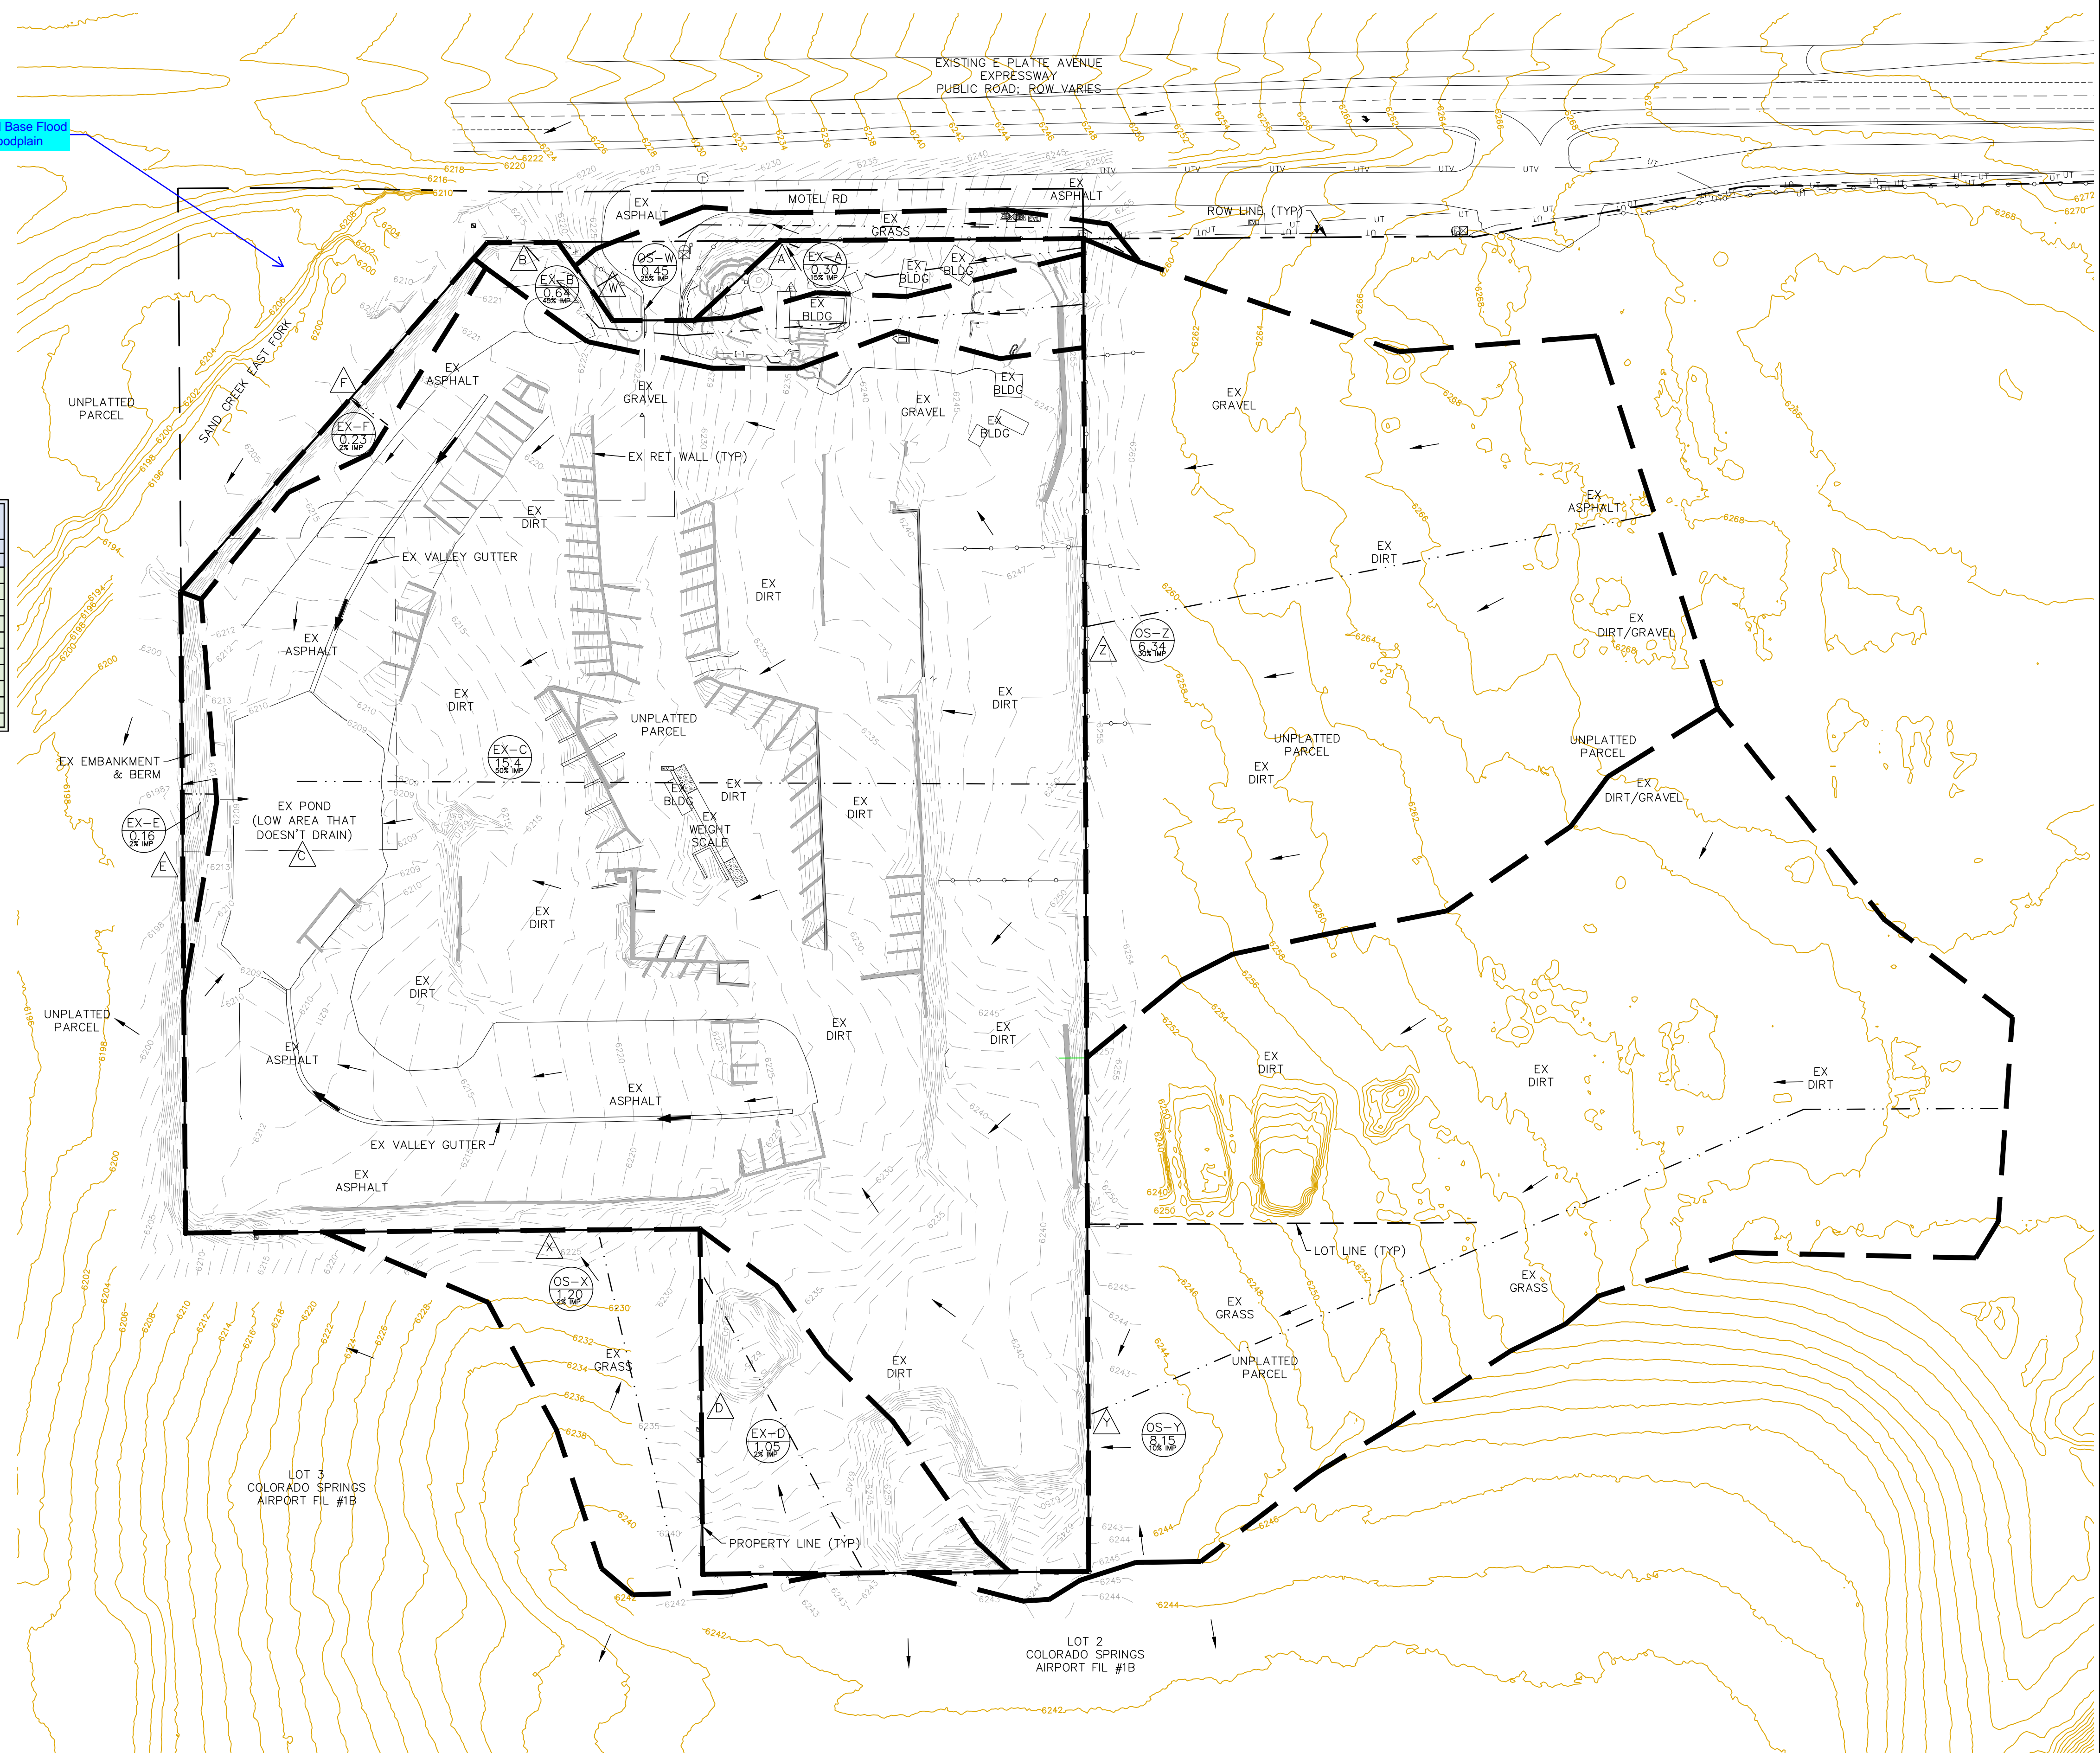

REVISIONS NO. DESCRIPTION	UNTIL SUCH TIME AS THESE DRAWINGS ARE APPROVED BY THE REVIEWING AGENCIES, THE TERRA NOVA ENGINEERING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT AND FOR THE PURPOSES AUTHORIZED BY WRITTEN AUTHORIZATION.
PREPARED FOR: RMG-ROCKY MOUNTAIN GROUP ATTN: 5085 LIST DR, #200 COLORADO SPRINGS, CO 80919 719.548.0600	 Terra Nova Engineering, Inc. Creative Civil Engineering, Inc.
721 S. 23RD STREET COLORADO SPRINGS, CO 80904 OFFICE: 719-635-6422 FAX: 719-635-6426 www.tnainc.com	DESIGNED BY DLF DRAWN BY DLF CHECKED BY LD H-SCALE AS SHOWN V-SCALE N/A JOB NO. 2419.00 DATE ISSUED 11/8/24 SHEET NO. 1 OF 3

PLATTE SELF STORAGE SITE DEVELOPMENT PLAN PROPOSED DRAINAGE MAP NOVEMBER 2024

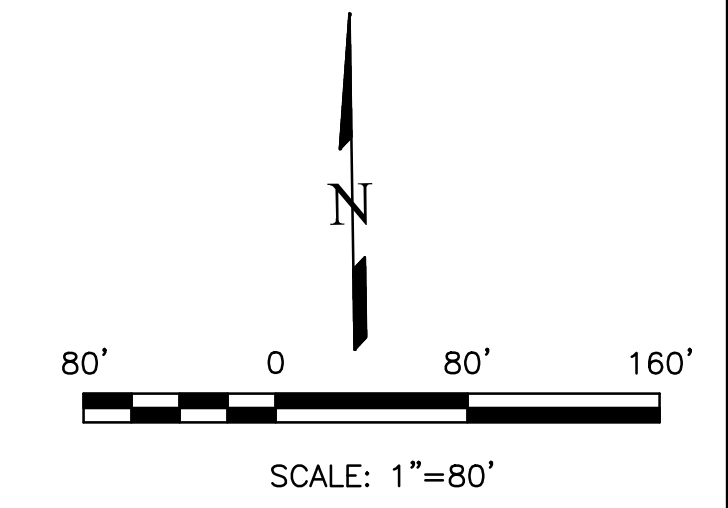

LEGEND

- BASIN DESIGNATION
AREA IN BASIN (AC)
PERCENT IMPERVIOUS
- DESIGN POINT
- BASIN BOUNDARY
- EXISTING 1' CONTOUR
- PROPOSED CONTOURS - 1'
- EXISTING PROPERTY LINE
- PROPOSED FENCE
- PROPOSED RETAINING WALL
- PROPOSED RIPRAP
- GROUND SURFACE FLOW DIRECTION
- ROAD AND DITCH FLOW DIRECTION
- TIME OF CONCENTRATION PATH
- SWALE IDENTIFIER

NOTES

1. BROWN GROUND SURFACE CONTOURS ARE LIDAR DATA DOWNLOADED FROM THE COLORADO HAZARD MAPPING & RISK MAP PORTAL, DATA SET: 2018 3DEP EAST CO EL PASO. THIS DATA IS APPROXIMATE. LIDAR DATA IS FROM 2018 AND AT 2' INTERVALS.

PIPE RUN SUMMARY


Pipe Run	Inlet #	Contributing Flow Sources	5 Year Flow (cfs)	100 Year Flow (cfs)	Slope	Pipe Size & Type	Owner
PR#1	-	PR#2	41.2	91.4	2.7%	48"RCP	PVT
PR#2	-	PR#3	41.2	91.4	2.2%	48"RCP	PVT
PR#3	#1	DP 3E & PR#4	41.2	91.4	2.2%	42"RCP	PVT
PR#4	#2	PR#5	32.4	71.2	1.7%	42"RCP	PVT
PR#5	#3	PR#6 & PR#11	32.4	71.2	2.1%	42"RCP	PVT
PR#6	#4	DP 3D & PR#7	20.6	39.0	5.0%	30"RCP	PVT
PR#7	#5	DP 3C & PR#8	16.5	32.7	1.9%	30"RCP	PVT
PR#8	#6	DP 3B & PR#9	12.5	26.7	1.9%	30"RCP	PVT
PR#9	#7	DP3A & PR#13	8.7	21.1	1.9%	24"RCP	PVT
PR#10	#10	PR#12	6.2	17.7	1.7%	24"RCP	PVT
PR#11	#8	PR#11	11.8	32.2	1.0%	36"RCP	PVT
PR#12	#9	DP 4	11.8	32.2	1.0%	36"RCP	PVT
PR#13	#11	DP 10E & PR#17 & 20	6.2	17.7	1.0%	24"RCP	PVT
PR#14	#12	DP 10A	0.4	1.3	1.0%	12"HDPE	PVT
PR#15	#13	DP 10B & PR#14	0.7	1.9	1.0%	15"HDPE	PVT
PR#16	#14	DP 10C & PR#15	0.9	2.6	1.0%	15"HDPE	PVT
PR#17	#15	DP 10D & PR#16	1.7	5.0	1.0%	18"HDPE	PVT
PR#18	#16	DP 10H	1.2	3.4	1.0%	12"HDPE	PVT
PR#19	#17	DP 10G & PR#18	2.0	5.8	1.0%	15"HDPE	PVT
PR#20	#18	DP 10F & PR#19	2.6	7.4	1.0%	15"HDPE	PVT
PR#90	-	Pond outlet	0.5	11.3	1.4%	18"HDPE	PVT

BASIN SUMMARY

BASIN	AREA (Ac)	WEIGHTED C _i	OVERLAND C _o	STREET CHANNEL FLOW (cfs)	T _o (min)	INTENSITY (in/hr)	TOTAL FLOWS (cfs)
OS-ZA	0.44	0.33	0.53	0.33	300	0.02	19.3
OS-ZB	0.22	0.33	0.53	0.33	300	0.02	19.3
OS-ZC	0.23	0.33	0.53	0.33	300	0.02	19.3
OS-ZD	0.86	0.33	0.53	0.33	300	0.02	19.3
OS-ZE	1.94	0.33	0.53	0.33	300	0.02	19.3
OS-ZF	0.56	0.33	0.53	0.33	300	0.02	19.3
OS-ZG	0.85	0.33	0.53	0.33	300	0.02	19.3
OS-ZH	1.24	0.33	0.53	0.33	300	0.02	19.3
OS-ZI	8.15	0.16	0.41	0.16	300	0.02	19.3
OS-X	1.20	0.09	0.36	0.09	300	0.05	18.5
OS-W	0.45	0.28	0.50	0.28	300	0.07	13.5
PR-1	0.07	0.08	0.35	0.08	100	0.08	9.3
PR-2	0.13	0.08	0.35	0.08	100	0.08	9.3
PR-3A	1.10	0.90	0.96	0.90	100	0.02	2.9
PR-3B	1.11	0.90	0.96	0.90	100	0.02	2.9
PR-3C	0.96	0.90	0.96	0.90	100	0.02	2.9
PR-3D	0.97	0.90	0.96	0.90	100	0.02	2.9
PR-3E	1.01	0.90	0.96	0.90	100	0.02	2.9
PR-4	3.66	0.61	0.75	0.61	100	0.02	7.0
PR-5	0.56	0.09	0.36	0.09	300	0.02	25.0
PR-6	6.64	0.16	0.41	0.16	300	0.02	23.3
PR-7	0.54	0.10	0.37	0.10	25	0.33	2.8
PR-8	0.30	0.11	0.37	0.11	35	0.33	3.3
PR-9	0.59	0.09	0.36	0.09	100	0.06	10.1
PR-10A	0.06	0.08	0.35	0.08	100	0.06	10.2
PR-10B	0.03	0.08	0.35	0.08	100	0.06	10.2
PR-10C	0.04	0.08	0.35	0.08	100	0.06	10.2
PR-10D	0.04	0.08	0.35	0.08	100	0.06	10.2
PR-10E	0.09	0.08	0.35	0.08	100	0.06	10.2
PR-10F	0.04	0.08	0.35	0.08	100	0.06	10.2
PR-10G	0.05	0.08	0.35	0.08	100	0.06	10.2
PR-10H	0.06	0.08	0.35	0.08	100	0.06	10.2
PR-10I	0.06	0.08	0.35	0.08	100	0.06	10.2

DESIGN POINT SUMMARY

Design Point(s)	Contributing Basins	Area (ac)	Flow (cfs)
1	PR-1	0.07	0.0
2	PR-2	0.13	0.1
3A	PR-3A	1.10	0.0
3B	PR-3B & PR-3A FLOW BY	1.11	7.8
3C	PR-3C & PR-3B FLOW BY	0.96	8.0
3D	PR-3D & PR-3C FLOW BY	0.97	8.1
3E	PR-3E & PR-3D FLOW BY	1.01	8.2
4	PR-4	11.81	11.8
5	PR-5 & DP 3	1.76	0.5
6	PR-6 & PR#11	7.74	14.3
7	PR-7	0.24	0.1
8	PR-8	0.30	0.2
9	PR-9	0.59	0.2
10A	PR-10A & OS-ZA	0.49	0.4
10B	PR-10B & DP 3B	0.25	0.2
10C	PR-10C & DP 3C	0.25	0.2
10D	PR-10D & DP 3D	0.50	0.8
10E	PR-10E & DP 3E	2.00	1.9
10F	PR-10F & DP 3F	0.60	0.6
10G	PR-10G & DP 3G	0.80	0.8
10H	PR-10H & DP 3H	1.30	1.1
W	OS-W, DP 1 & DP 2	0.63	0.5
X	OS-X	1.20	0.4
Y	OS-Y	8.15	3.6

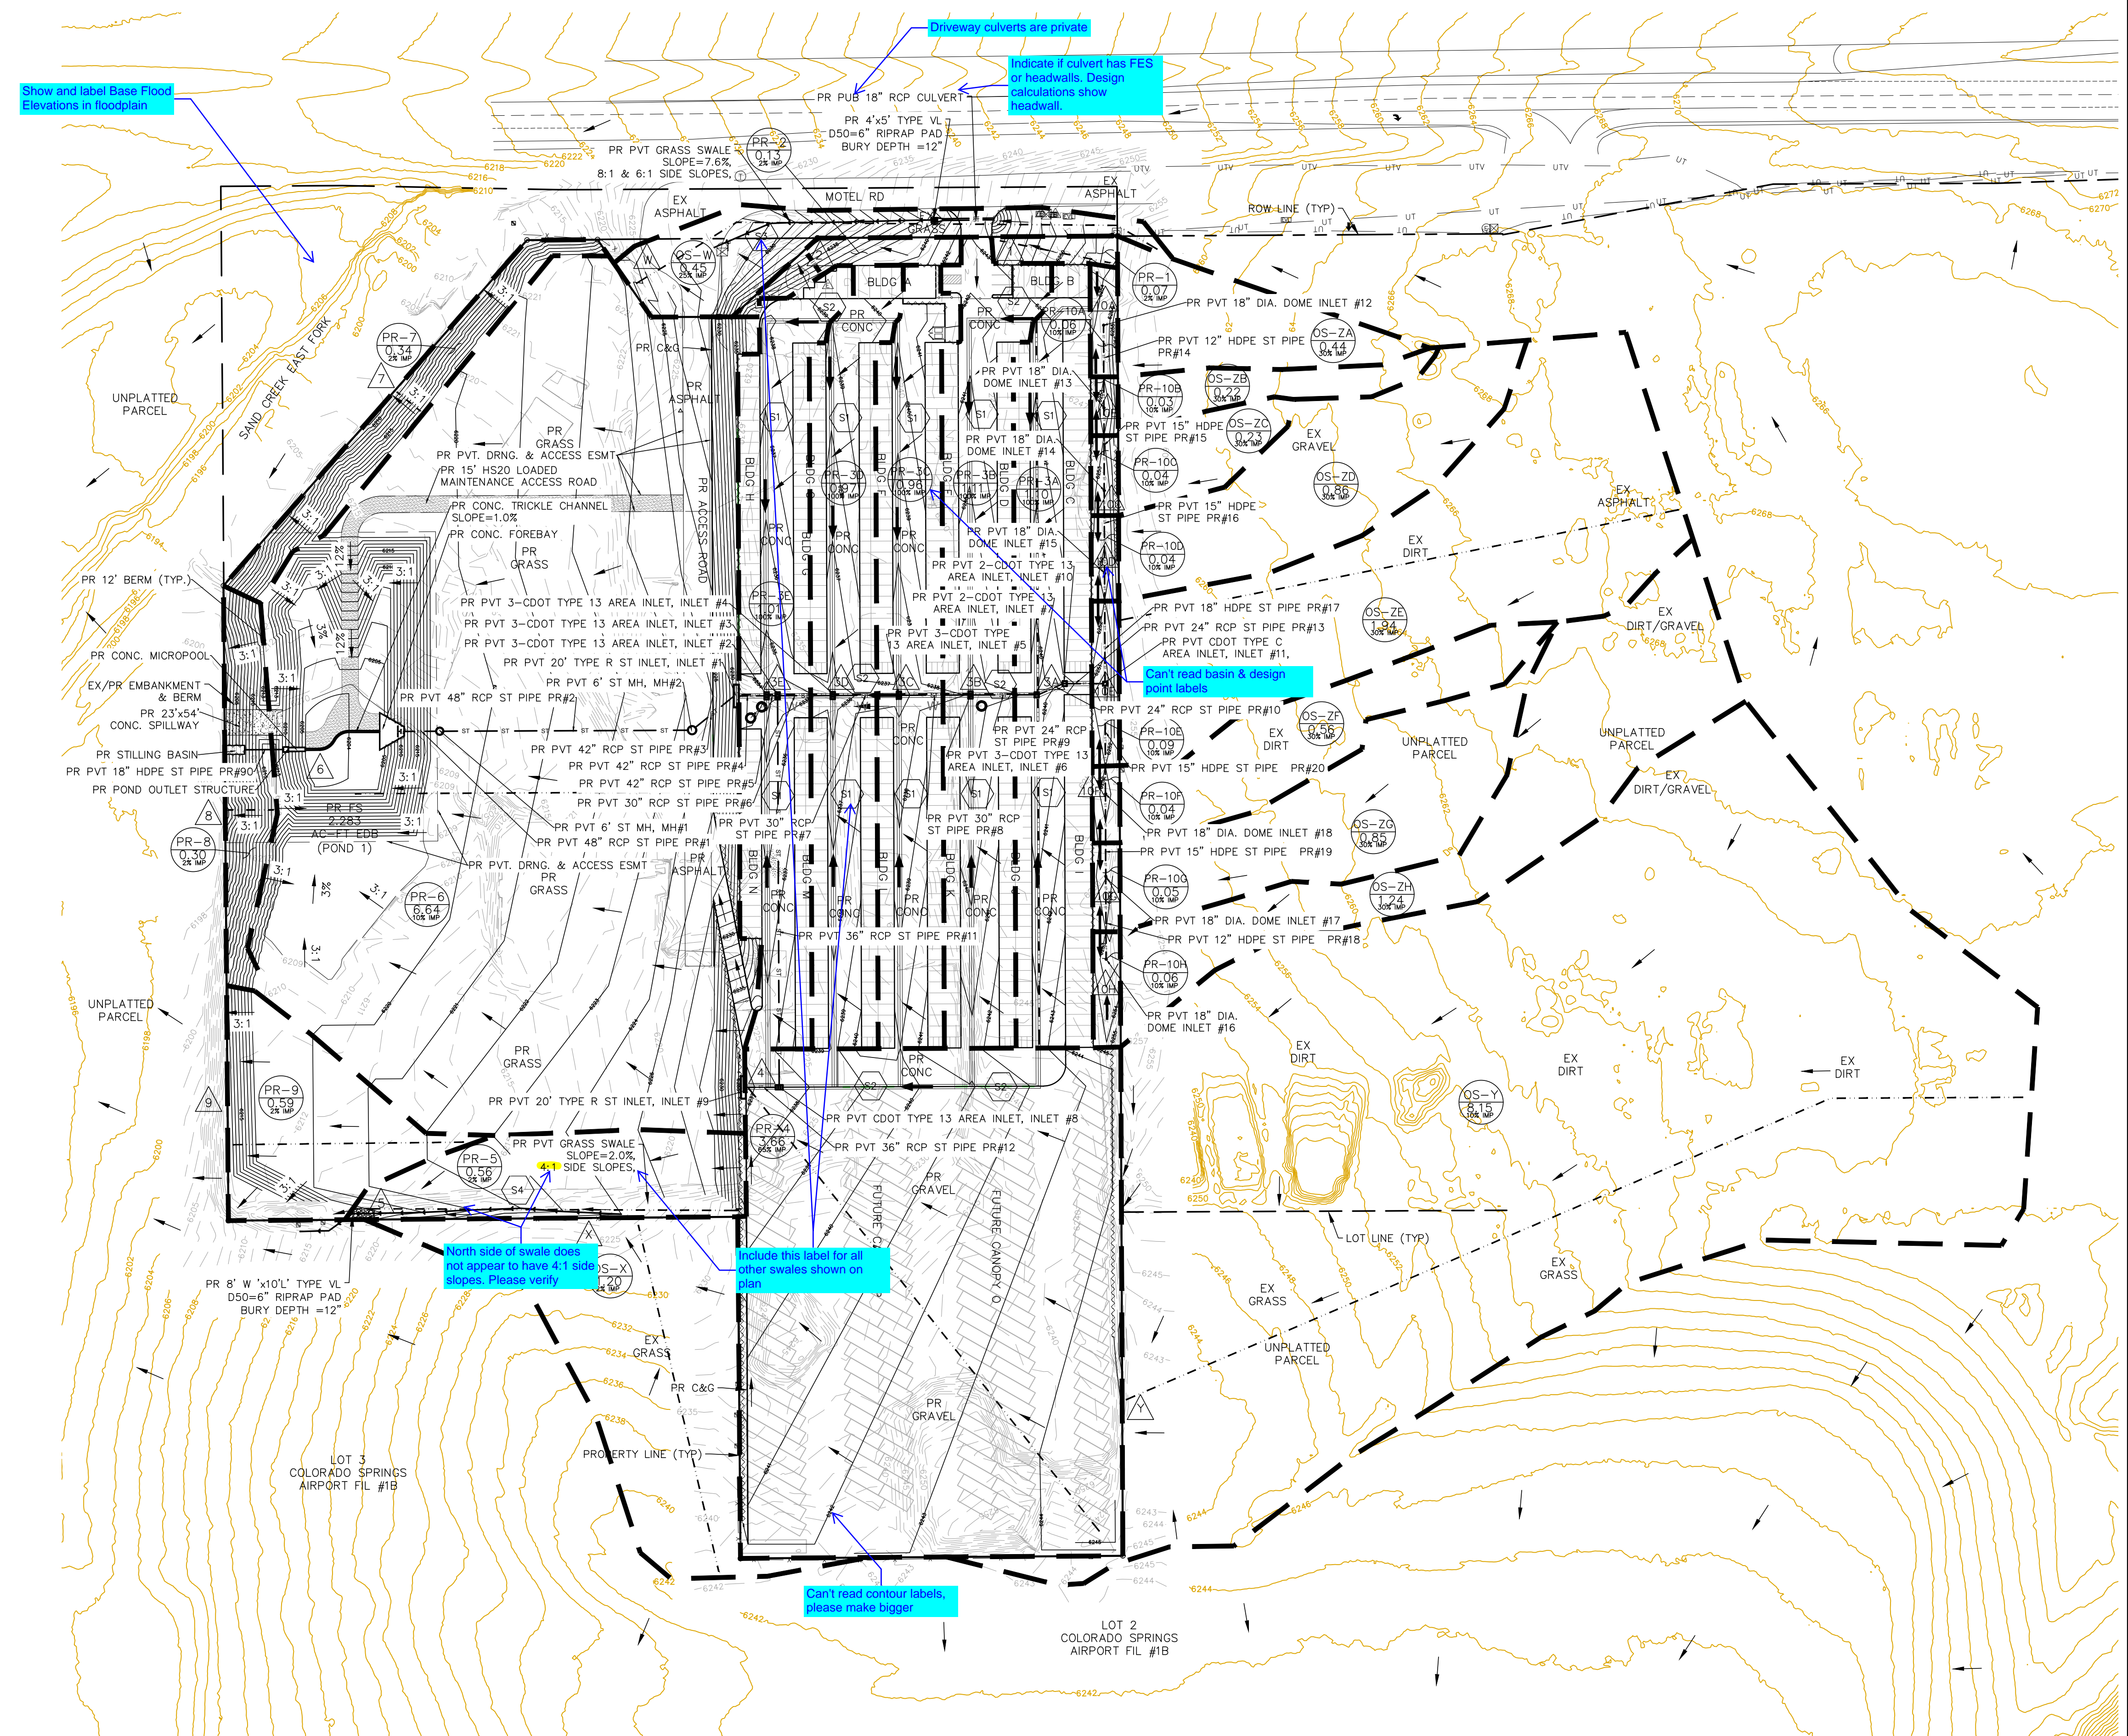

DATE: _____

DESCRIPTION: _____

REVISIONS: _____

NO. _____

UNTIL SUCH TIME AS THESE DRAWINGS ARE APPROVED BY THE REVIEWING AGENCIES FOR THE TERRA NOVA ENGINEERING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT AND FOR THE COST OF THE WRITTEN AUTHORIZATION.

PREPARED FOR:
RMG-ROCKY MOUNTAIN GROUP

ATTN:
5085 LIST DR, #200
COLORADO SPRINGS, CO 80919
719.548.0600

Terra Nova
Engineering, Inc.
Civil City Engineer

721 S. 23RD STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-635-6422
FAX: 719-635-6426
www.tnec.com


PLATTE SELF STORAGE
PROPOSED DRAINAGE MAP

DESIGNED BY DLF
DRAWN BY DLF
CHECKED BY LD

H-SCALE AS SHOWN
V-SCALE N/A

JOB NO. 2419.00
DATE ISSUED 11/8/24
SHEET NO. 2 OF 3

PLATTE SELF STORAGE SITE DEVELOPMENT PLAN WQ TREATMENT MAP NOVEMBER 2024

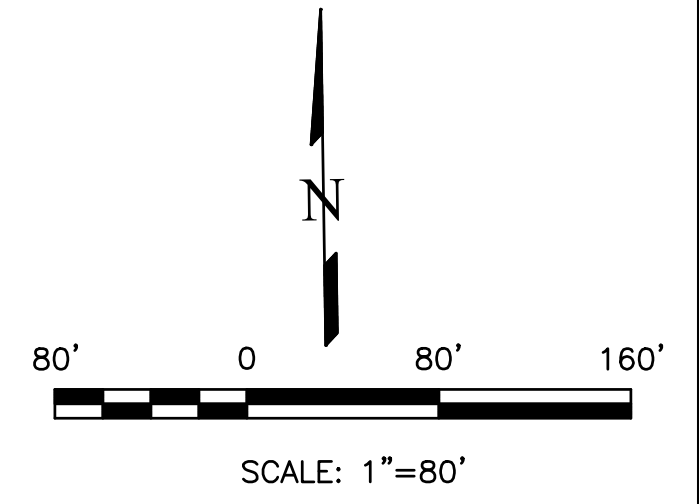

LEGEND


- BASIN DESIGNATION
AREA IN BASIN (AC)
PERCENT IMPERVIOUS
- DESIGN POINT
- BASIN BOUNDARY
- EXISTING 1' CONTOUR
- PROPOSED CONTOURS - 1'
- EXISTING PROPERTY LINE
- PROPOSED FENCE
- PROPOSED RETAINING WALL
- PROPOSED RIPRAP
- GROUND SURFACE FLOW DIRECTION
- ROAD AND DITCH FLOW DIRECTION
- TIME OF CONCENTRATION PATH
- SWALE IDENTIFIER

NOTES

1. BROWN GROUND SURFACE CONTOURS ARE LIDAR DATA DOWNLOADED FROM THE COLORADO HAZARD MAPPING & RISK MAP PORTAL, DATA SET: 2018 3DEP EAST CO EL PASO. THIS DATA IS APPROXIMATE. LIDAR DATA IS FROM 2018 AND AT 2' INTERVALS.

WQ TREATMENT SUMMARY


Basin ID	Total Area (ac)	Total Proposed Disturbed Area (ac)	Area Trib to Pond 1 (ac)	Disturbed Area Treated via Runoff Reduction (ac)	Disturbed Area Excluded from WQ per ECM App 1.7.1.C.1 (ac)	Disturbed Area Excluded from WQ per ECM App 1.7.1.B.# (ac)	Applicable WQ Exclusions (App 1.7.1.B.#)
OS-ZA	0.44	-	0.44	-	-	-	-
OS-ZB	0.22	-	0.22	-	-	-	-
OS-ZC	0.23	-	0.23	-	-	-	-
OS-ZD	0.86	-	0.86	-	-	-	-
OS-ZE	1.94	-	1.94	-	-	-	-
OS-ZF	0.56	-	0.56	-	-	-	-
OS-ZG	0.85	-	0.85	-	-	-	-
OS-ZH	1.24	-	1.24	-	-	-	-
OS-Y	8.15	-	8.15	-	-	-	-
OS-X	1.20	-	-	-	-	-	-
OS-W	0.45	0.45	-	-	0.45	-	-
PR-1	0.07	0.07	-	-	-	0.07	1.7.1.B.7
PR-2	0.13	0.13	-	-	-	0.13	1.7.1.B.7
PR-3A	1.10	1.10	1.10	-	-	-	-
PR-3B	1.11	1.11	1.11	-	-	-	-
PR-3C	0.96	0.96	0.96	-	-	-	-
PR-3D	0.97	0.97	0.97	-	-	-	-
PR-3E	1.01	1.01	1.01	-	-	-	-
PR-4	3.66	3.66	3.66	-	-	-	-
PR-5	0.56	0.56	-	-	0.55	0.01	1.7.1.B.7
PR-6	6.64	6.64	6.64	-	-	-	-
PR-7	0.34	0.34	-	-	-	0.34	1.7.1.B.7
PR-8	0.30	0.30	-	-	-	0.30	1.7.1.B.7
PR-9	0.59	0.59	-	-	-	0.59	1.7.1.B.7
PR-10A	0.06	0.06	0.06	-	-	-	-
PR-10B	0.03	0.03	0.03	-	-	-	-
PR-10C	0.04	0.04	0.04	-	-	-	-
PR-10D	0.04	0.04	0.04	-	-	-	-
PR-10E	0.09	0.09	0.09	-	-	-	-
PR-10F	0.04	0.04	0.04	-	-	-	-
PR-10G	0.05	0.05	0.05	-	-	-	-
PR-10H	0.06	0.06	0.06	-	-	-	-
TOTALS	30.33				1.00	1.44	
BASINS TRIB TO POND IN FUTURE PR-5, PR-9 & OS-X		2.35					Calc: DLF Date: 11/8/2024
AREA TRIB FOR POND DESIGN		32.68					Checked: JS

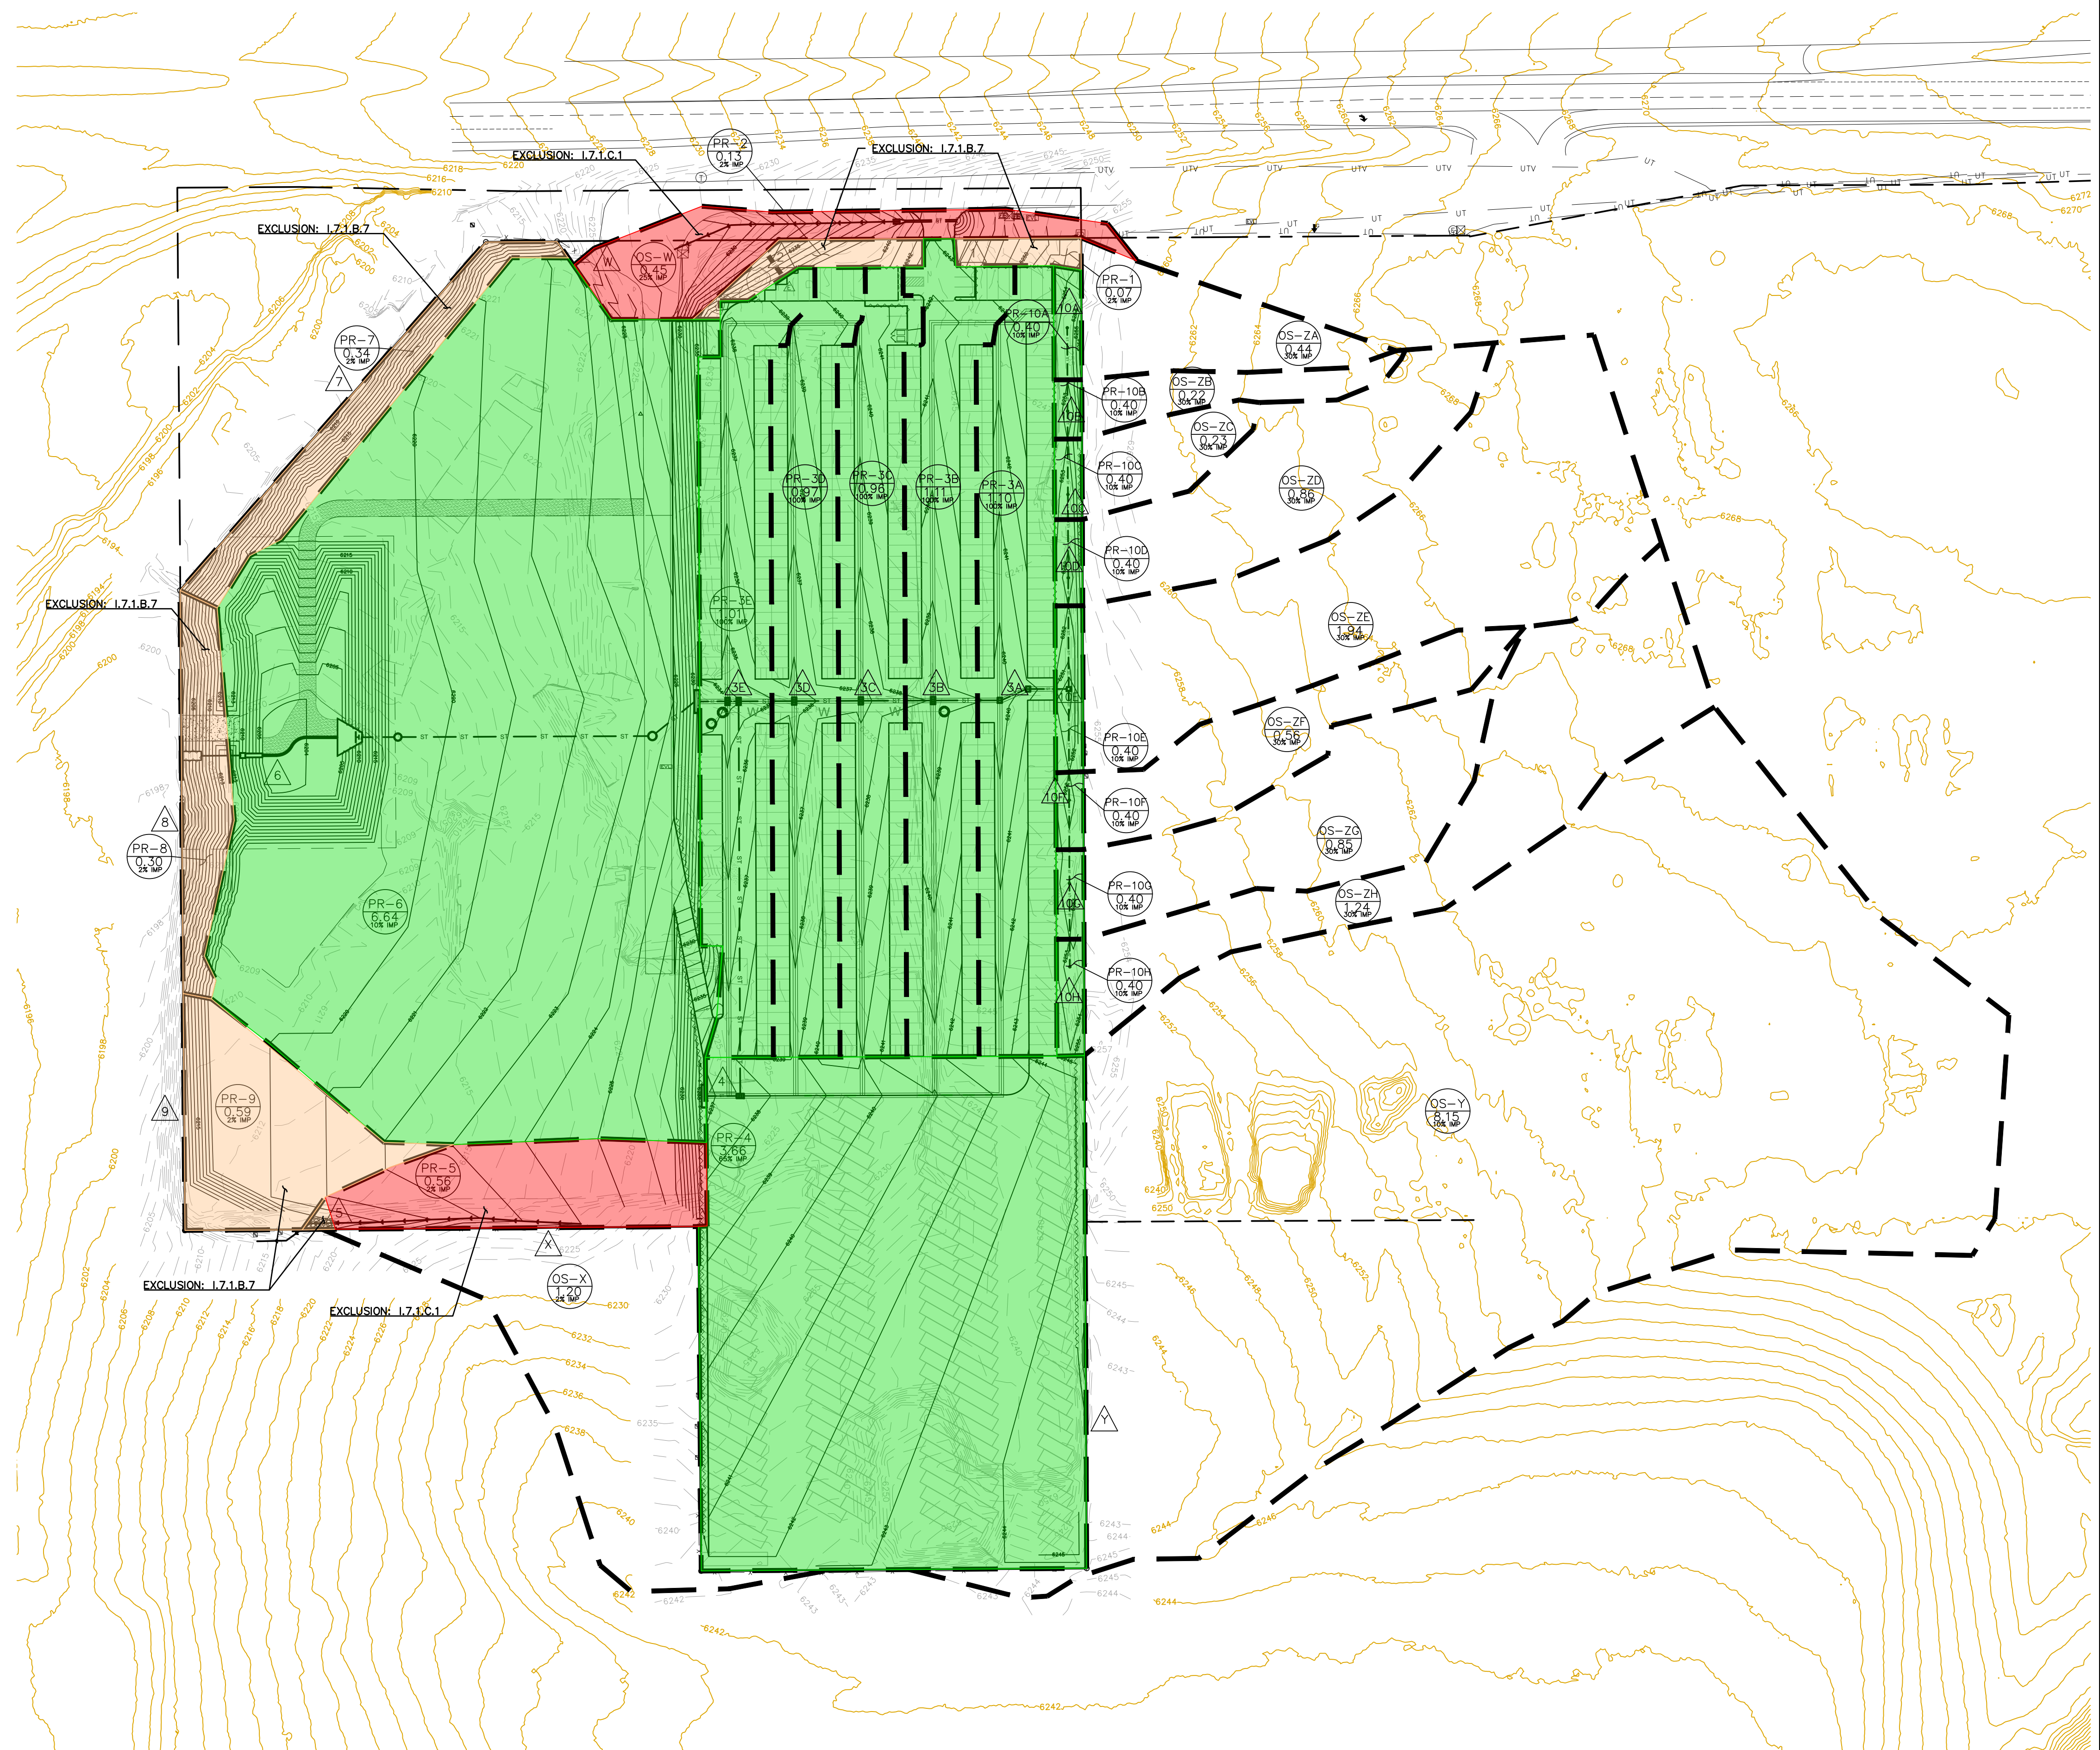

REVISIONS	NO.	DESCRIPTION	DATE

UNTIL SUCH TIME AS THESE DRAWINGS ARE APPROVED BY THE REVIEWING AGENCIES, TERRA NOVA ENGINEERING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT AND FOR THE COSTS AUTHORIZED BY WRITTEN AUTHORIZATION.

PREPARED FOR:
RMG-ROCKY MOUNTAIN GROUP
ATTN:
5085 LIST DR, #200
COLORADO SPRINGS, CO 80919
719.548.0600

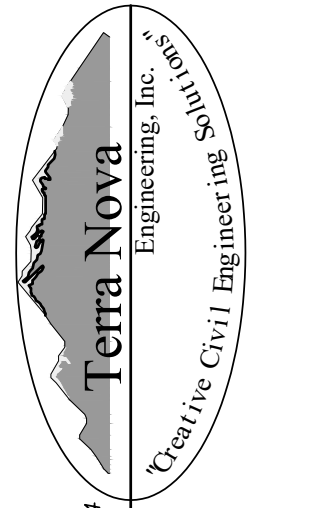

721 S. 23RD STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-635-6422
FAX: 719-635-6426
www.tnainc.com

PLATTE SELF STORAGE
WATER QUALITY TREATMENT MAP

DESIGNED BY DLF
DRAWN BY JS
CHECKED BY LD
H-SCALE AS SHOWN
V-SCALE N/A
JOB NO. 2419.00
DATE ISSUED 11/8/24
SHEET NO. 3 OF 3

V3_Drainage Report - Final.pdf Markup Summary

Callout (17)

by the property owner. The property owner. **Unresolved:** Provide discussion earlier in report discussing suitable outfall location.

development. Site runoff and ly affect the downstream and soed extended detention basin

Subject: Callout
Page Label: 16
Author: CDurham
Date: 12/23/2024 1:25:45 PM
Status:
Color: ■
Layer:
Space:

Unresolved:
 Provide discussion earlier in report discussing suitable outfall location.

This spreadsheet has Type 13 inlets under the Street inlet section

PR-3A inlet #7	PR-3B inlet #8
INLET	INLET
AREA	AREA
Shape	Shape
User-Defined	User-Defined

Subject: Callout
Page Label: 43
Author: CDurham
Date: 12/23/2024 2:53:32 PM
Status:
Color: ■
Layer:
Space:

The spreadsheet has Type 13 inlets under the Street inlet section

Which PR-3 Basin? Basins are labeled as PR-3A thru PR-3E

Location: Drive A105 S2 in Basins PR-3 and 1
 11/6/2024

Subject: Callout
Page Label: 57
Author: CDurham
Date: 12/30/2024 10:29:29 AM
Status:
Color: ■
Layer:
Space:

Which PR-3 Basin? Basins are labeled as PR-3A thru PR-3E.

How was length and width determined?

W x 10 L

May 2014

Subject: Callout
Page Label: 59
Author: CDurham
Date: 12/30/2024 10:51:26 AM
Status:
Color: ■
Layer:
Space:

How was length and width determined?

Unit discharge should be 3.3 cfs as the swale is a v-ditch

Unit Discharge (cfs/ft)

RGE=0.75

Subject: Callout
Page Label: 59
Author: CDurham
Date: 12/30/2024 10:51:51 AM
Status:
Color: ■
Layer:
Space:


Unit discharge should be 3.3 cfs as the swale is a v-ditch

Provide a more specific design as it appears velocity could be over allowable.

Flow cfs	Velocity (ft/s)	Depth (ft)
7.50	1.30	0.011
13.50	0.079	0.014

Subject: Callout
Page Label: 57
Author: CDurham
Date: 12/30/2024 11:04:59 AM
Status:
Color: ■
Layer:
Space:

Provide a more specific design as it appears velocity could be over allowable.




Subject: Callout
Page Label: 61
Author: CDurham
Date: 12/30/2024 11:07:28 AM
Status:
Color: ■
Layer:
Space:

Is culvert not using FES? Indicate on drainage map FES or Headwall.

	width. Exceeds max. Depth/Rise
0.00 in	1.23
0.00 in	Address this comment
0.00 in	1.77

Subject: Callout
Page Label: 81
Author: CDurham
Date: 12/30/2024 11:13:25 AM
Status:
Color: ■
Layer:
Space:

Address this comment




Subject: Callout
Page Label: 84
Author: CDurham
Date: 12/30/2024 11:16:40 AM
Status:
Color: ■
Layer:
Space:

Include note on CD's that all pressurized pipes will need to have watertight seals.




Subject: Callout
Page Label: [1] EX DRAIN
Author: CDurham
Date: 12/30/2024 11:29:11 AM
Status:
Color: ■
Layer:
Space:

Show and label Base Flood Elevations in floodplain



Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:31:55 AM
Status:
Color: ■
Layer:
Space:

North side of swale does not appear to have 4:1 side slopes. Please verify




Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:33:25 AM
Status:
Color: ■
Layer:
Space:

Include this label for all other swales shown on plan




Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:34:19 AM
Status:
Color: ■
Layer:
Space:

Can't read contour labels, please make bigger




Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:35:13 AM
Status:
Color: ■
Layer:
Space:

Can't read basin & design point labels



Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:35:35 AM
Status:
Color: ■
Layer:
Space:

Driveway culverts are private



Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:36:03 AM
Status:
Color: ■
Layer:
Space:

Indicate if culvert has FES or headwalls. Design calculations show headwall.



Subject: Callout
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:36:19 AM
Status:
Color: ■
Layer:
Space:

Show and label Base Flood Elevations in floodplain

Highlight (1)



Subject: Highlight
Page Label: [1] PR DRAIN
Author: CDurham
Date: 12/30/2024 11:31:08 AM
Status:
Color: ■
Layer:
Space:

Text Box (7)

41.131:
swale swale discharge into Sand Creek in the existing condition is
1.45. The proposed swale discharge into Sand Creek in the proposed
100-267 cfs, indicating a decrease in the discharge rate into Sand C
42.7%.
Include discussion of suitable outlet. Where do these
flows go? Please provide back-up flow rate for the
outlet.
7. Consider of 0.34 acres of earth embankment located on the northern
side of the swale (Q₁₀=0.2 cfs, Q₁₀₀=1.1 cfs) about three feet above, off-site, 1
year the runoff flows into Sand Creek.
A maximum of 0.34 acres of earth embankment located on the north side

Subject: Text Box
Page Label: 12
Author: CDurham
Date: 12/23/2024 1:24:26 PM
Status:
Color: ■
Layer:
Space:

Unresolved:
Include discussion of suitable outfall. Where do
these flows go, does it handle flows, even if they
are less, etc

2 cfs.
Set has sufficient capacity.
Set has sufficient capacity.
Unresolved:
MHFD Inlet spreadsheet has all inlet types
available. Please use the spreadsheet for inlet
design of Type R and C inlets.

Subject: Text Box
Page Label: 53
Author: CDurham
Date: 12/30/2024 10:23:13 AM
Status:
Color: ■
Layer:
Space:

Unresolved:
MHFD Inlet spreadsheet has all inlet types
available. Please use that spreadsheet for inlet
design of Type R and C inlets .

Chapter 13
Drainage Map has this
swale called out as grass.
Please verify and update
accordingly as to if it is
riprap or grass.
- 1' Min. Freeboard

Subject: Text Box
Page Label: 59
Author: CDurham
Date: 12/30/2024 10:48:19 AM
Status:
Color: ■
Layer:
Space:

Drainage Map has this swale called out as grass.
Please verify and update accordingly as to if it is
riprap or grass.

Q10
L=4
UNI
US1
13-34
This graph is for the overflow
spillways at a pond. Suggest
using a riprap rundown
spreadsheet instead of this one.

Subject: Text Box
Page Label: 59
Author: CDurham
Date: 12/30/2024 10:50:49 AM
Status:
Color: ■
Layer:
Space:

This graph is for the overflow spillways at a pond.
Suggest using a riprap rundown spreadsheet
instead of this one.

Please include back into report
design sheet for the swale in the
Central Drive Aisle which was in
the last submittal.

Subject: Text Box
Page Label: 56
Author: CDurham
Date: 12/30/2024 10:56:17 AM
Status:
Color: ■
Layer:
Space:

Please include back into report design sheet for
the swale in the Central Drive Aisle which was in
the last submittal.

Project: Humphrey Self Storage
Pipe ID: 18" RCP Culvert
Include label to indicate
which culvert this is.

Subject: Text Box
Page Label: 60
Author: CDurham
Date: 12/30/2024 10:57:46 AM
Status:
Color: ■
Layer:
Space:

Include label to indicate which culvert this is.

Indicate what is being done for supercritical condition. Per criteria, FR # needs to be less than 0.9.

Subject: Text Box
Page Label: 61
Author: CDurham
Date: 12/30/2024 11:07:18 AM
Status:
Color: ■
Layer:
Space:

Indicate what is being done for supercritical condition. Per criteria, FR # needs to be less than 0.9.