

DRAINAGE LETTER
for
LOT 7, FALCON MARKETPLACE

7555 Falcon Market Place
Falcon, Colorado

August 25, 2021



Please add "PCD File
No. PPR-21-042".

Prepared for:

Falcon Covenant Group, LLC
2044 California Avenue
Corona, CA 92881
Contact: Julie Margetich
(951) 582-5745

Prepared by:

Drexel, Barrell & Co.
3 South Seventh Street
Colorado Springs, CO 80905
Contact: Tim McConnell, P.E.
(719) 260-0887

TABLE OF CONTENTS

1.0	CERTIFICATION STATEMENTS	1
2.0	PURPOSE	1
3.0	GENERAL SITE DESCRIPTION	1
4.0	DRAINAGE CRITERIA	2
5.0	EXISTING CONDITION	2
6.0	DEVELOPED CONDITION	2
7.0	DRAINAGE & BRIDGE FEES	3
8.0	SUMMARY	3
9.0	REFERENCES	3

APPENDICES

VICINITY MAP
SOILS MAP
FLOODPLAIN MAP
HYDROLOGY CALCULATIONS
DRAINAGE MAP

DRAINAGE LETTER
for
LOT 7, FALCON MARKETPLACE

1.0 CERTIFICATION STATEMENTS

Engineer's Statement

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the city/county for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

SIGNATURE (Affix Seal): _____
For and on behalf of Drexel, Barrell & Co. Date
Tim D. McConnell, P.E. #33797

Developer's Statement

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

Authorized Signature Date
Falcon Covenant Group
2044 California Avenue
Corona, CA 92881

El Paso County

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Jennifer Irvine, P.E. Date
County Engineer / ECM Administrator

Conditions:

DRAINAGE LETTER
for
LOT 7, FALCON MARKETPLACE

2.0 PURPOSE

The purpose of this letter is to supplement the Final Drainage Report for Falcon Marketplace (approved December 19, 2019) with regards to the development of Lot 7 in order to establish that the development is in conformance with the approved drainage design.

Runoff patterns, drainage facilities and the ability to safely pass developed runoff to historic downstream facilities shall be presented.

3.0 GENERAL SITE DESCRIPTION

Location

Lot 7 Falcon Marketplace is located in Falcon, El Paso County, Colorado, within the Southeast Quarter of Section 1, Township 13 South, Range 65 West of the 6th P.M. The property is bounded by Lot 6 of Falcon Marketplace to the north, Lot 8 of Falcon Marketplace to the north, Meridian Road to the west and E. Woodmen Road to the south.

An ALTA and topographical field survey was completed by Clark Land Surveying, dated Jun 15, 2021 and is used as the basis of design for the drainage improvements.

Proposed Development

The proposed development of Lot 7 is the construction of a multi-tenant commercial building, with associated parking and landscaping. The proposed disturbed area consists of 1.02 acres. The imperviousness of the site will increase with this development, but is slightly less than that assumed in the approved Final Drainage Report for the overall Falcon Marketplace development, as described above.

Soils

According to the Soil Survey of El Paso County Area, Colorado, prepared by the U.S. Department of Agriculture Soil Conservation Service, the site is underlain by the Columbine gravelly sandy loam (Soil No. 19), a hydrologic type A soil. See appendix for Soils map.

Climate

This area of El Paso County can be described as the foothills, with total precipitation amounts typical of a semi-arid region. Winters are generally cold and dry, and summers relatively warm and dry. Precipitation ranges from 12 to 14 inches per year, with the majority of this moisture occurring in the spring and summer in the form of rainfall. Thunderstorms are common during the summer months.

Floodplain Statement

According to the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map (FIRM) Panel 08041CO553G (December 7, 2018), a portion of the site lies within Zone A for the Unnamed Tributary to Black Squirrel Creek.

A CLOMR to modify the effective floodplain was approved by FEMA, Case No. 17-08-0074R (May 26, 2017). The construction associated with the LOMR has been completed and the LOMR submitted to FEMA for approval.

4.0 DRAINAGE CRITERIA

The drainage analysis has been prepared in accordance with the current El Paso County Drainage Criteria Manual. Calculations were performed to determine runoff quantities during the 5-year and 100-year frequency storms for existing and developed conditions using the Rational Method as required for basins containing less than 100 acres.

5.0 EXISTING CONDITION

The existing condition is as described in the aforementioned approved Final Drainage Report for the overall Falcon Marketplace development, as part of Basin B19 (see appendix for drainage map excerpt). Overlot grading has been completed and access roadway, detention facilities and utility infrastructure have been installed. The site generally follows a 1%-2% grade from north to south and drains directly into the water quality/detention facility located along the south boundary of the property. A 24" RCP storm sewer stub has been installed to the southwestern corner of the lot.

6.0 DEVELOPED CONDITION

The proposed development consists of a multi-tenant building, and associated parking and landscaping. The proposed grading will route flows to the southwest where they will be captured by the existing 24" RCP storm sewer and directed towards the existing detention facility Pond 2.

See below for basin/design point table and description:

BASIN	DP	AREA (AC)	Q5 (cfs)	Q100 (cfs)
O1	DP1	0.60	2.4	4.3
A	DP2	0.59	2.5	4.5
B		0.12	0.5	0.9
C		0.23	1.0	1.8
	DP3	0.82	3.2	5.8
	DP4	1.53	5.9	10.7
D		0.09	0.0	0.2
E		0.62	0.3	1.9

Basin O1 covers a portion of Lot 6, to the north of Lot 7. This lot is currently undeveloped, but is anticipated to become a commercial property as with the rest of the Falcon Marketplace development. The flows will enter the northeast corner of Lot 7 (Design Point 1) and be captured by the proposed curb and gutter.

Basin A covers the central portion of Lot 7, including the building and proposed north parking. Flows generated by this basin will travel to the southern curb line of the parking lot and be captured by three Type 16 combination inlets, located at low points along the curb line. High points are located at both of the handicap ramp points to eliminate any ponding/freezing. Flows captured by the inlets and roof drain connections from the building will be directed via private 18" storm sewer to the west towards Design Point 2

Basin B covers the western portion of the lot, final roadway grading will be coordinated with Lot 8 to the west, but based on early grading plans is anticipated to follow the same general direction to the south. Flows will culminate at a proposed low point and 5' Type R curb inlet.

Basin C covers the eastern parking area and drive-thru lane, east and south of the building. Flows combine with those from O1 and travel to the south and west towards Design Point 3.

Design Point 4 represents the flows at the proposed private 5' Type R sump inlet located at the southwest corner of the lot buildable area. Flows are captured by this sump inlet in their entirety and directed to the west via existing private 24" RCP storm sewer towards the existing detention facility.

Basin D covers an area of landscaping and will generally flow from north to south towards the existing detention facility.

Basin E covers the remainder of the lot to the south. This area will not be disturbed.

7.0 DRAINAGE & BRIDGE FEES

Drainage and bridge fees are not required as the site has been previously platted.

8.0 SUMMARY

Development of Lot 7 Falcon Marketplace will not adversely affect surrounding or downstream developments. The drainage design is in conformance with that described in the approved Final Drainage Report for Falcon Marketplace.


9.0 REFERENCES

The sources of information used in the development of this study are:

1. El Paso County Drainage Criteria Manual, 10-31-2018.
2. Final Drainage Report for Falcon Marketplace (Drexel, Barrell & Co.) 12-19-2019.


Please compare proposed development and final drainage report. Runoff coefficients show a higher impervious development.

Appendix

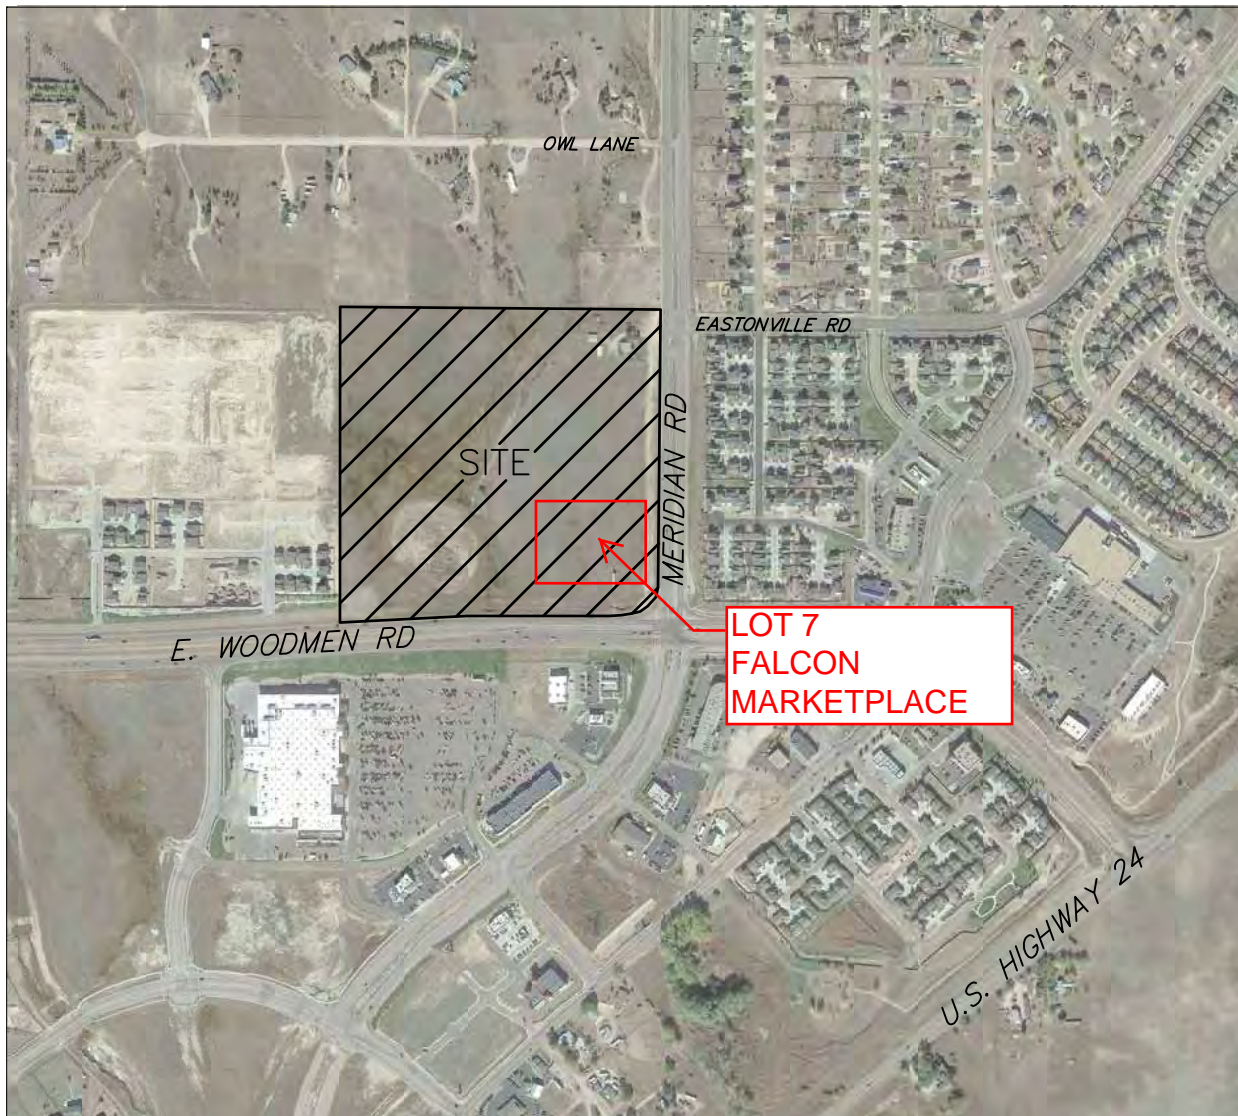

Vicinity Map

NTS



FALCON MARKETPLACE VICINITY MAP

Drexel, Barrell & Co.
Engineers • Surveyors

DATE:
8/18/16

JOB NO:
20988-00

DWG. NO.

VMAP

SHEET 1 OF 1

National Flood Hazard Layer FIRMette



Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
		Area of Undetermined Flood Hazard Zone D
GENERAL STRUCTURES		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
		17.5
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 3/20/2019 at 12:31:27 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

38°56'48.88"N



USGS The National Map: Orthoimagery. Data refreshed October, 2017.

38°56'20.89"N

0 250 500 1,000 1,500 2,000 Feet 1:6,000

104°36'18.33"W


Custom Soil Resource Report Soil Map



Custom Soil Resource Report


MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features

 Blowout

 Borrow Pit

 Clay Spot

 Closed Depression

 Gravel Pit

 Gravelly Spot

 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water


 Perennial Water

 Rock Outcrop


 Saline Spot

 Sandy Spot

 Severely Eroded Spot


 Sinkhole

 Slide or Slip

 Sodic Spot

 Spoil Area

 Stony Spot


 Very Stony Spot

 Wet Spot

 Other

 Special Line Features

Water Features

 Streams and Canals


Transportation

 Rails

 Interstate Highways

 US Routes

 Major Roads

 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL: <http://websoilsurvey.nrcs.usda.gov>
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
Survey Area Data: Version 13, Sep 22, 2015

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 15, 2011—Sep 22, 2011

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

El Paso County Area, Colorado (CO625)			
Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	1.2	3.2%
9	Blakeland-Fluvaquentic Haplaquolls	16.3	43.9%
19	Columbine gravelly sandy loam, 0 to 3 percent slopes	19.6	52.9%
Totals for Area of Interest		37.1	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments

on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

El Paso County Area, Colorado

8—Blakeland loamy sand, 1 to 9 percent slopes

Map Unit Setting

National map unit symbol: 369v

Elevation: 4,600 to 5,800 feet

Mean annual precipitation: 14 to 16 inches

Mean annual air temperature: 46 to 48 degrees F

Frost-free period: 125 to 145 days

Farmland classification: Not prime farmland

Map Unit Composition

Blakeland and similar soils: 85 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blakeland

Setting

Landform: Flats, hills

Landform position (three-dimensional): Side slope, tal

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Alluvium derived from sedimentary rock and/or eolian deposits
derived from sedimentary rock

Typical profile

A - 0 to 11 inches: loamy sand

AC - 11 to 27 inches: loamy sand

C - 27 to 60 inches: sand

Properties and qualities

Slope: 1 to 9 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Somewhat excessively drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95
to 19.98 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum in profile: 5 percent

Available water storage in profile: Low (about 4.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e

Land capability classification (nonirrigated): 6e

Hydrologic Soil Group: A

Ecological site: Sandy Foothill (R049BY210CO)

Minor Components

Other soils

Percent of map unit:

Pleasant

Percent of map unit:

Landform: Depressions

9—Blakeland-Fluvaquentic Haplaquolls

Map Unit Setting

National map unit symbol: 36b6

Elevation: 3,500 to 5,800 feet

Mean annual precipitation: 13 to 17 inches

Mean annual air temperature: 46 to 55 degrees F

Frost-free period: 110 to 165 days

Farmland classification: Not prime farmland

Map Unit Composition

Blakeland and similar soils: 60 percent

Fluvaquentic haplaquolls and similar soils: 30 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Blakeland

Setting

Landform: Flats, hills

Landform position (three-dimensional): Side slope, tal

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Sandy alluvium derived from arkose and/or eolian deposits derived from arkose

Typical profile

A - 0 to 11 inches: loamy sand

AC - 11 to 27 inches: loamy sand

C - 27 to 60 inches: sand

Properties and qualities

Slope: 1 to 9 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Somewhat excessively drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95 to 19.98 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum in profile: 5 percent

Available water storage in profile: Low (about 4.5 inches)

Interpretive groups

Land capability classification (irrigated): 3e

Land capability classification (nonirrigated): 6e

Custom Soil Resource Report

Hydrologic Soil Group: A

Ecological site: Sandy Foothill (R049BY210CO)

Description of Fluvaquentic Haplaquolls

Setting

Landform: Swales

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Alluvium

Typical profile

H1 - 0 to 12 inches: variable

Properties and qualities

Slope: 1 to 2 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Poorly drained

Runoff class: Very high

*Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high
(0.20 to 6.00 in/hr)*

Depth to water table: About 0 to 24 inches

Frequency of flooding: Occasional

Frequency of ponding: None

Salinity, maximum in profile: Nonsaline to slightly saline (0.0 to 4.0 mmhos/cm)

Interpretive groups

Land capability classification (irrigated): 6w

Land capability classification (nonirrigated): 6w

Hydrologic Soil Group: D

Minor Components

Other soils

Percent of map unit:

Pleasant

Percent of map unit:

Landform: Depressions

19—Columbine gravelly sandy loam, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 367p

Elevation: 6,500 to 7,300 feet

Mean annual precipitation: 14 to 16 inches

Mean annual air temperature: 46 to 50 degrees F

Frost-free period: 125 to 145 days

Farmland classification: Not prime farmland

Map Unit Composition

Columbine and similar soils: 85 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Columbine

Setting

Landform: Fans, flood plains, fan terraces

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Alluvium

Typical profile

A - 0 to 14 inches: gravelly sandy loam

C - 14 to 60 inches: very gravelly loamy sand

Properties and qualities

Slope: 0 to 3 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Well drained

Runoff class: Very low

Capacity of the most limiting layer to transmit water (Ksat): High to very high (5.95 to 19.98 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Available water storage in profile: Very low (about 2.5 inches)

Interpretive groups

Land capability classification (irrigated): 4e

Land capability classification (nonirrigated): 6e

Hydrologic Soil Group: A

Ecological site: Gravelly Foothill (R049BY214CO)

Minor Components

Fluvaquentic haplaquolls

Percent of map unit:

Landform: Swales

Other soils

Percent of map unit:

Pleasant

Percent of map unit:

Landform: Depressions

PROJECT INFORMATION

PROJECT: Lot 7 Falcon Marketplace
 PROJECT NO: 20988-09
 DESIGN BY: KGV
 REV. BY: TDM
 AGENCY: El Paso County
 REPORT TYPE: Final
 DATE: 8/27/2021
 Soil Type: A



Drexel, Barrell & Co.

	C2*	C5*	C10*	C100*	% IMPERV
Open Space		0.08		0.35	0
Commercial Development		0.81		0.88	90
Asphalt/Sidewalk/Roof		0.90		0.95	100

*C-Values and Basin Imperviousness based on Table 5-1, El Paso County Drainage Criteria Manual Vol 1

PROPOSED

SUB-BASIN	SURFACE DESIGNATION	AREA ACRE	COMPOSITE RUNOFF COEFFICIENTS				% IMPERV
			C2	C5	C10	C100	
O1	Open Space	0.00		0.08		0.35	0
	Commercial Development	0.60		0.81		0.88	90
	Asphalt/Sidewalk/Roof	0.00		0.90		0.95	100
	WEIGHTED AVERAGE			0.81		0.88	90%
TOTAL O1		0.60					
A	Open Space	0.06		0.08		0.35	0
	Commercial Development	0.00		0.81		0.88	90
	Asphalt/Sidewalk/Roof	0.53		0.90		0.95	100
	WEIGHTED AVERAGE			0.82		0.89	90%
TOTAL A		0.59					
B	Open Space	0.01		0.08		0.35	0
	Commercial Development	0.00		0.81		0.88	90
	Asphalt/Sidewalk/Roof	0.11		0.90		0.95	100
	WEIGHTED AVERAGE			0.83		0.90	92%
TOTAL B		0.12					
C	Open Space	0.02		0.08		0.35	0
	Commercial Development	0.00		0.81		0.88	90
	Asphalt/Sidewalk/Roof	0.21		0.90		0.95	100
	WEIGHTED AVERAGE			0.84		0.91	93%
TOTAL C		0.23					
D	Open Space	0.08		0.08		0.35	0
	Commercial Development	0.00		0.81		0.88	90
	Asphalt/Sidewalk/Roof	0.01		0.90		0.95	100
	WEIGHTED AVERAGE			0.17		0.42	11%
TOTAL D		0.09					
E	Open Space	0.61		0.08		0.35	0
	Commercial Development	0.00		0.81		0.88	90
	Asphalt/Sidewalk/Roof	0.01		0.90		0.95	100
	WEIGHTED AVERAGE			0.09		0.36	2%
TOTAL E		0.62					

PROJECT INFORMATION

PROJECT: Lot 7 Falcon Marketplace
 PROJECT NO: 20988-09
 DESIGN BY: KGV
 REV. BY: TDM
 AGENCY: El Paso County
 REPORT TYPE: Final
 DATE: 8/27/2021



RATIONAL METHOD CALCULATIONS FOR STORM WATER RUNOFF

PROPOSED TIME OF CONCENTRATION STANDARD FORM SF-2

SUB-BASIN DATA					INITIAL/OVERLAND TIME (t _i)				TRAVEL TIME (t _t)					TIME OF CONC. t _c		FINAL t _c
BASIN	DESIGN PT.	C _s	C ₁₀₀	AREA	LENGTH	HT	SLOPE	t _i	LENGTH	HT	SLOPE	VEL.	t _t	COMP. t _c	MINIMUM t _c	
				Ac	Ft	FT	%	Min	Ft	FT	%	FPS	Min	t _c	t _c	Min
O1	DP1	0.81	0.88	0.60	100	1	1.0	5.4	100	1	1.0	4.5	0.4	5.8	5	5.8
A	DP2	0.82	0.89	0.59	50	1	2.0	3.0	150	1.5	1.0	5.9	0.4	3.4	5	5.0
B		0.83	0.90	0.12	20	0.4	2.0	1.8	140	2	1.4	4.7	0.5	2.3	5	5.0
C		0.84	0.91	0.23	20	0.4	2.0	1.7	340	3.4	1.0	4.5	1.3	3.0	5	5.0
DP1+C	DP3	0.82	0.89	0.82				5.8	340	3.4	1.0	5.9	1.0	6.8	5	6.8
DP2+DP3+B	DP4	0.82	0.89	1.53				6.8						6.8	5	6.8
D		0.17	0.42	0.09	100	1	1.0	17.4						17.4	5	17.4
E		0.09	0.36	0.62	50	10	20.0	4.9	75	0.75	1.0	4.5	0.3	5.2	5	5.2

PROJECT INFORMATION

PROJECT: Lot 7 Falcon Marketplace
 PROJECT NO: 20988-09
 DESIGN BY: KGV
 REV. BY: TDM
 AGENCY: El Paso County
 REPORT TYPE: Final
 DATE: 8/27/2021



RATIONAL METHOD CALCULATIONS FOR STORM WATER RUNOFF

PROPOSED	RUNOFF		5 YR STORM		P1= 1.50		
BASIN (S)	DESIGN POINT	AREA (AC)	DIRECT RUNOFF		C * A	I (IN/HR)	Q (CFS)
			RUNOFF COEFF	t _c (MIN)			
O1	DP1	0.60	0.81	5.8	0.48	4.91	2.4
A	DP2	0.59	0.82	5.0	0.48	5.10	2.5
B		0.12	0.83	5.0	0.10	5.10	0.5
C		0.23	0.84	5.0	0.19	5.10	1.0
	DP3	0.82	0.82	6.8	0.67	4.69	3.2
	DP4	1.53	0.82	6.8	1.25	4.69	5.9
D		0.09	0.17	17.4	0.02	3.23	0.0
E		0.62	0.09	5.2	0.06	5.06	0.3


PROJECT INFORMATION

PROJECT: Lot 7 Falcon Marketplace
 PROJECT NO: 20988-09
 DESIGN BY: KGV
 REV. BY: TDM
 AGENCY: El Paso County
 REPORT TYPE: Final
 DATE: 8/27/2021



RATIONAL METHOD CALCULATIONS FOR STORM WATER RUNOFF



PROPOSED	RUNOFF	100 YR STORM	P1= 2.52				
BASIN (S)	DESIGN POINT	AREA (AC)	DIRECT RUNOFF		C * A	I (IN/HR)	Q (CFS)
			RUNOFF COEFF	t _c (MIN)			
O1	DP1	0.60	0.88	5.8	0.52	8.25	4.3
A	DP2	0.59	0.89	5.0	0.52	8.58	4.5
B		0.12	0.90	5.0	0.11	8.58	0.9
C		0.23	0.91	5.0	0.21	8.58	1.8
	DP3	0.82	0.89	6.8	0.73	7.88	5.8
	DP4	1.53	0.89	6.8	1.36	7.88	10.7
D		0.09	0.42	17.4	0.04	5.43	0.2
E		0.62	0.36	5.2	0.22	8.50	1.9

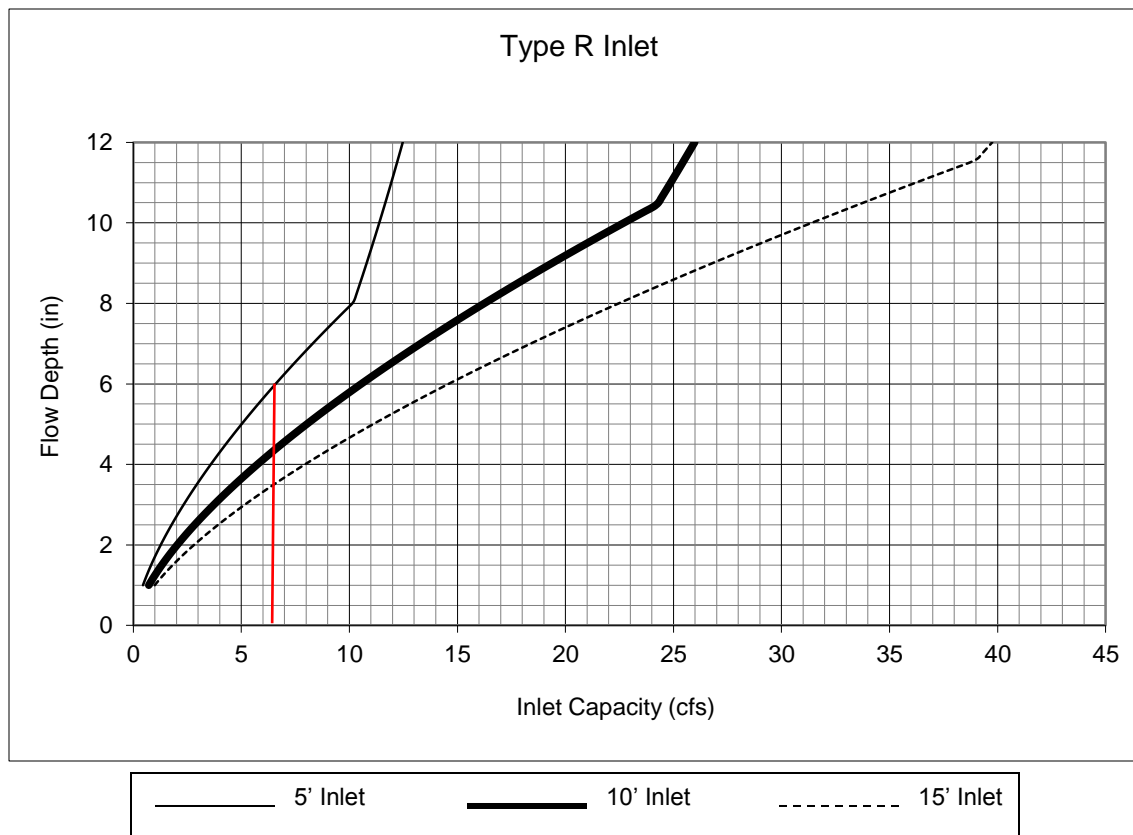Figure 8-11. Inlet Capacity Chart Sump Conditions , Curb Opening (Type R) Inlet**Notes:**

1. The standard inlet parameters must apply to use this chart.

Figure 8.1. Allowable Inlet Capacity— Sump Conditions

Note: See Section 8.3.2 for assumptions.

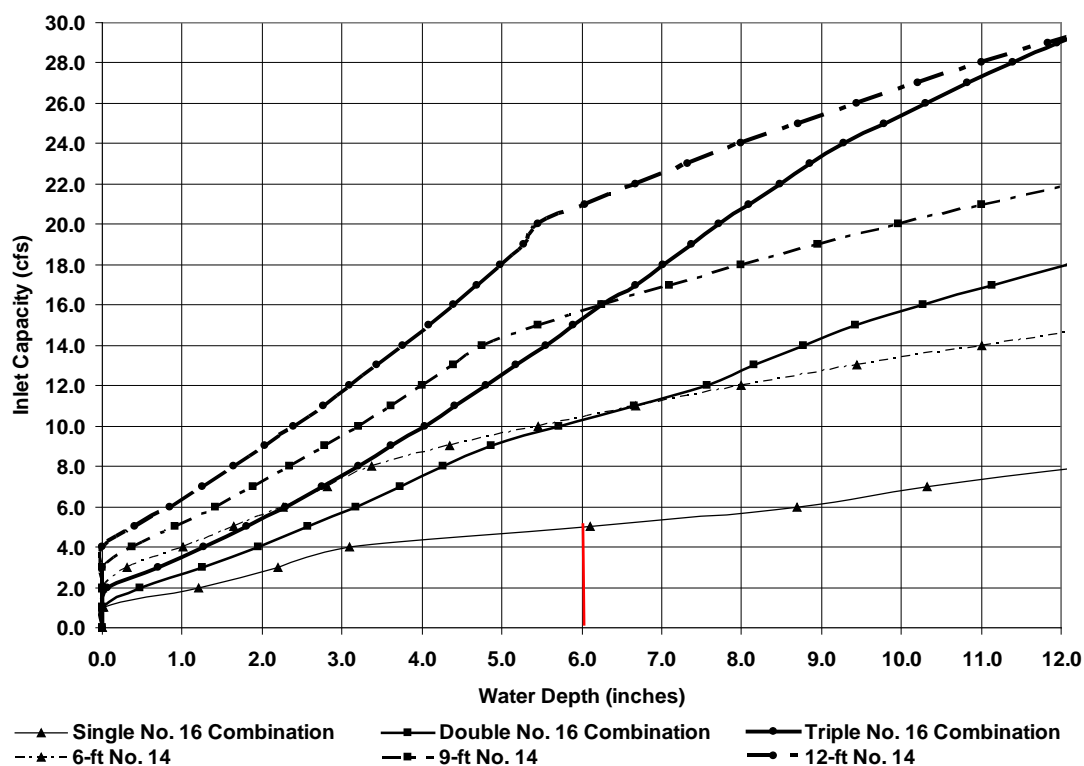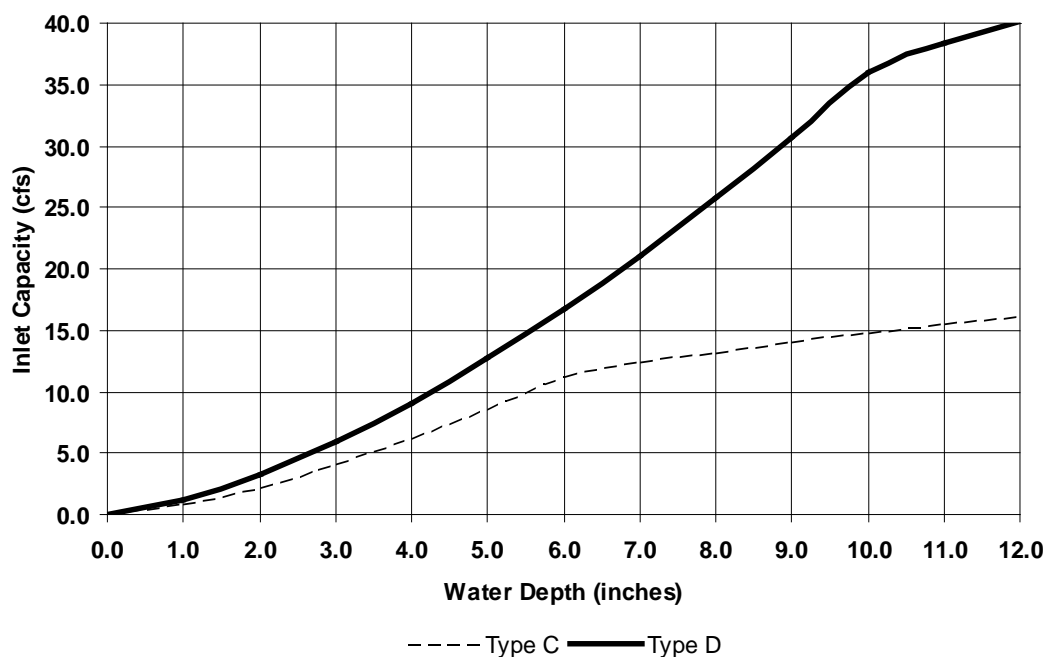Type 16 and Type 14 Inlets for Sump Conditions**Allowable Inlet Capacity for Type C and D Inlets for Sump Conditions**

Program: UDSEWER Math Model Interface 2.1.1.4 Run Date: 8/28/2021 6:35:00 PM	UDSewer Results Summary Project Title: New UDSEWER System Module Project Description: Default system
---	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 5
Rainfall Calculation Method: Formula

One Hour Depth (in): 1.50
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 500
Maximum Urban Overland Len. (ft): 300
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 18.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 2.0

Backwater Calculations:

Tailwater Elevation (ft): 6879.30

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
OUTFALL 1	6881.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

1	6883.00	2.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2	6883.00	2.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
3	6883.00	2.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Manhole Output Summary:

	Local Contribution					Total Design Flow				
Element Name	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	Comment
OUTFALL 1	0.00	0.00	0.00	0.00	0.00	0.39	6.43	1.13	2.50	
1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.50	
2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.50	
3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.50	

Sewer Input Summary:

		Elevation			Loss Coefficients			Given Dimensions		
Element Name	Sewer Length (ft)	Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
1	95.62	6878.10	1.0	6879.06	0.015	1.32	0.00	CIRCULAR	18.00 in	18.00 in
2	109.33	6880.26	1.0	6881.35	0.015	0.38	0.00	CIRCULAR	18.00 in	18.00 in
3	73.27	6881.45	1.0	6882.18	0.015	0.05	0.00	CIRCULAR	18.00 in	18.00 in

Sewer Flow Summary:

	Full Flow Capacity		Critical Flow		Normal Flow						
Element Name	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition	Flow (cfs)	Surcharged Length (ft)	Comment
1	9.13	5.17	7.18	3.80	6.44	4.40	1.24	Supercritical	2.50	0.00	
2	9.13	5.17	7.18	3.80	6.44	4.40	1.24	Supercritical	2.50	0.00	
3	9.13	5.17	7.18	3.80	6.44	4.40	1.24	Supercritical	2.50	0.00	

- A Froude number of 0 indicates that pressurized flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

	Existing	Calculated	Used	
--	----------	------------	------	--

Element Name	Peak Flow (cfs)	Cross Section	Rise	Span	Rise	Span	Rise	Span	Area (ft^2)	Comment
1	2.50	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	
2	2.50	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	
3	2.50	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 6879.30

	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
Element Name	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
1	6878.10	6879.06	0.00	0.00	6879.30	6879.66	6879.34	0.54	6879.88
2	6880.26	6881.35	0.01	0.00	6880.79	6881.95	6881.09	1.08	6882.17
3	6881.45	6882.18	0.00	0.00	6881.98	6882.78	6882.28	0.72	6883.00

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * $V_{fi}^2 / (2 * g)$
- Lateral loss = $V_{fo}^2 / (2 * g)$ - Junction Loss K * $V_{fi}^2 / (2 * g)$.
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft

The minimum trench width is 2.00 ft


					Downstream			Upstream				
Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Volume (cu. yd)	Comment
1	95.62	2.50	4.00	4.92	5.29	3.44	1.19	7.38	4.48	2.23	71.70	Sewer Too Shallow
2	109.33	2.50	4.00	4.92	4.99	3.28	1.03	4.92	2.19	0.00	54.52	Sewer Too Shallow
3	73.27	2.50	4.00	4.92	0.00	2.09	0.00	4.92	1.36	0.00	23.06	Sewer Too Shallow

Total earth volume for sewer trenches = 149 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.

- The sewer wall thickness is equal to: $(\text{equivalent diameter in inches}/12)+1$ inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.

1-3

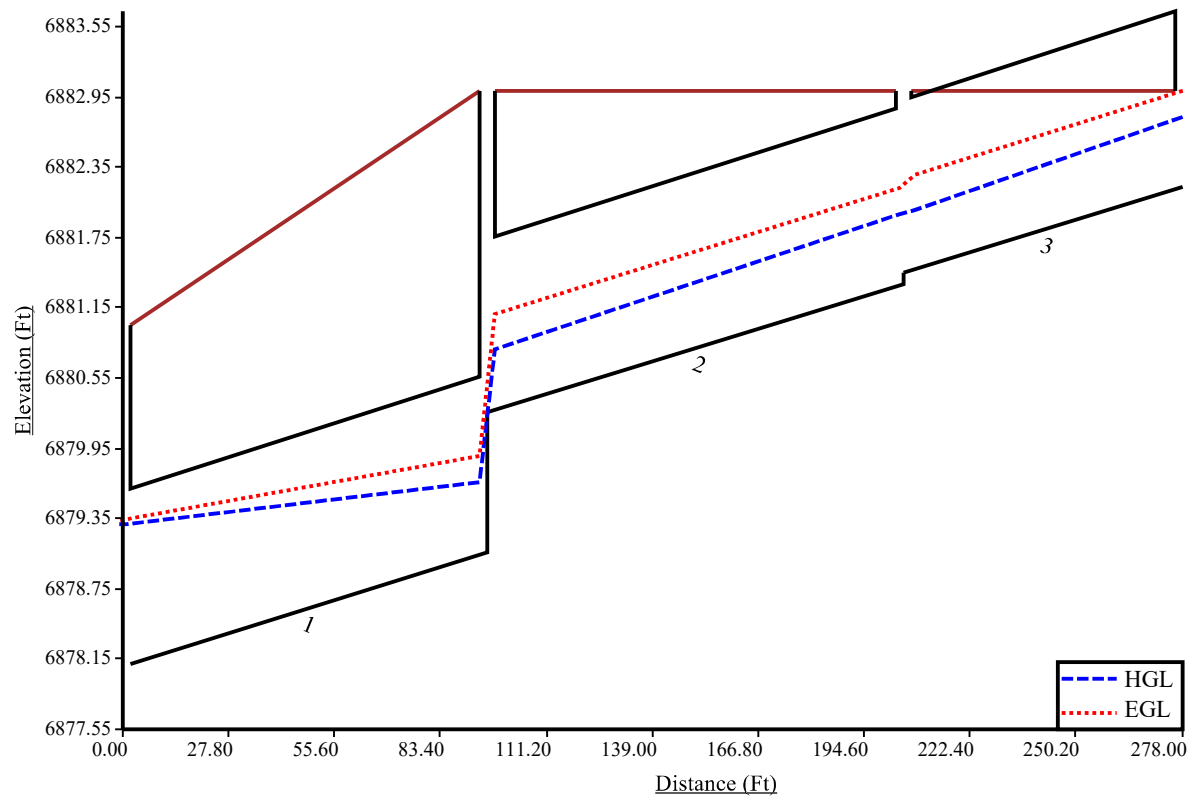

Program: UDSEWER Math Model Interface 2.1.1.4 Run Date: 8/28/2021 6:30:54 PM	UDSewer Results Summary Project Title: New UDSEWER System Module Project Description: Default system
---	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 100
Rainfall Calculation Method: Formula

One Hour Depth (in): 2.52
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 500
Maximum Urban Overland Len. (ft): 300
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 18.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 2.0

Backwater Calculations:

Tailwater Elevation (ft): 6879.60

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
OUTFALL 1	6881.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

1	6883.00	4.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2	6883.00	4.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
3	6883.00	4.50	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Manhole Output Summary:

	Local Contribution					Total Design Flow				
Element Name	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	Comment
OUTFALL 1	0.00	0.00	0.00	0.00	0.00	0.40	11.21	0.63	4.50	
1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.50	
2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.50	
3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.50	

Sewer Input Summary:

		Elevation			Loss Coefficients			Given Dimensions		
Element Name	Sewer Length (ft)	Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
1	95.62	6878.10	1.0	6879.06	0.015	1.32	0.00	CIRCULAR	18.00 in	18.00 in
2	109.33	6880.26	1.0	6881.35	0.015	0.38	0.00	CIRCULAR	18.00 in	18.00 in
3	73.27	6881.45	1.0	6882.18	0.015	0.05	0.00	CIRCULAR	18.00 in	18.00 in

Sewer Flow Summary:

	Full Flow Capacity		Critical Flow		Normal Flow						
Element Name	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition	Flow (cfs)	Surcharged Length (ft)	Comment
1	9.13	5.17	9.77	4.59	8.93	5.15	1.19	Supercritical	4.50	0.00	
2	9.13	5.17	9.77	4.59	8.93	5.15	1.19	Supercritical	4.50	0.00	
3	9.13	5.17	9.77	4.59	8.93	5.15	1.19	Supercritical	4.50	0.00	

- A Froude number of 0 indicates that pressurized flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

	Existing	Calculated	Used	
--	----------	------------	------	--

Element Name	Peak Flow (cfs)	Cross Section	Rise	Span	Rise	Span	Rise	Span	Area (ft^2)	Comment
1	4.50	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	
2	4.50	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	
3	4.50	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 6879.60

	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
Element Name	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
1	6878.10	6879.06	0.00	0.00	6879.60	6879.87	6879.70	0.50	6880.20
2	6880.26	6881.35	0.04	0.00	6881.00	6882.16	6881.41	1.08	6882.49
3	6881.45	6882.18	0.01	0.00	6882.19	6882.99	6882.60	0.72	6883.32

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * $V_{fi}^2 / (2 * g)$
- Lateral loss = $V_{fo}^2 / (2 * g)$ - Junction Loss K * $V_{fi}^2 / (2 * g)$.
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft

The minimum trench width is 2.00 ft


					Downstream			Upstream				
Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Volume (cu. yd)	Comment
1	95.62	2.50	4.00	4.92	5.29	3.44	1.19	7.38	4.48	2.23	71.70	Sewer Too Shallow
2	109.33	2.50	4.00	4.92	4.99	3.28	1.03	4.92	2.19	0.00	54.52	Sewer Too Shallow
3	73.27	2.50	4.00	4.92	0.00	2.09	0.00	4.92	1.36	0.00	23.06	Sewer Too Shallow



Total earth volume for sewer trenches = 149 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.

- The sewer wall thickness is equal to: $(\text{equivalent diameter in inches}/12)+1$ inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.

1-3

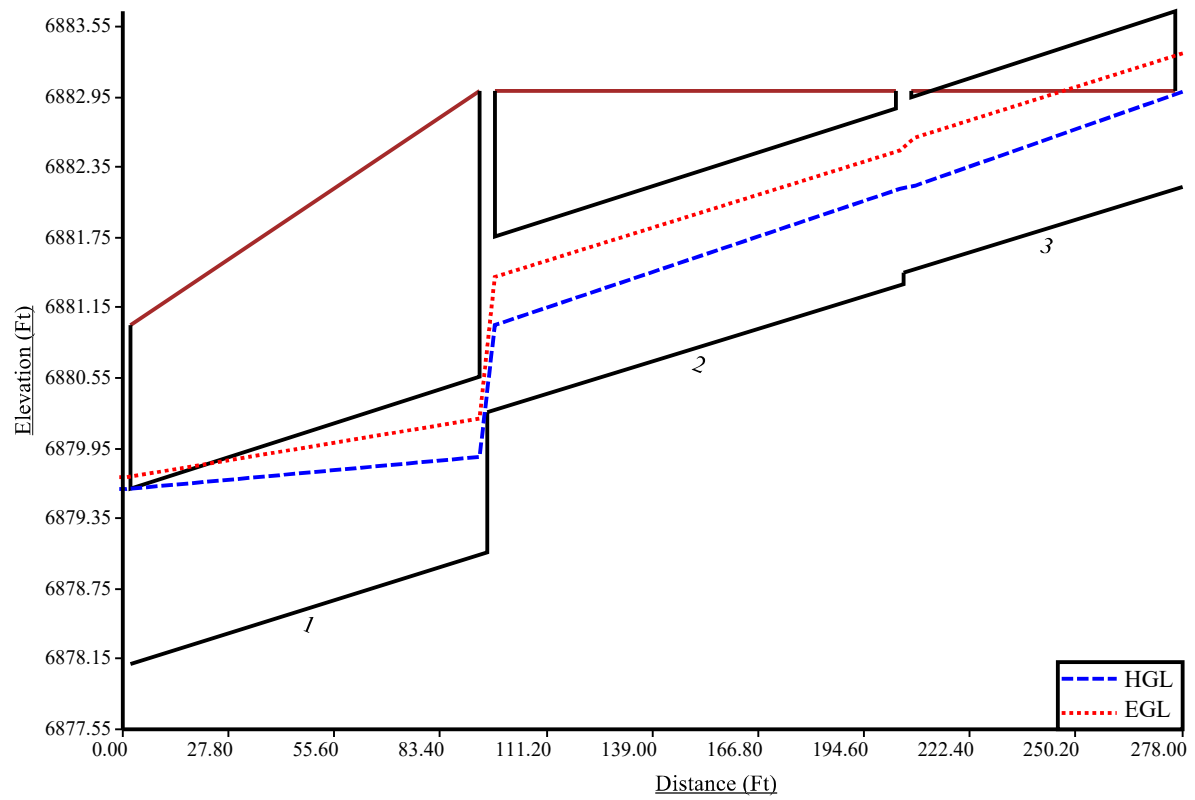

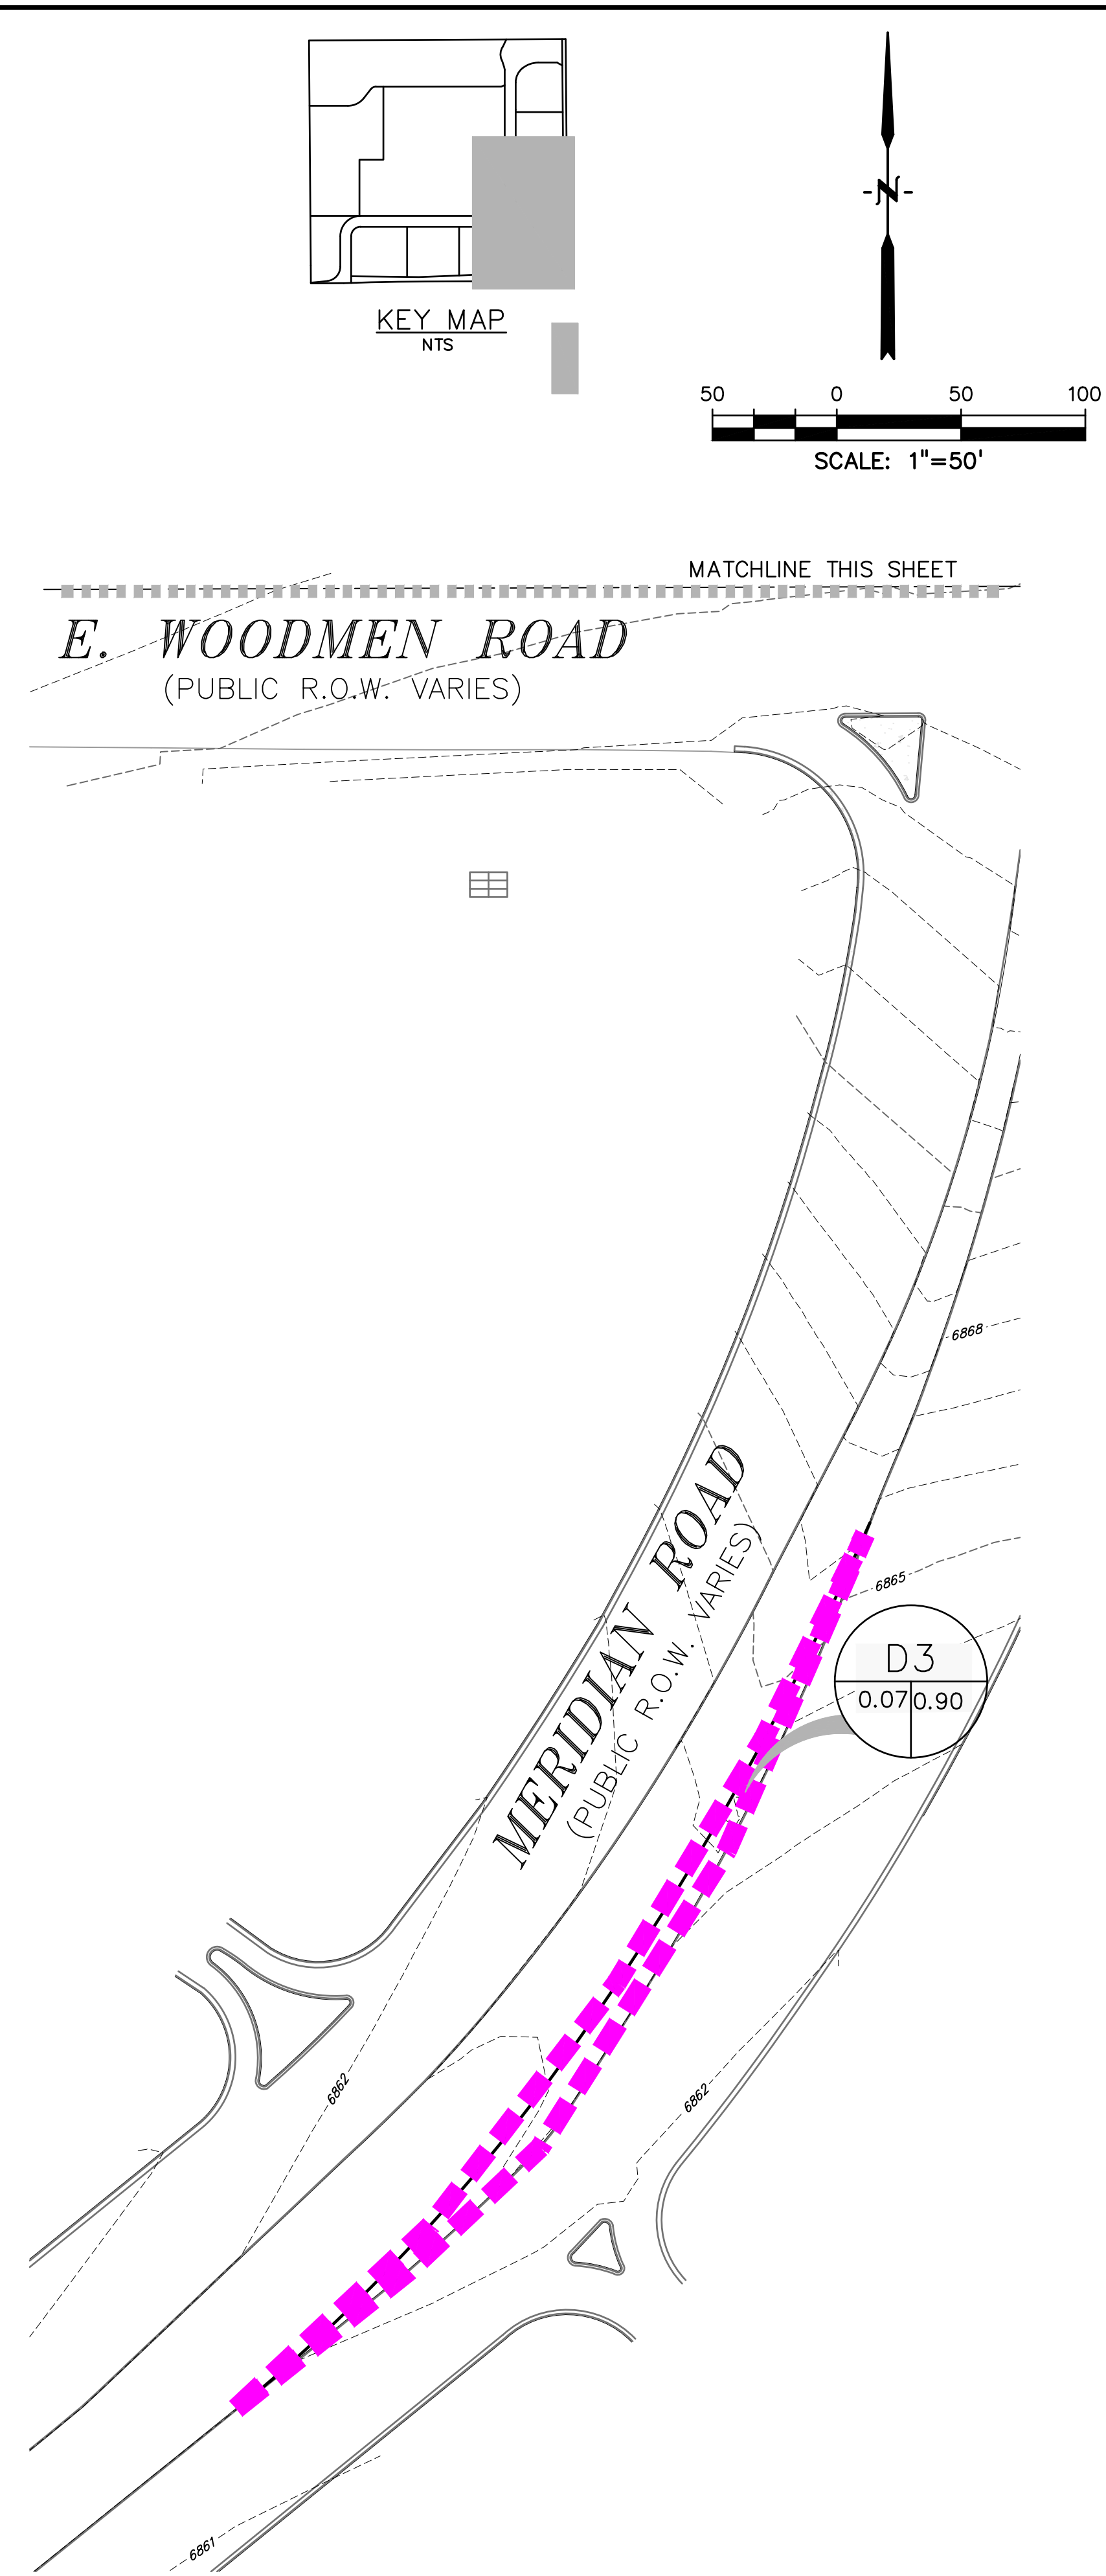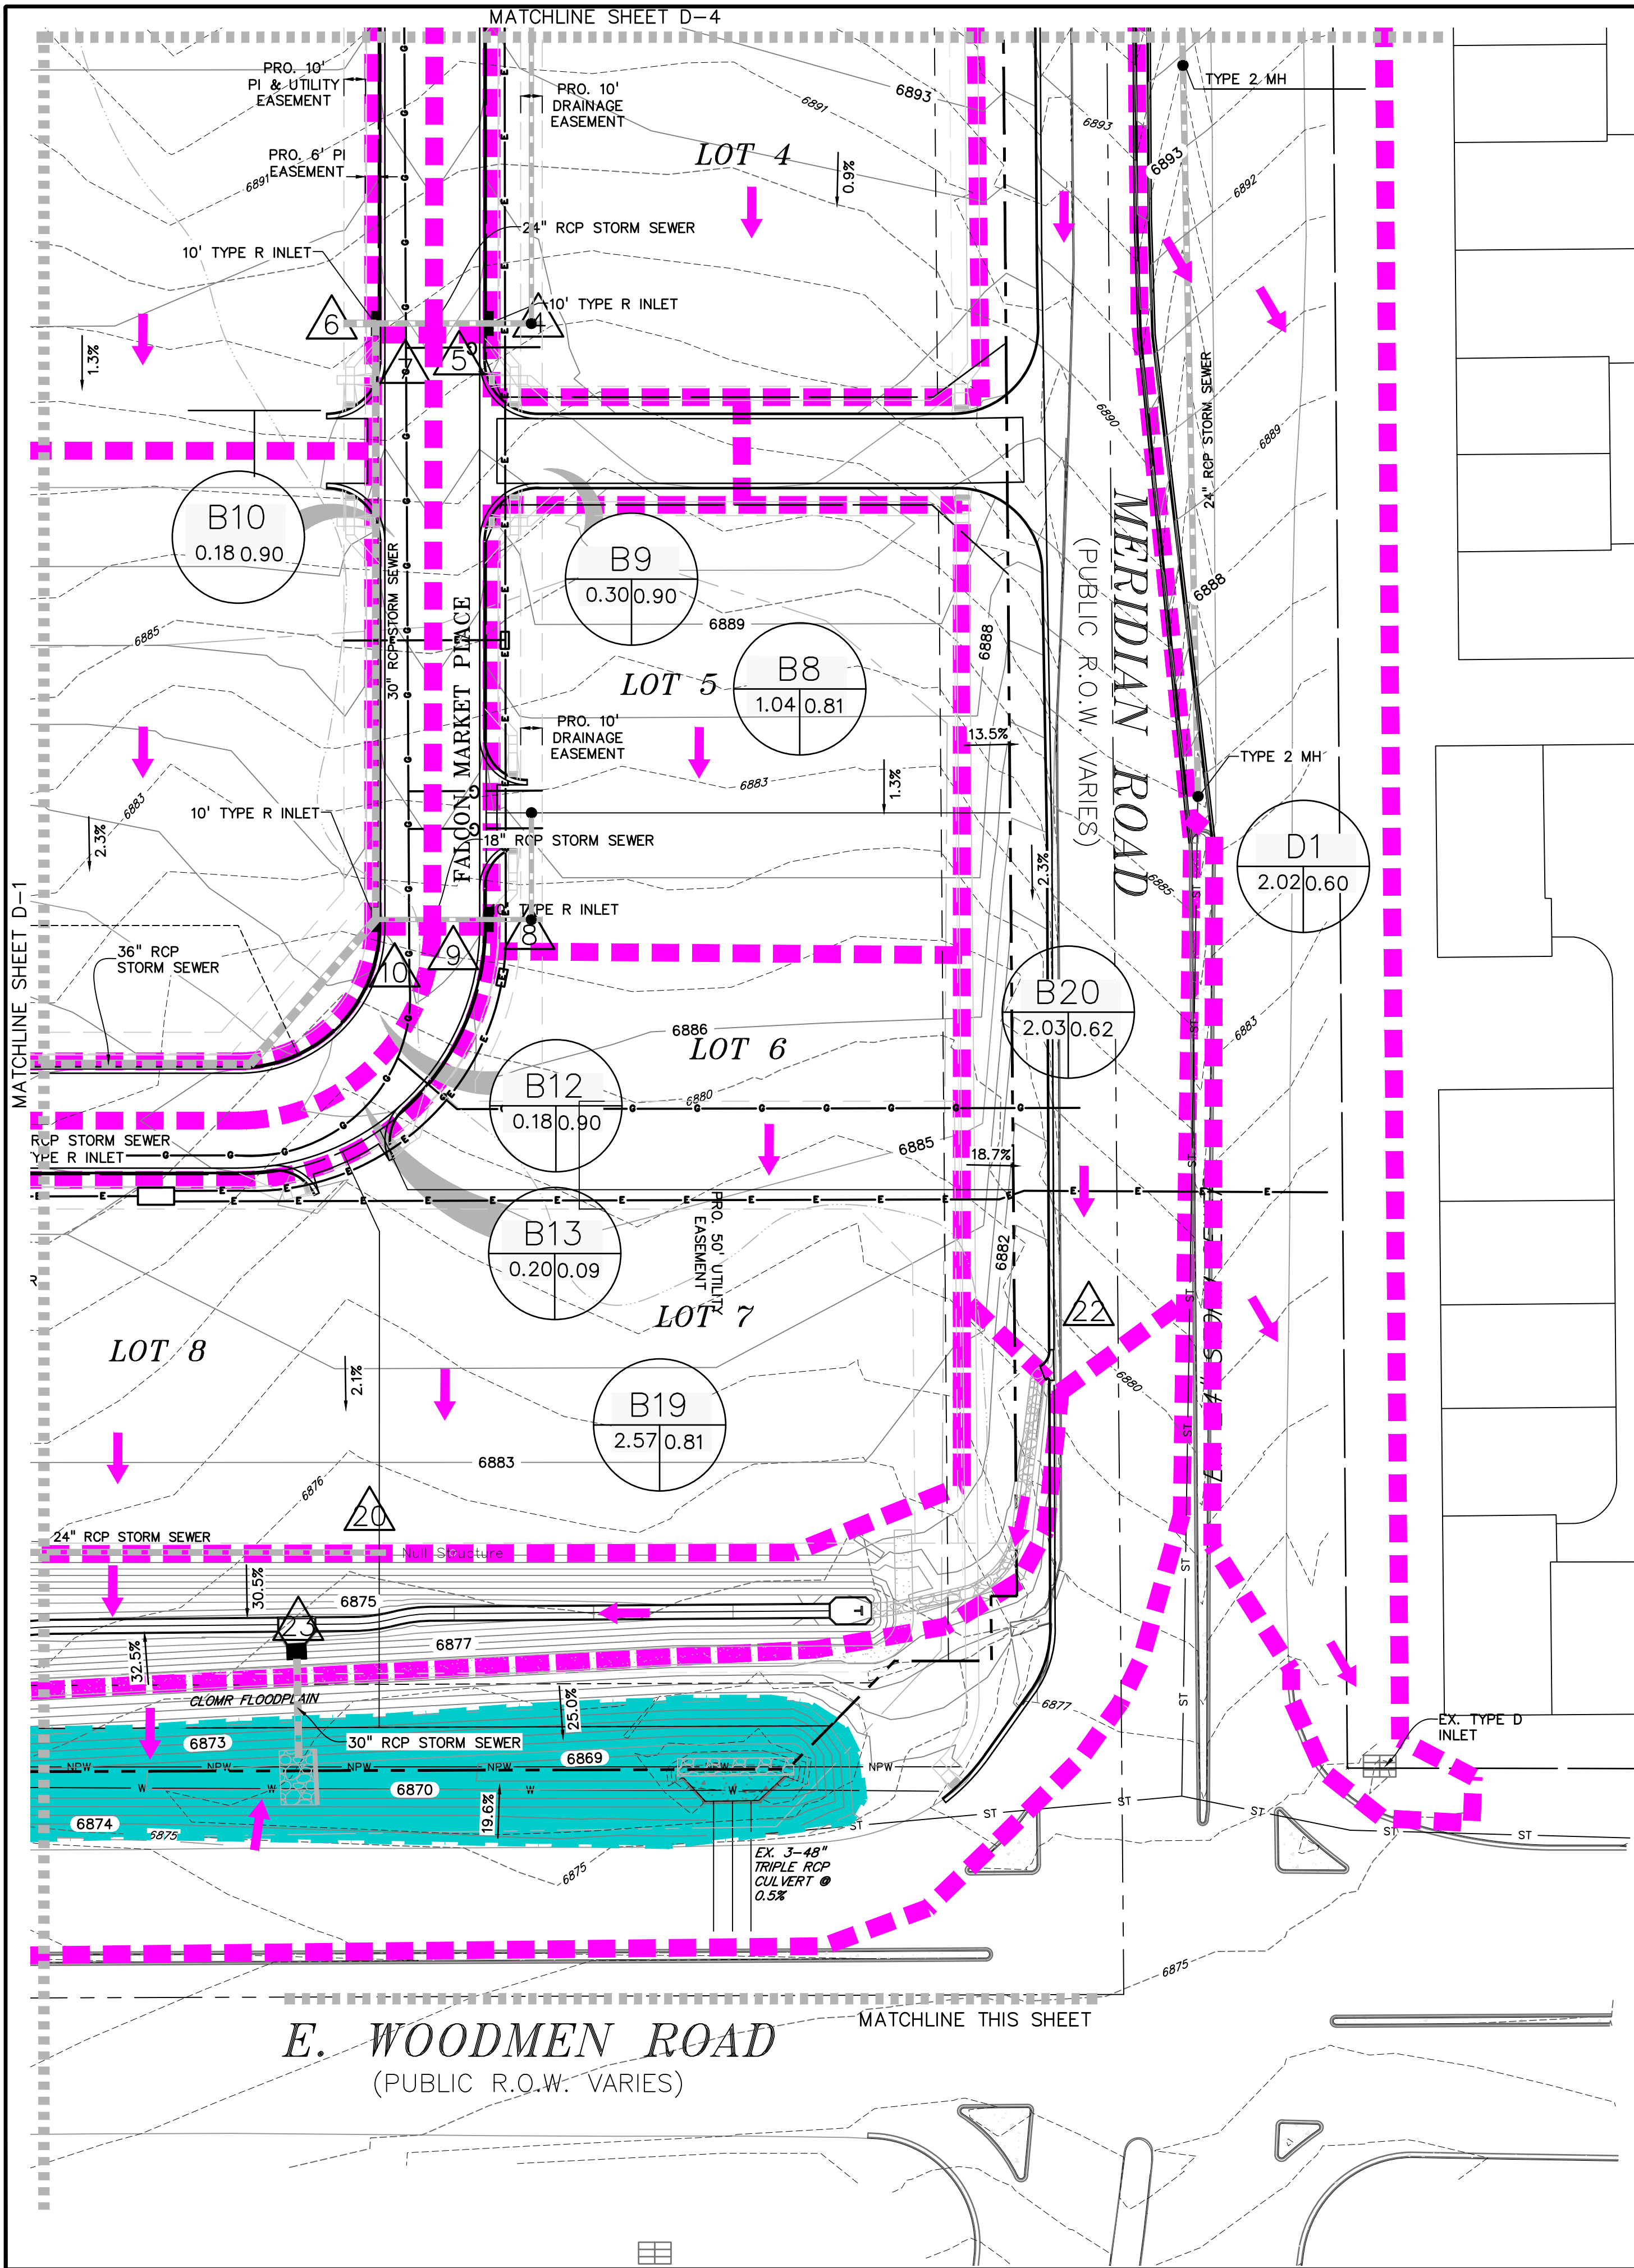


RUNOFF SUMMARY

BASIN	DP	Area (Ac.)	Q _s (CFS)	Q ₁₀₀ (CFS)
A1	DP1	1.81	3.4	7.7
	DP2	1.81	3.4	7.7
A2		4.82	1.4	10.2
	DP3	6.63	4.6	17.3
B4	DP4	2.35	7.5	14.6
B5		0.63	2.8	5.1
	DP5	2.99	10.0	19.3
B6	DP6	3.19	12.8	23.6
B7		0.46	2.0	3.7
	DP7	6.63	23.8	28.0
B8	DP8	1.04	3.5	6.9
B9		0.30	1.4	2.5
	DP9	1.35	4.9	9.3
B10		0.18	0.8	1.4
	DP10	8.16	29.2	38.1
B11	DP11	2.01	7.8	14.6
B12		0.18	0.8	1.5
	DP12	10.35	36.4	51.9
B13		0.20	0.9	1.6
	DP13	10.55	37.1	53.2
B14	DP14	2.49	9.1	17.0
B15	DP15	5.73	20.3	38.0
B16		0.35	1.6	2.9
	DP16	8.56	30.6	57.1
B17		0.33	1.5	2.7

BASIN	DP	Area (Ac.)	Q _s (CFS)	Q ₁₀₀ (CFS)
	DP17	8.89	31.9	59.3
	DP18	19.44	52.1	88.2
B18	DP19	2.18	7.8	15.0
B19	DP20	2.57	10.1	18.8
	DP21	24.19	67.6	117.5
B20	DP22	2.03	5.6	11.4
B21		1.62	0.5	4.0
	DP23	27.85	67.4	121.8
C1	DP24	0.35	1.3	2.6
C2		0.23	0.8	1.5
	DP25	0.59	2.0	3.8
C3		1.88	0.6	4.2
C4		2.19	6.9	13.8
	DP26	4.08	5.4	13.7
C5	DP27	0.64	0.5	1.9
C6		0.45	0.2	1.2
	DP28	5.31	7.4	18.3
C7	DP29	0.19	0.7	1.3
C8		1.14	2.5	5.5
	DP30	1.33	3.1	6.6
C9		3.43	7.3	16.2
D1		2.62	4.1	8.8
D2		0.07	0.3	0.6
D3		0.07	0.3	0.6
DPO1		32.50	10.3	30.2

PREPARED BY:


DREXEL, BARRELL & CO.
Engineers • Surveyors
3 SOUTH 7TH STREET
COLORADO SPGS, COLORADO 80905
CONTACT: TIM D. McCONNELL, P.E.
(719)260-0887
BOULDER • COLORADO SPRINGS

CLIENT:


HUMMEL INVESTMENTS, LLC
8117 PRESTON ROAD, SUITE 120
DALLAS, TEXAS 75225
(214) 416-9820

DRAINAGE PLAN FOR

**FALCON
MARKETPLACE**

FALCON, COLORADO

ISSUE	DATE
INITIAL ISSUE	6-28-19
REVISED	7-19-19
DESIGNED BY:	TDM
DRAWN BY:	KGV
CHECKED BY:	TDM
FILE NAME:	


PREPARED UNDER MY DIRECT
SUPERVISION FOR AND ON BEHALF
OF DREXEL, BARRELL & CO.




DRAWING SCALE:
HORIZONTAL: 1"=50'
VERTICAL: N/A

**PROPOSED
DRAINAGE
CONDITIONS**

PROJECT NO. 20988-00CSCV
DRAWING NO.


D-2

SHEET: 2 OF 5

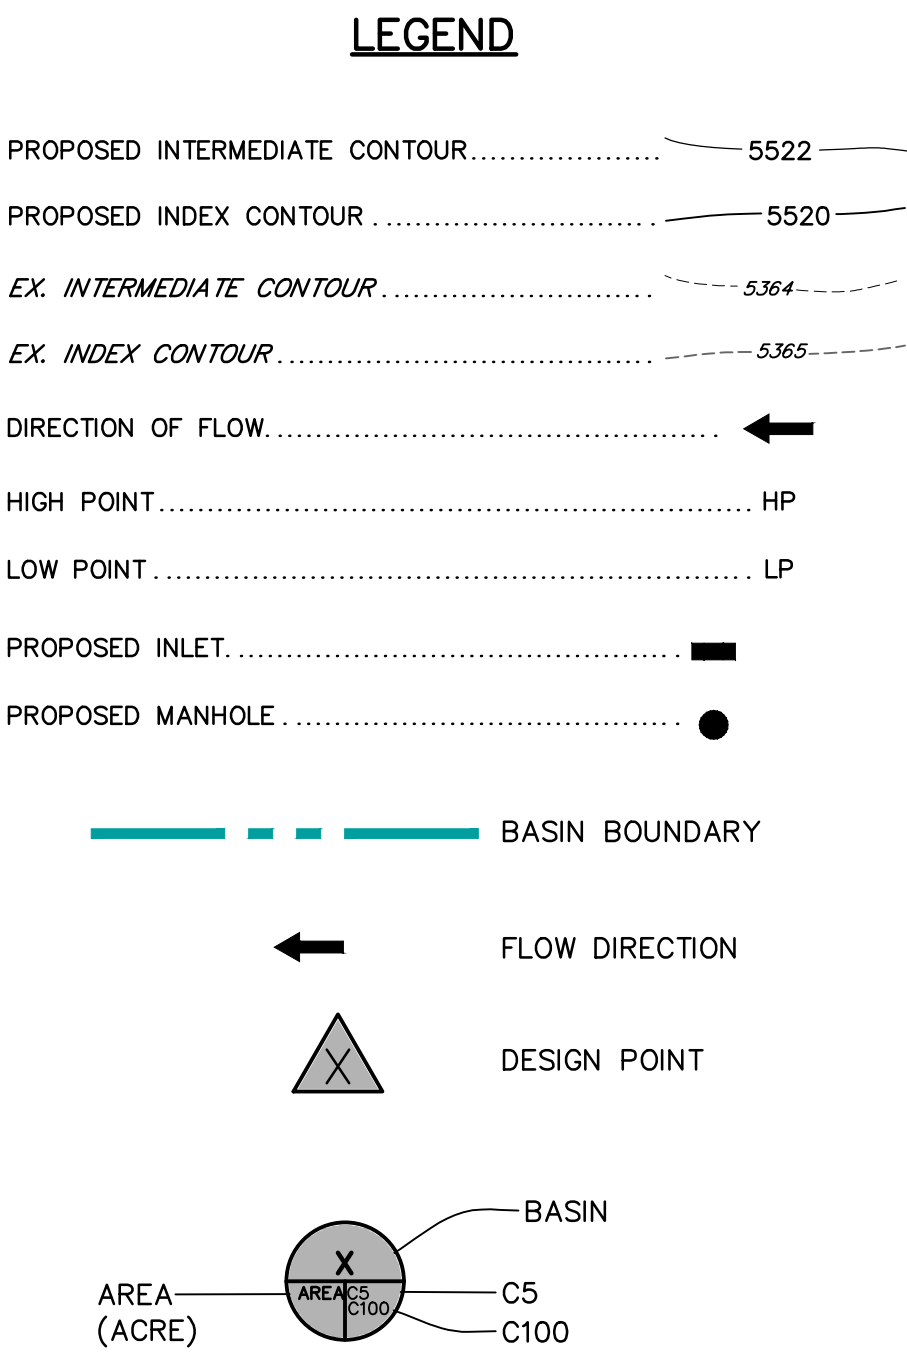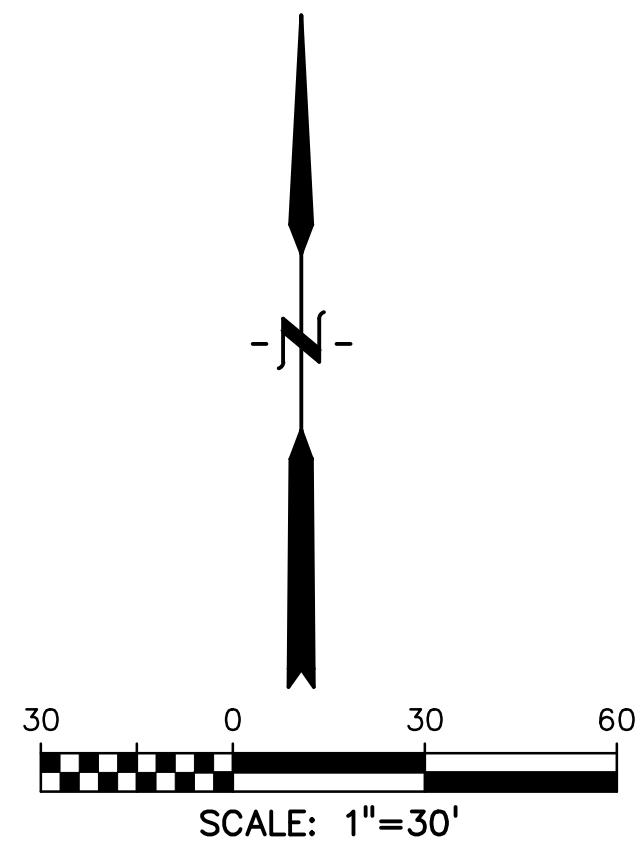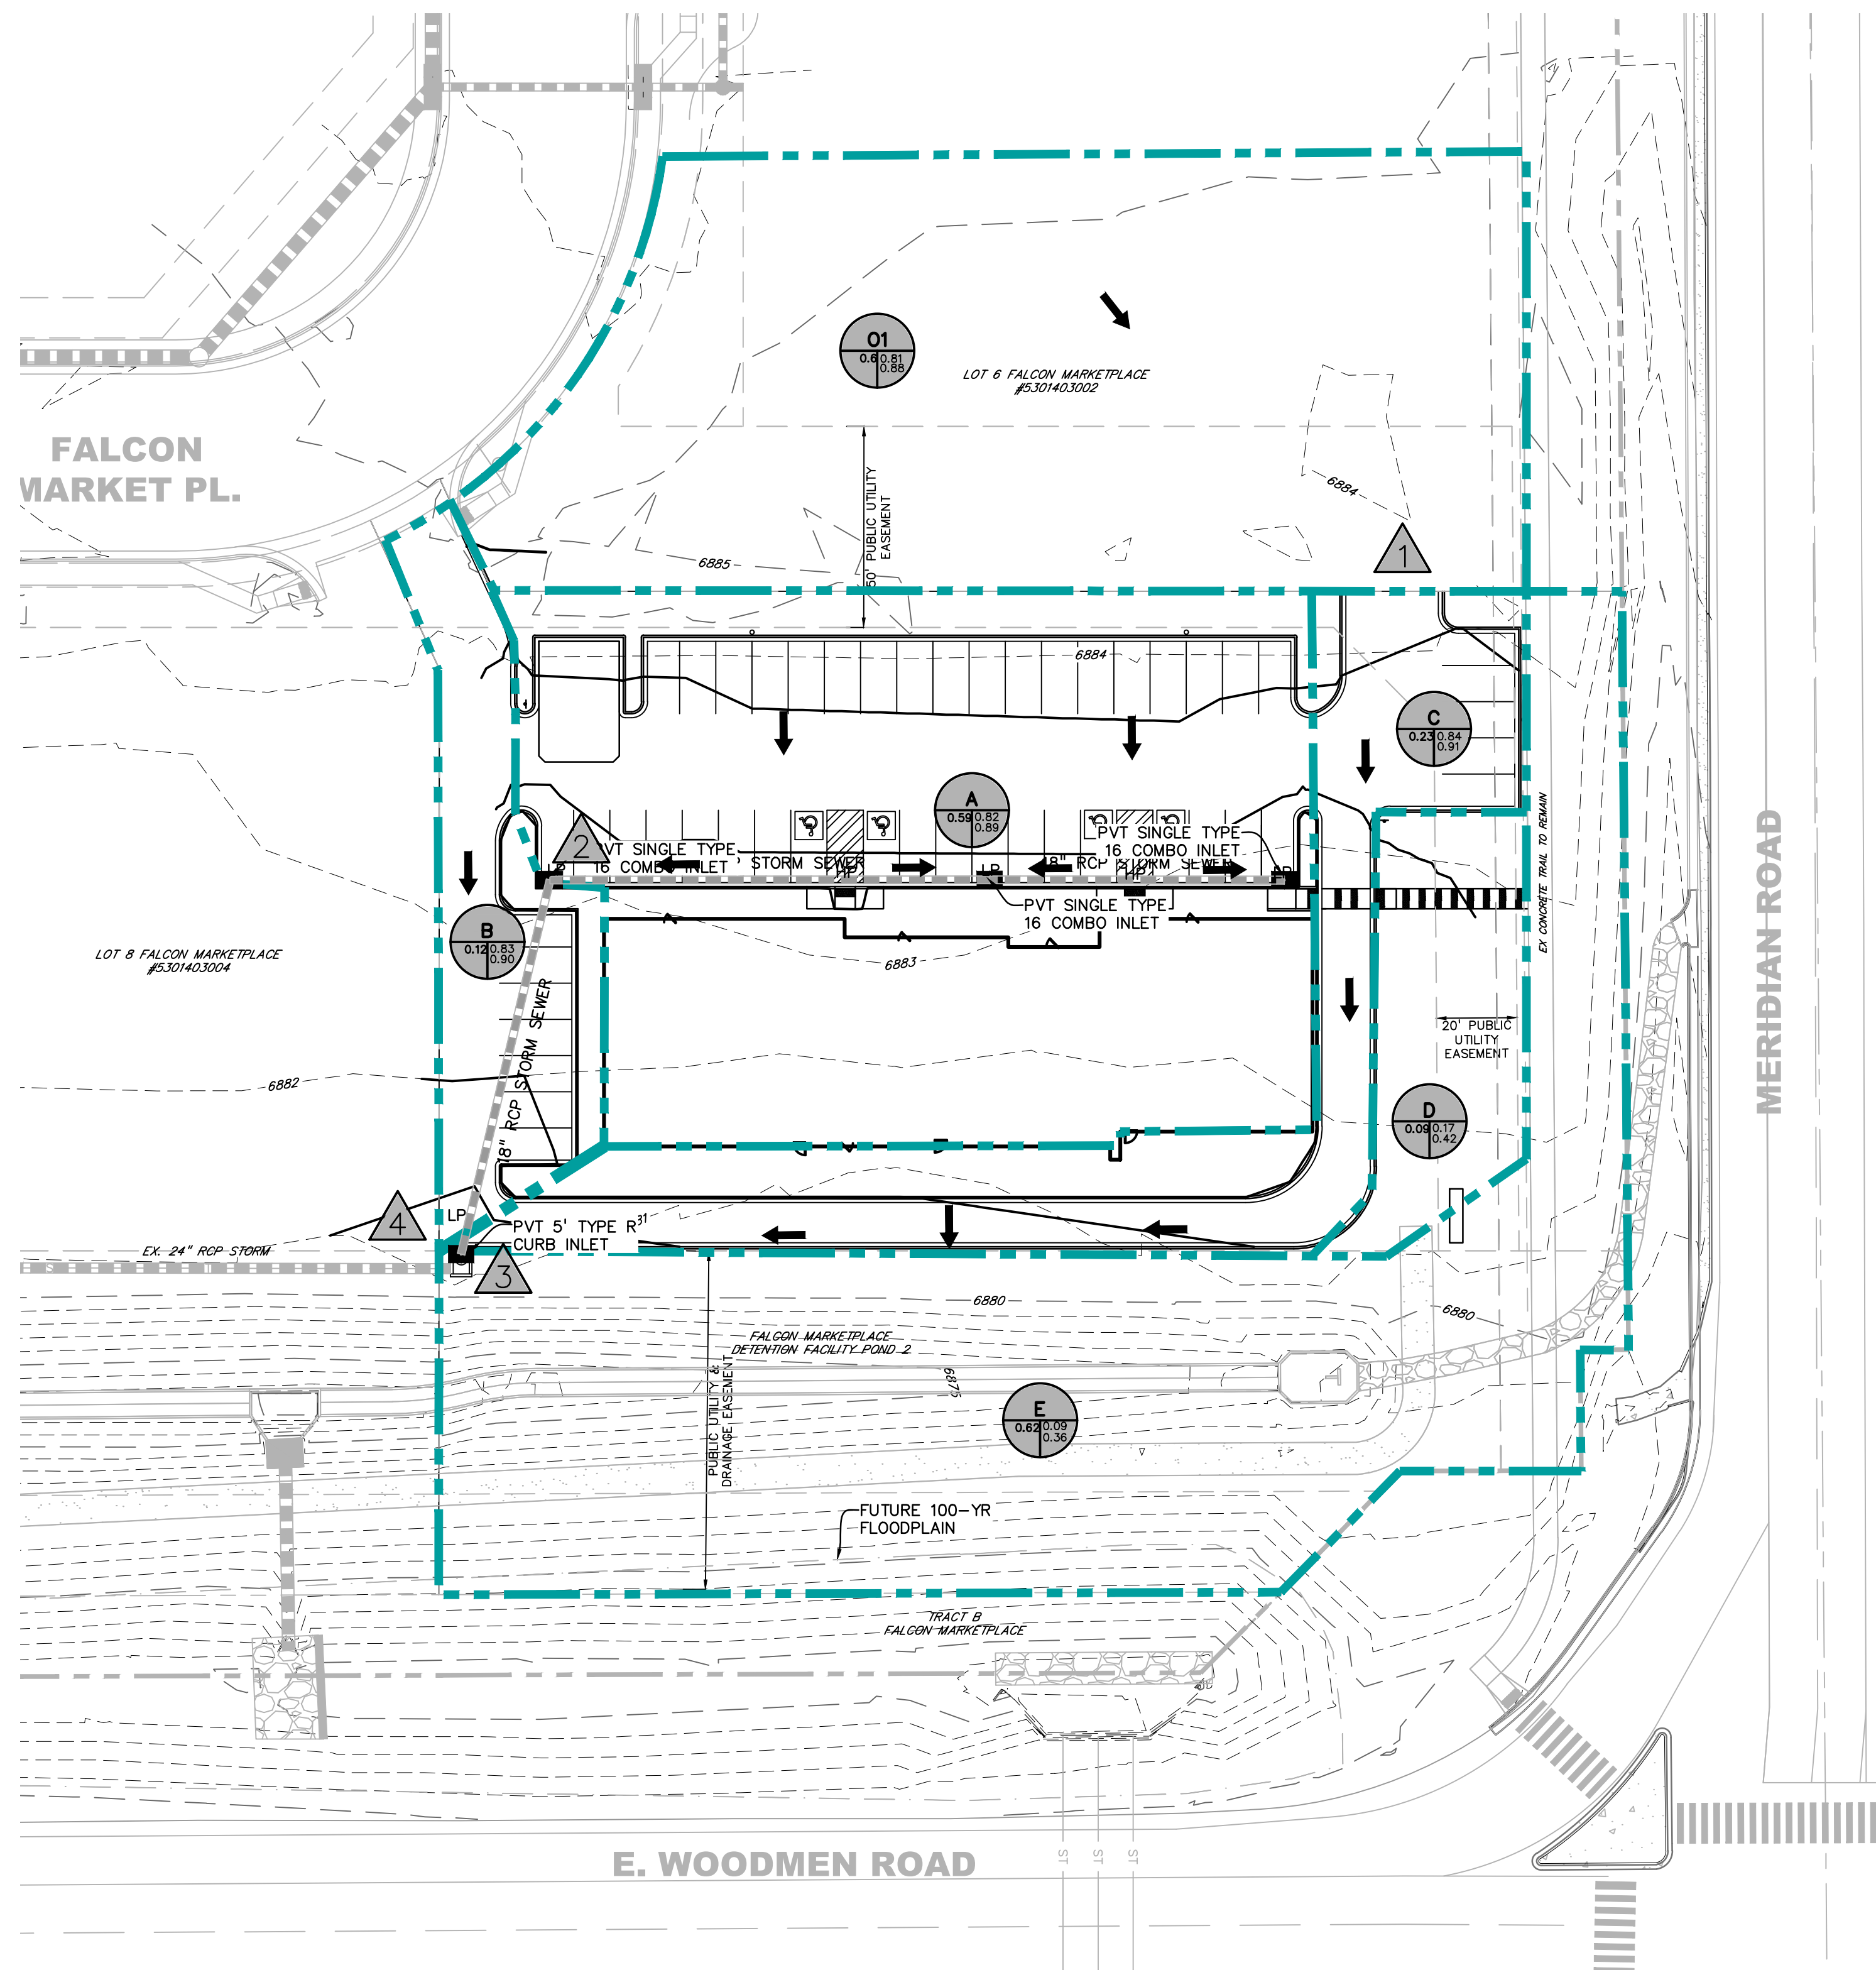

BASIN	DP	AREA (AC)	Q5 (cfs)	Q100 (cfs)
O1	DP1	0.60	2.4	4.3
A	DP2	0.59	2.5	4.5
B		0.12	0.5	0.9
C		0.23	1.0	1.8
	DP3	0.82	3.2	5.8
	DP4	1.53	5.9	10.7
D		0.09	0.0	0.2
E		0.62	0.3	1.9

PREPARED BY:


DREXEL, BARRELL & CO.
Engineers • Surveyors
3 SOUTH 7TH STREET
COLORADO SPGS, COLORADO 80905
CONTACT: TIM D. McCONNELL, P.E.
(719)260-0887
BOULDER • COLORADO SPRINGS • GREELEY

CLIENT:

FALCON COVENANT GROUP, LLC
2044 CALIFORNIA AVE
CORONA, CA 92881

GRADING & EROSION CONTROL PLANS FOR:

**LOT 7, FALCON
MARKETPLACE**
COLORADO SPRINGS, COLORADO

ISSUE	DATE
INITIAL ISSUE	8/26/21
DESIGNED BY:	TDM
DRAWN BY:	KGV
CHECKED BY:	TDM
FILE NAME:	20988-09-DRN

PREPARED UNDER MY DIRECT
SUPERVISION FOR AND ON BEHALF
OF DREXEL, BARRELL & CO.

DRAWING SCALE:
HORIZONTAL: 1" = 100'
VERTICAL: N/A

PROPOSED
DRAINAGE
PLAN

PROJECT NO. 20988-00CSCV
DRAWING NO.

DRN

SHEET: 1 OF 1