

**FINAL DRAINAGE REPORT  
FOR  
ELECTRONIC STORAGE  
LOT 2 MOUNTAIN STATES PIPE AND SUPPLY  
7765 ELECTRONIC DRIVE  
COLORADO SPRINGS, COLORADO**

**NOVEMBER 2020**

Prepared For:  
**D. STEFANO-BUILDING & RESTORATION, INC.**  
520 West 21<sup>ST</sup> Street, G-2 #710  
Norfolk, VA 23517  
757.333.3144

Prepared By:  
**TERRA NOVA ENGINEERING, INC.**  
721 S. 23<sup>RD</sup> Street  
Colorado Springs, CO 80904  
719.635.6422

TNE Job No. 1971.00  
County Job No. PPR-20-020

**FINAL DRAINAGE REPORT  
FOR  
ELECTRONIC STORAGE  
LOT 2 MOUNTAIN STATES PIPE AND SUPPLY  
7765 ELECTRONIC DRIVE  
COLORADO SPRINGS, COLORADO**

**TABLE OF CONTENTS**

Engineer's Statement	Page 3
Purpose	Page 4
General Description	Page 4
Existing Drainage Conditions	Page 5
Proposed Drainage Conditions	Page 6
Hydrologic Calculations	Page 9
Hydraulic Calculations	Page 9
Floodplain Statement	Page 9
Water Quality	Page 9
Construction Cost Opinion	Page 10
Drainage Fees	Page 10
Maintenance	Page 10
Summary	Page 11
Bibliography	Page 11

**APPENDICIES**

VICINITY MAP

S.C.S. SOILS MAP

FEMA FIRM MAP

HYDROLOGIC CALCULATIONS

HYDRAULIC CALCULATIONS

DETENTION CALCULATIONS

DRAINAGE PLAN

**FINAL DRAINAGE REPORT  
FOR  
ELECTRONIC STORAGE  
LOT 2 MOUNTAIN STATES PIPE AND SUPPLY  
7765 ELECTRONIC DRIVE  
COLORADO SPRINGS, COLORADO**

**DESIGN ENGINEER'S STATEMENT:**

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

\_\_\_\_\_  
Dane Frank, P.E. 50207  
On behalf of Terra Nova Engineering, Inc.

\_\_\_\_\_  
Date

**OWNER/DEVELOPER'S STATEMENT:**

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

\_\_\_\_\_  
Authorized Signature

\_\_\_\_\_  
Date

\_\_\_\_\_  
Printed Name, Title

\_\_\_\_\_  
Business Name

\_\_\_\_\_  
Address

---

**EL PASO COUNTY:**

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

\_\_\_\_\_  
Jennifer Irvine, P.E.  
County Engineer / ECM Administrator

\_\_\_\_\_  
Date

Conditions:

**FINAL DRAINAGE REPORT  
FOR  
ELECTRONIC STORAGE  
LOT 2 MOUNTAIN STATES PIPE AND SUPPLY  
7765 ELECTRONIC DRIVE  
COLORADO SPRINGS, COLORADO**

**PURPOSE**

The purpose of this Final Drainage Report is to identify and analyze the proposed drainage patterns, determine proposed runoff quantities, size drainage structures for conveyance of developed runoff, and present solutions to drainage impacts on-site and off-site resulting from this development. The site has previously been platted and has previously been studied in:

“Preliminary and Final Drainage Report for TMC Design Corporation”, dated December 2011, prepared by Stillwater Engineering.

Per El Paso County, there is no record on file that the above report was approved by the County.

**GENERAL DESCRIPTION**

This Final Drainage Report (FDR) is an analysis of approximately 2.25 acres of undeveloped land located at 7765 Electronic Drive. This site is being developed as a mini storage facility. The site is in the southeast quarter of Section 32, Township 13 South, Range 65 West of the 6<sup>th</sup> Principal Meridian within El Paso County. The parcels are bounded to the north by Electronic Drive, to the east by Marksheffel Road, to the south by LOT 6 AKERS ACRES SUB 1, EX THAT PT CONV TO COUNTY FOR R/W BY REC #210004057, and to the west by WLY 631.22 FT OF TRACT 5 AKERS ACRES SUB NO 1. (See vicinity map, Appendix).

The site lies within the Sand Creek Basin, with storm runoff surface draining from the southeast corner of the site, and flowing south, then west along streets, before entering Sand Creek. There are also storm inlets in Marksheffel Road that flow into a storm sewer that flows south along Markcheffel to an unknown outfall, which presumably also drains into Sand Creek.

Soils for this project are delineated by the map in the appendix as Blakeland loamy sand (8), 1 to 9 percent slopes. Soils in the study area are shown as mapped by S.C.S. in the “Soils Survey of El Paso County Area” and contains soils of Hydrologic Group A.

The site is undeveloped with mostly grass and dirt surfaces, and a small number of trees. The site drains to the southeast, with an average slope of 6.1%.

### **EXISTING DRAINAGE CONDITIONS**

There is one existing building and stormwater pond in the southeast corner of the site. There is also a small drainage swale on the south side of Electronic Drive, which is in the right of way, that prevents runoff flowing south from entering the site. There are 24” RCP culverts in this swale at each driveway to the site.

The existing stormwater pond is a 0.16 ac-ft water quality and detention structure that was designed in the 2011 drainage report. It collects runoff from basin EX-A. The pond has an outlet structure that drains to the public storm sewer system via a private storm pipe that leaves the pond/site to the south. This pond appears to be functioning as designed.

There are four drainage basins, two of which are offsite. See attached Existing Drainage Map (in appendix).

Basin OS-Z is 4.01 acres and drains to Design Point Z along Electronic Drive. This basin is offsite and no flow from it enters the site. Basin OS-Z has flows of  $Q_5 = 7.3$  cfs and  $Q_{100} = 16.5$  cfs.

Basin OS-Y is 2.55 acres and drains to Design Point Y at the west side of the site. This basin is offsite and runoff from this basin flows onto the site and into basin EX-B. Basin OS-Y has flows of  $Q_5 = 2.1$  cfs and  $Q_{100} = 8.2$  cfs.

Basin EX-A is 2.54 acres and drains to Design Point A at the existing stormwater pond. After going through the pond, runoff drains through an outlet structure to the public storm sewer system via a private storm pipe that leaves the pond/site to the south. There is also a 18” RCP culvert that

carries water under a paved portion of the basin to the pond. Basin EX-A has flows of  $Q_5 = 3.2$  cfs and  $Q_{100} = 9.5$  cfs.

Basin EX-B is 1.91 acres and drains to Design Point B at the south side of the site. Runoff flows off the site and onto the adjacent property. Basin EX-B has flows of  $Q_5 = 0.9$  cfs and  $Q_{100} = 5.4$  cfs. Design Point B has combined flows of  $Q_5 = 3.0$  cfs and  $Q_{100} = 13.6$  cfs from basins OS-Y and EX-B.

## **PROPOSED DRAINAGE CONDITIONS**

Runoff in the developed conditions consists of 10 basins; seven onsite basins and three offsite basins. Below is a description of the runoff in the developed conditions and how it will be safely routed, treated and detained. See appendix for calculations.

### Offsite Basins

Basin OS-E is 0.44 acres and drains to Design Point E on the western edge of the site. Runoff sheet flows onto the site from Basin OS-E. Basin OS-E has flows of  $Q_5 = 0.4$  cfs and  $Q_{100} = 1.7$  cfs.

Basin OS-F is 1.38 acres and drains to Design Point F on the western edge of the site. Runoff sheet flows onto the site from Basin OS-F. Basin OS-F has flows of  $Q_5 = 1.2$  cfs and  $Q_{100} = 4.6$  cfs.

Basin OS-G is 0.01 acres and drains to Design Point G on the north edge of the site. Runoff sheet flows onto the site from Basin OS-G. Basin OS-G has flows of  $Q_5 = 0.1$  cfs and  $Q_{100} = 0.1$  cfs.

### Onsite Basins

Basin PR-1 is 0.37 acres and drains to Design Point 1 at the northwest edge of the paved area onsite. Basin PR-1 is a hillside, the bottom of which will be at the top of curb at Design Point 1. Basin PR-1 has flows of  $Q_5 = 0.2$  cfs and  $Q_{100} = 1.1$  cfs. Design Point 1 has combined flows of  $Q_5 = 0.6$  cfs and  $Q_{100} = 2.8$  cfs from basins OS-E and PR-1.

Basin PR-2 is 0.62 acres and drains to Design Point 2 at the southeast edge of the paved area onsite. Basin PR-2 has flows of  $Q_5 = 0.2$  cfs and  $Q_{100} = 1.1$  cfs. Design Point 2 has combined flows of  $Q_5 = 3.9$  cfs and  $Q_{100} = 9.4$  cfs from basins OS-E, OS-F, PR-1, and PR-2. There are valley gutters and curb and gutter in this basin that channel runoff around the building and toward the pond. There is a 2'x2' area inlet on the southwest side of the building in this basin that is at the end of the storm sewer the roof drains will connect to, that will provide a cleanout location for this run of storm sewer (this inlet has zero runoff capture). There are two curb inlets at Design Point 2 that each take half of the basin's flow and send it to the pond via storm sewers.

Basin PR-3 is 0.45 acres and drains to Design Point 3 at the southwest edge of the building roof. Roof drains will connect to the adjacent storm sewer on the southwest side of the building. Basin PR-3 has flows of  $Q_5 = 2.3$  cfs and  $Q_{100} = 4.5$  cfs.

Basin PR-4 is 0.32 acres and drains to Design Point 4 at the outlet of the onsite detention basin. Basin PR-4 has flows of  $Q_5 = 0.2$  cfs and  $Q_{100} = 1.2$  cfs. Design Point 4 has combined flows of  $Q_5 = 6.3$  cfs and  $Q_{100} = 15.1$  cfs from basins OS-E, OS-F, PR-1, PR-2, PR-3, and PR-4.

Basin PR-5 is 0.34 acres and drains to Design Point 5 at the southeast corner of the site. This basin is undeveloped/landscaping area. Basin PR-5 has flows of  $Q_5 = 0.1$  cfs and  $Q_{100} = 1.0$  cfs. Design Point 5 has combined flows of  $Q_5 = 1.3$  cfs and  $Q_{100} = 5.6$  cfs from basins OS-F and PR-5.

Basin PR-6 is 0.03 acres and drains to Design Point 6 at the northeast corner of the site. This basin is a landscaping area that flows offsite to the north into the drainage ditch/swale along Electronic Drive. Basin PR-6 has flows of  $Q_5 = 0.0$  cfs and  $Q_{100} = 0.1$  cfs.

Basin PR-7 is 0.13 acres and drains to Design Point 7 at the east edge of the site. This basin is landscaping area that sheet flows offsite to the adjacent lot. Basin PR-7 has flows of  $Q_5 = 0.1$  cfs and  $Q_{100} = 0.6$  cfs. Some of the runoff from this basin will flow into the existing stormwater pond on adjacent Lot 1. The portion of this basin that will flow to the existing pond, is already flowing to the existing pond, so there won't be any change to the flow reaching the existing pond from this basin.

At Design Point 4 the combined flow ( $Q_5=6.3$  cfs and  $Q_{100}=15.1$  cfs) of the development will be captured in a 0.202 acre-foot Extended Detention Basin. Runoff entering the pond on the northwest side will be routed through storm sewers into a 39 cu-ft concrete lined forebay with a 1.0 feet high concrete cutoff wall. A 3 inch notch in the wall drains the flow to a 1' concrete trickle channel, then the runoff is routed to the 3.0' deep micropool which has a 6" deep initial surcharge area. The 1.77 acres tributary to the EDB are 62% impervious. Based upon this we need a WQCV of 0.036 ac-ft, an EURV volume of 0.098 ac-ft and 100-year volume of 0.068 ac-ft for a total volume needed of 0.202 ac-ft. The bottom of the micropool elevation is at 6480.00 while the top of the ISV elevation is at 6483.00. The WQCV orifice starts at 6482.50 with 3 5/8 inch diameter holes spaced 14.60 inches apart. A 2'x2' outlet structure is set at 6485.75. The 100-year elevation tops out at 6486.54. A 12" HDPE outlet will release  $Q_5=0.0$  cfs and  $Q_{100}=1.4$  cfs discharge southeast, across two lots, and to an existing storm inlet (~5'x5' grate). This inlet is piped to an adjacent curb inlet in the Marksheffel Road right of way.

Runoff from the site currently flows to this offsite storm inlet being connected to, either by surface flow, or through the existing stormwater pond on Lot 1. The runoff directed to the proposed onsite pond will no longer surface flow to this offsite inlet, but will instead flow to this inlet through the proposed storm sewer.

In an effort to protect receiving water and as part of the "four-step process to minimize adverse impacts of urbanization" this site was analyzed in the following manner:

1. Reduce Runoff- The proposed impervious areas on the site are surrounded by landscaping and green space areas. Additionally, the new improvements and impervious areas on the site will be routed to a proposed private Extended Detention Basin. These items will reduce the volume of runoff using ponding and infiltration.
2. Stabilize Drainageways- There are no existing or proposed drainageways onsite. Additionally, the outflow of the Extended Detention Basin is carried by storm sewer until it connects with an existing public storm sewer system.
3. Provide Water Quality Capture Volume (WQCV)- The Extended Detention Basin has been sized and designed to sufficiently capture the required WQCV and slowly release it though

the three hole outlet, thereby allowing solids and contaminants to settle out.

4. Consider Need for Industrial and Commercial BMPs- The proposed development is an indoor mini storage facility; therefore, no Industrial and Commercial BMPs have been proposed.

## **HYDROLOGIC CALCULATIONS**

Hydrologic calculations were performed using the El Paso County Storm Drainage Design Criteria Manual - Volumes 1 & 2, latest editions. The Rational Method was used to estimate storm water runoff anticipated from design storms with 5-year and 100-year recurrence intervals. The Urban Drainage Criteria Manual was used to calculate the detention and water quality volume.

## **HYDRAULIC CALCULATIONS**

Hydraulic calculations were estimated using the Manning's Formula and the methods described in the El Paso County Storm Drainage Design Criteria Manual – Volumes 1 & 2, latest editions. The pertinent data sheets are included in the appendix of this report.

A culvert is proposed at the entrance to the site. Design calculations have been included for the proposed culvert.

Street runoff capacity calculations for the onsite drive isles have been included.

## **FLOODPLAIN STATEMENT**

No portion of this site is within a designated F.E.M.A. floodplain, as determined by Flood Insurance Rate Map No. 08041C0756 G, dated December 7, 2018 (see appendix).

## **WATER QUALITY**

The proposed detention basin provides water quality treatment for the proposed development.

Runoff from basins PR-5, PR-6, PR-7, and OS-C are not captured by the proposed detention basin. Basin PR-5 is a landscaping area, some of which is below the detention pond, with no impervious area. Basin PR-6 is a landscaping area, behind a curb, with no impervious area. Basin PR-7 is a

landscaping area, all of which flows away from the detention pond, some of which flows to the existing stormwater pond on Lot 1. Basin OS-G is a part of the driveway in the right of way that drains into the existing drainage road side drainage swale that it crosses. The combined area of these basins is 0.51 acres, with only 0.01 acres (driveway) being impervious. Basins PR-5, PR-6, and PR-7 would qualify as grass buffers, which provide water quality treatment, and can be considered undeveloped (open space). Section I.7.1.C.1 of the ECM allows up to 20%, not to exceed 1 acre, of a development site to not be treated for water quality.

**CONSTRUCTION COST OPINION**

**Public Reimbursable**

None

**Public Non-Reimbursable**

1. 24" RCP	50 LF	\$ 78	<u>\$ 3,900</u>
			<b>Total \$ 3,900</b>

**Private Non-Reimbursable**

1. 12" HDPE	707 LF	\$ 40	\$ 28,280
2. 15" HDPE	82 LF	\$ 45	\$ 3,690
3. 2'x2' Area Inlet	1 EA	\$ 3,000	\$ 3,000
4. 8' D-10-R Curb Inlet	2 EA	\$ 7,800	\$ 15,600
2. EDB	1 EA	\$ 60,000	<u>\$ 60,000</u>
			<b>Total \$ 110,570</b>

**DRAINAGE FEES**

This drainage report is part of a site development application; therefore, no drainage fees are due.

**MAINTENANCE**

The Extended Detention Basin is private and will be maintained by the property owner. The proposed storm sewers are private and will be maintained by the property owner. The proposed culvert is public and will be maintained by the County.

## **SUMMARY**

Development of this site will not adversely affect the surrounding development. This report is in general conformance with the previous reports which included this site. Site runoff and storm drain appurtenances from the Electronic Storage development will not adversely affect the downstream and surrounding developments and will be safely routed to the proposed extended detention basin and runoff reduced to the allowable pre-developed rates while slowly treating the water quality capture volume. Runoff leaving the proposed extended detention basin is then routed to the existing public storm sewer system.

**PREPARED BY:**  
**TERRA NOVA ENGINEERING, INC.**

Dane Frank, P.E.  
Project Engineer

Jobs/1971.00/drainage/197100 FDR.doc

## **BIBLIOGRAPHY**

El Paso County Drainage Criteria Manual-Volumes 1 & 2, latest edition


El Paso County Board Resolution No 15-042 (Adoption of Chapter 6 and Section 3.2.1 Chapter 13 of the City of Colorado Springs Drainage Criteria Manual dated May 2014, Hydrology and Full Spectrum Detention)

Preliminary and Final Drainage Report for TMC Design Corporation, dated December 2011, prepared by Stillwater Engineering

## **VICINITY MAP**



Electronic Storage - Vicinity Map

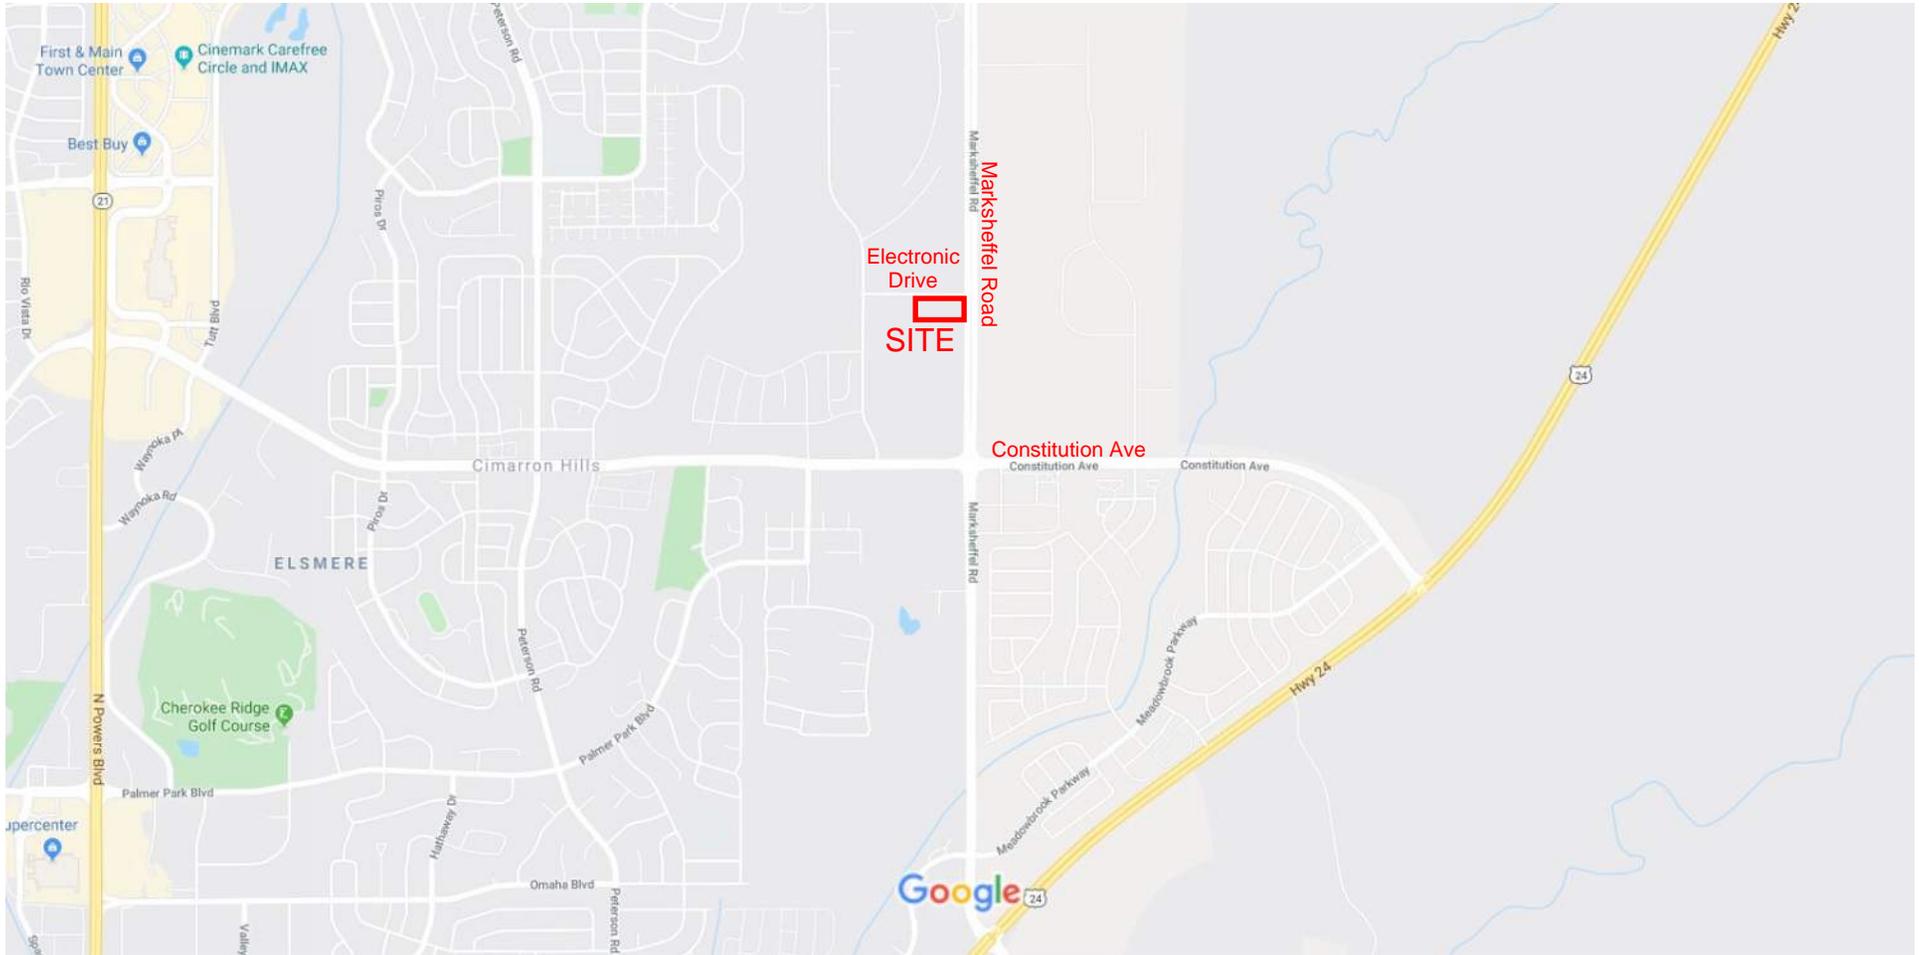

Map data ©2019 Google 1000 ft

North is up ^

# Electronic Storage - Location Map

Image Dated Oct 2018

Electronic Dr



SITE

Markshreffel Rd

Google Earth


© 2018 Google

400 ft




**S.C.S. SOILS MAP**

Soil Map—El Paso County Area, Colorado  
(Electronic Storage)

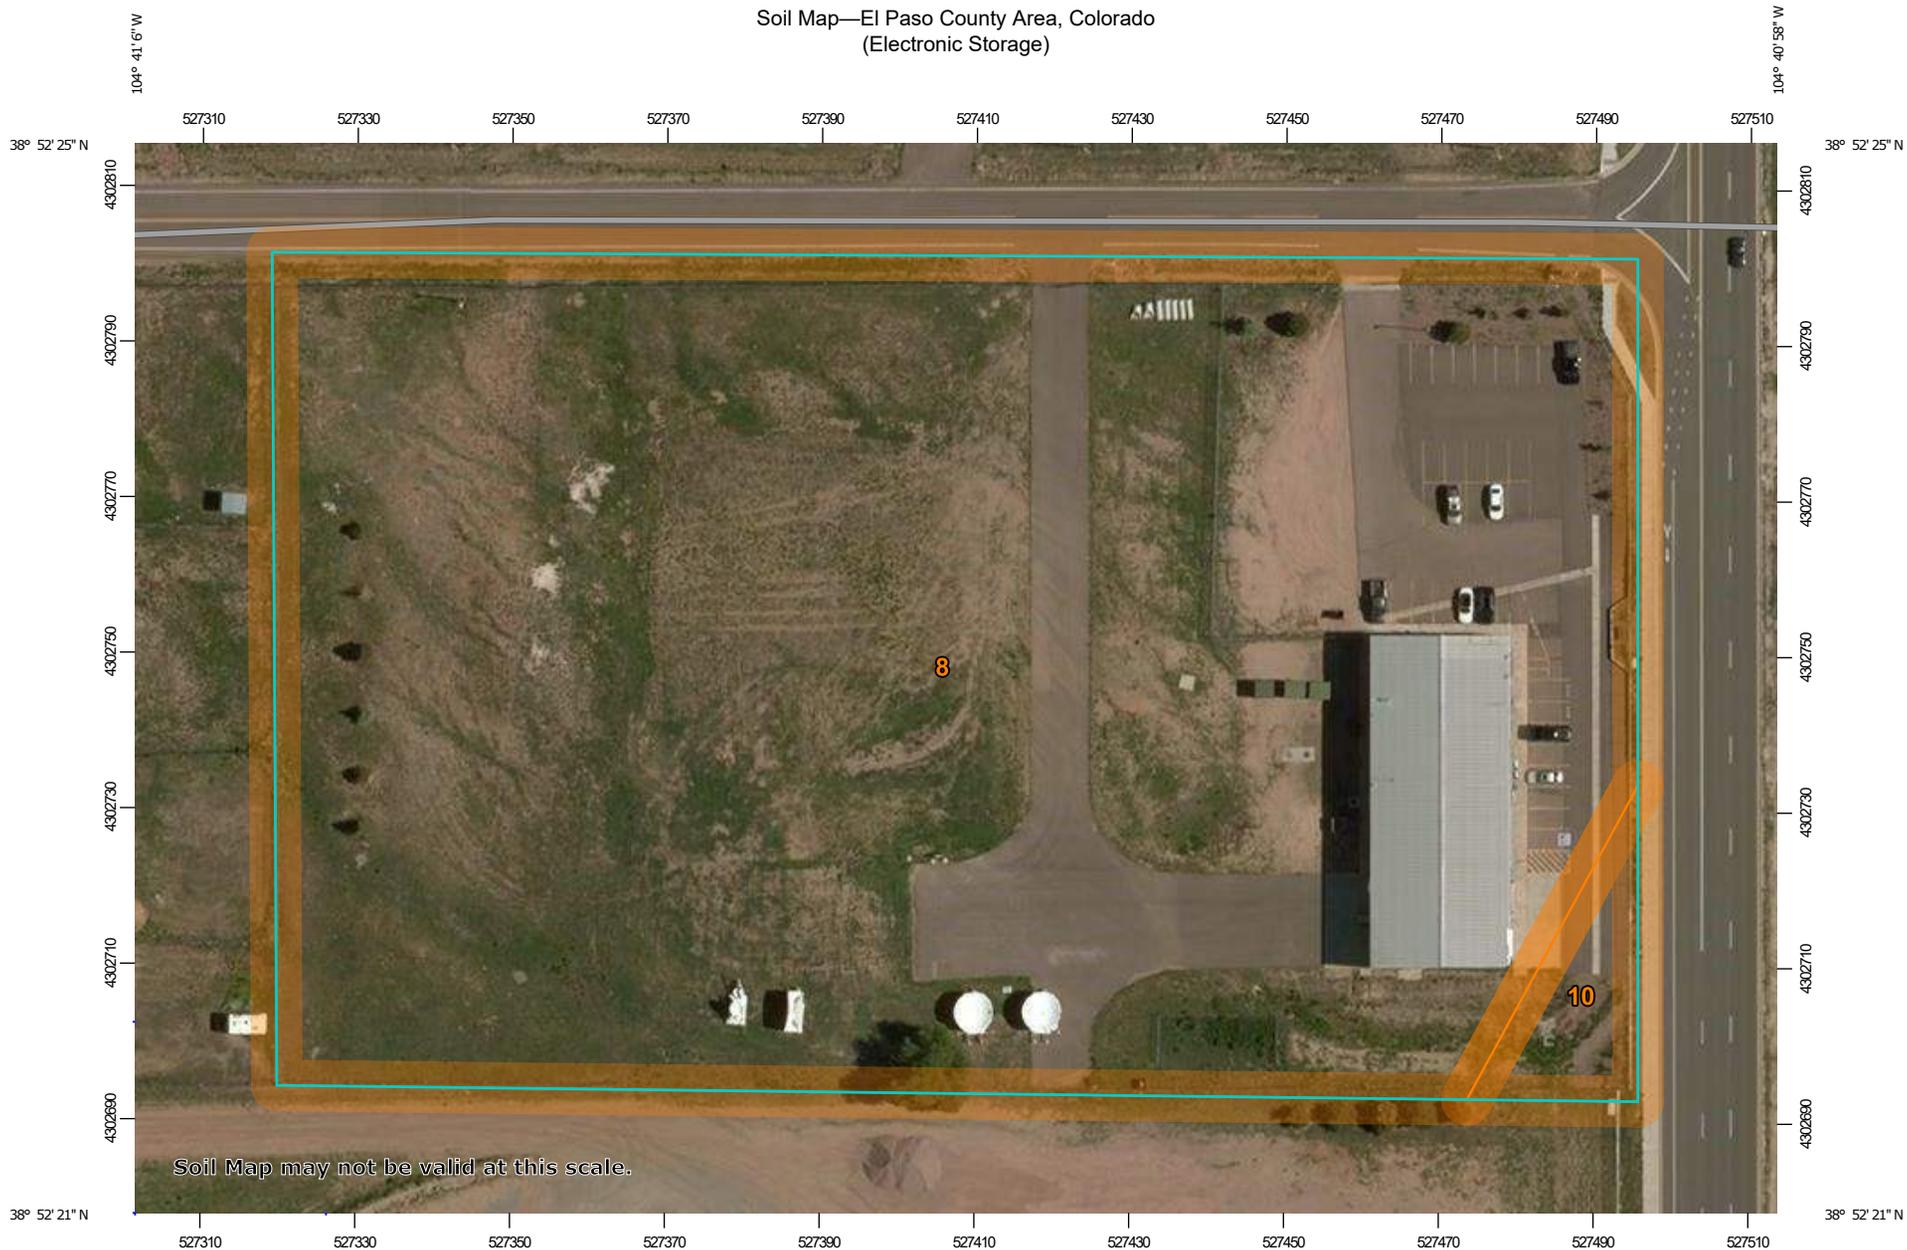

Soil Map may not be valid at this scale.

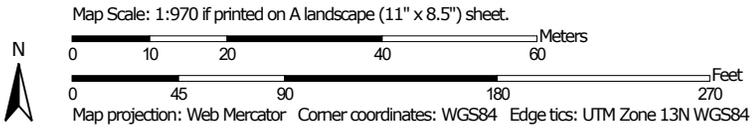

## MAP LEGEND

### Area of Interest (AOI)

Area of Interest (AOI)

### Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

### Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

### Water Features



Streams and Canals

### Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

### Background



Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

**Warning:** Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
Web Soil Survey URL:  
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
Survey Area Data: Version 17, Sep 13, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 3, 2014—Jun 17, 2014

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	4.6	97.6%
10	Blendon sandy loam, 0 to 3 percent slopes	0.1	2.4%
<b>Totals for Area of Interest</b>		<b>4.7</b>	<b>100.0%</b>

## El Paso County Area, Colorado

### 8—Blakeland loamy sand, 1 to 9 percent slopes

#### Map Unit Setting

*National map unit symbol:* 369v

*Elevation:* 4,600 to 5,800 feet

*Mean annual precipitation:* 14 to 16 inches

*Mean annual air temperature:* 46 to 48 degrees F

*Frost-free period:* 125 to 145 days

*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Blakeland and similar soils:* 98 percent

*Minor components:* 2 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Blakeland

##### Setting

*Landform:* Hills, flats

*Landform position (three-dimensional):* Side slope, talf

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Parent material:* Alluvium derived from sedimentary rock and/or eolian deposits derived from sedimentary rock

##### Typical profile

*A - 0 to 11 inches:* loamy sand

*AC - 11 to 27 inches:* loamy sand

*C - 27 to 60 inches:* sand

##### Properties and qualities

*Slope:* 1 to 9 percent

*Depth to restrictive feature:* More than 80 inches

*Natural drainage class:* Somewhat excessively drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* High to very high (5.95 to 19.98 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Calcium carbonate, maximum in profile:* 5 percent

*Available water storage in profile:* Low (about 4.5 inches)

##### Interpretive groups

*Land capability classification (irrigated):* 3e

*Land capability classification (nonirrigated):* 6e

*Hydrologic Soil Group:* A

*Ecological site:* Sandy Foothill (R049BY210CO)

*Hydric soil rating:* No

### **Minor Components**

#### **Other soils**

*Percent of map unit:* 1 percent

*Hydric soil rating:* No

#### **Pleasant**

*Percent of map unit:* 1 percent

*Landform:* Depressions

*Hydric soil rating:* Yes

## **Data Source Information**

Soil Survey Area: El Paso County Area, Colorado

Survey Area Data: Version 17, Sep 13, 2019

## El Paso County Area, Colorado

### 10—Blendon sandy loam, 0 to 3 percent slopes

#### Map Unit Setting

*National map unit symbol:* 3671

*Elevation:* 6,000 to 6,800 feet

*Mean annual precipitation:* 14 to 16 inches

*Mean annual air temperature:* 46 to 48 degrees F

*Frost-free period:* 125 to 145 days

*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Blendon and similar soils:* 98 percent

*Minor components:* 2 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Blendon

##### Setting

*Landform:* Terraces, alluvial fans

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Parent material:* Sandy alluvium derived from arkose

##### Typical profile

*A - 0 to 10 inches:* sandy loam

*Bw - 10 to 36 inches:* sandy loam

*C - 36 to 60 inches:* gravelly sandy loam

##### Properties and qualities

*Slope:* 0 to 3 percent

*Depth to restrictive feature:* More than 80 inches

*Natural drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):*

Moderately high to high (0.60 to 2.00 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Calcium carbonate, maximum in profile:* 2 percent

*Available water storage in profile:* Moderate (about 6.2 inches)

##### Interpretive groups

*Land capability classification (irrigated):* None specified

*Land capability classification (nonirrigated):* 3e

*Hydrologic Soil Group:* B

*Ecological site:* Sandy Foothill (R049BY210CO)

*Hydric soil rating:* No

### **Minor Components**

#### **Other soils**

*Percent of map unit:* 1 percent

*Hydric soil rating:* No

#### **Pleasant**

*Percent of map unit:* 1 percent

*Landform:* Depressions

*Hydric soil rating:* Yes

## **Data Source Information**

Soil Survey Area: El Paso County Area, Colorado

Survey Area Data: Version 17, Sep 13, 2019

**FEMA FIRM MAP**

**NOTES TO USERS**

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **Floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

**Coastal Base Flood Elevations** shown on this map apply only to landward of 0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

**Boundaries of the floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection used** in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The horizontal datum was NAD83, GRS80 spheroid. Differences in datum, projection, or UTM zone codes used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. Those differences do not affect the accuracy of the FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov> or contact the National Geodetic Survey at the following address:

NGS Information Services  
NOAA, NGS112  
National Geodetic Survey  
SSM-C-3, #5020  
1315 East-West Highway  
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov>.

**Base Map** information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

**Corporate limits** shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.


Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-368-9620 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/>.

**El Paso County Vertical Datum Offset Table**


Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM-BY-STREAM VERTICAL DATUM CONVERSION INFORMATION	

**Panel Location Map**

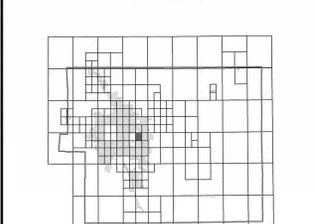

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).

Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

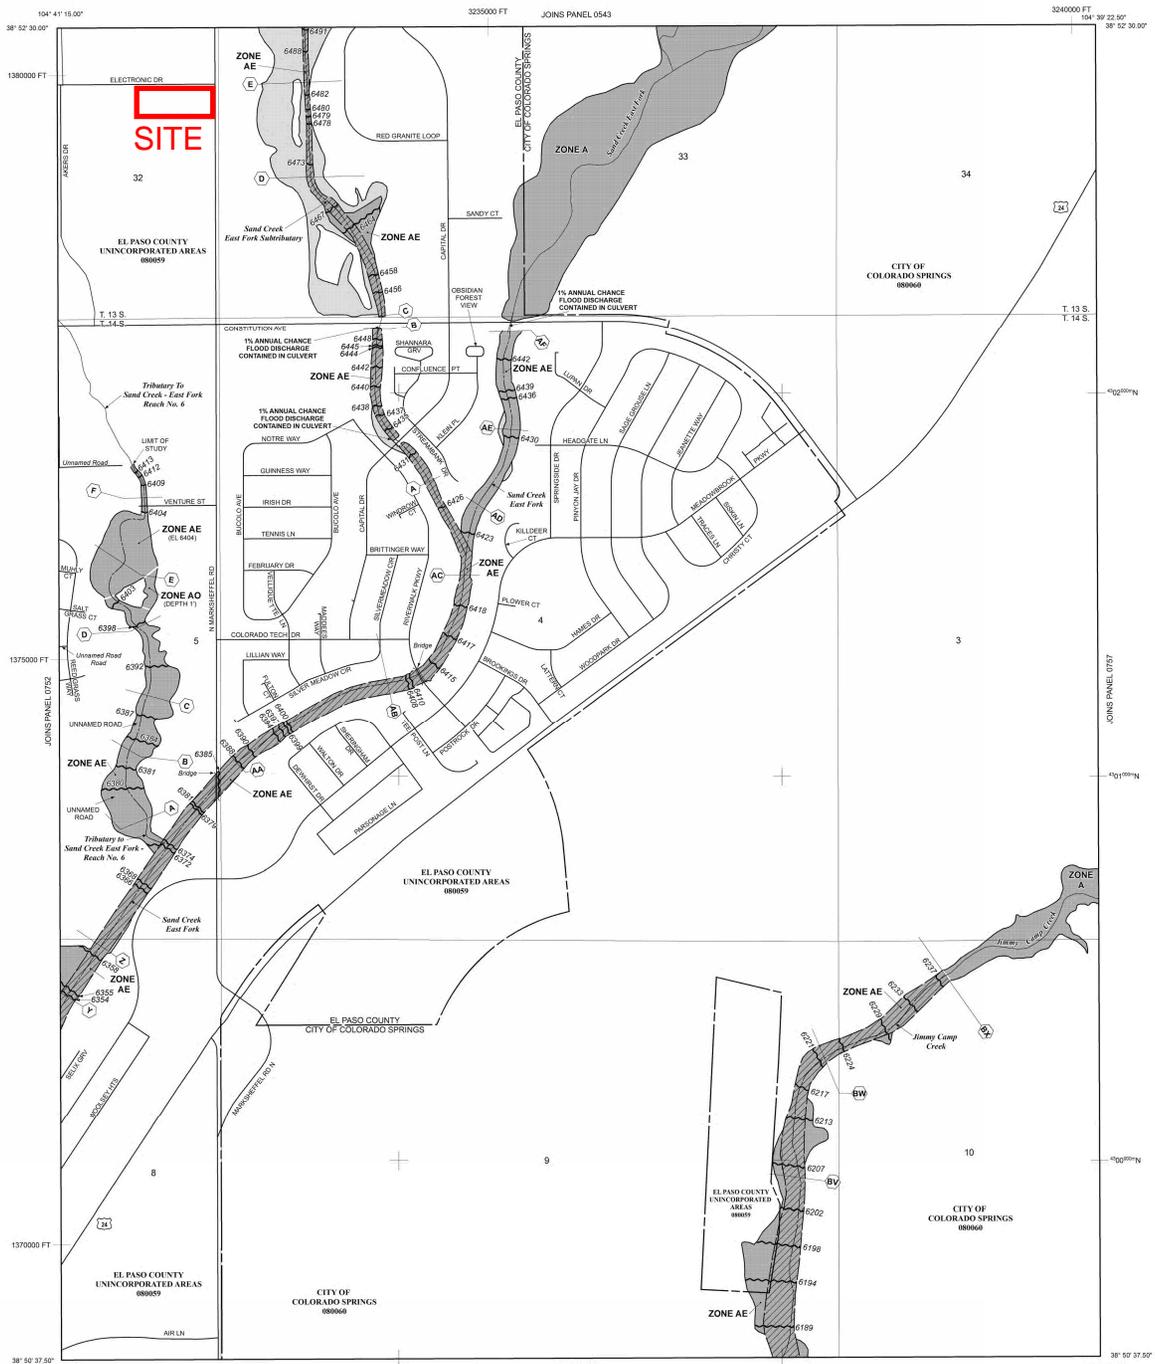

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN TOWNSHIP 13 SOUTH, RANGE 65 WEST, AND TOWNSHIP 14 SOUTH, RANGE 65 WEST.

**LEGEND**

- SPECIAL FLOOD HAZARD AREAS (SFHAs) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD
- ZONE A**  
No Base Flood Elevations determined.  
Base Flood Elevations determined.
- ZONE AE**  
Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO**  
Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR**  
Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently identified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE AV9**  
Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V**  
Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE**  
Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- FLOODWAY AREAS IN ZONE AE
- OTHER FLOOD AREAS
- ZONE X**  
Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of 1 foot or less in open water. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zone A, AE, AO, AR, AV, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.
- ZONE XE**  
Areas determined to be outside the 0.2% annual chance floodplain.
- ZONE D**  
Areas in which flood hazards are undetermined, but possible.
- COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS
- OTHERWISE PROTECTED AREAS (OPAs)
- CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.
- Floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.
- Base Flood Elevation line and value elevation in feet<sup>1</sup>
- Base Flood Elevation value where uniform within zone; elevation in feet<sup>1</sup>
- Referenced to the North American Vertical Datum of 1988 (NAVD 88)
- Cross section line
- Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
- 1000-meter Universal Transverse Mercator grid ticks, zone 13
- 5000-foot grid ticks; Colorado State Plane coordinate system, Lambert Conformal Conic Projection
- Bench mark (see explanation in Notes to Users section of this FIRM panel)
- M1.5 River Mile
- MAP REPOSITORIES  
Refer to Map Repositories list on Map Index
- EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP MARCH 17, 1997
- EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL 2011  
In update corporate limits, change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.
- For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.
- To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

**PANEL 0756G**

**FIRM**  
FLOOD INSURANCE RATE MAP  
EL PASO COUNTY,  
COLORADO  
AND INCORPORATED AREAS

PANEL 756 OF 1300  
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

COUNTY	COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO	SPRINGFIELD CITY OF	8000	076	G
EL PASO COUNTY		8000	076	G

Notice to User: The Map Number shown below should be used when placing map orders with the Community Number shown above should be used on insurance applications for the subject community.

**MAP NUMBER**  
08041C0756G

**MAP REVISED**  
DECEMBER 7, 2018

Federal Emergency Management Agency



## **HYDROLOGIC CALCULATIONS**

**ELECTRONIC STORAGE**  
**(Area Runoff Coefficient Summary)**

**EXISTING CONDITIONS**

BASIN	TOTAL AREA (Acres)	STREETS / DEVELOPED			OVERLAND / UNDEVELOPED			WEIGHTED	
		AREA (Acres)	C <sub>5</sub>	C <sub>100</sub>	AREA (Acres)	C <sub>5</sub>	C <sub>100</sub>	C <sub>5</sub>	C <sub>100</sub>
OS-Z	4.01	4.01	0.45	0.59	0.00	0.09	0.36	0.45	0.59
OS-Y	2.55	2.55	0.20	0.44	0.00	0.09	0.36	0.20	0.44
EX-A	2.54	2.54	0.30	0.50	0.00	0.09	0.36	0.30	0.50
EX-B	1.91	1.91	0.12	0.39	0.00	0.09	0.36	0.12	0.39

Note: Basin C values are based on measured impervious values.  
Percent impervious values are: 64%, 20%, 37%, and 7%.

Calculated by: DLF  
Date: 8/5/2020  
Checked by: LD

**DEVELOPED CONDITIONS**

BASIN	TOTAL AREA (Acres)	STREETS / DEVELOPED			OVERLAND / UNDEVELOPED			WEIGHTED	
		AREA (Acres)	C <sub>5</sub>	C <sub>100</sub>	AREA (Acres)	C <sub>5</sub>	C <sub>100</sub>	C <sub>5</sub>	C <sub>100</sub>
OS-E	0.44	0.44	0.20	0.44	0.00	0.09	0.36	0.20	0.44
OS-F	1.38	1.38	0.20	0.44	0.00	0.09	0.36	0.20	0.44
OS-G	0.01	0.01	0.90	0.96	0.00	0.09	0.36	0.90	0.96
PR-1	0.37	0.00	0.90	0.96	0.37	0.09	0.36	0.09	0.36
PR-2	0.62	0.62	0.90	0.96	0.00	0.09	0.36	0.90	0.96
PR-3	0.45	0.45	0.90	0.96	0.00	0.09	0.36	0.90	0.96
PR-4	0.32	0.32	0.09	0.36	0.00	0.09	0.36	0.09	0.36
PR-5	0.34	0.34	0.09	0.36	0.00	0.09	0.36	0.09	0.36
PR-6	0.03	0.03	0.09	0.36	0.00	0.09	0.36	0.09	0.36
PR-7	0.13	0.13	0.20	0.44	0.00	0.09	0.36	0.20	0.44

Calculated by: DLF  
Date: 1/10/2020  
Checked by: LD

## ELECTRONIC STORAGE AREA DRAINAGE SUMMARY

### EXISTING CONDITIONS

BASIN	AREA TOTAL (Acres)	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				$T_t$	INTENSITY		TOTAL FLOWS	
		$C_5$	$C_{100}$	$C_5$	Length (ft)	Height (ft)	$T_C$ (min)	Length (ft)	Slope (%)	Velocity (fps)	$T_t$ (min)	TOTAL (min)	$I_5$ (in/hr)	$I_{100}$ (in/hr)	$Q_5$ (c.f.s.)	$Q_{100}$ (c.f.s.)
OS-Z	4.01	0.45	0.59	0.45	300	20.0	6.2	900	6.0%	3.7	4.1	10.3	4.0	7.0	7.3	16.5
OS-Y	2.55	0.20	0.44	0.20	300	16.6	9.1	0	6.0%	4.9	0.0	9.1	4.2	7.3	2.1	8.2
EX-A	2.54	0.30	0.50	0.30	300	13.2	8.8	0	4.0%	1.0	0.0	8.8	4.3	7.5	3.2	9.5
EX-B	1.91	0.12	0.39	0.12	300	18.2	9.6	0	6.0%	4.9	0.0	9.6	4.1	7.2	0.9	5.4

### DEVELOPED CONDITIONS

BASIN	AREA TOTAL (Acres)	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				$T_t$	INTENSITY		TOTAL FLOWS	
		$C_5$	$C_{100}$	$C_5$	Length (ft)	Height (ft)	$T_C$ (min)	Length (ft)	Slope (%)	Velocity (fps)	$T_t$ (min)	TOTAL (min)	$I_5$ (in/hr)	$I_{100}$ (in/hr)	$Q_5$ (c.f.s.)	$Q_{100}$ (c.f.s.)
OS-E	0.44	0.20	0.44	0.20	100	7.0	5.4	0	5.0%	1.1	0.0	5.4	4.9	8.8	0.4	1.7
OS-F	1.38	0.20	0.44	0.20	300	21.0	8.4	0	5.0%	1.1	0.0	8.4	4.3	7.6	1.2	4.6
OS-G	0.01	0.90	0.96	0.90	20	2.0	0.6	0	5.0%	4.5	0.0	0.6	6.7	13.0	0.1	0.1
PR-1	0.37	0.09	0.36	0.09	100	6.0	6.4	0	5.0%	4.5	0.0	6.4	4.7	8.4	0.2	1.1
PR-2	0.62	0.90	0.96	0.90	100	5.0	1.4	300	6.0%	4.9	1.0	2.4	5.8	10.9	3.2	6.5
PR-3	0.45	0.90	0.96	0.90	100	0.5	2.9	0	5.0%	4.5	0.0	2.9	5.6	10.4	2.3	4.5
PR-4	0.32	0.09	0.36	0.09	40	10.0	2.8	0	5.0%	1.1	0.0	2.8	5.7	10.5	0.2	1.2
PR-5	0.34	0.09	0.36	0.09	100	5.0	6.8	0	5.0%	1.1	0.0	6.8	4.6	8.2	0.1	1.0
PR-6	0.03	0.09	0.36	0.09	20	2.7	2.6	0	5.0%	1.1	0.0	2.6	5.7	10.7	0.0	0.1
PR-7	0.13	0.20	0.44	0.20	20	1.2	3.0	0	5.0%	1.1	0.0	3.0	5.6	10.4	0.1	0.6

Calculated by: DLF

Date: 8/5/2020

Checked by: LD

***ELECTRONIC STORAGE  
PROPOSED SURFACE ROUTING SUMMARY***

<i>Design Point(s)</i>	<i>Contributing Basins</i>	<i>Area Ac</i>	<i>Flow</i>	
			<i>Q<sub>5</sub></i>	<i>Q<sub>100</sub></i>
<b>Z</b>	<b>OS-Z</b>	4.01	<b>7.3</b>	<b>16.5</b>
<b>Y</b>	<b>OS-Y</b>	2.55	<b>2.1</b>	<b>8.2</b>
<b>A</b>	<b>EX-A</b>	2.54	<b>3.2</b>	<b>9.5</b>
<b>B</b>	<b>EX-B, OS-Y</b>	4.46	<b>3.1</b>	<b>13.6</b>
<b>E</b>	<b>OS-E</b>	0.44	<b>0.4</b>	<b>1.7</b>
<b>F</b>	<b>OS-F</b>	1.38	<b>1.2</b>	<b>4.6</b>
<b>G</b>	<b>OS-G</b>	0.01	<b>0.1</b>	<b>0.1</b>
<b>1</b>	<b>OS-A, PR-1</b>	0.81	<b>0.6</b>	<b>2.8</b>
<b>2</b>	<b>OS-A, OS-C, PR-1, PR-2</b>	1.44	<b>3.9</b>	<b>9.4</b>
<b>3</b>	<b>PR-3</b>	0.45	<b>2.3</b>	<b>4.5</b>
<b>4</b>	<b>OS-A, OS-C, PR-1, PR-2, PR-3, PR-4</b>	2.21	<b>6.3</b>	<b>15.1</b>
<b>5</b>	<b>OS-B, PR-5</b>	1.72	<b>1.3</b>	<b>5.6</b>
<b>6</b>	<b>PR-6</b>	0.03	<b>0.0</b>	<b>0.1</b>
<b>7</b>	<b>PR-7</b>	0.13	<b>0.1</b>	<b>0.6</b>


Calculated by: DLF  
Date: 8/5/2020  
Checked by: LD

## **HYDRAULIC CALCULATIONS**

## CIRCULAR CONDUIT FLOW (Normal & Critical Depth Computation)

Project: **Electronic Storage**

Pipe ID: **Entrance Culvert**

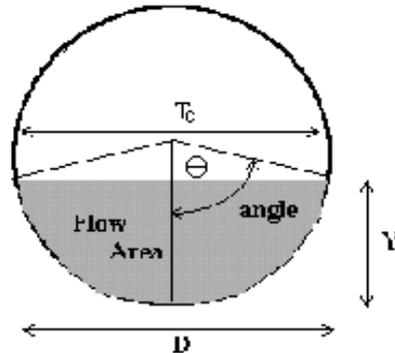

### Design Information (Input)

Pipe Invert Slope	So =	0.0200	ft/ft
Pipe Manning's n-value	n =	0.0130	
Pipe Diameter	D =	24.00	inches
<b>Design discharge</b>	<b>Q =</b>	<b>5.00</b>	<b>cfs</b>

### Full-flow Capacity (Calculated)

Full-flow area	Af =	3.14	sq ft
Full-flow wetted perimeter	Pf =	6.28	ft
Half Central Angle	Theta =	3.14	radians
Full-flow capacity	Qf =	32.08	cfs

### Calculation of Normal Flow Condition


Half Central Angle ( $0 < \theta < 3.14$ )	Theta =	1.09	radians
Flow area	An =	0.67	sq ft
Top width	Tn =	1.77	ft
Wetted perimeter	Pn =	2.17	ft
Flow depth	Yn =	0.53	ft
Flow velocity	Vn =	7.42	fps
Discharge	Qn =	5.00	cfs
Percent Full Flow	Flow =	15.6%	of full flow
Normal Depth Froude Number	Fr <sub>n</sub> =	2.12	supercritical

### Calculation of Critical Flow Condition

Half Central Angle ( $0 < \theta_c < 3.14$ )	Theta-c =	1.36	radians
Critical flow area	Ac =	1.15	sq ft
Critical top width	Tc =	1.95	ft
Critical flow depth	Yc =	0.79	ft
Critical flow velocity	Vc =	4.35	fps
Critical Depth Froude Number	Fr <sub>c</sub> =	1.00	

## CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: **Electronic Storage**  
 Basin ID: **Entrance Culvert**  
 Status: \_\_\_\_\_

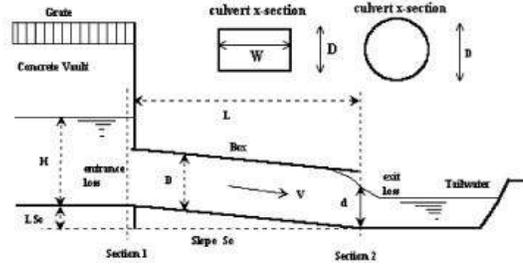

**Design Information (Input):**

**Circular Culvert:** Barrel Diameter in Inches D =  inches  
 Inlet Edge Type (choose from pull-down list) Grooved End with Headwall

**OR:**

**Box Culvert:** Barrel Height (Rise) in Feet Height (Rise) =   
 Barrel Width (Span) in Feet Width (Span) =   
 Inlet Edge Type (choose from pull-down list) Square Edge w/ 30-78 deg. Flared Wingwall

Number of Barrels No =   
 Inlet Elevation at Culvert Invert Inlet Elev =  ft. elev.  
 Outlet Elevation at Culvert Invert **OR** Slope of Culvert (ft v./ft h.) Outlet Elev =  ft. elev.  
 Culvert Length in Feet L =  ft.  
 Manning's Roughness n =   
 Bend Loss Coefficient K<sub>b</sub> =   
 Exit Loss Coefficient K<sub>x</sub> =

**Design Information (calculated):**

Entrance Loss Coefficient K<sub>e</sub> =   
 Friction Loss Coefficient K<sub>f</sub> =   
 Sum of All Loss Coefficients K<sub>s</sub> =   
 Orifice Inlet Condition Coefficient C<sub>d</sub> =   
 Minimum Energy Condition Coefficient KE<sub>low</sub> =


**Calculations of Culvert Capacity (output):**

Water Surface Elevation (ft., linked)	Tailwater Surface Elevation ft	Culvert Inlet-Control Flowrate cfs	Culvert Outlet-Control Flowrate cfs	Controlling Culvert Flowrate cfs (output)	Inlet Equation Used:	Flow Control Used
6497.50		0.00	0.00	<b>0.00</b>	No Flow (WS < inlet)	N/A
6497.75		0.30	9.55	<b>0.30</b>	Min. Energy. Eqn.	INLET
6498.00		1.30	10.21	<b>1.30</b>	Min. Energy. Eqn.	INLET
6498.25		2.70	11.45	<b>2.70</b>	Min. Energy. Eqn.	INLET
6498.50		4.60	13.23	<b>4.60</b>	Min. Energy. Eqn.	INLET
6498.75		6.50	14.80	<b>6.50</b>	Regression Eqn.	INLET
6499.00		8.90	16.20	<b>8.90</b>	Regression Eqn.	INLET
6499.25		11.60	17.50	<b>11.60</b>	Regression Eqn.	INLET
6499.50		14.30	18.72	<b>14.30</b>	Regression Eqn.	INLET
6499.75		16.80	20.92	<b>16.80</b>	Regression Eqn.	INLET
6500.00		19.10	22.91	<b>19.10</b>	Regression Eqn.	INLET
6500.25		21.10	24.75	<b>21.10</b>	Regression Eqn.	INLET
6500.50		23.00	26.46	<b>23.00</b>	Regression Eqn.	INLET
6500.75		24.80	28.06	<b>24.80</b>	Regression Eqn.	INLET
6501.00		26.40	29.58	<b>26.40</b>	Regression Eqn.	INLET
6501.25		27.90	31.02	<b>27.90</b>	Regression Eqn.	INLET
6501.50		29.40	32.39	<b>29.40</b>	Regression Eqn.	INLET
6501.75		30.80	33.72	<b>30.80</b>	Regression Eqn.	INLET
6502.00		32.10	35.00	<b>32.10</b>	Regression Eqn.	INLET
6502.25		33.50	36.22	<b>33.50</b>	Regression Eqn.	INLET
6502.50		34.70	37.42	<b>34.70</b>	Regression Eqn.	INLET
6502.75		36.00	38.57	<b>36.00</b>	Regression Eqn.	INLET
6503.00		37.20	39.69	<b>37.20</b>	Regression Eqn.	INLET
6503.25		38.40	40.76	<b>38.40</b>	Regression Eqn.	INLET
6503.50		39.50	41.83	<b>39.50</b>	Regression Eqn.	INLET
6503.75		40.50	42.85	<b>40.50</b>	Orifice Eqn.	INLET
6504.00		41.50	43.86	<b>41.50</b>	Orifice Eqn.	INLET
6504.25		42.40	44.85	<b>42.40</b>	Orifice Eqn.	INLET
6504.50		43.30	45.81	<b>43.30</b>	Orifice Eqn.	INLET
6504.75		44.20	46.76	<b>44.20</b>	Orifice Eqn.	INLET

Processing Time: 00.89 Seconds

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)


Project: Electronic Storage  
Basin ID: Entrance Culvert

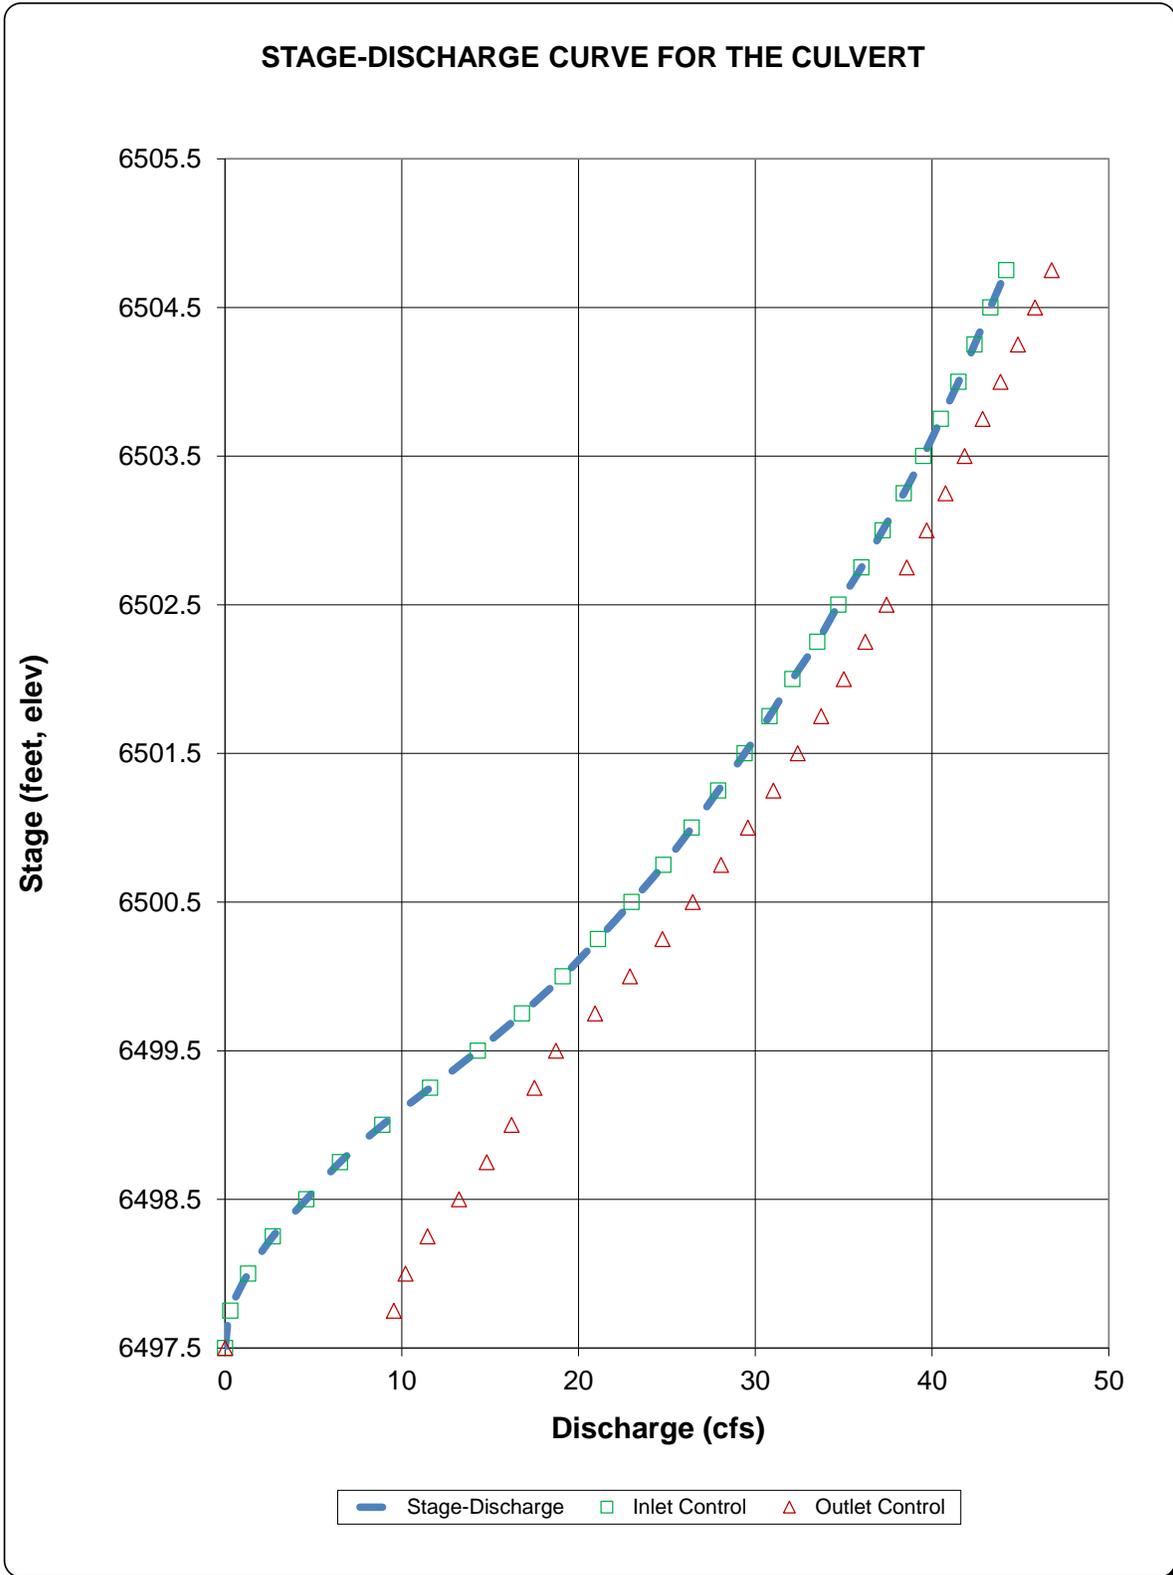

## Determination of Culvert Headwater and Outlet Protection

Project: **Electronic Storage**

Basin ID: **Entrance Culvert**

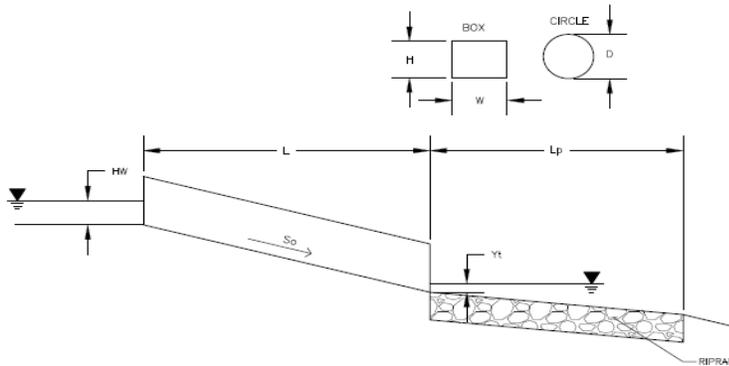

**Soil Type:**  
 Choose One:  
 Sandy  
 Non-Sandy

**Supercritical Flow! Using Da to calculate protection type.**

**Design Information (Input):**

Design Discharge  $Q = 5$  cfs

**Circular Culvert:**  
 Barrel Diameter in Inches  $D = 24$  inches  
 Inlet Edge Type (Choose from pull-down list) Square End with Headwall

**Box Culvert:**  
 Barrel Height (Rise) in Feet  $\text{Height (Rise)} =$  ft  
 Barrel Width (Span) in Feet  $\text{Width (Span)} =$  ft  
 Inlet Edge Type (Choose from pull-down list) OR

Number of Barrels  $\text{No} = 1$   
 Inlet Elevation  $\text{Elev IN} = 6497.5$  ft  
 Outlet Elevation **OR** Slope  $\text{Elev OUT} = 6496.5$  ft  
 Culvert Length  $L = 50$  ft  
 Manning's Roughness  $n = 0.013$   
 Bend Loss Coefficient  $k_b = 0$   
 Exit Loss Coefficient  $k_x = 1$   
 Tailwater Surface Elevation  $\text{Elev } Y_t =$  ft  
 Max Allowable Channel Velocity  $V = 5$  ft/s

**Required Protection (Output):**

Tailwater Surface Height  $Y_t = 0.80$  ft  
 Flow Area at Max Channel Velocity  $A_t = 1.00$  ft<sup>2</sup>  
 Culvert Cross Sectional Area Available  $A = 3.14$  ft<sup>2</sup>  
 Entrance Loss Coefficient  $k_e = 0.50$   
 Friction Loss Coefficient  $k_f = 0.62$   
 Sum of All Losses Coefficients  $k_s = 2.12$  ft  
 Culvert Normal Depth  $Y_n = 0.53$  ft  
 Culvert Critical Depth  $Y_c = 0.79$  ft

Tailwater Depth for Design  $d = 1.39$  ft  
 Adjusted Diameter **OR** Adjusted Rise  $D_a = 1.27$  ft  
 Expansion Factor  $1/(2*\tan(\Theta)) = 6.70$   
 Flow/Diameter<sup>2.5</sup> **OR** Flow/(Span \* Rise<sup>1.5</sup>)  $Q/D^{2.5} = 0.88$  ft<sup>0.5</sup>/s  
 Froude Number  $Fr = 2.12$  Supercritical!  
 Tailwater/Adjusted Diameter **OR** Tailwater/Adjusted Rise  $Y_t/D = 0.63$


Inlet Control Headwater  $HW_i = 1.09$  ft  
 Outlet Control Headwater  $HW_o = 0.48$  ft  
**Design Headwater Elevation**  $HW = 6,498.59$  ft  
**Headwater/Diameter **OR** Headwater/Rise Ratio**  $HW/D = 0.55$

Minimum Theoretical Riprap Size  $d_{50} = 2$  in  
 Nominal Riprap Size  $d_{50} = 6$  in  
**UDFCD Riprap Type**  $\text{Type} = VL$   
**Length of Protection**  $L_p = 6$  ft  
**Width of Protection**  $T = 3$  ft

## Vertical Profile for the Culvert

Project = **Electronic Storage**

Box ID = **Entrance Culvert**

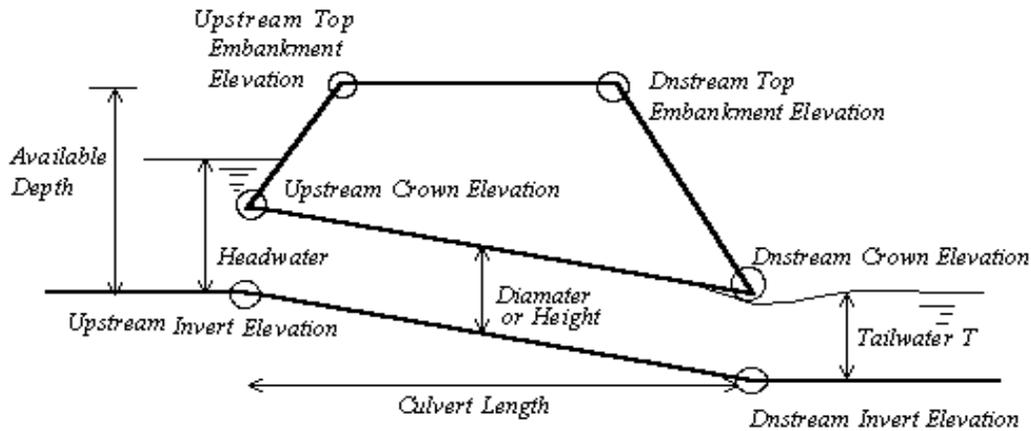

<b>Culvert Information (Input)</b>	
Barrel Diameter or Height	D or H = <input style="width: 100px;" type="text" value="24.00"/> inches
Barrel Length	L = <input style="width: 100px;" type="text" value="50.00"/> ft
Barrel Invert Slope	So = <input style="width: 100px;" type="text" value="0.0200"/> ft/ft
Downstream Invert Elevation	EDI = <input style="width: 100px;" type="text" value="6496.50"/> ft
Downstream Top Embankment Elevation	EDT = <input style="width: 100px;" type="text" value="6499.50"/> ft
Upstream Top Embankment Elevation	EUT = <input style="width: 100px;" type="text" value="6501.00"/> ft
Design Headwater Depth (not elev.)	Hw = <input style="width: 100px;" type="text" value="1.09"/> ft
Tailwater Depth (not elev.)	Yt = <input style="width: 100px;" type="text" value="1.39"/> ft
<b>Culvert Hydraulics (Calculated)</b>	
Available Headwater Depth	HW-a = <input style="width: 100px;" type="text" value="3.50"/> ft
Design Hw/D ratio	Hw/D = <input style="width: 100px;" type="text" value="0.55"/>
<b>Culvert Vertical Profile</b>	
Upstream Invert Elevation	EUI = <input style="width: 100px;" type="text" value="6497.50"/> ft
Upstream Crown Elevation	EUC = <input style="width: 100px;" type="text" value="6499.50"/> ft
Upstream Soil Cover Depth	Upsoil = <input style="width: 100px;" type="text" value="1.50"/> ft
Downstream Invert Elevation	EDI = <input style="width: 100px;" type="text" value="6496.50"/> ft
Downstream Crown Elevation	EDC = <input style="width: 100px;" type="text" value="6498.50"/> ft
Downstream Soil Cover Depth	Dnsoil = <input style="width: 100px;" type="text" value="1.00"/> ft


**MANNING'S EQUATION FOR PIPE FLOW**

Project: Electronic Storage Location: Roof Drains Storm Pipe (Need Q=4.5 cfs)  
 By: Dane Frank Date: 1/13/2020  
 Chk. By: Date: mdo version 12.8.00

Clear Data  
Entry Cells

INPUT

D= 12 inches  
 d= 12 inches  
 n= 0.012 mannings coeff  
 θ= 0.0 degrees  
 S= 0.1 slope in/in

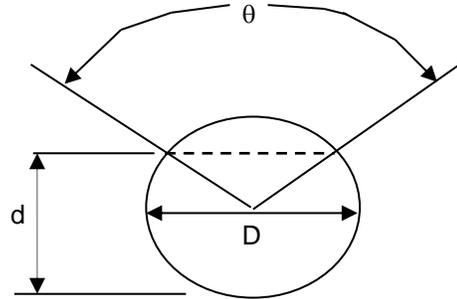

Mannings Formula

$$Q = (1.486/n) A R_h^{2/3} S^{1/2}$$

R=A/P  
 A=cross sectional area  
 P=wetted perimeter  
 S=slope of channel  
 n=Manning's roughness coefficient

$$V = (1.49/n) R_h^{2/3} S^{1/2}$$

$$Q = V \times A$$


Solution to Mannings Equation					Manning's n-values	
Area,ft <sup>2</sup>	Wetted Perimeter, ft	Hydraulic Radius, ft	velocity ft/s	flow, cfs		
0.79	3.14	0.25	15.54	12.20	PVC	0.01
					PE (<9"dia)	0.015
					PE (>12"dia)	0.02
					PE(9-12"dia)	0.017
					CMP	0.025
					ADS N12	0.012
					HCMP	0.023
					Conc	0.013

Created by: Mike O'Shea

**MANNING'S EQUATION FOR PIPE FLOW**

Project: Electronic Storage Location: SW Pond Inlet ST Pipe (Need Q=9.2 cfs)  
 By: Dane Frank Date: 8/28/2020  
 Chk. By: Date: mdo version 12.8.00

Clear Data  
Entry Cells

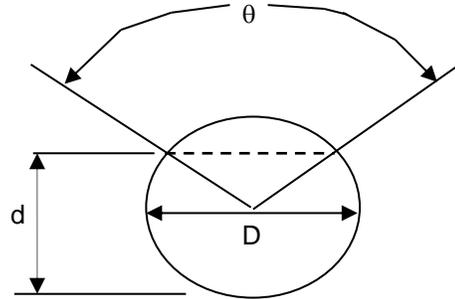

INPUT

D= 15 inches  
 d= 15 inches  
 n= 0.012 mannings coeff  
 theta= 0.0 degrees  
 S= 0.049 slope in/in

Mannings Formula

$$Q = (1.486/n) A R_h^{2/3} S^{1/2}$$

R=A/P  
 A=cross sectional area  
 P=wetted perimeter  
 S=slope of channel  
 n=Manning's roughness coefficient

$$V = (1.49/n) R_h^{2/3} S^{1/2}$$

$$Q = V \times A$$


			Solution to Mannings Equation		Manning's n-values	
Area,ft <sup>2</sup>	Wetted Perimeter, ft	Hydraulic Radius, ft	velocity ft/s	flow, cfs		
1.23	3.93	0.31	12.62	15.49	PVC	0.01
					PE (<9"dia)	0.015
					PE (>12"dia)	0.02
					PE(9-12"dia)	0.017
					CMP	0.025
					ADS N12	0.012
					HCMP	0.023
					Conc	0.013

Created by: Mike O'Shea

**MANNING'S EQUATION FOR PIPE FLOW**

Project: Electronic Storage Location: NE Pond Inlet ST Pipe (Need Q=4.7 cfs)  
 By: Dane Frank Date: 1/13/2020  
 Chk. By: Date: mdo version 12.8.00

Clear Data  
Entry Cells

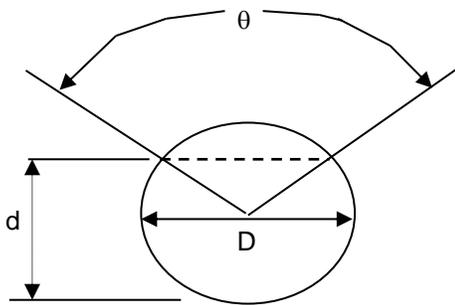

INPUT

D= 12 inches  
 d= 12 inches  
 n= 0.012 manning's coeff  
 theta= 0.0 degrees  
 S= 0.049 slope in/in

Mannings Formula

$$Q = (1.486/n) A R_h^{2/3} S^{1/2}$$

R=A/P  
 A=cross sectional area  
 P=wetted perimeter  
 S=slope of channel  
 n=Manning's roughness coefficient

$$V = (1.49/n) R_h^{2/3} S^{1/2}$$

$$Q = V \times A$$

			Solution to Mannings Equation		Manning's n-values	
Area,ft <sup>2</sup>	Wetted Perimeter, ft	Hydraulic Radius, ft	velocity ft/s	flow, cfs		
0.79	3.14	0.25	10.88	8.54	PVC	0.01
					PE (<9"dia)	0.015
					PE (>12"dia)	0.02
					PE(9-12"dia)	0.017
					CMP	0.025
					ADS N12	0.012
					HCMP	0.023
					Conc	0.013

Created by: Mike O'Shea

**MANNING'S EQUATION for OPEN CHANNEL FLOW**

Project: **Electronic Storage** Location: **NW of Bldg Street Capacity (Need 3 cfs)**  
 By: **Dane Frank** Date: **1/13/2020**  
 Chk By: \_\_\_\_\_ Date: \_\_\_\_\_ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

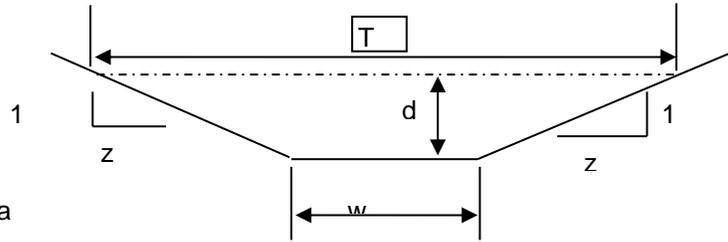

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 25  
 z (sideslope)= 50  
 b (btm width, ft)= 0  
 d (depth, ft)= 0.6  
 S (slope, ft/ft) 0.005  
 n<sub>low</sub> = 0.013  
 n<sub>high</sub> = 0.013

Clear Data  
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.6	13.50	45.02	0.30	3.62110768	48.885	3.621108	48.885	45	0.300

Sc low = 0.0037 Sc high = 0.0037

s<sub>c</sub> = critical slope ft / ft

T = top width of the stream

d<sub>m</sub> = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0026	0.0048	0.0026	0.0048

**MANNING'S EQUATION for OPEN CHANNEL FLOW**

Project: **Electronic Storage** Location: **NE of Bldg Street Capacity (Need 4.7 cfs)**  
 By: **Dane Frank** Date: **8/28/2020**  
 Chk By: \_\_\_\_\_ Date: \_\_\_\_\_ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

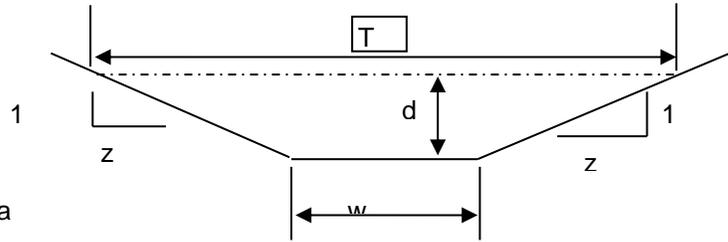

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 25  
 z (sideslope)= 25  
 b (btm width, ft)= 0  
 d (depth, ft)= 0.6  
 S (slope, ft/ft) 0.1  
 n<sub>low</sub> = 0.013  
 n<sub>high</sub> = 0.013

Clear Data  
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.6	9.00	30.02	0.30	16.1897726	145.708	16.18977	145.708	30	0.300

Sc low = 0.0037 Sc high = 0.0037

s<sub>c</sub> = critical slope ft / ft

T = top width of the stream

d<sub>m</sub> = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0026	0.0048	0.0026	0.0048

**MANNING'S EQUATION for OPEN CHANNEL FLOW**

Project: **Electronic Storage** Location: **SE of Bldg Street Capacity (Need 4.7 cfs)**  
 By: **Dane Frank** Date: **8/28/2020**  
 Chk By: \_\_\_\_\_ Date: \_\_\_\_\_ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_h^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

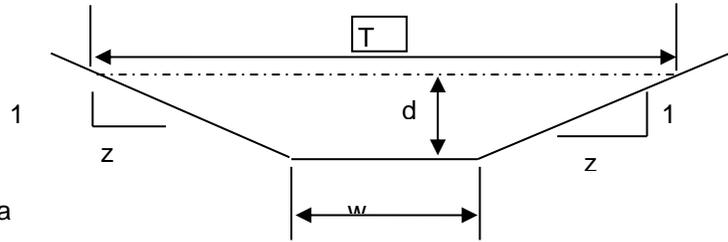

$$V = (1.49/n)R_h^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 50  
 z (sideslope)= 0  
 b (btm width, ft)= 0  
 d (depth, ft)= 0.5  
 S (slope, ft/ft) 0.01  
 n<sub>low</sub> = 0.013  
 n<sub>high</sub> = 0.013

Clear Data  
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.5	6.25	25.50	0.25	4.47601532	27.9751	4.476015	27.9751	25	0.250

Sc low = 0.0040 Sc high = 0.0040

s<sub>c</sub> = critical slope ft / ft

T = top width of the stream

d<sub>m</sub> = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0028	0.0052	0.0028	0.0052

**MANNING'S EQUATION for OPEN CHANNEL FLOW**

Project: **Electronic Storage** Location: **SW of Bldg Street Capacity (Need 4.7 cfs)**  
 By: **Dane Frank** Date: **8/28/2020**  
 Chk By: \_\_\_\_\_ Date: \_\_\_\_\_ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

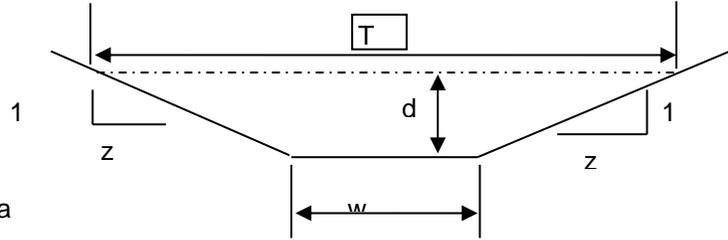

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 25  
 z (sideslope)= 0  
 b (btm width, ft)= 0  
 d (depth, ft)= 0.5  
 S (slope, ft/ft) 0.1  
 n low = 0.013  
 n high = 0.013

Clear Data  
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.5	3.13	13.01	0.24	13.967008	43.6469	13.96701	43.6469	12.5	0.250

Sc low = 0.0041 Sc high = 0.0041


s<sub>c</sub> = critical slope ft / ft

T = top width of the stream

d<sub>m</sub> = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0029	0.0054	0.0029	0.0054

Figure 8-12. Inlet Capacity Chart Sump Conditions, Curb Opening (D-10-R) Inlet

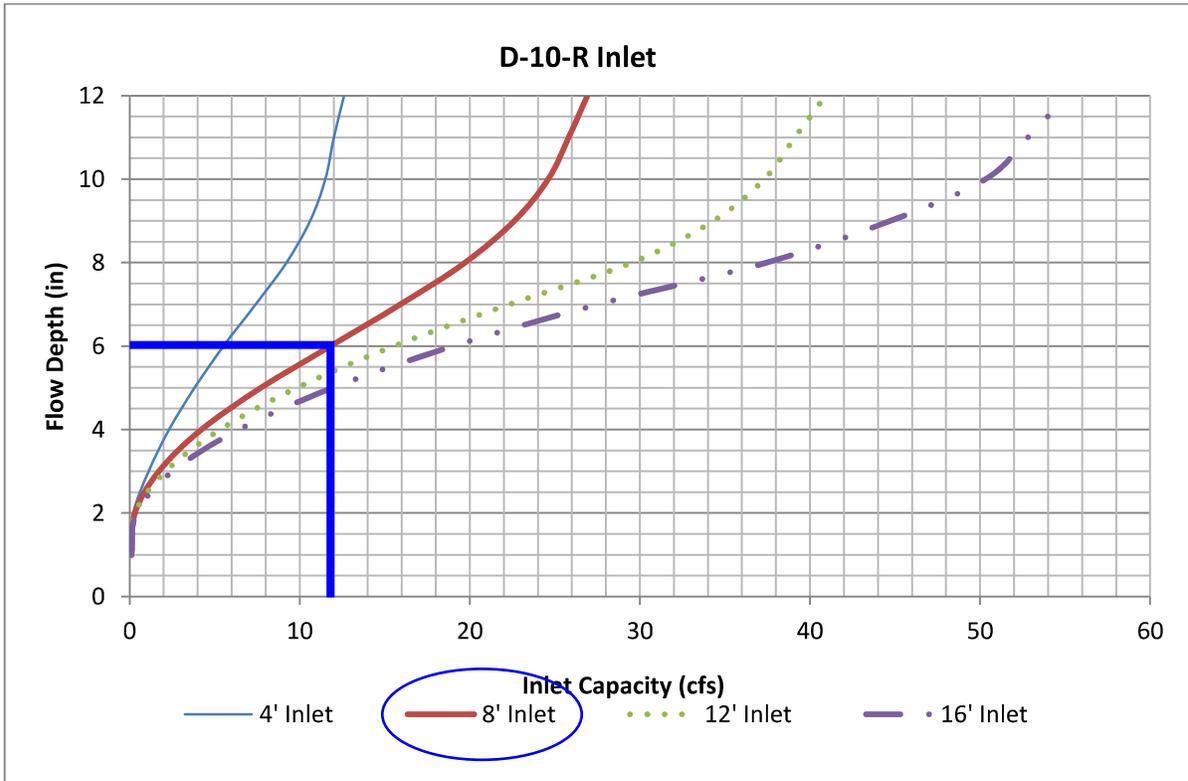


## **DETENTION CALCULATIONS**



# DETENTION BASIN STAGE-STORAGE TABLE BUILDER


*MHFD-Detention, Version 4.03 (May 2020)*

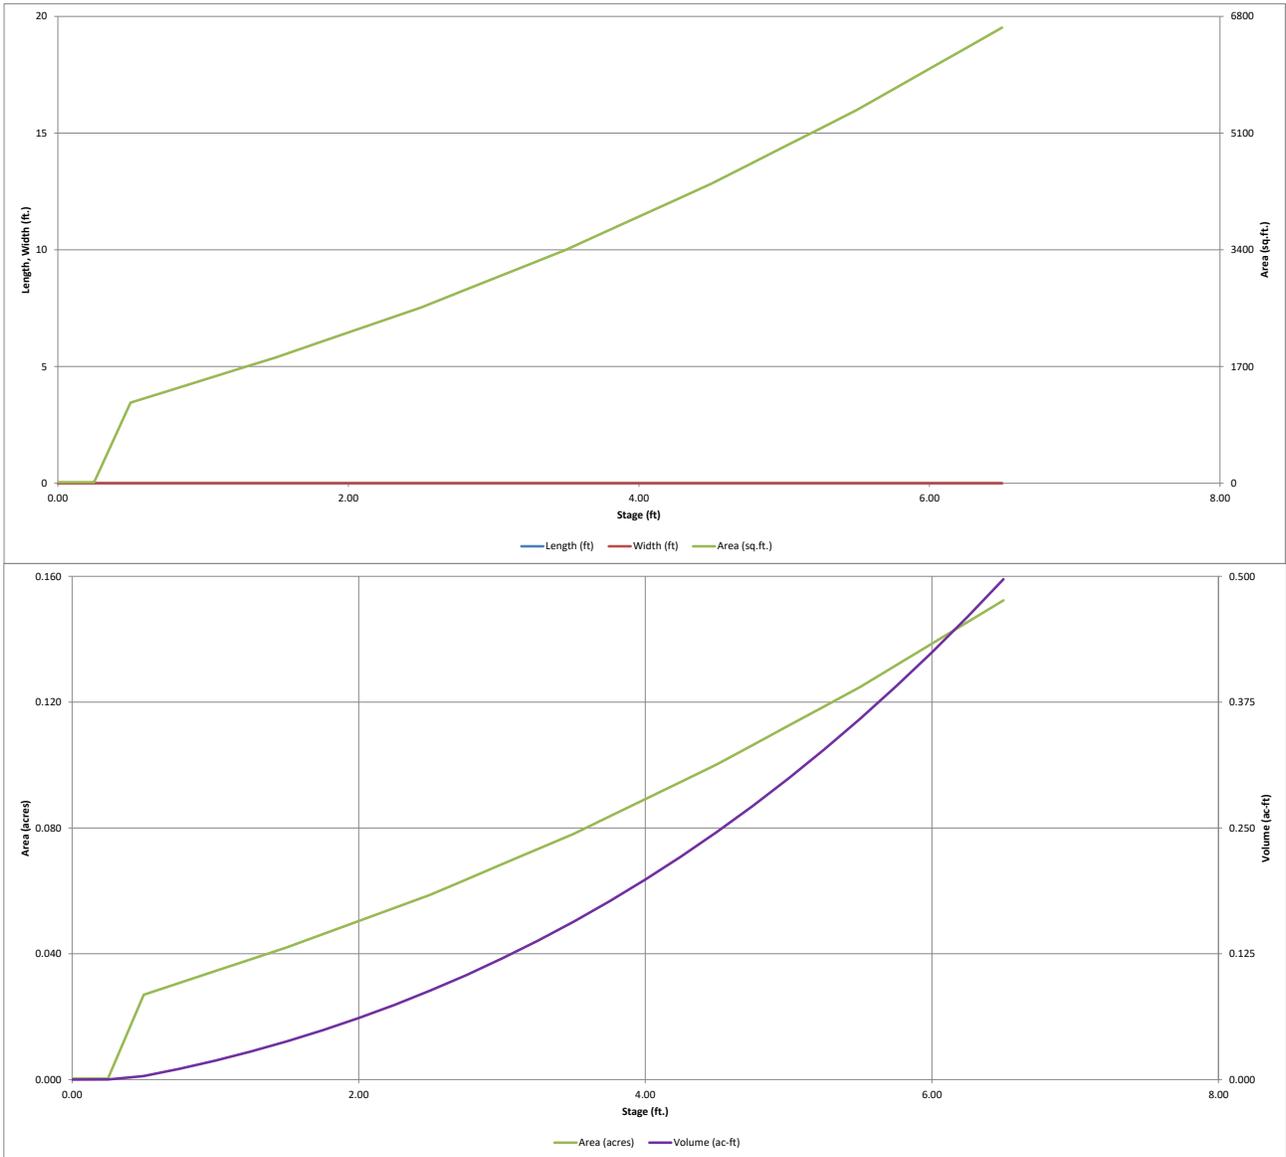

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.03 (May 2020)

**Project:** Electronic Storage  
**Basin ID:** EDB

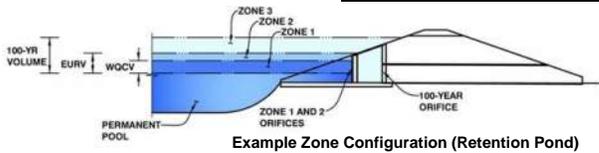

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.45	0.036	Orifice Plate
Zone 2 (EURV)	3.20	0.098	Orifice Plate
Zone 3 (100-year)	4.04	0.068	Weir&Pipe (Rect.)
<b>Total (all zones)</b>		<b>0.202</b>	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =	N/A	ft (distance below the filtration media surface)
Underdrain Orifice Diameter =	N/A	inches

Underdrain Orifice Area =	N/A	ft <sup>2</sup>
Underdrain Orifice Centroid =	N/A	feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice =	0.00	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate =	3.20	ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing =	14.60	inches
Orifice Plate: Orifice Area per Row =	0.31	sq. inches (diameter = 5/8 inch)

WQ Orifice Area per Row =	2.153E-03	ft <sup>2</sup>
Elliptical Half-Width =	N/A	feet
Elliptical Slot Centroid =	N/A	feet
Elliptical Slot Area =	N/A	ft <sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.07	2.13					
Orifice Area (sq. inches)	0.31	0.31	0.31					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

	Not Selected	Not Selected	
Vertical Orifice Area =	N/A	N/A	ft <sup>2</sup>
Vertical Orifice Centroid =	N/A	N/A	feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	3.25	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	2.00	N/A	feet
Overflow Weir Grate Slope =	0.00	N/A	H:V
Horiz. Length of Weir Sides =	2.00	N/A	feet
Overflow Grate Open Area % =	70%	N/A	%, grate open area/total area
Debris Clogging % =	50%	N/A	%

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H <sub>u</sub> =	3.25	N/A	feet
Overflow Weir Slope Length =	2.00	N/A	feet
Grate Open Area / 100-yr Orifice Area =	19.14	N/A	
Overflow Grate Open Area w/o Debris =	2.80	N/A	ft <sup>2</sup>
Overflow Grate Open Area w/ Debris =	1.40	N/A	ft <sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Rectangular	Not Selected	
Depth to Invert of Outlet Pipe =	0.50	N/A	ft (distance below basin bottom at Stage = 0 ft)
Rectangular Orifice Width =	4.90	N/A	inches
Rectangular Orifice Height =	4.30		inches

	Zone 3 Rectangular	Not Selected	
Outlet Orifice Area =	0.15	N/A	ft <sup>2</sup>
Outlet Orifice Centroid =	0.18	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	N/A	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	4.50	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	5.00	feet
Spillway End Slopes =	4.00	H:V
Freeboard above Max Water Surface =	1.00	feet

Spillway Design Flow Depth =	0.42	feet
Stage at Top of Freeboard =	5.92	feet
Basin Area at Top of Freeboard =	0.14	acres
Basin Volume at Top of Freeboard =	0.41	acre-ft




## Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
One-Hour Rainfall Depth (in) =	0.036	0.134	0.091	0.120	0.143	0.175	0.205	0.242	0.305
CUHP Runoff Volume (acre-ft) =	N/A	N/A	0.091	0.120	0.143	0.175	0.205	0.242	0.305
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	0.0	0.0	0.1	0.5	1.0	1.5	2.4
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A							
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.02	0.03	0.30	0.55	0.87	1.37
Peak Inflow Q (cfs) =	N/A	N/A	1.9	2.5	3.0	3.8	4.6	5.4	6.8
Peak Outflow Q (cfs) =	0.0	0.0	0.0	0.0	0.0	0.5	1.0	1.4	1.5
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	1.0	0.8	0.9	1.1	0.9	0.6
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Outlet Plate 1
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	0.1	0.4	0.5	0.5
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	39	73	63	70	76	75	73	72	69
Time to Drain 99% of Inflow Volume (hours) =	<b>41</b>	78	66	75	80	81	80	79	78
Maximum Ponding Depth (ft) =	1.46	3.20	2.47	2.91	3.23	3.33	3.40	3.61	4.08
Area at Maximum Ponding Depth (acres) =	0.04	0.07	0.06	0.07	0.07	0.07	0.08	0.08	0.09
Maximum Volume Stored (acre-ft) =	0.036	0.134	0.086	0.114	0.136	0.144	0.148	0.165	0.205

# DETENTION BASIN OUTLET STRUCTURE DESIGN

*MHFD-Detention, Version 4.00 (December 2019)*

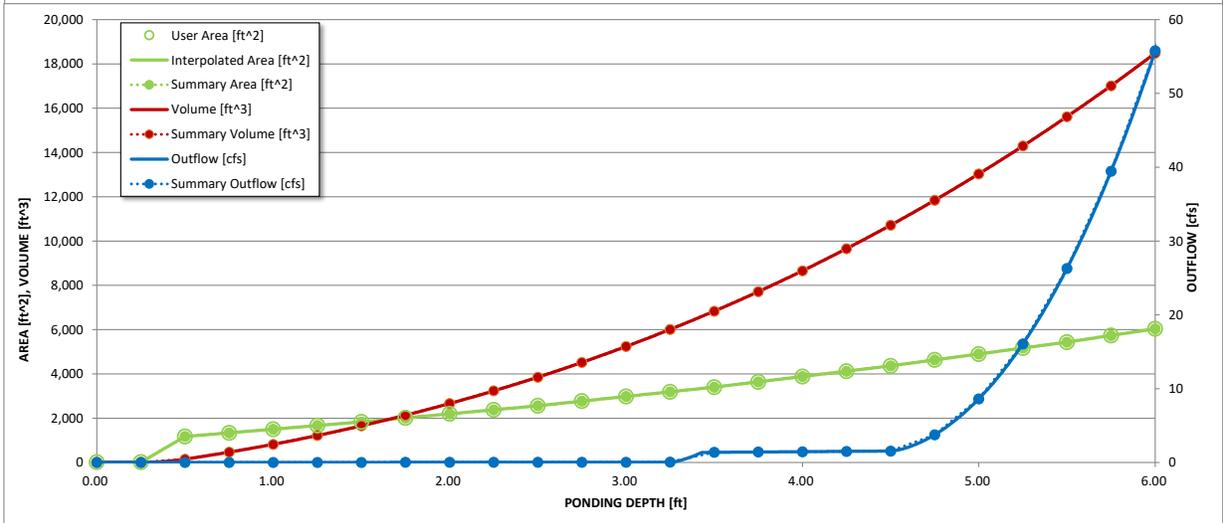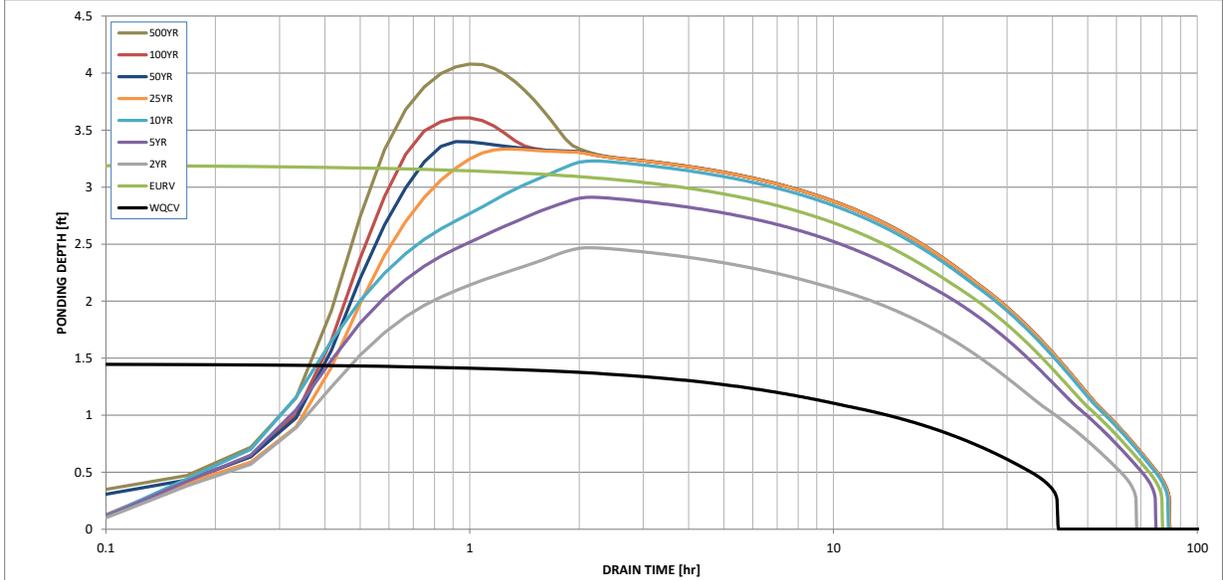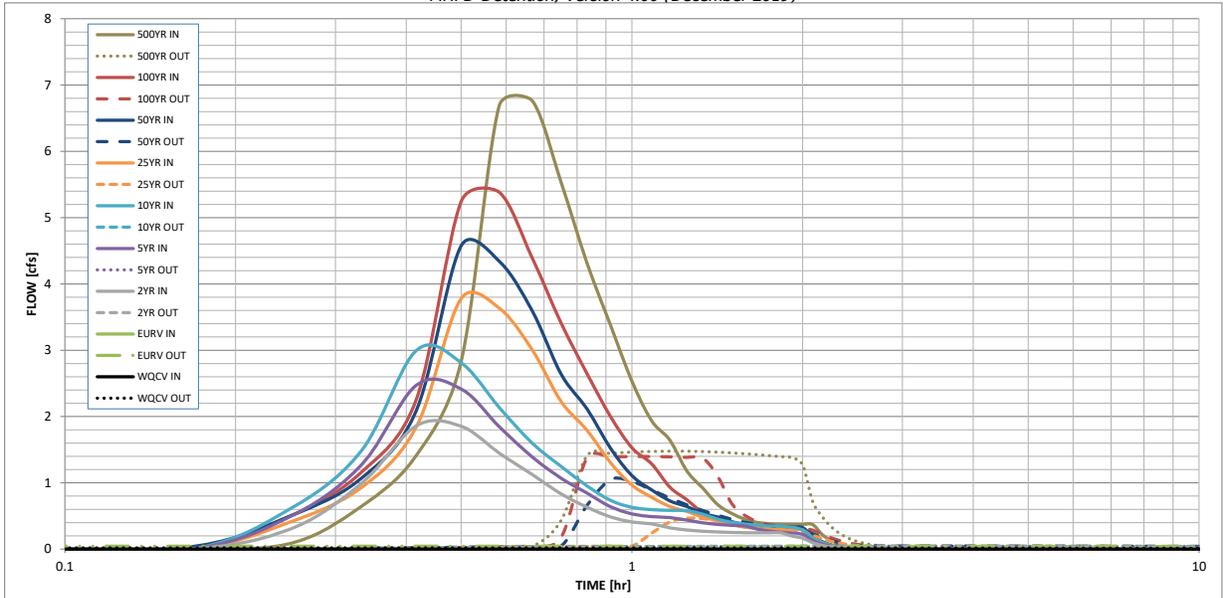

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# FORBAY VOLUMES

## FORBAY VOLUME

---

Required Forbay Volume = 1% of WQCV  
 WQCV = 0.035 ac-ft  
 WQCV = 1,525 cu-ft  
 1% of WQCV = 15 cu-ft

<i>ELEV</i>	<i>AREA</i>	<i>AREA AVG.</i>	<i>DELTA ELEV.</i>	<i>VOLUME</i>	<i>VOLUME TOTAL</i>
6483.00	39	39	1	39	
6484.00	39				39

Design Volume: 39 cu-ft  
 0.001 ac-ft

**MANNING'S EQUATION for OPEN CHANNEL FLOW**

Project: **Electronic Storage** Location: **Forebay Notch - Q=13.9 cfs \* 2% = 0.28 cfs**  
 By: **Dane Frank** Date: **8/31/2020**  
 Chk By: \_\_\_\_\_ Date: \_\_\_\_\_ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

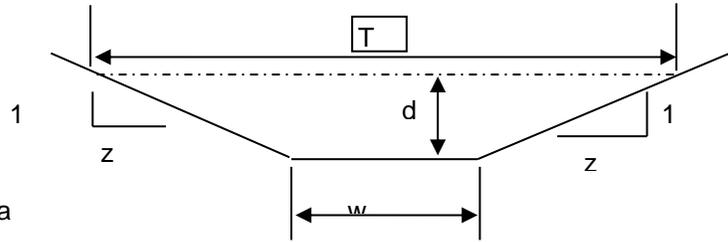

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 0  
 z (sideslope)= 0  
 b (btm width, ft)= 0.19  
 d (depth, ft)= 1  
 S (slope, ft/ft) 0.005  
 n low = 0.013  
 n high = 0.013

Clear Data  
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
1	0.19	2.19	0.09	1.58391326	0.30094	1.583913	0.30094	0.19	1.000

Sc low = 0.0641 Sc high = 0.0641

s<sub>c</sub> = critical slope ft / ft

T = top width of the stream

d<sub>m</sub> = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0448	0.0833	0.0448	0.0833

**MANNING'S EQUATION for OPEN CHANNEL FLOW**

Project: **Electronic Storage** Location: **EDB Trickle Channels (need Q= 0.28 cfs)**  
 By: **Dane Frank** Date: **8/31/2020**  
 Chk By: \_\_\_\_\_ Date: \_\_\_\_\_ version 12-2004

Mannings Formula

$$Q = (1.486/n)AR_n^{2/3}S^{1/2}$$


$$R = A/P$$

A = cross sectional area

P= wetted perimeter

S = slope of channel

n = Manning's roughness coefficient

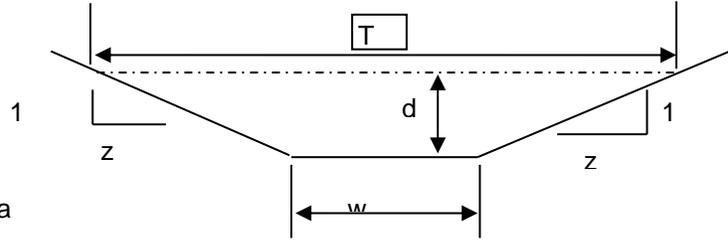

$$V = (1.49/n)R_n^{2/3}S^{1/2}$$

$$Q = V \times A$$

INPUT

z (sideslope)= 0  
 z (sideslope)= 0  
 b (btm width, ft)= 0.3  
 d (depth, ft)= 0.5  
 S (slope, ft/ft) 0.005  
 n<sub>low</sub> = 0.013  
 n<sub>high</sub> = 0.013

Clear Data  
Entry Cells

Depth, ft	Area, sf	Wetted Perimeter, ft	Hydraulic Radius, ft	Low N		High N		T =	Dm =
				Velocity, fps	Flow, cfs	Velocity, fps	Flow, cfs		
0.5	0.15	1.30	0.12	1.91555431	0.28733	1.915554	0.28733	0.3	0.500

Sc low = 0.0219 Sc high = 0.0219

s<sub>c</sub> = critical slope ft / ft

T = top width of the stream

d<sub>m</sub> = a/T = mean depth of flow

.7 Sc	1.3 Sc	.7 Sc	1.3 Sc
0.0153	0.0285	0.0153	0.0285

## **DRAINAGE MAPS**

# ELECTRONIC STORAGE SITE DEVELOPMENT PLAN EXISTING DRAINAGE MAP NOVEMBER 2020

**BASIN SUMMARY**


DESIGN POINT	BASIN	AREA (ACRES)	FLOW	
			5 YR (cfs)	100 YR (cfs)
Z	OS-Z	4.01	7.3	16.5
Y	OS-Y	2.55	2.1	8.2
A	EX-A	2.54	3.2	9.5
B	EX-B	1.91	0.9	5.4

**LEGEND**

- P-7  
12.22 BASIN DESIGNATION
- D DESIGN POINT
- BASIN BOUNDARY
- EXISTING 1' CONTOUR
- EXISTING 10' CONTOUR
- GROUND SURFACE FLOW DIRECTION
- ROAD AND DITCH FLOW DIRECTION
- CHAIN-LINK FENCE

**NOTES**


1. ALL FEATURE SHOWN ARE EXISTING.
2. NO GRADING CHANGES ARE INCLUDED IN THIS PLAN.
3. THE OFF-SITE BASINS ARE BASED ON FIMS GROUND SURFACE CONTOURS. FIMS DATA IS FROM 2012.

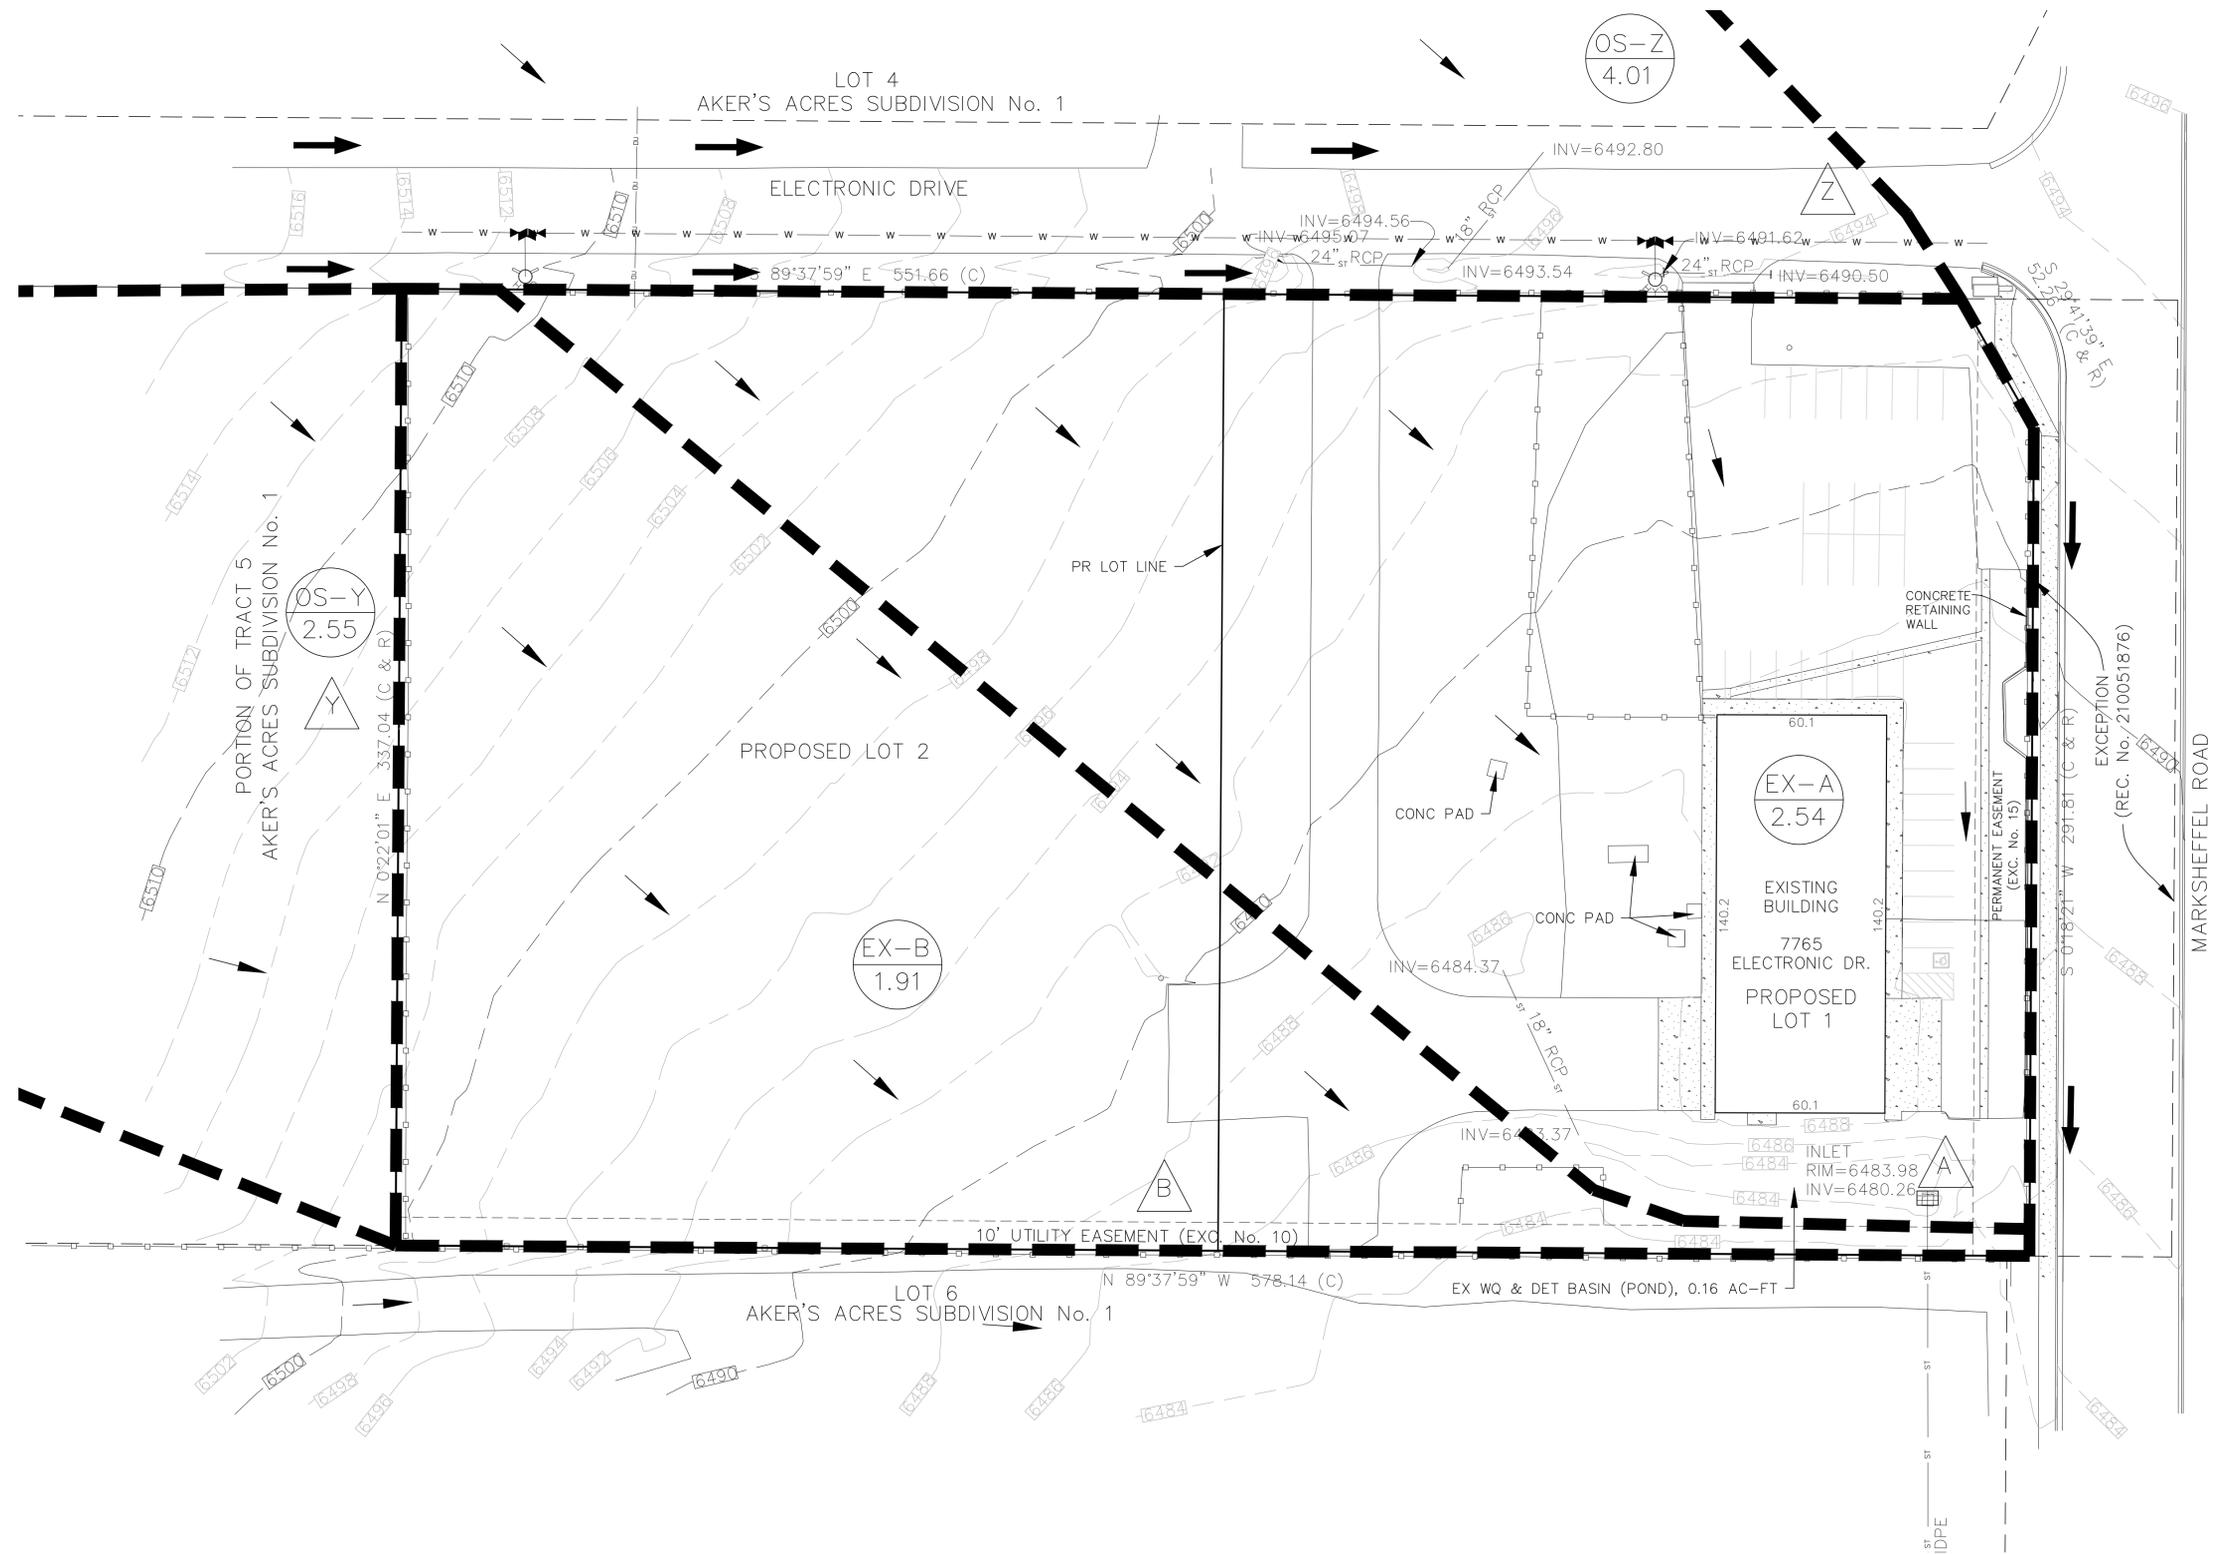

REVISIONS NO.	DESCRIPTION	DATE

UNTIL SUCH TIME AS THESE DRAWINGS ARE APPROVED BY THE LOCAL AGENCIES, THE REVIEWING AGENCIES, THE TERRA NOVA ENGINEERING, INC. APPROVES THEIR USE ONLY FOR THE DESIGN AND CONSTRUCTION OF THIS PROJECT. NO WRITTEN AUTHORIZATION.

PREPARED FOR:  
**D. STEFANO-BUILDING &...**  
ATTN: DAVID STEFANO  
520 W 21ST ST, G-2 #710  
NORFOLK, CA 94551  
757.333.3144



721 S. 23RD STREET  
COLORADO SPRINGS, CO 80904  
OFFICE: 719-635-6422  
FAX: 719-635-6426  
www.tninc.com




**ELECTRONIC STORAGE**  
EXISTING DRAINAGE MAP

DESIGNED BY DLF
DRAWN BY DLF
CHECKED BY LD
H-SCALE AS SHOWN
V-SCALE N/A
JOB NO. 1971.00
DATE ISSUED 11/16/20
SHEET NO. 1 OF 4

N:\jobs\1971.00\Drawings\197100 SDP.dwg, 11/17/2020 8:15:40 AM

N:\jobs\1971.00\Drawings\197100 SDP.dwg, 11/17/2020 8:15:40 AM

**LEGEND**

-  BASIN DESIGNATION
-  AREA IN BASIN (AC)
-  DESIGN POINT
-  BASIN BOUNDARY
-  EXISTING 1' CONTOUR
-  EXISTING 10' CONTOUR
-  GROUND SURFACE FLOW DIRECTION
-  ROAD AND DITCH FLOW DIRECTION
-  CHAIN-LINK FENCE

**NOTES**



1. ALL FEATURE SHOWN ARE EXISTING.
2. NO GRADING CHANGES ARE INCLUDED IN THIS PLAN.
3. THE OFFSITE BASINS ARE BASED ON FIMS GROUND SURFACE CONTOURS. FIMS DATA IS FROM 2012.

# ELECTRONIC STORAGE

## SITE DEVELOPMENT PLAN

# EXISTING OFFSITE BASINS

### NOVEMBER 2020

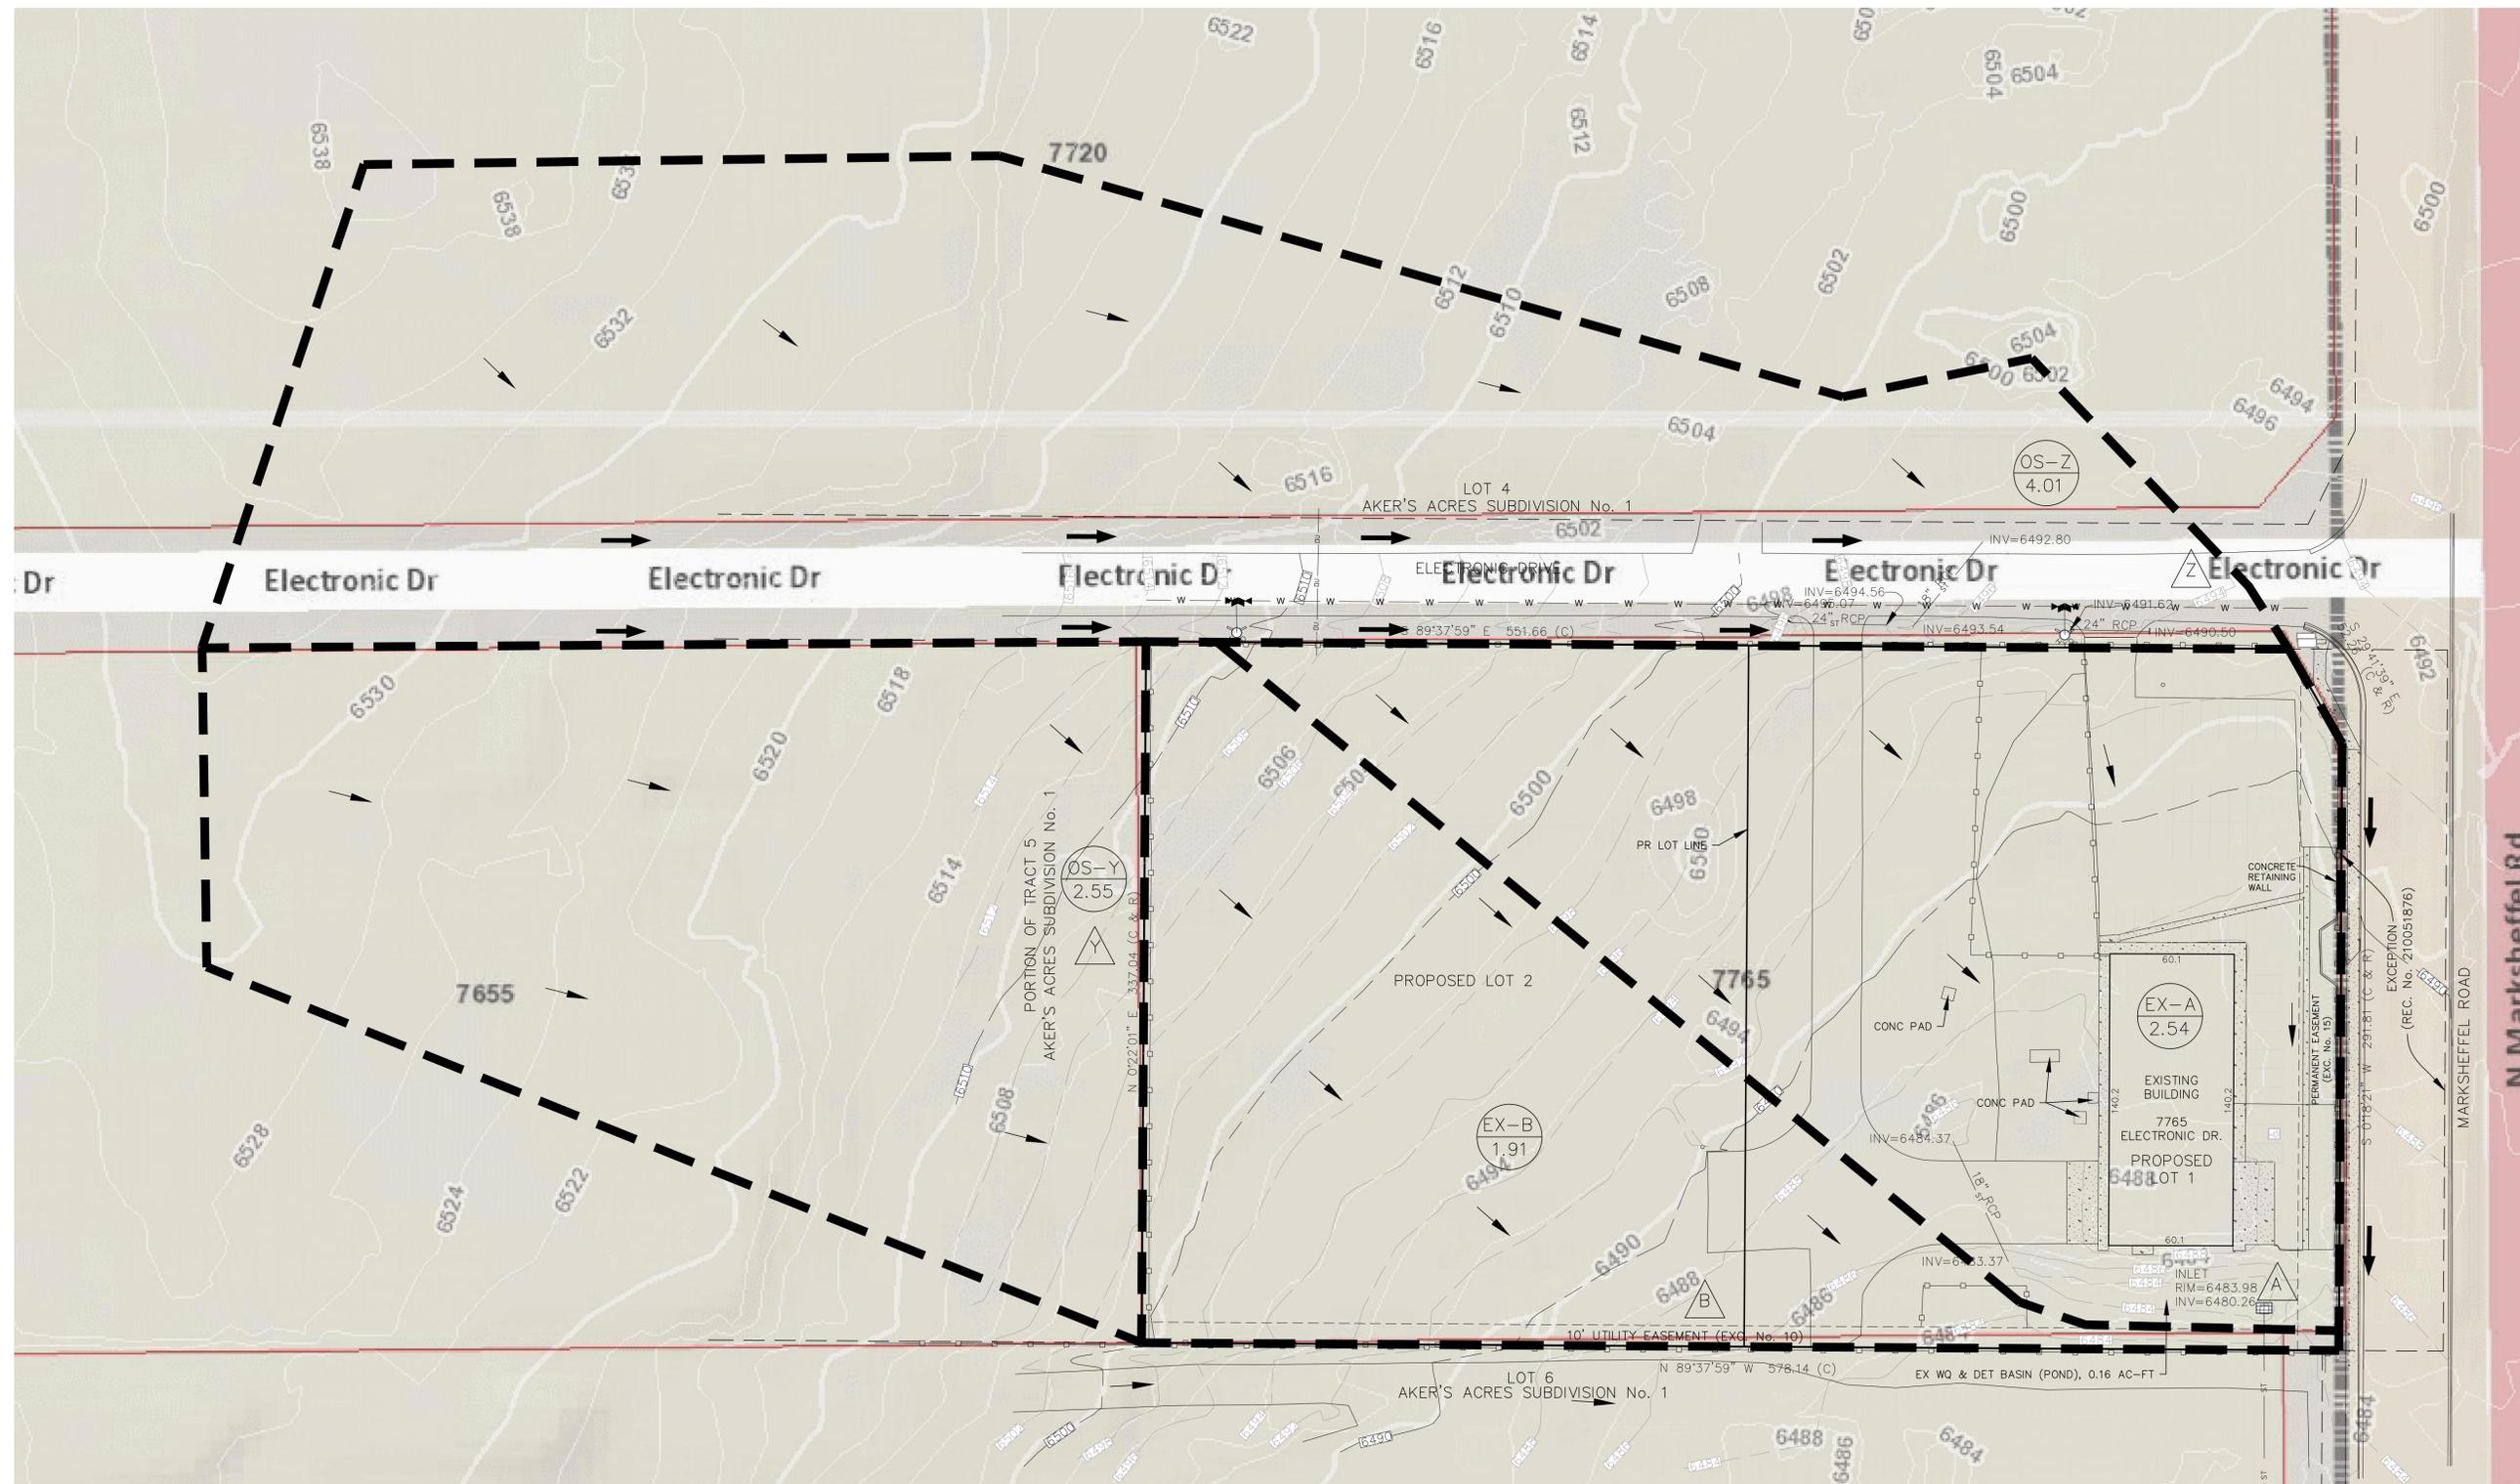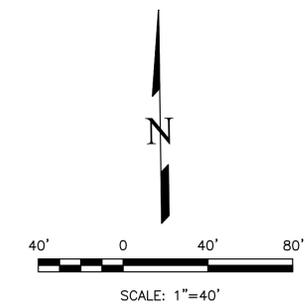

<b>REVISIONS</b>	NO.	DESCRIPTION	DATE

UNTIL SUCH TIME AS THESE DRAWINGS ARE APPROVED BY THE FOLLOWING AGENCIES: TERRA NOVA ENGINEERING, INC. APPROVES THEIR USE ONLY FOR THE PROJECT AND SITE SHOWN HEREIN. NO WRITTEN AUTHORIZATION.

PREPARED FOR:  
**D. STEFANO-BUILDING &...**  
ATTN: DAVID STEFANO  
520 W 21ST ST, G-2 #710  
NORFOLK, CA 94551  
757.333.3144



Terra Nova  
Engineering, Inc.  
Civil & Mechanical Engineers

721 S. ZUBO STREET  
COLORADO SPRINGS, CO 80904  
OFFICE: 719-635-6422  
FAX: 719-635-6426  
www.tnecinc.com

<b>ELECTRONIC STORAGE</b>	EXISTING OFFSITE BASINS
---------------------------	-------------------------

DESIGNED BY DLF	DRAWN BY DLF
CHECKED BY LD	H-SCALE AS SHOWN
	V-SCALE N/A
JOB NO. 1971.00	DATE ISSUED 11/16/20
SHEET NO. 2	OF 4

# ELECTRONIC STORAGE SITE DEVELOPMENT PLAN PROPOSED DRAINAGE MAP NOVEMBER 2020

**BASIN SUMMARY**



DESIGN POINT	BASIN	AREA (ACRES)	FLOW	
			5 YR (cfs)	100 YR (cfs)
E	OS-E	0.44	0.4	1.7
F	OS-F	1.38	1.2	4.6
G	OS-G	0.01	0.1	0.1
1	PR-1	0.37	0.2	1.1
2	PR-2	0.62	3.2	6.5
3	PR-3	0.45	2.3	4.5
4	PR-4	0.32	0.2	1.2
5	PR-5	0.34	0.1	1.0
6	PR-6	0.03	0.0	0.1
7	PR-7	0.13	0.1	0.6

**DESIGN POINT SUMMARY**

DESIGN POINT	CONTRIBUTING BASINS	AREA (ACRES)	FLOW	
			5 YR (cfs)	100 YR (cfs)
E	OS-E	0.44	0.4	1.7
F	OS-F	1.38	1.2	4.6
G	OS-G	0.01	0.1	0.1
1	OS-E, PR-1	0.81	0.6	2.8
2	OS-E, OS-F, PR-1, PR-2	1.44	3.9	9.4
2A	HALF OF BASIN TOTAL	---	2.0	4.7
2B	HALF OF BASIN TOTAL	---	2.0	4.7
3	PR-3	0.45	2.3	4.5
4	OS-E, OS-F, PR-1, PR-2, PR-3, PR-4	2.21	6.3	15.1
5	OS-F, PR-5	1.72	1.3	5.6
6	PR-6	0.03	0.0	0.1
7	PR-7	0.13	0.1	0.6

**LEGEND**

-  BASIN DESIGNATION
-  AREA IN BASIN (AC)
-  DESIGN POINT
-  BASIN BOUNDARY
-  EXISTING 1' CONTOUR
-  EXISTING 10' CONTOUR
-  GROUND SURFACE FLOW DIRECTION
-  ROAD AND DITCH FLOW DIRECTION
-  CHAIN-LINK FENCE

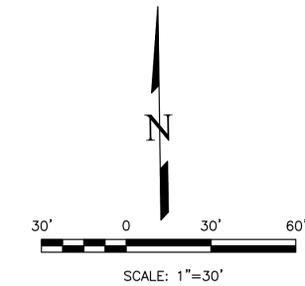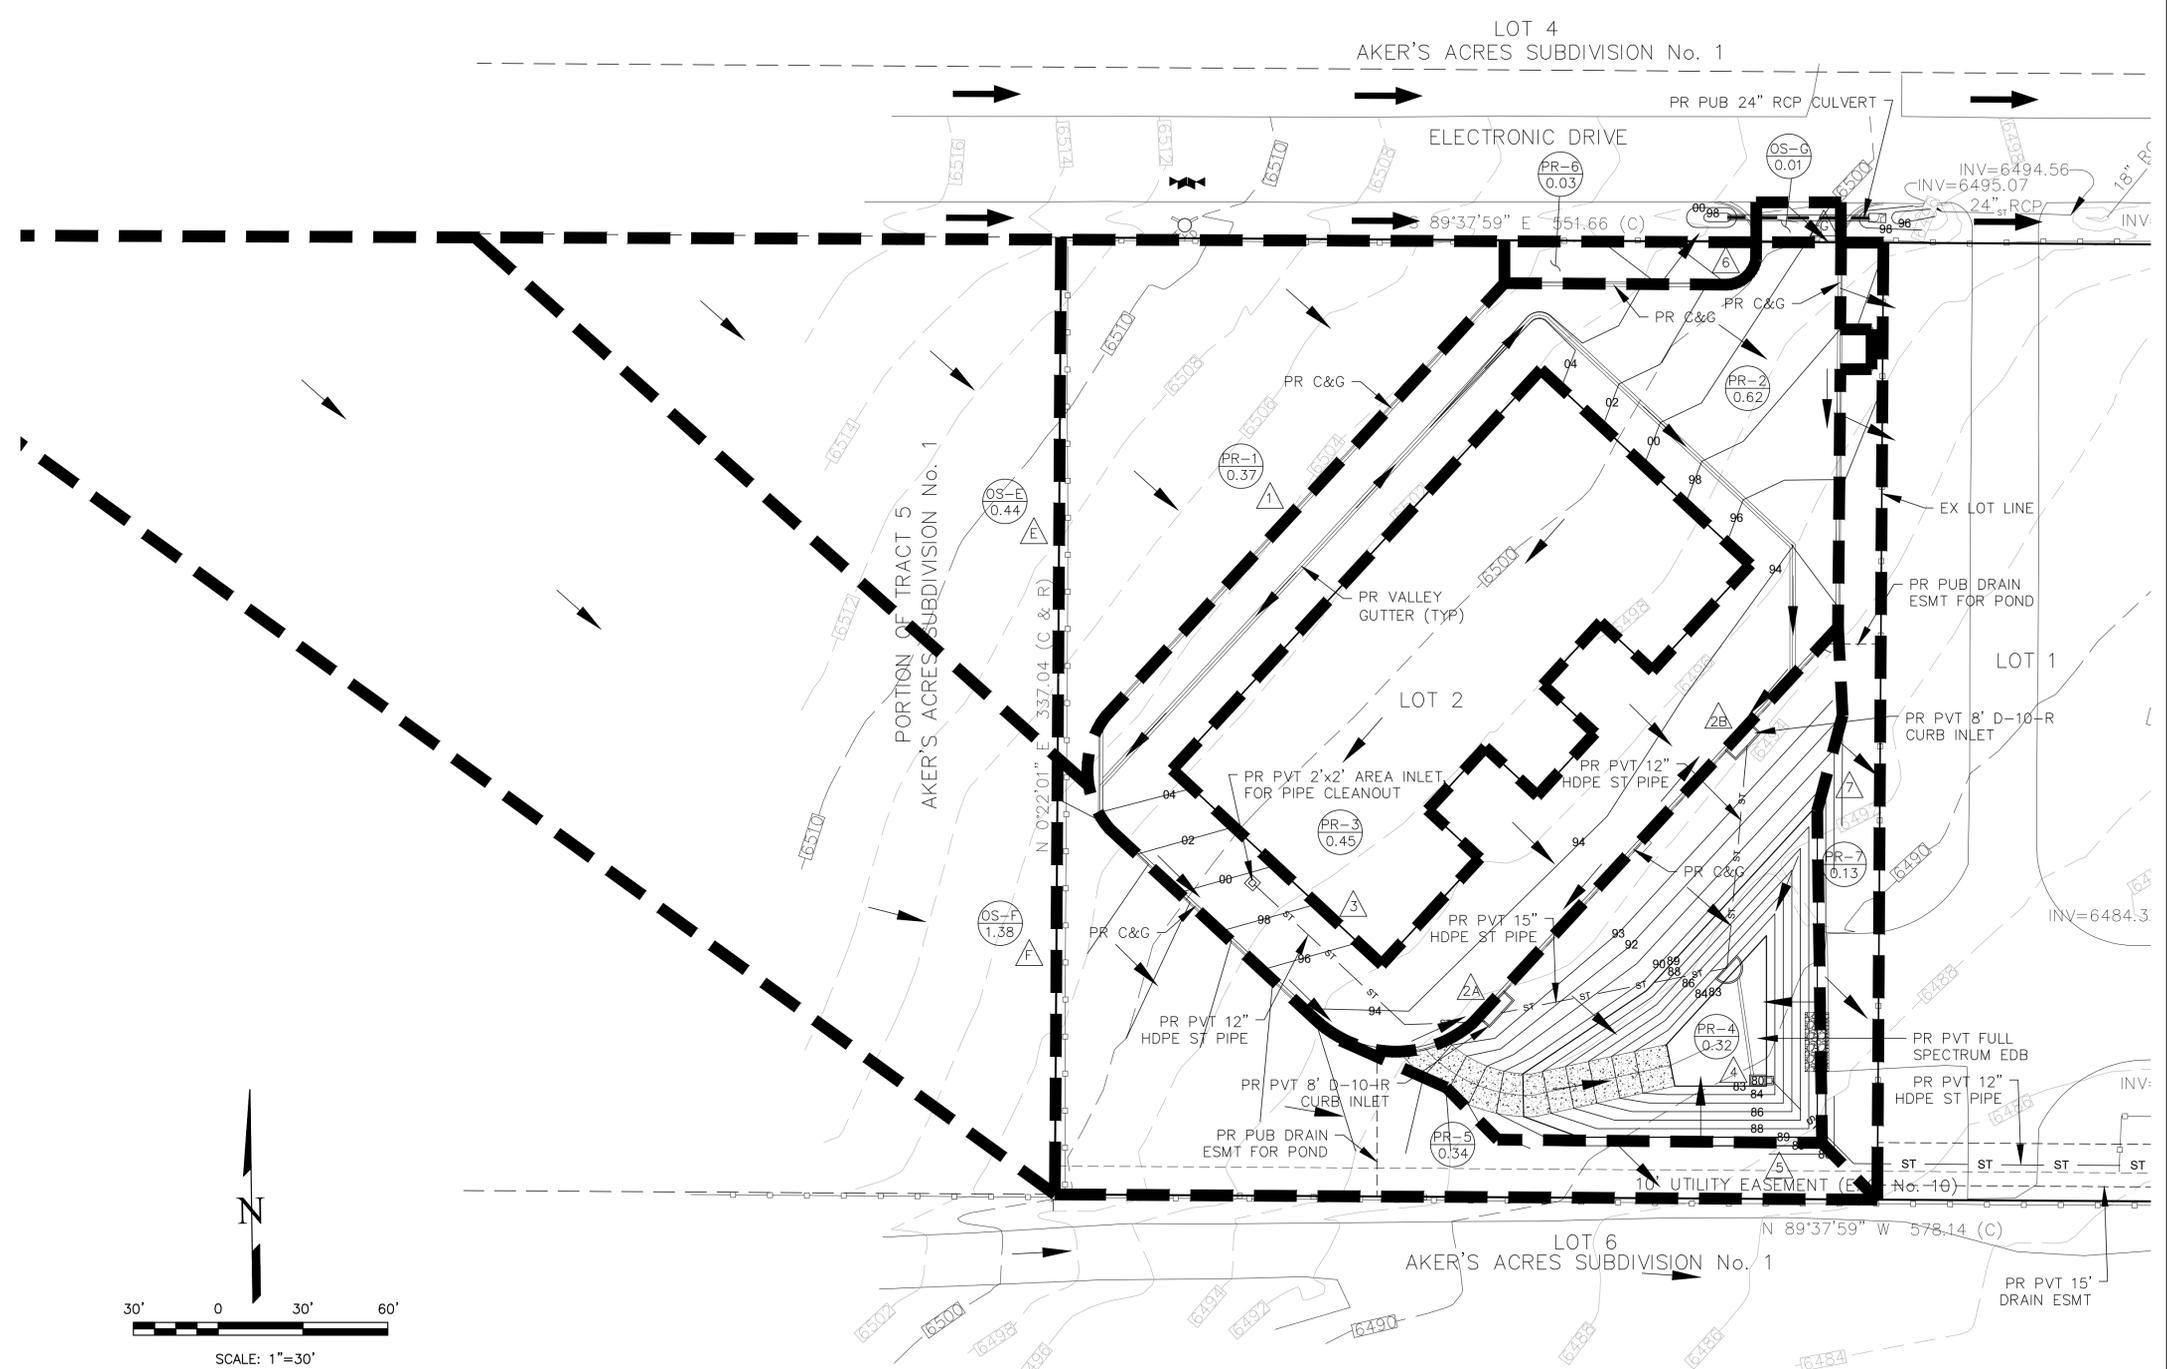

REVISIONS	NO.	DESCRIPTION	DATE

UNLESS SHOWN OTHERWISE, ALL DIMENSIONS ARE IN FEET AND DECIMALS THEREOF. ALL DIMENSIONS SHALL BE TO THE CENTERLINE UNLESS OTHERWISE NOTED. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND AUTHORIZATIONS FROM THE APPROPRIATE AGENCIES. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND AUTHORIZATIONS FROM THE APPROPRIATE AGENCIES. THE USER SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND AUTHORIZATIONS FROM THE APPROPRIATE AGENCIES.

PREPARED FOR:  
**D. STEFANO-BUILDING &...**  
ATTN: DAVID STEFANO  
520 W 21ST ST, G-2 #710  
NORFOLK, CA 94551  
757.333.3144

**Terra Nova**  
Engineering, Inc.  
Civil/Environmental Engineering

721 S. ZARO STREET  
COLORADO SPRINGS, CO 80904  
OFFICE: 719-635-6422  
FAX: 719-635-6426  
www.terrainc.com

**ELECTRONIC STORAGE**

PROPOSED DRAINAGE MAP

DESIGNED BY	DLF
DRAWN BY	DLF
CHECKED BY	LD
H-SCALE	AS SHOWN
V-SCALE	N/A
JOB NO.	1971.00
DATE ISSUED	11/16/20
SHEET NO.	2 OF 4

N:\jobs\1971.00\Drawings\197100 SDP.dwg, 11/17/2020 8:15:42 AM

