

**Final Drainage Report
Rock Island Trail
Sand Creek to Constitution
Capital Project
Colorado Springs, Colorado**

Prepared for:
City of Colorado Springs
Parks, Recreation and Cultural Services Department
1401 Recreation Way
Colorado Springs, CO 80905
(719) 385-6951

Prepared by:

1604 South 21st Street
Colorado Springs, Colorado 80904
Ph: (719)630-7342

Kiowa Project No. 16028
SWENT File: STM-REV24-0295
EPC Project Number CDR193

May 15, 2025

Table of Contents

I.	General Location and Description	1
II.	Drainage Facility Design.....	1
	A. General Concept	1
	i. Proposed drainage patterns.....	2
	ii. Off-site runoff consideration	4
	iii. Water quality and runoff reduction measures.....	4
	iv. Water Quality Methodology (4-Step Process):.....	4
	Step 1: Runoff reduction Practices.....	4
	Step 2: Implement CM's that Slowly Release the Water Quality Capture Volume	5
	Step 3: Stabilize Drainageways.....	5
	Step 4: Implement Site Specific & Source Control CM's	5
	B. Specific Details	5
	i. Detention storage and outlet design	5
	ii. Hydrologic and hydraulic calculations	6
	iii. Current estimate of cost of proposed facilities	6
	iv. Drainage fees.....	7
	v. Summary	8
	C. Agency Requirements	8
	i. Federal Emergency Management Agency (FEMA)	8
III.	References.....	9

Appendix A

- Vicinity Map
- Soils Map
- FEMA Flood Insurance Map

Appendix B

- Rational Calculations

Appendix C

- Runoff Reduction Calculations

Appendix D

- Drainage Conditions Map


Appendix E

- City / County MS4 Overlap Agreement

ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Kiowa Engineering Corporation, 1604 South 21st Street, Colorado Springs, Colorado 80904

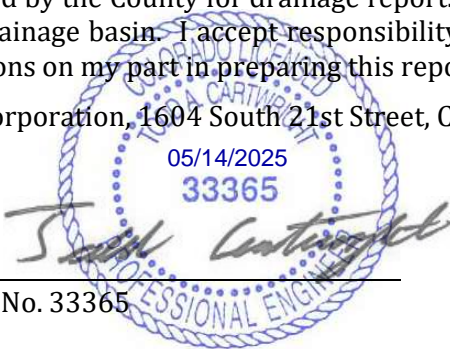

Todd Cartwright, P.E. No. 33365

Date

CITY PROJECT MANAGER'S STATEMENT:

I hereby certify that the drainage for Rock Island Trail shall be constructed according to the design presented in this report. I further understand that field changes must be reviewed by the City Review Engineer to ensure conformance with the original design intent. I am employed by and perform engineering services solely for the City of Colorado Springs, and therefore am exempt from Colorado Revised Statute Title 12, Article 25, Part 1 according to § 12-25-103(1), C.R.S.

Name of City Project Manager: Emily Duncan

Signature: _____

Date: 11/15/24

CITY OF COLORADO SPRINGS STATEMENT

Filed in accordance with section 7.4.701 of the Code of the City of Colorado Springs, 2023, as amended.

SWENT Manager

Date

EL PASO COUNTY STATEMENT:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 & 2, El Paso County Engineering Criteria Manual, and Land Development Code, as amended.

Joshua Palmer, P.E.

El Paso County Engineer/ECM Administrator

05/15/2025

Date

Conditions:

I. GENERAL LOCATION AND DESCRIPTION

The purpose of this Drainage Letter is to identify on-site and off-site drainage patterns, storm sewers, culvert and inlet locations, areas tributary to the site, and to safely route developed storm water to adequate outfalls for Rock Island Trail.

Rock Island Trail is comprised of 36.2 acres, located in southeast Colorado Springs, Colorado between Sand Creek and Constitution Ave. The property is bordered by multiple commercial and residential lots and city property.

The property is located in Sections 5 and 6, Township 14, Range 65 of the 6th Principal Meridian, in Colorado Springs, El Paso County, Colorado. The vegetation in the site consists of native grasses. A vicinity map showing the general location of the site is presented in Appendix A.

The property is primarily the abandoned Rock Island Railroad alignment. It is now an almost 2 mile long narrow strip of land that is city owned open space consisting of approximately 36.8 acres. The total disturbed area associated with this project is approximately 18.2 acres. However, the disturbance area is considered 0.0 because the whole project falls under the trail exclusion. There is no proposed development within any streamside buffer zone or in any designated floodplain, as indicated on FEMA panel 08041C0752G. A FEMA firmette for the site is located in Appendix A.

II. GENERAL CONCEPT

A. EXISTING DRAINAGE PATTERNS

In the existing condition, the site generally drains from north to the south and from east to west. The site sheet flows south offsite onto the developed properties to the south. Sand Creek is at the west end of the project which intercepts flows and conveys them West to Fountain Creek.

Because of the long and narrow shape of the project most of the storm runoff leaves the property as sheet flow onto the numerous properties adjacent to the property. There are not points on the property where flows leave in a concentrated manner. The following is a description of the existing drainage sub-basins.

Sub-basin E-1: Sub-basin E-1 is 0.87 acres, with 5 and 100-year runoff of 0.3 and 1.9 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E1. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin E-2: Sub-basin E-2 is 7.99 acres, with 5 and 100-year runoff of 3.3 and 22 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the north side of the site and consists of open space and trails. The runoff from this sub-basin flows north across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E2. The flow enters a concrete trapezoidal ditch that borders the project to the north. This ditch discharges directly to Sand Creek and the west end of the project.

Sub-basin E-3: Sub-basin E-3 is 10.64 acres, with 5 and 100-year runoff of 4.1 and 27 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E3. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin E-4: Sub-basin E-4 is 6.13 acres, with 5 and 100-year runoff of 2.5 and 17 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the north side of the site and consists of open space and trails. The runoff from this sub-basin flows north across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E4. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin E-5: Sub-basin E-5 is 9.69 acres, with 5 and 100-year runoff of 4.0 and 27 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E5. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin E-6: Sub-basin E-6 is 0.65 acres, with 5 and 100-year runoff of 0.3 and 1.7 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E6. The flow discharges into basin E-5.

Sub-basin E-7: Sub-basin E-7 is 0.67 acres, with 5 and 100-year runoff of 0.3 and 2.1 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the west end of the site and consists of open space and trails. The runoff from this sub-basin flows west into Sand Creek and does not concentrate. The design point is depicted as Design Point E7.

Sub-basin E-8: Sub-basin E-8 is 0.17 acres, with 5 and 100-year runoff of 0.5 and 1.0 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the west end of the site and consists of sidewalk and open space. The runoff from this sub-basin flows north into Constitution Ave as concentrated flow. The design point is depicted as Design Point E8. The flow ultimately gets to Sand Creek using Constitution Ave Curb and Gutter.

B. PROPOSED DRAINAGE PATTERNS

Similar to the existing conditions, the proposed drainage will generally travel to the west into Sand Creek, then ultimately flow into the Fountain creek drainage basin.

The runoff in the developed condition will be the same as the existing condition. The basin areas do not change as a result of this project, the times of concentration do not change as a result of this project. The C values do not change as a result of this project. The site remains “undeveloped historic greenbelts”

Sub-basin P-1: Sub-basin P-1 is 0.87 acres, with 5 and 100-year runoff of 0.3 and 1.9 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point P1. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin P-2: Sub-basin P-2 is 7.99 acres, with 5 and 100-year runoff of 3.3 and 22 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the north side of the site and consists of open space and trails. The runoff from this sub-basin flows north across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point E2. The flow enters a concrete trapezoidal ditch that borders the project to the north. This ditch discharges directly to Sand Creek and the west end of the project.

Sub-basin P-3: Sub-basin P-3 is 10.64 acres, with 5 and 100-year runoff of 4.1 and 27 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point P3. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin P-4: Sub-basin P-4 is 6.13 acres, with 5 and 100-year runoff of 2.5 and 17 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the north side of the site and consists of open space and trails. The runoff from this sub-basin flows north across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point P4. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin P-5: Sub-basin P-5 is 9.69 acres, with 5 and 100-year runoff of 4.0 and 27 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and does not concentrate. The design point is depicted as Design Point P5. The flow ultimately gets to Sand Creek through numerous paths.

Sub-basin P-6: Sub-basin P-6 is 0.65 acres, with 5 and 100-year runoff of 0.3 and 1.7 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the south side of the site and consists of open space and trails. The runoff from this sub-basin flows south across the basin as sheet flow and concentrates at design point 6. The flow discharges into basin P-5 through a proposed 18" culvert. There will be type L rip rap at the culvert outlet to dissipate the flows. The pipe and rip rap sizing calcs are included in appendix B. Basin P-5 these flows will travel overland over flat not steep (2%) terrain to infiltrate in a pervious (RPA) area.

Sub-basin P-7: Sub-basin P-7 is 0.67 acres, with 5 and 100-year runoff of 0.3 and 2.1 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the west end of the site and consists of open space and trails. The runoff from this sub-basin flows west into Sand Creek and does not concentrate. The design point is depicted as Design Point P7. Within Basin E-7/P-7 there is an existing 18" RCP culvert. This culvert will be extended past the abutment bank lining with the same diameter, slope and material pipe as the existing pipe.

Sub-basin P-8: Sub-basin P-8 is 0.17 acres, with 5 and 100-year runoff of 0.5 and 1.0 CFS respectively. It is not expected to receive any offsite flow. The sub-basin includes a portion of the west end of the site and consists of sidewalk and open space. The runoff from this sub-basin flows north into Constitution Ave as concentrated flow. The design point is depicted as Design Point P8. The flow ultimately gets to Sand Creek using Constitution Ave Curb and Gutter.

III. DRAINAGE DESIGN CRITERIA

This report followed the criteria and format included in "Colorado Springs Drainage Criteria Manual (DCM) Volume 1", "Volume 2" and "Colorado Springs Engineering Criteria Manual".

The report also followed the "Master Development Drainage Plan Drennan Subdivision Filing No. 1." And Amendment 1. The design of this site is in conformance with the MDDP.

Hydrologic and hydraulic calculations for the site were performed using the methods outlined in the *Colorado Springs Drainage Criteria Manual*. Topography for the site was compiled using a one-foot contour interval and is presented on the Drainage Plan.

The hydrologic calculations were made for the historic and developed site conditions. The Drainage Plan presents drainage patterns for the site, including the sub-basins. The peak flow rates for the

sub-basins were estimated using the Rational Method. The 5-year (Minor Storm) and 100-year (Major Storm) recurrence intervals were determined. The one-hour rainfall depth was determined from Table 6-2 of the Drainage Criteria Manual. These depths are shown in the runoff calculations spreadsheet.

This report and findings are in general conformance with the Sand Creek Drainage Basin Planning Study (DBPS) Final Report, dated January 2021, prepared by Stantec, HDR and DewBerry. There are no other known drainage reports for this site. This is primarily because the site is an old unplatted railroad corridor.

For both existing and proposed condition undeveloped greenbelt curve numbers were used. The site will remain a greenbelt with the trail improvements.

I. OFF-SITE RUNOFF CONSIDERATION

Most of the storm runoff leaves the site as sheet flows onto the adjacent properties. The amount of flow going onto any one property is negligible.

No significant off-site flows are expected to enter the site. No off-site flows will enter the site from the south due to the topography. No off-site flows will enter the site from the northwest of Peterson Blvd due to a concrete ditch separating the project site from all the properties north of the site. Some residential back yards will drain onto the site east of Peterson on the north side of the site. But this flow is negligible and unconcentrated flow.

II. HYDROLOGIC AND HYDRAULIC CALCULATIONS

Hydrologic and hydraulic calculations for the site were performed using the methods outlined in the *Colorado Springs Drainage Criteria Manual*. Topography for the site was compiled using a one-foot contour interval and is presented on the Drainage Plan.

The hydrologic calculations were made for the historic and developed site conditions. The Drainage Plan presents drainage patterns for the site, including the sub-basins. The peak flow rates for the sub-basins were estimated using the Rational Method. The 5-year (Minor Storm) and 100-year (Major Storm) recurrence intervals were determined. The one-hour rainfall depth was determined from Table 6-2 of the *Drainage Criteria Manual*. These depths are shown in the runoff calculations spreadsheet.

Collection of the runoff will be accomplished through a combination of sheet flow, gutter flow, creek flow, and off-site storm flow.

The peak flow data generated using the rational method was used to verify no increase in cfs of the site due to proposed site development within the site. Calculations are included in appendix B & C.

III. SOILS CONSIDERATIONS

The onsite soils were considered to be Hydrologic Soil Group A, based on the *Soil Survey*. For existing conditions, runoff coefficients were determined using a land use of pasture/meadow. The land use for the proposed development will be Commercial.

A Grading and Erosion Control plan is required for this project since the area of disturbance 18.2 acre. A Grading and Erosion Control plan will be submitted to SWENT and EPC for review and approval with the development of the construction drawings.

IV. WATER QUALITY METHODOLOGY (4-STEP PROCESS):

The Four Step Process is a method of mitigating the impact of new development on receiving waters by reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing

drainageways, and implementing long-term source controls. The Four Step Process primarily focuses on smaller, frequently occurring storm events, as opposed to larger storms for which the drainage facilities are sized.

Exclusion

This site is a trail shown as “Urban Trails in the Parks, Recreation, and Cultural Services Park System Master Plan.” This entire 18.2 acres of the project is claiming exclusion from disturbance area to reduce or eliminate the amount of the disturbance area associated with a project for the purposes of applying the 4 Step Process and detention requirements. Per section 2.0 of the 4-step process in the DCM.

The Grading and Erosion Control Plan will be submitted to Stormwater Enterprise for review and approval prior to construction.

The 4 step process does not apply to this project because of the exclusion.

IV. DRAINAGE BASIN FEES

The site is city property and will not be required to pay drainage fees.

V. MS4 PERMIT OVERLAP

This project is physically located in both the City of Colorado Springs and El Paso County. The Project “owner” is the City. More specifically the City Parks, Recreation and Cultural Services Department. For this project the City will be supervising the MS4 Permit activities. As a result, the City and County created an agreement to address the overlap of the MS4 Permits and the supervision of the activities. This agreement is located in appendix E.

VI. SUMMARY

The site runoff proposed for Rock Island Trail will not increase and not adversely affect the downstream and surrounding developments. This report and findings are in general conformance with the Sand Creek Drainage Basin Planning Study (DBPS).

Runoff Summary

Design Point	Existing		Proposed	
	5 yr Flow (cfs)	100-yr Flow (cfs)	5 yr Flow (cfs)	100 yr flow (cfs)
E-1 / P-1	0.3	1.9	0.3	1.9
E-2 / P-2	3.3	22	3.3	22
E-3 / P-3	4.1	27	4.1	27
E-4 / P-4	2.5	17	2.5	17
E-5 / P-5	4.2	30	4.2	30
E-6 / P-6	0.2	1.6	0.2	1.6
E-7 / P-7	0.3	2.1	0.3	2.1
E-8 / P-8	0.4	0.9	0.4	0.9

The flows do not change from existing to proposed because the “greenbelt” curve numbers are used for both the existing and developed conditions.

A. AGENCY REQUIREMENTS

I. FEDERAL EMERGENCY MANAGEMENT AGENCY (FEMA)

The subject property limits are shown on Flood Insurance Rate Map (FIRM) 08041C0752G with effective dates of December 7, 2018 that are included in Appendix A. The FIRMs also show that the property to be developed is located outside of the FEMA regulated floodplain.

VII. REFERENCES



- 1) Sand Creek Drainage Basin Planning Study Final Report, dated January 2021, prepared by Stantec, HDR and DewBerry.
- 2) Colorado Springs Drainage Criteria Manual Volume 1, dated July 2014, Revised January 2021.
- 3) Colorado Springs Drainage Criteria Manual Volume 2, dated July 2014, revised December 2020.
- 4) Colorado Springs Engineering Criteria Manual, dated July 2019.
- 5) National Flood Insurance Hazard layer FIRMette portion of panels 08041C0741G, Federal Emergency Management Agency, both Effective Date 12/7/2018.

APPENDIX A

Figure 1: Vicinity Map

Figure 2: Soils Map

Figure 3: FEMA Flood Insurance Rate Map

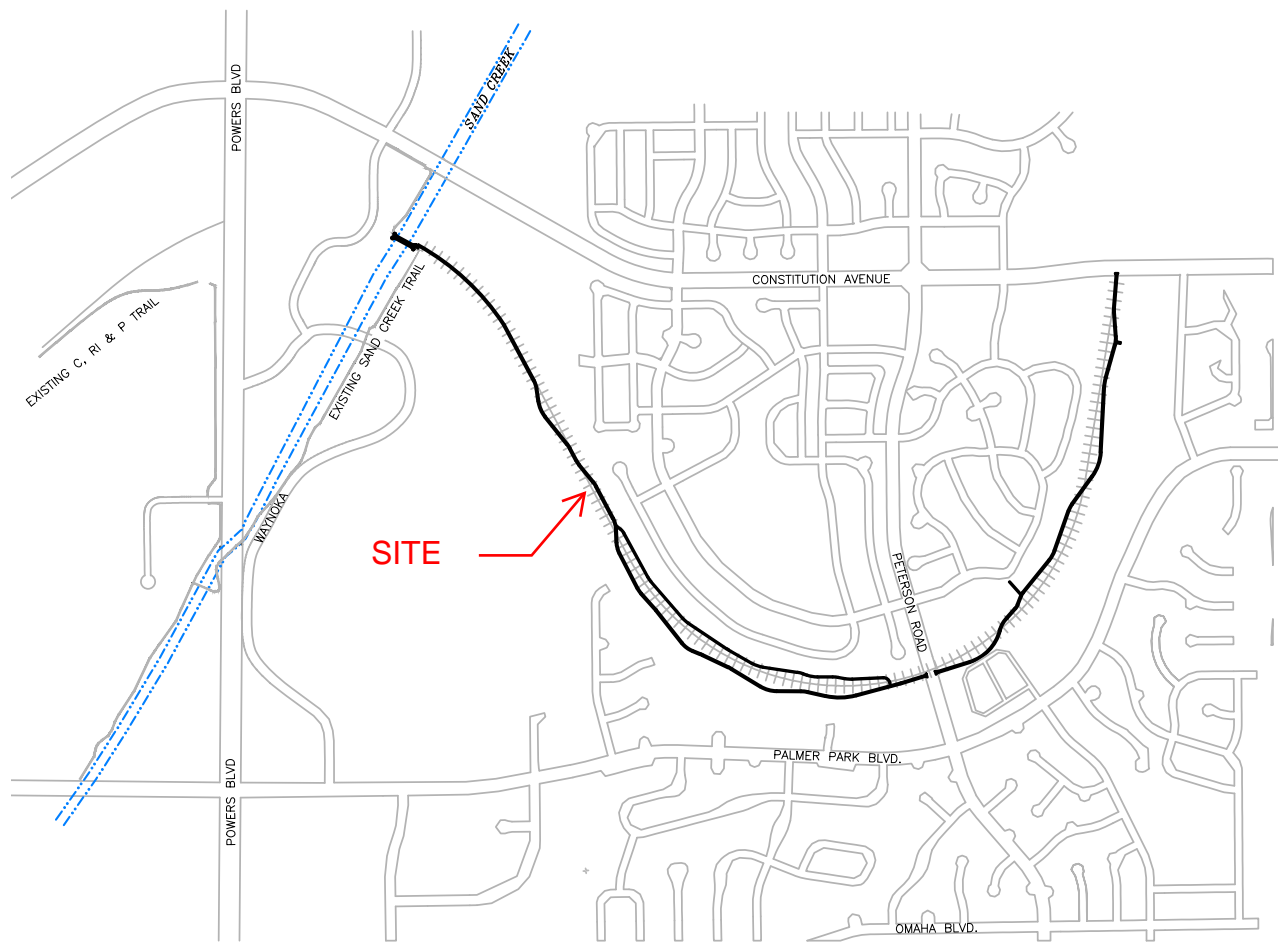

SCALE: 1"=1500'




FIGURE 1
VICINITY MAP
ROCK ISLAND MULTI-USE TRAIL

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The **community map repository** should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, NIMS12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations** and **floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.


Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call **1-877-FEMA MAP** (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfip>.

Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


Panel Location Map

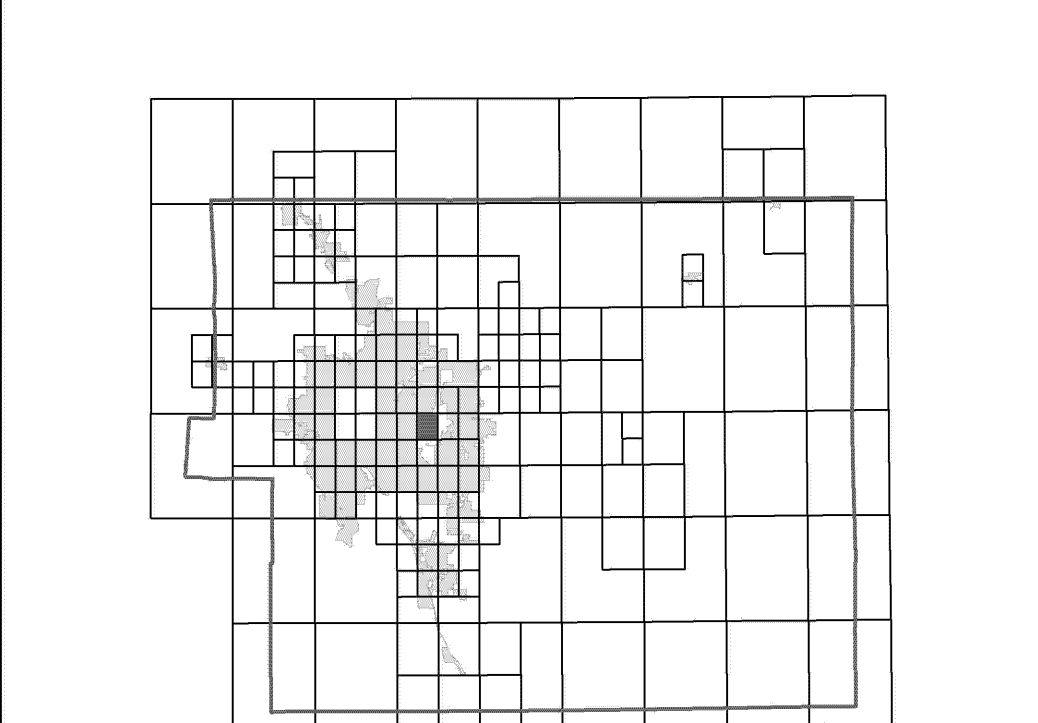

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).



Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

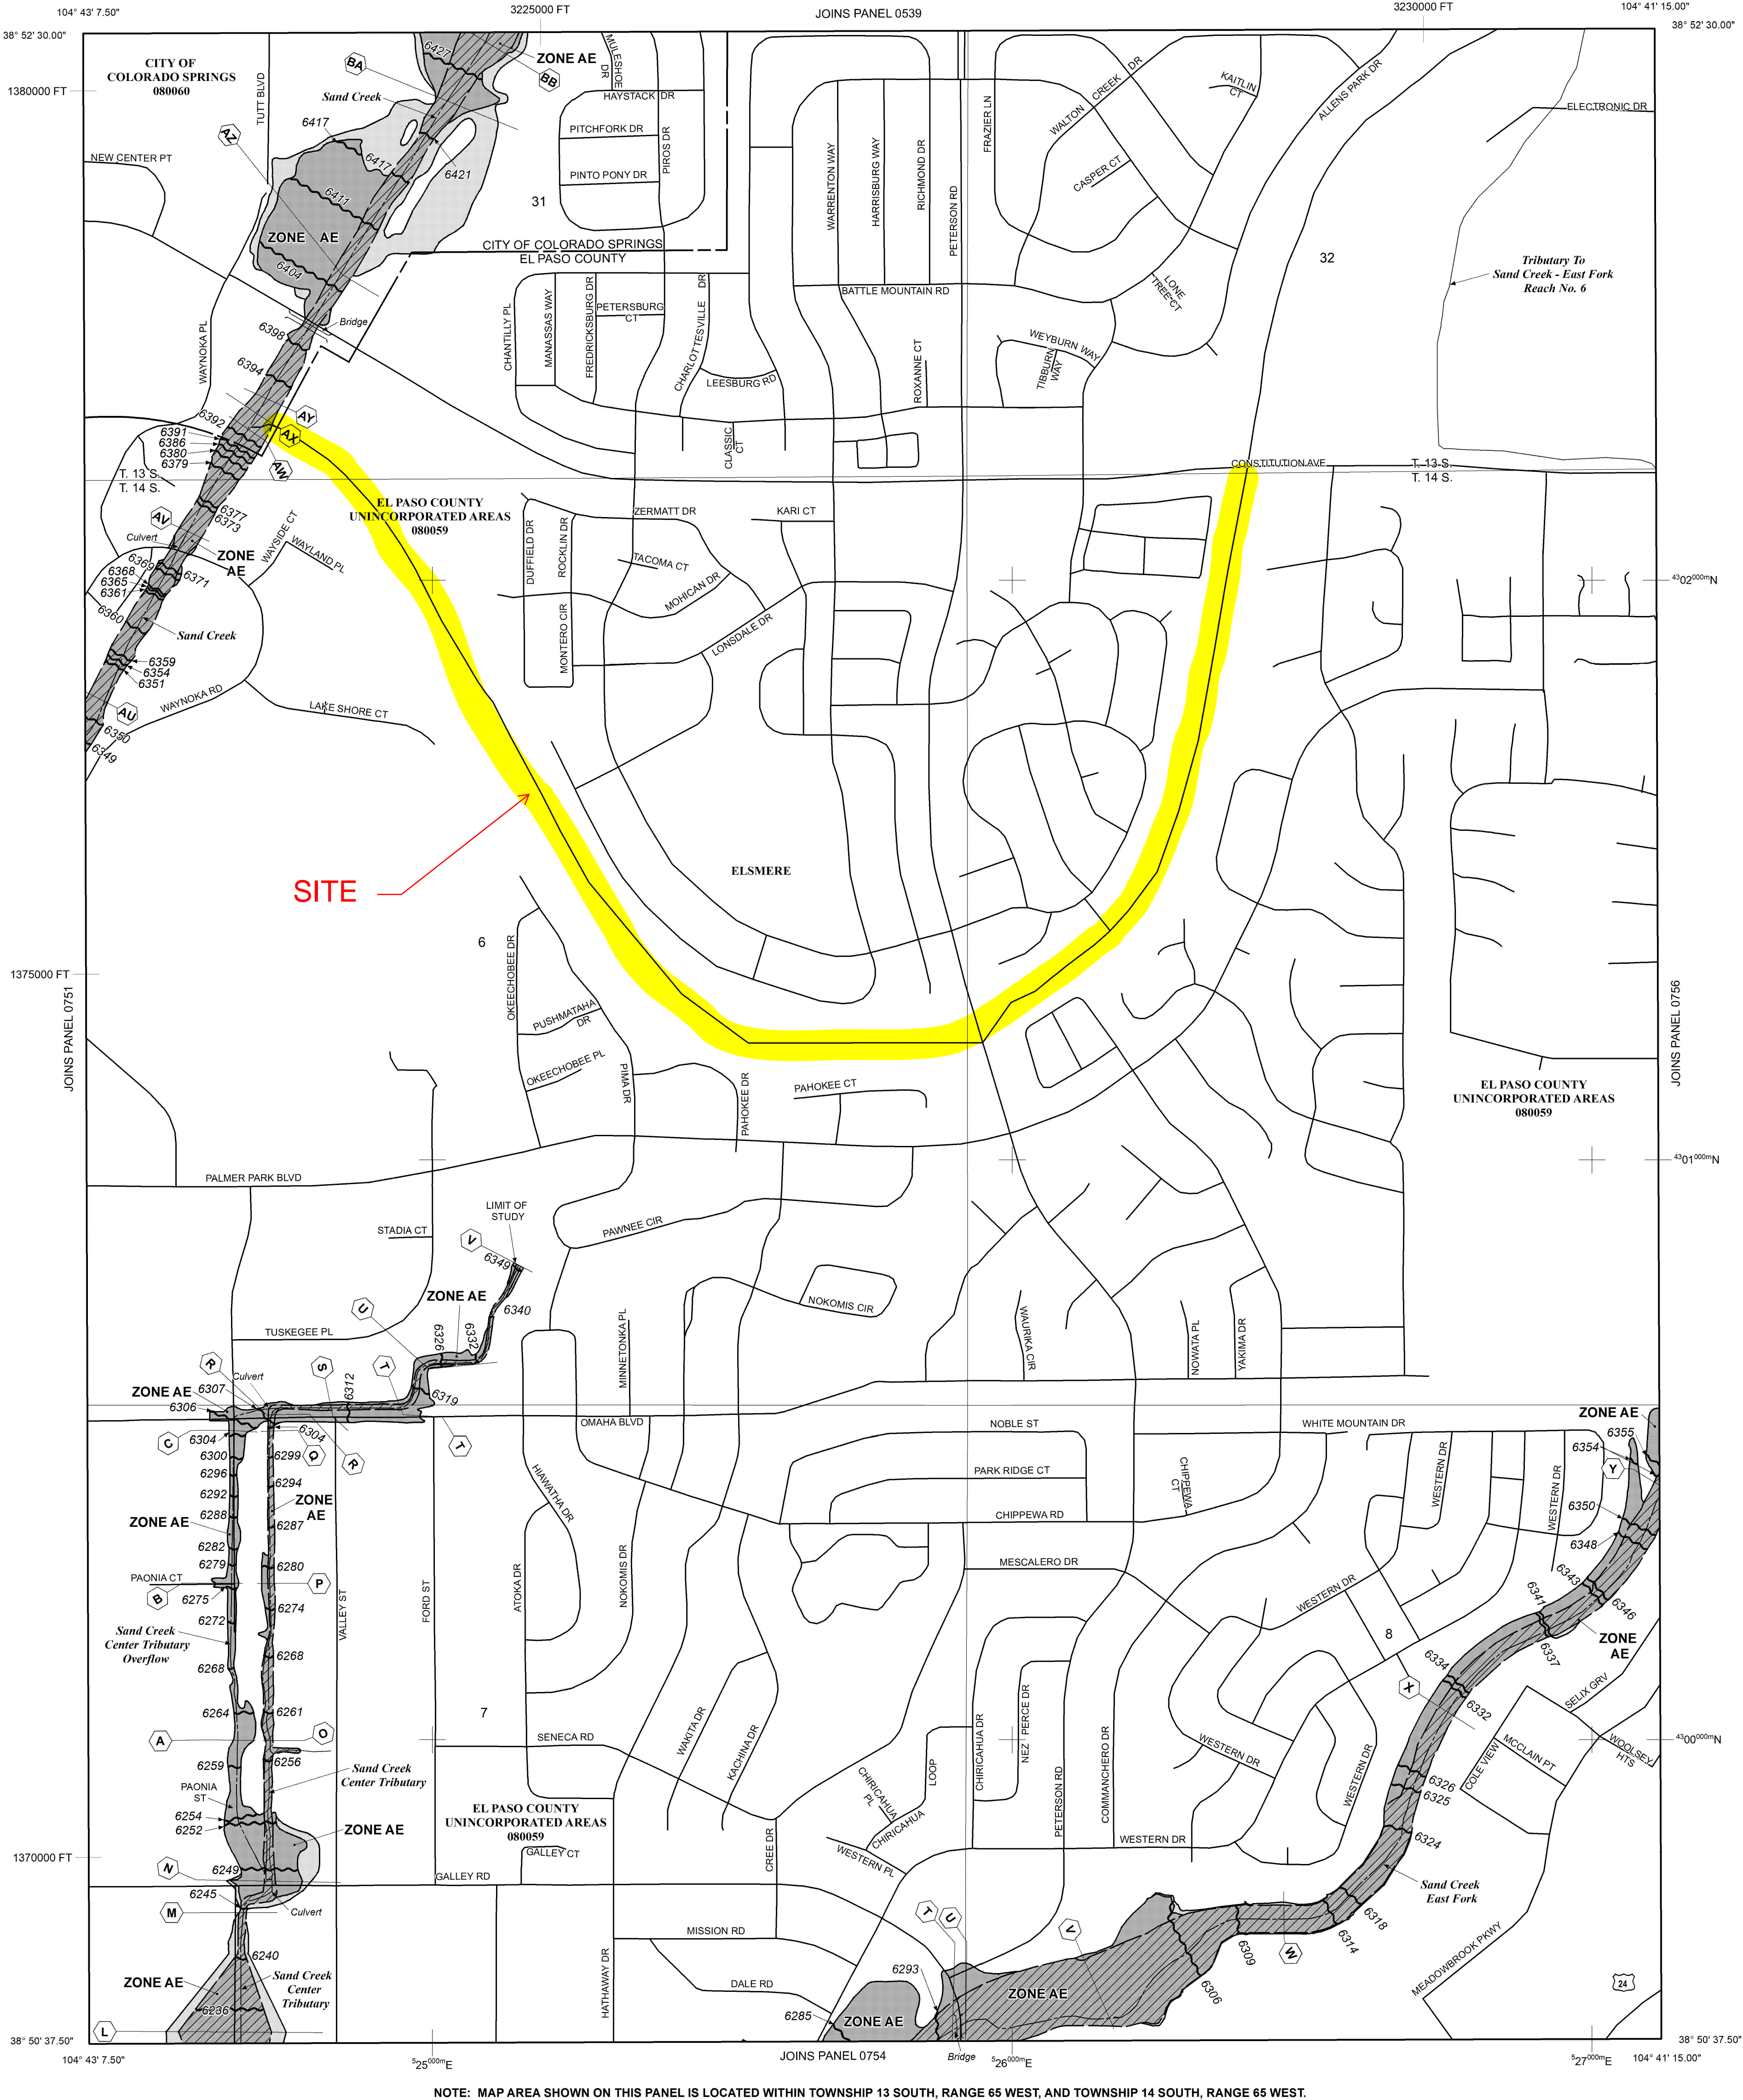

NOTE: MAP AREA SHOWN ON THIS PANEL IS LOCATED WITHIN TOWNSHIP 13 SOUTH, RANGE 65 WEST, AND TOWNSHIP 14 SOUTH, RANGE 65 WEST.

LEGEND

SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equalled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

ZONE A No Base Flood Elevations determined.
ZONE AE Base Flood Elevations determined.
ZONE AH Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.

ZONE AO Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.

ZONE AR Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently identified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.

ZONE A99 Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.

ZONE V Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.

ZONE VE Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

ZONE X Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

ZONE X Areas determined to be outside the 0.2% annual chance floodplain.

ZONE D Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

Floodplain boundary
Floodway boundary
Zone D Boundary
CBRS and OPA boundary
Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.
Base Flood Elevation line and value; elevation in feet* (EL 987)
Base Flood Elevation value where uniform within zone; elevation in feet*


* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

Cross section line
Transect line
Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
1000-meter Universal Transverse Mercator grid ticks, zone 13
5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 0502), Lambert Conformal Conic Projection
Bench mark (see explanation in Notes to Users section of this FIRM panel)
River Mile

MAP REPOSITORIES
Refer to Map Repositories list on Map Index
EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
MARCH 17, 1997
EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL
DECEMBER 7, 2018 to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

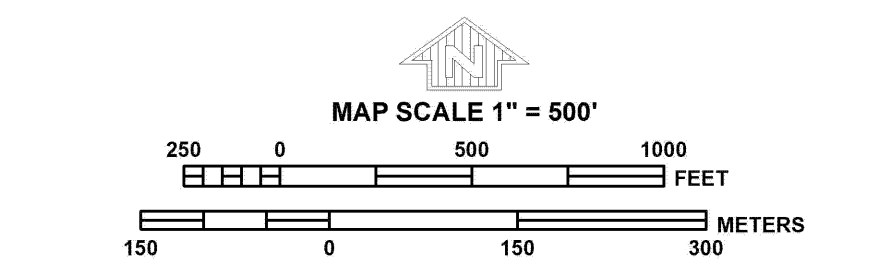

PANEL 0752G

FIRM

FLOOD INSURANCE RATE MAP
EL PASO COUNTY, COLORADO AND INCORPORATED AREAS

PANEL 752 OF 1300

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	080060	0752	G
EL PASO COUNTY	080059	0752	G

Notice: This map was released on 05/15/2020 to make a correction. This version replaces any previous versions. See the Notice to User Letter that accompanied this correction for details.

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.



MAP NUMBER
08041C0752G

MAP REVISED
DECEMBER 7, 2018

Federal Emergency Management Agency

ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Kiowa Engineering Corporation, 1604 South 21st Street, Colorado Springs, Colorado 80904



Signature (Affix Seal):

Todd Cartwright, P.E. No. 33365

Date

CITY PROJECT MANAGER'S STATEMENT:

I hereby certify that the drainage for Rock Island Trail shall be constructed according to the design presented in this report. I further understand that field changes must be reviewed by the City Review Engineer to ensure conformance with the original design intent. I am employed by and perform engineering services solely for the City of Colorado Springs, and therefore am exempt from Colorado Revised Statute Title 12, Article 25, Part 1 according to § 12-25-103(1), C.R.S.

Name of City Project Manager: Emily Duncan

Signature: 

Date: 11/15/24

EL PASO COUNTY STATEMENT:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 & 2, El Paso County Engineering Criteria Manual, and Land Development Code, as amended.

Joshua Palmer, P.E.
El Paso County Engineer/ECM Administrator

Date

Conditions:

APPENDIX B
Rational and Hydraulic Calculations

Rock Island Trail
Final Drainage Report
Area Runoff Coefficient Summary - EXISTING

			<i>DEVELOPED</i>			<i>UNDEVELOPED</i>			<i>WEIGHTED</i>	
<i>BASIN</i>	<i>TOTAL AREA</i>		<i>AREA</i>	<i>C₅</i>	<i>C₁₀₀</i>	<i>AREA</i>	<i>C₅</i>	<i>C₁₀₀</i>	<i>C₅</i>	<i>C₁₀₀</i>
	<i>(SF)</i>	<i>(Acres)</i>	<i>(Acres)</i>			<i>(Acres)</i>				
E-1	38,091	0.87		0.53	0.68	0.87	0.09	0.36	0.09	0.36
E-2	348,229	7.99		0.53	0.68	7.99	0.09	0.36	0.09	0.36
E-3	463,313	10.64		0.53	0.68	10.64	0.09	0.36	0.09	0.36
E-4	266,935	6.13		0.53	0.68	6.13	0.09	0.36	0.09	0.36
E-5	422,019	9.69		0.53	0.68	9.69	0.09	0.36	0.09	0.36
E-6	28,408	0.65		0.53	0.68	0.65	0.09	0.36	0.09	0.36
E-7	29,092	0.67		0.53	0.68	0.67	0.09	0.36	0.09	0.36
E-8	7,374	0.17	0.17	0.53	0.68	0.00	0.09	0.36	0.53	0.68
	1,603,461	36.8								

Calculated by: CKC
Date: 5/15/2024
Checked by: TC

Rock Island Trail
Final Drainage Report
Area Runoff Coefficient Summary - PROPOSED

			<i>DEVELOPED</i>			<i>UNDEVELOPED</i>			<i>WEIGHTED</i>	
<i>BASIN</i>	<i>TOTAL AREA</i>		<i>AREA</i>	<i>C₅</i>	<i>C₁₀₀</i>	<i>AREA</i>	<i>C₅</i>	<i>C₁₀₀</i>	<i>C₅</i>	<i>C₁₀₀</i>
	<i>(SF)</i>	<i>(Acres)</i>	<i>(Acres)</i>			<i>(Acres)</i>				
P-1	38,091	0.87		0.53	0.68	0.87	0.09	0.36	0.09	0.36
P-2	348,229	7.99		0.53	0.68	7.99	0.09	0.36	0.09	0.36
P-3	463,313	10.64		0.53	0.68	10.64	0.09	0.36	0.09	0.36
P-4	266,935	6.13		0.53	0.68	6.13	0.09	0.36	0.09	0.36
P-5	422,019	9.69		0.53	0.68	9.69	0.09	0.36	0.09	0.36
P-6	28,408	0.65		0.53	0.68	0.65	0.09	0.36	0.09	0.36
P-7	29,092	0.67		0.53	0.68	0.67	0.09	0.36	0.09	0.36
P-8	7,374	0.17	0.17	0.53	0.68	0.00	0.09	0.36	0.53	0.68

Calculated by: CKC
Date: 5/15/2024
Checked by: TC

Rock Island Trail
Final Drainage Report
Area Drainage Summary - EXISTING

		WEIGHTED		OVERLAND				STREET / CHANNEL FLOW					T_t	CA		INTENSITY		TOTAL FLOW	
BASIN	AREA TOTAL (Acres)	C_5	C_{100}	C_5	Length (ft)	Height (ft)	T_C (min)	Grass/ Paved	Length (ft)	Slope (%)	Velocity (fps)	T_t (min)	TOTAL (min)	CA_5	CA_{100}	I_5 (in/hr)	I_{100} (in/hr)	Q_5 (c.f.s.)	Q_{100} (c.f.s.)
		* For Calcs See Runoff Summary																	
E-1	0.87	0.09	0.36	0.09	90	2.0	13.8	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0	13.8	0.08	0.31	3.6	6.1	0.3	1.9
E-2	7.99	0.09	0.36	0.09	80	10.0	7.3	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0 0.0	7.3	0.72	2.88	4.6	7.7	3.3	22
E-3	10.64	0.09	0.36	0.09	100	30.0	6.1	Grass Grass	60 0	1.0% 1.0%	1.3 1.3	0.8 0.0 0.0	6.9	0.96	3.83	4.7	7.9	4.5	30
E-4	6.13	0.09	0.36	0.09	90	14.0	7.2	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0 0.0	7.2	0.55	2.21	4.6	7.7	2.5	17
E-5	9.69	0.09	0.36	0.09	100	17.0	7.4	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0 0.0	7.4	0.87	3.49	4.6	7.7	4.0	27
E-6	0.65	0.09	0.36	0.09	25	1.0	6.0	Grass Grass	430 0	2.0% 1.0%	1.3 1.3	5.4 0.0 0.0	11.4	0.06	0.23	3.9	6.6	0.2	1.6
E-7	0.67	0.09	0.36	0.09	25	1.0	6.0	Grass Grass	25 0	2.0% 1.0%	1.3 1.3	0.3 0.0 0.0	6.3	0.06	0.24	4.8	8.1	0.3	1.9
E-8	0.17	0.53	0.68	0.09	25	1.0	6.0	Grass Grass	50 0	2.0% 1.0%	1.3 1.3	0.6 0.0 0.0	6.6	0.09	0.12	4.8	8.0	0.4	0.9

Calculated by: CKC
Date: 5/15/2024
Checked by: TC

Rock Island Trail
Final Drainage Report
Area Drainage Summary - PROPOSED

		WEIGHTED		OVERLAND				STREET / CHANNEL FLOW					T_t	CA		INTENSITY		TOTAL FLOW	
BASIN	AREA TOTAL (Acres)	C_5	C_{100}	C_5	Length (ft)	Height (ft)	T_c (min)	Grass/ Paved	Length (ft)	Slope (%)	Velocity (fps)	T_t (min)	TOTAL (min)	CA_5	CA_{100}	I_5 (in/hr)	I_{100} (in/hr)	Q_5 (c.f.s.)	Q_{100} (c.f.s.)
		* For Cals See Runoff Summary																	
P-1	0.87	0.09	0.36	0.09	90	2.0	13.8	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0	13.8	0.08	0.31	3.6	6.1	0.3	1.9
P-2	7.99	0.09	0.36	0.09	80	10.0	7.3	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0 0.0	7.3	0.72	2.88	4.6	7.7	3.3	22
P-3	10.64	0.09	0.36	0.09	100	30.0	6.1	Grass Grass	60 0	1.0% 1.0%	1.3 1.3	0.8 0.0 0.0	6.9	0.96	3.83	4.7	7.9	4.5	30
P-4	6.13	0.09	0.36	0.09	90	14.0	7.2	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0 0.0	7.2	0.55	2.21	4.6	7.7	2.5	17
P-5	9.69	0.09	0.36	0.09	100	17.0	7.4	Grass Grass	0 0	1.0% 1.0%	1.3 1.3	0.0 0.0 0.0	7.4	0.87	3.49	4.6	7.7	4.0	27
P-6	0.65	0.09	0.36	0.09	25	1.0	6.0	Grass Grass	430 0	2.0% 1.0%	1.3 1.3	5.4 0.0 0.0	11.4	0.06	0.23	3.9	6.6	0.2	1.6
P-7	0.67	0.09	0.36	0.09	25	1.0	6.0	Grass Grass	25 0	2.0% 1.0%	1.3 1.3	0.3 0.0 0.0	6.3	0.06	0.24	4.8	8.1	0.3	1.9
P-8	0.17	0.53	0.68	0.09	25	1.0	6.0	Grass Grass	50 0	2.0% 1.0%	1.3 1.3	0.6 0.0 0.0	6.6	0.09	0.12	4.8	8.0	0.4	0.9

Calculated by: CKC
Date: 5/15/2024
Checked by: TC

**Rock Island Trail
Final Drainage Report
Surface Routing Summary**

Design Points	Contributing Basins & Design Points	Equivalent CA_3	Equivalent CA_{100}	Maximum T_c	STREET / CHANNEL FLOW				T_t	INTENSITY		FLOW	
					Length (ft)	Slope (%)	Velocity (fps)	T_t (min)	TOTAL (min)	I_3	I_{100}	Q_3	Q_{100}
E5	E6 E5	0.06	0.23	11.4	200	2.0%	2.8	1.2					
		0.87	3.49	7.4					7.4				
		0.93	3.72						7.4	4.5	8.0	4.2	30
P5	P6 P5	0.06	0.23	11.4	200	2.0%	2.8	1.2					
		0.9	3.5	7.4					7.4				
		0.93	3.72						7.4	4.5	8.0	4.2	30

Calculated by: CKC
Date: 5/15/2024
Checked by: TC

Rock Island Trail
Final Drainage Report
Pipe Hydraulics

<i>PIPE SEGMENT</i>	<i>Q_{max} (cfs)</i>	<i>Surf Grade (%)</i>	<i>LEN (ft)</i>	<i>$K_{(q,s)}$</i>	<i>DIA (in)</i>	<i>DIA USED (in)</i>	<i>K_{dia}</i>	<i>A (ft²)</i>	<i>V (fps)</i>	<i>S_f (%)</i>
<i>P-6</i>	1.6	1.50%	40	12.7	6	18	105.1	1.8	5.0	

Calculated by: _____

Date: _____

Checked by: _____

Rock Island Trail
Final Drainage Report
Rip Rap Sizing

Station	Description	Riprap or Boulder	Straight or Curved Section	Flow Velocity	Channel Slope	For Curved Sections			Velocity	Super-elevation dY	Rock Sizing Parameter	Calculated Riprap Type	Calculated Boulder Size
						rc	T	V _a					
95+40	Outlet Protection	Riprap	Straight	0.9ft/sec	1.25%				0.9ft/sec		0.3 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0	VL --- --- --- --- --- --- --- --- --- ---	6 in
								#DIV/0!	0.0ft/sec		0.0	---	#VALUE!

Riprap or Boulder Classification	Note
L	

Equations:

Rock Sizing Parameter = $V S^{0.17} / (G_s - 1)^{0.66}$

V = Mean channel flow velocity for Riprap Sizing

V = Critical Velocity for Grouted Boulder Sizing

S = Longitudinal channel slope

G_s = Specific Gravity of stone (minimum G_s = 2.50)

G_s = 2.55 (UDFCD Recommended) (2'x3' is about 1 ton, able to be moved by skid steer)

G_s = 2.55

Riprap

Boulder

Curved

Riprap

Rock Sizing Parameter		Riprap Type	D50	
0.00	3.29	VL	6 inches	VL
3.30	3.99	L	9 inches	L
4.00	4.59	M	12 inches	M
4.60	5.59	H	18 inches	H
5.60	6.40	VH	24 inches	VH

Equations taken from UDFCD USDCM (Eqn MD-13 & HS-9) and City of Colorado Springs & El Paso County Drainage Criteria Manual

V_a = (-0.147 r_c/T + 2.176)V (Eqn UDFCD MD-10)

V_a = Adjusted channel velocity for riprap sizing along outside of channel bends

r_c = channel centerline radius

T = Top width of water during the major design flood

Superelevation (dY) = V²T/2gr_c (Eqn UDFCD MD-9)

V = Mean channel flow velocity

T = Top Width of the channel under design flow conditions

g = Gravitational constant = 32.2 ft/sec²

r_c = channel centerline radius

Rock Sizing Parameter		Grouted Boulder Classification	Grouted Boulder Min. Dimension	
0.00	4.49	B18	18 inches	
4.50	4.99	B18	18 inches	B18
5.00	5.59	B24	24 inches	B24
5.60	6.39	B30	30 inches	B30
6.40	6.99	B36	36 inches	B36
7.00	7.49	B42	42 inches	B42
7.50	8.00	B48	48 inches	B48

Calculated by: _____

Date: _____

Checked by: _____

- Notes:
1. Type M Riprap is minimum size recommended for areas immediately upstream of drop structures (water surface drawdown area).
 2. Type M Riprap is minimum size recommended for areas immediately downstream of drop structures (hydraulic jump area).
 3. Type L Riprap is minimum size recommended for bank lining/toe protection.

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.

For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_r) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_r) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

Program: UDSEWER Math Model Interface 2.1.1.4 Run Date: 3/12/2025 11:46:28 AM	UDSewer Results Summary Project Title: 16028 - Rock Island Culvert Project Description: Default system
---	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 5
Rainfall Calculation Method: Formula

One Hour Depth (in): 4.00
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 500
Maximum Urban Overland Len. (ft): 300
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 18.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 2.0

Backwater Calculations:

Tailwater Elevation (ft): 54.50

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
outfall	54.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SD1	57.50	0.20	0.00	0.65	0.09	0.09	450.00	2.00	0.00	1.30

Manhole Output Summary:

	Local Contribution					Total Design Flow				
Element Name	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	Comment
outfall	0.00	0.00	0.00	0.00	0.00	0.06	3.42	76.64	0.20	Surface Water Present (Upstream)
SD1	30.77	0.00	30.77	6.18	0.36	0.06	3.42	76.64	0.20	Surface Water Present (Downstream)

Sewer Input Summary:

		Elevation			Loss Coefficients			Given Dimensions		
Element Name	Sewer Length (ft)	Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
SD1	40.00	53.98	1.3	54.50	0.014	0.03	0.00	CIRCULAR	18.00 in	18.00 in

Sewer Flow Summary:

	Full Flow Capacity		Critical Flow		Normal Flow						
Element Name	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition	Flow (cfs)	Surcharged Length (ft)	Comment
SD1	11.15	6.31	1.97	1.90	1.67	2.42	1.38	Supercritical	0.20	0.00	

- A Froude number of 0 indicates that pressurized flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

			Existing		Calculated		Used			
Element Name	Peak Flow (cfs)	Cross Section	Rise	Span	Rise	Span	Rise	Span	Area (ft^2)	Comment
SD1	0.20	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 54.50

	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
Element Name	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
SD1	53.98	54.50	0.00	0.00	54.50	54.66	54.50	0.22	54.72

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * $V_{fi}^2 / (2 * g)$
- Lateral loss = $V_{fo}^2 / (2 * g)$ - Junction Loss K * $V_{fi}^2 / (2 * g)$.
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft

The minimum trench width is 2.00 ft

					Downstream			Upstream				
Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Volume (cu. yd)	Comment
SD1	40.00	2.50	4.00	4.92	0.00	0.56	0.00	5.50	3.54	1.29	15.01	Sewer Too Shallow

Total earth volume for sewer trenches = 15 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.
- The sewer wall thickness is equal to: (equivalent diameter in inches/12)+1 inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.

Program: UDSEWER Math Model Interface 2.1.1.4 Run Date: 3/12/2025 11:47:12 AM	UDSewer Results Summary Project Title: 16028 - Rock Island Culvert Project Description: Default system
---	---

System Input Summary

Rainfall Parameters

Rainfall Return Period: 100
Rainfall Calculation Method: Formula

One Hour Depth (in): 4.00
Rainfall Constant "A": 28.5
Rainfall Constant "B": 10
Rainfall Constant "C": 0.786

Rational Method Constraints

Minimum Urban Runoff Coeff.: 0.20
Maximum Rural Overland Len. (ft): 500
Maximum Urban Overland Len. (ft): 300
Used UDFCD Tc. Maximum: Yes

Sizer Constraints

Minimum Sewer Size (in): 18.00
Maximum Depth to Rise Ratio: 0.90
Maximum Flow Velocity (fps): 18.0
Minimum Flow Velocity (fps): 2.0

Backwater Calculations:

Tailwater Elevation (ft): 54.50

Manhole Input Summary:

		Given Flow		Sub Basin Information						
Element Name	Ground Elevation (ft)	Total Known Flow (cfs)	Local Contribution (cfs)	Drainage Area (Ac.)	Runoff Coefficient	5yr Coefficient	Overland Length (ft)	Overland Slope (%)	Gutter Length (ft)	Gutter Velocity (fps)
outfall	54.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
SD1	57.50	0.00	0.00	0.65	0.09	0.36	450.00	2.00	0.00	1.30

Manhole Output Summary:

Local Contribution						Total Design Flow				
Element Name	Overland Time (min)	Gutter Time (min)	Basin Tc (min)	Intensity (in/hr)	Local Contrib (cfs)	Coeff. Area	Intensity (in/hr)	Manhole Tc (min)	Peak Flow (cfs)	Comment
outfall	0.00	0.00	0.00	0.00	0.00	0.06	10.16	11.67	0.59	Surface Water Present (Upstream)
SD1	18.41	0.00	11.67	10.16	0.59	0.06	10.16	11.67	0.59	Surface Water Present (Downstream) Used UDFCD Tc Maximum

Sewer Input Summary:

		Elevation			Loss Coefficients			Given Dimensions		
Element Name	Sewer Length (ft)	Downstream Invert (ft)	Slope (%)	Upstream Invert (ft)	Mannings n	Bend Loss	Lateral Loss	Cross Section	Rise (ft or in)	Span (ft or in)
SD1	40.00	53.98	1.3	54.50	0.014	0.03	0.00	CIRCULAR	18.00 in	18.00 in

Sewer Flow Summary:

Full Flow Capacity		Critical Flow		Normal Flow							
Element Name	Flow (cfs)	Velocity (fps)	Depth (in)	Velocity (fps)	Depth (in)	Velocity (fps)	Froude Number	Flow Condition	Flow (cfs)	Surcharged Length (ft)	Comment
SD1	11.15	6.31	3.43	2.53	2.82	3.35	1.47	Supercritical	0.59	0.00	

- A Froude number of 0 indicates that pressurized flow occurs (adverse slope or undersized pipe).
- If the sewer is not pressurized, full flow represents the maximum gravity flow in the sewer.
- If the sewer is pressurized, full flow represents the pressurized flow conditions.

Sewer Sizing Summary:

			Existing		Calculated		Used			
Element Name	Peak Flow (cfs)	Cross Section	Rise	Span	Rise	Span	Rise	Span	Area (ft^2)	Comment
SD1	0.59	CIRCULAR	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	18.00 in	1.77	

- Calculated diameter was determined by sewer hydraulic capacity rounded up to the nearest commercially available size.
- Sewer sizes should not decrease downstream.
- All hydraulics were calculated using the 'Used' parameters.

Grade Line Summary:

Tailwater Elevation (ft): 54.50

	Invert Elev.		Downstream Manhole Losses		HGL		EGL		
Element Name	Downstream (ft)	Upstream (ft)	Bend Loss (ft)	Lateral Loss (ft)	Downstream (ft)	Upstream (ft)	Downstream (ft)	Friction Loss (ft)	Upstream (ft)
SD1	53.98	54.50	0.00	0.00	54.50	54.79	54.52	0.37	54.89

- Bend and Lateral losses only apply when there is an outgoing sewer. The system outfall, sewer #0, is not considered a sewer.
- Bend loss = Bend K * $V_{fi}^2 / (2 * g)$
- Lateral loss = $V_{fo}^2 / (2 * g)$ - Junction Loss K * $V_{fi}^2 / (2 * g)$.
- Friction loss is always Upstream EGL - Downstream EGL.

Excavation Estimate:

The trench side slope is 1.0 ft/ft


The minimum trench width is 2.00 ft

					Downstream			Upstream				
Element Name	Length (ft)	Wall (in)	Bedding (in)	Bottom Width (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Top Width (ft)	Trench Depth (ft)	Cover (ft)	Volume (cu. yd)	Comment
SD1	40.00	2.50	4.00	4.92	0.00	0.56	0.00	5.50	3.54	1.29	15.01	Sewer Too Shallow


Total earth volume for sewer trenches = 15 cubic yards.

- The trench was estimated to have a bottom width equal to the outer pipe diameter plus 36 inches.
- If the calculated width of the trench bottom is less than the minimum acceptable width, the minimum acceptable width was used.
- The sewer wall thickness is equal to: (equivalent diameter in inches/12)+1 inches
- The sewer bedding thickness is equal to:
 - Four inches for pipes less than 33 inches.
 - Six inches for pipes less than 60 inches.
 - Eight inches for all larger sizes.

5 year

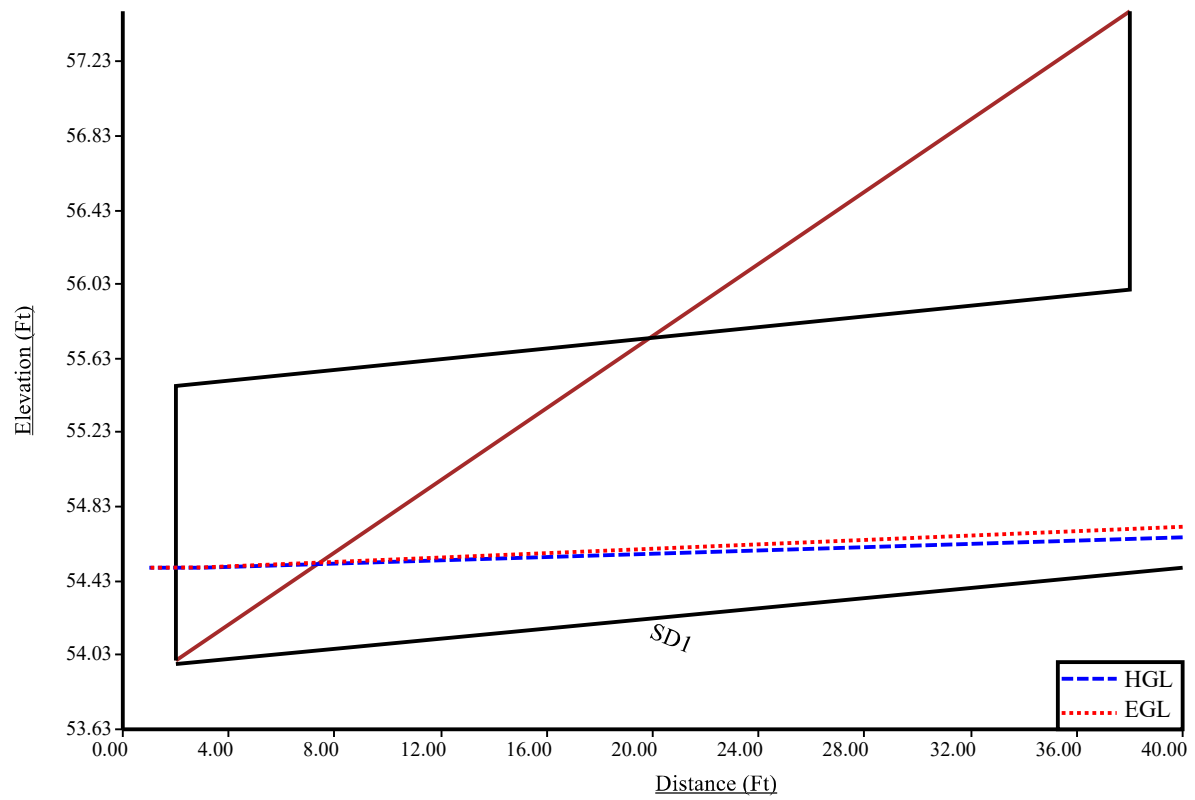

100 Year

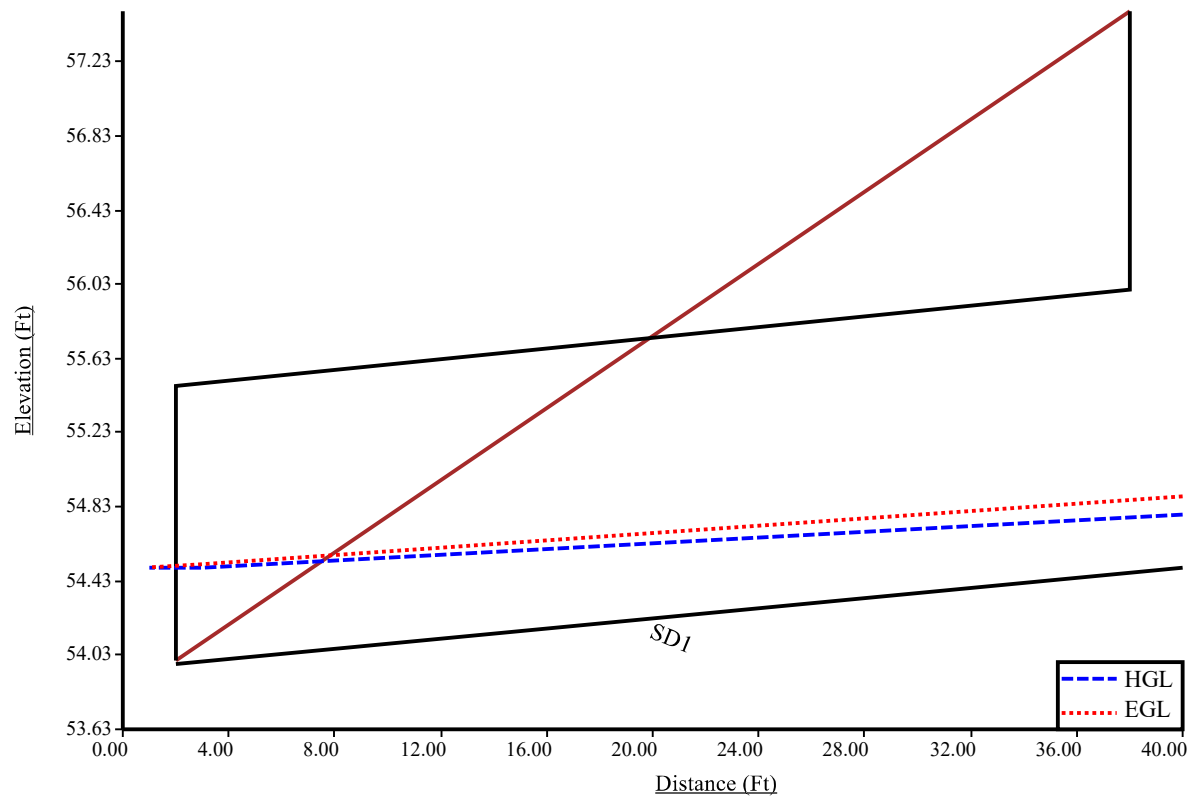

APPENDIX C
Runoff Reduction

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Todd Cartwright PE
 Company: Kiowa Engineering Inc.
 Date: August 15, 2024
 Project: 16028 Rock Island Trail
 Location: Basins 1 & 2

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth 0.60 inches
 Depth of Average Runoff Producing Storm, d_6 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	UIA:RPA		UIA:RPA	SPA	UIA:RPA	SPA	UIA:RPA	SPA	UIA:RPA			
Area ID	P1-UIA1		P2-UIA1	P2-SPA2	P2-UIA3	P2-SPA4	P2-UIA5	P2-SPA6	P2-UIA7			
Downstream Design Point ID	P1		P2	P2	P2	P2	P2	P2	P2			
Downstream BMP Type	None		None	None	None	None	None	None	None			
DCIA (ft ²)	--		--	--	--	--	--	--	--			
UIA (ft ²)	9,029		9,160	--	1,178	--	6,406	--	393			
RPA (ft ²)	29,062		30,859	--	12,961	--	19,857	--	5,267			
SPA (ft ²)	--		--	18,953	--	17,914	--	225,261	--			
HSG A (%)	100%		100%	100%	100%	100%	100%	100%	100%			
HSG B (%)	0%		0%	0%	0%	0%	0%	0%	0%			
HSG C/D (%)	0%		0%	0%	0%	0%	0%	0%	0%			
Average Slope of RPA (ft/ft)	0.050		0.050	--	0.050	--	0.050	--	0.050			
UIA:RPA Interface Width (ft)	1500.00		1500.00	--	600.00	--	550.00	--	50.00			

CALCULATED RUNOFF RESULTS

Area ID	P1-UIA1		P2-UIA1	P2-SPA2	P2-UIA3	P2-SPA4	P2-UIA5	P2-SPA6	P2-UIA7			
UIA:RPA Area (ft ²)	38,091		40,019	--	14,139	--	26,263	--	5,660			
L / W Ratio	0.06		0.06	--	0.06	--	0.09	--	2.26			
UIA / Area	0.2370		0.2289	--	0.0833	--	0.2439	--	0.0694			
Runoff (in)	0.00		0.00	0.00	0.00	0.00	0.00	0.00	0.00			
Runoff (ft ³)	0		0	0	0	0	0	0	0			
Runoff Reduction (ft ³)	376		382	948	49	896	267	11263	16			

CALCULATED WQCV RESULTS

Area ID	P1-UIA1		P2-UIA1	P2-SPA2	P2-UIA3	P2-SPA4	P2-UIA5	P2-SPA6	P2-UIA7			
WQCV (ft ³)	376		382	0	49	0	267	0	16			
WQCV Reduction (ft ³)	376		382	0	49	0	267	0	16			
WQCV Reduction (%)	100%		100%	0%	100%	0%	100%	0%	100%			
Untreated WQCV (ft ³)	0		0	0	0	0	0	0	0			

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	P1	P2										
DCIA (ft ²)	0	0										
UIA (ft ²)	9,029	17,137										
RPA (ft ²)	29,062	68,944										
SPA (ft ²)	0	262,128										
Total Area (ft ²)	38,091	348,209										
Total Impervious Area (ft ²)	9,029	17,137										
WQCV (ft ³)	376	714										
WQCV Reduction (ft ³)	376	714										
WQCV Reduction (%)	100%	100%										
Untreated WQCV (ft ³)	0	0										

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	386,300
Total Impervious Area (ft ²)	26,166
WQCV (ft ³)	1,090
WQCV Reduction (ft ³)	1,090
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Todd Cartwright PE
Company: Kiowa Engineering Inc.
Date: August 15, 2024
Project: 16028 Rock Island Trail
Location: Basins 3

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth = 0.60 inches
 Depth of Average Runoff Producing Storm, d_6 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	SPA	UIA:RPA	UIA:RPA	SPA	SPA	UIA:RPA	UIA:RPA	UIA:RPA	UIA:RPA			
Area ID	P3-UIA1	P3-SPA2	P3-UIA3	P3-SPA4	P3-SPA5	P3-UIA6A	P3-UIA6B	P3-UIA6C	P3-UIA7			
Downstream Design Point ID	P3	P3	P3	P3	P3	P3	P3	P3	P3			
Downstream BMP Type	None	None	None	None	None	None	None	None	None			
DCIA (ft ²)	--	--	--	--	--	--	--	--	--			
UIA (ft ²)	--	6,795	1,168	--	--	11,849	11,849	11,849	294			
RPA (ft ²)	--	31,927	5,080	--	--	55,759	55,759	55,759	5,079			
SPA (ft ²)	22,952	--	--	16,089	171,042	--	--	--	--			
HSG A (%)	100%	100%	100%	100%	100%	100%	100%	100%	100%			
HSG B (%)	0%	0%	0%	0%	0%	0%	0%	0%	0%			
HSG C/D (%)	0%	0%	0%	0%	0%	0%	0%	0%	0%			
Average Slope of RPA (ft/ft)	--	0.050	0.050	--	--	0.050	0.050	0.050	0.050			
UIA:RPA Interface Width (ft)	--	800.00	200.00	--	--	1000.00	1000.00	1000.00	50.00			

CALCULATED RUNOFF RESULTS

Area ID	P3-UIA1	P3-SPA2	P3-UIA3	P3-SPA4	P3-SPA5	P3-UIA6A	P3-UIA6B	P3-UIA6C	P3-UIA7			
UIA:RPA Area (ft ²)	--	38,722	6,248	--	--	67,608	67,608	67,608	5,373			
L / W Ratio	--	0.06	0.16	--	--	0.07	0.07	0.07	2.15			
UIA / Area	--	0.1755	0.1869	--	--	0.1753	0.1753	0.1753	0.0547			
Runoff (in)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00			
Runoff (ft ³)	0	0	0	0	0	0	0	0	0			
Runoff Reduction (ft ³)	1148	283	49	804	8552	494	494	494	12			

CALCULATED WQCV RESULTS

Area ID	P3-UIA1	P3-SPA2	P3-UIA3	P3-SPA4	P3-SPA5	P3-UIA6A	P3-UIA6B	P3-UIA6C	P3-UIA7			
WQCV (ft ³)	0	283	49	0	0	494	494	494	12			
WQCV Reduction (ft ³)	0	283	49	0	0	494	494	494	12			
WQCV Reduction (%)	0%	100%	100%	0%	0%	100%	100%	100%	100%			
Untreated WQCV (ft ³)	0	0	0	0	0	0	0	0	0			

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	P3											
DCIA (ft ²)	0											
UIA (ft ²)	43,804											
RPA (ft ²)	209,363											
SPA (ft ²)	210,083											
Total Area (ft ²)	463,250											
Total Impervious Area (ft ²)	43,804											
WQCV (ft ³)	1,825											
WQCV Reduction (ft ³)	1,825											
WQCV Reduction (%)	100%											
Untreated WQCV (ft ³)	0											

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	463,250
Total Impervious Area (ft ²)	43,804
WQCV (ft ³)	1,825
WQCV Reduction (ft ³)	1,825
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Todd Cartwright PE
Company: Kiowa Engineering Inc.
Date: August 15, 2024
Project: 16028 Rock Island Trail
Location: Basins 4

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth = 0.60 inches
 Depth of Average Runoff Producing Storm, d_6 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	UIA:RPA	SPA	SPA	UIA:RPA	SPA							
Area ID	P4-UIA1	P4-SPA2	P4-SPA3	P4-UIA4	P4-SPA5							
Downstream Design Point ID	P4	P4	P4	P4	P4							
Downstream BMP Type	None	None	None	None	None							
DCIA (ft ²)	--	--	--	--	--							
UIA (ft ²)	702	--	--	12,561	--							
RPA (ft ²)	12,065	--	--	42,611	--							
SPA (ft ²)	--	34,092	44,522	--	120,382							
HSG A (%)	100%	100%	100%	100%	100%							
HSG B (%)	0%	0%	0%	0%	0%							
HSG C/D (%)	0%	0%	0%	0%	0%							
Average Slope of RPA (ft/ft)	0.050	--	--	0.050	--							
UIA:RPA Interface Width (ft)	160.00	--	--	1050.00	--							

CALCULATED RUNOFF RESULTS

Area ID	P4-UIA1	P4-SPA2	P4-SPA3	P4-UIA4	P4-SPA5							
UIA:RPA Area (ft ²)	12,767	--	--	55,172	--							
L / W Ratio	0.50	--	--	0.06	--							
UIA / Area	0.0550	--	--	0.2277	--							
Runoff (in)	0.00	0.00	0.00	0.00	0.00							
Runoff (ft ³)	0	0	0	0	0							
Runoff Reduction (ft ³)	29	1705	2226	523	6019							

CALCULATED WQCV RESULTS

Area ID	P4-UIA1	P4-SPA2	P4-SPA3	P4-UIA4	P4-SPA5							
WQCV (ft ³)	29	0	0	523	0							
WQCV Reduction (ft ³)	29	0	0	523	0							
WQCV Reduction (%)	100%	0%	0%	100%	0%							
Untreated WQCV (ft ³)	0	0	0	0	0							

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	P4											
DCIA (ft ²)	0											
UIA (ft ²)	13,263											
RPA (ft ²)	54,676											
SPA (ft ²)	198,996											
Total Area (ft ²)	266,935											
Total Impervious Area (ft ²)	13,263											
WQCV (ft ³)	553											
WQCV Reduction (ft ³)	553											
WQCV Reduction (%)	100%											
Untreated WQCV (ft ³)	0											

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	266,935
Total Impervious Area (ft ²)	13,263
WQCV (ft ³)	553
WQCV Reduction (ft ³)	553
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Todd Cartwright PE
Company: Kiowa Engineering Inc.
Date: August 15, 2024
Project: 16028 Rock Island Trail
Location: Basins 5

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth = 0.60 inches
 Depth of Average Runoff Producing Storm, d_6 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	UIA:RPA	SPA	UIA:RPA	SPA	UIA:RPA	SPA	UIA:RPA	UIA:RPA				
Area ID	P5-UIA1	P5-SPA2	P5-UIA3	P5-SPA4	P5-UIA5	PR-SPA6	PB-UIA7A	P5-UIA7B				
Downstream Design Point ID	P5	P5	P5	P5	P5	P5	P5	P5				
Downstream BMP Type	None	None	None	None	None	None	None	None				
DCIA (ft ²)	--	--	--	--	--	--	--	--				
UIA (ft ²)	694	--	4,787	--	2,890	--	10,125	10,126				
RPA (ft ²)	10,765	--	29,493	--	22,377	--	42,331	42,332				
SPA (ft ²)	--	7,202	--	110,011	--	128,886	--	--				
HSG A (%)	100%	100%	100%	100%	100%	100%	100%	100%				
HSG B (%)	0%	0%	0%	0%	0%	0%	0%	0%				
HSG C/D (%)	0%	0%	0%	0%	0%	0%	0%	0%				
Average Slope of RPA (ft/ft)	0.050	--	0.050	--	0.050	--	0.050	0.050				
UIA:RPA Interface Width (ft)	100.00	--	1050.00	--	450.00	--	825.00	825.00				

CALCULATED RUNOFF RESULTS

Area ID	P5-UIA1	P5-SPA2	P5-UIA3	P5-SPA4	P5-UIA5	PR-SPA6	PB-UIA7A	P5-UIA7B				
UIA:RPA Area (ft ²)	11,459	--	34,280	--	25,267	--	52,456	52,458				
L / W Ratio	1.15	--	0.06	--	0.12	--	0.08	0.08				
UIA / Area	0.0606	--	0.1396	--	0.1144	--	0.1930	0.1930				
Runoff (in)	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00				
Runoff (ft ³)	0	0	0	0	0	0	0	0				
Runoff Reduction (ft ³)	29	360	199	5501	120	6444	422	422				

CALCULATED WQCV RESULTS

Area ID	P5-UIA1	P5-SPA2	P5-UIA3	P5-SPA4	P5-UIA5	PR-SPA6	PB-UIA7A	P5-UIA7B				
WQCV (ft ³)	29	0	199	0	120	0	422	422				
WQCV Reduction (ft ³)	29	0	199	0	120	0	422	422				
WQCV Reduction (%)	100%	0%	100%	0%	100%	0%	100%	100%				
Untreated WQCV (ft ³)	0	0	0	0	0	0	0	0				

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	P5											
DCIA (ft ²)	0											
UIA (ft ²)	28,622											
RPA (ft ²)	147,298											
SPA (ft ²)	246,099											
Total Area (ft ²)	422,019											
Total Impervious Area (ft ²)	28,622											
WQCV (ft ³)	1,193											
WQCV Reduction (ft ³)	1,193											
WQCV Reduction (%)	100%											
Untreated WQCV (ft ³)	0											

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	422,019
Total Impervious Area (ft ²)	28,622
WQCV (ft ³)	1,193
WQCV Reduction (ft ³)	1,193
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

Design Procedure Form: Runoff Reduction

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Todd Cartwright PE
Company: Kiowa Engineering Inc.
Date: August 15, 2024
Project: 16028 Rock Island Trail
Location: Basins 6 - 8

SITE INFORMATION (User Input in Blue Cells)

WQCV Rainfall Depth = 0.60 inches
 Depth of Average Runoff Producing Storm, d_6 = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

Area Type	UIA:RPA		UIA:RPA	SPA		UIA:RPA						
Area ID	P6-UIA1		P7-UIA1	P7-SPA2		P8-UIA1						
Downstream Design Point ID	P6		P7	P7		P8						
Downstream BMP Type	None		None	None		None						
DCIA (ft ²)	--		--	--		--						
UIA (ft ²)	2,648		5,583	--		4,400						
RPA (ft ²)	25,760		14,316	--		2,974						
SPA (ft ²)	--		--	9,193		--						
HSG A (%)	100%		100%	100%		100%						
HSG B (%)	0%		0%	0%		0%						
HSG C/D (%)	0%		0%	0%		0%						
Average Slope of RPA (ft/ft)	0.050		0.050	--		0.050						
UIA:RPA Interface Width (ft)	450.00		450.00	--		400.00						

CALCULATED RUNOFF RESULTS

Area ID	P6-UIA1		P7-UIA1	P7-SPA2		P8-UIA1						
UIA:RPA Area (ft ²)	28,408		19,899	--		7,374						
L / W Ratio	0.14		0.10	--		0.06						
UIA / Area	0.0932		0.2806	--		0.5967						
Runoff (in)	0.00		0.00	0.00		0.00						
Runoff (ft ³)	0		0	0		0						
Runoff Reduction (ft ³)	110		233	460		183						

CALCULATED WQCV RESULTS

Area ID	P6-UIA1		P7-UIA1	P7-SPA2		P8-UIA1						
WQCV (ft ³)	110		233	0		183						
WQCV Reduction (ft ³)	110		233	0		183						
WQCV Reduction (%)	100%		100%	0%		100%						
Untreated WQCV (ft ³)	0		0	0		0						

CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)

Downstream Design Point ID	P6	P7	P8									
DCIA (ft ²)	0	0	0									
UIA (ft ²)	2,648	5,583	4,400									
RPA (ft ²)	25,760	14,316	2,974									
SPA (ft ²)	0	9,193	0									
Total Area (ft ²)	28,408	29,092	7,374									
Total Impervious Area (ft ²)	2,648	5,583	4,400									
WQCV (ft ³)	110	233	183									
WQCV Reduction (ft ³)	110	233	183									
WQCV Reduction (%)	100%	100%	100%									
Untreated WQCV (ft ³)	0	0	0									

CALCULATED SITE RESULTS (sums results from all columns in worksheet)

Total Area (ft ²)	64,874
Total Impervious Area (ft ²)	12,631
WQCV (ft ³)	526
WQCV Reduction (ft ³)	526
WQCV Reduction (%)	100%
Untreated WQCV (ft ³)	0

K:\2016\16028 Rock Island Trail Design\DRAWINGS\Drainage\C-2 16028-Rock Island RR map.dwg Aug 15, 2024 10:41pm



LEGEND

H1

2.67 AC

0.310.50

C5 RUNOFF

C100 RUNOFF

2.2 cfs

4.3 cfs

5-YEAR RUNOFF

100-YEAR RUNOFF

→

DIRECTIONAL FLOW ARROW

PROP DRAINAGE BASIN BOUNDARY

PROP DRAINAGE SUB-BASIN BOUNDARY

△

DESIGN POINT

—

TIME OF CONCENTRATION PATH

10

HYDRAULIC STRUCTURE IDENTIFIER

S10

STORM SEWER IDENTIFIER

—

PROPOSED STORM SEWER PIPE

⊙

PROPOSED STORM SEWER MANHOLE

■

PROPOSED STORM DRAINAGE CURB INLET

(6020)

EXISTING CONTOURS

—6020

PROPOSED CONTOURS

PROPERTY BOUNDARY

LIMIT OF DISTURBANCE

XX-XXXX

SUB-BASIN NUMBER

Runoff Reduction Legend

UIA

UIA (Unconnected Impervious Area)

PIA/RPA

PIA (Planned Infiltration Area)
RPA (Receiving Pervious Area)

SPA

SPA (Separate Pervious Area)

DCIA

DCIA (Directly-Connected Impervious Area)

Runoff Reduction Calculations

Total Site Area (ac)	36.8
Total Tributary Area (ac)	36.8
Total Disturbed Area (ac)	18.2
Total Site Impervious Area (ac)	2.5
Total Site Percent Impervious	6.8%
Upstream Impervious Area (ac)	0.0
Planned Infiltration Area (ac)	0.0
WQCV (cf)	5576
Stormwater Volume Reduction (cf)	5576
Stormwater Volume Reduction as % of WQCV	100%



Celebrating 30 years

KIOWA

Engineering Corporation

1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342

Sheet Revisions

No Revisions:

Revised:

Void:

ROCK ISLAND TRAIL

Sand Creek to Constitution Avenue

RUNOFF REDUCTION MAP

Designer: TAC

Detailer: JDC



Date: 8/15/2024



Kiowa Proj. No. 16028



TAP M240-162

SubAcct No.20391

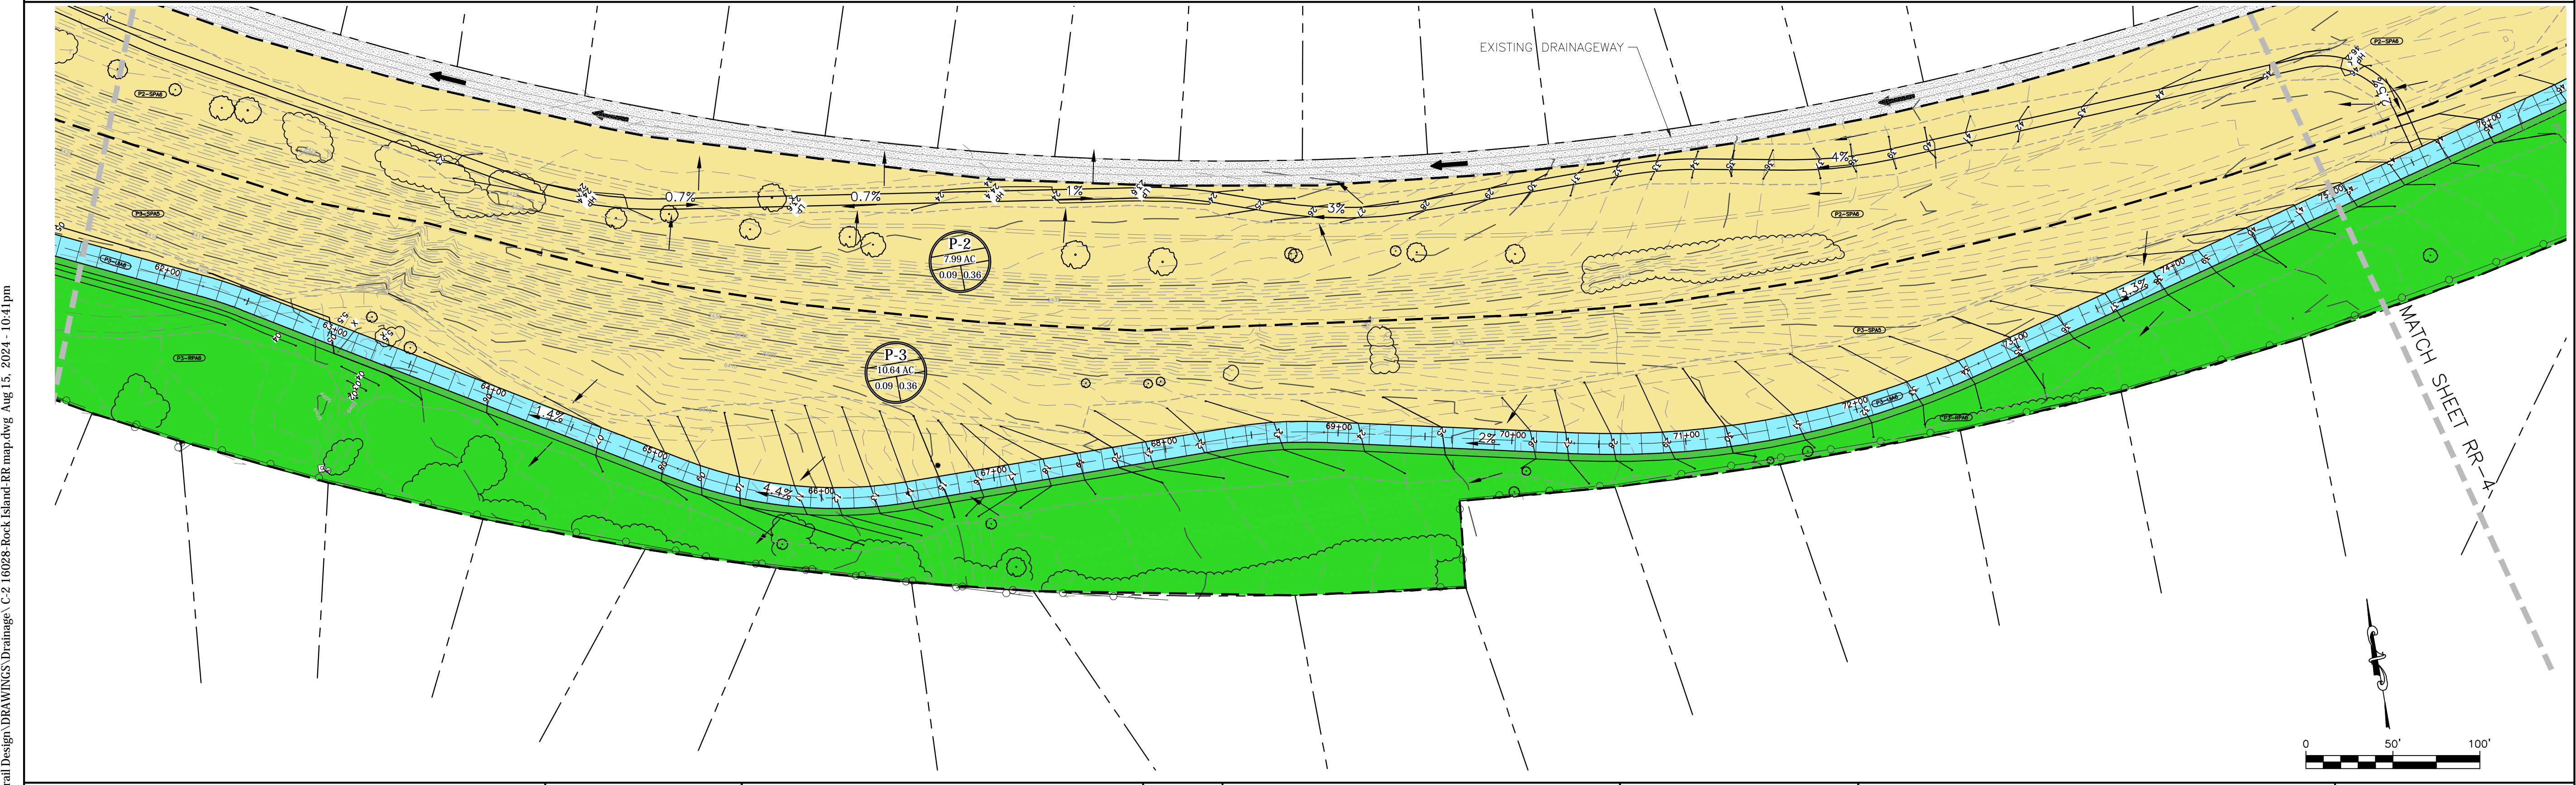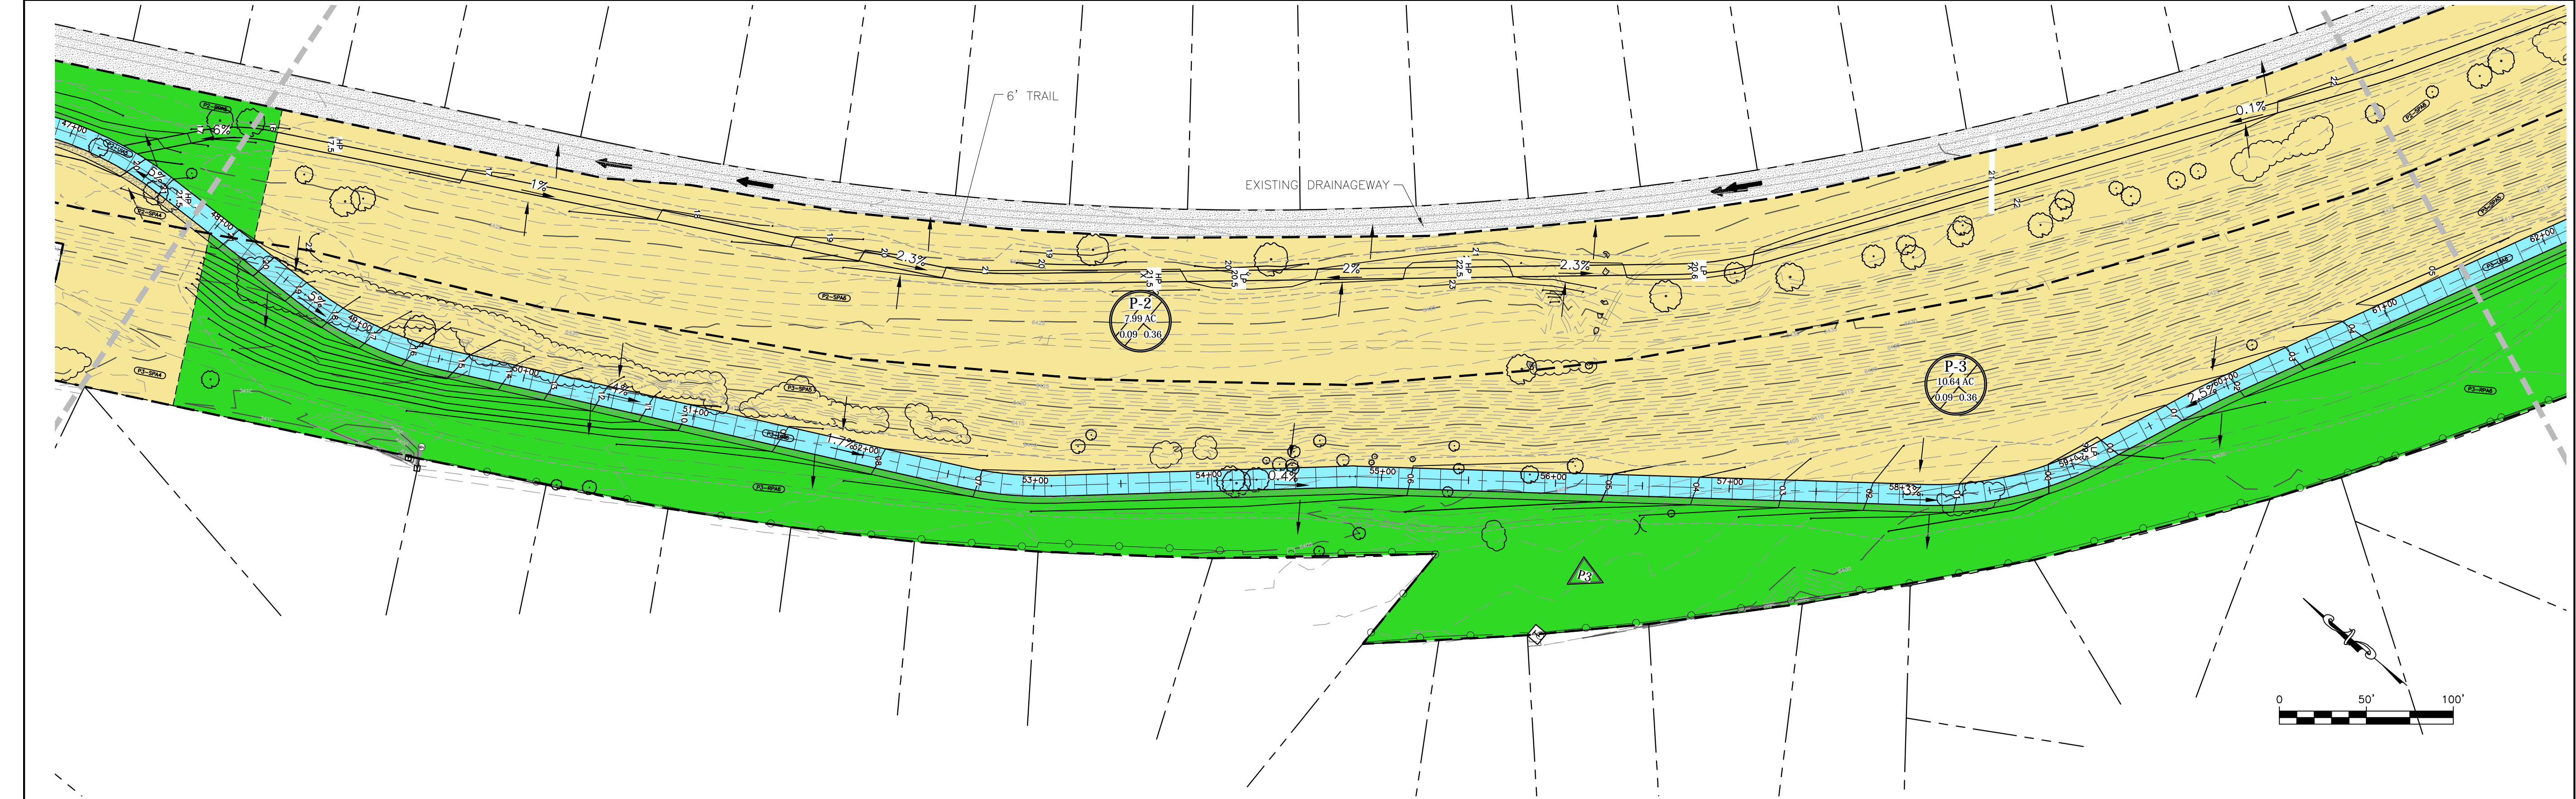
Sheet Number RR-1



	 1604 South 21st Street Colorado Springs, Colorado 80904 (719) 630-7342	<div><div></div><div></div><div></div><div></div><div></div></div>	Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue RUNOFF REDUCTION MAP		Kiowa Proj. No. 16028			
							TAP M240-162			
					No Revisions:				SubAcct No.20391	
					Revised:				Date: 8/15/2024	
					Void:				Sheet Number RR-3	

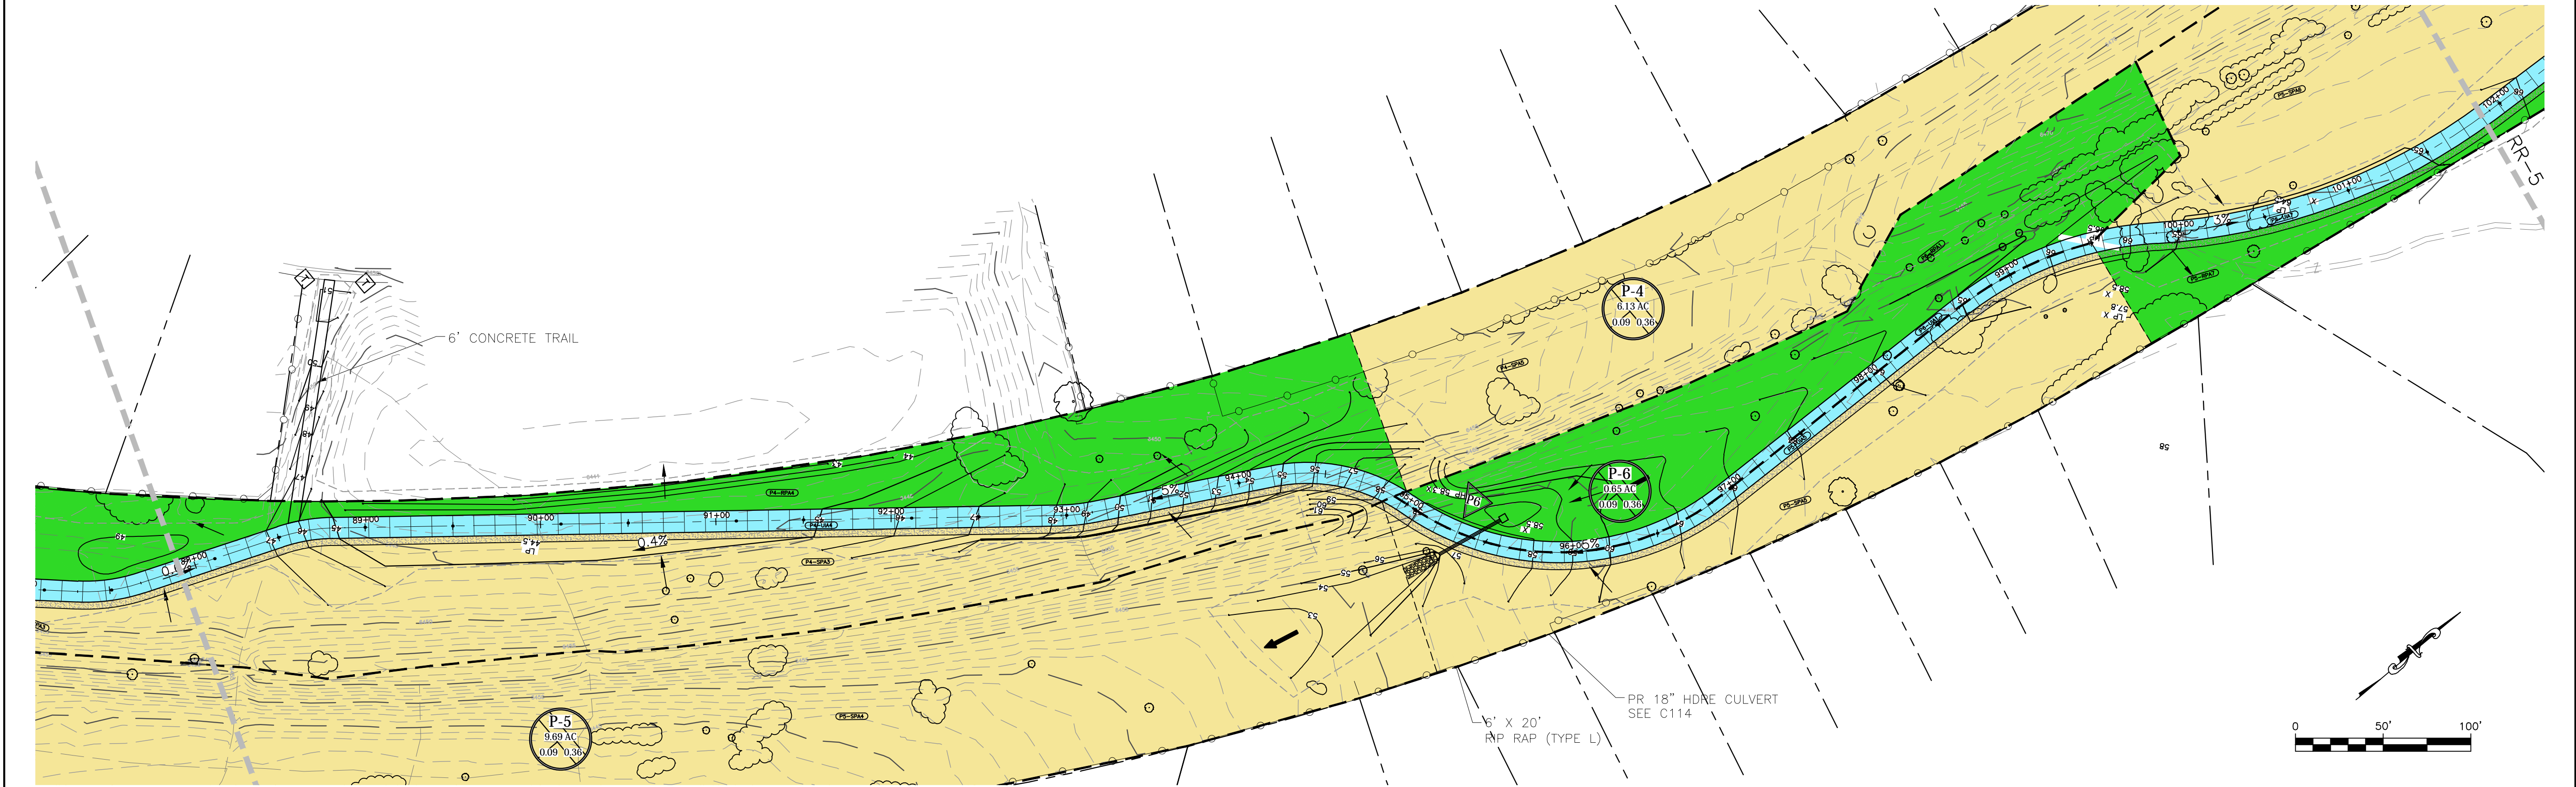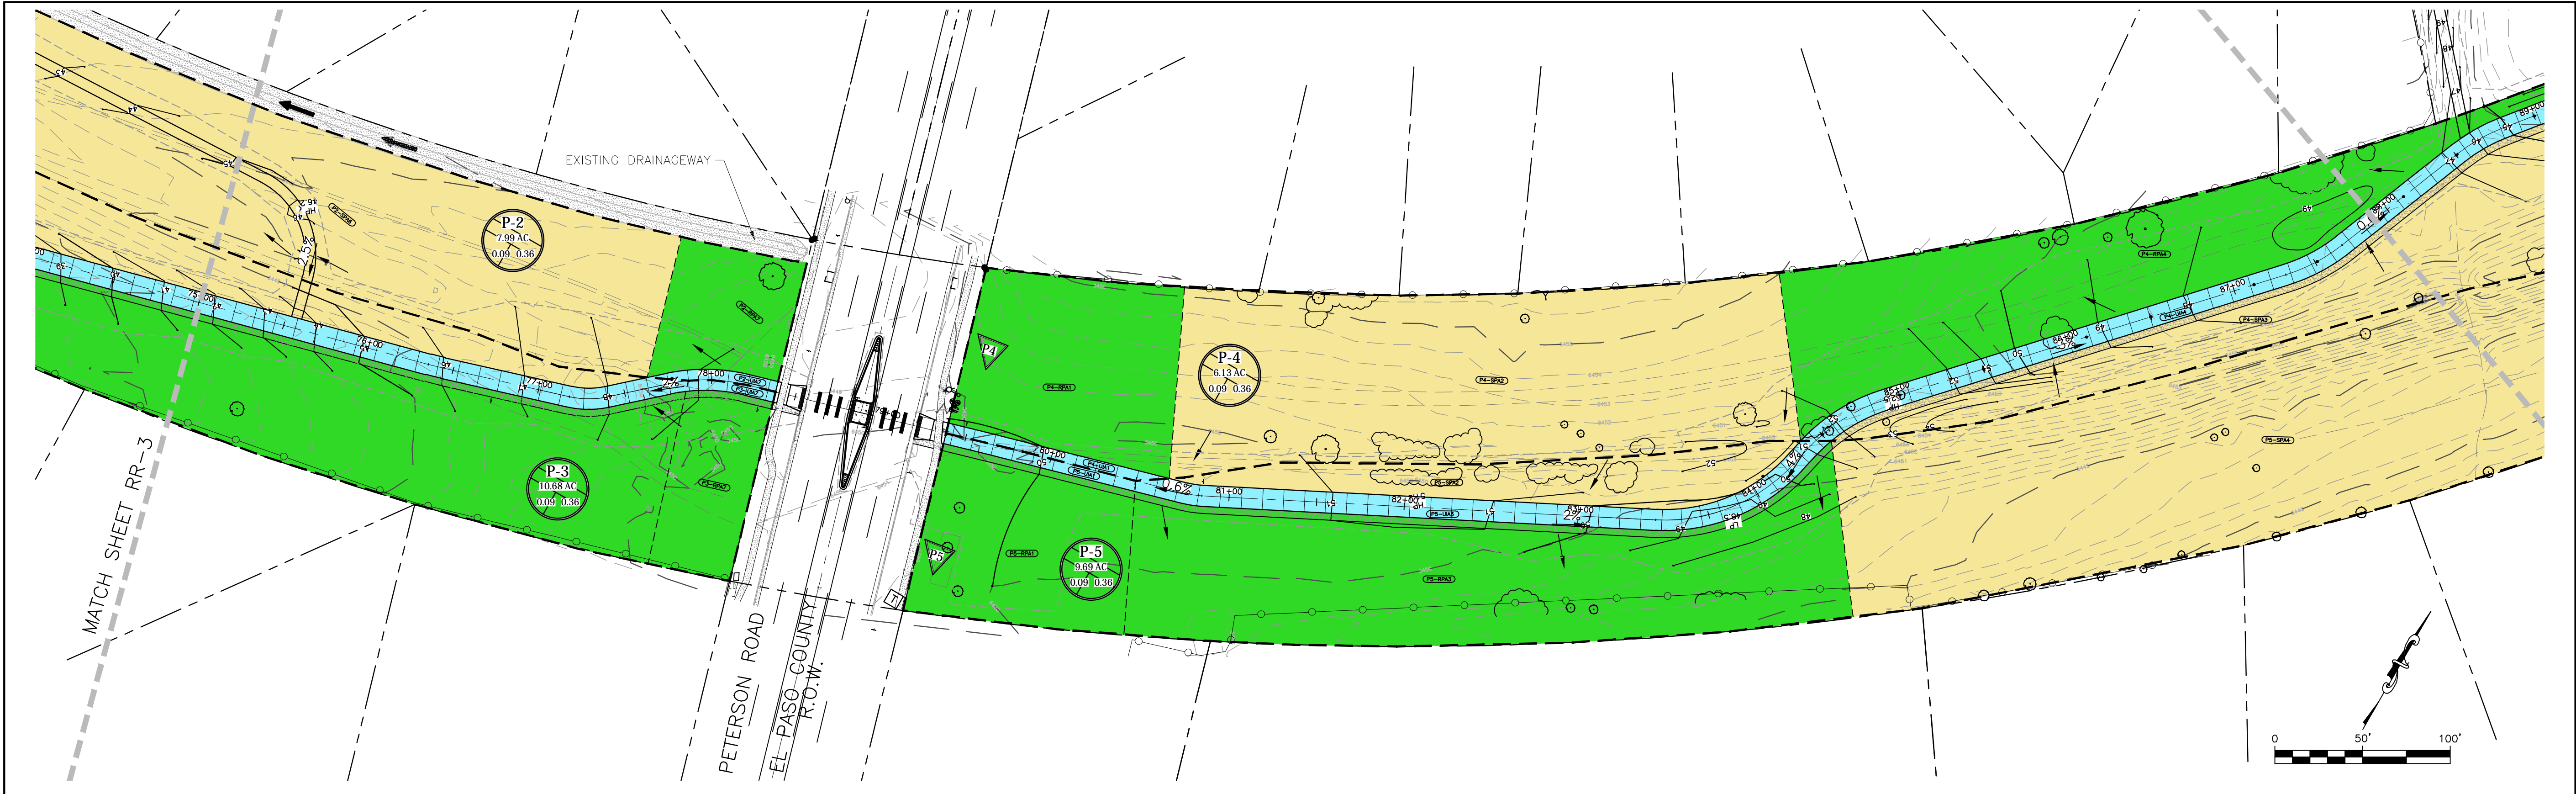


Celebrating 30 years
KIOWA
Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342



Sheet Revisions	
	No Revisions:
	Revised:
	Void:

ROCK ISLAND TRAIL Sand Creek to Constitution Avenue RUNOFF REDUCTION MAP	
Designer: TAC	
Detailer: JDC	
Date: 8/15/2024	

Kiowa Proj. No. 16028
TAP M240-162
SubAcct No.20391
Sheet Number RR-4

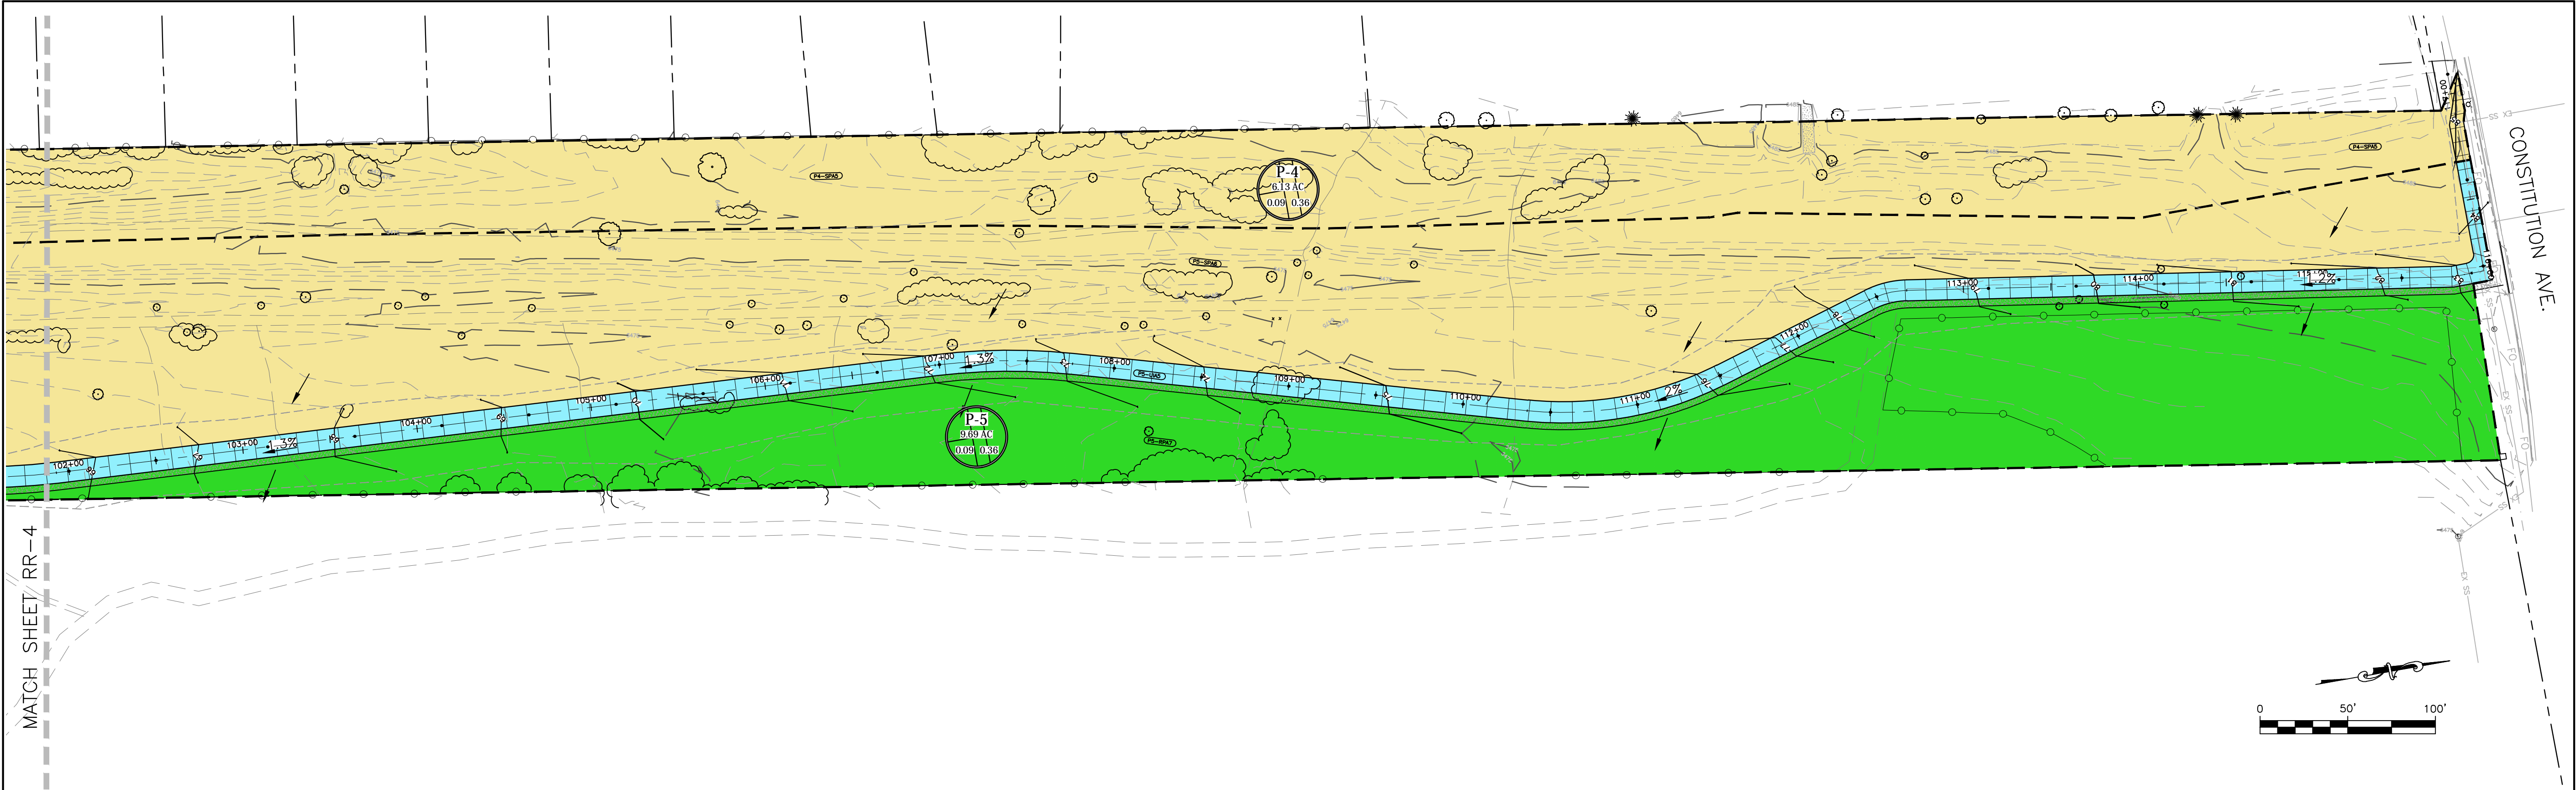

K:\2016\16028 Rock Island Trail Design\DRAWINGS\Drainage\C-2 16028-Rock Island-RR map.dwg Aug 15, 2024 - 10:41 pm



Sheet Revisions	

No Revisions:

Revised:

Void:

ROCK ISLAND TRAIL Sand Creek to Constitution Avenue RUNOFF REDUCTION MAP			
Designer:	TAC		
Detailer:	JDC		
Date:	8/15/2024		

Kiowa Proj. No. 16028	
TAP M240-162	
SubAcct No.20391	
Sheet Number	RR-5

APPENDIX D
Drainage Maps

K:\2016\16028 Rock Island Trail Design\DRAWINGS\Exhibits\Drainage\ D-1 16028 Rock Island EDM.dwg Mar 11, 2025 - 10:01 pm



LEGEND

H1

2.67 AC

0.310.50

C5 RUNOFF

5-YEAR RUNOFF

100-YEAR RUNOFF

2.2 cfs

4.3 cfs

DIRECTIONAL FLOW ARROW

PROP DRAINAGE BASIN BOUNDARY

PROP DRAINAGE SUB-BASIN BOUNDARY

DESIGN POINT

TIME OF CONCENTRATION PATH

10

S10

HYDRAULIC STRUCTURE IDENTIFIER

STORM SEWER IDENTIFIER

PROPOSED STORM SEWER PIPE

PROPOSED STORM SEWER MANHOLE

PROPOSED STORM DRAINAGE CURB INLET

(6020)

6020

EXISTING CONTOURS

PROPOSED CONTOURS

PROPERTY BOUNDARY

LIMIT OF DISTURBANCE

XX-XXXX

SUB-BASIN NUMBER

SUB-BASIN AND DESIGN POINT DISCHARGES						
DESIGN POINT	CONTRIBUTING BASINS	AREA	5-YR RUNOFF COEF.	100-YR RUNOFF COEF.	5-YR FLOW	100-YR FLOW
E1	E-1	0.87 ac	0.09	0.36	0.3 cfs	1.9 cfs
E2	E-2	7.99 ac	0.09	0.36	3.3 cfs	22 cfs
E3	E-3	10.64 ac	0.09	0.36	4.1 cfs	27 cfs
E4	E-4	6.13 ac	0.09	0.36	2.5 cfs	17 cfs
E5	E-5 & E-5	9.69 ac	0.09	0.36	4.2 CFS	30 CFS
E6	E-6	0.65 AC	0.09	0.36	0.2 CFS	1.6 CFS
E7	E-7	0.67 AC	0.09	0.36	0.3 CFS	1.9 CFS
E8	E-8	0.17 AC	0.53	0.68	0.4 CFS	10.9 CFS

Celebrating 30 years

Kiowa

Engineering Corporation

1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342

0000

Sheet Revisions

No Revisions:

Revised:

Void:

ROCK ISLAND TRAIL

Sand Creek to Constitution Avenue

EXISTING DRAINAGE MAP

Designer: TAC

Detailer: JDC

Date: 3/11/2025

Kiowa Proj. No. 16028

TAP M240-162

SubAcct No.20391

Sheet Number EDM-1





K:\2016\16028 Rock Island Trail Design\DRAWINGS\Exhibits\Drainage\ D-1 16028 Rock Island EDM.dwg Mar 11, 2025 - 10:01pm




Kiowa
Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342

00000000	Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue EXISTING DRAINAGE MAP			Kiowa Proj. No. 16028
						TAP M240-162
	No Revisions:					SubAcct No.20391
	Revised:		Designer: TAC			Sheet Number EDM-2
			Detailer: JDC			
	Void:		Date: 3/11/2025			

K:\2016\16028 Rock Island Trail Design\DRAWINGS\Exhibits\Drainage\ D-1 16028 Rock Island EDM.dwg, Mar 11, 2025 - 10:01pm

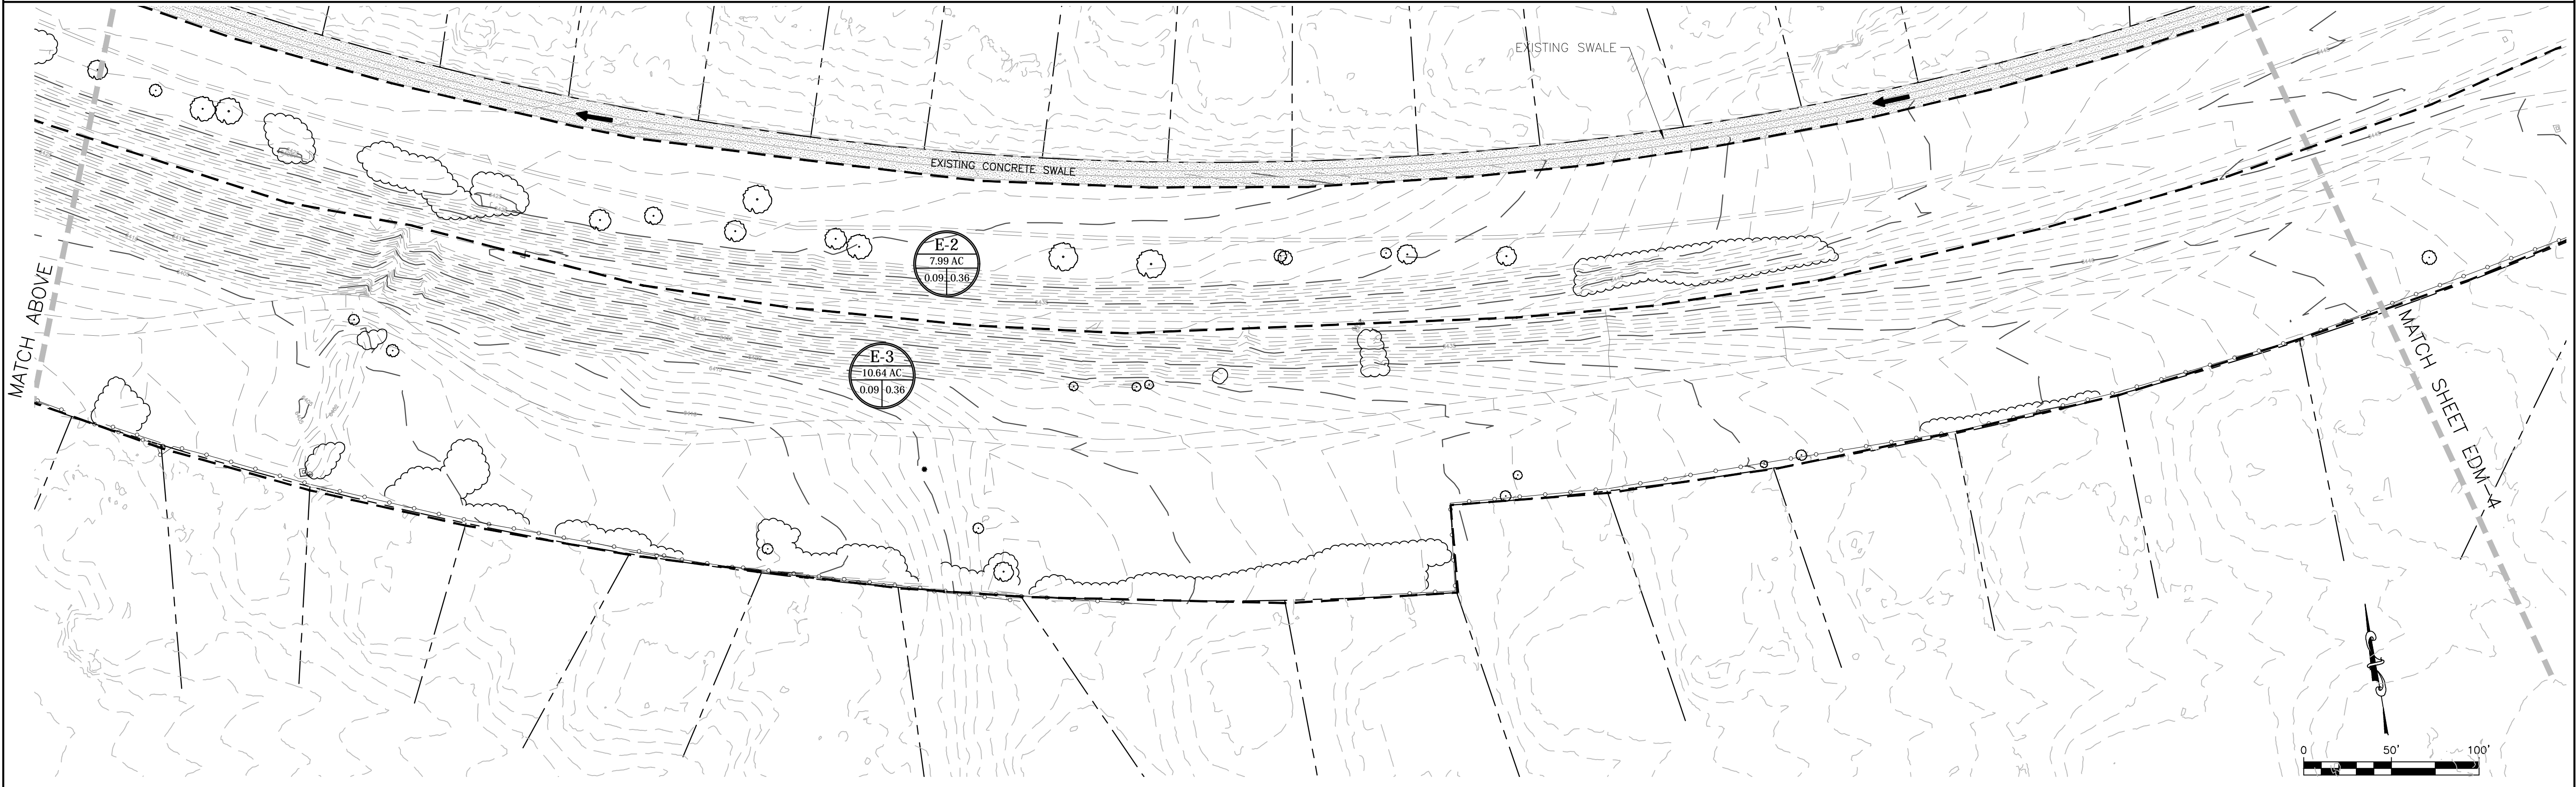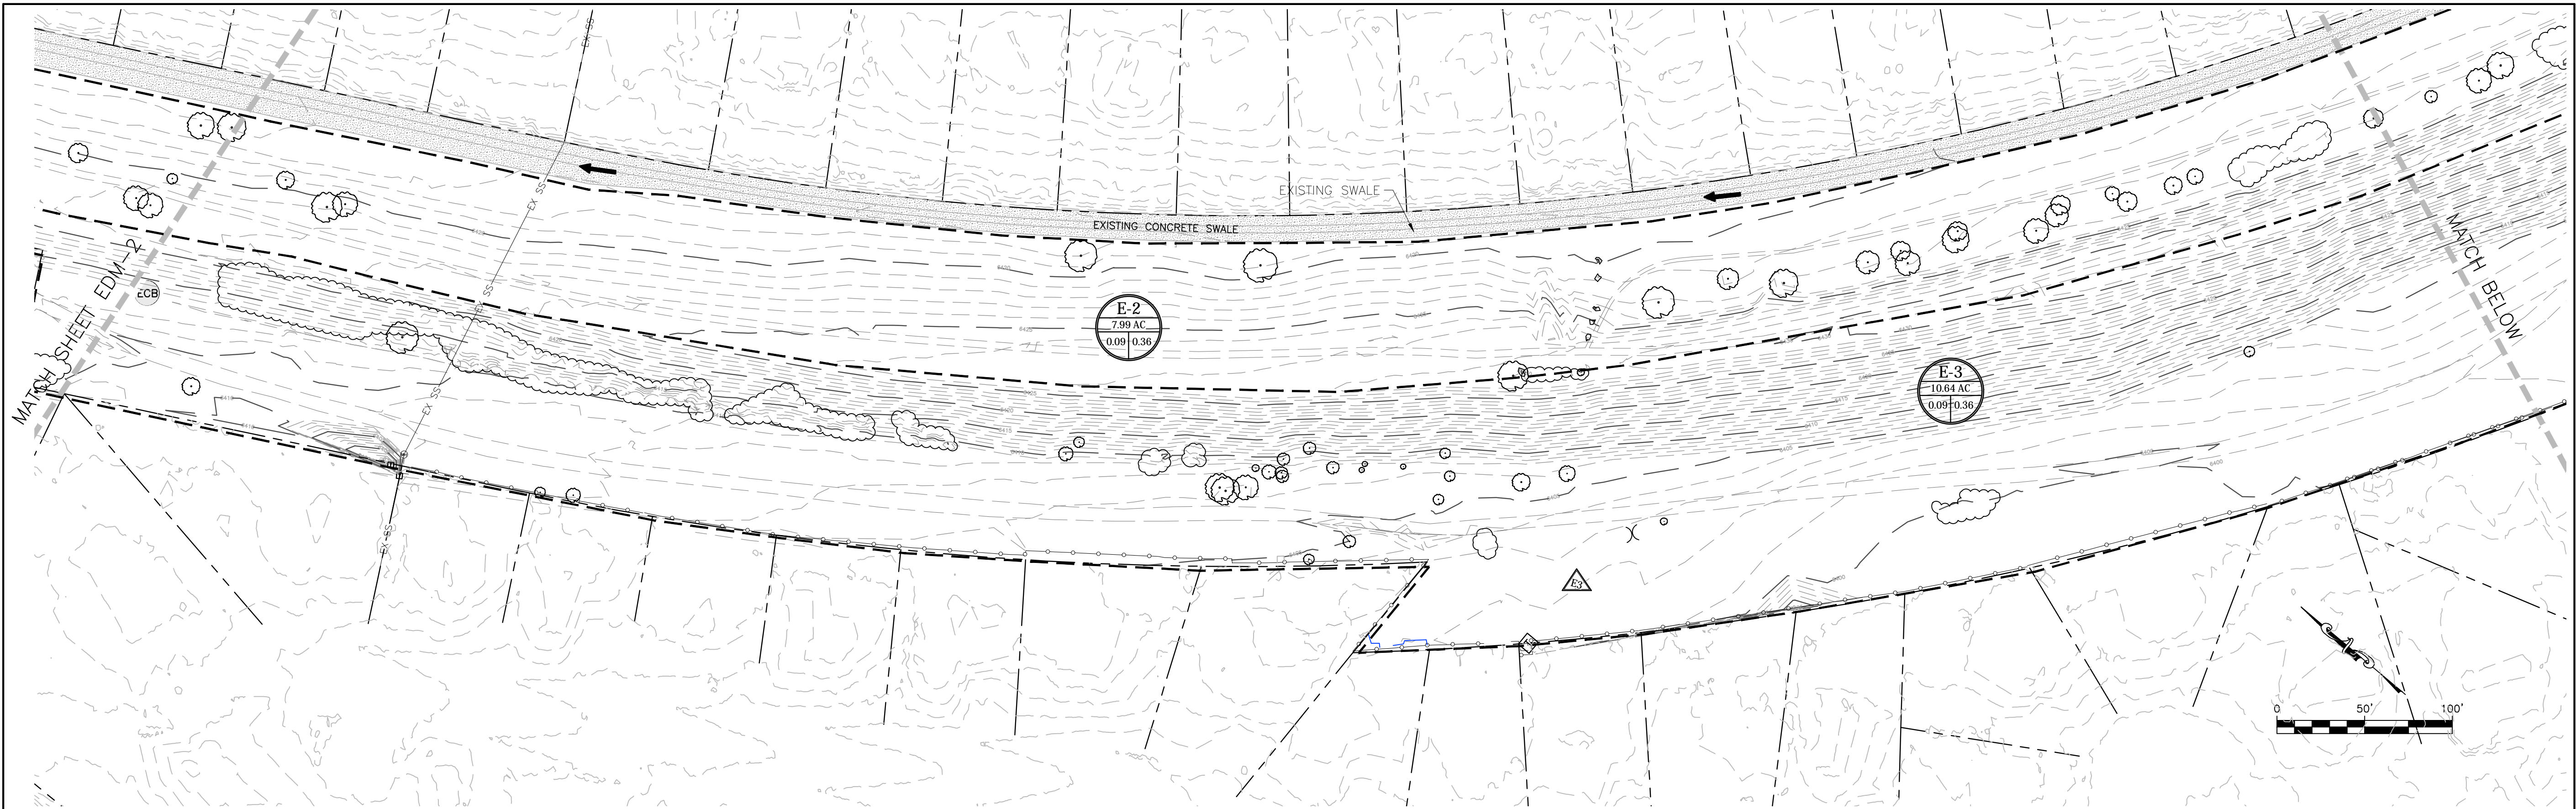

Kiowa
Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342



Sheet Revisions

No Revisions:

Revised:

Void:

ROCK ISLAND TRAIL Sand Creek to Constitution Avenue EXISTING DRAINAGE MAP

Designer: TAC

Detailer: JDC

Date: 3/11/2025



Kiowa Proj. No. 16028


TAP M240-162

SubAcct No.20391

Sheet Number EDM-3



		<div>0000</div> <div>0000</div> <div>0000</div> <div>0000</div>	Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue EXISTING DRAINAGE MAP			Kiowa Proj. No. 16028	
								TAP M240-162	
			No Revisions:		Designer:	TAC	SubAcct No.20391	Sheet Number EDM-4	
			Revised:		Detailer:	JDC			
			Void:		Date:	3/11/2025			

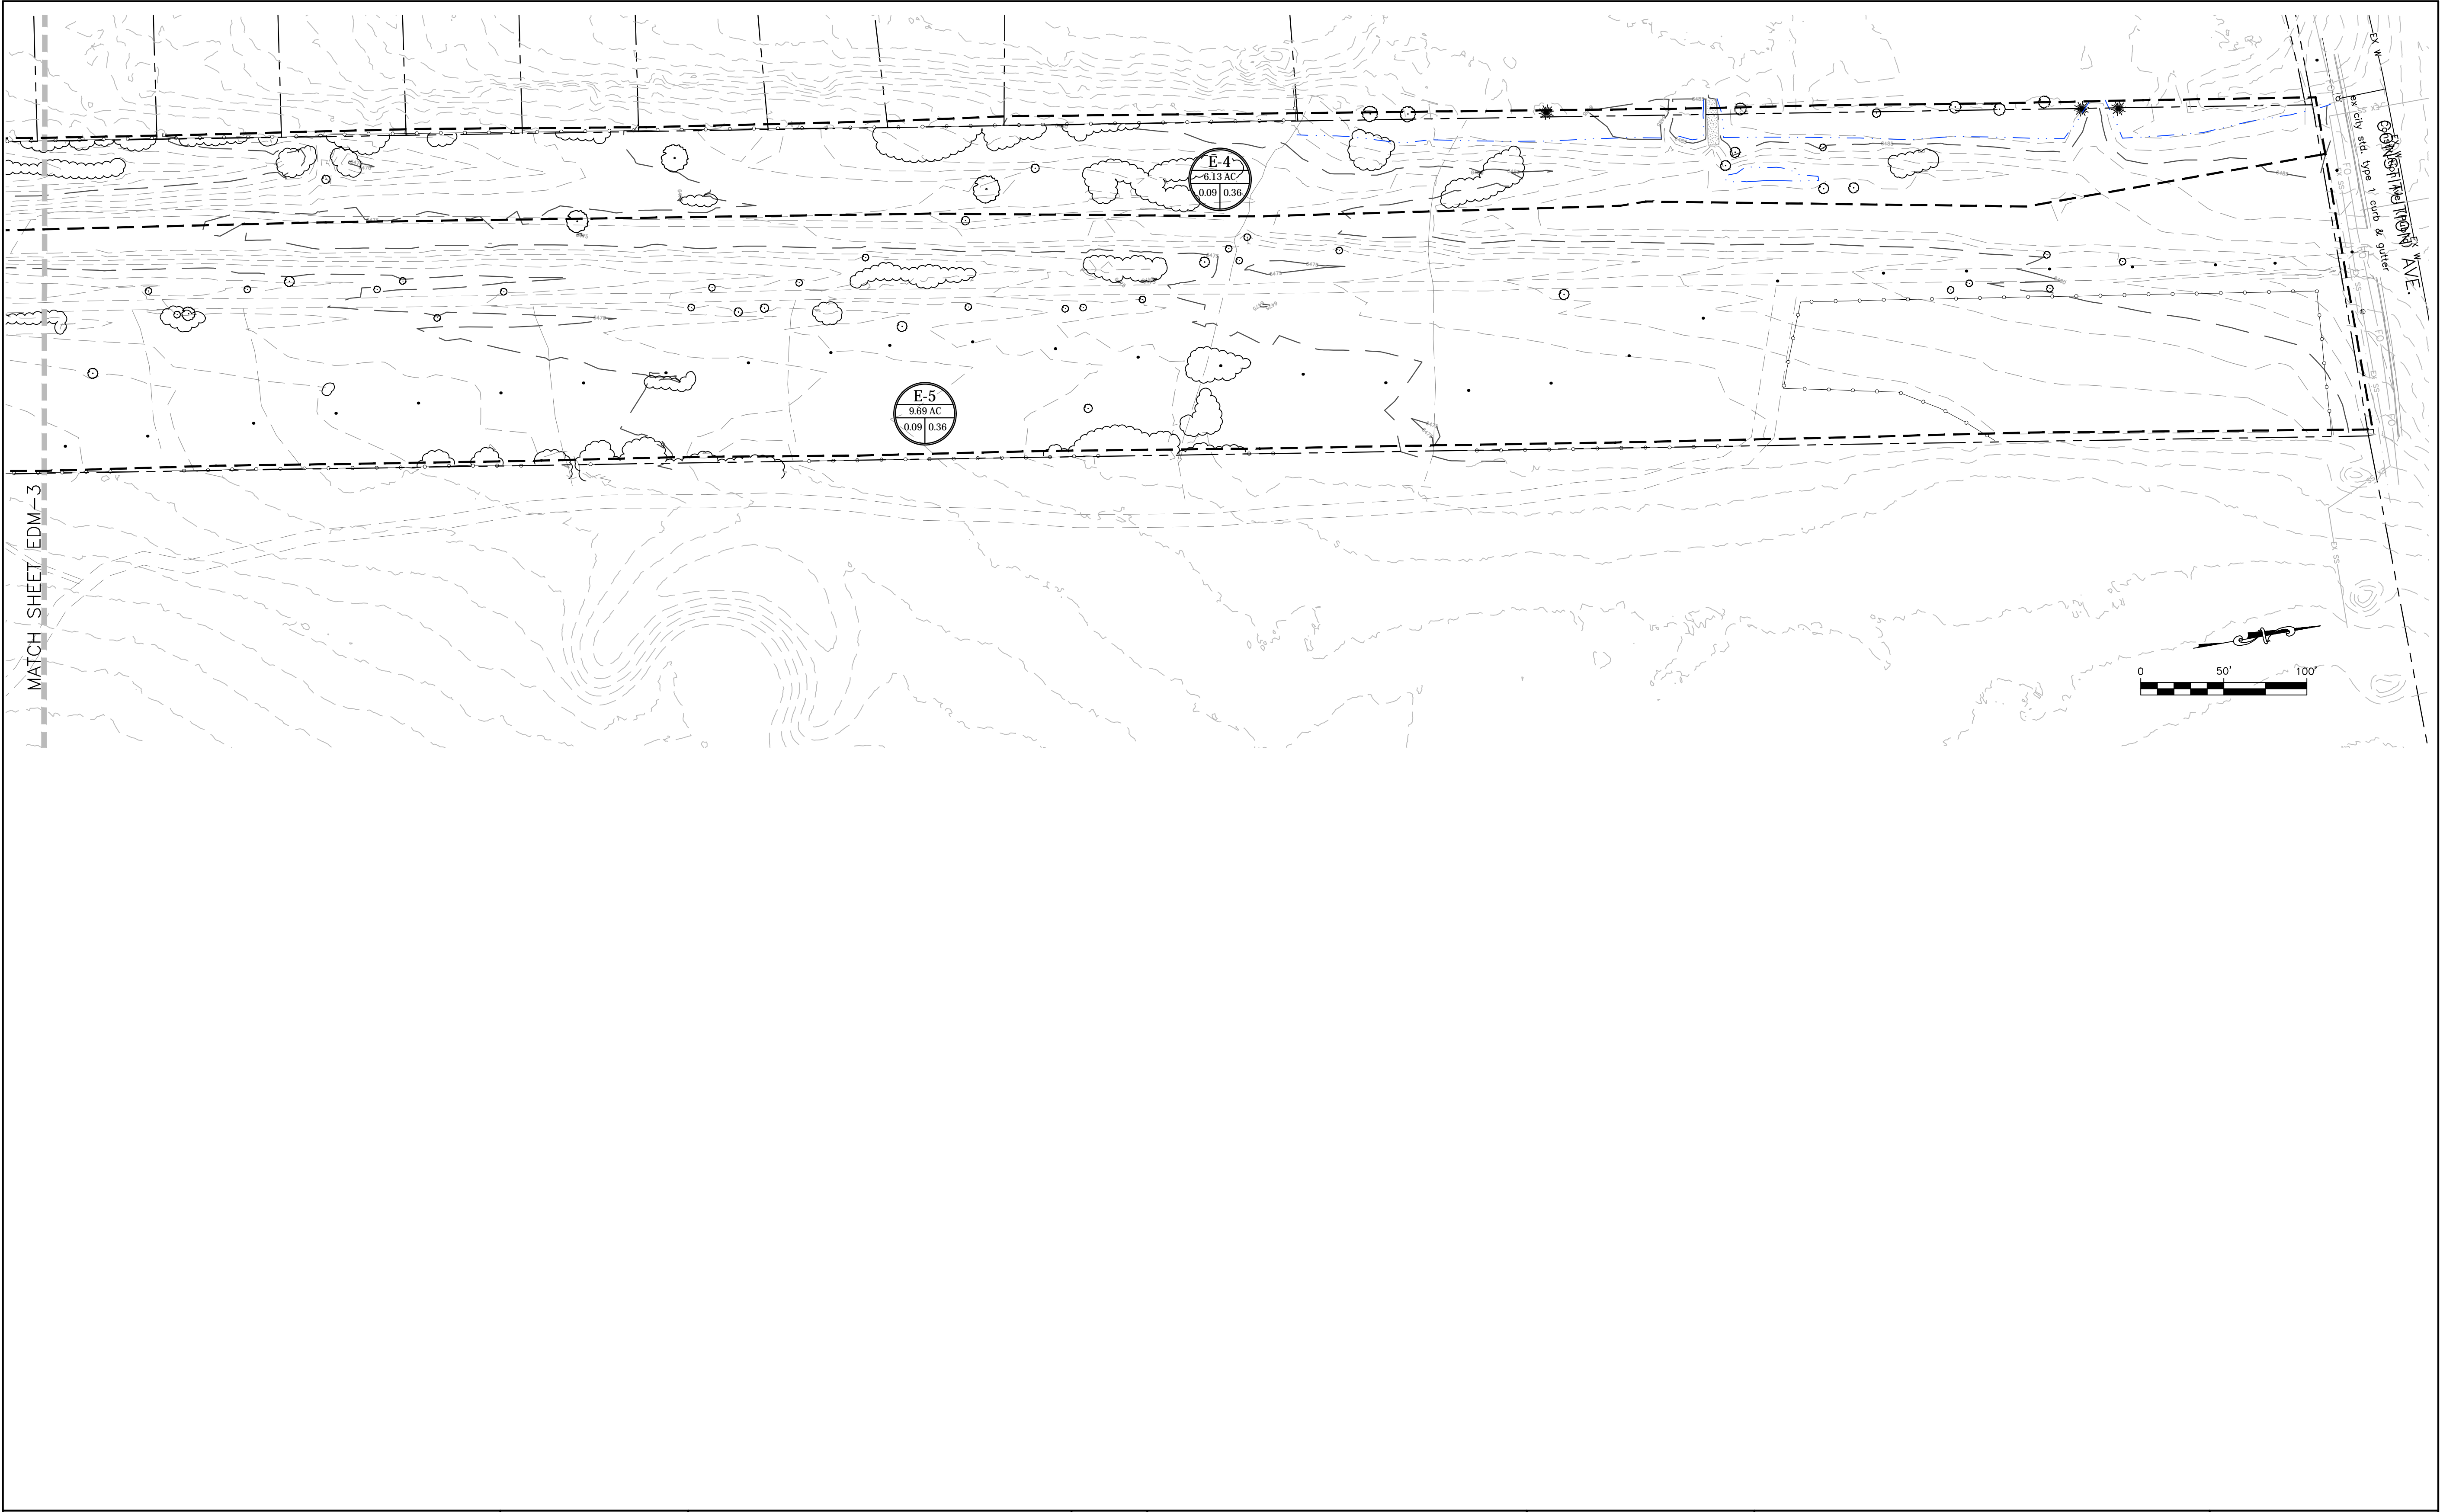

K:\2016\16028 Rock Island Trail Design\DRAWINGS\Exhibits\Drainage\ D-1 16028-Rock Island-EDM.dwg, Mar 11, 2025 - 10:01pm



Celebrating 30 years

Kiowa

Engineering Corporation

1604 South 21st Street

Colorado Springs, Colorado 80904

(719) 630-7342

<div><div></div><div></div><div></div><div></div><div></div></div>	Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue EXISTING DRAINAGE MAP			Kiowa Proj. No. 16028
						TAP M240-162
			No Revisions:			
			Revised:	Designer: TAC		SubAcct No.20391
				Detailer: JDC		
			Void:	Date: 3/11/2025	Sheet Number EDM-5	

K:\2016\16028 Rock Island Trail Design\Drawings\Exhibits\Drainage\ D 2 16028 Rock Island PDM.dwg Mar 11, 2025 - 9:58pm



LEGEND

H1

2.67 AC

0.31 0.50

C5 RUNOFF

C100 RUNOFF

2.2 cfs

4.3 cfs

5-YEAR RUNOFF

100-YEAR RUNOFF

→

DIRECTIONAL FLOW ARROW

PROP DRAINAGE BASIN BOUNDARY

PROP DRAINAGE SUB-BASIN BOUNDARY

△

DESIGN POINT

TIME OF CONCENTRATION PATH

10

HYDRAULIC STRUCTURE IDENTIFIER

S10

STORM SEWER IDENTIFIER

PROPOSED STORM SEWER PIPE

⊙

PROPOSED STORM SEWER MANHOLE

■

PROPOSED STORM DRAINAGE CURB INLET

(6020)

EXISTING CONTOURS

6020

PROPOSED CONTOURS

PROPERTY BOUNDARY

LIMIT OF DISTURBANCE

XX-XXXX

SUB-BASIN NUMBER

SUB-BASIN AND DESIGN POINT DISCHARGES						
DESIGN POINT	CONTRIBUTING BASINS	AREA	5-YR RUNOFF COEF.	100-YR RUNOFF COEF.	5-YR FLOW	100-YR FLOW
P1	P-1	0.87 ac	0.09	0.36	0.3 cfs	1.9 cfs
P2	P-2	7.99 ac	0.09	0.36	3.3 cfs	22 cfs
P3	P-3	10.64 ac	0.09	0.36	4.1 cfs	27 cfs
P4	P-4	6.13 ac	0.09	0.36	2.5 cfs	17 cfs
P5	P-5 & P-6	9.69 ac	0.09	0.36	4.2 cfs	30 cfs
P6	P-6	0.65 AC	0.09	0.36	0.2 CFS	1.6 CFS
P7	P-7	0.67 AC	0.09	0.36	0.3 CFS	1.9 CFS
P8	P-8	0.17 AC	0.53	0.68	0.4 CFS	10.9 CFS




Celebrating 30 years

Kiowa


Engineering Corporation

1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342

<div><div></div><div></div><div></div><div></div><div></div><div></div></div>	Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue PROPOSED DRAINAGE MAP			Kiowa Proj. No. 16028
						TAP M240-162
	No Revisions:		Designer: TAC		SubAcct No.20391	
	Revised:		Detailer: JDC			
	Void:		Date: 3/11/2025	Sheet Number PDM-1		

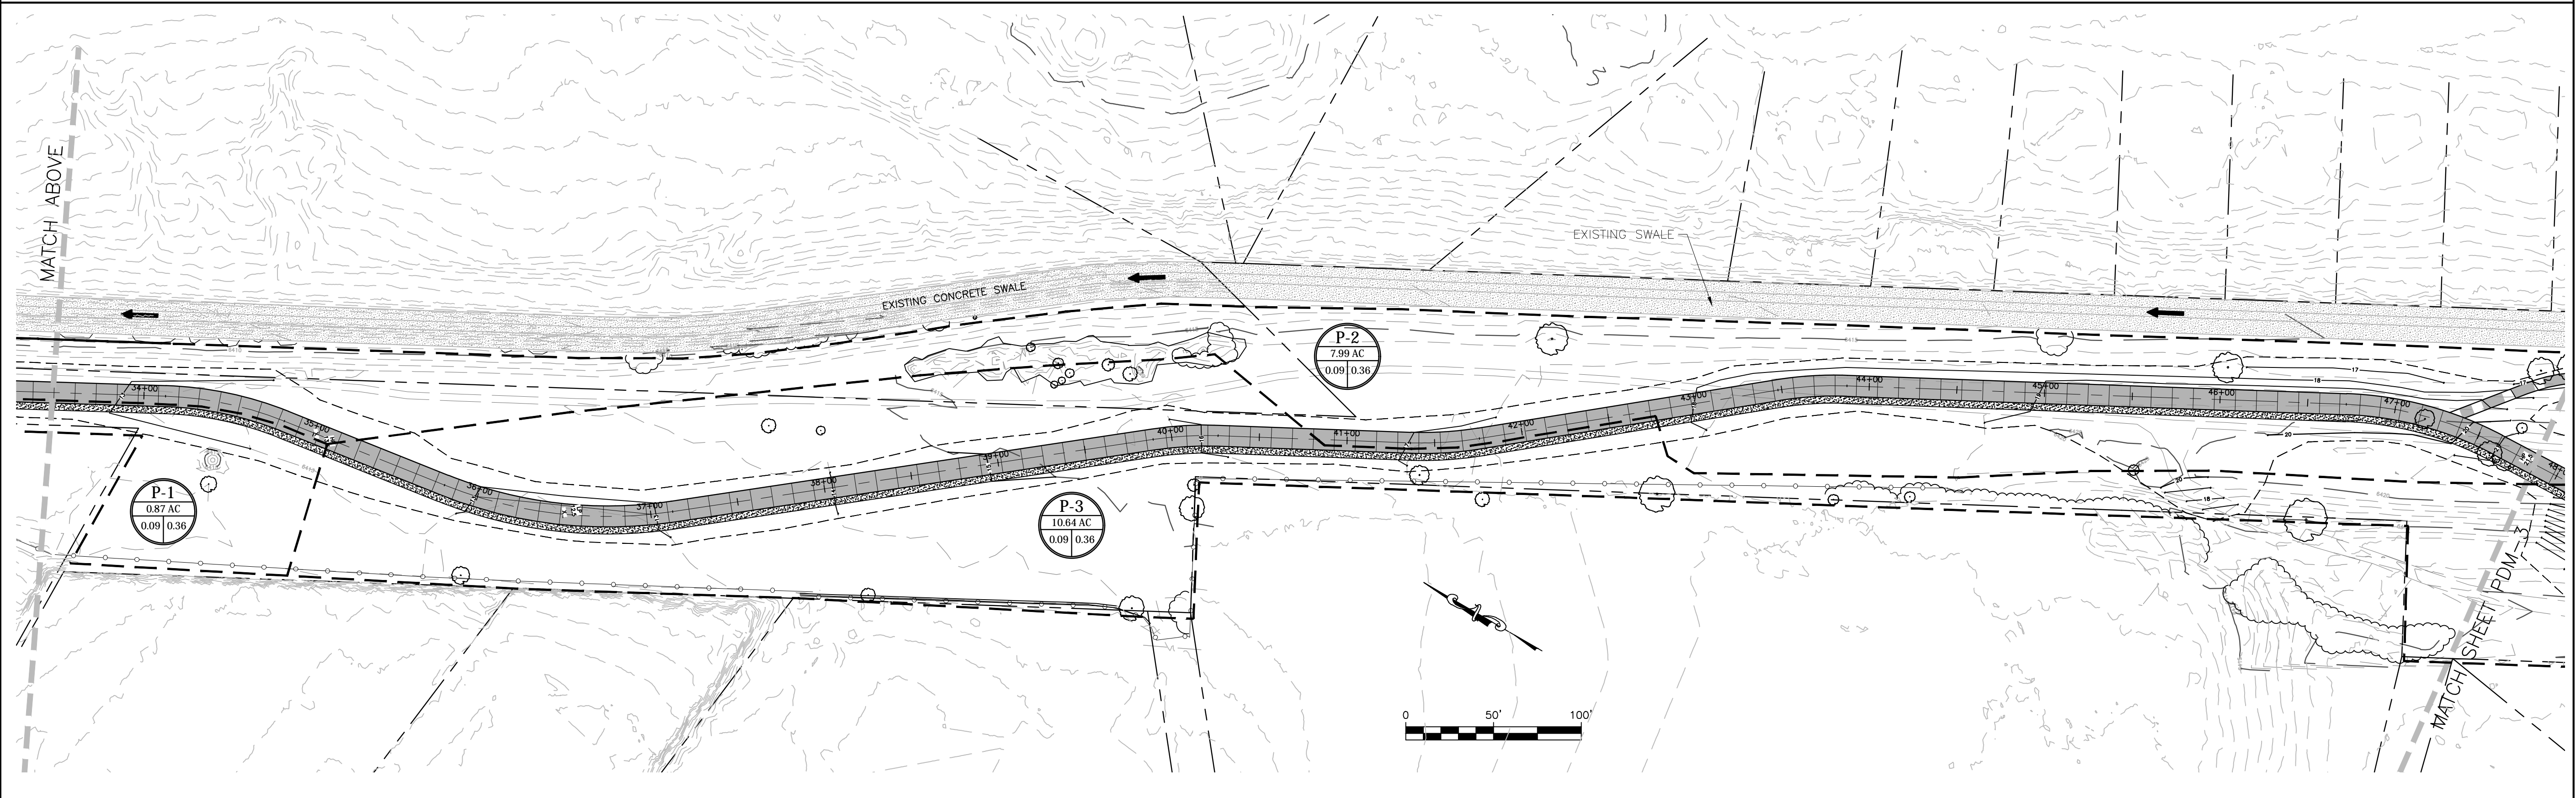



Kiowa
Engineering Corporation
1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342







Sheet Revisions	
	No Revisions:
	Revised:
	Void:

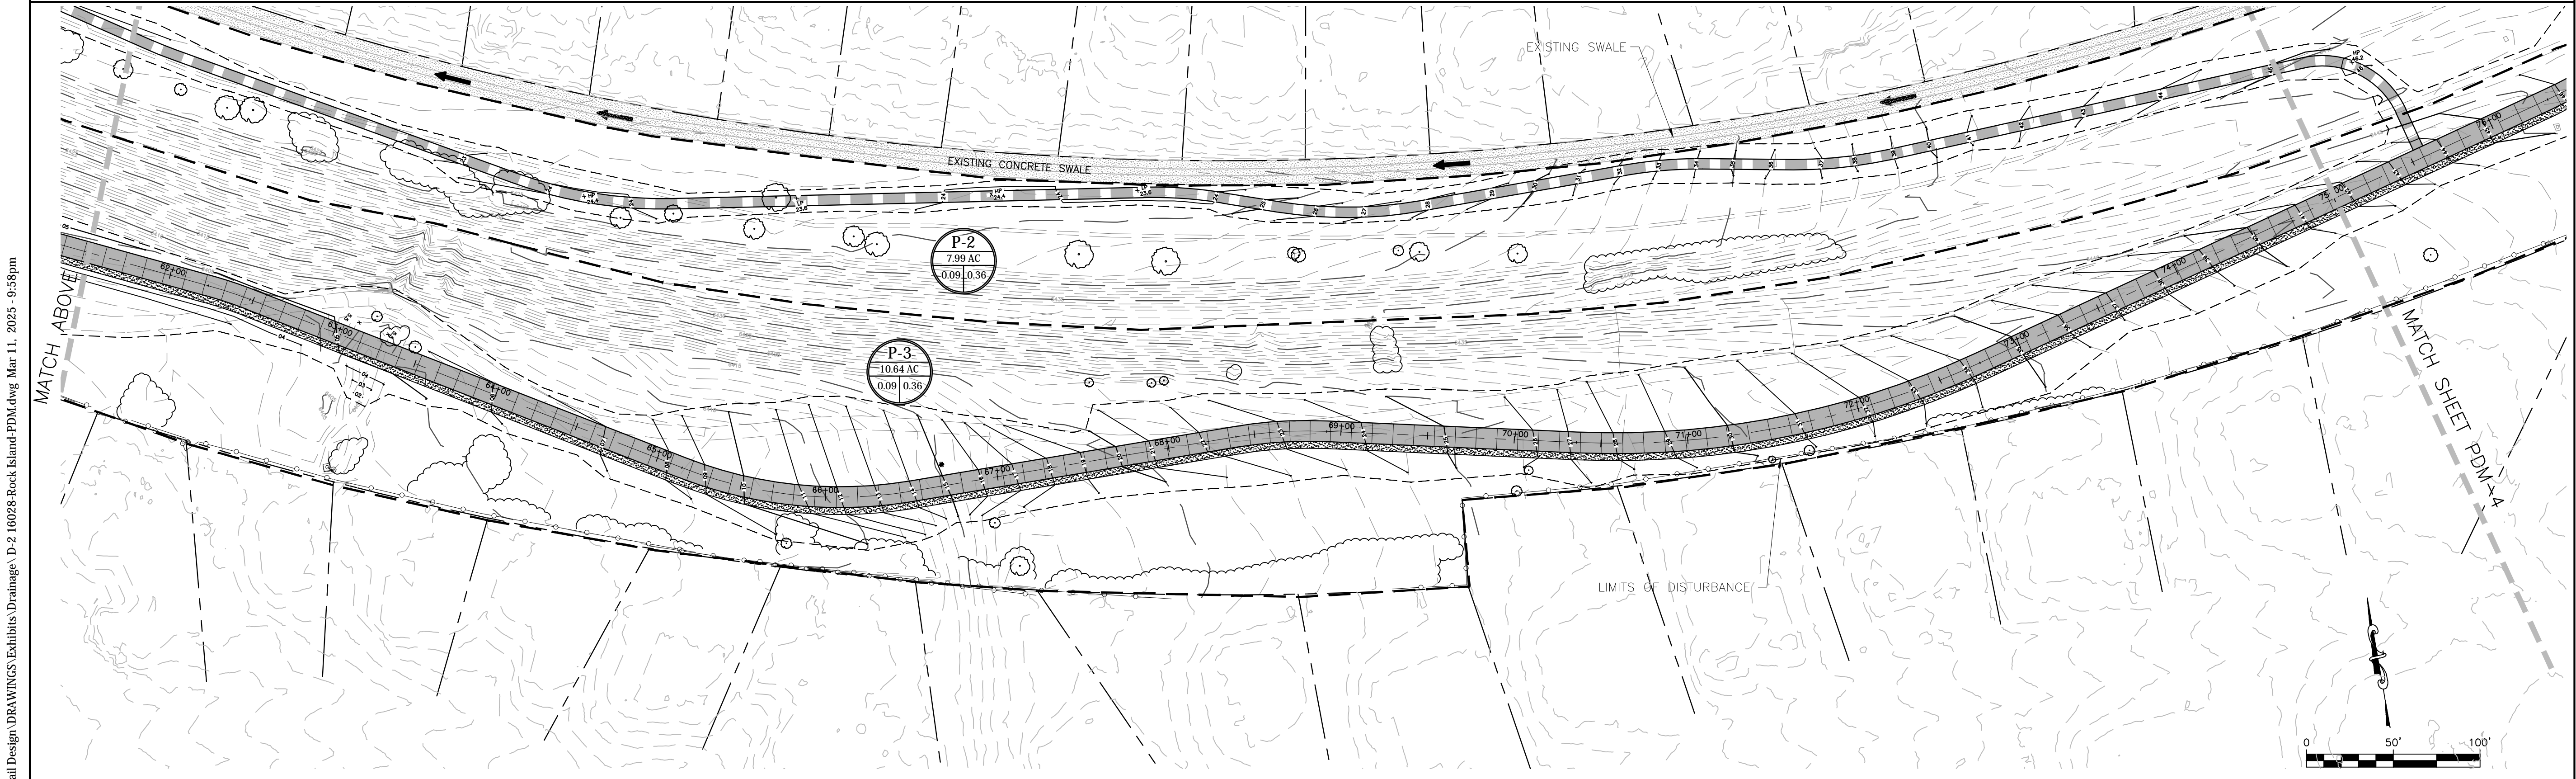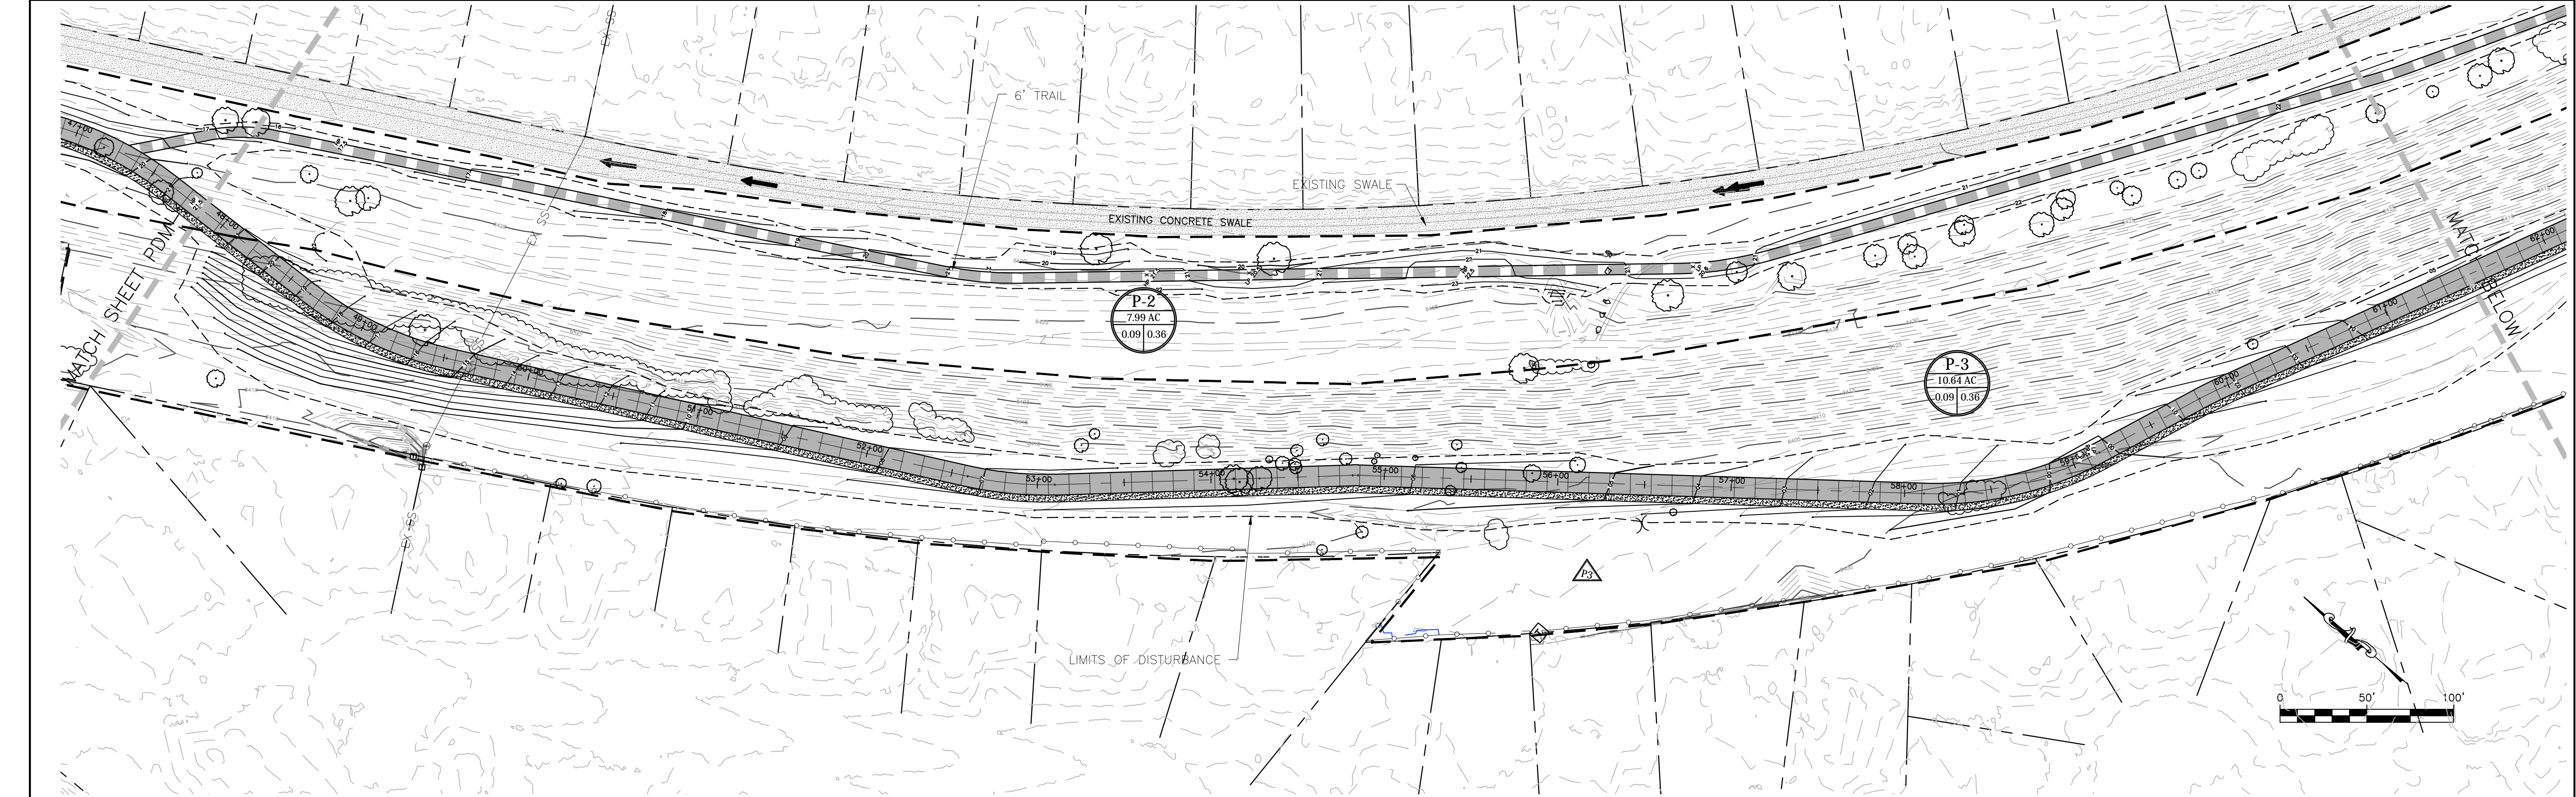

ROCK ISLAND TRAIL Sand Creek to Constitution Avenue PROPOSED DRAINAGE MAP			
Designer:	TAC		
Detailer:	JDC		
Date:	3/11/2025		


Kiowa Proj. No. 16028
TAP M240-162
SubAcct No.20391
Sheet Number PDM-2



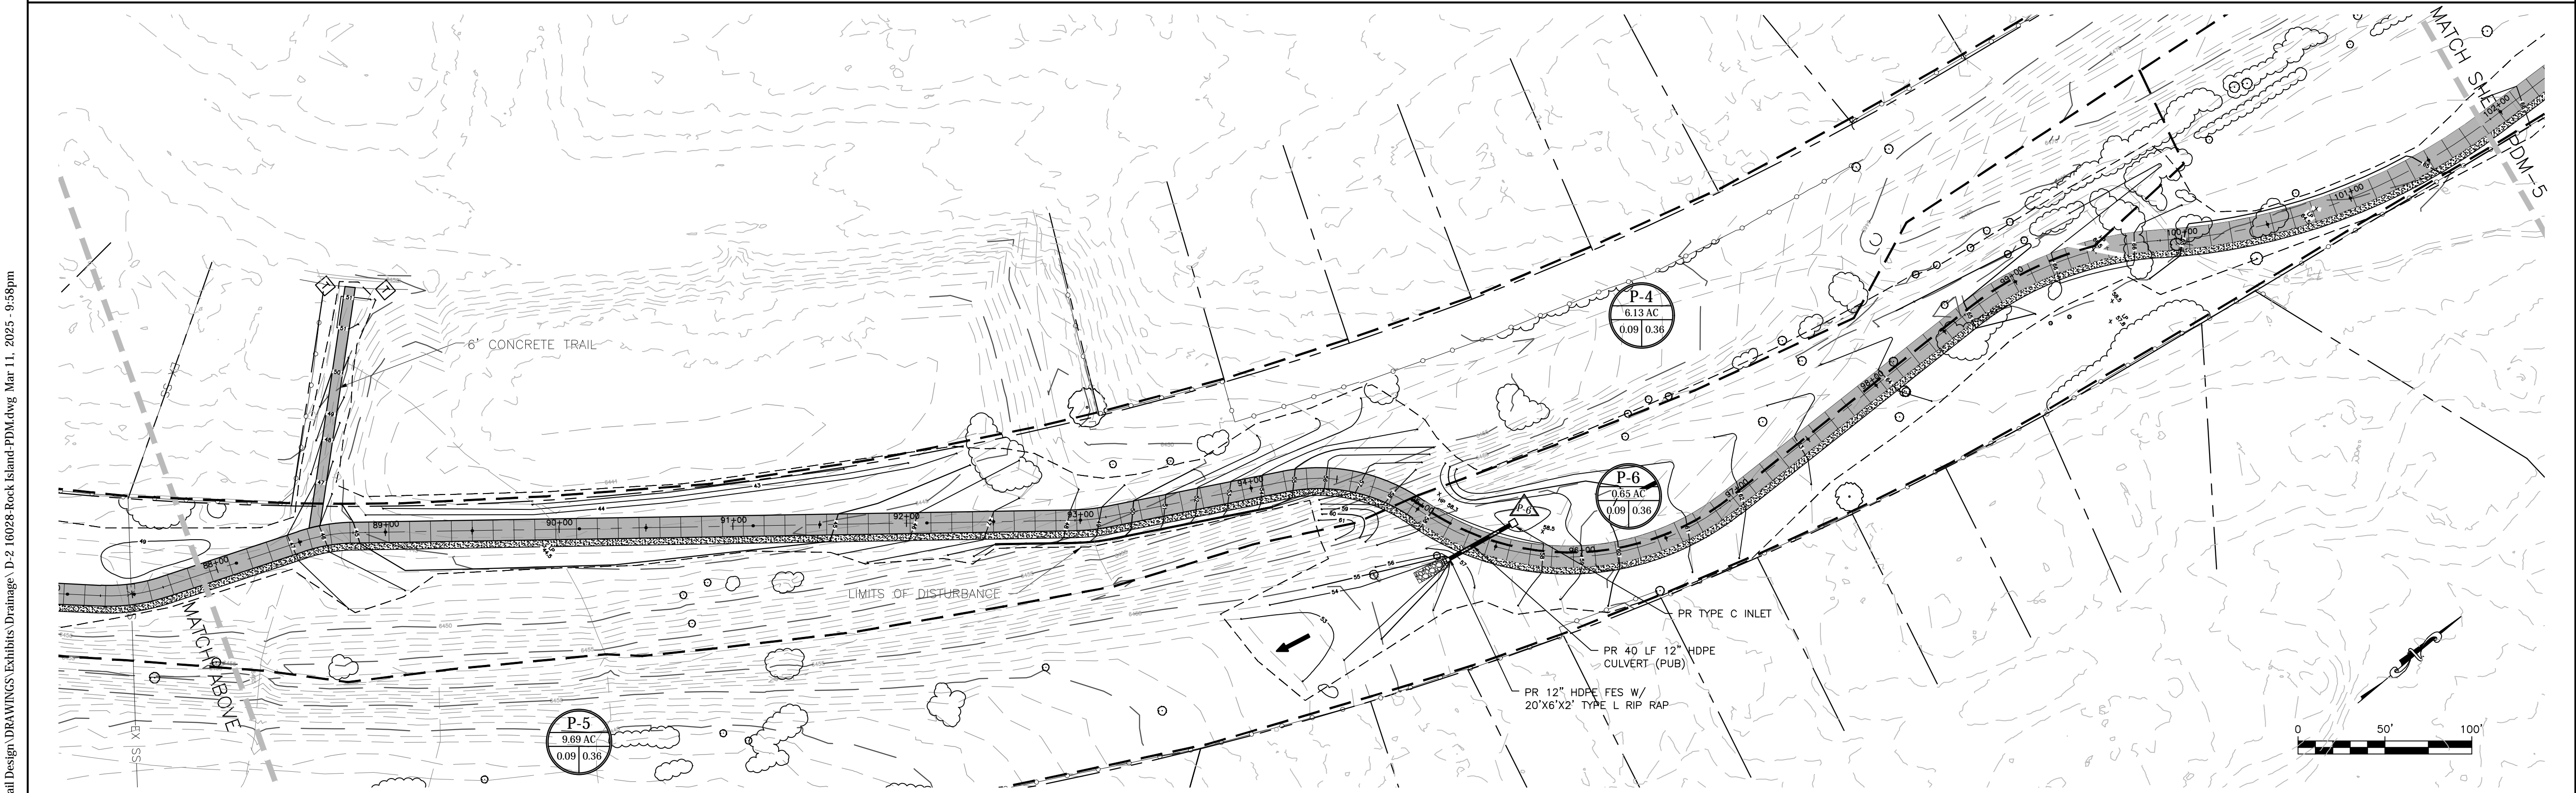	 1604 South 21st Street Colorado Springs, Colorado 80904 (719) 630-7342		Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue PROPOSED DRAINAGE MAP		Kiowa Proj. No. 16028			
							TAP M240-162			
					No Revisions:		Designer: TAC		SubAcct No.20391	
					Revised:		Detailer: JDC			
					Void:		Date: 3/11/2025		Sheet Number PDM-3	



	 1604 South 21st Street Colorado Springs, Colorado 80904 (719) 630-7342	<div><div></div><div></div><div></div><div></div><div></div></div>	Sheet Revisions		ROCK ISLAND TRAIL Sand Creek to Constitution Avenue PROPOSED DRAINAGE MAP			Kiowa Proj. No. 16028
			No Revisions:					TAP M240-162
			Revised:		Designer: TAC		SubAcct No.20391	
			Void:		Detailer: JDC		Sheet Number	
					Date: 3/11/2025		PDM-4	

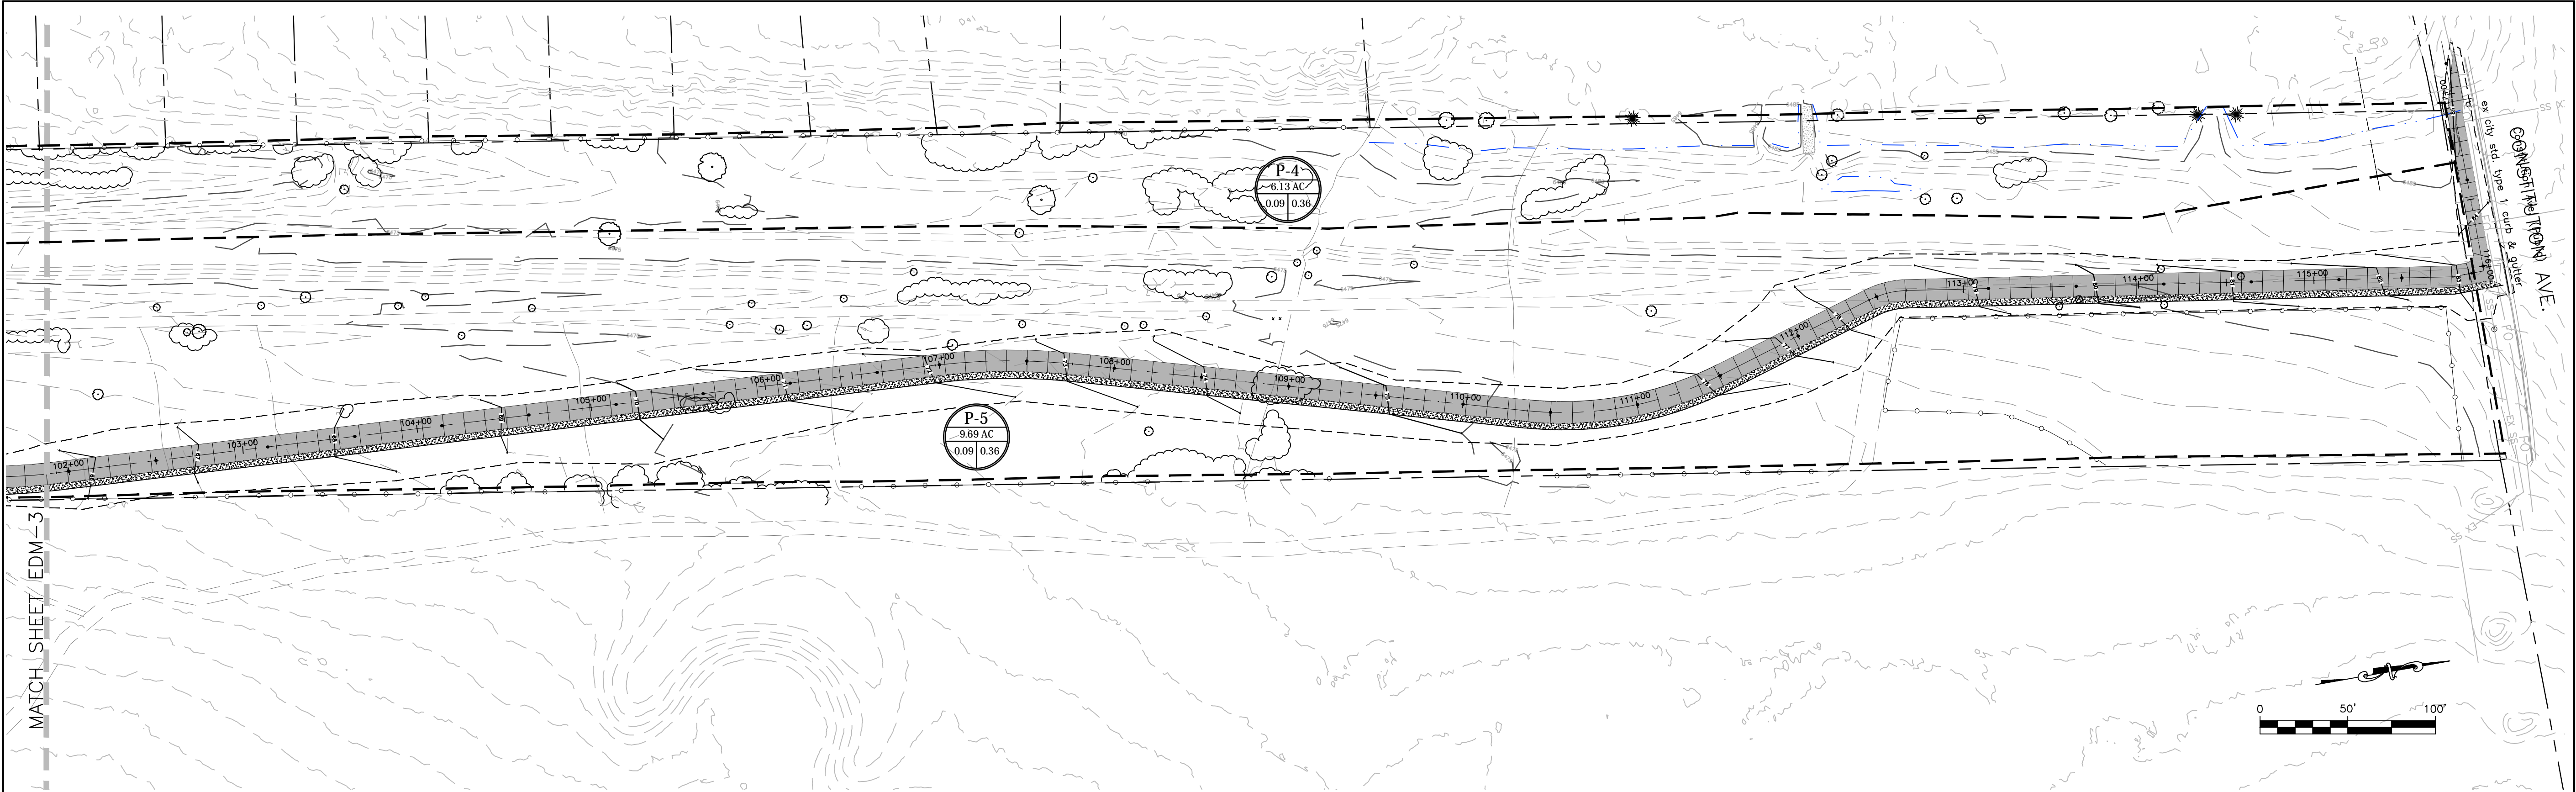

K:\2016\16028 Rock Island Trail Design\DRAWINGS\Exhibits\Drainage\ D-2 16028-Rock Island PDM.dwg, Mar 11, 2025 - 9:58pm



Kiowa
Engineering Corporation
Celebrating 30 years
1604 South 21st Street
Colorado Springs, Colorado 80904
(719) 630-7342



Sheet Revisions	

ROCK ISLAND TRAIL Sand Creek to Constitution Avenue PROPOSED DRAINAGE MAP			
No Revisions:			
Revised:			
Void:			
Designer:	TAC		
Detailer:	JDC		
Date:	3/11/2025		

Kiowa Proj. No. 16028	
TAP M240-162	
SubAcct No.20391	
Sheet Number	PDM-5

APPENDIX E
City / County MS4 Overlap Agreement



April 30, 2025

VIA EMAIL

Christina Prete, P.E.
Engineering Manager
El Paso County
3275 Akers Drive
Colorado Springs, CO 80922

Re: City of Colorado Springs (City) / El Paso County (County) MS4 Permit Overlapping Jurisdictional Boundary Agreement

Dear Ms. Prete:

This letter is provided to document agreement between co-regulating MS4 permittees. For the limits of the Rock Island Trail project, the following applies:

Construction Sites Program:

- Project will comply with the Construction Sites Program requirements as outlined in the El Paso County MS4 Permit (COR090000) section I.E.3. The project must comply with all applicable El Paso County criteria.
 - The project is subject to El Paso County compliance inspections, enforcement, and permit closeout requirements. Project inspections will comply with the Construction Sites Program requirements as outlined in the El Paso County MS4 Permit (COR090000) section I.E.3. The project inspections must comply with all applicable El Paso County criteria.
- Permanent Water Quality Management / Post Construction Program for New Development and Redevelopment:
 - Project will comply with the Permanent Water Quality Management requirements as outlined in the El Paso County MS4 Permit (COR090000) section I.E.4. The project must comply with all applicable El Paso County criteria.

Any questions regarding this information can be directed to me at erin.powers@coloradosprings.gov or (719) 418-1336.





April 30, 2025

Sincerely,

Erin Powers, P.E.

Stormwater Enterprise Manager

City of Colorado Springs

On behalf of El Paso County, I acknowledge and agree on this date: 05.12.2025

Christina Prete, P.E.

Engineering Manager

El Paso County

