



**ENTECH**  
 ENGINEERING, INC.  
 505 Elkton Drive  
 Colorado Springs, CO 80907  
 (719) 531-5599 • (719) 531-5238 (fax)

Client:	FLRD #5
Project:	Forest Lakes Residential Development, Filing 5
Entech Job #	192273

### CONCRETE TEST


<b>PG</b>			Test #: <b>40</b>		
Date:	# of Specimens	Specified Strength (psi)	Time of Test	Hours Field Cured	Lab Receive Date:
10/16/2020	4	4500	12:05 PM	24	10/17/2020
<b>Specimen Type</b>		<b>Test Type</b>		<b>Type of Cure</b>	
<b>Cylinders 4x8</b>		<b>Field</b>		<b>Tank</b>	
Contractor:		Supplier:		Mix Design Number	
PPC construction		Pete Lien		90DJ50	
Truck Number		Ticket Number		Batch Time:	
2207		977872		10:55 AM	

Location:  
 Curb and Gutter, driveway repair on Long Valley Drive., GPS Coordinates: 39.061868° N., - 104.874492° W.

Slump (in.):	Air (%):	Unit Weight (PCF):	Concrete Temp (°F)	Air Temp (°F)
4.25	7		61	48
<b>7-Day Strength</b>	<b>28-Day Strength</b>	<b>-Day Strength</b>	<b>56-Day Strength</b>	<b>-Day Strength</b>
4730	6060			
	5420			
Average:	Average:	Average:	Average:	Average:
4730	5740			
Break Date:	Break Date:	Break Date:	Break Date:	Break Date:
10/23/2020	11/13/2020			

Remarks:  
**28 Day Results**

Specifications: 4500 PSI, 5-8% Air, 3-5" Slump	Break Sequence: 1@7, 2@28, 1@hold
Summary Comments: PPC Construction, Pete Lien	

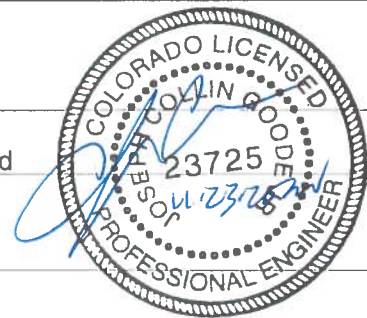

Reviewed By: *RPF*