



ENTECH
 ENGINEERING, INC.
 505 Elkton Drive
 Colorado Springs, CO 80907
 (719) 531-5599 • (719) 531-5238 (fax)

| | |
|--------------|--|
| Client: | FLRD #5 |
| Project: | Forest Lakes Residential Development, Filing 5 |
| Entech Job # | 192273 |

CONCRETE TEST

| | | | | | |
|----------------------|----------------|--------------------------|--------------|---------------------|-------------------|
| PG | | | Test #: 29 | | |
| Date: | # of Specimens | Specified Strength (psi) | Time of Test | Hours Field Cured | Lab Receive Date: |
| 9/18/2020 | 4 | 4500 | 8:10 AM | 24 | 9/19/2020 |
| Specimen Type | | Test Type | | Type of Cure | |
| Cylinders 4x8 | | Field | | Tank | |
| Contractor: | | Supplier: | | Mix Design Number | |
| Ideal Concrete | | Action Ready Mix | | A45BD67FCG | |
| Truck Number | | Ticket Number | | Batch Time: | |
| 521 | | 55716 | | 6:51 AM | |


Location:
 Curb and gutter, southwest side of 7114 Mesa Top Drive (39.061145, -104.898626)

| | | | | |
|-----------------------|------------------------|----------------------|------------------------|----------------------|
| Slump (in.): | Air (%): | Unit Weight (PCF): | Concrete Temp (°F) | Air Temp (°F) |
| 2.0 | 5.5 | 142.4 | 73 | 56 |
| 7-Day Strength | 28-Day Strength | -Day Strength | 56-Day Strength | -Day Strength |
| 3670 | 4750 | | | |
| | 4860 | | | |
| Average: | Average: | Average: | Average: | Average: |
| 3670 | 4810 | | | |
| Break Date: | Break Date: | Break Date: | Break Date: | Break Date: |
| 9/25/2020 | 10/16/2020 | | | |

Remarks:
 28 Day Results

Specifications:
 4500 PSI, 5-8% Air, 4" Max Slump
 Summary Comments:
 Ideal Concrete, Action Ready Mix

Break Sequence:
 1@7, 2@28, 1@hold

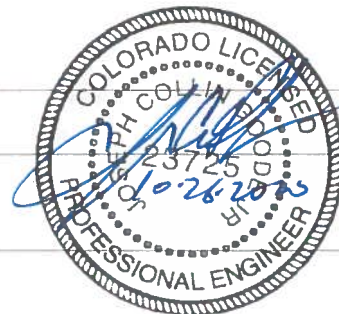

Reviewed By: *R.P.J.*