

## MEMORANDUM

---

To: El Paso County - Stormwater

---

From: Scott Maier, PE (Ayres Associates)

---

Date: October 19, 2023

EPC Project No.: PPR2315

---

Re: Super Star Carwash – Claremont Business Park 2 – Drainage Compliance Letter

---

---

### Background

Super Star Carwash is planning to construct a carwash located within the Claremont Business Park 2 located at the southwest corner of Marksheffel Road and Meadowbrook Parkway. The site is currently vacant and is 1.5+/- acres.

The proposed development will consist of a 5,000+/- square foot carwash building with access drives, parking areas with vacuum bays, patio areas, and landscaping. This lot was initially contemplated for development as part of the overall development of the Claremont Business Park 2, Filing No. 2 VR 233. The onsite runoff will be collected via onsite private storm sewers and curb and gutter. The runoff is conveyed to an onsite rain garden to provide water quality treatment. Peak runoff detention is not required for this project. The overall development will construct the storm sewer conveyance system to convey runoff from this site to the downstream outfall into the east fork of Sand Creek located southwest of this site and across Meadowbrook Parkway. The purpose of this letter is to demonstrate that the proposed development of the Super Star Carwash is in compliance with the assumptions of Claremont Business Park 2 Filing No. 2. The proposed development will discharge to an 18" RCP storm sewer system along El Jefe Heights that will be constructed as part of the overall development.

### Onsite Basins

Basins A1 and A2 are primarily the parking lot for the carwash. The flows from these basins will be collected via curb and gutter to storm sewer inlets and curb cuts that run to the water quality basin. These basins are primarily impervious except for the minor landscape areas.

Basin B1 is the carwash building. The flows from this basin will run (via roof drains to storm sewer) to the water quality basin. This basin is 100% impervious.

Basins A3, A4, A5, and A6 are landscape areas. These landscape areas are collected in area drains that convey the water to the water quality pond. These basins are pervious landscape areas.

Basin OFF is primarily the El Jefe Heights road. This basin is accounted for, and is part of, Basin E1 of the Claremont Business Park 2, Filing No. 2 drainage report.

## Runoff Comparison

The proposed development for the Super Star Carwash is part of Basin B within the Claremont Business Park 2 Filing No. 2 prepared by MS Civil Consultants, dated 6/11/23 as shown in the supporting documents. Below is a summary of the anticipated runoff from the overall drainage report.

Comparison Studies	Basin Area (acres)	Time of Concentration (min.)	Design Runoff Coefficient 5-yr	Design Runoff Coefficient 100-yr	Runoff (5 year) (CFS)	Runoff (100 year) (CFS)
Claremont Business Park 2 Filing No. 2 Basins A+B***	1.71	5.0	0.81	0.88	5.9	11.2
Super Star Carwash	1.8	5.0	C=0.44	C=0.67	2.95	10.09

\*\*\*Runoff noted is for design point 1 within the Claremont Business Park 2 Filing No. 2 drainage study (Not including Basin E1). Basin OFF of the superstar carwash plan is included in the calculations above; however, the runoff from basin off runs into Basin E1 of the Claremont Business Park 2 Filing No. 2. The runoff from basin OFF is a small landscape area and accounts for less than 20% of the site.

The proposed development for the Super Star Carwash will have less designed runoff than those contemplated in the Claremont Business Park 2 Filing No. 2 drainage studies even after adding in the offsite areas along Marksheffel Rd and Meadowbrook Parkway.

## Water Quality

Water Quality was not included as part of the improvements for the Claremont Business Park 2 Filing No. 2 overall development and is required to be constructed upon development. The Super Star Carwash proposes to construct a rain garden to serve the water quality requirements for it's development. A rain garden is an acceptable method of providing water quality treatment.

	WQCV Required	WQCV Provided	Method
Super Star Carwash Parking Lot and Building	0.022 Ac-Ft	0.03 Ac-Ft	Rain Garden

The rain garden is designed to have an underdrain system and an outfall to the west. As part of the proposed improvements, the site will drain a rain garden in the southern portion of the site.

After treatment the rain garden will enter the overall development storm sewer system to the west and ultimately discharge into the east fork of Sand Creek.

Super Star Carwash will follow the “Four-Step Process” as defined below:

**Step 1: Employ Runoff Reduction Practices**

The proposed development utilizes reduced pavement areas with the implementation of landscaped islands in the parking lot and around the building.

**Step 2: Stabilize Drainage Ways**

Proposed drainage ways have been stabilized through the implementation of a concrete drainage pan for water entering the rain garden. A grass drainage swale is located along the east side of the property to capture offsite runoff that enters the property.

**Step 3: Provide Water Quality Capture Volume (WQCV)**

WQCV is achieved through a rain garden that treats onsite runoff. The rain garden is located at the southern portion of the property and treats building and parking lot runoff as well as offsite runoff that enters the site from the east.

**Step 4: Consider Need for Industrial and Commercial BMP's**

The proposed site will implement silt fence, construction entrance, concrete washout area and inlet protection to limit erosion and sediment runoff across the site.

**Low Impact Development**

This development will propose to construct a rain garden as part of the development. The rain garden will provide water quality benefits by providing filtration and some infiltration. The engineered media within the rain garden will provide filtration of the runoff from the site. In addition to the filtration for smaller rain events infiltration will also be a benefit of the rain garden.

**Conclusion**

The proposed Super Star Carwash development complies with the Claremont Business Park 2 overall drainage study. The Super Star Carwash development will install the proposed rain garden to meet the water quality requirements of the onsite development.

In summary, the Super Star Carwash is in general compliance with the original development assumptions and no additional improvements to the storm sewer system beyond those noted is necessary.

**Design Engineer's Statement:**

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

\_\_\_\_\_  
Scott Maier, P.E. #38122



10/19/23

\_\_\_\_\_  
Date

**Owner/Developer Statement:**

I, the Owner/Developer had read and will comply with all of the requirements specific in the is drainage report and Plan

\_\_\_\_\_  
TIM VARLEY - Director  
[Name, Title ]

10/19/23  
\_\_\_\_\_  
Date

SSCW 22712 MEADOWBROOK LLC

\_\_\_\_\_  
*Business Name* SSCW 22712 MEADOWBROOK LLC  
960 W BEHREND DR, SUITE 2, PHOENIX, AZ 85027

\_\_\_\_\_  
*Address*

**El Paso County:**

Filed in accordance with the requirements of the Drainage Criteria Manual, Volume 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

\_\_\_\_\_  
*County Engineer/ECM Administrator*

\_\_\_\_\_  
Date

Conditions:



**FINAL DRAINAGE REPORT FOR CLAREMONT BUSINESS PARK 2 FILING NO.2  
PROPOSED DRAINAGE CALCULATIONS  
(Area Runoff Coefficient Summary)**

BASIN	TOTAL AREA (SF)	TOTAL AREA (Acres)	ROOFS 0.73-0.81 0.81-0.88 ASPHALT DRIVES 0.90-0.96				LANDSCAPED AREAS 0.16-0.41 GRAVEL STORAGE YARD 0.30-0.50 LIGHT INDUST AREAS 0.39-0.70				PARKS 0.12-0.39 GREENBELTS/AGRI. 0.09-0.36				WEIGHTED			
			AREA (Acres)	C <sub>1</sub>	C <sub>3</sub>	C <sub>100</sub>	AREA (Acres)	C <sub>3</sub>	C <sub>5</sub>	C <sub>100</sub>	AREA (Acres)	C <sub>2</sub>	C <sub>5</sub>	C <sub>100</sub>	C <sub>2</sub>	C <sub>5</sub>	C <sub>100</sub>	
A	9300.8	0.21	0.10	0.89	0.00	0.00	0.07	0.41	0.21	0.03	0.09	0.36	0.03	0.09	0.36	0.09		
B	65284.4	1.50	1.30	0.79	0.81	0.33	0.34	0.30	0.10	0.05	0.12	0.39	0.09	0.36	0.09	0.36		
C	5372.3	0.12	0.00	0.89	0.90	0.00	0.07	0.41	0.12	0.03	0.09	0.36	0.03	0.09	0.36	0.09		
CT	7457.3	0.17	0.00	0.89	0.90	0.00	0.07	0.41	0.17	0.03	0.09	0.36	0.03	0.09	0.36	0.09		
Σ	18440.8	0.49	0.77	0.70	0.82	0.00	0.21	0.20	0.00	0.05	0.15	0.20	0.05	0.15	0.20	0.20		

(EXHIBIT ABOVE IS PORTION OF Claremont Business Park 2 Filing No. 2 Proposed Drainage Calculations-Area Runoff Coefficient Summary)

**FINAL DRAINAGE REPORT FOR CLAREMONT BUSINESS PARK 2 FILING NO.2  
PROPOSED DRAINAGE CALCULATIONS  
(Area Drainage Summary)**

BASIN	Flow Area Based Coefficient Summary				OVERLAND				STREET / CHANNEL FLOW				Time of Travel (T <sub>t</sub> )				INTENSITY *				TOTAL FLOWS	
	AREA (Acres)	C <sub>1</sub>	C <sub>2</sub>	C <sub>3</sub>	C <sub>100</sub>	Length (ft)	Height (ft)	T <sub>c</sub> (min)	Slope (%)	Velocity (ft/s)	T <sub>t</sub> (min)	CHECK (min)	I <sub>1</sub> (ft/hr)	I <sub>2</sub> (ft/hr)	I <sub>3</sub> (ft/hr)	I <sub>100</sub> (ft/hr)	Q <sub>1</sub> (cfs)	Q <sub>2</sub> (cfs)	Q <sub>3</sub> (cfs)	Q <sub>100</sub> (cfs)		
A	0.21	0.03	0.79	0.81	0.36	40	5.0	5.0	0.0%	0.0	0.0	10.2	4.1	5.2	8.7	8.7	0.0	0.0	0.0	0.7		
B	1.50	0.79	0.81	0.88	0.36	80	1.0	4.4	1.7%	2.6	1.5	5.0	3.3	4.9	8.3	8.3	4.4	4.4	6.0	10.9		
C	0.12	0.03	0.09	0.36	0.09	40	16.0	3.4	0	0.0	0.0	5.0	4.1	5.2	8.7	8.7	0.0	0.0	0.0	0.4		
C1	0.17	0.03	0.09	0.36	0.09	60	22.0	4.3	0	0.0	0.0	5.0	10.3	5.2	8.7	8.7	0.0	0.0	0.0	0.7		
D	0.77	0.79	0.81	0.88	0.81	60	1.2	3.2	2.6%	2.5	1.6	5.0	11.7	4.1	5.2	8.7	2.5	2.5	3.2	5.9		
D1	0.78	0.79	0.81	0.88	0.81	60	1.2	3.2	2.6%	2.5	1.6	5.0	11.7	4.1	5.2	8.7	2.5	2.5	3.1	6.0		
E1	0.27	0.87	0.88	0.95	0.88	30	0.6	1.7	2.0%	2.8	1.7	5.0	11.7	4.1	5.2	8.7	1.0	1.0	1.2	2.2		
E2	0.21	0.87	0.88	0.95	0.88	30	0.6	1.7	2.0%	2.8	1.7	5.0	11.7	4.1	5.2	8.7	0.7	0.7	1.0	1.7		
F	0.30	0.79	0.81	0.88	0.81	60	1.2	3.2	1.3%	2.3	1.1	5.0	11.2	4.1	5.2	8.7	1.0	1.0	1.2	2.3		
G1	0.27	0.25	0.30	0.32	0.30	30	1.0	5.3	0	0.0	0.0	5.3	10.2	4.1	5.1	8.5	0.4	0.4	0.4	1.2		
G2	1.15	0.79	0.81	0.88	0.81	60	0.6	4.1	1.0%	2.0	3.3	7.4	12.6	3.7	4.6	7.7	2.3	2.3	4.3	7.8		
H1	0.16	0.03	0.04	0.36	0.09	76	20.0	5.4	0	0.0	0.0	5.4	10.4	4.0	5.1	8.5	0.0	0.0	0.0	0.5		
H2	0.40	0.03	0.09	0.36	0.09	100	17.0	7.2	0	0.0	0.0	7.2	10.6	3.7	4.6	7.8	0.0	0.0	0.2	1.1		
H3	0.04	0.03	0.09	0.36	0.09	100	17.0	7.2	0	0.0	0.0	7.2	10.6	3.7	4.6	7.8	0.0	0.0	0.0	0.1		
H4	0.10	0.03	0.09	0.36	0.09	100	17.0	7.2	0	0.0	0.0	7.2	10.6	3.7	4.6	7.8	0.0	0.0	0.0	0.2		
H5	0.56	0.82	0.83	0.90	0.83	100	3.0	3.4	2.1%	3.2	1.1	5.0	11.8	4.1	5.2	8.7	1.0	1.0	2.1	4.3		
I1	0.48	0.77	0.78	0.87	0.78	60	7.0	5.5	1.0%	5.0	5.3	5.0	11.7	4.1	5.3	8.7	1.4	1.4	3.0	7.4		

(EXHIBIT ABOVE IS PORTION OF Claremont Business Park 2 Filing No. 2 Proposed Drainage Calculations-Area Drainage Summary)

# FINAL DRAINAGE REPORT FOR CLAREMONT BUSINESS PARK 2 FILING NO.1 COUNTY OF EL PASO, STATE OF COLORADO PROPOSED CONDITIONS DRAINAGE MAP

MAY 2023

### LEGEND

- Z  
25  
1.25  
0.35 BASIN DESIGNATION
- 4 PIPE RUN REFERENCE LABEL
- 6 SURFACE DESIGN POINT
- BASIN BOUNDARY
- EXISTING CONTOUR
- PROP CONTOUR
- UGE
- EXISTING GAS LINE
- STORM SEWER PIPE
- EXISTING STORM SEWER PIPE
- CROSSSPAN
- INLET
- EXISTING FLOW DIRECTION
- EMERGENCY OVERFLOW DIRECTION
- FLOW DIRECTION
- FLARED END SECTION
- H.P. HIGH POINT
- L.P. LOW POINT

### BASIN SUMMARY

BASIN	AREA (ACRES)	Q <sub>5</sub>	Q <sub>100</sub>
A	0.21	0.1	0.7
B	1.50	6.0	10.9
C	0.12	0.1	0.4
C1	0.17	0.1	0.5
D	0.77	3.2	5.9
D1	0.78	3.3	6.0
E1	0.27	1.2	2.2
E2	0.21	1.0	1.7
F	0.30	1.2	2.3
G1	0.27	0.4	1.2
G2	1.15	4.3	7.8
H1	0.16	0.1	0.5
H2	0.40	0.2	1.1
H3	0.04	0.0	0.1
H4	0.10	0.0	0.3
I1	0.55	2.3	4.3
I2	0.48	2.0	3.6
I3	0.45	1.8	3.3
I4	0.55	2.3	4.2
I5	0.23	0.9	1.7
I6	0.19	0.6	1.2
I7	0.23	0.9	1.6
J1	0.69	2.7	5.1
J2	0.25	1.0	1.8
J3	0.01	0.0	0.1
K1	0.17	0.7	1.3
K2	0.05	0.2	0.4
K3	0.15	0.6	1.1
K4	0.05	0.2	0.4
L	1.32	5.3	9.7
M1	0.28	1.2	2.2
M2	0.24	0.8	1.5
M3	0.37	1.6	2.9
M4	0.98	3.5	6.6
N1	0.06	0.3	0.5
N2	0.41	0.2	1.1
O1	0.12	0.1	0.4
O2	0.06	0.1	0.3
P	0.11	0.0	0.3

### DESIGN POINT SUMMARY

DESIGN POINT	Q <sub>5</sub>	Q <sub>100</sub>	BASIN	STRUCTURE
1	5.9	11.2	A, B	18" PP
2				OMITTED
3	1.2	2.3	F	18" PP
4	1.0	1.7	E2	PROP 5" INLET
5	1.2	2.2	E1	PROP 5" INLET
6	7.8	14.6	C, D, C1, D1, PR6	WO POND 3
7	4.7	8.7	G2	EX STREET
8	2.2	4.3	H1, I1	EX STREET
9	1.8	4.1	H2, I2	EX STREET
10	0.8	1.6	H3, I7	EX STREET
11	8.4	16.7	DP3-5, I3-16	EX 15" INLETS
12	2.8	8.1	FB INLETS, J1	EX 15" INLET
13	1.0	5.0	FB INLETS, J2, J3	EX 15" INLET
14	3.8	9.7	H4, L, M4	EX SWALE
15	5.3	12.3	DP9, M2, M3	EX SWALE/RD
16	1.4	2.5	M1, K4	EX CONC. RD
17	1.1	2.0	K2, K3, N1	EX CONC. RD
18	0.7	1.3	K1	EX AREA INLET
19	19.3	43.7	DP15-17, N2, PR14, PR17	EX FSD POND 2

### STORM SEWER SUMMARY

PIPE RUN	Q <sub>5</sub>	Q <sub>100</sub>	PIPE SIZE	CONTRIBUTING DP/BASIN/PIPES
1	2.4	5.7	18"	FUT POND 1 OUTFALL
2			NOT USED	
3	0.4	1.0	18"	FUT POND 4 OUTFALL
4	3.9	6.7	24"	PR1-PR3
5	1.0	1.7	18"	DP4
6	2.2	3.9	18"	PR5, DP5
6A	6.0	11.6	18"	C, C1, 90% D, D1
7	3.3	4.0	18"	POND 3 OUTFALL
8	6.1	10.7	24"	PR4, PR7
9	1.3	3.0	18"	FUT POND 5 OUTFALL
10	7.4	13.8	24"	PR8, PR9
11	7.4	13.8	24"/EX24"	PR10
12	7.4	13.8	EX 24"	PR11
13	4.2	8.0	EX 15"	INLET 3
14	8.4	16.0	EX 24"	PR13, INLET 4
15	2.8	7.8	EX 18"	INLET 5
16	3.7	12.6	EX 24"	PR15, INLET 6
17	4.4	13.8	EX 24"	PR16, DP18
18	13.7	23.8	EX 30"	EX POND 2 OUTFALL
19	21.1	37.6	EX 42"	DP18, PR12

### SF WQCV FUTURE PONDS SUMMARY


PIPE RUN	Q <sub>5</sub>	Q <sub>100</sub>	PIPE SIZE	CONTRIBUTING DP/BASIN/PIPES
1	2.4	5.7	18"	FUT POND 1 OUTFALL
2			NOT USED	
3	0.4	1.0	18"	FUT POND 4 OUTFALL
4	3.9	6.7	24"	PR1-PR3
5	1.0	1.7	18"	DP4
6	2.2	3.9	18"	PR5, DP5
6A	6.0	11.6	18"	C, C1, 90% D, D1
7	3.3	4.0	18"	POND 3 OUTFALL
8	6.1	10.7	24"	PR4, PR7
9	1.3	3.0	18"	FUT POND 5 OUTFALL
10	7.4	13.8	24"	PR8, PR9
11	7.4	13.8	24"/EX24"	PR10
12	7.4	13.8	EX 24"	PR11
13	4.2	8.0	EX 15"	INLET 3
14	8.4	16.0	EX 24"	PR13, INLET 4
15	2.8	7.8	EX 18"	INLET 5
16	3.7	12.6	EX 24"	PR15, INLET 6
17	4.4	13.8	EX 24"	PR16, DP18
18	13.7	23.8	EX 30"	EX POND 2 OUTFALL
19	21.1	37.6	EX 42"	DP18, PR12

### SF WQCV POND 3 SUMMARY

PIPE RUN	Q <sub>5</sub>	Q <sub>100</sub>	PIPE SIZE	CONTRIBUTING DP/BASIN/PIPES
1	2.4	5.7	18"	FUT POND 1 OUTFALL
2			NOT USED	
3	0.4	1.0	18"	FUT POND 4 OUTFALL
4	3.9	6.7	24"	PR1-PR3
5	1.0	1.7	18"	DP4
6	2.2	3.9	18"	PR5, DP5
6A	6.0	11.6	18"	C, C1, 90% D, D1
7	3.3	4.0	18"	POND 3 OUTFALL
8	6.1	10.7	24"	PR4, PR7
9	1.3	3.0	18"	FUT POND 5 OUTFALL
10	7.4	13.8	24"	PR8, PR9
11	7.4	13.8	24"/EX24"	PR10
12	7.4	13.8	EX 24"	PR11
13	4.2	8.0	EX 15"	INLET 3
14	8.4	16.0	EX 24"	PR13, INLET 4
15	2.8	7.8	EX 18"	INLET 5
16	3.7	12.6	EX 24"	PR15, INLET 6
17	4.4	13.8	EX 24"	PR16, DP18
18	13.7	23.8	EX 30"	EX POND 2 OUTFALL
19	21.1	37.6	EX 42"	DP18, PR12

### POND 3 SAND FILTER DETENTION BASIN DATA

WO WATER SURFACE EL = 6371.78
WO VOLUME=0.051 AC-FT
100-YR WATER SURFACE EL=6373.36
100-YR VOLUME=0.153 AC-FT
SPILLWAY CREST EL=6375.30
TOP OF EMBANKMENT EL=6376.55
RATIONAL 100-YR INFLOW=14.8 CFS
MHFD 100-YR INFLOW = 9.0 CFS
MHFD 100-YR RELEASE = 4.0 CFS

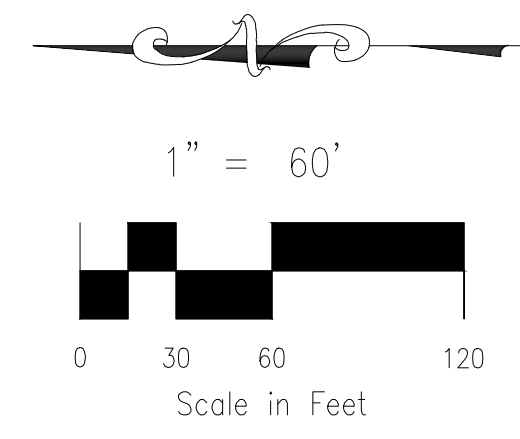


102 E. PIKES PEAK AVE., 5TH FLOOR  
COLORADO SPRINGS, CO 80903  
PHONE: 719.955.5485

### CLAREMONT BUSINESS PARK 2 FIL. NO.2 PROP. CONDITIONS DRAINAGE MAP

PROJECT NO. 10-022A FILE: \dwg\Eng Exhibits\10020 PDM.dwg

DESIGNED BY: DLM	SCALE: DATE: 05-17-2023
DRAWN BY: DLM	HORIZ: 1"=60'
CHECKED BY: VAS	VERT: N/A

SHEET 1 OF 1 PDM01

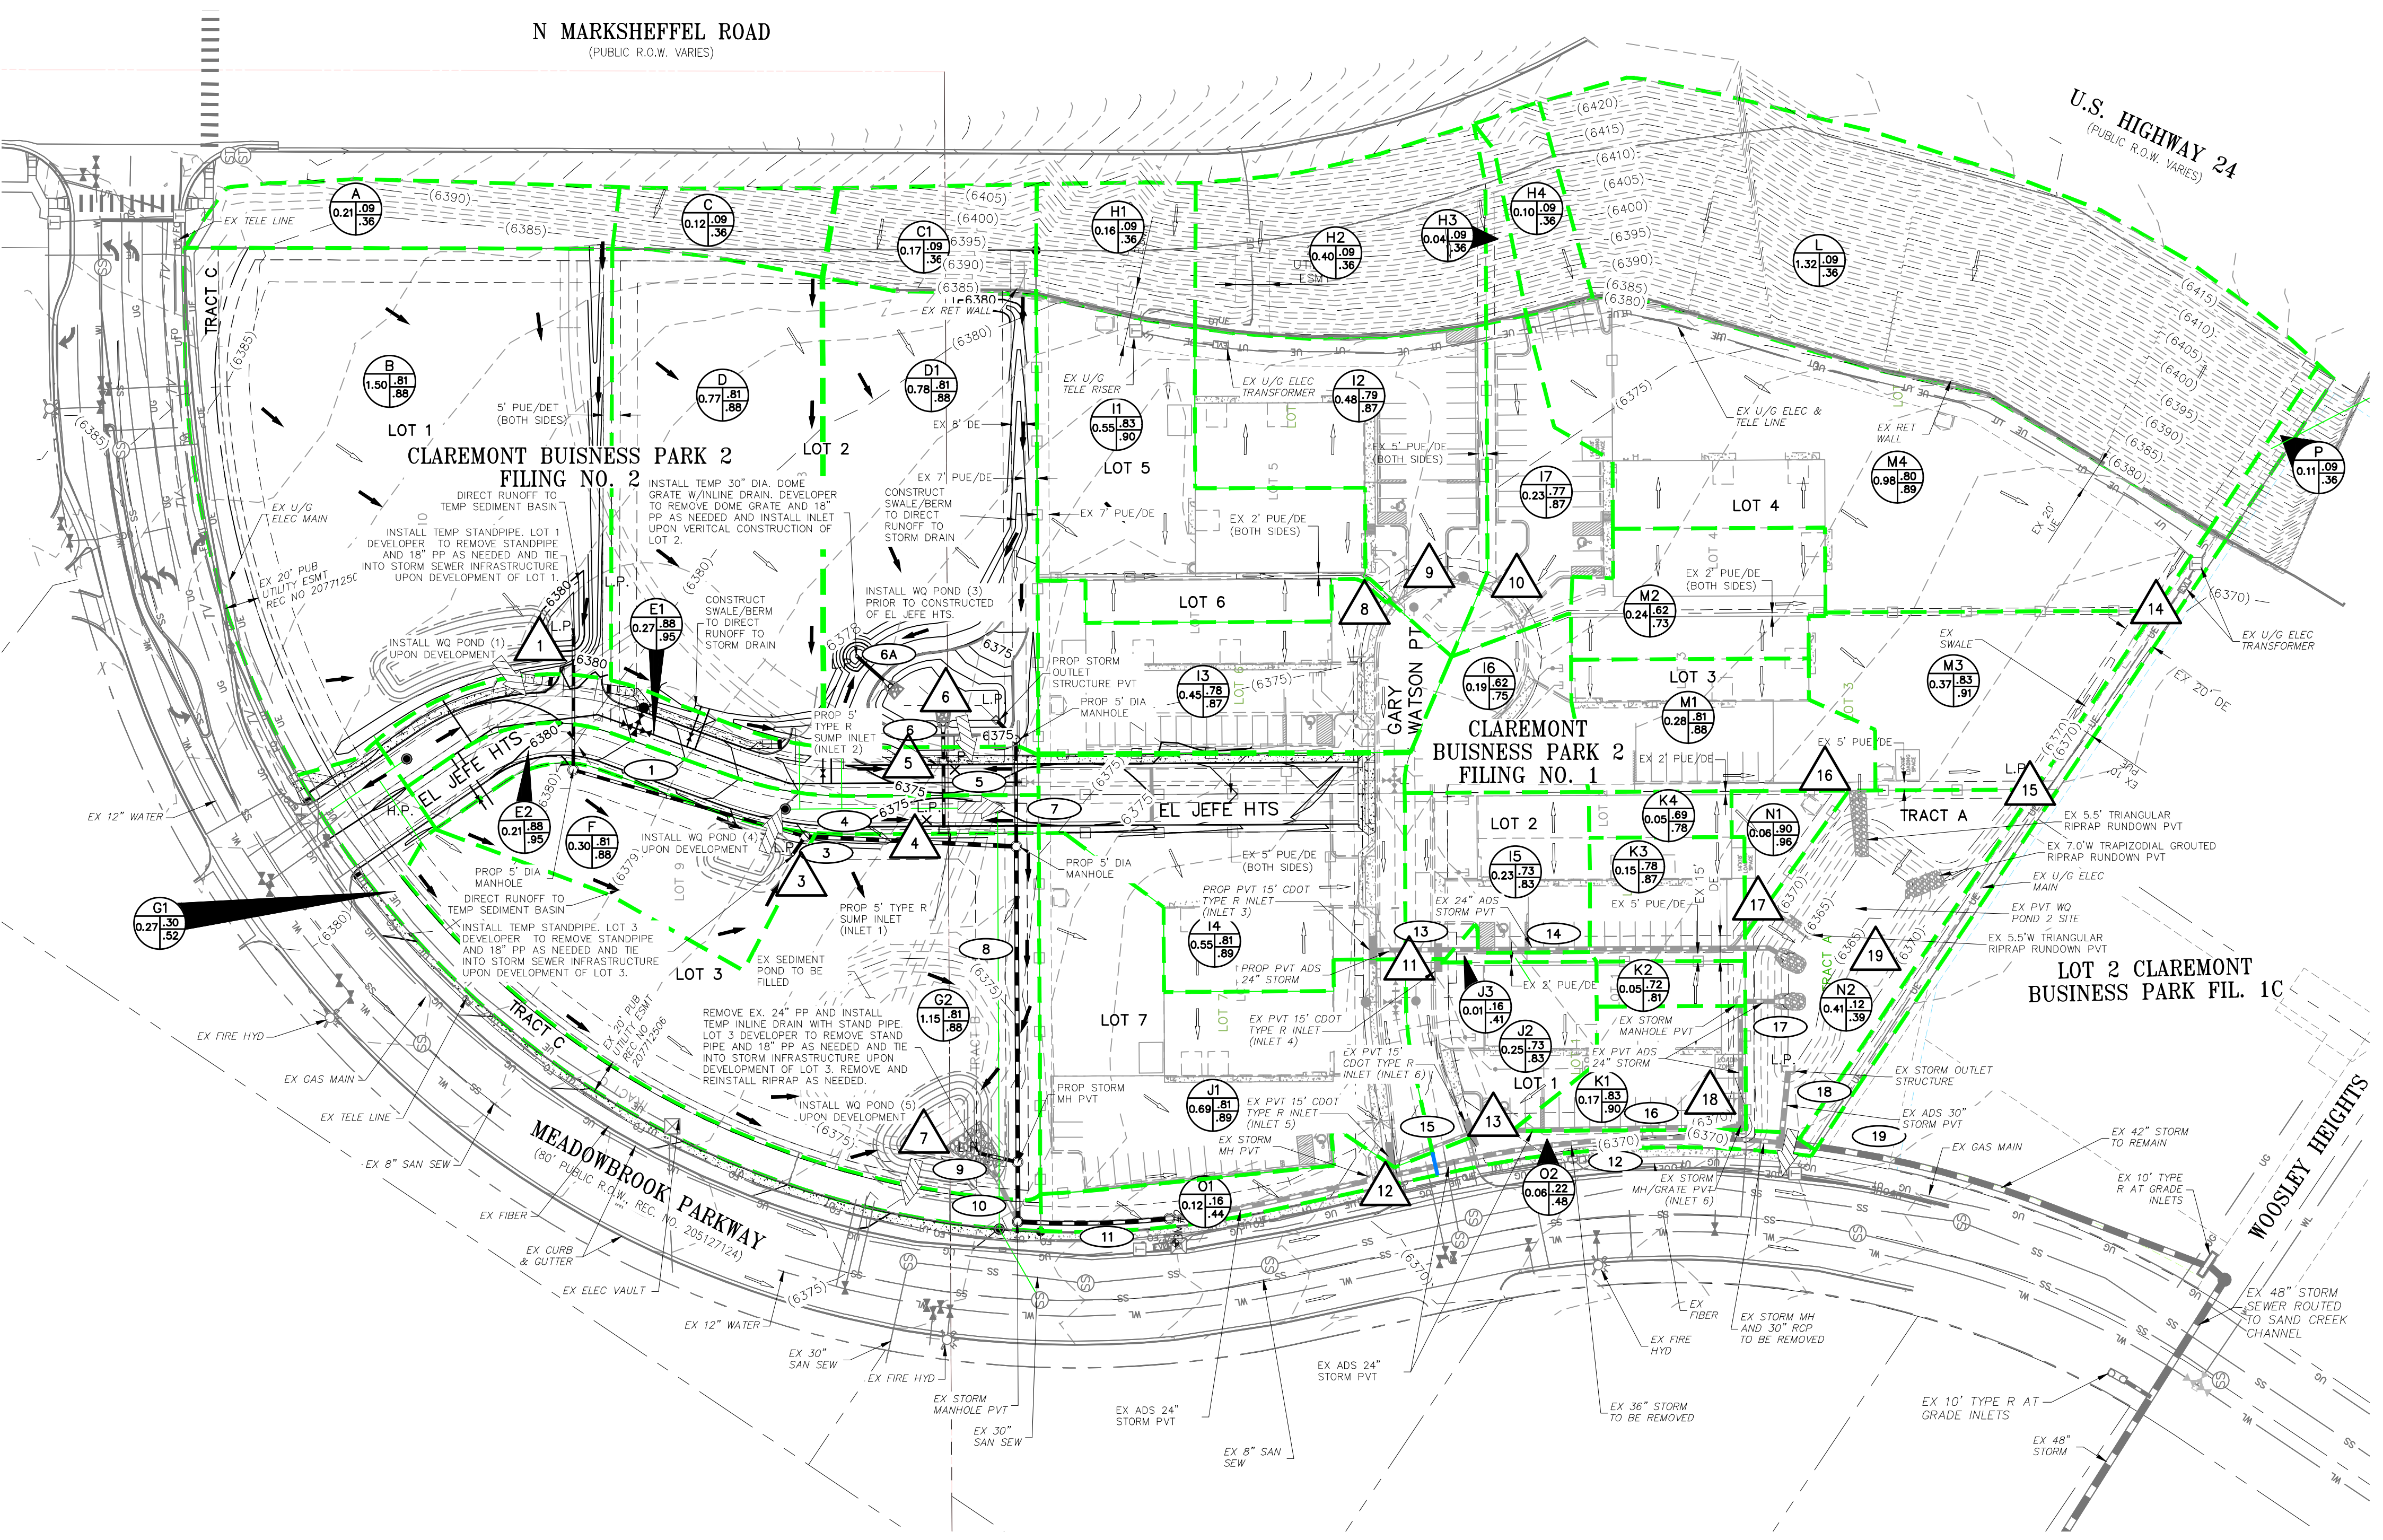

File: C:\10020\Eng\Drawings\Drainage\Map\10020\_PDM.dwg Plotstamp: 5/24/2023 10:39 AM

FOR LOCATING & MARKING GAS, ELECTRIC, WATER & TELEPHONE LINES  
FOR BURIED UTILITY INFORMATION 48 HRS BEFORE YOU DIG CALL 1-800-922-1987



# **Super Star Carwash Onsite Drainage Calculations**




REVISION	DATE
RESUBMITTAL #1	7/25/2023
RESUBMITTAL #2	9/18/2023
RESUBMITTAL #3	10/20/2023


**SUPERSTAR CARWASH**  
MEADOWBROOK PKWY  
COLORADO SPRING, CO 80915  
**DRAINAGE PLAN**

Drawn By: AJJ  
Checked By: SEM  
Date: 10/20/2023  
Project No. 24-0409  
Sheet Number

**C5.1**

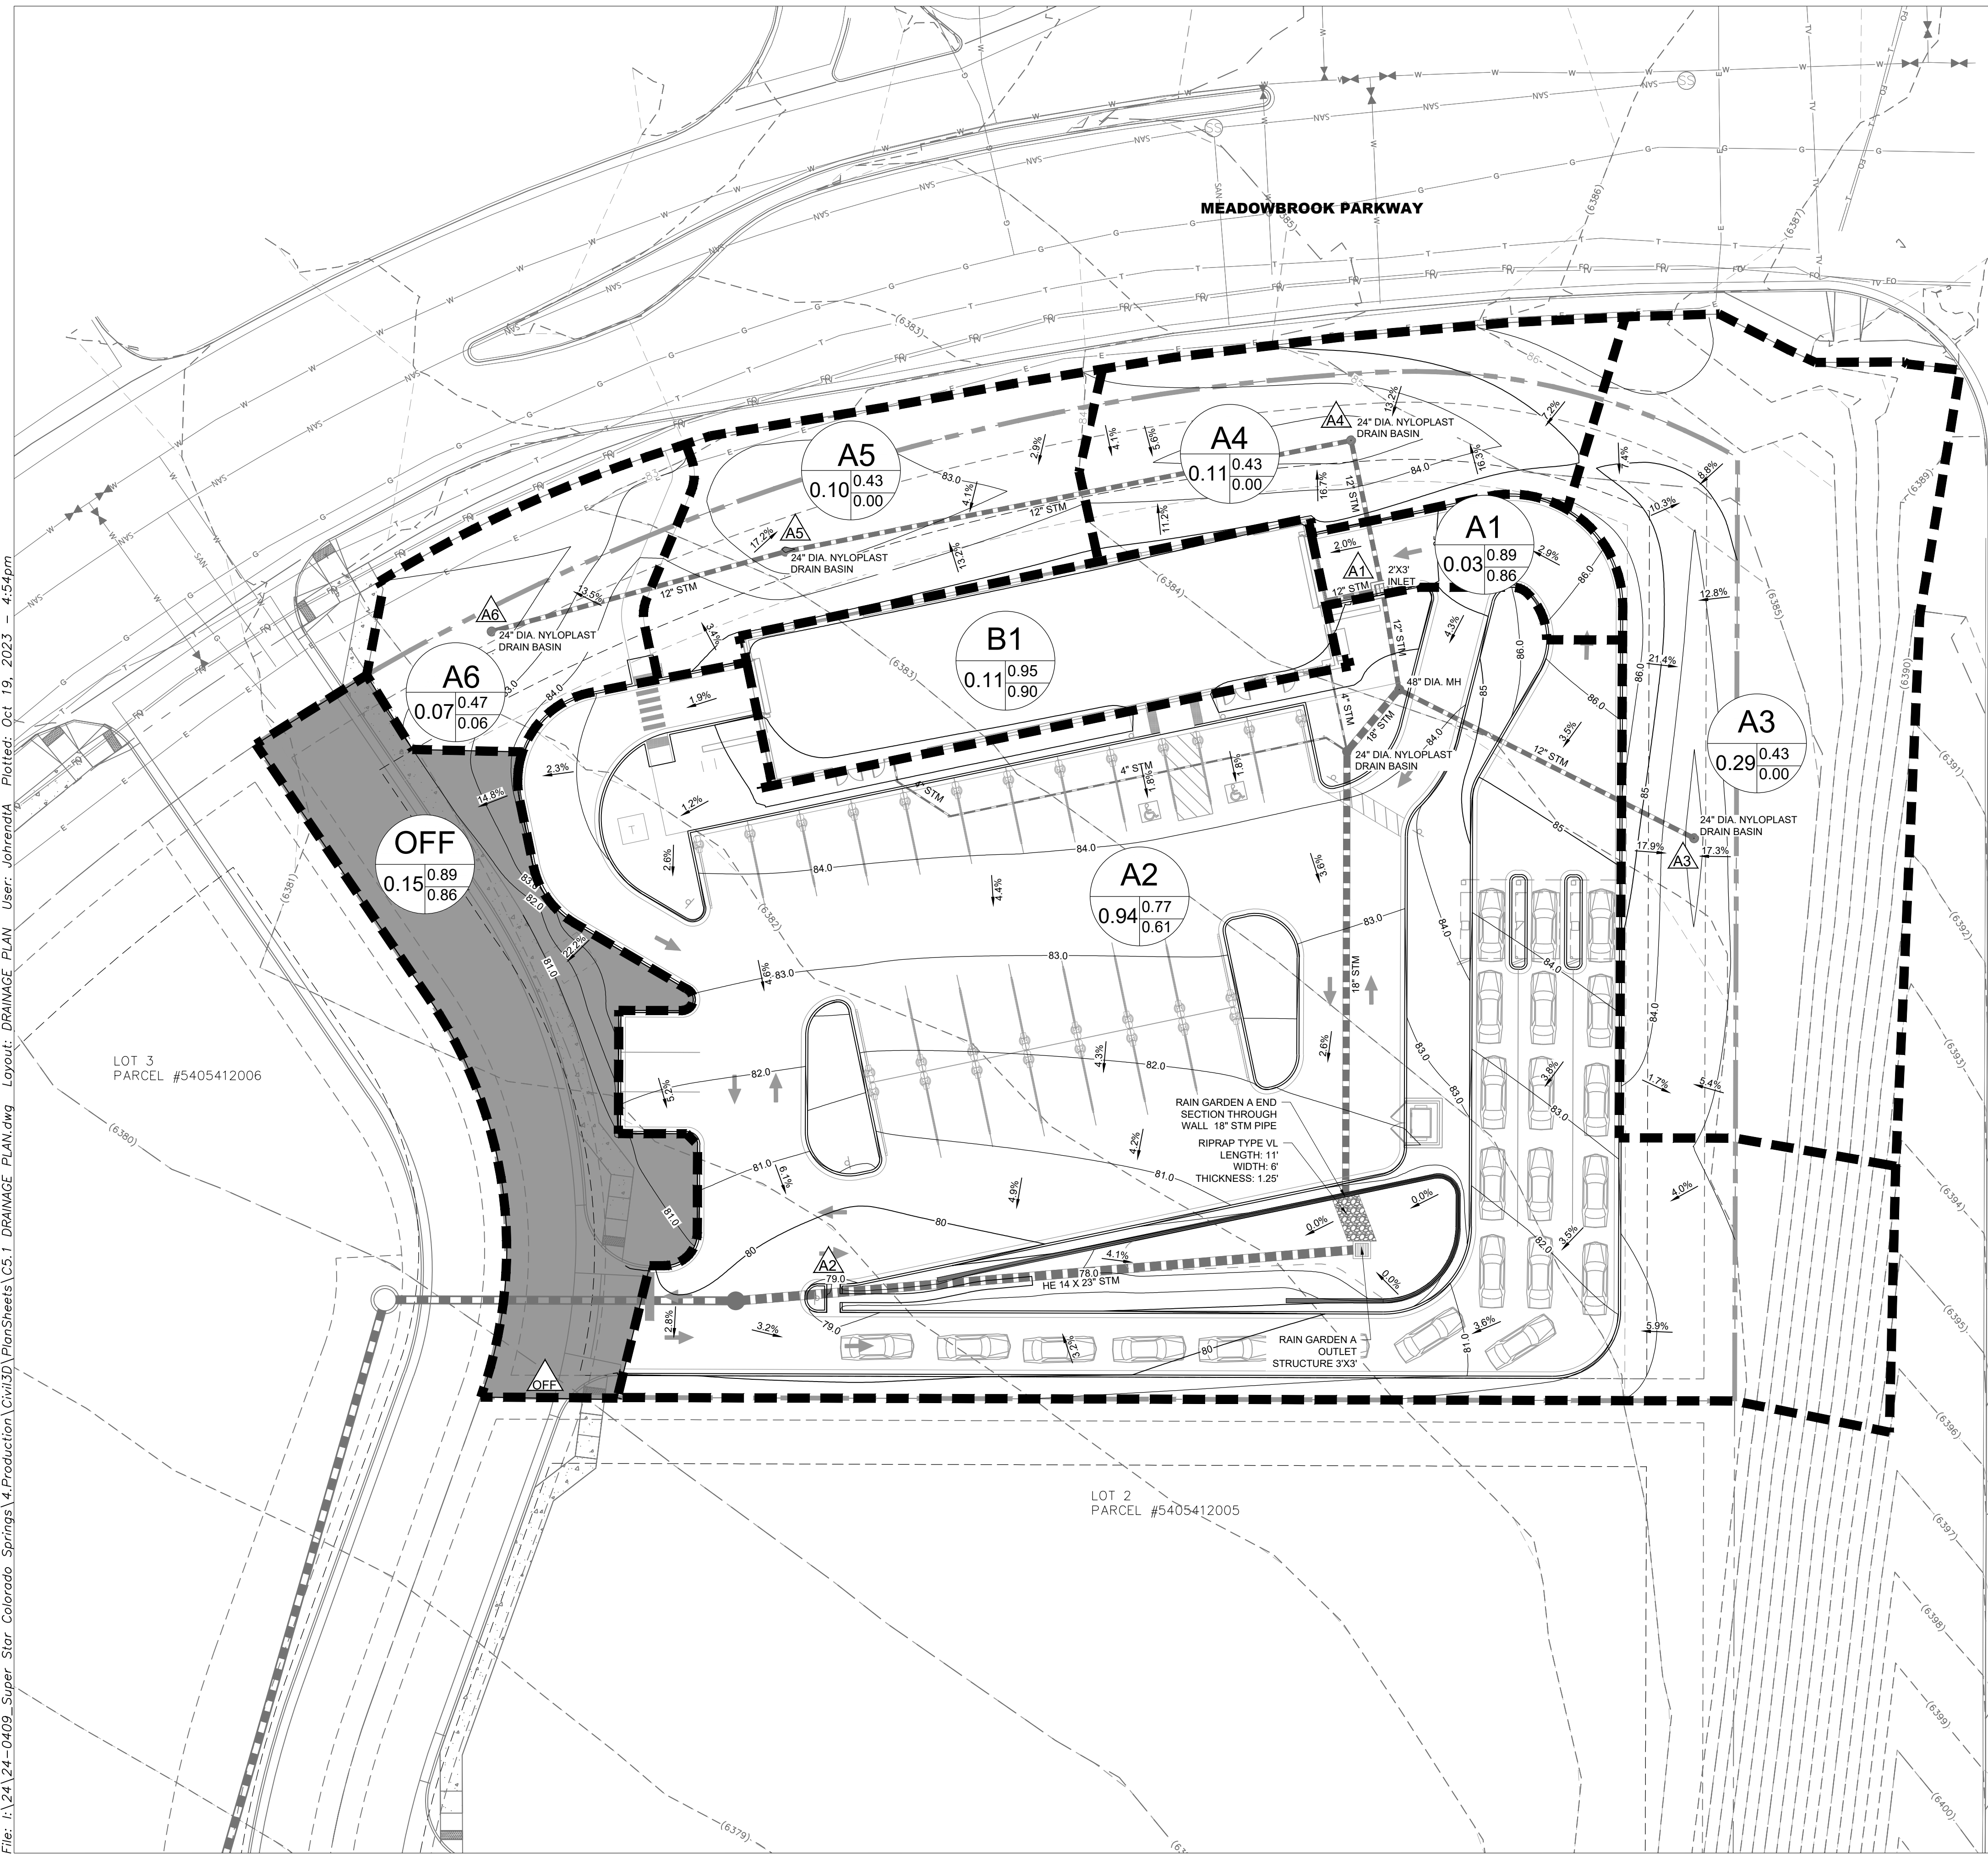


DESIGN POINT	INTERNAL ROUTING	AREA (AC)	5-YR RUNOFF (CFS)	100-YR RUNOFF
A1	2'x3' CURB INLET TO RAIN GARDEN VIA STORM SEWER PIPE	0.03	0.10	0.23
A2	SHEET FLOW TO RAIN GARDEN VIA STORM SEWER PIPE	0.94	2.15	6.30
A3	24" NYLOPLAST TO RAIN GARDEN VIA STORM SEWER PIPE	0.29	0.00	0.86
A4	24" NYLOPLAST TO RAIN GARDEN VIA STORM SEWER PIPE	0.11	0.00	0.33
A5	24" NYLOPLAST TO RAIN GARDEN VIA STORM SEWER PIPE	0.10	0.00	0.31
A6	24" NYLOPLAST TO RAIN GARDEN VIA STORM SEWER PIPE	0.07	0.01	0.23
B1	BUILDING ROOF DRAIN TO RAIN GARDEN VIA STORM SEWER PIPE	0.11	0.34	0.82
OFF	OFFSITE TO PRIVATE DRIVE (9% OF DISTURBED AREA)	0.15	0.35	1.01

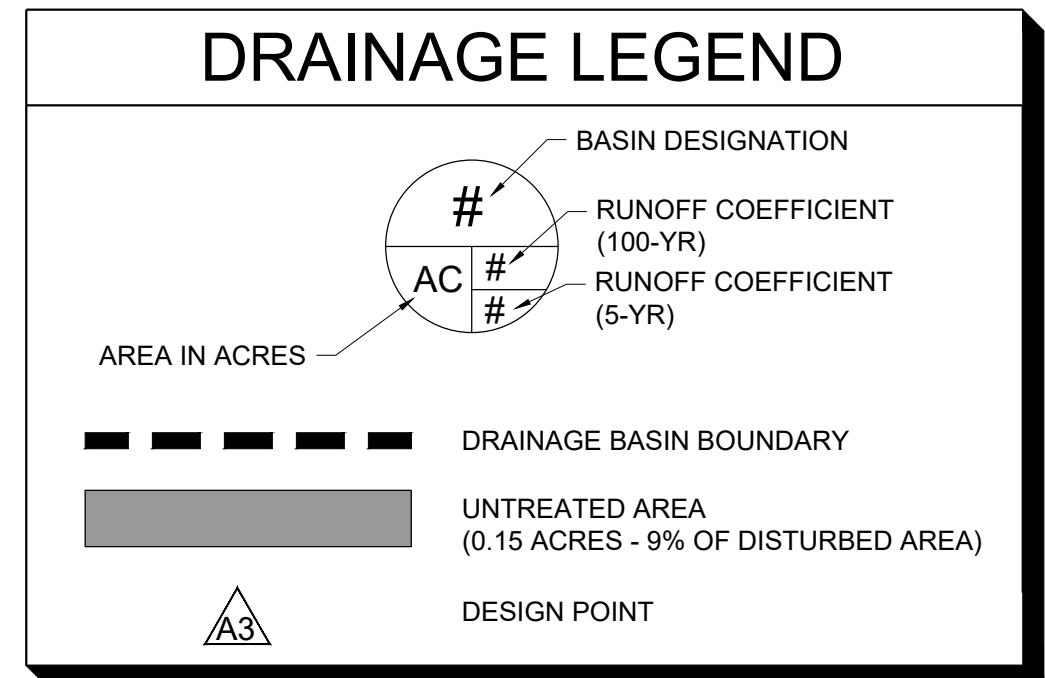

**Design Engineer's Statement:**

This grading and erosion control plan was prepared under my direction and supervision and is correct to the best of my knowledge and belief. Said plan has been prepared according to the criteria established by the County for grading and erosion control plans. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this plan.

SCOTT MAIER, P.E. 10/19/23  
[Name, P.E. # 38122] Date

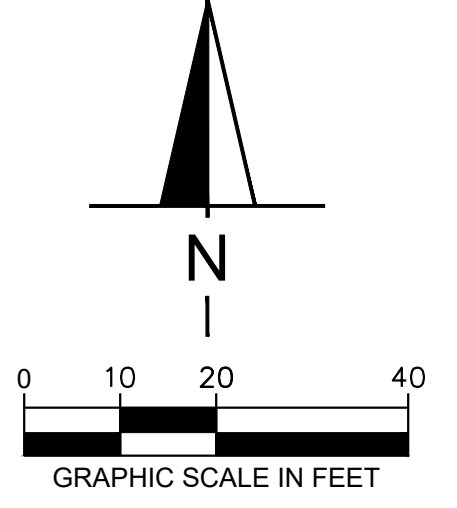

# Area-Weighted Runoff Coefficient Calculations

Version 2.00 released May 2017


Designer: Scott Maier

Company: Ayres Associates

Date: 9/11/2023

Project: SUPER STAR CAR WASH

Location: MEADOWBROOK, Mesa County

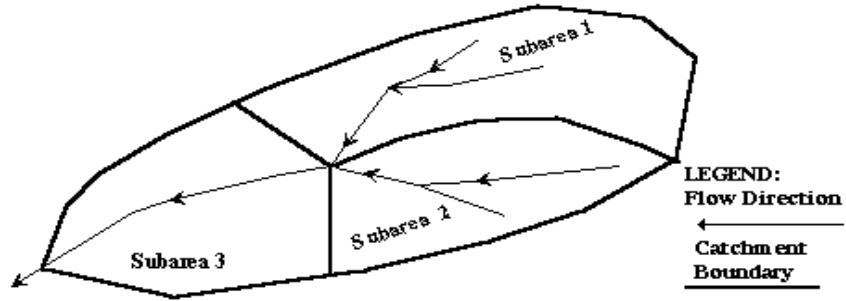

Subcatchment Name

Cells of this color are for required user-input
Cells of this color are for optional override values
Cells of this color are for calculated results based on overrides

See sheet "Design Info" for imperviousness-based runoff coefficient values.

Sub-Area ID	Area (ac)	NRCS Hydrologic Soil Group	Percent Imperviousness	Runoff Coefficient, C						
				2-yr	5-yr	10-yr	25-yr	50-yr	100-yr	500-yr
Basin A1	0.03	B	100.0	0.84	0.86	0.86	0.88	0.89	0.89	0.90
Basin A2	0.94	B	73.0	0.58	0.61	0.65	0.71	0.74	0.77	0.80
Basin A3	0.29	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54
Basin A4	0.11	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54
Basin A5	0.10	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54
Basin A6	0.07	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54
Basin B1	0.11	B	100.0	0.84	0.86	0.86	0.88	0.89	0.89	0.90
OFF	0.15	B	74.0	0.59	0.62	0.65	0.71	0.74	0.77	0.81
<b>Total Area (ac)</b>	<b>1.80</b>	<b>Area-Weighted C</b>		<b>0.42</b>	<b>0.44</b>	<b>0.48</b>	<b>0.58</b>	<b>0.62</b>	<b>0.67</b>	<b>0.73</b>
<b>Area-Weighted Override C</b>				<b>0.42</b>	<b>0.44</b>	<b>0.48</b>	<b>0.58</b>	<b>0.62</b>	<b>0.67</b>	<b>0.73</b>

### Calculation of Peak Runoff using Rational Method

Designer: Scott Maier  
 Company: Ayres Associates  
 Date: 10/19/2023  
 Project: SUPER STAR CAR WASH  
 Location: MEADOWBROOK, Mesa County

Version 2.00 released May 2017

Cells of this color are for required user-input  
 Cells of this color are for optional override values  
 Cells of this color are for calculated results based on overrides

$$t_1 = \frac{0.395(1.1 - C_5)\sqrt{L_1}}{S^{0.33}}$$

$$t_1 = \frac{L_1}{60K\sqrt{S_1}} = \frac{L_1}{60V_1}$$

Computed  $t_c = t_1 + t_t$

Regional  $t_c = (26 - 17i) + \frac{L_1}{60(14i + 9)\sqrt{S_1}}$

$t_{\text{minimum}} = 5$  (urban)  
 $t_{\text{minimum}} = 10$  (non-urban)

Selected  $t_c = \max\{t_{\text{minimum}}, \min(\text{Computed } t_c, \text{Regional } t_c)\}$

Select UDFCD location for NOAA Atlas 14 Rainfall Depths from the pulldown list OR enter your own depths obtained from the NOAA website (click this link)

1-hour rainfall depth, P1 (in)	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr	500-yr
	0.83	1.11	1.38	1.69	2.17	2.58	3.14

Rainfall Intensity Equation Coefficients =  $\frac{a}{b + t_c^c}$   
 a = 28.50, b = 10.00, c = 0.786  
 $I(\text{in/hr}) = \frac{a \cdot P_1}{(b + t_c)^c}$

$Q(\text{cfs}) = CIA$


Subcatchment Name	Area (ac)	NRCS Hydrologic Soil Group	Percent Imperviousness	Runoff Coefficient, C							Overland (Initial) Flow Time				Channelized (Travel) Flow Time					Time of Concentration			Rainfall Intensity, I (in/hr)							Peak Flow, Q (cfs)									
				2-yr	5-yr	10-yr	25-yr	50-yr	100-yr	500-yr	Overland Flow Length L <sub>1</sub> (ft)	U/S Elevation (ft) (Optional)	D/S Elevation (ft) (Optional)	Overland Flow Slope S <sub>1</sub> (ft/ft)	Overland Flow Time t <sub>1</sub> (min)	Channelized Flow Length L <sub>1</sub> (ft)	U/S Elevation (ft) (Optional)	D/S Elevation (ft) (Optional)	Channelized Flow Slope S <sub>1</sub> (ft/ft)	NRCS Conveyance Factor K	Channelized Flow Velocity V <sub>1</sub> (ft/sec)	Channelized Flow Time t <sub>1</sub> (min)	Computed t <sub>c</sub> (min)	Regional t <sub>c</sub> (min)	Selected t <sub>c</sub> (min)	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr	500-yr	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr	500-yr
Basin A1	0.03	B	100.0	0.84	0.86	0.86	0.88	0.89	0.89	0.90	10.00			0.250	0.48	20.00			0.010	20	2.00	0.17	0.65	9.14	5.00	2.80	3.76	4.68	5.73	7.36	8.75	10.65	0.07	0.10	0.12	0.15	0.20	0.23	0.29
Basin A2	0.94	B	73.0	0.58	0.61	0.65	0.71	0.74	0.77	0.80	20.00			0.050	2.33	200.00			0.015	20	2.45	1.36	3.69	15.01	5.00	2.80	3.76	4.68	5.73	7.36	8.75	10.65	1.52	2.15	2.84	3.81	5.09	6.30	8.04
Basin A3	0.29	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54	20.00			0.020	7.07	100.00			0.010	15	1.50	1.11	8.18	27.85	10.00	2.23	3.00	3.73	4.57	5.87	6.98	8.50	0.00	0.00	0.06	0.33	0.56	0.86	1.32
Basin A4	0.11	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54	20.00			0.020	7.07	30.00			0.020	15	2.12	0.24	7.30	26.39	10.00	2.23	3.00	3.73	4.57	5.87	6.98	8.50	0.00	0.00	0.02	0.13	0.21	0.33	0.50
Basin A5	0.10	B	0.0	0.00	0.00	0.06	0.25	0.33	0.43	0.54	20.00			0.250	3.07	30.00			0.030	15	2.60	0.19	3.26	26.32	10.00	2.23	3.00	3.73	4.57	5.87	6.98	8.50	0.00	0.00	0.02	0.12	0.20	0.31	0.47
Basin A6	0.07	B	9.0	0.05	0.06	0.13	0.31	0.38	0.47	0.57	20.00			0.050	4.93	10.00			0.043	15	3.11	0.05	4.98	24.55	10.00	2.23	3.00	3.73	4.57	5.87	6.98	8.50	0.01	0.01	0.03	0.10	0.16	0.23	0.34
Basin B1	0.11	B	100.0	0.84	0.86	0.86	0.88	0.89	0.89	0.90	20.00			0.020	1.56	50.00			0.020	20	2.83	0.29	1.86	9.26	5.00	2.80	3.76	4.68	5.73	7.36	8.75	10.65	0.25	0.34	0.42	0.53	0.68	0.82	1.01
OFF	0.15	B	74.0	0.59	0.62	0.65	0.71	0.74	0.77	0.81	10.00					150.00			0.020	20	2.63	0.88		14.33	5.00	2.80	3.76	4.68	5.73	7.36	8.75	10.65	0.25	0.35	0.46	0.61	0.82	1.01	1.29

## **Super Star Carwash Soil Information**

Hydrologic Soil Group—El Paso County Area, Colorado



Soil Map may not be valid at this scale.

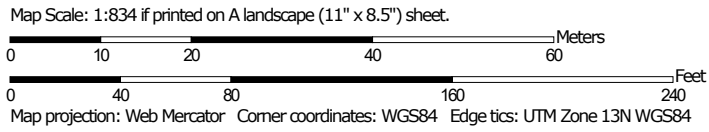

### MAP LEGEND

**Area of Interest (AOI)**









 Area of Interest (AOI)

**Soils**

**Soil Rating Polygons**





-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

**Soil Rating Lines**

-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

**Soil Rating Points**






-  A
-  A/D
-  B
-  B/D

-  C
-  C/D
-  D
-  Not rated or not available


**Water Features**

 Streams and Canals

**Transportation**

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

**Background**

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

**Warning:** Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 20, Sep 2, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 19, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	A	0.0	0.5%
10	Blendon sandy loam, 0 to 3 percent slopes	B	1.4	58.1%
28	Ellicott loamy coarse sand, 0 to 5 percent slopes	A	1.0	41.3%
<b>Totals for Area of Interest</b>			<b>2.4</b>	<b>100.0%</b>

### Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.



## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Higher

# **Super Star Carwash Onsite Water Quality Basin Calculations**

## Design Procedure Form: Rain Garden (RG)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 2

**Designer:** Scott Maier  
**Company:** Ayres Associates  
**Date:** October 19, 2023  
**Project:** Super Star Carwash  
**Location:** Meadowbrook

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, <math>I_a</math> (100% if all paved and roofed areas upstream of rain garden)</p> <p>B) Tributary Area's Imperviousness Ratio (<math>i = I_a/100</math>)</p> <p>C) Water Quality Capture Volume (WQCV) for a 12-hour Drain Time (<math>WQCV = 0.8 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i)</math>)</p> <p>D) Contributing Watershed Area (including rain garden area)</p> <p>E) Water Quality Capture Volume (WQCV) Design Volume <math>Vol = (WQCV / 12) * Area</math></p> <p>F) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p>	<p><math>I_a = </math> <input style="width: 50px;" type="text" value="50.0"/> %</p> <p><math>i = </math> <input style="width: 50px;" type="text" value="0.500"/></p> <p>WQCV = <input style="width: 50px;" type="text" value="0.17"/> watershed inches</p> <p>Area = <input style="width: 50px;" type="text" value="71.874"/> sq ft</p> <p><math>V_{WQCV} = </math> <input style="width: 50px;" type="text" value=""/></p> <p><math>d_e = </math> <input style="width: 50px;" type="text" value="0.42"/> in</p> <p><math>V_{WQCV\ OTHER} = </math> <input style="width: 50px;" type="text" value="965"/> cu ft</p> <p><math>V_{WQCV\ USER} = </math> <input style="width: 50px;" type="text" value=""/></p>
<p>2. Basin Geometry</p> <p>A) WQCV Depth (12-inch maximum)</p> <p>B) Rain Garden Side Slopes (<math>Z = 4</math> min., horiz. dist per unit vertical) (Use "0" if rain garden has vertical walls)</p> <p>C) Minimum Flat Surface Area</p> <p>D) Actual Flat Surface Area</p> <p>E) Area at Design Depth (Top Surface Area)</p> <p>F) Rain Garden Total Volume (<math>V_T = ((A_{Top} + A_{Actual}) / 2) * Depth</math>)</p>	<p><math>D_{WQCV} = </math> <input style="width: 50px;" type="text" value="12"/> in</p> <p><math>Z = </math> <input style="width: 50px;" type="text" value="0.00"/> ft / ft</p> <p><math>A_{Min} = </math> <input style="width: 50px;" type="text" value="719"/> sq ft</p> <p><math>A_{Actual} = </math> <input style="width: 50px;" type="text" value="1080"/> sq ft</p> <p><math>A_{Top} = </math> <input style="width: 50px;" type="text" value="1680"/> sq ft</p> <p><math>V_T = </math> <input style="width: 50px;" type="text" value="1,380"/> cu ft</p>
<p>3. Growing Media</p>	<p>Choose One <input style="width: 50px;" type="text"/></p> <p><input checked="" type="radio"/> 18" Rain Garden Growing Media</p> <p><input type="radio"/> Other (Explain):</p> <p>_____</p> <p>_____</p>
<p>4. Underdrain System</p> <p>A) Are underdrains provided?</p> <p>B) Underdrain system orifice diameter for 12 hour drain time</p> <p style="margin-left: 20px;">i) Distance From Lowest Elevation of the Storage Volume to the Center of the Orifice</p> <p style="margin-left: 20px;">ii) Volume to Drain in 12 Hours</p> <p style="margin-left: 20px;">iii) Orifice Diameter, 3/8" Minimum</p>	<p>Choose One <input style="width: 50px;" type="text"/></p> <p><input checked="" type="radio"/> YES</p> <p><input type="radio"/> NO</p> <p><math>y = </math> <input style="width: 50px;" type="text" value="2.1"/> ft</p> <p><math>Vol_{12} = </math> <input style="width: 50px;" type="text" value="965"/> cu ft</p> <p><math>D_o = </math> <input style="width: 50px;" type="text" value="11/16"/> in</p>

Design Procedure Form: Rain Garden (RG)

Designer: Scott Maier  
Company: Ayres Associates  
Date: October 19, 2023  
Project: Super Star Carwash  
Location: Meadowbrook

<p>5. Impermeable Geomembrane Liner and Geotextile Separator Fabric</p> <p>A) Is an impermeable liner provided due to proximity of structures or groundwater contamination?</p>	<p>Choose One</p> <p><input type="radio"/> YES</p> <p><input checked="" type="radio"/> NO</p>
<p>6. Inlet / Outlet Control</p> <p>A) Inlet Control</p>	<p>Choose One</p> <p><input type="radio"/> Sheet Flow- No Energy Dissipation Required</p> <p><input checked="" type="radio"/> Concentrated Flow- Energy Dissipation Provided</p>
<p>7. Vegetation</p>	<p>Choose One</p> <p><input checked="" type="radio"/> Seed (Plan for frequent weed control)</p> <p><input type="radio"/> Plantings</p> <p><input type="radio"/> Sand Grown or Other High Infiltration Sod</p>
<p>8. Irrigation</p> <p>A) Will the rain garden be irrigated?</p>	<p>Choose One</p> <p><input type="radio"/> YES</p> <p><input type="radio"/> NO</p>

Notes: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

## **Super Star Carwash Onsite Inlet Calculations**

# INLET MANAGEMENT

Worksheet Protected

INLET NAME	<a href="#">Basin A1</a>	<a href="#">Rain Garden Outlet Structure</a>	<a href="#">Basin A4</a>
Site Type (Urban or Rural)	URBAN	URBAN	URBAN
Inlet Application (Street or Area)	STREET	AREA	AREA
Hydraulic Condition	On Grade	Swale	Swale
Inlet Type	CDOT Type C Grate	CDOT Type C (Depressed)	User-Defined

## USER-DEFINED INPUT

User-Defined Design Flows			
Minor $Q_{known}$ (cfs)	0.10	2.59	0.00
Major $Q_{known}$ (cfs)	0.23	9.08	0.33

Bypass (Carry-Over) Flow from Upstream			
Receive Bypass Flow from:	User-Defined	No Bypass Flow Received	No Bypass Flow Received
Minor Bypass Flow Received, $Q_b$ (cfs)	0.0	0.0	0.0
Major Bypass Flow Received, $Q_b$ (cfs)	0.0	0.0	0.0

Watershed Characteristics			
Subcatchment Area (acres)			
Percent Impervious			
NRCS Soil Type			

Watershed Profile			
Overland Slope (ft/ft)			
Overland Length (ft)			
Channel Slope (ft/ft)			
Channel Length (ft)			

Minor Storm Rainfall Input			
Design Storm Return Period, $T_r$ (years)			
One-Hour Precipitation, $P_1$ (inches)			

Major Storm Rainfall Input			
Design Storm Return Period, $T_r$ (years)			
One-Hour Precipitation, $P_1$ (inches)			

## CALCULATED OUTPUT

Minor Total Design Peak Flow, $Q$ (cfs)	0.12	2.59	0.00
Major Total Design Peak Flow, $Q$ (cfs)	0.23	9.08	0.33
Minor Flow Bypassed Downstream, $Q_b$ (cfs)	0.1	0.0	0.0
Major Flow Bypassed Downstream, $Q_b$ (cfs)	0.1	0.0	0.0

# INLET MANAGEMENT

Worksheet Protected

INLET NAME	Basin A5	Basin A3	Basin A6
Site Type (Urban or Rural)	URBAN	URBAN	URBAN
Inlet Application (Street or Area)	AREA	AREA	AREA
Hydraulic Condition	Swale	Swale	Swale
Inlet Type	User-Defined	User-Defined	User-Defined

## USER-DEFINED INPUT

User-Defined Design Flows			
Minor $Q_{known}$ (cfs)	0.00	0.00	0.00
Major $Q_{known}$ (cfs)	0.31	0.86	0.23
Bypass (Carry-Over) Flow from Upstream			
Receive Bypass Flow from:	No Bypass Flow Received	No Bypass Flow Received	No Bypass Flow Received
Minor Bypass Flow Received, $Q_b$ (cfs)	0.0	0.0	0.0
Major Bypass Flow Received, $Q_b$ (cfs)	0.0	0.0	0.0
Watershed Characteristics			
Subcatchment Area (acres)			
Percent Impervious			
NRCS Soil Type			
Watershed Profile			
Overland Slope (ft/ft)			
Overland Length (ft)			
Channel Slope (ft/ft)			
Channel Length (ft)			
Minor Storm Rainfall Input			
Design Storm Return Period, $T_r$ (years)			
One-Hour Precipitation, $P_1$ (inches)			
Major Storm Rainfall Input			
Design Storm Return Period, $T_r$ (years)			
One-Hour Precipitation, $P_1$ (inches)			


## CALCULATED OUTPUT

Minor Total Design Peak Flow, $Q$ (cfs)	0.00	0.00	0.00
Major Total Design Peak Flow, $Q$ (cfs)	0.31	0.86	0.23
Minor Flow Bypassed Downstream, $Q_b$ (cfs)	0.0	0.0	0.0
Major Flow Bypassed Downstream, $Q_b$ (cfs)	0.0	0.0	0.0

## ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project: Super Star Car Wash - Meadowbrook  
 Inlet ID: Basin A1

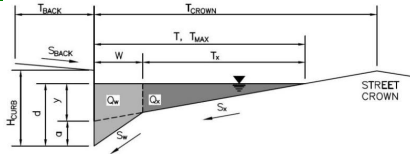

**Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)  
 Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK}$ =	10.0	ft
$S_{BACK}$ =		ft/ft
$n_{BACK}$ =	0.013	
$H_{CURB}$ =	6.00	inches
$T_{CROWN}$ =	10.0	ft
$W$ =	1.00	ft
$S_X$ =	0.048	ft/ft
$S_W$ =	0.083	ft/ft
$S_O$ =	0.007	ft/ft
$n_{STREET}$ =	0.013	

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Allow Flow Depth at Street Crown (check box for yes, leave blank for no)

	Minor Storm	Major Storm	
$T_{MAX}$ =	10.0	10.0	ft
$d_{MAX}$ =	6.0	6.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	

**Maximum Capacity for 1/2 Street based On Allowable Spread**

Water Depth without Gutter Depression (Eq. ST-2)  
 Vertical Depth between Gutter Lip and Gutter Flowline (usually 2")  
 Gutter Depression ( $d_c - (W * S_x * 12)$ )  
 Water Depth at Gutter Flowline  
 Allowable Spread for Discharge outside the Gutter Section W (T - W)  
 Gutter Flow to Design Flow Ratio by FHWA HEC-22 method (Eq. ST-7)  
 Discharge outside the Gutter Section W, carried in Section  $T_X$   
 Discharge within the Gutter Section W ( $Q_T - Q_X$ )  
 Discharge Behind the Curb (e.g., sidewalk, driveways, & lawns)  
 Maximum Flow Based On Allowable Spread  
 Flow Velocity within the Gutter Section  
 V\*d Product: Flow Velocity times Gutter Flowline Depth

	Minor Storm	Major Storm	
y =	5.76	5.76	inches
$d_c$ =	1.0	1.0	inches
a =	0.42	0.42	inches
d =	6.18	6.18	inches
$T_X$ =	9.0	9.0	ft
$E_0$ =	0.257	0.257	
$Q_X$ =	8.0	8.0	cfs
$Q_W$ =	2.8	2.8	cfs
$Q_{BACK}$ =	0.0	0.0	cfs
$Q_T$ =	10.8	10.8	cfs
V =	1.5	1.5	fps
V*d =	0.8	0.8	

**Maximum Capacity for 1/2 Street based on Allowable Depth**

Theoretical Water Spread  
 Theoretical Spread for Discharge outside the Gutter Section W (T - W)  
 Gutter Flow to Design Flow Ratio by FHWA HEC-22 method (Eq. ST-7)  
 Theoretical Discharge outside the Gutter Section W, carried in Section  $T_{X, TH}$   
 Actual Discharge outside the Gutter Section W, (limited by distance  $T_{CROWN}$ )  
 Discharge within the Gutter Section W ( $Q_d - Q_X$ )  
 Discharge Behind the Curb (e.g., sidewalk, driveways, & lawns)  
 Total Discharge for Major & Minor Storm (Pre-Safety Factor)  
 Average Flow Velocity Within the Gutter Section  
 V\*d Product: Flow Velocity Times Gutter Flowline Depth  
 Slope-Based Depth Safety Reduction Factor for Major & Minor ( $d \geq 6"$ ) Storm  
 Max Flow Based on Allowable Depth (Safety Factor Applied)  
 Resultant Flow Depth at Gutter Flowline (Safety Factor Applied)  
 Resultant Flow Depth at Street Crown (Safety Factor Applied)

	Minor Storm	Major Storm	
$T_{TH}$ =	9.7	9.7	ft
$T_{X, TH}$ =	8.7	8.7	ft
$E_0$ =	0.265	0.265	
$Q_{X, TH}$ =	7.3	7.3	cfs
$Q_X$ =	7.3	7.3	cfs
$Q_W$ =	2.6	2.6	cfs
$Q_{BACK}$ =	0.0	0.0	cfs
Q =	9.9	9.9	cfs
V =	1.4	1.4	fps
V*d =	0.7	0.7	
R =	1.00	1.00	
$Q_d$ =	9.9	9.9	cfs
d =	6.00	6.00	inches
$d_{CROWN}$ =	0.00	0.00	inches

MINOR STORM Allowable Capacity is based on Depth Criterion  
 MAJOR STORM Allowable Capacity is based on Depth Criterion


	Minor Storm	Major Storm	
$Q_{allow}$ =	9.9	9.9	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'  
 Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'



# INLET ON A CONTINUOUS GRADE


MHFD-Inlet, Version 5.01 (April 2021)

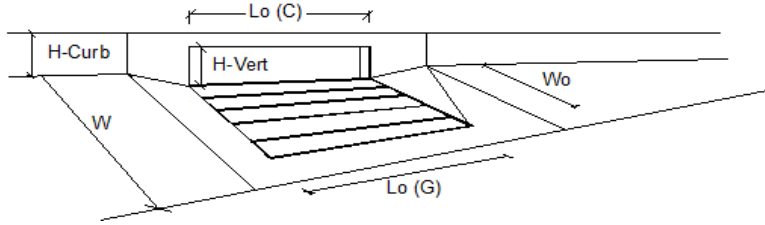

Design Information (Input)	MINOR		MAJOR	
Type of Inlet	CDOT Type C Grate			
Local Depression (additional to continuous gutter depression 'a')	a <sub>LOCAL</sub> =	0.0	0.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No =	1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	L <sub>0</sub> =	2.92	2.92	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)	W <sub>0</sub> =	2.92	2.92	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	C <sub>r-G</sub> =	0.50	0.50	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	C <sub>r-C</sub> =	N/A	N/A	
<b>Street Hydraulics: OK - Q &lt; Allowable Street Capacity</b>				
Design Discharge for Half of Street (from <i>Inlet Management</i> )	Q <sub>0</sub> =	0.1	0.2	cfs
Water Spread Width	T =	1.6	2.1	ft
Water Depth at Flowline (outside of local depression)	d =	1.3	1.7	inches
Water Depth at Street Crown (or at T <sub>MAX</sub> )	d <sub>CROWN</sub> =	0.0	0.0	inches
Ratio of Gutter Flow to Design Flow	E <sub>0</sub> =	0.968	0.867	
Discharge outside the Gutter Section W, carried in Section T <sub>x</sub>	Q <sub>x</sub> =	0.0	0.0	cfs
Discharge within the Gutter Section W	Q <sub>w</sub> =	0.1	0.2	cfs
Discharge Behind the Curb Face	Q <sub>BACK</sub> =	0.0	0.0	cfs
Flow Area within the Gutter Section W	A <sub>w</sub> =	0.07	0.10	sq ft
Velocity within the Gutter Section W	V <sub>w</sub> =	1.7	2.1	fps
Water Depth for Design Condition	d <sub>LOCAL</sub> =	1.3	1.7	inches
<b>Grate Analysis (Calculated)</b>				
Total Length of Inlet Grate Opening	L =	2.92	2.92	ft
Ratio of Grate Flow to Design Flow	E <sub>0-GRATE</sub> =	-0.487	0.422	
<b>Under No-Clogging Condition</b>				
Minimum Velocity Where Grate Splash-Over Begins	V <sub>0</sub> =	9.94	9.94	fps
Interception Rate of Frontal Flow	R <sub>f</sub> =	1.00	1.00	
Interception Rate of Side Flow	R <sub>s</sub> =	0.61	0.56	
Interception Capacity	Q <sub>i</sub> =	0.1	0.2	cfs
<b>Under Clogging Condition</b>				
Clogging Coefficient for Multiple-unit Grate Inlet	GrateCoef =	1.00	1.00	
Clogging Factor for Multiple-unit Grate Inlet	GrateClog =	0.50	0.50	
Effective (unclogged) Length of Multiple-unit Grate Inlet	L <sub>0</sub> =	1.46	1.46	ft
Minimum Velocity Where Grate Splash-Over Begins	V <sub>0</sub> =	6.91	6.91	fps
Interception Rate of Frontal Flow	R <sub>f</sub> =	1.00	1.00	
Interception Rate of Side Flow	R <sub>s</sub> =	0.24	0.20	
Actual Interception Capacity	Q <sub>a</sub> =	0.0	0.1	cfs
Carry-Over Flow = Q <sub>0</sub> - Q <sub>a</sub> (to be applied to curb opening or next d/s inlet)	Q <sub>0</sub> =	0.1	0.1	cfs
<b>Curb or Slotted Inlet Opening Analysis (Calculated)</b>				
Equivalent Slope S <sub>0</sub> (based on grate carry-over)	S <sub>0</sub> =	N/A	N/A	ft/ft
Required Length L <sub>T</sub> to Have 100% Interception	L <sub>T</sub> =	N/A	N/A	ft
<b>Under No-Clogging Condition</b>				
Effective Length of Curb Opening or Slotted Inlet (minimum of L, L <sub>T</sub> )	L =	N/A	N/A	ft
Interception Capacity	Q <sub>i</sub> =	N/A	N/A	cfs
<b>Under Clogging Condition</b>				
Clogging Coefficient	CurbCoef =	N/A	N/A	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	CurbClog =	N/A	N/A	
Effective (Unclogged) Length	L <sub>0</sub> =	N/A	N/A	ft
Actual Interception Capacity	Q <sub>a</sub> =	N/A	N/A	cfs
Carry-Over Flow = Q <sub>0</sub> - Q <sub>a</sub>	Q <sub>0</sub> =	N/A	N/A	cfs
<b>Summary</b>				
Total Inlet Interception Capacity	Q <sub>i</sub> =	0.0	0.1	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	Q <sub>0</sub> =	0.1	0.1	cfs
Capture Percentage = Q <sub>a</sub> /Q <sub>0</sub> =	C% =	-12	54	%

## AREA INLET IN A SWALE

Super Star Car Wash - Meadowbrook  
Rain Garden Outlet Structure

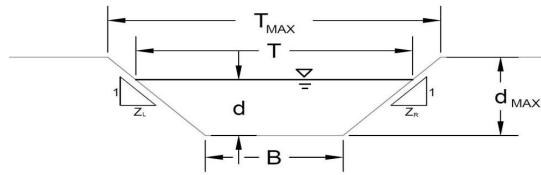

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

### Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)  
 Manning's n (Leave cell D16 blank to manually enter an n value)  
 Channel Invert Slope  
 Bottom Width  
 Left Side Slope  
 Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity (V <sub>MAX</sub> )	Max Froude No. (F <sub>MAX</sub> )
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D, or E =  
 n = 0.013  
 S<sub>0</sub> = 0.0050 ft/ft  
 B = 75.00 ft  
 Z1 = 100.00 ft/ft  
 Z2 = 100.00 ft/ft

Choose One:  
 Non-Cohesive  
 Cohesive  
 Paved

Maximum Allowable Top Width of Channel for Minor & Major Storm  
 Maximum Allowable Water Depth in Channel for Minor & Major Storm

	Minor Storm	Major Storm	
T <sub>MAX</sub> =	100.00	100.00	ft
d <sub>MAX</sub> =	0.20	0.70	ft

### Maximum Channel Capacity Based On Allowable Top Width

Maximum Allowable Top Width  
 Water Depth  
 Flow Area  
 Wetted Perimeter  
 Hydraulic Radius  
 Manning's n  
 Flow Velocity  
 Velocity-Depth Product  
 Hydraulic Depth  
 Froude Number  
 Maximum Flow Based on Allowable Water Depth

	Minor Storm	Major Storm	
T <sub>MAX</sub> =	100.00	100.00	ft
d =	0.13	0.13	ft
A =	10.94	10.94	sq ft
P =	100.00	100.00	ft
R =	0.11	0.11	ft
n =	0.013	0.013	
V =	1.85	1.85	fps
VR =	0.20	0.20	ft <sup>2</sup> /s
D =	0.11	0.11	ft
Fr =	0.99	0.99	
Q <sub>T</sub> =	20.3	20.3	cfs

### Maximum Channel Capacity Based On Allowable Water Depth

Maximum Allowable Water Depth  
 Top Width  
 Flow Area  
 Wetted Perimeter  
 Hydraulic Radius  
 Manning's n  
 Flow Velocity  
 Velocity-Depth Product  
 Hydraulic Depth  
 Froude Number  
 Maximum Flow Based on Allowable Water Depth

	Minor Storm	Major Storm	
d <sub>MAX</sub> =	0.20	0.70	ft
T =	115.00	215.00	ft
A =	19.00	101.50	sq ft
P =	115.00	215.01	ft
R =	0.17	0.47	ft
n =	0.013	0.013	
V =	2.44	4.91	fps
VR =	0.40	2.32	ft <sup>2</sup> /s
D =	0.17	0.47	ft
Fr =	1.06	1.26	
Q <sub>d</sub> =	46.4	498.7	cfs

### Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Top Width Criterion  
 MAJOR STORM Allowable Capacity is based on Top Width Criterion

	Minor Storm	Major Storm	
Q <sub>allow</sub> =	20.3	20.3	cfs
d <sub>allow</sub> =	0.13	0.13	ft

### Water Depth in Channel Based On Design Peak Flow

Design Peak Flow  
 Water Depth  
 Top Width  
 Flow Area  
 Wetted Perimeter  
 Hydraulic Radius  
 Manning's n  
 Flow Velocity  
 Velocity-Depth Product  
 Hydraulic Depth  
 Froude Number

	Minor Storm	Major Storm	
Q <sub>o</sub> =	2.6	9.1	cfs
d =	0.04	0.08	ft
T =	82.48	90.68	ft
A =	2.95	6.50	sq ft
P =	82.48	90.68	ft
R =	0.04	0.07	ft
n =	0.013	0.013	
V =	0.88	1.40	fps
VR =	0.03	0.10	ft <sup>2</sup> /s
D =	0.04	0.07	ft
Fr =	0.82	0.92	

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'  
 Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'


MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Rain Garden Outlet Structure

Inlet Design Information (Input)							
Type of Inlet	CDOT Type C (Depressed) Inlet Type = CDOT Type C (Depressed)						
Angle of Inclined Grate (must be $\leq 30$ degrees)	$\theta = 0.00$ degrees						
Width of Grate	$W = 3.00$ ft						
Length of Grate	$L = 3.00$ ft						
Open Area Ratio	$A_{RATIO} = 0.70$						
Height of Inclined Grate	$H_B = 0.00$ ft						
Clogging Factor	$C_f = 0.50$						
Grate Discharge Coefficient	$C_d = 0.84$						
Orifice Coefficient	$C_o = 0.56$						
Weir Coefficient	$C_w = 1.81$						
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	<table border="1"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> </tr> </thead> <tbody> <tr> <td><math>d =</math></td> <td>1.04</td> <td>1.08</td> </tr> </tbody> </table>		MINOR	MAJOR	$d =$	1.04	1.08
	MINOR	MAJOR					
$d =$	1.04	1.08					
<u>Grate Capacity as a Weir</u>							
Submerged Side Weir Length	$X = 3.00$ ft						
Inclined Side Weir Flow	$Q_{ws} = 10.0$ cfs						
Base Weir Flow	$Q_{wb} = 14.3$ cfs						
Interception Without Clogging	$Q_{wi} = 34.4$ cfs						
Interception With Clogging	$Q_{wa} = 17.2$ cfs						
<u>Grate Capacity as an Orifice</u>							
Interception Without Clogging	$Q_{oi} = 29.0$ cfs						
Interception With Clogging	$Q_{oa} = 14.5$ cfs						
Total Inlet Interception Capacity (assumes clogged condition)	$Q_a = 14.5$ cfs						
Bypassed Flow	$Q_b = 0.0$ cfs						
Capture Percentage = $Q_a/Q_o$	$C\% = 100$ %						

MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A4

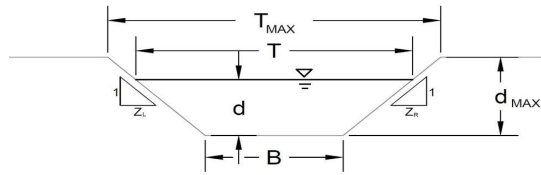


This worksheet uses the NRCS vegetal retardance method to determine Manning's n.  
 For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method				
NRCS Vegetal Retardance (A, B, C, D, or E)				
Manning's n (Leave cell D16 blank to manually enter an n value)				
Channel Invert Slope				
Bottom Width				
Left Side Slope				
Right Side Slope				
Check one of the following soil types:				
Soil Type:	Max. Velocity ( $V_{MAX}$ )	Max. Froude No. ( $F_{MAX}$ )		
Non-Cohesive	5.0 fps	0.60		
Cohesive	7.0 fps	0.80		
Paved	N/A	N/A		
A, B, C, D, or E = <table border="1"><tr><td>B</td></tr></table>			B	
B				
n = <table border="1"><tr><td>see details below</td></tr></table>			see details below	
see details below				
$S_0$ = <table border="1"><tr><td>0.0200</td></tr></table> ft/ft			0.0200	
0.0200				
B = <table border="1"><tr><td>4.00</td></tr></table> ft			4.00	
4.00				
$Z_1$ = <table border="1"><tr><td>10.00</td></tr></table> ft/ft			10.00	
10.00				
$Z_2$ = <table border="1"><tr><td>20.00</td></tr></table> ft/ft			20.00	
20.00				
Choose One:				
<input type="radio"/> Non-Cohesive				
<input type="radio"/> Cohesive				
<input type="radio"/> Paved				
Maximum Allowable Top Width of Channel for Minor & Major Storm				
$T_{MAX}$ = <table border="1"><tr><td>15.00</td><td>15.00</td></tr></table> ft			15.00	15.00
15.00	15.00			
Maximum Allowable Water Depth in Channel for Minor & Major Storm				
$d_{MAX}$ = <table border="1"><tr><td>0.50</td><td>0.50</td></tr></table> ft			0.50	0.50
0.50	0.50			
Allowable Channel Capacity Based On Channel Geometry				
MINOR STORM Allowable Capacity is based on Top Width Criterion				
MAJOR STORM Allowable Capacity is based on Top Width Criterion				
Water Depth in Channel Based On Design Peak Flow				
Design Peak Flow				
Water Depth				
$Q_o$ = <table border="1"><tr><td>0.0</td><td>0.3</td></tr></table> cfs			0.0	0.3
0.0	0.3			
d = <table border="1"><tr><td>0.00</td><td>0.23</td></tr></table> ft			0.00	0.23
0.00	0.23			
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'				
Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'				


MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A4

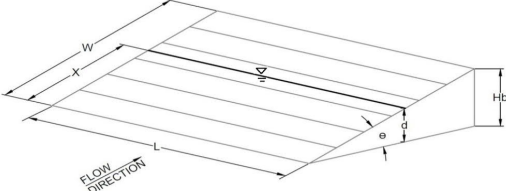Inlet Design Information (Input)																					
Type of Inlet	User-Defined																				
Inlet Type =	User-Defined																				
Angle of Inclined Grate (must be $\leq 30$ degrees)	$\theta = 0.00$ degrees																				
Width of Grate	$W = 2.00$ ft																				
Length of Grate	$L = 2.00$ ft																				
Open Area Ratio	$A_{RATIO} = 0.70$																				
Height of Inclined Grate	$H_B = 0.00$ ft																				
Clogging Factor	$C_f = 0.50$																				
Grate Discharge Coefficient	$C_d = N/A$																				
Orifice Coefficient	$C_o = 0.64$																				
Weir Coefficient	$C_w = 2.05$																				
																					
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)																					
Total Inlet Interception Capacity (assumes clogged condition)																					
Bypassed Flow																					
Capture Percentage = $Q_a/Q_o$																					
	<table border="1"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td><math>d =</math></td> <td>0.00</td> <td>0.23</td> <td></td> </tr> <tr> <td><math>Q_a =</math></td> <td>0.0</td> <td>1.4</td> <td>cfs</td> </tr> <tr> <td><math>Q_b =</math></td> <td>0.0</td> <td>0.0</td> <td>cfs</td> </tr> <tr> <td><math>C\% =</math></td> <td>100</td> <td>100</td> <td>%</td> </tr> </tbody> </table>		MINOR	MAJOR		$d =$	0.00	0.23		$Q_a =$	0.0	1.4	cfs	$Q_b =$	0.0	0.0	cfs	$C\% =$	100	100	%
	MINOR	MAJOR																			
$d =$	0.00	0.23																			
$Q_a =$	0.0	1.4	cfs																		
$Q_b =$	0.0	0.0	cfs																		
$C\% =$	100	100	%																		

MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A5

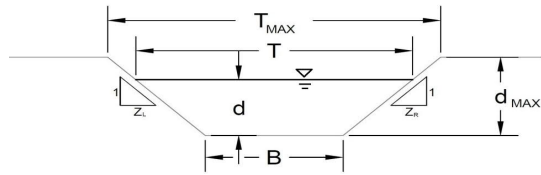


This worksheet uses the NRCS vegetal retardance method to determine Manning's n.  
 For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method				
NRCS Vegetal Retardance (A, B, C, D, or E)				
Manning's n (Leave cell D16 blank to manually enter an n value)				
Channel Invert Slope				
Bottom Width				
Left Side Slope				
Right Side Slope				
Check one of the following soil types:				
Soil Type:	Max. Velocity (V <sub>MAX</sub> )	Max. Froude No. (F <sub>MAX</sub> )		
Non-Cohesive	5.0 fps	0.60		
Cohesive	7.0 fps	0.80		
Paved	N/A	N/A		
A, B, C, D, or E = <table border="1"><tr><td>B</td></tr></table>			B	
B				
n = <table border="1"><tr><td>see details below</td></tr></table>			see details below	
see details below				
S <sub>0</sub> = <table border="1"><tr><td>0.0200</td><td>ft/ft</td></tr></table>			0.0200	ft/ft
0.0200	ft/ft			
B = <table border="1"><tr><td>4.00</td><td>ft</td></tr></table>			4.00	ft
4.00	ft			
Z1 = <table border="1"><tr><td>10.00</td><td>ft/ft</td></tr></table>			10.00	ft/ft
10.00	ft/ft			
Z2 = <table border="1"><tr><td>10.00</td><td>ft/ft</td></tr></table>			10.00	ft/ft
10.00	ft/ft			
Choose One:				
<input type="radio"/> Non-Cohesive				
<input type="radio"/> Cohesive				
<input type="radio"/> Paved				
Maximum Allowable Top Width of Channel for Minor & Major Storm				
Maximum Allowable Water Depth in Channel for Minor & Major Storm				
T <sub>MAX</sub> =	<table border="1"><tr><td>10.00</td><td>10.00</td></tr></table>	10.00	10.00	ft
10.00	10.00			
d <sub>MAX</sub> =	<table border="1"><tr><td>0.50</td><td>0.50</td></tr></table>	0.50	0.50	ft
0.50	0.50			
Allowable Channel Capacity Based On Channel Geometry				
MINOR STORM Allowable Capacity is based on Top Width Criterion				
MAJOR STORM Allowable Capacity is based on Top Width Criterion				
Q <sub>allow</sub> =	<table border="1"><tr><td>0.5</td><td>0.5</td></tr></table>	0.5	0.5	cfs
0.5	0.5			
d <sub>allow</sub> =	<table border="1"><tr><td>0.30</td><td>0.30</td></tr></table>	0.30	0.30	ft
0.30	0.30			
Water Depth in Channel Based On Design Peak Flow				
Design Peak Flow				
Water Depth				
Q <sub>o</sub> =	<table border="1"><tr><td>0.0</td><td>0.3</td></tr></table>	0.0	0.3	cfs
0.0	0.3			
d =	<table border="1"><tr><td>0.00</td><td>0.24</td></tr></table>	0.00	0.24	ft
0.00	0.24			
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'				
Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'				


MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A5

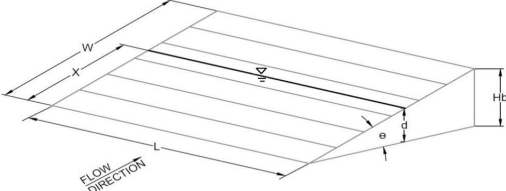Inlet Design Information (Input)																					
Type of Inlet	User-Defined																				
Inlet Type =	User-Defined																				
Angle of Inclined Grate (must be $\leq 30$ degrees)	$\theta = 0.00$ degrees																				
Width of Grate	$W = 2.00$ ft																				
Length of Grate	$L = 2.00$ ft																				
Open Area Ratio	$A_{RATIO} = 0.70$																				
Height of Inclined Grate	$H_B = 0.00$ ft																				
Clogging Factor	$C_f = 0.50$																				
Grate Discharge Coefficient	$C_d = N/A$																				
Orifice Coefficient	$C_o = 0.64$																				
Weir Coefficient	$C_w = 2.05$																				
																					
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	<table border="1"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td><math>d =</math></td> <td>0.00</td> <td>0.24</td> <td></td> </tr> <tr> <td><math>Q_a =</math></td> <td>0.0</td> <td>1.4</td> <td>cfs</td> </tr> <tr> <td><math>Q_b =</math></td> <td>0.0</td> <td>0.0</td> <td>cfs</td> </tr> <tr> <td><math>C\% =</math></td> <td>100</td> <td>100</td> <td>%</td> </tr> </tbody> </table>		MINOR	MAJOR		$d =$	0.00	0.24		$Q_a =$	0.0	1.4	cfs	$Q_b =$	0.0	0.0	cfs	$C\% =$	100	100	%
	MINOR	MAJOR																			
$d =$	0.00	0.24																			
$Q_a =$	0.0	1.4	cfs																		
$Q_b =$	0.0	0.0	cfs																		
$C\% =$	100	100	%																		
Total Inlet Interception Capacity (assumes clogged condition)																					
Bypassed Flow																					
Capture Percentage = $Q_a/Q_o$																					

MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A3

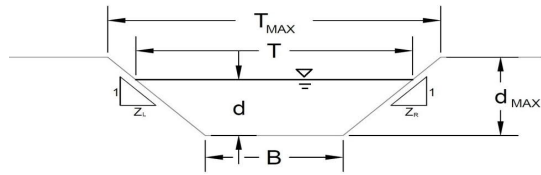

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.  
 For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method		
NRCS Vegetal Retardance (A, B, C, D, or E)	A, B, C, D, or E =	B
Manning's n (Leave cell D16 blank to manually enter an n value)	n =	see details below
Channel Invert Slope	S <sub>0</sub> =	0.0200 ft/ft
Bottom Width	B =	4.00 ft
Left Side Slope	Z1 =	5.00 ft/ft
Right Side Slope	Z2 =	5.00 ft/ft
Check one of the following soil types:		
Soil Type:	Max. Velocity (V <sub>max</sub> )	Max. Froude No. (F <sub>max</sub> )
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A
Choose One:		
<input type="radio"/> Non-Cohesive		
<input type="radio"/> Cohesive		
<input type="radio"/> Paved		
Maximum Allowable Top Width of Channel for Minor & Major Storm	T <sub>MAX</sub> =	Minor Storm: 10.00 ft, Major Storm: 10.00 ft
Maximum Allowable Water Depth in Channel for Minor & Major Storm	d <sub>MAX</sub> =	Minor Storm: 0.50 ft, Major Storm: 0.50 ft
Allowable Channel Capacity Based On Channel Geometry		
MINOR STORM Allowable Capacity is based on Depth Criterion		
MAJOR STORM Allowable Capacity is based on Depth Criterion		
Water Depth in Channel Based On Design Peak Flow	Q <sub>allow</sub> =	Minor Storm: 1.1 cfs, Major Storm: 1.1 cfs
Design Peak Flow	d <sub>allow</sub> =	Minor Storm: 0.50 ft, Major Storm: 0.50 ft
Water Depth	Q <sub>o</sub> =	0.0 cfs, 0.9 cfs
	d =	0.00 ft, 0.44 ft
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'		
Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'		




MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A3

Inlet Design Information (Input)	
Type of Inlet	User-Defined
Inlet Type =	User-Defined
Angle of Inclined Grate (must be $\leq 30$ degrees)	$\theta = 0.00$ degrees
Width of Grate	$W = 2.00$ ft
Length of Grate	$L = 2.00$ ft
Open Area Ratio	$A_{RATIO} = 0.70$
Height of Inclined Grate	$H_B = 0.00$ ft
Clogging Factor	$C_f = 0.50$
Grate Discharge Coefficient	$C_d = N/A$
Orifice Coefficient	$C_o = 0.64$
Weir Coefficient	$C_w = 2.05$
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	$d = 0.00$ MINOR MAJOR
Total Inlet Interception Capacity (assumes clogged condition)	$Q_a = 0.0$ 0.0 3.6 cfs
Bypassed Flow	$Q_b = 0.0$ 0.0 cfs
Capture Percentage = $Q_a/Q_o$	$C\% = 100$ 100 %

## AREA INLET IN A SWALE

Super Star Car Wash - Meadowbrook  
Basin A6

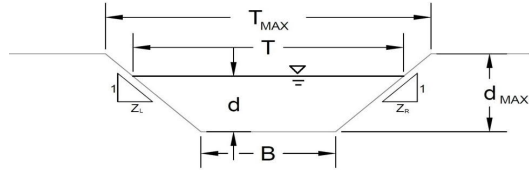

This worksheet uses the NRCS vegetative retardance method to determine Manning's n.  
For more information see Section 7.2.3 of the USDCM.

<b>Analysis of Trapezoidal Grass-Lined Channel Using SCS Method</b>																										
NRCS Vegetal Retardance (A, B, C, D, or E) Manning's n (Leave cell D16 blank to manually enter an n value) Channel Invert Slope Bottom Width Left Side Slope Right Side Slope	A, B, C, D, or E = <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="text-align: center;">B</td></tr></table> n = <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="text-align: center;">see details below</td></tr></table> S <sub>0</sub> = <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="text-align: center;">0.0200</td><td style="text-align: center;">ft/ft</td></tr></table> B = <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="text-align: center;">4.00</td><td style="text-align: center;">ft</td></tr></table> Z <sub>1</sub> = <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="text-align: center;">5.00</td><td style="text-align: center;">ft/ft</td></tr></table> Z <sub>2</sub> = <table border="1" style="display: inline-table; border-collapse: collapse;"><tr><td style="text-align: center;">5.00</td><td style="text-align: center;">ft/ft</td></tr></table>	B	see details below	0.0200	ft/ft	4.00	ft	5.00	ft/ft	5.00	ft/ft															
B																										
see details below																										
0.0200	ft/ft																									
4.00	ft																									
5.00	ft/ft																									
5.00	ft/ft																									
Check one of the following soil types:																										
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th style="text-align: left;">Soil Type:</th> <th style="text-align: center;">Max. Velocity (V<sub>max</sub>)</th> <th style="text-align: center;">Max Froude No. (F<sub>max</sub>)</th> </tr> </thead> <tbody> <tr> <td>Non-Cohesive</td> <td style="text-align: center;">5.0 fps</td> <td style="text-align: center;">0.60</td> </tr> <tr> <td>Cohesive</td> <td style="text-align: center;">7.0 fps</td> <td style="text-align: center;">0.80</td> </tr> <tr> <td>Paved</td> <td style="text-align: center;">N/A</td> <td style="text-align: center;">N/A</td> </tr> </tbody> </table>	Soil Type:	Max. Velocity (V <sub>max</sub> )	Max Froude No. (F <sub>max</sub> )	Non-Cohesive	5.0 fps	0.60	Cohesive	7.0 fps	0.80	Paved	N/A	N/A	Choose One: <input type="radio"/> Non-Cohesive <input type="radio"/> Cohesive <input type="radio"/> Paved													
Soil Type:	Max. Velocity (V <sub>max</sub> )	Max Froude No. (F <sub>max</sub> )																								
Non-Cohesive	5.0 fps	0.60																								
Cohesive	7.0 fps	0.80																								
Paved	N/A	N/A																								
Maximum Allowable Top Width of Channel for Minor & Major Storm Maximum Allowable Water Depth in Channel for Minor & Major Storm	<table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th></th> <th style="width: 50%;">Minor Storm</th> <th style="width: 50%;">Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>T<sub>MAX</sub> =</td> <td>10.00</td> <td>10.00</td> <td>ft</td> </tr> <tr> <td>d<sub>MAX</sub> =</td> <td>0.50</td> <td>0.50</td> <td>ft</td> </tr> </tbody> </table>			Minor Storm	Major Storm		T <sub>MAX</sub> =	10.00	10.00	ft	d <sub>MAX</sub> =	0.50	0.50	ft												
	Minor Storm	Major Storm																								
T <sub>MAX</sub> =	10.00	10.00	ft																							
d <sub>MAX</sub> =	0.50	0.50	ft																							
<b>Allowable Channel Capacity Based On Channel Geometry</b>																										
MINOR STORM Allowable Capacity is based on Depth Criterion MAJOR STORM Allowable Capacity is based on Depth Criterion																										
Water Depth in Channel Based On Design Peak Flow Design Peak Flow Water Depth	<table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th></th> <th style="width: 50%;">Minor Storm</th> <th style="width: 50%;">Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>Q<sub>allow</sub> =</td> <td>1.1</td> <td>1.1</td> <td>cfs</td> </tr> <tr> <td>d<sub>allow</sub> =</td> <td>0.50</td> <td>0.50</td> <td>ft</td> </tr> </tbody> </table> <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th></th> <th style="width: 50%;">Minor Storm</th> <th style="width: 50%;">Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>Q<sub>o</sub> =</td> <td>0.0</td> <td>0.2</td> <td>cfs</td> </tr> <tr> <td>d =</td> <td>0.00</td> <td>0.22</td> <td>ft</td> </tr> </tbody> </table>			Minor Storm	Major Storm		Q <sub>allow</sub> =	1.1	1.1	cfs	d <sub>allow</sub> =	0.50	0.50	ft		Minor Storm	Major Storm		Q <sub>o</sub> =	0.0	0.2	cfs	d =	0.00	0.22	ft
	Minor Storm	Major Storm																								
Q <sub>allow</sub> =	1.1	1.1	cfs																							
d <sub>allow</sub> =	0.50	0.50	ft																							
	Minor Storm	Major Storm																								
Q <sub>o</sub> =	0.0	0.2	cfs																							
d =	0.00	0.22	ft																							
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management' Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'																										

MHFD-Inlet, Version 5.01 (April 2021)  
**AREA INLET IN A SWALE**

Super Star Car Wash - Meadowbrook  
 Basin A6

**Inlet Design Information (Input)**

Type of Inlet:  Inlet Type =

Angle of Inclined Grate (must be  $\leq 30$  degrees)

Width of Grate

Length of Grate

Open Area Ratio


Height of Inclined Grate

Clogging Factor

Grate Discharge Coefficient

Orifice Coefficient

Weir Coefficient

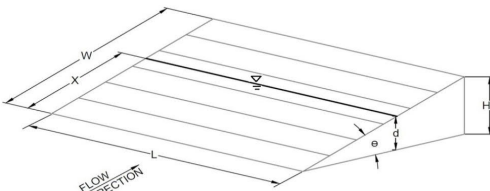

$\theta$ =	0.00	degrees
W =	2.00	ft
L =	2.00	ft
A <sub>RATIO</sub> =	0.70	
H <sub>B</sub> =	0.00	ft
C <sub>r</sub> =	0.50	
C <sub>d</sub> =	N/A	
C <sub>o</sub> =	0.64	
C <sub>w</sub> =	2.05	

	MINOR	MAJOR	
d =	0.00	0.22	
Q <sub>a</sub> =	0.0	1.2	cfs
Q <sub>b</sub> =	0.0	0.0	cfs
C% =	100	100	%

Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)

Total Inlet Interception Capacity (assumes clogged condition)

Bypassed Flow


Capture Percentage =  $Q_a/Q_o$

# Cross Section for RG Discharge

Project Description	
Friction Method	Manning Formula
Solve For	Discharge

Input Data	
Roughness Coefficient	0.013
Channel Slope	0.005 ft/ft
Normal Depth	14.0 in
Rise	14.0 in
Span	23.0 in
Discharge	7.15 cfs

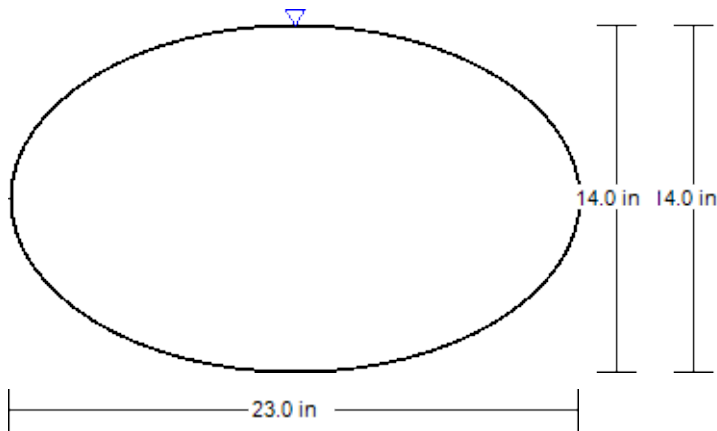


V: 1  
H: 1

# Cross Section for A3-MANHOLE

Project Description	
Friction Method	Manning Formula
Solve For	Full Flow Capacity

Input Data	
Roughness Coefficient	0.010
Channel Slope	0.020 ft/ft
Normal Depth	12.0 in
Diameter	12.0 in
Discharge	6.55 cfs

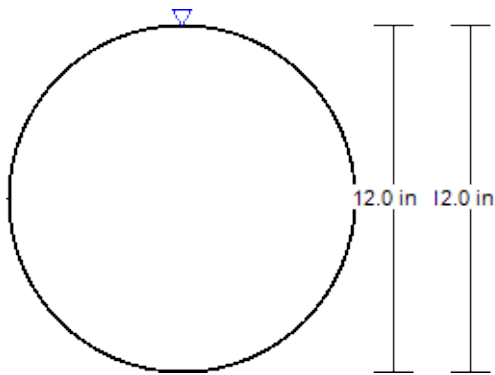


V: 1  
H: 1

## Cross Section for A6-A5

Project Description	
Friction Method	Manning Formula
Solve For	Full Flow Capacity

Input Data	
Roughness Coefficient	0.010
Channel Slope	0.005 ft/ft
Normal Depth	12.0 in
Diameter	12.0 in
Discharge	3.27 cfs

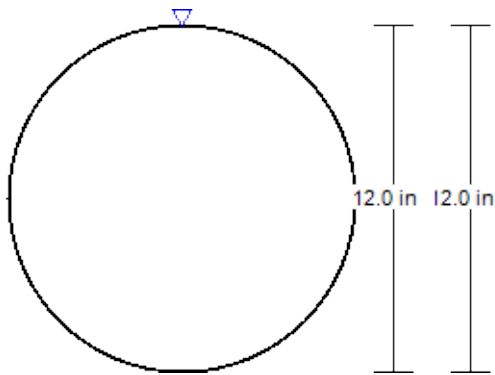


V: 1  
H: 1

## Cross Section for MANHOLE-RG

Project Description	
Friction Method	Manning Formula
Solve For	Full Flow Capacity

Input Data	
Roughness Coefficient	0.010
Channel Slope	0.005 ft/ft
Normal Depth	18.0 in
Diameter	18.0 in
Discharge	9.66 cfs

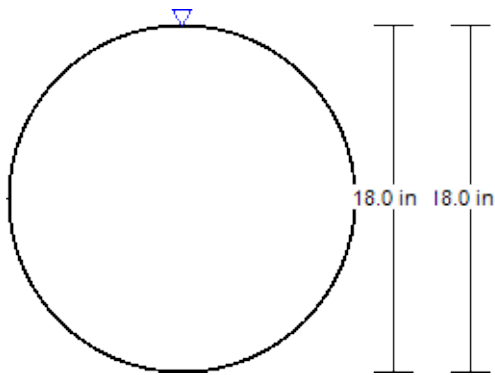


V: 1  
H: 1

# DETERMINATION OF CULVERT HEADWATER AND OUTLET PROTECTION

*MHFD-Culvert, Version 4.00 (May 2020)*

**Project:** Super Star Carwash Riprap

**ID:** \_\_\_\_\_

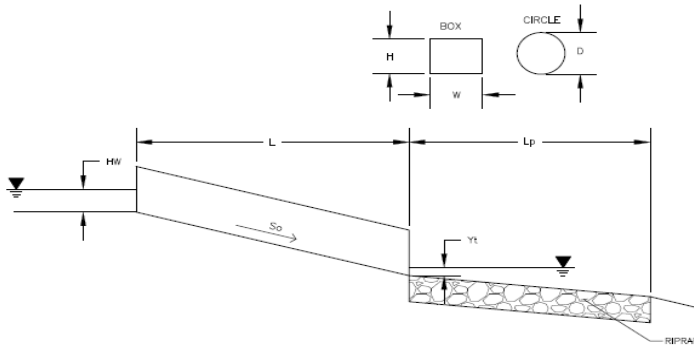

**Soil Type:**

Choose One:

Sandy

Non-Sandy

**Design Information:**

Design Discharge	Q = <input type="text" value="6"/> cfs
Circular Culvert:	
Barrel Diameter in Inches	D = <input type="text" value="18"/> inches
Inlet Edge Type (Choose from pull-down list)	Grooved Edge in Headwall
<b>OR:</b>	
Box Culvert:	
Barrel Height (Rise) in Feet	H (Rise) = <input type="text" value=""/> ft
Barrel Width (Span) in Feet	W (Span) = <input type="text" value=""/> ft
Inlet Edge Type (Choose from pull-down list)	
<b>OR:</b>	
Number of Barrels	# Barrels = <input type="text" value="1"/>
Inlet Elevation	Elev IN = <input type="text" value="6378.16"/> ft
Outlet Elevation <b>OR</b> Slope	Elev OUT = <input type="text" value="6377.7"/> ft
Culvert Length	L = <input type="text" value="101.4"/> ft
Manning's Roughness	n = <input type="text" value="0.012"/>
Bend Loss Coefficient	k <sub>b</sub> = <input type="text" value="0"/>
Exit Loss Coefficient	k <sub>x</sub> = <input type="text" value="1"/>
Tailwater Surface Elevation	Y <sub>t</sub> Elevation = <input type="text" value=""/> ft
Max Allowable Channel Velocity	V = <input type="text" value="5"/> ft/s

**Calculated Results:**

Culvert Cross Sectional Area Available	A = <input type="text" value="1.77"/> ft <sup>2</sup>
Culvert Normal Depth	Y <sub>n</sub> = <input type="text" value="1.00"/> ft
Culvert Critical Depth	Y <sub>c</sub> = <input type="text" value="0.95"/> ft
Froude Number	Fr = <input type="text" value="0.90"/>
Entrance Loss Coefficient	k <sub>e</sub> = <input type="text" value="0.20"/>
Friction Loss Coefficient	k <sub>f</sub> = <input type="text" value="1.57"/>
Sum of All Loss Coefficients	k <sub>s</sub> = <input type="text" value="2.77"/> ft
Headwater:	
Inlet Control Headwater	HW <sub>I</sub> = <input type="text" value="1.38"/> ft
Outlet Control Headwater	HW <sub>O</sub> = <input type="text" value="1.26"/> ft
<b>Design Headwater Elevation</b>	<b>HW = <input type="text" value="6379.54"/> ft</b>
<b>Headwater/Diameter <b>OR</b> Headwater/Rise Ratio</b>	<b>HW/D = <input type="text" value="0.92"/></b>
Outlet Protection:	
Flow/(Diameter <sup>2.5</sup> )	Q/D <sup>2.5</sup> = <input type="text" value="2.18"/> ft <sup>0.5</sup> /s
Tailwater Surface Height	Y <sub>t</sub> = <input type="text" value="0.60"/> ft
Tailwater/Diameter	Y <sub>t</sub> /D = <input type="text" value="0.40"/>
Expansion Factor	1/(2*tan(Θ)) = <input type="text" value="5.50"/>
Flow Area at Max Channel Velocity	A <sub>t</sub> = <input type="text" value="1.20"/> ft <sup>2</sup>
Width of Equivalent Conduit for Multiple Barrels	W <sub>eq</sub> = <input type="text" value="-"/>
<b>Length of Riprap Protection</b>	<b>L<sub>p</sub> = <input type="text" value="5"/> ft</b>
<b>Width of Riprap Protection at Downstream End</b>	<b>T = <input type="text" value="3"/> ft</b>
Adjusted Diameter for Supercritical Flow	Da = <input type="text" value="-"/> ft
Minimum Theoretical Riprap Size	d <sub>50</sub> min = <input type="text" value="3"/> in
Nominal Riprap Size	d <sub>50</sub> nominal = <input type="text" value="6"/> in
<b>MHFD Riprap Type</b>	<b>Type = <input type="text" value="VL"/></b>




## Cross Section for A4-A1

Project Description	
Friction Method	Manning Formula
Solve For	Full Flow Capacity

Input Data	
Roughness Coefficient	0.010
Channel Slope	0.005 ft/ft
Normal Depth	12.0 in
Diameter	12.0 in
Discharge	3.27 cfs

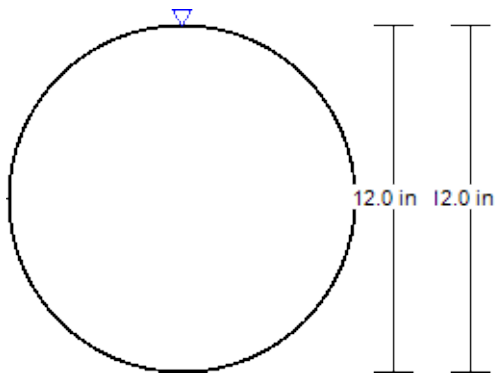


V: 1  
H: 1

## Cross Section for A5-A4

Project Description	
Friction Method	Manning Formula
Solve For	Full Flow Capacity

Input Data	
Roughness Coefficient	0.010
Channel Slope	0.005 ft/ft
Normal Depth	12.0 in
Diameter	12.0 in
Discharge	3.27 cfs

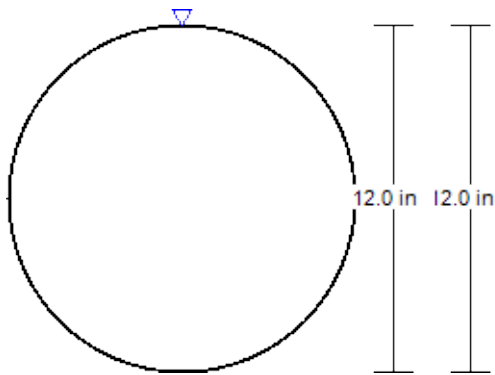

V: 1  
H: 1