



**ENTECH**  
ENGINEERING, INC.

505 ELKTON DRIVE  
COLORADO SPRINGS, CO 80907  
PHONE (719) 531-5599

**GEOTECHNICAL AND PAVEMENT DESIGN REPORT  
LIFE CHURCH AT BENT GRASS NORTH  
PARCEL NOS. 53010-00-026 & 53010-00-033  
FALCON, COLORADO**

Prepared for:  
**Seed Development Services, LLC  
8<sup>th</sup> Floor, Two Leadership Square  
211 N. Robinson Ave,  
Oklahoma City, OK 73102**

Attn: Brett Harrington


November 11, 2024

Respectfully Submitted,

ENTECH ENGINEERING, INC.

Zachary C. Gutierrez, E.I.T.  
Geotechnical Engineering Staff

Reviewed by:

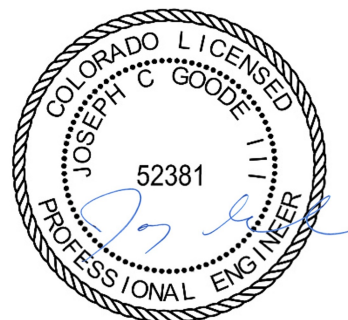

Joseph C. Goode III, P.E.  
Sr. Engineer

ZCG:JCG/ed

**Table of Contents**

**1 Introduction ..... 1**

**2 Project and Site Description..... 1**

**3 Subsurface Explorations and Laboratory Testing ..... 1**

    3.1 Subsurface Exploration Program ..... 1

    3.2 Laboratory Testing ..... 2

**4 Subsurface Conditions ..... 2**

    4.1 Soil and Bedrock ..... 2

    4.2 Groundwater ..... 3

**5 Geotechnical Evaluation and Recommendations ..... 4**

    5.1 Shallow Foundations ..... 4

    5.2 On-Grade Floor Slabs ..... 5

    5.3 Seismic Site Classification..... 6

    5.4 Surface and Subsurface Drainage..... 6

**6 Pavement Design Recommendations ..... 6**

    6.1 Pavement Subgrade Conditions ..... 6

    6.2 Swell Mitigation ..... 7

    6.3 Traffic Loading..... 7

    6.4 Pavement Designs ..... 7

**7 Construction Recommendations ..... 8**

    7.1 Earthwork Recommendations for Structures ..... 8

        7.1.1 Subgrade Preparation ..... 8

        7.1.2 Shallow Groundwater ..... 9

        7.1.3 Swell Mitigation ..... 9

        7.1.4 Granular Fill..... 10

        7.1.5 Fill Placement and Compaction ..... 10

    7.2 Pavements ..... 10

        7.2.1 Pavement Subgrade Preparation ..... 11

        7.2.2 Aggregate Base Course and Recycled Concrete Base ..... 11

    7.3 Excavation Potential ..... 11

    7.4 Excavation Stability ..... 11

    7.5 Utility Trench Backfill ..... 11

    7.6 General Backfill ..... 12

    7.7 Concrete Degradation Due to Sulfate Attack ..... 12

    7.8 Winter Construction ..... 12

    7.9 Foundation Excavation and Construction Observation ..... 13

**8 Closure..... 13**

**Figures**

*Figure 1: Vicinity Map*

*Figure 2: Site and Exploration Plan*

*Figure 3: Perimeter Drain Detail*

**List of Appendices**

*Appendix A: Test Boring Logs*

*Appendix B: Laboratory Test Results*

*Appendix C: Pavement Design Calculations*

## **1 Introduction**

Entech Engineering Inc. (Entech) completed this geotechnical and pavement design for a new church and associated site improvements in Falcon, Colorado. This report describes the subsurface exploration program conducted for the planned commercial building and provides recommendations for foundation design, pavement sections, and construction considerations. Our services were completed for Seed Development Services, LLC in accordance with our geotechnical services and pavement design service agreement dated September 25, 2024. The contents of this report, including the geotechnical evaluation and recommendations, are subject to the limitations and assumptions presented in Section 8.

## **2 Project and Site Description**

The project will consist of the construction of a new church and associated site improvements to be located northwest of Meridian Road and Bent Grass Meadows Drive in Falcon, Colorado. The location of the project site is shown on the Vicinity Map (Figure 1).

At the time of drilling, the property was a relatively flat vacant lot. Vegetation consisted of field grasses and weeds. Undeveloped land is located to the west with residential neighborhoods to the north and east and commercial property to the south of the proposed site. Building loads are expected to be light to moderate.

## **3 Subsurface Explorations and Laboratory Testing**

### **3.1 Subsurface Exploration Program**

Subsurface conditions at the project site were explored by eight test borings, designated TB-1 through TB-8, drilled on October 16 and 17, 2024 at the approximate locations shown on the Site and Exploration Plan (Figure 2). Five borings were drilled in the proposed building footprint and three additional borings were drilled in the parking lot and drive lanes to provide pavement design recommendations. The borings drilled in the building footprint were drilled to depths of 20 feet below the ground surface (bgs), and the borings drilled in the parking and drive areas were drilled to depths of 10 feet bgs. The drilling was performed using a truck-mounted, continuous-flight auger drill rig supplied and operated by Entech. Descriptive boring logs providing the lithologies of the subsurface conditions encountered during drilling are presented in Appendix A. Soil and bedrock samples were obtained from the borings utilizing the Standard Penetration Test (ASTM

D1586) using a split-barrel California sampler. Results of the Standard Penetration Test (SPT) are included on the boring logs in terms of N-values expressed in blows per foot (bpf). Soil and bedrock samples recovered from the borings were visually classified and recorded on the boring logs. The soil and bedrock classifications were later verified utilizing laboratory testing and grouped by soil type. The soil and bedrock type numbers are included on the boring logs. It should be understood that soil and bedrock descriptions shown on the boring logs may vary between boring location and sample depths. It should also be noted that the lines of stratigraphic separation shown on the boring logs represent approximate boundaries between soil and bedrock types, and the actual stratigraphic transitions may be more gradual or variable with location.

### **3.2 Laboratory Testing**

Water content testing (ASTM D2216) was performed on the samples recovered from the borings, and the results are shown on the boring logs. Grain-Size Analysis (ASTM D422) and Atterberg Limits testing (ASTM D4318) were performed on selected samples to assist in classifying the materials encountered in the borings. One-dimensional swell/collapse testing (ASTM D4546) was performed to evaluate the expansive characteristics and collapse potential characteristics. Soluble sulfate testing was performed on select soil samples to evaluate the potential for below-grade degradation of concrete due to sulfate attack.

For pavement design, a Standard Proctor (ASTM D698) and California Bearing Ratio (CBR) test (ASTM D1883) were completed on a bulk sample from the roadway subgrade. The Laboratory Testing Results are presented in Appendix B and summarized in Table B-1.

## **4 Subsurface Conditions**

Two primary soil types and two bedrock types were encountered in the test borings drilled for the subsurface investigation. Each soil type was classified in accordance with the Unified Soil Classification System (USCS) and the American Association of State Highway and Transportation Officials (AASHTO) soil classification system using the laboratory testing results and the observations made during drilling.

### **4.1 Soil and Bedrock**

Topsoil was encountered across the site and is generally anticipated to be on the order of 6 inches thick.

Soil Type 1 classified as clayey sand, silty sand, and sand with silt (SM, SC, SW-SM). The loose to medium-dense sands were encountered in all test borings underlying the topsoil to depths of 3 to 10 feet bgs. One-dimensional swell or collapse testing on a sample of sandy clay resulted in a volume change of -0.4% to 0.0% indicating low swell and collapse potential.

Soil Type 2 classified as native sandy clay (CL). The hard native clay was encountered in TB-1 at a depth of 8 feet bgs and extended to a depth of 12 feet bgs. One-dimensional swell or collapse testing on a sample of sandy clay resulted in a volume change of -0.1% indicating low collapse potential.

Soil Type 3 classified as sandstone bedrock of the Dawson formation, or very dense clayey sand, silty sand, and sand with clay when classified as a soil (SC, SM, SW-SC). The sandstone bedrock was encountered in all test borings except TB-6 at depths ranging from 3 to 12 feet bgs and extended to the termination depth of each boring, 20 feet bgs. The sandstone is expected to have a low potential for expansion or collapse.

Soil Type 4 classified as claystone bedrock of the Dawson formation, or hard sandy clay when classified as a soil (CL). The claystone was encountered in TB-2 underlying the Soil Type 1 and extended to 12 feet bgs. The claystone is expected to have a moderate potential for expansion or collapse.

For pavement design each soil type was classified using the AASHTO soil classifications system. Each soil type and corresponding AASHTO classification is listed below.

- Soil Type 1: A-2-4, A-1-b
- Soil Type 2: A-6
- Soil Type 3: A-2-4, A-1-b
- Soil Type 4: A-6

## **4.2 Groundwater**

Groundwater was encountered in borings TB-1 through TB-5 and TB-8 during our subsurface exploration program at depths ranging from 4.5 to 13 feet bgs. Shallow groundwater encountered on-site will need to be addressed as discussed in Sections 5.1, 5.4, and 7.1.2. Groundwater was measured at depths ranging from 6.5 to 13 feet bgs within the proposed building pad. It should be noted that groundwater levels could change due to seasonal variations, changes in land runoff characteristics, and future development of nearby areas.

## 5 Geotechnical Evaluation and Recommendations

*The following discussion is based on the subsurface conditions encountered in the borings drilled on the planned lot for construction. If subsurface conditions different from those described herein are encountered during construction, or if the project elements change from those described, Entech should be notified so that the evaluation and recommendations presented can be reviewed and revised if necessary.*

As discussed in Section 2, we understand that the site will be developed with a new church and associated site improvements. The proposed structure is expected to be supported on a shallow foundation system. Anticipated subsurface conditions will consist of native or recompacted silty sand.

### 5.1 Shallow Foundations

The proposed structure may be supported with shallow spread footing foundations placed on native silty sand, recompacted on-site granular material, or sandstone. We recommend that shallow foundations be founded a minimum of 3 feet above groundwater (maximum depth of 3.5 feet bgs). Depending on the conditions observed during the excavation, additional drains such as interceptor drains or a slab underdrain may be recommended.

The Dawson formation bedrock commonly includes interbedded expansive claystone layers. Cohesive soils and interbedded claystone may be encountered during subgrade preparation and, if encountered, should be overexcavated and prepared as discussed in Section 7.1.1.

Refer to Exhibit 1 below for recommended allowable bearing capacity values by subgrade type. Shallow foundations shall not be placed on uncontrolled fill or expansive soils or bedrock; refer to Section 7.1.1 for further discussion.

A spread footing (16") stemwall foundation system is anticipated for this site. Subgrades should be prepared as discussed in Section 7.1.1. Refer to Exhibit 1 for the recommended allowable bearing capacity values. Shallow foundations shall not be placed on differential bearing capacities, loose granular soil, cohesive soil, or uncontrolled fill. Actual bearing capacities will be verified at the time of the open excavation observation (Section 7.9).

Foundation walls should be designed to resist lateral pressures generated by the soils used for wall backfill. Recommended active equivalent fluid density parameters for the on-site granular

soils are provided in Exhibit 1. Clay/silt soils (more than 50% passing the No. 200 sieve) are not recommended for backfill against the walls. It should be noted that this value applies to level backfill conditions. If sloping backfill conditions exist, pressures will increase substantially depending on the conditions adjacent to the walls. Surcharge loading should also be considered in wall designs. Equivalent fluid pressures for sloping conditions should be determined on an individual basis. Exterior footings should extend a minimum of 30 inches below the adjacent exterior site grade for frost protection.

**Exhibit 1: Foundation Design Parameters**

<b>Design Parameter</b>	<b>Value</b>
<b>Allowable Bearing Capacity <sup>1,2</sup></b>	
Sandstone Bedrock	3,000 psf
Medium-Dense Silty Sand or Recompacted Granular Fill	2,400 psf
<b>Lateral Earth Pressure Equivalent Fluid Density <sup>3</sup></b>	
Active Conditions - Granular Backfill	40 pcf

*pcf = pounds per cubic foot; psf = pounds per square foot*

**Notes:**

1. Assumes a minimum embedment of 30 inches for frost protection.
2. Up to 1 inch of total settlement and ½ inch of differential settlement is anticipated for the bearing capacity value provided, assuming subgrades are prepared in accordance with Section 7.
3. Assumes level backfill conditions.

**5.2 On-Grade Floor Slabs**

On-grade floor slabs for the planned structures should be supported on compacted site or imported granular soils prepared in accordance with Section 7.1.1, and any loose soils or uncontrolled fill encountered will require removal.

Grade-supported floor slabs should be separated from other building structural components and utility penetrations to allow for possible future vertical movement. Interior partition walls should be constructed in such a manner so as not to transfer slab movement into the overlying floor(s) and/or roof members, should slab movement occur. Control joints in grade-supported slabs are recommended at 10- to 15-foot perpendicular spacings to control cracking. If slab movement cannot be tolerated, a structural floor system should be used.

### **5.3 Seismic Site Classification**

Based on the subsurface conditions encountered at the site, and in accordance with Section 1613 of the 2021 *International Building Code* (IBC), the site meets the conditions of a Site Class D.

### **5.4 Surface and Subsurface Drainage**

Positive surface drainage is recommended around the building's perimeter to minimize infiltration of surface water into the supporting foundation soils. A minimum ground surface slope of 5% in the first 10 feet adjacent to exterior foundation walls is recommended for unpaved areas. For paved areas and other impervious surfaces, a minimum slope of 2% is adequate. All roof drains and gutter downspouts should be extended to discharge well beyond the building's foundation backfill zone or be connected to a storm sewer system.

To help minimize infiltration of water into the foundation zone, vegetative plantings placed close to foundation walls should be limited to those species having low watering requirements, and irrigated grass should not be located within 5 feet of the foundation. Sprinklers are not recommended to discharge water within 5 feet of foundations. Irrigation near foundations should be limited to the minimum amount sufficient to maintain vegetation. Application of more irrigation water than necessary can increase the potential for slab and foundation movement.

Perimeter drains are recommended for usable space below grade (areas where the interior slab or bottom of the crawl space is below the exterior grade). A typical perimeter drain detail is shown in Figure 3. Additional drains, such as interceptor drains or a slab underdrain may be recommended if groundwater is encountered within 3.5 feet of the bottom of foundation components.

## **6 Pavement Design Recommendations**

Pavement design recommendations were made in accordance with the *El Paso County Engineering Criteria Manual*.

### **6.1 Pavement Subgrade Conditions**

Three test borings (TB-6, TB-7, and TB-8) were drilled to depths of approximately 10 feet below the existing subgrade surface in the parking lot and drive lanes. The soils at the roadway subgrade depth consisted of silty sand to sand with silt. The native sands, classified as A-2-4 using the

AASHTO classification system, were considered for pavement subgrades based on the laboratory testing.

California Bearing Ratio (CBR) testing was performed on a representative bulk sample of the silty sand (Soil Type 1) from TB-8 to determine the support characteristics of the subgrade soils for the pavement sections. The results of the CBR testing are presented in Appendix B and summarized in Exhibit 2.

**Exhibit 2: Pavement Subgrade Laboratory Summary**

Design Parameter	Value
Soil Type	1-Silty Sand
CBR at 95%	21.0
Design CBR	10
Liquid Limit	NV
Plasticity Index	NP
Percent Passing 200	17.8
AASHTO Classification	A-2-4
Group Index	0
Unified Soils Classification	SM

## 6.2 Swell Mitigation

El Paso County recommendations require swell mitigation of expansive soils criteria for roadway subgrade with swell testing results greater than 2% under a 150 pounds per square foot (psf) surcharge. Based on the classification of the soils, mitigation for expansive soils is not expected to be required on this site. However, due to shallow Dawson formation bedrock encountered, on-site cohesive soils or claystone may be encountered and swell mitigation may be required.

## 6.3 Traffic Loading

Traffic data is not available for the parking lot and access road. Based on the Colorado Asphalt Pavement Association (CAPA) *Guideline for the Design and Construction of Asphalt Parking Lots in Colorado* (2006), an 18-kip equivalent single axle loading (ESAL) of 100,000 is appropriate for moderate traffic level which includes passenger cars and light trucks.

## 6.4 Pavement Designs

The recommended flexible pavement sections were determined utilizing the *El Paso County Engineering Criteria Manual*, the CBR testing, and design ESAL value. Design parameters used in the pavement analysis are presented in Exhibit 3.

**Exhibit 3: Pavement Design Parameters**

Design Parameter	Value
Reliability	80%
Standard Deviation	0.45
Serviceability Loss ( $\Delta$ psi)	2.0
Design CBR	10
Resilient Modulus	15,000 psi
Standard Deviation	0.44
Structural Coefficients	
Hot Bituminous Pavement	0.44
Aggregate Base Course	0.11
Recycled Concrete Base	0.11

Pavement sections are presented below in Exhibit 4. Any additional grading may result in subgrade soils with different support characteristics. The following pavement sections should be re-evaluated if additional grading is performed.

**Exhibit 4: Recommended Pavement Sections**

Pavement Area	Design ESAL	Alternative <sup>1</sup>
Parking Areas and Drive Lanes	100,000	1. 4.0 inches HMA over 4.0 inches ABC/RCB

*ABC = Aggregate Base Course; ESAL = equivalent single axle loads; HMA = Hot Mix Asphalt; RCB = Recycled Concrete Base*

**Notes:**

1. The pavement alternatives meet the minimum sections required per the *El Paso County Engineering Criteria Manual*.

## 7 Construction Recommendations

### 7.1 Earthwork Recommendations for Structures

#### 7.1.1 Subgrade Preparation

If loose materials are encountered during subgrade preparation, they should be overexcavated to suitable, dense underlying soils and recompact in place or replaced with granular fill (Section 7.1.4 and 7.1.5). All soil beneath the foundation and slabs should be free of organics, debris, and cobbles larger than 3 inches in diameter. Shallow groundwater, if encountered, should be addressed as discussed in 7.1.2.

The foundation should be supported by soils with a similar bearing capacity (i.e., entirely on sand or entirely on sandstone bedrock). If the majority of the foundation is supported by sandstone and a relatively small portion supported by sand, the sand should be stepped down in order for the foundation to bear on sandstone, or the sand can be overexcavated and recompacted to a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density. Similarly, if the foundation subgrade is primarily medium-dense sand, any sandstone encountered should be overexcavated a minimum of 2 feet and replaced with recompacted site granular material.

Prior to site earthwork, any ponded water should be drained and surface runoff should be directed away from earthwork areas. If water is allowed to sit, pond, or infiltrate into the foundation subgrade, it will likely create unstable subgrade conditions.

### **7.1.2 Shallow Groundwater**

If shallow groundwater is encountered during subgrade preparation, we recommend overexcavating 6 to 12 inches below the base of foundation elements, pushing 2- to 4-inch shot rock into the subgrade for stabilization, as required, followed by a layer of Tensar BX1200 geogrid (or equivalent). The stabilization should extend a minimum of 2 feet beyond footings. We then recommend placing compacted granular fill in accordance with Section 7.1.4 and 7.1.5. After placement of backfill, the subgrade should be proof-rolled and evaluated to ensure that subgrade is not pumping. Based on the groundwater conditions encountered at the time of excavation, dewatering methods may be required. This could include diversion ditches, pumping, or capillary drains. Additional subsurface drains, such as interceptor drains or a slab underdrain, may be recommended, and should be determined at the time of our construction observation.

### **7.1.3 Swell Mitigation**

Expansive cohesive soils were not encountered on-site, however, expansive claystone is commonly interbedded in sandstone bedrock. An exploratory boring or test pit should be completed from the final subgrade elevation and slab-on-grade elevation to a depth of 4 feet. Expansive soils or bedrock must be penetrated or removed and replaced with recompacted granular fill (Section 7.1.4 and 7.1.5) if encountered during subgrade preparation or on-grade floor slab elevation. An overexcavation depth of 4 feet is anticipated where expansive soils are encountered, however the depth of overexcavation, if needed, should be determined at the time of the excavation observation on each lot.

If required, overexcavations should extend laterally beyond planned footings a minimum distance equal to the depth below planned footings (e.g. a 4-foot overexcavation should extend 4 feet beyond the edge of the foundation). The final overexcavation subgrade should be scarified a minimum of 8 inches, moisture conditioned 0 to +3% and be compacted to a minimum of 95% of the Standard Proctor (ASTM D698) for cohesive soils or bedrock or Modified Proctor (ASTM D1557) maximum dry density for cohesionless materials, respectively.

#### **7.1.4 Granular Fill**

Granular fill placed beneath foundation components and floor slabs shall consist of nonexpansive, granular soil free of organic matter, unsuitable materials, debris, and cobbles greater than 3 inches in diameter. On-site granular soils or properly processed sandstone may be used as granular fill. Entech should approve any imported granular or structural fill to be used within the foundation area prior to delivery to the site.

#### **7.1.5 Fill Placement and Compaction**

All granular fill placed within the foundation area should be compacted to a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density at +/- 2% of optimum moisture content. Fill material should be placed in horizontal lifts such that each finished lift has a compacted thickness of 6 inches or less as determined by ASTM D1557. Mechanical methods can be used for placement and compaction of fill; however, heavy equipment should be kept at a distance from foundation walls and below slab infrastructure to avoid overstressing. No water flooding techniques of any type should be used for compaction or placement of foundation or floor slab fill material.

Fill placement and compaction beneath and around foundations should be observed and tested by Entech during construction. Density tests should be performed frequently to verify compaction with the first density test performed at the overexcavated subgrade elevation and with additional testing once each 12 to 18 inches of granular fill has been placed.

### **7.2 Pavements**

Pavement design recommendations provided herein are contingent on good construction practices, and poor construction techniques may result in poor performance. Our analyses assumed that this project will be constructed according to the *El Paso County Engineering Criteria Manual* and the *Pike Peak Regional Asphalt Paving Specifications*.

### **7.2.1 Pavement Subgrade Preparation**

Proper subgrade preparation is required for adequate pavement performance. Paving areas should be cleared of all deleterious materials including but not limited to: existing pavements, utility poles, and fence poles. Surface vegetation should be removed by stripping, with the depth to be field determined.

The final subgrade surface should be scarified to a depth of 8 inches, a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density at +/-2% of optimum moisture content. The compacted surface below pavements should be proof-rolled with a fully loaded, tandem-axle, 10-yard dump truck or equivalent. Any areas that are delineated to be soft, loose, or yielding during proof-rolling should be removed and reconditioned or replaced.

### **7.2.2 Aggregate Base Course and Recycled Concrete Base**

ABC or RCB materials shall conform to the *El Paso County Standard Specifications Manual*, Section 300 Aggregate Base Course. ABC or RCB materials should be compacted to a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density within +/-2% of optimum moisture content.

### **7.3 Excavation Potential**

Excavation of the upper granular soils should be feasible with rubber-tired equipment.

### **7.4 Excavation Stability**

Excavation sidewalls must be properly sloped, benched, and/or otherwise supported in order to maintain stable conditions. All excavation openings and work completed therein shall conform to OSHA Standards as put forward in CFR 29, Part 1926.650-652, (Subpart P).

### **7.5 Utility Trench Backfill**

Trench backfill placement should be performed in accordance with El Paso County specifications. All excavation and excavation shoring/bracing should be performed in accordance with OSHA guidelines.

Fill placement and compaction in utility trenches should be observed and tested by Entech during construction. Fill should be placed in horizontal lifts having a compacted thickness of 6 inches or less and at a water content conducive to adequate compaction, within +/-2% of optimum water

content. No water flooding techniques of any type should be used for compaction or placement of utility trench fill.

## **7.6 General Backfill**

Any areas to receive general grading fill should have all topsoil, organic material, and debris removed. Fill must be properly benched into existing slopes in order to be adequately compacted. The fill-receiving surface should be scarified to a depth of 12 inches, a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density at +/-2% of optimum moisture content or the Standard Proctor (ASTM D698) for cohesive soils before the addition of new fill. Fill should be placed in thin lifts not to exceed 6 inches in thickness. Fill material should be free of vegetation and other unsuitable material and should not contain cobbles or fragments larger than 3 inches. Topsoil and strippings should be segregated from all other fill sources on the site. Fill placement and compaction beneath and around foundations, in utility trenches, or beneath roadways or other structural features of the project should be observed and tested by Entech during construction.

## **7.7 Concrete Degradation Due to Sulfate Attack**

Sulfate solubility testing was conducted on several samples recovered from the test borings to evaluate the potential for sulfate attack on concrete placed below surface grade. The test results indicated less than 0.01 and 0.00% soluble sulfate (by weight). The test results indicate the sulfate component of the in-place soils presents a negligible exposure threat to concrete placed below the site grade.

Type 1L or Type II cement is recommended for concrete on the site. To further avoid concrete degradation during construction it is recommended that concrete not be placed on frozen or wet ground. Care should be taken to prevent the accumulation or ponding of water in the foundation excavation prior to the placement of concrete. If standing water is present in the foundation excavation, it should be removed by ditching to sumps and pumping the water away from the foundation area prior to concrete placement. If concrete is placed during periods of cold temperatures, the concrete must be kept from freezing. This may require covering the concrete with insulated blankets and adding heat to prohibit freezing.

## **7.8 Winter Construction**

In the event construction of the planned facility occurs during winter, foundations and subgrades should be protected from freezing conditions. Concrete should not be placed on frozen soil and once concrete has been placed, it should not be allowed to freeze. Similarly, once exposed, the

foundation subgrade should not be allowed to freeze. During site grading and subgrade preparation, care should be taken to eliminate the burial of snow, ice, or frozen material within the planned construction area.

### **7.9 Foundation Excavation and Construction Observation**


Subgrade preparation for building foundations should be observed by Entech prior to construction of the footings and floor slabs in order to verify that (1) no anomalies are present, (2) materials similar to those described in this report have been encountered or placed, and (3) no soft spots, expansive or organic soil, or debris are present in the foundation area prior to concrete placement or backfilling. Entech should make final recommendations for overexcavation, if required, and foundation drainage at the time of excavation observation, if necessary.

In addition, Entech should observe and document placement and compaction of utility bedding and trench backfill.

## **8 Closure**

The subsurface investigation, geotechnical evaluation, and recommendations presented in this report are intended for use by Seed Development Services, LLC with application to the planned new construction of a church located in Falcon, Colorado. In conducting the subsurface investigation, laboratory testing, engineering evaluation and reporting, Entech Engineering, Inc. endeavored to work in accordance with generally accepted professional geotechnical and geologic practices and principles consistent with the level of care and skill ordinarily exercised by members of the geotechnical profession currently practicing in the same locality and under similar conditions. No other warranty, expressed or implied, is made. During final design and/or construction, if conditions are encountered which appear different from those described in this report, Entech Engineering, Inc. requests to be notified so that the evaluation and recommendations presented herein can be reviewed and modified as appropriate.

If there are any questions regarding the information provided herein, or if Entech Engineering, Inc. can be of further assistance, please do not hesitate to contact us.

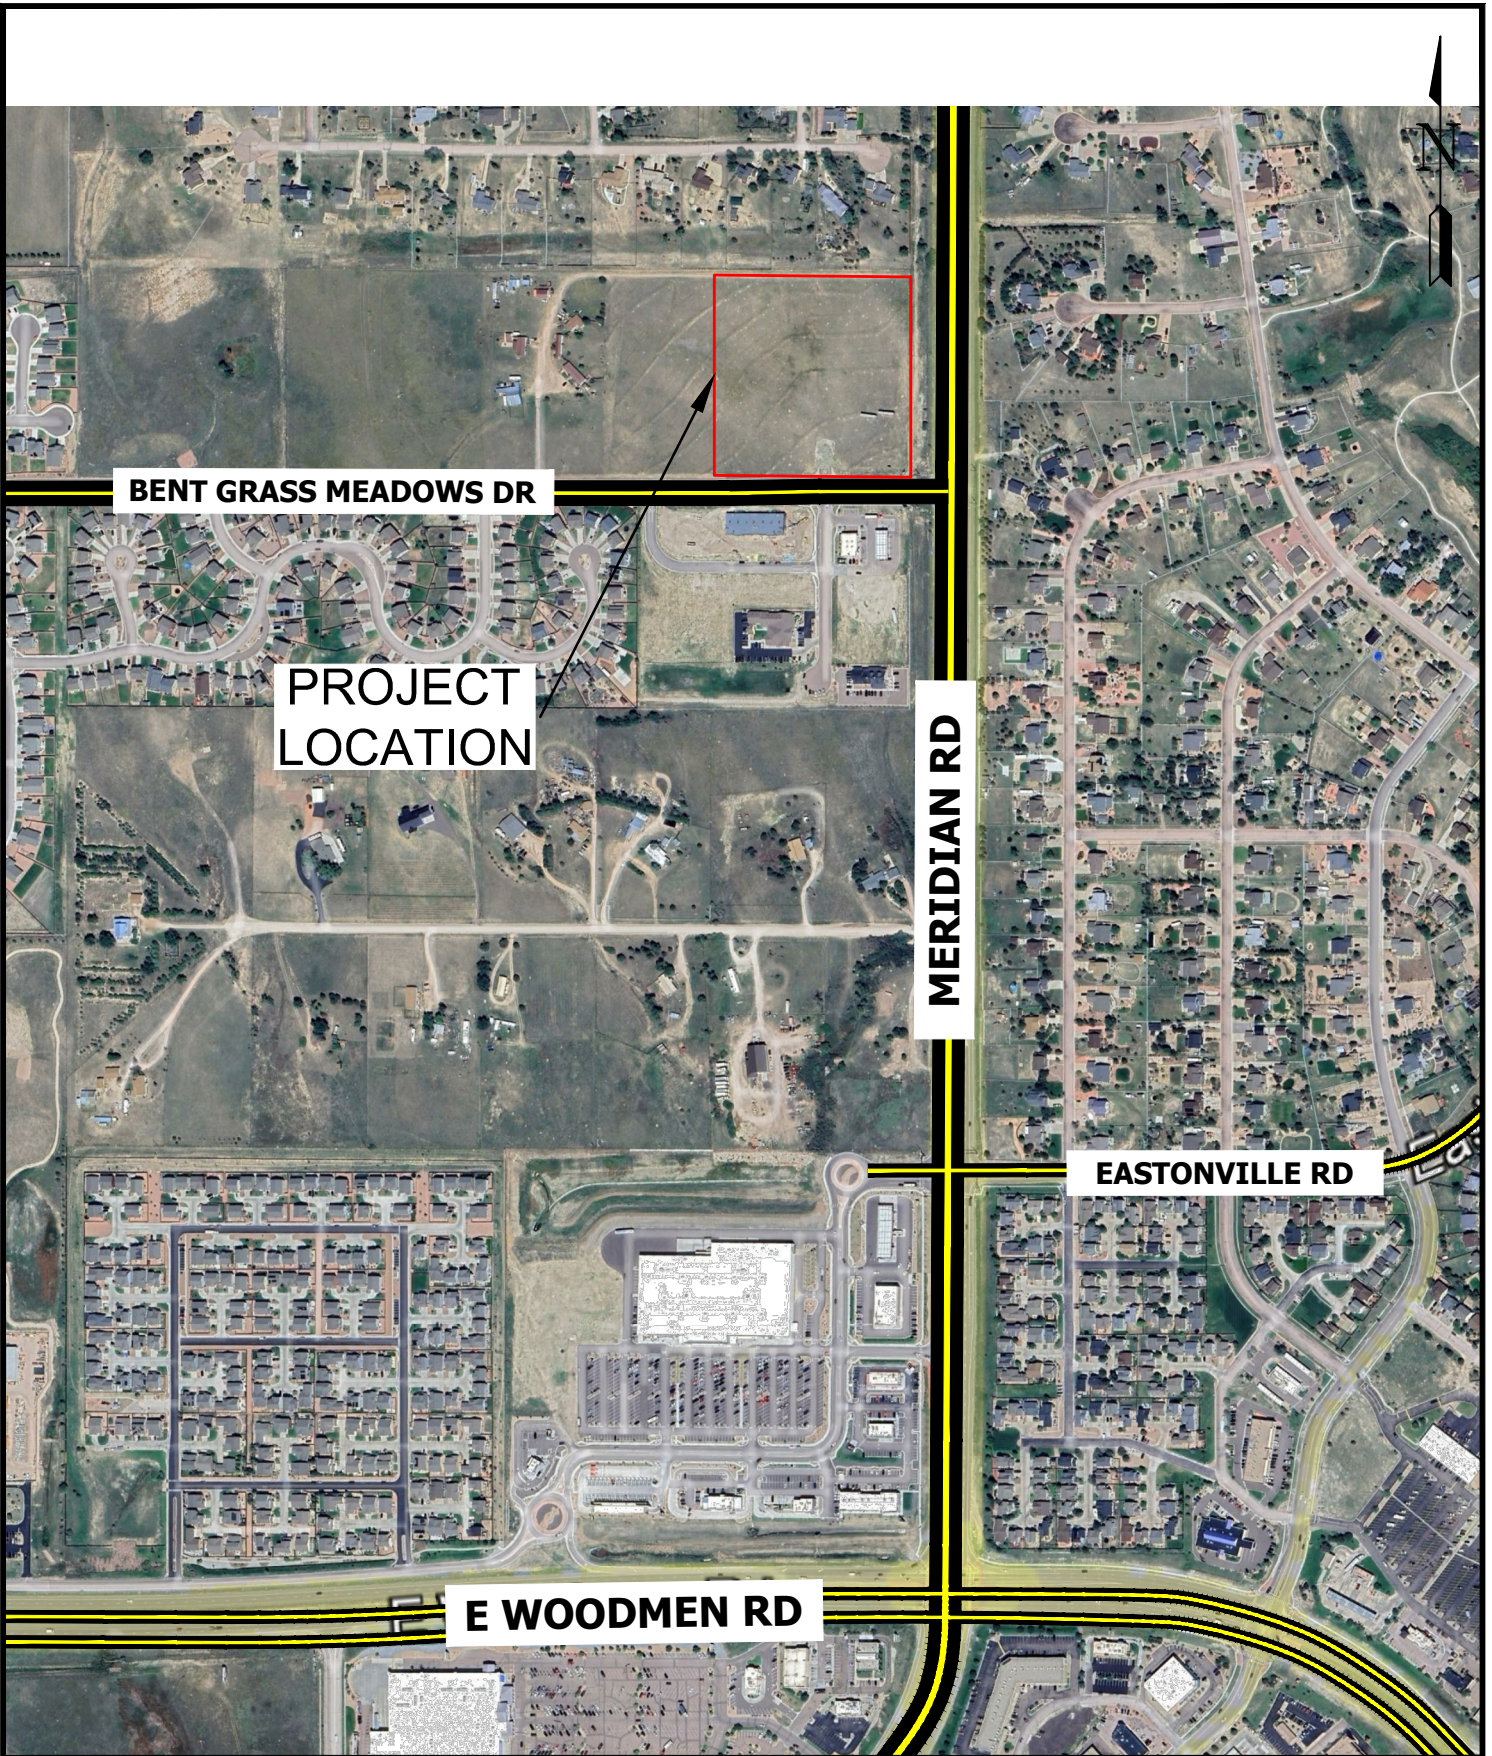

**BENT GRASS MEADOWS DR**

**PROJECT  
LOCATION**

**MERIDIAN RD**

**EASTONVILLE RD**

**E WOODMEN RD**




**VICINITY MAP**  
LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719

**FIG. 1**



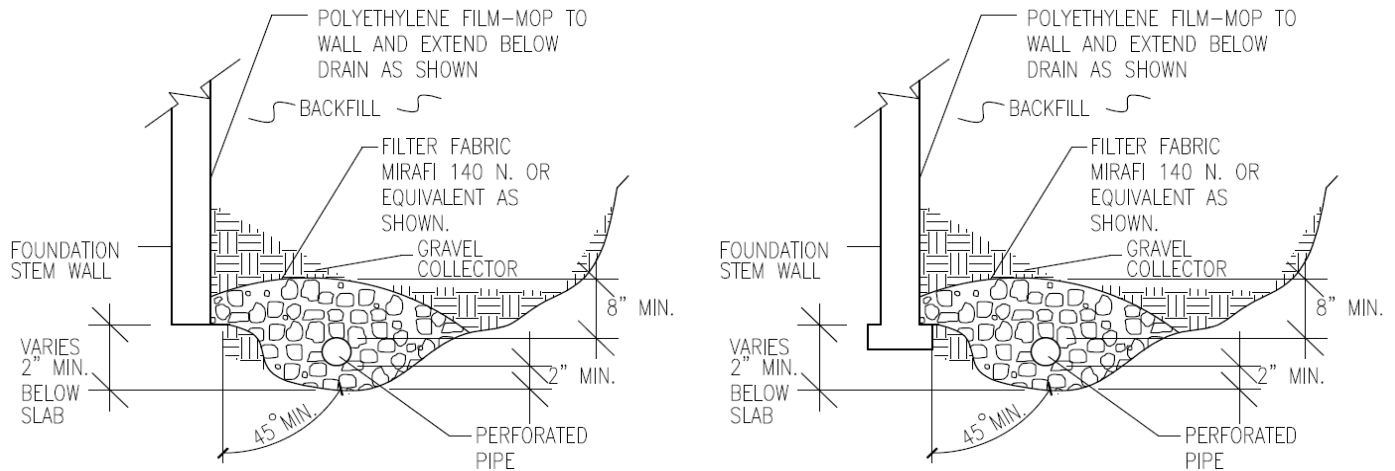

NOTES:

-GRAVEL SIZE IS RELATED TO DIAMETER OF PIPE PERFORATIONS-85% GRAVEL GREATER THAN 2x PERFORATION DIAMETER.

-PIPE DIAMETER DEPENDS UPON EXPECTED SEEPAGE. 4-INCH DIAMETER IS MOST OFTEN USED.

-ALL PIPE SHALL BE PERFORATED PLASTIC. THE DISCHARGE PORTION OF THE PIPE SHOULD BE NON-PERFORATED PIPE.

-FLEXIBLE PIPE MAY BE USED UP TO 8 FEET IN DEPTH, IF SUCH PIPE IS DESIGNED TO WITHSTAND THE PRESSURES. RIGID PLASTIC PIPE WOULD OTHERWISE BE REQUIRED.

-MINIMUM GRADE FOR DRAIN PIPE TO BE 1% OR 3 INCHES OF FALL IN 25 FEET.

-DRAIN TO BE PROVIDED WITH A FREE GRAVITY OUTFALL, IF POSSIBLE. A SUMP AND PUMP MAY BE USED IF GRAVITY OUTFALL IS NOT AVAILABLE.



**PERIMETER DRAIN DETAIL**

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719

**FIG. 3**



## **APPENDIX A: Test Boring Logs**

TEST BORING 1  
DATE DRILLED 10/16/2024

TEST BORING 2  
DATE DRILLED 10/16/2024

REMARKS

REMARKS

WATER @ 13', 10/31/24

WATER @ 6.5', 10/31/24

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0-6"					6" TOPSOIL
6-10			24	1.6	1
10-15			26	5.9	1
15-20			50	8.4	3
20-25			50	9.6	3

SAND, WITH SILT, TAN to LIGHT BROWN, MEDIUM DENSE, DRY to MOIST

CLAY, SANDY, LIGHT BROWN, HARD, MOIST (CLAYSTONE, VERY WEAK, HIGHLY WEATHERED)

SANDSTONE, VERY WEAK, GRAY, HIGHLY WEATHERED (SAND, CLAYEY, VERY DENSE, MOIST)

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0-6"					6" TOPSOIL
6-10			34	1.5	1
10-15			18	5.8	1
15-20			50	13.4	4
20-25			50	10.7	3
25-30			50	27.5	3

SAND, SILTY, TAN, DENSE to MEDIUM DENSE, DRY to MOIST

CLAYSTONE, VERY WEAK, TAN, HIGHLY WEATHERED (CLAY, SANDY, HARD, MOIST)  
SANDSTONE, WEAK, GRAY, COMPLETELY WEATHERED (SAND, SILTY, VERY DENSE, MOIST to WET)



**TEST BORING LOGS**  
LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719

**FIG. A-1**

TEST BORING 3  
 DATE DRILLED 10/17/2024

TEST BORING 4  
 DATE DRILLED 10/17/2024

REMARKS

REMARKS

WATER @ 7.5', 10/31/24

WATER @ 10', 10/31/24

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0 - 6"					6" TOPSOIL
6" - 10'			23	2.1	1 SAND, WITH SILT, TAN to BROWN, MEDIUM DENSE, DRY to MOIST
10' - 15'			19	5.4	1 SAND, CLAYEY, GRAY, MEDIUM DENSE, MOIST
15' - 20'			50	13.2	3 SANDSTONE, VERY WEAK, BROWN to GREEN-GRAY, HIGHLY WEATHERED (SAND, SILTY, VERY DENSE, MOIST)
			8"		
20' - 25'			50	8.3	3
			9"		
25' - 30'			50	11.8	3
			9"		

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0 - 6"					6" TOPSOIL
6" - 10'			23	1.6	1 SAND, SILTY, BROWN, MEDIUM DENSE, DRY
10' - 15'			27	9.3	1 SAND, CLAYEY, GRAY, MEDIUM DENSE, MOIST
15' - 20'			50	9.7	3 SANDSTONE, VERY WEAK, GRAY to GREEN-GRAY, HIGHLY WEATHERED (SAND, SILTY, VERY DENSE, MOIST)
			6"		
20' - 25'			50	9.4	3
			6"		
25' - 30'			50	13.8	3
			9"		



**TEST BORING LOGS**  
 LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. A-2**

TEST BORING 5  
 DATE DRILLED 10/17/2024

TEST BORING 6  
 DATE DRILLED 10/17/2024

REMARKS

REMARKS

WATER @ 8', 10/31/24

6" TOPSOIL

SAND, SILTY, BROWN, MEDIUM  
 DENSE, DRY

SANDSTONE, VERY WEAK,  
 GRAY, MODERATELY WEATHERED  
 (SAND, SILTY, VERY DENSE,  
 MOIST)



Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0-6	Diagonal lines				1
6-11	Diagonal lines		11	1.3	1
11-18	Diagonal lines		18	2.2	1
18-29	Diagonal lines				
29-30	Diagonal lines				
30-41	Stippled		50 11"	10.0	3
41-51	Stippled		50 10"	12.4	3
51-60	Stippled		50 9"	11.8	3

DRY TO 10', 10/31/24

6" TOPSOIL

SAND, CLAYEY, BROWN, MEDIUM  
 DENSE to LOOSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0-6	Diagonal lines				1
6-16	Diagonal lines		16	6.6	1
16-27	Diagonal lines		27	5.6	1
27-35	Diagonal lines				
35-43	Diagonal lines		8	24.6	1
43-60	Diagonal lines				



**TEST BORING LOGS**  
 LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. A-3**

TEST BORING 7  
 DATE DRILLED 10/17/2024

TEST BORING 8  
 DATE DRILLED 10/17/2024

REMARKS

REMARKS

DRY TO 10', 10/31/24

6" TOPSOIL  
 SAND, SILTY, BROWN, MEDIUM  
 DENSE, DRY to MOIST

SANDSTONE, VERY WEAK,  
 BROWN, HIGHLY WEATHERED  
 (SAND, CLAYEY, VERY DENSE,  
 MOIST)

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0-6"			10	1.8	1
6-10'			19	7.2	1
10-11.1'			50 7"	11.1	3

WATER @ 4.5', 10/31/24

6" TOPSOIL  
 SAND, WITH SILT, TAN, MEDIUM  
 DENSE, DRY  
 SANDSTONE, VERY WEAK,  
 BROWN, COMPLETELY  
 WEATHERED (SAND, WITH CLAY,  
 VERY DENSE, MOIST)

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
0-6"			24	2.0	1
6-10.6'			50 10"	10.6	3
10.6-11.7'			50 7"	11.7	3



**TEST BORING LOGS**  
 LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. A-4**

**TABLE A-1**  
**DEPTH TO GROUNDWATER & BEDROCK**

TEST BORING	DEPTH TO GROUNDWATER (ft.)	DEPTH TO BEDROCK (ft.)
1	13	12
2	6.5	12
3	7.5	7
4	10	8
5	8	8
6	>10	>10
7	>10	7
8	4.5	3



## **APPENDIX B: Laboratory Test Results**

**TABLE B-1  
SUMMARY OF LABORATORY TEST RESULTS**




SOIL TYPE	TEST BORING NO.	DEPTH (FT)	WATER (%)	DRY DENSITY (PCF)	PASSING NO. 200 SIEVE (%)	LIQUID LIMIT	PLASTIC LIMIT	PLASTIC INDEX	SULFATE (WT %)	SWELL/ COLLAPSE (%)	AASHTO CLASS. (GROUP INDEX)	USCS	SOIL DESCRIPTION
1, CBR	8	0-3	2.0		17.8	NV	NP	NP			A-2-4 (0)	SM	SAND, SILTY
1	1	2-3	1.6		7.7	NV	NP	NP	<0.01			SW-SM	SAND, WITH SILT
1	6	0-3	2.3		22.5	NV	NP	NP				SM	SAND, SILTY
1	3	5	5.4		10.9				0.00			SM	SAND, WITH SILT
1	4	5	11.1	114.5	49.4					-0.4		SC	SAND, CLAYEY
1	6	1-2	6.6		43.2	28	19	9			A-4 (1)	SC	SAND, CLAYEY
1	6	10	21.0	102.1	43.9	32	21	11	0.00	0.0	A-6 (2)	SC	SAND, CLAYEY
1	7	1-2	1.8		16.7	NV	NP	NP	<0.01		A-2-4 (0)	SM	SAND, SILTY
1	8	1-2	2.0		8.0	NV	NP	NP			A-1-b (0)	SW-SM	SAND, WITH SILT
2	1	10	13.2	117.6	58.7	36	24	12	0.00	-0.1	A-6 (5)	CL	CLAY, SANDY
3	8	5	10.6		10.8	32	23	9	<0.01		A-2-4 (0)	SW-SC	SANDSTONE (SAND, WITH CLAY)
3	5	10	10.0		23.9							SM	SANDSTONE (SAND, SILTY)
3	2	15	10.7		21.0	NV	NP	NP				SM	SANDSTONE (SAND, SILTY)
4	2	10	13.5	102.6	55.9	37	24	13	0.00			CL	CLAYSTONE (CLAY, SANDY)

TEST BORING 8  
 DEPTH (FT) 0-3

SOIL DESCRIPTION SAND, SILTY  
 SOIL TYPE 1, CBR

**Sieve Analysis  
 Grain Size Distribution**

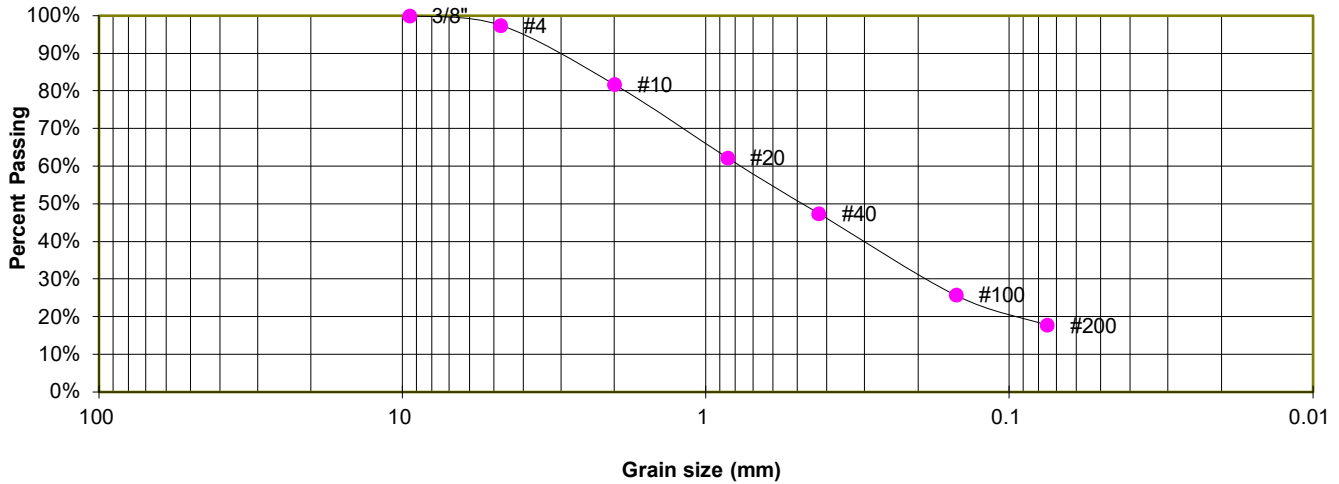

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	97.5%
10	81.7%
20	62.3%
40	47.4%
100	25.7%
200	17.8%

**ATTERBERG LIMITS**

Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SM  
 AASHTO CLASSIFICATION: A-2-4  
 AASHTO GROUP INDEX: 0



**LABORATORY TEST RESULTS**

LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES


JOB NO.  
 241719

**FIG. B-1**

TEST BORING 1  
 DEPTH (FT) 2-3

SOIL DESCRIPTION SAND, WITH SILT  
 SOIL TYPE 1

**Sieve Analysis  
 Grain Size Distribution**

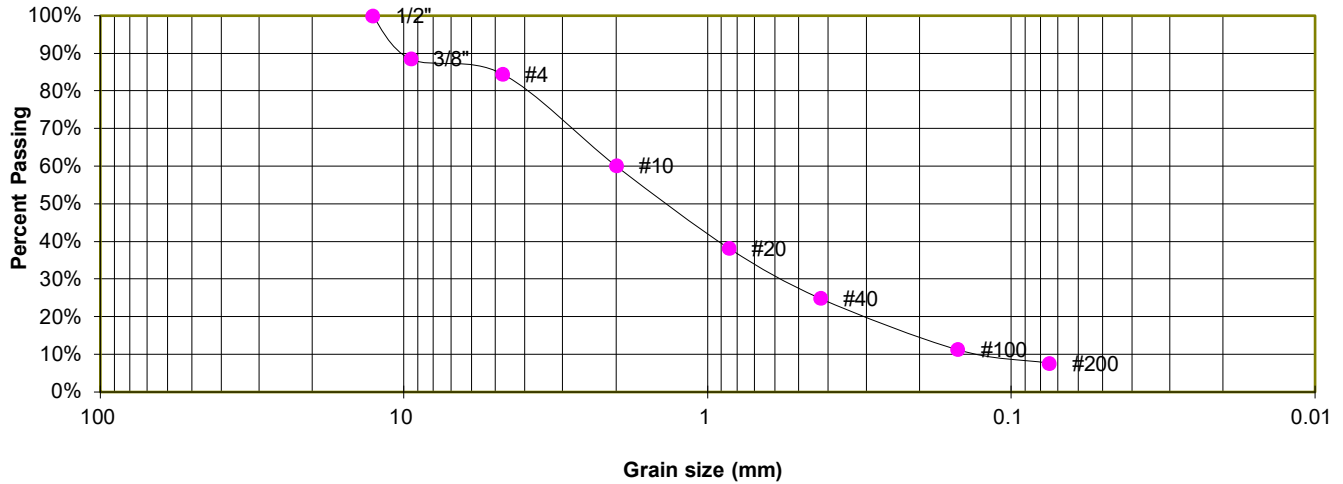

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	88.5%
4	84.5%
10	60.1%
20	38.2%
40	24.9%
100	11.3%
200	7.7%

**ATTERBERG LIMITS**

Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SW-SM



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-2**

TEST BORING 6  
 DEPTH (FT) 0-3

SOIL DESCRIPTION SAND, SILTY  
 SOIL TYPE 1

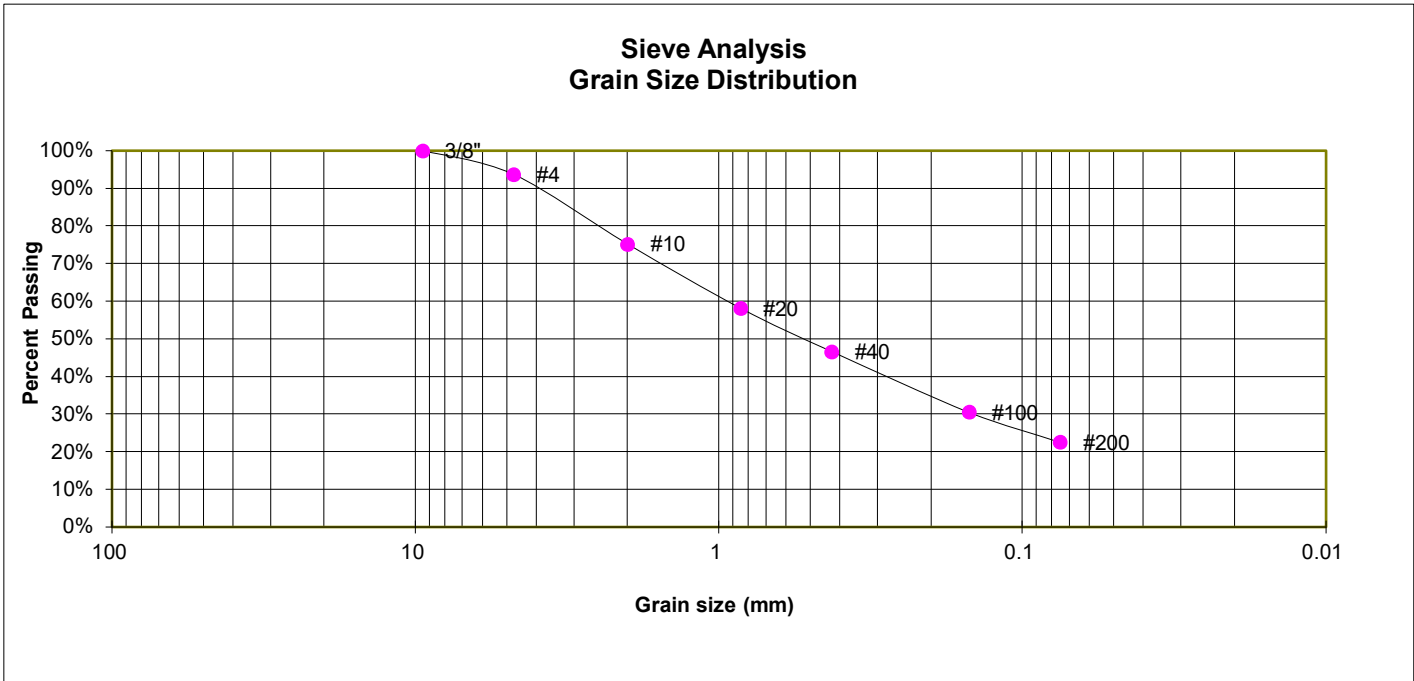

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	93.7%
10	75.2%
20	58.2%
40	46.6%
100	30.6%
200	22.5%

**ATTERBERG LIMITS**

Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SM  
 AASHTO CLASSIFICATION: A-2-4  
 AASHTO GROUP INDEX: 0



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-3**

TEST BORING 3  
 DEPTH (FT) 5

SOIL DESCRIPTION SAND, WITH SILT  
 SOIL TYPE 1

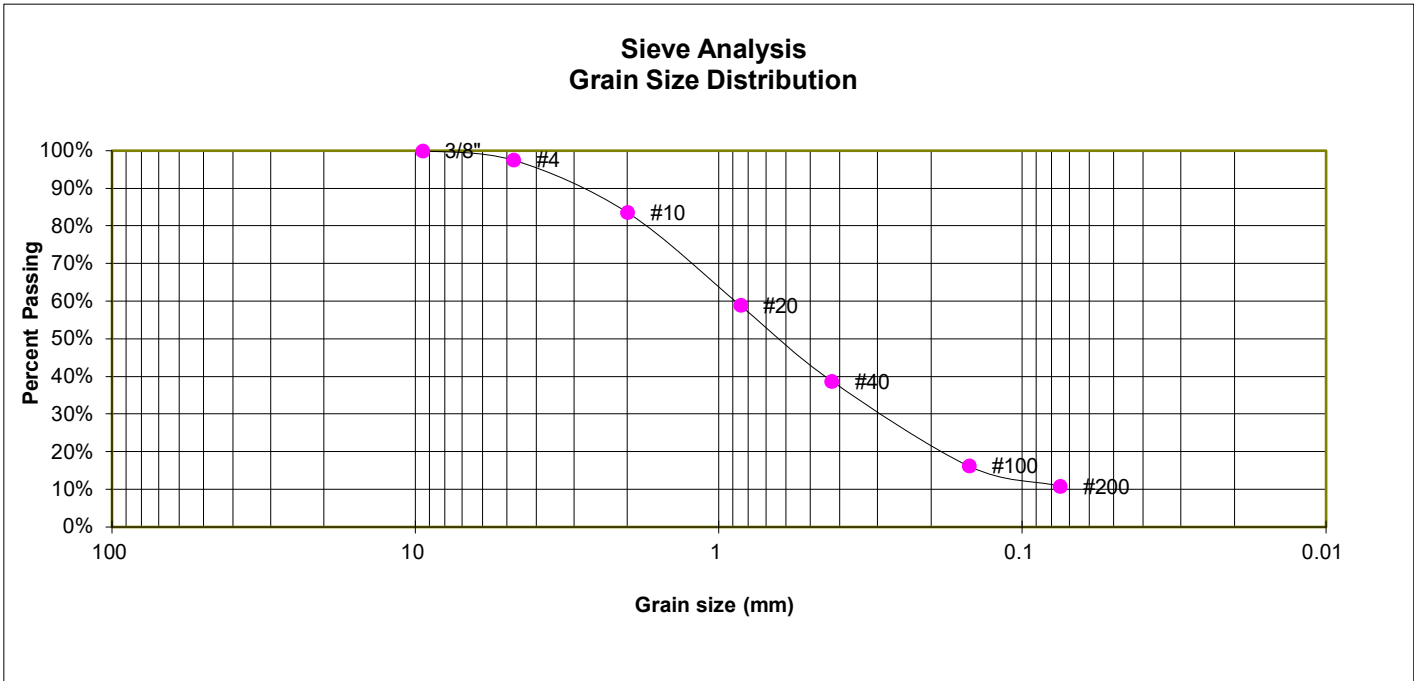

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	97.5%
10	83.6%
20	58.9%
40	38.8%
100	16.3%
200	10.9%

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SM



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-4**

TEST BORING 4  
DEPTH (FT) 5

SOIL DESCRIPTION SAND, CLAYEY  
SOIL TYPE 1

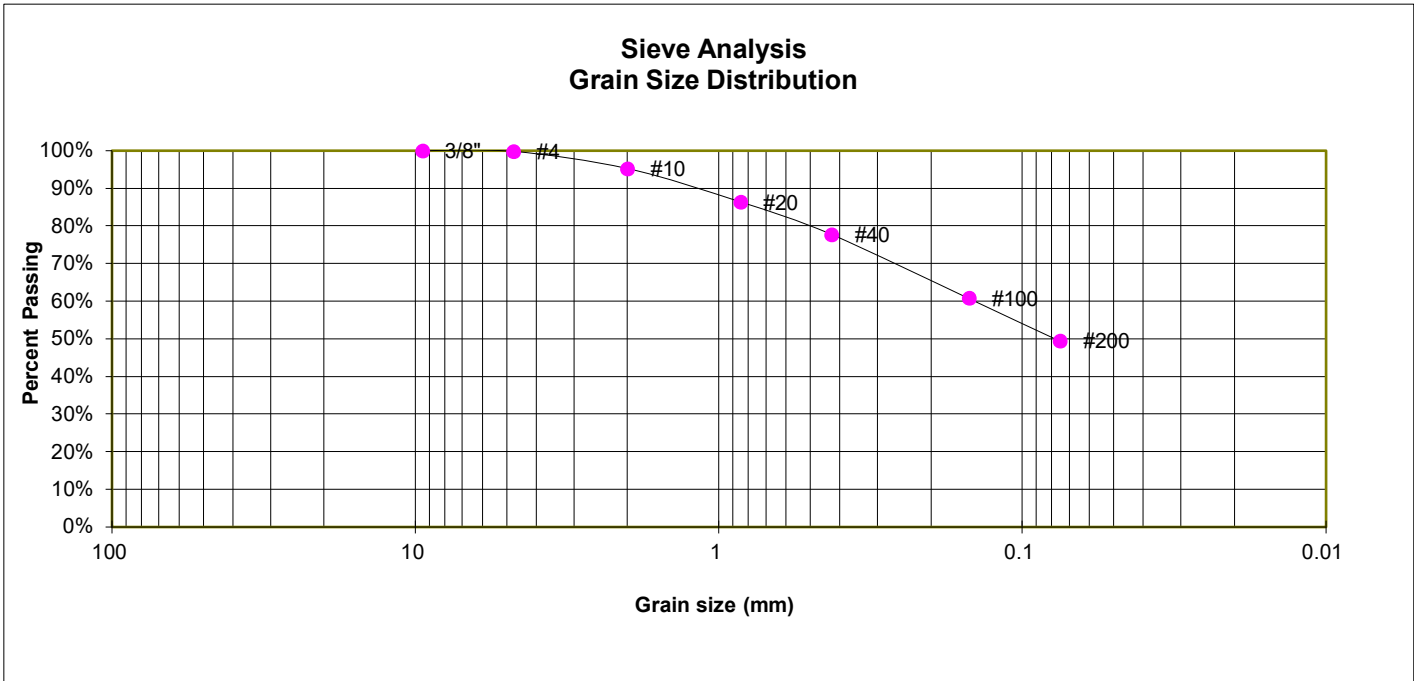

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	99.8%
10	95.2%
20	86.4%
40	77.7%
100	60.8%
200	49.4%

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SC



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719

**FIG. B-5**

TEST BORING 6  
 DEPTH (FT) 1-2

SOIL DESCRIPTION SAND, CLAYEY  
 SOIL TYPE 1

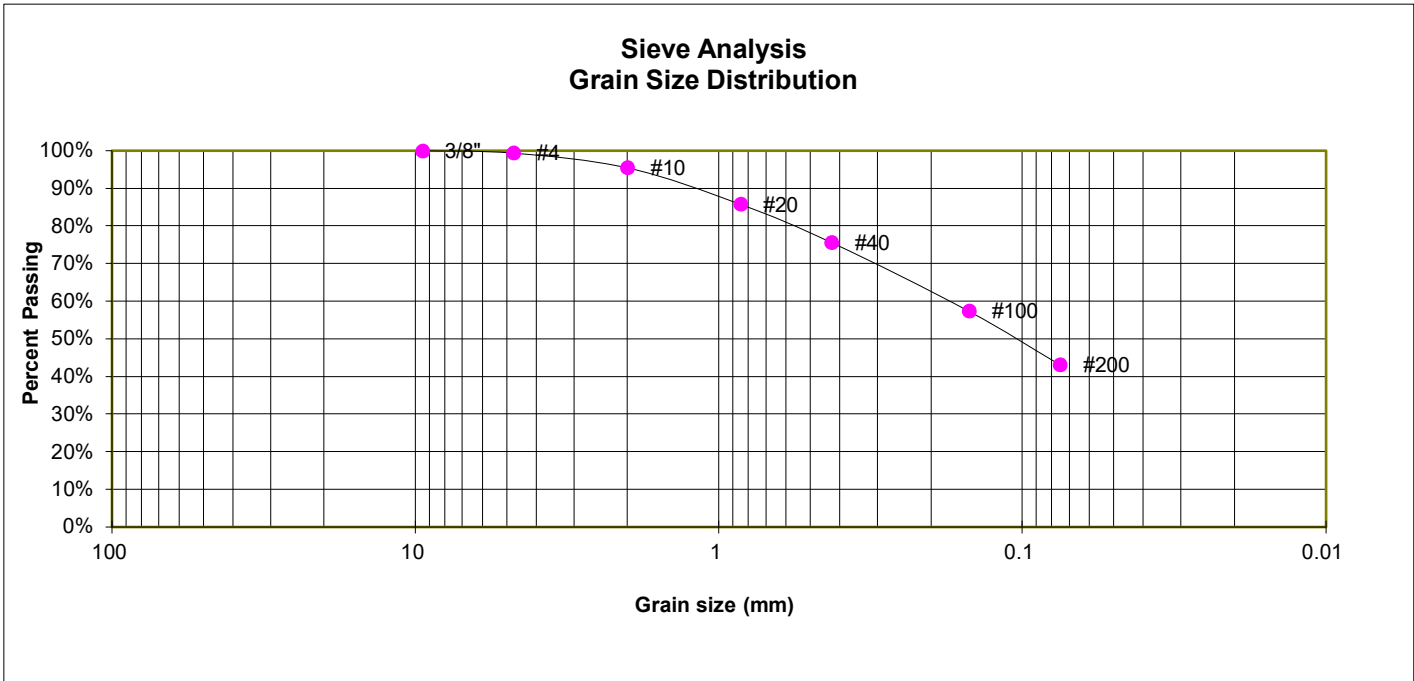

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	99.4%
10	95.5%
20	85.8%
40	75.6%
100	57.4%
200	43.2%

**ATTERBERG LIMITS**

Plastic Limit	19
Liquid Limit	28
Plastic Index	9

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SC  
 AASHTO CLASSIFICATION: A-4  
 AASHTO GROUP INDEX: 1



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-6**

TEST BORING 6  
 DEPTH (FT) 10

SOIL DESCRIPTION SAND, CLAYEY  
 SOIL TYPE 1

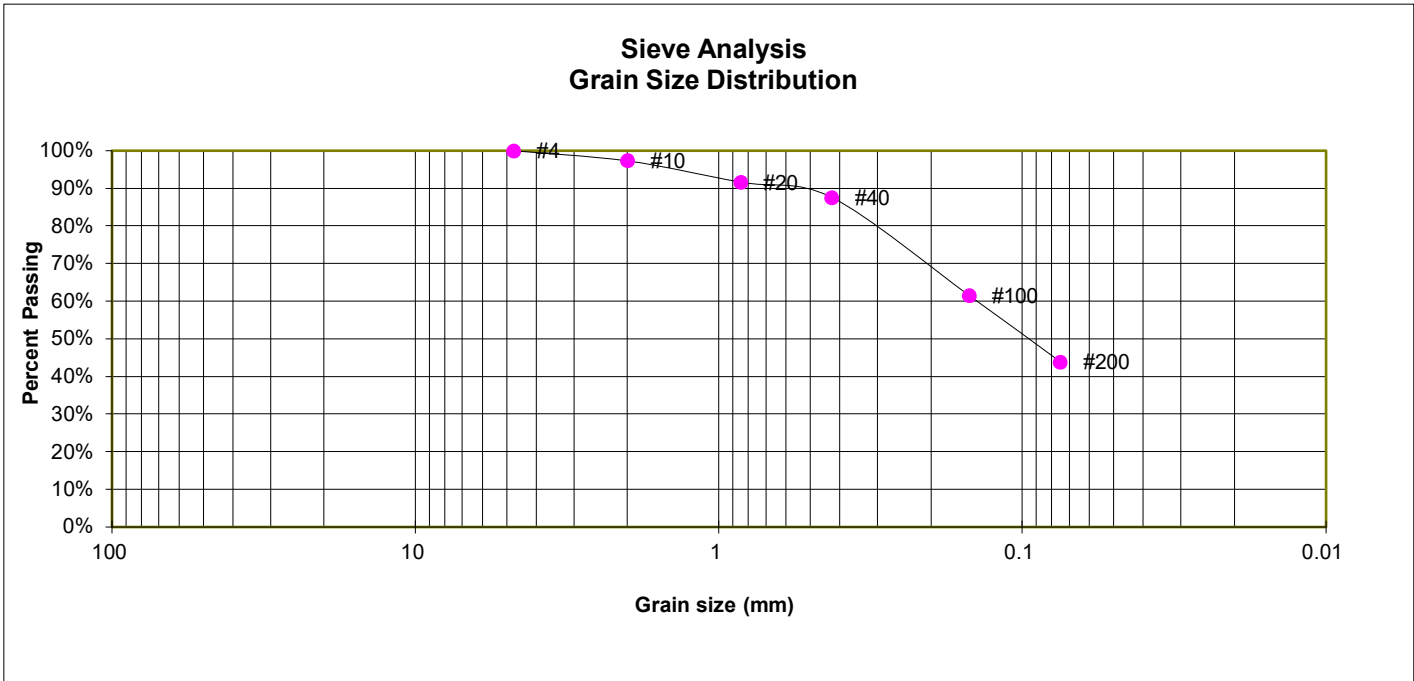

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	97.4%
20	91.7%
40	87.6%
100	61.6%
200	43.9%

**ATTERBERG LIMITS**

Plastic Limit	21
Liquid Limit	32
Plastic Index	11

**SOIL CLASSIFICATION**

USCS CLASSIFICATION:	SC
AASHTO CLASSIFICATION:	A-6
AASHTO GROUP INDEX:	2



**LABORATORY TEST RESULTS**

LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES


JOB NO.  
 241719

**FIG. B-7**

TEST BORING 7  
 DEPTH (FT) 1-2

SOIL DESCRIPTION SAND, SILTY  
 SOIL TYPE 1

**Sieve Analysis  
 Grain Size Distribution**

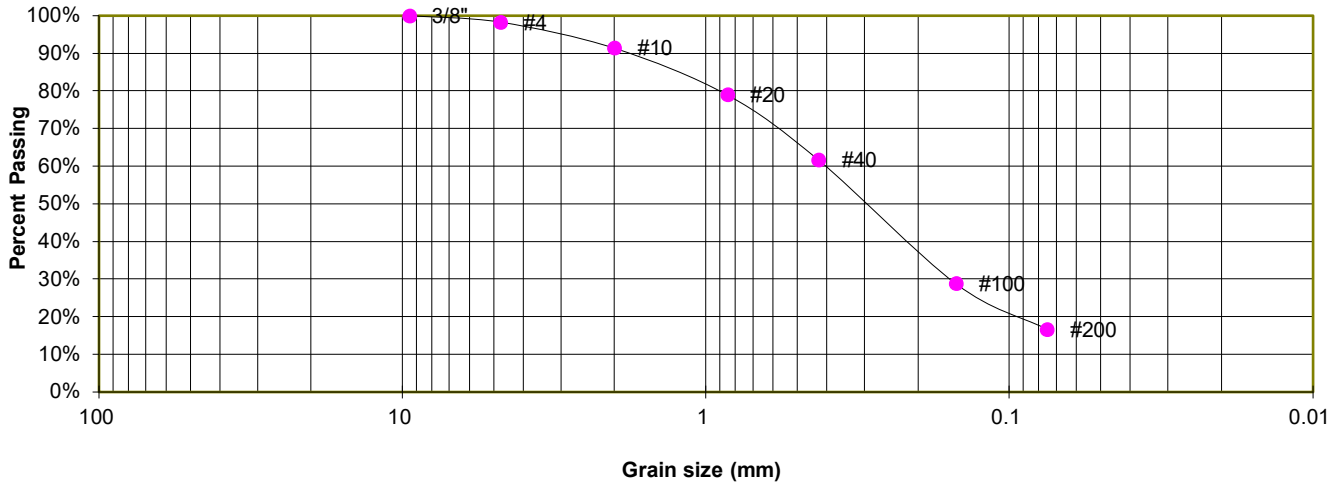

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	98.3%
10	91.4%
20	79.0%
40	61.7%
100	28.8%
200	16.7%

**ATTERBERG LIMITS**

Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SM  
 AASHTO CLASSIFICATION: A-2-4  
 AASHTO GROUP INDEX: 0



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-8**

TEST BORING 8  
 DEPTH (FT) 1-2

SOIL DESCRIPTION SAND, WITH SILT  
 SOIL TYPE 1

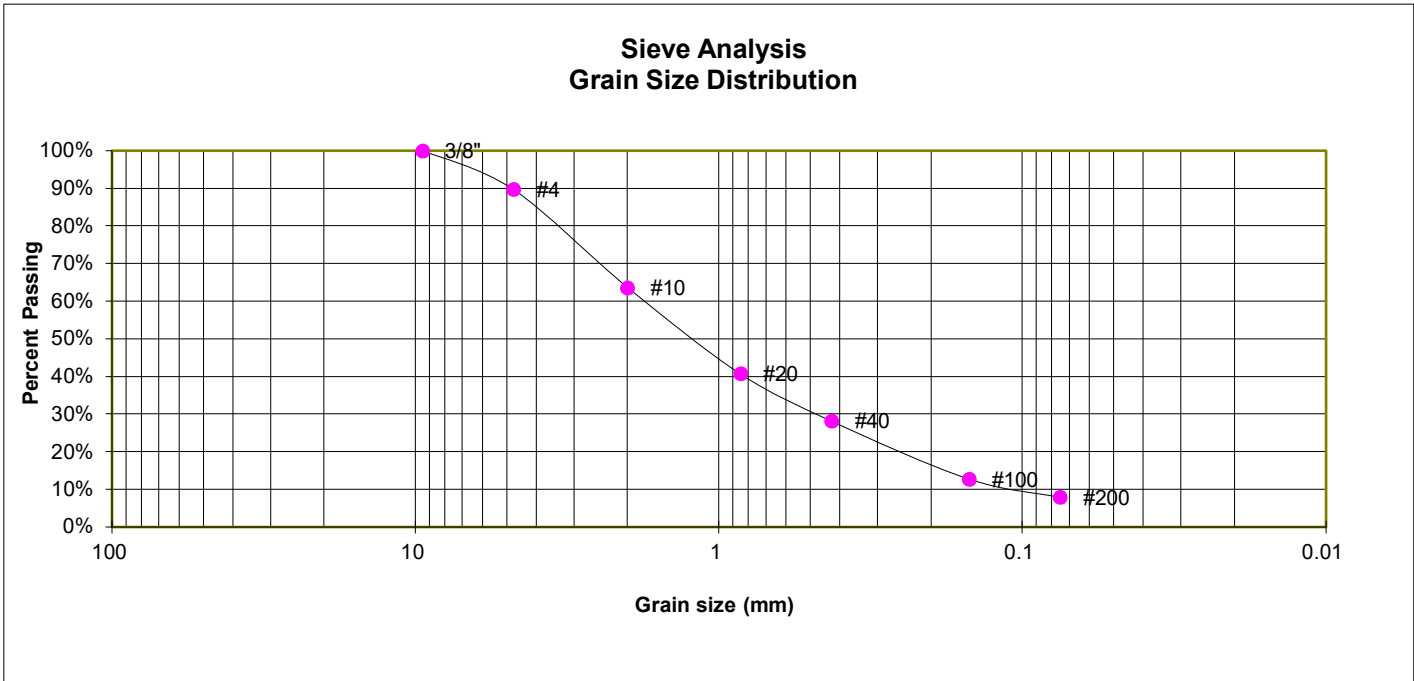

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	89.7%
10	63.6%
20	40.8%
40	28.1%
100	12.8%
200	8.0%

**ATTERBERG LIMITS**

Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SW-SM  
 AASHTO CLASSIFICATION: A-1-b  
 AASHTO GROUP INDEX: 0



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-9**

TEST BORING 1  
 DEPTH (FT) 10

SOIL DESCRIPTION CLAY, SANDY  
 SOIL TYPE 2

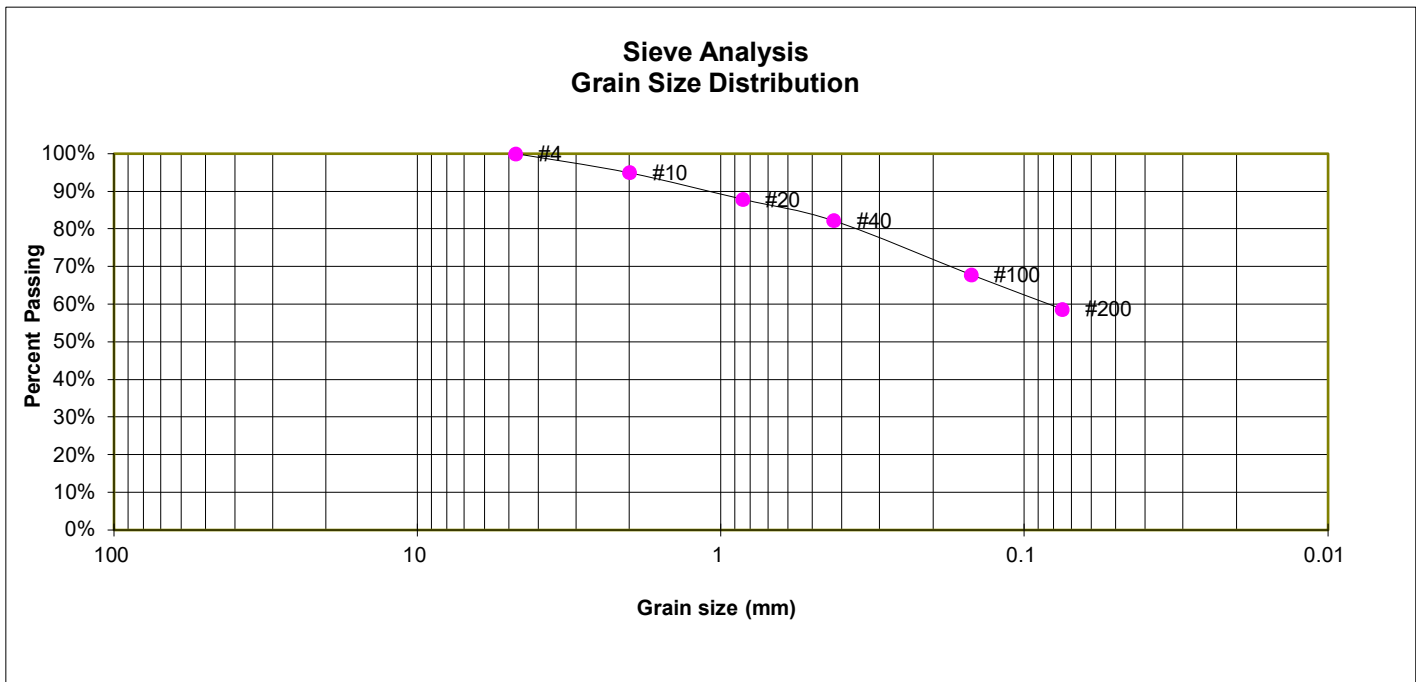

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	95.0%
20	87.9%
40	82.3%
100	67.8%
200	58.7%

**ATTERBERG LIMITS**

Plastic Limit	24
Liquid Limit	36
Plastic Index	12

**SOIL CLASSIFICATION**

USCS CLASSIFICATION:	CL
AASHTO CLASSIFICATION:	A-6
AASHTO GROUP INDEX:	5



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-10**

TEST BORING 8  
 DEPTH (FT) 5

SOIL DESCRIPTION SANDSTONE (SAND, WITH CLAY)  
 SOIL TYPE 3

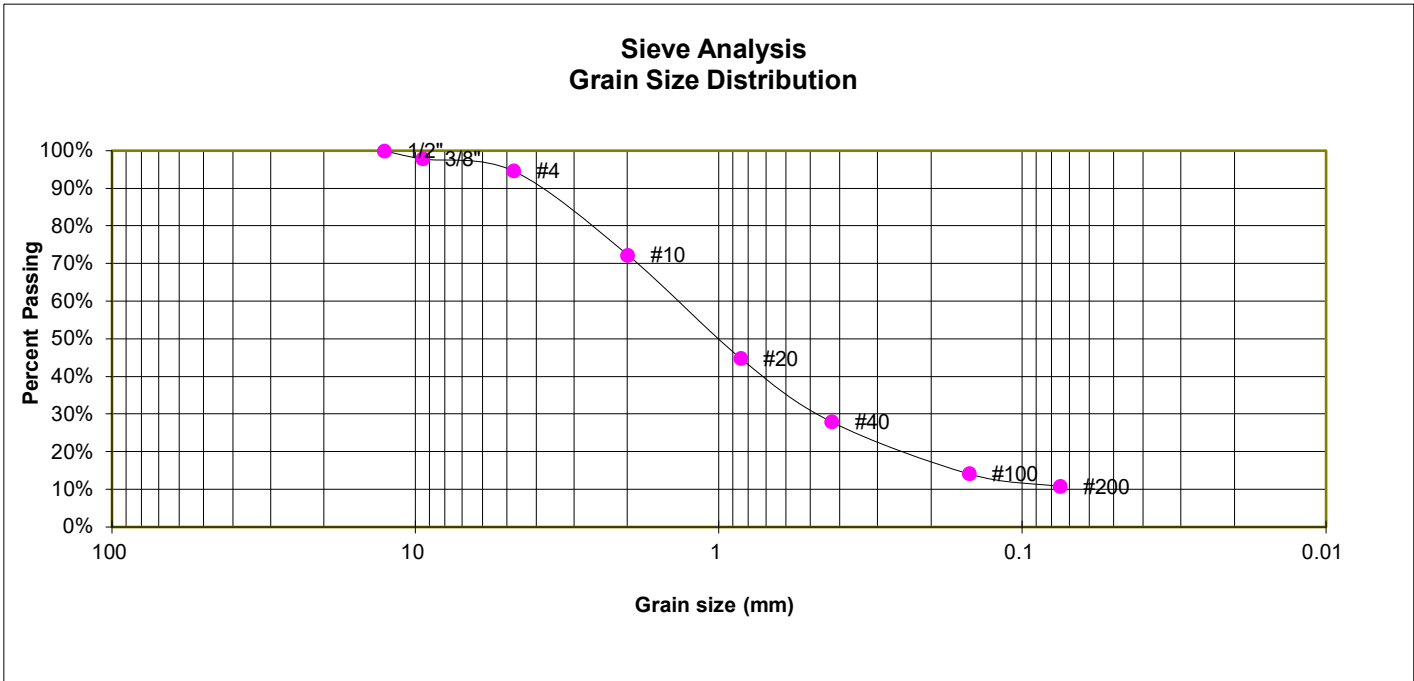

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	97.9%
4	94.6%
10	72.3%
20	44.9%
40	28.0%
100	14.2%
200	10.8%

**ATTERBERG LIMITS**

Plastic Limit	23
Liquid Limit	32
Plastic Index	9

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SW-SC  
 AASHTO CLASSIFICATION: A-2-4  
 AASHTO GROUP INDEX: 0



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-11**

TEST BORING 5  
 DEPTH (FT) 10

SOIL DESCRIPTION SANDSTONE (SAND, SILTY)  
 SOIL TYPE 3

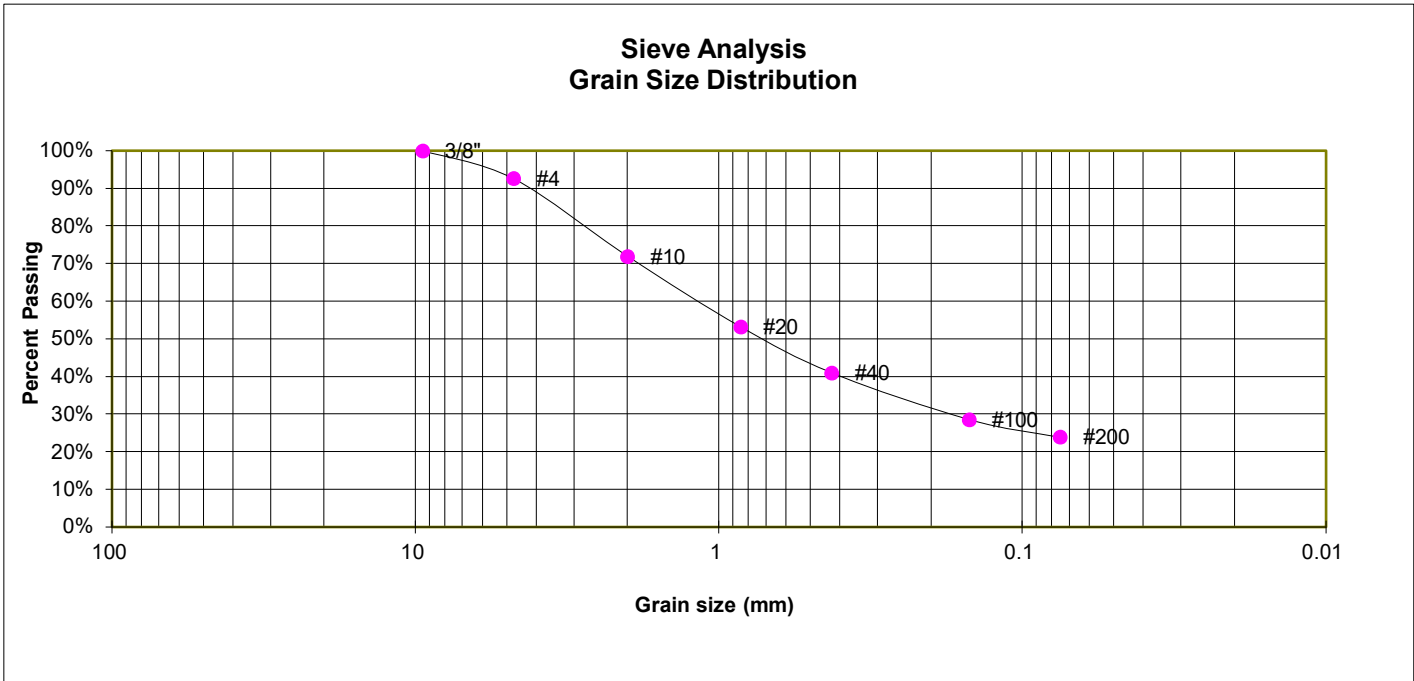

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	92.7%
10	71.9%
20	53.3%
40	41.0%
100	28.6%
200	23.9%

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SM



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-12**

TEST BORING 2  
 DEPTH (FT) 15

SOIL DESCRIPTION SANDSTONE (SAND, SILTY)  
 SOIL TYPE 3

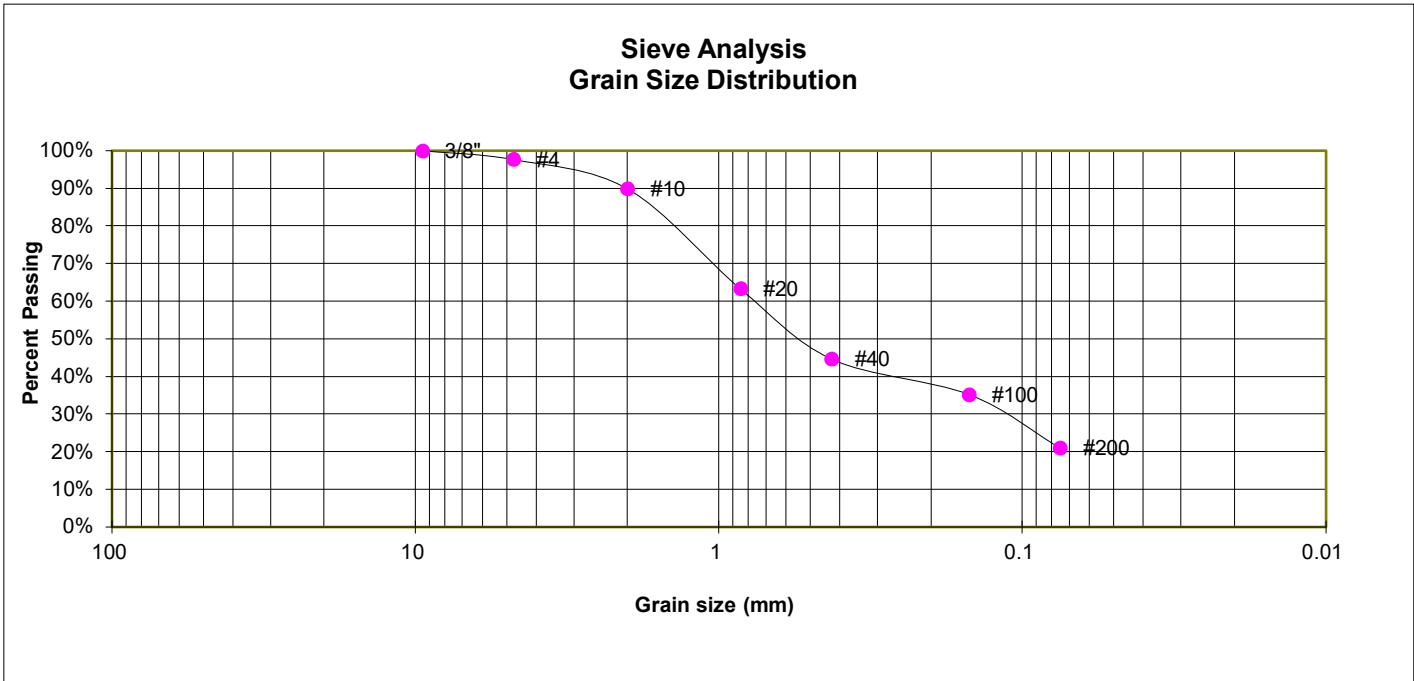

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	97.7%
10	89.9%
20	63.3%
40	44.7%
100	35.2%
200	21.0%

**ATTERBERG LIMITS**

Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: SM



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-13**

TEST BORING 2  
 DEPTH (FT) 10

SOIL DESCRIPTION CLAYSTONE (CLAY, SANDY)  
 SOIL TYPE 4

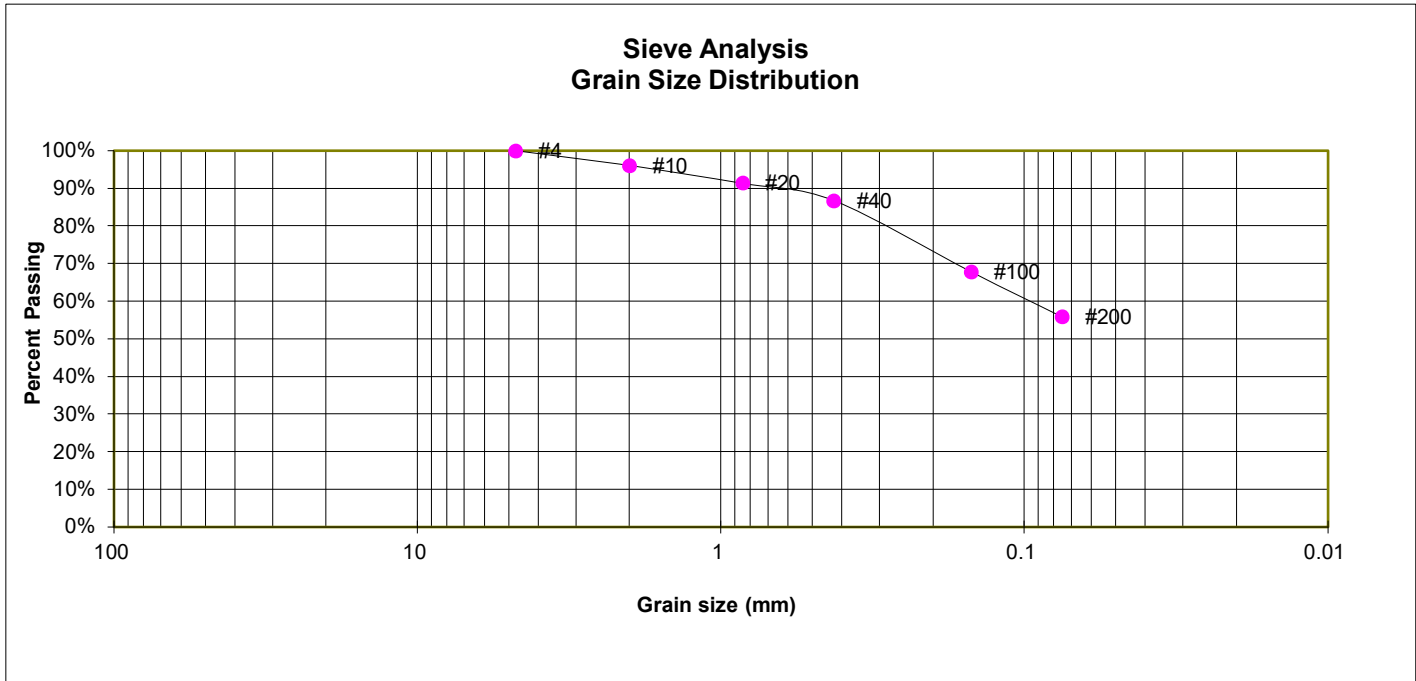

**GRAIN SIZE ANALYSIS**

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	96.1%
20	91.4%
40	86.8%
100	67.9%
200	55.9%

**ATTERBERG LIMITS**

Plastic Limit	24
Liquid Limit	37
Plastic Index	13

**SOIL CLASSIFICATION**

USCS CLASSIFICATION: CL



**LABORATORY TEST RESULTS**


LIFE CHURCH AT BENT GRASS NORTH  
 SEED DEVELOPMENT SERVICES

JOB NO.  
 241719

**FIG. B-14**

TEST BORING 4  
DEPTH (FT) 5

SOIL DESCRIPTION SAND, CLAYEY  
SOIL TYPE 1

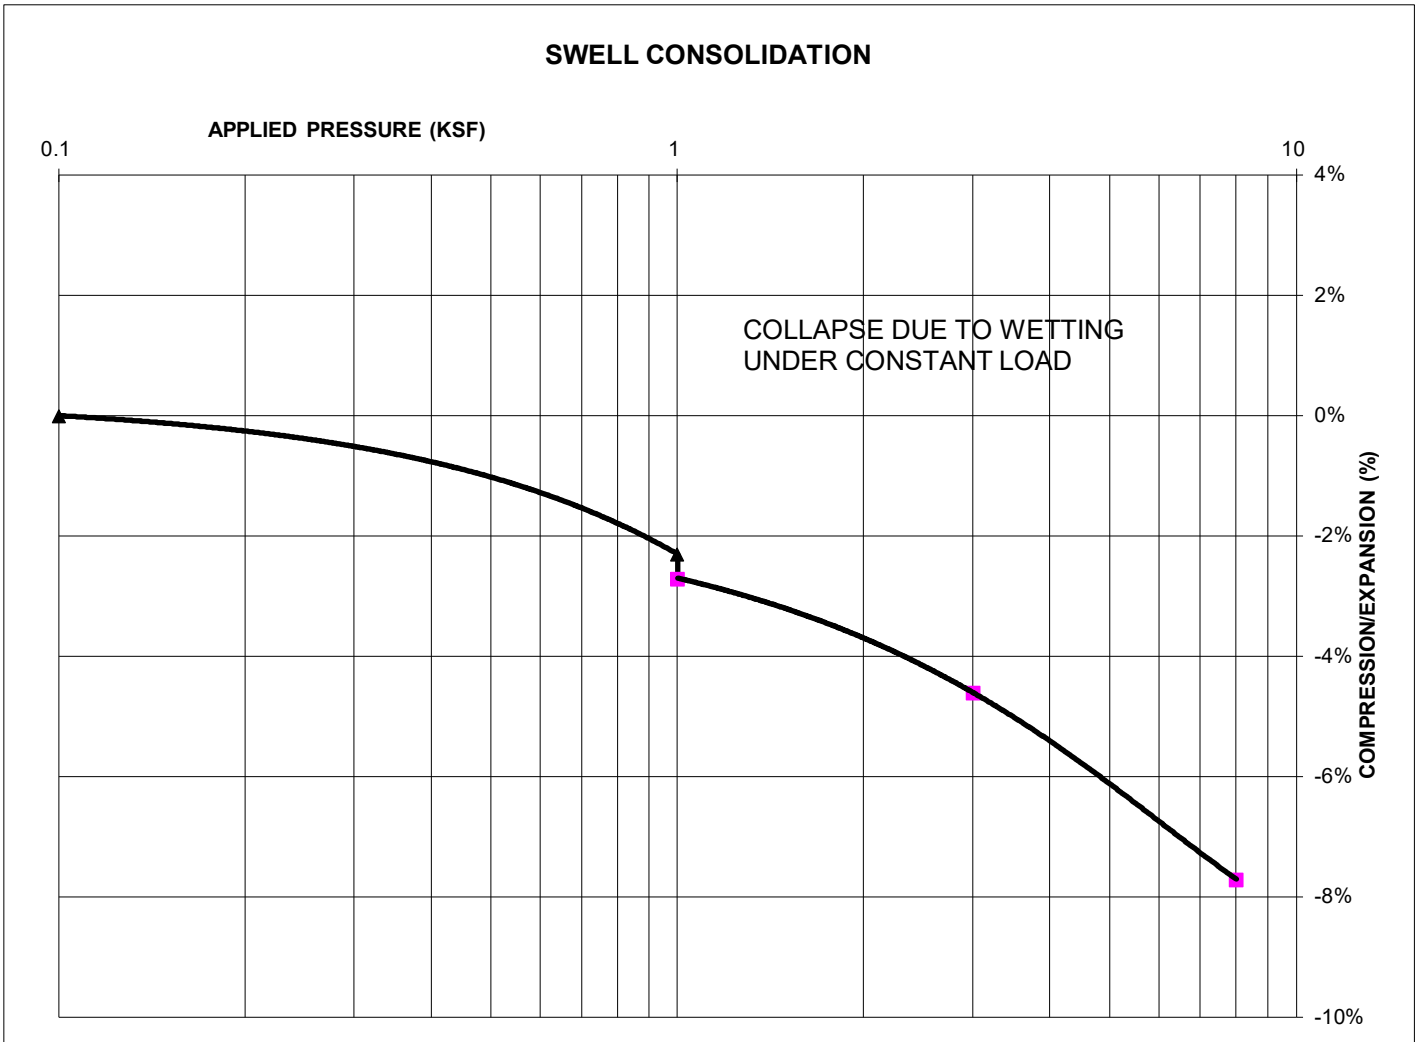

**SWELL/COLLAPSE TEST RESULTS**

NATURAL UNIT DRY WEIGHT (PCF): 115  
NATURAL MOISTURE CONTENT: 11.1%  
SWELL/COLLAPSE (%): -0.4%



**SWELL TEST RESULTS**

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES


JOB NO.  
241719

**FIG. B-15**

TEST BORING 6  
DEPTH (FT) 10

SOIL DESCRIPTION SAND, CLAYEY  
SOIL TYPE 1

### SWELL CONSOLIDATION

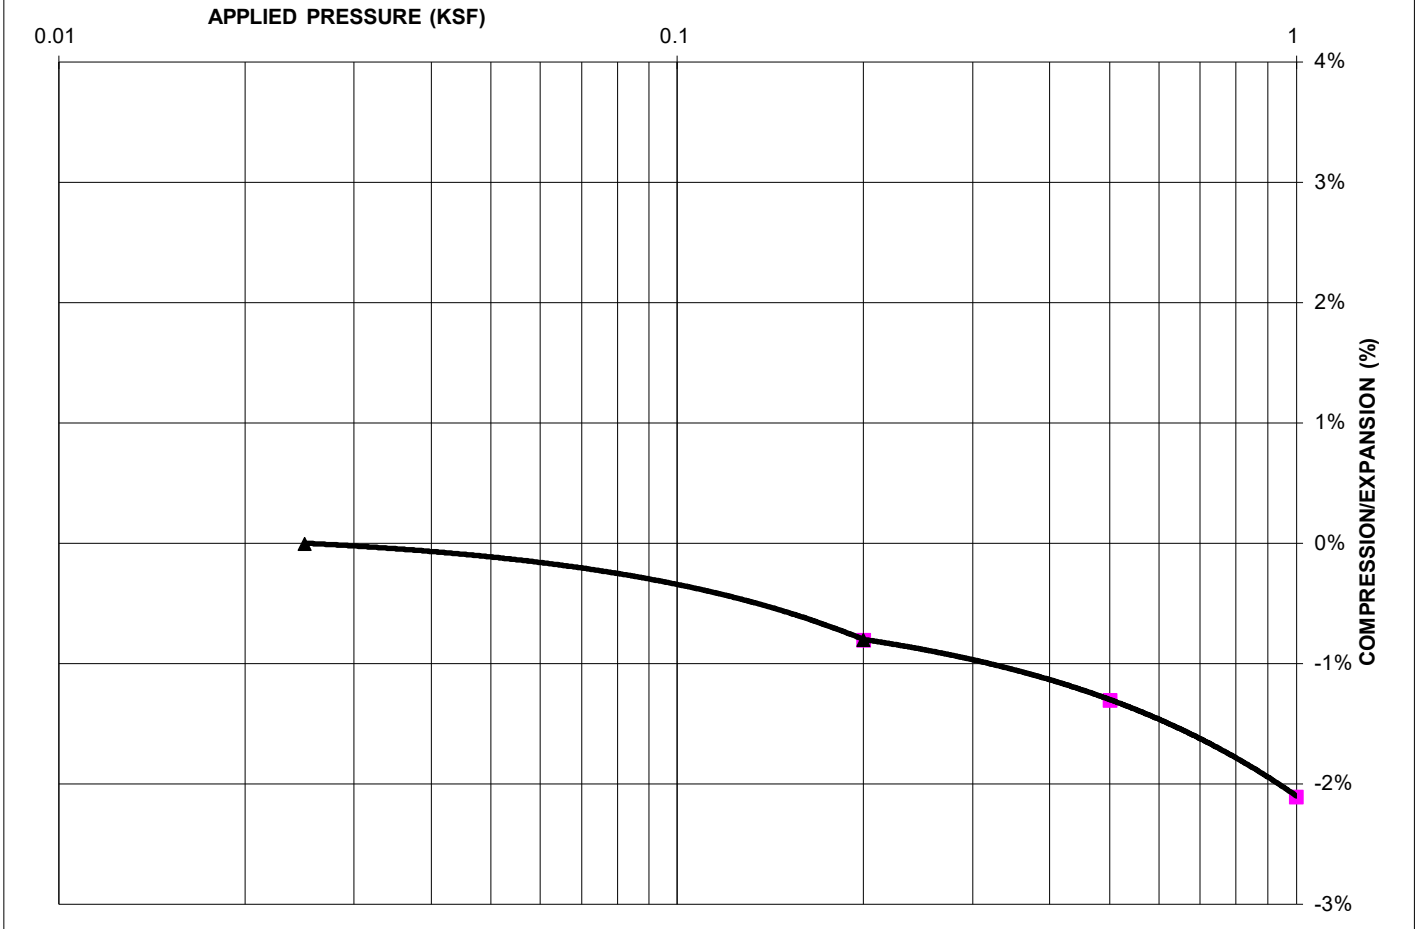

#### **SWELL/COLLAPSE TEST RESULTS**

NATURAL UNIT DRY WEIGHT (PCF): 102  
NATURAL MOISTURE CONTENT: 21.0%  
SWELL/COLLAPSE (%): 0.0%



### SWELL TEST RESULTS

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES


JOB NO.  
241719

**FIG. B-16**

TEST BORING 1  
DEPTH (FT) 10

SOIL DESCRIPTION CLAY, SANDY  
SOIL TYPE 2

### SWELL CONSOLIDATION

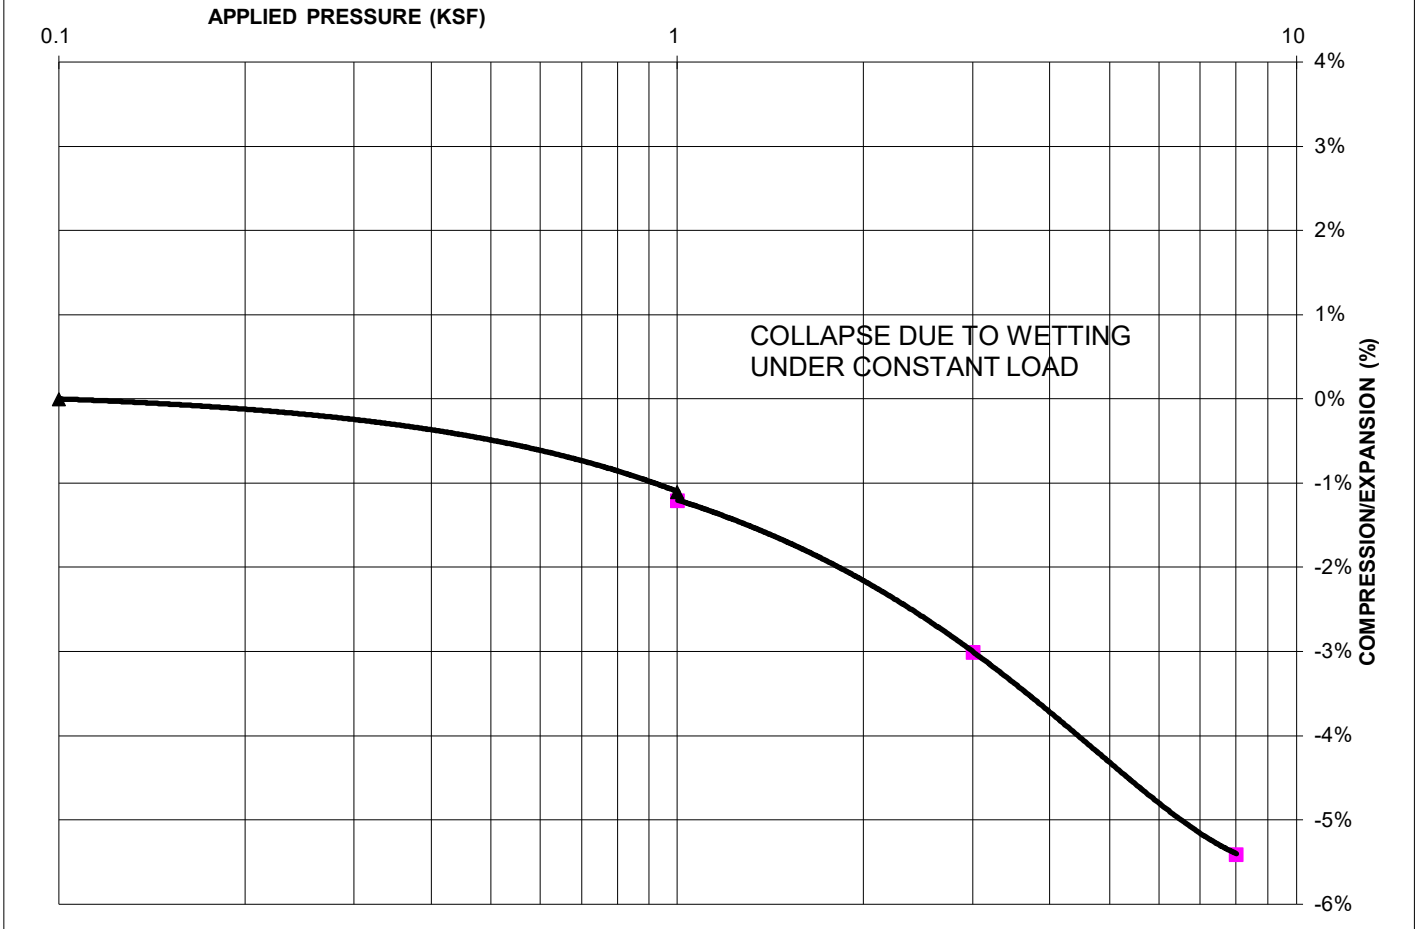

#### **SWELL/COLLAPSE TEST RESULTS**

NATURAL UNIT DRY WEIGHT (PCF): 118  
NATURAL MOISTURE CONTENT: 13.2%  
SWELL/COLLAPSE (%): -0.1%



### SWELL TEST RESULTS

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719


**FIG. B-17**

SAMPLE LOCATION TB-8 @ 0-3'

SOIL DESCRIPTION SAND, SILTY, BROWN  
SOIL TYPE 1

**PROCTOR DATA**

IDENTIFICATION: SM  
PROCTOR TEST #: 1  
TEST BY: PH  
TEST DESIGNATION: ASTM-1557-A  
MAXIMUM DRY DENSITY (PCF): 125.5  
OPTIMUM MOISTURE: 6.5

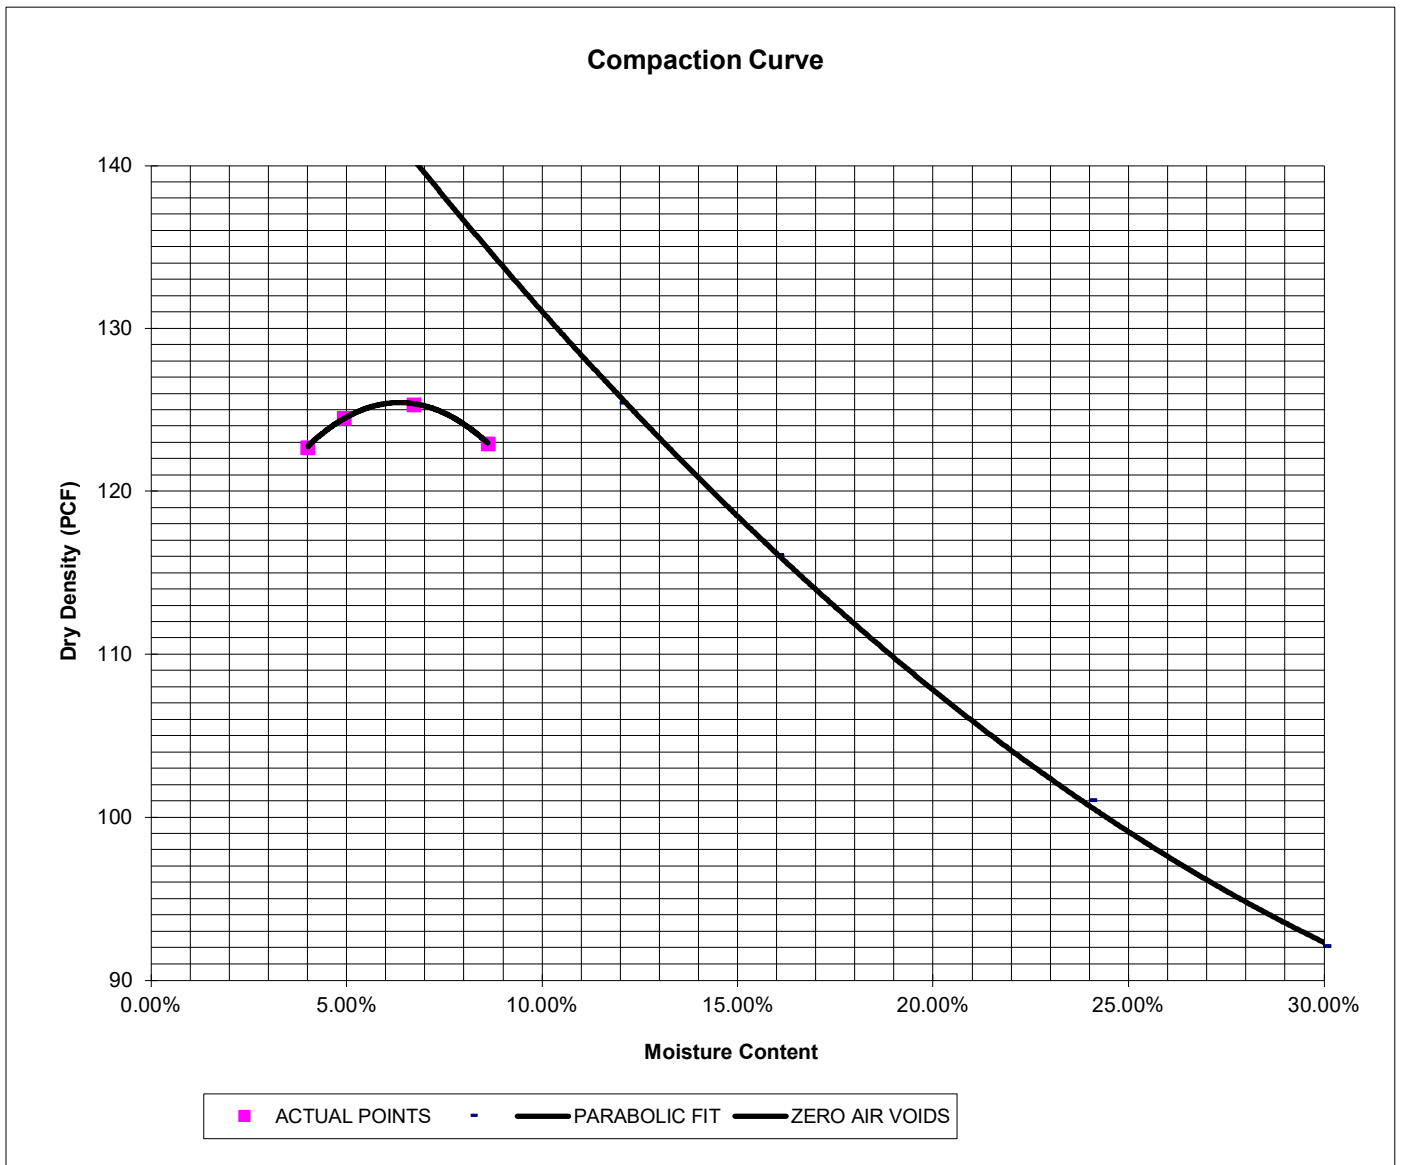

**LABORATORY TEST RESULTS**

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719

**FIG. B-18**

SAMPLE LOCATION TB-8 @ 0-3'

SOIL DESCRIPTION SAND, SILTY, BROWN  
SOIL TYPE 1

**CBR TEST LOAD DATA**

Piston Diameter (cm): 4.958

Piston Area (in<sup>2</sup>): 2.993

Penetration Depth (inches)	10 BLOWS Mold # 1		25 BLOWS Mold # 2		56 BLOWS Mold # 3	
	Load (lbs)	Stress (psi)	Load (lbs)	Stress (psi)	Load (lbs)	Stress (psi)
0.000	0	0.00	0	0.00	0	0.00
0.025	61	20.38	281	93.90	327	109.27
0.050	179	59.82	399	133.33	500	167.08
0.075	286	95.57	460	153.72	613	204.84
0.100	307	102.59	537	179.45	723	241.60
0.125	351	117.29	640	213.87	881	294.40
0.150	364	121.64	766	255.97	1068	356.89
0.175	400	133.67	857	286.38	1233	412.03
0.200	440	147.03	938	313.45	1379	460.82
0.300	558	186.47	1224	409.02	2048	684.38
0.400	640	213.87	1434	479.20	2548	851.46
0.500	721	240.93	1664	556.06	3168	1058.64

**MOISTURE AND DENSITY DATA**

	Mold # 1	Mold # 2	Mold # 3
Can #	341	342	351
Wt. Can	8.87	8.52	8.01
Wt. Can+Wet	167.14	143.86	137.61
Wt. Can+Dry	148.87	128.44	123.65
Wt. H2O	18.27	15.42	13.96
Wt. Dry Soil	140	119.92	115.64
Moisture Content	13.05%	12.86%	12.07%
Wet Density (PCF)	121.6	124.4	129.7
Dry Density (PCF)	114.2	116.8	121.7
% Compaction	91%	93%	97%
CBR	10.26	17.94	24.16

**PROCTOR DATA**

Maximum Dry Density (pcf)	125.5
Optimum Moisture	6.5
90% of Max. Dry Density (pcf)	113.0
95% of Max. Dry Density (pcf)	119.2

CBR at 90% of Max. Density = 6.6 ~ R VALUE 14  
CBR at 95% of Max. Density = 21.0 ~ R VALUE 71



**LABORATORY TEST RESULTS**

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES


JOB NO.  
241719

**FIG. B-19**


SAMPLE LOCATION TB-8 @ 0-3'

SOIL DESCRIPTION SAND, SILTY, BROWN  
SOIL TYPE 1

Stress VS Penetration

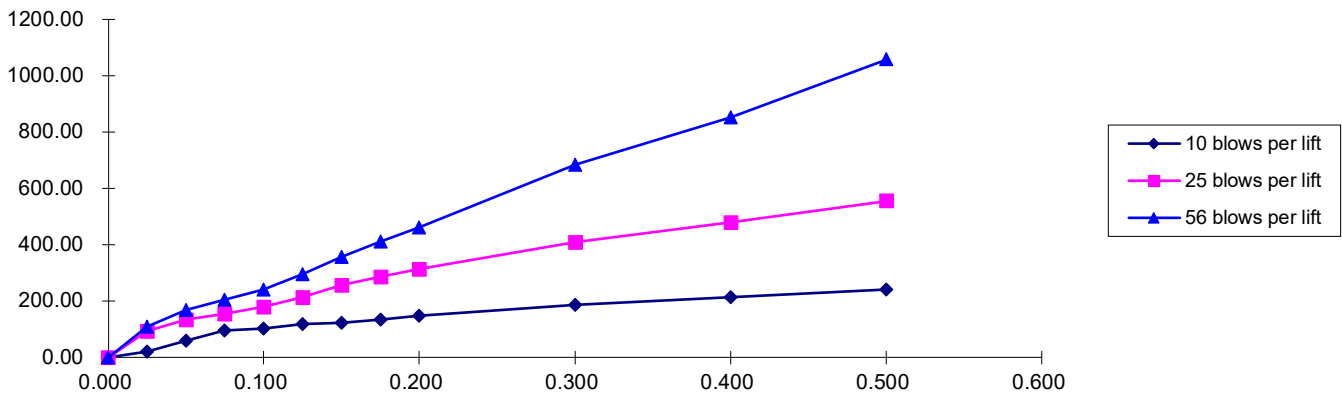

Bearing Ratio VS Dry Density

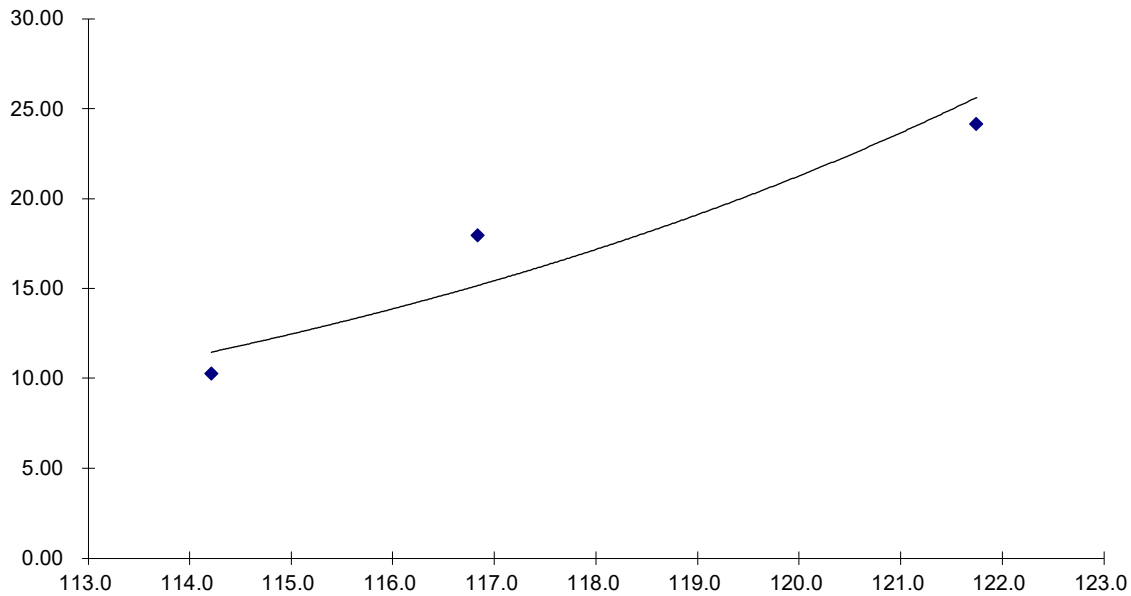

LABORATORY TEST RESULTS

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719


FIG. B-20

SAMPLE LOCATION TB-6 @ 0-3'

SOIL DESCRIPTION SAND, SILTY, BROWN  
SOIL TYPE 1

**PROCTOR DATA**

IDENTIFICATION: SM  
PROCTOR TEST #: 2  
TEST BY: PH  
TEST DESIGNATION: ASTM-1557-A  
MAXIMUM DRY DENSITY (PCF): 127.1  
OPTIMUM MOISTURE: 7

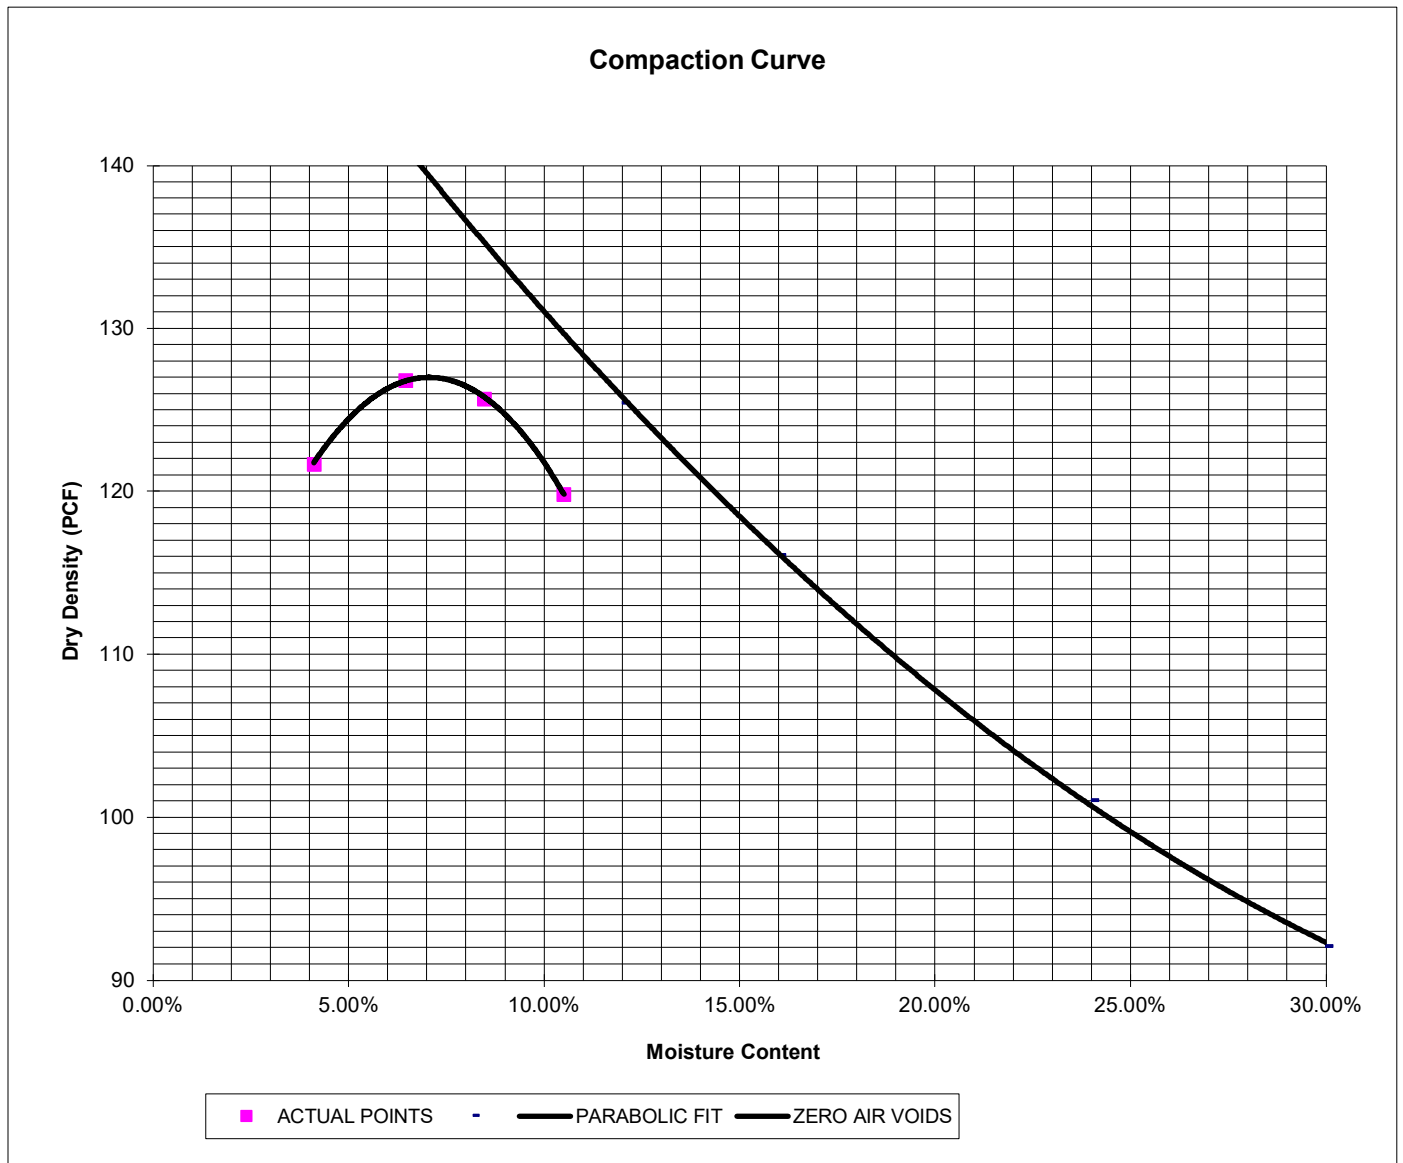

**LABORATORY TEST RESULTS**

LIFE CHURCH AT BENT GRASS NORTH  
SEED DEVELOPMENT SERVICES

JOB NO.  
241719

**FIG. B-20**



## **APPENDIX C: Pavement Design Calculations**

## FLEXIBLE PAVEMENT DESIGN

### PROJECT DATA

Project Location: Life Church at Bent Grass North

Job Number: 241719

### DESIGN DATA

Equivalent (18-kip) Single Axle Load Applications (ESAL):	ESAL ( $W_{18}$ ) =	100,000
Design CBR	CBR =	10
Standard Deviation	$S_o$ =	0.45
Loss in Serviceability	$\Delta\psi$ =	2.0
Reliability	Reliability =	80
Reliability (z-statistic)	$Z_R$ =	-0.84
Soil Resilient Modulus	$M_R$ =	15,000 psi

Required Structural Number (SN): ➔ SN = 1.66

### DESIGN EQUATIONS

#### Resilient Modulus

If using CBR:

$$M_R = (\text{CBR}) \times 1,500$$

If using R-Value:

$$M_R = 10^{[(S_1 + 18.72) / 6.24]} \text{ where } S_1 = [(R\text{-value} - 5) / 11.29] + 3$$

#### Required Structural Number

$$\log_{10} W_{18} = Z_R \cdot S_o + 9.36 \cdot \log_{10} (SN+1) - 0.20 + \frac{\log_{10} \left[ \frac{\Delta \text{PSI}}{4.2 - 1.5} \right]}{0.40 + \frac{1094}{(SN+1)^{5.19}}} + 2.32 \cdot \log_{10} M_R - 8.07$$

#### Pavement Section Thickness

$$SN^* = C_1 D_1 + C_2 D_2 \quad \text{where:}$$

- $C_1$  = Strength Coefficient - HMA
- $C_2$  = Strength Coefficient - ABC/RCB
- $D_1$  = Depth of HMA (inches)
- $D_2$  = Depth of ABC/RCB (inches)

### RECOMMENDED THICKNESSES

Layer	Material	Coefficient	Thickness ( $D^*_i$ )	$SN^*_i$	SN
1	HMA	$C_1 = 0.44$	4.0 inches	1.760	-
2	ABC/RCB	$C_2 = 0.11$	4.0 inches	0.440	
				$SN^* = 2.200$	1.66

Pavement SN > Required SN, Design is Acceptable

FIG. C-1