


Standard Electric Luminaire Schedule

Symbol	Qty	Label	Arrangement	[MANUFAC]	Description	Total Lumens	Total Wattage	LLF	BUG Rating	Mounting Height
	8	C1	SINGLE	LUMINOSO LED INC	ECPY-45W-40K-BK	4142	0	0.920	B2-U2-G2	10'
	16	P	SINGLE	PROGRESS	P5644-3030K9	3731	60	0.950	B1-U5-G1	7'
	2	S1	2 @ 180 DEG (BACK-BACK)	Lithonia Lighting	DSX1 LED P7 40K T5M MVOLT	43046	366	0.950	B5-U0-G3	25'
	1	S2	SINGLE	Lithonia Lighting	DSX1 LED P7 40K BLC MVOLT	16997	183	0.950	B2-U0-G3	25'
	1	WP1	SINGLE	RAB LIGHTING INC.	SLIM37N	3873	34.6	1.000	B1-U2-G1	8'

Calculation Summary

Label	CalcType	Avg	Max	Min	Units
Entire Site	Illuminance	2.59	23.0	0.0	Fc
Trash Enclosure	Illuminance	14.07	24.1	7.3	Fc

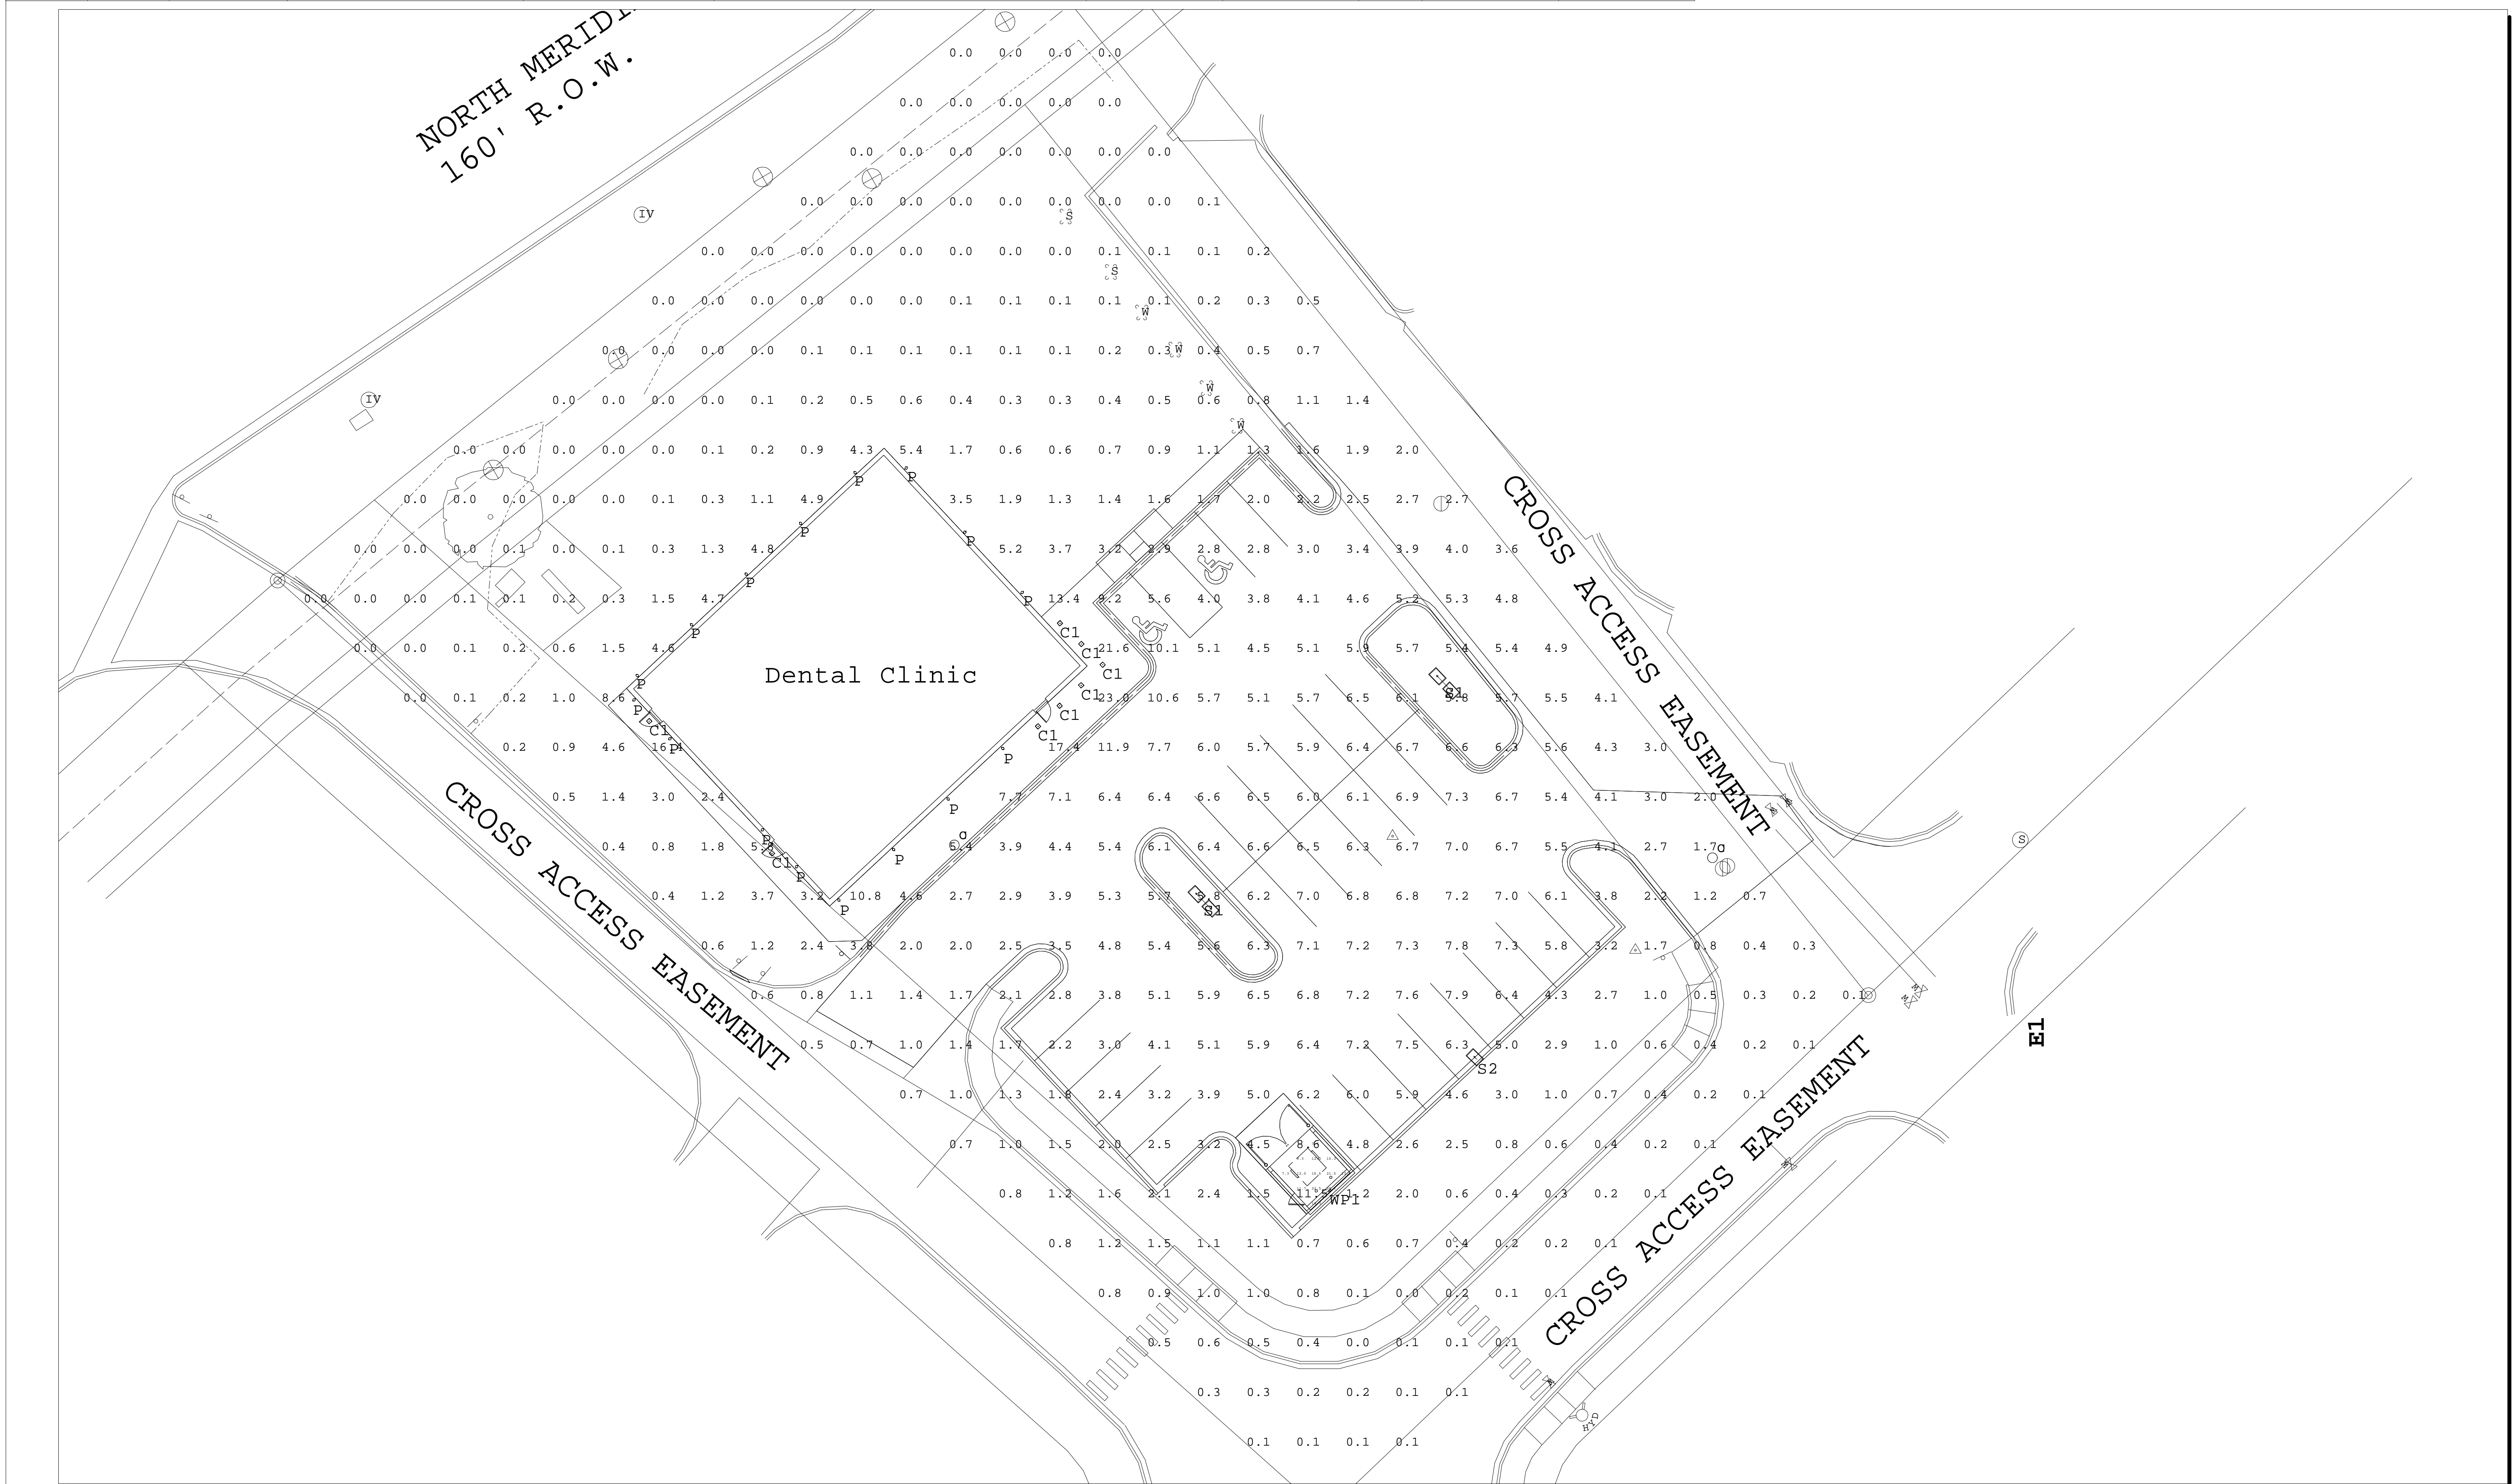

Rev. Date

Rev. #	Description
R1	
R2	
R3	
R4	
R5	

Disclaimer:
 These calculations are based on the information provided in the schedule. Actual or measured values may differ from those calculated due to differences in calculation methods, lighting conditions such as, but not limited to, line voltage, temperature, atmospheric conditions, luminaire and mechanical elements within the space may affect calculations. The lighting designer is not responsible for the accuracy of the calculations. Please refer to the applicable lighting codes for the responsibility of Standard Electric, and shall be the responsibility of the lighting designer for the calculations.

Project: WMG Development
 Heartland Dental Site Lighting
 Falcon, CO

Date: 1/17/2022
Page #: E1
Page 1 of 1

Revision #: XX
Size: ARCH D

Project #: 13-1977
Created By: Ryan Hunt

STANDARD ELECTRIC
 21 Lewis Drive
 Wilmington, MA 01897
 www.standardelectric.com
 978-661-1854

SE NATIONAL
 www.standardelectric.com