


Lot _____ Blk _____ Subdivision _____ Water Tap Date _____ Depth _____
 Address _____ Sewer Tap Date _____ Depth _____
 General Contractor _____ Sub-Contractor _____
 Inspected By _____

1) ABANDON EX. 6" WATER RUNNING SOUTH EAST THROUGH NORTHERN END OF SITE, REMOVE EX. FIRE HYDRANT NEAR STA 4+14, 15'R

2) CASING PIPE NEEDS TO EXTEND FAR ENOUGH IN EACH DIRECTION TO CLEAR GEOFABRICS & RETAINING WALLS:

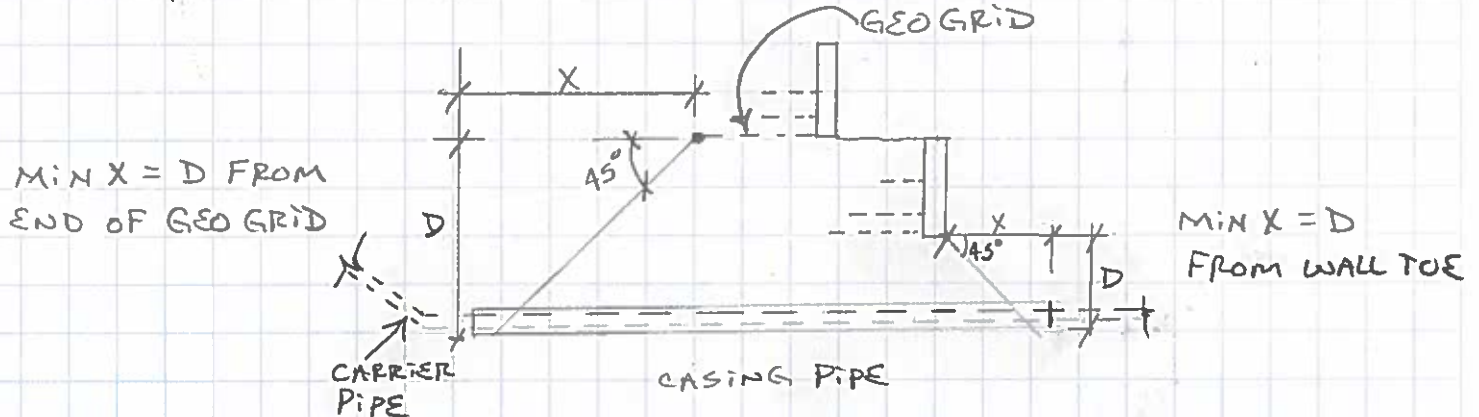

3) RE ROUTE STORM CONC. PIPE TO AVOID EXCESSIVE CONGESTION

4) MOVE EXIST. PRV VAULT TO THE WEST

5) CONNECT WELL 5 DISCHARGE TO 12" NPW PVC LINE

6) RE-ROUT EXIST & PROP. SS

7) MOVE STORM SEWER INLET @ SOUTH END OF RED BRIDGE PT.

8) REROUTE EXIST SS EAST OF SITE TO MH IN SHORE DITCH HEIGHTS