

**ON-SITE WASTEWATER TREATMENT SYSTEM INSPECTION FORM**

ON-SITE ID: ON0019998 P  
 APN # 5209000084  
 DATE: 8/22/16

APPROVED YES  NO  Environmental Health Specialist: Neil Mayes  
 Address: 12725 Linnwood Ln CS CO 80906 Owner: Tyson Henry  
 Residence:  #Bedrooms: 4 Commercial:  System Installer: Quigleys Dirtworks

SEPTIC TANK: Construction Material Concrete Capacity Gallon Existing 1250

**SOIL TREATMENT AREA:**

Trench: Depth (Range):      Width:      Total Length:      Sq. Ft.:       
 Bed: Depth (Range):      Width:      Total Length:      Sq. Ft.:       
 Depth of Rock:      Under PVC:      Type of cover on Rock:     

SEEPAGE PITS: # of Pits:      Working Depth #1:      #2:      Size (L x W) #1      #2      Total Sq. Ft.     

**CHAMBER SYSTEMS:**


Type of Chamber: Arc 36 #Chambers: 18 Sq. Ft./Chamber: 15 Bed:  Trench:  Depth (Range): 12" - 26"  
 Sq. Ft. Required (10-1):      Sq. Ft. Required (10-2):      Sq. Ft. Required (10-3):      Sq. Ft. Required for Diverter Valve: 126  
 Sq. Ft. Installed: 270

Engineer Design: Y  N  Engineering Firm:      Approval Letter Provided: Y  N

Well installed at time of OWTS inspection: Y  N  Public Water: Y  N

\*Approval will be revoked if in the future the well is found to be within 50 feet of the septic tank and/or 100 feet of the soil treatment area.

Notes:

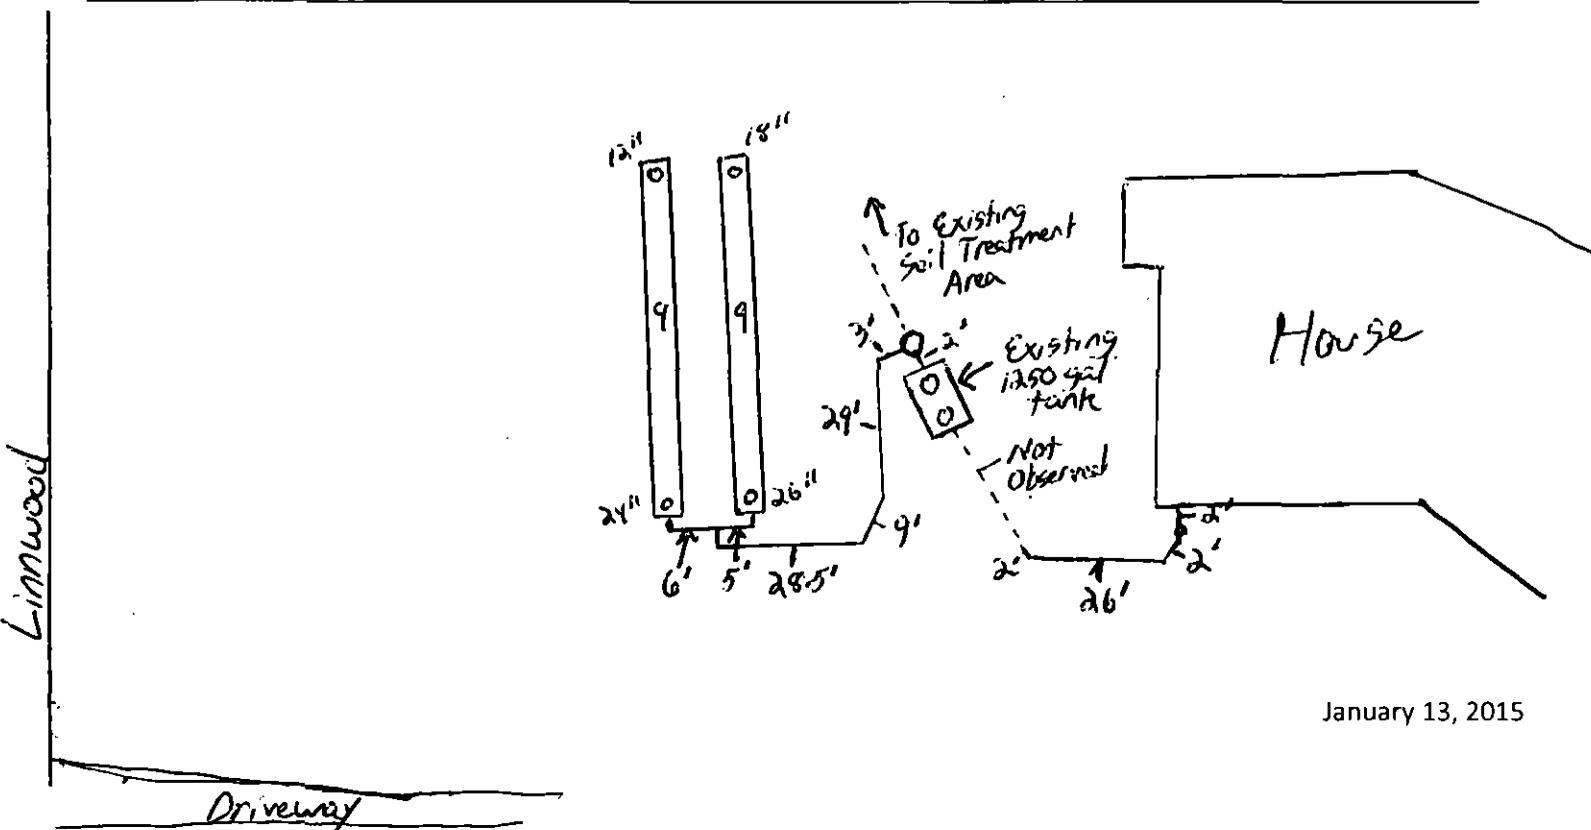

Notify Environmental Health of any change of ownership, type of business activity, business name, or billing address by calling (719) 578-3199. Failure to notify Environmental Health may result in late penalties, Permit/License denial or revocation, and business closure. PERMITS/LICENSES TO OPERATE AND ANNUAL FEE PAYMENTS ARE NOT TRANSFERABLE. Permits become void on change of ownership. New owners must apply and pay for a new Permit(s)/License(s) prior to beginning operation.

Attn: HENRY TYSON D  
12725 LINNWOOD LN  
COLORADO SPRINGS, CO  
80908-3415



**EL PASO COUNTY PUBLIC HEALTH  
ENVIRONMENTAL HEALTH DIVISION**  
1675 W. GARDEN OF THE GODS ROAD, SUITE 2044  
COLORADO SPRINGS, CO 80907  
PHONE: (719) 578-3199 FAX: (719) 578-3188  
[www.elpasocountyhealth.org](http://www.elpasocountyhealth.org)

## MAJOR REPAIR PERMIT - OWTS

Valid From 1/7/2016 To 1/7/2017

PERMITEE :

**HENRY TYSON D  
12725 LINNWOOD LN  
COLORADO SPRINGS, CO 80908-3415**

Onsite ID: ON0019998

Tax Schedule # : 5209000084

Permit Issue Date: 01/07/2016

Dwelling Type: RESIDENTIAL

OWNER NAME :

**HENRY TYSON D**

# of Bedrooms (if Res): 4

Proposed Use (if Comm):

Designed Gallons/Day:

Water Source: PRIVATE WELL

### System Installation Requirements:

**The OWTS must be installed per the stamped and approved Design Document dated 01/07/2016.**

This permit is issued in accordance with 25-10-106 Colorado Revised Statutes. The PERMIT EXPIRES upon completion/installation of the Onsite Wastewater Treatment System, or at the end of twelve (12) months from date of issue, whichever occurs first. If both a Building Permit and an Onsite Wastewater Treatment System Permit are issued for the same property and construction has not commenced prior to the expiration date of the Building Permit, the Onsite Wastewater Permit shall expire at the same time as the Building Permit. This permit is revocable if all stated requirements are not met. The Onsite Wastewater Treatment System must be installed by an El Paso County Licensed System Contractor, or the property owner.

The Health Officer shall assume no responsibility in case of failure or inadequacy of an Onsite Wastewater Treatment System, beyond consulting in good faith with the property owner or representative. Access to the property shall be authorized at reasonable time for the purpose of making such inspections as are necessary to determine compliance with the requirements of this law (permit).


**Inspection request line: Call (719) 575-8699 before 8:30 a.m. of the day that the inspection is requested  
Weekends & Holidays excluded.**

Authorized By: Environmental Health Specialist

12/30/15 - left with Neil

Environmental Health Division

El Paso County, CO

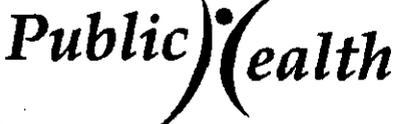

Prevent • Promote • Protect

1675 W. Garden of the Gods Rd., Suite 2044  
Colorado Springs, CO 80907  
(719) 578-3199 phone  
(719) 578-3188 fax  
www.elpasocountyhealth.org

SB0604117 A30008379

**APPLICATION FOR AN ON-SITE WASTEWATER TREATMENT SYSTEM PERMIT**

NEW PERMIT  MAJOR REPAIR PERMIT  MINOR REPAIR PERMIT

Owner Tyson & Kary Henry Daytime Phone 719 964-4501  
System Installer Kuanu Armin Daytime Phone 719 683-3720  
Property Address 12725 Linnwood Dr City and Zip Coverage Springs CO 80908  
Legal Description N 2NE 4 SW 1/4 together with R/W for rd over 20 FT of E 2SW 1/4 SE 1/4  
Owners Mailing Address 12725 Linnwood Dr.  
Email Address two2saint@yahoo.com Fax # 844-803-6348  
Tax Schedule # 520900084 Lot Size 5 AC  
Site Located Inside City Limits  Yes  No Primary Contact  Owner  Contractor  
Proposed Use:  Single Family  Multi-Family  Commercial  
Water Supply:  Well  Cistern  Municipal Number of Bedrooms 4  
 Pick up:  Fax:  Email: two2saint@yahoo.com

**CURRENT FEES AS APPROVED BY THE EI PASO COUNTY BOARD OF HEALTH**

New Permit: \$650.00 (EPCPH Charge) + \$147.00 (EPC Planning Dept. Surcharge) + \$23.00 (CDPHE Surcharge) = \$820.00

Major Repair Permit: \$515.00 (EPCPH Charge) + \$23.00 (CDPHE Surcharge) = \$538.00

Minor Repair Permit: \$230.00 (EPCPH Charge) + \$23.00 (CDPHE Surcharge) = \$253.00

- All Payments are due at the time of application submittal; by cash, check or major credit card (Visa / MC)
- This permit will expire one year from the date of issuance.

I certify that the information provided on this application is in compliance with Section 8.3, Chapter 8 of the Onsite Wastewater System (OWS) Regulations of the El Paso County Board of Health. I also authorize the assigned representative of El Paso County Public Health to enter onto this property in order to obtain information necessary for the issuance of a permit.

Applicants Signature: [Signature] Date: 12-29-15

Site Insp. Date: 1/7/2016 Perc. Rate: LTAAR=0.8 Permit # 0100019998

E.H.S. Review Notes: \_\_\_\_\_

Date to: E.P.C. Development Services N/A Flood Plain and Enumerations N/A

Permit Requirements: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Min. Septic Tank Capacity 1250 Min. Absorption Area 126  
E.H. Specialist Neil May Date 1/7/16  Approved  Denied

- 1) A report is required per Section 8.5 A-E, "Site and Soil Evaluation", or Section 8.5 A-F if the OWTS requires design by a Colorado Registered Professional Engineer. If your permit application submittal is incomplete, the application will not be accepted.
- 2) Property address or lot number must be posted and clearly visible from the road. The percolation test holes and/ or soil profile test pit must be clearly marked or an additional charge for a return trip to the site may be assessed.
- 3) The proposed soil treatment area must be protected from compaction and disturbance by staking, fencing, posting or other effective method.
- 4) In the Box below, please provide complete and accurate directions to the property from a main highway.

From HWY 83/Powass & Wooman Rd.  
Wooman Rd. East to Buck Forest Rd.  
North to Shoup Rd.  
East approx. 2 miles to Linnwood