



INNOVATIVE DESIGN. CLASSIC RESULTS.

**PRELIMINARY DRAINAGE REPORT**

**RISING MOON FILING NO. 1**  
**(A Replat of Tract B, Morning Sun I)**

**JUNE 2024**

**PCD Filing No.: XXXX**

Prepared for:  
**PIKES PEAK HABITAT FOR HUMANITY, INC.**  
**2802 N. PROSPECT STREET**  
**COLORADO SPRINGS, CO 80907**  
**719-661-5527**

Prepared by:  
**CLASSIC CONSULTING ENGINEERS & SURVEYORS**  
**619 CASCADE AVENUE, SUITE 200**  
**COLORADO SPRINGS, CO 80903**  
**(719) 785-0790**

Job no. 2506.03



# PRELIMINARY DRAINAGE REPORT FOR RISING MOON FILING NO. 1

## DRAINAGE REPORT STATEMENT

### DESIGN ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.

\_\_\_\_\_  
Kyle R. Campbell, Colorado P.E. #29794

\_\_\_\_\_  
Date

### OWNERS/DEVELOPER'S STATEMENT:

I, the owner/developer, have read and will comply with all of the requirements specified in this drainage report and plan.

Business Name: Pikes Peak Habitat for Humanity, Inc.

\_\_\_\_\_  
Date

Title: \_\_\_\_\_

Address: 2802 N. Prospect Street

Colorado Springs, CO 80907

### EL PASO COUNTY:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code, as amended.

\_\_\_\_\_  
Joshua Palmer, P.E.  
County Engineer / ECM Administrator

\_\_\_\_\_  
Date

Conditions:



# PRELIMINARY DRAINAGE REPORT FOR RISING MOON FILING NO. 1

## TABLE OF CONTENTS:

PURPOSE	Page 4
GENERAL DESCRIPTION	Page 4
EXISTING DRAINAGE CONDITIONS	Page 4
DEVELOPED DRAINAGE CONDITIONS	Page 5
DETENTION FACILITY	Page 6
STORMWATER QUALITY	Page 6
HYDROLOGIC CALCULATIONS	Page 7
FLOODPLAIN STATEMENT	Page 7
EROSION CONTROL PLAN	Page 8
DRAINAGE AND BRIDGE FEES	Page 8
SUMMARY	Page 8
REFERENCES	Page 9

## APPENDICES

VICINITY MAP
SOILS MAP (S.C.S. SURVEY)
F.E.M.A. MAP
HYDROLOGIC / HYDRAULIC CALCULATIONS
FULL SPECTRUM DETENTION CALCULATIONS
REFERENCE MATERIAL FROM PRIOR STUDIES
EXISTING CONDITIONS DRAINAGE MAP
PROPOSED CONDITIONS DRAINAGE MAP



## **PURPOSE**

This document is the Preliminary Drainage Report for Rising Moon Filing No. 1. The purpose of this report is to identify general onsite and offsite drainage patterns, conceptual storm sewer, inlet locations, and areas tributary to the site, and to safely route developed storm water runoff to adequate stormwater facilities, in accordance with all applicable area drainage plans. This report is required to accompany the proposed Preliminary Plan that is proposed to replace the prior approved and platted Tract B, Morning Sun I previously anticipated Elementary School.

A Final Drainage Report will be provided when the Final Plat and Construction Drawings details are processed for review.

## **GENERAL DESCRIPTION**

The overall Rising Moon Filing No. 1 development is a 9.00-acre residential community within a portion of Section 3, Township 15 South, Range 65 West of the 6<sup>th</sup> Principal Meridian in El Paso County, Colorado. The site is generally located west of Shining Star Drive just north of Peaceful Meadow Street. The proposed City of Colorado Springs Meadoworks Residential Community sits directly west of the site. The development includes a total of 41 single-family residences that will be developed as a single phase for the Pikes Peak Habitat for Humanity.

The average soil condition of the entire site and tributary area to the proposed ponds reflects Hydrologic Group "B" (Ustic Torrifluveots) as determined by the "Soil Survey of El Paso County Area," prepared by the National Cooperative Soil Survey (see map in Appendix).

## **EXISTING DRAINAGE CONDITIONS**

The site is located within the Jimmy Camp Drainage Basin. This site was previously studied in the "Drainage Report for Morning Sun Subdivision", by United Planning and Engineering, Co. (revised February 11, 1986). This currently proposed residential community is proposed to replace the previously platted (Tract B) but not constructed previously anticipated elementary school site. This report and map will be used as a portion of the existing conditions reference material.



Per visual observation, the site is predominantly covered in native grasses. The existing ground slopes in a south and south westerly direction as depicted on the Existing Conditions Drainage Map in the Appendix. All existing site flows drain directly into the existing southwesterly Colorado Centre Metropolitan District drainage facilities (culverts and trapezoidal channel). Existing flows tributary to the southwest corner of the site include:

Basin EX-A:  $Q_5 = 3.3$  cfs and  $Q_{100} = 7.3$  cfs (off-site unconcentrated flows into the site)

Basin EX-B:  $Q_5 = 2.4$  cfs and  $Q_{100} = 17.5$  cfs (on-site existing flows).

### **DEVELOPED DRAINAGE CONDITIONS**

Based upon City/County Drainage Criteria, the drainage approach for this development now reflects current criteria for stormwater quality (on-site) and Full Spectrum Detention requirements. The attached "Proposed Conditions Drainage Map" contains the preliminary, anticipated approach to drainage.

The majority of the site is comprised of Basin A ( $Q_5 = 17.6$  cfs,  $Q_{100} = 40.5$  cfs), 10.31-acres of existing off-site and proposed on-site public roadways, and single-family lots. At this preliminary stage of analysis, it is anticipated that all developed flows will be intercepted on-site in a proposed public storm system and then directed toward the proposed private Extended Detention Basin for detention and stormwater quality treatment. The ultimate release of all stormwater flows will be directly into the existing CCMD Storm Facilities as the flows currently do ( $Q_5 = 0.5$  cfs and  $Q_{100} = 5.8$  cfs from proposed pond).

The subsequent Final Drainage Report will provide a much higher level of detail for this proposed storm system and facilities, including public street capacity analysis, inlet calculations and pipe sizing analysis.

All proposed storm facilities within the public street right-of way will be public with ownership and maintenance by El Paso County.

The proposed Full Spectrum Detention Facility will be privately owned and maintained by the proposed homeowner's association.

## **DETENTION FACILITY**

A proposed private Extended Detention Basin (EDB) will provide full capture and detention of the on and off-site flows as reflected in the attached calculation sheets. Further design and calculation details will be provided in the subsequent Final Drainage Report.

## **STORMWATER QUALITY**

This site adheres to this **Four Step Process** as follows:

1. **Employ Runoff Reduction Practices:** Proposed impervious areas (roof tops, patios) will sheet flow across landscaped yards and through open space areas to slow runoff and increase time of concentration prior to being conveyed to the proposed public streets. This will minimize directly connected impervious areas within the project site.
2. **Stabilize Drainageways:** After developed flows utilize the runoff reduction practices through the yards, these flows will travel via curb and gutter within the public streets and eventually public storm systems. These collected flows are then routed directly to the proposed Full Spectrum Detention and stormwater quality facility on-site and ultimately released into existing CCMD storm facilities.
3. **Full Spectrum Detention and Provide Water Quality Capture Volume (WQCV):** Runoff from this development will be treated through capture and slow release of the WQCV in the proposed private on-site Full Spectrum Detention and water quality facility designed per current El Paso County drainage criteria.
4. **Consider need for Industrial and Commercial BMPs:** No industrial or commercial uses are proposed within this development. However, a site-specific storm water quality and erosion control plan and narrative will be submitted along with the grading and erosion control plan. Details such as site-specific source control construction BMP's as well as permanent BMP's

were detailed in this plan and narrative to protect receiving waters. BMP's will be constructed and maintained as the development has been graded and erosion control methods employed.

Based upon the requirement to provide Full Spectrum Detention and stormwater quality capture volume for the development area, a proposed Extended Detention Basin is proposed in the south area of the site. Per the preliminary calculations in the Appendix, a 1.087 ac-ft capture volume is needed. The details of this stormwater facility will be provided in the subsequent Final Drainage Report, including treatment of all disturbed areas, less any excluded areas.

### **HYDROLOGIC CALCULATIONS**

Hydrologic calculations were performed using the City of Colorado Springs/El Paso County Drainage Criteria Manual, as revised in November 1991 and 1994 with County adopted Chapter 6 and Section 3.2.1 of Chapter 13 of the City of Colorado Springs/El Paso County Drainage Criteria Manual as revised in May 2014. Individual on-site developed basin design used for inlet sizing and storm system routing was calculated using the Rational Method. Full Spectrum Detention pond modeling developed using UD-Detention spreadsheet ver. 3.07, Urban Drainage and Flood Control District.

The City of Colorado Springs/El Paso County DCM requires the Four Step Process for receiving water protection that focuses on reducing runoff volumes, treating the water quality capture volume (WQCV), stabilizing drainage ways, and implementing long-term source controls. The Four Step Process pertains to management of smaller, frequently occurring storm events, as opposed to larger storms for which drainage and flood control infrastructure are sized. Implementation of these four steps helps to achieve storm water permit requirements.

### **FLOODPLAIN STATEMENT**

A portion of this site is located within a FEMA floodplain as determined by the Flood Insurance Rate Maps (F.I.R.M.) Map Number 08041C0769G, with effective dates of December 7, 2018 (See Appendix).



## **EROSION CONTROL PLAN**

The Drainage Criteria Manual specifies an Erosion Control Plan and associated cost estimate be submitted with the Final Drainage Report. We respectfully request that the Erosion Control Plan and cost estimate be submitted in conjunction with the Overlot Grading Plan and construction assurances posted prior to obtaining a grading permit. Early grading is not being requested with this application.

## **DRAINAGE & BRIDGE FEES**

This site lies within the Jimmy Camp Creek Drainage Basin. As this site was previously platted as Tract B, no drainage or bridge fees will be required to be paid. Confirmation of prior platting and inclusion or exclusion in the Drainage Basin Planning Study will be provided in the Final Drainage Report to justify that no fees are required.

## **SUMMARY**

This proposed development remains consistent with the previously anticipated drainage patterns for the site. The proposed Full Spectrum Detention and stormwater quality facility meets current criteria. The proposed development will not adversely impact surrounding developments.

A future Final Plat application will include Construction Drawings and a Final Drainage Report to provide further Final Design details associated with the more detailed design.

PREPARED BY:

**Classic Consulting**



Kyle R. Campbell, P.E.  
Division Manager

db/250603/REPORTS/ PDR




## REFERENCES

1. City of Colorado Springs/County of El Paso Drainage Criteria Manual dated October 1991.\*
2. "Drainage Report and Plan – Waterside Condominiums Subdivision", by Leigh Whitehead.
3. Drainage Criteria Manual (Volume 3) latest revision April 2008, Urban Drainage and Flood Criteria District.
4. El Paso County Engineering Criteria Manual, Resolution No. 20-222, June 23, 2020 (Supp. No.2).

\*EPC Board Resolution NO. 15-042 (El Paso County adoption of Chapter 6 and Section 3.2.1 Chapter 13 of the City of Colorado Springs Drainage Criteria manual dated May 2014, hydrology and full-spectrum detention)


## APPENDIX

## VICINITY MAP

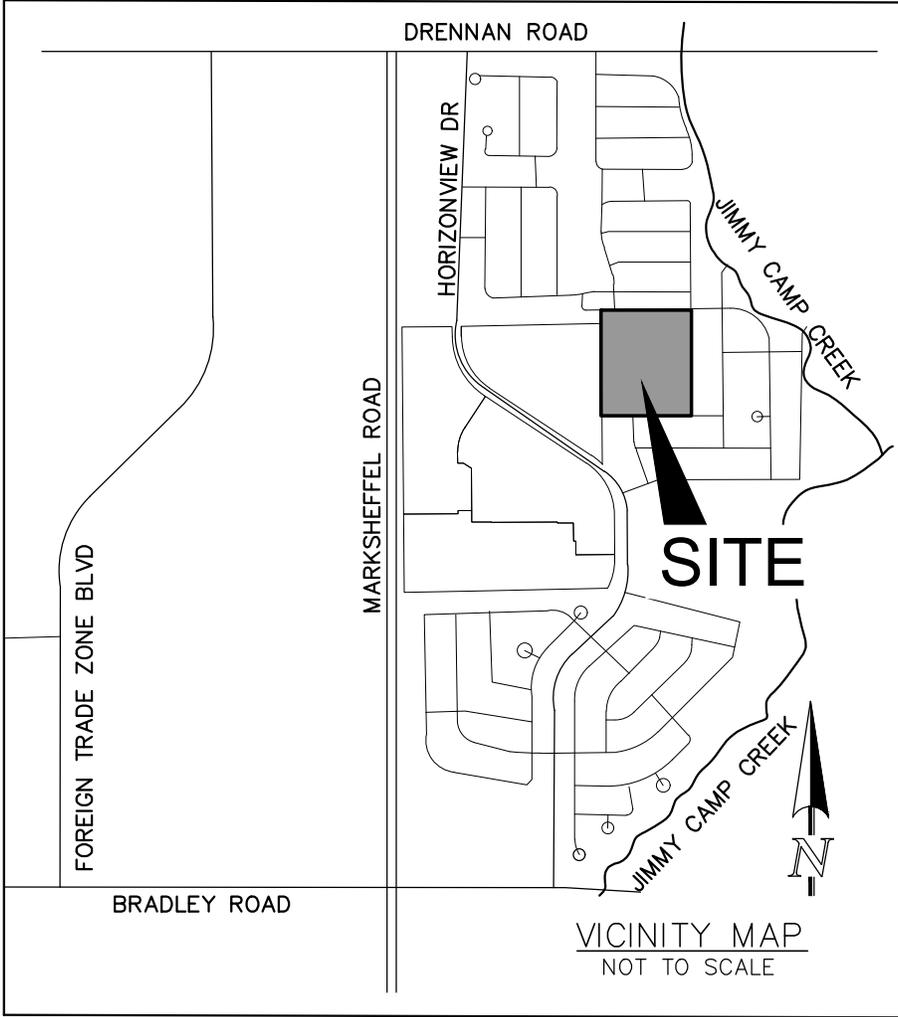


**SOILS MAP (S.C.S SURVEY)**

Hydrologic Soil Group—El Paso County Area, Colorado

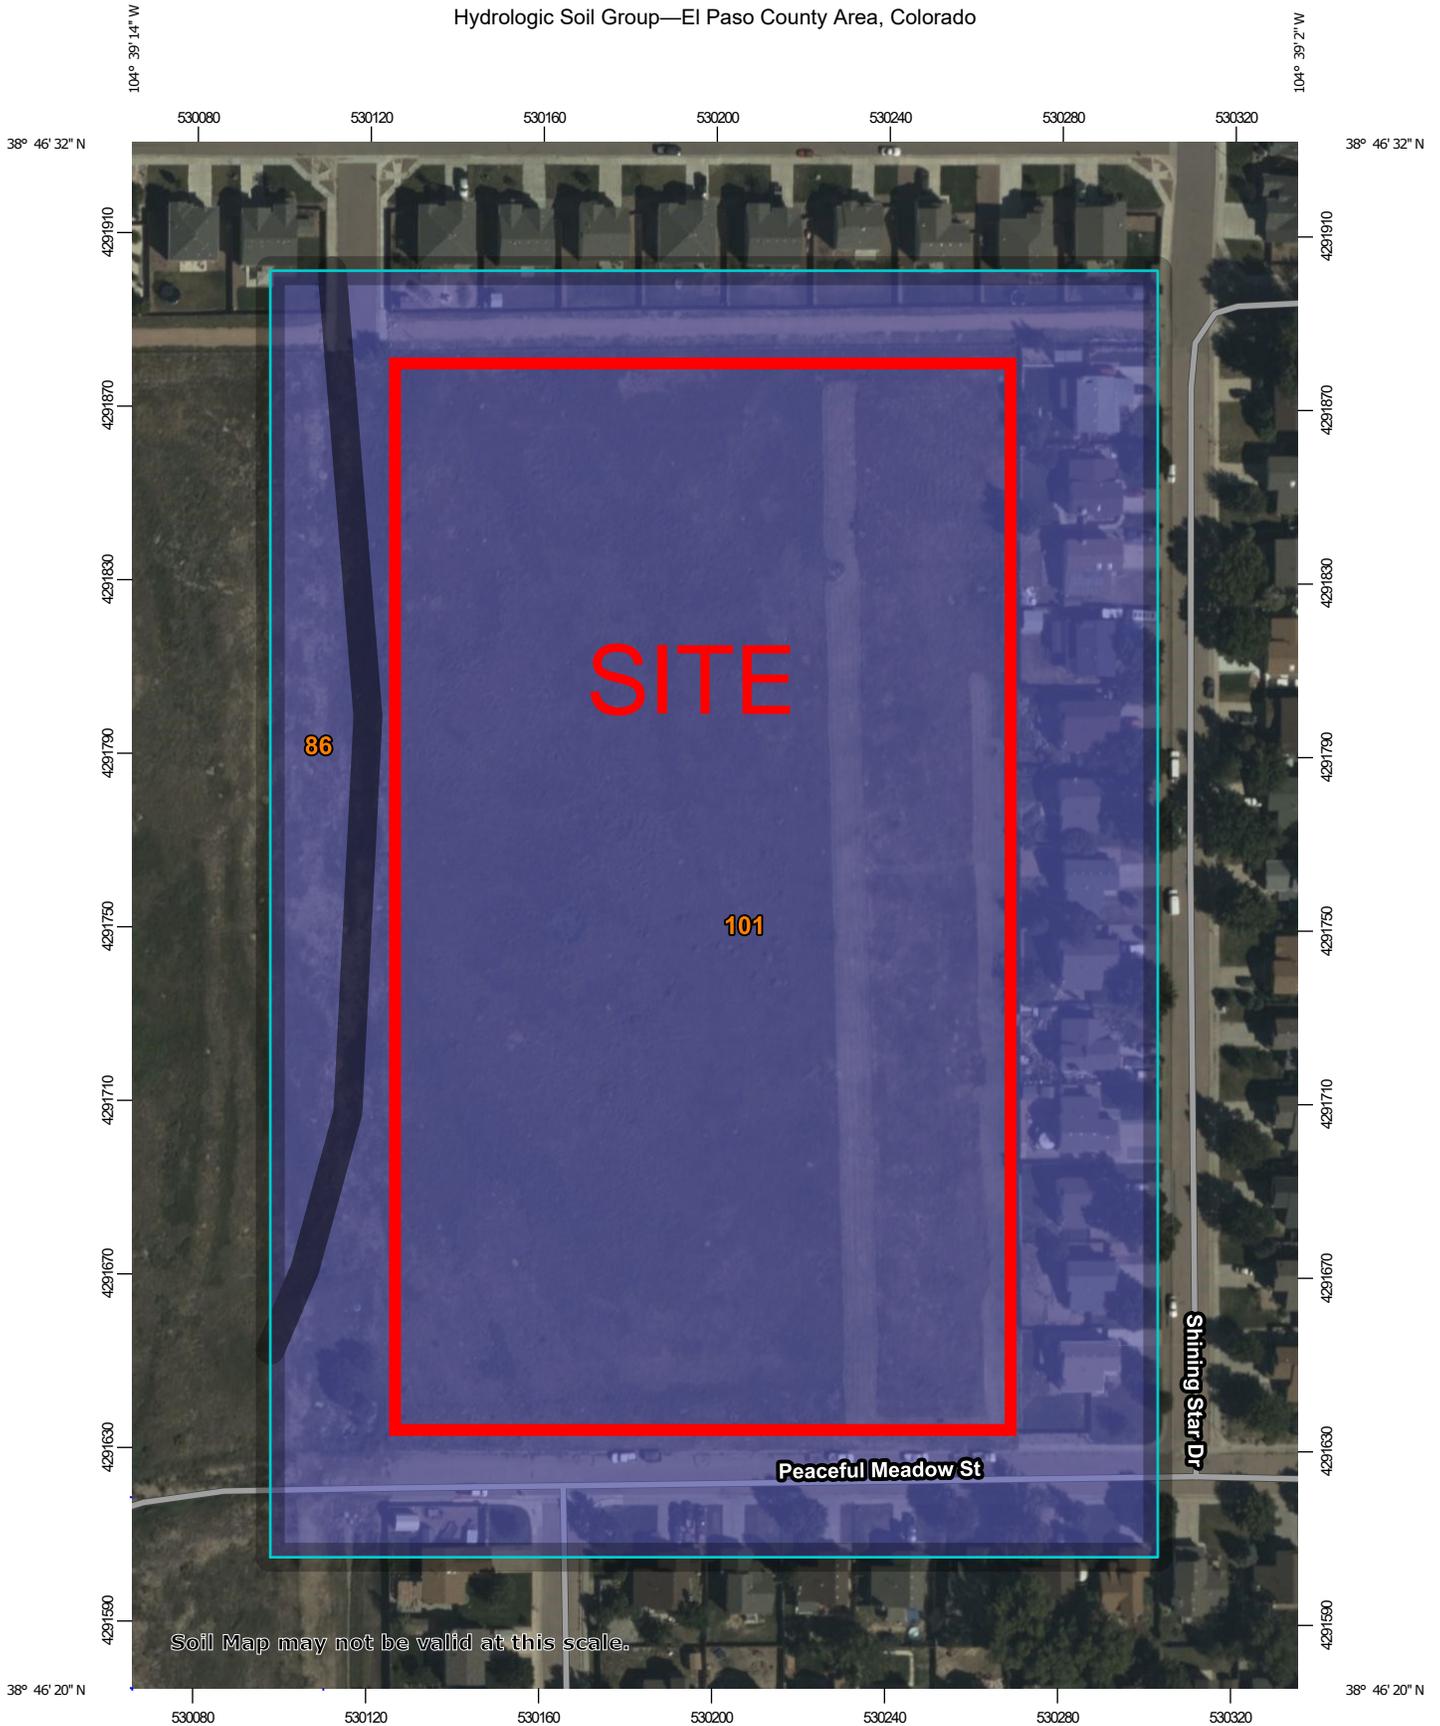

Soil Map may not be valid at this scale.

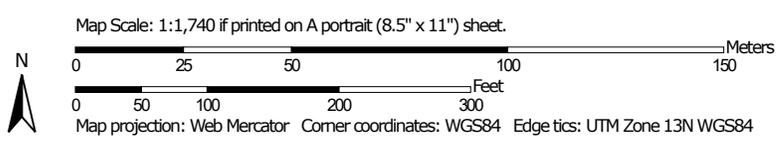

### MAP LEGEND

- Area of Interest (AOI)**
  -  Area of Interest (AOI)
- Soils**
  - Soil Rating Polygons**
    -  A
    -  A/D
    -  B
    -  B/D
    -  C
    -  C/D
    -  D
    -  Not rated or not available
  - Soil Rating Lines**
    -  A
    -  A/D
    -  B
    -  B/D
    -  C
    -  C/D
    -  D
    -  Not rated or not available
  - Soil Rating Points**
    -  A
    -  A/D
    -  B
    -  B/D
- Water Features**
  -  Streams and Canals
- Transportation**
  -  Rails
  -  Interstate Highways
  -  US Routes
  -  Major Roads
  -  Local Roads
- Background**
  -  Aerial Photography
- Other**
  -  C
  -  C/D
  -  D
  -  Not rated or not available

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

**Warning:** Soil Map may not be valid at this scale.  
 Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 21, Aug 24, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 11, 2018—Oct 20, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
86	Stoneham sandy loam, 3 to 8 percent slopes	B	1.1	7.0%
101	Ustic Torrfluvents, loamy	B	14.0	93.0%
<b>Totals for Area of Interest</b>			<b>15.1</b>	<b>100.0%</b>

### Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

### Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff: None Specified*

*Tie-break Rule: Higher*

**F.E.M.A. MAP**

# National Flood Hazard Layer FIRMMette



104°39'24"W 38°46'36"N



## Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT


SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) <i>Zone A, V, A99</i>
		With BFE or Depth <i>Zone AE, AO, AH, VE, AR</i>
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile <i>Zone X</i>
		Future Conditions 1% Annual Chance Flood Hazard <i>Zone X</i>
		Area with Reduced Flood Risk due to Levee. See Notes. <i>Zone X</i>
		Area with Flood Risk due to Levee <i>Zone D</i>
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard <i>Zone X</i>
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard <i>Zone D</i>
		Channel, Culvert, or Storm Sewer
OTHER FEATURES		Levee, Dike, or Floodwall
		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
MAP PANELS		17.5 Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature
		Digital Data Available
		No Digital Data Available
		Unmapped
		The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.



This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 6/4/2024 at 8:43 AM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.



## HYDROLOGIC / HYDRAULIC CALCULATIONS

JOB NAME: HABITAT FOR HUMANITY  
 JOB NUMBER: 2506.03  
 DATE: 05/23/23  
 CALCULATED BY: MAL

**FINAL DRAINAGE REPORT ~ BASIN RUNOFF COEFFICIENT SUMMARY (EXISTING CONDITIONS)**

BASIN	TOTAL AREA (AC)	IMPERVIOUS AREA / STREETS			LOTS/LANDSCAPE/UNDEV. AREAS (NOT PAVEMENT)				WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	LAND USE	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
EX-A	1.63	1.63	0.45	0.59	0.00	OPEN	0.08	0.35	0.45	0.59	0.73	0.96
EX-B	9.00	0.00	0.90	0.96	9.00	OPEN	0.08	0.35	0.08	0.35	0.72	3.15

JOB NAME: **HABITAT FOR HUMANITY**  
 JOB NUMBER: **2506.03**  
 DATE: **5/23/2023**  
 CALC'D BY: **MAL**

**FINAL DRAINAGE REPORT ~ BASIN RUNOFF SUMMARY (EXISTING CONDITIONS)**

BASIN	WEIGHTED		OVERLAND				STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS	
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
EX-A	0.73	0.96	0.45	70	1.5	7.6	50	2.0%	4.9	0.2	7.8	4.50	7.56	3.3	7.3
EX-B	0.72	3.15	0.08	100	2	14.7	700	1.5%	4.3	2.7	17.4	3.30	5.54	2.4	17.5

JOB NAME: HABITAT FOR HUMANITY  
 JOB NUMBER: 2506.03  
 DATE: 05/23/23  
 CALCULATED BY: MAL

**FINAL DRAINAGE REPORT ~ BASIN RUNOFF COEFFICIENT SUMMARY (DEVELOPED CONDITIONS)**

BASIN	TOTAL AREA (AC)	IMPERVIOUS AREA / DEV. AREA			LANDSCAPE/UNDEVELOPED AREAS				WEIGHTED		WEIGHTED CA	
		AREA (AC)	C(5)	C(100)	AREA (AC)	LAND USE	C(5)	C(100)	C(5)	C(100)	CA(5)	CA(100)
A	10.31	9.28	0.45	0.59	1.03	-	0.08	0.35	0.41	0.57	4.26	5.84

JOB NAME: **HABITAT FOR HUMANITY**  
 JOB NUMBER: **2506.03**  
 DATE: **5/23/2023**  
 CALC'D BY: **MAL**

**FINAL DRAINAGE REPORT ~ BASIN RUNOFF SUMMARY (DEVELOPED CONDITIONS)**

BASIN	WEIGHTED		OVERLAND			STREET / CHANNEL FLOW				Tc	INTENSITY		TOTAL FLOWS		
	CA(5)	CA(100)	C(5)	Length (ft)	Height (ft)	Tc (min)	Length (ft)	Slope (%)	Velocity (fps)	Tc (min)	TOTAL (min)	I(5) (in/hr)	I(100) (in/hr)	Q(5) (cfs)	Q(100) (cfs)
A	4.26	5.84	0.45	70	1.5	7.6	720	2.2%	5.2	2.3	9.9	4.14	6.95	17.6	40.5

## FULL SPECTRUM DETENTION CALCULATIONS

**Design Procedure Form: Extended Detention Basin (EDB)**

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

**Designer:** M. Larson  
**Company:** Classic Consulting  
**Date:** June 4, 2024  
**Project:** Habitat for Humanity  
**Location:** Pond - Prelim Design

<p>1. Basin Storage Volume</p> <p>A) Effective Imperviousness of Tributary Area, <math>I_a</math></p> <p>B) Tributary Area's Imperviousness Ratio (<math>i = I_a / 100</math>)</p> <p>C) Contributing Watershed Area</p> <p>D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm</p> <p>E) Design Concept (Select EURV when also designing for flood control)</p> <p>F) Design Volume (WQCV) Based on 40-hour Drain Time (<math>V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i) / 12 * Area)</math>)</p> <p>G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume (<math>V_{WQCV\ OTHER} = (d_6 * (V_{DESIGN} / 0.43))</math>)</p> <p>H) User Input of Water Quality Capture Volume (WQCV) Design Volume (Only if a different WQCV Design Volume is desired)</p> <p>I) NRCS Hydrologic Soil Groups of Tributary Watershed              i) Percentage of Watershed consisting of Type A Soils              ii) Percentage of Watershed consisting of Type B Soils              iii) Percentage of Watershed consisting of Type C/D Soils</p> <p>J) Excess Urban Runoff Volume (EURV) Design Volume              For HSG A: <math>EURV_A = 1.68 * i^{1.28}</math>              For HSG B: <math>EURV_B = 1.36 * i^{1.08}</math>              For HSG C/D: <math>EURV_{C/D} = 1.20 * i^{1.08}</math></p> <p>K) User Input of Excess Urban Runoff Volume (EURV) Design Volume (Only if a different EURV Design Volume is desired)</p>	<p><math>I_a =</math> <input type="text" value="58.7"/> %</p> <p><math>i =</math> <input type="text" value="0.587"/></p> <p>Area = <input type="text" value="10.310"/> ac</p> <p><math>d_6 =</math> <input type="text" value="0.42"/> in</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> <p>Choose One</p> <p><input type="radio"/> Water Quality Capture Volume (WQCV)</p> <p><input checked="" type="radio"/> Excess Urban Runoff Volume (EURV)</p> </div> <p><math>V_{DESIGN} =</math> <input type="text"/> ac-ft</p> <p><math>V_{DESIGN\ OTHER} =</math> <input type="text" value="0.195"/> ac-ft</p> <p><math>V_{DESIGN\ USER} =</math> <input type="text"/> ac-ft</p> <p>HSG A = <input type="text" value="0"/> %              HSG B = <input type="text" value="100"/> %              HSG C/D = <input type="text" value="0"/> %</p> <p><math>EURV_{DESIGN} =</math> <input type="text" value="0.657"/> ac-ft</p> <p><math>EURV_{DESIGN\ USER} =</math> <input type="text"/> ac-ft</p>
<p>2. Basin Shape: Length to Width Ratio (A basin length to width ratio of at least 2:1 will improve TSS reduction.)</p>	<p>L : W = <input type="text" value="2.0"/> : 1</p>
<p>3. Basin Side Slopes</p> <p>A) Basin Maximum Side Slopes (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>Z = <input type="text" value="4.00"/> ft / ft</p>
<p>4. Inlet</p> <p>A) Describe means of providing energy dissipation at concentrated inflow locations:</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>
<p>5. Forebay</p> <p>A) Minimum Forebay Volume (<math>V_{MIN} =</math> <input type="text" value="3%"/> of the WQCV)</p> <p>B) Actual Forebay Volume</p> <p>C) Forebay Depth (<math>D_F =</math> <input type="text" value="18"/> inch maximum)</p> <p>D) Forebay Discharge</p> <p>i) Undetained 100-year Peak Discharge</p> <p>ii) Forebay Discharge Design Flow (<math>Q_F = 0.02 * Q_{100}</math>)</p> <p>E) Forebay Discharge Design</p> <p>F) Discharge Pipe Size (minimum 8-inches)</p> <p>G) Rectangular Notch Width</p>	<p><math>V_{MIN} =</math> <input type="text" value="0.006"/> ac-ft</p> <p><math>V_F =</math> <input type="text"/> ac-ft</p> <p><math>D_F =</math> <input type="text"/> in</p> <p><math>Q_{100} =</math> <input type="text"/> cfs</p> <p><math>Q_F =</math> <input type="text"/> cfs</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;"> <p>Choose One</p> <p><input type="radio"/> Berm With Pipe</p> <p><input type="radio"/> Wall with Rect. Notch</p> <p><input type="radio"/> Wall with V-Notch Weir</p> </div> <p>Calculated <math>D_P =</math> <input type="text"/> in</p> <p>Calculated <math>W_N =</math> <input type="text"/> in</p> <p style="color: blue; font-size: small;">Flow too small for berm w/ pipe</p>

**Design Procedure Form: Extended Detention Basin (EDB)**

**Designer:** M. Larson  
**Company:** Classic Consulting  
**Date:** June 4, 2024  
**Project:** Habitat for Humanity  
**Location:** Pond - Prelim Design

<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;">             Choose One  <input checked="" type="radio"/> Concrete  <input type="radio"/> Soft Bottom         </div> <p>S = <input type="text" value="0.0050"/> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft<sup>2</sup> minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>D<sub>M</sub> = <input type="text" value="2.5"/> ft</p> <p>A<sub>M</sub> = <input type="text" value="75"/> sq ft</p> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;">             Choose One  <input checked="" type="radio"/> Orifice Plate  <input type="radio"/> Other (Describe):         </div> <hr/> <hr/> <p>D<sub>orifice</sub> = <input type="text" value="0.50"/> inches</p> <p>A<sub>ot</sub> = <input type="text" value="10.50"/> square inches</p>
<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>D<sub>IS</sub> = <input type="text" value="4"/> in</p> <p>V<sub>IS</sub> = <input type="text" value="25"/> cu ft</p> <p>V<sub>s</sub> = <input type="text" value="25.0"/> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: <math>A_t = A_{tot} * 38.5 * (e^{-0.095D})</math></p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open are to the total screen are for the material specified.)</p> <p style="margin-left: 40px;">Other (Y/N): <input type="text" value="N"/></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H<sub>TR</sub>)</p> <p>G) Width of Water Quality Screen Opening (W<sub>opening</sub>) (Minimum of 12 inches is recommended)</p>	<p>A<sub>t</sub> = <input type="text" value="385"/> square inches</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 10px; text-align: center;"> <i>S.S. Well Screen with 60% Open Area</i> </div> <hr/> <hr/> <p>User Ratio = <input type="text"/></p> <p>A<sub>total</sub> = <input type="text" value="642"/> sq. in.</p> <p>H = <input type="text" value="3.9"/> feet</p> <p>H<sub>TR</sub> = <input type="text" value="74.8"/> inches</p> <p>W<sub>opening</sub> = <input type="text" value="12.0"/> inches <span style="color: red; font-weight: bold;">VALUE LESS THAN RECOMMENDED MIN. WIDTH. WIDTH HAS BEEN SET TO 12 INCHES.</span></p>

Design Procedure Form: Extended Detention Basin (EDB)

Sheet 3 of 3


Designer: M. Larson  
Company: Classic Consulting  
Date: June 4, 2024  
Project: Habitat for Humanity  
Location: Pond - Prelim Design

<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>BURIED RIPRAP SPILLWAY</p> <p>Ze = <input type="text" value="4.00"/> ft / ft</p>
<p>11. Vegetation</p>	<p>Choose One</p> <p><input checked="" type="radio"/> Irrigated</p> <p><input type="radio"/> Not Irrigated</p> <p>AVOID PLACING IRRIGATION HEADS IN THE BOTTOM OF THE BASIN</p>
<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<p>ROAD TO BOTTOM AND ALL STRUCTURES</p>
<p>Notes:</p>	



# DETENTION BASIN STAGE-STORAGE TABLE BUILDER


*MHFD-Detention, Version 4.06 (July 2022)*

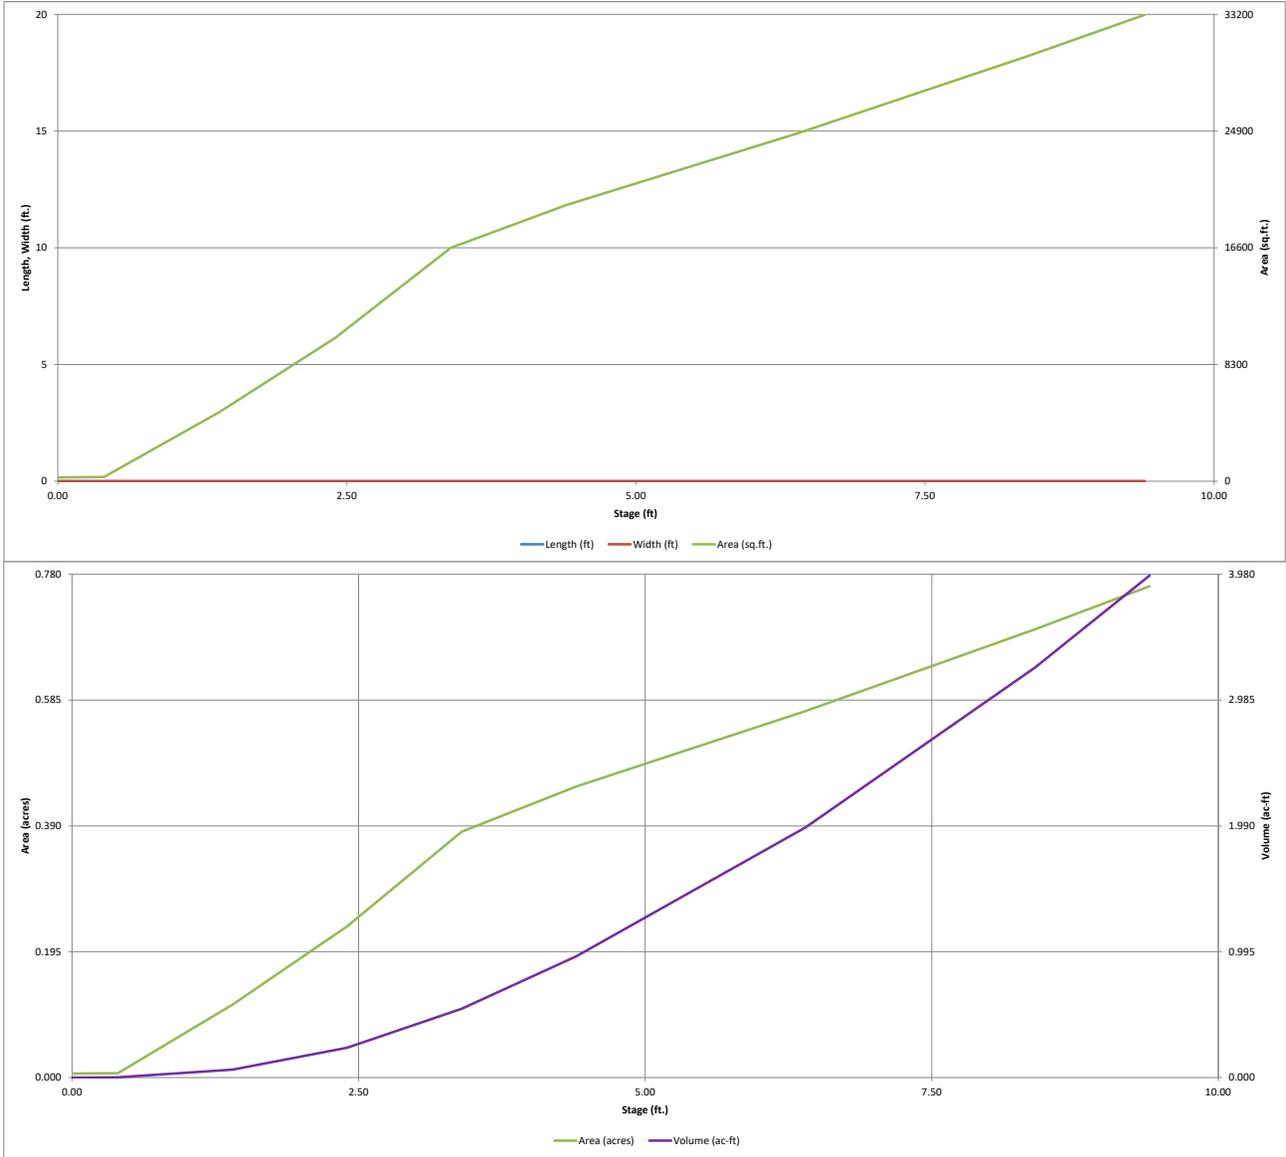

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

**Project:** HABITAT FOR HUMANITY  
**Basin ID:** POND - PRELIM

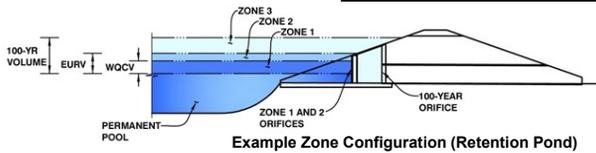

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.24	0.199	Orifice Plate
Zone 2 (EURV)	3.69	0.456	Orifice Plate
Zone 3 (100-year)	4.68	0.431	Weir&Pipe (Circular)
<b>Total (all zones)</b>		<b>1.087</b>	

**User Input:** Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
 Underdrain Orifice Diameter =  inches

**Calculated Parameters for Underdrain**  
 Underdrain Orifice Area =  ft<sup>2</sup>  
 Underdrain Orifice Centroid =  feet

**User Input:** Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Centroid of Lowest Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
 Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft)  
 Orifice Plate: Orifice Vertical Spacing =  inches  
 Orifice Plate: Orifice Area per Row =  sq. inches

**Calculated Parameters for Plate**  
 WQ Orifice Area per Row =  ft<sup>2</sup>  
 Elliptical Half-Width =  feet  
 Elliptical Slot Centroid =  feet  
 Elliptical Slot Area =  ft<sup>2</sup>

**User Input:** Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.30	2.60					
Orifice Area (sq. inches)	0.50	4.00	6.00					
	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

**User Input:** Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

**Calculated Parameters for Vertical Orifice**  
 Vertical Orifice Area =  ft<sup>2</sup>  
 Vertical Orifice Centroid =  feet

**User Input:** Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	3.90	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	4.00	N/A	feet
Overflow Weir Grate Slope =	3.00	N/A	H:V
Horiz. Length of Weir Sides =	4.00	N/A	feet
Overflow Grate Type =	Type C Grate	N/A	
Debris Clogging % =	50%	N/A	%

**Calculated Parameters for Overflow Weir**  
 Height of Grate Upper Edge, H<sub>u</sub> =  feet  
 Overflow Weir Slope Length =  feet  
 Grate Open Area / 100-yr Orifice Area =   
 Overflow Grate Open Area w/o Debris =  ft<sup>2</sup>  
 Overflow Grate Open Area w/ Debris =  ft<sup>2</sup>

**User Input:** Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Circular	Not Selected	
Depth to Invert of Outlet Pipe =	0.25	N/A	ft (distance below basin bottom at Stage = 0 ft)
Circular Orifice Diameter =	18.00	N/A	inches

**Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate**  
 Outlet Orifice Area =  ft<sup>2</sup>  
 Outlet Orifice Centroid =  feet  
 Half-Central Angle of Restrictor Plate on Pipe =  radians

**User Input:** Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =  ft (relative to basin bottom at Stage = 0 ft)  
 Spillway Crest Length =  feet  
 Spillway End Slopes =  H:V  
 Freeboard above Max Water Surface =  feet

**Calculated Parameters for Spillway**  
 Spillway Design Flow Depth =  feet  
 Stage at Top of Freeboard =  feet  
 Basin Area at Top of Freeboard =  acres  
 Basin Volume at Top of Freeboard =  acre-ft


## Routed Hydrograph Results

*The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).*

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.10
One-Hour Rainfall Depth (in) =	0.199	0.655	0.582	0.808	1.002	1.250	1.458	1.715	2.212
CUHP Runoff Volume (acre-ft) =	N/A	N/A	0.582	0.808	1.002	1.250	1.458	1.715	2.212
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	1.5	4.1	6.0	10.7	13.4	16.7	22.8
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A							
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.14	0.39	0.59	1.04	1.30	1.62	2.21
Peak Inflow Q (cfs) =	N/A	N/A	11.9	16.6	19.9	25.1	29.3	35.1	44.7
Peak Outflow Q (cfs) =	0.2	0.4	0.4	0.5	1.0	2.2	3.5	5.8	10.2
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	0.1	0.2	0.2	0.3	0.3	0.4
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Overflow Weir 1				
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	0.0	0.1	0.2	0.4	0.8
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	51	59	59	60	59	54	51	46	42
Time to Drain 99% of Inflow Volume (hours) =	55	70	69	73	74	73	72	70	66
Maximum Ponding Depth (ft) =	2.24	3.69	3.36	3.89	4.26	4.59	4.86	5.21	5.72
Area at Maximum Ponding Depth (acres) =	0.21	0.40	0.38	0.42	0.44	0.46	0.48	0.50	0.53
Maximum Volume Stored (acre-ft) =	0.200	0.657	0.529	0.739	0.898	1.047	1.169	1.340	1.601

# DETENTION BASIN OUTLET STRUCTURE DESIGN

*MHFD-Detention, Version 4.06 (July 2022)*

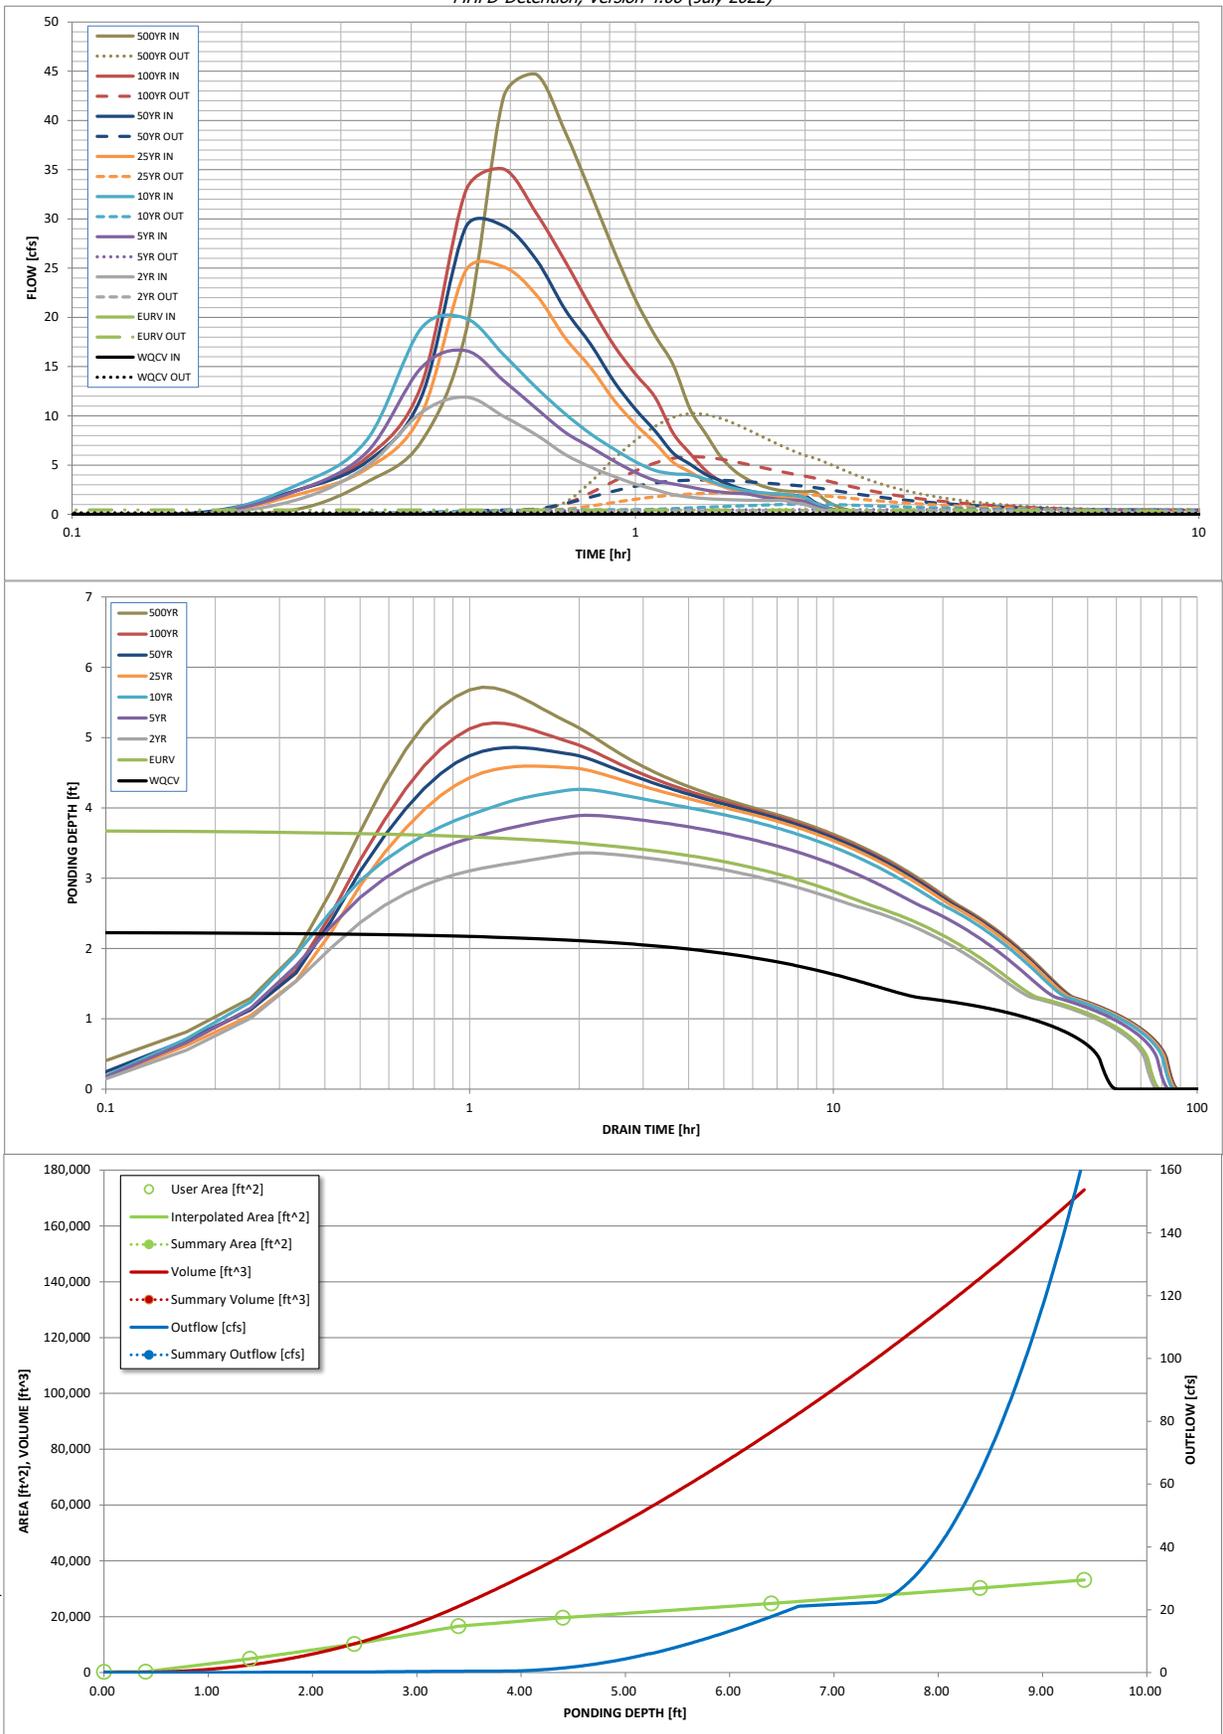

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]	
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.16	0.02	0.50
	0:15:00	0.00	0.00	1.45	2.37	2.94	1.97	2.42	2.40	3.27	3.27
	0:20:00	0.00	0.00	4.86	6.29	7.52	4.61	5.32	5.75	7.37	7.37
	0:25:00	0.00	0.00	10.33	14.88	18.89	10.13	11.88	13.07	18.52	18.52
	0:30:00	0.00	0.00	11.90	16.62	19.91	24.76	29.18	32.87	42.37	42.37
	0:35:00	0.00	0.00	9.95	13.58	16.22	25.13	29.29	35.07	44.69	44.69
	0:40:00	0.00	0.00	8.07	10.75	12.88	22.29	25.87	30.60	38.87	38.87
	0:45:00	0.00	0.00	6.08	8.33	10.21	17.93	20.80	25.71	32.61	32.61
	0:50:00	0.00	0.00	4.79	6.81	8.16	14.88	17.25	21.03	26.74	26.74
	0:55:00	0.00	0.00	3.84	5.40	6.62	11.57	13.47	17.12	21.81	21.81
	1:00:00	0.00	0.00	3.06	4.26	5.34	9.14	10.68	14.25	18.16	18.16
	1:05:00	0.00	0.00	2.52	3.45	4.45	7.24	8.48	11.90	15.19	15.19
	1:10:00	0.00	0.00	2.00	3.09	4.12	5.28	6.22	8.23	10.68	10.68
	1:15:00	0.00	0.00	1.74	2.77	4.02	4.30	5.10	6.18	8.16	8.16
	1:20:00	0.00	0.00	1.60	2.46	3.57	3.43	4.05	4.44	5.85	5.85
	1:25:00	0.00	0.00	1.52	2.26	3.00	2.90	3.42	3.35	4.40	4.40
	1:30:00	0.00	0.00	1.47	2.14	2.62	2.40	2.80	2.70	3.53	3.53
	1:35:00	0.00	0.00	1.43	2.06	2.37	2.09	2.41	2.26	2.94	2.94
	1:40:00	0.00	0.00	1.41	1.79	2.21	1.90	2.17	1.99	2.58	2.58
	1:45:00	0.00	0.00	1.40	1.61	2.10	1.77	2.01	1.84	2.38	2.38
	1:50:00	0.00	0.00	1.40	1.49	2.02	1.71	1.93	1.80	2.31	2.31
	1:55:00	0.00	0.00	1.16	1.42	1.91	1.67	1.88	1.78	2.28	2.28
	2:00:00	0.00	0.00	0.99	1.32	1.70	1.65	1.86	1.78	2.28	2.28
	2:05:00	0.00	0.00	0.64	0.85	1.10	1.07	1.21	1.16	1.48	1.48
	2:10:00	0.00	0.00	0.40	0.53	0.70	0.69	0.77	0.74	0.95	0.95
	2:15:00	0.00	0.00	0.25	0.33	0.43	0.43	0.48	0.46	0.59	0.59
	2:20:00	0.00	0.00	0.14	0.20	0.26	0.26	0.29	0.27	0.35	0.35
	2:25:00	0.00	0.00	0.07	0.11	0.14	0.15	0.17	0.16	0.20	0.20
	2:30:00	0.00	0.00	0.03	0.05	0.06	0.07	0.08	0.07	0.09	0.09
	2:35:00	0.00	0.00	0.01	0.02	0.02	0.02	0.02	0.02	0.03	0.03
	2:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	



JOB NAME: HABITAT  
 JOB NUMBER: 2506.03  
 DATE: 06/04/24  
 CALCULATED BY: MAL

**TOTAL POND VOLUME**

POND SIZING WITH PONDPACK EQUATION:  
 INSERT POND DESIGN SIZE INFO: (RED)

POND ELEVATION :	
(from lowest to highest)	
	5831.60
	5831.60
	5831.93
	5832.00
	5833.00
	5834.00
	5835.00
	5836.00
	5838.00
	5840.00
	5841.00

AREA (BTM to TOP):		
273	0.01	acres
273	0.01	acres
273	0.01	acres
300	0.01	acres
4,926	0.11	acres
10,203	0.23	acres
16,599	0.38	acres
19,652	0.45	acres
24,746	0.57	acres
30,260	0.69	acres
33,171	0.76	acres
-	-	acres

**PRELIMINARY SIZE:**

VOLUME =  $1/3\{(EL2-EL1)*(A1+A2+((A1*A2)^.5))\}$

**CUMMULATIVE VOLUME:**

-	AC-FT	from	5,832	to	5,832	
0.00	AC-FT	from	5,832	to	5,832	0.00
0.00	AC-FT	from	5,832	to	5,832	0.00
0.05	AC-FT	from	5,832	to	5,833	0.05
0.17	AC-FT	from	5,833	to	5,834	0.22
0.30	AC-FT	from	5,834	to	5,835	0.52
0.41	AC-FT	from	5,835	to	5,836	0.93
1.01	AC-FT	from	5,836	to	5,838	1.94
1.25	AC-FT	from	5,838	to	5,840	3.19
0.72	AC-FT	from	5,840	to	5,841	3.91
-	AC-FT	from	5,841	to	-	3.91

\*SIZING IS FOR PRELIMINARY PURPOSES ONLY.

**VOLUME = 3.91 AC-FT**

**APPROXIMATE SURFACE AREA REQUIREMENT**

POND DEPTH (FT)	POND VOLUME			SURFACE AREA (SF)
	AC-FT	=	CF	
4	3.91	=	#####	42,560
6	3.91	=	#####	28,373
8	3.91	=	#####	21,280
10	3.91	=	#####	17,024

JOB NAME: HABITAT  
 JOB NUMBER: 2506.03  
 DATE: 06/04/24  
 CALCULATED BY: MAL

TOTAL EURV

POND SIZING WITH PONDPACK EQUATION:  
 INSERT POND DESIGN SIZE INFO: (RED)

POND ELEVATION :	
(from lowest to highest)	
	5831.60
	5831.60
	5831.93
	5832.00
	5833.00
	5834.00
	5835.00
	5835.50

AREA (BTM to TOP):		
273	0.01	acres
273	0.01	acres
273	0.01	acres
300	0.01	acres
4,926	0.11	acres
10,203	0.23	acres
16,599	0.38	acres
18,462	0.42	acres
	-	acres

**PRELIMINARY SIZE:**

VOLUME =  $1/3\{(EL2-EL1)*(A1+A2+((A1*A2)^.5))\}$

**CUMMULATIVE VOLUME:**

-	AC-FT	from	5,832	to	5,832	
0.00	AC-FT	from	5,832	to	5,832	0.00
0.00	AC-FT	from	5,832	to	5,832	0.00
0.05	AC-FT	from	5,832	to	5,833	0.05
0.17	AC-FT	from	5,833	to	5,834	0.22
0.30	AC-FT	from	5,834	to	5,835	0.52
0.20	AC-FT	from	5,835	to	5,836	0.72
-	AC-FT	from	5,836	to	-	0.72
-	AC-FT	from	-	to	-	0.72
-	AC-FT	from	-	to	-	0.72
-	AC-FT	from	-	to	-	0.72

\*SIZING IS FOR PRELIMINARY PURPOSES ONLY.

**VOLUME = 0.72 AC-FT**

**APPROXIMATE SURFACE AREA REQUIREMENT**

POND DEPTH (FT)	POND VOLUME			SURFACE AREA (SF)
	AC-FT	=	CF	
4	0.72	=	31,380	7,845
6	0.72	=	31,380	5,230
8	0.72	=	31,380	3,922
10	0.72	=	31,380	3,138

JOB NAME: HABITAT  
 JOB NUMBER: 2506.03  
 DATE: 06/04/24  
 CALCULATED BY: MAL

TO SPILLWAY

POND SIZING WITH PONDPACK EQUATION:  
 INSERT POND DESIGN SIZE INFO: (RED)

POND ELEVATION :	
(from lowest to highest)	
	5831.60
	5831.60
	5831.93
	5832.00
	5833.00
	5834.00
	5835.00
	5836.00
	5838.00
	5839.00

AREA (BTM to TOP):		
273	0.01	acres
273	0.01	acres
273	0.01	acres
300	0.01	acres
4,926	0.11	acres
10,203	0.23	acres
16,599	0.38	acres
19,652	0.45	acres
24,746	0.57	acres
27,450	0.63	acres
	-	acres
	-	acres

**PRELIMINARY SIZE:**

VOLUME =  $1/3\{(EL2-EL1)*(A1+A2+((A1*A2)^.5))\}$

**CUMMULATIVE VOLUME:**

-	AC-FT	from	5,832	to	5,832	
0.00	AC-FT	from	5,832	to	5,832	0.00
0.00	AC-FT	from	5,832	to	5,832	0.00
0.05	AC-FT	from	5,832	to	5,833	0.05
0.17	AC-FT	from	5,833	to	5,834	0.22
0.30	AC-FT	from	5,834	to	5,835	0.52
0.41	AC-FT	from	5,835	to	5,836	0.93
1.01	AC-FT	from	5,836	to	5,838	1.94
0.59	AC-FT	from	5,838	to	5,839	2.53
-	AC-FT	from	5,839	to	-	2.53
-	AC-FT	from	-	to	-	2.53

\*SIZING IS FOR PRELIMINARY PURPOSES ONLY.

**VOLUME = 2.53 AC-FT**

**APPROXIMATE SURFACE AREA REQUIREMENT**

POND DEPTH (FT)	POND VOLUME			SURFACE AREA (SF)
	AC-FT	=	CF	
4	2.53	=	#####	27,578
6	2.53	=	#####	18,385
8	2.53	=	#####	13,789
10	2.53	=	#####	11,031



**REFERENCE MATERIAL FROM PRIOR STUDIES**

# MORNING SUN SUBDIVISION

AT COLORADO CENTRE

DEVELOPED BY:

KEITH DEVELOPMENT COMPANY  
5040 CORPORATE PLAZA DRIVE  
COLORADO SPRINGS, CO 80919

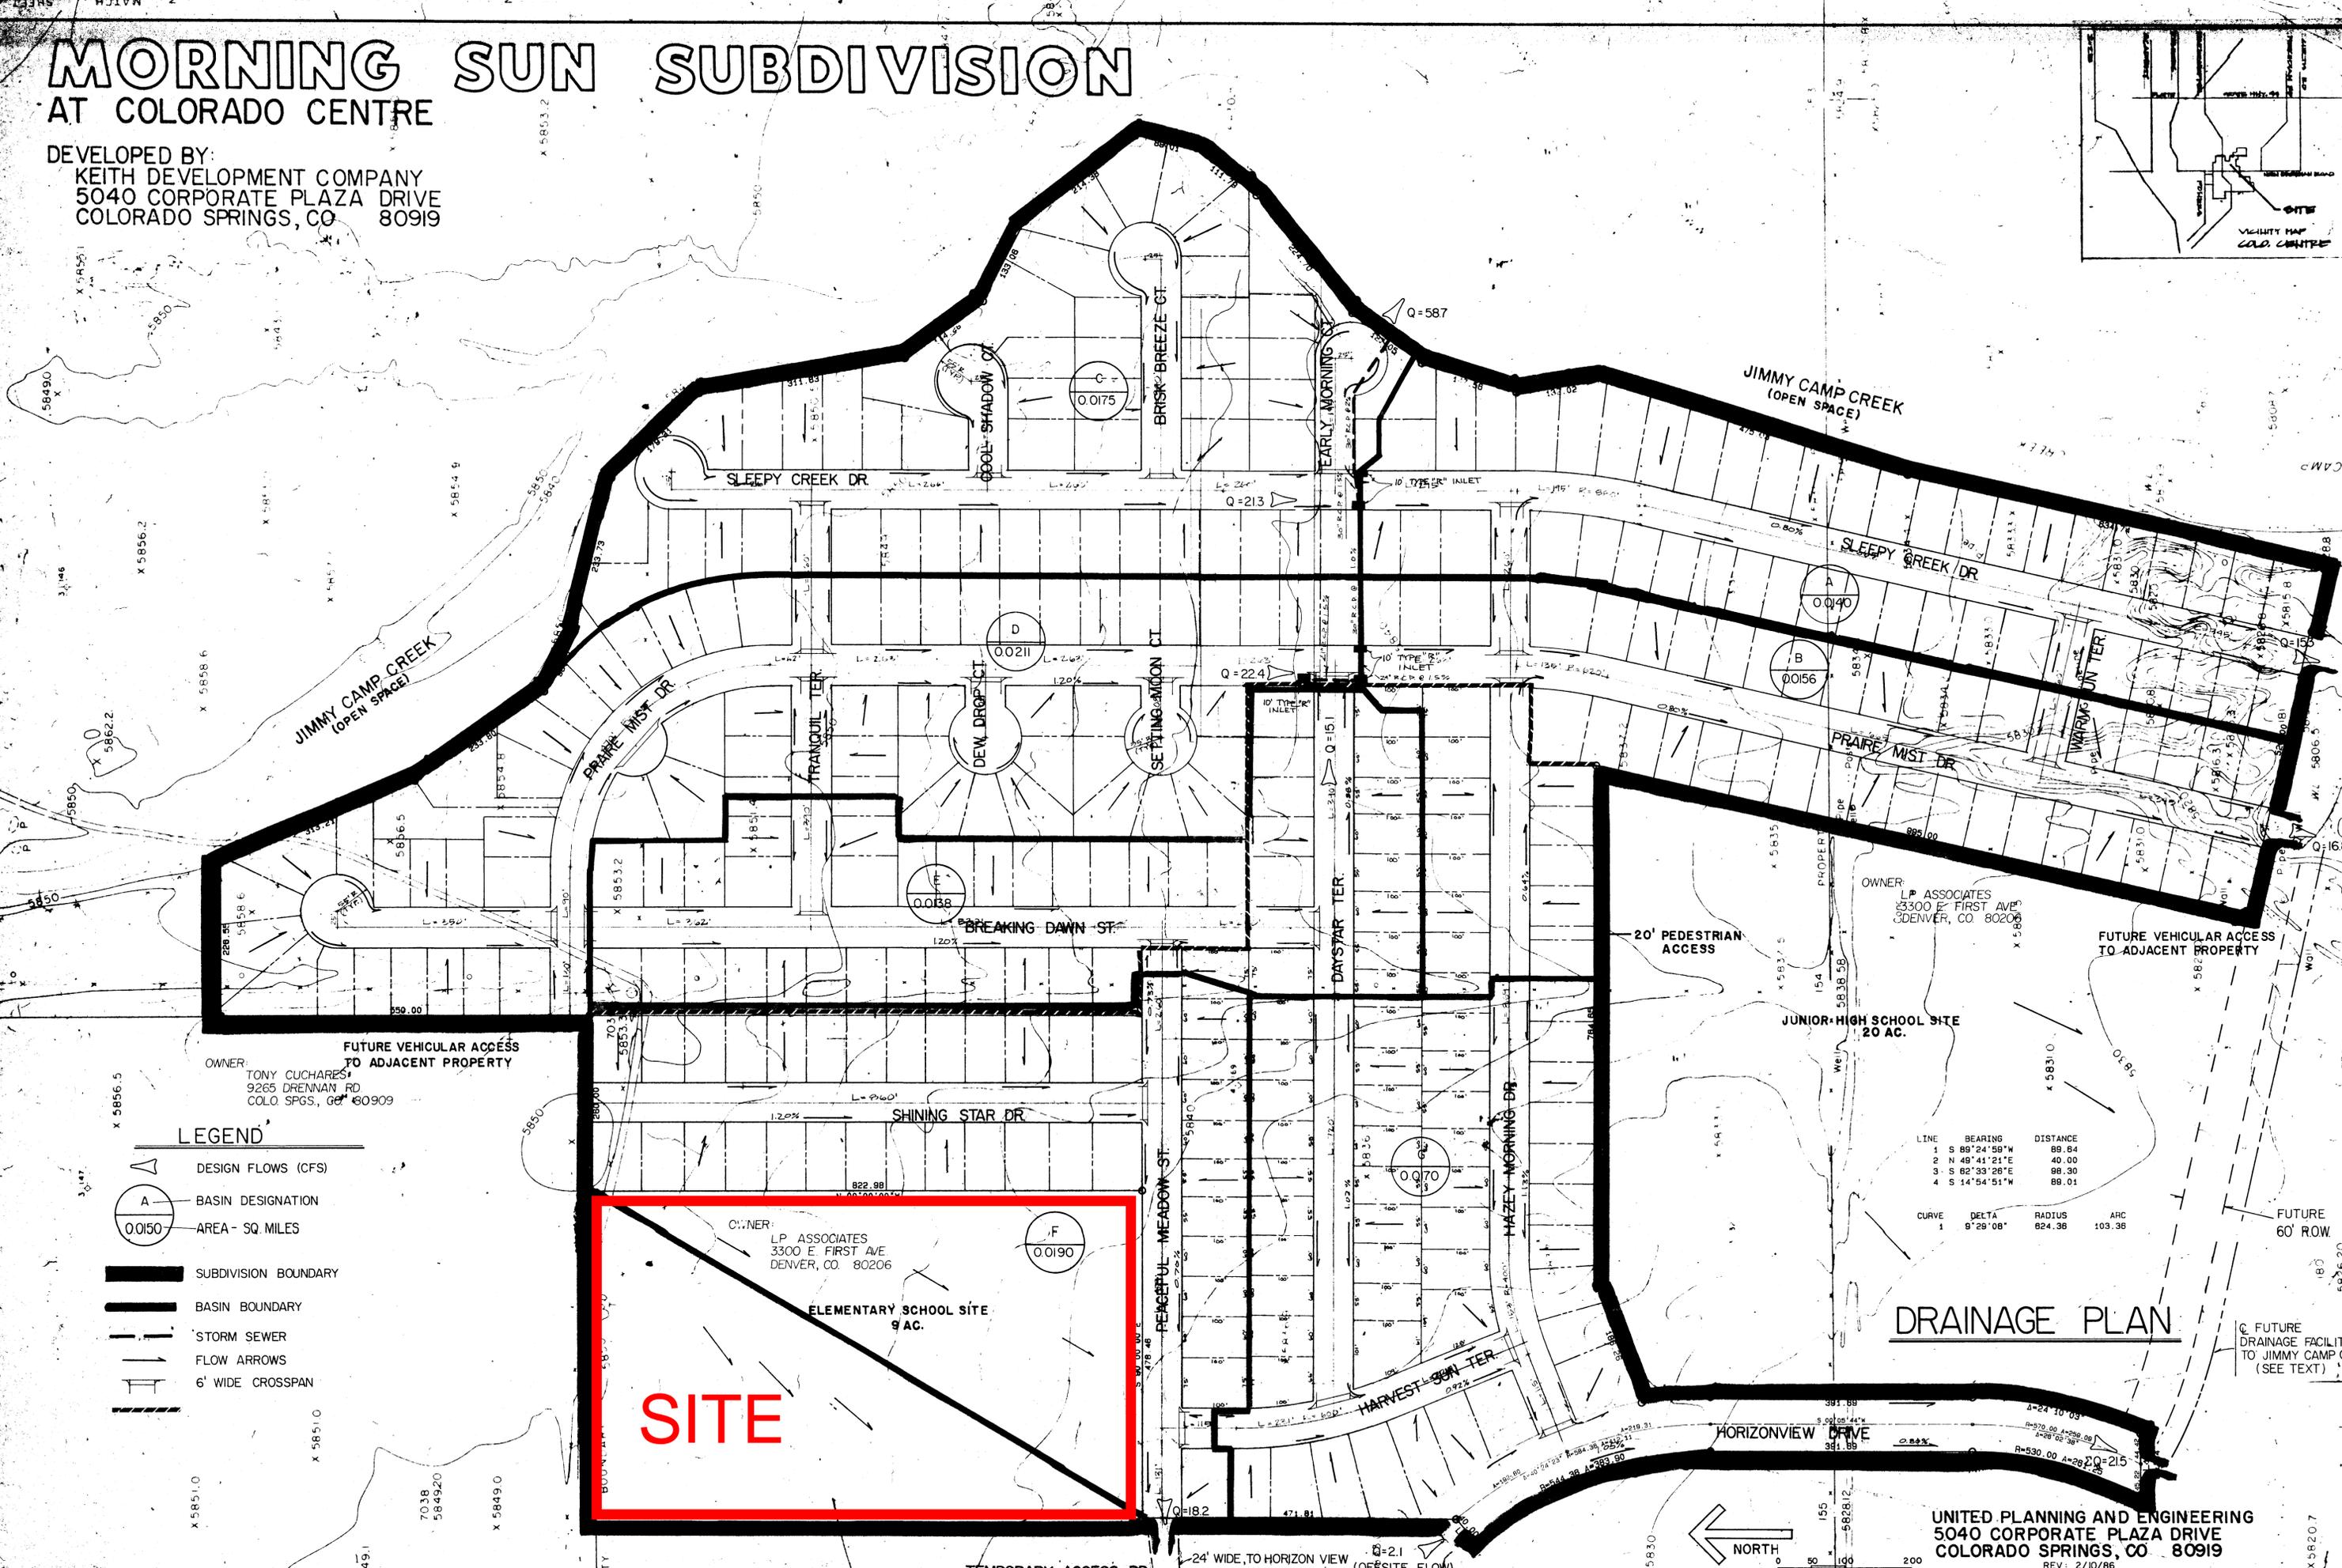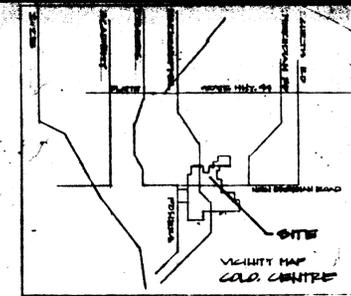

OWNER:  
TONY CUCHARST  
9265 DRENNAN RD  
COLO. SPGS., CO 80909

FUTURE VEHICULAR ACCESS  
TO ADJACENT PROPERTY

OWNER:  
LP ASSOCIATES  
3300 E. FIRST AVE  
DENVER, CO. 80206

JUNIOR-HIGH SCHOOL SITE  
20 AC.

## LEGEND

- DESIGN FLOWS (CFS)
- BASIN DESIGNATION
- AREA - SQ. MILES
- SUBDIVISION BOUNDARY
- BASIN BOUNDARY
- STORM SEWER
- FLOW ARROWS
- 6' WIDE CROSSSPAN


LINE	BEARING	DISTANCE
1	S 89°24'59"W	89.84
2	N 49°41'21"E	40.00
3	S 82°33'26"E	98.30
4	S 14°54'51"W	89.01

CURVE	DELTA	RADIUS	ARC
1	9°29'08"	624.36	103.36

## DRAINAGE PLAN

**SITE**



UNITED PLANNING AND ENGINEERING  
5040 CORPORATE PLAZA DRIVE  
COLORADO SPRINGS, CO 80919  
REV: 2/10/86  
DATE: 10/15/85

TEMPORARY ACCESS RD. 24' WIDE, TO HORIZON VIEW (OFFSITE FLOW) Q=2.1


SCALE: 1"=100'

JOB NO. DATE: 10/15/85 G.D.D.



**EXISTING CONDITIONS**

**DRAINAGE MAP**

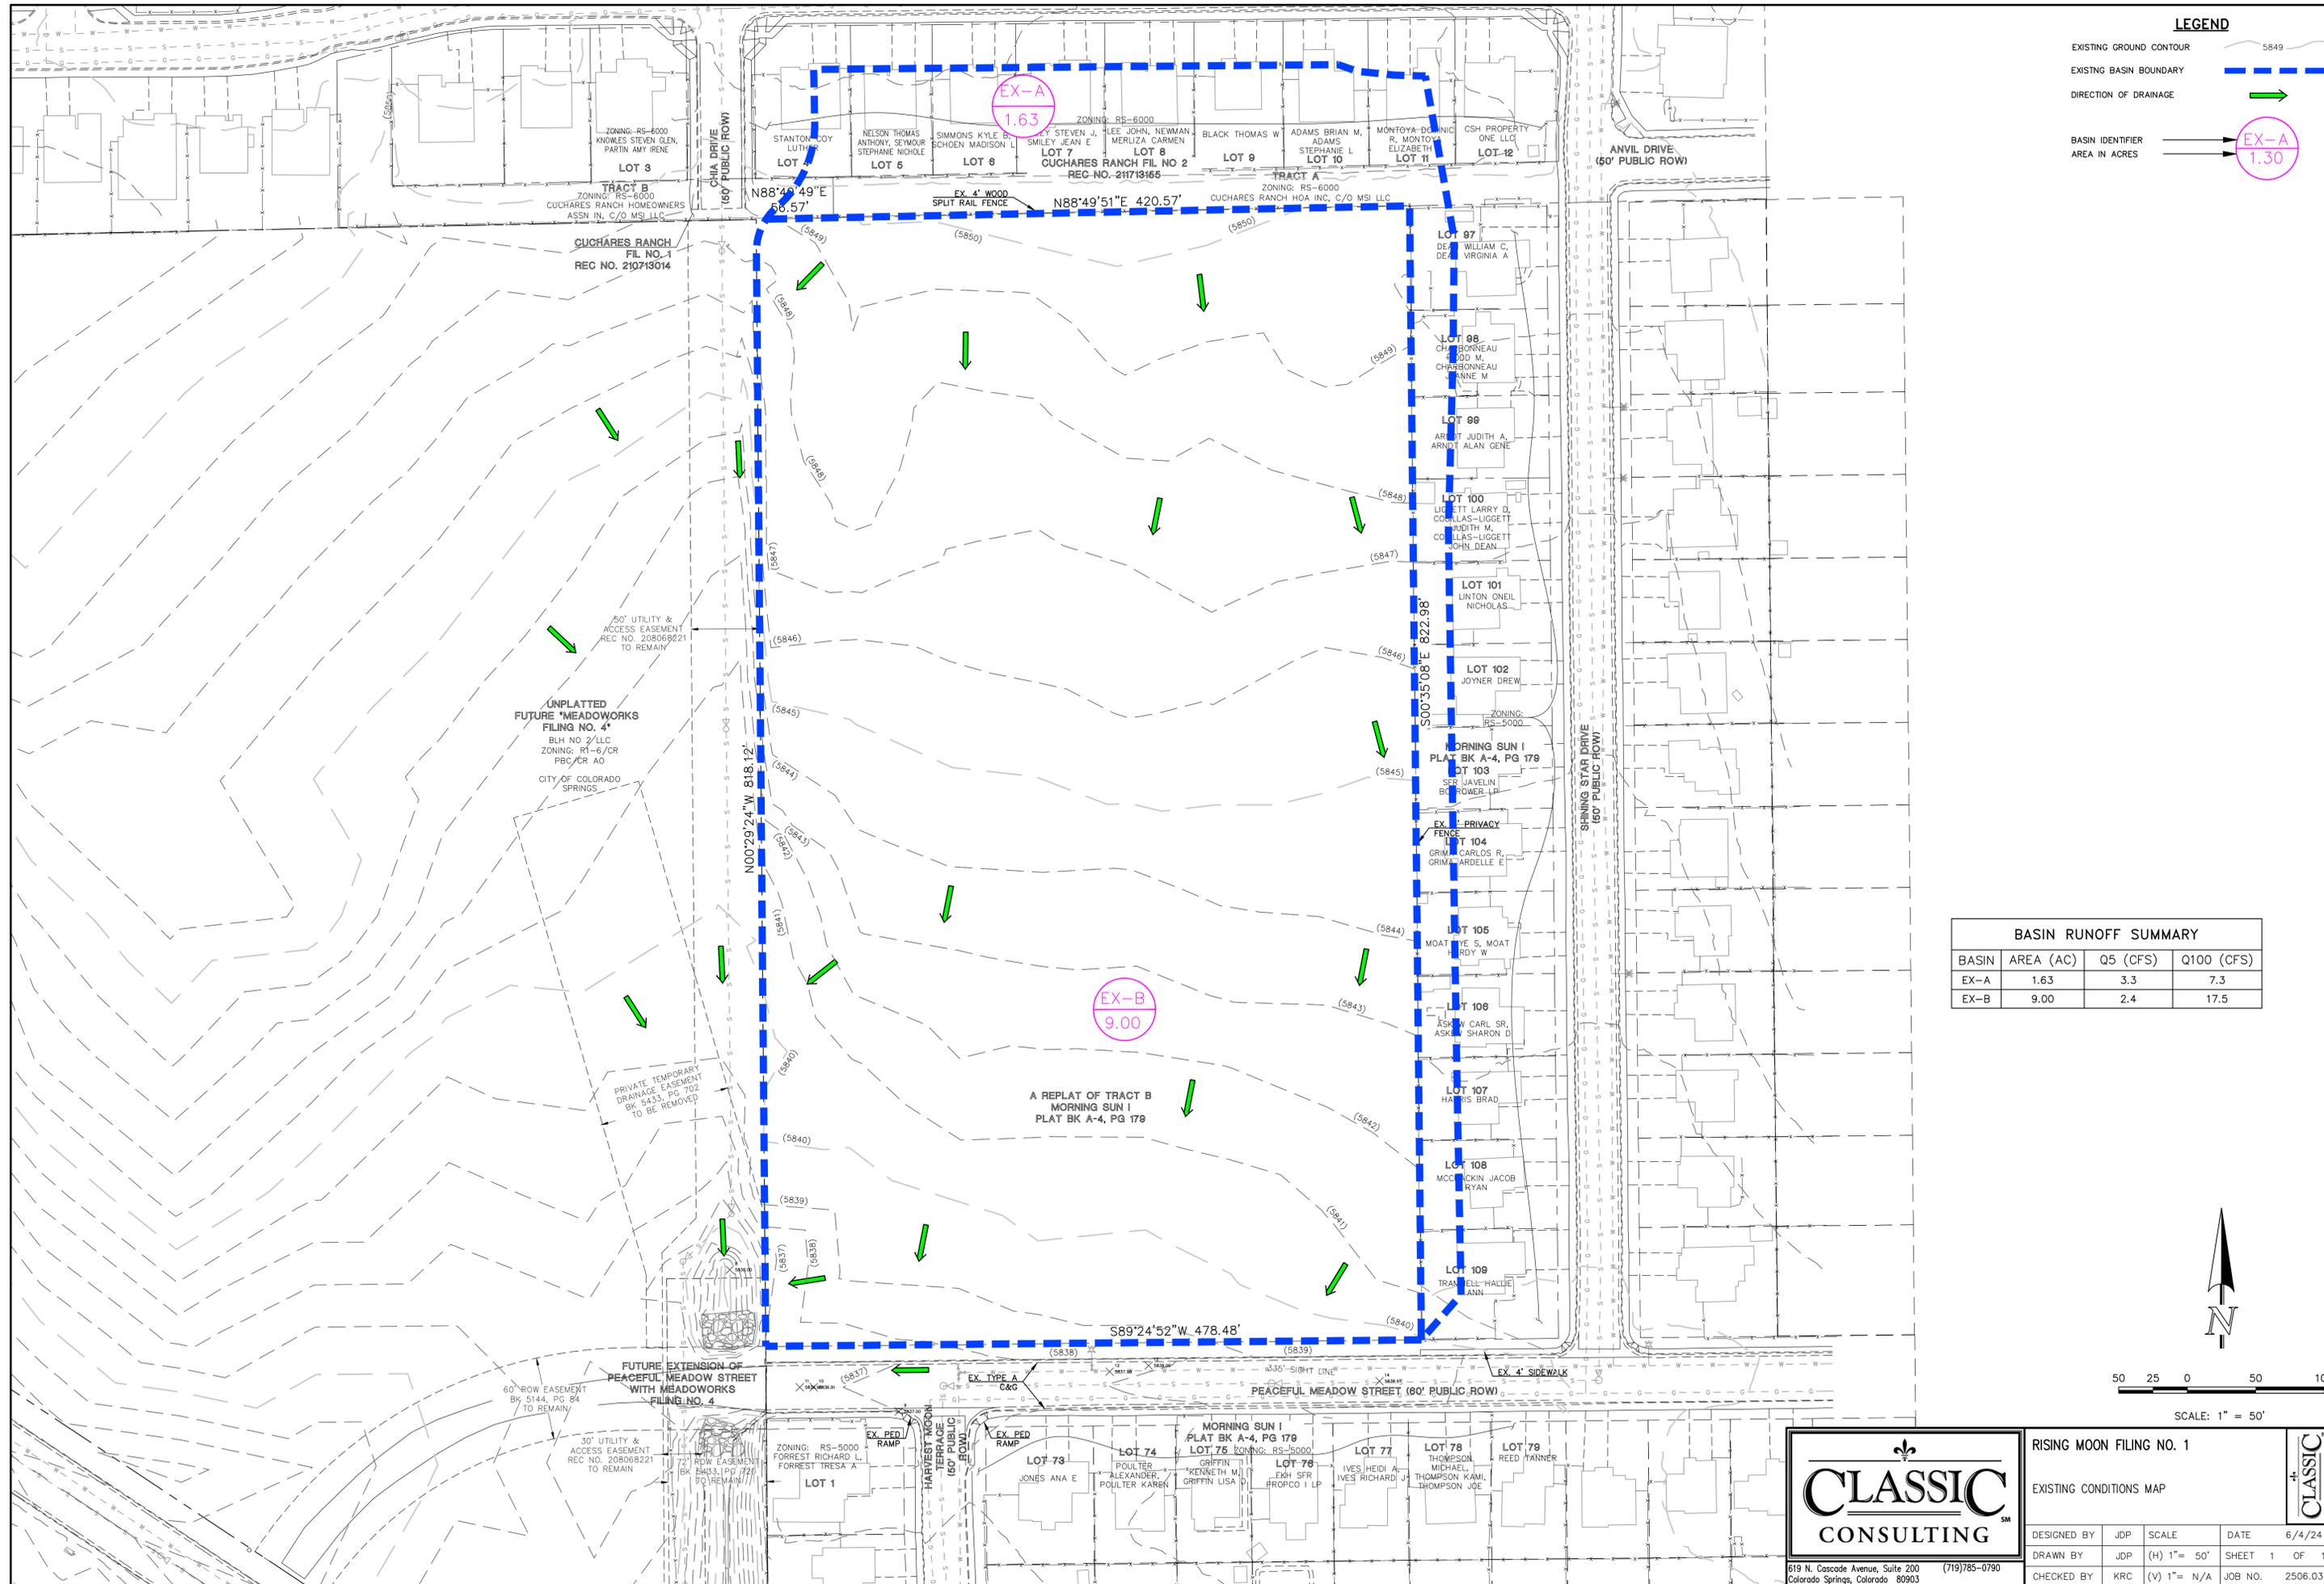

**LEGEND**

- EXISTING GROUND CONTOUR 5849
- EXISTING BASIN BOUNDARY ---
- DIRECTION OF DRAINAGE →
- BASIN IDENTIFIER EX-A
- AREA IN ACRES 1.30

BASIN RUNOFF SUMMARY			
BASIN	AREA (AC)	Q5 (CFS)	Q100 (CFS)
EX-A	1.63	3.3	7.3
EX-B	9.00	2.4	17.5



SCALE: 1" = 50'



**RISING MOON FILING NO. 1**

EXISTING CONDITIONS MAP

DESIGNED BY	JDP	SCALE	DATE	6/4/24
DRAWN BY	JDP	(H) 1" = 50'	SHEET	1 OF 1
CHECKED BY	KRC	(V) 1" = N/A	JOB NO.	2506.03

619 N. Cascade Avenue, Suite 200  
 Colorado Springs, Colorado 80903  
 (719) 785-0790

N:\250603\DRAWINGS\DRAINAGE\MAPS\250603-PREDWG PRINTED BY: MLARSON 6/04/24 @ 3:16 PM LAST SAVED BY: MLARSON

**PROPOSED CONDITIONS**

**DRAINAGE MAP**

**LEGEND**

- EXISTING GROUND CONTOUR 5910
- PROPOSED CONTOUR 5910
- PROPERTY LINE/LOT LINE ---
- PROPOSED BASIN BOUNDARY ---
- EXISTING DIRECTION OF DRAINAGE →
- PROPOSED DIRECTION OF DRAINAGE →
- BASIN IDENTIFIER A
- AREA IN ACRES 1.30

BASIN RUNOFF SUMMARY			
BASIN	AREA (AC)	Q5 (CFS)	Q100 (CFS)
A	10.31	17.6	40.5




SCALE: 1" = 50'



RISING MOON FILING NO. 1			
PROPOSED CONDITIONS MAP			
DESIGNED BY	JDP	SCALE	DATE 6/4/24
DRAWN BY	JDP	(H) 1" = 50'	SHEET 1 OF 1
CHECKED BY	KRC	(V) 1" = N/A	JOB NO. 2506.03

619 N. Cascade Avenue, Suite 200 (719)785-0790  
 Colorado Springs, Colorado 80903

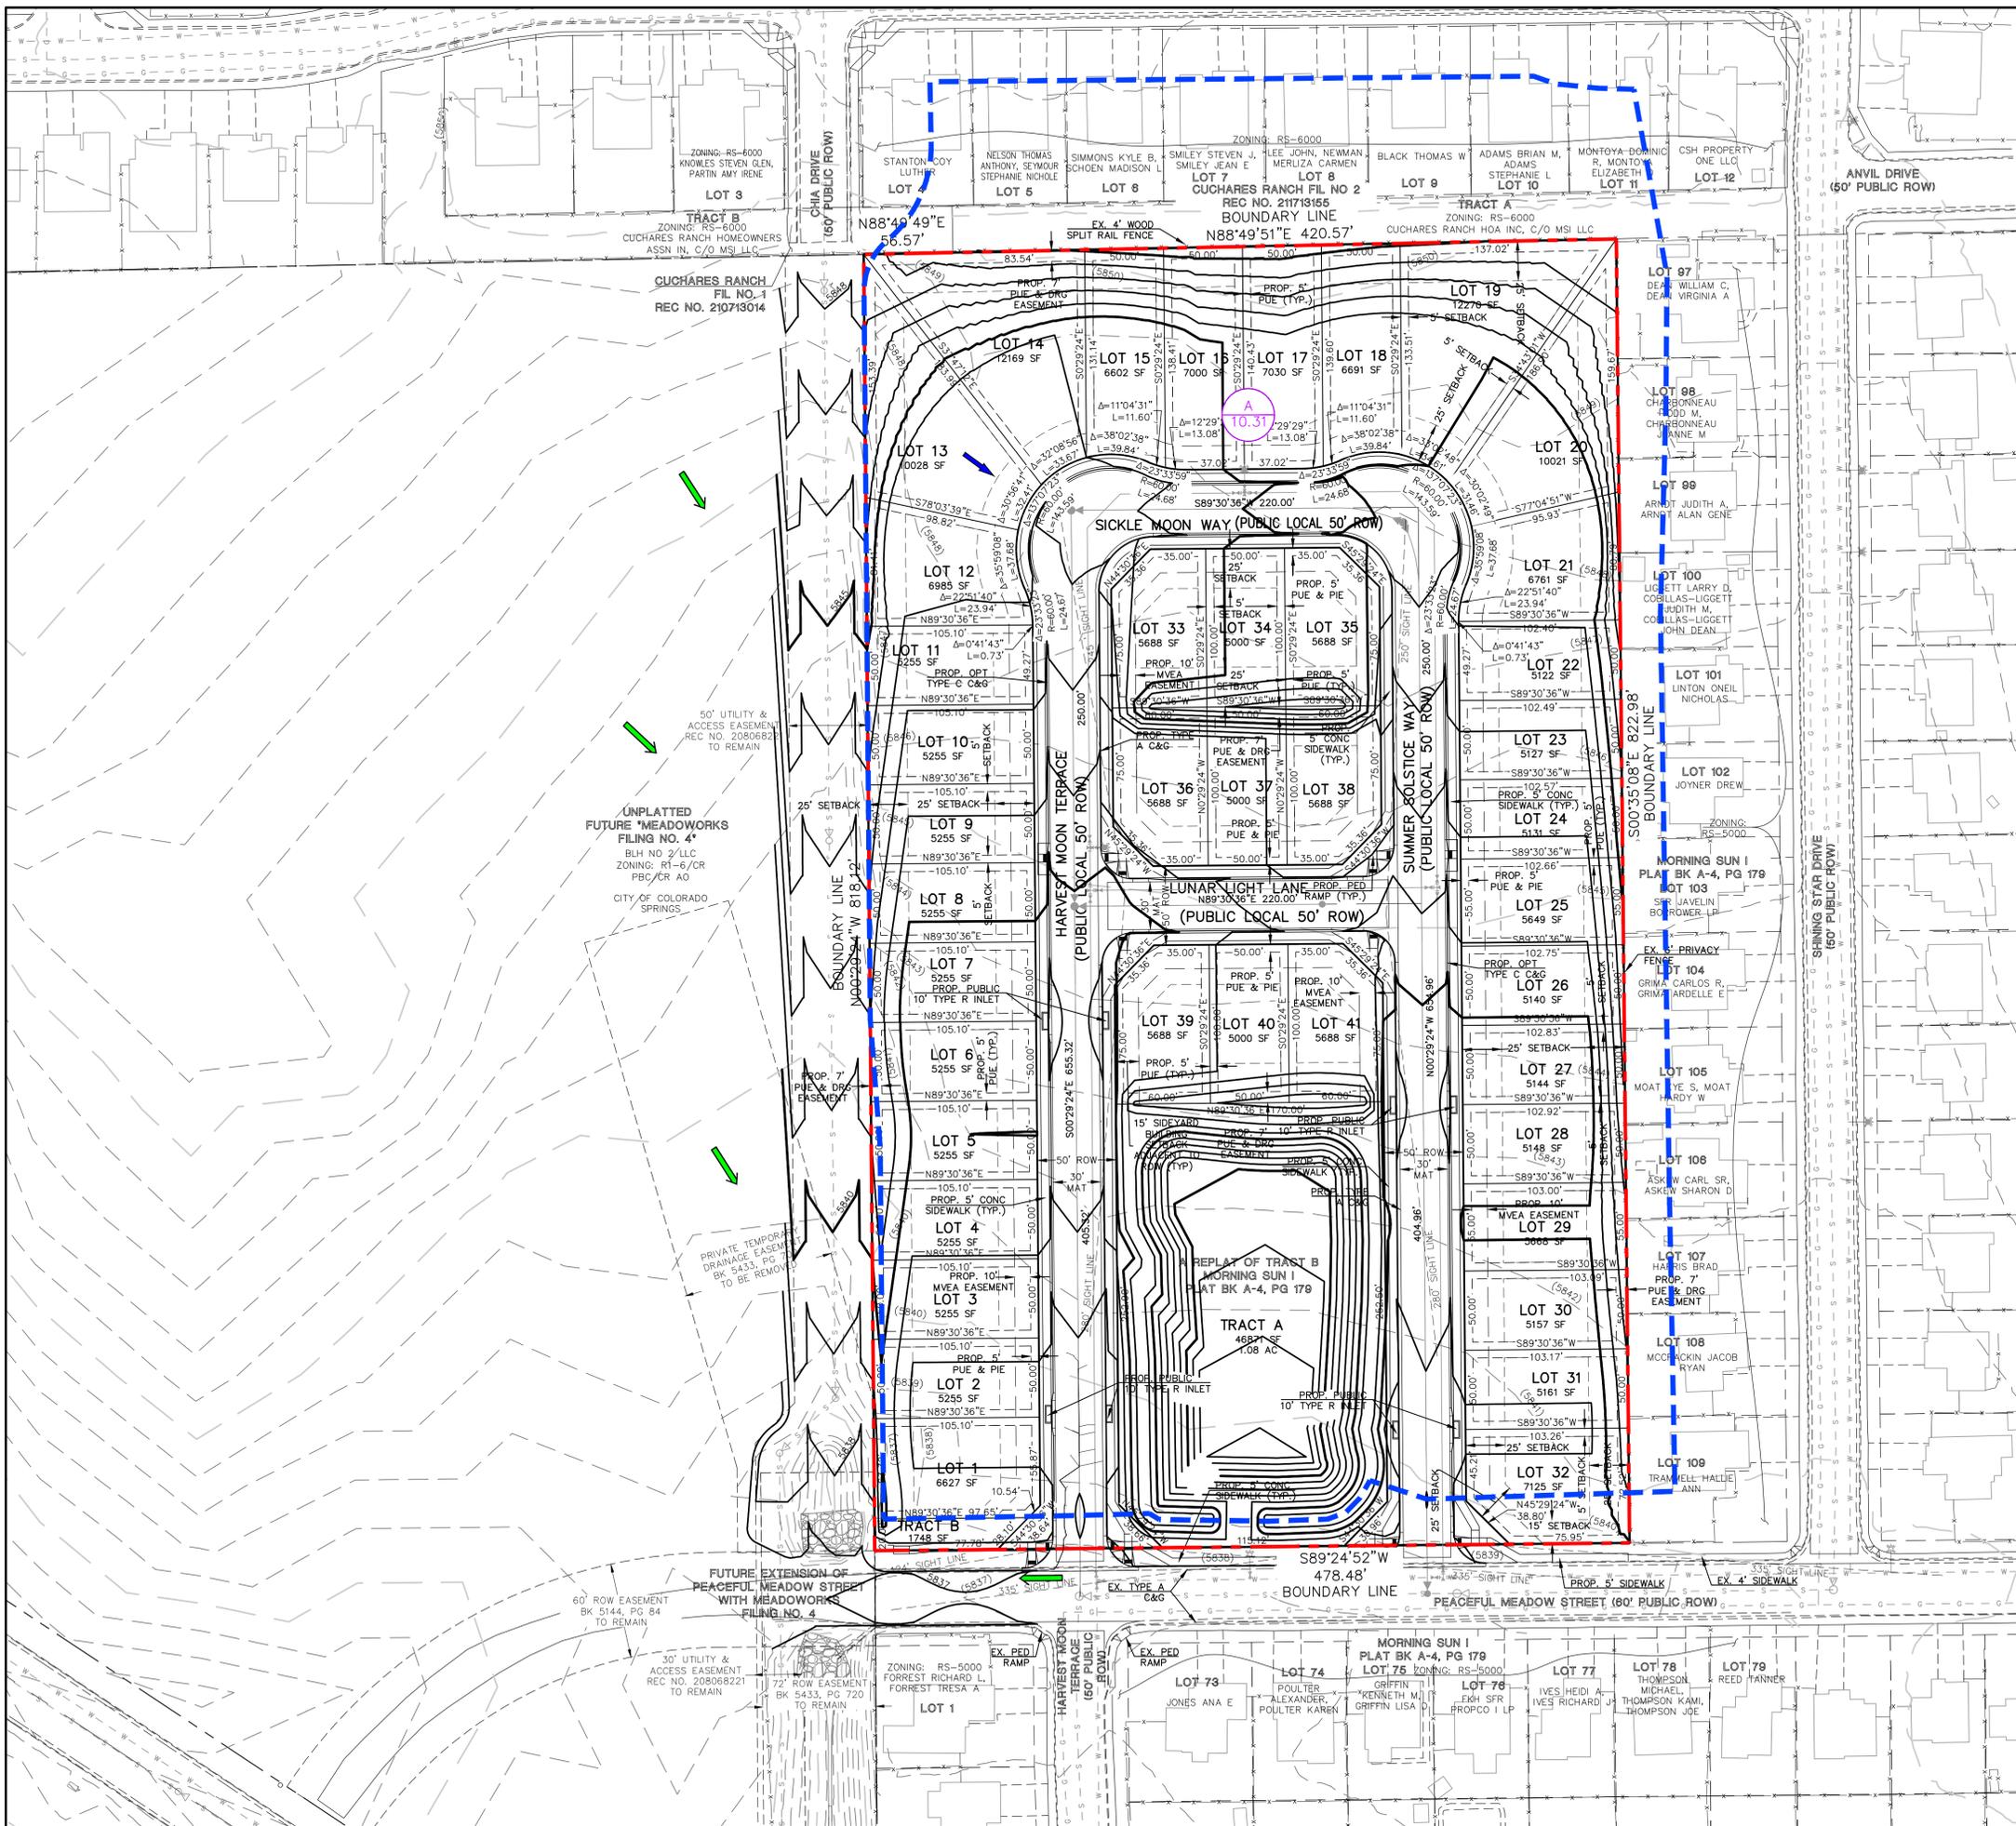

N:\250603\DRAWINGS\DRAINAGE MAPS\250603-POST.DWG PRINTED BY: MLARSON 6/04/24 @ 3:19 PM LAST SAVED BY: MLARSON