



# MDDP AMENDMENT & FINAL DRAINAGE REPORT

REPORT CHANGED BACK TO FDR ONLY,  
AS MDDP AND DBPS AMENDMENT WILL  
FOLLOW UP AS A SEPARATE  
DOCUMENT

## MERIDIAN ROAD & BENT GRASS MEADOWS DRIVE

El Paso County, Colorado

### GALLOWAY RESPONSE

PREPARED FOR:  
**Challenger Communities, LLC**  
8605 Explorer Dr., Suite 250  
Colorado Springs, CO 80920

PREPARED BY:  
**Galloway & Company, Inc.**  
1155 Kelly Johnson Blvd., Suite 305  
Colorado Springs, CO 80920

DATE:  
**March 2020**  
Revised: July 2020

#### Engineering Review

08/19/2020 3:54:33 PM

*dsdrice*

JeffRice@elpasoco.com

(719) 520-7877

**EPC Planning & Community  
Development Department**

Also see comment letter.



### **ENGINEER'S STATEMENT**

*The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the Drainage Criteria Manual for the City of Colorado Springs and El Paso County. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.*



**SIGNATURE & SEAL ADDED**

---

Charlene Durham, PE 36727  
For and on behalf of Galloway & Company, Inc.

---

Date

### **DEVELOPER'S CERTIFICATION**

*I, the developer, have read and will comply with all of the requirements specified in this drainage report and plan.*



**SIGNATURE ADDED**

By: \_\_\_\_\_

---

Date

Address: Challenger Communities, LLC  
8605 Explorer Dr., Suite 250  
Colorado Springs, CO 80920

### **EL PASO COUNTY**

*Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.*

---

Jennifer Irvine, P.E.  
County Engineer/ECM Administrator

---

Date

Conditions:

## TABLE OF CONTENTS

I.	Purpose .....	1
II.	General Description .....	1
III.	Previous Reports .....	1
IV.	Drainage Criteria .....	2
V.	Existing Drainage Conditions .....	2
VI.	Four Step Process .....	4
	1. Employ Runoff Reduction Practices .....	4
	2. Implement BMPs That Provide a Water Quality Capture Volume with Slow Release .....	4
	3. Stabilize Drainageways.....	5
	4. Implement Site Specific and Other Source Control BMPs.....	5
VII.	Proposed Drainage Conditions.....	5
VIII.	Proposed Channel Improvements .....	6
IX.	Proposed Water Quality .....	7
X.	Maintenance .....	7
XI.	Wetlands Mitigation.....	7
XII.	Floodplain Statement .....	7
XIII.	Drainage/Bridge Fees and Credits/Reimbursements .....	7
XIV.	Conclusion .....	8
XV.	References .....	8

### Appendices:

- A. Exhibits and Figures
- B. Hydrologic Computations
- C. Hydraulic Computations
- D. Drainage Map

## I. Purpose

The intent of the developer is to make improvements to the intersection at Meridian Road and Bent Grass Meadows Drive in association with the residential development of the Bent Grass Subdivision. The purpose of this Final Drainage Report (FDR) is to identify drainage patterns, locate and identify tributary or downstream drainage features and facilities that are impacted by the improvements, and to identify which types of drainage facilities will be needed and where they will be located. This report will also serve as an amendment to the approved Master Development and Drainage Plan (MDDP) for Bent Grass Meadows, approved in May 2019. The changes to the MDDP include the analysis of the flow from Meadows Filing 3 subdivision, which is now routed to the east and through the Middle Tributary of the Falcon Basin, as opposed to the West Tributary as previously studied. Drainage calculations, including an update to the HEC-HMS from the approved DBPS has been included as a portion of this report.

## II. General Description

The site is located in the Northwest  $\frac{1}{4}$  and Southwest  $\frac{1}{4}$  of Section 1, Township 13S, Range 65W, of the Sixth Principal Meridian, County of El Paso, State of Colorado. The proposed improvements are located at the intersection of Bent Grass Meadows Drive and Meridian Road, as well as the west side of Meridian Road from Bent Grass Meadows Drive to Owl Place. The proposed improvements include the construction of a right turn lane from Bent Grass Meadows Drive onto Meridian Road as well as a southbound acceleration lane from Bent Grass Meadows Drive to Owl Place. A Vicinity Map is included in Appendix A.

The existing soil type within the proposed site as determined by the NRCS Web Soil Survey for El Paso County Area consists of Columbine gravelly sandy loam which is defined as having a hydrologic soil group of A. See the soils map included in Appendix A.

## III. Previous Reports

The proposed site has been included in multiple drainage studies in the past. The following is a composite list of the existing reports pertaining to this site and adjacent sites.

1. *Falcon Drainage Basin Planning Study*, by Matrix Design Group, September 2015.
2. *Master Development Drainage Plan – Bent Grass Residential Subdivision*, by Galloway & Company, May 2019.
3. *Master Development Drainage Plan and Preliminary Drainage Plan – Bent Grass Subdivision*, by Kiowa Engineering Corporation, December 2006.
4. *Final Drainage and Erosion Control for The Meadows Filing 3 Subdivision*, by LADD Engineering, July 2000.
5. *Final Drainage Report for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2014.
6. *Final Drainage Report Addendum for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2015.
7. *Final Drainage Report for Bent Grass Residential Filing No. 2*, by Galloway & Company, April 2020.

this is this report; delete

LEFT IN THIS REPORT & WILL  
BE DELETED IN SUBSEQUENT  
MDDP/DBPS REPORT



## IV. Drainage Criteria

Hydrology calculations were performed using the City of Colorado Springs/El Paso County Drainage Criteria Manual, as revised in November 1991 and October 1994 with County adopted Chapter 6 and Section 3.2.1 of Chapter 13 of the City of Colorado Springs/El Paso County Drainage Criteria Manual as revised in May 2014.

The drainage calculations were based on the criteria manual Figure 6-5 and IDF equations to determine the intensity, and are listed in Table 1 below.

**Table 1 - Precipitation Data**

Return Period	One Hour Depth (in).	Intensity (in/hr)
5-year	1.50	5.17
100-year	2.52	8.68

The rational method was used to calculate peak flows as the tributary areas are less than 100 acres. The rational method has been proven to be accurate for basins of this size and is based on the following formula:

$$Q = CIA$$

Where:

Q = Peak Discharge (cfs)

C = Runoff Coefficient

I = Runoff intensity (inches/hour)

A = Drainage area (acres)

The runoff coefficients are calculated based on land use, percent imperviousness, and design storm for each basin, as shown in the drainage criteria manual (Table 6-6). Composite percent impervious and C values were calculated using the residential, streets, roofs, and lawns coefficients found in Table 6-6 of the manual.

The 100-year event was used as the major storm event and the 5-year event was used as the minor event.

For the analysis of the existing channel adjacent to Meridian Road and the preliminary design of the proposed channel, Bentley Flowmaster was utilized. Flowmaster was used to evaluate velocity, Froude number, and channel depth. A Manning's n value of 0.035 was utilized for the channel which is appropriate for the existing native grass that comprises the channel section. The proposed channel was designed to have a maximum depth of 5' per the criteria manual and have a maximum velocity of 5 ft/s with a maximum Froude number of 0.6.

## V. Existing Drainage Conditions

A historic basin map has been prepared for this area to analyze the existing basin contributing to the channel. The historic map is included in Appendix D and basins are described below.

FOR CULVERT ANALYSIS AT BGMD  
& MERIDIAN INTERSECTION, ADD'T  
FLOW WENT BACK TO THE 165 CFS.  
MDDP/DBPS WILL FOLLOW UP WITH  
MORE ACCURATE FLOW BASED ON  
ADDITIONAL ANALYSIS

Use the DBPS  
flows

**Design Point 30**

Design Point 30 is located north of basin OS-5, and is comprised of Basins B3 thru B6, A1, and A3 in Meadows Filing No. 3. The FDR for Meadows Filing No. 3 had the flows at this location reported as 91.8 cfs and 226.1 cfs for the 5 and 100-year storms. The Bent Grass Residential Filing No. 1 report updated the flows at this location to 23 cfs and 43 cfs for the minor and major storm events. This report moved forward with the 23 cfs and 43 cfs, as these were the most recent and up to date flows for the area. (An excerpt from the Bent Grass FDR is included in the appendix for the updated flow rates.) Flows will cross under Woodmen Hills Drive via an existing culvert, then sheet flow to the southeast, passing through Basin OS-5 to DP 11.

**Basin OS-5** (14.13 AC,  $Q_5 = 4.9$  cfs,  $Q_{100} = 27.5$  cfs): a basin that is associated with Bent Grass Filing No. 1. Runoff from this basin sheet flows from the North to the South into basin OS-6.

**Basin OS-6** (5.81 AC,  $Q_5 = 1.9$  cfs,  $Q_{100} = 12.7$  cfs): a basin that is associated with Bent Grass Filing No. 1. Runoff from this basin sheet flows from the North to South to an existing sediment pond and then into Bent Grass Meadows Drive. Flows will continue to the east, through existing curb & gutter on the north side of Bent Grass Meadows Drive, to the Meridian Road intersection.

**Design Point 12** ( $Q_5 = 29.7$  cfs,  $Q_{100} = 83.3$  cfs): is the combined flow from off site basins OS-5 and OS-6 with the flow from Design Point 30 in Bent Grass Meadows Filing No. 3. Flows are released into the Bent Grass Meadows Drive, where they travel to the east within the existing curb and gutter.

**Address DP12P?**

The following basins were part of the Final Drainage Report for Bent Grass Residential Filing No. 1.

will be addressed with  
mddp/dbps report

**Basin OS-3** ( $Q_5 = 3$  cfs,  $Q_{100} = 21.8$  cfs): consists of a portion of Woodmen Hills Filing No. 3 and Bent Grass Filing No. 1. It is located between Basins OS-6 and OS-2. Flows will continue in a southeasterly manner towards Bent Grass Meadows Drive.

**Basin OS-2** (4.42 AC,  $Q_5 = 1.4$  cfs,  $Q_{100} = 9.6$  cfs): was represented by a developed off-site basin, in the Bent Grass Filing No. 1 FDR, located between Basins H-3 and OS-3, north of Bent Grass Meadows Drive. Flows will continue to the southeast, releasing into Bent Grass Meadows Drive. Any development of this property in the future will require detention and release at historic rates.

**Basin OS-3** (10.24 AC,  $Q_5 = 3.3$  cfs,  $Q_{100} = 5.6$  cfs): was represented by a developed off-site basin, in the Bent Grass Filing No. 1 FDR, located west of Basin OS-2, north of Bent Grass Meadows Drive. Flows will continue to the southeast, releasing into Bent Grass Meadows Drive. Any development of this property in the future will require detention and release at historic rates.

**Basin C-1** (2.22 AC,  $Q_5 = 7.6$  cfs,  $Q_{100} = 13.6$  cfs): is the north half of Bent Grass Meadows Drive. Flows are captured with the existing curb and gutter and conveyed to the east.

**Design Point 15** ( $Q_5 = 91.3$  cfs,  $Q_{100} = 103.1$  cfs): is the combined flow from Design Point 12 with Basins H-3, OS-2, OS-3 and C-1. These flows all combine within Bent Grass Meadows Drive and conveyed as gutter flow to the east. These flows release via an existing riprap "rundown" to the inlet side of 3-elliptical rcp's running under Bent Grass Meadows Drive.

**Design Point 20** ( $Q_5 = 371.3$  cfs,  $Q_{100} = 953.1$  cfs): is located at the northwest corner of the Bent Grass Meadows Drive and Meridian Road intersection. Flows from DP-15 combine with ditch flow along Meridian Road. From the approved DBPS, the ditch flows are 280 and 850 cfs for the 5 and 100-year storm events. Based on an analysis of the existing channel section and culverts, both facilities are adequately undersized for the DBPS flows. Analysis of these items are provided in the following table.

THESE COMMENTS WILL  
ALL BE ADDRESSED  
WITHIN MDDP/DBPS  
REPORT

**Basin H-1** (2.03 AC,  $Q_5 = 3.2$  cfs,  $Q_{100} = 10.4$  cfs): is located on the western half of Meridian Road and the eastern half of the channel, south of the intersection of Bent Grass Meadows Drive and Meridian Road. Flows are captured with the existing curb and gutter and conveyed to the east.

Parcel 530100009 also needs to detain  
developed and upstream flows if necessary  
due to downstream constraints.

until the downstream  
culvert and channel  
constraints are resolved.

Address here or with DP15 the channel or pipe necessary (size of both options) to convey existing flows outside of Bent Grass Meadows Drive.

Runoff from the basin generally flows to the southwest, into the roadside channel, where it is conveyed south.

20?

**Design Point 25** ( $Q_5 = 374.5\text{ cfs}$ ,  $Q_{100} = 960.4\text{ cfs}$ ): is located at the northwest corner of the Bent Grass Meadows Drive and Meridian Road intersection. Flows from DP-20 combine with flows from Basin H-1. Flows will exit the project at the culverts located at Owl Place.

REVISED DESCRIPTION  
TO STATE IT IS AT THE  
INTERSECTION OF  
BGMD AND OWL PLACE.  
DESIGN POINT 25 IS  
CORRECT.

In the existing conditions, runoff from the basin drains directly into the roadside channel. The channel in this area has a depth of approximately 3 feet. As previously stated, the existing channel is undersized for the flows. The flow rate used for the analysis was taken from the Falcon DBPS. In the DBPS this section of the channel is referred to as RMT064 which has a flow rate of 140 cfs for the 5-year storm and 580 cfs for the 100-year storm in the existing conditions. The Flowmaster calculations, which have been included in Appendix C, show that the existing channel can only convey approximately 260 cfs in its current state. When 580 cfs is analyzed in the existing channel it produces a depth of approximately 4 feet, exceeding the channel depth by 1 foot. Relevant excerpts from the DBPS are included in Appendix A.

There are also three existing 45" x 29" elliptical RCP's that run beneath Bent Grass Meadows Drive that were analyzed with this report. The Federal Highway Administration's HY-8 program was used to analyze the culvert and design the proposed culverts in the future conditions. The calculations included in Appendix C show that the existing culverts can convey approximately 143 cfs before flow begins to overtop Bent Grass Meadows Drive. All of the included calculations show that the culverts and channel are clearly vastly undersized and will need to be improved by El Paso County in the future to properly convey the flows outlined in the DBPS.

## VI. Four Step Process

The Four Step Process is used to minimize the adverse impacts of urbanization and is a vital component of developing a balanced, sustainable project. Below identifies the approach to the four-step process:

### 1. Employ Runoff Reduction Practices

The proposed roadway improvements use Low Impact Development (LID) practices to reduce runoff at the source. All runoff is routed through the pervious areas in the channel to promote infiltration.

### 2. Implement BMPs That Provide a Water Quality Capture Volume with Slow Release

This step utilizes formalized water quality capture volume to slow the release of runoff from the site. There is no water quality being proposed with the associated roadway improvements. Per Section 1.7.1.B of the El Paso County *Stormwater Quality Policy & Procedures*, since the site is less than 1 acre, is not a sensitive or high-risk site, and does not directly discharge into State Waters, it is excluded from any water quality requirements.

Currently, the existing roadside ditch, ultimately conveys runoff to the existing detention and water quality pond MN, as shown and discussed in the Falcon DBPS. The Falcon DBPS also shows a future detention and water quality pond SR-4 that is to receive flows from basin MT060 and discharge into basin MT070 ultimately routing to existing Pond MN. Flows from Bent Grass Meadows Drive are listed in basin MT060 but are being routed to the existing roadside ditch along Meridian Road, which is in Basin MT070. The flows from the "School Site" and upstream basins will release into the east

side of Pond SR-4 (west of Falcon Market Place). Pond SR-4 is currently under construction. The proposed improvements impact on the existing drainage basin and both Pond MN and Pond SR-4 are discussed later in the report.

### 3. Stabilize Drainageways

This step implements stabilization to the channel to accommodate developed flows while protecting infrastructure and controlling sediment loading from erosion in the drainageways. Erosion protection in the form of riprap pads at all outfall points to the channel to prevent scouring of the channel from point discharges.

A stability analysis on the existing roadside ditch along Meridian road was conducted with results shown in Appendix C. From the analysis, it was determined that the existing ditch is not in stable condition with existing DBPS flows. Improvements are anticipated to be made in the future, per recommendations from the Falcon DBPS, when additional land is obtained to expand the ROW along the southbound portion of Meridian Road.

In the interim condition, it has been proposed to add a temporary lining to the existing channel to handle the excess velocities and depth associated with the DBPS flows. This analysis has been included in the Appendix.

and Bent Grass development re-routed flows

statement added

### 4. Implement Site Specific and Other Source Control BMPs

Since this project only includes roadway work with no curb and gutter, the potential use of source control BMP's is limited. All runoff however, will be conveyed through native grass buffers and a native grass channel to promote infiltration and pollutant removal.

Provide developed flows

will be addressed with mddp/dbps report

#### Drainage Conditions

Is this proposed to be a permanent detention basin?

Design Point 30 and Basins OS-5 and OS-6 are as described under Existing Drainage Conditions. However, Basins OS-5 and OS-6 now route through an existing sedimentation pond, on previously referred to as the "School Site", north of Bent Grass Meadows Drive and just west of Grass Filing No. 2. The existing pond only has an overflow weir to release flows. Based on the DBPS spreadsheet, the release rates are 0 cfs and 4.2 cfs for the 5 and 100-year flows. The UDF spreadsheet has been included in the appendix. (Note spreadsheet only has outlet information for larger storm events, as currently, pond only has a weir outlet to release flows.) Flows from Design Point 30 will be released directly to Bent Grass Meadows Drive.

no-only meant to be a temporary item until that lot develops. adding wording to elaborate on this.

revise per DBPS flows.

flows revised

Basins H-3, OS-2, OS-3 and C-1 all remain as described in the Existing Drainage Conditions. With flows from OS-5 and OS-6 reduced the flows for **Design Point 15** have been reduced to 13.8 cfs for the 5-year storm and 65.7 cfs for the 100-year storm. A street capacity analysis was performed for Bent Grass Meadows Drive. The flows shown will adequately be conveyed within the curb and gutter until released into the existing ditch at Meridian Road.

**Basin P-1** (2.03 AC,  $Q_5 = 4.2$  cfs,  $Q_{100} = 8.7$  cfs): is associated with the western half of Meridian Road and the eastern half of the channel, south of Bent Grass Meadows Drive, in the proposed development. Runoff from the basin generally flows to the southwest, into the roadside channel, where it is released south.

will be addressed with mddp/dbps report

Provide options for a long-term solution -- the channel or pipe necessary (size of both options) to convey developed flows outside of Bent Grass Meadows Drive. If water rights allow for retention of flows, describe. State what the allowable capacity of Bent Grass Meadows Drive curb and gutter is along the north side (no overtopping unless it can be shown that flows won't enter the subdivision to the south).

How did flows go  
down?

**Design Point 20** ( $Q_5 = 293.8$  cfs,  $Q_{100} = 915.7$  cfs): is located at the northwest corner of the Bent Grass Meadows Drive and Meridian Road intersection. Flows from [redacted] along Meridian Road. From the approved DBPS, the ditch flows [redacted] 100-year storm events. In addition to roadway improvements along [redacted] x 29" Elliptical pipes are proposed to be constructed under Bent [redacted] the additional off-site flow of 65.7 cfs.

flows updated. Will be finalized with MDDP/DBPS report

revise per DBPS flows RMT062

In the proposed conditions the historic drainage pattern will be maintained with runoff draining from Meridian Road and Bent Grass Meadows Drive directly into the roadside channel. In order to adequately determine the increase in runoff from the proposed improvements, the proposed basin, P-1, encompasses the same area as the historic basin, H-1. Basin H-1 is 48.4% impervious with peak runoff of 3.2 cfs and 7.3 cfs in the 5-year and 100-year storm events, respectively. Basin P-1 is 64.2% impervious with peak runoff of 4.2 cfs and 8.7 cfs in the 5-year and 100-year storm events, respectively. The 1.0 cfs increase in the 5-year event and the 1.4 cfs increase in the 100-year event produced by the proposed improvements will have minimal impact on any downstream properties or infrastructure.

A proposed basin map has been prepared for this area. The proposed map is included in Appendix D.

## VIII. Proposed Channel Improvements

Although the existing channel and culverts are undersized and improvements will need to be made in the future, minimal channel improvements are being proposed at this time. With the construction of the right turn lane on Bent Grass Meadows Drive, the three RCP culverts will be extended approximately 15' to span the extended width of the roadway. Additionally, two more 45"x29" Elliptical RCP pipes will be installed under Bent Grass Meadows Drive to convey the flows for DP 20. The existing channel will need to be lined with a temporary turf reinforcement mat (TRM) due to the excessive velocities (9.91 fps), high shear stress (5.11 lbs/ft<sup>2</sup>) & high Froude Number (1.12). With the TRM added to the channel sides, the allowable velocity is 25 fps and permissible shear stress is 12 lbs/ft<sup>2</sup>. An analysis of the channel with the TRM is provided in the Appendix.

Verify capacity for the total diverted flows.

In the future, El Paso County will need to improve [redacted] the flow outlined in the DBPS. These necessary [redacted] are described further below. A preliminary grading exhibit has [redacted] s and included in Appendix C.

"offsite" items will be addressed with MDDP/DBPS report. Statement has been added to this report stating as such.

Similar to the existing channel, Bentley Flowmaster was also used to design the future proposed channel section. The future channel was designed to have a maximum depth of 5' per the criteria manual and have a maximum velocity of 5 ft/s with a maximum Froude number of 0.6. The flow rate used for the design, 925 cfs, was taken from the Falcon DBPS flow combined with the additional off-site drainage coming from the "School Site" and

The future channel section was designed as trapezoidal shape with a 15' bottom width, 4:1 side slopes, and 0.3% longitudinal slope. The total depth of the channel will be 6', providing 1' of freeboard for the 5' of water depth. The velocity of the proposed channel is 4.93 ft/s.

The Federal Highway Administration [redacted] will run beneath Bent Grass Meadows Drive [redacted] to adequately convey the flows [redacted] d to design the future culverts that [redacted] in Appendix C show that in order [redacted] concrete box culverts will need to [redacted]

"offsite" & future items will be addressed with MDDP/DBPS report. Statement has been added to this report stating as such.

How many drop structures and what height will be required to obtain this slope? (~12 ft total => 1 ft per 100 ft between BGMD and Owl Place?)



replace the existing elliptical RCP's. In order to c flattened from downstream to create roughly 5' of

"offsite" & future items will be addressed with MDDP/DBPS report. Statement has been added to this report stating as such.

d to be

## IX. Proposed Water Quality

There is no water quality being proposed with the associated roadway improvements. Per Section 1.7.1.B of the El Paso County *Stormwater Quality Policy & Procedures*, since the site is less than 1 acre, is not a sensitive or high-risk site, and does not directly discharge into State Waters, it is excluded from any water quality requirements.

Though the site does not include the addition of any proposed water quality or detention ponds, future Pond SR-4 and existing Pond MN from the Falcon DBPS will receive flows from the improved site. The HEC-HMS has been updated and is included in Appendix B. As discussed previously, the "School Site" have been added as an additional Basin MT060a, which is routed to the regional detention facility SR-4. Basin MT070, described in the Falcon DBPS, was analyzed to include within Basin MT070 and the effects it has on existing Pond MN.

Previous flows have been used until MDDP/DBPS report

how?

From the analysis, Pond SR-4's 100-yr. receiving flows decreased from 1,000 cfs to 952.3 cfs. Based on the increase in impervious area, Basin MT070's Curve Number increased from 67 to 68. Subsequently, the 100-yr. receiving flows entering existing Pond MN decreased to 825.8 cfs from 850 cfs.

Release rates for SR-4 are 24.3 cfs for the 2-year storm and 696.4 cfs for the 100-year storm. Falcon DBPS has 2-year storm listed as 27 cfs and 100-year storm as 730 cfs. This gives a decrease of 2.7 cfs and 33.6 cfs for the 2 and 100-year events respectively.

Pond MN release rates 30.5 for the 2-year storm and 799.4 cfs for the 100-year storm. The DBPS has release rates listed as 32 cfs for the 2-year storm and 820 cfs for the 100-year storm. This gives a decrease of 1.5 cfs and 20.6 cfs for the 2 and 100-year events respectively.

## X. Maintenance

The proposed channel will be a public facility. After completion of construction and upon the Board of County Commissioners acceptance the channel will be owned and maintained by El Paso County along with all drainage facilities within the public Right-of-Way.

## XI. Wetlands Mitigation

No wetlands are located on site.

## XII. Floodplain Statement

According to the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map number 08041C0553G, effective December 7, 2018, there is no floodplain in the project area. A copy of the FIRM Panel is included in Appendix A.

## XIII. Drainage/Bridge Fees and

will be addressed with MDDP/DBPS report. Statement has been added to this report stating as such.

Since there is no land being platted with this development, drainage and bridge fees are not required.

Address re-routing of RMT062 flows to the Meridian Road channel RMT064, approximate additional DBPS costs for that channel and the ultimate Bent Grass and Owl Place culverts and re-allocation of the RMT062 costs to those three items.

and drainage facilities for  
flows diverted along Bent  
Grass Meadows Drive

#### XIV. Conclusion

This report for the proposed roadway improvements Drive and Owl Place, has been prepared using the County Drainage Criteria Manual. Although the road to the roadside channel, there will be minimal impact on the downstream infrastructure. The channel was analyzed in the existing conditions and determined to be undersized. Although the channel improvements will not be made with this development, recommendations are made within this report for the future conditions of the channel. The channel will ultimately be publicly owned and maintained and shall be the responsibility of El Paso County.

did not add here as it will be  
addressed with MDDP/DBPS report.  
Statement will be incorporated with  
that report.

Meridian Road added

#### XV. References

1. *City of Colorado Springs/County of El Paso Drainage Criteria Manual*, October 1991.
2. *Drainage Criteria Manual, Volume 2*, City of Colorado Springs, November 2002.
3. *Urban Storm Drainage Criteria Manual*, Urban Drainage and Flood Control District, January 2016 (with current revisions).
4. *Falcon Drainage Basin Planning Study*, by Matrix Design Group, September 2015.
5. *Master Development Drainage Plan and Preliminary Drainage Plan – Bent Grass Subdivision*, by Kiowa Engineering Corporation, December 2006.
6. *Final Drainage Report for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2014.
7. *Final Drainage Report Addendum for Bent Grass Residential (Filing No. 1)*, by Classic Consulting Engineers & Surveyors, LLC, August 2015.

# **APPENDIX A**

## **Exhibits and Figures**





## MERIDIAN ROAD IMPROVEMENTS

MERIDIAN RD & BENT GRASS MEADOWS DR

SCALE: 1" = 1,000'

VICINITY MAP

Project No: CLH000015.20

Drawn By: BHB

Checked By: SMB


Date: NOVEMBER 2019

**Galloway**

1755 Telstar Drive, Suite 107  
Colorado Springs, CO 80920  
719.900.7220 • [GallowayUS.com](http://GallowayUS.com)




# Hydrologic Soil Group—El Paso County Area, Colorado (Meridian Road Improvements)

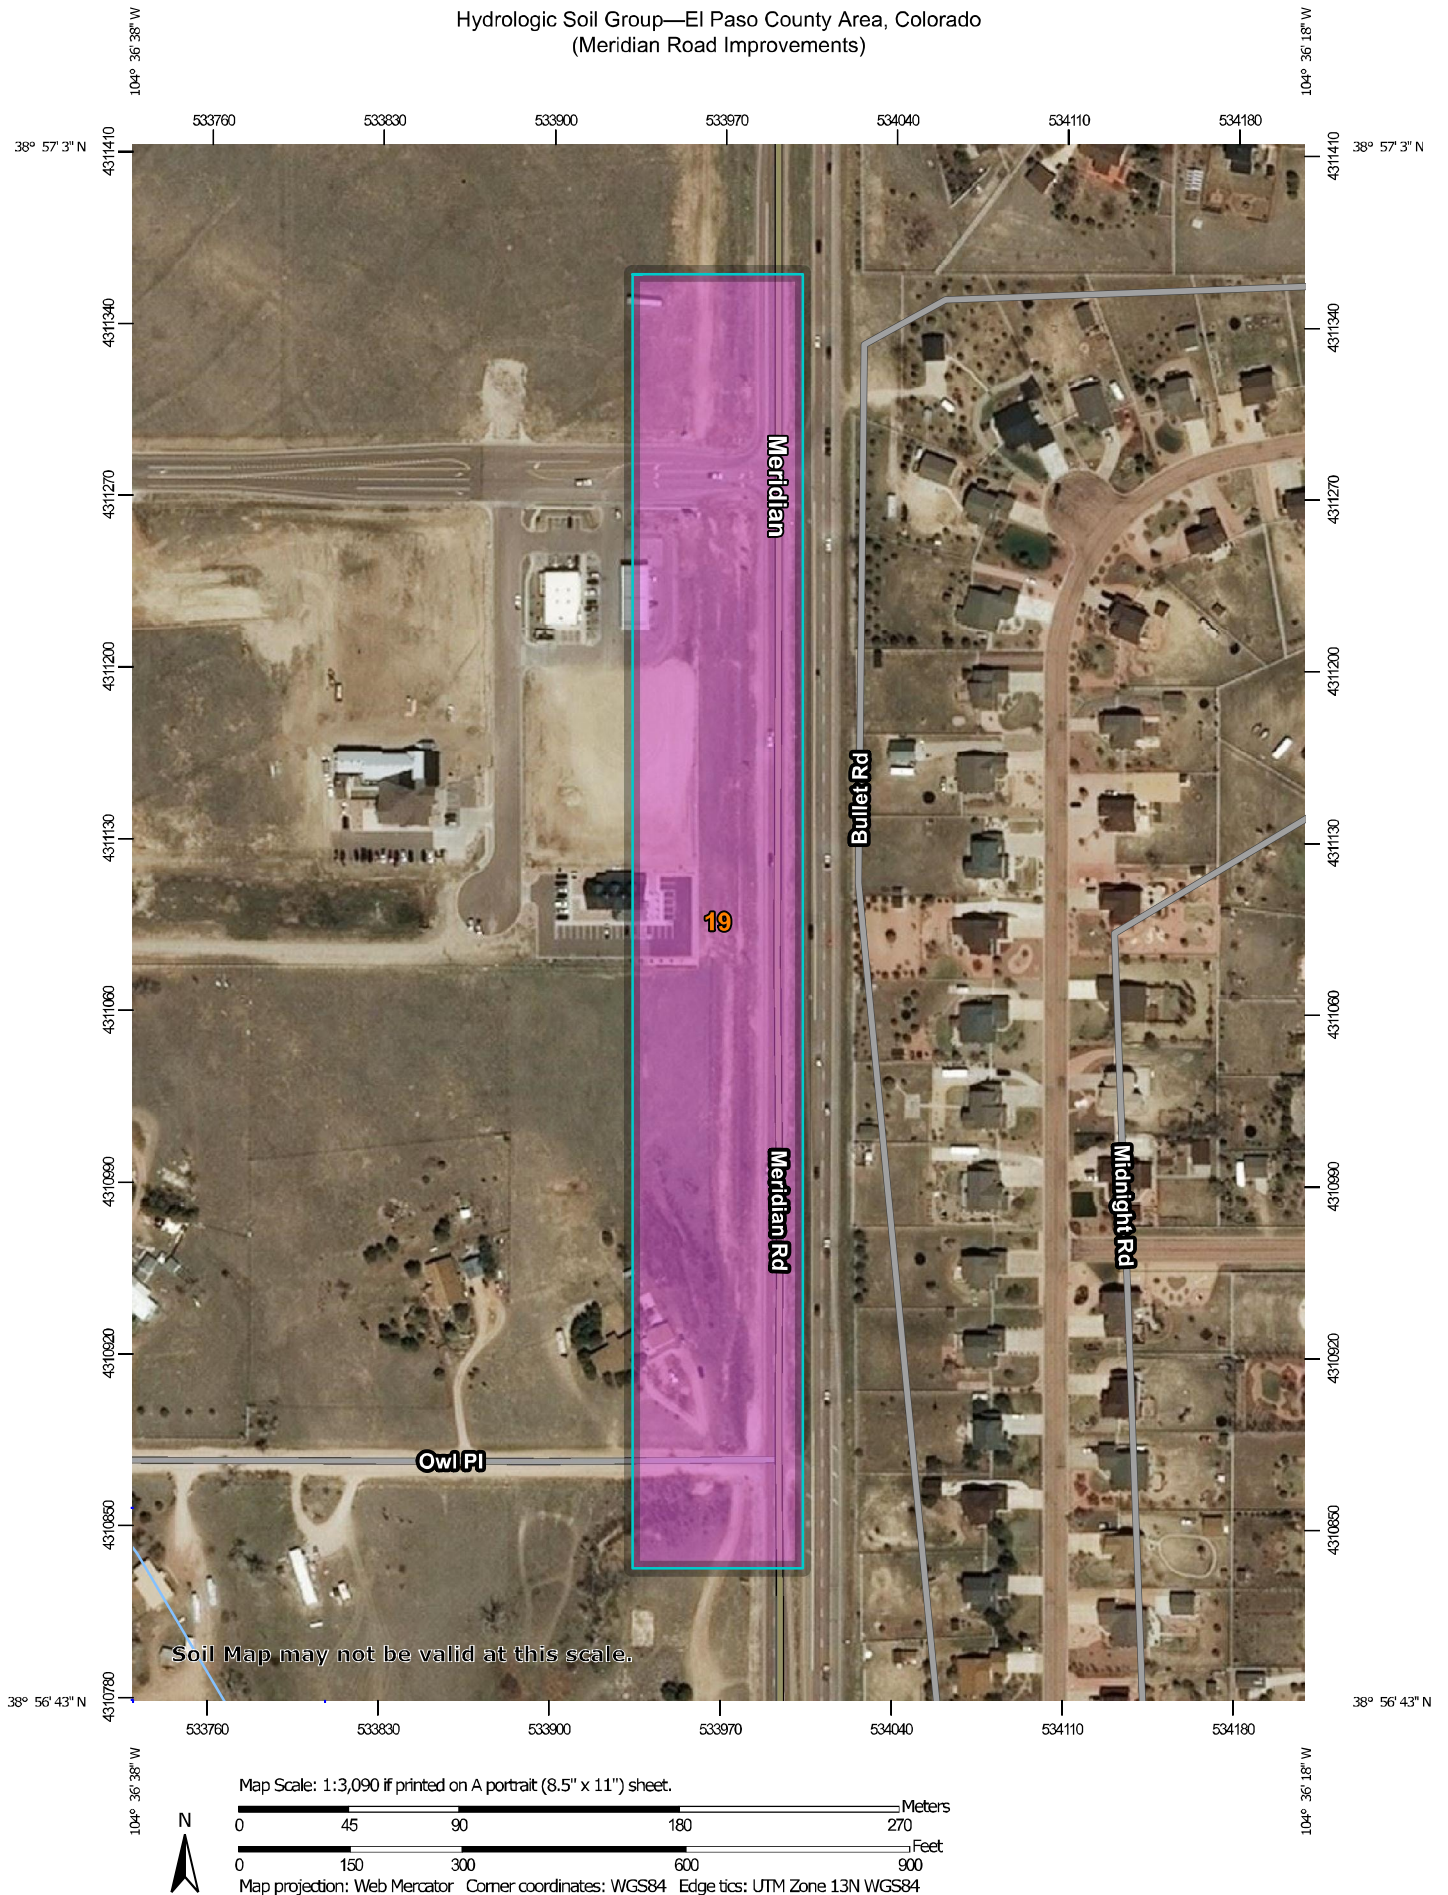

Hydrologic Soil Group—El Paso County Area, Colorado  
(Meridian Road Improvements)

## MAP LEGEND

### Area of Interest (AOI)









 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons





 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines

 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points






 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 17, Sep 13, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 8, 2018—May 26, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
19	Columbine gravelly sandy loam, 0 to 3 percent slopes	A	9.1	100.0%
<b>Totals for Area of Interest</b>			<b>9.1</b>	<b>100.0%</b>

## Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff: None Specified*

*Tie-break Rule: Higher*



**NOTES TO USERS**

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The **community map repository** should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

**Coastal Base Flood Elevations** shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services  
NOAA, NNGS12  
National Geodetic Survey  
SSMC-3, #9202  
1315 East-West Highway  
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

**Base Map** information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

**Corporate limits** shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.


Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FIMIX) 1-877-338-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.


If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call **1-877-FEMA MAP** (1-877-338-2627) or visit the FEMA website at <http://www.fema.gov/business/nfip>.

El Paso County Vertical Datum Offset Table	
Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


**Panel Location Map**

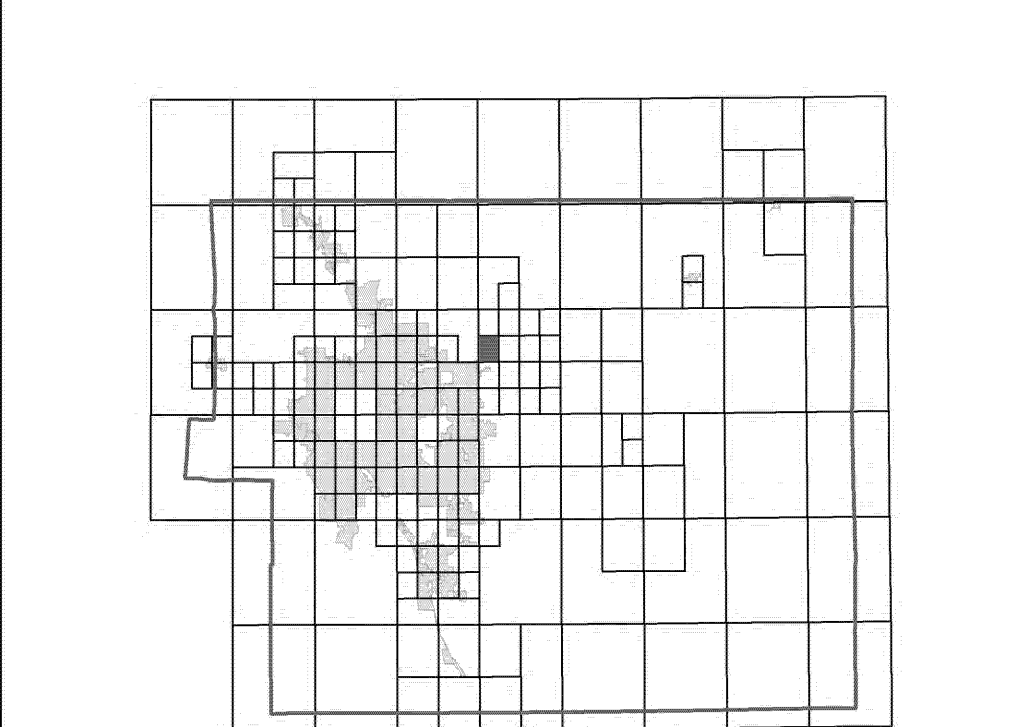

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).

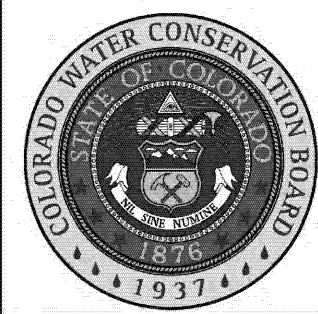

Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

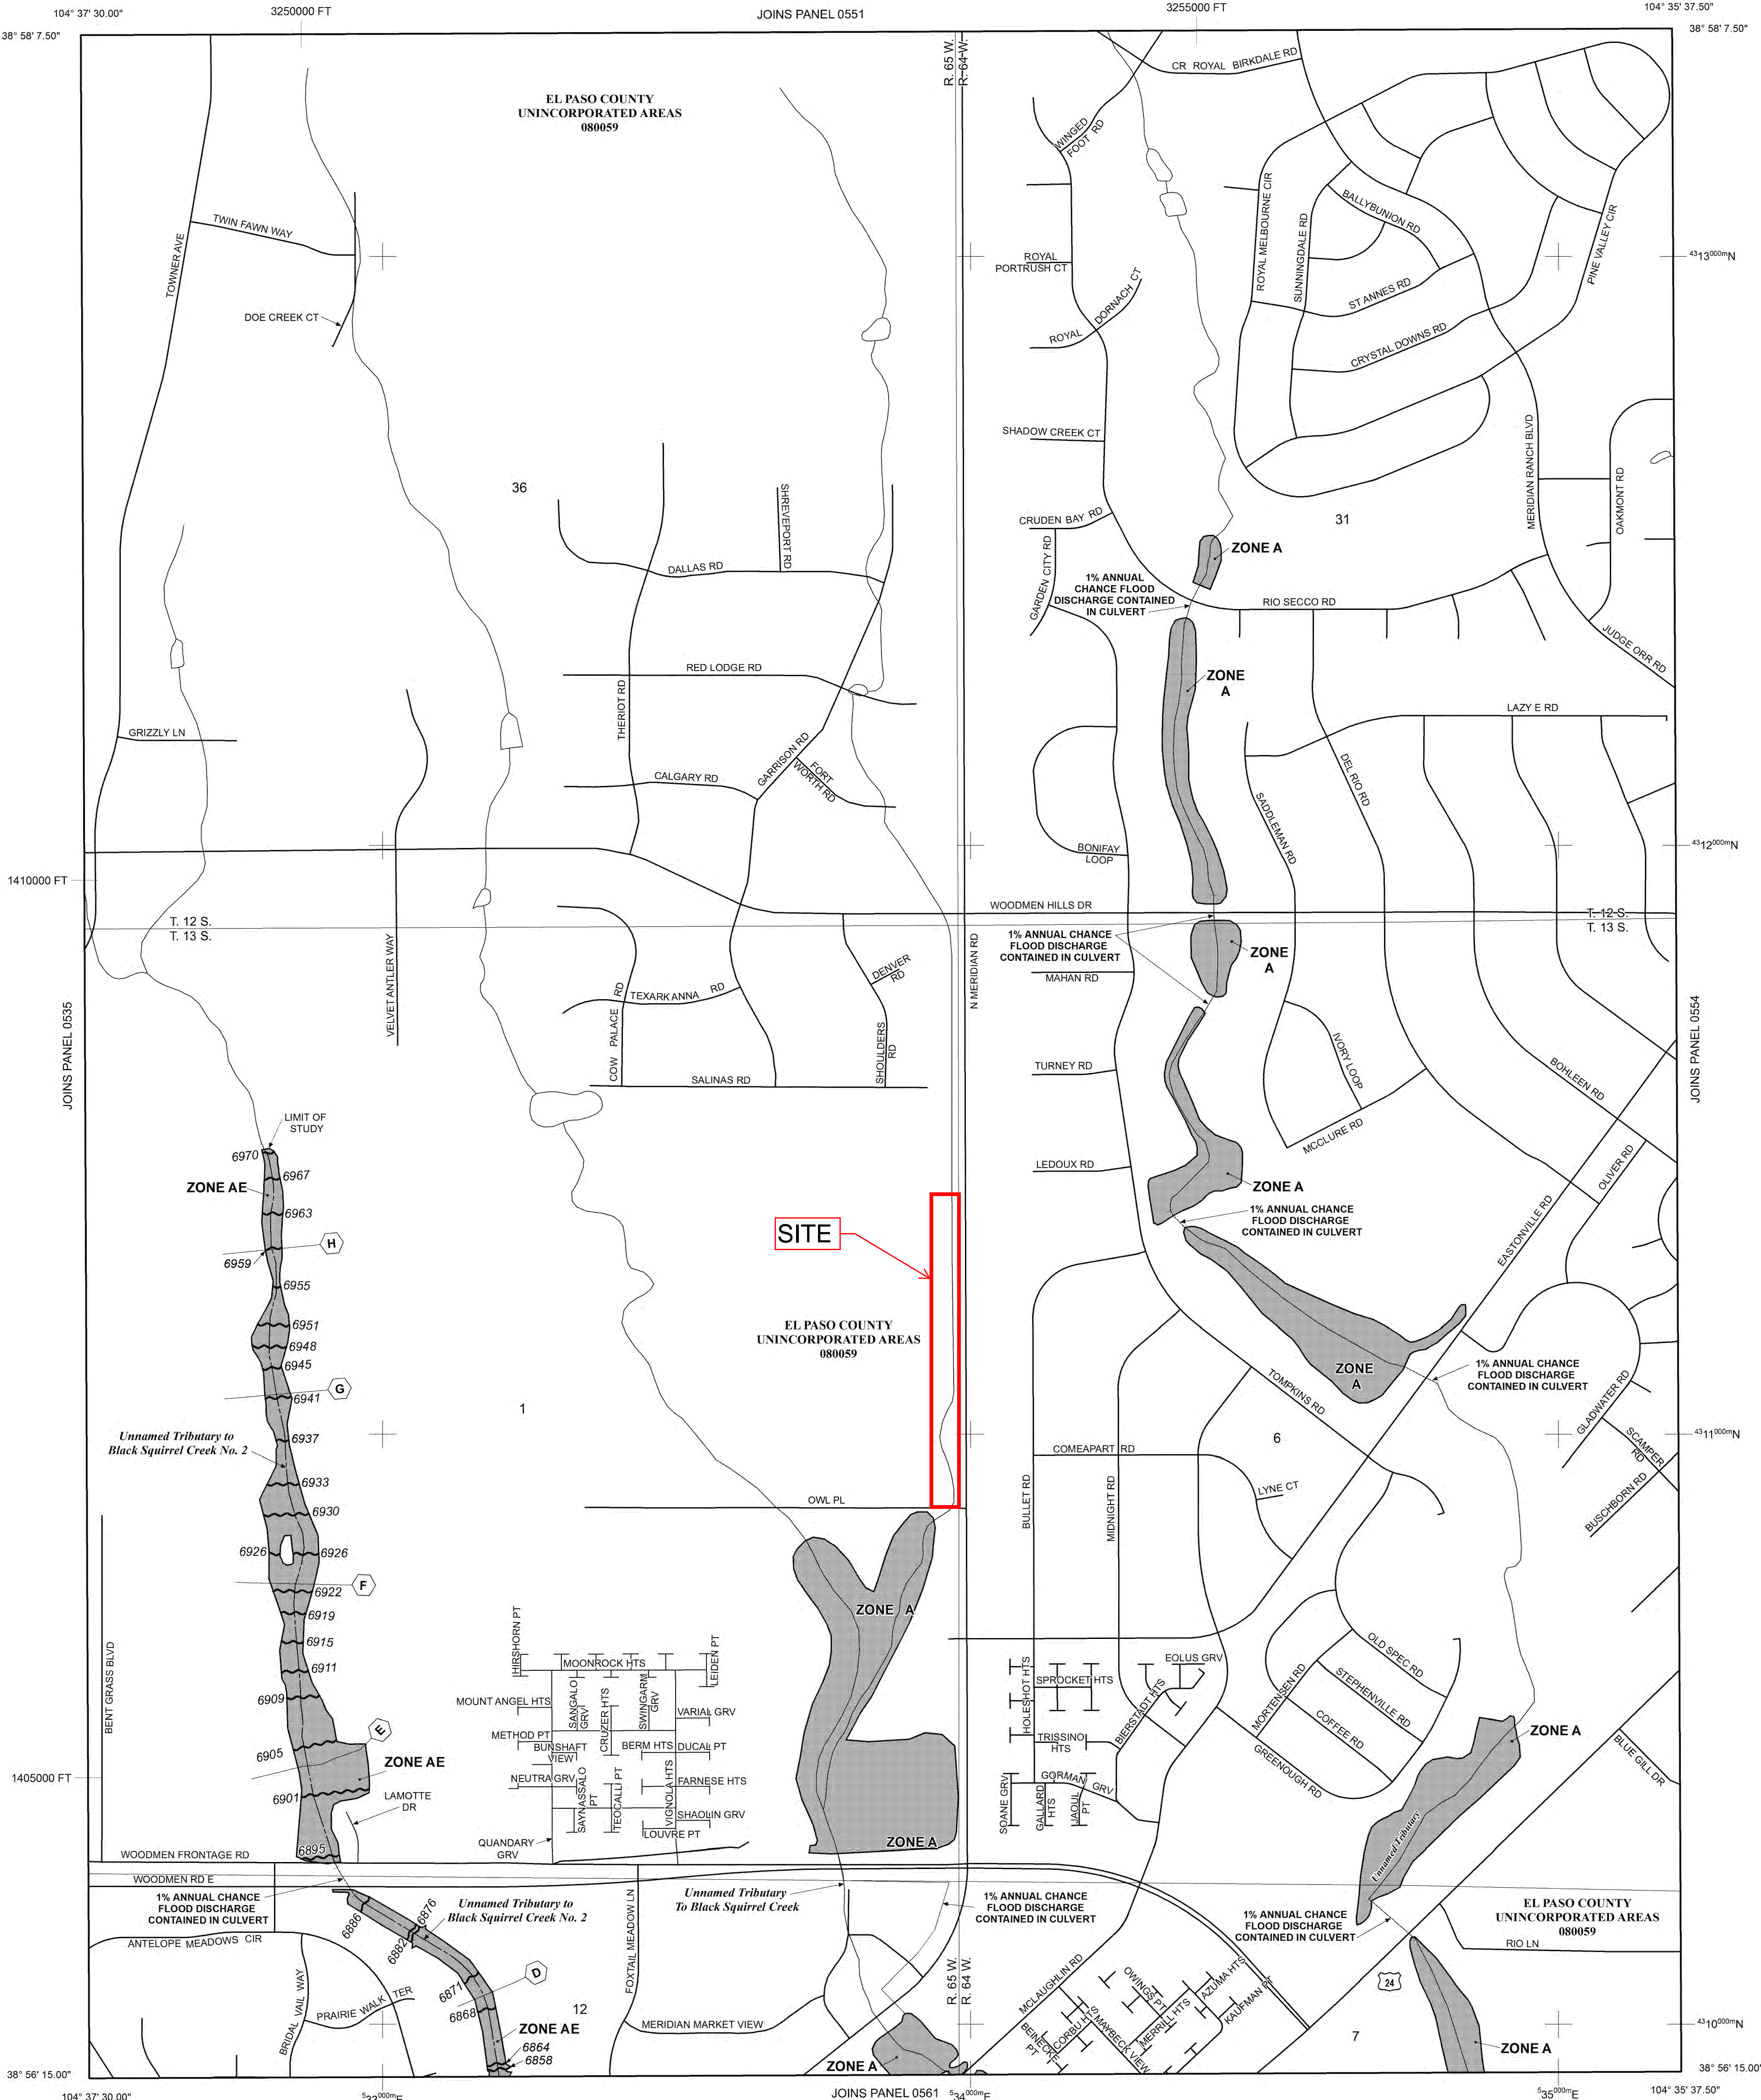

**LEGEND**

**SPECIAL FLOOD HAZARD AREAS (SFHAS) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD**

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equalled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

**ZONE A** No Base Flood Elevations determined.  
**ZONE AE** Base Flood Elevations determined.  
**ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.

**ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.

**ZONE AR** Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently deteriorated. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.

**ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.

**ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.

**ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

**FLOODWAY AREAS IN ZONE AE**

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

**OTHER FLOOD AREAS**

**ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

**OTHER AREAS**

**ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.

**ZONE D** Areas in which flood hazards are undetermined, but possible.

**COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS**

**OTHERWISE PROTECTED AREAS (OPAs)**


CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

**Legend Symbols:**  
Floodplain boundary  
Floodway boundary  
Zone D Boundary  
CBRS and OPA boundary  
Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.  
Base Flood Elevation line and value; elevation in feet\*  
Base Flood Elevation value where uniform within zone; elevation in feet\*  
Cross section line  
Transect line  
Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)  
1000-meter Universal Transverse Mercator grid ticks, zone 13  
5000-foot grid ticks: Colorado State Plane coordinate system, central zone (FIPSZONE 0502), Lambert Conformal Conic Projection  
Bench mark (see explanation in Notes to Users section of this FIRM panel)  
River Mile

\* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

**MAP REPOSITORIES**  
Refer to Map Repositories list on Map Index  
**EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP**  
**MARCH 17, 1997**  
**EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL**  
**DECEMBER 7, 2018** - to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.  
To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

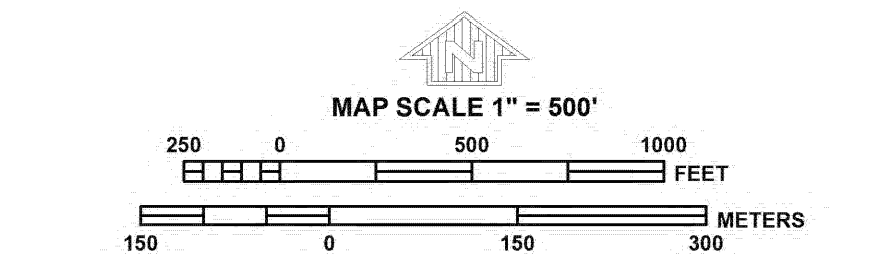

**NFIP**  
**NATIONAL FLOOD INSURANCE PROGRAM**

**PANEL 0553G**  
**FIRM**  
**FLOOD INSURANCE RATE MAP**  
**EL PASO COUNTY, COLORADO AND INCORPORATED AREAS**  
**PANEL 553 OF 1300**  
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)  
CONTAINS:  
COMMUNITY NUMBER PANEL SUFFIX  
EL PASO COUNTY 08059 0553 G  
Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.  
**MAP NUMBER 08041C0553G**  
**MAP REVISED DECEMBER 7, 2018**  
Federal Emergency Management Agency



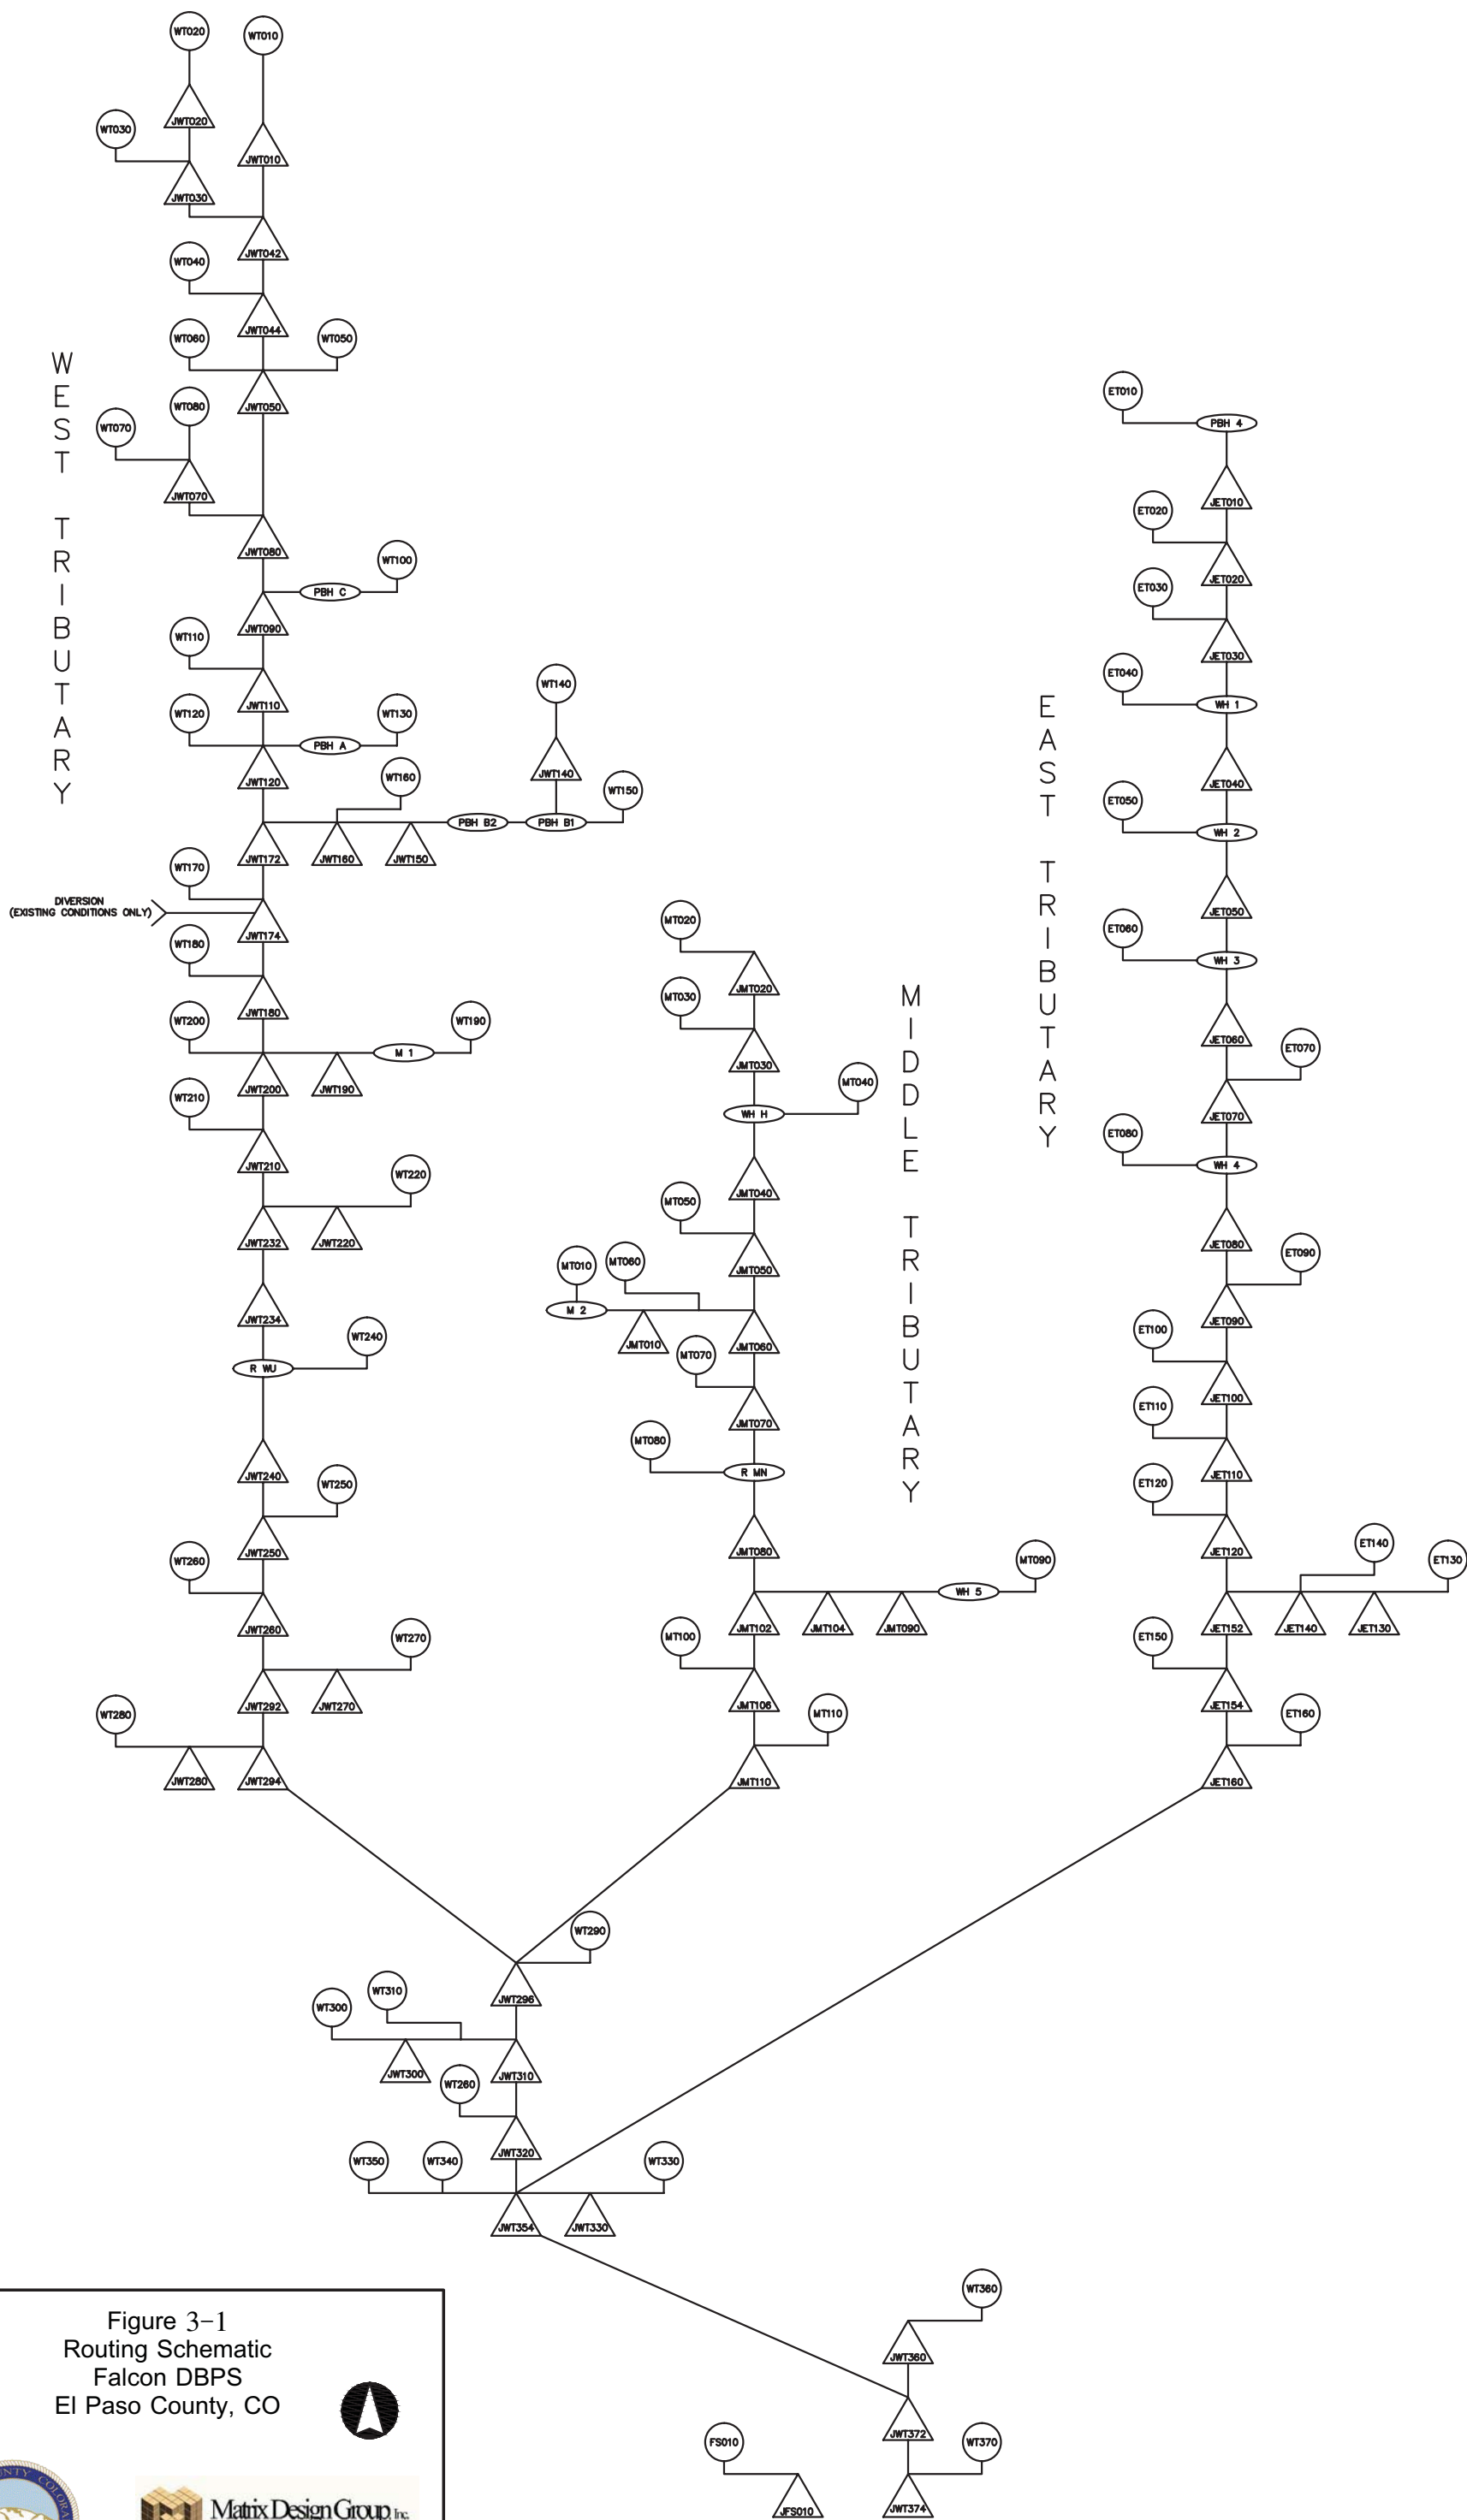



Figure 3-1  
Routing Schematic  
Falcon DBPS  
El Paso County, CO



DRAWING NOT TO SCALE




FILE: G:\gis\_projects\Falcon\_Creek\_DBPS\active\apps\20110613\basin\_map.mxd, 8/29/2011, wilson\_wheeler

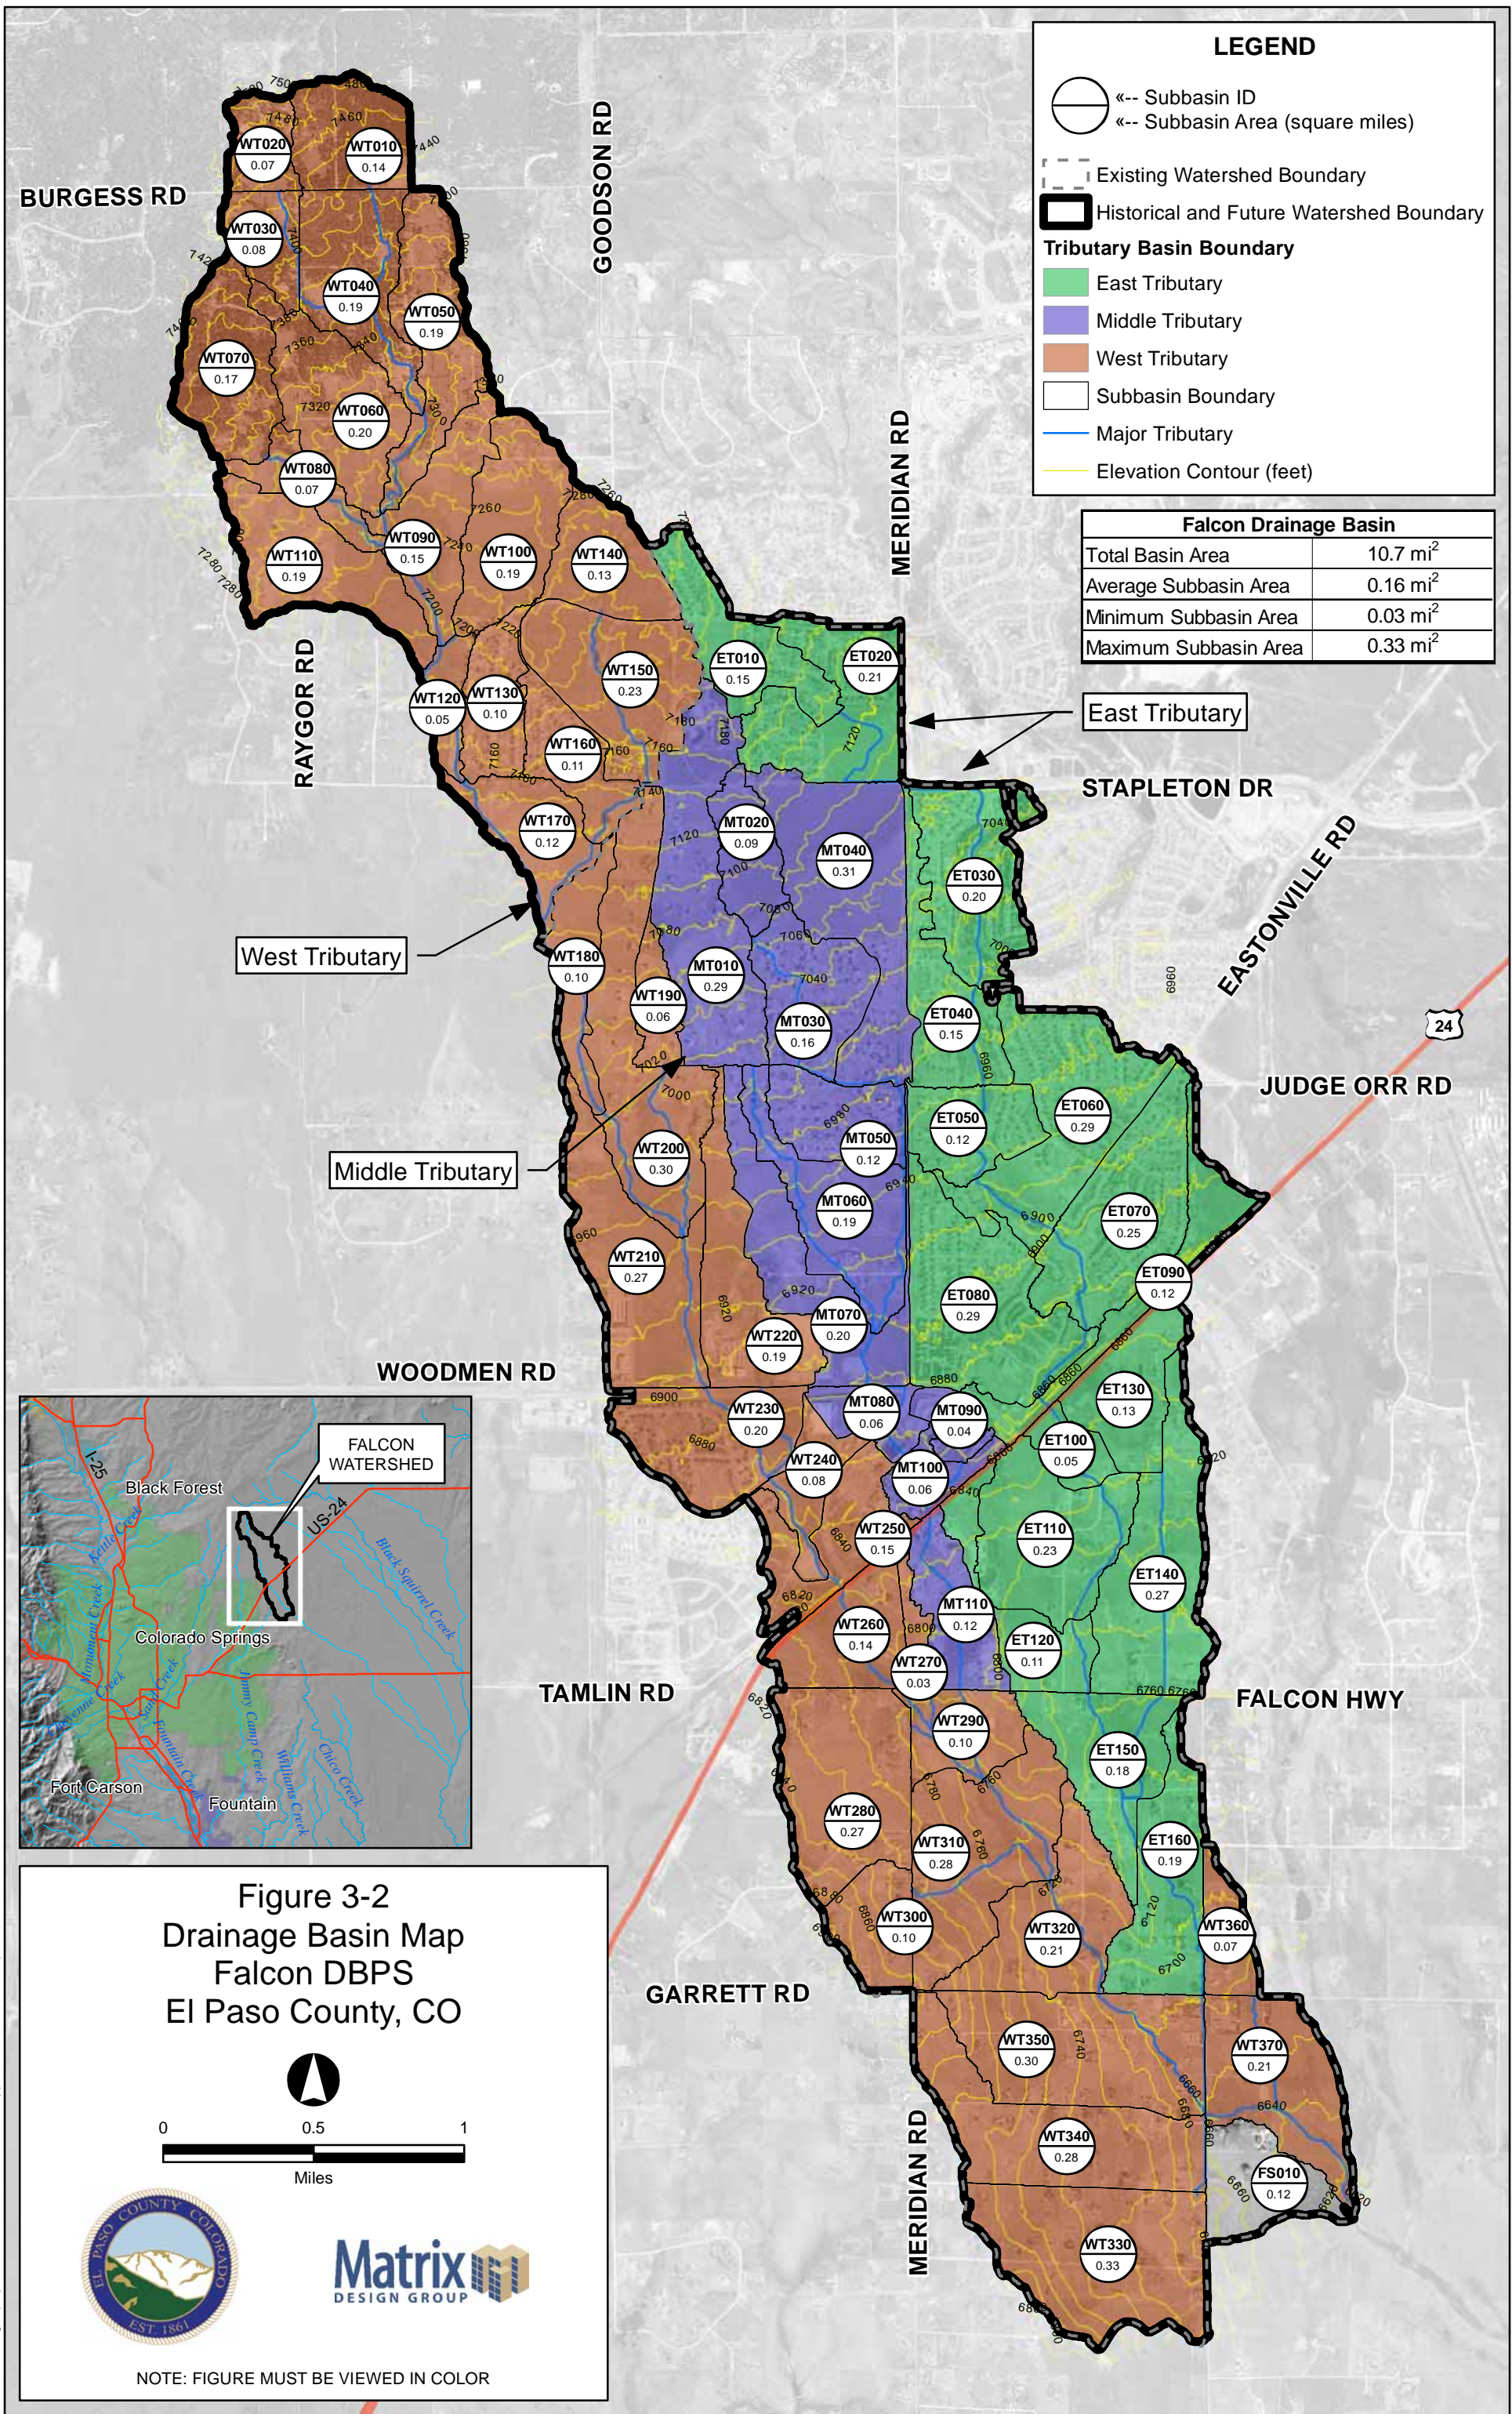


Replace Figure 3-13 (with prev. redlines) and add 3-12 if desired




Add notations per the redlines below.

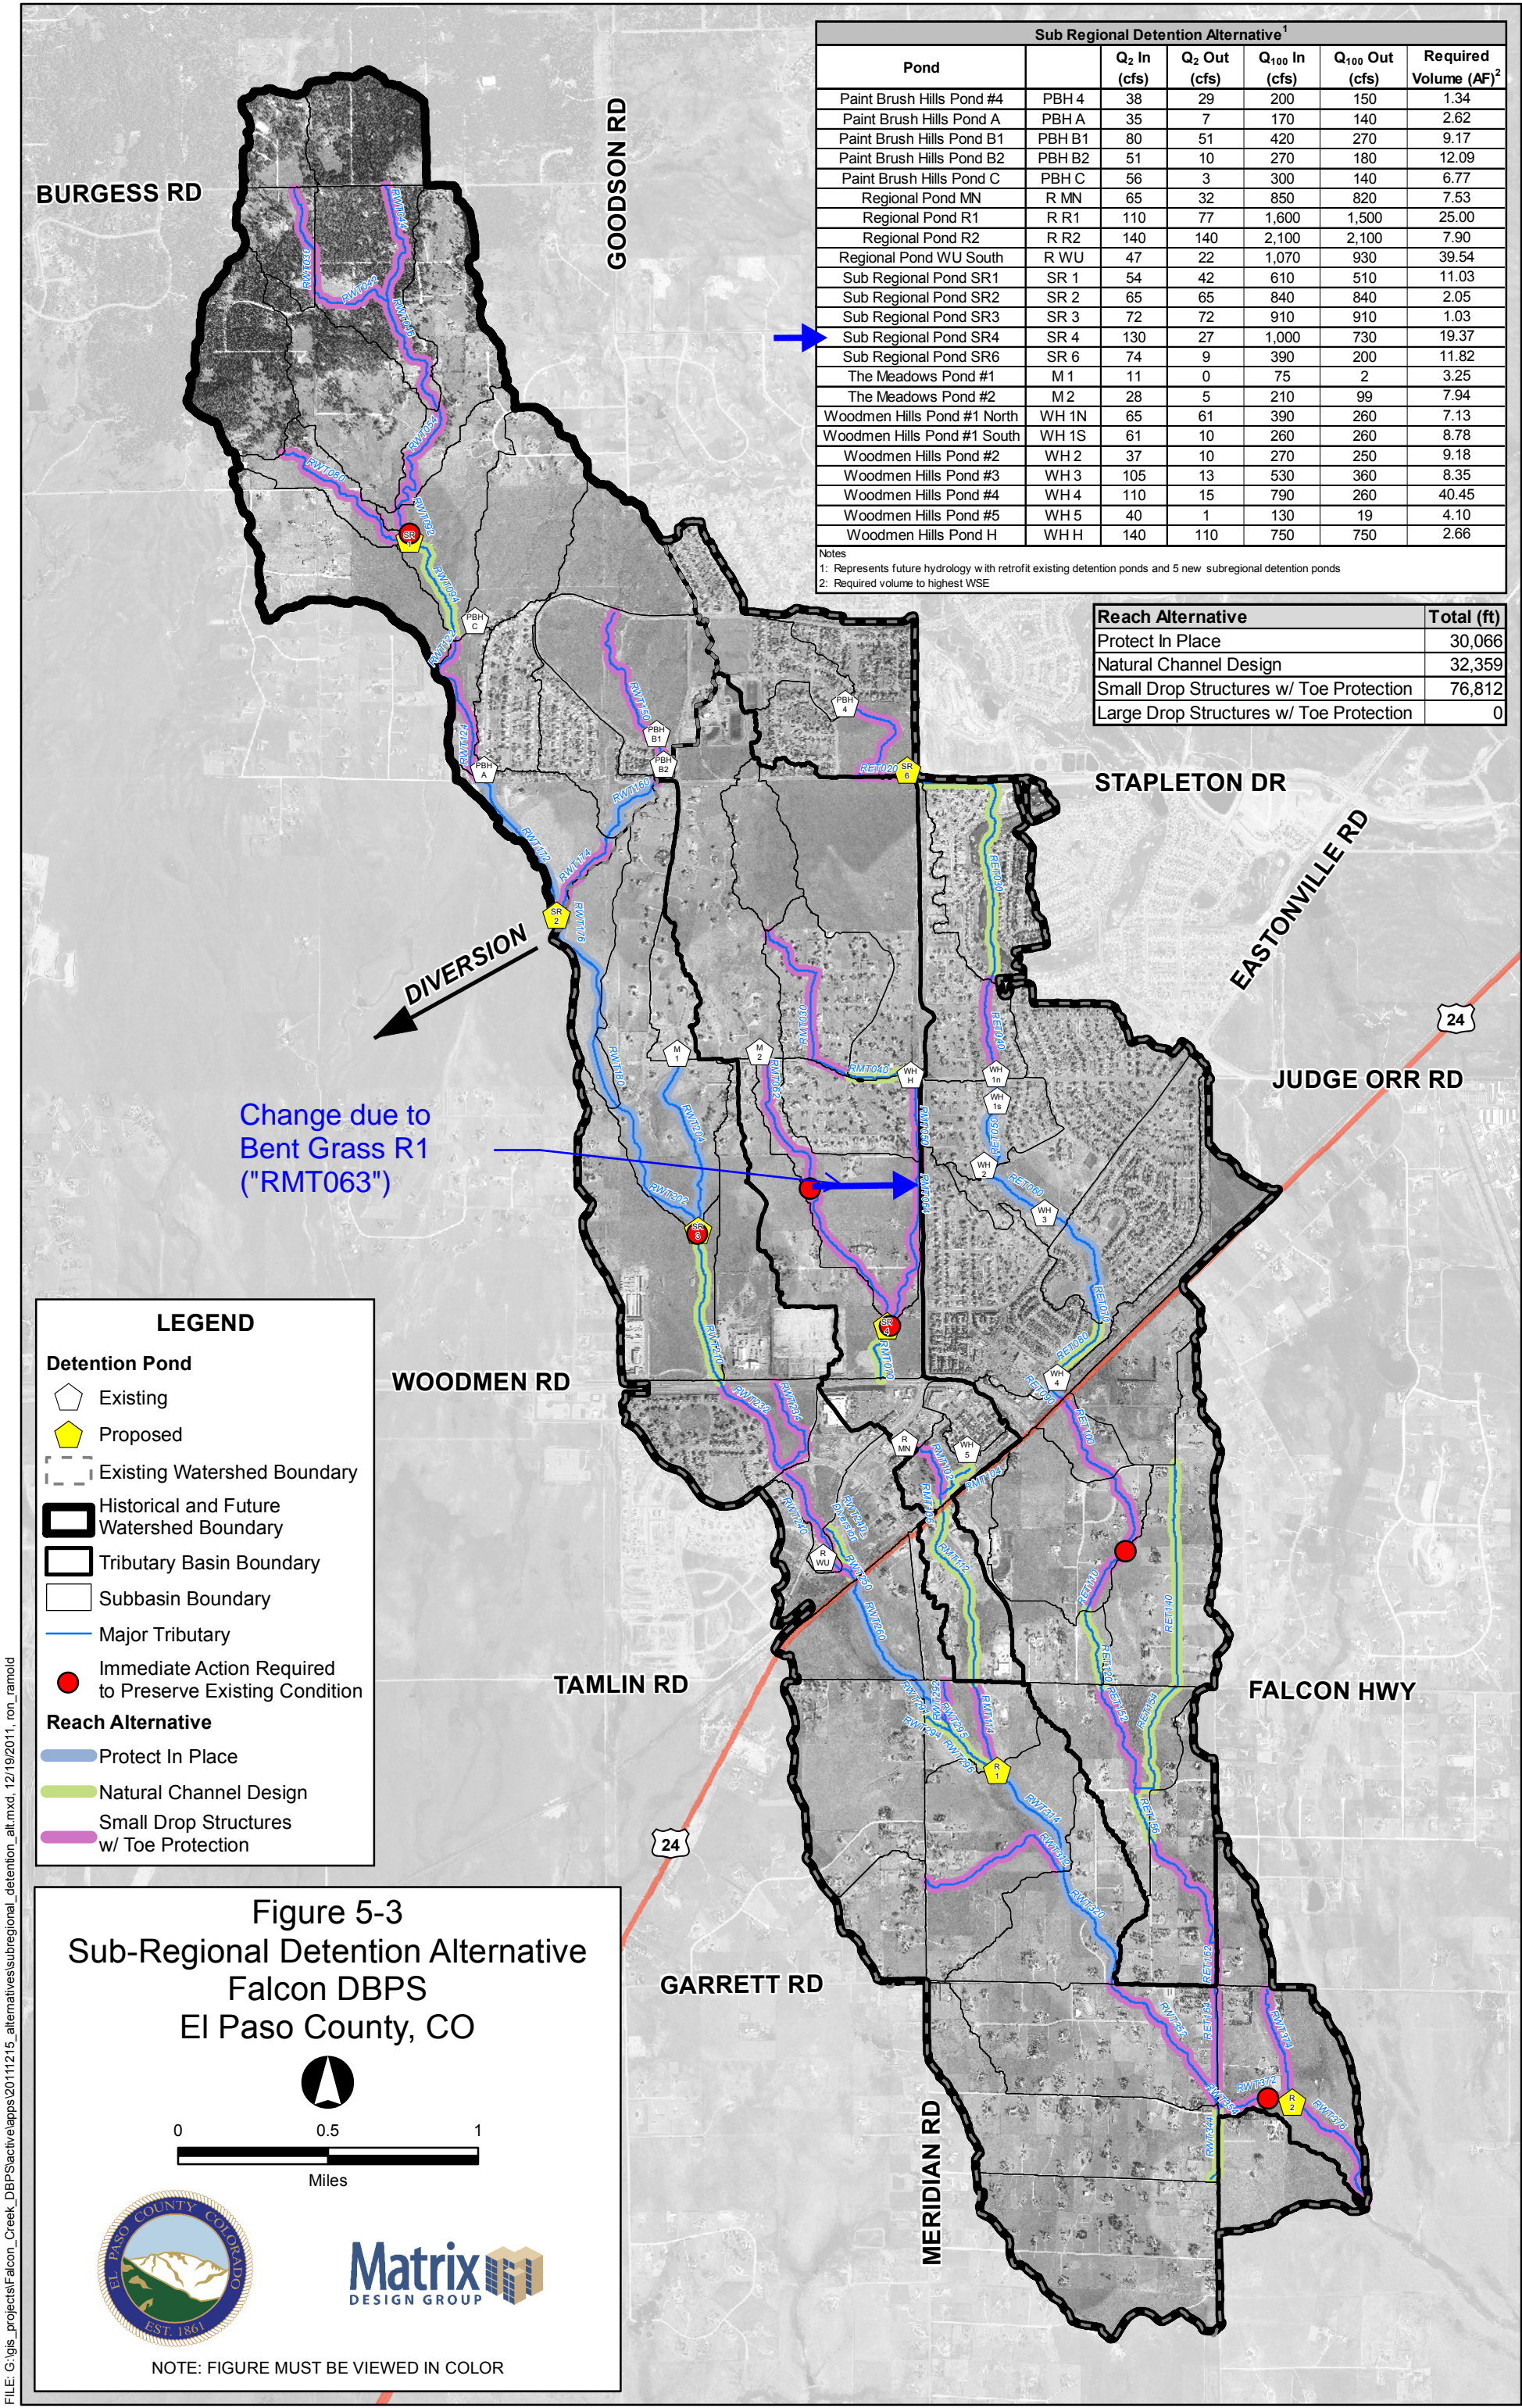




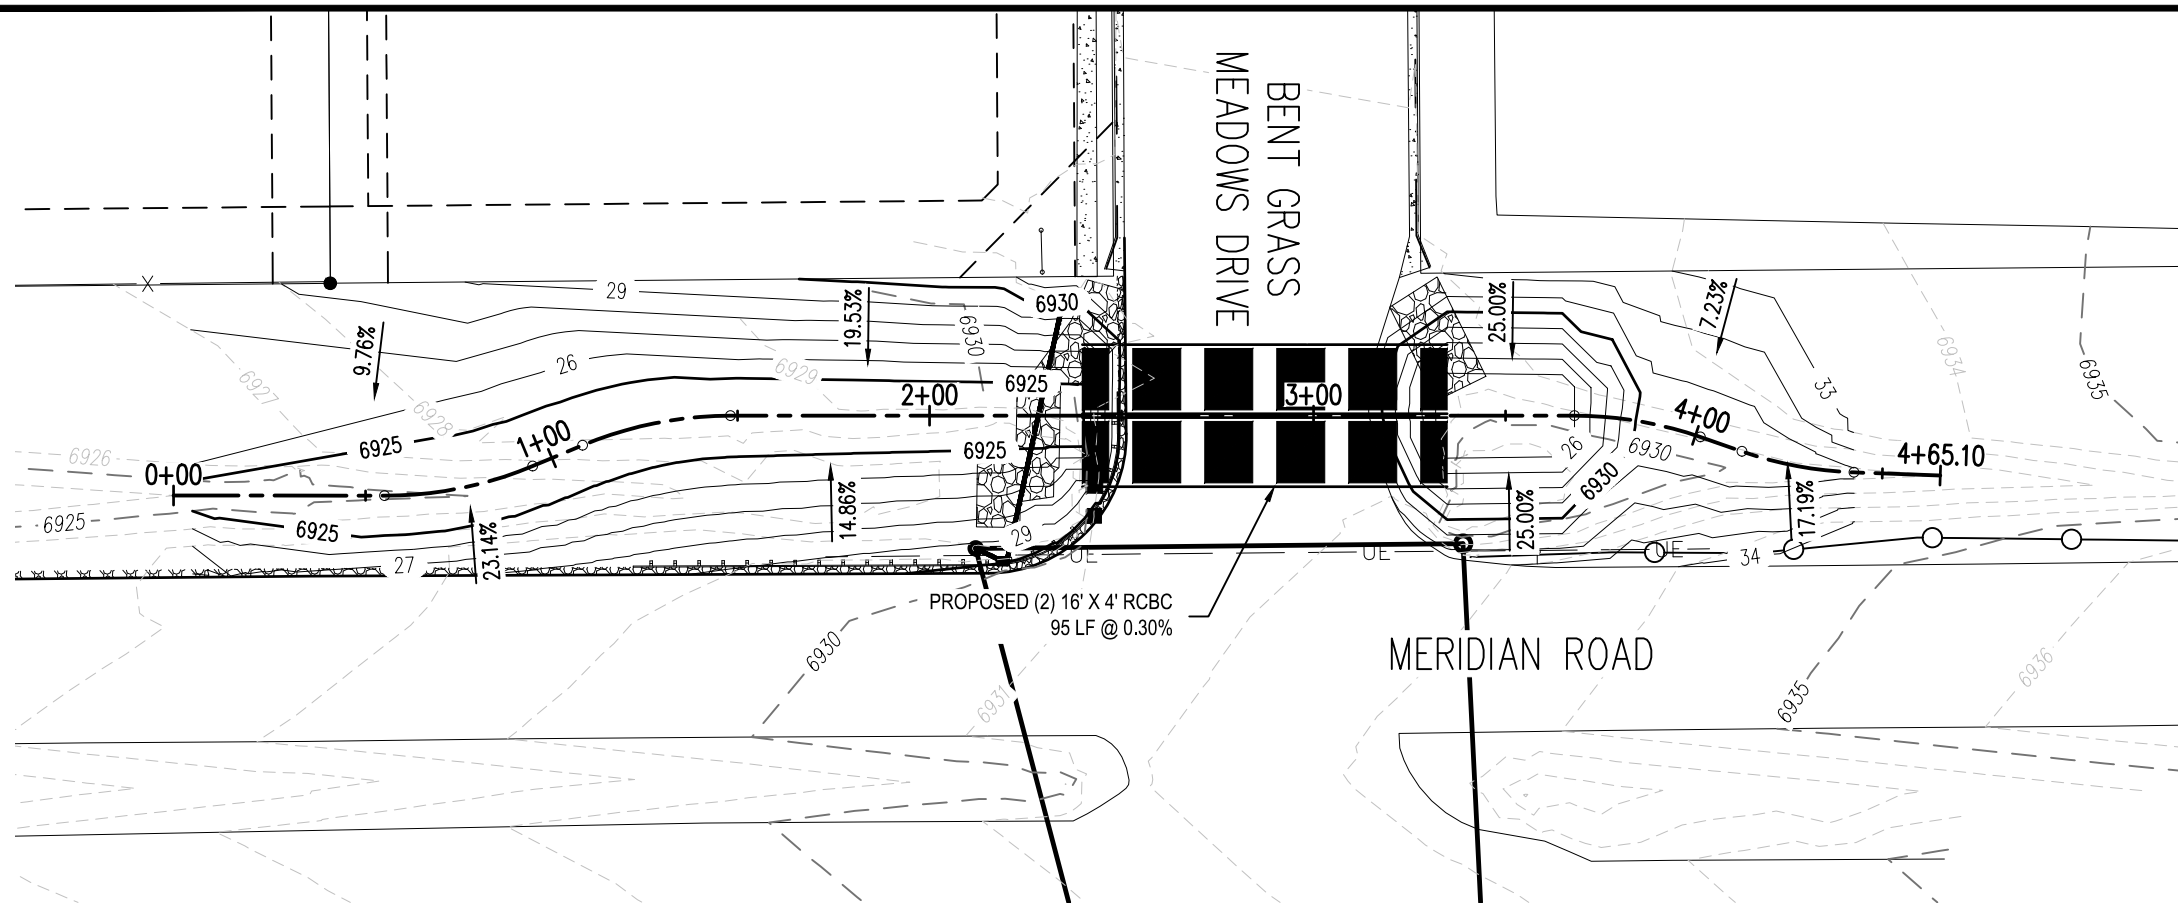


**FUTURE MERIDIAN CHANNEL – PLAN**  
SCALE: 1"=50'



LEGEND	
	EXISTING MAJOR CONTOUR
	EXISTING MINOR CONTOUR
	PROPOSED MAJOR CONTOUR
	PROPOSED MINOR CONTOUR

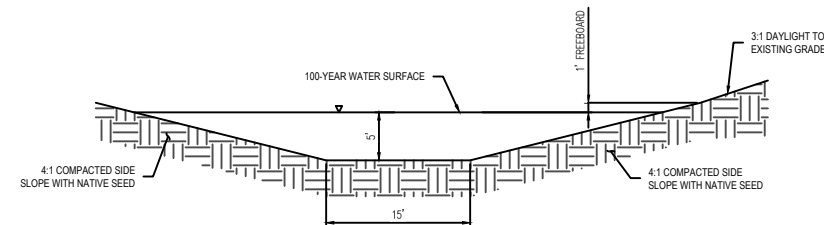

**ROADSIDE CHANNEL FUTURE SECTION**  
SCALE: 1"=20'

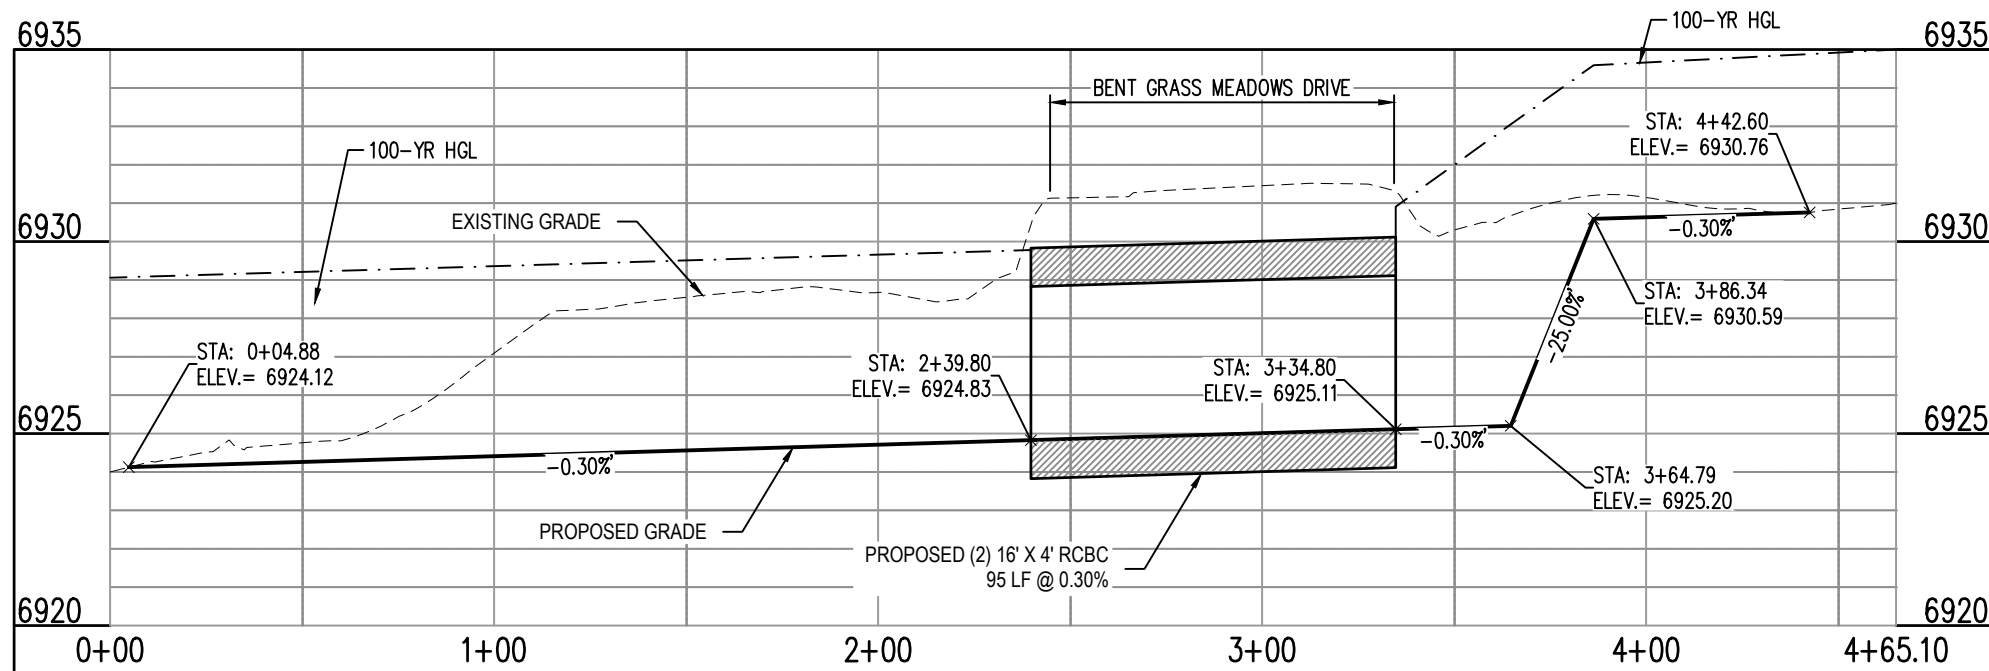

**FUTURE MERIDIAN CHANNEL – PROFILE**  
SCALE: 1"=50' HORIZONTAL, 1"=5' VERTICAL

**APPENDIX B**  
**Hydrologic Computations**

COMPOSITE % IMPERVIOUS CALCULATIONS: PROPOSED

Subdivision: Meridian Road Improvements  
Location: CO, Colorado Springs

Project Name: Meridian Road Improvements  
Project No.: CLH000015.20  
Calculated By: BHB  
Checked By: SMB  
Date: 3/23/20

1	2	3	4	5	6	7	8	9	10	11	12
Basin ID	Total Area (ac)	Paved/Gravel Roads			Lawns/Undeveloped			Roofs			Basins Total
		% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	Weighted % Imp.
OFFSITE BASINS											
OS-5	14.13	100	0.17	1.20	2	13.74	1.90	90	0.22	1.4	4.5
OS-6	5.81	100	0.00	0.00	2	5.81	5.81	90	0.00	0.0	5.8
H3	11.30	100	0.00	0.00	2	5.81	1.00	90	0.00	0.0	1.0
C1	2.22	100	2.22	100.00	2	0.00	0.00	90	0.00	0.0	100.0
OS-2	4.42	100	0.00	0.00	2	4.42	2.00	90	0.00	0.0	2.0
OS-3	10.24	100	0.00	0.00	2	10.24	2.00	90	0.00	0.0	2.0
HISTORIC											
H-1	2.03	100	0.96	47.3	2	1.07	1.1	90	0.00	0.0	48.4
PROPOSED											
P-1	2.03	100	1.29	63.5	2	0.74	0.7	90	0.00	0.0	64.2

NOTES:  
% Impervious values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1, CH. 6 (Referencing UDFCD 2001)

COMPOSITE RUNOFF COEFFICIENT CALCULATIONS: PROPOSED

Subdivision: Meridian Road Improvements  
Location: CO, Colorado Springs

Project Name: Meridian Road Improvements  
Project No.: CLH000015.20  
Calculated By: BHB  
Checked By: SMB  
Date: 3/23/20

1	2	3	4	5	6	7	8	9	10	11	12	13
Basin ID	Total Area (ac)	Paved/Gravel Roads			Lawns/Undeveloped			Roofs			Composite C <sub>5</sub>	Composite C <sub>100</sub>
		C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)	C <sub>5</sub>	C <sub>100</sub>	Area (ac)		
OFFSITE BASINS												
OS-5	14.13	0.90	0.96	0.17	0.09	0.36	13.71	0.73	0.81	0.22	0.11	0.37
OS-6	5.81	0.90	0.96	0.00	0.09	0.36	5.81	0.73	0.81	0.00	0.09	0.36
H3	11.30	0.90	0.96	0.00	0.09	0.36	11.30	0.73	0.81	0.00	0.09	0.36
C1	2.22	0.90	0.96	2.22	0.09	0.36	0.00	0.73	0.81	0.00	0.90	0.96
OS-2	4.42	0.90	0.96	0.00	0.09	0.36	4.42	0.73	0.81	0.00	0.09	0.36
OS-3	10.24	0.90	0.96	0.00	0.09	0.36	10.24	0.73	0.81	0.00	0.09	0.36
HISTORIC												
H-1	2.03	0.90	0.96	0.96	0.09	0.36	1.07	0.73	0.81	0.00	0.47	0.64
PROPOSED												
P-1	2.03	0.90	0.96	1.29	0.09	0.36	0.74	0.73	0.81	0.00	0.60	0.74

NOTES:

C values are taken directly from Table 6-6 in the Colorado Springs DCM Vol. 1. CH. 6 (Referencing UDFCD 2001)  
Coefficients use HSG A&B soils - Refer to "Appendix A: Exhibits and Figures" for soil map

# STANDARD FORM SF-2: PROPOSED TIME OF CONCENTRATION

**Subdivision:** Meridian Road Improvements  
**Location:** CO, Colorado Springs

**Project Name:** Meridian Road Improvements  
**Project No.:** CLH000015.20  
**Calculated By:** BHB  
**Checked By:** SMB  
**Date:** 3/23/20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					Tc CHECK			FINAL
DATA						(T <sub>i</sub> )			(T <sub>t</sub> )					(URBANIZED BASINS)			
BASIN ID	D.A. (AC)	Hydrologic Soils Group	Impervious (%)	C <sub>5</sub>	C <sub>100</sub>	L (FT)	S (%)	T <sub>i</sub> (MIN)	L (FT)	S (%)	C <sub>v</sub>	VEL. (FPS)	T <sub>t</sub> (MIN)	COMP. T <sub>c</sub> (MIN)	TOTAL LENGTH(FT)	Urbanized T <sub>c</sub> (MIN)	
OFFSITE BASINS																	
OS-5	14.13	A	4.5	0.11	0.37	300	2.5	23.1	1400	3.0	15	2.6	8.98	32.1	1700.0	19.4	19.4
OS-6	5.81	A	5.8	0.09	0.36	300	2.0	25.4	400	2.0	15	2.1	3.14	28.6	700.0	13.9	13.9
H3	11.30	A	1.0	0.09	0.36	100	6.0	10.2	1460	2.0	15	2.1	11.47	21.7	1560.0	18.7	18.7
C1	2.22	A	100.0	0.90	0.96	100	6.0	2.0	1230	1.7	15	2.0	10.48	12.5	1330.0	17.4	12.5
OS-2	4.42	A	2.0	0.09	0.36	100	1.0	18.5	650	1.0	10	1.0	10.83	29.3	750.0	14.2	14.2
OS-3	10.24	A	2.0	0.09	0.36	100	1.0	18.5	600	1.0	10	1.0	10.00	28.5	700.0	13.9	13.9
HISTORIC BASINS																	
H-1	2.03	A	48.4	0.47	0.64	100	6.0	6.4	1230	1.7	15	2.0	10.48	16.8	1330.0	17.4	16.8
PROPOSED BASINS																	
P-1	2.03	A	64.2	0.60	0.74	100	6.0	5.0	1230	1.7	15	2.0	10.48	15.5	1330.0	17.4	15.5

**NOTES:**

$T_i = (0.395 * (1.1 - C_5) * (L)^{0.5}) / ((S)^{0.33})$ , S in ft/ft

$T_t = L / 60V$  (Velocity From Fig. 501)

Velocity  $V = C_v * S^{0.5}$ , S in ft/ft

$T_c \text{ Check} = 10 + L / 180$

For Urbanized basins a minimum  $T_c$  of 5.0 minutes is required.

For non-urbanized basins a minimum  $T_c$  of 10.0 minutes is required

Existing?

**STANDARD FORM SF-3: PROPOSED**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Meridian Road Improvements

**Location:** CO, Colorado Springs

**Design Storm:** 100-Year

**Project Name:** Meridian Road Improvements

**Project No.:** CLH000015.20

**Calculated By:** BHB

**Checked By:** SMB

**Date:** 3/23/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
HISTORIC																					
Value from the Bent Grass Meadows Fil. 1 FDR (DP-12)	30							43.0													Total flow from existing culvert into basin OS-5 = 43 cfs
		OS-5	14.13	0.37	19.4	5.23	5.26	27.5													
	11										70.5										Combines Meadows Filing 3 with Basin OS-5
		OS-6	5.81	0.36	13.9	2.09	6.10	12.7													
	12										83.3										Combines DP 11 with Basin OS-6
		H3	11.30	0.36	18.7	4.07	5.36	21.8													
		OS-2	4.42	0.36	14.2	1.59	6.05	9.6													
		OS-3	10.24	0.36	13.9	3.69	6.10	22.5													
		C1	2.22	0.96	12.5	2.13	6.37	13.6													Street flow on North half of Bent Grass Meadows Drive
	15								18.7	11.48	5.36	144.8									Combines Offsite flow fomr Meadows Fil 3, and Basins OS-5, OS 6, H3, OS-2 and OS-3 & C-1 in Bent Grass Meadows Drive
	H1A							850.0				850.0									Flow from Falcon DBPS
	20											994.8									Combines DBPS Flow with DP 14 and DP 15
		H-1	2.03	0.64	16.8	1.30	5.62	7.3													
	25											1002.1									Combines flow from DP 20 with Basin H-1

**STANDARD FORM SF-3: PROPOSED**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Meridian Road Improvements  
**Location:** CO, Colorado Springs  
**Design Storm:** 100-Year

**Project Name:** Meridian Road Improvements  
**Project No.:** CLH000015.20  
**Calculated By:** BHB  
**Checked By:** SMB  
**Date:** 3/23/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE		TRAVEL TIME			REMARKS	
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)		Tt (min)
PROPOSED																					
Value from the Bent Grass Meadows Fil. 1 FDR (DP-12)	30							43.0												Total flow from existing culvert into basin OS-5 = 43 cfs	
		OS-5	14.13	0.37	19.4	5.23	5.26	27.5													
	11											27.5								Flow from OS-5	
		OS-6	5.81	0.36	13.9	2.09	6.10	12.7													
	12											40.3								Combines DP 11 with Basin OS-6	
	12-P											4.2								Release rate from School Site Sed Pond	
		H3	11.30	0.36	18.7	4.07	5.36	21.8													
		OS-2	4.42	0.36	14.2	1.59	6.05	9.6													
		OS-3	10.24	0.36	13.9	3.69	6.10	22.5													
		C1	2.22	0.96	12.5	2.13	6.37	13.6												Street flow on North half of Bent Grass Meadows Drive	
	15								18.7	11.48	5.36	65.7								Combines Offsite flow fomr Meadows Fil 3, and Basins OS-5, OS 6, H3, OS-2 and OS-3 & C-1 in Bent Grass Meadows Drive	
	H1A							850.0				850.0								Flow from Falcon DBPS	
	20											915.5								Combines DBPS Flow with DP 14 and DP 15	
		P-1	2.03	0.74	15.5	1.50	5.82	8.7													
	25											924.5								Combines flow from DP 20 with Basin P-1	

DP14?

Add a note stating that this table assumes the future Bent Grass development subbasins will be required to detain to historic rates.

How did this go down?



**STANDARD FORM SF-3: PROPOSED**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Meridian Road Improvements  
**Location:** CO, Colorado Springs  
**Design Storm:** 5-Year

**Project Name:** Meridian Road Improvements  
**Project No.:** CLH000015.20  
**Calculated By:** BHB  
**Checked By:** SMB  
**Date:** 3/23/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
HISTORIC																					
Value from the Bent Grass Meadows Fil. 1 FDR (DP-12)	30							23.0													Total flow from existing culvert into basin OS-5 = 23 cfs
		OS-5	14.13	0.11	19.4	1.55	3.13	4.9													
	11											27.9									Combines Meadows Filing 3 with Basin OS-5
		OS-6	5.81	0.09	13.9	0.52	3.64	1.9													
	12											29.7									Combines DP 11 with Basin OS-6
		H3	11.30	0.09	18.7	1.02	3.19	3.3													
		OS-2	4.42	0.09	14.2	0.40	3.61	1.4													
		OS-3	10.24	0.09	13.9	0.92	3.64	3.3													
		C1	2.22	0.90	12.5	2.00	3.79	7.6													Street flow on North half of Bent Grass Meadows Drive
	15								18.7	4.34	3.19	43.6									Combines Offsite flow fomr Meadows Fil 3, and Basins OS-5, OS-6, H3, OS-2 and OS-3 & C-1 in Bent Grass Meadows Drive
	H1A							280.0				280.0									Flow from Falcon DBPS
	20											323.6									Combines DBPS Flow with DP 15
		H-1	2.03	0.47	16.8	0.95	3.35	3.2													
	25											326.8									Combines flow from DP 20 with Basin H-1

**STANDARD FORM SF-3: PROPOSED**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

**Subdivision:** Meridian Road Improvements  
**Location:** CO, Colorado Springs  
**Design Storm:** 5-Year

**Project Name:** Meridian Road Improvements  
**Project No.:** CLH000015.20  
**Calculated By:** BHB  
**Checked By:** SMB  
**Date:** 3/23/20

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
PROPOSED																					
Value from the Bent Grass Meadows Fil. 1 FDR (DP-12)	30							23.0													Total flow from existing culvert into basin OS-5 = 23 cfs
		OS-5	14.13	0.11	19.4	1.55	3.13	4.9													
	11										4.9										Flow from OS-5
		OS-6	5.81	0.09	13.9	0.52	3.64	1.9													
	12										6.7										Combines DP 11 with Basin OS-6
	12-P										0.0										Release rate from School Site Sed Pond
		H3	11.30	0.09	18.7	1.02	3.19	3.3													
		OS-2	4.42	0.09	14.2	0.40	3.61	1.4													
		OS-3	10.24	0.09	13.9	0.92	3.64	3.3													
		C1	2.22	0.90	12.5	2.00	3.79	7.6													Street flow on North half of Bent Grass Meadows Drive
	15								18.7	4.34	3.19	13.8									Combines Offsite flow fomr Meadows Fil 3, and Basins OS-5, OS-6, H3, OS-2 and OS-3 & C-1 in Bent Grass Meadows Drive
	H1A							280.0				280.0									Flow from Falcon DBPS
	20											293.8									Combines DBPS Flow with DP 15
		P-1	2.03	0.60	15.5	1.22	3.47	4.2													
	25											298.1									Combines flow from DP 20 with Basin P-1

## HEC-HMS 100-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
WT020	0.0671	41.9	01Jan2011, 06:21	4.8
JWT020	0.0671	41.9	01Jan2011, 06:21	4.8
RWT030	0.0671	41.9	01Jan2011, 06:29	4.8
WT030	0.0765	75.3	01Jan2011, 06:07	5.5
JWT030	0.1436	85.4	01Jan2011, 06:09	10.3
RWT042	0.1436	85.3	01Jan2011, 06:15	10.3
WT010	0.1353	88.9	01Jan2011, 06:17	9.3
JWT010	0.1353	88.9	01Jan2011, 06:17	9.3
RWT044	0.1353	88.8	01Jan2011, 06:24	9.3
JWT042	0.2789	167.0	01Jan2011, 06:21	19.6
RWT046	0.2789	166.7	01Jan2011, 06:28	19.6
WT040	0.1851	92.7	01Jan2011, 06:28	12.8
JWT044	0.4640	259.4	01Jan2011, 06:28	32.4
RWT054	0.4640	258.8	01Jan2011, 06:35	32.3
WT060	0.1956	116.8	01Jan2011, 06:26	15.1
WT050	0.1899	139.4	01Jan2011, 06:19	15.3
JWT050	0.8496	475.4	01Jan2011, 06:31	62.7
RWT092	0.8496	475.2	01Jan2011, 06:32	62.7
WT070	0.1711	133.9	01Jan2011, 06:12	11.8
JWT070	0.1711	133.9	01Jan2011, 06:12	11.8
RWT080	0.1711	133.4	01Jan2011, 06:22	11.8
WT080	0.0692	67.3	01Jan2011, 06:10	5.6
Sub Regional Pond SR1	1.0898	513.2	01Jan2011, 06:40	78.4
JWT080	1.0898	513.2	01Jan2011, 06:40	78.4
RWT094	1.0898	512.4	01Jan2011, 06:45	78.3
WT100-REV	0.1293	203.0	01Jan2011, 06:04	12.9
W26-REV	0.0720	103.6	01Jan2011, 06:03	6.4
WS3-1	0.0720	102.8	01Jan2011, 06:10	6.4
Paint Brush Hills Pond C	0.2013	64.4	01Jan2011, 06:26	19.2
WT090	0.1533	162.4	01Jan2011, 06:09	12.8
JWT090	1.4444	595.9	01Jan2011, 06:44	110.2
RWT122	1.4444	595.5	01Jan2011, 06:45	110.2
WT110	0.1943	169.9	01Jan2011, 06:14	16.2
JWT110	1.6387	651.0	01Jan2011, 06:43	126.4
RWT124	1.6387	650.8	01Jan2011, 06:47	126.3
WT130-REV	0.1016	130.0	01Jan2011, 06:11	10.9
Paint Brush Hills Pond A	0.1016	53.8	01Jan2011, 06:32	10.9
WT120-REV	0.0430	51.1	01Jan2011, 06:08	3.8
JWT120	1.7834	703.6	01Jan2011, 06:46	140.9
RWT172	1.7834	702.5	01Jan2011, 06:58	140.5
WT140-REV	0.1445	194.2	01Jan2011, 06:12	16.8
JWT140	0.1445	194.2	01Jan2011, 06:12	16.8

## HEC-HMS 100-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
RWT150	0.1445	193.3	01Jan2011, 06:22	16.8
WT150-REV	0.1308	202.5	01Jan2011, 06:08	15
Paint Brush Hills Pond B1	0.2753	235.6	01Jan2011, 06:29	31.8
W34B2-REV	0.0936	141.8	01Jan2011, 06:07	10.2
Paint Brush Hills Pond B2	0.3689	234.3	01Jan2011, 06:43	38.9
JWT150	0.3689	234.3	01Jan2011, 06:43	38.9
RWT160	0.3689	234.2	01Jan2011, 06:49	38.8
WT160-REV	0.0735	109.9	01Jan2011, 06:06	7.5
JWT160	0.4424	244.8	01Jan2011, 06:48	46.3
RWT174	0.4424	244.7	01Jan2011, 06:56	46.2
WT170-REV	0.1060	85.2	01Jan2011, 06:19	9.2
W34-CY-REV	0.0465	38.1	01Jan2011, 06:16	3.8
JWT172	2.3783	981.9	01Jan2011, 06:56	199.7
RWT176	2.3783	981.6	01Jan2011, 06:57	199.7
Sub Regional Pond SR2	2.3783	972.9	01Jan2011, 07:01	194.8
JWT174	2.3783	972.9	01Jan2011, 07:01	194.8
RWT180	2.3783	972.1	01Jan2011, 07:10	194.2
WT180-REV	0.0409	29.3	01Jan2011, 06:19	3.2
JWT180	2.4193	978.0	01Jan2011, 07:10	197.4
RWT202	2.4193	977.3	01Jan2011, 07:21	196.8
WT200	0.3017	186.8	01Jan2011, 06:30	26
WT190	0.0575	74.7	01Jan2011, 06:05	5
The Meadows Pond #1	0.0575	2.1	01Jan2011, 08:29	2.8
JWT190	0.0575	2.1	01Jan2011, 08:29	2.8
RWT204	0.0575	2.1	01Jan2011, 08:55	2.7
JWT200	2.7784	1041.0	01Jan2011, 07:19	225.5
RWT210	2.7784	1040.5	01Jan2011, 07:24	225.1
WT210	0.2655	187.9	01Jan2011, 06:35	28
JWT210	3.0439	1113.0	01Jan2011, 07:23	253.1
RWT232	3.0439	1112.6	01Jan2011, 07:27	252.7
WT220	0.1895	250.4	01Jan2011, 06:12	21.3
JWT220	0.1895	250.4	01Jan2011, 06:12	21.3
RWT234	0.1895	249.6	01Jan2011, 06:20	21.3
JWT232	3.2334	1138.4	01Jan2011, 07:26	274
RWT236	3.2334	1138.3	01Jan2011, 07:26	274
WT230	0.1982	346.7	01Jan2011, 06:05	23.1
JWT234	3.4316	1155.6	01Jan2011, 07:26	297
RWT240	3.4316	1155.0	01Jan2011, 07:29	296.8
WT240	0.0761	160.3	01Jan2011, 06:01	9.1
Regional Pond WU North	3.5078	1160.9	01Jan2011, 07:30	304.7
Regional Pond WU Diversion	3.5078	1122.2	01Jan2011, 07:30	261.4
Old Meridian	0.0336	85.0	01Jan2011, 06:07	6.1

## HEC-HMS 100-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
RWT-OM	0.0336	84.2	01Jan2011, 06:12	6.1
Regional Pond WU South	3.5413	997.3	01Jan2011, 07:47	255.2
RWT240_Diversion Reach	0.0000	38.8	01Jan2011, 07:35	43.1
JWT240	3.5413	1036.0	01Jan2011, 07:47	298.4
RWT250	3.5413	1035.7	01Jan2011, 07:48	298.3
WT250	0.1470	291.4	01Jan2011, 06:02	17.1
JWT250	3.6883	1048.0	01Jan2011, 07:48	315.4
RWT260	3.6883	1047.5	01Jan2011, 07:58	314.3
WT260	0.1388	77.5	01Jan2011, 06:34	11.5
JWT260	3.8271	1061.8	01Jan2011, 07:58	325.9
RWT291	3.8271	1061.7	01Jan2011, 08:00	325.6
WT270	0.0325	57.1	01Jan2011, 06:04	3.6
JWT270	0.0325	57.1	01Jan2011, 06:04	3.6
RWT292	0.0325	56.9	01Jan2011, 06:08	3.5
JWT292	3.8596	1064.3	01Jan2011, 08:00	329.2
RWT295	3.8596	1064.2	01Jan2011, 08:01	329
WT280	0.2670	251.8	01Jan2011, 06:12	22.3
JWT280	0.2670	251.8	01Jan2011, 06:12	22.3
RWT294	0.2670	251.2	01Jan2011, 06:15	22.2
JWT294	4.1265	1082.0	01Jan2011, 08:01	351.3
RWT296	4.1265	1081.4	01Jan2011, 08:07	350.6
MT040	0.3084	455.2	01Jan2011, 06:11	38.1
MT030	0.1566	228.6	01Jan2011, 06:05	15.1
MT020	0.0902	143.1	01Jan2011, 06:04	9
JMT020	0.0902	143.1	01Jan2011, 06:04	9
RMT030	0.0902	141.8	01Jan2011, 06:17	8.9
JMT030	0.2468	294.4	01Jan2011, 06:07	24
RMT040	0.2468	293.0	01Jan2011, 06:11	24
Woodmen Hills Pond H	0.5553	751.7	01Jan2011, 06:11	61.7
JMT040	0.5553	751.7	01Jan2011, 06:11	61.7
RMT050	0.5553	745.8	01Jan2011, 06:14	61.7
MT050	0.1186	109.7	01Jan2011, 06:18	11.4
JMT050	0.6739	851.9	01Jan2011, 06:14	73.1
RMT064	0.6739	847.0	01Jan2011, 06:21	73
MT010	0.2899	206.3	01Jan2011, 06:24	25
The Meadows Pond #2	0.2899	99.3	01Jan2011, 06:53	23.4
JMT010	0.2899	99.3	01Jan2011, 06:53	23.4
RMT062	0.2899	99.2	01Jan2011, 07:11	23.3
MT060a	0.0300	46.8	01Jan2011, 06:03	2.8
School Site	0.0300	7.0	01Jan2011, 06:22	1.5
RMT060a	0.0300	7.0	01Jan2011, 06:31	1.5
MT060	0.1595	197.7	01Jan2011, 06:08	14.8

## HEC-HMS 100-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
Sub Regional Pond SR4	1.1533	696.4	01Jan2011, 06:35	107.2
JMT060	1.1533	696.4	01Jan2011, 06:35	107.2
RMT070	1.1533	694.8	01Jan2011, 06:40	107
MT070	0.1995	170.2	01Jan2011, 06:22	19.6
JMT070	1.3527	816.0	01Jan2011, 06:38	126.6
RMT080	1.3527	815.1	01Jan2011, 06:40	126.5
MT080	0.0638	191.9	01Jan2011, 06:00	11
Regional Pond MN	1.4166	799.4	01Jan2011, 06:45	135
JMT080	1.4166	799.4	01Jan2011, 06:45	135
RMT102	1.4166	797.8	01Jan2011, 06:51	134.7
MT090	0.0435	127.4	01Jan2011, 06:00	7.1
Woodmen Hills Pond #5	0.0435	18.6	01Jan2011, 06:07	5.9
JMT090	0.0435	18.6	01Jan2011, 06:07	5.9
RMT090	0.0435	18.6	01Jan2011, 06:08	5.9
JMT104	0.0435	18.6	01Jan2011, 06:08	5.9
RMT104	0.0435	18.6	01Jan2011, 06:12	5.9
JMT102	1.4601	813.3	01Jan2011, 06:51	140.6
RMT106	1.4601	808.9	01Jan2011, 06:53	140.5
MT100	0.0558	88.2	01Jan2011, 06:05	5.9
JMT106	1.5158	816.1	01Jan2011, 06:53	146.4
RMT112	1.5158	813.2	01Jan2011, 07:04	145.8
MT110	0.1164	117.4	01Jan2011, 06:16	11.5
JMT110	1.6322	835.5	01Jan2011, 07:04	157.3
RMT114	1.6322	834.5	01Jan2011, 07:09	157
WT290	0.1038	110.3	01Jan2011, 06:09	8.7
Regional Pond R1	5.8625	1428.4	01Jan2011, 08:03	508.7
JWT296	5.8625	1428.4	01Jan2011, 08:03	508.7
RWT314	5.8625	1428.1	01Jan2011, 08:08	507.8
WT300	0.0970	91.6	01Jan2011, 06:12	8.1
JWT300	0.0970	91.6	01Jan2011, 06:12	8.1
RWT312	0.0970	91.1	01Jan2011, 06:29	8.1
WT310	0.2774	246.7	01Jan2011, 06:13	22.3
JWT310	6.2370	1452.3	01Jan2011, 08:08	538.2
RWT320	6.2370	1451.6	01Jan2011, 08:14	537.2
WT320	0.2061	200.6	01Jan2011, 06:11	17.2
JWT320	6.4431	1463.9	01Jan2011, 08:14	554.3
RWT352	6.4431	1463.1	01Jan2011, 08:23	553.1
ET020	0.2132	360.5	01Jan2011, 06:06	24.8
ET010	0.1451	198.3	01Jan2011, 06:11	16.4
Paint Brush Hills Pond #4	0.1451	150.9	01Jan2011, 06:20	16.3
JET010	0.1451	150.9	01Jan2011, 06:20	16.3
RET020	0.1451	150.0	01Jan2011, 06:37	16.3

## HEC-HMS 100-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
Sub Regional Pond SR6	0.3583	195.4	01Jan2011, 06:41	37.9
JET020	0.3583	195.4	01Jan2011, 06:41	37.9
RET030	0.3583	194.9	01Jan2011, 07:02	37.5
ET030	0.2043	242.0	01Jan2011, 06:15	23
JET030	0.5626	266.0	01Jan2011, 06:43	60.5
RET040	0.5626	265.2	01Jan2011, 06:50	60.3
Woodmen Hills Pond #1 North	0.7117	263.5	01Jan2011, 07:09	75.5
ET040	0.1491	165.7	01Jan2011, 06:14	15.3
Woodmen Hills Pond #1 South	0.7117	261.1	01Jan2011, 07:18	69.5
JET040	0.7117	261.1	01Jan2011, 07:18	69.5
RET050	0.7117	261.1	01Jan2011, 07:23	69.4
ET050	0.1172	197.1	01Jan2011, 06:03	11.6
Woodmen Hills Pond #2	0.8289	250.3	01Jan2011, 07:46	79.3
JET050	0.8289	250.3	01Jan2011, 07:46	79.3
RET060	0.8289	250.3	01Jan2011, 07:53	79.1
ET060	0.2854	529.3	01Jan2011, 06:01	29.3
Woodmen Hills Pond #3	1.1143	360.9	01Jan2011, 06:06	105.9
JET060	1.1143	360.9	01Jan2011, 06:06	105.9
RET070	1.1143	356.7	01Jan2011, 06:16	105.6
ET070	0.2498	461.0	01Jan2011, 06:02	27.3
JET070	1.3641	636.4	01Jan2011, 06:04	132.9
RET080	1.3641	517.5	01Jan2011, 06:23	131.3
ET080	0.2916	517.9	01Jan2011, 06:07	37.1
Woodmen Hills Pond #4	1.6557	288.0	01Jan2011, 07:00	139.2
JET080	1.6557	288.0	01Jan2011, 07:00	139.2
RET090	1.6557	287.3	01Jan2011, 07:03	139
ET090	0.1242	133.0	01Jan2011, 06:22	14.9
JET090	1.7800	330.8	01Jan2011, 06:59	153.9
RET100	1.7800	330.7	01Jan2011, 07:01	153.8
ET100	0.0481	72.0	01Jan2011, 06:02	4
JET100	1.8280	335.4	01Jan2011, 07:01	157.8
RET110	1.8280	335.2	01Jan2011, 07:05	157.6
ET110	0.2260	198.8	01Jan2011, 06:12	17.5
JET110	2.0541	362.1	01Jan2011, 07:03	175.1
RET120	2.0541	361.3	01Jan2011, 07:09	174.7
ET120	0.1091	89.4	01Jan2011, 06:14	8.5
JET120	2.1632	403.2	01Jan2011, 06:17	183.2
RET152	2.1632	402.2	01Jan2011, 06:24	182.9
ET130	0.1348	85.4	01Jan2011, 06:27	11.2
JET130	0.1348	85.4	01Jan2011, 06:27	11.2
RET140	0.1348	84.7	01Jan2011, 06:54	11.1
ET140	0.2676	122.8	01Jan2011, 06:46	22.2

## HEC-HMS 100-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
JET140	0.4024	204.8	01Jan2011, 06:51	33.3
RET154	0.4024	204.4	01Jan2011, 07:05	33.2
JET152	2.5656	572.3	01Jan2011, 07:10	216.1
RET156	2.5656	572.0	01Jan2011, 07:14	215.8
ET150	0.1777	136.2	01Jan2011, 06:18	14.3
JET154	2.7433	595.8	01Jan2011, 07:12	230.1
RET162	2.7433	595.1	01Jan2011, 07:25	228.9
ET160	0.1889	137.2	01Jan2011, 06:23	16.3
JET160	2.9322	633.6	01Jan2011, 06:38	245.2
RET164	2.9322	629.0	01Jan2011, 06:47	244.7
WT350	0.3038	276.7	01Jan2011, 06:14	26.3
JWT352	9.6791	2076.7	01Jan2011, 07:39	824.1
RWT354	9.6791	2076.6	01Jan2011, 07:39	824.1
WT330	0.3267	249.3	01Jan2011, 06:19	27.2
JWT330	0.3267	249.3	01Jan2011, 06:19	27.2
RWT344	0.3267	248.4	01Jan2011, 06:25	27.2
WT340	0.2780	147.3	01Jan2011, 06:37	23.1
JWT354	10.2838	2154.8	01Jan2011, 07:38	874.3
RWT372	10.2838	2152.2	01Jan2011, 07:44	873.2
WT360	0.0657	54.8	01Jan2011, 06:15	5.3
JWT360	0.0657	54.8	01Jan2011, 06:15	5.3
RWT374	0.0657	54.6	01Jan2011, 06:24	5.3
Regional Pond R2	10.3495	2155.5	01Jan2011, 07:45	875.1
JWT372	10.3495	2155.5	01Jan2011, 07:45	875.1
RWT376	10.3495	2149.9	01Jan2011, 07:55	872.8
WT370	0.2148	123.3	01Jan2011, 06:12	11.5
JWT374_OUTLET	10.5642	2160.1	01Jan2011, 07:55	884.3
FS010	0.1220	74.9	01Jan2011, 06:16	7.7
JFS010_OUTLET	0.1220	74.9	01Jan2011, 06:16	7.7



Project: Aug15\_Working\_Falcon\_DBPS\_S  
Simulation Run: FU 100-yr Reservoir: Sub Regional Pond SR4

Start of Run:	01Jan2011, 00:00	Basin Model:	Falcon_DBPS_Future
End of Run:	02Jan2011, 00:00	Meteorologic Model:	100-yr
Compute Time:	28Jul2020, 17:58:02	Control Specifications:	24-hr Storm

Volume Units: AC-FT

#### Computed Results

Peak Inflow :	952.3 (CFS)	Date/Time of Peak Inflow :	01Jan2011, 06:20
Peak Outflow :	696.4 (CFS)	Date/Time of Peak Outflow :	01Jan2011, 06:35
Total Inflow :	112.5 (AC-FT)	Peak Storage :	18.9 (AC-FT)
Total Outflow :	107.2 (AC-FT)	Peak Elevation :	6897.9 (FT)

Project: Aug15\_Working\_Falcon\_DBPS\_S  
Simulation Run: FU 100-yr Reservoir: Regional Pond MN

Start of Run: 01Jan2011, 00:00 Basin Model: Falcon\_DBPS\_Future  
End of Run: 02Jan2011, 00:00 Meteorologic Model: 100-yr  
Compute Time: 28Jul2020, 17:58:02 Control Specifications: 24-hr Storm

Volume Units: AC-FT

#### Computed Results

Peak Inflow :	825.8 (CFS)	Date/Time of Peak Inflow :	01Jan2011, 06:39
Peak Outflow :	799.4 (CFS)	Date/Time of Peak Outflow :	01Jan2011, 06:45
Total Inflow :	137.5 (AC-FT)	Peak Storage :	7.4 (AC-FT)
Total Outflow :	135.0 (AC-FT)	Peak Elevation :	6853.9 (FT)

## HEC-HMS 5-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
WT020	0.0671	10.3	01Jan2011, 06:23	1.4
JWT020	0.0671	10.3	01Jan2011, 06:23	1.4
RWT030	0.0671	10.3	01Jan2011, 06:34	1.4
WT030	0.0765	19.5	01Jan2011, 06:08	1.6
JWT030	0.1436	20.0	01Jan2011, 06:09	3
RWT042	0.1436	19.9	01Jan2011, 06:18	3
WT010	0.1353	21.2	01Jan2011, 06:19	2.6
JWT010	0.1353	21.2	01Jan2011, 06:19	2.6
RWT044	0.1353	21.2	01Jan2011, 06:29	2.6
JWT042	0.2789	37.2	01Jan2011, 06:24	5.6
RWT046	0.2789	37.2	01Jan2011, 06:35	5.6
WT040	0.1851	21.9	01Jan2011, 06:31	3.6
JWT044	0.4640	58.9	01Jan2011, 06:34	9.2
RWT054	0.4640	58.7	01Jan2011, 06:43	9.2
WT060	0.1956	30.1	01Jan2011, 06:29	4.5
WT050	0.1899	37.3	01Jan2011, 06:21	4.7
JWT050	0.8496	108.6	01Jan2011, 06:38	18.4
RWT092	0.8496	108.5	01Jan2011, 06:39	18.4
WT070	0.1711	32.6	01Jan2011, 06:13	3.4
JWT070	0.1711	32.6	01Jan2011, 06:13	3.4
RWT080	0.1711	32.5	01Jan2011, 06:28	3.3
WT080	0.0692	18.5	01Jan2011, 06:12	1.7
Sub Regional Pond SR1	1.0898	113.8	01Jan2011, 06:50	21.9
JWT080	1.0898	113.8	01Jan2011, 06:50	21.9
RWT094	1.0898	113.7	01Jan2011, 06:58	21.8
WT100-REV	0.1293	67.7	01Jan2011, 06:05	4.5
W26-REV	0.0720	33.7	01Jan2011, 06:04	2.1
WS3-1	0.0720	33.4	01Jan2011, 06:13	2.1
Paint Brush Hills Pond C	0.2013	14.0	01Jan2011, 06:38	6.5
WT090	0.1533	46.0	01Jan2011, 06:10	4
JWT090	1.4444	133.8	01Jan2011, 06:57	32.3
RWT122	1.4444	133.7	01Jan2011, 07:01	32.3
WT110	0.1943	47.0	01Jan2011, 06:16	5.1
JWT110	1.6387	144.0	01Jan2011, 07:00	37.4
RWT124	1.6387	144.0	01Jan2011, 07:08	37.3
WT130-REV	0.1016	43.5	01Jan2011, 06:12	3.9
Paint Brush Hills Pond A	0.1016	9.3	01Jan2011, 06:49	3.9
WT120-REV	0.0430	14.8	01Jan2011, 06:09	1.2
JWT120	1.7834	154.4	01Jan2011, 07:08	42.4
RWT172	1.7834	154.2	01Jan2011, 07:18	42.2
WT140-REV	0.1445	65.2	01Jan2011, 06:14	6.1
JWT140	0.1445	65.2	01Jan2011, 06:14	6.1
RWT150	0.1445	64.9	01Jan2011, 06:24	6.1

## HEC-HMS 5-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
WT150-REV	0.1308	71.3	01Jan2011, 06:08	5.5
Paint Brush Hills Pond B1	0.2753	110.4	01Jan2011, 06:15	11.6
W34B2-REV	0.0936	49.1	01Jan2011, 06:08	3.7
Paint Brush Hills Pond B2	0.3689	20.1	01Jan2011, 07:15	13.8
JWT150	0.3689	20.1	01Jan2011, 07:15	13.8
RWT160	0.3689	20.0	01Jan2011, 07:24	13.8
WT160-REV	0.0735	36.3	01Jan2011, 06:07	2.6
JWT160	0.4424	37.3	01Jan2011, 06:07	16.4
RWT174	0.4424	36.9	01Jan2011, 06:20	16.3
WT170-REV	0.1060	24.0	01Jan2011, 06:21	2.9
W34-CY-REV	0.0465	10.7	01Jan2011, 06:18	1.2
JWT172	2.3783	181.3	01Jan2011, 07:17	62.6
RWT176	2.3783	181.2	01Jan2011, 07:18	62.6
Sub Regional Pond SR2	2.3783	171.7	01Jan2011, 07:30	59.3
JWT174	2.3783	171.7	01Jan2011, 07:30	59.3
RWT180	2.3783	171.6	01Jan2011, 07:45	59
WT180-REV	0.0409	7.6	01Jan2011, 06:21	1
JWT180	2.4193	172.6	01Jan2011, 07:45	59.9
RWT202	2.4193	172.6	01Jan2011, 08:03	59.5
WT200	0.3017	52.2	01Jan2011, 06:33	8.3
WT190	0.0575	22.5	01Jan2011, 06:06	1.6
The Meadows Pond #1	0.0575	0.6	01Jan2011, 10:18	0.9
JWT190	0.0575	0.6	01Jan2011, 10:18	0.9
RWT204	0.0575	0.6	01Jan2011, 10:56	0.8
JWT200	2.7784	182.8	01Jan2011, 08:02	68.6
RWT210	2.7784	182.7	01Jan2011, 08:10	68.3
WT210	0.2655	59.7	01Jan2011, 06:38	9.8
JWT210	3.0439	194.3	01Jan2011, 08:09	78.2
RWT232	3.0439	194.3	01Jan2011, 08:16	77.9
WT220	0.1895	84.8	01Jan2011, 06:13	7.8
JWT220	0.1895	84.8	01Jan2011, 06:13	7.8
RWT234	0.1895	84.4	01Jan2011, 06:25	7.7
JWT232	3.2334	200.7	01Jan2011, 08:16	85.7
RWT236	3.2334	200.7	01Jan2011, 08:16	85.7
WT230	0.1982	124.0	01Jan2011, 06:06	8.5
JWT234	3.4316	205.6	01Jan2011, 08:15	94.2
RWT240	3.4316	205.4	01Jan2011, 08:21	94
WT240	0.0761	61.0	01Jan2011, 06:02	3.4
Regional Pond WU North	3.5078	206.4	01Jan2011, 08:23	96.3
Regional Pond WU Diversion	3.5078	169.3	01Jan2011, 08:23	64.8
Old Meridian	0.0336	38.2	01Jan2011, 06:09	2.8
RWT-OM	0.0336	37.8	01Jan2011, 06:14	2.8
Regional Pond WU South	3.5413	144.6	01Jan2011, 08:49	57.2

## HEC-HMS 5-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
RWT240_Diversion Reach	0.0000	37.1	01Jan2011, 08:29	31.4
JWT240	3.5413	180.6	01Jan2011, 08:47	88.6
RWT250	3.5413	180.6	01Jan2011, 08:48	88.5
WT250	0.1470	107.5	01Jan2011, 06:03	6.3
JWT250	3.6883	183.2	01Jan2011, 08:48	94.9
RWT260	3.6883	183.1	01Jan2011, 09:04	94.3
WT260	0.1388	21.0	01Jan2011, 06:36	3.6
JWT260	3.8271	185.4	01Jan2011, 09:03	97.9
RWT291	3.8271	185.3	01Jan2011, 09:07	97.8
WT270	0.0325	20.0	01Jan2011, 06:04	1.3
JWT270	0.0325	20.0	01Jan2011, 06:04	1.3
RWT292	0.0325	19.9	01Jan2011, 06:10	1.3
JWT292	3.8596	185.9	01Jan2011, 09:07	99
RWT295	3.8596	185.8	01Jan2011, 09:09	99
WT280	0.2670	70.1	01Jan2011, 06:14	6.9
JWT280	0.2670	70.1	01Jan2011, 06:14	6.9
RWT294	0.2670	70.0	01Jan2011, 06:17	6.9
JWT294	4.1265	189.2	01Jan2011, 09:09	105.9
RWT296	4.1265	189.1	01Jan2011, 09:17	105.5
MT040	0.3084	163.5	01Jan2011, 06:12	14.5
MT030	0.1566	73.4	01Jan2011, 06:06	5.1
MT020	0.0902	47.3	01Jan2011, 06:05	3.1
JMT020	0.0902	47.3	01Jan2011, 06:05	3.1
RMT030	0.0902	46.8	01Jan2011, 06:21	3.1
JMT030	0.2468	93.6	01Jan2011, 06:07	8.1
RMT040	0.2468	92.8	01Jan2011, 06:12	8.1
Woodmen Hills Pond H	0.5553	242.5	01Jan2011, 06:16	22.5
JMT040	0.5553	242.5	01Jan2011, 06:16	22.5
RMT050	0.5553	242.2	01Jan2011, 06:19	22.5
MT050	0.1186	33.2	01Jan2011, 06:20	3.8
JMT050	0.6739	275.4	01Jan2011, 06:19	26.3
RMT064	0.6739	273.1	01Jan2011, 06:29	26.2
MT010	0.2899	57.8	01Jan2011, 06:26	8
The Meadows Pond #2	0.2899	20.8	01Jan2011, 07:07	6.5
JMT010	0.2899	20.8	01Jan2011, 07:07	6.5
RMT062	0.2899	20.8	01Jan2011, 07:34	6.4
MT060a	0.0300	15.1	01Jan2011, 06:03	0.9
School Site	0.0300	0.0	01Jan2011, 00:00	0
RMT060a	0.0300	0.0	01Jan2011, 00:00	0
MT060	0.1595	60.4	01Jan2011, 06:09	4.9
Sub Regional Pond SR4	1.1533	132.7	01Jan2011, 06:52	35.1
JMT060	1.1533	132.7	01Jan2011, 06:52	35.1
RMT070	1.1533	132.3	01Jan2011, 06:58	35

## HEC-HMS 5-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
MT070	0.1995	51.6	01Jan2011, 06:24	6.6
JMT070	1.3527	153.8	01Jan2011, 06:57	41.6
RMT080	1.3527	153.6	01Jan2011, 06:59	41.6
MT080	0.0638	91.5	01Jan2011, 06:00	5
Regional Pond MN	1.4166	151.6	01Jan2011, 07:04	44.1
JMT080	1.4166	151.6	01Jan2011, 07:04	44.1
RMT102	1.4166	151.2	01Jan2011, 07:13	44
MT090	0.0435	59.3	01Jan2011, 06:00	3.2
Woodmen Hills Pond #5	0.0435	2.2	01Jan2011, 08:01	2.3
JMT090	0.0435	2.2	01Jan2011, 08:01	2.3
RMT090	0.0435	2.2	01Jan2011, 08:01	2.3
JMT104	0.0435	2.2	01Jan2011, 08:01	2.3
RMT104	0.0435	2.2	01Jan2011, 08:07	2.3
JMT102	1.4601	153.4	01Jan2011, 07:13	46.3
RMT106	1.4601	151.6	01Jan2011, 07:16	46.3
MT100	0.0558	29.8	01Jan2011, 06:06	2.1
JMT106	1.5158	153.6	01Jan2011, 07:15	48.3
RMT112	1.5158	153.0	01Jan2011, 07:37	47.8
MT110	0.1164	36.3	01Jan2011, 06:18	3.9
JMT110	1.6322	157.2	01Jan2011, 07:37	51.7
RMT114	1.6322	156.9	01Jan2011, 07:44	51.5
WT290	0.1038	31.2	01Jan2011, 06:10	2.7
Regional Pond R1	5.8625	257.7	01Jan2011, 09:18	152.7
JWT296	5.8625	257.7	01Jan2011, 09:18	152.7
RWT314	5.8625	257.6	01Jan2011, 09:25	152
WT300	0.0970	25.5	01Jan2011, 06:14	2.5
JWT300	0.0970	25.5	01Jan2011, 06:14	2.5
RWT312	0.0970	25.4	01Jan2011, 06:34	2.5
WT310	0.2774	67.1	01Jan2011, 06:14	6.9
JWT310	6.2370	262.2	01Jan2011, 09:25	161.4
RWT320	6.2370	262.0	01Jan2011, 09:33	160.7
WT320	0.2061	56.1	01Jan2011, 06:13	5.4
JWT320	6.4431	264.6	01Jan2011, 09:33	166.1
RWT352	6.4431	264.5	01Jan2011, 09:42	165.2
ET020	0.2132	128.1	01Jan2011, 06:07	9.2
ET010	0.1451	67.4	01Jan2011, 06:12	5.9
Paint Brush Hills Pond #4	0.1451	48.8	01Jan2011, 06:22	5.9
JET010	0.1451	48.8	01Jan2011, 06:22	5.9
RET020	0.1451	48.7	01Jan2011, 06:37	5.9
Sub Regional Pond SR6	0.3583	19.9	01Jan2011, 07:26	13.5
JET020	0.3583	19.9	01Jan2011, 07:26	13.5
RET030	0.3583	19.7	01Jan2011, 08:14	13.1
ET030	0.2043	81.2	01Jan2011, 06:17	8.4

## HEC-HMS 5-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
JET030	0.5626	81.2	01Jan2011, 06:17	21.5
RET040	0.5626	80.9	01Jan2011, 06:28	21.4
Woodmen Hills Pond #1 North	0.7117	103.5	01Jan2011, 06:35	26.6
ET040	0.1491	52.6	01Jan2011, 06:15	5.3
Woodmen Hills Pond #1 South	0.7117	32.8	01Jan2011, 07:14	21.7
JET040	0.7117	32.8	01Jan2011, 07:14	21.7
RET050	0.7117	32.8	01Jan2011, 07:22	21.6
ET050	0.1172	66.6	01Jan2011, 06:03	4
Woodmen Hills Pond #2	0.8289	29.6	01Jan2011, 08:07	23.9
JET050	0.8289	29.6	01Jan2011, 08:07	23.9
RET060	0.8289	29.6	01Jan2011, 08:19	23.7
ET060	0.2854	185.5	01Jan2011, 06:02	10.2
Woodmen Hills Pond #3	1.1143	82.1	01Jan2011, 06:08	31.5
JET060	1.1143	82.1	01Jan2011, 06:08	31.5
RET070	1.1143	81.0	01Jan2011, 06:18	31.2
ET070	0.2498	164.1	01Jan2011, 06:03	9.8
JET070	1.3641	164.5	01Jan2011, 06:03	41
RET080	1.3641	123.5	01Jan2011, 06:29	40.2
ET080	0.2916	192.2	01Jan2011, 06:08	14.3
Woodmen Hills Pond #4	1.6557	26.7	01Jan2011, 14:58	26.8
JET080	1.6557	26.7	01Jan2011, 14:58	26.8
RET090	1.6557	26.7	01Jan2011, 15:03	26.6
ET090	0.1242	46.0	01Jan2011, 06:23	5.6
JET090	1.7800	50.6	01Jan2011, 06:24	32.2
RET100	1.7800	50.6	01Jan2011, 06:28	32.1
ET100	0.0481	22.3	01Jan2011, 06:02	1.3
JET100	1.8280	53.2	01Jan2011, 06:28	33.3
RET110	1.8280	53.1	01Jan2011, 06:35	33.1
ET110	0.2260	52.7	01Jan2011, 06:13	5.3
JET110	2.0541	86.0	01Jan2011, 06:13	38.4
RET120	2.0541	85.1	01Jan2011, 06:19	38.1
ET120	0.1091	23.5	01Jan2011, 06:16	2.5
JET120	2.1632	107.9	01Jan2011, 06:19	40.7
RET152	2.1632	107.7	01Jan2011, 06:25	40.4
ET130	0.1348	23.2	01Jan2011, 06:30	3.5
JET130	0.1348	23.2	01Jan2011, 06:30	3.5
RET140	0.1348	23.1	01Jan2011, 07:00	3.5
ET140	0.2676	33.4	01Jan2011, 06:49	6.9
JET140	0.4024	55.3	01Jan2011, 06:56	10.4
RET154	0.4024	55.2	01Jan2011, 07:19	10.3
JET152	2.5656	108.6	01Jan2011, 06:26	50.8
RET156	2.5656	108.3	01Jan2011, 06:30	50.6
ET150	0.1777	36.6	01Jan2011, 06:20	4.4

## HEC-HMS 5-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
JET154	2.7433	138.8	01Jan2011, 06:29	55
RET162	2.7433	135.5	01Jan2011, 06:54	54.2
ET160	0.1889	38.5	01Jan2011, 06:25	5.2
JET160	2.9322	154.7	01Jan2011, 06:53	59.4
RET164	2.9322	154.3	01Jan2011, 06:58	59.2
WT350	0.3038	78.7	01Jan2011, 06:16	8.4
JWT352	9.6791	337.2	01Jan2011, 08:17	232.8
RWT354	9.6791	337.2	01Jan2011, 08:17	232.8
WT330	0.3267	68.2	01Jan2011, 06:21	8.5
JWT330	0.3267	68.2	01Jan2011, 06:21	8.5
RWT344	0.3267	67.9	01Jan2011, 06:30	8.5
WT340	0.2780	40.0	01Jan2011, 06:39	7.2
JWT354	10.2838	361.9	01Jan2011, 07:18	248.4
RWT372	10.2838	361.5	01Jan2011, 07:22	247.8
WT360	0.0657	14.8	01Jan2011, 06:17	1.6
JWT360	0.0657	14.8	01Jan2011, 06:17	1.6
RWT374	0.0657	14.7	01Jan2011, 06:32	1.6
Regional Pond R2	10.3495	363.1	01Jan2011, 07:24	246.2
JWT372	10.3495	363.1	01Jan2011, 07:24	246.2
RWT376	10.3495	361.7	01Jan2011, 07:34	245
WT370	0.2148	23.4	01Jan2011, 06:15	2.8
JWT374_OUTLET	10.5642	364.8	01Jan2011, 07:34	247.8
FS010	0.1220	16.6	01Jan2011, 06:18	2.1
JFS010_OUTLET	0.1220	16.6	01Jan2011, 06:18	2.1



Project: Aug15\_Working\_Falcon\_DBPS\_S  
Simulation Run: FU 5-yr Reservoir: Sub Regional Pond SR4

Start of Run:	01Jan2011, 00:00	Basin Model:	Falcon_DBPS_Future
End of Run:	02Jan2011, 00:00	Meteorologic Model:	5-yr
Compute Time:	28Jul2020, 17:53:20	Control Specifications:	24-hr Storm

Volume Units: AC-FT

#### Computed Results

Peak Inflow :	293.0 (CFS)	Date/Time of Peak Inflow :	01Jan2011, 06:29
Peak Outflow :	132.7 (CFS)	Date/Time of Peak Outflow :	01Jan2011, 06:52
Total Inflow :	37.5 (AC-FT)	Peak Storage :	9.1 (AC-FT)
Total Outflow :	35.1 (AC-FT)	Peak Elevation :	6896.8 (FT)

Project: Aug15\_Working\_Falcon\_DBPS\_S  
Simulation Run: FU 5-yr Reservoir: Regional Pond MN

Start of Run:	01Jan2011, 00:00	Basin Model:	Falcon_DBPS_Future
End of Run:	02Jan2011, 00:00	Meteorologic Model:	5-yr
Compute Time:	28Jul2020, 17:53:20	Control Specifications:	24-hr Storm

Volume Units: AC-FT

#### Computed Results

Peak Inflow :	158.7 (CFS)	Date/Time of Peak Inflow :	01Jan2011, 06:59
Peak Outflow :	151.6 (CFS)	Date/Time of Peak Outflow :	01Jan2011, 07:04
Total Inflow :	46.6 (AC-FT)	Peak Storage :	3.4 (AC-FT)
Total Outflow :	44.1 (AC-FT)	Peak Elevation :	6851.9 (FT)

## HEC-HMS 2-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
WT020	0.0671	4.4	01Jan2011, 06:25	0.7
JWT020	0.0671	4.4	01Jan2011, 06:25	0.7
RWT030	0.0671	4.4	01Jan2011, 06:39	0.7
WT030	0.0765	8.6	01Jan2011, 06:09	0.8
JWT030	0.1436	8.7	01Jan2011, 06:09	1.5
RWT042	0.1436	8.7	01Jan2011, 06:20	1.5
WT010	0.1353	8.8	01Jan2011, 06:21	1.3
JWT010	0.1353	8.8	01Jan2011, 06:21	1.3
RWT044	0.1353	8.8	01Jan2011, 06:33	1.3
JWT042	0.2789	15.1	01Jan2011, 06:26	2.8
RWT046	0.2789	15.1	01Jan2011, 06:40	2.8
WT040	0.1851	9.1	01Jan2011, 06:34	1.8
JWT044	0.4640	23.9	01Jan2011, 06:39	4.5
RWT054	0.4640	23.8	01Jan2011, 06:50	4.5
WT060	0.1956	13.6	01Jan2011, 06:30	2.3
WT050	0.1899	17.3	01Jan2011, 06:23	2.4
JWT050	0.8496	42.8	01Jan2011, 06:47	9.3
RWT092	0.8496	42.7	01Jan2011, 06:49	9.3
WT070	0.1711	13.6	01Jan2011, 06:15	1.6
JWT070	0.1711	13.6	01Jan2011, 06:15	1.6
RWT080	0.1711	13.6	01Jan2011, 06:34	1.6
WT080	0.0692	8.7	01Jan2011, 06:13	0.9
Sub Regional Pond SR1	1.0898	41.9	01Jan2011, 07:03	10.4
JWT080	1.0898	41.9	01Jan2011, 07:03	10.4
RWT094	1.0898	41.9	01Jan2011, 07:14	10.3
WT100-REV	0.1293	37.0	01Jan2011, 06:05	2.5
W26-REV	0.0720	18.4	01Jan2011, 06:04	1.2
WS3-1	0.0720	18.1	01Jan2011, 06:15	1.2
Paint Brush Hills Pond C	0.2013	10.4	01Jan2011, 06:34	3.7
WT090	0.1533	22.1	01Jan2011, 06:11	2.1
JWT090	1.4444	54.5	01Jan2011, 07:12	16.1
RWT122	1.4444	54.5	01Jan2011, 07:17	16.1
WT110	0.1943	22.3	01Jan2011, 06:17	2.7
JWT110	1.6387	58.6	01Jan2011, 07:16	18.7
RWT124	1.6387	58.6	01Jan2011, 07:26	18.7
WT130-REV	0.1016	24.0	01Jan2011, 06:13	2.3
Paint Brush Hills Pond A	0.1016	4.8	01Jan2011, 06:53	2.3
WT120-REV	0.0430	7.2	01Jan2011, 06:09	0.6
JWT120	1.7834	63.9	01Jan2011, 07:26	21.6
RWT172	1.7834	63.8	01Jan2011, 07:38	21.5
WT140-REV	0.1445	35.7	01Jan2011, 06:14	3.6
JWT140	0.1445	35.7	01Jan2011, 06:14	3.6

## HEC-HMS 2-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
RWT150	0.1445	35.5	01Jan2011, 06:25	3.6
WT150-REV	0.1308	40.8	01Jan2011, 06:09	3.3
Paint Brush Hills Pond B1	0.2753	58.7	01Jan2011, 06:19	6.8
W34B2-REV	0.0936	27.9	01Jan2011, 06:08	2.2
Paint Brush Hills Pond B2	0.3689	9.8	01Jan2011, 07:30	8
JWT150	0.3689	9.8	01Jan2011, 07:30	8
RWT160	0.3689	9.8	01Jan2011, 07:40	8
WT160-REV	0.0735	19.7	01Jan2011, 06:07	1.5
JWT160	0.4424	20.1	01Jan2011, 06:07	9.5
RWT174	0.4424	19.8	01Jan2011, 06:23	9.4
WT170-REV	0.1060	11.6	01Jan2011, 06:22	1.6
W34-CY-REV	0.0465	5.2	01Jan2011, 06:19	0.6
JWT172	2.3783	81.2	01Jan2011, 06:39	33.1
RWT176	2.3783	81.1	01Jan2011, 06:40	33.1
Sub Regional Pond SR2	2.3783	66.8	01Jan2011, 08:06	30
JWT174	2.3783	66.8	01Jan2011, 08:06	30
RWT180	2.3783	66.8	01Jan2011, 08:25	29.7
WT180-REV	0.0409	3.4	01Jan2011, 06:22	0.5
JWT180	2.4193	67.2	01Jan2011, 08:25	30.2
RWT202	2.4193	67.1	01Jan2011, 08:51	29.9
WT200	0.3017	25.3	01Jan2011, 06:34	4.4
WT190	0.0575	11.3	01Jan2011, 06:07	0.9
The Meadows Pond #1	0.0575	0.3	01Jan2011, 13:19	0.4
JWT190	0.0575	0.3	01Jan2011, 13:19	0.4
RWT204	0.0575	0.3	01Jan2011, 14:16	0.4
JWT200	2.7784	70.6	01Jan2011, 08:50	34.8
RWT210	2.7784	70.6	01Jan2011, 09:00	34.6
WT210	0.2655	31.9	01Jan2011, 06:39	5.6
JWT210	3.0439	74.5	01Jan2011, 08:59	40.2
RWT232	3.0439	74.5	01Jan2011, 09:08	40
WT220	0.1895	47.1	01Jan2011, 06:14	4.5
JWT220	0.1895	47.1	01Jan2011, 06:14	4.5
RWT234	0.1895	46.9	01Jan2011, 06:26	4.5
JWT232	3.2334	76.6	01Jan2011, 09:08	44.5
RWT236	3.2334	76.6	01Jan2011, 09:09	44.5
WT230	0.1982	71.3	01Jan2011, 06:06	5
JWT234	3.4316	84.5	01Jan2011, 06:43	49.5
RWT240	3.4316	84.0	01Jan2011, 06:48	49.4
WT240	0.0761	36.4	01Jan2011, 06:02	2.1
Regional Pond WU North	3.5078	89.8	01Jan2011, 06:10	50.3
Regional Pond WU Diversion	3.5078	62.4	01Jan2011, 06:10	27.5
Old Meridian	0.0336	24.6	01Jan2011, 06:09	1.9

## HEC-HMS 2-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
RWT-OM	0.0336	24.3	01Jan2011, 06:16	1.8
Regional Pond WU South	3.5413	31.1	01Jan2011, 10:35	19.2
RWT240_Diversion Reach	0.0000	27.1	01Jan2011, 06:16	22.8
JWT240	3.5413	51.8	01Jan2011, 10:19	42
RWT250	3.5413	51.8	01Jan2011, 10:20	42
WT250	0.1470	63.0	01Jan2011, 06:03	3.7
JWT250	3.6883	63.4	01Jan2011, 06:03	45.7
RWT260	3.6883	61.1	01Jan2011, 06:24	45.4
WT260	0.1388	9.9	01Jan2011, 06:38	1.9
JWT260	3.8271	69.2	01Jan2011, 06:24	47.3
RWT291	3.8271	68.9	01Jan2011, 06:29	47.1
WT270	0.0325	11.3	01Jan2011, 06:05	0.7
JWT270	0.0325	11.3	01Jan2011, 06:05	0.7
RWT292	0.0325	11.2	01Jan2011, 06:11	0.7
JWT292	3.8596	71.9	01Jan2011, 06:29	47.9
RWT295	3.8596	71.5	01Jan2011, 06:31	47.8
WT280	0.2670	33.4	01Jan2011, 06:15	3.7
JWT280	0.2670	33.4	01Jan2011, 06:15	3.7
RWT294	0.2670	33.4	01Jan2011, 06:18	3.7
JWT294	4.1265	94.0	01Jan2011, 06:30	51.5
RWT296	4.1265	91.9	01Jan2011, 06:40	51.2
MT040	0.3084	94.6	01Jan2011, 06:13	8.8
MT030	0.1566	39.0	01Jan2011, 06:06	2.8
MT020	0.0902	25.8	01Jan2011, 06:05	1.7
JMT020	0.0902	25.8	01Jan2011, 06:05	1.7
RMT030	0.0902	25.4	01Jan2011, 06:20	1.7
JMT030	0.2468	50.1	01Jan2011, 06:10	4.5
RMT040	0.2468	49.3	01Jan2011, 06:16	4.5
Woodmen Hills Pond H	0.5553	107.8	01Jan2011, 06:25	13.2
JMT040	0.5553	107.8	01Jan2011, 06:25	13.2
RMT050	0.5553	107.4	01Jan2011, 06:28	13.2
MT050	0.1186	17.0	01Jan2011, 06:21	2.1
JMT050	0.6739	123.1	01Jan2011, 06:27	15.3
RMT064	0.6739	121.2	01Jan2011, 06:40	15.2
MT010	0.2899	27.9	01Jan2011, 06:27	4.3
The Meadows Pond #2	0.2899	5.4	01Jan2011, 07:46	3.1
JMT010	0.2899	5.4	01Jan2011, 07:46	3.1
RMT062	0.2899	5.4	01Jan2011, 08:25	3
MT060a	0.0300	8.0	01Jan2011, 06:04	0.5
School Site	0.0300	0.0	01Jan2011, 00:00	0
RMT060a	0.0300	0.0	01Jan2011, 00:00	0
MT060	0.1595	30.9	01Jan2011, 06:10	2.7

## HEC-HMS 2-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
Sub Regional Pond SR4	1.1533	24.3	01Jan2011, 08:22	19.2
JMT060	1.1533	24.3	01Jan2011, 08:22	19.2
RMT070	1.1533	24.3	01Jan2011, 08:31	19.1
MT070	0.1995	26.4	01Jan2011, 06:25	3.7
JMT070	1.3527	28.4	01Jan2011, 06:27	22.8
RMT080	1.3527	28.4	01Jan2011, 06:30	22.8
MT080	0.0638	62.4	01Jan2011, 06:00	3.4
Regional Pond MN	1.4166	30.5	01Jan2011, 06:38	23.7
JMT080	1.4166	30.5	01Jan2011, 06:38	23.7
RMT102	1.4166	30.4	01Jan2011, 06:49	23.6
MT090	0.0435	39.9	01Jan2011, 06:00	2.1
Woodmen Hills Pond #5	0.0435	1.4	01Jan2011, 08:02	1.5
JMT090	0.0435	1.4	01Jan2011, 08:02	1.5
RMT090	0.0435	1.4	01Jan2011, 08:02	1.5
JMT104	0.0435	1.4	01Jan2011, 08:02	1.5
RMT104	0.0435	1.4	01Jan2011, 08:09	1.5
JMT102	1.4601	31.8	01Jan2011, 06:49	25.1
RMT106	1.4601	31.5	01Jan2011, 06:52	25.1
MT100	0.0558	16.5	01Jan2011, 06:06	1.2
JMT106	1.5158	33.2	01Jan2011, 06:52	26.3
RMT112	1.5158	32.7	01Jan2011, 07:30	25.7
MT110	0.1164	18.9	01Jan2011, 06:19	2.2
JMT110	1.6322	35.5	01Jan2011, 07:30	27.9
RMT114	1.6322	35.4	01Jan2011, 07:40	27.7
WT290	0.1038	15.0	01Jan2011, 06:11	1.4
Regional Pond R1	5.8625	84.8	01Jan2011, 10:59	73.4
JWT296	5.8625	84.8	01Jan2011, 10:59	73.4
RWT314	5.8625	84.8	01Jan2011, 11:10	72.9
WT300	0.0970	12.2	01Jan2011, 06:15	1.3
JWT300	0.0970	12.2	01Jan2011, 06:15	1.3
RWT312	0.0970	12.1	01Jan2011, 06:39	1.3
WT310	0.2774	31.3	01Jan2011, 06:16	3.6
JWT310	6.2370	86.9	01Jan2011, 11:09	77.8
RWT320	6.2370	86.8	01Jan2011, 11:19	77.2
WT320	0.2061	26.8	01Jan2011, 06:14	2.8
JWT320	6.4431	88.0	01Jan2011, 11:19	80
RWT352	6.4431	88.0	01Jan2011, 11:31	79.4
ET020	0.2132	73.4	01Jan2011, 06:07	5.4
ET010	0.1451	37.5	01Jan2011, 06:12	3.5
Paint Brush Hills Pond #4	0.1451	29.4	01Jan2011, 06:21	3.5
JET010	0.1451	29.4	01Jan2011, 06:21	3.5
RET020	0.1451	29.3	01Jan2011, 06:37	3.5

## HEC-HMS 2-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
Sub Regional Pond SR6	0.3583	9.3	01Jan2011, 07:43	7.9
JET020	0.3583	9.3	01Jan2011, 07:43	7.9
RET030	0.3583	9.3	01Jan2011, 08:37	7.6
ET030	0.2043	44.9	01Jan2011, 06:17	4.9
JET030	0.5626	44.9	01Jan2011, 06:17	12.5
RET040	0.5626	44.6	01Jan2011, 06:30	12.4
Woodmen Hills Pond #1 North	0.7117	60.8	01Jan2011, 06:33	15.4
ET040	0.1491	27.9	01Jan2011, 06:16	3
Woodmen Hills Pond #1 South	0.7117	9.6	01Jan2011, 12:57	12
JET040	0.7117	9.6	01Jan2011, 12:57	12
RET050	0.7117	9.6	01Jan2011, 13:08	11.8
ET050	0.1172	36.5	01Jan2011, 06:03	2.2
Woodmen Hills Pond #2	0.8289	10.4	01Jan2011, 13:06	12.5
JET050	0.8289	10.4	01Jan2011, 13:06	12.5
RET060	0.8289	10.4	01Jan2011, 13:21	12.3
ET060	0.2854	105.0	01Jan2011, 06:02	5.8
Woodmen Hills Pond #3	1.1143	12.6	01Jan2011, 13:03	15.7
JET060	1.1143	12.6	01Jan2011, 13:03	15.7
RET070	1.1143	12.6	01Jan2011, 13:18	15.5
ET070	0.2498	93.5	01Jan2011, 06:03	5.7
JET070	1.3641	93.6	01Jan2011, 06:03	21.2
RET080	1.3641	64.9	01Jan2011, 06:31	20.7
ET080	0.2916	113.3	01Jan2011, 06:08	8.7
Woodmen Hills Pond #4	1.6557	9.8	02Jan2011, 00:00	12
JET080	1.6557	9.8	02Jan2011, 00:00	12
RET090	1.6557	9.8	02Jan2011, 00:00	11.9
ET090	0.1242	26.0	01Jan2011, 06:24	3.3
JET090	1.7800	29.2	01Jan2011, 06:25	15.3
RET100	1.7800	29.1	01Jan2011, 06:30	15.2
ET100	0.0481	11.4	01Jan2011, 06:02	0.7
JET100	1.8280	30.6	01Jan2011, 06:30	15.8
RET110	1.8280	30.6	01Jan2011, 06:38	15.7
ET110	0.2260	24.0	01Jan2011, 06:15	2.7
JET110	2.0541	41.4	01Jan2011, 06:32	18.4
RET120	2.0541	41.4	01Jan2011, 06:39	18.2
ET120	0.1091	10.7	01Jan2011, 06:17	1.3
JET120	2.1632	49.7	01Jan2011, 06:21	19.5
RET152	2.1632	49.5	01Jan2011, 06:29	19.4
ET130	0.1348	10.9	01Jan2011, 06:31	1.8
JET130	0.1348	10.9	01Jan2011, 06:31	1.8
RET140	0.1348	10.9	01Jan2011, 07:06	1.8
ET140	0.2676	15.9	01Jan2011, 06:51	3.6

## HEC-HMS 2-YEAR SUMMARY TABLE

Hydrologic Element	Drainage Area (MI <sup>2</sup> )	Peak Discharge (CFS)	Time of Peak	Volume (AC-FT)
JET140	0.4024	25.8	01Jan2011, 07:01	5.5
RET154	0.4024	25.7	01Jan2011, 07:27	5.4
JET152	2.5656	53.7	01Jan2011, 07:01	24.8
RET156	2.5656	53.5	01Jan2011, 07:06	24.7
ET150	0.1777	17.0	01Jan2011, 06:21	2.3
JET154	2.7433	62.3	01Jan2011, 06:34	27
RET162	2.7433	59.6	01Jan2011, 07:07	26.4
ET160	0.1889	18.6	01Jan2011, 06:26	2.8
JET160	2.9322	66.8	01Jan2011, 07:06	29.2
RET164	2.9322	66.5	01Jan2011, 07:12	29.1
WT350	0.3038	38.3	01Jan2011, 06:17	4.5
JWT352	9.6791	134.2	01Jan2011, 08:21	112.9
RWT354	9.6791	134.2	01Jan2011, 08:22	112.9
WT330	0.3267	32.2	01Jan2011, 06:23	4.5
JWT330	0.3267	32.2	01Jan2011, 06:23	4.5
RWT344	0.3267	32.0	01Jan2011, 06:34	4.5
WT340	0.2780	18.9	01Jan2011, 06:42	3.8
JWT354	10.2838	143.0	01Jan2011, 08:21	121.2
RWT372	10.2838	142.9	01Jan2011, 08:26	120.7
WT360	0.0657	6.9	01Jan2011, 06:18	0.8
JWT360	0.0657	6.9	01Jan2011, 06:18	0.8
RWT374	0.0657	6.9	01Jan2011, 06:36	0.8
Regional Pond R2	10.3495	143.5	01Jan2011, 08:28	118.4
JWT372	10.3495	143.5	01Jan2011, 08:28	118.4
RWT376	10.3495	143.3	01Jan2011, 08:37	117.6
WT370	0.2148	7.2	01Jan2011, 06:17	1.2
JWT374_OUTLET	10.5642	144.1	01Jan2011, 08:37	118.8
FS010	0.1220	6.3	01Jan2011, 06:20	1
JFS010_OUTLET	0.1220	6.3	01Jan2011, 06:20	1



Project: Aug15\_Working\_Falcon\_DBPS\_S  
Simulation Run: FU 2-yr Reservoir: Sub Regional Pond SR4

Start of Run:	01Jan2011, 00:00	Basin Model:	Falcon_DBPS_Future
End of Run:	02Jan2011, 00:00	Meteorologic Model:	2-yr
Compute Time:	28Jul2020, 17:06:15	Control Specifications:	24-hr Storm

Volume Units: AC-FT

#### Computed Results

Peak Inflow :	128.2 (CFS)	Date/Time of Peak Inflow :	01Jan2011, 06:40
Peak Outflow :	24.3 (CFS)	Date/Time of Peak Outflow :	01Jan2011, 08:22
Total Inflow :	20.9 (AC-FT)	Peak Storage :	7.3 (AC-FT)
Total Outflow :	19.2 (AC-FT)	Peak Elevation :	6896.6 (FT)

Project: Aug15\_Working\_Falcon\_DBPS\_S  
Simulation Run: FU 2-yr Reservoir: Regional Pond MN

Start of Run:	01Jan2011, 00:00	Basin Model:	Falcon_DBPS_Future
End of Run:	02Jan2011, 00:00	Meteorologic Model:	2-yr
Compute Time:	28Jul2020, 17:06:15	Control Specifications:	24-hr Storm

Volume Units: AC-FT

#### Computed Results

Peak Inflow :	64.9 (CFS)	Date/Time of Peak Inflow :	01Jan2011, 06:01
Peak Outflow :	30.5 (CFS)	Date/Time of Peak Outflow :	01Jan2011, 06:38
Total Inflow :	26.2 (AC-FT)	Peak Storage :	2.6 (AC-FT)
Total Outflow :	23.7 (AC-FT)	Peak Elevation :	6851.5 (FT)

**APPENDIX C**  
**Hydraulic Computations**

## Worksheet for Ex Channel Capacity Check

### Project Description

Friction Method	Manning Formula
Solve For	Discharge

### Input Data

Roughness Coefficient	0.035
Channel Slope	1.75 %
Normal Depth	3.00 ft
Left Side Slope	4.00 ft/ft (H:V)
Right Side Slope	4.00 ft/ft (H:V)

### Results

Discharge	259.64	ft <sup>3</sup> /s
Flow Area	36.00	ft <sup>2</sup>
Wetted Perimeter	24.74	ft
Hydraulic Radius	1.46	ft
Top Width	24.00	ft
Critical Depth	3.05	ft
Critical Slope	0.01616	ft/ft
Velocity	7.21	ft/s
Velocity Head	0.81	ft
Specific Energy	3.81	ft
Froude Number	1.04	
Flow Type	Supercritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	3.00	ft
Critical Depth	3.05	ft
Channel Slope	1.75	%
Critical Slope	0.01616	ft/ft

## Worksheet for Ex Channel - Pr DBPS 100 Yr Flow

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.035	
Channel Slope	1.75	%
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Discharge	850.00	ft³/s

### Results

Normal Depth	4.68	ft
Flow Area	87.61	ft²
Wetted Perimeter	38.59	ft
Hydraulic Radius	2.27	ft
Top Width	37.44	ft
Critical Depth	4.89	ft
Critical Slope	0.01379	ft/ft
Velocity	9.70	ft/s
Velocity Head	1.46	ft
Specific Energy	6.14	ft
Froude Number	1.12	
Flow Type	Supercritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	4.68	ft
Critical Depth	4.89	ft
Channel Slope	1.75	%
Critical Slope	0.01379	ft/ft

## Worksheet for Fut Channel - Pr DBPS 100 Yr Flow

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.035	
Channel Slope	0.30	%
Left Side Slope	4.00	ft/ft (H:V)
Right Side Slope	4.00	ft/ft (H:V)
Bottom Width	15.00	ft
Discharge	850.00	ft³/s

### Results

Normal Depth	4.95	ft
Flow Area	172.40	ft²
Wetted Perimeter	55.84	ft
Hydraulic Radius	3.09	ft
Top Width	54.62	ft
Critical Depth	3.43	ft
Critical Slope	0.01384	ft/ft
Velocity	4.93	ft/s
Velocity Head	0.38	ft
Specific Energy	5.33	ft
Froude Number	0.49	
Flow Type	Subcritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	4.95	ft
Critical Depth	3.43	ft
Channel Slope	0.30	%

---

Worksheet for Fut Channel - Pr DBPS 100 Yr Flow

---

GVF Output Data

Critical Slope 0.01384 ft/ft





North American Green  
 5401 St. Wendel-Cynthiana Rd.  
 Poseyville, Indiana 47633  
 Tel. 800.772.2040  
 >Fax 812.867.0247  
 www.nagreen.com  
 ECMDS v7.0

## ANALYSIS COMPUTATIONS

> > > [View Computation](#)

Inputs	
Channel Discharge (Q):	850 cfs
Peak Flow Period (H):	hours
Channel Slope (So):	0.0175 ft/ft
Bottom Width (B):	0 ft
Left Side Slope (ZL):	4 (H : V)
Right Side Slope (ZR):	4 (H : V)
Existing Channel Bend:	No
Bend Coefficient (Kb):	1
Channel Bend Radius:	
Retardance Class of Vegetation:	C 6-12 in
Vegetation Type:	Bunch Type
Vegetation Density:	Fair 50-64%
Soil Type:	Sandy Loam (GM)
Channel Lining Options	
P550 Protection Type	Permanent

Basic Relationships
$A = \text{Cross sectional area, ft}^2 \text{ (m}^2\text{)} = (B * D) + (Z_L / 2 * D^2) + (Z_R / 2 * D^2)$
Where:
B = Base width of channel, ft (m)
D = Flow depth, ft (m)
ZL = Left side bank slope (H : 1 V)
ZR = Right side bank slope (H : 1 V)
$P = \text{Wetted perimeter, ft (m)} = B + Z_L * D + Z_R * D$
$R = \text{Hydraulic radius, ft (m)} = A / P$
$V = \text{Flow velocity, ft/s (m/s)} = Q / A$
Where:
Q = Channel discharge, cfs (cms)
$\text{Tau}_a = \text{Average bed shear stress, psf (Pa)} = 62.4 * R * S_o$
Where:
S_o = Gradient of channel, ft/ft (m/m)
$\text{Tau}_0 = \text{Maximum bed shear stress, psf (Pa)} = 62.4 * D * S_o$

Unvegetated Conditions Computations:
$n = \text{Manning's } n = a * \text{Tau}_a^b$
<u>and (iteratively solved)</u>
$n = 1.486 / Q * A * R^{(2/3)} S_o^{0.5}$
Where:
n = Manning's n
a = Product specific coefficient from performance testing
b = Product specific coefficient from performance testing
$\text{SF}_P = \text{Product factor of safety} = \text{Tau}_t / \text{Tau}_0$

Where:
$\tau_{ut}$ = Permissible shear stress from testing, psf (Pa)
$\tau_{up}$ = In place permissible shear, psf (Pa) = $\tau_{ut} / \alpha * (\tau_{us} + \alpha / 4.3)$
Where:
$\alpha$ = unit conversion constant, 0.14 English, 6.5 Metric
$\tau_{us}$ = Permissible shear stress of soil
SFL = Factor of safety of installed liner = $\tau_{up} / \tau_{ua}$

Vegetated Computations:
$n$ = Manning's $n = \alpha * C_n * \tau_{ua}^{-0.4}$
and (iteratively solved)
$n = 1.486 / Q * A * R^{(2/3)} S_0^{0.5}$
Where:
$\alpha$ = Unit conversion constant, 0.213 English, 1.0 Metric
$C_n$ = Vegetation retardance coefficient
SFP = Product factor of safety = $\tau_{utv} / \tau_{uo}$
Where:
$\tau_{utv}$ = Permissible shear stress from testing, psf (Pa)
$\tau_{up}$ = In place permissible shear, psf (Pa) = $\tau_{us} / (1 - C_{TRM}) * (n / n_s)^2$
Where:
$C_{TRM}$ = Coefficient of TRM performance derived from testing $\tau_{us}$ = Permissible shear stress of soil
$n_s$ = Manning's of soil bed if left unprotected
SFL = Factor of safety of installed liner = $\tau_{up} / \tau_{ua}$

#### P550

Phase	Mannings N	Predicted flow depth (D)	Cross sectional area (A)	Wetted perimeter (P)	Hydraulic radius (R)	Flow velocity (V)	Froude number (FR)	Calculated Shear Stress	SFP/SFL
P550 Unvegetated	0.035	4.68 ft	87.61 ft <sup>2</sup>	38.59 ft	2.27 ft	9.7 ft/s	1.14	5.11 lbs/ft <sup>2</sup>	0.63 (SFP)
Underlying Substrate	0.035	4.68 ft	87.61 ft <sup>2</sup>	38.59 ft	2.27 ft	9.7 ft/s	1.14	2.48 lbs/ft <sup>2</sup>	1.22 (SFL)
P550 Reinforced Vegetation	0.035	4.68 ft	87.61 ft <sup>2</sup>	38.59 ft	2.27 ft	9.7 ft/s	1.14	5.11 lbs/ft <sup>2</sup>	2.74 (SFP)
Underlying Substrate	0.035	4.68 ft	87.61 ft <sup>2</sup>	38.59 ft	2.27 ft	9.7 ft/s	1.14	2.48 lbs/ft <sup>2</sup>	1.29 (SFL)



## Specification Sheet – VMax® P550® Turf Reinforcement Mat

### DESCRIPTION

The composite turf reinforcement mat (C-TRM) shall be a machine-produced mat of 100% UV stable polypropylene fiber matrix incorporated into permanent three-dimensional turf reinforcement matting. The matrix shall be evenly distributed across the entire width of the matting and stitch bonded between a ultra heavy duty UV stabilized nettings with 0.50 x 0.50 inch (1.27 x 1.27 cm) openings, an ultra heavy UV stabilized, dramatically corrugated (crimped) intermediate netting with 0.5 x 0.5 inch (1.27 x 1.27 cm) openings, and covered by an ultra heavy duty UV stabilized nettings with 0.50 x 0.50 inch (1.27 x 1.27 cm) openings. The middle corrugated netting shall form prominent closely spaced ridges across the entire width of the mat. The three nettings shall be stitched together on 1.50 inch (3.81cm) centers with UV stabilized polypropylene thread to form permanent three-dimensional turf reinforcement matting. All mats shall be manufactured with a colored thread stitched along both outer edges as an overlap guide for adjacent mats.

The P550 shall meet Type 5A, 5B, and 5C specification requirements established by the Erosion Control Technology Council (ECTC) and Federal Highway Administration's (FHWA) FP-03 Section 713.18

### Material Content

<b>Matrix</b>	100% UV stable polypropylene fiber	0.5 lb/sy (0.27 kg/sm)
<b>Netting</b>	Top and Bottom, UV-Stabilized Polypropylene	24 lb/1000 sf (11.7 kg/100 sm)
	Middle, Corrugated UV-Stabilized Polypropylene	24 lb/1000 sf (11.7 kg/100 sm)
<b>Thread</b>	Polypropylene, UV Stable	

### Standard Roll Sizes

<b>Width</b>	6.5 ft (2.0 m)
<b>Length</b>	55.5 ft (16.9 m)
<b>Weight ± 10%</b>	52 lbs (23.59 kg)
<b>Area</b>	40 sy (33.4 sm)

Index Property	Test Method	Typical
<b>Thickness</b>	ASTM D6525	0.72 in. (18.29 mm)
<b>Resiliency</b>	ASTM 6524	95%
<b>Density</b>	ASTM D792	0.892 g/cm <sup>3</sup>
<b>Mass/Unit Area</b>	ASTM 6566	21.25 oz/sy (723 g/sm)
<b>UV Stability</b>	ASTM D4355/ 1000 HR	100%
<b>Porosity</b>	ECTC Guidelines	96%
<b>Stiffness</b>	ASTM D1388	366.3 oz-in.
<b>Light Penetration</b>	ASTM D6567	16.5%
<b>Tensile Strength – MD</b>	ASTM D6818	1421 lbs/ft (21.07 kN/m)
<b>Elongation – MD</b>	ASTM D6818	40.5%
<b>Tensile Strength – TD</b>	ASTM D6818	1191.6 lbs/ft (17.67 kN/m)
<b>Elongation – TD</b>	ASTM D6818	28.8%
<b>Biomass Improvement</b>	ASTM D7322	378%

### Design Permissible Shear Stress

	Short Duration	Long Duration
<b>Phase 1: Unvegetated</b>	4.0 psf (191 Pa)	3.25 psf (156 Pa)
<b>Phase 2: Partially Veg.</b>	12.0 psf (576 Pa)	12.0 psf (576 Pa)
<b>Phase 3: Fully Veg.</b>	14.0 psf (672 Pa)	12.0 psf (576 Pa)
<b>Unvegetated Velocity</b>	12.5 fps (3.8 m/s)	
<b>Vegetated Velocity</b>	25 fps (7.6 m/s)	

### NTPEP ASTM D6460 Large Scale Channel

<b>Vegetated Shear Stress</b>	>13.2 psf (632 Pa)
<b>Vegetated Velocity</b>	>24.5 fps (7.47 m/s)

### Slope Design Data: C Factors

Slope Length (L)	Slope Gradients (S)		
	≤ 3:1	3:1 – 2:1	≥ 2:1
≤ 20 ft (6 m)	0.0005	0.015	0.043
20-50 ft	0.0173	0.031	0.050
≥ 50 ft (15.2 m)	0.035	0.047	0.057

### Roughness Coefficients – Unveg.

Flow Depth	Manning's n
≤ 0.50 ft (0.15 m)	0.041
0.50 – 2.0 ft	0.040-0.013
≥ 2.0 ft (0.60 m)	0.013

**Tensar**®

**NORTH AMERICAN GREEN®**

Tensar International Corporation  
2500 Northwinds Parkway  
Suite 500  
Alpharetta, GA 30009  
800-TENSAR-1  
tensarcorp.com

Tensar International Corporation warrants that at the time of delivery the product furnished hereunder shall conform to the specification stated herein. Any other warranty including merchantability and fitness for a particular purpose, are hereby executed. If the product does not meet specifications on this page and Tensar is notified prior to installation, Tensar will replace the product at no cost to the customer. **This product specification supersedes all prior specifications for the product described above and is not applicable to any products shipped prior to January 1, 2012.**

©2013, Tensar International Corporation

EC\_RMX\_MPDS\_VMP550\_5.13

# **HY-8 Culvert Analysis Report**

**Crossing Discharge Data**

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 0 cfs

Design Flow: 143 cfs

Maximum Flow: 143 cfs

**Table 1 - Summary of Culvert Flows at Crossing: Bent Grass & Meridian Existing Ex**

Headwater Elevation (ft)	Total Discharge (cfs)	Ex Culverts - Ex Pipe Capacity Discharge (cfs)	Roadway Discharge (cfs)	Iterations
6928.05	0.00	0.00	0.00	1
6929.11	14.30	14.30	0.00	1
6929.47	28.60	28.60	0.00	1
6929.76	42.90	42.90	0.00	1
6930.02	57.20	57.20	0.00	1
6930.29	71.50	71.50	0.00	1
6930.56	85.80	85.80	0.00	1
6930.86	100.10	100.10	0.00	1
6931.18	114.40	114.40	0.00	1
6931.53	128.70	128.70	0.00	1
6931.90	143.00	143.00	0.00	1
6931.90	143.03	143.03	0.00	Overtopping

**Pipe Cap Check**

Rating Curve Plot for Crossing: Bent Grass & Meridian Existing Ex Pipe Cap Check

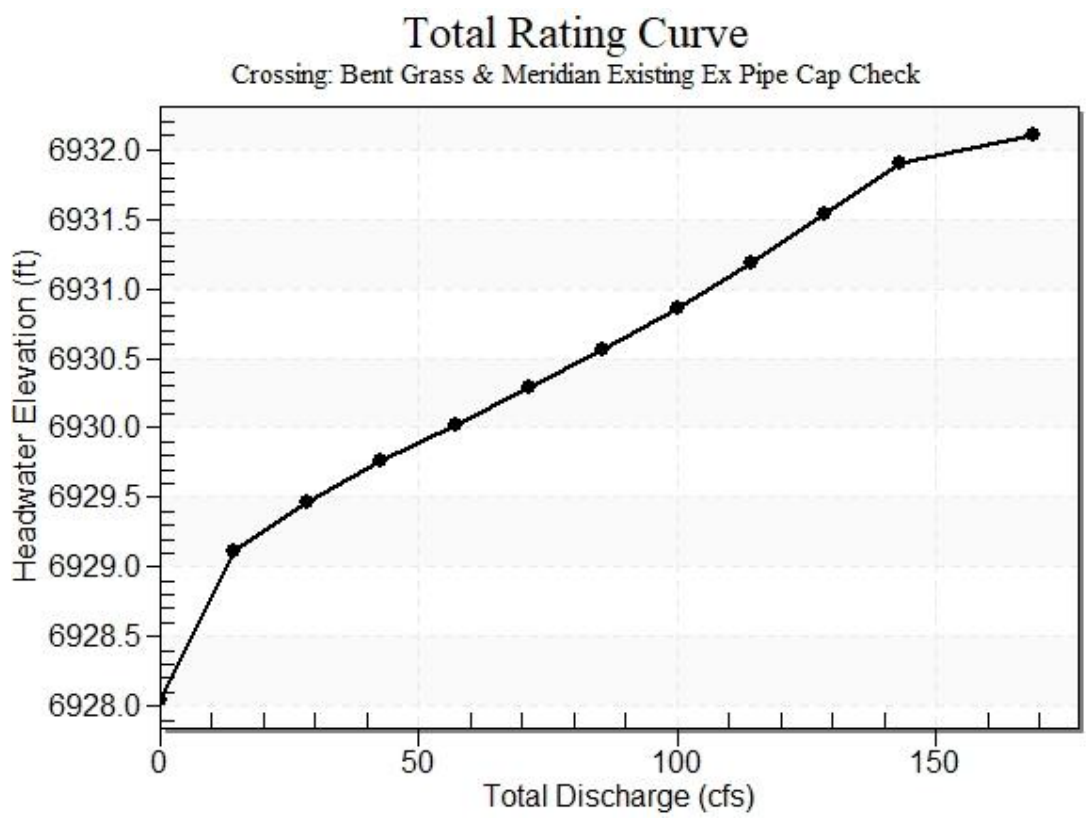




Table 2 - Culvert Summary Table: Ex Culverts - Ex Pipe Capacity

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
0.00	0.00	6928.05	0.000	0.000	0-NF	0.000	0.000	0.710	0.000	0.000	0.000
14.30	14.30	6929.11	0.753	1.061	1-S1t	0.481	0.558	1.722	1.012	0.851	3.494
28.60	28.60	6929.47	1.094	1.420	1-S1t	0.678	0.802	2.022	1.312	1.446	4.155
42.90	42.90	6929.76	1.388	1.709	1-S1t	0.835	0.995	2.237	1.527	1.997	4.598
57.20	57.20	6930.02	1.659	1.972	1-S1t	0.973	1.161	2.411	1.701	2.570	4.941
71.50	71.50	6930.29	1.913	2.237	1-S1f	1.100	1.303	2.417	1.850	3.213	5.225
85.80	85.80	6930.56	2.161	2.511	1-S1f	1.213	1.438	2.417	1.981	3.855	5.468
100.10	100.10	6930.86	2.415	2.810	1-S1f	1.321	1.562	2.417	2.098	4.498	5.683
114.40	114.40	6931.18	2.681	3.135	4-FFf	1.433	1.677	2.417	2.206	5.140	5.876
128.70	128.70	6931.53	2.968	3.481	4-FFf	1.545	1.783	2.417	2.306	5.783	6.052
143.00	143.00	6931.90	3.280	3.850	4-FFf	1.659	1.882	2.417	2.399	6.425	6.213

\*\*\*\*\*


Straight Culvert

Inlet Elevation (invert): 6928.05 ft,    Outlet Elevation (invert): 6927.34 ft


Culvert Length: 105.00 ft,    Culvert Slope: 0.0068

\*\*\*\*\*

Culvert Performance Curve Plot: Ex Culverts - Ex Pipe Capacity

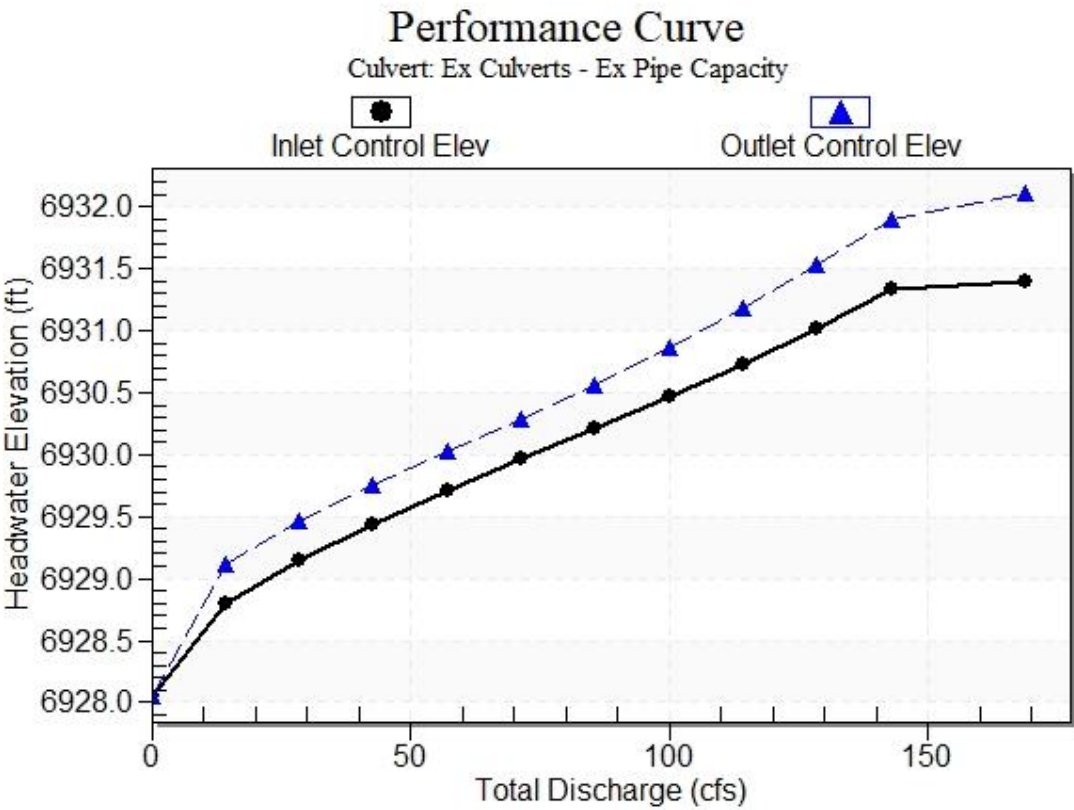

## Water Surface Profile Plot for Culvert: Ex Culverts - Ex Pipe Capacity

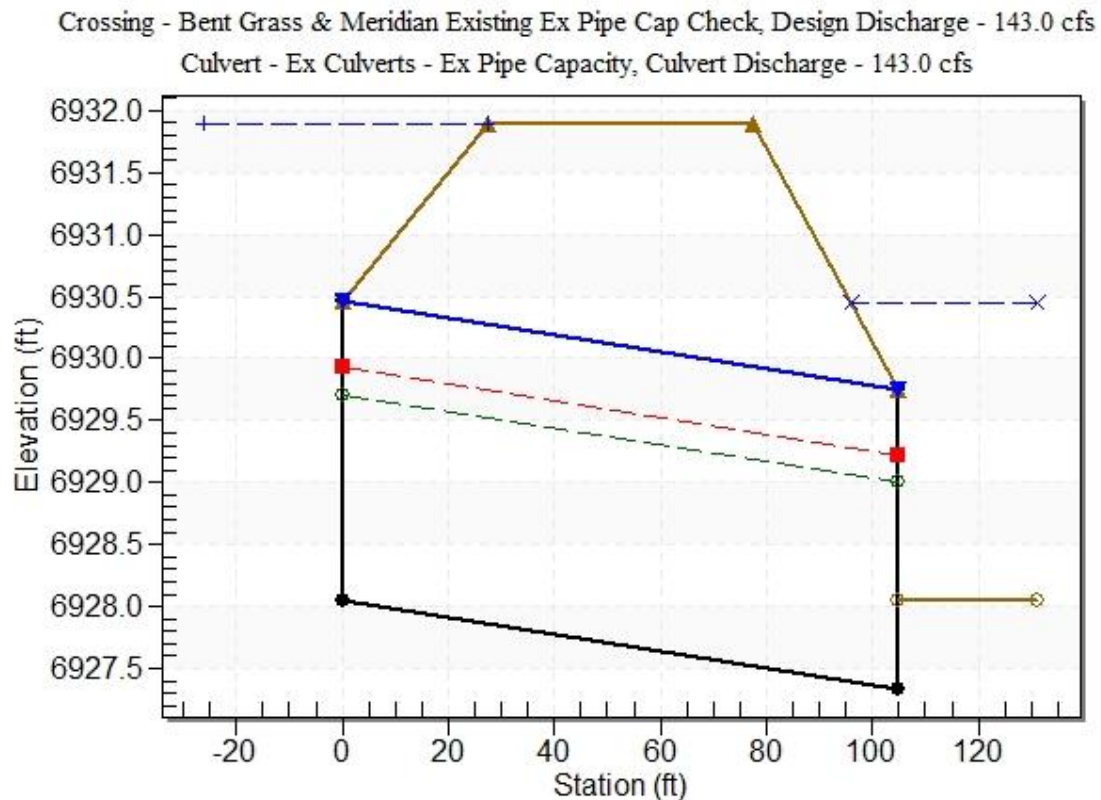

## Site Data - Ex Culverts - Ex Pipe Capacity

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 6928.05 ft

Outlet Station: 105.00 ft

Outlet Elevation: 6927.34 ft

Number of Barrels: 3

## Culvert Data Summary - Ex Culverts - Ex Pipe Capacity

Barrel Shape: Elliptical

Barrel Span: 45.00 in

Barrel Rise: 29.00 in

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Square Edge with Headwall

Inlet Depression: None

**Table 3 - Downstream Channel Rating Curve (Crossing: Bent Grass & Meridian**

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
0.00	6928.05	0.00	0.00	0.00	0.00
14.30	6929.06	1.01	3.49	1.10	0.87
28.60	6929.36	1.31	4.16	1.43	0.90
42.90	6929.58	1.53	4.60	1.67	0.93
57.20	6929.75	1.70	4.94	1.86	0.94
71.50	6929.90	1.85	5.22	2.02	0.96
85.80	6930.03	1.98	5.47	2.16	0.97
100.10	6930.15	2.10	5.68	2.29	0.98
114.40	6930.26	2.21	5.88	2.41	0.99
128.70	6930.36	2.31	6.05	2.52	0.99
143.00	6930.45	2.40	6.21	2.62	1.00

**Existing Ex Pipe Cap Check)****Tailwater Channel Data - Bent Grass & Meridian Existing Ex Pipe Cap Check**

Tailwater Channel Option: Triangular Channel

Side Slope (H:V): 4.00 (\_:1)

Channel Slope: 0.0175

Channel Manning's n: 0.0350

Channel Invert Elevation: 6928.05 ft

**Roadway Data for Crossing: Bent Grass & Meridian Existing Ex Pipe Cap Check**

Roadway Profile Shape: Constant Roadway Elevation

Crest Length: 80.00 ft

Crest Elevation: 6931.90 ft

Roadway Surface: Paved

Roadway Top Width: 50.00 ft

# **HY-8 Culvert Analysis Report**

**Crossing Discharge Data**

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 0 cfs

Design Flow: 270 cfs

Maximum Flow: 850 cfs

**Table 1 - Summary of Culvert Flows at Crossing: Bent Grass & Meridian Existing Pr**

Headwater Elevation (ft)	Total Discharge (cfs)	Ex Culverts - Pr DBPS Flow Discharge (cfs)	Roadway Discharge (cfs)	Iterations
6928.05	0.00	0.00	0.00	1
6930.55	85.00	85.00	0.00	1
6932.12	170.00	145.81	24.11	8
6932.55	270.00	143.20	126.70	5
6932.78	340.00	140.88	199.06	5
6933.02	425.00	138.39	286.31	4
6933.23	510.00	136.38	373.41	4
6933.43	595.00	134.77	460.09	4
6933.62	680.00	133.49	546.45	4
6933.79	765.00	132.46	632.08	3
6933.96	850.00	131.74	718.07	3
6931.90	143.05	143.05	0.00	Overtopping

**DBPS Flows**

Rating Curve Plot for Crossing: Bent Grass & Meridian Existing Pr DBPS Flows

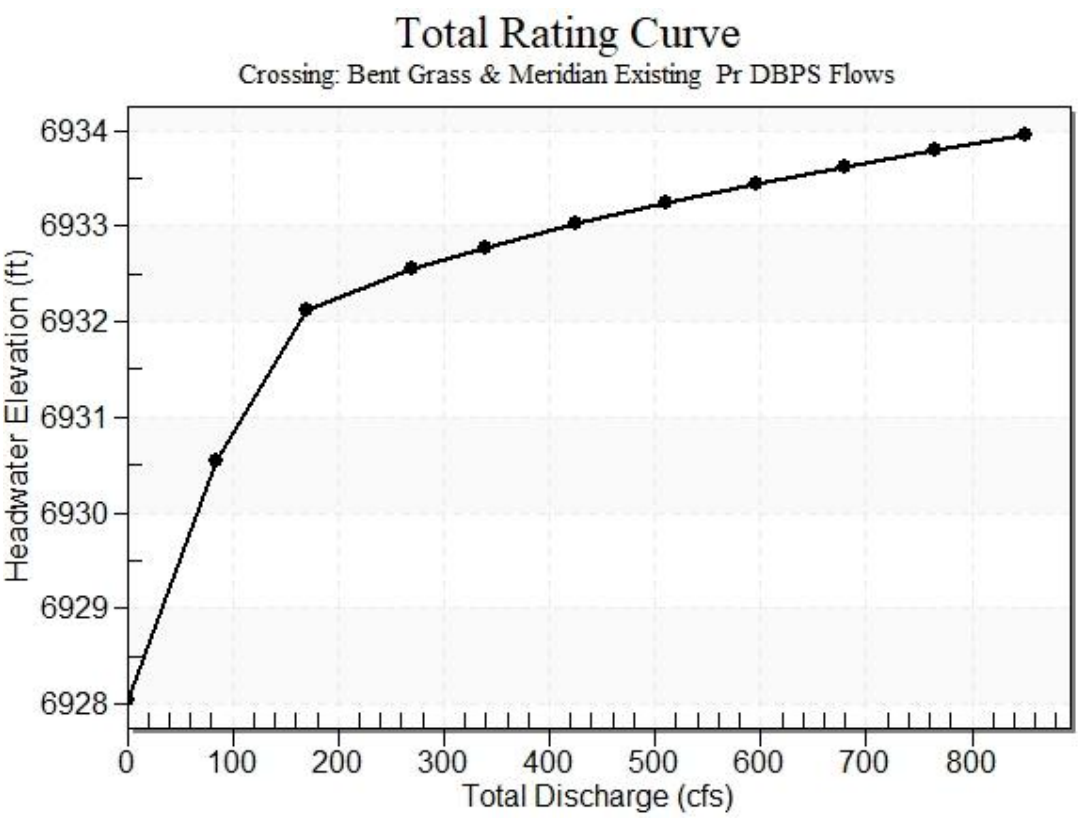




Table 2 - Culvert Summary Table: Ex Culverts - Pr DBPS Flow

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
0.00	0.00	6928.05	0.000	0.000	0-NF	0.000	0.000	0.710	0.000	0.000	0.000
85.00	85.00	6930.55	2.148	2.496	1-S1f	1.207	1.431	2.417	1.974	3.819	5.456
170.00	145.81	6932.12	3.345	4.068	4-FFf	1.682	1.900	2.417	2.559	6.551	6.488
270.00	143.20	6932.55	3.285	4.499	4-FFf	1.660	1.883	2.417	3.044	6.434	7.283
340.00	140.88	6932.78	3.232	4.727	4-FFf	1.642	1.868	2.417	3.319	6.330	7.715
425.00	138.39	6933.02	3.176	4.968	4-FFf	1.622	1.851	2.417	3.609	6.218	8.158
510.00	136.38	6933.23	3.132	5.184	4-FFf	1.606	1.837	2.417	3.864	6.128	8.539
595.00	134.77	6933.43	3.097	5.383	4-FFf	1.593	1.826	2.417	4.094	6.055	8.874
680.00	133.49	6933.62	3.069	5.569	4-FFf	1.583	1.817	2.417	4.304	5.998	9.175
765.00	132.46	6933.79	3.047	5.744	4-FFf	1.574	1.810	2.417	4.499	5.951	9.449
850.00	131.74	6933.96	3.032	5.912	4-FFf	1.569	1.805	2.417	4.680	5.919	9.702

\*\*\*\*\*


Straight Culvert

Inlet Elevation (invert): 6928.05 ft,    Outlet Elevation (invert): 6927.34 ft

Culvert Length: 105.00 ft,    Culvert Slope: 0.0068

\*\*\*\*\*


Culvert Performance Curve Plot: Ex Culverts - Pr DBPS Flow

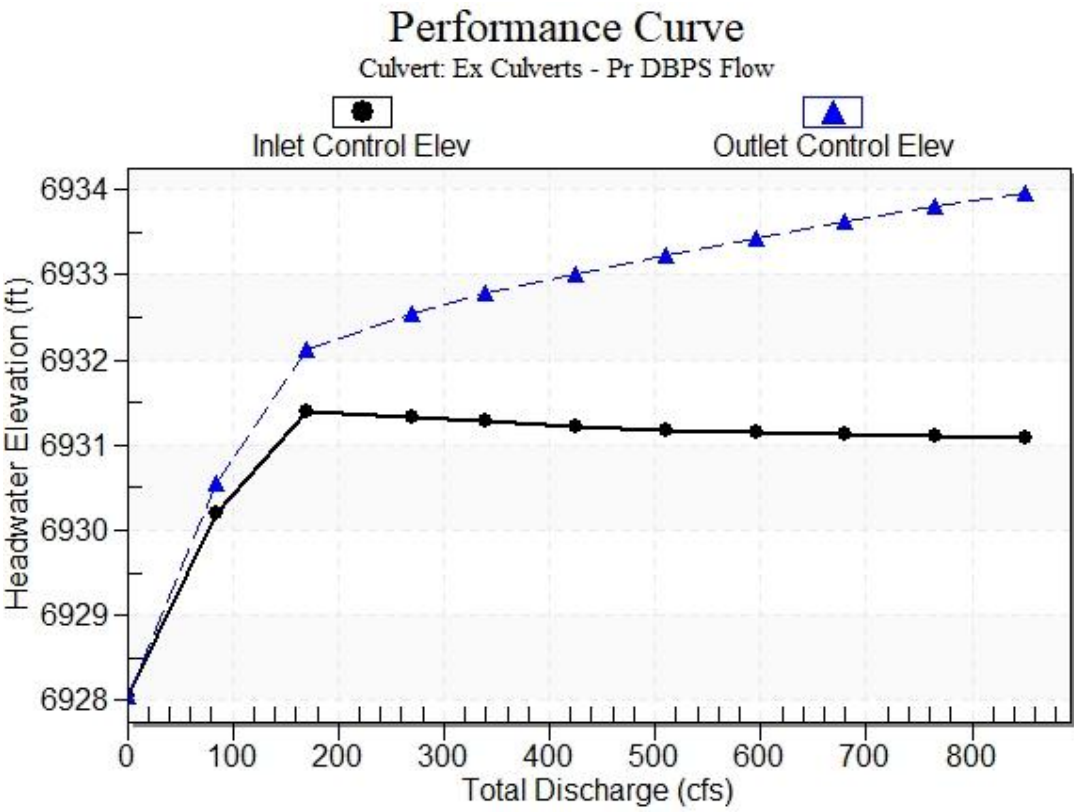

### Water Surface Profile Plot for Culvert: Ex Culverts - Pr DBPS Flow

Crossing - Bent Grass & Meridian Existing Pr DBPS Flows, Design Discharge - 270.0 cfs

Culvert - Ex Culverts - Pr DBPS Flow, Culvert Discharge - 143.2 cfs

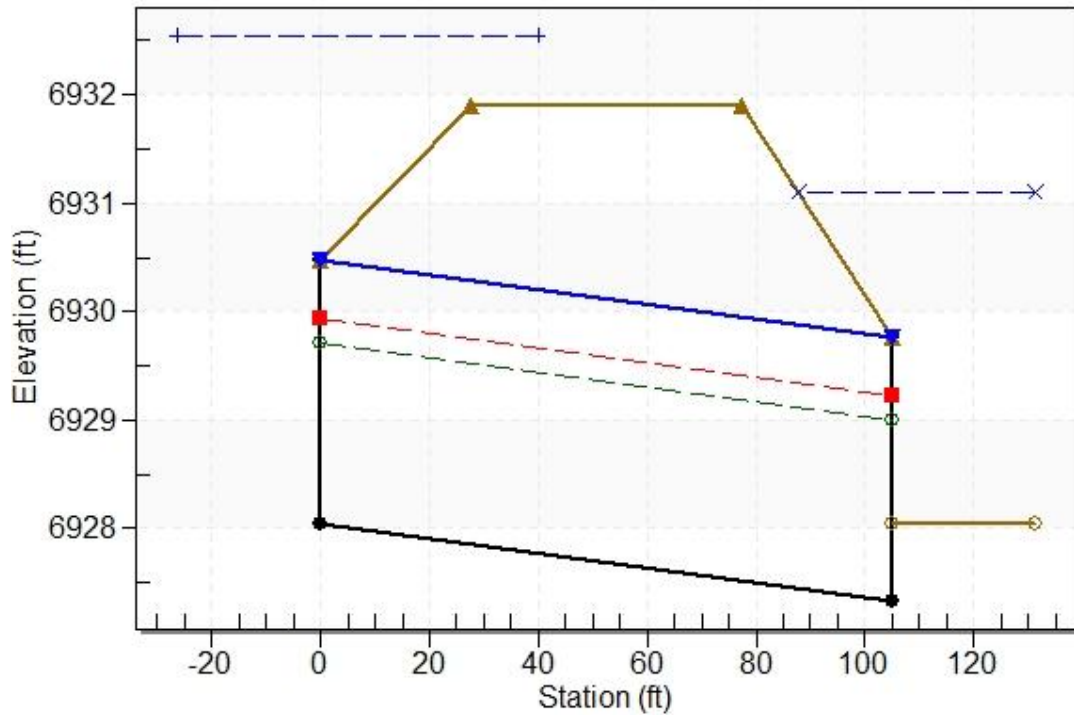

### Site Data - Ex Culverts - Pr DBPS Flow

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 6928.05 ft

Outlet Station: 105.00 ft

Outlet Elevation: 6927.34 ft

Number of Barrels: 3

### Culvert Data Summary - Ex Culverts - Pr DBPS Flow

Barrel Shape: Elliptical

Barrel Span: 45.00 in

Barrel Rise: 29.00 in

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Square Edge with Headwall

Inlet Depression: None

**Table 3 - Downstream Channel Rating Curve (Crossing: Bent Grass & Meridian**

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
0.00	6928.05	0.00	0.00	0.00	0.00
85.00	6930.02	1.97	5.46	2.16	0.97
170.00	6930.61	2.56	6.49	2.79	1.01
270.00	6931.09	3.04	7.28	3.32	1.04
340.00	6931.37	3.32	7.72	3.62	1.06
425.00	6931.66	3.61	8.16	3.94	1.07
510.00	6931.91	3.86	8.54	4.22	1.08
595.00	6932.14	4.09	8.87	4.47	1.09
680.00	6932.35	4.30	9.18	4.70	1.10
765.00	6932.55	4.50	9.45	4.91	1.11
850.00	6932.73	4.68	9.70	5.11	1.12

**Existing Pr DBPS Flows)****Tailwater Channel Data - Bent Grass & Meridian Existing Pr DBPS Flows**

Tailwater Channel Option: Triangular Channel

Side Slope (H:V): 4.00 (\_:1)

Channel Slope: 0.0175

Channel Manning's n: 0.0350

Channel Invert Elevation: 6928.05 ft

**Roadway Data for Crossing: Bent Grass & Meridian Existing Pr DBPS Flows**

Roadway Profile Shape: Constant Roadway Elevation

Crest Length: 80.00 ft

Crest Elevation: 6931.90 ft

Roadway Surface: Paved

Roadway Top Width: 50.00 ft

# HY-8 Culvert Analysis Report

Provide for BGMD and Owl Place

### **Crossing Discharge Data**

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 13.8 cfs

Design Flow: 65.7 cfs

Maximum Flow: 100 cfs

**Table 1 - Summary of Culvert Flows at Crossing: Add't Culverts for Add't Offsite Flow**

Headwater Elevation (ft)	Total Discharge (cfs)	New Ellp Culverts for Offsite Flow Discharge (cfs)	Roadway Discharge (cfs)	Iterations
6929.16	13.80	13.80	0.00	1
6929.44	22.42	22.42	0.00	1
6929.69	31.04	31.04	0.00	1
6929.92	39.66	39.66	0.00	1
6930.14	48.28	48.28	0.00	1
6930.36	56.90	56.90	0.00	1
6930.59	65.70	65.70	0.00	1
6930.82	74.14	74.14	0.00	1
6931.10	82.76	82.76	0.00	1
6931.41	91.38	91.38	0.00	1
6931.74	100.00	100.00	0.00	1
6931.90	103.85	103.85	0.00	Overtopping

Rating Curve Plot for Crossing: Add't Culverts for Add't Offsite Flow

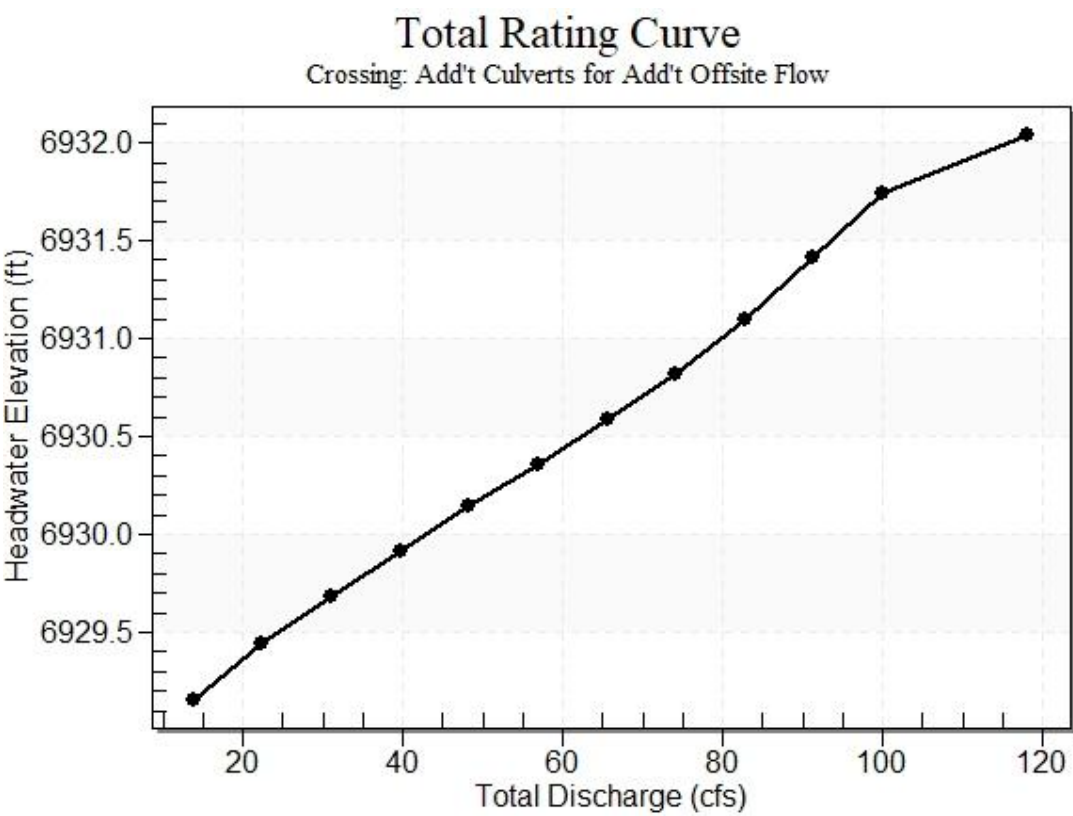




Table 2 - Culvert Summary Table: New Ellp Culverts for Offsite Flow

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
13.80	13.80	6929.16	0.918	1.108	1-S1t	0.577	0.676	1.708	0.998	1.242	3.463
22.42	22.42	6929.44	1.196	1.391	1-S1t	0.736	0.873	1.907	1.197	1.798	3.910
31.04	31.04	6929.69	1.460	1.636	1-S1t	0.872	1.039	2.063	1.353	2.312	4.241
39.66	39.66	6929.92	1.701	1.868	1-S1t	0.994	1.186	2.193	1.483	2.809	4.509
48.28	48.28	6930.14	1.929	2.092	1-S1t	1.108	1.312	2.306	1.596	3.311	4.736
56.90	56.90	6930.36	2.154	2.311	1-S1t	1.210	1.434	2.408	1.698	3.835	4.935
65.70	65.70	6930.59	2.387	2.538	1-S1f	1.309	1.549	2.417	1.792	4.428	5.115
74.14	74.14	6930.82	2.620	2.772	1-S1f	1.408	1.652	2.417	1.875	4.997	5.272
82.76	82.76	6931.10	2.874	3.047	1-S1f	1.509	1.750	2.417	1.954	5.578	5.419
91.38	91.38	6931.41	3.147	3.361	4-FFf	1.611	1.842	2.417	2.028	6.159	5.555
100.00	100.00	6931.74	3.444	3.694	4-FFf	1.716	1.926	2.417	2.098	6.740	5.682

\*\*\*\*\*


Straight Culvert

Inlet Elevation (invert): 6928.05 ft,    Outlet Elevation (invert): 6927.34 ft

Culvert Length: 105.00 ft,    Culvert Slope: 0.0068

\*\*\*\*\*


Culvert Performance Curve Plot: New Ellp Culverts for Offsite Flow

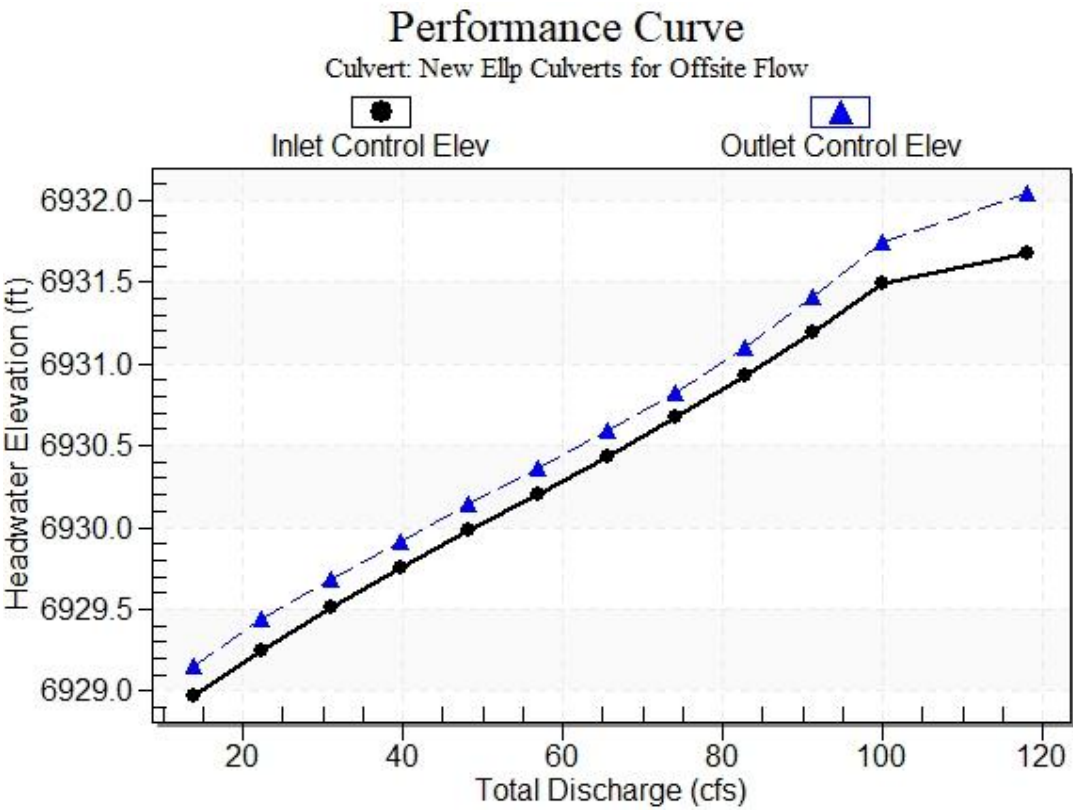

## Water Surface Profile Plot for Culvert: New Ellp Culverts for Offsite Flow

Crossing - Add't Culverts for Add't Offsite Flow, Design Discharge - 65.7 cfs

Culvert - New Ellp Culverts for Offsite Flow, Culvert Discharge - 65.7 cfs

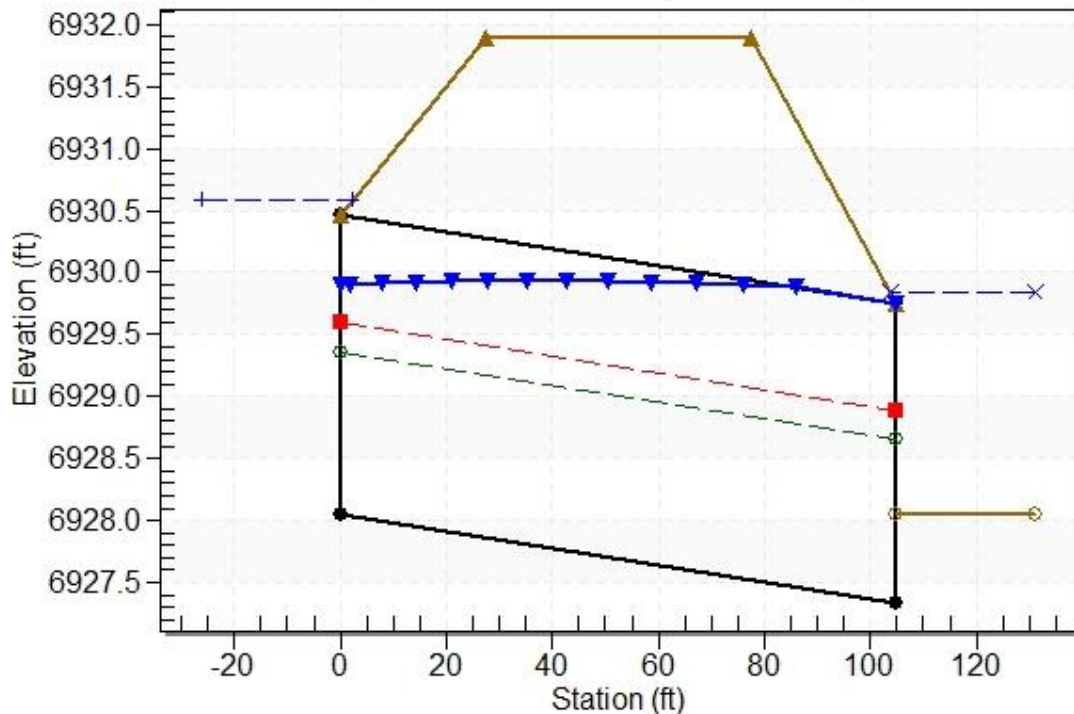

## Site Data - New Ellp Culverts for Offsite Flow

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 6928.05 ft

Outlet Station: 105.00 ft

Outlet Elevation: 6927.34 ft

Number of Barrels: 2

## Culvert Data Summary - New Ellp Culverts for Offsite Flow

Barrel Shape: Elliptical

Barrel Span: 45.00 in

Barrel Rise: 29.00 in

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Square Edge with Headwall

Inlet Depression: None

Verify based on  
hydrology  
comments

**Table 3 - Downstream Channel Rating Curve (Crossing: Add't Culverts for Add't**

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
13.80	6929.05	1.00	3.46	1.09	0.86
22.42	6929.25	1.20	3.91	1.31	0.89
31.04	6929.40	1.35	4.24	1.48	0.91
39.66	6929.53	1.48	4.51	1.62	0.92
48.28	6929.65	1.60	4.74	1.74	0.93
56.90	6929.75	1.70	4.93	1.85	0.94
65.70	6929.84	1.79	5.12	1.96	0.95
74.14	6929.92	1.87	5.27	2.05	0.96
82.76	6930.00	1.95	5.42	2.13	0.97
91.38	6930.08	2.03	5.56	2.21	0.97
100.00	6930.15	2.10	5.68	2.29	0.98

**Offsite Flow)****Tailwater Channel Data - Add't Culverts for Add't Offsite Flow**

Tailwater Channel Option: Triangular Channel

Side Slope (H:V): 4.00 (\_:1)

Channel Slope: 0.0175

Channel Manning's n: 0.0350

Channel Invert Elevation: 6928.05 ft

**Roadway Data for Crossing: Add't Culverts for Add't Offsite Flow**

Roadway Profile Shape: Constant Roadway Elevation

Crest Length: 80.00 ft

Crest Elevation: 6931.90 ft

Roadway Surface: Paved

Roadway Top Width: 50.00 ft

## PIPE OUTFALL RIPRAP SIZING CALCULATIONS

**Subdivision:** Meridian Road Improvements  
**Location:** CO, Colorado Springs

**Project Name:** Meridian Road Improvements  
**Project No.:** CLH000015.20  
**Calculated By:** BHB  
**Checked By:** SMB  
**Date:** 3/23/20

Storm Drain System				
	DP-20 Outfall			
Q100 (cfs)	915.7			
D or H (in)	45			
W (ft)	29			
Slope (%)	0.03			
Yn (in)	29.04			
Yt (ft)	4.81			If "Unknown" Yt/D=0.4
Yt/D, Yt/H	1.28			
Supercritical	Yes			Based on Froud Number >/< 1
Q/D <sup>2.5</sup> , Q/WH <sup>1.5</sup>	4.35			
Q/D <sup>1.5</sup> , Q/WH <sup>0.5</sup>				
Da, Ha (in) *	37.02			Da=0.5(D+Yn), Ha=0.5(H+Yn)
Q/Da <sup>1.5</sup> , Q/WHa <sup>0.5</sup> *	17.98			
d50 (in), Required	2.35			
Required Riprap Size	L			
<b>Use Riprap Size</b>	<b>L</b>			Found using Figure 9-38 (USDCM)
d50 (in)	9			
1/(2 tan θ)	4.90			Found using Figure 9-35/9-36 (USDCM)
Erosive Soils	No			
At	118.92			At=Q/5.5
L	-21.0			L=(1/(2 tan θ))(At/Yt - D)
Min L	11.3			Min L=3D or 3H
Max L	37.5			Max L=10D or 10H
Length (ft)	11.3			
Bottom Width (ft)	11.3			Width=3D (Minimum)
Riprap Depth (in)	18			Depth=2(d50)
Type II Base Depth (in)	6			
Cutoff Wall	No			
Cutoff Wall Depth (ft)				Depth of Riprap and Base
Cutoff Wall Width (ft)				

Note: No Type II Base to be used if Soil Riprap is specified within the plans

\* For use when the flow in the culvert is supercritical (and less than full).

\*\* This is a temporary minor storm culvert and the riprap has been sized for minor storm flows




## Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Basin ID: Proposed Pond (Diverted Flow)

ZONE 3

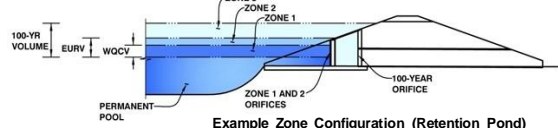

Example 2.10. Consider the following two graphs:

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	0.74	0.241	
Zone 2			
Zone 3			
		0.241	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the

Underdrain Orifice Diameter =  inches

User Input: Orifice at Underdrain Outlet (Typically used to drain WQCV in a Filtration BMP)										Calculated Parameters for Underdrain									
Orifice Parameters										Flow and Velocity Parameters									
Orifice Diameter (in)	Orifice Area (sq in)	Orifice Velocity (ft/s)	Orifice Flow (gpm)	Orifice Head (ft)	Orifice Loss Coefficient	Orifice Loss (ft)	Orifice Loss (in)	Orifice Loss (m)	Orifice Loss (mm)	Orifice Flow (L/s)	Orifice Velocity (m/s)	Orifice Head (m)	Orifice Loss Coefficient	Orifice Loss (m)	Orifice Loss (mm)	Orifice Loss (in)			
1.0	0.785	1.41	1.0	1.0	0.5	0.5	1.25	0.15	3.81	0.038	0.43	1.0	0.5	0.5	1.25	0.15			
1.5	1.77	0.94	2.25	1.0	0.5	0.5	1.25	0.15	3.81	0.08	0.31	1.0	0.5	0.5	1.25	0.15			
2.0	3.14	0.71	4.0	1.0	0.5	0.5	1.25	0.15	3.81	0.15	0.24	1.0	0.5	0.5	1.25	0.15			
2.5	4.91	0.57	5.6	1.0	0.5	0.5	1.25	0.15	3.81	0.22	0.20	1.0	0.5	0.5	1.25	0.15			
3.0	7.07	0.47	6.7	1.0	0.5	0.5	1.25	0.15	3.81	0.28	0.17	1.0	0.5	0.5	1.25	0.15			
3.5	9.62	0.40	7.7	1.0	0.5	0.5	1.25	0.15	3.81	0.33	0.15	1.0	0.5	0.5	1.25	0.15			
4.0	12.57	0.35	8.5	1.0	0.5	0.5	1.25	0.15	3.81	0.38	0.13	1.0	0.5	0.5	1.25	0.15			
4.5	15.9	0.31	9.2	1.0	0.5	0.5	1.25	0.15	3.81	0.42	0.12	1.0	0.5	0.5	1.25	0.15			
5.0	19.63	0.28	9.8	1.0	0.5	0.5	1.25	0.15	3.81	0.46	0.11	1.0	0.5	0.5	1.25	0.15			
5.5	23.76	0.25	10.3	1.0	0.5	0.5	1.25	0.15	3.81	0.50	0.10	1.0	0.5	0.5	1.25	0.15			
6.0	28.27	0.23	10.7	1.0	0.5	0.5	1.25	0.15	3.81	0.53	0.09	1.0	0.5	0.5	1.25	0.15			
6.5	33.18	0.21	11.1	1.0	0.5	0.5	1.25	0.15	3.81	0.56	0.08	1.0	0.5	0.5	1.25	0.15			
7.0	38.48	0.19	11.5	1.0	0.5	0.5	1.25	0.15	3.81	0.59	0.07	1.0	0.5	0.5	1.25	0.15			
7.5	44.18	0.18	11.8	1.0	0.5	0.5	1.25	0.15	3.81	0.62	0.06	1.0	0.5	0.5	1.25	0.15			
8.0	50.27	0.17	12.1	1.0	0.5	0.5	1.25	0.15	3.81	0.65	0.05	1.0	0.5	0.5	1.25	0.15			
8.5	56.75	0.16	12.4	1.0	0.5	0.5	1.25	0.15	3.81	0.68	0.04	1.0	0.5	0.5	1.25	0.15			
9.0	63.62	0.15	12.7	1.0	0.5	0.5	1.25	0.15	3.81	0.71	0.03	1.0	0.5	0.5	1.25	0.15			
9.5	70.88	0.14	13.0	1.0	0.5	0.5	1.25	0.15	3.81	0.74	0.02	1.0	0.5	0.5	1.25	0.15			
10.0	78.54	0.13	13.3	1.0	0.5	0.5	1.25	0.15	3.81	0.77	0.01	1.0	0.5	0.5	1.25	0.15			

Underdrain Orifice Invert Depth =		ft (distance below the filtration media surface)	Underdrain Orifice Area =		ft <sup>2</sup>
-----------------------------------	--	--	---------------------------	--	-----------------

Underdrain Orifice Diameter =  inches

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)	Calculated Parameters for Plate
---	---------------------------------

Invert of Lowest Orifice =                      ft (relative to basin bottom at Stage = 0 ft)      WQ Orifice Area per Row =           N/A           ft<sup>2</sup>

Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft) Elliptical Half-Width =  N/A feet

Orifice Plate: Orifice Vertical Spacing =  inches

Orifice Plate: Orifice Area per Row =  inches

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)	Calculated Parameters for Plate
---	---------------------------------

Invert of Lowest Orifice =                      ft (relative to basin bottom at Stage = 0 ft)      WQ Orifice Area per Row =           N/A           ft<sup>2</sup>

Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft) Elliptical Half-Width =  N/A feet

Orifice Plate: Orifice Vertical Spacing =  inches

Orifice Plate: Orifice Area per Row =  inches

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

Stage of Orifice Centroid (ft) Orifice Area (sq. inches)	Row 1 (optional)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft) Orifice Area (sq. inches)	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)

User Input: Vertical Orifice (Circular or Rectangular)	Calculated Parameters for Vertical Orifice
--	--

User Input: Vertical Orifice (Circular or Rectangular)	Calculated Parameters for Vertical Orifice
--	--

	Not Selected	Not Selected		Not Selected	Not Selected
Invert of Vertical Orifice =			ft (relative to basin bottom at Stage = 0 ft)	Vertical Orifice Area =	ft <sup>2</sup>
Depth at top of Zone using Vertical Orifice =			ft (relative to basin bottom at Stage = 0 ft)	Vertical Orifice Centroid =	feet
Vertical Orifice Diameter =			inches		

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)	Calculated Parameters for Overflow Weir
--	---

User Input: Overflow Weir (Dropbox) and Grate (Flat or Sloped)	Calculated Parameters for Overflow Weir
--	---

Overflow Weir Front Edge Height, $H_o$ =	Not Selected	Not Selected	ft (relative to basin bottom at Stage = 0 ft)	Height of Grate Upper Edge, $H_i$ =	Not Selected	Not Selected	feet
Overflow Weir Front Edge Length =			feet	Overflow Weir Slope Length =			feet
Overflow Weir Slope =			H:V (enter zero for flat grate)	Grate Open Area / 100-yr Orifice Area =			should be $\geq 4$
Horiz. Length of Weir Sides =			feet	Overflow Grate Open Area w/o Debris =			ft <sup>2</sup>
Overflow Grate Open Area % =			%, grate open area/total area	Overflow Grate Open Area w/ Debris =			ft <sup>2</sup>
Debris Clogging % =			%				

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)		Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate
--	--	---

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)		Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate
--	--	---

	Not Selected	Not Selected			Not Selected	Not Selected
Depth to Invert of Outlet Pipe =			ft (distance below basin bottom at Stage = 0 ft)	Outlet Orifice Area =		ft <sup>2</sup>
Circular Orifice Diameter =			inches	Outlet Orifice Centroid =		feet
				Half-Central Angle of Restrictor Plate on Pipe =	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)	Calculated Parameters for Spillway
---	------------------------------------

User Input: Emergency Spillway (Rectangular or Trapezoidal)	Calculated Parameters for Spillway
---	------------------------------------




Spillway Invert Stage=	3.00	ft (relative to basin bottom at Stage = 0 ft)	Spillway Design Flow Depth=	2.07	feet
Spillway Crest Length =	30.00	feet	Stage at Top of Freeboard =	6.07	feet
Spillway End Slopes =	0.17	H:V	Basin Area at Top of Freeboard =	1.34	acres
Freeboard above Max Water Surface =	1.00	feet			

### ROUTED HYDROGRAPH RESULTS

[illegible]

# Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

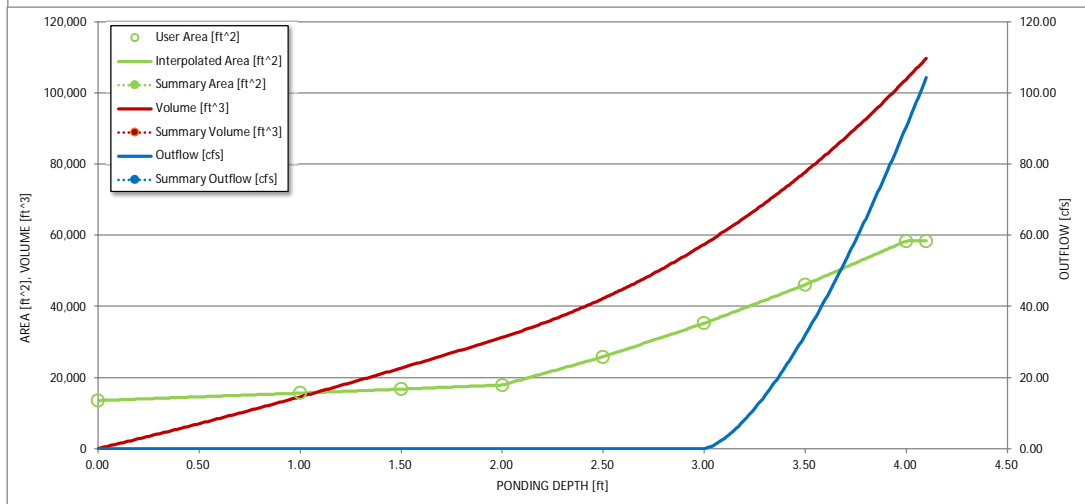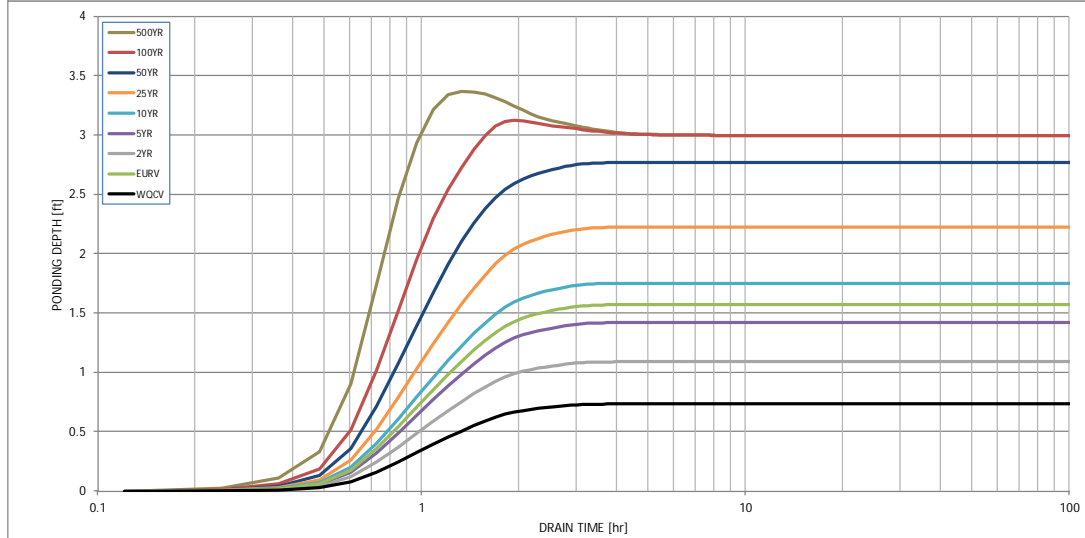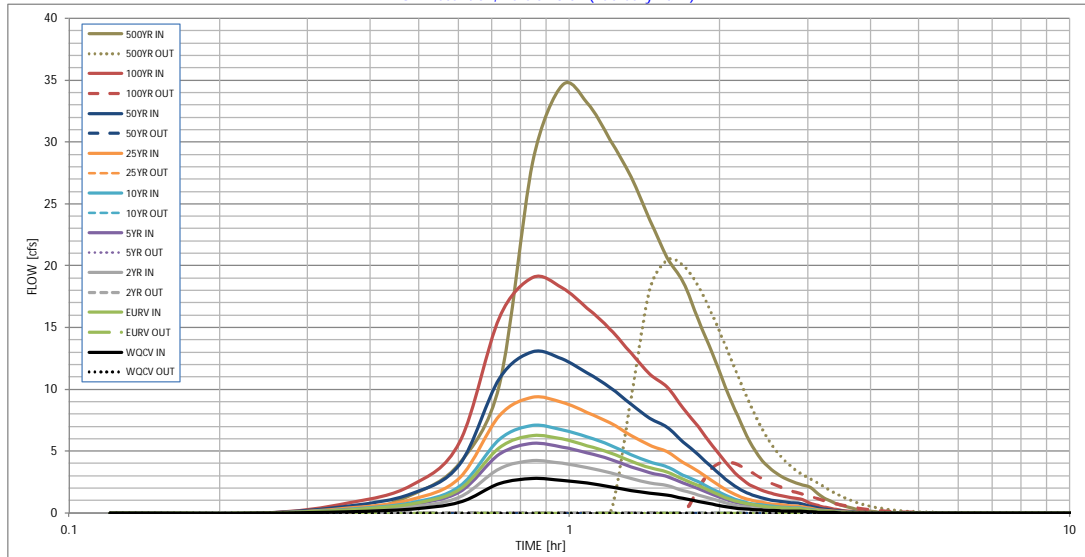

S-A-V-D Chart Axis Override

	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			



# ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Bent Grass Residential Filing No. 2

Inlet ID:

Bent Grass Meadows Drive - Street Capacity

**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

$T_{BACK} = 14.0$  ft  
 $S_{BACK} = 0.020$  ft/ft  
 $n_{BACK} = 0.013$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 39.0$  ft  
 $W = 2.00$  ft  
 $S_x = 0.020$  ft/ft  
 $S_w = 0.083$  ft/ft  
 $S_o = 0.010$  ft/ft  
 $n_{STREET} = 0.016$

26?

	Minor Storm	Major Storm
$T_{MAX} =$	29.0	39.0
$d_{MAX} =$	6.0	12.0
	<input type="checkbox"/>	<input type="checkbox"/>

check = yes

~7.26?

	Minor Storm	Major Storm
$Q_{allow} =$	13.8	110.5

cfs

MINOR STORM Allowable Capacity is based on Depth Criterion


MAJOR STORM Allowable Capacity is based on Spread Criterion

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

## INLET ON A CONTINUOUS GRADE

Version 4.05 Released March 2017

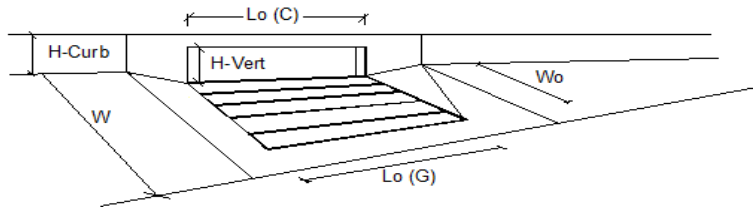

Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Type =		
Local Depression (additional to continuous gutter depression 'a')	$a_{LOCAL} =$		inches
Total Number of Units in the Inlet (Grate or Curb Opening)	$N_o =$		
Length of a Single Unit Inlet (Grate or Curb Opening)	$L_o =$		ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)	$W_o =$		ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	$C_r G =$		
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	$C_r C =$		
<b>Total Inlet Interception Capacity</b>	<b>Q =</b>		cfs
<b>Total Inlet Carry-Over Flow (flow bypassing inlet)</b>	<b><math>Q_b =</math></b>		cfs
<b>Capture Percentage = <math>Q_i/Q_o =</math></b>	<b>C% =</b>		%

**FINAL DRAINAGE AND EROSION CONTROL  
FOR  
THE MEADOWS FILING THREE SUBDIVISION**

**JULY 2000**

**PROJECT NO. 9820**

**LADD ENGINEERING**  
1975 SPRING VALLEY DRIVE  
COLORADO SPRINGS, CO 80921  
(719)481-6320, (719)481-6328 FAX  
fredladd@worldnet.att.net

**CONSULTING ENGINEERS**  
**LAND SURVEYOR**


The Meadows Filing Three


Capital Pacific Homes of Colorado, Inc.

July 2000

ENGINEER'S STATEMENT

The attached drainage plan and report was prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

  
Fred C. Ladd, PE-PLS

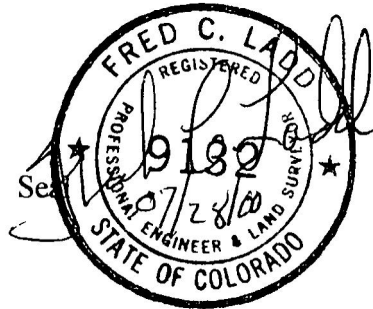

DEVELOPER'S STATEMENT

I, Everett Pfeiff, Agent for Capital Pacific Homes of Colorado, Inc. the Developer, have read and will comply with all the requirements specified in the drainage report and plan.


The Meadows Filing Three  
Capital Pacific Homes of Colorado, Inc.

By:   
Everett Pfeiff, Agent


Address: 1333 W. 120<sup>th</sup> Avenue, Suite 222  
Westminster, CO 80234

EL PASO COUNTY ONLY

Filed in accordance of section 51.1 of the El Paso Land Development Code, as amended.

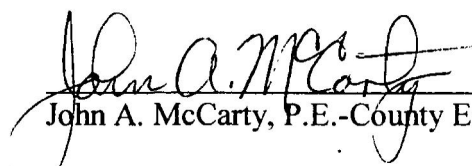  
John A. McCarty, P.E.-County Engineer  
Conditions:

8-15-00  
Date

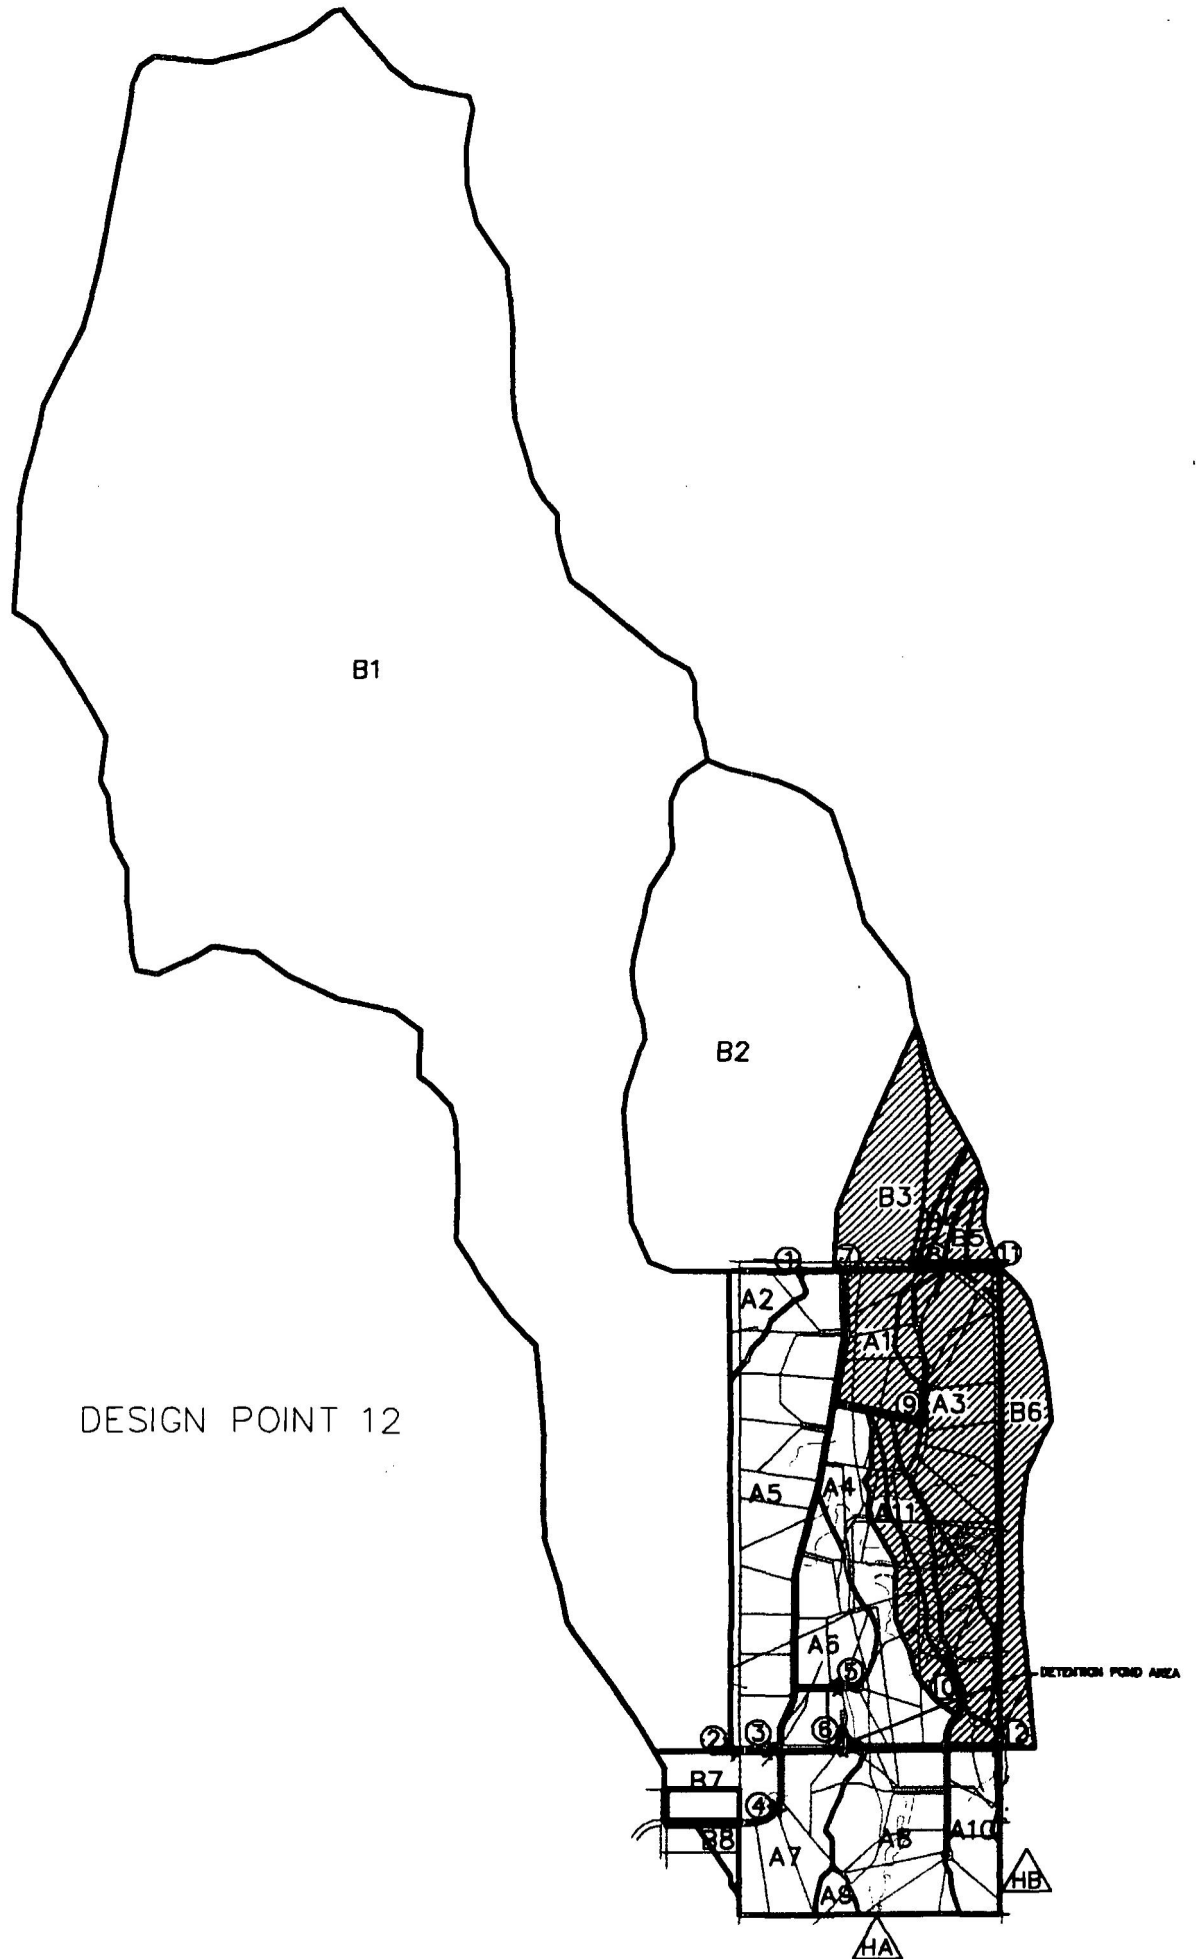

## DESIGN POINT #12 -

THE RUNOFF FOR THIS POINT WAS ORIGINALLY CALCULATED USING THE SCS UNIT HYDROGRAPH METHOD. BECAUSE OF THE SOILS TYPE AND LENGTH OF THE BASIN THE QUANTITY OF FLOWS CALCULATED WERE VERY SMALL (LESS THAN 10 CFS). TO GENERATE A MORE CONSERVATIVE QUANTITY AND A RESULTING, LARGER CULVERT DIAMETER, THE RATIONAL METHOD IS BEING USED TO CALCULATE FLOWS FOR THE BASIN.

## DESIGN POINT #12

BASINS B3, B4, B5, B6, A1, A3 &amp; A11

AREA = 42.48 + 7.13 + 7.52 + 33.84 + 27.21 + 79.22 + 27.65 = 225.05 ACRES

## COEFFICIENT OF RUNOFF

B3, B4 &amp; B5

$$C_{10} = 0.25$$

$$C_{100} = 0.35$$

B6

WOODMAN HILLS SUBDIVISION  
ASSUMED 1-ACRE PARCELS

$$C_{10} = 0.3$$

$$C_{100} = 0.4$$

A1, A3 &amp; A11

SOILS TYPE A

LAND USE IS 5-ACRE AND LARGER PARCELS

ASSUME 50% 1-ACRE PARCELS AND 50% PASTURE/MEADOW

$$C_{10} = 0.5(0.3) + 0.5(0.25) = 0.275$$

$$C_{100} = 0.5(0.4) + 0.5(0.35) = 0.375$$

## COMPOSITE

$$C_{10} = \frac{0.25(42.48 + 7.13 + 7.52) + 0.3(33.84) + 0.275(27.21 + 79.22 + 27.65)}{225.05}$$

$$C_{10} = 0.272$$

$$C_{100} = \frac{0.35(42.48 + 7.13 + 7.52) + 0.4(33.84) + 0.375(27.21 + 79.22 + 27.65)}{225.05}$$

$$C_{100} = 0.372$$

## DESIGN POINT #12

## TIME OF CONCENTRATION


$$T_1 = 52.3 \text{ MIN (SEE DESIGN POINT #9)}$$

$$T_T = \frac{L}{60V}$$

$$L = 3725 \text{ FT}$$

$$V = \frac{1.49}{n} (R)^{2/3} (S)^{1/2}$$

$$n = 0.03$$



$$A = bd + zd^2$$

$$R = \frac{bd + zd^2}{b + 2d\sqrt{z^2 + 1}}$$

$$R = \frac{8(1) + 4(1)^2}{8 + 2(1)\sqrt{4^2 + 1}} = 0.739$$

$$S = \frac{7096 - 7000}{3725} = 0.026$$

$$V = \frac{1.49}{0.03} (0.739)^{2/3} (0.026)^{1/2} = 6.55 \text{ FT/S}$$

$$T_T = \frac{3725}{60(6.55)} = 9.5 \text{ MIN}$$

$$T_C = 52.3 + 9.5 = 61.8 \text{ MIN}$$



DESIGN POINT #12

RAINFALL INTENSITY

$$\left. \begin{array}{l} I_5 = 1.5 \\ I_{100} = 2.7 \end{array} \right\} \text{FIG 5-1 DRAINAGE CRITERIA MANUAL}$$

$$Q_5 = 0.272(1.5)(225.05) = 91.8 \text{ CFS}$$

$$Q_{100} = 0.372(2.7)(225.05) = 226.0 \text{ CFS}$$



**Innovative Design. Classic Results.**



CDR-15-006

**FINAL DRAINAGE REPORT  
ADDENDUM  
FOR  
BENT GRASS RESIDENTIAL  
(FILING NO. 1)**

**AUGUST 2015**

Prepared for:  
**RIVERS DEVELOPMENT, INC.**  
13530 NORTHGATE ESTATES DR., SUITE 200  
COLORADO SPRINGS, CO 80921  
Contact: Roger Miller

Prepared by:  
**CLASSIC CONSULTING ENGINEERS & SURVEYORS, LLC**  
6385 CORPORATE DRIVE, SUITE 101  
COLORADO SPRINGS, CO 80919  
(719) 785-0790

Job no. 2430.00




**FINAL DRAINAGE REPORT ADDENDUM  
FOR BENT GRASS RESIDENTIAL (FILING NO. 1)**

**DRAINAGE REPORT STATEMENT**

**ENGINEER'S STATEMENT:**


The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the Drainage Criteria Manual for the City of Colorado Springs and El Paso County. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.

  
\_\_\_\_\_  
Marc A. Whorton, Colorado P.E. #37155

11/6/15  
Date


**DEVELOPER'S STATEMENT:**

I, the developer, have read and will comply with all of the requirements specified in this drainage report and plan.

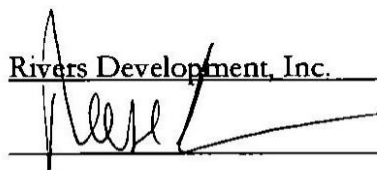Business Name: Rivers Development, Inc.  
 11/9/15  
Title: DIRECTOR OF ENGINEERING  
Address: 13530 Northgate Estates Dr., Suite 200  
Colorado Springs, CO 80921

**EL PASO COUNTY:**

Filed in accordance with Section 51.1 of the El Paso Land Development Code, as amended.

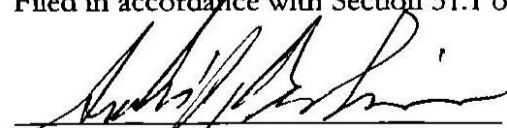  
\_\_\_\_\_  
For El Paso County Engineer/Director

11-18-15  
Date

Conditions:



lots within The Meadows Filing No. 3 subdivision (Basin H-1) and developed 2.5-acres lots within the Woodmen Hills Filings 1, 2 and 3 subdivisions (Basin H-2). However, after further investigation into The Meadows Filing No. 3 Final Drainage Report we found that the 225+ ac. basin tributary to their Pond 2 was calculated using the modified rational method and not the SCS method for basins over 100 acres. Also, given the fact that the Meadows No. 3 development consisted entirely of 5 ac. lots with the majority of the property being soil type A and no significant overlot grading, it seems that the anticipated developed flows from this subdivision were extremely over estimated. This finding seems consistent with recent site visits downstream of this pond outfall corridor, showing no apparent erosion or significant sediment transfer and even discussions with adjacent neighbors regarding the major storm event last summer that did not seem to overtop the existing pond in existence on Lot 15 of Woodmen Hills Filing No. 3. Based on this information, we would like to document this major discrepancy with the updated Falcon DBPS and suggest that the existing flows proposed in this report are a better representation of this currently developed off-site flow condition. Thus, the following data was used to appropriately model these off-site flows:

PondPack V8i with time of concentrations estimated using SCS procedures described in the DCM based upon the hydrologic soil type A and runoff curve numbers chart. (Table 5-5)

225.28 tributary acres (Design Point 12 in The Meadows Filing No. 3 FDR)

CN Number: 51 (Table 5-5, 1 ac. res. Lots, type A soils, no overlot grading)

Time of Concentration: 60 min. (The Meadows Filing No. 3 FDR)

Basin H-1 ( $Q_5 = 23$  cfs and  $Q_{100} = 43$  cfs) represents these existing off-site flows from The Meadows Filing No. 3 subdivision along with the on-site undeveloped area. The total existing flow at **Design Point H1** equals  $Q_5 = 23$  cfs and  $Q_{100} = 43$  cfs.

Basin H-2 ( $Q_5 = 14$  cfs and  $Q_{100} = 26$  cfs) represents existing off-site flows from rear yards of both The Meadows Filing No. 3 subdivision and Woodmen Hills Filing No. 3. These flows, along with the release from the existing Pond 2 ( $Q_5 = 0$  cfs and  $Q_{100} = 6$  cfs), just north of Woodmen Hills Drive, constructed with the Meadows Filing No. 3 combine and travel in a natural drainageway within “no build” areas across these lots and through various natural weir structures (stock ponds).

---

## Sediment Pond Spillway

---

### Project Description

Solve For

Discharge

### Input Data

Headwater Elevation	6957.60	ft
Crest Elevation	6957.00	ft
Weir Coefficient	3.00	US
Crest Length	30.00	ft

### Results

Discharge	41.83	ft <sup>3</sup> /s
Headwater Height Above Crest	0.60	ft
Flow Area	18.00	ft <sup>2</sup>
Velocity	2.32	ft/s
Wetted Perimeter	31.20	ft
Top Width	30.00	ft

Subsection: Elevation-Area Volume Curve

Return Event: 100 years

Label: SEDIMENT BASIN

Storm Event: TYPEIIA 24HR (4.4 in)

Elevation (ft)	Planimeter (ft <sup>2</sup> )	Area (acres)	A1+A2+sq (A1*A2) (acres)	Volume (ac-ft)	Volume (Total) (ac-ft)
6,954.00	0.0	0.310	0.000	0.000	0.000
6,956.00	0.0	0.410	1.077	0.718	0.718
6,958.00	0.0	1.340	2.491	1.661	2.378

Subsection: Outlet Input Data  
 Label: SEDIMENT BASIN

Return Event: 100 years  
 Storm Event: TYPEIIA 24HR (4.4 in)

Requested Pond Water Surface Elevations	
Minimum (Headwater)	6,953.00 ft
Increment (Headwater)	0.50 ft
Maximum (Headwater)	6,957.00 ft

### Outlet Connectivity

Structure Type	Outlet ID	Direction	Outfall	E1 (ft)	E2 (ft)
Stand Pipe	Riser - 1	Forward	TW	6,957.00	6,958.00
Orifice-Area	Orifice - 1	Forward	TW	6,955.25	6,958.00
Rectangular Weir	Weir - 1	Forward	TW	6,957.00	6,958.00
Tailwater Settings	Tailwater			(N/A)	(N/A)

Subsection: Outlet Input Data  
Label: SEDIMENT BASIN

Return Event: 100 years  
Storm Event: TYPEIIA 24HR (4.4 in)

Structure ID: Weir - 1	
Structure Type: Rectangular Weir	
Number of Openings	1
Elevation	6,957.00 ft
Weir Length	35.00 ft
Weir Coefficient	3.00 (ft <sup>0.5</sup> )/s
Structure ID: Riser - 1	
Structure Type: Stand Pipe	
Number of Openings	1
Elevation	6,957.00 ft
Diameter	8.0 In
Orifice Area	0.3 ft <sup>2</sup>
Orifice Coefficient	0.600
Weir Length	2.09 ft
Weir Coefficient	3.00 (ft <sup>0.5</sup> )/s
K Reverse	1.000
Manning's n	0.000
Kev, Charged Riser	0.000
Weir Submergence	False
Orifice H to crest	True
Structure ID: Orifice - 1	
Structure Type: Orifice-Area	
Number of Openings	5
Elevation	6,955.25 ft
Orifice Area	0.0 ft <sup>2</sup>
Top Elevation	6,956.92 ft
Datum Elevation	6,955.25 ft
Orifice Coefficient	0.600
Structure ID: TW	
Structure Type: TW Setup, DS Channel	
Tailwater Type	Free Outfall
Convergence Tolerances	
Maximum Iterations	30
Tailwater Tolerance (Minimum)	0.01 ft
Tailwater Tolerance (Maximum)	0.50 ft
Headwater Tolerance (Minimum)	0.01 ft
Headwater Tolerance (Maximum)	0.50 ft



Subsection: Outlet Input Data  
Label: SEDIMENT BASIN

Return Event: 100 years  
Storm Event: TYPEIIA 24HR (4.4 in)

Convergence Tolerances	
Flow Tolerance (Minimum)	0.001 ft <sup>3</sup> /s
Flow Tolerance (Maximum)	10.000 ft <sup>3</sup> /s

Subsection: Elevation-Volume-Flow Table (Pond)  
Label: SEDIMENT BASIN

Return Event: 100 years  
Storm Event: TYPEIIA 24HR (4.4 in)

Infiltration	
Infiltration Method (Computed)	No Infiltration
Initial Conditions	
Elevation (Water Surface, Initial)	6,954.00 ft
Volume (Initial)	0.000 ac-ft
Flow (Initial Outlet)	0.00 ft <sup>3</sup> /s
Flow (Initial Infiltration)	0.00 ft <sup>3</sup> /s
Flow (Initial, Total)	0.00 ft <sup>3</sup> /s
Time Increment	0.050 hours


Elevation (ft)	Outflow (ft <sup>3</sup> /s)	Storage (ac-ft)	Area (acres)	Infiltration (ft <sup>3</sup> /s)	Flow (Total) (ft <sup>3</sup> /s)	2S/t + O (ft <sup>3</sup> /s)
6,954.00	0.00	0.000	0.310	0.00	0.00	0.00
6,954.50	0.00	0.161	0.334	0.00	0.00	77.87
6,955.00	0.00	0.334	0.358	0.00	0.00	161.58
6,955.25	0.00	0.425	0.371	0.00	0.00	205.69
6,955.50	0.06	0.519	0.384	0.00	0.06	251.39
6,956.00	0.17	0.718	0.410	0.00	0.17	347.53
6,956.50	0.29	0.967	0.592	0.00	0.29	468.25
6,957.00	0.39	1.316	0.808	0.00	0.39	637.13
6,957.50	38.76	1.781	1.057	0.00	38.76	900.54
6,958.00	107.17	2.378	1.340	0.00	107.17	1,258.36

## **APPENDIX D**

### **Drainage Maps**

Also provide existing and proposed plans for the whole development as discussed previously. (Copy from approved Filing 2 report)







NOT FOR  
CONSTRUCTION

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE  
AND ARE THE PROPERTY OF GALLOWAY, AND MAY  
NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED  
WITHOUT THE WRITTEN CONSENT OF GALLOWAY.  
COPYRIGHTS AND INFRINGEMENTS WILL BE  
ENFORCED AND PROSECUTED.



# BENT GRASS MEADOW DRIVE & MERIDIAN ROAD ROADWAY IMPROVEMENTS DRAINAGE PLAN



BEN | GRASS MEADOWS DRIVE & MERIDIAN ROAD  
COLORADO SPRINGS, COLORADO

[illegible]

Project No:	CLH15.20
Drawn By:	BHB
Checked By:	SMB
Date:	NOVEMBER 2019

## HISTORIC DRAINAGE MAP

DR-2

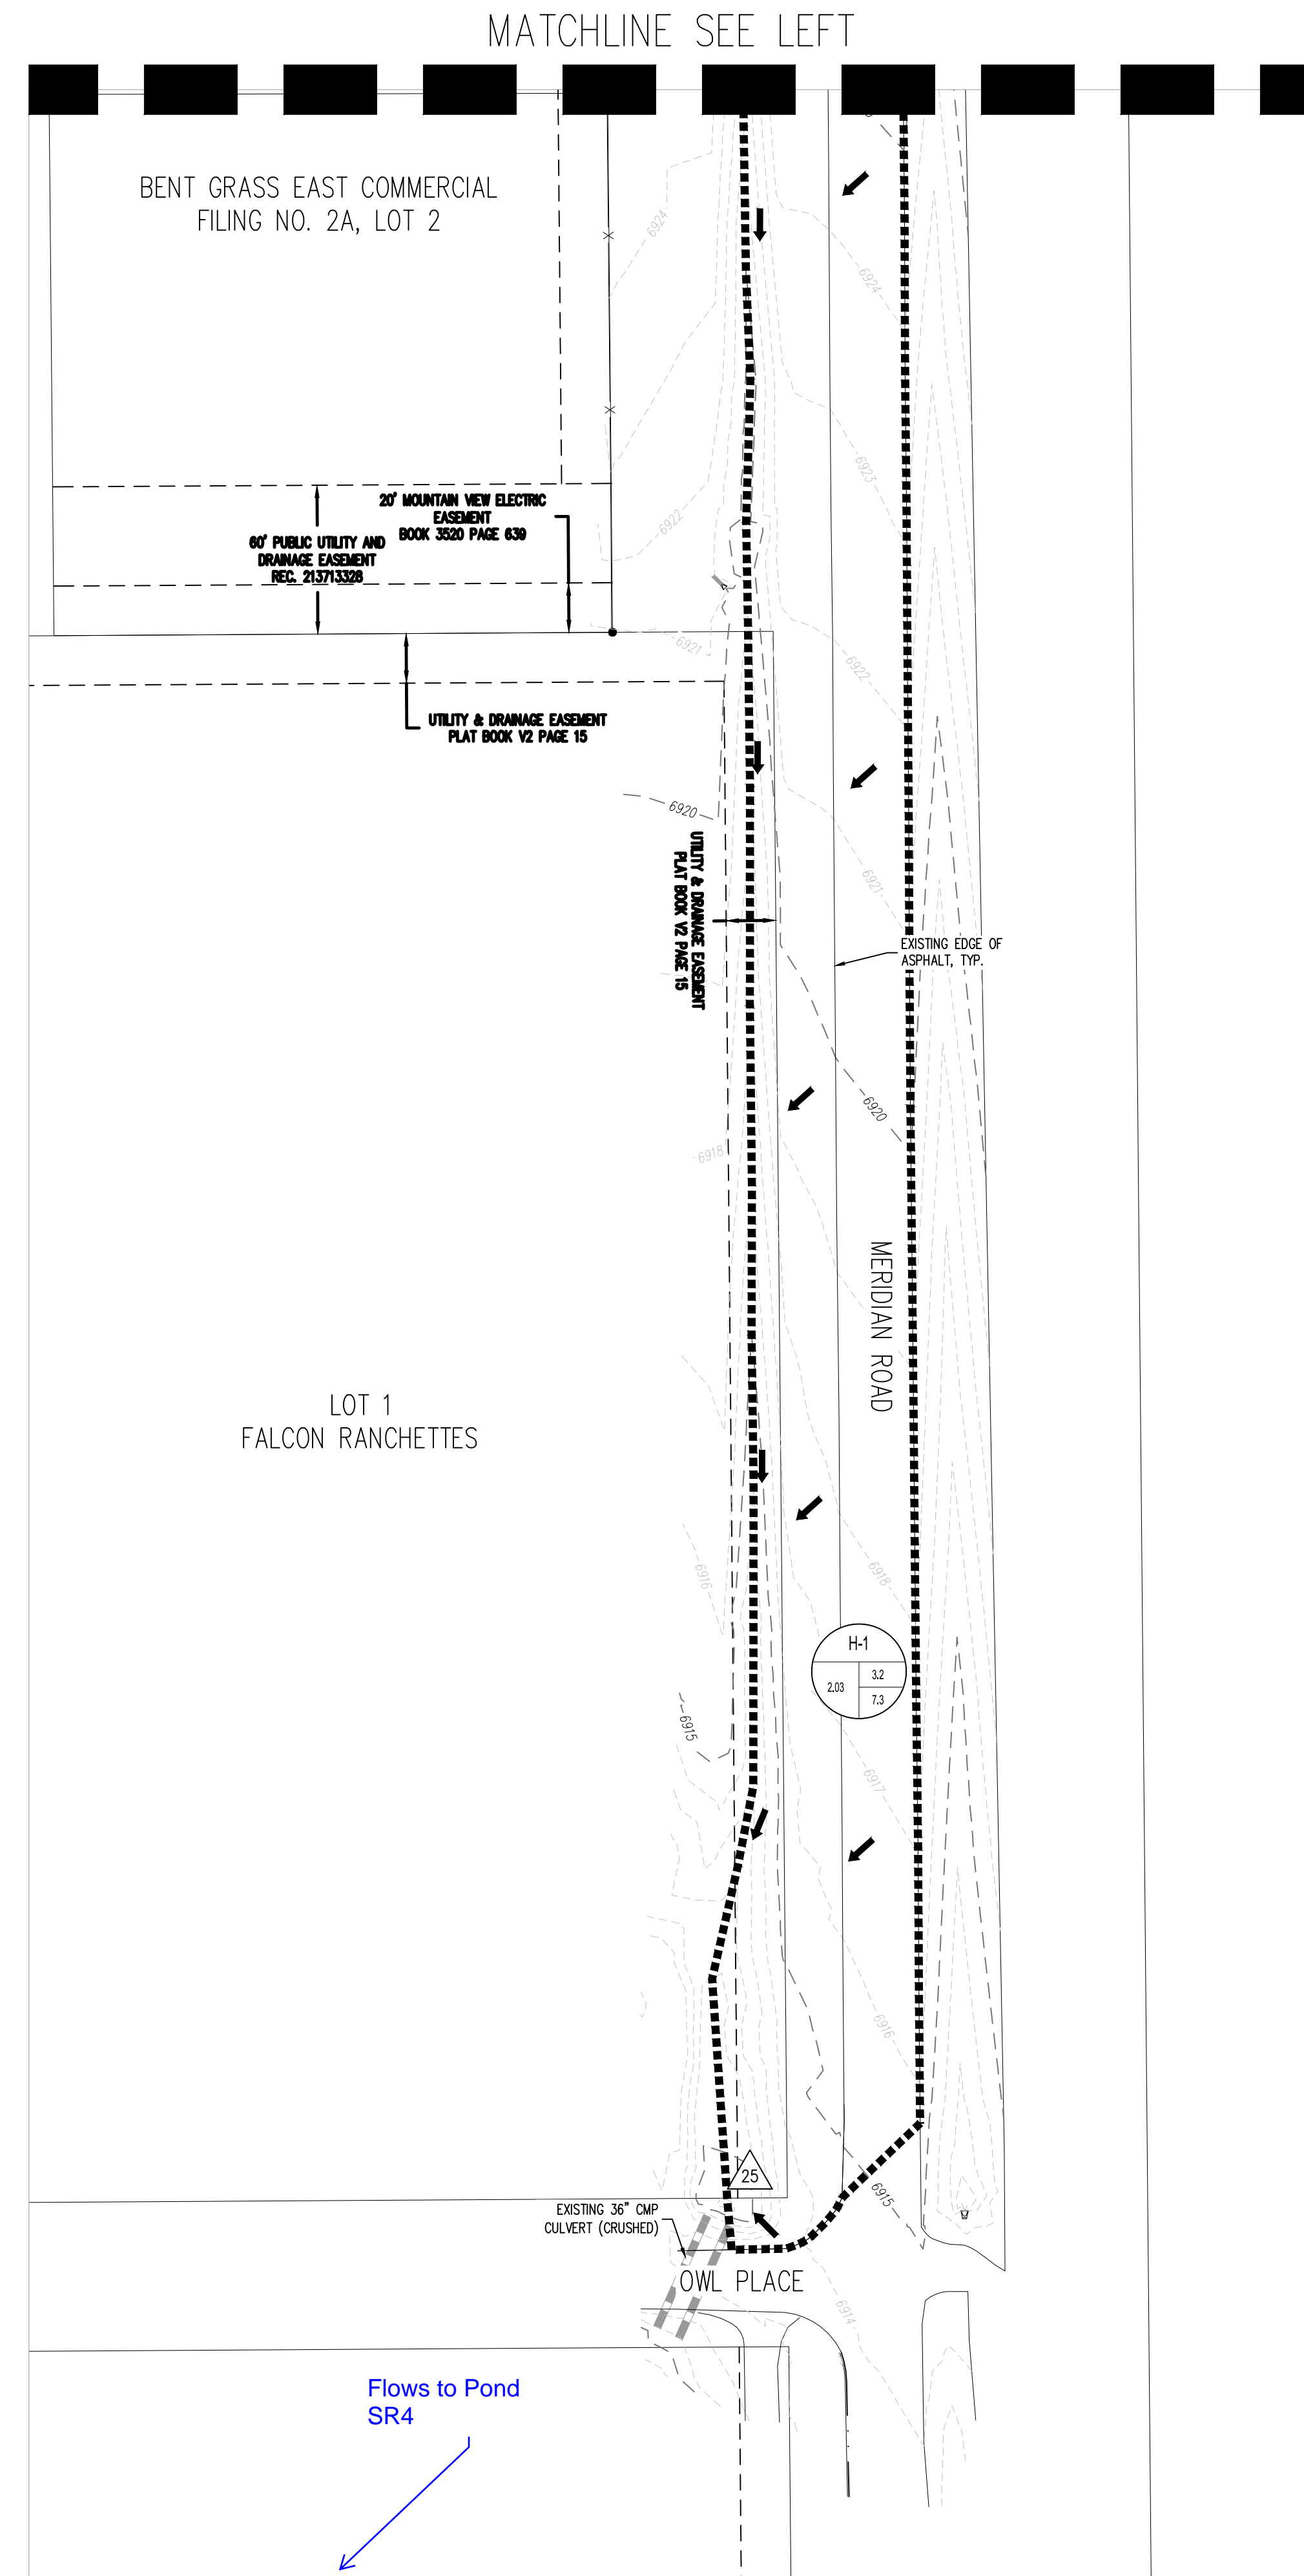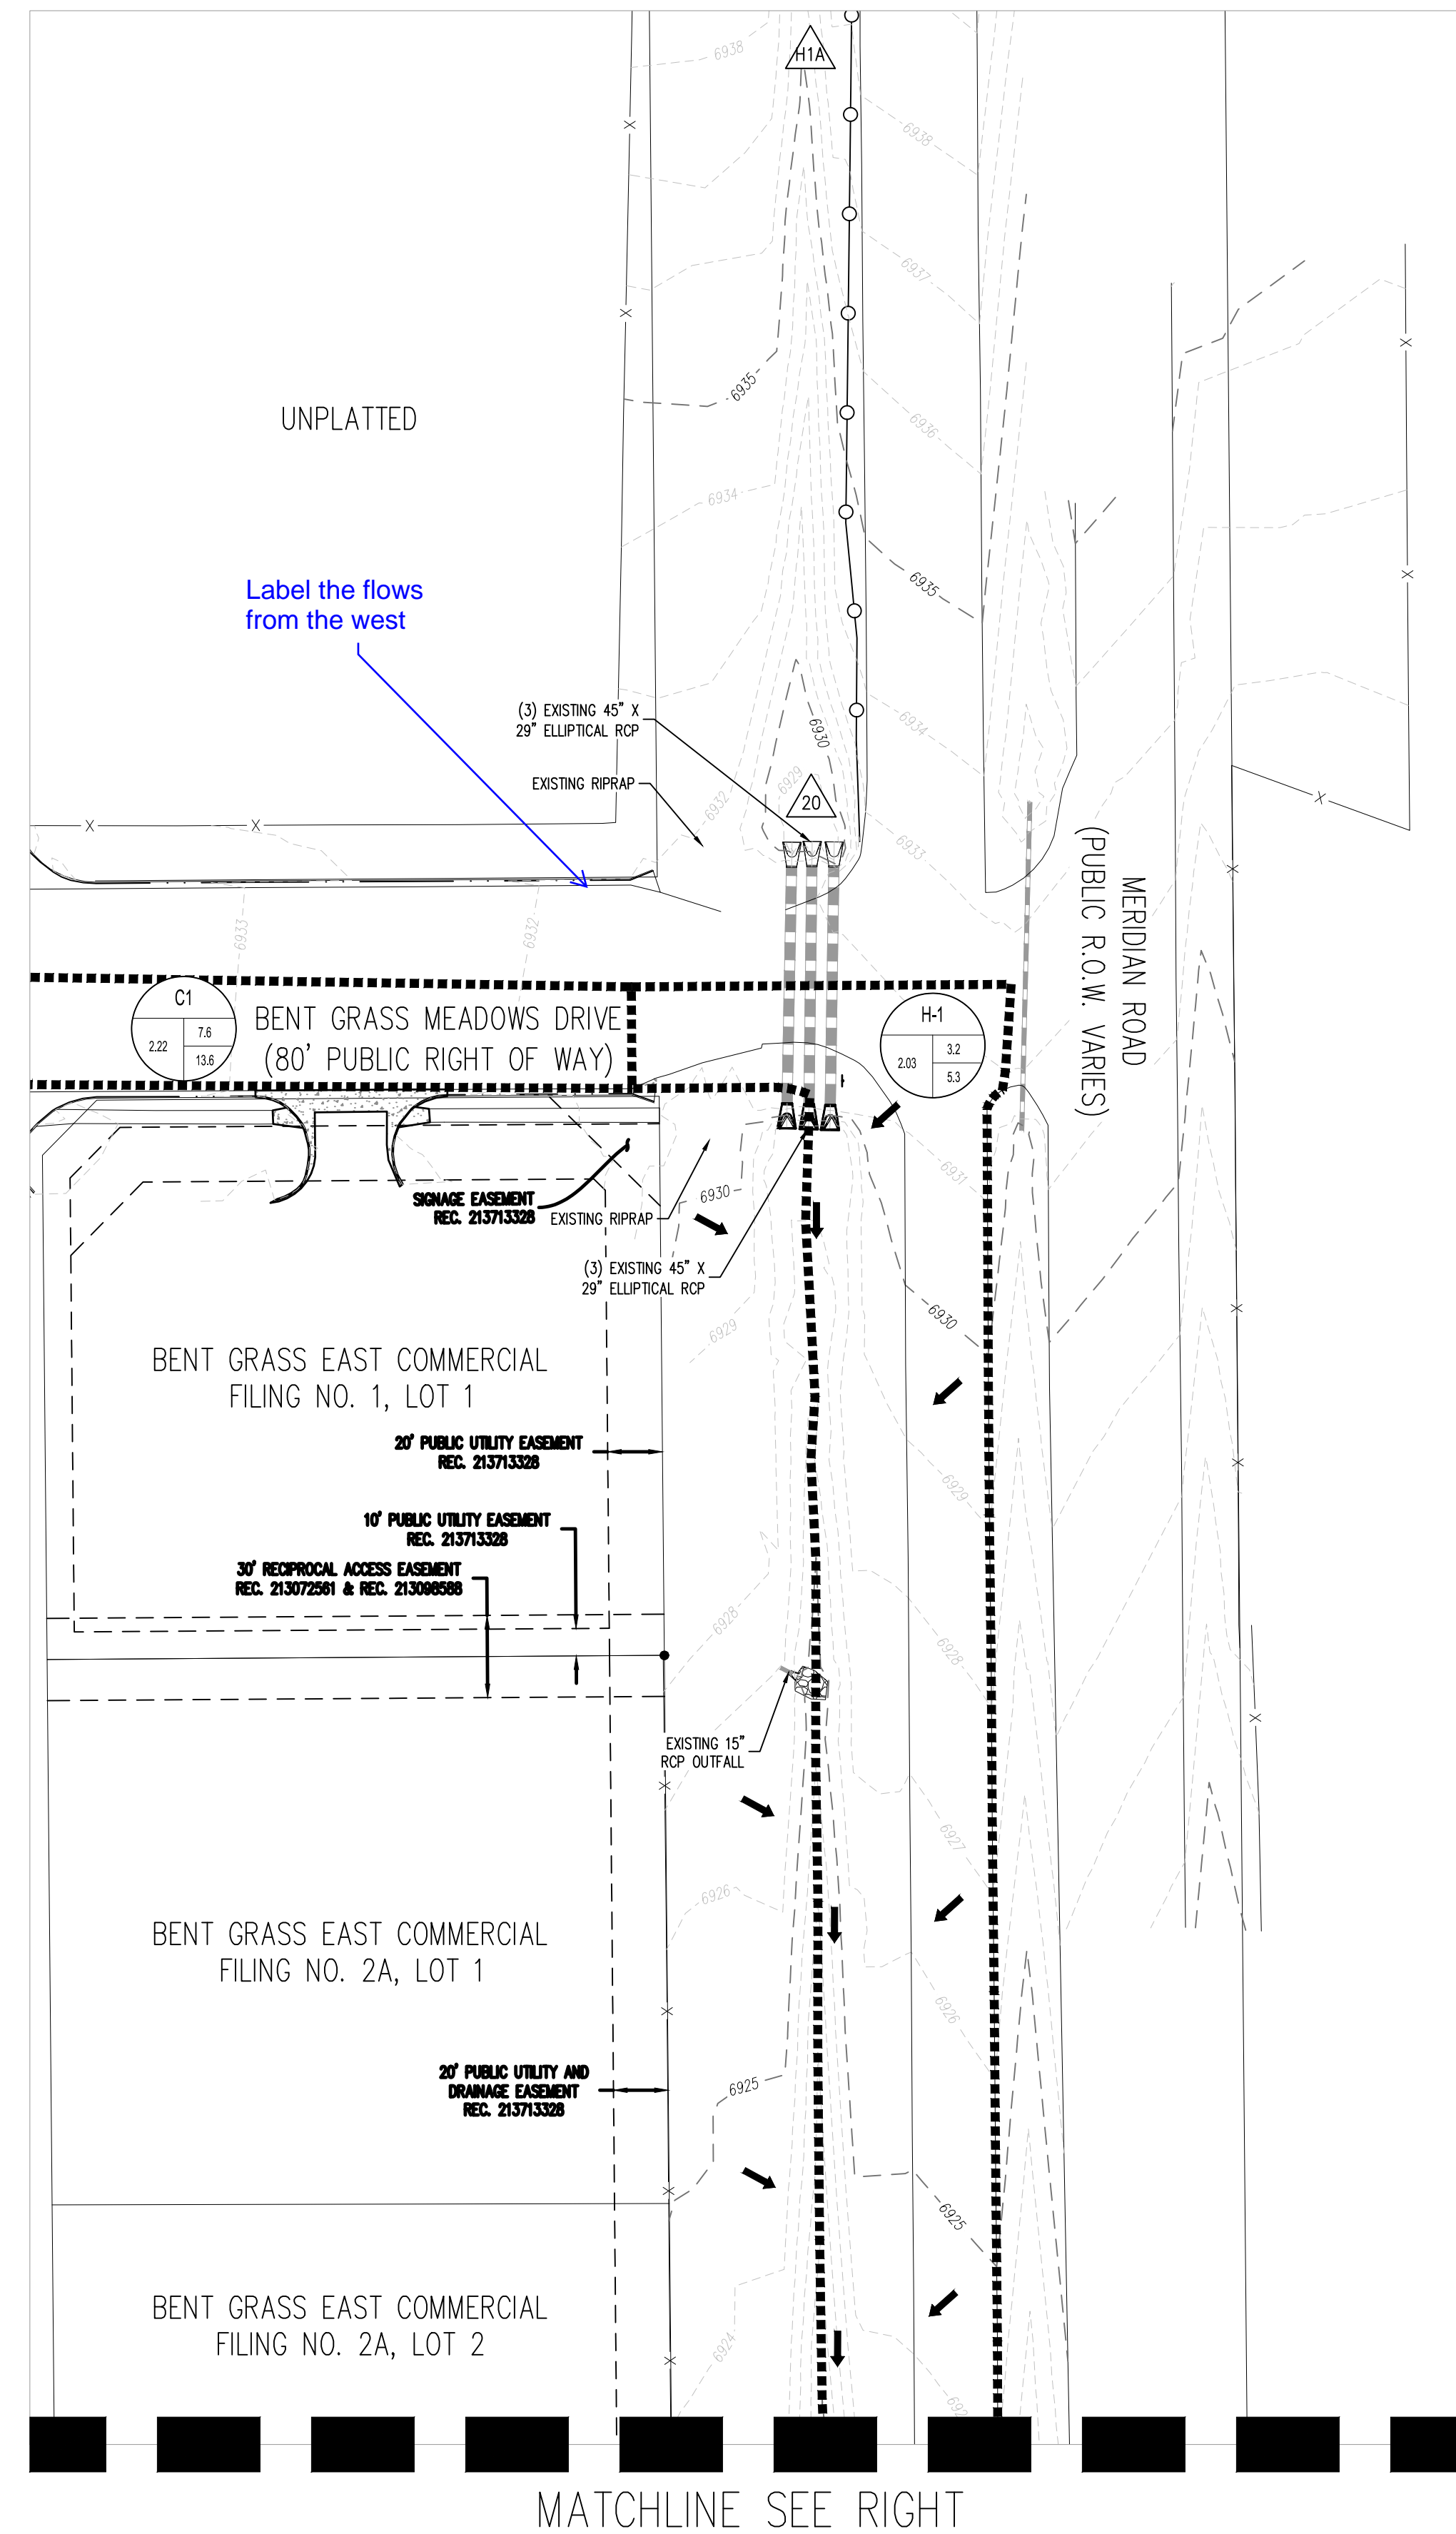

Chemical name	Molecular formula	EC number	Chemical structure	Chemical name	Chemical structure
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	
Phenylacetylene	$C_8H_6$	100-51-8		Phenylacetylene	



Developed

12P needs to meet  
FSD requirements  
for developed  
condition



1755 Telstar Drive, Suite 107  
Colorado Springs, CO 80920  
719.900.7220  
[GallowayUS.com](http://GallowayUS.com)

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE  
AND ARE THE PROPERTY OF GALLOWAY, AND MAY  
NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED  
WITHOUT THE WRITTEN CONSENT OF GALLOWAY.  
COPYRIGHTS AND INFRINGEMENTS WILL BE  
ENFORCED AND PROSECUTED.

BENT GRASS MEADOW DRIVE & MERIDIAN ROAD  
ROADWAY IMPROVEMENTS  
DRAINAGE PLAN

BENT GRASS MEADOWS DRIVE & MERIDIAN ROAD  
COLORADO SPRINGS, COLORADO

Project No:	CLH000014.20
Drawn By:	CMWJ
Checked By:	SMB
Date:	OCTOBER 2019

## PROPOSED DRAINAGE MAP OFFSITE

Sheet 1 of 1



NOT FOR  
CONSTRUCTION

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE  
AND ARE THE PROPERTY OF GALLOWAY, AND MAY  
NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED  
WITHOUT THE WRITTEN CONSENT OF GALLOWAY.  
COPYRIGHTS AND INFRINGEMENTS WILL BE  
ENFORCED AND PROSECUTED.

# CHALLENGER HOMES

# BENT GRASS MEADOW DRIVE & MERIDIAN ROAD ROADWAY IMPROVEMENTS DRAINAGE PLAN


BENT GRASS MEADOWS DRIVE & MERIDIAN ROAD  
COLORADO SPRINGS, COLORADO

[illegible]




Project No:	CLH15.20
Drawn By:	BHB
Checked By:	SMB
Date:	NOVEMBER 2019

## PROPOSED DRAINAGE MAP

DR-4

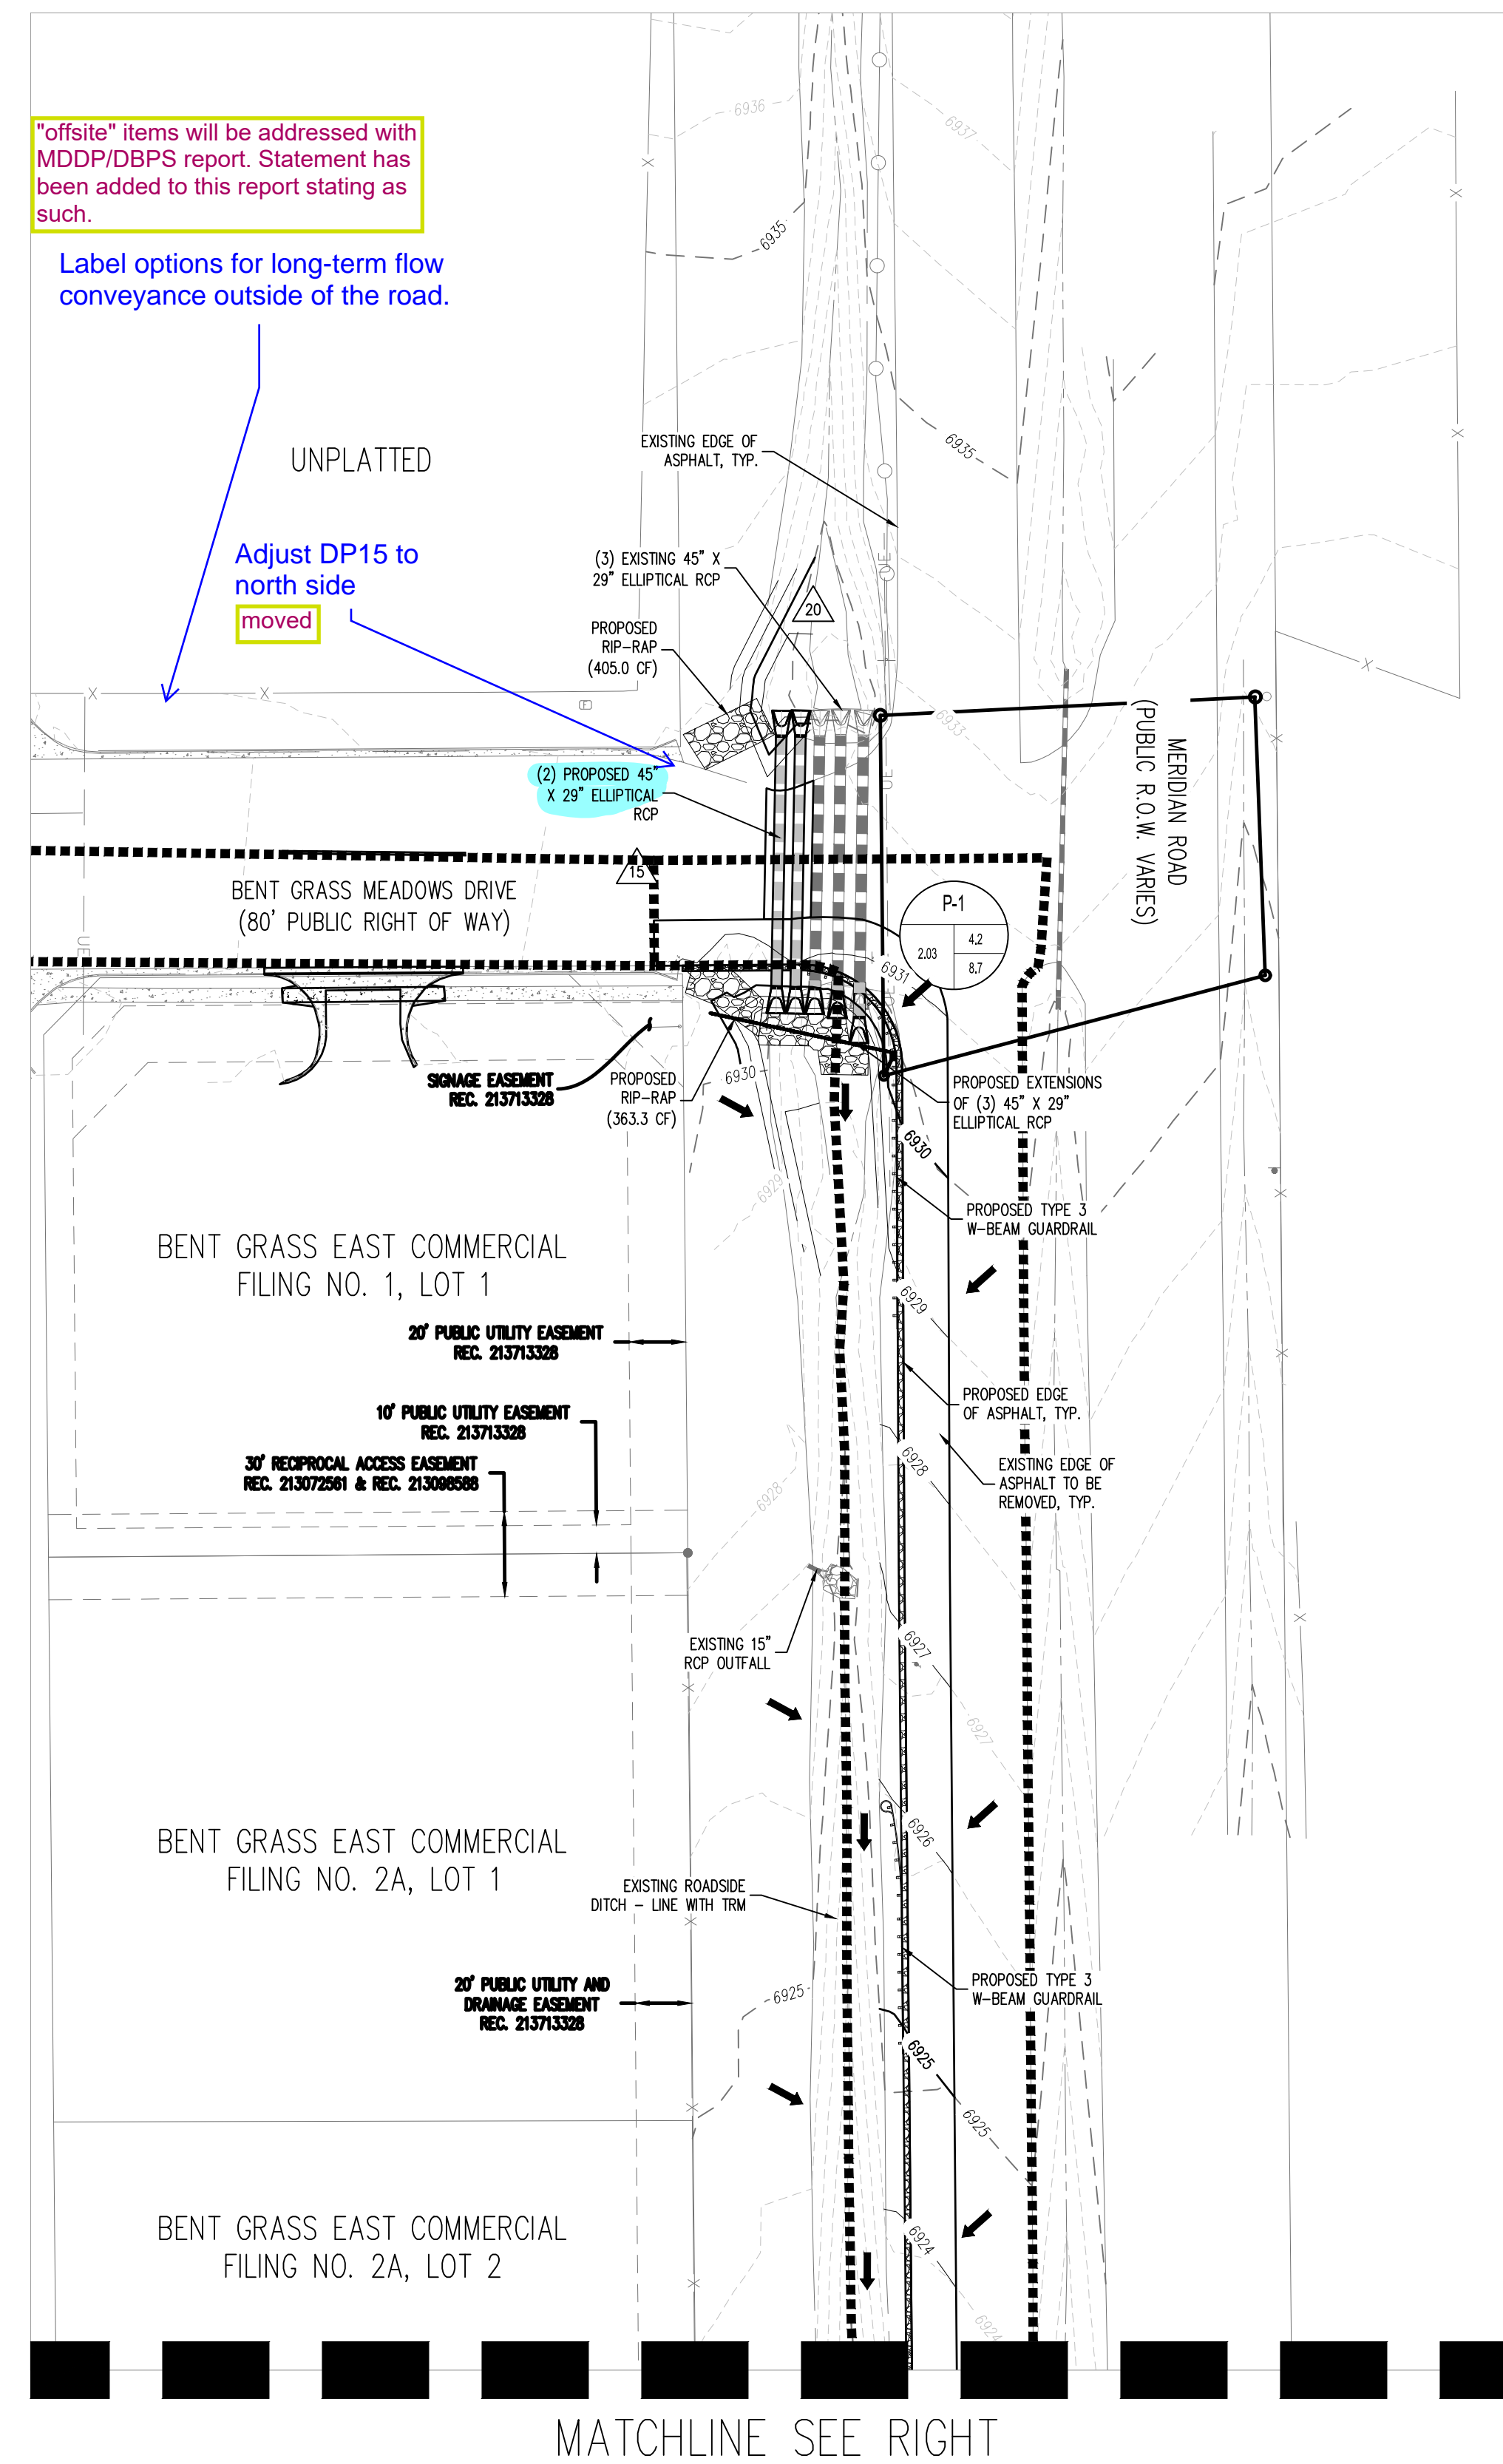

Flows to Pond SR4  
(see comment letter)

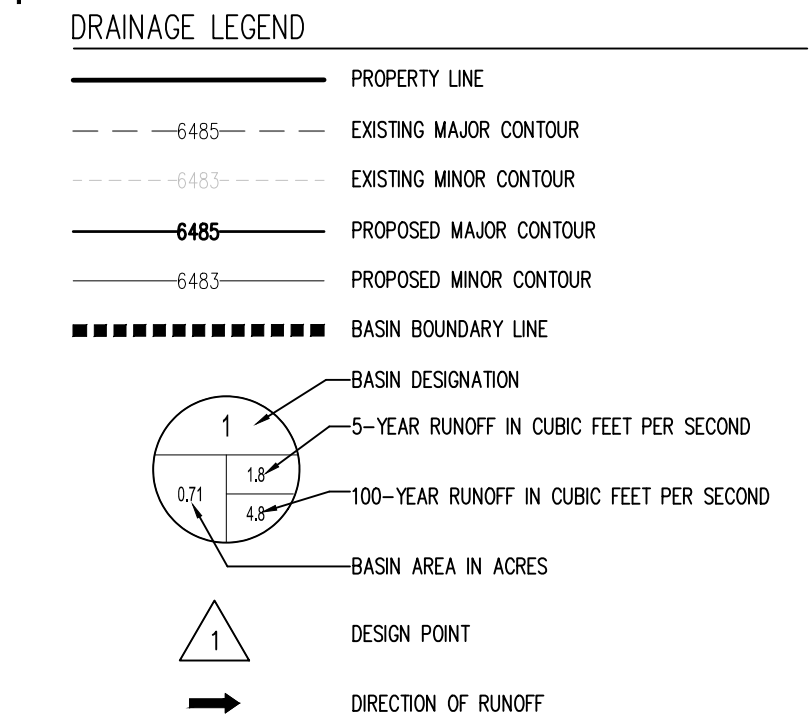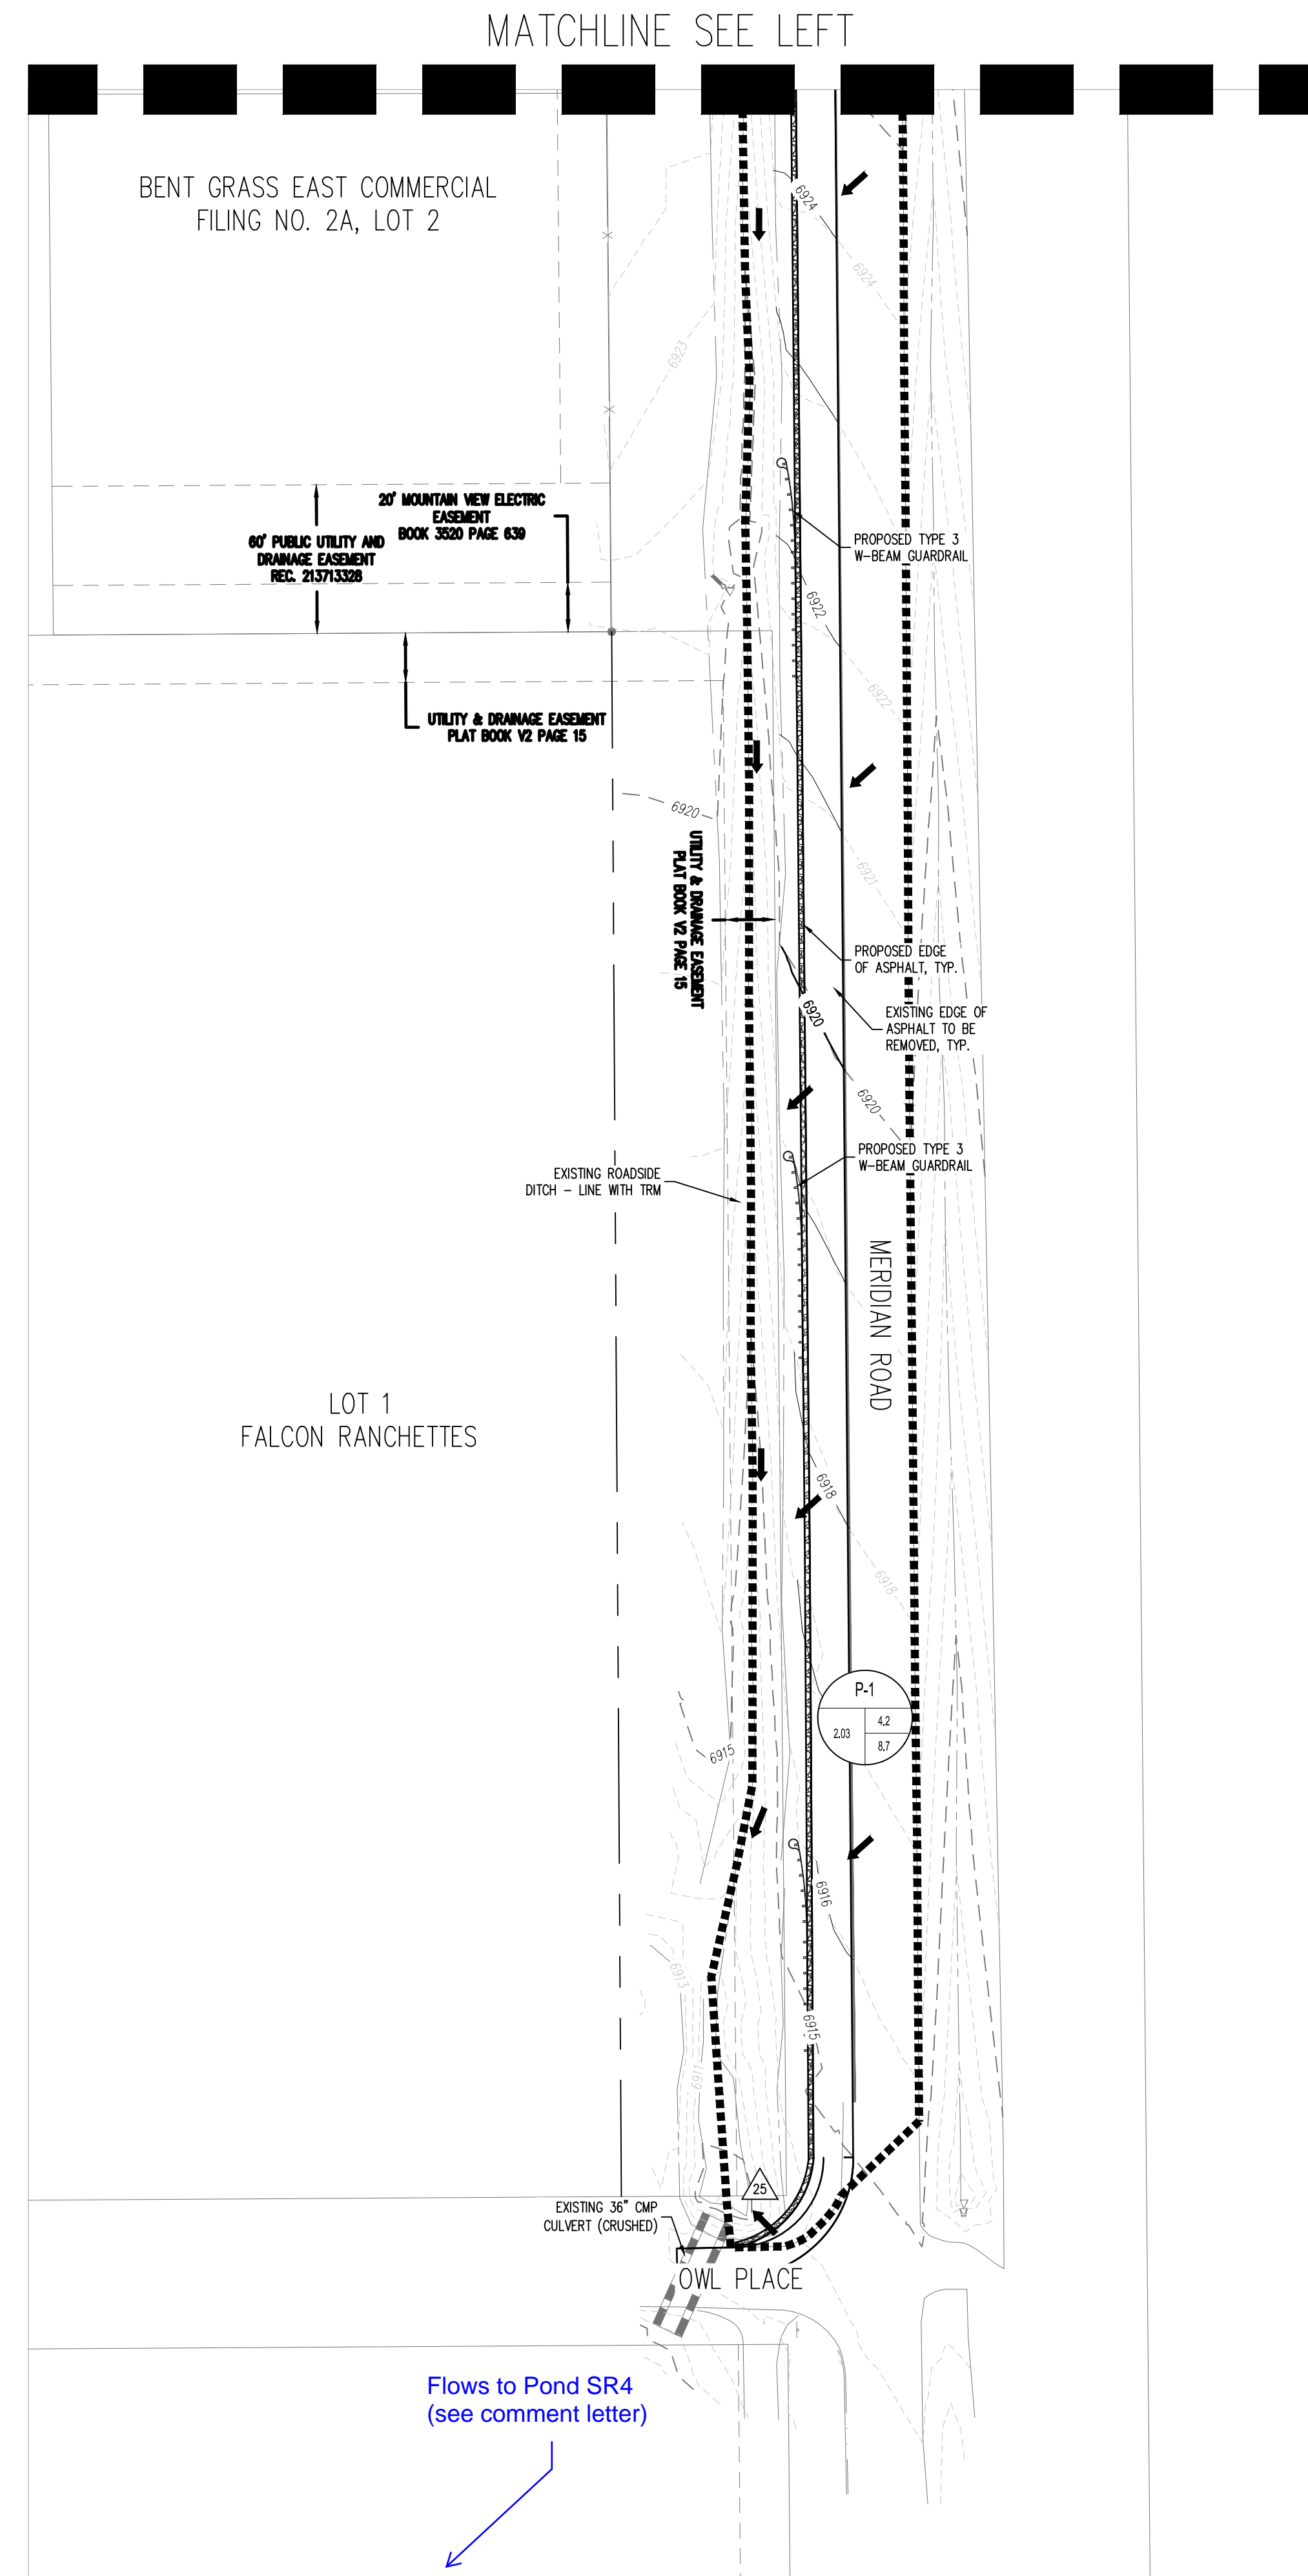

<b>Tributary Sub-basin</b>	<b>Area (acres)</b>	<b>Cs</b>	<b>C100</b>	<b>t<sub>c</sub> (min)</b>	<b>Qs (cfs)</b>	<b>Q100 (cfs)</b>
OS-5	14.13	0.11	0.37	19.44	4.85	27.51
OS-6	5.81	0.09	0.36	13.89	1.89	12.75
H3	11.30	0.09	0.36	18.67	3.25	21.82
OS-2	4.42	0.09	0.36	14.17	1.94	9.62
OS-3	10.24	0.09	0.36	13.89	3.35	22.51
C1	2.22	0.90	0.96	12.50	7.58	13.57
P-1	2.03	0.47	0.64	16.83	4.23	8.73

DESIGN POINT SUMMARY TABLE		
Design Point	Q <sub>5</sub> (cfs)	Q <sub>100</sub> (cfs)
30	23.0	43.0
11	4.9	27.5
12	6.7	40.3
12P	0.0	4.2
15	13.8	65.7
H1A	280.0	850.0
20	293.8	915.7
25	298.1	924.5