



Development Services Department
2880 International Circle
Colorado Springs, Colorado 80910

Phone: 719.520.6300
Fax: 719.520.6695
Website: www.elpasoco.com

DEVIATION REVIEW AND DECISION FORM

Procedure # R-FM-051-07
Issue Date: 12/31/07
Revision Issued: 00/00/00

DSD FILE NO.:

--	--	--	--	--	--	--	--

General Property Information:

Address of Subject Property (Street Number/Name): 9210 Arroya Lane

Tax Schedule ID(s) #: 5222000023

Legal Description of Property:

Basis of bearings: The east line of the Southwest One-Quarter (SW1/4) of Section 22, Township 12 South, Range 65 West and is assumed to bear N 00° 18' 04" E, a distance of 2640.26 feet.

Commencing at the southeast corner of the Southwest One-Quarter (SW1/4) of said Section 22;

Thence S 88° 38' 37"W along the south line of the Southeast One-Quarter of the Southwest One-Quarter (SE 1/4 SW1/4), a distance of 30.00 feet to the point of beginning of the parcel of land herein described;

Thence S 88° 38' 37"W along said south line, a distance of 1300.52 feet to the southwest corner of the Southeast One-Quarter of the Southwest One-Quarter (SE 1/4 SW1/4);

Thence S 88° 38' 56"W along the south line of the Southeast One-Quarter of the Southwest One-Quarter (SE 1/4 SW1/4), a distance of 898.51 feet;

Thence N 47° 35' 42" E, a distance of 105.23 feet;

Thence N 36° 59' 01" E, a distance of 517.38 feet;

Thence N 56° 32' 31" E, a distance of 489.24 feet;

Thence N 38° 17' 19" E, a distance of 182.67 feet;

Thence N 89° 41' 56" E, a distance of 1283.66 feet;

Subdivision or Project Name: Timberridge Estates

Section of ECM from Which Deviation is Sought: DCM Section 6.4.2

Specific Criteria from Which a Deviation is Sought: "For box culverts classified as bridges or culverts at major drainageways (100-year flows greater than 1500 cfs) adequate freeboard shall be provided for the passage of debris and should be no less than 2 feet."

El Paso County Procedures Manual
 Procedure # R-FM-051-07
 Issue Date: 12/31/07
 Revision Issued: 00/00/00
 DSD File No.

The invert at the proposed culvert outlet is at an elevation of 7232'. Per FEMA, the 100-year flood elevation at the culvert outlet is 7242'. Based on this, both of the culvert designs will be submerged during a 100-year flood event, and 2' of freeboard will not be possible due to flood water conditions, regardless of what the culvert design calculations show for headwater. In other words, due to the relatively narrow creek bed, the capacity of the culvert designs is not the controlling factor for the 100-year water level.

Constructing even taller culverts, say 12' tall, would provide the 2' of freeboard above the floodwater level, but would worsen the visibility impact problem and would conflict with the proposed alignment for Arroya Lane. Additionally, the requirement to further raise the Arroya Lane surface would require that the culverts be lengthened, further increases the disturbance to Sand Creek and the cost.

As both the 3-6'x12' culvert design and the 3-10'x15' culvert design will not provide any freeboard at the 100-year event due to the floodwater level, it is requested that the 3-6'x12' design be allowed. This design provides the capacity to accommodate the 100-year event, while avoiding the visibility impact problem and allowing for less expense for the culvert construction.

Comparison of Proposed Deviation to ECM Standard: As designing the box culverts to provide 2' of freeboard still results in the culverts being submerged during a 100-year event, there is no difference in actual freeboard between the proposed culvert design and the culvert design that follows the DCM standard.

Applicable Regional or National Standards used as Basis: Not applicable.

Application Consideration:

CHECK IF APPLICATION MEETS CRITERIA FOR CONSIDERATION

JUSTIFICATION

☐ The ECM standard is inapplicable to a particular situation.

☐ Topography, right-of-way, or other geographical conditions or impediments impose an undue hardship on the applicant, and an equivalent alternative that can accomplish the same design objective is available and does not compromise public safety or accessibility.

X A change to a standard is required to address a specific design or construction problem, and if not modified, the standard will impose an undue hardship on the applicant with little or no material benefit to the

Due to the floodwater elevation, designing the proposed culverts to provide 2' of freeboard does not actually result in any freeboard being provided, while it does cause a visibility impact problem and increases the cost of constructing the

El Paso County Procedures Manual

Procedure # R-FM-051-07

Issue Date: 12/31/07

Revision Issued: 00/00/00

DSD File No. _____

public.

culverts. Since following this specific portion of the standards increases the cost without provided the specified results, it will impose an undue hardship on the applicant with little or no material benefit to the public.

If at least one of the criteria listed above is not met, this application for deviation cannot be considered.

Criteria for Approval:

PLEASE EXPLAIN HOW EACH OF THE FOLLOWING CRITERIA HAVE BEEN SATISFIED BY THIS REQUEST

The request for a deviation is not based exclusively on financial considerations.	This deviation will eliminate a visual impact problem, while also allowing the use of a less expensive design that results in the same freeboard as the more expensive design.
The deviation will achieve the intended result with a comparable or superior design and quality of improvement.	As both the per standards design (3-10'x15' culverts) and the proposed design (3-6'x12' culverts) will not provide any freeboard at the 100-year event due to the floodwater level, and both designs provided the flow capacity required for the 100-year event, both the per standards design and the proposed design achieve the same result.
The deviation will not adversely affect safety or operations.	As both the per standards design (3-10'x15' culverts) and the proposed design (3-6'x12' culverts) provide the flow capacity required for the 100-year event and have zero freeboard due to the floodwater elevation, the safety and operations of both designs are equivalent.
The deviation will not adversely affect maintenance and its associated cost.	As both the per standards design (3-10'x15' culverts) and the proposed design (3-6'x12' culverts) provide the flow capacity required for the 100-year event and have zero freeboard due to the floodwater elevation, the effect on maintenance and its associated costs of both designs are equivalent.
The deviation will not adversely affect aesthetic appearance.	Granting this deviation will allow for the elimination of the visual impact problem that the per standards design creates.

Owner, Applicant and Engineer Declaration:

To the best of my knowledge, the information on this application and all additional or supplemental documentation is true, factual and complete. I am fully aware that any misrepresentation of any information on this application may be grounds for denial. I have familiarized myself with the rules, regulations and procedures with respect to preparing and filing this application. I also understand that an incorrect submittal will be cause to have the project removed from the agenda of the Planning Commission, Board of County Commissioners and/or Board of Adjustment or delay review, and that any approval of this application is based on the representations made in the application and may be revoked on any breach of representation or condition(s) of approval.

_____ Signature of owner (or authorized representative)	_____ Date
--	---------------

_____ Signature of applicant (if different from owner)	_____ Date
---	---------------

_____ Signature of Engineer	_____ Date
--------------------------------	---------------

Engineer's Seal

Review and Recommendation:
APPROVED by the ECM Administrator

_____ Date _____
This request has been determined to have met the criteria for approval. A deviation from Section _____ of ECM is hereby granted based on the justification provided. Comments:

_____ Additional comments or information are attached.

DENIED by the ECM Administrator


_____ Date _____
This request has been determined not to have met criteria for approval. A deviation from Section _____ of ECM is hereby denied. Comments:

_____ Additional comments or information are attached.

BOX CONDUIT FLOW (Normal & Critical Depth Computation)

Project: **Timberridge Estates**

Box ID: **Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-6'x12' Conc Box Culverts**

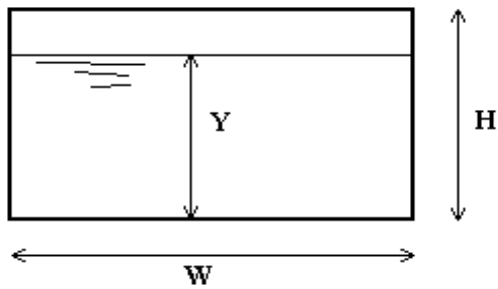

Design Information (Input)

Box conduit invert slope	So =	0.0100	ft/ft
Box Manning's n-value	n =	0.0130	
Box Width	W =	12.00	ft
Box Height	H =	6.00	ft
Design discharge	Q =	869.00	cfs

Full-flow capacity (Calculated)

Full-flow area	Af =	72.00	sq ft
Full-flow wetted perimeter	Pf =	36.00	ft
Full-flow capacity	Qf =	1309.97	cfs

Calculations of Normal Flow Condition

Normal flow depth (<H)	Yn =	3.66	ft
Flow area	An =	43.87	sq ft
Wetted perimeter	Pn =	19.31	ft
Flow velocity	Vn =	19.81	fps
Discharge	Qn =	869.00	cfs
Percent Full	Flow =	66.3%	of full flow
Normal Depth Froude Number	Fr _n =	1.83	supercritical

Calculation of Critical Flow Condition


Critical flow depth	Yc =	5.46	ft
Critical flow area	Ac =	65.53	sq ft
Critical flow velocity	Vc =	13.26	fps
Critical Depth Froude Number	Fr _c =	1.00	

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: **Timberidge Estates**

Basin ID: **Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-6'x12' Conc Box Culverts**

Status:

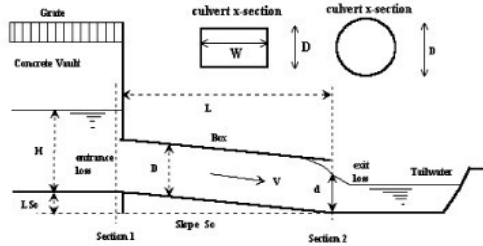

Design Information (Input):

Circular Culvert: Barrel Diameter in Inches

Inlet Edge Type (choose from pull-down list)

D = inches

Grooved End Projection

OR:

Box Culvert: Barrel Height (Rise) in Feet

Barrel Width (Span) in Feet

Inlet Edge Type (choose from pull-down list)

Height (Rise) = ft.

Width (Span) = ft.

Square Edge w/ 90-15 Deg. Headwall

Number of Barrels

Inlet Elevation at Culvert Invert

Outlet Elevation at Culvert Invert OR Slope of Culvert (ft v./ft h.)

Culvert Length in Feet

Manning's Roughness

Bend Loss Coefficient

Exit Loss Coefficient

No =

Inlet Elev = ft. elev.

Outlet Elev = ft. elev.

L = ft.

n =

K_b =

K_x =

Design Information (calculated):

Entrance Loss Coefficient

Friction Loss Coefficient

Sum of All Loss Coefficients

Orifice Inlet Condition Coefficient

Minimum Energy Condition Coefficient

K_e =

K_f =

K_a =

C_d =

KE_{low} =

Calculations of Culvert Capacity (output):


Water Surface Elevation (ft., linked)	Tailwater Surface Elevation ft	Culvert Inlet-Control Flowrate cfs	Culvert Outlet-Control Flowrate cfs	Controlling Culvert Flowrate cfs (output)	Inlet Equation Used:	Flow Control Used
7233.00		0.00	0.00	0.00	No Flow (WS < inlet)	N/A
7233.50		32.70	605.74	32.70	Min. Energy. Eqn.	INLET
7234.00		92.40	737.63	92.40	Min. Energy. Eqn.	INLET
7234.50		169.50	863.44	169.50	Min. Energy. Eqn.	INLET
7235.00		260.70	983.37	260.70	Min. Energy. Eqn.	INLET
7235.50		364.50	1,097.81	364.50	Min. Energy. Eqn.	INLET
7236.00		479.10	1,207.17	479.10	Min. Energy. Eqn.	INLET
7236.50		607.50	1,312.01	607.50	Regression Eqn.	INLET
7237.00		745.50	1,412.54	745.50	Regression Eqn.	INLET
7237.50		892.80	1,509.35	892.80	Regression Eqn.	INLET
7238.00		1,047.30	1,602.63	1,047.30	Regression Eqn.	INLET
7238.50		1,206.60	1,692.77	1,206.60	Regression Eqn.	INLET
7239.00		1,367.70	1,780.18	1,367.70	Regression Eqn.	INLET
7239.50		1,527.30	1,947.14	1,527.30	Regression Eqn.	INLET
7240.00		1,683.30	2,104.90	1,683.30	Regression Eqn.	INLET
7240.50		1,833.90	2,255.01	1,833.90	Regression Eqn.	INLET
7241.00		1,978.20	2,398.26	1,978.20	Regression Eqn.	INLET
7241.50		2,115.60	2,535.44	2,115.60	Regression Eqn.	INLET
7242.00		2,246.70	2,667.52	2,246.70	Regression Eqn.	INLET
7242.50		2,371.50	2,794.51	2,371.50	Regression Eqn.	INLET
7243.00		2,490.60	2,917.38	2,490.60	Regression Eqn.	INLET
7243.50		2,604.30	3,042.41	2,604.30	Regression Eqn.	INLET
7244.00		2,713.20	3,177.82	2,713.20	Regression Eqn.	INLET
7244.50		2,817.90	3,307.55	2,817.90	Regression Eqn.	INLET
7245.00		2,918.40	3,432.39	2,918.40	Regression Eqn.	INLET
7245.50		3,015.30	3,552.91	3,015.30	Regression Eqn.	INLET
7246.00		3,109.20	3,669.31	3,109.20	Regression Eqn.	INLET
7246.50		3,199.80	3,782.19	3,199.80	Regression Eqn.	INLET
7247.00		3,287.70	3,891.93	3,287.70	Regression Eqn.	INLET
7247.50		3,373.20	3,998.54	3,373.20	Regression Eqn.	INLET

Processing Time: 00.70 Seconds

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: Timberridge Estates


Basin ID: Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-6'x12' Conc Box Culverts

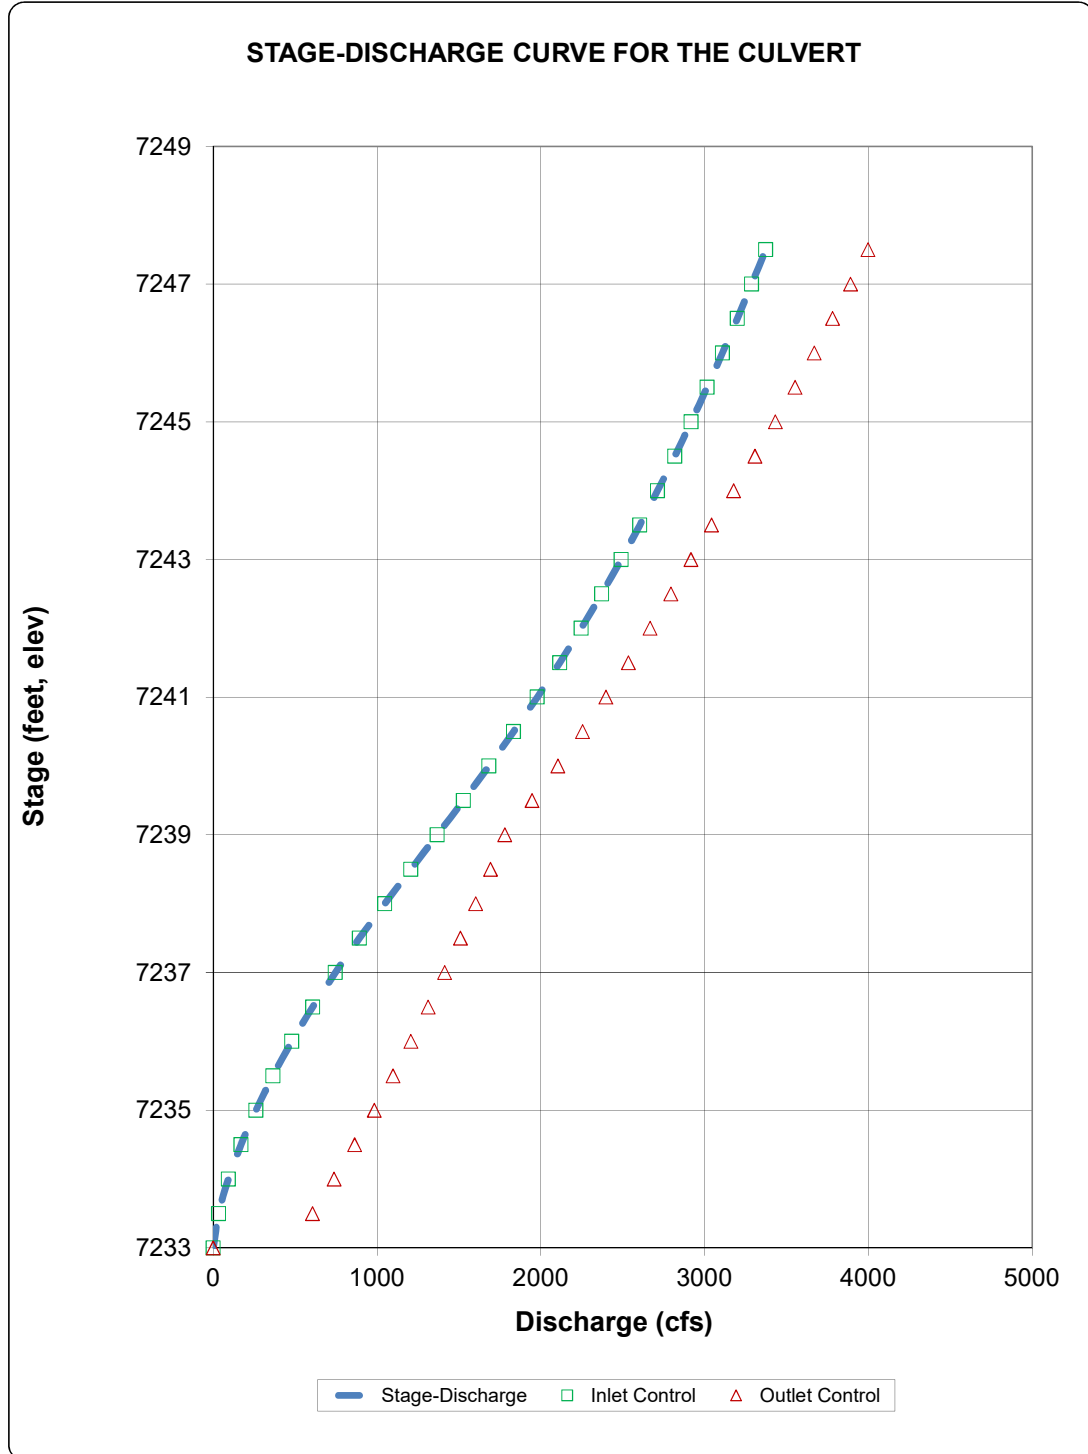

Determination of Culvert Headwater and Outlet Protection

Project: **Timberridge Estates**

Basin ID: **Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-6'x12' Conc Box Culverts**

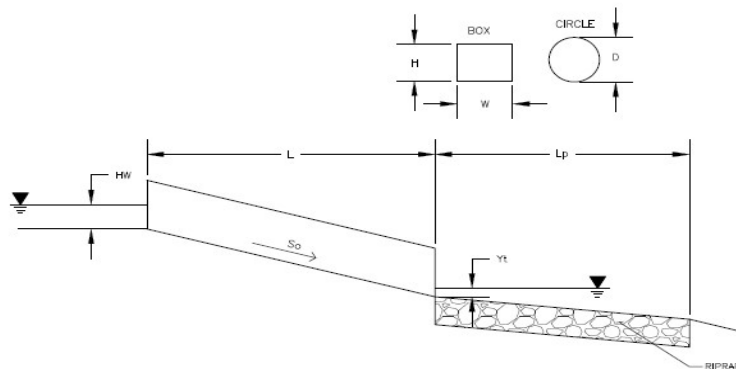

Soil Type:

Choose One:

☒ Sandy

☐ Non-Sandy

Supercritical Flow! Using H_a to calculate protection type.

Design Information (Input):

Design Discharge

Q = 2607 cfs

Circular Culvert:

Barrel Diameter in Inches

D = inches

Inlet Edge Type (Choose from pull-down list)

OR

Box Culvert:

Barrel Height (Rise) in Feet

Height (Rise) = 6 ft

Barrel Width (Span) in Feet

Width (Span) = 12 ft

Inlet Edge Type (Choose from pull-down list)

Square Edge w/ 90-15 Deg. Headwall

Number of Barrels

No = 3

Inlet Elevation

Elev IN = 7233 ft

Outlet Elevation **OR** Slope

Elev OUT = 7232 ft

Culvert Length

L = 100 ft

Manning's Roughness

n = 0.013

Bend Loss Coefficient

k_b = 0

Exit Loss Coefficient

k_x = 1

Tailwater Surface Elevation

Elev Y_t = ft

Max Allowable Channel Velocity

V = 5 ft/s

Required Protection (Output):

Tailwater Surface Height

Y_t = 2.40 ft

Flow Area at Max Channel Velocity

A_t = 173.80 ft²

Culvert Cross Sectional Area Available

A = 72.00 ft²

Entrance Loss Coefficient

k_e = 0.50

Friction Loss Coefficient

k_f = 0.29

Sum of All Losses Coefficients

k_s = 1.79

Culvert Normal Depth

Y_n = 3.66 ft

Culvert Critical Depth

Y_c = 5.46 ft

Tailwater Depth for Design

d = 5.73 ft

Adjusted Diameter **OR** Adjusted Rise

H_a = 4.83 ft

Expansion Factor

$1/(2*\tan(\Theta))$ = 2.85

Flow/Diameter^{2.5} **OR** Flow/(Span * Rise^{1.5})

$Q/WH^{1.5}$ = 4.93 ft^{0.5}/s

Froude Number

Fr = 1.83

Tailwater/Adjusted Diameter **OR** Tailwater/Adjusted Rise

Y_t/H = 0.50

Supercritical!

Inlet Control Headwater

HW_i = 10.51 ft

Outlet Control Headwater

HW_o = 8.77 ft

Design Headwater Elevation

HW = 7,243.51 ft

Headwater/Diameter **OR Headwater/Rise Ratio**

HW/H = 1.75 HW/H > 1.5!

Minimum Theoretical Riprap Size

d_{50} = 11 in

Nominal Riprap Size

d_{50} = 12 in

UDFCD Riprap Type

Type = M

Length of Protection

L_p = 60 ft


Width of Protection

T = 34 ft

Vertical Profile for the Culvert

Project = Timberridge Estates

Box ID = Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-6'x12' Conc Box Culverts

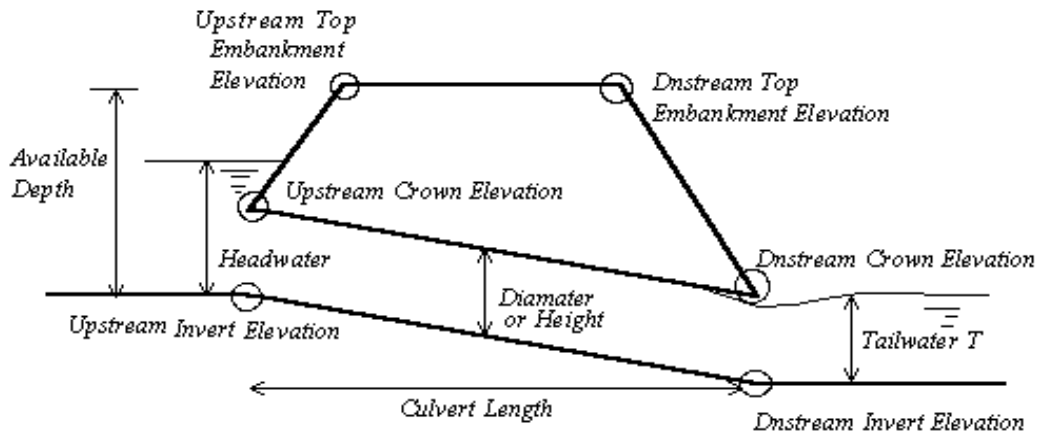

Culvert Information (Input)

Barrel Diameter or Height	D or H =	72.00	inches
Barrel Length	L =	100.00	ft
Barrel Invert Slope	So =	0.0100	ft/ft
Downstream Invert Elevation	EDI =	7232.00	ft
Downstream Top Embankment Elevation	EDT =	7244.00	ft
Upstream Top Embankment Elevation	EUT =	7244.00	ft
Design Headwater Depth (not elev.)	Hw =	8.70	ft
Tailwater Depth (not elev.)	Yt =	5.73	ft

Culvert Hydraulics (Calculated)

Available Headwater Depth	HW-a =	11.00	ft
Design Hw/D ratio	Hw/D =	1.45	


Culvert Vertical Profile

Upstream Invert Elevation	EUI =	7233.00	ft
Upstream Crown Elevation	EUC =	7239.00	ft
Upstream Soil Cover Depth	Upsoil =	5.00	ft
Downstream Invert Elevation	EDI =	7232.00	ft
Downstream Crown Elevation	EDC =	7238.00	ft
Downstream Soil Cover Depth	Dnsoil =	6.00	ft

BOX CONDUIT FLOW (Normal & Critical Depth Computation)

Project: **Timberridge Estates**

Box ID: **Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-10'x15' Conc Box Culverts**

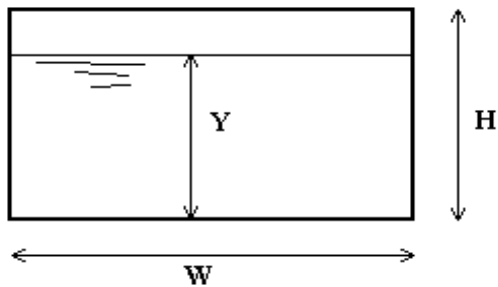

Design Information (Input)

Box conduit invert slope	So =	0.0100	ft/ft
Box Manning's n-value	n =	0.0130	
Box Width	W =	15.00	ft
Box Height	H =	10.00	ft
Design discharge	Q =	869.00	cfs

Full-flow capacity (Calculated)

Full-flow area	Af =	150.00	sq ft
Full-flow wetted perimeter	Pf =	50.00	ft
Full-flow capacity	Qf =	3576.14	cfs

Calculations of Normal Flow Condition

Normal flow depth (<H)	Yn =	3.03	ft
Flow area	An =	45.42	sq ft
Wetted perimeter	Pn =	21.06	ft
Flow velocity	Vn =	19.13	fps
Discharge	Qn =	869.02	cfs
Percent Full	Flow =	24.3%	of full flow
Normal Depth Froude Number	Fr _n =	1.94	supercritical

Calculation of Critical Flow Condition


Critical flow depth	Yc =	4.71	ft
Critical flow area	Ac =	70.59	sq ft
Critical flow velocity	Vc =	12.31	fps
Critical Depth Froude Number	Fr _c =	1.00	

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: **Timberidge Estates**

Basin ID: **Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-10'x15' Conc Box Culverts**

Status:

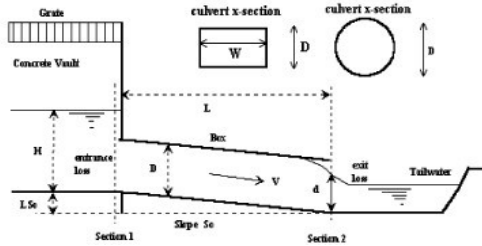

Design Information (Input):

Circular Culvert: Barrel Diameter in Inches

Inlet Edge Type (choose from pull-down list)

D = inches

Grooved End Projection

OR:

Box Culvert: Barrel Height (Rise) in Feet

Barrel Width (Span) in Feet

Inlet Edge Type (choose from pull-down list)

Height (Rise) = ft.

Width (Span) = ft.

Square Edge w/ 90-15 Deg. Headwall

Number of Barrels

Inlet Elevation at Culvert Invert

Outlet Elevation at Culvert Invert **OR** Slope of Culvert (ft v./ft h.)

Culvert Length in Feet

Manning's Roughness

Bend Loss Coefficient

Exit Loss Coefficient

No =

Inlet Elev = ft. elev.

Outlet Elev = ft. elev.

L = ft.

n =

K_b =

K_x =

Design Information (calculated):

Entrance Loss Coefficient

Friction Loss Coefficient

Sum of All Loss Coefficients

Orifice Inlet Condition Coefficient

Minimum Energy Condition Coefficient

K_e =

K_f =

K_s =

C_d =

KE_{low} =

Calculations of Culvert Capacity (output):


Water Surface Elevation (ft., linked)	Tailwater Surface Elevation ft	Culvert Inlet-Control Flowrate cfs	Culvert Outlet-Control Flowrate cfs	Controlling Culvert Flowrate cfs (output)	Inlet Equation Used:	Flow Control Used
7233.00		0.00	0.00	0.00	No Flow (WS < inlet)	N/A
7233.50		40.80	890.69	40.80	Min. Energy. Eqn.	INLET
7234.00		115.20	1,121.96	115.20	Min. Energy. Eqn.	INLET
7234.50		211.80	1,352.59	211.80	Min. Energy. Eqn.	INLET
7235.00		325.80	1,580.07	325.80	Min. Energy. Eqn.	INLET
7235.50		455.40	1,802.89	455.40	Min. Energy. Eqn.	INLET
7236.00		598.50	2,020.36	598.50	Min. Energy. Eqn.	INLET
7236.50		754.20	2,232.16	754.20	Min. Energy. Eqn.	INLET
7237.00		921.60	2,438.23	921.60	Min. Energy. Eqn.	INLET
7237.50		1,099.50	2,638.64	1,099.50	Min. Energy. Eqn.	INLET
7238.00		1,287.90	2,833.64	1,287.90	Min. Energy. Eqn.	INLET
7238.50		1,491.90	3,023.40	1,491.90	Regression Eqn.	INLET
7239.00		1,705.80	3,208.18	1,705.80	Regression Eqn.	INLET
7239.50		1,928.70	3,388.31	1,928.70	Regression Eqn.	INLET
7240.00		2,160.60	3,563.94	2,160.60	Regression Eqn.	INLET
7240.50		2,400.90	3,735.35	2,400.90	Regression Eqn.	INLET
7241.00		2,648.10	3,902.80	2,648.10	Regression Eqn.	INLET
7241.50		2,901.30	4,066.50	2,901.30	Regression Eqn.	INLET
7242.00		3,158.40	4,226.62	3,158.40	Regression Eqn.	INLET
7242.50		3,417.90	4,383.37	3,417.90	Regression Eqn.	INLET
7243.00		3,678.00	4,536.96	3,678.00	Regression Eqn.	INLET
7243.50		3,936.90	4,685.16	3,936.90	Regression Eqn.	INLET
7244.00		4,192.80	5,122.40	4,192.80	Regression Eqn.	INLET
7244.50		4,444.50	5,399.73	4,444.50	Regression Eqn.	INLET
7245.00		4,691.40	5,667.97	4,691.40	Regression Eqn.	INLET
7245.50		4,932.30	5,927.97	4,932.30	Regression Eqn.	INLET
7246.00		5,167.20	6,180.37	5,167.20	Regression Eqn.	INLET
7246.50		5,395.50	6,425.72	5,395.50	Regression Eqn.	INLET
7247.00		5,617.50	6,664.53	5,617.50	Regression Eqn.	INLET
7247.50		5,833.20	6,897.36	5,833.20	Regression Eqn.	INLET

Processing Time: 00.55 Seconds

CULVERT STAGE-DISCHARGE SIZING (INLET vs. OUTLET CONTROL WITH TAILWATER EFFECTS)

Project: Timberridge Estates


Basin ID: Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-10'x15' Conc Box Culverts

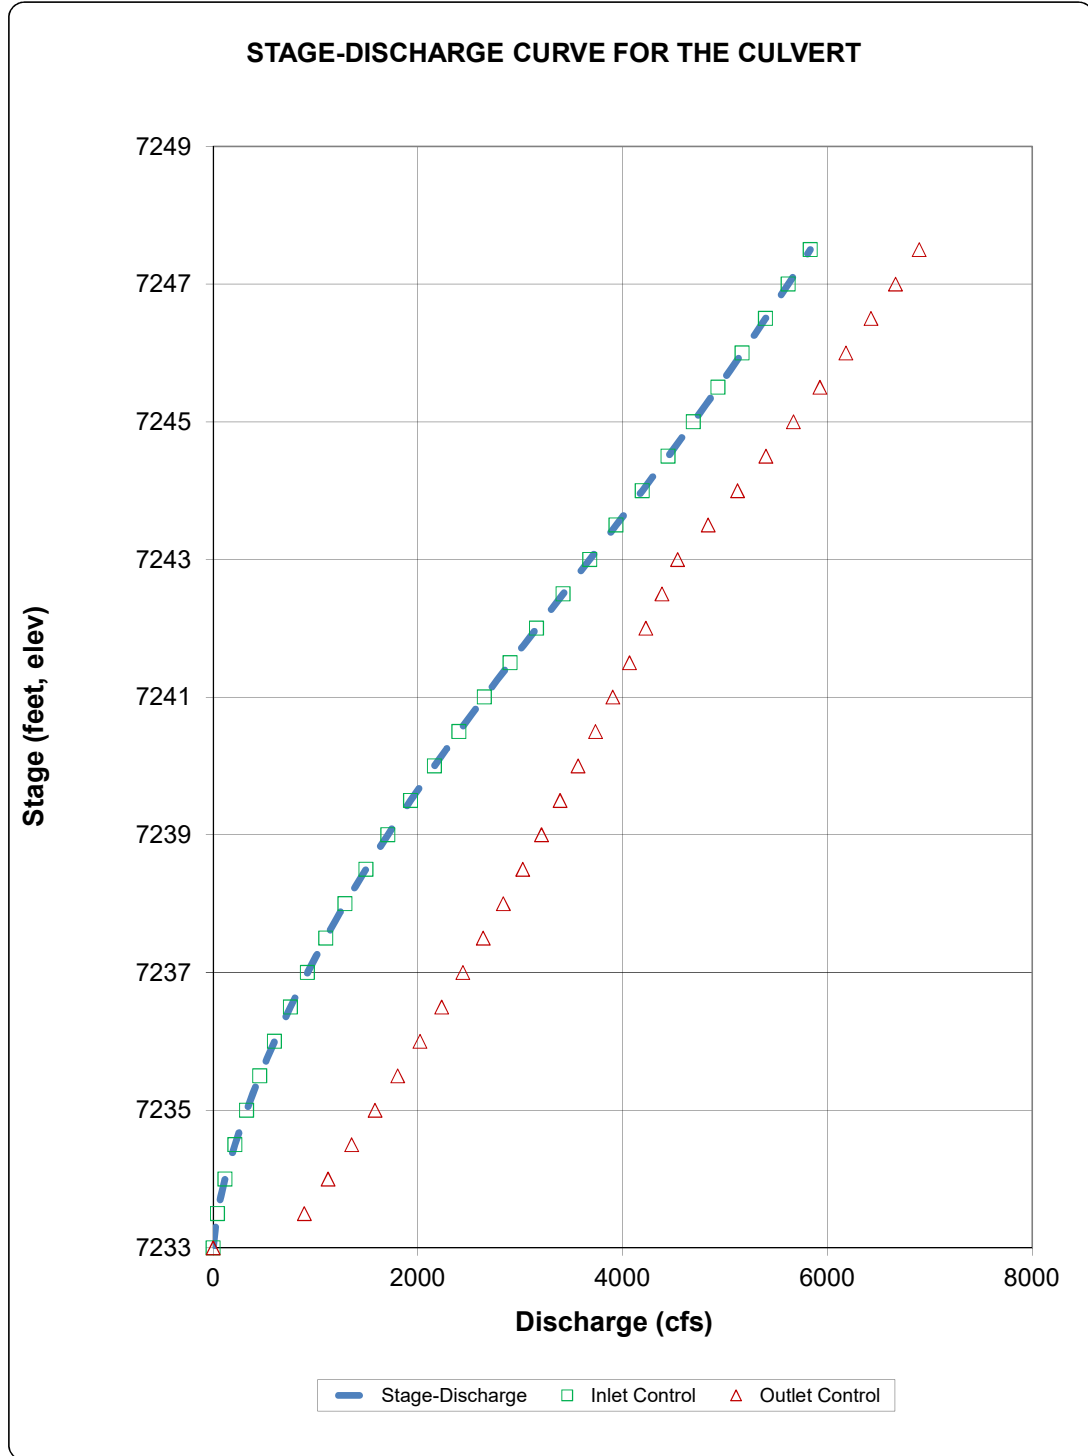

Determination of Culvert Headwater and Outlet Protection

Project: **Timberridge Estates**

Basin ID: **Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-10'x15' Conc Box Culverts**

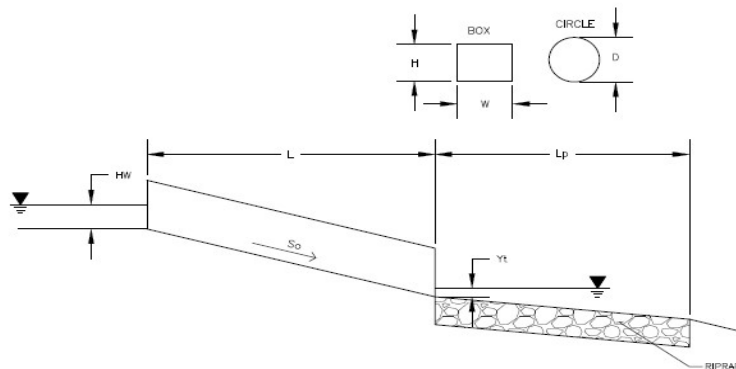

Soil Type:

Choose One:

☒ Sandy

☐ Non-Sandy

Supercritical Flow! Using H_a to calculate protection type.

Design Information (Input):

Design Discharge

Q = 2607 cfs

Circular Culvert:

Barrel Diameter in Inches

D = inches

Inlet Edge Type (Choose from pull-down list)

Box Culvert:

Barrel Height (Rise) in Feet

Height (Rise) = 10 ft

Barrel Width (Span) in Feet

Width (Span) = 15 ft

Inlet Edge Type (Choose from pull-down list)

Square Edge w/ 90-15 Deg. Headwall

Number of Barrels

No = 3

Inlet Elevation

Elev IN = 7233 ft

Outlet Elevation **OR** Slope

Elev OUT = 7232 ft

Culvert Length

L = 100 ft

Manning's Roughness

n = 0.013

Bend Loss Coefficient

k_b = 0

Exit Loss Coefficient

k_x = 1

Tailwater Surface Elevation

Elev Y_t = ft

Max Allowable Channel Velocity

V = 5 ft/s

Required Protection (Output):

Tailwater Surface Height

Y_t = 4.00 ft

Flow Area at Max Channel Velocity

A_t = 173.80 ft²

Culvert Cross Sectional Area Available

A = 150.00 ft²

Entrance Loss Coefficient

k_e = 0.50

Friction Loss Coefficient

k_f = 0.14

Sum of All Losses Coefficients

k_s = 1.64

Culvert Normal Depth

Y_n = 3.03 ft

Culvert Critical Depth

Y_c = 4.71 ft

Tailwater Depth for Design

d = 7.35 ft

Adjusted Diameter **OR** Adjusted Rise

H_a = 6.51 ft

Expansion Factor

$1/(2*\tan(\Theta))$ = 6.65

Flow/Diameter^{2.5} **OR** Flow/(Span * Rise^{1.5})

$Q/WH^{1.5}$ = 1.83 ft^{0.5}/s

Froude Number

Fr = 1.94

Tailwater/Adjusted Diameter **OR** Tailwater/Adjusted Rise

Y_t/H = 0.61

Supercritical!

Inlet Control Headwater

HW_i = 7.92 ft

Outlet Control Headwater

HW_o = 7.21 ft

Design Headwater Elevation

HW = 7,240.92 ft

Headwater/Diameter **OR** Headwater/Rise Ratio

HW/H = 0.79

Minimum Theoretical Riprap Size

d_{50} = 6 in

Nominal Riprap Size

d_{50} = 9 in

UDFCD Riprap Type

Type = L

Length of Protection

L_p = 100 ft


Width of Protection

T = 31 ft

Vertical Profile for the Culvert

Project = Timberridge Estates

Box ID = Arroya Lane Crossing Sand Creek (2,607 cfs) - 3-10'x15' Conc Box Culverts

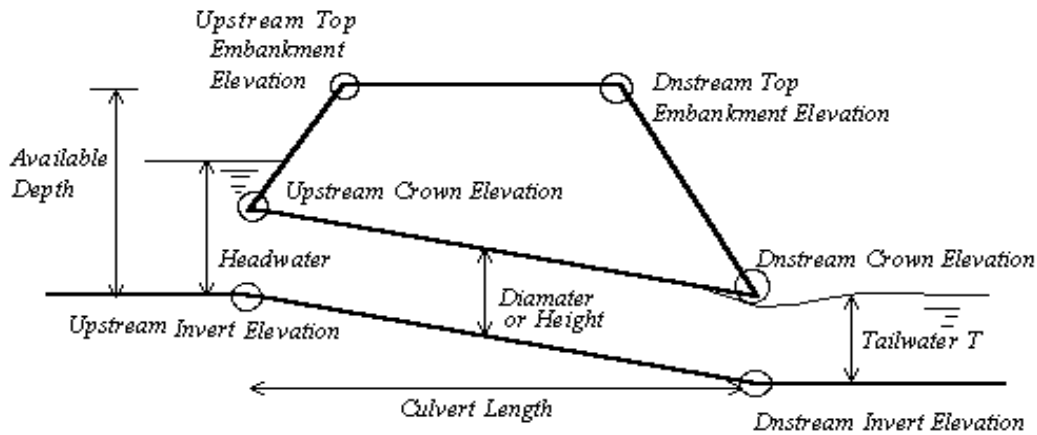

Culvert Information (Input)

Barrel Diameter or Height	D or H =	120.00	inches
Barrel Length	L =	100.00	ft
Barrel Invert Slope	So =	0.0100	ft/ft
Downstream Invert Elevation	EDI =	7232.00	ft
Downstream Top Embankment Elevation	EDT =	7244.00	ft
Upstream Top Embankment Elevation	EUT =	7244.00	ft
Design Headwater Depth (not elev.)	Hw =	7.92	ft
Tailwater Depth (not elev.)	Yt =	7.35	ft

Culvert Hydraulics (Calculated)

Available Headwater Depth	HW-a =	11.00	ft
Design Hw/D ratio	Hw/D =	0.79	




Culvert Vertical Profile

Upstream Invert Elevation	EUI =	7233.00	ft
Upstream Crown Elevation	EUC =	7243.00	ft
Upstream Soil Cover Depth	Upsoil =	1.00	ft
Downstream Invert Elevation	EDI =	7232.00	ft
Downstream Crown Elevation	EDC =	7242.00	ft
Downstream Soil Cover Depth	Dnsoil =	2.00	ft

Job No. 1733.00 Timberidge Estates

Date 03/13/19

By Dave

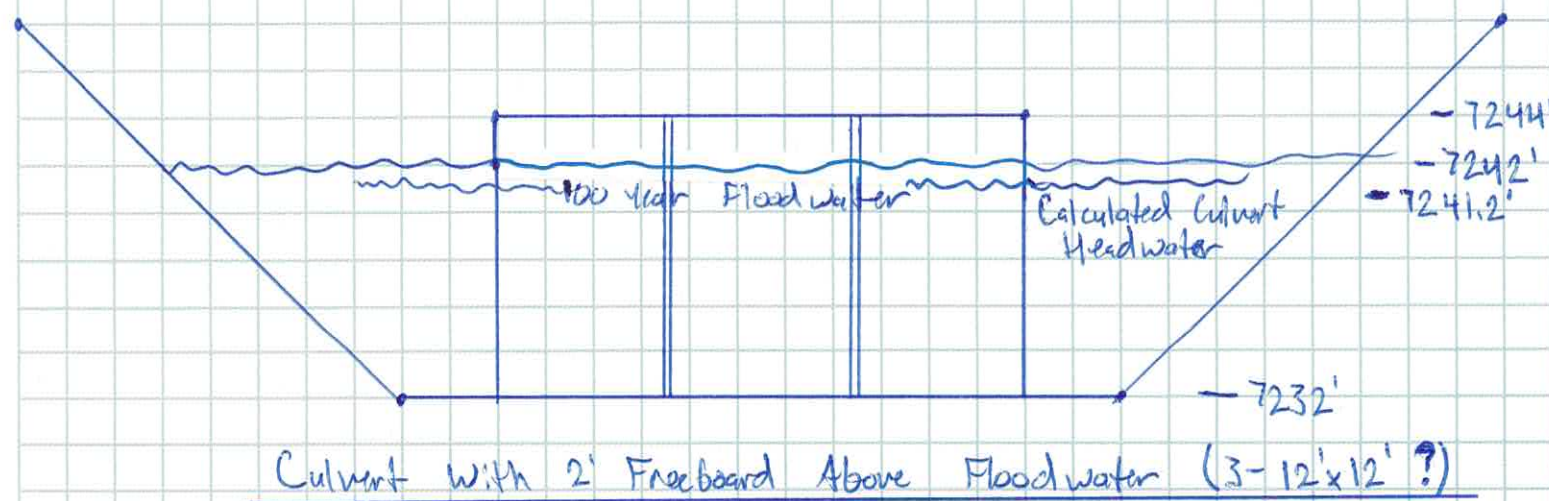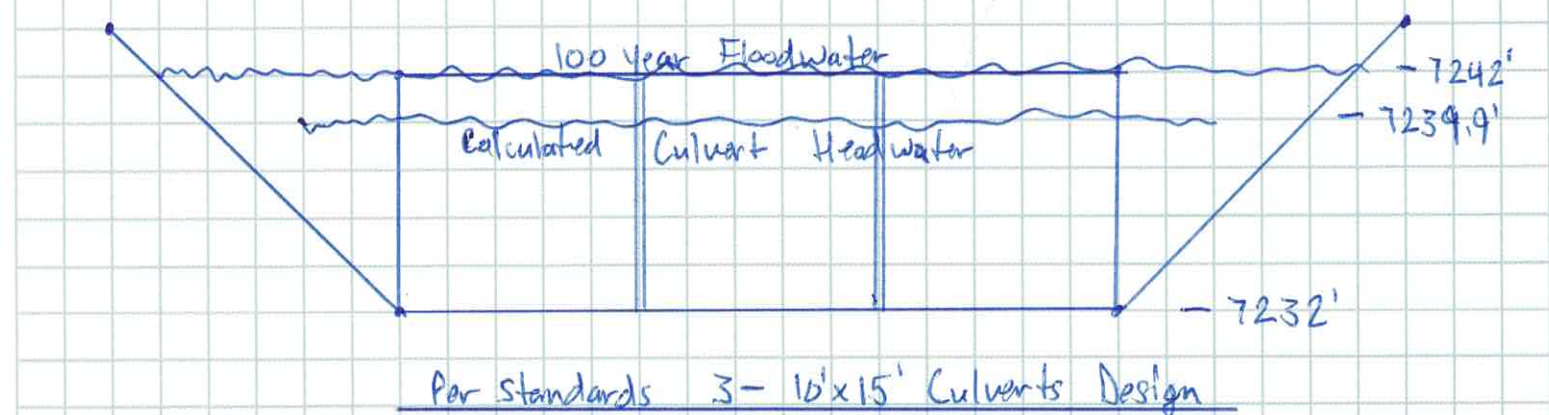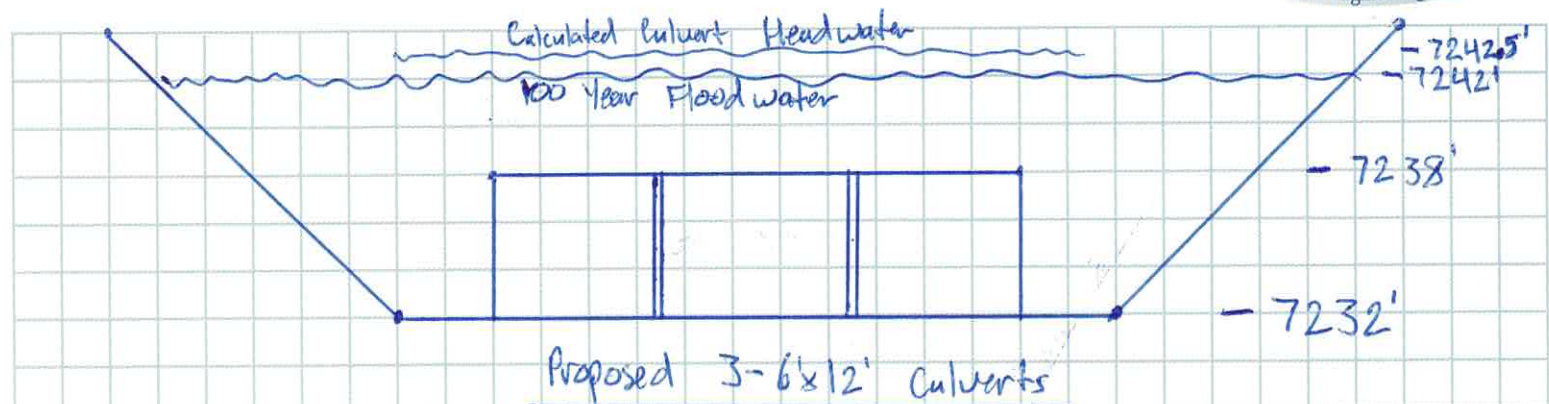

N:\jobs\1733.00\Drawings\CD\173300 GEC.dwg, GRAD #2, 2/28/2019 11:43:29 AM

BENCHMARKS

A #4 REBAR 28.3 FEET SOUTH AND 77.2 FEET WEST OF THE SOUTHEAST
PROPERTY CORNER.
ELEV = 7,319.85' (NGVD-1929)

NOTES

1. REINFORCE PROPOSED SWALES PR4, PR7, PR8, PR9, PR10, & PR11 WITH TURF REINFORCEMENT MATS (NORTH AMERICAN GREEN VMAX SC250, VMAX C350, OR SIMILAR). TURF REINFORCEMENT MATS ARE NOT REQUIRED FOR SWALE AREAS WITH RIPRAP.
2. SAND FILTER ACCESS WILL BE FROM THE FUTURE ROADS ADJACENT TO EACH SAND FILTER.
3. PROPOSED DRAINAGE EASEMENTS ARE BASED ON EXISTING CONDITIONS, 100-YEAR STORM EVENTS, 1' FREEBOARD, AND ARE PRELIMINARY.
4. DRAINAGE CHANNEL GRADING AND EASEMENT FOR LOTS R-1, R-2, R-3, AND R-4 HAVE NOT BEEN INCLUDED. THESE ITEMS WILL BE ADDRESSED ON A LOT BY LOT BASIS AS PART OF THE CONSTRUCTION PLANS FOR THE INDIVIDUAL LOTS.
5. REINFORCE PROPOSED SWALES PR4, PR7, PR8, PR9, PR10, & PR11 WITH TURF REINFORCEMENT MATS (NORTH AMERICAN GREEN VMAX SC250, VMAX C350, OR SIMILAR). TURF REINFORCEMENT MATS ARE NOT REQUIRED FOR SWALE AREAS WITH RIPRAP.

TIMBERRIDGE ESTATES - 9210 ARROYA LANE



EL PASO COUNTY

GRADING & EROSION CONTROL PLAN

FEBRUARY 2019

LEGEND

- EXISTING 2' CONTOUR
- 7260 EXISTING 10' CONTOUR
- PROPOSED 2' CONTOUR
- 260 PROPOSED 10' CONTOUR
- SURFACE FLOW CHANNEL
- PROPOSED DRAINAGE EASEMENT
- W EXISTING WATER LINE
- CONSTRUCTION SITE BOUNDARY
- AREA OF SOIL DISTURBANCE
- EXISTING TREE
- EX# / PR# OPEN CHANNEL FLOW CALC POINT
- AREA OF TREES/BRUSH LIMIT

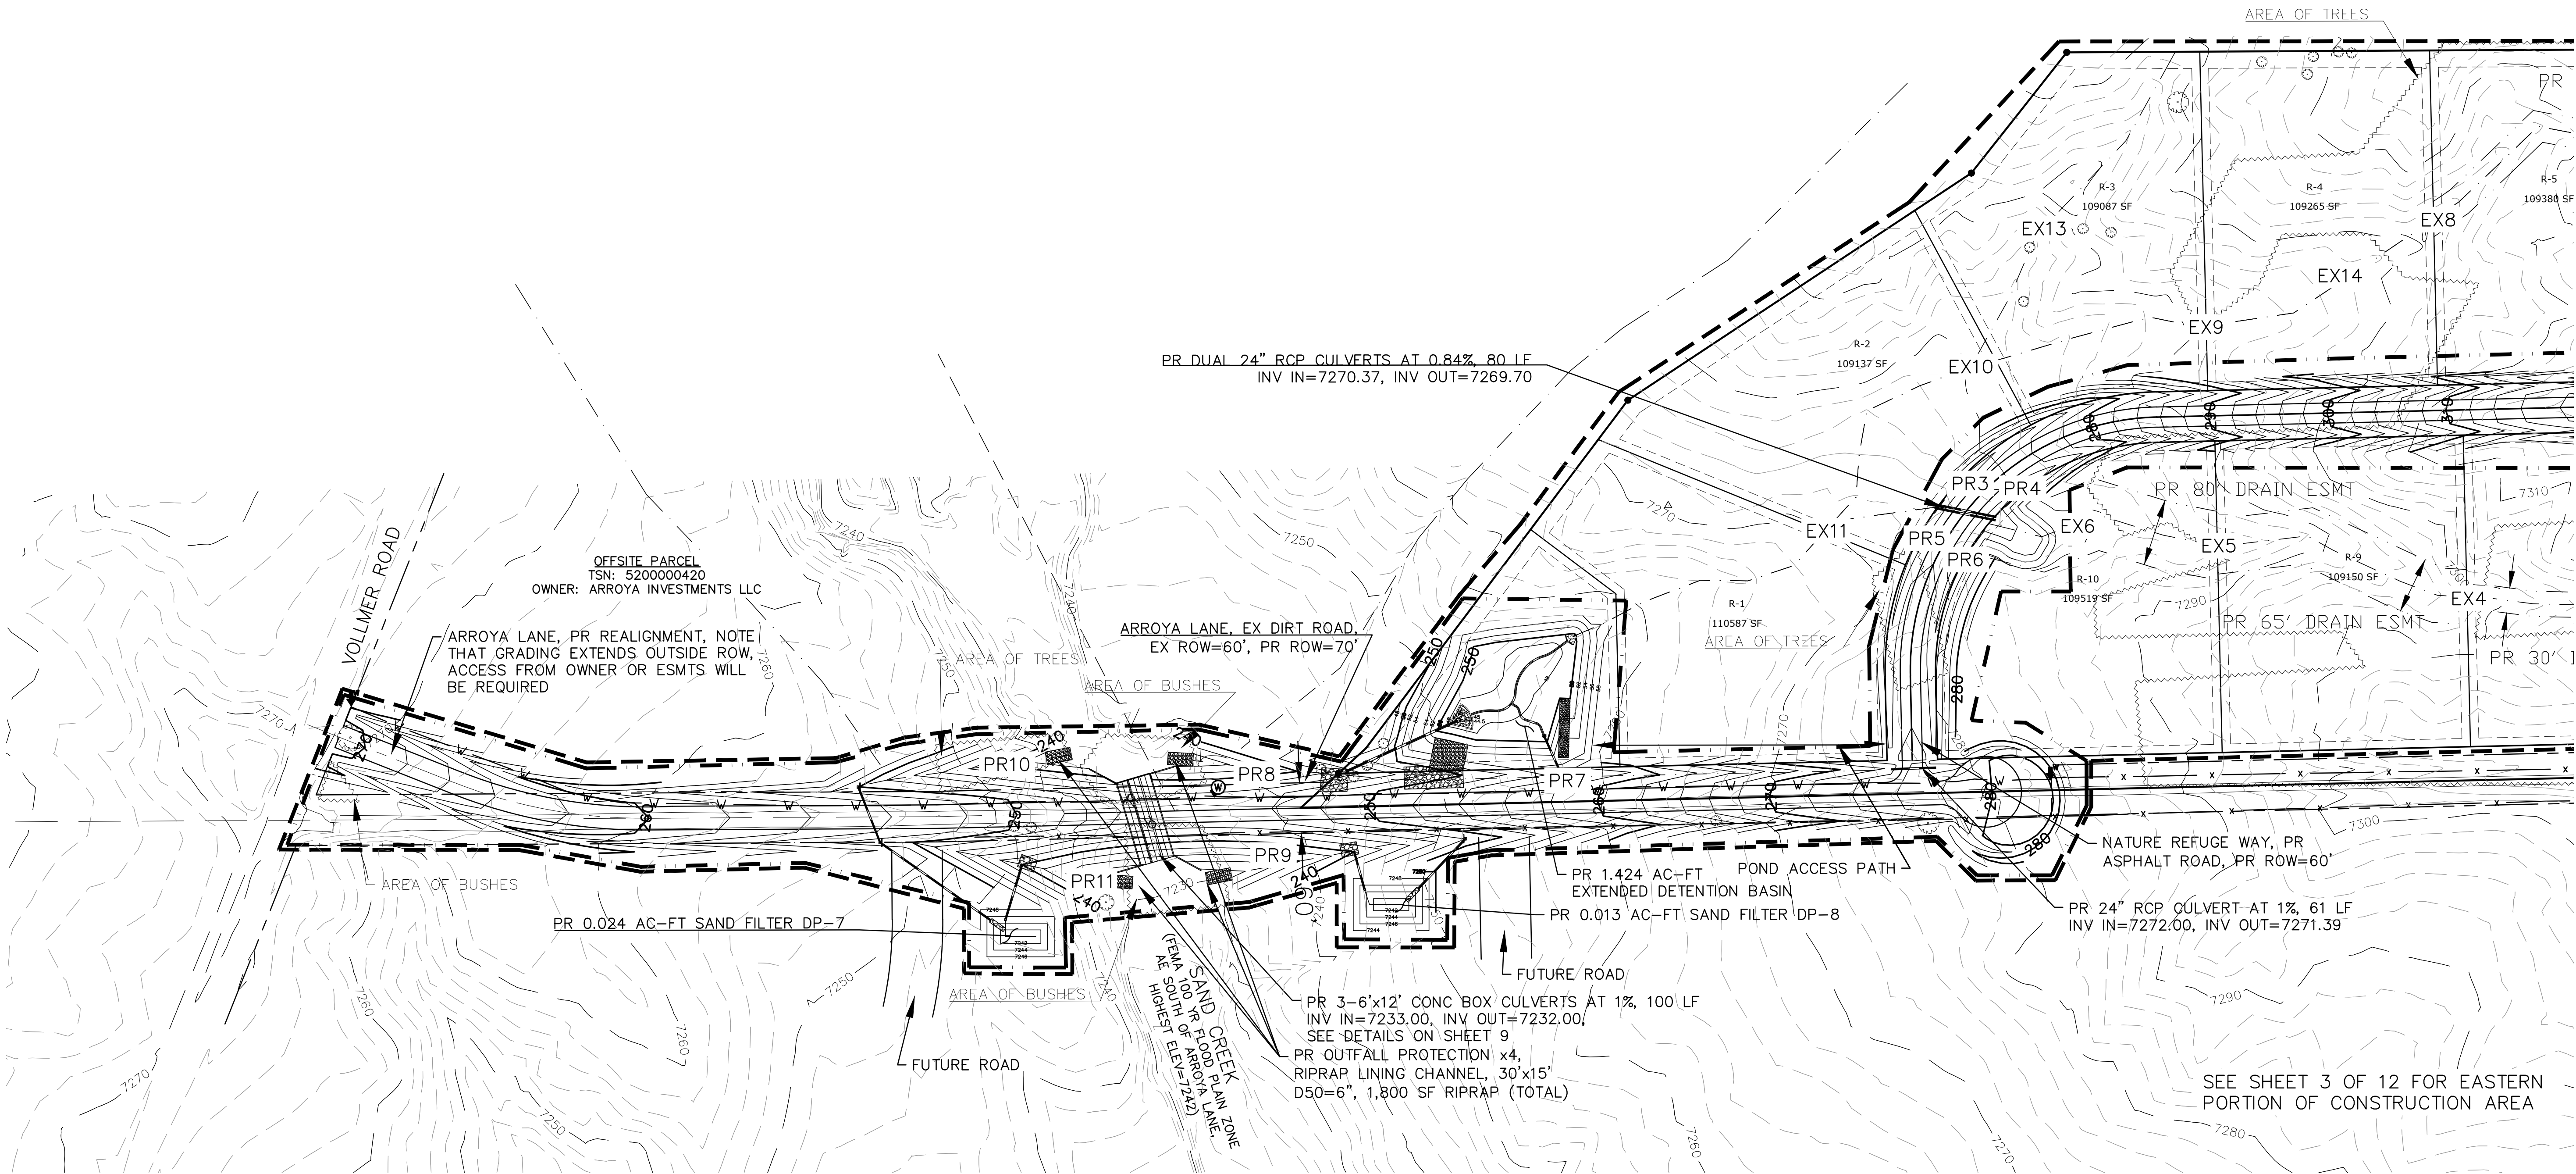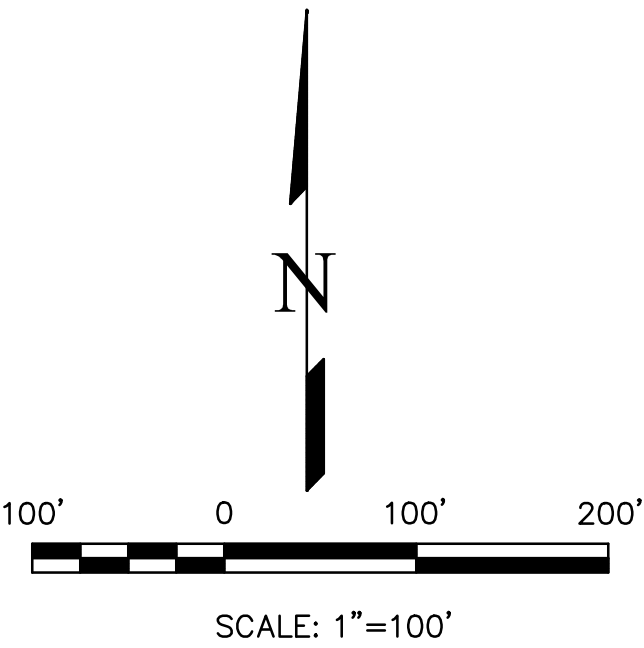

REVISIONS	
NO.	DESCRIPTION

UNTIL SUCH TIME AS THESE
DRAWINGS ARE APPROVED
BY THE EL PASO COUNTY
ENGINEERING DEPARTMENT
TERRA NOVA ENGINEERING,
INC. APPROVES THEIR USE
ONLY FOR THE PROJECT
AND FOR THE DESIGNATED BY
WRITTEN AUTHORIZATION.


PREPARED FOR:
TIMBERRIDGE ESTATES, LLC
ATTN: SCOTT HENTIE
2760 BROGANS BLUFF
COLORADO SPRINGS, CO 80919
719.499.6752

Terra Nova
Engineering, Inc.
Creative Civil Engineering
721 S. 2900 STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-635-6422
FAX: 719-635-6426
www.tnnae.com

TIMBERRIDGE ESTATES
9210 ARROYA LANE
GRADING & EROSION CONTROL PLAN
GRADING PLAN - WEST


DESIGNED BY LD
DRAWN BY DLF
CHECKED BY LD
H-SCALE 1"=100'
V-SCALE NA
JOB NO. 1733.00
DATE ISSUED 02/28/19
SHEET NO. 4 OF 12

TIMBERRIDGE ESTATES - 9210 ARROYA LANE
EL PASO COUNTY
GRADING & EROSION CONTROL PLAN
FEBRUARY 2019

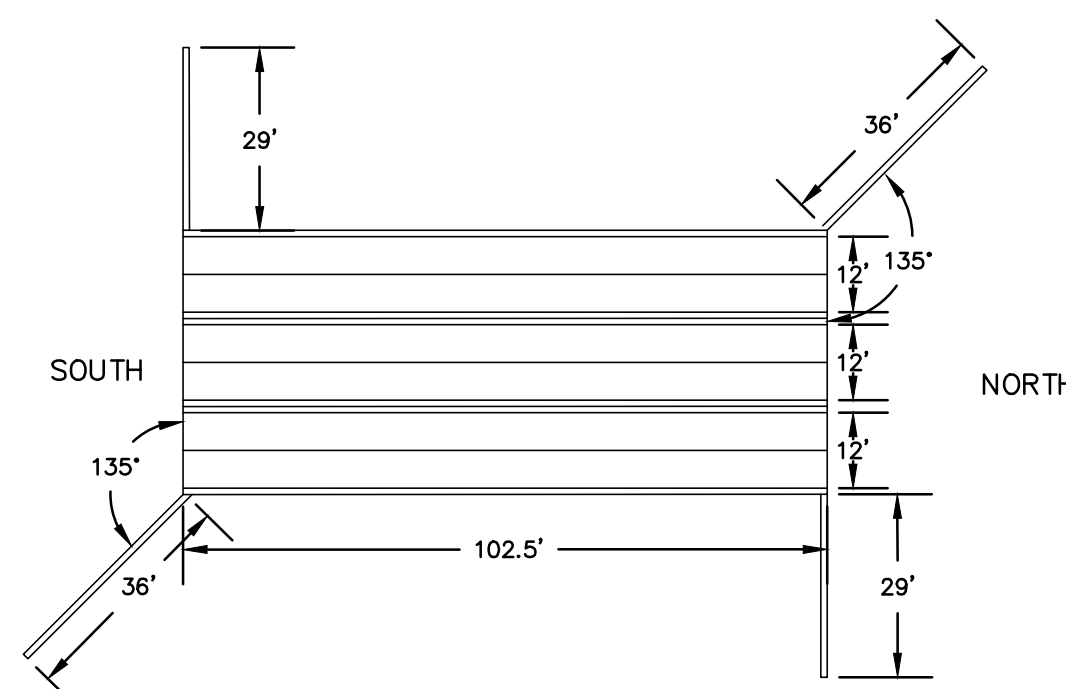

3-6'x12' CONCRETE BOX CULVERTS - PLAN VIEW

NOT TO SCALE

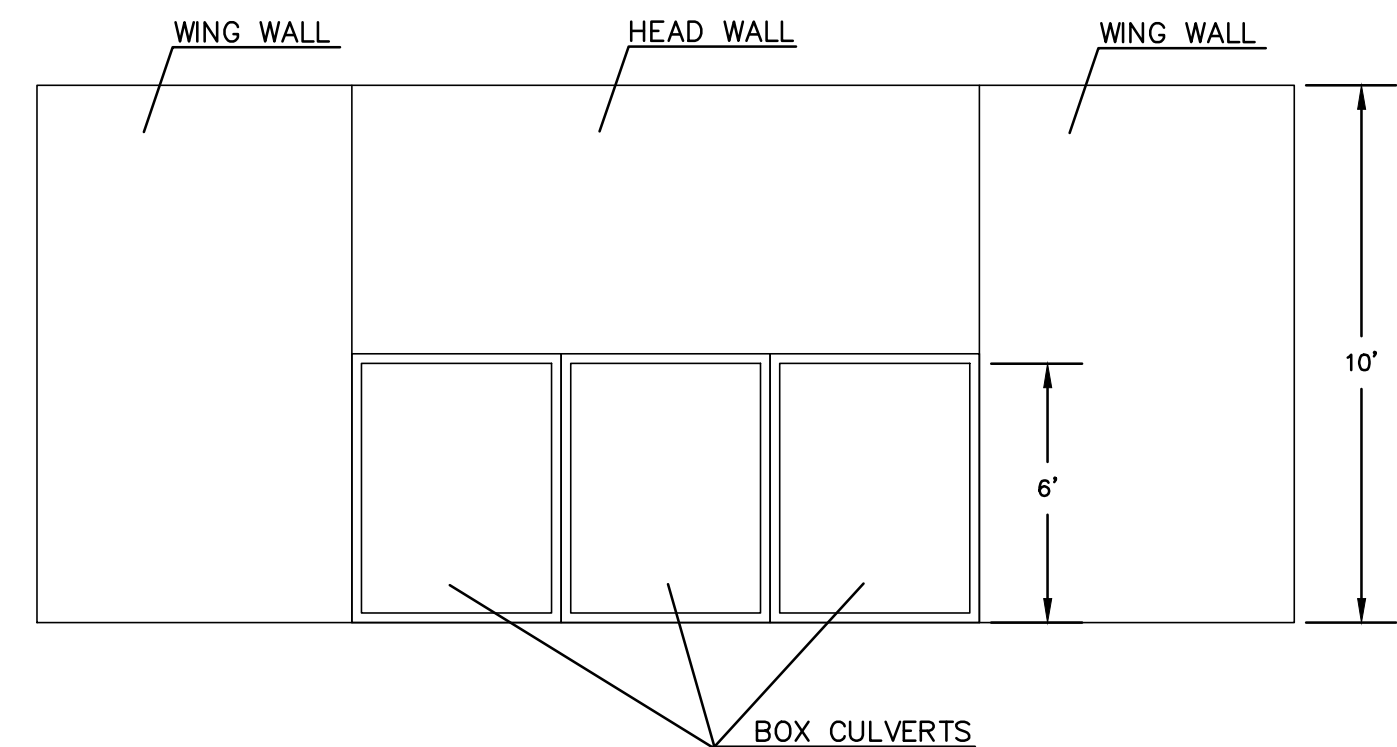

3-6'x12' CONCRETE BOX CULVERTS - PROFILE VIEW

NOT TO SCALE

TRIPLE CONCRETE BOX CULVERT DIMENSIONS, QUANTITIES & RATING FACTORS (EXCLUDING HEADWALL & TOEWALL QUANTITIES)

BOX SIZE				HEIGHT				DIMENSIONS												W/R SIZES				QUANTITIES				RATING FACTORS										
S	R	T	W	FT-1	FT-2	FT-3	FT-4	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	
FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	FT	IN	
6	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	
7.5	9	11	13	15	17	19	21	23	25	27	29	31	33	35	37	39	41	43	45	47	49	51	53	55	57	59	61	63	65	67	69	71	73	75	77	79	81	
9	11	13	15	17	19	21	23	25	27	29	31	33	35	37	39	41	43	45	47	49	51	53	55	57	59	61	63	65	67	69	71	73	75	77	79	81		
10.5	12.5	14.5	16.5	18.5	20.5	22.5	24.5	26.5	28.5	30.5	32.5	34.5	36.5	38.5	40.5	42.5	44.5	46.5	48.5	50.5	52.5	54.5	56.5	58.5	60.5	62.5	64.5	66.5	68.5	70.5	72.5	74.5	76.5	78.5	80.5	82.5	84.5	
12	14	16	18	20	22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88
13.5	15.5	17.5	19.5	21.5	23.5	25.5	27.5	29.5	31.5	33.5	35.5	37.5	39.5	41.5	43.5	45.5	47.5	49.5	51.5	53.5	55.5	57.5	59.5	61.5	63.5	65.5	67.5	69.5	71.5	73.5	75.5	77.5	79.5	81.5	83.5	85.5	87.5	
15	17	19	21	23	25	27	29	31	33	35	37	39	41	43	45	47	49	51	53	55	57	59	61	63	65	67	69	71	73	75	77	79	81	83	85	87	89	91
16.5	18.5	20.5	22.5	24.5	26.5	28.5	30.5	32.5	34.5	36.5	38.5	40.5	42.5	44.5	46.5	48.5	50.5	52.5	54.5	56.5	58.5	60.5	62.5	64.5	66.5	68.5	70.5	72.5	74.5	76.5	78.5	80.5	82.5	84.5	86.5	88.5	90.5	92.5
18	20	22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94
20	22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96
22	24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98
24	26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100
26	28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102
28	30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104
30	32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106
32	34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108
34	36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110
36	38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112
38	40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114
40	42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116
42	44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118
44	46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120
46	48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122
48	50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124
50	52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126
52	54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128
54	56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130
56	58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132
58	60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134
60	62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136
62	64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138
64	66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140
66	68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142
68	70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144
70	72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144	146
72	74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144	146	148
74	76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144	146	148	150
76	78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144	146	148	150	152
78	80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144	146	148	150	152	154
80	82	84	86	88	90	92	94	96	98	100	102	104	106	108	110	112	114	116	118	120	122	124	126	128	130	132	134	136	138	140	142	144	146	148	150	152	154	156
82	84	86	88																																			


HEADWALL AND TOEWALL QUANTITIES

HEADWALL BENT ANGLE	90° TO 75°				74° TO 60°				59° TO 45°			
	CLEAR SPAN (S)		REBAR QUANT.		CLEAR SPAN (S)		REBAR QUANT.		CLEAR SPAN (S)		REBAR QUANT.	
	#	Z	STIRRUPS	LBS/LF	#	Z	STIRRUPS	LBS/LF	#	Z	STIRRUPS	LBS/LF
8	4	4	19.2	5	4	4	23.5	7	4	4	34.4	
10	5	4	23.7	6	4	4	28.7	9	4	4	54.0	
12	6	4	28.9	7	4	4	28.2	10	5	4	59.2	
14	6	4	27.9	7	4	4	33.5	*	*	*	*	
16	6	4	27.5	8	5	4	41.1	*	*	*	*	
18	7	4	33.0	9	5	5	58.8	*	*	*	*	
20	7	4	32.8	*	*	*	*	*	*	*	*	

CONCRETE DENSITY = 0.086 CY/LB

NOTES

1. SIX INCH SPACING AT EACH END OF THE SPAN FOR A DISTANCE OF 1/4 OF THE SPAN LENGTH; 12 INCH SPACING ELSEWHERE.
2. QUANTITIES ARE GIVEN FOR ONE HEADWALL AND ONE TOWEALL AND ARE BASED ON PER LINEAR FOOT OF HEADWALL. STATE QUANTITIES INCLUDE ALL REINFORCING. QUANTITIES SHALL BE PAID FOR AS SHOWN ON THE PLANS.
- ★ 3. SKEWED HEADWALLS ARE NOT RECOMMENDED FOR THESE SPANS. A SPECIAL DESIGN IS REQUIRED.
4. FOR HEADWALL AND TOWEALL DETAILS SEE M-601-3, SHEET 1 OF 2.
5. WHEN THE FILL HEIGHTS ARE LESS THAN OR EQUAL TO 2 FT, ALL REINFORCING BARS IN THE HEADWALL, ALL REINFORCING BARS DESIGNATED BY AN ASTERISK (*), AND ALL OTHER BARS IN THE TOP MAT OF THE TOP SLAB SHALL BE EPOXY COATED.
6. REINFORCING QUANTITIES INCLUDE BOTH EPOXY-COATED AND UNCOATED BARS.
7. WHEN A (RISE) R OF LESS THAN 6 FT IS REQUIRED, USE THE BAR SIZES AND THE SLAB AND MAT THICKNESSES FOR THE 6 FT RISE (IF AVAILABLE ON THE TABLE).
- ▲ 8. FOR SIZE AND SPACING OF THE BOTTOM MAT BARS IN THE TOP SLAB SEE TABLE ON SHEET 1 OF 2. ALL OTHER BARS ARE #4s AT 1'-0" SPACING. THE NUMBER OF BARS REQUIRED IS LISTED ON THIS SHEET AND INCLUDES BOTH #4 BARS AND THOSE FROM THE TABLE.
- ◆ 9. LIVE LOAD IS NEGLECTED AS PER AASHTO LRFD SECTION 3.6.1.2.6. FOR THESE STRUCTURES REFER TO THE CDD RATING MANUAL.
10. FOR ALL NEW CULVERT DESIGN, A RATING IS REQUIRED. THE RATING SUMMARY SHEET SHOULD BE PRINTED FROM THE CDDT EXTERNAL WEBSITE AND SUBMITTED TO THE RATING UNIT IN THE OTHER BIDDING PART OF A LARGER DESIGN PACKAGE. FOR ADDITIONAL INFORMATION, SEE THE CDD RATING MANUAL.

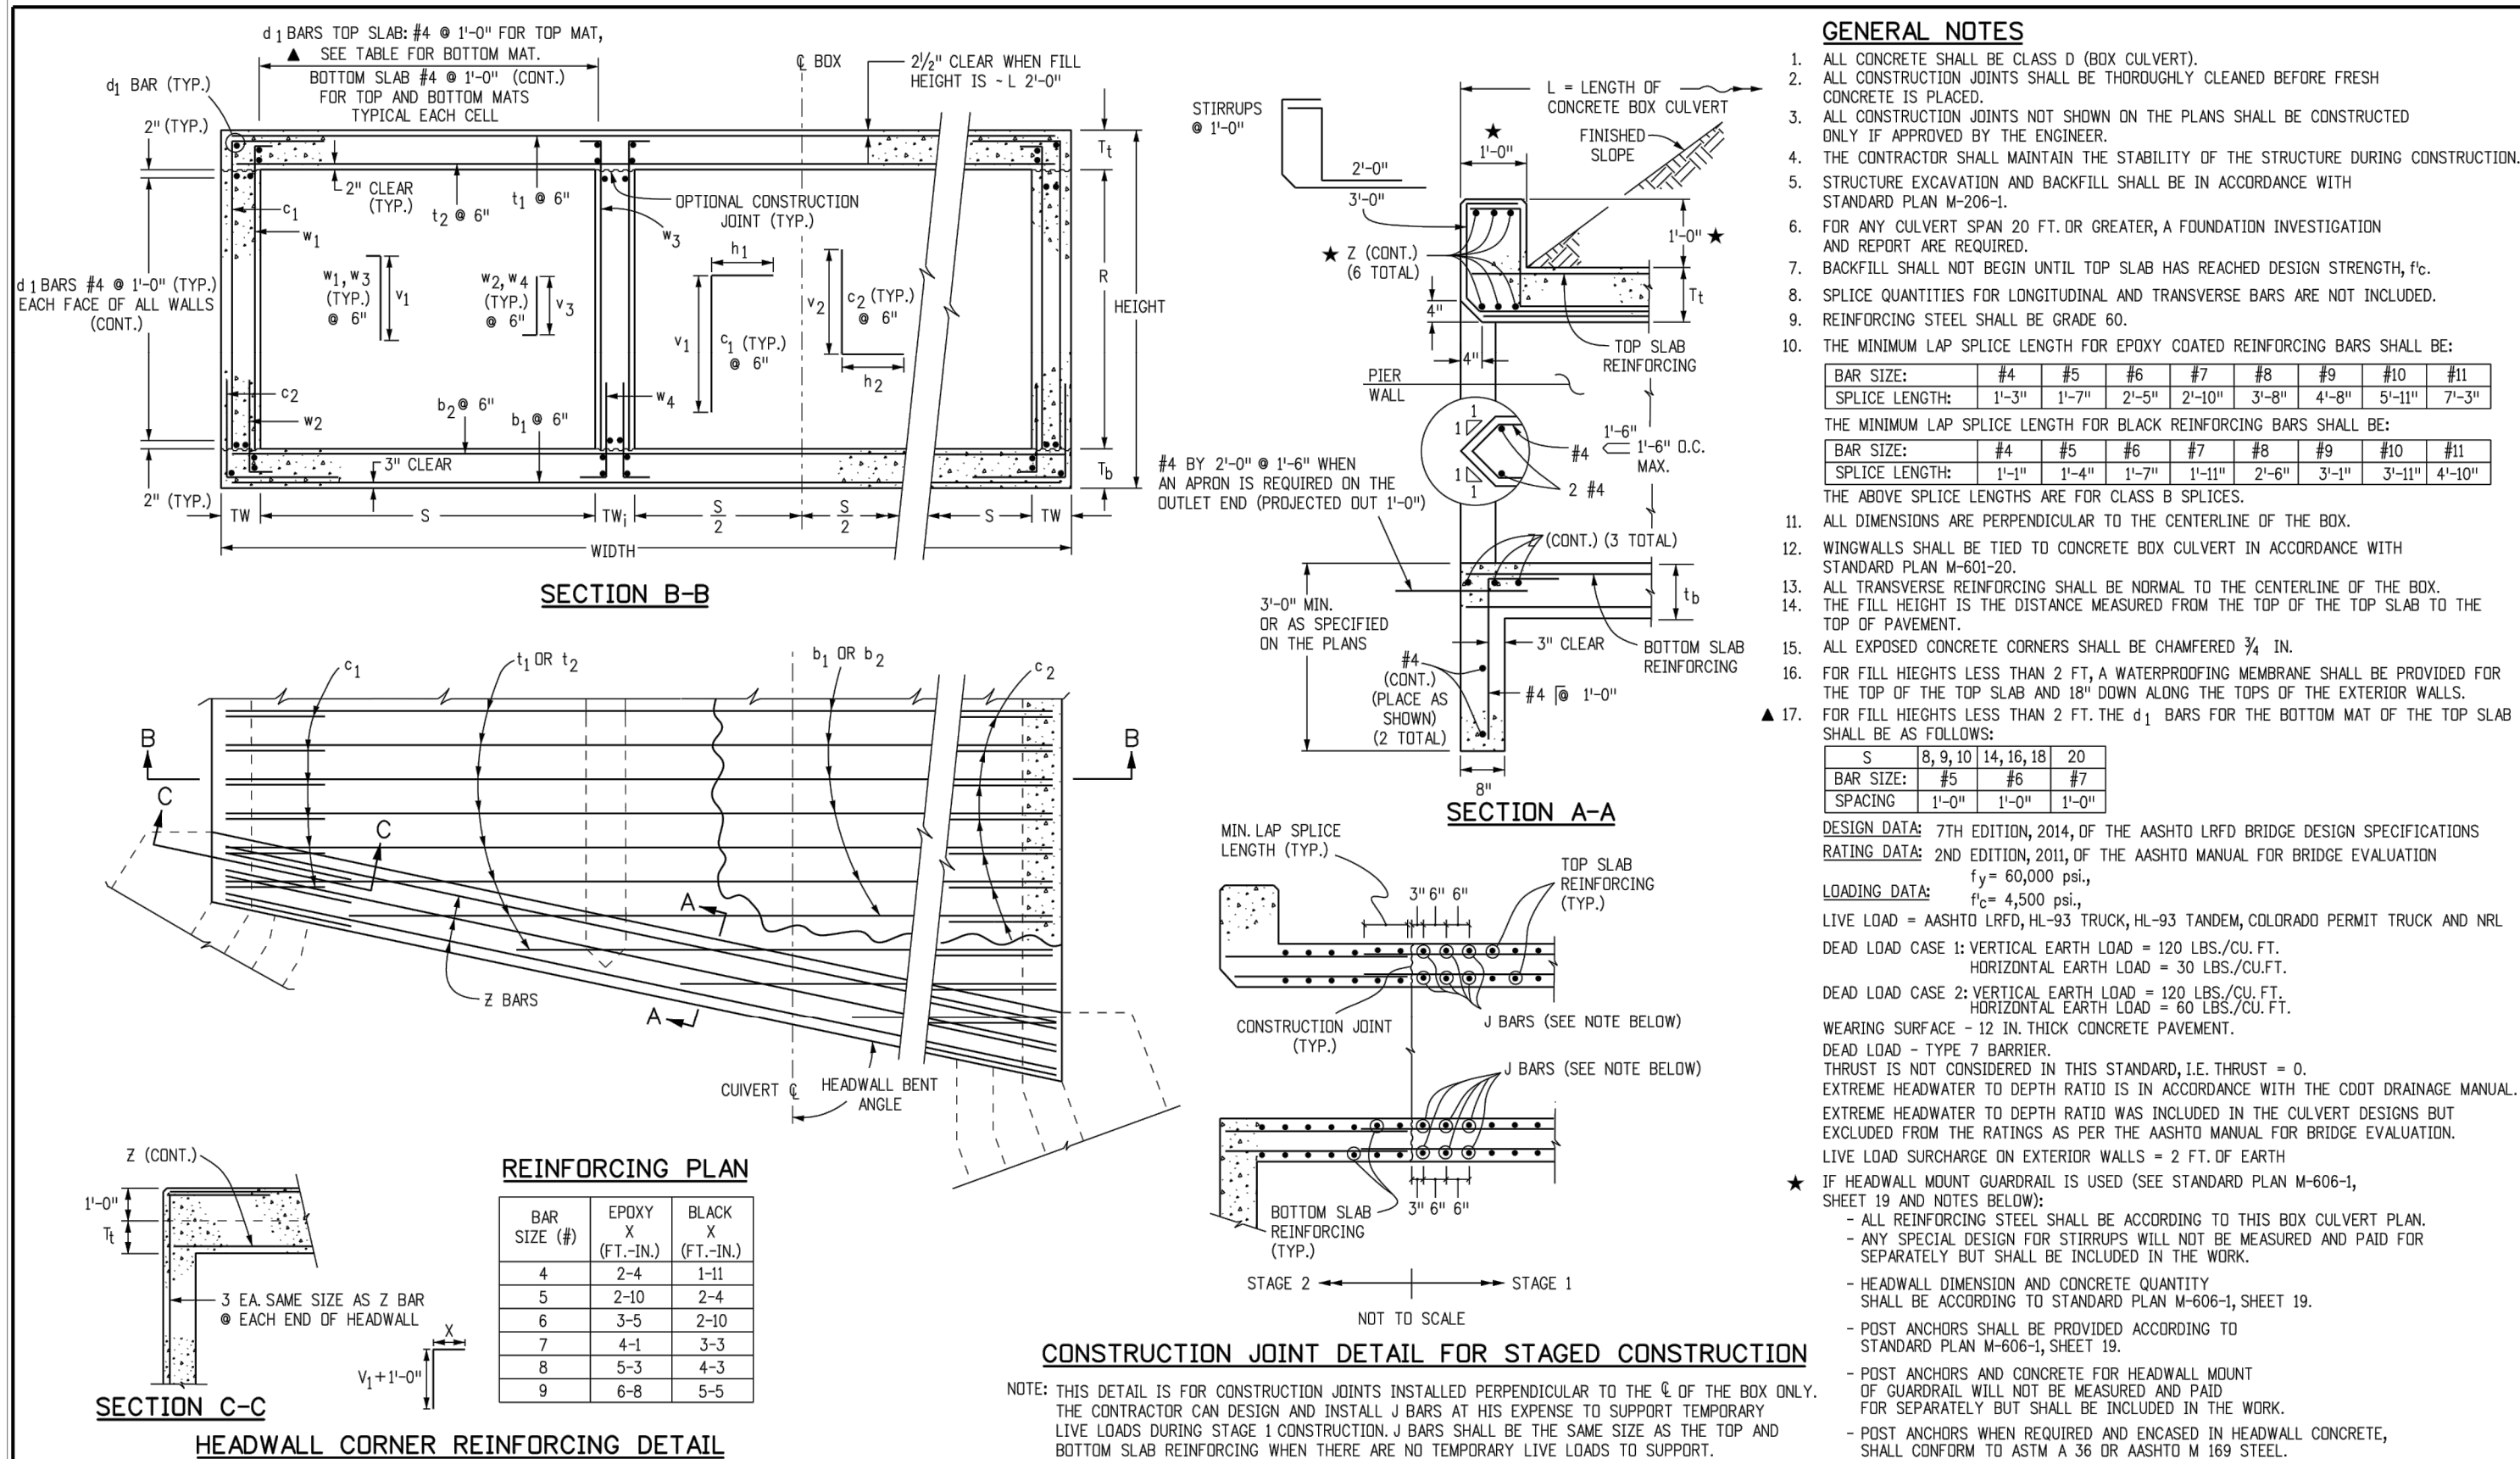

Computer File Information		
Creation Date:	07/04/12	Initials: JBE
Last Modification Date:	11/25/15	Initials: JBE
Full Path: www.codot.gov/business/designsupport		
Drawing File Name: 601030202.dgn		
CAD Ver:	MicroStation V8	Scale: Not to Scale Units: English

Sheet Revisions	
Date:	Comments
08/27/13	LRFD Design
08/01/15	Analysis Program Updates

Colorado Department of Transportation
 4201 East Arkansas Avenue
 CDDT HQ, 4th Floor
 Denver, CO 80222
 Phone: 303-757-9021 FAX: 303-757-9868
Division of Project Support DDG/Bridge

TRIPLE CONCRETE BOX CULVERT

Issued By: Project Development Branch July 4, 2012

STANDARD PLAN NO.

M-601-3

Sheet No. 2 of 2

Computer File Information	
Creation Date: 07/04/12	Initials: DD
Last Modification Date: 11/25/15	Initials: JBE
Full Path: www.codot.gov/business/designsupport	
Drawing File Name: 601030102.dgn	
CAD Ver.: MicroStation V8 Scale: Not to Scale Units: English	

Sheet Revisions	
Date:	Comments
08/27/13	LRFD Design
08/01/15	Analysis Program Updates

Colorado Department of Transportation
 4201 East Arkansas Avenue
 CDDT HQ, 4th Floor
 Denver, CO 80222
 Phone: 303-757-9021 FAX: 303-757-9868
 Division of Project Support DDG/Bridge

TRIPLE CONCRETE
BOX CULVERT

Issued By: Project Development Branch July 4, 201

STANDARD PLAN NO.


M-601-3

Sheet No. 1 of 2

[illegible]

UNTIL SUCH TIME AS THESE
DRAWINGS ARE APPROVED
BY THE APPROPRIATE
REVIEWING AGENCIES,
TERRA NOVA ENGINEERING,
INC. APPROVES THEIR USE
ONLY FOR THE
PURPOSES DESIGNATED BY
WRITTEN AUTHORIZATION.

PREPARED FOR:
TIMBERRIDGE ESTATES, LLC
ATTN: SCOTT HENTIE
2760 BROGANS BLUFF
COLORADO SPRINGS, CO 8091
719.499.6752

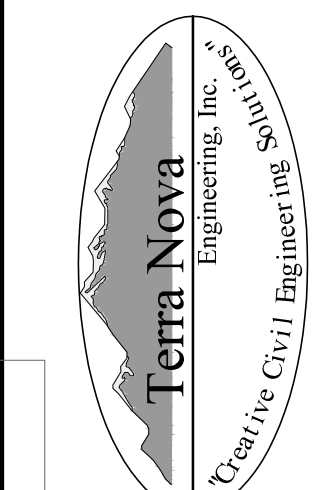

721 S. 23RD STREET
COLORADO SPRINGS, CO 80904
OFFICE: 719-635-6422
FAX: 719-635-6426
www.tnesinc.com

BERRIDGE ESTATES

BERRIDGE ESTATE
9210 ARROYA LANE

TIMBERRIDGE ESTATES
9210 ARROYA LANE

GRADING & EROSION CONTROL PLAN
GRADING PLAN - DETAILS

DESIGNED BY LD

DRAWN BY	DLF
----------	-----

CHECKED BY LD

H-SCALE	1"=200'
V-SCALE	N.A.

JOB NO. 1733.00

DATE ISSUED 02/2

SHEET NO. 9 C