

PAVEMENT DESIGN REPORT STERLING RANCH, FILING NO. 5 EL PASO COUNTY, COLORADO

PCD File No. SF241

Prepared for:
Classic Communities
2138 Flying Horse Club Drive
Colorado Springs, CO 80904

Attn: Austin Lenz

October 17, 2024

Respectfully Submitted,

ENTECH ENGINEERING, INC.

Zachary C. Gutierrez, E.I.T. Geotechnical Engineering Staff

Accepted for File

By: Gilbert LaForce, P.E. Engineering Manager

Date: 10/28/2024 3:59:31 PM El Paso County Department of Public Works

ZCG:JCG/zcg

Entech Job No. 240368

Reviewed by:

5238

Digitally signed by Joseph C Goode III

Date: 10/17/24

Joseph C. Goode III, P.E. Sr. Engineer



Table of Contents

1	Introduc	ction	. 1
2	Project	Description	. 1
3	Subsuri	face Explorations and Laboratory Testing	. 1
	3.1 Su	bsurface Exploration Program	. 1
	3.2 Ge	eotechnical Index and Engineering Property Testing	. 2
4	Subgrad	de Conditionsde Conditions	. 2
	4.1 Su	bsurface Conditions	. 3
	4.2 Gr	oundwater	. 3
5	Paveme	nt Design Recommendations	. 3
	5.1 Su	bgrade Conditions	. 3
	5.2 Sw	vell Mitigation	. 4
	5.3 Tra	affic Loading	. 4
	5.4 Pa	vement Design	. 4
6	Constru	iction Recommendations	. 5
	6.1 Ea	rthwork Recommendations for Pavement Subgrade	. 5
	6.1.1	Subgrade Preparation – Unbound Base Alternatives	. 6
	6.1.2	Subgrade Preparation – Cement Treated Subgrade	. 6
	6.1.3	Fill Placement and Compaction	. 7
	6.1.4	Aggregate Base Course and Recycled Concrete Base	. 7
	6.2 Co	ncrete Degradation Due to Sulfate Attack	. 8
	6.3 Co	nstruction Observation	. 8
7	Closure		8

Figures

Figure 1: Vicinity Map
Figure 2: Site and Exploration Plan

List of Appendices

Appendix A: Test Boring Logs Appendix B: Laboratory Test Results Appendix C: Pavement Design Calculations



1 Introduction

Entech Engineering, Inc. (Entech) completed a subsurface exploration program, laboratory testing, and pavement design for roadways within the Sterling Ranch, Filing No. 5. This report describes the subsurface exploration program conducted for the proposed roadway improvements and provides pavement section alternatives and construction recommendations. Entech participated in this project as a subconsultant to Classic Communities. The contents of this report, including the pavement design recommendations, are subject to the limitations and assumptions presented in Section 7.

2 Project Description

The site is located northwest of the intersection of Sterling Ranch Road and Dines Boulevard within Sterling Ranch, Filing No. 5, in El Paso County, Colorado (Figure 1). The proposed improvements include the paving of sections of Abby House Lane, Manor House Way, and School House Way. The extent of our investigation is shown in Figure 2.

At the time of our subsurface exploration program, the existing roadway had been rough-graded and utilities had been installed. Surrounding properties are comprised of vacant land, land being developed for future residential lots, and an existing subdivision. Based on the development plans, the roadways are designated as urban local roadways.

3 Subsurface Explorations and Laboratory Testing

3.1 Subsurface Exploration Program

Subsurface conditions at the project site were explored by eleven test borings, designated TB-1 through TB-11, drilled on September 17, 2024. The locations of the test borings are shown on the Site and Exploration Plan (Figure 2). The borings were drilled to depths of 5 to 10 feet below the existing ground surface (bgs). The drilling was performed using a truck-mounted, continuous flight auger drill rig supplied and operated by Entech. Descriptive boring logs providing the lithologies of the subsurface conditions encountered during drilling are presented in Appendix A. Groundwater levels were measured in each of the open boreholes at the conclusion of drilling.

Soil and bedrock samples were obtained from the borings utilizing the Standard Penetration Test (ASTM D1586) using a split-barrel California sampler. Results of the Standard Penetration Test (SPT) are included on the boring logs in terms of N-values expressed in blows per foot (bpf). Soil



and bedrock samples recovered from the borings were visually classified and recorded on the boring logs. The soil classifications were later verified utilizing laboratory testing and grouped by soil type. The soil type numbers are included on the boring logs. It should be understood that the soil descriptions shown on the boring logs may vary between boring location and sample depths. It should also be noted that the lines of stratigraphic separation shown on the boring logs represent approximate boundaries between soil types and the actual stratigraphic transitions may be more gradual or variable with location.

3.2 Geotechnical Index and Engineering Property Testing

Water content testing (ASTM D2216) was performed on the samples recovered from the borings, and the results are shown on the boring logs. Grain-Size Analysis (ASTM D422) and Atterberg Limits testing (ASTM D4318) were performed on selected samples to assist in classifying the materials encountered in the borings.

One-dimensional swell or collapse testing (ASTM D4546) was performed on select samples to determine the swell or collapse potential of the soil. For pavement design, a modified proctor (ASTM D1557) and California Bearing Ratio (CBR) test (ASTM D1883) were completed. Soluble sulfate testing was performed on select soil samples to evaluate the potential for below-grade degradation of concrete due to sulfate attack. The laboratory testing results are presented in Appendix B and summarized in Table B-1.

Strength testing was performed on two sets of soil/cement composite samples for each Soil Type 1 and Soil Type 2. Testing was performed on soil samples prepared with 2% and 4% Portland Cement Type 1L. A compression strength of 125 pounds per square inch (psi) is recommended for cement-stabilized subgrade. The 6-day average strength value of the 2% mix was 213 psi and 185 psi, respectively and the 6-day strength of the 4% mix was 243 psi and 210 psi, respectively. A 2% mix is recommended based on the laboratory test results. A summary of the testing results is attached in Appendix B, Table B-2.

4 Subgrade Conditions

Five primary soil types and one bedrock type were encountered in the test borings drilled for the subsurface investigation. Each soil type was classified in accordance with the Unified Soil Classification System (USCS) and the American Association of State Highway and Transportation



Officials (AASHTO) soil classification system using the laboratory testing results and the observations made during drilling.

4.1 Subsurface Conditions

Subsurface conditions along the proposed roadways consisted of loose to medium dense silty sand and sand with silt fill (Soil Type 1, AASHTO A-1-b, A-2-4, A-2-6, and A-4), loose to medium dense clayey sand fill (Soil Type 2, AASHTO A-1-b, A-6, and A-2-6), and stiff to very stiff sandy clay fill (Soil Type 3, AASHTO A-6). Soils also encountered in two of the test borings was native dense clayey sand (Soil Type 4, AASHTO A-1-b, A-2-6) and in one of the test borings was native hard sandy clay (Soil Type 5, AASHTO A-6). Extremely weak to very weak sandstone bedrock, or very dense silty to clayey sand when classified as a soil (Soil Type 6, AASHTO A-1-b, A-2-6) was encountered in two of the test borings. Water soluble sulfate testing results showed less than 0.01% sulfates which indicates that the soils exhibit a negligible potential for sulfate attack.

4.2 Groundwater

Groundwater was not encountered in the test borings. Groundwater fluctuations are possible and will depend on seasonal variations, local precipitation, runoff, and other factors, however, we do not anticipate groundwater to affect the proposed construction.

5 Pavement Design Recommendations

Pavement design recommendations were made in accordance with the *El Paso County Engineering Criteria Manual (ECM)*.

5.1 Subgrade Conditions

California Bearing Ratio (CBR) testing was performed on representative samples of the Soil Type 1 silty sand fill subgrade from TB-10 and from Soil Type 2 clayey sand fill from TB-8 to determine the support characteristic of the subgrade soils. The results of the CBR testing are presented in Appendix B and summarized in Exhibit 1.



Exhibit 1: Subsurface Laboratory Testing Summary

Design Parameter	Value						
Soil Type	1 – Clayey Sand Fill	2 – Clayey Sand Fill					
CBR at 95%	31.1	8.7					
Design CBR	10	8.7					
Liquid Limit	36	31					
Plasticity Index	15	20					
Percent Passing 200	23.8	41.9					
AASHTO Classification	A-2-6	A-6					
Unified Soils Classification	SC	SC					

5.2 Swell Mitigation

El Paso County requires swell mitigation for soils with swell testing results greater than 2% under a 150 pounds per square foot (psf) surcharge. Based on the subgrade soils classification and swell testing, mitigation for expansive soils will not be required on this site.

5.3 Traffic Loading

Traffic data is not available for the future interior roads in the Sterling Ranch, Filing No. 5 subdivision; however, the roads are classified as local roadways based on current development plans. The *El Paso County Engineering Criteria Manual* provides default 18-kip equivalent single axle loadings (ESAL) based on the street classification. For design, a default ESAL value of 292,000 was used for the local urban road designation.

5.4 Pavement Design

The pavement sections were determined utilizing the *El Paso County Engineering Criteria Manual*, the CBR testing, and default ESALs. Design parameters used in the pavement analysis are presented in Exhibit 2.

4



Exhibit 2: Pavement Design Parameters

Design Parameter	Value
Reliability	80%
Standard Deviation	0.45
Serviceability Loss (∆ psi)	2.5
Design CBR	8.7
Resilient Modulus	13,050 psi
Structural Coefficients	
Hot Bituminous Pavement	0.44
Aggregate Base Course	0.11
Recycled Concrete Base	0.11
Cement Stabilized Subgrade	0.11

Pavement section alternatives recommended for the roadways included in this phase filing are summarized in Exhibit 3. The pavement design calculations are presented in Appendix C.

Exhibit 3: Recommended Pavement Sections

Pavement Area	Design ESAL	Alternative ¹
Abby House Lane,	292,000	1. 3.0 inches HMA over 8.0 inches ABC/RCB
Manor House Way, School House Way		2. 3.0 inches HMA over 8.0 inches CTS

ABC = Aggregate Base Course; ESAL = equivalent single axle loads; HMA = Hot Mix Asphalt; CTS = Cement Treated Soil; RCB= Recycled Concrete Base Notes:

1. The use of CTS will require a deviation request approval.

6 Construction Recommendations

Pavement design recommendations provided herein are contingent on good construction practices, and poor construction techniques may result in poor performance. Our analyses assumed that this project will be constructed according to the *El Paso County Engineering Criteria Manual* and the *Pikes Peak Region Asphalt Paving Specifications*.

6.1 Earthwork Recommendations for Pavement Subgrade

Proper subgrade preparation is required for adequate pavement performance. Paving areas should be cleared of all deleterious materials including but not limited to: existing pavements, utility poles, and fence poles. Surface vegetation, if any, should be removed by stripping, with the depth to be field determined. Isolated pockets of high cohesive soils such as those encountered in boring TB-7 should be removed and replaced with granular fill. In addition, loose soils such as



those encountered in boring TB-8 should be overexcavated to underlying dense and unyielding subgrade. Granular soils can be replaced in accordance with Section 6.1.3.

6.1.1 Subgrade Preparation – Unbound Base Alternatives

If pavement section alternatives are selected utilizing aggregate base course (ABC) or Recycled Concrete Base (RCB), the final subgrade surface should be scarified to a depth of 8 inches, moisture conditioned within +/- 2% of the optimum water content, and recompacted to 95% of the Modified Proctor (ASTM 1557) maximum dry density.

The compacted surface below pavements should be proof-rolled with a fully loaded, tandem-axle, 10-yard dump truck or equivalent. Any areas, that are delineated to be soft, loose, or yielding during proof-rolling should be removed and reconditioned or replaced.

6.1.2 Subgrade Preparation – Cement Treated Subgrade

Prior to placement of cement stabilization a preliminary proof roll should be completed with a fully loaded, tandem-axle, 10-yard dump truck or equivalent. Any areas that are delineated to be soft, loose, or yielding during proof-rolling should be removed and reconditioned or replaced.

Following the preliminary proof roll, the subgrade shall be stabilized by the addition of cement. The amount of cement applied shall be a minimum of 2% (by weight) of the subgrade's maximum dry density as determined by the Modified Proctor (ASTM D1557) for granular soils or by the Standard Proctor (ASTM D698) for cohesive soils. The cement should be spread evenly on the subgrade surface and be thoroughly mixed into the subgrade such that a uniform blend of soil and cement is achieved to the CTS design depth. Densification of the cement-stabilized subgrade should be completed to obtain a compaction of at least 95% of the subgrade maximum dry density as determined by the Modified Proctor (ASTM D1557) or by the Standard Proctor (ASTM D698). Satisfactory compaction of the subgrade shall occur within 90 minutes from the time of mixing the cement into the subgrade.

The following conditions shall be observed as part of the subgrade stabilization:

- Type I/II or Type 1L cement as supplied; a local supplier shall be used. All cement used for stabilization should come from the same source. If cement sources are changed, a new laboratory mix design should be completed.
- Moisture conditioning of the subgrade and/or mixing of the cement into the subgrade shall not



occur when soil temperatures are below 40 degrees F. Cement treated subgrades should be maintained at a temperature of 40 degrees F or greater until the subgrade has been compacted as required.

- Cement placement, cement mixing, and compaction of the cement treated subgrade should be observed by Entech Engineering. Testing should include in-situ compaction tests and representative compacted specimens of the treated subgrade material for subsequent laboratory quality assurance testing. Testing reports will be provided to El Paso County as construction progresses.
- A minimum 7-day CTS compressive strength of 125 psi must be achieved.
- Soil strengths in excess of 275 psi will require microfracturing. Microfracturing will be completed using the Standard Method as defined by the City of Colorado Springs Draft Standard Specification, Section 305 Chemically Treated Subgrade. Microfracturing will be performed with the same (or equivalent tonnage) steel drum vibratory roller used for compaction of the CTS. A minimum of 12-ton roller shall be used. Three full passes with the roller operating at maximum amplitude and traveling at 2- 3 mph shall be applied. If the treated material breaks up excessively at the surface, the vibration amplitude shall be decreased or eliminated.

6.1.3 Fill Placement and Compaction

Granular fill placed as part of the pavement subgrade shall consist of non-expansive, granular soil, free of organic matter, unsuitable materials, debris, and cobbles greater than 3 inches in diameter. Additionally, any granular fill placed as part of the roadway subgrade should have a minimum CBR of 8. All granular fill placed within the pavement subgrade should be compacted to a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density at +/-2% of optimum moisture content. Fill material should be placed in horizontal lifts such that each finished lift has a compacted thickness of 6 inches or less. Entech should approve any imported fill to be used within the pavement subgrade area prior to delivery to the site.

6.1.4 Aggregate Base Course and Recycled Concrete Base

ABC or RCB materials shall conform to the *El Paso County Standard Specifications Manual*, Section 300 Aggregate Base Course. ABC or RCB materials should be compacted to a minimum of 95% of the Modified Proctor (ASTM D1557) maximum dry density within +/-2% of optimum moisture content.



6.2 Concrete Degradation Due to Sulfate Attack

Sulfate solubility testing was conducted on several samples recovered from the test borings to evaluate the potential for sulfate attack on concrete. The test results indicated less than 0.01% soluble sulfate (by weight). The test results indicate the sulfate component of the in-place soils presents a negligible to severe exposure threat to concrete placed below the site grade.

As presented in Evaluation of Selected Pavement Specifications and Responses to Questions Relevant to Design and Construction of Cement-Treated Soil and Aggregate Layers in El Paso County, Colorado report from Spencer Gutherie and Robert Stevens dated March 13, 2024 soils with less than 3,000 ppm (0.3%) do not require special construction practices.

6.3 Construction Observation

Subgrade preparation for pavement structures should be observed by Entech in order to verify that (1) no anomalies are present, (2) materials similar to those described in this report have been encountered or placed, and (3) no soft spots, expansive or organic soil, or debris are present in the pavement subgrade prior to paving. Construction observation requirements as presented in the Use of CTS for Paving Season Memorandum should be followed.

7 Closure

The subsurface investigation, geotechnical evaluation, and recommendations presented in this report are intended for use by Classic Communities with application to the paving of the Sterling Ranch, Filing No. 5 project in El Paso County, Colorado. In conducting the subsurface investigation, laboratory testing, engineering evaluation, and reporting, Entech Engineering, Inc. endeavored to work in accordance with generally accepted professional geotechnical and geologic practices and principles consistent with the level of care and skill ordinarily exercised by members of the geotechnical profession currently practicing in the same locality and under similar conditions. No other warranty, expressed or implied, is made. During final design and/or construction, if conditions are encountered that appear different from those described in this report, Entech Engineering, Inc. requests to be notified so that the evaluation and recommendations presented herein can be reviewed and modified as appropriate.

If there are any questions regarding the information provided herein, or if Entech Engineering, Inc. can be of further assistance, please do not hesitate to contact us.








VICINITY MAP

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

FIG. 1

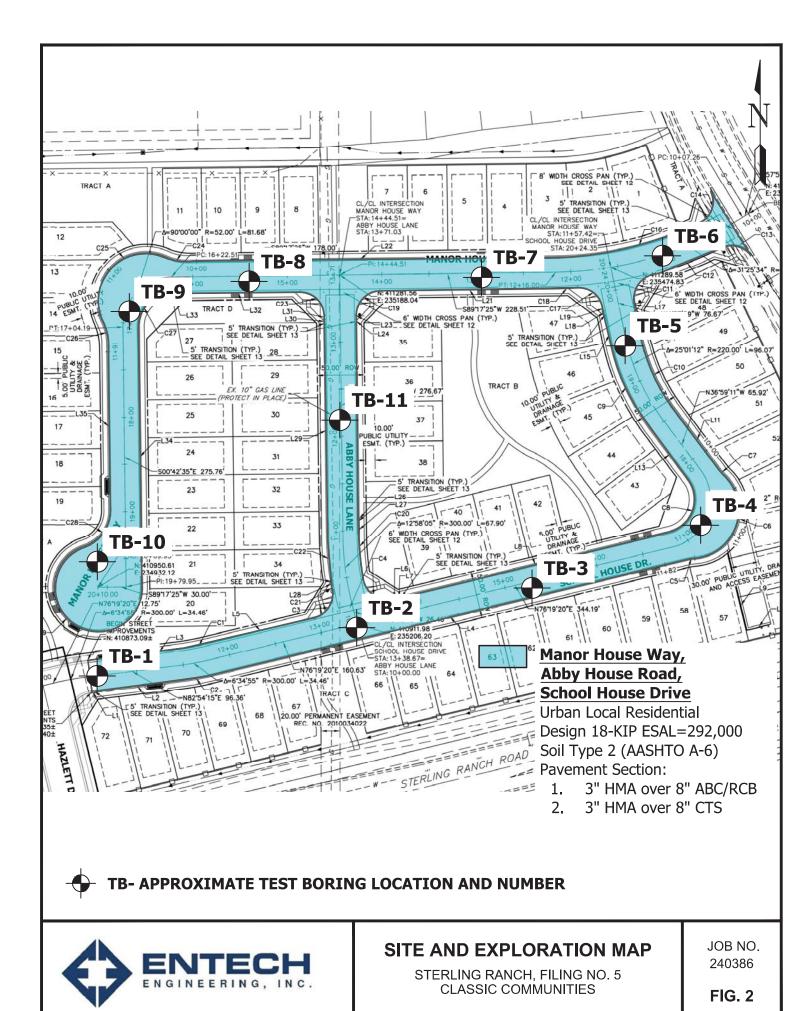



APPENDIX A: Test Boring Logs

TEST BORING 1							TEST BORING 2						
DATE DRILLED 9/17/202	4						DATE DRILLED 9/17/202	4					
REMARKS							REMARKS						
DRY TO 10', 9/17/24	Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type	DRY TO 5', 9/17/24	Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
FILL 0-10', SAND, SILTY, TAN to	4:				0.4		FILL 0-5', SAND, SILTY, BROWN to	_	jj		_	0.5	_
BROWN, LOOSE to MEDIUM DENSE, MOIST				6	8.1	1	TAN, LOOSE to MEDIUM DENSE, MOIST	=			7	6.5	1
	5_			16	9.5	1		5			12	5.9	1
	10 -	! 4.		4	13.7	1		10_					
								=					
	15							15					
]												
	20_							20_					



STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING 3							TEST BORING 4	ļ					
DATE DRILLED 9/17/202	4						DATE DRILLED 9/17/202	24					
REMARKS	Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type	REMARKS	Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
DRY TO 5', 9/17/24	۵	S	Š	В	≯	ιχ	DRY TO 10', 9/17/24	ے	S:	Š	В	>	Sc
FILL 0-5', SAND, SILTY, TAN to BROWN, LOOSE to MEDIUM DENSE, MOIST				9	7.4	1	FILL 0-4', SAND, WITH SILT, TAN, MEDIUM DENSE, MOIST	-			14	4.0	1
	5_	<u> </u>		11	5.1	1	SAND, CLAYEY, TAN, DENSE, MOIST SANDSTONE, WEAK, TAN, WEATHERED (SAND, CLAYEY, VERY DENSE, MOIST)	5_			35	11.6	4
	10							10			<u>50</u> 5"	7.4	5
	15							15					
	20_							20_	•				



STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING 5					TEST BORING 6					
DATE DRILLED 9/17/2024	4			•	DATE DRILLED 9/17/202	4				
REMARKS			Q.		REMARKS				,	
DRY TO 5', 9/17/24	Depth (ft) Symbol	Samples Blows per foot	Watercontent %	Soil Type	DRY TO 5', 9/17/24	Depth (ft) Svmbol	Samples	Blows per foot	Watercontent %	Soil Type
FILL 0-5', SAND, SILTY, BROWN to TAN, MEDIUM DENSE, MOIST		11	10.3	1	FILL 0-3', SAND, SLIGHTLY SILTY, TAN, MEDIUM DENSE, DRY			18	2.1	1
	5	13	7.3	1	SAND, SILTY, TAN, DENSE, MOIST	5 - 1		35	8.6	4
	10 _					10 _				
	15_					15				



STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING 7						TEST BORING 8					
DATE DRILLED 9/17/202						DATE DRILLED 9/17/2024	4				
REMARKS						REMARKS					
	Depth (ft) Svmbol	Samples	Blows per foot	Watercontent %	Soil Type		Depth (ft) Svmbol	Samples	Blows per foot	Watercontent %	Soil Type
DRY TO 5', 9/17/24	Dep	San	Blo	Wal	Soil	DRY TO 5', 9/17/24		San	Blo	Wat	Soil
FILL 0-5', CLAY, SLIGHTLY, SANDY,						FILL 0-5', SAND, CLAYEY, BROWN					
BROWN, STIFF, MOIST			10	17.7	3	to TAN, LOOSE, MOIST	<u>-</u> ?/		4	8.6	2
FILL, SAND, SILTY, BROWN, MEDIUM DENSE, MOIST	5 -!!		19	3.5	1		5		5	13.3	2
	10_						10 _				
	15_						15				
]]				
	20						20				



STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING 9							TEST BORING 10						
DATE DRILLED 9/17/202	4						DATE DRILLED 9/17/202						
REMARKS							REMARKS						
DRY TO 10', 9/17/24	Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type	DRY TO 5', 9/17/24	Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
FILL 0-9', SAND, CLAYEY, TAN to							FILL 0-1', SAND, CLAYEY, BROWN		·: ·.				
BROWN, MEDIUM DENSE to LOOSE, MOIST		/		16	8.2	2	SANDSTONE, VER YWEAK, TAN, MODERATELY WEATHERED (SAND, SILTY, VERY DENSE,	:			<u>50</u> 10"	11.0	6
	5			7	18.2	2	MOIST)	5			<u>50</u> 11"	11.9	6
CLAY, SANDY, TAN, HARD, MOIST	10_	<i>Ż</i> ,		40	19.4	5		10					
	15							15					
	20_							20_					



STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING 11 DATE DRILLED 9/17/2024 REMARKS Watercontent % Blows per foot Soil Type Symbol DRY TO 5', 9/17/24 FILL 0-5', SAND, CLAYEY, BROWN 8.1 2 14 to TAN, MEDIUM DENSE, MOIST 12 10.0 2 10 15



TEST BORING LOGS



APPENDIX B: Laboratory Test Results





		_	_	_	_	_	_	_	_	_	_	_	_	_	_	_	_
		SOIL DESCRIPTION	FILL, SAND, CLAYEY	FILL, SAND, SILTY	FILL, SAND, SILTY	FILL, SAND, SILTY	FILL, SAND, WITH SILT	FILL, SAND, SILTY	FILL, SAND, SLIGHTLY SILTY	FILL, SAND, CLAYEY	FILL, SAND, CLAYEY	FILL, SAND, CLAYEY	FILL, SAND, CLAYEY	FILL, CLAY, SLIGHTLY SANDY	CLAY, SANDY	SANDSTONE (SAND, SILTY)	SANDSTONE (SAND, CLAYEY)
		nscs	SC	WS	WS	WS	MS-MS	SM	MS	SC	SC	SC	SC	CF	CF	WS	SC
AASHTO CLASS.	(GROUP	INDEX)	A-2-6 (0)	A-2-4 (0)	A-1-b (0)	A-1-b (0)	A-1-b (0)	A-4 (0)	A-1-b (0)	A-6 (1)	A-4 (0)	A-2-6 (0)	A-6 (0)	A-6 (10)	A-6 (13)	A-1-b (0)	A-2-6 (0)
SWELL/	SE	(%)	0.5							1.0		0.3		0.4	6.0		-0.4
	SULFATE	(WT %)			<0.01				00'0							<0.01	<0.01
PLASTIC	INDEX		15	1	NP	NP	NP	2	NP	11	8	11	11	12	22	NP	13
PLASTIC	LIMIT		21	26	NP	NP	NP	26	NP	20	21	22	22	20	13	NP	24
LIQUID	LIMIT		36	27	>N	N	<u>N</u>	28	<u>N</u>	31	29	33	33	32	35	N N	37
PASSING	NO. 200 SIEVE	(%)	23.8	30.2	19.0	19.9	9.4	38.8	4.5	41.9	38.1	21.0	36.4	83.9	6.69	16.0	22.0
DRY	DENSITY	(PCF)	124.3							115.6		115.9		108.8	8.66		115.0
	WATER	(%)	8.1	8.1	6.5	7.4	4.0	10.3	2.1	9.6	8.6	8.6	8.1	17.7	16.9	11.0	12.3
	T	(FT)	0-3	1-2	1-2	1-2	1-2	1-2	1-2	0-3	1-2	1-2	1-2	1-2	10	1-2	10
TEST	BORING	NO.	10	1	2	3	4	5	9	8	8	6	11	7	6	10	4
	SOIL	TYPE	1, CBR	1	1	1	1	_	1	2, CBR	2	2	2	3	9	9	9



TABLE B-2 SUMMARY OF CTS TEST RESULTS

FIELD SAMPLE ID	SOIL ADDITIVE	ADDITIVE PERCENTAGE (%)	WATER CONTENT (%)	DENSITY (dry)	AGE (days)	STRENGTH (psi)
				121.9		219
TB-10 @ 0-3'	TYPE IL CEMENT	2	7.3	121.7	5	206
				121.8		214
				А	VERAGE:	213
				121.8		238
TB-10 @ 0-3'	TYPE IL CEMENT	4	7.3	121.6	5	234
				121.5		257
				Α	VERAGE:	243
				115.3		193
TB-8 @ 0-3'	TYPE IL CEMENT	2	9.2	115.0	5	185
				114.8		177
				А	VERAGE:	185
				115.1		212
TB-8 @ 0-3'	TYPE IL CEMENT	4	9.2	115.0	5	202
				114.7		216
				A	VERAGE:	210


Notes:

1. CURING METHOD: 100° HUMIDIFIED OVEN

Project: Sterling Ranch, Filing No. 5 Client: Classic Communities

Job No: 240368

TEST BORING10SOIL DESCRIPTION FILL, SAND, CLAYEYDEPTH (FT)0-3SOIL TYPE 1, CBR

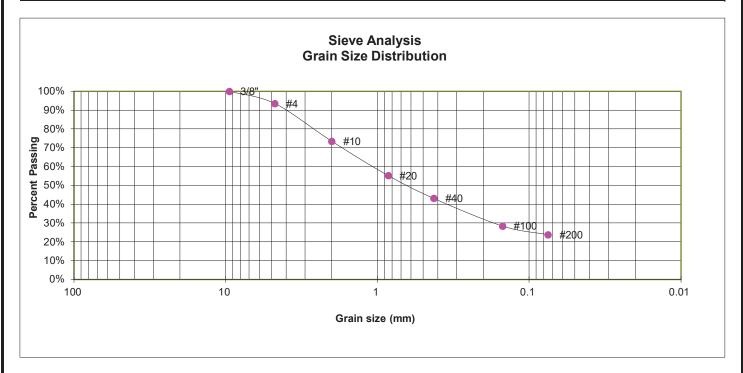

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	93.6%
10	73.4%
20	55.3%
40	43.1%
100	28.4%
200	23.8%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SC
AASHTO CLASSIFICATION: A-2-6
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	21
Liquid Limit	36
Plastic Index	15



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING1SOIL DESCRIPTION FILL, SAND, SILTYDEPTH (FT)1-2SOIL TYPE 1

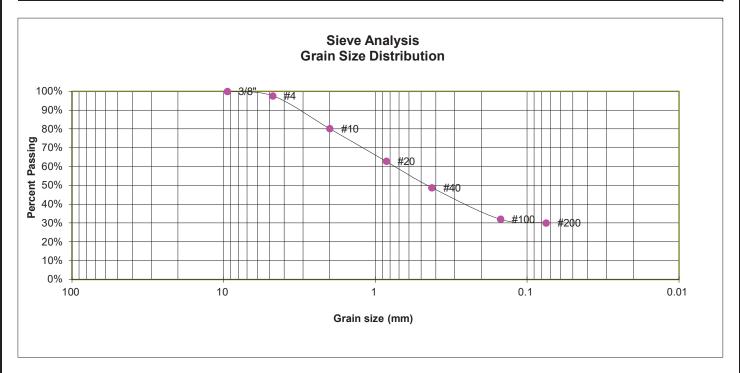

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	97.7%
10	80.2%
20	62.8%
40	48.8%
100	32.1%
200	30.2%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SM
AASHTO CLASSIFICATION: A-2-4
AASHTO GROUP INDEX: 0


ATTERBERG LIMITS

Plastic Limit	26
Liquid Limit	27
Plastic Index	1



LABORATORY TEST RESULTS

TEST BORING2SOIL DESCRIPTIONFILL, SAND, SILTYDEPTH (FT)1-2SOIL TYPE1

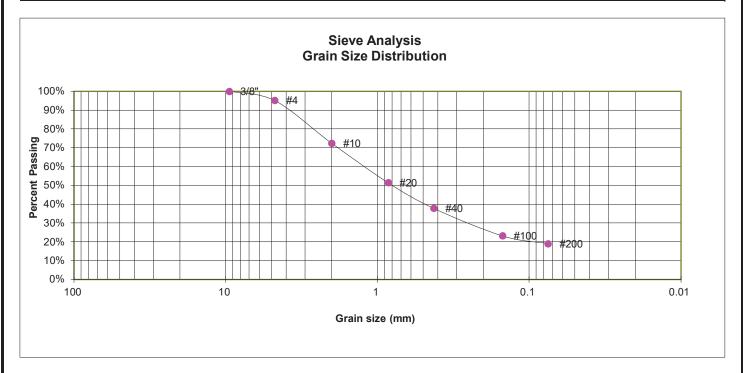

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	95.2%
10	72.4%
20	51.4%
40	37.8%
100	23.2%
200	19.0%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SM
AASHTO CLASSIFICATION: A-1-b
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING3SOIL DESCRIPTION FILL, SAND, SILTYDEPTH (FT)1-2SOIL TYPE 1

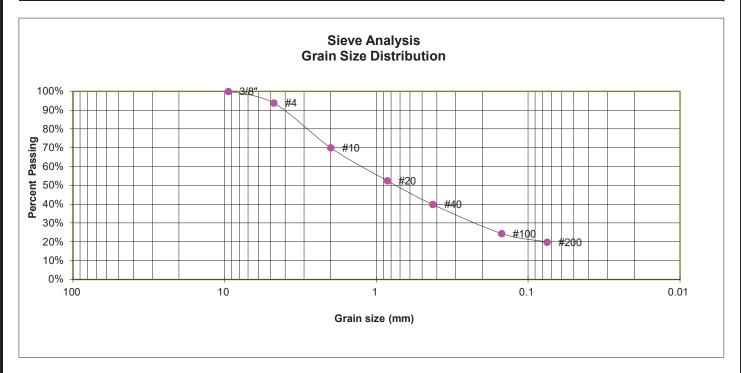

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	93.8%
10	70.0%
20	52.5%
40	39.9%
100	24.5%
200	19.9%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SM
AASHTO CLASSIFICATION: A-1-b
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING4SOIL DESCRIPTION FILL, SAND, WITH SILTDEPTH (FT)1-2SOIL TYPE 1

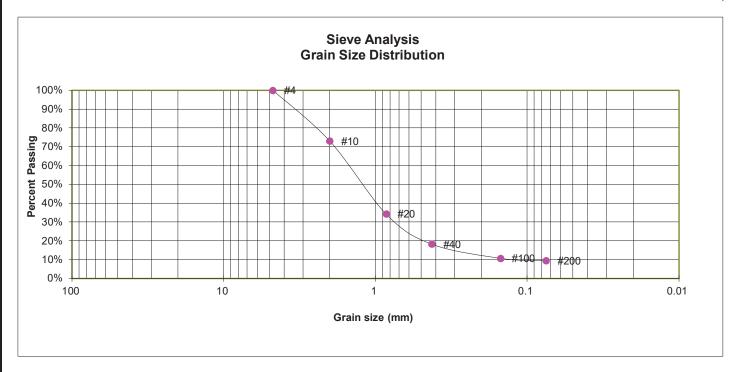

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	73.1%
20	34.2%
40	18.3%
100	10.7%
200	9.4%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SW-SM
AASHTO CLASSIFICATION: A-1-b
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING5SOIL DESCRIPTION
SOIL TYPEFILL, SAND, SILTYDEPTH (FT)1-2SOIL TYPE1

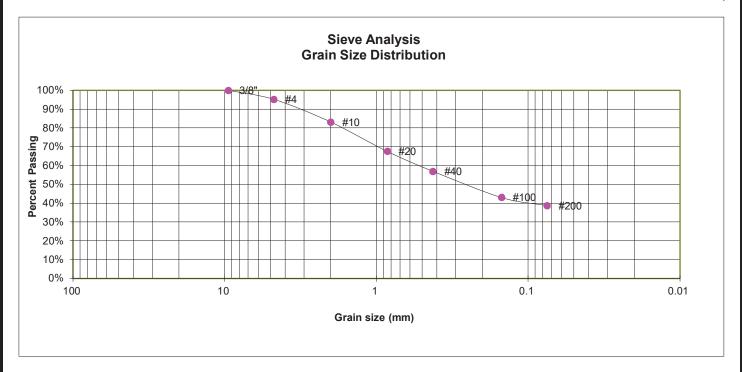

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	95.3%
10	83.1%
20	67.7%
40	57.0%
100	43.1%
200	38.8%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SM
AASHTO CLASSIFICATION: A-4
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	26
Liquid Limit	28
Plastic Index	2



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING6SOIL DESCRIPTION
SOIL TYPEFILL, SAND, SLIGHTLY SILTYDEPTH (FT)1-2SOIL TYPE1

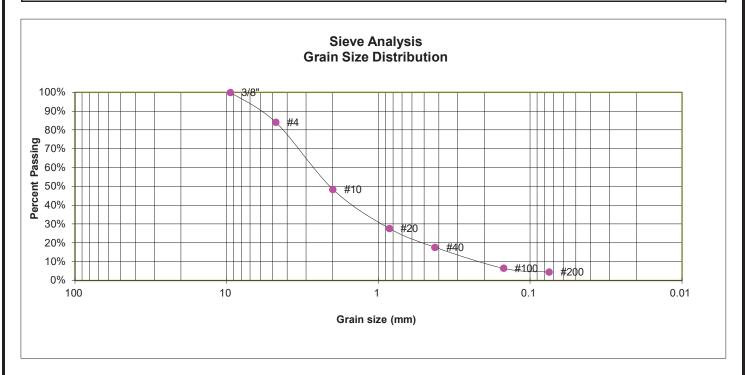

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	84.1%
10	48.5%
20	27.8%
40	17.7%
100	6.6%
200	4.5%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SW
AASHTO CLASSIFICATION: A-1-b
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING9SOIL DESCRIPTION
SOIL TYPEFILL, SAND, CLAYEYDEPTH (FT)1-2SOIL TYPE1

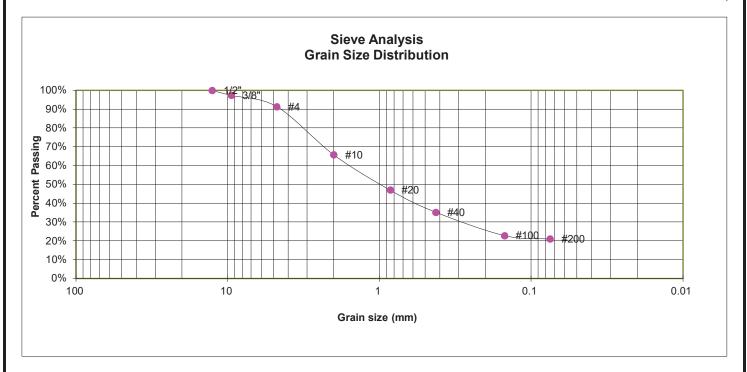

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	97.4%
4	91.4%
10	65.8%
20	47.1%
40	35.2%
100	22.8%
200	21.0%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SC
AASHTO CLASSIFICATION: A-2-6
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	22
Liquid Limit	33
Plastic Index	11



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING8SOIL DESCRIPTION
SOIL TYPEFILL, SAND, CLAYEYDEPTH (FT)0-3SOIL TYPE
2, CBR

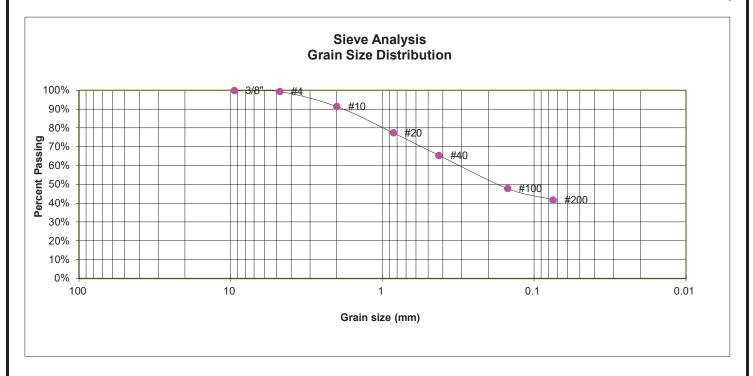

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	99.4%
10	91.4%
20	77.5%
40	65.5%
100	47.9%
200	41.9%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SC
AASHTO CLASSIFICATION: A-6
AASHTO GROUP INDEX: 1

ATTERBERG LIMITS


Plastic Limit	20
Liquid Limit	31
Plastic Index	11



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING7SOIL DESCRIPTION FILL, CLAY, SLIGHTLY SANDYDEPTH (FT)1-2SOIL TYPE 2

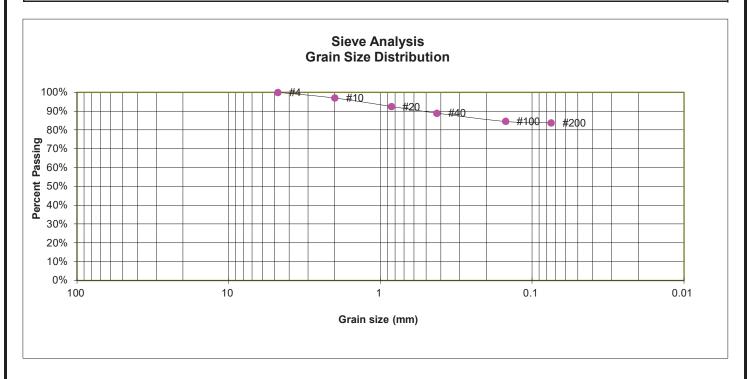

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	97.1%
20	92.5%
40	89.0%
100	84.6%
200	83.9%

SOIL CLASSIFICATION

USCS CLASSIFICATION: CL
AASHTO CLASSIFICATION: A-6
AASHTO GROUP INDEX: 10

ATTERBERG LIMITS


Plastic Limit 20 Liquid Limit 32 Plastic Index 12



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING8SOIL DESCRIPTIONFILL, SAND, CLAYEYDEPTH (FT)1-2SOIL TYPE2

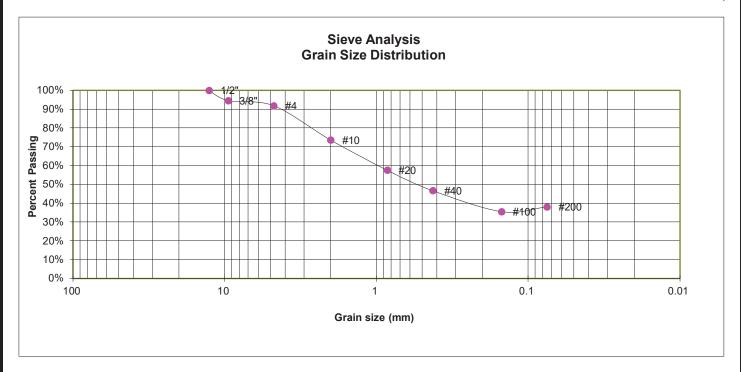

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	94.6%
4	91.8%
10	73.5%
20	57.6%
40	46.7%
100	35.5%
200	38.1%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SC
AASHTO CLASSIFICATION: A-4
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	21
Liquid Limit	29
Plastic Index	8



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING11SOIL DESCRIPTION FILL, SAND, CLAYEYDEPTH (FT)1-2SOIL TYPE 2

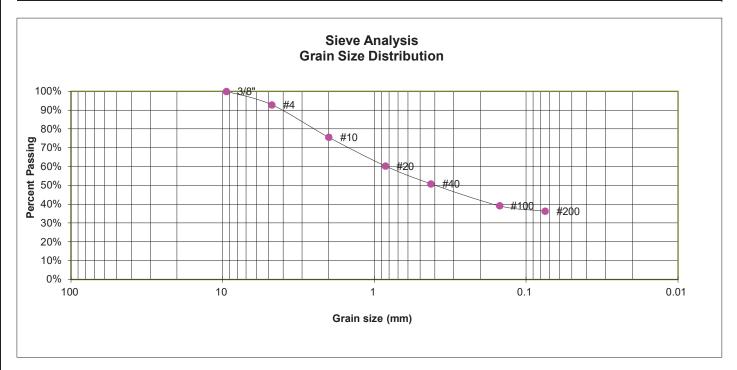

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	92.9%
10	75.6%
20	60.4%
40	50.9%
100	39.3%
200	36.4%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SC
AASHTO CLASSIFICATION: A-6
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit 22 Liquid Limit 33 Plastic Index 11



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368



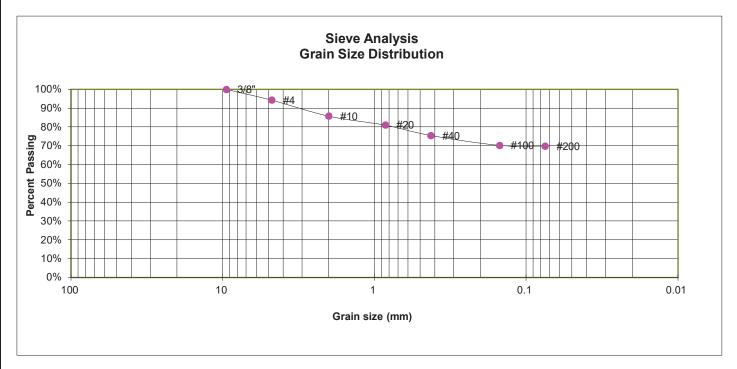

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	94.3%
10	85.8%
20	81.0%
40	75.5%
100	70.2%
200	69.9%

SOIL CLASSIFICATION

USCS CLASSIFICATION: CL AASHTO CLASSIFICATION: A-6 AASHTO GROUP INDEX: 13

ATTERBERG LIMITS


Plastic Limit 13 Liquid Limit 35 Plastic Index 22



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING10SOIL DESCRIPTION SANDSTONE (SAND, SILTY)DEPTH (FT)1-2SOIL TYPE 5

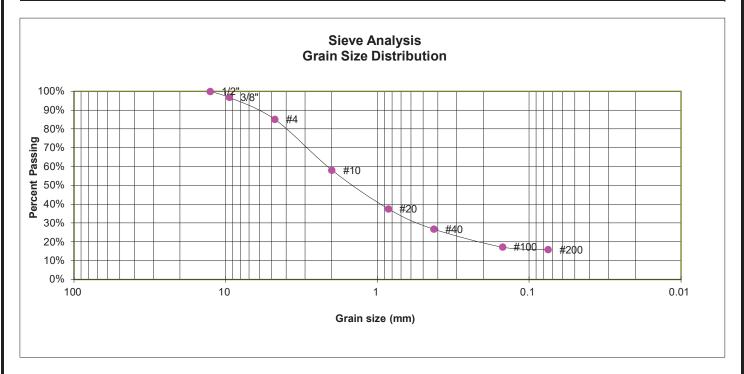

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	96.8%
4	85.2%
10	58.2%
20	37.6%
40	26.8%
100	17.3%
200	16.0%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SM
AASHTO CLASSIFICATION: A-1-b
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING4SOIL DESCRIPTION SANDSTONE (SAND, CLAYEY)DEPTH (FT)10SOIL TYPE 5

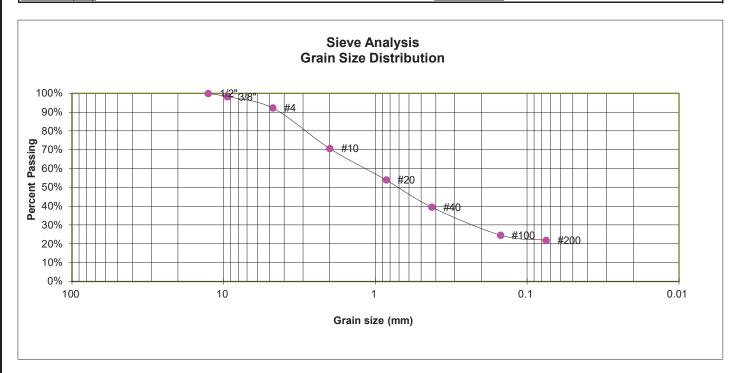

GRAIN SIZE ANALYSIS

U.S.	Percent
Sieve #	<u>Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	98.3%
4	92.3%
10	70.7%
20	54.0%
40	39.5%
100	24.7%
200	22.0%

SOIL CLASSIFICATION

USCS CLASSIFICATION: SC
AASHTO CLASSIFICATION: A-2-6
AASHTO GROUP INDEX: 0

ATTERBERG LIMITS


Plastic Limit	24
Liquid Limit	37
Plastic Index	13



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING10SOIL DESCRIPTION SAND, CLAYEYDEPTH (FT)0-3SOIL TYPE 1, CBR

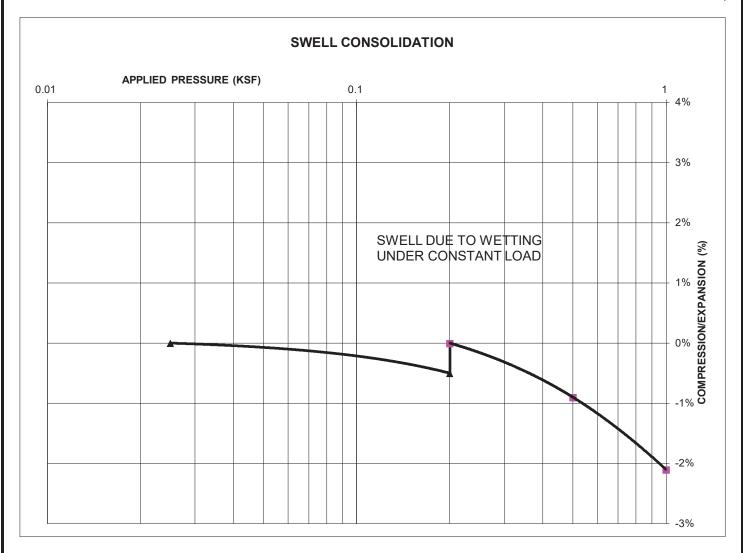

SWELL/COLLAPSE TEST RESULTS


NATURAL UNIT DRY WEIGHT (PCF): 124 NATURAL MOISTURE CONTENT: 8.1% SWELL/COLLAPSE (%): 0.5%



SWELL TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING9SOIL DESCRIPTION SAND, CLAYEYDEPTH (FT)1-2SOIL TYPE 1

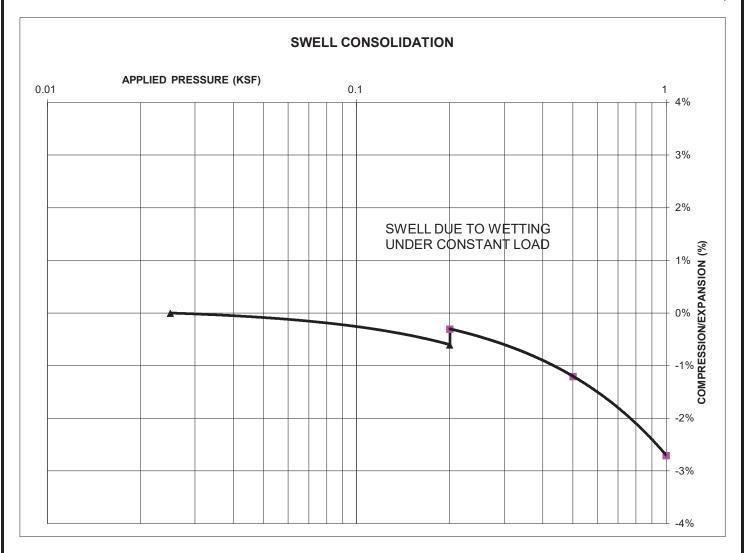

SWELL/COLLAPSE TEST RESULTS


NATURAL UNIT DRY WEIGHT (PCF): 116 NATURAL MOISTURE CONTENT: 8.6% SWELL/COLLAPSE (%): 0.3%



SWELL TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING8SOIL DESCRIPTIONSAND, CLAYEYDEPTH (FT)0-3SOIL TYPE2, CBR

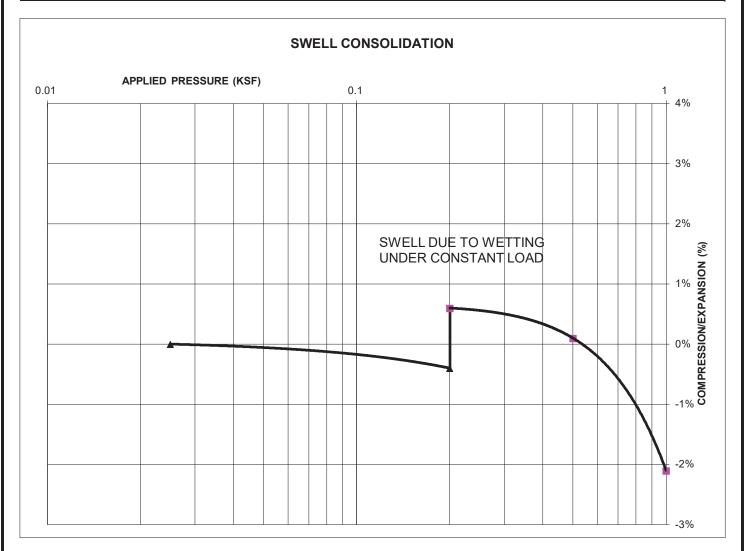

SWELL/COLLAPSE TEST RESULTS


NATURAL UNIT DRY WEIGHT (PCF): 116
NATURAL MOISTURE CONTENT: 9.6%
SWELL/COLLAPSE (%): 1.0%



SWELL TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING7SOIL DESCRIPTION CLAY, SLIGHTLY SANDYDEPTH (FT)1-2SOIL TYPE 2

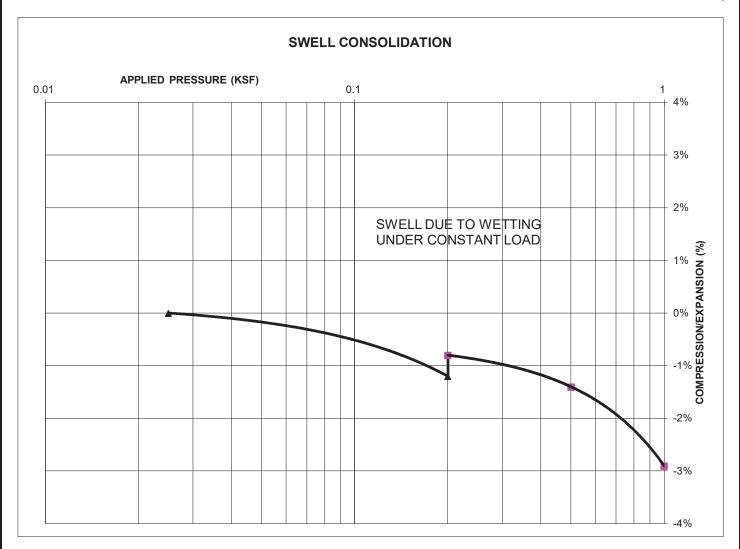


SWELL/COLLAPSE TEST RESULTS


NATURAL UNIT DRY WEIGHT (PCF): 109 NATURAL MOISTURE CONTENT: 17.7% SWELL/COLLAPSE (%): 0.4%



SWELL TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368



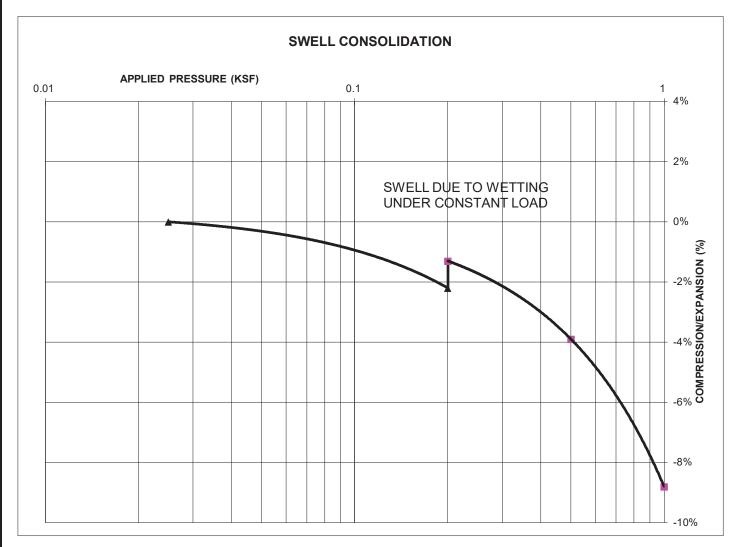

SWELL/COLLAPSE TEST RESULTS


NATURAL UNIT DRY WEIGHT (PCF): 100 NATURAL MOISTURE CONTENT: 16.9% SWELL/COLLAPSE (%): 0.9%



SWELL TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

TEST BORING4SOIL DESCRIPTION
SOIL TYPESANDSTONE (SAND, CLAYEY)DEPTH (FT)10SOIL TYPE5

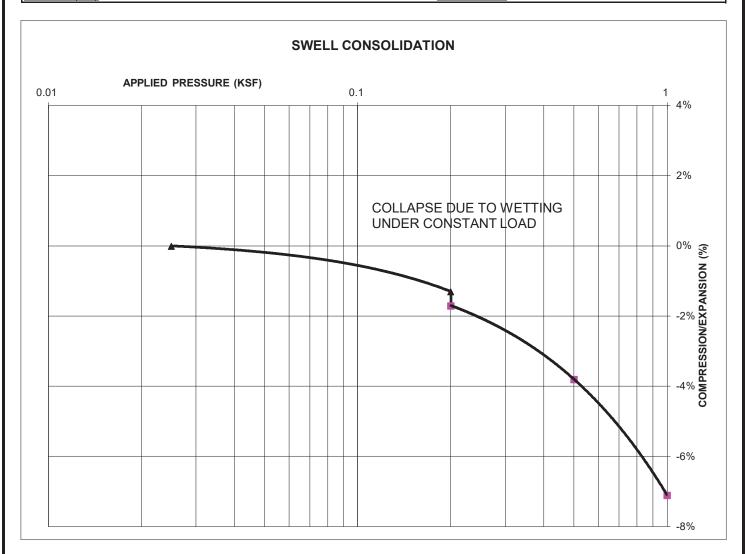

SWELL/COLLAPSE TEST RESULTS

NATURAL UNIT DRY WEIGHT (PCF): 115 NATURAL MOISTURE CONTENT: 12.3% SWELL/COLLAPSE (%): -0.4%



SWELL TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

SAMPLE LOCATION TB-10 @ 0-3'


SOIL DESCRIPTION SAND, CLAYEY, BROWN SOIL TYPE 1

PROCTOR DATA

IDENTIFICATION: SC PROCTOR TEST #: 1
TEST BY: BL

TEST DESIGNATION: ASTM-1557-A

MAXIMUM DRY DENSITY (PCF): 128.1 OPTIMUM MOISTURE: 7.3

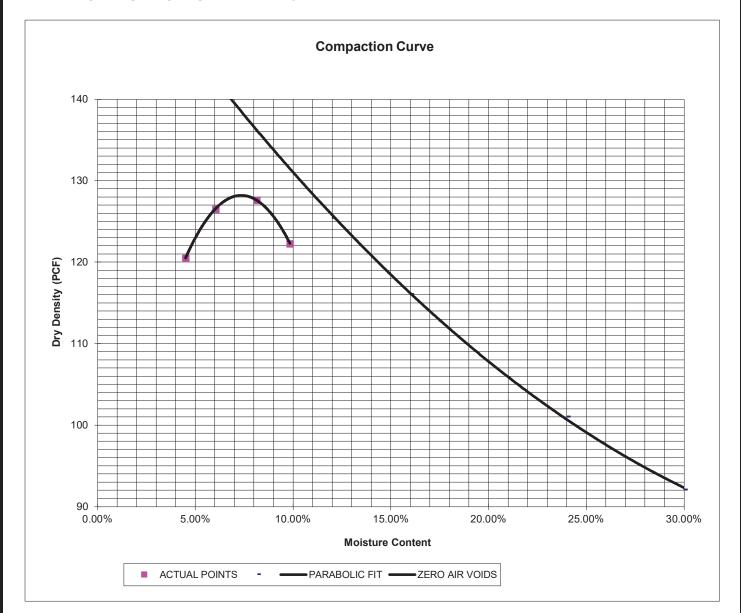



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

CBR TEST LOAD DATA

Piston Diameter (cm): 4.958 Piston Area (in²): 2.993

	10 B	LOWS	25 B	LOWS	56 B	LOWS
Penetration	Мо	ld # 1	Mol	ld # 2	Мо	ld # 3
Depth	Load	Stress	Load	Stress	Load	Stress
(inches)	(lbs)	(psi)	(lbs)	(psi)	(lbs)	(psi)
0.000	0	0.00	0	0.00	0	0.00
0.025	92	30.74	178	59.48	339	113.28
0.050	138	46.12	306	102.26	782	261.32
0.075	157	52.46	375	125.31	1102	368.25
0.100	172	57.48	450	150.38	1850	618.21
0.125	198	66.17	524	175.10	2239	748.20
0.150	218	72.85	662	221.22	2530	845.44
0.175	230	76.86	725	242.27	2825	944.02
0.200	236	78.86	801	267.67	3244	1084.04
0.300	261	87.22	952	318.13	4265	1425.23
0.400	296	98.91	1145	382.62	5045	1685.88
0.500	323	107.94	1265	422.72	5957	1990.64

MOISTURE AND DENSITY DATA

	Mold # 1	Mold # 2	Mold # 3
Can #	303	340	341
Wt. Can	9.28	6.85	6.76
Wt. Can+Wet	114.7	140.51	118.61
Wt. Can+Dry	100.55	124.52	107.25
Wt. H20	14.15	15.99	11.36
Wt. Dry Soil	91.27	117.67	100.49
Moisture Content	15.50%	13.59%	11.30%
Wet Density (PCF)	123.0	128.7	134.1
Dry Density (PCF)	114.6	120.0	125.0
% Compaction	89%	94%	98%
CBR	5.75	15.04	61.82

PROCTOR DATA

Maximum Dry Density (pcf)	128.1
Optimum Moisture	7.3
90% of Max. Dry Density (pcf)	115.3
95% of Max. Dry Density (pcf)	121.7


CBR at 90% of Max. Density = 6.9	~ R VALUE 14
CBR at 95% of Max. Density = 31.1	~ R VALUE 74




LABORATORY TEST RESULTS

SAMPLE LOCATION TB-10 @ 0-3'

SOIL DESCRIPTION SAND, CLAYEY, BROWN SOIL TYPE 1

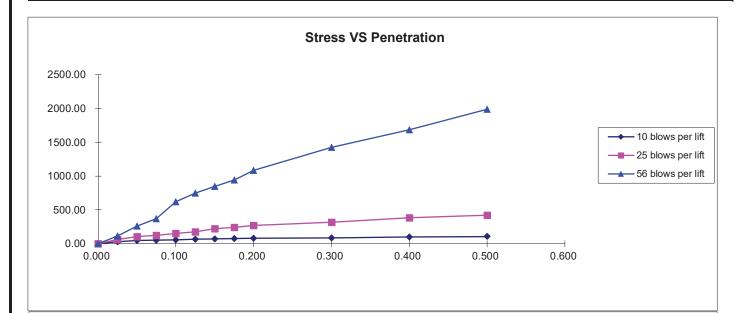

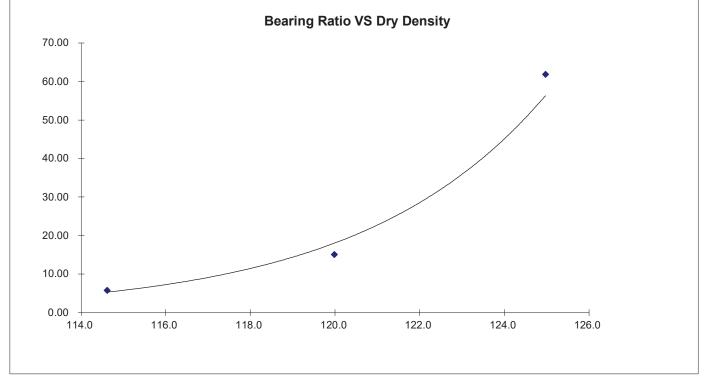



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

SAMPLE LOCATION TB-8 @ 0-3'


SOIL DESCRIPTION SAND, CLAYEY, BROWN SOIL TYPE 2

PROCTOR DATA

IDENTIFICATION: SC PROCTOR TEST #: 2
TEST BY: PH

TEST DESIGNATION: ASTM-698-A

MAXIMUM DRY DENSITY (PCF): 120.9
OPTIMUM MOISTURE: 9.2

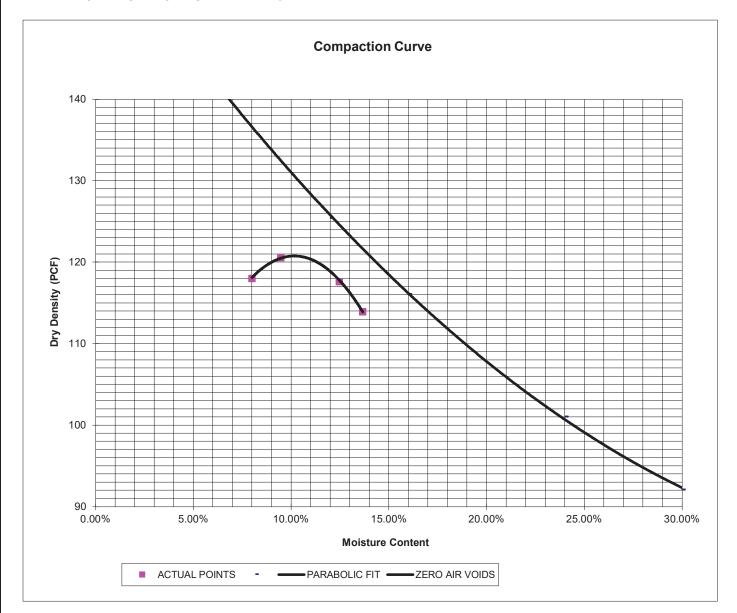



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368

CBR TEST LOAD DATA

Piston Diameter (cm): 4.958 Piston Area (in²): 2.993

	10 B	LOWS	25 B	LOWS	56 B	LOWS
Penetration	Mol	ld # 1	Мо	ld # 2	Мо	ld # 3
Depth	Load	Stress	Load	Stress	Load	Stress
(inches)	(lbs)	(psi)	(lbs)	(psi)	(lbs)	(psi)
0.000	0	0.00	0	0.00	0	0.00
0.025	41	13.70	109	36.42	148	49.46
0.050	51	17.04	169	56.47	236	78.86
0.075	60	20.05	196	65.50	292	97.58
0.100	81	27.07	212	70.84	339	113.28
0.125	93	31.08	241	80.53	410	137.01
0.150	101	33.75	262	87.55	478	159.73
0.175	114	38.10	281	93.90	535	178.78
0.200	123	41.10	296	98.91	588	196.49
0.300	133	44.44	352	117.63	820	274.02
0.400	145	48.45	402	134.34	955	319.13
0.500	165	55.14	462	154.39	1125	375.94

MOISTURE AND DENSITY DATA

	Mold # 1	Mold # 2	Mold # 3
Can #	369	420	352
Wt. Can	8.7	8.32	8.09
Wt. Can+Wet	197.1	152.42	136.19
Wt. Can+Dry	170.94	131.47	118.93
Wt. H20	26.16	20.95	17.26
Wt. Dry Soil	162.24	123.15	110.84
Moisture Content	16.12%	17.01%	15.57%
Wet Density (PCF)	120.1	123.1	129.1
Dry Density (PCF)	110.0	112.7	118.3
% Compaction	91%	93%	98%
CBR	2.71	7.08	11.33

PROCTOR DATA

Maximum Dry Density (pcf) 120.9 Optimum Moisture 9.2 90% of Max. Dry Density (pcf) 108.8 95% of Max. Dry Density (pcf) 114.9


CBR at 90% of Max. Density = 0.7	~ R VALUE 1
CBR at 95% of Max. Density = 8.7	~ R VALUE 22




LABORATORY TEST RESULTS

SAMPLE LOCATION TB-8 @ 0-3'

SOIL DESCRIPTION SAND, CLAYEY, BROWN SOIL TYPE 2

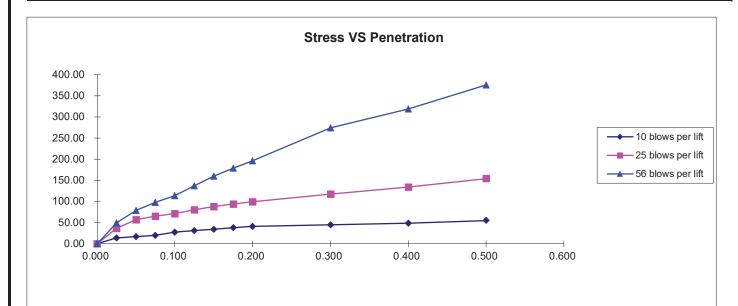

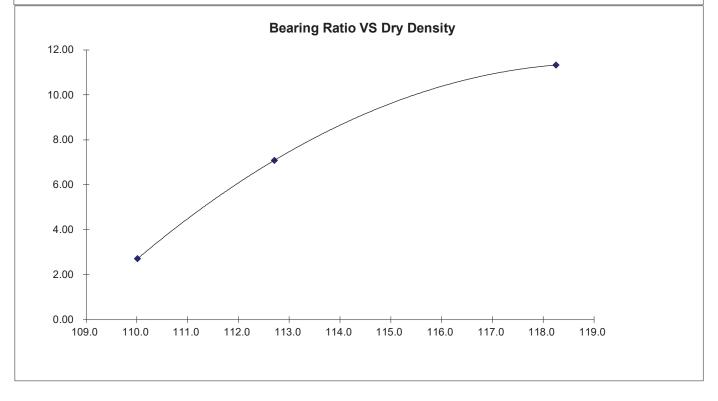



LABORATORY TEST RESULTS

STERLING RANCH, FILING NO. 5 CLASSIC COMMUNITIES JOB NO. 240368



APPENDIX C: Pavement Design Calculations



FLEXIBLE PAVEMENT DESIGN

PROJECT DATA

Project Location: Sterling Ranch, Filing No. 5

Job Number: 240368

DESIGN DATA

Equivalent (18-kip) Single Axle Load Applications (ESAL): ESAL (W_{18}) = 292,000 Design CBR CBR =8.7 **Standard Deviation** $S_0 =$ 0.45 Loss in Serviceability $\Delta psi =$ 2.5 Reliability Reliability = 80 Reliability (z-statistic) -0.84 $Z_R =$ Soil Resilient Modulus $M_R =$ 13,050

Required Structural Number (SN):

SN = 2.08

DESIGN EQUATIONS

Resilient Modulus

If using CBR: If using R-Value:

 $M_R = (CBR) \times 1,500$ $M_R = 10^{[(S_1 + 18.72)/6.24]} \text{ where } S_1 = [(R-value - 5)/11.29] + 3$

Required Structural Number

$$\log_{10}W_{18} = Z_{R}^{*} S_{O} + 9.36^{*} \log_{10}(SN+1) - 0.20 + \frac{\log_{10}\left[\frac{\Delta PSI}{4.2 - 1.5}\right]}{0.40 + \frac{1094}{(SN+1)^{5.19}}} + 2.32^{*} \log_{10}M_{R} - 8.07$$

Pavement Section Thickness

 $SN^* = C_1D_1 + C_2D_2$ where: $C_1 = Strength Coefficient - HMA$

 C_2 = Strength Coefficient - ABC/RCB

 D_1 = Depth of HMA (inches)

 D_2 = Depth of ABC/RCB (inches)

RECOMMENED THICKNESSES

Layer	Material	Structural Layer	Thickne	ess (D*i)	SN* _i	SN
1	HMA	$C_1 = 0.44$	3.0	inches	1.320	
2	ABC/RCB	$C_2 = 0.11$	8.0	inches	0.880	_
				SN* =	2 200	2.08

SN* = 2.200 2.08

Pavement SN > Required SN, Design is Acceptable



FLEXIBLE PAVEMENT DESIGN

PROJECT DATA

Project Location: Sterling Ranch, Filing No. 5

Job Number: 240368

DESIGN DATA

Equivalent (18-kip) Single Axle Load Applications (ESAL): ESAL (W_{18}) = 292,000 Design CBR CBR =8.7 **Standard Deviation** $S_0 =$ 0.45 Loss in Serviceability $\Delta psi =$ 2.5 Reliability Reliability = 80 Reliability (z-statistic) -0.84 $Z_R =$ Soil Resilient Modulus $M_R =$ 13,050

Required Structural Number (SN):

SN = 2.08

DESIGN EQUATIONS

Resilient Modulus

If using CBR: If using R-Value:

 $M_R = (CBR) \times 1,500$ $M_R = 10^{[(S_1 + 18.72)/6.24]} \text{ where } S_1 = [(R-value - 5)/11.29] + 3$

Required Structural Number

$$\log_{10}W_{18} = Z_{R}^{*}S_{O} + 9.36^{*}\log_{10}(SN+1) - 0.20 + \frac{\log_{10}\left[\frac{\Delta PSI}{4.2 - 1.5}\right]}{0.40 + \frac{1094}{(SN+1)^{5.19}}} + 2.32^{*}\log_{10}M_{R}^{-}8.07$$

Pavement Section Thickness

 $SN^* = C_1D_1 + C_2D_2$ where: $C_1 = Strength Coefficient - HMA$

 C_2 = Strength Coefficient - CTS D_1 = Depth of HMA (inches) D_2 = Depth of CTS (inches)

RECOMMENED THICKNESSES

Layer	Material	Structural Layer	Thickne	ess (D*i)	SN* _i	SN
1	HMA	$C_1 = 0.44$	3.0	inches	1.320	
2	CTS	$C_2 = 0.11$	8.0	inches	0.880	ı
				SN* =	2 200	2.08

Pavement SN > Required SN, Design is Acceptable