
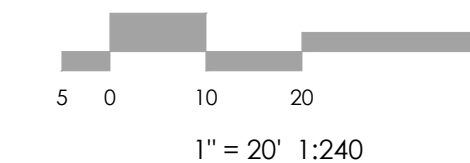


VICINITY MAP  
NOT TO SCALE

BENCHMARK

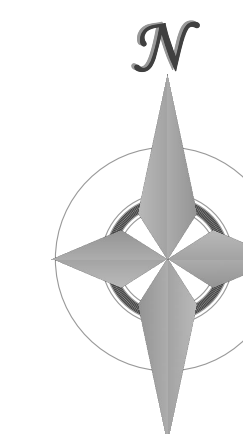

**MVE, INC.**  
ENGINEERS & SURVEYORS

1903 Leary Street, Suite 200 Colorado Springs, CO 80909 719.635.5736

REVISIONS


DESIGNED BY \_\_\_\_\_  
DRAWN BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_  
AS-BUILTS BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_

ROCKY MOUNTAIN CALVARY  
CHAPEL - ELLICOTT

**GRADING & EROSION  
CONTROL PLAN  
GRADING PLAN**





**C1.2** MVE PROJECT 61182  
MVE DRAWING GEC-GP

**FEBRUARY 19, 2025**  
SHEET 2 OF 5

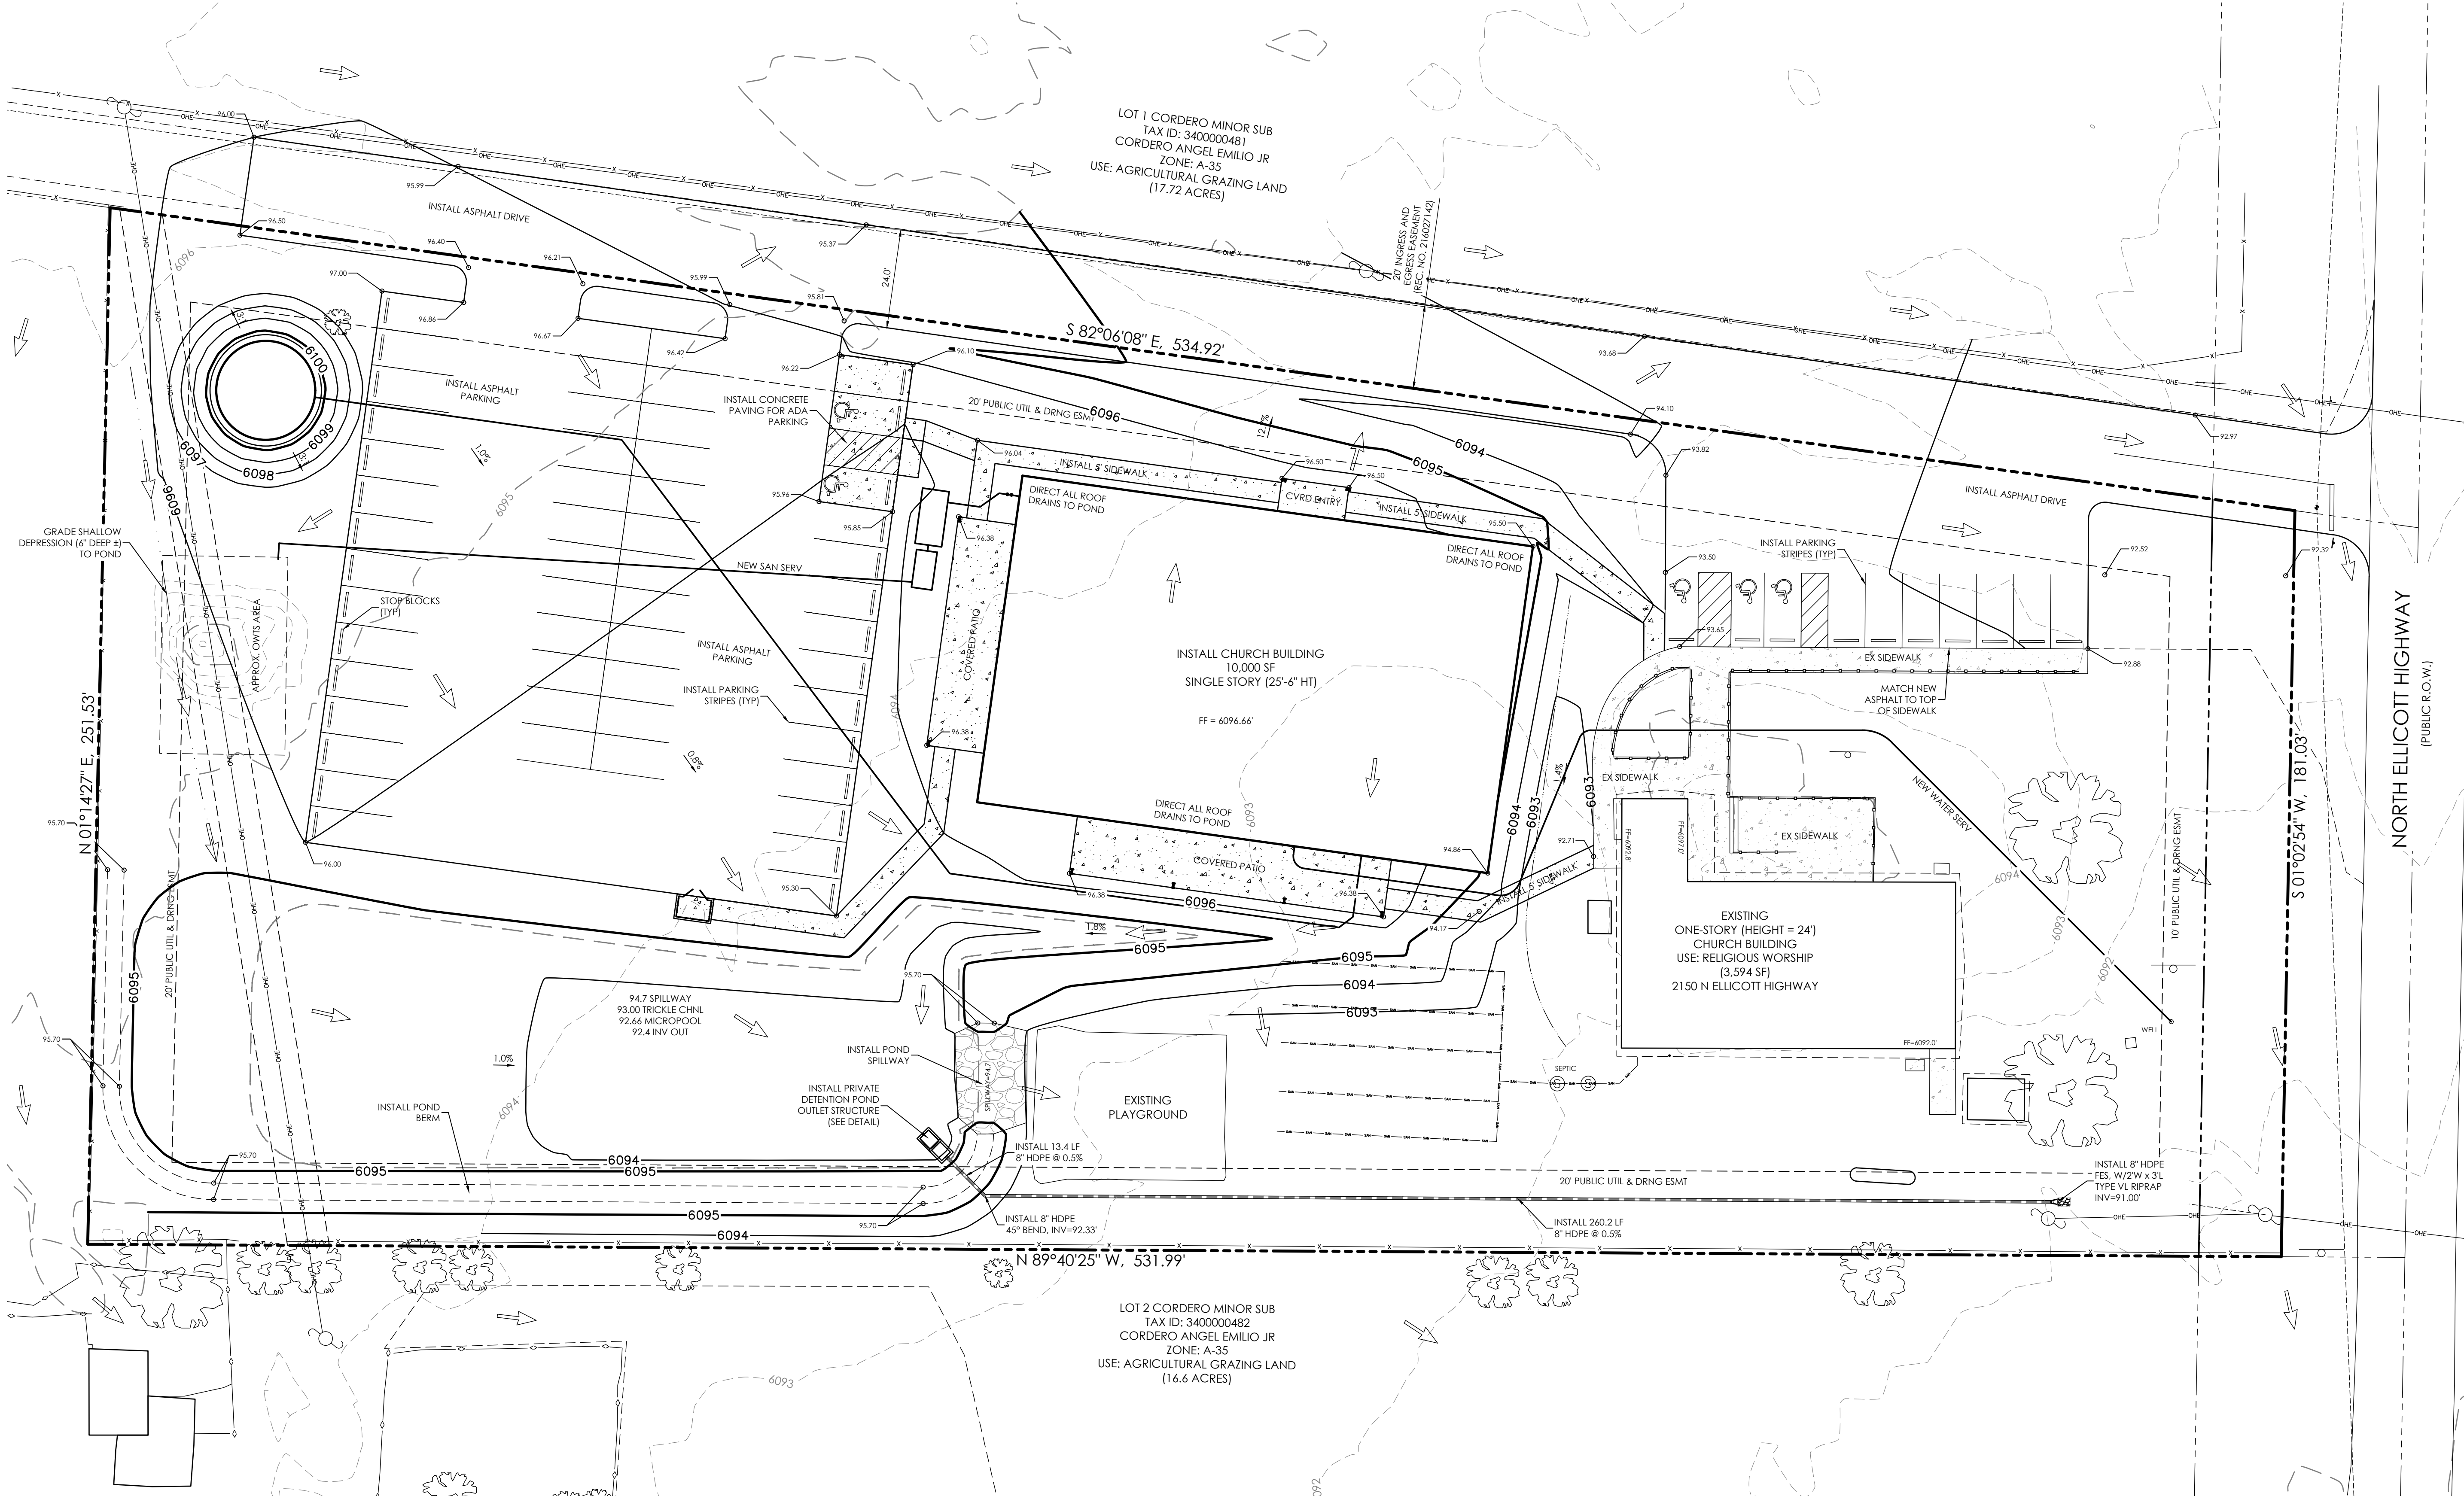

**MAP NOTES**





- BOUNDARY BEARINGS AND DISTANCES SHOWN ON THIS MAP ARE RELATIVE TO THE NORTH PROPERTY LINE BEARING S 82°06'08\"/>

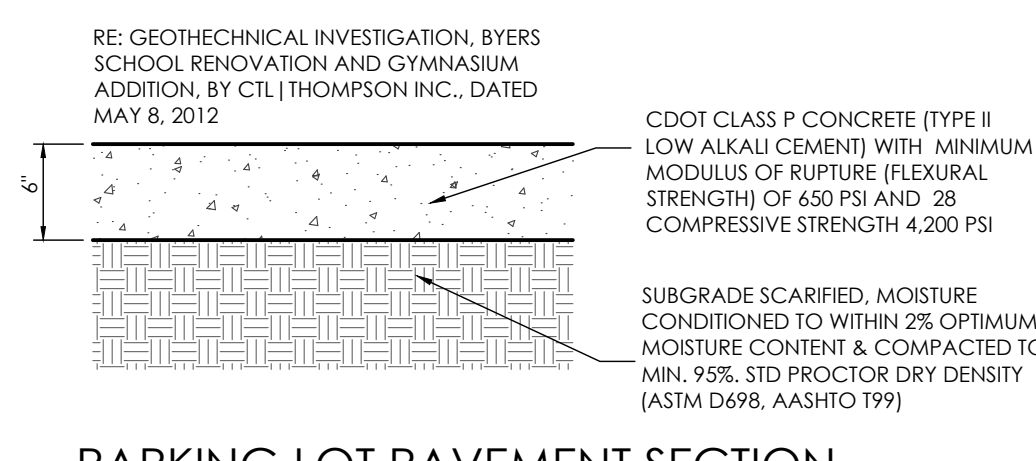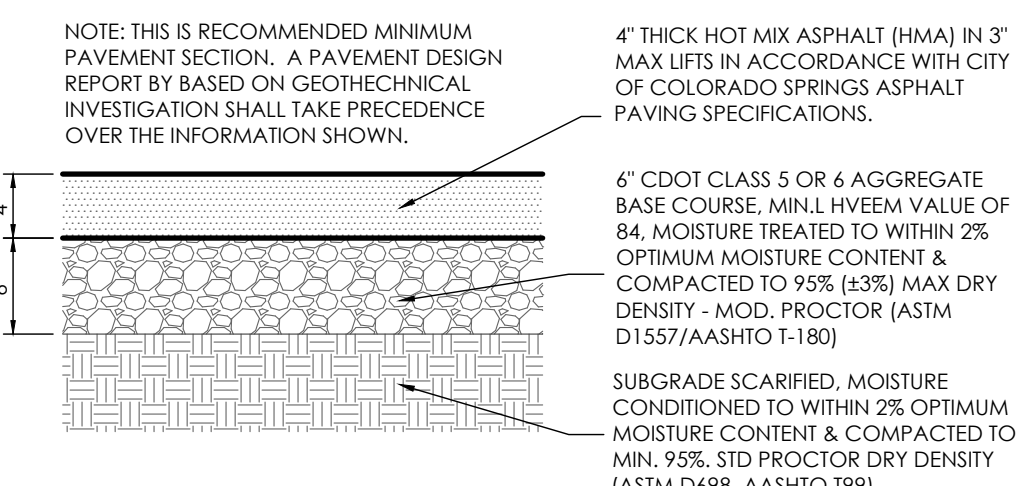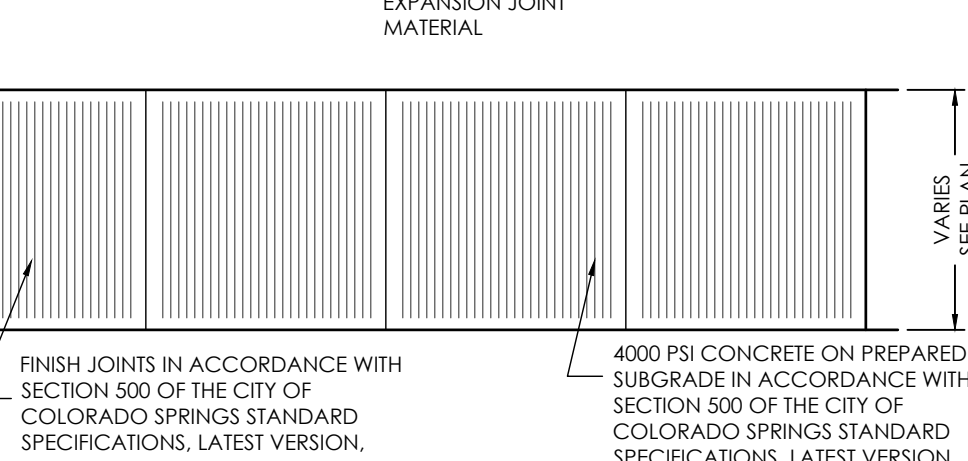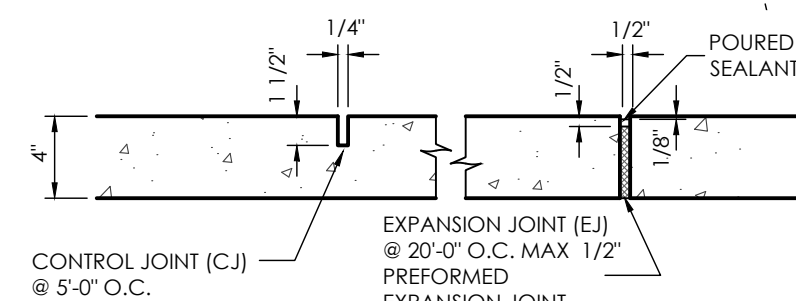

TYPICAL SIDEWALK DETAIL  
SCALE 1" = 4'









PARKING LOT PAVEMENT SECTION  
SCALE 1" = 1.0'

PARKING LOT PAVEMENT SECTION  
(CONCRETE)  
SCALE 1" = 1.0'

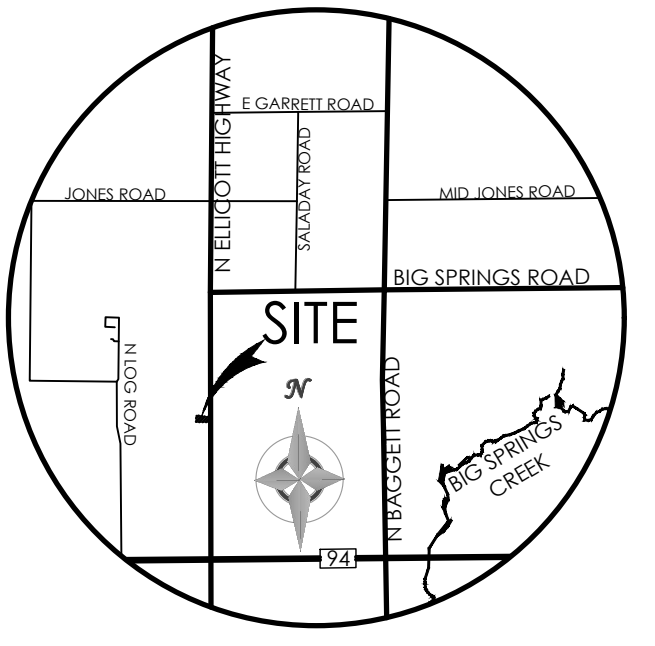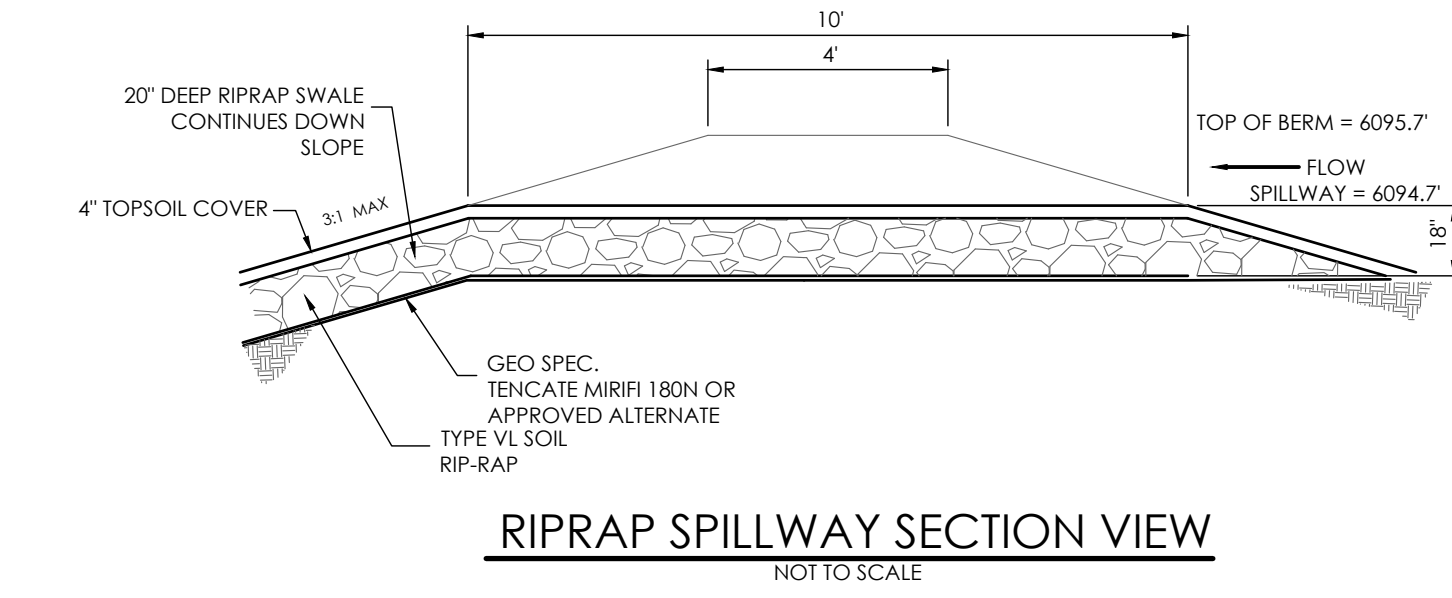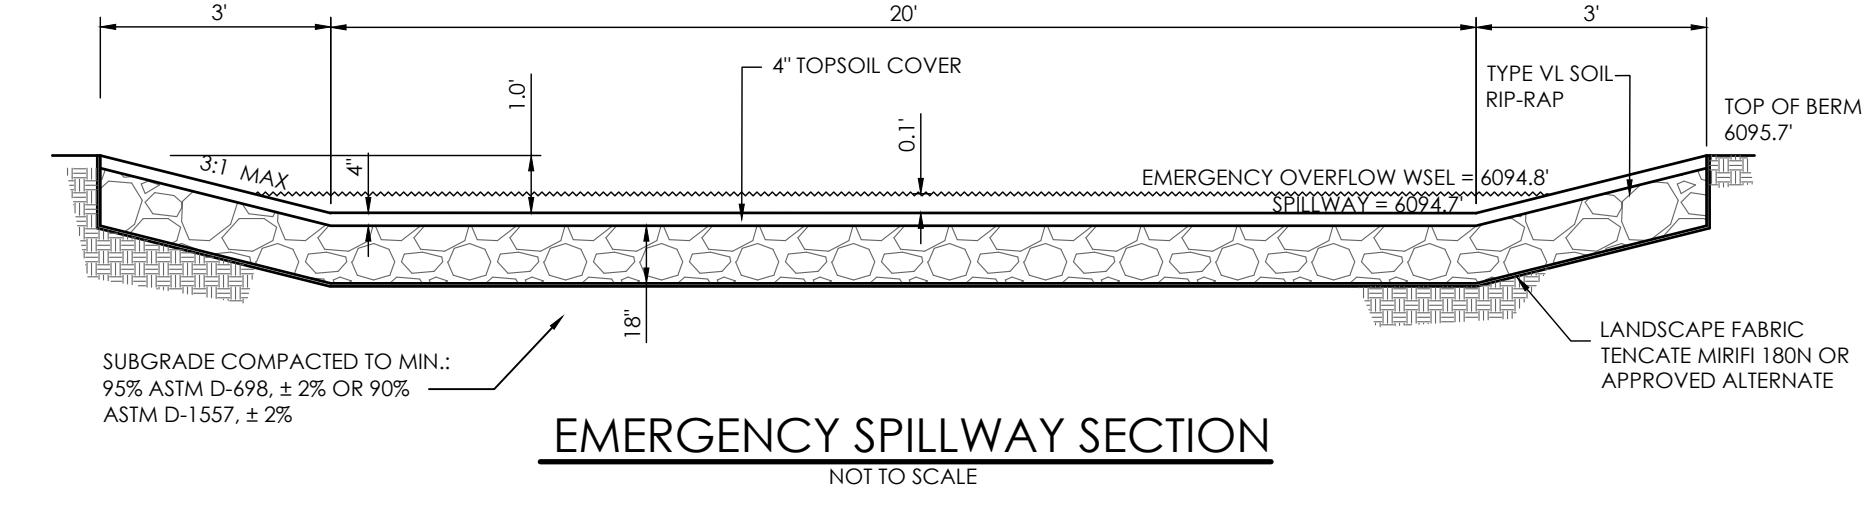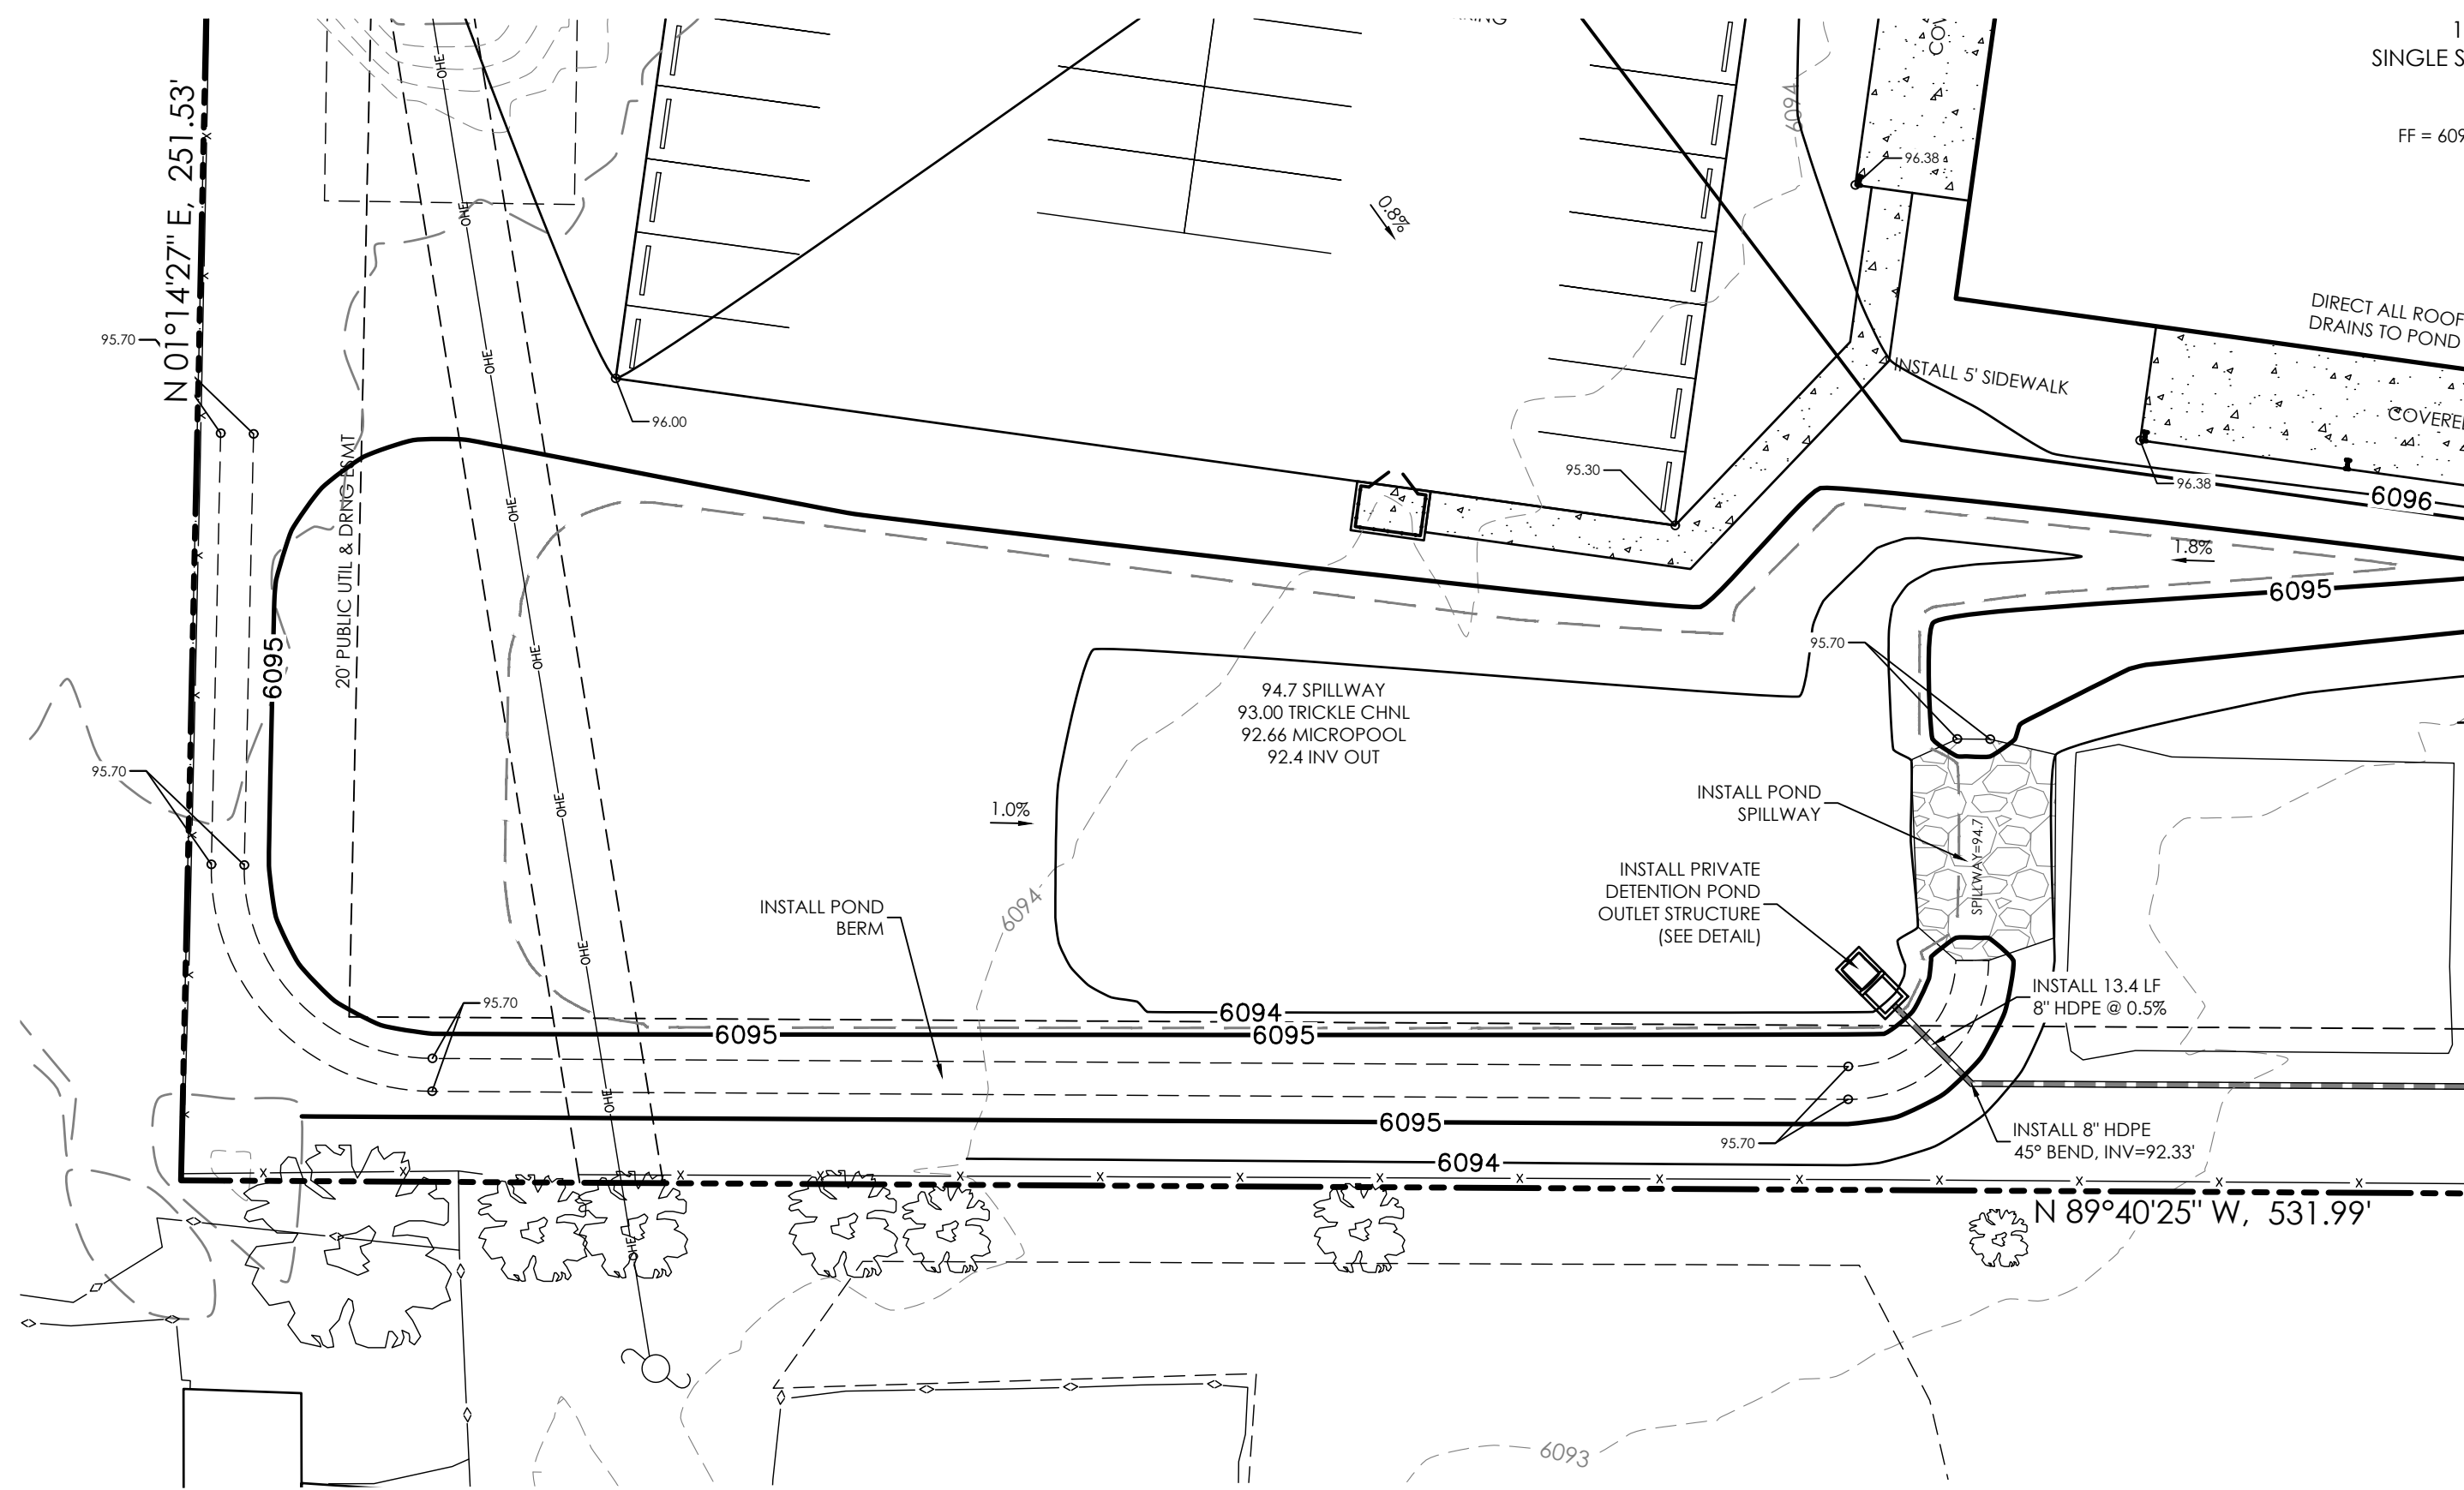

VICINITY MAP  
NOT TO SCALE

BENCHMARK

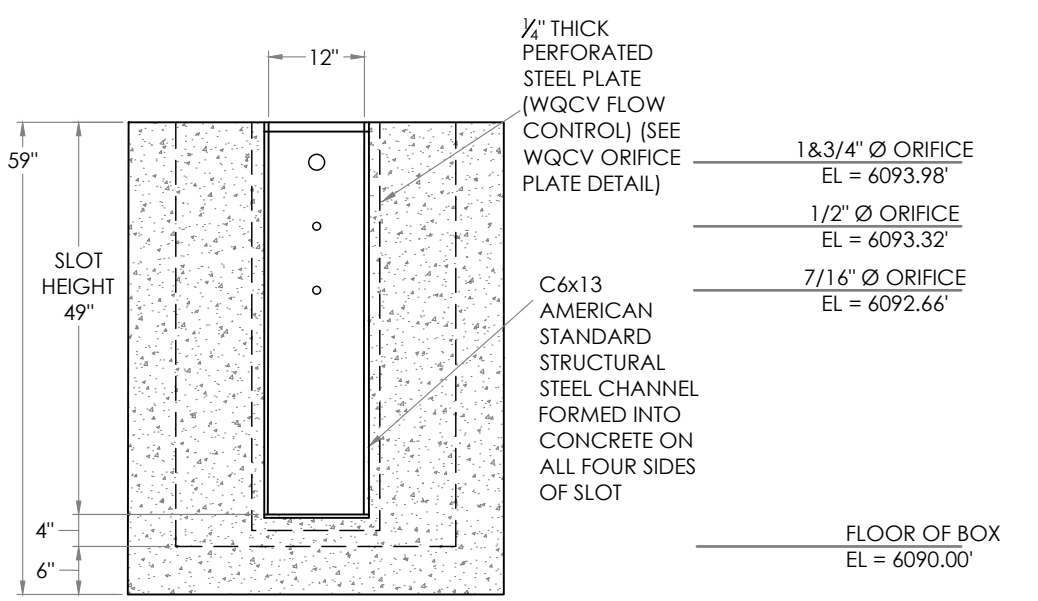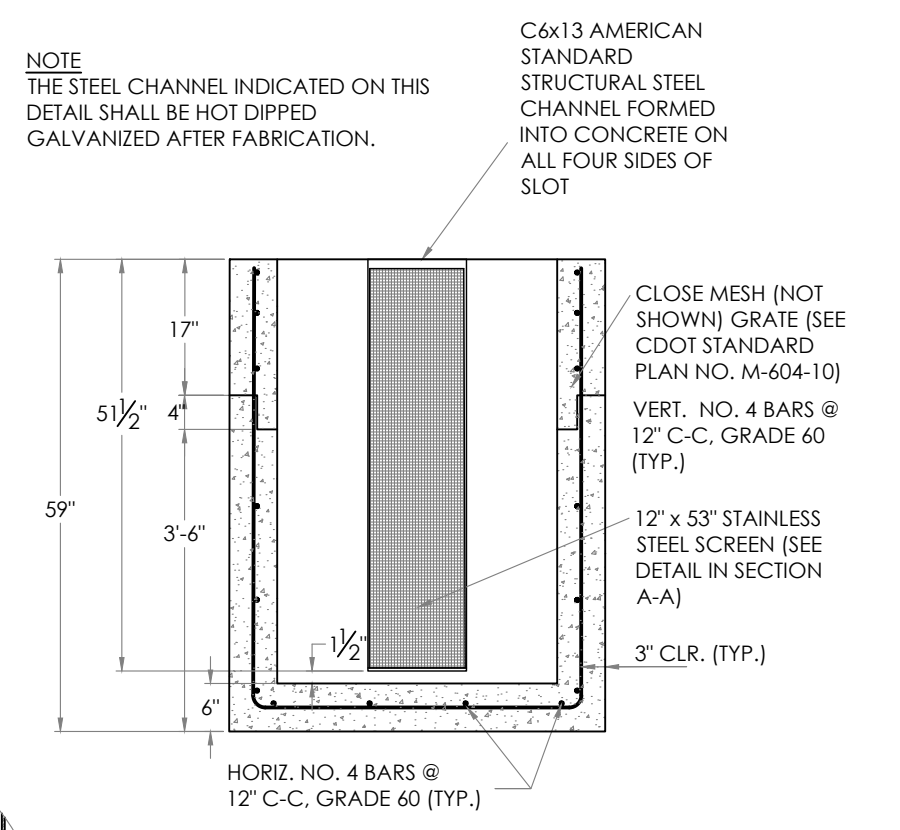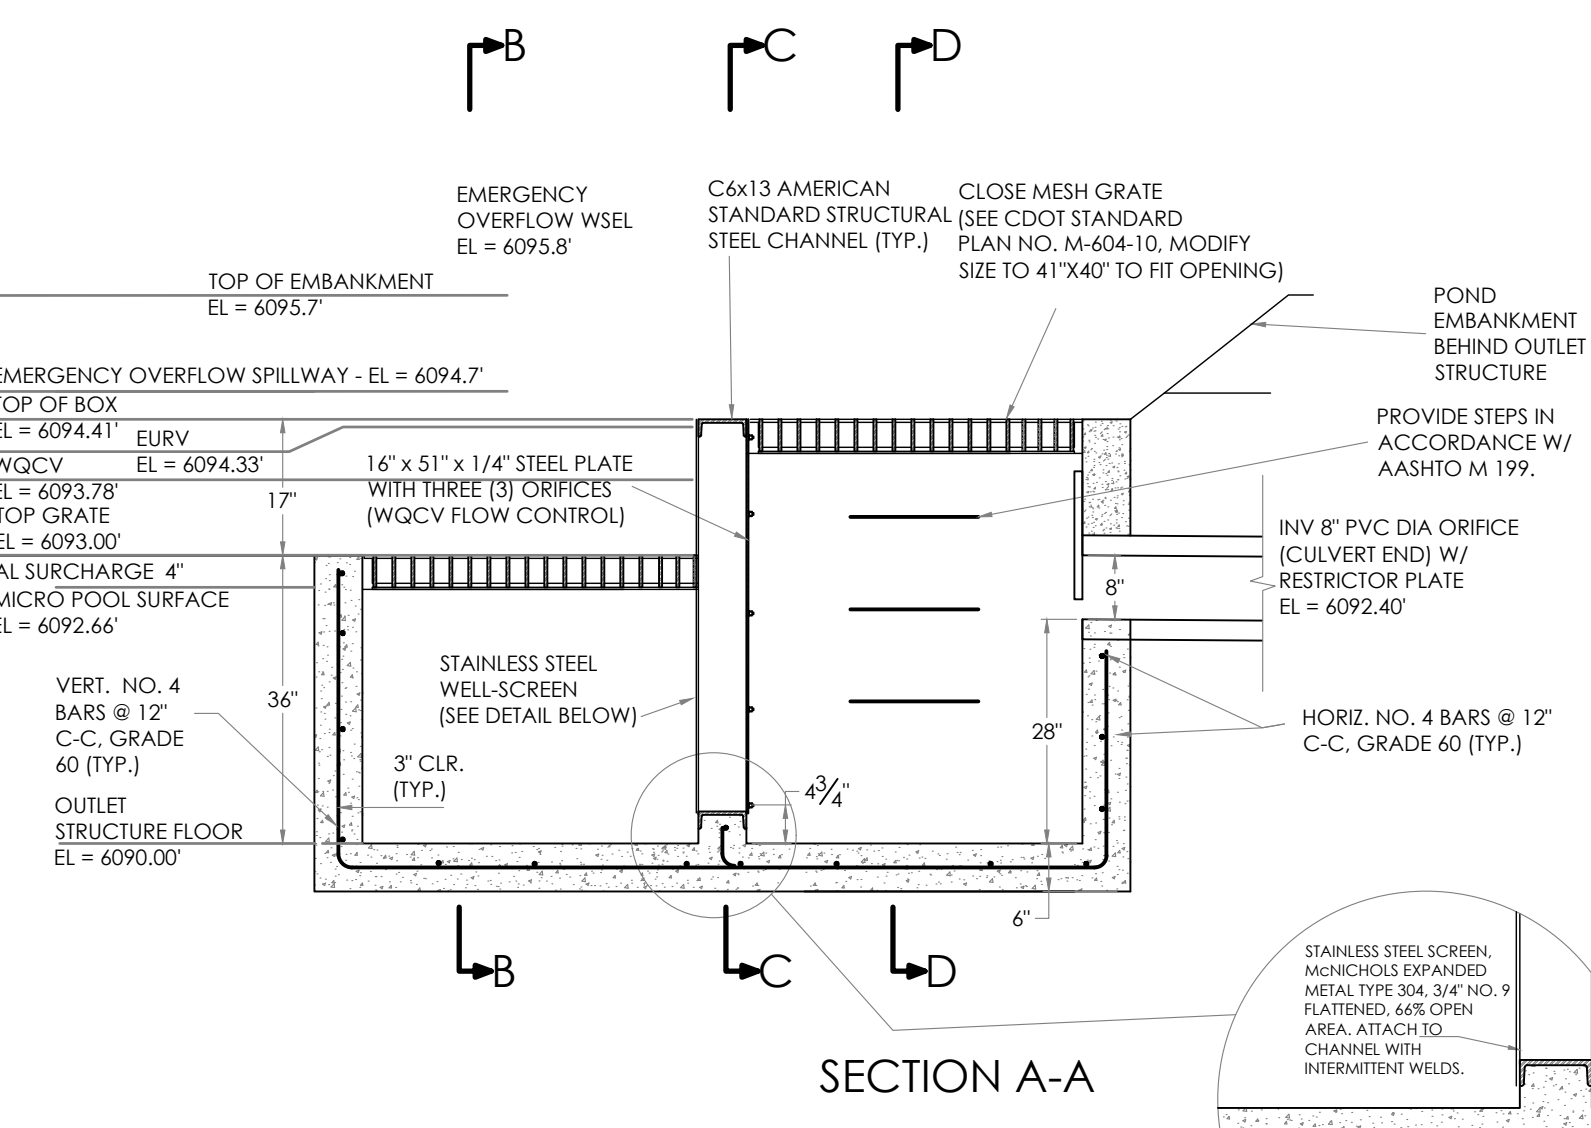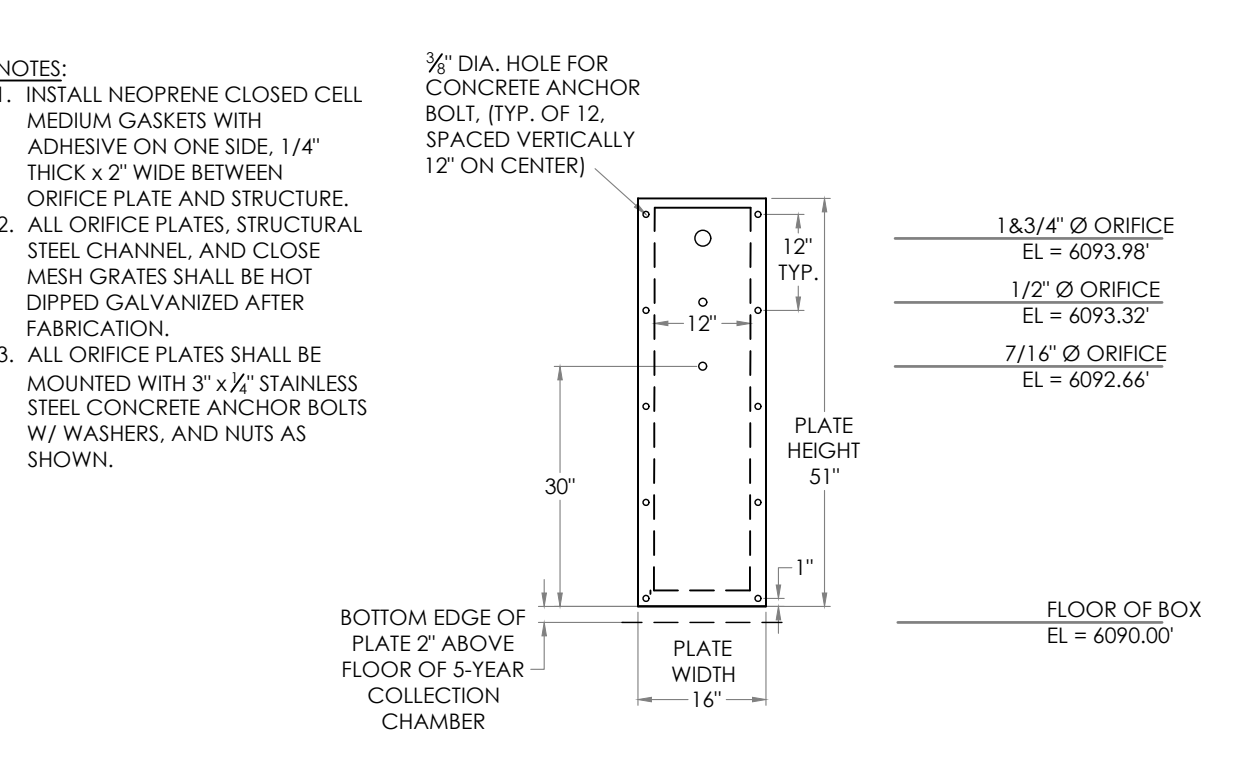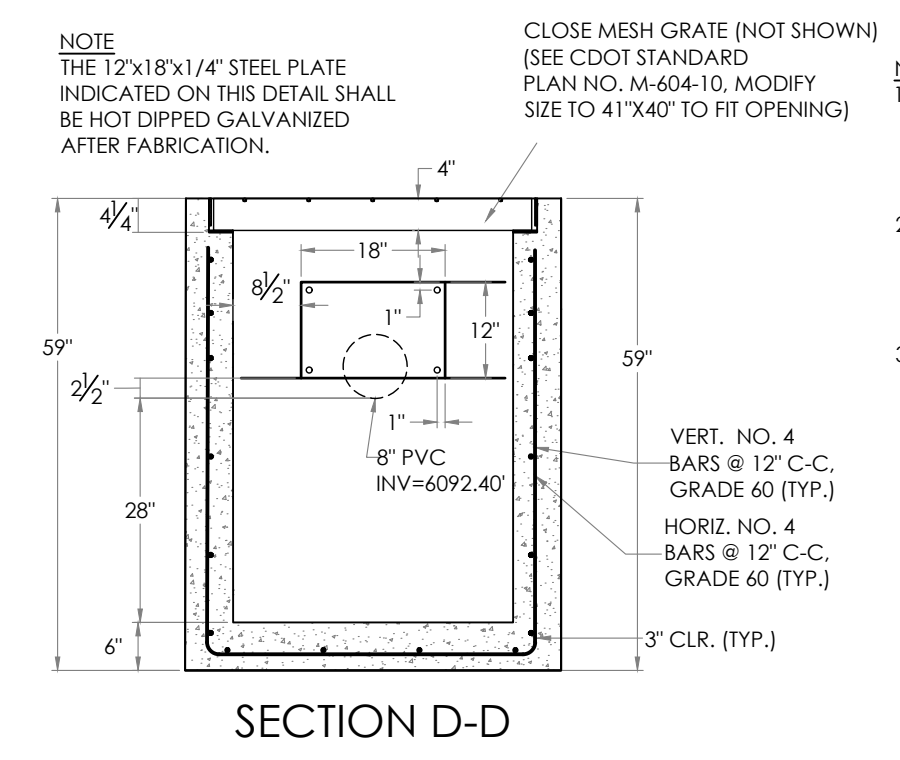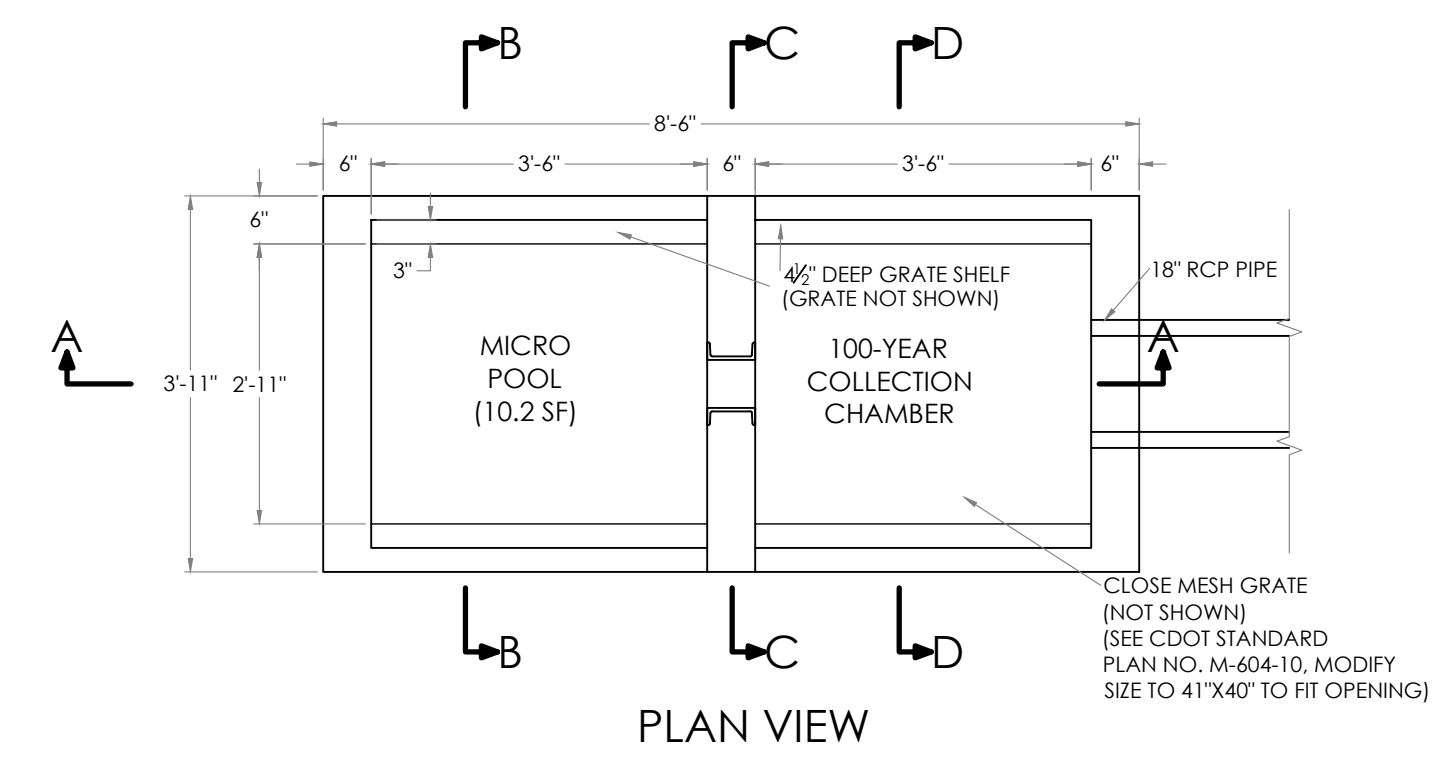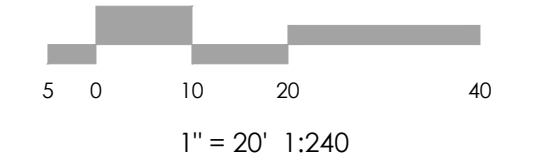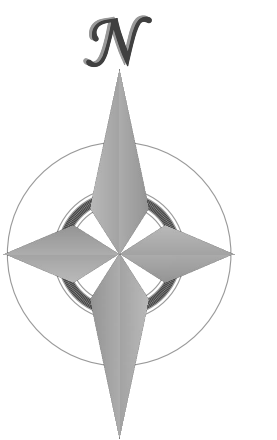

FULL SPECTRUM EXTENDED DETENTION BASIN OUTLET STRUCTURE DETAILS  
SCALE: 1" = 2'

| BASIN DATA TABLE |           |                    |
|------------------|-----------|--------------------|
|                  | ELEVATION | VOLUME @ ELEVATION |
| MICRO POOL       | 6092.66'  |                    |
| WQCV             | 6093.78'  | .023 AC/FT         |
| EURV             | 6094.33'  | 0.084 AC/FT        |
| 100-YR           | 6094.58'  | 0.127 AC/FT        |

REVISIONS


DESIGNED BY \_\_\_\_\_  
DRAWN BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_  
AS-BUILTS BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_



ROCKY MOUNTAIN CALVARY  
CHAPEL - ELLICOTT

GRADING & EROSION  
CONTROL PLAN  
POND PLAN



C1.3 MVE PROJECT 61182  
MVE DRAWING GEC-PP

FEBRUARY 19, 2025  
SHEET 3 OF 5

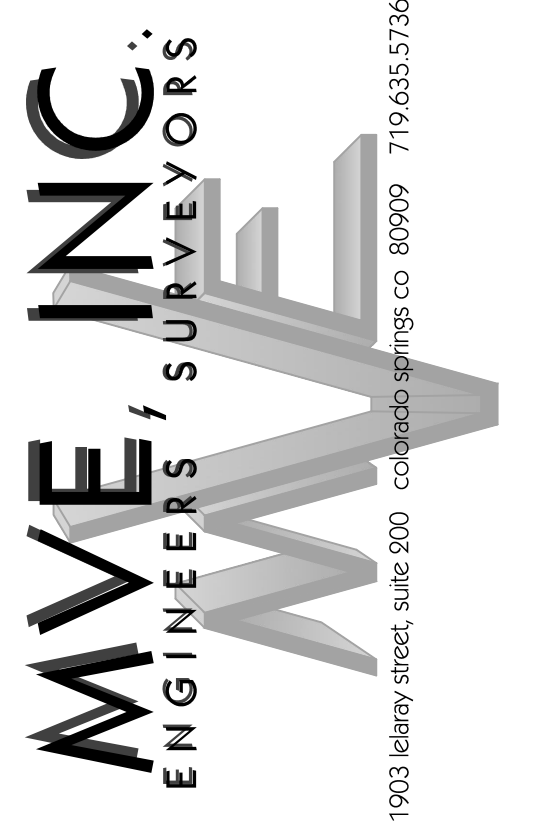

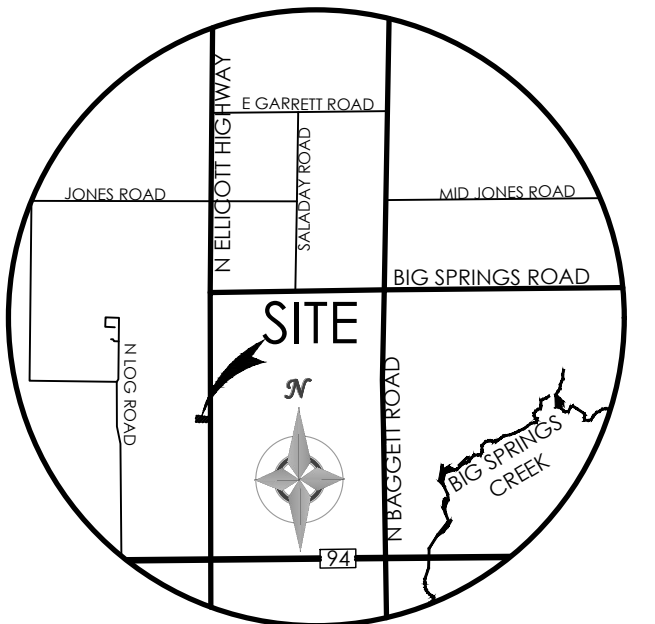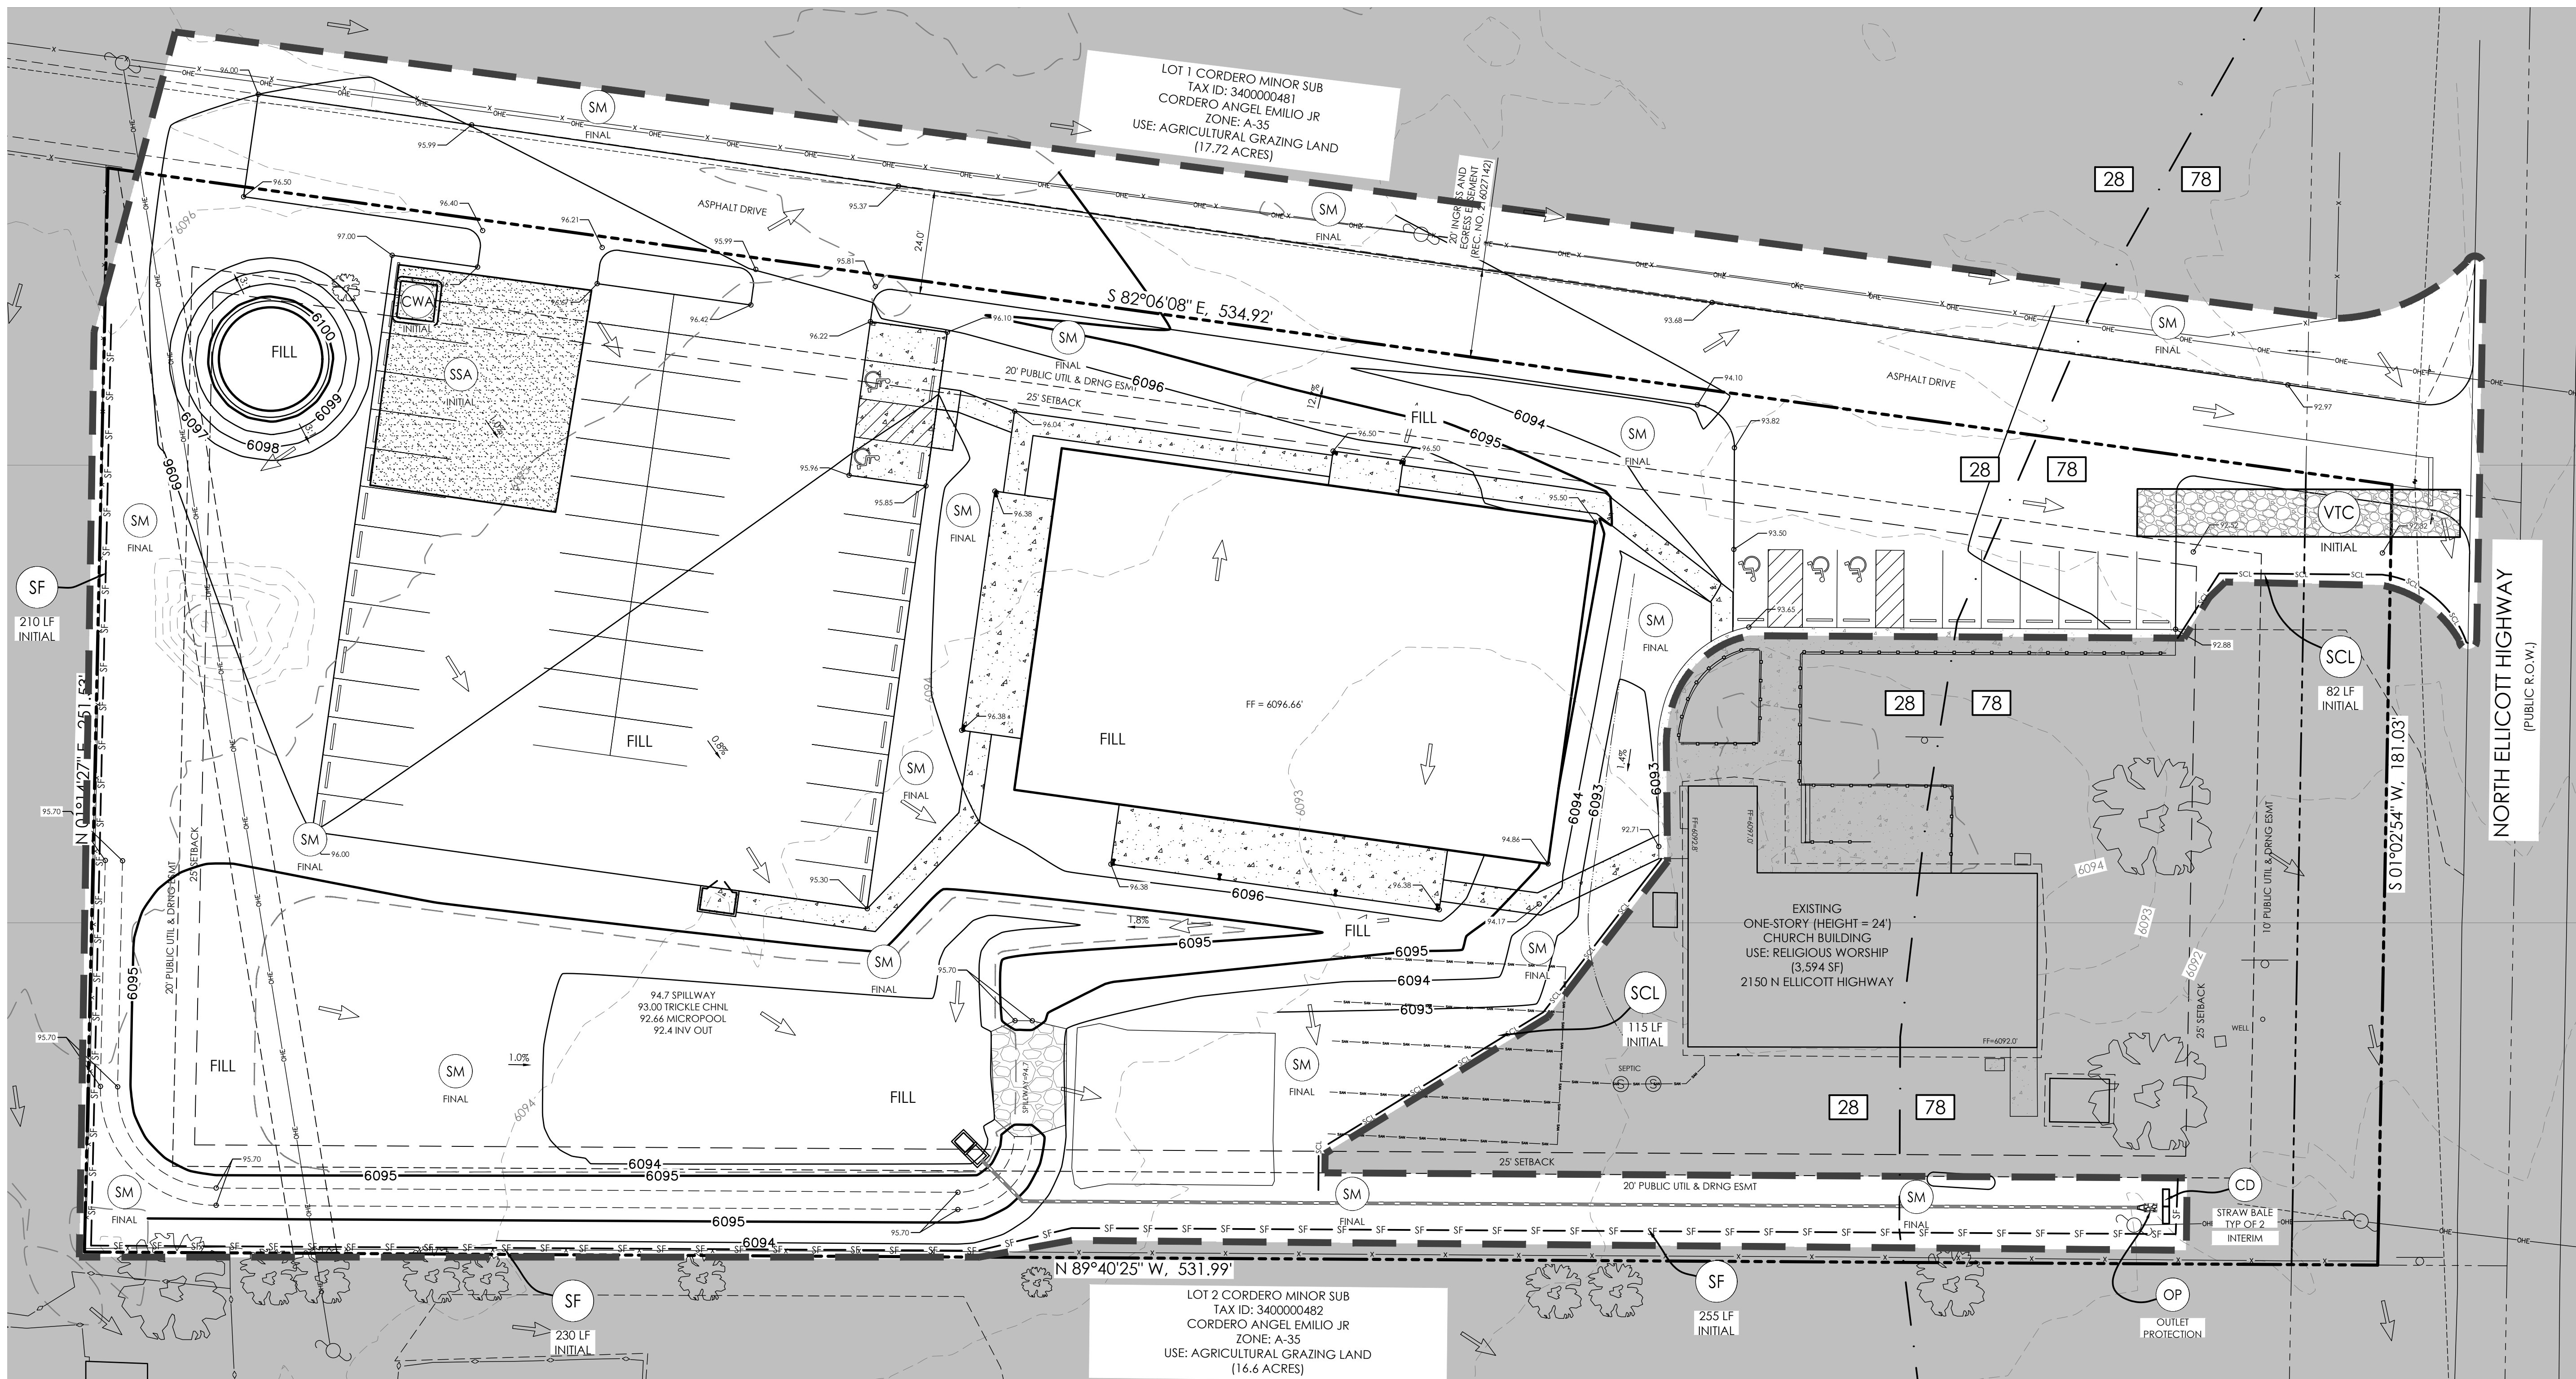

VICINITY MAP  
NOT TO SCALE

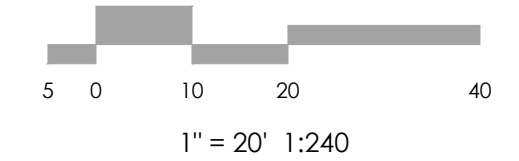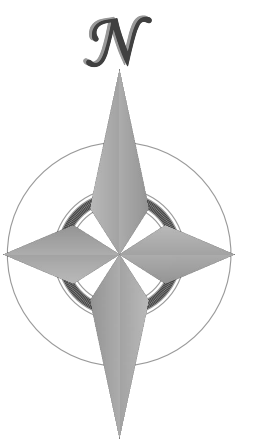

**MVE, INC.**  
ENGINEERS & SURVEYORS

1903 Library Street, Suite 200 Colorado Springs, CO 80909 719.635.5726

REVISIONS

**CM LEGEND**

| MAP SYMBOL               | KEY      | DESCRIPTION                                    |
|--------------------------|----------|--|
| <b>INITIAL CMs</b>       |          |  |
|                          | SSA      | STABILIZED STAGING AREA (Initial CM)           |
|                          | SCL      | SEDIMENT CONTROL LOG (Initial/INTERIM CM)      |
|                          | VTC      | VEHICLE TRACKING CONTROL (Initial CM)          |
|                          | CD       | CHECK DAM (Initial CM)                         |
|                          | SF       | SILT FENCE (Initial CM)                        |
|                          | TSB      | TEMPORARY SEDIMENT BASIN (INITIAL CM)          |
|                          | SSB      | STRAW BALE BARRIER (INITIAL CM)                |
|                          | CWA      | CONCRETE WASHOUT AREA (INITIAL CM)             |
| <b>INTERIM/FINAL CMs</b> |          |  |
|                          | OP       | OUTLET PROTECTION (RIP-RAP) (INTERIM/FINAL CM) |
|                          | CIP      | CULVERT INLET PROTECTION (INTERIM CM)          |
|                          | SM       | SEEDING & MULCHING (FINAL CM)                  |
|                          | 1.50%    | SLOPE DIRECTION AND GRADE                      |
|                          | CUT/FILL | CUT/FILL BOUNDARY                              |
|                          |          | DRAINAGE FLOW ARROW                            |
|                          |          | LIMITS OF DISTURBANCE/ LIMITS OF CONSTRUCTION  |
|                          |          | LIMITS OF DISTURBANCE LINE                     |
|                          |          | SOILTYPE BOUNDARY                              |

**OTHER DATA**

**LAT/LONG COORDS:** 38°51'40.82" / 104°23'18.46"

**VEGETATION:**  
EXISTING: NATIVE PRAIRIE GRASSES & WEEDS,  
PROPOSED: RESEEDING DISTURBED AREAS

**BATCH PLANTS:** NONE

**DEWATERING:** NONE

**DISTURBED AREA:** 2.5± ACRES

**RECEIVING WATERS:** BLACK SQUIRREL CREEK

**SCHEDULE:** SUMMER 2025 - FALL 2025  
FINAL STABILIZATION SPRING 2026

| HYDROLOGIC SOIL GROUP |  |
|-----------------------|--|
| MAP UNIT NUMBER       | DESCRIPTION                                |
| 28                    | ELLICOTT LOAMY COARSE SAND, 0 TO 5% SLOPES |
| 78                    | SAMPSON LOAM, 0 TO 3% SLOPES               |

**SOIL DATA**

| PRIMARY SOIL DESCRIPTION | ELLICOTT LOAMY COARSE SAND, 0 TO 5% SLOPES | PRIMARY SOIL DESCRIPTION | SAMPSON LOAM, 0 TO 3% SLOPES |
|--------------------------|--|--------------------------|------------------------------|
| PERMEABILITY             | RAPID                                      | PERMEABILITY             | MODERATE                     |
| SURFACE RUNOFF           | SLOW                                       | SURFACE RUNOFF           | SLOW                         |
| HAZARD OF EROSION        | HIGH                                       | HAZARD OF EROSION        | SLIGHT                       |
| HYDROLOGIC SOIL GROUP    | A  | HYDROLOGIC SOIL GROUP    | B                            |

SYMBOLS SHOWN IN LEGEND SHALL BE USED BY SWMP ADMINISTRATOR TO ANNOTATE ANY CHANGES AND/OR ADDITIONS TO THIS PLAN.


DESIGNED BY \_\_\_\_\_  
DRAWN BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_  
AS-BUILTS BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_

ROCKY MOUNTAIN CALVARY  
CHAPEL - ELLICOTT

**GRADING & EROSION CONTROL PLAN**  
**EROSION CONTROL**

**C1.4** MVE PROJECT 61182  
MVE DRAWING GEC-EC

**FEBRUARY 19, 2025**  
**SHEET 4 OF 5**

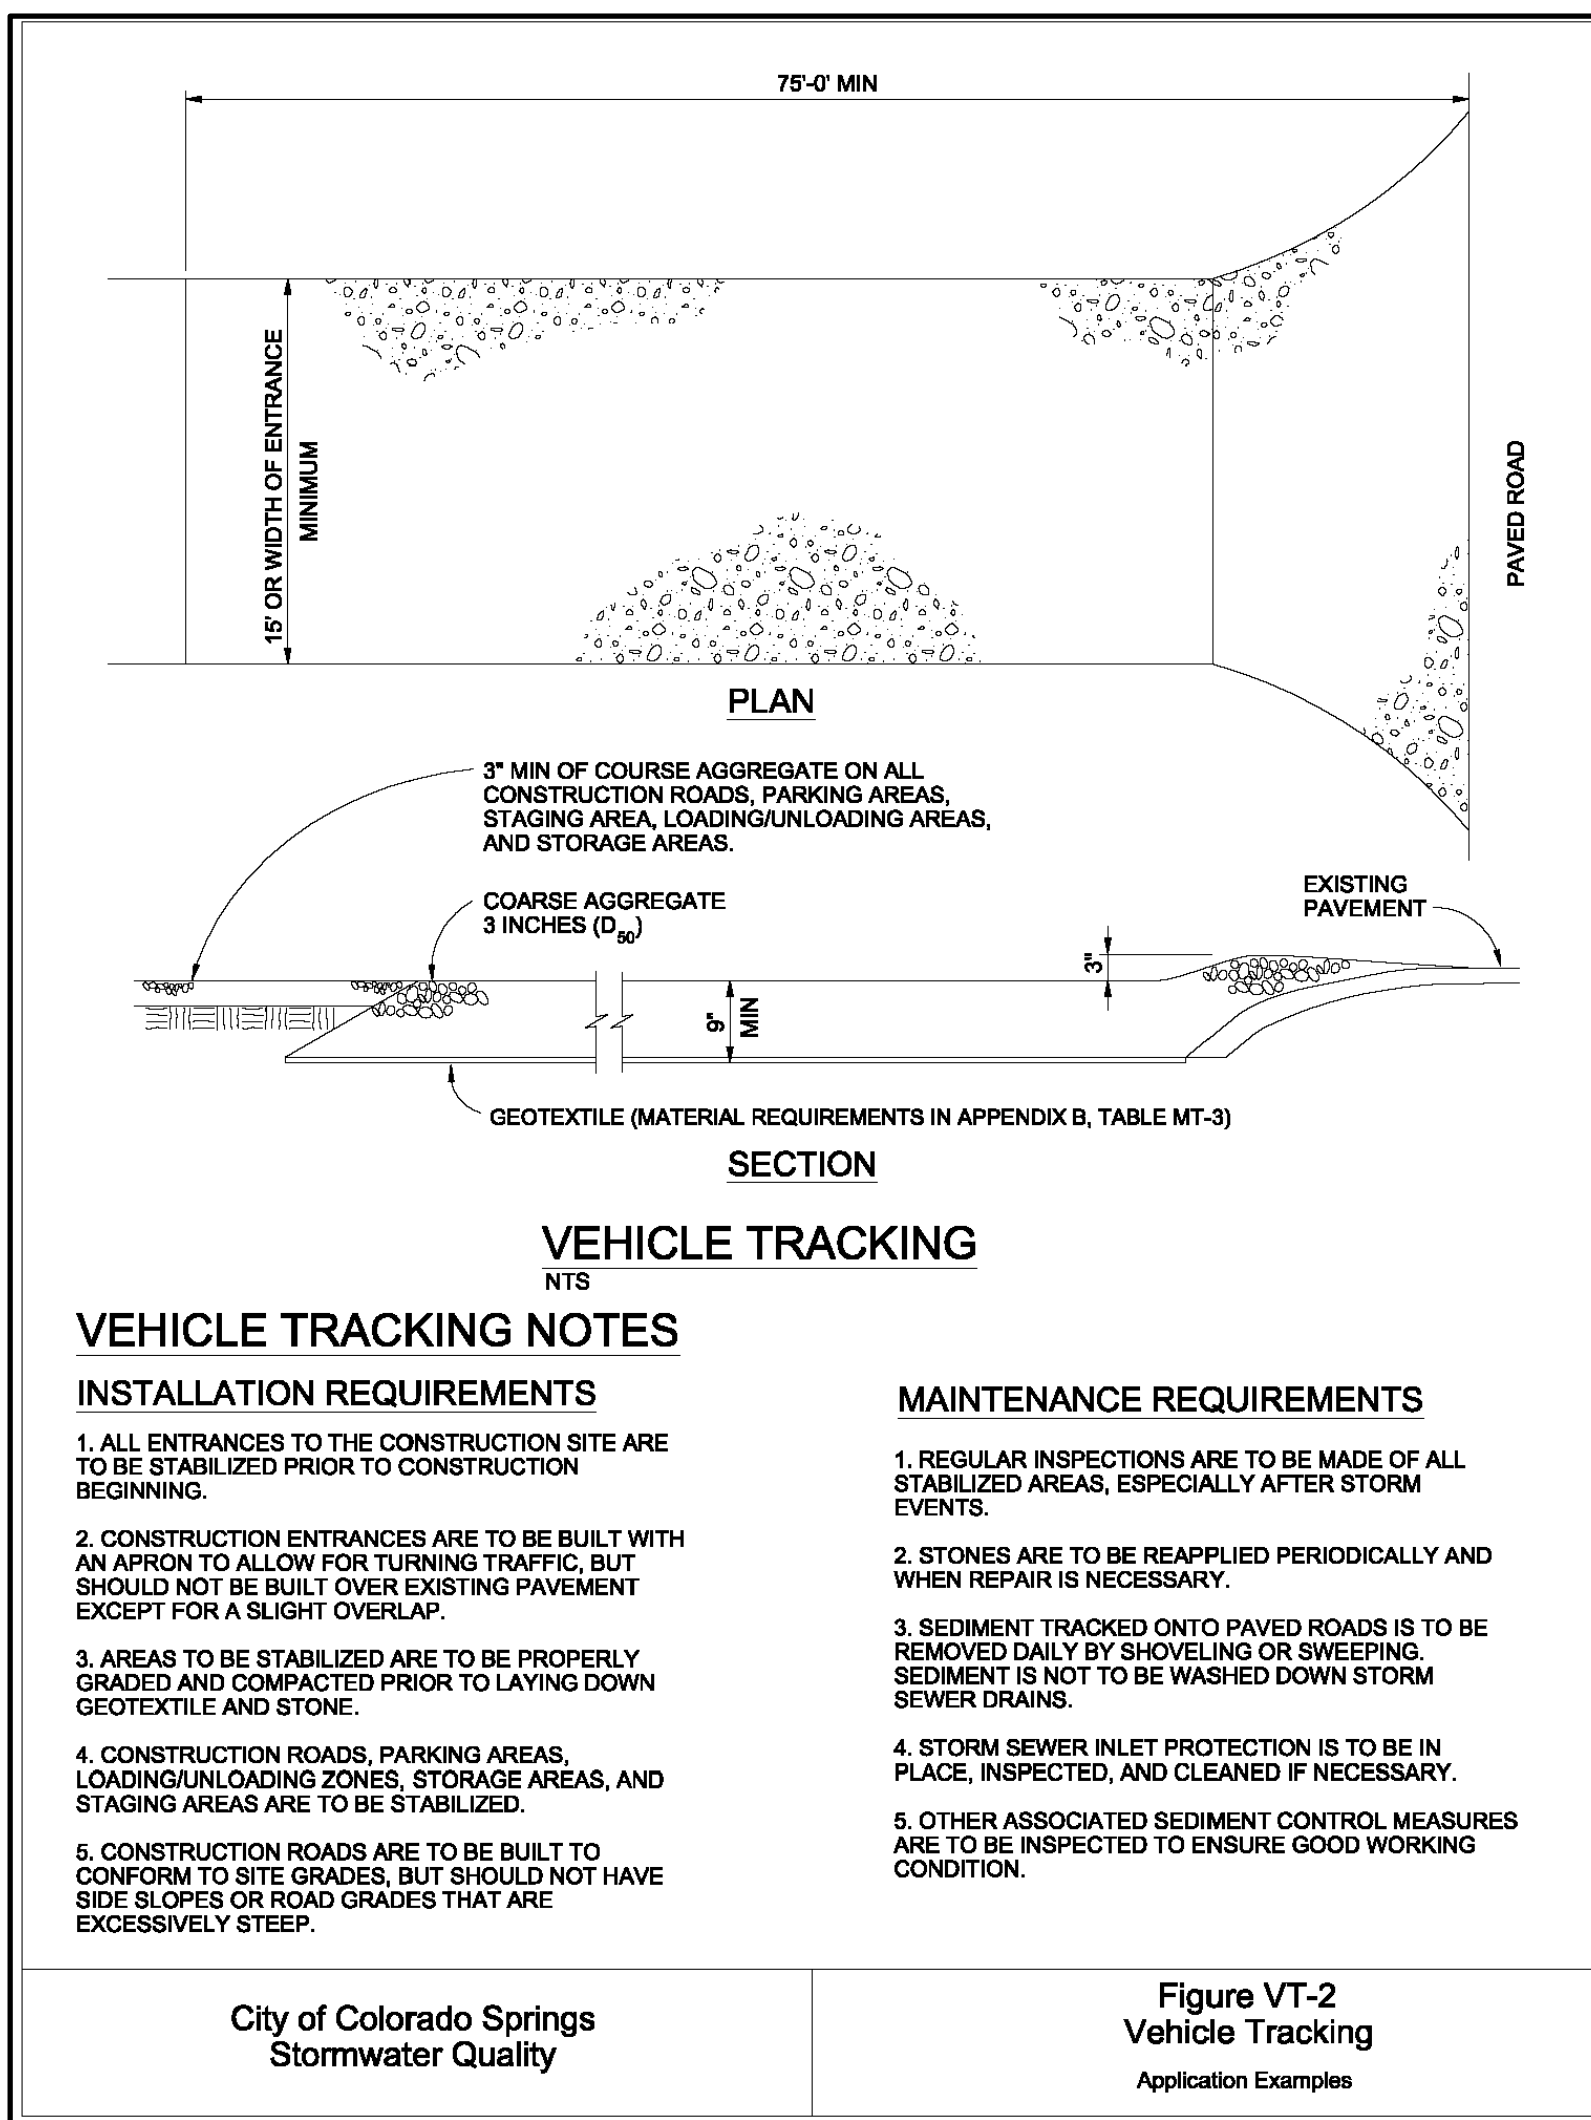

**VEHICLE TRACKING NOTES**


**INSTALLATION REQUIREMENTS**

1. ALL ENTRANCES TO THE CONSTRUCTION SITE ARE TO BE STABILIZED PRIOR TO CONSTRUCTION BEGINNING.
2. CONSTRUCTION ENTRANCES ARE TO BE BUILT WITH AN APRON TO ALLOW FOR TURNING TRAFFIC, BUT SHOULD NOT BE BUILT OVER EXISTING PAVEMENT EXCEPT FOR A SLIGHT OVERLAP.
3. AREAS TO BE STABILIZED ARE TO BE PROPERLY GRADED AND COMPACTED PRIOR TO LAYING DOWN GEOTEXTILE AND STONE.
4. CONSTRUCTION ROADS, PARKING AREAS, LOADING/UNLOADING ZONES, STORAGE AREAS, AND STAGING AREAS ARE TO BE STABILIZED.
5. CONSTRUCTION ROADS ARE TO BE BUILT TO CONFORM TO SITE GRADES, BUT SHOULD NOT HAVE SIDE SLOPES OR ROAD GRADES THAT ARE EXCESSIVELY STEEP.

**MAINTENANCE REQUIREMENTS**

1. REGULAR INSPECTIONS ARE TO BE MADE OF ALL STABILIZED AREAS, ESPECIALLY AFTER STORM EVENTS.
2. STONES ARE TO BE REAPPLIED PERIODICALLY AND WHEN REPAIR IS NECESSARY.
3. SEDIMENT TRACKED ONTO PAVED ROADS IS TO BE REMOVED DAILY BY SHOVELING OR SWEEPING. SEDIMENT IS NOT TO BE WASHED DOWN STORM SEWER DRAINS.
4. STORM SEWER INLET PROTECTION IS TO BE IN PLACE, INSPECTED, AND CLEANED IF NECESSARY.
5. OTHER ASSOCIATED SEDIMENT CONTROL MEASURES ARE TO BE INSPECTED TO ENSURE GOOD WORKING CONDITION.

City of Colorado Springs Stormwater Quality **Figure VT-2 Vehicle Tracking** Application Examples

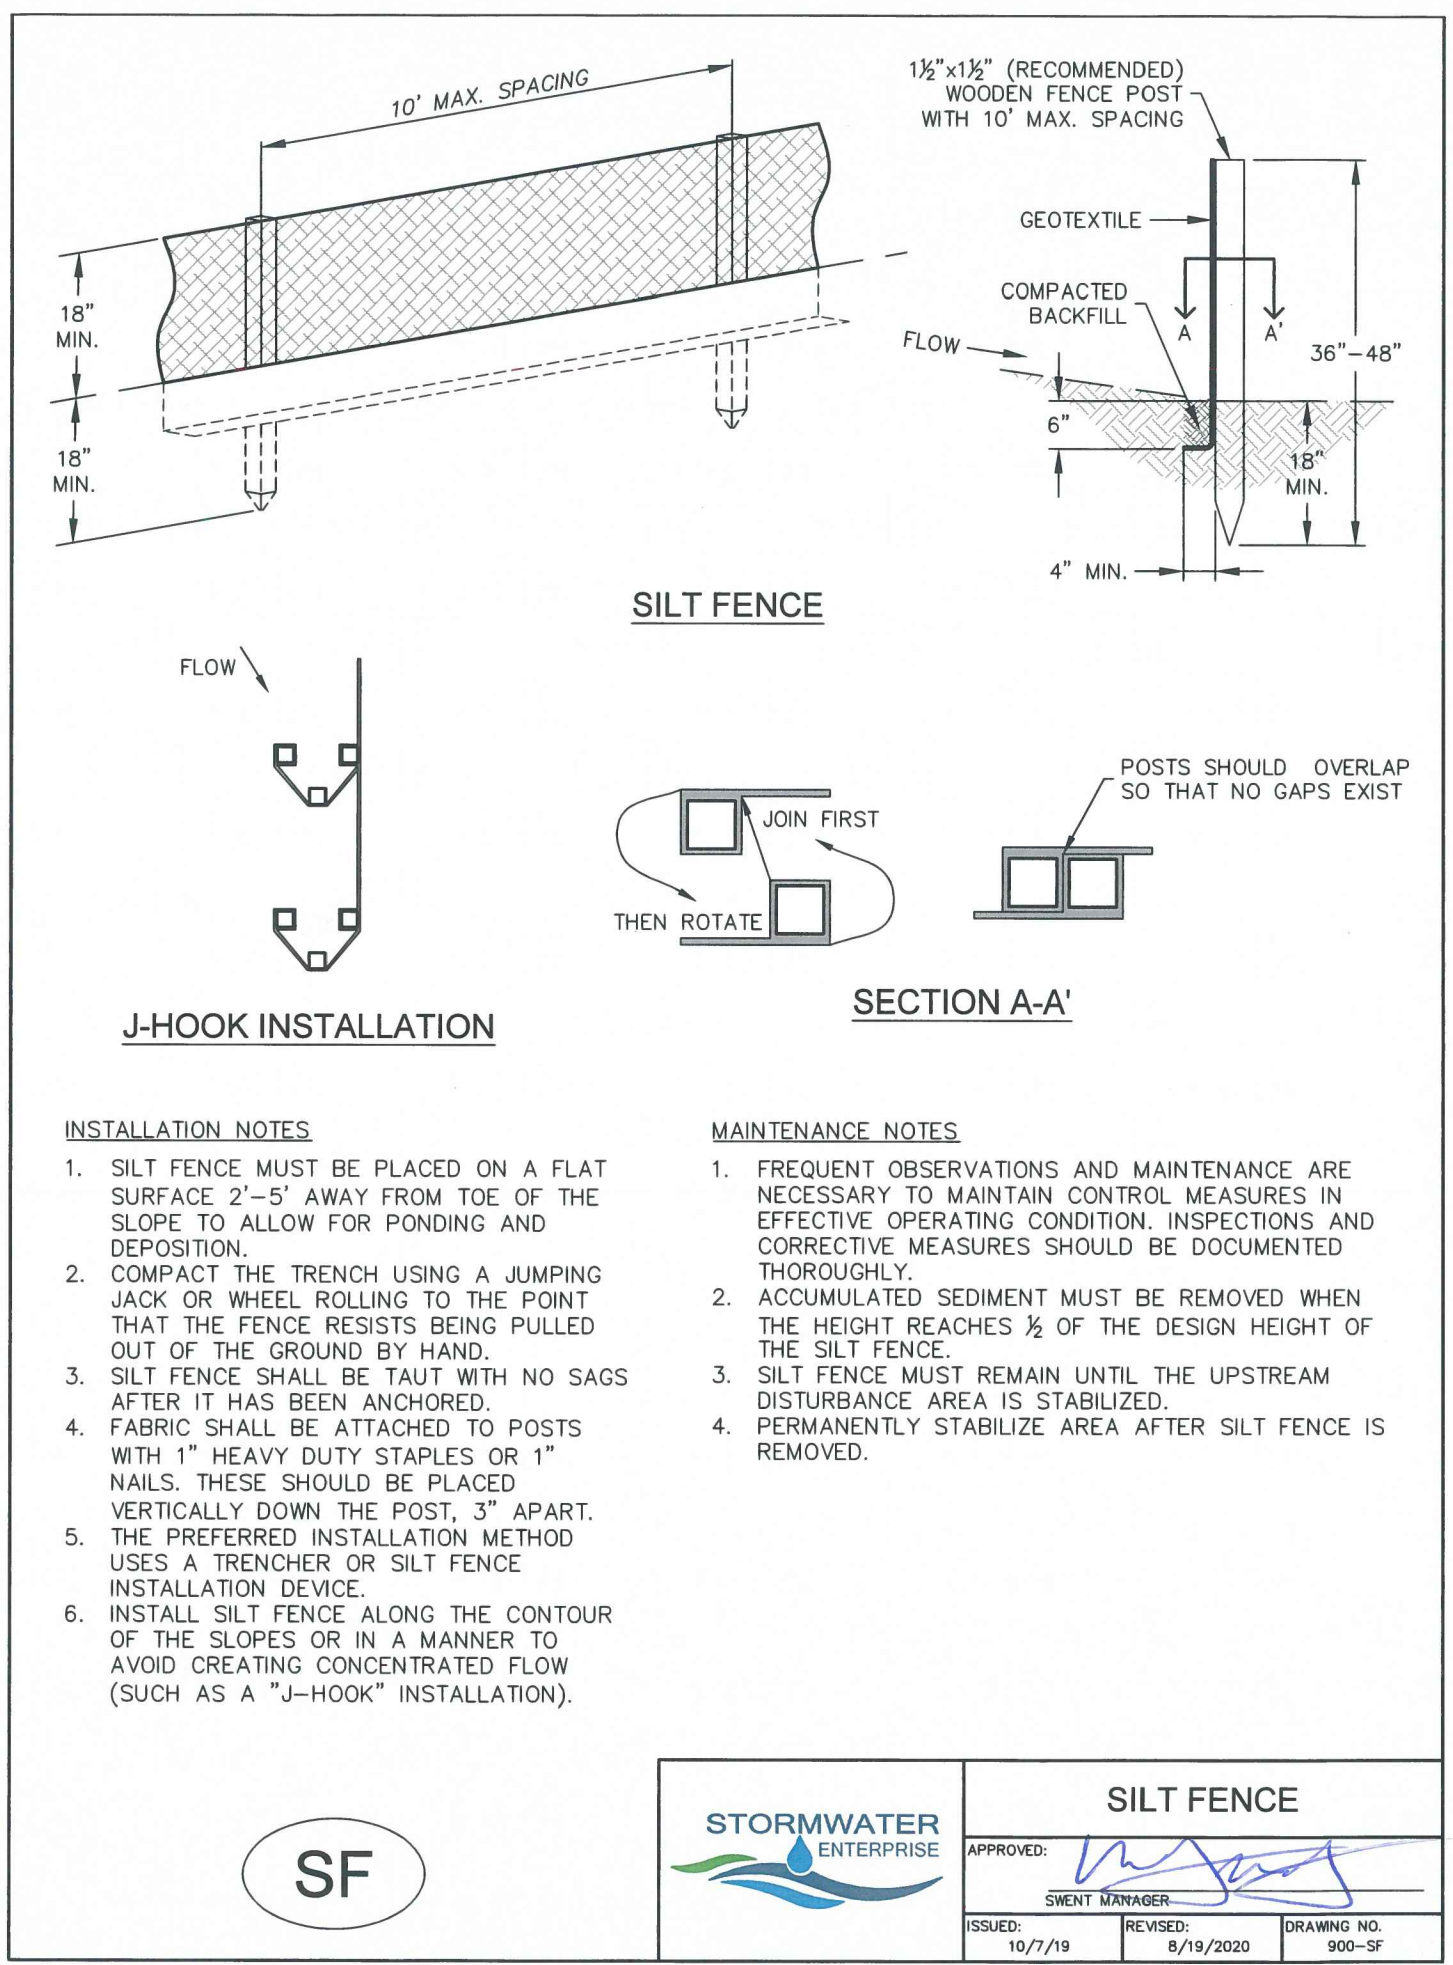


**INSTALLATION NOTES**

1. SILT FENCE MUST BE PLACED ON A FLAT SURFACE 2'-5' AWAY FROM TOE OF THE SLOPE TO ALLOW FOR PONDING AND DEPOSITION.
2. COMPACT THE TRENCH USING A JUMPING JACK OR WHEEL ROLLING TO THE POINT THAT THE FENCE RESISTS BEING PULLED OUT OF THE GROUND BY HAND.
3. SILT FENCE SHALL BE TAUT WITH NO SAGS AFTER IT HAS BEEN ANCHORED.
4. FABRIC SHALL BE ATTACHED TO POSTS WITH 1\"/>

**MAINTENANCE NOTES**

1. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN CONTROL MEASURES IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
2. ACCUMULATED SEDIMENT MUST BE REMOVED WHEN THE HEIGHT REACHES 1/2 OF THE DESIGN HEIGHT OF THE SILT FENCE.
3. SILT FENCE MUST REMAIN UNTIL THE UPSTREAM DISTURBANCE AREA IS STABILIZED.
4. PERMANENTLY STABILIZE AREA AFTER SILT FENCE IS REMOVED.

STORMWATER ENTERPRISE **SILT FENCE** APPROVED: [Signature] SHEET MANAGER: [Signature] ISSUED: 10/7/19 REVISED: 8/19/2020 DRAWING NO. 900-SF

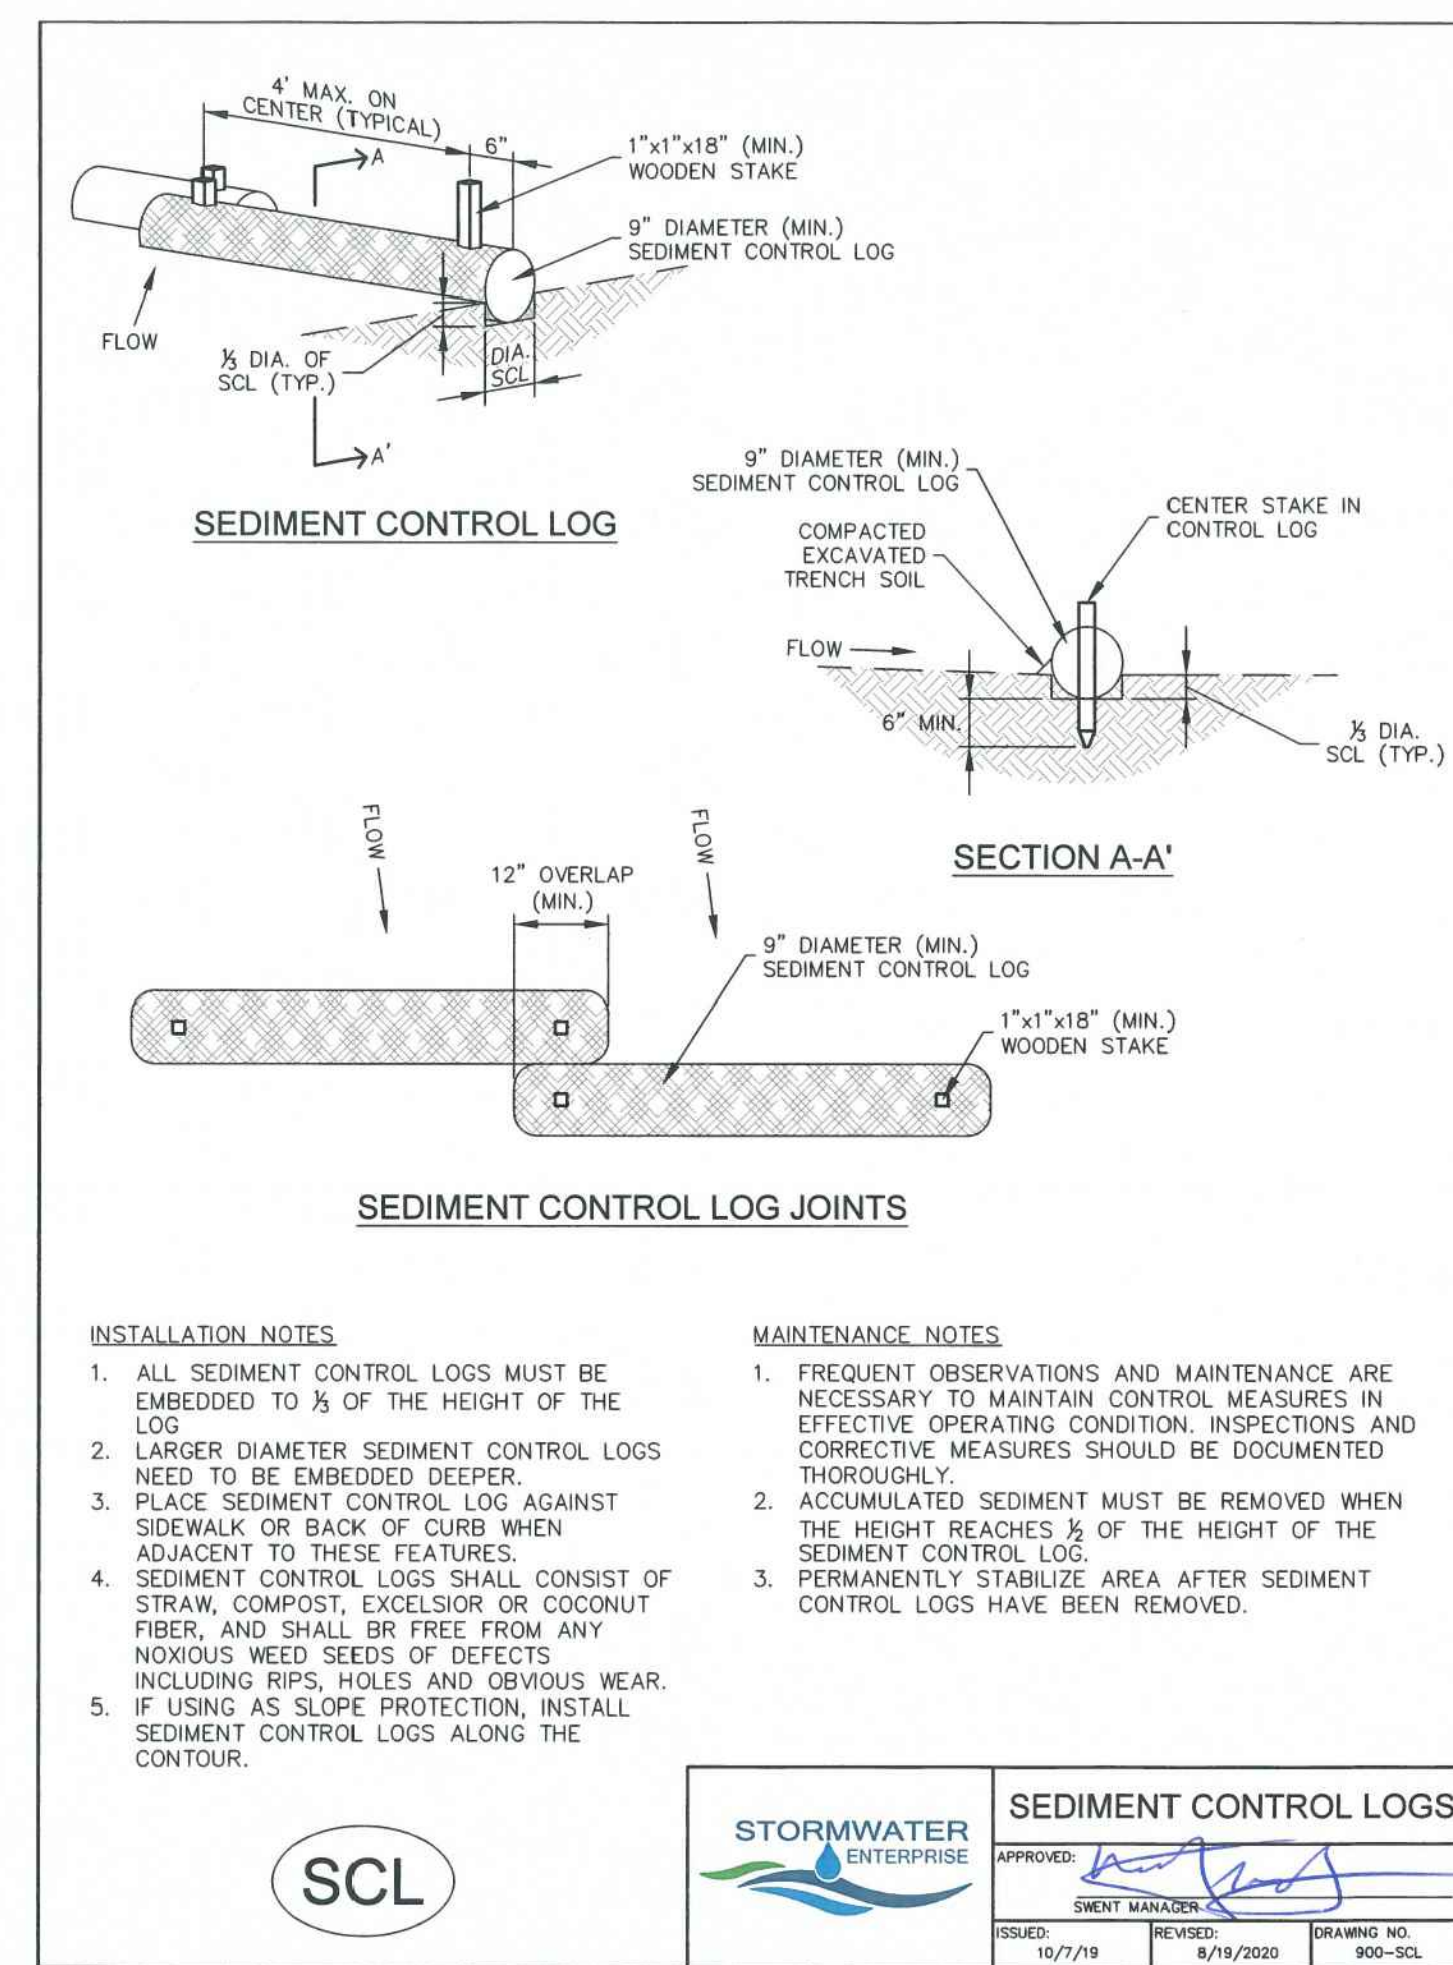


**INSTALLATION NOTES**

1. ALL SEDIMENT CONTROL LOGS MUST BE EMBEDDED TO 1/2 OF THE HEIGHT OF THE LOG.
2. LARGER DIAMETER SEDIMENT CONTROL LOGS NEED TO BE EMBEDDED DEEPER.
3. PLACE SEDIMENT CONTROL LOG AGAINST SIDEWALK OR BACK OF CURB WHEN ADJACENT TO THESE FEATURES.
4. SEDIMENT CONTROL LOGS SHALL CONSIST OF STRAW, COMPOST, EXCELSIOR OR COCONUT FIBER, AND SHALL BE FREE FROM ANY NOXIOUS WEED SEEDS OF DEFECTS INCLUDING RIPS, HOLES AND OBVIOUS WEAR.
5. IF USING AS SLOPE PROTECTION, INSTALL SEDIMENT CONTROL LOGS ALONG THE CONTOUR.

**MAINTENANCE NOTES**


1. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN CONTROL MEASURES IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
2. ACCUMULATED SEDIMENT MUST BE REMOVED WHEN THE HEIGHT REACHES 1/2 OF THE HEIGHT OF THE SEDIMENT CONTROL LOG.
3. PERMANENTLY STABILIZE AREA AFTER SEDIMENT CONTROL LOGS HAVE BEEN REMOVED.

STORMWATER ENTERPRISE **SEDIMENT CONTROL LOGS** APPROVED: [Signature] SHEET MANAGER: [Signature] ISSUED: 10/7/19 REVISED: 8/19/2020 DRAWING NO. 900-SCL

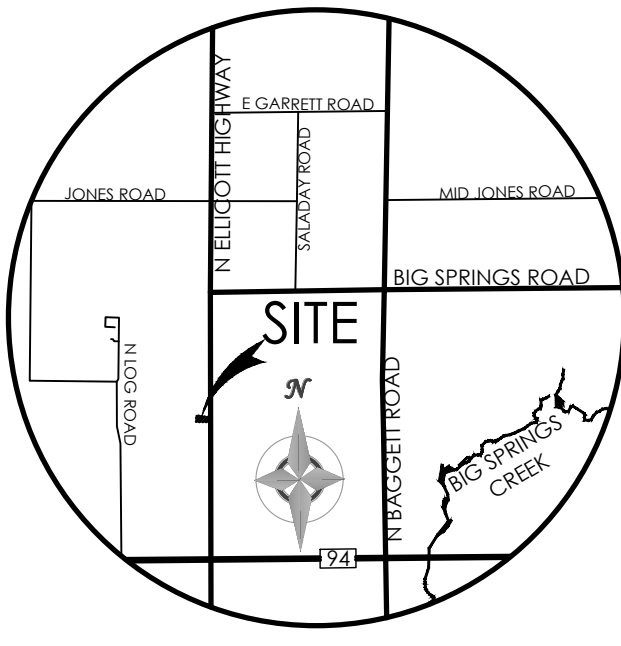

**VICINITY MAP** NOT TO SCALE

BENCHMARK

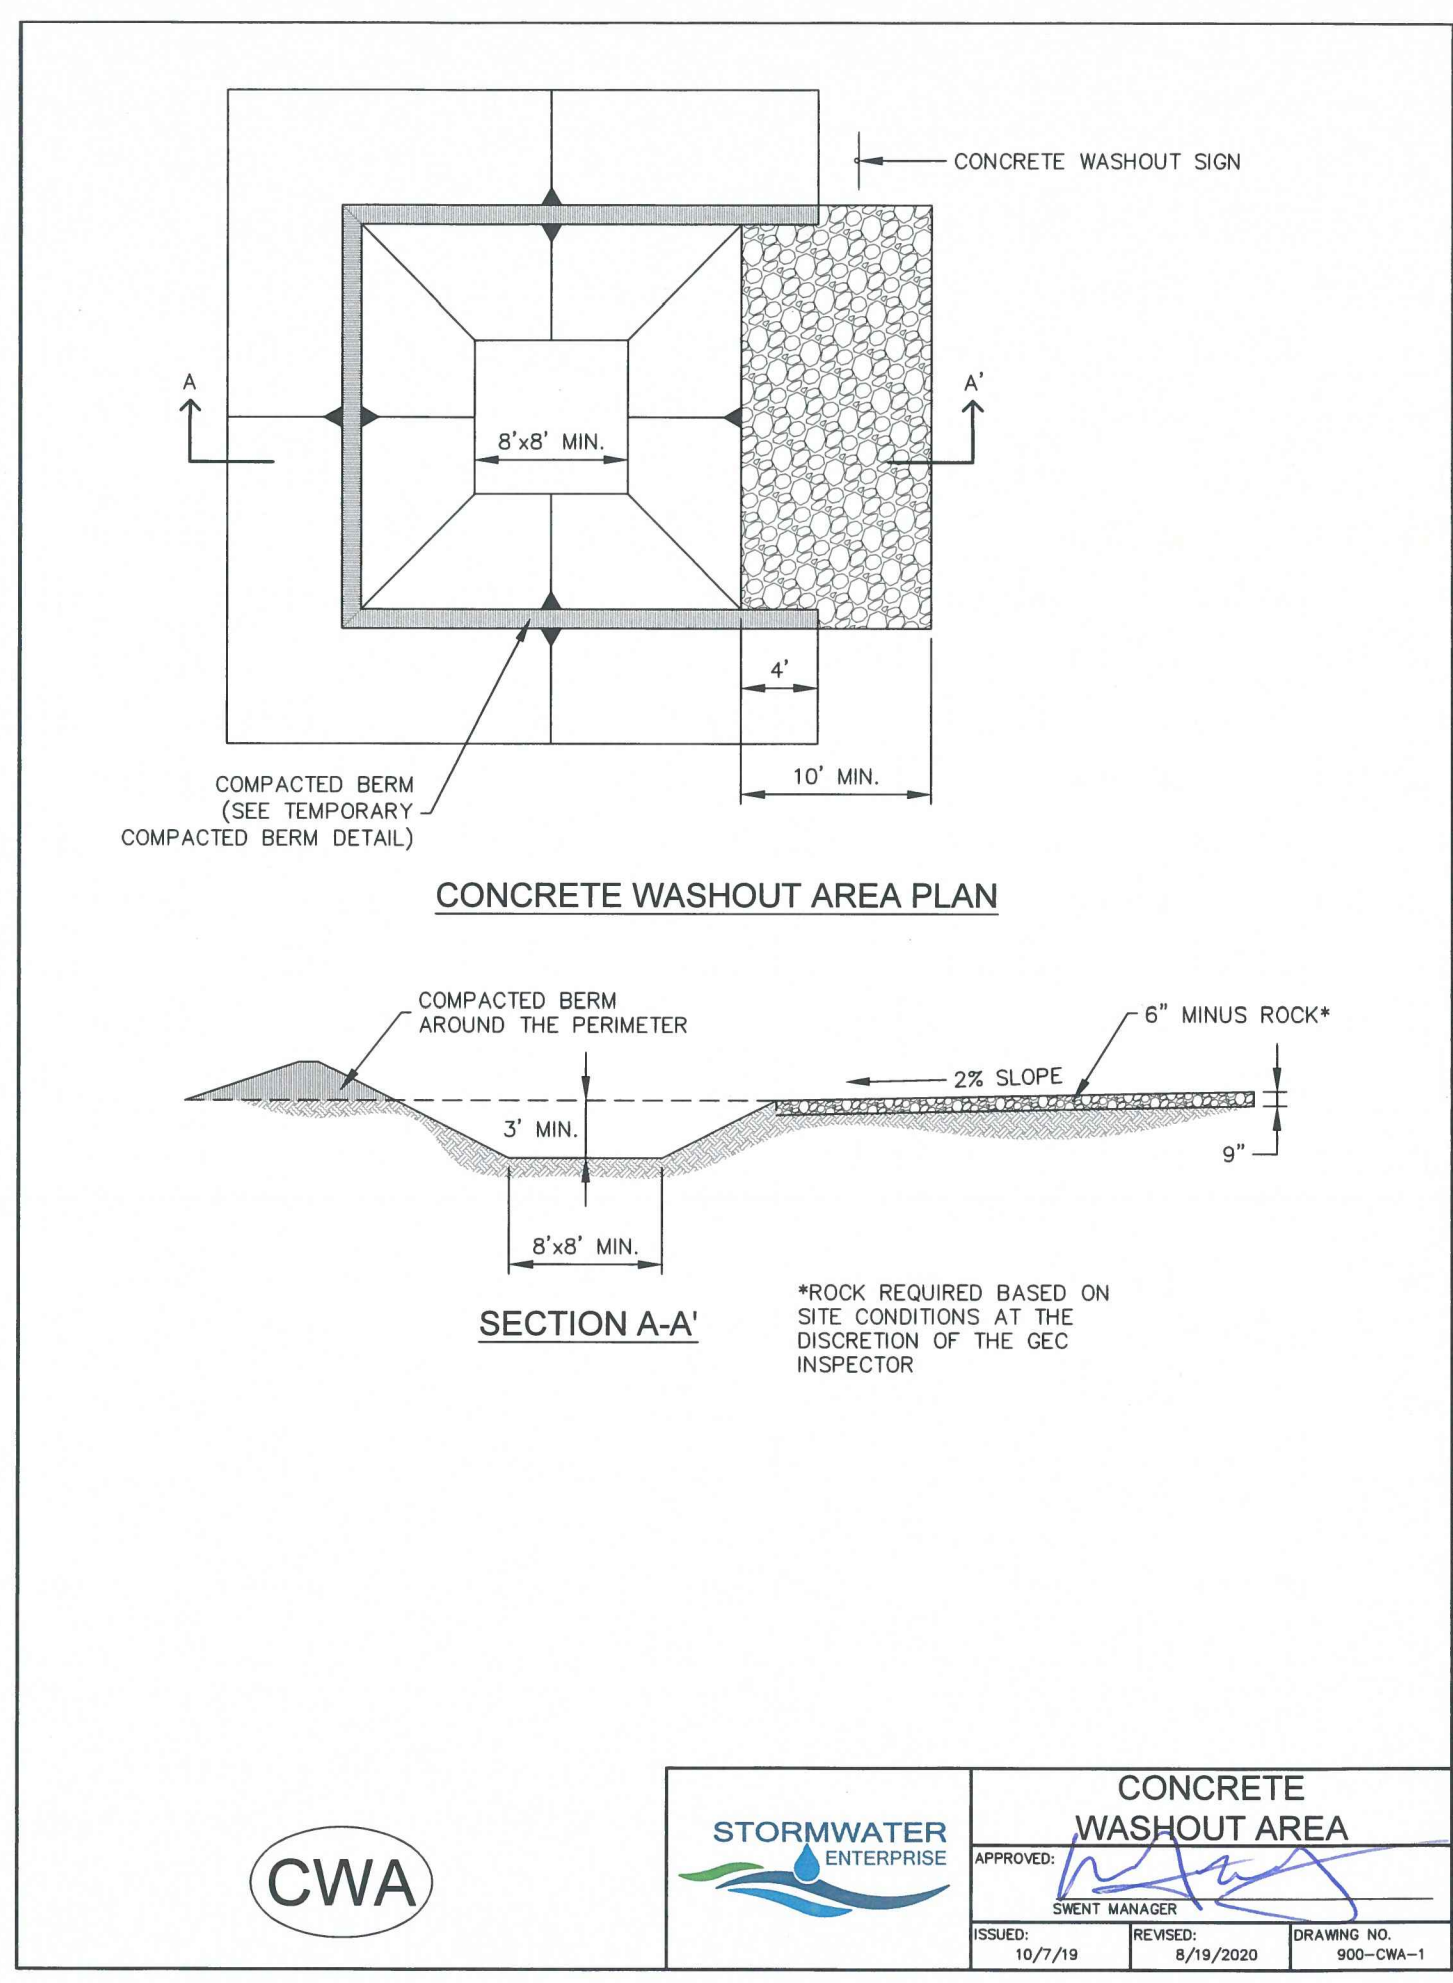


**INSTALLATION NOTES**

1. SEE PLAN VIEW FOR: -LOCATION OF CONCRETE WASHOUT AREA
2. LOCATE AT LEAST 50' AWAY FROM STATE WATERS MEASURED HORIZONTALLY.
3. AN IMPERMEABLE LINER (16 MIL. MINIMUM THICKNESS) IS REQUIRED IF CONCRETE WASH AREA IS LOCATED WITHIN 400' OF STATE WATERS OR 1000' OF WELLS OR DRINKING WATER SOURCES.
4. DO NOT LOCATE IN AREAS WHERE SHALLOW GROUNDWATER MAY BE PRESENT.
5. THE CONCRETE WASH AREA SHALL BE INSTALLED PRIOR TO CONCRETE PLACEMENT ON SITE.
6. CONCRETE WASH AREA SHALL INCLUDE A FLAT SUBSURFACE PIT THAT IS AT LEAST 8' BY 8'.
7. BERM SURROUNDING SIDES AND BACK OF CONCRETE WASH AREA SHALL HAVE A MINIMUM HEIGHT OF 2 FEET.
8. CONCRETE WASH AREA ENTRANCE SHALL BE SLOPED 2% TOWARDS THE CONCRETE WASH AREA.
9. SIGNS SHALL BE PLACED AT THE CONCRETE WASH AREA.
10. USE EXCAVATED MATERIAL FOR PERIMETER BERM CONSTRUCTION.

**MAINTENANCE NOTES**

1. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN CONTROL MEASURES IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
2. THE CONCRETE WASH AREA SHALL BE REPAIRED, CLEANED, OR ENLARGED AS NECESSARY TO MAINTAIN CAPACITY FOR CONCRETE WASTE. CONCRETE MATERIALS ACCUMULATED IN THE PIT SHALL BE REMOVED ONCE THE MATERIALS HAVE REACHED A DEPTH OF 1/2 THE HEIGHT OF THE CONCRETE WASH AREA.
3. CONCRETE WASHOUT WATER, WASTED PIECES OF CONCRETE, AND ALL OTHER DEBRIS IN THE SUBSURFACE PIT SHALL BE TRANSPORTED FROM THE JOB SITE IN A WATER-TIGHT CONTAINER AND DISPOSED OF PROPERLY.
4. THE CONCRETE WASH AREA SHALL REMAIN IN PLACE UNTIL ALL CONCRETE FOR THE PROJECT IS PLACED.
5. PERMANENTLY STABILIZE AREA AFTER CONCRETE WASH AREA IS REMOVED.

STORMWATER ENTERPRISE **CONCRETE WASHOUT AREA** APPROVED: [Signature] SHEET MANAGER: [Signature] ISSUED: 10/7/19 REVISED: 8/19/2020 DRAWING NO. 900-CWA-1

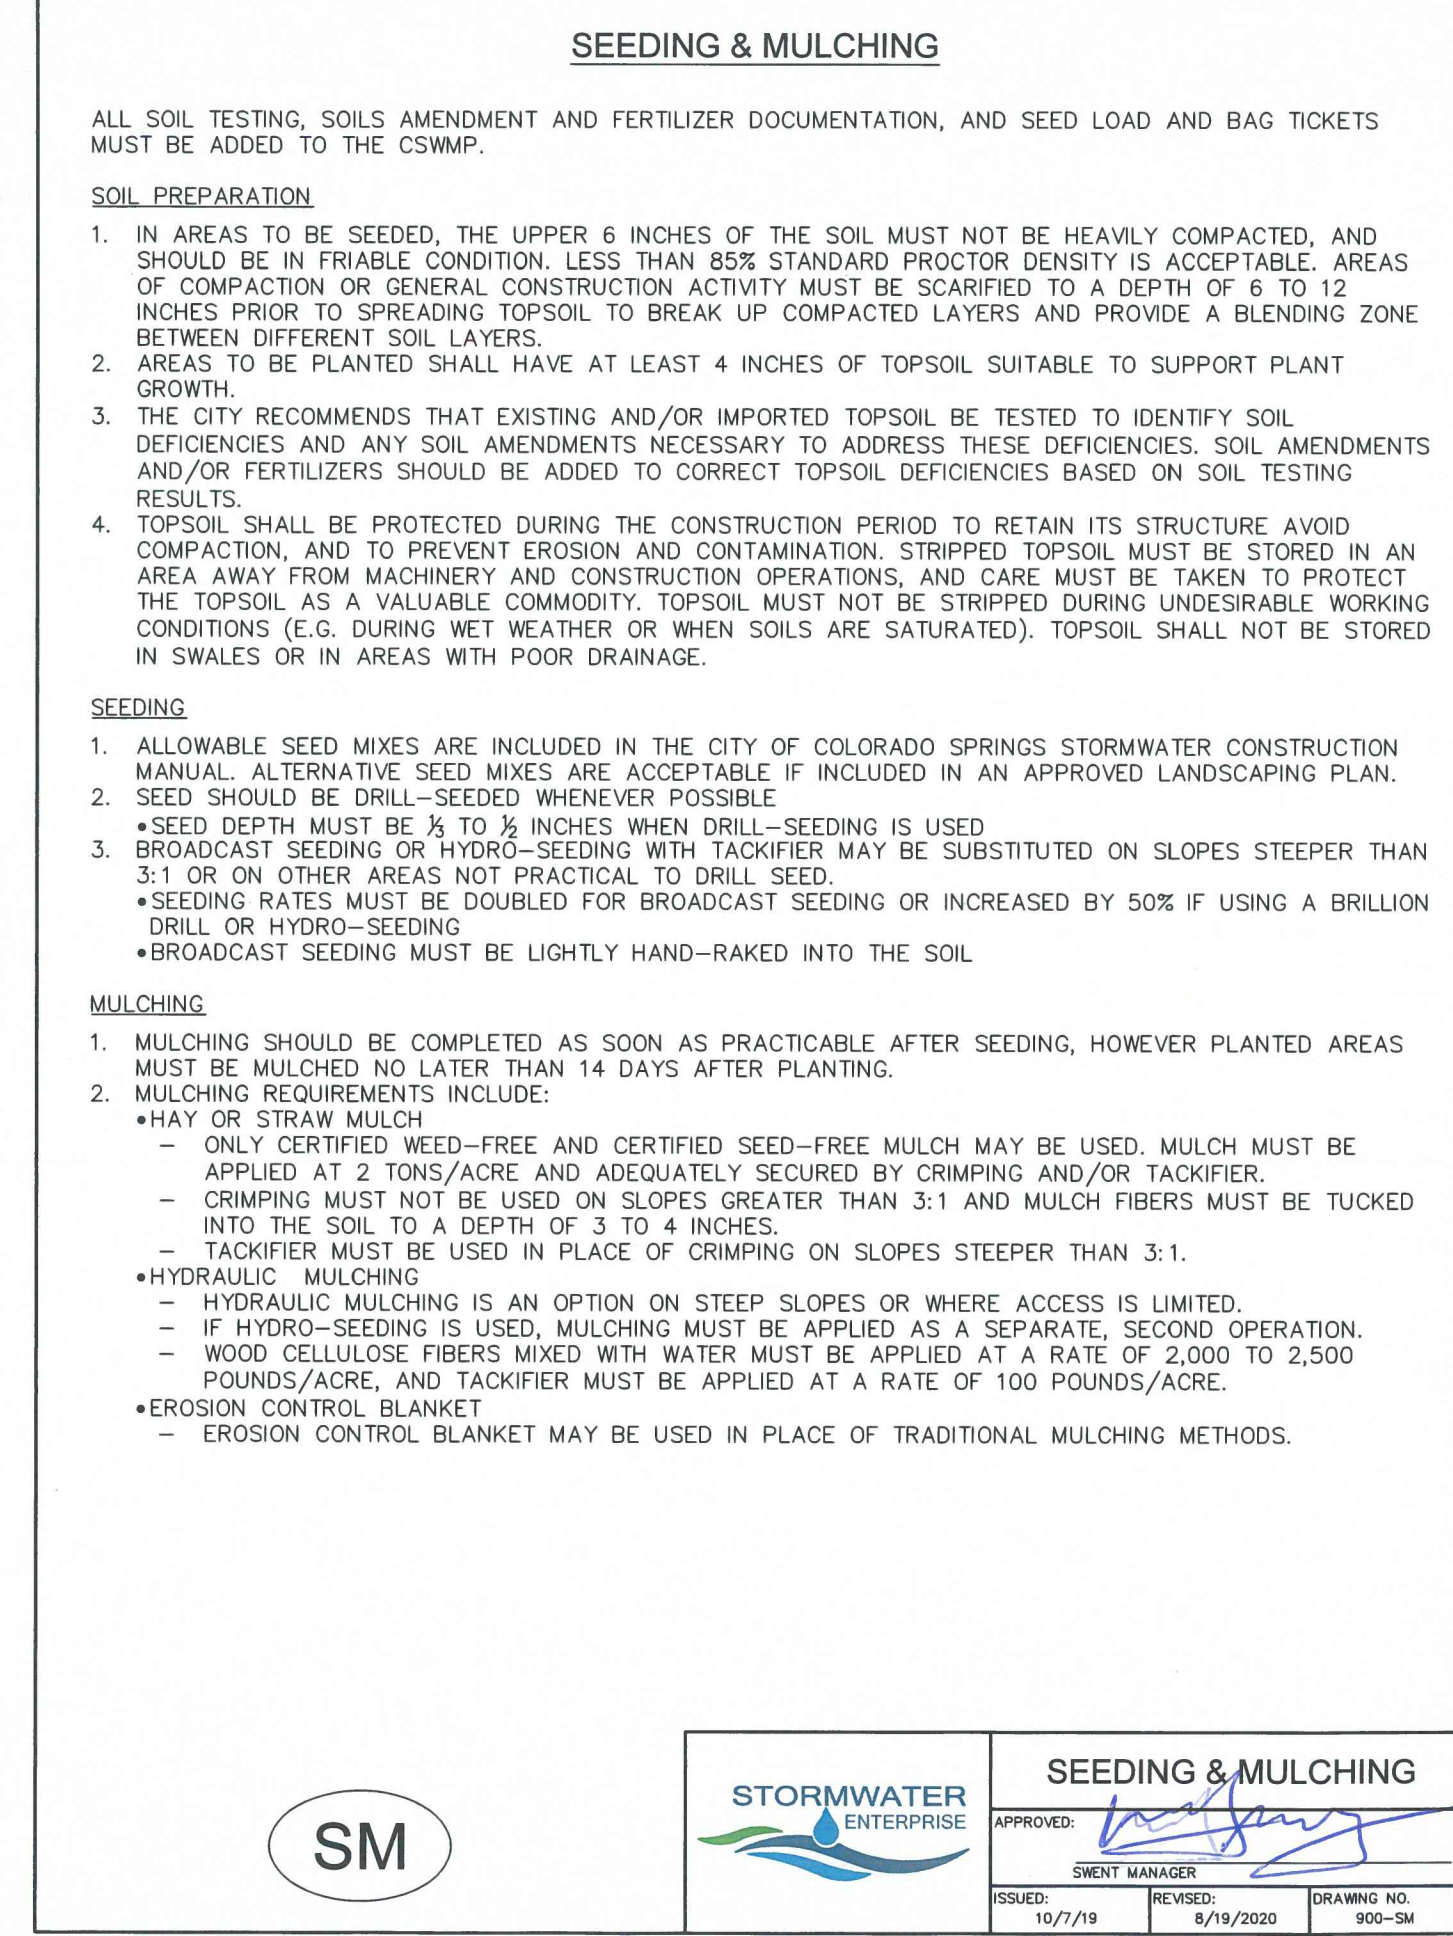

**SEEDING**

1. ALLOWABLE SEED MIXES ARE INCLUDED IN THE CITY OF COLORADO SPRINGS STORMWATER CONSTRUCTION MANUAL. ALTERNATIVE SEED MIXES ARE ACCEPTABLE IF INCLUDED IN AN APPROVED LANDSCAPING PLAN.
2. SEED SHOULD BE DRILL-SEEDED WHENEVER POSSIBLE.
3. SEED DEPTH MUST BE 1/2 TO 3/4 INCHES WHEN DRILL-SEEDED IS USED.
4. BROADCAST SEEDING OR HYDRO-SEEDED WITH TACKIFIER MAY BE SUBSTITUTED ON SLOPES STEEPER THAN 3:1 OR ON OTHER AREAS NOT PRACTICAL TO DRILL SEED.
5. SEEDING RATES MUST BE DOUBLED FOR BROADCAST SEEDING OR INCREASED BY 50% IF USING A BRILLION DRILL OR HYDRO-SEEDED.
6. BROADCAST SEEDING MUST BE LIGHTLY HAND-RAKED INTO THE SOIL.

**MULCHING**

1. MULCHING SHOULD BE COMPLETED AS SOON AS PRACTICABLE AFTER SEEDING, HOWEVER PLANTED AREAS MUST BE MULCHED NO LATER THAN 14 DAYS AFTER PLANTING.
2. MULCHING REQUIREMENTS INCLUDE:
  - HAY OR STRAW MULCH
  - ONLY CERTIFIED WEED-FREE AND CERTIFIED SEED-FREE MULCH MAY BE USED. MULCH MUST BE APPLIED AT 2 TONS/ACRE AND ADEQUATELY SECURED BY CRIMPING AND/OR TACKIFIER.
  - CRIMPING MUST NOT BE USED ON SLOPES GREATER THAN 3:1 AND MULCH FIBERS MUST BE TUCKED INTO THE SOIL TO A DEPTH OF 3 TO 4 INCHES.
  - TACKIFIER MUST BE USED IN PLACE OF CRIMPING ON SLOPES STEEPER THAN 3:1.
3. HYDRAULIC MULCHING
  - HYDRAULIC MULCHING IS AN OPTION ON STEEP SLOPES OR WHERE ACCESS IS LIMITED.
  - IF HYDRO-SEEDED IS USED, MULCHING MUST BE APPLIED AS A SEPARATE, SECOND OPERATION.
  - WOOD CELLULOSE FIBERS MIXED WITH WATER MUST BE APPLIED AT A RATE OF 2,000 TO 2,500 POUNDS/ACRE, AND TACKIFIER MUST BE APPLIED AT A RATE OF 100 POUNDS/ACRE.
4. EROSION CONTROL BLANKET
  - EROSION CONTROL BLANKET MAY BE USED IN PLACE OF TRADITIONAL MULCHING METHODS.

STORMWATER ENTERPRISE **SEEDING & MULCHING** APPROVED: [Signature] SHEET MANAGER: [Signature] ISSUED: 10/7/19 REVISED: 8/19/2020 DRAWING NO. 900-SM



REVISIONS

DESIGNED BY \_\_\_\_\_  
DRAWN BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_  
AS-BUILTS BY \_\_\_\_\_  
CHECKED BY \_\_\_\_\_

ROCKY MOUNTAIN ALVARY  
CHAPEL - ELLICOTT

GRADING & EROSION  
CONTROL PLAN  
EROSION CONTROL DET

**C1.5** MVE PROJECT 61182  
MVE DRAWING GEC-ED

**FEBRUARY 19, 2025**  
SHEET 5 OF 5