## DEVELOPER

VERDAD REAL ESTATE 1211 SOUTH WHITE CHAPEL BLVD. SOUTHLAKE, TX 76092 (817) 912-5372

### **CIVIL ENGINEER**

STERLING DESIGN ASSOCIATES, LLC 2009 W. LITTLETON BLVD. #300 LITTLETON, CO 80120 (303) 794-4727 CONTACT: JOSEPH G. SCHIEL, PE

### ARCHITECT

**ROGUE ARCHITECTS** 513 MAIN STREET SUITE 300 FORT WORTH, TX 76102 (817) 820-0433 CONTACT: TIFFANY CHALUPA

### LANDSCAPE ARCHITECT

STERLING DESIGN ASSOCIATES, LLC 2009 W. LITTLETON BLVD. #300 LITTLETON, CO 80120 (303) 794-4727 CONTACT: JONATHAN D. SPENCER, PLA

## AGENCY REFERRALS

PLANNING & COMMUNITY DEVELOPMENT 2880 INTERNATIONAL CIRCLE, SUITE 110 COLORADO SPRINGS, CO 80910 (719) 520-6306, (719) 520-6300 CONTACT: KARI PARSONS

PIKES PEAK REGIONAL BUILDING DEPARTMENT 2880 INTERNATIONAL CIRCLE COLORADO SPRINGS, CO 80910 CONTACT: DAN McCULLY (719) 327-2880

EL PASO ENVIRONMENTAL HEALTH DEPARTMENT 1675 W GARDEN OF THE GODS ROAD, SUITE 2044 COLORADO SPRINGS, CO 80907 CONTACT: PEGGY RIVERA (719) 578-3199

EL PASO COUNTY DEPARTMENT OF PUBLIC WORKS 3275 AKERS DRIVE COLORADO SPRINGS, CO 80922 CONTACT: JENNIFER IRVINE, COUNTY ENGINEER

(719) 520-6460

COLORADO SPRINGS UTILITIES 111 S. CASCADE AVE. COLORADO SPRINGS, CO 80903 CONTACT: ZACK SHEARER (719) 668-8111, (719) 448-4800 (MAIN)

MOUNTAIN VIEW ELECTRIC ASSOCIATION, INC 11140 E. WOODMAN RD. FALCON, CO 80831-8127 CONTACT: KATHY HANSEN-LEE OR LYNN HERTEL (719) 495-2283

DONALD WESCOTT FIRE PROTECTION 15415 GLENEAGLE DRIVE COLORADO SPRINGS, CO 80921 CONTACT: CHIEF VINCENT "VINNY" BURNS (719) 488-8680

DONALA WATER & SANITATION AREA A 15850 HOLBEIN DRIVE COLORADO SPRINGS, CO 80921 CONTACT: ROBERT HULL (719) 488-3603

## LEGAL DESCRIPTION

LOT 2, ACADEMY GATEWAY SUBDIVISION FILING NO. 1 EL PASO COUNTY, COLORADO

### BASIS OF BEARINGS

BEARINGS ARE BASED ON A PORTION OF THE EASTERLY BOUNDARY OF THE UNITED STATES AIR FORCE ACADEMY AS RECORDED IN PLAT BOOK O-2 AT PAGE 84, RECORDS OF EL PASO COUNTY, COLORADO, BEING MONUMENTED AT THE NORTHERLY END BY A3.5" BRASS CAP STAMPED "BDY 43" IS ASSUMED TO BEAR N 56°38'25"W, A DISTANCE OF 630.29 FEET.

### BENCHMARK

A CHISELED "+" ON THE WEST END OF THE CONCRETE MEDIAN LOCATED IN STRUTHERS ROAD EAST OF GLENEAGLE DRIVE ELEVATION = 6770.99 (NAVD 88)

CHISELED "+" ON THE EAST END OF THE CONCRETE MEDIAN LOCATED IN STRUTHERS ROAD EAST OF GLENEAGLE DRIVE ELEVATION = 6747.41 (NAVD 88)

### SOIL PREPARATION NOTE

SOIL PREPARATION SHALL BE PER RECOMMENDATIONS FROM A GEOTECHNICAL ENGINEERING REPORT PREPARED FOR THIS SITE AS FOLLOWS:

#### **GEOTECHNICAL ENGINEER: ENTECH ENGINEERING, INC, REPORT NO. 171002**

THE CONTRACTOR MUST FULLY REVIEW THIS REPORT PRIOR TO CONSTRUCTION. INFORMATION IN THE GEOTECHNICAL REPORT SUPERSEDES ANY CONFLICTING INFORMATION CONTAINED IN THE CONSTRUCTION PLANS AND SPECIFICATIONS.

## Approved

By:Craig Dossey, Executive Director Date: 10/26/2017





### **CAUTION - NOTICE TO CONTRACTOR**


THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE LOCAL UTILITY LOCATION CENTER (1-800-245-4545) AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATIONS OF THE UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING IMPROVEMENTS AND UTILITIES AND SHALL REPAIR ANY DAMAGE AT HIS EXPENSE.

# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

MERIDIAN, EL PASO COUNTY, COLORADO MAJOR SITE DEVELOPMENT PLAN

VICINITY MAP

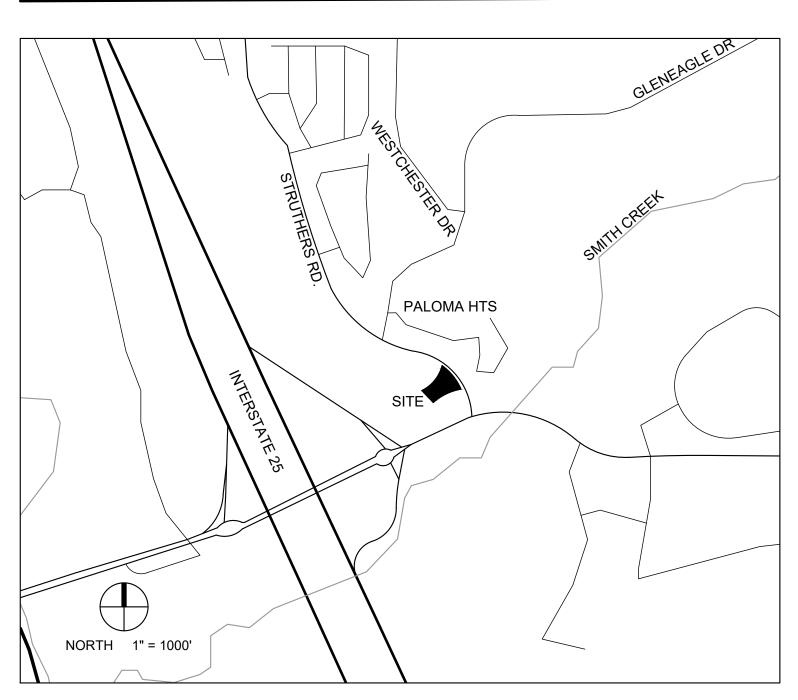

## SHEET INDEX

1	COVER SHEET
2	GENERAL NOTES
3	SITE PLAN
4	SITE DETAILS
5	SITE DETAILS
6	GRADING PLAN
7	EROSION AND STORMWATER QUALITY CONTROL PLAN
8	EROSION AND STORMWATER QUALITY CONTROL DETAILS
9	EROSION AND STORMWATER QUALITY CONTROL DETAILS
10	EROSION AND STORMWATER QUALITY CONTROL DETAILS
11	UTILITY PLAN
12	UTILITY DETAILS
I OF 2	PHOTOMETRIC PLAN
2 OF 2	PHOTOMETRIC PLAN
15	LANDSCAPE PLAN
16	LANDSCAPE DETAILS
17	SIGNAGE DETAILS
18	SIGNAGE DETAILS
19	BUILDING ELEVATIONS
20	BUILDING ELEVATIONS
21	DUMPSTER ENCLOSURE

SUBMITTALS INITIAL: MAY 16, 2017

REVISED: AUGUST 25, 2017 REVISED: SEPTEMBER 13, 2017



2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332 FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC



STERLING DESIGN ASSOCIATES, LLC

ISSUES & REVISIONS	
NO.: 1 DATE: 5/16/2017	BY: JDS
DESCRIPTION: 1ST MAJOR SDP SUBMITTAL	
NO.: 2 DATE: 8/24/2017	BY: JDS
DESCRIPTION: 2ND MAJOR SDP SUBMITTAL	
NO.: 3 DATE: 9/13/2017	BY: JDS
DESCRIPTION: 3RD MAJOR SDP SUBMITTAL	
NO.: 4 DATE: -	BY: -
DESCRIPTION: -	
NO.: 5 DATE: -	BY: -
DESCRIPTION: -	
NO.: 6 DATE: -	BY: -
DESCRIPTION: -	

date:	SCALE:
<b>9/13/2017</b>	1" = 20'
PROJECT MANAGER:	PROJECT NO.:
JDS	-
DRAWN BY:	DRAWING FILE:
	-

PROJECT:

### PROPOSED COFFEE SHOP **209 GLENEAGLE GATE VIEW** COLORADO SPRINGS, CO

CLIENT:

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421

SHEET TITLE:

**COVER SHEET** 

SHEET NUMBER:

1 OF 21

### **GENERAL NOTES**

- 1. ALL MATERIALS, WORKMANSHIP, AND CONSTRUCTION OF IMPROVEMENTS SHALL MEET OR EXCEED THE LOCAL AND APPLICABLE UTILITY DISTRICT STANDARDS AND SPECIFICATIONS, AND APPLICABLE STATE AND FEDERAL REGULATIONS. WHERE THERE IS CONFLICT BETWEEN THESE PLANS AND ANY APPLICABLE STANDARDS, THE HIGHER QUALITY STANDARD SHALL APPLY. ALL WORK SHALL BE INSPECTED AND APPROVED BY THE AUTHORITY HAVING JURISDICTION AND APPLICABLE UTILITY DISTRICT(S).
- THE CONTRACTOR SHALL HAVE ONE (1) SIGNED COPY OF THE APPROVED PLANS, ONE (1) COPY OF THE APPROPRIATE STANDARDS AND SPECIFICATIONS, AND A COPY OF ANY PERMITS AND EXTENSION AGREEMENTS NEEDED FOR THE JOB ON SITE AT ALL TIMES.
- ALL REFERENCES TO ANY PUBLISHED STANDARDS SHALL REFER TO THE LATEST REVISION OF SAID 3 STANDARDS, UNLESS SPECIFICALLY STATED OTHERWISE.
- 4. THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING ALL LABOR AND MATERIALS NECESSARY FOR THE COMPLETION OF THE INTENDED IMPROVEMENTS SHOWN ON THESE DRAWINGS OR DESIGNATED TO BE PROVIDED, INSTALLED, CONSTRUCTED, REMOVED, AND RELOCATED UNLESS SPECIFICALLY NOTED OTHERWISE.
- THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES, AS SHOWN ON THESE PLANS, IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED UPON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE LOCAL UTILITY LOCATION CENTER AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATIONS OF THE UTILITIES. PRIOR TO CONSTRUCTION THE CONTRACTOR SHALL VERIFY PERTINENT LOCATIONS AND ELEVATIONS, ESPECIALLY AT THE CONNECTION POINTS AND AT POTENTIAL UTILITY CONFLICTS. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES THAT CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THESE PLANS.
- 6. THE CONTRACTOR SHALL COORDINATE AND COOPERATE WITH THE AUTHORITY HAVING JURISDICTION AND ALL UTILITY COMPANIES/DISTRICTS INVOLVED WITH REGARD TO RELOCATIONS OR ADJUSTMENTS OF EXISTING UTILITIES DURING CONSTRUCTION AND TO ASSURE THAT THE WORK IS ACCOMPLISHED IN A TIMELY FASHION AND WITH A MINIMUM DISRUPTION OF SERVICE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONTACTING ALL PARTIES AFFECTED BY ANY DISRUPTION OF ANY UTILITY SERVICE.
- 7. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE ALL UTILITY RELOCATIONS, WHETHER SHOWN OR NOT SHOWN ON THE PLANS.
- 8. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE WITH UTILITY COMPANIES/DISTIRCTS TO OBTAIN TEMPORARY POWER, TELEPHONE AND WATER SERVICE DURING CONSTRUCTION. ALL COST FOR TEMPORARY SERVICES SHALL BE THE CONTRACTOR'S RESPONSIBILITY.
- 9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND LICENSES FOR WORK INCLUDING, BUT NOT LIMITED TO DEMOLITION, STREET CUTS, UTILITY INTERFERENCES, TRAFFIC CONTROL. GRADING, AND UTILITY FROM ALL APPLICABLE AGENCIES.
- 10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ASPECTS OF PROJECT SAFETY INCLUDING, BUT NOT LIMITED TO, EXCAVATION, TRENCHING, SHORING, TRAFFIC CONTROL, AND SECURITY.
- 11. THE CONTRACTOR SHALL INSTALL AND MAINTAIN CONSTRUCTION FENCE PRIOR TO, AND THROUGHOUT CONSTRUCTION.
- 12. UTILITY TRENCHES ARE TO BE SLOPED OR BRACED AND SHEETED AS NECESSARY TO FURNISH SAFE WORKING CONDITIONS FOR THE WORKMEN AND THE PROTECTION OF OTHER UTILITIES IN COMPLIANCE WITH APPLICABLE LOCAL, STATE, AND FEDERAL HEALTH AND SAFETY RULES AND REGULATIONS.
- 13. THE CONTRACTOR SHALL SUBMIT A TRAFFIC CONTROL PLAN, IN ACCORDANCE WITH THE M.U.T.C.D. TO THE APPROPRIATE RIGHT-OF-WAY AUTHORITY (CITY, COUNTY, OR STATE) FOR APPROVAL, PRIOR TO ANY CONSTRUCTION ACTIVITIES WITHIN, OR AFFECTING, THE RIGHT-OF-WAY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ANY AND ALL TRAFFIC CONTROL DEVICES AS MAY BE REQUIRED BY THE CONSTRUCTION ACTIVITIES.
- 14. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ALL WORK AND INSPECTIONS AS REQUIRED BY THE CITY, STATE, OR LOCAL DISTRICTS. ALL NECESSARY INSPECTIONS AND/OR CERTIFICATIONS REQUIRED SHALL BE PERFORMED PRIOR TO ANNOUNCED BUILDING POSSESSION AND THE FINAL CONNECTION OF SERVICES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL COST ASSOCIATED WITH INSPECTION.
- 15. THE CONTRACTOR SHALL NOTIFY THE LOCAL AUTHORITY (CITY, COUNTY, OR STATE) AND LOCAL UTILITY COMPANIES/DISTRICTS AT LEAST 48 HOURS PRIOR TO THE START OF ANY CONSTRUCTION.
- 16. THE CONTRACTOR SHALL NOTIFY THE LOCAL AUTHORITY (CITY, COUNTY, OR STATE) AND LOCAL UTILITY COMPANIES/DITRICTS AT LEAST 48 HOURS PRIOR TO THE START OF ANY EARTH DISTURBING ACTIVITY.
- 17. ALL STRUCTURAL EROSION CONTROL MEASURES SHALL BE INSTALLED AT THE LIMITS OF CONSTRUCTION, PRIOR TO ANY GROUND-DISTURBING ACTIVITY. ALL EROSION CONTROL MEASURES SHALL BE MAINTAINED IN GOOD REPAIR BY THE CONTRACTOR UNTIL SUCH TIME AS THE ENTIRE DISTURBED AREA IS STABILIZED WITH HARD SURFACE OR PERMANENT LANDSCAPING.
- 18. THE CONTRACTOR SHALL BE RESPONSIBLE FOR KEEPING ROADWAYS FREE AND CLEAR OF ALL CONSTRUCTION DEBRIS AND DIRT TRACKED FROM THE SITE.
- 19. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE RESTORATION OF ANY EXISTING IMPROVEMENTS INCLUDING, BUT NOT LIMITED TO STREET PAVEMENT, FENCES, SOD, LANDSCAPING, SPRINKLER SYSTEMS, AND UTILITIES DISTURBED DURING CONSTRUCTION TO THEIR ORIGINAL LOCATION AND CONDITION.
- 20. INCLUDED IN THIS PACKAGE IS THE DEMOLITION AND DISPOSAL OF ALL EXISTING UTILITIES, SITE IMPROVEMENTS AND SITE FURNISHINGS NEEDED FOR CONSTRUCTION OF THE IMPROVEMENTS SHOWN IN THIS SET OF CONSTRUCTION DRAWINGS. ALL QUESTIONS IN REGARD TO DEMOLITION SHALL BE SUBMITTED TO THE OWNER IN WRITING PRIOR TO BID.
- 21. ALL DEMOLITION, REMOVAL, DISPOSAL AND ABANDONMENT OF UTILITIES, STRUCTURES, SITE IMPROVEMENTS AND SITE FURNISHINGS SHALL BE DONE IN ACCORDANCE WITH ALL APPLICABLE FEDERAL, STATE AND LOCAL STANDARDS AND SPECIFICATIONS.
- 22. DIMENSIONS FOR LAYOUT AND CONSTRUCTION ARE NOT TO BE SCALED FROM ANY DRAWING. IF PERTINENT DIMENSIONS ARE NOT SHOWN, CONTACT THE CONSULTING ENGINEER FOR CLARIFICATION, AND ANNOTATE THE DIMENSION ON THE AS-BUILT RECORD DRAWINGS.

### GENERAL NOTES (CONT.)

- THE FINAL LIFT OF ASPHALT.
- THE GOVERNING AUTHORITY'S OR OWNER/DEVELOPER'S CRITERIA.
- COUNTY, STATE OR LOCAL DISTRICT AND THE ENGINEER OF RECORD.
- FOR THE OWNER/DEVELOPER AND THE ENGINEER IMMEDIATELY.
- AUTHORITY'S STANDARDS AND SPECIFICATIONS.
- APPROVAL PRIOR TO CONSTRUCTION.

# ACADEMY GATEWAY SUBDIVISION FILING NO. 1 LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

# MAJOR SITE DEVELOPMENT PLAN

23. RIM ELEVATIONS SHOWN ARE APPROXIMATE ONLY AND ARE NOT TO BE TAKEN AS FINAL ELEVATIONS. THE CONTRACTOR SHALL USE PRECAST CONCRETE ADJUSTMENT RINGS, GROUT, AND STEEL SHIMS TO ADJUST THE MANHOLE FRAMES TO THE REQUIRED FINAL GRADE IN CONFORMANCE WITH THE CITY OR UTILITY COMPANY/DISTIRCT STANDARD SPECIFICATIONS. ALL FRAMES SHALL BE ADJUSTED TO FINAL GRADE PRIOR TO

24. THE CONTRACTOR SHALL BE RESPONSIBLE FOR RECORDING AS-BUILT INFORMATION ON A SET OF RECORD DRAWINGS KEPT AT THE CONSTRUCTION SITE, AND AVAILABLE TO THE CITY INSPECTOR AT ALL TIMES.

25. AS-BUILT PLANS AND FIELD NOTES SHALL BE PROVIDED BY THE CONTRACTOR TO THE CITY, COUNTY, STATE, FEDERAL OR UTILITY DISTRICT; OR TO THE OWNER/DEVELOPER AS REQUIRED BY AND IN ACCORDANCE WITH

26 NO REVISIONS SHALL BE MADE TO THESE PLANS WITHOUT THE APPROVAL OF THE ACADEMY GATEWAY ARC.

27. IF, DURING THE CONSTRUCTION PROCESS, CONDITIONS ARE ENCOUNTERED BY THE CONTRACTOR, HIS SUBCONTRACTORS, OR OTHER AFFECTED PARTIES, WHICH COULD INDICATE A SITUATION THAT IS NOT IDENTIFIED IN THE PLANS OR SPECIFICATIONS, THE CONTRACTOR SHALL CONTACT THE PROJECT MANAGER

28. BENCHMARK VERIFICATION: THE CONTRACTOR SHALL USE BENCHMARKS AND DATUMS SHOWN HEREON TO SET PROJECT BENCHMARK(S), BY RUNNING A LEVEL LOOP BETWEEN AT LEAST TWO BENCHMARKS, AND SHALL PROVIDE SURVEY NOTES OF SUCH TO PROJECT ENGINEER PRIOR TO COMMENCING CONSTRUCTION.

29. ALL WORK WITHIN THE PUBLIC RIGHT-OF-WAY SHALL BE DONE IN ACCORDANCE WITH THE GOVERNING

30. THE SITE CONSTRUCTION PLANS INDICATE THE WORK TO BE COMPLETED FOR THE PROJECT. THE CONTRACTOR SHALL COORDINATE SAID WORK WITH THE OWNER AND THE TENANT CONSTRUCTION MANAGER(S) TO CONFIRM THE LIMITS AND DETAILS OF THE WORK TO BE PROVIDED AND COMPLETED.

31. THE SITE CONSTRUCTION PLANS LISTED WITHIN THIS PLAN SET ARE NOT FOR CONSTRUCTION UNLESS APPROVED BY THE APPROPRIATE GOVERNING JURISDICTION. THE CONTRACTOR SHALL CONFIRM SAID



2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332 FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC



STERLING DESIGN ASSOCIATES, LLC

NO.: 1 DATE: 5/16/2017	BY: JDS
DESCRIPTION: 1ST MAJOR SDP SUBMITTAL	
NO.: 2 DATE: 8/24/2017	BY: JDS
DESCRIPTION: 2ND MAJOR SDP SUBMITTAL	
NO.: 3 DATE: 9/13/2017	BY: JDS
DESCRIPTION: 3RD MAJOR SDP SUBMITTAL	
NO.: 4 DATE: -	BY: -
DESCRIPTION: -	
NO.: 5 DATE: -	BY: -
DESCRIPTION: -	
NO.: 6 DATE: -	BY: -
DESCRIPTION: -	
DATE: SCALE:	

DATE: 9/13/2017	SCALE: 1" = 20'
PROJECT MANAGER: JDS	PROJECT NO.:
DRAWN BY:	DRAWING FILE:

PROJECT:

### PROPOSED COFFEE SHOP **209 GLENEAGLE GATE VIEW** COLORADO SPRINGS, CO

CLIENT:

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092


TEL: (817) 527-8421

SHEET TITLE:

**GENERAL NOTES** 

SHEET NUMBER:

2 OF 21

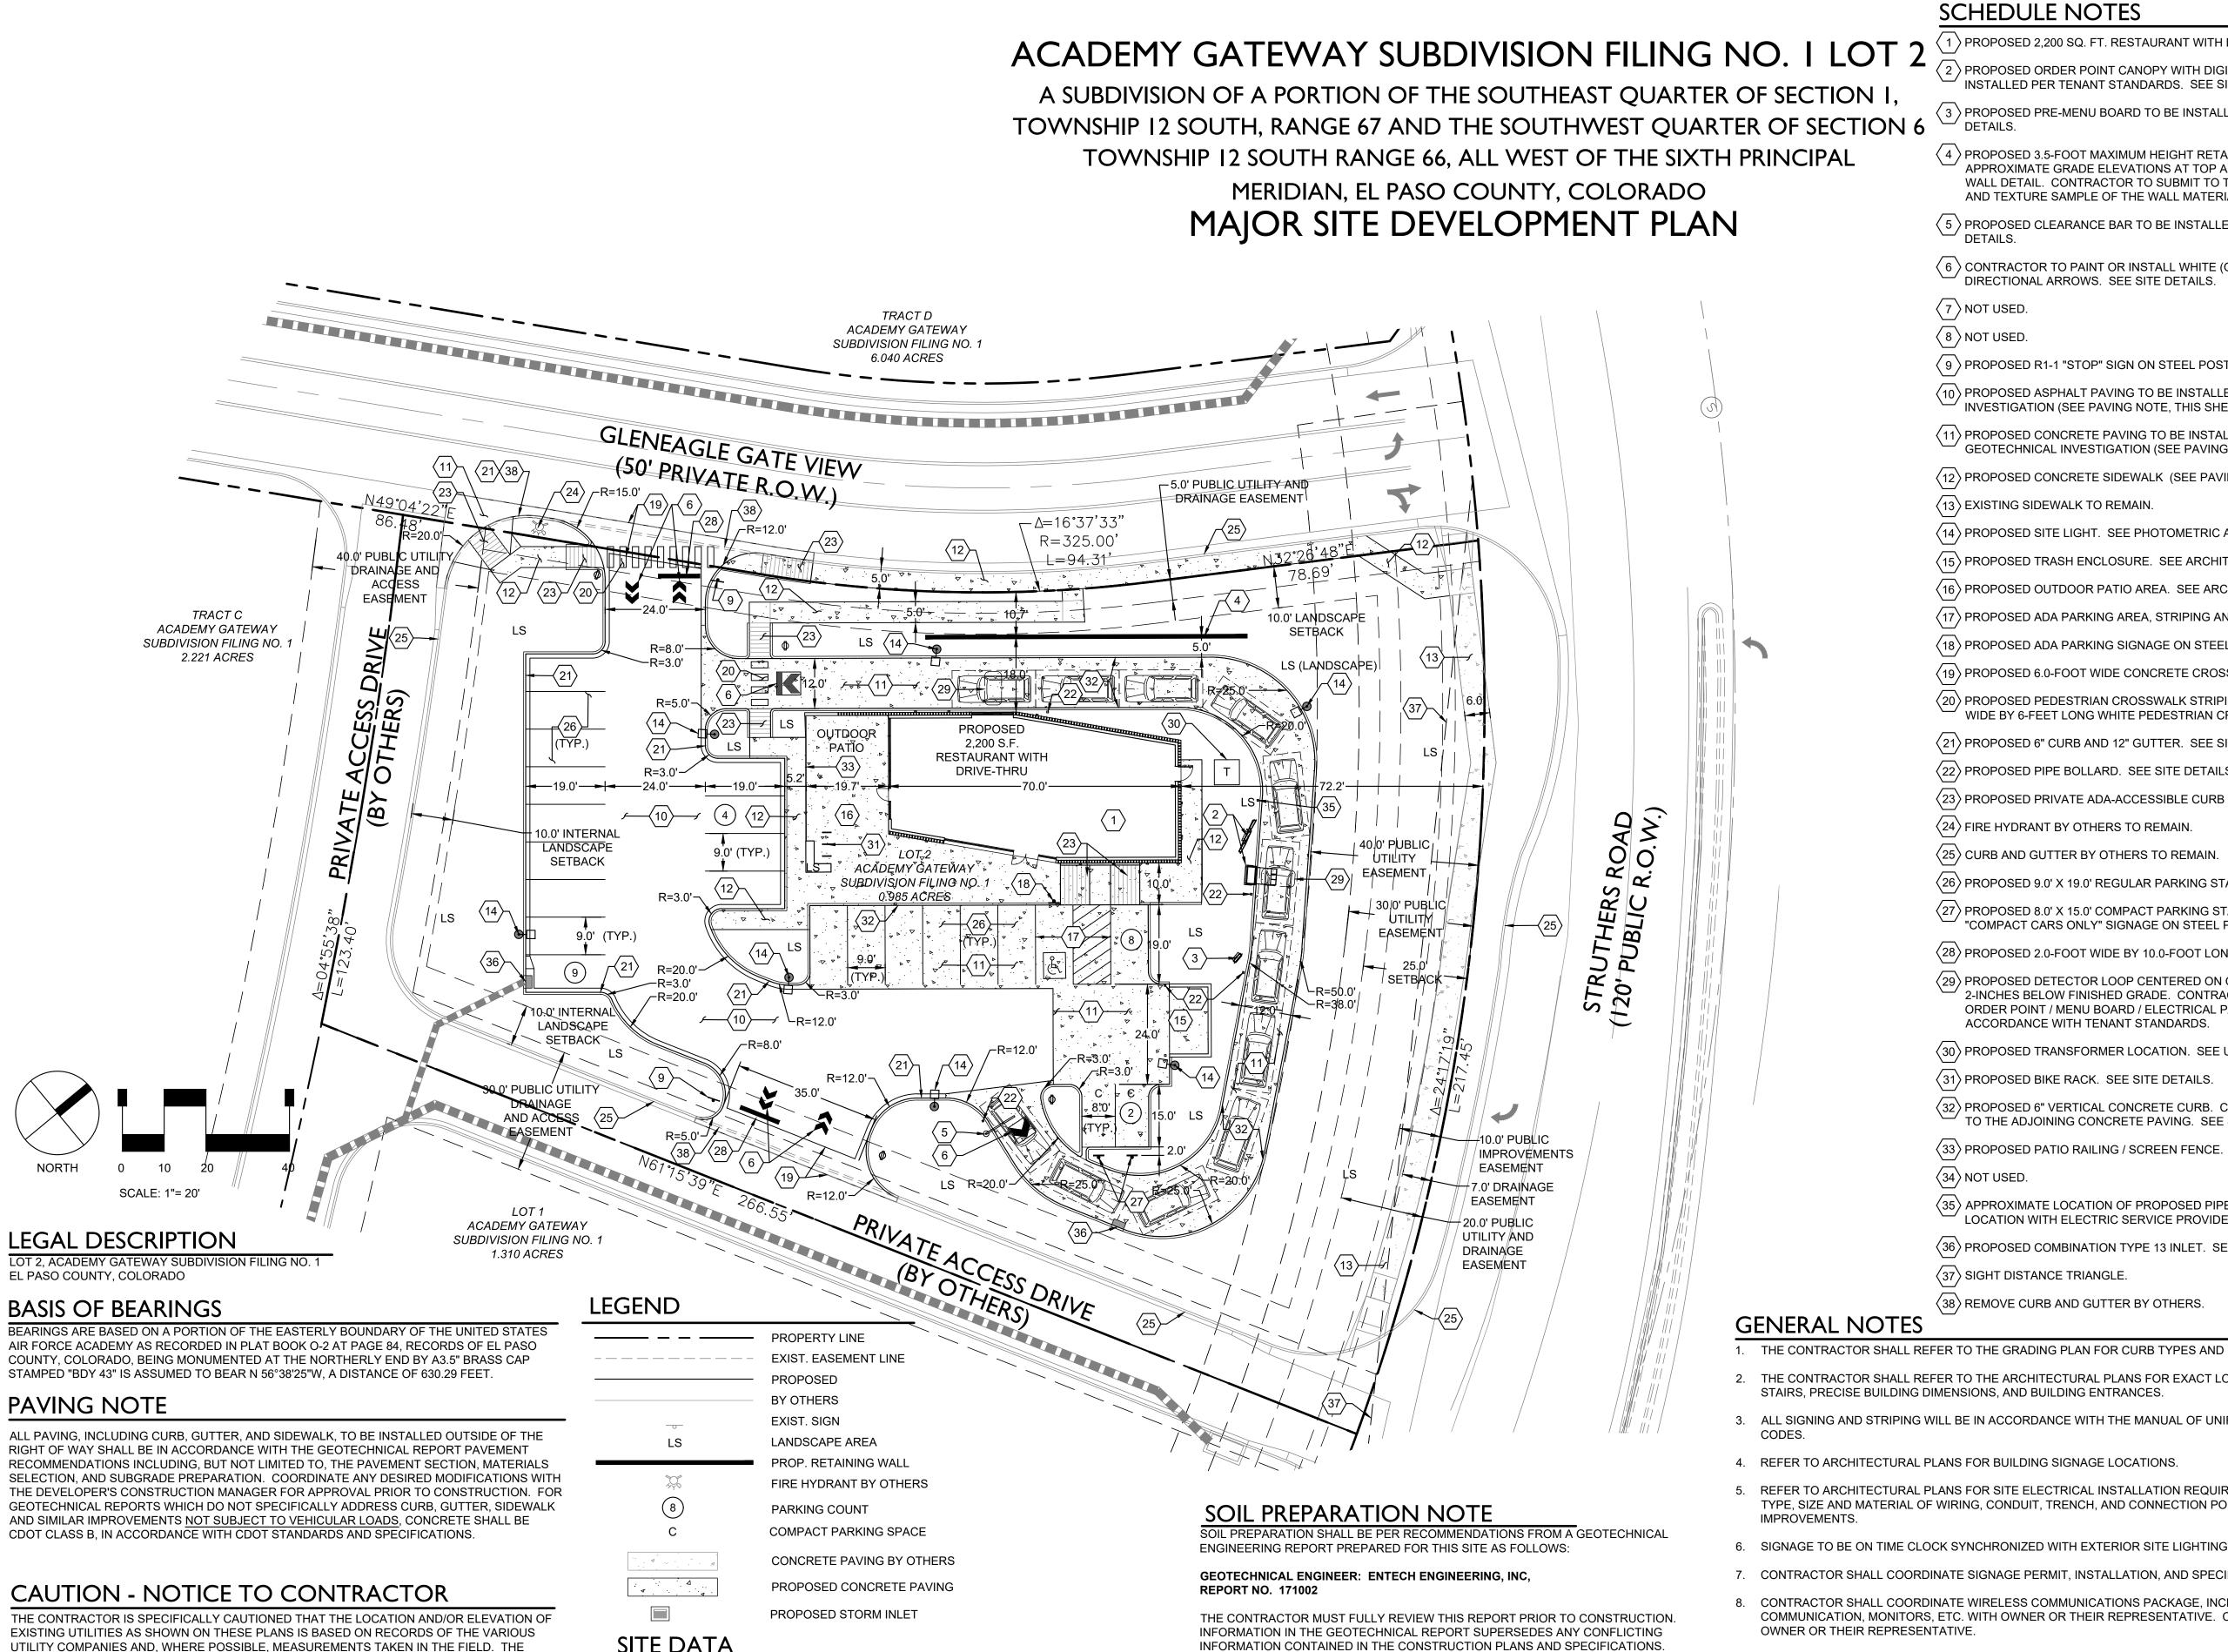

UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE LOCAL UTILITY LOCATION CENTER AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATIONS OF THE UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING IMPROVEMENTS AND UTILITIES AND SHALL REPAIR ANY DAMAGE AT HIS EXPENSE.



	- PROPOSED	
	BY OTHERS	
	EXIST. SIGN	
LS	LANDSCAPE AREA	
	PROP. RETAINING WAL	L
ЭС.	FIRE HYDRANT BY OTH	IERS
8	PARKING COUNT	
C	COMPACT PARKING SP	ACE
4	CONCRETE PAVING BY	OTHERS
۲	PROPOSED CONCRETE	E PAVING
	PROPOSED STORM INL	.ET
SITE DATA		
LOT AREA		0.985 ACRE
ZONING		(CS) COMM
BUILDING SQUARE FO	ОТ	2,200 (SF)
OVERALL LOT COVER	AGE	26,052 SF (6
LANDSCAPE COVERA	GE (EXCLUDING BUFFER)	7,324 (SF)
LANDSCAPE BUFFER	AREA	9,530 (SF)
PARKING REQUIRED		22 SPOTS 1
PARKING PROVIDED		20 REGULA
		23 TOTAL P

BIKE RACKS PROVIDED

**MERCIAL SERVICES** 

(60.72%)

1PER 100 SF BUILDING AR, 2 COMPACT, 1 HANDICAP SPOT 23 TOTAL PARKING SPOTS

**3 BIKE RACKS EQUALS 6 BIKE PARKING SPOTS** 

### CONSTRUCTION MANAGER COORDINATION NOTE

THE CONTRACTOR IS TO COORDINATE THE MATERIALS PROVISION, PLACEMENT, AND INSTALLATION OF ANY STARBUCKS PROTOTYPICAL SITE APPURTENANCES WITH THE OWNER PRIOR TO CONSTRUCTION. THIS INCLUDES, BUT IS NOT LIMITED TO, SITE DIRECTIONAL/RESTRICTION/COMPLIMENTARY SIGNAGE, CLEARANCE BAR, PRE-MENU BOARD, ORDER POINT CANOPY, DIGITAL ORDER SCREEN, MENU BOARD, DETECTOR LOOPS, DIRECTIONAL PAVEMENT MARKINGS, AND THE ORDER POINT STAR PATTERN PAVEMENT MARKINGS.

### SCHEDULE NOTES

PROPOSED 2,200 SQ. FT. RESTAURANT WITH DRIVE-THRU. SEE ARCHITECTURAL PLANS

PROPOSED ORDER POINT CANOPY WITH DIGITAL ORDER SCREEN AND MENU BOARD TO BE INSTALLED PER TENANT STANDARDS. SEE SIGNAGE DETAILS.

( 3 ) PROPOSED PRE-MENU BOARD TO BE INSTALLED PER TENANT STANDARDS. SEE SIGNAGE

 $\langle$  4  $\rangle$  PROPOSED 3.5-FOOT MAXIMUM HEIGHT RETAINING WALL. REFER TO GRADING PLAN FOR APPROXIMATE GRADE ELEVATIONS AT TOP AND BASE OF WALL. SEE LANDSCAPE DETAILS FOR WALL DETAIL. CONTRACTOR TO SUBMIT TO THE ARCHITECT AND OWNER/DEVELOPER A COLOR AND TEXTURE SAMPLE OF THE WALL MATERIAL TO BE USED PRIOR TO INSTALLATION.

 $\langle$  5  $\rangle$  PROPOSED CLEARANCE BAR TO BE INSTALLED PER TENANT STANDARDS. SEE SIGNAGE

 $\langle$  6 angle CONTRACTOR TO PAINT OR INSTALL WHITE (OUTGOING) AND GREEN (INCOMING) VEHICLE DIRECTIONAL ARROWS. SEE SITE DETAILS

 $\langle 9 \rangle$  PROPOSED R1-1 "STOP" SIGN ON STEEL POST. SEE SITE DETAILS.

 $\langle 10 \rangle$  proposed asphalt paving to be installed per the requirements of the geotechnical INVESTIGATION (SEE PAVING NOTE, THIS SHEET)

 $\langle 11 \rangle$  PROPOSED CONCRETE PAVING TO BE INSTALLED PER THE REQUIREMENTS OF THE GEOTECHNICAL INVESTIGATION (SEE PAVING NOTE, THIS SHEET).

(12) PROPOSED CONCRETE SIDEWALK (SEE PAVING NOTE, THIS SHEET). SEE SITE DETAILS.

 $\langle 13 \rangle$  EXISTING SIDEWALK TO REMAIN.

 $\langle 14 \rangle$  PROPOSED SITE LIGHT. SEE PHOTOMETRIC AND SITE ELECTRIC PLAN.

 $\langle 15 \rangle$  PROPOSED TRASH ENCLOSURE. SEE ARCHITECTURAL PLANS

(16) PROPOSED OUTDOOR PATIO AREA. SEE ARCHITECTURAL PLANS

 $\langle 17 \rangle$  proposed ada parking area, striping and symbols. See site details.

 $\langle$ 18angle PROPOSED ADA PARKING SIGNAGE ON STEEL POST. SEE SITE DETAILS

 $\langle 19 \rangle$  PROPOSED 6.0-FOOT WIDE CONCRETE CROSSPAN. SEE SITE DETAILS.

 $\langle 20 \rangle$  proposed pedestrian crosswalk striping. Contractor to paint or install 1.5-foot WIDE BY 6-FEET LONG WHITE PEDESTRIAN CROSSWALK BARS 4-FEET ON CENTER.

 $\langle 21 \rangle$  PROPOSED 6" CURB AND 12" GUTTER. SEE SITE DETAILS.

 $\langle 22 \rangle$  PROPOSED PIPE BOLLARD. SEE SITE DETAILS.

 $\langle 23 \rangle$  PROPOSED PRIVATE ADA-ACCESSIBLE CURB RAMP. SEE SITE DETAILS.

 $\langle 24 \rangle$  FIRE HYDRANT BY OTHERS TO REMAIN.

 $\langle 25 \rangle$  CURB AND GUTTER BY OTHERS TO REMAIN

 $\langle 26 \rangle$  proposed 9.0' X 19.0' REGULAR PARKING STALL WITH 4" WIDE, WHITE PARKING STRIPING.

 $\langle 27 \rangle$  proposed 8.0' X 15.0' Compact Parking Stall with 4" wide, white parking striping and 'COMPACT CARS ONLY" SIGNAGE ON STEEL POST. SEE SITE DETAILS

 $\langle 28 \rangle$  proposed 2.0-foot wide by 10.0-foot long white stop bar striping.

 $\langle 29 
angle$  PROPOSED DETECTOR LOOP CENTERED ON ORDER POINT AND/OR DRIVE-THROUGH WINDOW 2-INCHES BELOW FINISHED GRADE. CONTRACTOR TO EXTEND CONDUIT TO DRIVE-THROUGH. ORDER POINT / MENU BOARD / ELECTRICAL PANEL. CONTRACTOR SHALL INSTALL ALL WORK IN ACCORDANCE WITH TENANT STANDARDS.

 $\langle 30 \rangle$  PROPOSED TRANSFORMER LOCATION. SEE UTILITY PLAN.

 $\langle 31 \rangle$  PROPOSED BIKE RACK. SEE SITE DETAILS.

 $\langle 32 \rangle$  PROPOSED 6" VERTICAL CONCRETE CURB. CONTRACTOR MAY ELECT TO POUR MONOLITHICALLY TO THE ADJOINING CONCRETE PAVING. SEE SITE DETAILS.

 $\langle 33 \rangle$  PROPOSED PATIO RAILING / SCREEN FENCE. SEE ARCHITECTURAL PLANS.

 $\langle 35 \rangle$  APPROXIMATE LOCATION OF PROPOSED PIPE BOLLARD. CONTRACTOR TO COORDINATE LOCATION WITH ELECTRIC SERVICE PROVIDER.

 $\langle 36 \rangle$  PROPOSED COMBINATION TYPE 13 INLET. SEE UTILITY DETAILS.

 $\langle 37 \rangle$  SIGHT DISTANCE TRIANGLE.

 $\langle 38 \rangle$  REMOVE CURB AND GUTTER BY OTHERS.

THE CONTRACTOR SHALL REFER TO THE GRADING PLAN FOR CURB TYPES AND FLOWLINE ELEVATIONS.

2. THE CONTRACTOR SHALL REFER TO THE ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF EXIT PORCHES, RAMPS,

ALL SIGNING AND STRIPING WILL BE IN ACCORDANCE WITH THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) AND LOCAL

JOINTS THEREIN SHALL BE TOOL FINISHED.

INFORMATION.

REFER TO ARCHITECTURAL PLANS FOR SITE ELECTRICAL INSTALLATION REQUIREMENTS INCLUDING, BUT NOT LIMITED TO LOCATION, TYPE, SIZE AND MATERIAL OF WIRING, CONDUIT, TRENCH, AND CONNECTION POINTS FOR SITE LIGHTING, SITE SIGNAGE, AND OTHER SITE

7. CONTRACTOR SHALL COORDINATE SIGNAGE PERMIT, INSTALLATION, AND SPECIFICATIONS WITH OWNER.

CONTRACTOR SHALL COORDINATE WIRELESS COMMUNICATIONS PACKAGE, INCLUDING VEHICLE DETECTION LOOP, WIRELESS COMMUNICATION, MONITORS, ETC. WITH OWNER OR THEIR REPRESENTATIVE. CONTRACTOR SHALL VERIFY REQUIREMENTS WITH

SIGNAGE CONTRACTOR SHALL VERIFY SIZE AND LOCATION OF ANY AND ALL ALLOWABLE MONUMENT OR POLE SIGNAGE WITH OWNER AND PROVIDE SHOP DRAWINGS PRIOR TO FABRICATION TO OWNER FOR APPROVAL

10. ALL RADIUS DIMENSIONS SHOWN ARE TO FLOWLINES UNLESS OTHERWISE NOTED. ALL RADII ARE 3 FEET UNLESS OTHERWISE NOTED. 11. PROVIDE JOINTS AT 30 X DEPTH OF CONCRETE MAXIMUM SPACING IN VEHICULAR AREAS UNLESS OTHERWISE INDICATED. JOINTS SHOULD EXTEND THROUGH THE ADJACENT CURB.

12. MAXIMUM JOINT SPACING IN PEDESTRIAN AREAS (I.E. SIDEWALKS AND PATIOS) SHALL BE 5' UNLESS OTHERWISE INDICATED. CONTROL

13. THE CONTRACTOR SHALL SELECT AND USE A BOND BREAKER AT INLETS, MANHOLES, AND SIMILAR SIZE STRUCTURES. SMALLER STRUCTURES SUCH AS VALVE COVERS AND MONUMENT BOXES SHALL NOT REQUIRE A BOND BREAKER, UNLESS SPECIFIED OTHERWISE. 14. PROVIDE A CONTINUOUS ISOLATION JOINT AT THE BUILDING FOUNDATION. REFERENCE THE ARCHITECTURAL PLANS FOR ADDITIONAL



2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332 FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC



STERLING DESIGN ASSOCIATES, LLC

ISSUES & REVISIONS	
NO.: 1 DATE: 5/16/2017	BY: JDS
DESCRIPTION: 1ST MAJOR SI	DP SUBMITTAL
NO.: 2 DATE: 8/24/2017	BY: JDS
DESCRIPTION: 2ND MAJOR S	SDP SUBMITTAL
NO.: 3 DATE: 9/13/2017	BY: JDS
DESCRIPTION: 3RD MAJOR S	SDP SUBMITTAL
NO.: 4 DATE: -	BY: -
DESCRIPTION: -	
NO.: 5 DATE: -	BY: -
DESCRIPTION: -	
NO.: 6 DATE: -	BY: -
DESCRIPTION: -	
DATE:	SCALE:
9/13/2017	1" = 20'

1" = 20'	
PROJECT NO.:	
DRAWING FILE:	
-	
-	PROJECT NO.:

PROJECT:

### PROPOSED COFFEE SHOP **209 GLENEAGLE GATE VIEW** COLORADO SPRINGS, CO

CLIENT


VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421

SHEET TITLE: SITE PLAN

SHEET NUMBER:


3 OF 21

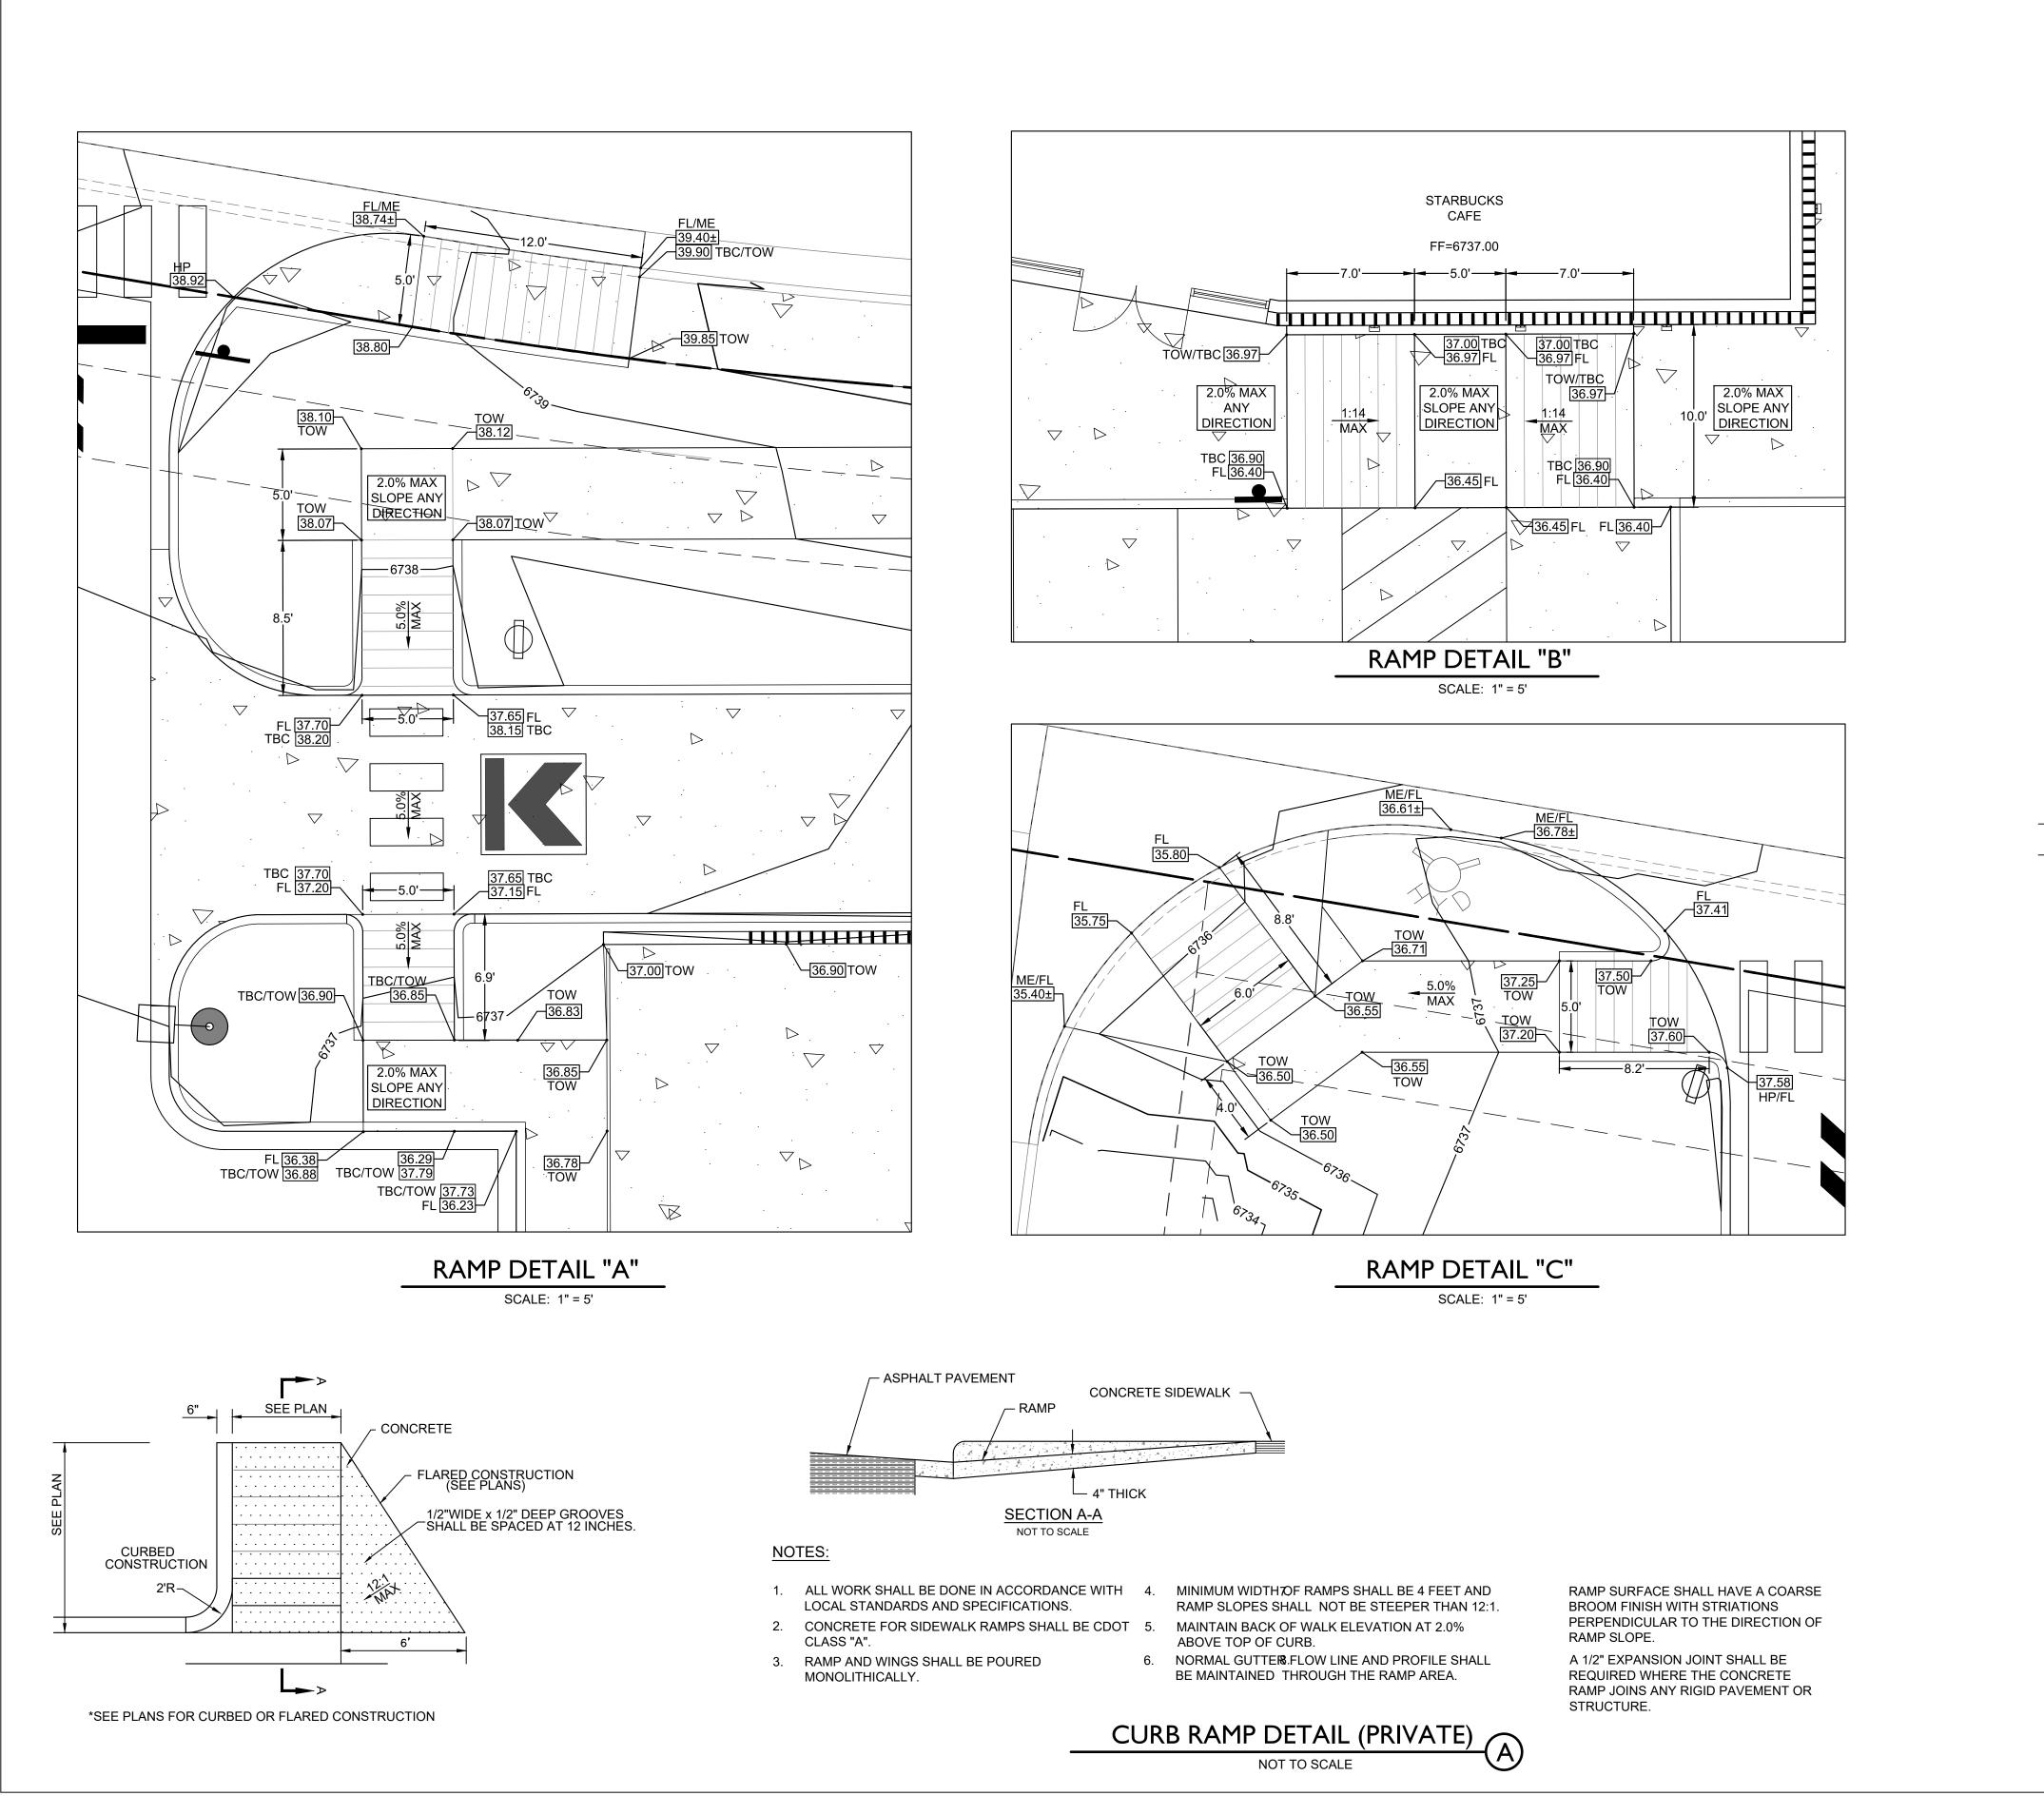

# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

MAJOR SITE DEVELOPMENT PLAN

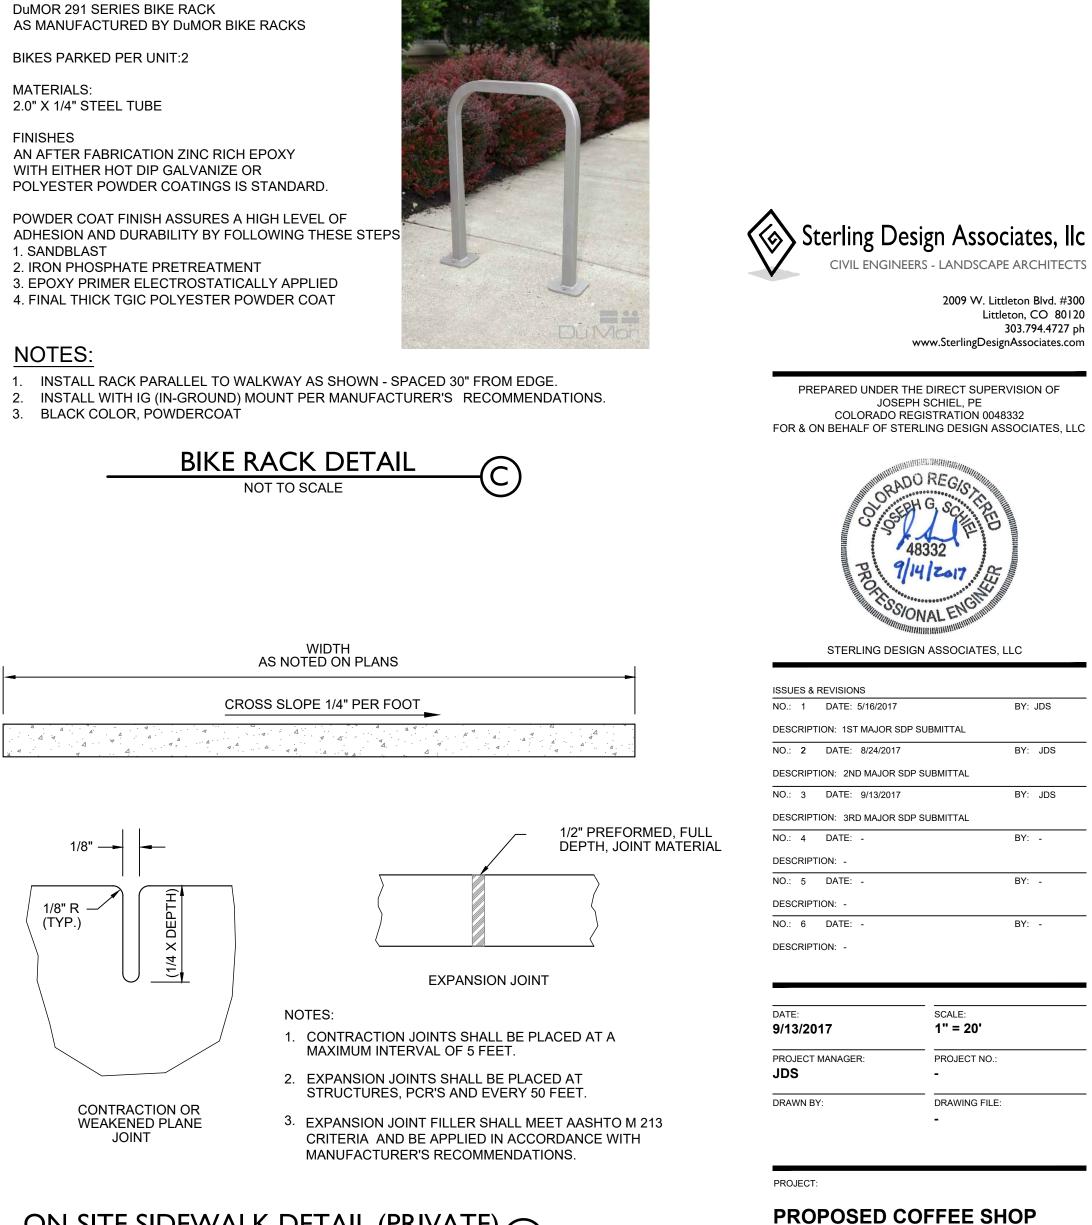

## ON-SITE SIDEWALK DETAIL (PRIVATE) NOT TO SCALE

MATERIALS:

FINISHES

1. SANDBLAST

NOTES:

1/8" R

(TYP.)

CLIENT: VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

209 GLENEAGLE GATE VIEW

COLORADO SPRINGS, CO


TEL: (817) 527-8421

SHEET TITLE:

SITE DETAILS

SHEET NUMBER:

4 OF 21

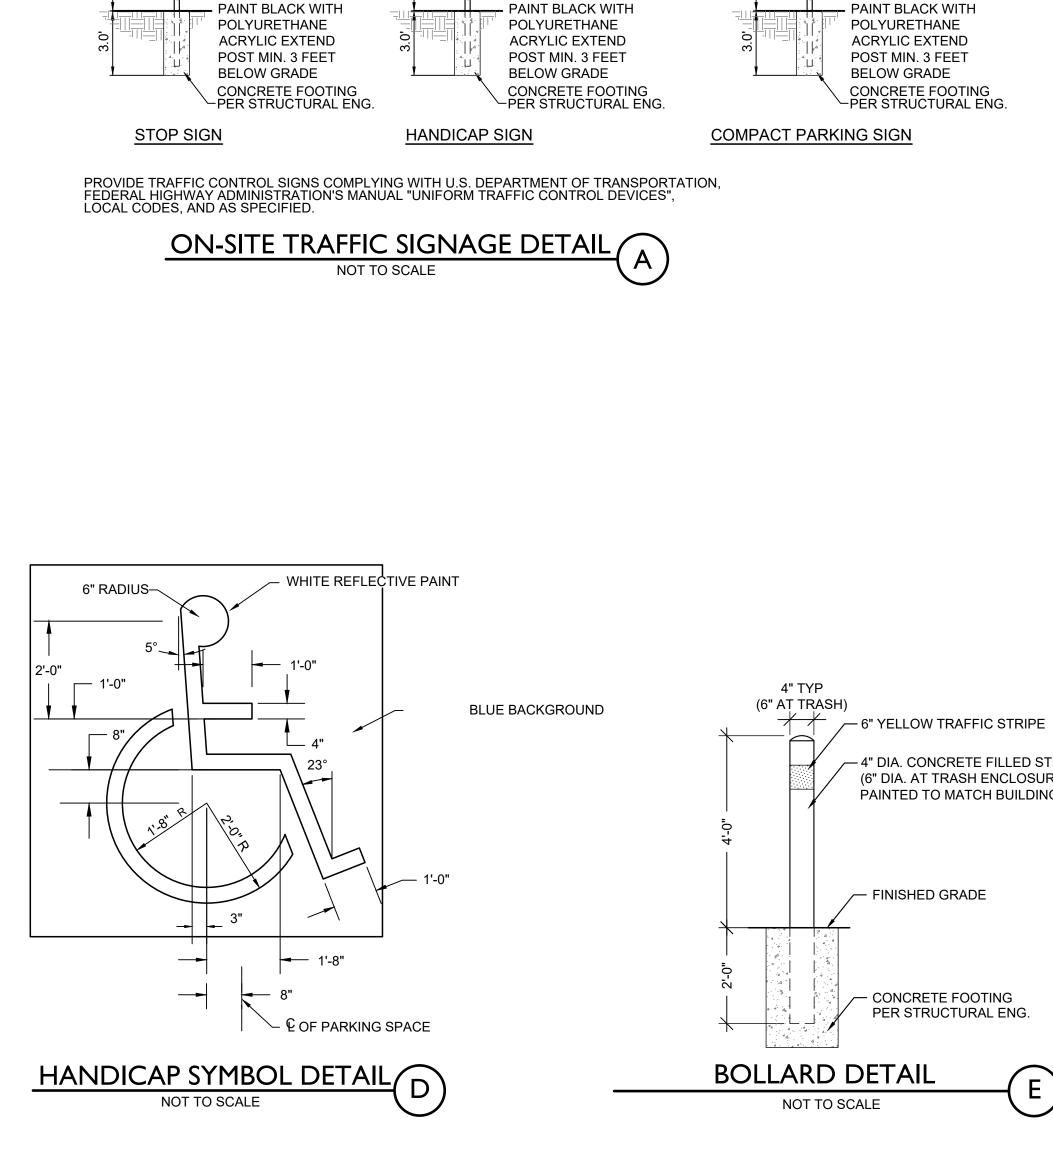

1.0'

RESERVED

ST0P

- UNIVERSAL STOP SIGN R1-1

\_1-3/4x1-3/4 STEEL

POST PRIME AND

UNIVERSAL

SIGN

THIS SIGN AT

-VAN SPACES

\_1-3/4x1-3/4 STEEL

POST PRIME AND

ONLY

HANDICAPPED

- THIS SIGN TYPICAL AT EACH HANDICAPPED PARKING SPACE

CARS

ONLY

- COMPACT CARS ONLY SIGN


\_1-3/4x1-3/4 STEEL

POST PRIME AND


# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

## MERIDIAN, EL PASO COUNTY, COLORADO MAJOR SITE DEVELOPMENT PLAN

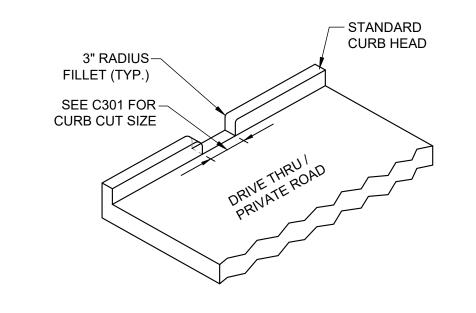

CURB OPENING AT RUNDOWN

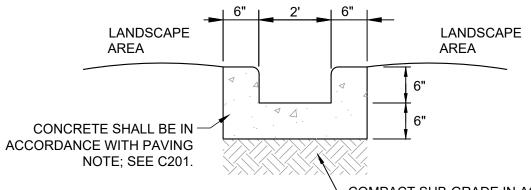

- COMPACT SUB-GRADE IN ACCORDANCE WITH PAVING NOTE (TYP); SEE C201.

CONCRETE RUNDOWN

## CONCRETE RUNDOWN (PRIVATE) NOT TO SCALE

8" - SEE PAVING +NOTE

> WW 6x6x4.4 OR #4 @ 18"\_ O.C.E.W. REINFORCING (LAP ALL JOINTS 6" MIN) COMPACT SUB-GRADE IN — ACCORDANCE WITH PAVING NOTE (TYP); SEE SITE PLAN


CONCRETE SHALL BE IN ACCORDANCE WITH PAVING NOTE; SEE SITE PLAN





– 4" DIA. CONCRETE FILLED STEEL TUBING


(6" DIA. AT TRASH ENCLOSURE) PAINTED TO MATCH BUILDING TRIM



PER PLAN -----

4" STRIPING

PAINTED WHITE

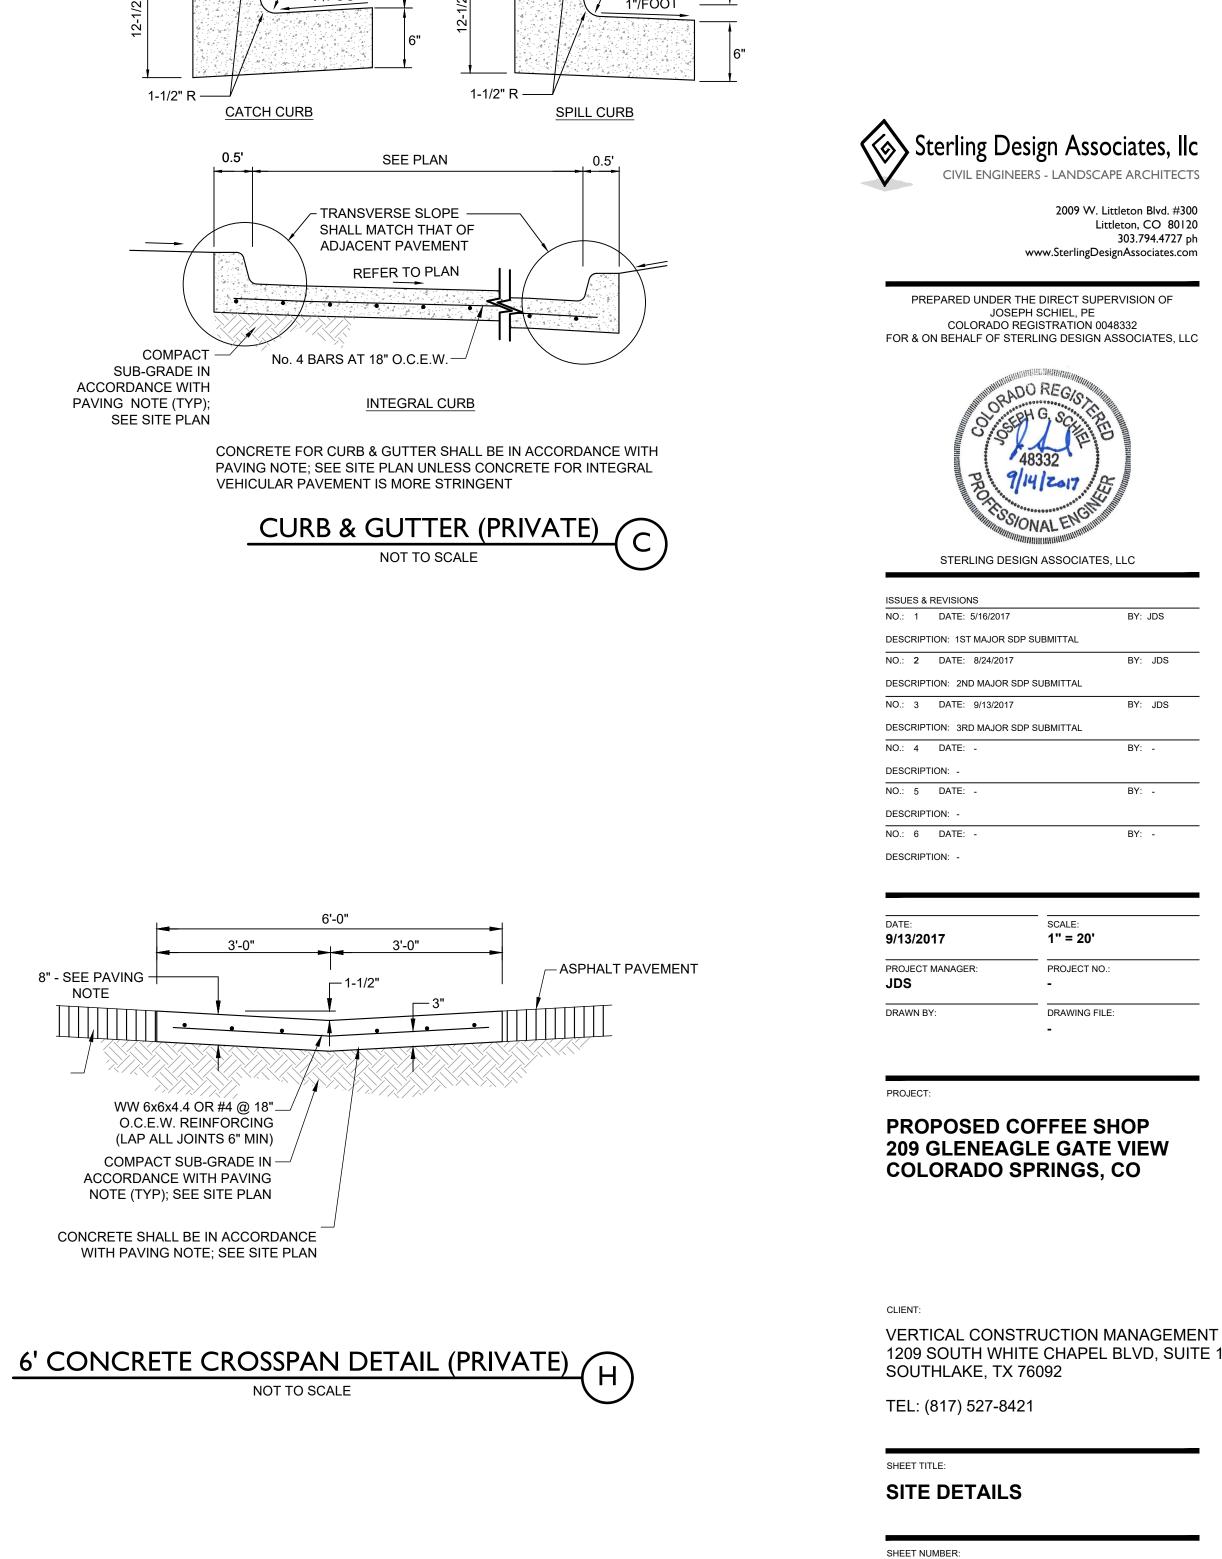

4 1/2" 1'-1/2" 1'-1/2" 1"/FOOT 1"/FOOT

1'-6"

CATCH CURB

1'-6"

4 1/2"

1-1/2" R

COMPACT

SUB-GRADE IN

SEE SITE PLAN

ACCORDANCE WITH

PAVING NOTE (TYP);

0.5

No. 4 BARS AT 18" O.C.E.W.


CONCRETE FOR CURB & GUTTER SHALL BE IN ACCORDANCE WITH PAVING NOTE; SEE SITE PLAN UNLESS CONCRETE FOR INTEGRAL VEHICULAR PAVEMENT IS MORE STRINGENT

CURB & GUTTER (PRIVATE)

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180

COUNTY PROJECT NUMBER PPR-17-030

5 OF 21

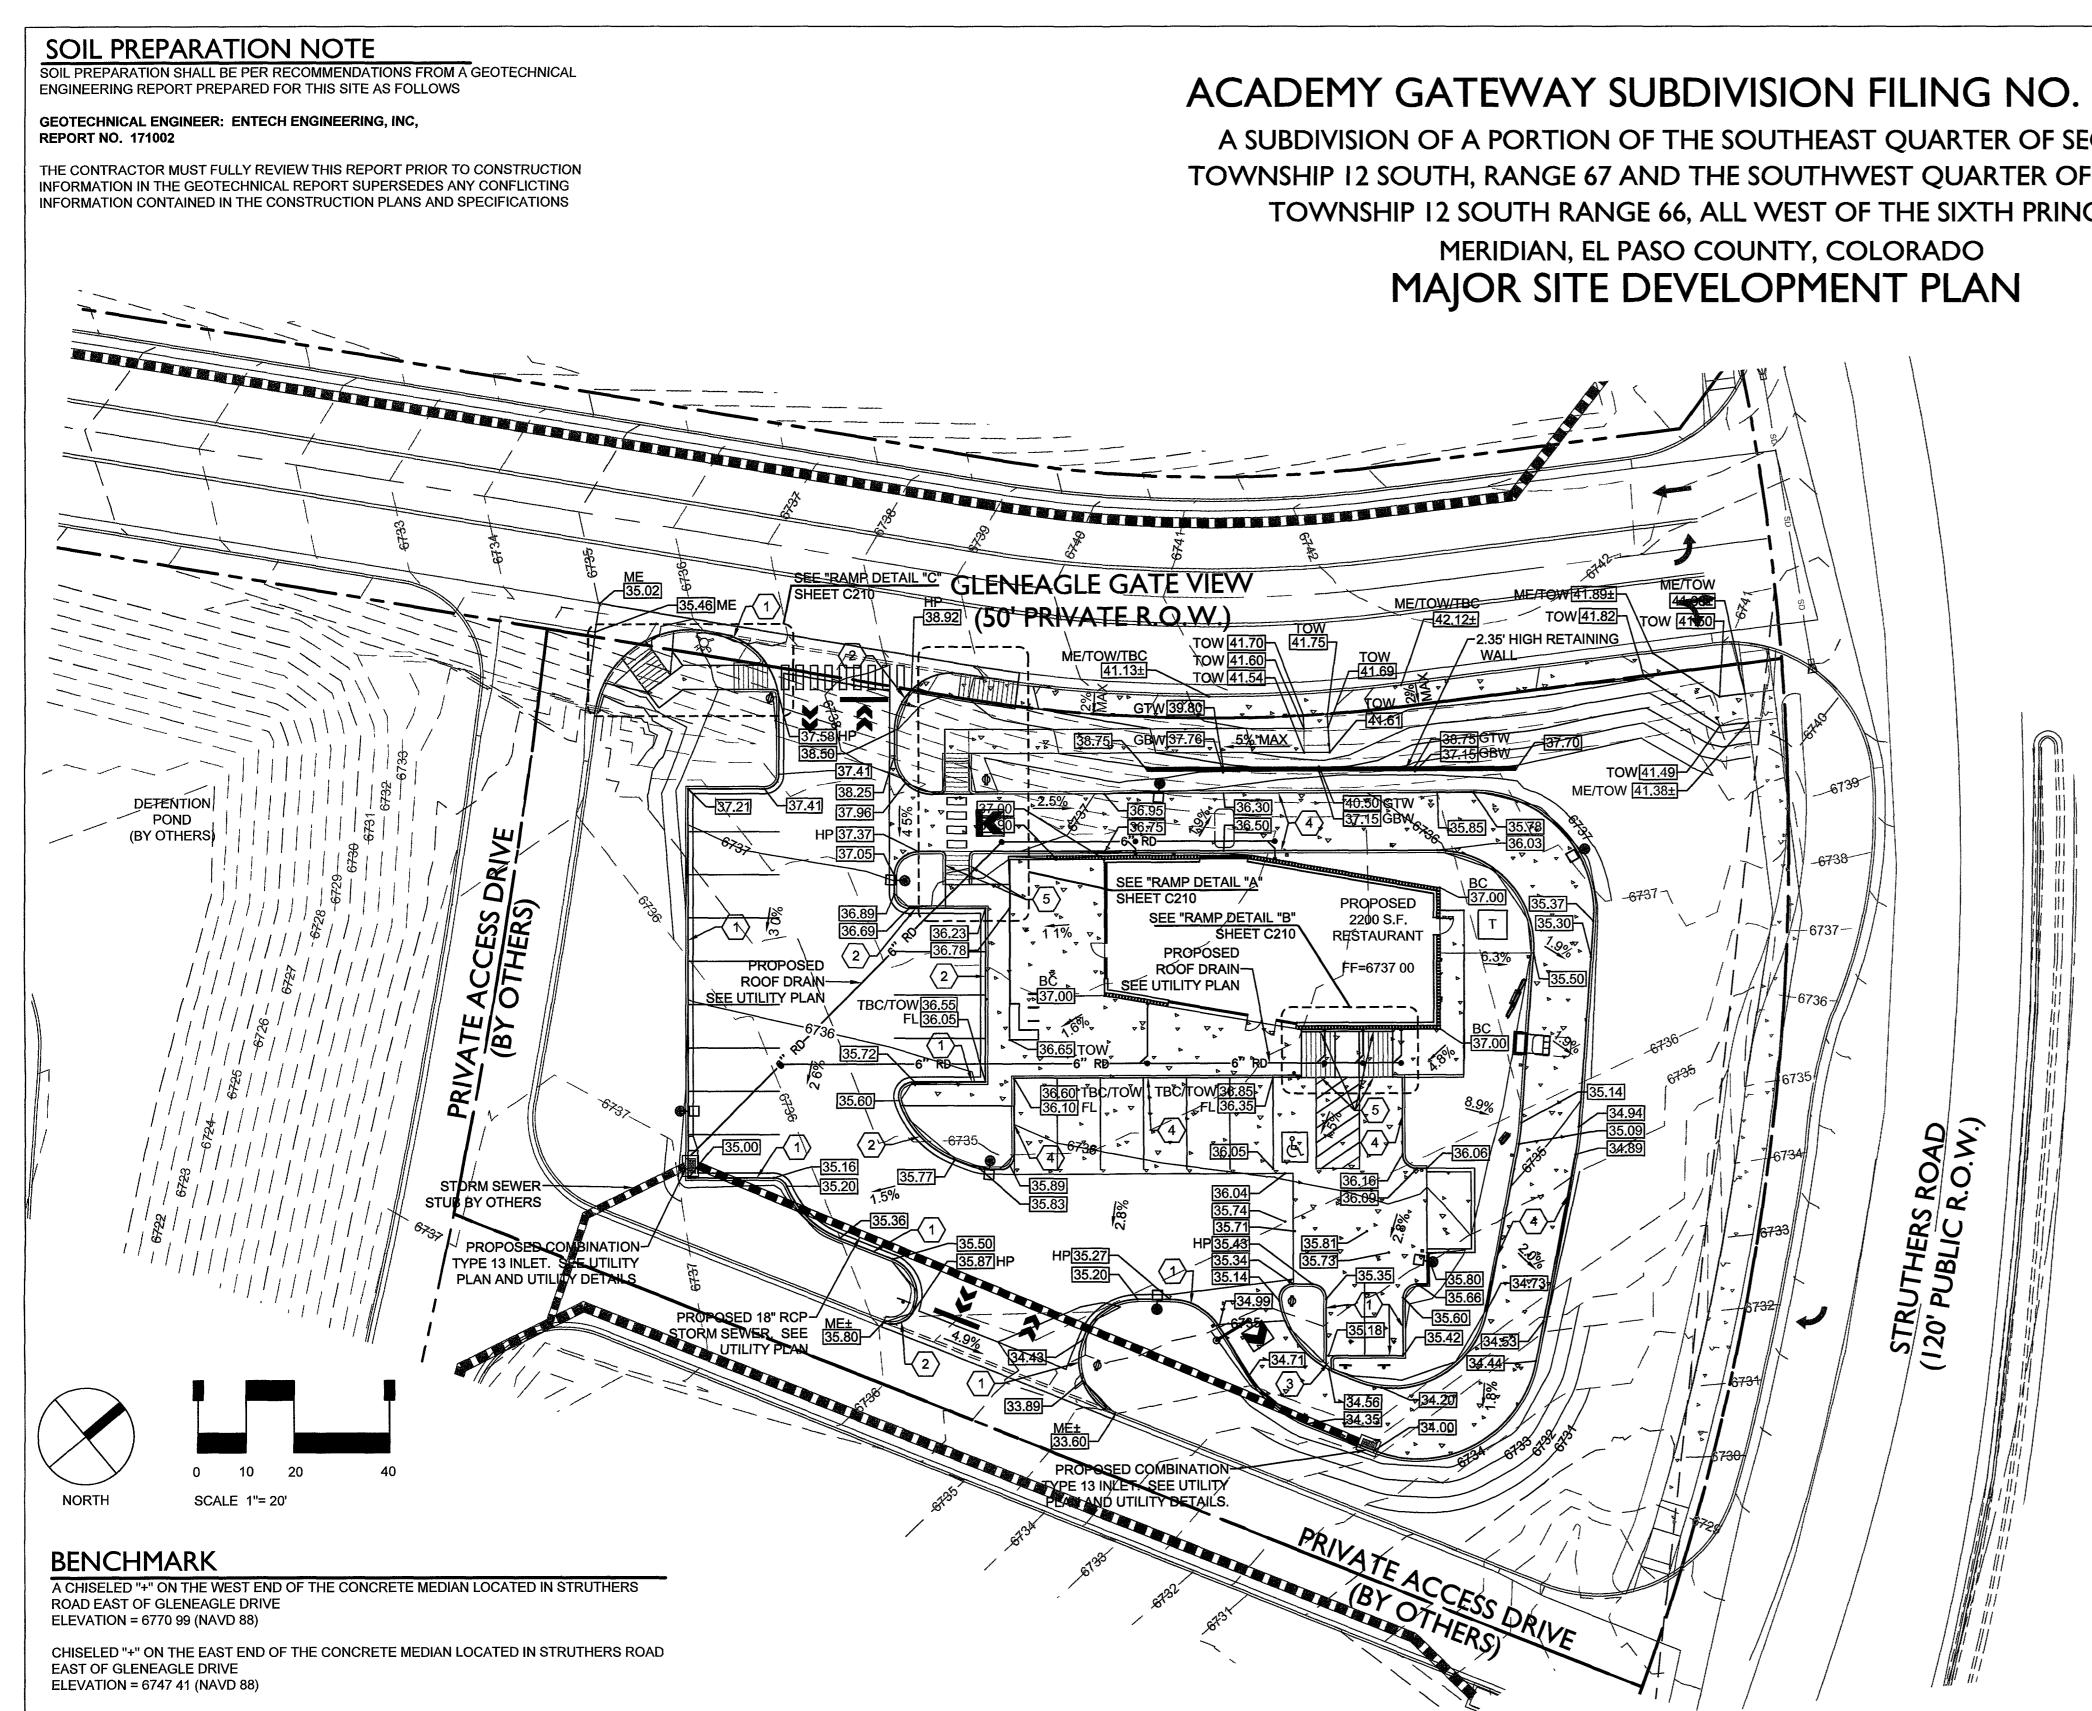

## PROPOSED WITHIN DISTURBED AREA

TOTAL LAND DISTURBANCE FOR PROJECT 37,794 SQ FT.± 0.87 ACRES±

## **CAUTION - NOTICE TO CONTRACTOR**

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE THE CONTRACTOR MUST CALL THE LOCAL UTILITY LOCATION CENTER AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATIONS OF THE UTILITIES IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING IMPROVEMENTS AND UTILITIES AND SHALL REPAIR ANY DAMAGE AT HIS EXPENSE



**GRADING LEGEND** 

	R O W / PROPERTY LINE
	ADJOINING PROPERTY
	EASEMENT LINE
	EXISTING TO REMAIN
	PROP CURB AND GUTTER
	PROPOSED STORM SEWE
6" RD	PROPOSED UNDERGROUN ROOF DRAIN LINE
	PROPOSED STORM INLET
	EXIST CONTOUR
7512	PROP CONTOUR
7.53	PROP SPOT ELEVATION
~51300g	EXIST SPOT ELEVATION
0.58%	PROP SLOPE

# ACADEMY GATEWAY SUBDIVISION FILING NO. 1 LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

## **GENERAL GRADING NOTES**

## **ENGINEER'S STATEMENT**

THIS GRADING AND EROSION CONTROL PLAN WAS PREPARED UNDER MY DIRECTION AND SUPERVISION AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF SAID PLAN HAS BEEN PREPARED TO THE CRITERIA ESTABLISHED BY THE COUNTY FOR GRADING AND EROSION CONTROL PLANS I ACCEPT RESPONSIBILITY FOR ANY LIABILITY CAUSED BY ANY NEGLIGENT ACTS, ERRORS, OR OMISSIONS ON MY PART IN PREPARING THIS REPORT

### NAME



COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH COUNTY DESIGN CRITERIA THE COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN. DIMENSIONS, AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED AT THE JOB SITE THE COUNTY THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT

AMENDED

EXIST. MANHOLE (S) EXIST FIRE HYDRANT EXIST WATER VALVE TBC TOP BACK OF CURB HP HIGH POINT TOP OF WALK TOW ME MATCH EXISTING EC EDGE OF CONCRETE GRADE AT TOP OF WALL GRADE AT BOTTOM OF WALL FLOW LINE GRADE BREAK

> BC BUILDING CORNER

## SCHEDULE NOTES

- (1) CONSTRUCT 6" VERTICAL CONCRETE CURB AND GUTTER WITH 1-FOOT CATCH PAN SEE SITE DETAILS
- $\langle 2 \rangle$  CONSTRUCT 6" VERTICAL CONCRETE CURB AND GUTTER WITH 1-FOOT SPILL PAN SEE SITE DETAILS
- (3) CONSTRUCT 1 0-FOOT WIDE CONCRETE RUNDOWN SEE SITE DETAILS
- (4) CONSTRUCT 6-INCH VERTICAL CONCRETE CURB CONTRACTOR MAY ELECT TO CONSTRUCT MONOLITHICALLY TO THE ADJOINING CONCRETE PAVING SEE SITE DETAILS
- $\langle 5 \rangle$  CURB VARIES IN HEIGHT FROM 0-INCHES TO 6-INCHES
- (6) CONSTRUCT HANDICAP PARKING AREA NO GRADES GREATER THAN 2 0% IN ANY DIRECTION CONTRACTOR TO VERIFY WITH CONSTRUCTION MANAGER AT FORM SET OR REMAIN SOLELY RESPONSIBLE FOR REMOVAL AND REPLACEMENT OF ANYU NON-ADA CONFORMING INSTALLATION

1 REFER TO SHEET 2 FOR ADDITIONAL PROJECT GENERAL NOTES

2 IF, DURING THE OVERLOT GRADING PROCESS, CONDITIONS ARE ENCOUNTERED BY THE CONTRACTOR, HIS SUBCONTRACTORS, OR OTHER AFFECTED PARTIES, WHICH COULD INDICATE A SITUATION THAT IS NOT IDENTIFIED IN THE PLANS OR SPECIFICATIONS, THE CONTRACTOR SHALL CONTACT THE GEOTECHNICAL ENGINEER IMMEDIATELY FOR RECOMMENDATIONS

3 ALL EARTHWORK, GRADING, OVERLOT GRADING, BACKFILLING, FILLING, EXCAVATION, COMPACTION, PAVEMENT, AND FLATWORK CONSTRUCTION WILL BE IN ACCORDANCE WITH THE RECOMMENDATIONS FROM THE GEOTECHNICAL INVESTIGATION PREPARED SPECIFICALLY FOR THIS SITE

4 ALL CONCRETE PAVEMENT, CONCRETE FLATWORK, CONCRETE STRUCTURES AND CONCRETE UTILITIES SHALL BE IN ACCORDANCE WITH THE MATERIAL RECOMMENDATIONS FROM THE GEOTECHNICAL INVESTIGATION PREPARED SPECIFICALLY FOR THIS SITE

5 THE EARTHWORK FOR ALL BUILDING FOUNDATIONS AND SLABS SHALL BE IN ACCORDANCE WITH ARCHITECTURAL AND STRUCTURAL PLANS AND SPECIFICATIONS, AND THE GEOTECHNICAL INVESTIGATION

SPOT ELEVATIONS SHALL TAKE PRECEDENCE OVER CONTOURS AND SLOPES SHOWN THE CONTRACTOR SHALL NOTIFY THE ENGINEER OF SPOT ELEVATIONS WHICH DO NOT APPEAR TO BE CONSISTENT WITH THE CONTOURS AND SLOPES SPOT ELEVATIONS AND SPECIFIC PROFILE DESIGN SHALL BE USED FOR SETTING ELEVATIONS OF CURB AND GUTTER AND UTILITIES

7 SPOT ELEVATIONS REPRESENT FLOWLINE (BOTTOM FACE OF CURB) WHERE SHOWN AT CURB AND GUTTER UNLESS OTHERWISE NOTED

8 CONTOURS SHOWN ARE FOR FINISHED PAVING, SIDEWALK, SLAB, OR GROUND ADJUSTMENT TO SUBGRADE IS THE CONTRACTOR'S RESPONSIBILITY

9 THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING HIS OWN ESTIMATE OF EARTHWORK QUANTITIES

10 REFER TO SITE PLAN FOR EXTENT OF PAVEMENT AND PAVEMENT SECTIONS

11 GRADES WITHIN ASPHALT PAVING AREAS SHALL BE CONSTRUCTED TO WITHIN 0 10 FEET OF THE DESIGN GRADE HOWEVER, THE CONTRACTOR SHALL MAINTAIN POSITIVE DRAINAGE IN ALL PAVEMENT AREAS AND ALONG CURBS ALL CURBS SHALL BE BUILT IN ACCORDANCE WITH THE PLAN CURBS OR PAVEMENT AREAS WHICH DO NOT PROVIDE PROPER DRAINAGE MUST BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE

12 THE CONTRACTOR SHALL HAVE FORMS CHECKED BY A SURVEYOR FOR CURB AND GUTTER ADJACENT TO EXISTING ASPHALT OR CONCRETE THE CROSS SLOPE SHALL NOT BE LESS THAN 2% OR GREATER THAN 4% FROM THE EXISTING SAWCUT LINE TO THE PROPOSED LIP OF GUTTER DO NOT PLACE CONCRETE IN FORMS THAT HAVE BEEN CHECKED TO BE OR APPEAR IN ANY WAY INCORRECT CONTACT THE ENGINEER IMMEDIATELY IF A PROBLEM SHOULD ARISE

13 THE CONTRACTOR SHALL ADJUST AND/OR CUT EXISTING PAVEMENT AS NECESSARY TO ASSURE A SMOOTH FIT AND CONTINUOUS GRADE

14 THE CONTRACTOR SHALL ASSURE POSITIVE DRAINAGE AWAY FROM BUILDINGS FOR ALL LANDSCAPED AND PAVED AREA

15 ALL DISTURBED AREAS THAT ARE NOT DESIGNATED TO BE PAVED SHALL BE LANDSCAPED OR SEEDED, ACCORDING TO THE LANDSCAPE PLAN

16 EXISTING DRAINAGE STRUCTURES SHALL BE INSPECTED AND REPAIRED AS NEEDED. AND EXISTING PIPES CLEANED OUT TO REMOVE ALL SILT AND DEBRIS

17 IF ANY EXISTING STRUCTURES, SIDEWALK, AND/OR CURB AND GUTTER MODIFIED OR TO REMAIN ARE DAMAGED DURING CONSTRUCTION, IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR AND/OR REPLACE THE EXISTING STRUCTURE AS NECESSARY TO RETURN IT TO EXISTING CONDITIONS OR BETTER PRIOR TO PROJECT CLOSEOUT

18 ALL GRATES, MANHOLE RIMS, VALVE BOXES, VALVE COVERS, CLEANOUTS, AND VAULT OR BOX COVERS SHALL BE ADJUSTED TO "AS CONSTRUCTED" FINISHED GRADE PRIOR TO THE FINAL LIFT OF ASPHALT

19 NO PROPOSED SLOPE IN LANDSCAPED AREAS OR OPEN SPACE SHALL EXCEED THREE (3) HORIZONTAL FEET TO ONE (1) VERTICAL FOOT, OR AS OTHERWISE SPECIFIED BY LOCAL CRITERIA

20 THE CONTRACTOR SHALL PROTECT THE PROJECT BENCHMARK THROUGHOUT CONSTRUCTION AND SET ADDITIONAL PROJECT BENCHMARKS AS NECESSARY TO MAINTAIN VERTICAL CONTROL THROUGHOUT THE DURATION OF THE PROJECT

21 THE CONTRACTOR SHALL FILL AND COMPACT BASEMENTS, CESSPOOLS, AND OTHER LARGE EXCAVATED AREAS WITH CLEAN FILL SUITABLE TO THE OWNER, AND IN ACCORDANCE WITH RECOMMENDATIONS OBTAINED FROM THE GEOTECHNICAL INVESTIGATION OR GEOTECHNICAL ENGINEER AND GRADE TO MATCH EXISTING OR PROPOSED FINISH GRADE, OR CONFIRM SUCH WORK HAS BEEN PERFORMED PRIOR TO CONSTRUCTION

10/3/2017 DATE

## OWNER'S STATEMENT

THE OWNER WILL COMPLY WITH THE REQUIREMENTS OF THE GRADING AND EROSION

10/19/17 DATE

## **EL PASO COUNTY**

FILED IN ACCORDANCE WITH THE REQUIREMENTS OF THE EL PASO COUNTY LAND DEVELOPMENT CODE, DRAINAGE CRITERIA AND ENGINEERING CRITERIA MANUAL AS

# Approved

COUNTY ENGINEER / DIRECTOR By: Jennifer Irvine, County Engineer Date:10/26/2017 El Paso County Department of Public Work



COUNTY PROJECT NUMBER PPR-17-030

Sterling Design Associates, II CIVIL ENGINEERS - LANDSCAPE ARCHITECT 2009 W Littleton Blvd #300

ittleton, CO 80120 303 794 4727 ph www.SterlingDesignAssociates.co

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332

FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC



STERLING DESIGN ASSOCIATES, LLC

NO 1	DATE 5/16/2017	BY	JDS
DESCRI	PTION 1ST MAJOR SDP SUBMITTAL		
NO 2	DATE 8/24/2017	BY	JDS
DESCRI	PTION 2ND MAJOR SDP SUBMITTAL		
NO 3	DATE 9/13/2017	BY	JDS
DESCRI	PTION 3RD MAJOR SDP SUBMITTAL		
NO 4	DATE -	BY	-
DESCRI	PTION -		
NO 5	DATE -	BY	•
DESCRII	PTION -		
NO 6	DATE -	BY	-
DESCRI	PTION -		

DATE 9/13/2017	scale 1" = 20'
PROJECT MANAGER	PROJECT NO
DRAWN BY	DRAWING FILE

#### PROJECT

### **PROPOSED COFFEE SHOP 209 GLENEAGLE GATE VIEW** COLORADO SPRINGS, CO

### CLIENT


VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421

SHEET TITLE **GRADING PLAN** 

SHEET NUMBER


6 OF 21

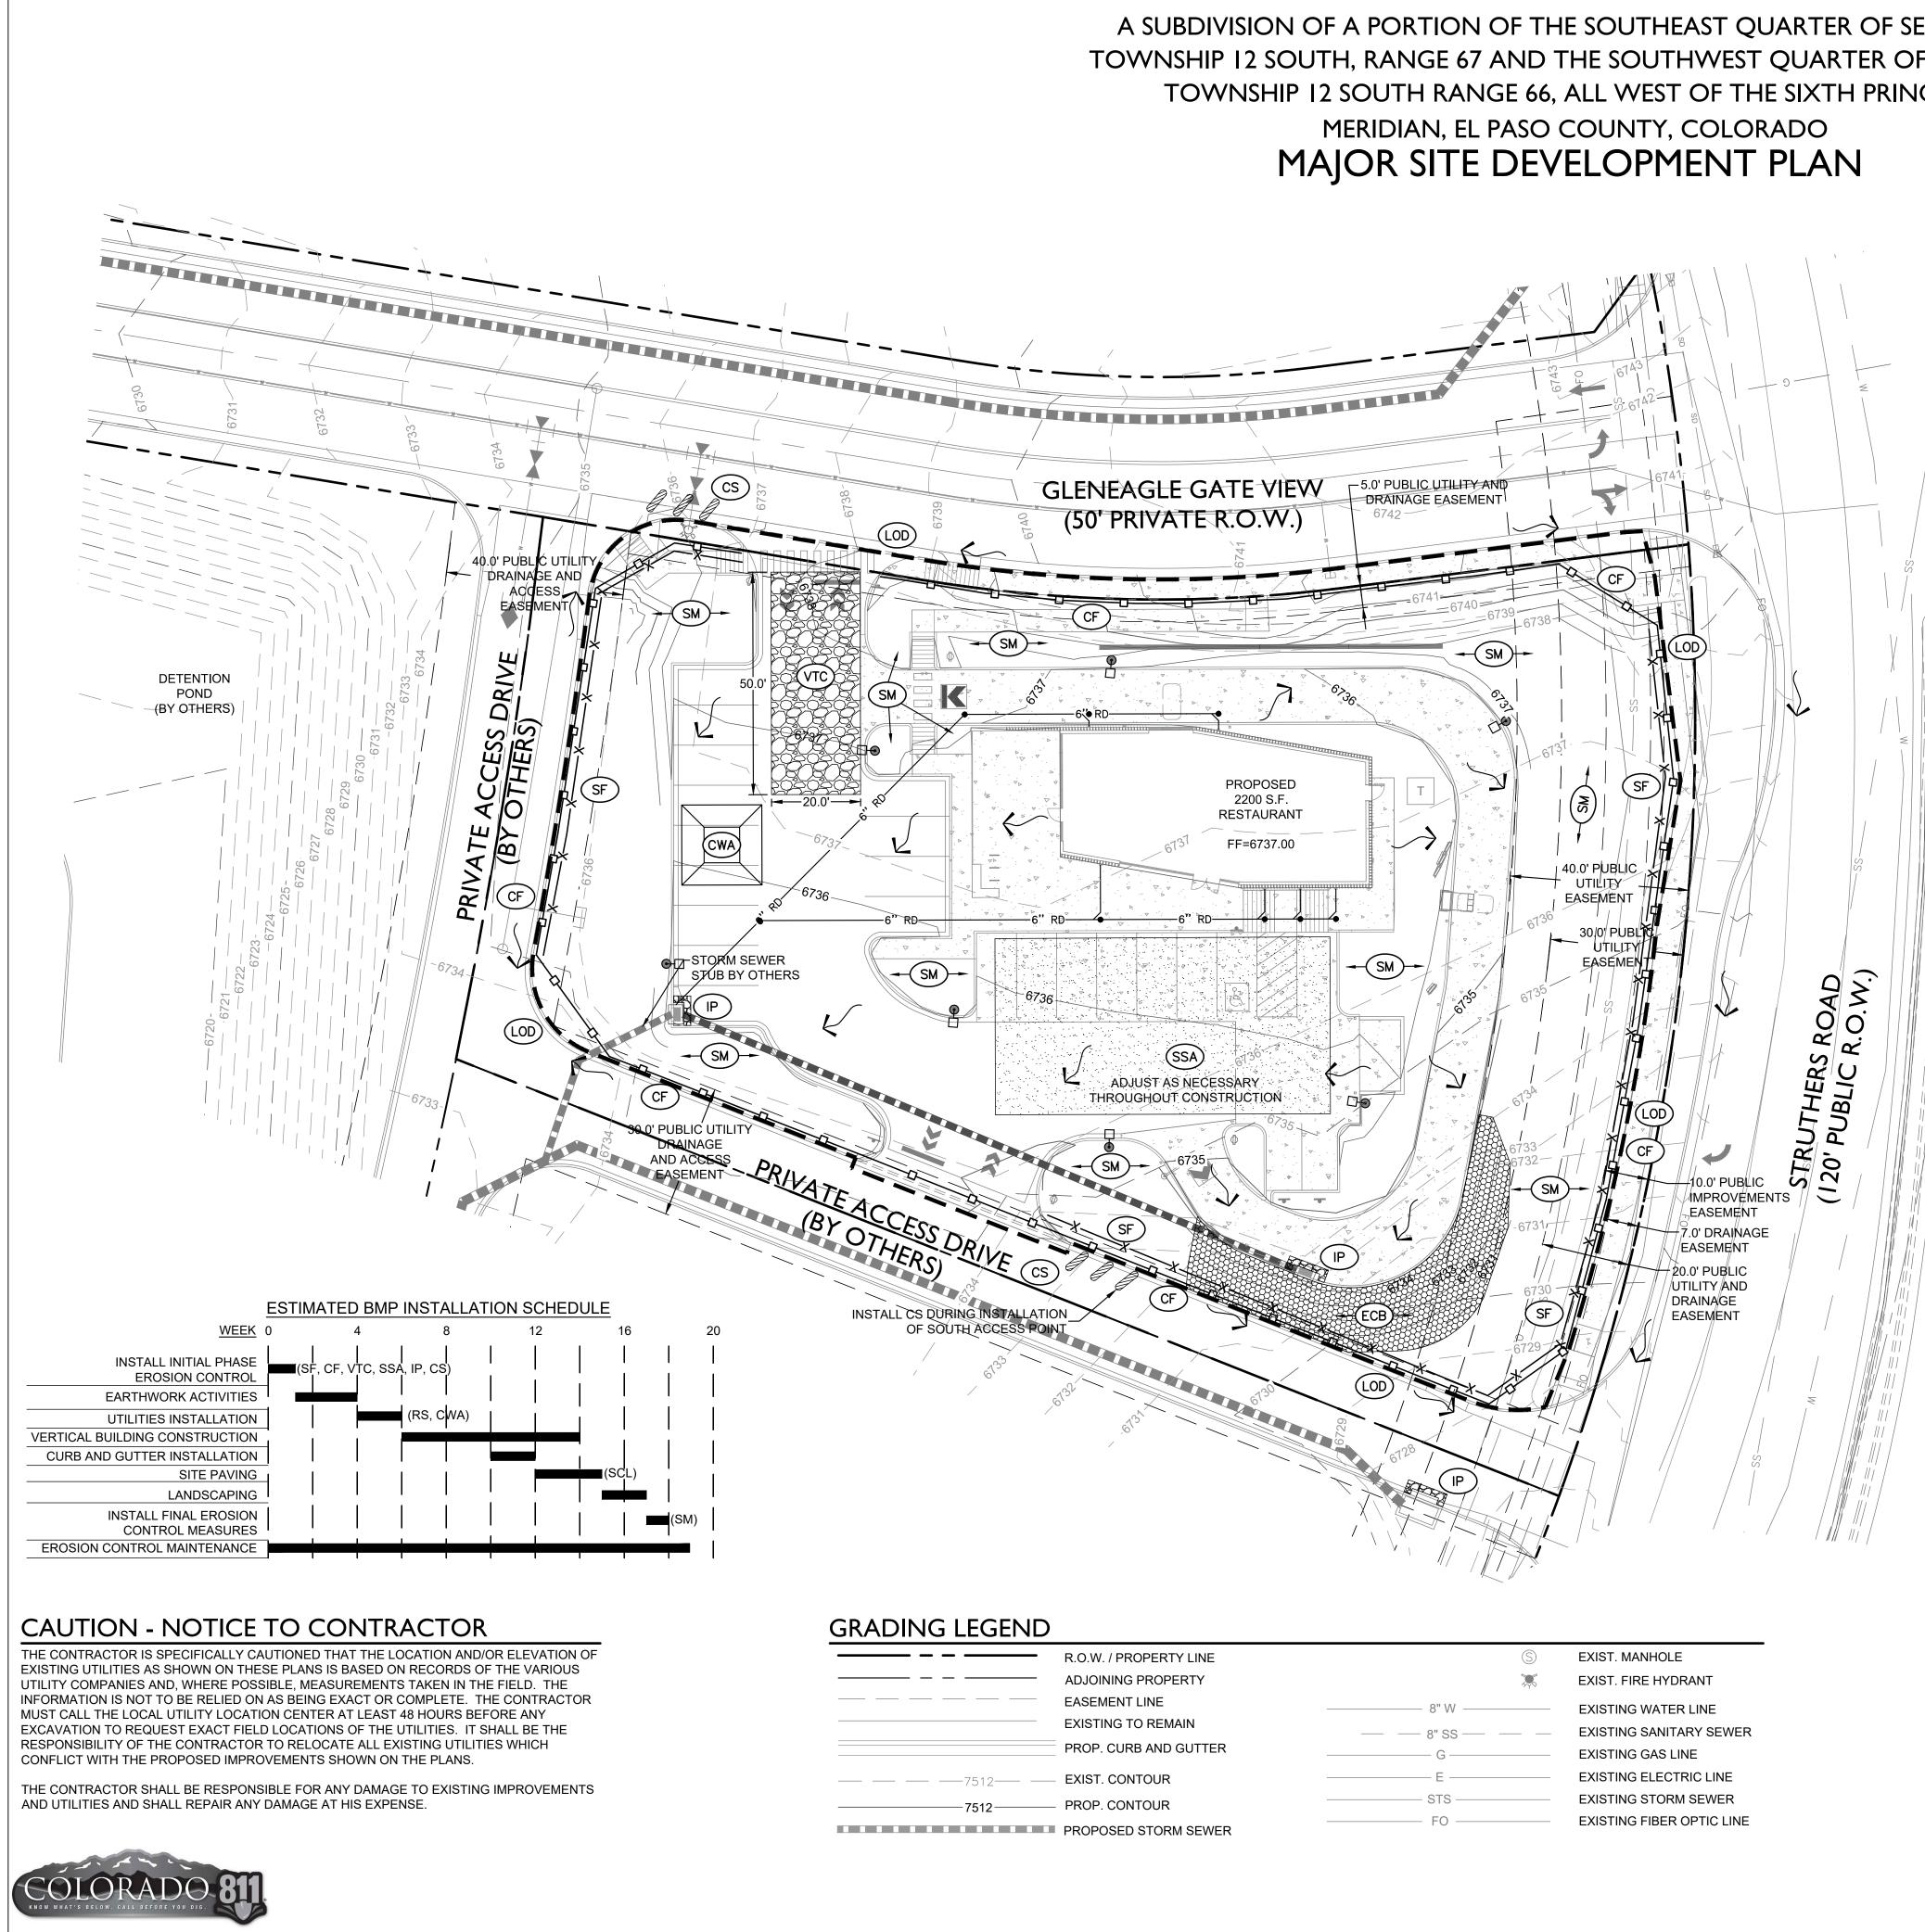



# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

R.O.W. / PROPERTY LINE		S	EXIST
ADJOINING PROPERTY		<b>X</b>	EXIST
EASEMENT LINE	8" W		EXIST
EXISTING TO REMAIN			EXIST
PROP. CURB AND GUTTER	G		EXIST
EXIST. CONTOUR	———— E ————		EXIST
PROP. CONTOUR	STS		EXIST
PROPOSED STORM SEWER	FO		EXIST

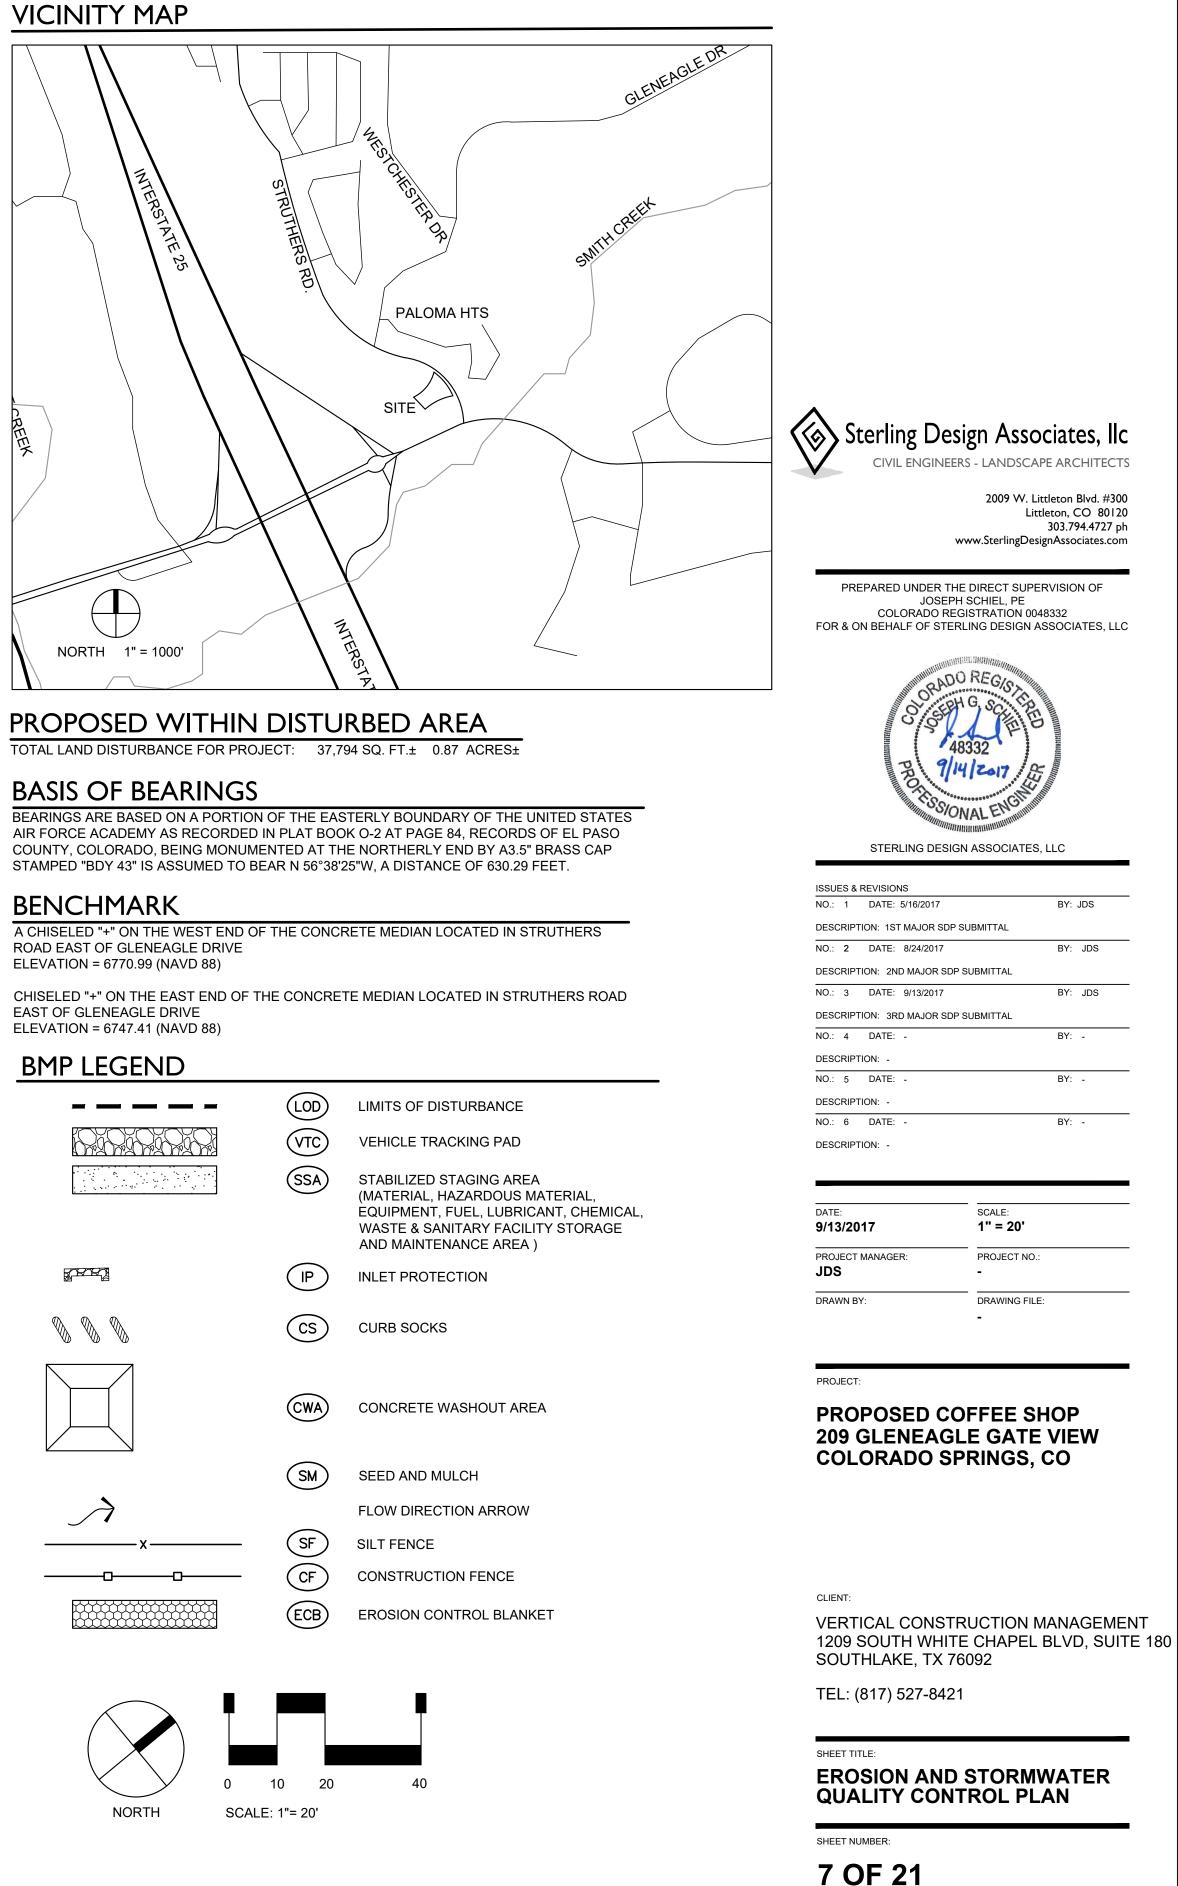

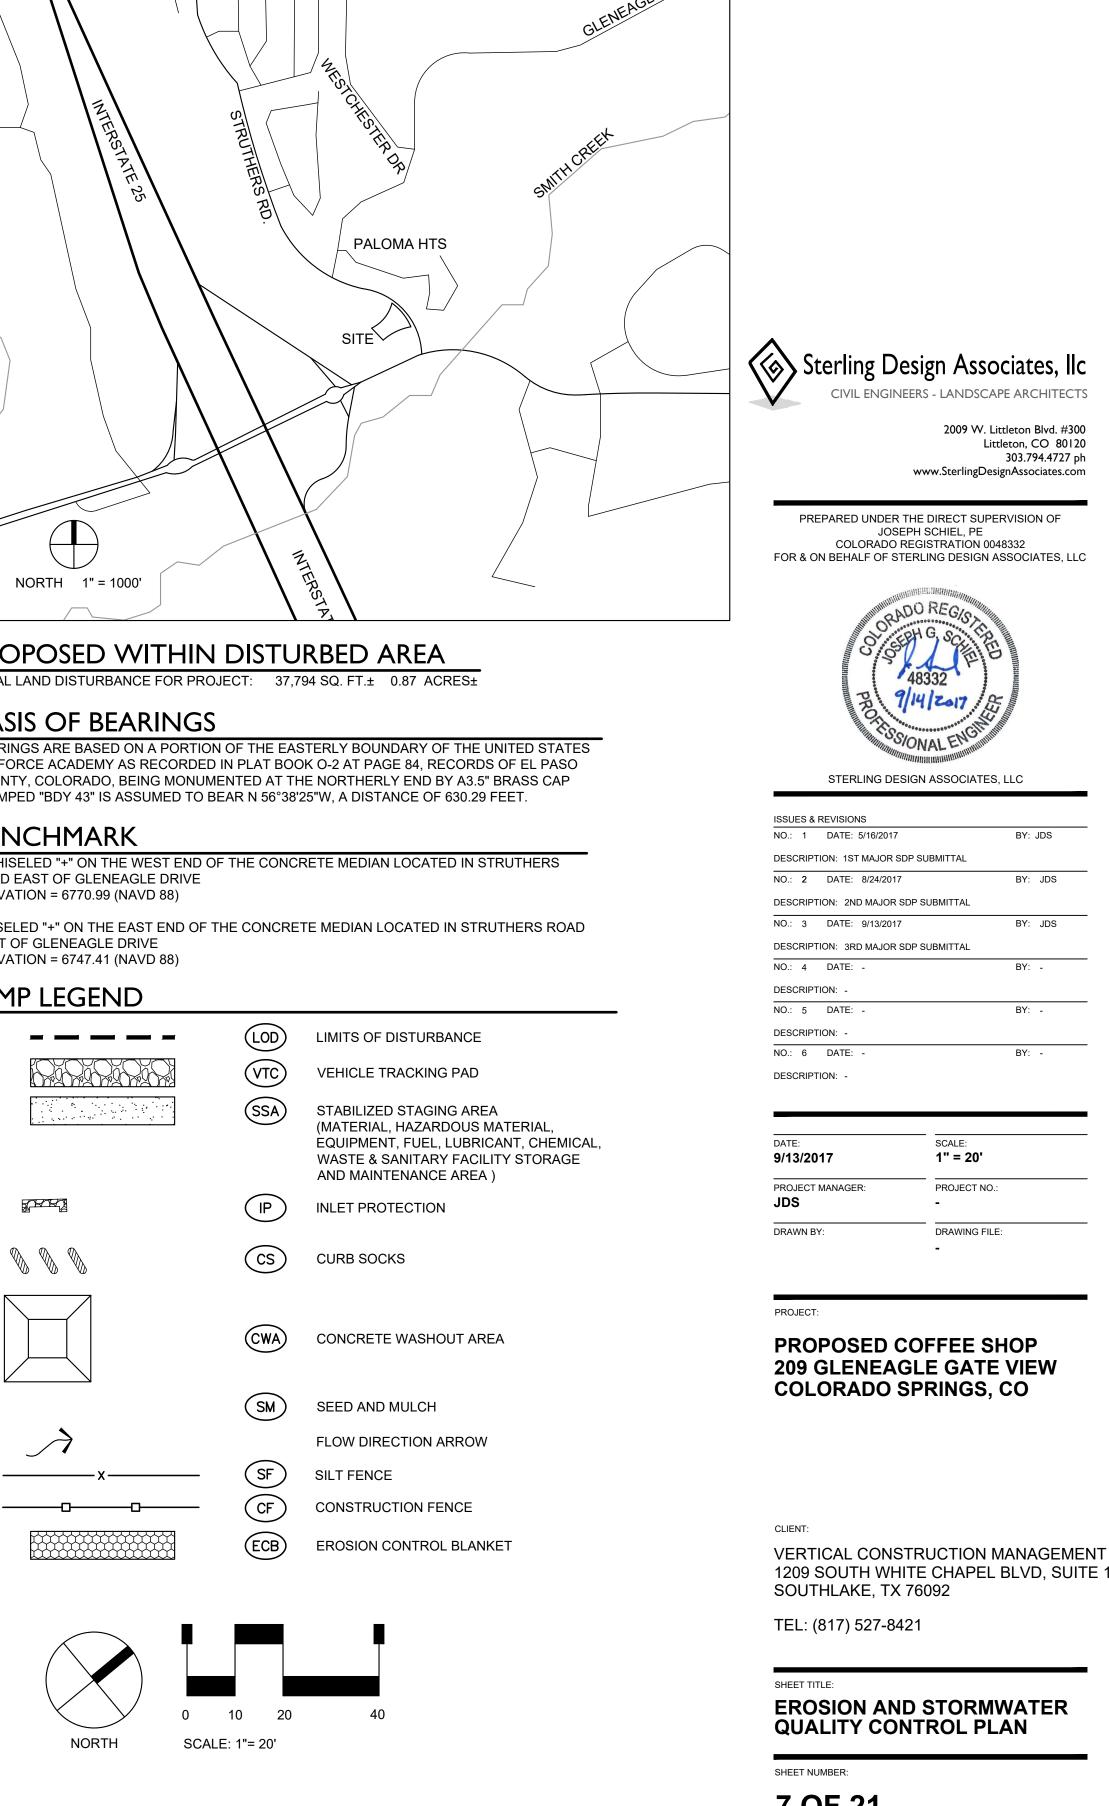



### **GENERAL NOTES**

- 1. REFER TO SHEET C100, C101, C304, AND C402 FOR ADDITIONAL PROJECT NOTES.
- 2. THE OWNER, SITE DEVELOPER, CONTRACTOR AND/OR THEIR AUTHORIZED AGENTS SHALL REMOVE ALL SEDIMENT, MUD, CONSTRUCTION DEBRIS, OR OTHER POTENTIAL POLLUTANTS THAT MAY HAVE BEEN DISCHARGED TO OR, ACCUMULATE IN, THE FLOWLINES AND PUBLIC RIGHTS OF WAYS OF THE CITY AS A RESULT OF CONSTRUCTION ACTIVITIES ASSOCIATED WITH THIS SITE DEVELOPMENT OR CONSTRUCTION PROJECT. SAID REMOVAL SHALL BE CONDUCTED IN A TIMELY MANNER.
- ADDITIONAL EROSION AND SEDIMENT CONTROL MEASURES MAY BE REQUIRED OF THE OWNER AND HIS OR 3. HER AGENTS DUE TO UNFORESEEN EROSION PROBLEMS OR IF THE PLAN AS SUBMITTED AND APPROVED DOES NOT FUNCTION AS INTENDED. THE REQUIREMENTS OF THIS PLAN SHALL BE THE OBLIGATION OF THE LAND OWNER AND/ OR HIS SUCCESSORS OR HEIRS; UNTIL SUCH TIME AS THE PLAN IS PROPERLY COMPLETED. MODIFIED, OR VOIDED.
- 4. THE CONTRACTOR SHALL PREVENT SEDIMENT, DEBRIS AND ALL OTHER POLLUTANTS FROM ENTERING THE STORM SEWER SYSTEM DURING ALL DEMOLITION, EXCAVATION, TRENCHING, BORING, GRADING OR OTHER CONSTRUCTION OPERATIONS THAT ARE PART OF THIS PROJECT. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR REMEDIATION OF ANY ADVERSE IMPACTS TO ADJACENT WATERWAYS, WETLANDS. ETC. RESULTING FROM WORK DONE AS PART OF THIS PROJECT.
- 5. THE CONTRACTOR SHALL LOCATE, INSTALL, AND MAINTAIN ALL EROSION CONTROL AND WATER QUALITY "BEST MANAGEMENT PRACTICES" AS INDICATED ON THE APPROVED PLAN.
- 6. THE DEVELOPER, GENERAL CONTRACTOR, GRADING CONTRACTOR AND/OR THEIR AUTHORIZED AGENTS SHALL INSURE THAT ALL LOADS OF CUT AND FILL MATERIAL IMPORTED TO OR EXPORTED FROM THIS SITE SHALL BE PROPERLY COVERED TO PREVENT LOSS OF THE MATERIAL DURING TRANSPORT ON PUBLIC RIGHTS OF WAYS.
- THE USE OF REBAR, STEEL STAKES, OR STEEL FENCE POSTS TO STAKE DOWN STRAW OR HAY BALES; OR TO SUPPORT SILT FENCING USED AS AN EROSION CONTROL MEASURE; IS PROHIBITED. THE USE OF OSHA APPROVED COLORED WARNING CAPS ON REBAR OR FENCE POSTS USED WITH EROSION CONTROL MEASURES IS NOT ACCEPTABLE.
- APPROVED EROSION AND SEDIMENT CONTROL "BEST MANAGEMENT PRACTICES" (BMP) SHALL BE MAINTAINED AND KEPT IN GOOD REPAIR FOR THE DURATION OF THIS PROJECT. AT A MINIMUM, THE CONTRACTOR OR HIS AGENT SHALL INSPECT ALL BMPS WEEKLY AND WITHIN 24 HOURS AFTER SIGNIFICANT PRECIPITATION EVENTS. ALL NECESSARY MAINTENANCE AND REPAIR SHALL BE COMPLETED IN A TIMELY MANNER. SEDIMENT WILL BE REMOVED AND DEVICES REPAIRED AS SOON AS PRACTICABLE. ACCUMULATED SEDIMENT AND DEBRIS SHALL BE REMOVED FROM A BMP WHEN THE SEDIMENT LEVEL REACHES ONE HALF THE HEIGHT OF THE BMP, AT ANY TIME THAT SEDIMENT OR DEBRIS ADVERSELY IMPACTS THE FUNCTIONING OF THE BMP, OR IN ACCORDANCE WITH LOCAL, STATE, AND FEDERAL REGULATIONS. ALL INSPECTION, MAINTENANCE, AND REPAIR PRACTICES SHALL MEET APPLICABLE LOCAL, STATE, AND FEDERAL REGULATIONS.
- 9. THE CONTRACTOR SHALL PROVIDE CONTROL MEASURES TO PREVENT OR MINIMIZE THE IMPACT TO RECIEVEING WATERS AS REQUIRED BY THE PLANS. THE CONTRACTOR SHALL EFFECTIVELY PREVENT AND CONTROL EROSION AND SEDIMENTATION ON CONSTRUCTION SITES AT THE EARLIEST PRACTICABLE TIME. IN GENERAL, CONTROL MEASURES WILL BE IMPLEMENTED PRIOR TO THE COMMENCEMENT OF EACH CONSTRUCTION OPERATION OR IMMEDIATELY AFTER THE AREA HAS BEEN DISTURBED. CONSTRUCTION STAGING AREAS AND VEHICLE MAINTENANCE ACTIVITIES SHALL BE MANAGED AND CONTROLLED SO AS TO MINIMIZE THE RUNOFF OF POLLUTANTS. DISTURBANCE OF VEGETATION SHALL BE MINIMIZED AND LIMITED TO ONLY WHAT IS SHOWN ON THE CONSTRUCTION PLANS. ALL EROSION, SEDIMENT AND WATER POLLUTION CONTROLS WILL BE MAINTAINED IN GOOD WORKING ORDER.
- 10. WATER USED IN THE CLEANING OF CEMENT TRUCK DELIVERY CHUTES SHALL BE DISCHARGED INTO A PREDEFINED. CONTAINMENT AREA ON THE JOB SITE. THE DISCHARGE OF WATER CONTAINING CEMENT TO THE STORM SEWER SYSTEM IS PROHIBITED.
- 11. THE CONTRACTOR SHALL PROTECT ALL STORM SEWER FACILITIES ADJACENT TO ANY LOCATION WHERE PAVEMENT CUTTING OPERATIONS INVOLVING WHEEL CUTTING, SAW CUTTING OR ABRASIVE WATER JET CUTTING ARE TO TAKE PLACE. THE CONTRACTOR SHALL REMOVE AND PROPERLY DISPOSE OF ALL WASTE PRODUCTS GENERATED BY SAID CUTTING OPERATIONS ON A DAILY BASIS. THE DISCHARGE OF ANY WATER CONTAMINATED BY WASTE PRODUCTS FROM CUTTING OPERATIONS TO THE STORM SEWER SYSTEM IS PROHIBITED.
- 12. PAVED SURFACES WHICH ARE ADJACENT TO CONSTRUCTION SITES SHALL BE SWEPT IN A TIMELY MANNER WHEN SEDIMENT AND OTHER MATERIALS ARE TRACKED OR DISCHARGED ON TO THEM. EITHER SWEEPING BY HAND OR USE OF STREET SWEEPERS IS ACCEPTABLE. STREET SWEEPERS USING WATER WHILE SWEEPING IS PREFERRED IN ORDER TO MINIMIZE DUST. FLUSHING OFF PAVED SURFACES WITH WATER IS PROHIBITED.
- 13. THE CONTRACTOR SHALL PROVIDE A DETAILED CONSTRUCTION SCHEDULE. THE SCHEDULE SHALL INCLUDE ALL MAJOR CONSTRUCTION ACTIVITIES AS WELL AS THE INSTALLATION OF PROPOSED EROSION CONTROL MEASURES, SEDIMENT/POLLUTANT CONTROL MEASURES, INTERIM AND FINAL SITE STABILIZATION MEASURES, PERMANENT EROSION PREVENTION MEASURES, AND PERMANENT WATER QUALITY ENHANCEMENT FACILITIES.
- 14. THE CONTRACTOR SHALL SUBMIT A SPILL PREVENTION AND MANAGEMENT PLAN. THE PLAN SHALL IDENTIFY THE MEASURES PROPOSED TO PREVENT THE DISCHARGE OF POLLUTANTS RESULTING FROM SPILLS AND EXPEDITE THE CLEANUP AND PROPER DISPOSAL OF SOILS CONTAMINATED BY CHEMICAL, PETROLEUM OR HAZARDOUS MATERIALS.
- 15. EXPOSURE OF SPOIL PILES CREATED DURING UTILITY TRENCHING SHOULD BE MINIMIZED. LOCATION OF SPOIL PILES SHOULD BE ON THE UPHILL SIDE OF THE TRENCH AND OUT OF THE WAY OF VISIBLE DRAINAGE PATHS.
- 16. STOCKPILES AND AREAS DISTURBED BY GRADING OPERATIONS SHALL BE STABILIZED FROM WIND AND WATER EROSION THROUGH THE USE OF A LAYER OF SUITABLE MULCH, TEMPORARY REVEGETATION, OR EROSION CONTROL MATTING/GEOTEXTILES AT A MINIMUM. ANY OF THESE METHODS SHALL BE APPLIED AT TIMES AND FREQUENCIES IN ACCORDANCE WITH LOCAL, STATE, AND FEDERAL REGULATIONS: (1) TO DISTURBED AREAS AND STOCKPILES AFTER FINAL GRADING IS REACHED, (2) TO DISTURBED AREAS WHICH MAY NOT BE AT FINAL GRADE, BUT WHICH WILL REMAIN DORMANT, AND (3) TO STOCKPILE CONSTRUCTION ON ANY STOCKPILE WHICH WILL REMAIN DORMANT . SAID STABILIZATION PRACTICES SHALL BE APPLIED PER MANUFACTURER AND/OR SUPPLIER RECOMMENDATIONS AND SHALL BE TACKED OR FASTENED BY AN APPROVED METHOD SUITABLE FOR THE TYPE OF PRODUCT USED.

### BMP MAINTENANCE NOTE

ALL EROSION AND SEDIMENT CONTROL PRACTICES AND OTHER PROTECTIVE MEASURES IDENTIFIED IN THE SWMP MUST BE MAINTAINED IN EFFECTIVE OPERATING CONDITION. PROPER SELECTION AND INSTALLATION OF BMPS AND IMPLEMENTATION OF COMPREHENSIVE INSPECTION AND MAINTENANCE PROCEDURES, IN ACCORDANCE WITH THE SWMP, SHOULD BE ADEQUATE TO MEET THIS CONDITION. BMPS THAT ARE NOT ADEQUATELY MAINTAINED IN ACCORDANCE WITH GOOD ENGINEERING, HYDROLOGIC AND POLLUTION CONTROL PRACTICES, INCLUDING REMOVAL OF COLLECTED SEDIMENT OUTSIDE THE ACCEPTABLE TOLERANCES OF THE BMPS, ARE CONSIDERED TO BE NO LONGER OPERATING EFFECTIVELY AND MUST BE ADDRESSED.



## EL PASO COUNTY STANDARD NOTES FOR GRADING AND EROSION CONTROL PLANS

CONSTRUCTION MAY NOT COMMENCE UNTIL A CONSTRUCTION PERMIT IS OBTAINED FROM PLANNING AND COMMUNITY DEVELOPMENT (PCD) AND A PRECONSTRUCTION CONFERENCE IS HELD WITH PCD INSPECTIONS.

2. STORMWATER DISCHARGES FROM CONSTRUCTION SITES SHALL NOT CAUSE OR THREATEN TO CAUSE POLLUTION, CONTAMINATION, OR DEGRADATION OF STATE WATERS. ALL WORK AND EARTH DISTURBANCE SHALL BE DONE IN A MANNER THAT MINIMIZES POLLUTION OF ANY ON-SITE OR OFF SITE WATERS, INCLUDING WETLANDS.

3. NOTWITHSTANDING ANYTHING DEPICTED IN THESE PLANS IN WORDS OR GRAPHIC REPRESENTATION, ALL DESIGN AND CONSTRUCTION RELATED TO ROADS. STORM DRAINAGE AND EROSION CONTROL SHALL CONFORM TO THE STANDARDS AND REQUIREMENTS OF THE MOST RECENT VERSION OF THE RELEVANT ADOPTED EL PASO COUNTY STANDARDS, INCLUDING THE LAND DEVELOPMENT CODE, THE ENGINEERING CRITERIA MANUAL, THE DRAINAGE CRITERIA MANUAL, AND THE DRAINAGE CRITERIA MANUAL VOLUME 2. ANY DEVIATIONS TO REGULATIONS AND STANDARDS MUST BE REQUESTED. AND APPROVED. IN WRITING.

4. A SEPARATE STORMWATER MANAGEMENT PLAN (SMWP) FOR THIS PROJECT SHALL BE COMPLETED AND AN EROSION AND STORMWATER QUALITY CONTROL PERMIT (ESQCP) ISSUED PRIOR TO COMMENCING CONSTRUCTION. DURING CONSTRUCTION THE SWMP IS THE RESPONSIBILITY OF THE DESIGNATED STORMWATER MANAGER, SHALL BE LOCATED ON SITE AT ALL TIMES AND SHALL BE KEPT UP TO DATE WITH WORK PROGRESS AND CHANGES IN THE FIELD.

5. ONCE THE ESOCP HAS BEEN ISSUED. THE CONTRACTOR MAY INSTALL THE INITIAL STAGE EROSION AND SEDIMENT CONTROL BMPS AS INDICATED ON THE GEC. A PRECONSTRUCTION MEETING BETWEEN THE CONTRACTOR, ENGINEER, AND EL PASO COUNTY WILL BE HELD PRIOR TO ANY CONSTRUCTION. IT IS THE RESPONSIBILITY OF THE APPLICANT TO COORDINATE THE MEETING TIME AND PLACE WITH COUNTY DS INSPECTIONS STAFF.

6. SOIL EROSION CONTROL MEASURES FOR ALL SLOPES, CHANNELS, DITCHES, OR ANY DISTURBED LAND AREA SHALL BE COMPLETED WITHIN 21 CALENDAR DAYS AFTER FINAL GRADING, OR FINAL EARTH DISTURBANCE, HAS BEEN COMPLETED. DISTURBED AREAS AND STOCKPILES WHICH ARE NOT AT FINAL GRADE BUT WILL REMAIN DORMANT FOR LONGER THAN 30 DAYS SHALL ALSO BE MULCHED WITHIN 21 DAYS AFTER INTERIM GRADING. AN AREA THAT IS GOING TO REMAIN IN AN INTERIM STATE FOR MORE THAN 60 DAYS SHALL ALSO BE SEEDED. ALL TEMPORARY SOIL EROSION CONTROL MEASURES AND BMPS SHALL BE MAINTAINED UNTIL PERMANENT SOIL EROSION CONTROL MEASURES ARE IMPLEMENTED AND ESTABLISHED.

TEMPORARY SOIL EROSION CONTROL FACILITIES SHALL BE REMOVED AND EARTH DISTURBANCE AREAS GRADED AND STABILIZED WITH PERMANENT SOIL EROSION CONTROL MEASURES PURSUANT TO STANDARDS AND SPECIFICATION PRESCRIBED IN THE DCM VOLUME II AND THE ENGINEERING CRITERIA MANUAL (ECM) APPENDIX I.

ALL PERSONS ENGAGED IN EARTH DISTURBANCE SHALL IMPLEMENT AND MAINTAIN ACCEPTABLE SOIL EROSION AND SEDIMENT CONTROL MEASURES INCLUDING BMPS IN CONFORMANCE WITH THE EROSION CONTROL TECHNICAL STANDARDS OF THE DRAINAGE CRITERIA MANUAL (DCM) VOLUME II AND IN ACCORDANCE WITH THE STORMWATER MANAGEMENT PLAN (SWMP).

9. ALL TEMPORARY EROSION CONTROL FACILITIES INCLUDING BMPS AND ALL PERMANENT FACILITIES INTENDED TO CONTROL EROSION OF ANY EARTH DISTURBANCE OPERATIONS, SHALL BE INSTALLED AS DEFINED IN THE APPROVED PLANS, THE SWMP AND THE DCM VOLUME II AND MAINTAINED THROUGHOUT THE DURATION OF THE EARTH DISTURBANCE OPERATION.

10. ANY EARTH DISTURBANCE SHALL BE CONDUCTED IN SUCH A MANNER SO AS TO EFFECTIVELY REDUCE ACCELERATED SOIL EROSION AND RESULTING SEDIMENTATION. ALL DISTURBANCES SHALL BE DESIGNED, CONSTRUCTED, AND COMPLETED SO THAT THE EXPOSED AREA OF ANY DISTURBED LAND SHALL BE LIMITED TO THE SHORTEST PRACTICAL PERIOD OF TIME.

11. ANY TEMPORARY OR PERMANENT FACILITY DESIGNED AND CONSTRUCTED FOR THE CONVEYANCE OF STORMWATER AROUND, THROUGH, OR FROM THE EARTH DISTURBANCE AREA SHALL BE DESIGNED TO LIMIT THE DISCHARGE TO A NON-EROSIVE VELOCITY.

12. CONCRETE WASH WATER SHALL BE CONTAINED AND DISPOSED OF IN ACCORDANCE WITH THE SWMP. NO WASH WATER SHALL BE DISCHARGED TO OR ALLOWED TO RUNOFF TO STATE WATERS, INCLUDING ANY SURFACE OR SUBSURFACE STORM DRAINAGE SYSTEM OR FACILITIES.

13. EROSION CONTROL BLANKETING IS TO BE USED ON SLOPES STEEPER THAN 3:1.

14. BUILDING, CONSTRUCTION, EXCAVATION, OR OTHER WASTE MATERIALS SHALL NOT BE TEMPORARILY PLACED OR STORED IN THE STREET. ALLEY. OR OTHER PUBLIC WAY. UNLESS IN ACCORDANCE WITH AN APPROVED TRAFFIC CONTROL PLAN. BMP'S MAY BE REQUIRED BY EL PASO COUNTY ENGINEERING IF DEEMED NECESSARY, BASED ON SPECIFIC CONDITIONS AND CIRCUMSTANCES.

15. VEHICLE TRACKING OF SOILS AND CONSTRUCTION DEBRIS OFF-SITE SHALL BE MINIMIZED. MATERIALS TRACKED OFFSITE SHALL BE CLEANED UP AND PROPERLY DISPOSED OF IMMEDIATELY.

16. CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL WASTES FROM THE CONSTRUCTION SITE FOR DISPOSAL IN ACCORDANCE WITH LOCAL AND STATE REGULATORY REQUIREMENTS. NO CONSTRUCTION DEBRIS, TREE SLASH, BUILDING MATERIAL WASTES OR UNUSED BUILDING MATERIALS SHALL BE BURIED, DUMPED, OR DISCHARGED AT THE SITE.

17. THE OWNER, SITE DEVELOPER, CONTRACTOR, AND/OR THEIR AUTHORIZED AGENTS SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL CONSTRUCTION DEBRIS, DIRT, TRASH, ROCK, SEDIMENT, AND SAND THAT MAY ACCUMULATE IN THE STORM SEWER OR OTHER DRAINAGE CONVEYANCE SYSTEM AND STORMWATER APPURTENANCES AS A RESULT OF SITE DEVELOPMENT.

18. THE QUANTITY OF MATERIALS STORED ON THE PROJECT SITE SHALL BE LIMITED, AS MUCH AS PRACTICAL, TO THAT QUANTITY REQUIRED TO PERFORM THE WORK IN AN ORDERLY SEQUENCE. ALL MATERIALS STORED ON-SITE SHALL BE STORED IN A NEAT, ORDERLY MANNER, IN THEIR ORIGINAL CONTAINERS, WITH ORIGINAL MANUFACTURER'S LABELS.

19. NO CHEMICALS ARE TO BE USED BY THE CONTRACTOR, WHICH HAVE THE POTENTIAL TO BE RELEASED IN STORMWATER UNLESS PERMISSION FOR THE USE OF A SPECIFIC CHEMICAL IS GRANTED IN WRITING BY THE ECM ADMINISTRATOR. IN GRANTING THE USE OF SUCH CHEMICALS, SPECIAL CONDITIONS AND MONITORING MAY BE REQUIRED.

20. BULK STORAGE STRUCTURES FOR PETROLEUM PRODUCTS AND OTHER CHEMICALS SHALL HAVE ADEQUATE PROTECTION SO AS TO CONTAIN ALL SPILLS AND PREVENT ANY SPILLED MATERIAL FROM ENTERING STATE WATERS, INCLUDING ANY SURFACE OR SUBSURFACE STORM DRAINAGE SYSTEM OR FACILITIES.

GUTTER OR IN THE DITCHLINE.

22. INDIVIDUALS SHALL COMPLY WITH THE "COLORADO WATER QUALITY CONTROL ACT" (TITLE 25, ARTICLE 8, CRS), AND THE "CLEAN WATER ACT" (33 USC 1344), IN ADDITION TO THE REQUIREMENTS INCLUDED IN THE DCM VOLUME II AND THE ECM APPENDIX I. ALL APPROPRIATE PERMITS MUST BE OBTAINED BY THE CONTRACTOR PRIOR TO CONSTRUCTION (NPDES, FLOODPLAIN, 404, FUGITIVE DUST, ETC.). IN THE EVENT OF CONFLICTS BETWEEN THESE REQUIREMENTS AND LAWS, RULES, OR REGULATIONS OF OTHER FEDERAL, STATE, OR COUNTY AGENCIES, THE MORE RESTRICTIVE LAWS, RULES, OR REGULATIONS SHALL APPLY.

23. ALL CONSTRUCTION TRAFFIC MUST ENTER/EXIT THE SITE AT APPROVED CONSTRUCTION ACCESS POINTS.

24. PRIOR TO ACTUAL CONSTRUCTION THE PERMITEE SHALL VERIFY THE LOCATION OF EXISTING UTILITIES.

# ACADEMY GATEWAY SUBDIVISION FILING NO. 1 LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

MERIDIAN, EL PASO COUNTY, COLORADO

# MAJOR SITE DEVELOPMENT PLAN

21. NO PERSON SHALL CAUSE THE IMPEDIMENT OF STORMWATER FLOW IN THE FLOW LINE OF THE CURB AND


24. A WATER SOURCE SHALL BE AVAILABLE ON SITE DURING EARTHWORK OPERATIONS AND UTILIZED AS REQUIRED TO MINIMIZE DUST FROM EARTHWORK EQUIPMENT AND WIND.

25. THE SOILS REPORT FOR THIS SITE HAS BEEN PREPARED BY ENTECH ENGINEERING, INC. AND SHALL BE CONSIDERED A PART OF THESE PLANS.

26. AT LEAST TEN DAYS PRIOR TO THE ANTICIPATED START OF CONSTRUCTION, FOR PROJECTS THAT WILL DISTURB 1 ACRE OR MORE, THE OWNER OR OPERATOR OF CONSTRUCTION ACTIVITY SHALL SUBMIT A PERMIT APPLICATION FOR STORMWATER DISCHARGE TO THE COLORADO DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT, WATER QUALITY DIVISION, THE APPLICATION CONTAINS CERTIFICATION OF COMPLETION OF A STORMWATER MANAGEMENT PLAN (SWMP), OF WHICH THIS GRADING AND EROSION CONTROL PLAN MAY BE A PART. FOR INFORMATION OR APPLICATION MATERIALS CONTACT:

COLORADO DEPARTMENT OF PUBLIC HEALTH AND ENVIRONMENT WATER QUALITY CONTROL DIVISION WQCD – PERMITS 4300 CHERRY CREEK DRIVE SOUTH DENVER, CO 80246-1530

ATTN: PERMITS UNIT

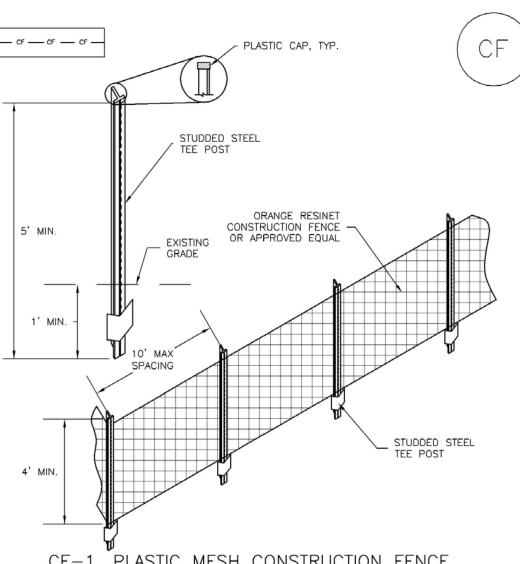

CF-1. PLASTIC MESH CONSTRUCTION FENCE CONSTRUCTION FENCE INSTALLATION NOTES

1. SEE PLAN VIEW FOR: -LOCATION OF CONSTRUCTION FENCE.

2. CONSTRUCTION FENCE SHOWN SHALL BE INSTALLED PRIOR TO ANY LAND DISTURBING

3. CONSTRUCTION FENCE SHALL BE COMPOSED OF ORANGE, CONTRACTOR-GRADE MATERIAL THAT IS AT LEAST 4' HIGH. METAL POSTS SHOULD HAVE A PLASTIC CAP FOR SAFETY. 4. STUDDED STEEL TEE POSTS SHALL BE UTILIZED TO SUPPORT THE CONSTRUCTION FENCE. MAXIMUM SPACING FOR STEEL TEE POSTS SHALL BE 10'.

5. CONSTRUCTION FENCE SHALL BE SECURELY FASTENED TO THE TOP, MIDDLE, AND BOTTOM OF EACH POST

CONSTRUCTION FENCE MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMP'S SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMP'S AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE

2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.

3. WHERE BMPS HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.

4. CONSTRUCTION FENCE SHALL BE REPAIRED OR REPLACED WHEN THERE ARE SIGNS OF DAMAGE SUCH AS RIPS OR SAGS. CONSTRUCTION FENCE IS TO REMAIN IN PLACE UNTIL THE UPSTREAM DISTURBED AREA IS STABILIZED AND APPROVED BY THE LOCAL JURISDICTION. 5. WHEN CONSTRUCTION FENCES ARE REMOVED, ALL DISTURBED AREAS ASSOCIATED WITH THE


INSTALLATION, MAINTENANCE, AND/OR REMOVAL OF THE FENCE SHALL BE COVERED WITH TOPSOIL, SEEDED AND MULCHED, OR OTHERWISE STABILIZED AS APPROVED BY LOCAL JURISDICTION

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED. (DETAIL ADAPTED FROM TOWN OF PARKER, COLORADO, NOT AVAILABLE IN AUTOCAD)



2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332 FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC

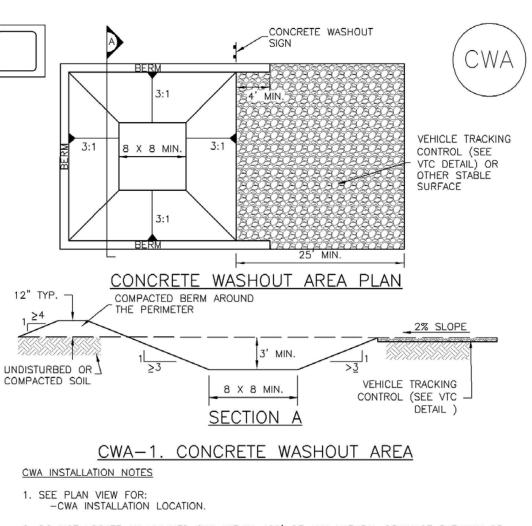

#### 2. DO NOT LOCATE AN UNLINED CWA WITHIN 400' OF ANY NATURAL DRAINAGE PATHWAY OR WATERBODY, DO NOT LOCATE WITHIN 1,000' OF ANY WELLS OR DRINKING WATER SOURCES. IF SITE CONSTRAINTS MAKE THIS INFEASIBLE, OR IF HIGHLY PERMEABLE SOILS EXIST ON SITE, THE CWA MUST BE INSTALLED WITH AN IMPERMEABLE LINER (16 MIL MIN. THICKNESS) OR SURFACE STORAGE ALTERNATIVES USING PREFABRICATED CONCRETE WASHOUT DEVICES OR A LINED ABOVE GROUND STORAGE ARE SHOULD BE USED.

3. THE CWA SHALL BE INSTALLED PRIOR TO CONCRETE PLACEMENT ON SITE. 4. CWA SHALL INCLUDE A FLAT SUBSURFACE PIT THAT IS AT LEAST 8' BY 8' SLOPES LEADING OUT OF THE SUBSURFACE PIT SHALL BE 3:1 OR FLATTER. THE PIT SHALL BE AT LEAST 3' DEEP.

5. BERM SURROUNDING SIDES AND BACK OF THE CWA SHALL HAVE MINIMUM HEIGHT OF 1'. 6. VEHICLE TRACKING PAD SHALL BE SLOPED 2% TOWARDS THE CWA.

7. SIGNS SHALL BE PLACED AT THE CONSTRUCTION ENTRANCE, AT THE CWA, AND ELSEWHERE AS NECESSARY TO CLEARLY INDICATE THE LOCATION OF THE CWA TO OPERATORS OF CONCRETE TRUCKS AND PUMP RIGS.

8. USE EXCAVATED MATERIAL FOR PERIMETER BERM CONSTRUCTION.

### CWA MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE

2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.

3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.

4. THE CWA SHALL BE REPAIRED, CLEANED, OR ENLARGED AS NECESSARY TO MAINTAIN CAPACITY FOR CONCRETE WASTE. CONCRETE MATERIALS, ACCUMULATED IN PIT, SHALL BE REMOVED ONCE THE MATERIALS HAVE REACHED A DEPTH OF 2'

5. CONCRETE WASHOUT WATER, WASTED PIECES OF CONCRETE AND ALL OTHER DEBRIS IN THE SUBSURFACE PIT SHALL BE TRANSPORTED FROM THE JOB SITE IN A WATER-TIGHT CONTAINER AND DISPOSED OF PROPERLY. 6. THE CWA SHALL REMAIN IN PLACE UNTIL ALL CONCRETE FOR THE PROJECT IS PLACED.

7. WHEN THE CWA IS REMOVED, COVER THE DISTURBED AREA WITH TOP SOIL, SEED AND MULCH OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION. (DETAIL ADAPTED FROM DOUGLAS COUNTY, COLORADO AND THE CITY OF PARKER, COLORADO, NOT AVAILABLE IN AUTOCAD). MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. ISULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.



ISSUES & REVISIONS	
NO.: 1 DATE: 5/16/2017	BY: JDS
DESCRIPTION: 1ST MAJOR SDR	P SUBMITTAL
NO.: 2 DATE: 8/24/2017	BY: JDS
DESCRIPTION: 2ND MAJOR SD	P SUBMITTAL
NO.: 3 DATE: 9/13/2017	BY: JDS
DESCRIPTION: 3RD MAJOR SD	OP SUBMITTAL
NO.: 4 DATE: -	BY: -
DESCRIPTION: -	
NO.: 5 DATE: -	BY: -
DESCRIPTION: -	
NO.: 6 DATE: -	BY: -
DESCRIPTION: -	
DATE:	SCALE:
9/13/2017	1'' = 20'
PROJECT MANAGER:	PROJECT NO.:

JDS DRAWN BY: DRAWING FILE:

#### PROJECT:

### PROPOSED COFFEE SHOP **209 GLENEAGLE GATE VIEW** COLORADO SPRINGS. CO

CLIENT:


VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421

SHEET TITLE

### EROSION AND STORMWATER QUALITY CONTROL DETAILS

SHEET NUMBER: 8 OF 21

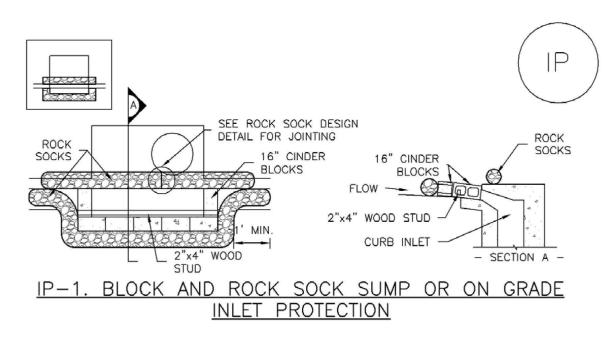

BLOCK AND CURB SOCK INLET PROTECTION INSTALLATION NOTES 1. SEE ROCK SOCK DESIGN DETAIL FOR INSTALLATION REQUIREMENTS.

2. CONCRETE "CINDER" BLOCKS SHALL BE LAID ON THEIR SIDES AROUND THE INLET IN A SINGLE ROW, ABUTTING ONE ANOTHER WITH THE OPEN END FACING AWAY FROM THE CURB. 3. GRAVEL BAGS SHALL BE PLACED AROUND CONCRETE BLOCKS, CLOSELY ABUTTING ONE ANOTHER AND JOINTED TOGETHER IN ACCORDANCE WITH ROCK SOCK DESIGN DETAIL. INLET PROTECTION MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.

. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.

3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.

4. SEDIMENT ACCUMULATED UPSTREAM OF INLET PROTECTION SHALL BE REMOVED AS NECESSARY TO MAINTAIN BMP EFFECTIVENESS, TYPICALLY WHEN STORAGE VOLUME REACHES 50% OF CAPACITY, A DEPTH OF 6" WHEN SILT FENCE IS USED, OR ¼ OF THE HEIGHT FOR STRAW BALES.


5. INLET PROTECTION IS TO REMAIN IN PLACE UNTIL THE UPSTREAM DISTURBED AREA IS PERMANENTLY STABILIZED, UNLESS THE LOCAL JURISDICTION APPROVES EARLIER REMOVAL OF INLET PROTECTION IN STREETS.


6. WHEN INLET PROTECTION AT AREA INLETS IS REMOVED, THE DISTURBED AREA SHALL BE COVERED WITH TOP SOIL, SEEDED AND MULCHED, OR OTHERWISE STABILIZED IN A MANNER APPROVED BY THE LOCAL JURISDICTION.

(DETAIL ADAPTED FROM TOWN OF PARKER, COLORADO AND CITY OF AURORA, COLORADO, NOT AVAILABLE IN AUTOCAD) NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

NOTE: THE DETAILS INCLUDED WITH THIS FACT SHEET SHOW COMMONLY USED, CONVENTIONAL METHODS OF INLET PROTECTION IN THE DENVER METROPOLITAN AREA. THERE ARE MANY PROPRIETARY INLET PROTECTION METHODS ON THE MARKET. UDFCD NEITHER ENDORSES NOR DISCOURAGES USE OF PROPRIETARY INLET PROTECTION; HOWEVER, IN THE EVENT PROPRIETARY METHODS ARE USED, THE APPROPRIATE DETAIL FROM THE MANUFACTURER MUST BE INCLUDED IN THE SWMP AND THE BMP MUST BE INSTALLED AND MAINTAINED AS SHOWN IN THE MANUFACTURER'S DETAILS.

NOTE: SOME MUNICIPALITIES DISCOURAGE OR PROHIBIT THE USE OF STRAW BALES FOR INLET PROTECTION. CHECK WITH LOCAL JURISDICTION TO DETERMINE IF STRAW BALE INLET PROTECTION IS ACCEPTABLE.



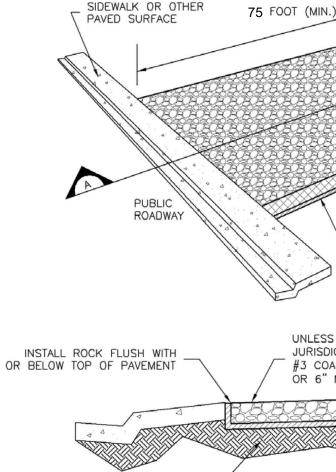

COMPACTED SUBGRADE SECTION

### VTC-1. AGGREGATE VEHICLE TRACKING CONTROL

STABILIZED CONSTRUCTION ENTRANCE/EXIT INSTALLATION NOTES

1. SEE PLAN VIEW FOR -LOCATION OF CONSTRUCTION ENTRANCE(S)/EXIT(S). -TYPE OF CONSTRUCTION ENTRANCE(S)/EXITS(S) (WITH/WITHOUT WHEEL WASH, CONSTRUCTION MAT OR TRM).

2. CONSTRUCTION MAT OR TRM STABILIZED CONSTRUCTION ENTRANCES ARE ONLY TO BE USED ON SHORT DURATION PROJECTS (TYPICALLY RANGING FROM A WEEK TO A MONTH) WHERE THERE WILL BE LIMITED VEHICULAR ACCESS.

3. A STABILIZED CONSTRUCTION ENTRANCE/EXIT SHALL BE LOCATED AT ALL ACCESS POINTS WHERE VEHICLES ACCESS THE CONSTRUCTION SITE FROM PAVED RIGHT-OF-WAYS. 4. STABILIZED CONSTRUCTION ENTRANCE/EXIT SHALL BE INSTALLED PRIOR TO ANY LAND DISTURBING ACTIVITIES.

5. A NON-WOVEN GEOTEXTILE FABRIC SHALL BE PLACED UNDER THE STABILIZED CONSTRUCTION ENTRANCE/EXIT PRIOR TO THE PLACEMENT OF ROCK.

SECT. #703, AASHTO #3 COARSE AGGREGATE OR 6" (MINUS) ROCK. STABILIZED CONSTRUCTION ENTRANCE/EXIT MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.

2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.

DISCOVERY OF THE FAILURE.

ENTRANCE/EXIT TO MAINTAIN A CONSISTENT DEPTH.

5. SEDIMENT TRACKED ONTO PAVED ROADS IS TO BE REMOVED THROUGHOUT THE DAY AND THE END OF THE DAY BY SHOVELING OR SWEEPING. SEDIMENT MAY NOT BE WASHED DOWN STORM SEWER DRAINS.


DIFFERENCES ARE NOTED.



# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

## MERIDIAN, EL PASO COUNTY, COLORADO MAJOR SITE DEVELOPMENT PLAN

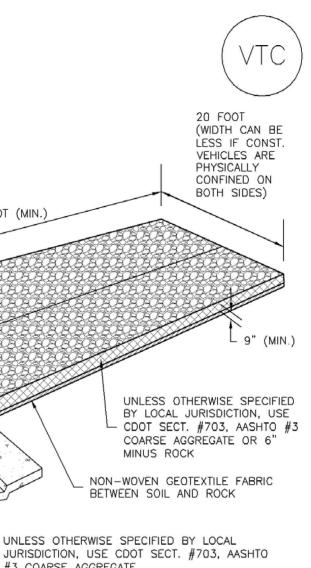

#3 COARSE AGGREGATE - 9" (MIN.) OR 6" MINUS ROCK NON-WOVEN GEOTEXTILE


6. UNLESS OTHERWISE SPECIFIED BY LOCAL JURISDICTION, ROCK SHALL CONSIST OF DOT

3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON

4. ROCK SHALL BE REAPPLIED OR REGRADED AS NECESSARY TO THE STABILIZED

### NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN

(DETAILS ADAPTED FROM CITY OF BROOMFIELD, COLORADO, NOT AVAILABLE IN AUTOCAD)

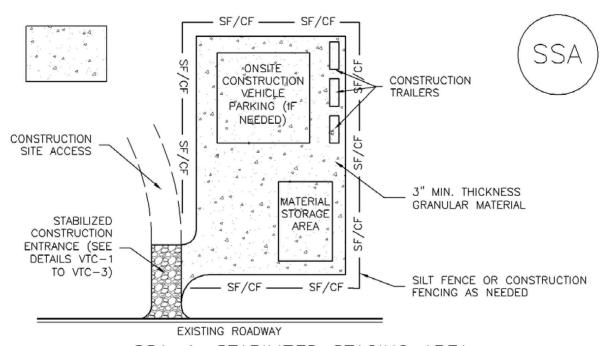

### SSA-1. STABILIZED STAGING AREA

STABILIZED STAGING AREA INSTALLATION NOTES

#### 1. SEE PLAN VIEW FOR

-LOCATION OF STAGING AREA(S). -CONTRACTOR MAY ADJUST LOCATION AND SIZE OF STAGING AREA WITH APPROVAL FROM THE LOCAL JURISDICTION.

2. STABILIZED STAGING AREA SHOULD BE APPROPRIATE FOR THE NEEDS OF THE SITE. OVERSIZING RESULTS IN A LARGER AREA TO STABILIZE FOLLOWING CONSTRUCTION.

3. STAGING AREA SHALL BE STABILIZED PRIOR TO OTHER OPERATIONS ON THE SITE. 4. THE STABILIZED STAGING AREA SHALL CONSIST OF A MINIMUM 3" THICK GRANULAR MATERIAL.

5. UNLESS OTHERWISE SPECIFIED BY LOCAL JURISDICTION, ROCK SHALL CONSIST OF DOT SECT. #703, AASHTO #3 COARSE AGGREGATE OR 6" (MINUS) ROCK. 6. ADDITIONAL PERIMETER BMPs MAY BE REQUIRED INCLUDING BUT NOT LIMITED TO SILT

FENCE AND CONSTRUCTION FENCING.

STABILIZED STAGING AREA MAINTENANCE NOTES

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE, INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE EROSION, AND PERFORM NECESSARY MAINTENANCE.

2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.

3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.

4. ROCK SHALL BE REAPPLIED OR REGRADED AS NECESSARY IF RUTTING OCCURS OR UNDERLYING SUBGRADE BECOMES EXPOSED.

STABILIZED STAGING AREA MAINTENANCE NOTES


5. STABILIZED STAGING AREA SHALL BE ENLARGED IF NECESSARY TO CONTAIN PARKING, STORAGE, AND UNLOADING/LOADING OPERATIONS.

6. THE STABILIZED STAGING AREA SHALL BE REMOVED AT THE END OF CONSTRUCTION. THE GRANULAR MATERIAL SHALL BE REMOVED OR, IF APPROVED BY THE LOCAL JURISDICTION, USED ON SITE, AND THE AREA COVERED WITH TOPSOIL, SEEDED AND MULCHED OR OTHERWISE STABILIZED IN A MANNER APPROVED BY LOCAL JURISDICTION.

NOTE: MANY MUNICIPALITIES PROHIBIT THE USE OF RECYCLED CONCRETE AS GRANULAR MATERIAL FOR STABILIZED STAGING AREAS DUE TO DIFFICULTIES WITH RE-ESTABLISHMENT OF VEGETATION IN AREAS WHERE RECYCLED CONCRETE WAS PLACED.

NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

(DETAILS ADAPTED FROM DOUGLAS COUNTY, COLORADO, NOT AVAILABLE IN AUTOCAD)

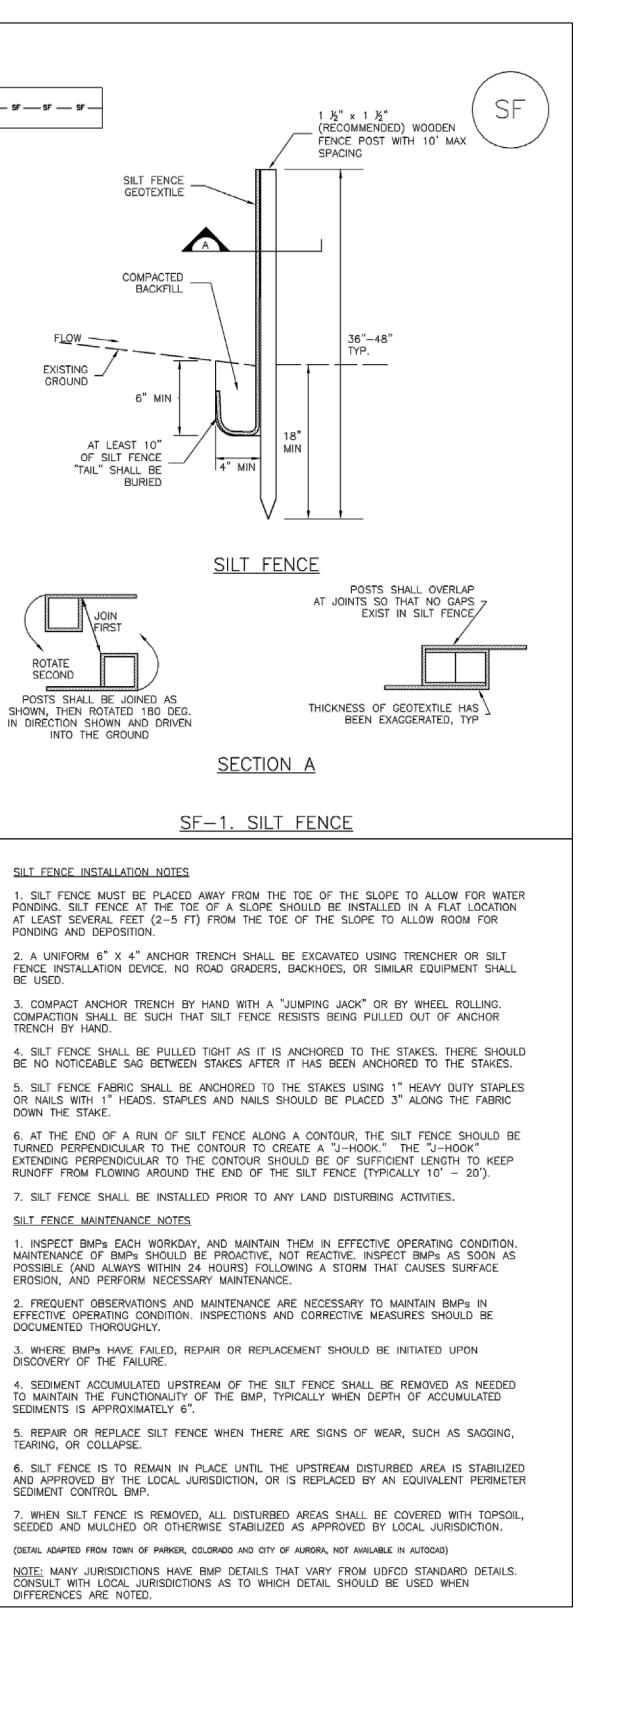

-	sign Associates, IIc ers - landscape architects
	2009 W. Littleton Blvd. #300 Littleton, CO 80120
	303.794.4727 ph www.SterlingDesignAssociates.com
JOSEF COLORADO RI	HE DIRECT SUPERVISION OF PH SCHIEL, PE EGISTRATION 0048332 ERLING DESIGN ASSOCIATES, LLC
PROTESS	A8332 HIZOIT
	GN ASSOCIATES, LLC
SUES & REVISIONS 0.: 1 DATE: 5/16/2017	BY: JDS
SCRIPTION: 1ST MAJOR SD	P SUBMITTAL
0.: 2 DATE: 8/24/2017 SCRIPTION: 2ND MAJOR SD	BY: JDS
D.: 3 DATE: 9/13/2017	BY: JDS
SCRIPTION: 3RD MAJOR SD	DP SUBMITTAL BY: -
SCRIPTION: -	
).: 5 DATE: - SCRIPTION: -	BY: -
).: 6 DATE: - SCRIPTION: -	BY: -
TE: 13/2017	SCALE: <b>1" = 20'</b>
OJECT MANAGER:	PROJECT NO.:
AWN BY:	DRAWING FILE:
ROJECT:	
	OFFEE SHOP GLE GATE VIEW PRINGS, CO
IENT:	

COUNTY PROJECT NUMBER PPR-17-030

9 OF 21

SHEET NUMBER:

### **Temporary and Permanent Seeding (TS/PS)**

Seeding dates for the highest success probability of perennial species along the Front Range are generally in the spring from April through early May and in the fall after the first of September until the ground freezes. If the area is irrigated, seeding may occur in summer months, as well. See Table TS/PS-3 for appropriate seeding dates.

SM

**EC-2** 

Table TS/PS-1. Minimum Drill Seeding Rates for Various Temporary Annual Grasses

Species <sup>a</sup> (Common name)	Growth Season <sup>b</sup>	Pounds of Pure Live Seed (PLS)/acre <sup>c</sup>	Planting Depth (inches)
1. Oats	Cool	35 - 50	1 - 2
2. Spring wheat	Cool	25 - 35	1 - 2
3. Spring barley	Cool	25 - 35	1 - 2
4. Annual ryegrass	Cool	10 - 15	1/2
5. Millet	Warm	3 - 15	1/2 - 3/4
6. Sudangrass	Warm	5–10	1/2 - 3/4
7. Sorghum	Warm	5-10	1/2 - 3/4
8. Winter wheat	Cool	20–35	1 - 2
9. Winter barley	Cool	20–35	1 - 2
10. Winter rye	Cool	20–35	1 - 2
11. Triticale	Cool	25–40	1 - 2

Successful seeding of annual grass resulting in adequate plant growth will usually produce enough dead-plant residue to provide protection from wind and water erosion for an additional year. This assumes that the cover is not disturbed or mowed closer than 8 inches.

Hydraulic seeding may be substituted for drilling only where slopes are steeper than 3:1 or where access limitations exist. When hydraulic seeding is used, hydraulic mulching should be applied as a separate operation, when practical, to prevent the seeds from being encapsulated in the mulch.

- See Table TS/PS-3 for seeding dates. Irrigation, if consistently applied, may extend the use of cool season species during the summer months.
- Seeding rates should be doubled if seed is broadcast, or increased by 50

percent if done using a Brillion Drill or by hydraulic seeding.

#### **Temporary and Permanent Seeding (TS/PS) EC-2**

#### Table TS/PS-2. Minimum Drill Seeding Rates for Perennial Grasses

Common <sup>a</sup> Name	Botanical Name	Growth Season <sup>b</sup>	Growth Form	Seeds/ Pound	Pounds of PLS/acre
Alakali Soil Seed Mix					
Alkali sacaton	Sporobolus airoides	Cool	Bunch	1,750,000	0.25
Basin wildrye	Elymus cinereus	Cool	Bunch	165,000	2.5
Sodar streambank wheatgrass	Agropyron riparium 'Sodar'	Cool	Sod	170,000	2.5
Jose tall wheatgrass	Agropyron elongatum 'Jose'	Cool	Bunch	79,000	7.0
Arriba western wheatgrass	Agropyron smithii 'Arriba'	Cool	Sod	110,000	5.5
Total					17.75
Fertile Loamy Soil Seed Mix	सी ्री		Ne para		
Needleandthread	Stipa comata	Warm	Bunch	175,000	2.0
Blue grama	Bouteloua gracilis	Warm	Bunch	565,000	1.0
Thickspike wheatgrass	Elymus lanceolatus	Cool	Sod	130,000	3.0
Sodar streambank wheatgrass	Agropyron riparium 'Sodar'	Cool	Sod	170,000	2.5
Arriba western wheatgrass	Agropyron smithii 'Arriba'	Cool	Sod	110,000	7.0
Total					15.5
High Water Table Soil Seed Mix	r .				
Western wheatgrass	Agropyron repens	Cool	Bunch	900,000	0.5
Redtop	Agrostis alba	Warm	Open sod	5,000,000	0.25
Prairie cordgrass	Spartina pectinata	Cool	Bunch	68,000	0.5
Alkali sacaton	Sporobolus airoides	Warm	Bunch	130,000	3.0
Pathfinder switchgrass	Panicum virgatum 'Pathfinder'	Warm	Sod	389,000	1.0
Slender wheatgrass	Elymus trachycaulus	Cool	Bunch	79,000	5.5
Total					10.75
Transition Turf Seed Mix <sup>c</sup>					
Sheep fescue	Festuca ovine	Cool	Bunch	2,500,000	0.5
Idaho fescue	Festuca idahoensis	Cool	Bunch	565,000	1.0
Buffalograss	Bouteloua dactyloides 'Topgun'	Warm	Sod	247,000	3.0
Blue grama	Bouteloua gracilis 'Hachita'	Warm	Bunch	130,000	3.0
Total					7.5

TS/PS-4

Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual Volume 3 June 2012

#### **Temporary and Permanent Seeding (TS/PS) EC-2**

Common Name	Botanical Name	Growth Season <sup>b</sup>	Growth Form	Seeds/ Pound	Pounds of PLS/acre
Sandy Soil Seed Mix					
Blue grama	Bouteloua gracilis	Warm	Sod-forming bunchgrass	825,000	0.5
Camper little bluestem	Schizachyrium scoparium 'Camper'	Warm	Bunch	240,000	1.0
Prairie sandreed	Calamovilfa longifolia	Warm	Open sod	274,000	1.0
Sand dropseed	Sporobolus cryptandrus	Cool	Bunch	5,298,000	0.25
Vaughn sideoats grama	Bouteloua curtipendula 'Vaughn'	Warm	Sod	191,000	2.0
Arriba western wheatgrass	Agropyron smithii 'Arriba'	Cool	Sod	110,000	5.5
Total					10.25
Heavy Clay, Rocky Foothill Se	ed Mix				
Mountain muhly	Muhlenbergia montana	Warn	Bunch	175,000	1.5
Arizona fescue	Festuca arizonica	Cool	Bunch	115,000	5.5
Vaughn sideoats grama <sup>e</sup>	Bouteloua curtipendula 'Vaughn'	Warm	Sod	191,000	2.0
Blue grama	Bouteloua gracilis	Warm	Bunch	130,000	3.0
Arriba western wheatgrass	Agropyron smithii 'Arriba'	Cool	Sod	110,000	5.5
Total					17.5
doubled if seed is broadcast an through hydraulic seeding. Hy	s and rates are based on drill seeding nd should be increased by 50 percen ydraulic seeding may be substituted raulic mulching should be done as a	t if the seeding for drilling onl	is done using a E y where slopes ar	Brillion Drill or	is applied
<sup>b</sup> See Table TS/PS-3 for seeding	g dates.				
<sup>c</sup> If site is to be irrigated, the tra	unsition turf seed rates should be dou	blad			

If site is to be irrigated, the transition turf seed rates should be doubled

Crested wheatgrass should not be used on slopes steeper than 6H to 1V. Can substitute 0.5 lbs PLS of blue grama for the 2.0 lbs PLS of Vaughn sideoats grama.

June 2012	Urban Drainage and Flood Cont
	Urban Storm Drainage Criteria Mar

#### Table TS/PS-3. Seeding Dates for Annual and Perennial Grasses

	(Numbers in	Annual Grasses (Numbers in table reference species in Table TS/PS-1)		Perennial Grasses	
Seeding Dates	Warm	Cool	Warm	Cool	
January 1–March 15			✓	✓	
March 16–April 30	4	1,2,3	✓	✓	
May 1–May 15	4		$\checkmark$		
May 16–June 30	4,5,6,7				
July 1–July 15	5,6,7				
July 16–August 31					
September 1–September 30		8,9,10,11			
October 1–December 31			$\checkmark$	✓	

#### Mulch

Cover seeded areas with mulch or an appropriate rolled erosion control product to promote establishment of vegetation. Anchor mulch by crimping, netting or use of a non-toxic tackifier. See the Mulching BMP Fact Sheet for additional guidance.

#### Maintenance and Removal

Monitor and observe seeded areas to identify areas of poor growth or areas that fail to germinate. Reseed and mulch these areas, as needed.

An area that has been permanently seeded should have a good stand of vegetation within one growing season if irrigated and within three growing seasons without irrigation in Colorado. Reseed portions of the site that fail to germinate or remain bare after the first growing season.

Seeded areas may require irrigation, particularly during extended dry periods. Targeted weed control may also be necessary.

Protect seeded areas from construction equipment and vehicle access.

### **EC-4**

• Clean, weed-free and seed-free cereal grain straw should be applied evenly at a rate of 2 tons per acre and must be tacked or fastened by a method suitable for the condition of the site. Straw mulch must be anchored (and not merely placed) on the surface. This can be accomplished mechanically by crimping or with the aid of tackifiers or nets. Anchoring with a crimping implement is preferred, and is the recommended method for areas flatter than 3:1. Mechanical crimpers must be capable of tucking the long mulch fibers into the soil to a depth of 3 inches without cutting them. An agricultural disk, while not an ideal substitute, may work if the disk blades are dull or blunted and set vertically; however, the frame may have to be weighted to afford proper soil penetration.

### Maintenance and Removal

After mulching, the bare ground surface should not be more than 10 percent exposed. Reapply mulch, as needed, to cover bare areas.



# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2


A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

MAJOR SITE DEVELOPMENT PLAN

trol District Manual Volume 3

TS/PS-5

### Mulching (MU)

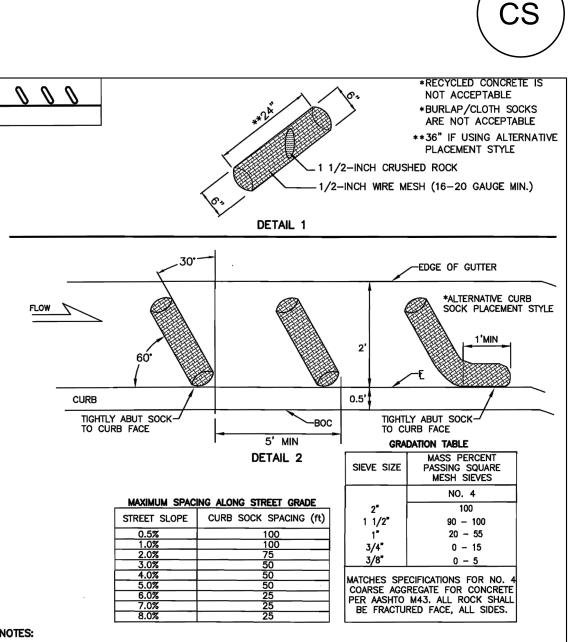

SOCKS WILL BE USED UPGRADIENT OF INLET ANGLED AS SHOWN AND SHALL BE FLUSH WITH CURB. FOR IPS AND IPO NO LESS THAN THREE 6-INCH DIAMETER SOCKS MUST BE USED IN SEQUENCE, SPACED NO MORE THAN FIVE FEET APART, WHEN SHOWN ON PLAN. INCLINE AT 30 DEGREES FROM PERPENDICULAR, OPPOSITE THE DIRECTION OF FLOW (SEE DETAIL 2). A MINIMUM OF THREE CURB SOCKS SHALL BE PLACED DOWNSTREAM OF ANY DISTURBED AREA AND

ALONG ALL CURBS FRONTING DISTURBED AREA, SPACED PER THE TABLE SOCKS WILL BE USED AT ANY LOCATION ALONG A CURB TO CONTROL SEDIMENT AS DIRECTED BY CITY. 16-20 GAUGE CHICKEN WIRE IS AN ACCEPTABLE ALTERNATIVE IF DOUBLE WRAPPED WITH NO MORE THAN 1/2 INCH OPENINGS.

Curb Sock - are installed as curbside check dams and are wire mesh wrapped rock wattles installed for sediment control. Typical installation is a series of socks on a grade in the curb flowline upstream of a curb inlet to filter sediment-laden runoff and reduce the velocity of the flow.

### Key Installation and Maintenance Requirements:

 Curb socks shall be constructed such that the final product is a cylindrical shaped filter with 1/2 - inch mesh filled with 11/2 - inch gravel

· Curb socks shall not exceed 24" in length, 6" in diameter and shall be placed at 60° angles in curb drainage flow lines flush with the curb. The spacing and quantity of the curb socks should be determined by the length and grade of the curb drainage flow

· Install delineators with the curb socks for high traffic areas where installations present a potential traffic hazard or where they may be damaged by snow plowing activities · Recycled or demolished concrete material is not an acceptable substitute for rock fill. • Installed features need to be monitored for correct placement or rupture and adjusted, replaced or repaired as needed



Features are not appropriately spaced in this application. Upgradient erosion control measures need to be implemented to prevent heavy sediment loading. Curb socks are not designed to manage the amount of sediment removal depicted here.



Blankets & Open

DIVERSION DI

TYPICALLY AT TOP

PERIMETER ANCHOF TRENCH O' JOINT, TY'

4:1-3:1 SLOPES

SEE PLAN VIEW FOR: -LOCATION OF ECB.

BLANKET

BLANKET AREAS.

TYPE

STRAW\*

STRAW-

COCONUT

EXCELSIOR

DOCUMENTED THOROUGHLY.

COCONUT 100%

-

EROSION CONTROL BLANKET MAINTENANCE NOTES

EROSION, AND PERFORM NECESSARY MAINTENANCE.

9000

LOW FLOW CHANNEL

EROSION CONTROL BLANKET INSTALLATION NOTES

Weave Textiles

# 5. ANY ECB PULLED OUT, TORN, OR OTHERWISE DAMAGED SHALL BE REPAIRED OR REINSTALLED. ANY SUBGRADE AREAS BELOW THE GEOTEXTILE THAT HAVE ERODED TO CREATED A VOID UNDER THE BLANKET, OR THAT REMAIN DEVOID OF GRASS SHALL BE REPAIRED, RESEEDED AND MULCHED AND THE ECB REINSTALLED. NOTE: MANY JURISDICTIONS HAVE BMP DETAILS THAT VARY FROM UDFCD STANDARD DETAILS. CONSULT WITH LOCAL JURISDICTIONS AS TO WHICH DETAIL SHOULD BE USED WHEN DIFFERENCES ARE NOTED.

(DETAILS ADAPTED FROM DOUGLAS COUNTY, COLORADO AND TOWN OF PARKER COLORADO, NOT AVAILABLE IN AUTOCAD)

COUNTY PROJECT NUMBER PPR-17-030

SHEET NUMBER:

10 OF 21

### EROSION AND STORMWATER QUALITY CONTROL DETAILS

# SHEET TITLE:

CLIENT: VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421

PROJECT:


### PROPOSED COFFEE SHOP 209 GLENEAGLE GATE VIEW COLORADO SPRINGS, CO

DESCRIPTION: NO.: 5 DATE: BY: · DESCRIPTION: -NO.: 6 DATE: BY: -DESCRIPTION: SCALE: DATE: 1" = 20' 9/13/2017 PROJECT MANAGER: PROJECT NO. JDS DRAWN BY: DRAWING FILE:

STERLING DESIGN ASSOCIATES, LLC ISSUES & REVISIONS NO.: 1 DATE: 5/16/201 BY: JDS DESCRIPTION: 1ST MAJOR SDP SUBMITTAL NO.: 2 DATE: 8/24/2017 BY: JDS DESCRIPTION: 2ND MAJOR SDP SUBMITTAL NO.: 3 DATE: 9/13/2017 BY: JDS DESCRIPTION: 3RD MAJOR SDP SUBMITTAL NO.: 4 DATE: · BY: -







	Sterling Design Associates, Ilc civil engineers - landscape architects
_	2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com
	PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE

ECB

Expected

Longevity

Up to 12 months

24 months

24 months

36 months

Minimum

Tensile

Strength<sup>1</sup>

5 lbs/ft

(0.073 kN/m)

5 lbs/ft

(0.073 kN/m)

50 lbs/ft

(0.73 kN/m)

75 lbs/ft

(1.09 kN/m)

25 lbs/ft

(0.36 kN/m)

100 lbs/ft

125 lbs/ft

(1.82 kN/m)

OVERLAPPING JOINT

TAKING PATTERN PER

2:1 AND STEEPER

HIGH FLOW CHANNEL

MANUFACTURER SPEC. OR PATTERN BASED ON ECB AND/OR SLOPE

TYPE (SEE STAKING PATTERN DETAIL)

- STAGGER OVERLAPS

(1.45 kN/m)

Table RECP-1. ECTC Standard Specification for Temporary Rolled Erosion Control Products

(Adapted from Erosion Control Technology Council 2005)

Applications\*

C Factor<sup>2,5</sup>

≤0.10 @

≤0.10 @

≤0.15 @

≤0.20 @

2:1

≤0.10 @ 5:1

≤0.25 @

1.5:1

≤0.25 @

1:1

3:1

4:1

5:1

Maximum

Gradient

5:1 (H:V)

4:1 (H:V)

3:1 (H:V)

2:1 (H:V)

5:1 (H:V)

1.5:1 (H:V)

1:1 (H:V)

Channel

Applications<sup>1</sup>

Max. Shear

 $0.25 \text{ lbs/ft}^2$ 

(12 Pa)

 $0.5 \text{ lbs/ft}^2$ 

(24 Pa)

 $1.5 \text{ lbs/ft}^2$ 

(72 Pa)

1.75 lbs/ft<sup>2</sup>

(84 Pa)

0.25 lbs/ft<sup>2</sup>

(12 Pa)

 $2.00 \text{ lbs/ft}^2$ 

2.25 lbs/ft<sup>2</sup>

(108 Pa)

ECB-3. OUTSIDE OF DRAINAGEWAY

STRAW-COCONU

STAKING PATTERNS BY ECB TYPE

3:1-2:1 SLOPES

STAKING PATTERNS BY SLOPE OR CHANNEL TYPE

2. 100% NATURAL AND BIODEGRADABLE MATERIALS ARE PREFERRED FOR RECPS, ALTHOUGH SOME JURISDICTIONS MAY ALLOW OTHER MATERIALS IN SOME APPLICATIONS.

3. IN AREAS WHERE ECBS ARE SHOWN ON THE PLANS, THE PERMITTEE SHALL PLACE TOPSOIL AND PERFORM FINAL GRADING, SURFACE PREPARATION, AND SEEDING AND MULCHING. SUBGRADE SHALL BE SMOOTH AND MOIST PRIOR TO ECB INSTALLATION AND THE ECB SHALL BE IN FULL CONTACT WITH SUBGRADE. NO GAPS OR VOIDS SHALL EXIST UNDER THE

4. PERIMETER ANCHOR TRENCH SHALL BE USED ALONG THE OUTSIDE PERIMETER OF ALL

6. INTERMEDIATE ANCHOR TRENCH SHALL BE USED AT SPACING OF ONE-HALF ROLL LENGTH FOR COCONUT AND EXCELSIOR ECBs.

7. OVERLAPPING JOINT DETAIL SHALL BE USED TO JOIN ROLLS OF ECBs TOGETHER FOR ECBs ON SLOPES.

9. ANY AREAS OF SEEDING AND MULCHING DISTURBED IN THE PROCESS OF INSTALLING ECBS SHALL BE RESEEDED AND MULCHED.

10. DETAILS ON DESIGN PLANS FOR MAJOR DRAINAGEWAY STABILIZATION WILL GOVERN IF DIFFERENT FROM THOSE SHOWN HERE.

TABLE ECB-1. ECB MATERIAL SPECIFICATIONS

100%

-

1. INSPECT BMPs EACH WORKDAY, AND MAINTAIN THEM IN EFFECTIVE OPERATING CONDITION. MAINTENANCE OF BMPs SHOULD BE PROACTIVE, NOT REACTIVE. INSPECT BMPs AS SOON AS POSSIBLE (AND ALWAYS WITHIN 24 HOURS) FOLLOWING A STORM THAT CAUSES SURFACE

2. FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN BMPs IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE

3. WHERE BMPs HAVE FAILED, REPAIR OR REPLACEMENT SHOULD BE INITIATED UPON DISCOVERY OF THE FAILURE.

4. ECBs SHALL BE LEFT IN PLACE TO EVENTUALLY BIODEGRADE, UNLESS REQUESTED TO BE REMOVED BY THE LOCAL JURISDICTION.

\*STRAW ECBs MAY ONLY BE USED OUTSIDE OF STREAMS AND DRAINAGE CHANNEL.

30% MIN 70% MAX

COCONUT STRAW EXCELSIOR RECOMMENDED CONTENT CONTENT CONTENT NETTING\*\*

\_

100%

DOUBLE/ NATURAL

DOUBLE/ NATURAL

DOUBLE/ NATURAL

DOUBLE/ NATURAL


5. JOINT ANCHOR TRENCH SHALL BE USED TO JOIN ROLLS OF ECBs TOGETHER (LONGITUDINALLY AND TRANSVERSELY) FOR ALL ECBs EXCEPT STRAW WHICH MAY USE AN OVERLAPPING JOINT.

8. MATERIAL SPECIFICATIONS OF ECBs SHALL CONFORM TO TABLE ECB-1.

-TYPE OF ECB (STRAW, STRAW-COCONUT, COCONUT, OR EXCELSIOR). -AREA, A, IN SQUARE YARDS OF EACH TYPE OF ECB.

(96 Pa)

Stress<sup>3,4</sup>

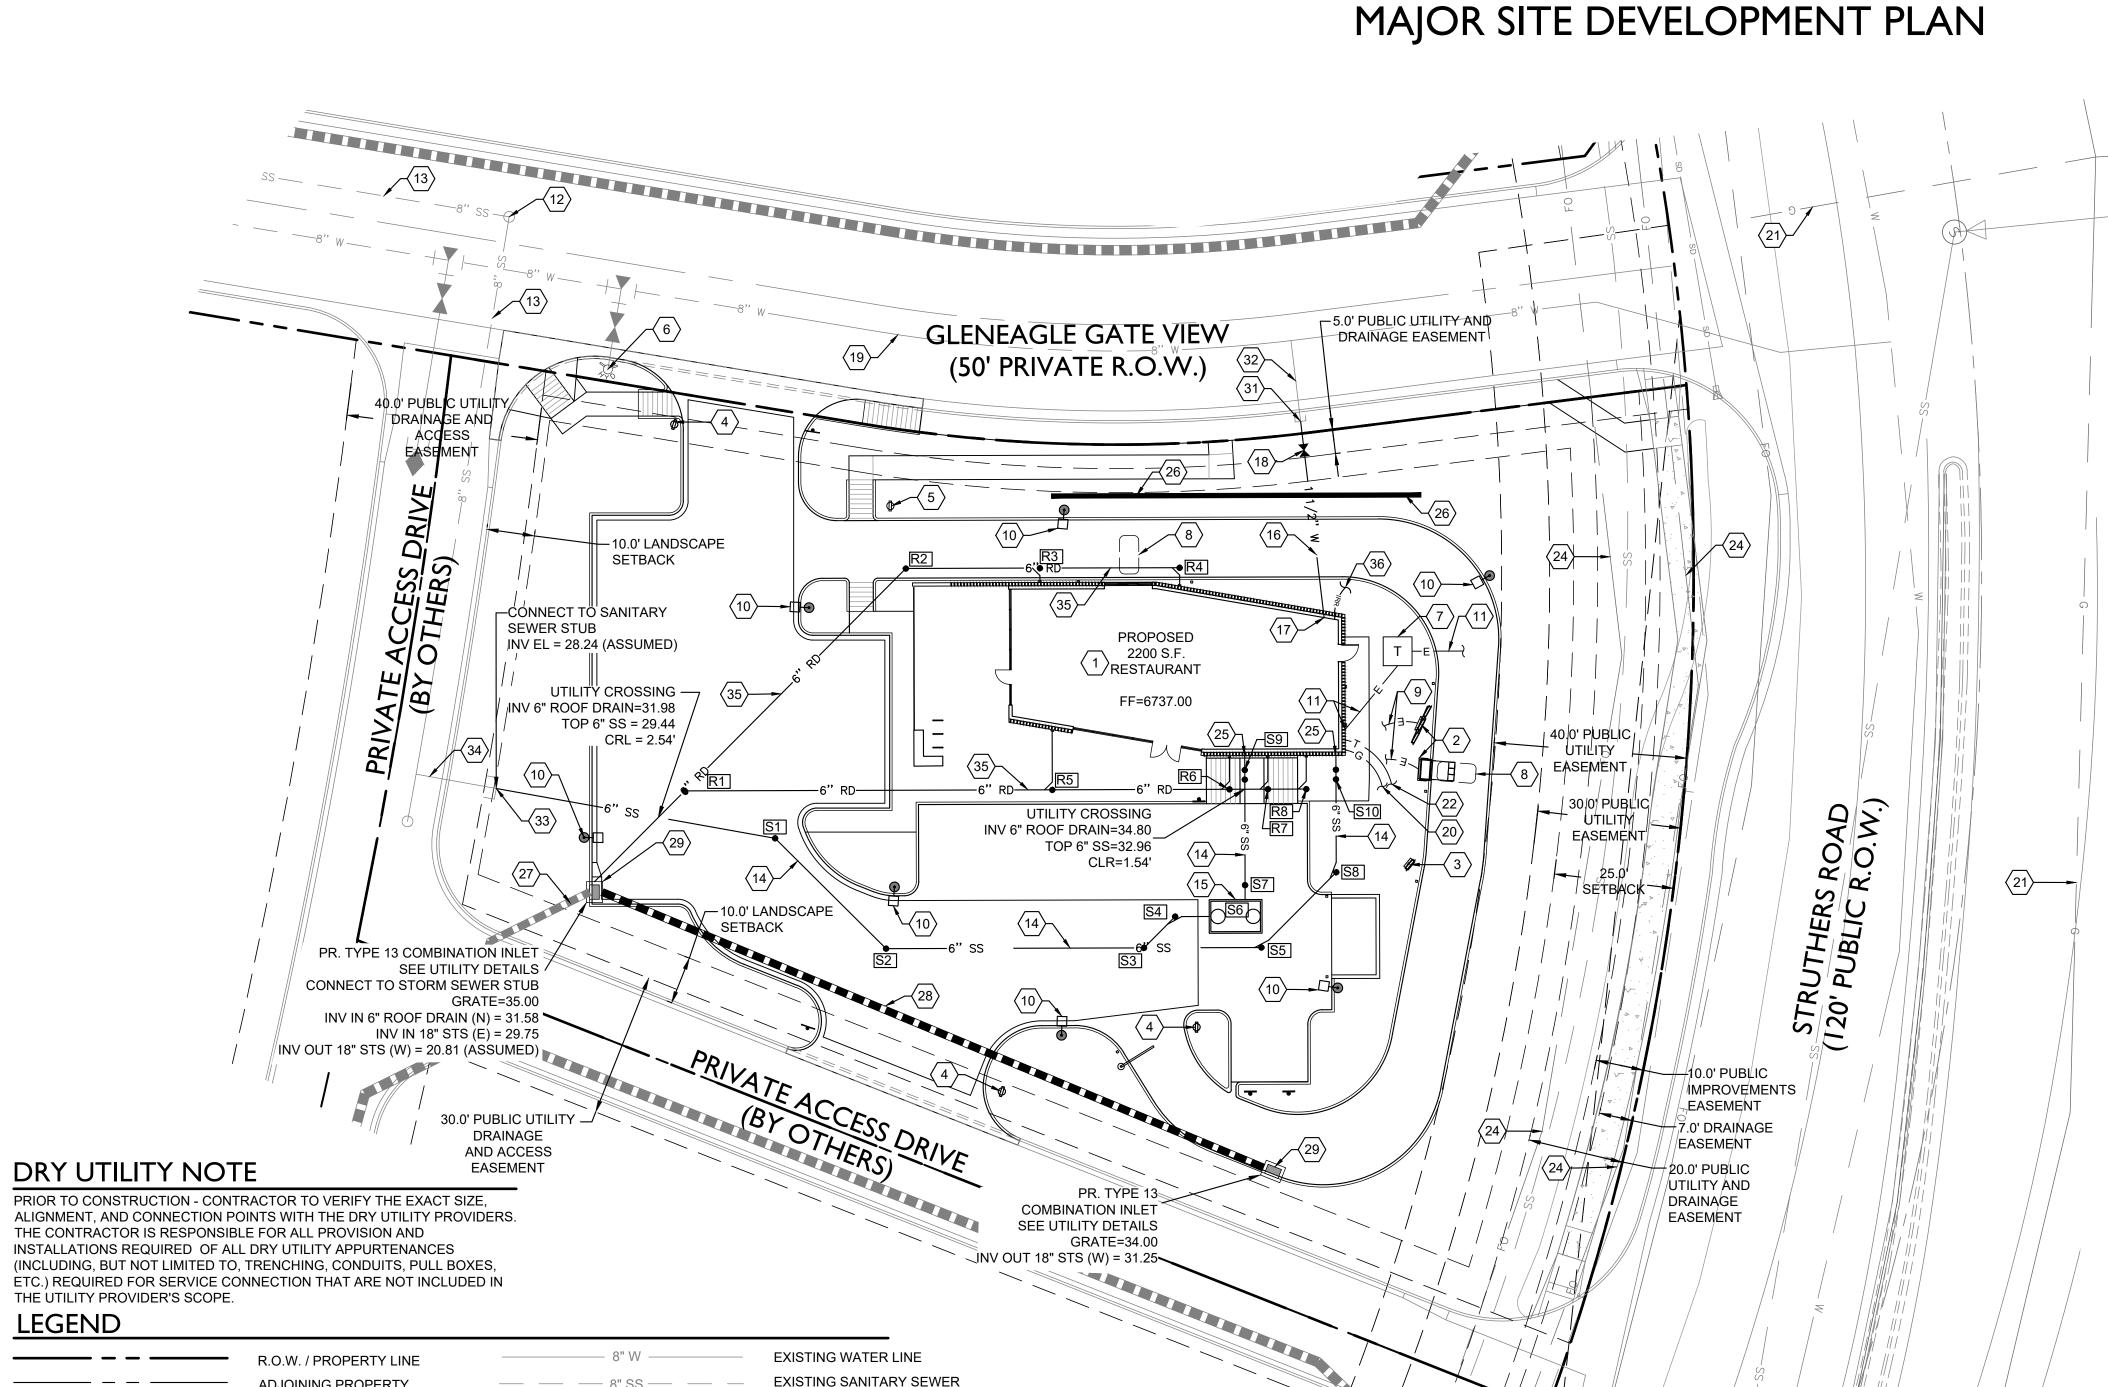

LEGEND		
	R.O.W. / PROPERTY LINE	
	ADJOINING PROPERTY	
	EASEMENT LINE	
	EXISTING TO REMAIN	
-\$-	EXISTING SITE LIGHT	
	PROP. CURB AND GUTTER	
TRN	EXISTING TRANSFORMER	
	EXISTING RETAINING WALL	
	EXISTING GUARDRAIL	
S	EXIST. MANHOLE	
N.	EXIST. FIRE HYDRANT	
WV	EXIST. WATER VALVE	
	PROPOSED STORM INLET	CAUTIC

8" W	EXISTING WATER LINE
8" SS	EXISTING SANITARY SEWER
G	EXISTING GAS LINE
E	EXISTING ELECTRIC LINE
STS	EXISTING STORM SEWER
FO	EXISTING FIBER OPTIC LINE
1 1/2" W	PROPOSED WATER LINE
6" SS	PROPOSED SANITARY SEWER SERVICE
G	PROPOSED GAS SERVICE
——— E ———	PROPOSED ELECTRIC LINE
6" RD	PROPOSED ROOF DRAIN LINE
T	PROPOSED TELEPHONE LINE
	PROPOSED STORM SEWER

### ON - NOTICE TO CONTRACTOR

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE LOCAL UTILITY LOCATION CENTER AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATIONS OF THE UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH THE PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.



THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO EXISTING IMPROVEMENTS AND UTILITIES AND SHALL REPAIR ANY DAMAGE AT HIS EXPENSE.

# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

## SCHEDULE NOTES

- SIGNAGE DETAILS.

- PROVIDER.

- CONSTRUCTION.

- BUILDING).
- CONSTRUCTION.
- DRY UTILITY NOTE.
- SEE DRY UTILITY NOTE.
- CONSTRUCTION.

- $\langle 27 \rangle$  STORM SEWER STUB BY OTHERS.
- $\langle 28 \rangle$  PROPOSED 18" RCP STORM SEWER.
- $\langle 30 \rangle$  NOT USED.

- ARCHITECTURAL/MEP PLANS.

	NOF	RTH	
0 SCA	10 .LE: 1"=	20 20'	40
JUA	LL. I -	20	

## PRIVATE SAN. SEWER APPURTENANCES TABLE

ID	FIXTURE	INV OUT	INV IN	RIM
S1	6" CLEANOUT	29.40	SAME	35.55
S2	6" CLEANOUT	30.06	SAME	35.69
S3	6" CLEANOUT	31.14	SAME	35.71
S4	6" CLEANOUT	31.50	SAME	35.92
S5	6" CLEANOUT	31.64	SAME	35.85
S6	PRECAST GREASE INTERCEPTOR	31.65	31.90	36.00
S7	6" CLEANOUT	31.96	SAME	36.15
S8	6" CLEANOUT	32.08	SAME	36.63
S9	6" TWO WAY CLEANOUT	32.50	SAME	36.48
S10	6" TWO WAY CLEANOUT	32.50	SAME	36.95

## PRIVATE ROOF DRAIN APPURTENANCES TABLE

ID	FIXTURE	INV OUT	INV IN	RIM
R1	6" CLEANOUT	32.14	SAME	35.77
R2	6" CLEANOUT	34.24	SAME	37.11
R3	6" CLEANOUT	34.80	SAME	36.65
R4	6" CLEANOUT	34.80	SAME	36.36
R5	6" CLEANOUT	33.68	SAME	36.75
R6	6" CLEANOUT	34.44	SAME	36.44
R7	6" CLEANOUT	34.62	SAME	36.53
R8	6" CLEANOUT	34.80	SAME	36.90

|--|--|--|--|--|

(1) PROPOSED 2,200 SQ. FT. STARBUCKS CAFE. SEE ARCHITECTURAL ELEVATIONS.

 $\langle$  2 angle proposed order point canopy with digital order screen and menu board to be INSTALLED PER STARBUCKS STANDARDS. SEE SIGNAGE DETAILS.

 $\langle$  3  $\rangle$  PROPOSED PRE-MENU BOARD TO BE INSTALLED PER STARBUCKS STANDARDS. SEE

(4) PROPOSED "DRIVE-THRU" DIRECTIONAL SIGNAGE TO BE INSTALLED PER STARBUCKS STANDARDS. SEE SIGNAGE DETAILS.

 $\langle$  5 angle PROPOSED "THANK YOU" AND "EXIT ONLY" SIGNAGE TO BE INSTALLED PER STARBUCKS STANDARDS. SEE SIGNAGE DETAILS.

 $\langle$  6 angle EXISTING FIRE HYDRANT TO REMAIN AND BE PROTECTED THROUGHOUT CONSTRUCTION

 $\overline{(7)}$  PROPOSED LOCATION OF THE TRANSFORMER PAD. CONTRACTOR TO VERIFY EXACT OCATION AND SIZE WITH UTILITY PROVIDOR PRIOR TO INSTALLATION. CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLATION OF CONCRETE PAD AND CONDUIT AS REQUIRED BY THE UTILITY PROVIDER. CONTRACTOR SHALL COORDINATE SAID WORK WITH THE UTILITY

(8) PROPOSED DETECTOR LOOP CENTERED ON ORDER POINT AND/OR DRIVE-THROUGH NINDOW 2-INCHES BELOW FINISHED GRADE. CONTRACTOR TO EXTEND CONDUIT TO DRIVE-THROUGH / ORDER POINT / MENU BOARD / ELECTRICAL PANEL. CONTRACTOR SHALL INSTALL ALL WORK IN ACCORDANCE WITH STARBUCKS STANDARDS.

(9) APPROXIMATE LOCATION FOR UNDERGROUND ELECTRICAL CONDUIT FOR DIGITAL ORDER SCREEN CONTROL BOX AND PREVIEW BOARD.

 $\langle 10 \rangle$  PROPOSED SITE LIGHT. SEE PHOTOMETRIC PLAN. CONTRACTOR TO COORDINATE CONDUIT PLACEMENT FOR SITE LIGHTING WITH SITE ELECTRICAL PLAN.

 $\langle 11 \rangle$  APPROXIMATE ALIGNMENT AND CONNECTION POINTS FOR PROPOSED ELECTRIC SERVICE. SEE DRY UTILITY NOTE.

 $\langle 12 \rangle$  EXISTING SANITARY SEWER MANHOLE TO REMAIN.

 $\langle 13 \rangle$  EXISTING 8" SANITARY SEWER MAIN TO REMAIN AND BE PROTECTED THROUGHOUT

(14) PROPOSED 6" ASTM 3034 SDR-35 PVC SANITARY SEWER SERVICE WITH CLEANOUTS. INSTALL AT 2.0% MINIMUM SLOPE. REFER TO ARCHITECTURAL PLANS FOR DETAILS AND INFORMATION REGARDING PONT OF CONNECTION/CONTINUATION AT THE BUILDING.

 $\langle 15 \rangle$  PROPOSED GREASE INTERCEPTOR WITH VENT LINES TO BUILDING

(16) PROPOSED 1-1/2" TYPE K COPPER WATER SERVICE 4.5 FEET MINIMUM DEPTH BELOW GRADE. IN ACCORDANCE WITH DONALA WATER STANDARDS AND SPECIFICATIONS. CONTRACTOR TO COORDINATE INSTALLATION OF ALL APPURTENANCES NECESSARY FOR CONSTRUCTION WITH DONALA WATER, PERFORM REQUIRED WORK, AND CONFIRM PROPOSED SERVICE SIZE WITH ARCH/MEP PLANS PRIOR TO CONSTRUCTION.

 $\langle 17 \rangle$  DOMESTIC WATER SERVICE ENTRY. CONTRACTOR SHALL VERIFY HORIZONTAL AND VERTICAL LOCATION AND CONTINUATION WITH ARCH/MEP PLANS PRIOR TO CONSTRUCTION. CONTRACTOR TO REFER TO ARCH/MEP PLANS FOR WATER METER PLACEMENT (INSIDE

 $\langle 18 \rangle$  proposed curb stop and box to be installed in accordance with donala water STANDARDS AND SPECIFICATIONS. CONTRACTOR TO COORDINATE INSTALLATION OF ALL APPURTENANCES NECESSARY FOR CONSTRUCTION WITH DONALA WATER.

 $\langle 19 \rangle$  EXISTING 8" WATER MAIN BY OTHERS TO REMAIN AND BE PROTECTED DURING

 $\langle 20 \rangle$  APPROXIMATE ALIGNMENT AND CONNECTION POINTS FOR PROPOSED GAS SERVICE. SEE

 $\langle 21 \rangle$  EXISTING GAS MAIN TO REMAIN AND BE PROTECTED THROUGHOUT CONSTRUCTION.

 $\langle 22 
angle$  APPROXIMATE ALIGNMENT AND CONNECTION POINTS FOR PROPOSED PHONE SERVICE.

 $\langle 23 \rangle$  EXISTING UNDERGROUND ELECTRIC LINE TO REMAIN AND BE PROTECTED DURING

 $\langle 24 \rangle$  EXISTING FIBER OPTIC LINE TO REMAIN AND BE PROTECTED THROUGHOUT CONSTRUCTION.

 $\langle 25 
angle$  sanitary sewer service entry. Contractor shall verify horizontal and VERTICAL LOCATION AND CONTINUATION WITH ARCH/MEP PLANS PRIOR TO CONSTRUCTION.

(26) PROPOSED 3.5-FOOT MAXIMUM HEIGHT RETAINING WALL. REFER TO GRADING PLAN FOR APPROXIMATE GRADE ELEVATIONS AT TOP AND BASE OF WALL. SEE LANDSCAPE DETAILS FOR WALL DETAIL. CONTRACTOR TO SUBMIT TO THE ARCHITECT AND OWNER/DEVELOPER A COLOR AND TEXTURE SAMPLE OF THE WALL MATERIAL TO BE USED PRIOR TO INSTALLATION.

 $\langle 29 \rangle$  proposed type 13 combination inlet. See utility details.

 $\langle 31 \rangle$  POINT OF CONNECTION TO 1-1/2" TYPE K COPPER WATER LINE STUB.

 $\langle 32 \rangle$  1-1/2" TYPE K COPPER WATER LINE STUB (BY OTHERS).

 $\langle 33 \rangle$  POINT OF CONNECTION TO 6" SDR~35 PVC SEWER LINE STUB.

 $\langle 34 \rangle$  6" SDR~35 PVC SEWER LINE STUB (BY OTHERS).

 $\langle 35 \rangle$  PROPOSED 6" ASTM 3034 SDR-35 PVC ROOF DRAIN WITH CLEANOUTS. INSTALL AT 2.0% MINIMUM SLOPE. REFER TO ARCHITECTURAL PLANS FOR DETAILS AND INFORMATION REGARDING POINT OF CONNECTION/CONTINUATION AT THE BUILDING.

 $\langle 36 \rangle$  PROPOSED IRRIGATION LINE TO BE INSTALLED AFTER THE METER AND BEFORE THE DOMESTIC BACKFLOW PREVENTION DEVICE. SEE IRRIGATION PLANS AND



2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332 FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC



STERLING DESIGN ASSOCIATES, LLC

ISSUES & REVISIONS				
NO.: 1 DATE: 5/16/2017	BY: JDS			
DESCRIPTION: 1ST MAJOR SDP SUBMITTAL				
NO.: 2 DATE: 8/24/2017	BY: JDS			
DESCRIPTION: 2ND MAJOR SDP SUBMITTAL				
NO.: 3 DATE: 9/13/2017	BY: JDS			
DESCRIPTION: 3RD MAJOR SDP SUBMITTAL				
NO.: 4 DATE: -	BY: -			
DESCRIPTION: -				
NO.: 5 DATE: -	BY: -			
DESCRIPTION: -				
NO.: 6 DATE: -	BY: -			
DESCRIPTION: -				
DATE: SCALE:				
9/13/2017 1" = 20'				

PROJECT MANAGER: PROJECT NO. JDS DRAWN BY DRAWING FILE:

PROJECT:

### PROPOSED COFFEE SHOP **209 GLENEAGLE GATE VIEW** COLORADO SPRINGS, CO

CLIENT:

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421


SHEET TITLE: UTILITY PLAN

SHEET NUMBER:

11 of 21

### **GENERAL UTILITY NOTES**

- 1. REFER TO SHEET 2 FOR ADDITIONAL PROJECT GENERAL NOTES.
- WHEN IT IS NECESSARY TO LOWER OR RAISE WATER LINES AT STORM DRAINS AND OTHER UTILITY CROSSINGS, A MINIMUM CLEARANCE IN ACCORDANCE WITH THE GOVERNING AUTHORITY'S STANDARDS AND SPECIFICATIONS SHALL BE MAINTAINED BETWEEN OUTSIDE OF PIPES.
- COMPACTION OF ALL TRENCHES MUST BE ATTAINED IN ACCORDANCE WITH THE GOVERNING 3 AUTHORITIES STANDARDS AND THE RECOMMENDATIONS OF THE GEOTECHNICAL INVESTIGATION. THE CONTRACTOR SHALL SUBMIT COMPACTION TEST RESULTS TO THE GOVERNING AUTHORITY IN ACCORDANCE WITH THE GOVERNING AUTHORITY'S CRITERIA.
- 4. ALL WATER LINES SHALL HAVE A MINIMUM COVER IN ACCORDANCE WITH THE GOVERNING AUTHORITY'S STANDARDS AND SPECIFICATIONS.
- 5. THE CONTRACTOR SHALL REFER TO THE ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF UTILITY ENTRANCES.
- 6. WATERLINES SHALL BE TESTED AND DISINFECTED IN ACCORDANCE WITH THE GOVERNING AUTHORITY'S STANDARDS AND SPECIFICATIONS.
- 7. SANITARY SEWER LINES SHALL BE TESTED IN ACCORDANCE WITH THE GOVERNING AUTHORITY'S STANDARDS AND SPECIFICATIONS.
- 8. ALL WATER, STORM SEWER, AND SANITARY SEWER MAIN AND SERVICE LINES SHALL BE BEDDED IN ACCORDANCE WITH THER GOVERNING AUTHORITY'S STANDARDS AND SPECIFICATIONS.
- 9. LENGTHS OF PIPE SHOWN ARE THE HORIZONTAL DISTANCE FROM CENTERLINE TO CENTERLINE OF FITTING, BEND, MANHOLE AND/OR INLET. THEREFORE, LENGTHS SHOWN ARE APPROXIMATE.
- 10. CONTRACTOR SHALL INSTALL CORROSION PROTECTION ON FERROUS METAL WATER LINES AND FITTINGS INSTALLED IN CORROSIVE SOILS IN ACCORDANCE WITH THE RECOMMENDATIONS OF THE GEOTECHNICAL INVESTIGATION AND IN ACCORDANCE WITH GOVERNING AUTHORITY'S STANDARDS AND SPECIFICATIONS.
- 11. ALL CONCRETE STRUCTURES AND CONCRETE UTILITIES SHALL BE IN ACCORDANCE WITH THE MATERIAL RECOMMENDATIONS FROM THE GEOTECHNICAL INVESTIGATION PREPARED SPECIFICALLY FOR THIS SITE.
- 12. THE CONTRACTOR IS RESPONSIBLE TO COORDINATE AND PROVIDE SLEEVING OR OTHER IMPROVEMENTS AS NECESSARY FOR UTILITY PENETRATIONS THROUGH THE FOUNDATION WALLS AND SLAB IN ACCORDANCE WITH THE STRUCTURAL PLANS, MEP PLANS; AND APPLICABLE BUILDING AND PLUMBING/UTILITY CODE(S).
- 13. THE CONTRACTOR SHALL COORDINATE THE EXACT ALIGNMENT, CONNECTION POINT, AND BUILDING ENTRY LOCATION FOR TELEPHONE, DATA, ELECTRIC, CABLE, GAS, AND OTHER DRY UTILITY SERVICES WITH THE UTILITY PROVIDER AND MEP PLANS PRIOR TO CONSTRUCTION, AND INSTALL NECESSARY APPURTENANCES.

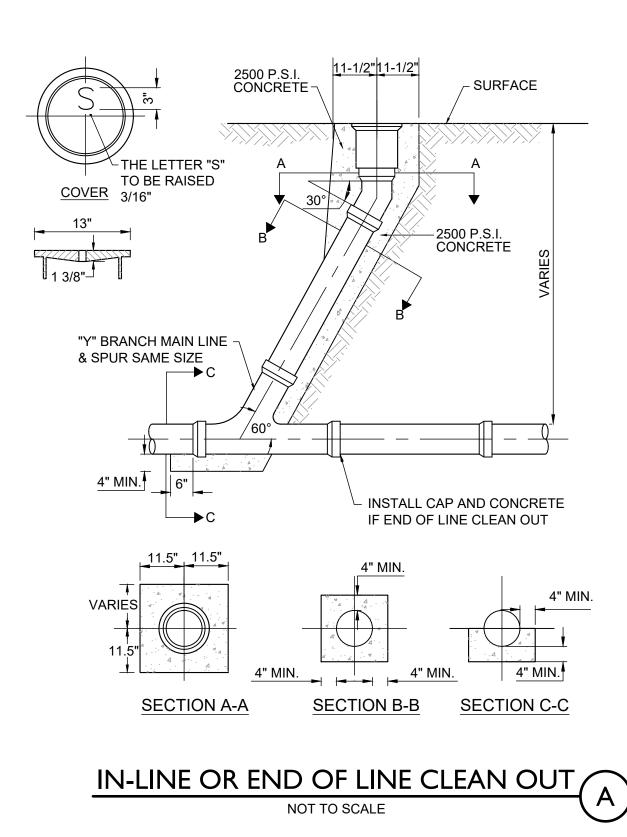

PROVIDE C.I. FRAME & LID, NEENAH R-7514 WITH "S" CAST IN LID, OR APPROVED SUBSTITUTION **REPAIR / REPLACE** EXISTING PAVEMENT IF NEEDED

> PROVIDE EXPANSION JOINT MATERIAL WHEN PLACING PAD IN PAVEMENT 6" CLEANOUT ADAPTER FITTING WITH THREADED PLUG

> > 6" PVC RISER-

6" 45° BEND (GxS)-

45° WYE — 1% MIN SLOP


NOTES

- 1. 2-WAY CLEAN-OUTS ARE TYPICALLY INSTALLED 2.0' TO 5.0' JUST OUTSIDE THE BUILDING SERVED, OR, JUST BEYOND A PORCH OR PATIO. COORDINATE LOCATION WITH INSPECTOR PRIOR TO INSTALLATION.
- 2. A SINGLE, TWO-WAY, CLEAN-OUT FITTING, IF AVAILABLE, MAY BE SUBSTITUTED WITH APPROVAL FROM ENGINEER AND LOCAL AUTOHORITIES.

# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

MAJOR SITE DEVELOPMENT PLAN

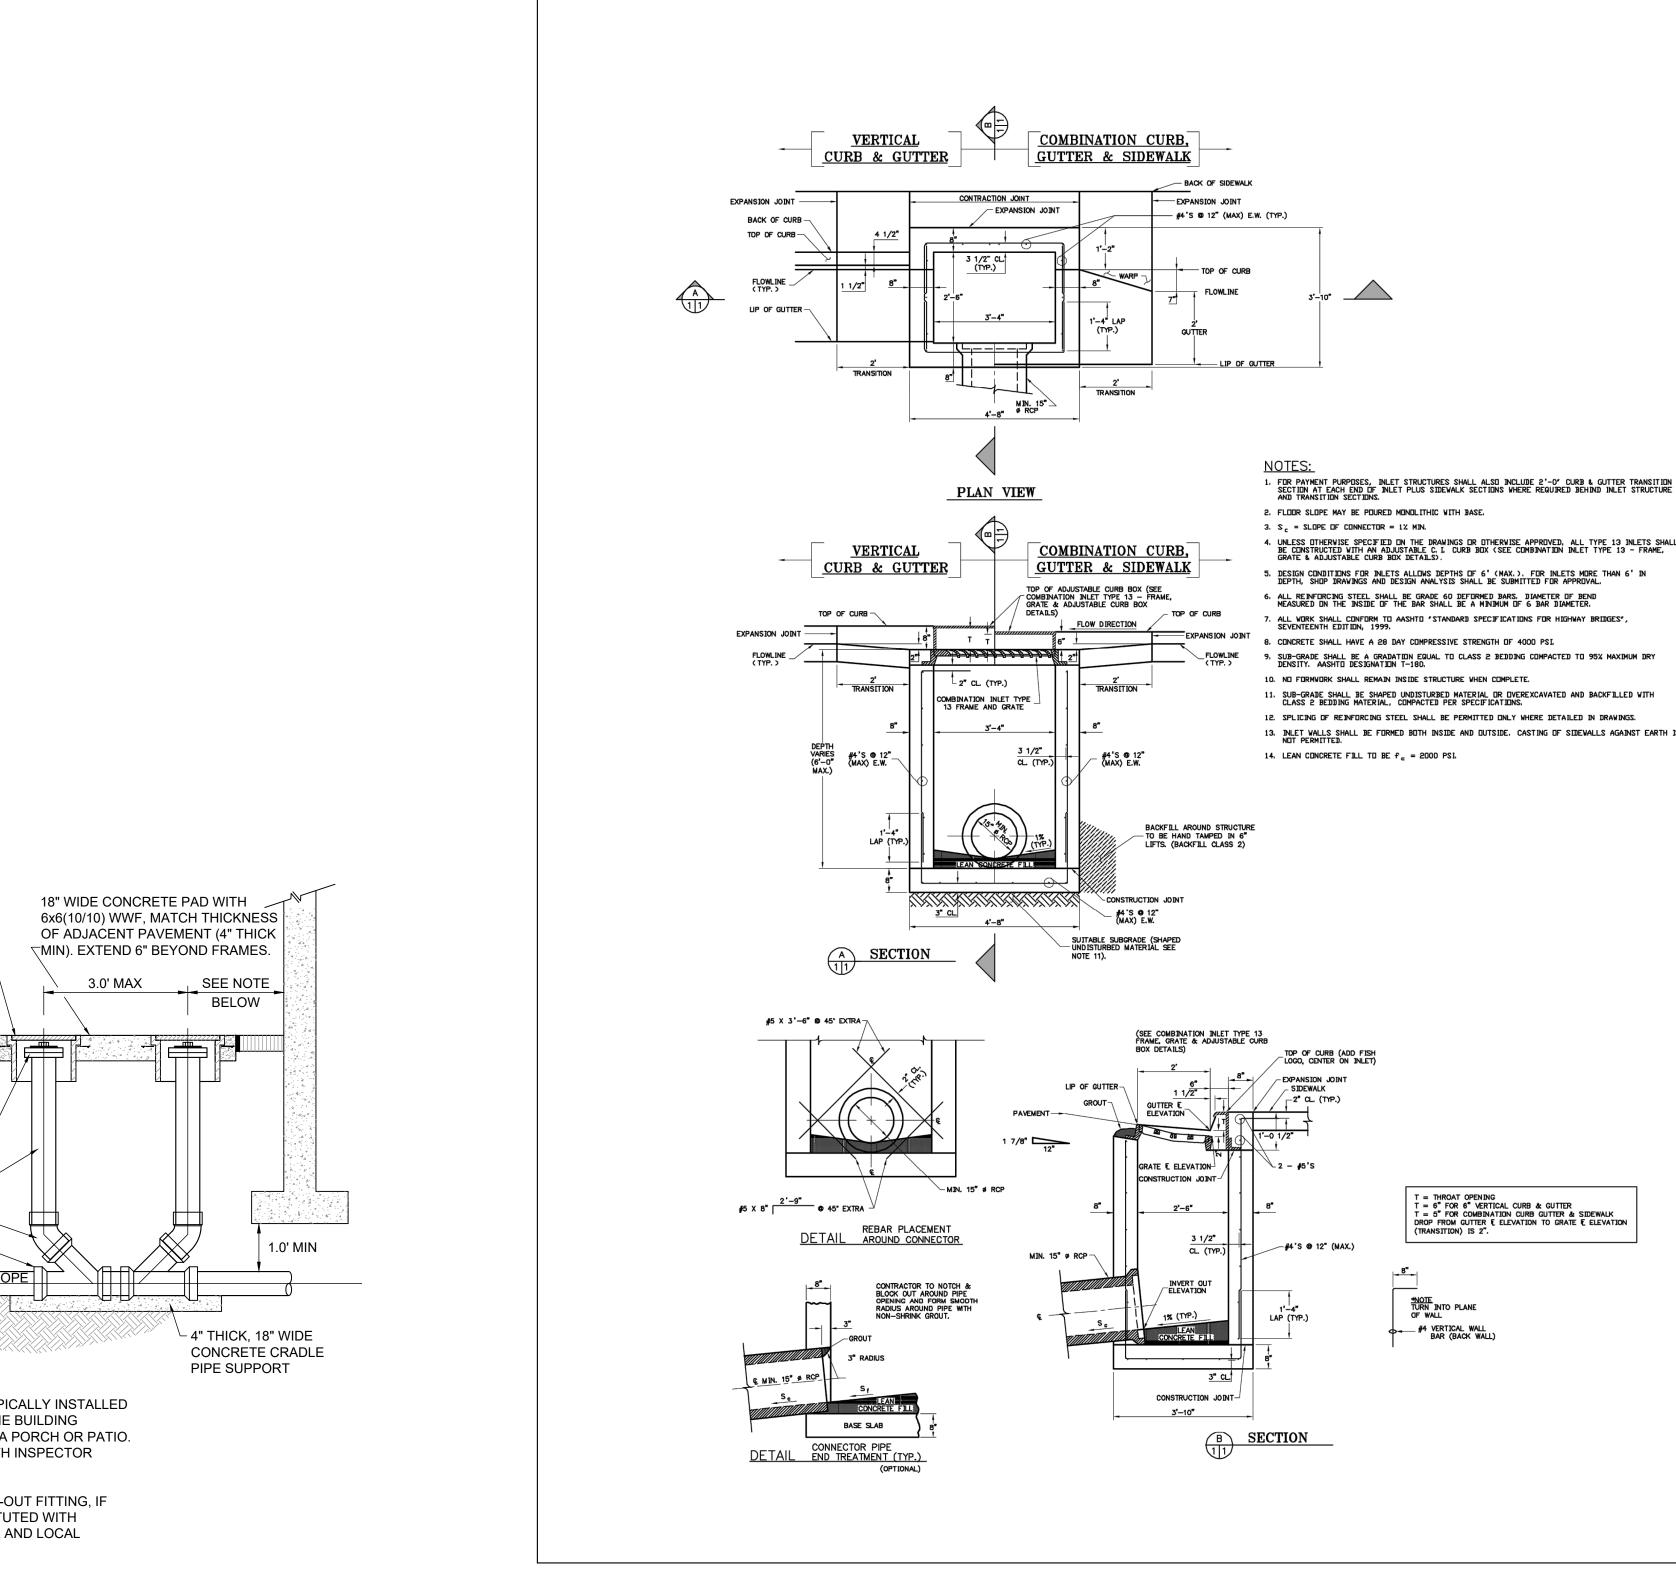

TWO WAY CLEAN OUT / В NOT TO SCALE

COMBINATION TYPE 13 INLET  $\overline{c}$ NOT TO SCALE

COUNTY PRO	JECT NUMBER PPR-17-030

SHEET NUMBER:

12 OF 21

SHEET TITLE: UTILITY DETAILS

TEL: (817) 527-8421

SOUTHLAKE, TX 76092

COLORADO SPRINGS, CO

VERTICAL CONSTRUCTION MANAGEMENT

1209 SOUTH WHITE CHAPEL BLVD, SUITE 180

PROPOSED COFFEE SHOP

**209 GLENEAGLE GATE VIEW** 

STERLING DESIGN ASSOCIATES, LLC ISSUES & REVISIONS NO.: 1 DATE: 5/16/2017 BY: JDS DESCRIPTION: 1ST MAJOR SDP SUBMITTAL NO.: 2 DATE: 8/24/2017 BY: JDS DESCRIPTION: 2ND MAJOR SDP SUBMITTAL NO.: 3 DATE: 9/13/2017 BY: JDS DESCRIPTION: 3RD MAJOR SDP SUBMITTAL NO.: 4 DATE: · BY: -DESCRIPTION: NO.: 5 DATE: BY: -

DESCRIPTION: -

DESCRIPTION:

DATE:

JDS

DRAWN BY:


PROJECT:

CLIENT:

9/13/2017

PROJECT MANAGER:

NO.: 6 DATE:

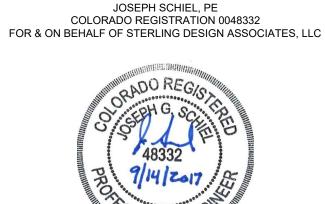

PREPARED UNDER THE DIRECT SUPERVISION OF

Sterling Design Associates, IIc

CIVIL ENGINEERS - LANDSCAPE ARCHITECTS

2009 W. Littleton Blvd. #300

www.SterlingDesignAssociates.com

Littleton, CO 80120

BY: -


SCALE:

1" = 20'

PROJECT NO .:


DRAWING FILE:

303.794.4727 ph





11. SUB-GRADE SHALL BE SHAPED UNDISTURBED MATERIAL OR OVEREXCAVATED AND BACKFILLED WITH CLASS 2 BEDDING MATERIAL, COMPACTED PER SPECIFICATIONS.

13. INLET WALLS SHALL BE FORMED BOTH INSIDE AND DUTSIDE. CASTING OF SIDEWALLS AGAINST EARTH IS

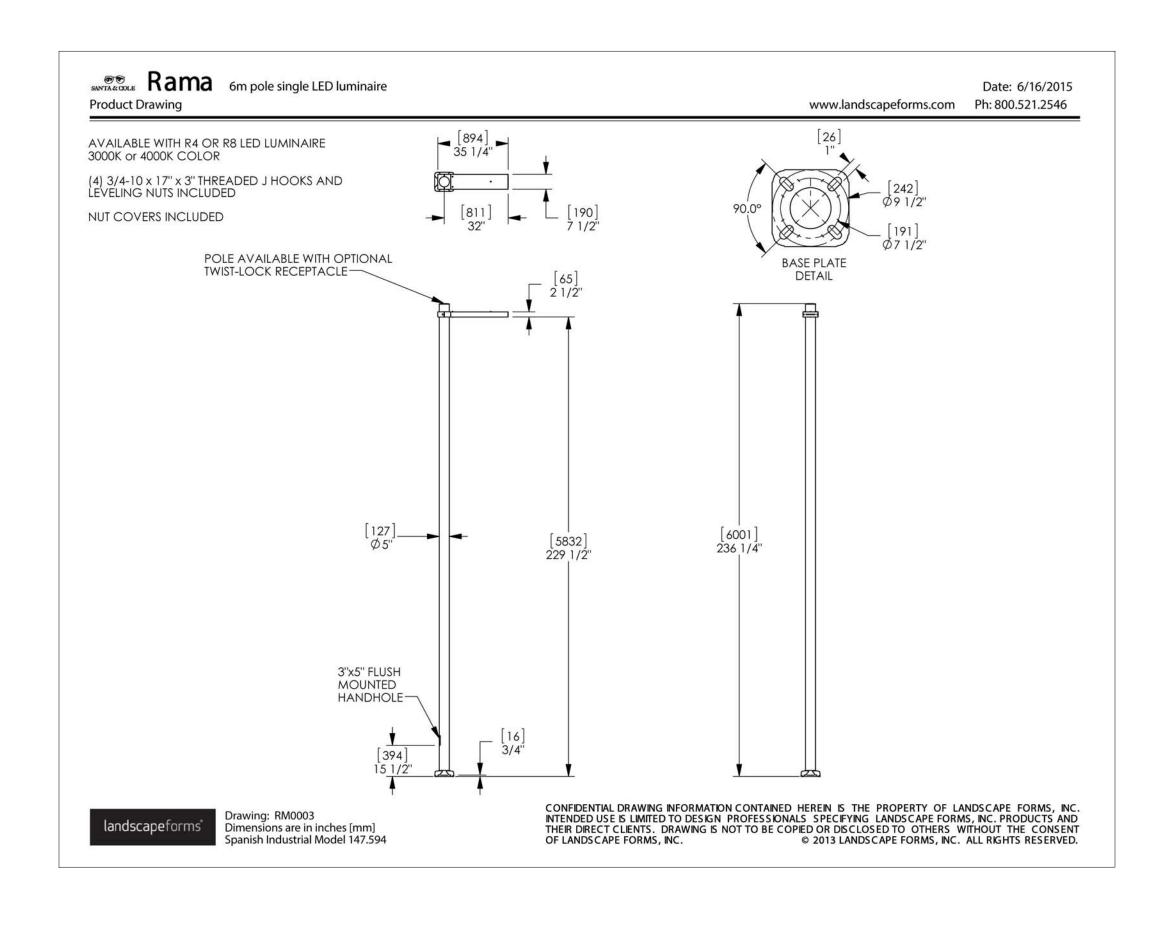





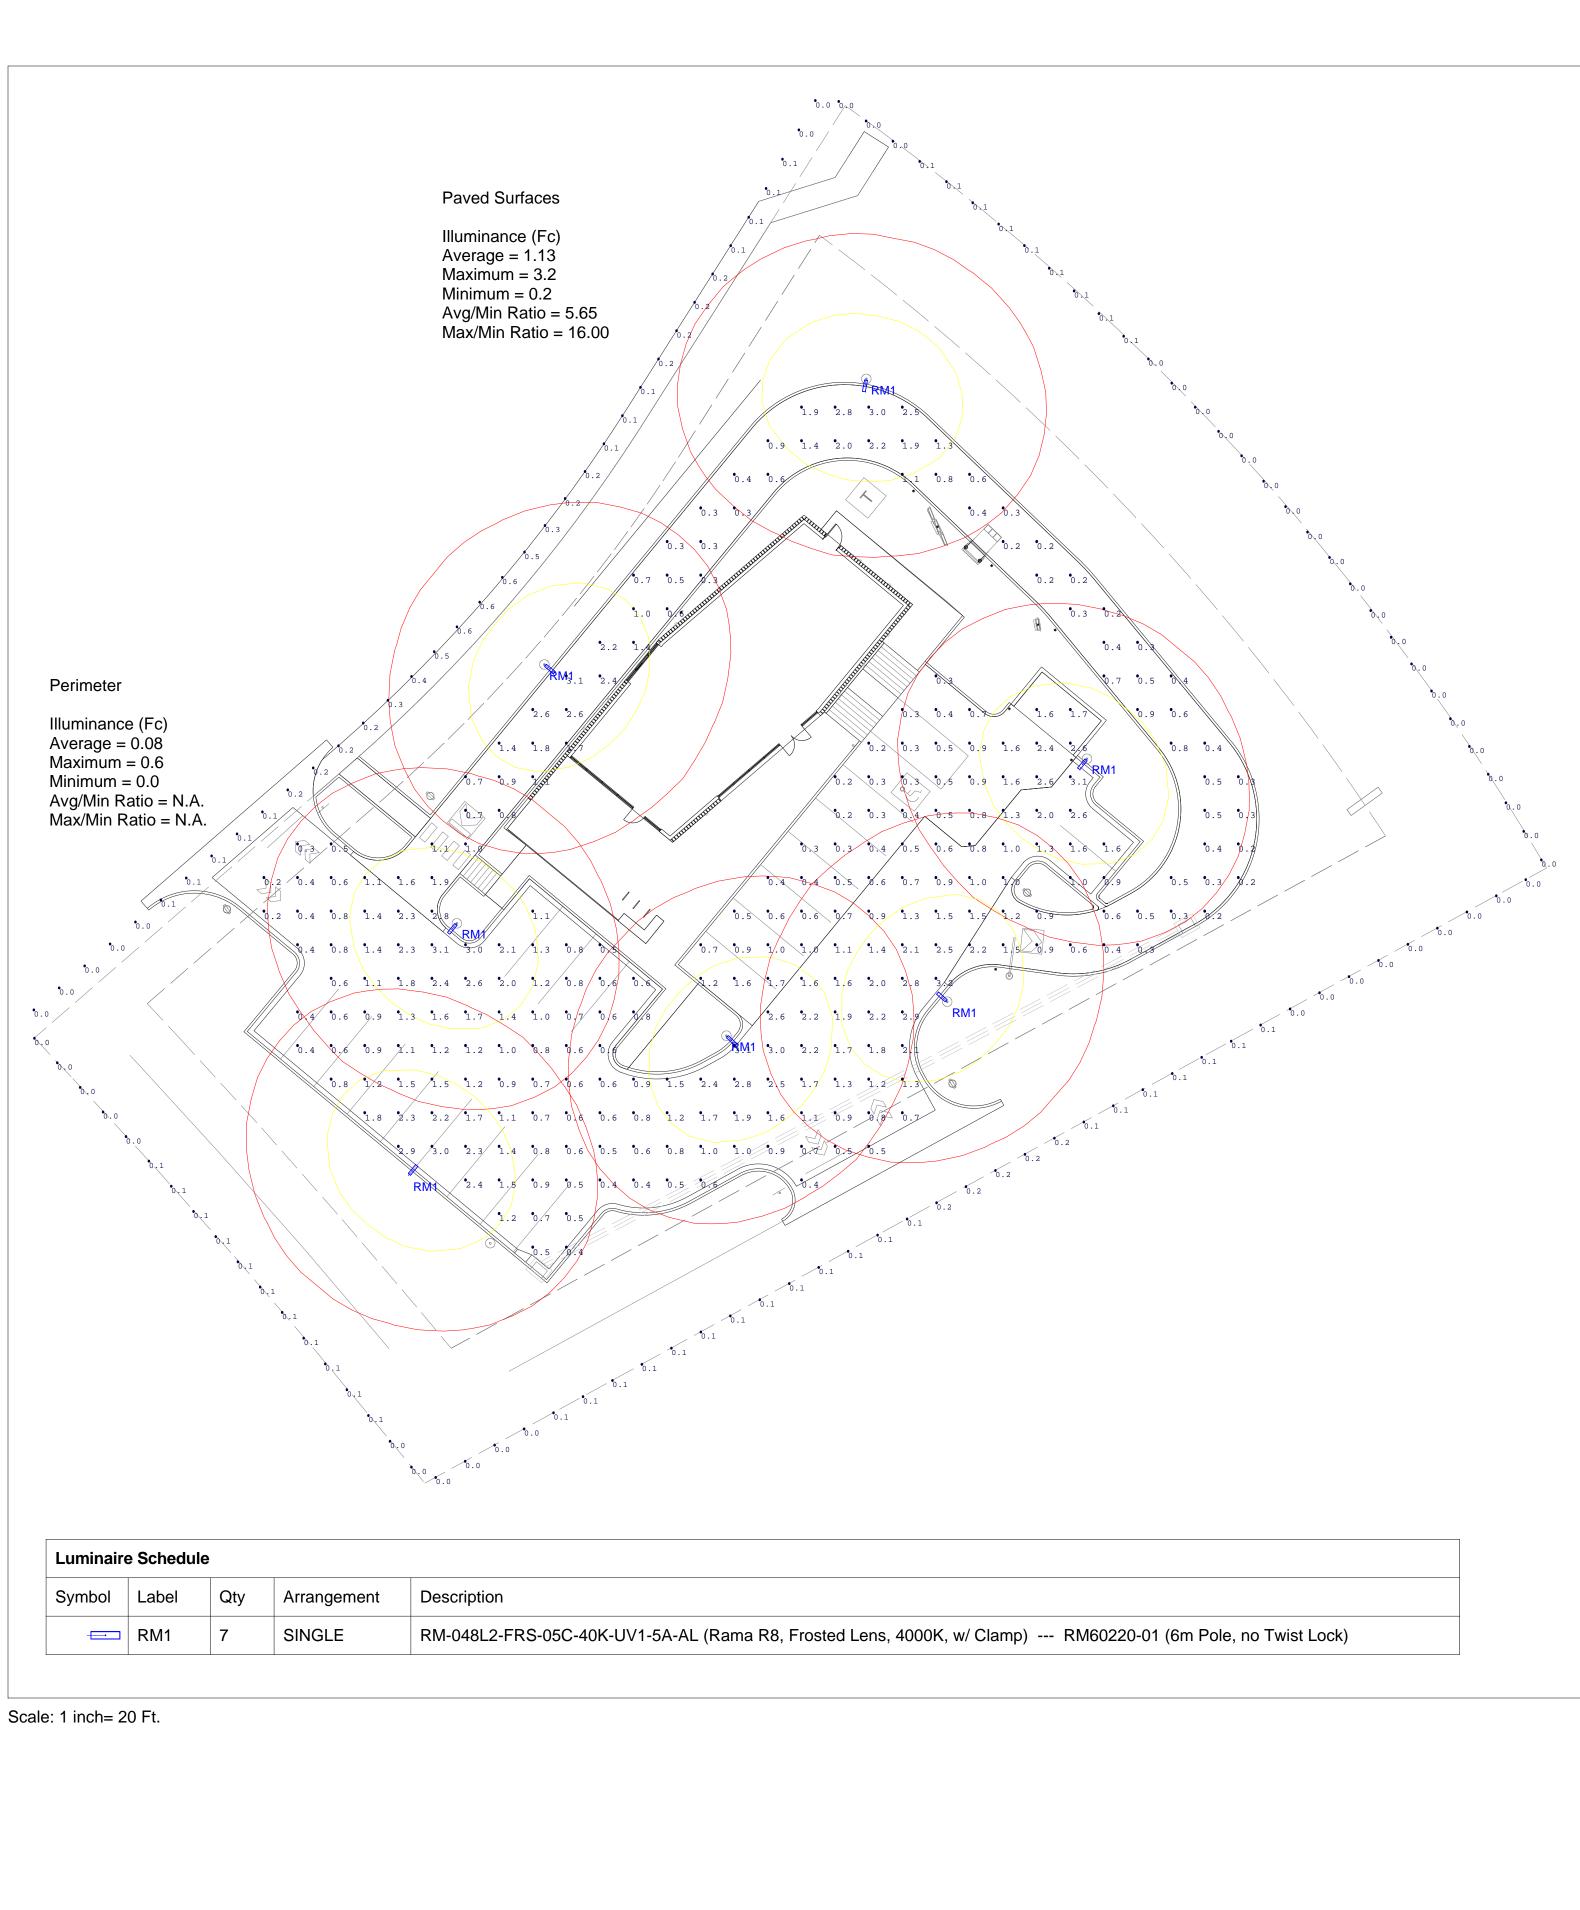

7800 E. Michigan Ave. Kalamazoo, MI 49048 800.430.6209 landscapeforms.com


Academy Gateway - Rama Lighting This drawing shows suggested fixtures and mounting locations based on the information provided. Landscape Forms assumes no responsibility for variation of light levels that result from changes in parameters not reported at the time of design.

Completed By: AH Checked By: CG Date:8/25/2017

AGi32 Version 18.3.2



### RAMA Product Data Sheet

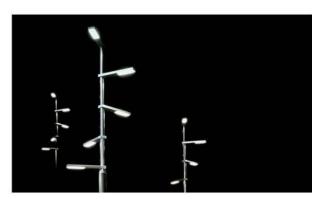

Rama, designed by Gonzalo Milá, is a simple, innovative and versatile street lamp delivering the latest in LED technology, Directional lighting and use of white light provides a great visual experience with reduced light pollution and excellent performance with reduced energy consumption. The housing is made of aluminum to dissipate heat and increase LED longevity. Offered with 3 standard pole heights, a single luminaire or multiple luminaires. can be mounted in different positions and heights. A simple clamping mechanism also allows Rama luminaires to be retrofitted to existing 5" poles, making it suitable for any outdoor space.

#### LED Technology

Rama employs solid state LED technology that provides exceptional energy efficiency and very long life, reducing maintenance cost. Designed to maximize this potential by managing the thermal properties of LEDs, the cast aluminum housing and anodized heat sink dissipate heat while its meticulous details and finish express quality you can see. Available in two standard color temperatures and offered with a clear or frosted glass lens.

#### Rama LED R4 Type 2 Distribution

Housing: Aluminum extrusion Lamp: 24 Cree XPG2 LEDs L70: >100,000 hrs Drive Current: 500mA Optic: Polycarbonate Lens: Clear / Frosted Glass Power Supply: 120V-277V LED Driver: Philips Xitanium 75W Dimmable: 0-10V or DALI IP Rating: IP66 Weight: 20 lbs (luminaire) EPA: 1.06 ft<sup>2</sup>





compensates for lumen depreciation by adjusting the drive current, allowing light output to remain constant throughout the luminaire maintenance cycle.

page 1 of 6

Landscape Forms, Inc. 1 800.521.2546 | F 269.381.3455 | 7800 E. Michigan Ave., Kalamazoo, MI 49048

### RAMA Product Data Sheet



### To Order Rama Luminaire


Product	Lamp	Lens	Drive Current	Color Temp.	Input Voltage	Mounting	Finish
RM Rama	024L2 (R4, 24 LED Type 2) 048L2 (R8, 48 LED Type 2)	CLR ( Clear Glass ) FRS ( Frosted Glass )	05C (500mA CLO <sup>1</sup> )	40K (4000K) 30K (3000K)	UV1 (120-277VAC)	5A (w/ clamp - single mount) 5B (w/o clamp - double mount)	AL ( Aluminun Silver )


### To Order Aluminum Pole


Specify: Rama pole with desired mounting option, optional 7-pin (ANSI 136.41) twist lock receptacle, and Powdercoat Color.


Height	Pole	Luminaire Configuration	Twist Lock	Diameter	Wall Thick
15	RM60219-01	(1) or (2) Rama luminaires at top	No	5"	.125"
4.5 meters	RM60219-02	(1) or (2) Rama luminaires at top	Yes	5"	.125"
	RM60220-01	(1) or (2) Rama luminaires at top	No	5"	.188"
C	RM60220-02	(1) or (2) Rama luminaires at top	Yes	5"	.188"
6 meters	RM60220-03	(2) Rama luminaires at different heights	No	5"	.188"
	RM60220-04	(2) Rama luminaires at different heights	Yes	5"	.188"
	RM60221-01	(1) or (2) Rama luminaires at top	No	5"/6"	.188"
	RM60221-02	(1) or (2) Rama luminaires at top	Yes	5"/6"	.188"
0	RM60221-03	(2) Rama luminaires at different heights	No	5"/6"	.188"
8 meters	RM60221-04	(2) Rama luminaires at different heights	Yes	5"/6"	.188"
	RM60226-01	(5) Rama luminaires in spiral configuration	No	5" / 7"	.188"
	RM60226-02	(5) Rama luminaires in sprial configuration	Yes	5"/7"	.188"

EXAMPLE: RM60220-01 - Powdercoat Color

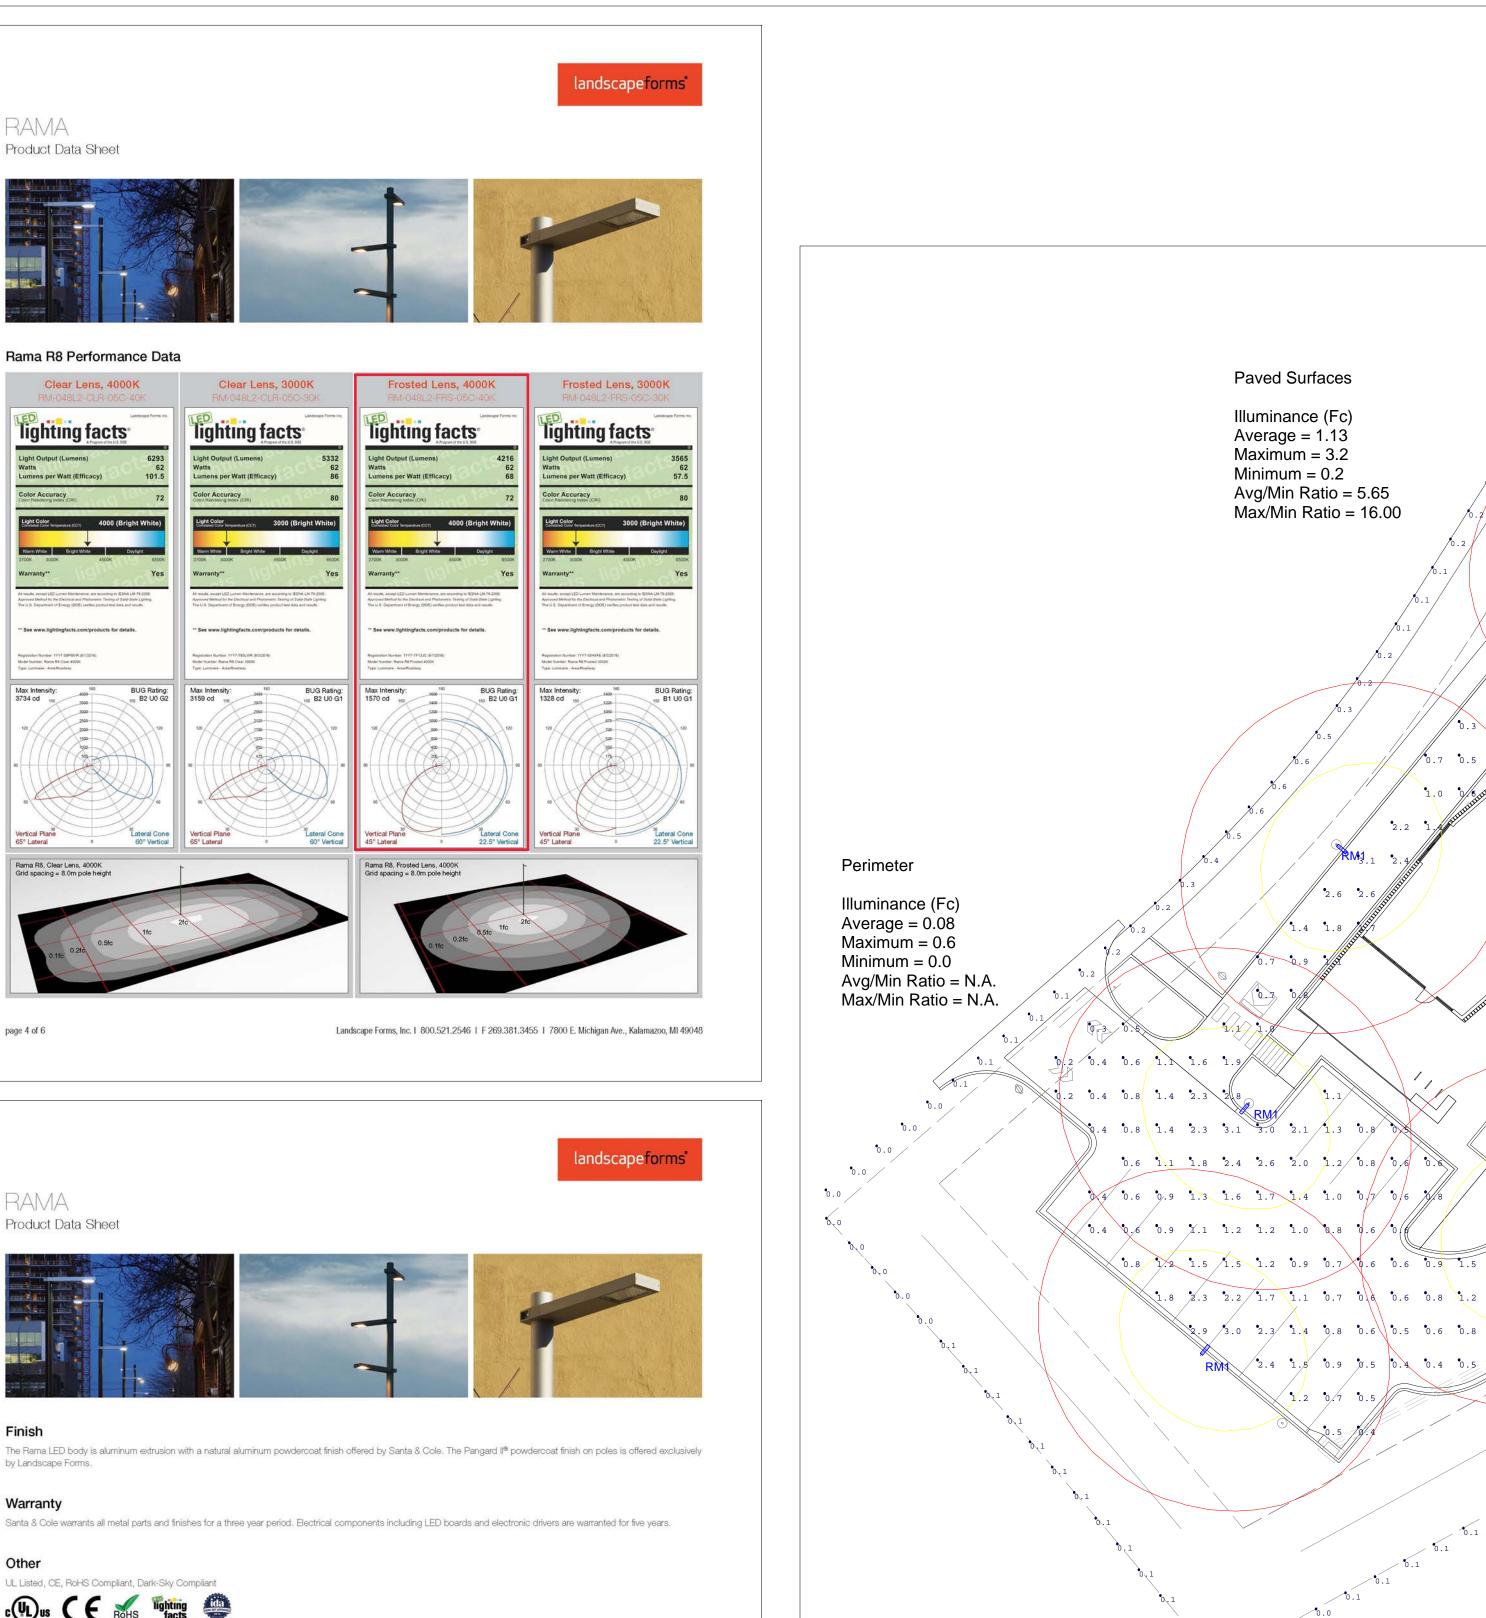

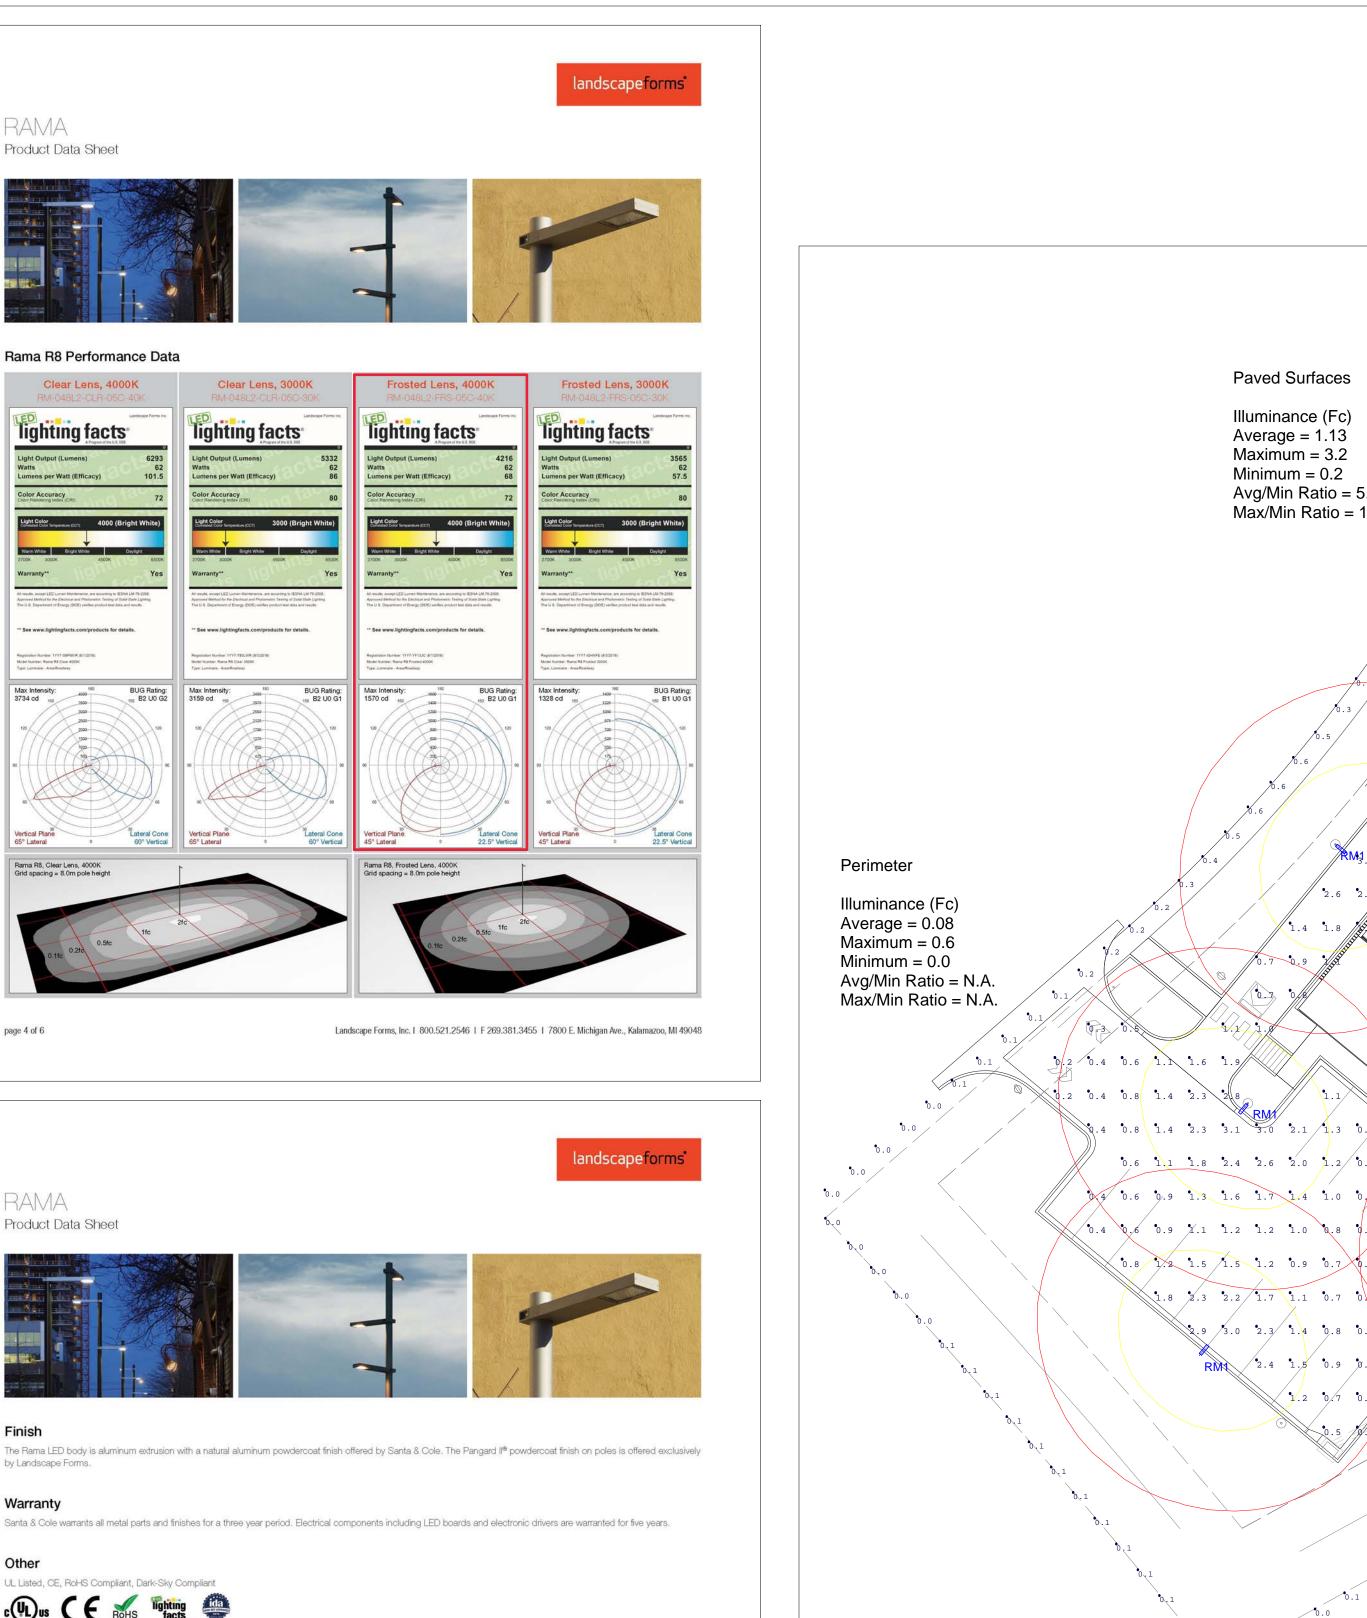

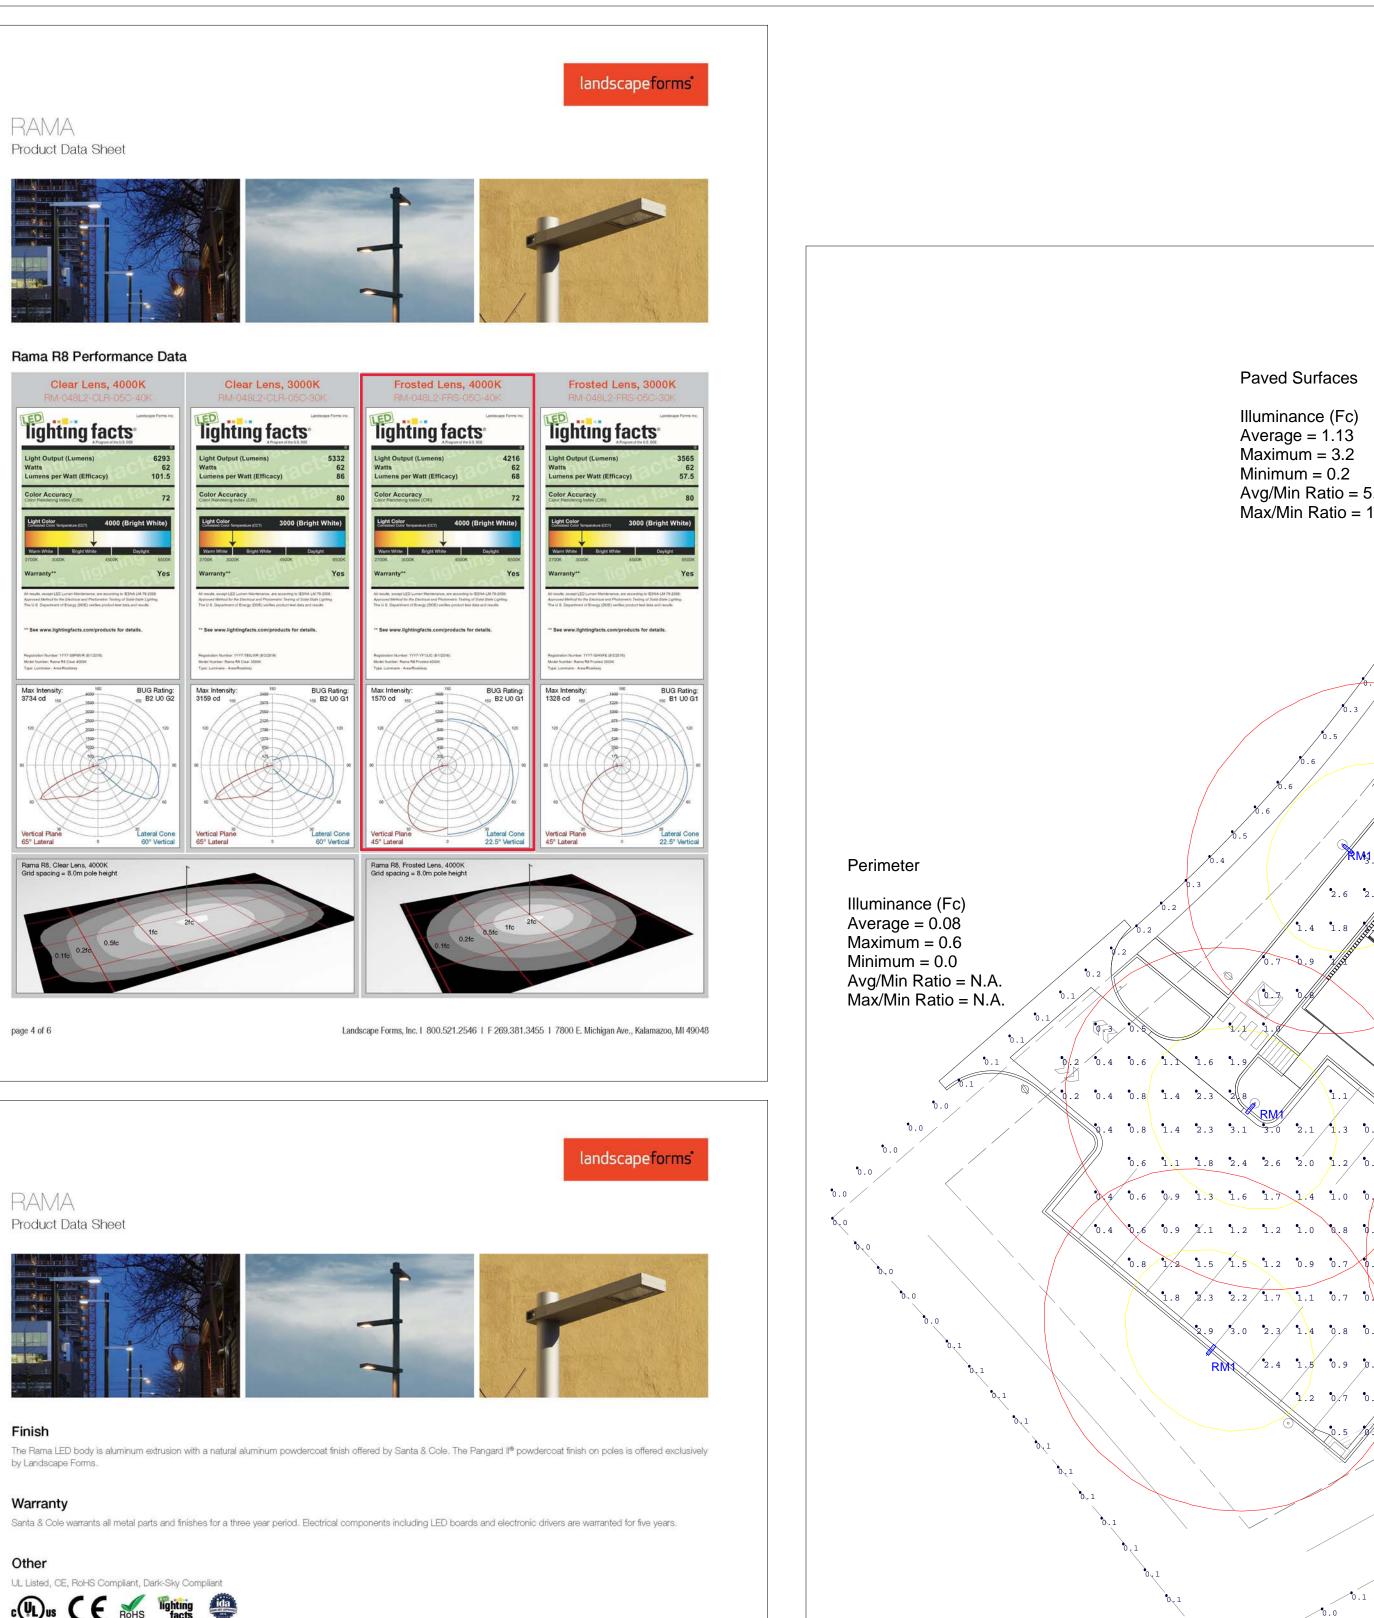

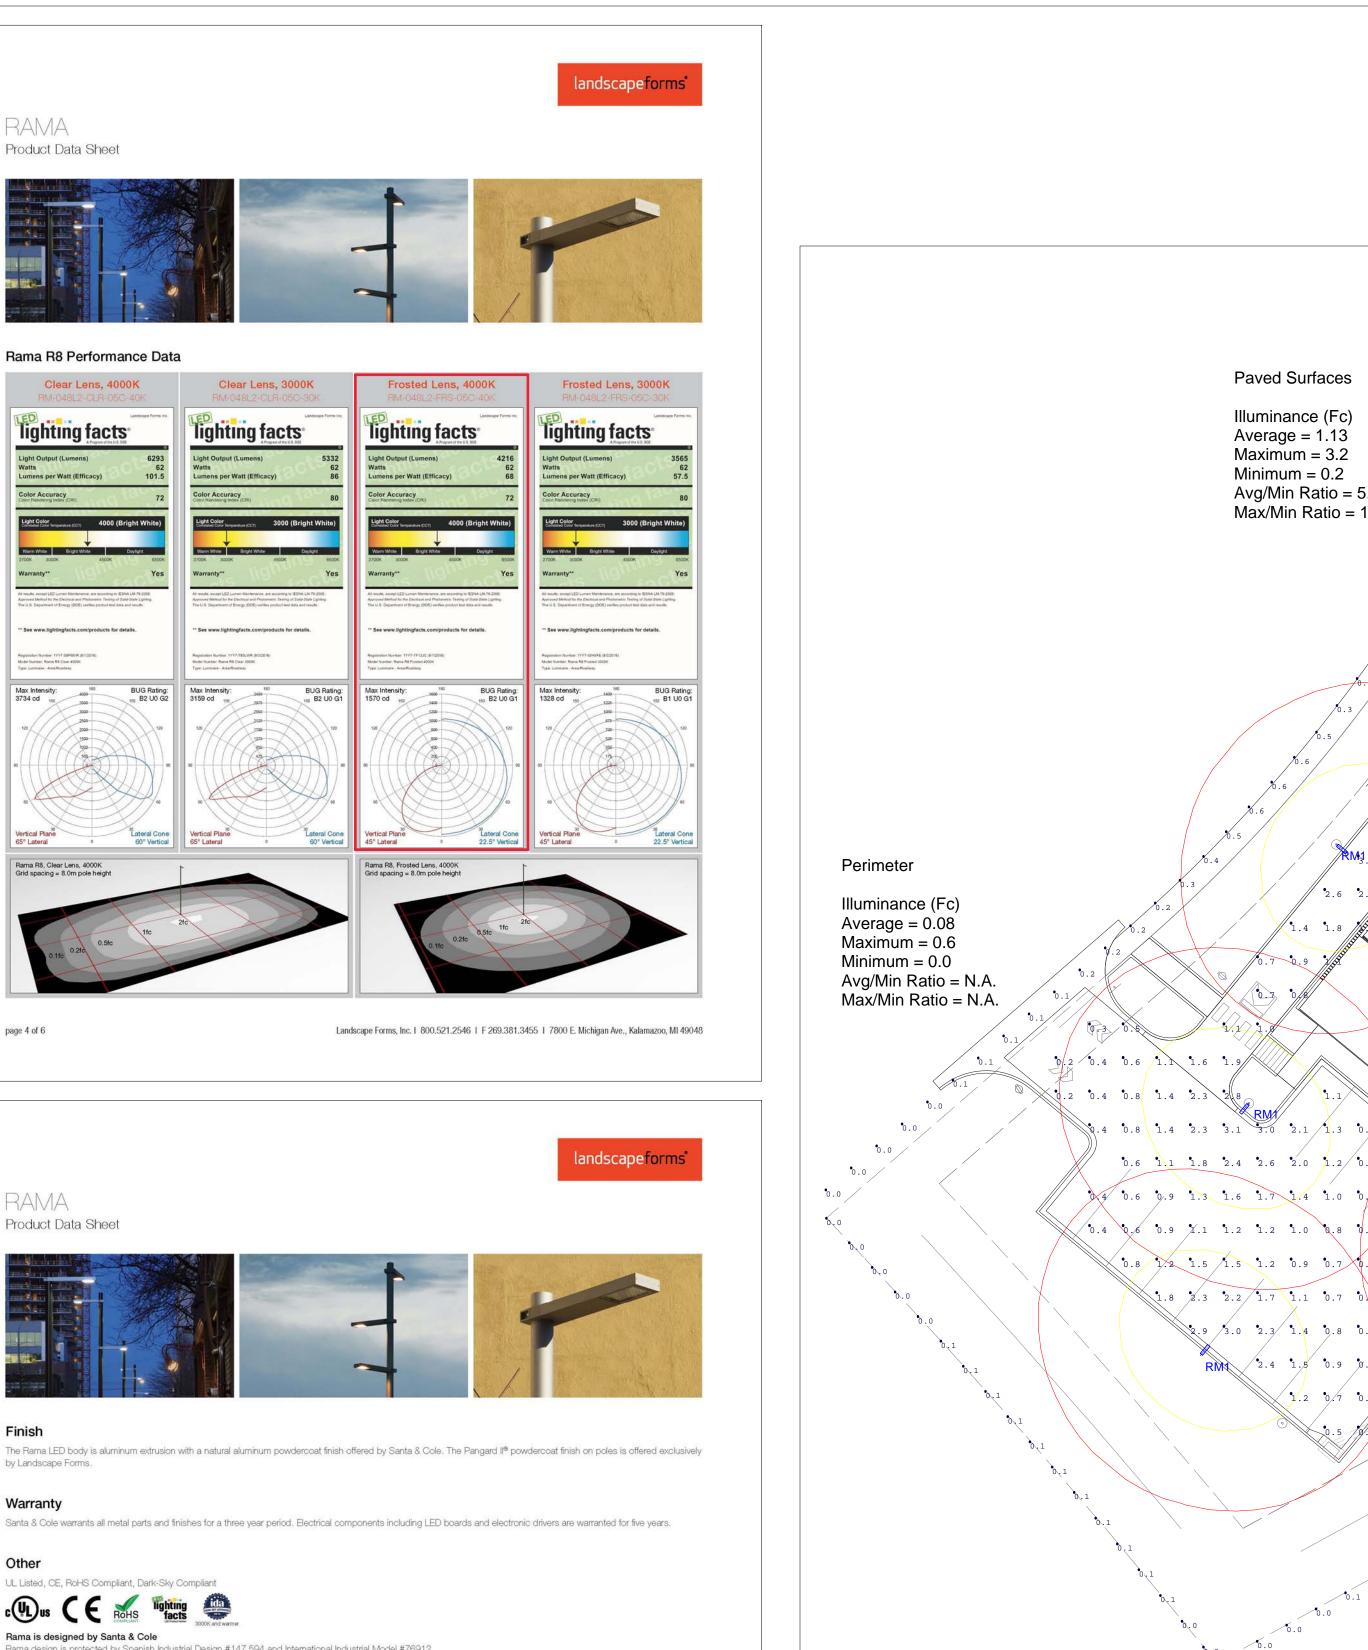

Rama design is protected by Spanish Industrial Design #147,594 and International Industrial Model #76912

Visit our landscapeforms.com for more information. Specifications are subject to change without notice. Landscape Forms supports the Landscape Architecture Foundation at the Second Century level. ©2016 Landscape Forms, Inc. Printed in U.S.A.


Landscape Forms, Inc. I 800.521.2546 | F 269.381.3455 | 7800 E. Michigan Ave., Kalamazoo, MI 49048

### Luminaire Schedule

ymbol	Label	Qty	Arrangement	Description
	RM1	7	SINGLE	RM-048L2-FRS-05C-40K-UV1

•0.0

Scale: 1 inch= 20 Ft.

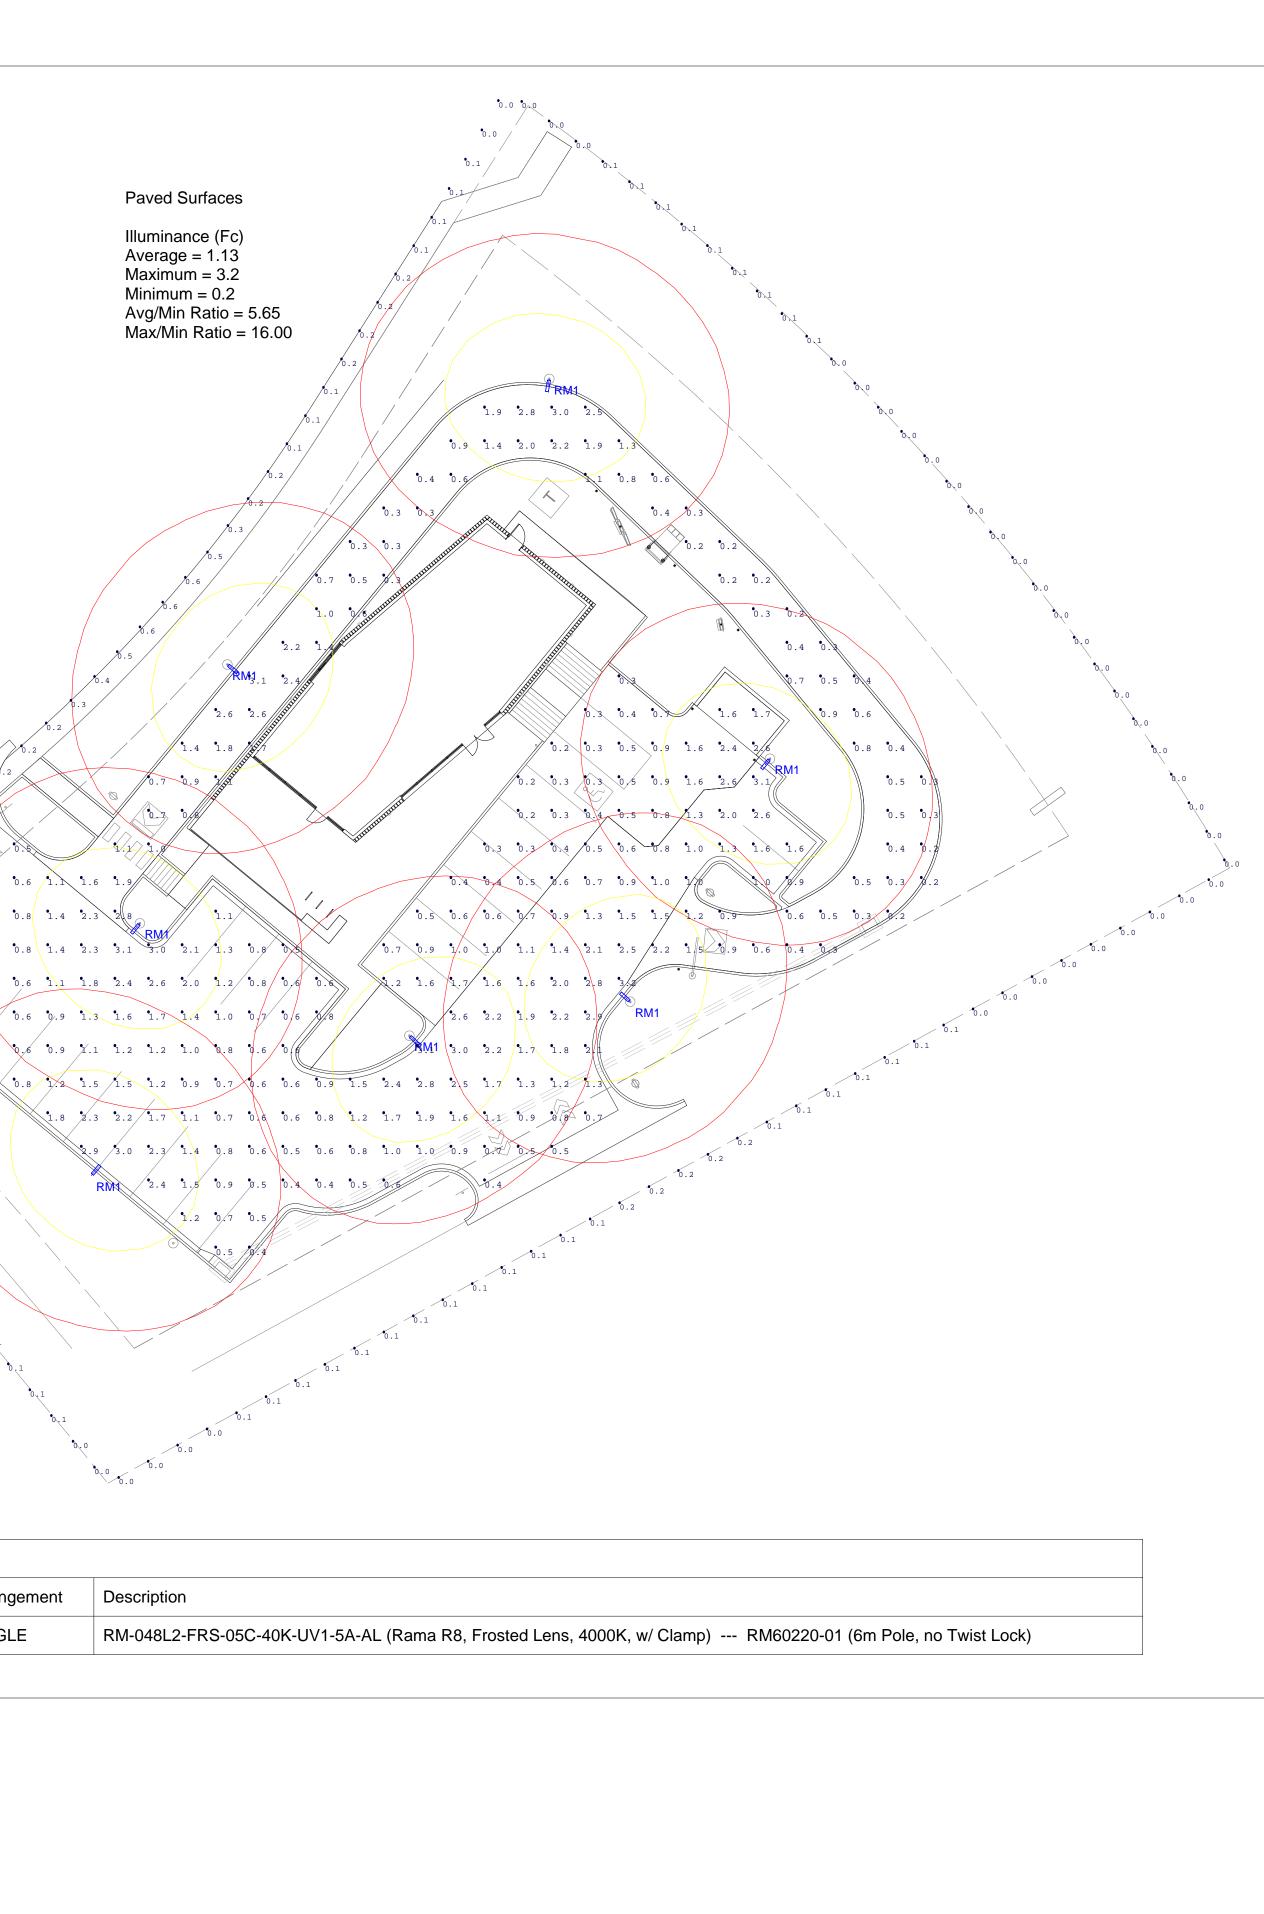

7800 E. Michigan Ave. Kalamazoo, MI 49048 800.430.6209 landscapeforms.com

Academy Gateway - Rama Lighting This drawing shows suggested fixtures and mounting locations based on the information provided.

Landscape Forms assumes no responsibility for variation of light levels that result from changes in parameters not reported at the time of design.


Completed By: AH Checked By: CG Date:8/25/2017

AGi32 Version 18.3.2

Comments:

Revision A Page 1 of 2

## LANDSCAPE DATA

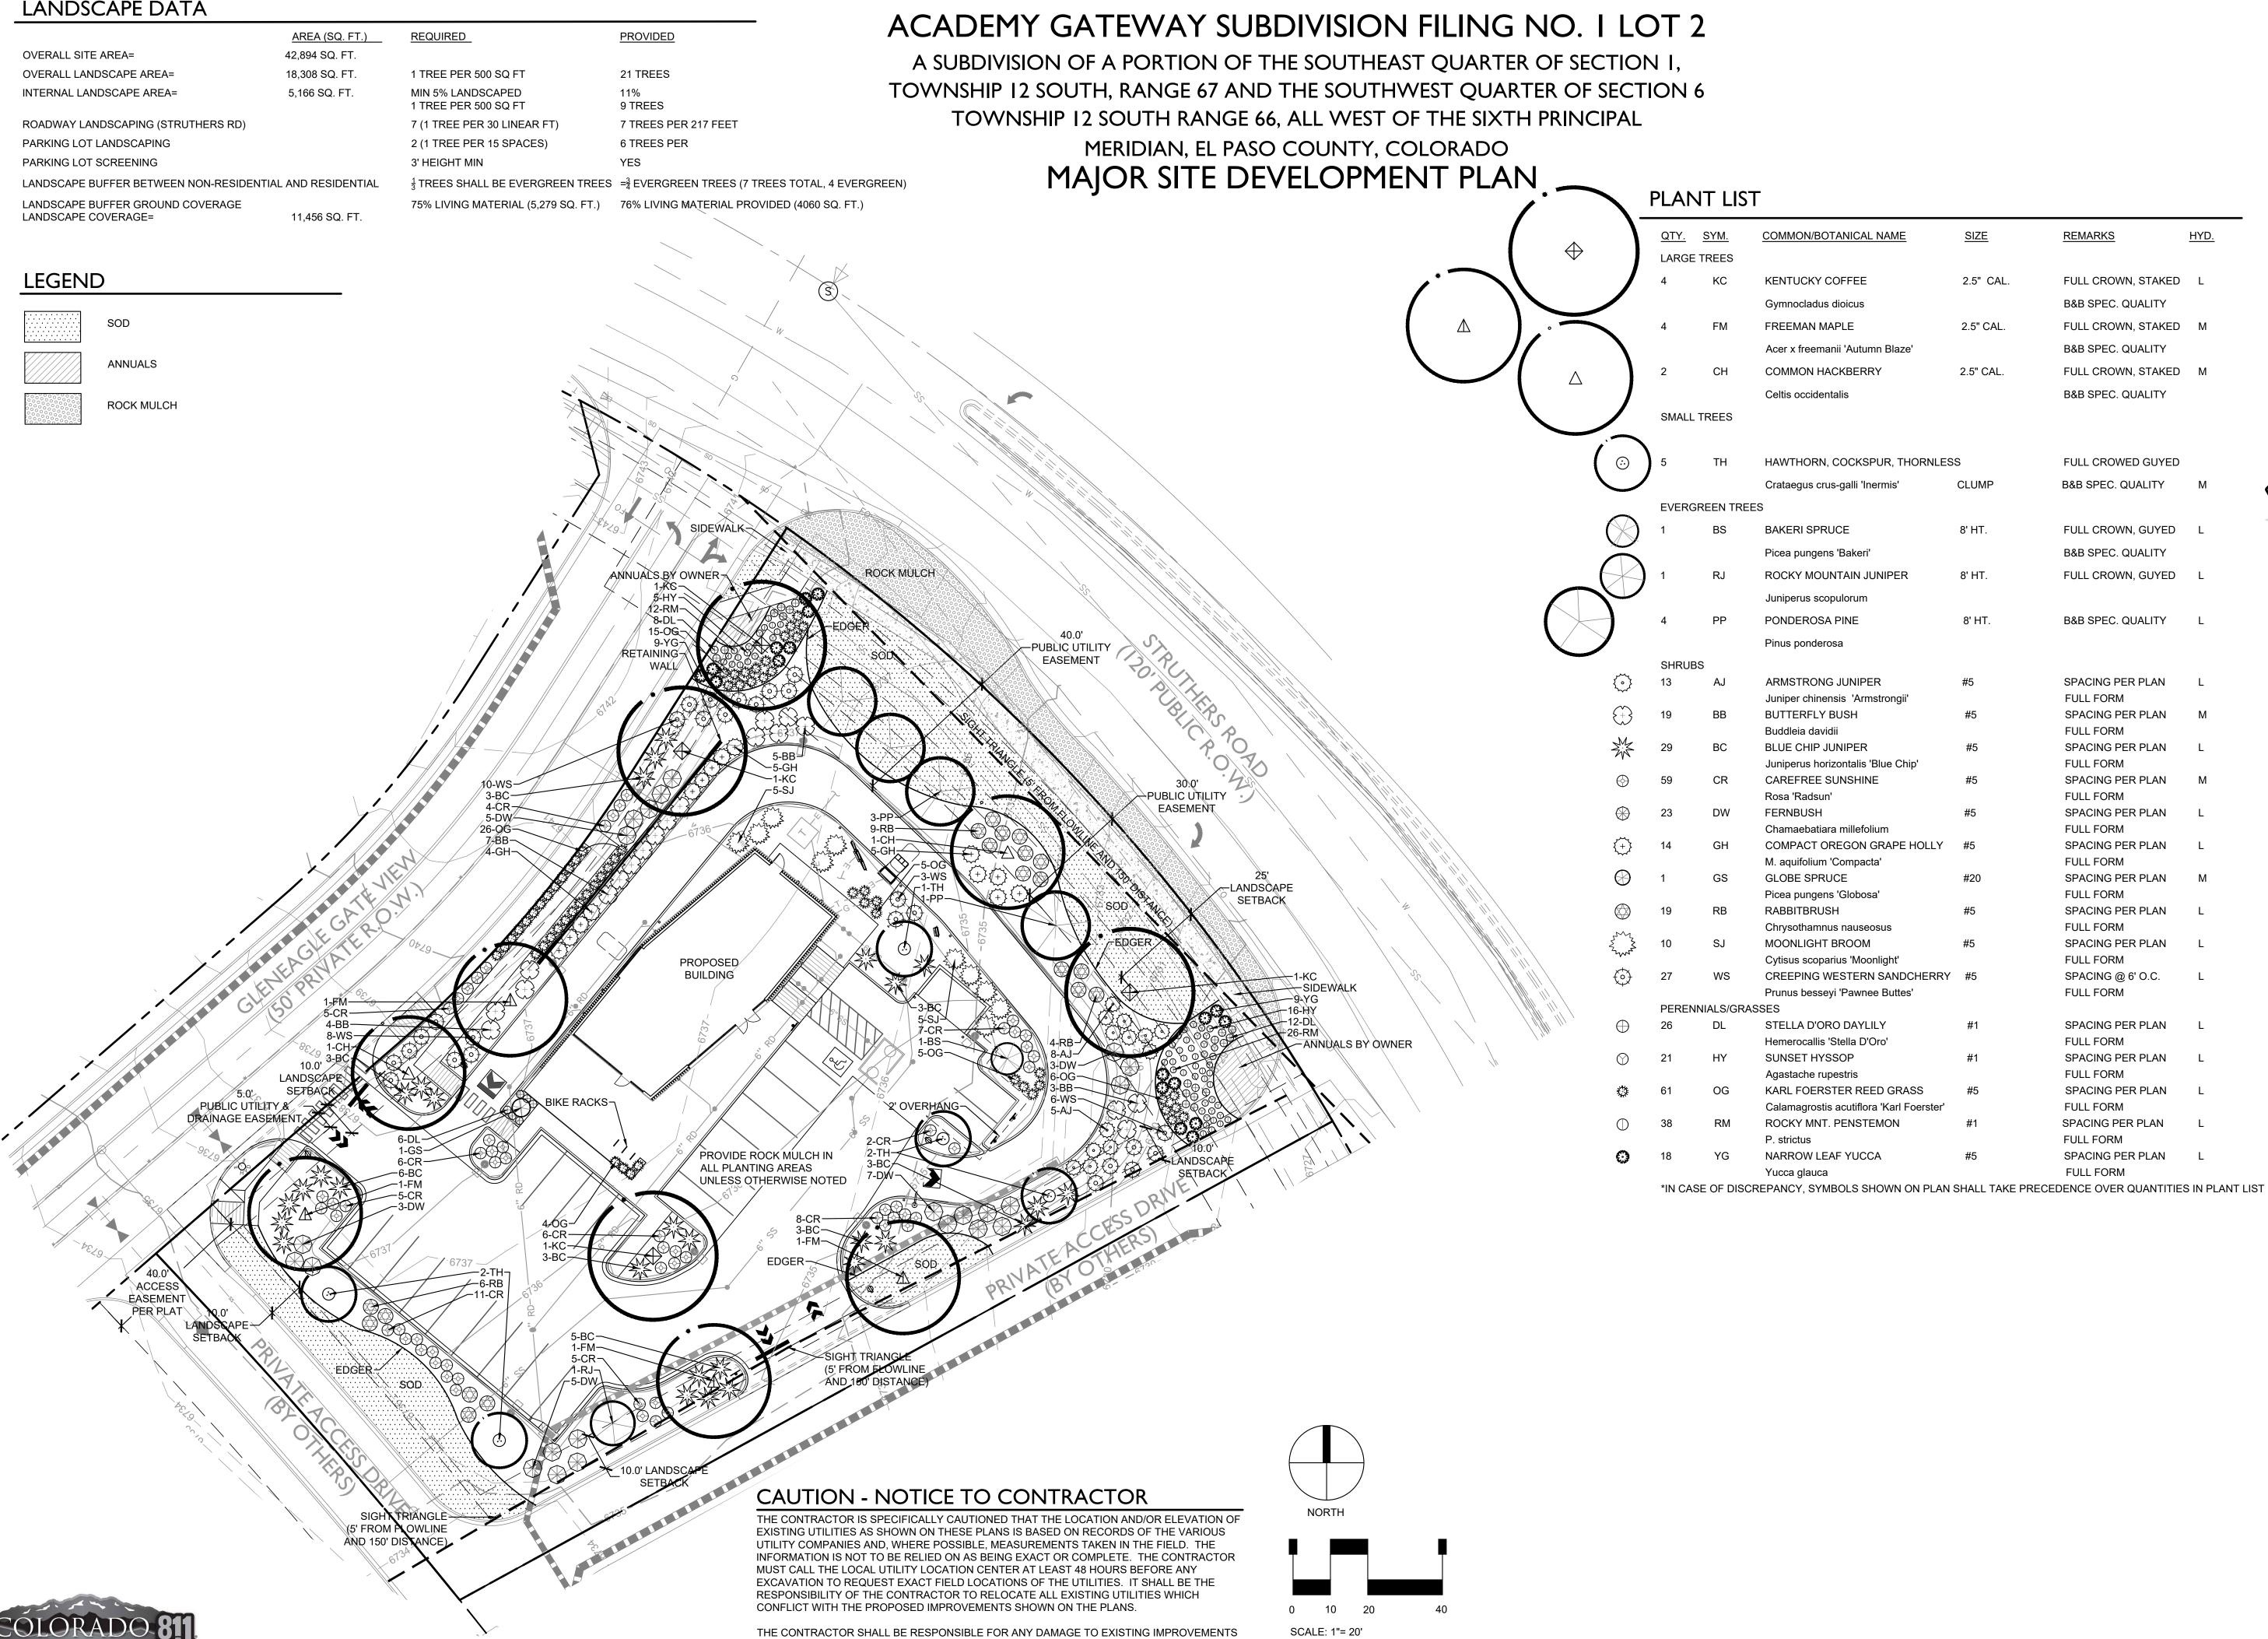


AND UTILITIES AND SHALL REPAIR ANY DAMAGE AT HIS EXPENSE.

ON/BOTANICAL NAME	SIZE	REMARKS	<u>HYD.</u>
JCKY COFFEE	2.5" CAL.	FULL CROWN, STAKED	L
ocladus dioicus		B&B SPEC. QUALITY	
MAN MAPLE	2.5" CAL.	FULL CROWN, STAKED	М
freemanii 'Autumn Blaze'		<b>B&amp;B SPEC. QUALITY</b>	
ION HACKBERRY	2.5" CAL.	FULL CROWN, STAKED	М
occidentalis		B&B SPEC. QUALITY	
HORN, COCKSPUR, THORNLES	S	FULL CROWED GUYED	
gus crus-galli 'Inermis'	CLUMP	B&B SPEC. QUALITY	М
RI SPRUCE	8' HT.	FULL CROWN, GUYED	L
oungens 'Bakeri'		B&B SPEC. QUALITY	
Y MOUNTAIN JUNIPER	8' HT.	FULL CROWN, GUYED	L
rus scopulorum	-	,	
	01.11		
EROSA PINE	8' HT.	B&B SPEC. QUALITY	L
oonderosa			
TRONG JUNIPER	#5	SPACING PER PLAN	L
r chinensis 'Armstrongii'		FULL FORM	
ERFLY BUSH ia davidii	#5	SPACING PER PLAN FULL FORM	М
CHIP JUNIPER	#5	SPACING PER PLAN	L
rus horizontalis 'Blue Chip'		FULL FORM	-
REE SUNSHINE	#5	SPACING PER PLAN	М
Radsun'		FULL FORM	
BUSH	#5	SPACING PER PLAN	L
aebatiara millefolium ACT OREGON GRAPE HOLLY	#5	FULL FORM SPACING PER PLAN	L
ifolium 'Compacta'	#5	FULL FORM	L
E SPRUCE	#20	SPACING PER PLAN	М
oungens 'Globosa'		FULL FORM	
TBRUSH	#5	SPACING PER PLAN	L
othamnus nauseosus ILIGHT BROOM	#6	FULL FORM SPACING PER PLAN	
s scoparius 'Moonlight'	#5	FULL FORM	L
PING WESTERN SANDCHERRY	#5	SPACING @ 6' O.C.	L
s besseyi 'Pawnee Buttes'		FULL FORM	
A D'ORO DAYLILY	#1	SPACING PER PLAN	L
ocallis 'Stella D'Oro'		FULL FORM	_
ET HYSSOP	#1	SPACING PER PLAN FULL FORM	L
ache rupestris FOERSTER REED GRASS	#5	FULL FORM SPACING PER PLAN	L
agrostis acutiflora 'Karl Foerster'		FULL FORM	-
Y MNT. PENSTEMON	#1	SPACING PER PLAN	L
tus		FULL FORM	
OW LEAF YUCCA	#5	SPACING PER PLAN	L
DIALICA			

FULL FORM



🠼 Sterling Design Associates, Ilc

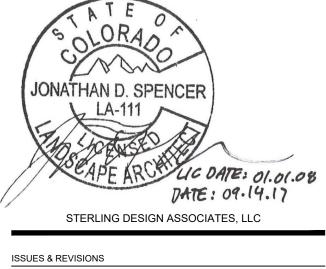

NO.: 1 DATE: 5/16/2017 DESCRIPTION: 1ST MAJOR SDP SUBMITTAL NO.: 2 DATE: 8/24/2017 DESCRIPTION: 2ND MAJOR SDP SUBMITTAL	BY: JDS BY: JDS
NO.: 2 DATE: 8/24/2017	BY: JDS
	BY: JDS
DESCRIPTION: 2ND MAJOR SDP SUBMITTAL	
NO.: 3 DATE: 9/13/2017	BY: JDS
DESCRIPTION: 3RD MAJOR SDP SUBMITTAL	
NO.: 4 DATE: -	BY: -
DESCRIPTION: -	
NO.: 5 DATE: -	BY: -
DESCRIPTION: -	
NO.: 6 DATE: -	BY: -
DESCRIPTION: -	DI

DATE: 9/13/2017	scale: <b>1'' = 20'</b>
PROJECT MANAGER: JDS	PROJECT NO.:
DRAWN BY: CM	DRAWING FILE:

PROJECT:

### PROPOSED COFFEE SHOP 209 GLENEAGLE GATE VIEW COLORADO SPRINGS, CO

CLIENT:

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

COUNTY PROJECT NUMBER PPR-17-030


TEL: (817) 527-8421

SHEET NUMBER:

15 OF 21

SHEET TITLE:

LANDSCAPE PLAN

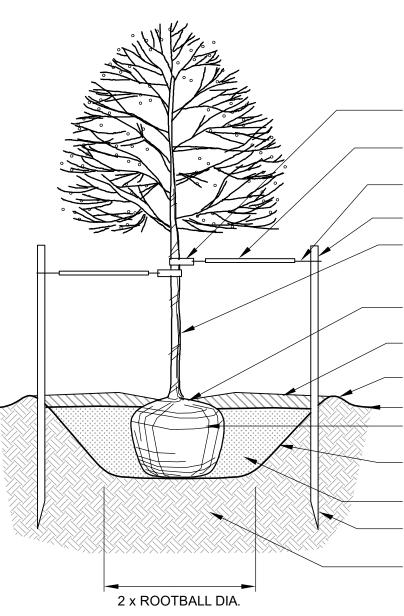

DO NOT CUT SINGLE LEADER. PRUNE DAMAGED OR DEAD WOOD AND CO-DOMINANT LEADERS AT LANDSCAPE ARCHITECT'S DIRECTION ONLY.

12" NYLON TREE STRAP ON GUY WIRE AND AROUND TREE TRUNK.

1/2" DIAM. WHITE PVC PIPE SECTION ON ENTIRE LENGTH OF EACH WIRE. 14 GAUGE GALVANIZED WIRE, DOUBLE

STRAND TWISTED. 6' STEEL T-POST (2 MIN.) (4' EXPOSED)

WRAP ENTIRE SURFACE OF TRUNK TO SECOND BRANCH WITH SPECIFIED TREE WRAP MATERIAL SECURED AT TOP AND BOTTOM & AT 2-FT. INTERVALS. RE: SPECS FOR TIMING.

SET ROOT COLLAR 3" HIGHER THAN GRADE AT WHICH TREE GREW

48" CIRCLE OF SHREDDED BARK MULCH (4" DEEP) AROUND BASE OF TREES IN GRASS AREAS. FORM SAUCER AROUND EDGE OF TREE PIT

#### — FINISH GRADE

REMOVE ALL TWINE AND WIRE BASKET ENTIRELY. PULL BURLAP BACK 2/3 MINIMUM SLOPE SIDES OF PIT AS SHOWN. ROUGHEN SIDES PRIOR TO BACKFILLING.

SPECIFIED BACKFILL MIXTURE

STAKE TO EXTEND MIN. 24" INTO UNDISTURBED SOIL.


UNDISTURBED SUBGRADE

ANY BROKEN OR CRUMBLING ROOTBALL WILL BE REJECTED. REMOVING THE WIRE WILL NOT BE AN EXCUSE FOR DAMAGED ROOTBALLS. REMOVE STAKING AFTER ONE YEAR.



SHRUB PLANTING

NOT TO SCALE

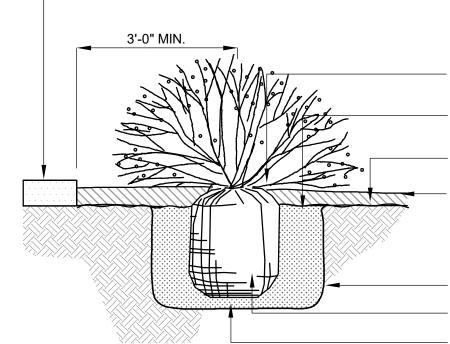

CONCRETE CURB OR SIDEWALK

PRUNE ALL DAMAGED OR DEAD WOOD IMMEDIATELY PRIOR TO PLANTING

SET SHRUB 1" HIGHER THAN THE GRADE AT WHICH IT GREW

DIG PLANT PIT TWICE AS WIDE OR MORE AS THE CONTAINER

APPLY SPECIFIED MULCH 4" DEEP OVER SPECIFIED WEED MAT.

FINISHED GRADE

ALL JUNIPER PLANTS SHOULD BE PLANTED SO TOP OF ROOT MASS OCCURS AT FINISH GRADE OF MULCH LAYER

LOOSEN SIDES OF PLANT PIT AND ROOTBALL REMOVE CONTAINER

BACKFILL: ONE THIRD ORGANIC MATTER

TWO THIRDS SITE SOIL THOROUGHLY MIXED

ANY BROKEN OR CRUMBLING ROOTBALL WILL BE REJECTED. REMOVING THE CONTAINER WILL NOT BE AN EXCUSE FOR DAMAGED ROOTBALL

# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

# MAJOR SITE DEVELOPMENT PLAN



- 1. COORDINATION: THIS LANDSCAPE ARCHITECTURAL SITE PLAN IS TO BE USED IN CONJUNCTION WITH THE CIVIL, ARCHITECTURAL, MECHANICAL, ELECTRICAL, STRUCTURAL AND IRRIGATION PLANS AND SPECIFICATIONS TO FORM COMPLETE INFORMATION REGARDING THIS SITE
- 2. COMPLIANCE
- 3. GUARANTEE: DATE OF FINAL ACCEPTANCE, AT NO ADDITIONAL COST TO THE OWNER.
- 4. COMPLETION AND MAINTENANCE: SHALL SIGNIFY ACCEPTANCE.
- INSECT PROTECTION.
- 5. SITE CONDITIONS: GRADES AND POSITIVE DRAINAGE IN LANDSCAPE AREAS.
- 6. DAMAGE AND CLEANING: AT NO ADDITIONAL COST TO THE OWNER.
- REMOVE ALL UNUSED MATERIALS FROM SITE.
- 7. RIGHT OF REJECTION:
- 8. SOIL PREPARATION (AS NEEDED): REPLACE WITH NEW TOPSOIL.
- 9. PLANTING: FERTILIZE AS RECOMMENDED WITH AGRIFORM TABLETS.
- 10. SODDING
- 11. EDGER (AS NEEDED): AREAS.
- 12. MULCH: BUILDING WERE ADJACENT TO LANDSCAPE AREAS.
- 13. MAINTENANCE:
- 14. IRRIGATION: IRRIGATED USING A DRIP IRRIGATION SYSTEM.
- 15. ROCK MULCH:

DO NOT CUT OR DAMAGE LEADER

- RUBBER HOSE (1/2" DIA.) OR 12" NYLON TREE STRAP ON GUY WIRE TO PROTECT TREE

- #12 GALVANIZED WIRE TWISTED DOUBLE STRAND. MIN. 3 GUY WIRES PER TREE - 1/2" DIA. X 36" LONG WHITE PVC PIPE

ON EACH GUY WIRE - SET ROOTBALL 3" HIGHER THAN GRADE AT

WHICH TREE GREW. - APPLY 4" OF BARK MULCH TO THE OUTSIDE EDGE OF SAUCER UPON PLANTING APPLY 18-24" RING OF BARK MULCH 4" DEEP UPON COMPLETION OF SEEDING OR SODDING

- FINISHED GRADE 30" METAL "T" STAKE. DRIVE VERTICALLY INTO UNDISTURBED SOIL, FLUSH W/GRADE

- REMOVE BURLAP FROM TOP 2/3 OF ROOTBALL - REMOVE WIRE COMPLETELY FROM ROOTBALL

- UNDISTURBED SUBGRADE - SPECIFIED BACKFILL MIXTURE HOLE SHOULD

HAVE ROUGHENED SIDES AND FERTILIZER APPLICATION REMOVE GUYING AFTER ONE YEAR.



THE VIN

2 x ROOTBALL DIA.



NOTE: WALL SHOWN FOR GENERAL LOOK AND FEEL. \*IMAGE BY NATIVE EARTH LANDSCAPING, SANTA FE, NM LANDSCAPE WALL NOT TO SCALE

– 4"-8" RED STRIP STONE DRY STACKED

### COUNTY PROJECT NUMBER PPR-17-030

16 OF 21

SHEET NUMBER:

### LANDSCAPE NOTES AND DETAILS

SHEET TITLE:

TEL: (817) 527-8421

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

CLIENT


### PROPOSED COFFEE SHOP **209 GLENEAGLE GATE VIEW COLORADO SPRINGS, CO**

<b>JB</b> S	-	
DRAWN BY:	DRAWING FILE:	
СМ	-	
PROJECT:		

DATE: 9/13/2017	SCALE: <b>1" = 20'</b>
PROJECT MANAGER: JBS	PROJECT NO.:
DRAWN BY:	DRAWING FILE:

DESCRIPTION: 2ND MAJOR SDP SUBMITTAL		
NO.: 3 DATE: 9/13/2017	BY:	JDS
DESCRIPTION: 3RD MAJOR SDP SUBMITTAL		
NO.: 4 DATE: -	BY:	-
DESCRIPTION: -		
NO.: 5 DATE: -	BY:	-
DESCRIPTION: -		
NO.: 6 DATE: -	BY:	-
DESCRIPTION: -		

ORA ONATHAN D. SPENCE LA-111 APE ARCY LIC DATE: 01.01.08 DATE: 09.14.17 STERLING DESIGN ASSOCIATES, LLC ISSUES & REVISIONS

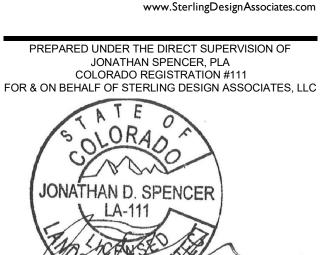

TEN CALENDAR DAYS FROM DATE ISSUED. SUBSEQUENT REVIEW AND APPROVAL B. MAINTENANCE: ALL LANDSCAPING SHALL BE MAINTAINED FROM INSTALLATION TO

FINAL ACCEPTANCE. MAINTENANCE SHALL INCLUDE WATERING, FERTILIZING, WEEDING, MOWING, TRIMMING, ROLLING, REGRADING, REPLANTING, DISEASE AND

LANDSCAPE CONTRACTOR SHALL EXAMINE THE SITE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED AND NOTIFY THE GENERAL CONTRACTOR IN WRITING OF UNSATISFACTORY CONDITIONS. DO NOT PROCEED UNTIL CONDITIONS ARE CORRECTED. LANDSCAPE CONTRACTOR SHALL BE RESPONSIBLE FOR FINISHED

A. CONTRACTOR SHALL REPAIR OR REPLACE ALL ITEMS DAMAGED DUE TO THIS WORK B. CONTRACTOR SHALL CLEAN ALL AREAS DUE TO THIS WORK AND PROPERLY

OWNER/LANDSCAPE ARCHITECT RESERVES THE RIGHT TO REJECT ANY MATERIALS AT ANY TIME. ALL PLANT MATERIALS SHALL MEET THE MINIMUM CURRENT "AMERICAN STANDARDS FOR NURSERY STOCK" BY THE AMERICAN ASSOCIATION OF NURSERYMEN CONTRACTOR SHALL PROVIDE SAMPLES, SPECS., AND OR TAGS FOR ALL MATERIALS.

SOD AND SHRUB BED AREAS SHALL RECEIVE SIX INCHES OF APPROVED TOPSOIL. AMEND SOIL WITH FOUR CUBIC YARDS PER THOUSAND SQUARE FEET OF ORGANIC COMPOST. COMPOST TO HAVE A C:N RATIO BETWEEN 15:1 AND 30:1, LESS THAN 6

mmhos/cm SALT CONTENT, A pH BETWEEN 6.5 AND 8.5, AND OVER 30% ORGANIC MATTER. APPLY 5 LBS. OF 20-10-5 GRANULAR FERTILIZER PER THOUSAND SQ. FEET. ROTOTILL AMENDMENTS AND TOPSOIL TO A DEPTH OF SIX INCHES. VERIFY SOIL PREP SPECIFICATIONS WITH WATER PROVIDER STANDARDS. PROVIDE EVIDENCE OF APPLICATION AS REQUIRED. TEST SOIL IN EXISTING ASPHALT AREAS FOR STERILANT USE. IF STERILANTS ARE FOUND PRESENT, REMOVE ALL CONTAMINATED SOIL AND

TREES AND SHRUBS SHALL BE PLANTED PER DETAILS. STAKE AND GUY TREES PER DETAILS. TREE AND SHRUB BED LOCATIONS SHALL BE APPROVED PRIOR TO PLANTING. BACKFILL WITH 1/3 SOIL AMENDMENT AND 2/3 SITE SOIL, THOROUGHLY MIXED.

SOD SHALL BE "RTF" FESCUE BY GREEN VALLEY TURF (GVT) (303-798-6764) OR APPROVED EQUAL. SOIL PREP, INSTALL AND WATER ACCORDING TO GVT GUIDELINES.

INSTALL 4" ROLL-TOP RYERSON STEEL EDGING (14 GAUGE WITH GREEN FINISH) OR

EQUAL. INSTALL WITH STAKES AND SPLICERS PER MANUFACTURER'S RECOMMENDATIONS. INSTALL BETWEEN ALL SOD OR SEEDED AREAS AND MULCHED

MULCH SHALL BE A CRUSHED/ANGULAR MNT. OVER DEWITT PROS FILTER FABRIC, 3" DEEP IN ALL PLANTING AREAS. WOOD MULCH SHALL BE PROVIDED IN ANY PERENNIAL OR ANNUAL AREAS, AROUND SHRUBS AND TREES WITHIN ROCK MULCH AREAS. WOOD MULCH SHALL BE SHREDDED WESTERN RED CEDAR (NOT COLORED) AND SHALL BE PLACED AS FOLLOWS; 3' RINGS AROUND TREES AND  $1\frac{1}{2}$  THE WIDTH OF THE ROOT BALL AROUND SHRUBS, PER THE ACADEMY GATEWAY DESIGN GUIDELINES. AN 18" WIDE PERIMETER OF ROCK MULCH SHALL BE PLACED AROUND THE FOUNDATION OF THE

THE PROPERTY OWNER OF RECORD, THE OWNER'S AGENT OR TENANT SHALL KEEP ALL LANDSCAPING IN A WELL MAINTAINED AND HEALTHY GROWING CONDITION, AND IN ACCORDANCE WITH ACADEMY GATEWAY DESIGN GUIDELINES.

ALL LANDSCAPE AREAS SHALL BE WATERED BY AN AUTOMATIC IRRIGATION SYSTEM TO INCLUDE IRRIGATION TO ALL PROPOSED PLANT MATERIAL. ALL SHRUB BEDS SHALL BE

4"-6" ROUNDED GRANITE COBBLES OVER WEED BARRIER FABRIC.

Sterling Design Associates, Ilc

2009 W. Littleton Blvd. #300

Littleton, CO 80120

BY: JDS

BY: JDS

303.794.4727 ph

**CIVIL ENGINEERS - LANDSCAPE ARCHITECTS** 

NO.: 1 DATE: 5/16/201


NO.: 2 DATE: 8/24/2017

DESCRIPTION: 1ST MAJOR SDP SUBMITTAL

A. FINAL ACCEPTANCE: WITHIN TEN DAYS OF CONTRACTOR'S NOTICE THAT THE ENTIRE PROJECT IS COMPLETE, THE L.A. SHALL REVIEW INSTALLATION. IF FINAL ACCEPTANCE IS NOT GIVEN, THE L.A. SHALL PREPARE A PUNCH LIST OF PENDING ITEMS. THE PUNCH LIST ITEMS SHALL BE COMPLETED BY THE CONTRACTOR WITHIN

CONSTRUCTION SHALL CONFORM TO ALL APPLICABLE STATE AND LOCAL CODES.


ALL MATERIALS AND WORKMANSHIP SHALL BE GUARANTEED FOR ONE YEAR. FROM

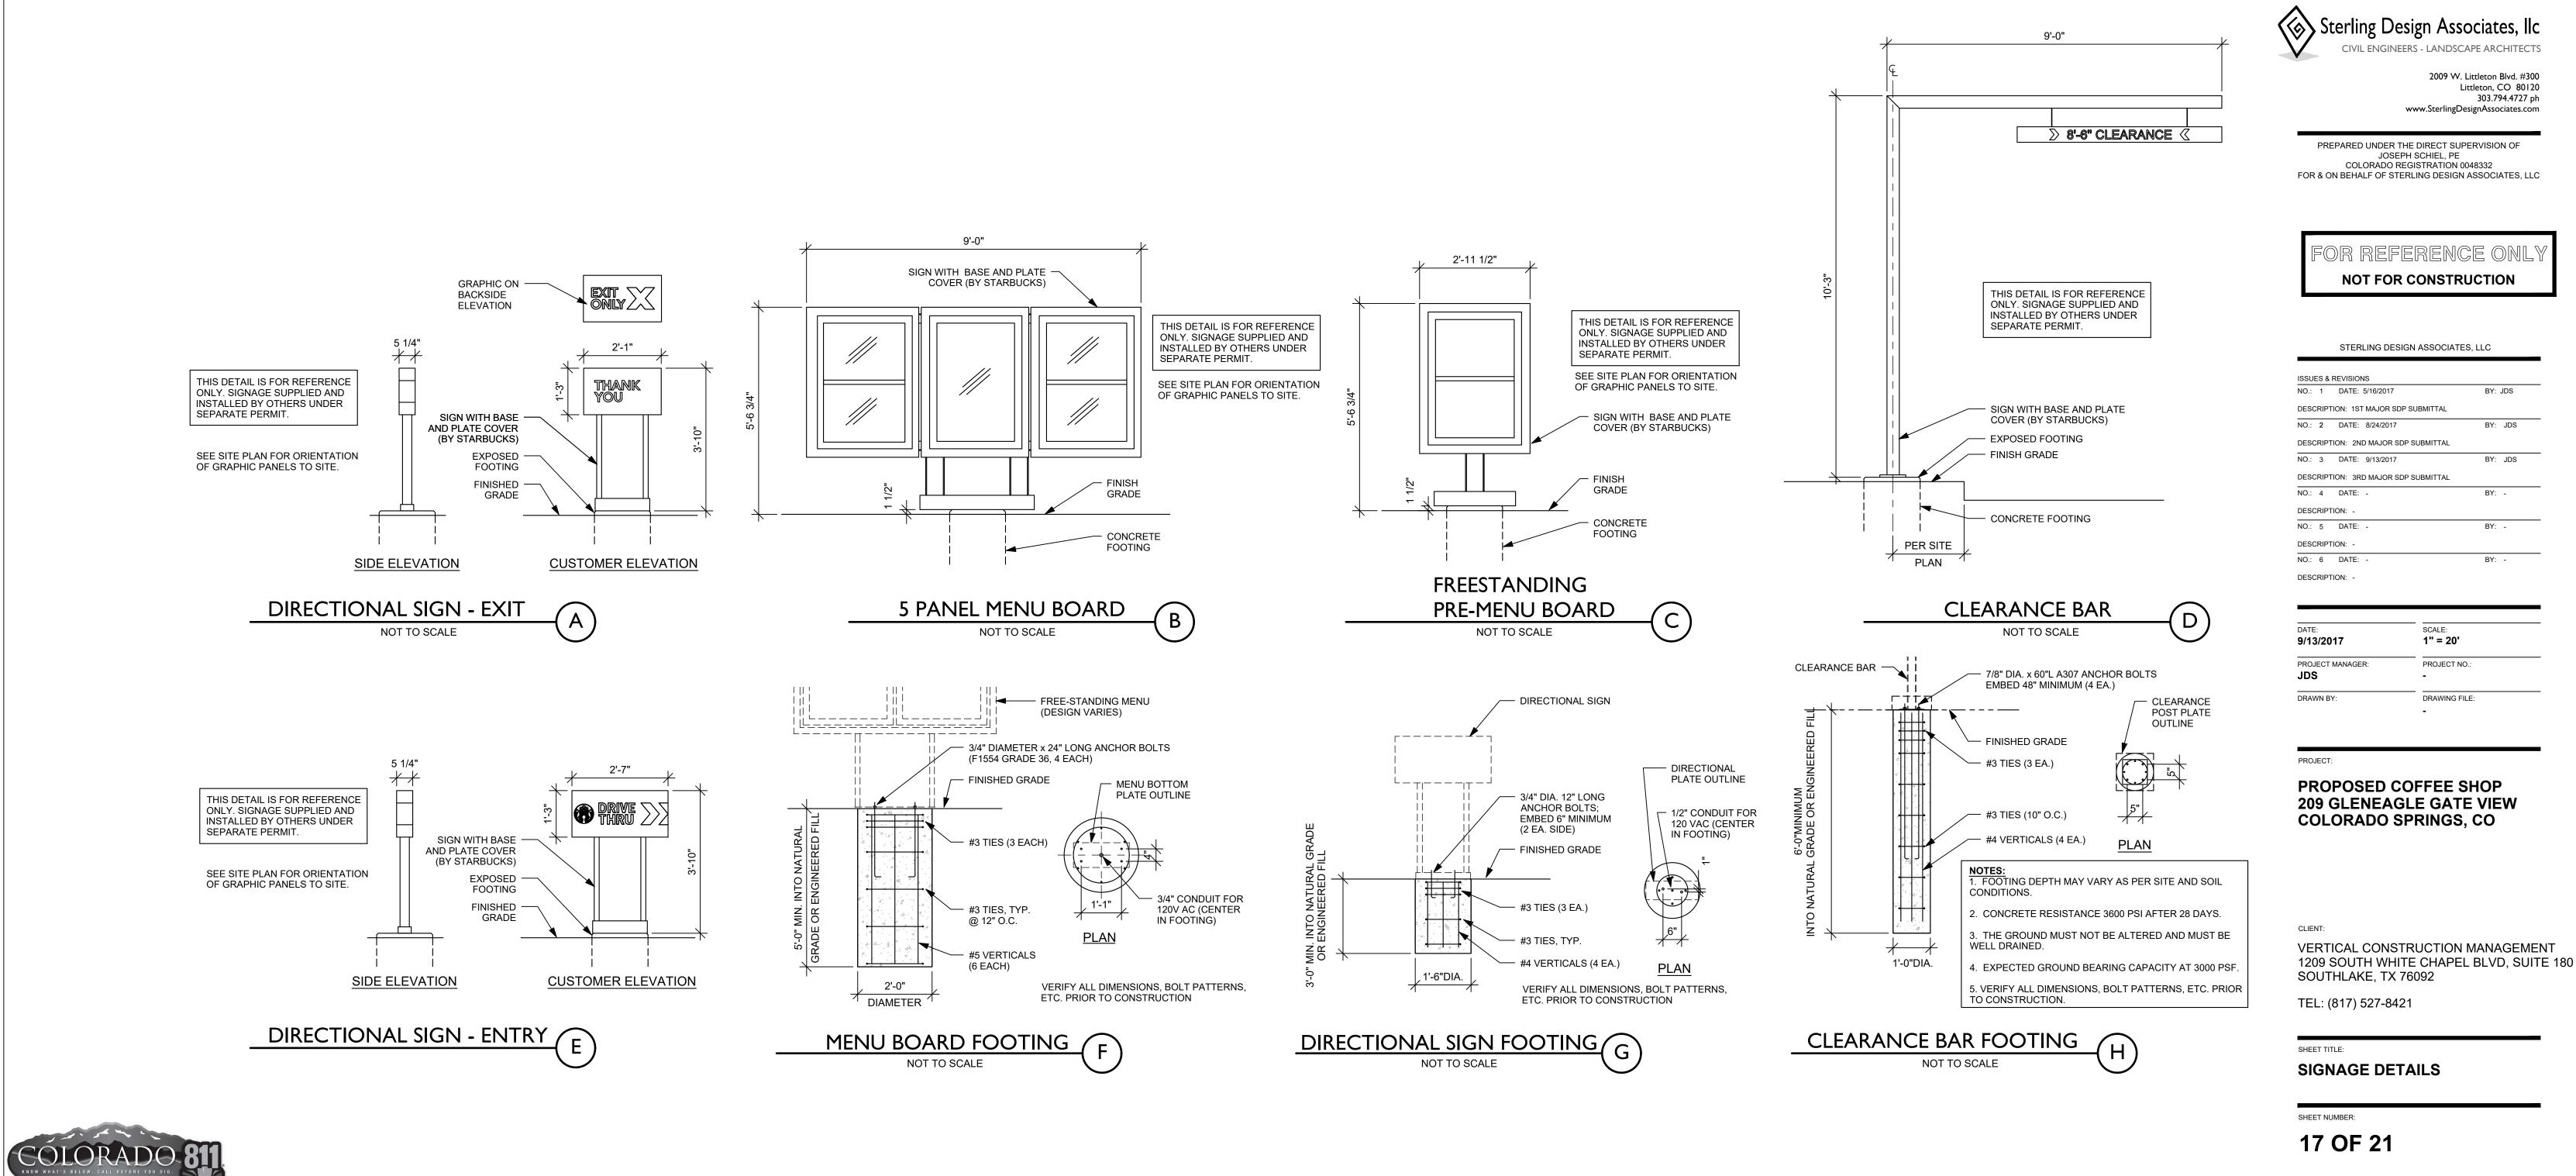

# ACADEMY GATEWAY SUBDIVISION FILING NO. I LOT 2


A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL MERIDIAN, EL PASO COUNTY, COLORADO

MAJOR SITE DEVELOPMENT PLAN

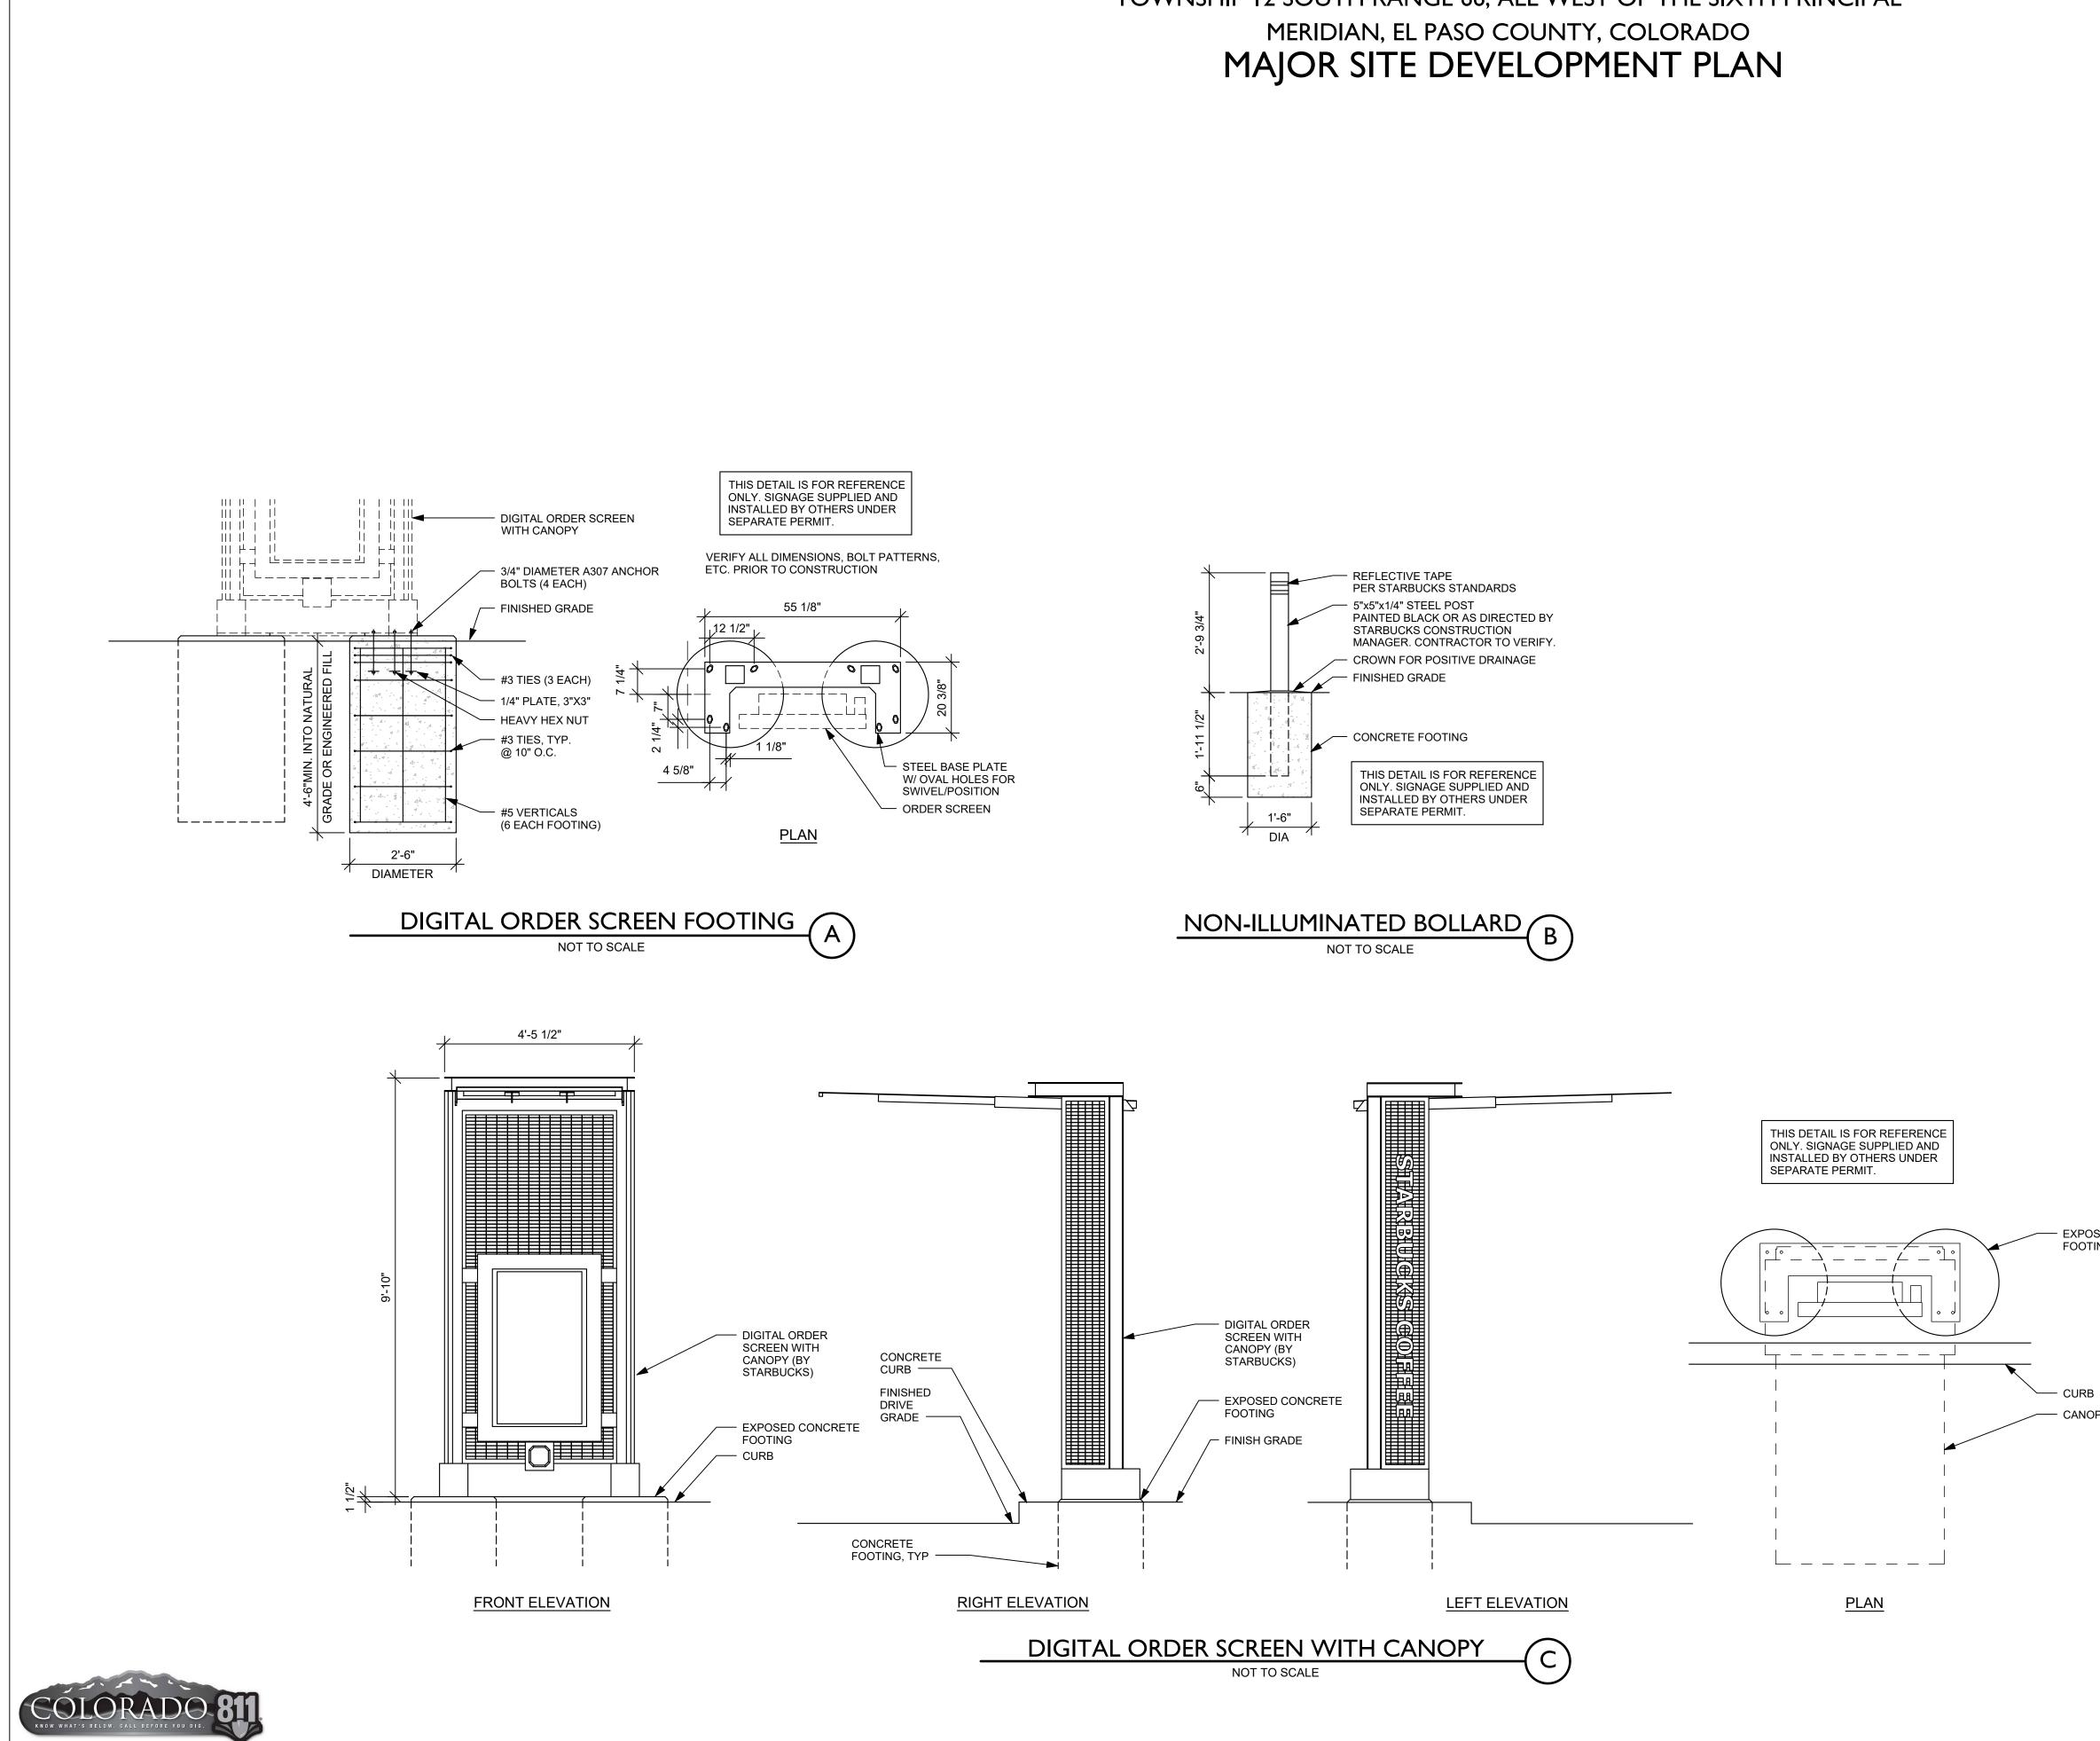

# ACADEMY GATEWAY SUBDIVISION FILING NO. 1 LOT 2

A SUBDIVISION OF A PORTION OF THE SOUTHEAST QUARTER OF SECTION I, TOWNSHIP 12 SOUTH, RANGE 67 AND THE SOUTHWEST QUARTER OF SECTION 6 TOWNSHIP 12 SOUTH RANGE 66, ALL WEST OF THE SIXTH PRINCIPAL

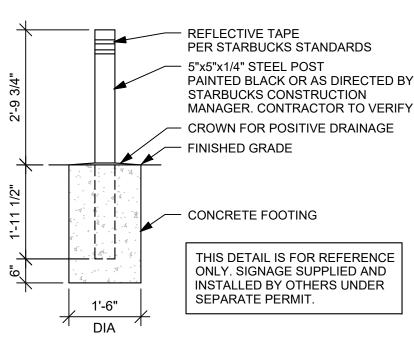





2009 W. Littleton Blvd. #300 Littleton, CO 80120 303.794.4727 ph www.SterlingDesignAssociates.com

PREPARED UNDER THE DIRECT SUPERVISION OF JOSEPH SCHIEL, PE COLORADO REGISTRATION 0048332 FOR & ON BEHALF OF STERLING DESIGN ASSOCIATES, LLC

> FOR REFERENCE ONL NOT FOR CONSTRUCTION

#### STERLING DESIGN ASSOCIATES, LLC

ISSUES & REVISIONS			
NO.: 1 DATE: 5/16/2017	BY: JDS		
DESCRIPTION: 1ST MAJOR SDP SU	BMITTAL		
NO.: 2 DATE: 8/24/2017	BY: JDS		
DESCRIPTION: 2ND MAJOR SDP SU	JBMITTAL		
NO.: 3 DATE: 9/13/2017	BY: JDS		
DESCRIPTION: 3RD MAJOR SDP SUBMITTAL			
NO.: 4 DATE: -	BY: -		
DESCRIPTION: -			
NO.: 5 DATE: -	BY: -		
DESCRIPTION: -			
NO.: 6 DATE: -	BY: -		
DESCRIPTION: -			
DATE:	SCALE:		
9/13/2017	1'' = 20'		
PROJECT MANAGER: JDS	PROJECT NO.:		

PROJECT:

DRAWN BY:

### PROPOSED COFFEE SHOP 209 GLENEAGLE GATE VIEW COLORADO SPRINGS, CO

DRAWING FILE:

CLIENT:

VERTICAL CONSTRUCTION MANAGEMENT 1209 SOUTH WHITE CHAPEL BLVD, SUITE 180 SOUTHLAKE, TX 76092

TEL: (817) 527-8421

SHEET TITLE:

SIGNAGE DETAILS

SHEET NUMBER:

18 OF 21


**COUNTY PROJECT NUMBER PPR-17-030** 

EXPOSED CONCRETE FOOTING


- CANOPY ABOVE









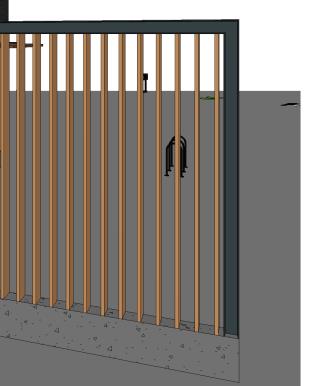




513 MAIN STREET, SUITE 300 FORT WORTH, TEXAS 76102 (817) 820-0433


THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF REVIEW UNDER THE AUTHORITY OF ROGUE ARCHITECTS. IT IS NOT TO BE USED FOR CONSTRUCTION, BIDDING OR PERMIT PURPOSES.

PERMIT SET 09-14-2017

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS, OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

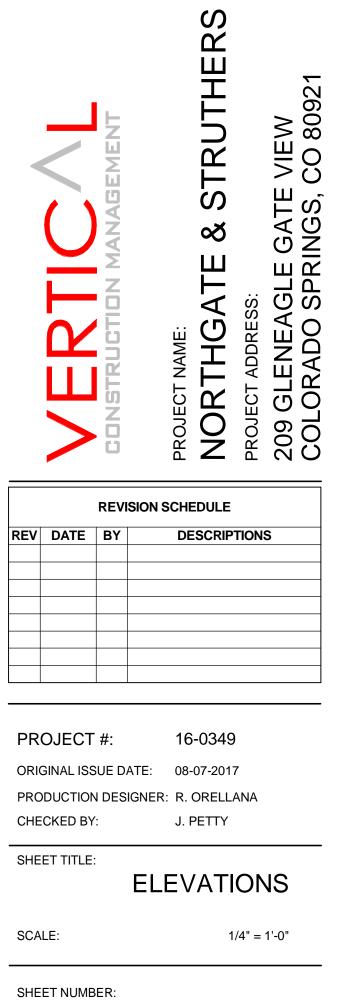

20

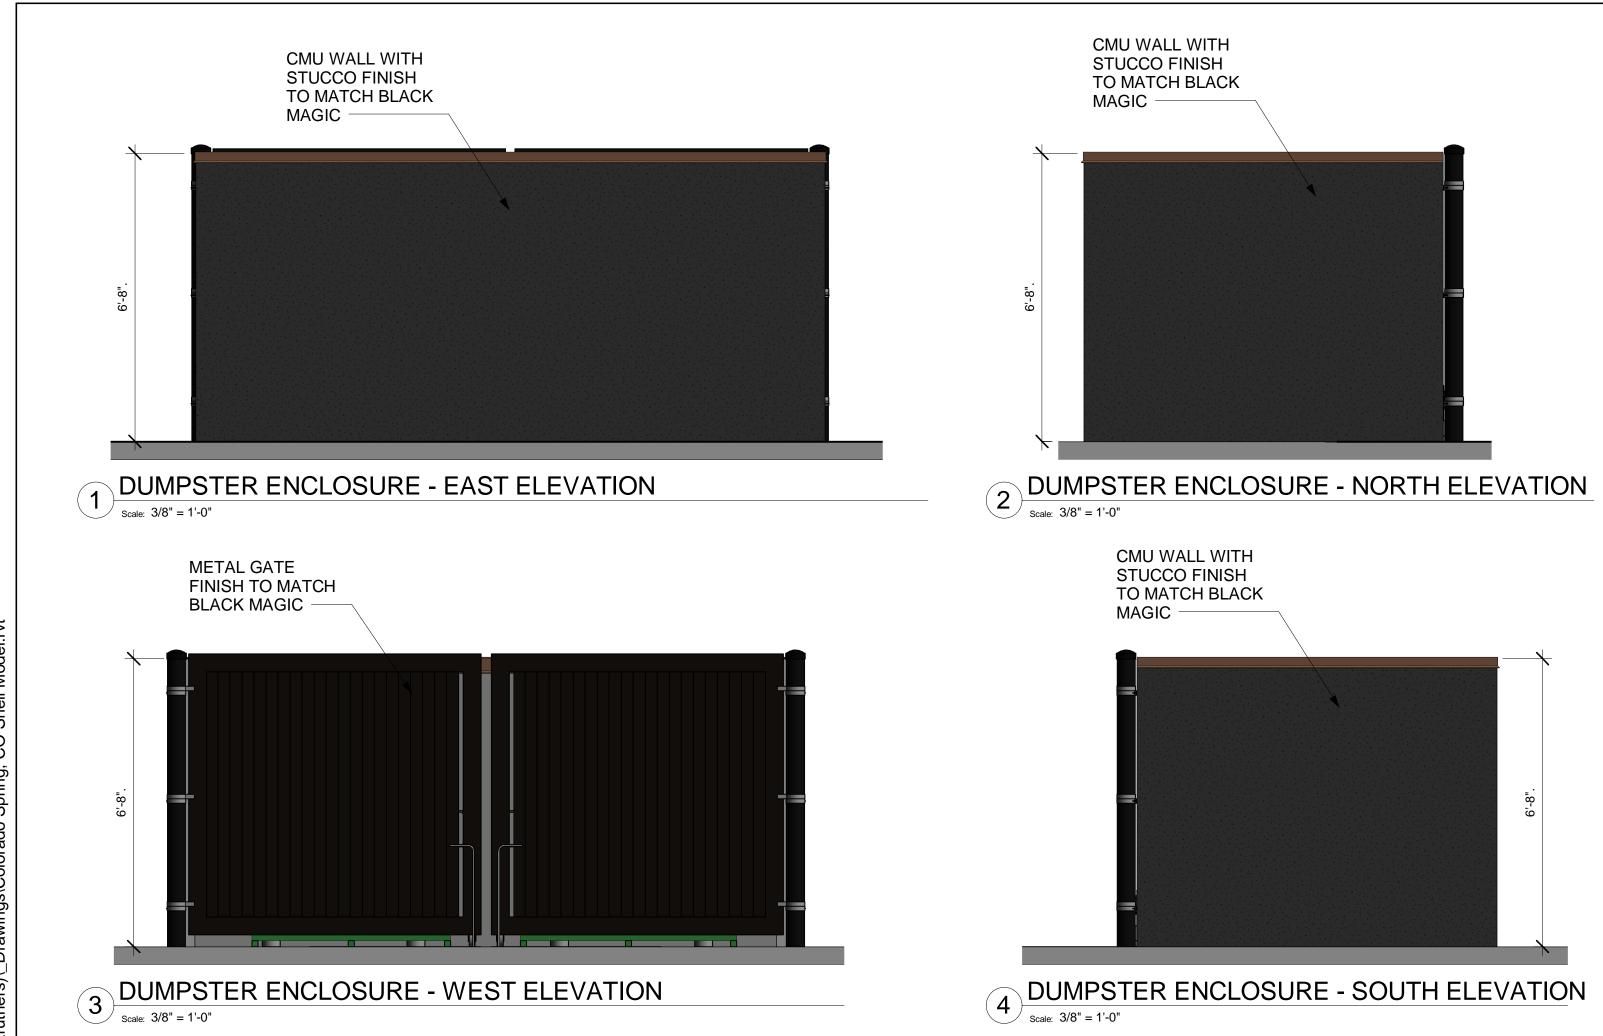

© 2011 STARBUCKS COFFEE COMPANY
STARBUCKS COFFEE COMPANY 2401 UTAH AVENUE SOUTH SEATTLE, WASHINGTON 98134 (206) 318-1575
THESE DRAWINGS AND SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF STARBUCKS CORPORATION, WHICH IS THE OWNER OF THE COPYRIGHT IN THIS WORK. THEY SHALL NOT BE REPRODUCED (IN WHOLE OR IN PART), SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF STARBUCKS CORPORATION. THESE DRAWINGS AND SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL STARBUCKS STORE (WHICH IS SUBJECT TO CHANGE AT ANYTIME) AND DO NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLICATION NOR LIABILITY TO THE OTHER (EXCEPT STATED ABOVE) LINTIL A WRITTEN AGREEMENT IS FULLY FXECUTED BY ROTH
ARCHITECTROF RECORD
THIS DOCUMENT IS RELEASED FOR THE PURPOSE OF REVIEW UNDER THE AUTHORITY OF ROGUE ARCHITECTS. IT IS NOT TO BE USED FOR CONSTRUCTION, BIDDING OR PERMIT PURPOSES. PERMIT SET 09-13-2017
PERMIT SET 09-13-2017
PROJECT NAME: <b>NORTHGATE &amp; STRUTHERS</b> PROJECT ADDRESS: 209 GLENEAGLE GATE VIEW COLORADO SPRINGS, CO 80921
STORE #: 51410 PROJECT #: 16-0349
CONCEPT: PALETTE: ORIGINAL ISSUE 08-07-2017 DESIGN MANAGER: S. ZOHOORI LEED <sup>①</sup> AP: PRODUCTION R. ORELLANA DESIGNER: CHECKED BY: J. PETTY
REVISION SCHEDULE       REV     DATE     BY     DESCRIPTIONS
SHEET TITLE:
DUMPSTER ENCLOSURE SCALE: 3/8" = 1'-0"
SHEET NUMBER: 21

