


Please clearly depict the property boundaries.

Please indicate a north arrow


Per Section 6.2.3.B.1.e. in the Land Development Code, light levels measured at the property line of the development site adjacent to public right of way shall not exceed 0.1 foot candles as a direct result of the on-site lighting.

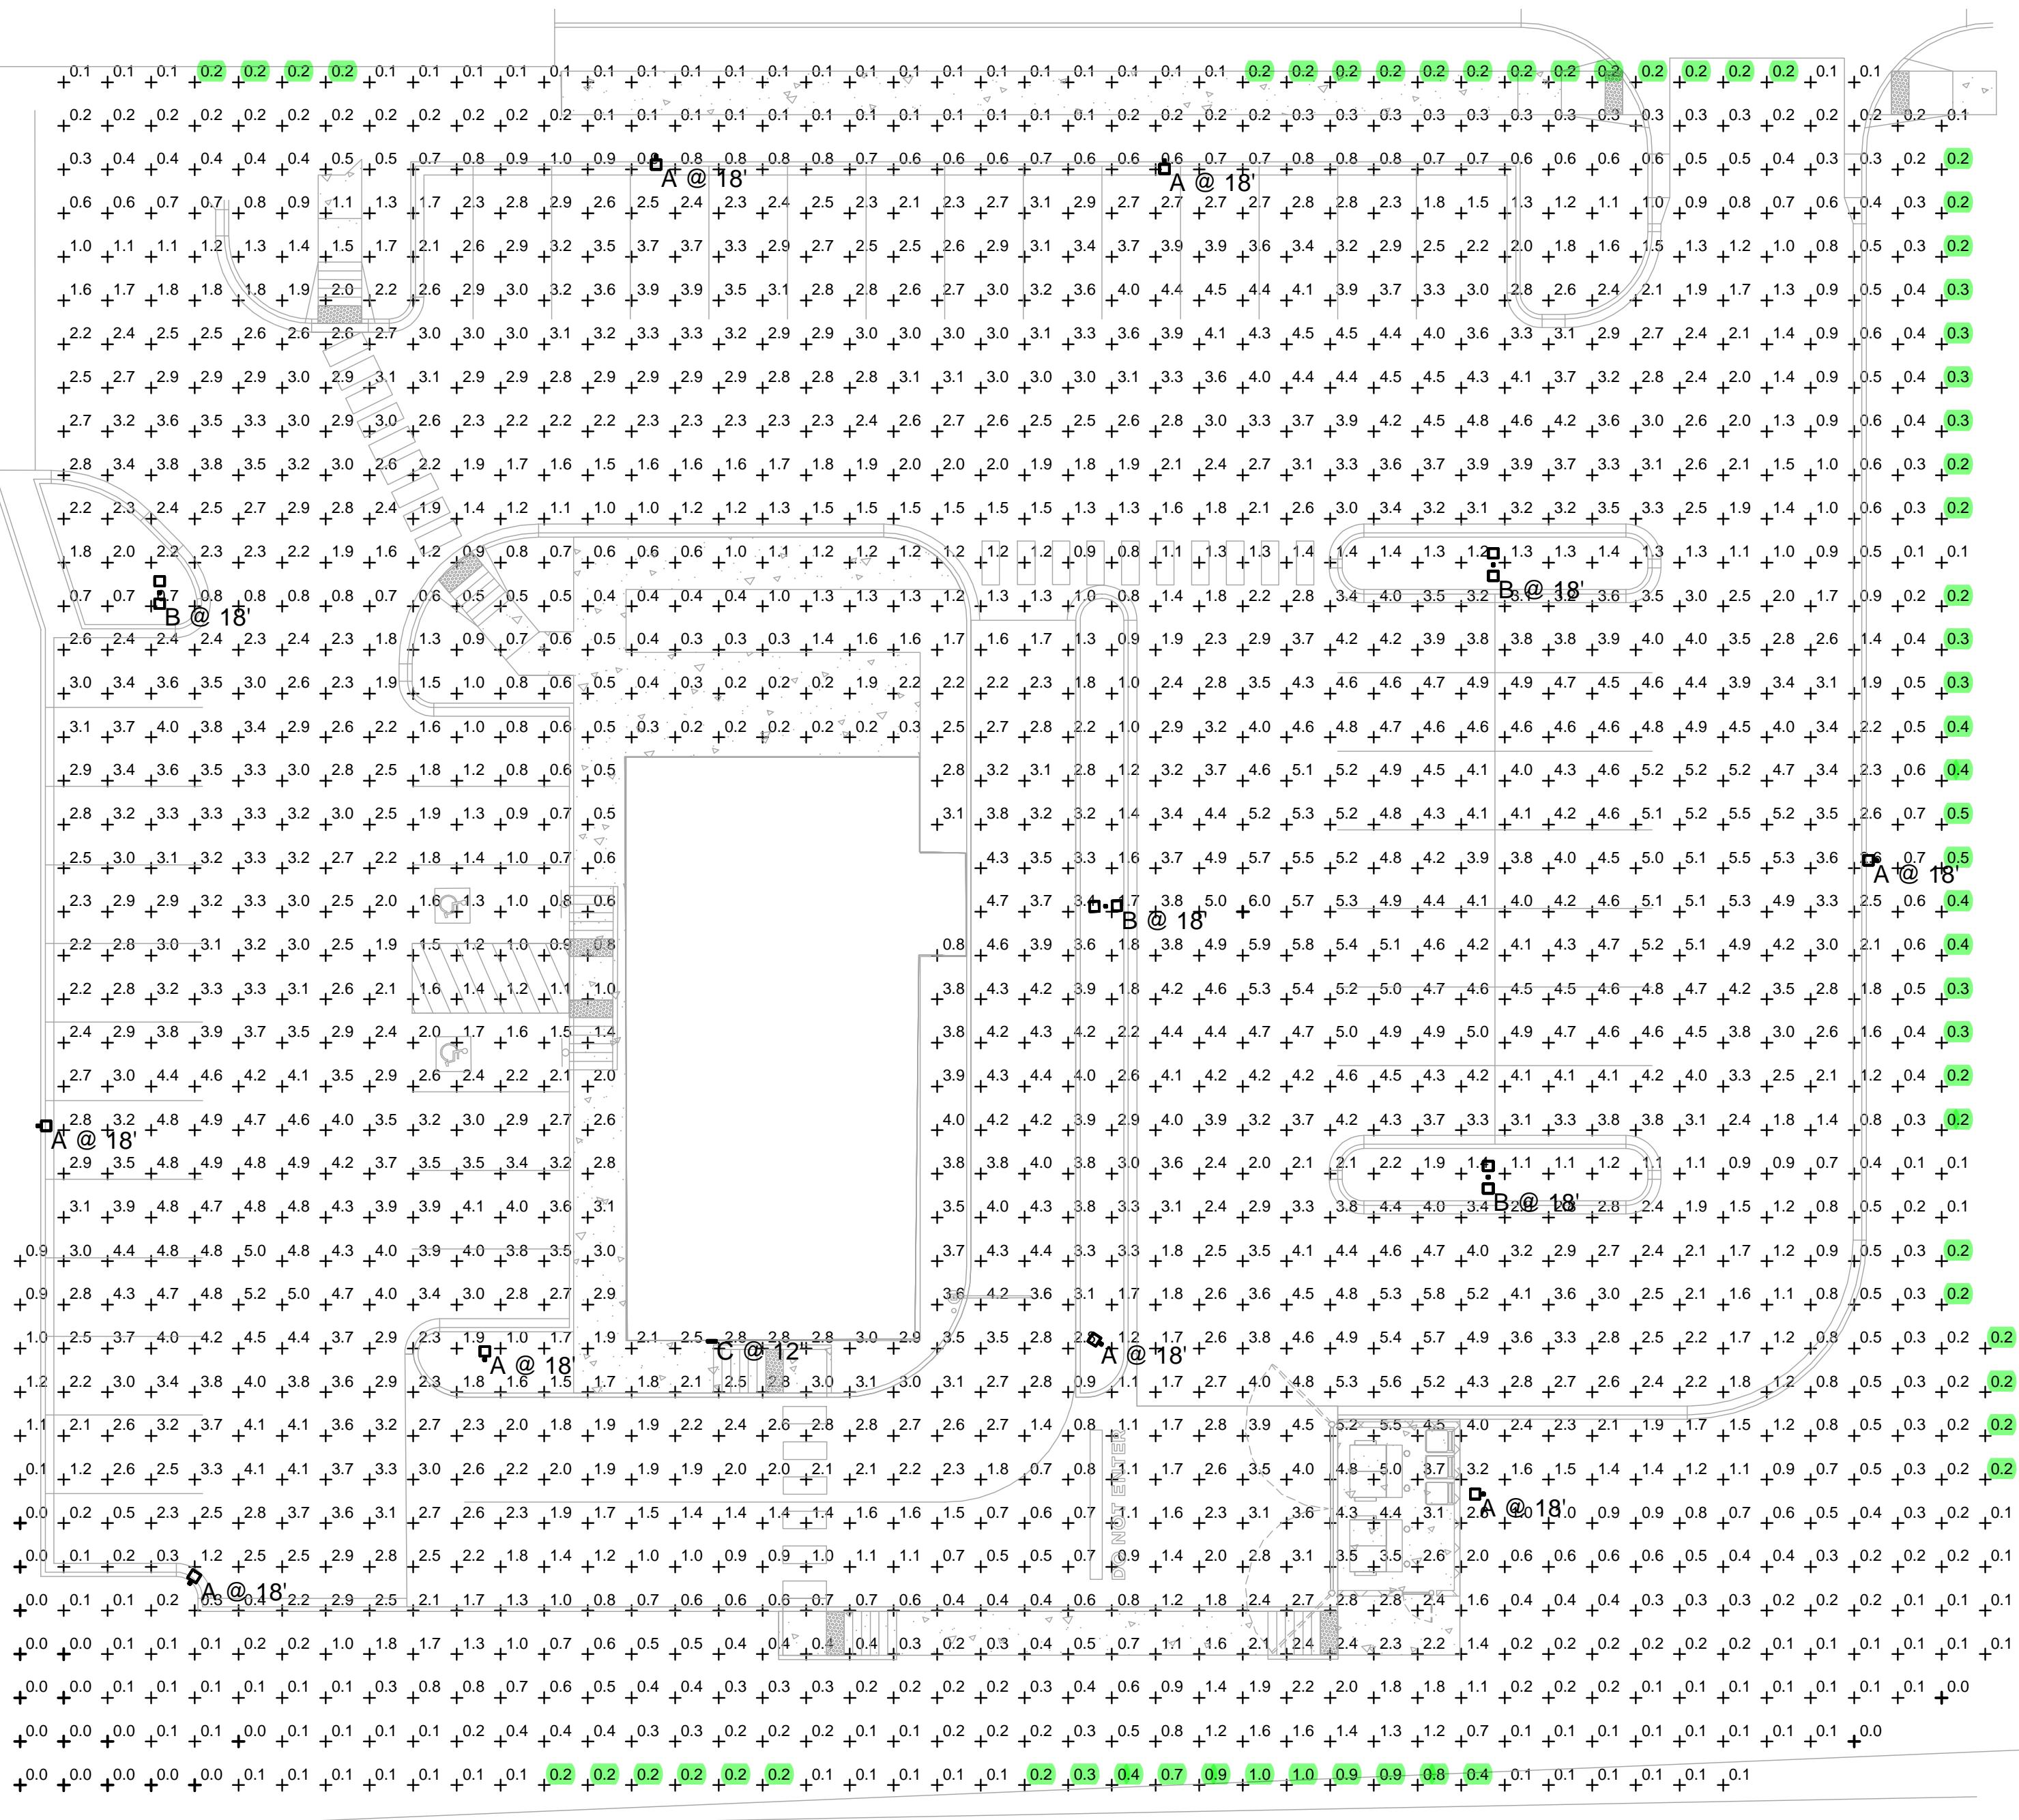

SITE PHOTOMETRIC PLAN

1" = 15'-0"

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Site	+	2.1 fc	6.0 fc	0.0 fc	N/A	N/A

Schedule											
Symbol	Label	Image	Quantity	Manufacturer	Catalog Number	Description	Number Lamps	Lumens Per Lamp	Light Loss Factor	Wattage	Plot
	A		8	Lithonia Lighting	DSX1 LED P2 30K 70CRI BLC3 EGS	D-Series Size 1 Area Luminaire P2 Performance Package 3000K CCT 70 CRI Type 3 Extreme Backlight Control External Glare Shield	1	6314	1	67.79	 Max: 6776cd
	B		4	Lithonia Lighting	DSX1 LED P2 30K 70CRI BLC3 EGS	D-Series Size 1 Area Luminaire P2 Performance Package 3000K CCT 70 CRI Type 3 Extreme Backlight Control External Glare Shield	1	6314	1	135.58	 Max: 6776cd
	C		1	Lithonia Lighting	DSXW1 LED 10C 350 40K T3S MVOLT HS	DSXW1 LED WITH (1) 10 LED LIGHT ENGINES, TYPE T3S OPTIC, 4000K, @ 350mA WITH HOUSE-SIDE SHIELDS.	1	1278	1	13.3	 Max: 956cd

CHIPOTLE
COLORADO SPRINGS, CO

REVISIONS

SITE PHOTOMETRIC PLAN

Project #
Issue Date
Drawn by
Checked by

E-102

Scale

