

Please update report title to Preliminary/Final Drainage Report. A Final drainage report cannot be approved with the PRELIM Plan

**FINAL DRAINAGE REPORT
FOR
ESTATES AT CATHEDRAL PINES,
EL PASO COUNTY, COLORADO**

PCD File No. SF2234

March 2024

Prepared For:

**Gregg & Elaine Cawfield
Villagree Development, LLC**
5710 Vessey Road
Colorado Springs, CO 80908
(719) 413-6900


Prepared By:

JR ENGINEERING
5475 Tech Center Drive
Colorado Springs, CO 80919
(719) 593-2593

Job No. 25260.00

ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by El Paso County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors, or omissions on my part in preparing this report.



3/29/2024

Bryan T. Law, Colorado P.E. #25043
For and On Behalf of JR Engineering, LLC

Date

DEVELOPER'S STATEMENT:

I, the developer, have read and will comply with all of the requirements specified in this drainage report and plan.

Business Name: Villagree Development, LLC

By: *Elaine Cawlfild*

Title: Gregg & Elaine Cawlfild
Owner

Address: 5710 Vessey Road
Colorado Springs CO 80908

El Paso County:

Filed in accordance with the requirements of the El Paso County Land Development Code, Drainage Criteria Manual, Volumes 1 and 2 and Engineering Criteria Manual, as amended.

Joshua Palmer, P.E.
County Engineer/ ECM Administrator

Date

Conditions:



CONTENTS

PURPOSE.....	1
GENERAL LOCATION AND DESCRIPTION.....	1
GENERAL LOCATION	1
DESCRIPTION OF PROPERTY	1
FLOODPLAIN STATEMENT.....	1
EXISTING DRAINAGE CONDITIONS	2
MAJOR BASIN DESCRIPTIONS	2
PROPOSED CONVEYANCE	3
PROPOSED SUB-BASIN DRAINAGE.....	4
COMPARISON OF FLOWS	8
DRAINAGE DESIGN CRITERIA.....	9
DEVELOPMENT CRITERIA REFERENCE	9
HYDROLOGIC CRITERIA.....	9
HYDRAULIC CRITERIA.....	10
DRAINAGE FACILITY DESIGN	10
GENERAL CONCEPT.....	10
SPECIFIC DETAILS	10
<i>Four Step Process to Minimize Adverse Impacts of Urbanization</i>	11
<i>Water Quality</i>	12
<i>Erosion Control Plan</i>	13
<i>Operation & Maintenance</i>	13
<i>Drainage and Bridge Fees</i>	13
<i>Construction Cost Opinion</i>	14
SUMMARY	15
REFERENCES:	16

APPENDICES

- A. Figures and Exhibits
- B. Hydrologic Calculations
- C. Hydraulic Calculations
- D. Reference Materials
- E. Drainage Maps



PURPOSE

This document is the Final Drainage Report for Estates at Cathedral Pines. The purpose of this report is to identify on-site and off-site drainage patterns, culverts, areas tributary to the site, and to safely route developed storm water to adequate outfall facilities.

GENERAL LOCATION AND DESCRIPTION

General Location

The proposed Estates at Cathedral Pines development, hereby known as “the site”, is located within the southeast quarter of Section 2, Township 12 South, Range 66 West of the 6th Prime Meridian, El Paso County, Colorado. The proposed development is 35.09 acres containing approximately 8 – 2.7 to 4.1 acre single-family lots, 2.5 acres of open space, and associated infrastructure. The site is bounded on the east by Winslow Drive, by Cathedral Pines Subdivision Filing No. 1 to the east and north, properties at 13855 Highway 83 and 13580 Bridle Bit Road to the west, and by Falcon Forest Subdivision Filing No. 2 to the south. A vicinity map of the area is presented in Appendix A.

Description of Property

The site is currently covered by an existing forested area with a large portion that has suffered damage from a fire. There is an existing grove of trees in the middle of the property that are healthy with little to no fire damage. The proposed development will save as many healthy trees as possible. Multiple natural drainage paths run through the site and range from poorly-defined to well-defined. The existing ground cover is sparse vegetation and open space with slopes that range from 3% to 30% generally draining from east to west.

Soils located within the site as shown on the USDA Natural Resources Conservation Service Soil Survey Map are kettle gravelly loamy sand. These soils are characterized as Hydrologic Soil Group B, which have a moderate infiltration rate when thoroughly wet and have a moderate rate of water transmission. A soils map is included in Appendix A of this report.

There are no major drainageways or known irrigation facilities located on the project site. There are no known utilities located within the project boundary. There is an existing trail that borders the property to the east.

Floodplain Statement

The FEMA Flood Insurance Rate Map (FIRM) Panel No. 08041C0315G, dated December 7, 2018 is the best representation of the project site. The site is located within Zone X which is defined as areas determined to be outside the 0.2% annual chance floodplain, and therefore there is little threat of a flood. See the FIRM map in Appendix A.

EXISTING DRAINAGE CONDITIONS

Major Basin Descriptions

The site lies within the Black Squirrel Creek Drainage Basin. The DPBS for this basin was prepared by URS Corporation and dated January 1989. See excerpts in Appendix D for more information. The Black Squirrel Creek DBPS modeled the site assuming residential development of 5-acre single-family lots. The proposed development is composed of 2.7 to 4.1 acre single-family lots, which is denser than was originally assumed. This site will detain major runoff to historic rates to prevent any negative impacts to the existing downstream drainage. The DBPS identified major channel system improvements with grade control structures within the reaches adjacent to the site. There are no proposed major DBPS improvements proposed within the project site.

Existing Sub-basin Drainage

Existing basin drainage patterns are generally from east to west by way of sheet flow overland and then concentrated flow within natural channels. There are two locations where off-site flows enters onto the site. First, off-site flows enter the property at design point (DP) P1 via an 18" RCP pipe from an existing pond part of the Cathedral Pines Subdivision Filing No.1 development, and flows east to west through an existing natural channel. A 24" RCP pipe adjacent to the existing Cathedral Pines Subdivision Filing No. 1 pond crosses onto the site, which conveys the pond emergency flows from the spillway onto the site. See excerpts of the Cathedral Pines Subdivision Filing No. 1 FDR and as-built construction drawings in Appendix D. From a visual inspection during a site visit, the existing pond and outfall onto the site appears to be functioning as intended. Second, off-site flows enter the site along the southern property line and are routed through the site via an existing natural channel. The off-site basin is a large lot residential single-family home and is predominantly composed of undeveloped land. Large portions of these basins are heavily wooded.

Unresolved from Submittal 1,2 - engineer must confirm in the DR that the existing natural channels are functioning properly and do not require stabilization.

The existing basin delineation as shown in the existing drainage map in Appendix E is as follows:

Basin EX-1 is approximately 0.84 acres and in its existing condition is undeveloped land. Runoff ($Q_5=0.3$ cfs, $Q_{100}=1.8$ cfs) flows overland towards DP1 and off-site onto the adjacent Cathedral Pines Subdivision Filing No. 1 property to the north. For applicable excerpts from the Drainage Report and Plan for Cathedral Pines Subdivision Filing No. 1, refer to Appendix D.

Basin EX-2 is approximately 3.16 acres and in its existing condition is undeveloped land. Runoff ($Q_5=0.8$ cfs, $Q_{100}=5.6$ cfs) flows overland towards DP2 and off-site onto the adjacent Cathedral Pines Subdivision Filing No. 1 property to the north. For applicable excerpts from the Drainage Report and Plan for Cathedral Pines Subdivision Filing No. 1, refer to Appendix D.

Basin EX-3 is approximately 3.29 acres and in its existing condition is undeveloped land, and existing drainageways (both poorly and well-defined). Runoff flows will follow the historic path east

Final Drainage Report for Estates at Cathedral Pines

to west overland and in swales towards DP3 ($Q_5=0.8$ cfs, $Q_{100}=5.0$ cfs). Flows continue off-site onto the property at 13855 Highway 83 to the west.

Basin EX-4 is approximately 12.6 acres and in its existing condition is undeveloped land, and existing drainageways (both poorly and well-defined), and a portion of Winslow Drive. Runoff flows will follow the historic path east to west overland towards DP4 ($Q_5=4.0$ cfs, $Q_{100}=25.2$ cfs). Flows continue off-site onto the property at 13580 Bridle Bit Road to the west.

Basin EX-6 is approximately 4.74 acres and in its existing condition is undeveloped land, existing drainageways (both poorly and well-defined), and a portion of Winslow Drive. Runoff flows will follow the historic path east to west overland towards DP6 ($Q_5=1.5$ cfs, $Q_{100}=9.5$ cfs). Flows continue off-site onto the property at 13580 Bridle Bit Road to the west.

Basin EX-7 is approximately 8.06 acres and in its existing condition is undeveloped land, existing drainageways (both poorly and well-defined), and a portion of Winslow Drive. Runoff flows will follow the historic path east to west overland towards DP7 ($Q_5=2.3$ cfs, $Q_{100}=14.0$ cfs). The existing Cathedral Pines Subdivision Filing No. 1 pond located to the east of Winslow Drive releases flows within the existing 18" RCP at DPP1 ($Q_5=3.7$ cfs, $Q_{100}=10.9$ cfs). Flows from DPP1 enters the existing swale and combines with DP7 at DP7.1 ($Q_5=6.0$ cfs, $Q_{100}=24.9$ cfs). DP7.1 flows continue off-site onto the property at 13580 Bridle Bit Road to the west and combine at DP8.2. As mentioned above, the 24" RCP emergency spillway overflow culvert from Cathedral Pines Subdivision Filing No. 1 also enters the existing swale through the site should the exiting pond overflow.

Basin OS-1 is approximately 2.44 acres and in its existing condition is comprised of part of a single-family lot with a house, asphalt drive, and a portion of Winslow Drive. This is an off-site basin to the south, a part of the Falcon Forest Subdivision Filing No. 2 development. Due to the basin location off-site, no work is proposed within this basin. Runoff flows will follow the historic path east to west overland to the existing natural channel at DPO1 ($Q_5=1.7$ cfs, $Q_{100}=6.7$ cfs) where it will enter Basin EX-8 and follow the drainage patterns of the basin as described below. Flows will combine with DP8 at DP8.1.

Basin EX-8 is approximately 3.64 acres and in its existing condition is undeveloped land, existing drainageways (both poorly and well-defined), and a portion of Winslow Drive. Runoff flows will follow the historic path east to west overland towards DP8 ($Q_5=1.1$ cfs, $Q_{100}=6.5$ cfs). DP8 flows will combine with DPO1 at DP8.1 ($Q_5=2.3$ cfs, $Q_{100}=11.5$ cfs) and continue off-site onto the property at 13580 Bridle Bit Road to the west and combines at DP8.2 ($Q_5=8.2$ cfs, $Q_{100}=36.1$ cfs). Flows continue within the existing swale flowing west.

Proposed Conveyance

Developed flows are collected in existing natural swales, proposed roadside ditches, and proposed culverts which convey water to the proposed detention areas on the north and south ends of the site. As previously noted, there are large portions of the site that have experienced fire damage. A grove

of trees located centrally on the site are considered healthy due to them having little to no fire damage. Therefore, a design goal of the proposed drainage conveyance was to limit the disturbance to the healthy trees and natural aesthetics of the site.

Roadside swales will be designed per the typical county rural roadside ditch section. Proposed swale sections will be designed to ensure they are stable and have required capacity to satisfy criteria. A swale is considered stable with a velocity of 5 ft/s or less. Where velocities exceed 5 ft/s, swales will be reinforced with the specified SC250 VMax TRM (turf reinforcement mat) product (or approved equivalent) shown in Appendix C. Specific locations where the TRM is required in swale sections is shown in the Grading and Erosion Control Construction Documents. To ensure capacity, swales will have a minimum of 1-ft. of freeboard over the water surface for flows anticipated in a 100-year storm event. Natural drainage swales are analyzed by the tributary flows and physical geometry to ensure stability and sufficient capacity for the proposed flows. Detailed swale calculations, sections, and TRM specifications can all be found in Appendix C.

In addition to the swales, proposed culverts also convey flows under roadways. Culverts under proposed local paved roadways will be sized to ensure that flows will not over-top the roadway. The outlets of the proposed culverts will be protected with riprap to limit potential erosion. The riprap protection sizing calculations for the proposed culverts are located in Appendix C.

Proposed Sub-basin Drainage

In the proposed condition, the site will be developed into eight 2.5-acre minimum single-family lots, proposed roadways, proposed swales, proposed roadside swales, undeveloped land, existing drainageways (both well and poorly defined), culverts, and two proposed full-spectrum extended detention basins (EDBs). The drainage design is intended to limit the impacts of development and impact to the natural landscape and the healthy tree grove by utilizing the existing well-vegetated natural drainage paths as much as possible. In general, the proposed drainage conditions follow the historic path from east to west utilizing pervious surfaces and the existing natural channels. Flows will then follow the historic paths in proposed or existing natural channels onto the unplatted properties to the west.

Proposed hydrologic analysis was performed utilizing the Rational Method calculations for the on-site drainage basins. Proposed imperviousness in the 2.5-acre (minimum) residential lots will be limited to a maximum of 10%, in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. See the proposed water quality map in Appendix E. If development in any of the residential lots exceeds 10% impervious, a lot specific drainage report must be submitted to address the additional imperviousness, water quality/detention requirements, and additional anticipated runoff. Runoff from these single-family lots does not include any proposed roadway flows and therefore follows the historic drainage patterns flowing off-site undetained or treated.

The proposed basin delineation as shown in proposed drainage map in Appendix E is as follows;

Final Drainage Report for Estates at Cathedral Pines

Basin A is approximately 0.84 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lot 8. Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the north undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=0.4$ cfs, $Q_{100}=1.8$ cfs) sheet flows generally northwest to DP1 and onto the adjacent Cathedral Pines Subdivision Filing No. 1 property to the north. For applicable excerpts from the Drainage Report and Plan for Cathedral Pines Subdivision Filing No. 1, refer to Appendix D.

Basin B is approximately 2.36 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lots 7 and 8. Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the north undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=1.1$ cfs, $Q_{100}=4.8$ cfs) sheet flows generally northwest to DP2 and onto the adjacent Cathedral Pines Subdivision Filing No. 1 property to the north. For applicable excerpts from the Drainage Report and Plan for Cathedral Pines Subdivision Filing No. 1, refer to Appendix D.

Basin C is approximately 2.06 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lot 7 and existing drainageways (both poorly and well-defined). Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the northwest undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=1.0$ cfs, $Q_{100}=4.2$ cfs) sheet flows generally northwest to DP3 and onto the unplatted adjacent property to the west.

Basin D is approximately 4.49 acres and in its proposed condition is comprised of a portion of existing Winslow Drive, a portion of the proposed roadways, parts of 2.5-acre developed Lots 6-8, proposed roadside swales, and existing undeveloped landscaping areas. Runoff generated by this basin ($Q_5=2.9$ cfs, $Q_{100}=10.3$ cfs) sheets flows into the roadside swales and flows north to DP4. Flows are combined with DP5 at the 24" FES located at DP5.1.

Basin E is approximately 0.65 acres and in its proposed condition is comprised of a portion of the proposed roadways, proposed roadside swales, and Pond A maintenance access. Runoff generated by this basin ($Q_5=1.1$ cfs, $Q_{100}=2.6$ cfs) sheets flows into the roadside swales and flows north under the maintenance trail via a 24" RCP culvert to DP5. Flows are combined with DP4 at the low spot at DP5.1 ($Q_5=3.8$ cfs, $Q_{100}=12.4$ cfs). Flows are then piped via a 24" RCP storm sewer into the forebay of the full-spectrum EDB (Pond A) within Basin F.

Basin F is approximately 0.31 acres and in its proposed condition is comprised of a proposed full-spectrum EDB (Pond A) and associated infrastructure. Runoff generated by this basin ($Q_5=0.4$ cfs, $Q_{100}=1.2$ cfs) sheets flows to the Pond A at DP6. Flow at DP6.1 ($Q_5=4.1$ cfs, $Q_{100}=13.1$ cfs)

combines the flow of DP5.1 and DP6, representing the total inflow into Pond A. Flows will be released through the outlet structure at DP6.2 ($Q_5=1.2$ cfs, $Q_{100}=5.4$ cfs). Flows will then enter Basin G and follow the drainage patterns of the basin as described below. Flows will combine with DP7 at DP7.1.

Basin G is approximately 9.03 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lots 4-7, existing drainageways (both poorly and well-defined), and a proposed swale. Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the west undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=4.5$ cfs, $Q_{100}=19.4$ cfs) flows to the existing natural swale that flows to the west to DP7. Flows from the Pond A outlet structure outfall to this basin at DP6.2 and follow the proposed swale west and south to the existing swale at DP7.1. Flows from DP6.2 and DP7 combine at DP7.1 ($Q_5=5.7$ cfs, $Q_{100}=24.8$ cfs) and continue off-site onto the property at 13855 Highway 83 to the west at flows less than existing DP4. See the Ex. DP4 and Prop. DP7.1 Existing Property Line section calculations in Appendix C.

Basin J is approximately 0.82 acres and in its proposed condition is comprised of part of proposed landscaping and undeveloped land. Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the west undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=0.4$ cfs, $Q_{100}=2.2$ cfs) sheet flows to the existing natural channel and generally follows the historic drainage pattern of east to west to DP10, a proposed 18" RCP culvert. Runoff enters the culvert and is transported under the proposed private road to Basin K. Flows from DP10 enter into Basin K and follow the existing drainage patterns of the basin as described below. Flows will combine with DP11 at DP11.1.

Basin K is approximately 3.48 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lots 3 and 4 and existing drainageways (both poorly and well-defined). Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the west undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=1.8$ cfs, $Q_{100}=7.8$ cfs) sheet flows to an existing natural channel and generally follows the historic drainage pattern from east to west to DP11. Flows from DP10 and DP11 combine at DP11.1 ($Q_5=2.2$ cfs, $Q_{100}=9.5$ cfs) and continue off-site onto the property at 13580 Bridle Bit Road to the west.

Basin L is approximately 2.58 acres and in its proposed condition is comprised of a portion of existing Winslow Drive, a portion of the proposed roadways, parts of 2.5-acre developed Lots 1-2, proposed roadside swales, and existing undeveloped landscaping areas. Runoff generated by this basin ($Q_5=2.6$ cfs, $Q_{100}=7.6$ cfs) sheets flows into the roadside swale of Sterling Manor Heights and flows south to DP12. DP12 flows to DP12.1 where it combines with DPP1. The existing Cathedral

Pines Subdivision Filing No. 1 pond located to the east of Winslow Drive releases flows within the existing 18" RCP at DPP1 ($Q_5=3.7$ cfs, $Q_{100}=10.9$ cfs). Flows from DPP1 enter the site via the existing swale and later combine with DP12 at the proposed roadside swale at DP12.1 ($Q_5=6.3$ cfs, $Q_{100}=18.5$ cfs). DP12.1 then combines flows with DP13 at the Type C sump inlet located at DP13.1. As mentioned above, the 24" RCP emergency spillway overflow culvert from Cathedral Pines Subdivision Filing No. 1 also enters the existing swale through the site should the existing pond overflow. For more information on the emergency overflow conveyance design, see the end of this section below and Appendix C for calculations.

Basin M is approximately 0.45 acres and in its proposed condition is comprised of a portion of the proposed roadways, proposed roadside swales, and Pond B maintenance access. Runoff generated by this basin ($Q_5=0.9$ cfs, $Q_{100}=2.1$ cfs) sheets flows into the roadside swales and flows south under the maintenance trail via a 12" RCP culvert to DP13. Flows are combined with DP12.1 at DP13.1 ($Q_5=7.1$ cfs, $Q_{100}=20.2$ cfs), the Type C sump inlet. This sump inlet was sized to capture all flows in the minor and major storm. In the event that the inlet becomes clogged, flows will overtop the berm and flow into Pond B. Captured inlet flows are then piped via a 24" RCP storm sewer into the forebay within the full-spectrum EDB (Pond B) within Basin N.

Basin N is approximately 0.75 acres and in its proposed condition is comprised of a proposed full-spectrum EDB (Pond B), associated infrastructure, and lawn areas. Runoff generated by this basin ($Q_5=0.6$ cfs, $Q_{100}=2.5$ cfs) sheets flows to Pond B at DP14. Flow at DP14.1 ($Q_5=7.6$ cfs, $Q_{100}=22.0$ cfs) combines the flow of DP13.1 (the Type C sump inlet) and DP14, representing the total inflow into Pond B. Flows will be released through the outlet structure at DP14.2 ($Q_5=0.6$ cfs, $Q_{100}=4.3$ cfs). Flows will then enter Basin O and follow the drainage patterns of the basin as described below. Flows will combine with DP15 at DP15.1.

Basin O is approximately 4.83 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lots 2-4 and existing drainageways (both poorly and well-defined). Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the west undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=2.5$ cfs, $Q_{100}=10.7$ cfs) sheets flows to the existing natural channel that flows to the west to DP15. Flows from Pond B outlet structure outfall to this basin at DP14.2. Flows from DP14.2 and DP15 combine at DP15.1 ($Q_5=3.1$ cfs, $Q_{100}=15.0$ cfs) and continue onto the property at 13580 Bridle Bit Road to the west and combine at DP16.2.

Basin OS-1 is approximately 0.13 acres and in its existing condition is comprised of a portion of Winslow Drive. The basin is off-site and therefore no work is proposed within this basin. Runoff from this basin does not include any modification to existing roadway flows and therefore follows the historic drainage pattern flowing off-site to the west undetained or treated. This is in accordance with Section I.7.1.B.3 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=0.3$ cfs, $Q_{100}=0.7$ cfs) will follow the historic path east to west overland to the existing

natural channel at DPO1. Flows will then enter Basin P and follow the drainage patterns of the basin as described below. Flows will combine with DPO2 and DP16 at DP16.1.

Basin OS-2 is approximately 2.44 acres and in its existing condition is comprised of part of a single-family lot with a house, asphalt drive, and a portion of Winslow Drive. This is an off-site basin to the south, a part of the Falcon Forest Subdivision Filing No. 2 development. Due to the basin location off-site, no work is proposed within this basin. Runoff generated by this basin ($Q_5=1.7$ cfs, $Q_{100}=6.7$ cfs) will follow the historic path east to west overland to the existing natural channel at DPO2. Flows will then enter Basin P and follow the drainage patterns of the basin as described below. Flows will combine with DPO1 and DP16 at DP16.1.

Basin P is approximately 3.51 acres and in its proposed condition is comprised of part of proposed 2.5-acre developed Lots 1 and 2 and existing drainageways (both poorly and well-defined). Runoff from this basin does not include any proposed roadway flows and therefore follows the historic drainage pattern flowing off-site to the west undetained or treated. This is in accordance with Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Runoff generated by this basin ($Q_5=1.6$ cfs, $Q_{100}=6.8$ cfs) sheet flows to an existing natural channel and generally follows the historic drainage pattern from east to west to DP16. DP16 flows will combine with DPO1 and DPO2 at DP16.1 ($Q_5=2.9$ cfs, $Q_{100}=12.0$ cfs) continue off-site onto the property at 13580 Bridle Bit Road to the west and combines at DP16.2 ($Q_5=5.6$ cfs, $Q_{100}=25.1$ cfs). Flows continue within the existing swale flowing west.

Comparison of Flows

There are several locations where flow leaves the site in both the existing and proposed conditions. Comparisons of the flows are shown below.

- Ex. DP1 ($Q_5=0.3$ cfs, $Q_{100}=1.8$ cfs) and prop. DP1 ($Q_5=0.4$ cfs, $Q_{100}=1.8$ cfs) flow off-site to the north onto Tract 1 of the Cathedral Pines Subdivision Filing No. 1.
- Ex. DP2 ($Q_5=0.8$ cfs, $Q_{100}=5.6$ cfs) and prop. DP2 ($Q_5=1.1$ cfs, $Q_{100}=4.8$ cfs) flow off-site to the north onto Lot 30 of the Cathedral Pines Subdivision Filing No. 1.
- Ex. DP3 ($Q_5=0.8$ cfs, $Q_{100}=5.0$ cfs) and prop. DP3 ($Q_5=1.0$ cfs, $Q_{100}=4.2$ cfs) flow off-site to the northwest onto the property at 13855 Highway 83.
- Ex. DP4 ($Q_5=4.0$ cfs, $Q_{100}=25.2$ cfs) and prop. DP7.1 ($Q_5=5.7$ cfs, $Q_{100}=24.8$ cfs) flow off-site to the west onto the property at 13855 Highway 83.
- Ex. DP6 ($Q_5=1.5$ cfs, $Q_{100}=9.5$ cfs) and prop. DP11.1 ($Q_5=2.2$ cfs, $Q_{100}=9.5$ cfs) flow off-site to the west onto the property at 13855 Highway 83.
- Ex. DP8.2 ($Q_5=8.2$ cfs, $Q_{100}=36.1$ cfs) and prop. DP16.2 ($Q_5=5.6$ cfs, $Q_{100}=25.1$ cfs) flow off-site to the west onto the property at 13580 Bridle Bit Road.

Overall in the existing condition, the total released flows off-site are from DP 1-6 and 8.2 for a total flow of $Q_5=15.6$ cfs and $Q_{100}=83.2$ cfs flowing north and west to adjacent properties. In the proposed condition, the total released flows off-site are from DP 1-3, 7.1, 11.1, and 16.2 for a

total flow of $Q_5=16.0$ cfs and $Q_{100}=70.2$ cfs. The flows follow the historic pattern released off-site to the north and west. Comparing the existing and proposed individual and total flows released off-site, the major flows released in the proposed condition are less than the existing condition. Therefore, there are no negative impacts anticipated to downstream conveyances or properties with the development of the site.

In the case where the existing pond part of Cathedral Pines Subdivision Filing No. 1 overtops, the proposed conveyance was analyzed to ensure emergency flows would get to the desired location. The existing pond would overtop the emergency spillway and flow to the existing 24" RCP culvert before crossing onto the site. Flows ($Q_{100}=35.6$ cfs) would then enter the existing swale to the combination with the proposed roadside swale at DP12.1. The total flow within the proposed Basin L roadside swale would be $Q_{100}=43.2$ cfs. The Basin L emergency overflow swale calculation shows that flows would stay within the proposed swale to the Type C inlet at DP13.1. The inlet calculation shows that the flows would overtop the proposed Type C inlet at DP13.1 and flow into the Pond B. For the Pond B emergency spillway, the total flow would be the existing pond emergency overflow ($Q_{100}=35.6$ cfs) as well as the Pond B emergency overflow ($Q_{100}=22.0$ cfs) for a total flow of $Q_{100}=57.6$ cfs. The spillway weir calculation shows that the Pond B spillway would direct flows to the Basin O existing swale. Flows would then combine with DP15 at DP15.1, the existing swale with a total flow of $Q_{100}=68.3$ cfs. The Basin O emergency overflow swale calculation shows that the existing swale would contain the flows and convey them off-site following the historic path west. See the end of Appendix C for applicable emergency overflow conveyance calculations.

DRAINAGE DESIGN CRITERIA

Development Criteria Reference

Storm drainage analysis and design criteria for the project were taken from the "City of Colorado Spring/El Paso County Drainage Criteria Manual" Volumes 1 and 2 (EPCDCM), dated October 12, 1994, the "Urban Storm Drainage Criteria Manual" Volumes 1 - 3 (USDCM) and Chapter 6 and Section 3.2.1 of Chapter 13 of the "Colorado Springs Drainage Criteria Manual (CCSDCM)", dated May 2014, as adopted by El Paso County, as well as the El Paso County "Engineering Criteria Manual" (ECM), dated October 14, 2020.

Hydrologic Criteria

All hydrologic data was obtained from the "City of Colorado Springs Drainage Criteria Manual" Volumes 1 and 2, and the "Urban Drainage and Flood Control District Urban Storm Drainage Criteria Manual" Volumes 1, 2, and 3. On-site drainage improvements were designed based on the 5 year (minor) storm event and the 100-year (major) storm event. Runoff was calculated using the Rational Method, and rainfall intensities for the 5-year and the 100-year storm return frequencies were obtained from Figure 6-5 Intensity Duration Frequency Curve of the Colorado Springs DCM. Runoff coefficients were determined based on proposed land use and from data in Table 6-6 from the DCM. Time of concentrations were developed using equations from the DCM. The flows for the off-

site pond released flows at DP-P1 was routed into the Rational Method calculations by taking the released flows and dividing by the adjacent basin intensity to calculate C^*A . Then the routing continued using the standard calculations per the Rational Method to the next design point. All runoff calculations and applicable charts and graphs are included in Appendix B.

Hydraulic Criteria

The Rational Method and USDCM's SF-2 and SF-3 forms were used to determine the runoff from the minor and major storms on the site. Autodesk Inc.'s Hydraflow Express Extension (Volume 10.5) was used to size the roadside ditches and drainage swales per criteria. Hydraflow Express was also used to analyze the proposed culverts within the Estates at Cathedral Pines development. Per Section 6.4.1 of the EPCDCM, culverts were sized as to not overtop the road in the 100-year storm. UDFCD Volume 2 Chapter 9 Figure 9-35 will be used to size the riprap protection around the proposed culverts. The MHFD-Detention_v4.06 spreadsheet was utilized for evaluating proposed detention and water quality for the Pond A and Pond B. Required detention volumes and allowable release rates were designed per USDCM and CCS/EPCDCM. Bentley StormCAD v8i was used to analyze the hydraulic grade lines and energy grade lines for the storm sewer network. See Appendix C for calculations.

DRAINAGE FACILITY DESIGN

General Concept

The combination of the proposed and existing stormwater conveyance system was designed to convey the developed Estates at Cathedral Pines flows to one of two full-spectrum EDB via roadside ditches and swales. The drainage design is intended to utilize the existing well-vegetated natural drainage paths on-site and reduce the impacts of development. The proposed full-spectrum EDBs will be located at the northern and southern ends of the proposed main roadway. Pond A is located on the northern portion of the site and will outfall to a proposed swale. The outfall channel is routed to direct flows to the historic drainage path of east to west within Lot 5. Pond B is located on the southern portion of the site and will utilize an existing natural channel to outfall flows on the adjacent unplatted property. Development of the 2.5 acre (min.) single-family lots in basins A-C, G-K, and O-P will be limited to 10% or less for areas that do not have a water quality feature downstream in order to satisfy Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure. Impacts to adjacent properties will be limited as proposed developed flows will be released at below existing rates of flow.

Specific Details

All proposed drainage items in this report will be designed to accept both 5-year and 100-year flows. All culverts will have a flared end section (FES) on both sides of the pipe. All culverts will have riprap protection downstream as a method of erosion protection prior to the stormwater entering the proposed swales. The proposed forebays will have a concrete bottom leading to the soil riprap berm. The proposed pond forebays and weir contain 1% of the required Water Quality Capture Volume

(WQCV). The forebays weir will release 2% of the undetained peak 100-year inflow into the full-spectrum EDB via a notch in the berm and onto the proposed concrete trickle channel. The trickle channel will direct flows into the proposed full-spectrum EDB outlet structure, which will detain water per times specified by criteria.

Four Step Process to Minimize Adverse Impacts of Urbanization

In accordance with the El Paso County Drainage Criteria Manual, Volume 2 this site has implemented the four step process to minimize adverse impacts of urbanization. The four step process includes reducing runoff volumes; stabilizing drainageways, treating the water quality capture volume (WQCV), and consider the need for Industrial Commercial BMP's.

Step 1, Reducing Runoff Volumes: The development of the project site is proposed as single-family residential (2.5 acre min.) with lawn areas interspersed within the development which helps disconnect impervious areas and reduce runoff volumes. The development is intended to limit the impact to the natural landscape and preserve the existing healthy tree grove by creating an open space preservation easement for this area. Roadways will utilize roadside ditches to further disconnect impervious areas. Proposed flow in general follows the historic path over pervious surfaces into existing drainage paths. These practices will also allow for increased infiltration and reduce runoff volume.

Step 2, Stabilize Drainageways: This site utilizes roadside ditches with culvert crossings throughout the site. These roadside ditches will then direct the applicable on-site and off-site development flows to a proposed full-spectrum EDB within the project. The proposed full-spectrum EDB's will be designed to release flows at or below historic rates. Roadside ditches will be stabilized by keeping velocities below 5 ft/s, or providing additional erosion protection. Developed flows leaving the site are limited to below existing rates, and therefore no impact to downstream drainageways is anticipated.

Step 3, Provide WQCV: Runoff from this development is treated through capture and slow release of the WQCV in the two on-site proposed permanent full-spectrum EDBs that are be designed per current El Paso County drainage criteria. The 2.5-acre (minimum) residential lots will be limited to a maximum of 10% imperviousness to meet the requirements of Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure for water quality through a plat note. Should any lot exceed 10% imperviousness, a lot specific drainage report addressing the increased imperviousness must be submitted.

Step 4, Consider the need for Industrial and Commercial BMP's: No industrial or commercial uses are proposed within this development. Site specific temporary source control BMPs as well as permanent BMP's will be detailed in this plan and narrative to protect receiving waters.

Water Quality

In accordance with Section 13.3.2.1 of the CCS/EPCDCM, full-spectrum water quality and detention will be provided for all of the development site not meeting exclusions present in the ECM - Stormwater Quality Policy and Procedures Section I.7.1.B. As previously stated, the applicable exclusions for Basins A-C, G-K, and O-P fall under Section I.7.1.B.5 of the ECM Stormwater Quality Policy and Procedure for areas with large single-family lots (2.5-acre min.). In addition, one of the basins J is an proposed open space tract that is excluded under the Section I.7.1.B.7 of the ECM Stormwater Quality Policy and Procedure for land disturbance to undeveloped land that will remain undeveloped. The proposed roadway will be treated within the proposed full-spectrum EDBs. Outlet structure release rates will be limited to less than historic rates to minimize adverse impacts to downstream stormwater facilities.

Proposed Full-Spectrum EDBs

Water quality is provided for the site by two private full-spectrum detention and water quality extended detention basins. The proposed Pond A is sized to provide water quality and detention for a total of 5.5 acres at 21.5% impervious. The proposed Pond B is sized to provide water quality and detention for a total of 4.0 acres at 27% impervious. Table 1 below shows the basin parameters for both ponds. Refer to Appendix C for the UD-Detention design sheets that include the tributary basin parameters as well as the stage-storage table and outlet structure design. The outlet structure includes an orifice plate, overflow grate, and restrictor plate to release stormwater at the appropriate rates. The WQCV will be released within 40 hours, the EURV will be released within 72 hours, and the minor and major flows will be released at or below the pre-development flow rate. Table 2 below gives the design storm results for Pond A and Pond B.

A broad-crested weir lined with Type L buried soil riprap is provided as an emergency spillway along the western embankment of both ponds. Pond A emergency flows are conveyed via a proposed drainage swale to the existing natural channel directing flows the west per historic drainage patterns. Pond B emergency flows are conveyed via an existing drainage swale to the properties to the west per historic drainage patterns. A low tailwater Type L riprap basin (per MHFD specifications) will be used at the outfall of Pond B providing erosion protection for the downstream wetlands. A separate analysis for the existing Cathedral Pines Subdivision Filing No. 1 pond emergency overflow shows that the Pond B spillway would direct flows to the existing swale within Basin O.

Table 1 - Watershed Design Parameters for both EDBs

Name	Watershed Area	Percent Impervious	Watershed Slope
Pond A	5.5 AC	21.5%	0.040 ft/ft
Pond B	4.0 AC	27.0%	0.045 ft/ft

Table 2- Full-spectrum EDB Design for both EDBs

Name	Required Volume (ac-ft)	Provided Volume (ac-ft)	WQCV (ac-ft)	EURV (ac-ft)	5-year Release (cfs)	100-year Release (cfs)
Pond A	0.30	0.42	0.06	0.12	1.2	5.4
Pond B	0.25	0.28	0.05	0.11	0.6	4.3

Calculations and pond design parameters are presented in Appendix C.

Erosion Control Plan

It is the policy of El Paso County that a Final Grading and Erosion Control Plan be submitted with the Final Drainage Report, construction drawings, and plat prior to obtaining a grading permit.

Operation & Maintenance

In order to ensure the function and effectiveness of the stormwater infrastructure, maintenance activities such as inspection, routine maintenance, restorative maintenance, rehabilitation and repair, are required. All proposed drainage structures within any platted County R.O.W. (roadside ditches and local road culverts) will be owned and maintained by El Paso County. All proposed drainage structures within easements or tracts (full-spectrum water quality ponds, drainageway culverts and drainageway improvements) will be owned and maintained by The Estates at Cathedral Pines Homeowners Association unless another party accepts such responsibility in writing and responsibility is properly assigned through legal documentation. The proposed local road is private and therefore also maintained by The Estates at Cathedral Pines Homeowners Association. Inspection access for El Paso County will be provided through a maintenance easement.

Drainage and Bridge Fees

The proposed site lies within the Black Squirrel Drainage Basin. The drainage fee associated with the Black Squirrel Drainage Basin is \$11,275 per impervious acre and the bridge fee is \$710 per impervious acre. Anticipated drainage and bridge fees are presented below and will be due at time of platting (depending on date of plat submittal):

ESTATES AT CATHEDRAL PINES IMPERVIOUS AREA CALCULATION			
Breakdown	Area (acres)	% Impervious	Impervious Acres
Tract C	2.0723	100%	2.07
2.5 Acre (Min.) Lots	30.5169	10%	3.05
Tracts – Open Space	2.5038	2%	0.05
Total	35.0930		5.17

2024 DRAINAGE AND BRIDGE FEES – ESTATES AT CATHEDRAL PINES				
Impervious Acres (ac)	Drainage Fee (Per Imp. Acre)	Bridge Fee (Per Imp. Acre)	Cathedral Pines Drainage Fee	Cathedral Pines Bridge Fee
5.17	\$11,275	\$710	\$58,291.75	\$ 3,670.70

Construction Cost Opinion

A construction cost opinion for the drainage infrastructure has been provided below. The below cost opinion is only an estimate of facility and drainage infrastructure cost and may vary.

Estates at Cathedral Pines (Private Non-Reimbursable)-Storm					
Item	Description	Quantity	Unit	Unit Price	Cost
1	12" RCP	72	LF	\$ 60.00	\$ 4,320.00
2	12" FES	4	EA	\$ 360.00	\$ 1,440.00
3	18" RCP	168	LF	\$ 82.00	\$ 13,776.00
4	18" FES	2	EA	\$ 492.00	\$ 984.00
5	Type L Soil Riprap	4	Tons	\$ 104.00	\$ 416.00
				Sub-Total	\$ 20,936.00

Estates at Cathedral Pines (Private Non-Reimbursable)-Pond A					
Item	Description	Quantity	Unit	Unit Price	Cost
1	18" RCP	43	LF	\$ 82.00	\$ 3,526.00
2	18" FES	1	EA	\$ 492.00	\$ 492.00
3	24" RCP	48	LF	\$ 98.00	\$ 4,704.00
4	24" FES	1	EA	\$ 588.00	\$ 588.00
5	Concrete Forebay	1	EA	\$12,000.00	\$ 12,000.00
6	Outlet Structure	1	EA	\$15,000.00	\$ 15,000.00
7	Aggregate Base Course (12" Depth)	61	CY	\$ 66.00	\$ 4,026.00
8	Type L Soil Riprap	56	Tons	\$ 104.00	\$ 5,824.00
9	Concrete Pavement (8")	54	SY	\$ 125.00	\$ 6,750.00
				Sub-Total	\$ 52,910.00

Estates at Cathedral Pines (Private Non-Reimbursable)-Pond B					
Item	Description	Quantity	Unit	Unit Price	Cost
1	18" RCP	39	LF	\$ 82.00	\$ 3,198.00
2	18" FES	1	EA	\$ 492.00	\$ 492.00
3	24" RCP	57	LF	\$ 98.00	\$ 5,586.00
4	Type C Inlet	1	EA	\$ 6,037.00	\$ 6,037.00
5	Concrete Forebay	1	EA	\$12,000.00	\$ 12,000.00
6	Outlet Structure	1	EA	\$15,000.00	\$ 15,000.00
7	Aggregate Base Course (12" Depth)	109	CY	\$ 66.00	\$ 7,194.00
8	Type L Soil Riprap	74	Tons	\$ 104.00	\$ 7,696.00
9	Concrete Pavement (8")	57	SY	\$ 125.00	\$ 7,125.00
				Sub-Total	\$ 64,328.00



SUMMARY

The Final Drainage Report for Estates at Cathedral Pines identifies on-site and off-site drainage patterns, storm sewer, culvert locations, areas tributary to the site, and safely routes developed storm water to adequate outfall facilities. The proposed Estates at Cathedral Pines development will not adversely affect the off-site major drainageways or surrounding development. This report meets the latest El Paso County Drainage Criteria requirements for this site.

REFERENCES:

1. Engineering Criteria Manual, El Paso County, October 14, 2020.
2. City of Colorado Springs Drainage Criteria Manual Volume 1, City of Colorado Springs, CO, May 2014.
3. Urban Storm Drainage Criteria Manual, Urban Drainage and Flood Control District, Latest Revision.
4. FEMA Flood Insurance Rate Map (F.I.R.M.) Panel No. 08041C0535G, effective date December 7, 2018.
5. "Soil Survey of El Paso County Area, Colorado," by the USDA Natural Resources Conservation Service.
6. Black Squirrel Creek Drainage Basin Planning Study, prepared by URS Corporation and dated January, 1989.
7. Final Drainage Report and Plan for Cathedral Pines Subdivision Filing No. 1, prepared by Leigh Whitehead & Associates, Inc. and dated January 2005.
8. Cathedral Pines Subdivision Filing No. 1-As-Built Construction Drawings, prepared by Stillwater Engineering and dated October 8, 2008.

APPENDIX A
FIGURES AND EXHIBITS

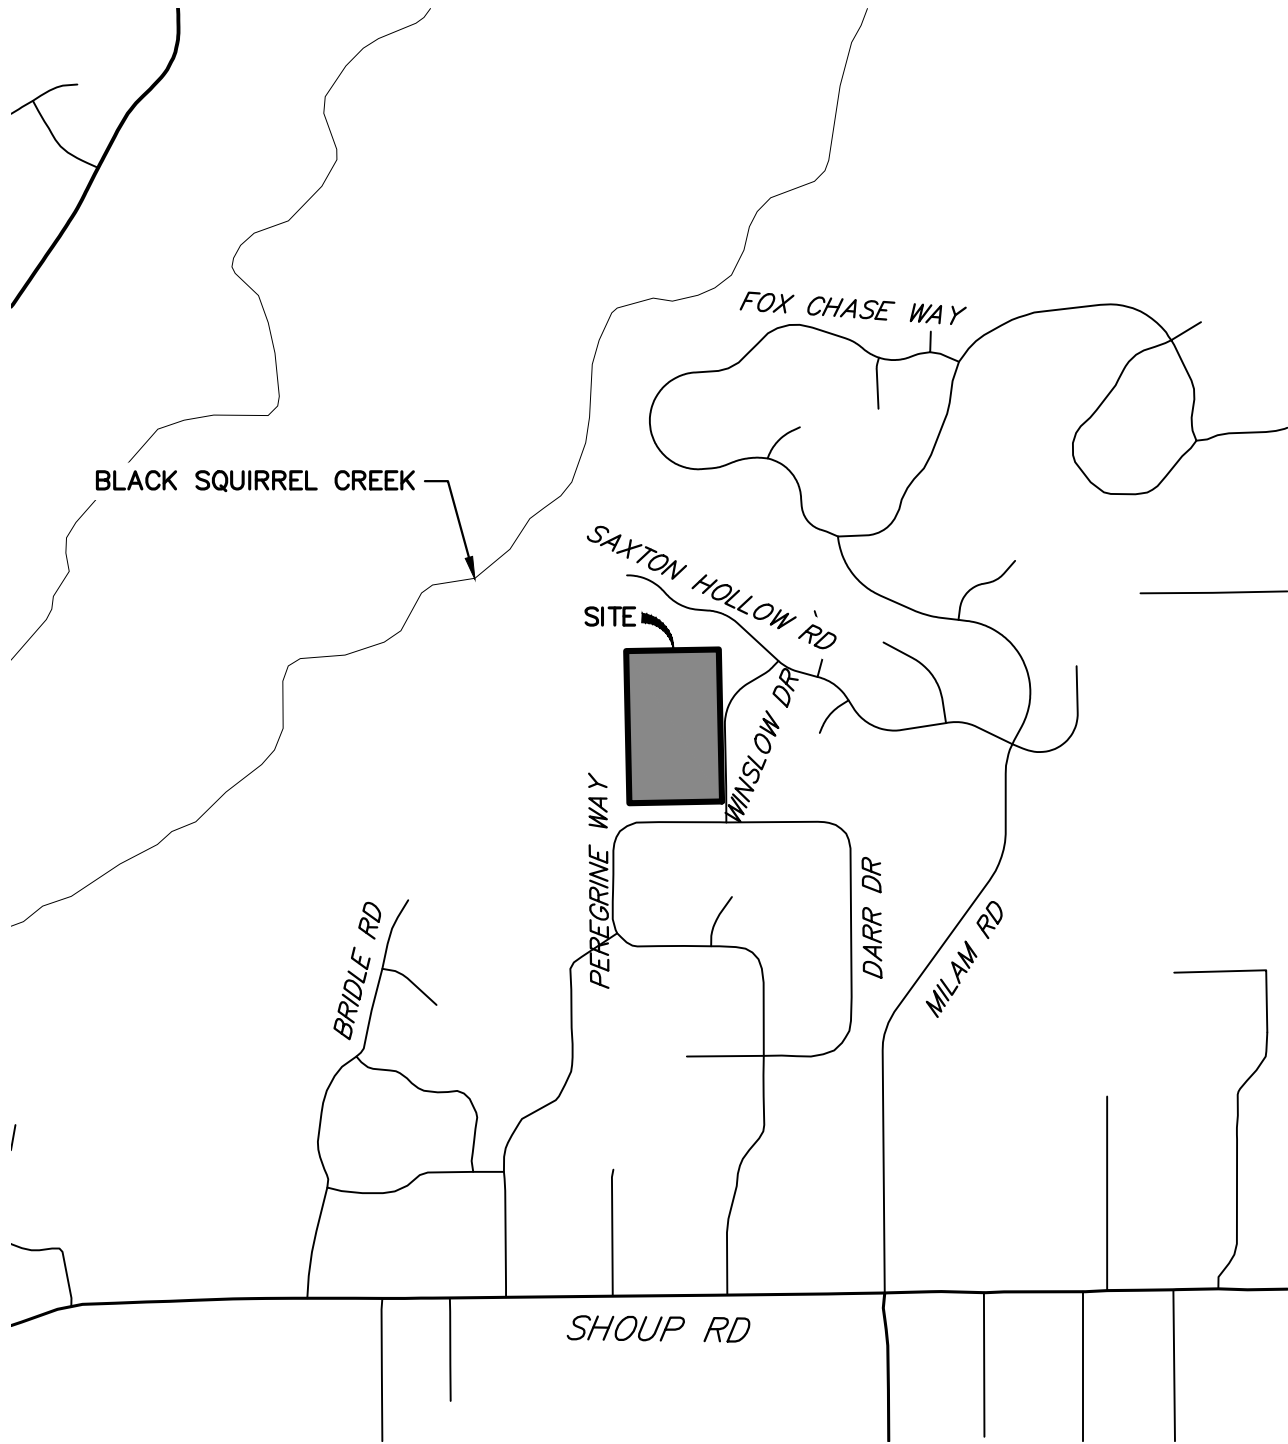


CATHEDRAL PINES
VICINITY MAP
2000-5260.00
08-17-2022
SHEET 1 OF 1




Centennial 303-740-9393 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com

X:\25260000\Drawings\Blocks\2022-08-07_2526000 Vic Map.dwg, 8.5x11 Portrait, 9/22/2022 3:48:36 PM, CS

Hydrologic Soil Group—El Paso County Area, Colorado

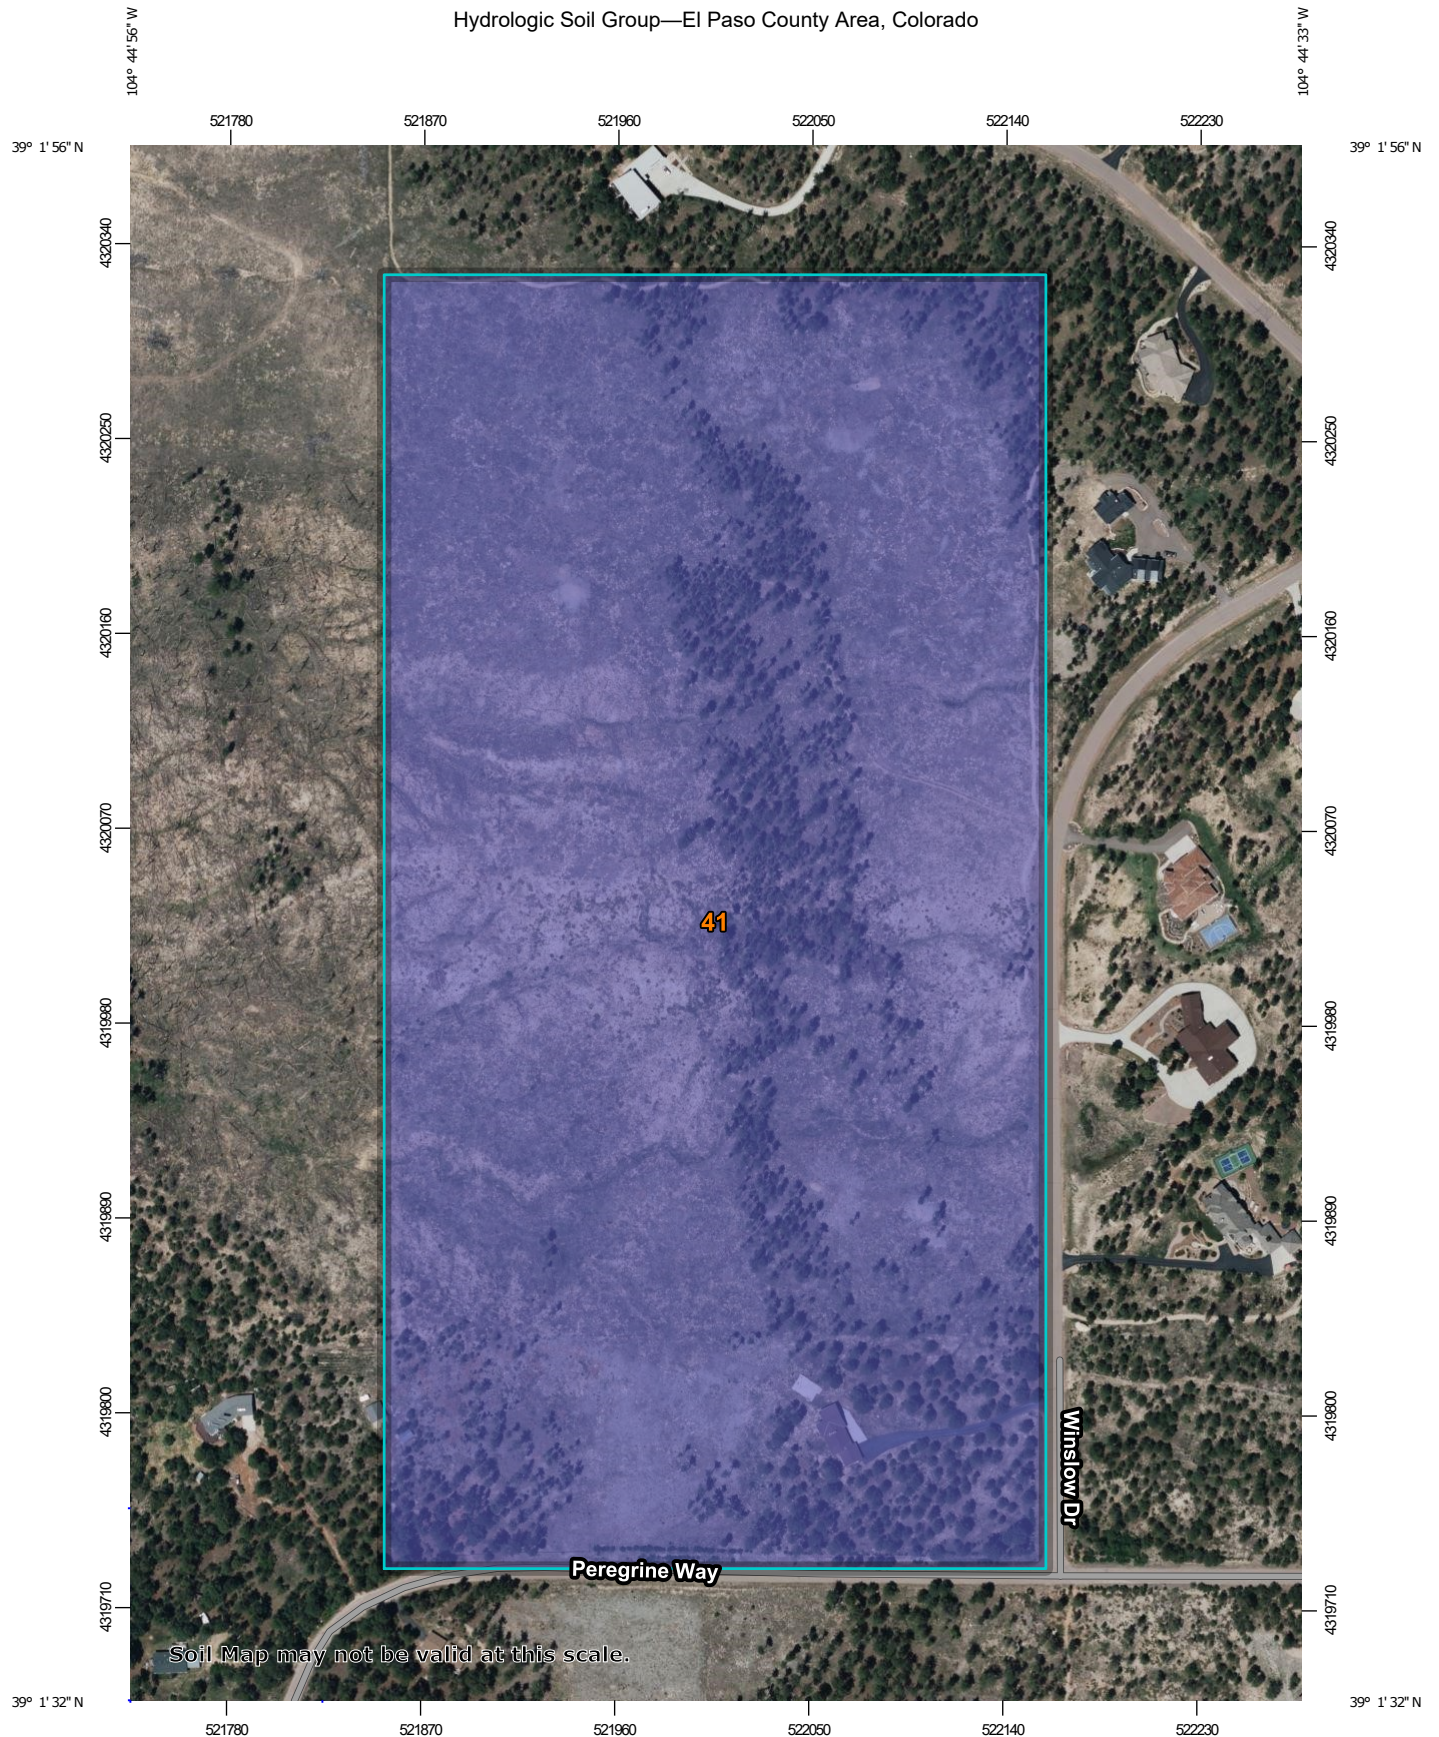

Soil Map may not be valid at this scale.

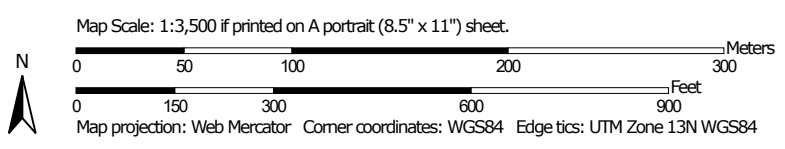

MAP LEGEND

Area of Interest (AOI)









 Area of Interest (AOI)

Soils

Soil Rating Polygons





-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

Soil Rating Lines

-  A
-  A/D
-  B
-  B/D
-  C
-  C/D
-  D
-  Not rated or not available

Soil Rating Points



-  A
-  A/D
-  B
-  B/D

-  C
-  C/D
-  D
-  Not rated or not available


Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 19, Aug 31, 2021

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Jun 9, 2021—Jun 12, 2021

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
41	Kettle gravelly loamy sand, 8 to 40 percent slopes	B	45.5	100.0%
Totals for Area of Interest			45.5	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in the preparation of this map was Universal Transverse Mercator (UTM) zone 13. The **horizontal datum** was NAD83, GRS80 spheroid. Differences in datum, spheroid, projection or UTM zones zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the **North American Vertical Datum of 1988 (NAVD88)**. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, NUNCS12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, MD 20910-3282

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was provided in digital format by El Paso County, Colorado Springs Utilities, City of Fountain, Bureau of Land Management, National Oceanic and Atmospheric Administration, United States Geological Survey, and Anderson Consulting Engineers, Inc. These data are current as of 2006.

This map reflects more detailed and up-to-date **stream channel configurations and floodplain delineations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study Report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map. The profile baselines depicted on this map represent the hydraulic modeling baselines that match the flood profiles and Floodway Data Tables if applicable, in the FIS report. As a result, the profile baselines may deviate significantly from the new base map channel representation and may appear outside of the floodplain.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.


Contact **FEMA Map Service Center (MSC)** via the FEMA Map Information eXchange (FMIX) 1-877-336-2627 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. The MSC may also be reached by Fax at 1-800-358-9620 and its website at <http://www.msc.fema.gov/>.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at <http://www.fema.gov/business/nfp/>.


El Paso County Vertical Datum Offset Table

Flooding Source	Vertical Datum Offset (ft)
REFER TO SECTION 3.3 OF THE EL PASO COUNTY FLOOD INSURANCE STUDY FOR STREAM BY STREAM VERTICAL DATUM CONVERSION INFORMATION	


Panel Location Map

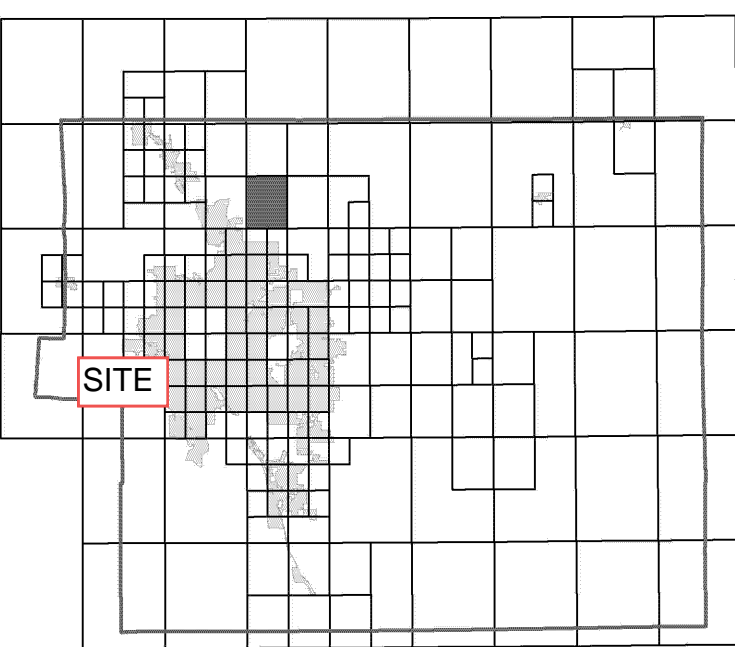

This Digital Flood Insurance Rate Map (DFIRM) was produced through a Cooperating Technical Partner (CTP) agreement between the State of Colorado Water Conservation Board (CWCB) and the Federal Emergency Management Agency (FEMA).

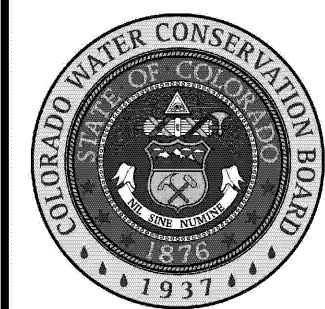

Additional Flood Hazard information and resources are available from local communities and the Colorado Water Conservation Board.

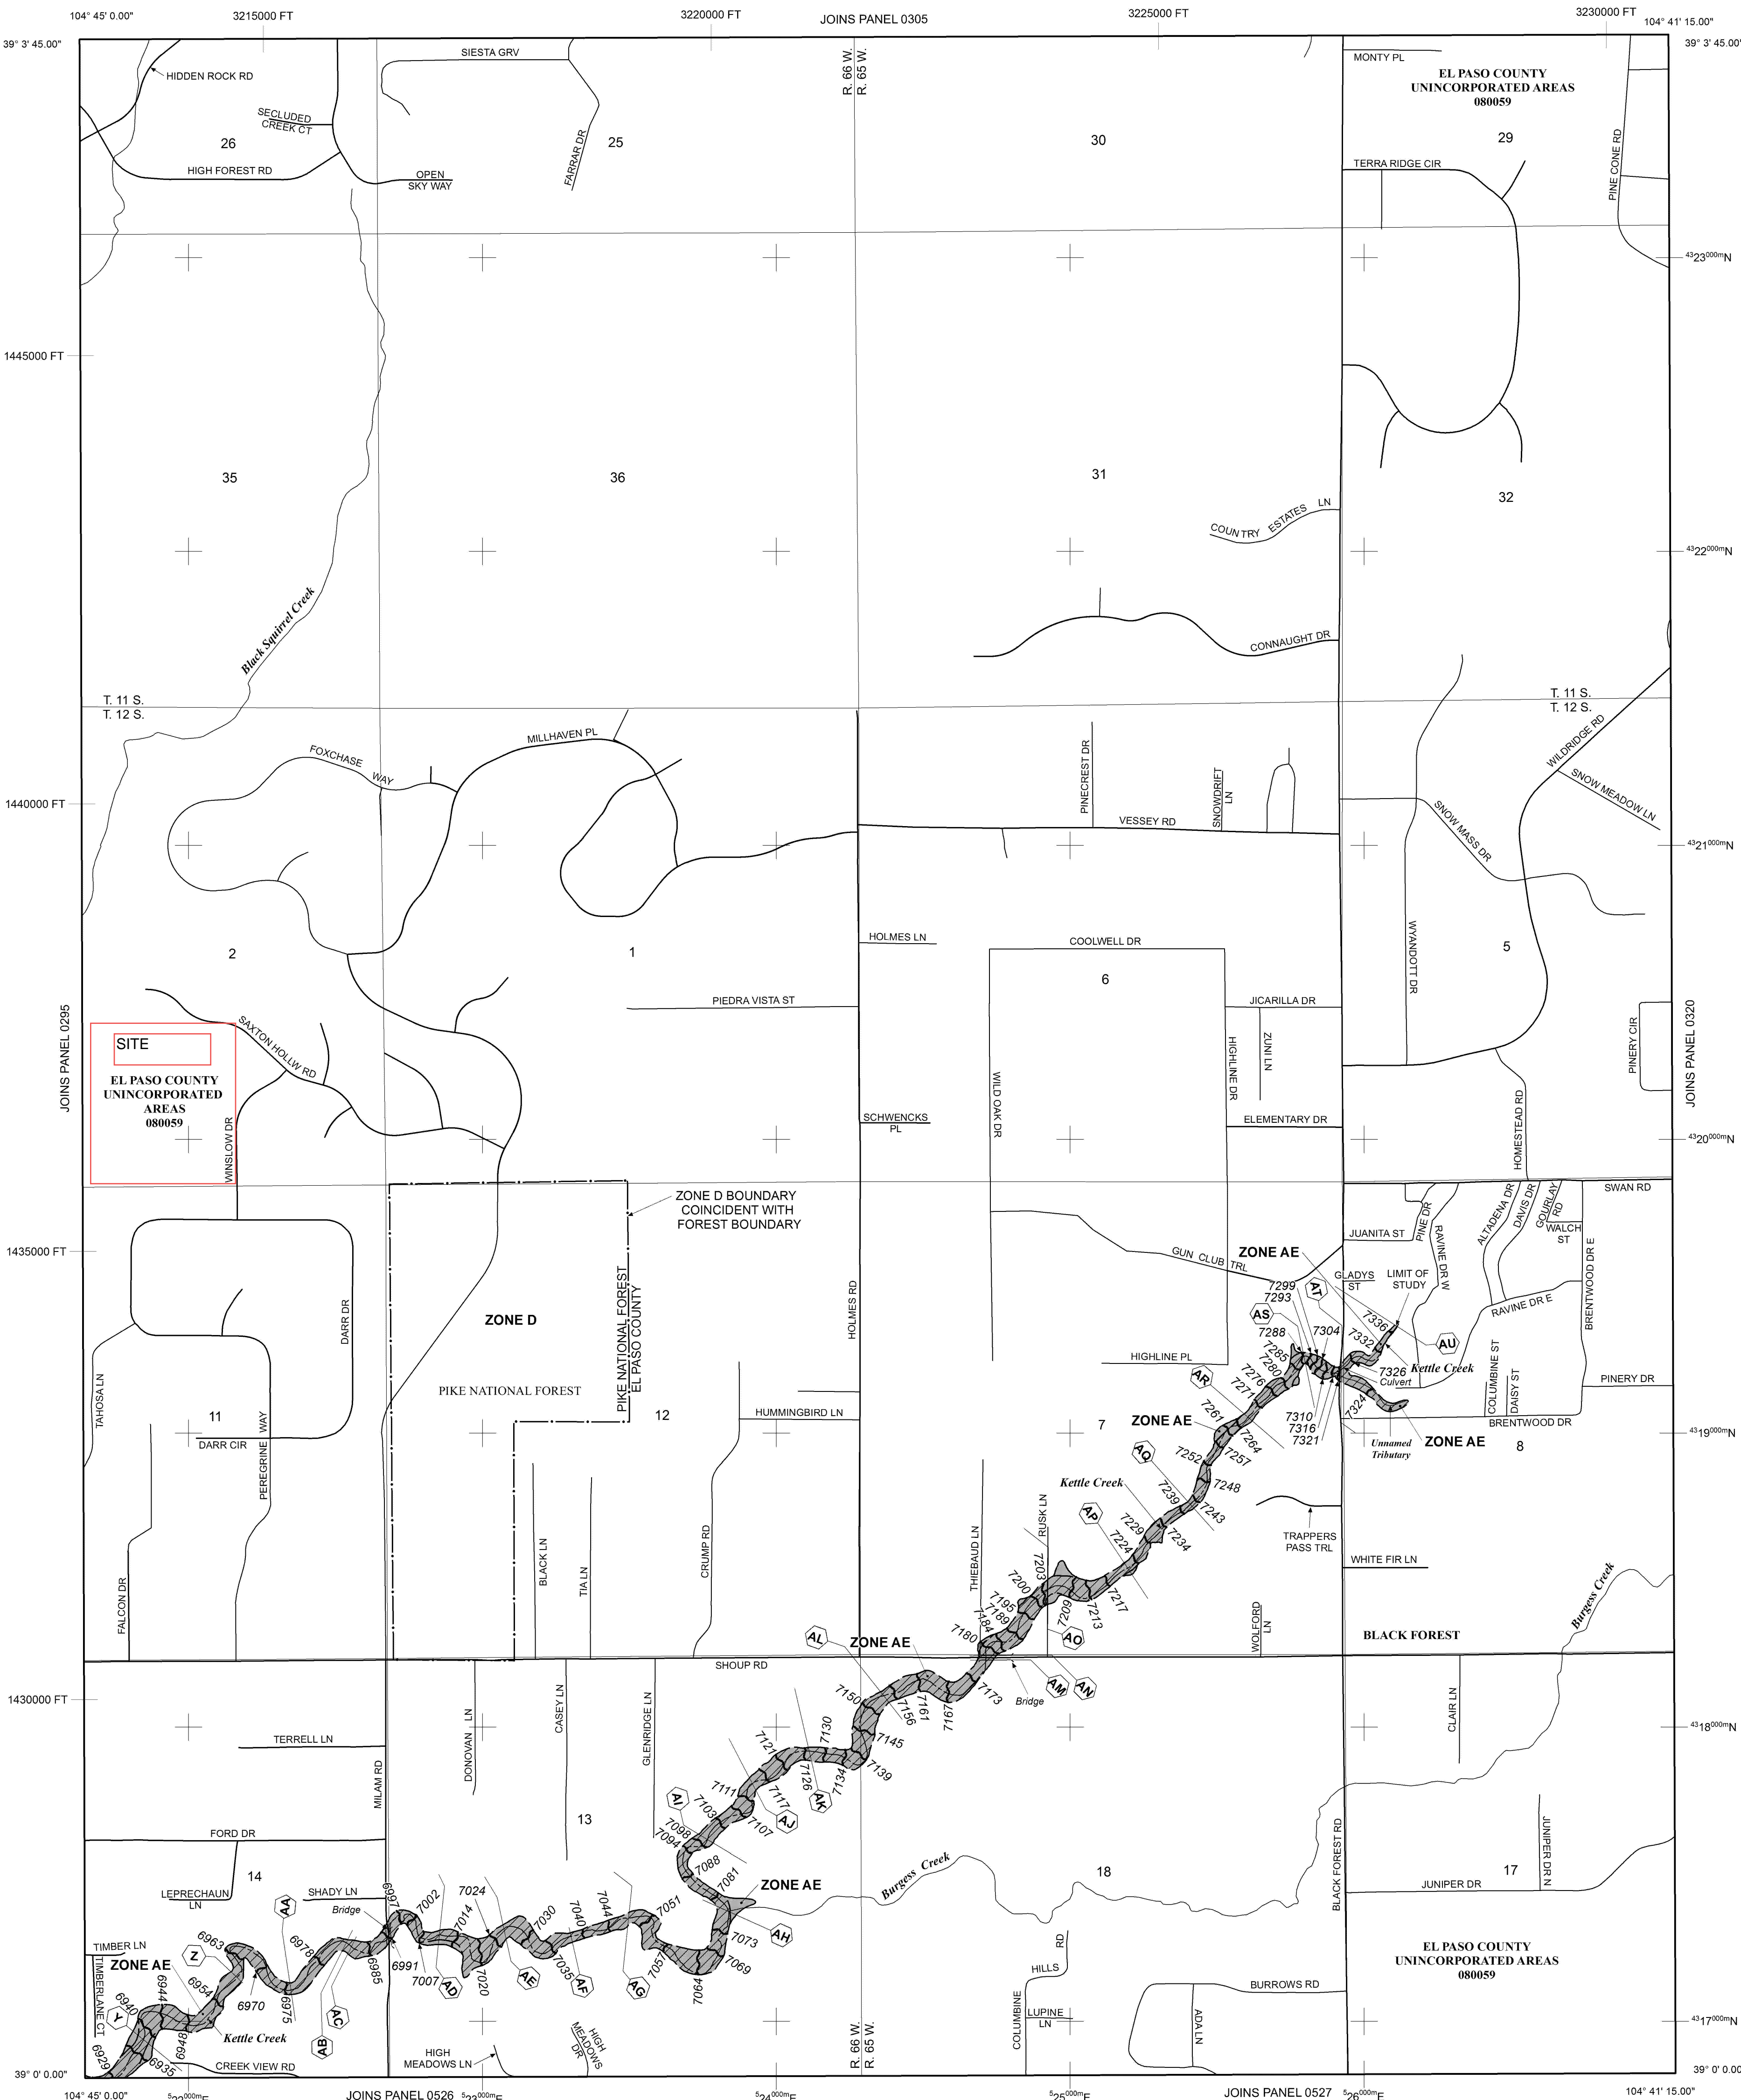

LEGEND

SPECIAL FLOOD HAZARD AREAS (SFHAs) SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equalled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area Formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

ZONE X Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot, or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

ZONE X Areas determined to be outside the 0.2% annual chance floodplain.

ZONE D Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- Floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.

Base Flood Elevation line and value; elevation in feet* (EL 987)

* Referenced to the North American Vertical Datum of 1988 (NAVD 88)

- Cross section line
- Transsect line

57° 07' 30.00" 32° 22' 30.00" Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)

4750000N 1000-meter Universal Transverse Mercator grid ticks, zone 13

6000000 FT 5000-foot grid ticks; Colorado State Plane coordinate system, central zone (FIPSZONE 0502), Lambert Conformal Conic Projection

DX5510 Bench mark (see explanation in Notes to Users section of this FIRM map)

M1.5 River Mile

MAP REPOSITORIES Refer to Map Repositories list on Map Index


EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP MARCH 17, 1997

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL DECEMBER 7, 2018 - to update corporate limits, to change Base Flood Elevations and Special Flood Hazard Areas, to update map format, to add roads and road names, and to incorporate previously issued Letters of Map Revision.

For community map revision history prior to countywide mapping, refer to the Community Map History Table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

MAP SCALE 1" = 1000'



EL PASO COUNTY UNINCORPORATED AREAS 080059

FIRM FLOOD INSURANCE RATE MAP EL PASO COUNTY, COLORADO AND INCORPORATED AREAS

PANEL 315 OF 1300

(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS: COMMUNITY NUMBER PANEL SUFFIX EL PASO COUNTY 080059 0315 0

Notice to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used on insurance applications for the subject community.

MAP NUMBER 08041C0315G

MAP REVISED DECEMBER 7, 2018

Federal Emergency Management Agency

APPENDIX B
HYDROLOGIC CALCULATIONS

EXISTING COMPOSITE % IMPERVIOUS/C VALUE CALCULATIONS

Subdivision: Cathedral Pines
 Location: El Paso County

Project Name: Estates at Cathedral Pines
 Project No.: 25260.00
 Calculated By: GAG
 Checked By: _____
 Date: 3/22/24

Basin ID	Total Area (ac)	Paved Hardscape/Water (100% Impervious)				Gravel Hardscape (80% Impervious)				2.5 Acre Lots (10% Impervious)				Lawns (2% Impervious)				Basin Total Weighted C		Basins Total Weighted % Imp.
		C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	
EX-1	0.84	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	0.84	2.0%	0.09	0.36	2.0%
EX-2	3.16	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	3.16	2.0%	0.09	0.36	2.0%
EX-3	3.29	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	3.29	2.0%	0.09	0.36	2.0%
EX-4	12.60	0.90	0.96	0.08	0.6%	0.59	0.70	0.03	0.2%	0.16	0.41	0.00	0.0%	0.09	0.36	12.49	2.0%	0.10	0.36	2.8%
EX-6	4.74	0.90	0.96	0.05	1.0%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	4.69	2.0%	0.10	0.37	3.0%
EX-7	8.06	0.90	0.96	0.10	1.2%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	7.96	2.0%	0.10	0.37	3.2%
EX-8	3.64	0.90	0.96	0.05	1.4%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	3.59	2.0%	0.10	0.37	3.4%
OS-1	2.44	0.90	0.96	0.05	2.0%	0.59	0.70	0.00	0.0%	0.16	0.41	2.39	9.8%	0.09	0.36	0.00	0.0%	0.17	0.42	11.8%
TOTAL	38.77																			3.4%

EXISTING STANDARD FORM SF-2 TIME OF CONCENTRATION

Subdivision: Cathedral Pines
Location: El Paso County

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/22/24

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					tc CHECK			FINAL
DATA						(T _i)			(T _t)					(URBANIZED BASINS)			
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C ₅	C ₁₀₀	L (ft)	S _o (%)	t _i (min)	L _t (ft)	S _t (%)	K	VEL. (ft/s)	t _t (min)	COMP. t _c (min)	TOTAL LENGTH (ft)	Urbanized t _c (min)	t _c (min)
EX-1	0.84	B	2%	0.09	0.36	255	7.3%	15.1	0	0.0%	7.0	0.0	0.0	15.1	255.0	25.7	15.1
EX-2	3.16	B	2%	0.09	0.36	300	5.6%	17.9	400	5.3%	7.0	1.6	4.1	22.0	700.0	28.8	22.0
EX-3	3.29	B	2%	0.09	0.36	300	4.4%	19.4	850	4.6%	7.0	1.5	9.4	28.8	1150.0	32.8	28.8
EX-4	12.6	B	3%	0.10	0.36	120	13.0%	8.5	950	6.0%	7.0	1.7	9.2	17.7	1070.0	32.4	17.7
EX-6	4.74	B	3%	0.10	0.37	110	12.0%	8.4	975	6.4%	7.0	1.8	9.2	17.6	1085.0	32.3	17.6
EX-7	8.06	B	3%	0.10	0.37	220	9.4%	12.8	1,035	4.9%	7.0	1.5	11.1	23.9	1255.0	33.7	23.9
EX-8	3.64	B	3%	0.10	0.37	150	6.2%	12.1	1,020	5.0%	7.0	1.6	10.9	23.0	1170.0	33.5	23.0
OS-1	2.44	B	12%	0.17	0.42	180	6.9%	11.8	0	0.0%	7.0	0.0	0.0	11.8	180.0	24.0	11.8

NOTES:

$$t_c = t_i + t_t$$

$$\text{Equation 6-} \quad t_i = \frac{0.395(1.1 - C_5)\sqrt{L_i}}{S_o^{0.33}}$$

$$\text{Equation 6-3}$$

Where:

t_c = computed time of concentration (minutes)

t_i = overland (initial) flow time (minutes)

t_t = channelized flow time (minutes).

$$t_t = \frac{L_t}{60K\sqrt{S_o}} = \frac{L_t}{60V_t}$$

Where:

t_t = channelized flow time (travel time, min)

L_t = waterway length (ft)

S_o = waterway slope (ft/ft)

V_t = travel time velocity (ft/sec) = K√S_o

K = NRCS conveyance factor (see Table 6-2).

Where:

t_i = overland (initial) flow time (minutes)

C₅ = runoff coefficient for 5-year frequency (from Table 6-4)

L_i = length of overland flow (ft)

S_o = average slope along the overland flow path (ft/ft).

$$\text{Equation 6-4 } t_c = (26 - 17i) + \frac{L_t}{60(14i + 9)\sqrt{S_t}}$$

$$\text{Equation 6-5}$$

Where:

t_c = minimum time of concentration for first design point when less than t_c from Equation 6-1.

L_t = length of channelized flow path (ft)

i = imperviousness (expressed as a decimal)

S_t = slope of the channelized flow path (ft/ft).

Table 6-2. NRCS Conveyance factors, K

Type of Land Surface	Conveyance Factor, K
Heavy meadow	2.5
Tillage/field	5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

Use a minimum t_c value of 5 minutes for urbanized areas and a minimum t_c value of 10 minutes for areas that are not considered urban. Use minimum values even when calculations result in a lesser time of concentration.

EXISTING STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 5-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/22/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE			TRAVEL TIME			REMARKS	
		Basin ID	Area (Ac)	Runoff Coeff.	t _c (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)		t _t (min)
	1	EX-1	0.84	0.09	15.1	0.08	3.51	0.3															Sheet flows overland to DP1 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Tract 1
	2	EX-2	3.16	0.09	22.0	0.28	2.94	0.8															Sheet flows overland to DP2 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Lot 30
	3	EX-3	3.29	0.09	28.8	0.30	2.54	0.8															Sheet flows overland to existing swale to DP3 Flows off-site onto property at 13855 Highway 83
	4	EX-4	12.60	0.10	17.7	1.21	3.27	4.0															Sheet flows overland to existing swale to DP4 Flows off-site onto property at 13580 Bridle Bit Road
	6	EX-6	4.74	0.10	17.6	0.46	3.28	1.5															Sheet flows overland to existing swale to DP6 Flows off-site onto property at 13580 Bridle Bit Road
	P1	-	15.50	-	-	1.31	-	3.7															Released flows from off-site pond via 18" RCP culvert Enters Basin EX-7 and combines at DP7.1
	7	EX-7	8.06	0.10	23.9	0.80	2.82	2.3															Sheet flows overland to existing swale to DP7 Combines in existing swale at DP7.1
	7.1								23.9	2.11	2.82	6.0											Combines flows of DPP1 and DP7 in existing swale Combines flows in existing swale at DP8.2
	O1	OS-1	2.44	0.17	11.8	0.43	3.87	1.7															Sheet flows overland to existing swale to DPO1 Combines in existing swale at DP8.1
	8	EX-8	3.64	0.10	23.0	0.37	2.88	1.1															Sheet flows overland to existing swale to DP8 Combines in existing swale at DP8.1
	8.1								23.0	0.80	2.88	2.3											Combines flows of DPO1 and DP8 in existing swale Combines flows in existing swale at DP8.2
	8.2								23.9	2.91	2.82	8.2											Combines flows of DP7.1 and DP8.1 in existing swale Flows off-site onto property at 13580 Bridle Bit Road

Notes:
Street and Pipe C*A values are determined by Q/I using the catchment's intensity value.
Values in blue indicate that they are from "Cathedral Pines Subdivision Filing No. 1 Drainage Report & Plan"

EXISTING STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 100-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/22/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	1	EX-1	0.84	0.36	15.1	0.30	5.90	1.8															Sheet flows overland to DP1 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Tract 1
	2	EX-2	3.16	0.36	22.0	1.14	4.94	5.6															Sheet flows overland to DP2 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Lot 30
	3	EX-3	3.29	0.36	28.8	1.18	4.26	5.0															Sheet flows overland to existing swale to DP3 Flows off-site onto property at 13855 Highway 83
	4	EX-4	12.60	0.36	17.7	4.59	5.49	25.2															Sheet flows overland to existing swale to DP4 Flows off-site onto property at 13580 Bridle Bit Road
	6	EX-6	4.74	0.37	17.6	1.73	5.51	9.5															Sheet flows overland to existing swale to DP6 Flows off-site onto property at 13580 Bridle Bit Road
	P1	-	15.50	-	-	2.30	-	10.9															Released flows from off-site pond via 18" RCP culvert Enters Basin EX-7 and combines at DP7.1
	7	EX-7	8.06	0.37	23.9	2.96	4.73	14.0															Sheet flows overland to existing swale to DP7 Combines in existing swale at DP7.1
	7.1								23.9	5.26	4.73	24.9											Combines flows of DPP1 and DP7 in existing swale Combines flows in existing swale at DP8.2
	O1	OS-1	2.44	0.42	11.8	1.03	6.51	6.7															Sheet flows overland to existing swale to DPO1 Combines in existing swale at DP8.1
	8	EX-8	3.64	0.37	23.0	1.34	4.83	6.5															Sheet flows overland to existing swale to DP8 Combines in existing swale at DP8.1
	8.1								23.0	2.37	4.83	11.5											Combines flows of DPO1 and DP8 in existing swale Combines flows in existing swale at DP8.2
	8.2								23.9	7.63	4.73	36.1											Combines flows of DP7.1 and DP8.1 in existing swale Flows off-site onto property at 13580 Bridle Bit Road

Notes:
Street and Pipe C*A values are determined by Q/I using the catchment's intensity value.
Values in blue indicate that they are from "Cathedral Pines Subdivision Filing No. 1 Drainage Report & Plan"

PROPOSED COMPOSITE % IMPERVIOUS/C VALUE CALCULATIONS

Subdivision: Cathedral Pines
 Location: El Paso County

Project Name: Estates at Cathedral Pines
 Project No.: 25260.00
 Calculated By: GAG
 Checked By: _____
 Date: 3/25/24

Basin ID	Total Area (ac)	Paved Hardscape/Water (100% Impervious)				Gravel Hardscape (80% Impervious)				2.5 Acre Lots (10% Impervious)				Lawns/Open Space (2% Impervious)				Basin Total Weighted C		Basins Total Weighted % Imp.
		C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	Area (ac)	Weighted % Imp.	C ₅	C ₁₀₀	
A	0.84	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	0.84	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
B	2.36	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	2.36	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
C	2.06	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	2.06	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
D	4.49	0.90	0.96	0.46	10.2%	0.59	0.70	0.07	1.2%	0.16	0.41	2.32	5.2%	0.09	0.36	1.64	0.7%	0.22	0.45	17.4%
E	0.65	0.90	0.96	0.24	36.9%	0.59	0.70	0.03	3.7%	0.16	0.41	0.38	5.8%	0.09	0.36	0.00	0.0%	0.45	0.63	46.5%
F	0.31	0.90	0.96	0.02	6.5%	0.59	0.70	0.04	10.3%	0.16	0.41	0.25	8.1%	0.09	0.36	0.00	0.0%	0.26	0.48	24.8%
G	9.03	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	9.03	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
J	0.82	0.90	0.96	0.04	4.9%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	0.78	1.9%	0.13	0.39	6.8%
K	3.48	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	3.48	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
L	2.58	0.90	0.96	0.44	17.1%	0.59	0.70	0.04	1.2%	0.16	0.41	2.10	8.1%	0.09	0.36	0.00	0.0%	0.29	0.51	26.4%
M	0.45	0.90	0.96	0.19	42.2%	0.59	0.70	0.03	5.3%	0.16	0.41	0.23	5.1%	0.09	0.36	0.00	0.0%	0.50	0.66	52.7%
N	0.75	0.90	0.96	0.01	1.3%	0.59	0.70	0.07	7.5%	0.16	0.41	0.23	3.1%	0.09	0.36	0.44	1.2%	0.17	0.42	13.0%
O	4.83	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	4.83	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
P	3.51	0.90	0.96	0.00	0.0%	0.59	0.70	0.00	0.0%	0.16	0.41	3.51	10.0%	0.09	0.36	0.00	0.0%	0.16	0.41	10.0%
OS-1	0.13	0.90	0.96	0.05	37.6%	0.59	0.70	0.00	0.0%	0.16	0.41	0.00	0.0%	0.09	0.36	0.08	1.2%	0.39	0.59	38.9%
OS-2	2.44	0.90	0.96	0.05	2.0%	0.59	0.70	0.00	0.0%	0.16	0.41	2.39	9.8%	0.09	0.36	0.00	0.0%	0.17	0.42	11.8%
TOTAL POND A	5.45																			21.3%
TOTAL POND B	3.78																			26.9%

PROPOSED STANDARD FORM SF-2
TIME OF CONCENTRATION

Subdivision: Cathedral Pines
Location: El Paso County

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/25/24

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					tc CHECK			FINAL
DATA						(T _i)			(T _t)					(URBANIZED BASINS)			
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C ₅	C ₁₀₀	L (ft)	S _o (%)	t _i (min)	L _t (ft)	S _t (%)	K	VEL. (ft/s)	t _t (min)	COMP. t _c (min)	TOTAL LENGTH (ft)	Urbanized t _c (min)	
A	0.84	B	10%	0.16	0.41	300	5.0%	17.3	80	5.0%	7.0	1.6	0.9	18.1	380.0	24.9	18.1
B	2.36	B	10%	0.16	0.41	300	5.5%	16.7	500	5.5%	7.0	1.6	5.1	21.8	800.0	27.7	21.8
C	2.06	B	10%	0.16	0.41	200	5.7%	13.5	680	4.2%	7.0	1.4	7.9	21.4	880.0	29.6	21.4
D	4.49	B	17%	0.22	0.45	190	4.5%	13.4	590	3.5%	7.0	1.3	7.5	20.9	780.0	27.6	20.9
E	0.65	B	46%	0.45	0.63	26	2.0%	4.7	605	3.8%	7.0	1.4	7.4	12.1	631.0	21.4	12.1
F	0.31	B	25%	0.26	0.48	50	15.0%	4.4	70	0.5%	7.0	0.5	2.4	6.7	120.0	23.1	6.7
G	9.03	B	10%	0.16	0.41	100	3.0%	11.8	800	6.0%	7.0	1.7	7.8	19.6	900.0	29.5	19.6
J	0.82	B	7%	0.13	0.39	100	8.4%	8.7	180	6.0%	7.0	1.7	1.7	10.4	280.0	26.1	10.4
K	3.48	B	10%	0.16	0.41	150	10.0%	9.7	750	4.5%	7.0	1.5	8.4	18.1	900.0	30.0	18.1
L	2.58	B	26%	0.29	0.51	26	2.0%	5.9	800	3.8%	7.0	1.4	9.8	15.7	826.0	26.9	15.7
M	0.45	B	53%	0.50	0.66	26	2.0%	4.4	470	3.8%	7.0	1.4	5.7	10.1	496.0	19.5	10.1
N	0.75	B	13%	0.17	0.42	55	27.0%	4.2	90	0.8%	7.0	0.6	2.5	6.7	145.0	25.4	6.7
O	4.83	B	10%	0.16	0.41	235	11.9%	11.5	645	4.8%	7.0	1.5	7.0	18.5	880.0	29.0	18.5
P	3.51	B	10%	0.16	0.41	150	6.0%	11.5	1180	5.0%	7.0	1.6	12.6	24.1	1330.0	32.8	24.1
OS-1	0.13	B	39%	0.39	0.59	12	2.0%	3.5	20	14.0%	7.0	2.6	0.1	3.6	32.0	19.5	5.0
OS-2	2.44	B	12%	0.17	0.42	185	6.9%	12.0	0	0.0%	7.0	0.0	0.0	12.0	185.0	24.0	12.0

PROPOSED STANDARD FORM SF-2 TIME OF CONCENTRATION

Subdivision: Cathedral Pines _____
 Location: El Paso County _____

Project Name: Estates at Cathedral Pines _____
 Project No.: 25260.00 _____
 Calculated By: GAG _____
 Checked By: _____
 Date: 3/25/24 _____

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME				t _c CHECK			FINAL	
DATA						(T _i)			(T _t)				(URBANIZED BASINS)				
BASIN ID	D.A. (ac)	Hydrologic Soils Group	Impervious (%)	C ₅	C ₁₀₀	L (ft)	S _o (%)	t _i (min)	L _t (ft)	S _t (%)	K	VEL. (ft/s)	t _t (min)	COMP. t _c (min)	TOTAL LENGTH (ft)	Urbanized t _c (min)	t _c (min)

$$t_c = t_i + t_t$$

Equation 6-2

$$t_i = \frac{0.395(1.1 - C_5)\sqrt{L_i}}{S_o^{0.33}}$$

Equation 6-3

Where:

t_c = computed time of concentration (minutes)

t_i = overland (initial) flow time (minutes)

t_t = channelized flow time (minutes).

$$t_t = \frac{L_t}{60K\sqrt{S_o}} = \frac{L_t}{60V_t}$$

Where:

t_t = channelized flow time (travel time, min)
 L_t = waterway length (ft)
 S_o = waterway slope (ft/ft)
 V_t = travel time velocity (ft/sec) = K√S_o
 K = NRCS conveyance factor (see Table 6-2).

Where:

t_i = overland (initial) flow time (minutes)
 C₅ = runoff coefficient for 5-year frequency (from Table 6-4)
 L_i = length of overland flow (ft)
 S_o = average slope along the overland flow path (ft/ft).

Equation 6-4

$$t_i = (26 - 17i) + \frac{L_i}{60(14i + 9)\sqrt{S_o}}$$

Equation 6-5

Where:

t_c = minimum time of concentration for first design point when less than t_c from Equation 6-1.
 L_t = length of channelized flow path (ft)
 i = imperviousness (expressed as a decimal)
 S_o = slope of the channelized flow path (ft/ft).

Use a minimum t_c value of 5 minutes for urbanized areas and a minimum t_c value of 10 minutes for areas that are not considered urban. Use minimum values even when calculations result in a lesser time of concentration.

Table 6-2. NRCS Conveyance factors, K

Type of Land Surface	Conveyance Factor, K
Heavy meadow	2.5
Tillage/field	5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

PROPOSED STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 5-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By: _____
Date: 3/25/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	t _c (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (Inches)	Length (ft)	Velocity (fps)	t _t (min)	
	1	A	0.84	0.16	18.1	0.13	3.24	0.4															Sheet flows overland to DP1 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Tract 1
	2	B	2.36	0.16	21.8	0.38	2.96	1.1															Sheet flows overland to DP2 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Lot 30
	3	C	2.06	0.16	21.4	0.33	2.99	1.0															Sheet flows overland to existing swale to DP3 Flows off-site onto property at 13855 Highway 83
	4	D	4.49	0.22	20.9	0.97	3.02	2.9															Sheet flows overland to proposed swale to DP4 Combines with DP5 at DP5.1
	5	E	0.65	0.45	12.1	0.29	3.84	1.1															Flows to proposed swale to DP5 Combines with DP4 at DP5.1
	5.1								20.9	1.26	3.02	3.8											Combines flows of DP4 and DP5 Piped to North Pond forebay and combines at DP6.1
	6	F	0.31	0.26	6.7	0.08	4.72	0.4															Sheet flows overland to DP6 Combines with DP5.1 at DP6.1
	6.1								20.9	1.34	3.02	4.1											Combines flows of DP5.1 and DP6 North Pond flows, released through outlet at DP6.2
	6.2								-	0.38	-	1.2											North Pond outlet structure controlled release Combines with DP7 at DP7.1
	7	G	9.03	0.16	19.6	1.44	3.12	4.5															Sheet flows overland to proposed swale to DP7 Combines flow at DP7.1
	7.1								19.6	1.82	3.12	5.7											Combines flow of DP6.2 and DP7 in existing swale Flows off-site onto property at 13580 Bridle Bit Road
	10	J	0.82	0.13	10.4	0.11	4.07	0.4											660	2.5	4.4		Flows in existing swale to proposed culvert at DP10 Flows onto Basin K and combines at DP11.1
	11	K	3.48	0.16	18.1	0.56	3.24	1.8															Flows in existing swale to DP11 Combines flow at DP11.1
	11.1								18.1	0.67	3.24	2.2											Combines flows of DP10 and DP11 Flows off-site onto property at 13580 Bridle Bit Road

PROPOSED STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 5-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By: _____
Date: 3/25/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	t _c (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (Inches)	Length (ft)	Velocity (fps)	t _t (min)	
	P1	-	15.50	-	-	1.07	-	3.7															Released flows from off-site pond via 18" RCP culvert Enters Basin L and combines at DP13.1
	12	L	2.58	0.29	15.7	0.76	3.45	2.6															Sheet flows overland to proposed swale to DP12 Combines with DPP1 at DP12.1
	12.1								15.7	1.83	3.45	6.3											Combines flows of DPP1 and DP12 Continues in proposed swale to DP13.1
	13	M	0.45	0.50	10.1	0.23	4.11	0.9															Flows to proposed swale to DP13 Combines with DP12.1 at DP13.1
	13.1								15.7	2.06	3.45	7.1											Combines flows of DP12.1 and DP13 Piped to South Pond forebay and combines at DP14.1
	14	N	0.75	0.17	6.7	0.13	4.74	0.6															Sheet flows overland to DP14 Combines with DP13.1 at DP14.1
	14.1								15.7	2.19	3.45	7.6											Combines flows of DP13.1 and DP14 South Pond flows, released through outlet at DP14.2
	14.2								-	0.19	-	0.6											South Pond outlet structure controlled release Combines with DP15 at DP15.1
	15	O	4.83	0.16	18.5	0.77	3.21	2.5															Sheet flows overland to existing swale to DP15 Combines flow at DP15.1
	15.1								18.5	0.96	3.21	3.1											Combines flow of DP14.2 and DP15 Combines flow in existing swale at DP16.2

PROPOSED STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 5-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By: _____
Date: 3/25/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	t _c (min)	C*A (Ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (Inches)	Length (ft)	Velocity (fps)	t _t (min)	
	O1	OS-1	0.13	0.39	5.0	0.05	5.17	0.3															Sheet flows overland to DPO1 Enters Basin P and combines at DP16.1
	O2	OS-2	2.44	0.17	12.0	0.43	3.85	1.7															Sheet flows overland to DPO2 Enters Basin P and combines at DP16.1
	16	P	3.51	0.16	24.1	0.56	2.81	1.6															Sheet flows overland to existing swale to DP16 Combines flow at DP16.1
	16.1								24.1	1.04	2.81	2.9											Combines flow of DPO1, DPO2, and DP16 Combines flow in existing swale at DP16.2
	16.2								24.1	2.00	2.81	5.6											Combines flow of DP15.1 and DP16.1 Flows off-site onto property at 13580 Bridle Bit Road

Notes:
Street and Pipe C*A values are determined by Q/i using the catchment's intensity value.
Values in blue indicate that they are from "Cathedral Pines Subdivision Filing No. 1 Drainage Report & Plan"

PROPOSED STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 100-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/25/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	1	A	0.84	0.41	18.1	0.34	5.43	1.8															Sheet flows overland to DP1 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Tract 1
	2	B	2.36	0.41	21.8	0.97	4.97	4.8															Sheet flows overland to DP2 Flows off-site onto Cathedral Pines Sub. Filing No. 1 Lot 30
	3	C	2.06	0.41	21.4	0.84	5.01	4.2															Sheet flows overland to existing swale to DP3 Flows off-site onto property at 13855 Highway 83
	4	D	4.49	0.45	20.9	2.03	5.08	10.3															Sheet flows overland to proposed swale to DP4 Combines with DP5 at DP5.1
	5	E	0.65	0.63	12.1	0.41	6.45	2.6															Flows to proposed swale to DP5 Combines with DP4 at DP5.1
	5.1								20.9	2.44	5.08	12.4											Combines flows of DP4 and DP5 Piped to North Pond forebay and combines at DP6.1
	6	F	0.31	0.48	6.7	0.15	7.93	1.2															Sheet flows overland to DP6 Combines with DP5.1 at DP6.1
	6.1								20.9	2.59	5.08	13.1											Combines flows of DP5.1 and DP6 North Pond flows, released through outlet at DP6.2
	6.2								-	1.03	-	5.4											North Pond outlet structure controlled release Combines with DP7 at DP7.1
	7	G	9.03	0.41	19.6	3.70	5.24	19.4															Sheet flows overland to proposed swale to DP7 Combines flow at DP7.1
	7.1								19.6	4.73	5.24	24.8											Combines flow of DP6.2 and DP7 in existing swale Flows off-site onto property at 13580 Bridle Bit Road
	10	J	0.82	0.39	10.4	0.32	6.83	2.2												660	3.5	3.1	Flows in existing swale to proposed culvert at DP10 Flows onto Basin K and combines at DP11.1
	11	K	3.48	0.41	18.1	1.43	5.43	7.8															Flows in existing swale to DP11 Combines flow at DP11.1
	11.1								18.1	1.75	5.43	9.5											Combines flows of DP10 and DP11 Flows off-site onto property at 13580 Bridle Bit Road

PROPOSED STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 100-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/25/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	P1	-	15.50	-	-	1.88	-	10.9															Released flows from off-site pond via 18" RCP culvert Enters Basin L and combines at DP13.1
	12	L	2.58	0.51	15.7	1.31	5.80	7.6															Sheet flows overland to proposed swale to DP12 Combines with DPP1 at DP12.1
	12.1								15.7	3.19	5.80	18.5											Combines flows of DPP1 and DP12 Continues in proposed swale to DP13.1
	13	M	0.45	0.66	10.1	0.30	6.90	2.1															Flows to proposed swale to DP13 Combines with DP12.1 at DP13.1
	13.1								15.7	3.49	5.80	20.2											Combines flows of DP12.1 and DP13 Piped to South Pond forebay and combines at DP14.1
	14	N	0.75	0.42	6.7	0.31	7.95	2.5															Sheet flows overland to DP14 Combines with DP13.1 at DP14.1
	14.1								15.7	3.80	5.80	22.0											Combines flows of DP13.1 and DP14 South Pond flows, released through outlet at DP14.2
	14.2								-	0.80	-	4.3											South Pond outlet structure controlled release Combines with DP15 at DP15.1
	15	O	4.83	0.41	18.5	1.98	5.38	10.7															Sheet flows overland to existing swale to DP15 Combines flow at DP15.1
	15.1								18.5	2.78	5.38	15.0											Combines flow of DP14.2 and DP15 Combines flow in existing swale at DP16.2

PROPOSED STANDARD FORM SF-3
STORM DRAINAGE SYSTEM DESIGN
(RATIONAL METHOD PROCEDURE)

Subdivision: Cathedral Pines
Location: El Paso County
Design Storm: 100-Year

Project Name: Estates at Cathedral Pines
Project No.: 25260.00
Calculated By: GAG
Checked By:
Date: 3/25/24

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET			PIPE				TRAVEL TIME			REMARKS
		Basin ID	Area (ac)	Runoff Coeff.	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	t _c (min)	C*A (ac)	I (in/hr)	Q (cfs)	Q _{street} (cfs)	C*A (ac)	Slope (%)	Q _{pipe} (cfs)	C*A (ac)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	t _t (min)	
	01	OS-1	0.13	0.59	5.0	0.08	8.68	0.7															Sheet flows overland to DPO1 Enters Basin P and combines at DP16.1
	02	OS-2	2.44	0.42	12.0	1.03	6.47	6.7															Sheet flows overland to DPO2 Enters Basin P and combines at DP16.1
	16	P	3.51	0.41	24.1	1.44	4.72	6.8															Sheet flows overland to existing swale to DP16 Combines flow at DP16.1
	16.1								24.1	2.55	4.72	12.0											Combines flow of DPO1, DP02, and DP16 Combines flow in existing swale at DP16.2
	16.2								24.1	5.33	4.72	25.1											Combines flow of DP15.1 and DP16.1 Flows off-site onto property at 13580 Bridle Bit Road

Notes:
Street and Pipe C*A values are determined by Q/I using the catchment's intensity value.
Values in blue indicate that they are from "Cathedral Pines Subdivision Filing No. 1 Drainage Report & Plan"

APPENDIX C
HYDRAULIC CALCULATIONS

Channel Report

Basin C Existing Swale

User-defined

Invert Elev (ft) = 7311.50
Slope (%) = 6.00
N-Value = 0.030

Calculations


Compute by: Known Q
Known Q (cfs) = 4.50

Highlighted

Depth (ft) = 0.23
Q (cfs) = 4.500
Area (sqft) = 1.51
Velocity (ft/s) = 2.98
Wetted Perim (ft) = 10.92
Crit Depth, Yc (ft) = 0.28
Top Width (ft) = 10.91
EGL (ft) = 0.37

(Sta, El, n)-(Sta, El, n)...

(0.00, 7312.60)-(21.25, 7311.50, 0.030)-(24.31, 7311.53, 0.030)-(50.00, 7313.04, 0.030)

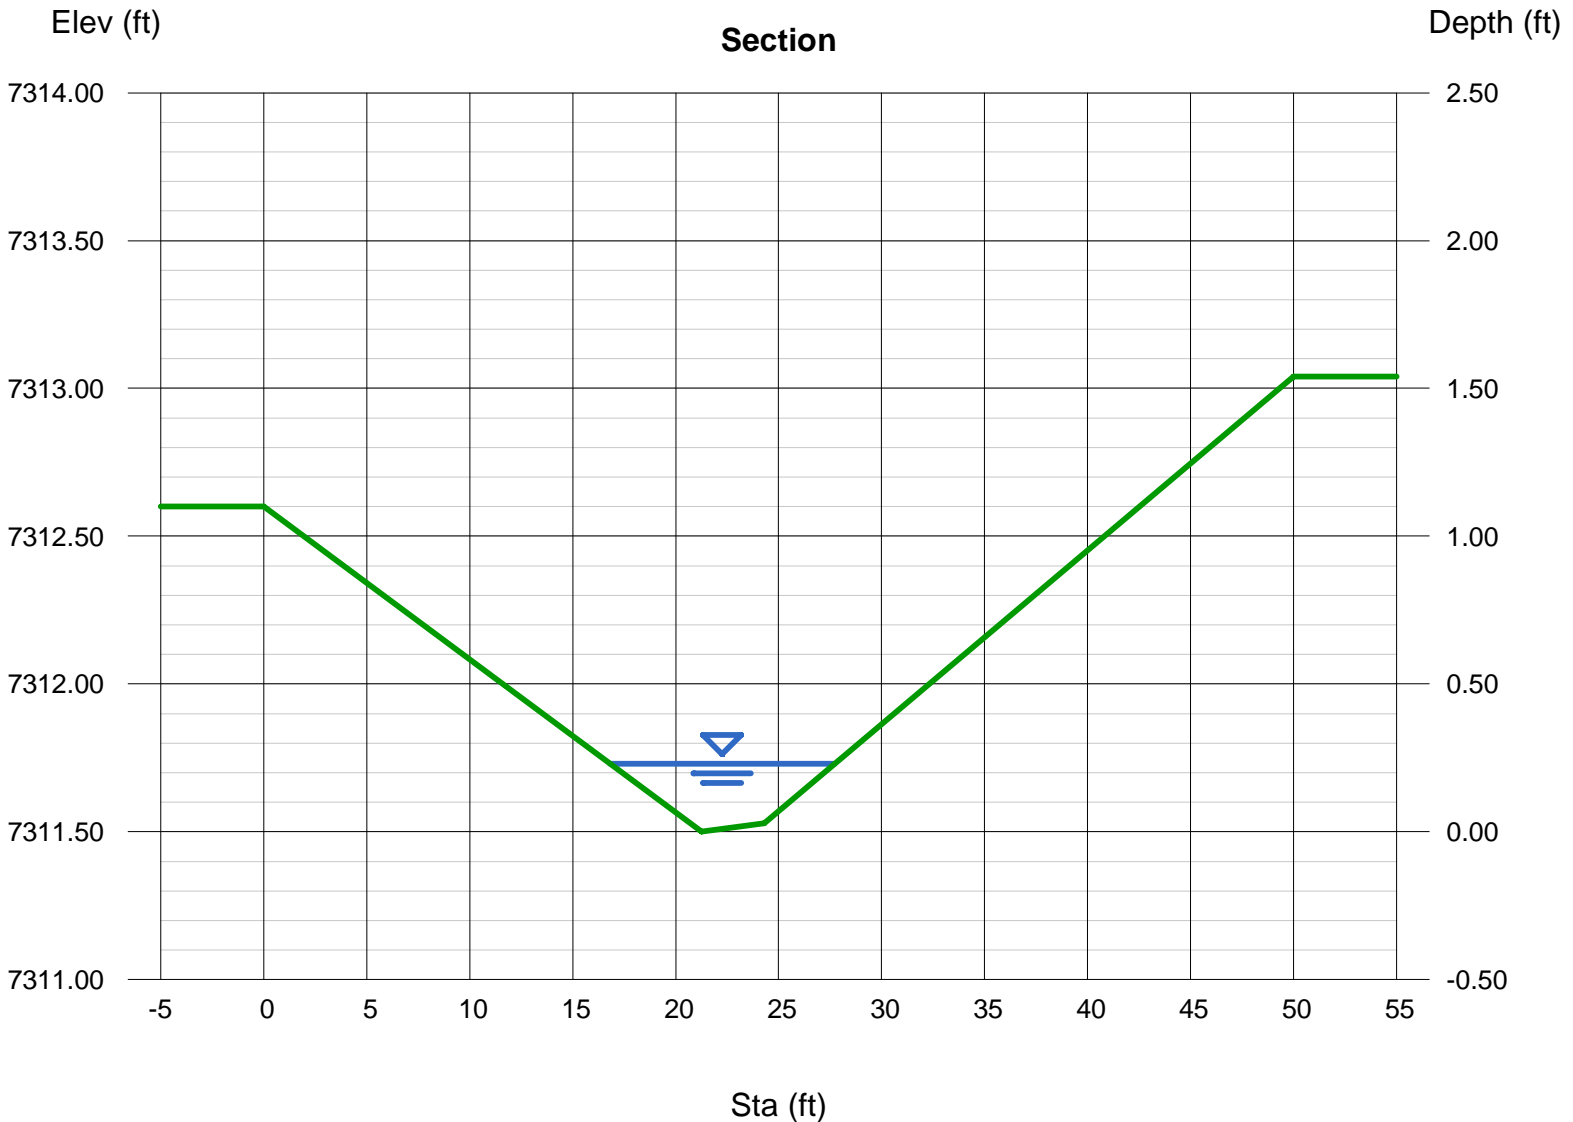

Channel Report

Basin D Roadside Swale-Capacity

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 2.50


Invert Elev (ft) = 100.00
Slope (%) = 1.00
N-Value = 0.030

Calculations

Compute by: Known Q
Known Q (cfs) = 10.50

Highlighted

Depth (ft) = 1.00
Q (cfs) = 10.50
Area (sqft) = 3.50
Velocity (ft/s) = 3.00
Wetted Perim (ft) = 7.29
Crit Depth, Yc (ft) = 0.90
Top Width (ft) = 7.00
EGL (ft) = 1.14

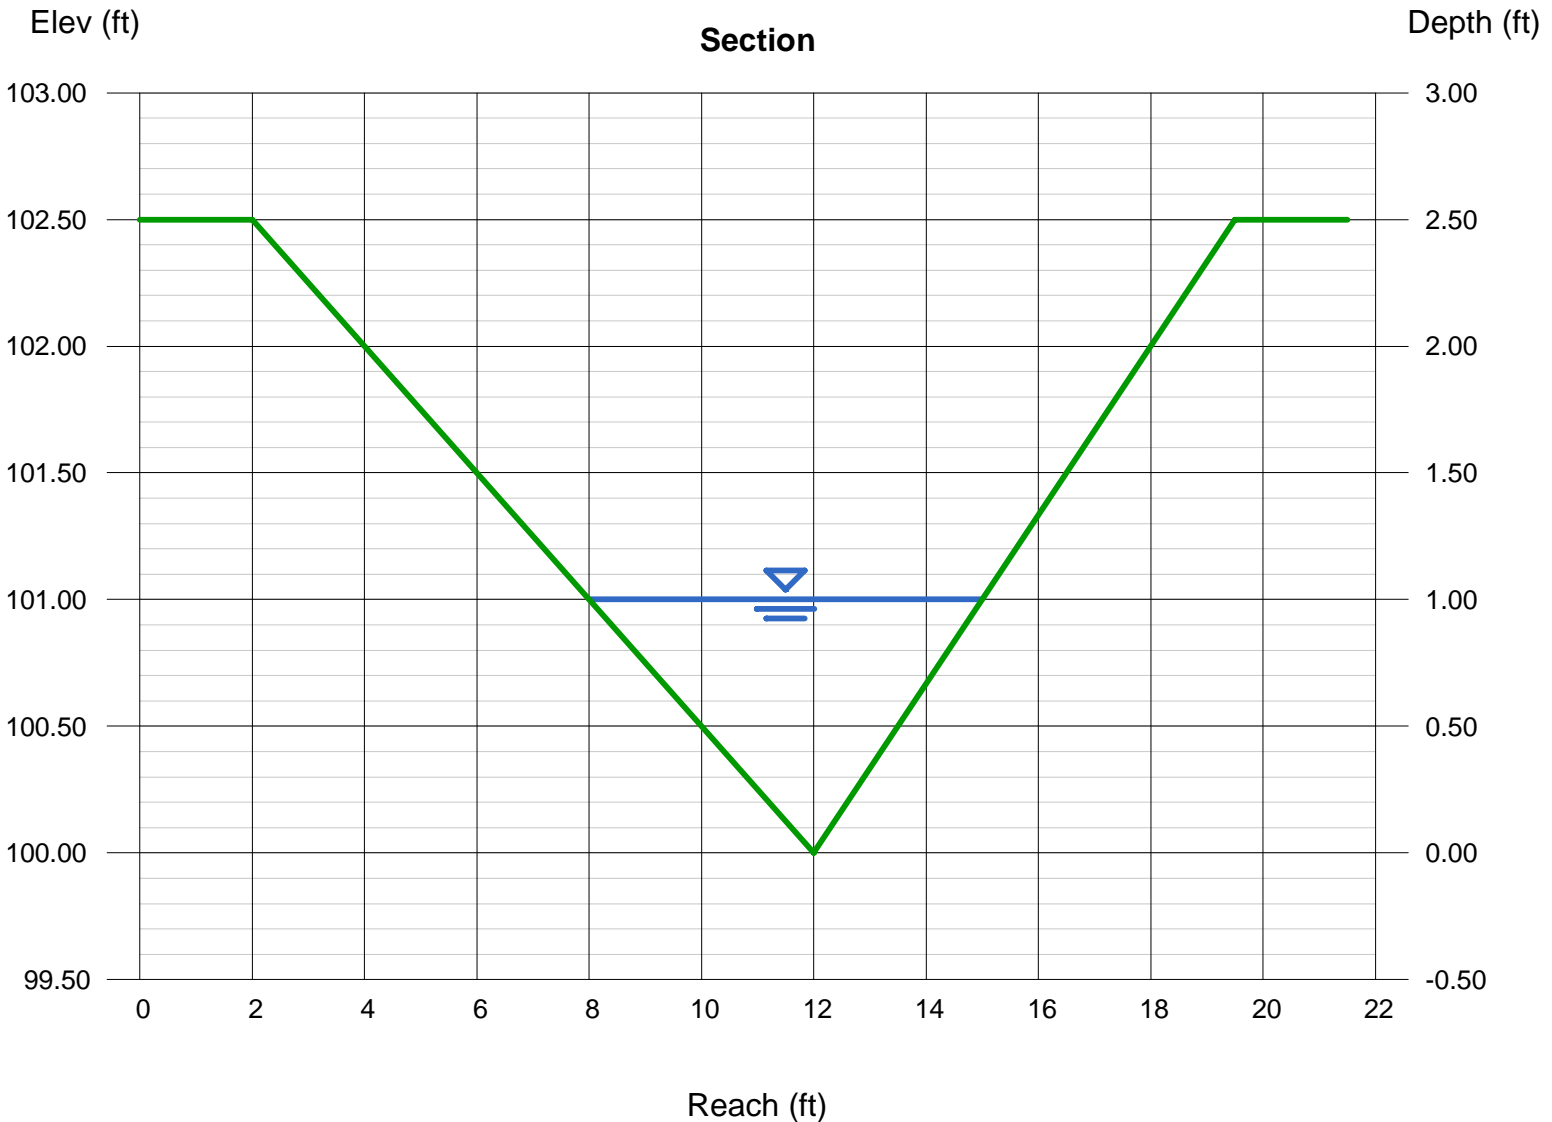

Channel Report

Basin D Roadside Swale-Velocity

Triangular

Side Slopes (z:1) = 4.00, 3.00

Total Depth (ft) = 2.50

Invert Elev (ft) = 100.00

Slope (%) = 8.00

N-Value = 0.030

Calculations

Compute by: Known Q

Known Q (cfs) = 10.50

Highlighted

Depth (ft) = 0.68

Q (cfs) = 10.50

Area (sqft) = 1.62

Velocity (ft/s) = 6.49


Wetted Perim (ft) = 4.95

Crit Depth, Yc (ft) = 0.90

Top Width (ft) = 4.76

EGL (ft) = 1.33

Slopes over 3.9% for this section will require TRM as the velocity > 5 ft/s

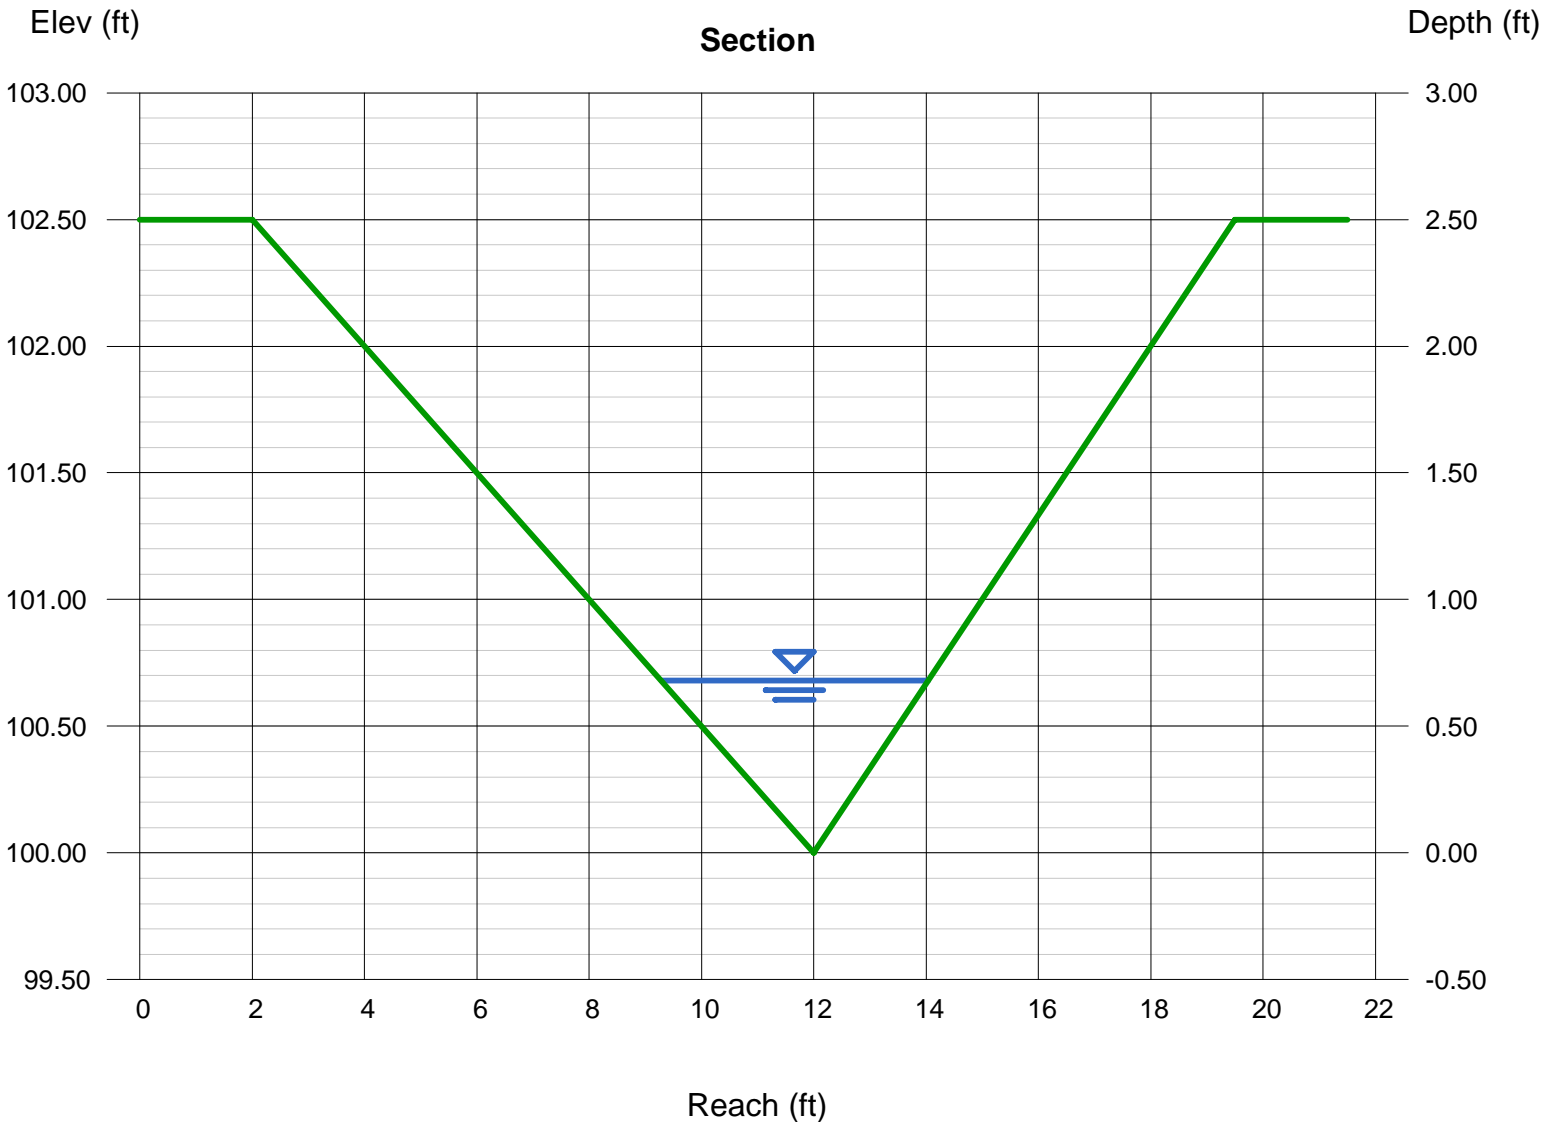

Channel Report

Basin E Roadside Swale-Capacity

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 2.50


Invert Elev (ft) = 100.00
Slope (%) = 0.50
N-Value = 0.030

Calculations

Compute by: Known Q
Known Q (cfs) = 3.00

Highlighted

Depth (ft) = 0.71
Q (cfs) = 3.000
Area (sqft) = 1.76
Velocity (ft/s) = 1.70
Wetted Perim (ft) = 5.17
Crit Depth, Yc (ft) = 0.54
Top Width (ft) = 4.97
EGL (ft) = 0.75

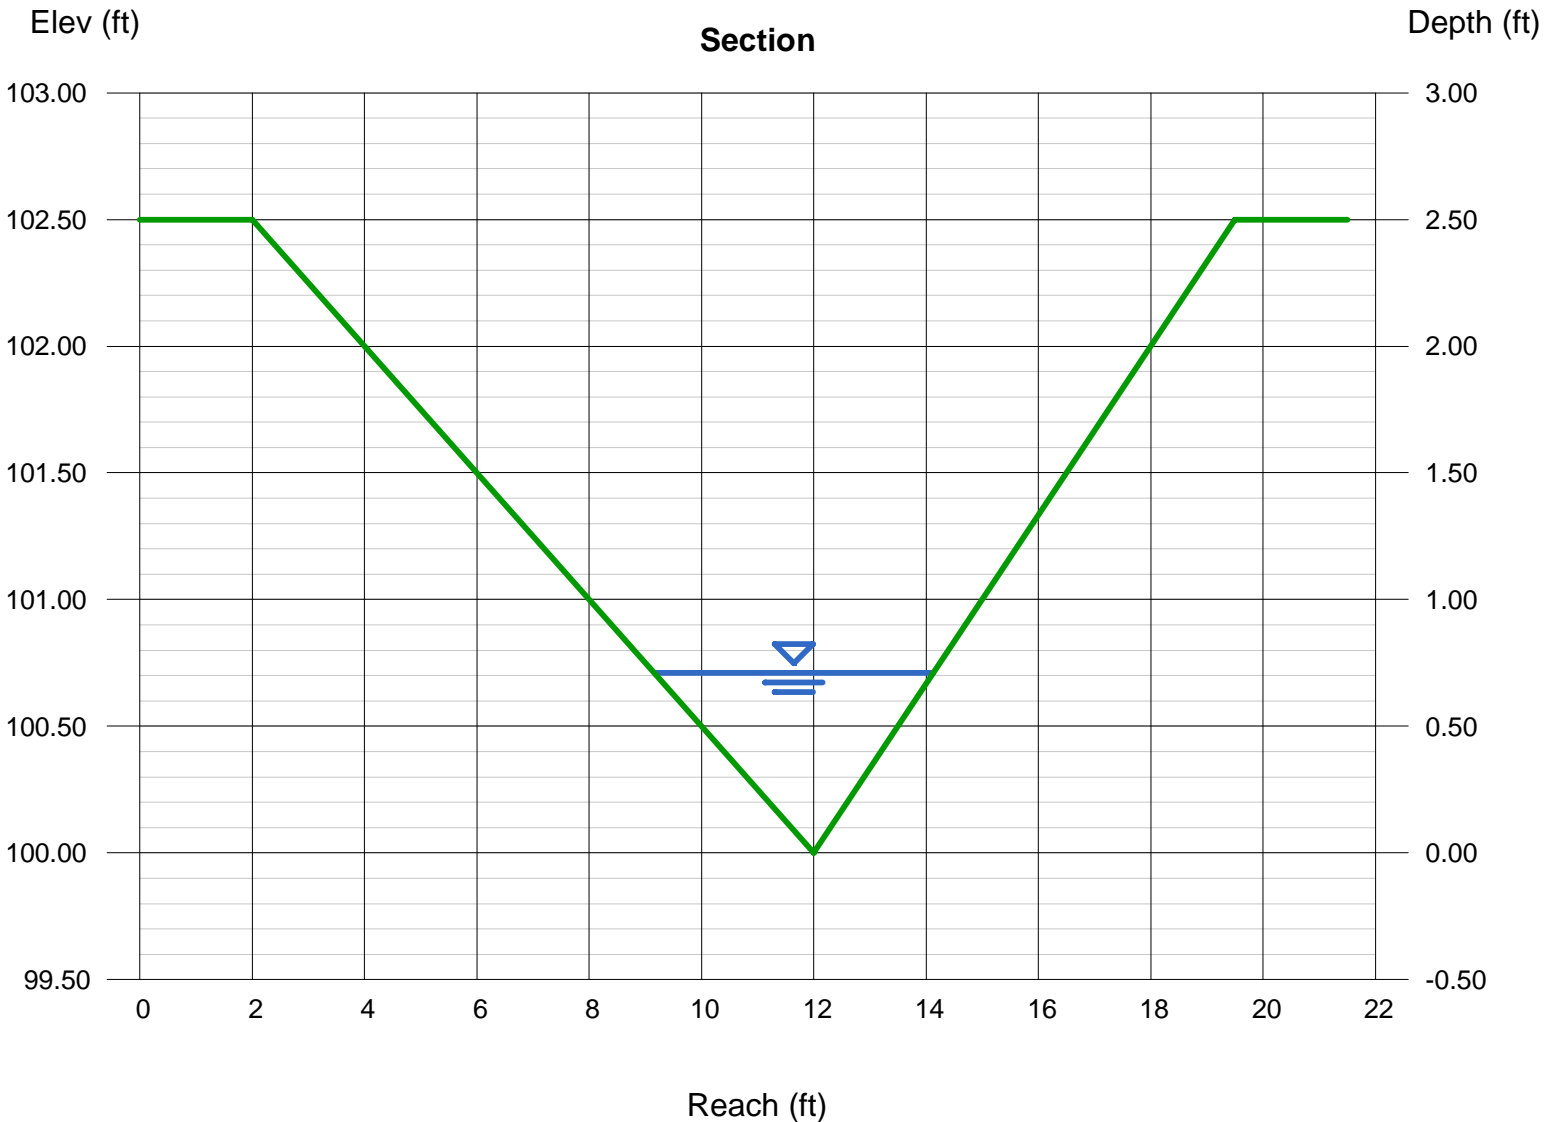

Channel Report

Basin E Roadside Swale-Velocity

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 2.50


Invert Elev (ft) = 100.00
Slope (%) = 8.00
N-Value = 0.030

Calculations

Compute by: Known Q
Known Q (cfs) = 3.00

Highlighted

Depth (ft) = 0.43
Q (cfs) = 3.000
Area (sqft) = 0.65
Velocity (ft/s) = 4.64
Wetted Perim (ft) = 3.13
Crit Depth, Yc (ft) = 0.54
Top Width (ft) = 3.01
EGL (ft) = 0.76

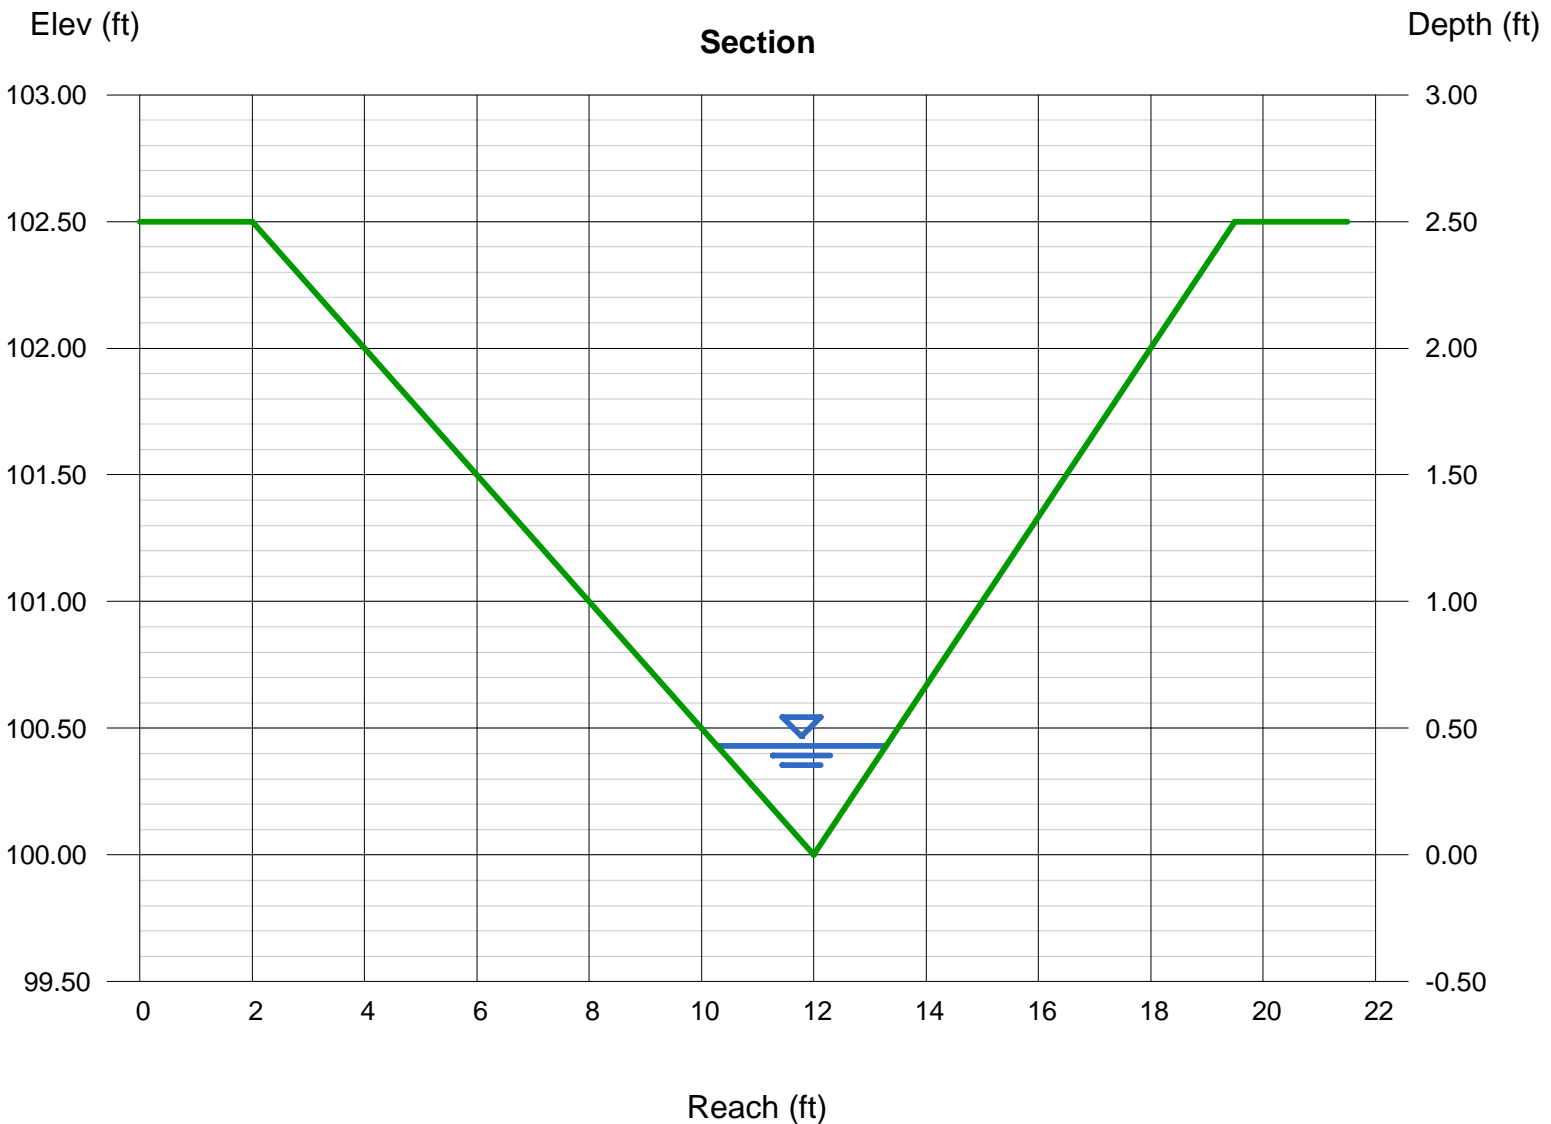

Channel Report

Pond A Outfall-Proposed Swale (Flatter)

Trapezoidal


Bottom Width (ft) = 10.00
Side Slopes (z:1) = 4.00, 4.00
Total Depth (ft) = 1.30
Invert Elev (ft) = 100.00
Slope (%) = 0.65
N-Value = 0.030

Highlighted

Depth (ft) = 0.30
Q (cfs) = 5.500
Area (sqft) = 3.36
Velocity (ft/s) = 1.64
Wetted Perim (ft) = 12.47
Crit Depth, Yc (ft) = 0.21
Top Width (ft) = 12.40
EGL (ft) = 0.34

Calculations

Compute by: Known Q
Known Q (cfs) = 5.50

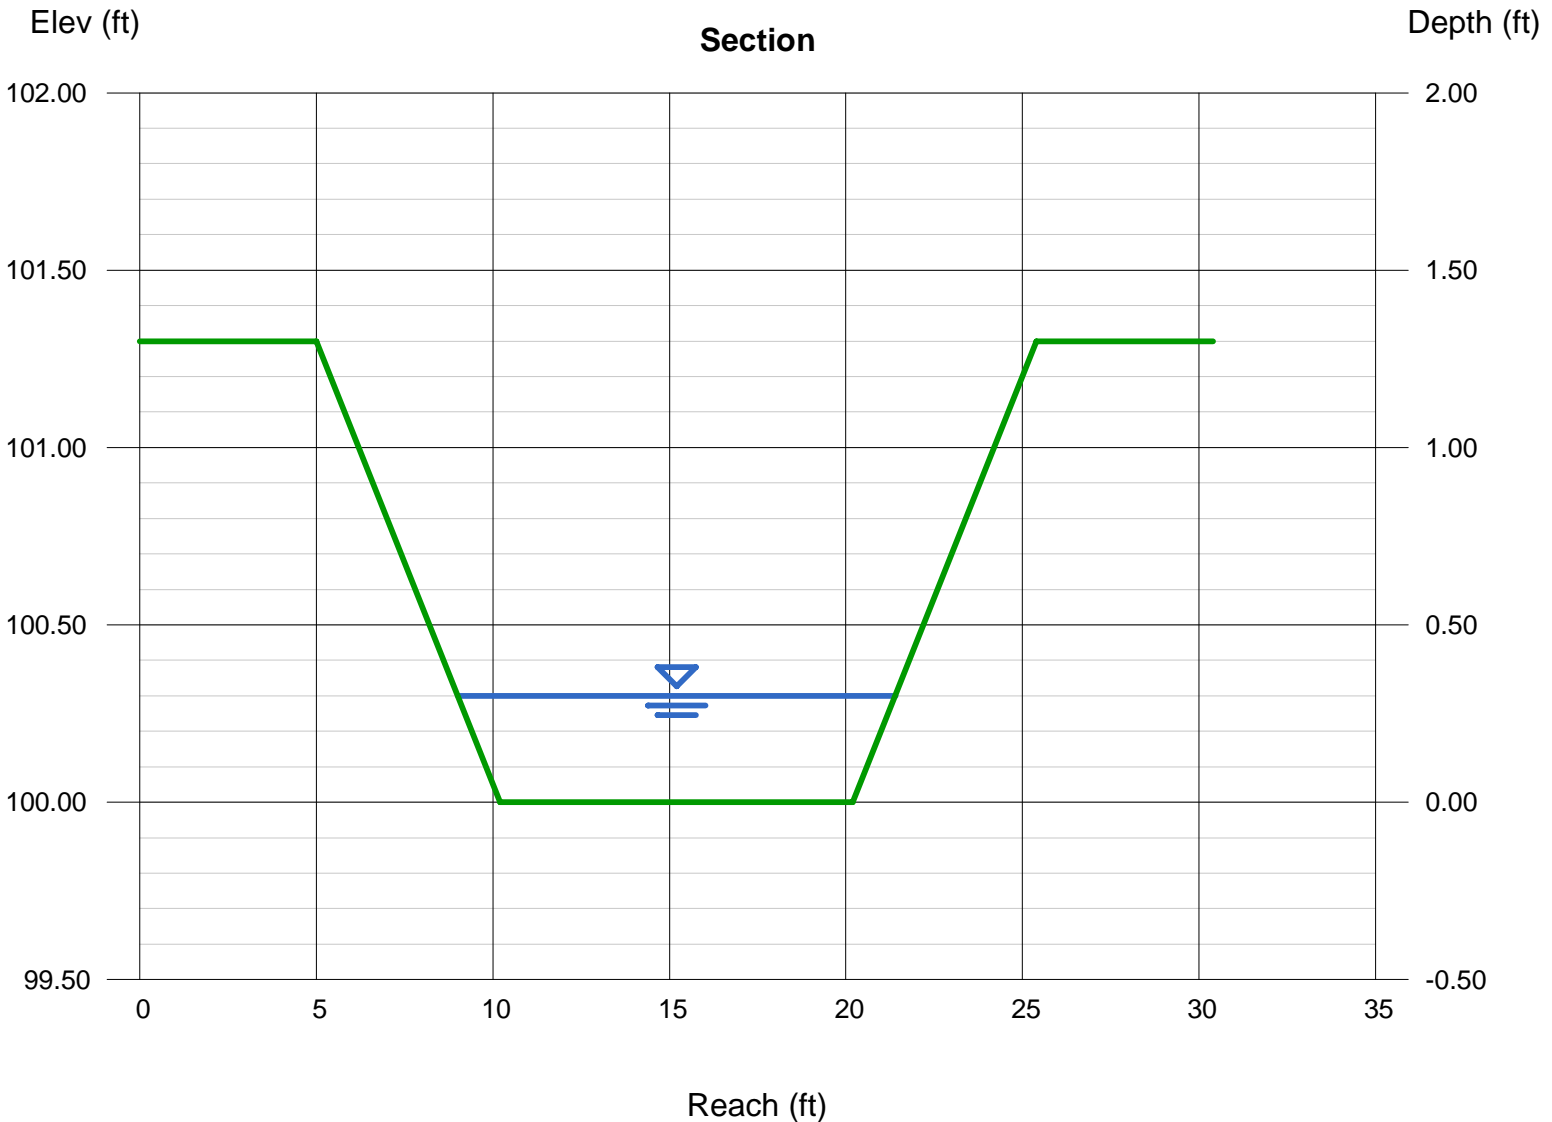

Channel Report

Pond A Outfall-Proposed Swale (Steeper)

Trapezoidal


Bottom Width (ft) = 10.00
Side Slopes (z:1) = 4.00, 4.00
Total Depth (ft) = 1.30
Invert Elev (ft) = 100.00
Slope (%) = 15.20
N-Value = 0.030

Highlighted

Depth (ft) = 0.12
Q (cfs) = 5.500
Area (sqft) = 1.26
Velocity (ft/s) = 4.37
Wetted Perim (ft) = 10.99
Crit Depth, Yc (ft) = 0.21
Top Width (ft) = 10.96
EGL (ft) = 0.42

Calculations

Compute by: Known Q
Known Q (cfs) = 5.50

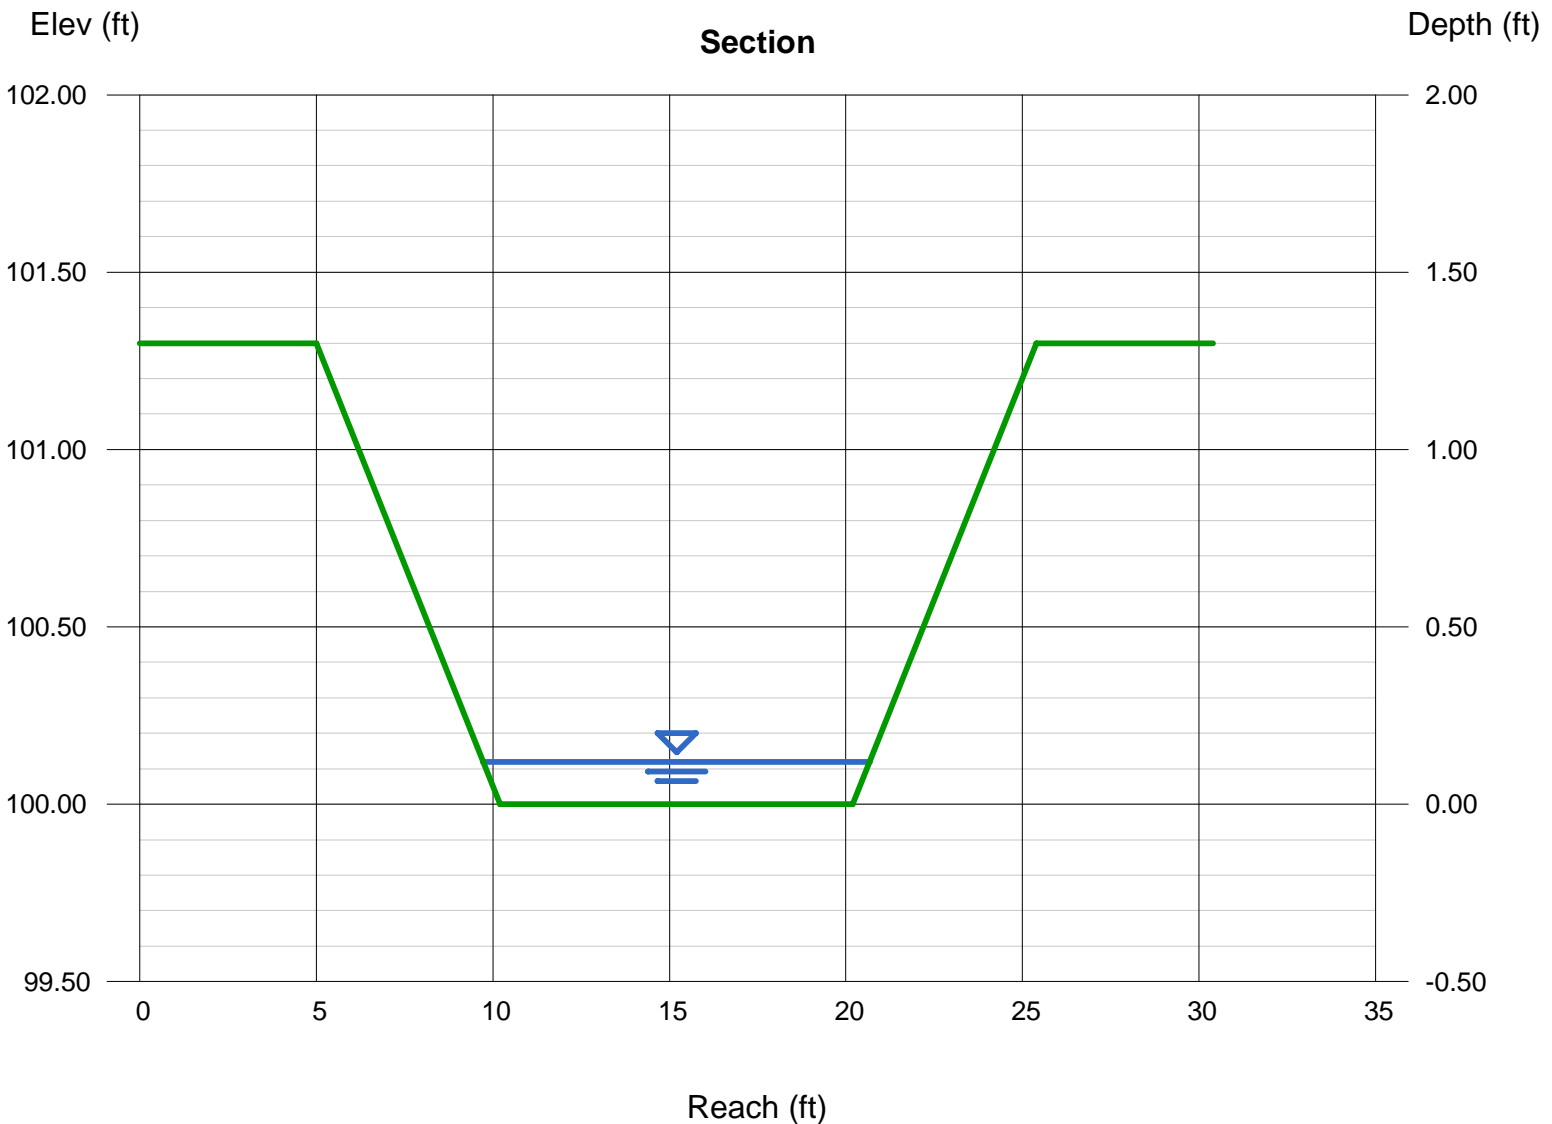

Channel Report

Ex. DP4-Existing Property Line

User-defined

Invert Elev (ft) = 7298.40
Slope (%) = 5.20
N-Value = 0.040

Calculations


Compute by: Known Q
Known Q (cfs) = 25.50

Highlighted

Depth (ft) = 0.83
Q (cfs) = 25.50
Area (sqft) = 5.54
Velocity (ft/s) = 4.60
Wetted Perim (ft) = 13.49
Crit Depth, Yc (ft) = 0.92
Top Width (ft) = 13.35
EGL (ft) = 1.16

(Sta, El, n)-(Sta, El, n)...

(0.00, 7310.91)-(26.60, 7304.00, 0.040)-(45.15, 7301.36, 0.040)-(80.56, 7298.40, 0.040)-(103.90, 7304.06, 0.040)-(125.00, 7308.00, 0.040)-(146.20, 7311.87, 0.040)

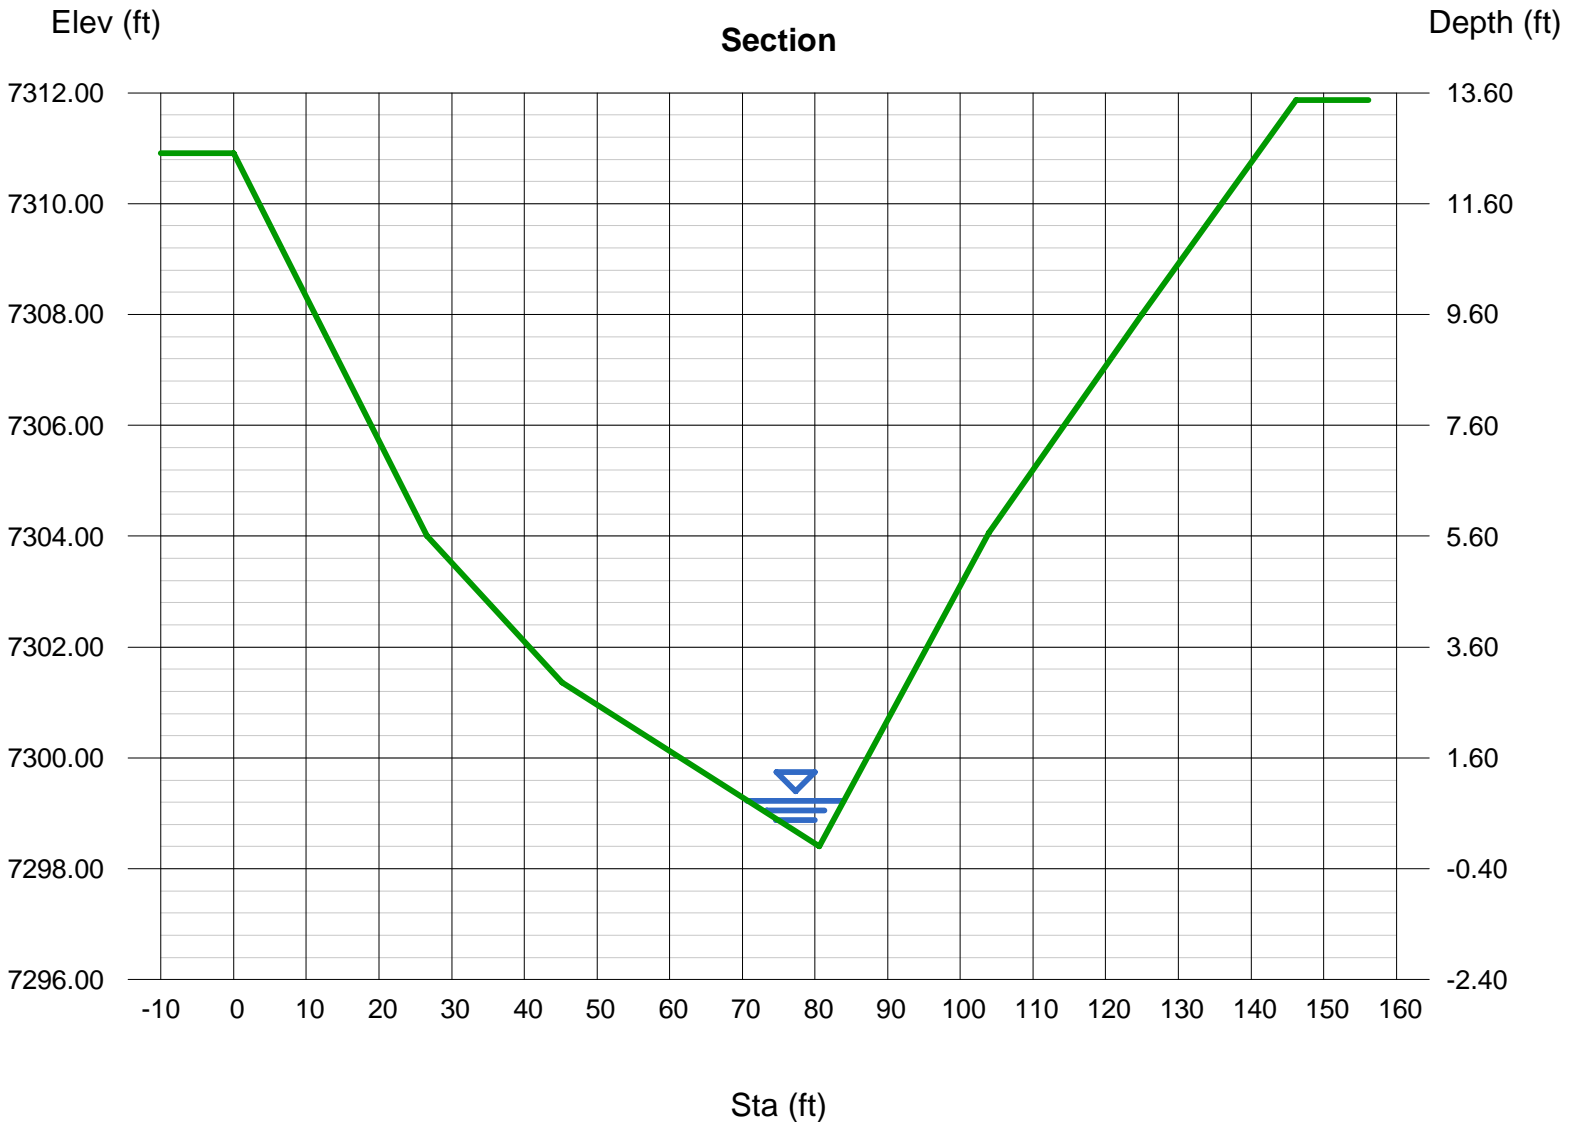

Channel Report

Basin G Existing Swale

User-defined

Invert Elev (ft) = 7306.04
Slope (%) = 8.00
N-Value = 0.040

Calculations


Compute by: Known Q
Known Q (cfs) = 19.50

Highlighted

Depth (ft) = 0.50
Q (cfs) = 19.50
Area (sqft) = 4.12
Velocity (ft/s) = 4.74
Wetted Perim (ft) = 13.49
Crit Depth, Yc (ft) = 0.61
Top Width (ft) = 13.44
EGL (ft) = 0.85

(Sta, El, n)-(Sta, El, n)...

(0.00, 7309.65) -(20.95, 7306.15, 0.040) -(25.50, 7306.04, 0.040) -(50.00, 7307.91, 0.040)

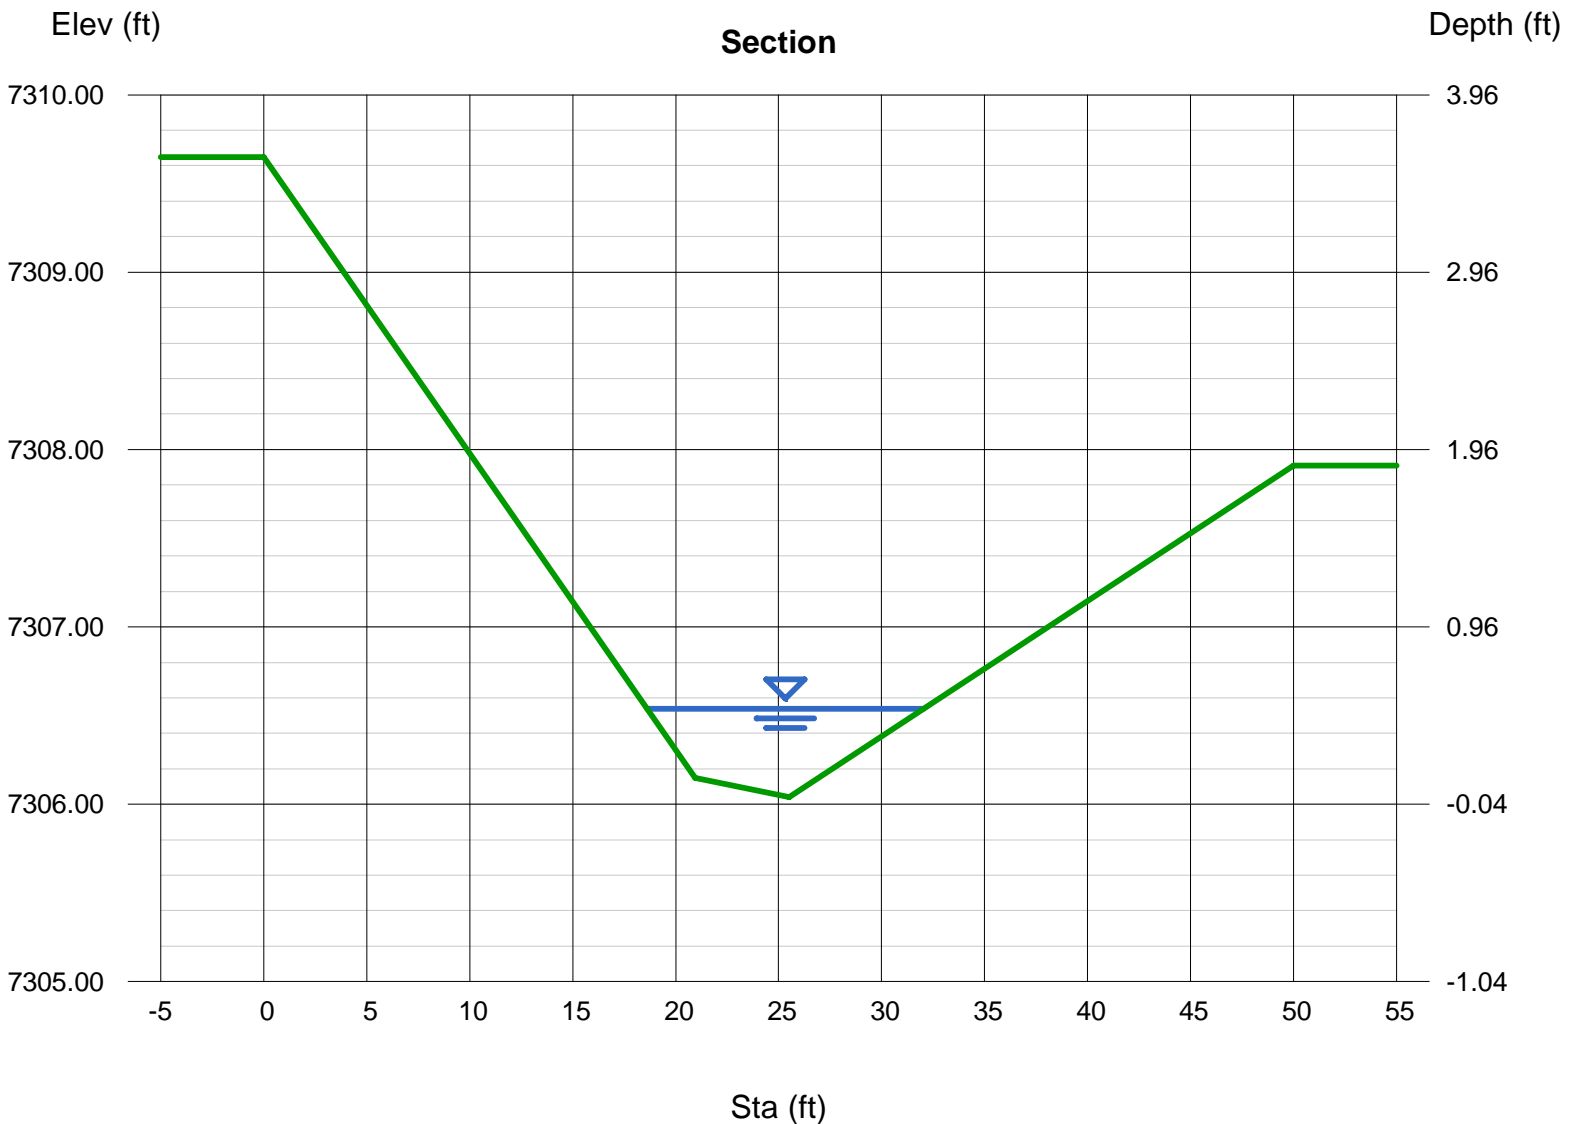

Channel Report

Prop. DP7.1-Existing Property Line

User-defined

Invert Elev (ft) = 7298.40
Slope (%) = 5.20
N-Value = 0.040

Highlighted


Depth (ft) = 0.82
Q (cfs) = 25.00
Area (sqft) = 5.41
Velocity (ft/s) = 4.62
Wetted Perim (ft) = 13.32
Crit Depth, Yc (ft) = 0.91
Top Width (ft) = 13.19
EGL (ft) = 1.15

Calculations

Compute by: Known Q
Known Q (cfs) = 25.00

(Sta, El, n)-(Sta, El, n)...

(0.00, 7310.91)-(26.60, 7304.00, 0.040)-(45.15, 7301.36, 0.040)-(80.56, 7298.40, 0.040)-(103.90, 7304.06, 0.040)-(125.00, 7308.00, 0.040)-(146.20, 7311.87, 0.040)

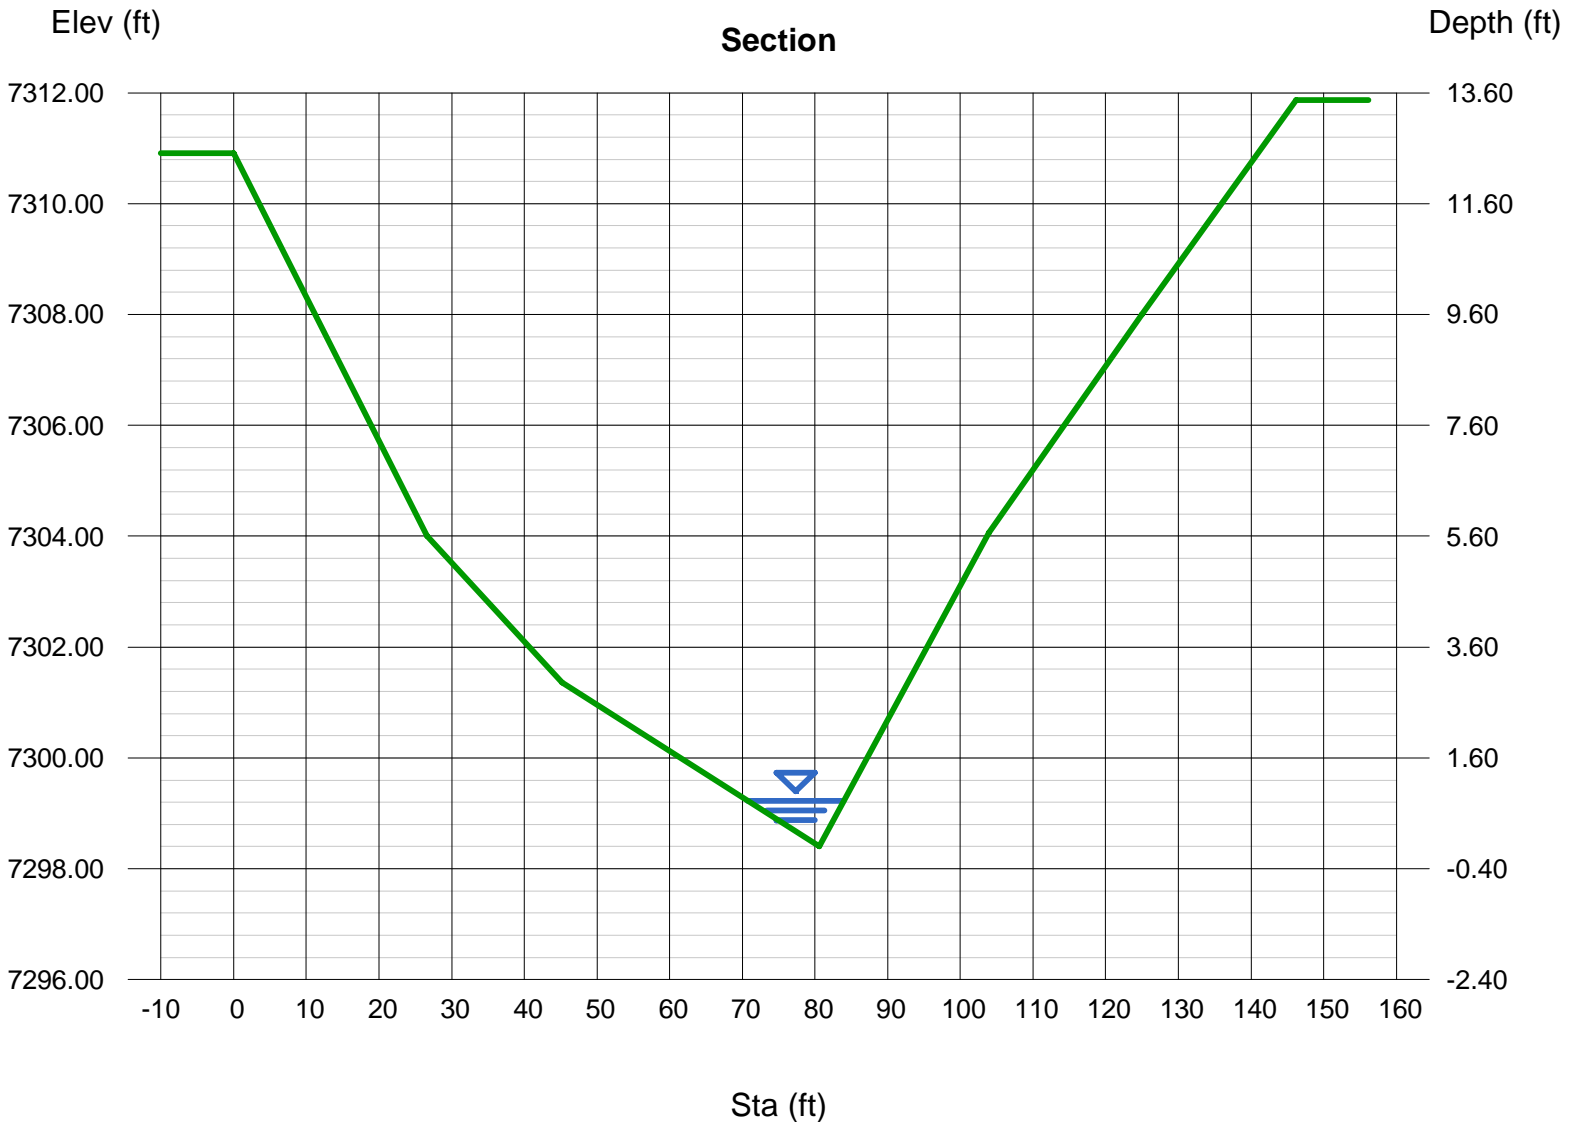

Channel Report

Basin J Existing Swale

User-defined

Invert Elev (ft) = 7350.36
Slope (%) = 7.50
N-Value = 0.030

Highlighted


Depth (ft) = 0.30
Q (cfs) = 2.500
Area (sqft) = 0.70
Velocity (ft/s) = 3.58
Wetted Perim (ft) = 4.71
Crit Depth, Yc (ft) = 0.37
Top Width (ft) = 4.66
EGL (ft) = 0.50

Calculations

Compute by: Known Q
Known Q (cfs) = 2.50

(Sta, El, n)-(Sta, El, n)...

(0.00, 7354.21)-(21.02, 7350.90, 0.030)-(26.85, 7350.36, 0.030)-(50.00, 7355.23, 0.030)

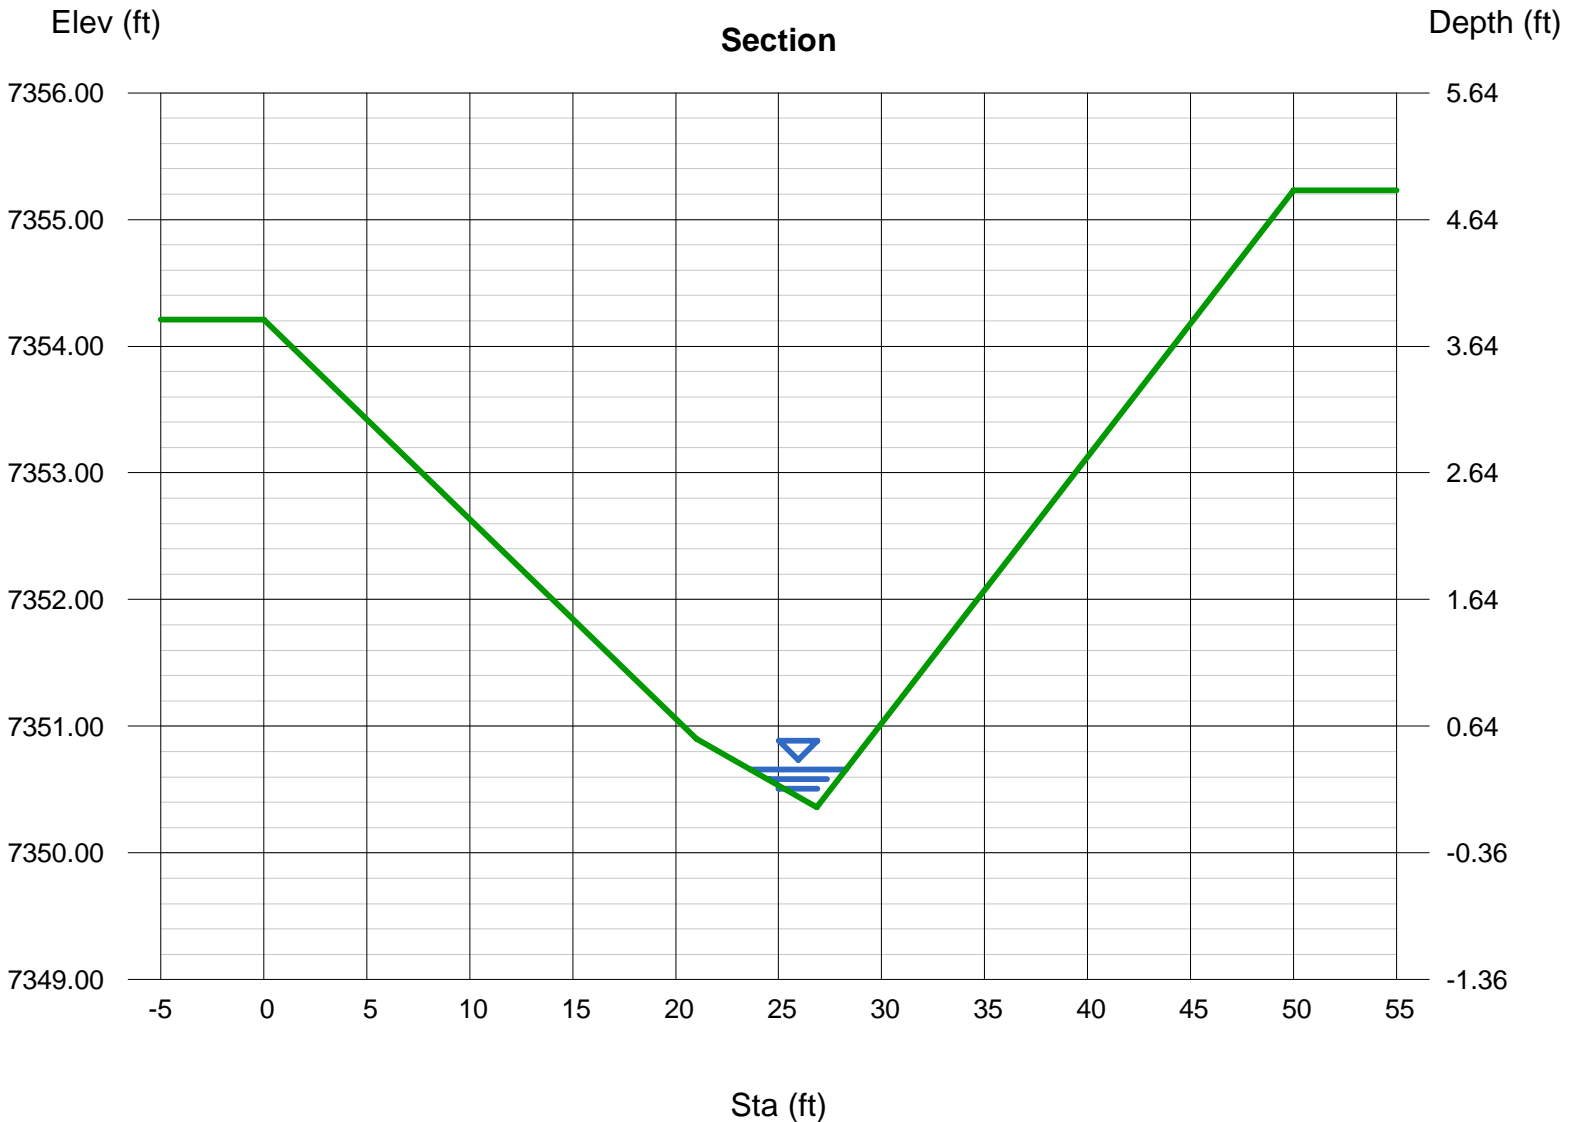

Channel Report

Basin K Existing Swale

User-defined

Invert Elev (ft) = 7305.29
Slope (%) = 6.50
N-Value = 0.030

Calculations


Compute by: Known Q
Known Q (cfs) = 9.50

Highlighted

Depth (ft) = 0.17
Q (cfs) = 9.500
Area (sqft) = 2.84
Velocity (ft/s) = 3.34
Wetted Perim (ft) = 18.90
Crit Depth, Yc (ft) = 0.22
Top Width (ft) = 18.87
EGL (ft) = 0.34

(Sta, El, n)-(Sta, El, n)...

(0.00, 7307.87) -(17.79, 7305.31, 0.030) -(34.47, 7305.29, 0.030) -(50.00, 7307.58, 0.030)

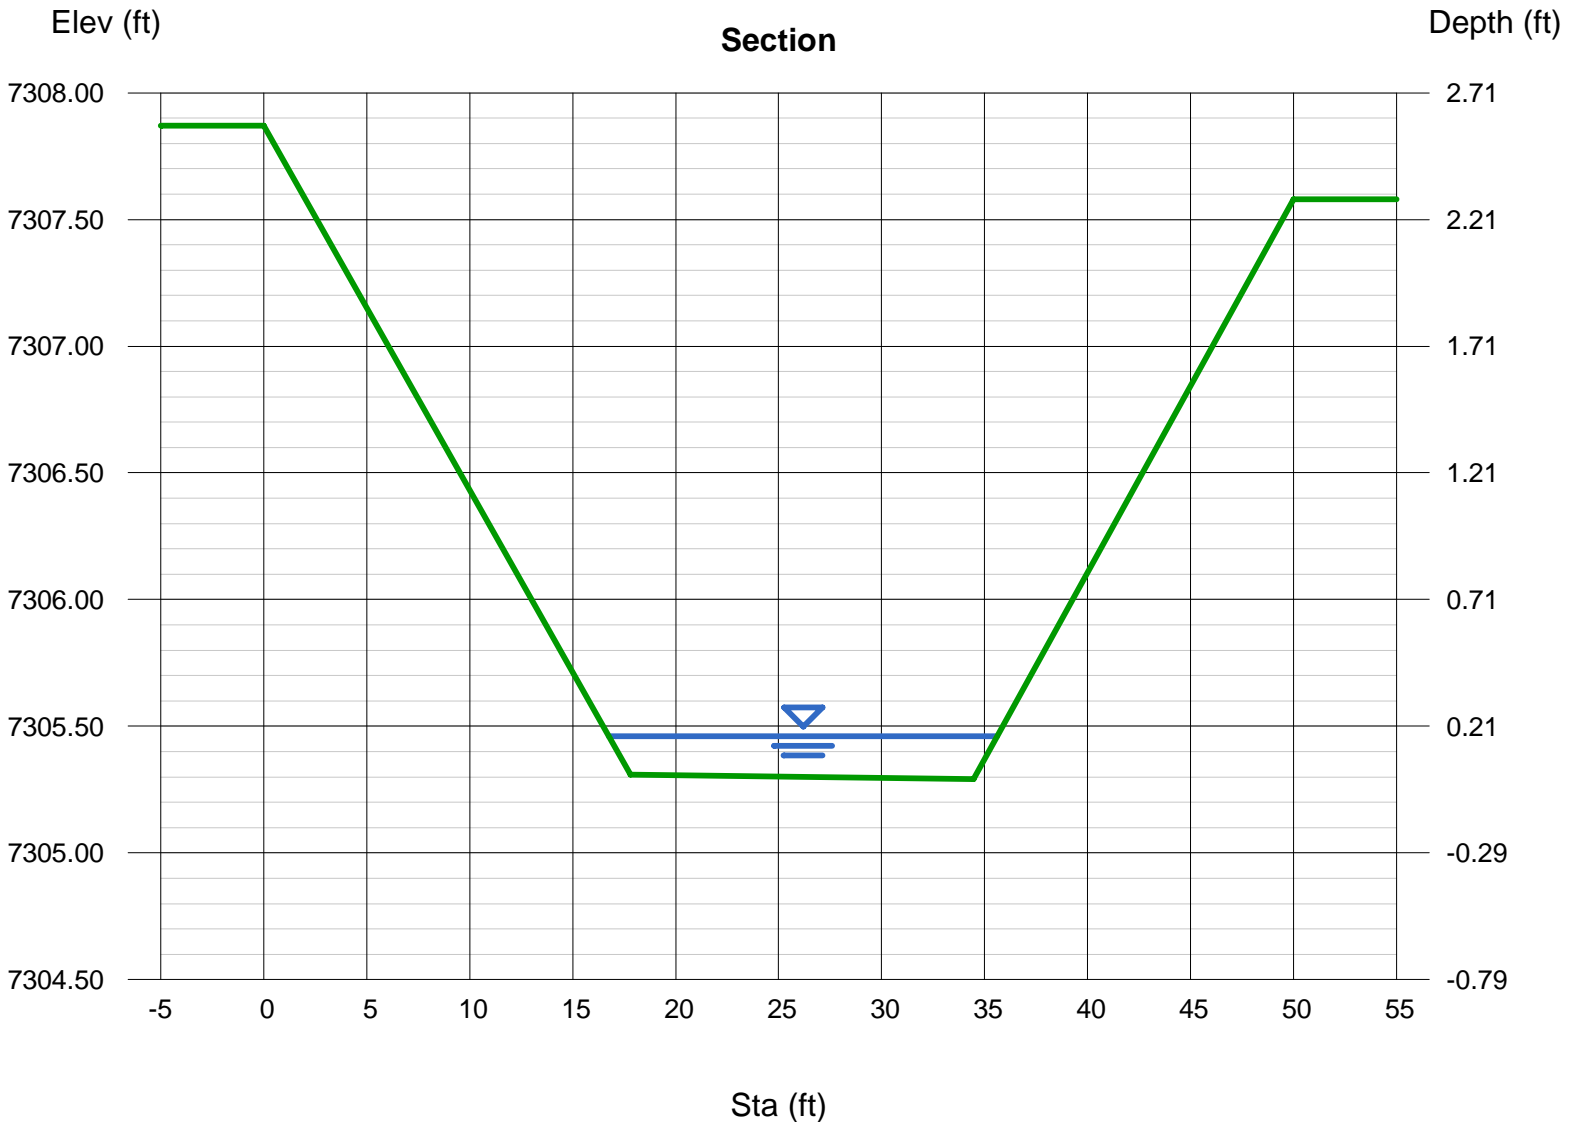

Channel Report

P1 Swale to Combination

Triangular

Side Slopes (z:1) = 33.00, 15.00
Total Depth (ft) = 2.10


Invert Elev (ft) = 1.00
Slope (%) = 1.00
N-Value = 0.035

Calculations

Compute by: Known Q
Known Q (cfs) = 11.00

Highlighted

Depth (ft) = 0.52
Q (cfs) = 11.00
Area (sqft) = 6.49
Velocity (ft/s) = 1.70
Wetted Perim (ft) = 24.99
Crit Depth, Yc (ft) = 0.42
Top Width (ft) = 24.96
EGL (ft) = 0.56

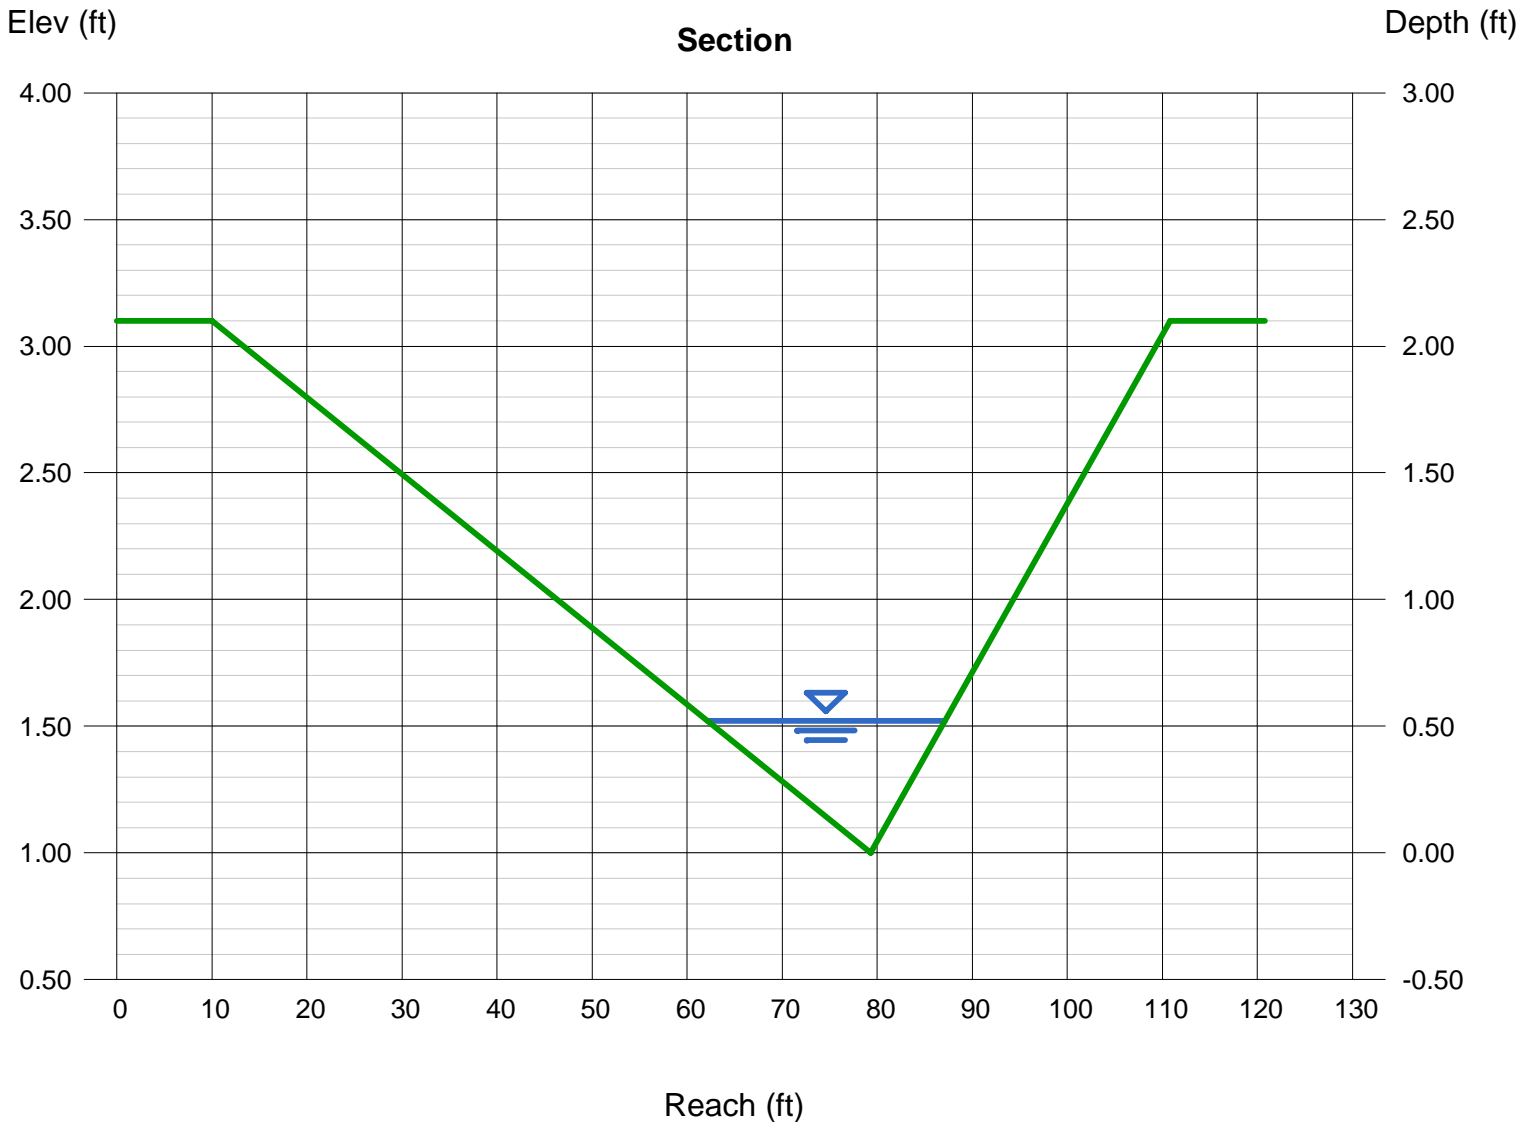

Channel Report

Basin L Roadside Swale-Capacity

Triangular

Side Slopes (z:1) = 4.00, 3.00

Total Depth (ft) = 3.00

Invert Elev (ft) = 100.00

Slope (%) = 1.50

N-Value = 0.030

Calculations

Compute by: Known Q

Known Q (cfs) = 18.50

Highlighted

Depth (ft) = 1.15

Q (cfs) = 18.50

Area (sqft) = 4.63


Velocity (ft/s) = 4.00

Wetted Perim (ft) = 8.38

Crit Depth, Y_c (ft) = 1.12

Top Width (ft) = 8.05

EGL (ft) = 1.40

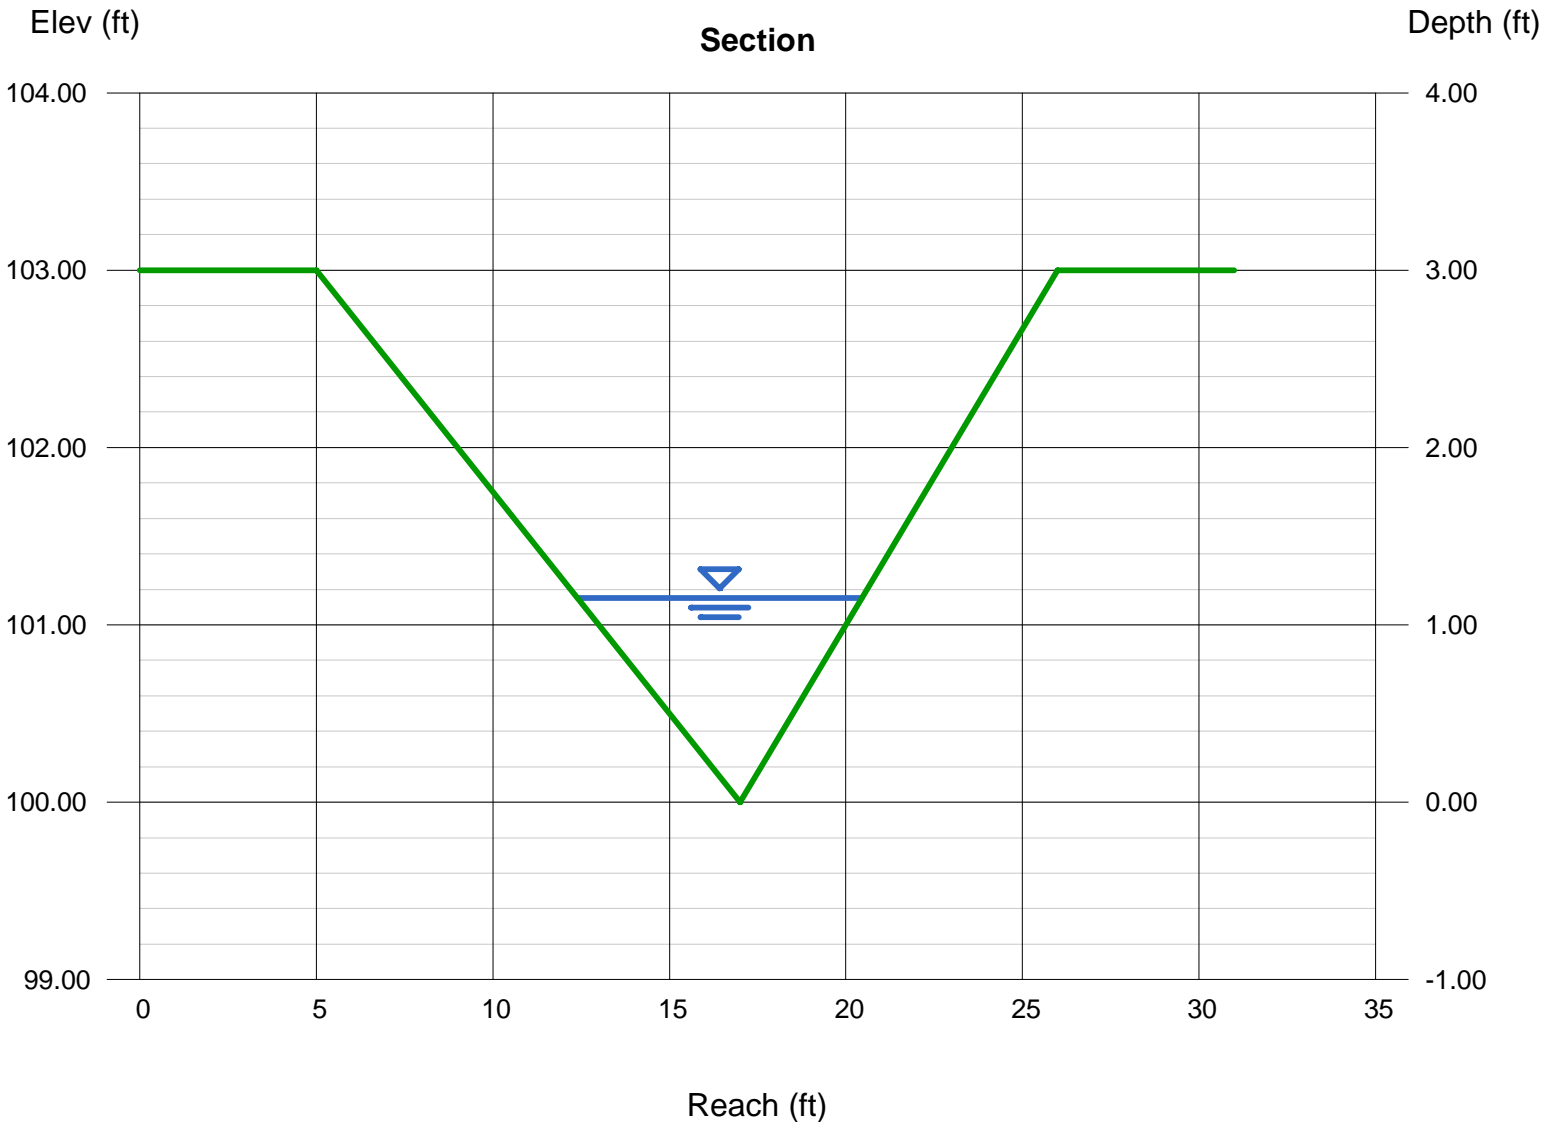

Channel Report

Basin L Roadside Swale-Velocity

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 3.00

Invert Elev (ft) = 100.00
Slope (%) = 8.00
N-Value = 0.030


Calculations

Compute by: Known Q
Known Q (cfs) = 18.50

Highlighted

Depth (ft) = 0.84
Q (cfs) = 18.50
Area (sqft) = 2.47
Velocity (ft/s) = 7.49
Wetted Perim (ft) = 6.12
Crit Depth, Yc (ft) = 1.12
Top Width (ft) = 5.88
EGL (ft) = 1.71

Slopes over 2.7% for this section will require TRM as the velocity > 5 ft/s

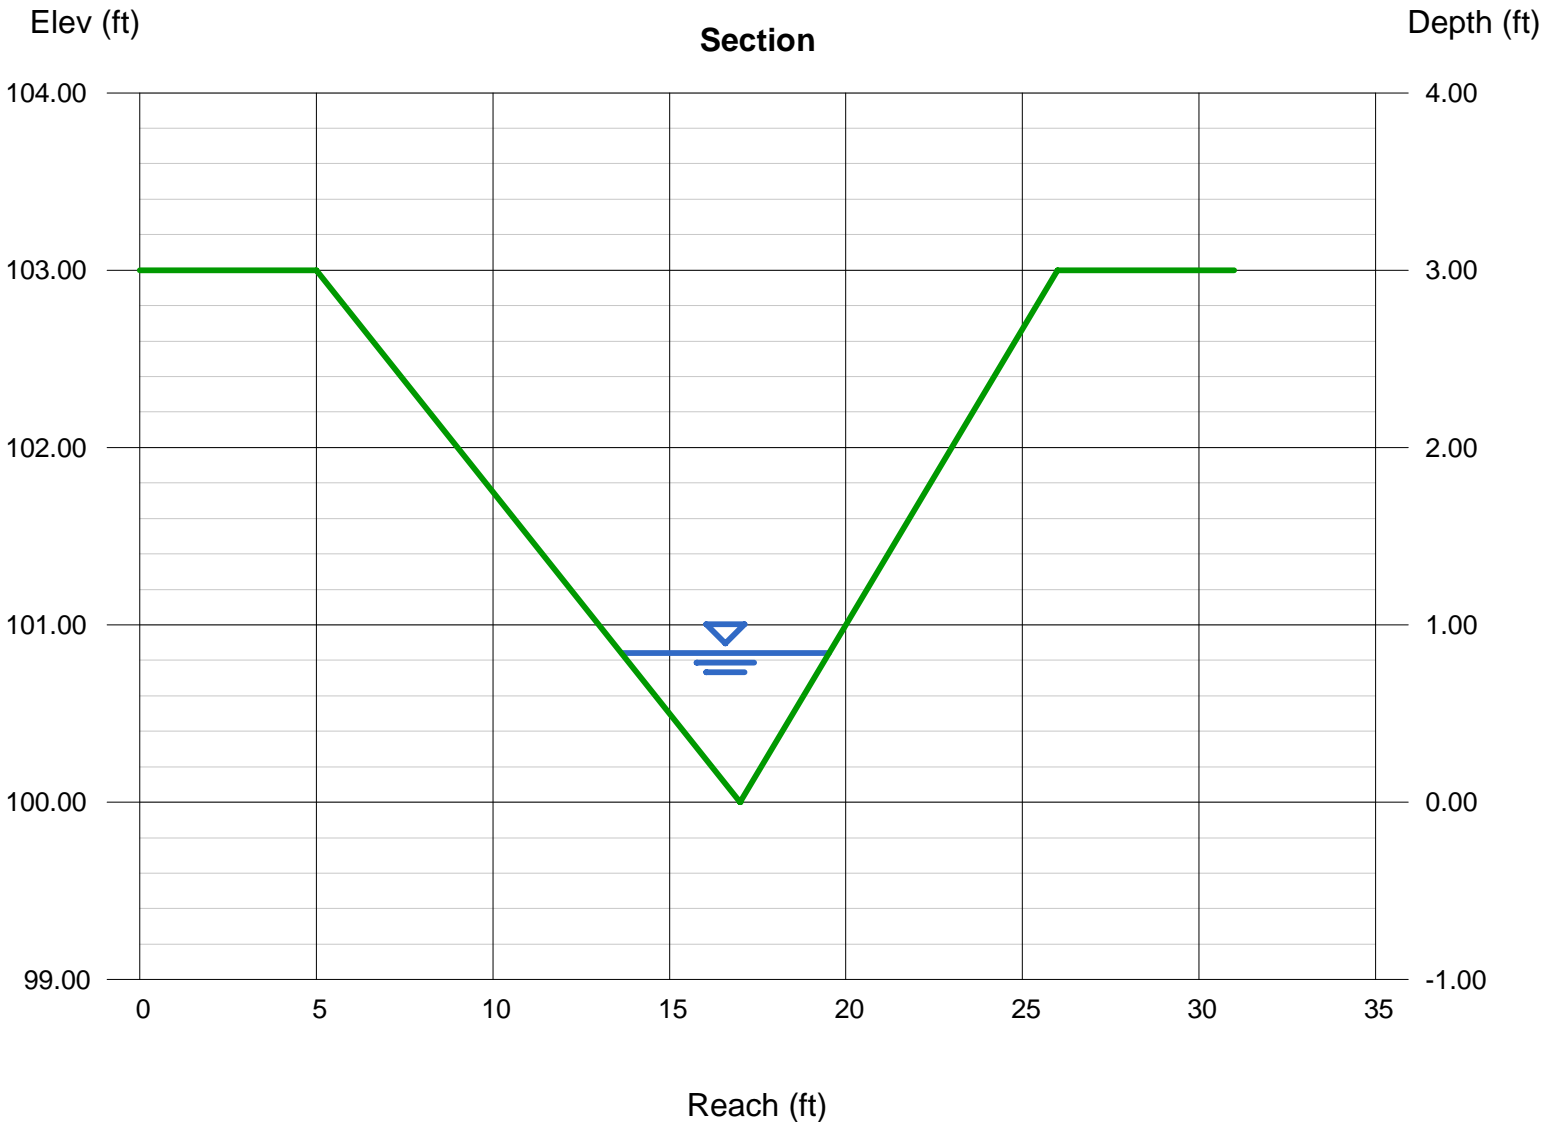

Channel Report

Basin M Roadside Swale-Capacity

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 2.50


Invert Elev (ft) = 100.00
Slope (%) = 1.50
N-Value = 0.030

Calculations

Compute by: Known Q
Known Q (cfs) = 2.50

Highlighted

Depth (ft) = 0.54
Q (cfs) = 2.500
Area (sqft) = 1.02
Velocity (ft/s) = 2.45
Wetted Perim (ft) = 3.93
Crit Depth, Yc (ft) = 0.51
Top Width (ft) = 3.78
EGL (ft) = 0.63

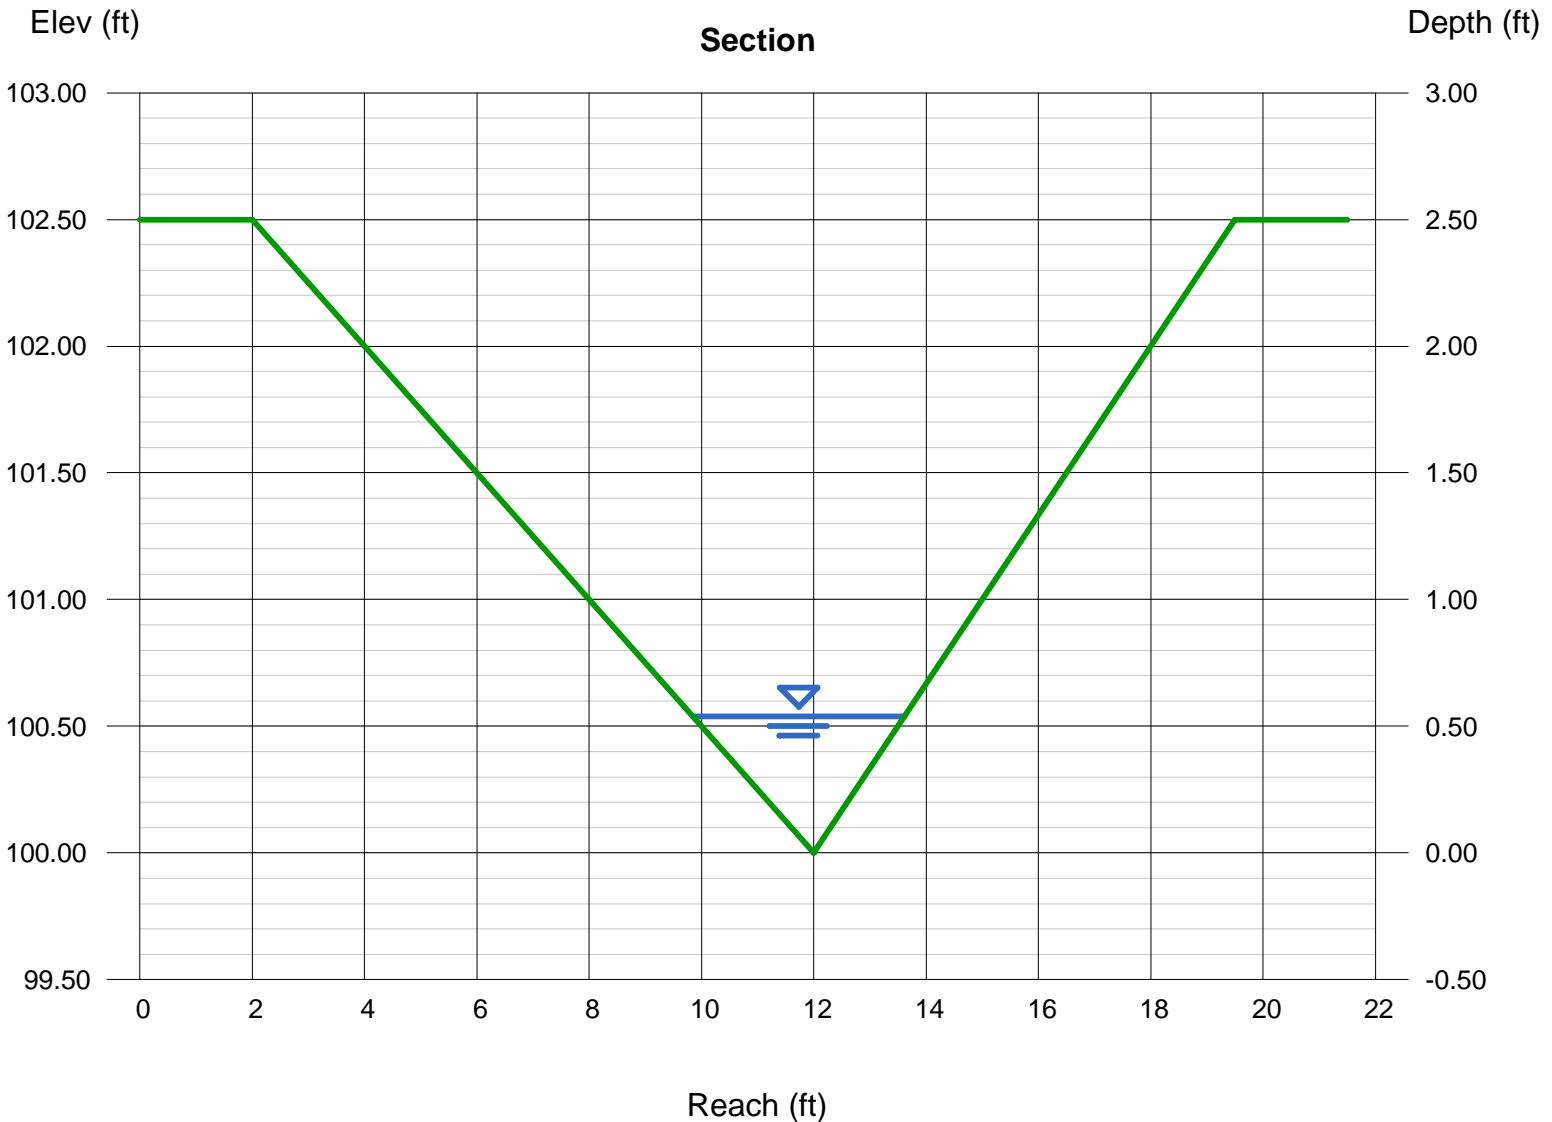

Channel Report

Basin M Roadside Swale-Velocity

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 2.50


Invert Elev (ft) = 100.00
Slope (%) = 8.00
N-Value = 0.030

Calculations

Compute by: Known Q
Known Q (cfs) = 2.50

Highlighted

Depth (ft) = 0.40
Q (cfs) = 2.500
Area (sqft) = 0.56
Velocity (ft/s) = 4.46
Wetted Perim (ft) = 2.91
Crit Depth, Yc (ft) = 0.51
Top Width (ft) = 2.80
EGL (ft) = 0.71

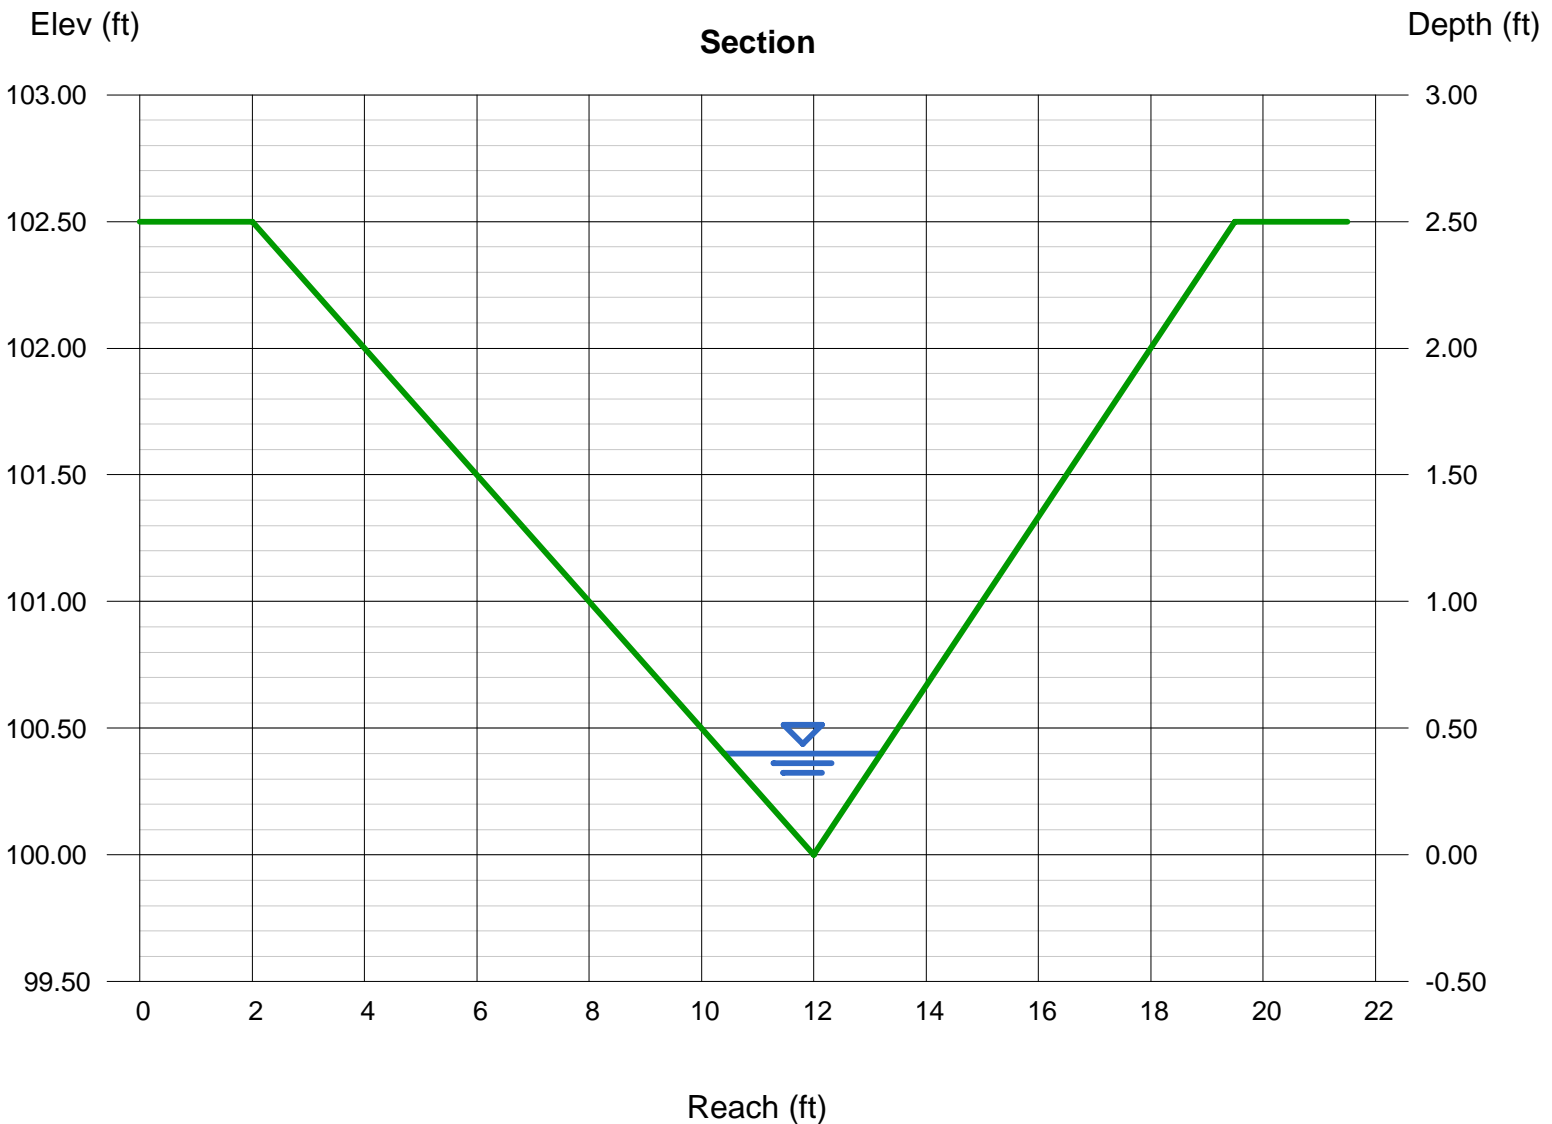

Channel Report

Basin O Existing Swale

User-defined

Invert Elev (ft) = 7303.25
Slope (%) = 5.00
N-Value = 0.030

Highlighted


Depth (ft) = 0.50
Q (cfs) = 15.00
Area (sqft) = 3.08
Velocity (ft/s) = 4.87
Wetted Perim (ft) = 10.08
Crit Depth, Yc (ft) = 0.62
Top Width (ft) = 10.01
EGL (ft) = 0.87

Calculations

Compute by: Known Q
Known Q (cfs) = 15.00

(Sta, El, n)-(Sta, El, n)...

(0.00, 7307.07) -(8.60, 7306.82, 0.030) -(18.35, 7304.06, 0.030) -(24.28, 7303.25, 0.030) -(29.38, 7303.47, 0.030) -(50.00, 7308.07, 0.030)

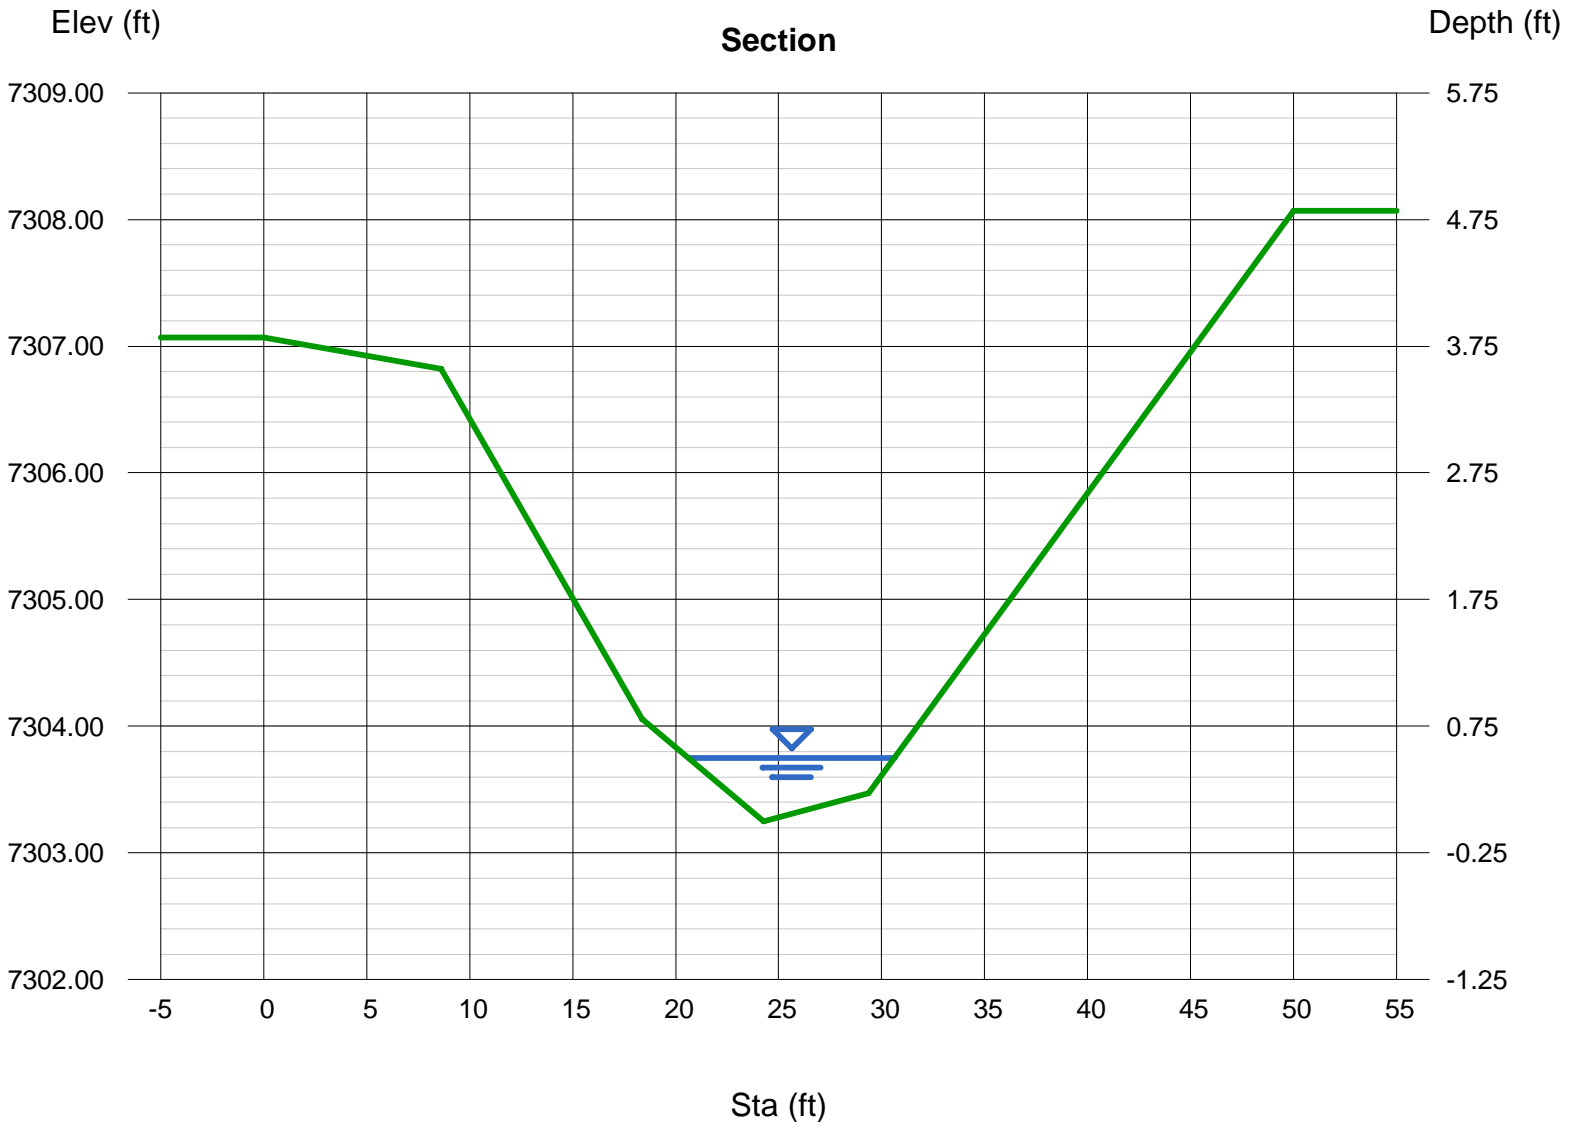

Channel Report

Basin P Existing Swale

User-defined

Invert Elev (ft) = 7297.91
Slope (%) = 6.50
N-Value = 0.030

Highlighted


Depth (ft) = 0.27
Q (cfs) = 12.00
Area (sqft) = 3.30
Velocity (ft/s) = 3.63
Wetted Perim (ft) = 20.00
Crit Depth, Yc (ft) = 0.34
Top Width (ft) = 19.99
EGL (ft) = 0.48

Calculations

Compute by: Known Q
Known Q (cfs) = 12.00

(Sta, El, n)-(Sta, El, n)...

(0.00, 7299.49)-(12.62, 7298.17, 0.030)-(20.94, 7297.91, 0.030)-(30.32, 7298.03, 0.030)-(50.00, 7299.38, 0.030)

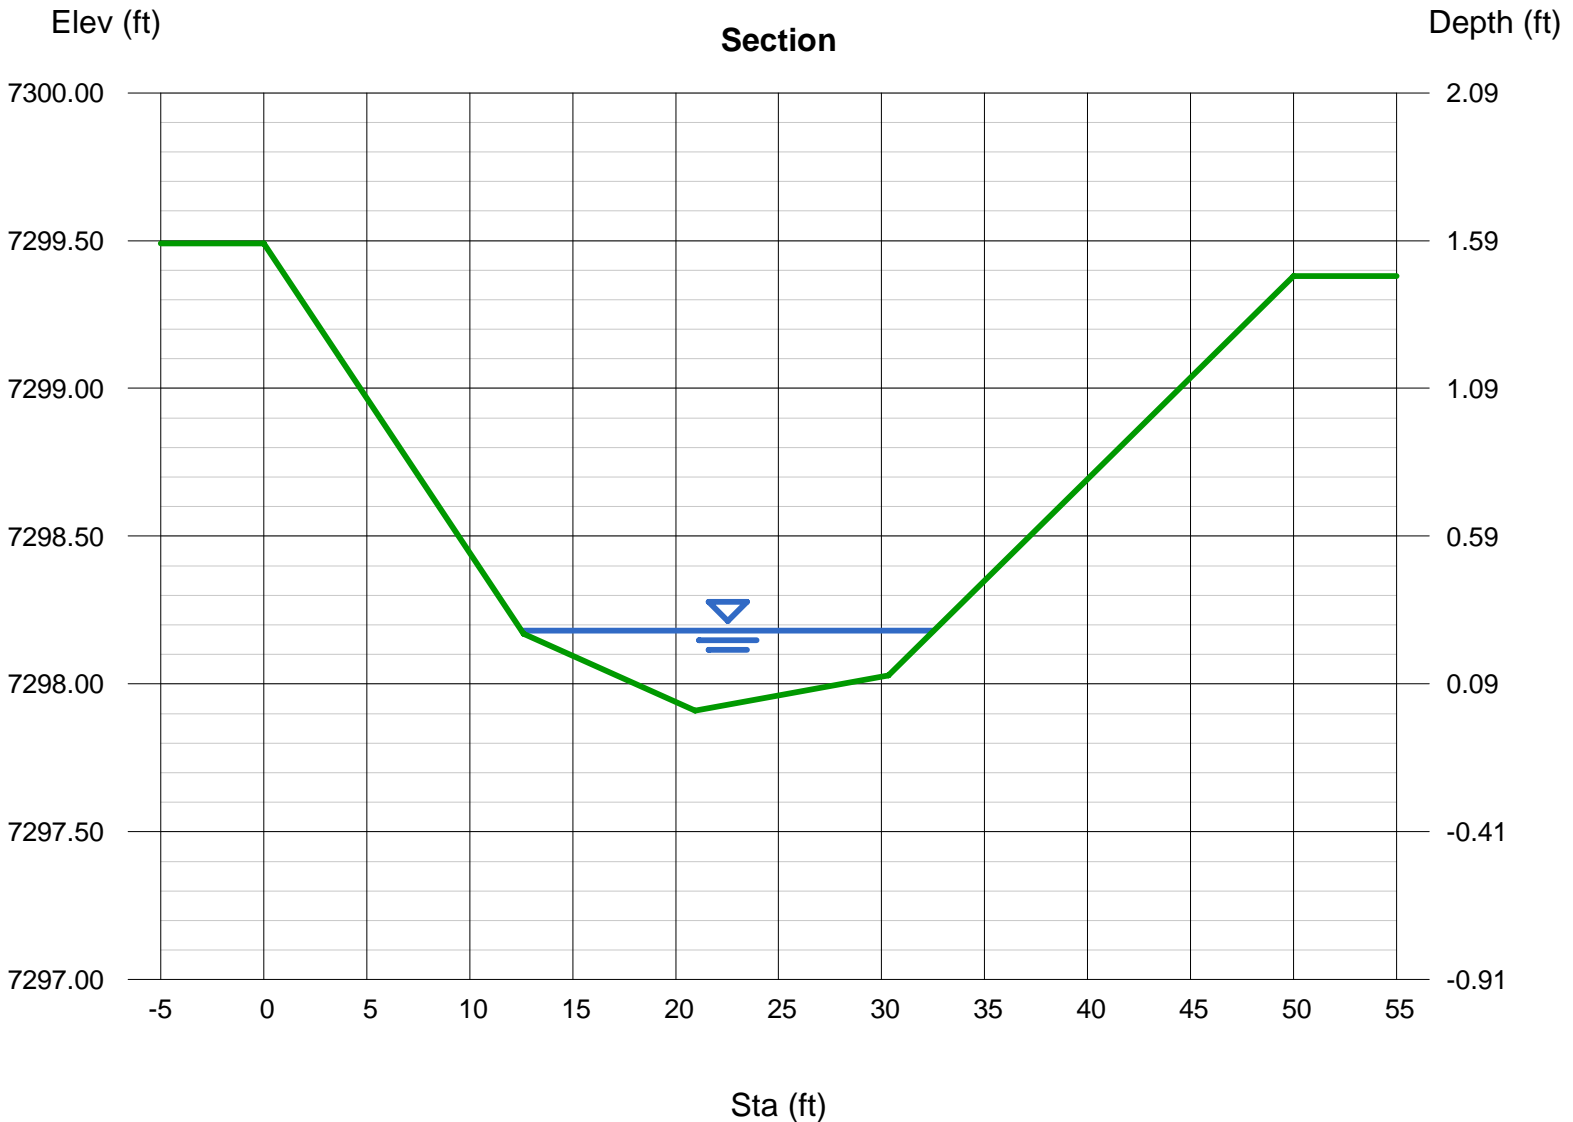

VMax® TRMs




A Permanent Turf Reinforcement Mat Solution for Every Design

The VMax system of permanent TRMs are ideal for high-flow channels, streambanks, shorelines, and other areas needing permanent vegetation reinforcement and protection from water and wind. Our VMax TRMs combine a three-dimensional matting and a fiber matrix material for all-out erosion protection, vegetation establishment and reinforcement. The VMax TRMs are available with various performance capabilities and support reinforced vegetative lining development from germination to maturity.

VMax® Unique Three-Dimensional Design

North American Green VMax TRMs are each designed to maximize performance through all development phases of a reinforced vegetative lining. The corrugated matting structure lends a true reinforcement zone for vegetation entanglement, especially compared to flat net mats. The unique design of the corrugated matting also helps to create a shear plane that deflects flowing water away from the soil surface. And the incorporation of a fiber matrix supplements the 3-D structure by creating a ground cover that blocks soil movement and aids in vegetation establishment.

Four VMax Turf Reinforcement Mats Designed for Every Level of Performance

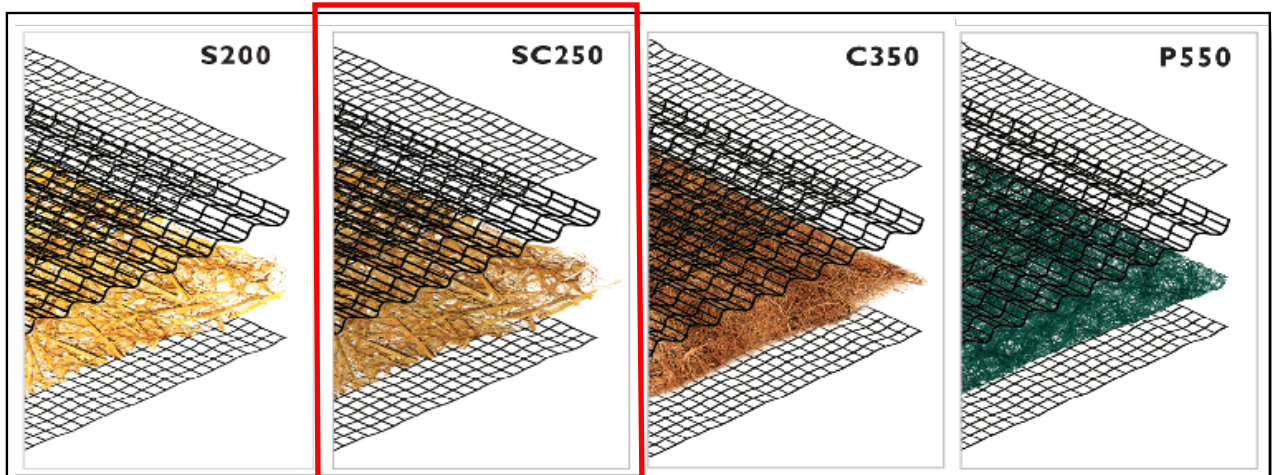

Matrix Fiber	100% Straw	70% Straw / 30% Coconut	100% Coconut	100% Polypropylene
Netting Types	Top and Bottom light-weight UV-stabilized PP, Crimped PP center net	Top and Bottom UV-stabilized PP, Crimped PP center net	Top and Bottom heavy-weight UV-stabilized PP, Crimped PP center net	Top and Bottom ultra heavy-weight UV-stabilized PP, Crimped PP center net
Typical Slope Applications (H:V)	1:1 and greater	1:1 and greater	1:1 and greater	1:1 and greater
Channel Shear Stress Threshold	Unvegetated: 2.3 psf Vegetated: 10.0 psf	Unvegetated: 3.0 psf Vegetated: 10.0 psf	Unvegetated: 3.2 psf Vegetated: 12.0 psf	Unvegetated: 4.0 psf Vegetated: 14.0 psf
Channel Velocity Threshold	Unvegetated: 8.5 fps Vegetated: 18 fps	Unvegetated: 9.5 fps Vegetated: 15 fps	Unvegetated: 10.5 fps Vegetated: 20 fps	Unvegetated: 12.5 fps Vegetated: 25 fps



Selected product that will work for all swales above 5 ft/s. Has maximum of 15 ft/s.

Copyright 2021.

North American Green, LLC.
4609 E. Boonville-New Harmony Rd., Evansville, IN
(800) 772-2040 | www.nagreen.com

VMax[®] TRMs cont.


Selecting the Right VMax TRM

Choosing the right VMax TRM can be made easy by utilizing our Erosion Control Materials Design Software (www.ecmds.com), which allows users to input project specific parameters for channels, slopes, spillways, and more and ensures proper evaluation, design, and product selection in return. Our four VMax TRMs offer varying performance values, fiber matrix longevities, and price points, to help you meet your project specific goals.




Twist Pin + VMax TRM - an Ideal Installation

Utilizing the VMax TRMs in conjunction with Twist Pin fastener technology can result in an installed system that pushes TRM performance with increased factors of safety. The combined system has been shown to have superior pullout strength performance up to 200 lbs when compared to installation with traditional wire staples and pins. This is up to 10x the pullout resistance of wire staples and pins. Additionally, the use of the twist pins provides intimate contact between the TRM and the soil, and have been shown to be effective in a wide range of soil types. With a quick and easy installation using an electric drill and custom chuck, the TRM+Twist Pin system can eliminate time and labor costs from day 1 through project release.

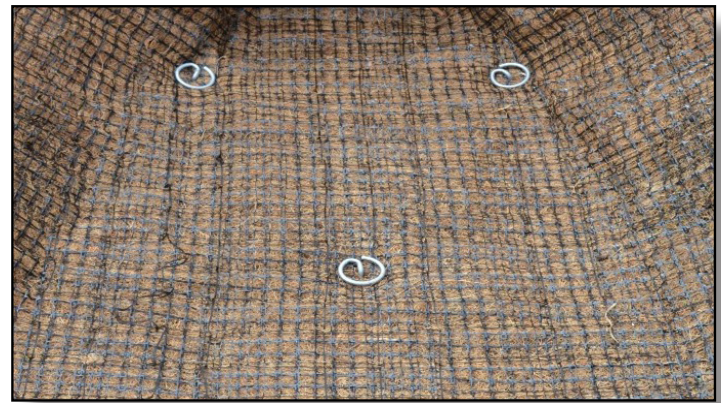

VMax turf reinforcement mat being installed on a channel application (top right), twist pins installed with TRMs can have increased system performance and pullout resistance (middle right), twist pins are available in 8" and 12" lengths and two coil configurations designed for hard or soft soil types (lower right).

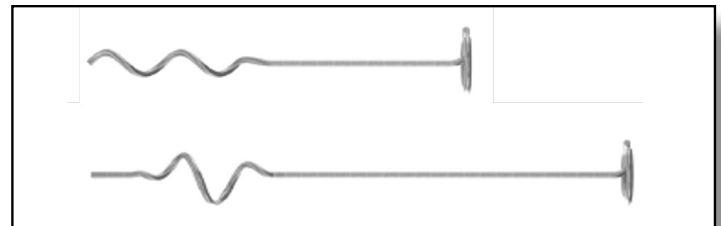

Comparison of common TRM fasteners based on pullout performance and typical application (below).

Fastener	Pullout Resistance (lb)	Comment
6" Round Top Pin	14	Best for hardened soils where other fasteners are damaged during installation.
6" Regular U-staple	42	Standard fastener that develops additional pullout as legs may deflect and add friction during installation.
12" Pin with Washer	35	Standard fastener good for soils where staples can be bent frequently and are too difficult to install.
18" Pin with Washer	27	Standard fastener good for soils where staples are frequently bent and 12" straight pins fail to provide sufficient pullout because surface soil is wet or loose.
Twist Pin	170	Upgraded fastener that provides high pullout and ideal for loose or soft soils.



Copyright 2021.

North American Green, LLC.
 4609 E. Boonville-New Harmony Rd., Evansville, IN
 (800) 772-2040 | www.nagreen.com

HY-8 Culvert Analysis Report

Pond A Maint. Trail 5-yr (DP5)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 1.5 cfs

Design Flow: 1.5 cfs

Maximum Flow: 1.5 cfs

Table 1 - Summary of Culvert Flows at Crossing: Pond A Maint. Trail-5 yr (DP5)

Headwater Elevation (ft)	Total Discharge (cfs)	Pond A Culvert Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7332.23	1.50	1.50	0.00	1
7334.23	5.17	5.17	0.00	Overtopping

Rating Curve Plot for Crossing: Pond A Maint. Trail-5 yr (DP5)

Total Rating Curve

Crossing: Pond A Maint. Trail-5 yr (DP5)


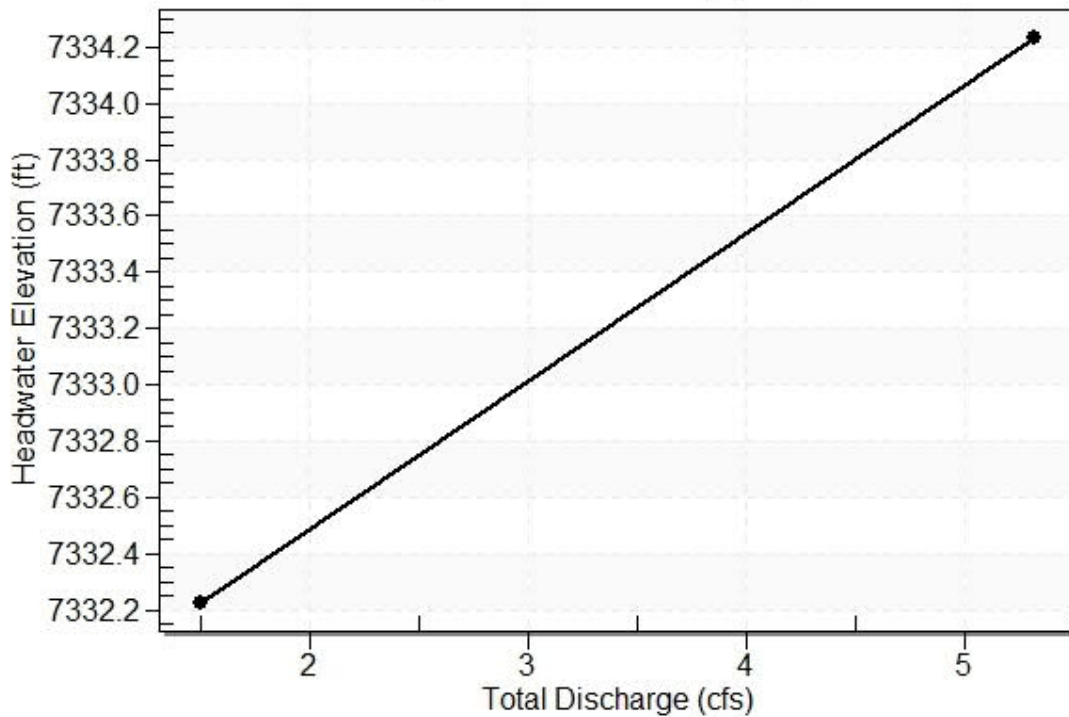


Table 2 - Culvert Summary Table: Pond A Culvert

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436
1.50	1.50	7332.23	0.777	0.417	1-S2n	0.483	0.519	0.483	0.546	3.988	1.436

 Straight Culvert
 Inlet Elevation (invert): 7331.45 ft, Outlet Elevation (invert): 7331.16 ft
 Culvert Length: 36.60 ft, Culvert Slope: 0.0079


Culvert Performance Curve Plot: Pond A Culvert

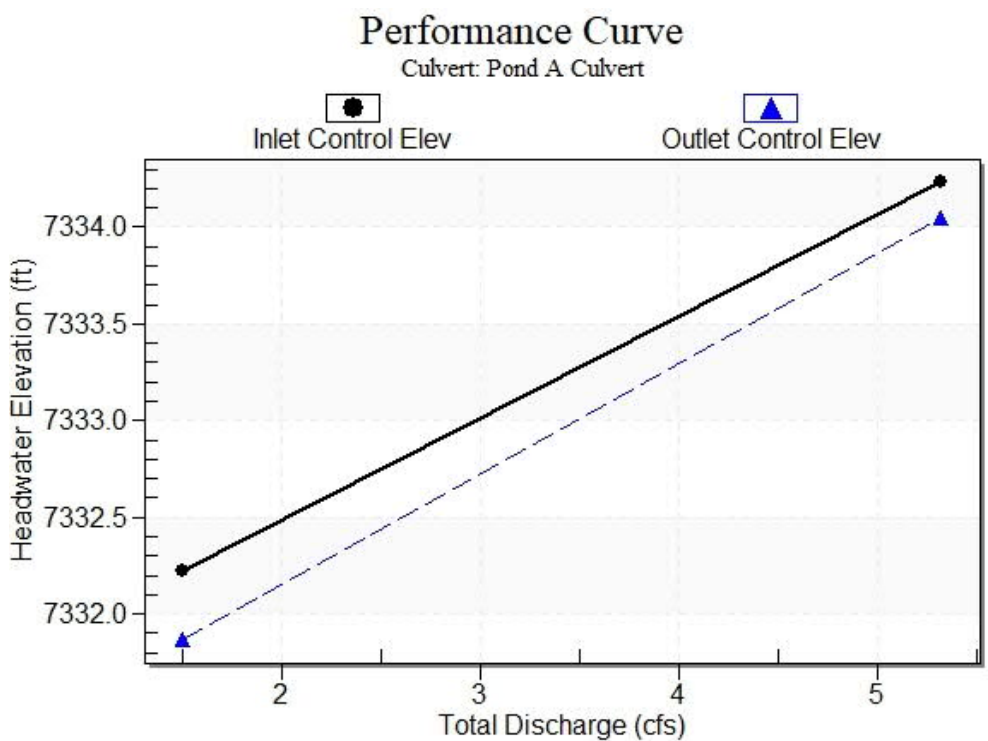

Water Surface Profile Plot for Culvert: Pond A Culvert

Crossing - Pond A Maint. Trail-5 yr (DP5), Design Discharge - 1.5 cfs

Culvert - Pond A Culvert, Culvert Discharge - 1.5 cfs

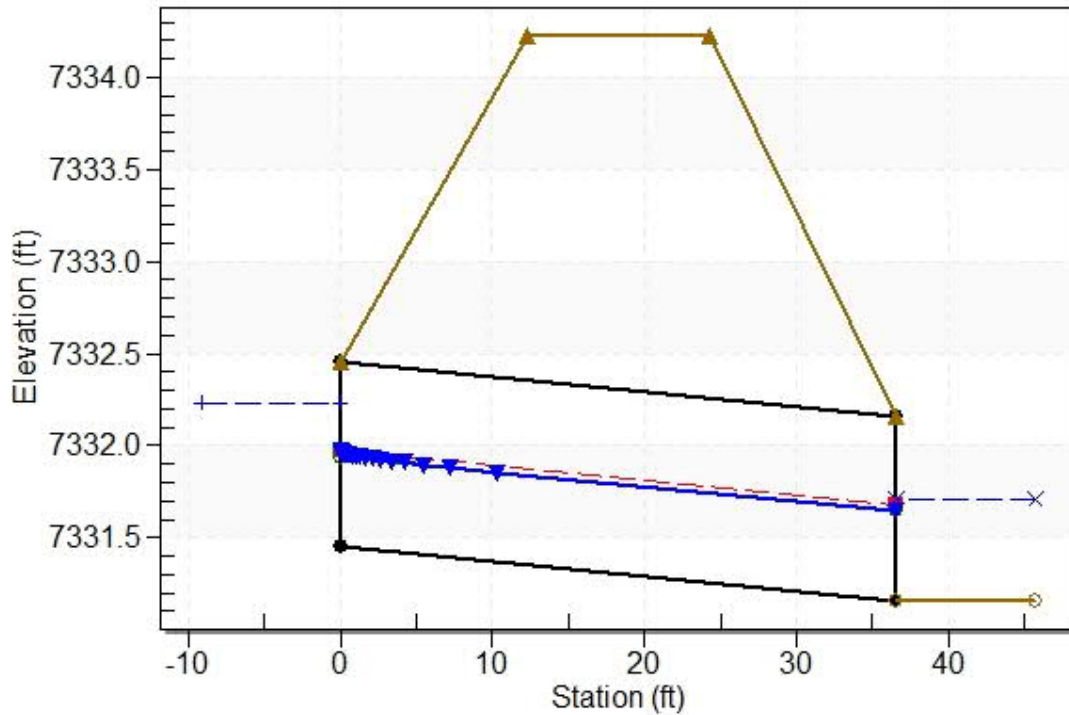

Site Data - Pond A Culvert

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 7331.45 ft

Outlet Station: 36.60 ft

Outlet Elevation: 7331.16 ft

Number of Barrels: 1

Culvert Data Summary - Pond A Culvert

Barrel Shape: Circular

Barrel Diameter: 1.00 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Mitered to Conform to Slope

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (X-ing: Pond A Maint. Trail-5 yr (DP5))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48
1.50	7331.71	0.55	1.44	0.17	0.48

Tailwater Channel Data - Pond A Maint. Trail-5 yr (DP5)

Tailwater Channel Option: Triangular Channel
Side Slope (H:V): 3.50 (_:1)
Channel Slope: 0.0050
Channel Manning's n: 0.0300
Channel Invert Elevation: 7331.16 ft

Roadway Data for Crossing: Pond A Maint. Trail-5 yr (DP5)

Roadway Profile Shape: Constant Roadway Elevation
Crest Length: 100.00 ft
Crest Elevation: 7334.23 ft
Roadway Surface: Gravel
Roadway Top Width: 12.00 ft

HY-8 Culvert Analysis Report

Pond A Maint. Trail 100-yr (DP5)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 3 cfs

Design Flow: 3 cfs

Maximum Flow: 3 cfs

Table 1 - Summary of Culvert Flows at Crossing: Pond A Maint. Trail-100 yr (DP5)

Headwater Elevation (ft)	Total Discharge (cfs)	Pond A Culvert Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7332.80	3.00	3.00	0.00	1
7334.23	5.17	5.17	0.00	Overtopping

Rating Curve Plot for Crossing: Pond A Maint. Trail-100 yr (DP5)

Total Rating Curve

Crossing: Pond A Maint. Trail-100 yr (DP5)


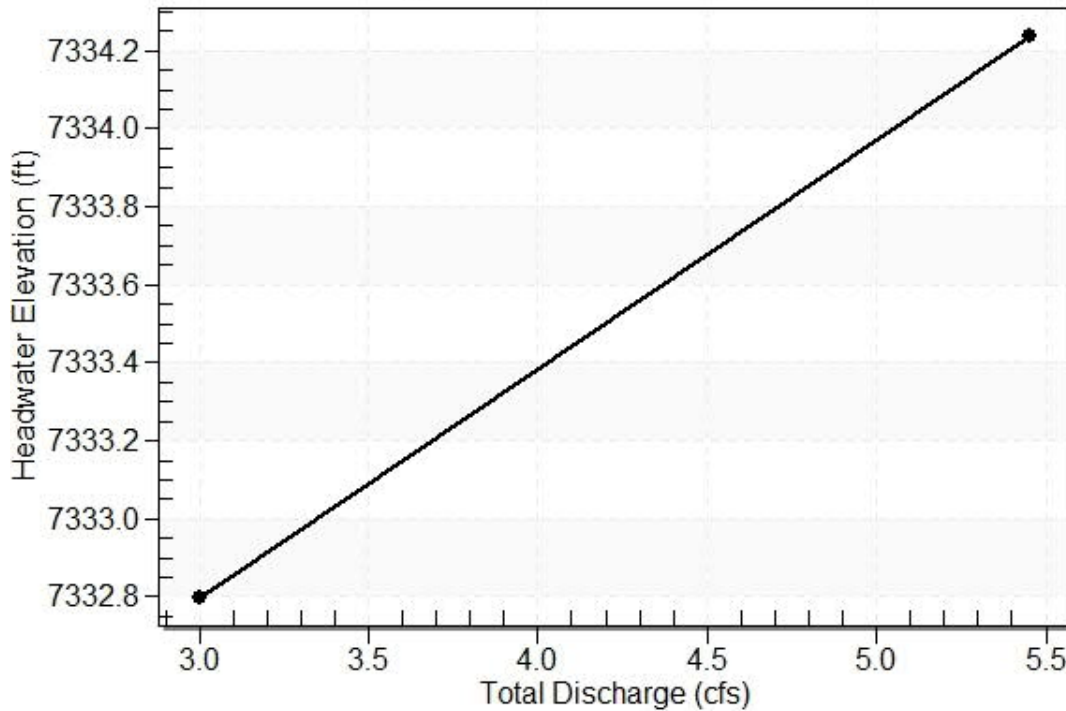


Table 2 - Culvert Summary Table: Pond A Culvert

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708
3.00	3.00	7332.80	1.350	1.333	7-M2c	0.774	0.742	0.742	0.708	4.798	1.708

 Straight Culvert
 Inlet Elevation (invert): 7331.45 ft, Outlet Elevation (invert): 7331.16 ft
 Culvert Length: 36.60 ft, Culvert Slope: 0.0079


Culvert Performance Curve Plot: Pond A Culvert

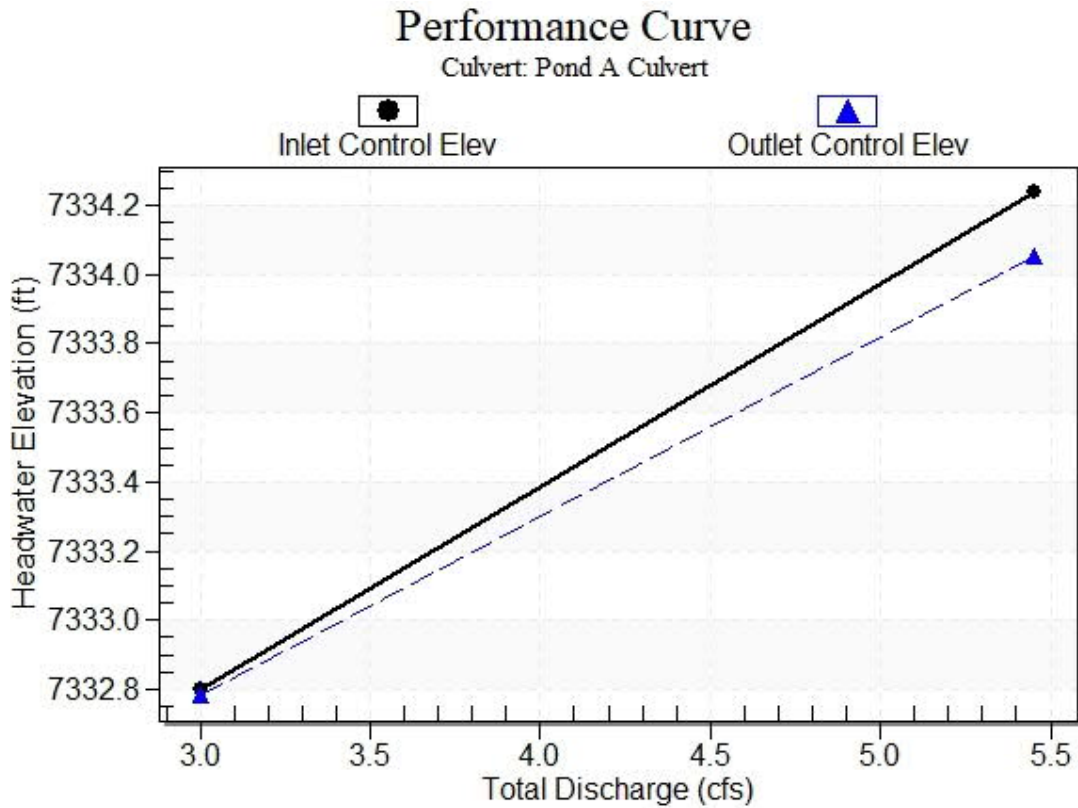

Water Surface Profile Plot for Culvert: Pond A Culvert

Crossing - Pond A Maint. Trail-100 yr (DP5), Design Discharge - 3.0 cfs

Culvert - Pond A Culvert, Culvert Discharge - 3.0 cfs

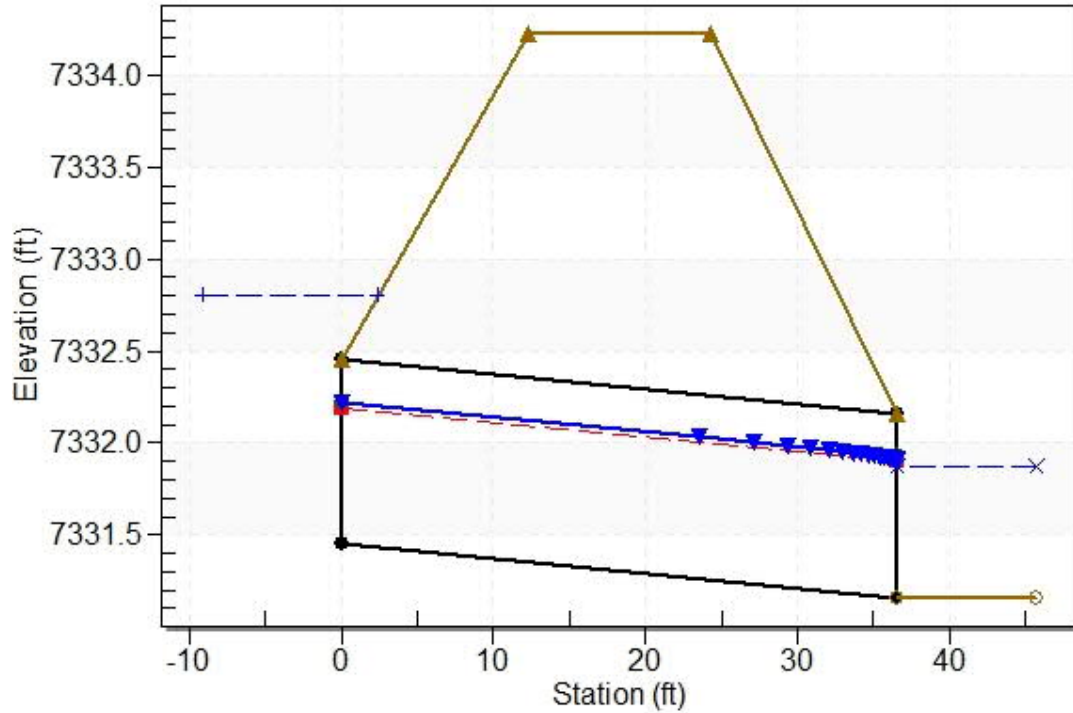

Site Data - Pond A Culvert

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 7331.45 ft

Outlet Station: 36.60 ft

Outlet Elevation: 7331.16 ft

Number of Barrels: 1

Culvert Data Summary - Pond A Culvert

Barrel Shape: Circular

Barrel Diameter: 1.00 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Mitered to Conform to Slope

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (X-ing: Pond A Maint. Trail-100 yr (DP5))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51
3.00	7331.87	0.71	1.71	0.22	0.51

Tailwater Channel Data - Pond A Maint. Trail-100 yr (DP5)

Tailwater Channel Option: Triangular Channel
Side Slope (H:V): 3.50 (_:1)
Channel Slope: 0.0050
Channel Manning's n: 0.0300
Channel Invert Elevation: 7331.16 ft

Roadway Data for Crossing: Pond A Maint. Trail-100 yr (DP5)

Roadway Profile Shape: Constant Roadway Elevation
Crest Length: 100.00 ft
Crest Elevation: 7334.23 ft
Roadway Surface: Gravel
Roadway Top Width: 12.00 ft

HY-8 Culvert Analysis Report

Pond A Inflow – 5 yr (DP5.1)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 3.8 cfs

Design Flow: 3.8 cfs

Maximum Flow: 3.8 cfs

Table 1 - Summary of Culvert Flows at Crossing: Pond A Inflow-5 yr (DP5.1)

Headwater Elevation (ft)	Total Discharge (cfs)	Pond A Inflow Pipe Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7331.96	3.80	3.80	0.00	1
7335.50	28.04	28.04	0.00	Overtopping

Rating Curve Plot for Crossing: Pond A Inflow-5 yr (DP5.1)

Total Rating Curve

Crossing: Pond A Inflow-5 yr (DP5.1)


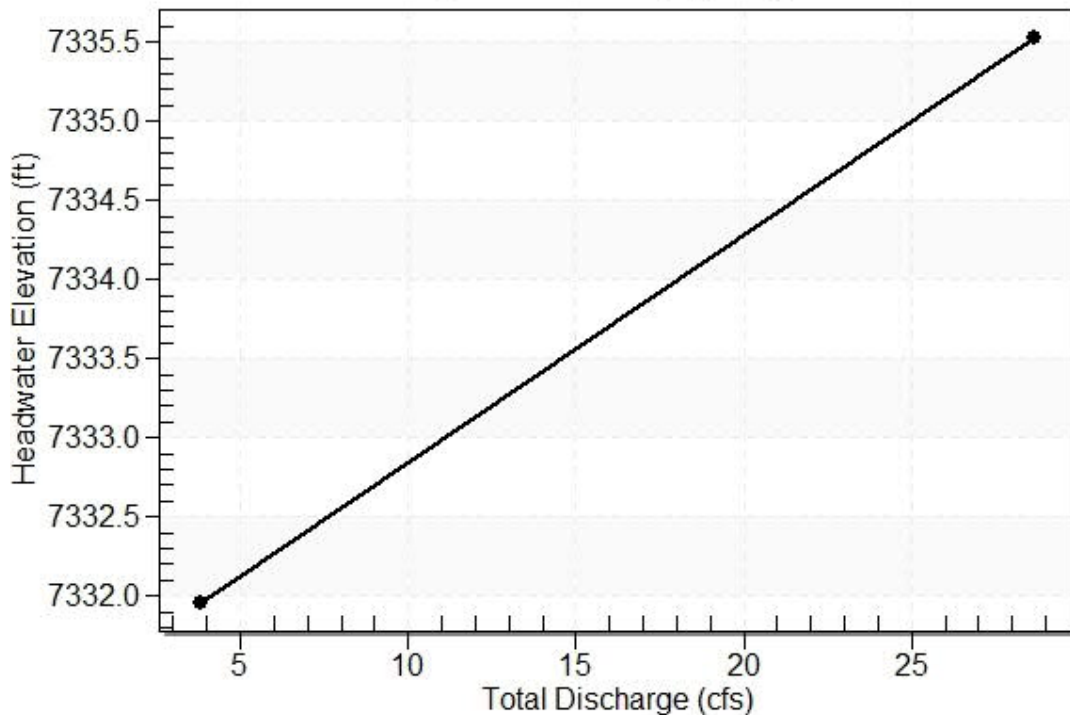


Table 2 - Culvert Summary Table: Pond A Inflow Pipe


Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000
3.80	3.80	7331.96	0.920	0.737	1-JS1f	0.416	0.683	2.000	2.940	1.210	0.000

 Straight Culvert
 Inlet Elevation (invert): 7331.04 ft, Outlet Elevation (invert): 7329.55 ft
 Culvert Length: 47.70 ft, Culvert Slope: 0.0312

Culvert Performance Curve Plot: Pond A Inflow Pipe

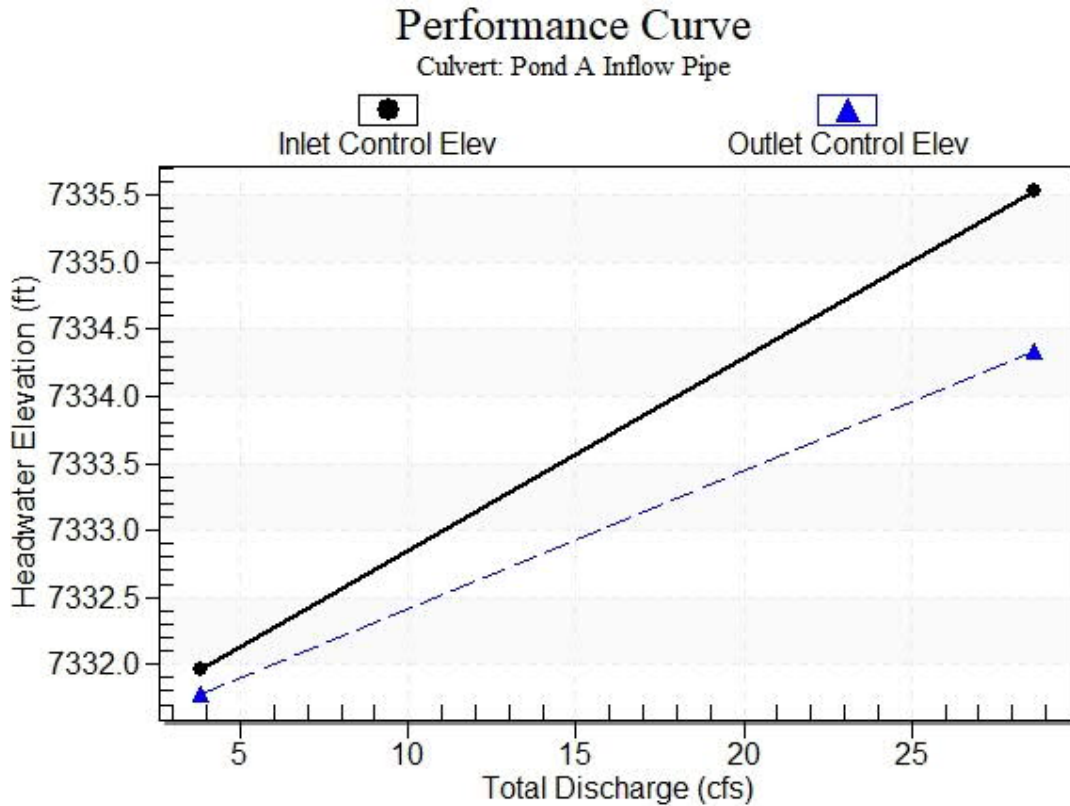

Water Surface Profile Plot for Culvert: Pond A Inflow Pipe
 Crossing - Pond A Inflow-5 yr (DP5.1), Design Discharge - 3.8 cfs
 Culvert - Pond A Inflow Pipe, Culvert Discharge - 3.8 cfs

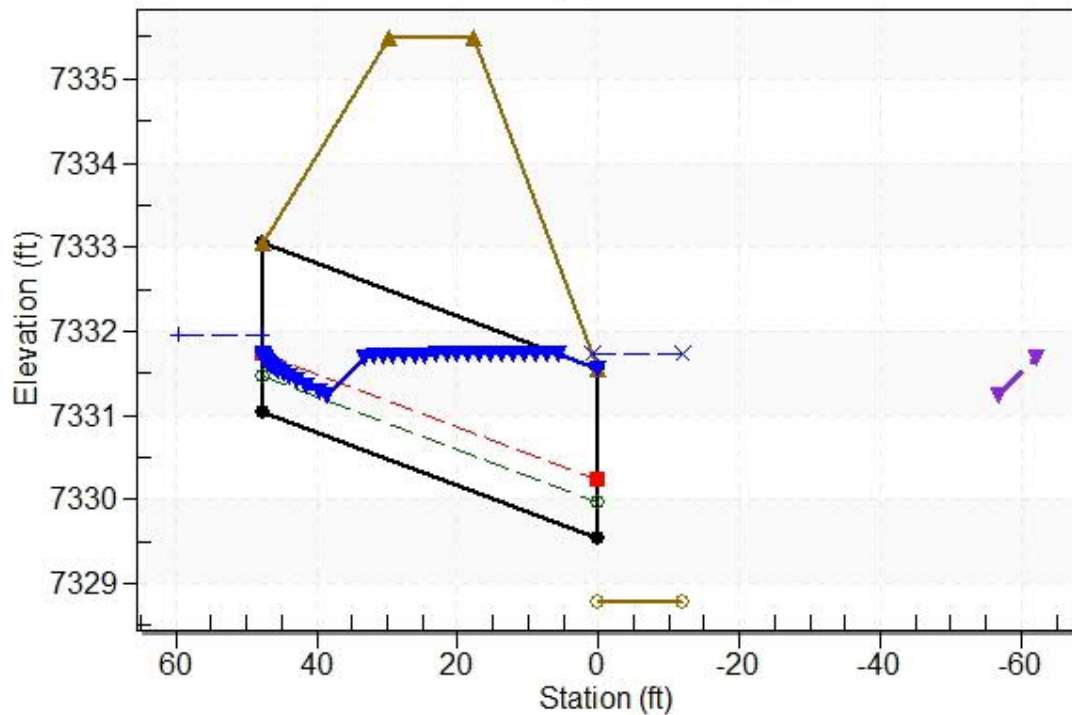

Site Data - Pond A Inflow Pipe

Site Data Option: Culvert Invert Data
 Inlet Station: 47.68 ft
 Inlet Elevation: 7331.04 ft
 Outlet Station: 0.00 ft
 Outlet Elevation: 7329.55 ft
 Number of Barrels: 1

Culvert Data Summary - Pond A Inflow Pipe

Barrel Shape: Circular
 Barrel Diameter: 2.00 ft
 Barrel Material: Concrete
 Embedment: 0.00 in
 Barrel Manning's n: 0.0130
 Culvert Type: Straight
 Inlet Configuration: Square Edge with Headwall
 Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (Crossing: Pond A Inflow-5 yr (DP5.1))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94
3.80	7331.73	2.94

Tailwater Channel Data - Pond A Inflow-5 yr (DP5.1)

Tailwater Channel Option: Enter Constant Tailwater Elevation
 Constant Tailwater Elevation: 7331.73 ft

Roadway Data for Crossing: Pond A Inflow-5 yr (DP5.1)

Roadway Profile Shape: Constant Roadway Elevation
 Crest Length: 50.00 ft
 Crest Elevation: 7335.50 ft
 Roadway Surface: Gravel
 Roadway Top Width: 12.00 ft

HY-8 Culvert Analysis Report

Pond A Inflow – 100 yr (DP5.1)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 12.4 cfs

Design Flow: 12.4 cfs

Maximum Flow: 12.4 cfs

Table 1 - Summary of Culvert Flows at Crossing: Pond A Inflow-100 yr (DP5.1)

Headwater Elevation (ft)	Total Discharge (cfs)	Pond A Inflow Pipe Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7333.42	12.40	12.40	0.00	1
7335.50	28.04	28.04	0.00	Overtopping

Rating Curve Plot for Crossing: Pond A Inflow-100 yr (DP5.1)

Total Rating Curve
Crossing: Pond A Inflow-100 yr (DP5.1)


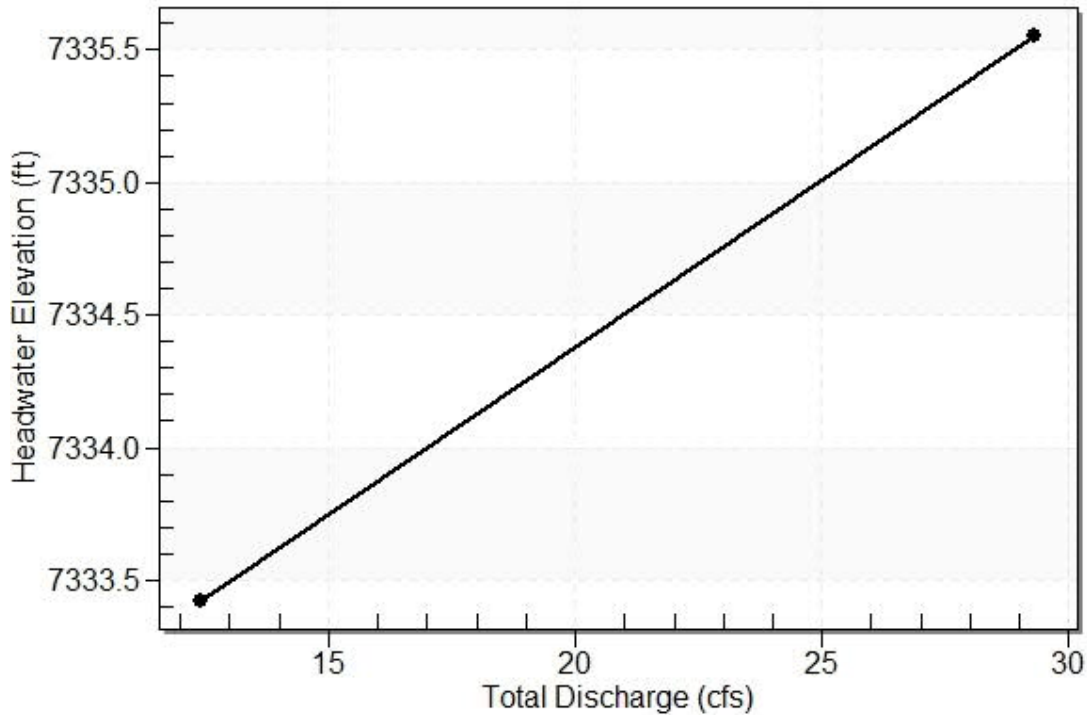


Table 2 - Culvert Summary Table: Pond A Inflow Pipe

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000
12.40	12.40	7333.42	1.932	2.385	4-FFf	0.764	1.266	2.000	4.130	3.947	0.000

 Straight Culvert
 Inlet Elevation (invert): 7331.04 ft, Outlet Elevation (invert): 7329.55 ft
 Culvert Length: 47.70 ft, Culvert Slope: 0.0312


Culvert Performance Curve Plot: Pond A Inflow Pipe

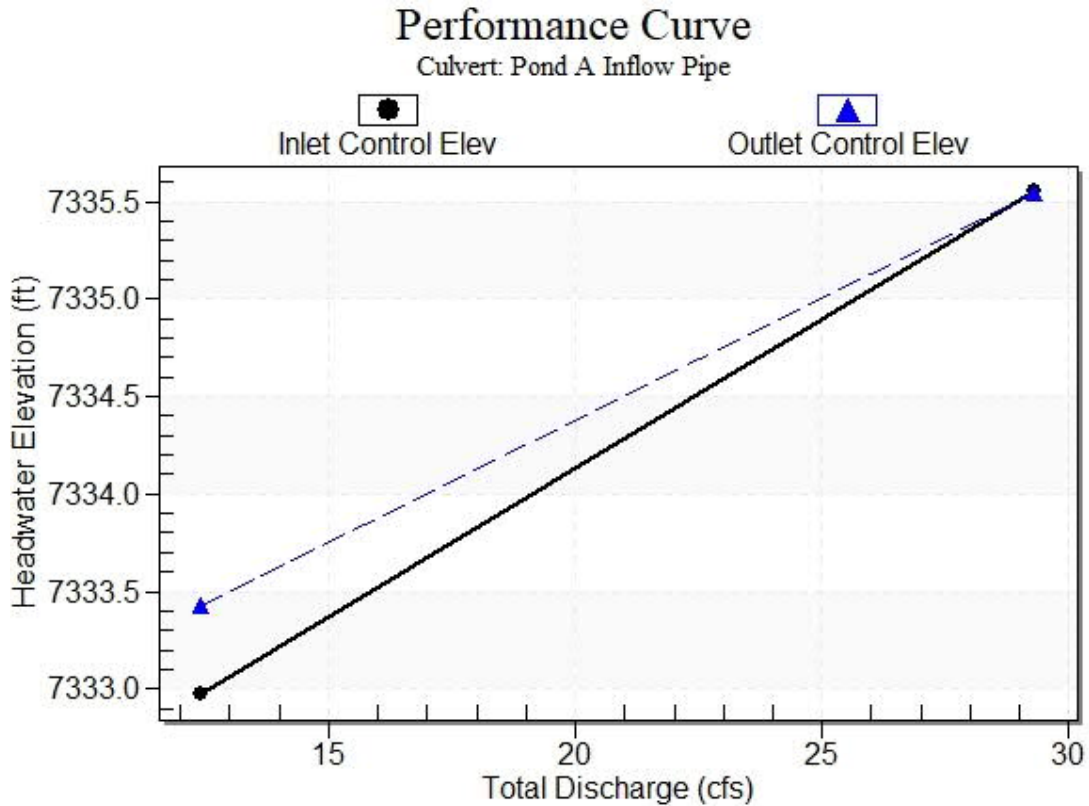

Water Surface Profile Plot for Culvert: Pond A Inflow Pipe

Crossing - Pond A Inflow-100 yr (DP5.1), Design Discharge - 12.4 cfs

Culvert - Pond A Inflow Pipe, Culvert Discharge - 12.4 cfs

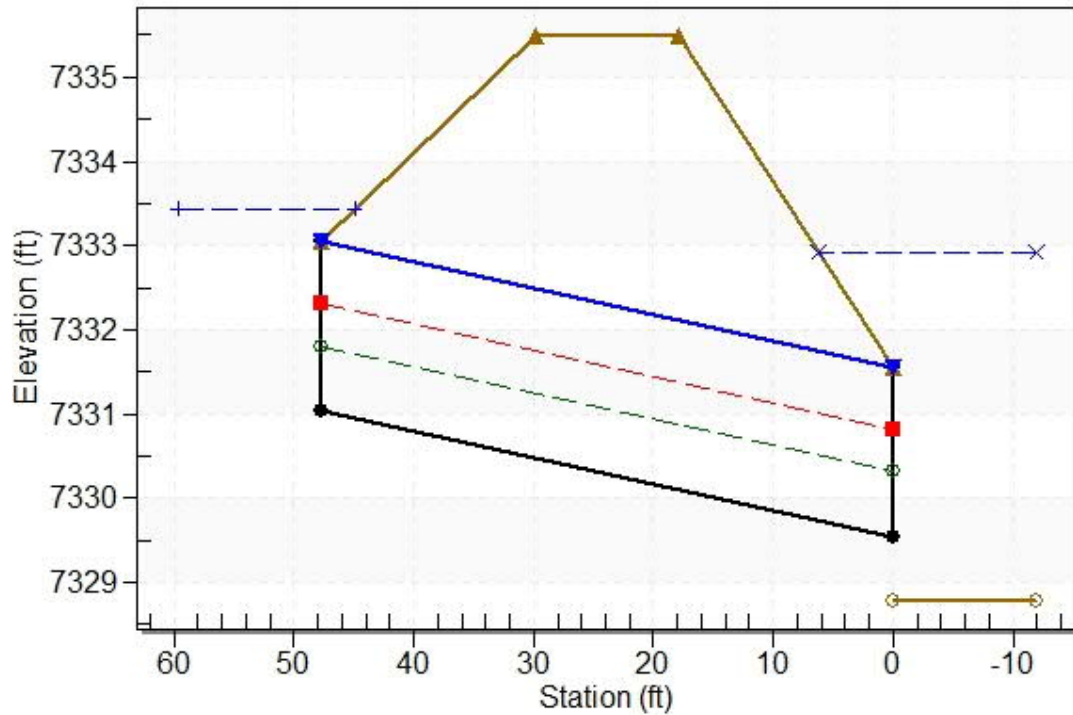

Site Data - Pond A Inflow Pipe

Site Data Option: Culvert Invert Data

Inlet Station: 47.68 ft

Inlet Elevation: 7331.04 ft

Outlet Station: 0.00 ft

Outlet Elevation: 7329.55 ft

Number of Barrels: 1

Culvert Data Summary - Pond A Inflow Pipe

Barrel Shape: Circular

Barrel Diameter: 2.00 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Square Edge with Headwall

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (Crossing: Pond A Inflow-100 yr (DP5.1))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13
12.40	7332.92	4.13

Tailwater Channel Data - Pond A Inflow-100 yr (DP5.1)

Tailwater Channel Option: Enter Constant Tailwater Elevation
 Constant Tailwater Elevation: 7332.92 ft

Roadway Data for Crossing: Pond A Inflow-100 yr (DP5.1)

Roadway Profile Shape: Constant Roadway Elevation
 Crest Length: 50.00 ft
 Crest Elevation: 7335.50 ft
 Roadway Surface: Gravel
 Roadway Top Width: 12.00 ft

HY-8 Culvert Analysis Report

Basin J Culvert 5-yr (DP10)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 0.5 cfs

Design Flow: 0.5 cfs

Maximum Flow: 0.5 cfs

Table 1 - Summary of Culvert Flows at Crossing: Basin J Culvert 5-year (DP10)

Headwater Elevation (ft)	Total Discharge (cfs)	Basin J Culvert Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7348.96	0.50	0.50	0.00	1
7354.88	18.12	18.12	0.00	Overtopping

Rating Curve Plot for Crossing: Basin J Culvert 5-year (DP10)

Total Rating Curve

Crossing: Basin J Culvert 5-year (DP10)

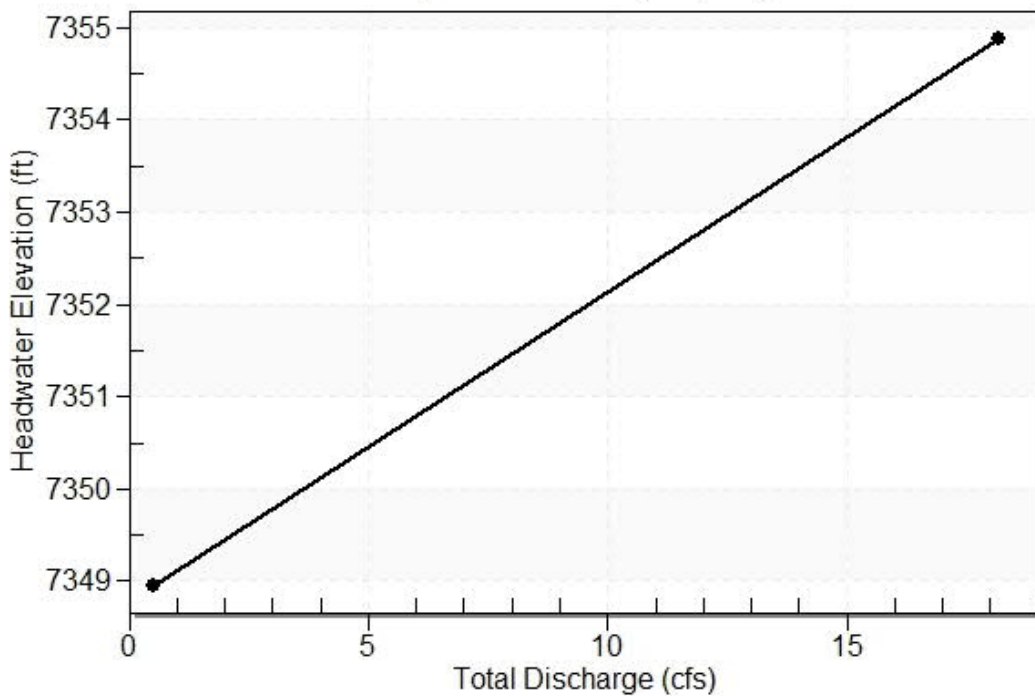



Table 2 - Culvert Summary Table: Basin J Culvert

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851
0.50	0.50	7348.96	0.410	0.0*	1-S2n	0.133	0.262	0.133	0.187	6.431	2.851

* Full Flow Headwater elevation is below inlet invert.

 Straight Culvert
 Inlet Elevation (invert): 7348.55 ft, Outlet Elevation (invert): 7334.90 ft
 Culvert Length: 167.96 ft, Culvert Slope: 0.0815


Culvert Performance Curve Plot: Basin J Culvert

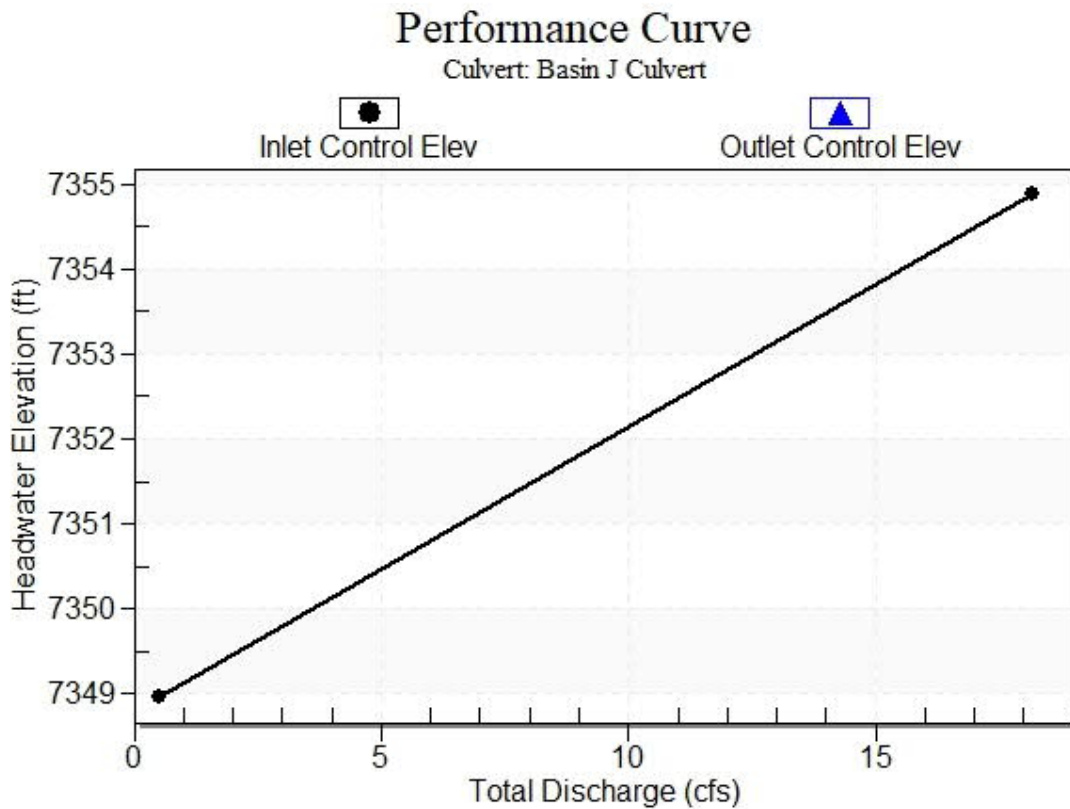

Water Surface Profile Plot for Culvert: Basin J Culvert

Crossing - Basin J Culvert 5-year (DP10), Design Discharge - 0.5 cfs

Culvert - Basin J Culvert, Culvert Discharge - 0.5 cfs

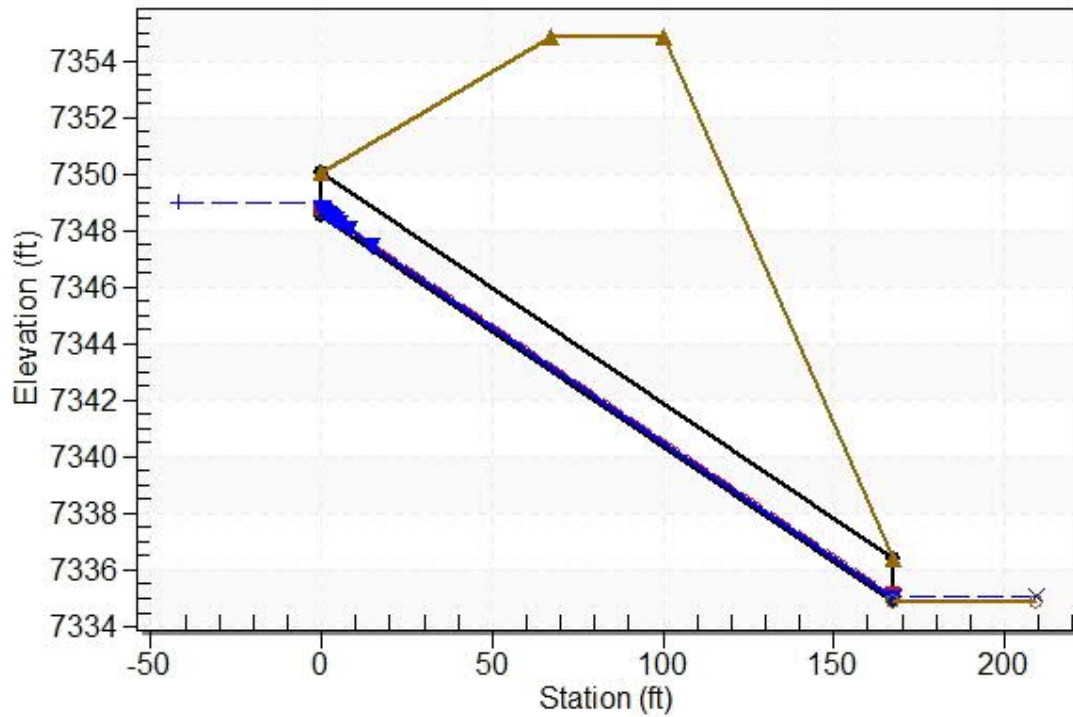

Site Data - Basin J Culvert

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 7348.55 ft

Outlet Station: 167.40 ft

Outlet Elevation: 7334.90 ft

Number of Barrels: 1

Culvert Data Summary - Basin J Culvert

Barrel Shape: Circular

Barrel Diameter: 1.50 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Mitered to Conform to Slope

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (X-ing: Basin J Culvert 5-year (DP10))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64
0.50	7335.09	0.19	2.85	0.93	1.64

Tailwater Channel Data - Basin J Culvert 5-year (DP10)

Tailwater Channel Option: Triangular Channel
Side Slope (H:V): 5.00 (_:1)
Channel Slope: 0.0800
Channel Manning's n: 0.0300
Channel Invert Elevation: 7334.90 ft

Roadway Data for Crossing: Basin J Culvert 5-year (DP10)

Roadway Profile Shape: Constant Roadway Elevation
Crest Length: 100.00 ft
Crest Elevation: 7354.88 ft
Roadway Surface: Paved
Roadway Top Width: 33.00 ft

HY-8 Culvert Analysis Report

Basin J Culvert 100-yr (DP10)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 2.5 cfs

Design Flow: 2.5 cfs

Maximum Flow: 2.5 cfs

Table 1 - Summary of Culvert Flows at Crossing: Basin J Culvert 100-year (DP10)

Headwater Elevation (ft)	Total Discharge (cfs)	Basin J Culvert Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7349.50	2.50	2.50	0.00	1
7354.88	18.11	18.11	0.00	Overtopping

Rating Curve Plot for Crossing: Basin J Culvert 100-year (DP10)

Total Rating Curve

Crossing: Basin J Culvert 100-year (DP10)

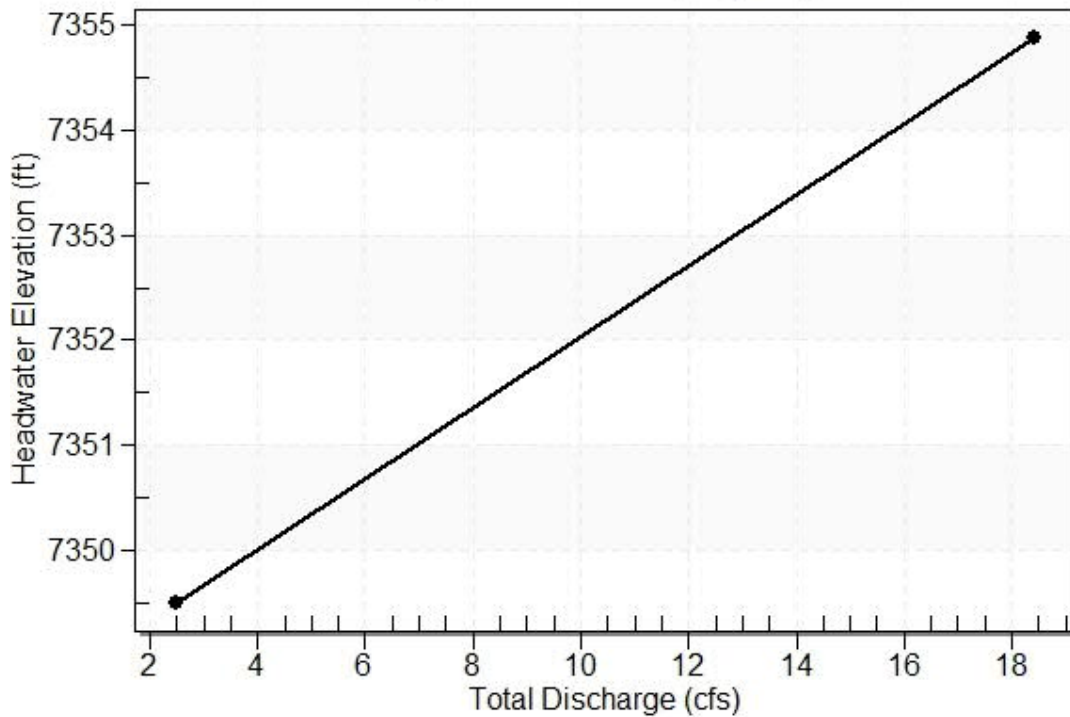



Table 2 - Culvert Summary Table: Basin J Culvert

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264
2.50	2.50	7349.50	0.954	0.0*	1-S2n	0.292	0.599	0.292	0.342	10.322	4.264

* Full Flow Headwater elevation is below inlet invert.

 Straight Culvert
 Inlet Elevation (invert): 7348.55 ft, Outlet Elevation (invert): 7334.90 ft
 Culvert Length: 167.96 ft, Culvert Slope: 0.0815


Culvert Performance Curve Plot: Basin J Culvert

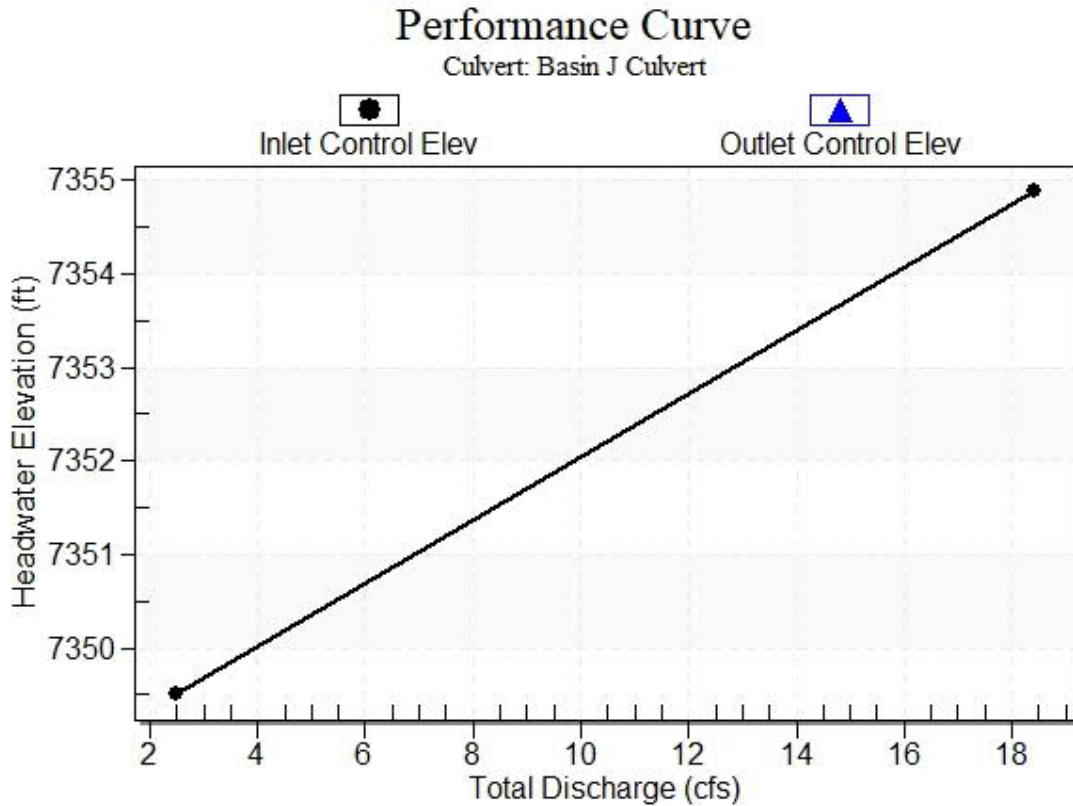

Water Surface Profile Plot for Culvert: Basin J Culvert

Crossing - Basin J Culvert 100-year (DP10), Design Discharge - 2.5 cfs

Culvert - Basin J Culvert, Culvert Discharge - 2.5 cfs

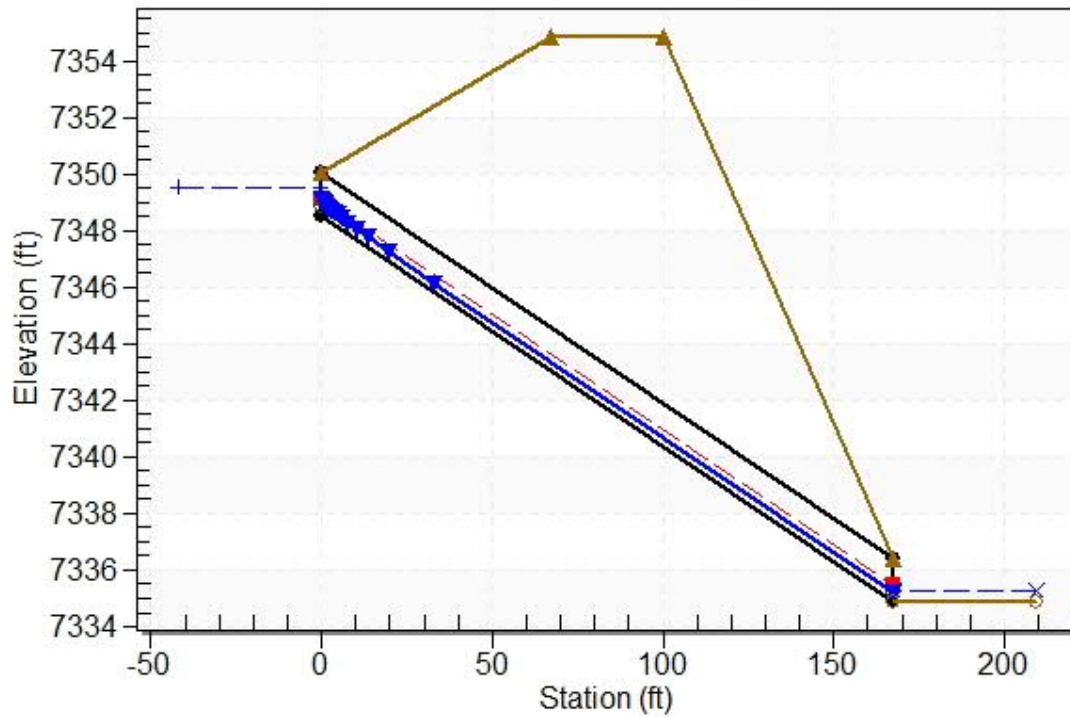

Site Data - Basin J Culvert

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 7348.55 ft

Outlet Station: 167.40 ft

Outlet Elevation: 7334.90 ft

Number of Barrels: 1

Culvert Data Summary - Basin J Culvert

Barrel Shape: Circular

Barrel Diameter: 1.50 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Mitered to Conform to Slope

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (X-ing: Basin J Culvert 100-year (DP10))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82
2.50	7335.24	0.34	4.26	1.71	1.82

Tailwater Channel Data - Basin J Culvert 100-year (DP10)

Tailwater Channel Option: Triangular Channel
Side Slope (H:V): 5.00 (_:1)
Channel Slope: 0.0800
Channel Manning's n: 0.0300
Channel Invert Elevation: 7334.90 ft

Roadway Data for Crossing: Basin J Culvert 100-year (DP10)

Roadway Profile Shape: Constant Roadway Elevation
Crest Length: 100.00 ft
Crest Elevation: 7354.88 ft
Roadway Surface: Paved
Roadway Top Width: 33.00 ft

HY-8 Culvert Analysis Report

Pond B Maint. Trail 5-yr (DP13)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 1 cfs

Design Flow: 1 cfs

Maximum Flow: 1 cfs

Table 1 - Summary of Culvert Flows at Crossing: Pond B Maint. Trail-5 yr (DP13)

Headwater Elevation (ft)	Total Discharge (cfs)	Pond B Culvert Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7341.80	1.00	1.00	0.00	1
7342.94	3.73	3.73	0.00	Overtopping

Rating Curve Plot for Crossing: Pond B Maint. Trail-5 yr (DP13)

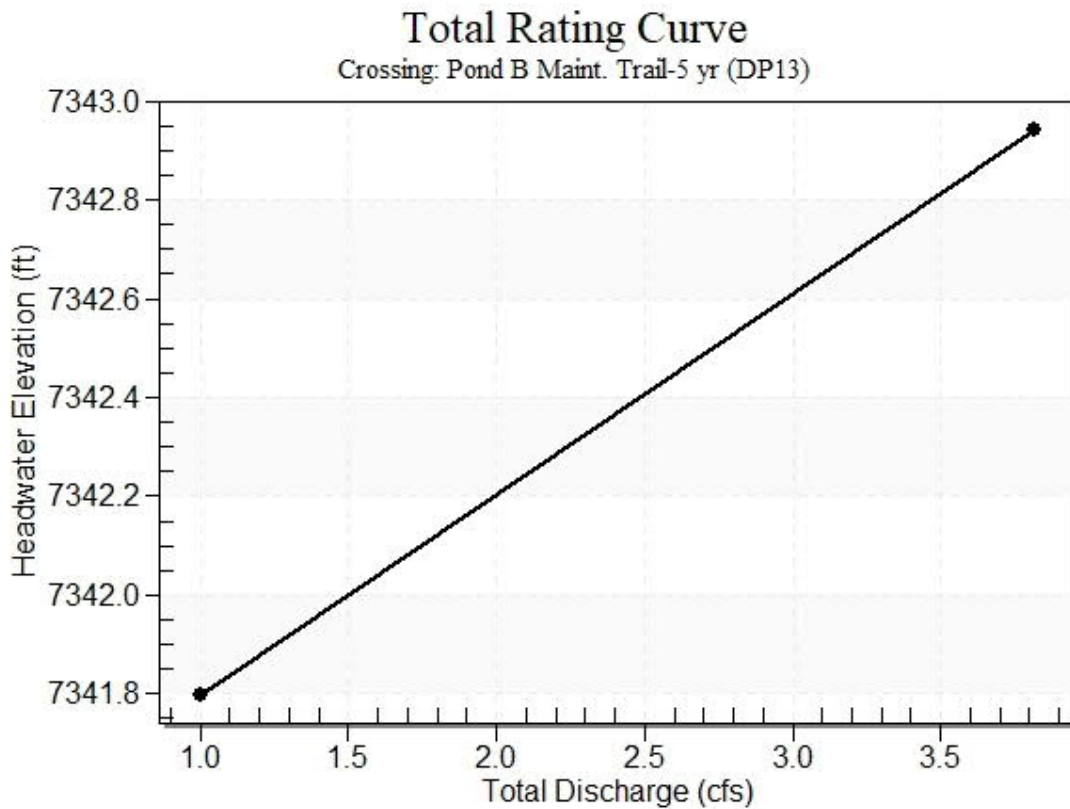



Table 2 - Culvert Summary Table: Pond B Culvert

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337
1.00	1.00	7341.80	0.630	0.0*	1-S2n	0.283	0.420	0.285	0.350	5.429	2.337

* Full Flow Headwater elevation is below inlet invert.


 Straight Culvert
 Inlet Elevation (invert): 7341.17 ft, Outlet Elevation (invert): 7340.27 ft
 Culvert Length: 35.01 ft, Culvert Slope: 0.0257

Culvert Performance Curve Plot: Pond B Culvert

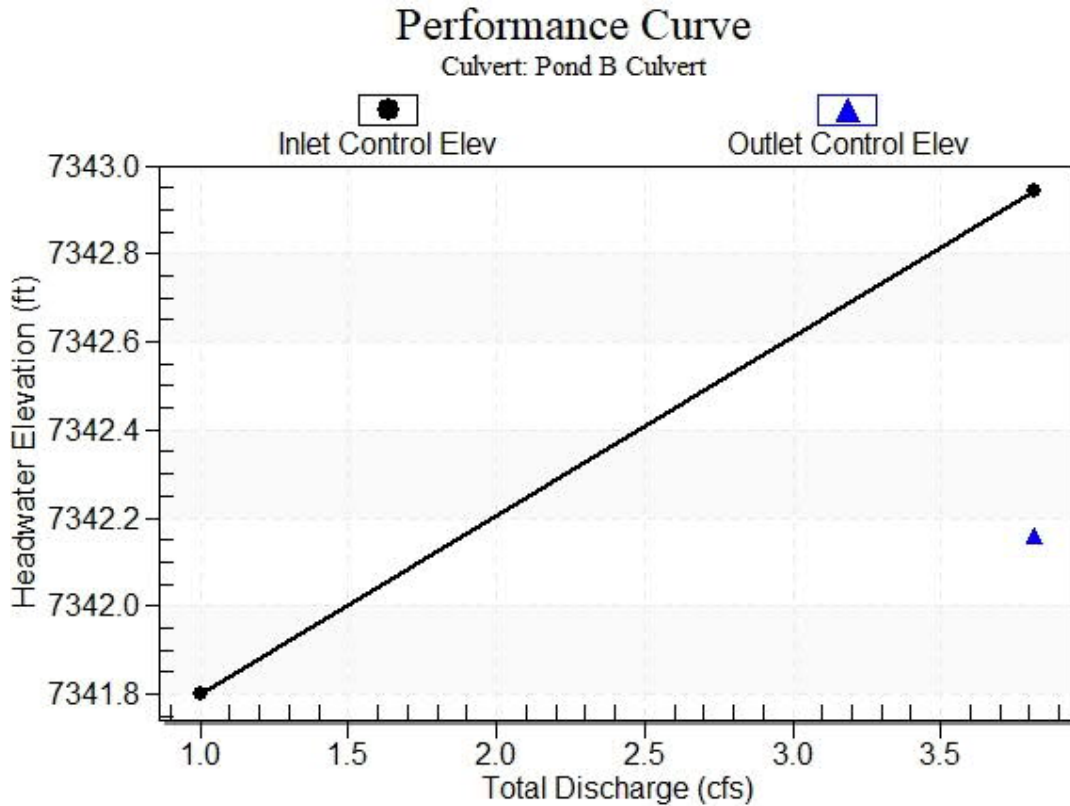

Water Surface Profile Plot for Culvert: Pond B Culvert

Crossing - Pond B Maint. Trail-5 yr (DP13), Design Discharge - 1.0 cfs
Culvert - Pond B Culvert, Culvert Discharge - 1.0 cfs

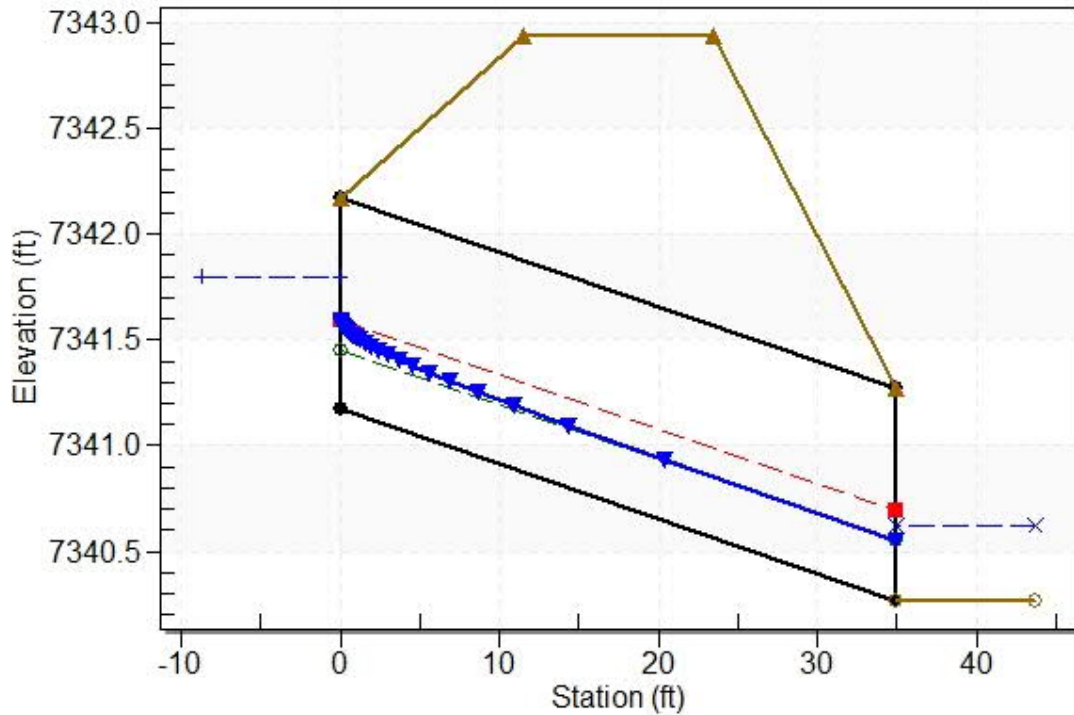

Site Data - Pond B Culvert

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 7341.17 ft

Outlet Station: 35.00 ft

Outlet Elevation: 7340.27 ft

Number of Barrels: 1

Culvert Data Summary - Pond B Culvert

Barrel Shape: Circular

Barrel Diameter: 1.00 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Mitered to Conform to Slope

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (X-ing: Pond B Maint. Trail-5 yr (DP13))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99
1.00	7340.62	0.35	2.34	0.52	0.99

Tailwater Channel Data - Pond B Maint. Trail-5 yr (DP13)

Tailwater Channel Option: Triangular Channel

Side Slope (H:V): 3.50 (_:1)

Channel Slope: 0.0240

Channel Manning's n: 0.0300

Channel Invert Elevation: 7340.27 ft

Roadway Data for Crossing: Pond B Maint. Trail-5 yr (DP13)

Roadway Profile Shape: Constant Roadway Elevation

Crest Length: 100.00 ft

Crest Elevation: 7342.94 ft

Roadway Surface: Gravel

Roadway Top Width: 12.00 ft

HY-8 Culvert Analysis Report

Pond B Maint. Trail 100-yr (DP13)

Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 2.5 cfs

Design Flow: 2.5 cfs

Maximum Flow: 2.5 cfs

Table 1 - Summary of Culvert Flows at Crossing: Pond B Maint. Trail-100 yr (DP13)

Headwater Elevation (ft)	Total Discharge (cfs)	Pond B Culvert Discharge (cfs)	Roadway Discharge (cfs)	Iterations
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.31	2.50	2.50	0.00	1
7342.94	3.73	3.73	0.00	Overtopping

Rating Curve Plot for Crossing: Pond B Maint. Trail-100 yr (DP13)

Total Rating Curve

Crossing: Pond B Maint. Trail-100 yr (DP13)


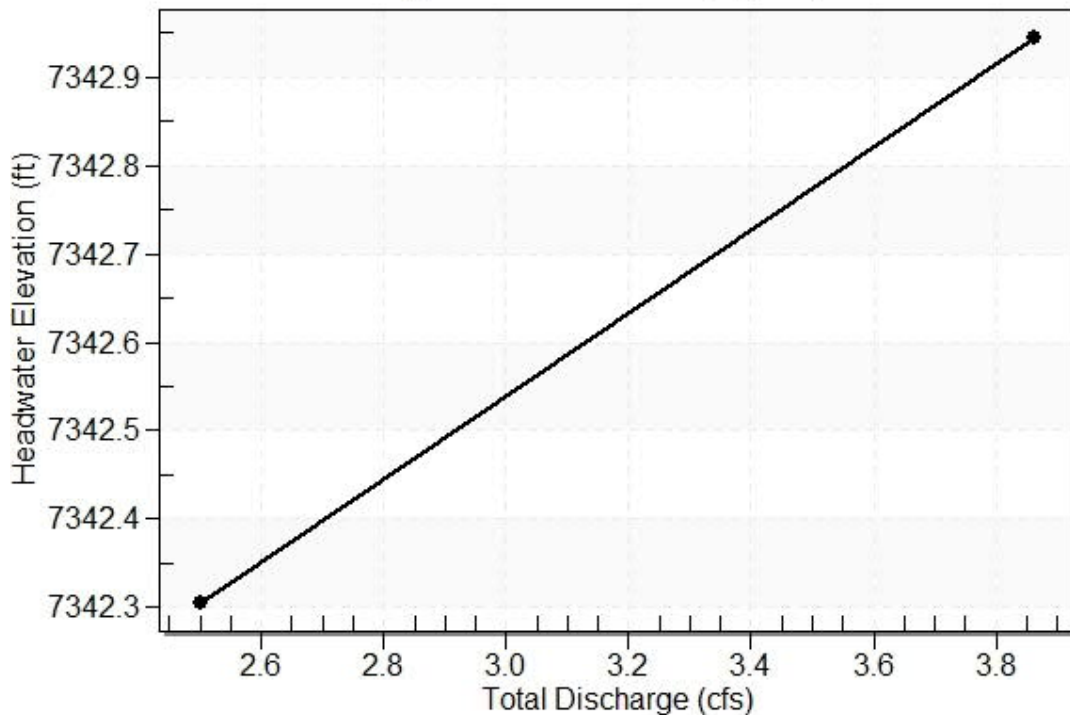


Table 2 - Culvert Summary Table: Pond B Culvert

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939
2.50	2.50	7342.31	1.136	0.216	5-S2n	0.462	0.677	0.474	0.493	6.824	2.939


 Straight Culvert
 Inlet Elevation (invert): 7341.17 ft, Outlet Elevation (invert): 7340.27 ft
 Culvert Length: 35.01 ft, Culvert Slope: 0.0257

Culvert Performance Curve Plot: Pond B Culvert

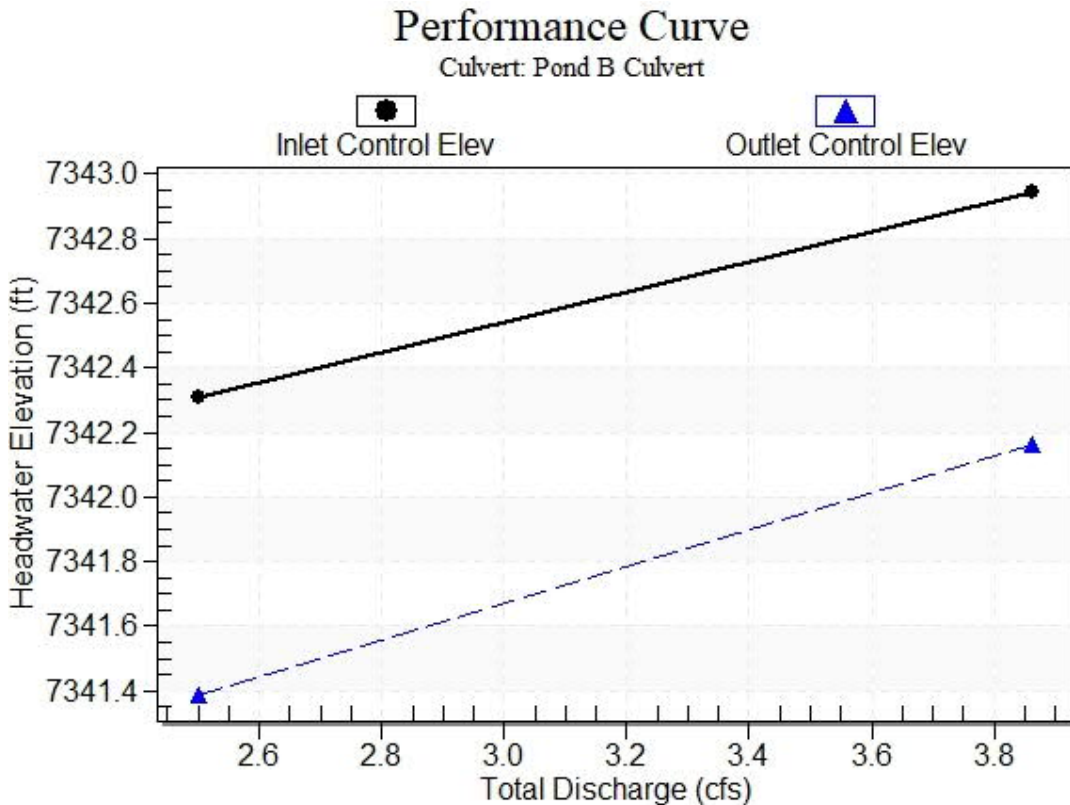

Water Surface Profile Plot for Culvert: Pond B Culvert

Crossing - Pond B Maint. Trail-100 yr (DP13), Design Discharge - 2.5 cfs
Culvert - Pond B Culvert, Culvert Discharge - 2.5 cfs

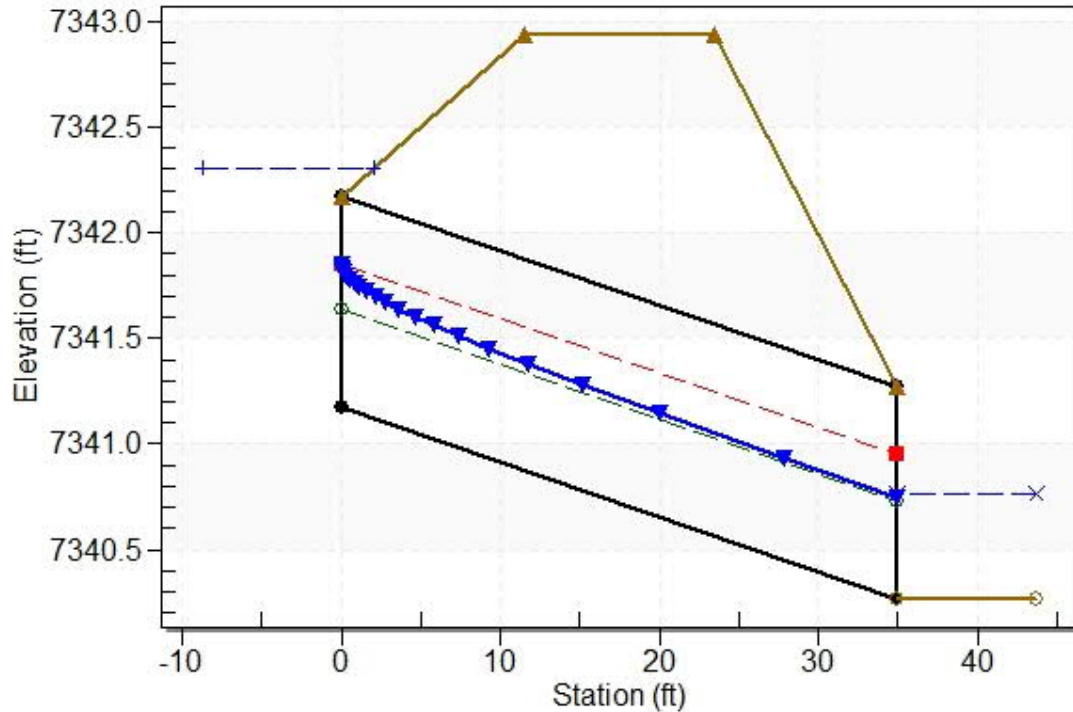

Site Data - Pond B Culvert

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 7341.17 ft

Outlet Station: 35.00 ft

Outlet Elevation: 7340.27 ft

Number of Barrels: 1

Culvert Data Summary - Pond B Culvert

Barrel Shape: Circular

Barrel Diameter: 1.00 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0130

Culvert Type: Straight

Inlet Configuration: Mitered to Conform to Slope

Inlet Depression: None

Table 3 - Downstream Channel Rating Curve (X-in: Pond B Maint. Trail-100 yr (DP13))

Flow (cfs)	Water Surface Elev (ft)	Depth (ft)	Velocity (ft/s)	Shear (psf)	Froude Number
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04
2.50	7340.76	0.49	2.94	0.74	1.04

Tailwater Channel Data - Pond B Maint. Trail-100 yr (DP13)

Tailwater Channel Option: Triangular Channel

Side Slope (H:V): 3.50 (_:1)

Channel Slope: 0.0240

Channel Manning's n: 0.0300

Channel Invert Elevation: 7340.27 ft

Roadway Data for Crossing: Pond B Maint. Trail-100 yr (DP13)

Roadway Profile Shape: Constant Roadway Elevation

Crest Length: 100.00 ft

Crest Elevation: 7342.94 ft

Roadway Surface: Gravel

Roadway Top Width: 12.00 ft

INLET MANAGEMENT

Worksheet Protected

INLET NAME	DP13.1
Site Type (Urban or Rural)	RURAL
Inlet Application (Street or Area)	AREA
Hydraulic Condition	Swale
Inlet Type	CDOT Type C

USER-DEFINED INPUT


User-Defined Design Flows	
Minor Q_{Known} (cfs)	7.1
Major Q_{Known} (cfs)	20.2
Bypass (Carry-Over) Flow from Upstream Inlets must be organized from upstream (let	
Receive Bypass Flow from:	No Bypass Flow Received
Minor Bypass Flow Received, Q_b (cfs)	0.0
Major Bypass Flow Received, Q_b (cfs)	0.0
Watershed Characteristics	
Subcatchment Area (acres)	
Percent Impervious	
NRCS Soil Type	
Watershed Profile	
Overland Slope (ft/ft)	
Overland Length (ft)	
Channel Slope (ft/ft)	
Channel Length (ft)	
Minor Storm Rainfall Input	
Design Storm Return Period, T_r (years)	
One-Hour Precipitation, P_1 (inches)	
Major Storm Rainfall Input	
Design Storm Return Period, T_r (years)	
One-Hour Precipitation, P_1 (inches)	

CALCULATED OUTPUT

Minor Total Design Peak Flow, Q (cfs)	7.1
Major Total Design Peak Flow, Q (cfs)	20.2
Minor Flow Bypassed Downstream, Q_b (cfs)	0.0
Major Flow Bypassed Downstream, Q_b (cfs)	0.0

AREA INLET IN A SWALE

Estates at Cathedral Pines
DP13.1

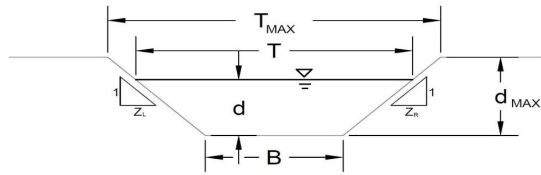

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.
For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method		
NRCS Vegetal Retardance (A, B, C, D, or E)	A, B, C, D, or E =	
Manning's n (Leave cell D16 blank to manually enter an n value)	n =	0.030
Channel Invert Slope	S ₀ =	0.0010 ft/ft
Bottom Width	B =	0.00 ft
Left Side Slope	Z1 =	4.00 ft/ft
Right Side Slope	Z2 =	3.00 ft/ft
Check one of the following soil types:		
Soil Type:	Max. Velocity (V _{max})	Max. Froude No. (F _{max})
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A
Choose One:		
<input type="radio"/> Non-Cohesive		
<input type="radio"/> Cohesive		
<input type="radio"/> Paved		
Maximum Allowable Top Width of Channel for Minor & Major Storm	T _{MAX} =	Minor Storm: 21.00 ft, Major Storm: 21.00 ft
Maximum Allowable Water Depth in Channel for Minor & Major Storm	d _{MAX} =	Minor Storm: 3.00 ft, Major Storm: 3.00 ft
Allowable Channel Capacity Based On Channel Geometry		
MINOR STORM Allowable Capacity is based on Depth Criterion		
MAJOR STORM Allowable Capacity is based on Depth Criterion		
Water Depth in Channel Based On Design Peak Flow	Q _{allow} =	Minor Storm: 63.1 cfs, Major Storm: 63.1 cfs
Design Peak Flow	d _{allow} =	Minor Storm: 3.00 ft, Major Storm: 3.00 ft
Water Depth	Q _o =	7.1 cfs
	d =	1.32 ft
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'		
Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'		

MHFD-Inlet, Version 5.02 (August 2022)
AREA INLET IN A SWALE

Estates at Cathedral Pines
 DP13.1

Inlet Design Information (Input)	
Type of Inlet	CDOT Type C
Inlet Type =	CDOT Type C
Angle of Inclined Gate (must be ≤ 30 degrees)	$\theta = 0.00$ degrees
Width of Gate	$W = 3.00$ ft
Length of Gate	$L = 3.00$ ft
Open Area Ratio	$A_{RATIO} = 0.70$
Height of Inclined Gate	$H_B = 0.00$ ft
Clogging Factor	$C_f = 0.50$
Grate Discharge Coefficient	$C_d = 0.96$
Orifice Coefficient	$C_o = 0.64$
Weir Coefficient	$C_w = 2.05$
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	$d = 1.32$ MINOR
Total Inlet Interception Capacity (assumes clogged condition)	$d = 1.96$ MAJOR
Bypassed Flow	$Q_a = 18.6$ cfs
Capture Percentage = Q_a/Q_o	$Q_b = 0.0$ cfs
	$C\% = 100$ %

The diagram illustrates a 3D perspective of an area inlet in a swale. The inlet is a rectangular grate with length L and width W . The height of the grate is H_b . The angle of the grate is θ . The flow direction is indicated by an arrow labeled 'FLOW DIRECTION'. The diagram also shows the water depth d at the inlet.

PIPE OUTFALL RIPRAP SIZING CALCULATIONS

Subdivision: Cathedral Pines
 Location: El Paso County

Project Name: Estates at Cathedral Pines
 Project No.: 25260.00
 Calculated By: GAG
 Checked By: _____
 Date: 3/25/24

	STORM DRAIN SYSTEM			Notes
	Pond A Culv. (DP5)	DP10	Pond B Culv. (DP13)	
Q ₁₀₀ (cfs):	3.0	2.5	2.5	
Conduit	Pipe	Pipe	Pipe	
D _c , Pipe Diameter (in):	12	18	12	
W, Box Width (ft):	N/A	N/A	N/A	
H, Box Height (ft):	N/A	N/A	N/A	
Y _t , Tailwater Depth (ft):	0.40	0.60	0.40	If unknown, use Y _t /D _c (or H)=0.4
Y _t /D _c or Y _t /H	0.40	0.40	0.40	
Q/D ^{2.5} or Q/(WH ^{3/2})	3.00	0.91	2.50	
Supercritical?	No	No	No	
Y _n , Normal Depth (ft) [Supercritical]:				
D _a , H _a (in) [Supercritical]:	N/A	N/A	N/A	D _a =(D _c +Y _n)/2
Riprap d ₅₀ (in) [Supercritical]:	N/A	N/A	N/A	
Riprap d ₅₀ (in) [Subcritical]:	2.49	1.13	2.07	
Required Riprap Size:	L	L	L	Fig. 9-38 or Fig. 9-36
d ₅₀ (in):	9	9	9	
Expansion Factor, 1/(2 tan θ):	4.40	6.80	4.80	Read from Fig. 9-35 or 9-36
θ:	0.11	0.07	0.10	
Erosive Soils?	No	No	No	
Area of Flow, A _t (ft ²):	0.43	0.36	0.36	A _t =Q/V
Length of Protection, L _p (ft):	0.3	-6.2	-0.5	L=(1/(2 tan θ))(A _t /Y _t - D)
Min Length (ft)	3.0	4.5	3.0	Min L=3D or 3H
Max Length (ft)	10.0	15.0	10.0	Max L=10D or 10H
Min Bottom Width, T (ft):	1.1	0.6	0.9	T=2*(L _p *tanθ)+W
Design Length (ft)	3.0	4.5	3.0	
Design Width (ft)	1.1	0.6	0.9	
Riprap Depth (in)	18	18	18	Depth=2(d ₅₀)
Type II Bedding Depth (in)*	6	6	6	*Not used if Soil Riprap
Cutoff Wall	No	No	No	
Cutoff Wall Depth (ft)				Depth of Riprap and Base
Cutoff Wall Width (ft)				

Note: No Type II Base to be used if Soil Riprap is specified within the plans
 * For use when the flow in the culvert is supercritical (and less than full).

PIPE OUTFALL RIPRAP SIZING CALCULATIONS

Subdivision: Cathedral Pines
 Location: El Paso County

Project Name: Estates at Cathedral Pines
 Project No.: 25260.00
 Calculated By: GAG
 Checked By: _____
 Date: 3/25/24

	STORM DRAIN SYSTEM			Notes
	Pond A Out(DP6.2)			
Q ₁₀₀ (cfs):	5.5			
Conduit	Pipe			
D _c , Pipe Diameter (in):	18			
W, Box Width (ft):	N/A			
H, Box Height (ft):	N/A			
Y _t , Tailwater Depth (ft):	0.60			If unknown, use Y _t /D _c (or H)=0.4
Y _t /D _c or Y _t /H	0.40			
Q/D ^{2.5} or Q/(WH ^{3/2})	2.00			
Supercritical?	No			
Y _n , Normal Depth (ft) [Supercritical]:				
D _a , H _a (in) [Supercritical]:	N/A			D _a =(D _c +Y _n)/2
Riprap d ₅₀ (in) [Supercritical]:	N/A			
Riprap d ₅₀ (in) [Subcritical]:	2.48			
Required Riprap Size:	L			Fig. 9-38 or Fig. 9-36
d ₅₀ (in):	9			
Expansion Factor, 1/(2 tan θ):	4.50			Read from Fig. 9-35 or 9-36
θ:	0.11			
Erosive Soils?	No			
Area of Flow, A _t (ft ²):	0.79			A _t =Q/V
Length of Protection, L _p (ft):	-0.9			L=(1/(2 tan θ))(A _t /Y _t - D)
Min Length (ft)	4.5			Min L=3D or 3H
Max Length (ft)	15.0			Max L=10D or 10H
Min Bottom Width, T (ft):	1.3			T=2*(L _p *tanθ)+W
Design Length (ft)	4.5			
Design Width (ft)	1.3			
Riprap Depth (in)	18			Depth=2(d ₅₀)
Type II Bedding Depth (in)*	6			*Not used if Soil Riprap
Cutoff Wall	No			
Cutoff Wall Depth (ft)				Depth of Riprap and Base
Cutoff Wall Width (ft)				

Note: No Type II Base to be used if Soil Riprap is specified within the plans
 * For use when the flow in the culvert is supercritical (and less than full).

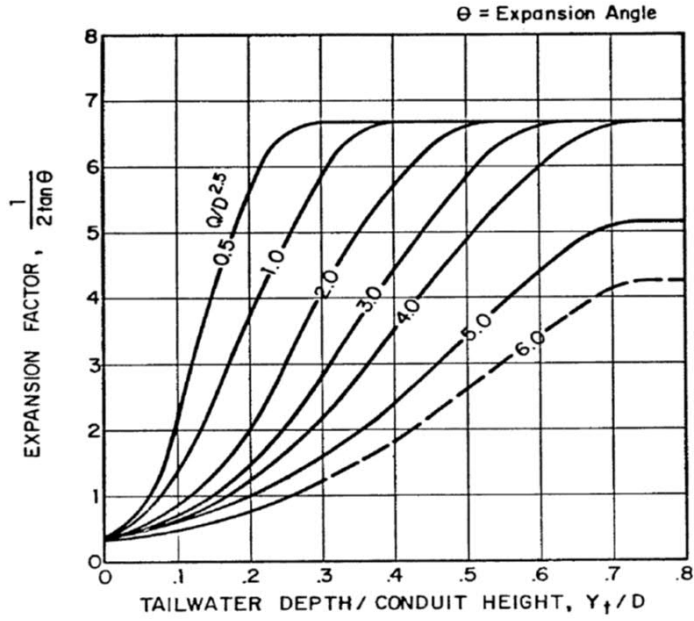


Figure 9-35. Expansion factor for circular conduits


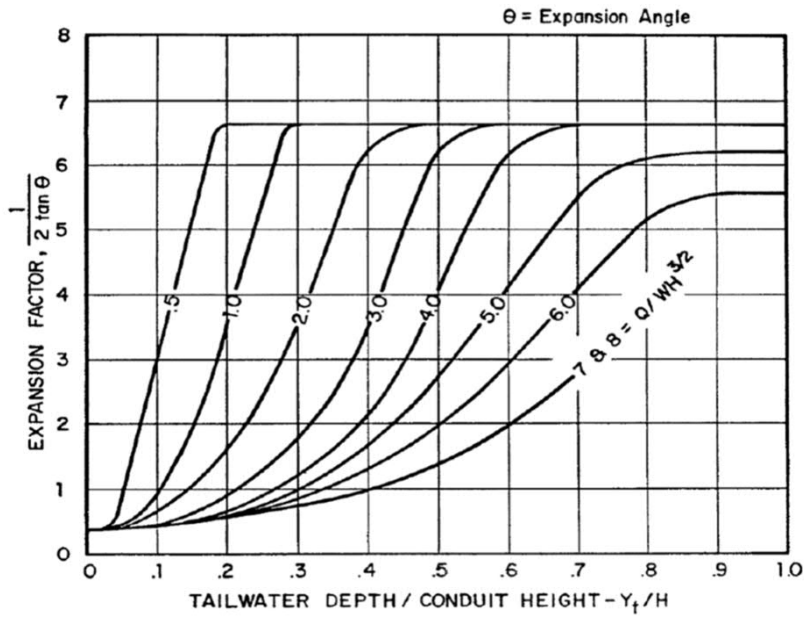


Figure 9-36. Expansion factor for rectangular conduits

DP03-01

DP03-02



Pipe - (7)

**POND A
FULL-SPECTRUM
EDB**

POND A
OUTLET STRUCTURE

**POND B
FULL-SPECTRUM
EDB**

POND B
FOREBAY


TYPE C
INLET

DP07-02

DP06-01

DP06-02

DP07-01



Pipe - (6)

Pipe - (5)

POND B
OUTLET
STRUCTURE



STORMCAD MAP
ESTATES AT CATHEDRAL PINES
JOB NO. 25260.00
03/26/2024
SHEET 1 OF 1



J-R ENGINEERING

A Westrian Company


Centennial 303-740-9393 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com

Scenario: 5-YEAR**Current Time Step: 0.000 h****Conduit FlexTable: Combined Pipe/Node Report**

Label	Upstream Structure	Flow (cfs)	Capacity (Full Flow) (cfs)	Diameter (in)	Length (User Defined) (ft)	Slope (Calculated) (ft/ft)	Invert (Start) (ft)	Invert (Stop) (ft)	Elevation Ground (Start) (ft)	Elevation Ground (Stop) (ft)	HGL (In) (ft)	HGL (Out) (ft)	Energy Grade Line (In) (ft)	Energy Grade Line (Out) (ft)	Velocity (ft/s)	Manning's n	Upstream Structure Headloss Coefficient
Pipe - (5)	DP06-02	7.50	62.83	24.0	56.9	0.077	7,329.80	7,325.41	7,337.97	7,329.08	7,330.77	7,327.33	7,331.15	7,327.42	13.48	0.013	0.100
Pipe - (6)	DP07-02	0.60	12.88	18.0	38.6	0.015	7,323.58	7,323.00	7,327.23	7,323.00	7,323.87	7,323.22	7,323.97	7,323.44	3.72	0.013	0.100
Pipe - (7)	DP03-02	1.20	10.52	18.0	42.9	0.010	7,327.83	7,327.40	7,331.58	7,327.40	7,328.24	7,327.74	7,328.39	7,327.99	3.95	0.013	0.100

X:\2520000.al\2526000\StormCAD\2526000 StormCAD Model.stsw

DPO3 - 5-YEAR

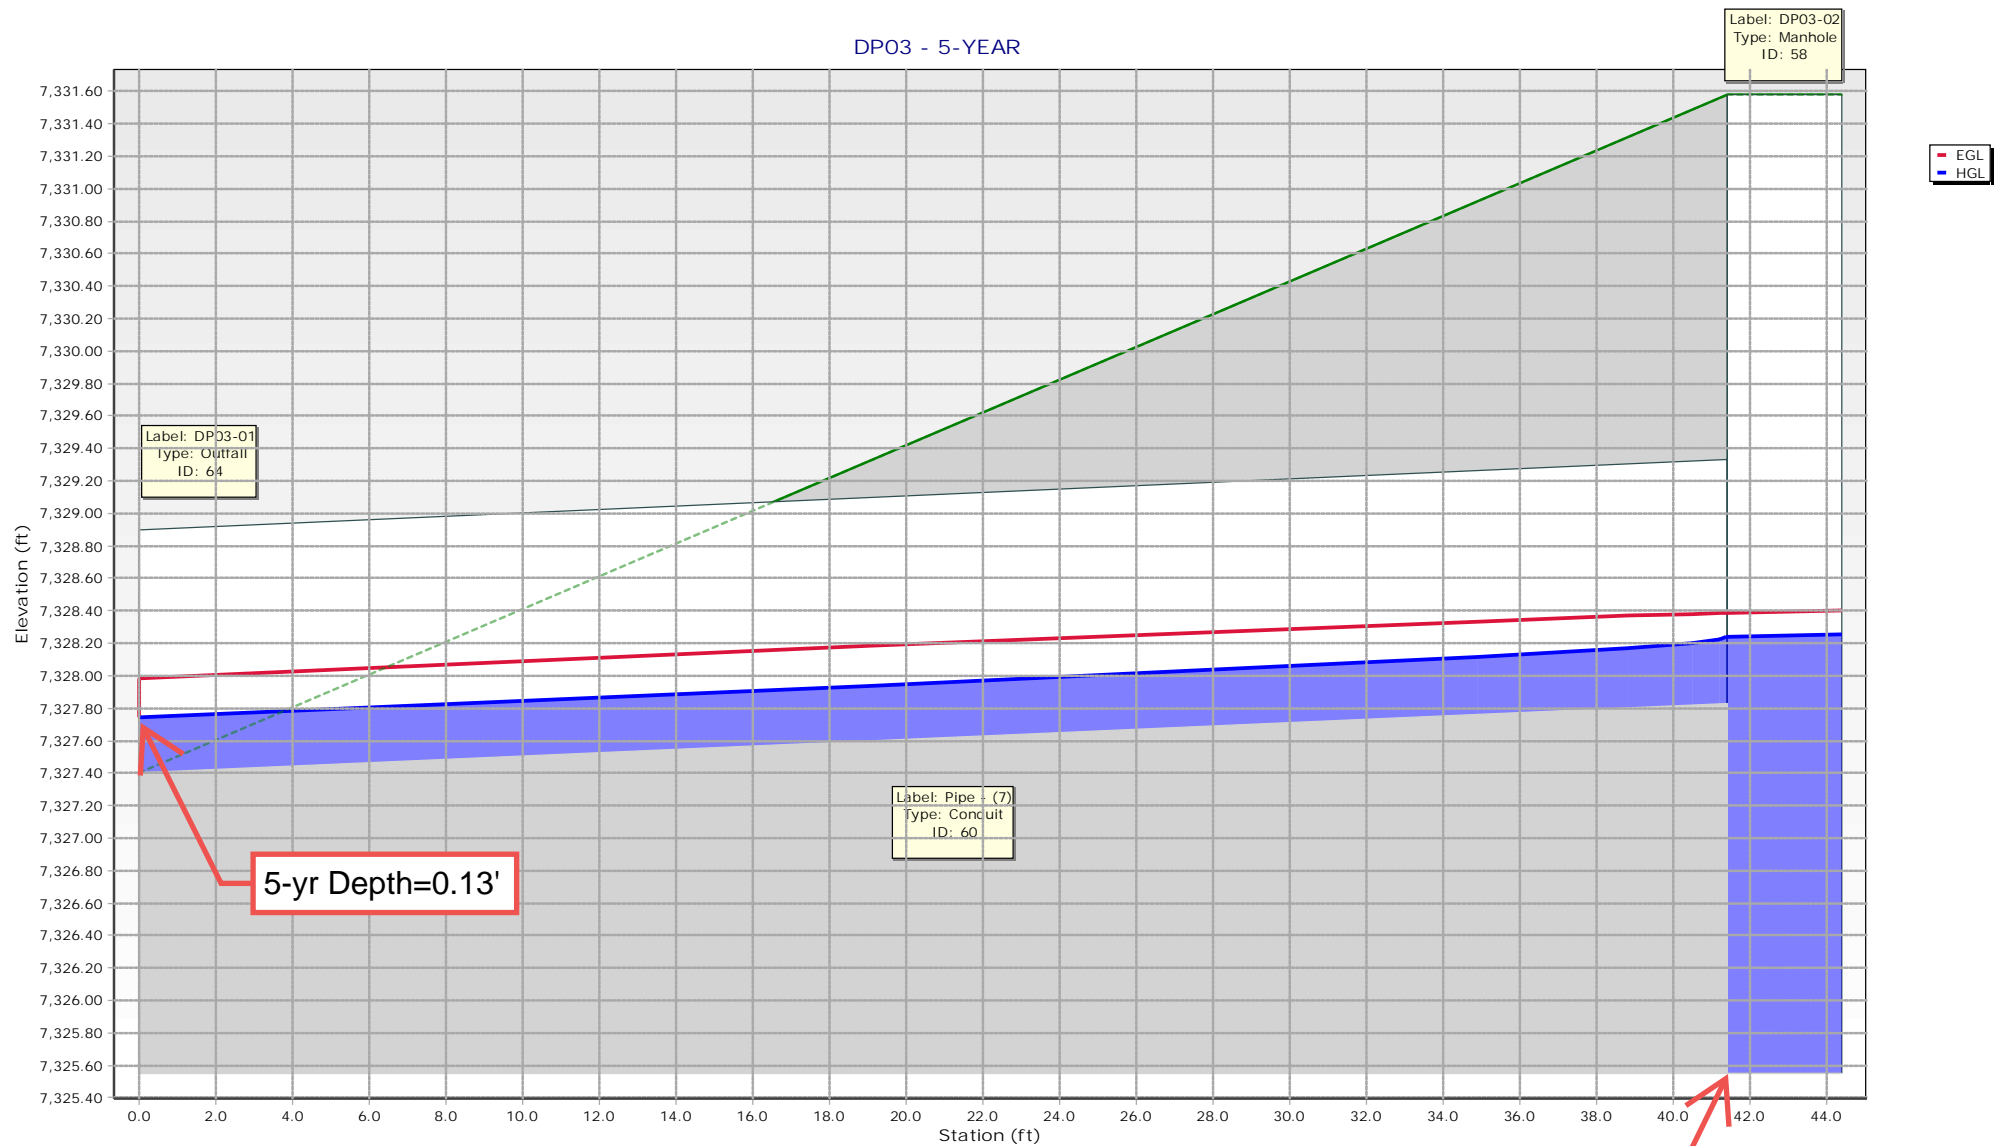

Label: DP03-01
Type: Outfall
ID: 64


Label: Pipe (7)
Type: Conduit
ID: 60

Label: DP03-02
Type: Manhole
ID: 58

5-yr Depth=0.13'

Outlet structure
bottom of micropool

EGL
HGL

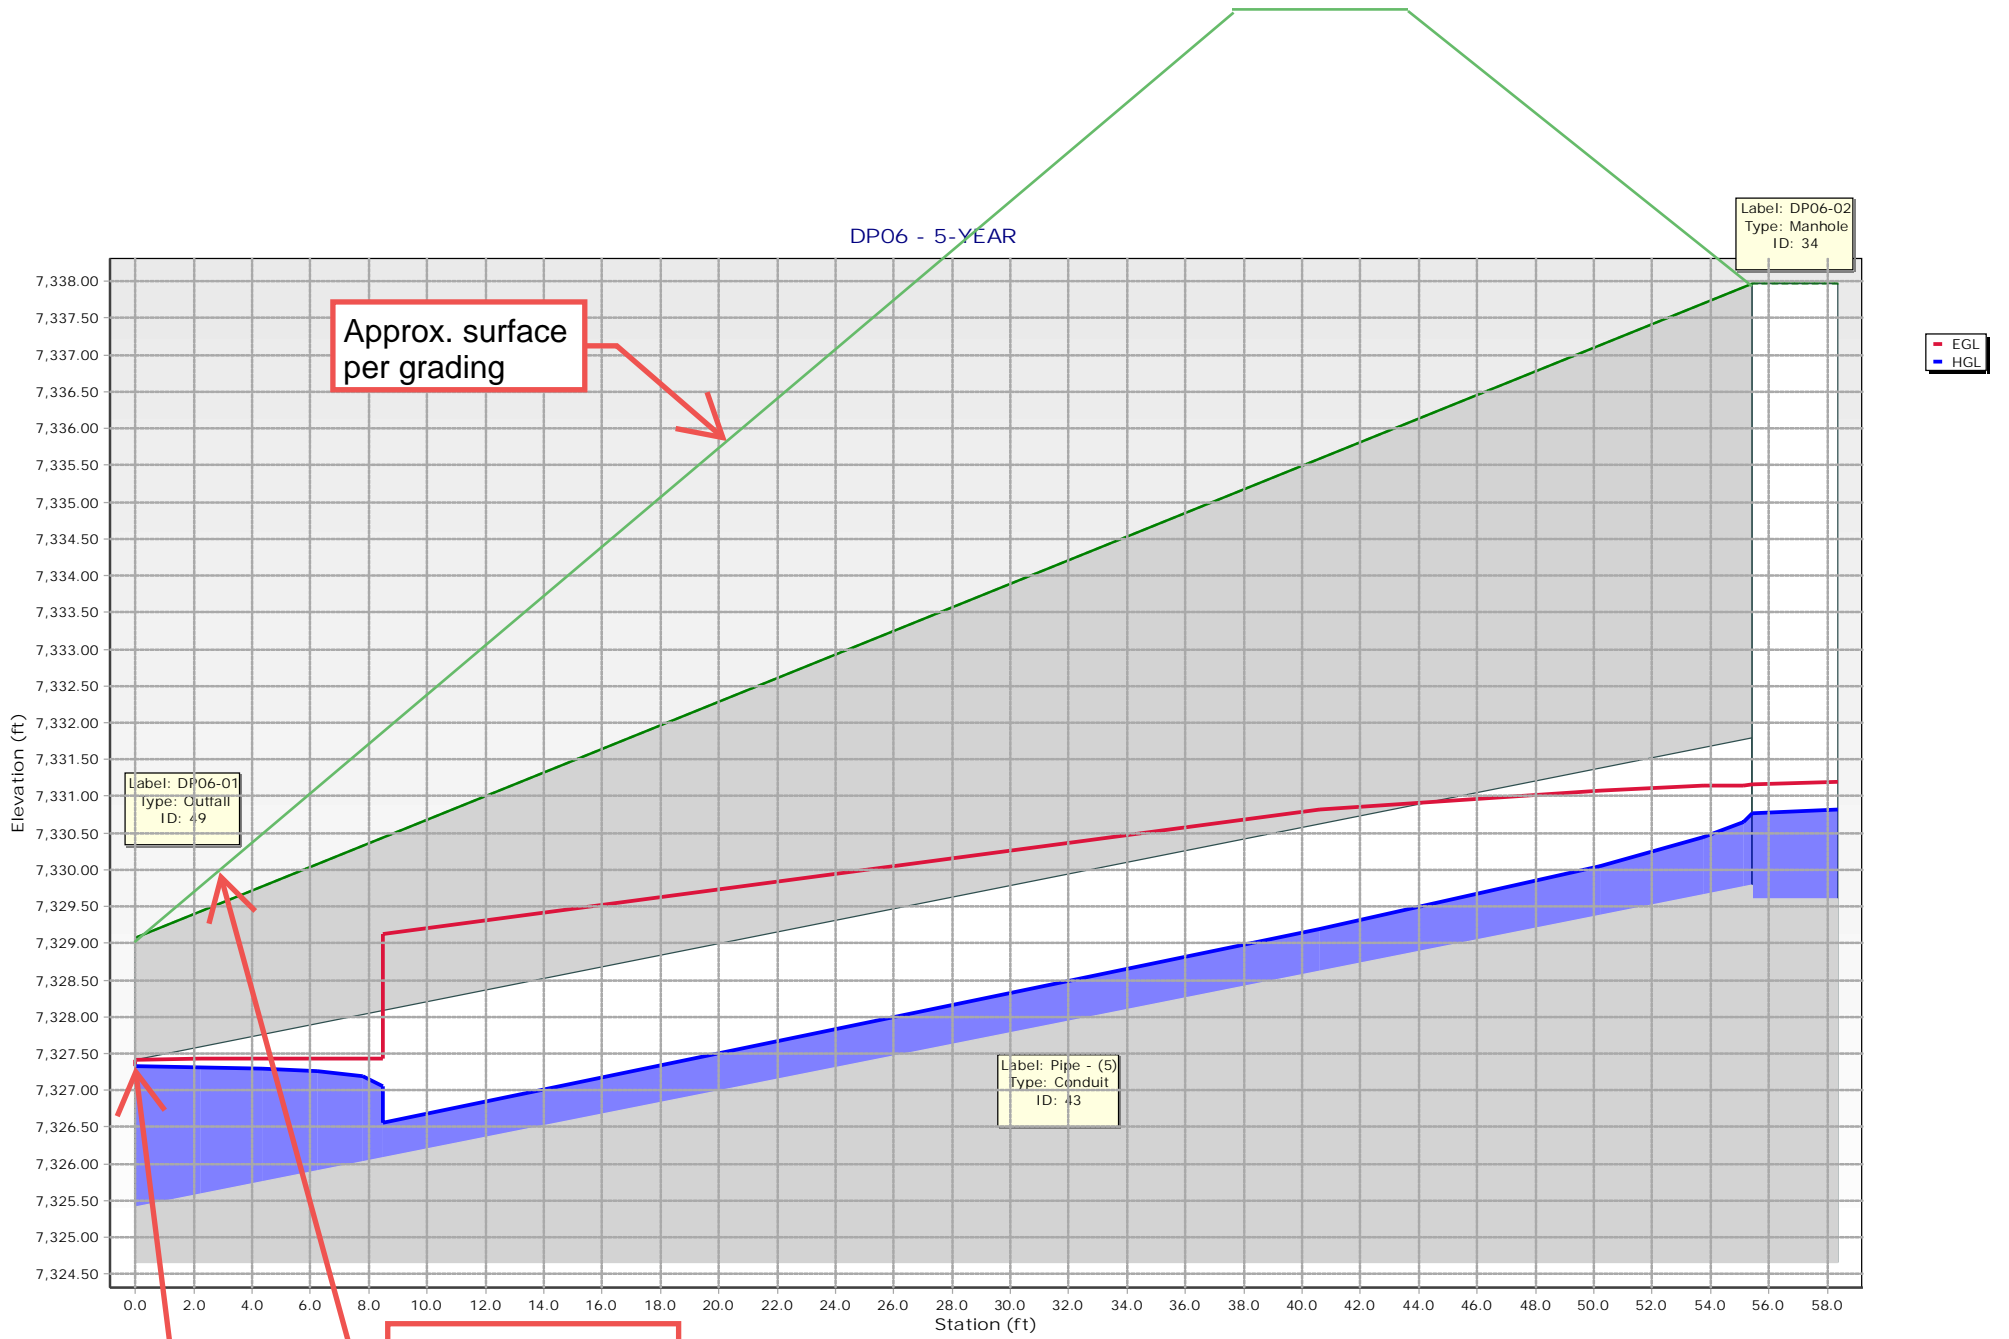

Approx. surface per grading

DPO6 - 5-YEAR

Label: DP06-02
Type: Manhole
ID: 34

EGL
HGL


Label: DP06-01
Type: Outfall
ID: 49

Label: Pipe - (5)
Type: Conduit
ID: 43

Top of pond elevation=7330.00'

5-year tailwater elevation=7327.33'

DPO7 - 5-YEAR

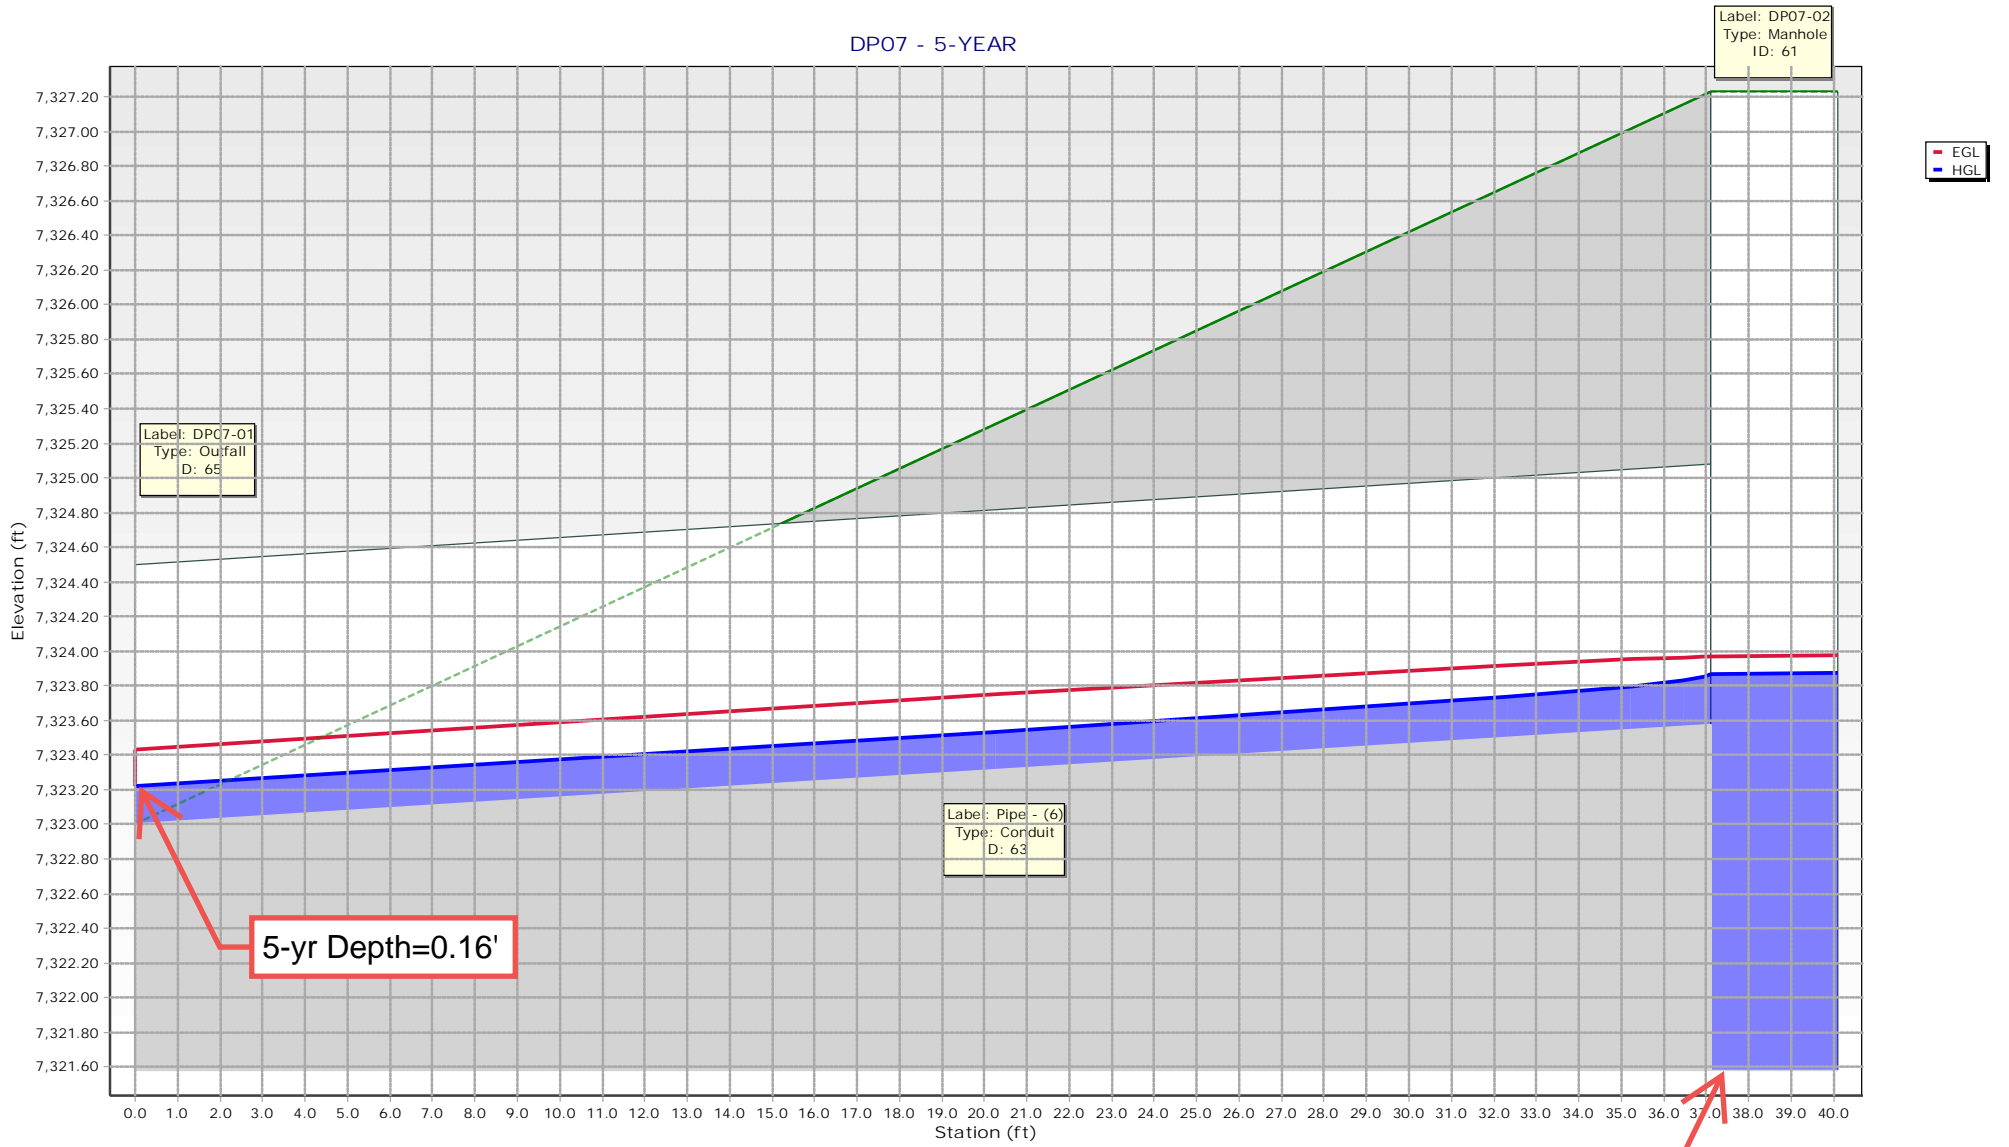

5-yr Depth=0.16'


Outlet structure
bottom of micropool

Scenario: 100-YEAR
Current Time Step: 0.000 h
Conduit FlexTable: Combined Pipe/Node Report

Label	Upstream Structure	Flow (cfs)	Capacity (Full Flow) (cfs)	Diameter (in)	Length (User Defined) (ft)	Slope (Calculated) (ft/ft)	Invert (Start) (ft)	Invert (Stop) (ft)	Elevation Ground (Start) (ft)	Elevation Ground (Stop) (ft)	HGL (In) (ft)	HGL (Out) (ft)	Energy Grade Line (In) (ft)	Energy Grade Line (Out) (ft)	Velocity (ft/s)	Manning's n	Upstream Structure Headloss Coefficient
Pipe - (5)	DP06-02	20.50	62.83	24.0	56.9	0.077	7,329.80	7,325.41	7,337.97	7,329.08	7,331.42	7,327.73	7,332.30	7,328.39	17.89	0.013	0.100
Pipe - (6)	DP07-02	4.30	12.88	18.0	38.6	0.015	7,323.58	7,323.00	7,327.23	7,323.00	7,324.38	7,323.61	7,324.69	7,324.25	6.56	0.013	0.100
Pipe - (7)	DP03-02	7.90	10.52	18.0	42.9	0.010	7,327.83	7,327.40	7,331.58	7,327.40	7,328.92	7,328.37	7,329.43	7,329.03	6.53	0.013	0.100


X:\2520000.al\2526000\StormCAD\2526000 StormCAD Model.stsw

DPO3 - 100-YEAR

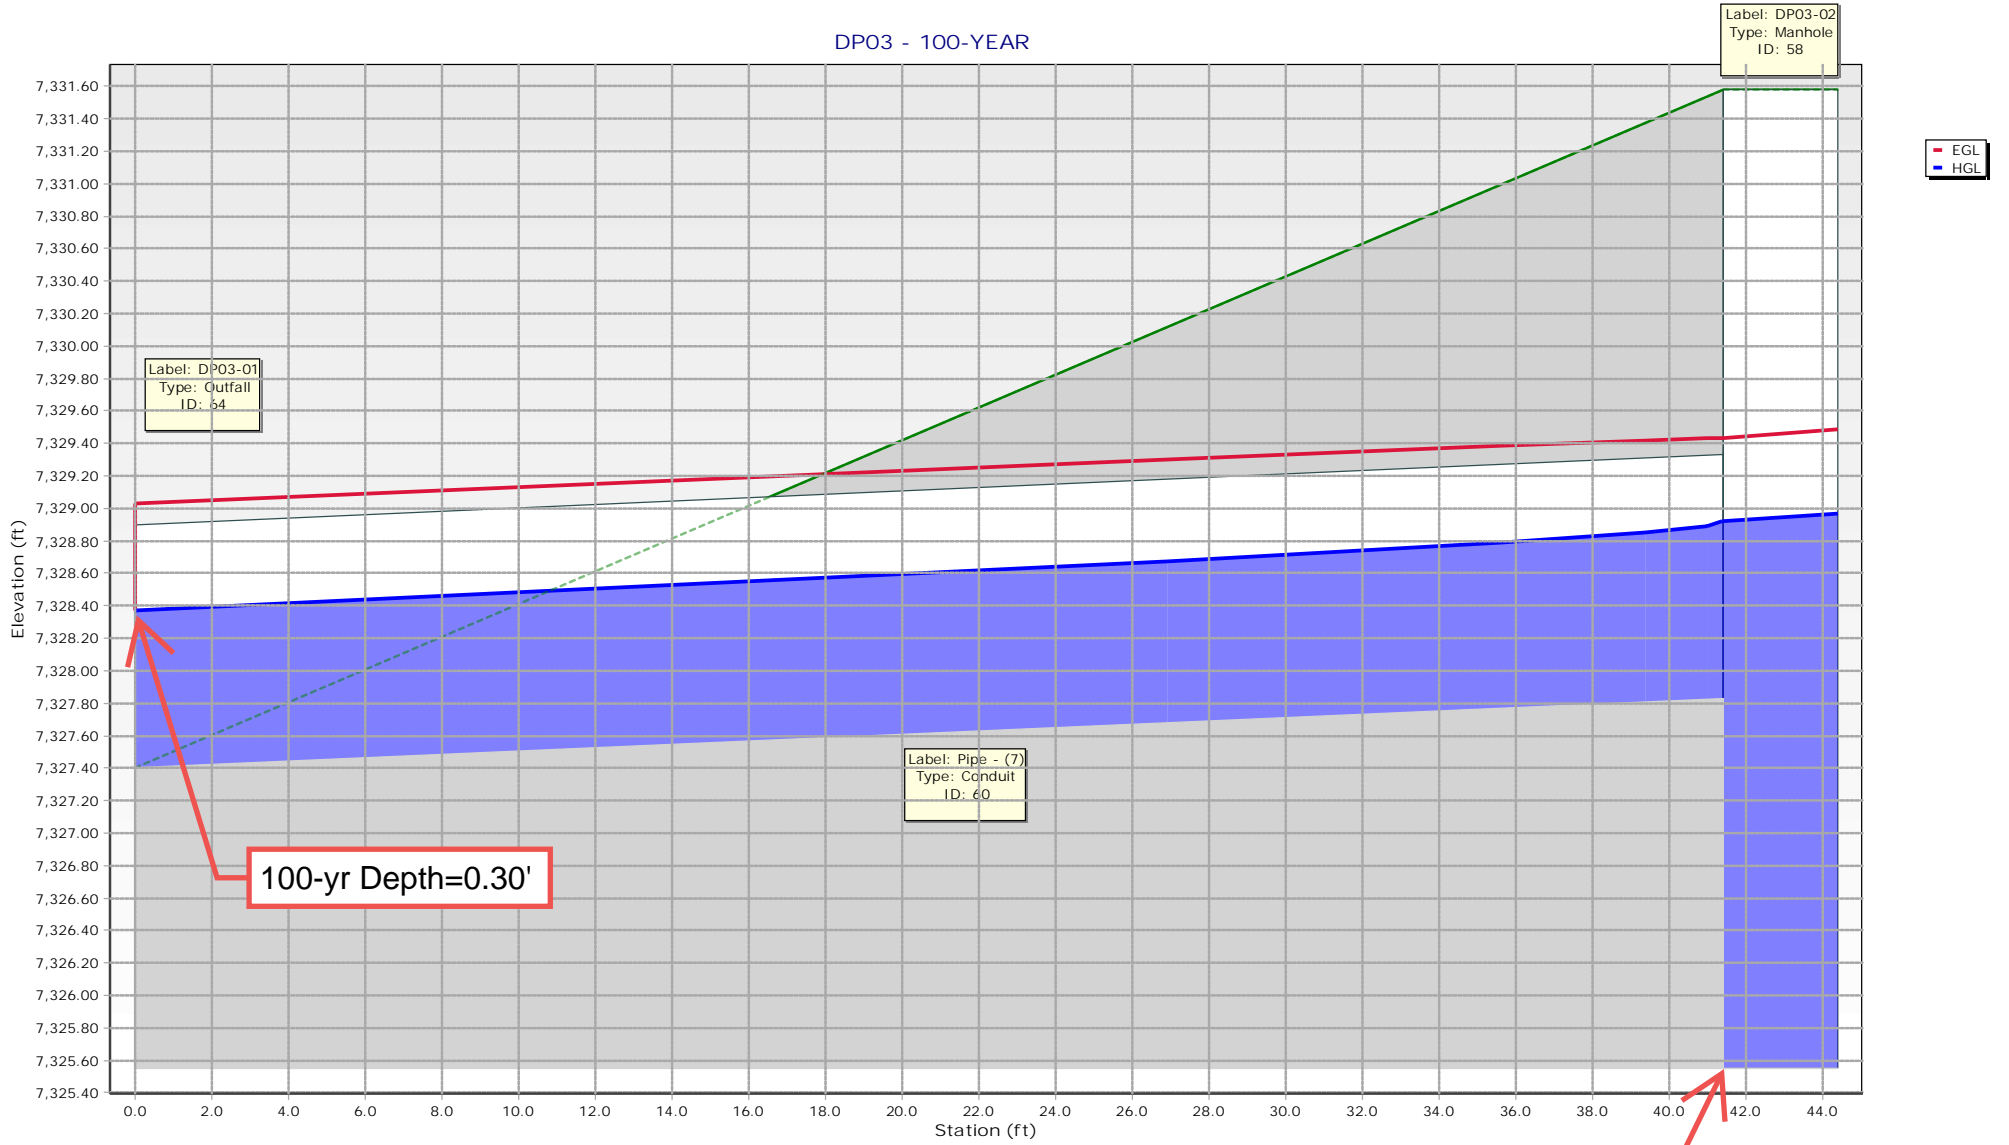


100-yr Depth=0.30'

Outlet structure
bottom of micropool

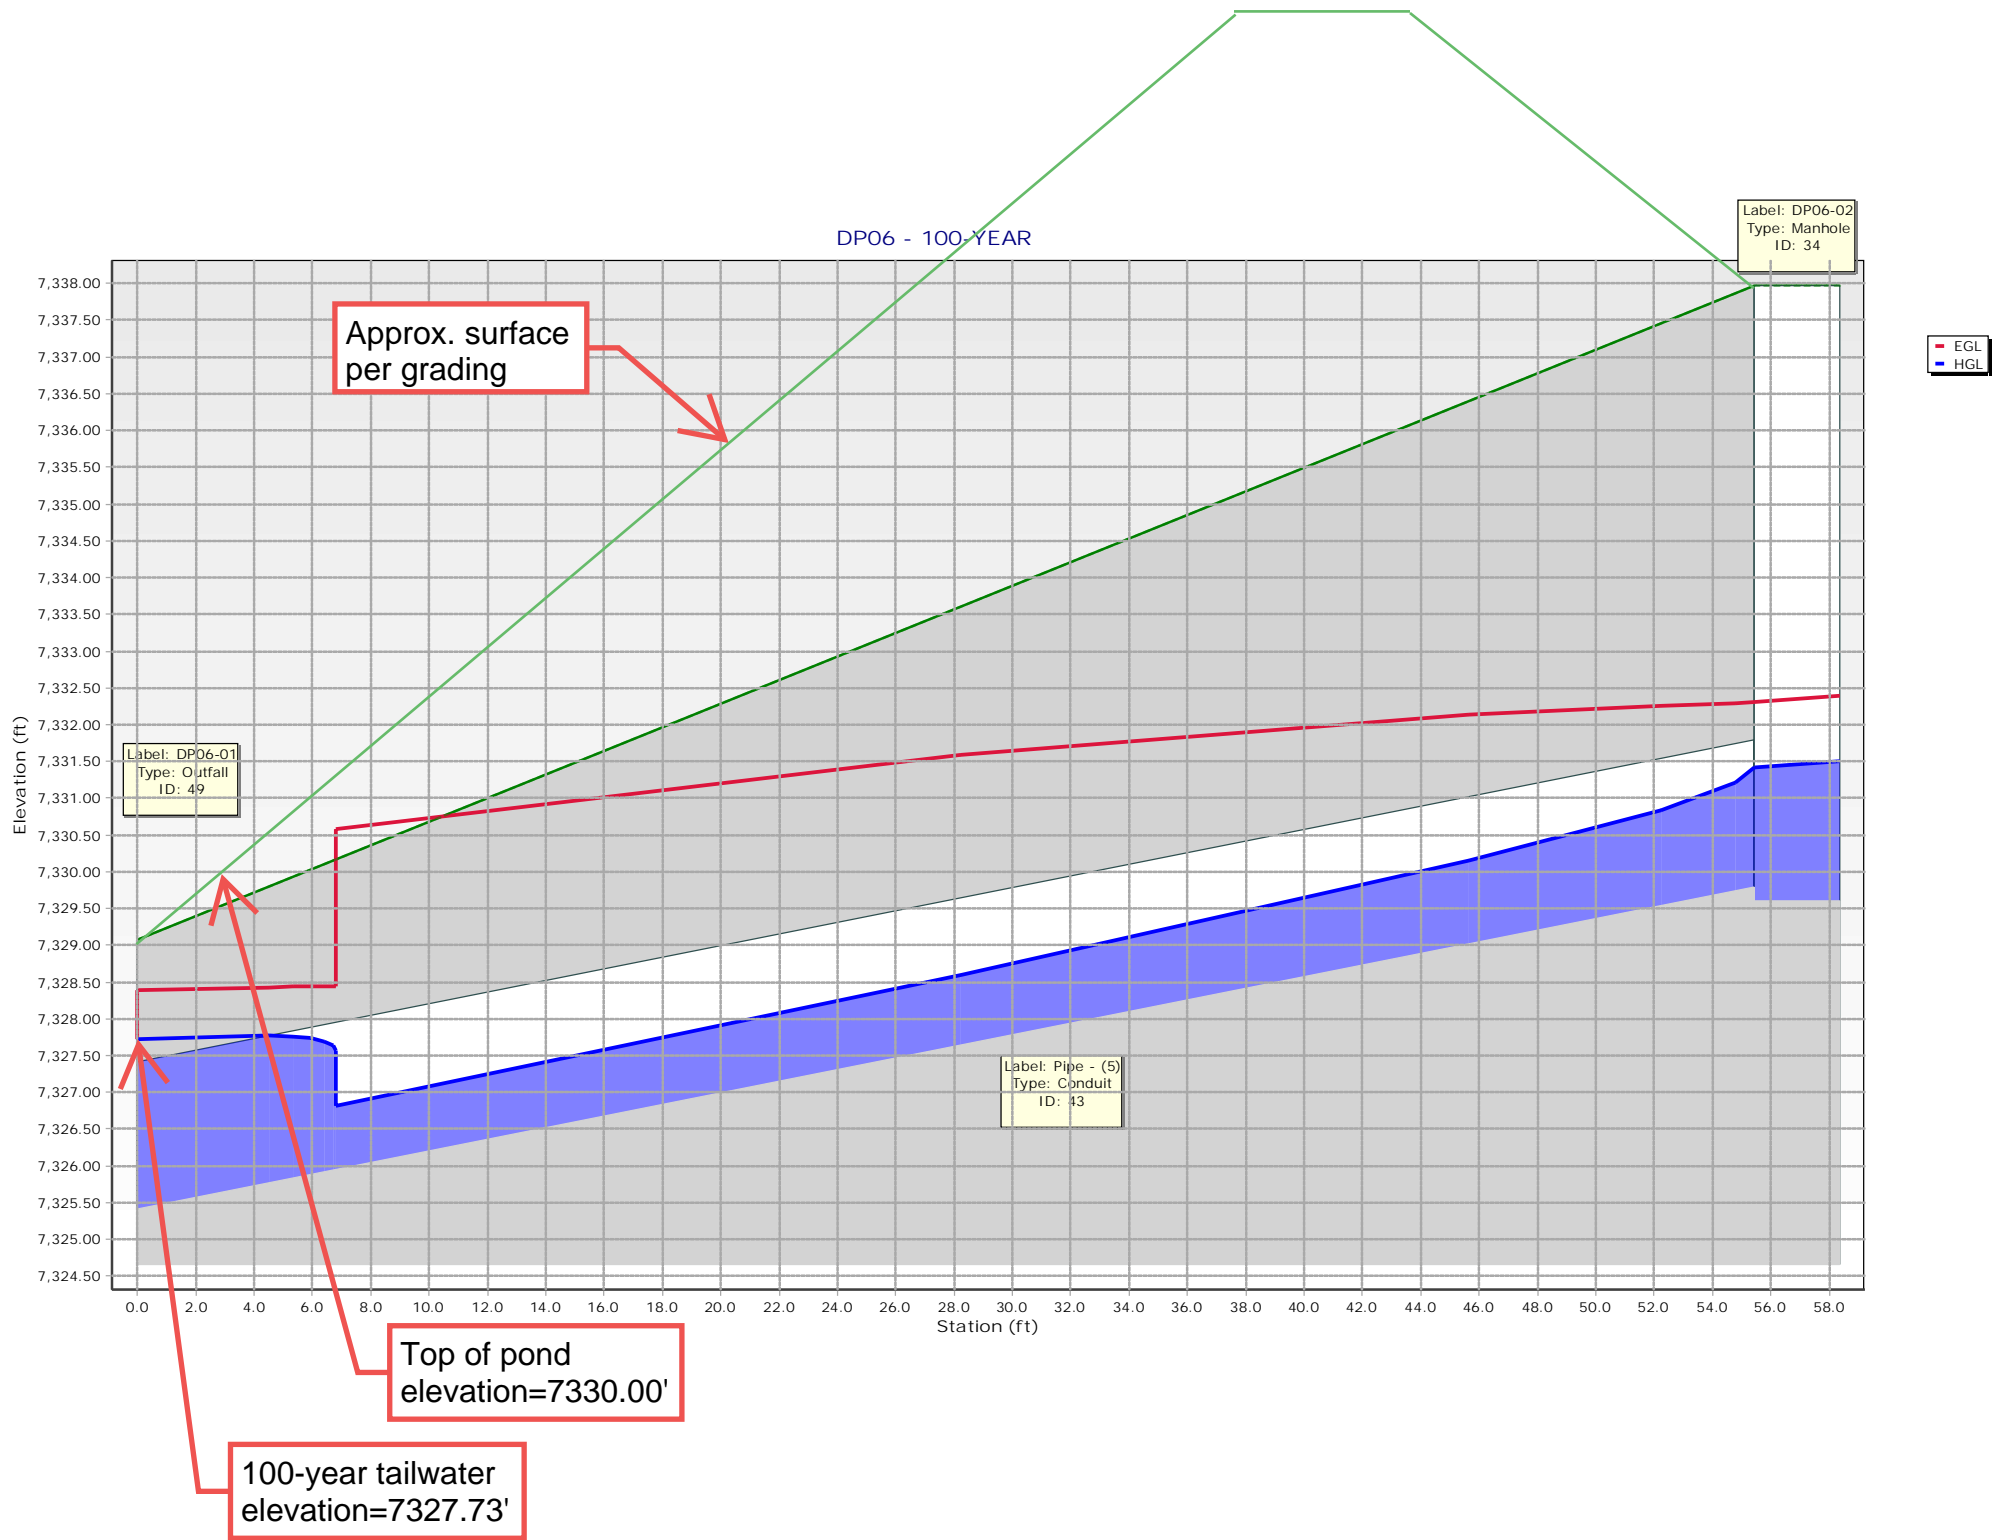

DP07 - 100-YEAR


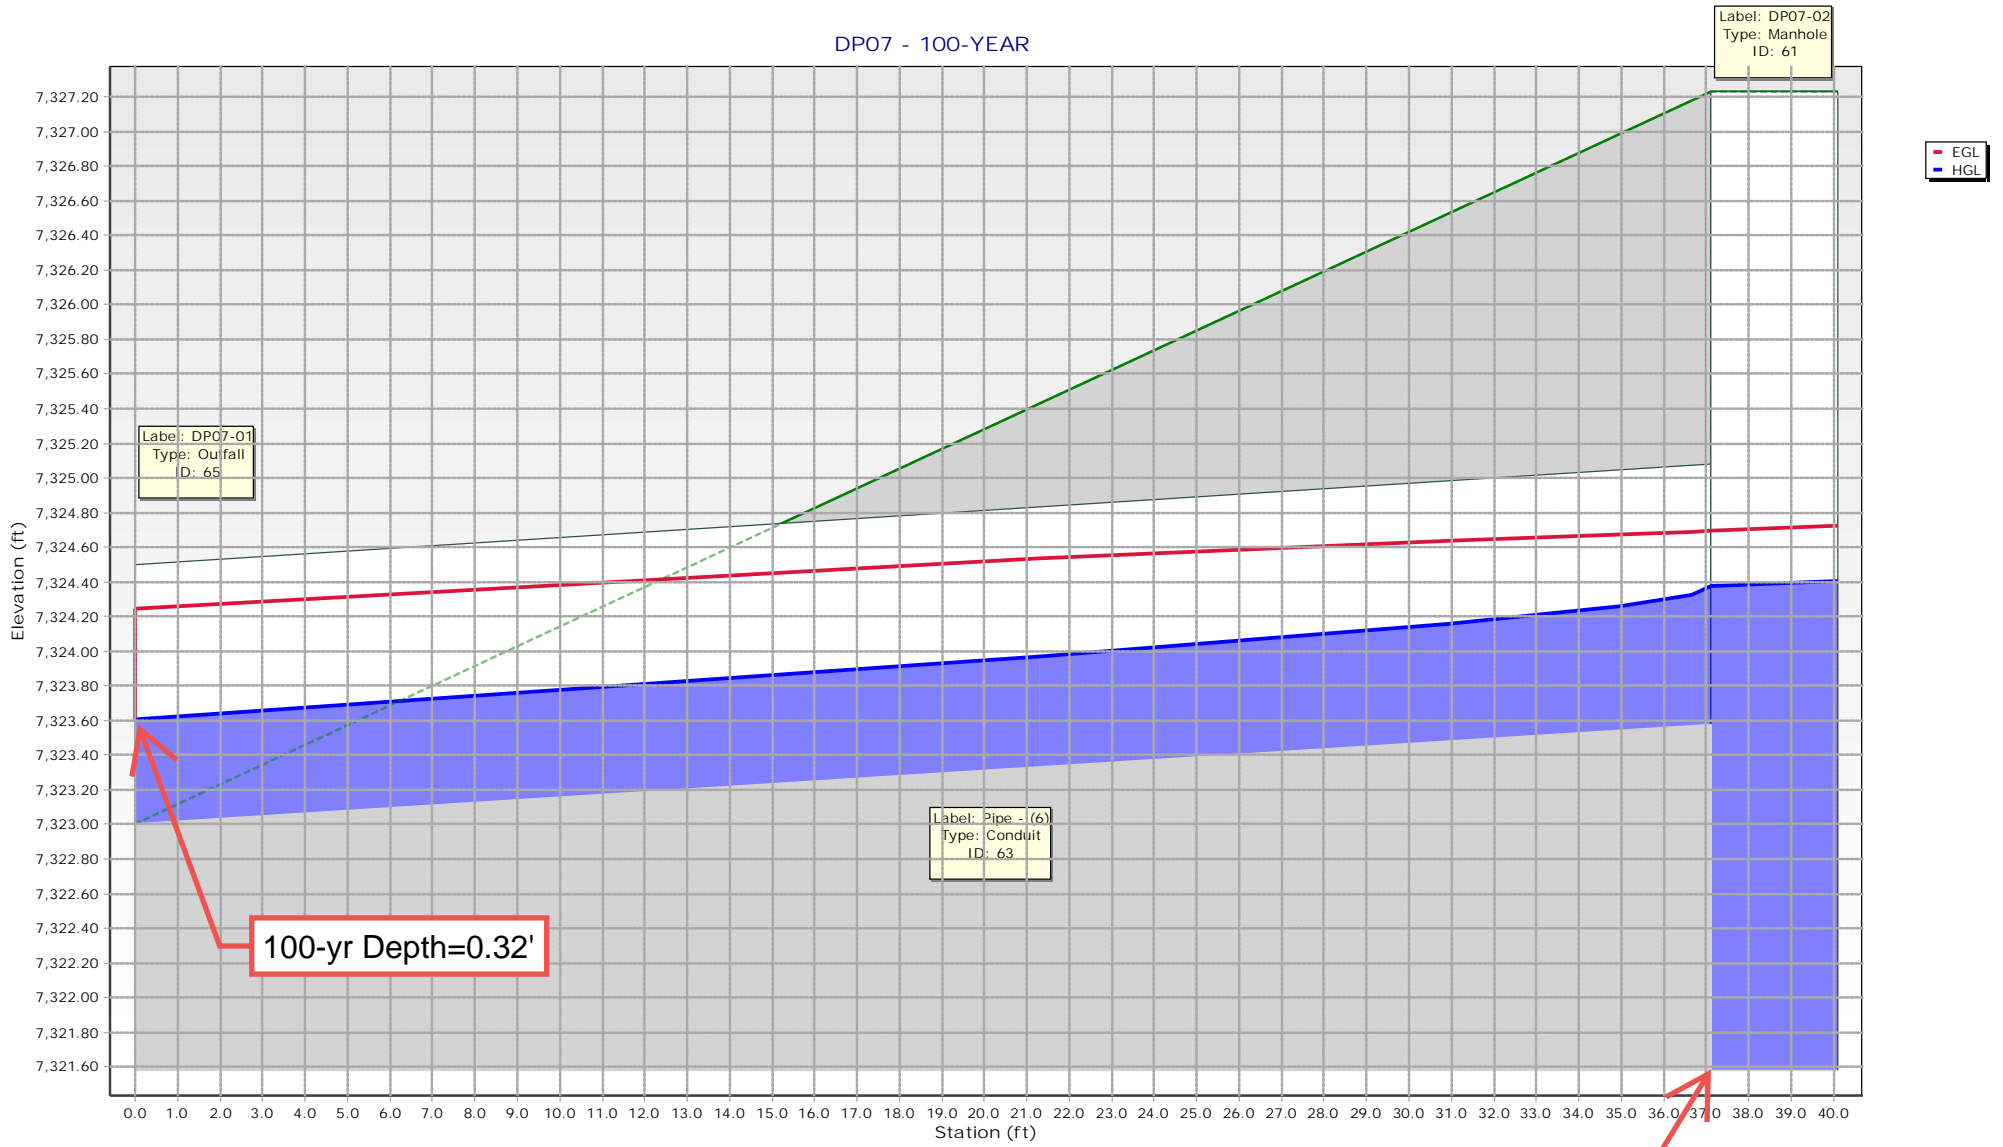


100-yr Depth=0.32'

Outlet structure
bottom of micropool

DETENTION BASIN STAGE-STORAGE TABLE BUILDER


MHFD-Defention, Version 4.06 (July 2022)

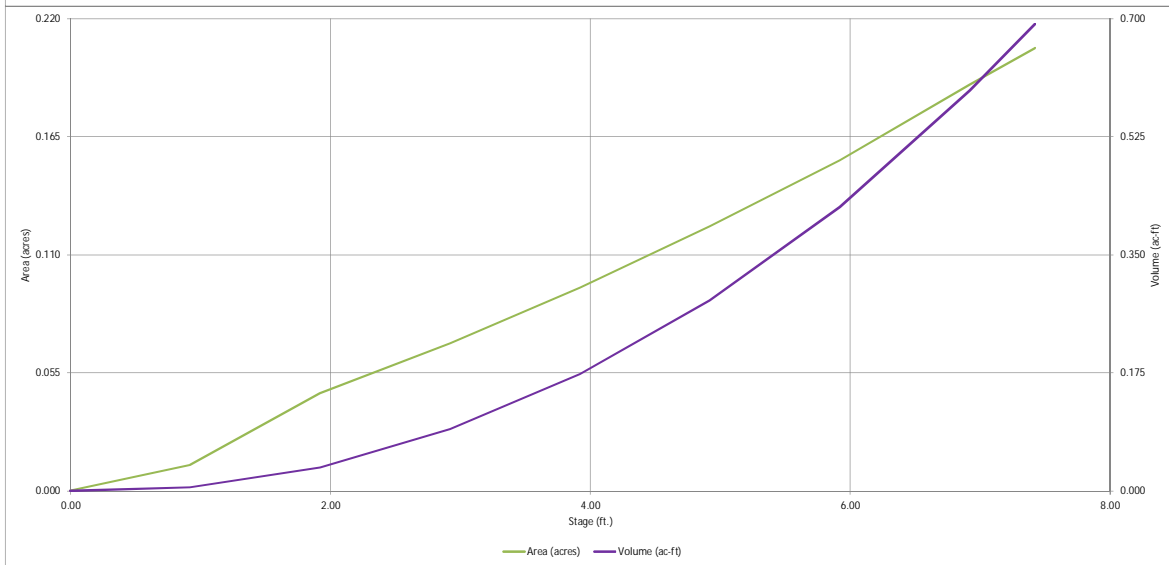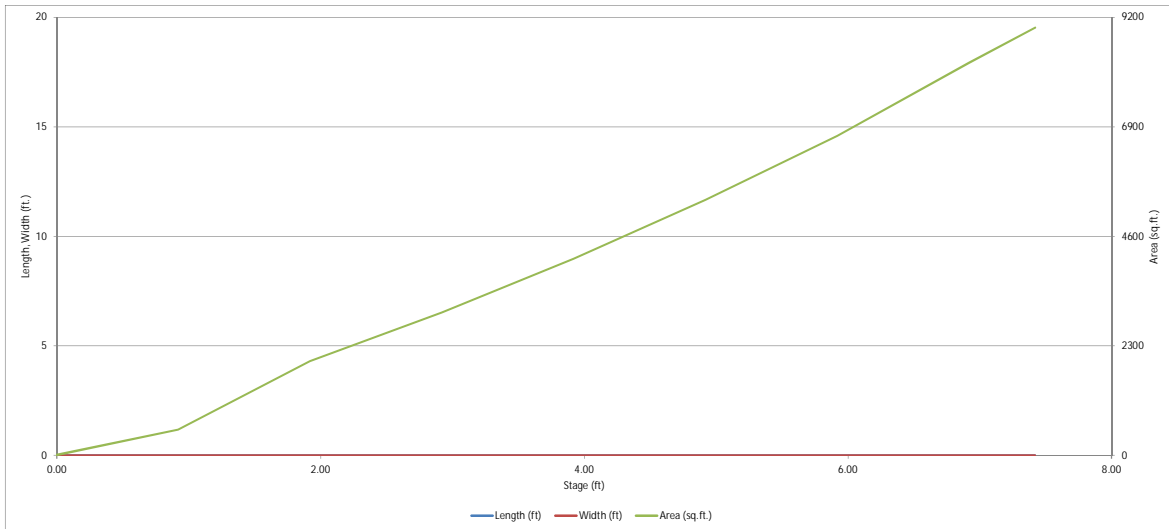

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

Project: Cathedral Pines
Basin ID: Pond A

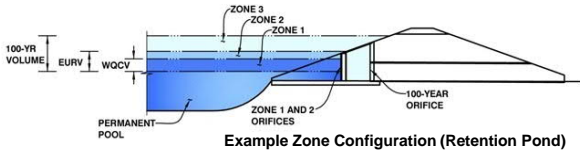

Example Zone Configuration (Retention Pond)

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WOCV)	2.34	0.056	Orifice Plate
Zone 2 (EURV)	3.28	0.062	Orifice Plate
Zone 3 (100-year)	5.06	0.182	Weir&Pipe (Restrict)
Total (all zones)		0.300	

User Input: Orifice at Underdrain Outlet (typically used to drain WOCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain
Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WOCV and/or EURV in a sedimentation BMP)

Centroid of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = inches
Orifice Plate: Orifice Area per Row = sq. inches

Calculated Parameters for Plate
WO Orifice Area per Row = ft²
Elliptical Half-Width = feet
Elliptical Slot Centroid = feet
Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.80	2.80					
Orifice Area (sq. inches)	0.25	0.25	0.25					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	inches

Calculated Parameters for Vertical Orifice
Vertical Orifice Area = ft²
Vertical Orifice Centroid = feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Gate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	3.50	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	3.00	N/A	feet
Overflow Weir Gate Slope =	0.00	N/A	H:V
Horiz. Length of Weir Sides =	3.00	N/A	feet
Overflow Gate Type =	Close Mesh Gate	N/A	
Debris Clogging % =	50%	N/A	%

Calculated Parameters for Overflow Weir
Height of Gate Upper Edge, H₁ = feet
Overflow Weir Slope Length = feet
Grate Open Area / 100-yr Orifice Area =
Overflow Gate Open Area w/o Debris = ft²
Overflow Gate Open Area w/ Debris = ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.25	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	18.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	6.00		inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate
Outlet Orifice Area = ft²
Outlet Orifice Centroid = feet
Half-Central Angle of Restrictor Plate on Pipe = radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = feet
Spillway End Slopes = H:V
Freeboard above Max Water Surface = feet

Calculated Parameters for Spillway
Spillway Design Flow Depth = feet
Stage at Top of Freeboard = feet
Basin Area at Top of Freeboard = acres
Basin Volume at Top of Freeboard = acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WOCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	4.00
One-Hour Rainfall Depth (in)	0.056	0.118	0.126	0.224	0.317	0.467	0.575	0.725	1.405
CUHP Runoff Volume (acre-ft)	N/A	N/A	0.126	0.224	0.317	0.467	0.575	0.725	1.405
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.7	1.9	2.8	4.9	6.2	7.7	15.2
CUHP Predevelopment Peak Q (cfs)	N/A	N/A	0.7	1.9	2.8	4.9	6.2	7.7	15.2
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.12	0.34	0.51	0.90	1.13	1.41	2.76
Peak Inflow Q (cfs)	N/A	N/A	1.7	3.0	4.0	6.2	7.5	9.1	17.1
Peak Outflow Q (cfs)	0.0	0.0	0.7	1.2	2.4	4.9	5.1	5.4	13.4
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	0.7	0.9	1.0	0.8	0.7	0.9
Structure Controlling Flow	Plate	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Outlet Plate 1	Outlet Plate 1	Spillway
Max Velocity through Gate 1 (fps)	N/A	N/A	N/A	0.2	0.3	0.7	0.7	0.8	0.9
Max Velocity through Gate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	39	63	66	68	66	62	60	57	45
Time to Drain 99% of Inflow Volume (hours)	42	68	71	75	73	71	69	68	62
Maximum Ponding Depth (ft)	2.35	3.28	3.29	3.65	3.74	3.90	4.19	4.84	6.27
Area at Maximum Ponding Depth (acres)	0.06	0.08	0.08	0.09	0.09	0.09	0.10	0.12	0.17
Maximum Volume Stored (acre-ft)	0.056	0.118	0.119	0.149	0.157	0.172	0.200	0.272	0.476

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

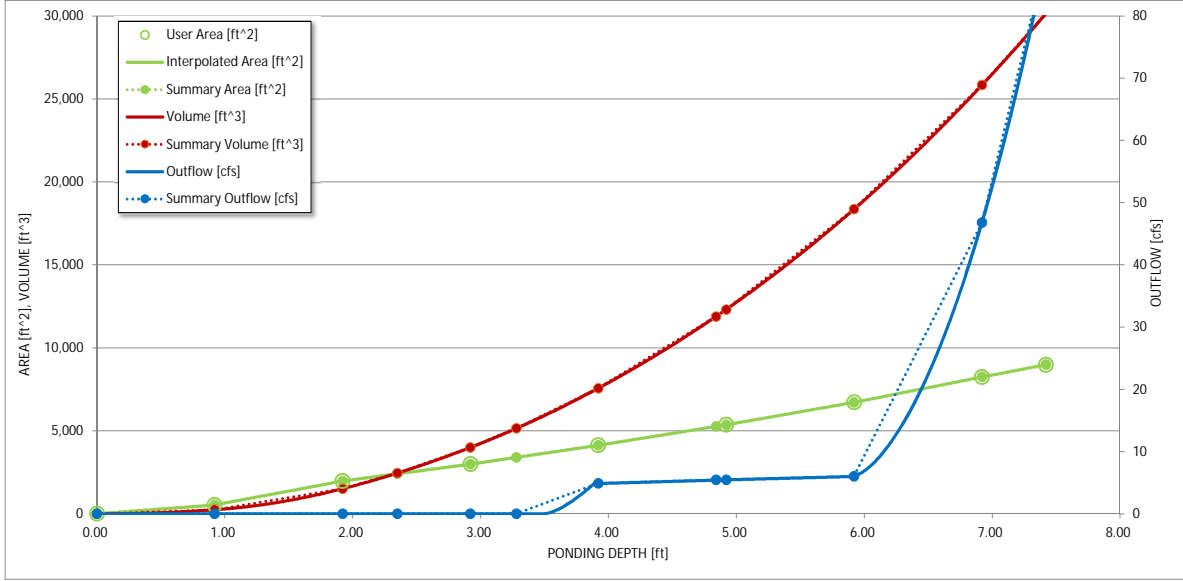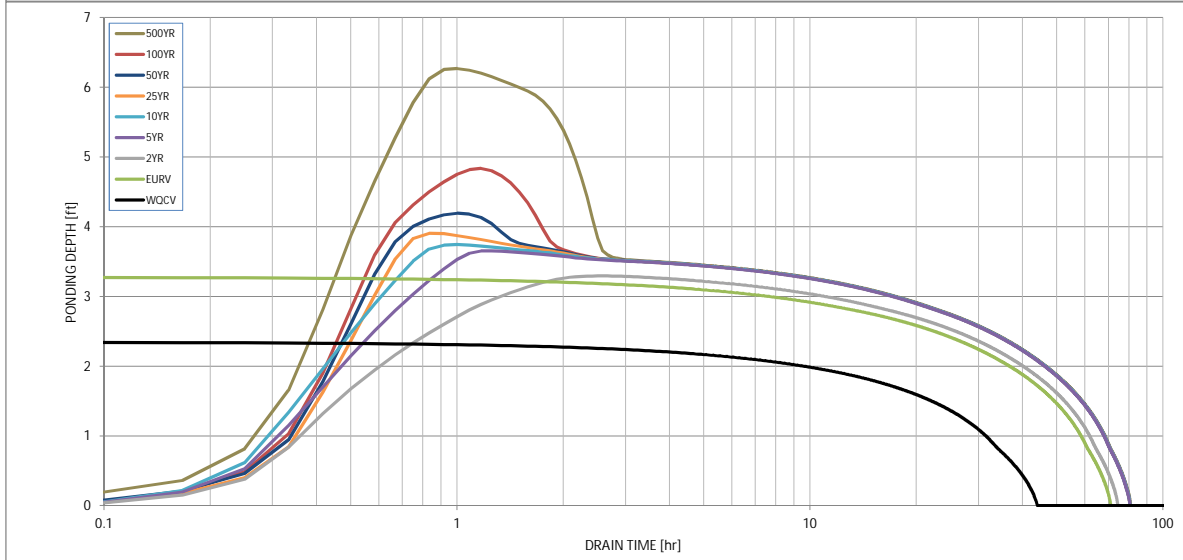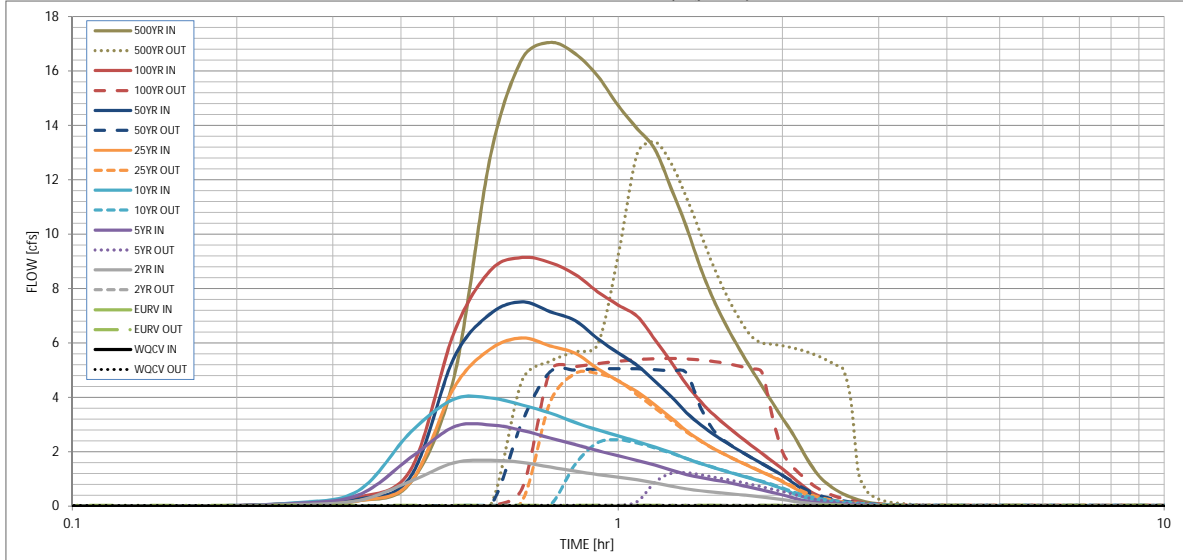

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WOCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.05
	0:15:00	0.00	0.00	0.06	0.09	0.11	0.08	0.09	0.09	0.19
	0:20:00	0.00	0.00	0.20	0.41	0.56	0.20	0.25	0.32	0.88
	0:25:00	0.00	0.00	0.92	1.79	2.73	0.89	1.10	1.35	4.75
	0:30:00	0.00	0.00	1.60	2.92	3.94	4.36	5.46	6.38	12.90
	0:35:00	0.00	0.00	1.69	2.99	3.98	5.78	7.08	8.67	16.46
	0:40:00	0.00	0.00	1.61	2.79	3.72	6.19	7.51	9.15	17.05
	0:45:00	0.00	0.00	1.44	2.51	3.43	5.89	7.15	8.96	16.64
	0:50:00	0.00	0.00	1.29	2.27	3.08	5.62	6.83	8.53	15.82
	0:55:00	0.00	0.00	1.16	2.04	2.81	5.06	6.16	7.88	14.73
	1:00:00	0.00	0.00	1.06	1.86	2.59	4.60	5.63	7.39	13.88
	1:05:00	0.00	0.00	0.97	1.68	2.38	4.21	5.18	6.98	13.13
	1:10:00	0.00	0.00	0.85	1.51	2.17	3.72	4.60	6.13	11.68
	1:15:00	0.00	0.00	0.74	1.33	1.97	3.25	4.03	5.30	10.26
	1:20:00	0.00	0.00	0.64	1.16	1.75	2.77	3.44	4.48	8.72
	1:25:00	0.00	0.00	0.57	1.05	1.56	2.40	2.99	3.83	7.52
	1:30:00	0.00	0.00	0.51	0.96	1.41	2.10	2.62	3.34	6.57
	1:35:00	0.00	0.00	0.47	0.88	1.27	1.86	2.31	2.93	5.77
	1:40:00	0.00	0.00	0.42	0.78	1.14	1.64	2.04	2.57	5.06
	1:45:00	0.00	0.00	0.38	0.69	1.02	1.44	1.80	2.24	4.41
	1:50:00	0.00	0.00	0.34	0.59	0.90	1.25	1.56	1.93	3.80
	1:55:00	0.00	0.00	0.29	0.50	0.77	1.07	1.34	1.64	3.23
	2:00:00	0.00	0.00	0.24	0.41	0.64	0.90	1.13	1.37	2.69
	2:05:00	0.00	0.00	0.19	0.32	0.49	0.70	0.88	1.07	2.09
	2:10:00	0.00	0.00	0.13	0.23	0.36	0.51	0.64	0.78	1.54
	2:15:00	0.00	0.00	0.10	0.16	0.28	0.35	0.44	0.54	1.10
	2:20:00	0.00	0.00	0.08	0.13	0.22	0.25	0.32	0.38	0.82
	2:25:00	0.00	0.00	0.06	0.10	0.18	0.18	0.24	0.28	0.61
	2:30:00	0.00	0.00	0.05	0.09	0.15	0.14	0.18	0.20	0.45
	2:35:00	0.00	0.00	0.04	0.07	0.12	0.10	0.13	0.14	0.33
	2:40:00	0.00	0.00	0.03	0.05	0.09	0.08	0.10	0.10	0.23
	2:45:00	0.00	0.00	0.02	0.04	0.07	0.06	0.08	0.07	0.16
	2:50:00	0.00	0.00	0.02	0.03	0.05	0.04	0.06	0.05	0.12
	2:55:00	0.00	0.00	0.02	0.03	0.04	0.03	0.04	0.04	0.09
	3:00:00	0.00	0.00	0.01	0.02	0.03	0.03	0.03	0.03	0.07
	3:05:00	0.00	0.00	0.01	0.01	0.02	0.02	0.03	0.02	0.06
	3:10:00	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.04
	3:15:00	0.00	0.00	0.01	0.01	0.01	0.01	0.02	0.01	0.03
	3:20:00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.02
	3:25:00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

Designer: Gabe Gonzales
Company: JR Engineering, LLC
Date: March 25, 2024
Project: Cathedral Pines
Location: Pond A

1. Basin Storage Volume

- A) Effective Imperviousness of Tributary Area, I_a
- B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)
- C) Contributing Watershed Area
- D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm
- E) Design Concept
(Select EURV when also designing for flood control)
- F) Design Volume (WQCV) Based on 40-hour Drain Time
($V_{DESIGN} = (1.0 * (0.91 * i^2 - 1.19 * i^2 + 0.78 * i) / 12 * Area)$)
- G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume
($V_{WQCV\ OTHER} = (d_6 * (V_{DESIGN} / 0.43))$)
- H) User Input of Water Quality Capture Volume (WQCV) Design Volume
(Only if a different WQCV Design Volume is desired)
- I) NRCS Hydrologic Soil Groups of Tributary Watershed
 - i) Percentage of Watershed consisting of Type A Soils
 - ii) Percentage of Watershed consisting of Type B Soils
 - iii) Percentage of Watershed consisting of Type C/D Soils
- J) Excess Urban Runoff Volume (EURV) Design Volume
 For HSG A: $EURV_A = 1.68 * i^{1.28}$
 For HSG B: $EURV_B = 1.36 * i^{1.08}$
 For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$
- K) User Input of Excess Urban Runoff Volume (EURV) Design Volume
(Only if a different EURV Design Volume is desired)

$I_a =$ %
 $i =$
 Area = ac
 $d_6 =$
 Choose One
 Water Quality Capture Volume (WQCV)
 Excess Urban Runoff Volume (EURV)
 $V_{DESIGN} =$ ac-ft
 $V_{DESIGN\ OTHER} =$
 $V_{DESIGN\ USER} =$
 $HSG_A =$ %
 $HSG_B =$ %
 $HSG_{C/D} =$ %
 $EURV_{DESIGN} =$ ac-ft
 $EURV_{DESIGN\ USER} =$ ac-ft

2. Basin Shape: Length to Width Ratio
(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

$L : W =$: 1

3. Basin Side Slopes

- A) Basin Maximum Side Slopes
(Horizontal distance per unit vertical, 4:1 or flatter preferred)

$Z =$ ft / ft

4. Inlet

- A) Describe means of providing energy dissipation at concentrated inflow locations:

5. Forebay

- A) Minimum Forebay Volume
($V_{FMN} =$ % of the WQCV)
- B) Actual Forebay Volume
- C) Forebay Depth
($D_F =$ inch maximum)
- D) Forebay Discharge
 - i) Undetained 100-year Peak Discharge
 - ii) Forebay Discharge Design Flow
($Q_F = 0.02 * Q_{100}$)
- E) Forebay Discharge Design
- F) Discharge Pipe Size (minimum 8-inches)
- G) Rectangular Notch Width

$V_{FMN} =$ ac-ft
 $V_F =$ ac-ft
 $D_F =$ in
 $Q_{100} =$ cfs
 $Q_F =$ cfs
 Choose One
 Berm With Pipe
 Wall with Rect. Notch
 Wall with V-Notch Weir
 Calculated $D_p =$ in
 Calculated $W_N =$ in

Flow too small for berm w/ pipe

Design Procedure Form: Extended Detention Basin (EDB)

Designer: Gabe Gonzales
Company: JR Engineering, LLC
Date: March 25, 2024
Project: Cathedral Pines
Location: Pond A

<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;"> Choose One <input checked="" type="radio"/> Concrete <input type="radio"/> Soft Bottom </div> <p>S = <input style="width: 50px;" type="text" value="0.0050"/> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>D_M = <input style="width: 50px;" type="text" value="2.5"/> ft</p> <p>A_M = <input style="width: 50px;" type="text" value="10"/> sq ft</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;"> Choose One <input checked="" type="radio"/> Orifice Plate <input type="radio"/> Other (Describe): </div> <hr/> <hr/> <p>D_{orifice} = <input style="width: 50px;" type="text" value="0.56"/> inches</p> <p>A_{ot} = <input style="width: 50px;" type="text" value="0.75"/> square inches</p>
<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>D_{IS} = <input style="width: 50px;" type="text" value="4"/> in</p> <p>V_{IS} = <input style="width: 50px;" type="text" value=""/> cu ft</p> <p>V_s = <input style="width: 50px;" type="text" value="3.3"/> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: $A_t = A_{ot} * 38.5 * (e^{-0.095D})$</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open area to the total screen area for the material specified.)</p> <p style="margin-left: 40px;">Other (Y/N): <input style="width: 50px;" type="text" value="N"/></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening (W_{opening}) (Minimum of 12 inches is recommended)</p>	<p>A_t = <input style="width: 50px;" type="text" value="27"/> square inches</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px; width: fit-content;"> S.S. Well Screen with 60% Open Area </div> <hr/> <hr/> <p>User Ratio = <input style="width: 50px;" type="text" value=""/></p> <p>A_{total} = <input style="width: 50px;" type="text" value="46"/> sq. in.</p> <p>H = <input style="width: 50px;" type="text" value="3.28"/> feet</p> <p>H_{TR} = <input style="width: 50px;" type="text" value="67.36"/> inches</p> <p>W_{opening} = <input style="width: 50px;" type="text" value="12.0"/> inches VALUE LESS THAN RECOMMENDED MIN. WIDTH. WIDTH HAS BEEN SET TO 12 INCHES.</p>

Weir Report

Pond A Forebay Release

Compound Weir


Crest	= Sharp
Bottom Length (ft)	= 6.00
Total Depth (ft)	= 1.00
Length, x (ft)	= 0.28
Depth, a (ft)	= 0.75

Highlighted

Depth (ft)	= 0.43
Q (cfs)	= 0.260
Area (sqft)	= 0.12
Velocity (ft/s)	= 2.18
Top Width (ft)	= 0.28

Calculations

Weir Coeff. Cw	= 3.33
Compute by:	Known Q
Known Q (cfs)	= 0.26

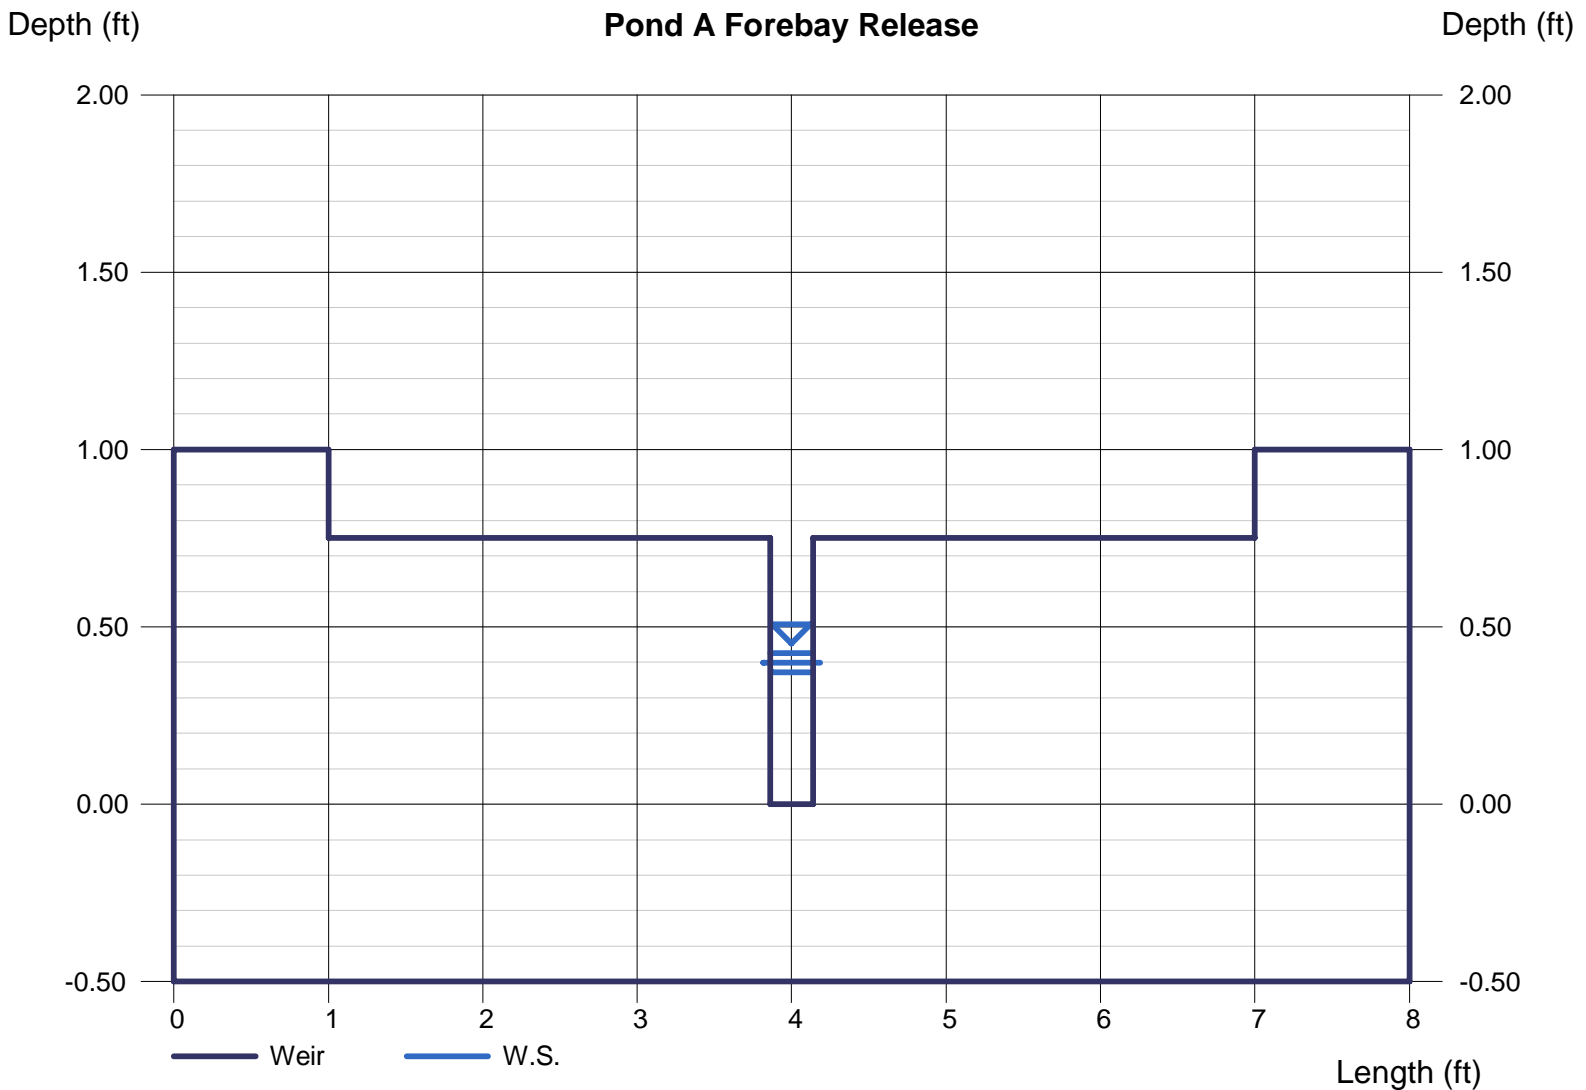

Channel Report

Pond A Trickle Channel

Rectangular

Bottom Width (ft) = 6.00
Total Depth (ft) = 0.50


Invert Elev (ft) = 100.00
Slope (%) = 0.50
N-Value = 0.013

Calculations

Compute by: Known Q
Known Q (cfs) = 0.26

Highlighted

Depth (ft) = 0.05
Q (cfs) = 0.260
Area (sqft) = 0.30
Velocity (ft/s) = 0.87
Wetted Perim (ft) = 6.10
Crit Depth, Yc (ft) = 0.04
Top Width (ft) = 6.00
EGL (ft) = 0.06

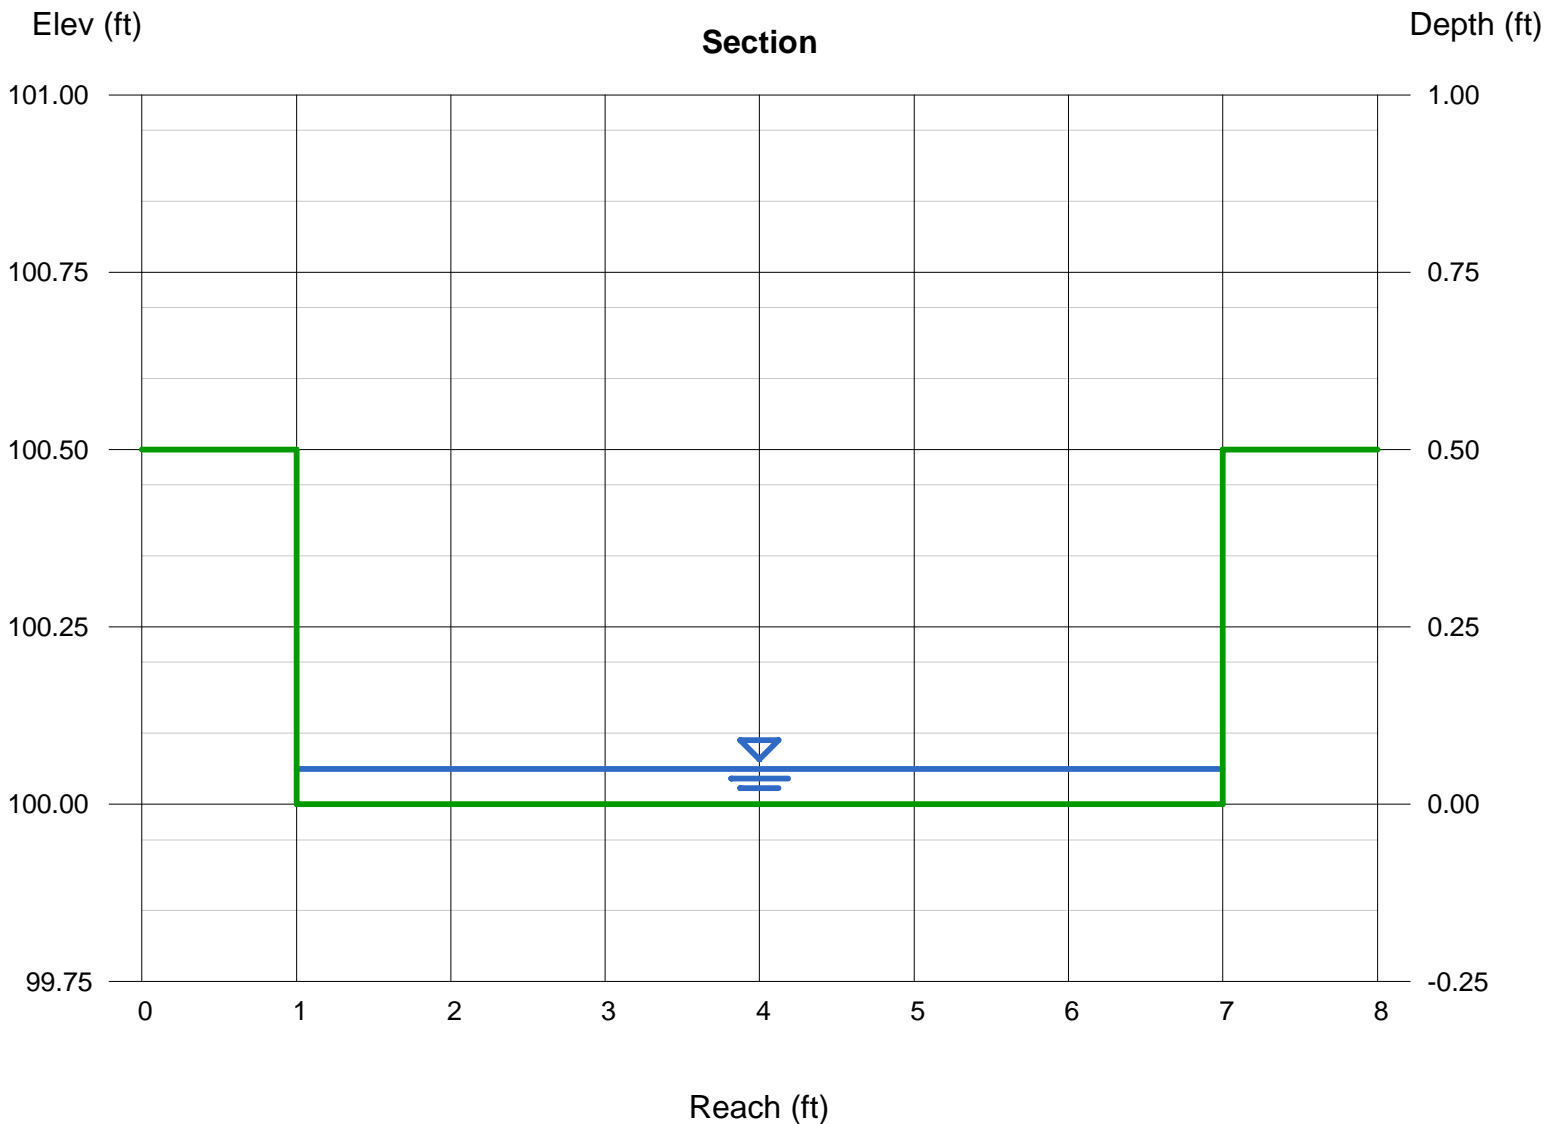

POND A

Figure 13-12c. Emergency Spillway Protection




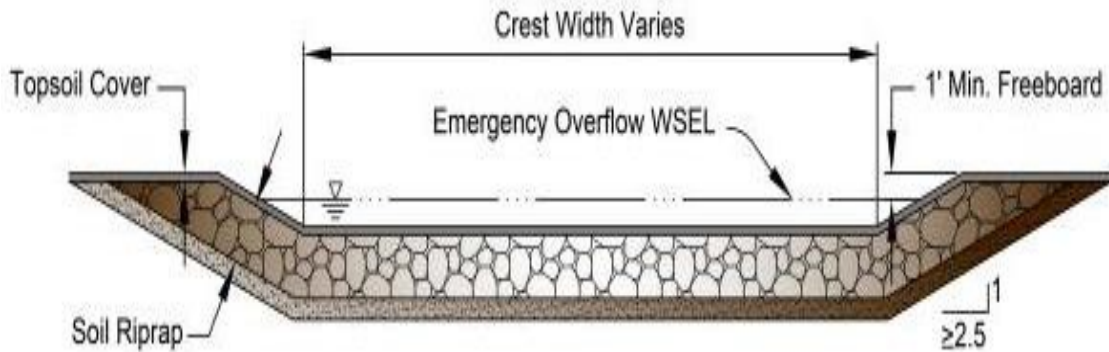


Figure 13-12d. Riprap Types for Emergency Spillway Protection

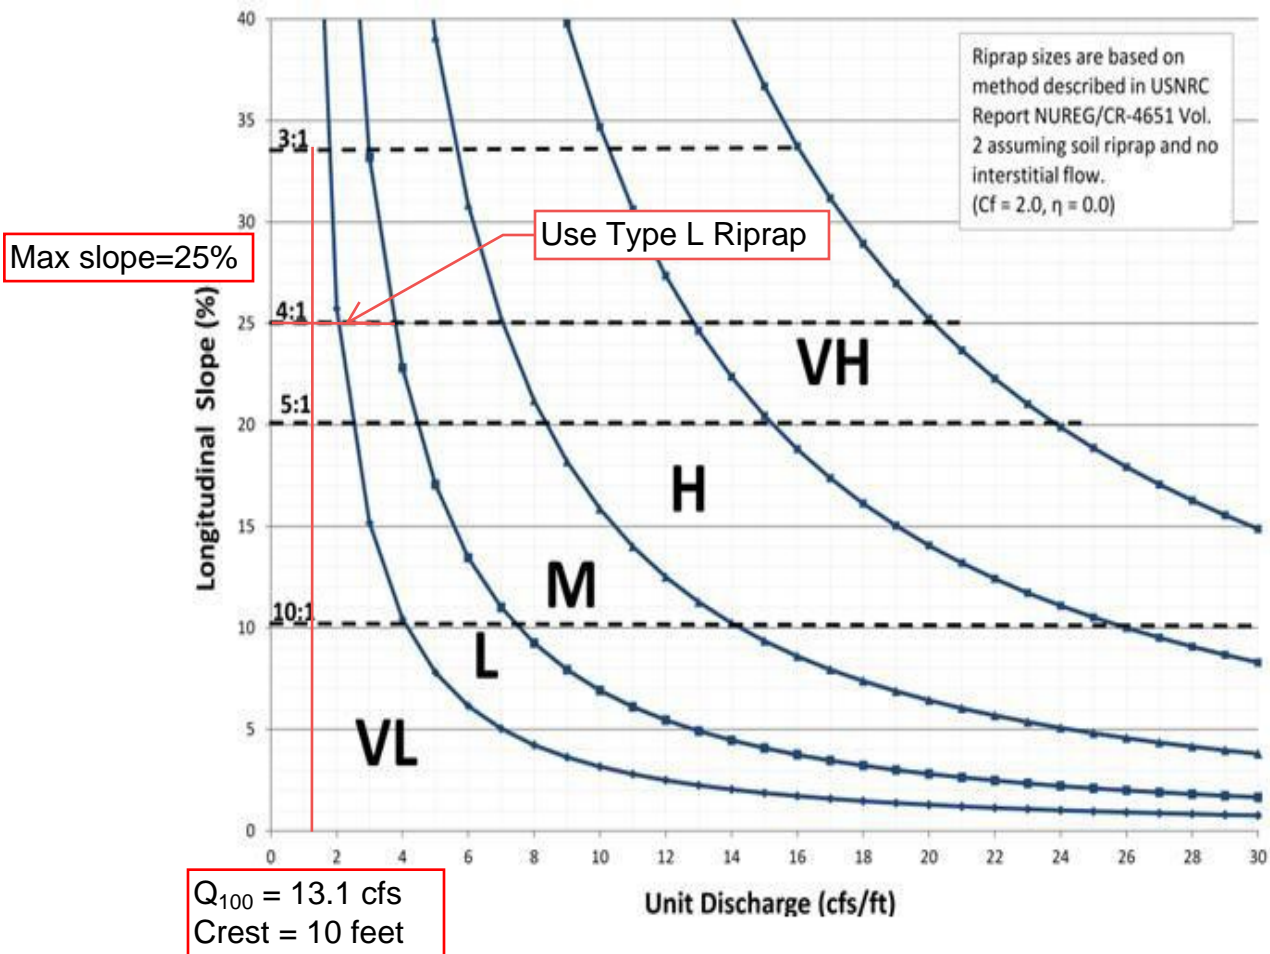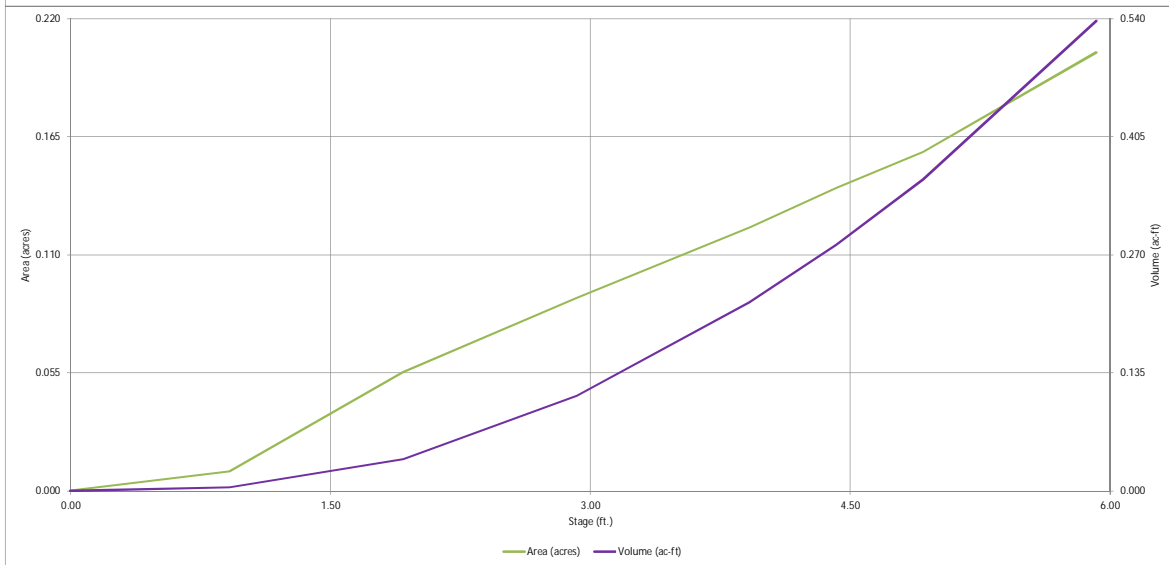

DETENTION BASIN STAGE-STORAGE TABLE BUILDER


MHFD-Defention, Version 4.06 (July 2022)

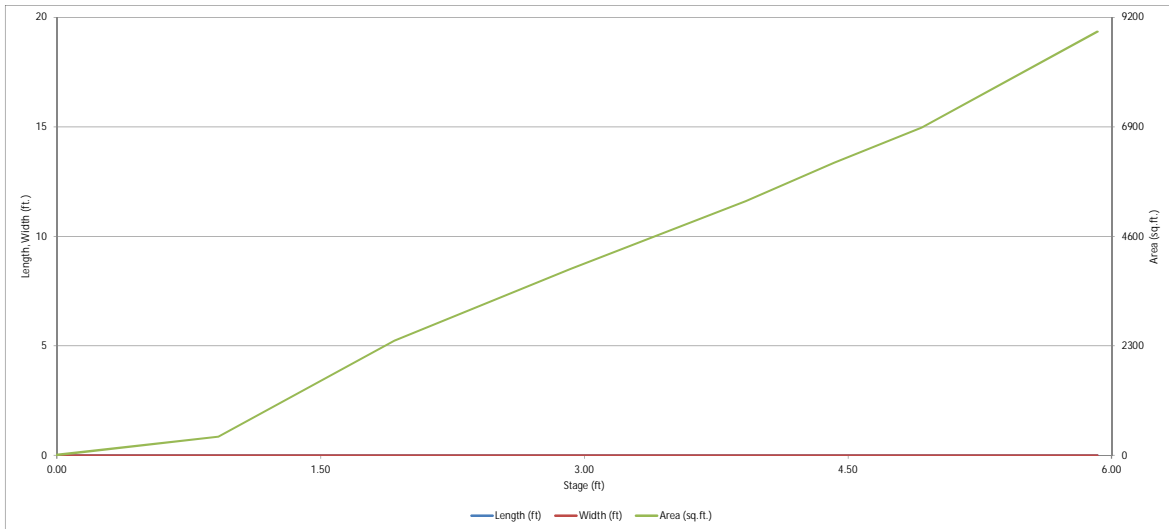

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-*Detention*, Version 4.06 (July 2022)

Project: Estates at Cathedral Pines
Basin ID: Pond B

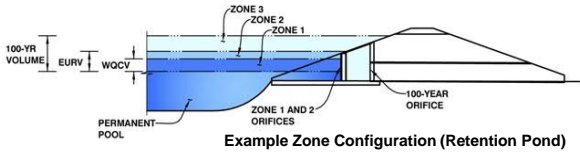

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.11	0.047	Orifice Plate
Zone 2 (EURV)	2.93	0.063	Orifice Plate
Zone 3 (100-year)	4.19	0.139	Weir&Pipe (Restrict)
Total (all zones)		0.249	

Example Zone Configuration (Retention Pond)

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Calculated Parameters for Plate

Centroid of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = inches
Orifice Plate: Orifice Area per Row = sq. inches

WQ Orifice Area per Row = ft²
Elliptical Half-Width = feet
Elliptical Slot Centroid = feet
Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.50	2.25					
Orifice Area (sq. inches)	0.28	0.28	0.28					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Calculated Parameters for Vertical Orifice

	Not Selected	Not Selected	
Invert of Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	inches

	Not Selected	Not Selected	
Vertical Orifice Area =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	ft ²
Vertical Orifice Centroid =	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>	feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Gate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

Calculated Parameters for Overflow Weir

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	3.15	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	3.00	N/A	feet
Overflow Weir Gate Slope =	0.00	N/A	H:V
Horiz. Length of Weir Sides =	3.00	N/A	feet
Overflow Gate Type =	Close Mesh Gate	N/A	
Debris Clogging % =	50%	N/A	%

	Zone 3 Weir	Not Selected	
Height of Gate Upper Edge, H ₁ =	3.15	N/A	feet
Overflow Weir Slope Length =	3.00	N/A	feet
Gate Open Area / 100-yr Orifice Area =	15.57	N/A	
Overflow Gate Open Area w/o Debris =	7.12	N/A	ft ²
Overflow Gate Open Area w/ Debris =	3.56	N/A	ft ²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.50	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	18.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	5.50		inches

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	0.46	N/A	ft ²
Outlet Orifice Centroid =	0.27	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	1.17	N/A	radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Calculated Parameters for Spillway

Spillway Invert Stage =	4.42	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	10.00	feet
Spillway End Slopes =	4.00	H:V
Freeboard above Max Water Surface =	1.00	feet

Spillway Design Flow Depth =	0.27	feet
Stage at Top of Freeboard =	5.69	feet
Basin Area at Top of Freeboard =	0.19	acres
Basin Volume at Top of Freeboard =	0.49	acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	4.00
One-Hour Rainfall Depth (in)	0.047	0.110	0.112	0.187	0.257	0.365	0.446	0.554	1.055
CUHP Runoff Volume (acre-ft)	N/A	N/A	0.112	0.187	0.257	0.365	0.446	0.554	1.055
Inflow Hydrograph Volume (acre-ft)	N/A	N/A	0.4	1.0	1.5	2.8	3.5	4.5	8.8
CUHP Predevelopment Peak Q (cfs)	N/A	N/A							
OPTIONAL Override Predevelopment Peak Q (cfs)	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre)	N/A	N/A	0.09	0.25	0.38	0.69	0.87	1.12	2.20
Peak Inflow Q (cfs)	N/A	N/A	1.2	1.9	2.5	3.8	4.7	5.7	10.6
Peak Outflow Q (cfs)	0.0	0.0	0.0	0.6	1.4	2.8	3.7	4.3	8.8
Ratio Peak Outflow to Predevelopment Q	N/A	N/A	N/A	0.6	0.9	1.0	1.1	1.0	1.0
Structure Controlling Flow	Plate	Plate	Plate	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Spillway
Max Velocity through Gate 1 (fps)	N/A	N/A	N/A	0.1	0.2	0.4	0.5	0.6	0.7
Max Velocity through Gate 2 (fps)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours)	40	64	66	72	69	65	63	59	48
Time to Drain 99% of Inflow Volume (hours)	42	68	69	77	76	74	73	72	66
Maximum Ponding Depth (ft)	2.10	2.93	2.87	3.25	3.32	3.42	3.48	3.65	4.67
Area at Maximum Ponding Depth (acres)	0.06	0.09	0.09	0.10	0.10	0.11	0.11	0.11	0.15
Maximum Volume Stored (acre-ft)	0.047	0.110	0.105	0.140	0.147	0.157	0.164	0.184	0.316

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

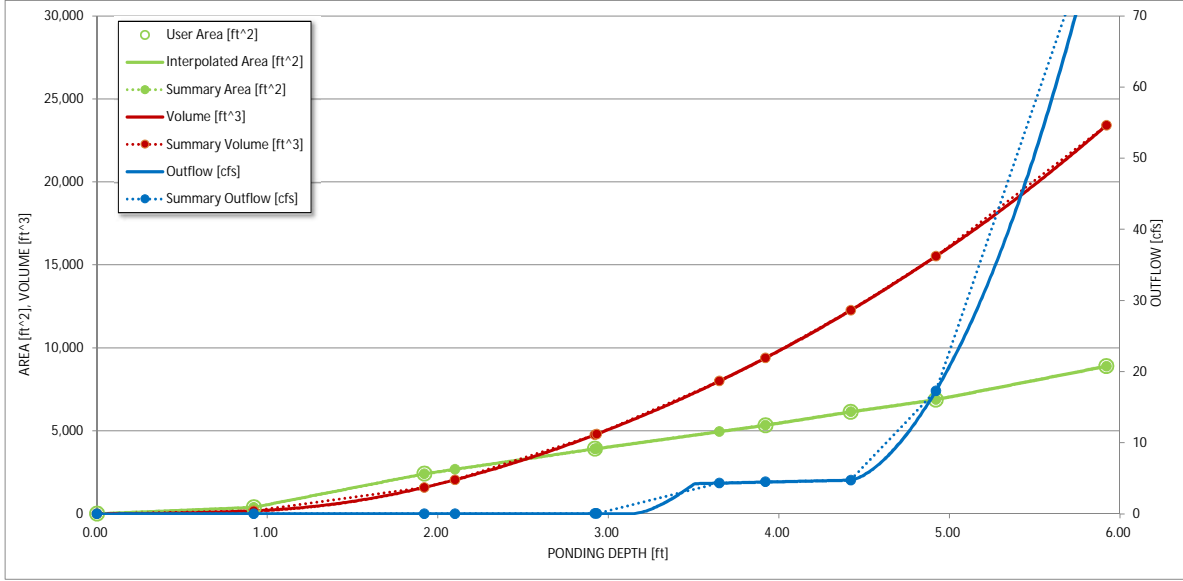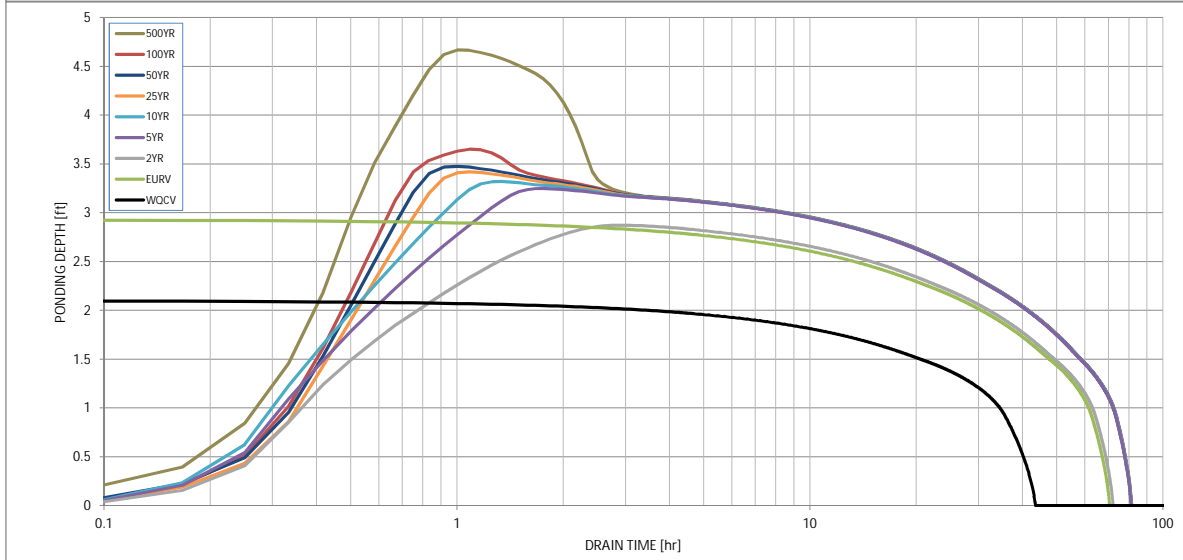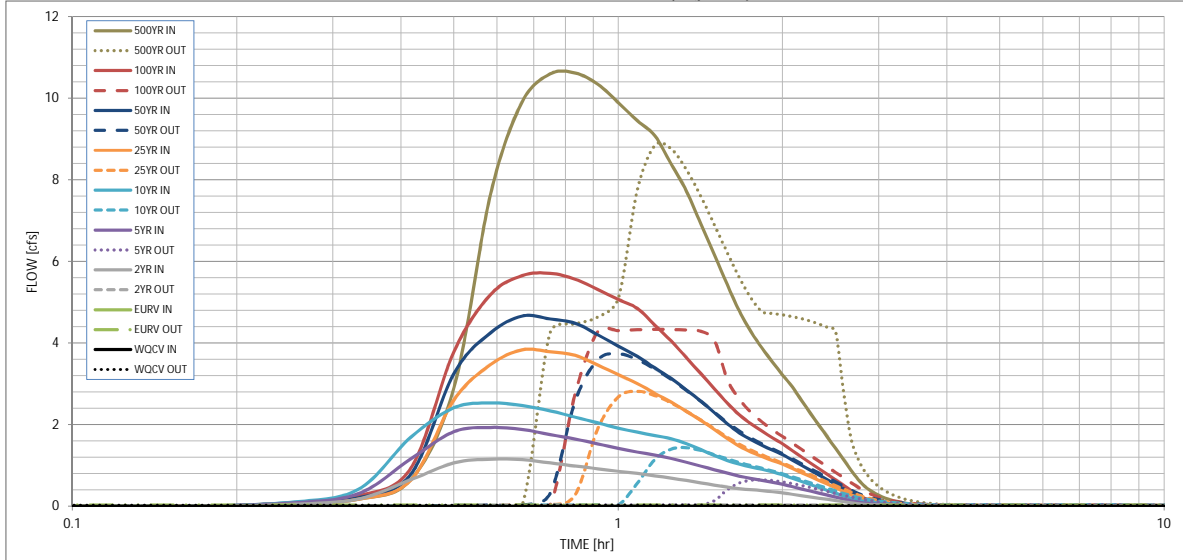

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: _____

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WOCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.04
	0:15:00	0.00	0.00	0.05	0.08	0.10	0.07	0.08	0.08	0.17
	0:20:00	0.00	0.00	0.18	0.31	0.41	0.18	0.21	0.25	0.65
	0:25:00	0.00	0.00	0.65	1.17	1.70	0.64	0.79	0.94	2.92
	0:30:00	0.00	0.00	1.07	1.83	2.42	2.61	3.26	3.80	7.65
	0:35:00	0.00	0.00	1.15	1.93	2.53	3.47	4.25	5.19	9.92
	0:40:00	0.00	0.00	1.15	1.88	2.47	3.84	4.66	5.65	10.60
	0:45:00	0.00	0.00	1.06	1.76	2.34	3.79	4.59	5.71	10.62
	0:50:00	0.00	0.00	0.99	1.65	2.19	3.70	4.49	5.57	10.35
	0:55:00	0.00	0.00	0.92	1.53	2.05	3.46	4.20	5.32	9.89
	1:00:00	0.00	0.00	0.86	1.42	1.92	3.23	3.93	5.07	9.45
	1:05:00	0.00	0.00	0.81	1.33	1.82	3.01	3.68	4.85	9.08
	1:10:00	0.00	0.00	0.75	1.26	1.74	2.77	3.39	4.44	8.39
	1:15:00	0.00	0.00	0.69	1.17	1.66	2.55	3.13	4.05	7.72
	1:20:00	0.00	0.00	0.63	1.08	1.53	2.33	2.85	3.64	6.92
	1:25:00	0.00	0.00	0.58	0.99	1.39	2.11	2.58	3.25	6.16
	1:30:00	0.00	0.00	0.52	0.90	1.25	1.88	2.29	2.88	5.43
	1:35:00	0.00	0.00	0.47	0.81	1.12	1.66	2.03	2.53	4.78
	1:40:00	0.00	0.00	0.43	0.74	1.03	1.47	1.80	2.24	4.28
	1:45:00	0.00	0.00	0.41	0.68	0.97	1.33	1.63	2.02	3.88
	1:50:00	0.00	0.00	0.39	0.63	0.91	1.22	1.50	1.84	3.53
	1:55:00	0.00	0.00	0.36	0.59	0.84	1.12	1.38	1.68	3.22
	2:00:00	0.00	0.00	0.33	0.54	0.77	1.03	1.27	1.53	2.93
	2:05:00	0.00	0.00	0.29	0.48	0.69	0.93	1.13	1.36	2.59
	2:10:00	0.00	0.00	0.26	0.43	0.61	0.82	1.00	1.21	2.27
	2:15:00	0.00	0.00	0.23	0.37	0.53	0.73	0.88	1.06	1.98
	2:20:00	0.00	0.00	0.20	0.32	0.46	0.63	0.76	0.92	1.69
	2:25:00	0.00	0.00	0.17	0.27	0.39	0.54	0.65	0.78	1.42
	2:30:00	0.00	0.00	0.14	0.23	0.32	0.45	0.54	0.65	1.15
	2:35:00	0.00	0.00	0.11	0.18	0.26	0.37	0.44	0.52	0.89
	2:40:00	0.00	0.00	0.09	0.14	0.20	0.29	0.33	0.39	0.66
	2:45:00	0.00	0.00	0.07	0.10	0.15	0.21	0.24	0.27	0.48
	2:50:00	0.00	0.00	0.05	0.08	0.12	0.15	0.17	0.19	0.36
	2:55:00	0.00	0.00	0.04	0.06	0.10	0.11	0.13	0.14	0.27
	3:00:00	0.00	0.00	0.03	0.05	0.08	0.08	0.10	0.10	0.20
	3:05:00	0.00	0.00	0.03	0.04	0.07	0.06	0.07	0.08	0.15
	3:10:00	0.00	0.00	0.02	0.04	0.06	0.05	0.06	0.06	0.11
	3:15:00	0.00	0.00	0.02	0.03	0.05	0.04	0.05	0.04	0.08
	3:20:00	0.00	0.00	0.02	0.02	0.04	0.03	0.04	0.03	0.06
	3:25:00	0.00	0.00	0.01	0.02	0.03	0.02	0.03	0.02	0.05
	3:30:00	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.04
	3:35:00	0.00	0.00	0.01	0.01	0.02	0.01	0.02	0.02	0.03
	3:40:00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.02
	3:45:00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.02
	3:50:00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

Designer: Gabe Gonzales
Company: JR Engineering, LLC
Date: March 25, 2024
Project: Cathedral Pines
Location: Pond B

1. Basin Storage Volume

- A) Effective Imperviousness of Tributary Area, I_a
- B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)
- C) Contributing Watershed Area
- D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm
- E) Design Concept
(Select EURV when also designing for flood control)
- F) Design Volume (WQCV) Based on 40-hour Drain Time
($V_{DESIGN} = (1.0 * (0.91 * i^2 - 1.19 * i^2 + 0.78 * i) / 12 * Area)$)
- G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume
($V_{WQCV\ OTHER} = (d_6 * (V_{DESIGN} / 0.43))$)
- H) User Input of Water Quality Capture Volume (WQCV) Design Volume
(Only if a different WQCV Design Volume is desired)
- I) NRCS Hydrologic Soil Groups of Tributary Watershed
 - i) Percentage of Watershed consisting of Type A Soils
 - ii) Percentage of Watershed consisting of Type B Soils
 - iii) Percentage of Watershed consisting of Type C/D Soils
- J) Excess Urban Runoff Volume (EURV) Design Volume
 For HSG A: $EURV_A = 1.68 * i^{1.28}$
 For HSG B: $EURV_B = 1.36 * i^{1.08}$
 For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$
- K) User Input of Excess Urban Runoff Volume (EURV) Design Volume
(Only if a different EURV Design Volume is desired)

$I_a =$ %
 $i =$
 Area = ac
 $d_6 =$ in
 Choose One
 Water Quality Capture Volume (WQCV)
 Excess Urban Runoff Volume (EURV)
 $V_{DESIGN} =$ ac-ft
 $V_{DESIGN\ OTHER} =$ ac-ft
 $V_{DESIGN\ USER} =$ ac-ft
 $HSG_A =$ %
 $HSG_B =$ %
 $HSG_{C/D} =$ %
 $EURV_{DESIGN} =$ ac-ft
 $EURV_{DESIGN\ USER} =$ ac-ft

2. Basin Shape: Length to Width Ratio
(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

$L : W =$: 1

3. Basin Side Slopes

- A) Basin Maximum Side Slopes
(Horizontal distance per unit vertical, 4:1 or flatter preferred)

$Z =$ ft / ft

4. Inlet

- A) Describe means of providing energy dissipation at concentrated inflow locations:

5. Forebay

- A) Minimum Forebay Volume
($V_{FMN} =$ % of the WQCV)
- B) Actual Forebay Volume
- C) Forebay Depth
($D_F =$ inch maximum)
- D) Forebay Discharge
 - i) Undetained 100-year Peak Discharge
 - ii) Forebay Discharge Design Flow
($Q_F = 0.02 * Q_{100}$)
- E) Forebay Discharge Design
- F) Discharge Pipe Size (minimum 8-inches)
- G) Rectangular Notch Width

$V_{FMN} =$ ac-ft
 $V_F =$ ac-ft
 $D_F =$ in
 $Q_{100} =$ cfs
 $Q_F =$ cfs
 Choose One
 Berm With Pipe
 Wall with Rect. Notch
 Wall with V-Notch Weir
 Calculated $D_p =$ in
 Calculated $W_N =$ in

Flow too small for berm w/ pipe

Design Procedure Form: Extended Detention Basin (EDB)

Designer: Gabe Gonzales
Company: JR Engineering, LLC
Date: March 25, 2024
Project: Cathedral Pines
Location: Pond B

<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;"> Choose One <input checked="" type="radio"/> Concrete <input type="radio"/> Soft Bottom </div> <p>S = <input style="width: 50px;" type="text" value="0.0050"/> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft² minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>D_M = <input style="width: 50px;" type="text" value="2.5"/> ft</p> <p>A_M = <input style="width: 50px;" type="text" value="10"/> sq ft</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;"> Choose One <input checked="" type="radio"/> Orifice Plate <input type="radio"/> Other (Describe): </div> <hr/> <hr/> <hr/> <p>D_{orifice} = <input style="width: 50px;" type="text" value="0.56"/> inches</p> <p>A_{ot} = <input style="width: 50px;" type="text" value="0.84"/> square inches</p>
<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>D_{IS} = <input style="width: 50px;" type="text" value="4"/> in</p> <p>V_{IS} = <input style="width: 50px;" type="text" value=""/> cu ft</p> <p>V_s = <input style="width: 50px;" type="text" value="3.3"/> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: $A_t = A_{ot} * 38.5 * (e^{-0.095D})$</p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open area to the total screen area for the material specified.)</p> <p style="margin-left: 40px;">Other (Y/N): <input style="width: 50px;" type="text" value="N"/></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H_{TR})</p> <p>G) Width of Water Quality Screen Opening (W_{opening}) (Minimum of 12 inches is recommended)</p>	<p>A_t = <input style="width: 50px;" type="text" value="31"/> square inches</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px; width: fit-content;"> S.S. Well Screen with 60% Open Area </div> <hr/> <hr/> <hr/> <p>User Ratio = <input style="width: 50px;" type="text" value=""/></p> <p>A_{total} = <input style="width: 50px;" type="text" value="51"/> sq. in.</p> <p>H = <input style="width: 50px;" type="text" value="2.93"/> feet</p> <p>H_{TR} = <input style="width: 50px;" type="text" value="63.16"/> inches</p> <p>W_{opening} = <input style="width: 50px;" type="text" value="12.0"/> inches VALUE LESS THAN RECOMMENDED MIN. WIDTH. WIDTH HAS BEEN SET TO 12 INCHES.</p>

Weir Report

South Pond Forebay Release

Compound Weir


Crest	= Sharp
Bottom Length (ft)	= 6.00
Total Depth (ft)	= 1.00
Length, x (ft)	= 0.33
Depth, a (ft)	= 0.75

Highlighted

Depth (ft)	= 0.54
Q (cfs)	= 0.440
Area (sqft)	= 0.18
Velocity (ft/s)	= 2.46
Top Width (ft)	= 0.33

Calculations

Weir Coeff. Cw	= 3.33
Compute by:	Known Q
Known Q (cfs)	= 0.44

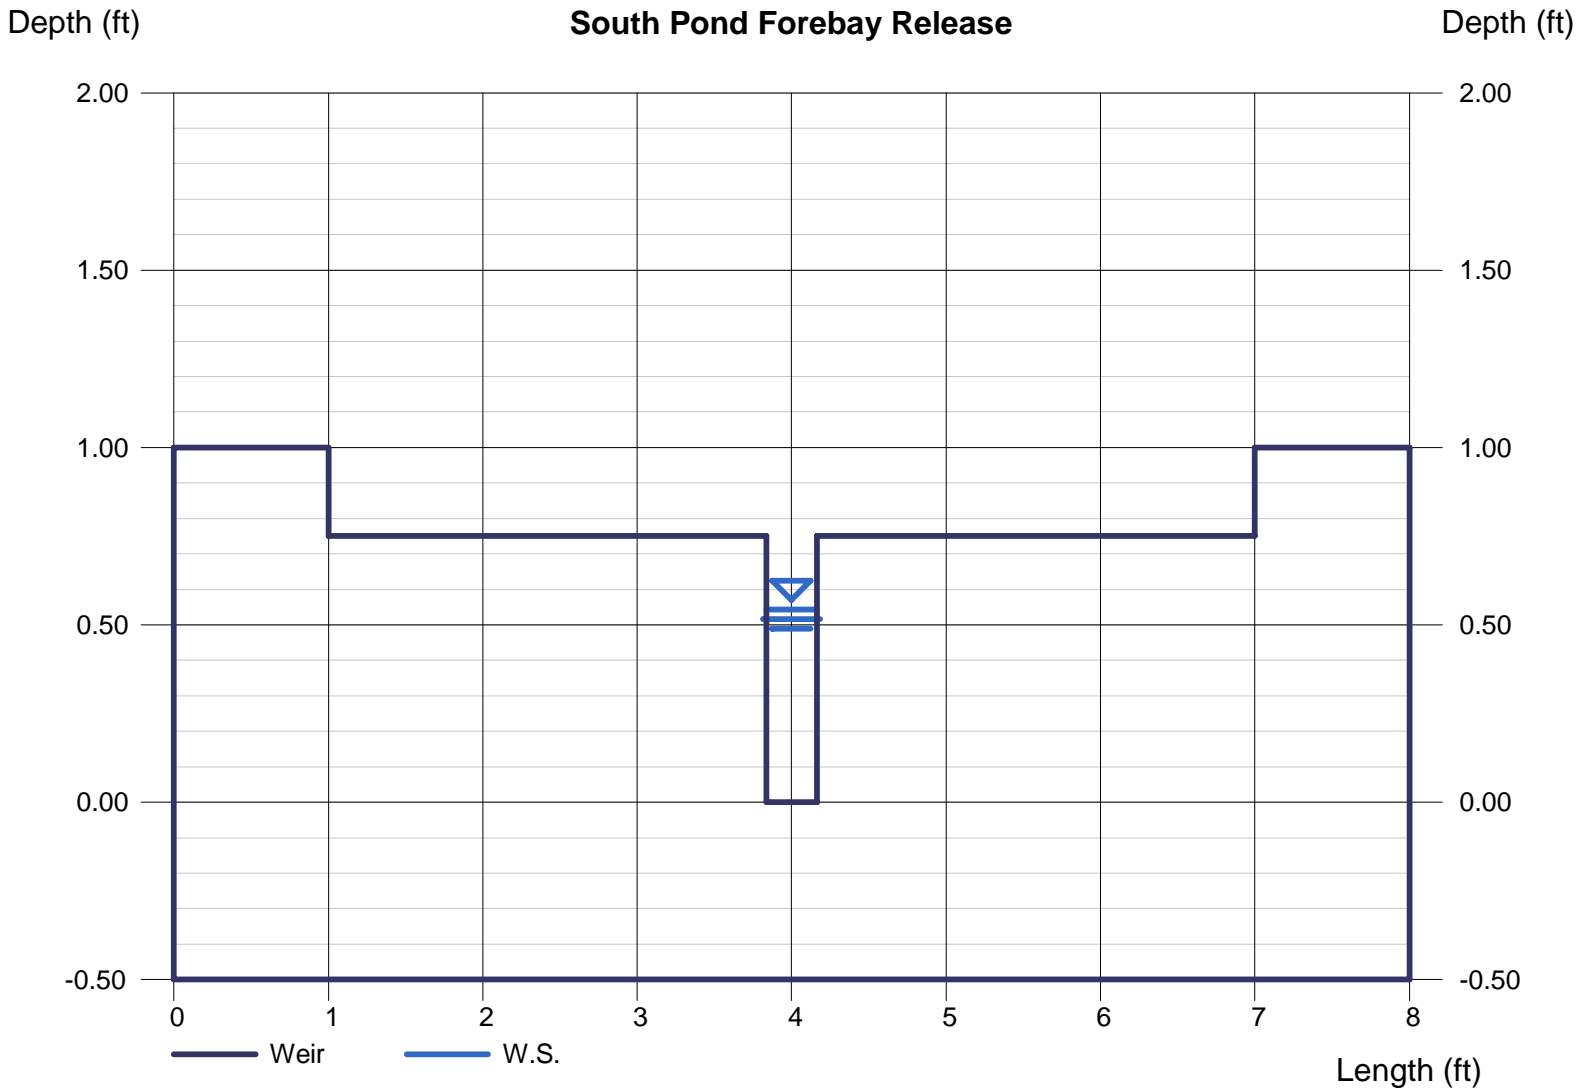

Channel Report

Pond B Trickle Channel - 6 ft

Rectangular

Bottom Width (ft) = 6.00
Total Depth (ft) = 0.50


Invert Elev (ft) = 100.00
Slope (%) = 0.75
N-Value = 0.013

Calculations

Compute by: Known Q
Known Q (cfs) = 0.44

Highlighted

Depth (ft) = 0.06
Q (cfs) = 0.440
Area (sqft) = 0.36
Velocity (ft/s) = 1.22
Wetted Perim (ft) = 6.12
Crit Depth, Yc (ft) = 0.06
Top Width (ft) = 6.00
EGL (ft) = 0.08

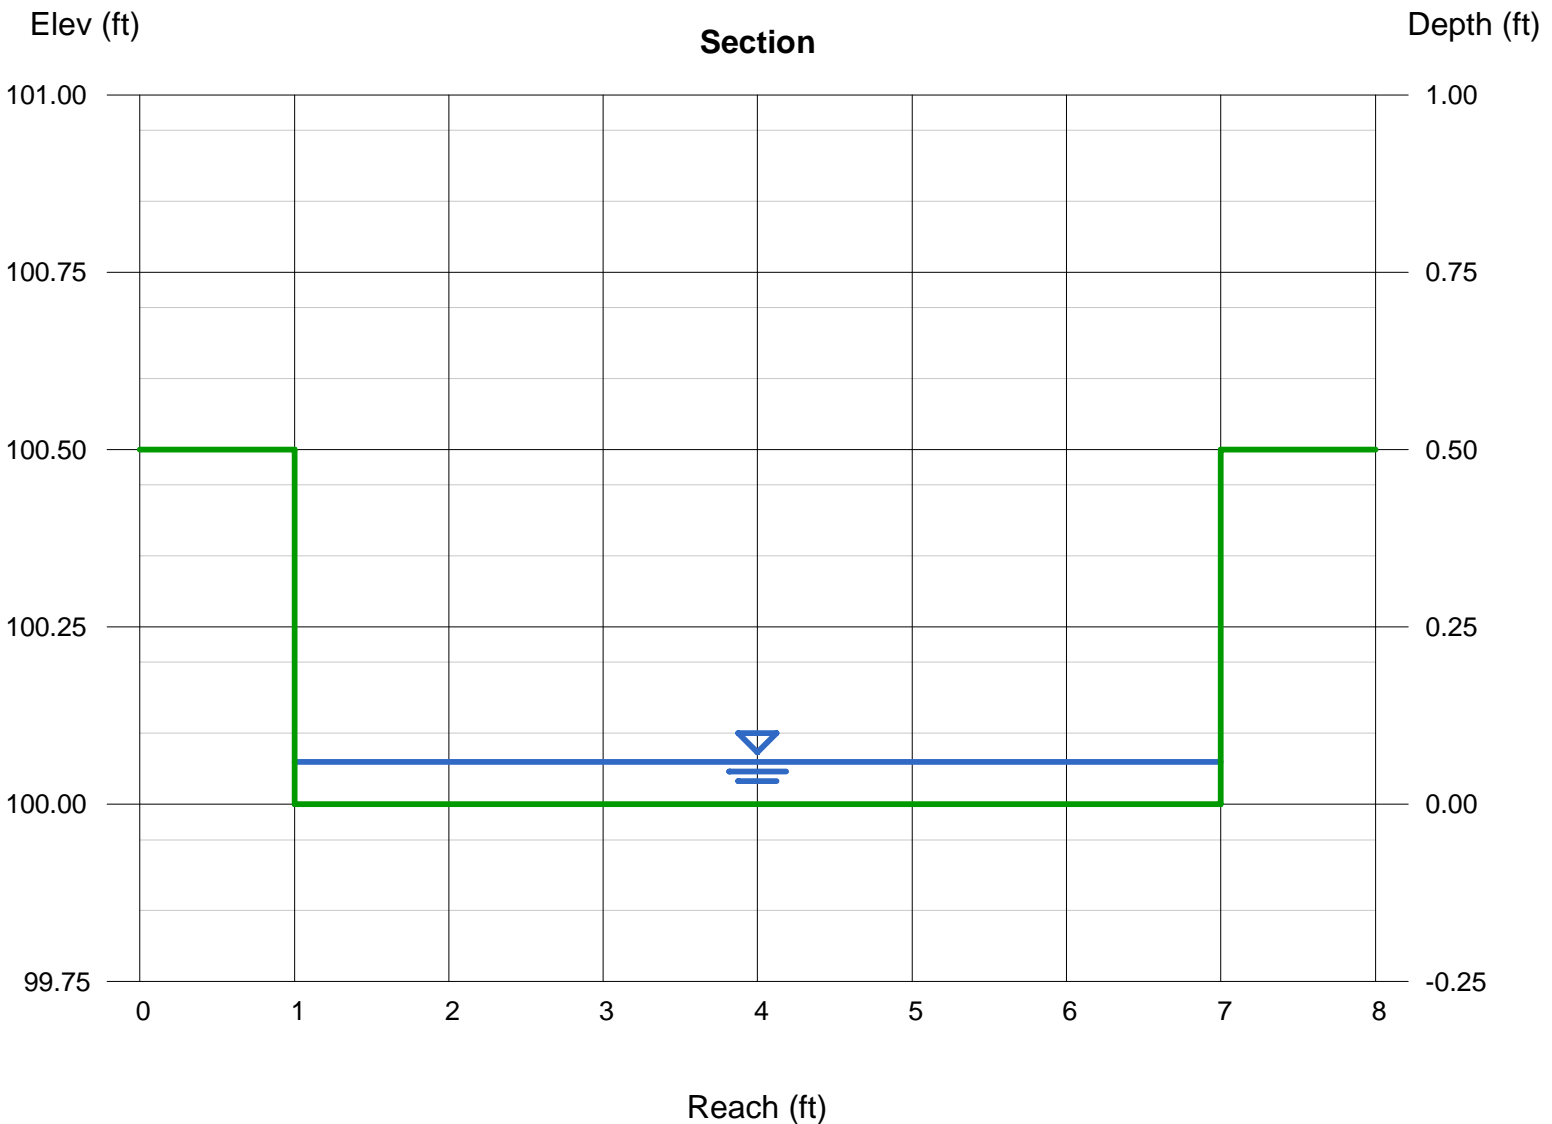

Channel Report

Pond B Trickle Channel - 3.5 ft

Rectangular

Bottom Width (ft) = 3.50
Total Depth (ft) = 0.50


Invert Elev (ft) = 100.00
Slope (%) = 0.75
N-Value = 0.013

Calculations

Compute by: Known Q
Known Q (cfs) = 0.44

Highlighted

Depth (ft) = 0.08
Q (cfs) = 0.440
Area (sqft) = 0.28
Velocity (ft/s) = 1.57
Wetted Perim (ft) = 3.66
Crit Depth, Yc (ft) = 0.08
Top Width (ft) = 3.50
EGL (ft) = 0.12

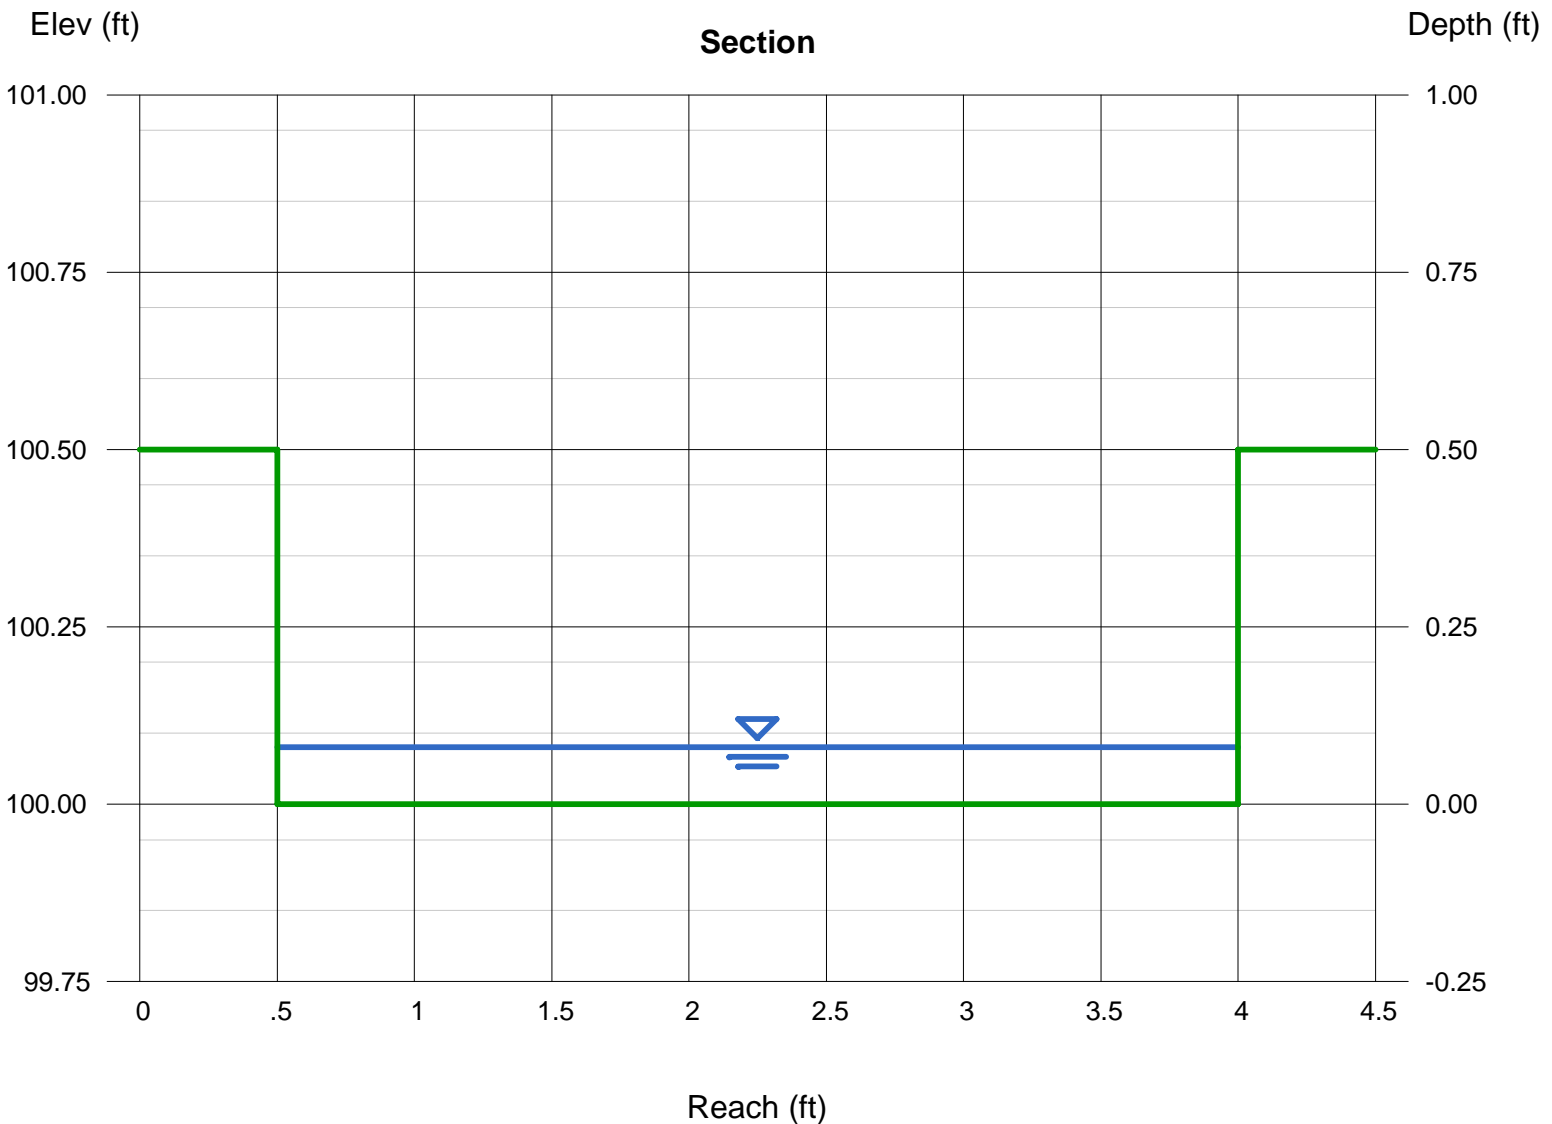

POND B

Figure 13-12c. Emergency Spillway Protection


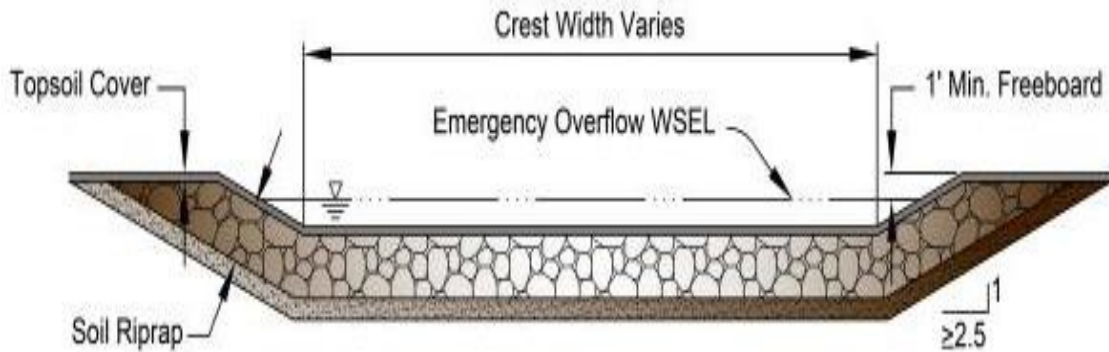


Figure 13-12d. Riprap Types for Emergency Spillway Protection

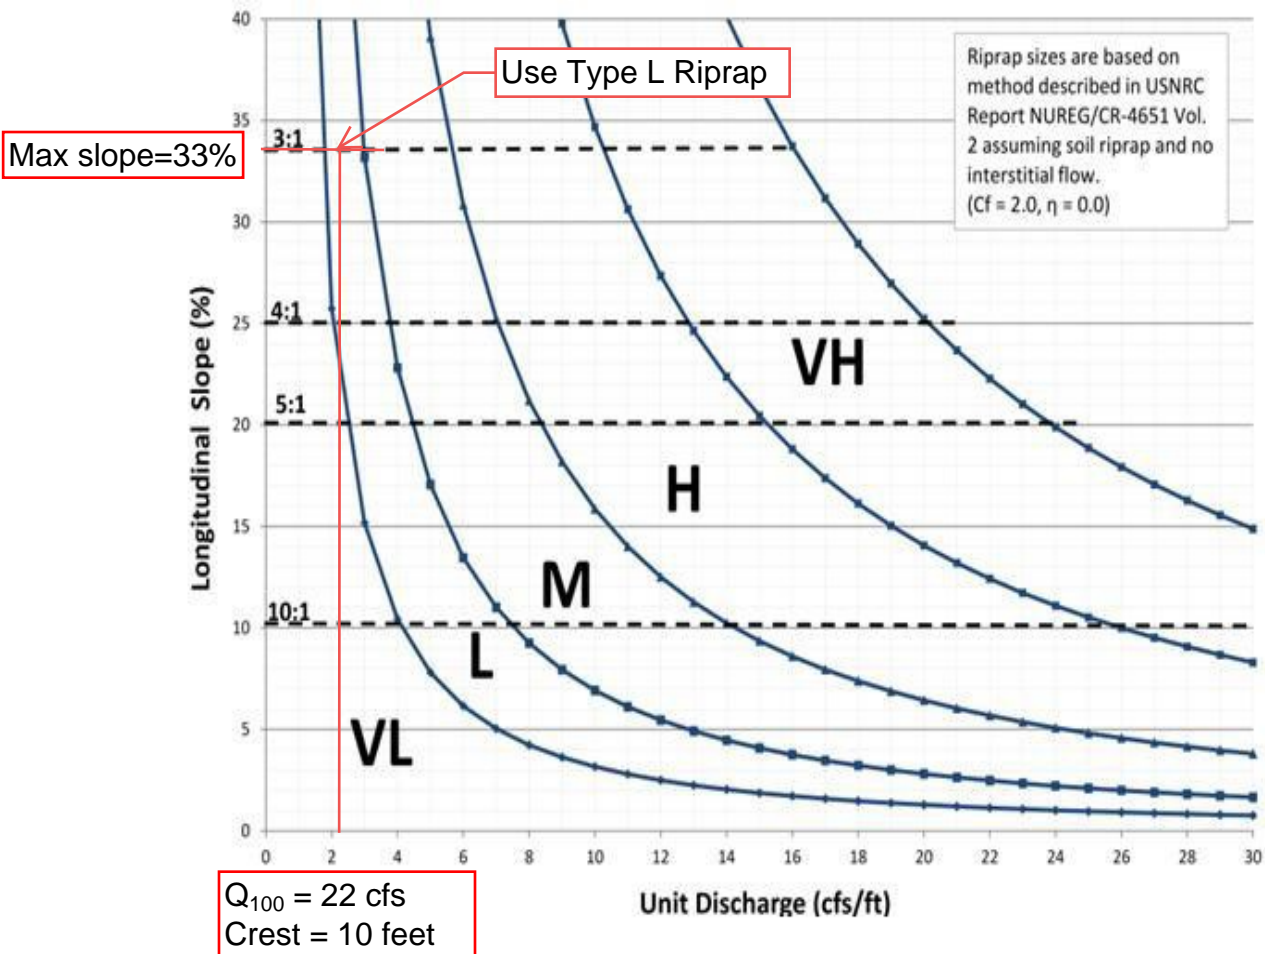

Channel Report

P1 Swale to Combination-Emergency Overflow

Triangular

Side Slopes (z:1) = 33.00, 15.00
Total Depth (ft) = 2.10

Invert Elev (ft) = 1.00
Slope (%) = 1.00
N-Value = 0.035


Calculations

Compute by: Known Q
Known Q (cfs) = 35.60

Highlighted

Depth (ft) = 0.81
Q (cfs) = 35.60
Area (sqft) = 15.75
Velocity (ft/s) = 2.26
Wetted Perim (ft) = 38.92
Crit Depth, Yc (ft) = 0.68
Top Width (ft) = 38.88
EGL (ft) = 0.89

Cathedral Pines Subdivision Filing No. 1
Emergency Overflow via Spillway and 24" RCP
Q₁₀₀ = 35.6 cfs

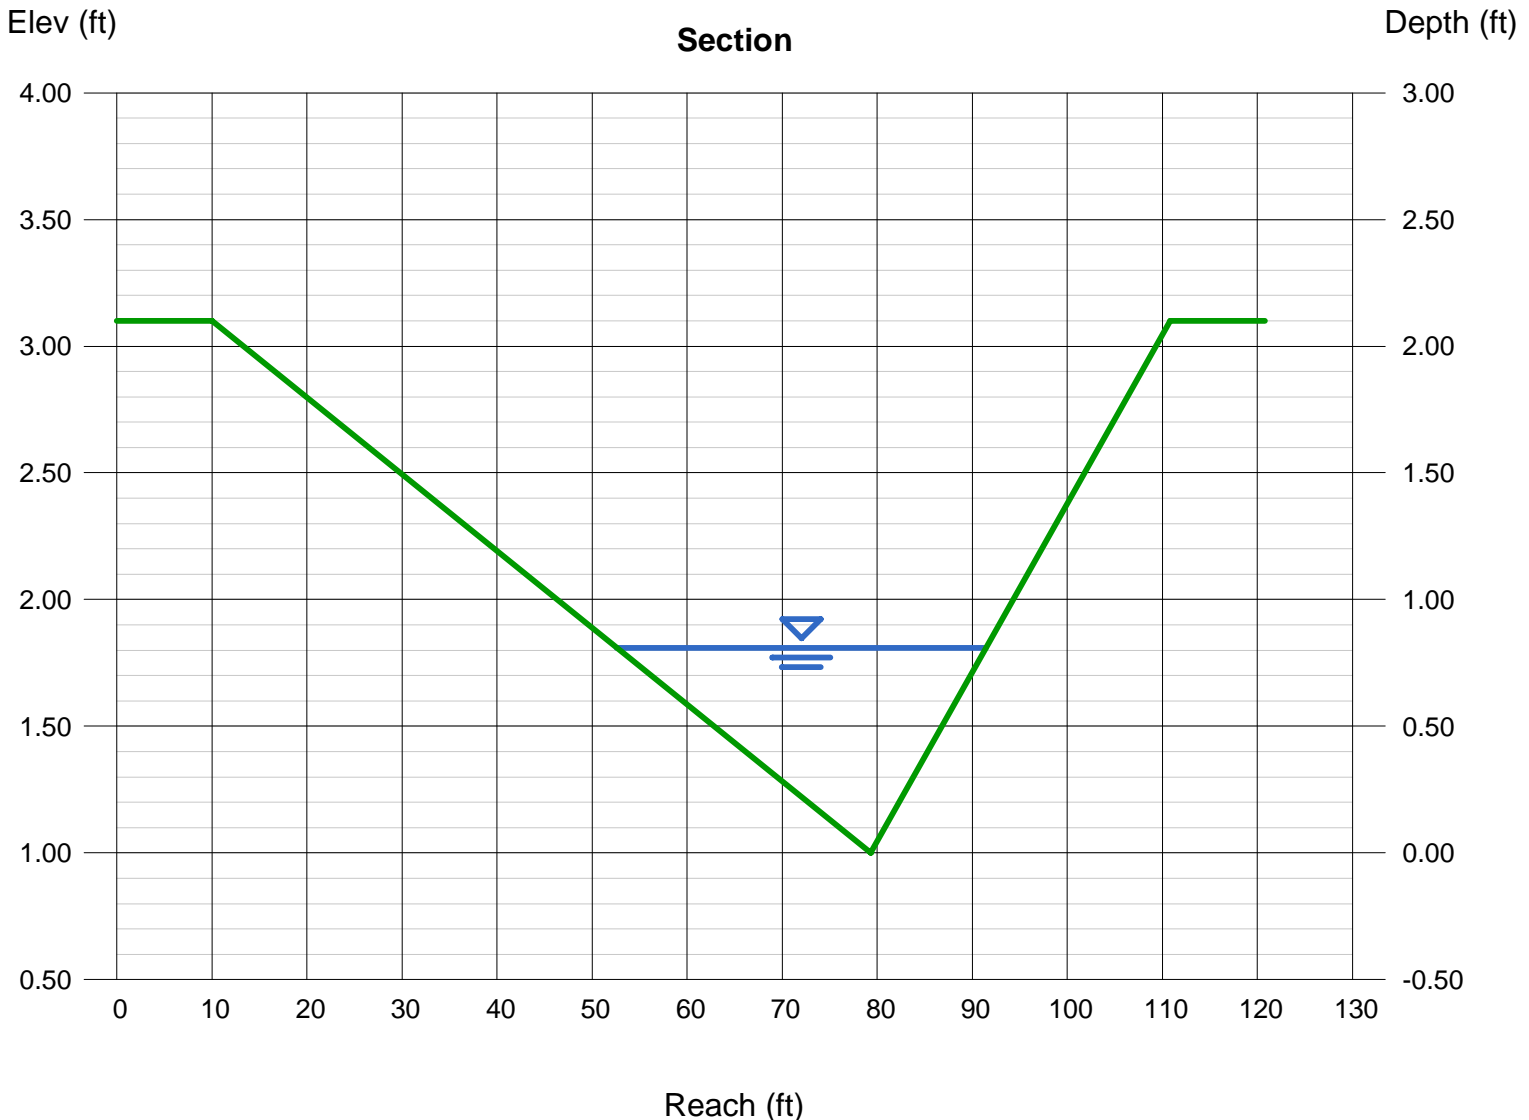

Channel Report

Basin L Roadside Swale-Emergency Flows

Triangular

Side Slopes (z:1) = 4.00, 3.00
Total Depth (ft) = 2.25

Invert Elev (ft) = 100.00
Slope (%) = 2.60
N-Value = 0.030


Calculations

Compute by: Known Q
Known Q (cfs) = 43.20

Highlighted


Depth (ft) = 1.42
Q (cfs) = 43.20
Area (sqft) = 7.06
Velocity (ft/s) = 6.12
Wetted Perim (ft) = 10.35
Crit Depth, Yc (ft) = 1.57
Top Width (ft) = 9.94
EGL (ft) = 2.00

Cathedral Pines Subdivision Filing No. 1
Emergency Overflow via Spillway and 24" RCP
Q₁₀₀ = 35.6 cfs
DP12 Q₁₀₀ = 7.6 cfs
Q₁₀₀ = 35.6 cfs + 7.6 cfs = **43.2 cfs**

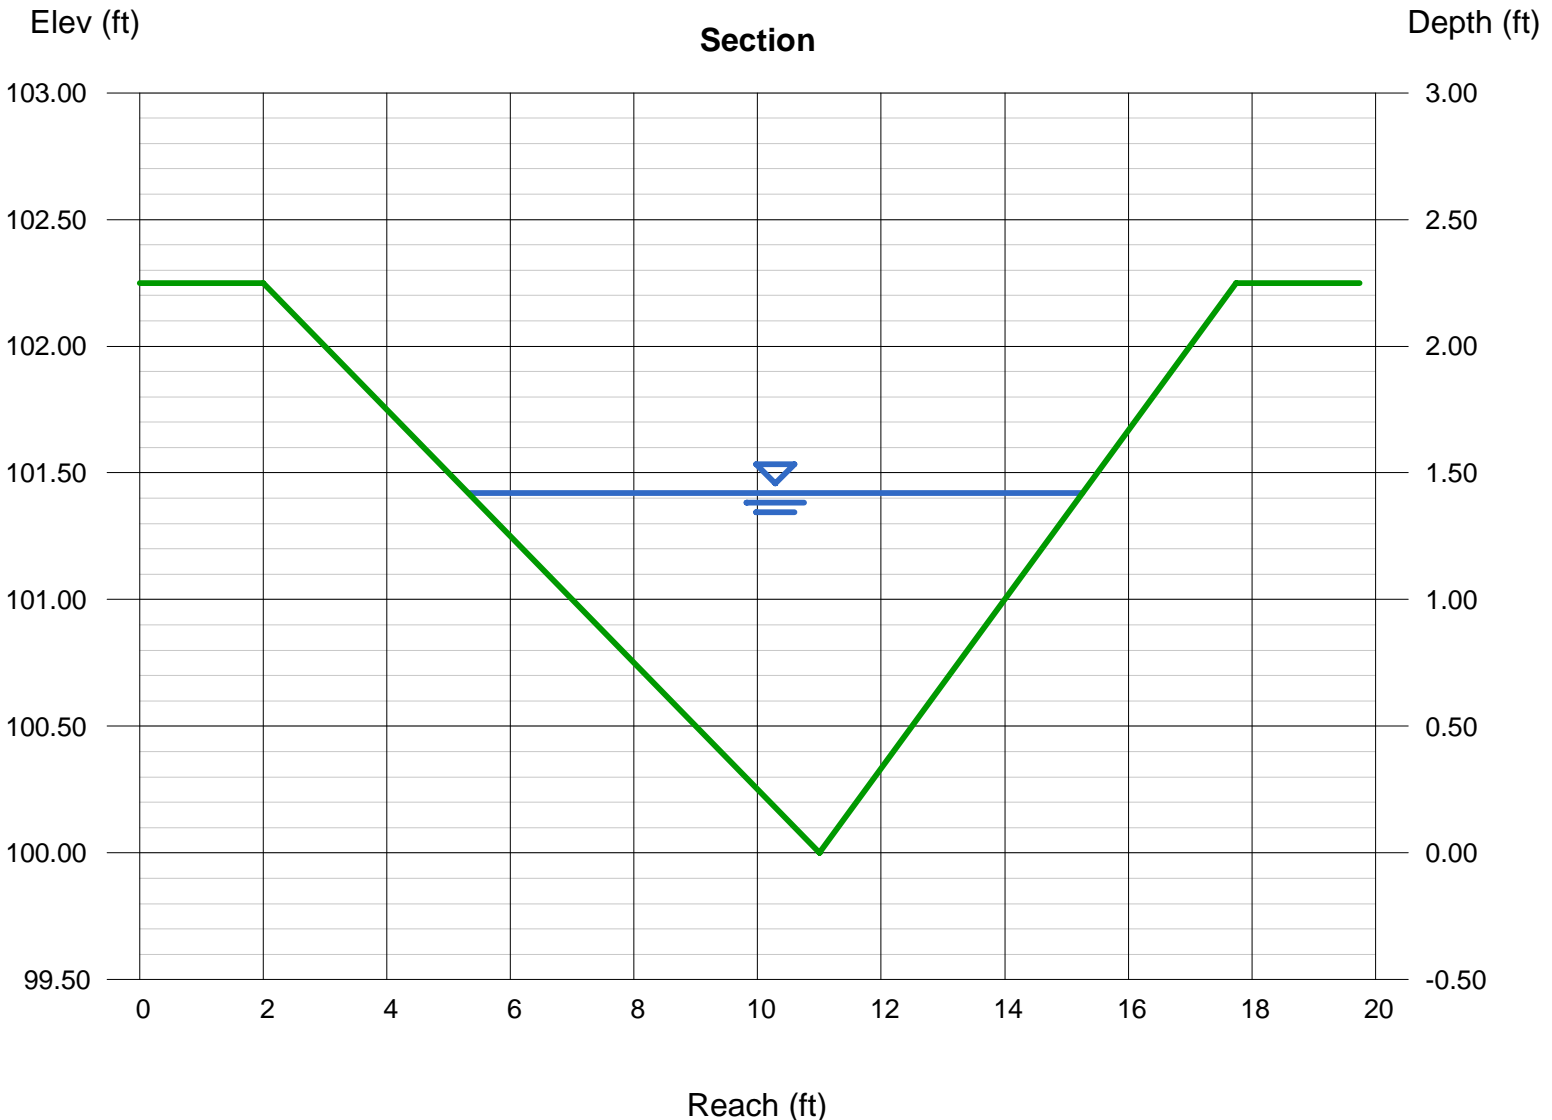

AREA INLET IN A SWALE

Estates at Cathedral Pines
DP13.1-Emergency

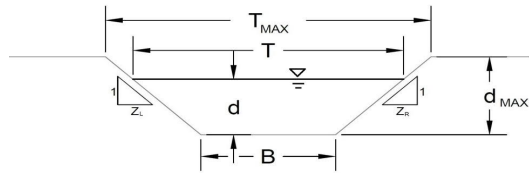


This worksheet uses the NRCS vegetative retardance method to determine Manning's n.
For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method			A, B, C, D, or E =																									
NRCS Vegetal Retardance (A, B, C, D, or E)			n = 0.030																									
Manning's n (Leave cell D16 blank to manually enter an n value)			S ₀ = 0.0010 ft/ft																									
Channel Invert Slope			B = 0.00 ft																									
Bottom Width			Z1 = 4.00 ft/ft																									
Left Side Slope			Z2 = 3.00 ft/ft																									
Right Side Slope			Choose One: <input checked="" type="radio"/> Non-Cohesive <input type="radio"/> Cohesive <input type="radio"/> Paved																									
Check one of the following soil types: <table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th style="text-align: left;">Soil Type:</th> <th style="text-align: left;">Max. Velocity (V_{max})</th> <th style="text-align: left;">Max Froude No. (F_{max})</th> </tr> </thead> <tbody> <tr> <td>Non-Cohesive</td> <td>5.0 fps</td> <td>0.60</td> </tr> <tr> <td>Cohesive</td> <td>7.0 fps</td> <td>0.80</td> </tr> <tr> <td>Paved</td> <td>N/A</td> <td>N/A</td> </tr> </tbody> </table>			Soil Type:	Max. Velocity (V _{max})	Max Froude No. (F _{max})	Non-Cohesive	5.0 fps	0.60	Cohesive	7.0 fps	0.80	Paved	N/A	N/A	<table border="1" style="width: 100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th></th> <th>Minor Storm</th> <th>Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>T_{MAX} =</td> <td>21.00</td> <td>21.00</td> <td>ft</td> </tr> <tr> <td>d_{MAX} =</td> <td>3.00</td> <td>3.00</td> <td>ft</td> </tr> </tbody> </table>			Minor Storm	Major Storm		T _{MAX} =	21.00	21.00	ft	d _{MAX} =	3.00	3.00	ft
Soil Type:	Max. Velocity (V _{max})	Max Froude No. (F _{max})																										
Non-Cohesive	5.0 fps	0.60																										
Cohesive	7.0 fps	0.80																										
Paved	N/A	N/A																										
	Minor Storm	Major Storm																										
T _{MAX} =	21.00	21.00	ft																									
d _{MAX} =	3.00	3.00	ft																									
Maximum Allowable Top Width of Channel for Minor & Major Storm																												
Maximum Allowable Water Depth in Channel for Minor & Major Storm																												
Allowable Channel Capacity Based On Channel Geometry																												
MINOR STORM Allowable Capacity is based on Depth Criterion			Q _{allow} = 63.1 cfs																									
MAJOR STORM Allowable Capacity is based on Depth Criterion			d _{allow} = 3.00 ft																									
Water Depth in Channel Based On Design Peak Flow																												
Design Peak Flow			Q _o = 0.0 cfs																									
Water Depth			d = 0.04 ft																									
Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management' Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'																												

AREA INLET IN A SWALE

Estates at Cathedral Pines
 DP13.1-Emergency

Inlet Design Information (Input)	
Type of Inlet	<input type="text" value="CDOT Type C"/> Inlet Type = <input type="text" value="CDOT Type C"/>
Angle of Inclined Grate (must be <= 30 degrees)	$\theta = 0.00$ degrees
Width of Grate	$W = 3.00$ ft
Length of Grate	$L = 3.00$ ft
Open Area Ratio	$A_{RATIO} = 0.70$
Height of Inclined Grate	$H_B = 0.00$ ft
Clogging Factor	$C_r = 0.50$
Grate Discharge Coefficient	$C_d = 0.96$
Orifice Coefficient	$C_o = 0.64$
Weir Coefficient	$C_w = 2.05$

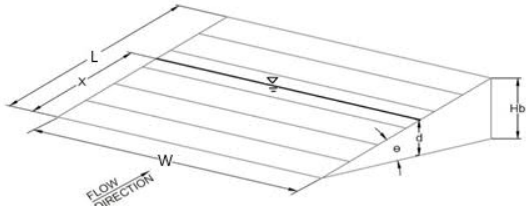

	MINOR	MAJOR	
$d =$	0.04	2.65	
$Q_a =$	0.1	26.3	cfs
$Q_b =$	0.0	19.0	cfs
$C\% =$	100	58	%

Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)	$d =$	0.04	2.65	
Total Inlet Interception Capacity (assumes clogged condition)	$Q_a =$	0.1	26.3	cfs
Bypassed Flow	$Q_b =$	0.0	19.0	cfs
Capture Percentage = Q_a/Q_o	$C\% =$	100	58	%

Emergency Overflow DP12.1 $Q_{100} = 43.2$ cfs
 DP13 $Q_{100} = 2.1$ cfs
 $Q_{100} = 43.2$ cfs + 2.1 cfs = **45.3 cfs**

Flows would stay within Basin L roadway swale and then overtop the proposed inlet depression.
 Overtopped flows enter into the proposed South Pond.

Weir Report

South Pond-Emergency Overflow

Trapezoidal Weir

Crest = Sharp
Bottom Length (ft) = 10.00
Total Depth (ft) = 1.50
Side Slope (z:1) = 4.00


Highlighted

Depth (ft) = 1.22
Q (cfs) = 57.60
Area (sqft) = 18.15
Velocity (ft/s) = 3.17
Top Width (ft) = 19.76

Calculations

Weir Coeff. Cw = 3.10
Compute by: Known Q
Known Q (cfs) = 57.60

Cathedral Pines Subdivision Filing No. 1
Emergency Overflow via Spillway and 24" RCP
Q₁₀₀ = 35.6 cfs
DP14.1 (South Pond) Q₁₀₀ = 22 cfs
Q₁₀₀ = 35.6 cfs + 22 cfs = **57.6 cfs**

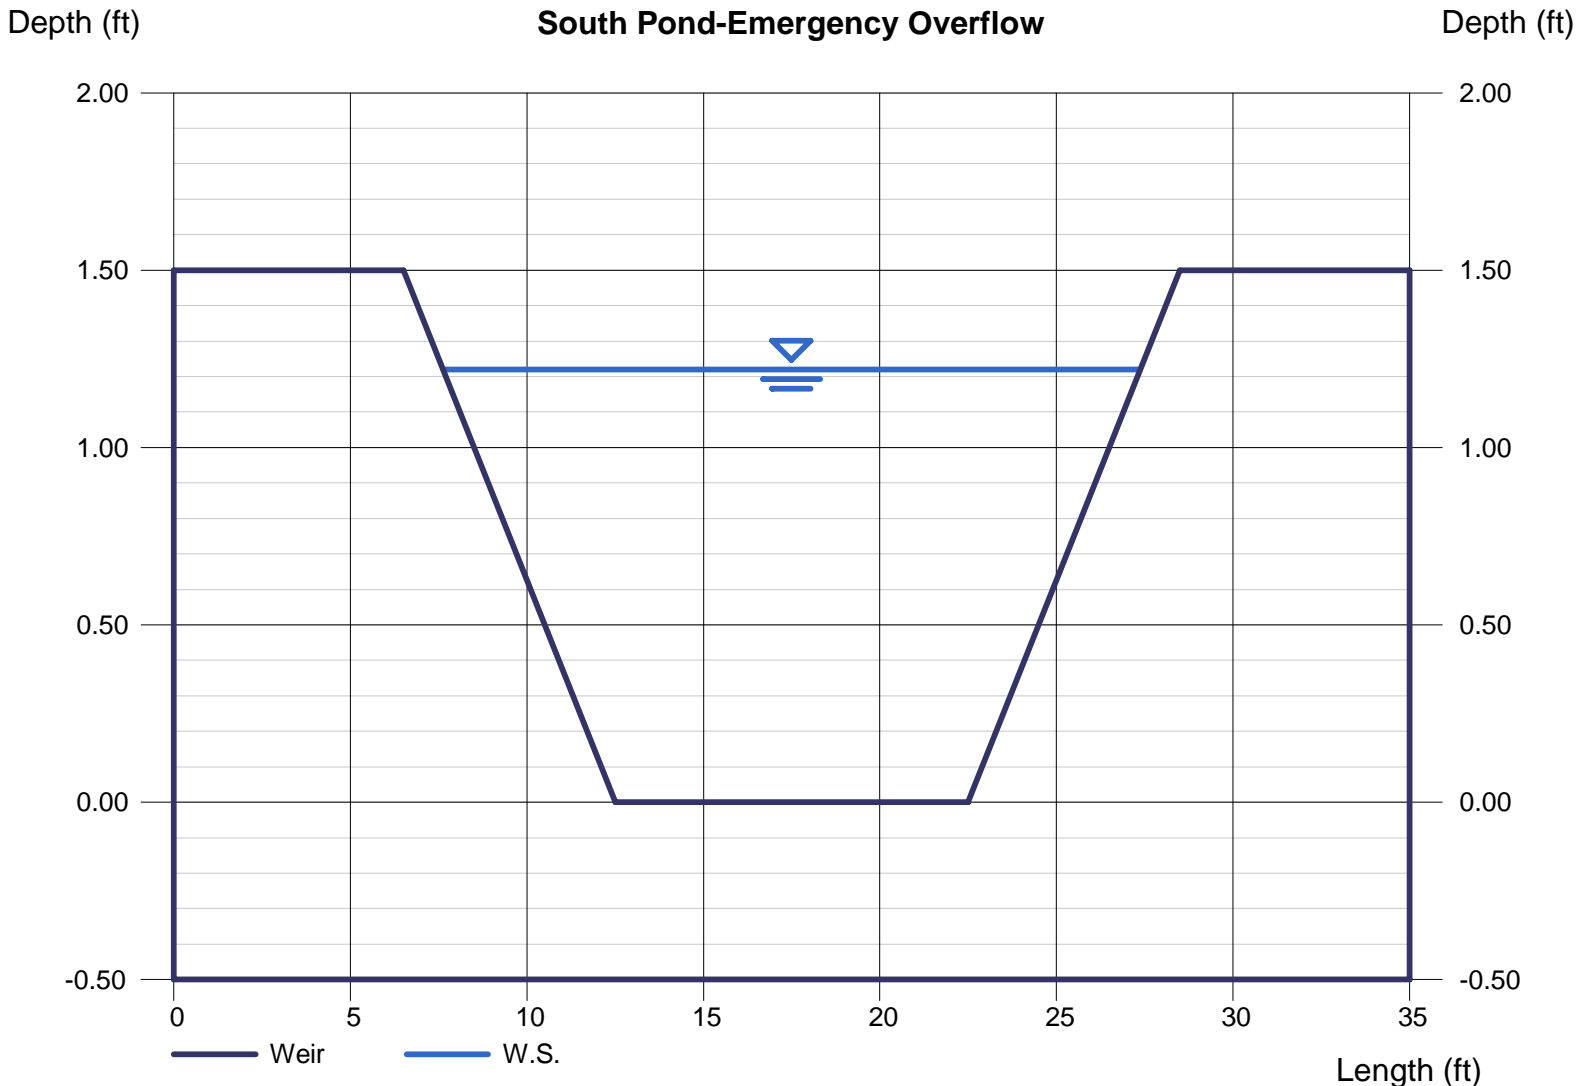

Channel Report

Basin O Existing Swale-Emergency Overflow

User-defined

Invert Elev (ft) = 7303.25
Slope (%) = 5.00
N-Value = 0.030

Highlighted

Depth (ft) = 0.96
Q (cfs) = 68.30
Area (sqft) = 8.89
Velocity (ft/s) = 7.68
Wetted Perim (ft) = 15.04
Crit Depth, Yc (ft) = 1.26
Top Width (ft) = 14.88
EGL (ft) = 1.88


Calculations

Compute by: Known Q
Known Q (cfs) = 68.30

(Sta, El, n)-(Sta, El, n)...


(0.00, 7307.07) -(8.60, 7306.82, 0.030) -(18.35, 7304.06, 0.030) -(24.28, 7303.25, 0.030) -(29.38, 7303.47, 0.030) -(50.00, 7308.07, 0.030)

Cathedral Pines Subdivision Filing No. 1
Emergency Overflow via Spillway and 24" RCP
Q₁₀₀ = 35.6 cfs
DP14.1 (South Pond) Q₁₀₀ = 22 cfs
DP15 Q₁₀₀ = 10.7 cfs
Q₁₀₀ = 35.6 cfs + 22 cfs + 10.7 cfs = **68.3 cfs**

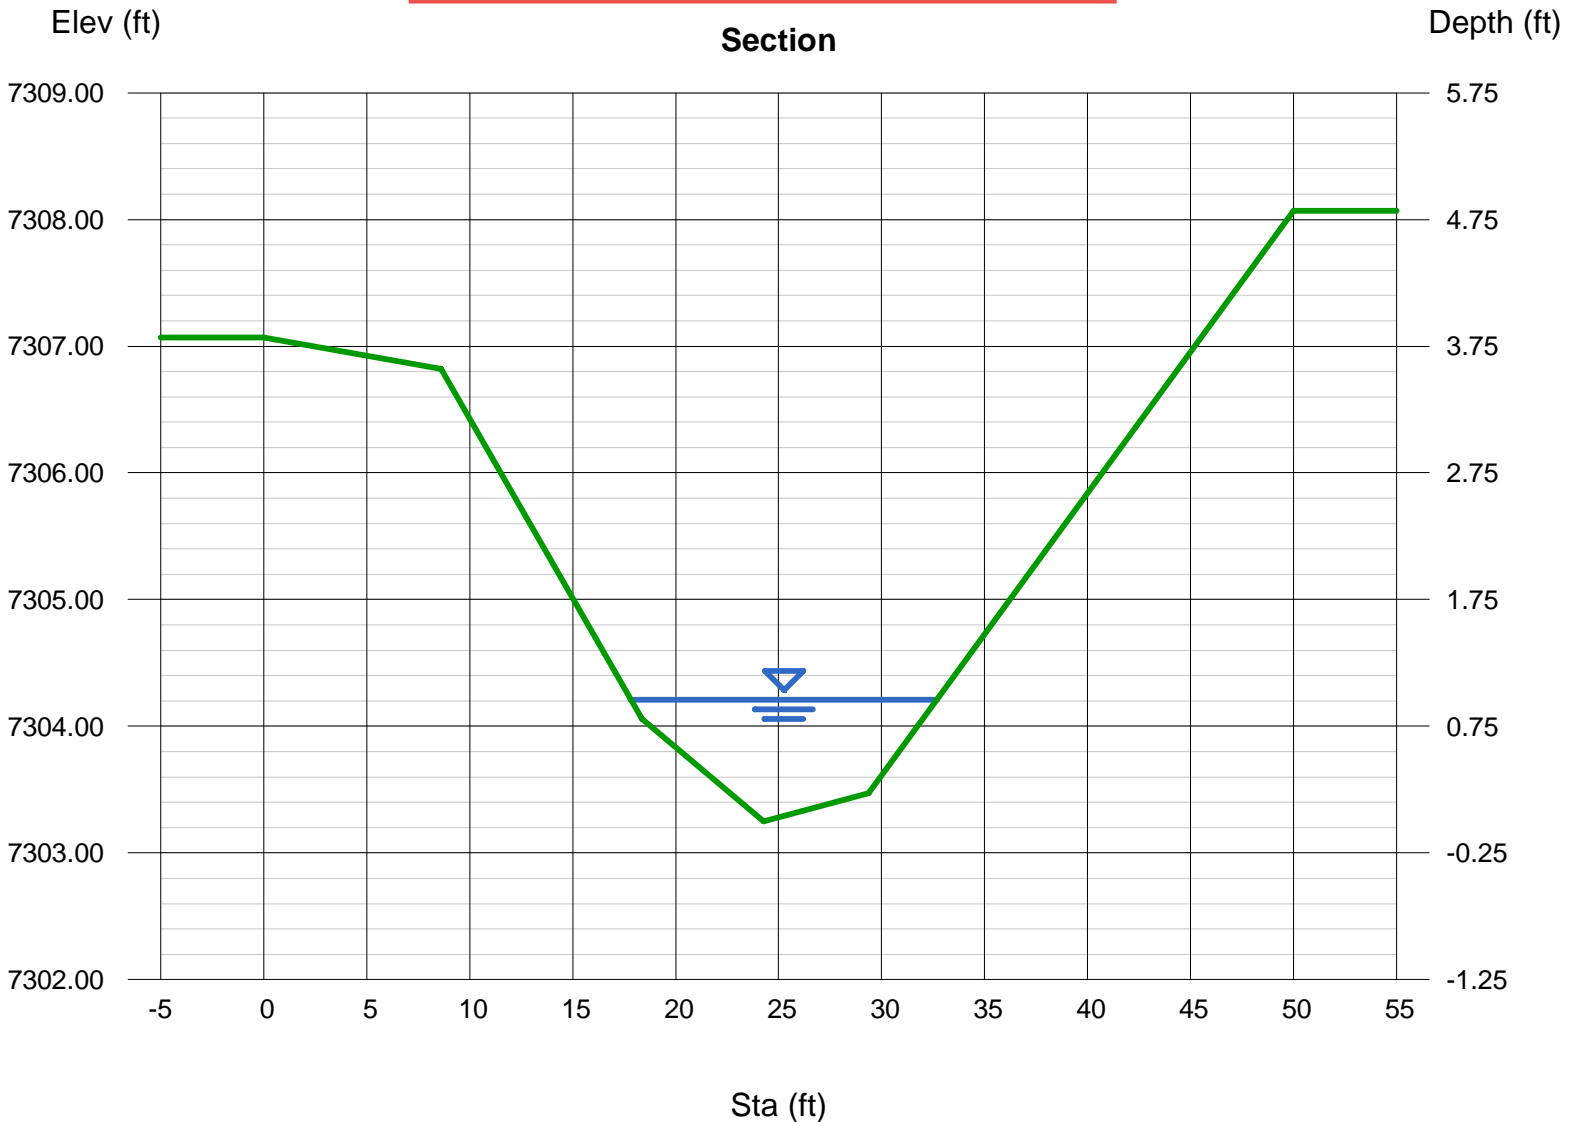

APPENDIX D
REFERENCE MATERIALS

Approved
El Paso County
Planning Commission
This 17th day of Jan. 1989



Chairman
Clair Nebes, Secretary

URS
CONSULTANTS
MAKING
TECHNOLOGY
WORK

Black Squirrel Creek Drainage Basin Planning Study

City of Colorado Springs
and El Paso County

January, 1989

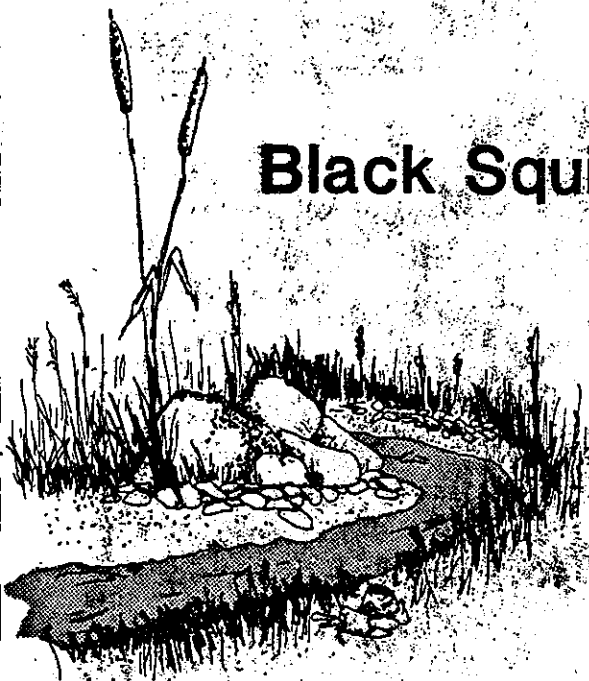





Department, the City Public Works Department, the City Planning Department, along with the aid of the Black Forest Preservation Study, the Urban Planning Area Map, and the Northgate Master Plan. The area between Interstate 25 and State Highway 83 (Downstream of D.P. #6) was assumed to be developed as if it was an urban type development. A buffer area was also assumed along State Highway 83 consisting of 2.5 acre development. This buffer area was assumed to be included within the urban development. The remaining area was assumed to be developed in a rural type development with an average lot size of 5 acres per current zoning and presently platted subdivisions within the basin. This was assumed to be appropriate due to the limiting density where City services are anticipated to be available and the desirability of maintaining the forest area in a more rural type setting. The Air Force Academy land was assumed to remain undeveloped and was not included in the drainage and bridge fee calculations. Future changes in land use beyond this concept would require a revision to this study. Land use assumptions for the basin are depicted on Figure 1.

LEGEND



LAND USE


-  5 ACRE DEVELOPMENT
-  2.5 ACRE DEVELOPMENT
-  MIXED DEVELOPMENT (URBAN)
-  UNDEVELOPABLE

ASSUMED MIXED DEVELOPMENT (URBAN)

LAND USE	% OF AREA	CN
BUSINESS PARK	63	92
COMMERCIAL, OFFICE		
RESIDENTIAL	25	78
PARK / OPEN SPACE	6	64
MAJOR ROADS	6	98

$\Sigma = 100$

CN = 87

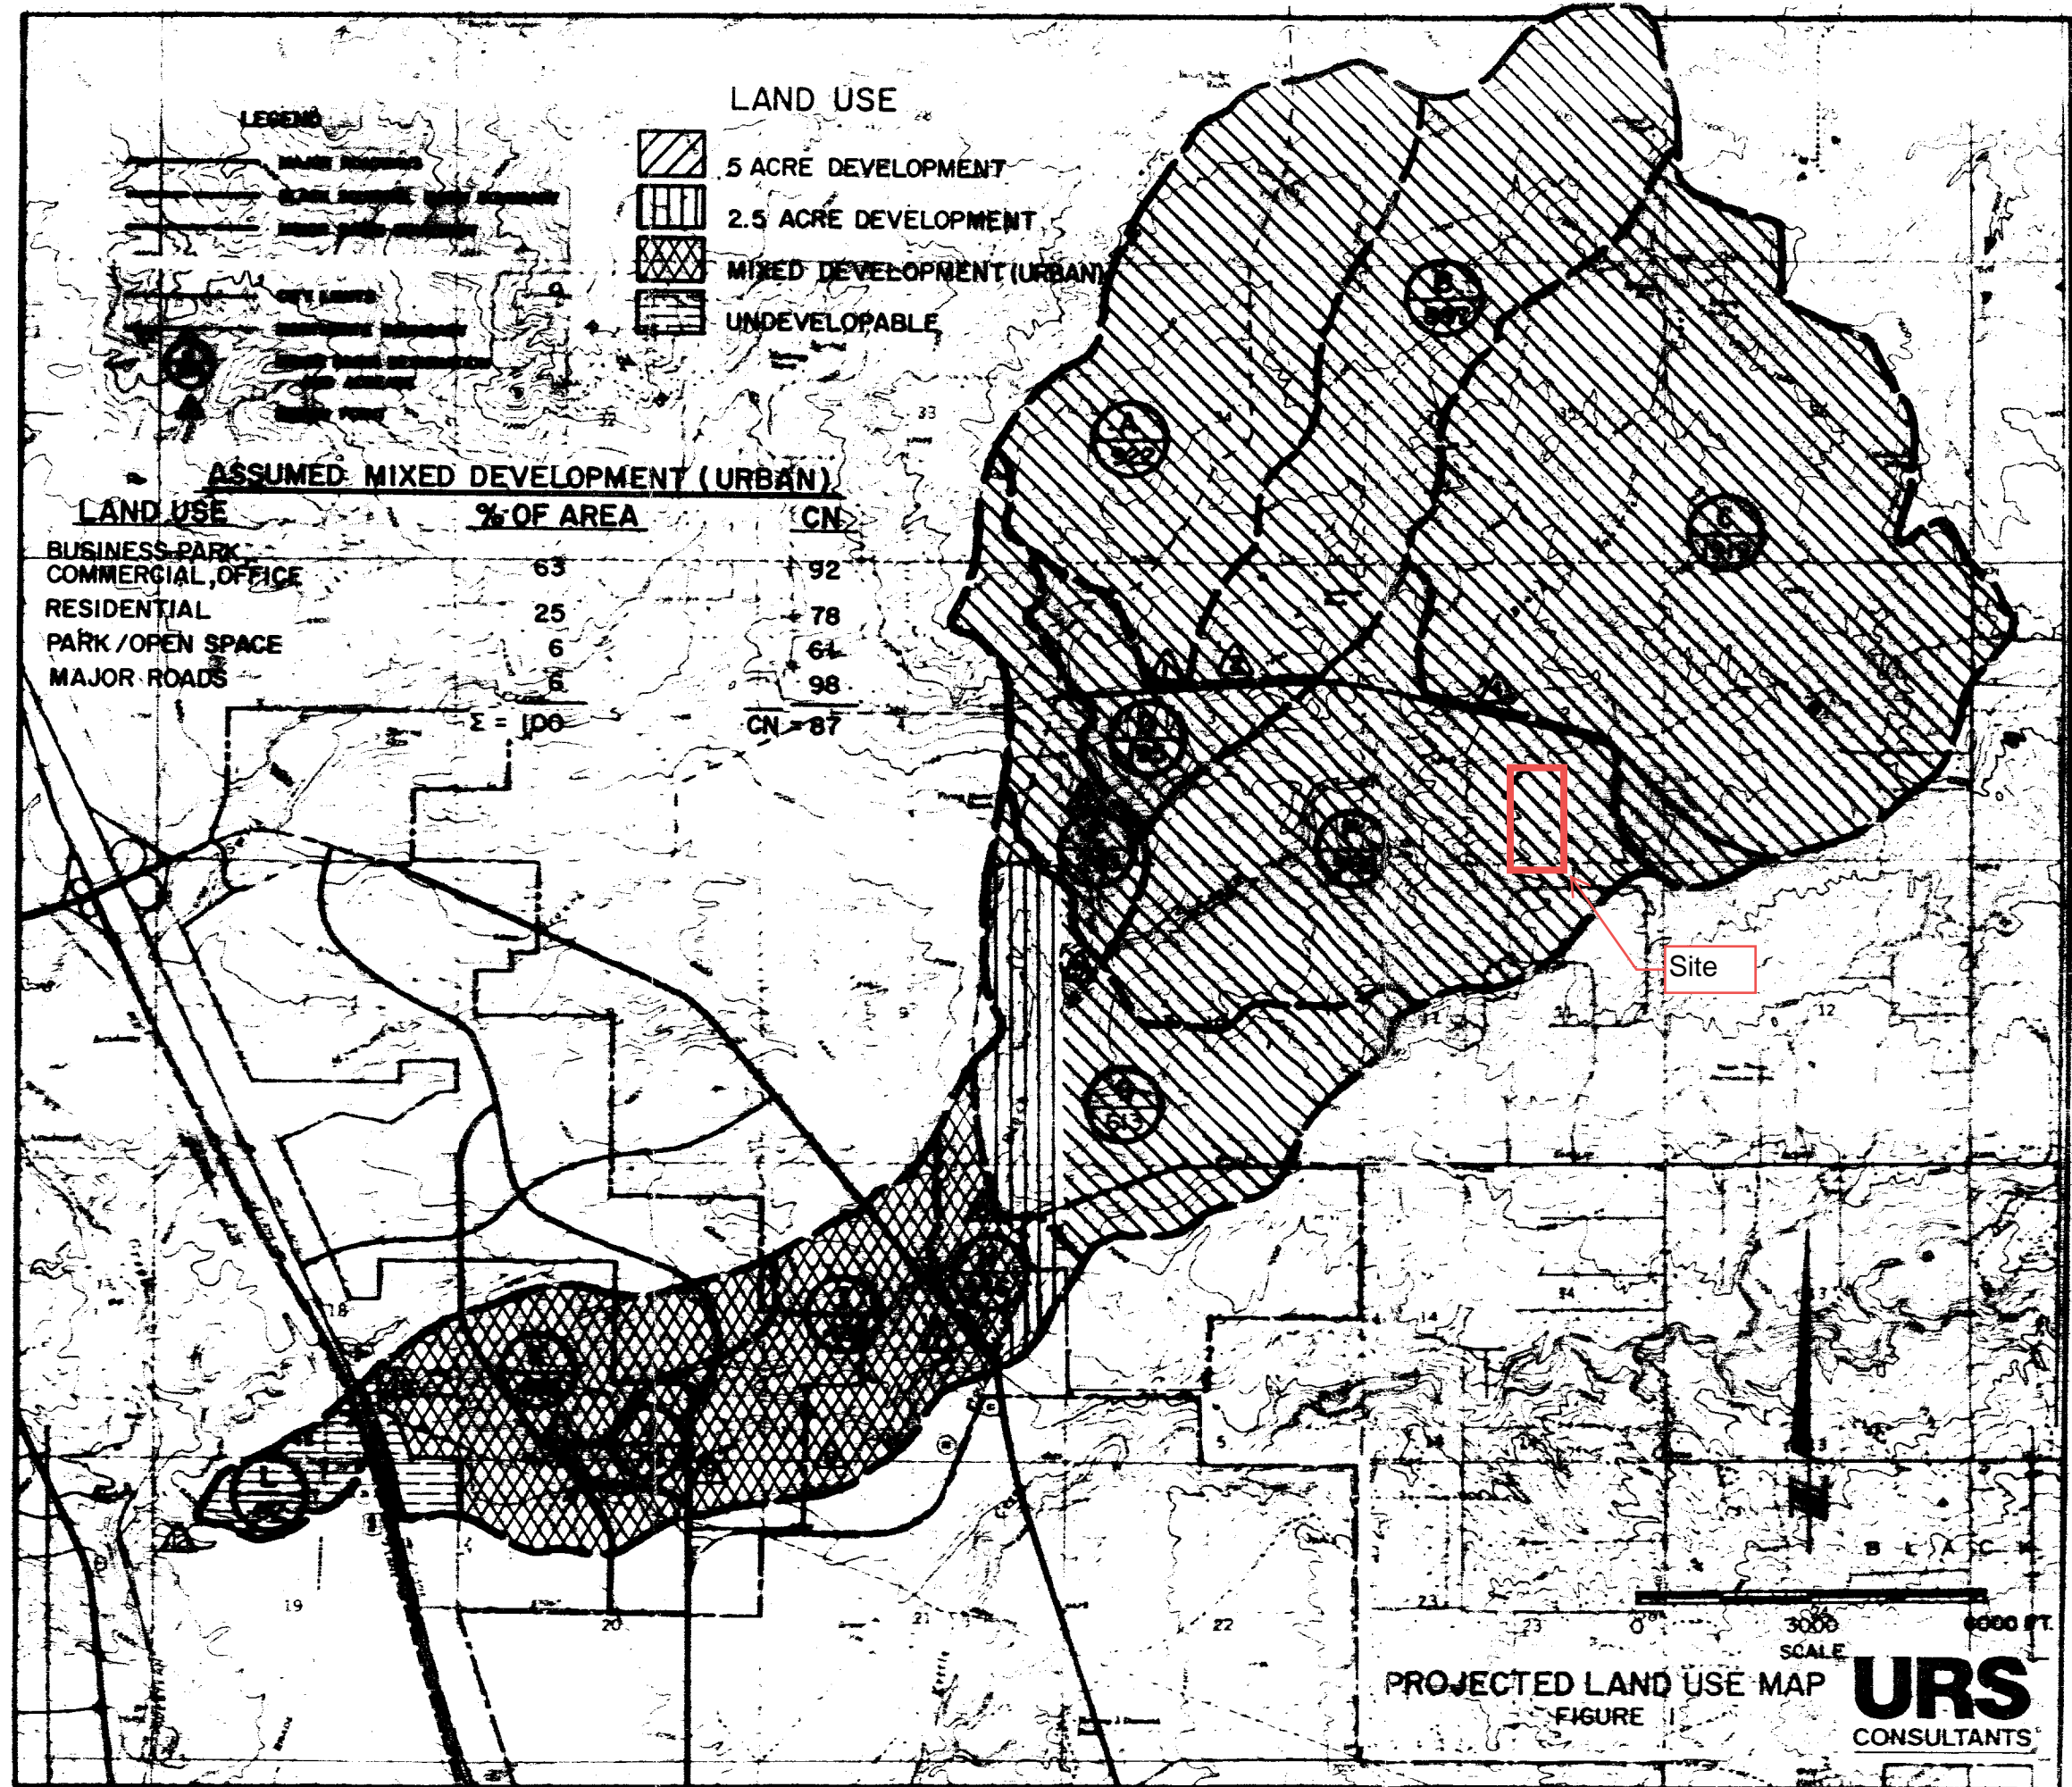

Site

PROJECTED LAND USE MAP
FIGURE

0 3000 6000 FT.
SCALE




Curve number development for the rural area was generated by assuming five acre type development. The five acre parcel was assumed to consist of approximately 16% developed area (CN=93) with the remaining 84% being split based on percentage of forest (CN=63) and range (CN=69) land in the subbasin. The developed area, within the five acre parcel, was assumed to include approximately 7% of impervious area (CN=98) and 9% of gravel driveway and adjacent road (CN=89). The curve numbers presented are intended to be conservative to allow for uncertainties in land use predictions, present and future paved driveways and roads, and assuming "fair" to "poor" hydrological conditions for range and forest land uses due to a general lack of ground cover.

Drainage facilities are designed and constructed according to the City/County Criteria Manual. Other possible requirements may be imposed through the Corps of Engineers 404 permit process and through the Flood Plain Administrator concerning current FEMA mapping, map revisions, and amendments in conjunction with the planning process. Additional costs associated with these processes have not been included here.

MAJOR CHANNEL SYSTEM

Reaches 1 through 19 and 21 are primarily located in the upper reaches of the basin. These reaches are proposed to remain as natural as possible except for the addition of grade control structures and riprap at sharp horizontal bends for the purpose of stabilizing the channel. A total of 136 grade control

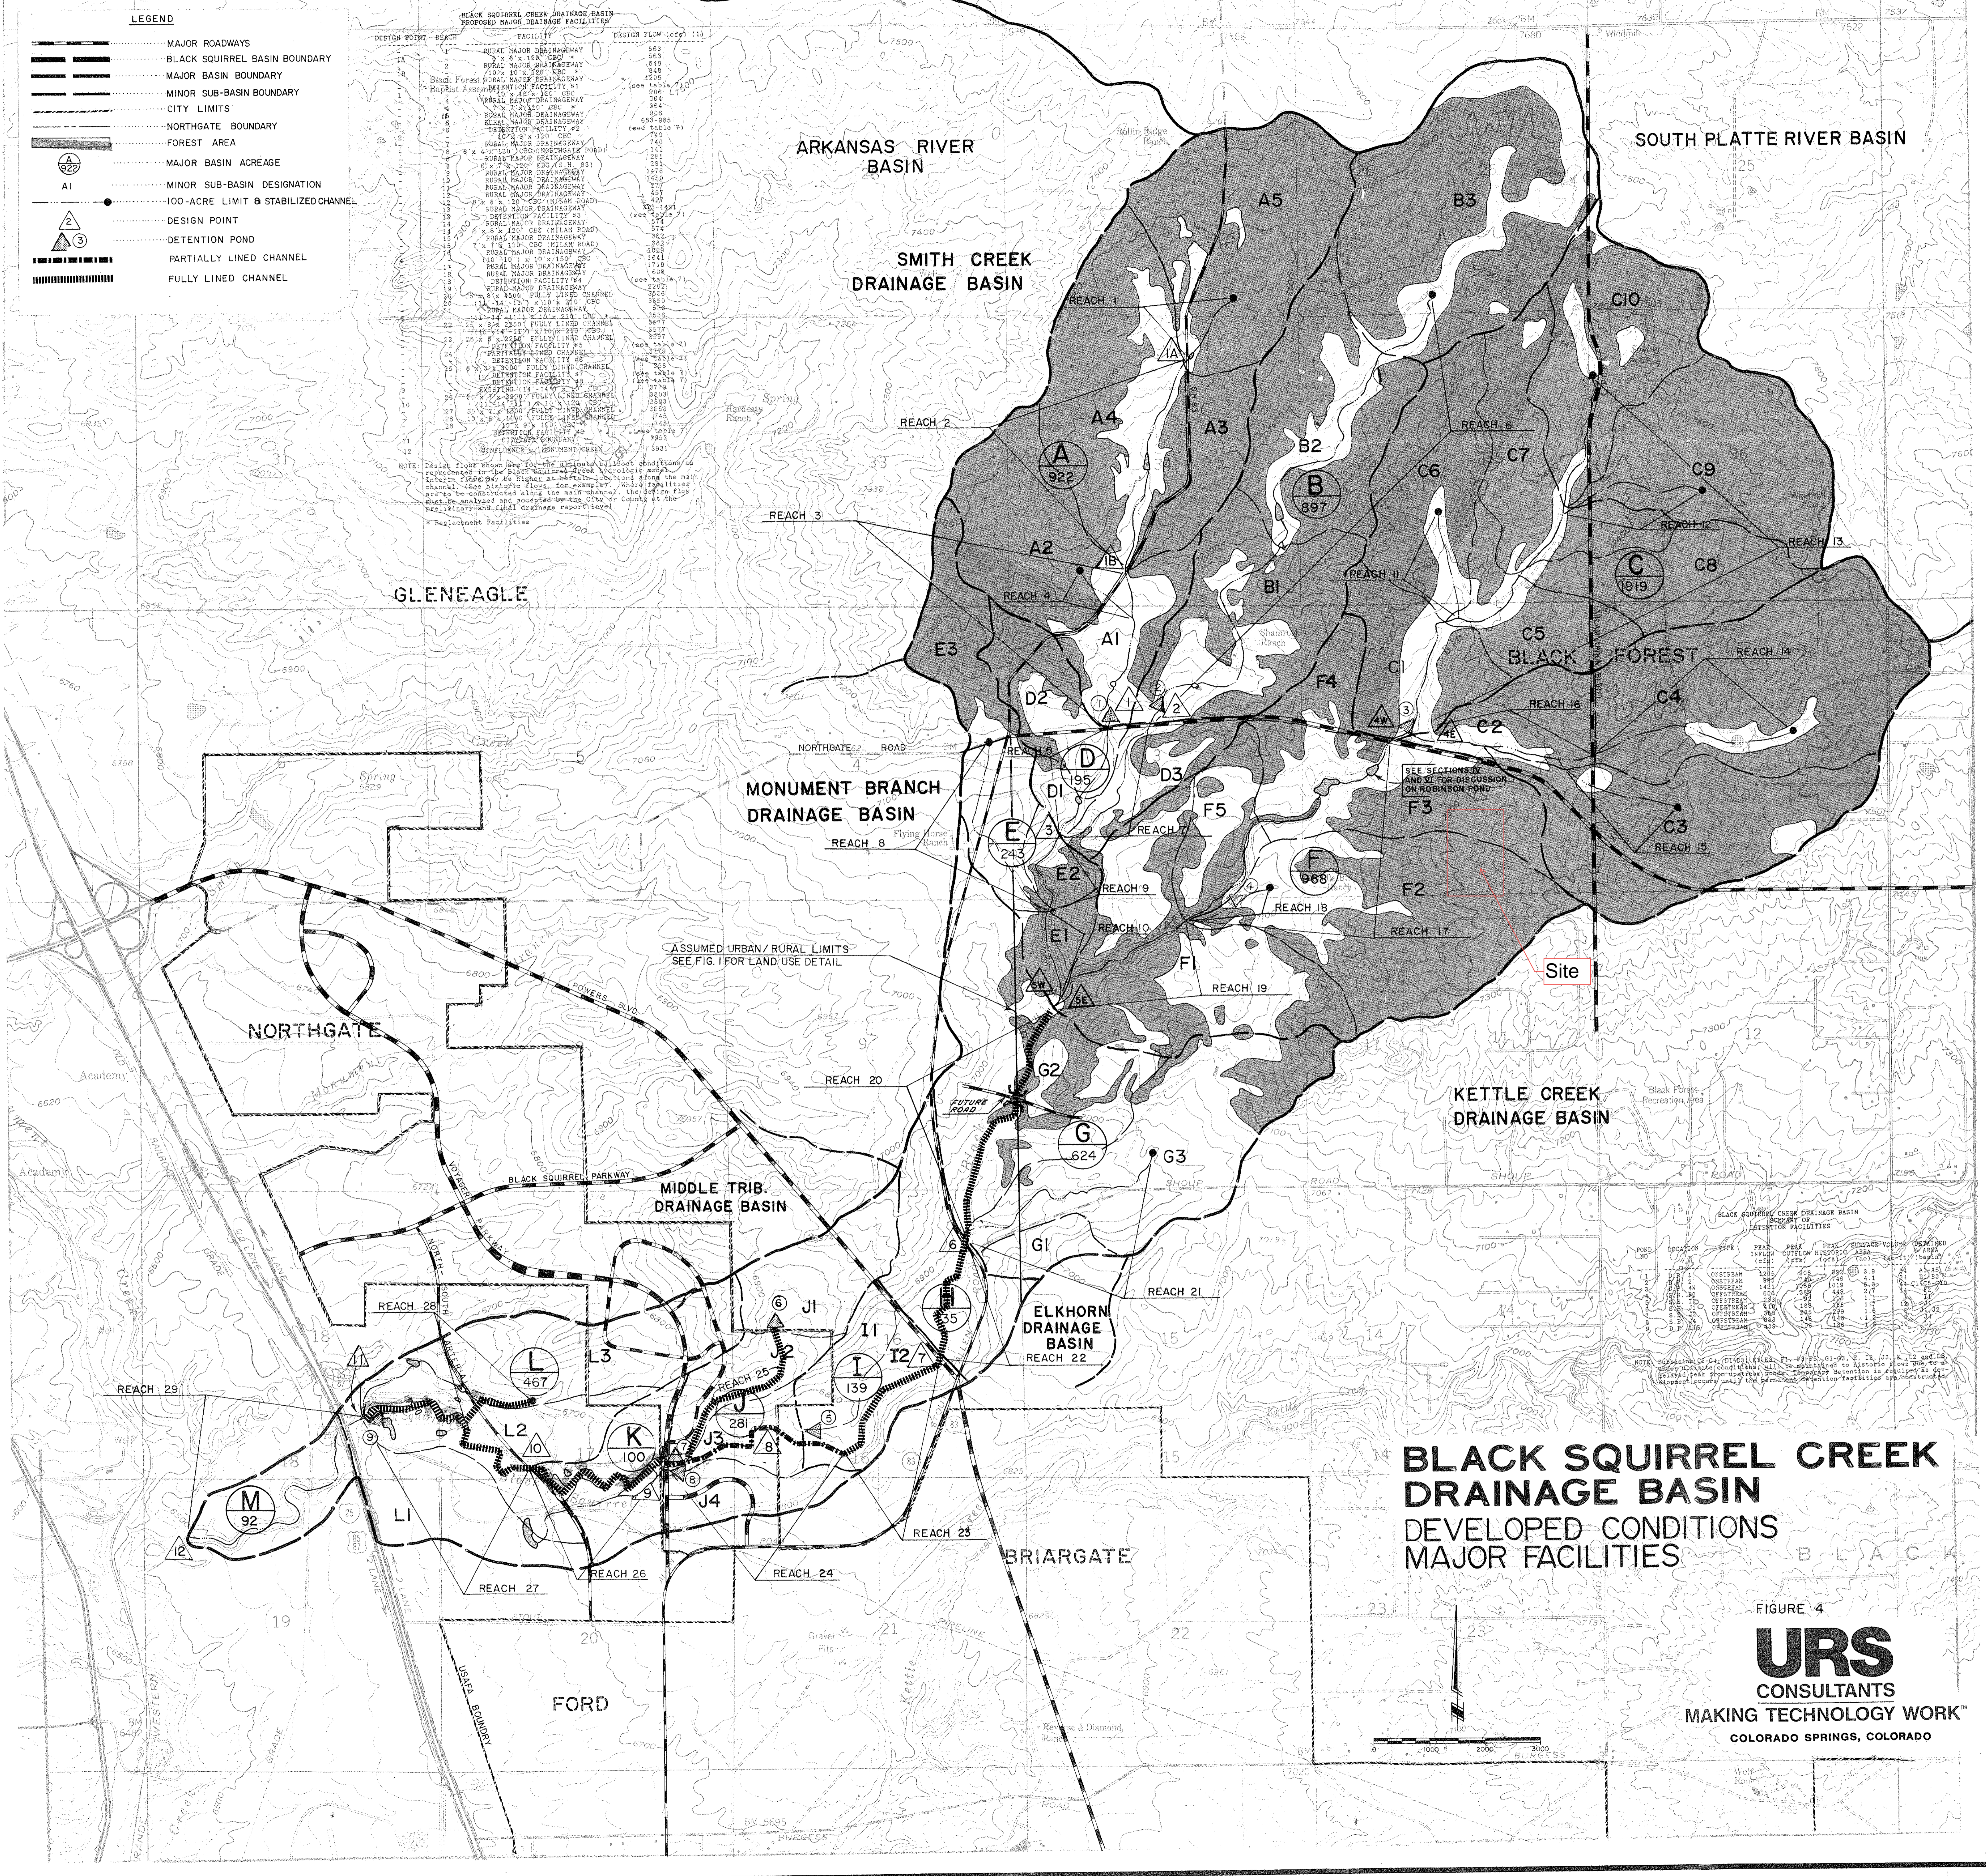

- LEGEND**
- MAJOR ROADWAYS
 - BLACK SQUIRREL BASIN BOUNDARY
 - MAJOR BASIN BOUNDARY
 - MINOR SUB-BASIN BOUNDARY
 - CITY LIMITS
 - NORTHGATE BOUNDARY
 - FOREST AREA
 - MAJOR BASIN ACREAGE
 - MINOR SUB-BASIN DESIGNATION
 - 100-ACRE LIMIT & STABILIZED CHANNEL
 - DESIGN POINT
 - DETENTION POND
 - PARTIALLY LINED CHANNEL
 - FULLY LINED CHANNEL


BLACK SQUIRREL CREEK DRAINAGE BASIN
DEVELOPED MAJOR DRAINAGE FACILITIES

DESIGN POINT - REACH	FACILITY	DESIGN FLOW (cfs) (1)
1A	RURAL MAJOR DRAINAGEWAY	87
1B	RURAL MAJOR DRAINAGEWAY	869
2	RURAL MAJOR DRAINAGEWAY	848
3	RURAL MAJOR DRAINAGEWAY	1014
4	RURAL MAJOR DRAINAGEWAY	864
5	RURAL MAJOR DRAINAGEWAY	896
6	RURAL MAJOR DRAINAGEWAY	685-985
7	RURAL MAJOR DRAINAGEWAY	700
8	RURAL MAJOR DRAINAGEWAY	700
9	RURAL MAJOR DRAINAGEWAY	700
10	RURAL MAJOR DRAINAGEWAY	700
11	RURAL MAJOR DRAINAGEWAY	700
12	RURAL MAJOR DRAINAGEWAY	700
13	RURAL MAJOR DRAINAGEWAY	700
14	RURAL MAJOR DRAINAGEWAY	700
15	RURAL MAJOR DRAINAGEWAY	700
16	RURAL MAJOR DRAINAGEWAY	700
17	RURAL MAJOR DRAINAGEWAY	700
18	RURAL MAJOR DRAINAGEWAY	700
19	RURAL MAJOR DRAINAGEWAY	700
20	RURAL MAJOR DRAINAGEWAY	700
21	RURAL MAJOR DRAINAGEWAY	700
22	RURAL MAJOR DRAINAGEWAY	700
23	RURAL MAJOR DRAINAGEWAY	700
24	RURAL MAJOR DRAINAGEWAY	700
25	RURAL MAJOR DRAINAGEWAY	700
26	RURAL MAJOR DRAINAGEWAY	700
27	RURAL MAJOR DRAINAGEWAY	700
28	RURAL MAJOR DRAINAGEWAY	700
29	RURAL MAJOR DRAINAGEWAY	700

NOTE: Design flow shown for the drainage facilities as proposed in the Black Squirrel Creek Drainage Basin Master Plan. The design flow shown for the drainage facilities is based on the design flow shown in the Black Squirrel Creek Drainage Basin Master Plan. The design flow shown for the drainage facilities is based on the design flow shown in the Black Squirrel Creek Drainage Basin Master Plan.


BLACK SQUIRREL CREEK DRAINAGE BASIN DEVELOPED CONDITIONS MAJOR FACILITIES

FIGURE 4
URS
 CONSULTANTS
 MAKING TECHNOLOGY WORK™
 COLORADO SPRINGS, COLORADO

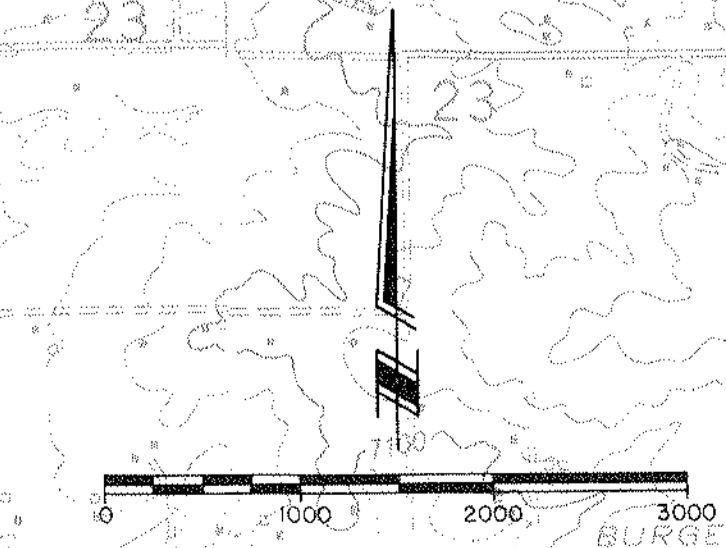

LEGEND

- MAJOR ROADWAYS
- BLACK SQUIREL BASIN BOUNDARY
- CITY LIMITS
- NORTHGATE BOUNDARY
- FOREST AREA
- DETENTION PONDS (MAJOR SYSTEM)
- 100 ACRE LIMIT
- DESIGN POINT
- INLET
- EXISTING INITIAL SYSTEM
- 24" RCP
- 30" RCP
- 36" RCP
- 42" RCP
- 48" RCP
- RURAL INITIAL SYSTEM
- RURAL INITIAL SYSTEM DESIGNATION (SEE TABLE 9)

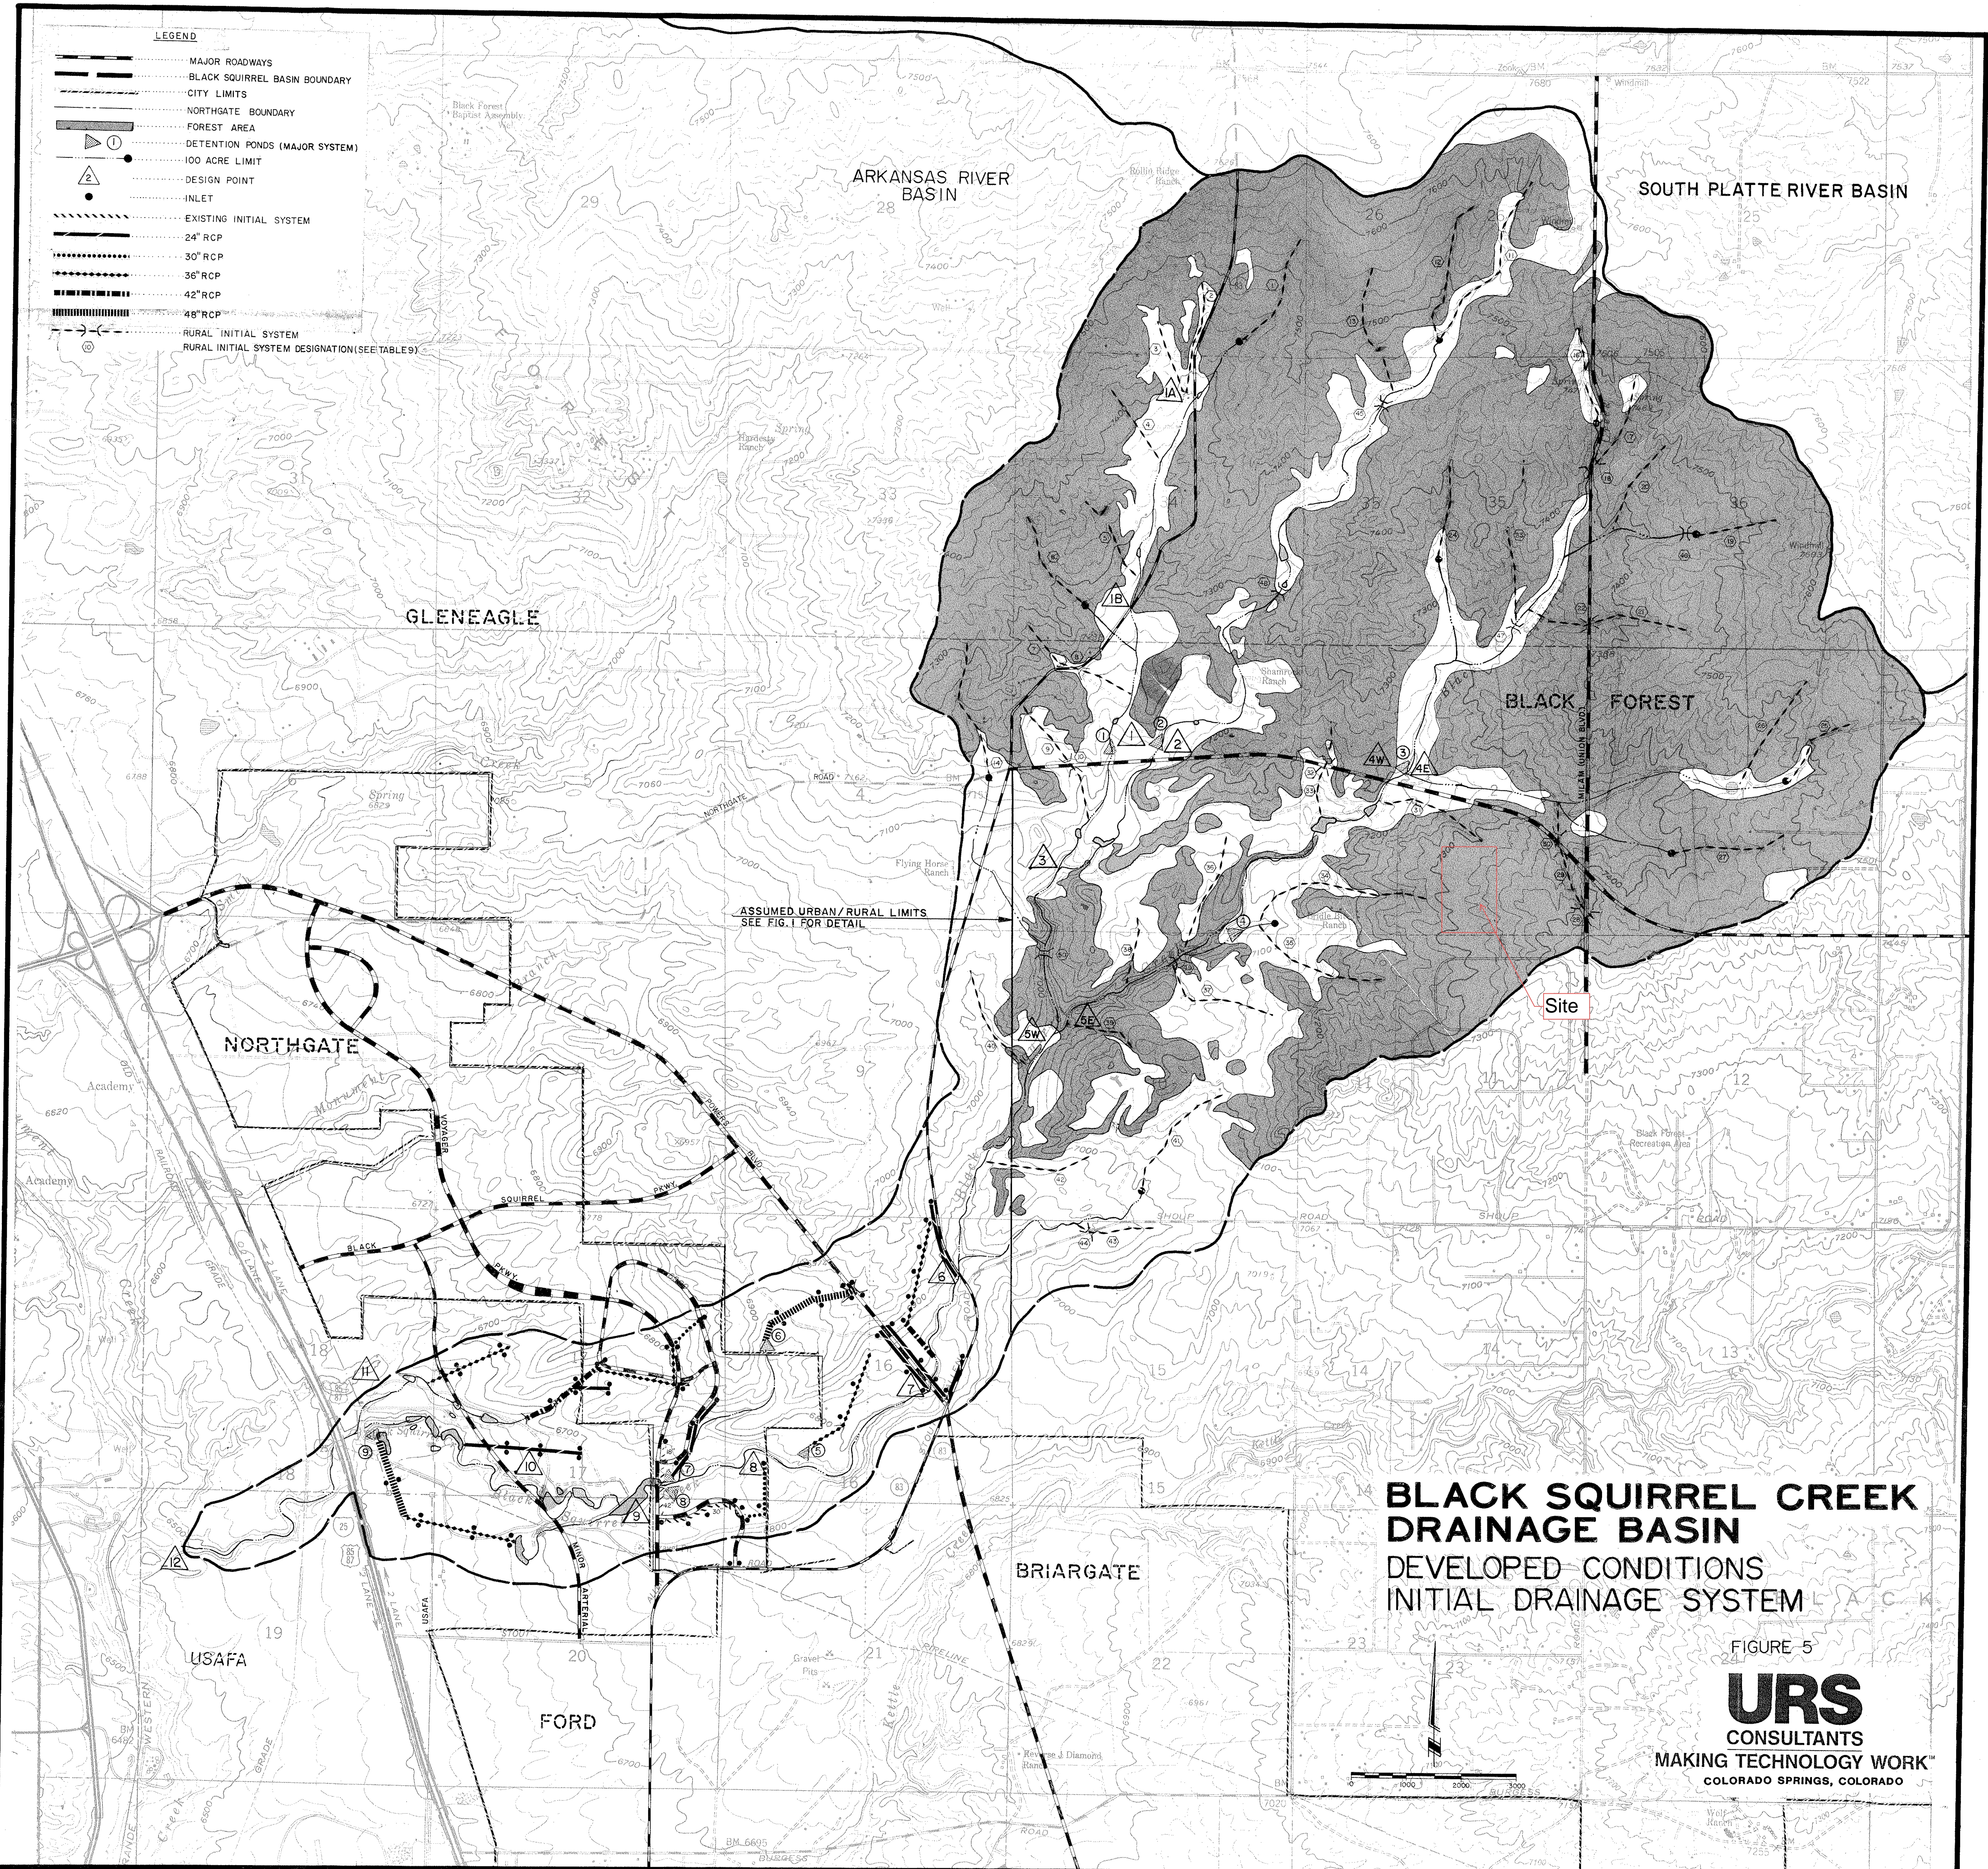


**BLACK SQUIREL CREEK
DRAINAGE BASIN
DEVELOPED CONDITIONS
INITIAL DRAINAGE SYSTEM**

FIGURE 5

URS

CONSULTANTS
MAKING TECHNOLOGY WORK™
COLORADO SPRINGS, COLORADO

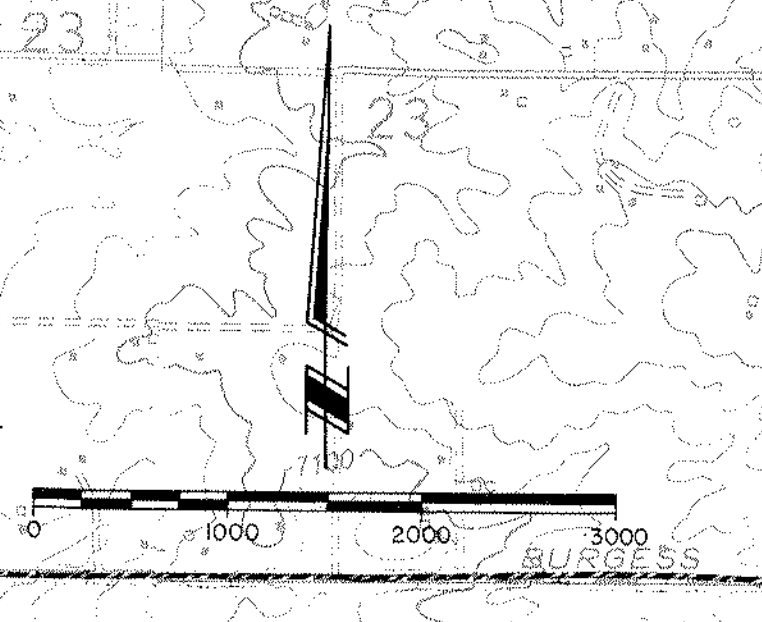

**FINAL
DRAINAGE REPORT AND PLAN
FOR
CATHEDRAL PINES SUBDIVISION FILING NO. 1**

January, 2005

***Leigh
& Whitehead
Associates, Inc.***

CONSULTING CIVIL ENGINEERS & SURVEYORS
2906 BEACON STREET
COLORADO SPRINGS, CO 80907-6192
LWA Project No. 04040.62

TABLE 1

BASIN ID		AREA		Q5 cfs		Q100 cfs	
Exist.	Prop.	Exist.	Prop.	Exist.	Prop.	Exist.	Prop.
DP-1	DP-1	0.22 sm.	0.36 sm.	40.0	57.0	175.0	189.0
DP-2	DP-2	1.02 sm.	0.87 sm.	68.0	141.0	335.0	465.0
DP-3	DP-3	1.24 sm.	1.43 sm.	76.0	218.0	385.0	733.0
D	D	8.61 Ac.	5.06 Ac.	1.8	5.0	4.9	12.3
E	E	20.20 Ac.	15.50 Ac.	4.2	13.4	11.3	32.8
F	F	2.79 Ac.	2.79 Ac.	0.9	0.9	2.5	2.5

TABLE 1

sm = Square Miles Ac. = Acres

Culverts have been sized in accordance with the requirements of the Bureau of Public Roads, nomographs, and the City of Colorado Springs/El Paso County Drainage Criteria Manual. The computer program "Culvert Master for Windows", Culvert Design and Analysis Software, Version 1.0, developed by Haestad Methods, was used in the computations for sizing of culverts. This software program is in accordance with the Bureau of Public Road's standards for developing culvert sizes. The culverts have been sized as R.C.P., using a Manning's roughness coefficient of 0.013. The culvert design data computations are in the back of this report. The rip-rap at the outlet of the culverts, have been designed in accordance with CDOT Std. M-601-12, and a copy of this standard is located in the back of this report. These rip-rap pads are shown on the detailed street plan and profiles and the calculations are in the back of this report. These rip-rap pads have been sized in accordance with the appropriate requirements.

There are plans to construct 2-detention facilities. One is located at design point 3 (DP-3) in basin B, and the other one is located at Winslow Drive in basin E. These detention facilities release runoff at or below historic rates.

The detention pond at DP-3 has been sized to accept runoff from Filing No. 1, which contributes 381.67 acres. This does include basins B21 and D. The remaining 413.6 undeveloped acres from the adjacent portion will sheet flow westerly to Black Squirrel Creek, and will not be intercepted by this detention facility. Developed peak flow at DP-3 for the 381.67 acres is 142.0 cfs for the 5 year event, and 444.0 cfs for the 100 year event.

Historic flows at this location are 44.0 cfs for the 5 year event and 219.0 cfs for the 100 year event. This detention facility will release flows of 41.8 cfs for the 5 year event and 192.6 cfs for the 100 year event. These flows are below historic runoff. This detention pond will detain 5.84 acre feet (100.2 cfs) for the 5 year event and 17.26 acre (251.4 cfs) for the 100 year event. When the remaining portion of this basin is developed, detailed evaluation will be required to determine the best solution to reduce developed runoff from exiting the property.

The detention pond at Basin E has been sized to accept runoff from 15.50 acres, which generates a peak developed flow of 13.4 cfs for the 5 year event and 32.8 cfs for the 100 year event. Historic flows at this location are 4.2 cfs for the 5 year event and 11.3 cfs for the 100 year event. This detention facility will release runoff of 3.7 cfs for the 5 year event and 10.9 cfs for the 100 year event. These flows are below historic runoff. This detention pond will detain 0.25 acre feet (9.7 cfs) for the 5 year event and 0.56 acre feet (21.9 cfs) for the 100 year event.

Detention facilities were analyzed using Haestad methods "Pond Pack-Detention Pond Design and Analysis" computer program for both the 5 year and 100 year events. Pond volumes were determined by conic method. The detention ponds are private drainage facilities and will be maintained by the homeowners association. Calculations for the two detention ponds are included in the back of this report. These ponds will have adequate maintenance access.

The proposed detention facilities include outlet structures that will control both the minor and major storms. They are dual-stage outlet facilities. The calculations for the emergency spillway are shown on the construction documents. Any seeding that is developed in the detention pond areas will be in accordance with the NRCS specifications that are shown on sheet 2 of the construction documents.

Located throughout the property are small stock or ranch ponds that are currently in existence. These ponds will be removed and regraded, and will not be part of the storm drainage system. All runoff calculations for this development did not take into account these stock ponds. Grades for the proposed roads may cause high storm water flow velocities and create the need for roadside ditch protection. The roadside ditches generate

RUNOFF COMPUTATIONS
RATIONAL METHOD

04040_62.xls

CATHEDRAL PINES SUBDIVISION FILING NO. 1
HOLMES ROAD, Sec.'s 1 & 2, T12S, R66W
EL PASO COUNTY, COLORADO

LEIGH WHITEHEAD & ASSOCIATES, INC.
Engineers, Surveyors & Planners
2906 BEACON STREET
COLORADO SPRINGS, COLORADO
(719) 636-5179

TABLE A:
PROPOSED CONDITIONS

LWA # 04040.62

16-Nov-04

SHEET 4 OF 4

BASIN	AREA	SOIL TYPE	C 5 C 100	GEOMETRY		Tt 5 Tt 100	V Tt	tc 5 tc 100	i 5 i 100	Q5	Q100	COMMENTS
				LENGTH	HEIGHT							
				SLOPE								
B29	7.60	B	0.30	300	42.0	10.85	3.95	14.31	3.45	7.9	19.2	
		26/40	0.40	14.00		9.49	3.46	12.95	6.32			
B30	8.85	B	0.30	300	48.0	10.38	3.37	14.29	3.45	9.2	22.3	
		26	0.40	16.00		9.08	3.91	12.99	6.31			
B31	15.46	B	0.30	300	38.0	11.21	3.60	18.38	3.05	14.1	34.3	
		26/40	0.40	12.67		9.81	7.17	16.98	5.54			
B32	37.25	B	0.30	300	12.0	16.40	4.01	29.68	2.33	26.1	63.3	
		26/40/71	0.40	4.00		14.35	13.28	27.63	4.25			
B32 (cum.)	69.16	B	0.30	300	42.0	10.85	Varies	26.87	2.47	51.3	123.1	B29 through B32
		26/40/71	0.40	14.00		9.49	16.02	25.51	4.45			
DP-3	916.42	B	0.29	300	15.0	15.43	Varies	66.25	1.39	370.2	887.2	Rational; OS-B1 -- B32
		26/40/41/71	0.39	5.00		13.52	50.82	64.34	2.48			
DP-3	1.4319	B	CN							218	733	HEC-1; OS-B1 -- B32 (Ultimate Condition)
		26/40/41/71	64.51									
DP-3	381.67	B	0.29	300	15.0	15.43	Varies	46.05	1.78	196.6	474.7	Rational Analysis
		26/40/41/71	0.39	5.00		13.52	30.62	44.14	3.19			
DP-3	0.5964	B	CN							142	444	HEC-1; OS-B1 -- B32 (For Detention Purposes)
		26/40/41/71	64.51									
D	5.06	B	0.30	300	23.0	13.23	3.81	15.77	3.29	5.0	12.3	
		41	0.40	7.67		11.58	2.54	14.12	6.07			
E	15.50	B	0.30	300	17.0	14.62	3.54	20.37	2.89	13.4	32.8	
		41	0.40	5.67		12.79	5.75	18.54	5.30			
F	2.79	B	0.10	350	40.0	15.66	/	15.66	3.30	0.9	2.5	Undisturbed
		41	0.15	11.43		14.88	/	14.88	5.92			
Milam Cir.	1.22	B	0.40	200	9.0	11.27	/	11.27	3.85	1.9	4.4	
		41	0.50	4.50		9.66	/	9.66	7.18			

Culvert Designer/Analyzer Report Winslow Drive - 2

Peak Discharge Method: User-Specified																					
Design Discharge	4.7 cfs	Check Discharge	11.7 cfs																		
Grades Model: Inverts																					
Invert Upstream	7,365.00 ft	Invert Downstream	7,364.00 ft																		
Length	70.00 ft	Slope	0.014286 ft/ft																		
Drop	1.00 ft																				
Headwater Model: Maximum Allowable HW																					
Headwater Elevation	7,368.00 ft																				
Tailwater properties: Triangular Channel																					
Slope	0.020000 ft/ft	Mannings Coefficient	0.035																		
Depth	0.78 ft	Left Side Slope	6 H : V																		
Right Side Slope	6 H : V																				
Tailwater conditions for Design Storm.																					
Discharge	4.7 cfs	Bottom Elevation	7,364.00 ft																		
Depth	0.56 ft	Velocity	2.53 ft/s																		
Tailwater conditions for Check Storm.																					
Discharge	11.7 cfs	Bottom Elevation	7,364.00 ft																		
Depth	0.78 ft	Velocity	3.18 ft/s																		
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th style="width: 10%;"></th> <th style="width: 20%;">Name</th> <th style="width: 20%;">Desc</th> <th style="width: 15%;">Discharge</th> <th style="width: 15%;">HW Elev</th> <th style="width: 10%;">Velocity</th> </tr> </thead> <tbody> <tr> <td></td> <td>Trial-1</td> <td>1-18 inch Circular</td> <td style="text-align: center;">4.7 cfs</td> <td style="text-align: center;">7,366.34 ft</td> <td style="text-align: center;">6.59 ft/s</td> </tr> <tr> <td>x</td> <td>Trial-2</td> <td>1-18 inch Circular</td> <td style="text-align: center;">11.7 cfs</td> <td style="text-align: center;">7,367.74 ft</td> <td style="text-align: center;">8.06 ft/s</td> </tr> </tbody> </table>					Name	Desc	Discharge	HW Elev	Velocity		Trial-1	1-18 inch Circular	4.7 cfs	7,366.34 ft	6.59 ft/s	x	Trial-2	1-18 inch Circular	11.7 cfs	7,367.74 ft	8.06 ft/s
	Name	Desc	Discharge	HW Elev	Velocity																
	Trial-1	1-18 inch Circular	4.7 cfs	7,366.34 ft	6.59 ft/s																
x	Trial-2	1-18 inch Circular	11.7 cfs	7,367.74 ft	8.06 ft/s																

Culvert Designer/Analyzer Report Winslow Drive - 2

Design: Trial-1

Solve For: Headwater Elevation

Culvert Summary			
Allowable HW Elevation	7,368.00 ft	Storm Event	Design
Computed Headwater Elevation	7,366.34 ft	Discharge	4.7 cfs
Headwater Depth/ Height	0.89	Tailwater Elevation	7,364.56 ft
Inlet Control HW Elev	7,366.23 ft	Control Type	Outlet Control
Outlet Control HW Elev	7,366.34 ft		
Grades			
Upstream Invert	7,365.00 ft	Downstream Invert	7,364.00 ft
Length	70.00 ft	Constructed Slope	0.014286 ft/ft
Hydraulic Profile			
Profile	S2	Depth, Downstream	0.64 ft
Slope Type	Steep	Normal Depth	0.64 ft
Flow Regime	Supercritical	Critical Depth	0.83 ft
Velocity Downstream	6.59 ft/s	Critical Slope	0.005655 ft/ft
Section			
Section Shape	Circular	Mannings Coefficient	0.013
Section Material	Concrete	Span	1.50 ft
Section Size	18 inch	Rise	1.50 ft
Number Sections	1		
Outlet Control Properties			
Outlet Control HW Elev	7,366.34 ft	Upstream Velocity Head	0.34 ft
Ke	0.50	Entrance Loss	0.17 ft
Inlet Control Properties			
Inlet Control HW Elev	7,366.23 ft	Flow Control	Unsubmerged
Inlet Type	End-Section Conforming to fill slope	Area Full	1.8 ft ²
K	0.00980	HDS 5 Chart	1
M	2.00000	HDS 5 Scale	1
C	0.03980	Equation Form	1
Y	0.67000		

Culvert Designer/Analyzer Report Winslow Drive - 2

Design: Trial-2

Solve For: Headwater Elevation

Culvert Summary			
Allowable HW Elevation	7,368.00 ft	Storm Event	Check
Computed Headwater Elevation	7,367.74 ft	Discharge	11.7 cfs
Headwater Depth/ Height	1.83	Tailwater Elevation	7,364.78 ft
Inlet Control HW Elev	7,367.74 ft	Control Type	Inlet Control
Outlet Control HW Elev	7,367.50 ft		


Grades			
Upstream Invert	7,365.00 ft	Downstream Invert	7,364.00 ft
Length	70.00 ft	Constructed Slope	0.014286 ft/ft

Hydraulic Profile			
Profile	S2	Depth, Downstream	1.15 ft
Slope Type	Steep	Normal Depth	1.15 ft
Flow Regime	Supercritical	Critical Depth	1.30 ft
Velocity Downstream	8.06 ft/s	Critical Slope	0.011352 ft/ft

Section			
Section Shape	Circular	Mannings Coefficient	0.013
Section Material	Concrete	Span	1.50 ft
Section Size	18 inch	Rise	1.50 ft
Number Sections	1		

Outlet Control Properties			
Outlet Control HW Elev	7,367.50 ft	Upstream Velocity Head	0.80 ft
Ke	0.50	Entrance Loss	0.40 ft

Inlet Control Properties			
Inlet Control HW Elev	7,367.74 ft	Flow Control	Submerged
Inlet Type	End-Section Conforming to fill slope	Area Full	1.8 ft ²
K	0.00980	HDS 5 Chart	1
M	2.00000	HDS 5 Scale	1
C	0.03980	Equation Form	1
Y	0.67000		

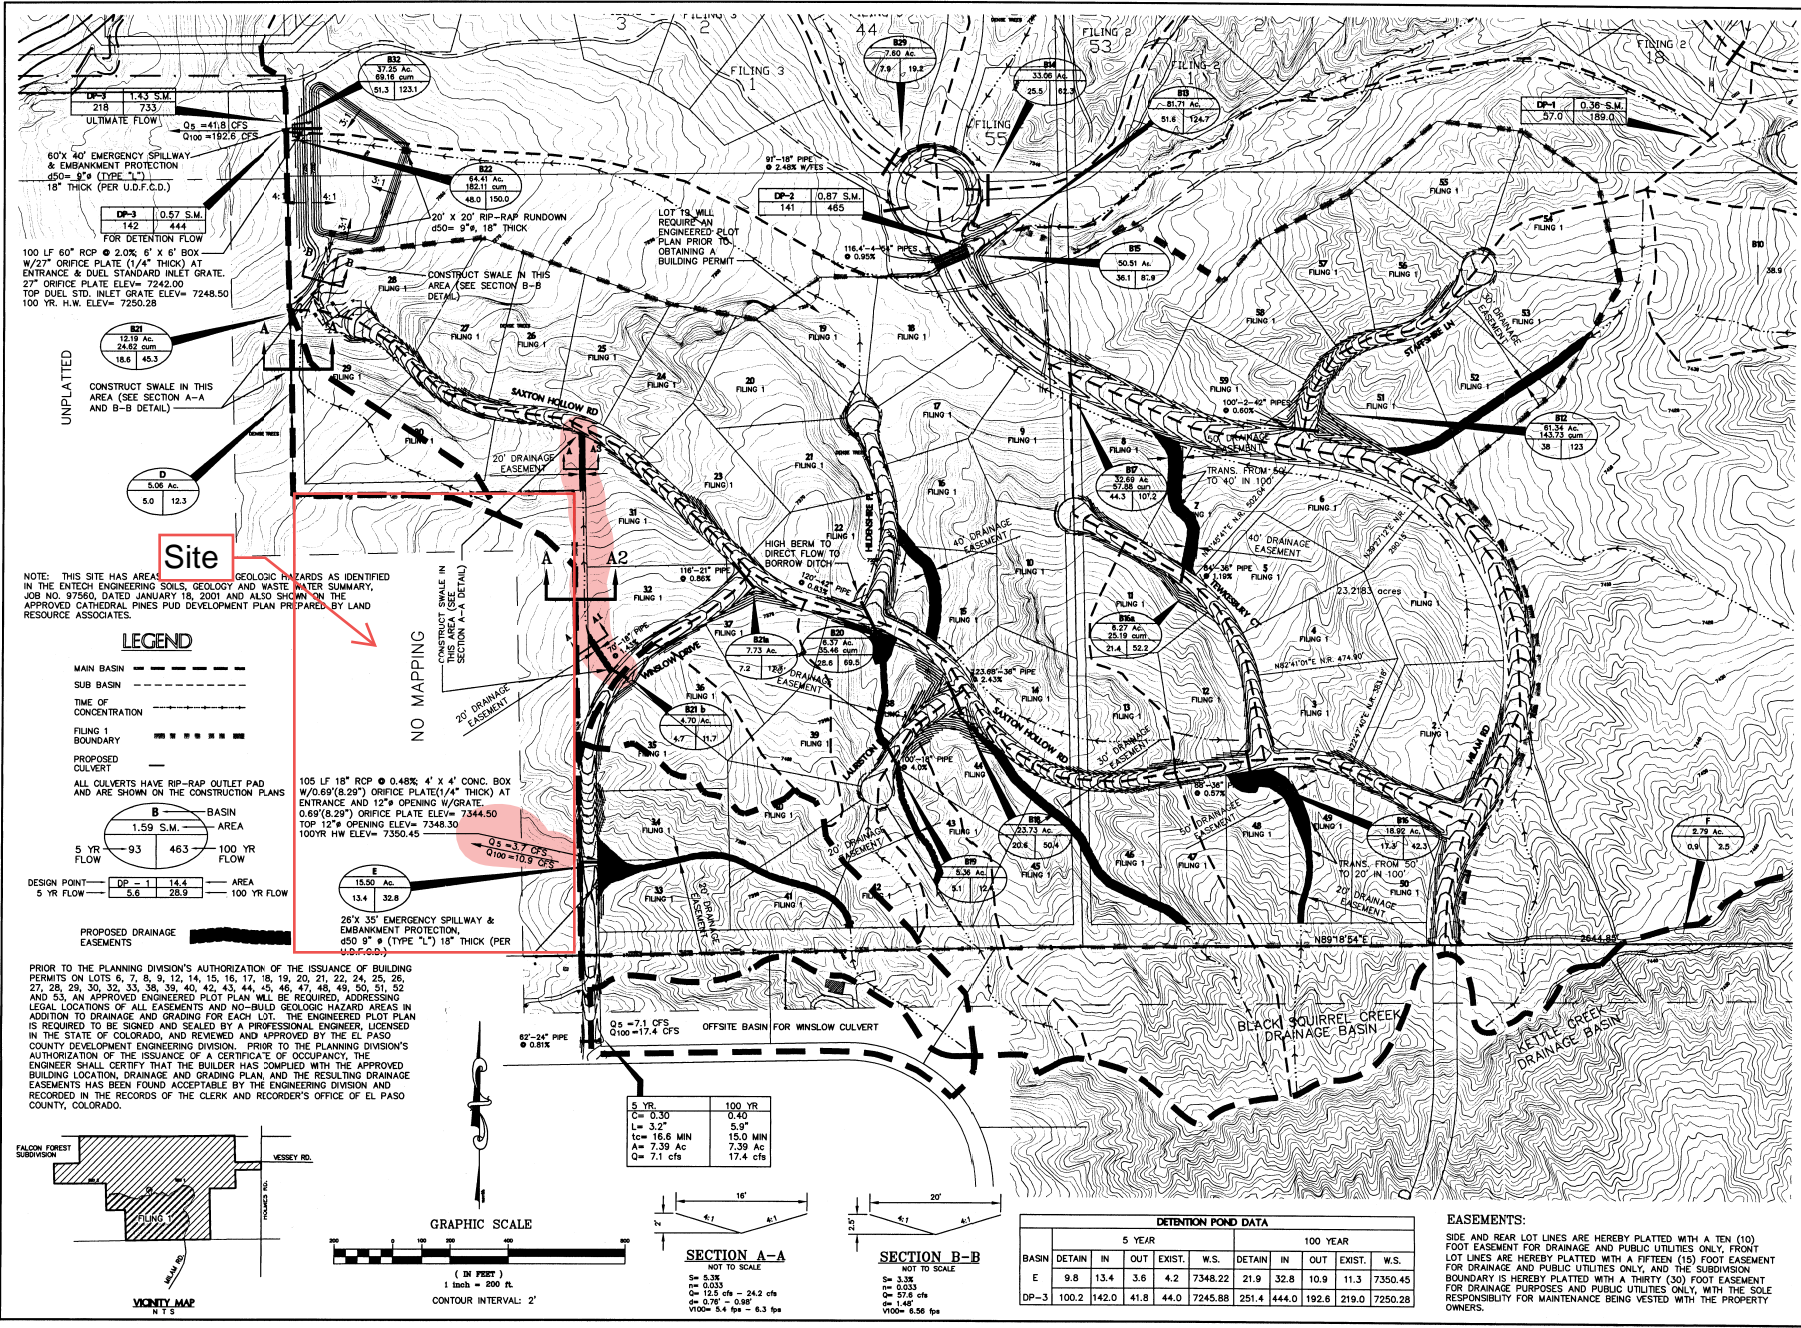

NOTE: THIS SITE HAS AREA GEOLOGIC HAZARDS AS IDENTIFIED IN THE DITCH ENGINEERING SOILS, GEOLOGY AND WASTE WATER SUMMARY, JOB NO. 97560, DATED JANUARY 18, 2001 AND ALSO SHOWN ON THE APPROVED CATHEDRAL PINES PUD DEVELOPMENT PLAN PREPARED BY LAND RESOURCE ASSOCIATES.

LEGEND



- MAIN BASIN
- SUB BASIN
- TIME OF CONCENTRATION
- FILING 1 BOUNDARY
- PROPOSED CULVERT
- ALL CULVERTS HAVE RIP-RAP OUTLET PAD AND ARE SHOWN ON THE CONSTRUCTION PLANS
- DESIGN POINT
- PROPOSED DRAINAGE EASEMENTS

105 LF 18" RCP @ 0.48% 4' X 4' CONIC BOX W/0.69"(8.29") ORIFICE PLATE(1/4" THICK) AT ENTRANCE AND 12" OPENING W/GRATE. 0.69"(8.29") ORIFICE PLATE ELEV= 7344.50 TOP 12" OPENING ELEV= 7348.50 100YR HW ELEV= 7350.45

0.6 @ 1.7 CFS
Q100=10.9 CFS

26' X 35' EMERGENCY SPILLWAY & EMBANKMENT PROTECTION, 450 9" (TYPE "L") 18" THICK (PER 9060904)

PRIOR TO THE PLANNING DIVISION'S AUTHORIZATION OF THE ISSUANCE OF BUILDING PERMITS ON LOTS 6, 7, 8, 9, 12, 14, 15, 16, 17, 18, 19, 20, 21, 22, 24, 25, 26, 27, 28, 29, 30, 32, 33, 36, 39, 40, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 AND 53, AN APPROVED ENGINEERED PLOT PLAN WILL BE REQUIRED, ADDRESSING LEGAL LOCATIONS OF ALL EASEMENTS AND NO-BUILD GEOLOGIC HAZARD AREAS IN ADDITION TO DRAINAGE AND GRADING FOR EACH LOT. THE ENGINEERED PLOT PLAN IS REQUIRED TO BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER, LICENSED IN THE STATE OF COLORADO, AND REVIEWED AND APPROVED BY THE EL PASO COUNTY DEVELOPMENT ENGINEERING DIVISION. PRIOR TO THE PLANNING DIVISION'S AUTHORIZATION OF THE ISSUANCE OF A CERTIFICATE OF OCCUPANCY, THE ENGINEER SHALL CERTIFY THAT THE BUILDER HAS COMPLIED WITH THE APPROVED BUILDING LOCATION, DRAINAGE AND GRADING PLAN, AND THE RESULTING DRAINAGE EASEMENTS HAS BEEN FOUND ACCEPTABLE BY THE ENGINEERING DIVISION AND RECORDED IN THE RECORDS OF THE CLERK AND RECORDER'S OFFICE OF EL PASO COUNTY, COLORADO.



SECTION A-A
NOT TO SCALE

5 YR	100 YR
C ₁₀₀ 0.30	0.40
L= 3.2'	5.9'
t _c = 16.6 MIN	15.0 MIN
A= 7.39 AC	7.39 AC
Q= 7.1 cfs	17.4 cfs

SECTION B-B
NOT TO SCALE

5 YR	100 YR
C ₁₀₀ 0.33	0.45
L= 3.2'	5.9'
t _c = 12.0 MIN	24.2 cfs
A= 1.45	0.98
Q= 1.45	6.3 cfs

DETENTION POND DATA

BASIN	5 YEAR			100 YEAR		
	DETAIN	IN	OUT	EXIST.	W.S.	W.S.
E	9.8	13.4	3.6	4.2	7348.22	21.9 32.8 10.9 11.3 7350.45
DP-3	100.2	142.0	41.8	44.0	7245.88	251.4 444.0 192.6 219.0 7250.28

EASEMENTS:
SIDE AND REAR LOT LINES ARE HEREBY PLATTED WITH A TEN (10) FOOT EASEMENT FOR DRAINAGE AND PUBLIC UTILITIES ONLY. FRONT LOT LINES ARE HEREBY PLATTED WITH A FIFTEEN (15) FOOT EASEMENT FOR DRAINAGE AND PUBLIC UTILITIES ONLY, AND THE SUBDIVISION BOUNDARY IS HEREBY PLATTED WITH A THIRTY (30) FOOT EASEMENT FOR DRAINAGE PURPOSES AND PUBLIC UTILITIES ONLY, WITH THE SOLE RESPONSIBILITY FOR MAINTENANCE BEING VESTED WITH THE PROPERTY OWNERS.

ENGINEERS
SURVEYORS
LEIGH WHITEHEAD & ASSOCIATES
2720 EAST VAMPA STREET, SUITE 1
COLORADO SPRINGS, CO 80909
PHONE: (719) 584-4111 FAX: (719) 584-4110

COPYRIGHT LEIGH WHITEHEAD & ASSOCIATES, INC.
DESIGN AND DRAWINGS NOT TO BE REUSED WITHOUT WRITTEN PERMISSION OF ENGINEER

SHEET TITLE:
FINAL DRAINAGE PLAN
PROPOSED CONDITIONS
PROJECT NAME:
CATHEDRAL PINES SUBDIVISION
FILING NO. 1

BENCHMARK:
TOP OF 5/8" DIA. REBAR
28" NORTH AND 20" EAST
OF THE SOUTHWEST COR.
OF SECTION 1
ELEV= 7436.65 - NAVD '88



REVISIONS:

SCALE: 1" = 200'
DATE: 1/18/05
DRAWN BY: CLH
CHECKED BY: LAB

SHEET NO:
2 OF 2

PROJECT NO: 04040
DRAWING NAME: Final Drainage
VIEW: PROPOSED

CATHEDRAL PINES SUBDIVISION
FILING NO. 1
EL PASO COUNTY, COLORADO

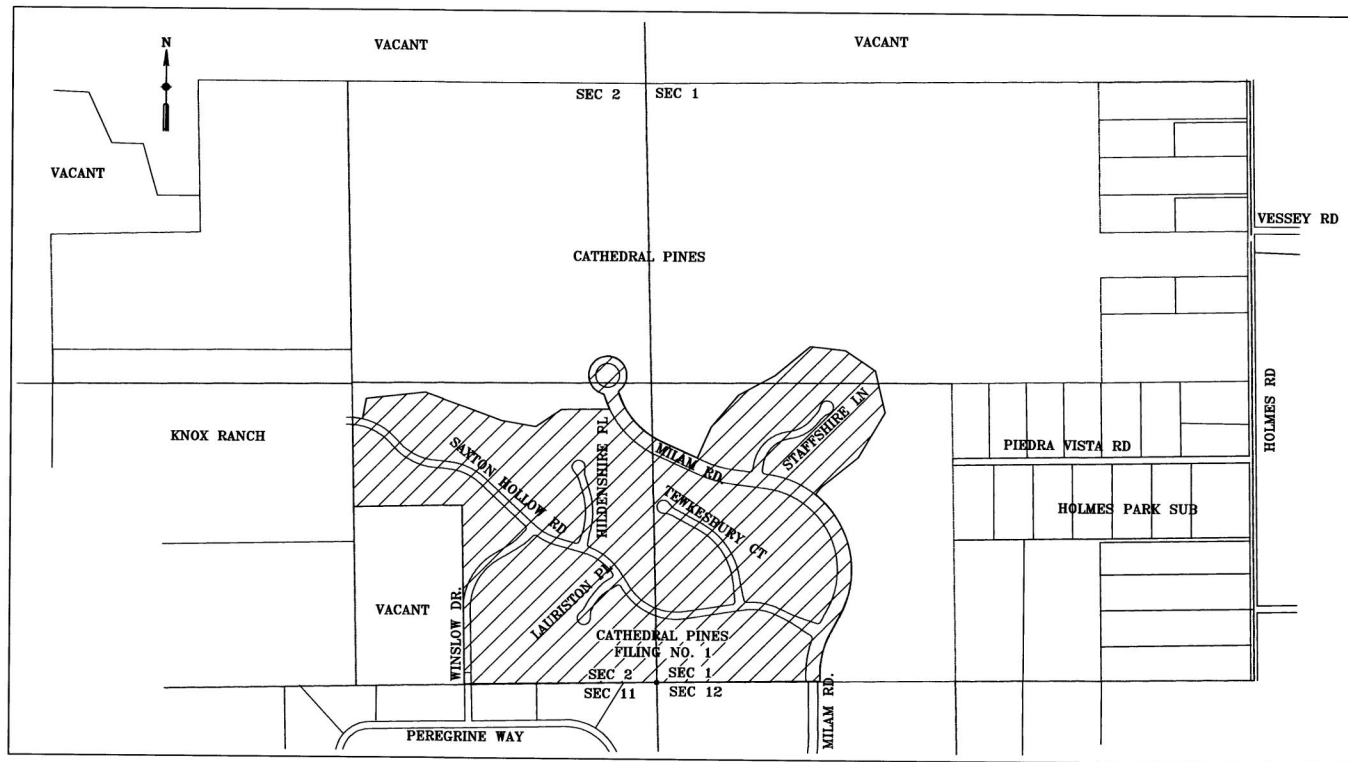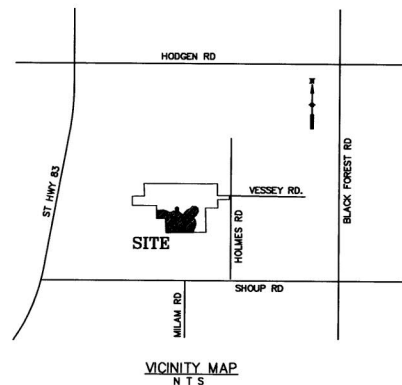

SITE MAP
1" = 800'

INDEX OF SHEETS

1. COVER SHEET
2. TYPICAL NOTES & DETAILS
3. DRAINAGE NOTES & DETAILS
4. SAXTON HOLLOW ROAD-PLAN & PROFILE - STA: 1+00.00 TO 14+50.00
5. SAXTON HOLLOW ROAD-PLAN & PROFILE - STA: 14+50.00 TO 28+00.00
6. SAXTON HOLLOW ROAD-PLAN & PROFILE - STA: 28+00.00 TO 44+00.00
7. SAXTON HOLLOW ROAD-PLAN & PROFILE - STA: 44+00.00 TO 47+31.44
8. WINSLOW DRIVE-PLAN & PROFILE - STA: 1+00.00 TO 10+50.00
9. WINSLOW DRIVE-PLAN & PROFILE - STA: 10+50.00 TO 20+32.84
10. HILDENSHIRE PLACE-PLAN & PROFILE - STA: 1+00.00 TO 8+85.78
11. LAURISTON PLACE-PLAN & PROFILE - STA: 1+00.00 TO 6+45.18
12. TEWKESBURY COURT-PLAN & PROFILE - STA: 1+00.00 TO 13+22.24
13. MILAM ROAD-PLAN & PROFILE - STA: 10+00.00 TO 23+50.00
14. MILAM ROAD-PLAN & PROFILE - STA: 23+50.00 TO 37+50.00
15. MILAM ROAD-PLAN & PROFILE - STA: 37+50.00 TO 46+88.43
16. MILAM CIRCLE-PLAN & PROFILE - STA: 1+00.00 TO 9+16.79
17. STAFFSHIRE LANE-PLAN & PROFILE - STA: 1+00.00 TO 11+01.49
18. EROSION CONTROL PLAN - SHEET 1
19. EROSION CONTROL PLAN - SHEET 2
20. EROSION CONTROL PLAN - SHEET 3
21. EROSION CONTROL PLAN - SHEET 4
22. EROSION CONTROL PLAN - SHEET 5
23. EROSION CONTROL PLAN - SHEET 6
24. EROSION CONTROL PLAN - SHEET 7
25. EROSION CONTROL PLAN - SHEET 8
26. EROSION CONTROL PLAN - SHEET 9
27. STREET SIGNING PLAN - SHEET 1
28. STREET SIGNING PLAN - SHEET 2

DEVELOPER'S STATEMENT:

I, THE DEVELOPER, HAVE READ AND WILL COMPLY WITH ALL THE REQUIREMENTS IN THIS CONSTRUCTION AND EROSION CONTROL PLAN.

BY _____ DATE _____

ENGINEER STATEMENT:

THESE DETAILED PLANS AND SPECIFICATIONS WERE PREPARED UNDER MY DIRECTION AND SUPERVISION. SAID DETAILED PLANS AND SPECIFICATIONS HAVE BEEN PREPARED ACCORDING TO THE CRITERIA ESTABLISHED BY THE CITY/COUNTY FOR DETAILED DRAINAGE PLANS AND SPECIFICATIONS, AND SAID DETAILED PLANS AND SPECIFICATIONS ARE IN CONFORMITY WITH THE MASTER PLAN OF THE DRAINAGE BASIN. SAID DETAILED DRAINAGE PLANS AND SPECIFICATIONS MEET THE PURPOSES FOR WHICH THE PARTICULAR DRAINAGE FACILITY(S) IS DESIGNED. I ACCEPT RESPONSIBILITY FOR ANY LIABILITY CAUSED BY NEGLIGENT ACTS, ERRORS OR OMISSIONS ON MY PART IN THE PREPARATION OF THESE DETAILED DRAINAGE PLANS AND SPECIFICATIONS.

F.E. COLORADO# _____

PREPARED UNDER MY DIRECT SUPERVISION FOR AND ON BEHALF OF LEIGH WHITEHEAD & ASSOCIATES, INC.

COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH COUNTY DESIGN CRITERIA. THE COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSIONS AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED AT THE JOB SITE. THE COUNTY, THROUGH THE APPROVAL OF THIS DOCUMENT, ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT.

JOHN A. McCARTY, P.E. _____ DATE _____
DIRECTOR/COUNTY ENGINEER

LEGEND:

- DAYLIGHT LINE
- RIGHT OF WAY LINE
- PROPERTY BOUNDARY
- LOT LINES
- PROPOSED UTILITY & GRADING EASEMENT
- PROPOSED DRAINAGE EASEMENT
- EXISTING CONTOURS
- PROPOSED CONTOURS
- C350 REINFORCED MAT NORTH AMERICAN GREEN
- SC150 REINFORCED MAT NORTH AMERICAN GREEN
- SILT FENCE
- RETAINING WALL
- NEW PAVEMENT

54 LOT NUMBERS

GOVERNING AGENCIES

EL PASO COUNTY DEPARTMENT OF TRANSPORTATION
3480 N. MARKSHEFFEL ROAD
COLORADO SPRINGS, CO 80922
PHONE: (719) 520-6460

MOUNTAIN VIEW ELECTRIC ASSOCIATION
11140 E. WOODMEN ROAD
FALCON, CO 80831
PHONE: (719) 495-2283

TRI-LAKES FIRE PROTECTION DISTRICT
18370 ROLLER COASTER ROAD
MONUMENT, CO 80132
PHONE: (719) 481-9644

BASIS OF BEARINGS

THE BASIS OF BEARINGS FOR THIS PLAT IS THE SOUTH LINE OF THE SOUTHWEST QUARTER OF SECTION 1, S89°18'49"E - 2644.82 FEET. THIS IS A GRID BEARING OF THE COLORADO STATE PLANE COORDINATE SYSTEM, CENTRAL ZONE, NORTH AMERICAN DATUM 1983.

TABLE 1: SIGHT DISTANCE

STREET NAME	CLASSIFICATION	DESIGN SPEED	POSTED SPEED	ENTERING SIGHT DISTANCE	MINIMUM STOPPING SIGHT DISTANCE
SAXTON HOLLOW ROAD	RESIDENTIAL	30 MPH	30 MPH	390	200
WINSLOW DRIVE	RESIDENTIAL	30 MPH	30 MPH	390	200
LAURISTON PLACE	RESIDENTIAL	30 MPH	30 MPH	325	200
TEWKESBURY COURT	RESIDENTIAL	30 MPH	30 MPH	325	200
MILAM ROAD	COLLECTOR	40 MPH	35 MPH	546	275
STAFFSHIRE LANE	RESIDENTIAL	30 MPH	30 MPH	325	200

UPON SATISFACTORY INSPECTION, BUT BEFORE ACCEPTANCE BY THE COUNTY, A BOND SHALL BE POSTED TO INSURE THE SATISFACTORY PERFORMANCE OF GEOTEXTILE FABRICS INSTALLED IN THE ROADSIDE DITCHES CALLED OUT HEREIN. THIS BOND SHALL REMAIN POSTED FOR THREE YEARS.


These as-builds are effective per field survey data collected 10-08-08.

stillwater engineering
 CONSULTING ENGINEERS AND SURVEYORS
 225 S. ARADO AVENUE
 DENVER, COLORADO 80202
 719-534-1941, 543-1944, FAX

AS-BUILT DRAWINGS
 CATHEDRAL PINES FILING NO. 1
 EL PASO COUNTY, COLORADO



BENCHMARK
 TOP OF 5/8" DIA.
 REBAR 28' NORTH
 AND 20' EAST OF
 THE SOUTHWEST
 COR. OF SEC. 1
 ELEV=7436.66
 NAVD '88

DATE: 13 August 2008
 DRAWN BY: CLH/AGM
 CHECKED BY: DAP
 JOB NO.: 2007-27
 SHEET NO. 1 OF 28

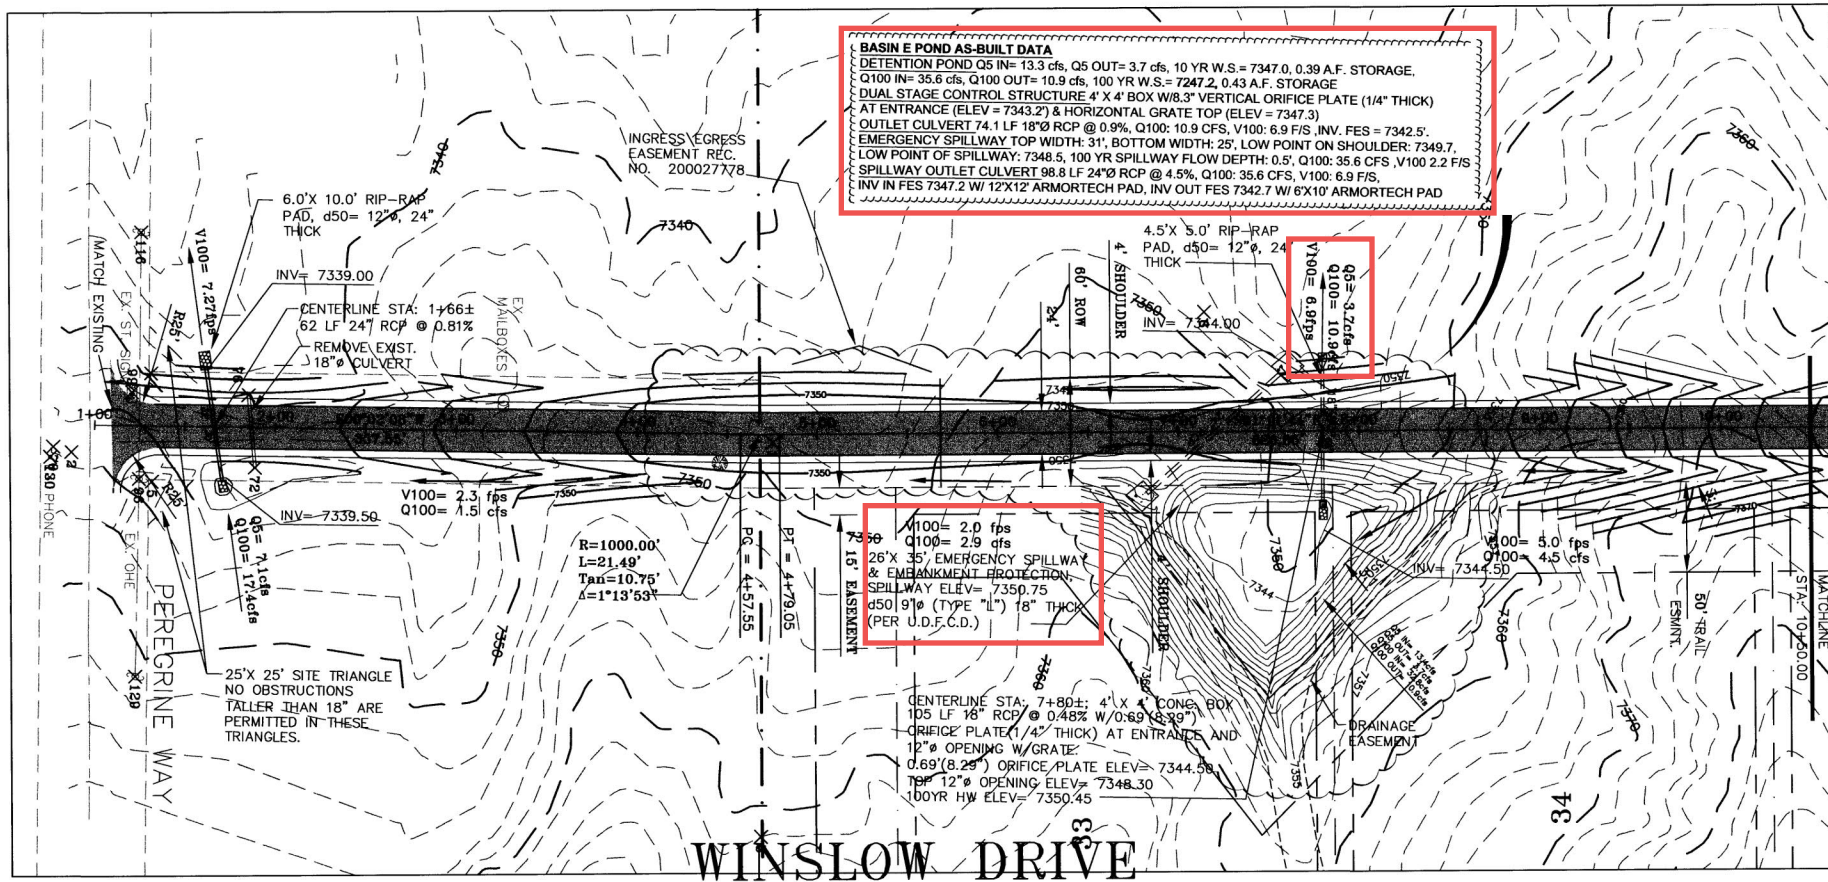

Basin E Pond AS-Built Data
 DETENTION POND Q5 IN= 13.3 cfs, Q5 OUT= 3.7 cfs, 10 YR W.S. = 7347.0, 0.39 A.F. STORAGE.
 Q100 IN= 35.6 cfs, Q100 OUT= 10.9 cfs, 100 YR W.S. = 7247.2, 0.43 A.F. STORAGE
 DUAL STAGE CONTROL STRUCTURE 4' X 4' BOX W/8.3\"/>

V100 = 2.0 fps
 Q100 = 2.9 cfs
 26' X 35' EMERGENCY SPILLWAY
 & EMBANKMENT PROTECTION
 SPILLWAY ELEV = 7350.75
 d50 9\"/>

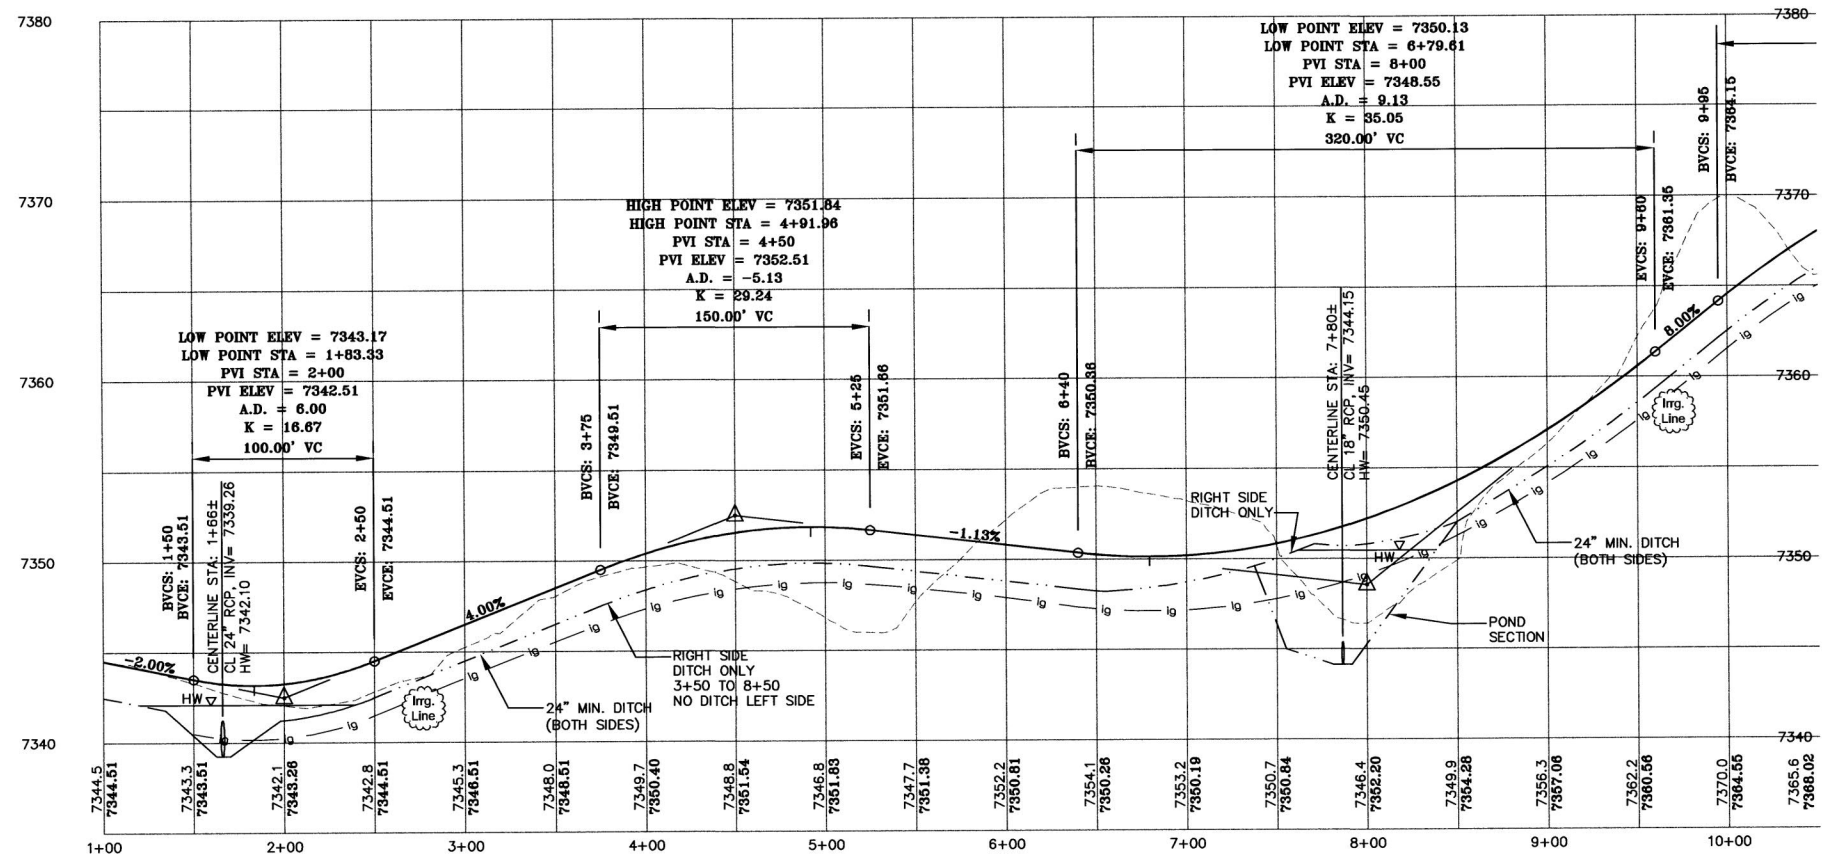

These as-builts are effective per field survey data collected 10-08-08.

stillwater engineering
 CONSULTING ENGINEERS
 AND SURVEYORS
 225 S. COLORADO AVE.
 PUEBLO, CO 81004
 719-684-1941 719-684-1944 FAX

Professional Engineer Seal for David J. Foster, No. 15159, State of Colorado.

AS-BUILT STATEMENT: I have made periodic site visits to the site during the construction process and verified that the improvements were installed according to the approved set of construction documents. Design revisions I have verified that the improvements have been constructed according to the applicable standards and specifications required by the El Paso County. In my professional judgment, the relative elevations and drainage patterns as built are in substantial conformance with the approved design report. All permanent erosion and storm drainage design features shown on the design plan of the approved drainage report. All permanent erosion and storm drainage features shown on the approved construction documents for this site are installed.

WINSLOW DRIVE
 STA 1+00 TO 10+50
 CATHEDRAL PINES FILING NO. 1
 EL PASO COUNTY, COLORADO


BENCHMARK
 TOP OF 5/8\"/>

AS-BUILT
 DRAWINGS

DATE: 13 August 2008
 DRAWN BY: CLH/AGM
 CHECKED BY: DAP
 JOB NO.: 2007-27
 SHEET NO. 8 OF 28

APPENDIX E
DRAINAGE MAPS

ESTATES AT CATHEDRAL PINES EXISTING DRAINAGE MAP

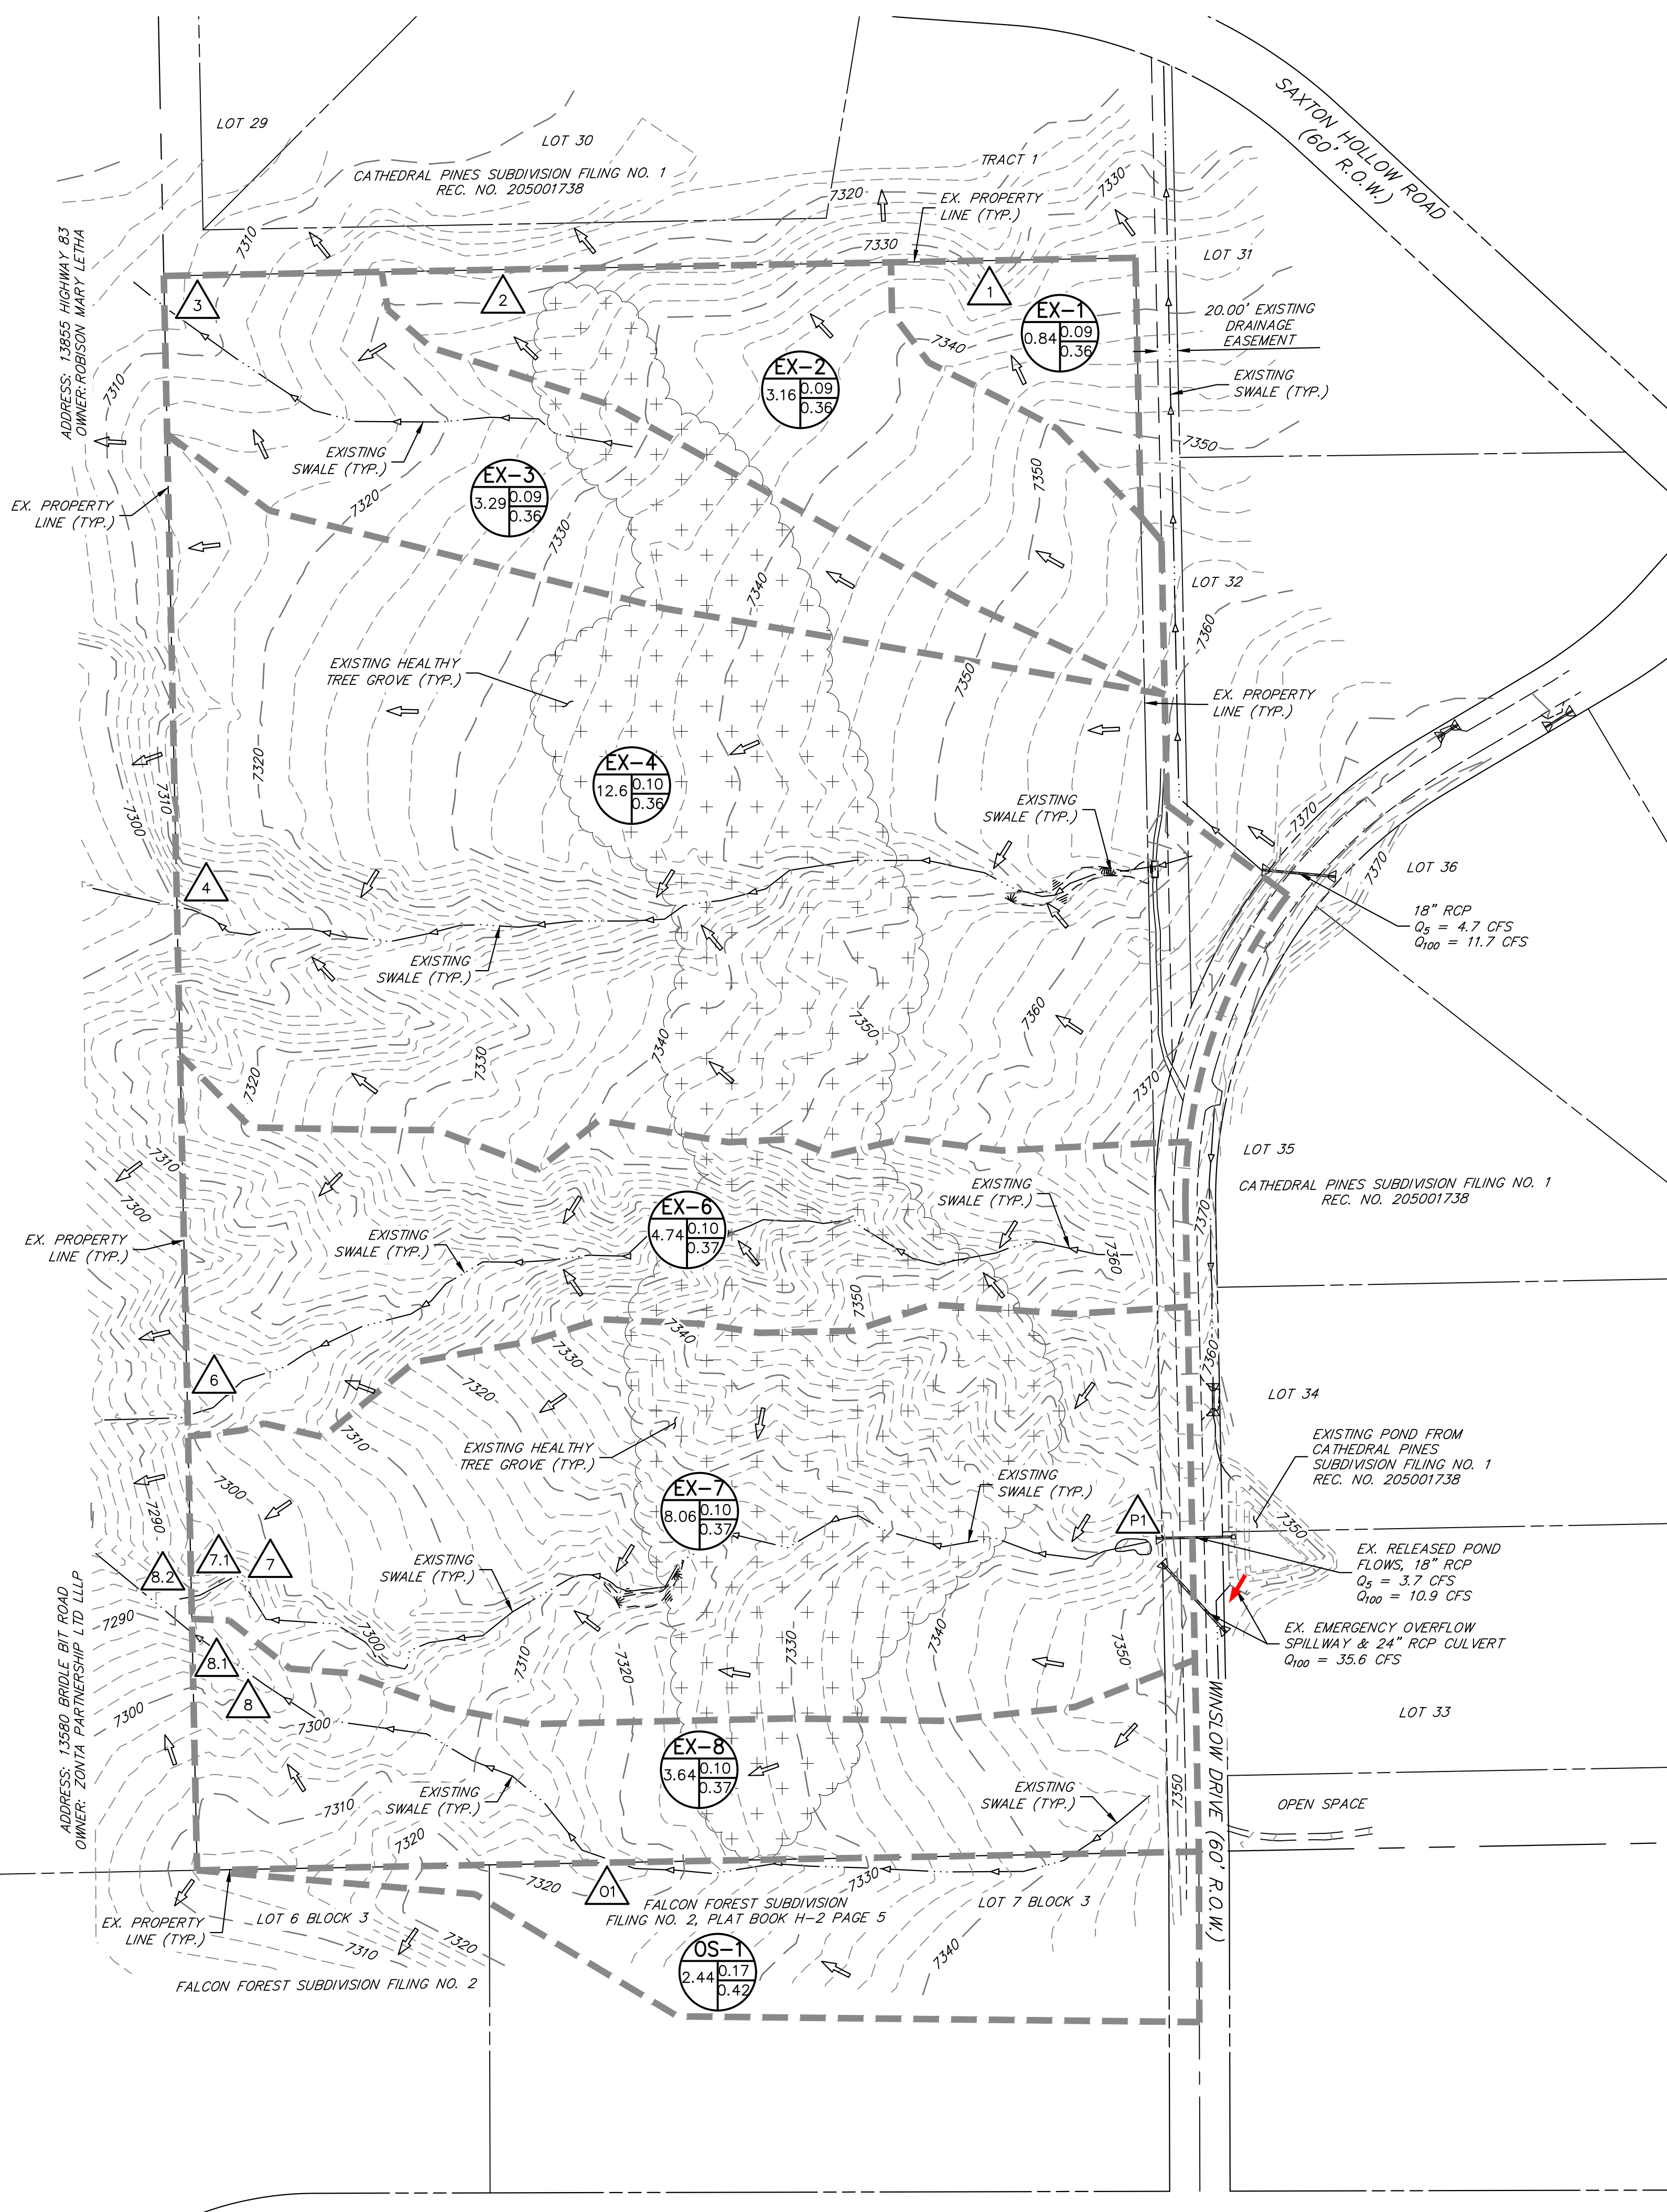

LAYER LINETYPE LEGEND

EXISTING							
SECTION LINE	---						
BOUNDARY LINE	---						
PROPERTY LINE	---						
EASEMENT LINE	---						
RIGHT OF WAY	---						
CENTERLINE	---						
ELECTRIC	-E- -E-						
FIBER OPTIC	-FO- -FO-						
GAS MAIN	-G- -G-						
IRRIGATION MAIN	-IRR- -IRR-						
OVERHEAD UTILITY	-OHU- -OHU-						
SANITARY SEWER	-S- -S-						
STORM SEWER	====						
TELEPHONE	-T- -T-						
WATER MAIN	-W- -W-						
SWALE/WATERWAY FLOWLINE	~ ~ ~						
INDEX CONTOUR	---6100---						
INTERMEDIATE CONTOUR	---6100---						
DEPRESSION CONT. (INDEX)	---6100---						
DEPRESSION CONT. (INTER)	---6100---						
CURB & GUTTER	====						
WALL	====						
BASIN ID	<table border="1"> <tr><td>ID</td><td>AC</td><td>CS</td></tr> <tr><td></td><td>C100</td><td></td></tr> </table>	ID	AC	CS		C100	
ID	AC	CS					
	C100						
DESIGN POINT DESIGNATION	△						
FLOW DIRECTION (EXISTING)	→						
SUB-BASIN DRAINAGE AREA	▬▬▬▬▬						


DESIGN POINT SUMMARY TABLE

DP#	Q _s	Q ₁₀₀
1	0.3	1.8
2	0.8	5.6
3	0.8	5.0
4	4.0	25.2
6	1.5	9.5
P1	3.7	10.9
7	2.3	14.0
7.1	6.0	24.9
O1	1.7	6.7
8	1.1	6.5
8.1	2.3	11.5
8.2	8.2	36.1

Values in blue indicate that they are from "Cathedral Pines Subdivision Filing No. 1 Drainage Report & Plan".

BASIN SUMMARY TABLE

Tributary	Area	Percent	C _s	C ₁₀₀	t _c	Q _s	Q ₁₀₀
Sub-basin	(acres)	Impervious			(min)	(cfs)	(cfs)
EX-1	0.84	2%	0.09	0.36	15.1	0.3	1.8
EX-2	3.16	2%	0.09	0.36	22.0	0.8	5.6
EX-3	3.29	2%	0.09	0.36	28.8	0.8	5.0
EX-4	12.60	3%	0.10	0.36	17.7	4.0	25.2
EX-6	4.74	3%	0.10	0.37	17.6	1.5	9.5
EX-7	8.06	3%	0.10	0.37	23.9	2.3	14.0
EX-8	3.64	3%	0.10	0.37	23.0	1.1	6.5
OS-1	2.44	12%	0.17	0.42	11.8	1.7	6.7

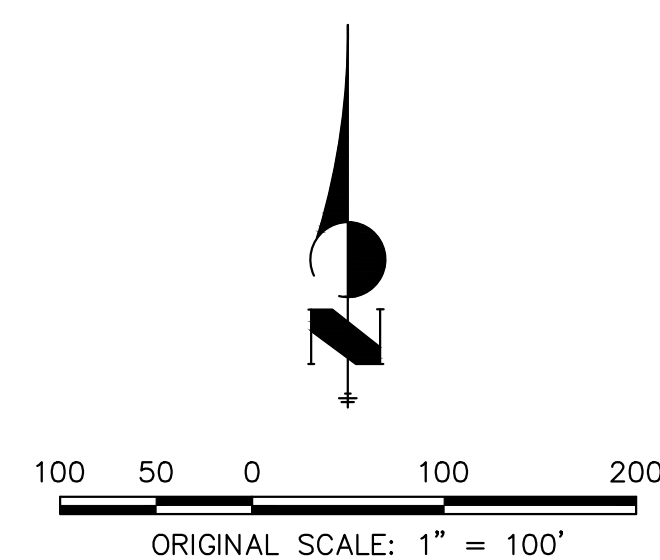


EXISTING DRAINAGE MAP
ESTATES AT CATHEDRAL PINES
JOB NO. 25260.00
03/25/2024
SHEET 1 OF 1

J-R ENGINEERING
A Westrian Company

Centennial 303-740-9393 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com

ESTATES AT CATHEDRAL PINES PROPOSED DRAINAGE MAP

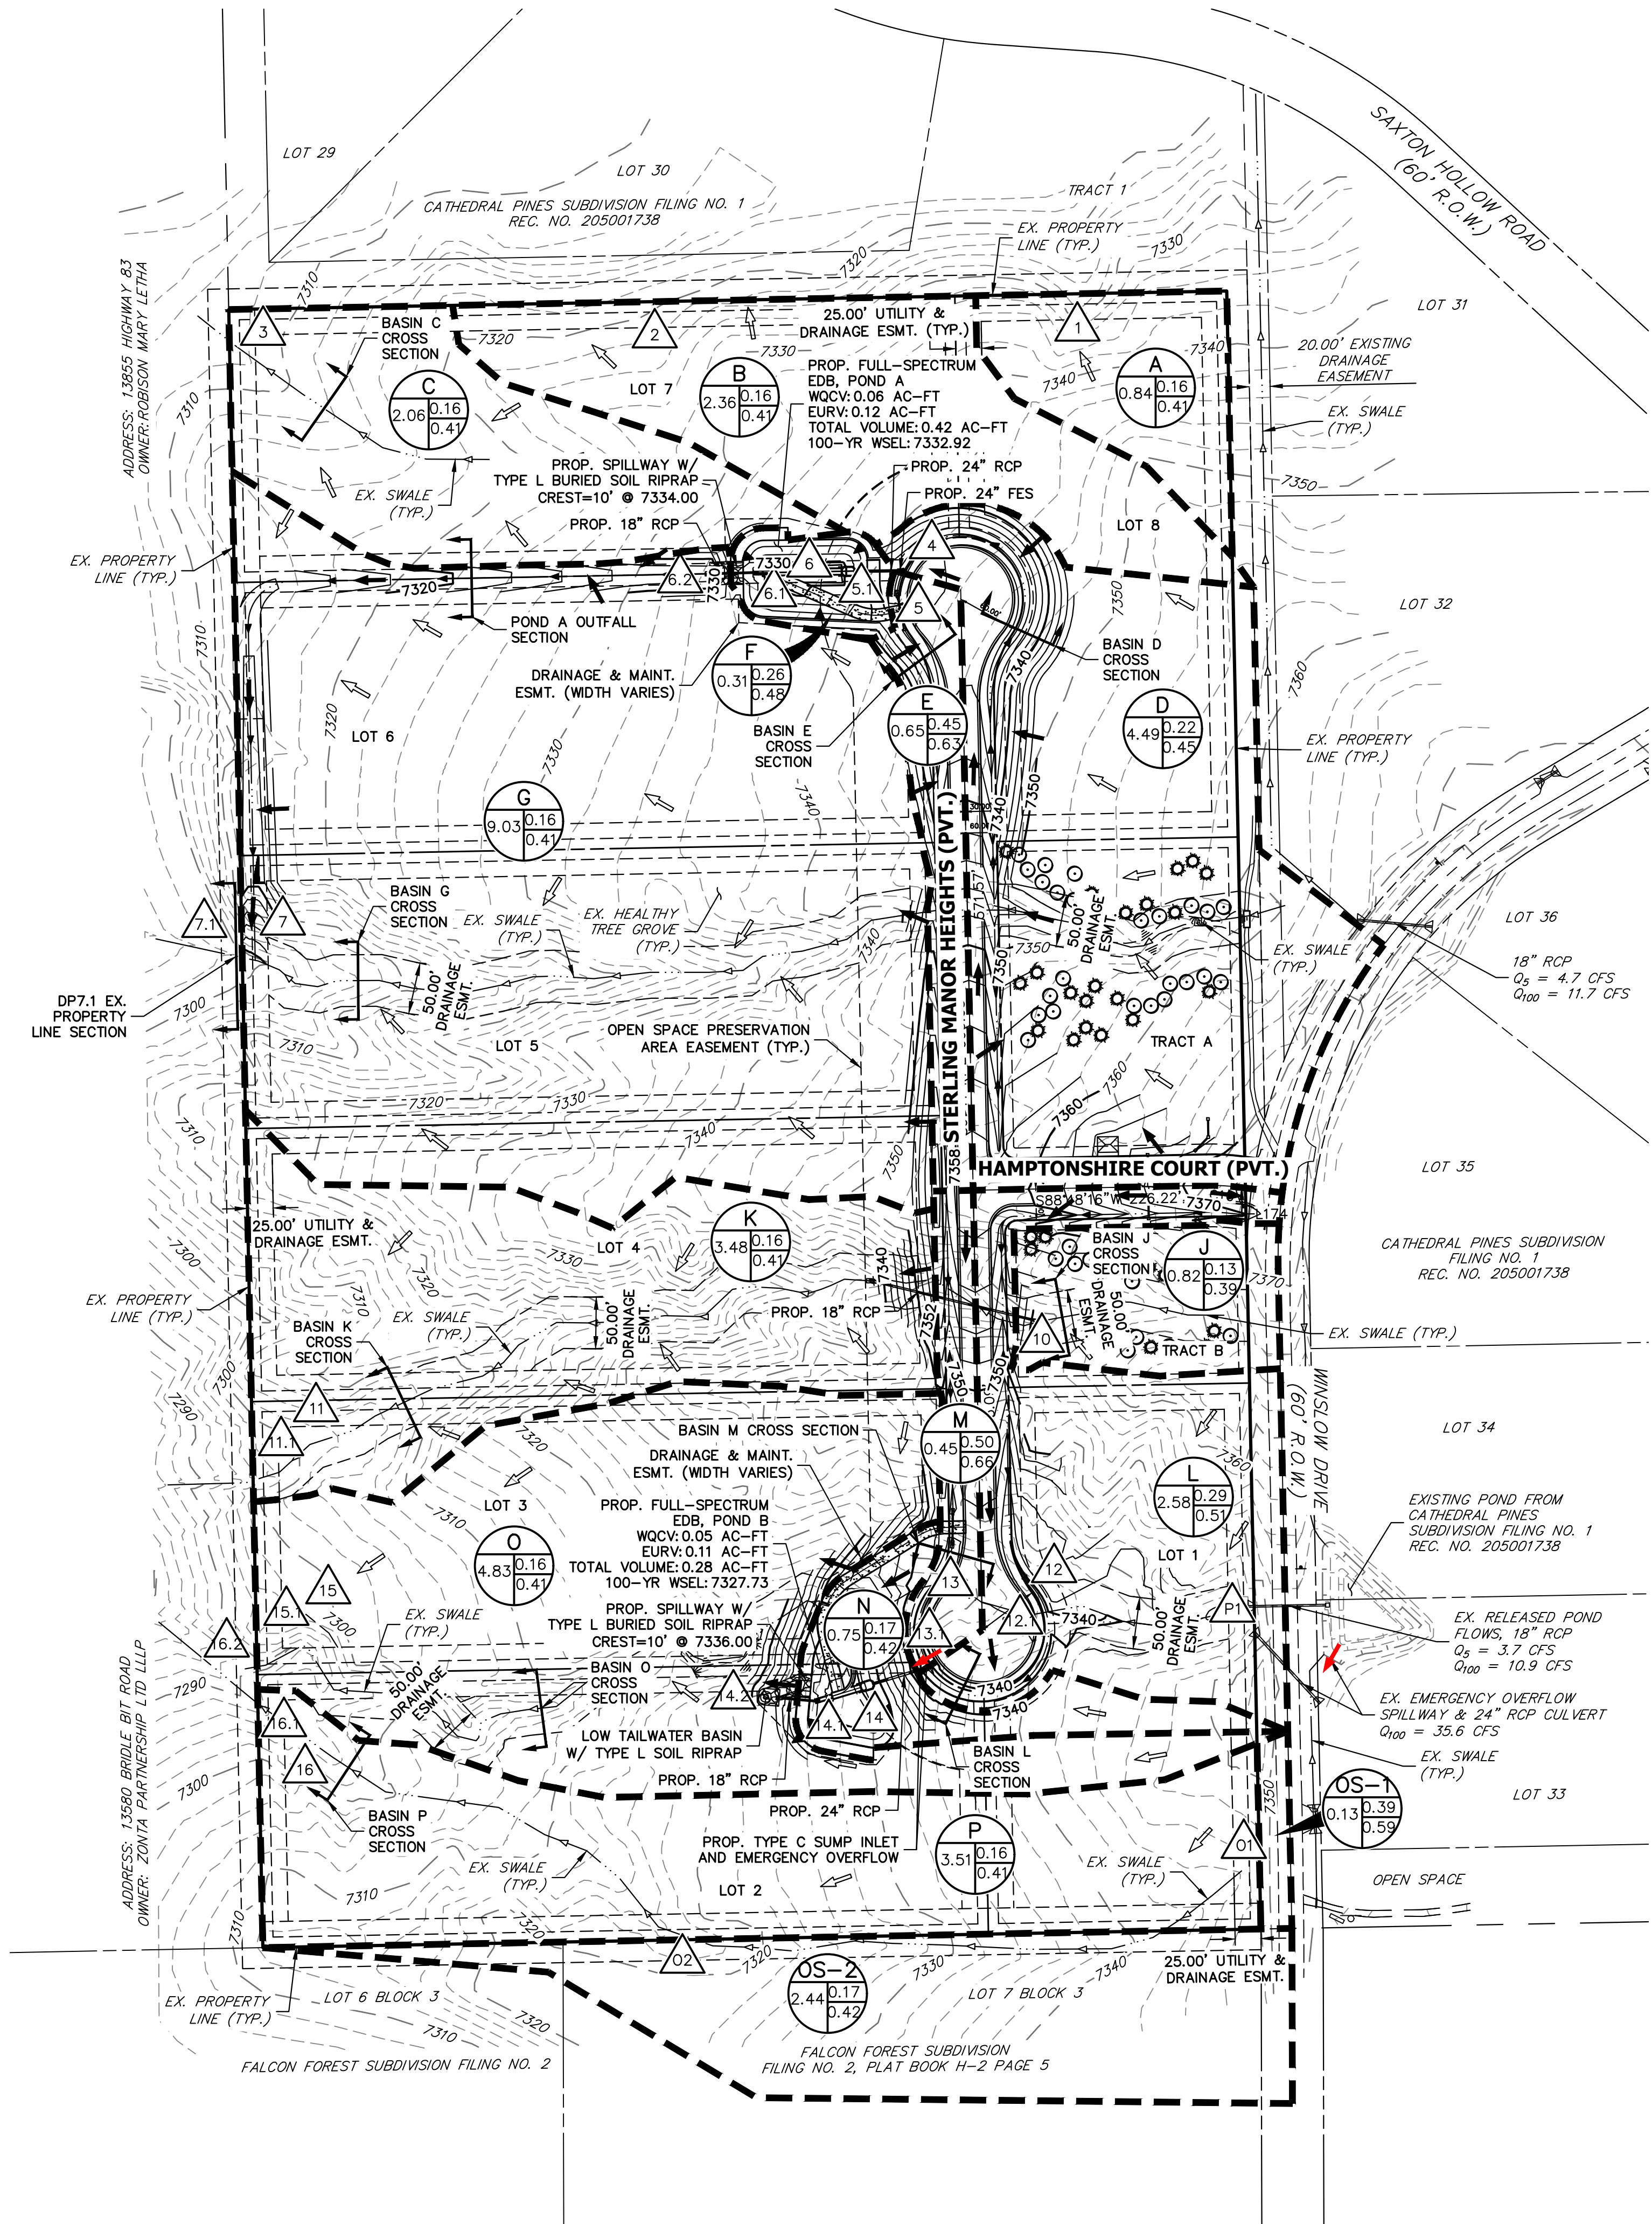

LAYER LINETYPE LEGEND

	EXISTING	PROPOSED
SECTION LINE	---	---
BOUNDARY LINE	---	---
PROPERTY LINE	---	---
EASEMENT LINE	---	---
RIGHT OF WAY	---	---
CENTERLINE	---	---
ELECTRIC	-E-E-	E-E
FIBER OPTIC	-FO-FO-	FO-FO
GAS MAIN	-G-G-	G-G
IRRIGATION MAIN	-IRR-IRR-	IRR-IRR
OVERHEAD UTILITY	-OHU-OHU-	OHU-OHU
SANITARY SEWER	-S-S-	S-S
STORM SEWER	---S---	---S---
TELEPHONE	-T-T-	T-T
WATER MAIN	-W-W-	W-W
SWALE/WATERWAY FLOWLINE	~	~
INDEX CONTOUR	---6100---	---6100---
INTERMEDIATE CONTOUR	---	---
DEPRESSION CONT. (INDEX)	---6100---	---6100---
DEPRESSION CONT. (INTER)	---	---
CURB & GUTTER	---	---
WALL	---	---
BASIN ID		
DESIGN POINT DESIGNATION		
FLOW DIRECTION (PROPOSED)	→	→
FLOW DIRECTION (EXISTING)	→	→
SUB-BASIN DRAINAGE AREA	---	---

DESIGN POINT SUMMARY TABLE

DP#	Q _s	Q ₁₀₀
1	0.4	1.8
2	1.1	4.8
3	1.0	4.2
4	2.9	10.3
5	1.1	2.6
5.1	3.8	12.4
6	0.4	1.2
6.1	4.1	13.1
6.2	1.2	5.4
7	4.5	19.4
7.1	5.7	24.8
10	0.4	2.2
11	1.8	7.8
11.1	2.2	9.5
P1	3.7	10.9
12	2.6	7.6
12.1	6.3	18.5
13	0.9	2.1
13.1	7.1	20.2
14	0.6	2.5
14.1	7.6	22.0
14.2	0.6	4.3
15	2.5	10.7
15.1	3.1	15.0
O1	0.3	0.7
O2	1.7	6.7
16	1.6	6.8
16.1	2.9	12.0
16.2	5.6	25.1


Values in blue indicate that they are from "Cathedral Pines Subdivision Filing No. 1 Drainage Report & Plan".

BASIN SUMMARY TABLE

Tributary	Area	Percent	C _s	C ₁₀₀	t _c	Q _s	Q ₁₀₀
Sub-basin	(acres)	Impervious			(min)	(cfs)	(cfs)
A	0.84	10%	0.16	0.41	18.1	0.4	1.8
B	2.36	10%	0.16	0.41	21.8	1.1	4.8
C	2.06	10%	0.16	0.41	21.4	1.0	4.2
D	4.49	17%	0.22	0.45	20.9	2.9	10.3
E	0.65	46%	0.45	0.63	12.1	1.1	2.6
F	0.31	25%	0.26	0.48	6.7	0.4	1.2
G	9.03	10%	0.16	0.41	19.6	4.5	19.4
J	0.82	7%	0.13	0.39	10.4	0.4	2.2
K	3.48	10%	0.16	0.41	18.1	1.8	7.8
L	2.58	26%	0.29	0.51	15.7	2.6	7.6
M	0.45	53%	0.50	0.66	10.1	0.9	2.1
N	0.75	13%	0.17	0.42	6.7	0.6	2.5
O	4.83	10%	0.16	0.41	18.5	2.5	10.7
P	3.51	10%	0.16	0.41	24.1	1.6	6.8
OS-1	0.13	39%	0.39	0.59	5.0	0.3	0.7
OS-2	2.44	12%	0.17	0.42	12.0	1.7	6.7

Lot Culvert Table

Lot #	Culvert Size
1	24" RCP
2	24" RCP
3	12" RCP
4	12" RCP
5	12" RCP
6	12" RCP
7	24" RCP
8	24" RCP

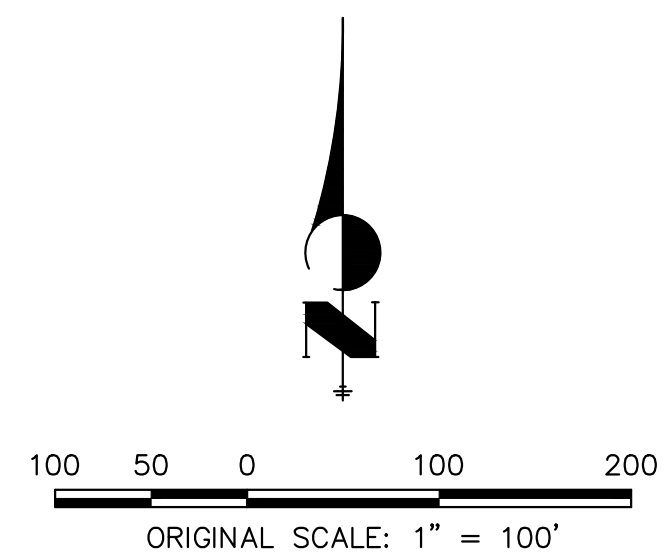


PROPOSED DRAINAGE MAP
ESTATES AT CATHEDRAL PINES
JOB NO. 25260.00
03/27/2024
SHEET 1 OF 1



Centennial 303-740-9393 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com

ESTATES AT CATHEDRAL PINES


PROPOSED WATER QUALITY MAP

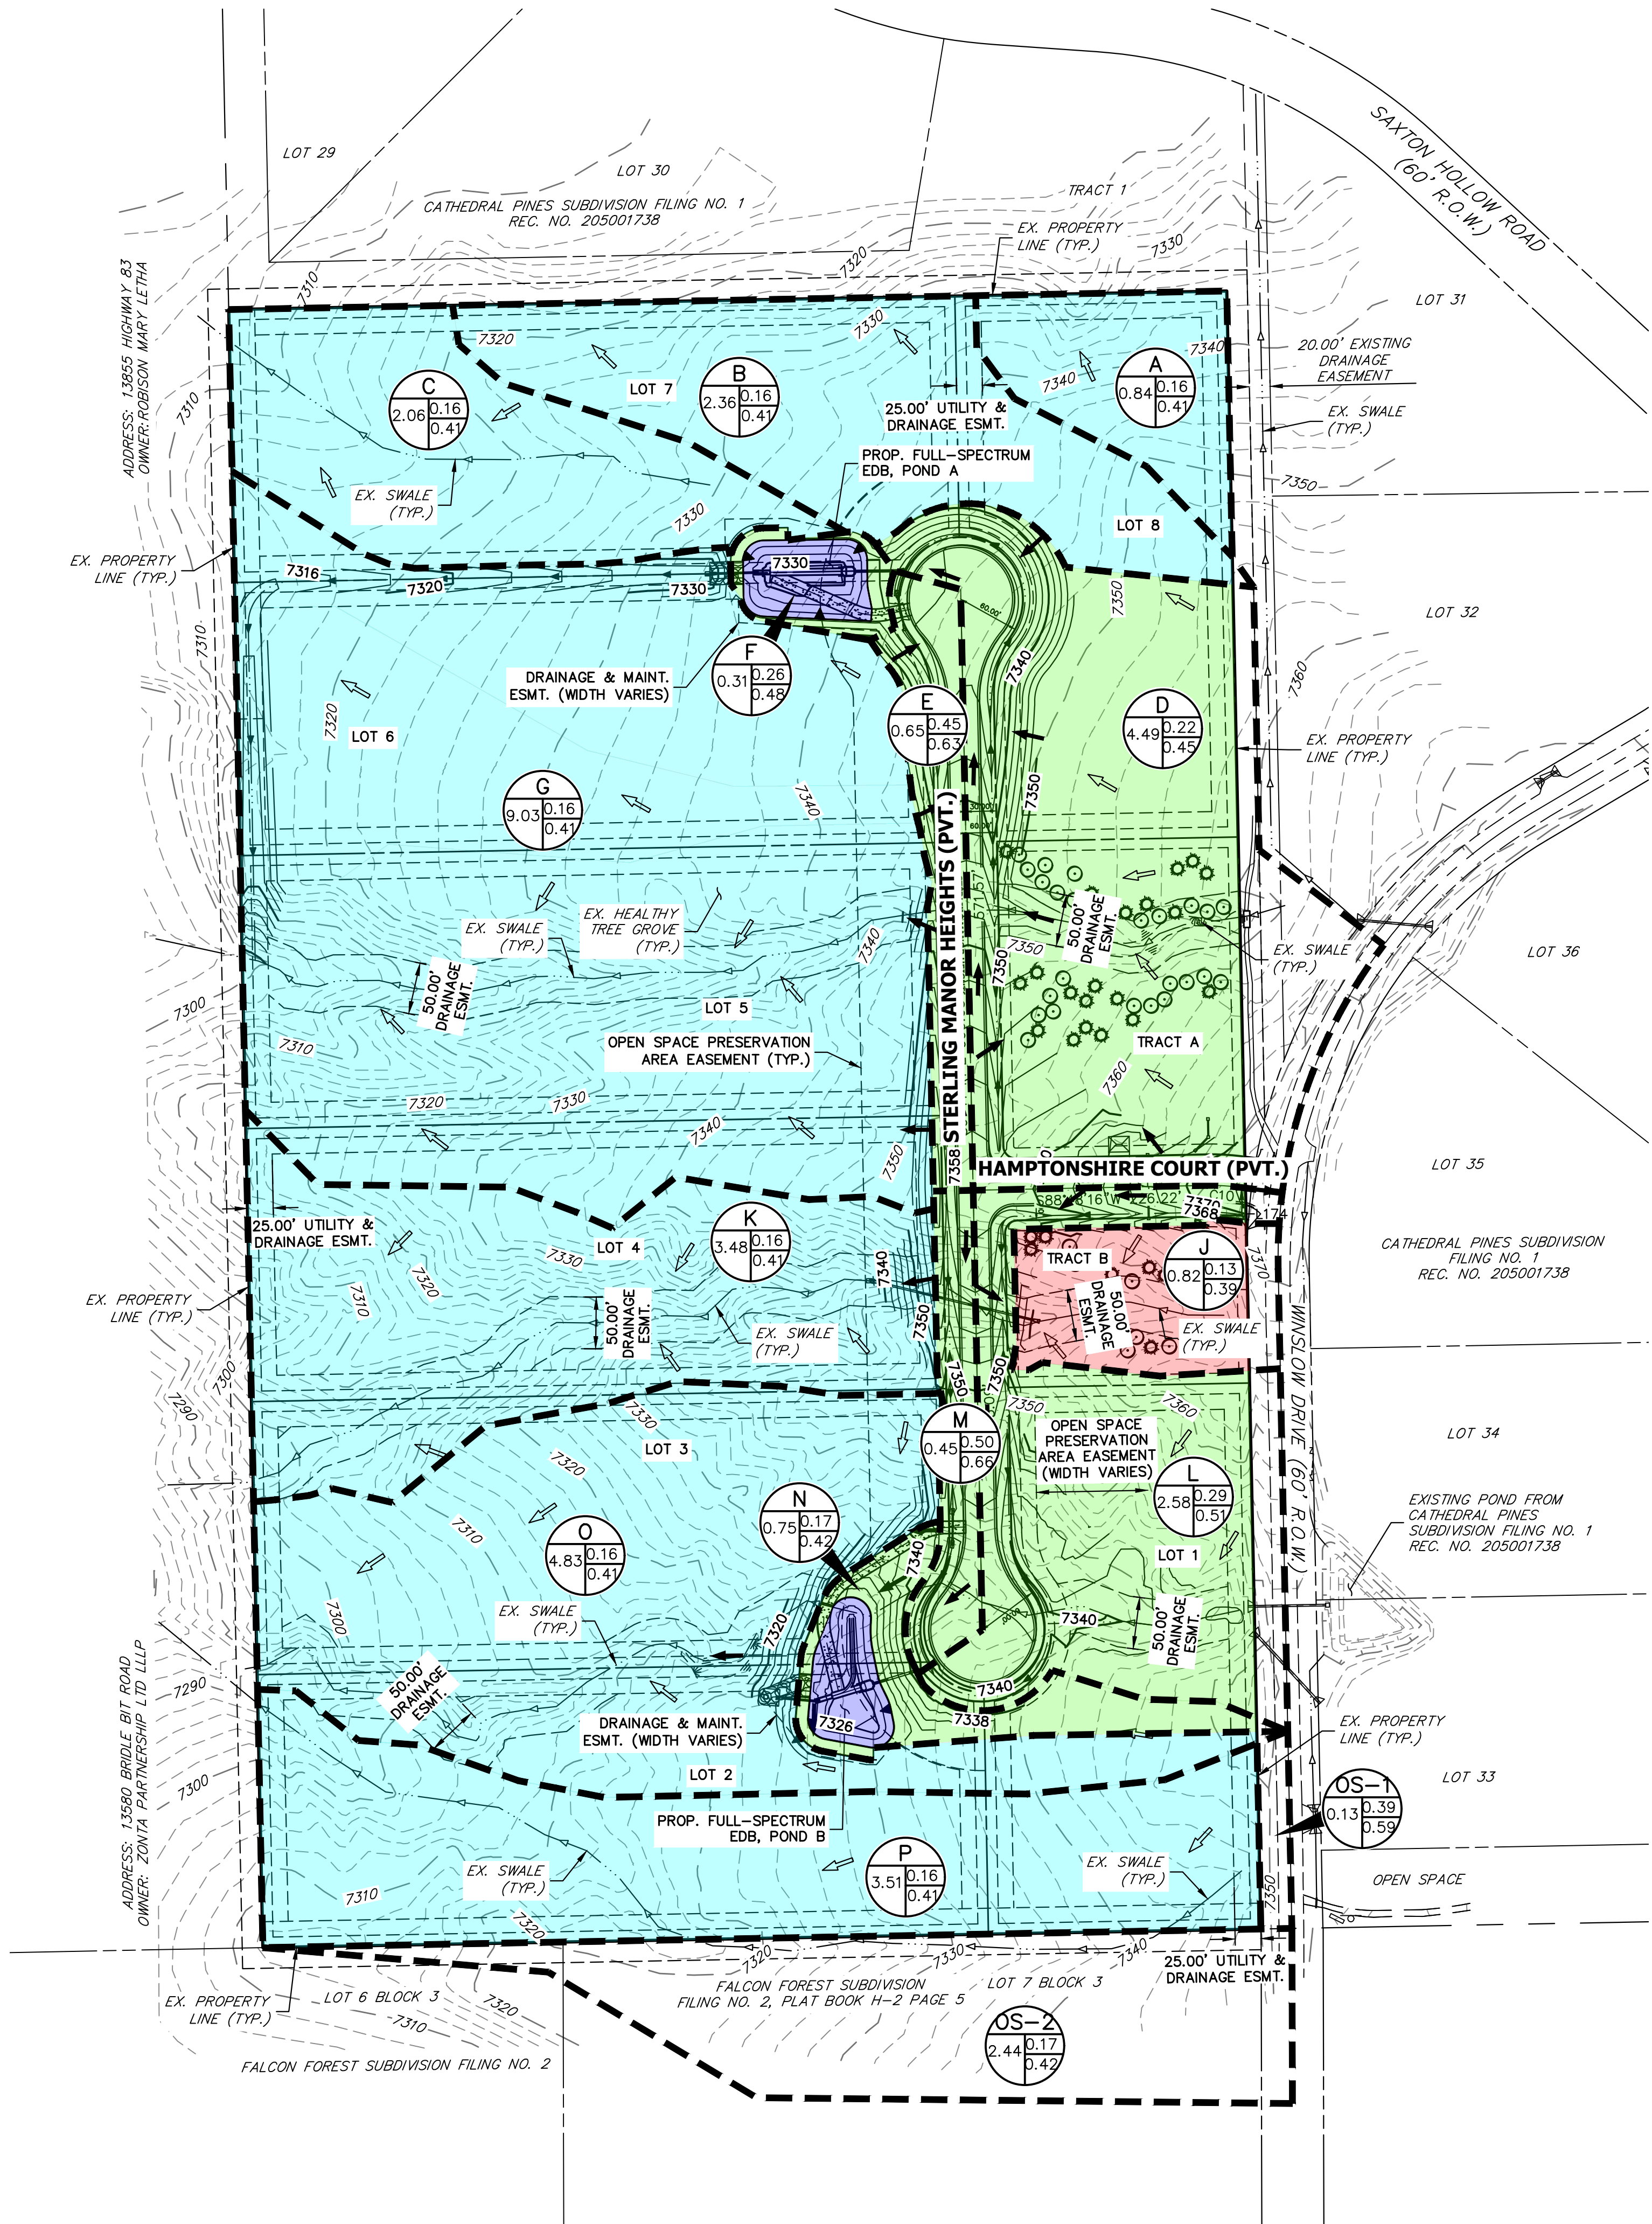

LAYER LINETYPE LEGEND

	EXISTING	PROPOSED
SECTION LINE	---	---
BOUNDARY LINE	---	---
PROPERTY LINE	---	---
EASEMENT LINE	---	---
RIGHT OF WAY	---	---
CENTERLINE	---	---
ELECTRIC	-E-E	E E
FIBER OPTIC	-FO-FO	FO FO
GAS MAIN	-G-G	G G
IRRIGATION MAIN	-IRR-IRR	IRR IRR
OVERHEAD UTILITY	-OHU-OHU	OHU OHU
SANITARY SEWER	-S-S	S S
STORM SEWER	▬▬▬▬▬▬▬▬▬▬	▬▬▬▬▬▬▬▬▬▬
TELEPHONE	-T-T	T T
WATER MAIN	-W-W	W W
SWALE/WATERWAY FLOWLINE	~ ~ ~ ~ ~	~ ~ ~ ~ ~
INDEX CONTOUR	-6100-	-6100-
INTERMEDIATE CONTOUR	-6100-	-6100-
DEPRESSION CONT. (INDEX)	-6100-	-6100-
DEPRESSION CONT. (INTER)	-6100-	-6100-
CURB & GUTTER	▬▬▬▬▬▬▬▬▬▬	▬▬▬▬▬▬▬▬▬▬
WALL	▬▬▬▬▬▬▬▬▬▬	▬▬▬▬▬▬▬▬▬▬
BASIN ID	⊙ ID AC C5 C100	⊙ 4
DESIGN POINT DESIGNATION	→	→
FLOW DIRECTION	→	→
SUB-BASIN DRAINAGE AREA	▬▬▬▬▬▬▬▬▬▬	▬▬▬▬▬▬▬▬▬▬
	<div style="display: inline-block; width: 20px; height: 10px; background-color: #ADD8E6; border: 1px solid black;"></div> LARGE-LOT SINGLE FAMILY DEVELOPMENT UNDETAINED AREA PER ECM APP I.7.1.B.5	<div style="display: inline-block; width: 20px; height: 10px; background-color: #FFC0CB; border: 1px solid black;"></div> LAND DISTURBANCE TO UNDEVELOPED LAND THAT WILL REMAIN UNDEVELOPED AREA PER ECP APP I.7.1.B.7
	<div style="display: inline-block; width: 20px; height: 10px; background-color: #90EE90; border: 1px solid black;"></div> DETAINED AND TREATED AREAS WITHIN PROPOSED EDB'S	<div style="display: inline-block; width: 20px; height: 10px; background-color: #CCCCFF; border: 1px solid black;"></div> APPROXIMATE EDB FOR DETENTION AND WATER QUALITY

Basin ID	Total Area (ac)	Area Tributary to Ponds (ac)	Area Excluded from WQ Per ECM App I.7.1.B.5 (ac)	Area Excluded from WQ Per ECM App I.7.1.B.7 (ac)	Applicable WQ Exclusions
A	0.84	-	0.84	-	ECM App I.7.1.B.5
B	2.36	-	2.36	-	ECM App I.7.1.B.5
C	2.06	-	2.06	-	ECM App I.7.1.B.5
D	4.49	4.49	-	-	-
E	0.65	0.65	-	-	-
F	0.31	0.31	-	-	-
G	9.03	-	9.03	-	ECM App I.7.1.B.5
J	0.82	-	-	0.82	ECM App I.7.1.B.7
K	3.48	-	3.48	-	ECM App I.7.1.B.5
L	2.58	2.58	-	-	-
M	0.45	0.45	-	-	-
N	0.75	0.75	-	-	-
O	4.83	-	4.83	-	ECM App I.7.1.B.5
P	3.51	-	3.51	-	ECM App I.7.1.B.5
OS-1	0.13	-	-	-	-
OS-2	2.44	-	-	2.44	ECM App I.7.1.B.5
Total	38.73	9.23	26.11	3.26	

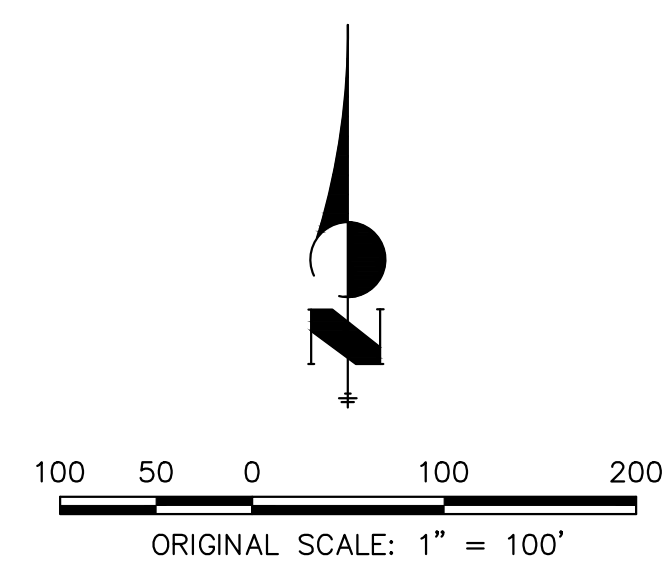

PROPOSED WATER QUALITY MAP
ESTATES AT CATHEDRAL PINES
JOB NO. 25260.00
03/27/2024
SHEET 1 OF 1



Centennial 303-740-9393 • Colorado Springs 719-593-2593
Fort Collins 970-491-9888 • www.jrengineering.com