

# Stormwater Detention and Infiltration Design Data Sheet

*SDI-Design Data v2.00, Released January 2020*

Stormwater Facility Name: **Winsome Subdivison- Filing 2 - Pond 5 with Pond 6**

Facility Location & Jurisdiction: **Winsome Subdivison, El Paso County**

### User Input: Watershed Characteristics

Extended Detention Basin (EDB)	EDB	
Watershed Area =	152.00	acres
Watershed Length =	4,755	ft
Watershed Length to Centroid =	2,378	ft
Watershed Slope =	0.028	ft/ft
Watershed Imperviousness =	13.0%	percent
Percentage Hydrologic Soil Group A =	0.0%	percent
Percentage Hydrologic Soil Group B =	98.1%	percent
Percentage Hydrologic Soil Groups C/D =	1.9%	percent
Target WQCV Drain Time =	40.0	hours
Location for 1-hr Rainfall Depths (use dropdown):		
User Input		

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Once CUHP has been run and the Stage-Area-Discharge information has been provided, click 'Process Data' to interpolate the Stage-Area-Volume-Discharge data and generate summary results in the table below. Once this is complete, click 'Print to PDF'.



User Defined Stage [ft]	User Defined Area [ft^2]	User Defined Stage [ft]	User Defined Discharge [cfs]
0.00	100	0.00	0.00
1.00	20,725	1.00	0.29
2.00	42,508	2.00	0.59
3.00	59,501	3.00	4.31
4.00	75,482	4.00	35.35
5.00	84,240	5.00	79.71
6.00	91,599	6.00	110.60
7.00	98,229	7.00	120.42
8.00	104,545	8.00	675.28

After completing and printing this worksheet to a pdf, go to: <https://maperture.digitaldataservices.com/gvh/?viewer=cswdif>  
 Create a new stormwater facility, and attach the PDF of this worksheet to that record.

### Routed Hydrograph Results

Design Storm Return Period =	WQCV	2 Year	5 Year	10 Year	50 Year	100 Year	
One-Hour Rainfall Depth =	N/A	1.19	1.50	1.75	2.25	2.52	in
CUHP Runoff Volume =	1.055	2.429	4.980	7.498	14.820	19.088	acre-ft
Inflow Hydrograph Volume =	1.152	2.088	6.533	10.168	20.785	26.936	acre-ft
Time to Drain 97% of Inflow Volume =	37.0	38.6	<b>34.2</b>	30.0	20.8	16.8	hours
Time to Drain 99% of Inflow Volume =	40.2	43.0	41.8	39.5	34.3	<b>32.2</b>	hours
Maximum Ponding Depth =	2.04	2.65	3.67	4.23	5.64	6.56	ft
Maximum Ponded Area =	0.99	1.22	1.61	1.78	2.04	<b>2.19</b>	acres
Maximum Volume Stored =	0.995	1.666	3.120	4.073	6.764	8.728	acre-ft

# Stormwater Detention and Infiltration Design Data Sheet

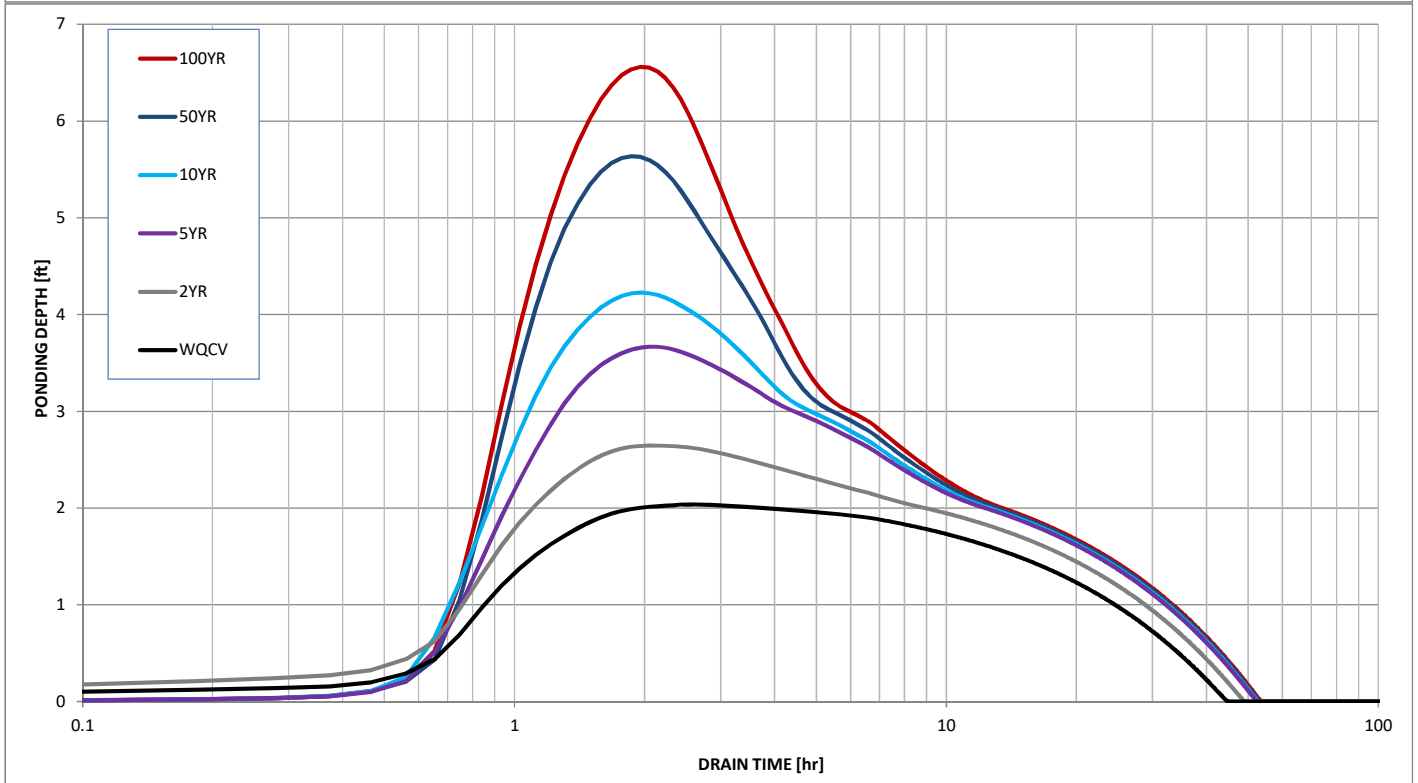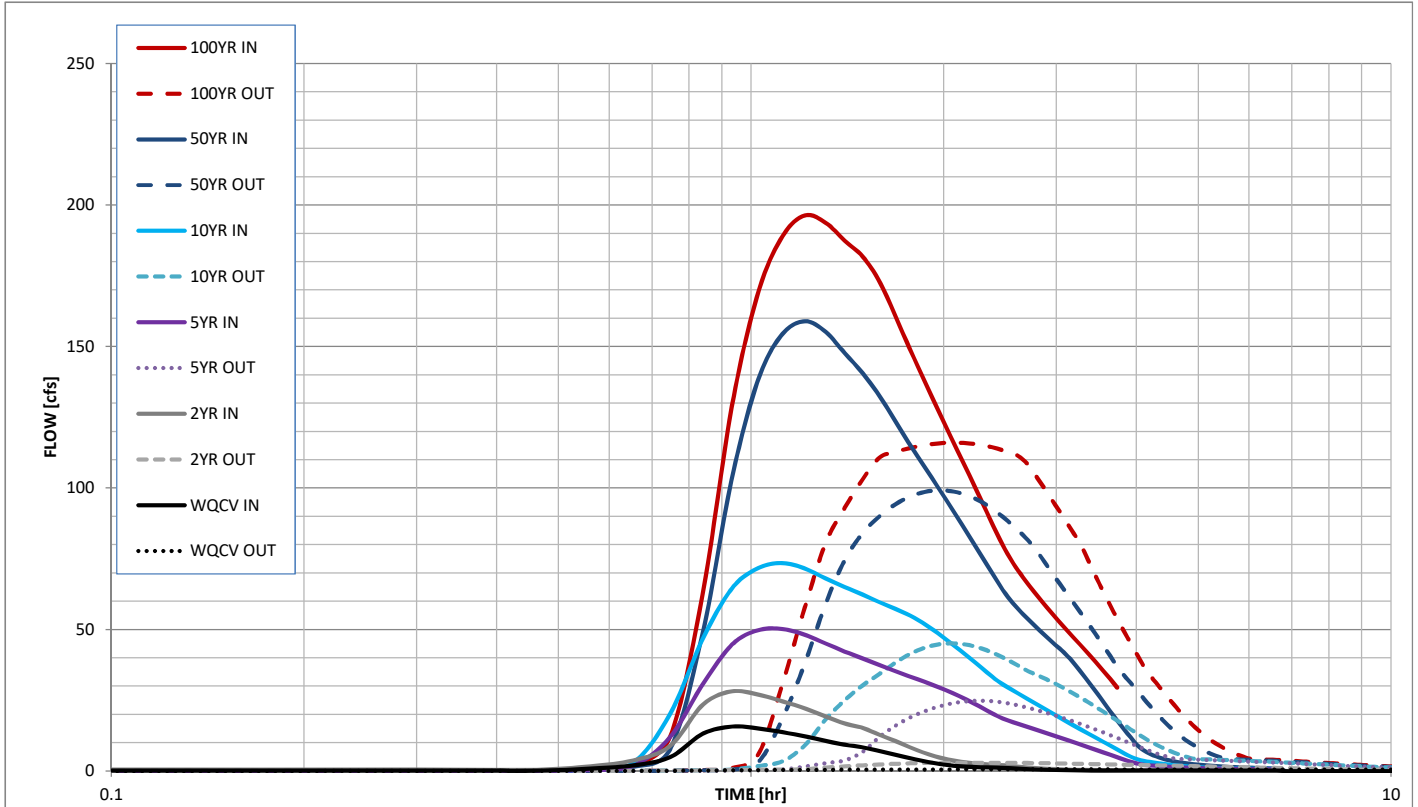



# Stormwater Detention and Infiltration Design Data Sheet

