

LIBERTY TREE ACADEMY – PHASE II IMPROVEMENTS FINAL DRAINAGE REPORT

Prepared for:

Liberty Tree Academy
8579 Eastonville Road
Peyton, CO 80831

Prepared by:

Matrix Design Group, Inc.
1601 Blake Street, Suite 200
Denver, CO 80202

Project Number: 18.995.001

Submitted:

June 26, 2020

PPR2018-023

Engineer's Statement

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Andrew Beck

Andrew Beck, PE
Matrix Design Group
1601 Blake Street, Suite 300
Denver, CO 80202



Developers Statement:

I, the developer have read and will comply with all of the requirements specified in this drainage report and plan.

Ronnie Wilson, Vice President
Liberty Tree Academy Building Corporation
PO Box 64614
Colorado Springs, CO 80962

EL PASO COUNTY ONLY:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Jennifer Irvine, P.E.
County Engineer/ECM Administrator

Date

Conditions:

TABLE OF CONTENTS

I.	GENERAL LOCATION AND DESCRIPTION	4
A.	Location	4
B.	Description of Property	5
II.	DRAINAGE BASINS AND SUB-BASINS	8
A.	Major Basin Descriptions	8
B.	Sub-basin Description	8
C.	Conveyance of Offsite Runoff	10
III.	DRAINAGE DESIGN CRITERIA	10
A.	Development Criteria Reference	10
1.	Design Criteria	10
2.	Previous Drainage Studies	11
B.	Hydrologic Criteria	11
IV.	DRAINAGE FACILITY DESIGN	12
A.	General Concept	12
B.	BMP Selection Process	13
C.	Specific Details	15
1.	Proposed Runoff Patterns and Quantities	15
2.	Extended Detention Basin Design	16
3.	Curb and Gutter, Street, and Inlet Capacity	19
4.	Offsite Channel Capacity	19
V.	DRAINAGE FEES	21
VI.	REFERENCES	22
APPENDIX A – SITE PHOTOS		
APPENDIX B – HYDROLOGIC ANALYSIS		
APPENDIX C – HYDRAULIC ANALYSIS		
APPENDIX D – REFERENCED DOCUMENTS		
APPENDIX E – DRAINAGE PLANS		

List of Figures

Figure 1 – Liberty Tree Academy Vicinity Map.....	6
Figure 2 – National Resources Conservation Service Soils Map.	7
Figure 3 – BMP Selection Matrix.....	14
Figure 4 – Offsite Drainageway Capacity Evaluation	21

List of Tables

Table 1 – One-Hour Rainfall Depths	11
Table 4 – Post-developed Hydrology (Rational Method).....	16
Table 5 - EDB Volume and Flow Rates Summary	17
Table 6 – Peak Flow to Bennett Ranch Drainageway	18
Table 6 – Manning’s n.....	20
Table 7 – Offsite Channel Flow Depth Summary	20

I. GENERAL LOCATION AND DESCRIPTION

This Final Drainage Report is for the Phase II improvements for the Liberty Tree Academy. This is an update to the Liberty Tree Academy Final Drainage Report submitted by Matrix Design Group in August 2018. The update includes a 5,705 sf building addition and a 0.9 acres of added parking area. The “historic” in this report refers to the condition previous to any development, the “existing condition” refers to Phase I improvements outlined in the August 2018 Drainage Report, and the “proposed condition” includes the new proposed addition and parking area within the Phase II development.

A. Location

The proposed Liberty Tree Academy is within Township 12S, and Range 64W, Section 32, SW Quarter, of El Paso County, Colorado as shown in **Figure 1**. The approximate latitude and longitude are 38°57'35"N and 104°35'11 W. The lot is situated along the east side of Eastonville Road from Tex Tan Road to approximately 250 ft north of Snaffle Bit Road. The project area is located east, south, and north of residential parcels. Unplatted agricultural land exists to the east of the site. The project is situated in Woodmen Hills Filing No. 10 (Plat Number 10942). To the north is Woodmen Hills Filing No. 11 (Plat Number 11258). The current El Paso Assessor map is provided in **Appendix F**.

The project is located within the Bennett Ranch (CHWS1200) drainage basin. The project drains to the southeast to the Bennett Ranch drainageway.

B. Description of Property


The overall 12-acre lot consists of the 4.38-acre project area (school, parking, and detention), undeveloped land, and a 240-ft wide drainage easement. This drainage report considers the entire 12-acre lot and the half of the adjacent Eastonville Road. The undeveloped land, except for the drainage easement, will be developed by future projects; this area is covered by the drainage report, but the future impervious values and detention requirements are not considered.

Phase I improvements included the construction of the school, parking lot, landscaping, and extended detention basin (EDB). Of the remaining area, the ground cover currently consists of native grasses, including Blue Grama with a few dispersed alders and other plant species consistent with pasture land in the Colorado Semi-arid plains environment. Willows line the drainageway on the east side of the site. Photos of existing site vegetation are included in **Appendix A**.

Slopes across the property typically range from 1-5%, with some local slopes around small mounds up to 20%. The slope from the access road to the drainageway is approximately 8:1. According to National Resources Conservation Service (NRCS) soil datasets, the predominant soil type is Columbine gravelly sandy loam, 0 to 3 percent slopes. This soil type is generally consistent with a Type A hydrologic soil group (HSG). NRCS soil data was obtained from the Soil Survey Geographic (SSURGO) Database for Arapahoe County, Colorado. The spatial dataset was last updated September 23, 2016 (version 7) and the tabular dataset was last updated October 10, 2017 (version 14). The soils map and a breakdown of HSG group by basin is provided in **Figure 2**.

The site includes a 240-ft wide drainage easement along the eastern boundary associated with Bennett Ranch drainageway, which flows from north to south along the property boundary. The boundary of the drainage easement is marked by an existing access road, which overlays a parallel water line. Existing sewer, gas, fiber optic, underground electric, underground telephone, water, and storm utilities are located within the Eastonville Road right-of-way. General locations of existing utilities are presented in **Figure B-1**. An irrigation system for the newly landscaped areas was installed with Phase I.



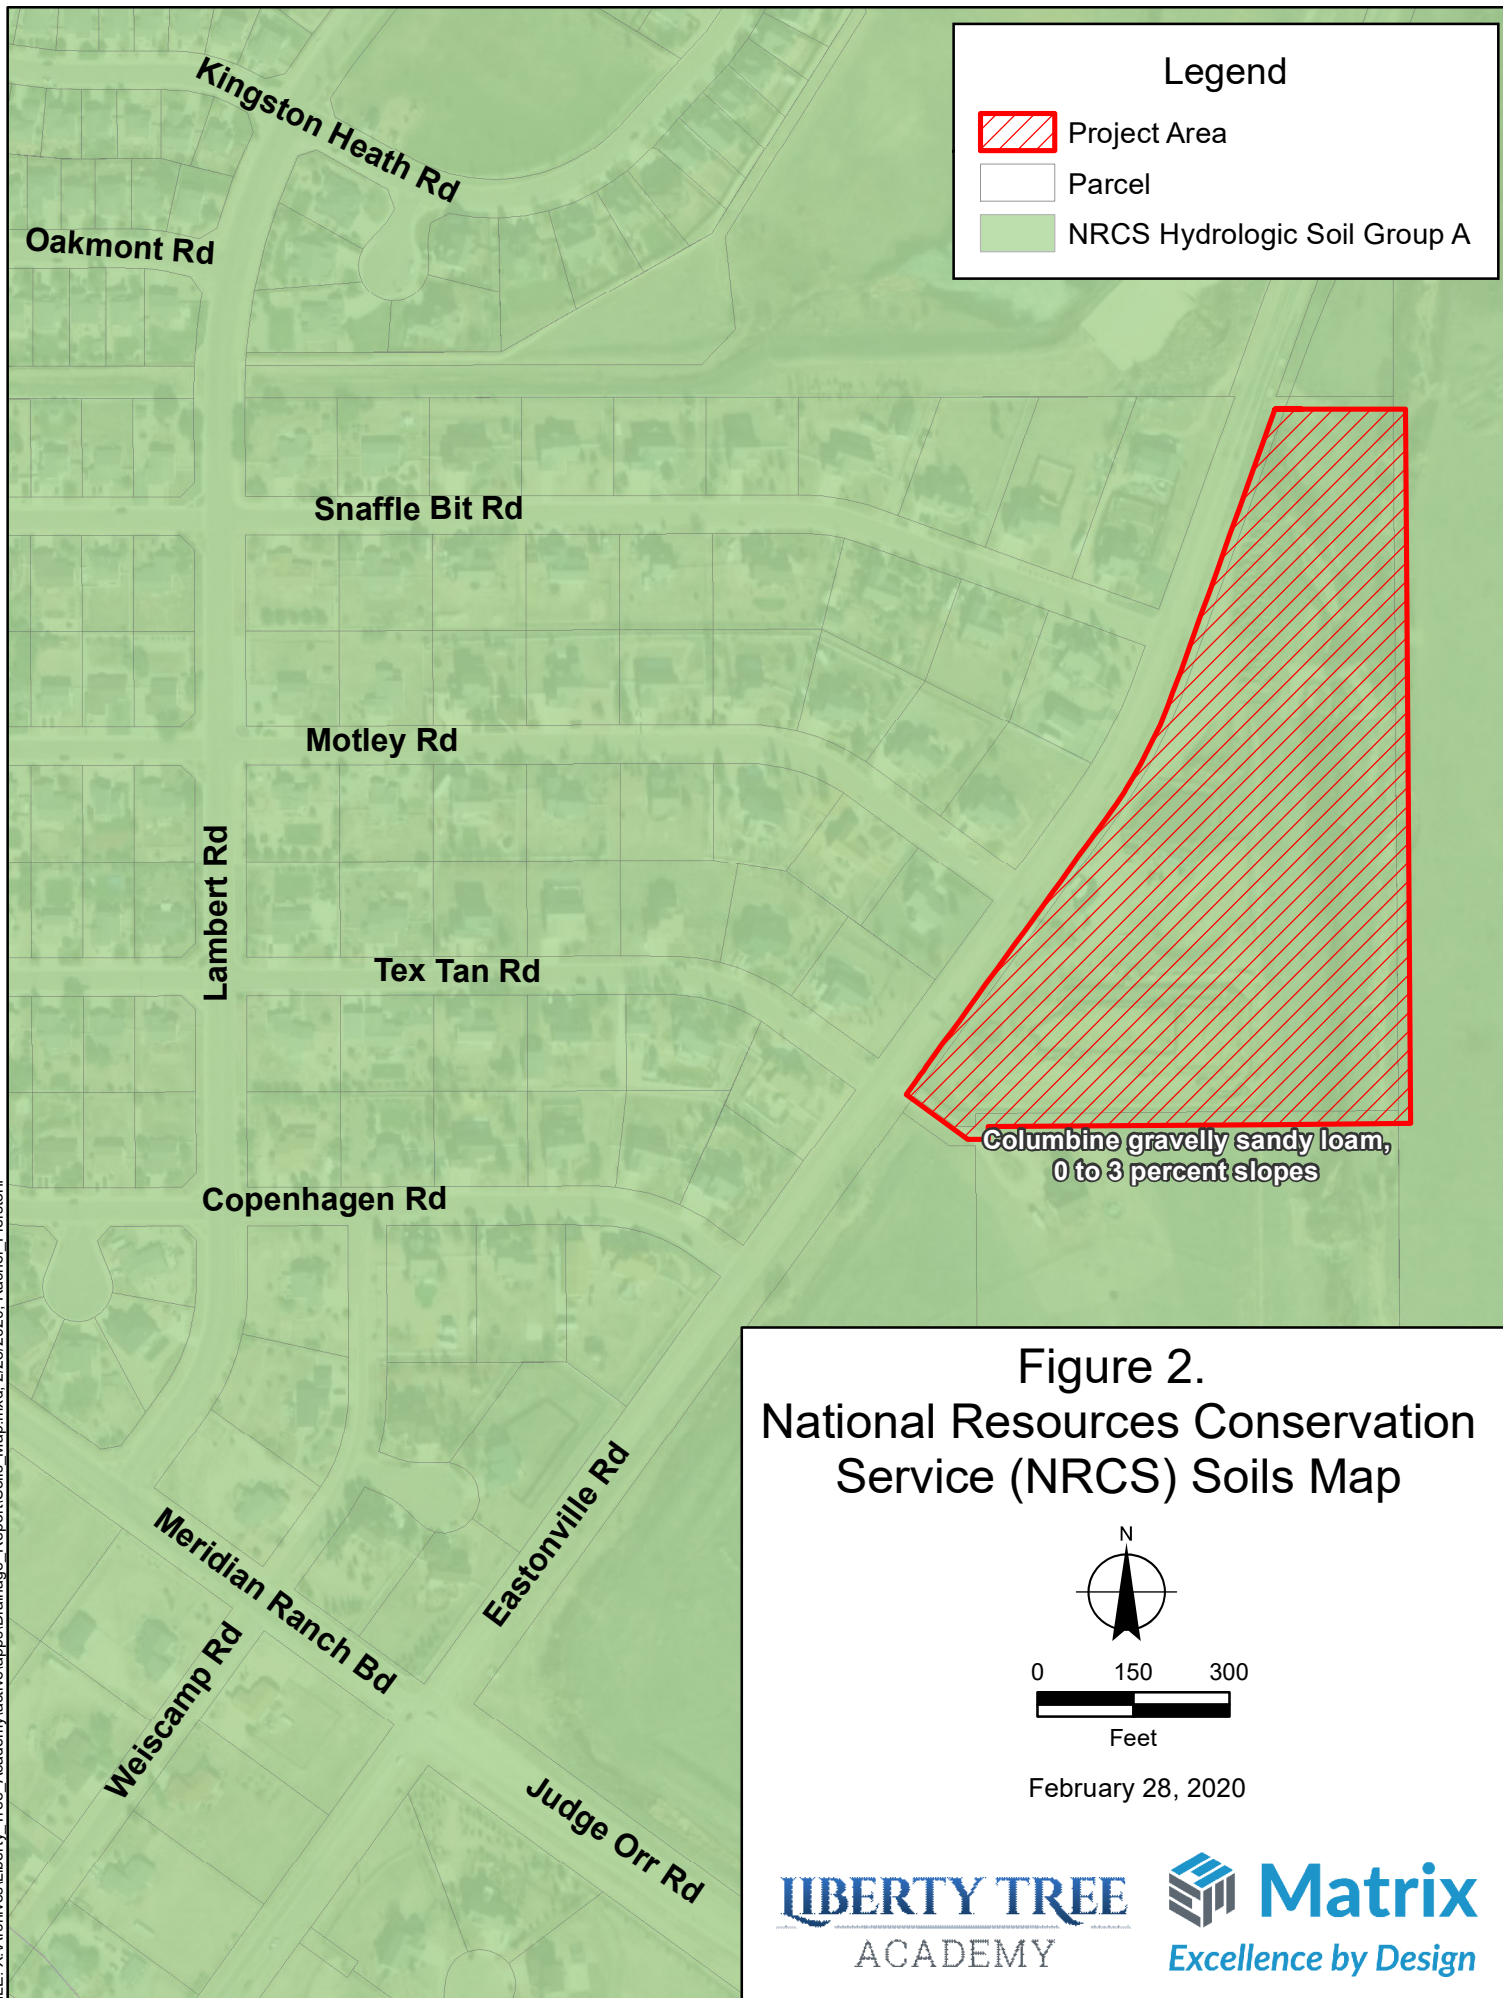

II. DRAINAGE BASINS AND SUB-BASINS

A. Major Basin Descriptions

The project falls between Design Points (DP) D and C in the *Bennett Ranch Drainage Basin Planning Study (DBPS)* (El Paso County 2001). Between these design points, surface runoff flows to the southeast and the drainageway flows from north to south. The selected plan in the DBPS proposes a 50 acre-ft detention pond upstream of the project area at DP D and 9,500 linear-ft of new channel at 0.25% with thirteen 3-ft drop structures between Eastonville Road (DP D) and Drake Pond (between DP C and B). Based on the 2016 aerial, it appears that these proposed improvements are constructed. Selected pages from the DBPS are provided in **Appendix D**.

A Flood Insurance Study exists for El Paso County, Colorado and Incorporated Areas (FEMA 1999). The property is not located within a FEMA defined Floodplain, as identified on Flood Insurance Rate Map, Unincorporated El Paso County Community Panel Number 08041C0554 G, Effective December 7, 2018 (see **Appendix D**).

B. Sub-basin Description

The overall project area in the historic, Phase I, and Phase II proposed condition drain southeast to the Bennett Ranch Drainageway. Historic topography routes surface flows southeast across the lot to the drainage easement access road. East of the access road, an approximately 8:1 embankment slopes to the east to the invert of the Bennett Ranch drainageway. The lot encompasses both banks of the drainageway within the 240-ft wide drainage easement. In the Phase I and Phase II condition, developed flows are routed the EDB before being discharged to Bennett Ranch drainageway

The site has been sub-divided into sub-basins. A description of these sub-basins follows:

Eastonville Road

Proposed Basins ER1 and ER2 are 0.94 and 0.45 acres in size, respectively, and consist of existing roadway, lawn, and proposed sidewalk. As in the historic condition, runoff generated in these basins will drain into the existing curb and gutter in Eastonville Road and continue southwest at Design Point (DP) ER2. The total impervious area added from the proposed sidewalk will be less than an acre and the increase in peak runoff is 0.5 cfs and 1.2 cfs in the 5yr and 100yr event, respectively. There is sufficient capacity in Eastonville Road, see Curb and Gutter/Street Capacity calculations in **Appendix C**.

Southern Boundary

In the historic condition, Basin OS1 drains to the property to the south before reaching the Bennett Ranch Drainageway. With the Phase I improvements, Basin OS1 was reduced in size from 2.39 acres to 0.30 acres and will remain vegetated. Runoff generated in basin OS-1 will continue to sheet flow to the property to the south before reaching the Bennet Ranch Drainageway. Because of the decrease in tributary area and peak flows, no adverse impact to the property to the south is anticipated.

Extended Detention Basin

Proposed basins A-C drain to the proposed EDB. The proposed Basin A is 2.57 acres in size and contains the Phase I building, the Phase II building expansion, playground, and Phase I parking areas. The majority of runoff from basin A will be routed via curb and gutter to a curb cut at DP A, where it will be routed into the EDB. A separate piped system conveys roof runoff to the EDB; an underdrain draining directly to the Bennett Ranch Drainageway serves the playground area. The runoff from the roof and playground are included within Basin A and not calculated separately. The storm infrastructure for Basin A was constructed with Phase I.

The proposed Basins B1 and B2 are 0.44 and 0.45 acres, respectively, and consist of new parking and landscaped area proposed with Phase II. Runoff from these basins is routed via curb and gutter to Type-R Inlets in the low spot of each basin. The storm system serving Basins B1 and B2 discharges into the EDB.

The proposed Basin C is 0.69 acres in size and contains undeveloped area and the EDB. Runoff from Basin A reaches the EDB at a rundown at DP A, and runoff from Basins B1 and B2 reaches the EDB via a piped storm system. The EDB was designed and constructed with Phase I improvements and will serve the Phase II improvements as well. Modifications from the original EDB design are discussed in Section IV.C.2. If the undeveloped area of Basin C develops in the future, the EDB will likely need to be re-designed.

Bennett Ranch Drainageway

The EDB outfall, Basin OS1, and Basin OS2 eventually drain to the Bennett Ranch Drainageway. Basin OS2 is reduced in size from 8.37 acres to 6.01 acres from the historic to Phase II condition and will continue to sheet flow into the drainageway. Basin OS2 is largely undisturbed except some grading to meet historic grade and the installation of a riprap rundown with Phase I. Disturbed areas will be revegetated. The tributary runoff from Basin OS2 will be less in the proposed condition than in the historic condition. Basin OS2 will continue to serve as a drainage easement.

C. Conveyance of Offsite Runoff

Basins ER1 and ER2 contain half of offsite Eastonville Road and the proposed sidewalk and landscaped area within the ROW. These basins will continue to drain into Eastonville Road, which can adequately convey the proposed runoff. The total area added by the proposed sidewalk is less than an acre, and total peak runoff released from the entire site will be less than in the existing condition. See Section IV.C.1 and Appendix C for more details on the runoff quantifications.

Some undeveloped area within Basin C will sheet flow into a proposed Extended Detention Basin (EDB). The extended detention basin is designed to accommodate this extra undeveloped area; should this area develop in the future, the extended detention basin may have to be redesigned to accommodate the increased impervious area. Basin OS-2 will remain undeveloped and will continue to drain east to Bennett Ranch Drainageway.

A normal depth flow analysis was performed to ensure the existing off-site Bennett Ranch Drainageway could sufficiently pass 100-year peak offsite runoff without resulting in adverse site impacts. A detailed description of this analysis can be found in Section IV.C.3. 100-yr offsite runoff in the channel is lower than the emergency overflow weir elevation of the onsite extended detention basin.

III. DRAINAGE DESIGN CRITERIA

A. Development Criteria Reference

1. Design Criteria

This report is prepared in accordance with the following criterion:

- Chapter Six, Section 6.3.2 – Drainage and Section 6.3.5 - Grading and Erosion Control of the El Paso County Land Development Code.
- El Paso County Drainage Criteria Manual Volume 1 and Volume 1 Update (DCM-V1, DCM-V1-Update)
- El Paso County Drainage Criteria Manual Volume 2 (DCM-V2)
- Engineering Criteria Manual for El Paso County, revised July 2019.

In addition, the Mile High Flood District (MHFD) criteria manuals and spreadsheet tools were used to guide design assumptions. El Paso County adopts the use of MHFD's MHFD-Rational and MHFD-Detention within the listed references above.

2. Previous Drainage Studies

There are several existing drainage reports and studies used in the development of this report. They are:

- Liberty Tree Academy Final Drainage Report by Matrix Design Group, August 2018. (Phase I Drainage Report).
- El Paso County. 2001. Bennett Ranch Pilot Project Drainage Basin Planning Study. El Paso County. November 2001.
- Federal Emergency Management Agency (FEMA). 2018. Flood Insurance Rate Map Number 08041C0554 G. El Paso County, Colorado and Unincorporated Areas. Effective December 7, 2018.

The site is not within a FEMA regulatory floodplain (See **Appendix D**). The Bennett Ranch Pilot Project Drainage Basin Planning Study (Bennet Ranch DBPS) outlines the improvements to the adjacent drainage channel and upstream detention basin. Anticipated runoff in the adjacent channel during the 100-yr event may cause backwater events into the proposed extended detention basin but will be below the crest elevation of the emergency overflow weir (see Section IV.C.4).

The site will utilize an extended detention basin and will therefore not cause significant increases in runoff rates due to development which would negatively impact downstream properties (see Section IV.C.2).

B. Hydrologic Criteria

Based on Figures 6-6 through 6-17 of the DCM-V1, the NOAA Atlas 2 rainfall depths presented in Table 6-2 of the DCM-V1 Update applies. The basin size is less than 2 square-miles; therefore, Depth Area Reduction Factors are not required. The one-hour rainfall depths used in this analysis are presented in **Table 1**.

Table 1 – One-Hour Rainfall Depths

D ₂ (in)	D ₅ (in)	D ₁₀ (in)	D ₂₅ (in)	D ₅₀ (in)	D ₁₀₀ (in)
1.19	1.50	1.75	2.00	2.25	2.52

The rational method was used to calculate the runoff, as outlined in Section 6.2 of the MHFD Volume 1, with the exception of the impervious values and runoff coefficients which were taken from the DMC-V1-Update. For street and gutter capacity, the minor design storm was the 5-yr event. The major design storm is the 100-yr event.

Composite percent imperviousness, assuming Type A soils (see **Figure 2**), for each historic and proposed basin were determined using the land use categories in Table 6-6 of the DCM-V1-Update. These values are presented in **Table 2** and **Appendix B**.

Table 2 – Percent Imperviousness from Table 6-6 of DCM-V1-Update

Land Use or Surface Characteristic	Percent Imperviousness	C _{5yr}	C _{100yr}
Pasture/ Meadow, Lawn	0	0.08	0.35
Playground	13	0.16	0.41
Roofs	90	0.73	0.81
Paved, Drive and Walks	100	0.90	0.96

Water quality and stormwater detention will be provided by the onsite extended detention basin. Total detention volumes and discharges were determined using MHFD's MHFD-Detention_v4.02 (See Section IV).

IV. DRAINAGE FACILITY DESIGN

A. General Concept

Generally, existing site flows are to the southeast. The proposed development will maintain the overall drainage patterns. As in the historic condition, the area within the ROW of Eastonville Road will continue to drain west to the curb and gutter. A portion of the site along the southern border graded and vegetated with Phase I will continue drain to the property to the south; the proposed tributary area will remain vegetated and total area and runoff reaching the property to the south will be less than in the historic condition. East of the access road, there is a surface break and the site slopes approximately 8:1 towards the offsite drainageway. This section of the property is not included in planned development in order to maintain existing drainage patterns and avoid changes to the drainage easement. Any minor grading changes to this area will be re-vegetated.

With the exception of the sidewalk along Eastonville Road, all runoff from the developed area will be routed to the extended detention basin (EDB) in the eastern side of the project area constructed with Phase I. The extended detention basin will maintain historic outflow to the existing Bennett Ranch Drainageway. The EDB will serve the Phase II improvements with minor changes in grading for the access road, see section IV.C.2.

B. BMP Selection Process

Per section I.7.2 of El Paso ECM, a four-step process is used to select structural BMPs for the site. Discussion of these four steps and decision matrix is found below.

1. Employ Runoff Reduction Practices

Opportunities to minimize directly connected impervious areas were limited for this site; Most of the disturbed site is utilized for the building footprint or parking area or will be in future improvements. The sidewalk along Eastonville Road is disconnected from the road. Developed runoff from the site is routed to an extended detention basin.

2. Stabilize Drainageways


All channelized runoff on the site is conveyed via curb and gutter to curb cuts and inlets at DPs A and B, respectively. Runoff from Basin A is routed to the EDB via a riprap rundown and runoff from Basin B1 and B2 is routed to the EDB via a storm system. The energy for inflow to the EDB is dissipated in a concrete forebay. A trickle channel conveys channelized runoff within the extended detention basin to its outlet. The extended detention basin outfalls to Bennett Ranch Drainageway, which was previously stabilized with drop structures, in accordance with the Bennett Ranch DBPS (See Section II.A and **Appendix D**).

3. Provide WQCV

Water Quality Capture Volume (WQCV) is provided within the Excess Urban Runoff Volume (EURV) in the onsite extended detention basin. See **Appendix C** for extended detention basin design. The only developed areas not routed to the EDB are the sidewalks and a portion of the driveway adjacent to Eastonville Road, because the sidewalks are graded towards Eastonville Road. It would be impractical to route this runoff towards the site. The total impervious area from the sidewalk and driveway draining towards Eastonville Road is less than 0.14 acres for both the Phase I and Phase II development. The sidewalk will sheet drain onto a landscape buffer, which will adequately treat the WQCV for this area as calculated by the UD-BMP v3.07 worksheet, allowed in Section I.7.1.B.6 of the revised ECM. This calculation is included in **Appendix C**.

4. Consider Need for Industrial and Commercial BMPs

The proposed use for this site, a school, does not warrant Covering of Storage/Handling Areas or Spill Containment and Control.

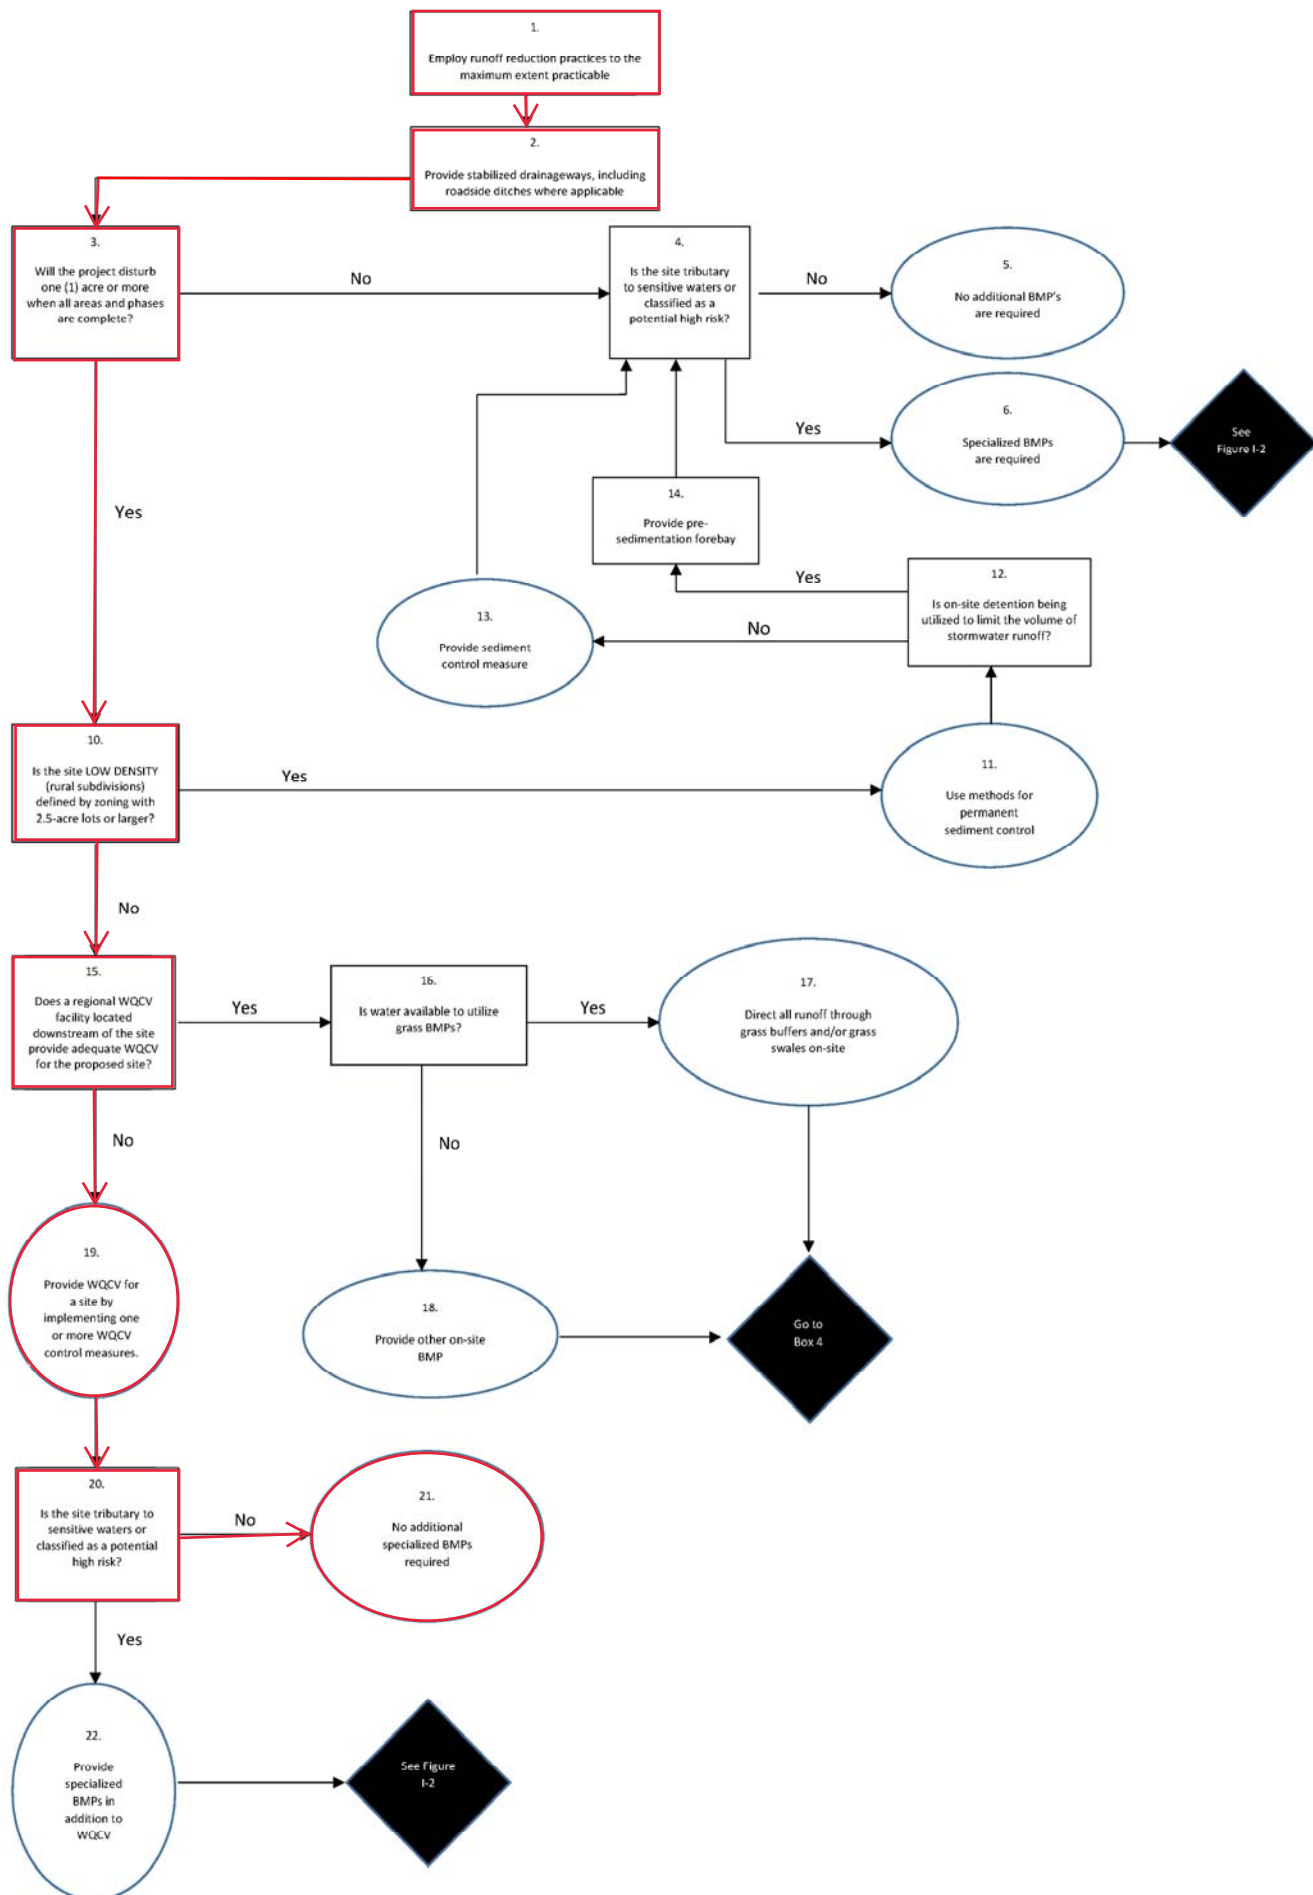

C. Specific Details

1. Proposed Runoff Patterns and Quantities

The proposed development will maintain the overall drainage patterns. As in the existing condition, the area within the ROW of Eastonville Road (Basins ER1 and ER2) will continue to drain west to the curb and gutter. A portion of the site along the southern border (Basin OS1) will drain to the property to the south; the proposed tributary area will remain vegetated and total area and runoff reaching the property to the south will be less than in the historic condition. Basin OS2 will remain undeveloped and drain to the Bennett Ranch Drainageway; any regraded area in basin OS2 will be revegetated.

Basins A, B1, B2, and C contain all the developed areas apart from the sidewalk along Eastonville Road. Basins A-C are tributary to the EDB. Runoff from the parking lot and fire lane of Basin A is routed via curb gutter to a curb cut at DP A and is conveyed to a forebay in the EDB by a riprap rundown. A separate piped system will convey roof runoff to the EDB. Runoff from Basins B1 and B2 will be routed via curb and gutter to inlets at DP B1 and DP B2, and will then be routed via a piped system to the EDB. Basin C contains the EDB; runoff generated in this basin sheet flows into the EDB.

Historic and proposed runoff values, calculated using the rational method, are presented in **Tables 3** and **4**, respectively. See Appendix B for detailed hydrology calculations, see Appendix C for detailed hydraulic calculations.

Table 3 – Pre-developed Hydrology (Rational Method)

Design Point	Tributary Basins	Drainage Area (ac)	Tc (min)	Q ₅ (cfs)	Q ₁₀₀ (cfs)
ER1 (Driveway)	ER1	0.76	9.8	1.74	3.70
ER2	ER2	0.33	5.0	0.92	1.97
ER2	ER1+ER2	1.10	12.2	2.26	4.83
OS1	OS1	2.39	23.1	0.52	3.83
OS2	OS1	8.37	23.1	2.43	14.19

Table 4 – Post-developed Hydrology (Rational Method)

Design Point	Tributary Basin	Drainage Area (ac)	Tc (min)	Q ₅ (cfs)	Q ₁₀₀ (cfs)
ER1 (Driveway)	ER1	0.94	9.8	2.11	4.52
ER2	ER2	0.45	6.1	1.08	2.40
ER2	ER1+ER2	1.39	12.3	2.76	5.98
OS1	OS1	0.30	5.0	0.12	0.90
OS2	OS2	6.01	23.0	1.92	10.44
A	A	2.57	9.5	7.66	14.65
B1	B1	0.44	5.0	1.34	2.77
B2	B2	0.45	5.0	1.94	3.53
C	C	0.69	13.7	0.28	1.54
C* (Pond Inflow)	A+B1+B2+C	4.15	11.3	9.93*	20.11*

*Note: *. For DP C, flows represent inflow into the EDB, not the attenuated outflow.*

2. Extended Detention Basin Design

The extended detention basin was constructed with Phase I and is located at the eastern edge of the developed area. The EDB will intercept all developed runoff from the site and convey attenuated flows east to the Bennett Ranch Drainageway. The EDB will preserve historic flow rates to Bennett Ranch Drainageway and provide full spectrum detention (WQCV, EURV and 100-yr detention). Detailed design calculations, outlet configuration, and design drawings for the section IV.C can be found in **Appendix C**.

Modifications for Phase II Improvements

The existing EDB will serve Phase I and Phase II improvements. Since the approval to the Phase I plans, the UD-Detention v3.07 spreadsheet has been replaced by the MHFD-Detention v4.02. spreadsheet with differences in calculated hydrographs and WQCV/EURV storage calculations. The as-built outlet structure is modeled in the new MHFD-Detention v4.02 spreadsheet, including the increased impervious areas for Phase II to verify that drain times are still in compliance with CRS § 37-92-602(8).

Changes to pond grading are proposed with Phase II, to include the access road which was not constructed with Phase I and to adjust the bottom of the pond to more closely match the area outlined in the Phase I construction drawings.

The outlet structure will not need to be modified. With the proposed alterations to grading, the Phase II WQCV drains in 40 hours, the EURV in 59 hours, release 97% of all events in less than 72 hours, and releases 99% of all events in less than 120 hours. The discussion of volumes and release rate for the Phase II improvements are presented in the subsequent discussion within this section.

The emergency overflow weir was constructed at an elevation of 6951.52' instead of 6951.00', and at a width of 8.82' instead of 10.00'. The emergency overflow will convey the 100-yr emergency flow with less than 12" of ponding in the parking lot and 3' below the finished floor elevation of the building, see the subsequent discussion in this section.

Volumes and Release Rates

The basin and outlet structure were originally sized and built in Phase I using the UDFCD-Detention spreadsheet v3.07, which was the accepted criteria at the time. This report utilizes the MHFD-Detention spreadsheet, version 4.02 in accordance with DCM-V1-Update criteria to verify the structure is still in compliance. The outlet structure was designed utilizes an orifice plate to release the water quality capture volume (WQCV) over 40-hours and the extended urban runoff volume (EURV) in between 52 and 72-hours. Because of the change in tributary area and updated methodology between the detention workbooks, the EURV now overtops the weir of the outlet structure and is controlled by the restrictor plate instead. The drainage times are still in compliance with CRS § 37-92-602(8) and thus the outlet structure will not need to be modified. A 2.5' micropool in front of the orifice plate provides settlement. A drop box and 18-inch pipe with a restrictor plate attenuates runoff events exceeding the EURV. Outflows will be conveyed under to the existing stabilized channel in Bennett Ranch Drainageway. The Phase III development will increase the impervious area routed to the EDB; these volumes are adequately contained in the existing EDB. Total proposed detention volumes and release rate summary are provided in the table below:

Table 5 - EDB Volume and Flow Rates Summary

Design Storm Return Period	EDB Summary							
	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year
Rational Calculations								
Predev. Peak Inflow (cfs)=	N/A	N/A	0.24	1.20	2.61	4.98	6.72	8.78
MHFD Detention Spreadsheet								
Pre-dev. Peak Inflow (CUHP) (cfs)	N/A	N/A	0.03	0.06	0.08	0.75	1.51	2.46
Dev. Peak Inflow (CUHP) Q (cfs)	N/A	N/A	4.11	5.33	6.22	7.87	9.30	11.22
Dev. Peak Outflow Q (cfs)=	0.05	1.23	0.27	0.96	1.18	1.22	1.25	1.29
Calculated Runoff Volume (acre-ft)	N/A	N/A	0.248	0.324	0.385	0.463	0.540	0.632
Maximum Volume Stored (acre-ft)	0.093	0.355	0.227	0.247	0.271	0.337	0.398	0.488
Maximum Ponding Elevation (ft)	6946.94	6948.87	6948.04	6948.19	6948.34	6948.77	6949.12	6949.61

Per the MHFD's Detention Workbook, the proposed 100-yr release rate from the detention basin will be 52% of the existing inflow rate. In the 2-yr through 25-yr events, the predevelopment runoff calculated using MHFD-Detention workbook was very low (<1 cfs) which is due to the small tributary area. As a result, the workbook calculated developed outflow exceeds the predeveloped inflow for these conditions. Restricting outflow for these conditions any further would cause retention in excess of 72 hours. A more appropriate method for calculating the 2-yr through 25-yr events is the rational method, the results of which are presented the table above. Proposed outflow from the extended detention basin at DP C is less than the historic runoff at DP C as calculated with the rational method. **See Appendix B** for detailed calculations.

The peak outflow from the EDB is also different than the peak timing of basin OS2. A more accurate quantification of the peak flows to the Bennet Ranch Drainageway generated within the site would be to add the peak outflows from the EDB and Basin OS2 at the time of concentration of Basin OS2. Those calculations are presented below.

Table 6 – Peak Flow to Bennett Ranch Drainageway

Event	Q100 (cfs)		
	OS2	EDB Outflow	Total
5-yr	1.92	0.03	1.95
100-yr	10.44	0.03	10.47

Tc= 23.0 min

The peak outflow into Bennett Ranch is reduced by 0.48 cfs in the 5-yr event and 3.72 cfs in the major event.

Emergency Overflow and Freeboard

The calculated 100-yr WSEL is 6949.61'. Placing the emergency overflow weir crest at this elevation would have reduced the cover of the waterline parallel to the access road to less than 5'. In order to maintain 5' of cover over the waterline the emergency overflow weir elevation was designed to be at 6951.00', with as-built survey showing the crest elevation at 6951.52. In the condition that the outlet structure became completely clogged, the 100-yr event runoff volume, 0.632 ac-ft, would have a ponded elevation of 6950.13'. Total freeboard between the 100-yr WSEL (clogged condition) and weir crest is 1.23'. In the condition where the outlet structure is completely clogged in the 500-year event, the ponded elevation would be 6951.13'. There would be 0.39' of freeboard between the clogged 500-yr event and the spillway.

The constructed emergency spillway is 8.82-ft wide and is calculated to convey 100-year undetained flows (20.1 cfs) with 8.6" inches of flow depth and consists of soil riprap (Type VL riprap) in accordance with Figure 12-21 from MHFD Volume 2. In the event the emergency overflow weir is activated, some ponding in the parking lot built with Phase I would occur, but would be less than 12" and would be more than 3' below the finished floor elevation of the building.

Other Design Components

Runoff will enter the EDB via the concrete pans within the parking lot in drainage Basin A and flow down a riprap rundown to the forebay. From Basins B1 and B2, runoff will be captured by Type-R inlets and piped to a trickle channel, and then to the pond forebay. The 6" tall pond forebay is sized for 2% of the WQCV of Basins A-B2, as per DCM-V2. The target release rate (2% of undetained runoff into the EDB) is 0.40 cfs, which can be achieved with a 5.3-inch notch. This forebay has already been constructed with Phase I with a 4.1-inch notch, which should not affect the overall performance of the forebay.

The main trickle channel constructed with Phase I and the new trickle channel for the B Basin storm system will be concrete and 4-inch deep as per DCM-V2. Per criteria, the capacity of the channel is sized to convey the maximum possible forebay outlet capacity, at a minimum. The flat bottom longitudinal slope will be graded at 0.5% per MHFD Volume 3. The adjacent vegetated areas will slope towards the low flow channel at 3%, as per DCM-V2 and MHFD Volume 3.

Maintenance access was not built with Phase I, and will be built with Phase II along the west side of the EDB and include ramps with less than 10% slopes to the forebay, pond bottom, and outlet structure. The pond will be maintained by Liberty Tree Academy as part of grounds maintenance via a Stormwater BMP Maintenance Agreement, which will be signed and recorded as part of this project approval.

3. Curb and Gutter, Street, and Inlet Capacity

An 8-ft wide crosspan, in accordance with El Paso's Standard Details, will be constructed at the driveway intersection with Eastonville Road to convey offsite runoff within the road at the north end of the new Phase II parking lot. Another crosspan was constructed for the parking lot constructed with Phase I. Flowmaster V8i was used for the capacity calculations for the driveway/cross pan. Onsite curb/gutter capacity was calculated using UD-Inlet_v4.05. All street and curb calculations are provided in **Appendix C**. The Type-R Inlet capacity within Basins B1 and B2 were also calculated using the UD-Inlet_v4.05 workbook.

4. Offsite Channel Capacity

In order to ensure the existing off-site drainageway can sufficiently pass 100-year peak runoff without resulting in adverse site impacts, a normal depth analysis was conducted using FlowMaster, version 8i. 100-year outflow from the upstream detention pond as described in the DBPS was considered in this analysis (see **Appendix D**). Two typical drainageway cross-sections were cut along the project extents. The longitudinal channel slope was estimated based on available contours and the DBPS Selected Alternative (0.25%).

The resulting typical cross-sections are presented in **Figure 4**. The cross-section points on the west bank are taken from survey. Cross section points from the east bank are calculated based on the typical channel cross section found in the *Bennett Ranch* DBPS (See **Appendix D**). It is assumed that some incision of the channel has occurred since the construction of the stabilized channel, and the toe (the invert of the original channel) is equal to the surveyed elevation 5' west of the surveyed flowline. The Manning's n for the channel sections is taken from Table 8-5 of MHFD Volume 1, which is summarized in **Table 6**. The resulting water flow depths and freeboard are presented in **Table 7**.

Table 7 – Manning's n

Location and Cover	Manning's n ¹
<u>Main Channel (bankfull channel)</u>	
Sand or clay bed	0.04
<u>Vegetated Overbanks</u>	
Native Grasses	0.05
Willow Stands, woody shrubs	0.16

Notes:

1. Manning's n for assessing water surface elevation and water depth

A detailed cross section and corresponding segments for each manning's n used can be found in **Appendix C**. Normal flow depths for the channel are as follows:

Table 8 – Offsite Channel Flow Depth Summary

Scenario	100-yr WSEL (feet)	Flow Depth (feet)	Freeboard (feet)
Cross-section 1	6943.90	7.14	7.10
Cross-section 2	6945.87	7.87	5.13

Notes:

1. 100-Year Master Planned Flow = 810 cfs, as per the DBPS for 100-year release rate from the upstream pond, see **Appendix D**).
2. Freeboard is measured from weir crest elevation. = 6951.0

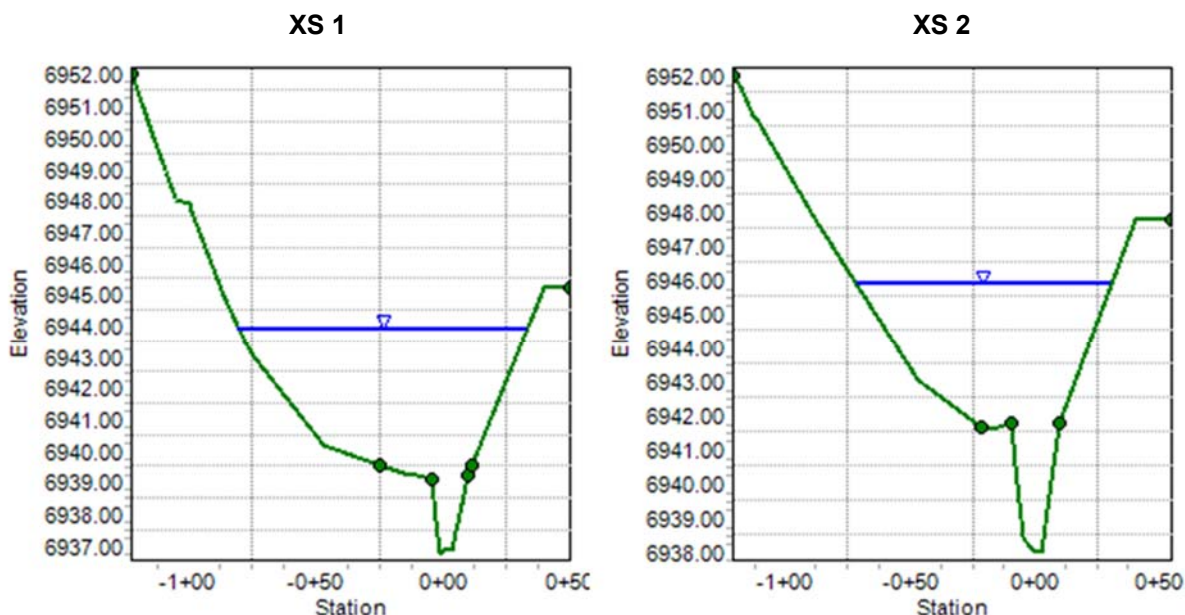


Figure 4 – Offsite Drainageway Capacity Evaluation

Cross sections, looking upstream

Q100=810 cfs (release rate of upstream basin)

There is a significant amount of freeboard between 100-yr channel WSEL and the onsite emergency overflow weir crest. The 100-yr WSEL at Section X2 (6945.87), however, is higher than the invert of the detention basin outlet pipe (6942.00). Because of difference in peak timing, it is not anticipated that this will negatively impact the ability for the EDB to drain in 72 hours or less.

The offsite channel can convey 60 cfs without any backwater effect on the pond (WSEL = invert of outlet pipe = 6942.00'). Backflow would not occur into the pond until offsite flow of 538 cfs (WSEL = Invert of pond = 6945). Calculations can be found in **Appendix C**.

V. DRAINAGE FEES

Drainage and Bridge fees were paid with the Woodmen Hills Filing #10 final plate, therefore no fees are due.

VI. REFERENCES

Bentley. 2009. FlowMaster Hydraulic Toolbox, Version 8i. November 4, 2009.

El Paso County. 2016. Engineering Criteria Manual, Revision 6. El Paso County. Adopted 12/23/2004. Revised 12/13/2016.

El Paso County. 1994. City of Colorado Springs Drainage Criteria Manual Volume 1 (DCM 1). Chapters 1 through 5. Prepared by City of Colorado Springs. Adopted by El Paso County. October 1994.

El Paso County. 2014. City of Colorado Springs Drainage Criteria Manual Volume 1 Update (DCM 1). Chapters 6 through 13. Prepared by City of Colorado Springs. Adopted by El Paso County. May 2014.

El Paso County. 2002. City of Colorado Springs Drainage Criteria Manual Volume 2 (DCM 2). Prepared by City of Colorado Springs. Adopted by El Paso County. November 2002.

El Paso County. 2000. El Paso County Land Development Code, Chapter V. El Paso County. Last Updated June 29, 2000.

El Paso County. 2001. Bennett Ranch Pilot Project Drainage Basin Planning Study. El Paso County. November 2001.

Federal Emergency Management Agency (FEMA). 1999. Flood Insurance Study El Paso County, Colorado and Unincorporated Areas. Revised August 23, 1999.

Federal Emergency Management Agency (FEMA). 1997. Flood Insurance Rate Map Number 08041C0575 F. El Paso County, Colorado and Unincorporated Areas. Effective August 17, 1997.

Federal Emergency Management Agency (FEMA). 2013. Letter of Map Revision Case No. 12-08-0659P, Flood Insurance Rate Map Number 08041C0575 F. El Paso County, Colorado and Unincorporated Areas. Effective July 12, 2013.

Mile High Flood District (MHFD). 2018. Urban Storm Drainage Criteria Manual, Volumes 1 through 3. Mile High Flood District. Last updated April 2018.

Mile High Flood District (MHFD). 2017a. MHFD-Detention, Version 4.02. Mile High Flood District. Last updated January 2020.

APPENDIX A – SITE PHOTOS



Figure A1. Project area looking east.



Figure A2. Project area looking south east along utility access towards the drainage easement.



Figure A3. Project area looking north along Eastonville Road right-of-way.



Figure A4. Project area looking south towards adjacent residential property.



Figure A5. Bennett Ranch drainageway looking upstream (north) along eastern extent of the project area.

APPENDIX B – HYDROLOGIC ANALYSIS

Project Name: **Liberty Tree Academy**
 Job Number: **20.995.002**
 Subject: **Composite Runoff Coefficients**
 Date: **6/25/2020**
 Designed by: **MAS**

Global Parameters							
Land Use	% Imp.	C ₂	C ₅	C ₁₀	C ₂₅	C ₅₀	C ₁₀₀
Pasture/ Meadow, Lawn	0	0.02	0.08	0.15	0.25	0.30	0.35
Playground	13	0.07	0.16	0.24	0.32	0.37	0.41
Paved, Drive and Walk, Detention	100	0.89	0.90	0.92	0.94	0.95	0.96
Roofs/Gravel	90	0.71	0.73	0.75	0.78	0.80	0.81

*Type A Soils

Subbasin	Total Area (acres)	Land Use Area per Sub-Basin								Composite Imperviousness	Composite Runoff Coefficient					
		Pasture/ Meadow, Lawn		Playground		Paved, Drive and Walk, Detention		Roofs/Gravel			2-year	5-year	10-year	25-year	50-year	100-year
		Area (acres)	%	Area (acres)	%	Area (acres)	%	Area (acres)	%							
EXISTING																
ER1	0.76	0.32	42.1%	0.00	0.0%	0.44	57.9%	0.00	0.0%	57.9%	0.52	0.55	0.60	0.65	0.68	0.70
ER2	0.33	0.14	43.5%	0.00	0.0%	0.19	56.5%	0.00	0.0%	56.5%	0.51	0.54	0.59	0.64	0.67	0.69
OS1	2.39	2.39	100.0%	0.00	0.0%	0.00	0.0%	0.00	0.0%	0.0%	0.02	0.08	0.15	0.25	0.30	0.35
OS2	8.37	8.10	96.8%	0.00	0.0%	0.27	3.2%	0.00	0.0%	3.2%	0.05	0.11	0.17	0.27	0.32	0.37
PROPOSED																
ER1	0.94	0.40	42.9%	0.00	0.0%	0.54	57.1%	0.00	0.0%	57.1%	0.52	0.55	0.59	0.64	0.67	0.70
ER2	0.45	0.22	48.4%	0.00	0.0%	0.23	51.6%	0.00	0.0%	51.6%	0.47	0.50	0.55	0.61	0.64	0.66
OS1	0.30	0.30	100.0%	0.00	0.0%	0.00	0.0%	0.00	0.0%	0.0%	0.02	0.08	0.15	0.25	0.30	0.35
OS2	6.01	5.74	95.5%	0.00	0.0%	0.27	4.5%	0.00	0.0%	4.5%	0.06	0.12	0.18	0.28	0.33	0.38
A	2.57	0.32	12.3%	0.12	4.5%	1.43	55.5%	0.71	27.7%	81.0%	0.70	0.72	0.75	0.78	0.80	0.82
B1	0.44	0.16	37.2%	0.00	0.0%	0.28	62.8%	0.00	0.0%	62.8%	0.57	0.60	0.63	0.68	0.71	0.73
B2	0.45	0.02	5.4%	0.00	0.0%	0.42	94.6%	0.00	0.0%	94.6%	0.84	0.86	0.88	0.90	0.91	0.93
C	0.69	0.66	95.5%	0.00	0.0%	0.03	4.5%	0.00	0.0%	4.5%	0.06	0.12	0.18	0.28	0.33	0.38
Pond Total A-C	4.15	1.16	28.0%	0.12	2.8%	2.16	52.0%	0.71	17.2%	67.9%	0.59	0.62	0.66	0.70	0.73	0.75

TIME OF CONCENTRATION

Location: Liberty Tree Academy
Date: June 25, 2020
Designed by: MAS

P1, 5-yr: $\frac{1.50}{2.52}$ in.
P1, 100-yr: $\frac{1.50}{2.52}$ in.

Sub-Basin Data						Overland Time (ti)			Travel Time 1 (tt)					Travel Time 2 (tt)					Tc Check					Tc	5-Year Runoff			100-Year Runoff		
Design Pt.	Basin ID	Area	Imperv.	Coefficient "C5"	Coefficient "C100"	Length (300' max)	Slope	ti	Length	Slope	Cv, conveyance factor	Velocity = Cv * Slope^0.5	tt	Length	Slope	Cv, conveyance factor	Velocity = Cv * Slope^0.5	tt	tc=ti+tt	Channelized Length	Channelized Slope	tc = (26-17i)+Lt/(60(14i+9)St^0.5	Minimum tc	Final tc	5-Year Intensity "I"	C5A	Total Peak Discharge "Q5"	100-Year Intensity "I"	C100A	Total Peak Discharge "Q100"
		acres				ft	%	min.	ft	%		fps	min						min	ft		min	min	min			cfs			cfs
EXISTING																														
ER1	ER1	0.76	58%	0.55	0.70	21	2.5%	3.4	873	1.3%	20	2.3	6.4						9.8	873	1.3%	23.6	5.0	9.8	4.10	0.42	1.74	6.88	0.54	3.70
ER2	ER2	0.33	57%	0.54	0.69	12	2.5%	2.6	367	1.6%	20	2.6	2.4						5.0	367	1.6%	19.2	5.0	5.0	5.09	0.18	0.92	8.55	0.23	1.97
ER2	ER1+ER2	1.10	57%	0.55	0.70	21	2.5%	3.4	873	1.3%	20	2.3	6.4	367	1.6%	20	2.6	2.4	12.2	1240	1.4%	26.5	5.0	12.2	3.74	0.60	2.26	6.29	0.77	4.83
OS1	OS1	2.39	0%	0.08	0.35	175	2.0%	19.6	241	2.7%	7	1.1	3.5						23.1	241	2.7%	28.7	5.0	23.1	2.73	0.19	0.52	4.59	0.84	3.83
OS2	OS2	8.37	3%	0.11	0.37	197	12.5%	11.0	1041	0.9%	15	1.4	12.1						23.1	1041	0.9%	44.6	5.0	23.1	2.73	0.89	2.43	4.59	3.09	14.19
PROPOSED																														
ER1	ER1	0.94	57%	0.55	0.70	21	2.5%	3.4	873	1.3%	20	2.3	6.4						9.8	873	1.3%	23.8	5.0	9.8	4.09	0.52	2.11	6.87	0.66	4.52
ER2	ER2	0.45	52%	0.50	0.66	21	2.5%	3.7	367	1.6%	20	2.6	2.4						6.1	367	1.6%	20.2	5.0	6.1	4.82	0.22	1.08	8.09	0.30	2.40
ER2	ER1+ER2	1.39	55%	0.53	0.69	21	2.5%	3.5	873	1.3%	20	2.3	6.4	367	1.6%	20	2.6	2.4	12.3	1240	1.4%	27.0	5.0	12.3	3.73	0.74	2.76	6.26	0.95	5.98
OS1	OS1	0.30	0%	0.08	0.35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	5.0	5.0	5.09	0.02	0.12	8.55	0.11	0.90
OS2	OS2	6.01	4%	0.12	0.38	197	12.5%	10.9	1041	0.9%	15.0	1.4	12.1						23.0	1041	0.9%	44.0	5.0	23.0	2.74	0.70	1.92	4.60	2.27	10.44
A	A	2.57	81%	0.72	0.82	5	2.0%	1.2	740	0.6%	20.0	1.5	8.3						9.5	740	0.6%	20.3	5.0	9.5	4.14	1.85	7.66	6.96	2.11	14.65
B1	B1	0.44	63%	0.60	0.73	7	2.5%	1.8	431	1.3%	20.0	2.3	3.1						4.9	431	1.3%	18.8	5.0	5.0	5.09	0.26	1.34	8.55	0.32	2.77
B2	B2	0.45	95%	0.86	0.93	7	2.5%	0.9	473	1.3%	20.0	2.3	3.4						4.3	473	1.3%	13.0	5.0	5.0	5.09	0.38	1.94	8.55	0.41	3.53
C	C	0.69	4%	0.12	0.38	95	3.2%	12.0	165	0.6%	20.0	1.6	1.7						13.7	165	0.6%	28.9	5.0	13.7	3.55	0.08	0.28	5.96	0.26	1.54
C	A-C	4.15	68%	0.62	0.75	5	2.0%	1.6	740	0.6%	20.0	1.5	8.3	140	0.6%	20.0	1.5	1.5	11.3	880	0.6%	25.0	5.0	11.3	3.86	2.57	9.93	6.48	3.10	20.11

EDB EXISTING RUNOFF ANALYSIS

Location: Liberty Tree Academy
 Date: June 25, 2020
 Designed by: MAS

Basin Name: Existing A-C

Area (ac.) 4.15
 Imperv. (%) 0%
 Tc (min.) 13.27


Design Storm	P1 (in)	Runoff Coefficient	Intensity "I"	Total Peak Discharge "Q100"
			in/hr	cfs
2	1.19	0.02	2.86	0.24
5	1.5	0.08	3.60	1.20
10	1.75	0.15	4.20	2.61
25	2	0.25	4.80	4.98
50	2.25	0.30	5.40	6.72
100	2.52	0.35	6.05	8.78

*Intensity values from Eq. 5-1 of MHFD V1

APPENDIX C – HYDRAULIC ANALYSIS


Extended Detention Basin Design

ORIGINAL POND DESIGN FROM 2018 PLANS

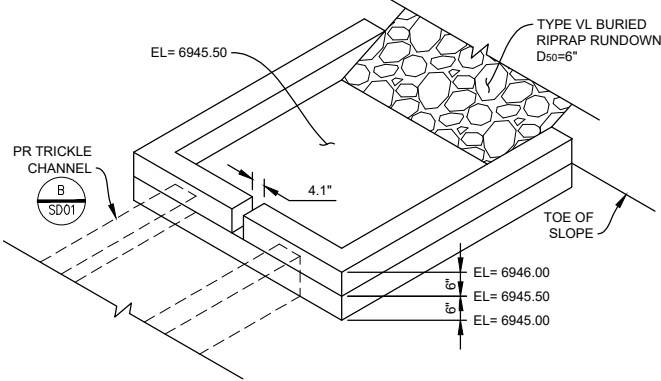


FOREBAY DETAIL (A)

SCALE: N.T.S. SEE PLAN FOR LIMITS.

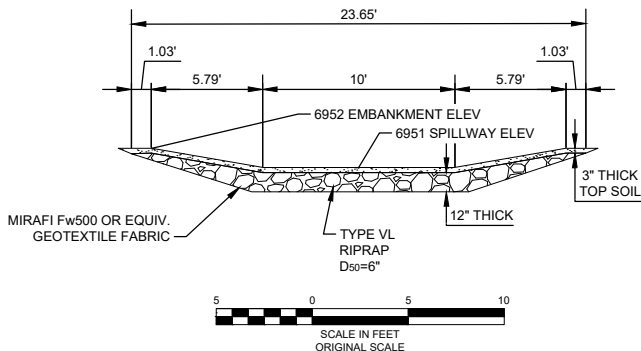


SPILLWAY SECTION (C)






SCALE: 1" = 5'

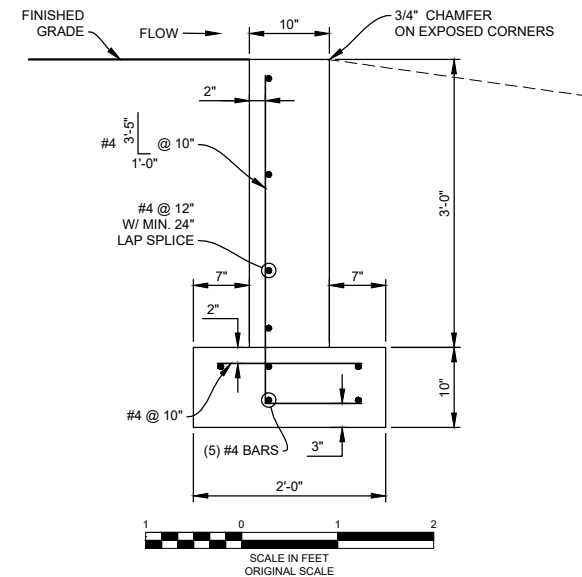

CONCRETE OVERFLOW WALL SECTION (D)

SCALE: 1" = 1'-0"

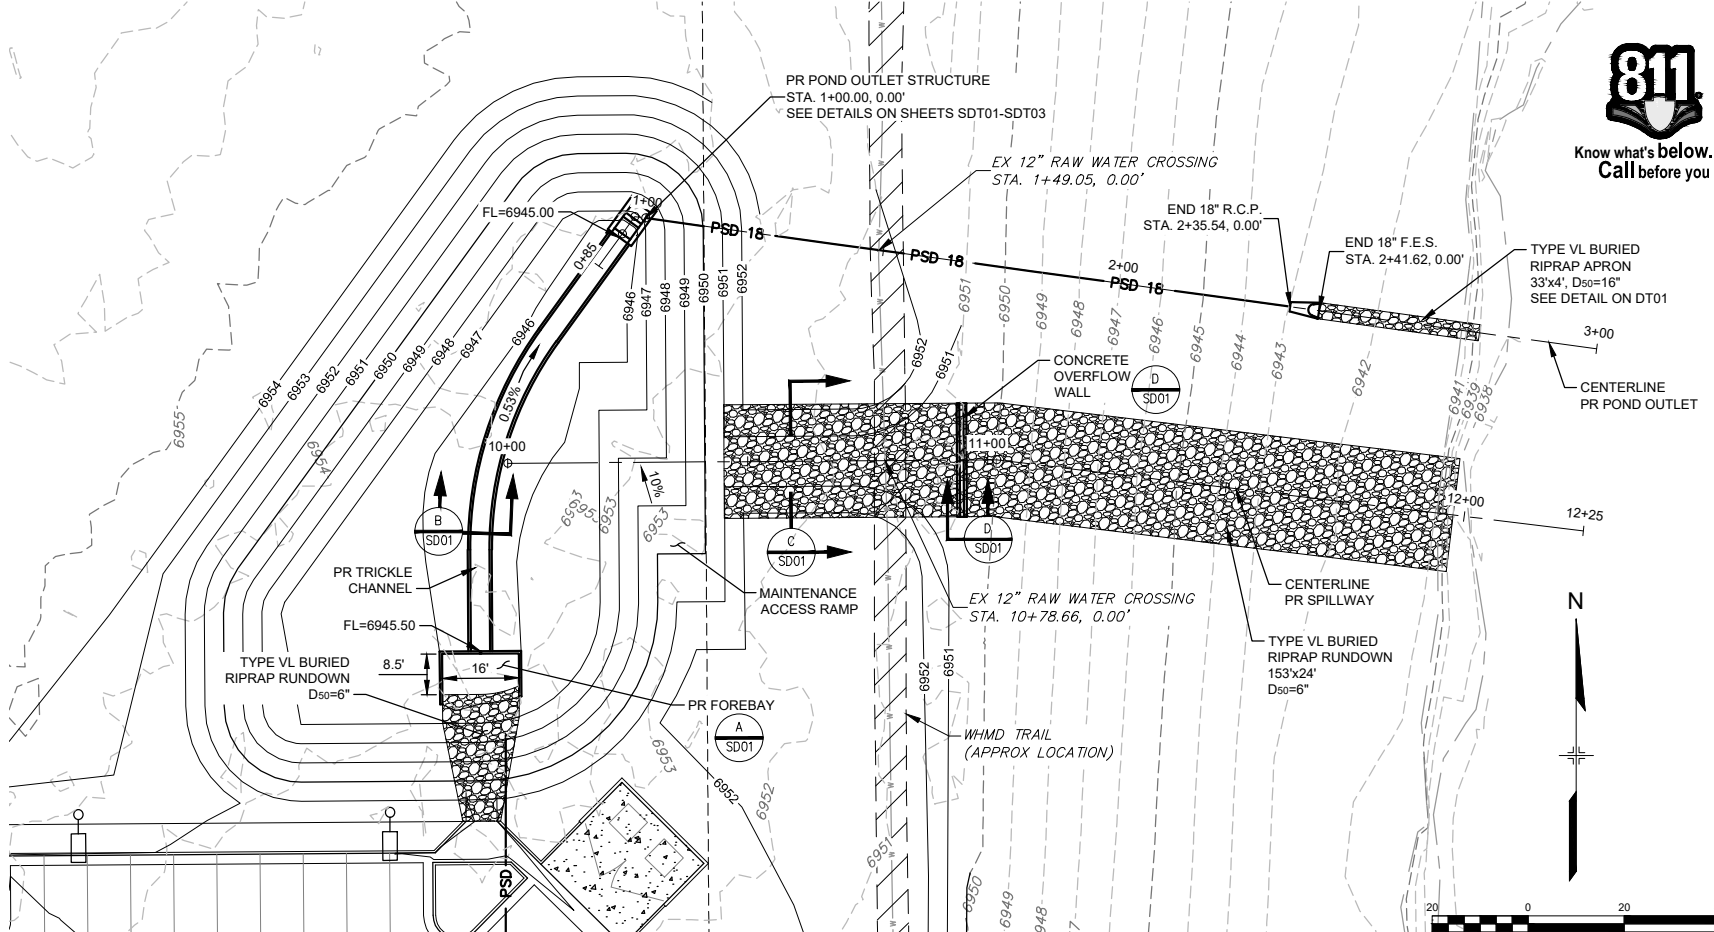




SHEET KEY




SEAL






FOR AND ON BEHALF OF
MATRIX DESIGN GROUP, INC.
PROJECT No. 18.995.001

LIBERTY TREE ACADEMY			
TOWN OF PEYTON, EL PASO COUNTY CONSTRUCTION DOCUMENTS, PCD FILE NO. PPR-18-023			
POND OUTLET STRUCTURE DETAILS			
DESIGNED BY:	ACR	SCALE	
DRAWN BY:	ACR	HORIZ. 3/8" = 1'-0"	DATE ISSUED: AUGUST 2018
CHECKED BY:	DRK	VERT. 3/8" = 1'-0"	DRAWING No. SDT01
		SHEET	20 OF 29

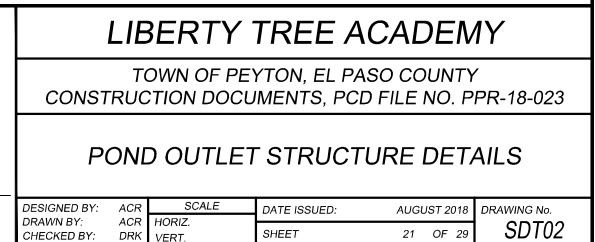



Know what's below.
Call before you dig.

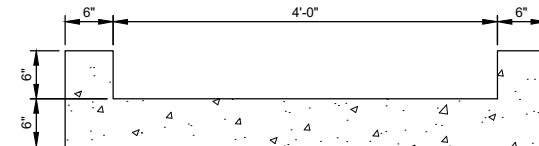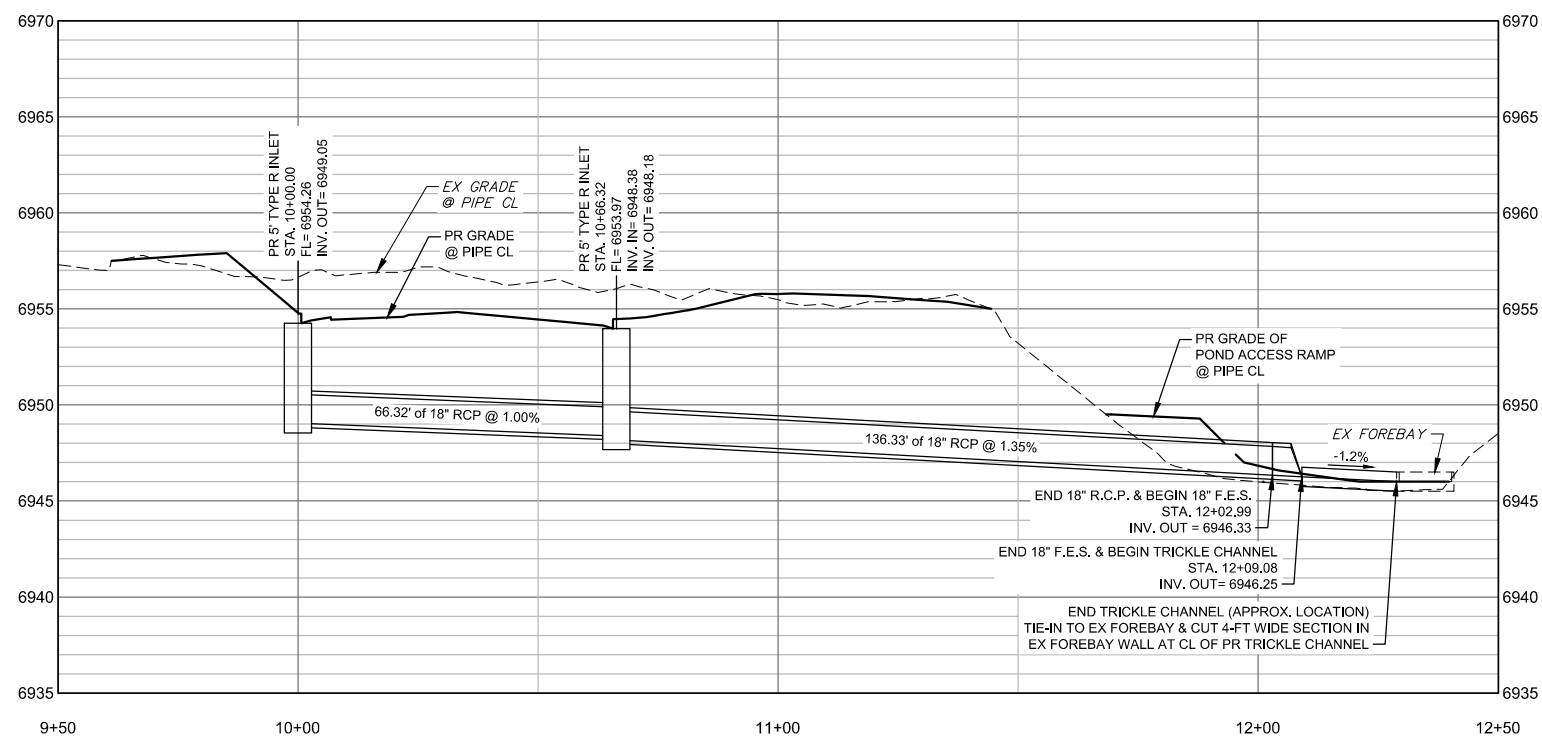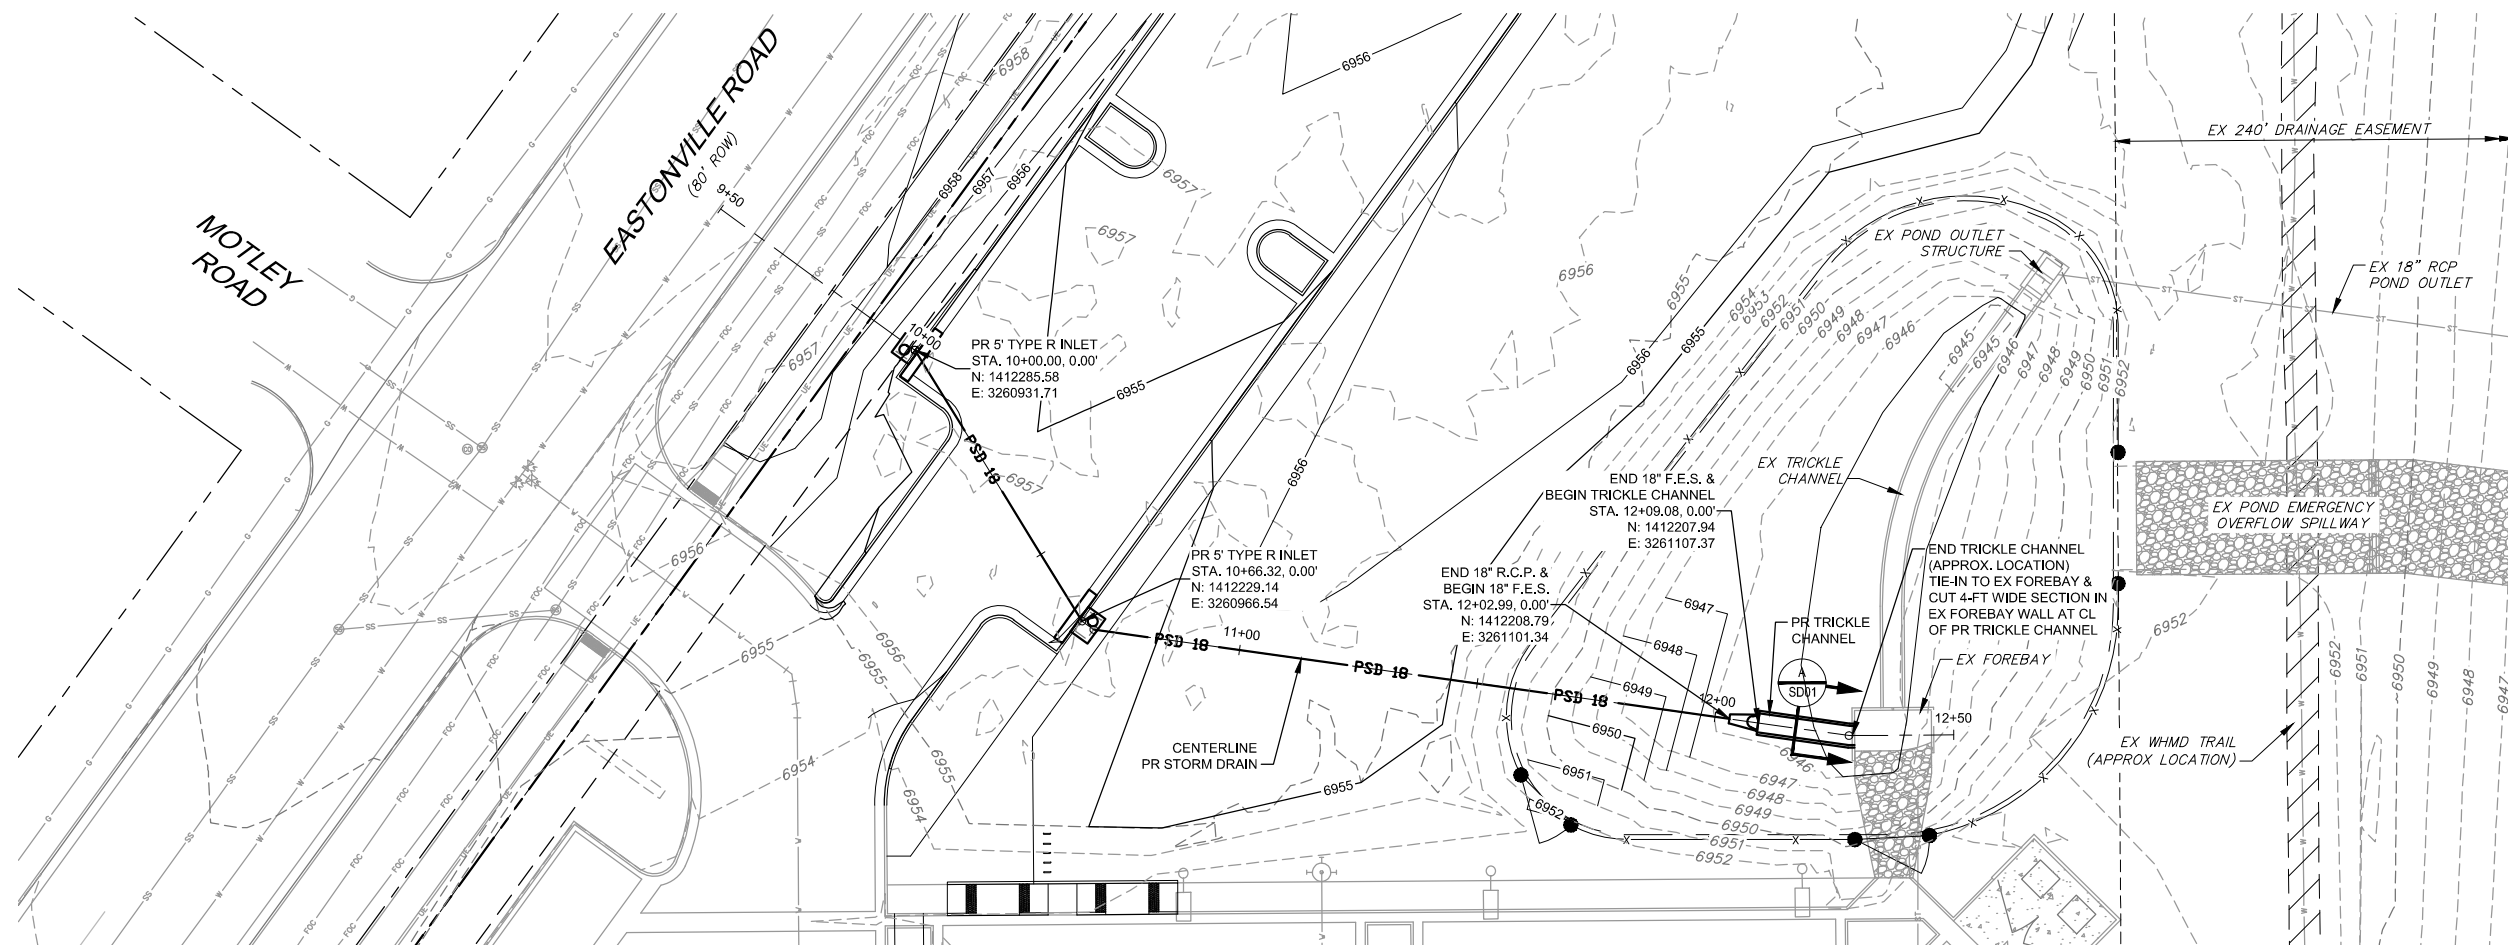

1 0 1 2
SCALE IN FEET
ORIGINAL SCALE


TRICKLE CHANNEL SECTION A



20 0 20 40
SCALE IN FEET
ORIGINAL SCALE

REFERENCE DRAWINGS			
X-995.002-MDG22X34			
X-995.002-PR-BASE_PH-2			
X-995.002-EX-BASE			
X-995.002-EX-BASE_PH-1			
X-995.002-EX-MAP			
X-995.002-PR-UTIL_PH-2			
No.	DATE	DESCRIPTION	BY
COMPUTER FILE MANAGEMENT			
FILE NAME: R:\20.995.002 (Liberty Tree Academy Additional Svcs)\Dwg\Sheets\CDs\SD01_PH2.dwg			
CTB FILE: ---			
PLOT DATE: 6/25/2020 11:09 AM			
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.			

SHEET KEY



PREPARED FOR:

LIBERTY TREE
ACADEMY

PREPARED BY:

Matrix
Excellence by Design

PRELIMINARY

THIS DRAWING HAS NOT
BEEN APPROVED BY
GOVERNING AGENCIES AND
IS SUBJECT TO CHANGE

FOR AND ON BEHALF OF
MATRIX DESIGN GROUP, INC.
PROJECT No. 20.995.002

LIBERTY TREE ACADEMY - PHASE 2

TOWN OF PEYTON, EL PASO COUNTY
CONSTRUCTION DOCUMENTS, PCD FILE NO. PPR2018

STORM DRAIN PLAN & PROFILE

DESIGNED BY: ACR	SCALE: HORIZ 1" = 20'	DATE ISSUED: JUNE 2020	DRAWING No. SD01
CHECKED BY: DRK	VERT. 1" = 5'	SHEET 8 OF 19	

MHFD-Detention, Version 4.02 (February 2020)

Basin ID: Extended Detention Basin



Zone 1 Volume (WQCV) =	0.092	acre-feet
Zone 2 Volume (EURV - Zone 1) =	0.262	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.168	acre-feet
Total Detention Basin Volume =	0.522	acre-feet


6/25/2020, 8:45 AM

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-DETENTION, Version 4.02 (February 2020)

Project: **Liberty Tree - Phase II Improvements**

Basin ID: **Extended Detention Basin**

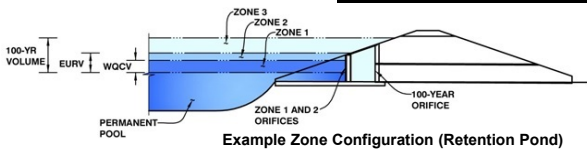

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	2.44	0.092	Orifice Plate
Zone 2 (EURV)	4.37	0.262	Orifice Plate
Zone 3 (100-year)	5.28	0.168	Weir&Pipe (Restrict)
Total (all zones)		0.522	

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth = ft (distance below the filtration media surface)
Underdrain Orifice Diameter = inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = ft²
Underdrain Orifice Centroid = feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = inches
Orifice Plate: Orifice Area per Row = inches

Calculated Parameters for Plate

WQ Orifice Area per Row = ft²
Elliptical Half-Width = feet
Elliptical Slot Centroid = feet
Elliptical Slot Area = ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.21	2.41					
Orifice Area (sq. inches)	0.44	0.44	1.62					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice = Not Selected Not Selected ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter = Not Selected Not Selected inches

Calculated Parameters for Vertical Orifice

Vertical Orifice Area = Not Selected Not Selected ft²
Vertical Orifice Centroid = Not Selected Not Selected feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir (and No Outlet Pipe))

Overflow Weir Front Edge Height, H_o = Zone 3 Weir Not Selected ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length = 4.00 N/A feet
Overflow Weir Grate Slope = 3.66 N/A H:V
Horiz. Length of Weir Sides = 3.00 N/A feet
Overflow Grate Open Area % = 70% N/A %, grate open area/total area
Debris Clogging % = 50% N/A %

Height of Grate Upper Edge, H_u = 4.28 N/A feet
Overflow Weir Slope Length = 3.11 N/A feet
Grate Open Area / 100-yr Orifice Area = 88.83 N/A
Overflow Grate Open Area w/o Debris = 8.71 N/A ft²
Overflow Grate Open Area w/ Debris = 4.35 N/A ft²

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe = Zone 3 Restrictor Not Selected ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter = 18.00 N/A inches
Restrictor Plate Height Above Pipe Invert = 1.88 Not Selected inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

Outlet Orifice Area = 0.10 N/A ft²
Outlet Orifice Centroid = 0.09 N/A feet
Half-Central Angle of Restrictor Plate on Pipe = 0.66 N/A radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = 7.02 Not Selected ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = 8.82 Not Selected feet
Spillway End Slopes = 4.00 Not Selected H:V
Freeboard above Max Water Surface = 0.40 Not Selected feet

Calculated Parameters for Spillway

Spillway Design Flow Depth = 0.50 Not Selected feet
Stage at Top of Freeboard = 7.92 Not Selected feet
Basin Area at Top of Freeboard = 0.29 Not Selected acres
Basin Volume at Top of Freeboard = 1.07 Not Selected acre-ft




Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.14
One-Hour Rainfall Depth (in) =	0.092	0.354	0.248	0.324	0.385	0.463	0.540	0.632	0.835
CUHP Runoff Volume (acre-ft) =	N/A	N/A	0.248	0.324	0.385	0.463	0.540	0.632	0.835
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	0.03	0.06	0.08	0.75	1.51	2.46	4.40
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A							
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.01	0.01	0.02	0.18	0.36	0.59	1.06
Peak Inflow Q (cfs) =	N/A	N/A	4.11	5.33	6.22	7.87	9.30	11.22	14.83
Peak Outflow Q (cfs) =	0.05	1.23	0.27	0.96	1.18	1.22	1.25	1.29	1.36
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	16.01	14.31	1.62	0.83	0.53	0.31
Structure Controlling Flow =	Plate	Outlet Plate 1	Overflow Weir 1	Overflow Weir 1	Outlet Plate 1	Outlet Plate 1	Outlet Plate 1	Outlet Plate 1	Outlet Plate 1
Max Velocity through Grate 1 (fps) =	N/A	0.13	0.02	0.1	0.1	0.1	0.1	0.1	0.1
Max Velocity through Grate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	39	53	56	55	54	53	52	51	50
Time to Drain 99% of Inflow Volume (hours) =	40	59	61	60	60	60	60	60	60
Maximum Ponding Depth (ft) =	2.44	4.37	3.54	3.69	3.84	4.27	4.62	5.10	5.95
Area at Maximum Ponding Depth (acres) =	0.10	0.17	0.14	0.14	0.15	0.16	0.18	0.20	0.23
Maximum Volume Stored (acre-ft) =	0.093	0.355	0.227	0.247	0.271	0.337	0.398	0.488	0.666

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.00 (December 2019)

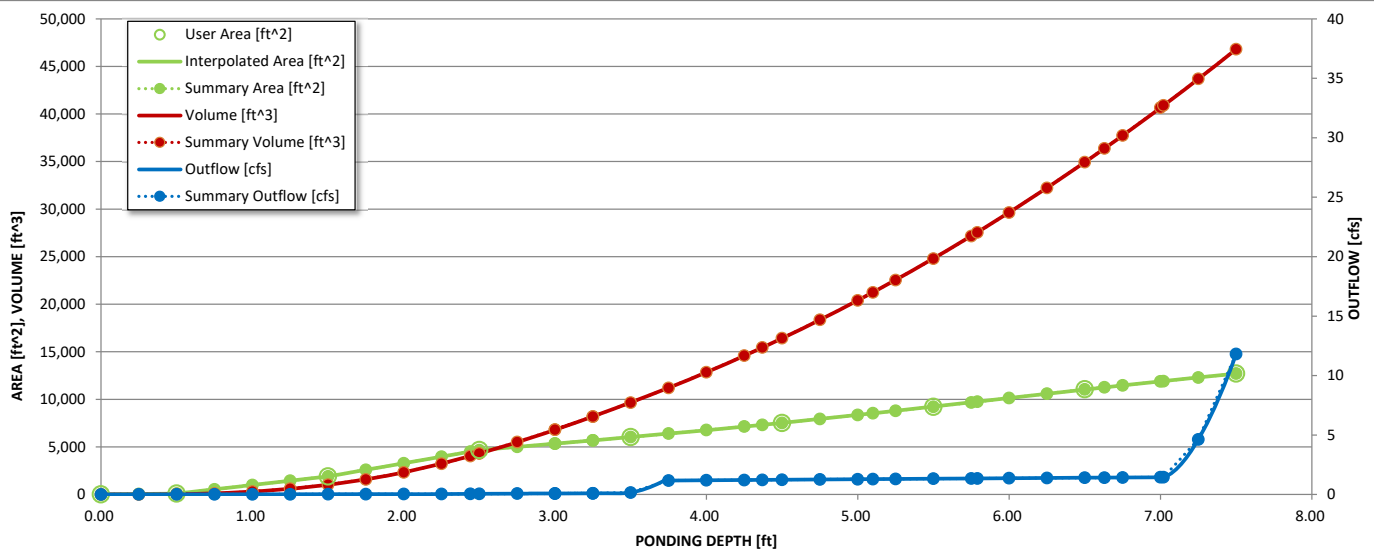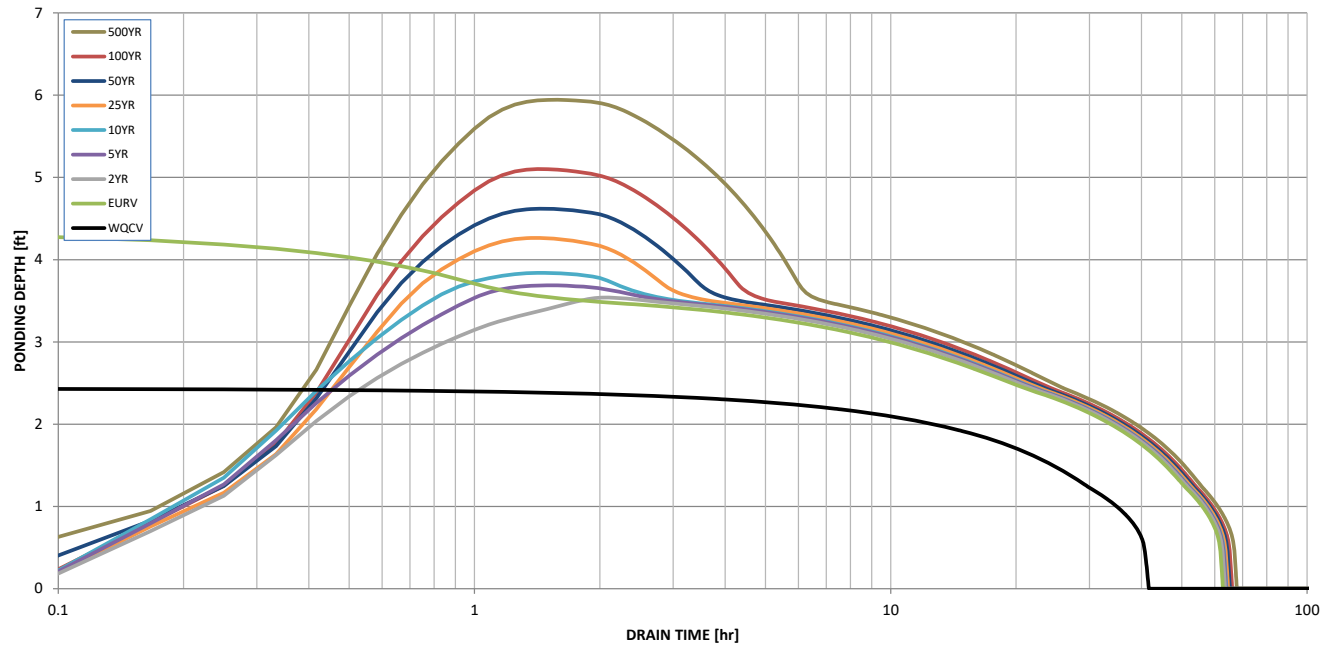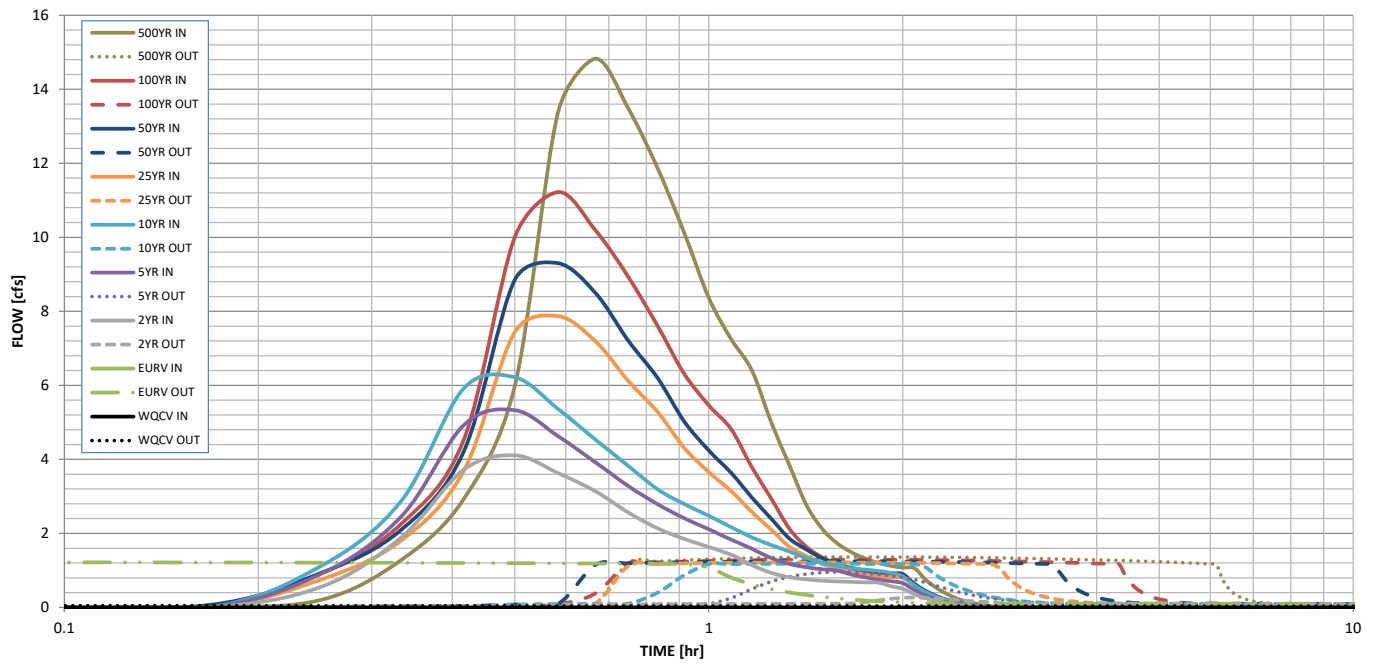

DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename:

Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
Time Interval	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.06	0.01	0.20
	0:15:00	0.00	0.00	0.55	0.90	1.12	0.75	0.93	0.91	1.29
	0:20:00	0.00	0.00	1.90	2.46	2.88	1.81	2.10	2.26	2.93
	0:25:00	0.00	0.00	3.72	4.92	5.92	3.69	4.21	4.53	5.98
	0:30:00	0.00	0.00	4.11	5.33	6.22	7.44	8.85	10.00	13.37
	0:35:00	0.00	0.00	3.63	4.63	5.37	7.87	9.30	11.22	14.83
	0:40:00	0.00	0.00	3.14	3.93	4.54	7.20	8.50	10.20	13.49
	0:45:00	0.00	0.00	2.57	3.28	3.82	6.12	7.21	8.94	11.86
	0:50:00	0.00	0.00	2.13	2.79	3.19	5.28	6.19	7.60	10.11
	0:55:00	0.00	0.00	1.85	2.41	2.79	4.31	5.02	6.31	8.37
	1:00:00	0.00	0.00	1.63	2.11	2.48	3.66	4.24	5.46	7.25
	1:05:00	0.00	0.00	1.43	1.83	2.17	3.14	3.63	4.81	6.41
	1:10:00	0.00	0.00	1.15	1.59	1.89	2.58	2.97	3.79	5.00
	1:15:00	0.00	0.00	0.94	1.34	1.69	2.10	2.40	2.95	3.85
	1:20:00	0.00	0.00	0.82	1.18	1.51	1.64	1.86	2.13	2.77
	1:25:00	0.00	0.00	0.76	1.09	1.33	1.39	1.57	1.64	2.12
	1:30:00	0.00	0.00	0.72	1.03	1.21	1.18	1.33	1.35	1.73
	1:35:00	0.00	0.00	0.70	0.99	1.12	1.04	1.18	1.17	1.49
	1:40:00	0.00	0.00	0.69	0.89	1.06	0.95	1.07	1.04	1.32
	1:45:00	0.00	0.00	0.68	0.81	1.02	0.89	1.00	0.96	1.21
	1:50:00	0.00	0.00	0.67	0.75	0.99	0.85	0.95	0.90	1.13
	1:55:00	0.00	0.00	0.58	0.71	0.94	0.82	0.92	0.87	1.08
	2:00:00	0.00	0.00	0.51	0.66	0.84	0.80	0.90	0.85	1.06
	2:05:00	0.00	0.00	0.36	0.47	0.60	0.57	0.64	0.61	0.76
	2:10:00	0.00	0.00	0.26	0.33	0.42	0.41	0.46	0.43	0.54
	2:15:00	0.00	0.00	0.18	0.23	0.30	0.28	0.32	0.30	0.38
	2:20:00	0.00	0.00	0.12	0.15	0.20	0.19	0.22	0.21	0.26
	2:25:00	0.00	0.00	0.08	0.10	0.13	0.13	0.14	0.14	0.17
	2:30:00	0.00	0.00	0.05	0.07	0.09	0.09	0.10	0.09	0.11
	2:35:00	0.00	0.00	0.03	0.04	0.05	0.05	0.06	0.05	0.07
	2:40:00	0.00	0.00	0.01	0.02	0.02	0.03	0.03	0.03	0.03
	2:45:00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01
	2:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.02 (February 2020)

Summary Stage-Area-Volume-Discharge Relationships

The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

Stage - Storage Description	Stage [ft]	Area [ft ²]	Area [acres]	Volume [ft ³]	Volume [ac-ft]	Total Outflow [cfs]
Micropool=6944.5	0.00	12	0.000	0	0.000	0.00
6944.75	0.25	53	0.001	8	0.000	0.01
6945	0.50	94	0.002	27	0.001	0.01
6945.25	0.75	546	0.013	107	0.002	0.01
6945.5	1.00	997	0.023	299	0.007	0.01
6945.75	1.25	1,448	0.033	605	0.014	0.02
6946	1.50	1,900	0.044	1,024	0.023	0.03
6946.25	1.75	2,591	0.059	1,585	0.036	0.03
6946.5	2.00	3,283	0.075	2,319	0.053	0.03
6946.75	2.25	3,974	0.091	3,226	0.074	0.04
WQCV=6946.94	2.44	4,500	0.103	4,031	0.093	0.05
6947	2.50	4,666	0.107	4,306	0.099	0.06
6947.25	2.75	5,007	0.115	5,515	0.127	0.07
6947.5	3.00	5,349	0.123	6,810	0.156	0.09
6947.75	3.25	5,690	0.131	8,190	0.188	0.10
6947.5	3.00	5,349	0.123	6,810	0.156	0.09
6947.75	3.25	5,690	0.131	8,190	0.188	0.10
6948	3.50	6,031	0.138	9,655	0.222	0.16
6948.25	3.75	6,402	0.147	11,209	0.257	1.17
6948.5	4.00	6,774	0.155	12,856	0.295	1.19
6948.75	4.25	7,145	0.164	14,596	0.335	1.22
EURV=6948.87	4.37	7,323	0.168	15,464	0.355	1.23
6949	4.50	7,516	0.173	16,428	0.377	1.24
6949.25	4.75	7,941	0.182	18,361	0.421	1.26
6949.5	5.00	8,366	0.192	20,399	0.468	1.28
100 YR=6949.6	5.10	8,536	0.196	21,244	0.488	1.29
6949.75	5.25	8,792	0.202	22,544	0.518	1.31
6950	5.50	9,217	0.212	24,795	0.569	1.33
6950.25	5.75	9,677	0.222	27,156	0.623	1.35
100 YR Clogged=6950.29	5.79	9,751	0.224	27,545	0.632	1.35
6950.5	6.00	10,137	0.233	29,633	0.680	1.37
6950.75	6.25	10,597	0.243	32,225	0.740	1.39
6951	6.50	11,057	0.254	34,932	0.802	1.41
500 YR Clogged=6951.13	6.63	11,272	0.259	36,383	0.835	1.42
6951.25	6.75	11,470	0.263	37,748	0.867	1.43
6951.5	7.00	11,883	0.273	40,667	0.934	1.45
AB Weir Crest El.=6951.52	7.02	11,916	0.274	40,905	0.939	1.45
6951.75	7.25	12,296	0.282	43,689	1.003	4.63
6952	7.50	12,709	0.292	46,815	1.075	11.82

For best results, include the stages of all grade slope changes (e.g. ISV and Floor) from the S-A-V table on Sheet 'Basin'.

Also include the inverts of all outlets (e.g. vertical orifice, overflow grate, and spillway, where applicable).

Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

Designer: MAS
 Company: Matrix
 Date: June 25, 2020
 Project: Liberty Tree Academy
 Location: Liberty Tree EDB Forebay

1. Basin Storage Volume

- A) Effective Imperviousness of Tributary Area, I_a
- B) Tributary Area's Imperviousness Ratio ($i = I_a / 100$)
- C) Contributing Watershed Area
- D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm
- E) Design Concept
(Select EURV when also designing for flood control)
- F) Design Volume (WQCV) Based on 40-hour Drain Time
($V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i) / 12 * Area)$)
- G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume
($V_{WQCV\ OTHER} = (d_s * (V_{DESIGN} / 0.43))$)
- H) User Input of Water Quality Capture Volume (WQCV) Design Volume
(Only if a different WQCV Design Volume is desired)
- I) NRCS Hydrologic Soil Groups of Tributary Watershed
 i) Percentage of Watershed consisting of Type A Soils
 ii) Percentage of Watershed consisting of Type B Soils
 iii) Percentage of Watershed consisting of Type C/D Soils
- J) Excess Urban Runoff Volume (EURV) Design Volume
 For HSG A: $EURV_A = 1.68 * i^{1.28}$
 For HSG B: $EURV_B = 1.36 * i^{1.08}$
 For HSG C/D: $EURV_{C/D} = 1.20 * i^{1.08}$
- K) User Input of Excess Urban Runoff Volume (EURV) Design Volume
(Only if a different EURV Design Volume is desired)

$I_a =$ 67.9 %

$i =$ 0.679

Area = 4.150 ac

$d_s =$ in

Choose One

- ☐ Water Quality Capture Volume (WQCV)
☒ Excess Urban Runoff Volume (EURV)

$V_{DESIGN} =$ 0.092 ac-ft

$V_{DESIGN\ OTHER} =$ ac-ft

$V_{DESIGN\ USER} =$ ac-ft

HSG _A = %

HSG _B = %

HSG _{C/D} = %

$EURV_{DESIGN} =$ ac-ft

$EURV_{DESIGN\ USER} =$ ac-ft

2. Basin Shape: Length to Width Ratio

(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

L : W = 2.0 : 1

3. Basin Side Slopes

- A) Basin Maximum Side Slopes
(Horizontal distance per unit vertical, 4:1 or flatter preferred)

Z = 4.00 ft / ft

4. Inlet

- A) Describe means of providing energy dissipation at concentrated inflow locations:

5. Forebay

- A) Minimum Forebay Volume
($V_{MIN} =$ 2% of the WQCV)

- B) Actual Forebay Volume

- C) Forebay Depth
($D_F =$ 18 inch maximum)

- D) Forebay Discharge

- i) Undetained 100-year Peak Discharge

- ii) Forebay Discharge Design Flow
($Q_F = 0.02 * Q_{100}$)

- E) Forebay Discharge Design

- F) Discharge Pipe Size (minimum 8-inches)

- G) Rectangular Notch Width

$V_{MIN} =$ 0.002 ac-ft

$V_F =$ 0.002 ac-ft

$D_F =$ 6.0 in

$Q_{100} =$ 20.20 cfs

$Q_F =$ 0.40 cfs

Choose One

- ☐ Berm With Pipe
☒ Wall with Rect. Notch
☐ Wall with V-Notch Weir


Flow too small for berm w/ pipe

Calculated $D_P =$ in


Calculated $W_N =$ 5.3 in

Cross Section for Trickle Channel

Project Description	
Friction Method	Manning
	Formula
Solve For	Normal Depth
Input Data	
Roughness Coefficient	0.013
Channel Slope	0.005 ft/ft
Normal Depth	0.9 in
Bottom Width	4.00 ft
Discharge	0.40 cfs



V: 1
H: 1



Spillway Capacity Calculation

Spillway Section

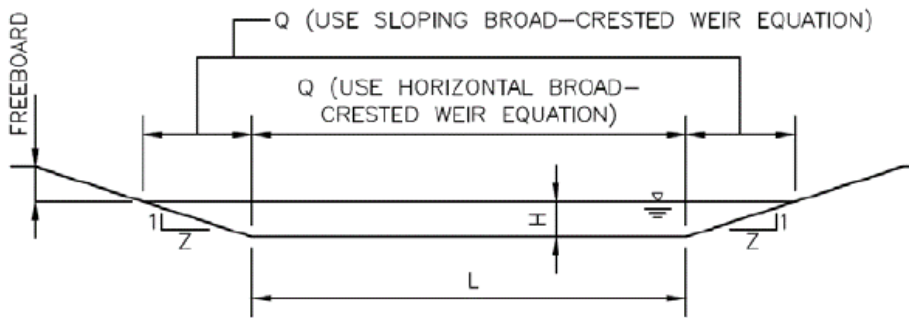


Fig. 12-20 of UDFCD V1

Horizontal Broad Crested Weir: $Q = C_{BCW} L H^{1.5}$ Eq. 12-20 of UDFCD V1

Sloping Broad-Crested Weir: $Q = \left(\frac{2}{5}\right) C_{BCW} Z H^{2.5}$ Eq. 12-21 of UDFCD V1

100-yr Undetained Runoff	Q =	20.11	cfs
Side slope 1 (horizontal: vertical)	Z1 =	4.00	
Side slope 2 (horizontal: vertical)	Z2 =	4.00	
Broad Crested Weir Coefficient	C_{BCW} =	3.0	
Head above Weir Crest	H =	0.71	ft

Total Required Length
$$L = \frac{Q - \left(\frac{2}{5}\right) C_{BCW} Z_1 Z_1 H^{2.5} - \left(\frac{2}{5}\right) C_{BCW} Z_2 Z_2 H^{2.5}}{C H^{1.5}}$$

Bottom Length of Weir	L _{bottom} =	8.82	ft
Water spread at Q100	L _{top} =	14.53	
Unit Discharge	q =	1.38	cfs/ft




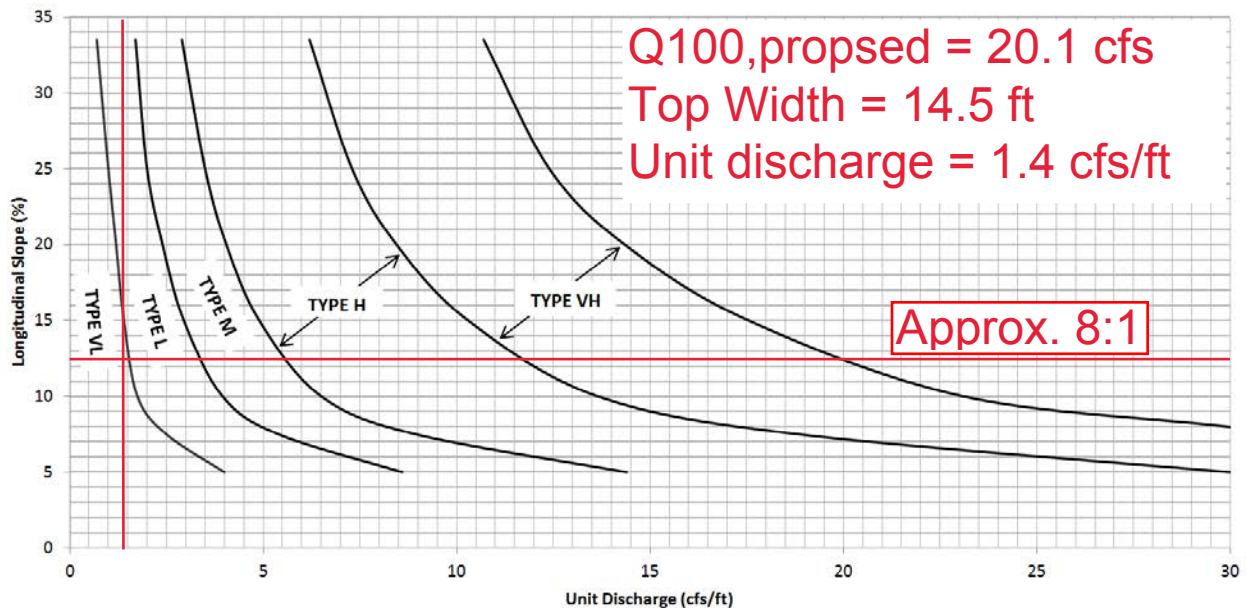


Figure 12-21. Embankment protection details and rock sizing chart (adapted from Arapahoe County)

18" RCP Outfall Protection

	Q (cfs)	Dc (ft)	Yt/Dt	Yt	$Q/D^{1.5}$	Selected Riprap
Basin B	6.30	1.5	0.4	0.6	3.43	L

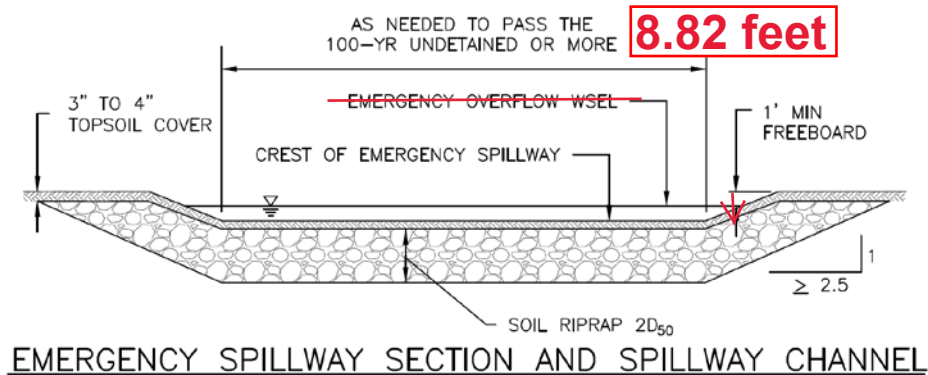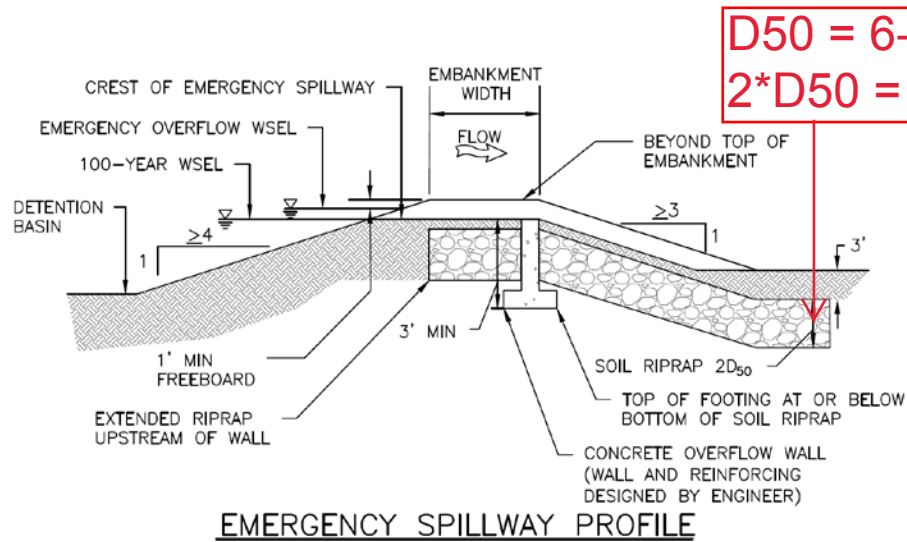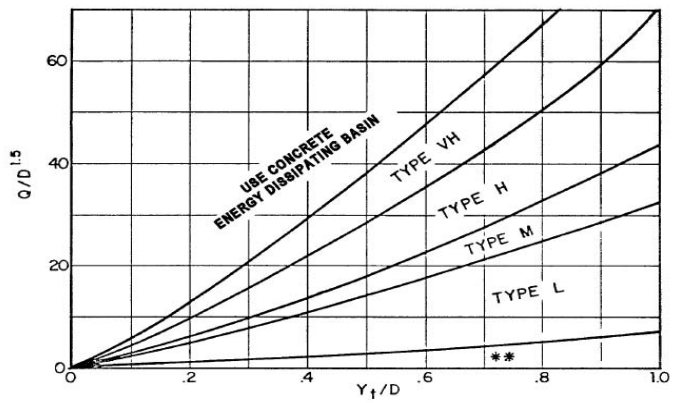

Use D_0 instead of D whenever flow is supercritical in the barrel.
** Use Type L for a distance of $3D$ downstream.

Figure 9-38. Riprap erosion protection at circular conduit outlet (valid for $Q/D^{1.5} \leq 6.0$)

SOIL RIPRAP SIZING

Mile High Flood District
 Volume I - August 2018
 Chapter 8 - Open Channels
 8.1.2 - Steep Slope Conditions

	= Calculated Value
	= Manually Entered Value
	= Referenced from Flowmaster
	= Other / Published Value

USACE Steep Slope Riprap Equation

U.S. Army Corps of Engineers. 1994. Hydraulic Design of Flood Control Channels.
 EM 1110-2-1601, Change 1. June 30.
 Steep Slope Method (Recommended for slopes from 2% to 20%)

$$S = 0.25 \text{ Channel Slope (ft/ft)}$$

$$q = \text{Peak Unit Discharge (cfs/ft)}$$

$$100\text{-Year} = 1.8$$

$$D_{50} = \text{Median Stone Size (ft)}$$

$$100\text{-Year} = 0.64 \text{ *Type L riprap, } D_{50} 0.75 \text{ ft to be used}$$

$$F_{fc} = 1.25$$

Flow Concentration Factor (1.25 recommended in EM 1601)

$$g = 32.2$$

Gravity (ft/s²)

$$F_{fc} \times q = \text{Peak Unit Discharge by Flow Concentration Factor (cfs/ft)}$$

$$100\text{-Year} = 2.30$$

$$D_{30} = \text{Rock Diameter for which 30% is smaller by mass (ft)}$$

$$100\text{-Year} = 0.50$$

$$D_{30} = \frac{1.95 S^{0.555} q^{2/3}}{g^{1/3}}$$

where

S = slope of bed

q = unit discharge

Eastonville Road Water Quality Calculation

Curb and Gutter / Street Capacity

Existing Gutter Capacity Determination

1. Calculate upstream runoff along the gutter line.

The gutter line on the southeast side of Eastonville extends from the proposed driveway to the north side of the Bennett Ranch drainageway crossing.



Google Streetview at the upstream end of the gutter line (north side of Bennett Ranch drainageway crossing).





Google Streetview at the upstream end of the gutter line (south side of Bennett Ranch drainageway crossing). Transition from block to 6 inch curb.

The roadway is crowned in the center with two 20 ft wide lanes plus 2 ft wide gutters on each side as per survey, aerial, and CDOT data. To determine the drainage area to the project driveway, the length was measured along the flow line from the driveway to the upstream end of the gutter line (960 ft). Tributary area is basin ER1 at DP ER1, and Basins ER1 and ER2 at DP ER2 at the southern end of the Liberty Tree site. In the existing condition includes the road, curb and gutter as well as some vegetated areas sloped towards the road. In the proposed condition the tributary area is the road, curb and gutter, landscaped area, and proposed sidewalk. Runoff was calculated using the Rational Method (see **Appendix B, Composite Runoff Coefficients**).

- Calculate maximum allowable flow in gutter based on El Paso criteria for minor arterials.

Gutter capacity was determined using the street capacity charts in Chapter 7 of DCM-V1-Update. The street is a minor arterial, however, the typical cross-section in Figure 7-5 for Collectors with Parking applies to this roadway (6" vertical curve, $d = 6"$, $T_{\max} = 22'$ (20' travel lane with 2' wide gutter)).

Figure 7-5. Street Capacity Charts Collector (with Parking)

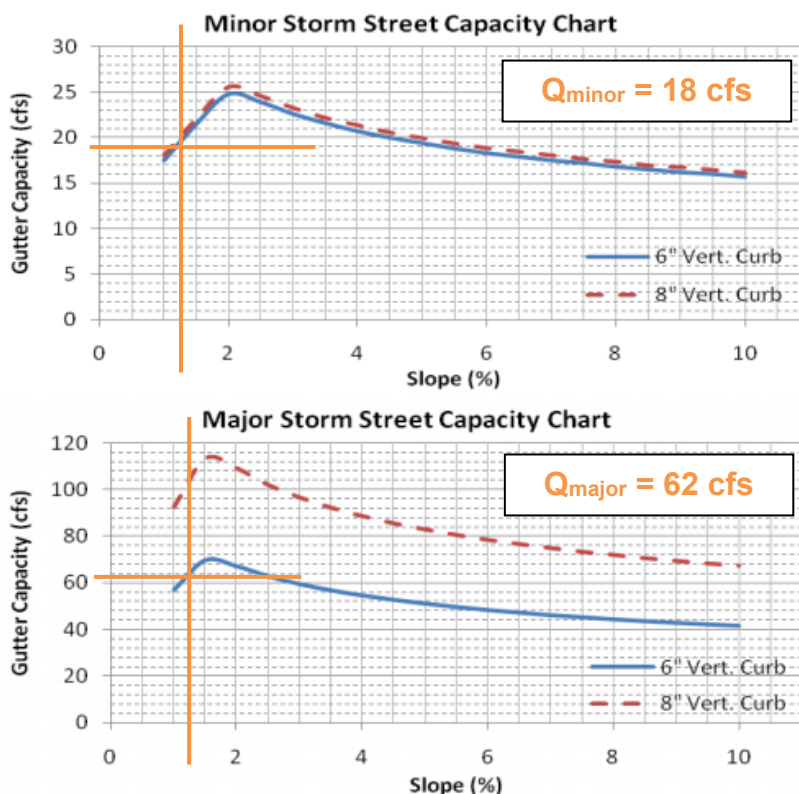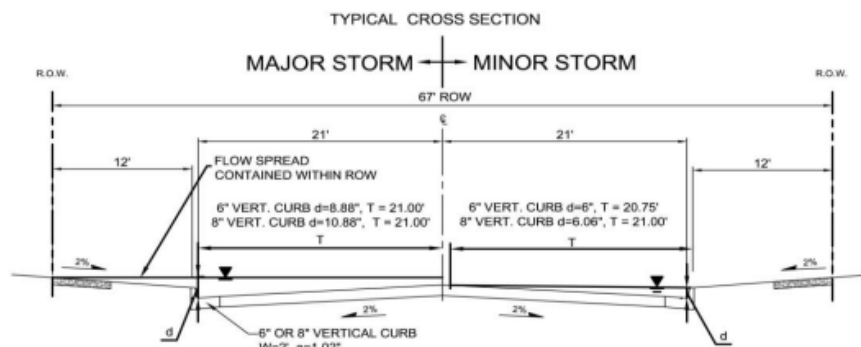

These charts shall only be used for the standard street sections as shown. The capacity shown is based on $\frac{1}{2}$ the street section as calculated by the UD-Inlet spreadsheets. Minor storm capacities are based on no crown overtopping, curb height or maximum allowable spread widths. Major storm capacities are based on flow being contained within the public right-of-way, including conveyance capacity behind the curb. The UDFCD Safety Reduction Factor was applied. An n_{STREET} of 0.016 and n_{BACK} of 0.020 was used. Calculations were done using UD-Inlet 3.00.xls, March, 2011.

Parameter	Value	Note
Flow spread, T (ft)	21	Length from crown to gutterline (based on CDOT lane width) plus 1 ft gutter width.
Longitudinal slope, S (ft/ft)	0.013	Measured from the 5958 to 5951 contour.
Manning's n, n	0.016	From Figure 7-5 of DCM-V1-Update.
Minor gutter capacity, Q (cfs)	18	Using Figure 7-5 of DCM-V1-Update.
5-year Q (cfs) @ DP ER2	2.8	From Proposed Conditions, Rational Calculations
Major gutter capacity, Q (cfs)	62	Using Figure 7-5 of DCM-V1-Update.
100-year Q (cfs) @ DP ER2	6.0	From Existing Conditions, Rational Calculations

As summarized in the table above, runoff in the minor and major event will be contained within the R.O.W. of Eastonville Road without entering the site.

3. Calculate maximum allowable flow in cross pan/driveway section.

The driveway section geometry was determined from El Paso County Detail SD 2-26 for Typical Cross Pan Layout Detail. Depth from the flowline of the cross pan to the crown of the road is 6.8 inches; the corresponding maximum allowable flow is 51.0 cfs, as shown in the following FlowMasterV8i calculation sheets. The minor and major events will be sufficiently to conveyed in the proposed cross pan along Eastonville Road without entering the site.

Cross Pan and Driveway Section

Project Description

Friction Method	Manning Formula
Solve For	Discharge

Input Data

Channel Slope	0.01300	ft/ft
Normal Depth	0.57	ft
Section Definitions		

Station (ft)	Elevation (ft)
-0+22	0.57
-0+02	0.17
0+00	0.00
0+06	0.17
0+36	0.76

Roughness Segment Definitions

Start Station	Ending Station	Roughness Coefficient
(-0+22, 0.57)	(-0+02, 0.17)	0.016
(-0+02, 0.17)	(0+06, 0.17)	0.013
(0+06, 0.17)	(0+36, 0.76)	0.016

Options

Current Roughness Weighted Method	Pavlovskii's Method
Open Channel Weighting Method	Pavlovskii's Method
Closed Channel Weighting Method	Pavlovskii's Method

Results

Discharge	50.95	ft ³ /s
Elevation Range	0.00 to 0.76 ft	
Flow Area	11.87	ft ²
Wetted Perimeter	48.02	ft
Hydraulic Radius	0.25	ft
Top Width	48.00	ft

Cross Pan and Driveway Section

Results

Normal Depth	0.57	ft
Critical Depth	0.65	ft
Critical Slope	0.00522	ft/ft
Velocity	4.29	ft/s
Velocity Head	0.29	ft
Specific Energy	0.85	ft
Froude Number	1.52	
Flow Type	Supercritical	

GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.57	ft
Critical Depth	0.65	ft
Channel Slope	0.01300	ft/ft
Critical Slope	0.00522	ft/ft

Cross Pan and Driveway Section


Project Description

Friction Method	Manning Formula
Solve For	Discharge

Input Data

Channel Slope	0.01300	ft/ft
Normal Depth	0.57	ft
Discharge	50.95	ft ³ /s

Cross Section Image

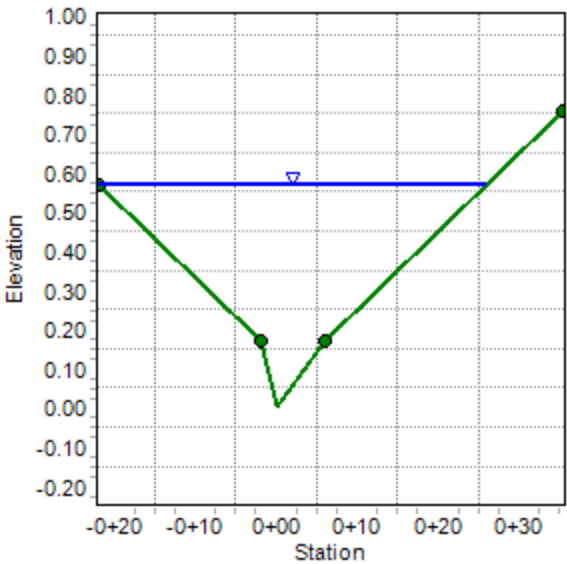

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Liberty Tree Academy

Inlet ID:

Parking Lot - 1' Gutter Vertical Catch Curb

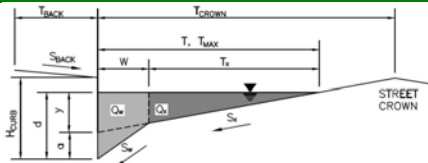**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

 $T_{BACK} = 20.0$ ft

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

 $S_{BACK} = 0.020$ ft/ft

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

 $n_{BACK} = 0.016$

Height of Curb at Gutter Flow Line

 $H_{CURB} = 6.00$ inches

Distance from Curb Face to Street Crown

 $T_{CROWN} = 30.0$ ft

Gutter Width

 $W = 1.00$ ft

Street Transverse Slope

 $S_x = 0.020$ ft/ft

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

 $S_w = 0.083$ ft/ft

Street Longitudinal Slope - Enter 0 for sump condition

 $S_o = 0.008$ ft/ft

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm

	Minor Storm	Major Storm	
$T_{MAX} =$	30.0	30.0	ft
$d_{MAX} =$	6.0	12.0	inches

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (leave blank for no)

☐ ☒ check = yes
MINOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
$Q_{allow} =$	16.9	143.0	cfs

MAJOR STORM Allowable Capacity is based on Depth Criterion

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Liberty Tree Academy

Inlet ID:

Parking Lot - 2' Gutter Vertical Catch Curb

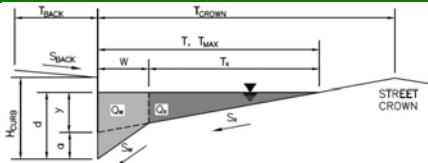**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

 $T_{BACK} = 20.0$ ft

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

 $S_{BACK} = 0.020$ ft/ft

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

 $n_{BACK} = 0.016$

Height of Curb at Gutter Flow Line

 $H_{CURB} = 6.00$ inches

Distance from Curb Face to Street Crown

 $T_{CROWN} = 30.0$ ft

Gutter Width

 $W = 2.00$ ft

Street Transverse Slope

 $S_x = 0.020$ ft/ft

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

 $S_w = 0.083$ ft/ft

Street Longitudinal Slope - Enter 0 for sump condition

 $S_o = 0.008$ ft/ft

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm

	Minor Storm	Major Storm	
$T_{MAX} =$	30.0	30.0	ft

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

	Minor Storm	Major Storm	
$d_{MAX} =$	6.0	12.0	inches

Allow Flow Depth at Street Crown (leave blank for no)

☐ ☒ check = yes
MINOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
$Q_{allow} =$	11.9	126.2	cfs

MAJOR STORM Allowable Capacity is based on Depth Criterion

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Storm System Capacity

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Liberty Tree - Phase II Improvements

Inlet ID:

B1

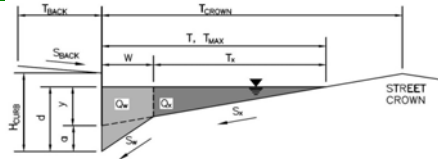**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} =$ 6.5 ft
 $S_{BACK} =$ 0.020 ft/ft
 $n_{BACK} =$ 0.016

$H_{CURB} =$ 6.00 inches
 $T_{CROWN} =$ 30.0 ft
 $W =$ 2.00 ft
 $S_x =$ 0.020 ft/ft
 $S_w =$ 0.083 ft/ft
 $S_o =$ 0.000 ft/ft
 $n_{STREET} =$ 0.016

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX} =$	30.0	30.0	ft
$d_{MAX} =$	3.6	4.6	inches


**MINOR STORM Allowable Capacity is based on Depth Criterion****MAJOR STORM Allowable Capacity is based on Depth Criterion**

$Q_{allow} =$

Minor Storm	Major Storm	
SUMP	SUMP	cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

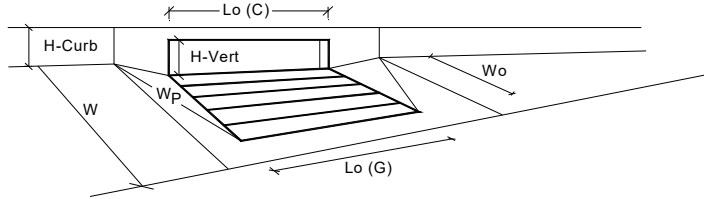

Design Information (Input)

Type of Inlet CDOT Type R Curb Opening
 Local Depression (additional to continuous gutter depression 'a' from above)
 Number of Unit Inlets (Grate or Curb Opening)
 Water Depth at Flowline (outside of local depression)

Grate Information

Length of a Unit Grate
 Width of a Unit Grate
 Area Opening Ratio for a Grate (typical values 0.15-0.90)
 Clogging Factor for a Single Grate (typical value 0.50 - 0.70)
 Grate Weir Coefficient (typical value 2.15 - 3.60)
 Grate Orifice Coefficient (typical value 0.60 - 0.80)

Curb Opening Information

Length of a Unit Curb Opening
 Height of Vertical Curb Opening in Inches
 Height of Curb Orifice Throat in Inches
 Angle of Throat (see USDCM Figure ST-5)
 Side Width for Depression Pan (typically the gutter width of 2 feet)
 Clogging Factor for a Single Curb Opening (typical value 0.10)
 Curb Opening Weir Coefficient (typical value 2.3-3.7)
 Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)

Low Head Performance Reduction (Calculated)

Depth for Grate Midwidth
 Depth for Curb Opening Weir Equation
 Combination Inlet Performance Reduction Factor for Long Inlets
 Curb Opening Performance Reduction Factor for Long Inlets
 Grated Inlet Performance Reduction Factor for Long Inlets

Total Inlet Interception Capacity (assumes clogged condition)

Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)

	MINOR	MAJOR	
Type =	CDOT Type R Curb Opening		
a_{local} =	3.00	3.00	inches
No =	1	1	
Ponding Depth =	3.6	4.6	inches
	MINOR	MAJOR	Override Depths
L_o (G) =	N/A	N/A	
W_o =	N/A	N/A	feet
A_{ratio} =	N/A	N/A	
C_r (G) =	N/A	N/A	
C_w (G) =	N/A	N/A	
C_o (G) =	N/A	N/A	
	MINOR	MAJOR	
L_o (C) =	5.00	5.00	feet
H_{vert} =	6.00	6.00	inches
H_{throat} =	6.00	6.00	inches
Theta =	63.40	63.40	degrees
W_p =	2.00	2.00	feet
C_r (C) =	0.10	0.10	
C_w (C) =	3.60	3.60	
C_o (C) =	0.67	0.67	
	MINOR	MAJOR	
d_{Grate} =	N/A	N/A	ft
d_{Curb} =	0.13	0.22	ft
$RF_{Combination}$ =	0.46	0.59	
RF_{Curb} =	1.00	1.00	
RF_{Grate} =	N/A	N/A	
	MINOR	MAJOR	
Q_a =	1.4	2.8	cfs
$Q_{PEAK REQUIRED}$ =	1.3	2.8	cfs

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)


(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

Project:

Liberty Tree - Phase II Improvements

Inlet ID:

B2

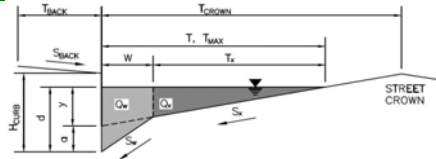**Gutter Geometry (Enter data in the blue cells)**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Check boxes are not applicable in SUMP conditions

MINOR STORM Allowable Capacity is based on Depth Criterion**MAJOR STORM Allowable Capacity is based on Depth Criterion**

$T_{BACK} =$ 6.5 ft
 $S_{BACK} =$ 0.020 ft/ft
 $n_{BACK} =$ 0.016

$H_{CURB} =$ 6.00 inches
 $T_{CROWN} =$ 30.0 ft
 $W =$ 2.00 ft
 $S_x =$ 0.020 ft/ft
 $S_w =$ 0.083 ft/ft
 $S_o =$ 0.000 ft/ft
 $n_{STREET} =$ 0.016

	Minor Storm	Major Storm	
$T_{MAX} =$	30.0	30.0	ft
$d_{MAX} =$	4.0	5.0	inches




$Q_{allow} =$

Minor Storm	Major Storm	
SUMP	SUMP	cfs

INLET IN A SUMP OR SAG LOCATION

Version 4.05 Released March 2017

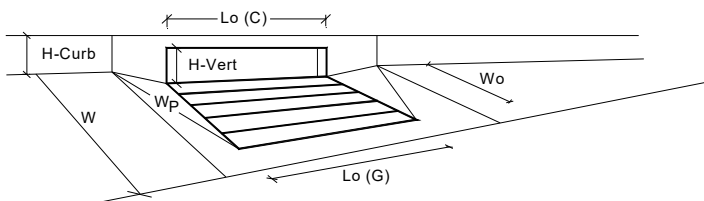

Design Information (Input)

Type of Inlet
 Local Depression (additional to continuous gutter depression 'a' from above)
 Number of Unit Inlets (Grate or Curb Opening)
 Water Depth at Flowline (outside of local depression)

Grate Information

Length of a Unit Grate
 Width of a Unit Grate
 Area Opening Ratio for a Grate (typical values 0.15-0.90)
 Clogging Factor for a Single Grate (typical value 0.50 - 0.70)
 Grate Weir Coefficient (typical value 2.15 - 3.60)
 Grate Orifice Coefficient (typical value 0.60 - 0.80)

Curb Opening Information

Length of a Unit Curb Opening
 Height of Vertical Curb Opening in Inches
 Height of Curb Orifice Throat in Inches
 Angle of Throat (see USDCM Figure ST-5)
 Side Width for Depression Pan (typically the gutter width of 2 feet)
 Clogging Factor for a Single Curb Opening (typical value 0.10)
 Curb Opening Weir Coefficient (typical value 2.3-3.7)
 Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)

Low Head Performance Reduction (Calculated)


Depth for Grate Midwidth
 Depth for Curb Opening Weir Equation
 Combination Inlet Performance Reduction Factor for Long Inlets
 Curb Opening Performance Reduction Factor for Long Inlets
 Grated Inlet Performance Reduction Factor for Long Inlets

Total Inlet Interception Capacity (assumes clogged condition)

Inlet Capacity IS GOOD for Minor and Major Storms(>Q PEAK)

	MINOR	MAJOR	
Type =	CDOT Type R Curb Opening		
a _{local} =	3.00	3.00	inches
No =	1	1	
Ponding Depth =	4.0	5.0	inches
	MINOR	MAJOR	Override Depths
L _o (G) =	N/A	N/A	
W _o =	N/A	N/A	feet
A _{ratio} =	N/A	N/A	
C _r (G) =	N/A	N/A	
C _w (G) =	N/A	N/A	
C _o (G) =	N/A	N/A	
	MINOR	MAJOR	
L _o (C) =	5.00	5.00	feet
H _{vert} =	6.00	6.00	inches
H _{throat} =	6.00	6.00	inches
Theta =	63.40	63.40	degrees
W _p =	2.00	2.00	feet
C _r (C) =	0.10	0.10	
C _w (C) =	3.60	3.60	
C _o (C) =	0.67	0.67	
	MINOR	MAJOR	
d _{Grate} =	N/A	N/A	ft
d _{Curb} =	0.17	0.25	ft
RF _{Combination} =	0.52	0.65	
RF _{Curb} =	1.00	1.00	
RF _{Grate} =	N/A	N/A	
	MINOR	MAJOR	
Q _a =	2.0	3.6	cfs
Q _{PEAK REQUIRED} =	1.9	3.5	cfs

Hydraflow Storm Sewers Extension for Autodesk® AutoCAD® Civil 3D® Plan

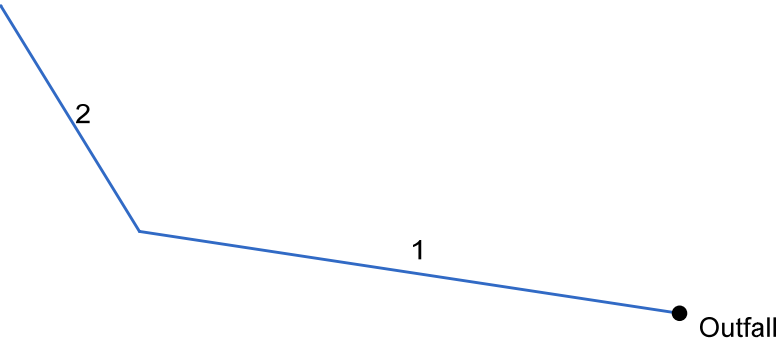


Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line Size (in)	Line shape	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line Slope (%)	HGL Down (ft)	HGL Up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns Line No.	Junction Type
1	Pipe - (2)	6.30	18	Cir	136.000	6946.33	6948.18	1.360	6949.60*	6950.09*	0.16	6950.25	End	None
2	Pipe - (1)	2.77	18	Cir	66.000	6948.38	6949.05	1.015	6950.25	6950.28	0.05	6950.33	1	None

Storm Sewer Profile

Proj. file: 100-YR STORM.stm

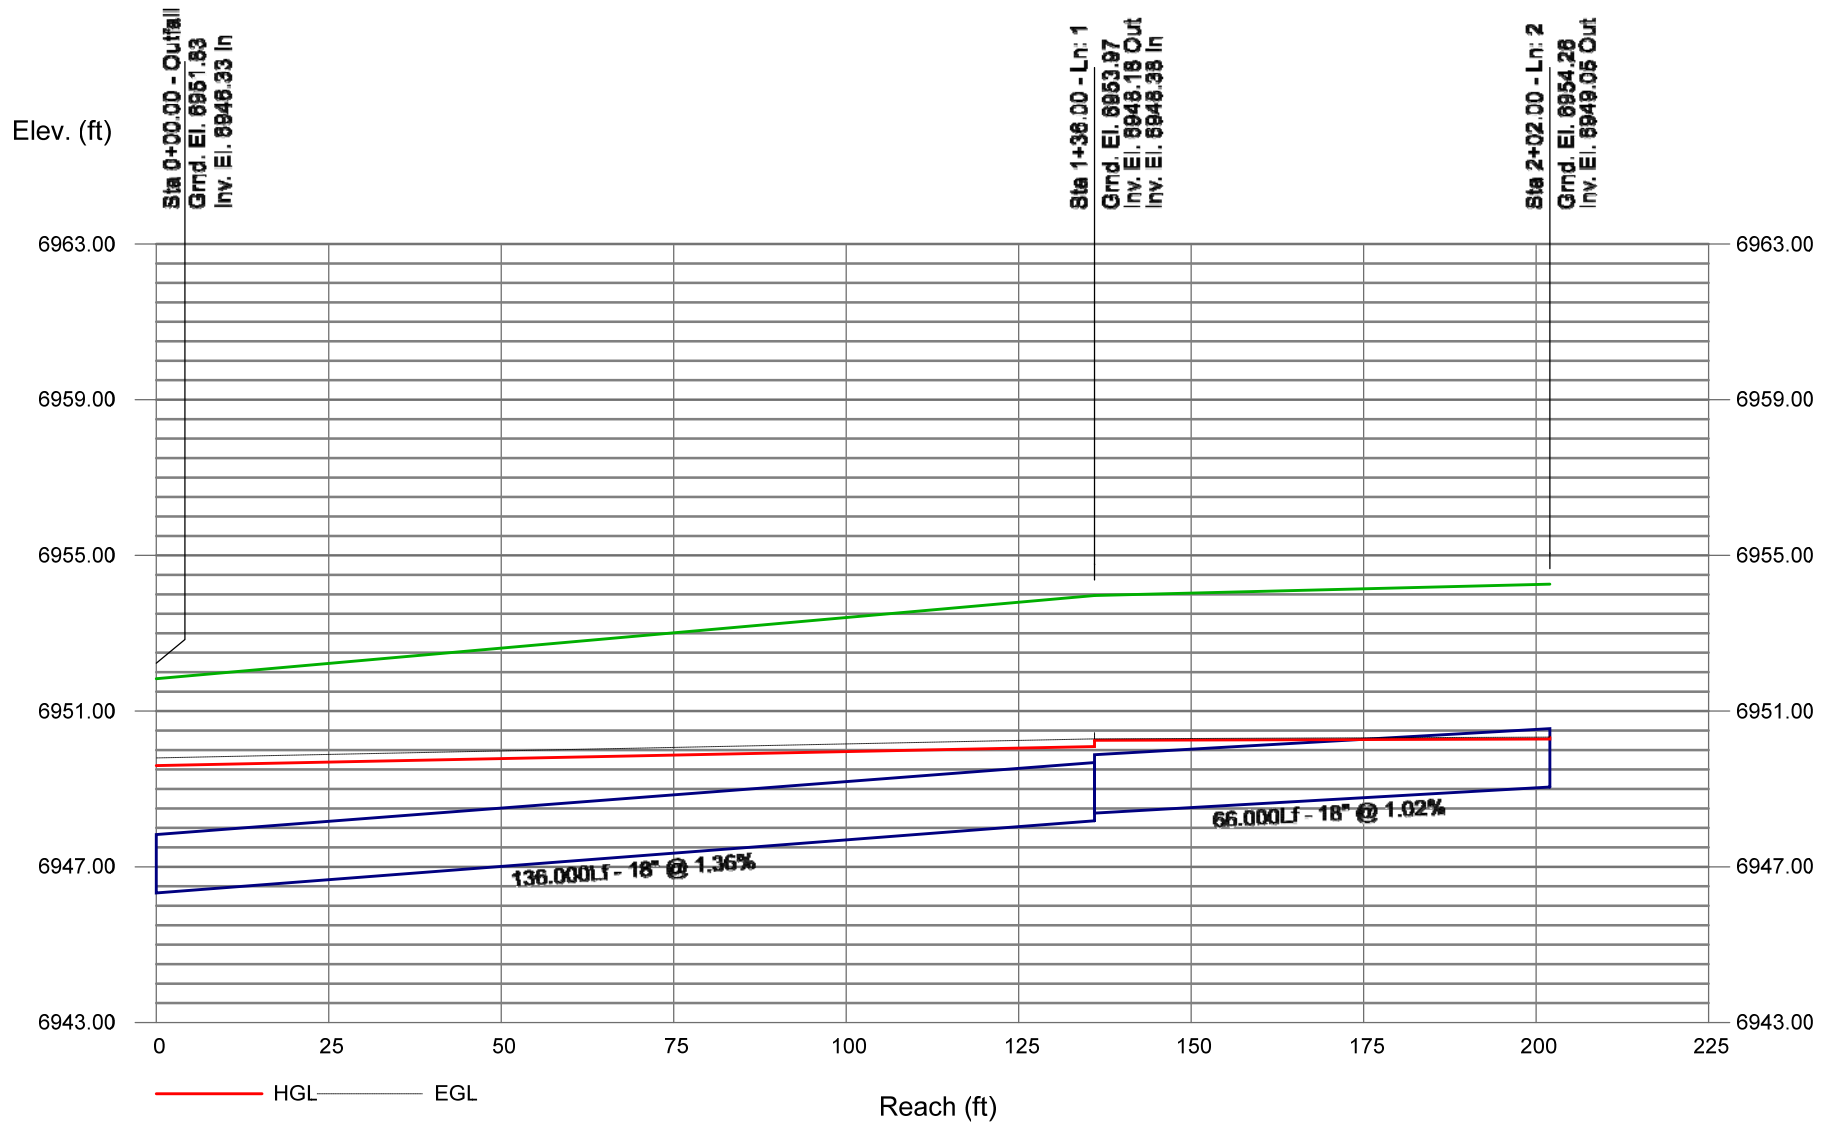

Bennet Ranch Drainageway Capacity

Existing Gutter Capacity Determination

1. Calculate upstream runoff along the gutter line.

The gutter line on the southeast side of Eastonville extends from the proposed driveway to the north side of the Bennett Ranch drainageway crossing.



Google Streetview at the upstream end of the gutter line (north side of Bennett Ranch drainageway crossing).





Google Streetview at the upstream end of the gutter line (south side of Bennett Ranch drainageway crossing). Transition from block to 6 inch curb.

The roadway is crowned in the center with two 20 ft wide lanes plus 2 ft wide gutters on each side as per survey, aerial, and CDOT data. To determine the drainage area to the project driveway, the length was measured along the flow line from the driveway to the upstream end of the gutter line (960 ft). Tributary area is basin ER1 and in the existing condition includes the road, curb and gutter as well as some vegetated areas sloped towards the road. In the proposed condition the tributary area is the road, curb and gutter, landscaped area, and proposed sidewalk. Runoff was calculated using the Rational Method (see **Appendix B, Composite Runoff Coefficients**).

- Calculate maximum allowable flow in gutter based on El Paso criteria for minor arterials.

Gutter capacity was determined using the street capacity charts in Chapter 7 of DCM-V1-Update. The street is a minor arterial, however, the typical cross-section in Figure 7-5 for Collectors with Parking applies to this roadway (6" vertical curve, $d = 6"$, $T_{\max} = 22'$ (20' travel lane with 2' wide gutter)).

Figure 7-5. Street Capacity Charts Collector (with Parking)

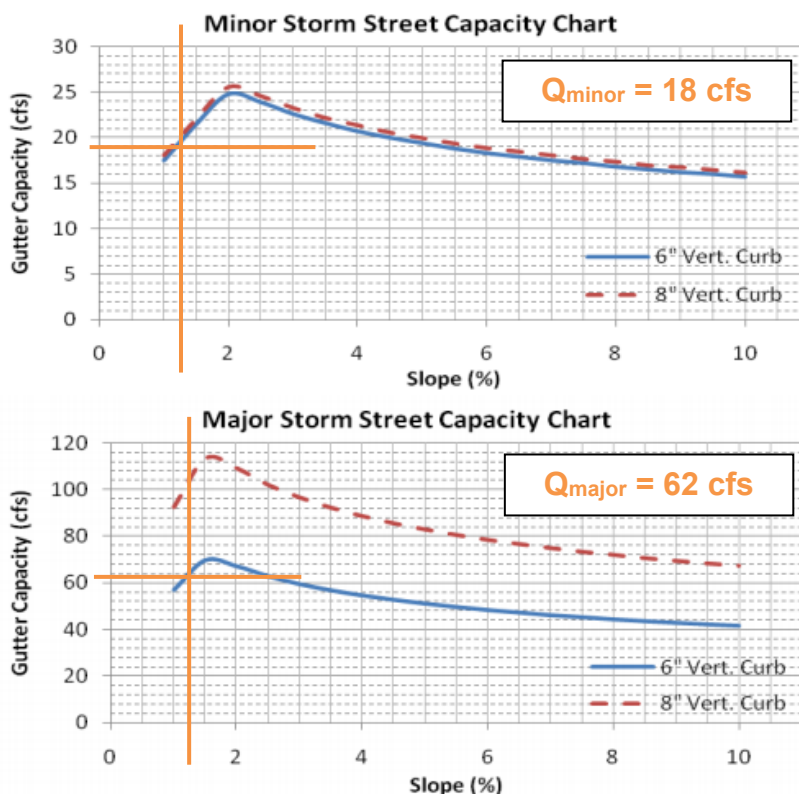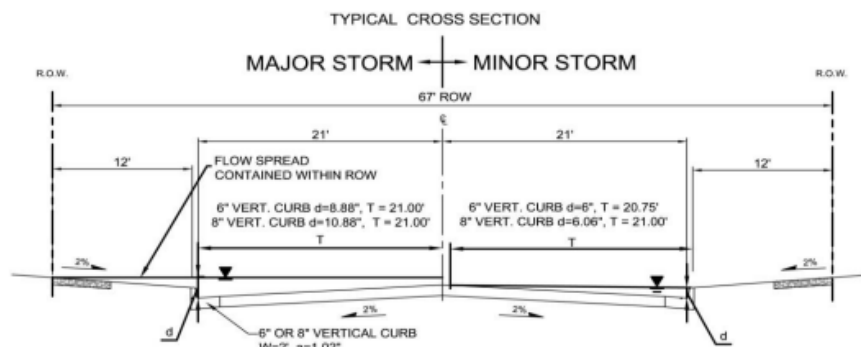

These charts shall only be used for the standard street sections as shown. The capacity shown is based on $\frac{1}{2}$ the street section as calculated by the UD-Inlet spreadsheets. Minor storm capacities are based on no crown overtopping, curb height or maximum allowable spread widths. Major storm capacities are based on flow being contained within the public right-of-way, including conveyance capacity behind the curb. The UDFCD Safety Reduction Factor was applied. An 'n_{STREET}' of 0.016 and 'n_{BACK}' of 0.020 was used. Calculations were done using UD-Inlet 3.00.xls, March, 2011.

Parameter	Value	Note
Flow spread, T (ft)	21	Length from crown to gutterline (based on CDOT lane width) plus 1 ft gutter width.
Longitudinal slope, S (ft/ft)	0.013	Measured from the 5958 to 5951 contour.
Manning's n, n	0.016	From Figure 7-5 of DCM-V1-Update.
Minor gutter capacity, Q (cfs)	18	Using Figure 7-5 of DCM-V1-Update.
5-year Q (cfs)	1.7	From Proposed Conditions, Rational Calculations
Major gutter capacity, Q (cfs)	62	Using Figure 7-5 of DCM-V1-Update.
100-year Q (cfs)	3.7	From Existing Conditions, Rational Calculations

As summarized in the table above, runoff in the minor and major event will be contained within the R.O.W. of Eastonville Road without entering the site.

3. Calculate maximum allowable flow in cross pan/driveway section.

The driveway section geometry was determined from El Paso County Detail SD 2-26 for Typical Cross Pan Layout Detail. Depth from the flowline of the cross pan to the crown of the road is 6.8 inches; the corresponding maximum allowable flow is 51.0 cfs, as shown in the following FlowMasterV8i calculation sheets. The minor and major events will be sufficiently to conveyed in the proposed cross pan along Eastonville Road without entering the site.

Off-site Drainageway Analysis

From MHFD, Volume 1:

Table 8-5. Recommended roughness values

Location and Cover	When Assessing Velocity, Froude No., Shear Stress	When Assessing Water Surface Elevation and Water Depth
<u>Main Channel (bankfull channel)</u>		
Sand or clay bed	0.03	0.04
Gravel or cobble bed	0.035	0.07
<u>Vegetated Overbanks</u>		
Turfgrass sod	0.03	0.04
Native grasses	0.032	0.05
Herbaceous wetlands (few or no willows)	0.06	0.12
Willow stands, woody shrubs	0.07	0.16

(Source: Chow 1959, USDA 1954, Barnes 1967, Arcement and Schneider 1989, Jarrett 1985)

Worksheet for X1

Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

Input Data

Channel Slope	0.00250	ft/ft
Discharge	810.00	ft³/s
Section Definitions		

Station (ft)	Elevation (ft)
-1+22	6952.00
-1+16	6950.54
-1+13	6950.00
-1+10	6949.29
-1+09	6949.00
-1+09	6948.91
-1+06	6948.39
-1+05	6948.06
-1+05	6948.00
-1+00	6947.87
-1+00	6947.87
-0+99	6947.65
-0+86	6944.96
-0+78	6943.42
-0+74	6942.94
-0+47	6940.17
-0+25	6939.53
-0+16	6939.30
-0+10	6939.19
-0+04	6939.09
-0+03	6937.77
-0+02	6937.26
-0+02	6936.77
-0+01	6936.76
0+00	6936.87
0+03	6936.85
0+04	6936.83

Worksheet for X1

Input Data

Station (ft)	Elevation (ft)
0+04	6936.87
0+10	6939.19
0+12	6939.53
0+40	6945.19
0+50	6945.19

Start Station	Ending Station	Roughness Coefficient
(-1+22, 6952.00)	(-0+25, 6939.53)	0.050
(-0+25, 6939.53)	(-0+04, 6939.09)	0.160
(-0+04, 6939.09)	(0+10, 6939.19)	0.040
(0+10, 6939.19)	(0+12, 6939.53)	0.160
(0+12, 6939.53)	(0+50, 6945.19)	0.050

Options

Current Roughness Weighted Method	Pavlovskii's Method
Open Channel Weighting Method	Pavlovskii's Method
Closed Channel Weighting Method	Pavlovskii's Method

Results

Normal Depth	7.14	ft
Elevation Range	6936.76 to 6952.00 ft	
Flow Area	396.96	ft ²
Wetted Perimeter	115.86	ft
Hydraulic Radius	3.43	ft
Top Width	113.90	ft
Normal Depth	7.14	ft
Critical Depth	4.13	ft
Critical Slope	0.08816	ft/ft

Worksheet for X1

Results

Velocity	2.04	ft/s
Velocity Head	0.06	ft
Specific Energy	7.20	ft
Froude Number	0.19	
Flow Type	Subcritical	

GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	7.14	ft
Critical Depth	4.13	ft
Channel Slope	0.00250	ft/ft
Critical Slope	0.08816	ft/ft

Cross Section for X1


Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

Input Data

Channel Slope	0.00250	ft/ft
Normal Depth	7.14	ft
Discharge	810.00	ft ³ /s

Cross Section Image

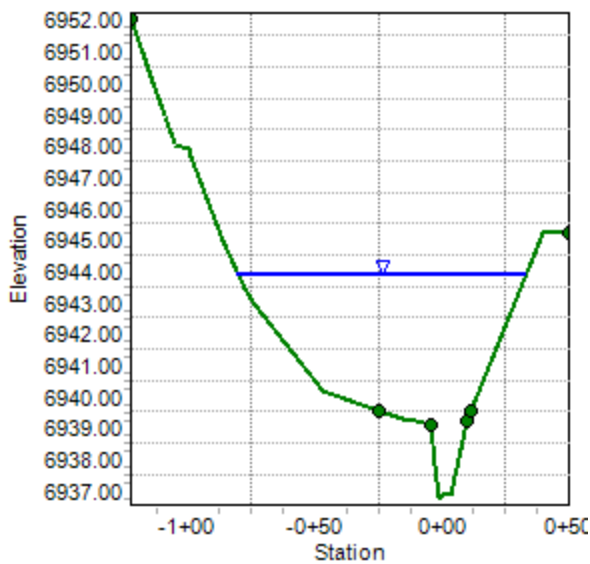

Worksheet for X2

Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

Input Data

Channel Slope	0.00250	ft/ft
Discharge	810.00	ft³/s
Section Definitions		

Station (ft)	Elevation (ft)
--------------	----------------

-1+21	6952.00
-1+18	6951.62
-1+13	6950.84
-1+11	6950.71
-0+89	6947.86
-0+87	6947.61
-0+85	6947.40
-0+47	6943.05
-0+46	6943.02
-0+22	6941.67
-0+17	6941.62
-0+10	6941.78
-0+08	6940.48
-0+05	6938.40
-0+03	6938.21
0+00	6938.00
0+02	6938.02
0+03	6938.02
0+10	6941.78
0+40	6947.78
0+55	6947.78

Roughness Segment Definitions

Start Station	Ending Station	Roughness Coefficient
---------------	----------------	-----------------------

Worksheet for X2

Input Data

Start Station	Ending Station	Roughness Coefficient
(-1+21, 6952.00)	(-0+22, 6941.67)	0.050
(-0+22, 6941.67)	(-0+10, 6941.78)	0.160
(-0+10, 6941.78)	(0+10, 6941.78)	0.040
(0+10, 6941.78)	(0+55, 6947.78)	0.050

Options

Current Roughness weighted Method	Pavlovskii's Method
Open Channel Weighting Method	Pavlovskii's Method
Closed Channel Weighting Method	Pavlovskii's Method

Results

Normal Depth	7.87	ft
Elevation Range	6938.00 to 6952.00 ft	
Flow Area	346.08	ft ²
Wetted Perimeter	104.77	ft
Hydraulic Radius	3.30	ft
Top Width	102.19	ft
Normal Depth	7.87	ft
Critical Depth	4.97	ft
Critical Slope	0.06270	ft/ft
Velocity	2.34	ft/s
Velocity Head	0.09	ft
Specific Energy	7.96	ft
Froude Number	0.22	
Flow Type	Subcritical	

GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

GVF Output Data

Upstream Depth	0.00	ft
----------------	------	----

Worksheet for X2

GVF Output Data

Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	7.87	ft
Critical Depth	4.97	ft
Channel Slope	0.00250	ft/ft
Critical Slope	0.06270	ft/ft

Cross Section for X2


Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

Input Data

Channel Slope	0.00250	ft/ft
Normal Depth	7.87	ft
Discharge	810.00	ft ³ /s

Cross Section Image

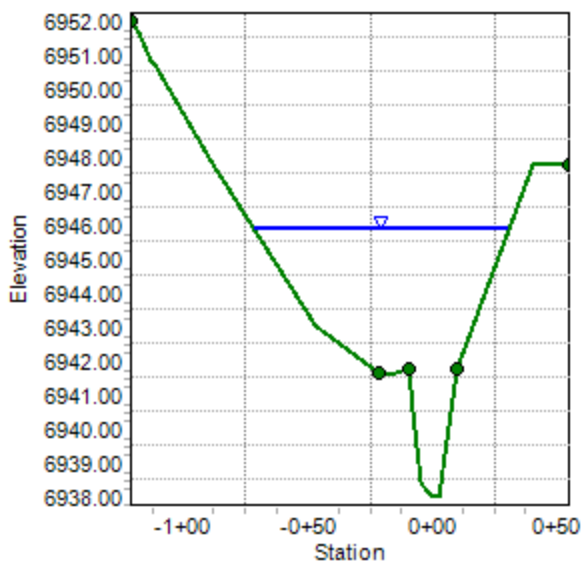

Cross Section for X2, WSEL = 6942


Project Description

Friction Method	Manning Formula
Solve For	Discharge

Input Data

Channel Slope	0.00250	ft/ft
Normal Depth	4.00	ft
Discharge	59.97	ft ³ /s

Cross Section Image

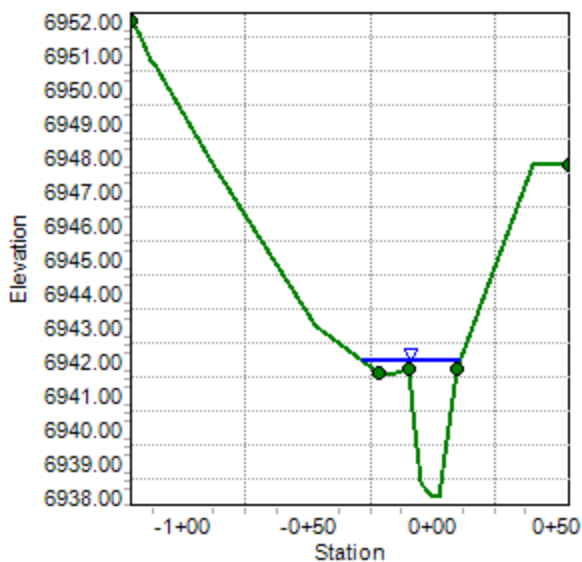

Cross Section for X2, WSEL = 6945


Project Description

Friction Method	Manning Formula
Solve For	Discharge

Input Data

Channel Slope	0.00250	ft/ft
Normal Depth	7.00	ft
Discharge	537.83	ft ³ /s

Cross Section Image

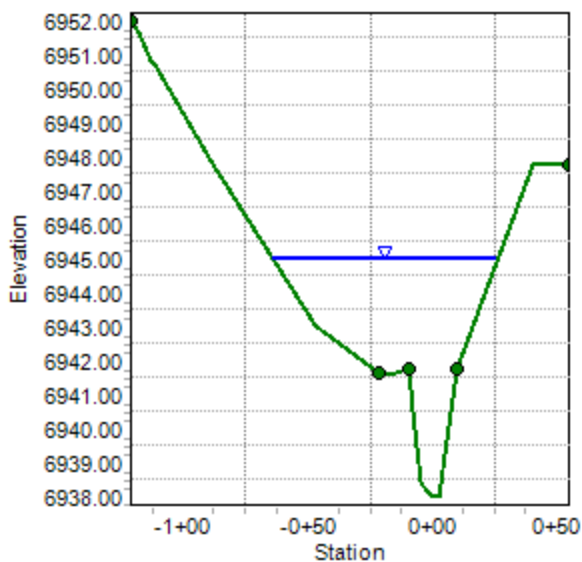

APPENDIX D – REFERENCED DOCUMENTS

Selected Pages from the Bennett Ranch

Drainage Basin Planning Study


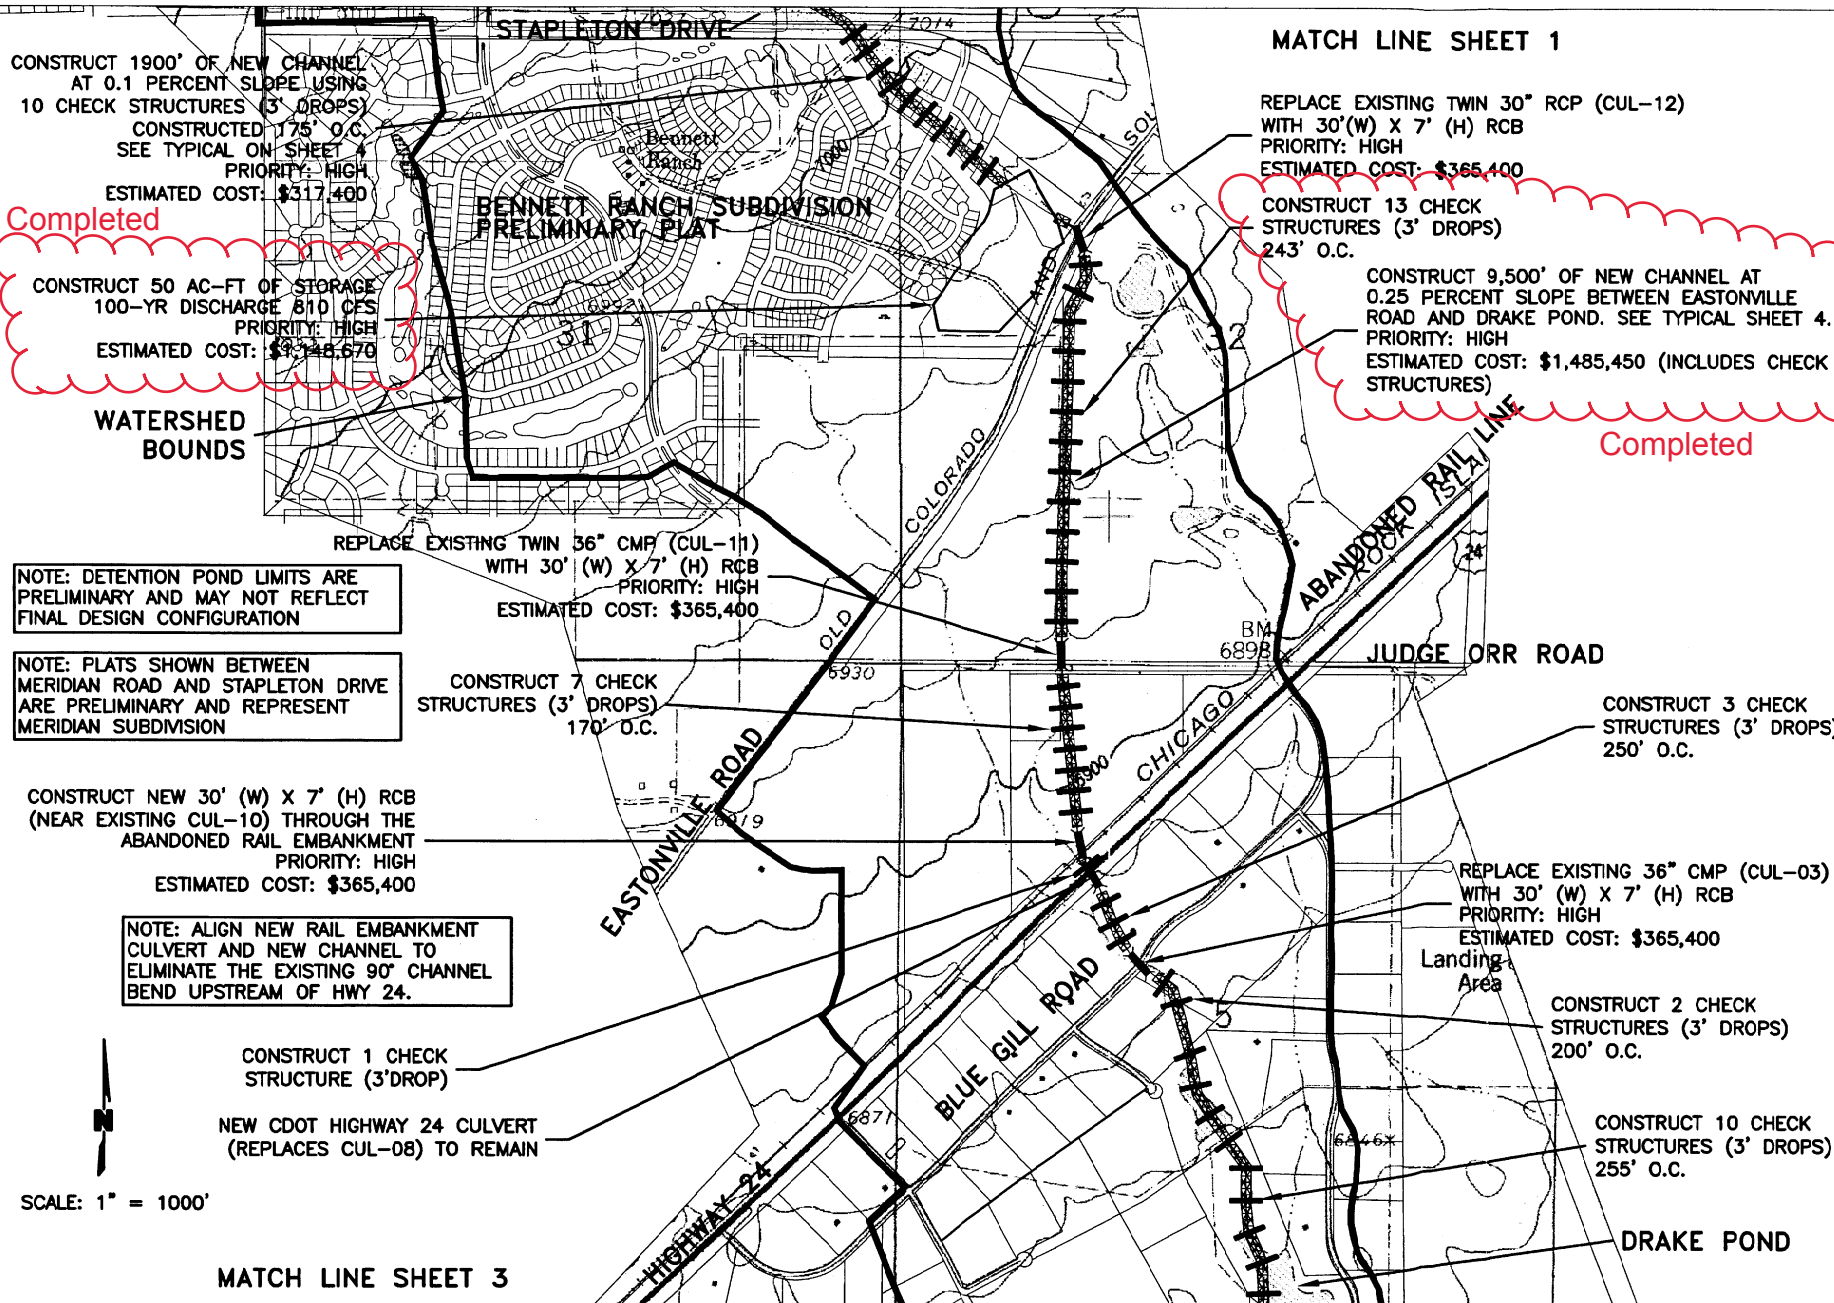


FIGURE 7-1
SHEET 2



WATER & ENVIRONMENTAL CONSULTANTS, INC.
Engineering, Scientific, & Financial Specialists in Stormwater Management

drawn by: FAP, WCB
designed by: KKB
checked by: KKB
project no.: 2000-0818
drawing no.:
date: MAR 01
revisions:

**DRAFT BENNETT
RANCH PILOT PROJECT**

MATCH LINE SHEET 3

REPLACE EXISTING 48" CMP (CUL-01)
WITH 30" (W) X 7' (H) RCB
PRIORITY: MEDIUM
ESTIMATED COST: \$365,400

CONSTRUCT 9 CHECK
STRUCTURES (3' DROPS)
450' O.C. TO MAINTAIN A
MAXIMUM CHANNEL SLOPE OF
0.7 PERCENT
PRIORITY: LOW
ESTIMATED COST: \$65,250

SCALE: 1" = 1000'

WEST FORK
SQUIRREL CREEK

WATERSHED BOUNDS



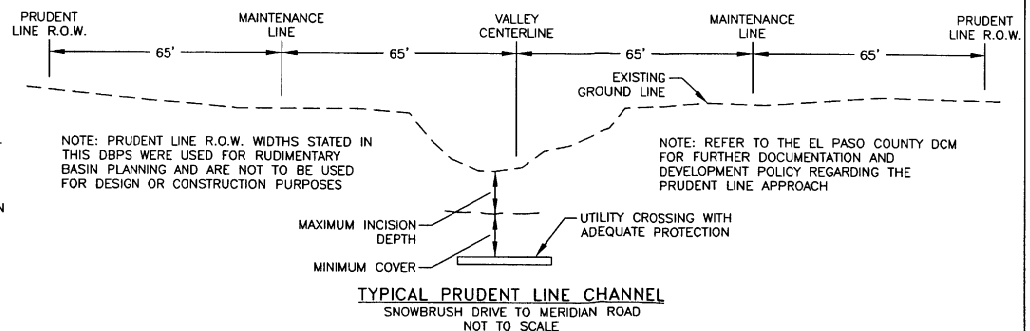


FIGURE 7-1
SHEET 4

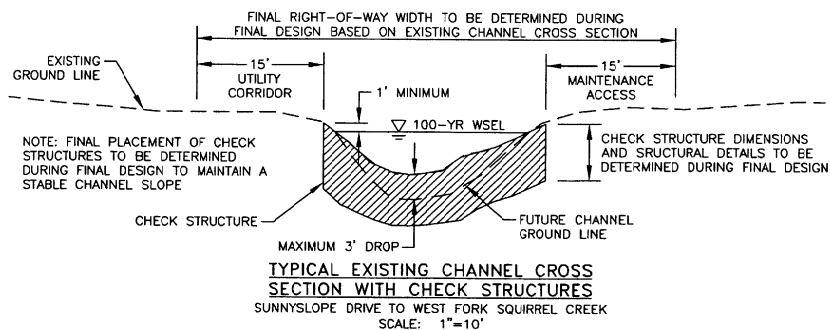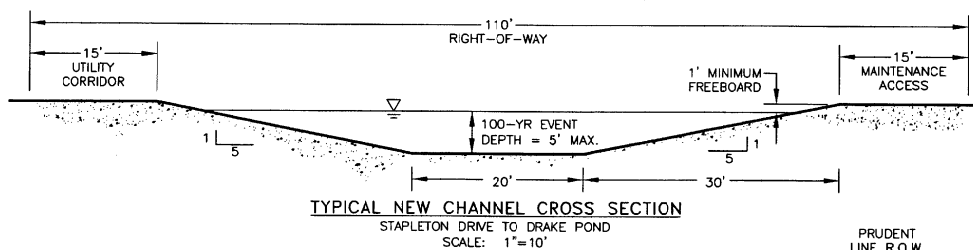


WATER & ENVIRONMENTAL CONSULTANTS, INC.
Engineering, Scientific, & Financial Specialists in Stormwater Management

drawn by: FAP, WCB
designed by: KKB
checked by: KKB
project no.: 2000-0818
drawing no.:
date: MAR 01
revisions:

**DRAFT BENNETT
RANCH PILOT PROJECT**

**Figure 3-3
Developed and
Existing Conditions
Peak Flows**

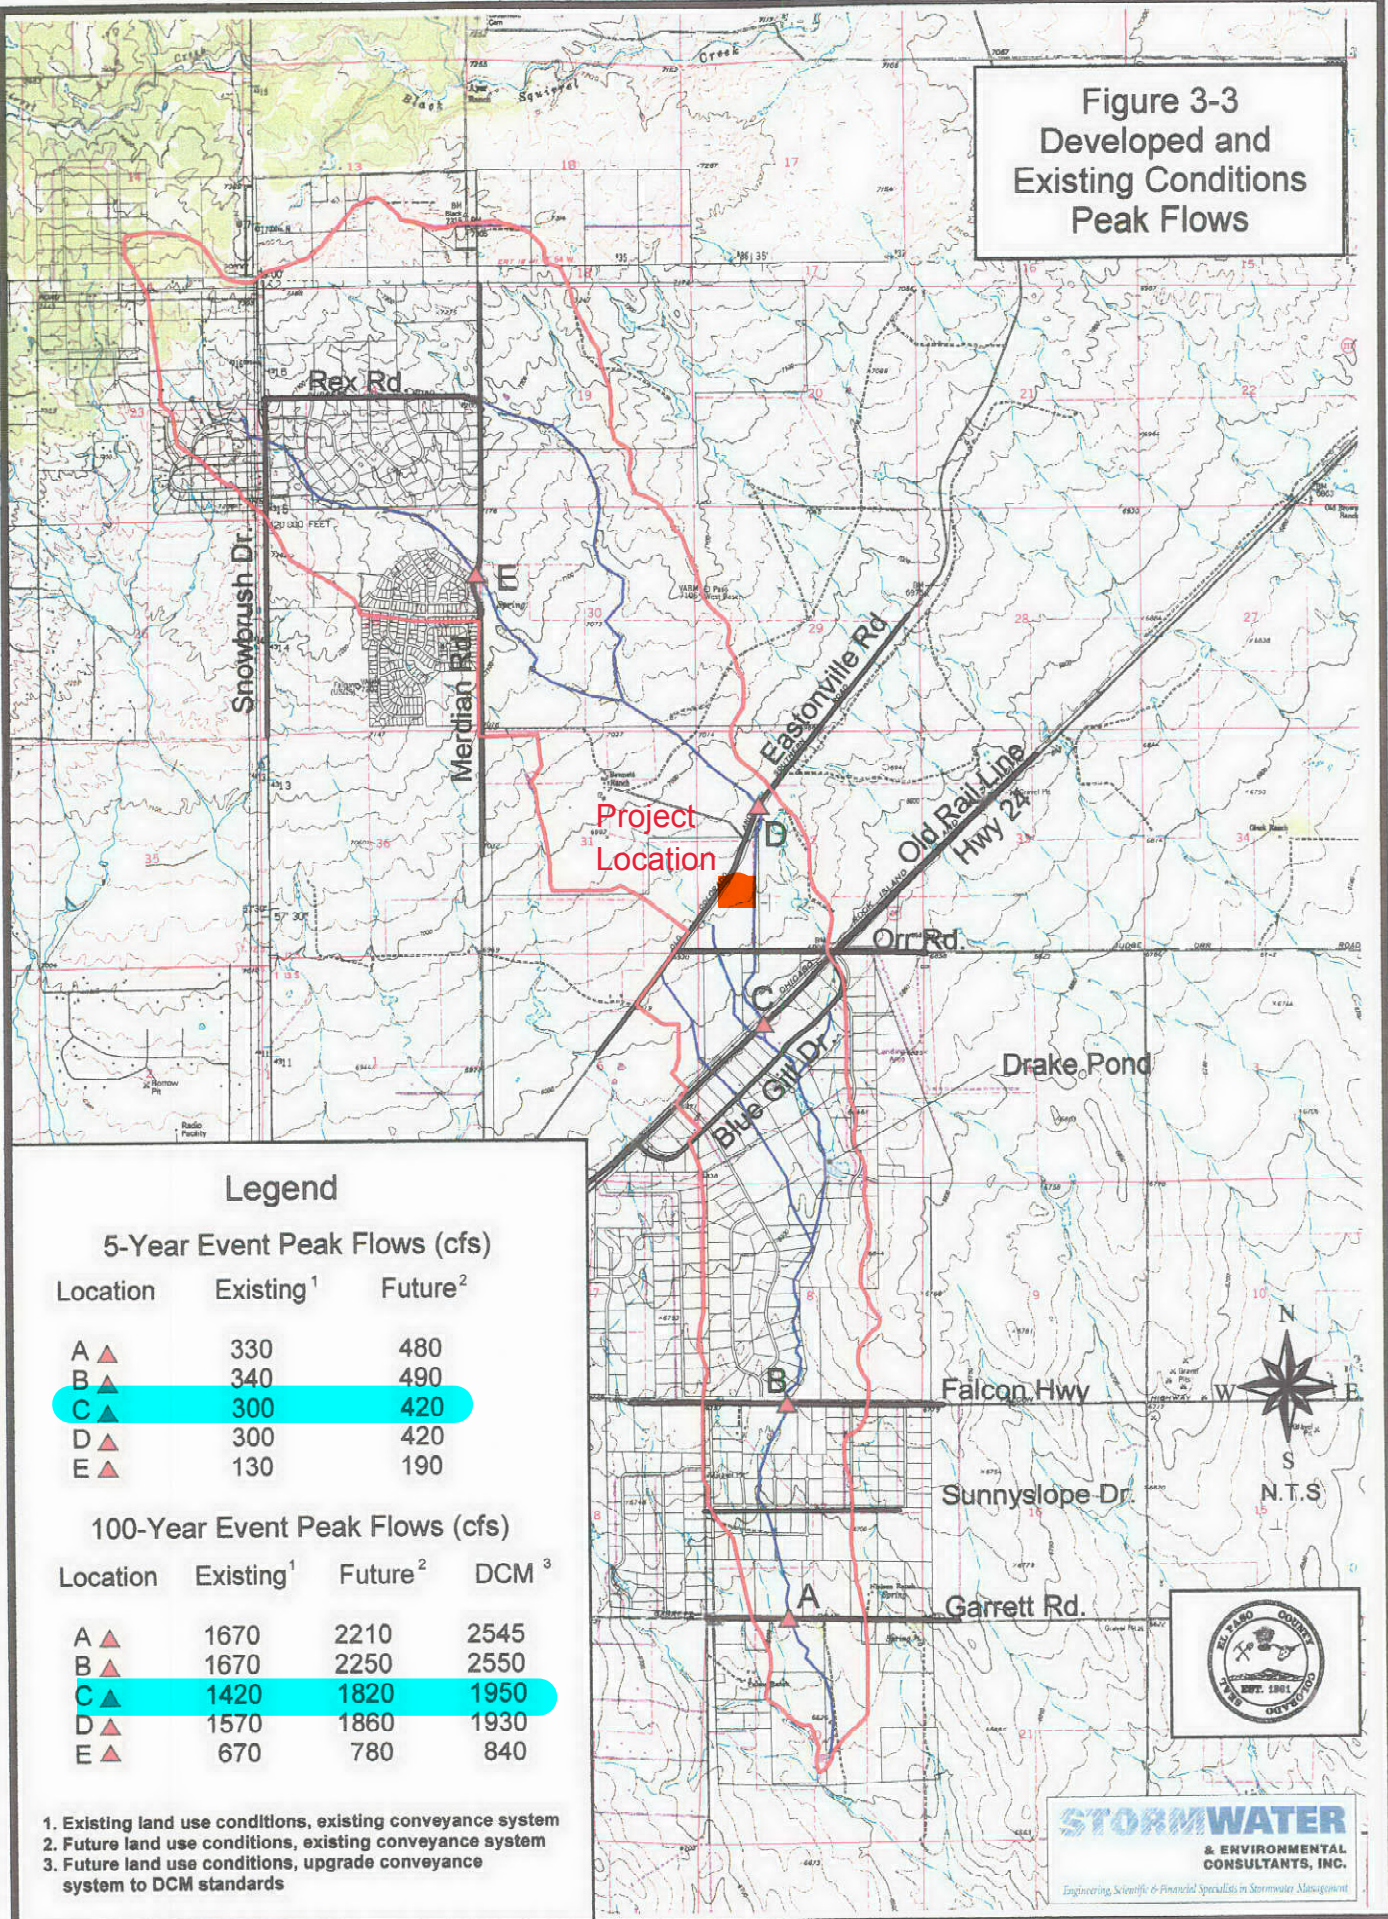


FEMA Flood Maps

National Flood Hazard Layer FIRMette



104°35'30"W 38°57'53"N

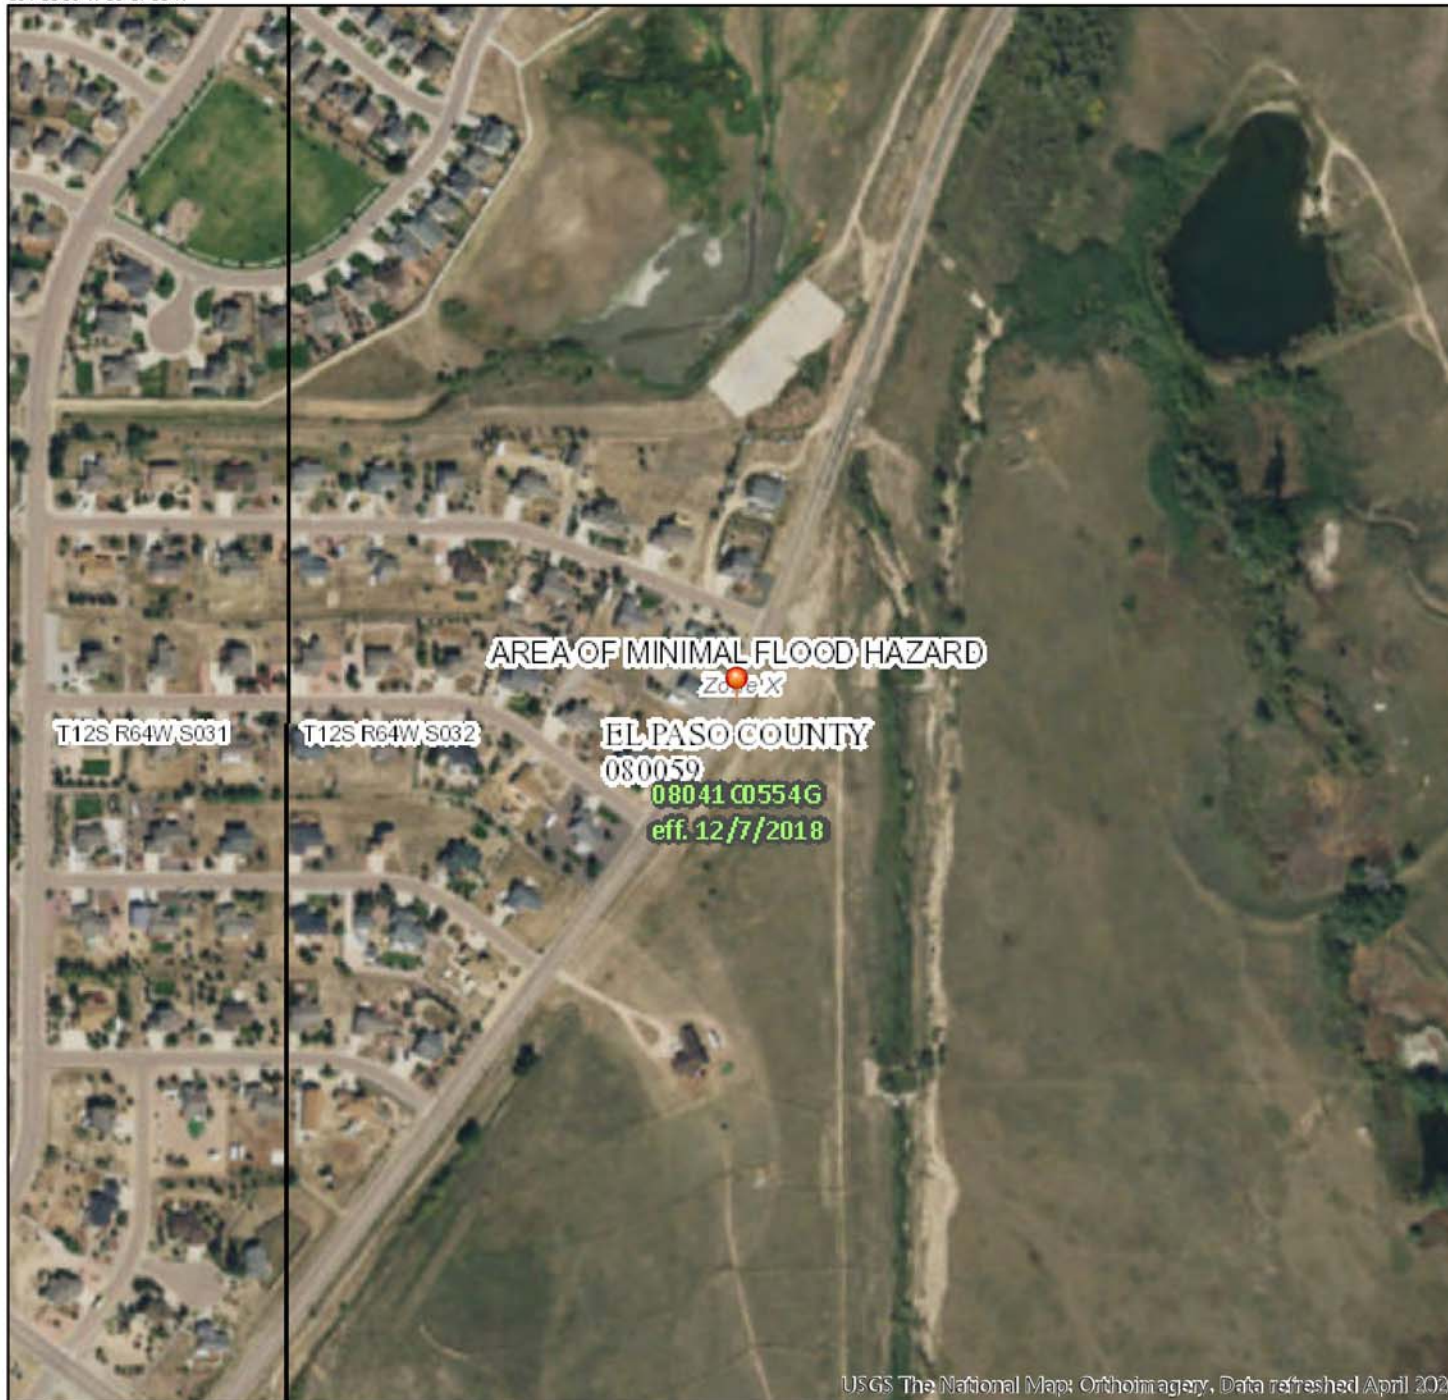

USGS The National Map: Orthoimagery. Data refreshed April 2020

0 250 500 1,000 1,500 2,000 Feet

1:6,000

104°34'53"W 38°57'25"N

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone D
		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		Cross Sections with 1% Annual Chance Water Surface Elevation
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
		Profile Baseline
MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **6/22/2020 at 1:22 PM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

Urban Drainage and Flood Control District Standards

Table EDB-4. EDB component criteria

	On-Site EDBs for Watersheds up to 1 Impervious Acre ¹	EDBs with Watersheds between 1 and 2 Impervious Acres ¹	EDBs with Watersheds up to 5 Impervious Acres	EDBs with Watersheds over 5 Impervious Acres	EDBs with Watersheds over 20 Impervious Acres
Forebay Release and Configuration	EDBs should not be used for watersheds with less than 1 impervious acre.	Release 2% of the undetained 100-year peak discharge by way of a wall/notch configuration	Release 2% of the undetained 100-year peak discharge by way of a wall/notch configuration	Release 2% of the undetained 100-year peak discharge by way of a wall/notch configuration	Release 2% of the undetained 100-year peak discharge by way of a wall/notch or berm/pipe ² configuration
Minimum Forebay Volume		1% of the WQCV	2% of the WQCV	3% of the WQCV	3% of the WQCV
Maximum Forebay Depth		12 inches	18 inches	18 inches	30 inches
Trickle Channel Capacity		≥ the maximum possible forebay outlet capacity	≥ the maximum possible forebay outlet capacity	≥ the maximum possible forebay outlet capacity	≥ the maximum possible forebay outlet capacity
Micropool		Area ≥ 10 ft ²	Area ≥ 10 ft ²	Area ≥ 10 ft ²	Area ≥ 10 ft ²
Initial Surge Volume		Depth ≥ 4 inches	Depth ≥ 4 inches	Depth ≥ 4 in. Volume ≥ 0.3% WQCV	Depth ≥ 4 in. Volume ≥ 0.3% WQCV

¹ EDBs are not recommended for sites with less than 2 impervious acres. Consider a sand filter or rain garden.

² Round up to the first standard pipe size (minimum 8 inches).

5. **Forebay Design:** The forebay provides an opportunity for larger particles to settle out in an area that can be easily maintained. The length of the flow path through the forebay should be maximized, and the slope minimized to encourage settling. The appropriate size of the forebay may be as much a function of the level of development in the tributary area as it is a percentage of the WQCV. When portions of the watershed may remain disturbed for an extended period of time, the forebay size will need to be increased due to the potentially high sediment load. Refer to Table EDB-4 for a design criteria summary. When using this table, the designer should consider increasing the size of the forebay if the watershed is not fully developed.

The forebay outlet should be sized to release 2% of the undetained peak 100-year discharge. A soil riprap berm with 3:1 sideslopes (or flatter) and a pipe outlet or a concrete wall with a notch outlet should be constructed between the forebay and the main EDB. It is recommended that the berm/pipe configuration be reserved for watersheds in excess of 20 impervious acres to accommodate the minimum recommended pipe diameter of 8 inches. When using the berm/pipe configuration, round up to the nearest standard pipe size and use a minimum diameter of 8 inches. The floor of the forebay should be concrete or lined with grouted boulders to define sediment removal limits. With either configuration, soil riprap should also be provided on the downstream side of the forebay berm or wall if the downstream grade is lower than the top of the berm or wall. The forebay will overtop frequently so this protection is necessary for erosion control. All soil riprap in the area of the forebay should be seeded and erosion control fabric should be placed to retain the seed in this high flow area.


6. **Trickle Channel:** Convey low flows from the forebay to the micropool with a trickle channel. The trickle channel should have a minimum flow capacity equal to the maximum release from the forebay outlet.

- **Concrete Trickle Channels:** A concrete trickle channel will help to establish the bottom of the basin long-term and may also facilitate regular sediment removal. It can be a "V" shaped concrete drain pan or a concrete channel with curbs. A flat-bottom channel facilitates maintenance. A slope between 0.4% - 1% is recommended to encourage settling while reducing the potential for low points within the pan.
- **Soft-bottom Trickle Channels:** When designed and maintained properly, soft-bottom trickle channels can allow for an attractive alternative to concrete. They can also improve water quality. However, they are not appropriate for all sites. Be aware, maintenance of soft bottom trickle channels requires mechanical removal of sediment and vegetation. Additionally, this option provides mosquito habitat. For this reason, UDFCD recommends that they be considered on a case-by-case basis and with the approval of the local jurisdiction. It is recommended that soft bottom trickle channels be designed with a consistent longitudinal slope from forebay to micropool and that they not meander. This geometry will allow for reconstruction of the original design when sediment removal in the trickle channel is necessary. The trickle channel may also be located along the toe of the slope if a straight channel is not desired. The recommended minimum depth of a soft bottom trickle channel is 1.5 feet. This depth will help limit potential wetland growth to the trickle channel, preserving the bottom of the basin.

Riprap and soil riprap lined trickle channels are not recommended due to past maintenance experiences, where the riprap was inadvertently removed along with the sediment during maintenance.

- Micropool and Outlet Structure:** Locate the outlet structure in the embankment of the EDB and provide a permanent micropool directly in front of the structure. Submerge the well screen to the bottom of the micropool. This will reduce clogging of the well screen because it allows water to flow through the well screen below the elevation of the lowest orifice even when the screen above the water surface is plugged. This will prevent shallow ponding in front of the structure, which provides a breeding ground for mosquitoes (large shallow puddles tend to produce more mosquitoes than a smaller, deeper permanent pond).

Micropool side slopes may be vertical walls or stabilized slopes of 3:1 (horizontal:vertical). For watersheds with less than 5 impervious acres, the micropool can be located inside the outlet structure (refer to Figures OS-7 and OS-8 provided in Fact Sheet T-12). The micropool should be at least 2.5 feet in depth with a minimum surface area of 10 square feet. The bottom should be concrete unless a baseflow is present or anticipated or if groundwater is anticipated. Riprap is not recommended because it complicates maintenance operations.

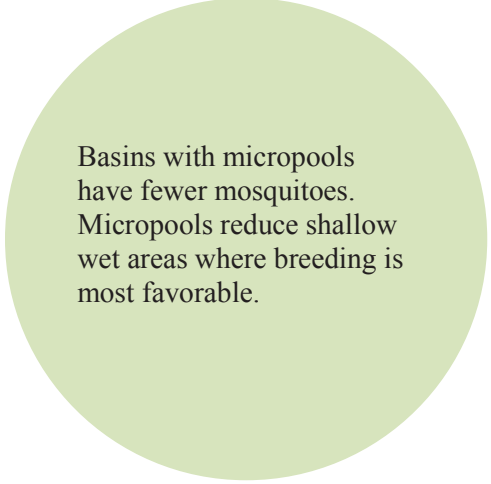

Basins with micropools have fewer mosquitoes. Micropools reduce shallow wet areas where breeding is most favorable.

Where possible, place the outlet in an inconspicuous location as shown in Photo EDB-3. This urban EDB utilizes landscaped parking lot islands connected by a series of culverts (shown in Photo EDB-4) to provide the required water quality and flood control volumes.

The outlet should be designed to release the WQCV over a 40-hour period. Draining a volume of water over a specified time can be done through an orifice plate as detailed in Fact Sheet T-12. Use reservoir routing calculations as discussed in the *Storage* Chapter of Volume 2 to assist in the design. Two workbooks tools have been developed by UDFCD for this purpose, UD-FSD and UD-Detention. Both are available at www.udfcd.org. UD-FSD is recommended for a typical EDB full spectrum detention design. UD-Detention uses the same methodology and can be used for a full spectrum detention basin or a WQCV only design. It also allows for a wider range of outlet controls should the user want to specify something beyond what is shown in Fact Sheet T-12.

Refer to BMP Fact Sheet T-12 for schematics pertaining to structure geometry, grates, trash racks, orifice plate, and all other necessary components.

The outlet may have flared or parallel wing walls as shown in Figures EDB-1 and EDB-2, respectively. Either configuration should be recessed into the embankment to minimize its profile. Additionally, the trash rack should be sloped with the basin side-slopes.

From MHFD, Volume 1:

Table 8-5. Recommended roughness values

Location and Cover	When Assessing Velocity, Froude No., Shear Stress	When Assessing Water Surface Elevation and Water Depth
<u>Main Channel (bankfull channel)</u>		
Sand or clay bed	0.03	0.04
Gravel or cobble bed	0.035	0.07
<u>Vegetated Overbanks</u>		
Turfgrass sod	0.03	0.04
Native grasses	0.032	0.05
Herbaceous wetlands (few or no willows)	0.06	0.12
Willow stands, woody shrubs	0.07	0.16

(Source: Chow 1959, USDA 1954, Barnes 1967, Arcement and Schneider 1989, Jarrett 1985)

4.0 Intensity-Duration Curves for Rational Method

To develop depth-duration curves or intensity-duration curves for the Rational Method of runoff analysis take the 1-hour depth(s) obtained from NOAA Atlas 14 and apply Equation 5-1 for the duration (or durations) of interest:

$$I = \frac{28.5 P_1}{(10 + T_d)^{0.786}} \quad \text{Equation 5-1}$$

Where:

I = rainfall intensity (inches per hour)

P_1 = 1-hour point rainfall depth (inches)

T_d = storm duration (minutes)

2.4.1 Initial or Overland Flow Time

The initial or overland flow time, t_i , may be calculated using Equation 6-3:

$$t_i = \frac{0.395(1.1 - C_5)\sqrt{L_i}}{S_o^{0.33}} \quad \text{Equation 6-3}$$

Where:

- t_i = overland (initial) flow time (minutes)
- C_5 = runoff coefficient for 5-year frequency (from Table 6-4)
- L_i = length of overland flow (ft)
- S_o = average slope along the overland flow path (ft/ft).

Equation 6-3 is adequate for distances up to 300 feet in urban areas and 500 feet in rural areas. Note that in a highly urbanized catchment, the overland flow length is typically shorter than 300 feet due to effective man-made drainage systems that collect and convey runoff.

2.4.2 Channelized Flow Time

The channelized flow time (travel time) is calculated using the hydraulic properties of the conveyance element. The channelized flow time, t_t , is estimated by dividing the length of conveyance by the velocity. The following equation, Equation 6-4 (Guo 2013), can be used to determine the flow velocity in conjunction with Table 6-2 for the conveyance factor.

$$t_t = \frac{L_t}{60K\sqrt{S_o}} = \frac{L_t}{60V_t} \quad \text{Equation 6-4}$$

Where:

- t_t = channelized flow time (travel time, min)
- L_t = waterway length (ft)
- S_o = waterway slope (ft/ft)
- V_t = travel time velocity (ft/sec) = $K\sqrt{S_o}$
- K = NRCS conveyance factor (see Table 6-2).

Table 6-2. NRCS Conveyance factors, K

Type of Land Surface	Conveyance Factor, K
Heavy meadow	2.5
Tillage/field	5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

The time of concentration, t_c , is the sum of the initial (overland) flow time, t_i , and the channelized flow time, t_t , as per Equation 6-2.

2.4.3 First Design Point Time of Concentration in Urban Catchments

Equation 6-4 was solely determined by the waterway characteristics and using a set of empirical formulas. A calibration study between the Rational Method and the Colorado Urban Hydrograph Procedure (CUHP) suggests that the time of concentration shall be the lesser of the values calculated by Equation 6-2 and Equation 6-5 (Guo and Urbonas 2013).

$$t_c = (26 - 17i) + \frac{L_t}{60(14i + 9)\sqrt{S_t}} \quad \text{Equation 6-5}$$

Where:

t_c = minimum time of concentration for first design point when less than t_c from Equation 6-1.

L_t = length of channelized flow path (ft)

i = imperviousness (expressed as a decimal)

S_t = slope of the channelized flow path (ft/ft).

Equation 6-5 is the regional time of concentration that warrants the best agreement on peak flow predictions between the Rational Method and CUHP when the imperviousness of the tributary area is greater than 20 percent. It was developed using the UDFCD database that includes 295 sample urban catchments under 2-, 5-, 10-, 50, and 100-yr storm events (MacKenzie 2010). It suggests that both initial flow time and channelized flow velocity are directly related to the catchment's imperviousness (Guo and MacKenzie 2013).

The first design point is defined as a node where surface runoff enters the storm drain system. For example, all inlets are "first design points" because inlets are designed to accept flow into the storm drain.

Typically, but not always, Equation 6-5 will result in a lesser time of concentration at the first design point and will govern in an urbanized watershed. For subsequent design points, add the travel time for each relevant segment downstream.

2.4.4 Minimum Time of Concentration

Use a minimum t_c value of 5 minutes for urbanized areas and a minimum t_c value of 10 minutes for areas that are not considered urban. Use minimum values even when calculations result in a lesser time of concentration.

2.4.5 Common Errors in Calculating Time of Concentration

A common mistake in urbanized areas is to assume travel velocities that are too slow. Another common error is to not check the runoff peak resulting from only part of the catchment. Sometimes a lower portion of the catchment or a highly impervious area produces a larger peak than that computed for the whole catchment. This error is most often encountered when the catchment is long or the upper portion contains grassy open land and the lower portion is more developed.

El Paso County Drainage Criteria Manual

For Colorado Springs and much of the Fountain Creek watershed, the 1-hour depths are fairly uniform and are summarized in Table 6-2. Depending on the location of the project, rainfall depths may be calculated using the described method and the NOAA Atlas maps shown in Figures 6-6 through 6-17.

Table 6-2. Rainfall Depths for Colorado Springs

Return Period	1-Hour Depth	6-Hour Depth	24-Hour Depth
2	1.19	1.70	2.10
5	1.50	2.10	2.70
10	1.75	2.40	3.20
25	2.00	2.90	3.60
50	2.25	3.20	4.20
100	2.52	3.50	4.60

Where $Z = 6,840 \text{ ft}/100$

These depths can be applied to the design storms or converted to intensities (inches/hour) for the Rational Method as described below. However, as the basin area increases, it is unlikely that the reported point rainfalls will occur uniformly over the entire basin. To account for this characteristic of rain storms an adjustment factor, the Depth Area Reduction Factor (DARF) is applied. This adjustment to rainfall depth and its effect on design storms is also described below. The UDFCD UD-Rain spreadsheet, available on UDFCD's website, also provides tools to calculate point rainfall depths and Intensity-Duration-Frequency curves² and should produce similar depth calculation results.

2.2 Design Storms

Design storms are used as input into rainfall/runoff models and provide a representation of the typical temporal distribution of rainfall events when the creation or routing of runoff hydrographs is required. It has long been observed that rainstorms in the Front Range of Colorado tend to occur as either short-duration, high-intensity, localized, convective thunderstorms (cloud bursts) or longer-duration, lower-intensity, broader, frontal (general) storms. The significance of these two types of events is primarily determined by the size of the drainage basin being studied. Thunderstorms can create high rates of runoff within a relatively small area, quickly, but their influence may not be significant very far downstream. Frontal storms may not create high rates of runoff within smaller drainage basins due to their lower intensity, but tend to produce larger flood flows that can be hazardous over a broader area and extend further downstream.

- **Thunderstorms:** Based on the extensive evaluation of rain storms completed in the Carlton study (Carlton 2011), it was determined that typical thunderstorms have a duration of about 2 hours. The study evaluated over 300,000 storm cells using gage-adjusted NEXRAD data, collected over a 14-year period (1994 to 2008). Storms lasting longer than 3 hours were rarely found. Therefore, the results of the Carlton study have been used to define the shorter duration design storms.

To determine the temporal distribution of thunderstorms, 22 gage-adjusted NEXRAD storm cells were studied in detail. Through a process described in a technical memorandum prepared by the City of Colorado Springs (City of Colorado Springs 2012), the results of this analysis were interpreted and normalized to the 1-hour rainfall depth to create the distribution shown in Table 6-3 with a 5 minute time interval for drainage basins up to 1 square mile in size. This distribution represents the rainfall

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)


Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

3.2 Time of Concentration

One of the basic assumptions underlying the Rational Method is that runoff is a function of the average rainfall rate during the time required for water to flow from the hydraulically most remote part of the drainage area under consideration to the design point. However, in practice, the time of concentration can be an empirical value that results in reasonable and acceptable peak flow calculations.


For urban areas, the time of concentration (t_c) consists of an initial time or overland flow time (t_i) plus the travel time (t_t) in the storm sewer, paved gutter, roadside drainage ditch, or drainage channel. For non-urban areas, the time of concentration consists of an overland flow time (t_i) plus the time of travel in a concentrated form, such as a swale or drainageway. The travel portion (t_t) of the time of concentration can be estimated from the hydraulic properties of the storm sewer, gutter, swale, ditch, or drainageway. Initial time, on the other hand, will vary with surface slope, depression storage, surface cover, antecedent rainfall, and infiltration capacity of the soil, as well as distance of surface flow. The time of concentration is represented by Equation 6-7 for both urban and non-urban areas.

APPENDIX E – DRAINAGE PLANS

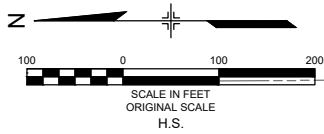

Know what's below.
Call before you dig.

LEGEND

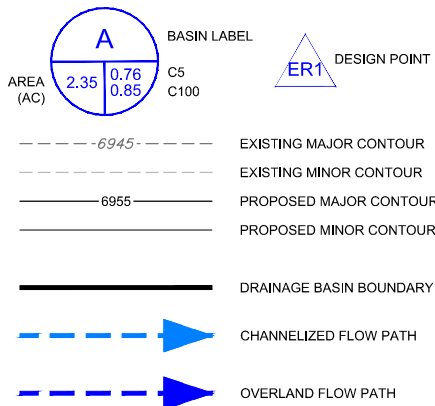

EXISTING RUNOFF SUMMARY					
DP	BASINS	AREA (AC)	IMP. (%)	Q5 (CFS)	Q100 (CFS)
ER1	ER1	0.76	58%	1.74	3.70
ER2	ER2	0.33	57%	0.92	1.97
ER2	ER1+ER2	1.10	57%	2.26	4.83
OS1	OS1	2.39	0%	0.52	3.83
OS2	OS2	8.37	3%	2.43	14.19

CITY/COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH CITY/COUNTY DESIGN CRITERIA. THE CITY/COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSION, AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT.

REFERENCE DRAWINGS


X-995-EX-BASE
X-995-002-EX-MAP
X-995-002-EX-BASE
X-995-002-MDC22X34

No.	DATE	DESCRIPTION	BY
REVISIONS			

COMPUTER FILE MANAGEMENT

FILE NAME: R:\20.995.002 (Liberty Tree Academy Additional Svcs)\Dwg\Exhibits\Existing Drainage_Liberty-Tree-Academy.dwg
CTB FILE: ---
PLOT DATE: 6/24/2020 4:55 PM
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.

SHEET KEY



PREPARED FOR:

LIBERTY TREE
ACADEMY

PREPARED BY:

Matrix
Excellence by Design

PRELIMINARY

THIS DRAWING HAS NOT
BEEN APPROVED BY
GOVERNING AGENCIES AND
IS SUBJECT TO CHANGE


FOR AND ON BEHALF OF
MATRIX DESIGN GROUP, INC.
PROJECT No. 20.995.002

LIBERTY TREE


DRAINAGE REPORT
PHASE II IMPROVEMENTS

FIGURE A-1 EXISTING DRAINAGE PLAN

DESIGNED BY:	MAS	SCALE	DATE ISSUED:	6/26/2020	DRAWING No. A-1
DRAWN BY:	MAS	HORIZ.1"=100' (HS)			
CHECKED BY:	DK	VERT. N/A	SHEET	1 OF 2	

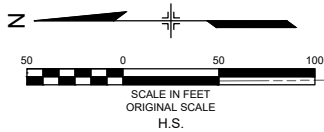

LEGEND

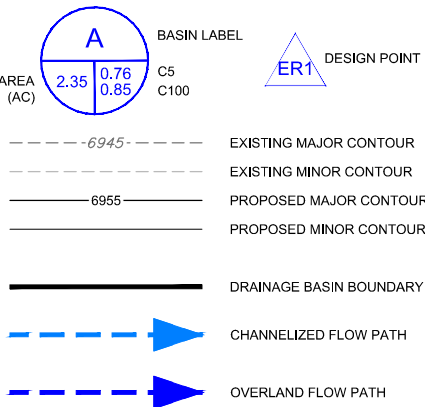


PROPOSED RUNOFF SUMMARY					
DP	BASINS	AREA (AC)	IMP (%)	Q5 (CFS)	Q100 (CFS)
ER1	ER1	0.94	57%	2.11	4.52
ER2	ER2	0.45	52%	1.08	2.40
ER2	ER1+ER2	1.39	55%	2.76	6.98
OS1	OS1	0.30	0%	0.12	0.90
OS2	OS2	6.01	4%	1.92	10.44
A	A	2.57	81%	7.66	14.65
B1	B1	0.44	63%	1.34	2.77
B2	B2	0.45	95%	1.94	3.53
C	C	0.69	4%	0.28	1.54
C	A-C	4.15	68%	9.93	20.11

CITY/COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH CITY/COUNTY DESIGN CRITERIA. THE CITY/COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSION, AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT.

REFERENCE DRAWINGS			
X-995-EX-BASE X-995-PR-UTIL X-995-002-PR-BASE_PH-2 X-995-002-EX-MAP X-995-002-EX-BASE X-995-002-EX-BASE_PH-1 X-995-002-MOD-22X34			
No.	DATE	DESCRIPTION REVISIONS	BY
COMPUTER FILE MANAGEMENT			
FILE NAME: R:\20.995.002 (Liberty Tree Academy Additional Svcs)\Dwg\Exhibits\Proposed Drainage_Liberty-Tree-Academy.dwg			
CTB FILE: ---			
PLOT DATE: 6/26/2020 10:58 AM			
THIS DRAWING IS CURRENT AS OF PLOT DATE AND MAY BE SUBJECT TO CHANGE.			

SHEET KEY



PREPARED FOR:

LIBERTY TREE
ACADEMY

PREPARED BY:



PRELIMINARY

THIS DRAWING HAS NOT BEEN APPROVED BY GOVERNING AGENCIES AND IS SUBJECT TO CHANGE

FOR AND ON BEHALF OF
MATRIX DESIGN GROUP, INC.
PROJECT No. 20.995.002

LIBERTY TREE

DRAINAGE REPORT
PHASE II IMPROVEMENTS

FIGURE A-2
PROPOSED DRAINAGE PLAN

DESIGNED BY:	MAS	SCALE	DATE ISSUED:	6/26/2020	DRAWING No.
DRAWN BY:	MAS	HORIZONTAL=1"=100' (HS)			
CHECKED BY:	AJB	VERT. N/A	SHEET	2 OF 2	A-2