

June 29, 2002
Revised August 2, 2022
Revised August 17, 2022

SR Land, LLC
20 Boulder Crescent, 2nd Floor
Colorado Springs, Colorado 80903



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
COLORADO SPRINGS, CO 80907
PHONE (719) 531-5599
FAX (719) 531-5238

* **APPROVED**
Engineering Department

08/22/2022 3:08:07 PM

dsdnijkamp

EPC Planning & Community
Development Department

Attn: Chaz Collins

Re: Pavement Recommendations - Revised
Sterling Ranch, Filing No. 3
El Paso County, Colorado
Entech Job No. 221370

* if CTS is chosen, a mix design to determine the percent cement will be required prior to placement.

Dear Mr. Collins:

As requested, Entech Engineering, Inc. has obtained samples of the pavement subgrade soils from the roads in the Sterling Ranch, Filing No 3 Subdivision. This letter presents the results of the laboratory testing and pavement recommendations for the roadway sections within the filing.

Project Description

The roadways for this project consist of sections of Dines Boulevard, Pennydale Drive, Hazlett Drive, and Polson Drive, located in northeast of Colorado Springs, in the north portion of El Paso County, Colorado. Subsurface Soil Investigation and laboratory testing was performed in order to determine the pavement support characteristics of the soils. The approximate locations of the test borings are presented on the Test Boring Location Plan, Figure 1.

Subgrade Conditions

Ten test borings were drilled along the roadway to depths of approximately 5 and 10 feet below the existing subgrade surface. The soils in the test borings consisted of clayey sand fill and slightly silty to silty sand fill (Soil Type 1), silty to slightly silty sandstone (Soil Type 2), and very sandy siltstone (Soil Type 3).

The subgrade soils consisted of Soil Type 1. Soil Type 2 and 3 will not be encountered in the roadway excavation as they are located at depths beneath the subgrade influence zone. The Test Boring Logs are presented in Appendix A. Sieve Analyses and Atterberg Limit testing were performed on the subgrade soil samples obtained from the test borings for the purpose of classification. The percent passing the No. 200 sieve for the Type 1 soils is approximately 5 to 30 percent. The Type 1 subgrade soils classify as A-1-b, A-2-4, and A-2-6 soils. using the AASHTO classification system. Groundwater was not encountered in the test borings. Water soluble sulfate tests results indicated that the soils exhibit a negligible potential for sulfate attack. The subgrade soils on this site are not expected to be affected in any form regarding constraints resulting from frost susceptibility, special drainage requirements, or cold-weather construction.

Atterberg Limits Testing on samples of the soils taken from the test borings resulted in Liquid Limits of No Value to 46 percent and Plastic Indexes of Non-Plastic to 18 percent. A Swell/Consolidation Test indicated a volume change of 0.3%, which is in the low expansion range

PCD File No. SF 21-032

for a sample of Soil Type 1 from Test Boring No. 10 at a depth of 1 to 2 feet. A Swell/Consolidation Test indicated a volume change of 3.8%, which is in the high expansion range for a sample of Soil Type 3 from Test Boring No. 8 at a depth of 10 feet. The Type 3 soils are beneath the influence zone and will not require mitigation. Based on the Type 1 soils test results, mitigation will not be required on this site. Laboratory test results are presented in Appendix B and are summarized in Table 1.

California Bearing Ratio (CBR) testing was performed on a representative sample of Soil Type 1 to determine the support characteristics of the subgrade soils for the roadway sections. The results of the CBR testing, are presented in Appendix B and summarized as follows:

Soil Type 1 – Clayey Sand Fill

R @ 90% = 22.0

R @ 95% = 40.0

Use R = 40.0 for design

Classification Testing

Liquid Limit	30
Plasticity Index	18
Percent Passing 200	29.3
AASHTO Classification	A-2-6
Group Index	1
Unified Soils Classification	SC

Pavement Design

CBR testing was used to determine pavement sections for the roadways. Pavement sections were determined utilizing the El Paso County Pavement Design Criteria Manual. The cul-de-sac section on Pennydale Drive classifies as an urban local (low volume) roadway, which will use an 18k ESAL value of 36,500 for design. Dines Boulevard, Pennydale Drive, Hazlett Drive, and Polson Drive classify as urban local roads, which will use an 18k ESAL value of 292,000 for design purposes. Alternative pavement sections were determined for full depth asphalt, asphalt supported on aggregate basecourse, asphalt on recycled concrete and asphalt on cement stabilized subgrade. El Paso County does not allow full depth asphalt sections. The approval report and laboratory testing performed for the recycled concrete are attached in Appendix D. The source and locations are provided in the report

Design parameters used in the pavement analysis for the roadways are as follows:

Reliability	80%
Serviceability Index 2.0	2.0%
Standard Deviation	0.44
"R" Value Subgrade	40.0
Resilient Modulus	9,497 psi
Δ psi	2.0
Structural Coefficients	
Hot Bituminous Pavement	0.44
Aggregate Basecourse	0.11
Cement Stabilized Subgrade	0.11
Recycled Concrete	0.09

The pavement design calculations are presented in Appendix C. Pavement section alternatives for the roadway sections are presented below. Any additional grading may result in subgrade soils with different support characteristics. The following pavement sections should be re-evaluated if additional grading is performed.

Pavement Sections
ESAL = 36,500 – Local (Low Volume)

<u>Alternative</u>	<u>Asphalt (in)</u>	<u>Basecourse (in)</u>	<u>Cement Stabilized Subgrade (in)</u>	<u>Recycled Concrete (in)**</u>
1. Asphalt Over Basecourse	3.0*	6.0*	—	—
2. Asphalt Over Recycled Concrete	3.0*	—	—	6.0*
3. Asphalt Over Stabilized Subgrade	4.0	—	8.0	—

Pavement Sections
ESAL = 292,000 - Urban Local

<u>Alternative</u>	<u>Asphalt (in)</u>	<u>Basecourse (in)</u>	<u>Cement Stabilized Subgrade (in)</u>	<u>Recycled Concrete (in)**</u>
1. Asphalt Over Basecourse	4.0*	8.0*	—	—
2. Asphalt Over Recycled Concrete	4.0*	—	—	8.0*
3. Asphalt Over Stabilized Subgrade	4.0	—	8.0	—

*Minimum sections required per El Paso County Pavement Design Criteria Manual.

** County approval pending.

Mitigation

El Paso County requires mitigation of expansive soils that have a swell of 2 percent or greater with a 150 pound per square foot surcharge. Based on the swell testing the soils at subgrade depth do not require mitigation. This site will not require mitigation.

Roadway Construction – Asphalt on Aggregate Basecourse or Recycled Concrete Alternatives

Prior to placement of the asphalt, the subgrade should be mitigated as required and compacted to a minimum of 95 percent of the soils maximum Modified Proctor Dry Density, ASTM D-1557 at ± 2 percent of optimum moisture content and proofrolled. Any loose areas should be removed and replaced with suitable materials. Basecourse materials should be compacted to a minimum of 95 percent of its maximum Modified Proctor Dry Density, at ± 2 percent of optimum moisture content. Special attention should be given to areas adjacent to manholes, inlet structures and valves.

Roadway Construction – Stabilized Subgrade Alternative

Prior to placement of the asphalt, the subgrade shall be stabilized by the addition of cement to a depth of at least 8 inches (see Pavement Sections). The amount of cement applied shall be a minimum of 2 percent (by weight) of the subgrade's maximum dry density as determined by the Modified Proctor Test (ASTM D-1557). The cement should be spread evenly on the subgrade surface and be thoroughly mixed into the subgrade over an 8-inch depth, as specified, such that a uniform blend of soil and cement is achieved. Prior to application or mixing of the cement, the upper 8 inches of subgrade should be thoroughly moisture conditioned to the soil's optimum water content or as much as 2 percent more than the optimum water content as necessary to provide a compactable soil condition. Densification of the cement-stabilized subgrade should be completed to obtain a compaction of at least 95 percent of the subgrade maximum dry density as determined by the Modified Proctor Test (ASTM D-1557) or by the Standard Proctor Test (ASTM D-698). Satisfactory compaction of the subgrade shall occur within 90 minutes from the time of mixing the cement into the subgrade.

The following conditions shall be observed as part of the subgrade stabilization:

- Type I/II cement as supplied; a local supplier shall be used. All cement used for stabilization should come from the same source. If cement sources are changed a new laboratory mix design should be completed.
- Moisture conditioning of the subgrade and/or mixing of the cement into the subgrade shall not occur when soil temperatures are below 40° F. Cement treated subgrades should be maintained at a temperature of 40° F or greater until the subgrade has been compacted as required.
- Cement placement, cement mixing and compaction of the cement treated subgrade should be observed by a Soils Engineer. The Soils Engineer should complete in situ compaction tests and construct representative compacted specimens of the treated subgrade material for subsequent laboratory quality assurance testing.

SR Land, LLC
Pavement Recommendations - Revised
Sterling Ranch, Filing No 3
El Paso County, Colorado
Entech Job No. 221370

- Pending the results of the field density testing, micro fracturing of the stabilized subgrade may be required. Soil strengths in excess of 200 psi require micro fracturing.

In addition to the above guidance, the asphalt, cement, subgrade conditions, compaction of materials and roadway construction methods shall meet El Paso County pavement design specifications.

We trust that this report contains the information you require. If you have questions or need additional information, please contact us.

Respectfully Submitted,

ENTECH ENGINEERING, INC.



Daniel P. Stegman

DPS/lu

Encl.

AAprojects/2022/221370 pr - rev

Reviewed by:



Austin M. Nossokoff, P.E.



TABLE

TABLE 1
SUMMARY OF LABORATORY TEST RESULTS

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370

SOIL TYPE	TEST BORING NO.	DEPTH (FT)	WATER (%)	DRY DENSITY (PCF)	PASSING NO. 200 SIEVE (%)	LIQUID LIMIT (%)	PLASTIC INDEX (%)	SULFATE (WT %)	AASHTO CLASS.	SWELL/ CONSOL (%)	UNIFIED CLASSIFICATION	SOIL DESCRIPTION
1, CBR	3	0-3			29.3	30	18		A-2-6		SC	FILL, SAND, CLAYEY
1	1	1-2			15.6	29	17	0.00	A-2-6		SC	FILL, SAND, CLAYEY
1	2	1-2			16.6	30	15	<0.01	A-2-6		SC	FILL, SAND, CLAYEY
1	3	1-2			17.3	30	12		A-2-6		SC	FILL, SAND, CLAYEY
1	4	1-2			15.0	NV	NP		A-1-b		SM	FILL, SAND, SILTY
1	5	1-2			29.8	NV	NP		A-2-4		SM	FILL, SAND, SILTY
1	6	1-2			16.6	NV	NP		A-1-b		SM	FILL, SAND, SILTY
1	7	1-2			11.1	NV	NP		A-1-b		SM-SW	FILL, SAND, SLIGHTLY SILTY
1	8	1-2			20.2	NV	NP		A-1-b		SM	FILL, SAND, SILTY
1	9	1-2			5.2	NV	NP		A-1-b		SM-SW	FILL, SAND, SLIGHTLY SILTY
1	10	1-2	11.8	105.6	16.5	28	11		A-2-6	0.3	SC	FILL, SAND, CLAYEY
2	1	10			11.2	NV	NP	<0.01	A-1-b		SM-SW	SANDSTONE, SLIGHTLY SILTY
2	4	10			10.4	NV	NP		A-1-b		SM-SW	SANDSTONE, SILTY
3	8	10	17.9	104.7	50.2	46	18	<0.01	A-7-6	3.8	ML	SILTSTONE, VERY SANDY

FIGURES


REVISION	BY

ENTTECH
ENGINEERING, INC.
505 ELKTON DRIVE (719) 531-5599
COLORADO SPRINGS, CO. 80907




TEST BORING LOCATION PLAN
STERLING RANCH, FILING 3
EL PASO COUNTY, CO.
FOR: SR LAND, LLC

DRAWN	JHR
CHECKED	DPS
DATE	6/22/22
SCALE	1"=100'
JOB NO.	221370
FIGURE NO.	1

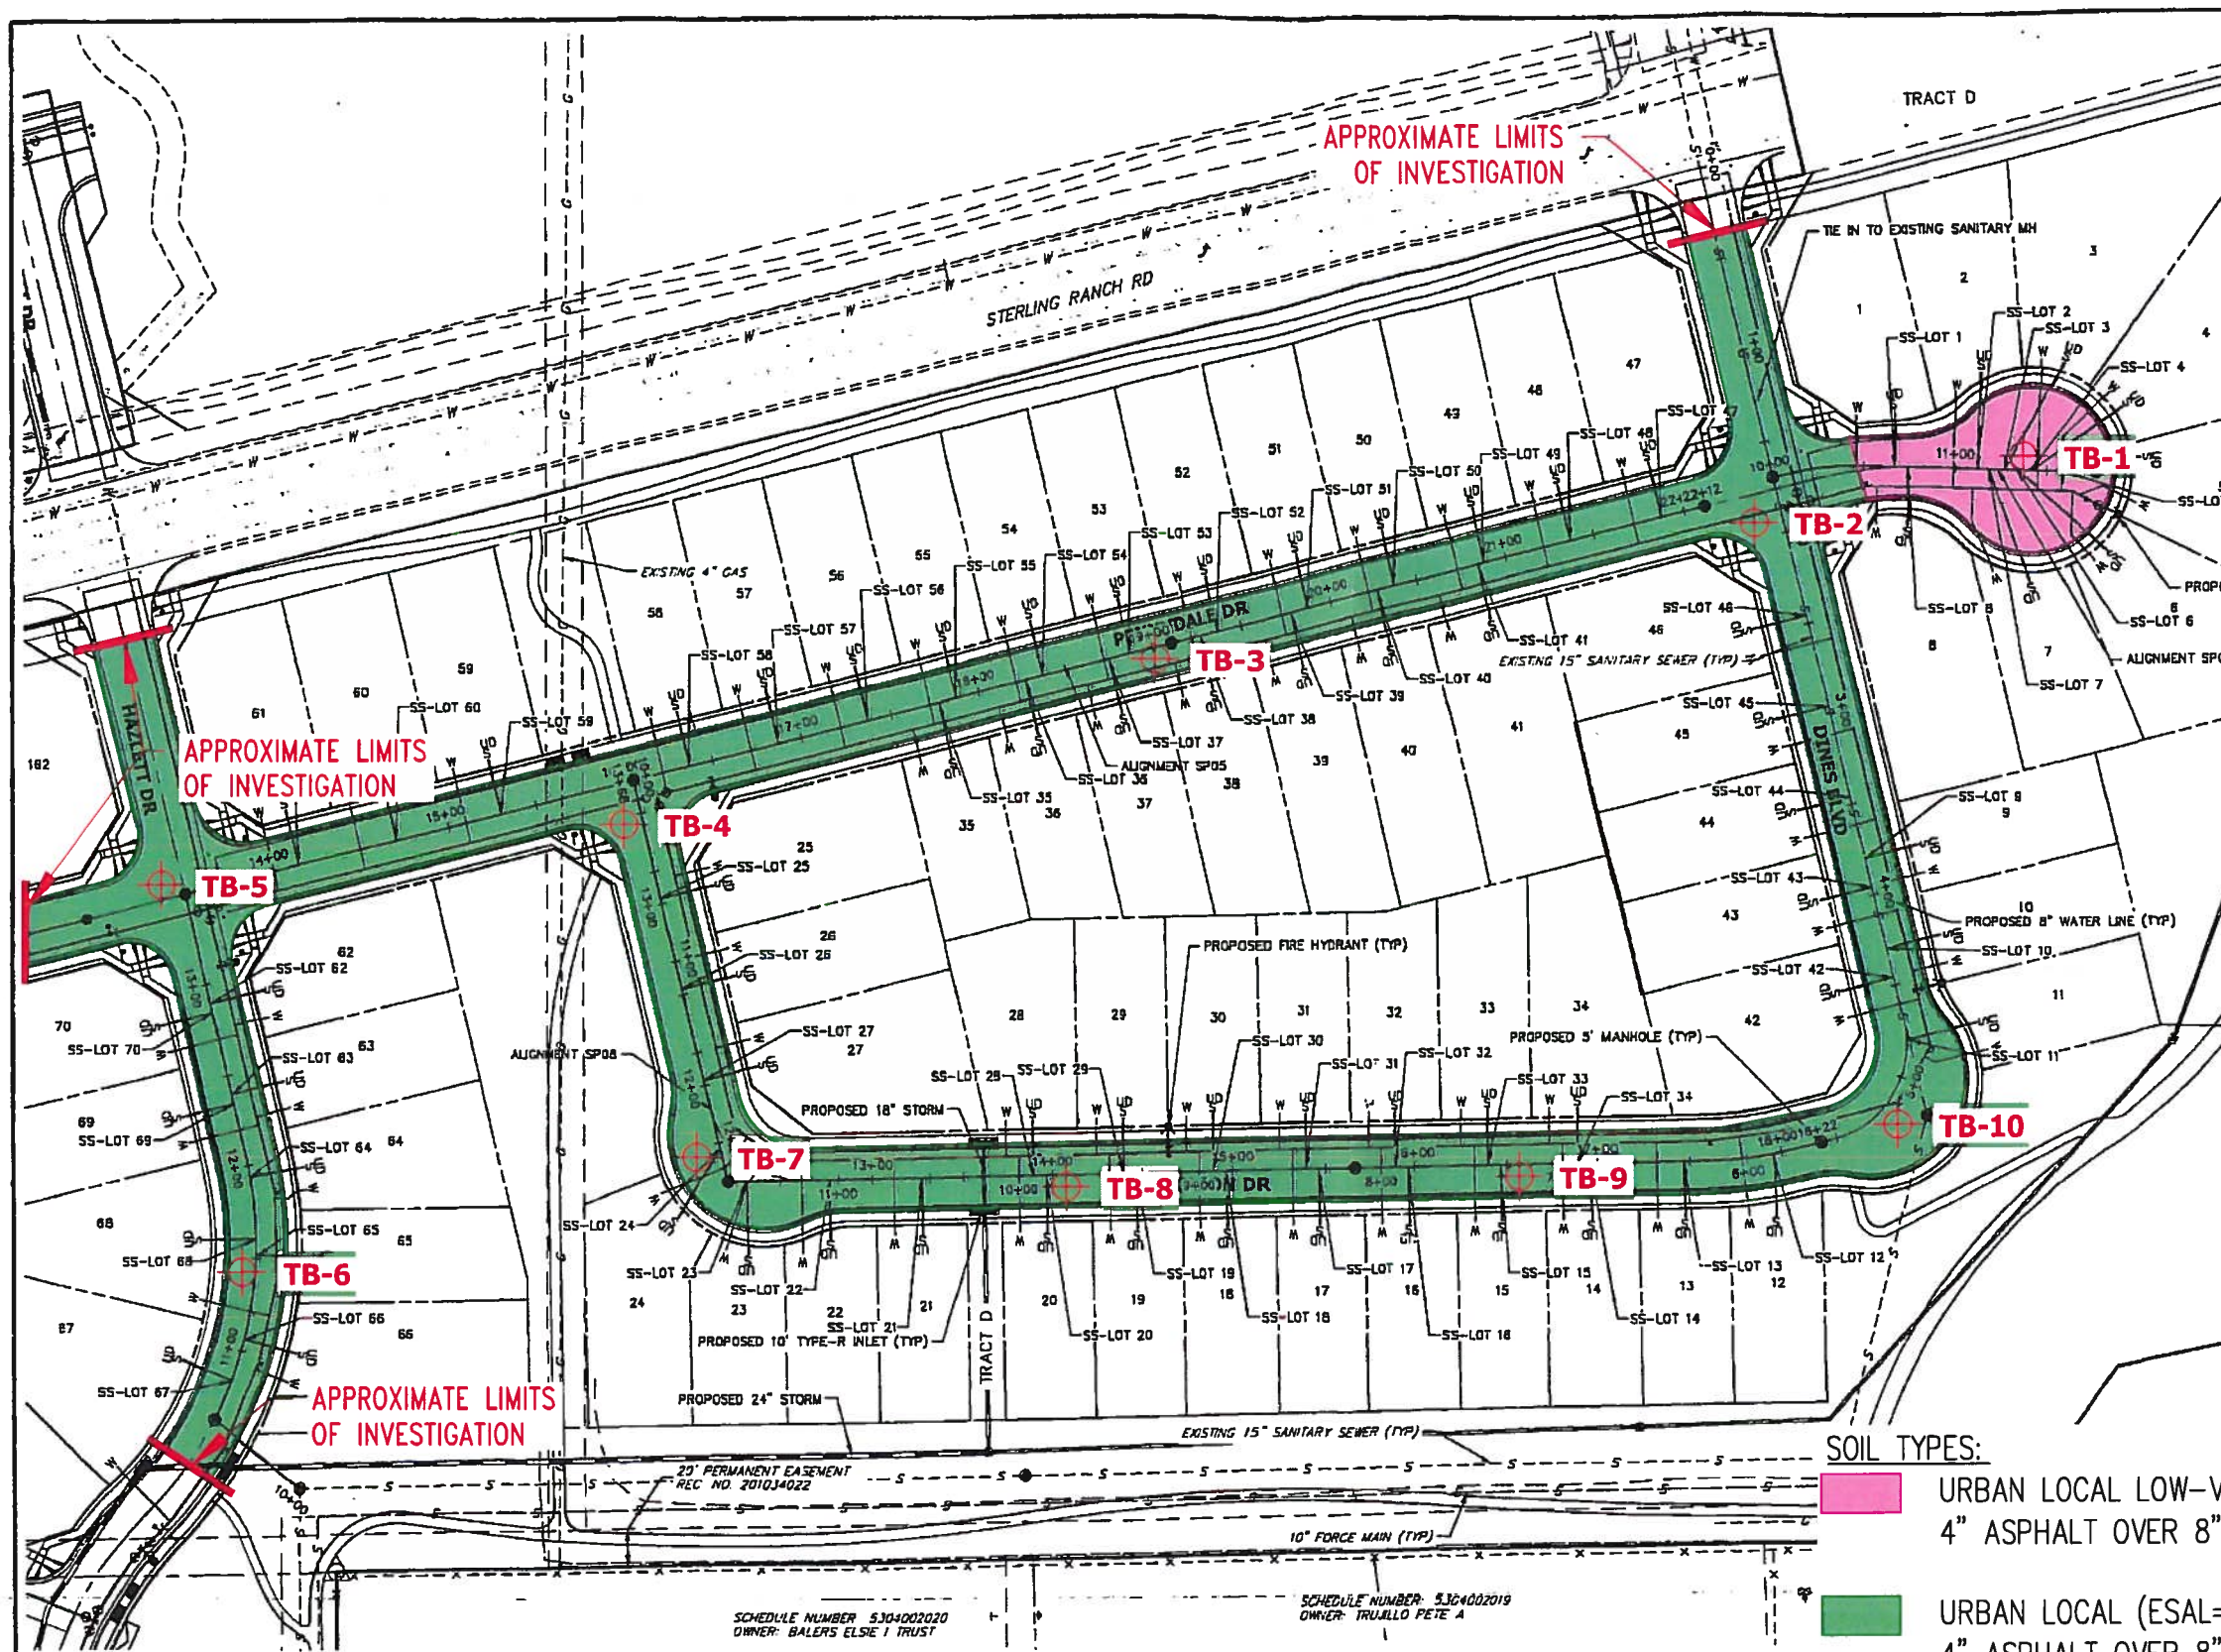

- SOIL TYPES:
- URBAN LOCAL LOW-VOLUME (ESAL=36,500)
4" ASPHALT OVER 8" OF CTS
 - URBAN LOCAL (ESAL=292,000)
4" ASPHALT OVER 8" OF CTS

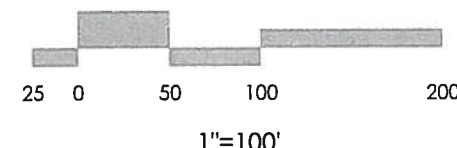

-SEE REPORT FOR
COMPOSITE SECTIONS

 **TB- APPROXIMATE TEST BORING LOCATIONS AND NUMBERS**

SCHEDULE NUMBER: 5304002020
OWNER: BALERS ELSIE I TRUST

SCHEDULE NUMBER: 5304002019
OWNER: TRULLIO PETE A

APPENDIX A: Test Boring Logs

TEST BORING NO. 1
 DATE DRILLED 6/8/2022
 Job # 221370

TEST BORING NO. 2
 DATE DRILLED 6/8/2022
 CLIENT SR LAND, LLC
 LOCATION STERLING RANCH, FILING 3

REMARKS

DRY TO 10', 6/8/22

FILL 0-8', SAND, CLAYEY, FINE
 TO MEDIUM GRAINED, BROWN,
 MEDIUM DENSE, MOIST

SANDSTONE, SILTY, FINE TO
 COARSE GRAINED, GRAY
 BROWN, VERY DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
			16	8.1	1
5			17	8.4	1
10			50 11"	9.0	2
15					
20					

REMARKS

DRY TO 5', 6/8/22

FILL 0-5', SAND, CLAYEY, FINE
 TO MEDIUM GRAINED, BROWN,
 MEDIUM DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
			21	4.5	1
5			28	6.5	1
10					
15					
20					



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

TEST BORING LOG

DRAWN:

DATE:

CHECKED:

DATE:

59

6/24/22

JOB NO.:
 221370

FIG NO.:
 A- 1

TEST BORING NO. 3
 DATE DRILLED 6/8/2022
 Job # 221370

TEST BORING NO. 4
 DATE DRILLED 6/8/2022
 CLIENT SR LAND, LLC
 LOCATION STERLING RANCH, FILING 3

REMARKS

DRY TO 5', 6/8/22

FILL 0-5', SAND, CLAYEY, FINE
 TO MEDIUM GRAINED, BROWN,
 MEDIUM DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
5			15	10.8	1
5			14	4.4	1
10					
15					
20					

REMARKS

DRY TO 10', 6/8/22

FILL 0-8', SAND, SILTY, FINE TO
 COARSE GRAINED, TAN, MEDIUM
 DENSE, MOIST

SANDSTONE, SILTY, FINE TO
 COARSE GRAINED, GRAY BROWN,
 VERY DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
5			10	9.2	1
5			15	10.4	1
10			50 9"	11.8	2
15					
20					



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

TEST BORING LOG

DRAWN:

DATE:

CHECKED:

DATE:

DS 6/24/22

JOB NO.:
 221370

FIG NO.:
 A- 2

TEST BORING NO. 5
DATE DRILLED 6/8/2022
Job # 221370

TEST BORING NO. 6
DATE DRILLED 6/8/2022
CLIENT SR LAND, LLC
LOCATION STERLING RANCH, FILING 3

REMARKS

DRY TO 5', 6/8/22

FILL 0-5', SAND, SILTY, FINE TO
COARSE GRAINED, TAN, MEDIUM
DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
5			14	9.1	1
5			16	5.4	1
10					
15					
20					

REMARKS

DRY TO 5', 6/8/22

FILL 0-5', SAND, SILTY, FINE TO
COARSE GRAINED, TAN, MEDIUM
DENSE, MOIST

FILL, SAND, CLAYEY, FINE TO
MEDIUM GRAINED, BROWN,
MEDIUM DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
5			12	3.6	1
5			14	15.1	1
10					
15					
20					



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

TEST BORING LOG

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/24/22

JOB NO.:
221370

FIG NO.:
A- 3

TEST BORING NO. 7
 DATE DRILLED 6/8/2022
 Job # 221370

TEST BORING NO. 8
 DATE DRILLED 6/8/2022
 CLIENT SR LAND, LLC
 LOCATION STERLING RANCH, FILING 3

REMARKS

DRY TO 5', 6/8/22

FILL 0-5', SAND, SLIGHTLY SILTY,
 FINE TO COARSE GRAINED, TAN,
 LOOSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
5			7	6.4	1
6			6	11.0	1
10					
15					
20					

REMARKS

DRY TO 5', 6/8/22

FILL 0-8', SAND, SILTY, FINE TO
 COARSE GRAINED, BROWN,
 MEDIUM DENSE, MOIST
 FILL, SAND, CLAYEY, FINE TO
 COARSE GRAINED, BROWN,
 DENSE, MOIST

SILTSTONE, VERY SANDY, GRAY
 BROWN, HARD, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
5			18	10.8	1
6			33	18.9	1
10			50 10"	17.0	3
15					
20					



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

TEST BORING LOG

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/24/22

JOB NO.:
 221370

FIG NO.:
 A- 4

TEST BORING NO. 9
 DATE DRILLED 6/8/2022
 Job # 221370

TEST BORING NO. 10
 DATE DRILLED 6/8/2022
 CLIENT SR LAND, LLC
 LOCATION STERLING RANCH, FILING 3

REMARKS

DRY TO 5', 6/8/22

FILL 0-4', SAND, SLIGHTLY SILTY,
 FINE TO COARSE GRAINED, TAN,
 DENSE, MOIST

SANDSTONE, SILTY, FINE TO
 COARSE GRAINED, TAN, VERY
 DENSE, MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
			35	9.3	1
5			50 8"	6.3	2
10					
15					
20					

REMARKS

DRY TO 5', 6/8/22

FILL 0-5', SAND, CLAYEY, FINE
 TO MEDIUM GRAINED, BROWN,
 MEDIUM DENSE TO LOOSE,
 MOIST

Depth (ft)	Symbol	Samples	Blows per foot	Watercontent %	Soil Type
			25	5.9	1
5			7	13.2	1
10					
15					
20					



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

TEST BORING LOG

DRAWN:

DATE:

CHECKED:

DATE:

PS


6/24/22

JOB NO.:
 221370

FIG NO.:
 A- 5

APPENDIX B: Laboratory Testing Results

<u>UNIFIED CLASSIFICATION</u>	SC	<u>CLIENT</u>	SR LAND, LLC
<u>SOIL TYPE #</u>	1, CBR	<u>PROJECT</u>	STERLING RANCH, FILING 3
<u>TEST BORING #</u>	3	<u>JOB NO.</u>	221370
<u>DEPTH (FT)</u>	0-3	<u>TEST BY</u>	BL
<u>AASHTO CLASSIFICATION</u>	A-2-6	<u>GROUP INDEX</u>	1

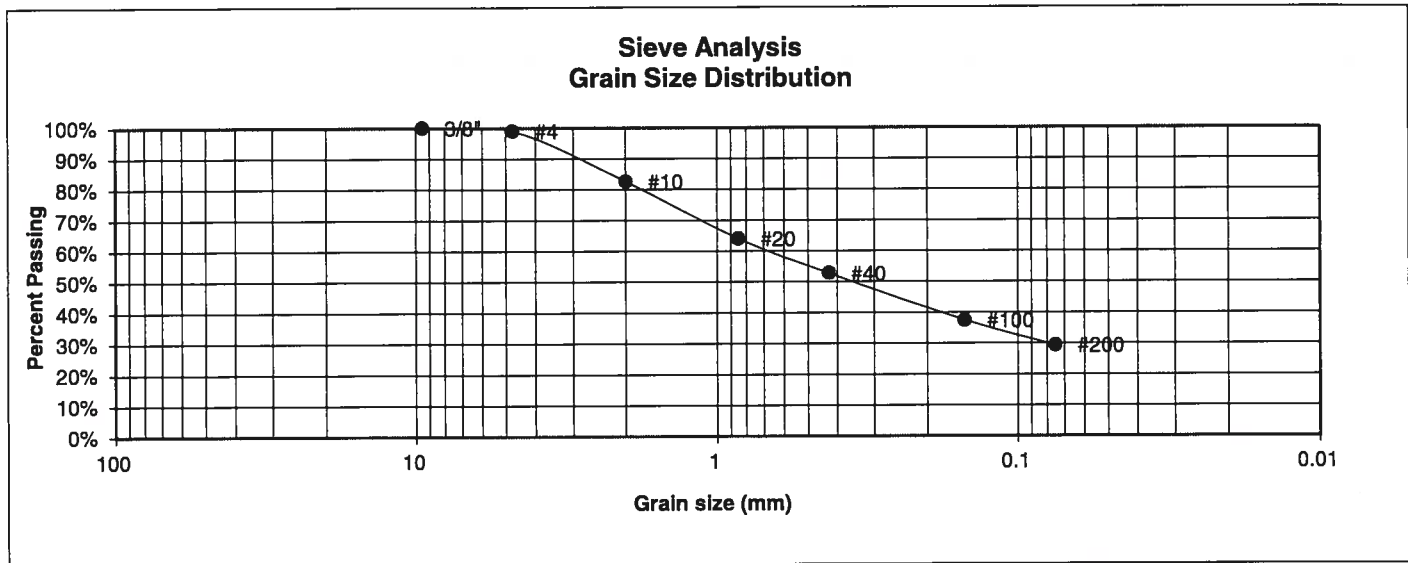

<u>U.S. Sieve #</u>	<u>Percent Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	99.0%
10	82.6%
20	64.0%
40	52.8%
100	37.5%
200	29.3%

<u>Atterberg Limits</u>	
Plastic Limit	12
Liquid Limit	30
Plastic Index	18

<u>Swell</u>	
Moisture at start	
Moisture at finish	
Moisture increase	
Initial dry density (pcf)	
Swell (psf)	



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED:

DS

DATE:

6/24/22

JOB NO.:

221370


FIG NO.:

B-1

UNIFIED CLASSIFICATION SC
SOIL TYPE # 1
TEST BORING # 1
DEPTH (FT) 1-2
AASHTO CLASSIFICATION A-2-6

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

**Sieve Analysis
Grain Size Distribution**

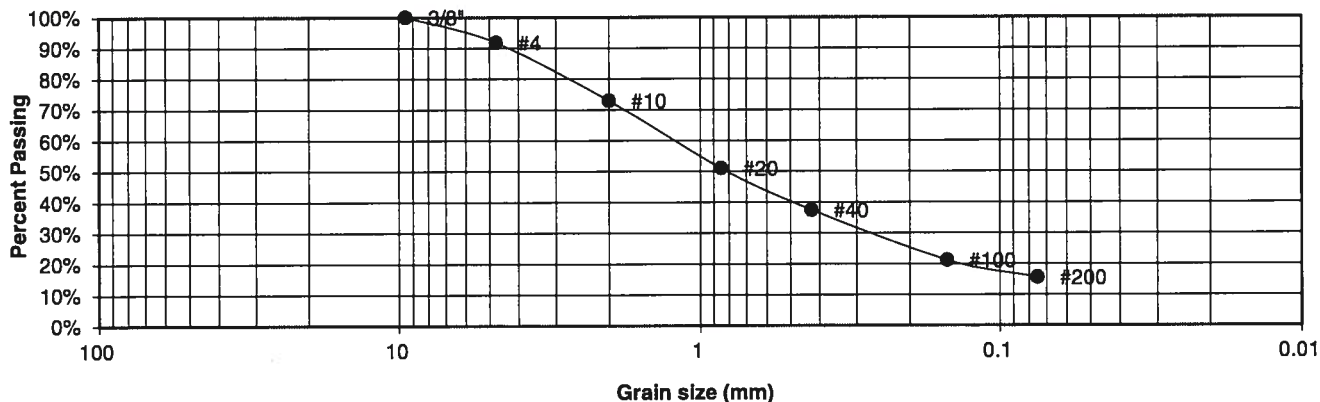

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	91.8%
10	73.0%
20	51.0%
40	37.5%
100	21.1%
200	15.6%

Atterberg
Limits
 Plastic Limit 13
 Liquid Limit 29
 Plastic Index 17

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

**LABORATORY TEST
RESULTS**

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/24/22

JOB NO.:

221370


FIG NO.:

B-2

UNIFIED CLASSIFICATION SC
SOIL TYPE # 1
TEST BORING # 2
DEPTH (FT) 1-2
AASHTO CLASSIFICATION A-2-6

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

**Sieve Analysis
Grain Size Distribution**

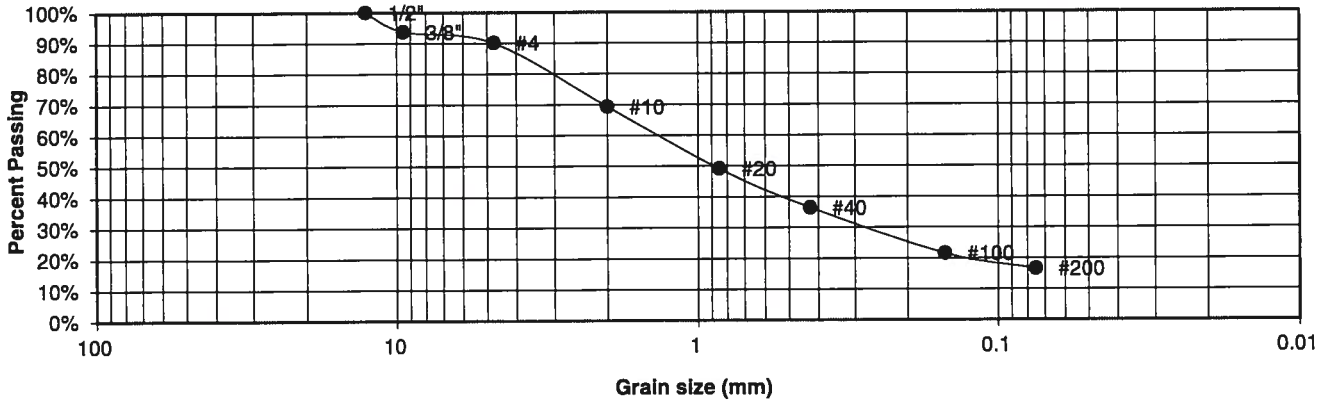

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	93.7%
4	90.1%
10	69.3%
20	49.1%
40	36.4%
100	21.5%
200	16.6%

**Atterberg
Limits**
 Plastic Limit 15
 Liquid Limit 30
 Plastic Index 15

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

**LABORATORY TEST
RESULTS**

DRAWN:

DATE:

CHECKED: *DS*

DATE: *6/24/22*

JOB NO.:


221370
 FIG NO.:

B-3

UNIFIED CLASSIFICATION SC
SOIL TYPE # 1
TEST BORING # 3
DEPTH (FT) 1-2
AASHTO CLASSIFICATION A-2-6

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

Sieve Analysis Grain Size Distribution

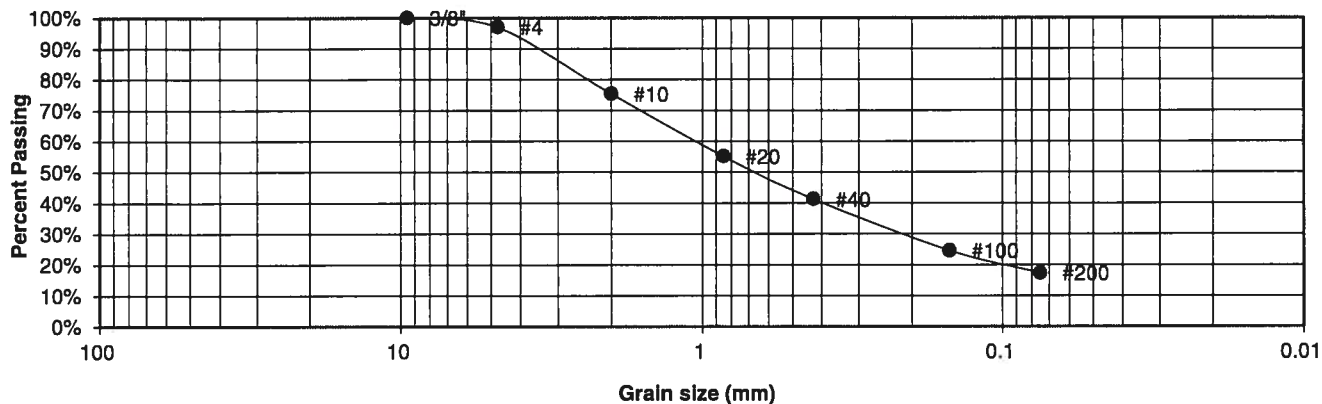

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	97.0%
10	75.4%
20	55.1%
40	41.2%
100	24.5%
200	17.3%

Atterberg
Limits
 Plastic Limit 18
 Liquid Limit 30
 Plastic Index 12

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/24/22

JOB NO.:


221370

FIG NO.:

B-4

<u>UNIFIED CLASSIFICATION</u>	SM	<u>CLIENT</u>	SR LAND, LLC
<u>SOIL TYPE #</u>	1	<u>PROJECT</u>	STERLING RANCH, FILING 3
<u>TEST BORING #</u>	4	<u>JOB NO.</u>	221370
<u>DEPTH (FT)</u>	1-2	<u>TEST BY</u>	BL
<u>AASHTO CLASSIFICATION</u>	A-1-b	<u>GROUP INDEX</u>	0

**Sieve Analysis
Grain Size Distribution**

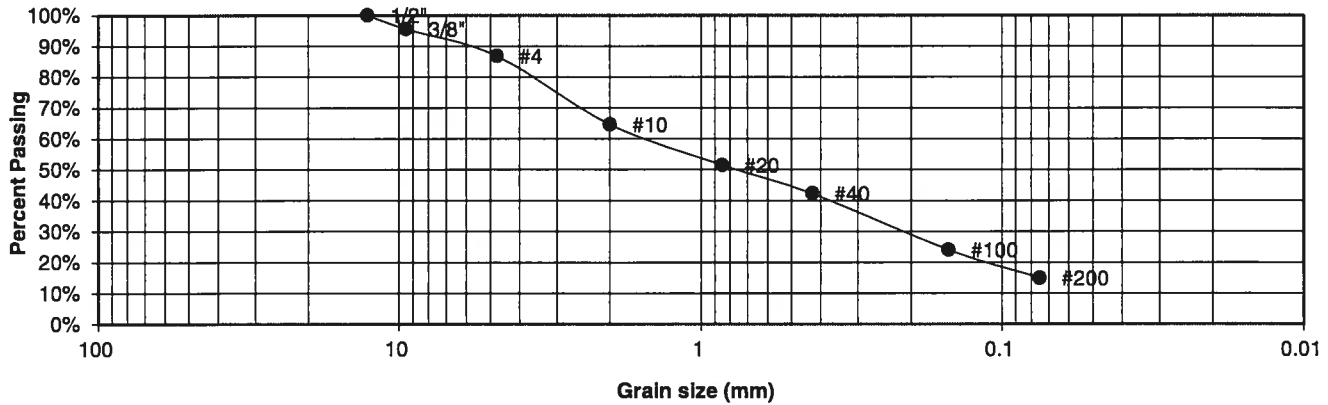

<u>U.S. Sieve #</u>	<u>Percent Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	95.5%
4	86.8%
10	64.6%
20	51.5%
40	42.3%
100	24.0%
200	15.0%

<u>Atterberg Limits</u>	
Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

<u>Swell</u>	
Moisture at start	
Moisture at finish	
Moisture increase	
Initial dry density (pcf)	
Swell (psf)	



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

**LABORATORY TEST
RESULTS**


<u>DRAWN:</u>	<u>DATE:</u>	<u>CHECKED:</u>	<u>DATE:</u>
		DS	6/24/22

JOB NO.:

221370
FIG NO.:

B-5

<u>UNIFIED CLASSIFICATION</u>	SM	<u>CLIENT</u>	SR LAND, LLC
<u>SOIL TYPE #</u>	1	<u>PROJECT</u>	STERLING RANCH, FILING 3
<u>TEST BORING #</u>	5	<u>JOB NO.</u>	221370
<u>DEPTH (FT)</u>	1-2	<u>TEST BY</u>	BL
<u>AASHTO CLASSIFICATION</u>	A-2-4	<u>GROUP INDEX</u>	0

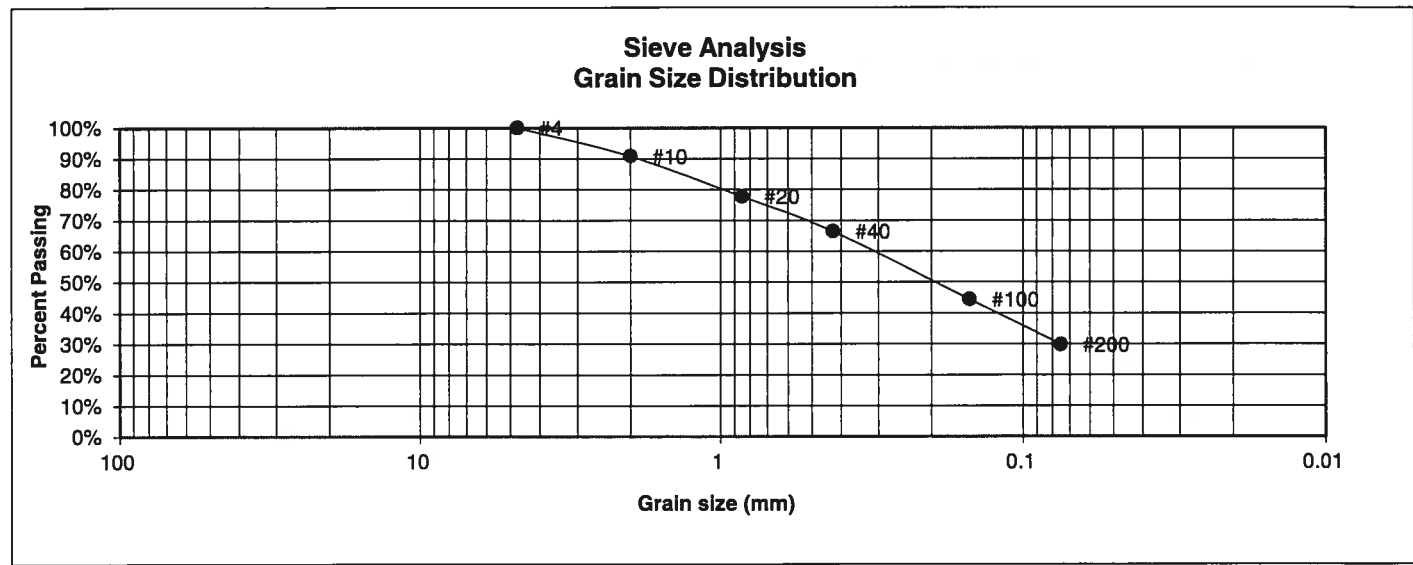

<u>U.S. Sieve #</u>	<u>Percent Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	90.8%
20	77.8%
40	66.5%
100	44.4%
200	29.8%

<u>Atterberg Limits</u>	
Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

<u>Swell</u>
Moisture at start
Moisture at finish
Moisture increase
Initial dry density (pcf)
Swell (psf)



**ENTECH
ENGINEERING, INC.**
505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907


**LABORATORY TEST
RESULTS**

DRAWN:	DATE:	CHECKED:	DATE:
		DS	6/24/22

JOB NO.:
221370
FIG NO.:
B-6

UNIFIED CLASSIFICATION	SM	CLIENT	SR LAND, LLC
SOIL TYPE #	1	PROJECT	STERLING RANCH, FILING 3
TEST BORING #	6	JOB NO.	221370
DEPTH (FT)	1-2	TEST BY	BL
AASHTO CLASSIFICATION	A-1-b	GROUP INDEX	0

Sieve Analysis Grain Size Distribution

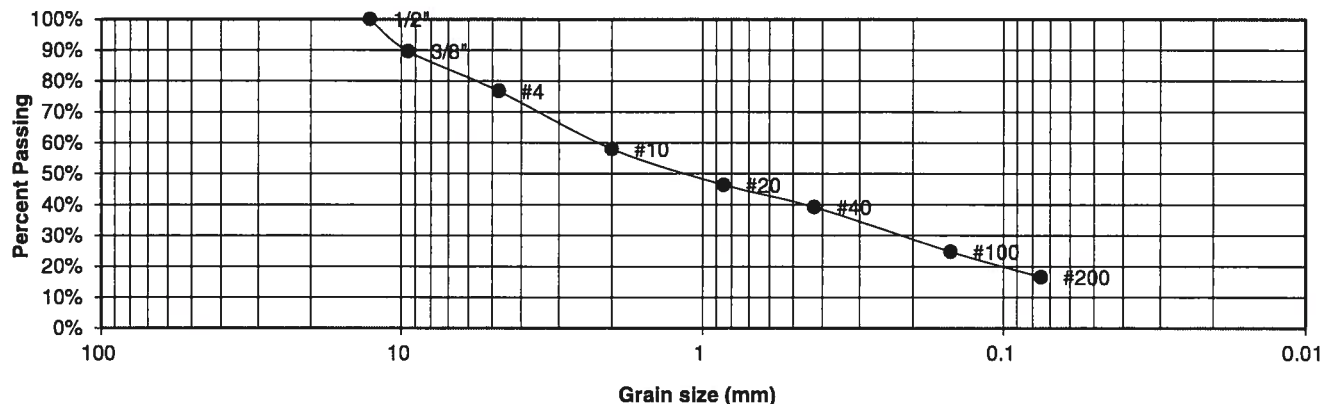

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	89.6%
4	76.7%
10	58.0%
20	46.4%
40	39.2%
100	24.8%
200	16.6%

Atterberg Limits	
Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

Swell	
Moisture at start	
Moisture at finish	
Moisture increase	
Initial dry density (pcf)	
Swell (psf)	



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED: *DS*

DATE: *6/24/22*

JOB NO.:


221370

FIG NO.:

B-7

<u>UNIFIED CLASSIFICATION</u>	SM-SW	<u>CLIENT</u>	SR LAND, LLC
<u>SOIL TYPE #</u>	1	<u>PROJECT</u>	STERLING RANCH, FILING 3
<u>TEST BORING #</u>	7	<u>JOB NO.</u>	221370
<u>DEPTH (FT)</u>	1-2	<u>TEST BY</u>	BL
<u>AASHTO CLASSIFICATION</u>	A-1-b	<u>GROUP INDEX</u>	0

**Sieve Analysis
Grain Size Distribution**

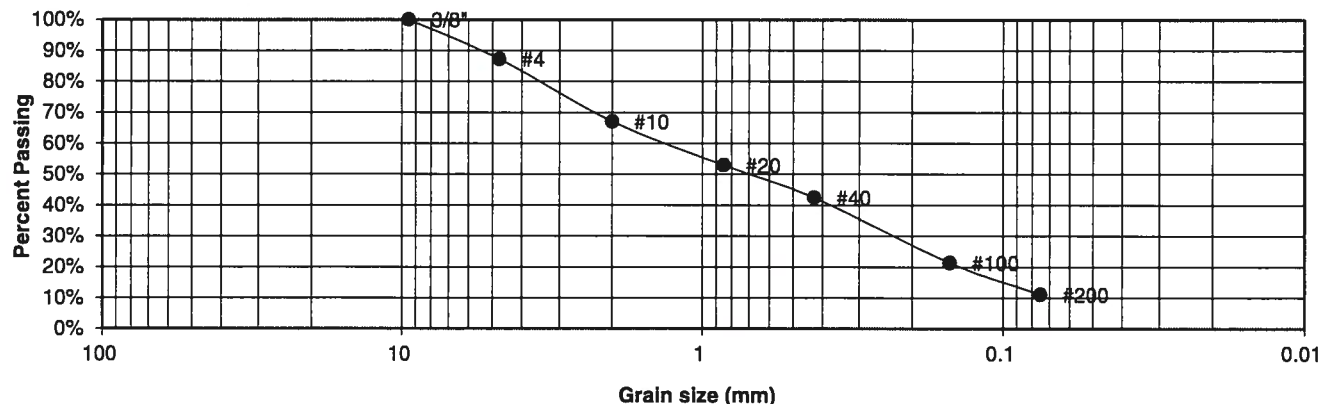

<u>U.S. Sieve #</u>	<u>Percent Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	87.2%
10	67.0%
20	52.9%
40	42.4%
100	21.3%
200	11.1%

<u>Atterberg Limits</u>	
Plastic Limit	NP
Liquid Limit	NV
Plastic Index	NP

<u>Swell</u>	
Moisture at start	
Moisture at finish	
Moisture increase	
Initial dry density (pcf)	
Swell (psf)	



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

**LABORATORY TEST
RESULTS**

DRAWN:	DATE:	CHECKED:	DATE:
		DS	6/24/22

JOB NO.:

221370


FIG NO.:

B-8

UNIFIED CLASSIFICATION SM
SOIL TYPE # 1
TEST BORING # 8
DEPTH (FT) 1-2
AASHTO CLASSIFICATION A-1-b

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

**Sieve Analysis
Grain Size Distribution**

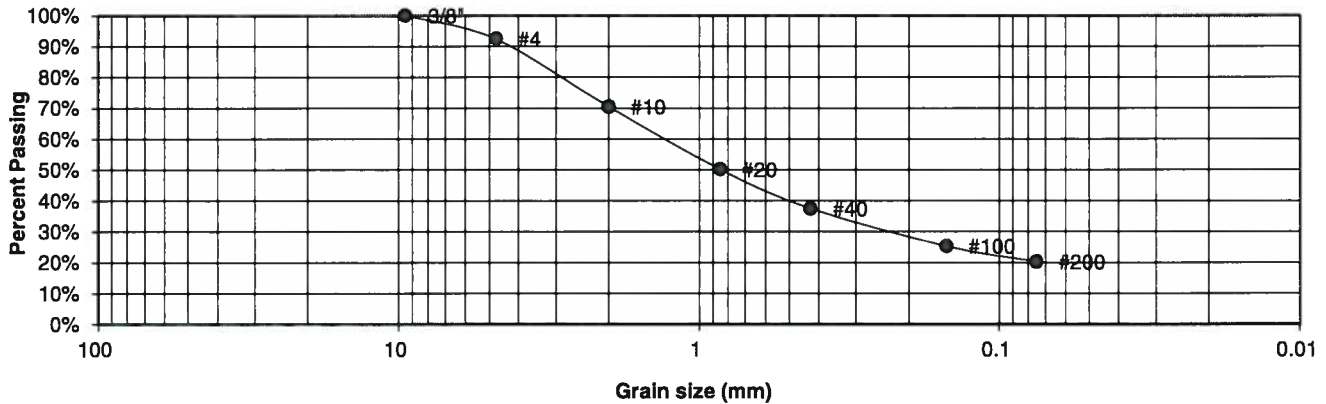

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	92.4%
10	70.5%
20	50.2%
40	37.5%
100	25.3%
200	20.2%

**Atterberg
Limits**
 Plastic Limit NP
 Liquid Limit NV
 Plastic Index NP

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

**LABORATORY TEST
RESULTS**

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/24/22

JOB NO.:

221370


FIG NO.:

B-9

UNIFIED CLASSIFICATION SM-SW
SOIL TYPE # 1
TEST BORING # 9
DEPTH (FT) 1-2
AASHTO CLASSIFICATION A-1-b

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

Sieve Analysis Grain Size Distribution

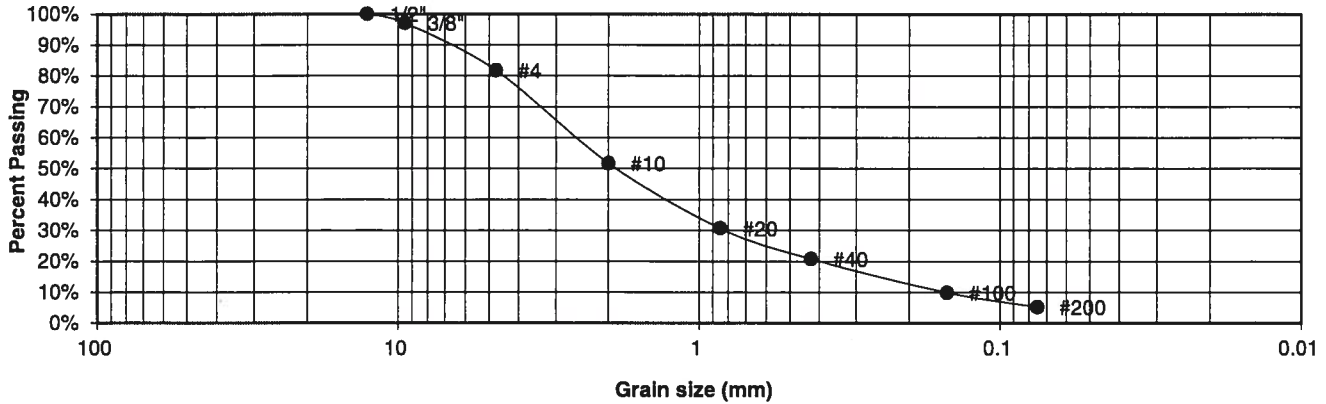

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	97.1%
4	81.7%
10	51.7%
20	30.7%
40	20.7%
100	9.9%
200	5.2%

Atterberg
Limits
 Plastic Limit NP
 Liquid Limit NV
 Plastic Index NP

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED:

DS

DATE:

6/24/22

JOB NO.:

221370


FIG NO.:

B-10

UNIFIED CLASSIFICATION SC
SOIL TYPE # 1
TEST BORING # 10
DEPTH (FT) 1-2
AASHTO CLASSIFICATION A-2-6

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

Sieve Analysis Grain Size Distribution

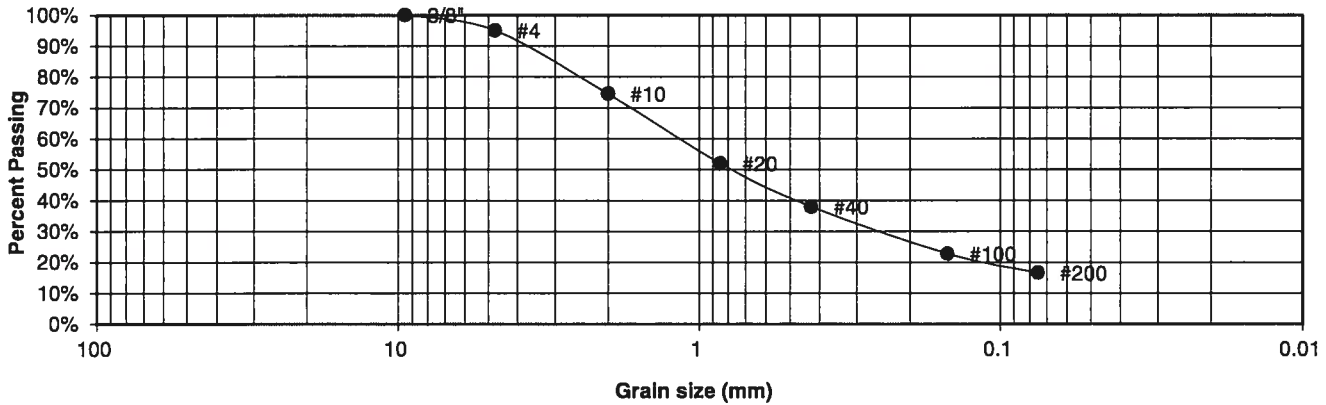

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	95.1%
10	74.5%
20	52.0%
40	38.0%
100	22.7%
200	16.5%

**Atterberg
Limits**
 Plastic Limit 18
 Liquid Limit 28
 Plastic Index 11

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/22/22

JOB NO.:

221370


FIG NO.:

B-11

UNIFIED CLASSIFICATION SM-SW
SOIL TYPE # 2
TEST BORING # 1
DEPTH (FT) 10
AASHTO CLASSIFICATION A-1-b

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

Sieve Analysis Grain Size Distribution

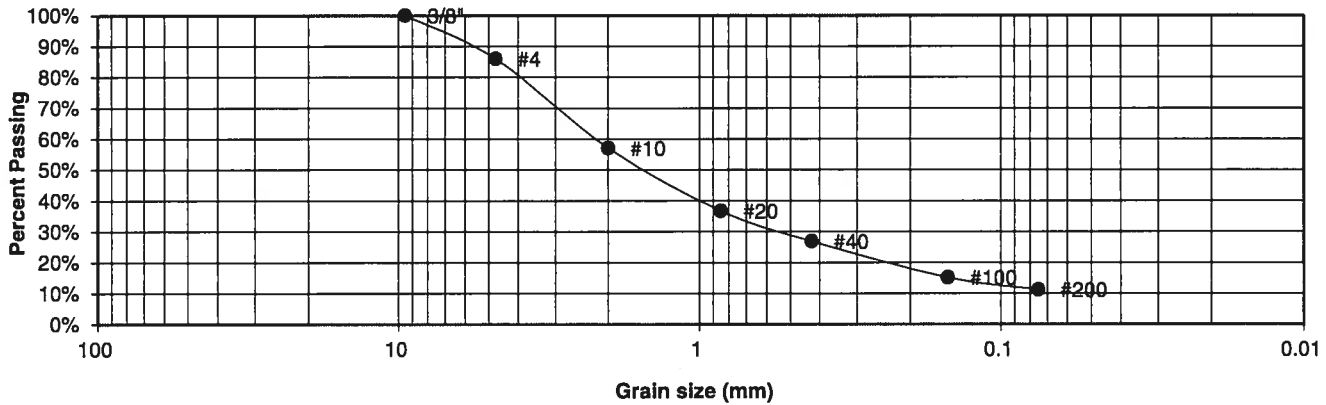

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	100.0%
4	86.0%
10	57.1%
20	36.7%
40	26.9%
100	15.1%
200	11.2%

Atterberg Limits
 Plastic Limit NP
 Liquid Limit NV
 Plastic Index NP

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED: DS

DATE:

6/24/72

JOB NO.:

221370


FIG NO.:

B-12

UNIFIED CLASSIFICATION SM-SW
SOIL TYPE # 2
TEST BORING # 4
DEPTH (FT) 10
AASHTO CLASSIFICATION A-1-b

CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3
JOB NO. 221370
TEST BY BL
GROUP INDEX 0

**Sieve Analysis
Grain Size Distribution**

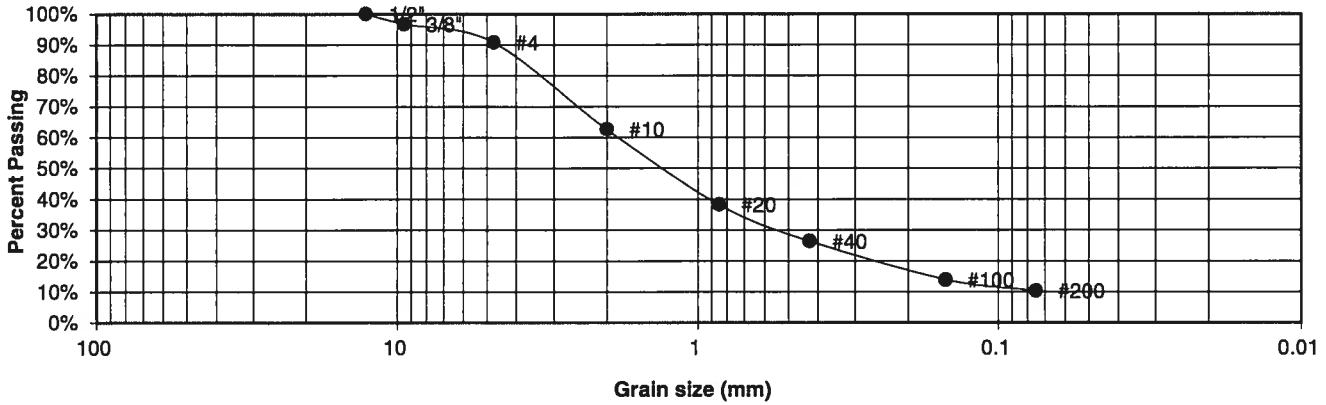

U.S. Sieve #	Percent Finer
3"	
1 1/2"	
3/4"	
1/2"	100.0%
3/8"	96.7%
4	90.8%
10	62.6%
20	38.2%
40	26.4%
100	13.9%
200	10.4%

**Atterberg
Limits**
 Plastic Limit NP
 Liquid Limit NV
 Plastic Index NP

Swell
 Moisture at start
 Moisture at finish
 Moisture increase
 Initial dry density (pcf)
 Swell (psf)



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

**LABORATORY TEST
RESULTS**

DRAWN:

DATE:

CHECKED: *DS*

DATE:


6/24/22

JOB NO.:

221370
FIG NO.:

B-13

<u>UNIFIED CLASSIFICATION</u>	ML	<u>CLIENT</u>	SR LAND, LLC
<u>SOIL TYPE #</u>	3	<u>PROJECT</u>	STERLING RANCH, FILING 3
<u>TEST BORING #</u>	8	<u>JOB NO.</u>	221370
<u>DEPTH (FT)</u>	10	<u>TEST BY</u>	BL
<u>AASHTO CLASSIFICATION</u>	A-7-6	<u>GROUP INDEX</u>	6

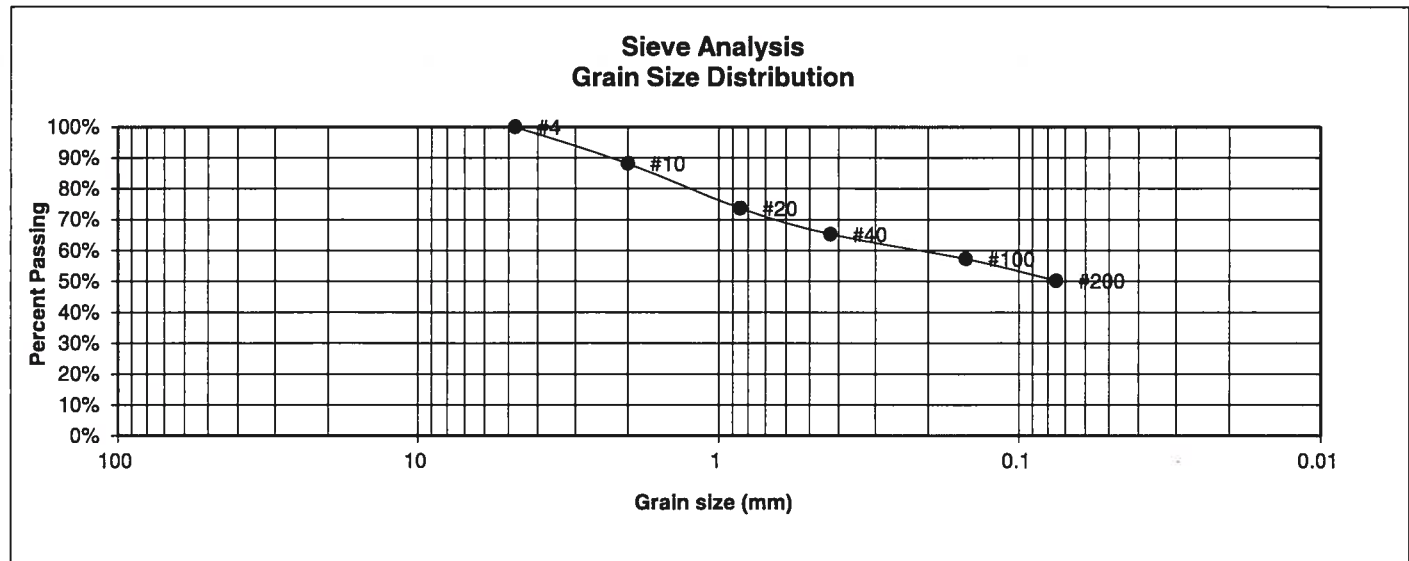

<u>U.S. Sieve #</u>	<u>Percent Finer</u>
3"	
1 1/2"	
3/4"	
1/2"	
3/8"	
4	100.0%
10	88.2%
20	73.7%
40	65.3%
100	57.3%
200	50.2%

<u>Atterberg Limits</u>	
Plastic Limit	28
Liquid Limit	46
Plastic Index	18

<u>Swell</u>	
Moisture at start	
Moisture at finish	
Moisture increase	
Initial dry density (pcf)	
Swell (psf)	



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST RESULTS

DRAWN:

DATE:

CHECKED:

DATE:

6/24/22

JOB NO.:


221370
FIG NO.:

B-14

CONSOLIDATION TEST RESULTS

TEST BORING #	10	DEPTH(ft)	1-2
DESCRIPTION	SC	SOIL TYPE	1
NATURAL UNIT DRY WEIGHT (PCF)	106		
NATURAL MOISTURE CONTENT	11.8%		
SWELL/CONSOLIDATION (%)	0.3%		

JOB NO. 221370
CLIENT SR LAND, LLC
PROJECT STERLING RANCH, FILING 3

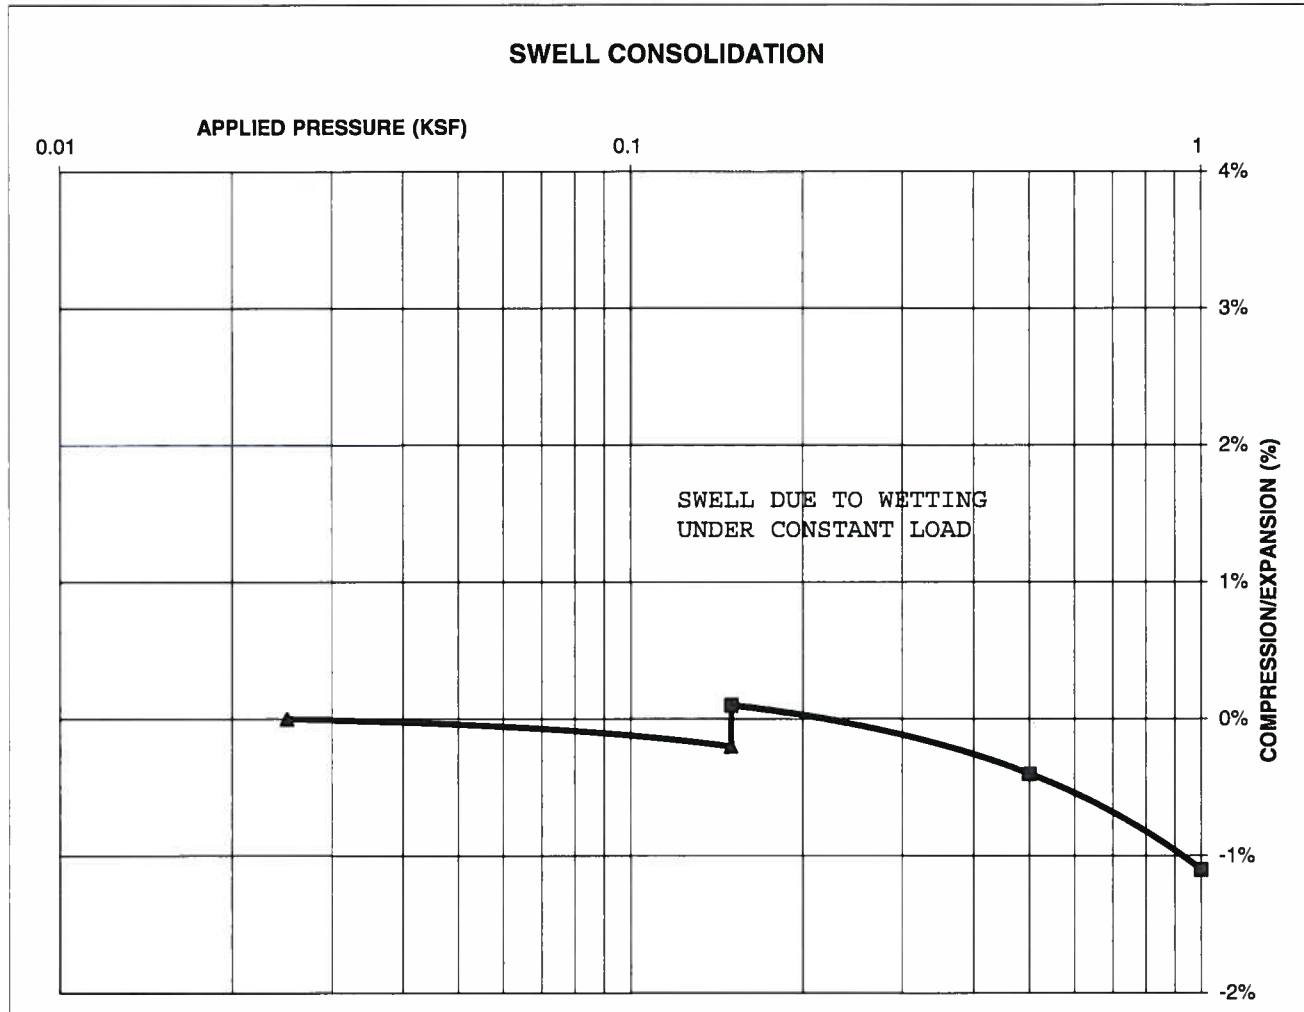

**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

SWELL CONSOLIDATION TEST RESULTS

DRAWN:

DATE:

CHECKED:

DATE:

DS

6/24/22


JOB NO.:
221370

FIG NO.:
B-15

CONSOLIDATION TEST RESULTS

TEST BORING #	8	DEPTH(ft)	10
DESCRIPTION	ML	SOIL TYPE	3
NATURAL UNIT DRY WEIGHT (PCF)	105		
NATURAL MOISTURE CONTENT	17.9%		
SWELL/CONSOLIDATION (%)	3.8%		

JOB NO. 221370
 CLIENT SR LAND, LLC
 PROJECT STERLING RANCH, FILING 3

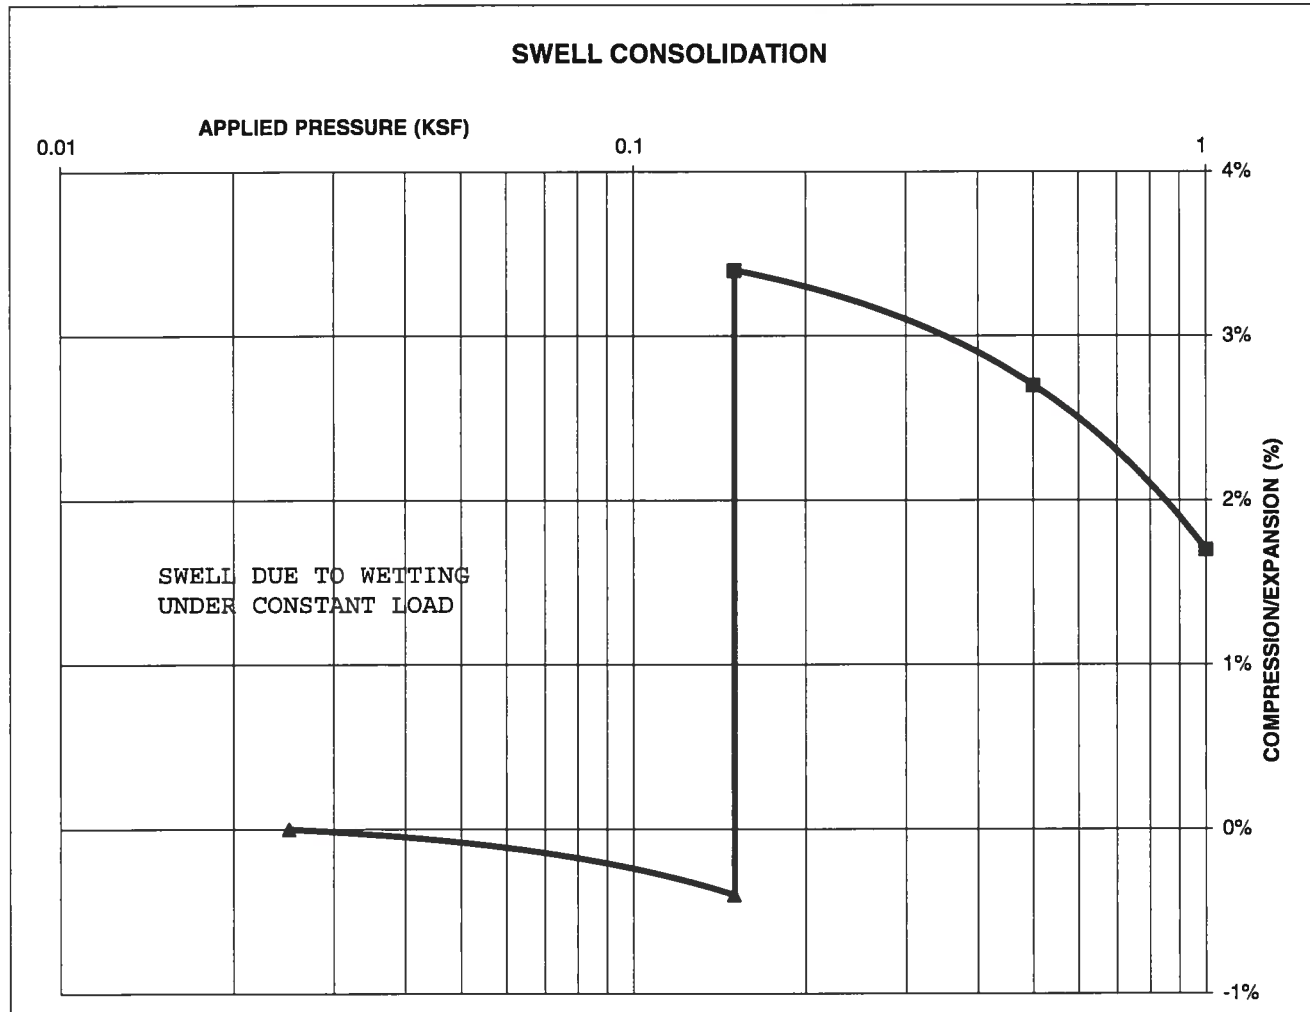

ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

SWELL CONSOLIDATION TEST RESULTS

DRAWN:

DATE:

CHECKED:

DATE:

JOB NO.:
 221370

FIG NO.:
 B-14

CLIENT	SR LAND, LLC	JOB NO.	221370
PROJECT	STERLING RANCH, FILING 3	DATE	6/16/2022
LOCATION	STERLING RANCH, FILING 3	TEST BY	BL

[illegible]

QC BLANK PASS



ENTECH
ENGINEERING, INC.
505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

LABORATORY TEST SULFATE RESULTS

DRAWN:

DATE: _____

CHECKED:

DATE: _____

JOB NO.:


221370

FIG NO.:

B-17

<u>PROJECT</u>	STERLING RANCH, FILING 3	<u>CLIENT</u>	SR LAND, LLC
<u>SAMPLE LOCATION</u>	TB-3 @ 0-3'	<u>JOB NO.</u>	221370
<u>SOIL DESCRIPTION</u>	SAND, CLAYEY, BROWN	<u>DATE</u>	06/09/22

<u>IDENTIFICATION</u>	SC	<u>COMPACTION TEST #</u>	1
<u>TEST DESIGNATION / METHOD</u>	ASTM D-1557-A	<u>TEST BY</u>	AL
<u>MAXIMUM DRY DENSITY (PCF)</u>	130.9	<u>OPTIMUM MOISTURE</u>	8.4%

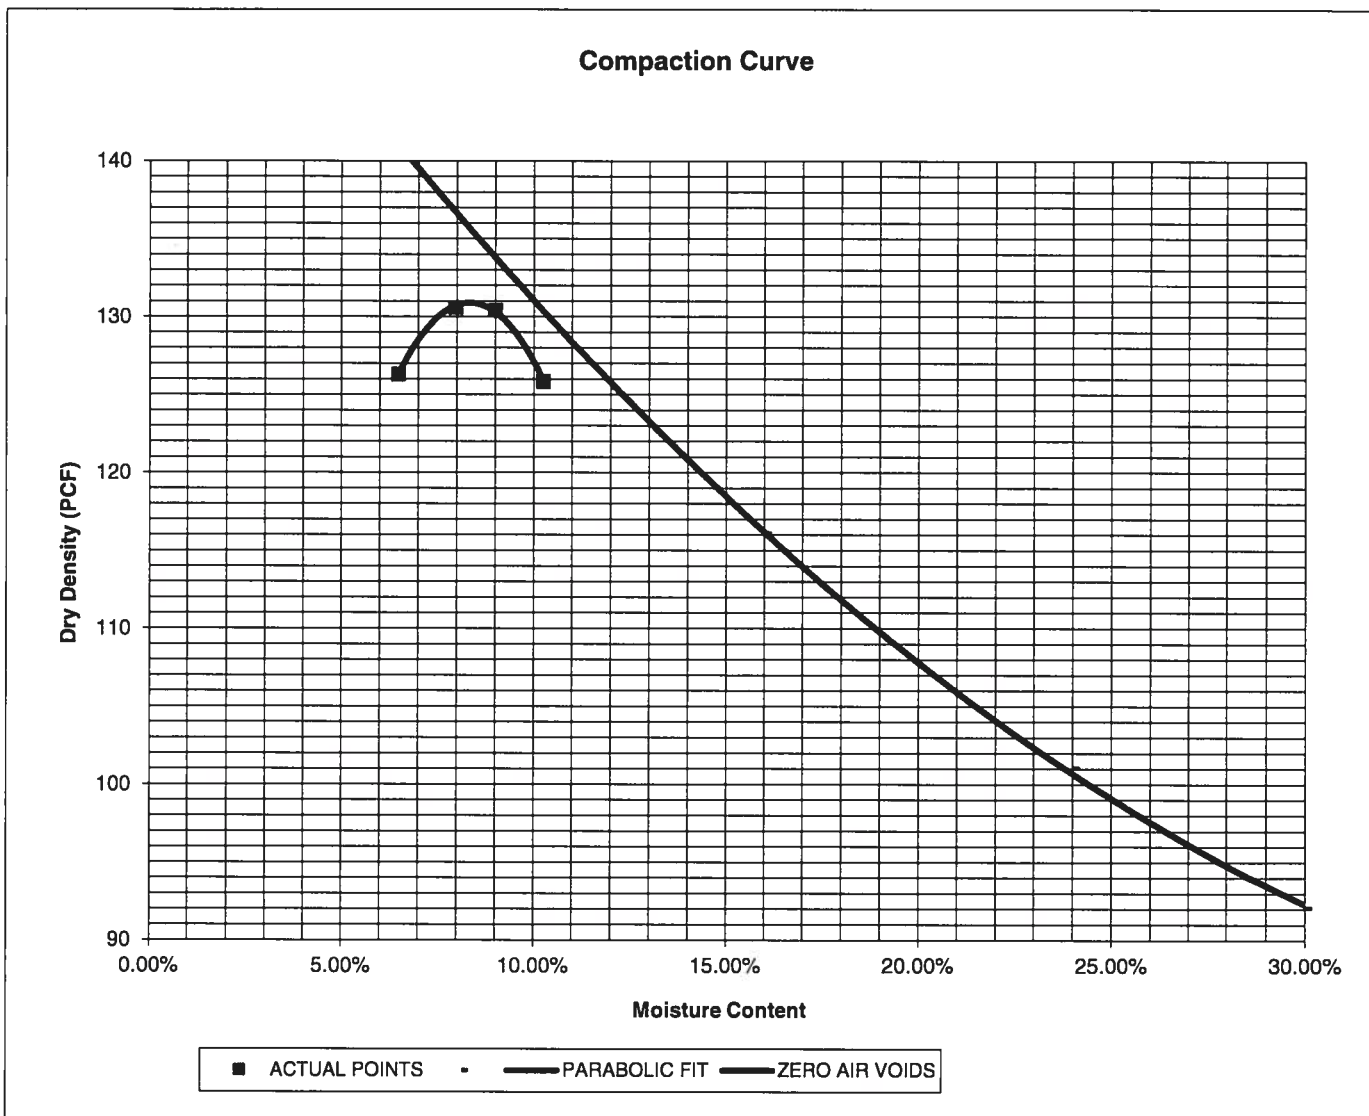

**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

MOISTURE DENSITY RELATION

DRAWN:

DATE:

CHECKED:

DS

DATE:

6/24/22

JOB NO.:

221370

FIG NO.:

B-8

CBR TEST LOAD DATA

JOB NO: 221370
 CLIENT: SR LAND, LLC
 PROJECT: STERLING RANCH, FILING 3
 SOIL TYPE: 1

PISTON DIAMETER (cm)	PISTON AREA (in ²)						
4.958	2.993						
PENETRATION DEPTH (INCHES)	10 BLOWS		25 BLOWS		56 BLOWS		
	MOLD # 1		MOLD # 2		MOLD # 3		
	LOAD(LBS)	STRESS (PSI)	LOAD(LBS)	STRESS (PSI)	LOAD(LBS)	STRESS (PSI)	
0.000	0	0.00	0	0.00	0	0.00	
0.025	141	47.12	178	59.48	199	66.50	
0.050	216	72.18	263	87.89	401	134.00	
0.075	269	89.89	354	118.30	555	185.46	
0.100	384	128.32	510	170.43	710	237.26	
0.125	428	143.02	641	214.20	838	280.03	
0.150	532	177.78	710	237.26	955	319.13	
0.175	625	208.85	739	246.95	1095	365.91	
0.200	719	240.27	899	300.42	1256	419.71	
0.300	901	301.09	1213	405.35	1744	582.79	
0.400	1140	380.95	1596	533.33	2118	707.77	
0.500	1300	434.42	2061	688.72	2611	872.51	

FINAL MOISTURE CONTENT

	MOLD # 1	MOLD # 2	MOLD # 3
CAN #	351	357	352
WT. CAN	7.93	7.88	7.91
WT. CAN+WET	177.32	164.94	190.3
WT. CAN+DRY	156.66	149.4	173.32
WT. H2O	20.66	15.54	16.98
WT. DRY SOIL	148.73	141.52	165.41
MOISTURE CONTENT	13.89%	10.98%	10.27%

WET DENSITY (PCF)	133.7	139.4	142.6
DRY DENSITY (PCF)	123.4	128.6	131.5

BEARING RATIO 12.83 17.04 23.73

90% OF DRY DENSITY 117.8

95% OF DRY DENSITY 124.4

BEARING RATIO AT 90% OF MAX	8.37 ~ R VALUE	22
BEARING RATIO AT 95% OF MAX	13.64 ~ R VALUE	40



ENTECH
ENGINEERING, INC.

505 ELKTON DRIVE
 COLORADO SPRINGS, COLORADO 80907

CBR TEST DATA

DRAWN:

DATE:

CHECKED:

DATE:

DS



6/12/22

JOB NO.:

221370

FIG NO.:

B-19

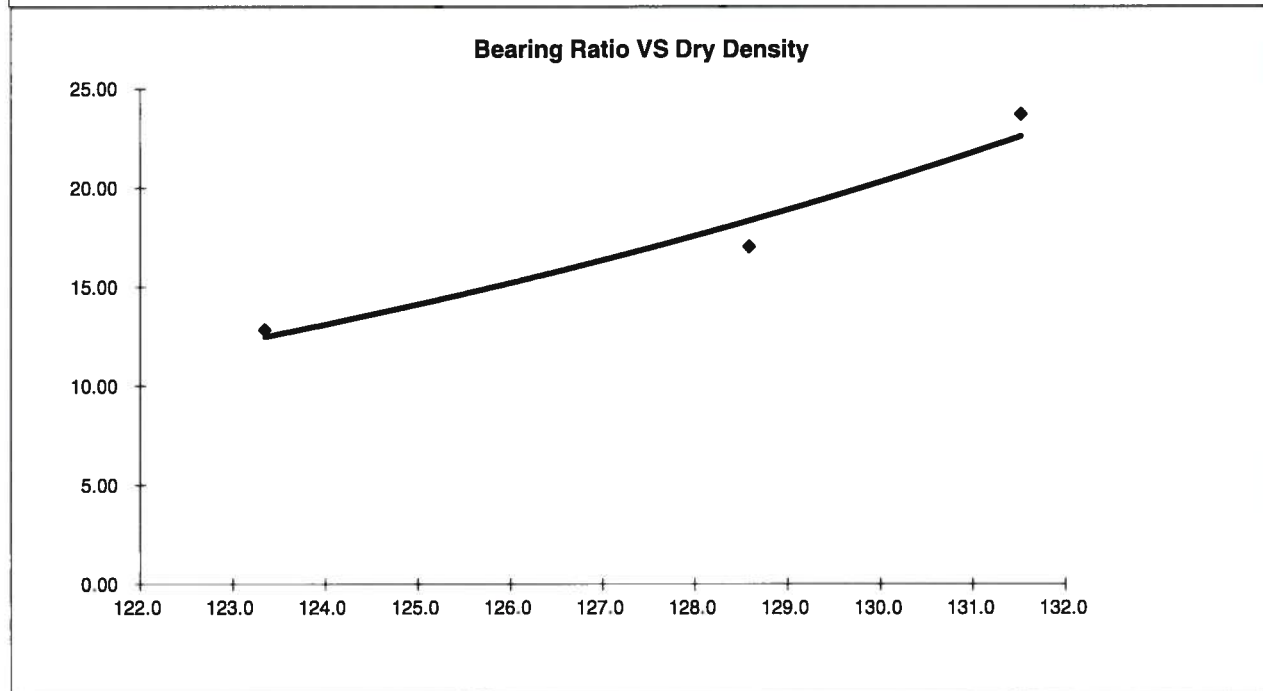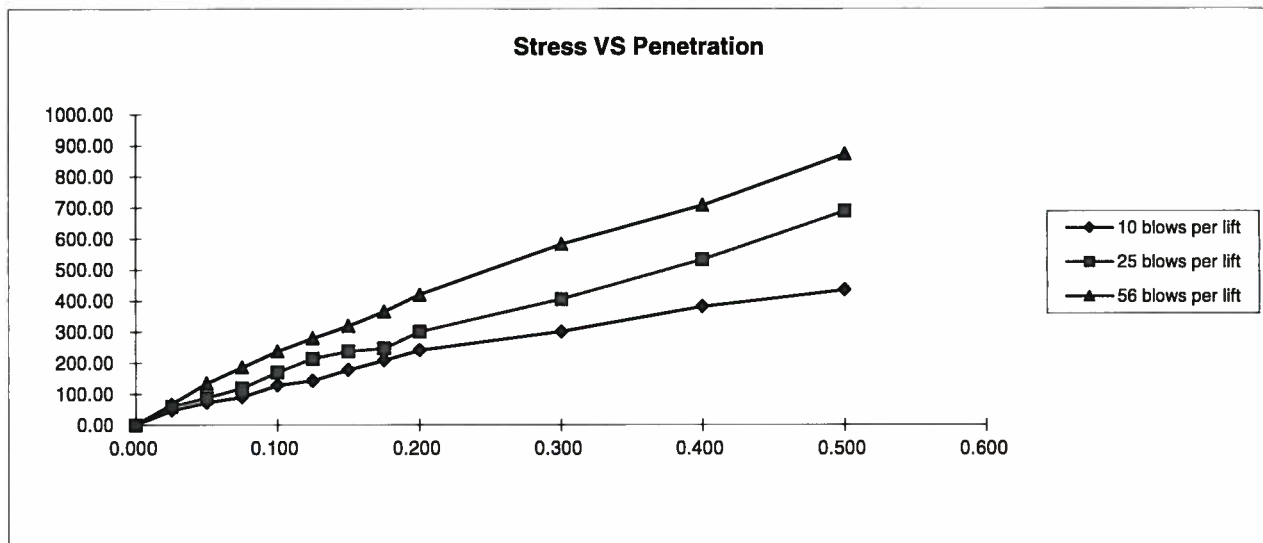

BEARING RATIO AT 90% OF MAX	8.37 ~ R VALUE	22.00
BEARING RATIO AT 95% OF MAX	13.64 ~ R VALUE	40.00

JOB NO: 221370
SOIL TYPE: 1



**ENTECH
ENGINEERING, INC.**

505 ELKTON DRIVE
COLORADO SPRINGS, COLORADO 80907

CALIFORNIA BEARING RATIO

DRAWN:

DATE:

CHECKED:

DS

DATE:

6/24/22

JOB NO: 221370

FIG NO: B-20

APPENDIX C: Pavement Design Calculations

FLEXIBLE PAVEMENT DESIGN

DESIGN DATA

SR LAND, LLC
STERLING RANCH, FILING 3
URBAN LOCAL

Equivalent (18 kip) Single Axle Load Applications (ESAL):
Hveem Stabilometer (R Value) Results:
Standard Deviation
Loss in Serviceability
Reliability
Reliability (z-statistic)
Soil Resilient Modulus

ESAL (W_{18}) =	292,000
R =	40
S_o =	0.45
$\Delta\psi$ =	2.0
Reliability =	80
Z_R =	-0.84
M_R =	9497

Weighted Structural Number (WSN): → WSN = 2.37

DESIGN TABLES AND EQUATIONS

$$S_1 = [(R - 5) / 11.29] + 3$$

$$M_R = 10^{[(S_1 + 18.72) / 6.24]}$$

$$k = M_R / 19.4$$

Where:

M_R = resilient modulus (psi)

S_1 = the soil support value

R = R-value obtained from the Hveem stabilometer

CBR = California Bearing Ratio

Reliability (%) Z_R (z-statistic)

80	-0.84
85	-1.04
90	-1.28
93	-1.48
94	-1.56
95	-1.65
96	-1.75
97	-1.88
98	-2.05
99	-2.33
99.9	-3.09
99.99	-3.75

$$\log_{10} W_{18} = Z_R \cdot S_o + 9.36 \cdot \log_{10} (SN+1) - 0.20 + \frac{\log_{10} \left[\frac{\Delta \text{PSI}}{4.2 - 1.5} \right]}{0.40 + \frac{1094}{(SN+1)^{5.19}}} + 2.32 \cdot \log_{10} M_R - 8.07$$

Left	Right	Difference
5.47	5.47	0.0

Job No. 221370

Fig. No. C-1

DESIGN CALCULATIONS

DESIGN DATA SR LAND, LLC
 STERLING RANCH, FILING 3
 URBAN LOCAL

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL = 292,000
Hveem Stabilometer (R Value) Results:	R = 40
Weighted Structural Number (WSN):	WSN = 2.37

DESIGN EQUATION

$$WSN = C_1 D_1 + C_2 D_2$$

$C_1 = 0.44$ Strength Coefficient - Hot Bituminous Asphalt

$C_2 = 0.11$ Strength Coefficient - Aggregate Basecourse

D_1 = Depth of Asphalt (inches)

D_2 = Depth of Basecourse (inches)

FOR FULL DEPTH ASPHALT SECTION

$D_1 = (WSN)/C_1 = 5.4$ inches of Full Depth Asphalt
Use 5.5 inches Full Depth

FOR ASPHALT + AGGREGATE BASECOURSE SECTION

Asphalt Thickness (t) = 4 inches

$D_2 = ((WSN) - (t)(C_1))/C_2 = 5.5$ inches of Aggregate

Basecourse, use 8.0 inches USE 8 INCHES MINIMUM.

RECOMMENDED ALTERNATIVES

1. 4.0 inches of Asphalt + 8.0 inches of Aggregate Basecourse, or
2. 5.5 inches of Asphalt

Job No. 221370

Fig. No. C-2

DESIGN CALCULATIONS

CEMENT SECTIONS

DESIGN DATA SR LAND, LLC
STERLING RANCH, FILING 3
URBAN LOCAL

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL = 292,000
Hveem Stabilometer (R Value) Results:	R = 40
Weighted Structural Number (WSN):	WSN = 2.37

DESIGN EQUATION

$$WSN = C_1 D_1 + C_2 D_2$$

$C_1 = 0.44$ Strength Coefficient - Hot Bituminous Asphalt

$C_2 = 0.11$ Strength Coefficient - Cement Stabilized Subgrade

D_1 = Depth of Asphalt (inches)

D_2 = Depth of Cement Stabilized Subgrade (inches)

FOR ASPHALT + CEMENT STABILIZED SUBGRADE SECTION

Asphalt Thickness (t) = 4 inches

$D_2 = ((WSN) - (t)(C_1))/C_2 = 5.5$ inches of Cement Stabilized Subgrade

Cement Stabilized Subgrade, Use 8.0 inches minimum

RECOMMENDED ALTERNATIVES

1. 4.0 inches of Asphalt + 8.0 inches of Cement Stabilized Subgrade

Job No. 221370

Fig. No. C-3

DESIGN CALCULATIONS

RECYCLED CONCRETE

DESIGN DATA

STERLING RANCH - SOIL TYPE 3
URBAN LOCAL

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL = 292,000
Hveem Stabilometer (R Value) Results:	R = 40
Weighted Structural Number (WSN):	WSN = 2.37

DESIGN EQUATION

$$WSN = C_1 D_1 + C_2 D_2$$

$C_1 = 0.44$ Strength Coefficient - Hot Bituminous Asphalt

$C_2 = 0.09$ Strength Coefficient - Recycled Concrete

D_1 = Depth of Asphalt (inches)

D_2 = Depth of Recycled Concrete (inches)

FOR FULL DEPTH ASPHALT SECTION

$D_1 = (WSN)/C_1 = 5.4$ inches of Full Depth Asphalt
Use 5.5 inches Full Depth

FOR ASPHALT + AGGREGATE BASE COURSE SECTION

Asphalt Thickness (t) = 4 inches

$D_2 = ((WSN) - (t)(C_1))/C_2 = 6.8$ inches of Recycled Concrete
Recycled Concrete, use 8.0 inches

RECOMMENDED ALTERNATIVES

1. 4.0 inches of Asphalt + 8.0 inches of Recycled Concrete, or
2. 5.5 inches of Asphalt

Job No. 221370
Fig. No. C-4

FLEXIBLE PAVEMENT DESIGN

DESIGN DATA

SR LAND, LLC - SOIL TYPE 3

COLLECTORSURBAN LOCALLOCAL LOW-VOLUME

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL (W_{18}) =	36,500
Hveem Stabilometer (R Value) Results:	R =	40
Standard Deviation	S_o =	0.45
Loss in Serviceability	$\Delta\psi$ =	2.0
Reliability	Reliability =	80
Reliability (z-statistic)	Z_R =	-0.84
Soil Resilient Modulus	M_R =	9497

Weighted Structural Number (WSN):  WSN = 1.68

DESIGN TABLES AND EQUATIONS

$$S_1 = [(R - 5) / 11.29] + 3$$

$$M_R = 10^{[(S_1 + 18.72) / 6.24]}$$

$$k = M_R / 19.4$$

Where:

M_R = resilient modulus (psi)

S_1 = the soil support value

R = R-value obtained from the Hveem stabilometer

CBR = California Bearing Ratio

Reliability (%) Z_R (z-statistic)

80	-0.84
85	-1.04
90	-1.28
93	-1.48
94	-1.56
95	-1.65
96	-1.75
97	-1.88
98	-2.05
99	-2.33
99.9	-3.09
99.99	-3.75

$$\log_{10} W_{18} = Z_R \cdot S_o + 9.36 \cdot \log_{10} (SN+1) - 0.20 + \frac{\log_{10} \left[\frac{\Delta PSI}{4.2 - 1.5} \right]}{0.40 + \frac{1094}{(SN+1)^{5.19}}} + 2.32 \cdot \log_{10} M_R - 8.07$$

Left	Right	Difference
4.56	4.56	0.0

Job No. 221370

Fig. No. C-5

DESIGN CALCULATIONS

DESIGN DATA SR LAND, LLC
STERLING RANCH, FILING 3
LOCAL LOW-VOLUME

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL = 36,000
Hveem Stabilometer (R Value) Results:	R = 40
Weighted Structural Number (WSN):	WSN = 1.68

DESIGN EQUATION

$$WSN = C_1 D_1 + C_2 D_2$$

$C_1 = 0.44$ Strength Coefficient - Hot Bituminous Asphalt

$C_2 = 0.11$ Strength Coefficient - Aggregate Basecourse

D_1 = Depth of Asphalt (inches)

D_2 = Depth of Basecourse (inches)

FOR FULL DEPTH ASPHALT SECTION

$D_1 = (WSN)/C_1 = 3.8$ inches of Full Depth Asphalt
Use 5.0 inches Full Depth

FOR ASPHALT + AGGREGATE BASECOURSE SECTION

Asphalt Thickness (t) = 3 inches

$D_2 = ((WSN) - (t)(C_1))/C_2 = 3.3$ inches of Aggregate
Basecourse, use 6.0 inches USE 6 INCHES MINIMUM.

RECOMMENDED ALTERNATIVES

1. 3.0 inches of Asphalt + 6.0 inches of Aggregate Basecourse, or
2. 5.0 inches of Asphalt

Job No. 221370
Fig. No. C-6

DESIGN CALCULATIONS

CEMENT SECTIONS

DESIGN DATA SR LAND, LLC
STERLING RANCH, FILING 3
LOCAL LOW-VOLUME

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL = 50,000
Hveem Stabilometer (R Value) Results:	R = 40
Weighted Structural Number (WSN):	WSN = 1.68

DESIGN EQUATION

$$WSN = C_1 D_1 + C_2 D_2$$

$C_1 = 0.44$ Strength Coefficient - Hot Bituminous Asphalt

$C_2 = 0.11$ Strength Coefficient - Cement Stabilized Subgrade

D_1 = Depth of Asphalt (inches)

D_2 = Depth of Cement Stabilized Subgrade (inches)

FOR ASPHALT + CEMENT STABILIZED SUBGRADE SECTION

Asphalt Thickness (t) = 4 inches

$D_2 = ((WSN) - (t)(C_1))/C_2 = -0.7$ inches of Cement Stabilized Subgrade

Cement Stabilized Subgrade, Use 8.0 inches minimum

RECOMMENDED ALTERNATIVES

1. 4.0 inches of Asphalt + 8.0 inches of Cement Stabilized Subgrade

Job No. 221370

Fig. No. C-7

DESIGN CALCULATIONS

RECYCLED CONCRETE

DESIGN DATA

STERLING RANCH - SOIL TYPE 3
LOCAL LOW-VOLUME

Equivalent (18 kip) Single Axle Load Applications (ESAL):	ESAL = 36,500
Hveem Stabilometer (R Value) Results:	R = 40
Weighted Structural Number (WSN):	WSN = 1.68

DESIGN EQUATION

$$WSN = C_1 D_1 + C_2 D_2$$

$C_1 = 0.44$ Strength Coefficient - Hot Bituminous Asphalt

$C_2 = 0.09$ Strength Coefficient - Recycled Concrete

D_1 = Depth of Asphalt (inches)

D_2 = Depth of Recycled Concrete (inches)

FOR FULL DEPTH ASPHALT SECTION

$D_1 = (WSN)/C_1 = 3.8$ inches of Full Depth Asphalt
Use 5.0 inches Full Depth

FOR ASPHALT + AGGREGATE BASE COURSE SECTION

Asphalt Thickness (t) = 3 inches

$D_2 = ((WSN) - (t)(C_1))/C_2 = 4.0$ inches of Recycled Concrete
Recycled Concrete, use 6.0 inches

RECOMMENDED ALTERNATIVES

1. 3.0 inches of Asphalt + 6.0 inches of Recycled Concrete, or
2. 5.0 inches of Asphalt

Job No. 221370
Fig. No. C-8