

**LOTS 3, 4, AND 5 NORTHCREST CENTER FILING No 2**  
**PHASE 1 SUBDIVISION**  
**REFERRED TO AS: “NORTHCREST CENTER”**  
**FINAL DRAINAGE REPORT**

2510 & 2522 CANADA DRIVE  
COLORADO SPRINGS, COLORADO  
80922

PREPARED FOR: LEISURE CONSTRUCTION  
3443 TAMPA ROAD, SUITE B  
PALM HARBOR, FL 34684  
(727) 242-5121

PCD FILE NO. PPR-21-036

January 11, 2023

Prepared by  
**David Walker, P.E.**  
Rocky Mountain Group  
2910 Austin Bluffs Blvd. | Colorado Springs, CO 80918 | 719-434-5638



**SIGNATURE PAGE**

**LOTS 3, 4, AND 5 NORTHCREST CENTER FILING NO 2 PHASE 1  
SUBDIVISION**

**ENGINEER'S STATEMENT**

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by negligent acts, errors or omissions on my part in preparing this report.

SIGNATURE (Affix Seal)



David Walker, P.E. No.: 51909

12/16/22  
Date:

**DEVELOPER'S STATEMENT**

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

K&S Development, LLC

\_\_\_\_\_  
Name of Developer

*SL Edwards, MM*

\_\_\_\_\_  
Authorized Signature

11-14-22

\_\_\_\_\_  
Date

Sean L. Edwards

\_\_\_\_\_  
Printed Name

Managing Member

\_\_\_\_\_  
Title

3442 Tampa Rd., Suite B, Palm Harbor, FL 34684

\_\_\_\_\_  
Address

**EL PASO COUNTY:**

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

\_\_\_\_\_  
Joshua Palmer, P.E.

County Engineer / ECM Administrator

\_\_\_\_\_  
Date

Conditions:

## TABLE OF CONTENTS

|       |  |    |
|-------|--|----|
| I.    | PURPOSE .....  | 5  |
| II.   | GENERAL LOCATION AND DESCRIPTION .....                 | 5  |
| A.    | LOCATION .....   | 5  |
| B.    | DESCRIPTION OF PROPERTY – EXISTING CONDITIONS .....    | 6  |
| C.    | EXISTING SOILS.....                                    | 6  |
| D.    | EXISTING DRAINAGE.....                                 | 7  |
| E.    | DESCRIPTION OF PROPERTY – PROPOSED CONDITIONS .....    | 7  |
| III.  | DRAINAGE BASINS AND SUB-BASINS.....                    | 8  |
| A.    | EXISTING MAJOR DRAINAGE BASIN AND SUB-BASINS .....     | 8  |
| B.    | DEVELOPED MAJOR DRAINAGE BASIN AND SUB-BASINS .....    | 8  |
| IV.   | DRAINAGE DESIGN CRITERIA .....                         | 12 |
| A.    | REGULATIONS .....                                      | 12 |
| B.    | DEVELOPMENT CRITERIA REFERENCE AND CONSTRAINTS.....    | 12 |
| C.    | HYDROLOGICAL CRITERIA .....                            | 12 |
| D.    | FOUR-STEP PROCESS.....                                 | 12 |
| V.    | DRAINAGE INFRASTRUCTURE COSTS AND FEES.....            | 13 |
| A.    | DRAINAGE AND BRIDGE FEES .....                         | 13 |
| B.    | STORM DRAIN SYSTEM QUANTITIES AND COSTS ESTIMATE ..... | 14 |
| VI.   | CONCLUSIONS.....                                       | 14 |
| A.    | COMPLIANCE WITH STANDARDS .....                        | 14 |
| VII.  | REFERENCES .....                                       | 15 |
| VIII. | Appendices.....  | 16 |

## APPENDICES

A – Vicinity Map

B – Hydrologic and Hydraulic Computations

C – FEMA Floodplain Map

D – USGS Soils Survey Map

E – Drainage Plans



## **I. PURPOSE**

This report is a Final Drainage Report for Lots 3, 4 & 5 Northcrest Center Subdivision, a currently unaddressed set of lots, for the development for a multi-unit commercial development, Northcrest Center.

The purpose of this report is to identify on-site and off-site drainage patterns, assess stormwater conditions per delineated basin and sub-basins, demonstrate adequate design standards for storm water flow and release into the existing storm water system or right-of-way, and provide a narrative for any other drainage considerations related to the development of this parcel.

## **II. GENERAL LOCATION AND DESCRIPTION**

### **A. LOCATION**

The proposed development of thirteen 2,280 square foot commercial buildings, is located at the address of Northcrest Center (formerly Lots 3, 4, & 5) in the City of Colorado Springs, Colorado in El Paso County within the Northcrest Center Subdivision. The parcel schedule numbers are 5332309004, 5332309006, and 5332309005 and the legal descriptions are Lot 3 Northcrest Center, A Vacation & Replat Of Tract B Northcrest Fil No 2 Phase 1, Lot 5 Northcrest Center, A Vacation & Replat Of Tract B Northcrest Fil No 2 Phase 1, and Lot 4 Northcrest Center, A Vacation & Replat Of Tract B Northcrest Fil No 2 Phase 1. The parcel is located to the north of Constitution Avenue, west of Canada Drive, east of Peterson Road, and south of Bismark Road.

The surrounding parcels are as follows:

North of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from west to east:

2508 Weyburn Way, Schedule No. 5332308031, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 15 Constitution Hills Fil No 8

2507 Weyburn Way, Schedule No. 5332308032, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 14 Constitution Hills Fil No 8

2630 Tibburn Way, Schedule No. 5332308040, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 6 Constitution Hills Fil No 8

2610 Tibburn Way, Schedule No. 5332308041, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 5 Constitution Hills Fil No 8

2605 Tibburn Way, Schedule No. 5332308042, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 4 Constitution Hills Fil No 8

2624 Tibburn Way, Schedule No. 5332308043, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 3 Constitution Hills Fil No 8

East of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from north to south:

2535 Canada Drive, Schedule No. 5332310002, Zoning RS-6000 CAD-O, Plat No. 8956, Lot 1 Living Waters Sub

2525 Canada Drive, Schedule No. 5332310003, Zoning PUD CAD-O, Plat No. 8956, Lot 2 Living Waters Sub

2455 Canada Drive, Schedule No. 5405207050, Zoning RM-30 CAD-O, Plat No. 7588, Lot 2 Northcrest Fil No 4

South of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from west to east:

6855 Constitution Avenue, Schedule No. 5405218002, Zoning CC CAD-O, Plat No. 9808, Lot 1 Eight Line Sub

West of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from north to south:

6805 Bismark Road, Schedule No. 5332309007, Zoning CC CAD-O, Plat No. 7776, Lots 1 & 2 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1

## **B. DESCRIPTION OF PROPERTY – EXISTING CONDITIONS**

Lots 3, 4, and 5 (Northcrest Center (formerly Lots 3, 4, & 5)) is approximately 144,776 square feet combined (3.32 acres) and is located on the north side of Constitution Avenue, east side of Peterson Road, West of Canada Drive, and south of Bismark Road. The parcels fall within the SW 1/4 of Section 32, Township 13 South, Range 65 West of the 6<sup>th</sup> P.M. of Colorado Springs, El Paso County, Colorado.

The property currently consists of undeveloped natural vegetation. There is existing curb and gutter along Bismark Drive, Canada Drive, and Constitution Avenue.

The existing percent imperviousness is approximately 1.5 percent on Lots 3, 4, and 5.

The existing topography consists of grades between 5.3 and 19.17 percent. Drainage patterns sheet flow across the parcel southeasterly to the corner of Canada Drive and Constitution Avenue.

## **C. EXISTING SOILS**

The soils indicative to the site are classified as Truckton sandy loam by the USDA Soil Conservation Service and are listed as NRCS (National Resources Conservation Service) Hydrologic Soil Group A. A USDA Soil Map is provided in the Appendix.

A subsurface soils investigation was conducted for Commercial Development Site Constitution and Peterson, with a letter entitled *Geotechnical Report* by RMG – Rocky Mountain Group dated

February 23, 2021. The investigation “revealed similar substance subsurface soil conditions across the site, being primarily silty sand extending from the ground surface to the extent of the test borings. Neither expansive clay soil nor bedrock were encountered in the borings.”

“Test Borings for structures and storage yards were advanced with a power-driven, continuous-flight auger drill rig to depths of 15 and 20-feet below the existing ground surface. Pavement Borings were advanced to 5 and 10-foot depths.”

The study found that “groundwater was not encountered in the test borings during field exploration.”

#### **D. EXISTING DRAINAGE**

The existing topography consists of grades between 5.3 and 19.17 percent within the entire parcel that ultimately flows southeast. The existing imperviousness of the lot is approximately 1.5 percent. The existing vegetation consists of native grasses and has been identified via site visits and aerial photography as well as survey data and pictures.

The existing drainage pattern from storm runoff is generally characterized as overland flow to the southeast of the parcel across pervious landscaped yard. The runoff from this parcel and the surrounding neighborhood flows via curb and gutter in the public right of way of Bismark Road, Constitution Avenue, and Canada Drive. The runoff flows south on Canada Drive into the existing Public 15' CDOT Type R Curb Inlet located at the northwest corner of the intersection of Canada Drive and Constitution Avenue. This Public Storm Inlet is a branch of the Public 24" RCP Storm Main that flows west to east along the north side of Constitution Avenue and ultimately outfalls into Jimmy Camp Creek.

Lots 3, 4, and 5 do not lie within a designated floodplain according to information published in the Federal Emergency Management Agency Floodplain Map No. 08041C0752G, dated December 7, 2018. The FEMA Floodplain map is provided in Appendix C showing it lies within Zone X, a minimal flood hazard area.

There are no known non-stormwater discharges that contribute to the storm water systems on site and downstream, both private and public.

#### **E. DESCRIPTION OF PROPERTY – PROPOSED CONDITIONS**

The proposed development consists of thirteen 2,280 square foot commercial units and approximately 69,000 square feet of concrete and asphalt pavement for drive accesses, sidewalks, and curb and gutter. Other on-site features includes approximately 29,000 square feet of landscaping, 760 linear feet of retaining wall, and 2,800 square feet for a full spectrum detention pond.

There is no existing access point to the property. Two new curb cuts are proposed along Canada Drive.

### **III. DRAINAGE BASINS AND SUB-BASINS**

#### **A. EXISTING MAJOR DRAINAGE BASIN AND SUB-BASINS**

The parcel is delineated into sub-basins according to the existing and proposed grading for existing and developed conditions.

**Basin E** is the entirety of the parcel representing existing conditions and consists of one on-site sub-basin. There are no off-site flows that enter the property due to the slope of the existing drive aisle between this lot and the neighboring lot.

**Sub-basin E-1 (3.24 ac.;  $Q_{10} = 2.15$  cfs,  $Q_{100} = 6.86$  cfs)** is the entirety of Lots 3, 4, and 5 to be replatted via vacation into a single lot which contains natural vegetation that flows to the right of ways of Bismark Road, Canada Drive, and Constitution Ave. Those right of ways have curb and gutter directly adjacent to the lot that flow to a Public 15' CDOT Type R Curb Inlet. This public stormwater system is connected to a Public 24" RCP Storm Main that runs west to east along the south side of the lot within Constitution Avenue. The Public 15' & 5' CDOT Type R Curb Inlets located at the northwest and northeast corners, respectively, of the intersection of Canada Drive and Constitutions Avenue are branches that connect to the public stormwater main within Constitution Avenue. The public stormwater system ultimately flows to the East Fork Sand Creek.

**EP1** is the existing conditions design point representing the Public 15' CDOT Type R Curb Inlet at the northwest corner at the intersection of Canada Drive and Constitution Avenue where sub-basin E-1 flows over the pervious lot containing native grasses and vegetation to the public roadways. The emergency flow route of this public storm inlet is due east along the north side of Constitution Avenue.

#### **B. DEVELOPED MAJOR DRAINAGE BASIN AND SUB-BASINS**

**Basin D** is the entirety of the developed parcel representing developed conditions and consists of nine sub-basins. Some off-site flows will enter the proposed site from the western paved drive access currently serving the existing school.

**Sub-basin D-1 (0.29 ac. ;  $Q_{10} = 1.14$  cfs,  $Q_{100} = 1.80$  cfs)** is the northwestern area of the development consisting of an asphalt drive access off of the common drive access for this property and the neighboring lot from Bismark Road as well as enclosed storage and large vehicle parking area that consists of compacted gravel. The sub-basin is sloped southeast and overland flow is directed to a concrete drainage pan within the drive aisle and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate.

**DP1** is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-1. The Private Storm Inlet flows downstream to subsequent Design Point 6 before entering the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The total peak runoff flowing into DP1 is 1.14 cfs for the 10-year peak flow and 1.80 cfs for the 100-year peak flow. The emergency flow route for DP1 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the northern drive aisle and

would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-2 (0.45 ac. ;  $Q_{10} = 1.86$  cfs,  $Q_{100} = 2.90$  cfs)** is the middle-north area of the development consisting of an asphalt drive access off of the common drive access for this property as well as enclosed storage and large vehicle parking area that consists of compacted gravel. The sub-basin is sloped southeast and overland flow is directed to the concrete drain pan within the drive aisle and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate, the second in a series of storm inlets in the northern area.

**DP2** is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-2. The Private Storm Inlet flows downstream to subsequent Design Points 1 and 6 before entering the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The total peak runoff flowing into DP2 is 1.86 cfs for the 10-year peak flow and 2.90 cfs for the 100-year peak flow. The emergency flow route for DP2 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the northern drive aisle and would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-3 (0.37 ac. ;  $Q_{10} = 1.70$  cfs,  $Q_{100} = 2.63$  cfs)** is the northeast area of the development consisting of an asphalt drive access off of the common drive access for this property as well as enclosed storage and large vehicle parking area that consists of compacted gravel. The sub-basin is sloped southeast and overland flow is directed to the concrete drain pan within the drive aisle and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate, the third in a series of storm inlets in the northern area.

**DP3** is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-3. The Private Storm Inlet flows downstream to subsequent Design Points 2, 1, and 6 before entering the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The total peak runoff flowing into DP3 is 1.70 cfs for the 10-year peak flow and 2.63 cfs for the 100-year peak flow. The emergency flow route for DP3 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the northern drive aisle and would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-4 (0.73 ac. ;  $Q_{10} = 3.29$  cfs,  $Q_{100} = 5.12$  cfs)** is the roof of the proposed building within the center of the lot. This sub-basin captures stormwater runoff from the roof and distributes it to roof drains along the northern edge of the building. Roof drains will be connected to the underground storm drain line under the concrete drainage pan within the north drive aisle. Runoff from this sub-basin is only included in the detention basin design point DP4.

**DP4** is the Design Point representing the proposed roof runoff. The total peak runoff flowing into DP4 is 3.29 cfs for the 10-year peak flow and 5.12 cfs for the 100-year peak flow.

**Sub-basin D-5 (0.50 ac. ;  $Q_{10} = 2.69$  cfs,  $Q_{100} = 4.07$  cfs)** is the southern area of the development consisting of the south frontage parking lot. The sub-basin is generally sloped southeast within the parking lot with storm water conveyances via overland flow and curb and

gutter. The sub-basin flows to a proposed Private 10' CDOT Type R Curb Inlet and conveys it to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system.

**DP5** is the Design Point representing the Private 10' CDOT Type R Curb Inlet for Sub-basin D-5. The Private Storm Inlet flows downstream to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The total peak runoff flowing into DP5 is 2.69 cfs for the 10-year peak flow and 4.07 cfs for the 100-year peak flow. The emergency flow route for DP5 is to the east following proposed curb and gutter into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-6 (0.31 ac. ;  $Q_{10} = 1.58$  cfs,  $Q_{100} = 2.42$  cfs)** is the tributary area within the property boundary that consists of the common drive access off of Bismark Road to be extended to the south parking lot frontage of the development. This sub-basin previously flowed southeast to the public storm system and is proposed to flow southeast to the proposed curb inlet within the south parking lot, DP-6. The existing drainage pattern along the western property line will be preserved to accomplish this.

**DP6** is the Design Point representing the Private 10' CDOT Type R Curb Inlet for Sub-basin D-6. The Private Storm Inlet flows downstream to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The total peak runoff flowing into DP6 is 1.58 cfs for the 10-year peak flow and 2.42 cfs for the 100-year peak flow. The emergency flow route for DP6 is to the east following proposed curb and gutter into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-7 (0.14 ac. ;  $Q_{10} = 0.26$  cfs,  $Q_{100} = 0.56$  cfs)** accounts for the tributary area of the development that consists of the Full Spectrum Extended Detention Basin footprint. Runoff in this area is directly collected by the basin.

**DP7** is the Design Point representing the Full Spectrum Extended Detention Basin that is designed to detain a major storm event for the developed lot and provide Water Quality. The EDB is proposed to consist of 5.5-foot high structural walls with a detention volume of 24,000 cubic feet. The EDB consists of two forebays, concrete trickle channel, micropool, and outlet structure with an engineered orifice plate to comply with release rates for Water Quality Capture Volume, Excess Urban Runoff Volume, and the 100-Year Major Storm Event. The foundation drain of the EDB will be directed into the EDB and will have no effect on the design of the EDB. The emergency spillway of the detention basin is via a 6' wide wall notch in the westerly wall that discharges into a riprap lined slope flowing due south to Constitution Avenue, ultimately flowing into the existing Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-8 (0.21 ac. ;  $Q_{10} = 0.17$  cfs,  $Q_{100} = 0.66$  cfs)** is the southwest area of the development consisting of landscaping. The sub-basin flow is directed to the grass swale within the landscape area and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate.

**DP8** is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-8. The Private Storm Inlet flows downstream to subsequent Design Points via the Private Storm Sewer system. The total peak runoff flowing into DP8 is 0.17 cfs for the 10-year peak flow and 0.58 cfs for the 100-year peak flow. The emergency flow route for DP8 is to the east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**Sub-basin D-9 (0.63 ac. ;  $Q_{10} = 1.20$  cfs,  $Q_{100} = 2.54$  cfs)** is the tributary area within the property boundary that flows toward the adjacent right of ways of Bismark Road, Canada Drive, and Constitution Avenue. The sub-basin consists mostly of proposed landscaped areas, public concrete sidewalk, and ingress/egress curb cuts. The sub-basin flows to Design Point 9 via the adjacent roadways' curb and gutter, ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

**DP9** is the Design Point representing the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue. This Public Storm Inlet is a branch line of the Public Storm Main that runs west to east within Constitution Avenue and is the ultimate recipient of storm water flow from the developed lot as it is proposed to connect to the outlet structure of the EDB (DP7). The emergency flow route of this public storm inlet is due east along the north side of Constitution Avenue.

There is an existing Water Quality Capture Volume BMP/control measure constructed for the neighboring lot (Northcrest Center Fil No 2 Lots 1 & 2). This feature will not see additional runoff due to the proposed development, and was not evaluated for its current conditions.

The difference between Basin E and Basin D results in an overall increase of the 100-year storm Water volume of 14.71 cfs overall due to increased impervious surfaces.

2.65 acres (83.9% imperviousness) of on-site flows, and 0.31 acres of off-site flows drain to the Full Spectrum Detention Basin, with a total runoff of 20.19 cfs (100-yr storm) being captured.

A Full Spectrum Extended Detention Basin is proposed for the site to provide water quality and detention prior to attenuated storm water release to the public storm system. The vertical concrete walls on all four sides of the Extended Detention Basin are due to site constraints including an existing electric vault and existing easement where the pond is being constructed. The Full Spectrum Extended Detention Basin does include a 10' wide concrete maintenance access ramp with a grass bottom that slopes to the trickle channel.

It is anticipated that there will be no negative impact to downstream developments or infrastructure as a result of this development.

## **IV. DRAINAGE DESIGN CRITERIA**

### **A. REGULATIONS**

The hydrological and hydraulic calculations and design of the site conform to the City of Colorado Springs Drainage Criteria Manuals I and II (latest revision, May 2014) as well as the Mile High Flood District Drainage Criteria manuals revised August 2018.

### **B. DEVELOPMENT CRITERIA REFERENCE AND CONSTRAINTS**

The parcel falls within the Sand Creek major drainage basin (East Fork Sand Creek) designated by the City of Colorado Springs Water Resources Engineering Department with the ultimate receiving waters of Arkansas River. The drainage on this parcel will have no effect on downstream infrastructure or facilities, streets, utilities, transit, or further development of adjacent lots. Relevant criteria for the calculations shown further include equations and design criteria for the rational method, volumes and runoff of various storm events.

### **C. HYDROLOGICAL CRITERIA**

The rational method was used to calculate the peak runoff of the delineated sub-basins using the manuals referenced prior with the C, I, and P1 values from the Design Criteria Manual Volume I, Chapter 6 as well as the Colorado Springs designated IDF curve values. Specific calculations and tables are provided further with inputs including design rainfall, sub-basin acreage and percent imperviousness, runoff coefficients, one-hour rainfall depths, rainfall intensities, time of concentration, and peak discharge of various storm events. The default rainfall intensities and volumes use runoff coefficients based on soil types. Weighted runoff coefficients were calculated for each basin and sub-basin due to the mix of impervious surfaces, shown in the Appendix exhibits.

### **D. FOUR-STEP PROCESS**

The selection of appropriate control measures is based on the characteristics of the site and potential pollutants. The Four-Step Process provides a method of going through the selection process. The following applies the four-step process to the Development Plan for the Northcrest Center.

#### **Step 1: Employ Runoff Reduction Practices**

The Development Plan including the Landscape Plan utilizes landscaping areas for plantings and grass or mulch wherever possible without obstructing utilities or drainageways. Given the proposed land use, the majority of the site is to be paved for vehicular use. Within the mostly-impervious site, the storm water runoff is kept to the site limits where possible by use of grading, a private storm system and all other areas are to be landscaped, including the right of way landscape buffer areas.



### **Step 2: Provide Water Quality Capture Volume**

The Development Plan and Final Drainage Report indicate the use of a storm water detention pond as a control measure for capturing storm water runoff and properly treating the storm water prior to release either via percolation into the soil or attenuated to the public storm system. The detention pond is to be installed and the configuration is sized for capture of the WQCV as well as the EURV and full-spectrum detention, and 100-year detention.

### **Step 3: Stabilize Drainageways**

The drainage within the site is stabilized by way of pavement with features such as drainage pans, curb and gutter, and sloped pavement to direct storm water to the private storm system. There are no unpaved or unstabilized drainageways on this site.

### **Step 4: Implement Site Specific and Other Source Control BMPs**

No control measures beyond the Full Spectrum Extended Detention Basin are proposed as there are no unusual land uses that would result in the need for other source control BMPs.

## **V. DRAINAGE INFRASTRUCTURE COSTS AND FEES**

### **A. DRAINAGE AND BRIDGE FEES**

The development falls within the Sand Creek drainage basin (FOFO4000) which has a drainage basin fee of \$20,387 per impervious acre and a bridge fee of \$8,339 per impervious acre according to the 2021 El Paso County Drainage Basin Fees document. The development has a total impervious acreage of 2.72 acres (3.24 acres \* 83.9% imperviousness).

Drainage Basin Fee:  $\$20,387/\text{impervious acre} * 2.72 \text{ impervious acres} = \$55,452.64$

Bridge Fee:  $\$8,339/\text{impervious acre} * 2.72 \text{ impervious acres} = \$22,682.08$

Since the site is already platted, drainage fees are assumed to have already been paid. Since this development is increasing imperviousness, the County shall review their records and make a decision on fee requirements.

Any outstanding fees must be paid prior to plat recordation.

## B. STORM DRAIN SYSTEM QUANTITIES AND COSTS ESTIMATE

The following summarizes the Engineer's Opinion of Probable Cost for the proposed storm facilities for the development (installation plus materials).

### Private System

| Description                                    | Quantity | Unit | Unit Price | Cost      |
|--|----------|------|------------|-----------|
| Earthwork for cut of Pond<br>(Less than 1,000) | 612      | CY   | \$ 8       | \$ 4,896  |
| 12" RCP  | 230      | LF   | \$ 55      | \$ 12,650 |
| 18" RCP  | 226      | LF   | \$ 65      | \$ 14,690 |
| 24" RCP  | 74       | LF   | \$ 78      | \$ 5,772  |
| Curb Inlet (Type R) L=10'<br>5' ≤ Depth < 10'  | 2        | EA   | \$ 8,136   | \$ 16,272 |
| Pond Outlet Structure                          | 1        | EA   | \$ 10,000  | \$ 10,000 |
| Grated Inlet (Type C)<br>Depth < 5'            | 4        | EA   | \$ 4,802   | \$ 19,208 |
| Storm Sewer Manhole, Box<br>Base               | 2        | EA   | \$ 12,034  | \$ 24,068 |
| Concrete Basin Walls and<br>Safety Railing     | 1        | EA   | \$20,000   | \$20,000  |

**Total Cost      \$127,556.00**  
**Engineering**

**Contingency (10%)      \$ 12,755.60**

**Grand Total (w/  
Contingency)**  
**Non-Reimbursable      \$140,311.60**

## VI. CONCLUSIONS

### A. COMPLIANCE WITH STANDARDS

The criteria used to design the storm water runoff volumes are formulas and figures within the City of Colorado Springs Drainage Manuals as well as the Mile High Flood District Drainage Criteria manual. Grading practices for optimal drainage shall comply with the geotechnical investigative report and City standards. The development of Lots 3-5 is within compliance and standards and meets the requirements for the Northcrest Center.

The proposed grading and drainage is within substantial conformance for the master drainage plan for the Subdivision and Drainage Basin. There is no impact on major drainageway planning studies within the larger drainage basin. This development will not adversely affect downstream development.

## **VII. REFERENCES**

Colorado Springs Drainage Manual Volumes I & II (May 2014)

Colorado Urban Drainage and Flood Control District Drainage Criteria Manual, Volume I (August 2018)

Colorado Urban Drainage and Flood Control District Drainage Criteria Manual, Volume III (April 2018)

Urban Storm Drainage Criteria Manual, Volume III (November, 2015)


FEMA Flood Map Service Center

United States Department of Agriculture National Resources Conservation Service

Subsurface Soil Investigation prepared by RMG-Rocky Mountain Group Engineers dated February 23, 2021

## **VIII. Appendices**

## APPENDIX A – VICINITY MAP

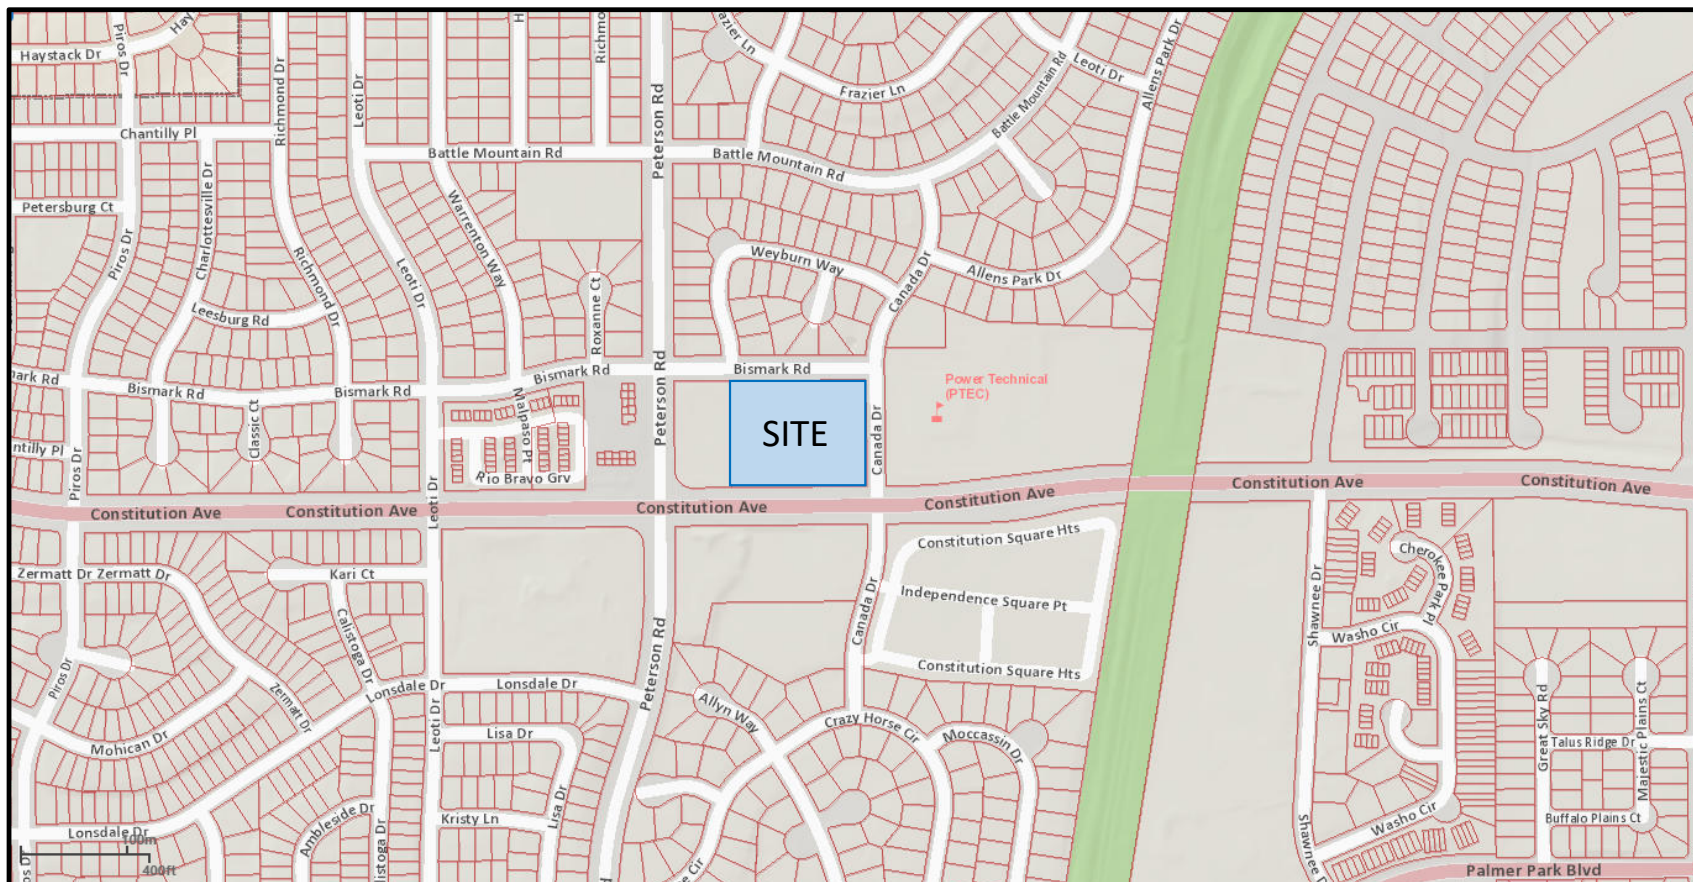

## APPENDIX B – HYDROLOGIC AND HYDRAULIC COMPUTATIONS

Project: Northcrest Center PEMBs Development - EXISTING CONDITIONS  
Engineer: David Walker, PE  
Date: 11/11/2022  
Address: 2510 & 2521 Canada Dr

|                |                |   |                 |                 |                  |  |
|----------------|----------------|---|-----------------|-----------------|------------------|--|
| Sub-Basin:     | E-1            | (IDF Curve Equations from Figure 6-5 of the DCM Volume 1) |                 |                 |                  |  |
| 1. Duration:   | 15-15          |   |                 |                 |                  |  |
| I <sub>2</sub> | I <sub>5</sub> | I <sub>10</sub>   | I <sub>25</sub> | I <sub>50</sub> | I <sub>100</sub> |  |
| 2.800816441    | 3.506298035    | 4.0908477   | 4.6753974       | 5.2559471       | 5.8861407        |  |

Hydrologic Soil Type: A

| Design Points |                 |                  |
|---------------|-----------------|------------------|
| Design Point  | Q <sub>10</sub> | Q <sub>100</sub> |
| EX DP1        | 2.15            | 6.86             |
| TOTAL SITE    | 2.15            | 6.86             |

| Coefficient (Table 6-6)            |             |       |                          |                                      |                                       |                                       |                                       |  |             |             |              |              |              |               |                      |                      |                       |                       |                       |                        |
|------------------------------------|-------------|-------|--------------------------|--------------------------------------|---------------------------------------|---------------------------------------|---------------------------------------|--|-------------|-------------|--------------|--------------|--------------|---------------|----------------------|----------------------|-----------------------|-----------------------|-----------------------|------------------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient <sub>C</sub> | Coefficient <sub>C<sub>u</sub></sub> | Coefficient <sub>C<sub>10</sub></sub> | Coefficient <sub>C<sub>25</sub></sub> | Coefficient <sub>C<sub>50</sub></sub> | Coefficient <sub>C<sub>100</sub></sub> | 2 Yr: C * A | 5 Yr: C * A | 10 Yr: C * A | 25 Yr: C * A | 50 Yr: C * A | 100 Yr: C * A | 2 Yr: C <sub>u</sub> | 5 Yr: C <sub>u</sub> | 10 Yr: C <sub>u</sub> | 25 Yr: C <sub>u</sub> | 50 Yr: C <sub>u</sub> | 100 Yr: C <sub>u</sub> |
| Roof                               | 0           | 0.000 | 0.71                     | 0.73                                 | 0.75                                  | 0.78                                  | 0.80                                  | 0.81                                   | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         | 0.033                | 0.093                | 0.162                 | 0.261                 | 0.310                 | 0.359                  |
| Pavement                           | 2155        | 0.049 | 0.89                     | 0.90                                 | 0.92                                  | 0.94                                  | 0.95                                  | 0.96                                   | 0.044       | 0.045       | 0.046        | 0.047        | 0.047        | 0.047         |                      |                      |                       |                       |                       |                        |
| Lawn                               | 139193      | 3.195 | 0.02                     | 0.08                                 | 0.15                                  | 0.25                                  | 0.30                                  | 0.35                                   | 0.064       | 0.256       | 0.479        | 0.799        | 0.959        | 1.118         |                      |                      |                       |                       |                       |                        |
|                                    |             |       |                          |                                      |                                       |                                       |                                       |  |             |             |              |              |              |               |                      |                      |                       |                       |                       |                        |
|                                    |             |       |                          |                                      |                                       |                                       |                                       |  |             |             |              |              |              |               |                      |                      |                       |                       |                       |                        |
|                                    |             |       |                          |                                      |                                       |                                       |                                       |  |             |             |              |              |              |               |                      |                      |                       |                       |                       |                        |
|                                    |             |       |                          |                                      |                                       |                                       |                                       |  |             |             |              |              |              |               |                      |                      |                       |                       |                       |                        |
| A <sub>c</sub> :                   | 141348.11   | 3.245 |                          |                                      |                                       |                                       |                                       |  |             |             |              |              |              |               |                      |                      |                       |                       |                       |                        |

| Q Peak Flow (cfs) |          |           |           |           |            |
|-------------------|----------|-----------|-----------|-----------|------------|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |
| 0.30              | 1.05     | 2.15      | 3.95      | 5.29      | 6.86       |



## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

| Sub-Basin or DP: | E-1   |  |
|------------------|-------|--|
| $C_{10}$ :       | 0.16  | [Table 6-6. Runoff Coefficients for Rational Method] |
| $L$ :            | 100   |  |
| $S$ :            | 0.045 |  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 2155        | 0.05    | 0.92     |
| Lawn                               | 139193      | 3.20    | 0.15     |
| $A_t$ :                            | 141348      | 3.24    |          |

$$C_c = (0.92 * 0.05 + 0.15 * 3.20) / 3.24 =$$

0.16

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.09) * \sqrt{550}) / (0.045^{0.33}) =$$

10.31

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.006)^{0.5} =$$

1.55

ft/s

Flow Distance:

450.00

ft

$$t_t = L / V =$$

290.47

sec.

4.84

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

15.15

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

15.15

min.

Project: Northeast Center PEMBs Commercial Development - DEVELOPED CONDITIONS  
Engineer: David Walker, PE  
Date: 11/6/2022  
Address: 2510 & 2522 Canada Dr

|                          |                |  |                 |                 |                 |                  |  |
|--------------------------|----------------|--|-----------------|-----------------|-----------------|------------------|--|
| Sub-Basin:               | D-1            | [DF Curve Equations from Figure 6-5 of the DCM Volume 1] |                 |                 |                 |                  |  |
| T <sub>r</sub> Duration: | 5.45           |  |                 |                 |                 |                  |  |
|                          | I <sub>1</sub> | I <sub>2</sub>   | I <sub>30</sub> | I <sub>75</sub> | I <sub>90</sub> | I <sub>100</sub> |  |
|                          | 3.919923358    | 6.916937006  | 5.7365932       | 6.5562493       | 7.73759055      | 8.23603142       |  |

Hydrologic Soil Type: A

| Coefficient (Table 6-6)            |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|------------------------------------|-------------|-------|-------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------------|-------------|--------------|--------------|--------------|---------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient <sub>1</sub> | Coefficient <sub>2</sub> | Coefficient <sub>3</sub> | Coefficient <sub>4</sub> | Coefficient <sub>5</sub> | Coefficient <sub>6</sub> | 2 Yr. C * A | 5 Yr. C * A | 10 Yr. C * A | 25 Yr. C * A | 50 Yr. C * A | 100 Yr. C * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73                     | 0.75                     | 0.78                     | 0.80                     | 0.81                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         |
| Pavement                           | 4720        | 0.108 | 0.89        | 0.90                     | 0.92                     | 0.94                     | 0.95                     | 0.96                     | 0.096                    | 0.098       | 0.100       | 0.102        | 0.103        | 0.104        |               |
| Lawn                               | 1217        | 0.028 | 0.02        | 0.08                     | 0.15                     | 0.25                     | 0.30                     | 0.33                     | 0.001                    | 0.002       | 0.004       | 0.007        | 0.008        | 0.010        |               |
| Gravel                             | 6007        | 0.140 | 0.57        | 0.59                     | 0.63                     | 0.66                     | 0.68                     | 0.70                     | 0.080                    | 0.088       | 0.094       | 0.099        | 0.102        | 0.105        |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
| A <sub>T</sub>                     | 12444       | 0.29  |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |

| Q Peak Flow (cfs) |          |           |           |           |            |  |
|-------------------|----------|-----------|-----------|-----------|------------|--|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |  |
| 0.71              | 0.92     | 1.14      | 1.36      | 1.57      | 1.80       |  |

|                          |                |  |                 |                 |                 |                  |  |
|--------------------------|----------------|--|-----------------|-----------------|-----------------|------------------|--|
| Sub-Basin:               | D-2            | [DF Curve Equations from Figure 6-5 of the DCM Volume 1] |                 |                 |                 |                  |  |
| T <sub>r</sub> Duration: | 5.89           |  |                 |                 |                 |                  |  |
|                          | I <sub>1</sub> | I <sub>2</sub>   | I <sub>30</sub> | I <sub>75</sub> | I <sub>90</sub> | I <sub>100</sub> |  |
|                          | 3.925794957    | 6.924933813  | 5.7402279       | 6.5661176       | 7.73870073      | 8.2684481        |  |

Hydrologic Soil Type: A

| Coefficient (Table 6-6)            |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|------------------------------------|-------------|-------|-------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------------|-------------|--------------|--------------|--------------|---------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient <sub>1</sub> | Coefficient <sub>2</sub> | Coefficient <sub>3</sub> | Coefficient <sub>4</sub> | Coefficient <sub>5</sub> | Coefficient <sub>6</sub> | 2 Yr. C * A | 5 Yr. C * A | 10 Yr. C * A | 25 Yr. C * A | 50 Yr. C * A | 100 Yr. C * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73                     | 0.75                     | 0.78                     | 0.80                     | 0.81                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         |
| Pavement                           | 6189        | 0.142 | 0.89        | 0.90                     | 0.92                     | 0.94                     | 0.95                     | 0.96                     | 0.126                    | 0.128       | 0.131       | 0.133        | 0.135        | 0.136        |               |
| Lawn                               | 0           | 0.000 | 0.02        | 0.08                     | 0.15                     | 0.25                     | 0.30                     | 0.33                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        |               |
| Gravel                             | 13359       | 0.307 | 0.57        | 0.59                     | 0.63                     | 0.66                     | 0.68                     | 0.70                     | 0.175                    | 0.181       | 0.193       | 0.202        | 0.209        | 0.215        |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
| A <sub>T</sub>                     | 19542       | 0.45  |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |

| Q Peak Flow (cfs) |          |           |           |           |            |  |
|-------------------|----------|-----------|-----------|-----------|------------|--|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |  |
| 1.18              | 1.52     | 1.86      | 2.21      | 2.54      | 2.90       |  |

|                          |                |  |                 |                 |                 |                  |  |
|--------------------------|----------------|--|-----------------|-----------------|-----------------|------------------|--|
| Sub-Basin:               | D-3            | [DF Curve Equations from Figure 6-5 of the DCM Volume 1] |                 |                 |                 |                  |  |
| T <sub>r</sub> Duration: | 5.00           |  |                 |                 |                 |                  |  |
|                          | I <sub>1</sub> | I <sub>2</sub>   | I <sub>30</sub> | I <sub>75</sub> | I <sub>90</sub> | I <sub>100</sub> |  |
|                          | 4.119768884    | 5.166863131  | 6.0304837       | 6.8921242       | 7.7537647       | 8.6792165        |  |

Hydrologic Soil Type: A

| Coefficient (Table 6-6)            |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|------------------------------------|-------------|-------|-------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------------|-------------|--------------|--------------|--------------|---------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient <sub>1</sub> | Coefficient <sub>2</sub> | Coefficient <sub>3</sub> | Coefficient <sub>4</sub> | Coefficient <sub>5</sub> | Coefficient <sub>6</sub> | 2 Yr. C * A | 5 Yr. C * A | 10 Yr. C * A | 25 Yr. C * A | 50 Yr. C * A | 100 Yr. C * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73                     | 0.75                     | 0.78                     | 0.80                     | 0.81                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         |
| Pavement                           | 7141        | 0.164 | 0.89        | 0.90                     | 0.92                     | 0.94                     | 0.95                     | 0.96                     | 0.148                    | 0.151       | 0.154       | 0.156        | 0.157        |              |               |
| Lawn                               | 0           | 0.000 | 0.02        | 0.08                     | 0.15                     | 0.25                     | 0.30                     | 0.33                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        |               |
| Gravel                             | 9090        | 0.208 | 0.57        | 0.59                     | 0.63                     | 0.66                     | 0.68                     | 0.70                     | 0.118                    | 0.123       | 0.131       | 0.137        | 0.141        | 0.145        |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
| A <sub>T</sub>                     | 16191       | 0.37  |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |

| Q Peak Flow (cfs) |          |           |           |           |            |  |
|-------------------|----------|-----------|-----------|-----------|------------|--|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |  |
| 3.09              | 2.40     | 1.70      | 2.08      | 2.36      | 2.65       |  |

|                          |                |  |                 |                 |                 |                  |  |
|--------------------------|----------------|--|-----------------|-----------------|-----------------|------------------|--|
| Sub-Basin:               | D-4            | [DF Curve Equations from Figure 6-5 of the DCM Volume 1] |                 |                 |                 |                  |  |
| T <sub>r</sub> Duration: | 5.00           |  |                 |                 |                 |                  |  |
|                          | I <sub>1</sub> | I <sub>2</sub>   | I <sub>30</sub> | I <sub>75</sub> | I <sub>90</sub> | I <sub>100</sub> |  |
|                          | 4.119768884    | 5.166863131  | 6.0304837       | 6.8921242       | 7.7537647       | 8.6792165        |  |

Hydrologic Soil Type: A

| Coefficient (Table 6-6)            |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|------------------------------------|-------------|-------|-------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------------|-------------|--------------|--------------|--------------|---------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient <sub>1</sub> | Coefficient <sub>2</sub> | Coefficient <sub>3</sub> | Coefficient <sub>4</sub> | Coefficient <sub>5</sub> | Coefficient <sub>6</sub> | 2 Yr. C * A | 5 Yr. C * A | 10 Yr. C * A | 25 Yr. C * A | 50 Yr. C * A | 100 Yr. C * A |
| Roof                               | 31733       | 0.728 | 0.71        | 0.73                     | 0.75                     | 0.78                     | 0.80                     | 0.81                     | 0.517                    | 0.532       | 0.546       | 0.568        | 0.583        | 0.590        |               |
| Pavement                           | 0           | 0.000 | 0.89        | 0.90                     | 0.92                     | 0.94                     | 0.95                     | 0.96                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         |
| Lawn                               | 0           | 0.000 | 0.02        | 0.08                     | 0.15                     | 0.25                     | 0.30                     | 0.33                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
| A <sub>T</sub>                     | 31733       | 0.73  |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |

| Q Peak Flow (cfs) |          |           |           |           |            |  |
|-------------------|----------|-----------|-----------|-----------|------------|--|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |  |
| 3.13              | 2.75     | 3.19      | 3.92      | 4.52      | 5.12       |  |

|                          |                |  |                 |                 |                 |                  |  |
|--------------------------|----------------|--|-----------------|-----------------|-----------------|------------------|--|
| Sub-Basin:               | D-5            | [DF Curve Equations from Figure 6-5 of the DCM Volume 1] |                 |                 |                 |                  |  |
| T <sub>r</sub> Duration: | 5.00           |  |                 |                 |                 |                  |  |
|                          | I <sub>1</sub> | I <sub>2</sub>   | I <sub>30</sub> | I <sub>75</sub> | I <sub>90</sub> | I <sub>100</sub> |  |
|                          | 4.119768884    | 5.166863131  | 6.0304837       | 6.8921242       | 7.7537647       | 8.6792165        |  |

Hydrologic Soil Type: A

| Coefficient (Table 6-6)            |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|------------------------------------|-------------|-------|-------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------------|-------------|--------------|--------------|--------------|---------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient <sub>1</sub> | Coefficient <sub>2</sub> | Coefficient <sub>3</sub> | Coefficient <sub>4</sub> | Coefficient <sub>5</sub> | Coefficient <sub>6</sub> | 2 Yr. C * A | 5 Yr. C * A | 10 Yr. C * A | 25 Yr. C * A | 50 Yr. C * A | 100 Yr. C * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73                     | 0.75                     | 0.78                     | 0.80                     | 0.81                     | 0.000                    | 0.000       | 0.000       | 0.000        | 0.000        | 0.000        | 0.000         |
| Pavement                           | 20994       | 0.482 | 0.89        | 0.90                     | 0.92                     | 0.94                     | 0.95                     | 0.96                     | 0.429                    | 0.434       | 0.443       | 0.453        | 0.458        | 0.463        |               |
| Lawn                               | 784         | 0.018 | 0.02        | 0.08                     | 0.15                     | 0.25                     | 0.30                     | 0.33                     | 0.000                    | 0.001       | 0.003       | 0.004        | 0.005        | 0.006        |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
|                                    |             |       |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |
| A <sub>T</sub>                     | 21778       | 0.50  |             |                          |                          |                          |                          |                          |                          |             |             |              |              |              |               |

| Q Peak Flow (cfs) |          |           |           |           |            |  |
|-------------------|----------|-----------|-----------|-----------|------------|--|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |  |
| 1.77              | 2.25     | 1.69      | 3.15      | 3.59      | 4.09       |  |

|                          |                |  |                 |                 |                  |  |  |
|--------------------------|----------------|--|-----------------|-----------------|------------------|--|--|
| Sub-Basin:               | <b>D-6</b>     | [RBF Curve Equations from Figure 6-5 of the DCM] |                 |                 |                  |  |  |
| t <sub>e</sub> Duration: | <b>5.00</b>    | [Volume I]                                       |                 |                 |                  |  |  |
| I <sub>1</sub>           | I <sub>2</sub> | I <sub>30</sub>                                  | I <sub>25</sub> | I <sub>10</sub> | I <sub>100</sub> |  |  |
| 4.13976884               | 5.16864313     | 6.0304837  | 6.8921242       | 7.757647        | 8.6792165        |  |  |

Hydrologic Soil Type: **A**

|                          |                |  |                 |                 |                  |  |  |
|--------------------------|----------------|--|-----------------|-----------------|------------------|--|--|
| Sub-Basin:               | <b>D-7</b>     | [RBF Curve Equations from Figure 6-5 of the DCM] |                 |                 |                  |  |  |
| t <sub>e</sub> Duration: | <b>5.49</b>    | [Volume I]                                       |                 |                 |                  |  |  |
| I <sub>1</sub>           | I <sub>2</sub> | I <sub>30</sub>                                  | I <sub>25</sub> | I <sub>10</sub> | I <sub>100</sub> |  |  |
| 4.008564233              | 5.02868204     | 5.8689474  | 6.7052255       | 7.5435035       | 8.4437243        |  |  |

Hydrologic Soil Type: **A**

|                          |                |  |                 |                 |                  |  |  |
|--------------------------|----------------|--|-----------------|-----------------|------------------|--|--|
| Sub-Basin:               | <b>D-8</b>     | [RBF Curve Equations from Figure 6-5 of the DCM] |                 |                 |                  |  |  |
| t <sub>e</sub> Duration: | <b>6.45</b>    | [Volume I]                                       |                 |                 |                  |  |  |
| I <sub>1</sub>           | I <sub>2</sub> | I <sub>30</sub>                                  | I <sub>25</sub> | I <sub>10</sub> | I <sub>100</sub> |  |  |
| 5.82628953               | 6.7989124      | 5.5988904  | 6.3958817       | 7.1955069       | 8.0377309        |  |  |

Hydrologic Soil Type: **A**

|                          |                |  |                 |                 |                  |  |  |
|--------------------------|----------------|--|-----------------|-----------------|------------------|--|--|
| Sub-Basin:               | <b>D-9</b>     | [RBF Curve Equations from Figure 6-5 of the DCM] |                 |                 |                  |  |  |
| t <sub>e</sub> Duration: | <b>11.17</b>   | [Volume I]                                       |                 |                 |                  |  |  |
| I <sub>1</sub>           | I <sub>2</sub> | I <sub>30</sub>                                  | I <sub>25</sub> | I <sub>10</sub> | I <sub>100</sub> |  |  |
| 3.163090946              | 3.962957411    | 4.623617   | 5.2842765       | 5.9449361       | 6.6533281        |  |  |

Hydrologic Soil Type: **A**

| Design Points  |                 |                  |
|----------------|-----------------|------------------|
| Design Points  | Q <sub>10</sub> | Q <sub>100</sub> |
| DP1            | 1.14            | 1.85             |
| DP2            | 1.86            | 2.95             |
| DP3            | 1.70            | 2.63             |
| DP4            | 3.29            | 5.12             |
| DP5            | 2.69            | 4.07             |
| DP6            | 1.58            | 2.42             |
| DP7            | 0.33            | 0.66             |
| DP8            | 0.17            | 0.34             |
| TOTAL ON-SITE  | 12.77           | 20.19            |
| DP9            | 1.20            | 2.54             |
| TOTAL OFF-SITE | 1.20            | 3.34             |

| Coefficient (Table 6-6)            |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|------------------------------------|-------------|-------|-------------|-------------|-------------|-------------|-------------|-------------|--------------|--------------|---------------|---------------|---------------|----------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | 2 Yr. C. * A | 5 Yr. C. * A | 10 Yr. C. * A | 15 Yr. C. * A | 50 Yr. C. * A | 100 Yr. C. * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73        | 0.75        | 0.78        | 0.80        | 0.81        | 0.000        | 0.000        | 0.000         | 0.000         | 0.000         | 0.000          |
| Pavement                           | 12249       | 0.281 | 0.89        | 0.90        | 0.92        | 0.94        | 0.95        | 0.96        | 0.250        | 0.253        | 0.259         | 0.264         | 0.267         | 0.270          |
| Lawn                               | 1104        | 0.025 | 0.02        | 0.08        | 0.15        | 0.25        | 0.30        | 0.35        | 0.001        | 0.002        | 0.004         | 0.006         | 0.008         | 0.009          |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
| A <sub>T</sub>                     | 13353       | 0.31  |             |             |             |             |             |             |              |              |               |               |               |                |

| Coefficient (Table 6-6)            |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|------------------------------------|-------------|-------|-------------|-------------|-------------|-------------|-------------|-------------|--------------|--------------|---------------|---------------|---------------|----------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | 2 Yr. C. * A | 5 Yr. C. * A | 10 Yr. C. * A | 15 Yr. C. * A | 50 Yr. C. * A | 100 Yr. C. * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73        | 0.75        | 0.78        | 0.80        | 0.81        | 0.000        | 0.000        | 0.000         | 0.000         | 0.000         | 0.000          |
| Pavement                           | 1385        | 0.046 | 0.89        | 0.90        | 0.92        | 0.94        | 0.95        | 0.96        | 0.041        | 0.041        | 0.042         | 0.043         | 0.043         | 0.044          |
| Lawn                               | 4290        | 0.098 | 0.02        | 0.08        | 0.15        | 0.25        | 0.30        | 0.35        | 0.002        | 0.008        | 0.015         | 0.025         | 0.030         | 0.034          |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
| A <sub>T</sub>                     | 6275        | 0.14  |             |             |             |             |             |             |              |              |               |               |               |                |

| Coefficient (Table 6-6)            |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|------------------------------------|-------------|-------|-------------|-------------|-------------|-------------|-------------|-------------|--------------|--------------|---------------|---------------|---------------|----------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | 2 Yr. C. * A | 5 Yr. C. * A | 10 Yr. C. * A | 15 Yr. C. * A | 50 Yr. C. * A | 100 Yr. C. * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73        | 0.75        | 0.78        | 0.80        | 0.81        | 0.000        | 0.000        | 0.000         | 0.000         | 0.000         | 0.000          |
| Pavement                           | 0           | 0.000 | 0.89        | 0.90        | 0.92        | 0.94        | 0.95        | 0.96        | 0.000        | 0.000        | 0.000         | 0.000         | 0.000         | 0.000          |
| Lawn                               | 8969        | 0.208 | 0.02        | 0.08        | 0.15        | 0.25        | 0.30        | 0.35        | 0.004        | 0.016        | 0.031         | 0.051         | 0.062         | 0.072          |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
| A <sub>T</sub>                     | 9969        | 0.21  |             |             |             |             |             |             |              |              |               |               |               |                |

| Coefficient (Table 6-6)            |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|------------------------------------|-------------|-------|-------------|-------------|-------------|-------------|-------------|-------------|--------------|--------------|---------------|---------------|---------------|----------------|
| Land Use or Surface Characteristic | Square Feet | Acres | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | Coefficient | 2 Yr. C. * A | 5 Yr. C. * A | 10 Yr. C. * A | 15 Yr. C. * A | 50 Yr. C. * A | 100 Yr. C. * A |
| Roof                               | 0           | 0.000 | 0.71        | 0.73        | 0.75        | 0.78        | 0.80        | 0.81        | 0.000        | 0.000        | 0.000         | 0.000         | 0.000         | 0.000          |
| Pavement                           | 6715        | 0.154 | 0.89        | 0.90        | 0.92        | 0.94        | 0.95        | 0.96        | 0.137        | 0.139        | 0.142         | 0.145         | 0.146         | 0.148          |
| Lawn                               | 20813       | 0.478 | 0.02        | 0.08        | 0.15        | 0.25        | 0.30        | 0.35        | 0.010        | 0.038        | 0.072         | 0.119         | 0.143         | 0.167          |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
|                                    |             |       |             |             |             |             |             |             |              |              |               |               |               |                |
| A <sub>T</sub>                     | 27527       | 0.63  |             |             |             |             |             |             |              |              |               |               |               |                |

| Q Peak Flow (cfs) |          |           |           |           |            |
|-------------------|----------|-----------|-----------|-----------|------------|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |
| 1.09              | 1.32     | 1.58      | 1.87      | 2.13      | 2.42       |

| Q Peak Flow (cfs) |          |           |           |           |            |
|-------------------|----------|-----------|-----------|-----------|------------|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |
| 0.17              | 0.25     | 0.33      | 0.45      | 0.55      | 0.66       |

| Q Peak Flow (cfs) |          |           |           |           |            |
|-------------------|----------|-----------|-----------|-----------|------------|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |
| 0.02              | 0.08     | 0.17      | 0.33      | 0.46      | 0.58       |

| Q Peak Flow (cfs) |          |           |           |           |            |
|-------------------|----------|-----------|-----------|-----------|------------|
| 2 Year Q          | 5 Year Q | 10 Year Q | 25 Year Q | 50 Year Q | 100 Year Q |
| 0.56              | 0.85     | 1.20      | 1.69      | 2.09      | 2.54       |

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

| Sub-Basin or DP: | D-1                |
|------------------|--------------------|
| $C_{10}$ :       | <b>0.69</b>        |
| $L$ :            | <b>100</b> ft      |
| $S$ :            | <b>0.025</b> ft/ft |

[Table 6-6. Runoff Coefficients for Rational Method]

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 4720        | 0.11    | 0.92     |
| Lawn                               | 1217        | 0.03    | 0.15     |
| Gravel                             | 6507        | 0.15    | 0.63     |
| $A_t$ :                            | 12444       | 0.29    |          |

$$C_c = (0.92*0.11 + 0.15*0.03 + 0.63*0.15) / 0.29 = \mathbf{0.69}$$

$$t_i = (0.395*(1.1 - C_{10})*\sqrt{L})/(S^{0.33})$$

$$t_i = (0.395*(1.1 - 0.48)*\sqrt{145})/(0.055^{0.33}) = \mathbf{5.47} \text{ mins}$$

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)/(0.025)^{0.5} = \mathbf{3.16} \text{ ft/s}$$

$$\text{Flow Distance: } \mathbf{85.00} \text{ ft}$$

$$t_t = L/V = \mathbf{26.88} \text{ sec.}$$

$$\mathbf{0.45} \text{ min.}$$

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t = \mathbf{5.91} \text{ min.}$$

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

$$\text{Final } t_c: \mathbf{5.91} \text{ min.}$$

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

| Sub-Basin or DP: | D-2                |
|------------------|--------------------|
| $C_{10}$ :       | <b>0.72</b>        |
| $L$ :            | <b>100</b> ft      |
| $S$ :            | <b>0.025</b> ft/ft |

[Table 6-6. Runoff Coefficients for Rational Method]

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 6183        | 0.14    | 0.92     |
| Lawn                               | 0           | 0.00    | 0.15     |
| Gravel                             | 13359       | 0.31    | 0.63     |
| $A_t$ :                            | 19542       | 0.45    |          |

$$C_c = (0.92 * 0.14 + 0.63 * 0.31) / 0.45 =$$

**0.72**

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.39) * \sqrt{124}) / (0.03^{0.33}) =$$

**5.05**

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20) / (0.025)^{0.5} =$$

**3.16**

ft/s

$$\text{Flow Distance:}$$

**159.00**

ft

$$t_t = L / V =$$

**50.28**

sec.

**0.84**

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

**5.89**

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

**5.89**

min.

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

| Sub-Basin or DP: | D-3                |
|------------------|--------------------|
| $C_{10}$ :       | <b>0.76</b>        |
| $L$ :            | <b>100</b> ft      |
| $S$ :            | <b>0.025</b> ft/ft |

[Table 6-6. Runoff Coefficients for Rational Method]

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 7141        | 0.16    | 0.92     |
| Lawn                               | 0           | 0.00    | 0.15     |
| Gravel                             | 9050        | 0.21    | 0.63     |
| $A_t$ :                            | 16191       | 0.37    |          |

$$C_c = (0.92 * 0.16 + 0.63 * 0.21) / 0.37 =$$

**0.76**

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.90) * \sqrt{124}) / (0.03^{0.33}) =$$

**4.56**

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20) / (0.025)^{0.5} =$$

**3.16**

ft/s

$$\text{Flow Distance:}$$

**82.00**

ft

$$t_t = L/V =$$

25.93

sec.

**0.43**

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)                  | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

**5.00**

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

**5.00**

min.

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

|                  |       |  |
|------------------|-------|--|
| Sub-Basin or DP: | D-4   |  |
| $C_{10}$ :       | 0.75  | [Table 6-6. Runoff Coefficients for Rational Method] |
| $L$ :            | 95    | ft   |
| $S$ :            | 0.083 | ft/ft  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 31714       | 0.73    | 0.75     |
| Pavement                           | 0           | 0.00    | 0.92     |
| Lawn                               | 0           | 0.000   | 0.15     |
| $A_t$ :                            | 31714       | 0.73    |          |

$$C_c = (0.75 * 0.73) / 0.73 =$$

0.75

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.87) * \sqrt{90}) / (0.035^{0.33}) =$$

3.06

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.042)^{0.5} =$$

0.00

ft/s

Flow Distance:

0.00

ft

$$t_t = L / V =$$

0.00

sec.

0.00

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

3.06

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

5.00

min.

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

|                  |       |  |
|------------------|-------|--|
| Sub-Basin or DP: | D-5   |  |
| $C_{10}$ :       | 0.89  | [Table 6-6. Runoff Coefficients for Rational Method] |
| L:               | 100   | ft   |
| S:               | 0.035 | ft/ft  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots + C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 21716       | 0.50    | 0.92     |
| Lawn                               | 784         | 0.018   | 0.15     |
| $A_t$ :                            | 22500       | 0.517   |          |

$$C_c = (0.92 * 0.50 + 0.15 * 0.018) / 0.515 =$$

0.89

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.88) * \sqrt{125}) / (0.035^{0.33}) =$$

2.47

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.035)^{0.5} =$$

3.74

ft/s

Flow Distance:

166.00

ft

$$t_t = L / V =$$

44.37

sec.

0.74

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

3.21

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

5.00

min.



## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

| Sub-Basin or DP: | D-6  |  |
|------------------|------|--|
| $C_{10}$ :       | 0.86 | [Table 6-6. Runoff Coefficients for Rational Method] |
| $L$ :            | 100  |  |
| $S$ :            | 0.07 |  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 12249       | 0.28    | 0.92     |
| Lawn                               | 1104        | 0.03    | 0.15     |
| $A_t$ :                            | 13353       | 0.31    |          |

$$C_c = (0.92 * 0.28 + 0.15 * 0.03) / 0.31 =$$

0.86

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.86) * \sqrt{100}) / (0.07^{0.33}) =$$

2.31

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.053)^{0.5} =$$

4.60

ft/s

Flow Distance:

188.00

ft

$$t_t = L / V =$$

40.83

sec.

0.68

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

3.00

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

5.00

min.

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

|                  |      |  |
|------------------|------|--|
| Sub-Basin or DP: | D-7  |  |
| $C_{10}$ :       | 0.40 | [Table 6-6. Runoff Coefficients for Rational Method] |
| $L$ :            | 15   | ft   |
| $S$ :            | 0.01 | ft/ft  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 1985        | 0.05    | 0.92     |
| Lawn                               | 4119        | 0.09    | 0.15     |
| $A_t$ :                            | 6104        | 0.14    |          |

$$C_c = (0.75 * 0.0 + 0.92 * 0.10 + 0.15 * 0.07) / 0.08 = 0.40$$

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.20) * \sqrt{15}) / (0.01^{0.33}) = 4.89 \text{ mins}$$

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.01)^{0.5} = 2.00 \text{ ft/s}$$

$$\text{Flow Distance: } 66.00 \text{ ft}$$

$$t_t = L/V = 33.00 \text{ sec.}$$

$$0.55 \text{ min.}$$

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t = 5.44 \text{ min.}$$

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

$$\text{Final } t_c: 5.44 \text{ min.}$$

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

|                  |      |  |
|------------------|------|--|
| Sub-Basin or DP: | D-8  |  |
| $C_{10}$ :       | 0.15 | [Table 6-6. Runoff Coefficients for Rational Method] |
| $L$ :            | 25   | ft   |
| $S$ :            | 0.04 | ft/ft  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots + C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 0           | 0.00    | 0.92     |
| Lawn                               | 8402        | 0.19    | 0.15     |
| $A_t$ :                            | 8402        | 0.19    |          |

$$C_c = (0.15 * 0.25) / 0.25 =$$

0.15

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.15) * \sqrt{46}) / (0.25^{0.33}) =$$

5.43

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.04)^{0.5} =$$

4.00

ft/s

Flow Distance:

233.00

ft

$$t_t = L/V =$$

58.25

sec.

0.97

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

6.40

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.

Final  $t_c$ :

6.40

min.

## Time of Concentration

$$t_c = t_i + t_t$$

### 3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

$t_i$  = overland (initial) flow time (min)

$C_s$  = runoff coefficient for 5-year frequency (see Table 6-6)

$L$  = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

$S$  = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

|                  |      |  |
|------------------|------|--|
| Sub-Basin or DP: | D-9  |  |
| $C_{10}$ :       | 0.34 | [Table 6-6. Runoff Coefficients for Rational Method] |
| $L$ :            | 100  | ft   |
| $S$ :            | 0.04 | ft/ft  |

#### Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

| Land Use or Surface Characteristic | Square Feet | Acreage | $C_{10}$ |
|------------------------------------|-------------|---------|----------|
| Roof                               | 0           | 0.00    | 0.75     |
| Pavement                           | 6715        | 0.15    | 0.92     |
| Lawn                               | 20727       | 0.48    | 0.15     |
| $A_t$ :                            | 27442       | 0.63    |          |

$$C_c = (0.15 * 0.39 + 0.92 * 0.10) / 0.50 =$$

0.34

$$t_i = (0.395 * (1.1 - C_{10}) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.35) * \sqrt{46}) / (0.25^{0.33}) =$$

8.70

mins

### 3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time,  $t_t$ , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time,  $t_t$ , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

$V$  = velocity (ft/s)

$C_v$  = conveyance coefficient (from Table 6-7)

$S_w$  = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.04)^{0.5} =$$

4.00

ft/s

$$\text{Flow Distance:}$$

591.00

ft

$$t_t = L/V =$$

147.75

sec.

2.46

min.

Table 6-7. Conveyance Coefficient,  $C_v$

| Type of Land Surface                 | $C_v$ |
|--------------------------------------|-------|
| Heavy meadow                         | 2.5   |
| Tillage/field                        | 5     |
| Riprap (not buried)*                 | 6.5   |
| Short pasture and lawns              | 7     |
| Nearly bare ground                   | 10    |
| Grassed waterway                     | 15    |
| Paved areas and shallow paved swales | 20    |

\*For buried riprap, select  $C_v$  value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

11.16

min.

### 3.2.4 Minimum Time of Concentration

If the calculations result in a  $t_c$  of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum  $t_c$  for urbanized areas is 5 minutes.


$$\text{Final } t_c:$$

11.16

min.

MHFD-Detention, Version 4.06 (July 2022)

**Basin ID: EDB, Full Spectrum Extended Detention Basin**



### Example Zone Configuration (Retention Pond)

|   |               |         |
|---|---------------|---------|
| Selected BMP Type =                           | <b>EDB</b>    |         |
| Watershed Area =                              | <b>3.02</b>   | acres   |
| Watershed Length =                            | <b>400</b>    | ft      |
| Watershed Length to Centroid =                | <b>175</b>    | ft      |
| Watershed Slope =                             | <b>0.050</b>  | ft/ft   |
| Watershed Imperviousness =                    | <b>86.46%</b> | percent |
| Percentage Hydrologic Soil Group A =          | <b>100.0%</b> | percent |
| Percentage Hydrologic Soil Group B =          | <b>0.0%</b>   | percent |
| Percentage Hydrologic Soil Group C/D =        | <b>0.0%</b>   | percent |
| Target WQCV Drain Time =                      | <b>40.0</b>   | hours   |
| Location for 1-h Rainfall Depths = User Input |               |         |

### Optional User Overrides

|   |       |           |
|---|-------|-----------|
| Water Quality Capture Volume (WQCV) =     | 0.094 | acre-feet |
| Excess Urban Runoff Volume (EURV) =       | 0.351 | acre-feet |
| 2-yr Runoff Volume ( $P1 = 1.19$ in.) =   | 0.219 | acre-feet |
| 5-yr Runoff Volume ( $P1 = 1.5$ in.) =    | 0.283 | acre-feet |
| 10-yr Runoff Volume ( $P1 = 1.75$ in.) =  | 0.334 | acre-feet |
| 25-yr Runoff Volume ( $P1 = 2$ in.) =     | 0.391 | acre-feet |
| 50-yr Runoff Volume ( $P1 = 2.25$ in.) =  | 0.447 | acre-feet |
| 100-yr Runoff Volume ( $P1 = 2.52$ in.) = | 0.511 | acre-feet |
| 500-yr Runoff Volume ( $P1 = 3.48$ in.) = | 0.731 | acre-feet |
| Approximate 2-yr Detention Volume =       | 0.231 | acre-feet |
| Approximate 5-yr Detention Volume =       | 0.300 | acre-feet |
| Approximate 10-yr Detention Volume =      | 0.357 | acre-feet |
| Approximate 25-yr Detention Volume =      | 0.422 | acre-feet |
| Approximate 50-yr Detention Volume =      | 0.460 | acre-feet |
| Approximate 100-yr Detention Volume =     | 0.493 | acre-feet |

|      |           |
|------|-----------|
|      | acre-feet |
|      | acre-feet |
| 1.19 | inches    |
| 1.50 | inches    |
| 1.75 | inches    |
| 2.00 | inches    |
| 2.25 | inches    |
| 2.52 | inches    |
| 3.48 | inches    |


|   |       |                |
|---|-------|----------------|
| Zone 1 Volume (WQCV) =                                  | 0.094 | acre-feet      |
| Zone 2 Volume (EURV - Zone 1) =                         | 0.257 | acre-feet      |
| Zone 3 Volume (100-year - Zone 1 & 2) =                 | 0.142 | acre-feet      |
| Total Detention Basin Volume =                          | 0.493 | acre-feet      |
| Initial Surge Charge Volume (ISV) =                     | user  | R <sup>3</sup> |
| Initial Surge Depth (ISD) =                             | user  | ft             |
| Total Available Detention Depth (H <sub>total</sub> ) = | user  | ft             |
| Depth of Trickle Channel (H <sub>TC</sub> ) =           | user  | ft             |
| Slope of Trickle Channel (S <sub>TC</sub> ) =           | user  | ft/ft          |
| Slopes of Main Basin Sides (S <sub>main</sub> ) =       | user  | H:V            |
| Basin Length-to-Width Ratio (R <sub>L/W</sub> ) =       | user  |                |

|   |   |      |                 |
|---|---|------|-----------------|
| Initial Surcharge Area ( $A_{SIV}$ )        | = | user | ft <sup>2</sup> |
| Surcharge Volume Length ( $L_{SIV}$ )       | = | user | ft              |
| Surcharge Volume Width ( $W_{SIV}$ )        | = | user | ft              |
| Depth of Basin Floor ( $H_{1,COR}$ )        | = | user | ft              |
| Length of Basin Floor ( $L_{1,COR}$ )       | = | user | ft              |
| Width of Basin Floor ( $W_{1,COR}$ )        | = | user | ft              |
| Area of Basin Floor ( $A_{1,COR}$ )         | = | user | ft <sup>2</sup> |
| Volume of Basin Floor ( $V_{1,COR}$ )       | = | user | ft <sup>3</sup> |
| Depth of Main Basin ( $H_{M,B}$ )           | = | user | ft              |
| Length of Main Basin ( $L_{M,B}$ )          | = | user | ft              |
| Width of Main Basin ( $W_{M,B}$ )           | = | user | ft              |
| Area of Main Basin ( $A_{M,B}$ )            | = | user | ft <sup>2</sup> |
| Volume of Main Basin ( $V_{M,B}$ )          | = | user | ft <sup>3</sup> |
| Calculated Total Basin Volume ( $V_{T,B}$ ) | = | user | acre-feet       |

[illegible]

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.06 (July 2022)

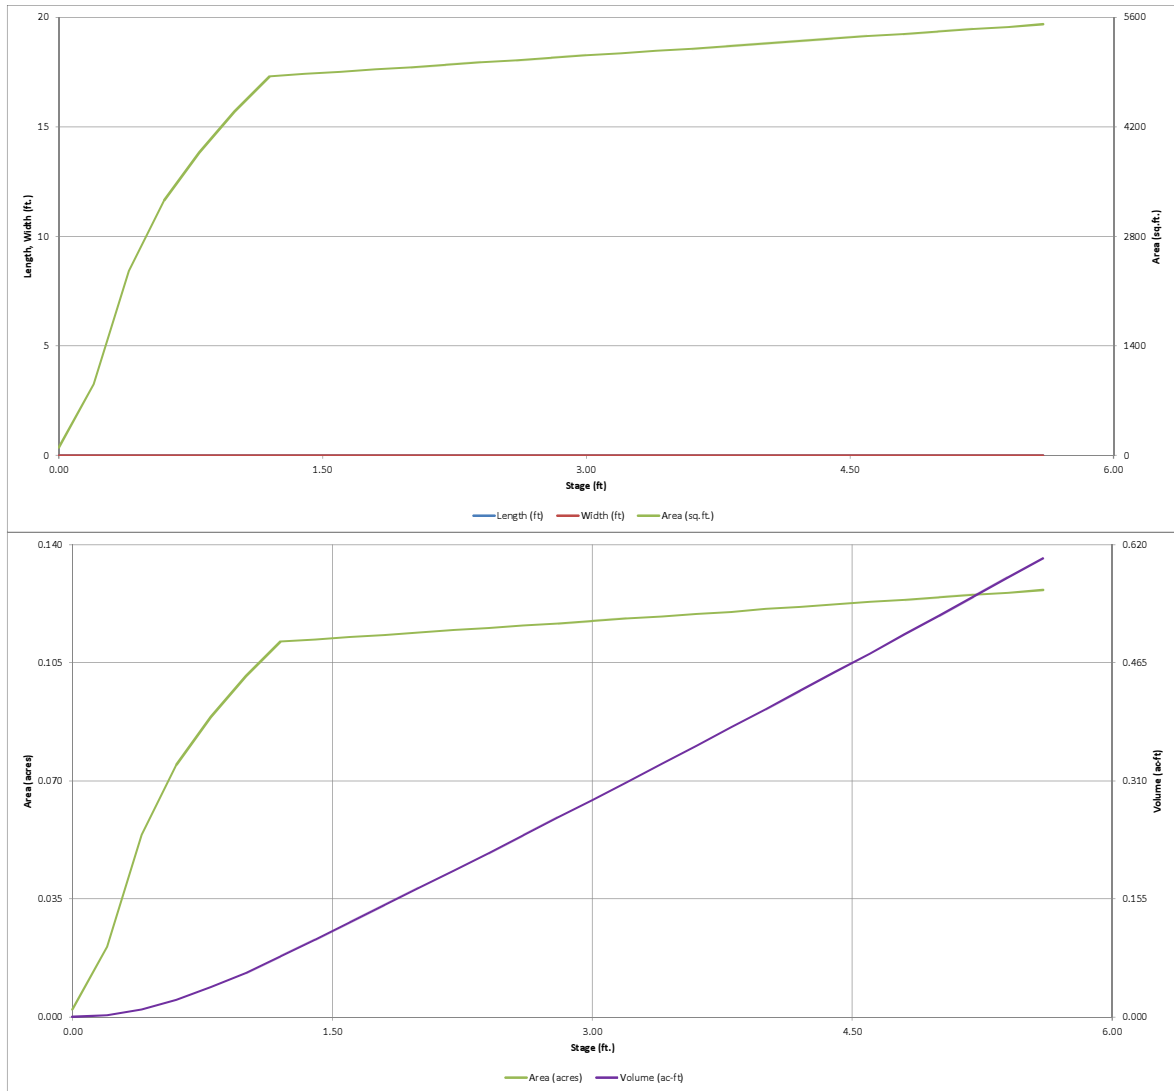


# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-DETENTION, Version 4.06 (July 2022)

Project: Northcrest Center

Basin ID: EDB, Full Spectrum Extended Detention Basin

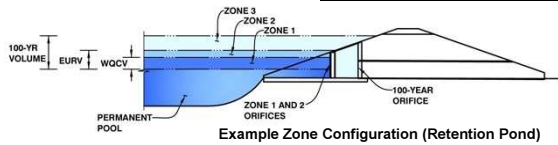

Example Zone Configuration (Retention Pond)

|                   | Estimated Stage (ft) | Estimated Volume (ac-ft) | Outlet Type          |
|-------------------|----------------------|--------------------------|----------------------|
| Zone 1 (WQCV)     | 1.34                 | 0.094                    | Orifice Plate        |
| Zone 2 (EURV)     | 3.56                 | 0.257                    | Orifice Plate        |
| Zone 3 (100-year) | 4.73                 | 0.142                    | Weir&Pipe (Restrict) |
| Total (all zones) |                      | 0.493                    |                      |

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =  ft (distance below the filtration media surface)  
Underdrain Orifice Diameter =  inches

Calculated Parameters for Underdrain  
Underdrain Orifice Area =  ft<sup>2</sup>  
Underdrain Orifice Centroid =  feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Centroid of Lowest Orifice =  ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Orifice Plate =  ft (relative to basin bottom at Stage = 0 ft)  
Orifice Plate: Orifice Vertical Spacing =  inches  
Orifice Plate: Orifice Area per Row =  sq. inches

Calculated Parameters for Plate  
WQ Orifice Area per Row =  ft<sup>2</sup>  
Elliptical Half-Width =  feet  
Elliptical Slot Centroid =  feet  
Elliptical Slot Area =  ft<sup>2</sup>

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

|                                | Row 1 (required) | Row 2 (optional) | Row 3 (optional) | Row 4 (optional) | Row 5 (optional) | Row 6 (optional) | Row 7 (optional) | Row 8 (optional) |
|--------------------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|------------------|
| Stage of Orifice Centroid (ft) | 0.00             | 0.89             | 1.78             | 2.67             |                  |                  |                  |                  |
| Orifice Area (sq. inches)      | 0.79             | 0.79             | 0.44             | 0.44             |                  |                  |                  |                  |

|                                | Row 9 (optional) | Row 10 (optional) | Row 11 (optional) | Row 12 (optional) | Row 13 (optional) | Row 14 (optional) | Row 15 (optional) | Row 16 (optional) |
|--------------------------------|------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|
| Stage of Orifice Centroid (ft) |                  |                   |                   |                   |                   |                   |                   |                   |
| Orifice Area (sq. inches)      |                  |                   |                   |                   |                   |                   |                   |                   |

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice =   ft (relative to basin bottom at Stage = 0 ft)  
Depth at top of Zone using Vertical Orifice =   ft (relative to basin bottom at Stage = 0 ft)  
Vertical Orifice Diameter =   inches

Calculated Parameters for Vertical Orifice  
Vertical Orifice Area =   ft<sup>2</sup>  
Vertical Orifice Centroid =   feet

User Input: Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

Overflow Weir Front Edge Height, H<sub>o</sub> =   ft (relative to basin bottom at Stage = 0 ft)  
Overflow Weir Front Edge Length =   feet  
Overflow Weir Grate Slope =   H:V  
Horiz. Length of Weir Sides =   feet  
Overflow Grate Type =    
Debris Clogging % =   %

Calculated Parameters for Overflow Weir  
Height of Grate Upper Edge, H<sub>u</sub> =   feet  
Overflow Weir Slope Length =   feet  
Grate Open Area / 100-yr Orifice Area =    
Overflow Grate Open Area w/o Debris =   ft<sup>2</sup>  
Overflow Grate Open Area w/ Debris =   ft<sup>2</sup>

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe =   ft (distance below basin bottom at Stage = 0 ft)  
Outlet Pipe Diameter =   inches  
Restrictor Plate Height Above Pipe Invert =   inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate  
Outlet Orifice Area =   ft<sup>2</sup>  
Outlet Orifice Centroid =   feet  
Half-Central Angle of Restrictor Plate on Pipe =   radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =  ft (relative to basin bottom at Stage = 0 ft)  
Spillway Crest Length =  feet  
Spillway End Slopes =  H:V  
Freeboard above Max Water Surface =  feet

Calculated Parameters for Spillway  
Spillway Design Flow Depth =  feet  
Stage at Top of Freeboard =  feet  
Basin Area at Top of Freeboard =  acres  
Basin Volume at Top of Freeboard =  acre-ft




## Routed Hydrograph Results

The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).

|  | WQCV  | EURV            | 2 Year | 5 Year | 10 Year | 25 Year         | 50 Year  | 100 Year | 500 Year |
|--|-------|-----------------|--------|--------|---------|-----------------|----------|----------|----------|
| Design Storm Return Period                     | N/A   | N/A             | 1.19   | 1.50   | 1.75    | 2.00            | 2.25     | 2.52     | 3.48     |
| One-Hour Rainfall Depth (in)                   | N/A   | N/A             | 0.219  | 0.283  | 0.334   | 0.391           | 0.447    | 0.511    | 0.731    |
| CUHP Runoff Volume (acre-ft)                   | 0.094 | 0.351           | 0.219  | 0.283  | 0.334   | 0.391           | 0.447    | 0.511    | 0.731    |
| Inflow Hydrograph Volume (acre-ft)             | N/A   | N/A             | 0.219  | 0.283  | 0.334   | 0.391           | 0.447    | 0.511    | 0.731    |
| CUHP Predevelopment Peak Q (cfs)               | N/A   | N/A             | 0.0    | 0.1    | 0.1     | 0.9             | 1.7      | 2.8      | 6.2      |
| OPTIONAL: Override Predevelopment Peak Q (cfs) | N/A   | N/A             | 0.3    | 1.1    | 2.2     | 4.0             | 5.3      | 6.9      | 8.0      |
| Predevelopment Unit Peak Flow, q (cfs/acre)    | N/A   | N/A             | 0.10   | 0.35   | 0.71    | 1.31            | 1.75     | 2.27     | 2.65     |
| Peak Inflow Q (cfs)                            | N/A   | N/A             | 5.4    | 6.9    | 8.2     | 9.8             | 11.2     | 12.5     | 17.9     |
| Peak Outflow Q (cfs)                           | 0.0   | 0.1             | 0.1    | 0.1    | 0.1     | 0.2             | 0.9      | 2.3      | 7.5      |
| Ratio Peak Outflow to Predevelopment Q         | N/A   | N/A             | N/A    | 0.1    | 0.1     | 0.1             | 0.2      | 0.3      | 0.9      |
| Structure Controlling Flow                     | Plate | Overflow Weir 1 | Plate  | Plate  | Plate   | Overflow Weir 1 | Spillway | Spillway | Spillway |
| Max Velocity through Grate 1 (fps)             | N/A   | N/A             | N/A    | N/A    | N/A     | 0.0             | 0.1      | 0.2      | 0.6      |
| Max Velocity through Grate 2 (fps)             | N/A   | N/A             | N/A    | N/A    | N/A     | N/A             | N/A      | N/A      | N/A      |
| Time to Drain 97% of Inflow Volume (hours)     | 42    | 74              | 62     | 69     | 73      | 77              | 76       | 75       | 71       |
| Time to Drain 99% of Inflow Volume (hours)     | 44    | 79              | 66     | 74     | 79      | 83              | 83       | 82       | 80       |
| Maximum Ponding Depth (ft)                     | 1.34  | 3.56            | 2.34   | 2.87   | 3.28    | 3.73            | 3.84     | 3.95     | 4.22     |
| Area at Maximum Ponding Depth (acres)          | 0.11  | 0.12            | 0.12   | 0.12   | 0.12    | 0.12            | 0.12     | 0.12     | 0.12     |
| Maximum Volume Stored (acre-ft)                | 0.095 | 0.351           | 0.207  | 0.269  | 0.318   | 0.370           | 0.384    | 0.398    | 0.431    |

# DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

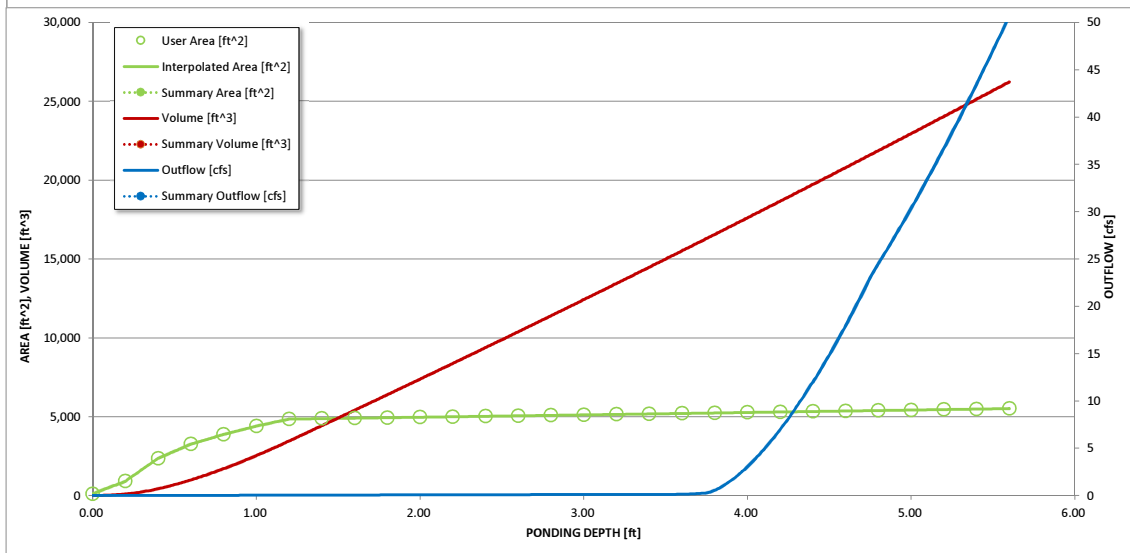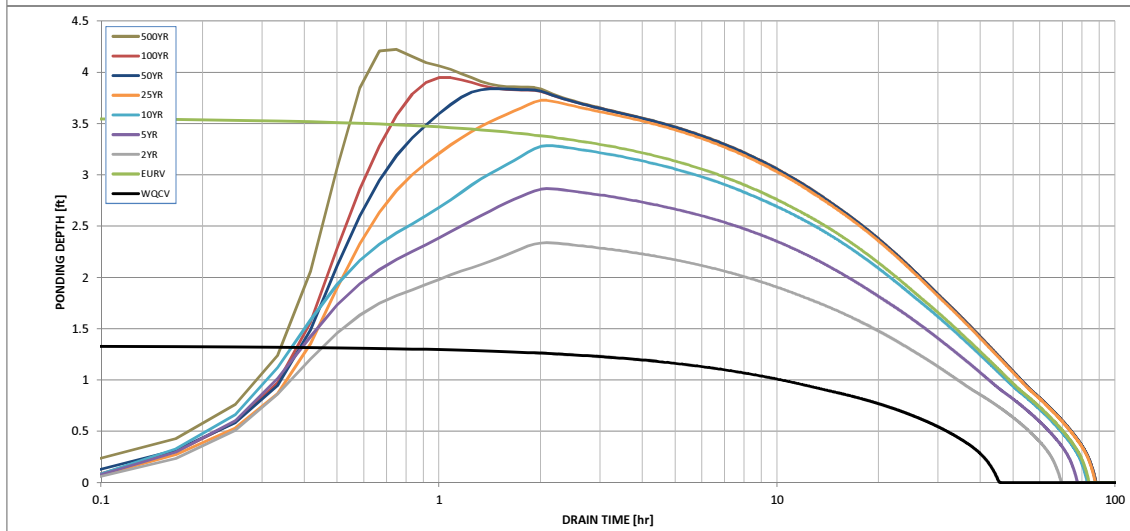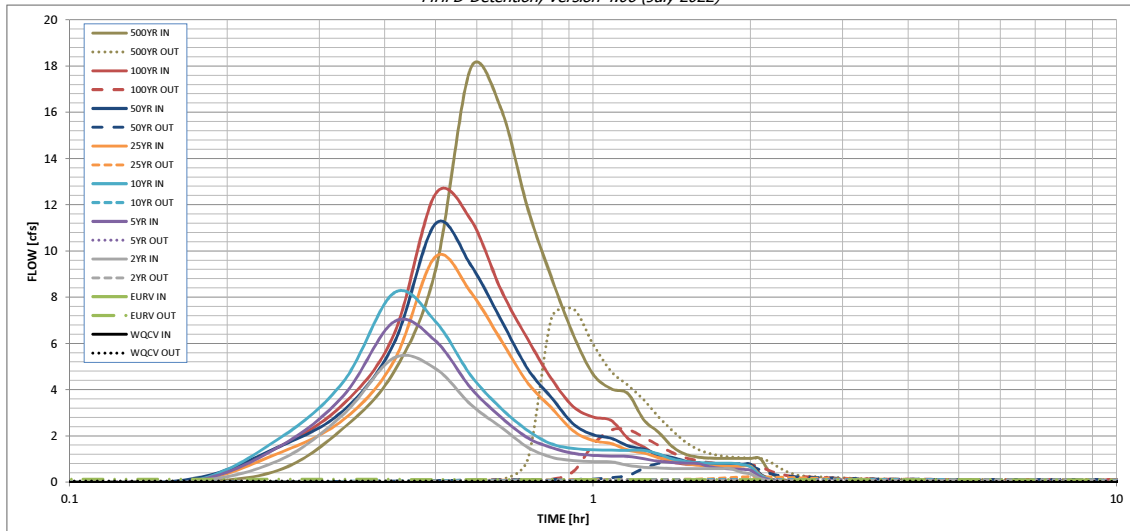

| S-A-V-D Chart Axis Override | X-axis | Left Y-Axis | Right Y-Axis |
|-----------------------------|--------|-------------|--------------|
| minimum bound               |        |             |              |
| maximum bound               |        |             |              |



# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

| Time Interval | SOURCE  | CUHP       | CUHP       | CUHP         | CUHP         | CUHP          | CUHP          | CUHP          | CUHP           | CUHP           |
|---------------|---------|------------|------------|--------------|--------------|---------------|---------------|---------------|----------------|----------------|
|               | TIME    | WQCV [cfs] | EURV [cfs] | 2 Year [cfs] | 5 Year [cfs] | 10 Year [cfs] | 25 Year [cfs] | 50 Year [cfs] | 100 Year [cfs] | 500 Year [cfs] |
| 5.00 min      | 0:00:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 0:05:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 0:10:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.10          | 0.01           | 0.51           |
|               | 0:15:00 | 0.00       | 0.00       | 0.93         | 1.51         | 1.86          | 1.25          | 1.52          | 1.51           | 2.34           |
|               | 0:20:00 | 0.00       | 0.00       | 2.94         | 3.74         | 4.35          | 2.71          | 3.10          | 3.38           | 4.79           |
|               | 0:25:00 | 0.00       | 0.00       | 5.38         | 6.95         | 8.20          | 5.25          | 6.02          | 6.41           | 9.17           |
|               | 0:30:00 | 0.00       | 0.00       | 4.92         | 6.11         | 6.95          | 9.75          | 11.18         | 12.47          | 17.90          |
|               | 0:35:00 | 0.00       | 0.00       | 3.37         | 4.09         | 4.63          | 8.24          | 9.41          | 11.37          | 16.17          |
|               | 0:40:00 | 0.00       | 0.00       | 2.39         | 2.82         | 3.20          | 6.15          | 7.03          | 8.33           | 11.86          |
|               | 0:45:00 | 0.00       | 0.00       | 1.51         | 1.92         | 2.24          | 4.30          | 4.90          | 6.19           | 8.83           |
|               | 0:50:00 | 0.00       | 0.00       | 1.08         | 1.49         | 1.65          | 3.21          | 3.65          | 4.46           | 6.38           |
|               | 0:55:00 | 0.00       | 0.00       | 0.94         | 1.25         | 1.47          | 2.22          | 2.52          | 3.27           | 4.68           |
|               | 1:00:00 | 0.00       | 0.00       | 0.89         | 1.16         | 1.41          | 1.81          | 2.06          | 2.82           | 4.04           |
|               | 1:05:00 | 0.00       | 0.00       | 0.88         | 1.13         | 1.39          | 1.67          | 1.90          | 2.67           | 3.83           |
|               | 1:10:00 | 0.00       | 0.00       | 0.73         | 1.12         | 1.38          | 1.39          | 1.57          | 1.89           | 2.70           |
|               | 1:15:00 | 0.00       | 0.00       | 0.65         | 1.01         | 1.38          | 1.27          | 1.43          | 1.52           | 2.16           |
|               | 1:20:00 | 0.00       | 0.00       | 0.61         | 0.91         | 1.22          | 1.06          | 1.20          | 1.10           | 1.54           |
|               | 1:25:00 | 0.00       | 0.00       | 0.59         | 0.85         | 1.01          | 0.96          | 1.08          | 0.87           | 1.21           |
|               | 1:30:00 | 0.00       | 0.00       | 0.59         | 0.83         | 0.90          | 0.81          | 0.91          | 0.79           | 1.09           |
|               | 1:35:00 | 0.00       | 0.00       | 0.59         | 0.82         | 0.85          | 0.74          | 0.83          | 0.75           | 1.04           |
|               | 1:40:00 | 0.00       | 0.00       | 0.59         | 0.68         | 0.83          | 0.71          | 0.80          | 0.75           | 1.03           |
|               | 1:45:00 | 0.00       | 0.00       | 0.59         | 0.61         | 0.82          | 0.69          | 0.78          | 0.75           | 1.03           |
|               | 1:50:00 | 0.00       | 0.00       | 0.59         | 0.58         | 0.82          | 0.69          | 0.78          | 0.75           | 1.03           |
|               | 1:55:00 | 0.00       | 0.00       | 0.43         | 0.56         | 0.78          | 0.69          | 0.78          | 0.75           | 1.03           |
|               | 2:00:00 | 0.00       | 0.00       | 0.36         | 0.52         | 0.66          | 0.69          | 0.78          | 0.75           | 1.03           |
|               | 2:05:00 | 0.00       | 0.00       | 0.16         | 0.24         | 0.31          | 0.33          | 0.37          | 0.35           | 0.49           |
|               | 2:10:00 | 0.00       | 0.00       | 0.07         | 0.11         | 0.13          | 0.14          | 0.16          | 0.16           | 0.21           |
|               | 2:15:00 | 0.00       | 0.00       | 0.03         | 0.04         | 0.05          | 0.06          | 0.07          | 0.06           | 0.09           |
|               | 2:20:00 | 0.00       | 0.00       | 0.01         | 0.01         | 0.01          | 0.01          | 0.01          | 0.01           | 0.02           |
|               | 2:25:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 2:30:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 2:35:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 2:40:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 2:45:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 2:50:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 2:55:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:00:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:05:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:10:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:15:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:20:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:25:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:30:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:35:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:40:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:45:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:50:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 3:55:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:00:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:05:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:10:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:15:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:20:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:25:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:30:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:35:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:40:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:45:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:50:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 4:55:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:00:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:05:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:10:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:15:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:20:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:25:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:30:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:35:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:40:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:45:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:50:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 5:55:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |
|               | 6:00:00 | 0.00       | 0.00       | 0.00         | 0.00         | 0.00          | 0.00          | 0.00          | 0.00           | 0.00           |

## DETENTION BASIN OUTLET STRUCTURE DESIGN

MHFD-Detention, Version 4.06 (July 2022)

### Summary Stage-Area-Volume-Discharge Relationships

The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

[illegible]

INLET MANAGEMENT

Worksheet Protected

| INLET NAME                         | DP1                     | DP2                     | DP6                      | DP6                      | DP3                     | DP8                     |
|------------------------------------|-------------------------|-------------------------|--------------------------|--------------------------|-------------------------|-------------------------|
| Site Type (Urban or Rural)         |                         |                         |                          |                          |                         |                         |
| Inlet Application (Street or Area) | AREA                    | AREA                    | STREET                   | STREET                   | AREA                    | AREA                    |
| Hydraulic Condition                | Swale                   | Swale                   | On Grade                 | On Grade                 | Swale                   | Swale                   |
| Inlet Type                         | CDOT Type C (Depressed) | CDOT Type C (Depressed) | CDOT Type R Curb Opening | CDOT Type R Curb Opening | CDOT Type C (Depressed) | CDOT Type C (Depressed) |

USER-DEFINED INPUT

|   |                         |                         |                         |                         |                         |                         |
|---|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|
| <b>User-Defined Design Flows</b>              |                         |                         |                         |                         |                         |                         |
| Minor $Q_{down}$ (cfs)                        | 0.4                     | 1.0                     | 1.4                     | 2.3                     | 1.7                     | 0.1                     |
| Major $Q_{down}$ (cfs)                        | 1.0                     | 2.4                     | 2.4                     | 4.1                     | 2.6                     | 0.4                     |
| <b>Bypass (Carry-Over) Flow from Upstream</b> |                         |                         |                         |                         |                         |                         |
| Receive Bypass Flow from:                     | No Bypass Flow Received | No Bypass Flow Received | No Bypass Flow Received | No Bypass Flow Received | No Bypass Flow Received | No Bypass Flow Received |
| Minor Bypass Flow Received, $Q_b$ (cfs)       | 0.0                     | 0.0                     | 0.0                     | 0.0                     | 0.0                     | 0.0                     |
| Major Bypass Flow Received, $Q_b$ (cfs)       | 0.0                     | 0.0                     | 0.0                     | 0.0                     | 0.0                     | 0.0                     |
| <b>Watershed Characteristics</b>              |                         |                         |                         |                         |                         |                         |
| Subcatchment Area (acres)                     |                         |                         |                         |                         |                         |                         |
| Percent Impervious                            |                         |                         |                         |                         |                         |                         |
| NRCS Soil Type                                |                         |                         |                         |                         |                         |                         |
| <b>Watershed Profile</b>                      |                         |                         |                         |                         |                         |                         |
| Overland Slope (ft/ft)                        |                         |                         |                         |                         |                         |                         |
| Overland Length (ft)                          |                         |                         |                         |                         |                         |                         |
| Channel Slope (ft/ft)                         |                         |                         |                         |                         |                         |                         |
| Channel Length (ft)                           |                         |                         |                         |                         |                         |                         |
| <b>Minor Storm Rainfall Input</b>             |                         |                         |                         |                         |                         |                         |
| Design Storm Return Period, $T_r$ (years)     |                         |                         |                         |                         |                         |                         |
| One-Hour Precipitation, $P_1$ (inches)        |                         |                         |                         |                         |                         |                         |
| <b>Major Storm Rainfall Input</b>             |                         |                         |                         |                         |                         |                         |
| Design Storm Return Period, $T_r$ (years)     |                         |                         |                         |                         |                         |                         |
| One-Hour Precipitation, $P_1$ (inches)        |                         |                         |                         |                         |                         |                         |


CALCULATED OUTPUT

|   |     |     |     |     |     |     |
|---|-----|-----|-----|-----|-----|-----|
| Minor Total Design Peak Flow, $Q$ (cfs)     | 0.4 | 1.0 | 1.4 | 2.3 | 1.7 | 0.1 |
| Major Total Design Peak Flow, $Q$ (cfs)     | 1.0 | 2.4 | 2.4 | 4.1 | 2.6 | 0.4 |
| Minor Flow Bypassed Downstream, $Q_b$ (cfs) | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |
| Major Flow Bypassed Downstream, $Q_b$ (cfs) | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

## AREA INLET IN A SWALE

NORTHCREST CENTER PEMBs - EL PASO COUNTY

DP1

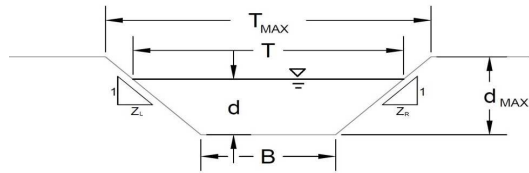

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

## Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

| Soil Type:   | Max. Velocity ( $V_{MAX}$ ) | Max Froude No. ( $F_{MAX}$ ) |
|--------------|-----------------------------|------------------------------|
| Non-Cohesive | 5.0 fps                     | 0.60                         |
| Cohesive     | 7.0 fps                     | 0.80                         |
| Paved        | N/A                         | N/A                          |

A, B, C, D, or E =

|         |        |       |
|---------|--------|-------|
| n =     | 0.012  |       |
| $S_o$ = | 0.0300 | ft/ft |
| B =     | 4.00   | ft    |
| Z1 =    | 0.02   | ft/ft |
| Z2 =    | 0.02   | ft/ft |

Choose One:

- ☐ Non-Cohesive  
☐ Cohesive  
☐ Paved

Maximum Allowable Top Width of Channel for Minor &amp; Major Storm

Maximum Allowable Water Depth in Channel for Minor &amp; Major Storm

|             | Minor Storm | Major Storm |    |
|-------------|-------------|-------------|----|
| $T_{MAX}$ = | 30.00       | 30.00       | ft |
| $d_{MAX}$ = | 0.50        | 0.50        | ft |

## Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

|               | Minor Storm | Major Storm |     |
|---------------|-------------|-------------|-----|
| $Q_{allow}$ = | 23.4        | 23.4        | cfs |
| $d_{allow}$ = | 0.50        | 0.50        | ft  |

## Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

|         |      |      |     |
|---------|------|------|-----|
| $Q_o$ = | 0.4  | 1.0  | cfs |
| d =     | 0.04 | 0.07 | ft  |

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'


Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

MHFD-Inlet, Version 5.01 (April 2021)

## AREA INLET IN A SWALE

**NORTHCREST CENTER PEMBs - EL PASO COUNTY**  
**DP1**

| Inlet Design Information (Input)  |   |
|---|---|
| Type of Inlet   | <div style="border: 1px solid black; padding: 2px; display: inline-block;">CDOT Type C (Depressed)</div>  |
| Inlet Type = <div style="border: 1px solid black; padding: 2px; display: inline-block;">CDOT Type C (Depressed)</div> |   |
| Angle of Inclined Gate (must be $\leq 30$ degrees)  | $\theta = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">1.19</div> degrees |
| Width of Gate   | $W = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">3.00</div> ft           |
| Length of Gate  | $L = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">3.00</div> ft           |
| Open Area Ratio   | $A_{RATIO} = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.70</div>      |
| Height of Inclined Gate   | $H_B = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.06</div> ft         |
| Clogging Factor   | $C_f = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.50</div>            |
| Grate Discharge Coefficient   | $C_d = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.79</div>            |
| Orifice Coefficient   | $C_o = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.52</div>            |
| Weir Coefficient  | $C_w = $ <div style="border: 1px solid black; padding: 2px; display: inline-block;">1.68</div>            |

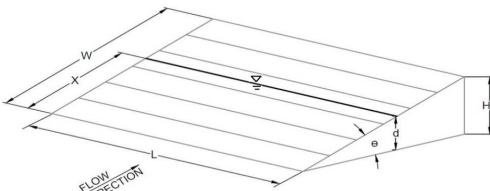

|          | MINOR | MAJOR |     |
|----------|-------|-------|-----|
| $d = $   | 1.04  | 1.07  |     |
| $Q_a = $ | 15.6  | 16.3  | cfs |
| $Q_b = $ | 0.0   | 0.0   | cfs |
| $C\% = $ | 100   | 100   | %   |

Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)

Total Inlet Interception Capacity (assumes clogged condition)


Bypassed Flow

Capture Percentage =  $Q_a/Q_o$

Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.

Warning 02: Depth (d) exceeds USDCM Volume I recommendation.

## AREA INLET IN A SWALE

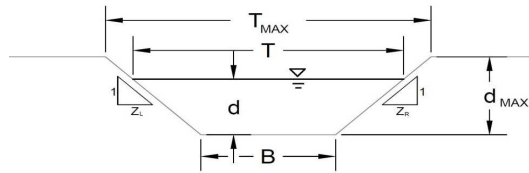NORTHCREST CENTER PEMBs - EL PASO COUNTY  
DP2

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

## Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

| Soil Type:   | Max. Velocity ( $V_{MAX}$ ) | Max Froude No. ( $F_{MAX}$ ) |
|--------------|-----------------------------|------------------------------|
| Non-Cohesive | 5.0 fps                     | 0.60                         |
| Cohesive     | 7.0 fps                     | 0.80                         |
| Paved        | N/A                         | N/A                          |

A, B, C, D, or E =

|         |        |       |
|---------|--------|-------|
| n =     | 0.012  |       |
| $S_o$ = | 0.0300 | ft/ft |
| B =     | 4.00   | ft    |
| Z1 =    | 0.02   | ft/ft |
| Z2 =    | 0.02   | ft/ft |

Choose One:

- ☐ Non-Cohesive  
☐ Cohesive  
☐ Paved

Maximum Allowable Top Width of Channel for Minor &amp; Major Storm

Maximum Allowable Water Depth in Channel for Minor &amp; Major Storm

|             | Minor Storm | Major Storm |    |
|-------------|-------------|-------------|----|
| $T_{MAX}$ = | 30.00       | 30.00       | ft |
| $d_{MAX}$ = | 0.50        | 0.50        | ft |

## Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

|               | Minor Storm | Major Storm |     |
|---------------|-------------|-------------|-----|
| $Q_{allow}$ = | 23.4        | 23.4        | cfs |
| $d_{allow}$ = | 0.50        | 0.50        | ft  |

## Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

|         |      |      |     |
|---------|------|------|-----|
| $Q_o$ = | 1.0  | 2.4  | cfs |
| d =     | 0.07 | 0.12 | ft  |

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

MHFD-Inlet, Version 5.01 (April 2021)

## AREA INLET IN A SWALE


**NORTHCREST CENTER PEMBs - EL PASO COUNTY**  
**DP2**

| Inlet Design Information (Input)  |   |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
|---|---|-------|-------|-------|--|-----|------|------|--|---------|------|------|-----|---------|-----|-----|-----|------|-----|-----|---|
| Type of Inlet   | <div style="border: 1px solid black; padding: 2px; display: inline-block;">CDOT Type C (Depressed)</div>  |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Inlet Type = <div style="border: 1px solid black; padding: 2px; display: inline-block;">CDOT Type C (Depressed)</div>   |   |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Angle of Inclined Gate (must be <= 30 degrees)  | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">1.19</div> <div style="margin-left: 5px;">degrees</div> </div> </div> |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Width of Gate   | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">3.00</div> <div style="margin-left: 5px;">ft</div> </div> </div>      |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Length of Gate  | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">3.00</div> <div style="margin-left: 5px;">ft</div> </div> </div>      |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Open Area Ratio   | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.70</div> </div> </div>  |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Height of Inclined Gate   | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.06</div> <div style="margin-left: 5px;">ft</div> </div> </div>      |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Clogging Factor   | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.50</div> </div> </div>  |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Grate Discharge Coefficient   | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.79</div> </div> </div>  |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Orifice Coefficient   | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">0.52</div> </div> </div>  |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| Weir Coefficient  | <div style="display: flex; align-items: center;"> <div style="flex: 1;"> <div style="border: 1px solid black; padding: 2px; display: inline-block;">1.68</div> </div> </div>  |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| <div style="display: flex; align-items: center;"> <div style="margin-left: 20px;"> <p>Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)</p> <p>Total Inlet Interception Capacity (assumes clogged condition)</p> <p>Bypassed Flow</p> <p>Capture Percentage = <math>Q_a/Q_o</math></p> </div> </div>  |   |       |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| <table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="text-align: center; border-bottom: 1px solid black;">MINOR</th> <th style="text-align: center; border-bottom: 1px solid black;">MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td>d =</td> <td style="text-align: center; border: 1px solid black;">1.07</td> <td style="text-align: center; border: 1px solid black;">1.12</td> <td></td> </tr> <tr> <td><math>Q_a</math> =</td> <td style="text-align: center; border: 1px solid black;">16.4</td> <td style="text-align: center; border: 1px solid black;">17.4</td> <td style="text-align: right; border: 1px solid black;">cfs</td> </tr> <tr> <td><math>Q_b</math> =</td> <td style="text-align: center; border: 1px solid black;">0.0</td> <td style="text-align: center; border: 1px solid black;">0.0</td> <td style="text-align: right; border: 1px solid black;">cfs</td> </tr> <tr> <td>C% =</td> <td style="text-align: center; border: 1px solid black;">100</td> <td style="text-align: center; border: 1px solid black;">100</td> <td style="text-align: right; border: 1px solid black;">%</td> </tr> </tbody> </table> |   |       | MINOR | MAJOR |  | d = | 1.07 | 1.12 |  | $Q_a$ = | 16.4 | 17.4 | cfs | $Q_b$ = | 0.0 | 0.0 | cfs | C% = | 100 | 100 | % |
|   | MINOR   | MAJOR |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| d =   | 1.07  | 1.12  |       |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| $Q_a$ =   | 16.4  | 17.4  | cfs   |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| $Q_b$ =   | 0.0   | 0.0   | cfs   |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |
| C% =  | 100   | 100   | %     |       |  |     |      |      |  |         |      |      |     |         |     |     |     |      |     |     |   |

Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.

Warning 02: Depth (d) exceeds USDCM Volume I recommendation.

## AREA INLET IN A SWALE

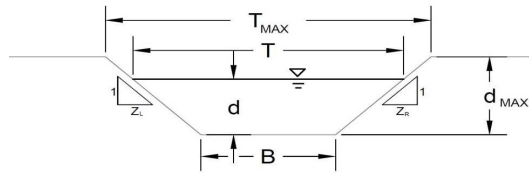NORTHCREST CENTER PEMBs - EL PASO COUNTY  
DP3

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

## Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

| Soil Type:   | Max. Velocity ( $V_{MAX}$ ) | Max Froude No. ( $F_{MAX}$ ) |
|--------------|-----------------------------|------------------------------|
| Non-Cohesive | 5.0 fps                     | 0.60                         |
| Cohesive     | 7.0 fps                     | 0.80                         |
| Paved        | N/A                         | N/A                          |

A, B, C, D, or E =

|         |        |       |
|---------|--------|-------|
| n =     | 0.012  |       |
| $S_o$ = | 0.0300 | ft/ft |
| B =     | 4.00   | ft    |
| Z1 =    | 0.02   | ft/ft |
| Z2 =    | 0.02   | ft/ft |

Choose One:

- ☐ Non-Cohesive  
☐ Cohesive  
☐ Paved

Maximum Allowable Top Width of Channel for Minor &amp; Major Storm

Maximum Allowable Water Depth in Channel for Minor &amp; Major Storm

|             | Minor Storm | Major Storm |    |
|-------------|-------------|-------------|----|
| $T_{MAX}$ = | 30.00       | 30.00       | ft |
| $d_{MAX}$ = | 0.50        | 0.50        | ft |

## Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

|               | Minor Storm | Major Storm |     |
|---------------|-------------|-------------|-----|
| $Q_{allow}$ = | 23.4        | 23.4        | cfs |
| $d_{allow}$ = | 0.50        | 0.50        | ft  |

## Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

|         |      |      |     |
|---------|------|------|-----|
| $Q_o$ = | 1.7  | 2.6  | cfs |
| d =     | 0.10 | 0.13 | ft  |

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'


Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'



MHFD-Inlet, Version 5.01 (April 2021)

## AREA INLET IN A SWALE


**NORTHCREST CENTER PEMBs - EL PASO COUNTY**  
**DP3**
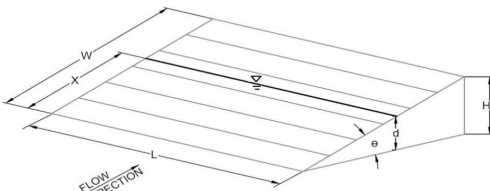
| Inlet Design Information (Input)  |   |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
|---|---|---------|-------|---------|-----|------|------|------|------|------------------|----------------------|------|-----|------------------|------|-----|------------------|------|-----|------------------|------|--|------------------|------|--|------------------|------|--|
| Type of Inlet: <span style="border: 1px solid black; padding: 2px;">CDOT Type C (Depressed)</span>  | Inlet Type = <span style="border: 1px solid black; padding: 2px;">CDOT Type C (Depressed)</span>  |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| Angle of Inclined Gate (must be <= 30 degrees)<br>Width of Gate<br>Length of Gate<br>Open Area Ratio<br>Height of Inclined Gate<br>Clogging Factor<br>Gate Discharge Coefficient<br>Orifice Coefficient<br>Weir Coefficient | <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="text-align: right;">θ =</td> <td style="border: 1px solid black; text-align: center;">1.20</td> <td style="text-align: left;">degrees</td> </tr> <tr> <td style="text-align: right;">W =</td> <td style="border: 1px solid black; text-align: center;">3.00</td> <td style="text-align: left;">ft</td> </tr> <tr> <td style="text-align: right;">L =</td> <td style="border: 1px solid black; text-align: center;">3.00</td> <td style="text-align: left;">ft</td> </tr> <tr> <td style="text-align: right;">A<sub>RATIO</sub> =</td> <td style="border: 1px solid black; text-align: center;">0.70</td> <td></td> </tr> <tr> <td style="text-align: right;">H<sub>B</sub> =</td> <td style="border: 1px solid black; text-align: center;">0.06</td> <td style="text-align: left;">ft</td> </tr> <tr> <td style="text-align: right;">C<sub>f</sub> =</td> <td style="border: 1px solid black; text-align: center;">0.50</td> <td></td> </tr> <tr> <td style="text-align: right;">C<sub>d</sub> =</td> <td style="border: 1px solid black; text-align: center;">0.78</td> <td></td> </tr> <tr> <td style="text-align: right;">C<sub>o</sub> =</td> <td style="border: 1px solid black; text-align: center;">0.52</td> <td></td> </tr> <tr> <td style="text-align: right;">C<sub>w</sub> =</td> <td style="border: 1px solid black; text-align: center;">1.68</td> <td></td> </tr> </table> | θ =     | 1.20  | degrees | W = | 3.00 | ft   | L =  | 3.00 | ft               | A <sub>RATIO</sub> = | 0.70 |     | H <sub>B</sub> = | 0.06 | ft  | C <sub>f</sub> = | 0.50 |     | C <sub>d</sub> = | 0.78 |  | C <sub>o</sub> = | 0.52 |  | C <sub>w</sub> = | 1.68 |  |
| θ =   | 1.20  | degrees |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| W =   | 3.00  | ft      |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| L =   | 3.00  | ft      |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| A <sub>RATIO</sub> =  | 0.70  |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| H <sub>B</sub> =  | 0.06  | ft      |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| C <sub>f</sub> =  | 0.50  |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| C <sub>d</sub> =  | 0.78  |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| C <sub>o</sub> =  | 0.52  |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| C <sub>w</sub> =  | 1.68  |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
|    | <table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="text-align: center; border-bottom: 1px solid black;">MINOR</th> <th style="text-align: center; border-bottom: 1px solid black;">MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td style="text-align: right;">d =</td> <td style="border: 1px solid black; text-align: center;">1.10</td> <td style="border: 1px solid black; text-align: center;">1.13</td> <td></td> </tr> <tr> <td style="text-align: right;">Q<sub>a</sub> =</td> <td style="border: 1px solid black; text-align: center;">16.9</td> <td style="border: 1px solid black; text-align: center;">17.6</td> <td style="text-align: left;">cfs</td> </tr> <tr> <td style="text-align: right;">Q<sub>b</sub> =</td> <td style="border: 1px solid black; text-align: center;">0.0</td> <td style="border: 1px solid black; text-align: center;">0.0</td> <td style="text-align: left;">cfs</td> </tr> <tr> <td style="text-align: right;">C% =</td> <td style="border: 1px solid black; text-align: center;">100</td> <td style="border: 1px solid black; text-align: center;">100</td> <td style="text-align: left;">%</td> </tr> </tbody> </table>   |         | MINOR | MAJOR   |     | d =  | 1.10 | 1.13 |      | Q <sub>a</sub> = | 16.9                 | 17.6 | cfs | Q <sub>b</sub> = | 0.0  | 0.0 | cfs              | C% = | 100 | 100              | %    |  |                  |      |  |                  |      |  |
|   | MINOR   | MAJOR   |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| d =   | 1.10  | 1.13    |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| Q <sub>a</sub> =  | 16.9  | 17.6    | cfs   |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| Q <sub>b</sub> =  | 0.0   | 0.0     | cfs   |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| C% =  | 100   | 100     | %     |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |
| Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)<br>Total Inlet Interception Capacity (assumes clogged condition)<br>Bypassed Flow<br>Capture Percentage = Q <sub>a</sub> /Q <sub>o</sub>        |   |         |       |         |     |      |      |      |      |                  |                      |      |     |                  |      |     |                  |      |     |                  |      |  |                  |      |  |                  |      |  |

**Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.**  
**Warning 02: Depth (d) exceeds USDCM Volume I recommendation.**

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

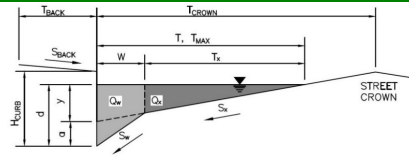Project: **NORTHCREST CENTER PEMBS - EL PASO COUNTY**Inlet ID: **DP5****Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 0.0$  ft  
 $S_{BACK} =$  ft/ft  
 $n_{BACK} =$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 60.0$  ft  
 $W = 2.00$  ft  
 $S_X = 0.040$  ft/ft  
 $S_W = 0.083$  ft/ft  
 $S_O = 0.035$  ft/ft  
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (check box for yes, leave blank for no)

|             | Minor Storm              | Major Storm              |        |
|-------------|--------------------------|--------------------------|--------|
| $T_{MAX} =$ | 5.0                      | 6.0                      | ft     |
| $d_{MAX} =$ | 6.0                      | 6.0                      | inches |
|             | <input type="checkbox"/> | <input type="checkbox"/> |        |

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion

$Q_{allow} =$


|  | Minor Storm | Major Storm |     |
|--|-------------|-------------|-----|
|  | 3.1         | 4.6         | cfs |

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

# INLET ON A CONTINUOUS GRADE


MHFD-Inlet, Version 5.01 (April 2021)

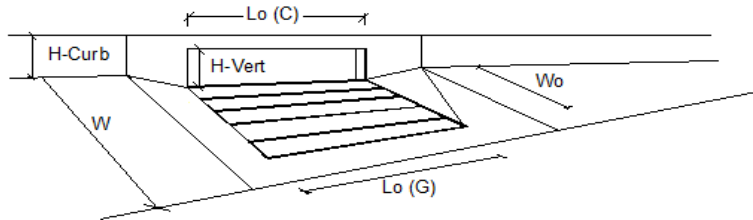

| Design Information (Input)  |                          | MINOR         |                          | MAJOR |        |
|---|--------------------------|---------------|--------------------------|-------|--------|
| Type of Inlet   | CDOT Type R Curb Opening | Type =        | CDOT Type R Curb Opening |       |        |
| Local Depression (additional to continuous gutter depression 'a')                   |                          | $a_{LOCAL}$ = | 3.0                      | 3.0   | inches |
| Total Number of Units in the Inlet (Grate or Curb Opening)                          |                          | $N_u$ =       | 2                        | 2     |        |
| Length of a Single Unit Inlet (Grate or Curb Opening)                               |                          | $L_u$ =       | 5.00                     | 5.00  | ft     |
| Width of a Unit Grate (cannot be greater than W, Gutter Width)                      |                          | $W_u$ =       | N/A                      | N/A   | ft     |
| Clogging Factor for a Single Unit Grate (typical min. value = 0.5)                  |                          | $C_r-G$ =     | N/A                      | N/A   |        |
| Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)           |                          | $C_r-C$ =     | 0.10                     | 0.10  |        |
| <b>Street Hydraulics: OK - <math>Q &lt; \text{Allowable Street Capacity}</math></b> |                          |               |                          |       |        |
| Total Inlet Interception Capacity   |                          | $Q$ =         | 2.3                      | 4.1   | cfs    |
| Total Inlet Carry-Over Flow (flow bypassing inlet)                                  |                          | $Q_b$ =       | 0.0                      | 0.0   | cfs    |
| Capture Percentage = $Q_u/Q_a$ =  |                          | $C\%$ =       | 100                      | 100   | %      |

**ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)**

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

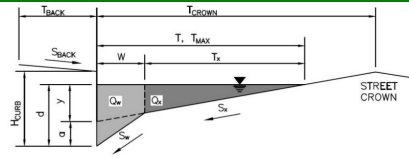Project: **NORTHCREST CENTER PEMBS - EL PASO COUNTY**Inlet ID: **DP6****Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

|            |   |     |       |
|------------|---|-----|-------|
| $T_{BACK}$ | = | 0.0 | ft    |
| $S_{BACK}$ | = |     | ft/ft |
| $n_{BACK}$ | = |     |       |

|              |   |       |        |
|--------------|---|-------|--------|
| $H_{CURB}$   | = | 6.00  | inches |
| $T_{CROWN}$  | = | 12.0  | ft     |
| $W$          | = | 2.00  | ft     |
| $S_x$        | = | 0.040 | ft/ft  |
| $S_w$        | = | 0.083 | ft/ft  |
| $S_o$        | = | 0.042 | ft/ft  |
| $n_{STREET}$ | = | 0.016 |        |

Max. Allowable Spread for Minor &amp; Major Storm

Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm

Allow Flow Depth at Street Crown (check box for yes, leave blank for no)

|           | Minor Storm              | Major Storm              |        |
|-----------|--------------------------|--------------------------|--------|
| $T_{MAX}$ | 4.0                      | 5.0                      | ft     |
| $d_{MAX}$ | 6.0                      | 6.0                      | inches |
|           | <input type="checkbox"/> | <input type="checkbox"/> |        |

MINOR STORM Allowable Capacity is based on Spread Criterion


MAJOR STORM Allowable Capacity is based on Spread Criterion

|             | Minor Storm | Major Storm |     |
|-------------|-------------|-------------|-----|
| $Q_{allow}$ | 2.2         | 3.4         | cfs |

**Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'****Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'**

# INLET ON A CONTINUOUS GRADE

MHFD-Inlet, Version 5.01 (April 2021)

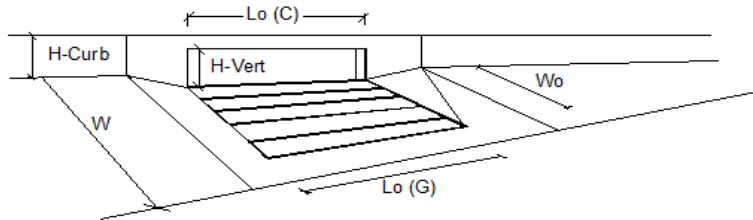


| Design Information (Input)  |                          | MINOR         |                          | MAJOR |        |
|---|--------------------------|---------------|--------------------------|-------|--------|
| Type of Inlet   | CDOT Type R Curb Opening | Type =        | CDOT Type R Curb Opening |       |        |
| Local Depression (additional to continuous gutter depression 'a')                   |                          | $a_{LOCAL}$ = | 3.0                      | 3.0   | inches |
| Total Number of Units in the Inlet (Grate or Curb Opening)                          |                          | $N_u$ =       | 2                        | 2     |        |
| Length of a Single Unit Inlet (Grate or Curb Opening)                               |                          | $L_u$ =       | 5.00                     | 5.00  | ft     |
| Width of a Unit Grate (cannot be greater than W, Gutter Width)                      |                          | $W_u$ =       | N/A                      | N/A   | ft     |
| Clogging Factor for a Single Unit Grate (typical min. value = 0.5)                  |                          | $C_r-G$ =     | N/A                      | N/A   |        |
| Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)           |                          | $C_r-C$ =     | 0.10                     | 0.10  |        |
| <b>Street Hydraulics: OK - <math>Q &lt; \text{Allowable Street Capacity}</math></b> |                          |               |                          |       |        |
| Total Inlet Interception Capacity   |                          | $Q$ =         | 1.3                      | 2.4   | cfs    |
| Total Inlet Carry-Over Flow (flow bypassing inlet)                                  |                          | $Q_b$ =       | 0.0                      | 0.0   | cfs    |
| Capture Percentage = $Q_u/Q_a$ =  |                          | $C\%$ =       | 100                      | 100   | %      |

## AREA INLET IN A SWALE

NORTHCREST CENTER PEMBs - EL PASO COUNTY

DP8

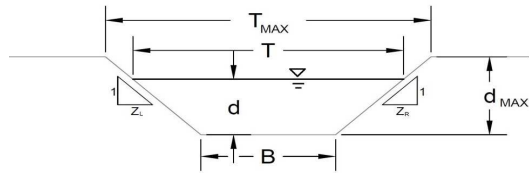

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

## Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

| Soil Type:   | Max. Velocity ( $V_{MAX}$ ) | Max Froude No. ( $F_{MAX}$ ) |
|--------------|-----------------------------|------------------------------|
| Non-Cohesive | 5.0 fps                     | 0.60                         |
| Cohesive     | 7.0 fps                     | 0.80                         |
| Paved        | N/A                         | N/A                          |

A, B, C, D, or E =

|         |        |       |
|---------|--------|-------|
| n =     | 0.012  |       |
| $S_o$ = | 0.0300 | ft/ft |
| B =     | 4.00   | ft    |
| Z1 =    | 0.02   | ft/ft |
| Z2 =    | 0.02   | ft/ft |

Choose One:

- ☒ Non-Cohesive  
☐ Cohesive  
☐ Paved

Maximum Allowable Top Width of Channel for Minor &amp; Major Storm

Maximum Allowable Water Depth in Channel for Minor &amp; Major Storm

|             | Minor Storm | Major Storm |    |
|-------------|-------------|-------------|----|
| $T_{MAX}$ = | 30.00       | 30.00       | ft |
| $d_{MAX}$ = | 0.50        | 0.50        | ft |

## Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

|               | Minor Storm | Major Storm |     |
|---------------|-------------|-------------|-----|
| $Q_{allow}$ = | 23.4        | 23.4        | cfs |
| $d_{allow}$ = | 0.50        | 0.50        | ft  |

## Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

|         |      |      |     |
|---------|------|------|-----|
| $Q_o$ = | 0.1  | 0.4  | cfs |
| d =     | 0.02 | 0.04 | ft  |


Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

MHFD-Inlet, Version 5.01 (April 2021)

## AREA INLET IN A SWALE

**NORTHCREST CENTER PEMBs - EL PASO COUNTY**  
**DP8**
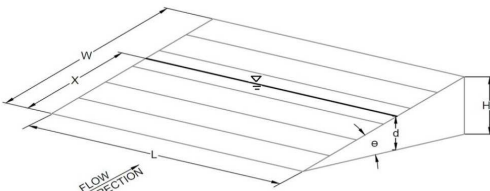
| Inlet Design Information (Input)   |  |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
|--|--|------------|-------|---------|-------|-------|------|-------|------|---------|---------------|------|-----|---------|------|-----|---------|---------|-----|---------|------|--|---------|------|--|---------|------|--|
| Type of Inlet: <span style="border: 1px solid black; padding: 2px;">CDOT Type C (Depressed)</span>   | Inlet Type = <span style="border: 1px solid black; padding: 2px;">CDOT Type C (Depressed)</span>   |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| Angle of Inclined Grate (must be $\leq 30$ degrees)<br>Width of Grate<br>Length of Grate<br>Open Area Ratio<br>Height of Inclined Grate<br>Clogging Factor<br>Grate Discharge Coefficient<br>Orifice Coefficient<br>Weir Coefficient | <div style="display: flex; align-items: center;">  <table style="border-collapse: collapse;"> <tr><td><math>\theta =</math></td><td style="border: 1px solid black; text-align: center;">0.50</td><td>degrees</td></tr> <tr><td><math>W =</math></td><td style="border: 1px solid black; text-align: center;">3.00</td><td>ft</td></tr> <tr><td><math>L =</math></td><td style="border: 1px solid black; text-align: center;">3.00</td><td>ft</td></tr> <tr><td><math>A_{RATIO} =</math></td><td style="border: 1px solid black; text-align: center;">0.70</td><td></td></tr> <tr><td><math>H_b =</math></td><td style="border: 1px solid black; text-align: center;">0.03</td><td>ft</td></tr> <tr><td><math>C_f =</math></td><td style="border: 1px solid black; text-align: center;">0.50</td><td></td></tr> <tr><td><math>C_d =</math></td><td style="border: 1px solid black; text-align: center;">0.82</td><td></td></tr> <tr><td><math>C_o =</math></td><td style="border: 1px solid black; text-align: center;">0.55</td><td></td></tr> <tr><td><math>C_w =</math></td><td style="border: 1px solid black; text-align: center;">1.75</td><td></td></tr> </table> </div> | $\theta =$ | 0.50  | degrees | $W =$ | 3.00  | ft   | $L =$ | 3.00 | ft      | $A_{RATIO} =$ | 0.70 |     | $H_b =$ | 0.03 | ft  | $C_f =$ | 0.50    |     | $C_d =$ | 0.82 |  | $C_o =$ | 0.55 |  | $C_w =$ | 1.75 |  |
| $\theta =$   | 0.50   | degrees    |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $W =$  | 3.00   | ft         |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $L =$  | 3.00   | ft         |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $A_{RATIO} =$  | 0.70   |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $H_b =$  | 0.03   | ft         |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $C_f =$  | 0.50   |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $C_d =$  | 0.82   |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $C_o =$  | 0.55   |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $C_w =$  | 1.75   |            |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)<br>Total Inlet Interception Capacity (assumes clogged condition)<br>Bypassed Flow<br>Capture Percentage = $Q_a/Q_o$                                      | <table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="text-align: center; border-bottom: 1px solid black;">MINOR</th> <th style="text-align: center; border-bottom: 1px solid black;">MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td><math>d =</math></td> <td style="border: 1px solid black; text-align: center;">1.02</td> <td style="border: 1px solid black; text-align: center;">1.04</td> <td></td> </tr> <tr> <td><math>Q_a =</math></td> <td style="border: 1px solid black; text-align: center;">16.1</td> <td style="border: 1px solid black; text-align: center;">16.6</td> <td>cfs</td> </tr> <tr> <td><math>Q_b =</math></td> <td style="border: 1px solid black; text-align: center;">0.0</td> <td style="border: 1px solid black; text-align: center;">0.0</td> <td>cfs</td> </tr> <tr> <td><math>C\% =</math></td> <td style="border: 1px solid black; text-align: center;">100</td> <td style="border: 1px solid black; text-align: center;">100</td> <td>%</td> </tr> </tbody> </table>   |            | MINOR | MAJOR   |       | $d =$ | 1.02 | 1.04  |      | $Q_a =$ | 16.1          | 16.6 | cfs | $Q_b =$ | 0.0  | 0.0 | cfs     | $C\% =$ | 100 | 100     | %    |  |         |      |  |         |      |  |
|  | MINOR  | MAJOR      |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $d =$  | 1.02   | 1.04       |       |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $Q_a =$  | 16.1   | 16.6       | cfs   |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $Q_b =$  | 0.0  | 0.0        | cfs   |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |
| $C\% =$  | 100  | 100        | %     |         |       |       |      |       |      |         |               |      |     |         |      |     |         |         |     |         |      |  |         |      |  |         |      |  |

**Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.**

**Warning 02: Depth (d) exceeds USDCM Volume I recommendation.**

**Warning 04: Froude No. exceeds USDCM Volume I recommendation.**

# Design Procedure Form: Extended Detention Basin (EDB)

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

Designer:

Company:

Rocky Mountain Group

Date:

January 11, 2023

Project:

Northcrest

Location:

## 1. Basin Storage Volume

A) Effective Imperviousness of Tributary Area,  $I_a$

$I_a = 86.5$  %

B) Tributary Area's Imperviousness Ratio ( $i = I_a / 100$ )

$i = 0.865$

C) Contributing Watershed Area

Area = 3.020 ac

D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm

$d_s =$  in

E) Design Concept

(Select EURV when also designing for flood control)

Choose One

☐ Water Quality Capture Volume (WQCV)

☒ Excess Urban Runoff Volume (EURV)

F) Design Volume (WQCV) Based on 40-hour Drain Time  
( $V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i) / 12 * \text{Area})$ )

$V_{DESIGN} =$  ac-ft

G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume  
( $V_{WQCV\ OTHER} = (d_s * (V_{DESIGN} / 0.43))$ )

$V_{DESIGN\ OTHER} =$  ac-ft

H) User Input of Water Quality Capture Volume (WQCV) Design Volume  
(Only if a different WQCV Design Volume is desired)

$V_{DESIGN\ USER} = 0.094$  ac-ft

I) NRCS Hydrologic Soil Groups of Tributary Watershed  
i) Percentage of Watershed consisting of Type A Soils  
ii) Percentage of Watershed consisting of Type B Soils  
iii) Percentage of Watershed consisting of Type C/D Soils

HSG A = 100 %

HSG B = 0 %

HSG C/D = 0 %

J) Excess Urban Runoff Volume (EURV) Design Volume

For HSG A:  $EURV_A = 1.68 * i^{1.28}$

For HSG B:  $EURV_B = 1.36 * i^{1.08}$

For HSG C/D:  $EURV_{C/D} = 1.20 * i^{1.08}$

$EURV_{DESIGN} =$  ac-ft

K) User Input of Excess Urban Runoff Volume (EURV) Design Volume  
(Only if a different EURV Design Volume is desired)

$EURV_{DESIGN\ USER} = 0.257$  ac-ft

## 2. Basin Shape: Length to Width Ratio

(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

L : W = 3.0 : 1

## 3. Basin Side Slopes

A) Basin Maximum Side Slopes

(Horizontal distance per unit vertical, 4:1 or flatter preferred)

Z = 1.00 ft / ft **TOO STEEP (< 3)**

## 4. Inlet

A) Describe means of providing energy dissipation at concentrated inflow locations:

## 5. Forebay

A) Minimum Forebay Volume

( $V_{MIN} = 2\%$  of the WQCV)

$V_{MIN} = 0.002$  ac-ft

B) Actual Forebay Volume

$V_F = 0.003$  ac-ft

C) Forebay Depth

( $D_F = 18$  inch maximum)

$D_F = 18.0$  in **8"**

D) Forebay Discharge

i) Undetained 100-year Peak Discharge

$Q_{100} = 2.30$  cfs

ii) Forebay Discharge Design Flow

( $Q_F = 0.02 * Q_{100}$ )

$Q_F = 0.05$  cfs

E) Forebay Discharge Design

Choose One

☐ Berm With Pipe

☒ Wall with Rect. Notch

☐ Wall with V-Notch Weir

F) Discharge Pipe Size (minimum 8-inches)

Calculated  $D_P =$  in




G) Rectangular Notch Width

Calculated  $W_N = 3.7$  in

This is the detained flow, not the undetained flow. Use two spreadsheets. One for each forebay. Use 10.33cfs (F1) and 4.07cfs (F2) as calculated for V5




Flow too small for berm w/ pipe



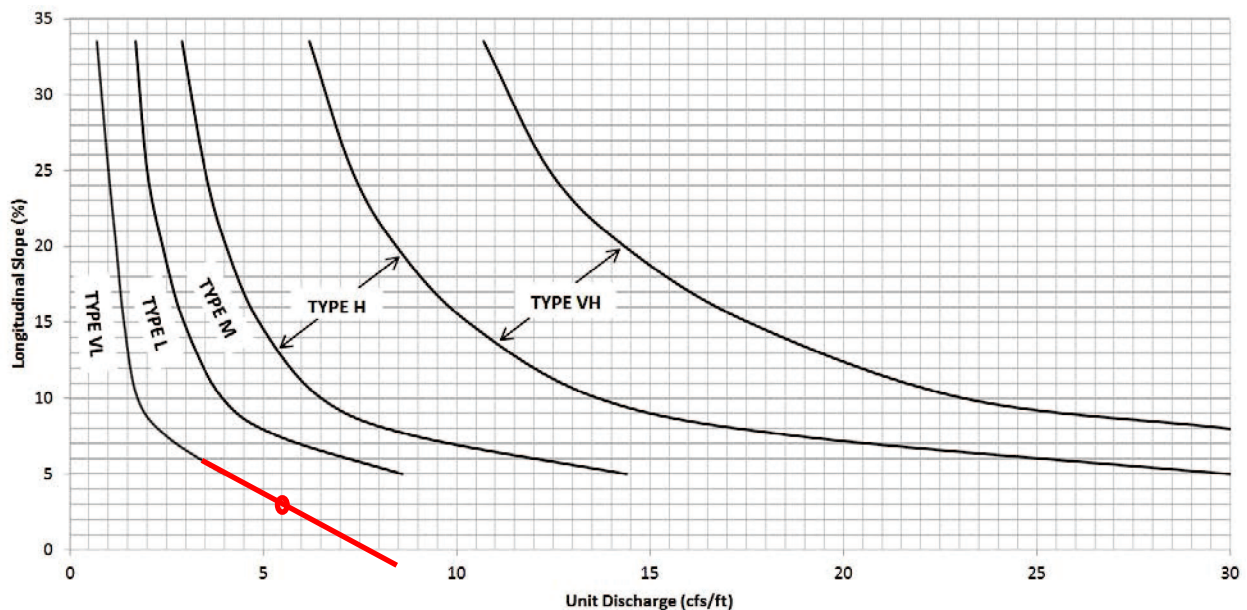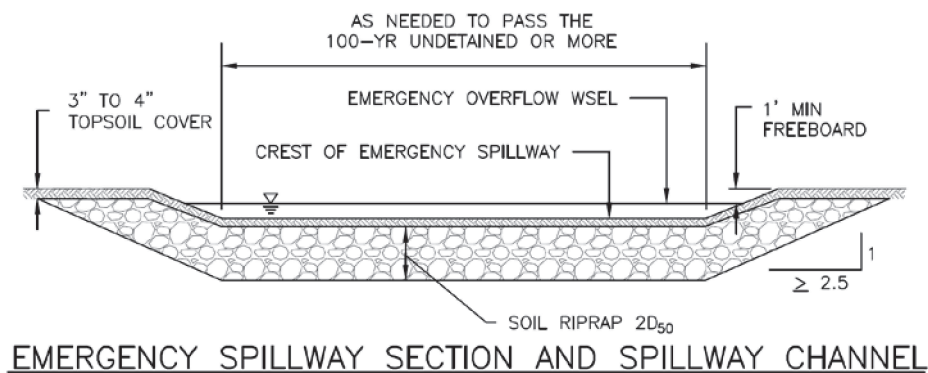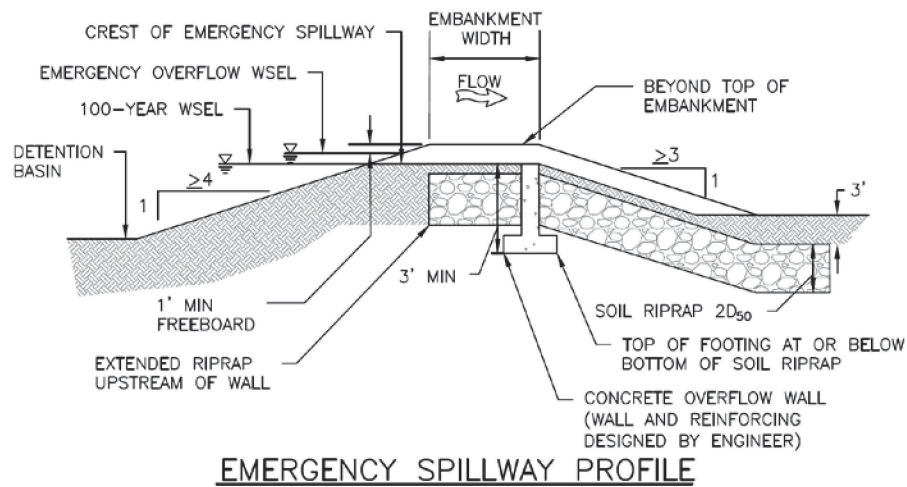

**Figure 12-21. Embankment protection details and rock sizing chart** (adapted from Arapahoe County)

Forebay (West) ~ Slope = 3% and 100-Year Peak Discharge = 5.6 cfs

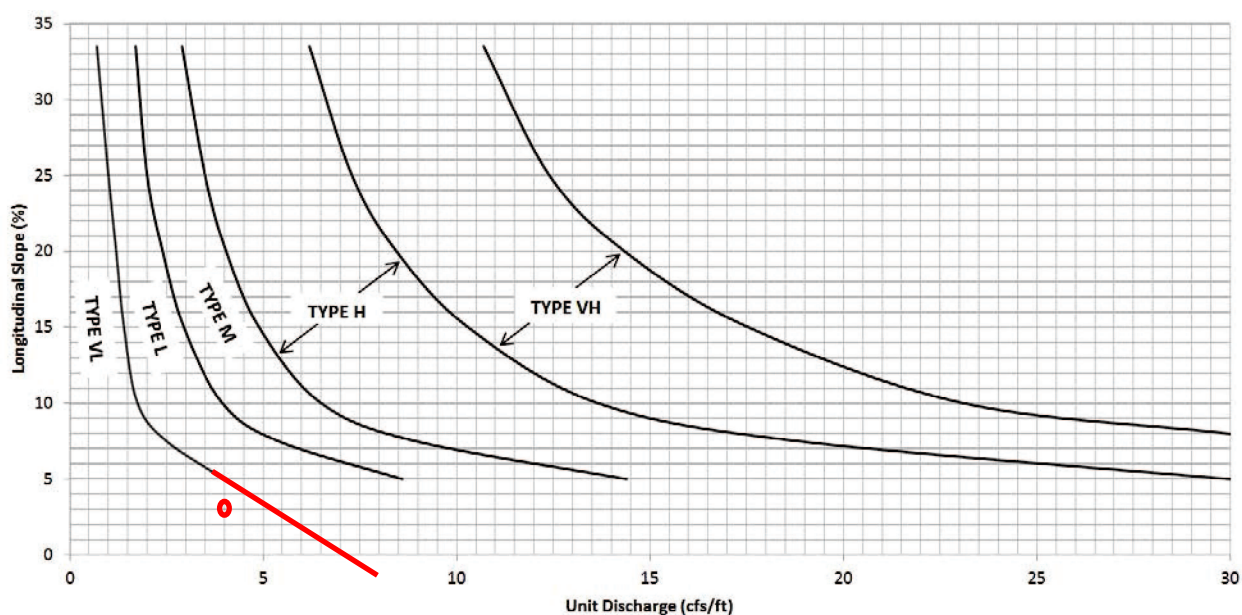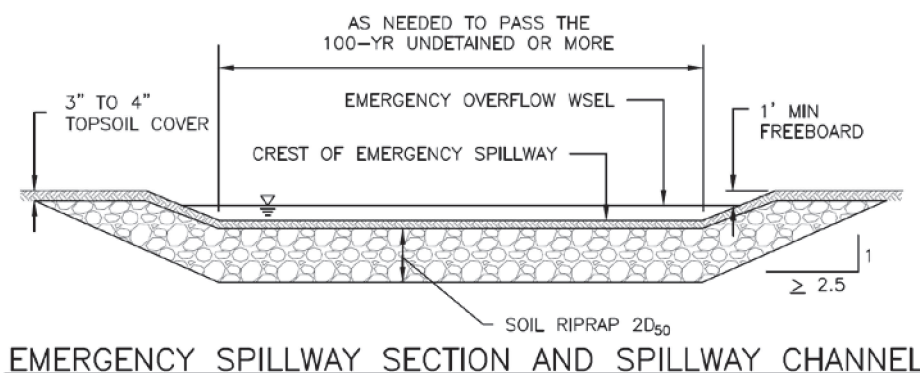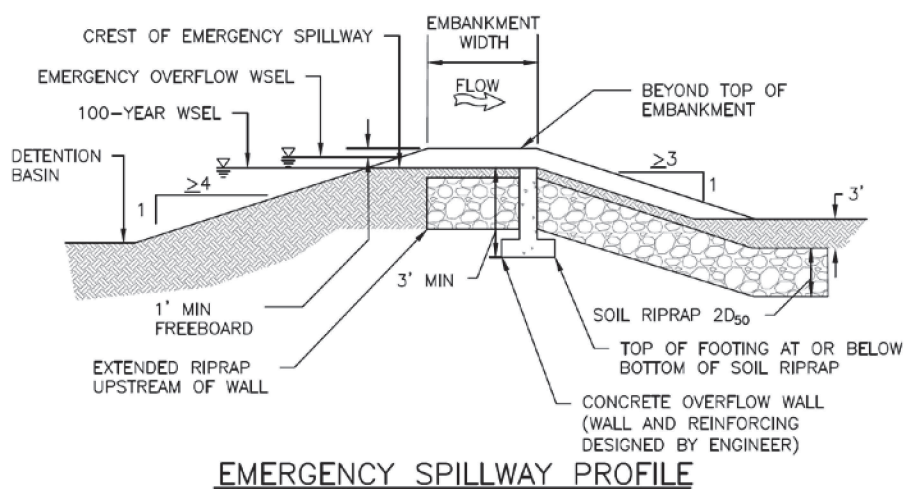

**Figure 12-21. Embankment protection details and rock sizing chart** (adapted from Arapahoe County)

Forebay (East)~~ Slope = 3% and 100-Year Peak Discharge = 4.07 cfs



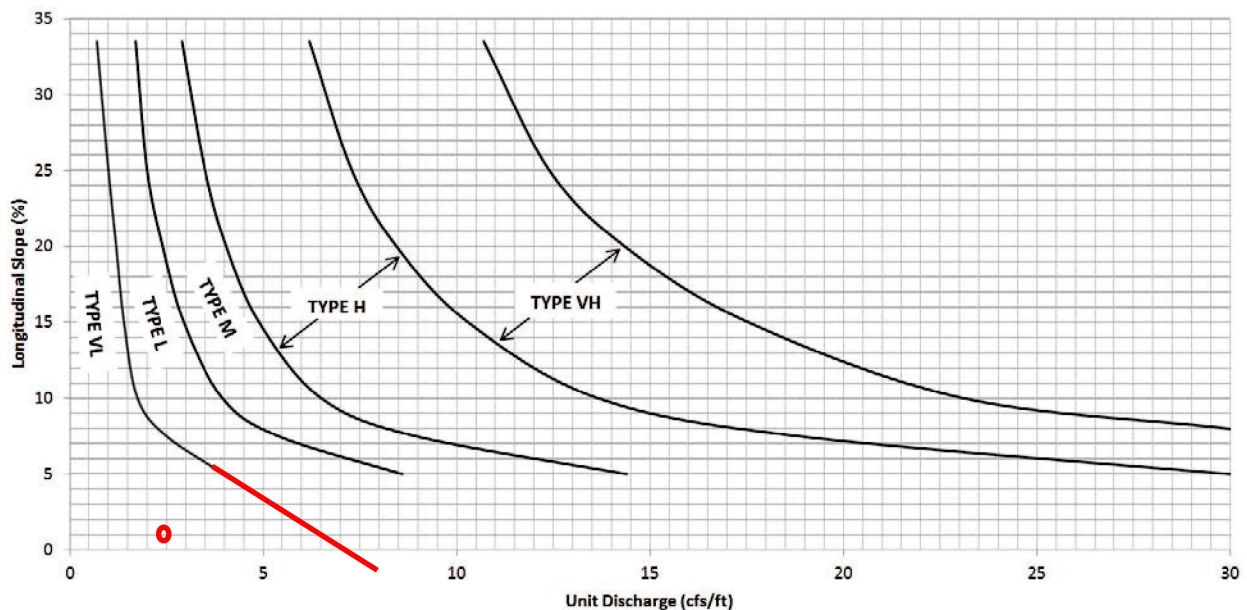


Figure 12-21. Embankment protection details and rock sizing chart (adapted from Arapahoe County)

Emergency Spillway ~ Slope = 1% and 100-Year Peak Discharge = 2.3 cfs


## APPENDIX C – FEMA FLOODPLAIN MAP

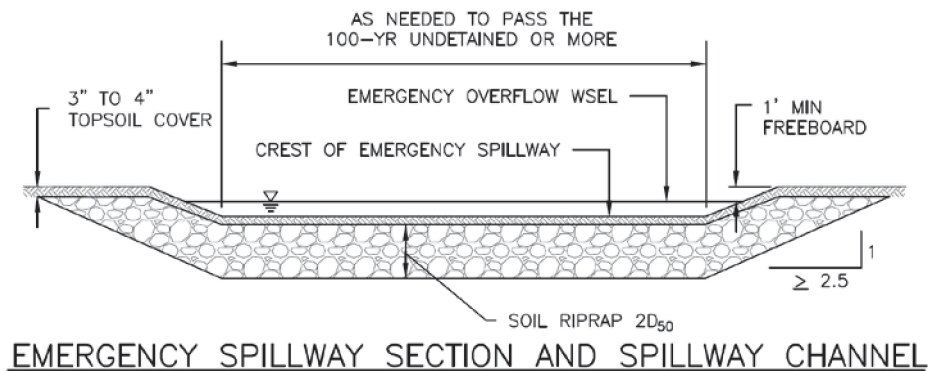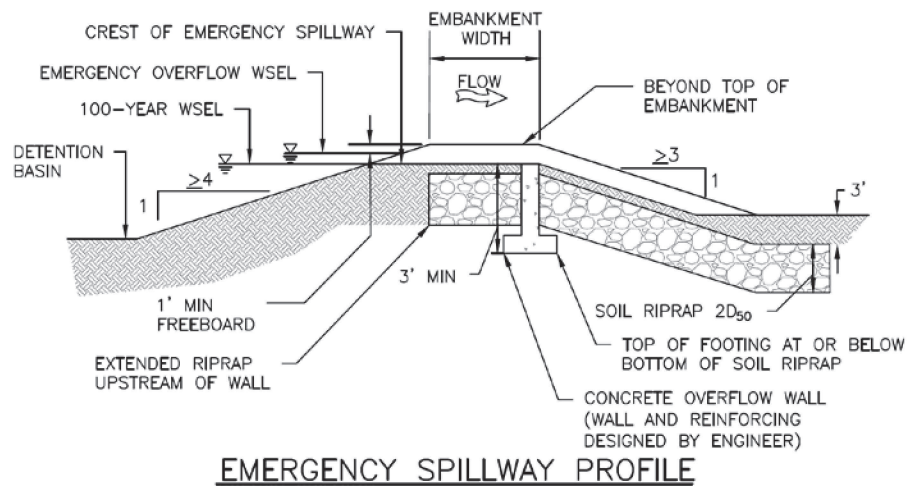

# National Flood Hazard Layer FIRMette



104°42'18"W 38°52'21"N

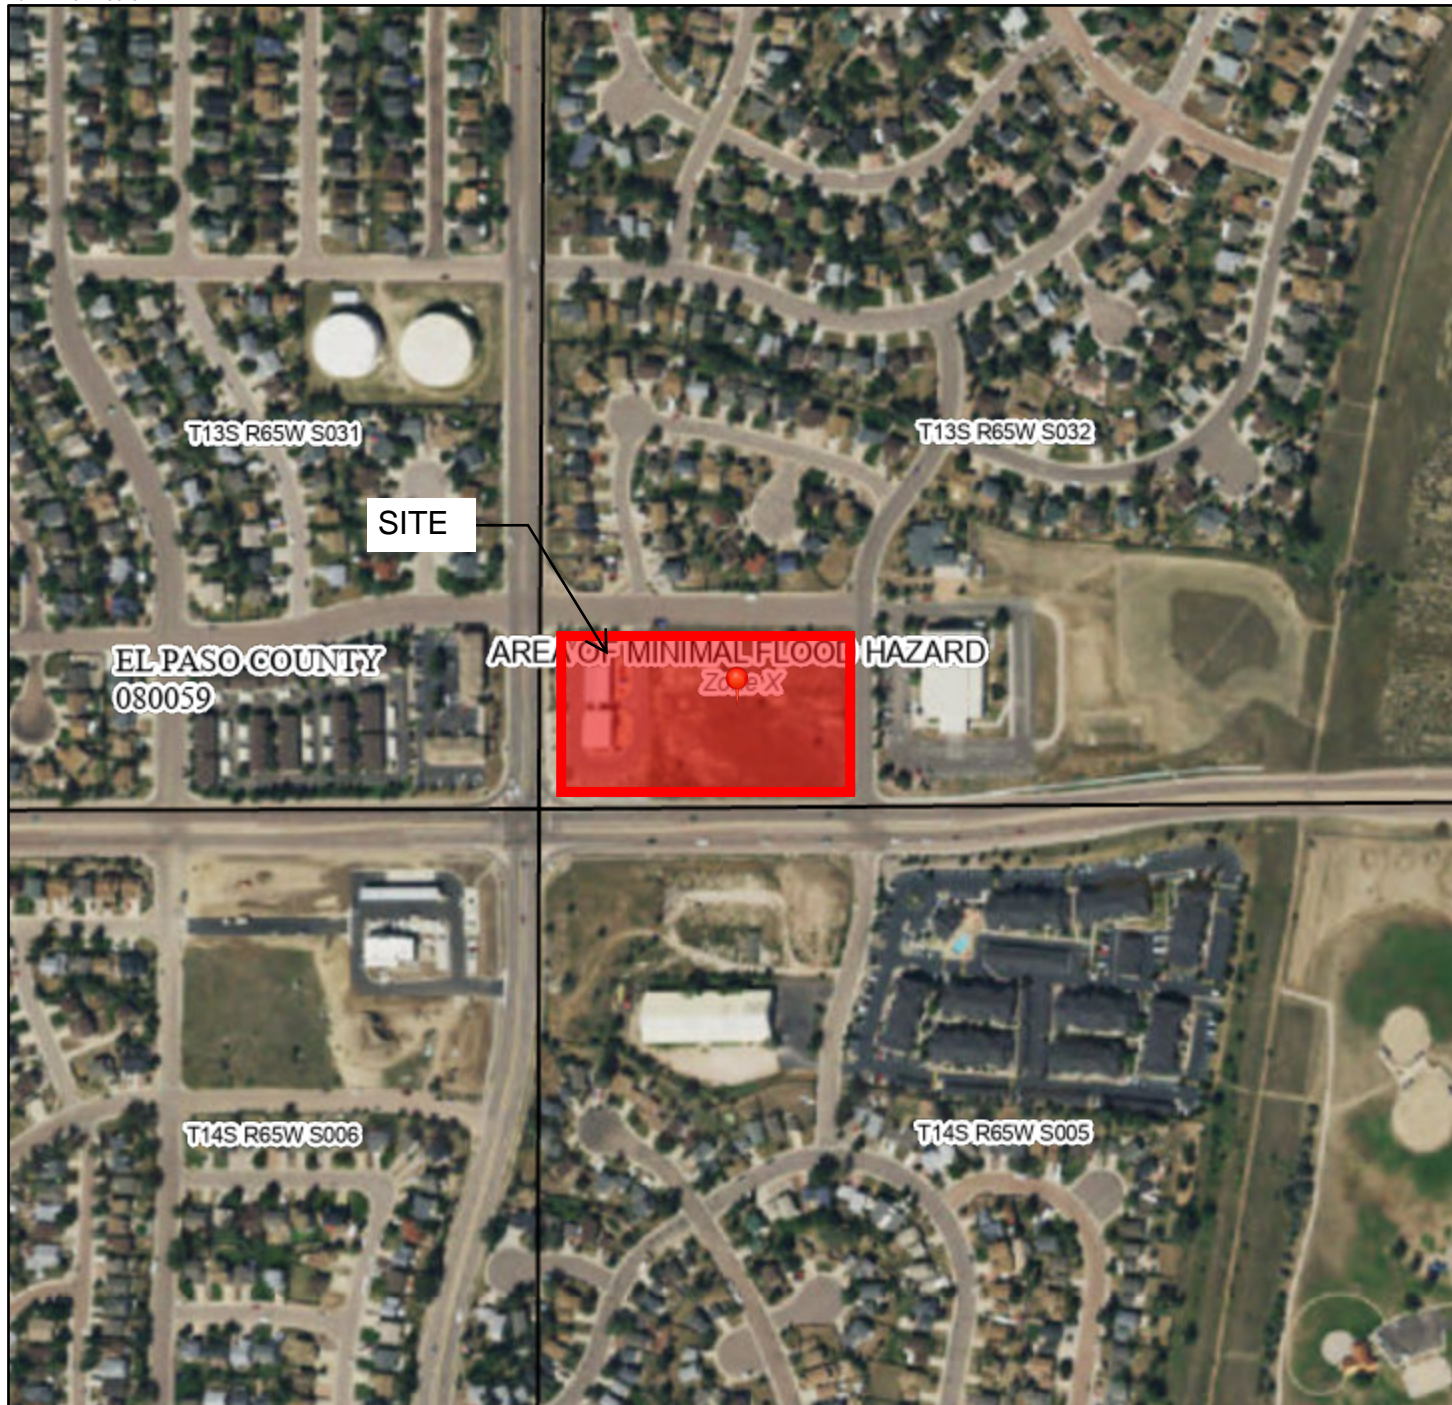

0 250 500 1,000 1,500 2,000 Feet 1:6,000

Basemap: USGS National Map: Orthoimagery: Data refreshed October, 2020

## Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

|                             |  |   |
|-----------------------------|--|---|
| SPECIAL FLOOD HAZARD AREAS  |  | Without Base Flood Elevation (BFE)<br>Zone A, V, A99  |
|                             |  | With BFE or Depth Zone AE, AO, AH, VE, AR   |
|                             |  | Regulatory Floodway   |
| OTHER AREAS OF FLOOD HAZARD |  | 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X |
|                             |  | Future Conditions 1% Annual Chance Flood Hazard Zone X  |
|                             |  | Area with Reduced Flood Risk due to Levee. See Notes. Zone X  |
|                             |  | Area with Flood Risk due to Levee Zone D  |
| OTHER AREAS                 |  | NO SCREEN Area of Minimal Flood Hazard Zone X   |
|                             |  | Effective LOMRs   |
| GENERAL STRUCTURES          |  | Area of Undetermined Flood Hazard Zone D  |
|                             |  | Channel, Culvert, or Storm Sewer  |
|                             |  | Levee, Dike, or Floodwall   |
| OTHER FEATURES              |  | 20.2 Cross Sections with 1% Annual Chance Water Surface Elevation   |
|                             |  | 17.5  |
|                             |  | Coastal Transect  |
|                             |  | Base Flood Elevation Line (BFE)   |
|                             |  | Limit of Study  |
|                             |  | Jurisdiction Boundary   |
|                             |  | Coastal Transect Baseline   |
|                             |  | Profile Baseline  |
|                             |  | Hydrographic Feature  |
| MAP PANELS                  |  | Digital Data Available  |
|                             |  | No Digital Data Available   |
|                             |  | Unmapped  |



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards


The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 3/17/2021 at 3:21 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.


## APPENDIX D – USGS SOILS SURVEY MAP



# Hydrologic Soil Group—El Paso County Area, Colorado

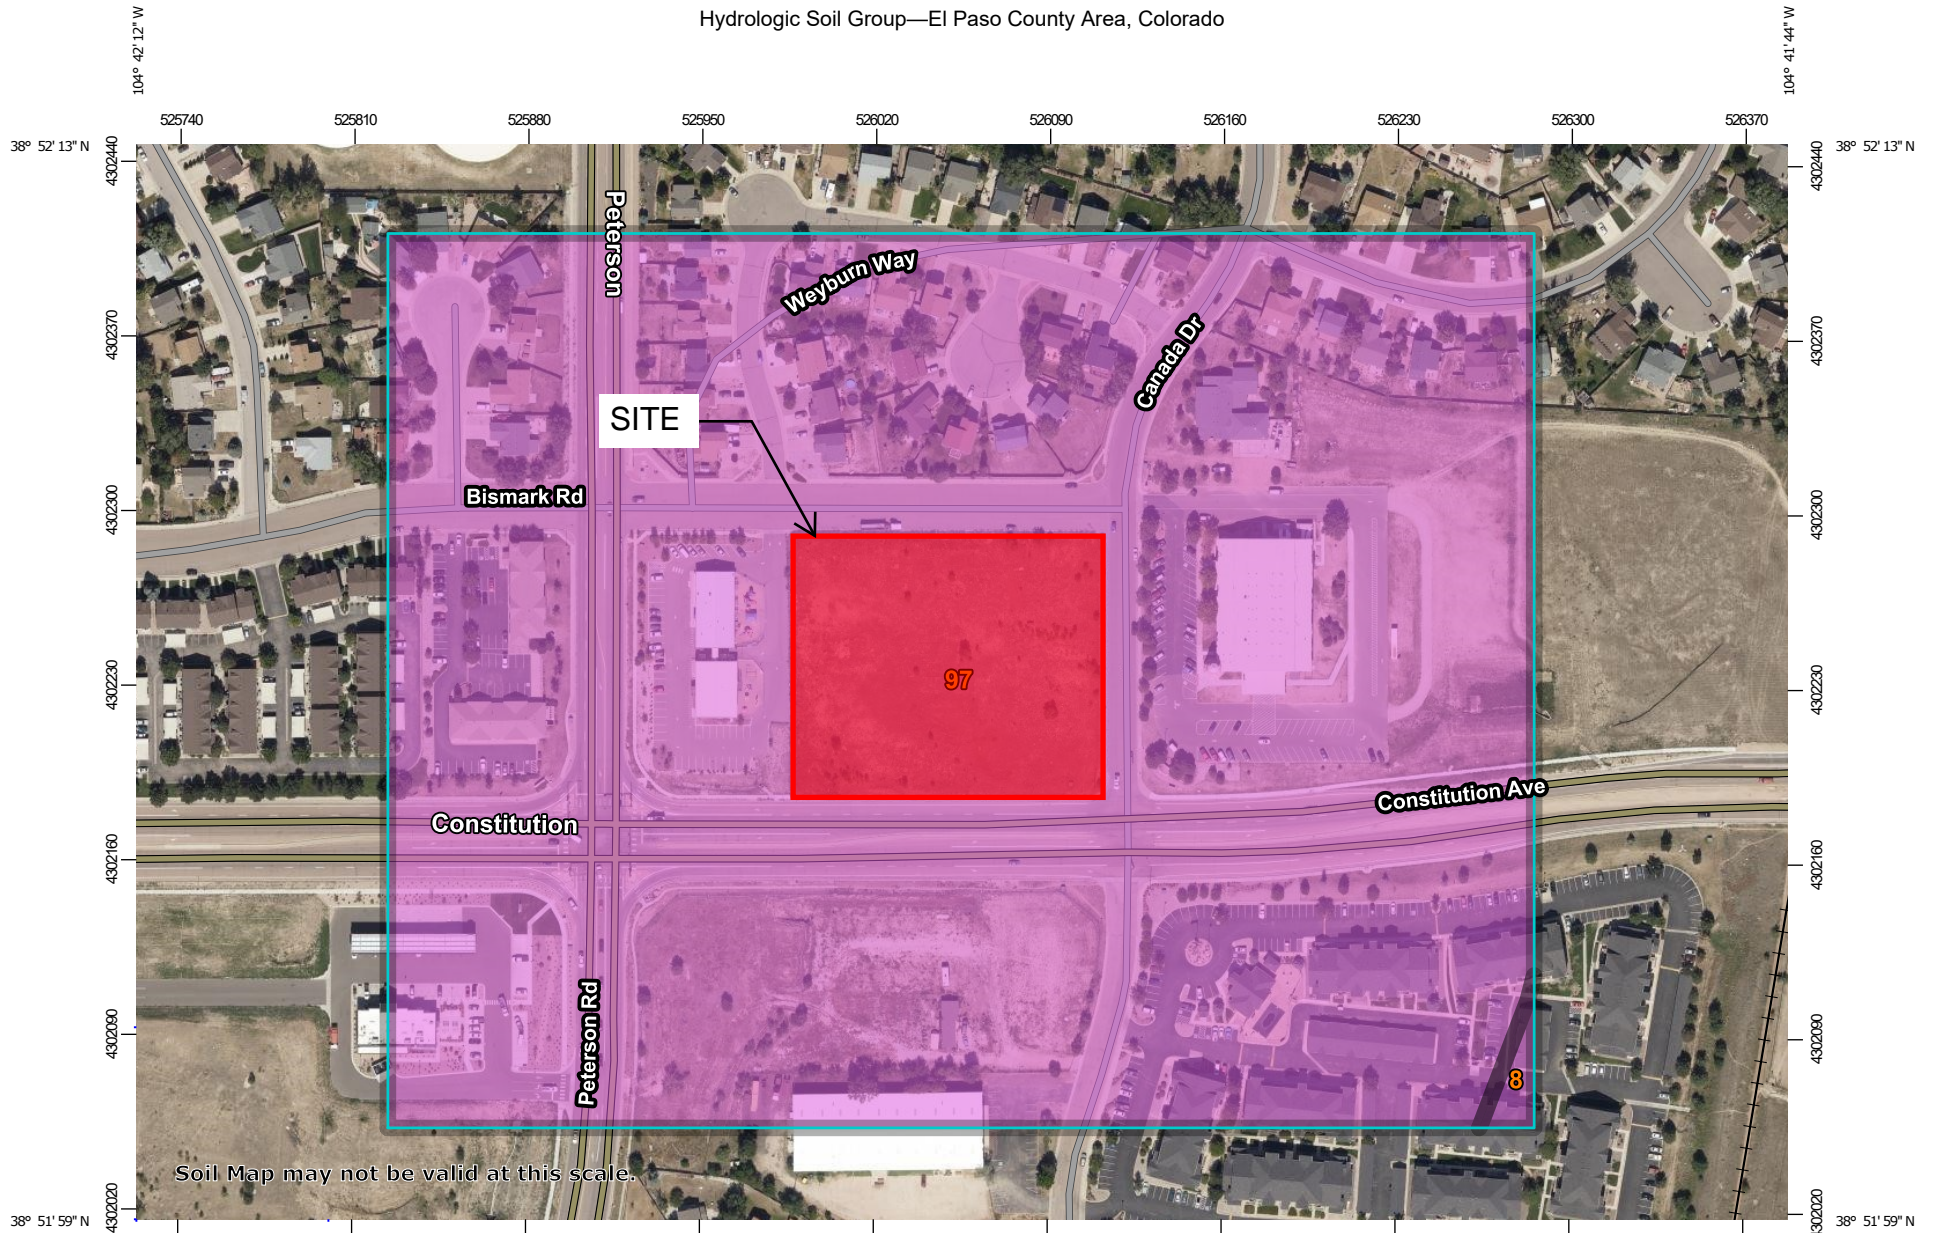

Soil Map may not be valid at this scale.

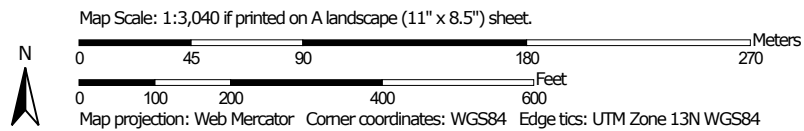

**Natural Resources  
Conservation Service**

Web Soil Survey  
National Cooperative Soil Survey

3/17/2021  
Page 1 of 4

## MAP LEGEND

### Area of Interest (AOI)

 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons

 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines

 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points

 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 19, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.



## Hydrologic Soil Group

| Map unit symbol                    | Map unit name                               | Rating | Acres in AOI | Percent of AOI |
|------------------------------------|---|--------|--------------|----------------|
| 8                                  | Blakeland loamy sand, 1 to 9 percent slopes | A      | 0.2          | 0.4%           |
| 97                                 | Truckton sandy loam, 3 to 9 percent slopes  | A      | 40.9         | 99.6%          |
| <b>Totals for Area of Interest</b> |   |        | <b>41.1</b>  | <b>100.0%</b>  |

## Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff: None Specified*

*Tie-break Rule: Higher*

## APPENDIX E – DRAINAGE PLANS

**SYMBOL**

---  
---  
---

**SYMBOL**

○ E-1  
X.XX AC

△ DP1

→

---

**GRAPHIC SCALE**

0 10 20 40

In Feet: 1" = 20'

**DESIGN POINT**

| DESIGN POINT | FLOW (CFS)  |
|--------------|---|
| 1            | Q <sub>10</sub> = 2.15<br>Q <sub>100</sub> = 6.86 |

**BASIN SUMMARY**

| BASIN | Q(10)-CFS | Q(100)-CFS | ACRES(AC) |
|-------|-----------|------------|-----------|
| E-1   | 2.15      | 6.86       | 3.24      |

**E-1**  
3.24 AC

**TOC PATH**


**DESIGN POINT**

**DP1**

**EXISTING STORM MANHOLE, (TYP.)**

**EXISTING 15' TYPE R STORM INLET**

**EXISTING 5' TYPE R STORM INLET**

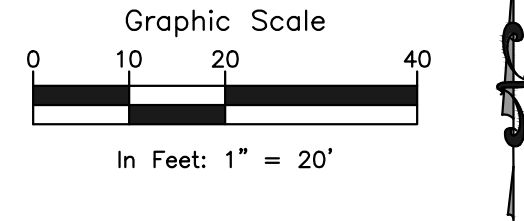

| <u>DESIGN POINT</u>  |                  | <u>FLOW (CFS)</u>                                 |                  |
|----------------------|------------------|---|------------------|
| 1                    |                  | Q <sub>10</sub> = 2.15<br>Q <sub>100</sub> = 6.86 |                  |
| <u>BASIN SUMMARY</u> |                  |   |                  |
| <u>BASIN</u>         | <u>Q(10)-CFS</u> | <u>Q(100)-CFS</u>                                 | <u>ACRES(AC)</u> |
| E-1                  | 2.15             | 6.86  | 3.24             |

**ROCKY MOUNTAIN GROUP**

ARCHITECTS  
**RMG**  
ENGINEERS

Geotechnical  
Mechanical  
Testing  
Civil Planning

ARCHITECTURAL  
STRUCTURAL  
PLANNING

SOUTHERN COLORADO  
2910 AUSTIN BLUFFS PARKWAY, COLORADO SPRINGS, CO 80918  
(719) 546-0500 • [WWW.RMGENGINEERS.COM](http://WWW.RMGENGINEERS.COM)  
SOUTHERN COLORADO, DENVER METRO, NORTHERN COLORADO

NOT FOR CONSTRUCTION  
FOR CIVIL ONLY

NORTHCREST PEMB DEVELOPMENT  
2510 & 2522 CANADA DRIVE  
COLORADO SPRINGS, COLORADO  
LEISURE CONSTRUCTION

SHEET NAME  
EXISTING CONDITIONS  
SUB-BASIN HYDROLOGY

---

PROJECT STATUS  
DESIGN DEVELOPMENT



|            |               |
|------------|---------------|
| ENG:       | DCW           |
| DRAWN:     | TPT           |
| CHECKED:   | DCW           |
| DATE       |               |
| 11/11/2022 |               |
| #          | REVISION DATE |
|            | 0000 0000     |
|            | 0000 0000     |
|            | 0000 0000     |
|            | 0000 0000     |
|            | 0000 0000     |
|            | 0000 0000     |
|            | 0000 0000     |
|            | 0000 0000     |
| JOB NO.    |               |
| 180649     |               |
| SHEET NO.  |               |
| DR-01      |               |



# LEGEND

| DESCRIPTION                 | SYMBOL |
|-----------------------------|--------|
| PROP. STRUCTURE/BUILDING    |        |
| TIME OF CONCENTRATION PATH  |        |
| EX. CONTOUR                 |        |
| PROP. CONTOUR               |        |
| DRAINAGE SUB-BASIN BOUNDARY |        |
| DESCRIPTION                 | SYMBOL |
| BASIN IDENTIFIER            |        |
| AREA IN ACRES               |        |
| DESIGN POINT ID             |        |
| FLOW ARROW                  |        |
| PROPERTY LINE               |        |

| DESIGN POINT                | FLOW (CFS)  |            |           |
|-----------------------------|---|------------|-----------|
| DP-1                        | Q <sub>10</sub> = 1.14<br>Q <sub>100</sub> = 1.80 |            |           |
| DP-2                        | Q <sub>10</sub> = 1.86<br>Q <sub>100</sub> = 2.90 |            |           |
| DP-3                        | Q <sub>10</sub> = 1.70<br>Q <sub>100</sub> = 2.63 |            |           |
| DP-4                        | Q <sub>10</sub> = 3.29<br>Q <sub>100</sub> = 5.12 |            |           |
| DP-5                        | Q <sub>10</sub> = 2.69<br>Q <sub>100</sub> = 4.07 |            |           |
| DP-6                        | Q <sub>10</sub> = 1.58<br>Q <sub>100</sub> = 2.42 |            |           |
| DP-7                        | Q <sub>10</sub> = 0.33<br>Q <sub>100</sub> = 0.66 |            |           |
| DP-8                        | Q <sub>10</sub> = 0.17<br>Q <sub>100</sub> = 0.58 |            |           |
| DP-9                        | Q <sub>10</sub> = 1.20<br>Q <sub>100</sub> = 2.54 |            |           |
| <b><u>BASIN SUMMARY</u></b> |   |            |           |
| BASIN                       | Q(10)-CFS   | Q(100)-CFS | ACRES(AC) |
| D-1                         | 1.14  | 1.80       | 0.29      |
| D-2                         | 1.86  | 2.90       | 0.45      |
| D-3                         | 1.70  | 2.63       | 0.37      |
| D-4                         | 3.29  | 5.12       | 0.73      |
| D-5                         | 2.69  | 4.07       | 0.50      |
| D-6                         | 1.58  | 2.42       | 0.31      |
| D-7                         | 0.33  | 0.66       | 0.14      |
| D-8                         | 0.17  | 0.58       | 0.21      |
| D-9                         | 1.20  | 2.54       | 0.63      |

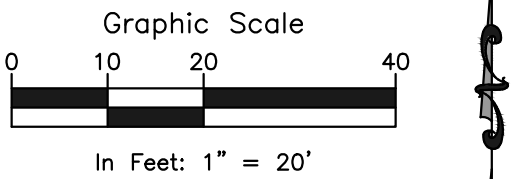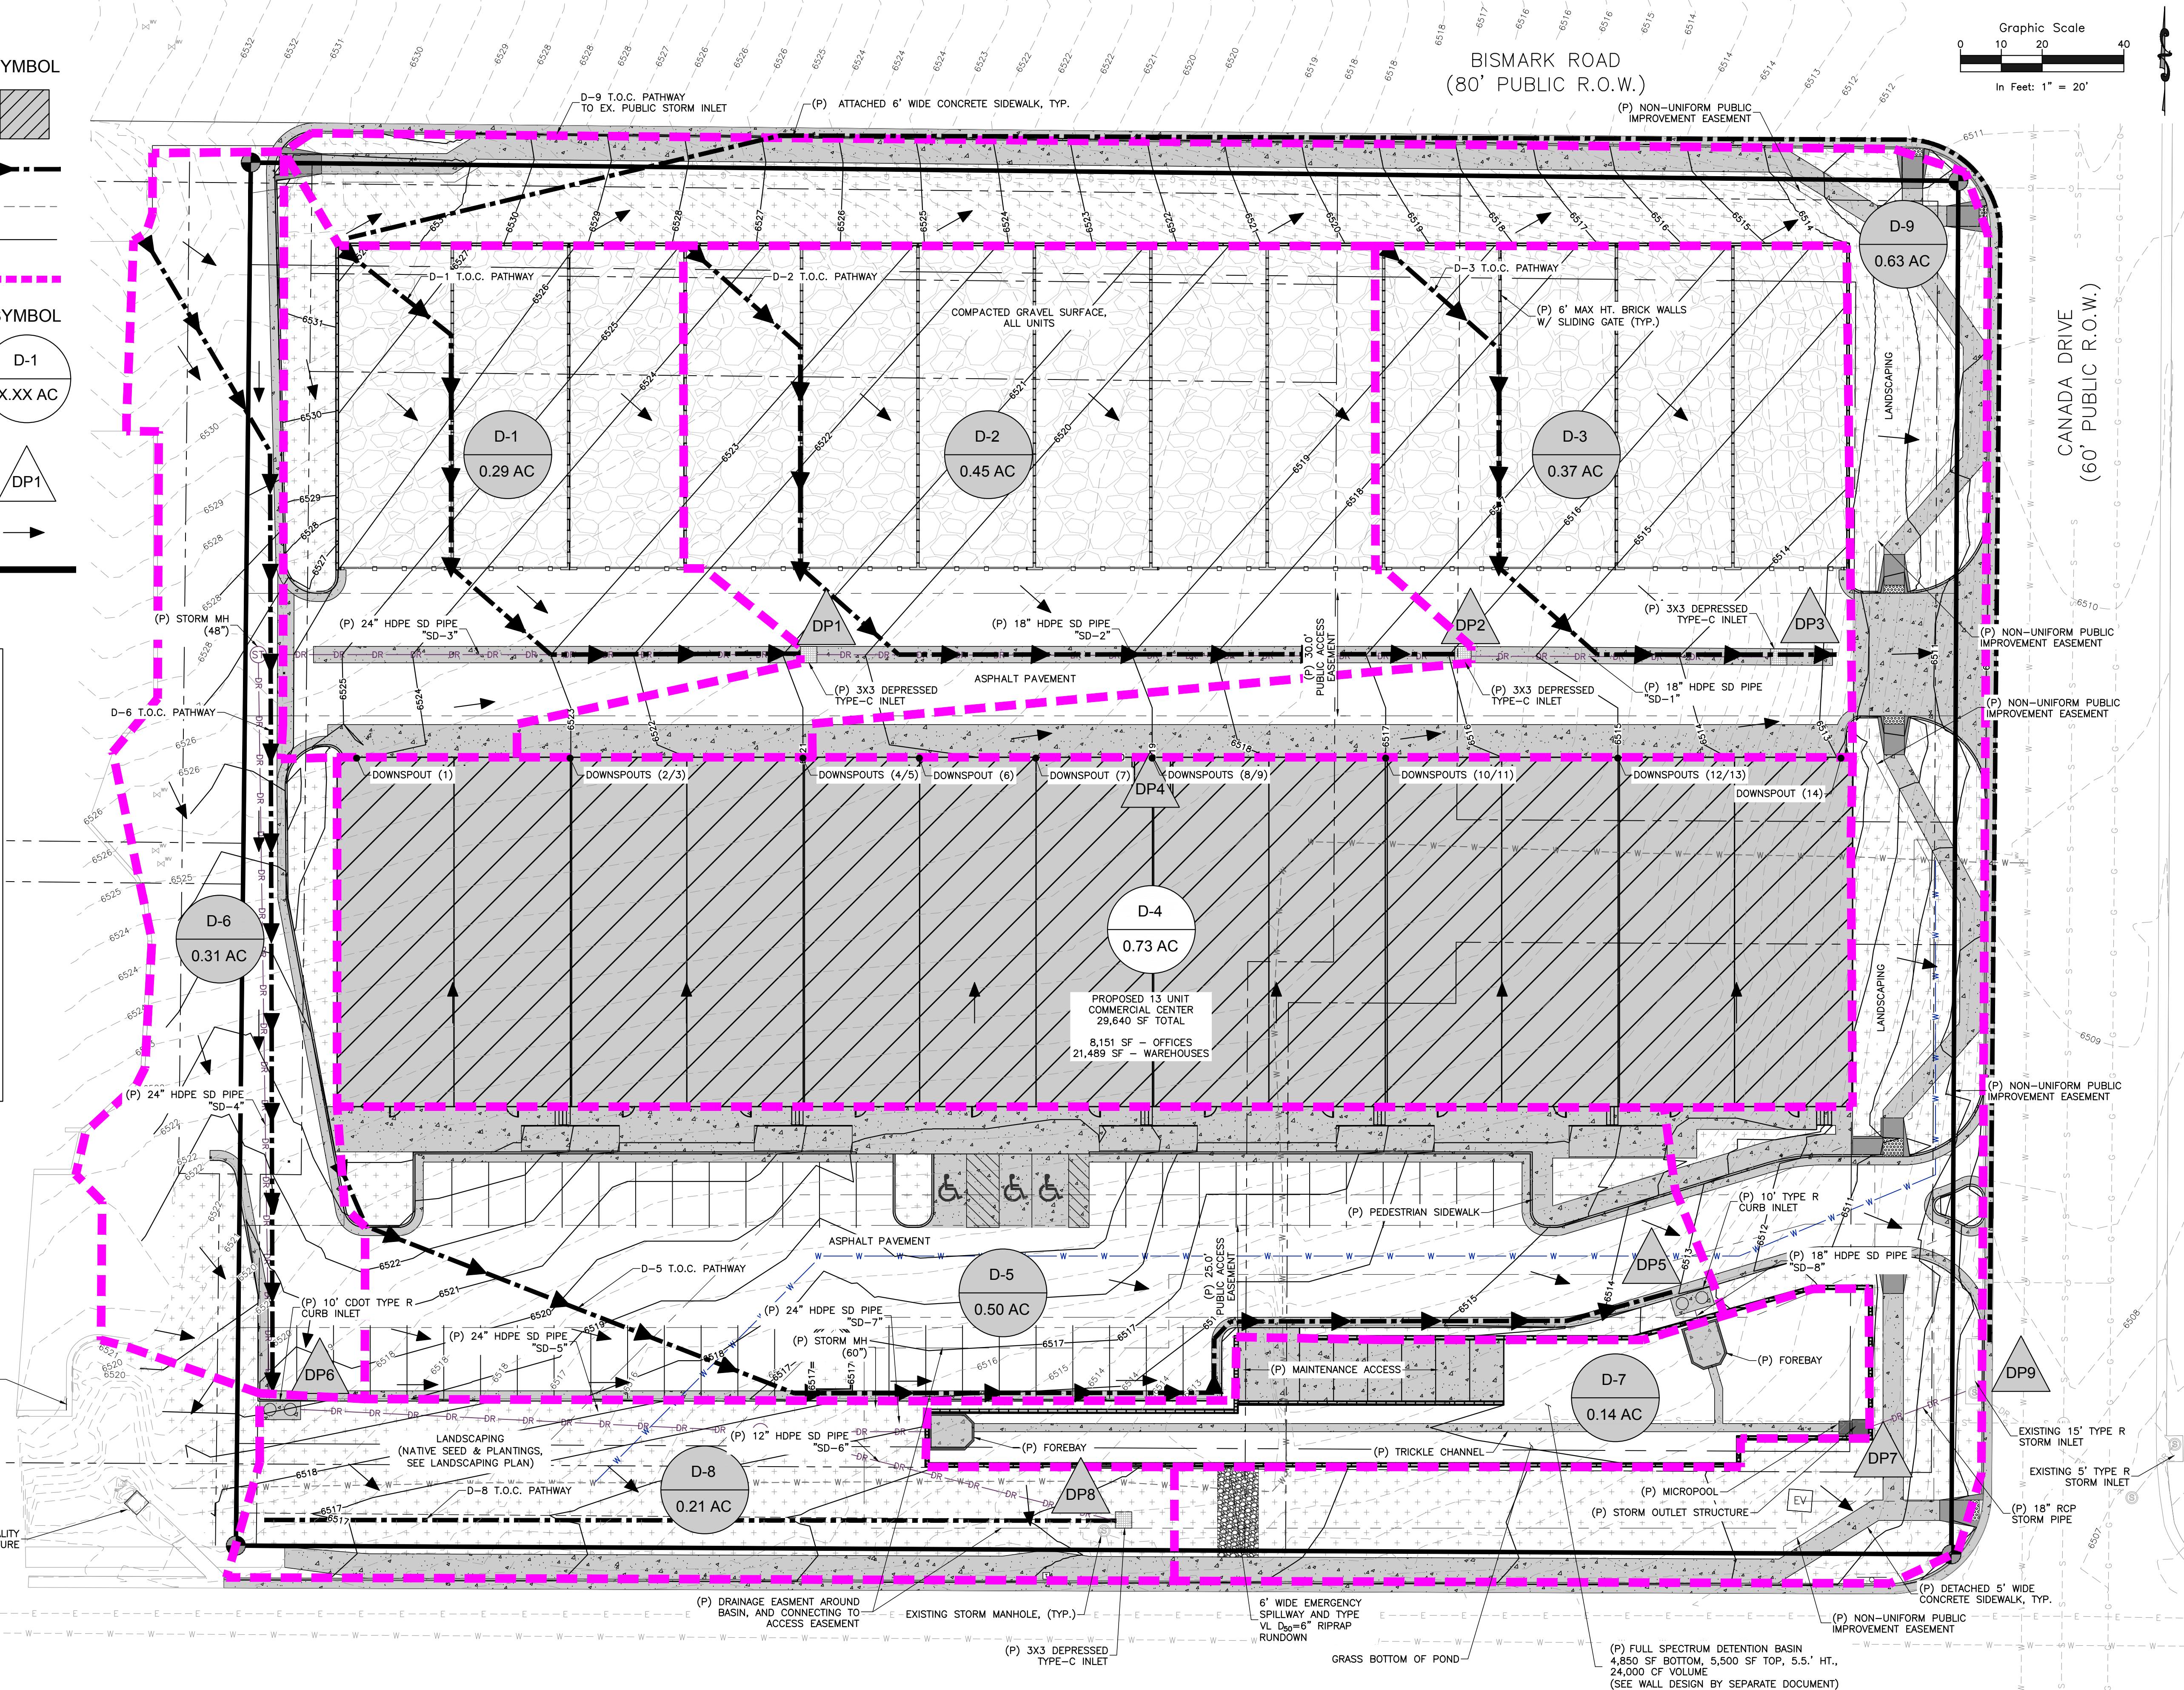

**ROCKY MOUNTAIN GROUP**

Geotechnical  
Materials Testing  
Civil Planning

**RMG**  
ENGINEERS

2910 ALBERTA BLVD. SUITE 100  
DENVER, CO 80202  
TEL: 303.733.8800  
WWW.RMG-ENGINEERS.COM

**NOT FOR CONSTRUCTION  
FOR CIVIL ONLY**

**NORTHCREST PEMB DEVELOPMENT**

2510 & 2522 CANADA DRIVE  
COLORADO SPRINGS, COLORADO

**LEISURE CONSTRUCTION**

**DEVELOPED CONDITIONS  
SUB-BASINS HYDROLOGY**

**DESIGN DEVELOPMENT**

ENG: DWG  
DRAWN: TPT  
CHECKED: DWG  
DATE: 11/11/2022

| # | REVISION | DATE |
|---|----------|------|
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |
|   |          |      |

JOB NO: 180649  
SHEET NO: DR-02

LAST SAVED: 11/11/2022 1:18:39 PM. PATH: \\local.mountaingroup.com\DR\Projects\2020\4-Leisure Construction\180649\Drawings\From RMG\Sheet Sub-Basin Analysis\180649-Conditionals\180649-Sub-Basin Analysis.dwg