

LOTS 3, 4, AND 5 NORTHCREST CENTER FILING NO 2
PHASE 1 SUBDIVISION
REFERRED TO AS: “NORTHCREST CENTER”
FINAL DRAINAGE REPORT

TBD BISMARK ROAD
COLORADO SPRINGS, COLORADO
80922

PREPARED FOR: LEISURE CONSTRUCTION
3443 TAMPA ROAD, SUITE B
PALM HARBOR, FL 34684
(727) 242-5121

May 14, 2021

Prepared by
Richard Lyon, P.E.
Rocky Mountain Group
2910 Austin Bluffs Blvd. | Colorado Springs, CO 80918 | 719-434-5638



SIGNATURE PAGE

**LOTS 3, 4, AND 5 NORTHCREST CENTER FILING NO 2 PHASE 1
SUBDIVISION**

ENGINEER'S STATEMENT

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by negligent acts, errors or omissions on my part in preparing this report.

SIGNATURE (Affix Seal): _____
Colorado P.E. No.: 53921 Date: _____

DEVELOPER'S STATEMENT

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

Name of Developer

Authorized Signature

Date

Printed Name

Title

Address

EL PASO COUNTY:

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

Jennifer Irvine, P.E.

County Engineer / ECM Administrator

Date

Conditions:

TABLE OF CONTENTS

I.	PURPOSE.....	5
II.	GENERAL LOCATION AND DESCRIPTION	5
A.	LOCATION	5
B.	DESCRIPTION OF PROPERTY – EXISTING CONDITIONS	6
C.	EXISTING SOILS.....	6
D.	EXISTING DRAINAGE.....	7
E.	DESCRIPTION OF PROPERTY – PROPOSED CONDITIONS	7
III.	DRAINAGE BASINS AND SUB-BASINS.....	7
A.	EXISTING MAJOR DRAINAGE BASIN AND SUB-BASINS	7
B.	DEVELOPED MAJOR DRAINAGE BASIN AND SUB-BASINS	8
IV.	DRAINAGE DESIGN CRITERIA	11
A.	REGULATIONS	11
B.	DEVELOPMENT CRITERIA REFERENCE AND CONSTRAINTS.....	11
C.	HYDROLOGICAL CRITERIA	12
D.	FOUR-STEP PROCESS.....	12
V.	DRAINAGE INFRASTRUCTURE COSTS AND FEES.....	13
A.	DRAINAGE AND BRIDGE FEES	13
B.	STORM DRAIN SYSTEM QUANTITIES AND COSTS ESTIMATE	14
VI.	CONCLUSIONS.....	14
A.	COMPLIANCE WITH STANDARDS	14
VII.	REFERENCES	15
VIII.	Appendices	16

APPENDICES

A – Vicinity Map

B – Hydrologic and Hydraulic Computations

C – FEMA Floodplain Map

D – USGS Soils Survey Map

I. PURPOSE

This report is a Final Drainage Report for Lots 3, 4 & 5 Northcrest Center Subdivision, a currently unaddressed set of lots, for the development for a multi-unit commercial development, Northcrest Center.

The purpose of this report is to identify on-site and off-site drainage patterns, assess stormwater conditions per delineated basin and sub-basins, demonstrate adequate design standards for storm water flow and release into the existing storm water system or right-of-way, and provide a narrative for any other drainage considerations related to the development of this parcel.

II. GENERAL LOCATION AND DESCRIPTION

A. LOCATION

The proposed development of thirteen 2,280 square foot commercial buildings, is located at the address of Northcrest Center (formerly Lots 3, 4, & 5) in the City of Colorado Springs, Colorado in El Paso County within the Northcrest Center Subdivision. The parcel schedule numbers are 5332309004, 5332309006, and 5332309005 and the legal descriptions are Lot 3 Northcrest Center, A Vacation & Replat Of Tract B Northcrest Fil No 2 Phase 1, Lot 5 Northcrest Center, A Vacation & Replat Of Tract B Northcrest Fil No 2 Phase 1, and Lot 4 Northcrest Center, A Vacation & Replat Of Tract B Northcrest Fil No 2 Phase 1. The parcel is located to the north of Constitution Avenue, west of Canada Drive, east of Peterson Road, and south of Bismark Road.

The surrounding parcels are as follows:

North of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from west to east:

2508 Weyburn Way, Schedule No. 5332308031, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 15 Constitution Hills Fil No 8

2507 Weyburn Way, Schedule No. 5332308032, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 14 Constitution Hills Fil No 8

2630 Tibburn Way, Schedule No. 5332308040, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 6 Constitution Hills Fil No 8

2610 Tibburn Way, Schedule No. 5332308041, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 5 Constitution Hills Fil No 8

2605 Tibburn Way, Schedule No. 5332308042, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 4 Constitution Hills Fil No 8

2624 Tibburn Way, Schedule No. 5332308043, Zoning RS-6000 CAD-O, Plat No. 10281, Lot 3 Constitution Hills Fil No 8

East of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from north to south:

2535 Canada Drive, Schedule No. 5332310002, Zoning RS-6000 CAD-O, Plat No. 8956, Lot 1 Living Waters Sub

2525 Canada Drive, Schedule No. 5332310003, Zoning PUD CAD-O, Plat No. 8956, Lot 2 Living Waters Sub

2455 Canada Drive, Schedule No. 5405207050, Zoning RM-30 CAD-O, Plat No. 7588, Lot 2 Northcrest Fil No 4

South of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from west to east:

6855 Constitution Avenue, Schedule No. 5405218002, Zoning CC CAD-O, Plat No. 9808, Lot 1 Eight Line Sub

West of Lots 3, 4 & 5 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1 (Northcrest Center (formerly Lots 3, 4, & 5)) from north to south:

6805 Bismark Road, Schedule No. 5332309007, Zoning CC CAD-O, Plat No. 7776, Lots 1 & 2 Northcrest Center, A Vacation & Replat of Tract B Northcrest Fil No 2 Phase 1

B. DESCRIPTION OF PROPERTY – EXISTING CONDITIONS

Lots 3, 4, and 5 (Northcrest Center (formerly Lots 3, 4, & 5)) is approximately 144,776 square feet combined (3.32 acres) and is located on the north side of Constitution Avenue, east side of Peterson Road, West of Canada Drive, and south of Bismark Road. The parcels fall within the NW 1/4 of Section 5, Township 14 South, Range 65 West of the 6th P.M. of Colorado Springs, El Paso County, Colorado.

The property currently consists of minor landscaping. There is existing curb and gutter along Bismark Drive, Canada Drive, and Constitution Avenue. The parcels are unpaved.

The existing percent imperviousness is approximately 1.5 percent on Lots 3, 4, and 5.

The existing topography consists of grades between 5.3 and 19.17 percent. Drainage patterns sheet flow across the parcel southeasterly to the corner of Canada Drive and Constitution Avenue.

C. EXISTING SOILS

The soils indicative to the site are classified as Truckton sandy loam by the USDA Soil Conservation Service and are listed as NRCS (National Resources Conservation Service) Hydrologic Soil Group A. A USDA Soil Map is provided in the Appendix.

A subsurface soils investigation was conducted for Commercial Development Site Constitution and Peterson and a letter was developed entitled *Geotechnical Report* by RMG – Rocky

Mountain Group dated February 23, 2021. The investigation “revealed similar substance subsurface soil conditions across the site, being primarily silty sand extending from the ground surface to the extent of the test borings. Neither expansive clay soil nor bedrock were encountered in the borings.”

The study found that “groundwater was not encountered in the test borings during field exploration.”

D. EXISTING DRAINAGE

The existing topography consists of grades between 5.3 and 19.17 percent within the entire parcel that ultimately flows southeast. The existing imperviousness of the lot is approximately 1.5 percent. The existing vegetation consists of native grasses and has been identified via site visits and aerial photography as well as survey data and pictures.

The existing drainage pattern from storm runoff is generally characterized as overland flow to the southeast of the parcel across pervious landscaped yard. The runoff from this parcel and the surrounding neighborhood flows via curb and gutter in the public right of way of Bismark Road, Constitution Avenue, and Canada Drive. The runoff flows south on Canada Drive into the existing Public 15' CDOT Type R Curb Inlet located at the northwest corner of the intersection of Canada Drive and Constitution Avenue. This Public Storm Inlet is a branch of the Public 24" RCP Storm Main that flows west to east along the north side of Constitution Avenue and ultimately outfalls into Jimmy Camp Creek.

Lots 3, 4, and 5 do not lie within a designated floodplain according to information published in the Federal Emergency Management Agency Floodplain Map No. 08041C0733G, dated December 7, 2018. The FEMA Floodplain map is provided in Appendix B showing it lies within Zone X, a minimal flood hazard area.

There are no known non-stormwater discharges that contribute to the storm water systems on site and downstream, both private and public.

E. DESCRIPTION OF PROPERTY – PROPOSED CONDITIONS

The proposed development consists of thirteen 2,280 square foot commercial units and 58,695 square feet of concrete and asphalt pavement for drive accesses, sidewalks, and curb and gutter. Other on-site features include landscaping, 1,789 linear feet of retaining wall, and 2,427 square feet for a full spectrum detention pond.

There is not access point to the property. Two new curb cuts are proposed along Canada Drive.

III. DRAINAGE BASINS AND SUB-BASINS

A. EXISTING MAJOR DRAINAGE BASIN AND SUB-BASINS

The parcel is delineated into sub-basins according to the existing and proposed grading for existing and developed conditions.

Basin E is the entirety of the parcel representing existing conditions and consists of one on-site sub-basins. There are no off-site flows that enter the property due to the slope of the existing drive aisle between this lot and the neighboring lot.

Sub-basin E-1 (3.24 ac.; $Q_5 = 0.81$ cfs, $Q_{100} = 5.27$ cfs) is the entirety of Lots 3, 4, and 5 to be replatted via vacation into a single lot which contains natural vegetation that flows to the right of ways of Bismark Road, Canada Drive, and Constitution Ave. Those right of ways have curb and gutter directly adjacent to the lot that flows to a Public 10' CDOT Type R Curb Inlet. This public storm system is connected to a Public 24" RCP Storm Main that runs west to east along the south side of the lot and continues east along Constitution Avenue. The Public 10' CDOT Type R Curb Inlets located at the northwest and northeast corners of the intersection of Canada Drive and Constitutions Avenue are branches that are connected to the Public Storm Main within the north side of Constitution Avenue. The Public Storm system ultimately flows to the East Fork Sand Creek.

EP1 is the existing conditions design point representing the Public 15' CDOT Type R Curb Inlet at the northwest corner at the intersection of Canada Drive and Constitution Avenue where sub-basin E-1 flows over the pervious lot containing native grasses and vegetation to the public roadways. The emergency flow route of this public storm inlet is due east along the north side of Constitution Avenue.

B. DEVELOPED MAJOR DRAINAGE BASIN AND SUB-BASINS

Basin D is the entirety of the developed parcel representing developed conditions and consists of eight sub-basins. There are no off-site flows that enter the property due to grading of the drive accesses to divert storm water away from the property near the property boundary.

Sub-basin D-1 (0.32 ac. ; $Q_5 = 0.70$ cfs, $Q_{100} = 1.58$ cfs) is the northwestern area of the development consisting of a wide asphalt drive access off of the common drive access for this property and the neighboring lot from Bismark Road as well as enclosed storage and large vehicle parking area that consists of compacted gravel. The sub-basin is sloped due southeast and overland flow is directed to the concrete drain pan within the drive aisle and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate.

DP1 is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-1. The Private Storm Inlet flows downstream to subsequent Design Points via the Private Storm Sewer system. The emergency flow route for DP1 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the northern drive aisle and would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

Sub-basin D-2 (0.41 ac. ; $Q_5 = 0.88$ cfs, $Q_{100} = 2.00$ cfs) is the middle-north area of the development consisting of a wide asphalt drive access off of the common drive access for this property as well as enclosed storage and large vehicle parking area that consists of compacted gravel. The sub-basin is sloped due southeast and overland flow is directed to the concrete drain pan within the drive aisle and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate, the second in a series of storm inlets in the northern area.

DP2 is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-2. The Private Storm Inlet flows downstream to subsequent Design Points via the Private Storm Sewer system. The emergency flow route for DP2 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the northern drive aisle and would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

Sub-basin D-3 (0.52 ac. ; $Q_5 = 0.93$ cfs, $Q_{100} = 2.29$ cfs) is the northeast area of the development consisting of a wide asphalt drive access off of the common drive access for this property as well as enclosed storage and large vehicle parking area that consists of compacted gravel. The sub-basin is sloped due southeast and overland flow is directed to the concrete drain pan within the drive aisle and channeled to a Private 3'x3' CDOT Type C Depressed Inlet with Grate, the third and last in a series of storm inlets in the northern area that conveys storm water via the Private Storm system due south toward the Full Spectrum Extended Detention Basin.

DP3 is the Design Point representing the Private 3'x3' CDOT Type C Depressed Inlet with Grate for Sub-basin D-3. The Private Storm Inlet flows downstream to subsequent Design Points via the Private Storm Sewer system. The emergency flow route for DP3 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the northern drive aisle and would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

Sub-basin D-4 (0.46 ac. ; $Q_5 = 1.64$ cfs, $Q_{100} = 3.01$ cfs) is the southeast area of the development consisting roof runoff from Unit 9 through 13 as well as the south frontage parking lot and pedestrian access area. The sub-basin is generally sloped due southeast within the parking lot area and other storm water conveyances are via roof drains and curb and gutter. The sub-basin flows to a low point in the south curb and gutter where a proposed Private 10' CDOT Type R Curb Inlet collects storm water and conveys it to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system.

DP4 is the Design Point representing the Private 10' CDOT Type R Curb Inlet for Sub-basin D-4. The Private Storm Inlet flows downstream to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The emergency flow route for DP4 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the southern drive aisle indicated as a right turn exit only aisle and would flow due east into Canada Drive and ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

Sub-basin D-5 (0.79 ac. ; $Q_5 = 2.86$ cfs, $Q_{100} = 5.22$ cfs) is the southwest and middle-south area of the development consisting roof runoff from Units 1 through 9 as well as the south frontage parking lot and pedestrian access area. The sub-basin is generally sloped due southeast within the parking lot area and other storm water conveyances are via roof drains and curb and gutter. The sub-basin flows to a low point in the south curb and gutter just west of the proposed EDB where a proposed Private 20' CDOT Type R Curb Inlet collects storm water and conveys it to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system.

DP5 is the Design Point representing the Private 20' CDOT Type R Curb Inlet for Sub-basin D-5. The Private Storm Inlet flows downstream to the Full Spectrum Extended Detention Basin via the Private Storm Sewer system. The emergency flow route for DP4 is an overflow condition of the Private Storm Inlet that would cause storm water pooling within the southern parking lot area and would pool for 6" before spilling into the landscaping area surrounding the EDB and ultimately entering the EDB.

Sub-basin D-6 (0.07 ac. ; $Q_5 = 0.08$ cfs, $Q_{100} = 0.26$ cfs) accounts for the tributary area of the development that consists of the Full Spectrum Extended Detention Basin. Runoff in this area is directly collected by the basin.

DP6 is the Design Point representing the Full Spectrum Extended Detention Basin that is designed to detain a major storm event for the developed lot and provide Water Quality. The EDB is proposed to as 32.4' by 75.2' basin with 7 foot redirock structural walls and has a total detention volume of 15,917 cubic feet. Of the total height, one foot is for freeboard and 6 feet is for detention and water quality. The EDB consists of concrete trickle channel, micropool, and outlet structure with an engineered orifice plate to comply with release rates for Water Quality Capture Volume, Excess Urban Runoff Volume, and the 100-Year Major Storm Event. The emergency spillway of the Design Point results in storm water spilling over the walls and flowing due south to Constitution Avenue, ultimately flowing into the existing Public 15' CDOT Type R Curb Inlet (DP7) at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

Sub-basin D-7 (0.54 ac. ; $Q_5 = 0.55$ cfs, $Q_{100} = 1.87$ cfs) is the tributary area within the property boundary that flows toward the adjacent right of ways of Bismark Road, Canada Drive, and Constitution Avenue. The sub-basin consists mostly of proposed landscaped areas, public concrete sidewalk, and ingress/egress curb cuts. The sub-basin flows to Design Point 7 via the adjacent roadways' curb and gutter, ultimately to the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

DP7 is the Design Point representing the Public 15' CDOT Type R Curb Inlet at the northwest corner of the intersection of Canada Drive and Constitution Avenue. This Public Storm Inlet is a branch line of the Public Storm Main that runs west to east along the north side of Constitution Avenue and is the ultimate recipient of storm water flow from the developed lot as it is proposed to be connected to the outlet structure of the EDB (DP6). The emergency flow route of this public storm inlet is due east along the north side of Constitution Avenue.

Sub-basin D-8 (0.10 ac. ; $Q_5 = 0.40$ cfs, $Q_{100} = 0.74$ cfs) is the tributary area within the property boundary that consists of the common drive access off of Bismark Road to be extended to the south parking lot frontage of the development as well as a small landscaped portion at the south side of the lot. This sub-basin previously flowed southeast to the public storm system and is proposed to flow to the existing water quality control measure constructed for the neighboring lot. If existing drainage patterns were adhered to at the west property boundary, the new development would take on excess storm water runoff from the neighboring parcel. Grading of the extended drive aisle due south is to create a slight slope due west as originally intended to keep storm water of the respective lots directed toward their respective control measures.

DP8 is the Design Point representing the Water Quality Capture Volume BMP/control measure constructed for the neighboring lot (Northcrest Center Fil No 2 Lots 1 & 2). The emergency overflow of DP8 is via a sidewalk chase directly to the curb and gutter of Constitution Avenue and ultimately to the existing Public 15' CDOT Type R Curb Inlet (DP7) at the northwest corner of the intersection of Canada Drive and Constitution Avenue.

The difference between Basin E and Basin D results in an overall increase of the 100-year storm water volume overall due to increased impervious pavement and roof area yielding a larger percent imperviousness.

The total storm water flow generated from the entirety of the 3.24 acre lot for the major (100-year) storm event for existing conditions with an effective imperviousness of 1.5 percent is 5.27 cfs. The major storm event runoff for developed conditions with an effective imperviousness of 62.5 percent yields 16.96 cfs.

Of the total 3.24-acre lot, a tributary area of 2.59 acres with an effective imperviousness of 70.8 percent drains to the Full Spectrum Detention Basin, totaling 14.36 cfs, 87 percent of the total site runoff.

The remaining 0.65 acres has an effective 29.8 percent imperviousness and flows over mostly landscaped area and public concrete sidewalk to the respective roadways, ultimately to the public storm system. The developed conditions yield a major storm runoff of 2.61 cfs that flows directly to the public storm system. This is directly comparable to the existing drainage conditions that yielded 5.27 cfs of storm water runoff for a major storm event. This is a nearly 50 percent decrease.

A Full Spectrum Extended Detention Basin is proposed for the site to provide water quality and detention prior to storm water release to the public storm system.

It is anticipated that there will be no negative impact to downstream developments or infrastructure as a result of this development.

IV. DRAINAGE DESIGN CRITERIA

A. REGULATIONS

The hydrological and hydraulic calculations and design of the site conform to the City of Colorado Springs Drainage Criteria Manuals I and II (latest revision, May 2014) as well as the Mile High Flood District Drainage Criteria manuals revised August 2018.

B. DEVELOPMENT CRITERIA REFERENCE AND CONSTRAINTS

The parcel falls within the East Fork Sand major drainage basin designated by the City of Colorado Springs Water Resources Engineering Department with the ultimate receiving waters of Arkansas River. The drainage on this parcel will have no effect on downstream infrastructure or facilities, streets, utilities, transit, or further development of adjacent lots. Relevant criteria for the calculations shown further include equations and design criteria for the rational method, volumes and runoff of various storm events.

C. HYDROLOGICAL CRITERIA

The rational method was used to calculate the peak runoff of the delineated basin and sub-basins using the manuals referenced prior with the C, I, and P1 values from the Design Criteria Manual Volume I, Chapter 6 as well as the Colorado Springs designated IDF curve values. Specific calculations and tables are provided further with inputs including design rainfall, sub-basin acreage and percent imperviousness, runoff coefficients, one-hour rainfall depths, rainfall intensities, time of concentration, and peak discharge of various storm events. The default rainfall intensities and volumes use runoff coefficients based on soil types. Weighted runoff coefficients were calculated for each basin and sub-basin due to the mix of impervious surfaces, shown in the Appendix exhibits. Due to site disturbance being less than one acre and not part of a larger common plan, water quality is not required.

D. FOUR-STEP PROCESS

The selection of appropriate control measures is based on the characteristics of the site and potential pollutants. The Four-Step Process provides a method of going through the selection process. The following applies the four-step process to the Development Plan for the Northcrest Center.

Step 1: Employ Runoff Reduction Practices

The Development Plan including the Landscape Plan utilizes landscaping areas for plantings and grass or mulch wherever possible without obstructing utilities or drainageways. Given the proposed land use, the majority of the site is to be paved for vehicular use. Within the mostly-impervious site, the storm water runoff is kept to the site limits by use of grading, a private storm system and all other areas are to be landscaped, including the right of way landscape buffer areas.

Step 2: Provide Water Quality Capture Volume

The Development Plan and Final Drainage Report indicate the use of storm water detention pond that a control measure for capturing storm water runoff and properly treating the storm water prior to release either via percolation into the soil or the public storm system. The detention pond is to be installed and the configuration is sized for capture of the WQCV as well as the EURV and full-spectrum detention and 100-year detention.

Step 3: Stabilize Drainageways

The drainage within the site is stabilized by way of pavement with features such as drainage pans, curb and gutter, and sloped pavement to direct storm water to the private storm system. There are no unpaved or unstabilized drainageways on this site. The distance to the nearest creek is approximately 1,033 feet to Douglas Creek.

Step 4: Implement Site Specific and Other Source Control BMPs

No control measures beyond the Full Spectrum Extended Detention Basin are proposed as there are no unusual land uses that would result in the need for other source control BMPs.

V. DRAINAGE INFRASTRUCTURE COSTS AND FEES

A. DRAINAGE AND BRIDGE FEES

The development falls within the Jimmy Camp Creek drainage basin which has a drainage basin fee of \$19,752/acre and a bridge fee of \$924/acre according to the El Paso County's 2021 fee schedule. The development's total property acreage is 3.25 acres.

Drainage Basin Fee: $\$19,752/\text{acre} * 3.25 \text{ acres} = \$64,194$

Bridge Fee: $\$924/\text{acre} * 3.25 \text{ acres} = \$3,003$

Note: This is an interim fee and will be adjusted when a DBPS is completed. In addition to the Drainage Fee a surety in the amount of \$7,285 per impervious acre

shall be provided to secure payment of additional fees in the event that the DBPS results in a fee greater than the current fee. Fees paid in excess of the future revised fee will be reimbursed. See Resolution 06-326 (9/14/06) and Resolution 16-320 (9/07/16).

Since the site is already platted, drainage fees have already been paid.

Any outstanding fees must be paid prior to plat recordation.

B. STORM DRAIN SYSTEM QUANTITIES AND COSTS ESTIMATE

The following summarizes the Engineer's Opinion of Probable Cost for the proposed storm facilities for the development (installation plus materials).

Private System

Description	Quantity	Unit	Unit Price	Cost
Earthwork for cut of Pond (Less than 1,000)	540	CY	\$ 8.00	\$ 5,300
Concrete Drainage Channel	2	CY	\$ 590.00	\$ 1,180
12" RCP	230	LF	\$55.00	\$12,650
18" RCP	226	LF	\$65.00	\$14,690
24" RCP	74	LF	\$ 78.00	\$ 5,772
Curb Inlet (Type R) L=10' 5' ≤ Depth < 10'	1	EA	\$8,136.00	\$8,136
Curb Inlet (Type R) L=20' 5' ≤ Depth < 10'	1	EA	\$11,005.00	\$11,005
Pond Outlet Structure	1	EA	\$ 10,000	\$ 10,000
Grated Inlet (Type C) Depth < 5'	2	EA	\$4,802.00	\$9,604
Storm Sewer Manhole, Box Base	1	EA	\$12,034.00	\$12,034

Total Cost	\$ 90,371
Engineering	
Contingency (10%)	\$ 9,037
Grand Total (w/ Contingency)	\$ 99,408
Non-Reimbursable	\$ 99,408

VI. CONCLUSIONS

A. COMPLIANCE WITH STANDARDS

The criteria used to design the storm water runoff volumes are formulas and figures within the City of Colorado Springs Drainage Manuals as well as the Mile High Flood District Drainage Criteria manual. Grading practices for optimal drainage comply with the geotechnical investigative report and City standards. The development of Lots 3-5 is within compliance and standards and meets the requirements for the Northcrest Center.

The proposed grading and drainage is within substantial conformance for the master drainage plan for the Subdivision and Drainage Basin. There is no impact on major drainageway planning studies within the larger drainage basin. This development will not adversely affect downstream development.

VII. REFERENCES

Colorado Springs Drainage Manual Volumes I & II (May 2014)

Colorado Urban Drainage and Flood Control District Drainage Criteria Manual, Volume I (August 2018)

Colorado Urban Drainage and Flood Control District Drainage Criteria Manual, Volume III (April 2018)

Urban Storm Drainage Criteria Manual, Volume III (November, 2015)

FEMA Flood Map Service Center


United States Department of Agriculture National Resources Conservation Service

Subsurface Soil Investigation prepared by RMG-Rocky Mountain Group Engineers dated February 23, 2021

VIII. Appendices

APPENDIX A – VICINITY MAP

VICINITY MAP
NORTHCREST CENTER
TBD BISMARK ROAD
COLORADO SPRINGS, COLORADO 80922
EL PASO COUNTY

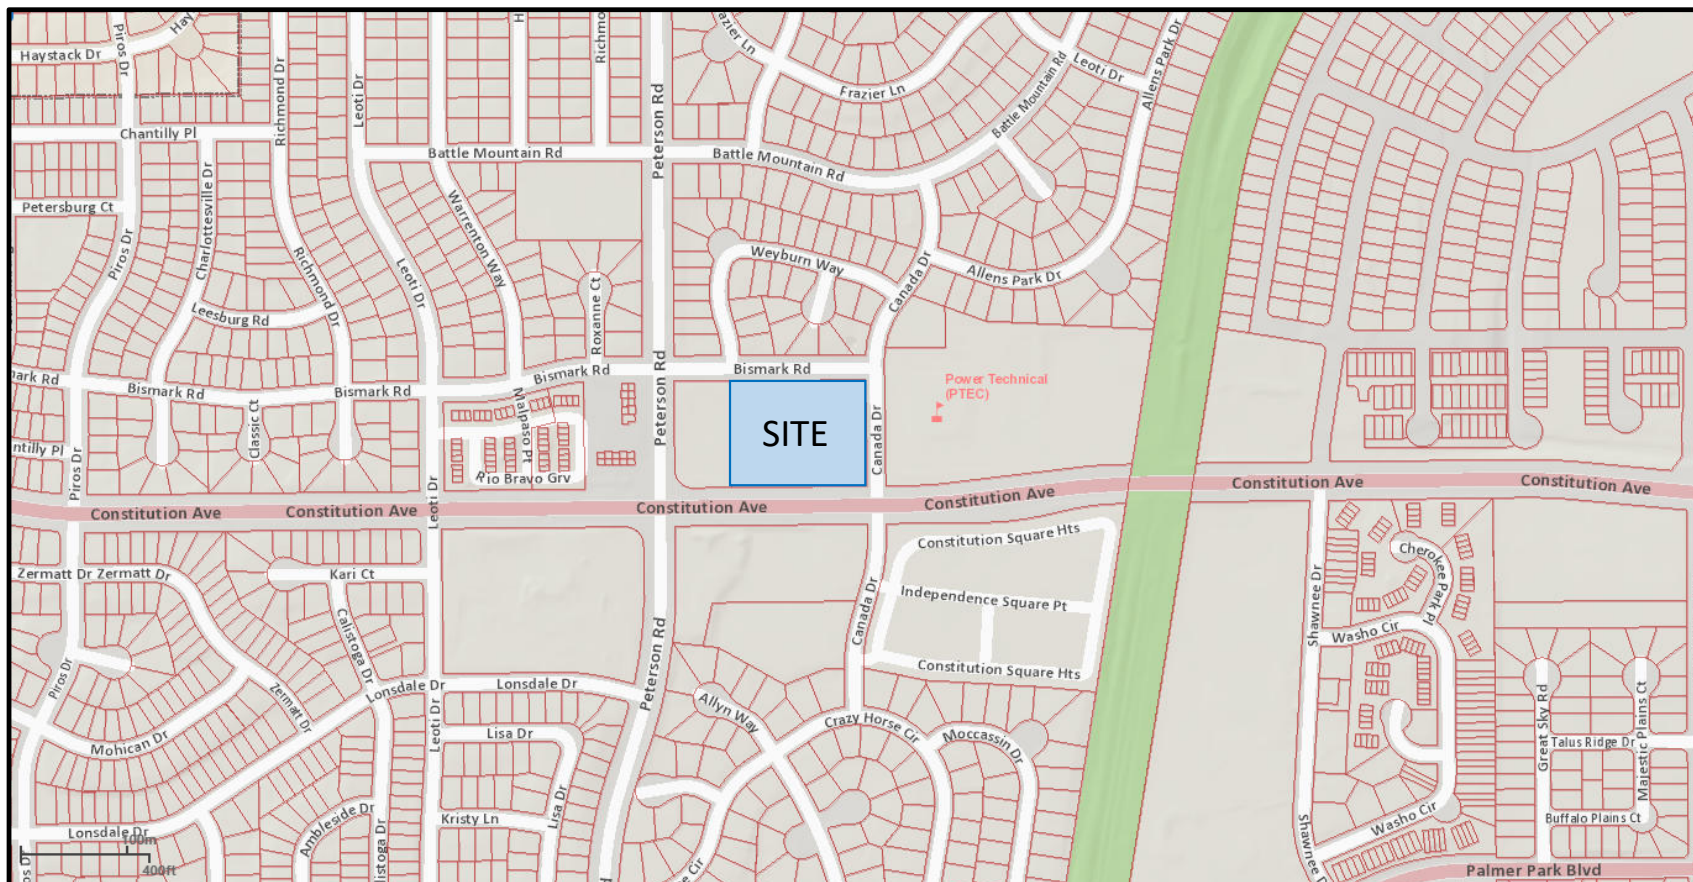

APPENDIX B – HYDROLOGIC AND HYDRAULIC COMPUTATIONS

Project: Northcrest Center PEMBs Development - EXISTING CONDITIONS
Engineer: Richard Lyon, PE
Date: 5/12/2021
Address: TBD Bismark Rd. Colorado Springs, Colorado

Sub-Basin:	E-1	(IDF Curve Equations from Figure 6-5 of the DCM Volume 1)				
t, Duration:	26.08					
I ₂	I ₅	I ₁₀	I ₂₅	I ₅₀	I ₁₀₀	
2.154002235	2.69098601	3.1396503	3.5883147	4.036979	4.5164165	

Hydrologic Soil Type:	A
-----------------------	---

Design Points			
Design Point	Q ₅	Q ₁₀	Q ₁₀₀
EX DP1	0.81	1.65	5.27
Total Site	0.81	1.65	5.27

Coefficient (Table 6-6)																
Land Use or Surface Characteristic	Square Feet	Acreage	Coefficient ₂	Coefficient ₅	Coefficient ₁₀	Coefficient ₂₅	Coefficient ₅₀	Coefficient ₁₀₀	2 Yr: C _c * A	5 Yr: C _c * A	10 Yr: C _c * A	25 Yr: C _c * A	50 Yr: C _c * A	100 Yr: C _c * A	2 Yr C _c	5 Yr C _c
Roof	0	0.000	0.71	0.73	0.75	0.78	0.80	0.81	0.000	0.000	0.000	0.000	0.000	0.000	0.033	0.093
Pavement	2155	0.049	0.89	0.90	0.92	0.94	0.95	0.96	0.044	0.045	0.046	0.047	0.047	0.047	0.162	0.261
Lawn	139193	3.195	0.02	0.08	0.15	0.25	0.30	0.35	0.064	0.256	0.479	0.799	0.959	1.118	0.310	0.359
A _c :	141348.11	3.245														

Q Peak Flow (cfs)					
2 Year Q	5 Year Q	10 Year Q	25 Year Q	50 Year Q	100 Year Q
0.23	0.81	1.65	3.03	4.06	5.27

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	E-1	
C_s :	0.09	[Table 6-6. Runoff Coefficients for Rational Method]
L :	550	
S :	0.045	

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots + C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	2155	0.05	0.90
Lawn	139193	3.20	0.08
A_t :	141348	3.24	

$$C_c = (0.90 * 0.04 + 0.08 * 3.20) / 3.24 =$$

0.09

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.09) * \sqrt{550}) / (0.045^{0.33}) =$$

26.03

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.006)^{0.5} =$$

1.55

ft/s

Flow Distance:

5.00

ft

$$t_t = L / V =$$

3.23

sec.

0.05

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

26.08

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

26.08

min.

Project: Northcrest Center PEMBs Commercial Development - DEVELOPED CONDITIONS
Engineer: Richard Lyon, PE
Date: 5/12/2021
Address: TBD Bismark Road

Sub-Basin:	D-1	(IDF Curve Equations from Figure 6-5 of the DCM Volume 1)				
t _r Duration:	7.83					
I ₂	I ₅	I ₁₀	I ₂₅	I ₅₀	I ₁₀₀	
3.585515386	4.495414352	5.2448167	5.9942191	6.7436215	7.5478561	

Hydrologic Soil Type: A

Sub-Basin:	D-2	(IDF Curve Equations from Figure 6-5 of the DCM Volume 1)				
t _r Duration:	8.08					
I ₂	I ₅	I ₁₀	I ₂₅	I ₅₀	I ₁₀₀	
3.548739946	4.449058756	5.1907352	5.9324117	6.6740881	7.4699787	

Hydrologic Soil Type: A

Sub-Basin:	D-3	(IDF Curve Equations from Figure 6-5 of the DCM Volume 1)				
t _r Duration:	10.08					
I ₂	I ₅	I ₁₀	I ₂₅	I ₅₀	I ₁₀₀	
3.284994319	4.116606284	4.802874	5.4891417	6.1754094	6.9114586	

Hydrologic Soil Type: A

Sub-Basin:	D-4	(IDF Curve Equations from Figure 6-5 of the DCM Volume 1)				
t _r Duration:	5.00					
I ₂	I ₅	I ₁₀	I ₂₅	I ₅₀	I ₁₀₀	
4.119768884	5.168843131	6.0304837	6.8921242	7.7537647	8.6792165	

Hydrologic Soil Type: A

Sub-Basin:	D-5	(IDF Curve Equations from Figure 6-5 of the DCM Volume 1)				
t _r Duration:	8.50					
I ₂	I ₅	I ₁₀	I ₂₅	I ₅₀	I ₁₀₀	
3.488148863	4.372683441	5.1016307	5.8305779	6.5595252	7.3416682	

Hydrologic Soil Type: A

Coefficient (Table 6-6)																				
Land Use or Surface Characteristic	Square Feet	Acreage	Coefficient ₂	Coefficient ₅	Coefficient ₁₀	Coefficient ₂₅	Coefficient ₅₀	Coefficient ₁₀₀	2 Yr: C * A	5 Yr: C * A	10 Yr: C * A	25 Yr: C * A	50 Yr: C * A	100 Yr: C * A	2 Yr C _c	5 Yr C _c	10 Yr C _c	25 Yr C _c	50 Yr C _c	100 Yr C _c
Roof	0	0.000	0.71	0.73	0.75	0.78	0.80	0.81	0.000	0.000	0.000	0.000	0.000	0.000	0.447	0.482	0.528	0.588	0.619	0.649
Pavement	6964	0.160	0.89	0.90	0.92	0.94	0.95	0.96	0.142	0.144	0.147	0.150	0.152	0.153						
Lawn & Gravel	7240	0.166	0.02	0.08	0.15	0.25	0.30	0.35	0.003	0.013	0.025	0.042	0.050	0.058						
A _c :	14204	0.326																		

Coefficient (Table 6-6)																				
Land Use or Surface Characteristic	Square Feet	Acreage	Coefficient ₂	Coefficient ₅	Coefficient ₁₀	Coefficient ₂₅	Coefficient ₅₀	Coefficient ₁₀₀	2 Yr: C _c * A	5 Yr: C _c * A	10 Yr: C _c * A	25 Yr: C _c * A	50 Yr: C _c * A	100 Yr: C _c * A	2 Yr C _c	5 Yr C _c	10 Yr C _c	25 Yr C _c	50 Yr C _c	100 Yr C _c
Roof	0	0.000	0.71	0.73	0.75	0.78	0.80	0.81	0.000	0.000	0.000	0.000	0.000	0.000	0.446	0.482	0.527	0.588	0.618	0.649
Pavement	8793	0.202	0.89	0.90	0.92	0.94	0.95	0.96	0.180	0.182	0.186	0.190	0.192	0.194						
Lawn	9159	0.210	0.02	0.08	0.15	0.25	0.30	0.35	0.004	0.017	0.032	0.053	0.063	0.074						
A _c :	17952	0.412																		

Coefficient (Table 6-6)																				
Land Use or Surface Characteristic	Square Feet	Acreage	Coefficient ₂	Coefficient ₅	Coefficient ₁₀	Coefficient ₂₅	Coefficient ₅₀	Coefficient ₁₀₀	2 Yr: C _c * A	5 Yr: C _c * A	10 Yr: C _c * A	25 Yr: C _c * A	50 Yr: C _c * A	100 Yr: C _c * A	2 Yr C _c	5 Yr C _c	10 Yr C _c	25 Yr C _c	50 Yr C _c	100 Yr C _c
Roof	0	0.000	0.71	0.73	0.75	0.78	0.80	0.81	0.000	0.000	0.000	0.000	0.000	0.000	0.362	0.402	0.452	0.521	0.555	0.589
Pavement	8902	0.204	0.89	0.90	0.92	0.94	0.95	0.96	0.182	0.184	0.188	0.192	0.194	0.196						
Lawn	13776	0.316	0.02	0.08	0.15	0.25	0.30	0.35	0.006	0.025	0.047	0.079	0.095	0.111						
A _c :	22678	0.521																		

Coefficient (Table 6-6)																				
Land Use or Surface Characteristic	Square Feet	Acreage	Coefficient ₂	Coefficient ₅	Coefficient ₁₀	Coefficient ₂₅	Coefficient ₅₀	Coefficient ₁₀₀	2 Yr: C _c * A	5 Yr: C _c * A	10 Yr: C _c * A	25 Yr: C _c * A	50 Yr: C _c * A	100 Yr: C _c * A	2 Yr C _c	5 Yr C _c	10 Yr C _c	25 Yr C _c	50 Yr C _c	100 Yr C _c
Roof	12040	0.276	0.71	0.73	0.75	0.78	0.80	0.81	0.196	0.202	0.207	0.216	0.221	0.224	0.781	0.797	0.817	0.843	0.859	0.869
Pavement	8104	0.186	0.89	0.90	0.92	0.94	0.95	0.96	0.166	0.167	0.171	0.175	0.177	0.179						
Lawn	45	0.001	0.02	0.08	0.15	0.25	0.30	0.35	0.000	0.000	0.000	0.000	0.000	0.000						
A _c :	20189	0.463																		

Coefficient (Table 6-6)																				
Land Use or Surface Characteristic	Square Feet	Acreage	Coefficient ₂	Coefficient ₅	Coefficient ₁₀	Coefficient ₂₅	Coefficient ₅₀	Coefficient ₁₀₀	2 Yr: C * A	5 Yr: C * A	10 Yr: C * A	25 Yr: C * A	50 Yr: C * A	100 Yr: C * A	2 Yr C _c	5 Yr C _c	10 Yr C _c	25 Yr C _c	50 Yr C _c	100 Yr C _c
Roof	17775	0.408	0.71	0.73	0.75	0.78	0.80	0.81	0.290	0.298	0.306	0.318	0.326	0.331	0.793	0.809	0.829	0.854	0.870	0.880
Pavement	16645	0.382	0.89	0.90	0.92	0.94	0.95	0.96	0.340	0.344	0.352	0.359	0.363	0.367						
Lawn	175	0.004	0.02	0.08	0.15	0.25	0.30	0.35	0.000	0.000	0.001	0.001	0.001	0.001						
A _c :	34595	0.794																		

Q Peak Flow (cfs)					
2 Year Q	5 Year Q	10 Year Q	25 Year Q	50 Year Q	100 Year Q
0.52	0.70	0.89	1.14	1.35	1.58

Q Peak Flow (cfs)					
2 Year Q	5 Year Q	10 Year Q	25 Year Q	50 Year Q	100 Year Q
0.65	0.88	1.13	1.44	1.70	2.00

Q Peak Flow (cfs)					
2 Year Q	5 Year Q	10 Year Q	25 Year Q	50 Year Q	100 Year Q
0.67	0.93	1.22	1.61	1.93	2.29

Q Peak Flow (cfs)					
2 Year Q	5 Year Q	10 Year Q	25 Year Q	50 Year Q	100 Year Q
1.28	1.64	1.97	2.32	2.66	3.01

Q Peak Flow (cfs)					
2 Year Q	5 Year Q	10 Year Q	25 Year Q	50 Year Q	100 Year Q
2.24	2.86	3.42	4.03	4.61	5.22

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-1	
C_s :	0.48	[Table 6-6. Runoff Coefficients for Rational Method]
L :	145	ft
S :	0.055	ft/ft

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	6964	0.16	0.90
Lawn	7240	0.17	0.08
A_t :	14204	0.33	

$$C_c = (0.90 * 0.16 + 0.08 * 0.17) / 0.33 =$$

0.48

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.48) * \sqrt{145}) / (0.055^{0.33}) =$$

7.71

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.041)^{0.5} =$$

4.05

ft/s

Flow Distance:

30.00

ft

$$t_t = L/V =$$

7.41

sec.

0.12

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

7.83

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

7.83

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-2	[Table 6-6. Runoff Coefficients for Rational Method]
C_s :	0.48	
L :	135	
S :	0.05	

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	8793	0.20	0.90
Lawn	9159	0.21	0.08
A_t :	17952	0.41	

$$C_c = (0.90 \cdot 0.20 + 0.08 \cdot 0.21) / 0.41 =$$

0.48

$$t_i = (0.395 \cdot (1.1 - C_s) \cdot \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 \cdot (1.1 - 0.48) \cdot \sqrt{135}) / (0.05^{0.33}) =$$

7.65

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.041)^{0.5} =$$

4.05

ft/s

Flow Distance:

105.00

ft

$$t_t = L/V =$$

25.93

sec.

0.43

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

8.08

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

8.08

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-3	[Table 6-6. Runoff Coefficients for Rational Method]
C_s :	0.40	
L :	155	
S :	0.043	

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	8902	0.20	0.90
Lawn	13776	0.32	0.08
A_t :	22678	0.52	

$$C_c = (0.90 * 0.20 + 0.08 * 0.32) / 0.52 =$$

0.40

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.40) * \sqrt{155}) / (0.043^{0.33}) =$$

9.79

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.02)^{0.5} =$$

4.05

ft/s

Flow Distance:

72.00

ft

$$t_t = L / V =$$

17.78

sec.

0.30

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

10.08

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

10.08

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-4	
C_s :	0.82	[Table 6-6. Runoff Coefficients for Rational Method]
L :	90	ft
S :	0.04	ft/ft

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	12040	0.28	0.73
Pavement	8104	0.19	0.90
Lawn	45	0.001	0.08
A_t :	20189	0.46	

$$C_c = (0.73 * 0.28 + 0.90 * 0.19 + 0.08 * 0.001) / 0.46 =$$

0.82

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.82) * \sqrt{90}) / (0.04^{0.33}) =$$

3.08

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.013)^{0.5} =$$

4.15

ft/s

Flow Distance:

130.00

ft

$$t_t = L/V =$$

31.35

sec.

0.52

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

3.60

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

5.00

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-5	[Table 6-6. Runoff Coefficients for Rational Method]
C_s :	0.47	
L :	125	
S :	0.046	

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	17775	0.41	0.73
Pavement	16645	0.38	0.90
Lawn	175	0.004	0.08
A_t :	34595	0.794	

$$C_c = (0.73 * 0.41 + 0.90 * 0.38 + 0.08 * 0.004) / 0.794 =$$

0.47

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.47) * \sqrt{125}) / (0.046^{0.33}) =$$

7.70

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.055)^{0.5} =$$

4.47

ft/s

Flow Distance:

215.00

ft

$$t_t = L / V =$$

48.08

sec.

0.80

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

8.50

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

8.50

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-6	[Table 6-6. Runoff Coefficients for Rational Method]
C_s :	0.33	
L :	7	
S :	10	

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	654	0.02	0.90
Lawn	2487	0.06	0.08
A_t :	3141	0.07	

$$C_c = (0.90 * 0.02 + 0.08 * 0.06) / 0.07 =$$

0.33

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.33) * \sqrt{7}) / (0.1^{0.33}) =$$

0.38

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20)(0.02)^{0.5} =$$

6.32

ft/s

Flow Distance:

10.00

ft

$$t_t = L/V =$$

1.58

sec.

0.03

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

0.40

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

5.00

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-7	
C_s :	0.42	[Table 6-6. Runoff Coefficients for Rational Method]
L :	46	ft
S :	0.02	ft/ft

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	4220	0.097	0.90
Lawn	19604	0.450	0.08
A_t :	23824	0.547	

$$C_c = (0.73 * 0.0 + 0.90 * 0.018 + 0.08 * 0.027) / 0.044 =$$

0.42

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.42) * \sqrt{24}) / (0.07^{0.33}) =$$

6.65

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.033)^{0.5} =$$

3.63

ft/s

Flow Distance:

642.00

ft

$$t_t = L / V =$$

176.70

sec.

2.95

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

9.60

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

9.60

min.

Time of Concentration

$$t_c = t_i + t_t$$

3.2.1 - Overland (Initial) Flow Time

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L}}{S^{0.33}} \quad (\text{Eq. 6-8})$$

Where:

t_i = overland (initial) flow time (min)

C_s = runoff coefficient for 5-year frequency (see Table 6-6)

L = length of overland flow (300 ft maximum for non-urban land uses, 100 ft maximum for urban land uses)

S = average basin slope (ft/ft)

Note that in some urban watersheds, the overland flow time may be very small because flows quickly concentrate and channelize.

Sub-Basin or DP:	D-8	[Table 6-6. Runoff Coefficients for Rational Method]
C_s :	0.41	
L :	10	
S :	0.02	

Composite Runoff Coefficient Calculation:

$$C_c = (C_1 A_1 + C_2 A_2 + C_3 A_3 + \dots C_i A_i) / A_t$$

Land Use or Surface Characteristic	Square Feet	Acreage	C_s
Roof	0	0.00	0.73
Pavement	4304	0.099	0.90
Lawn	446	0.010	0.08
A_t :	4750	0.109	

$$C_c = (0.73 * 0.0 + 0.90 * 0.027 + 0.08 * 0.039) / 0.067 =$$

0.41

$$t_i = (0.395 * (1.1 - C_s) * \sqrt{L}) / (S^{0.33})$$

$$t_i = (0.395 * (1.1 - 0.41) * \sqrt{25}) / (0.02^{0.33}) =$$

3.14

mins

3.2.2 Travel Time

For catchments with overland and channelized flow, the time of concentration needs to be considered in combination with the travel time, t_t , which is calculated using the hydraulic properties of the swale, ditch, or channel. For preliminary work, the overland travel time, t_t , can be estimated with the help of Figure 6-25 or Equation 6-9 (Guo 1999).

$$V = C_v S_w^{0.5} \quad (\text{Eq. 6-9})$$

Where:

V = velocity (ft/s)

C_v = conveyance coefficient (from Table 6-7)

S_w = watercourse slope (ft/ft)

$$V = C_v S_w^{0.5}$$

$$V = (20 / 0.038)^{0.5} =$$

3.90

ft/s

Flow Distance:

360.00

ft

$$t_t = L / V =$$

92.34

sec.

1.54

min.

Table 6-7. Conveyance Coefficient, C_v

Type of Land Surface	C_v
Heavy meadow	2.5
Tillage/field	5
Riprap (not buried)*	6.5
Short pasture and lawns	7
Nearly bare ground	10
Grassed waterway	15
Paved areas and shallow paved swales	20

*For buried riprap, select C_v value based on type of vegetative cover.

$$t_c = t_i + t_t =$$

4.68

min.

3.2.4 Minimum Time of Concentration

If the calculations result in a t_c of less than 10 minutes for undeveloped conditions, it is recommended that a minimum value of 10 minutes be used. The minimum t_c for urbanized areas is 5 minutes.

Final t_c :

5.00

min.

Site-Level Low Impact Development (LID) Design Effective Impervious Calculator

LID Credit by Impervious Reduction Factor (IRF) Method

UD-BMP (Version 3.06, November 2016)

User Input

Calculated cells

***Design Storm: 1-Hour Rain Depth

WQCY Event

0.60

inches

***Minor Storm: 1-Hour Rain Depth

2-Year Event

1.19

inches

***Major Storm: 1-Hour Rain Depth

100-Year Event

2.52

inches

Optional User Defined Storm

CWHP

100-Year Event

(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm

0

Max Intensity for Optional User Defined Storm

0


Designer: Richard Lyon, PE

Company: RMG - Rocky Mountain Group

Date: May 14, 2021

Project: Northeast Center PEMBs Development

Location: TBD Bismark Road Colorado Springs, CO - El Paso County

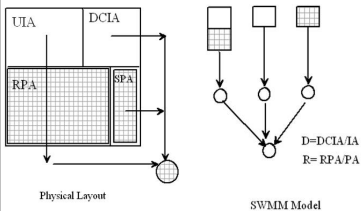

SITE INFORMATION (USER-INPUT)												
Sub-basin Identifier	D-1	D-2	D-3	D-4	D-5	D-6						
Receiving Pervious Area Soil Type	Sandy Loam	Sandy Loam	Sandy Loam	Sandy Loam	Sandy Loam	Sandy Loam						
Total Area (ac., Sum of DCIA, IUA, RPA, & SPA)	0.326	0.412	0.521	0.463	0.794	0.072						
Directly Connected Impervious Area (DCIA, acres)	0.160	0.202	0.204	0.462	0.790	0.015						
Unconnected Impervious Area (IUA, acres)	0.000	0.000	0.000	0.000	0.000	0.000						
Receiving Pervious Area (RPA, acres)	0.166	0.210	0.316	0.001	0.004	0.057						
Separate Pervious Area (SPA, acres)	0.000	0.000	0.000	0.000	0.000	0.000						
RPA Treatment Type: Conveyance (C), Volume (V), or Permeable Pavement (PP)	V	V	V	V	V	V						

CALCULATED RESULTS (OUTPUT)						
Total Calculated Area (ac, check against input)	0.326	0.412	0.521	0.463	0.794	0.072
Directly Connected Impervious Area (DCIA, %)	49.0%	49.0%	39.3%	99.8%	99.5%	20.8%
Unconnected Impervious Area (UIA, %)	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Receiving Pervious Area (RPA, %)	51.0%	51.0%	60.7%	0.2%	0.5%	79.2%
Separate Pervious Area (SPA, %)	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
A _p (RPA / UIA)	0.000	0.000	0.000	0.000	0.000	0.000
I _a Check	1.000	1.000	1.000	1.000	1.000	1.000
f / I for WQCV Event:	1.7	1.7	1.7	1.7	1.7	1.7
f / I for 2-Year Event:	0.5	0.5	0.5	0.5	0.5	0.5
f / I for 100-Year Event:	0.3	0.3	0.3	0.3	0.3	0.3
f / I for Optional User Defined Storm CLUP:						
IRF for WQCV Event:	0.00	0.00	0.00	0.00	0.00	0.00
IRF for 2-Year Event:	1.00	1.00	1.00	1.00	1.00	1.00
IRF for 100-Year Event:	1.00	1.00	1.00	1.00	1.00	1.00
IRF for Optional User Defined Storm CLUP:						
Total Site Imperviousness: I _{total}	49.0%	49.0%	39.3%	99.8%	99.5%	20.8%
Effective Imperviousness for WQCV Event:	49.0%	49.0%	39.3%	99.8%	99.5%	20.8%
Effective Imperviousness for 2-Year Event:	49.0%	49.0%	39.3%	99.8%	99.5%	20.8%
Effective Imperviousness for 100-Year Event:	49.0%	49.0%	39.3%	99.8%	99.5%	20.8%
Effective Imperviousness for Optional User Defined Storm CLUP:						

[illegible]

Total Site Imperviousness:	70.8%
Total Site Effective Imperviousness for WQCV Event:	70.8%
Total Site Effective Imperviousness for 2-Year Event:	70.8%
Total Site Effective Imperviousness for 100-Year Event:	70.8%
Total Site Effective Imperviousness for Optional User Defined Storm CUHP:	

Notes:


* Use Green-Ampt average infiltration rate values from Table 3-3.

** Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.

*** Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposes

Soil Type	Hydrologic Soil Group	WQCV Event	Minor Storm Event	Major Storm Event	Optional User Defined Event
		(in/hr)	(in/hr)	(in/hr)	(in/hr)
Clay	D	0.12	0.22	0.23	#N/A
Sandy Clay	D	0.16	0.25	0.29	#N/A
Silty Clay	D	0.18	0.29	0.29	#N/A
Clay Loam	D	0.26	0.29	0.29	#N/A
Silty Clay Loam	D	0.27	0.39	0.40	#N/A
Sandy Clay Loam	D	0.34	0.38	0.38	#N/A
Loam	C	0.43	0.42	0.47	#N/A
Silt Loam	C	0.83	0.51	0.76	#N/A
Sandy Loam	C	1.04	0.51	0.78	#N/A
Loamy Sand	B	1.92	0.67	0.98	#N/A
Sand	A	5.85	0.67	1.44	#N/A

¹Infiltration Rates are based on the Green-Ampt method and are calculated as the average infiltration rate over the duration of the storm.

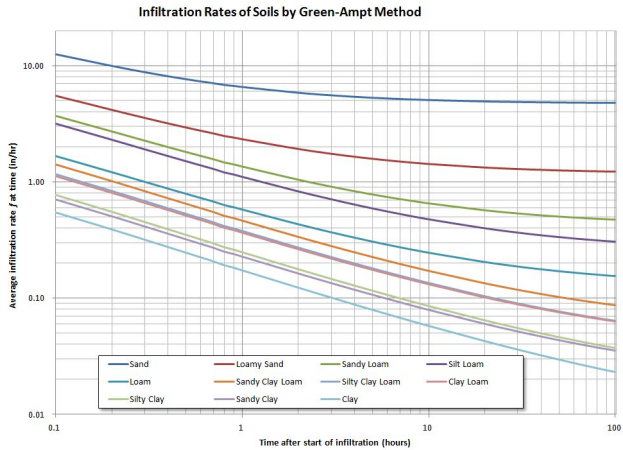

Hydraulic Grade Line and Pipe Capacity


100-YEAR EVENT											
Pipe	Design Flow Rate	Proposed Pipe Diameter	Slope	80% of Proposed Pipe Diameter	Manning Coefficient	Full Pipe Cross Sectional Area	Full Pipe Flow Rate	Q Design / Q Full	d/D	Hydraulic Grade Line (Depth of Flow)	Depth of Flow Less Than 80% of Pipe Diameter
	Qdes (ft3/sec)	Dpro(in)	S (%)	Dpro*.8 (in)	n	A (ft) = $\pi (Dpro/2)^2$	Qfull (ft3/s) = $A(1.49/n)((Dpro/48)^{2/3})^{5/2}$	Qdes/Qfull	(from Chart)	d (in) = (d/D)*Dpro	(Yes/No)
1-2	1.58	12.0	2.08%	9.6	0.013	0.785	5.150	0.31	0.43	5.16	Yes
2-3	3.58	12.0	2.08%	9.6	0.013	0.785	5.150	0.70	0.68	8.10	Yes
3-4	5.87	18.0	2.08%	14.4	0.013	1.766	15.183	0.39	0.49	8.73	Yes
4-6	8.88	18.0	2.08%	14.4	0.013	1.766	15.183	0.58	0.62	11.07	Yes
5-6	5.22	18.0	2.08%	14.4	0.013	1.766	15.183	0.34	0.45	8.10	Yes
OUTLET	14.36	24.0	2.08%	19.2	0.013	3.140	32.698	0.44	0.52	12.36	Yes

5-YEAR EVENT											
Pipe	Design Flow Rate	Proposed Pipe Diameter	Slope	80% of Proposed Pipe Diameter	Manning Coefficient	Full Pipe Cross Sectional Area	Full Pipe Flow Rate	Q Design / Q Full	d/D	Hydraulic Grade Line (Depth of Flow)	Depth of Flow Less Than 80% of Pipe Diameter
	Qdes (ft3/sec)	Dpro(in)	S (%)	Dpro*.8 (in)	n	A (ft) = $\pi (Dpro/2)^2$	Qfull (ft3/s) = $A(1.49/n)((Dpro/48)^{2/3})^{5/2}$	Qdes/Qfull	(from Chart)	d (in) = (d/D)*Dpro	(Yes/No)
1-2	0.70	12.0	2.08%	9.6	0.013	0.785	5.150	0.14	0.28	3.30	Yes
2-3	1.58	12.0	2.08%	9.6	0.013	0.785	5.150	0.31	0.43	5.16	Yes
3-4	2.51	18.0	2.08%	14.4	0.013	1.766	15.183	0.17	0.31	5.63	Yes
4-6	4.15	18.0	2.08%	14.4	0.013	1.766	15.183	0.27	0.38	6.84	Yes
5-6	2.86	18.0	2.08%	14.4	0.013	1.766	15.183	0.19	0.34	6.03	Yes
OUTLET	7.09	18.0	2.08%	14.4	0.013	1.766	15.183	0.47	0.53	9.54	Yes

AREA INLET IN A SWALE

NORTHCREST CENTER PEMBs - EL PASO COUNTY

DP1

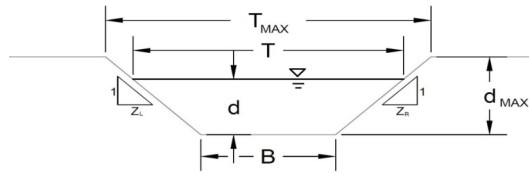

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity (V_{MAX})	Max Froude No. (F_{MAX})
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D, or E =

n =	0.012	
S_o =	0.0410	ft/ft
B =	4.00	ft
Z1 =	0.02	ft/ft
Z2 =	0.02	ft/ft

Choose One:

- ☐ Non-Cohesive
☐ Cohesive
☐ Paved

Maximum Allowable Top Width of Channel for Minor & Major Storm

Maximum Allowable Water Depth in Channel for Minor & Major Storm

	Minor Storm	Major Storm	
T_{MAX} =	55.00	55.00	ft
d_{MAX} =	2.00	2.00	ft

Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
Q_{allow} =	204.5	204.5	cfs
d_{allow} =	2.00	2.00	ft

Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

Q_o =	0.7	1.6	cfs
d =	0.05	0.08	ft


Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

MHFD-Inlet, Version 5.01 (April 2021)


AREA INLET IN A SWALE

NORTHCREST CENTER PEMBs - EL PASO COUNTY
DP1

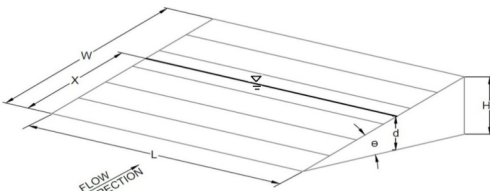Inlet Design Information (Input)																					
Type of Inlet	CDOT Type C (Depressed)																				
Inlet Type =	CDOT Type C (Depressed)																				
Angle of Inclined Grate (must be ≤ 30 degrees)	$\theta = 1.19$ degrees																				
Width of Grate	$W = 3.00$ ft																				
Length of Grate	$L = 3.00$ ft																				
Open Area Ratio	$A_{RATIO} = 0.70$																				
Height of Inclined Grate	$H_B = 0.06$ ft																				
Clogging Factor	$C_f = 0.50$																				
Grate Discharge Coefficient	$C_d = 0.79$																				
Orifice Coefficient	$C_o = 0.52$																				
Weir Coefficient	$C_w = 1.68$																				
																					
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression)																					
Total Inlet Interception Capacity (assumes clogged condition)																					
Bypassed Flow																					
Capture Percentage = Q_a/Q_o																					
	<table border="1"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td>$d =$</td> <td>1.05</td> <td>1.08</td> <td></td> </tr> <tr> <td>$Q_a =$</td> <td>15.9</td> <td>16.6</td> <td>cfs</td> </tr> <tr> <td>$Q_b =$</td> <td>0.0</td> <td>0.0</td> <td>cfs</td> </tr> <tr> <td>$C\% =$</td> <td>100</td> <td>100</td> <td>%</td> </tr> </tbody> </table>		MINOR	MAJOR		$d =$	1.05	1.08		$Q_a =$	15.9	16.6	cfs	$Q_b =$	0.0	0.0	cfs	$C\% =$	100	100	%
	MINOR	MAJOR																			
$d =$	1.05	1.08																			
$Q_a =$	15.9	16.6	cfs																		
$Q_b =$	0.0	0.0	cfs																		
$C\% =$	100	100	%																		

Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.
Warning 02: Depth (d) exceeds USDCM Volume I recommendation.

AREA INLET IN A SWALE

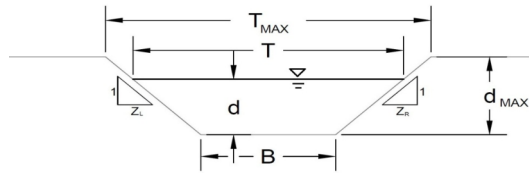NORTHCREST CENTER PEMBs - EL PASO COUNTY
DP2

This worksheet uses the NRCS vegetative retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetative Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity (V_{MAX})	Max Froude No. (F_{MAX})
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D, or E =

n =	0.012	
S_0 =	0.0410	ft/ft
B =	4.00	ft
Z1 =	0.05	ft/ft
Z2 =	0.05	ft/ft

Choose One:

- ☐ Non-Cohesive
☐ Cohesive
☒ Paved

Maximum Allowable Top Width of Channel for Minor & Major Storm

Maximum Allowable Water Depth in Channel for Minor & Major Storm

	Minor Storm	Major Storm	
T_{MAX} =	55.00	55.00	ft
d_{MAX} =	2.00	2.00	ft

Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
Q_{allow} =	209.5	209.5	cfs
d_{allow} =	2.00	2.00	ft

Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

Q_o =	0.9	2.0	cfs
d =	0.06	0.10	ft


Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

MHFD-Inlet, Version 5.01 (April 2021)


AREA INLET IN A SWALE

NORTHCREST CENTER PEMBs - EL PASO COUNTY
DP2

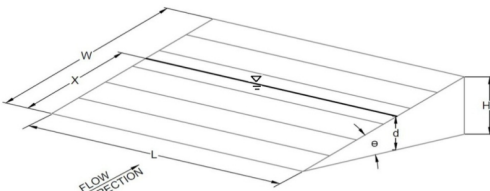Inlet Design Information (Input)																												
Type of Inlet: CDOT Type C (Depressed)	Inlet Type = CDOT Type C (Depressed)																											
Angle of Inclined Grate (must be <= 30 degrees) Width of Grate Length of Grate Open Area Ratio Height of Inclined Grate Clogging Factor Grate Discharge Coefficient Orifice Coefficient Weir Coefficient	<div style="display: flex; align-items: center;">  <table border="1" style="border-collapse: collapse; text-align: right;"> <tr><td>θ =</td><td>1.19</td><td>degrees</td></tr> <tr><td>W =</td><td>3.00</td><td>ft</td></tr> <tr><td>L =</td><td>3.00</td><td>ft</td></tr> <tr><td>A_{RATIO} =</td><td>0.70</td><td></td></tr> <tr><td>H_B =</td><td>0.06</td><td>ft</td></tr> <tr><td>C_f =</td><td>0.50</td><td></td></tr> <tr><td>C_d =</td><td>0.79</td><td></td></tr> <tr><td>C_o =</td><td>0.52</td><td></td></tr> <tr><td>C_w =</td><td>1.68</td><td></td></tr> </table> </div>	θ =	1.19	degrees	W =	3.00	ft	L =	3.00	ft	A _{RATIO} =	0.70		H _B =	0.06	ft	C _f =	0.50		C _d =	0.79		C _o =	0.52		C _w =	1.68	
θ =	1.19	degrees																										
W =	3.00	ft																										
L =	3.00	ft																										
A _{RATIO} =	0.70																											
H _B =	0.06	ft																										
C _f =	0.50																											
C _d =	0.79																											
C _o =	0.52																											
C _w =	1.68																											
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression) Total Inlet Interception Capacity (assumes clogged condition) Bypassed Flow Capture Percentage = Q_a/Q_o	<table border="1" style="border-collapse: collapse; text-align: center;"> <thead> <tr> <th></th> <th>MINOR</th> <th>MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td>d =</td> <td>1.06</td> <td>1.10</td> <td></td> </tr> <tr> <td>Q_a =</td> <td>16.1</td> <td>16.9</td> <td>cfs</td> </tr> <tr> <td>Q_b =</td> <td>0.0</td> <td>0.0</td> <td>cfs</td> </tr> <tr> <td>C% =</td> <td>100</td> <td>100</td> <td>%</td> </tr> </tbody> </table>		MINOR	MAJOR		d =	1.06	1.10		Q_a =	16.1	16.9	cfs	Q_b =	0.0	0.0	cfs	C% =	100	100	%							
	MINOR	MAJOR																										
d =	1.06	1.10																										
Q_a =	16.1	16.9	cfs																									
Q_b =	0.0	0.0	cfs																									
C% =	100	100	%																									

Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.
Warning 02: Depth (d) exceeds USDCM Volume I recommendation.

AREA INLET IN A SWALE

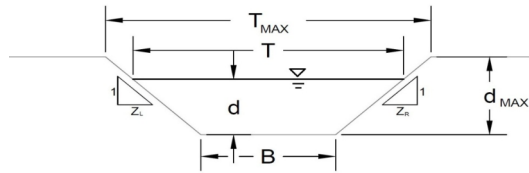NORTHCREST CENTER PEMBs - EL PASO COUNTY
DP3

This worksheet uses the NRCS vegetal retardance method to determine Manning's n.

For more information see Section 7.2.3 of the USDCM.

Analysis of Trapezoidal Grass-Lined Channel Using SCS Method

NRCS Vegetal Retardance (A, B, C, D, or E)

Manning's n (Leave cell D16 blank to manually enter an n value)

Channel Invert Slope

Bottom Width

Left Side Slope

Right Side Slope

Check one of the following soil types:

Soil Type:	Max. Velocity (V_{MAX})	Max Froude No. (F_{MAX})
Non-Cohesive	5.0 fps	0.60
Cohesive	7.0 fps	0.80
Paved	N/A	N/A

A, B, C, D, or E =

n =	0.012	
S_o =	0.0410	ft/ft
B =	4.00	ft
Z1 =	0.05	ft/ft
Z2 =	0.05	ft/ft

Choose One:

- ☐ Non-Cohesive
☐ Cohesive
☒ Paved

Maximum Allowable Top Width of Channel for Minor & Major Storm

Maximum Allowable Water Depth in Channel for Minor & Major Storm

	Minor Storm	Major Storm	
T_{MAX} =	55.00	55.00	ft
d_{MAX} =	2.00	2.00	ft

Allowable Channel Capacity Based On Channel Geometry

MINOR STORM Allowable Capacity is based on Depth Criterion

MAJOR STORM Allowable Capacity is based on Depth Criterion

	Minor Storm	Major Storm	
Q_{allow} =	209.5	209.5	cfs
d_{allow} =	2.00	2.00	ft

Water Depth in Channel Based On Design Peak Flow

Design Peak Flow

Water Depth

Q_o =	0.9	2.3	cfs
d =	0.06	0.11	ft


Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

MHFD-Inlet, Version 5.01 (April 2021)

AREA INLET IN A SWALE


NORTHCREST CENTER PEMBs - EL PASO COUNTY
DP3

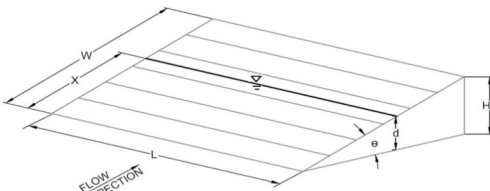Inlet Design Information (Input)																												
Type of Inlet: CDOT Type C (Depressed)	Inlet Type = CDOT Type C (Depressed)																											
Angle of Inclined Grate (must be <= 30 degrees) Width of Grate Length of Grate Open Area Ratio Height of Inclined Grate Clogging Factor Grate Discharge Coefficient Orifice Coefficient Weir Coefficient	<div style="display: flex; align-items: center;">  <table style="border-collapse: collapse;"> <tr><td>θ =</td><td style="border: 1px solid black; text-align: center;">1.19</td><td>degrees</td></tr> <tr><td>W =</td><td style="border: 1px solid black; text-align: center;">3.00</td><td>ft</td></tr> <tr><td>L =</td><td style="border: 1px solid black; text-align: center;">3.00</td><td>ft</td></tr> <tr><td>A_{RATIO} =</td><td style="border: 1px solid black; text-align: center;">0.70</td><td></td></tr> <tr><td>H_B =</td><td style="border: 1px solid black; text-align: center;">0.06</td><td>ft</td></tr> <tr><td>C_f =</td><td style="border: 1px solid black; text-align: center;">0.50</td><td></td></tr> <tr><td>C_d =</td><td style="border: 1px solid black; text-align: center;">0.79</td><td></td></tr> <tr><td>C_o =</td><td style="border: 1px solid black; text-align: center;">0.52</td><td></td></tr> <tr><td>C_w =</td><td style="border: 1px solid black; text-align: center;">1.68</td><td></td></tr> </table> </div>	θ =	1.19	degrees	W =	3.00	ft	L =	3.00	ft	A_{RATIO} =	0.70		H_B =	0.06	ft	C_f =	0.50		C_d =	0.79		C_o =	0.52		C_w =	1.68	
θ =	1.19	degrees																										
W =	3.00	ft																										
L =	3.00	ft																										
A_{RATIO} =	0.70																											
H_B =	0.06	ft																										
C_f =	0.50																											
C_d =	0.79																											
C_o =	0.52																											
C_w =	1.68																											
Water Depth at Inlet (for depressed inlets, 1 foot is added for depression) Total Inlet Interception Capacity (assumes clogged condition) Bypassed Flow Capture Percentage = Q_a/Q_o	<table style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th style="text-align: center; border-bottom: 1px solid black;">MINOR</th> <th style="text-align: center; border-bottom: 1px solid black;">MAJOR</th> <th></th> </tr> </thead> <tbody> <tr> <td>d =</td> <td style="border: 1px solid black; text-align: center;">1.06</td> <td style="border: 1px solid black; text-align: center;">1.11</td> <td></td> </tr> <tr> <td>Q_a =</td> <td style="border: 1px solid black; text-align: center;">16.1</td> <td style="border: 1px solid black; text-align: center;">17.1</td> <td>cfs</td> </tr> <tr> <td>Q_b =</td> <td style="border: 1px solid black; text-align: center;">0.0</td> <td style="border: 1px solid black; text-align: center;">0.0</td> <td>cfs</td> </tr> <tr> <td>$C\%$ =</td> <td style="border: 1px solid black; text-align: center;">100</td> <td style="border: 1px solid black; text-align: center;">100</td> <td>%</td> </tr> </tbody> </table>		MINOR	MAJOR		d =	1.06	1.11		Q_a =	16.1	17.1	cfs	Q_b =	0.0	0.0	cfs	$C\%$ =	100	100	%							
	MINOR	MAJOR																										
d =	1.06	1.11																										
Q_a =	16.1	17.1	cfs																									
Q_b =	0.0	0.0	cfs																									
$C\%$ =	100	100	%																									

Warning 01: Sideslope steepness exceeds USDCM Volume I recommendation.
 Warning 02: Depth (d) exceeds USDCM Volume I recommendation.

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

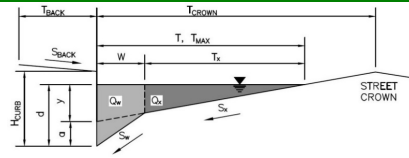Project: **NORTHCREST CENTER PEMBS - EL PASO COUNTY**Inlet ID: **DP4****Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

T_{BACK}	=	5.0	ft
S_{BACK}	=	0.020	ft/ft
n_{BACK}	=	0.020	

H_{CURB}	=	6.00	inches
T_{CROWN}	=	12.0	ft
W	=	2.00	ft
S_X	=	0.040	ft/ft
S_W	=	0.083	ft/ft
S_O	=	0.020	ft/ft
n_{STREET}	=	0.016	

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (check box for yes, leave blank for no)

	Minor Storm	Major Storm		
T_{MAX}	=	10.0	10.0	ft
d_{MAX}	=	6.0	6.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>		

MINOR STORM Allowable Capacity is based on Spread Criterion

MAJOR STORM Allowable Capacity is based on Spread Criterion


	Minor Storm	Major Storm		
Q_{allow}	=	11.8	11.8	cfs

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'

INLET ON A CONTINUOUS GRADE


MHFD-Inlet, Version 5.01 (April 2021)

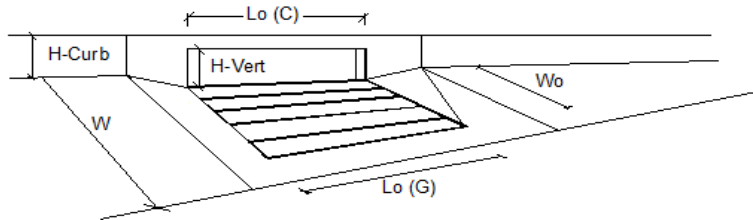

Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		N_u =	2	2	
Length of a Single Unit Inlet (Grate or Curb Opening)		L_u =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_u =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		C_{r-G} =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		C_{r-C} =	0.10	0.10	
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$					
Total Inlet Interception Capacity		Q =	1.6	3.0	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.0	0.0	cfs
Capture Percentage = Q_u/Q_a =		$C\%$ =	100	100	%

ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

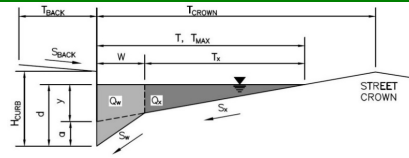Project: **NORTHCREST CENTER PEMBS - EL PASO COUNTY**Inlet ID: **DP5****Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb

Side Slope Behind Curb (leave blank for no conveyance credit behind curb)

Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

Height of Curb at Gutter Flow Line

Distance from Curb Face to Street Crown

Gutter Width

Street Transverse Slope

Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)

Street Longitudinal Slope - Enter 0 for sump condition

Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$$\begin{aligned} T_{\text{BACK}} &= 5.0 \text{ ft} \\ S_{\text{BACK}} &= 0.020 \text{ ft/ft} \\ n_{\text{BACK}} &= 0.020 \end{aligned}$$

$$\begin{aligned} H_{\text{CURB}} &= 6.00 \text{ inches} \\ T_{\text{CROWN}} &= 60.0 \text{ ft} \\ W &= 2.00 \text{ ft} \\ S_x &= 0.040 \text{ ft/ft} \\ S_y &= 0.083 \text{ ft/ft} \\ S_o &= 0.020 \text{ ft/ft} \\ n_{\text{STREET}} &= 0.016 \end{aligned}$$

Max. Allowable Spread for Minor & Major Storm

Max. Allowable Depth at Gutter Flowline for Minor & Major Storm

Allow Flow Depth at Street Crown (check box for yes, leave blank for no)

	Minor Storm	Major Storm	
T_{MAX}	48.0	48.0	ft
d_{MAX}	6.0	6.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	

MINOR STORM Allowable Capacity is based on Depth Criterion


MAJOR STORM Allowable Capacity is based on Depth Criterion

$$Q_{\text{allow}} = \begin{matrix} \text{Minor Storm} & \text{Major Storm} \\ 12.8 & 12.8 \end{matrix} \text{ cfs}$$

Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'**Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'**

INLET ON A CONTINUOUS GRADE

MHFD-Inlet, Version 5.01 (April 2021)

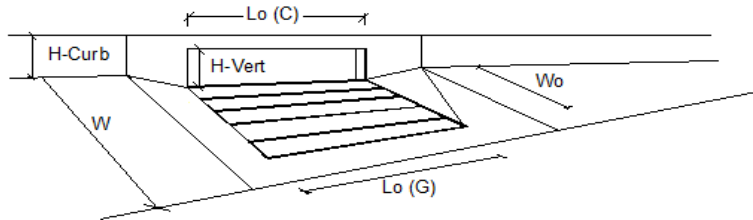


Design Information (Input)		MINOR		MAJOR	
Type of Inlet	CDOT Type R Curb Opening	Type =	CDOT Type R Curb Opening		
Local Depression (additional to continuous gutter depression 'a')		a_{LOCAL} =	3.0	3.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)		N_u =	4	4	
Length of a Single Unit Inlet (Grate or Curb Opening)		L_u =	5.00	5.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)		W_u =	N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)		C_r-G =	N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)		C_r-C =	0.10	0.10	
Street Hydraulics: OK - $Q < \text{Allowable Street Capacity}$					
Total Inlet Interception Capacity		Q =	2.9	5.2	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)		Q_b =	0.0	0.0	cfs
Capture Percentage = Q_u/Q_a =		$C\%$ =	100	100	%

APPENDIX C – FEMA FLOODPLAIN MAP

National Flood Hazard Layer FIRMette



104°42'18"W 38°52'21"N

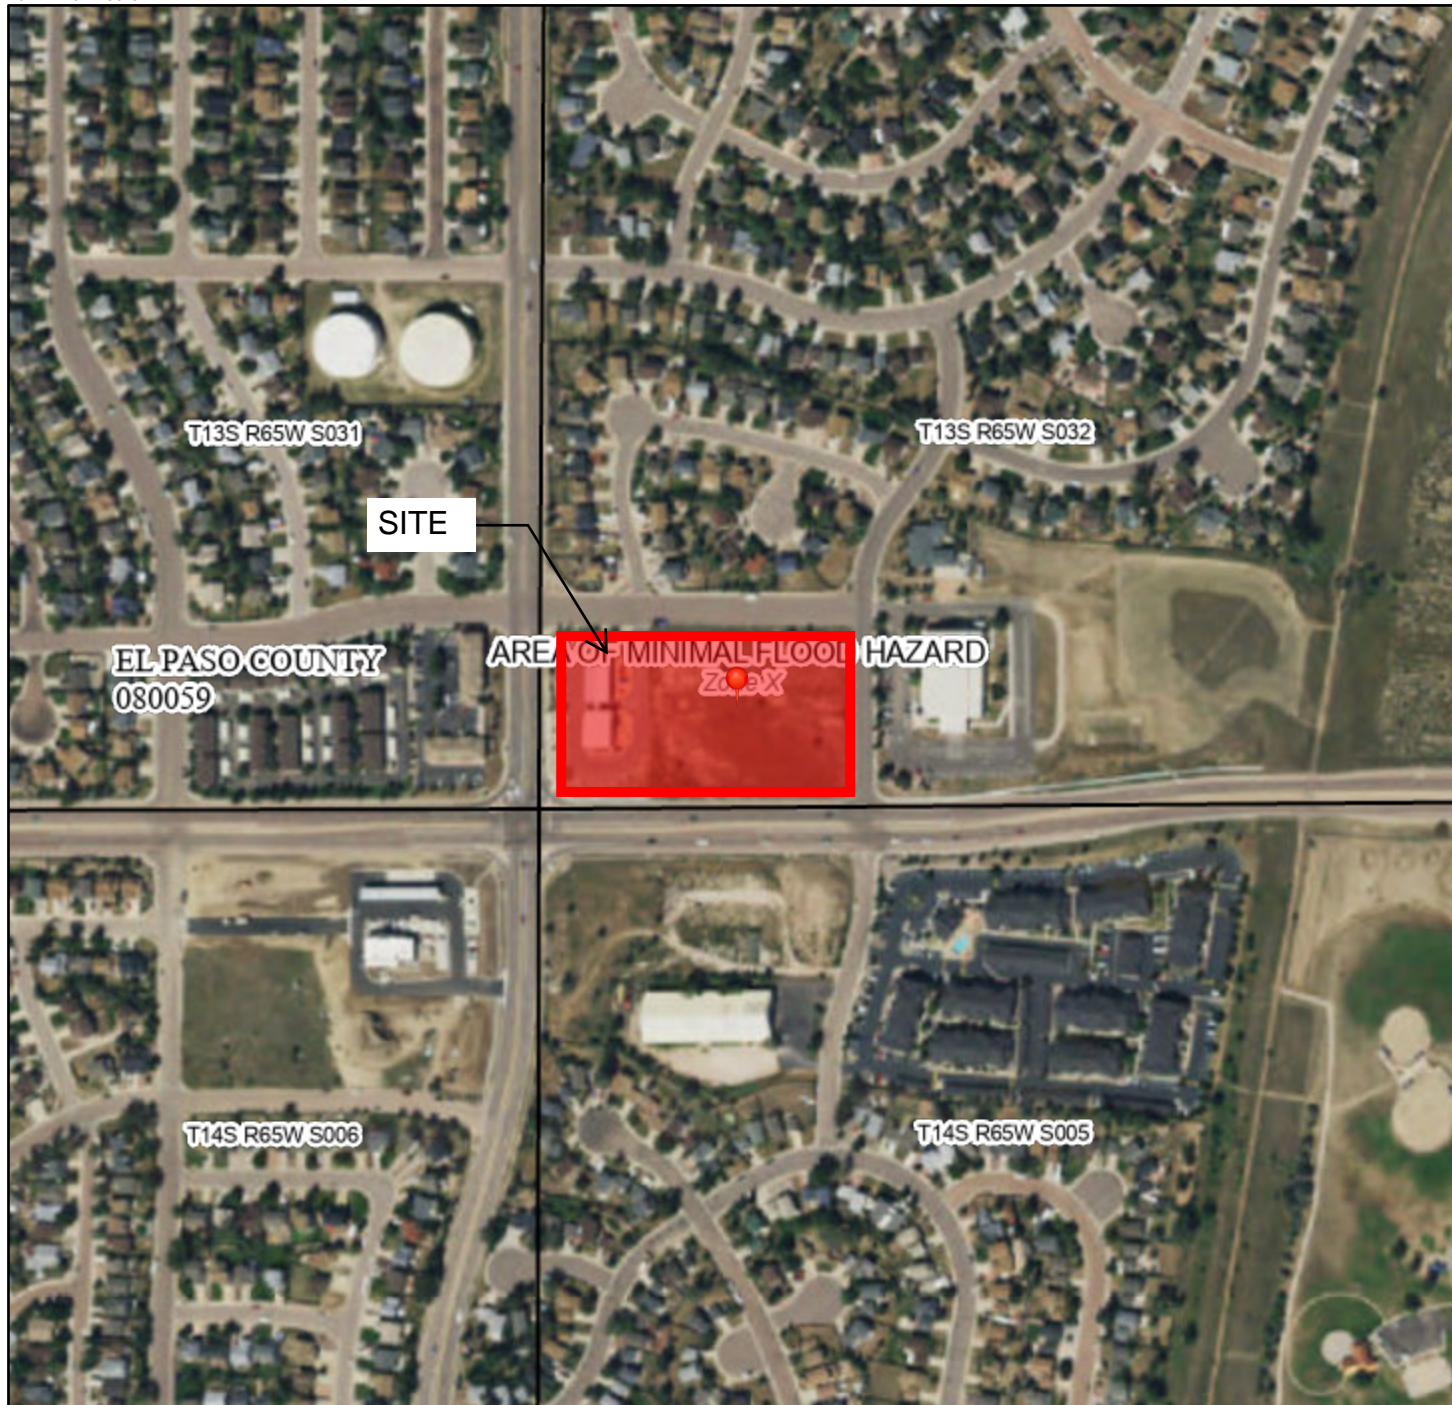

0 250 500 1,000 1,500 2,000 Feet 1:6,000

Basemap: USGS National Map: Orthoimagery: Data refreshed October, 2020

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS		Without Base Flood Elevation (BFE) Zone A, V, A99
		With BFE or Depth Zone AE, AO, AH, VE, AR
		Regulatory Floodway
OTHER AREAS OF FLOOD HAZARD		0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
		Future Conditions 1% Annual Chance Flood Hazard Zone X
		Area with Reduced Flood Risk due to Levee. See Notes. Zone X
		Area with Flood Risk due to Levee Zone D
OTHER AREAS		NO SCREEN Area of Minimal Flood Hazard Zone X
		Effective LOMRs
GENERAL STRUCTURES		Area of Undetermined Flood Hazard Zone D
		Channel, Culvert, or Storm Sewer
		Levee, Dike, or Floodwall
OTHER FEATURES		20.2 Cross Sections with 1% Annual Chance Water Surface Elevation
		17.5 Cross Sections with 1% Annual Chance Water Surface Elevation
		Coastal Transect
		Base Flood Elevation Line (BFE)
		Limit of Study
		Jurisdiction Boundary
		Coastal Transect Baseline
		Profile Baseline
		Hydrographic Feature
MAP PANELS		Digital Data Available
		No Digital Data Available
		Unmapped



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.


This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 3/17/2021 at 3:21 PM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

APPENDIX D – USGS SOILS SURVEY MAP

Hydrologic Soil Group—El Paso County Area, Colorado

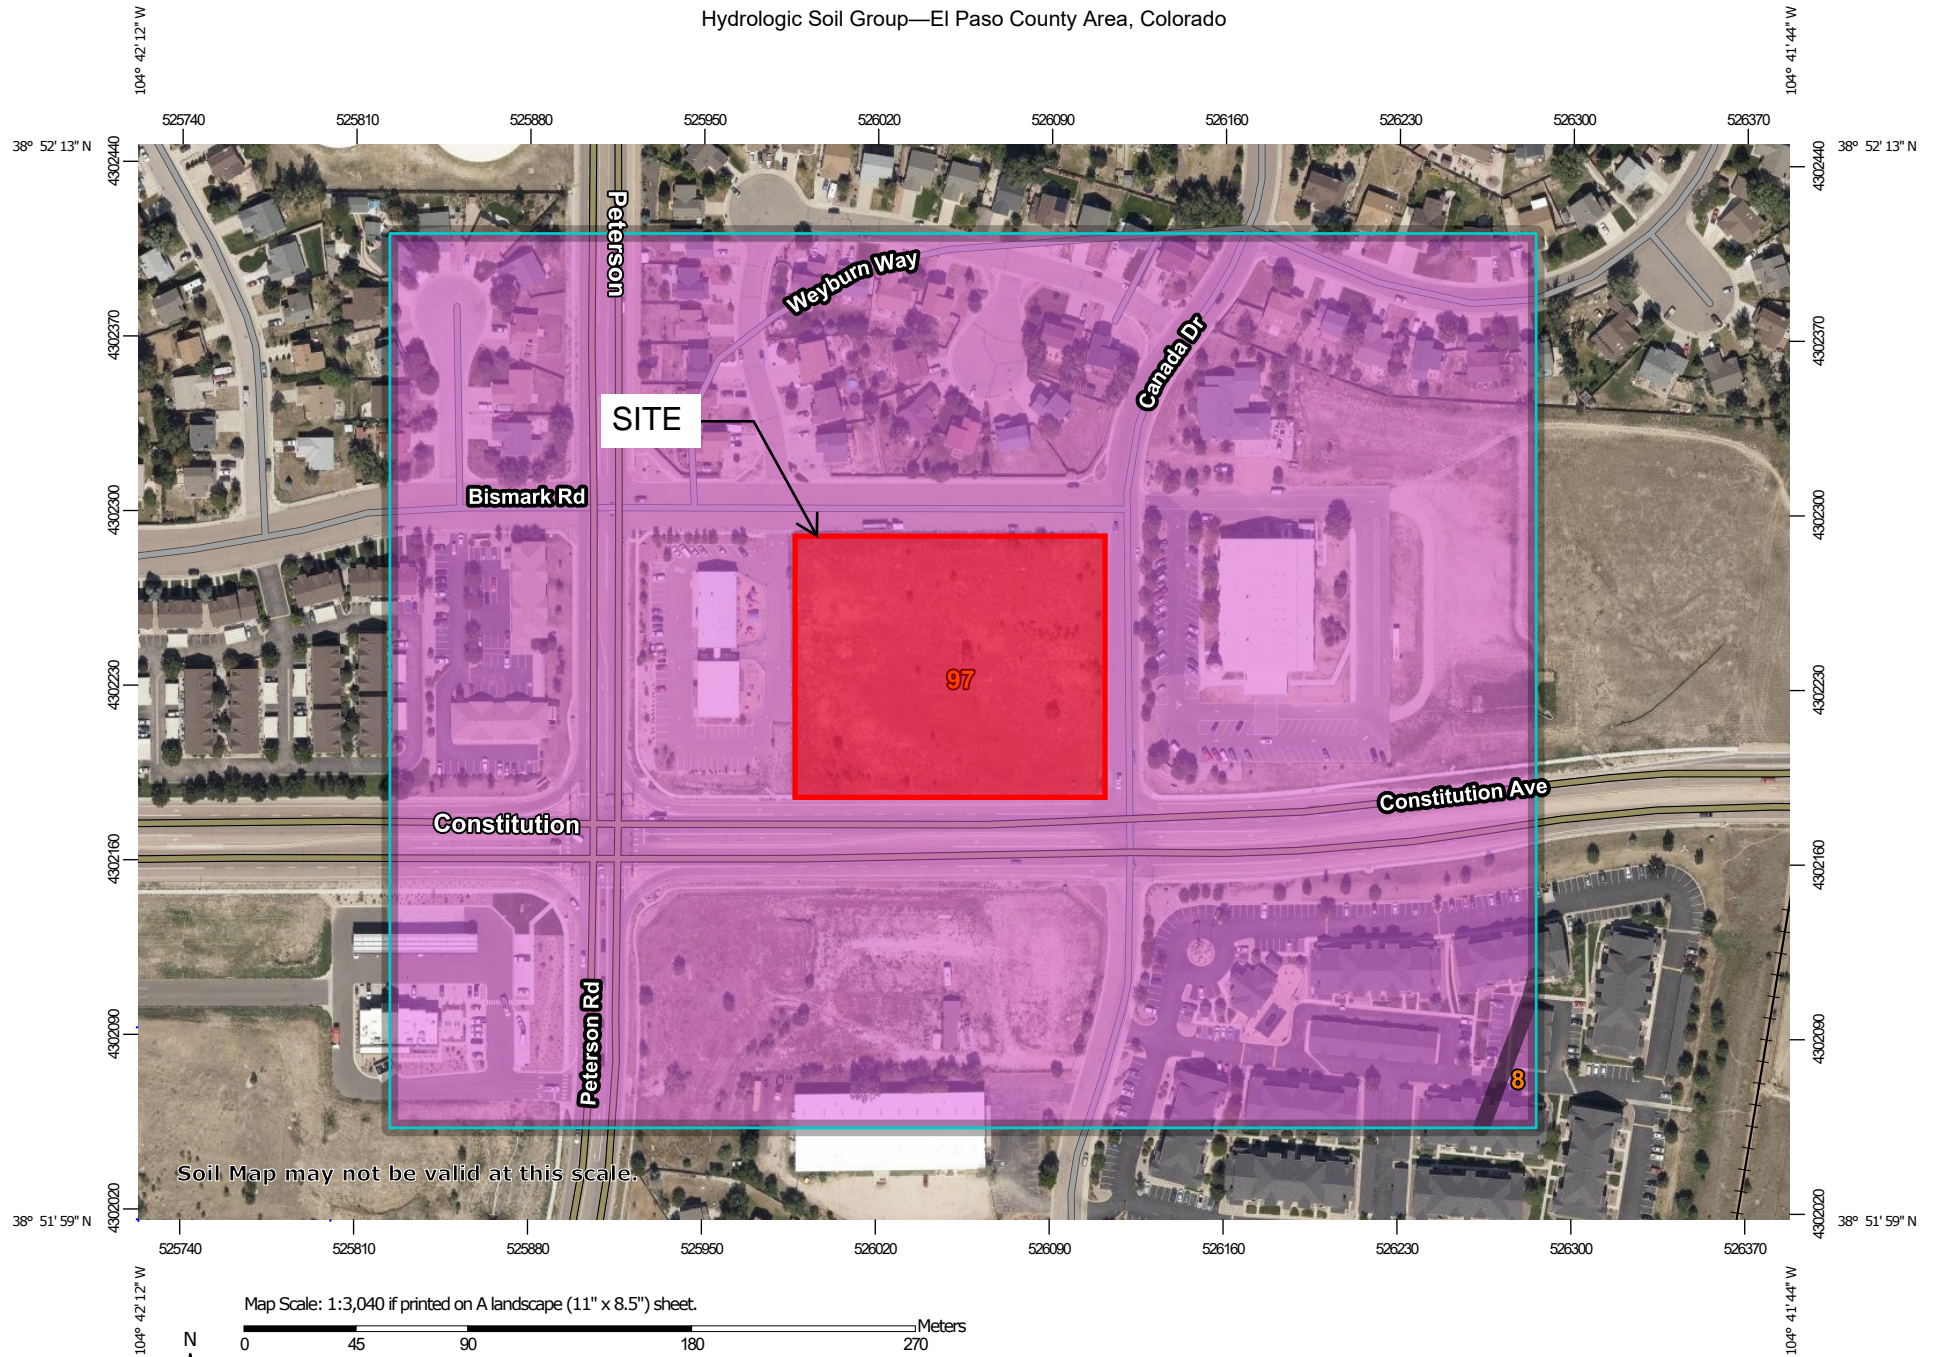

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

Soil Rating Polygons

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Lines

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Points

 A
 A/D
 B
 B/D

 C
 C/D
 D
 Not rated or not available

Water Features

 Streams and Canals

Transportation

 Rails
 Interstate Highways
 US Routes
 Major Roads
 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 19, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
8	Blakeland loamy sand, 1 to 9 percent slopes	A	0.2	0.4%
97	Truckton sandy loam, 3 to 9 percent slopes	A	40.9	99.6%
Totals for Area of Interest			41.1	100.0%

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher