#### GENERAL NOTES

WORK SHALL BE DONE IN ACCORDANCE WITH THE COLORADO DEPARTMENT OF TRANSPORTATION 2019 STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.

STRUCTURE EXCAVATION SHALL BE AS SHOWN ON M-206-2. STRUCTURE BACKFILL SHALL BE AS SHOWN ON THE

EXPANSION JOINT MATERIAL SHALL MEET AASHTO SPECIFICATION M213.

ALL EXPOSED CONCRETE SURFACES SHALL RECEIVE A CLASS I FINAL FINISH TO ONE FOOT BELOW THE GROUND

THE FOLLOWING STRUCTURAL STEEL SHALL BE AASHTO M270 GRADE 36 (ASTM A-36); EXPANSION DEVICES, REMOVABLE COVER PLATES, PIPE RAILING BASE PLATES.

THE FOLLOWING STRUCTURAL STEEL SHALL BE AASHTO M270 GRADE 50 (ASTM A-572): PILING.

ALL STRUCTURAL CONCRETE SHALL CONFORM TO CEMENTITIOUS MATERIALS REQUIREMENTS CORRESPONDING TO SULFATE EXPOSURE CLASS O.

FIELD WELDING OF ANY KIND SHALL NOT BE PERMITTED ON THE STEEL GIRDERS UNLESS SPECIFICALLY CALLED FOR IN THE PLANS.

GRADE 60 REINFORCING STEEL IS REQUIRED

ALL REINFORGING STEEL SHALL BE EPOXY COATED UNLESS OTHERWISE NOTED

(N) DENOTES NON COATED REINFORCING STEEL

ALL THE PROVISIONS FOR BRIDGE DECK CONCRETE SHALL ALSO APPLY TO APPROACH SLAB CONCRETE

CLEARANCE FROM THE SURFACE OF CONCRETE TO THE FACE OF REINFORCEMENT SHALL BE 2 INCHES UNLESS NOTED

SPLICE LOCATIONS ARE BASED ON AN ASSUMED 60' STOCK LENGTH, SPLICES SHALL BE ALTERNATELY STAGGERED UNLESS NOTED OTHERWISE.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE STABILITY OF THE STRUCTURE DURING CONSTRUCTION

STATIONS, ELEVATIONS, AND DIMENSIONS CONTAINED IN THESE PLANS ARE BASED ON THE "FOREST LAKES FILING NO. 6 PUBLIC STREET IMPROVEMENT PLAN" BY CLASSIC CONSULTING. THE CONTRACTOR SHALL VERIFY ALL DEPENDENT DIMENSIONS IN THE FIELD PRIOR TO ORDERING OR FABRICATING ANY MATERIAL.

THE ENGINEER SHALL BE NOTIFIED IN WRITING OF ANY DISCREPANCIES BETWEEN THE PLANS AND ACTUAL FIELD

ALL LONGITUDINAL AND TRANSVERSE DIMENSIONS ARE MEASURED HORIZONTALLY AND INCLUDE NO CORRECTION

THE INFORMATION SHOWN IN THESE PLANS CONCERNING THE TYPE AND LOCATION OF UNDERGROUND UTILITIES IS NOT GUARANTEED TO BE ACCURATE OR ALL INCLUSIVE. THE CONTRACTOR IS RESPONSIBLE FOR MAKING HIS OWN DETERMINATION AS TO THE TYPE AND LOCATION OF UNDERGROUND UTILITIES AS MAY BE NECESSARY TO AVOID DAMAGE THERETO, THE CONTRACTOR SHALL CONTACT THE UTILITY NOTIFICATION CENTER OF COLORADO AT 811 (I-800-922-1981) AT LEAST 3 DAYS (2 DAYS NOT INCLUDING THE DAY OF NOTIFICATION) PRIOR TO ANY EXCAVATION OR OTHER FARTHWORK

THE SUPERSTRUCTURE DESIGN WAS PERFORMED BY CONTECH ENGINEERED SOLUTIONS LLC. THE INFORMATION PERTAINING TO THE SUPERSTRUCTURE IS CONTAINED IN CONTRACT DRAWINGS DATED 12/15/2020 (JOB NO. 621715).

THE SOILS AND FOUNDATION INVESTIGATION FOR THIS PROJECT WAS PERFORMED BY ENTECH ENGINEERING, INC. THE SUBSURFACE CONDITIONS AND RECOMMENDATIONS FOR THE STRUCTURE PROJECT ARE CONTAINED IN A REPORT DATED 09/04/2020 (JOB NO. 200150).

THE END 6' OF THE GIRDER AT EACH ABUTMENT AND PIER SHALL BE PAINTED, EQUIVALENT TO FEDERAL STANDARD 595B COLOR NO. 30045 (WEATHERED STEEL COLOR).

<u>DESIGN ENGINEER'S STATEMENT:</u>
THESE DETAILED PLANS AND SPECIFICATIONS WERE PREPARED UNDER MY DIRECTION AND SUPERVISION. SAID PLANS AND SPECIFICATIONS HAVE BEEN PREPARED ACCORDING TO THE CRITERIA ESTABLISHED BY THE COUNTY FOR BRIDGE PLANS AND SPECIFICATIONS, SAID PLANS AND SPECIFICATIONS MEET THE PURPOSES FOR WHICH THE PARTICULAR BRIDGES ARE DESIGNED FOR AND ARE CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF. I ACCEPT RESPONSIBILITY FOR ANY LIABILITY DIRECTLY CAUSED BY THE NEGLIGENT ACTS. FRRORS, OR OMISSIONS ON MY PART IN PREPARATION OF THESE DETAILED PLANS AND SPECIFICATIONS

HEATHER REED, P.E. #49431 STEAMBOAT STRUCTURES LLC

Airithe Ros


49431

07-12-22

07/12/2022

AS-BUILT/

# CONSTRUCTED REVISIONS





DESIGN DATA

AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, EIGHTH EDITION WITH CURRENT INTERIMS. DESIGN METHOD: LOAD AND RESISTANCE FACTOR DESIGN (LRFD).

HL-93 (DESIGN TRUCK OR TANDEM, AND DESIGN LANE LOAD) DEAD LOAD: ASSUMES 36 LBS. PER SQ. FT. FOR BRIDGE DECK OVERLAY EARTH LOAD: Y = 135 PCF

STRUCTURAL BACKFILL CLASS I:

AT-REST WINGWALL: EFW = 57 pcf EFW = 45 pcf ACTIVE ABUTMENT:

REINFORCED CONCRETE:

CLASS D CONCRETE: f'c = 4,500 psi REINFORCING STEEL: fy = 60,000 psi

CAISSON CONCRETE.

CLASS BZ CONCRETE: f'c = 4,000 pslREINFORCING STEEL: fs = 60,000 psi

STRUCTURAL STEEL, AASHTO M270 (ASTM A-572): fy = 50,000 psi GRADE 50

### SEISMIC DESIGN CRITERIA

SEISMIC ZONE = I

NO SEISMIC DESIGN IS REQUIRED

PEAK GROUND ACCELERATION PGA = 0.058 q

SHORT-PERIOD SPECTRAL ACCELERATION Ss = 0.185 q (PER GEOTECH REPORT) SI =0.059 q (PER GEOTECH REPORT) LONG-PERIOD SPECTRAL ACCELERATION

SITE CLASS D SITE FACTOR

Fpga = 1.6 SITE FACTOR Fa = 1.6 SITE FACTOR FV = 2.4

PEAK DESIGN SPECTRAL ACCELERATION As = 0.0928 qSHORT-PERIOD DESIGN SPECTRAL ACCELERATION Sds = 0.296 a LONG-PERIOD DESIGN SPECTRAL ACCELERATION Sdl = 0.142 a

To = 0.096 sec Ts = 0.478 sec

### BRIDGE DESCRIPTION

2 SPAN (99'-76" 99'-76") TWIN BRIDGES PREFABRICATED CONTECH BRIDGES WITH STEEL WIDE FLANGE GIRDERS MESA TOP DRIVE SOUTH OVER NORTH BEAVER CREEK 24'-0" ROADWAY CURB TO CURB 45°00'00" SKEW 5'-6" SIDEWALK, THRIE BEAM RAIL WITH SAFETY RAIL ABOVE SIDEWALK

### HYDRAULIC DATA


6" CURB, THRIE BEAM

100YR WSE = 7058,46 AT NORTH BRIDGE HCL 100YR SCOUR AT PIER = 7046.76 NO LOOYR SCOUR AT ABUTMENTS 100YR VELOCITY = 5.67 FT/S

### INDEX OF SHEETS:

GENERAL INFORMATION SUMMARY OF QUANTITIES B<sub>0</sub>2 GENERAL LAYOUT B03 B04 TYPICAL SECTION ENGINEERING GEOLOGY B<sub>0</sub>5 BRIDGE HYDRAULIC INFORMATION B06 CONSTRUCTION LAYOUT B07 BOS FOUNDATION LAYOUT CAISSON DETAILS B09 BIO ABUTMENT I PLAN AND ELEVATION ABUTMENT 3 PLAN AND ELEVATION BI2 ABUTMENT DETAILS BI4 PIER 2 PLAN AND ELEVATION BI5 PIER DETAILS BI6 BRIDGE EXPANSION DEVICE (I OF 2) BI7 BRIDGE EXPANSION DEVICE (2 OF 2) BI8 PIPE RAILING B19 APPROACH SLAB B20 BACKFILL DETAILS (I OF 2)

BACKFILL DETAILS (2 OF 2)

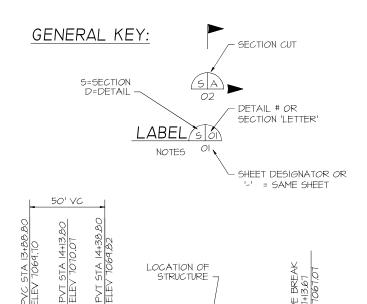

PROFILE GRADE

-1.00%

<u>EL PASO COUNTY:</u> COUNTY PLAN REVIEW IS PROVIDED ONLY FOR GENERAL CONFORMANCE WITH COUNTY DESIGN CRITERIA. THE COUNTY IS NOT RESPONSIBLE FOR THE ACCURACY AND ADEQUACY OF THE DESIGN, DIMENSIONS, AND/OR ELEVATIONS WHICH SHALL BE CONFIRMED AT THE JOB SITE. THE COUNTY THROUGH THE APPROVAL OF THIS DOCUMENT ASSUMES NO RESPONSIBILITY FOR COMPLETENESS AND/OR ACCURACY OF THIS DOCUMENT.

FILED IN ACCORDANCE WITH THE REQUIREMENTS OF THE EL PASO COUNTY LAND DEVELOPMENT CODE, DRAINAGE CRITERIA MANUAL VOLUMES 1 AND 2 AND ENGINEERING CRITERIA MANUAL AS AMENDED.

IN ACCORDANCE WITH THE ECM SECTION 1.12, THESE CONSTRUCTION DOCUMENTS WILL BE VALID FOR CONSTRUCTION FOR A PERIOD OF 2 YEARS FROM THE DATE SIGNED BY THE EL PASO COUNTY ENGINEER. IF CONSTRUCTION HAS NOT STARTED WITHIN THOSE 2 YEARS, THE PLANS WILL NEED TO BE RESUBMITTED FOR APPROVAL, INCLUDING PAYMENT OF REVIEW FEES AT THE PLANNING AND COMMUNITY DEVELOPMENT DIRECTOR'S DISCRETION.

JENNIFER IRVINE, P.E. COUNTY ENGINEER/ECM ADMINISTRATOR

STRUCTURES SERVIN

DATE

HMR

AJN

HMR

7/12/22

FOR BURIED UTILITY INFORMATION tREE (3)BUSINESS DA BEFÓRE YOU DIG CALL 811 (or 1-800-922-1987) UTILITY NOTIFICATION



-1.50%

CENTER OF COLORADO (UNCC) www.uncc.org

PROJECT TITLE

FOREST LAKES BRIDGES

**GENERAL INFORMATION** 


MONUMENT, CO RUCT/JOB:

B01

# SUMMARY OF QUANTITIES (TWO BRIDGES, EASTBOUND AND WESTBOUND BRIDGES)

	ITEM NO.	DESCRIPTION	UNIT	SUPERSTRUCTURE	ABUTMENT 1	PIER 2	ABUTMENT 3	TOTAL	
	206	STRUCTURE EXCAVATION	CY	-	545	45	65	655	
	206	STRUCTURE BACKFILL (CLASS 1)	CY	-	1,595	25	1,275	2,895	
	206	MECHANICAL REINFORCEMENT OF SOIL	CY	-	1,595	-	1,275	2,870	
	502	STEEL PILING (HP 12x53)	LF	-	827	-	958	1,785	
$\sim$	503	DRILLED CAISSON (42 INCH)	MF.		~~~~	182	~~~~~	182	
$\left\{ \left\langle \cdot \right\rangle \right\}$	506	RIPRAP	CY	-	1317	-	982	2,299	3
L.	<u> </u>	PIPE RAILING	U LF	108				108	
	518	BRIDGE COMPRESSION SEAL	LF	85	-	-	-	85	
	518	BRIDGE EXPANSION DEVICE (0-4 INCH)	LF	170	-	-	-	170	
2	601~	CONCRETE CLASS D (BBIDGE)	~~6Y~~	503~~~	~~210~~~	~~68~~~	182~~	963~~	· .
3	602	REINFORCING STEEL (EPOXY)	LB	77,965	23,725	16,885	20,815	139,390	$\left\langle \right\rangle /_{2}$
$\sim$	628	BRIDGE GIRDER AND DECK UNIT (BY OTHERS)	ÊÁCĤ	1	<u>-</u>	-	<u>-</u>	1	J —

. RIPRAP QUANTITY PROVIDED FOR INFORMATION ONLY, REFER TO CIVIL PLANS AND BRIDGE HYDRAULIC INFORMATION SHEET FOR RIPRAP LIMITS, QUANTITY ASSUMES 4' DEEP RIPRAP,



3. INCLUDES 59,465 LB OF REINFORCING STEEL WITHIN THE DECK, CURB AND SIDEWALK WHICH IS TO BE INCLUDED IN THE CONTECH PLANS. THE VALUE IS INCLUDED FOR OVERALL QUANTITY CALCULATIONS INFORMATION ONLY.



# AS-BUILT/ CONSTRUCTED




ı	_	REVISED BEARING PAD DEPTH	05-19-21	***
ı	2	REVISED QUANTITY	<i>0</i> 6-II-2I	**
ı	n	REVISED QUANTITY	07-09-21	**
ı	4			
ı	5			
ı	6			
ı	7			








DESIGNED BY:  HMR  DRAWN BY:	FOREST LAKES BRIDGES	PROJECT LOCATION MONUMENT, CO
AJM PROJECT MANAGER:		STRUCTIJOB:
HMR	SUMMARY OF QUANTITIES	SHEET NO.
7/12/22		B02


THE SENDING PARE OFF MEDICAL EXTENSION PROPERTY OF THE CONCENTED THE PROPERTY OF THE PROPERTY OF THE CONCENTED THE PROPERTY OF THE

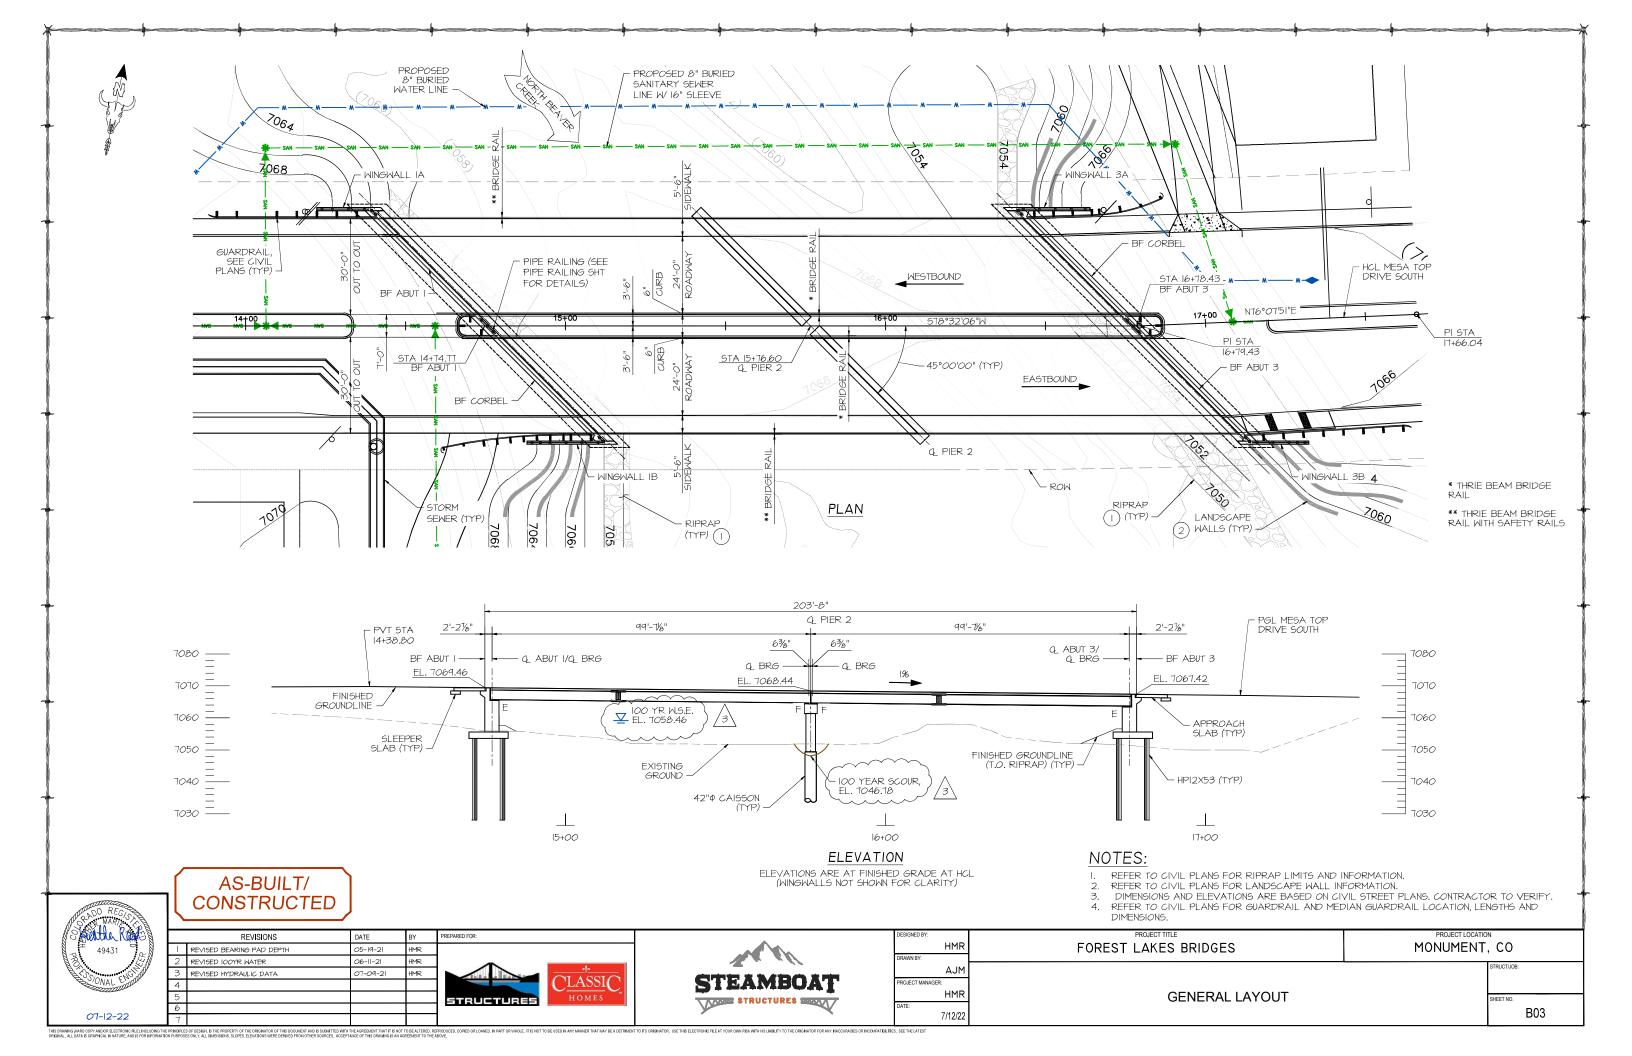


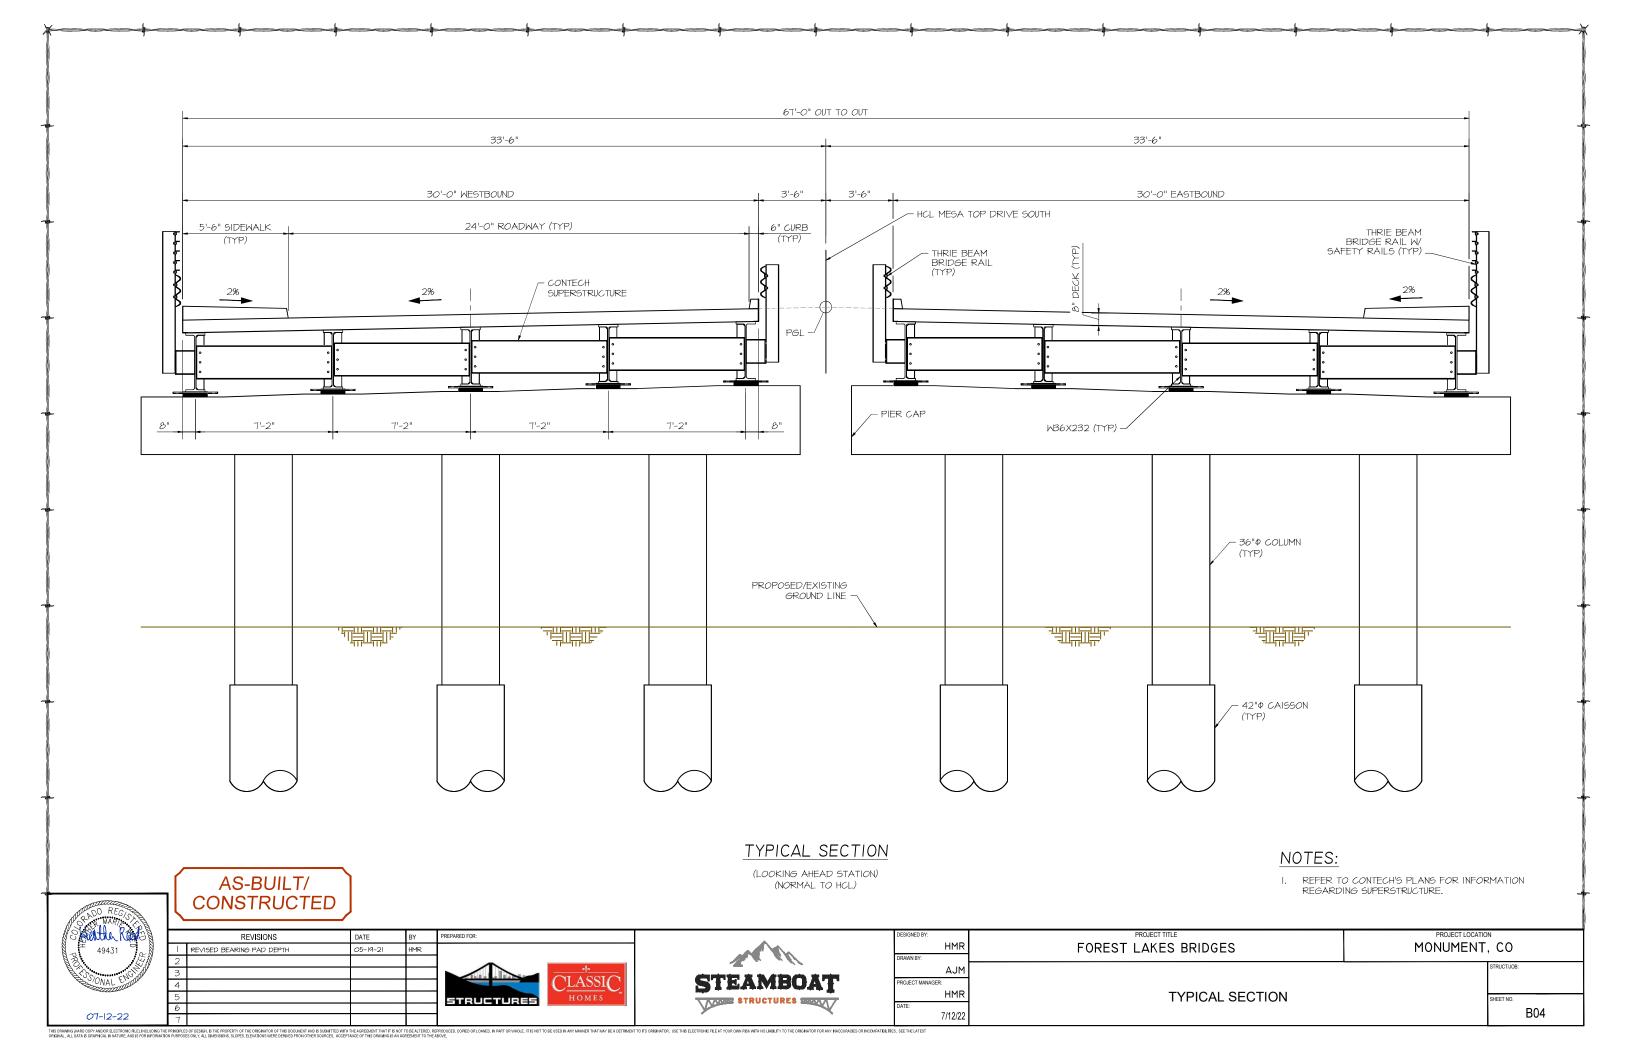


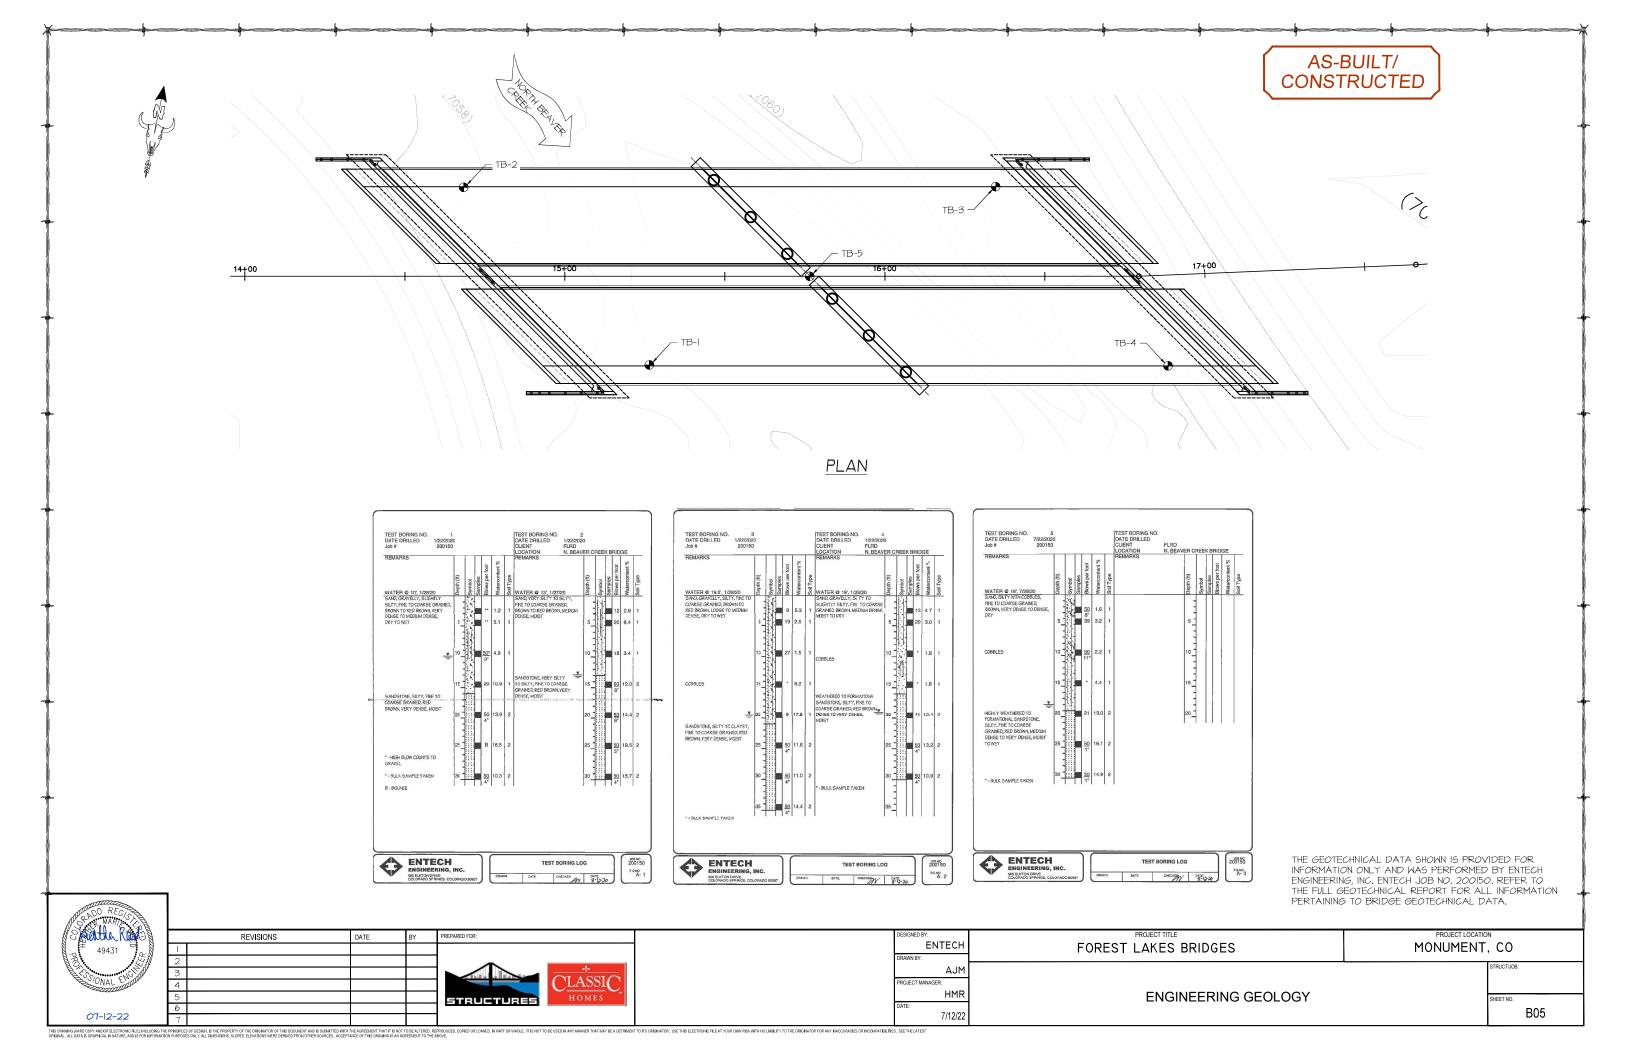

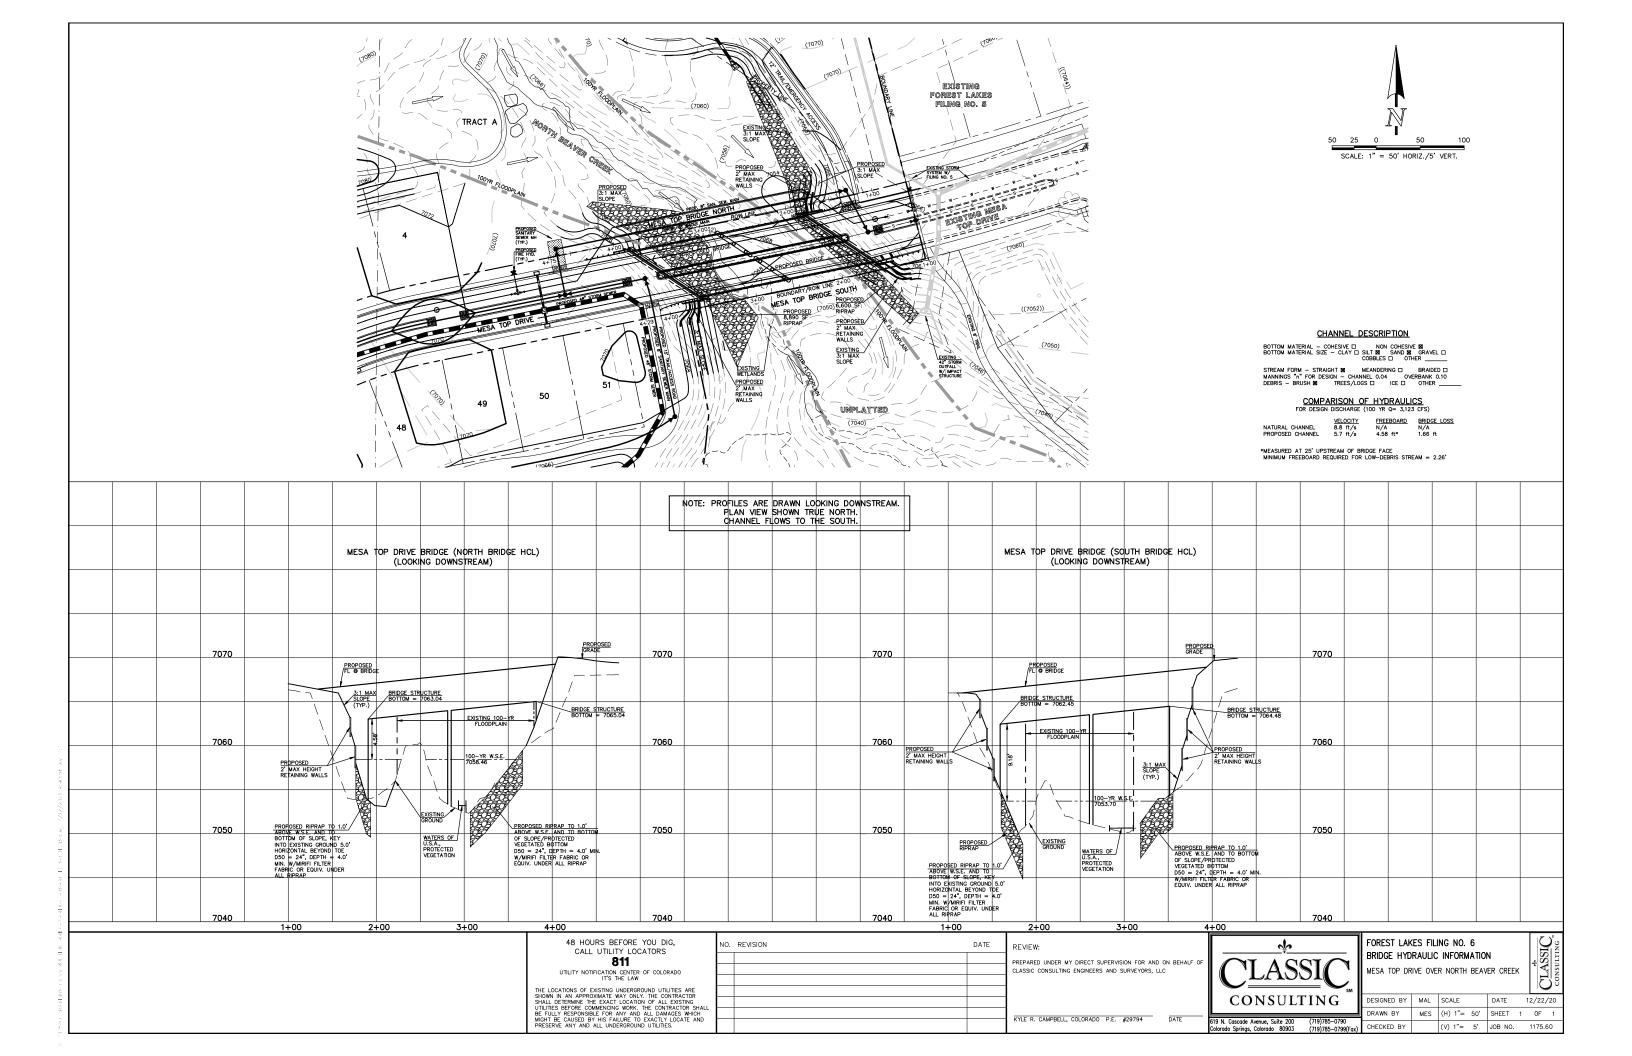

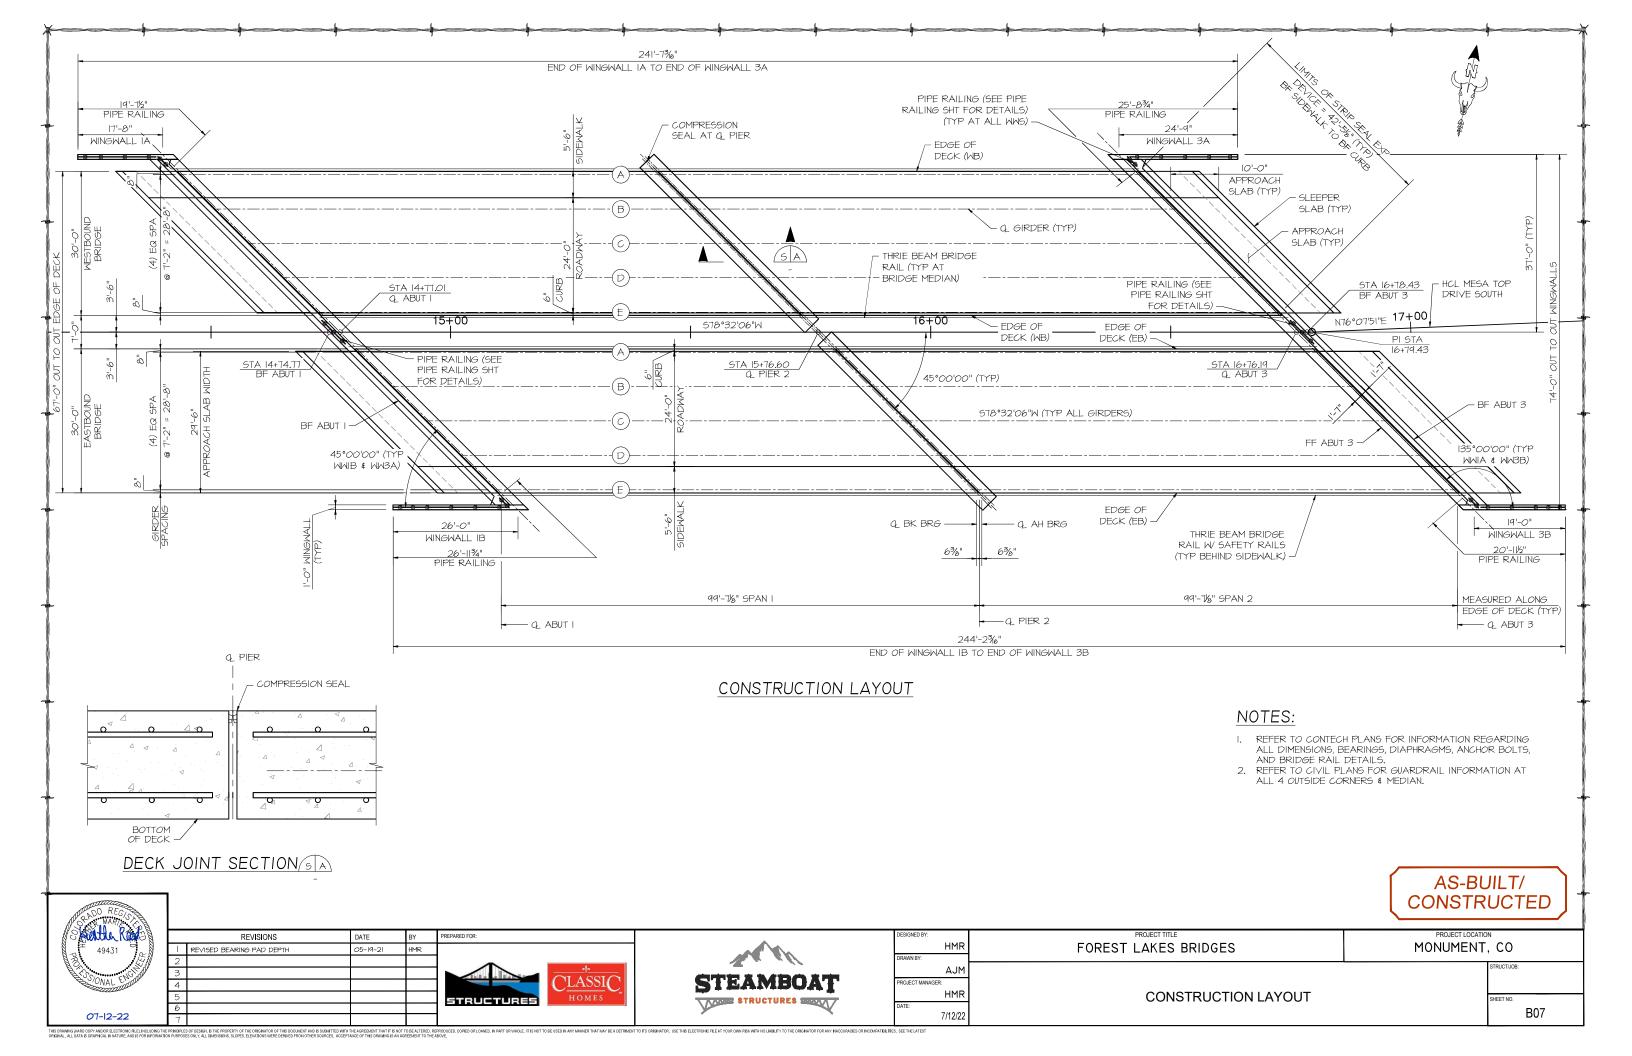

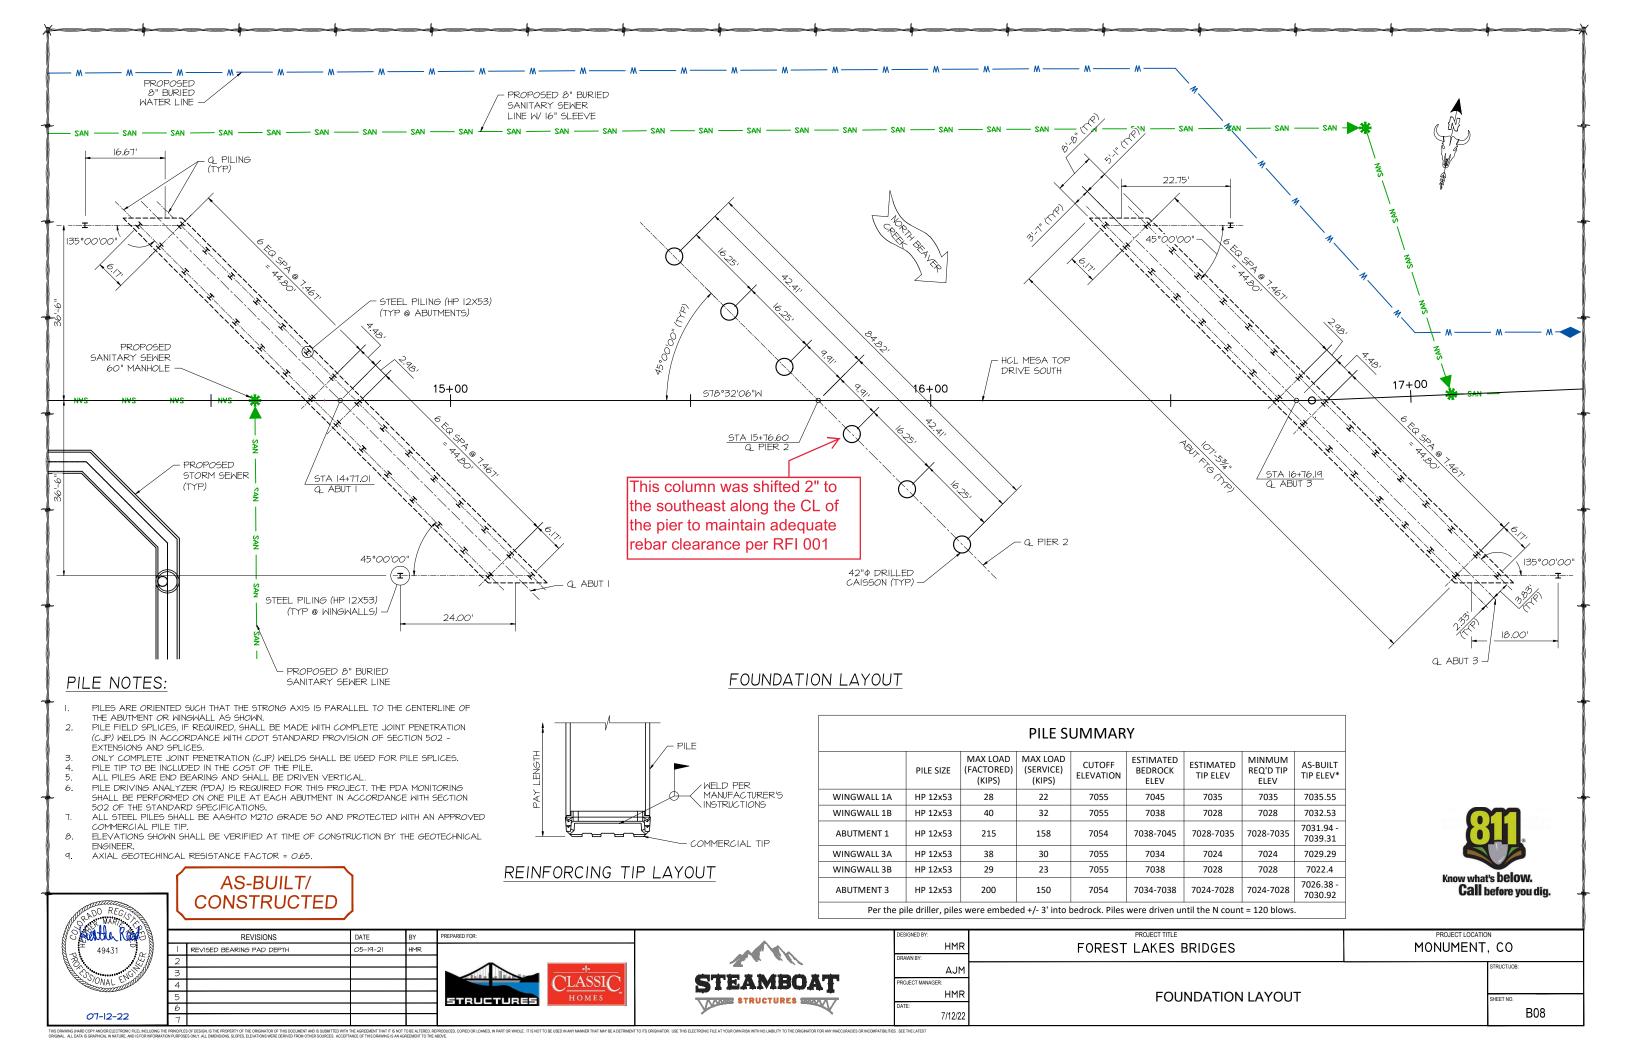

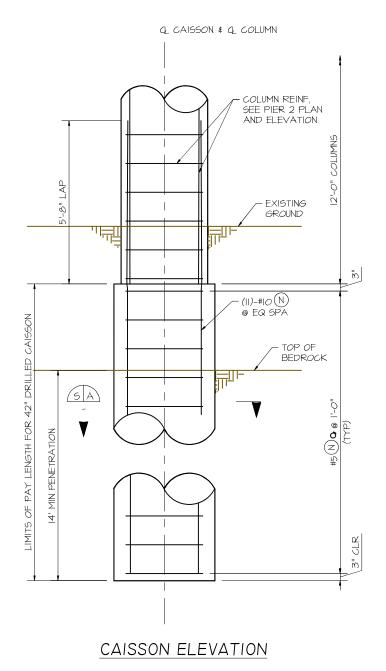


### CAISSON NOTES:


- I. MINIMUM EMBEDMENT TO BE PROVIDED. BEDROCK ELEVATIONS MAY VARY.
- 2. 2" DIA CSL TUBES SHALL BE SCHEDULE 40 STEEL PIPE WITH TIGHT END CAPS, CSL TUBES SHALL BE SECURED TO REINFORCEMENT AND FILLED WITH WATER AND CAPPED PRIOR TO CONCRETE PLACEMENT.
- 3. CSL TESTING SHALL BE PERFORMED ON 100% OF PIER 2 CAISSONS.
- 4. CONTRACTOR SHALL VERIFY THAT FOUNDATION LOCATIONS DO NOT INTERFERE WITH ANY EXISTING OR PROPOSED
- 5. ALL TIES AND VERTICAL REINFORCEMENT IN CAISSONS ARE NON-EPOXY COATED.
  6. CAISSON REINFORCING SHALL EXTEND TO FULL DEPTH OF DRILLED HOLE.
  7. BRILLED CAISSON CONCRETE IS OXASS BZ.
- 8. MINIMUM LENGTH OF CAISSON SHALL BE 29.91' FOR EB BRIDGE, 30.56' FOR WB BRIDGE.

  4. CONCRETE SHOULD BE PLACED IN THE CAISSON IMPEDIATELY AFTER DRILLING AND MUST BE PLACED THE SAME DAY THE HOLES ARE DRILLED.
- IO. THE MAXIMUM PERMISSIBLE VARIATION OF THE CENTER AXIS OF ANY DRILLED CAISSON AT THE TOP FROM IT'S PLANNED LOCATION SHALL BE 3 INCHES.
- II. REFER TO THE GEOTECHNICAL REPORT FOR GROUND WATER AND POTENTIAL CAVING SOIL CONDITIONS, THE CONTRACTOR SHOULD BE PREPARED TO DE-WATER DRILLED CAISSONS AND TO CONSTRUCT CAISSONS WITH TEMPORARY CASINGS TO CONTROL GROUNDWATER AND MAINTAIN A STABLE OPEN EXCAVATION.
- 12. REFER TO THE GEOTECHNICAL REPORT FOR SHEAR RING INFORMATION AND REQUIREMENTS.
- 13. END BEARING & SIDE RESISTANCE FACTOR = 0.60

DRILLED CAISSON SUMMARY				
WESTBOUND PIER CAIS		EASTBOUND PIER CAISSONS		
MAX FACTORED AXIAL	740	740		
MAX-SERVICE AXIAL	502	502	$\checkmark$	
TOP OF CAISSON	7049.06	7048.41	J	
ESTIMATED BEDROCK ELEV	7032.50	7032.50		
MIN BEDROCK PENETRATION	14.0'	14.0'		
ESTIMATED TIP ELEV	7018.50	7018.50		
SCOUR ELEV	7047.76	7047.76		
AS-BUILT BEDROCK ELEV	7031.7-7032.4	7032.3-7032.8		
AS-BUILT TIP ELEV	7017-7017.5	7018.1-7018.4		

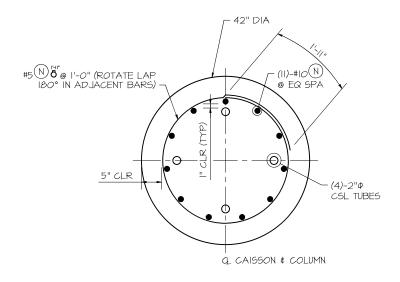

CAISSON SECTION S

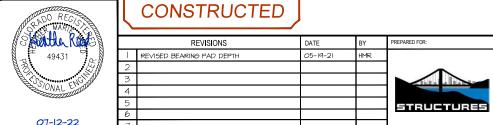

AS-BUILT/



	HMR
DRAWN BY:	
	AJM
PROJECT MANAGE	R:
	HMR
DATE:	7/12/22


PROJECT TITLE FOREST LAKES BRIDGES


MONUMENT, CO


TRUCT/JOB:


CAISSON DETAILS


B09

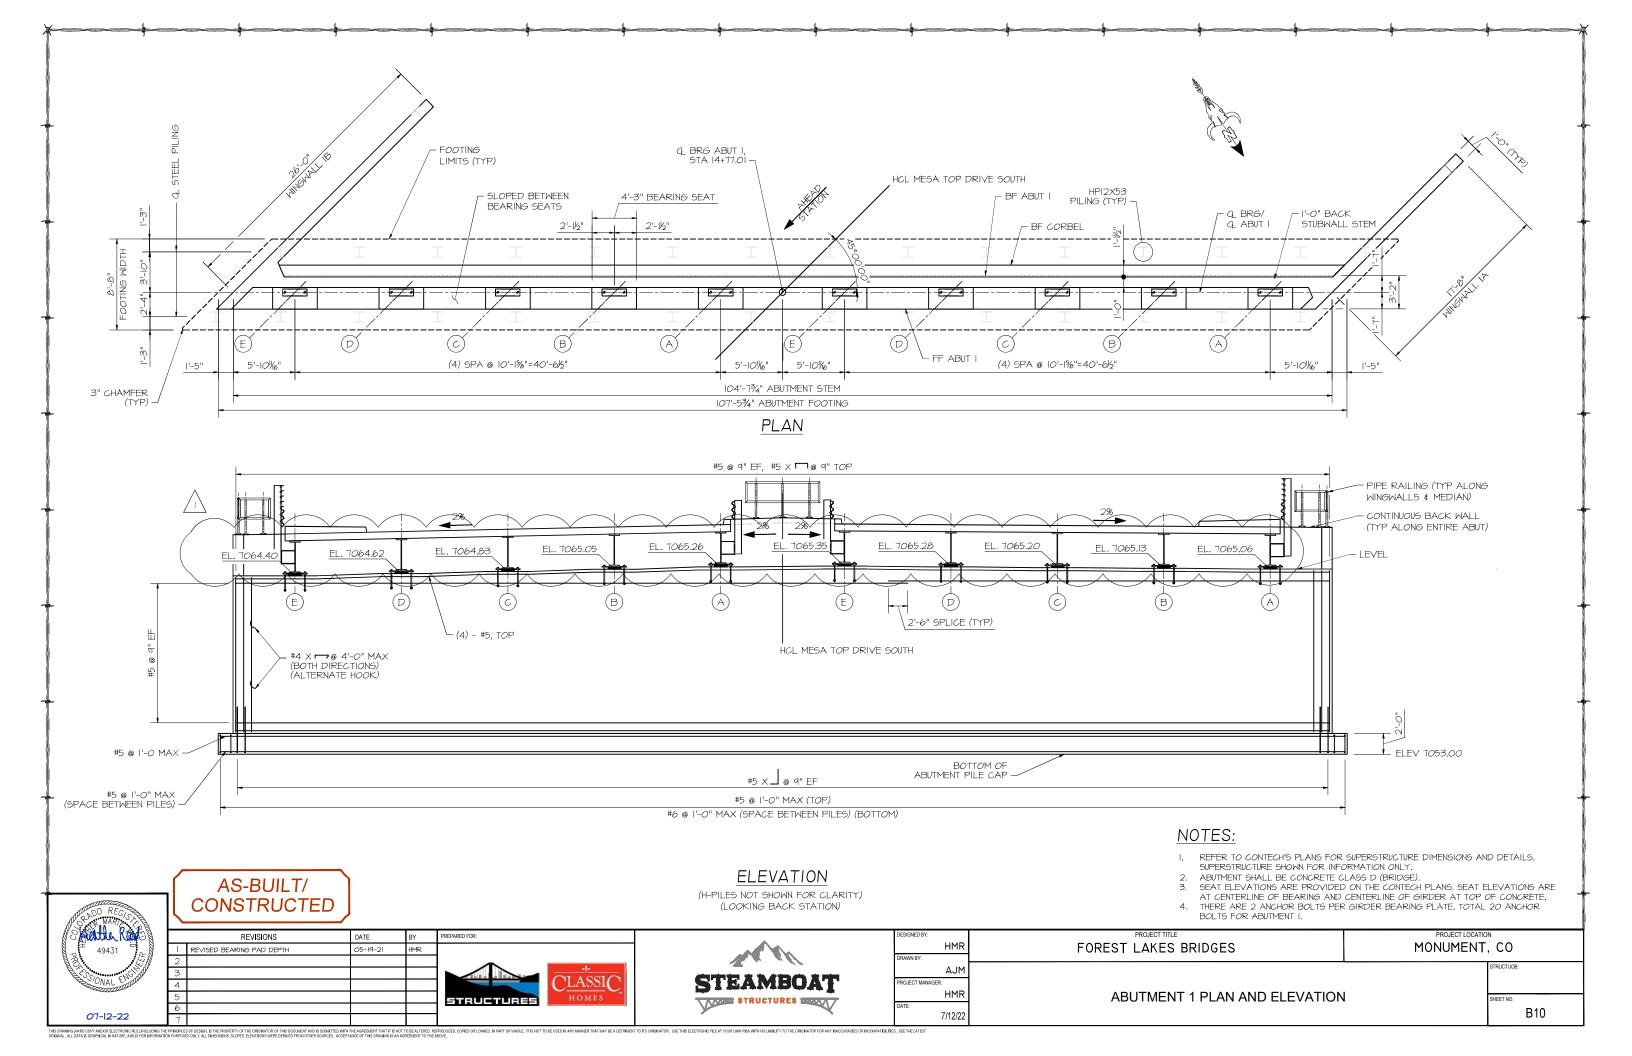


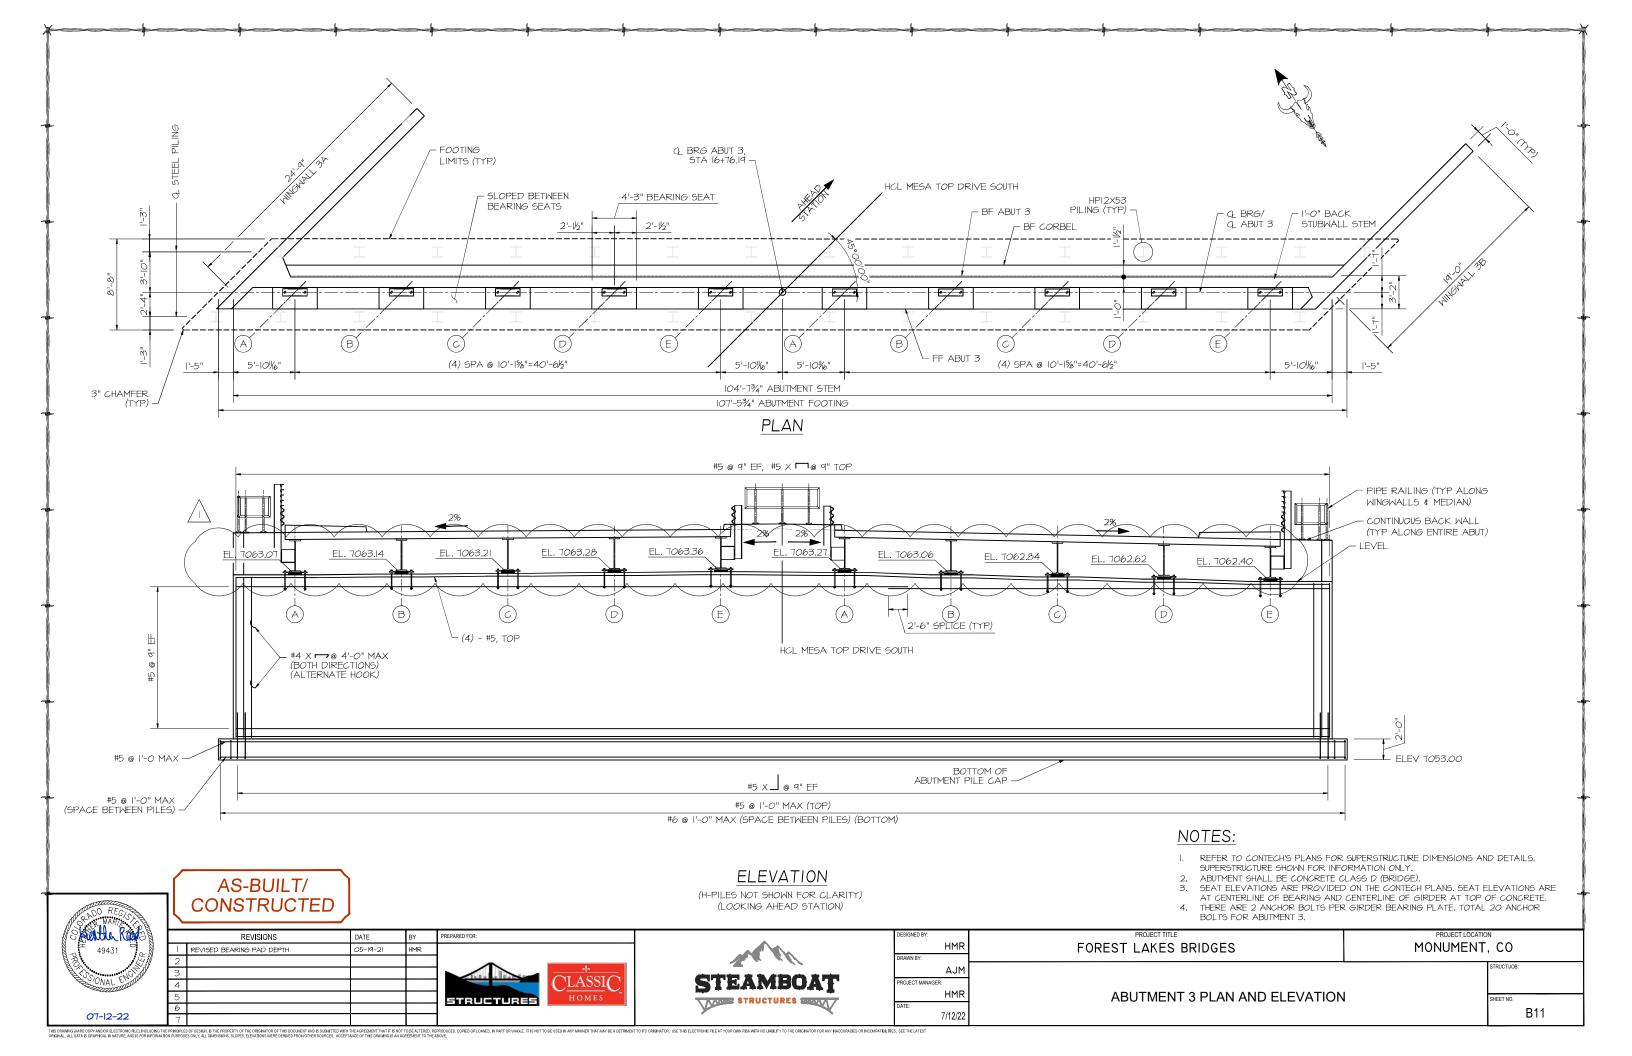

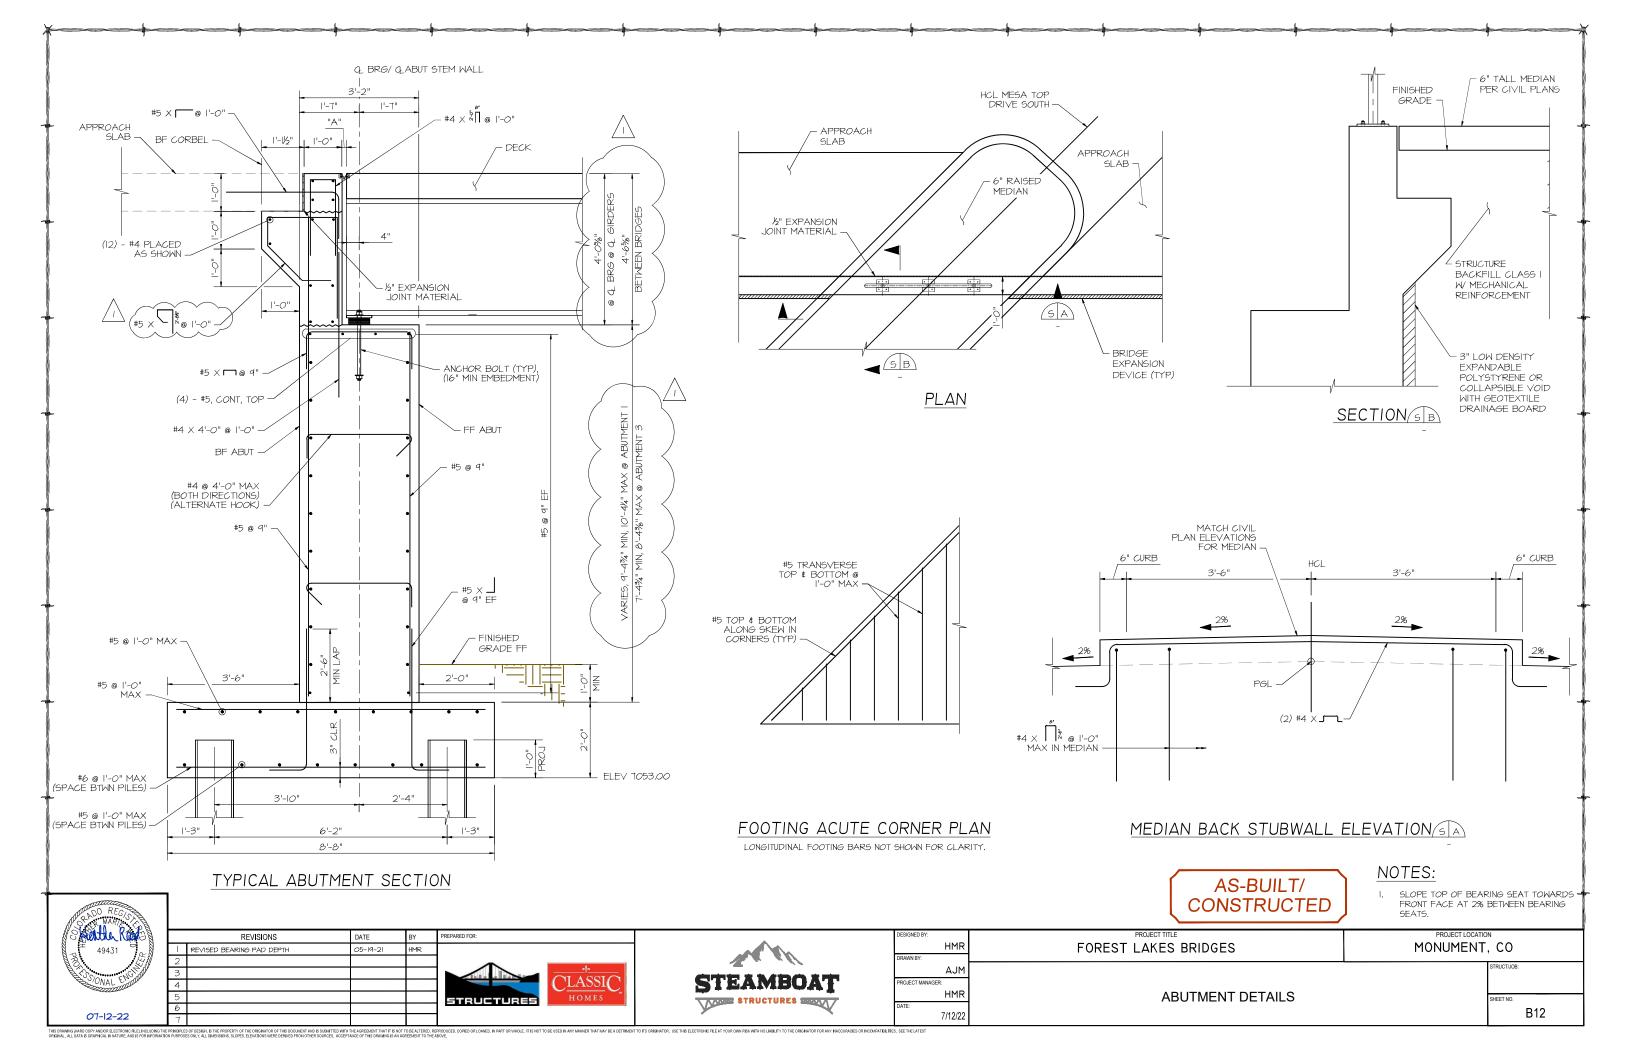

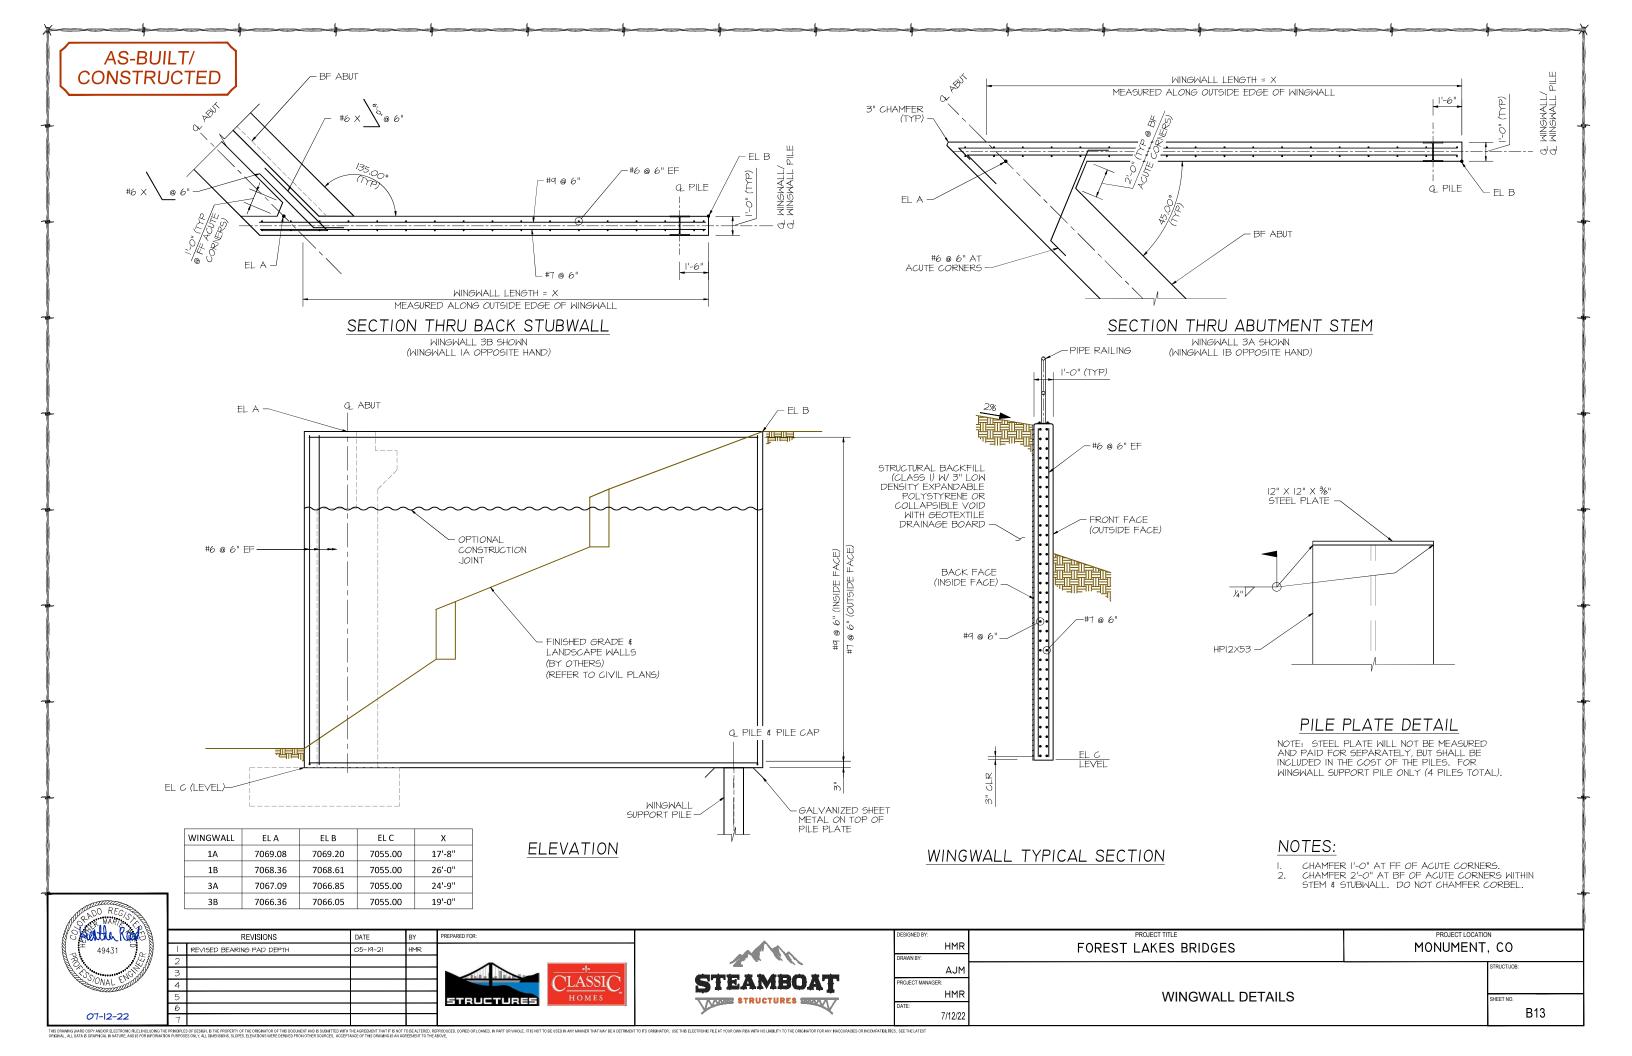

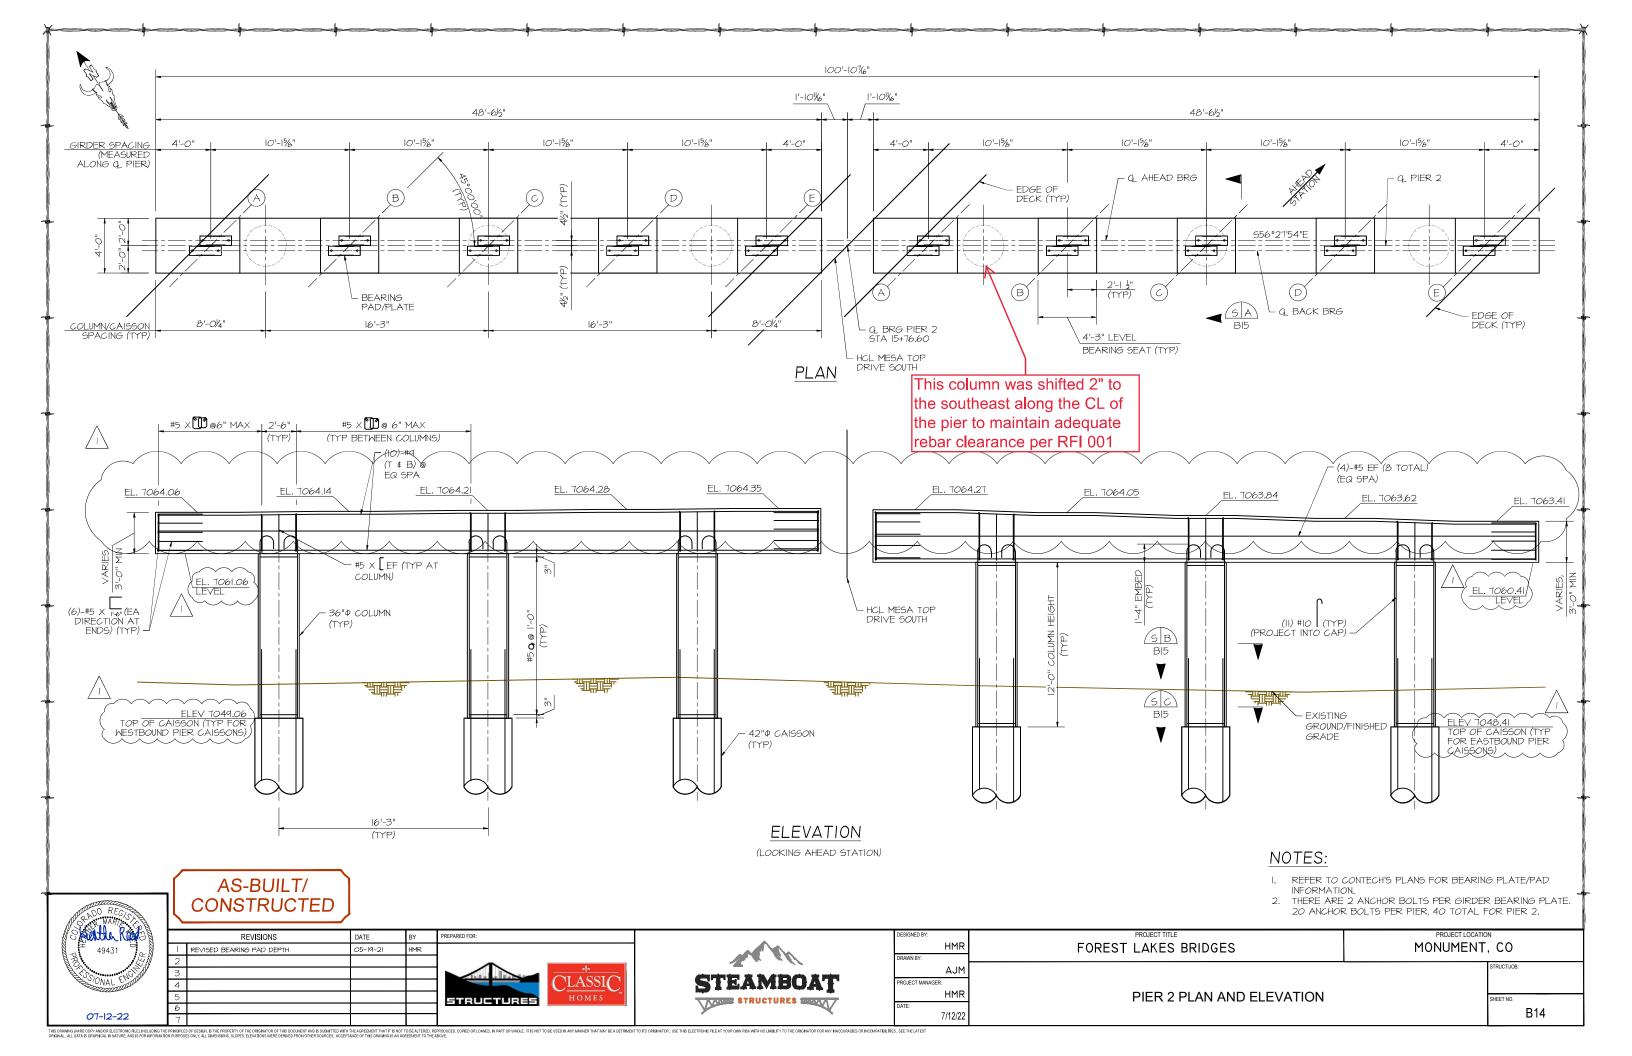

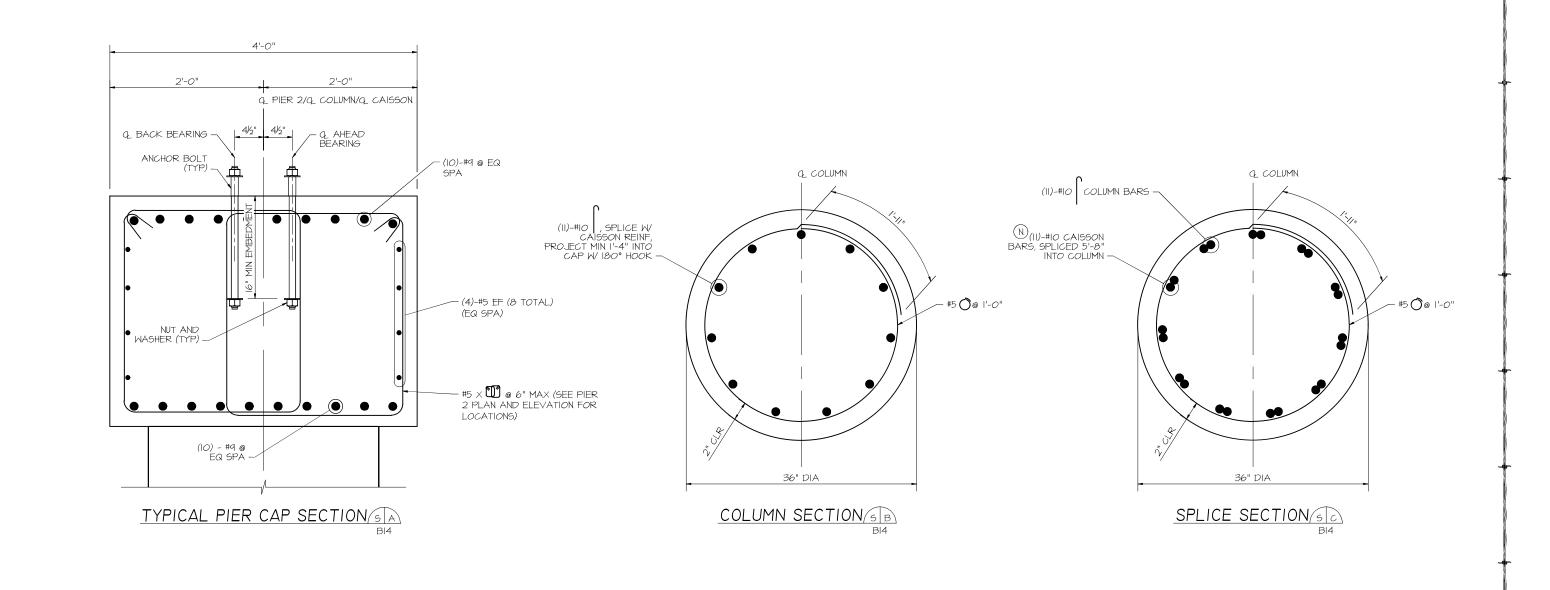

# NOTES:

I. REFER TO CONTECH'S PLANS FOR ANCHOR BOLT LOCATIONS & INFORMATION.



07-12-22

# AS-BUILT/ CONSTRUCTED

REVISIONS DATE		DATE	BY	PREPARED FOR:
	REVISED BEARING PAD DEPTH	05-19-21	HMR	
2				
3				
4				CLASSIC
5				STRUCTURES HOMES
6				
7				

MAN.
STEAMBOAT
STRUCTURES SERVICES

HMR
DRAWN BY:
AJM
PROJECT MANAGER:
HMR
DATE:

DESIGNED BY:

FOREST LAKES BRIDGES


PROJECT LOCATION MONUMENT, CO

STRUCTION:


SHEET NO.

B15

THE SENSION (AND COPY MODIO ESCRIBOTION THE, DICE, DESTRUCTION OF THE DOCUMENT AND IS SENSION THE MODIFMENT OF THE OCCUMENT AND IS SENSION THE MODIFMENT OF THE

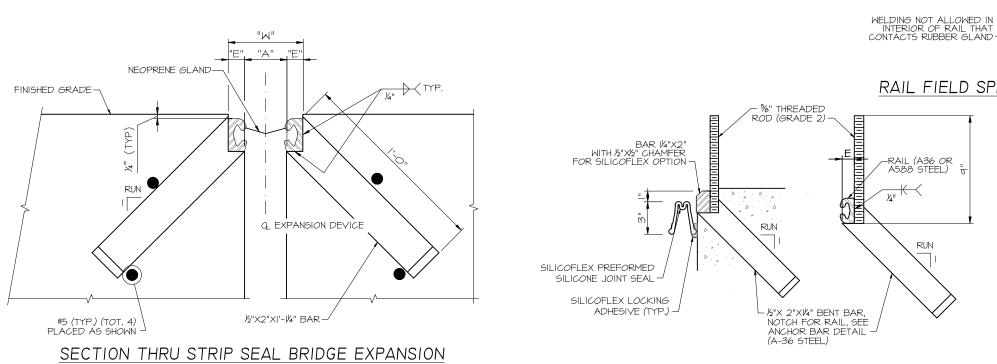

# ANCHORAGE DETAIL

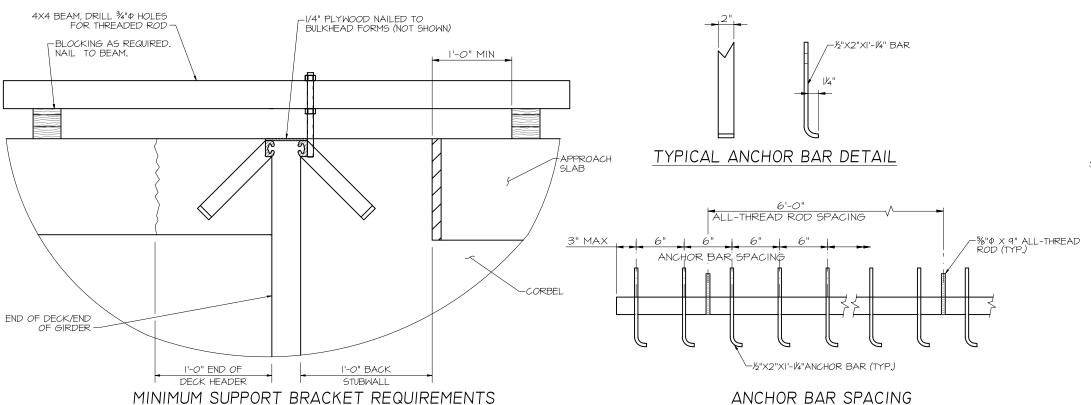

### NOTES:

RAIL FIELD SPLICE DETAIL

-RAIL (A36 OR A588 STEEL)

RUN

THE EXPANSION DEVICE SHALL BE INSTALLED ON GRADE, PARALLEL TO THE SLOPE AND GRADE OF THE DECK.

THE EXPANSION DEVICE SHALL NOT BE SET BEFORE THE DECK ELEVATIONS HAVE BEEN APPROVED BY THE ENGINEER. THE CONTRACTOR SHALL TAKE SHOTS OF THE EXPANSION DEVICE TO ACHIEVE THE REQUIRED ELEVATIONS FOR SMOOTHER RIDEABILITY ON BRIDGE APPROACHES.

AFTER THE CONCRETE HAS ATTAINED INITIAL SET, THE ATTACHMENTS USED TO HOLD THE EXPANSION DEVICE ASSEMBLY IN ITS PROPER POSITION SHALL BE

"W" AND "E" DIMENSIONS ARE DEPENDENT UPON THE PARTICULAR EXPANSION DEVICE SUPPLIED, AND SHALL BE SHOWN ON THE WORKING DRAWINGS.

SEE TABLE FOR DIMENSIONS "A" AND "W"; INTERPOLATE AS NEEDED. DO NOT INSTALL THE GLAND UNTIL DIMENSION "A" HAS OPENED UP TO AT LEAST 1/2" (2/2"

THE NEOPRENE GLAND SHALL BE INSTALLED IN ONE PIECE IN ACCORDANCE WITH SECTION 518 OF THE STANDARD SPECIFICATIONS.

SEE SECTION 518.09 IN THE STANDARD SPECIFICATIONS FOR WATER TIGHT INTEGRITY TESTING REQUIREMENTS.

SET ELEVATIONS AT TOP OF END OF DECK AND BACK STUBWALL WITH THE GRADE PROJECTION SCHEME.

ALL STEEL ELEMENTS (WHETHER GRADE A36 OR A588) OF THE BRIDGE EXPANSION DEVICE, INCLUDING COVER PLATES, SHALL BE HOT DIP GALVANIZED AFTER FABRICATION AS PER SECTION 509.II OF THE STANDARD SPECIFICATIONS.

USE A RUN OF I FOR NEW CONSTRUCTION.

PROVIDE EXPANSION DEVICE SUPPORT AS SHOWN AT 6'-0" INTERVALS.

FOR REINFORCING NOT SHOWN HEREON, SEE ABUTMENT DETAILS AND CONTECH

CUT THREADED ROD FLUSH TO CONCRETE FOR FINISHED JOINT.

CONCRETE SHALL BE PLACED AFTER EXPANSION DEVICE HAS BEEN ADJUSTED TO PROPER GRADE AND APPROVED BY THE ENGINEER.

### ACCEPTABLE EXPANSION DEVICE ALTERNATES

D.S. BROWN A2R400-SSA2WABO SE400 TYPE AEPOXY INDUSTRIES S400-A R. J. WATSON SILICOFLEX SF 400

AIR TEMP (°F)	"A"	"W"*
-30	2.75	5.25
0	2.55	5.05
30	2.35	4.85
60	2.15	4.65
90	1.95	4.45
120	1.75	4.25

\* FOR E = 4" (MIN.)

AS-BUILT/ CONSTRUCTED

Addu Ros 49431

07-12-22

REVISIONS 05-19-21 REVISED BEARING PAD DEPT HMR

SECTION TAKEN PERPENDICULAR TO Q EXP'N DEVICE



HMR	
DRAWN BY:	L
AJM	
PROJECT MANAGER:	
HMR	
DATE: 7/12/22	


PROJECT TITLE FOREST LAKES BRIDGES


MONUMENT, CO


TRUCT/JOB:


BRIDGE EXPANSION DEVICE (1 OF 2)


B16

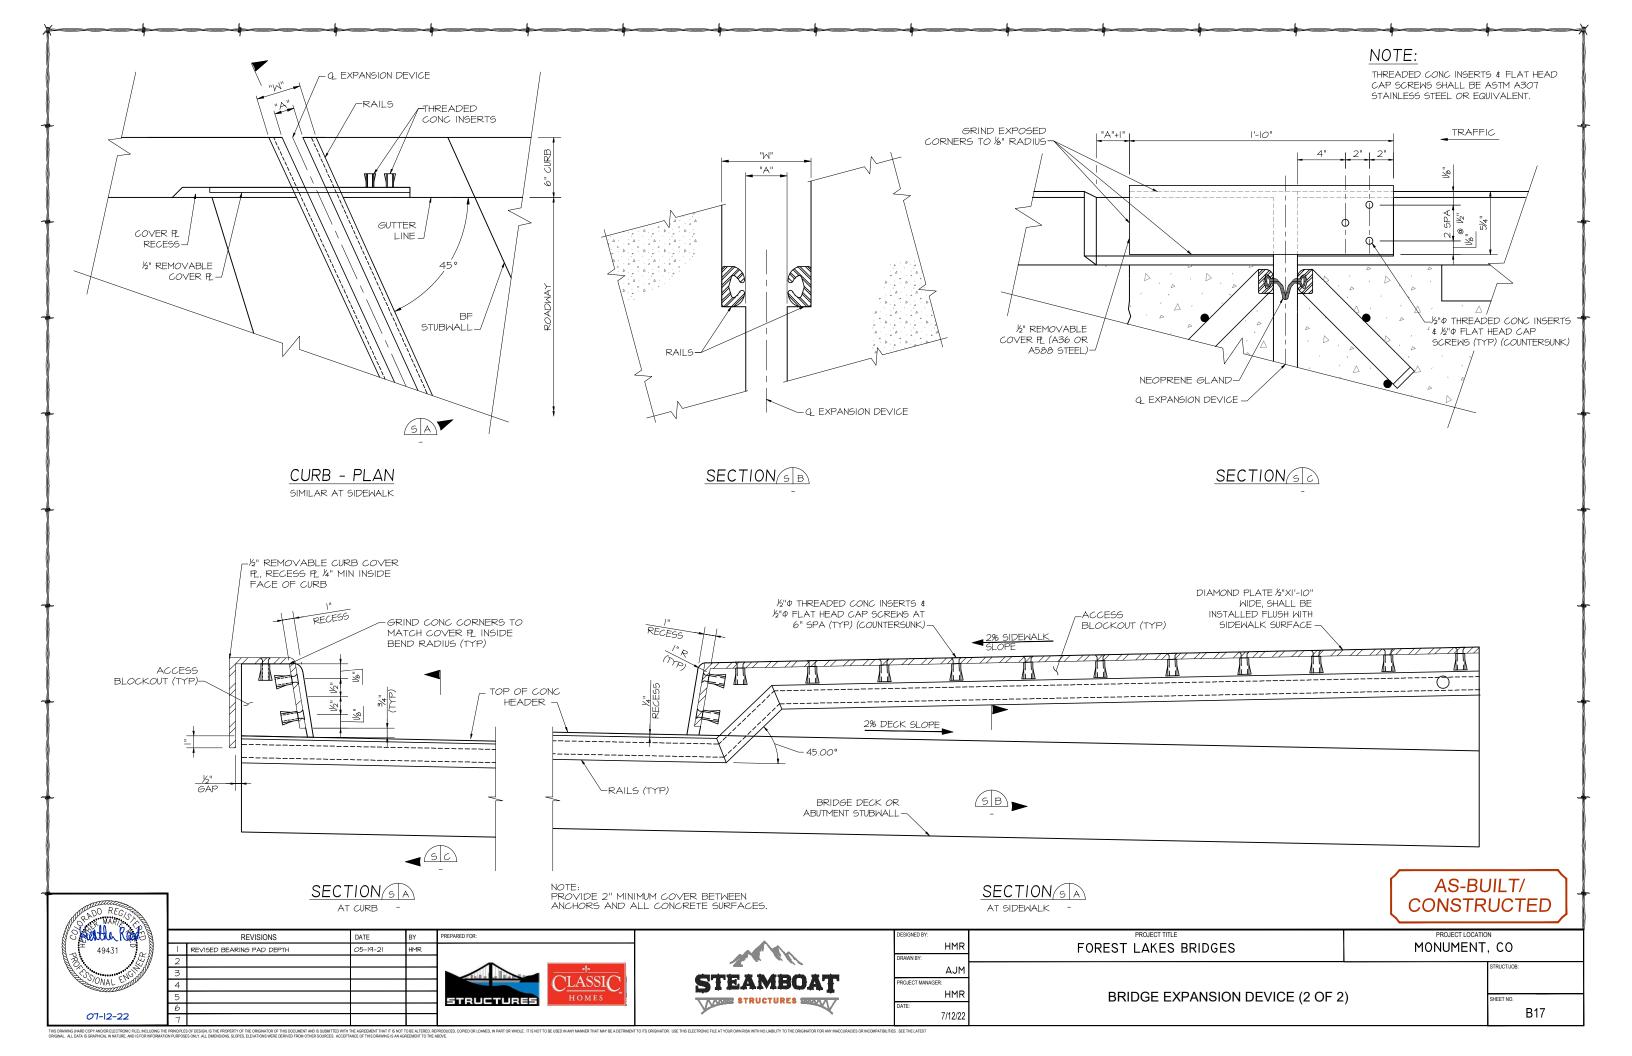

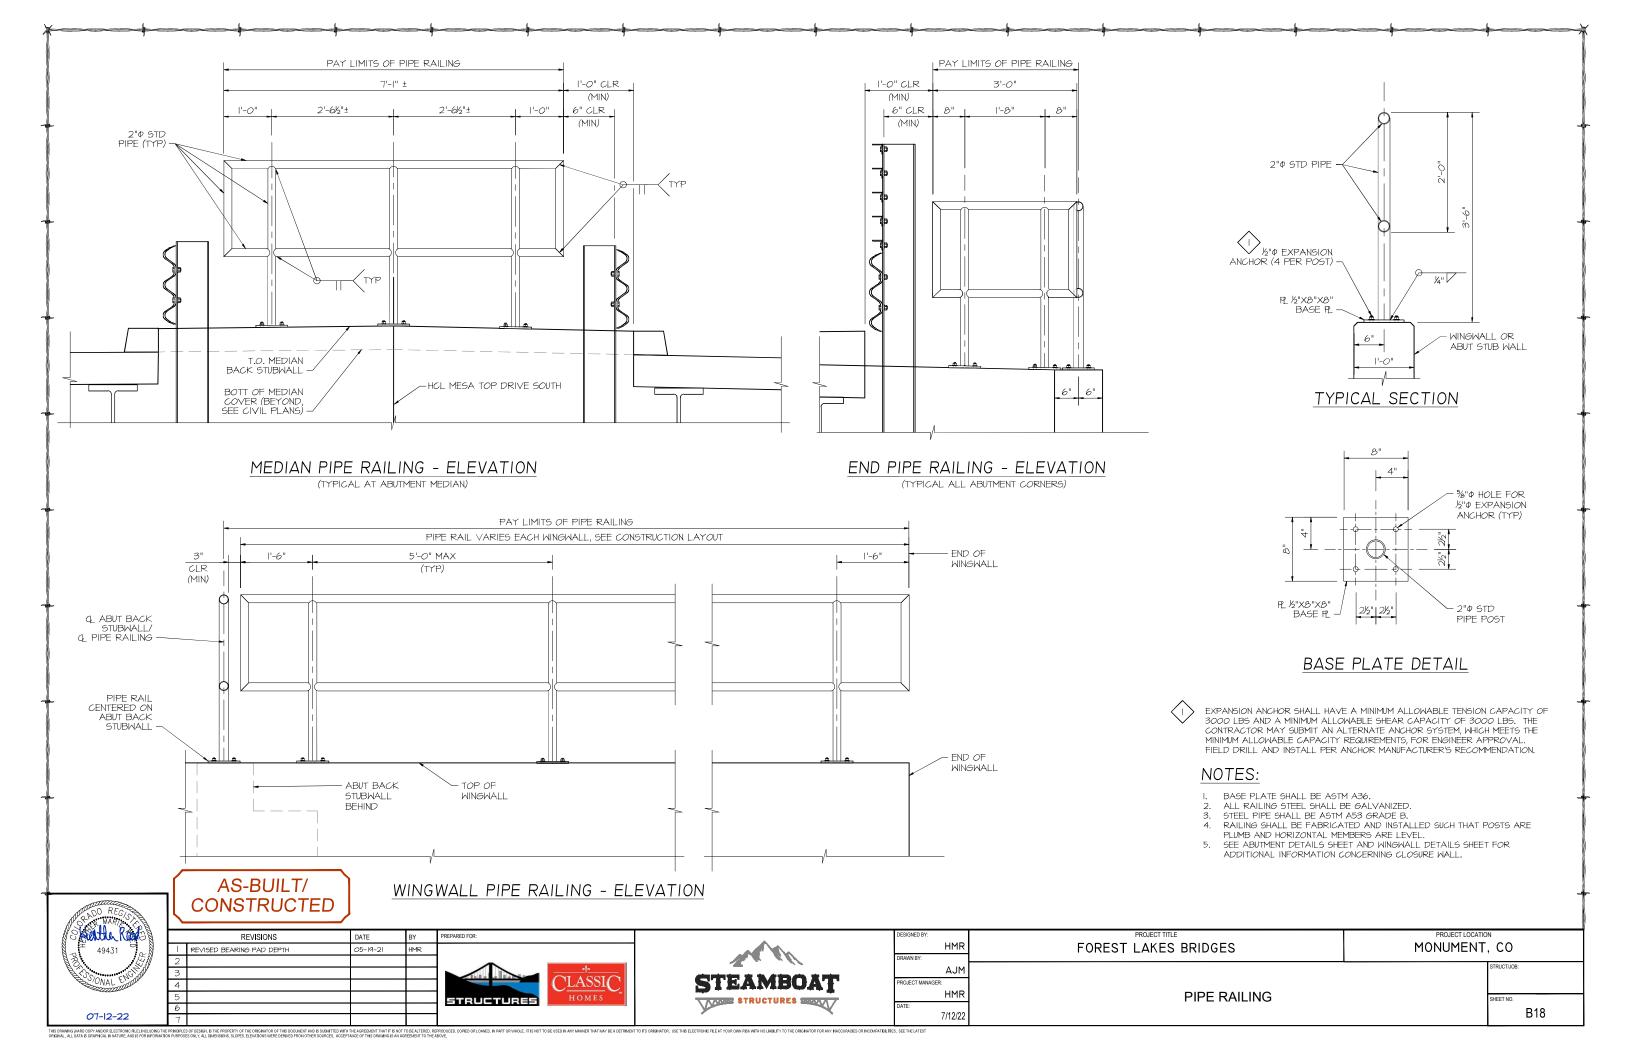

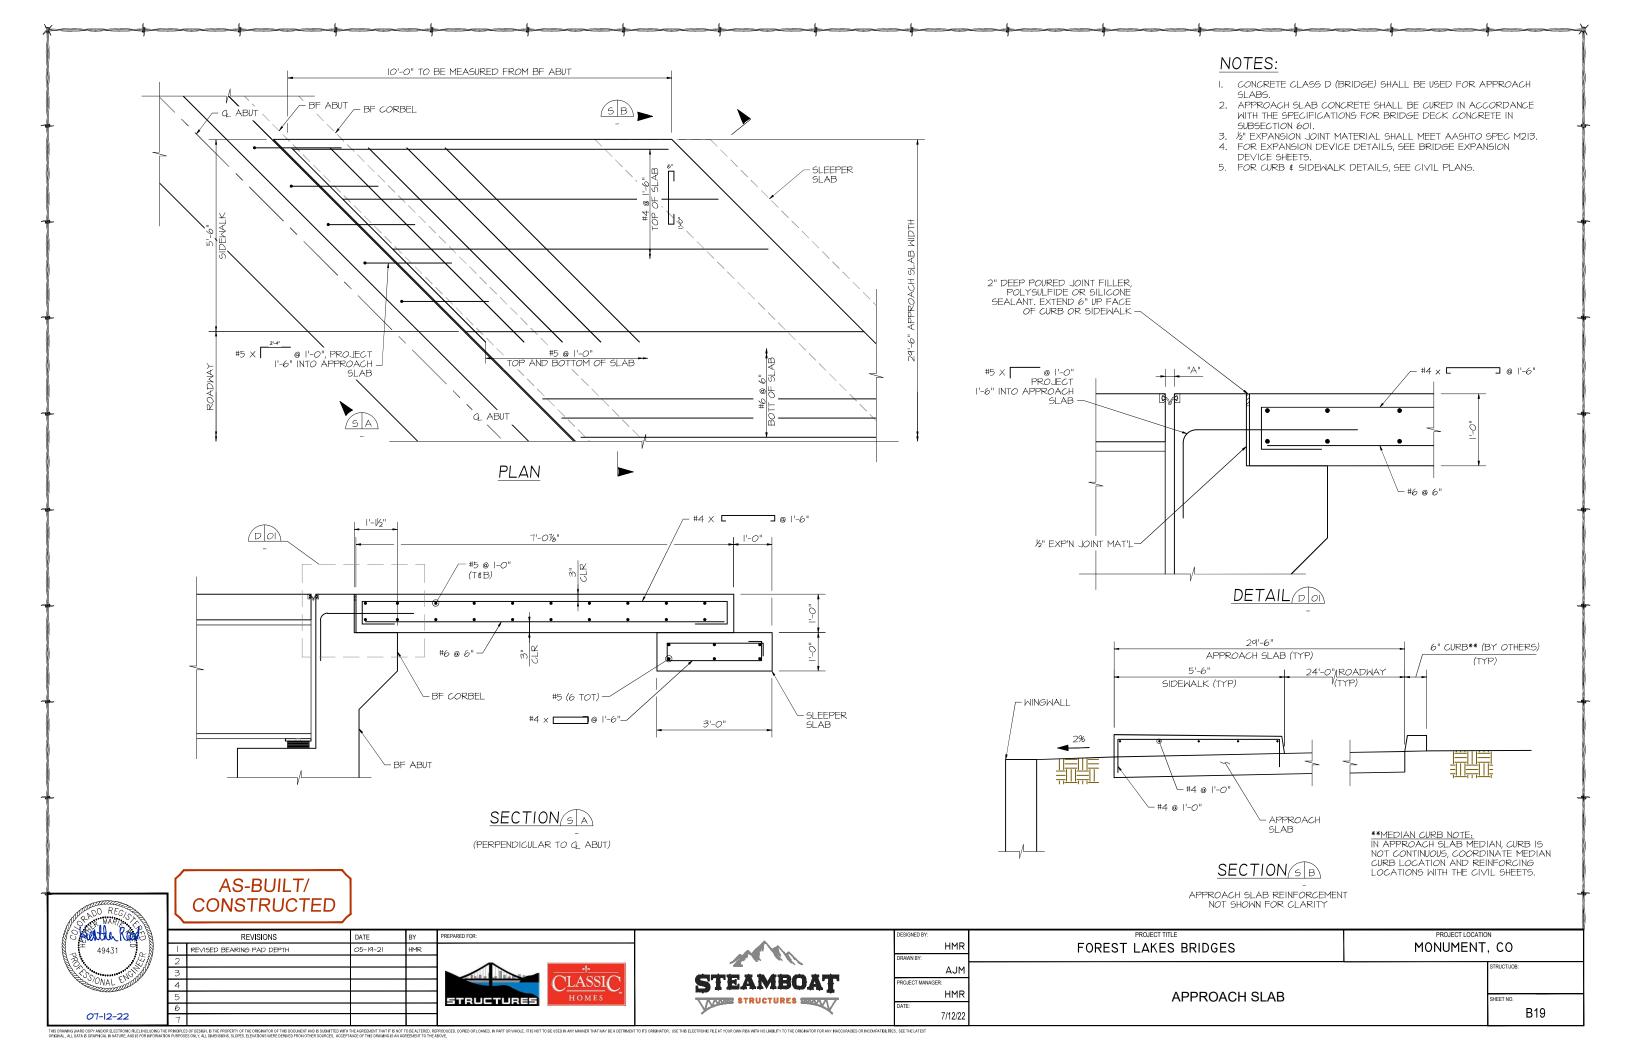

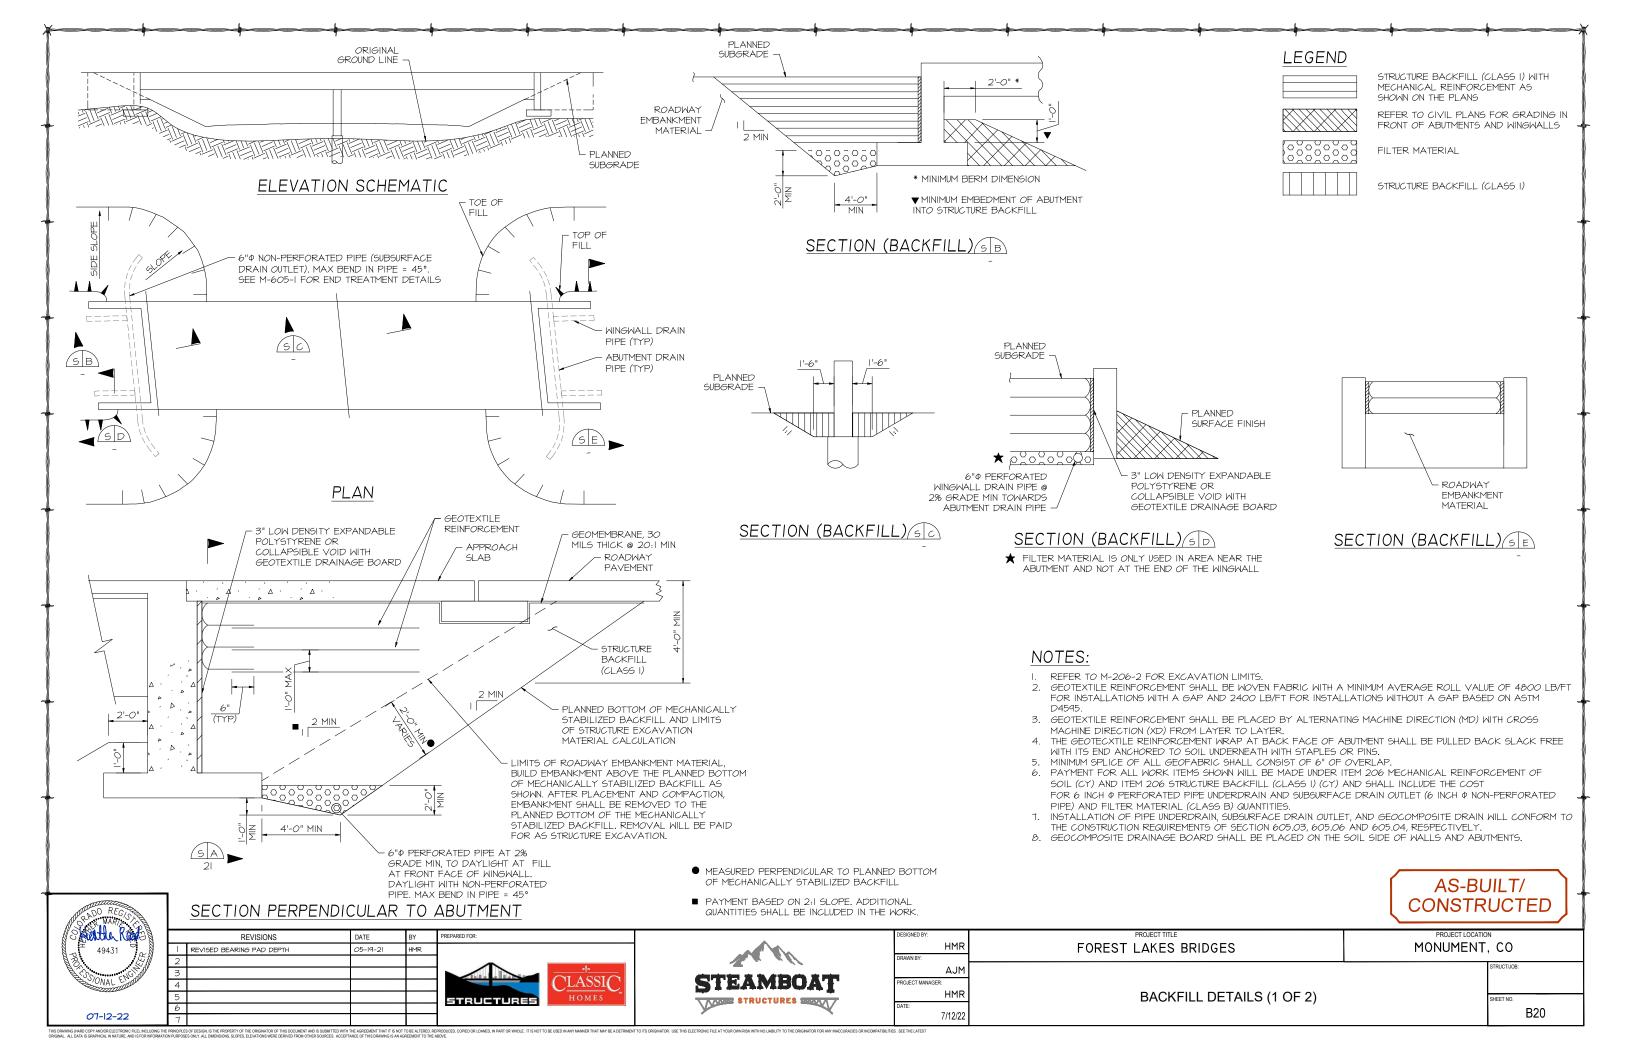

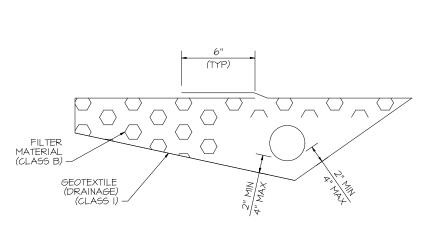

# 2'-0" **GEOTEXTILE** REINFORCEMENT COMPACTED STRUCTURE BACKFILL (CLASS I) BACK FACE ABUT OR WINGWALL PROVIDE GAP OF 3" STAPLES OR BETWEEN ABUTMENT PINS (TYP) AND WRAPS -

WRAP DETAIL

### APPROACH SLAB : - GEOMEMBRANE, BRIDGE RAIL & SIDEWALK NOT SHOWN 30 MILS THICK 3" LOW DENSITY EXPANDABLE POLYSTYRENE OR COLLAPSIBLE VOID WITH GEOTEXTILE DRAINAGE BOARD 6"Φ NON-PERFORATED FILTER MATERIAL PIPE MAX BEND IN (CLASS B) WINGWALL DRAIN PIPE (TYP) 6" PERFORATED UNDERDRAIN PIPE 6"Φ PIPE 6"Φ PIPE 6"Φ PIPE PERFORATED NON-PERFORATED NON-PERFORATED SECTION S A


LEGEND


STRUCTURE BACKFILL (CLASS I) WITH MECHANICAL REINFORCEMENT AS

SHOWN ON THE PLANS

FILTER MATERIAL

# 6 INCH PERFORATED PIPE UNDERDRAIN

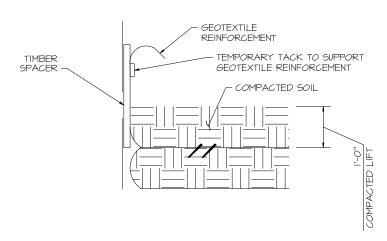

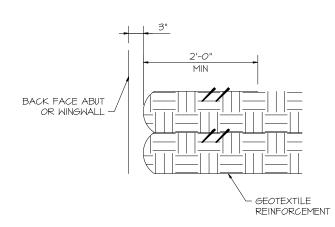

### GAP DETAIL STEP I

## GAP DETAIL STEP 2

WHEN REQUIRED, THE GEOTEXTILE REINFORCEMENT WRAP AT BACK FACE OF ABUTMENT OR WINGWALL SHALL BE TEMPORARILY HUNG WITH A SPACER BOARD AND TACK STRIP, AFTER REACHING TOTAL OF 1'-O" COMPACTED LIFT, THE TACK STRIP SHALL BE REMOVED AND TEXTILE REINFORCEMENT SHALL BE PULLED BACK SLACK FREE WITH ITS END ANCHORED TO SOIL UNDERNEATH WITH STAPLE OR PINS BEFORE THE SPACER BOARD IS PULLED. ANY ALTERNATE METHOD TO MAINTAIN THE MINIMUM GAP BETWEEN ABUTMENT CONCRETE AND REINFORCED SOIL MAY BE PROPOSED TO THE ENGINEER FOR APPROVAL

### NOTES:

- REFER TO M-206-2 FOR EXCAVATION LIMITS.
- 2. GEOTEXTILE REINFORCEMENT SHALL BE WOVEN FABRIC WITH A MINIMUM AVERAGE ROLL VALUE OF 4800 LB/FT FOR INSTALLATIONS WITH A GAP AND 2400 LB/FT FOR INSTALLATIONS WITHOUT A GAP BASED ON ASTM
- 3. GEOTEXTILE REINFORCEMENT SHALL BE PLACED BY ALTERNATING MACHINE DIRECTION (MD) WITH CROSS
- MACHINE DIRECTION (XD) FROM LAYER TO LAYER.
  THE GEOTECXTILE REINFORCEMENT WRAP AT BACK FACE OF ABUTMENT SHALL BE PULLED BACK SLACK FREE WITH ITS END ANCHORED TO SOIL UNDERNEATH WITH STAPLES OR PINS. MINIMUM SPLICE OF ALL GEOFABRIC SHALL CONSIST OF 6" OF OVERLAP.
- 6. PAYMENT FOR ALL WORK ITEMS SHOWN WILL BE MADE UNDER ITEM 206 MECHANICAL REINFORCEMENT OF SOIL (CY) AND ITEM 206 STRUCTURE BACKFILL (CLASS I) (CY) AND SHALL INCLUDE THE COST FOR 6 INCH ¢ PERFORATED PIPE UNDERDRAIN AND SUBSURFACE DRAIN OUTLET (6 INCH ¢ NON-PERFORATED PIPE) AND FILTER MATERIAL (CLASS B) QUANTITIES.
- INSTALLATION OF PIPE UNDERDRAIN, SUBSURFACE DRAIN OUTLET, AND GEOCOMPOSITE DRAIN WILL CONFORM TO THE CONSTRUCTION REQUIREMENTS OF SECTION 605.03, 605.06 AND 605.04, RESPECTIVELY.
- 8. GEOCOMPOSITE DRAINAGE BOARD SHALL BE PLACED ON THE SOIL SIDE OF WALLS AND ABUTMENTS.



l	NOO REGIS
l	MARIA ROLL
l	49431
l	
l	SONAL ENGLISH

07-12-22

REVISIONS 05-19-21 REVISED BEARING PAD DEPT HMR



	HMR
DRAWN BY:	AJM
PROJECT MANAGE	HMR
DATE:	7/12/22

PROJECT TITLE MONUMENT, CO FOREST LAKES BRIDGES STRUCT/JOB: BACKFILL DETAILS (2 OF 2) B21