



# FINAL DRAINAGE REPORT

## CONSTITUTION STORAGE DEVELOPMENT

El Paso County, Colorado

---

PREPARED FOR:  
**Johnson Development Associates, Inc.**  
**100 Dunbar Street, Suite 400**  
**Spartanburg, SC 29306**

PREPARED BY:  
**Galloway & Company, Inc.**  
**1155 Kelly Johnson Blvd., Suite 305**  
**Colorado Springs, CO 80920**

DATE:  
**December 22, 2022**

*PCD Filing No.: PPR-2224*

**ENGINEER'S STATEMENT**

*The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.*

\_\_\_\_\_  
Brady A. Shyrock, PE #38164  
For and on behalf of Galloway & Company, Inc.

\_\_\_\_\_  
Date

**DEVELOPER'S CERTIFICATION**

*I, The developer, have read and will comply with all of the requirements specified in this drainage report and plan.*

By: \_\_\_\_\_

\_\_\_\_\_  
Date

Address: Johnson Development Associates, Inc.  
101 N. Pacific Coast Hwy, Suite 308  
El Segundo, CA 90245

**EL PASO COUNTY CERTIFICATION**

*Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.*

\_\_\_\_\_  
Joshua Palmer, P.E.  
Interim County Engineer

\_\_\_\_\_  
Date

Conditions:

## TABLE OF CONTENTS

I.	Purpose .....	4
II.	General Description .....	4
III.	Drainage Criteria .....	4
IV.	Existing Drainage Conditions .....	5
V.	Four Step Process .....	6
	1. Employ Runoff Reduction Practices.....	6
	2. Stabilize Channels.....	6
	3. Provide Water Quality Capture Volume (WQCV) .....	6
	4. Consider Need for Industrial and Commercial BMPs .....	7
VI.	Proposed Drainage Conditions .....	7
VII.	Storm Sewer System.....	8
VIII.	Proposed Water Quality Detention Ponds .....	9
IX.	Proposed Channel Improvements.....	9
X.	Maintenance .....	10
XI.	Wetlands Mitigation .....	10
XII.	Floodplain Statement .....	10
XIII.	Drainage Fees & Maintenance.....	10
XIV.	Conclusion.....	10
XV.	References .....	11

Appendices:

- A. Exhibits and Figures
- B. Hydrologic Computations
- C. Hydraulic Computations
- D. Water Quality Computations
- E. Drainage Maps & Water Quality Plan

## I. Purpose

The purpose of this Final Drainage Report is to identify on and offsite drainage patterns, locate and identify tributary or downstream drainage features and facilities that impact the site, and to identify which types of drainage facilities will be needed and where they will be located. This report will remain in general compliance with the approved FDR prepared by Costin Engineering Company, dated February 2, 1983.

## II. General Description

The project is a self-storage commercial development located in the Cimarron Hills area of El Paso County, Colorado. The site is located in a portion of Section 05, Township 14 South, Range 65 West of the 6<sup>th</sup> Principal Meridian, County of El Paso, State of Colorado. The subject property is bounded by Constitution Avenue to the north, Canada Drive to the east, Peterson Road to the west, and existing Northcrest Filing No. 3 residential development to the south. A Vicinity Map is included in **Appendix A**.

This final drainage report is the basis for the drainage facility design in conformance with the previously approved FDR for the site prepared by Costin Engineering Company, "*Amendment Number 1, Final Drainage Study, Cimarron Northcrest Filing No. 3*", Costin Engineering Company, February 1983 (**FDR**). The site consists of approximately 3.716 acres and includes 929 storage units.

The existing soil types within the proposed site as determined by the NRCS Web Soil Survey for El Paso County Area consist of Truckton Sandy Loam (hydrologic soil group A). See the soils map included in **Appendix A**.

## III. Drainage Criteria

Hydrology calculations were performed using the City of Colorado Springs/El Paso County Drainage Criteria Manual, as revised in November 1991 and October 1994 with County adopted Chapter 6 and Section 3.2.1 of Chapter 13 of the City of Colorado Springs/El Paso County Drainage Criteria Manual as revised in May 2014.

The drainage calculations were based on the criteria manual Figure 6-5 and IDF equations to determine the intensity and are listed in Table 1 below.

**Table 1 - Precipitation Data**

Return Period	One Hour Depth (in.)	Intensity (in/hr)
5-year	1.50	5.17
100-year	2.52	8.68

The rational method was used to calculate peak flows as the tributary areas are less than 100 acres. The rational method has been proven to be accurate for basins of this size and is based on the following formula:

$$Q = CIA$$

Where:



Q = Peak Discharge (cfs)  
C = Runoff Coefficient  
I = Runoff intensity (inches/hour)  
A = Drainage area (acres)

The runoff coefficients are calculated based on land use, percent imperviousness, and design storm for each basin, as shown in the drainage criteria manual (Table 6-6). Composite percent impervious and C values were calculated using the residential, streets, roofs, and lawns coefficients found in Table 6-6 of the manual.

The 100-year event was used as the major storm event. The 5-year event was used as the minor event. The UD-Inlets v5.01 spreadsheet was utilized for the sizing of the proposed sump inlets.

The UD-Detention v4.04 spreadsheet was utilized for the design of the proposed on-site Full Spectrum Detention Pond.

## IV. Existing Drainage Conditions

The site lies within the existing Sand Creek drainage basin (see Reference Map). Based on this report, existing topography, and proposed future developments, no off-site basins will impact the site.

Stormwater from this site generally drains to the southeast and southwest and will be routed to a single (1) private full spectrum detention facility designated as FSD-1 which has been sized to accommodate the developed flows from this site. The rational method was used to analyze the individual basins within the site because their size permits it.

The property presently discharges via sheet flow along the southern property line onto the adjacent Eight Line Inc. property and Alvarado property. Portions of the site along the eastern and western property lines also drain to the adjacent right-of-ways.

While the **FDR** shows a total of 26 basins that were analyzed as part of the overall Northcrest Filing No. 3 development, for the purposes of this report, only one (1) of the Basins within the FDR will be used for analysis. This Basin, C-4 (6.3 AC,  $Q_5 = 7.0$  cfs,  $Q_{100} = 18.30$  cfs) is located at the northwest corner of the approved FDR study area and drains through properties to the south to Allyn Way.

The **FDR** also establishes that runoff from Basin C-4 will be conveyed via curb and gutter to an existing detention facility south of the site along Piros Drive. This existing detention facility will no longer be utilized for water quality or detention for the project site, but the existing street flow drainage pattern will be maintained. As a result, the proposed private FSD-1 pond will outlet at grade to the curb in Canada Drive. There is no storm sewer infrastructure existing in Canada Drive.

For a more in-depth analysis of existing tributary conditions as it pertains to this phase of development, an existing basin map has been prepared. The existing map can be found in **Appendix E** and basins are described below. The site has been divided into six (6) sub-basins to better show where runoff flows in the current conditions.

**Basin EX-1** (0.05 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.1$  cfs): This basin encompasses a portion of the southwest of the site in the existing condition. This basin consists of un-developed land. Runoff from this basin will sheet flow to the south before outfalling onto the adjacent Eight Line Inc. property. **(DP 1)**.

**Basin EX-2** (0.26 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.4$  cfs): This basin encompasses the southwest portion of the site in the existing condition. This basin consists of un-developed land. Runoff from this basin will sheet flow to the south before outfalling onto the adjacent Alvarado property. **(DP 2)**.

**Basin EX-3** (0.39 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.7$  cfs): This basin encompasses the western portion of the site in the existing condition, as well as a portion of the Peterson Road right-of-way. This basin consists of un-developed land and a portion of existing sidewalk. Runoff from this basin will sheet flow to the southwest before outfalling into Peterson Road. **(DP 3)**.

**Basin EX-4** (0.03 AC,  $Q_5 = 0.1$  cfs,  $Q_{100} = 0.2$  cfs): This basin encompasses a portion of the northwest of the site in the existing condition. This basin consists mostly of existing sidewalk. Runoff from this basin will sheet flow to the north before outfalling into Constitution Avenue. **(DP 4)**.

**Basin EX-5** (2.69 AC,  $Q_5 = 0.4$  cfs,  $Q_{100} = 4.8$  cfs): This basin encompasses the majority of the site in the existing condition, as well as a portion of Constitution Avenue right-of-way that is currently undeveloped. This basin consists of un-developed land, access drive, and a single-family home. Runoff from this basin will sheet flow to the south before outfalling onto the adjacent Eight Line Inc. property. **(DP 5)**.

**Basin EX-6** (0.36 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.5$  cfs): This basin encompasses the eastern portion of the site in the existing condition, as well as a portion of Constitution Avenue right-of-way that is currently undeveloped. This basin consists of un-developed land. Runoff from this basin will sheet flow to the southeast before outfalling into Canada Drive. **(DP 6)**.

## V. Four Step Process

The Four Step Process is used to minimize the adverse impacts of urbanization and is a vital component of developing a balanced, sustainable project. Below identifies the approach to the four-step process:

### 1. Employ Runoff Reduction Practices

This step uses low impact development (LID) practices to reduce runoff at the source. Generally, rather than creating point discharges that are directly connected to impervious areas runoff is routed through pervious areas to promote infiltration. The Impervious Reduction Factor (IRF) method was used, and calculations can be found in **Appendix D**. For the majority of the site this is not practical, however portions of the site do drain through landscaped swales prior to entering the storm sewer system.

### 2. Stabilize Channels

This step implements stabilization to channels to accommodate developed flows while protecting infrastructure and controlling sediment loading from erosion in the drainageways. This project does not discharge to a channel. Flows are detained onsite to control release rates from the site down to existing rates and not adversely impact downstream facilities. The site is designed to release at or below the existing release rate for the site and will not negatively impact the downstream infrastructure.

### 3. Provide Water Quality Capture Volume (WQCV)

This step utilizes formalized water quality capture volume to slow the release of runoff from the site. The EURV volume will release in 72 hours, while the WQCV will release in no less than 40 hours. An on-site Full Spectrum Detention Pond will provide water quality treatment for the majority of the

developed areas, prior to the runoff being released into existing curb flowlines at Canada Dr. Refer to WQCV Plan in **Appendix E**.

#### 4. Consider Need for Industrial and Commercial BMPs

As this project is a commercial development, roof drains connecting directly to proposed water quality and detention facility, surface flows being routed to inlets that capture developed runoff and direct flows to proposed water quality and detention facility. Stockpile and concrete washout BMPs will be implemented onsite. At the Contractor's discretion, additional specialized BMPs which would be associated with an industrial or commercial site may be implemented.

## VI. Proposed Drainage Conditions

The proposed development lies completely within the Sand Creek Drainage Basin and consists of eleven (11) sub-basins. Site runoff will be collected via sheet flows, roof drains, inlets & pipes and diverted to the one (1) proposed full spectrum detention pond (FSD-1). All necessary calculations can be found within the appendices of this report.

According to the **FDR**, the proposed project site lies within Basin C-4 (6.3 AC,  $Q_5 = 7.0$  cfs,  $Q_{100} = 18.30$  cfs) is located at the northwest corner of the approved FDR study area. The property presently discharges via sheet flow along the southern property line onto the adjacent Eight Line Inc. property.

The site will provide one (1) private Full Spectrum Detention Pond (FSD). Pond FSD-1 will discharge treated runoff at historic rates directly into the existing curb flowline at Canada Drive, as there is not adjacent storm sewer infrastructure.

As has been mentioned previously, the site is proposed to have a land use of commercial self-storage. The site will consist of 929 storage units along with associated parking, drive aisles, RV storage, detention pond, and landscaping areas.

**Basin PR-1** (0.24 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.3$  cfs): Located at the southwestern corner of the site, Basin PR-1 contains the proposed landscaping improvements immediately adjacent to the existing residential development (Northcrest Filing No. 3). Runoff from this basin will sheet flow to the existing southern boundary into the Alvarado property as it does in the existing condition (Basin EX-2) (**DP 1**). **Exclusion I.7.1.B.7**

**Basin PR-2A** (0.11 AC,  $Q_5 = 0.1$  cfs,  $Q_{100} = 0.3$  cfs): Located on the western boundary of the site, this basin consists of driveway and landscaping. Runoff from this basin will sheet flow from the driveway to proposed curb and gutter at the driveway and Peterson Rd. Flows will then be routed, via curb & gutter downstream to the existing curb & gutter at the southwestern corner of the project site (**DP 2A**).

**Basin PR-2B** (0.01 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.1$  cfs): Located on the northwestern corner of the site, this basin consists of sidewalk and landscaping. Runoff from this basin will sheet flow to existing curb and gutter at Peterson Rd. Flows will then be routed, via existing curb & gutter at the northwestern corner of the project site (**DP 2B**).

**Basin PR-3** (0.22 AC,  $Q_5 = 0.2$  cfs,  $Q_{100} = 0.7$  cfs): Located on the northern boundary of the site, this basin consists of sidewalk and landscaping, as well as offsite areas within the Constitution right-of-way being developed. Runoff from this basin will sheet flow to existing curb and gutter in Constitution Ave. Flows will then be routed, via existing curb & gutter downstream to the northeastern corner of the project site (**DP 3**).

Galloway & Company, Inc.

Explain in the narrative how WQ is being addressed for each highlighted basin and reference Section VIII for more information. The basin exclusion needs to be discussed briefly in this section of the text.

All runoff needs to be treated before leaving the Site unless an exclusion applies. Possible exclusions include I.7.1.B.7 (land disturbance to undeveloped land that will remain undeveloped) and/or I.7.1.C.1 (which allows for 20% not to exceed 1 acre of the applicable development site area to not be captured [based on the lot site, that would be a max of 0.8 acres for this Site])

Unresolved.

**Basin PR-4** (0.25 AC,  $Q_5 = 0.2$  cfs,  $Q_{100} = 0.7$  cfs): Located on the eastern boundary of the site, this basin consists of driveway and landscaping. Runoff from this basin will sheet flow from the driveway to proposed curb and gutter at the driveway and Canada Dr. Flows will then be routed, via curb & gutter downstream to the existing curb & gutter at the southeastern corner of the project site (**DP 4**).

**Basin PR-5** (1.32 AC,  $Q_5 = 3.9$  cfs,  $Q_{100} = 9.0$  cfs): Located on the northcentral portion of the site, this basin consists entirely of the proposed two-story building. Flows will be captured by roof drains and routed, via pipe (**DP 5**), to the proposed (private) full spectrum detention (FSD-1) located at the northeast corner of the site (**DP 10**).

**Basin PR-6** (0.83 AC,  $Q_5 = 0.9$  cfs,  $Q_{100} = 2.6$  cfs): Located on the central portion of the site, west and south of Basin PR-5. This basin consists of landscaping and driveway. Runoff from this basin will sheet flow from the driveway to the proposed curb and gutter to the proposed (private) 8' Colorado Springs D-10-R inlet (**DP 6A**) where flows will be routed, via pipe, to the proposed (private) full spectrum detention (FSD-1) located at the northeast corner of the site (**DP 10**). Emergency overflows will be routed downstream via proposed curb and gutter to Canada Drive.

**Basin PR-7** (0.19 AC,  $Q_5 = 0.6$  cfs,  $Q_{100} = 1.3$  cfs): Located on the northcentral portion of the site east of Basin PR-5, this basin consists of landscaping, and RV storage. Runoff from this basin will sheet flow to the edge of the proposed RV storage area to a proposed (private) 6' Colorado Springs D-10-R inlet in sump condition (**DP 7**), where flows will be routed, via pipe, to the proposed (private) full spectrum detention (FSD-1) located at the northeast corner of the site (**DP 10**). Emergency overflows will be routed downstream via proposed curb and gutter to Canada Drive.

**Basin PR-8** (0.13 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.2$  cfs): Located on the northern portion of the site, this basin consists entirely of landscaped area and swale north of the building. Runoff from this basin will sheet flow to the proposed swale to the proposed (private) CDOT Type C inlet (**DP 8**) where flows will be routed, via pipe, to the proposed (private) full spectrum detention (FSD-1) located at the northeast corner of the site (**DP 10**). Emergency overflows will be routed downstream via proposed curb and gutter to Canada Drive.

**Basin PR-9** (0.17 AC,  $Q_5 = 0.5$  cfs,  $Q_{100} = 0.9$  cfs): Located in the eastern portion of the site, this basin consists of drive aisle and parking. Runoff from this basin will sheet flow to a proposed (private) 6' Colorado Springs D-10-R inlet in on-grade conditions, located on the south side of the access drive adjacent to the eastern most parking stalls (**DP 9**) where flows will be routed, via pipe, to the proposed (private) full spectrum detention (FSD-1) located at the northeast corner of the site (**DP 10**). Emergency overflows will be routed downstream via proposed curb and gutter to Canada Drive.

**Basin PR-10** (0.31 AC,  $Q_5 = 0.0$  cfs,  $Q_{100} = 0.6$  cfs): Located at the northeastern corner of the site, Basin PR-8 contains the entirety of the proposed (private) full spectrum detention (FSD-1) and adjacent landscaped area. Runoff from this basin will sheet flow directly to the (private) full spectrum detention (FSD-1) (**DP 10**).

## VII. Storm Sewer System

All development is anticipated to be urban and will include storm sewer & street inlets. Storm sewers collect storm water runoff and convey the water to the water quality facility prior to discharging. Storm sewer systems will be designed to the 100-year storm and checked with the 5-year storm. Inlets will be placed at sump areas and locations where street flow is larger than street capacity. UDFCD Inlet

clarify what size storm is considered emergency overflow  
Unresolved.

spreadsheet has been used to determine the size of all sump inlets. Emergency overflow conditions discussed above will only be activated in storm events exceeding the 100-year storm event.

There will be a proposed storm system within the site. The storm sewer system will discharge storm water into the proposed private full spectrum detention facility (FSD-1). The proposed system will consist of HDPE pipe, CDOT Type C inlets, Colorado Springs D-10-R inlets, Nyloplast Drain Basins, and storm sewer manholes. Inlet sizing and capacity calculations can be found in **Appendix D**, along with preliminary storm sewer sizing.

Additionally, there are two (2) proposed drainage swales that run along the north and west side of the proposed building, respectively within sub-basins PR-8 and PR-6. The swales were analyzed using the Bentley software FlowMaster to properly size a triangular channel to convey the 100-year flows from the basins to FSD-1, while providing 1.0-ft of freeboard. The sizing calculations can be found in **Appendix D**.

## VIII. Proposed Water Quality Detention Ponds

One (1) Full Spectrum Detention Pond (FSD-1) will be provided for the proposed site. The proposed pond will be privately owned and maintained by Johnson Development Associates Inc., once established. This detention pond is proposed to be full spectrum and will provide water quality and detention. Flows will be routed into the pond with the proposed (private) storm sewer system and release onto proposed forebays into the pond. The WQCV release will be controlled by an orifice plate within the outlet structure. The release rates for the WQCV and EURV will be 41-hours and 69-hours, respectively, and will pond to depths of 6500.94 and 6502.05. Flows exceeding the WQCV will be controlled by orifices and a modified Type C Outlet Structure and will be designed to release at or below the pre-development flow rate. A proposed outlet structure has been designed with this report. See **Appendix D** for calculations. Basins PR-5 through PR-10 drain to FSD-1, totaling 2.95 acres and 80% of the project site.

Note: The approved Northcrest Filing No. 3 FDR designed the area of the project site to drain to a detention facility south of the site via curb and gutter. While this existing drainage facility is no longer being utilized for water quality or detention, the existing drainage pattern using curb and gutter must be maintained as there is no existing storm sewer system in Canada Dr.

Per ECM Section I.7.1.C.1.a, 20% of the site may free release offsite, not to exceed 1 acre. Because the proposed private FSD-1 pond must outlet at grade to the curb and gutter, there are significant grading limitations to the site. Because of this, Basins PR-1, PR-2A, PR-2B, PR-2 and PR-4 free release off-site, totaling 0.77 acres and 20% of the site area. These basins also generally reflect the existing drainage patterns for the perimeter of the site. Since these basins are 20% of the site and do not exceed 1 acre, the project site complies with ECM Section I.7.1.C.1.a.

**FSD-1:** Located at the northeastern corner of the site, just west of existing Canada Dr. This pond will discharge to the existing western curb line within Canada Dr. The required volume WQCV and EURV are 0.069 Ac-Ft & 0.200 Ac-Ft, respectively. The total required detention basin volume is 0.392 Ac-Ft. See **Appendix D** for volume calculations.

## IX. Proposed Channel Improvements

There are no proposed channel improvements as part of this report.

## X. Maintenance

After completion of construction, the drainage facility (FSD-1) will be privately owned and maintained by Johnson Development Associates, Inc.

## XI. Wetlands Mitigation

There are no existing wetlands within the project site.

## XII. Floodplain Statement

No portion of the project sit lies with the designated Flood Zone as defined by the FIRM Map number 08041C0752G effective December 7, 2018. A copy of the FIRM Panel is included in **Appendix A**.

## XIII. Drainage Fees & Maintenance

Drainage fees do not apply for Site Development Plans and are therefore not applicable to this project.

Below is a cost estimate for the improvements proposed with this filing.

Item	Quantity	Unit	Unit Cost	Cost
<b>Storm Drain Improvements (Private)</b>				
CDOT Type C Inlet (Private)	1	EA	\$ 5,138.00	\$ 5,138.00
6' Type D-10 R Inlet (Private)	2	EA	\$ 7,292.00	\$ 14,584.00
8' Type D-10 R Inlet (Private)	1	EA	\$ 8,447.00	\$ 8,447.00
Storm Sewer Manhole, Slab Base	3	EA	\$ 7,082.00	\$ 21,246.00
18" Storm Drain - RCP (Private)	355	LF	\$ 70.00	\$ 24,850.00
18" Storm Drain - HDPE (Private)	475	LF	\$ 60.00	\$ 28,500.00
18" FES	1	EA	\$ 420.00	\$ 420.00
<b>Subtotal</b>				<b>\$ 103,185.00</b>
<b>WQCV Detention Ponds (Private)</b>				
Pond (FSD-1)	1	EA	\$ 45,000.00	\$ 45,000.00
<b>Subtotal</b>				<b>\$ 45,000.00</b>
<b>Total</b>				<b>\$ 148,185.00</b>
Contingency			10%	\$ 14,818.50
<b>Grand Total</b>				<b>\$ 163,003.50</b>

## XIV. Conclusion

The Constitution Storage commercial development lies within the Sand Creek Drainage Basin. Water quality for the site is provided in a single on-site, private, Full Spectrum Detention Pond; FSD-1. All drainage facilities within this report were sized according to the El Paso County Drainage Criteria Manuals. The private full spectrum detention facility (FSD-1) will be maintained by Johnson Development Associates, Inc. The Constitution Storage development will not adversely impact any downstream facilities.



## **XV. References**

1. *El Paso County Drainage Criteria Manual*, 1990.
2. *Drainage Criteria Manual, Volume 2*, City of Colorado Springs, 2002.
3. *El Paso County Drainage Criteria Manual Update*, 2015.
4. *El Paso County Engineering Criteria Manual*, 2020.
5. *Urban Storm Drainage Criteria Manual*, Urban Drainage and Flood Control District, January 2016 (with current revisions).
6. *Amendment Number 1, Final Drainage Study, Cimarron Northcrest Filing No. 3*", Costin Engineering Company, February 1983.

## **APPENDIX A**

### **Exhibits and Figures**



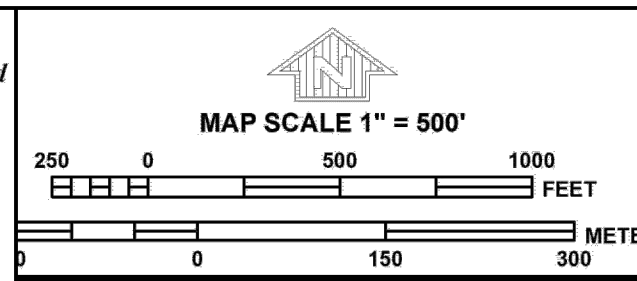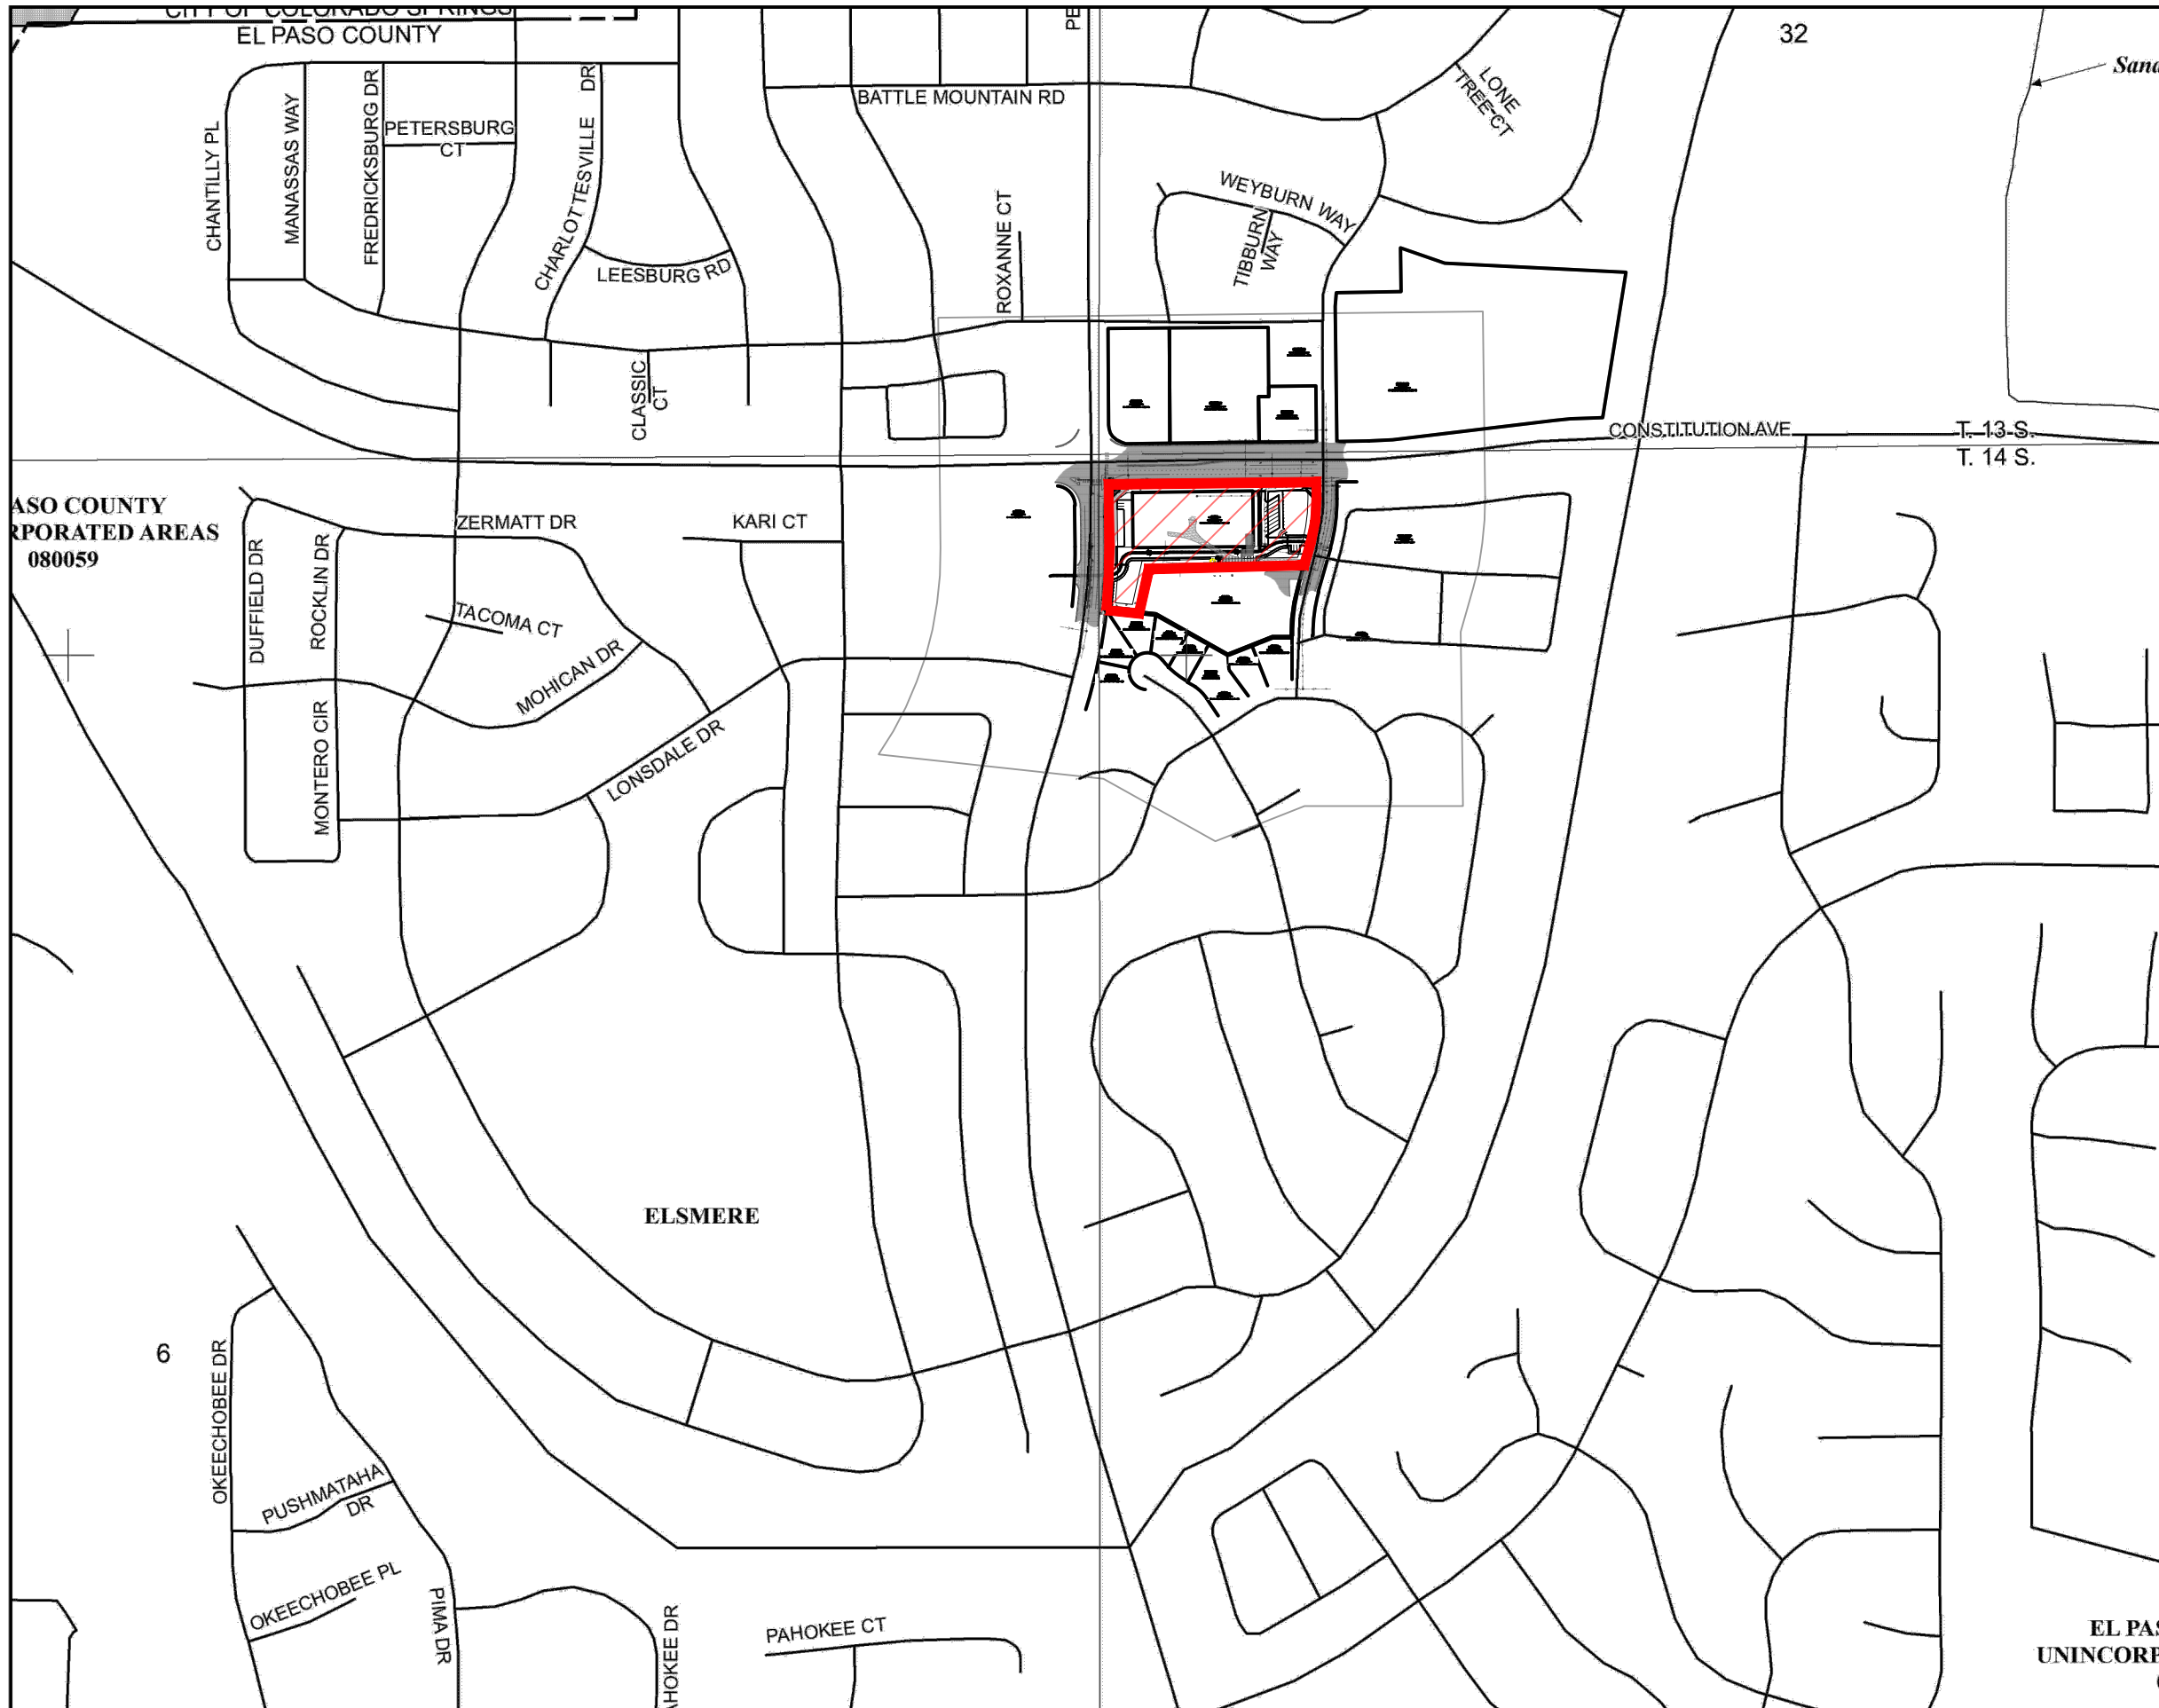

**NFP**

**PANEL 0752G**

**FIRM**  
FLOOD INSURANCE RATE MAP  
EL PASO COUNTY,  
COLORADO  
AND INCORPORATED AREAS

**PANEL 752 OF 1300**  
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
COLORADO SPRINGS, CITY OF	080060	0752	G
EL PASO COUNTY	080059	0752	G

Notice: This map was reissued on 05/15/2020 to make a correction. This version replaces any previous versions. See the Notice-to-User Letter that accompanied this correction for details.

Notice to User: The Map Number shown below should be used when placing map orders; the Community Number shown above should be used on insurance applications for the subject community.

**MAP NUMBER**  
08041C0752G

**MAP REVISED**  
DECEMBER 7, 2018

Federal Emergency Management Agency

**NATIONAL FLOOD INSURANCE PROGRAM**

**EL PASO UNINCORPORATED AREAS 080059**

This is an official FIRMette showing a portion of the above-referenced flood map created from the MSC FIRMette Web tool. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For additional information about how to make sure the map is current, please see the Flood Hazard Mapping Updates Overview Fact Sheet available on the FEMA Flood Map Service Center home page at <https://msc.fema.gov>.

## El Paso County Area, Colorado

### 97—Truckton sandy loam, 3 to 9 percent slopes

#### Map Unit Setting

*National map unit symbol:* 2x0j2

*Elevation:* 5,300 to 6,850 feet

*Mean annual precipitation:* 14 to 19 inches

*Mean annual air temperature:* 48 to 52 degrees F

*Frost-free period:* 85 to 155 days

*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Truckton and similar soils:* 85 percent

*Minor components:* 15 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Truckton

##### Setting

*Landform:* Interfluves, hillslopes

*Landform position (two-dimensional):* Backslope

*Landform position (three-dimensional):* Side slope

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Parent material:* Re-worked alluvium derived from arkose

##### Typical profile

*A - 0 to 4 inches:* sandy loam

*Bt1 - 4 to 12 inches:* sandy loam

*Bt2 - 12 to 19 inches:* sandy loam

*C - 19 to 80 inches:* sandy loam

##### Properties and qualities

*Slope:* 3 to 9 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Well drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* High  
(2.00 to 6.00 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Calcium carbonate, maximum content:* 1 percent

*Maximum salinity:* Nonsaline (0.1 to 1.9 mmhos/cm)

*Available water supply, 0 to 60 inches:* Moderate (about 6.6 inches)

##### Interpretive groups

*Land capability classification (irrigated):* 6e

*Land capability classification (nonirrigated):* 6e

*Hydrologic Soil Group:* A  
*Ecological site:* R049XB210CO - Sandy Foothill  
*Hydric soil rating:* No

### **Minor Components**

#### **Blakeland**

*Percent of map unit:* 8 percent  
*Landform:* Interfluves, hillslopes  
*Landform position (two-dimensional):* Summit, shoulder, backslope  
*Landform position (three-dimensional):* Side slope, crest  
*Down-slope shape:* Convex, linear  
*Across-slope shape:* Convex, linear  
*Ecological site:* R049XB210CO - Sandy Foothill  
*Hydric soil rating:* No

#### **Bresser**


*Percent of map unit:* 7 percent  
*Landform:* Interfluves, low hills  
*Landform position (two-dimensional):* Footslope, toeslope  
*Landform position (three-dimensional):* Base slope  
*Down-slope shape:* Concave, linear  
*Across-slope shape:* Concave, linear  
*Ecological site:* R049XB210CO - Sandy Foothill  
*Hydric soil rating:* No

## **Data Source Information**

Soil Survey Area: El Paso County Area, Colorado  
Survey Area Data: Version 19, Aug 31, 2021



Soil Map—El Paso County Area, Colorado

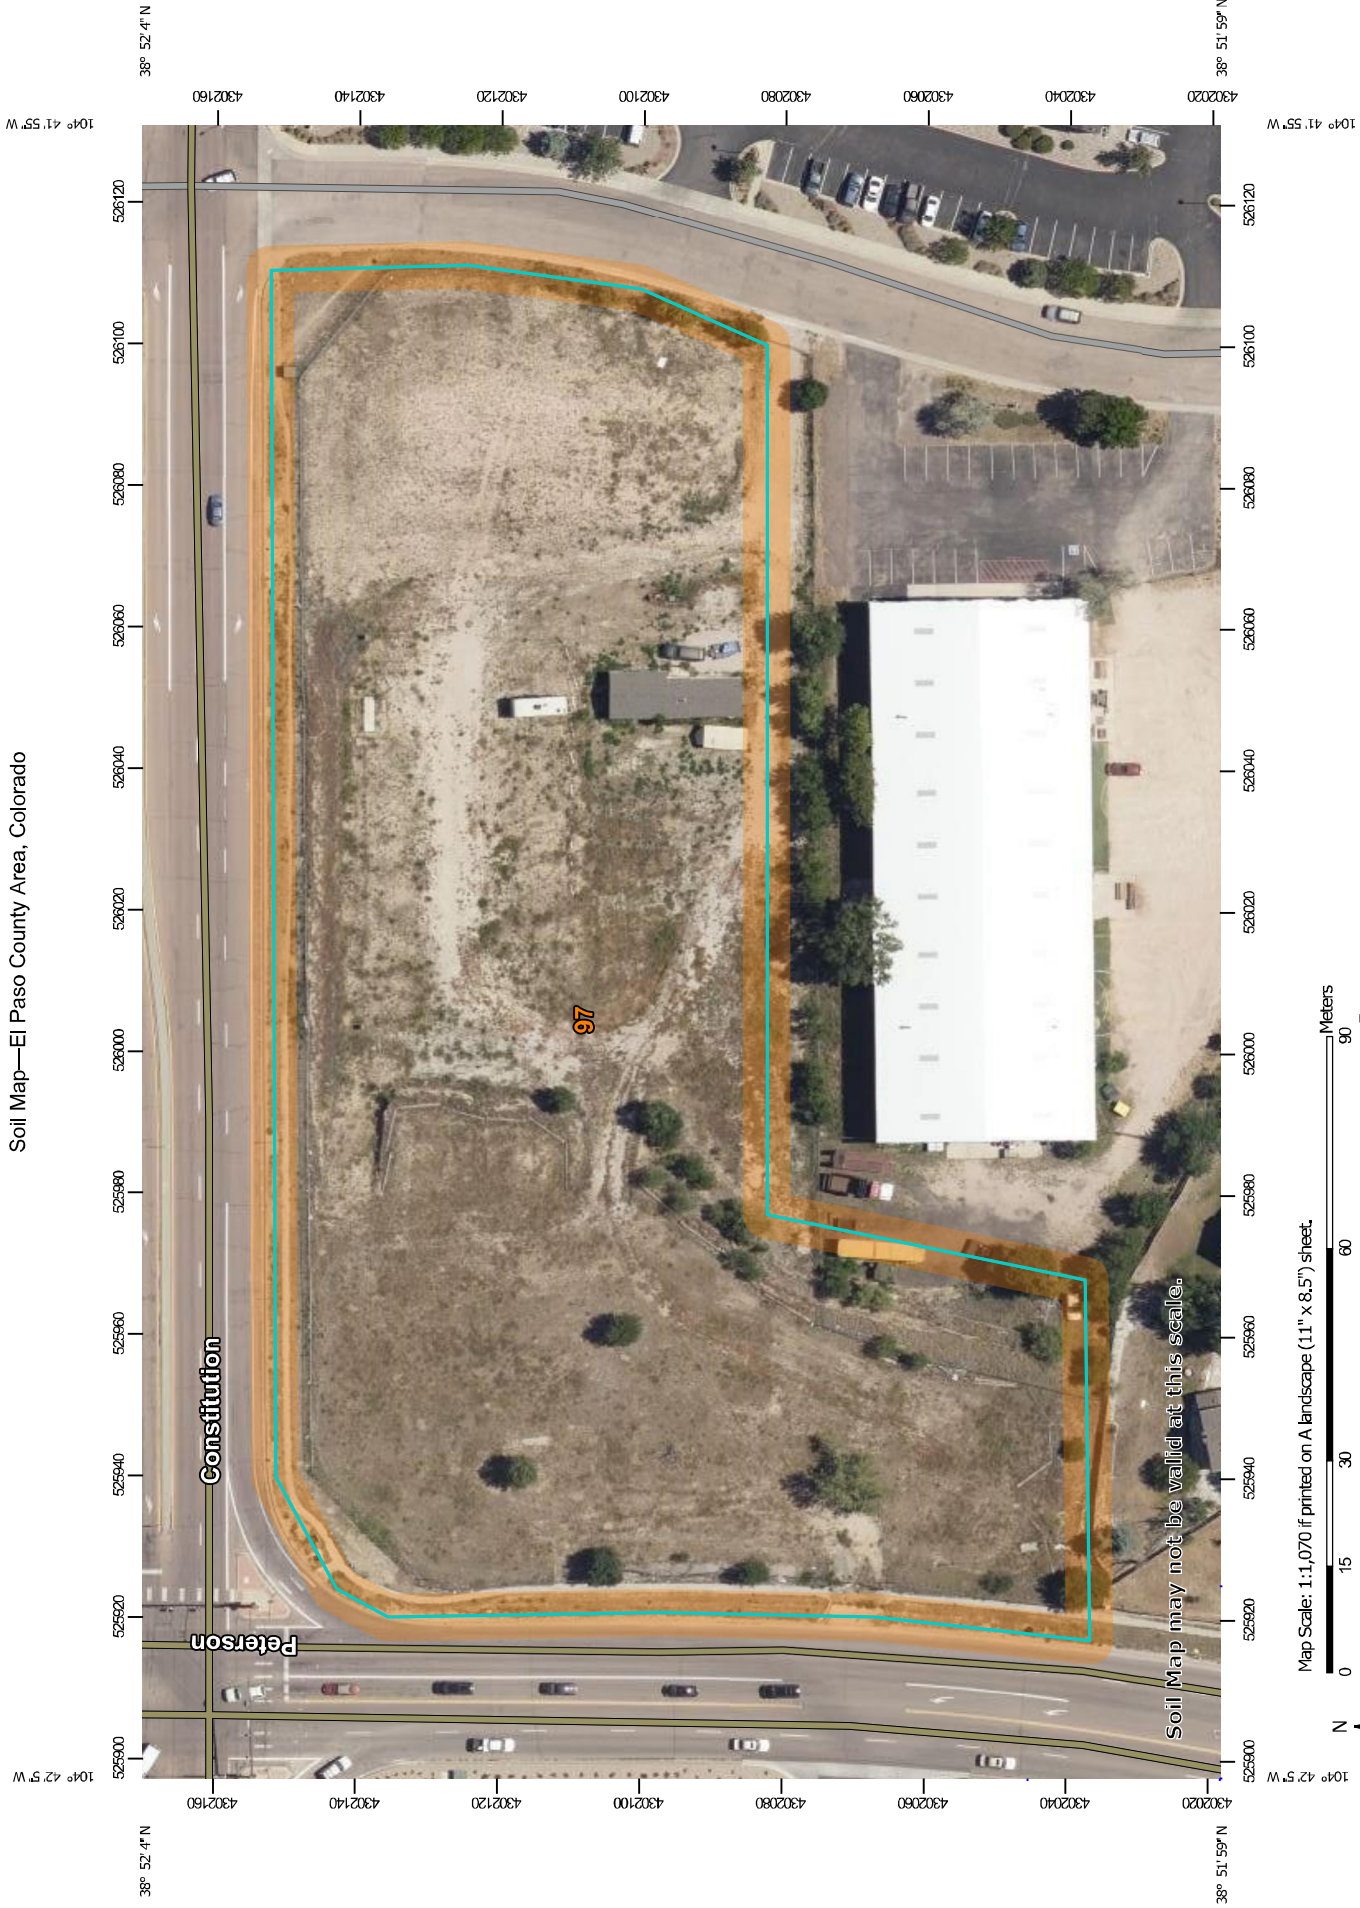





































Soil Map may not be valid at this scale.

Map Scale: 1:1,070 if printed on A landscape (11" x 8.5") sheet.

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84

## MAP LEGEND

-  Area of Interest (AOI)
- Soils**
-  Soil Map Unit Polygons
-  Soil Map Unit Lines
-  Soil Map Unit Points
- Special Point Features**
-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot
-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features
- Water Features**
-  Streams and Canals
- Transportation**
-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads
- Background**
-  Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 19, Aug 31, 2021

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 19, 2018—Sep 23, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
97	Truckton sandy loam, 3 to 9 percent slopes	3.8	100.0%
<b>Totals for Area of Interest</b>		<b>3.8</b>	<b>100.0%</b>

## **APPENDIX B**

### **Hydrologic Computations**

## COMPOSITE % IMPERVIOUS CALCULATIONS

### Existing Conditions

**Subdivision:** \_\_\_\_\_  
**Location:** CO, Colorado Springs

**Project Name:** 6855 Constitution Ave Storage Site  
**Project No.:** JDA000002  
**Calculated By:** DDJ  
**Checked By:** BS  
**Date:** 7/8/22

Basin ID	Total Area (ac)	Paved Roads			Lawns			Roofs			Basins Total Weighted % Imp.
		% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	
EX-1	0.05	100	0.00	0.0	2	0.05	2.0	90	0.00	0.00	2.0
EX-2	0.26	100	0.00	0.0	2	0.26	2.0	90	0.00	0.00	2.0
EX-3	0.39	100	0.02	4.2	2	0.38	1.9	90	0.00	0.00	6.1
EX-4	0.03	100	0.02	77.0	2	0.01	0.5	90	0.00	0.00	77.5
EX-5	2.69	100	0.16	6.0	2	2.50	1.9	90	0.03	1.00	8.9
EX-6	0.36	100	0.00	0.0	2	0.36	2.0	90	0.00	0.00	2.0



**STANDARD FORM SF-2  
TIME OF CONCENTRATION**

Existing Conditions

Subdivision: \_\_\_\_\_  
Location: CO, Colorado Springs

Project Name: 6855 Constitution Ave Storage Site  
Project No.: JDA000002  
Calculated By: DDJ  
Checked By: BS  
Date: 7/8/22

SUB-BASIN						INITIAL/OVERLAND			TRAVEL TIME					T <sub>c</sub> CHECK			FINAL
DATA						(T <sub>i</sub> )			(T <sub>t</sub> )					(URBANIZED BASINS)			
BASIN ID	D.A. (AC)	Hydrologic Soils Group	Impervious (%)	C <sub>100</sub>	C <sub>5</sub>	L (FT)	S (%)	T <sub>i</sub> (MIN)	L (FT)	S (%)	C <sub>v</sub>	VEL. (FPS)	T <sub>t</sub> (MIN)	COMP. T <sub>c</sub> (MIN)	TOTAL LENGTH (FT)	Urbanized T <sub>c</sub> (MIN)	T <sub>c</sub> (MIN)
EX-1	0.05	A	2.0	0.22	0.00	61	27.0	5.2	0	1.5	20.0	2.4	0.0	5.2	61.0	10.3	5.2
EX-2	0.26	A	2.0	0.22	0.00	100	3.0	14.0	130	7.3	15.0	4.1	0.5	14.5	230.0	11.3	11.3
EX-3	0.39	A	6.1	0.25	0.03	210	3.0	19.7	0	1.5	20.0	2.4	0.0	19.7	210.0	11.2	11.2
EX-4	0.03	A	77.5	0.63	0.53	16.5	2.0	3.4	16	1.5	20.0	2.4	0.1	3.5	32.5	10.2	5.0
EX-5	2.69	A	8.9	0.27	0.05	300	2.0	26.4	0	1.5	20.0	2.4	0.0	26.4	300.0	11.7	11.7
EX-6	0.36	A	2.0	0.22	0.00	200	5.0	16.7	0	1.5	20.0	2.4	0.0	16.7	200.0	11.1	11.1

**NOTES:**

$T_i = (0.395 * (1.1 - C_5) * (L)^{0.5}) / ((S)^{0.33})$ , S in ft/ft

$T_t = L / 60V$  (Velocity From Fig. 501)

Velocity  $V = C_v * S^{0.5}$ , S in ft/ft

$T_c \text{ Check} = 10 + L / 180$

For Urbanized basins a minimum T<sub>c</sub> of 5.0 minutes is required.

For non-urbanized basins a minimum T<sub>c</sub> of 10.0 minutes is required

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)  
Existing Conditions

Subdivision: \_\_\_\_\_  
Location: CO, Colorado Springs \_\_\_\_\_  
Design Storm: 2-Year \_\_\_\_\_

Project Name: 6855 Constitution Ave Storage Site \_\_\_\_\_  
Project No.: JDA000002 \_\_\_\_\_  
Calculated By: DDJ \_\_\_\_\_  
Checked By: BS \_\_\_\_\_  
Date: 7/8/22 \_\_\_\_\_

STREET	Design Point	DIRECT RUNOFF				TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS		
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)		Length (ft)	Velocity (fps)
	1	EX-1	0.05	0.00	5.2	0.00	4.06	0.0												Free-release offsite to Eight Line Inc. property
	2	EX-2	0.26	0.00	11.3	0.00	3.15	0.0												Free-release offsite to Alvarado property
	3	EX-3	0.39	0.03	11.2	0.01	3.16	0.0												Free-release offsite to Peterson Road
	4	EX-4	0.03	0.53	5.0	0.02	4.12	0.1												Free-release offsite to Constitution Avenue
	5	EX-5	2.69	0.05	11.7	0.13	3.11	0.4												Free-release offsite to Eight Line Inc. property
	6	EX-6	0.36	0.00	11.1	0.00	3.17	0.0												Free-release offsite to Canada Drive

**STANDARD FORM SF-3  
STORM DRAINAGE SYSTEM DESIGN  
(RATIONAL METHOD PROCEDURE)  
Existing Conditions**

Subdivision: \_\_\_\_\_  
Location: CO, Colorado Springs \_\_\_\_\_  
Design Storm: 100-Year \_\_\_\_\_

Project Name: 6855 Constitution Ave Storage Site \_\_\_\_\_  
Project No.: JDA000002 \_\_\_\_\_  
Calculated By: DDJ \_\_\_\_\_  
Checked By: BS \_\_\_\_\_  
Date: 7/8/22 \_\_\_\_\_

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS	
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)		
	1	EX-1	0.05	0.22	5.2	0.01	8.56	0.1													Free-release offsite to Eight Line Inc. property	
	2	EX-2	0.26	0.22	11.3	0.06	6.63	0.4													Free-release offsite to Alvarado property	
	3	EX-3	0.39	0.25	11.2	0.10	6.65	0.7													Free-release offsite to Peterson Road	
	4	EX-4	0.03	0.63	5.0	0.02	8.68	0.2													Free-release offsite to Constitution Avenue	
	5	EX-5	2.69	0.27	11.7	0.73	6.54	4.8													Free-release offsite to Eight Line Inc. property	
	6	EX-6	0.36	0.22	11.1	0.08	6.67	0.5													Free-release offsite to Canada Drive	



## COMPOSITE % IMPERVIOUS CALCULATIONS

### Proposed Conditions

**Subdivision:** \_\_\_\_\_  
**Location:** CO, Colorado Springs

**Project Name:** 6855 Constitution Ave Storage Site  
**Project No.:** JDA000002  
**Calculated By:** DDJ  
**Checked By:** BS  
**Date:** 9/23/22

Basin ID	Total Area (ac)	Paved Roads			Lawns			Roofs			Basins Total Weighted % Imp.
		% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	% Imp.	Area (ac)	Weighted % Imp.	
PR-1	0.24	100	0.00	0.0	2	0.24	2.0	90	0.00	0.00	2.0
PR-2A	0.11	100	0.04	39.7	2	0.07	1.2	90	0.00	0.00	40.9
PR-2B	0.01	100	0.008	75.5	2	0.003	0.5	90	0.00	0.00	76.0
PR-3	0.22	100	0.07	30.8	2	0.15	1.4	90	0.00	0.00	32.2
PR-4	0.25	100	0.09	35.9	2	0.16	1.3	90	0.00	0.00	37.2
PR-5	1.32	100	0.00	0.0	2	0.00	0.0	90	1.32	90.00	90.0
PR-6	0.83	100	0.49	58.6	2	0.34	0.8	90	0.00	0.00	59.4
PR-7	0.19	100	0.17	91.7	2	0.02	0.2	90	0.00	0.00	91.9
PR-8	0.13	100	0.00	0.0	2	0.13	2.0	90	0.00	0.00	2.0
PR-9	0.17	100	0.13	77.8	2	0.04	0.4	90	0.00	0.00	78.2
PR-10	0.31	100	0.00	0.0	2	0.31	2.0	90	0.00	0.00	2.0

**STANDARD FORM SF-2  
TIME OF CONCENTRATION**

Proposed Conditions

Subdivision: \_\_\_\_\_  
Location: CO, Colorado Springs

Project Name: 6855 Constitution Ave Storage Site  
Project No.: JDA000002  
Calculated By: DDJ  
Checked By: BS  
Date: 9/23/22

SUB-BASIN DATA						INITIAL/OVERLAND (T <sub>i</sub> )			TRAVEL TIME (T <sub>t</sub> )					T <sub>c</sub> CHECK (URBANIZED BASINS)			FINAL T <sub>c</sub>
BASIN ID	D.A. (AC)	Hydrologic Soils Group	Impervious (%)	C <sub>100</sub>	C <sub>5</sub>	L (FT)	S (%)	T <sub>i</sub> (MIN)	L (FT)	S (%)	C <sub>v</sub>	VEL. (FPS)	T <sub>t</sub> (MIN)	COMP. T <sub>c</sub> (MIN)	TOTAL LENGTH (FT)	Urbanized T <sub>c</sub> (MIN)	T <sub>c</sub> (MIN)
PR-1	0.24	A	2.0	0.22	0.00	137	10.0	10.9	0	3.0	20.0	3.5	0.0	10.9	137.0	10.8	10.8
PR-2A	0.11	A	40.9	0.41	0.25	42	2.0	8.0	54	2.0	20.0	2.8	0.3	8.3	96.0	10.5	8.3
PR-2B	0.01	A	76.0	0.62	0.51												5.0
PR-3	0.22	A	32.2	0.38	0.20												5.0
PR-4	0.25	A	37.2	0.40	0.23	93	6.0	8.5	0	3.0	20.0	3.5	0.0	8.5	93.0	10.5	8.5
PR-5	1.32	A	90.0	0.79	0.71												5.0
PR-6	0.83	A	59.4	0.49	0.36	57	2.0	8.1	370	0.5	20.0	1.4	4.4	12.5	427.0	12.4	12.4
PR-7	0.19	A	91.9	0.81	0.74	42	2.0	3.4	47	0.5	20.0	1.4	0.6	3.9	89.0	10.5	5.0
PR-8	0.13	A	2.0	0.22	0.00	25	2.0	8.0	390	2.5	20.0	3.2	2.1	10.0	415.0	12.3	10.0
PR-9	0.17	A	78.2	0.64	0.54	96	4.0	6.3	59	4.0	20.0	4.0	0.2	6.6	155.0	10.9	6.6
PR-10	0.31	A	2.0	0.22	0.00												5.0

**NOTES:**

$T_i = (0.395 * (1.1 - C_5) * (L)^{0.5}) / ((S)^{0.33})$ , S in ft/ft

$T_t = L / 60V$  (Velocity From Fig. 501)

Velocity  $V = C_v * S^{0.5}$ , S in ft/ft

$T_c \text{ Check} = 10 + L / 180$

For Urbanized basins a minimum T<sub>c</sub> of 5.0 minutes is required.

For non-urbanized basins a minimum T<sub>c</sub> of 10.0 minutes is required

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

Subdivision: \_\_\_\_\_  
Location: CO, Colorado Springs \_\_\_\_\_  
Design Storm: 2-Year \_\_\_\_\_

Project Name: 6855 Constitution Ave Storage Site \_\_\_\_\_  
Project No.: JDA000002 \_\_\_\_\_  
Calculated By: DDJ \_\_\_\_\_  
Checked By: BS \_\_\_\_\_  
Date: 9/23/22 \_\_\_\_\_

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
	1	PR-1	0.24	0.00	10.8	0.00	3.21	0.0													Free Release to Alvarado property
	2A	PR-2A	0.11	0.25	8.3	0.03	3.51	0.1													Free Release to Peterson Road
	2B	PR-2B	0.01	0.51	5.0	0.01	4.12	0.0													Free Release to Peterson Road
	3	PR-3	0.22	0.20	5.0	0.04	4.12	0.2													Free Release to Constitution Avenue
	4	PR-4	0.25	0.23	8.5	0.06	3.49	0.2													Free Release to Canada Drive
	5	PR-5	1.32	0.71	5.0	0.94	4.12	3.9													Roof drains to DP-6B
	6A	PR-6	0.83	0.36	12.4	0.30	3.04	0.9													D-10R inlet to DP-6B
	6B								12.4	1.24	3.04	3.8									Max flow at DP-6B to DP-7
	7	PR-7	0.19	0.74	5.0	0.14	4.12	0.6	12.4	1.38	3.04	4.2									D-10R inlet & Maximum flow at DP-7 to DP-8
	8	PR-8	0.13	0.00	10.0	0.00	3.29	0.0	12.4	1.38	3.04	4.2									Area inlet & Flows from PR-5, PR-6, PR-7, PR-8 into FSD
	9	PR-9	0.17	0.54	6.6	0.09	3.79	0.3													Max flow at DP-9 into FSD
	10	PR-10	0.31	0.00	5.0	0.00	4.12	0.0	12.4	1.47	3.04	4.5									Maximum flow into FSD

**STANDARD FORM SF-3**  
**STORM DRAINAGE SYSTEM DESIGN**  
(RATIONAL METHOD PROCEDURE)

Subdivision: \_\_\_\_\_  
 Location: CO, Colorado Springs \_\_\_\_\_  
 Design Storm: 100-Year \_\_\_\_\_

Project Name: 6855 Constitution Ave Storage Site \_\_\_\_\_  
 Project No.: JDA000002 \_\_\_\_\_  
 Calculated By: DDJ \_\_\_\_\_  
 Checked By: BS \_\_\_\_\_  
 Date: 9/23/22 \_\_\_\_\_

STREET	Design Point	DIRECT RUNOFF							TOTAL RUNOFF				STREET		PIPE			TRAVEL TIME			REMARKS
		Basin ID	Area (Ac)	Runoff Coeff.	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Tc (min)	C*A (Ac)	I (in/hr)	Q (cfs)	Slope (%)	Street Flow (cfs)	Design Flow (cfs)	Slope (%)	Pipe Size (inches)	Length (ft)	Velocity (fps)	Tt (min)	
	1	PR-1	0.24	0.22	10.8	0.05	6.75	0.3													Free Release to Alvarado property
	2A	PR-2A	0.11	0.41	8.3	0.04	7.39	0.3													Free Release to Peterson Road
	2B	PR-2B	0.01	0.62	5.0	0.01	8.68	0.1													Free Release to Peterson Road
	3	PR-3	0.22	0.38	5.0	0.08	8.68	0.7													Free Release to Constitution Avenue
	4	PR-4	0.25	0.40	8.5	0.10	7.35	0.7													Free Release to Canada Drive
	5	PR-5	1.32	0.79	5.0	1.04	8.68	9.0													Roof drains to DP-6B
	6A	PR-6	0.83	0.49	12.4	0.41	6.40	2.6													D-10R inlet to DP-6B
	6B								12.4	1.45	6.40	9.3									Max flow at DP-6B to DP-7
	7	PR-7	0.19	0.81	5.0	0.15	8.68	1.3	12.4	1.60	6.40	10.2									D-10R inlet & Maximum flow at DP-7 to DP-8
	8	PR-8	0.13	0.22	10.0	0.03	6.92	0.2	12.4	1.63	6.40	10.4									Area inlet & Flows from PR-5, PR-6, PR-7, PR-8 into FSD
	9	PR-9	0.17	0.64	6.6	0.11	7.99	0.9													Max flow at DP-9 into FSD
	10	PR-10	0.31	0.22	5.0	0.07	8.68	0.6	12.4	1.81	6.40	11.6									Maximum flow into FSD

## **APPENDIX C**


### **Hydraulic Computations**



## ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)


**Project:** 6855 Constitution Ave Self Storage  
**Inlet ID:** INLET DP-6A

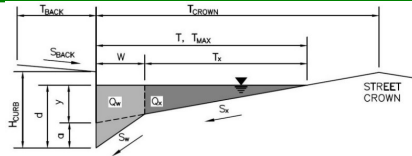

<p><b>Gutter Geometry:</b></p> <p>Maximum Allowable Width for Spread Behind Curb                  Side Slope Behind Curb (leave blank for no conveyance credit behind curb)                  Manning's Roughness Behind Curb (typically between 0.012 and 0.020)</p> <p>Height of Curb at Gutter Flow Line                  Distance from Curb Face to Street Crown                  Gutter Width                  Street Transverse Slope                  Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)                  Street Longitudinal Slope - Enter 0 for sump condition                  Manning's Roughness for Street Section (typically between 0.012 and 0.020)</p> <p>Max. Allowable Spread for Minor &amp; Major Storm                  Max. Allowable Depth at Gutter Flowline for Minor &amp; Major Storm                  Check boxes are not applicable in SUMP conditions</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr><td>T<sub>BACK</sub> =</td><td>5.0</td><td>ft</td></tr> <tr><td>S<sub>BACK</sub> =</td><td>0.020</td><td>ft/ft</td></tr> <tr><td>n<sub>BACK</sub> =</td><td>0.013</td><td></td></tr> <tr><td>H<sub>CURB</sub> =</td><td>6.00</td><td>inches</td></tr> <tr><td>T<sub>CROWN</sub> =</td><td>120.0</td><td>ft</td></tr> <tr><td>W =</td><td>2.00</td><td>ft</td></tr> <tr><td>S<sub>X</sub> =</td><td>0.005</td><td>ft/ft</td></tr> <tr><td>S<sub>W</sub> =</td><td>0.083</td><td>ft/ft</td></tr> <tr><td>S<sub>O</sub> =</td><td>0.000</td><td>ft/ft</td></tr> <tr><td>n<sub>STREET</sub> =</td><td>0.016</td><td></td></tr> </table> <table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th></th> <th>Minor Storm</th> <th>Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>T<sub>MAX</sub> =</td> <td>25.0</td> <td>40.0</td> <td>ft</td> </tr> <tr> <td>d<sub>MAX</sub> =</td> <td>6.0</td> <td>8.0</td> <td>inches</td> </tr> <tr> <td></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td></td> </tr> </tbody> </table>	T <sub>BACK</sub> =	5.0	ft	S <sub>BACK</sub> =	0.020	ft/ft	n <sub>BACK</sub> =	0.013		H <sub>CURB</sub> =	6.00	inches	T <sub>CROWN</sub> =	120.0	ft	W =	2.00	ft	S <sub>X</sub> =	0.005	ft/ft	S <sub>W</sub> =	0.083	ft/ft	S <sub>O</sub> =	0.000	ft/ft	n <sub>STREET</sub> =	0.016			Minor Storm	Major Storm		T <sub>MAX</sub> =	25.0	40.0	ft	d <sub>MAX</sub> =	6.0	8.0	inches		<input type="checkbox"/>	<input type="checkbox"/>																							
T <sub>BACK</sub> =	5.0	ft																																																																			
S <sub>BACK</sub> =	0.020	ft/ft																																																																			
n <sub>BACK</sub> =	0.013																																																																				
H <sub>CURB</sub> =	6.00	inches																																																																			
T <sub>CROWN</sub> =	120.0	ft																																																																			
W =	2.00	ft																																																																			
S <sub>X</sub> =	0.005	ft/ft																																																																			
S <sub>W</sub> =	0.083	ft/ft																																																																			
S <sub>O</sub> =	0.000	ft/ft																																																																			
n <sub>STREET</sub> =	0.016																																																																				
	Minor Storm	Major Storm																																																																			
T <sub>MAX</sub> =	25.0	40.0	ft																																																																		
d <sub>MAX</sub> =	6.0	8.0	inches																																																																		
	<input type="checkbox"/>	<input type="checkbox"/>																																																																			
<p><b>Maximum Capacity for 1/2 Street based On Allowable Spread</b></p> <p>Water Depth without Gutter Depression (Eq. ST-2)                  Vertical Depth between Gutter Lip and Gutter Flowline (usually 2")                  Gutter Depression (d<sub>c</sub> - (W * S<sub>x</sub> * 12))                  Water Depth at Gutter Flowline                  Allowable Spread for Discharge outside the Gutter Section W (T - W)                  Gutter Flow to Design Flow Ratio by FHWA HEC-22 method (Eq. ST-7)                  Discharge outside the Gutter Section W, carried in Section T<sub>x</sub>                  Discharge within the Gutter Section W (Q<sub>T</sub> - Q<sub>x</sub>)                  Discharge Behind the Curb (e.g., sidewalk, driveways, &amp; lawns)                  Maximum Flow Based On Allowable Spread                  Flow Velocity within the Gutter Section                  V*d Product: Flow Velocity times Gutter Flowline Depth</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th>Minor Storm</th> <th>Major Storm</th> <th></th> </tr> </thead> <tbody> <tr><td>y =</td><td>1.50</td><td>2.40</td><td>inches</td></tr> <tr><td>d<sub>c</sub> =</td><td>2.0</td><td>2.0</td><td>inches</td></tr> <tr><td>a =</td><td>1.87</td><td>1.87</td><td>inches</td></tr> <tr><td>d =</td><td>3.37</td><td>4.27</td><td>inches</td></tr> <tr><td>T<sub>x</sub> =</td><td>23.0</td><td>38.0</td><td>ft</td></tr> <tr><td>E<sub>o</sub> =</td><td>0.372</td><td>0.207</td><td></td></tr> <tr><td>Q<sub>x</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>w</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>BACK</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>T</sub> =</td><td>SUMP</td><td>SUMP</td><td>cfs</td></tr> <tr><td>V =</td><td>0.0</td><td>0.0</td><td>fps</td></tr> <tr><td>V*d =</td><td>0.0</td><td>0.0</td><td></td></tr> </tbody> </table>		Minor Storm	Major Storm		y =	1.50	2.40	inches	d <sub>c</sub> =	2.0	2.0	inches	a =	1.87	1.87	inches	d =	3.37	4.27	inches	T <sub>x</sub> =	23.0	38.0	ft	E <sub>o</sub> =	0.372	0.207		Q <sub>x</sub> =	0.0	0.0	cfs	Q <sub>w</sub> =	0.0	0.0	cfs	Q <sub>BACK</sub> =	0.0	0.0	cfs	Q <sub>T</sub> =	SUMP	SUMP	cfs	V =	0.0	0.0	fps	V*d =	0.0	0.0																	
	Minor Storm	Major Storm																																																																			
y =	1.50	2.40	inches																																																																		
d <sub>c</sub> =	2.0	2.0	inches																																																																		
a =	1.87	1.87	inches																																																																		
d =	3.37	4.27	inches																																																																		
T <sub>x</sub> =	23.0	38.0	ft																																																																		
E <sub>o</sub> =	0.372	0.207																																																																			
Q <sub>x</sub> =	0.0	0.0	cfs																																																																		
Q <sub>w</sub> =	0.0	0.0	cfs																																																																		
Q <sub>BACK</sub> =	0.0	0.0	cfs																																																																		
Q <sub>T</sub> =	SUMP	SUMP	cfs																																																																		
V =	0.0	0.0	fps																																																																		
V*d =	0.0	0.0																																																																			
<p><b>Maximum Capacity for 1/2 Street based on Allowable Depth</b></p> <p>Theoretical Water Spread                  Theoretical Spread for Discharge outside the Gutter Section W (T - W)                  Gutter Flow to Design Flow Ratio by FHWA HEC-22 method (Eq. ST-7)                  Theoretical Discharge outside the Gutter Section W, carried in Section T<sub>x,TH</sub>                  Actual Discharge outside the Gutter Section W, (limited by distance T<sub>CROWN</sub>)                  Discharge within the Gutter Section W (Q<sub>d</sub> - Q<sub>x</sub>)                  Discharge Behind the Curb (e.g., sidewalk, driveways, &amp; lawns)                  Total Discharge for Major &amp; Minor Storm (Pre-Safety Factor)                  Average Flow Velocity Within the Gutter Section                  V*d Product: Flow Velocity Times Gutter Flowline Depth                  Slope-Based Depth Safety Reduction Factor for Major &amp; Minor (d ≥ 6") Storm                  Max Flow Based on Allowable Depth (Safety Factor Applied)                  Resultant Flow Depth at Gutter Flowline (Safety Factor Applied)                  Resultant Flow Depth at Street Crown (Safety Factor Applied)</p>	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th>Minor Storm</th> <th>Major Storm</th> <th></th> </tr> </thead> <tbody> <tr><td>T<sub>TH</sub> =</td><td>68.8</td><td>102.1</td><td>ft</td></tr> <tr><td>T<sub>x,TH</sub> =</td><td>66.8</td><td>100.1</td><td>ft</td></tr> <tr><td>E<sub>o</sub> =</td><td>0.104</td><td>0.065</td><td></td></tr> <tr><td>Q<sub>x,TH</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>x</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>w</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>BACK</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>Q<sub>d</sub> =</td><td>0.0</td><td>0.0</td><td>cfs</td></tr> <tr><td>V =</td><td>0.0</td><td>0.0</td><td>fps</td></tr> <tr><td>V*d =</td><td>0.0</td><td>0.0</td><td></td></tr> <tr><td>R =</td><td>SUMP</td><td>SUMP</td><td></td></tr> <tr><td>Q<sub>d</sub> =</td><td>SUMP</td><td>SUMP</td><td>cfs</td></tr> <tr><td>d =</td><td></td><td></td><td>inches</td></tr> <tr><td>d<sub>CROWN</sub> =</td><td></td><td></td><td>inches</td></tr> </tbody> </table> <table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th></th> <th>Minor Storm</th> <th>Major Storm</th> <th></th> </tr> </thead> <tbody> <tr> <td>Q<sub>allow</sub> =</td> <td>SUMP</td> <td>SUMP</td> <td>cfs</td> </tr> </tbody> </table>		Minor Storm	Major Storm		T <sub>TH</sub> =	68.8	102.1	ft	T <sub>x,TH</sub> =	66.8	100.1	ft	E <sub>o</sub> =	0.104	0.065		Q <sub>x,TH</sub> =	0.0	0.0	cfs	Q <sub>x</sub> =	0.0	0.0	cfs	Q <sub>w</sub> =	0.0	0.0	cfs	Q <sub>BACK</sub> =	0.0	0.0	cfs	Q <sub>d</sub> =	0.0	0.0	cfs	V =	0.0	0.0	fps	V*d =	0.0	0.0		R =	SUMP	SUMP		Q <sub>d</sub> =	SUMP	SUMP	cfs	d =			inches	d <sub>CROWN</sub> =			inches		Minor Storm	Major Storm		Q <sub>allow</sub> =	SUMP	SUMP	cfs
	Minor Storm	Major Storm																																																																			
T <sub>TH</sub> =	68.8	102.1	ft																																																																		
T <sub>x,TH</sub> =	66.8	100.1	ft																																																																		
E <sub>o</sub> =	0.104	0.065																																																																			
Q <sub>x,TH</sub> =	0.0	0.0	cfs																																																																		
Q <sub>x</sub> =	0.0	0.0	cfs																																																																		
Q <sub>w</sub> =	0.0	0.0	cfs																																																																		
Q <sub>BACK</sub> =	0.0	0.0	cfs																																																																		
Q <sub>d</sub> =	0.0	0.0	cfs																																																																		
V =	0.0	0.0	fps																																																																		
V*d =	0.0	0.0																																																																			
R =	SUMP	SUMP																																																																			
Q <sub>d</sub> =	SUMP	SUMP	cfs																																																																		
d =			inches																																																																		
d <sub>CROWN</sub> =			inches																																																																		
	Minor Storm	Major Storm																																																																			
Q <sub>allow</sub> =	SUMP	SUMP	cfs																																																																		
<p>MINOR STORM Allowable Capacity is based on Depth Criterion                  MAJOR STORM Allowable Capacity is based on Depth Criterion</p>																																																																					

# INLET IN A SUMP OR SAG LOCATION

MHFD-Inlet, Version 5.01 (April 2021)

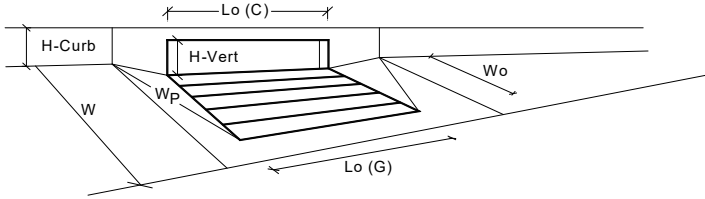


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Colorado Springs D-10-R		
Local Depression (additional to continuous gutter depression 'a' from above)	4.00	4.00	inches
Number of Unit Inlets (Grate or Curb Opening)	1	1	
Water Depth at Flowline (outside of local depression)	3.4	4.3	inches
<b>Grate Information</b>			
Length of a Unit Grate	N/A	N/A	feet
Width of a Unit Grate	N/A	N/A	feet
Area Opening Ratio for a Grate (typical values 0.15-0.90)	N/A	N/A	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	N/A	N/A	
Grate Weir Coefficient (typical value 2.15 - 3.60)	N/A	N/A	
Grate Orifice Coefficient (typical value 0.60 - 0.80)	N/A	N/A	
<b>Curb Opening Information</b>			
Length of a Unit Curb Opening	8.00	8.00	feet
Height of Vertical Curb Opening in Inches	8.00	8.00	inches
Height of Curb Orifice Throat in Inches	8.00	8.00	inches
Angle of Throat (see USDCM Figure ST-5)	81.00	81.00	degrees
Side Width for Depression Pan (typically the gutter width of 2 feet)	2.00	2.00	feet
Clogging Factor for a Single Curb Opening (typical value 0.10)	0.10	0.10	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	3.60	3.60	
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	0.67	0.67	
<b>Low Head Performance Reduction (Calculated)</b>			
Depth for Grate Midwidth	N/A	N/A	ft
Depth for Curb Opening Weir Equation	0.12	0.19	ft
Combination Inlet Performance Reduction Factor for Long Inlets	0.34	0.43	
Curb Opening Performance Reduction Factor for Long Inlets	0.81	0.89	
Grated Inlet Performance Reduction Factor for Long Inlets	N/A	N/A	
Total Inlet Interception Capacity (assumes clogged condition)	1.2	2.9	cfs
<b>Inlet Capacity IS GOOD for Minor and Major Storms(&gt;0 PEAK)</b>	0.9	2.6	cfs

## ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

**Project:** 6855 Constitution Ave Self Storage  
**Inlet ID:** INLET DP-9

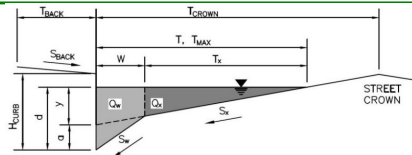

**Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)  
 Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

T <sub>BACK</sub> =	5.0	ft	
S <sub>BACK</sub> =	0.020	ft/ft	
n <sub>BACK</sub> =	0.013		
H <sub>CURB</sub> =	6.00	inches	
T <sub>CROWN</sub> =	27.0	ft	
W =	2.00	ft	
S <sub>X</sub> =	0.020	ft/ft	
S <sub>W</sub> =	0.083	ft/ft	
S <sub>O</sub> =	0.041	ft/ft	
n <sub>STREET</sub> =	0.016		
Minor Storm      Major Storm			
T <sub>MAX</sub> =	5.0	9.0	ft
d <sub>MAX</sub> =	6.0	8.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Allow Flow Depth at Street Crown (check box for yes, leave blank for no)

**Maximum Capacity for 1/2 Street based On Allowable Spread**

Water Depth without Gutter Depression (Eq. ST-2)  
 Vertical Depth between Gutter Lip and Gutter Flowline (usually 2")  
 Gutter Depression ( $d_c - (W * S_x * 12)$ )  
 Water Depth at Gutter Flowline  
 Allowable Spread for Discharge outside the Gutter Section W (T - W)  
 Gutter Flow to Design Flow Ratio by FHWA HEC-22 method (Eq. ST-7)  
 Discharge outside the Gutter Section W, carried in Section T<sub>X</sub>  
 Discharge within the Gutter Section W (Q<sub>T</sub> - Q<sub>X</sub>)  
 Discharge Behind the Curb (e.g., sidewalk, driveways, & lawns)  
 Maximum Flow Based On Allowable Spread  
 Flow Velocity within the Gutter Section  
 V\*d Product: Flow Velocity times Gutter Flowline Depth

	Minor Storm	Major Storm	
y =	1.20	2.16	inches
d <sub>c</sub> =	2.0	2.0	inches
a =	1.51	1.51	inches
d =	2.71	3.67	inches
T <sub>X</sub> =	3.0	7.0	ft
E <sub>O</sub> =	0.889	0.629	
Q <sub>X</sub> =	0.2	1.9	cfs
Q <sub>W</sub> =	1.6	3.2	cfs
Q <sub>BACK</sub> =	0.0	0.0	cfs
<b>Q<sub>T</sub> =</b>	<b>1.8</b>	<b>5.1</b>	<b>cfs</b>
V =	5.5	7.2	fps
V*d =	1.2	2.2	

**Maximum Capacity for 1/2 Street based on Allowable Depth**

Theoretical Water Spread  
 Theoretical Spread for Discharge outside the Gutter Section W (T - W)  
 Gutter Flow to Design Flow Ratio by FHWA HEC-22 method (Eq. ST-7)  
 Theoretical Discharge outside the Gutter Section W, carried in Section T<sub>X,TH</sub>  
 Actual Discharge outside the Gutter Section W, (limited by distance T<sub>CROWN</sub>)  
 Discharge within the Gutter Section W (Q<sub>d</sub> - Q<sub>X</sub>)  
 Discharge Behind the Curb (e.g., sidewalk, driveways, & lawns)  
 Total Discharge for Major & Minor Storm (Pre-Safety Factor)  
 Average Flow Velocity Within the Gutter Section  
 V\*d Product: Flow Velocity Times Gutter Flowline Depth  
 Slope-Based Depth Safety Reduction Factor for Major & Minor (d ≥ 6") Storm  
 Max Flow Based on Allowable Depth (Safety Factor Applied)  
 Resultant Flow Depth at Gutter Flowline (Safety Factor Applied)  
 Resultant Flow Depth at Street Crown (Safety Factor Applied)

	Minor Storm	Major Storm	
T <sub>TH</sub> =	18.7	27.0	ft
T <sub>X,TH</sub> =	16.7	25.0	ft
E <sub>O</sub> =	0.318	0.216	
Q <sub>X,TH</sub> =	19.1	56.3	cfs
Q <sub>X</sub> =	19.1	56.3	cfs
Q <sub>W</sub> =	8.9	15.5	cfs
Q <sub>BACK</sub> =	0.0	3.4	cfs
Q =	28.0	75.2	cfs
V =	10.7	13.3	fps
V*d =	5.3	8.9	
R =	0.58	0.47	
<b>Q<sub>d</sub> =</b>	<b>16.1</b>	<b>35.0</b>	<b>cfs</b>
d =	5.10	6.41	inches
d <sub>CROWN</sub> =	0.00	0.00	inches


MINOR STORM Allowable Capacity is based on Spread Criterion  
 MAJOR STORM Allowable Capacity is based on Spread Criterion

	Minor Storm	Major Storm	
<b>Q<sub>allow</sub> =</b>	<b>1.8</b>	<b>5.1</b>	<b>cfs</b>

**Minor storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'**  
**Major storm max. allowable capacity GOOD - greater than the design flow given on sheet 'Inlet Management'**

# INLET ON A CONTINUOUS GRADE

MHFD-Inlet, Version 5.01 (April 2021)

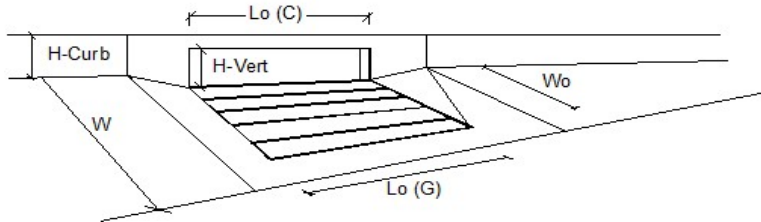


Design Information (Input)	MINOR	MAJOR	
Type of Inlet	Colorado Springs D-10-R		
Local Depression (additional to continuous gutter depression 'a')	a <sub>LOCAL</sub> = 4.0	4.0	inches
Total Number of Units in the Inlet (Grate or Curb Opening)	No = 1	1	
Length of a Single Unit Inlet (Grate or Curb Opening)	L <sub>o</sub> = 6.00	6.00	ft
Width of a Unit Grate (cannot be greater than W, Gutter Width)	W <sub>o</sub> = N/A	N/A	ft
Clogging Factor for a Single Unit Grate (typical min. value = 0.5)	C <sub>r-G</sub> = N/A	N/A	
Clogging Factor for a Single Unit Curb Opening (typical min. value = 0.1)	C <sub>r-C</sub> = 0.10	0.10	
<b>Street Hydraulics: OK - Q &lt; Allowable Street Capacity</b>			
Design Discharge for Half of Street (from <i>Inlet Management</i> )	Q <sub>o</sub> = 0.5	0.9	cfs
Water Spread Width	T = 1.8	2.2	ft
Water Depth at Flowline (outside of local depression)	d = 1.8	2.0	inches
Water Depth at Street Crown (or at T <sub>MAX</sub> )	d <sub>CROWN</sub> = 0.0	0.0	inches
Ratio of Gutter Flow to Design Flow	E <sub>o</sub> = 1.000	1.011	
Discharge outside the Gutter Section W, carried in Section T <sub>x</sub>	Q <sub>x</sub> = 0.0	0.0	cfs
Discharge within the Gutter Section W	Q <sub>w</sub> = 0.5	0.9	cfs
Discharge Behind the Curb Face	Q <sub>BACK</sub> = 0.0	0.0	cfs
Flow Area within the Gutter Section W	A <sub>w</sub> = 0.13	0.17	sq ft
Velocity within the Gutter Section W	V <sub>w</sub> = 4.0	5.2	fps
Water Depth for Design Condition	d <sub>LOCAL</sub> = 5.8	6.0	inches
<b>Grate Analysis (Calculated)</b>			
Total Length of Inlet Grate Opening	L = N/A	N/A	ft
Ratio of Grate Flow to Design Flow	E <sub>o-GRATE</sub> = N/A	N/A	
<b>Under No-Clogging Condition</b>			
Minimum Velocity Where Grate Splash-Over Begins	V <sub>o</sub> = N/A	N/A	fps
Interception Rate of Frontal Flow	R <sub>f</sub> = N/A	N/A	
Interception Rate of Side Flow	R <sub>s</sub> = N/A	N/A	
Interception Capacity	Q <sub>i</sub> = N/A	N/A	cfs
<b>Under Clogging Condition</b>			
Clogging Coefficient for Multiple-unit Grate Inlet	GrateCoef = N/A	N/A	
Clogging Factor for Multiple-unit Grate Inlet	GrateClog = N/A	N/A	
Effective (unclogged) Length of Multiple-unit Grate Inlet	L <sub>e</sub> = N/A	N/A	ft
Minimum Velocity Where Grate Splash-Over Begins	V <sub>o</sub> = N/A	N/A	fps
Interception Rate of Frontal Flow	R <sub>f</sub> = N/A	N/A	
Interception Rate of Side Flow	R <sub>s</sub> = N/A	N/A	
Actual Interception Capacity	Q <sub>a</sub> = N/A	N/A	cfs
Carry-Over Flow = Q <sub>o</sub> - Q <sub>a</sub> (to be applied to curb opening or next d/s inlet)	Q <sub>b</sub> = N/A	N/A	cfs
<b>Curb or Slotted Inlet Opening Analysis (Calculated)</b>			
Equivalent Slope S <sub>e</sub> (based on grate carry-over)	S <sub>e</sub> = 0.250	0.250	ft/ft
Required Length L <sub>T</sub> to Have 100% Interception	L <sub>T</sub> = 2.81	3.80	ft
<b>Under No-Clogging Condition</b>			
Effective Length of Curb Opening or Slotted Inlet (minimum of L, L <sub>T</sub> )	L = 2.81	3.80	ft
Interception Capacity	Q <sub>i</sub> = 0.5	0.9	cfs
<b>Under Clogging Condition</b>			
Clogging Coefficient	CurbCoef = 1.00	1.00	
Clogging Factor for Multiple-unit Curb Opening or Slotted Inlet	CurbClog = 0.08	0.08	
Effective (Unclogged) Length	L <sub>e</sub> = 5.40	5.40	ft
Actual Interception Capacity	Q <sub>a</sub> = 0.5	0.9	cfs
Carry-Over Flow = Q <sub>o</sub> - Q <sub>a</sub>	Q <sub>b</sub> = 0.0	0.0	cfs
<b>Summary</b>			
Total Inlet Interception Capacity	Q = 0.5	0.9	cfs
Total Inlet Carry-Over Flow (flow bypassing inlet)	Q <sub>b</sub> = 0.0	0.0	cfs
Capture Percentage = Q <sub>a</sub> /Q <sub>o</sub> =	C% = 100	100	%

## ALLOWABLE CAPACITY FOR ONE-HALF OF STREET (Minor & Major Storm)

(Based on Regulated Criteria for Maximum Allowable Flow Depth and Spread)

**Project:** 6855 Constitution Ave Self Storage

**Inlet ID:** INLET DP-7

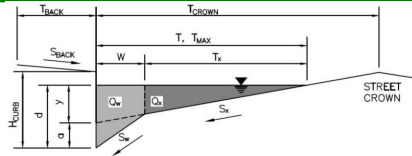

**Gutter Geometry:**

Maximum Allowable Width for Spread Behind Curb  
 Side Slope Behind Curb (leave blank for no conveyance credit behind curb)  
 Manning's Roughness Behind Curb (typically between 0.012 and 0.020)

**Warning 01**

Height of Curb at Gutter Flow Line  
 Distance from Curb Face to Street Crown  
 Gutter Width  
 Street Transverse Slope  
 Gutter Cross Slope (typically 2 inches over 24 inches or 0.083 ft/ft)  
 Street Longitudinal Slope - Enter 0 for sump condition  
 Manning's Roughness for Street Section (typically between 0.012 and 0.020)

$T_{BACK} = 0.0$  ft  
 $S_{BACK} = 0.000$  ft/ft  
 $n_{BACK} = 0.035$

$H_{CURB} = 6.00$  inches  
 $T_{CROWN} = 36.0$  ft  
 $W = 2.00$  ft  
 $S_X = 0.020$  ft/ft  
 $S_W = 0.083$  ft/ft  
 $S_O = 0.000$  ft/ft  
 $n_{STREET} = 0.016$

Max. Allowable Spread for Minor & Major Storm  
 Max. Allowable Depth at Gutter Flowline for Minor & Major Storm  
 Check boxes are not applicable in SUMP conditions

	Minor Storm	Major Storm	
$T_{MAX}$	5.0	10.0	ft
$d_{MAX}$	6.0	6.0	inches
	<input type="checkbox"/>	<input type="checkbox"/>	

MINOR STORM Allowable Capacity is based on Depth Criterion  
 MAJOR STORM Allowable Capacity is based on Depth Criterion


$Q_{allow} =$ 

Minor Storm	Major Storm	
SUMP	SUMP	cfs

**Warning 01: Manning's n-value does not meet the USDCM recommended design range.**

# INLET IN A SUMP OR SAG LOCATION


MHFD-Inlet, Version 5.01 (April 2021)

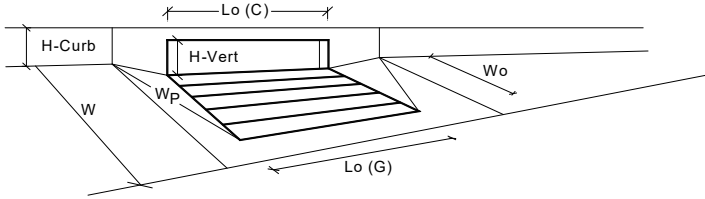

Design Information (Input)		MINOR		MAJOR	
Type of Inlet		Colorado Springs D-10-R			
Local Depression (additional to continuous gutter depression 'a' from above)	Type =	Colorado Springs D-10-R			
Number of Unit Inlets (Grate or Curb Opening)	$a_{local}$ =	4.00	4.00	inches	
Water Depth at Flowline (outside of local depression)	No =	6	6		
<b>Grate Information</b>		MINOR		MAJOR	
Length of a Unit Grate	Ponding Depth =	2.7	3.9	inches	
Width of a Unit Grate	$L_o$ (G) =	N/A	N/A	<input type="checkbox"/> Override Depths	
Area Opening Ratio for a Grate (typical values 0.15-0.90)	$W_o$ =	N/A	N/A	feet	
Clogging Factor for a Single Grate (typical value 0.50 - 0.70)	$A_{ratio}$ =	N/A	N/A		
Grate Weir Coefficient (typical value 2.15 - 3.60)	$C_f$ (G) =	N/A	N/A		
Grate Orifice Coefficient (typical value 0.60 - 0.80)	$C_w$ (G) =	N/A	N/A		
<b>Curb Opening Information</b>		MINOR		MAJOR	
Length of a Unit Curb Opening	$C_o$ (G) =	N/A	N/A		
Height of Vertical Curb Opening in Inches	$L_o$ (C) =	1.00	1.00	feet	
Height of Curb Orifice Throat in Inches	$H_{vert}$ =	8.00	8.00	inches	
Angle of Throat (see USDCM Figure ST-5)	$H_{throat}$ =	8.00	8.00	inches	
Side Width for Depression Pan (typically the gutter width of 2 feet)	Theta =	81.00	81.00	degrees	
Clogging Factor for a Single Curb Opening (typical value 0.10)	$W_o$ =	2.00	2.00	feet	
Curb Opening Weir Coefficient (typical value 2.3-3.7)	$C_f$ (C) =	0.10	0.10		
Curb Opening Orifice Coefficient (typical value 0.60 - 0.70)	$C_w$ (C) =	3.60	3.60		
	$C_o$ (C) =	0.67	0.67		
<b>Grate Flow Analysis (Calculated)</b>		MINOR		MAJOR	
Clogging Coefficient for Multiple Units	Coef =	N/A	N/A		
Clogging Factor for Multiple Units	Clog =	N/A	N/A		
<b>Grate Capacity as a Weir (based on Modified HEC22 Method)</b>		MINOR		MAJOR	
Interception without Clogging	$Q_{wi}$ =	N/A	N/A	cfs	
Interception with Clogging	$Q_{wa}$ =	N/A	N/A	cfs	
<b>Grate Capacity as a Orifice (based on Modified HEC22 Method)</b>		MINOR		MAJOR	
Interception without Clogging	$Q_{oi}$ =	N/A	N/A	cfs	
Interception with Clogging	$Q_{oa}$ =	N/A	N/A	cfs	
<b>Grate Capacity as Mixed Flow</b>		MINOR		MAJOR	
Interception without Clogging	$Q_{mi}$ =	N/A	N/A	cfs	
Interception with Clogging	$Q_{ma}$ =	N/A	N/A	cfs	
<b>Resulting Grate Capacity (assumes clogged condition)</b>	<b><math>Q_{Grate}</math> =</b>	<b>N/A</b>	<b>N/A</b>	<b>cfs</b>	
<b>Curb Opening Flow Analysis (Calculated)</b>		MINOR		MAJOR	
Clogging Coefficient for Multiple Units	Coef =	1.00	1.00		
Clogging Factor for Multiple Units	Clog =	0.08	0.08		
<b>Curb Opening as a Weir (based on Modified HEC22 Method)</b>		MINOR		MAJOR	
Interception without Clogging	$Q_{wi}$ =	1.2	6.1	cfs	
Interception with Clogging	$Q_{wa}$ =	1.1	5.6	cfs	
<b>Curb Opening as an Orifice (based on Modified HEC22 Method)</b>		MINOR		MAJOR	
Interception without Clogging	$Q_{oi}$ =	10.3	12.4	cfs	
Interception with Clogging	$Q_{oa}$ =	9.5	11.3	cfs	
<b>Curb Opening Capacity as Mixed Flow</b>		MINOR		MAJOR	
Interception without Clogging	$Q_{mi}$ =	3.3	8.1	cfs	
Interception with Clogging	$Q_{ma}$ =	3.0	7.4	cfs	
<b>Resulting Curb Opening Capacity (assumes clogged condition)</b>	<b><math>Q_{Curb}</math> =</b>	<b>1.1</b>	<b>5.6</b>	<b>cfs</b>	
<b>Resultant Street Conditions</b>		MINOR		MAJOR	
Total Inlet Length	L =	6.00	6.00	feet	
Resultant Street Flow Spread (based on street geometry from above)	T =	5.0	10.0	ft	
Resultant Flow Depth at Street Crown	$d_{CROWN}$ =	0.0	0.0	inches	
<b>Low Head Performance Reduction (Calculated)</b>		MINOR		MAJOR	
Depth for Grate Midwidth	$d_{Grate}$ =	N/A	N/A	ft	
Depth for Curb Opening Weir Equation	$d_{Curb}$ =	0.06	0.16	ft	
Combination Inlet Performance Reduction Factor for Long Inlets	$RF_{Combination}$ =	0.32	0.46		
Curb Opening Performance Reduction Factor for Long Inlets	$RF_{Curb}$ =	0.83	0.96		
Grated Inlet Performance Reduction Factor for Long Inlets	$RF_{Grate}$ =	N/A	N/A		
Total Inlet Interception Capacity (assumes clogged condition)	<b><math>Q_s</math> =</b>	<b>1.1</b>	<b>5.6</b>	<b>cfs</b>	
<b>Inlet Capacity IS GOOD for Minor and Major Storms(&gt;Q PEAK)</b>	<b><math>Q_{PEAK REQUIRED}</math> =</b>	<b>0.6</b>	<b>1.3</b>	<b>cfs</b>	

Warning 1: Dimension entered is not a typical dimension for inlet type specified.

**Figure 8-10. Inlet Capacity Chart Sump Conditions, Area (Type C) Inlet**

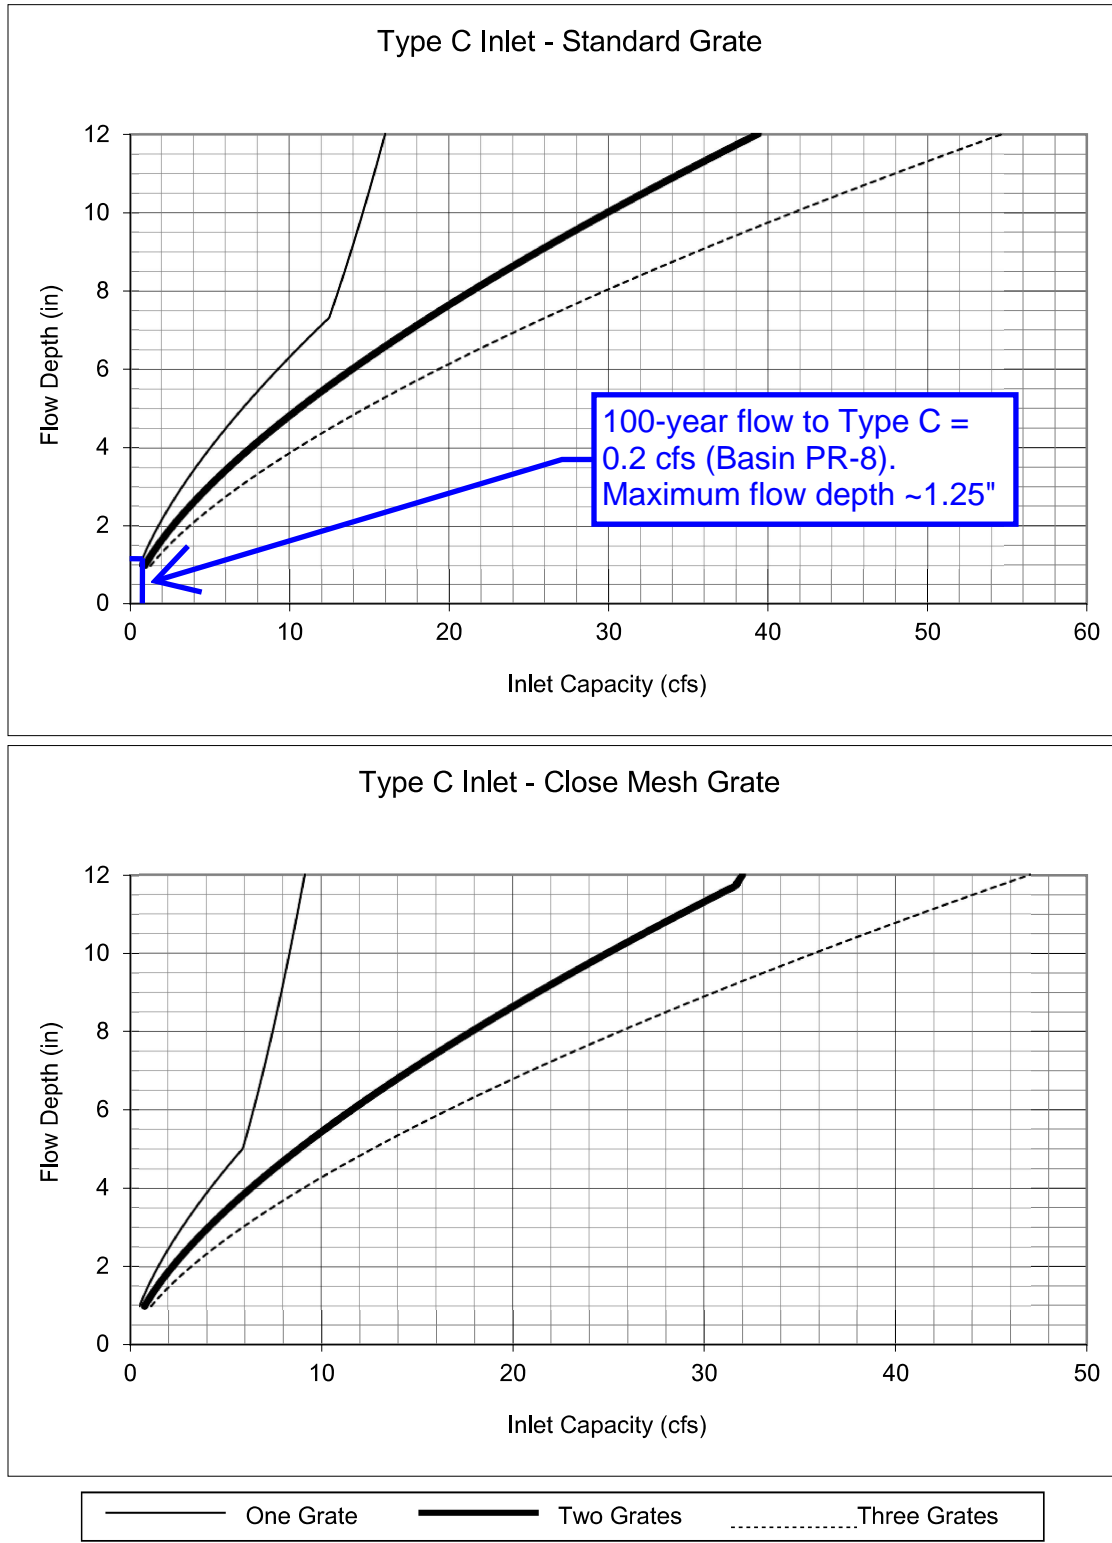

Notes:

1. The standard inlet parameters must apply to use these charts.

---

## 12" @ 0.5% Capacity

---

### Project Description

Friction Method	Manning Formula
Solve For	Full Flow Capacity

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00500	ft/ft
Normal Depth	1.00	ft
Diameter	1.00	ft
Discharge	2.52	ft <sup>3</sup> /s

### Results

Discharge	2.52	ft <sup>3</sup> /s
Normal Depth	1.00	ft
Flow Area	0.79	ft <sup>2</sup>
Wetted Perimeter	3.14	ft
Hydraulic Radius	0.25	ft
Top Width	0.00	ft
Critical Depth	0.68	ft
Percent Full	100.0	%
Critical Slope	0.00770	ft/ft
Velocity	3.21	ft/s
Velocity Head	0.16	ft
Specific Energy	1.16	ft
Froude Number	0.00	
Maximum Discharge	2.71	ft <sup>3</sup> /s
Discharge Full	2.52	ft <sup>3</sup> /s
Slope Full	0.00500	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%



---

## 12" @ 0.5% Capacity

---

### GVF Output Data

Normal Depth Over Rise	100.00	%
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	1.00	ft
Critical Depth	0.68	ft
Channel Slope	0.00500	ft/ft
Critical Slope	0.00770	ft/ft

---

## 18" @ 0.5% Capacity

---

### Project Description

Friction Method	Manning Formula
Solve For	Full Flow Capacity

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00500	ft/ft
Normal Depth	1.50	ft
Diameter	1.50	ft
Discharge	7.43	ft <sup>3</sup> /s

### Results

Discharge	7.43	ft <sup>3</sup> /s
Normal Depth	1.50	ft
Flow Area	1.77	ft <sup>2</sup>
Wetted Perimeter	4.71	ft
Hydraulic Radius	0.38	ft
Top Width	0.00	ft
Critical Depth	1.06	ft
Percent Full	100.0	%
Critical Slope	0.00703	ft/ft
Velocity	4.20	ft/s
Velocity Head	0.27	ft
Specific Energy	1.77	ft
Froude Number	0.00	
Maximum Discharge	7.99	ft <sup>3</sup> /s
Discharge Full	7.43	ft <sup>3</sup> /s
Slope Full	0.00500	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%

---

## 18" @ 0.5% Capacity

---

### GVF Output Data

Normal Depth Over Rise	100.00	%
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	1.50	ft
Critical Depth	1.06	ft
Channel Slope	0.00500	ft/ft
Critical Slope	0.00703	ft/ft

---

## 24" @ 0.5% Capacity

---

### Project Description

Friction Method	Manning Formula
Solve For	Full Flow Capacity

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00500	ft/ft
Normal Depth	2.00	ft
Diameter	2.00	ft
Discharge	16.00	ft <sup>3</sup> /s

### Results

Discharge	16.00	ft <sup>3</sup> /s
Normal Depth	2.00	ft
Flow Area	3.14	ft <sup>2</sup>
Wetted Perimeter	6.28	ft
Hydraulic Radius	0.50	ft
Top Width	0.00	ft
Critical Depth	1.44	ft
Percent Full	100.0	%
Critical Slope	0.00662	ft/ft
Velocity	5.09	ft/s
Velocity Head	0.40	ft
Specific Energy	2.40	ft
Froude Number	0.00	
Maximum Discharge	17.21	ft <sup>3</sup> /s
Discharge Full	16.00	ft <sup>3</sup> /s
Slope Full	0.00500	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%

---

## 24" @ 0.5% Capacity

---

### GVF Output Data

Normal Depth Over Rise	100.00	%
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	2.00	ft
Critical Depth	1.44	ft
Channel Slope	0.00500	ft/ft
Critical Slope	0.00662	ft/ft

## Curb Chase Capacity

### Project Description

Friction Method                      Manning Formula  
Solve For                                Normal Depth

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.02000	ft/ft
Bottom Width	2.00	ft
Discharge	0.62	ft <sup>3</sup> /s

### Results

Normal Depth	0.10	ft
Flow Area	0.19	ft <sup>2</sup>
Wetted Perimeter	2.19	ft
Hydraulic Radius	0.09	ft
Top Width	2.00	ft
Critical Depth	0.14	ft
Critical Slope	0.00562	ft/ft
Velocity	3.20	ft/s
Velocity Head	0.16	ft
Specific Energy	0.26	ft
Froude Number	1.82	
Flow Type	Supercritical	

Note: 100-year Release Rate from Private FSD-1 Pond

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.10	ft
Critical Depth	0.14	ft
Channel Slope	0.02000	ft/ft
Critical Slope	0.00562	ft/ft

## Basin PR-6 Swale

### Project Description

Friction Method                      Manning Formula  
 Solve For                                Normal Depth

### Input Data

Roughness Coefficient	0.035	
Channel Slope	0.04000	ft/ft
Left Side Slope	3.00	ft/ft (H:V)
Right Side Slope	3.00	ft/ft (H:V)
Discharge	1.00	ft <sup>3</sup> /s

### Results

Normal Depth	0.36	ft
Flow Area	0.38	ft <sup>2</sup>
Wetted Perimeter	2.26	ft
Hydraulic Radius	0.17	ft
Top Width	2.15	ft
Critical Depth	0.37	ft
Critical Slope	0.03362	ft/ft
Velocity	2.60	ft/s
Velocity Head	0.11	ft
Specific Energy	0.46	ft
Froude Number	1.08	
Flow Type	Supercritical	

Note: Flow reduced from PR-6 basin flow since swale only captures small portion of landscaped flows

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.36	ft
Critical Depth	0.37	ft
Channel Slope	0.04000	ft/ft
Critical Slope	0.03362	ft/ft

---

## Basin PR-8 Swale

---

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.035	
Channel Slope	0.02000	ft/ft
Left Side Slope	3.00	ft/ft (H:V)
Right Side Slope	3.00	ft/ft (H:V)
Discharge	0.20	ft <sup>3</sup> /s

### Results

Normal Depth	0.22	ft
Flow Area	0.15	ft <sup>2</sup>
Wetted Perimeter	1.41	ft
Hydraulic Radius	0.11	ft
Top Width	1.34	ft
Critical Depth	0.19	ft
Critical Slope	0.04167	ft/ft
Velocity	1.34	ft/s
Velocity Head	0.03	ft
Specific Energy	0.25	ft
Froude Number	0.71	
Flow Type	Subcritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Downstream Velocity	Infinity	ft/s
Upstream Velocity	Infinity	ft/s
Normal Depth	0.22	ft
Critical Depth	0.19	ft
Channel Slope	0.02000	ft/ft
Critical Slope	0.04167	ft/ft



## **APPENDIX D**

### **Pond Computations**

## Site-Level Low Impact Development (LID) Design Effective Impervious Calculator LID Credit by Impervious Reduction Factor (IRF) Method

UD-BMP (Version 3.06, November 2016)

User Input		
Calculated cells		
***Design Storm: 1-Hour Rain Depth	WQCV Event	0.60
***Minor Storm: 1-Hour Rain Depth	5-Year Event	1.50
***Major Storm: 1-Hour Rain Depth	100-Year Event	2.52
Optional User Defined Storm	CUHP	
(CUHP) NOAA 1 Hour Rainfall Depth and Frequency for User Defined Storm	100-Year Event	
Max Intensity for Optional User Defined Storm		0

**Designer:** DDJ  
**Company:** Galloway & Co.  
**Date:** September 21, 2022  
**Project:** 6855 Constitution Ave Self Storage  
**Location:** FSD

### SITE INFORMATION (USER-INPUT)

Sub-basin Identifier	PR-5	PR-6	PR-7	PR-8	PR-9	PR-10								
Receiving Pervious Area Soil Type	Sandy Loam	Sandy Loam	Sandy Loam	Sandy Loam	Sandy Loam	Sandy Loam								
Total Area (ac., Sum of DCIA, UIA, RPA, & SPA)	1.320	0.830	0.190	0.130	0.170	0.310								
Directly Connected Impervious Area (DCIA, acres)	1.320	0.490	0.170	0.000	0.130	0.000								
Unconnected Impervious Area (UIA, acres)	0.000	0.000	0.000	0.000	0.000	0.000								
Receiving Pervious Area (RPA, acres)	0.000	0.000	0.000	0.000	0.000	0.000								
Separate Pervious Area (SPA, acres)	0.000	0.340	0.020	0.130	0.040	0.310								
RPA Treatment Type: Conveyance (C), Volume (V), or Permeable Pavement (PP)	C	C	C	C	C	C								

### CALCULATED RESULTS (OUTPUT)

Total Calculated Area (ac, check against input)	1.320	0.830	0.190	0.130	0.170	0.310								
Directly Connected Impervious Area (DCIA, %)	100.0%	59.0%	89.5%	0.0%	76.5%	0.0%								
Unconnected Impervious Area (UIA, %)	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%								
Receiving Pervious Area (RPA, %)	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%								
Separate Pervious Area (SPA, %)	0.0%	41.0%	10.5%	100.0%	23.5%	100.0%								
A <sub>v</sub> (RPA / UIA)	0.000	0.000	0.000	0.000	0.000	0.000								
I <sub>c</sub> Check	1.000	1.000	1.000	1.000	1.000	1.000								
f / I for WQCV Event:	1.7	1.7	1.7	1.7	1.7	1.7								
f / I for 5-Year Event:	0.5	0.5	0.5	0.5	0.5	0.5								
f / I for 100-Year Event:	0.3	0.3	0.3	0.3	0.3	0.3								
<b>f / I for Optional User Defined Storm CUHP:</b>														
IRF for WQCV Event:	1.00	1.00	1.00	1.00	1.00	1.00								
IRF for 5-Year Event:	1.00	1.00	1.00	1.00	1.00	1.00								
IRF for 100-Year Event:	1.00	1.00	1.00	1.00	1.00	1.00								
<b>IRF for Optional User Defined Storm CUHP:</b>														
Total Site Imperviousness: I <sub>total</sub>	100.0%	59.0%	89.5%	0.0%	76.5%	0.0%								
Effective Imperviousness for WQCV Event:	100.0%	59.0%	89.5%	0.0%	76.5%	0.0%								
Effective Imperviousness for 5-Year Event:	100.0%	59.0%	89.5%	0.0%	76.5%	0.0%								
Effective Imperviousness for 100-Year Event:	100.0%	59.0%	89.5%	0.0%	76.5%	0.0%								
<b>Effective Imperviousness for Optional User Defined Storm CUHP:</b>														

### LID / EFFECTIVE IMPERVIOUSNESS CREDITS

WQCV Event CREDIT: Reduce Detention By:	N/A	0.0%	0.0%	0.0%	N/A	0.0%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
This line only for 10-Year Event	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
100-Year Event CREDIT**:	N/A	0.0%	0.0%	0.1%	N/A	0.2%	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
<b>User Defined CUHP CREDIT:</b> Reduce Detention By:														

<b>Total Site Imperviousness:</b>	<b>71.5%</b>
<b>Total Site Effective Imperviousness for WQCV Event:</b>	<b>71.5%</b>
<b>Total Site Effective Imperviousness for 5-Year Event:</b>	<b>71.5%</b>
<b>Total Site Effective Imperviousness for 100-Year Event:</b>	<b>71.5%</b>
<b>Total Site Effective Imperviousness for Optional User Defined Storm CUHP:</b>	

Notes:


- \* Use Green-Ampt average infiltration rate values from Table 3-3.
- \*\* Flood control detention volume credits based on empirical equations from Storage Chapter of USDCM.
- \*\*\* Method assumes that 1-hour rainfall depth is equivalent to 1-hour intensity for calculation purposes

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

MHFD-Detention, Version 4.05 (January 2022)

Project: **6855 Constitution Ave Self Storage**

Basin ID: **FSD-1**



**Watershed Information**

Selected BMP Type =	<b>EDB</b>
Watershed Area =	2.95 acres
Watershed Length =	520 ft
Watershed Length to Centroid =	225 ft
Watershed Slope =	0.020 ft/ft
Watershed Imperviousness =	71.50% percent
Percentage Hydrologic Soil Group A =	100.0% percent
Percentage Hydrologic Soil Group B =	0.0% percent
Percentage Hydrologic Soil Groups C/D =	0.0% percent
Target WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depths =	User Input

After providing required inputs above including 1-hour rainfall depths, click 'Run CUHP' to generate runoff hydrographs using the embedded Colorado Urban Hydrograph Procedure.

Water Quality Capture Volume (WQCV) =	0.069	acre-feet
Excess Urban Runoff Volume (EURV) =	0.269	acre-feet
2-yr Runoff Volume (P1 = 1.19 in.) =	0.185	inches
5-yr Runoff Volume (P1 = 1.5 in.) =	0.241	inches
10-yr Runoff Volume (P1 = 1.75 in.) =	0.287	inches
25-yr Runoff Volume (P1 = 2 in.) =	0.343	inches
50-yr Runoff Volume (P1 = 2.25 in.) =	0.397	inches
100-yr Runoff Volume (P1 = 2.52 in.) =	0.463	inches
500-yr Runoff Volume (P1 = 3 in.) =	0.573	inches
Approximate 2-yr Detention Volume =	0.176	acre-feet
Approximate 5-yr Detention Volume =	0.229	acre-feet
Approximate 10-yr Detention Volume =	0.275	acre-feet
Approximate 25-yr Detention Volume =	0.329	acre-feet
Approximate 50-yr Detention Volume =	0.361	acre-feet
Approximate 100-yr Detention Volume =	0.392	acre-feet

**Optional User Overrides**

	acre-feet
	acre-feet
1.19	inches
1.50	inches
1.75	inches
2.00	inches
2.25	inches
2.52	inches
3.00	inches

**Define Zones and Basin Geometry**


Zone 1 Volume (WQCV) =	0.069	acre-feet
Zone 2 Volume (EURV - Zone 1) =	0.200	acre-feet
Zone 3 Volume (100-year - Zones 1 & 2) =	0.123	acre-feet
Total Detention Basin Volume =	0.392	acre-feet
Initial Surcharge Volume (ISV) =	user	ft <sup>3</sup>
Initial Surcharge Depth (ISD) =	user	ft
Total Available Detention Depth (H <sub>total</sub> ) =	user	ft
Depth of Trickle Channel (H <sub>TC</sub> ) =	user	ft
Slope of Trickle Channel (S <sub>TC</sub> ) =	user	ft/ft
Slopes of Main Basin Sides (S <sub>main</sub> ) =	user	H:V
Basin Length-to-Width Ratio (R <sub>LW</sub> ) =	user	
Initial Surcharge Area (A <sub>ISV</sub> ) =	user	ft <sup>2</sup>
Surcharge Volume Length (L <sub>ISV</sub> ) =	user	ft
Surcharge Volume Width (W <sub>ISV</sub> ) =	user	ft
Depth of Basin Floor (H <sub>FLOOR</sub> ) =	user	ft
Length of Basin Floor (L <sub>FLOOR</sub> ) =	user	ft
Width of Basin Floor (W <sub>FLOOR</sub> ) =	user	ft
Area of Basin Floor (A <sub>FLOOR</sub> ) =	user	ft <sup>2</sup>
Volume of Basin Floor (V <sub>FLOOR</sub> ) =	user	ft <sup>3</sup>
Depth of Main Basin (H <sub>MAIN</sub> ) =	user	ft
Length of Main Basin (L <sub>MAIN</sub> ) =	user	ft
Width of Main Basin (W <sub>MAIN</sub> ) =	user	ft
Area of Main Basin (A <sub>MAIN</sub> ) =	user	ft <sup>2</sup>
Volume of Main Basin (V <sub>MAIN</sub> ) =	user	ft <sup>3</sup>
Calculated Total Basin Volume (V <sub>total</sub> ) =	user	acre-feet

Depth Increment = 0.20 ft

Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft <sup>2</sup> )	Optional Override Area (ft <sup>2</sup> )	Area (acre)	Volume (ft <sup>3</sup> )	Volume (ac-ft)
<b>Top of Micropool</b>	--	0.00	--	--	--	35	0.001		
<b>6499.6</b>	--	0.20	--	--	--	194	0.004	23	0.001
	--	0.40	--	--	--	468	0.011	89	0.002
<b>6500</b>	--	0.60	--	--	--	759	0.017	212	0.005
	--	0.80	--	--	--	1,395	0.032	427	0.010
	--	1.00	--	--	--	2,555	0.059	822	0.019
	--	1.20	--	--	--	3,917	0.090	1,469	0.034
	--	1.40	--	--	--	5,190	0.119	2,380	0.055
<b>6501</b>	--	1.60	--	--	--	6,173	0.142	3,516	0.081
	--	1.80	--	--	--	7,042	0.162	4,838	0.111
	--	2.00	--	--	--	7,777	0.179	6,319	0.145
	--	2.20	--	--	--	8,401	0.193	7,937	0.182
	--	2.40	--	--	--	8,872	0.204	9,665	0.222
<b>6502</b>	--	2.60	--	--	--	9,019	0.207	11,454	0.263
	--	2.80	--	--	--	9,121	0.209	13,268	0.305
	--	3.00	--	--	--	9,210	0.211	15,101	0.347
	--	3.20	--	--	--	9,249	0.212	16,947	0.389
	--	3.40	--	--	--	9,288	0.213	18,800	0.432
<b>6503</b>	--	3.60	--	--	--	9,327	0.214	20,662	0.474
	--	3.80	--	--	--	9,366	0.215	22,531	0.517
	--	4.00	--	--	--	9,423	0.216	24,410	0.560
	--	4.20	--	--	--	9,459	0.217	26,298	0.604
	--	4.40	--	--	--	9,496	0.218	28,193	0.647
<b>6504</b>	--	4.60	--	--	--	9,532	0.219	30,096	0.691
	--	4.80	--	--	--	9,568	0.220	32,006	0.735
	--	5.00	--	--	--	9,604	0.220	33,923	0.779
	--	5.20	--	--	--	9,641	0.221	35,848	0.823
	--	5.40	--	--	--	9,677	0.222	37,780	0.867
<b>6505</b>	--	5.60	--	--	--	9,713	0.223	39,719	0.912
	--	5.80	--	--	--	9,750	0.224	41,665	0.956
	--	6.00	--	--	--	9,786	0.225	43,619	1.001
	--	6.20	--	--	--	9,822	0.225	45,579	1.046
	--	6.40	--	--	--	9,859	0.226	47,547	1.092
<b>6506</b>	--		--	--	--				

# DETENTION BASIN STAGE-STORAGE TABLE BUILDER

*MHFD-Detention, Version 4.05 (January 2022)*

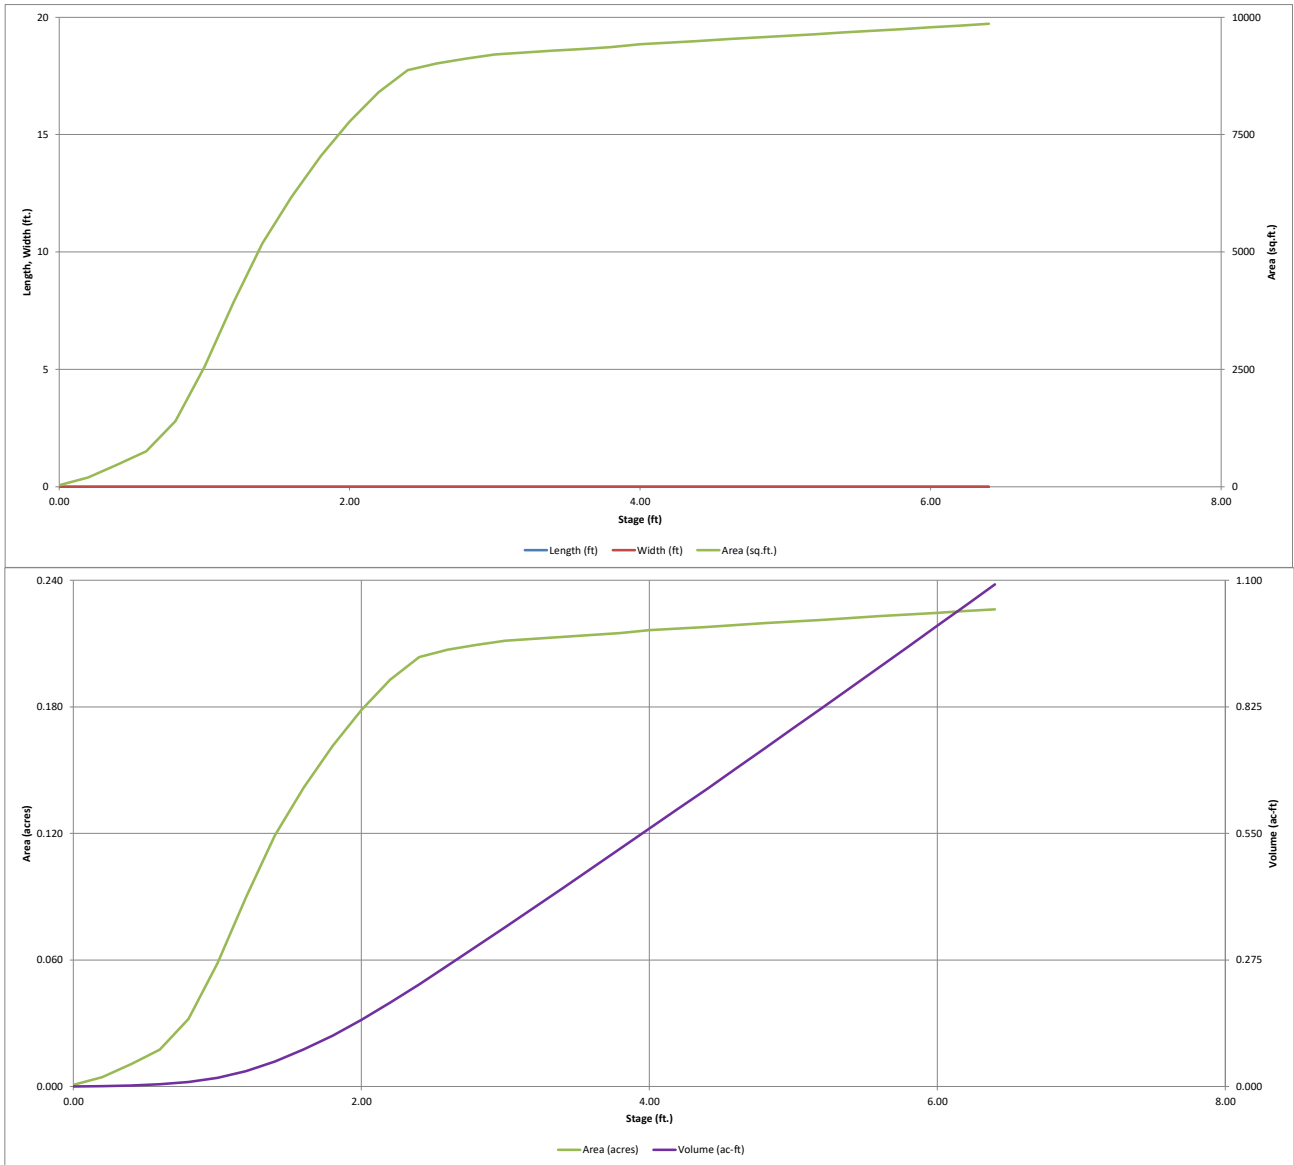


Unresolved. Provide detail for outlet structure and orifice plate.

## DETENTION BASIN OUTLET STRUCTURE DESIGN

*MHFD-Detention, Version 4.05 (January 2022)*

**Project:** 6855 Constitution Ave Self Storage  
**Basin ID:** FSD-1

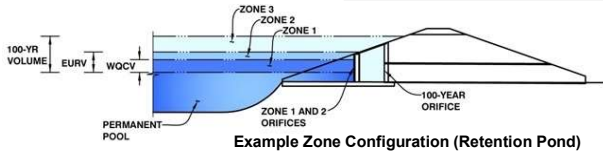

	Estimated Stage (ft)	Estimated Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.52	0.069	Orifice Plate
Zone 2 (EURV)	2.63	0.200	Orifice Plate
Zone 3 (100-year)	3.22	0.123	Weir&Pipe (Restrict)
<b>Total (all zones)</b>		<b>0.392</b>	

**User Input:** Orifice at Underdrain Outlet (typically used to drain WQCV in a Filtration BMP)

Underdrain Orifice Invert Depth =	N/A	ft (distance below the filtration media surface)
Underdrain Orifice Diameter =	N/A	inches

**Calculated Parameters for Underdrain**

Underdrain Orifice Area =	N/A	ft <sup>2</sup>
Underdrain Orifice Centroid =	N/A	feet

**User Input:** Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Centroid of Lowest Orifice =	0.00	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate =	2.63	ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing =	N/A	inches
Orifice Plate: Orifice Area per Row =	N/A	sq. inches

**Calculated Parameters for Plate**

WQ Orifice Area per Row =	N/A	ft <sup>2</sup>
Elliptical Half-Width =	N/A	feet
Elliptical Slot Centroid =	N/A	feet
Elliptical Slot Area =	N/A	ft <sup>2</sup>

**User Input:** Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	0.88	1.52	2.45				
Orifice Area (sq. inches)	0.44	0.44	1.23	1.23				

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

**User Input:** Vertical Orifice (Circular or Rectangular)

	Not Selected	Not Selected	
Invert of Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice =	N/A	N/A	ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter =	N/A	N/A	inches

**Calculated Parameters for Vertical Orifice**

	Not Selected	Not Selected	
Vertical Orifice Area =	N/A	N/A	ft <sup>2</sup>
Vertical Orifice Centroid =	N/A	N/A	feet

**User Input:** Overflow Weir (Dropbox with Flat or Sloped Grate and Outlet Pipe OR Rectangular/Trapezoidal Weir and No Outlet Pipe)

	Zone 3 Weir	Not Selected	
Overflow Weir Front Edge Height, Ho =	3.25	N/A	ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length =	2.92	N/A	feet
Overflow Weir Grate Slope =	0.00	N/A	H:V
Horiz. Length of Weir Sides =	2.92	N/A	feet
Overflow Grate Type =	Type C Grate	N/A	
Debris Clogging % =	50%	N/A	%

**Calculated Parameters for Overflow Weir**

	Zone 3 Weir	Not Selected	
Height of Grate Upper Edge, H <sub>u</sub> =	3.25	N/A	feet
Overflow Weir Slope Length =	2.92	N/A	feet
Grate Open Area / 100-yr Orifice Area =	22.25	N/A	
Overflow Grate Open Area w/o Debris =	5.93	N/A	ft <sup>2</sup>
Overflow Grate Open Area w/ Debris =	2.97	N/A	ft <sup>2</sup>

**User Input:** Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

	Zone 3 Restrictor	Not Selected	
Depth to Invert of Outlet Pipe =	0.00	N/A	ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter =	18.00	N/A	inches
Restrictor Plate Height Above Pipe Invert =	3.75	N/A	inches

**Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate**

	Zone 3 Restrictor	Not Selected	
Outlet Orifice Area =	0.27	N/A	ft <sup>2</sup>
Outlet Orifice Centroid =	0.18	N/A	feet
Half-Central Angle of Restrictor Plate on Pipe =	0.95	N/A	radians

**User Input:** Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage =	3.40	ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length =	20.00	feet
Spillway End Slopes =	0.00	H:V
Freeboard above Max Water Surface =	1.00	feet

**Calculated Parameters for Spillway**

Spillway Design Flow Depth =	0.29	feet
Stage at Top of Freeboard =	4.69	feet
Basin Area at Top of Freeboard =	0.22	acres
	0.71	acre-ft

Unresolved. Provide details for spillway.

**Routed Hydrograph Results**




*The user can override the default CUHP hydrographs and runoff volumes by entering new values in the Inflow Hydrographs table (Columns W through AF).*

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	N/A	N/A	1.19	1.50	1.75	2.00	2.25	2.52	3.00
One-Hour Rainfall Depth (in) =	0.069	0.269	0.185	0.241	0.287	0.343	0.397	0.463	0.573
CUHP Runoff Volume (acre-ft) =	N/A	N/A	0.185	0.241	0.287	0.343	0.397	0.463	0.573
Inflow Hydrograph Volume (acre-ft) =	N/A	N/A	0.0	0.0	0.1	0.6	1.2	1.9	3.0
CUHP Predevelopment Peak Q (cfs) =	N/A	N/A	0.01	0.02	0.02	0.20	0.39	0.64	1.03
OPTIONAL Override Predevelopment Peak Q (cfs) =	N/A	N/A	3.3	4.3	5.0	6.2	7.3	8.8	10.9
Predevelopment Unit Peak Flow, q (cfs/acre) =	N/A	N/A	0.071	0.081	0.105	0.122	0.135	0.1617	2.968
Peak Inflow Q (cfs) =	N/A	N/A	N/A	1.7	1.6	0.2	0.1	0.3	1.0
Peak Outflow Q (cfs) =	Plate	Plate	Plate	Plate	Plate	Plate	Plate	Overflow Weir 1	Spillway
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	0.1	0.3
Structure Controlling Flow =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Max Velocity through Grate 1 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Max Velocity through Grate 2 (fps) =	39	69	60	67	72	76	79	80	78
Time to Drain 97% of Inflow Volume (hours) =	41	75	65	73	77	83	87	89	88
Time to Drain 99% of Inflow Volume (hours) =	1.52	2.63	2.16	2.44	2.64	2.90	3.15	3.34	3.46
Maximum Ponding Depth (ft) =	0.13	0.21	0.19	0.20	0.21	0.21	0.21	0.21	0.21
Area at Maximum Ponding Depth (acres) =	0.070	0.269	0.173	0.228	0.271	0.323	0.376	0.417	0.444
Maximum Volume Stored (acre-ft) =									

Unresolved. Ratio should be closer to 1. Revise.

# DETENTION BASIN OUTLET STRUCTURE DESIGN

*MHFD-Detention, Version 4.05 (January 2022)*

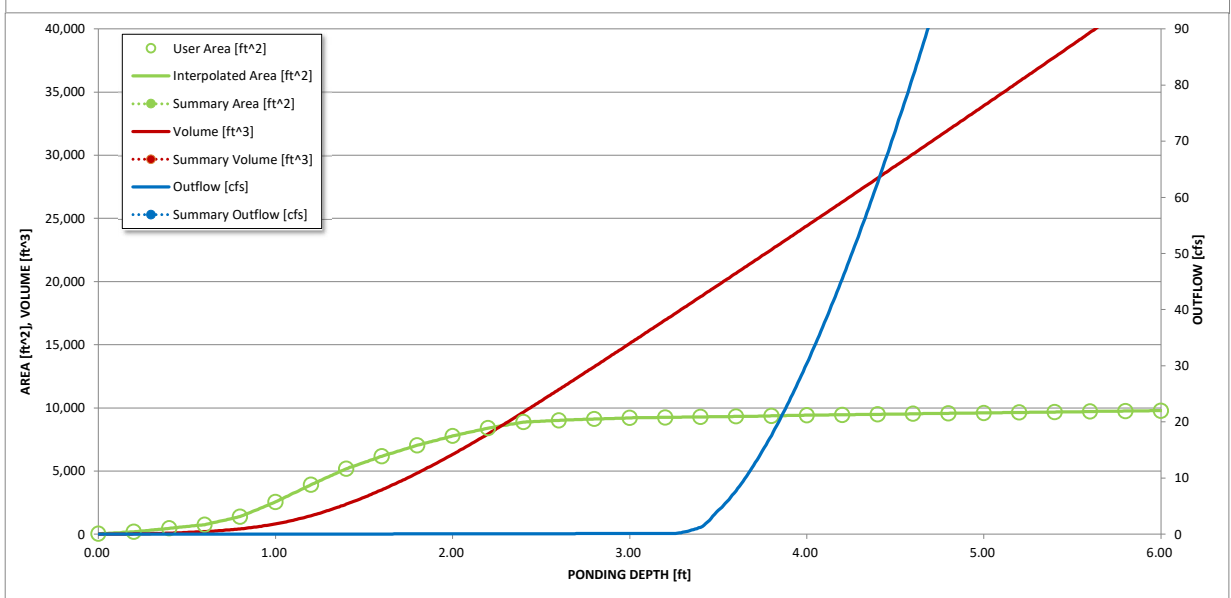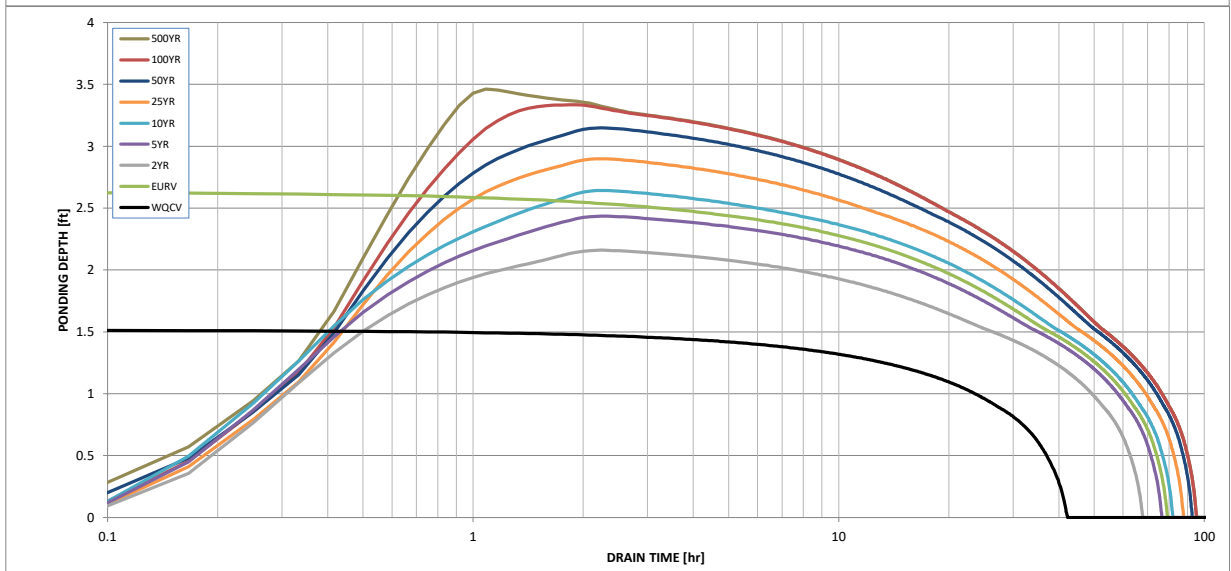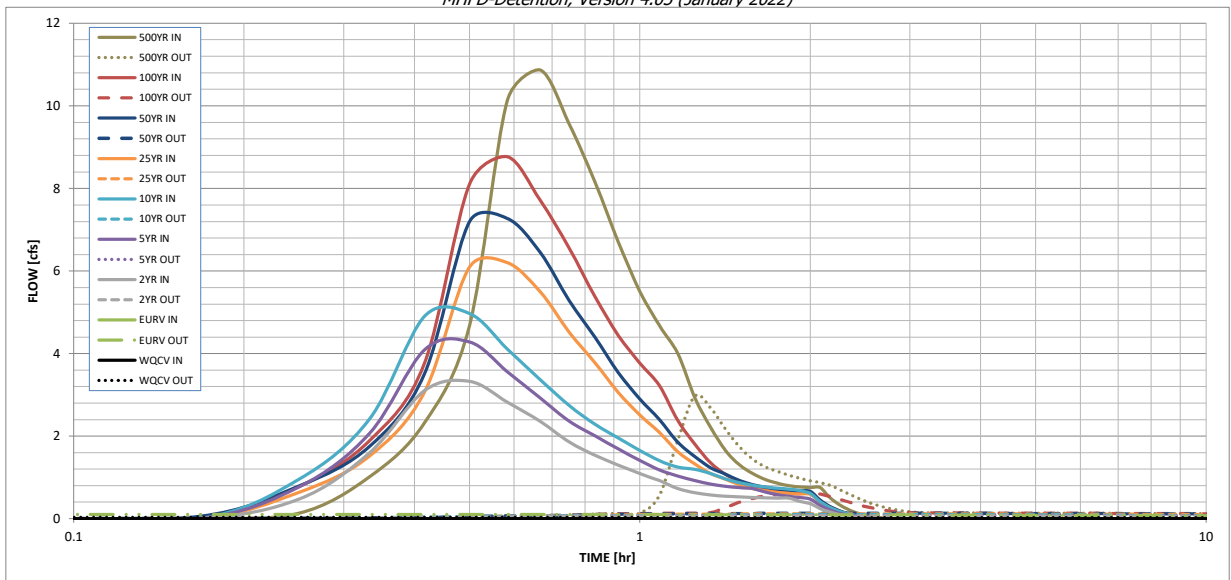

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

# DETENTION BASIN OUTLET STRUCTURE DESIGN

Outflow Hydrograph Workbook Filename: \_\_\_\_\_

## Inflow Hydrographs

The user can override the calculated inflow hydrographs from this workbook with inflow hydrographs developed in a separate program.

Time Interval	SOURCE	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP	CUHP
	TIME	WQCV [cfs]	EURV [cfs]	2 Year [cfs]	5 Year [cfs]	10 Year [cfs]	25 Year [cfs]	50 Year [cfs]	100 Year [cfs]	500 Year [cfs]
5.00 min	0:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	0:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.05	0.01
	0:15:00	0.00	0.00	0.47	0.77	0.96	0.64	0.79	0.78	1.02
	0:20:00	0.00	0.00	1.60	2.07	2.42	1.52	1.76	1.90	2.32
	0:25:00	0.00	0.00	3.10	4.09	4.90	3.07	3.51	3.76	4.67
	0:30:00	0.00	0.00	3.33	4.28	4.97	6.09	7.19	8.10	10.13
	0:35:00	0.00	0.00	2.82	3.56	4.11	6.20	7.28	8.77	10.87
	0:40:00	0.00	0.00	2.36	2.92	3.37	5.50	6.45	7.71	9.57
	0:45:00	0.00	0.00	1.86	2.36	2.74	4.52	5.29	6.56	8.16
	0:50:00	0.00	0.00	1.53	2.01	2.29	3.78	4.39	5.38	6.70
	0:55:00	0.00	0.00	1.30	1.69	1.95	3.05	3.54	4.44	5.51
	1:00:00	0.00	0.00	1.09	1.41	1.65	2.51	2.90	3.77	4.67
	1:05:00	0.00	0.00	0.92	1.18	1.40	2.09	2.40	3.22	4.00
	1:10:00	0.00	0.00	0.73	1.03	1.25	1.63	1.86	2.38	2.93
	1:15:00	0.00	0.00	0.63	0.93	1.20	1.33	1.50	1.81	2.22
	1:20:00	0.00	0.00	0.58	0.84	1.10	1.10	1.24	1.36	1.65
	1:25:00	0.00	0.00	0.55	0.79	0.96	0.96	1.08	1.08	1.30
	1:30:00	0.00	0.00	0.53	0.75	0.87	0.82	0.93	0.91	1.09
	1:35:00	0.00	0.00	0.52	0.73	0.81	0.73	0.82	0.79	0.95
	1:40:00	0.00	0.00	0.51	0.64	0.77	0.68	0.76	0.72	0.86
	1:45:00	0.00	0.00	0.50	0.58	0.74	0.64	0.72	0.67	0.80
	1:50:00	0.00	0.00	0.50	0.54	0.72	0.61	0.69	0.65	0.77
	1:55:00	0.00	0.00	0.42	0.51	0.68	0.60	0.67	0.64	0.76
	2:00:00	0.00	0.00	0.36	0.48	0.61	0.59	0.66	0.63	0.75
	2:05:00	0.00	0.00	0.25	0.32	0.41	0.40	0.45	0.43	0.51
	2:10:00	0.00	0.00	0.16	0.21	0.28	0.27	0.30	0.29	0.34
	2:15:00	0.00	0.00	0.11	0.14	0.18	0.18	0.20	0.19	0.23
	2:20:00	0.00	0.00	0.07	0.09	0.11	0.11	0.12	0.12	0.14
	2:25:00	0.00	0.00	0.04	0.05	0.07	0.07	0.08	0.08	0.09
	2:30:00	0.00	0.00	0.02	0.03	0.04	0.04	0.05	0.04	0.05
	2:35:00	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.02
	2:40:00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01
	2:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	2:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:05:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:10:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:15:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:20:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:25:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:30:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:35:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:40:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:45:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:50:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
5:55:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
6:00:00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	

**Design Procedure Form: Extended Detention Basin (EDB)**

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

**Designer:** DDJ  
**Company:** Galloway  
**Date:** December 16, 2022  
**Project:** 6855 Constitution Self Storage  
**Location:** \_\_\_\_\_

1. Basin Storage Volume

A) Effective Imperviousness of Tributary Area,  $I_a$

B) Tributary Area's Imperviousness Ratio ( $i = I_a / 100$ )

C) Contributing Watershed Area

D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm

E) Design Concept  
(Select EURV when also designing for flood control)

F) Design Volume (WQCV) Based on 40-hour Drain Time  
( $V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i) / 12 * Area)$ )

G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume  
( $V_{WQCV\ OTHER} = (d_s * V_{DESIGN} / 0.43)$ )

H) User Input of Water Quality Capture Volume (WQCV) Design Volume  
(Only if a different WQCV Design Volume is desired)

I) NRCS Hydrologic Soil Groups of Tributary Watershed  
 i) Percentage of Watershed consisting of Type A Soils  
 ii) Percentage of Watershed consisting of Type B Soils  
 iii) Percentage of Watershed consisting of Type C/D Soils

J) Excess Urban Runoff Volume (EURV) Design Volume  
 For HSG A:  $EURV_A = 1.68 * i^{1.28}$   
 For HSG B:  $EURV_B = 1.36 * i^{1.08}$   
 For HSG C/D:  $EURV_{C/D} = 1.20 * i^{1.08}$

K) User Input of Excess Urban Runoff Volume (EURV) Design Volume  
(Only if a different EURV Design Volume is desired)

$I_a =$   %  
 $i =$    
 Area =  ac  
 $d_s =$   in

Choose One  
 Water Quality Capture Volume (WQCV)  
 Excess Urban Runoff Volume (EURV)

$V_{DESIGN} =$   ac-ft  
 $V_{DESIGN\ OTHER} =$   ac-ft  
 $V_{DESIGN\ USER} =$   ac-ft

$HSG_A =$   %  
 $HSG_B =$   %  
 $HSG_{C/D} =$   %

$EURV_{DESIGN} =$   ac-ft  
 $EURV_{DESIGN\ USER} =$   ac-ft

2. Basin Shape: Length to Width Ratio  
(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

$L : W =$   : 1

**FSD-1 USES VERTICAL WALLS**

3. Basin Side Slopes

A) Basin Maximum Side Slopes  
(Horizontal distance per unit vertical, 4:1 or flatter preferred)

$Z =$   ft / ft **TOO STEEP (< 3)**

4. Inlet

A) Describe means of providing energy dissipation at concentrated inflow locations:

Forebays (Sheet 1 has been included twice, one for each forebay design; designated South Forebay and North Forebay)

---



---



---

5. Forebay

A) Minimum Forebay Volume  
( $V_{MIN} =$   of the WQCV)

B) Actual Forebay Volume

C) Forebay Depth  
( $D_F =$   inch maximum)

D) Forebay Discharge

i) Undetained 100-year Peak Discharge

ii) Forebay Discharge Design Flow  
( $Q_F = 0.02 * Q_{100}$ )

E) Forebay Discharge Design

F) Discharge Pipe Size (minimum 8-inches)

G) Rectangular Notch Width

**NORTH FOREBAY**

$V_{MIN} =$   ac-ft  
 $V_F =$   ac-ft  
 $D_F =$   in  
 $Q_{100} =$   cfs  
 $Q_F =$   cfs

Choose One  
 Berm With Pipe  
 Wall with Rect. Notch  
 Wall with V-Notch Weir

**Flow too small for berm w/ pipe**

Calculated  $D_P =$   in  
 Calculated  $W_N =$   in



**Design Procedure Form: Extended Detention Basin (EDB)**

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 3

**Designer:** DDJ  
**Company:** Galloway  
**Date:** December 16, 2022  
**Project:** 6855 Constitution Self Storage  
**Location:** \_\_\_\_\_

1. Basin Storage Volume

A) Effective Imperviousness of Tributary Area,  $I_a$

B) Tributary Area's Imperviousness Ratio ( $i = I_a / 100$ )

C) Contributing Watershed Area

D) For Watersheds Outside of the Denver Region, Depth of Average Runoff Producing Storm

E) Design Concept  
(Select EURV when also designing for flood control)

F) Design Volume (WQCV) Based on 40-hour Drain Time  
( $V_{DESIGN} = (1.0 * (0.91 * i^3 - 1.19 * i^2 + 0.78 * i) / 12 * Area)$ )

G) For Watersheds Outside of the Denver Region, Water Quality Capture Volume (WQCV) Design Volume  
( $V_{WQCV\ OTHER} = (d_s * V_{DESIGN} / 0.43)$ )

H) User Input of Water Quality Capture Volume (WQCV) Design Volume  
(Only if a different WQCV Design Volume is desired)

I) NRCS Hydrologic Soil Groups of Tributary Watershed  
 i) Percentage of Watershed consisting of Type A Soils  
 ii) Percentage of Watershed consisting of Type B Soils  
 iii) Percentage of Watershed consisting of Type C/D Soils

J) Excess Urban Runoff Volume (EURV) Design Volume  
 For HSG A:  $EURV_A = 1.68 * i^{1.28}$   
 For HSG B:  $EURV_B = 1.36 * i^{1.08}$   
 For HSG C/D:  $EURV_{C/D} = 1.20 * i^{1.08}$

K) User Input of Excess Urban Runoff Volume (EURV) Design Volume  
(Only if a different EURV Design Volume is desired)

$I_a =$   %  
 $i =$    
 Area =  ac  
 $d_s =$   in

Choose One  
 Water Quality Capture Volume (WQCV)  
 Excess Urban Runoff Volume (EURV)

$V_{DESIGN} =$   ac-ft  
 $V_{DESIGN\ OTHER} =$   ac-ft  
 $V_{DESIGN\ USER} =$   ac-ft

$HSG_A =$   %  
 $HSG_B =$   %  
 $HSG_{C/D} =$   %

$EURV_{DESIGN} =$   ac-ft  
 $EURV_{DESIGN\ USER} =$   ac-ft

2. Basin Shape: Length to Width Ratio  
(A basin length to width ratio of at least 2:1 will improve TSS reduction.)

$L : W =$   : 1

**FSD-1 USES VERTICAL WALLS**

3. Basin Side Slopes

A) Basin Maximum Side Slopes  
(Horizontal distance per unit vertical, 4:1 or flatter preferred)

$Z =$   ft / ft **TOO STEEP (< 3)**

4. Inlet

A) Describe means of providing energy dissipation at concentrated inflow locations:

Forebays (Sheet 1 has been included twice, one for each forebay design; designated South Forebay and North Forebay)

---



---



---

5. Forebay

A) Minimum Forebay Volume  
( $V_{MIN} =$   of the WQCV)

B) Actual Forebay Volume

C) Forebay Depth  
( $D_F =$   inch maximum)

D) Forebay Discharge

i) Undetained 100-year Peak Discharge

ii) Forebay Discharge Design Flow  
( $Q_F = 0.02 * Q_{100}$ )

E) Forebay Discharge Design

F) Discharge Pipe Size (minimum 8-inches)

G) Rectangular Notch Width

**SOUTH FOREBAY**

$V_{MIN} =$   ac-ft  
 $V_F =$   ac-ft  
 $D_F =$   in  
 $Q_{100} =$   cfs  
 $Q_F =$   cfs

Choose One  
 Berm With Pipe  
 Wall with Rect. Notch  
 Wall with V-Notch Weir

**Flow too small for berm w/ pipe**

Calculated  $D_P =$   in  
 Calculated  $W_N =$   in

**Design Procedure Form: Extended Detention Basin (EDB)**

**Designer:** DDJ  
**Company:** Galloway  
**Date:** December 16, 2022  
**Project:** 6855 Constitution Self Storage  
**Location:** \_\_\_\_\_

<p>6. Trickle Channel</p> <p>A) Type of Trickle Channel</p> <p>F) Slope of Trickle Channel</p>	<div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;">             Choose One  <input checked="" type="radio"/> Concrete  <input type="radio"/> Soft Bottom         </div> <p>S = <input type="text" value="0.0050"/> ft / ft</p>
<p>7. Micropool and Outlet Structure</p> <p>A) Depth of Micropool (2.5-foot minimum)</p> <p>B) Surface Area of Micropool (10 ft<sup>2</sup> minimum)</p> <p>C) Outlet Type</p> <p>D) Smallest Dimension of Orifice Opening Based on Hydrograph Routing (Use UD-Detention)</p> <p>E) Total Outlet Area</p>	<p>D<sub>M</sub> = <input type="text" value="2.5"/> ft</p> <p>A<sub>M</sub> = <input type="text" value="35"/> sq ft</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;">             Choose One  <input checked="" type="radio"/> Orifice Plate  <input type="radio"/> Other (Describe): _____         </div> <hr/> <p>D<sub>orifice</sub> = <input type="text" value="0.63"/> inches</p> <p>A<sub>orifice</sub> = <input type="text" value="0.93"/> square inches</p>
<p>8. Initial Surcharge Volume</p> <p>A) Depth of Initial Surcharge Volume (Minimum recommended depth is 4 inches)</p> <p>B) Minimum Initial Surcharge Volume (Minimum volume of 0.3% of the WQCV)</p> <p>C) Initial Surcharge Provided Above Micropool</p>	<p>D<sub>IS</sub> = <input type="text" value="4"/> in</p> <p>V<sub>IS</sub> = <input type="text"/> cu ft</p> <p>V<sub>s</sub> = <input type="text" value="11.7"/> cu ft</p>
<p>9. Trash Rack</p> <p>A) Water Quality Screen Open Area: <math>A_t = A_{ot} * 38.5 * (e^{-0.095D})</math></p> <p>B) Type of Screen (If specifying an alternative to the materials recommended in the USDCM, indicate "other" and enter the ratio of the total open area to the total screen area for the material specified.)</p> <p style="margin-left: 40px;">Other (Y/N): <input type="text" value="N"/></p> <p>C) Ratio of Total Open Area to Total Area (only for type 'Other')</p> <p>D) Total Water Quality Screen Area (based on screen type)</p> <p>E) Depth of Design Volume (EURV or WQCV) (Based on design concept chosen under 1E)</p> <p>F) Height of Water Quality Screen (H<sub>TR</sub>)</p> <p>G) Width of Water Quality Screen Opening (W<sub>opening</sub>) (Minimum of 12 inches is recommended)</p>	<p>A<sub>t</sub> = <input type="text" value="34"/> square inches</p> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px; width: fit-content;">             S.S. Well Screen with 60% Open Area         </div> <hr/> <p>User Ratio = <input type="text"/></p> <p>A<sub>total</sub> = <input type="text" value="56"/> sq. in.</p> <p>H = <input type="text" value="1.52"/> feet</p> <p>H<sub>TR</sub> = <input type="text" value="46.24"/> inches</p> <p>W<sub>opening</sub> = <input type="text" value="12.0"/> inches <span style="color: red; font-weight: bold; font-size: small;">VALUE LESS THAN RECOMMENDED MIN. WIDTH. WIDTH HAS BEEN SET TO 12 INCHES.</span></p>

Design Procedure Form: Extended Detention Basin (EDB)

Designer: DDJ  
Company: Galloway  
Date: December 16, 2022  
Project: 6855 Constitution Self Storage  
Location: \_\_\_\_\_

<p>10. Overflow Embankment</p> <p>A) Describe embankment protection for 100-year and greater overtopping:</p> <p>B) Slope of Overflow Embankment (Horizontal distance per unit vertical, 4:1 or flatter preferred)</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>Ze = <input type="text" value="16.67"/> ft / ft</p>
-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------

<p>11. Vegetation</p>	<p>Choose One</p> <p><input type="radio"/> Irrigated</p> <p><input type="radio"/> Not Irrigated</p>
-----------------------	-----------------------------------------------------------------------------------------------------

<p>12. Access</p> <p>A) Describe Sediment Removal Procedures</p>	<p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p> <p>_____</p>
------------------------------------------------------------------	------------------------------------------------------------------



Notes: \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_



# Stormwater Detention and Infiltration Design Data Sheet

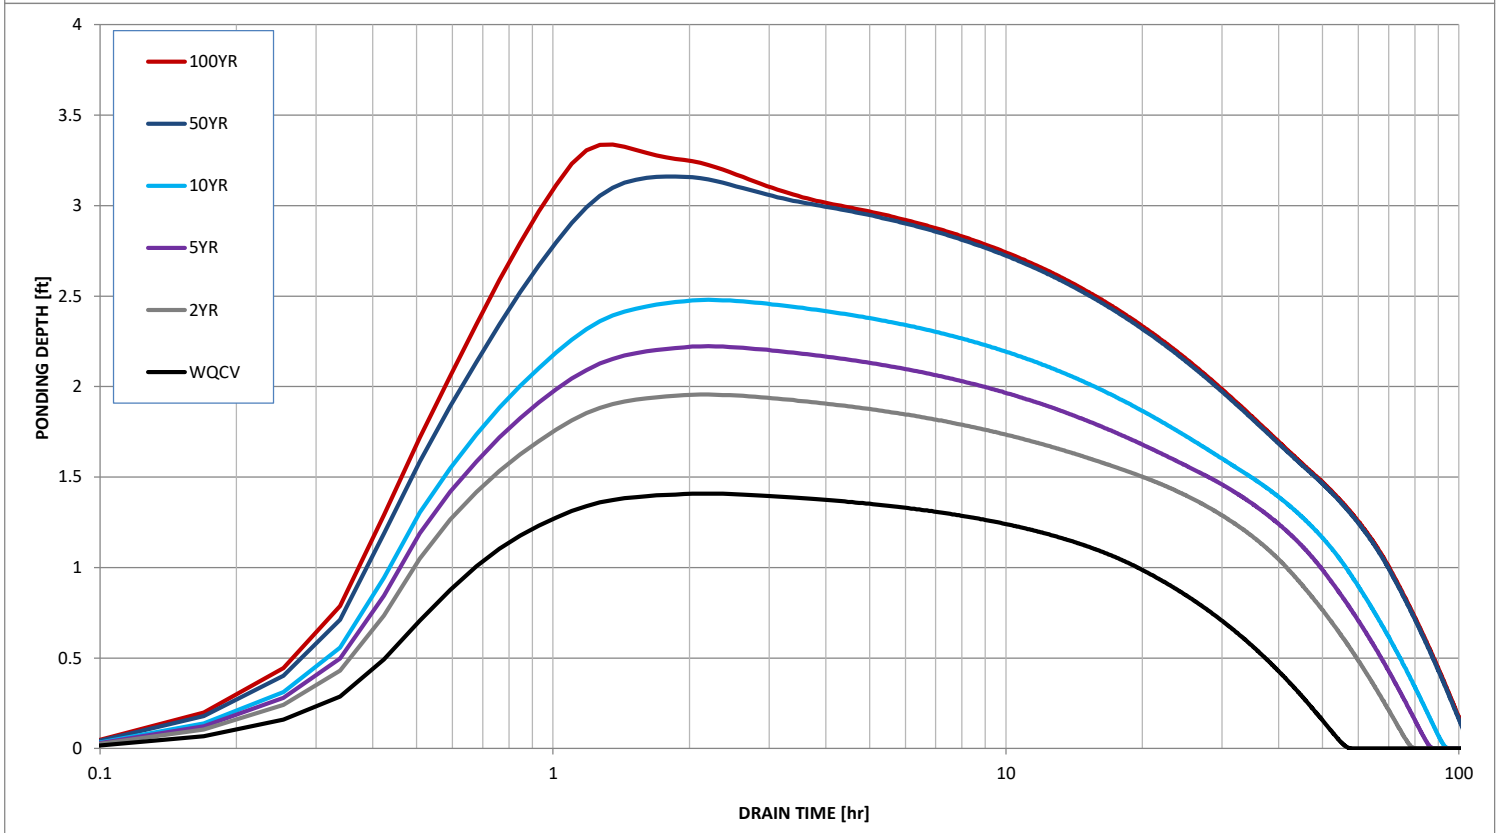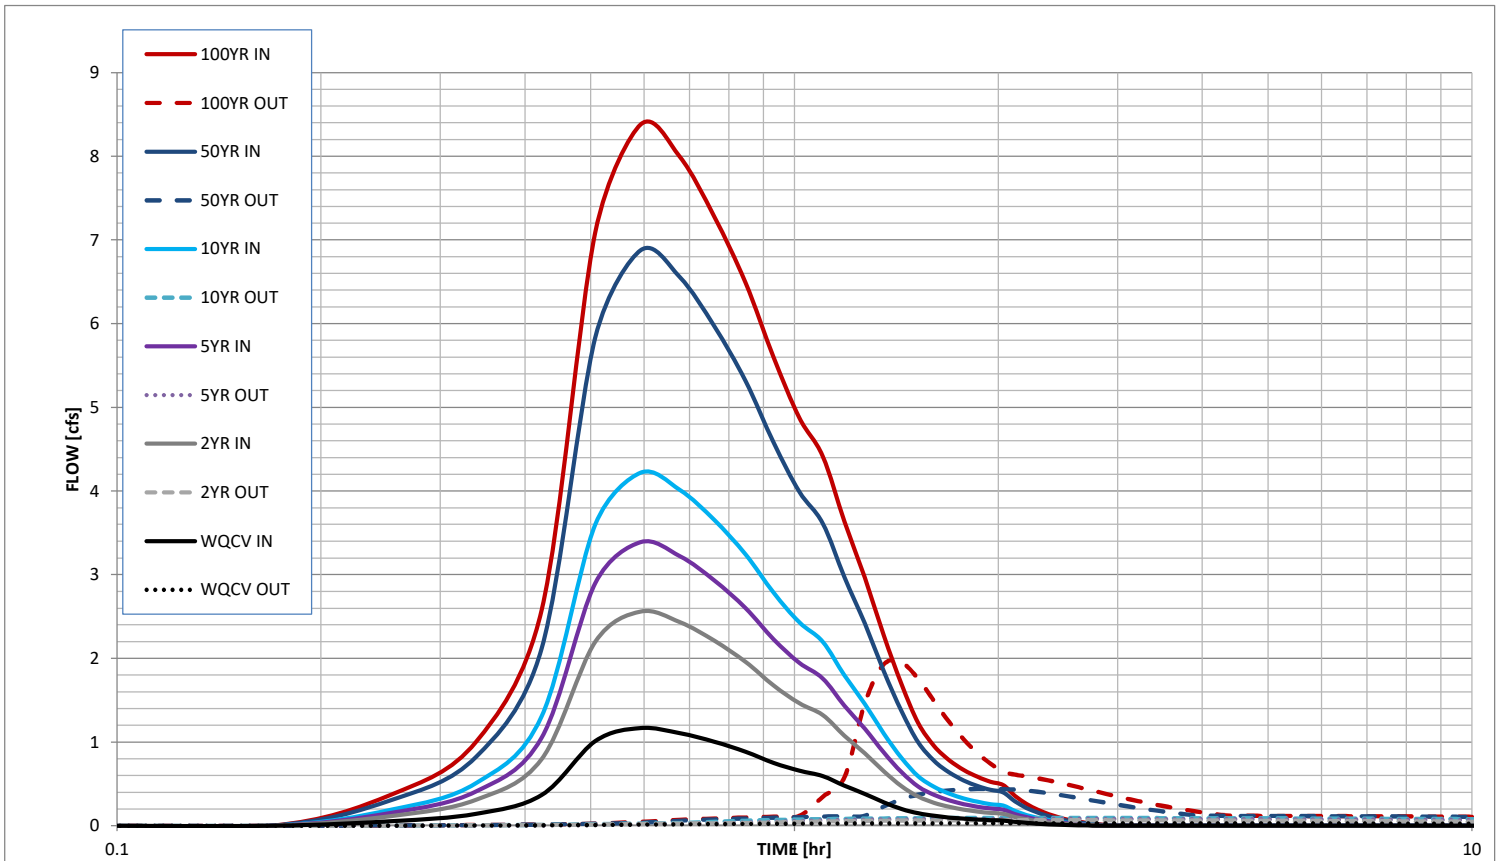

## **APPENDIX E**


### **Drainage Maps**




6805 BISMARCK RD COLORADO SPRINGS CO, 80922-1116

LAND USE: CODE 200 AT PRESENT WORTH  
PLAT NO: 7776  
4432 SLICE DR COLORADO SPRINGS CO, 80922

K & S DEVELOPMENT LLC  
PARCEL NO: 5332309004  
ZONE: CC CAD-0  
LAND USE: CODE 200 AT PRESENT WORTH  
PLAT NO: 7776  
4432 SLICE DR COLORADO SPRINGS CO, 80922



VICINITY MAP  
1" = 2000'

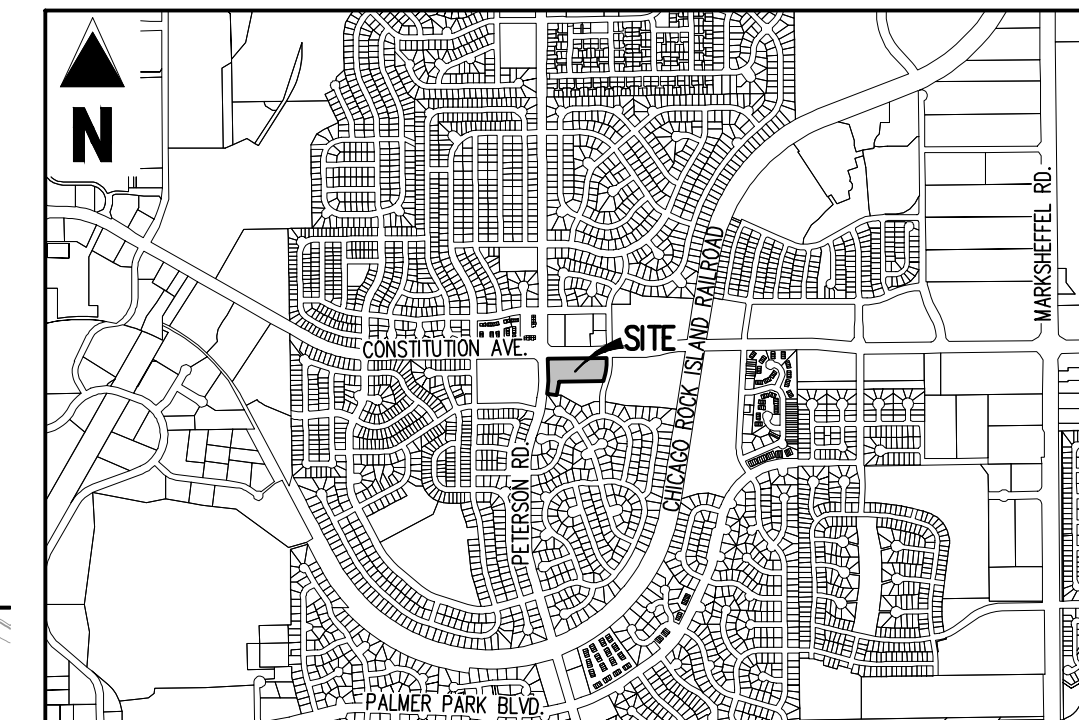

**Galloway**

6162 S. Willow Drive, Suite 320  
Greenwood Village, CO 80111  
303.770.8884  
gallowayus.com


**PRELIMINARY**  
NOT FOR BIDDING  
NOT FOR CONSTRUCTION

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE AND ARE THE PROPERTY OF GALLOWAY, AND MAY NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF GALLOWAY. COPYRIGHTS AND INFINGEMENTS WILL BE ENFORCED AND PROSECUTED.



CONSTITUTION AVENUE  
120' PUBLIC RIGHT OF WAY

DRAINAGE LEGEND

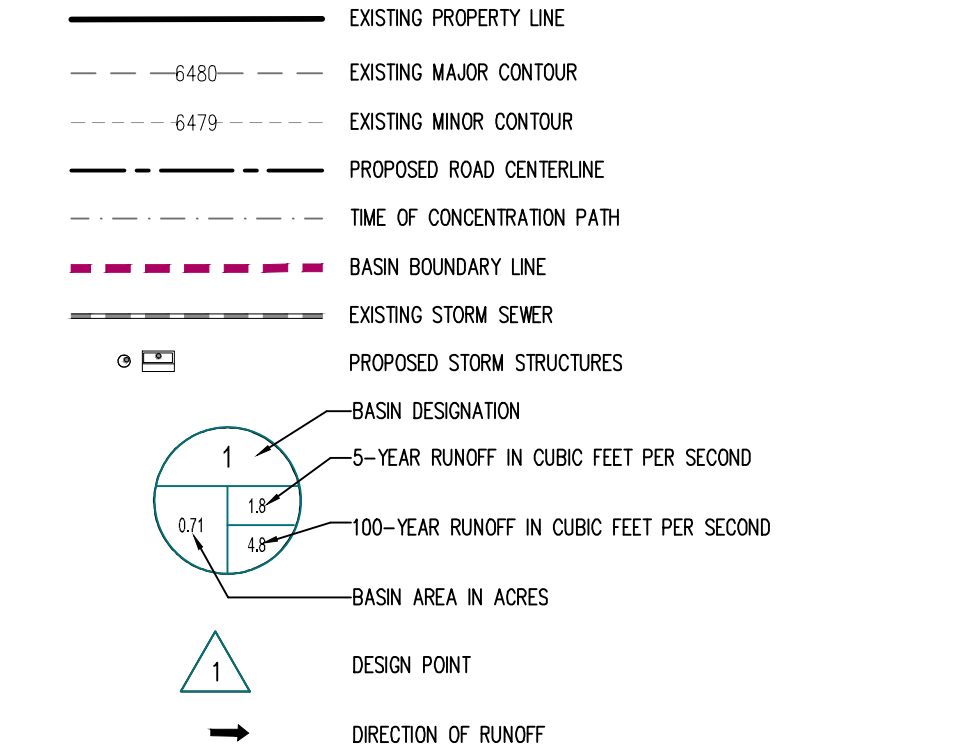


BASIN SUMMARY TABLE

Tributary Sub-basin	Area (acres)	Cs	C100	t <sub>c</sub> (min)	Q <sub>c</sub> (cfs)	Q <sub>100</sub> (cfs)
EX-1	0.05	0.00	0.22	5.25	0.0	0.1
EX-2	0.26	0.00	0.22	11.28	0.0	0.4
EX-3	0.39	0.03	0.25	11.17	0.0	0.7
EX-4	0.03	0.53	0.63	5.00	0.1	0.2
EX-5	2.69	0.05	0.27	11.67	0.4	4.8
EX-6	0.36	0.00	0.22	11.11	0.0	0.5


PETERSON ROAD  
100' PUBLIC RIGHT OF WAY

5' PUBLIC UTILITY EASEMENT  
REC. 1445775

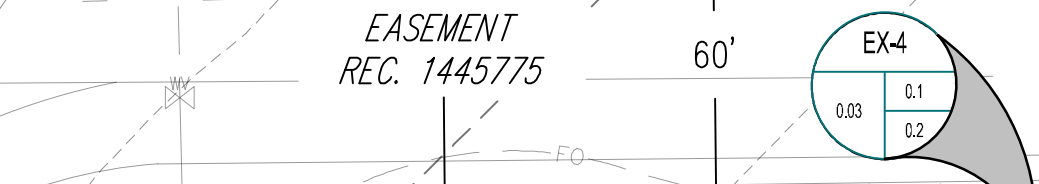


SET NAIL WITH 1-1/2" ALUMINUM DISC STAMPED "PLS 38069"


JASPERCO LLC  
PARCEL NO: 5405218002  
ZONE: RM-30  
LAND USE: SPECIAL PURPOSE  
PLAT NO: 9808  
5532 SADDLE ROCK TRL COLORADO SPRINGS CO, 80918-3006



UTILITY EASEMENT  
REC. 98070659




SINGLE STORY WOOD RESIDENCE  
F.F.: 6502.08



GRAVEL DRIVE



5' PUBLIC UTILITY AND DRAINAGE EASEMENT  
REC. 1445775



ALVARADO KIMBERLY AI  
PARCEL NO: 5405218010  
ZONE: RS-6000 CAD-0  
LAND USE: SINGLE FAMILY RES.  
PLAT NO: 6430  
5365 ALLYN WAY COLORADO SPRINGS CO, 80915-4230

EIGHT LINE INC  
PARCEL NO: 5405218003  
ZONE: CC CAD-0  
LAND USE: SPECIAL PURPOSE  
PLAT NO: 9808  
8300 S COUNTY LINE RD OKLAHOMA CITY OK, 73169-1606

OPSAHL LEV  
PARCEL NO: 5405218009  
ZONE: RS-6000 CAD-0  
LAND USE: SINGLE FAMILY RES.

6855 CONSTITUTION AVE. STORAGE SITE  
COMMERCIAL DEVELOPMENT  
DRAINAGE MAP  
FOR JOHNSON DEVELOPMENT ASSOCIATES  
LOT 1 OF THE EIGHT LINE SUBDIVISION  
COLORADO SPRINGS, CO 80915




#	Date	Issue / Description	Init.

Project No: JDA02.20  
Drawn By: BAS  
Checked By: BAS  
Date: 07.08.2022

EXISTING DRAINAGE MAP

DR-1



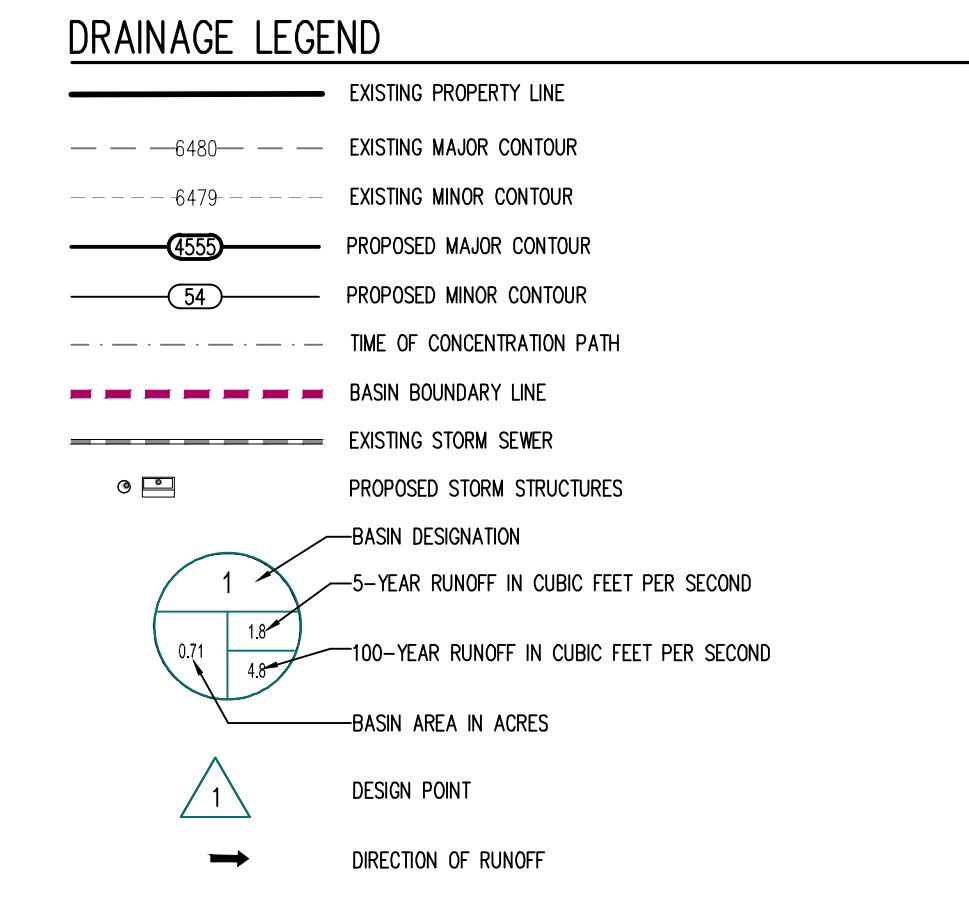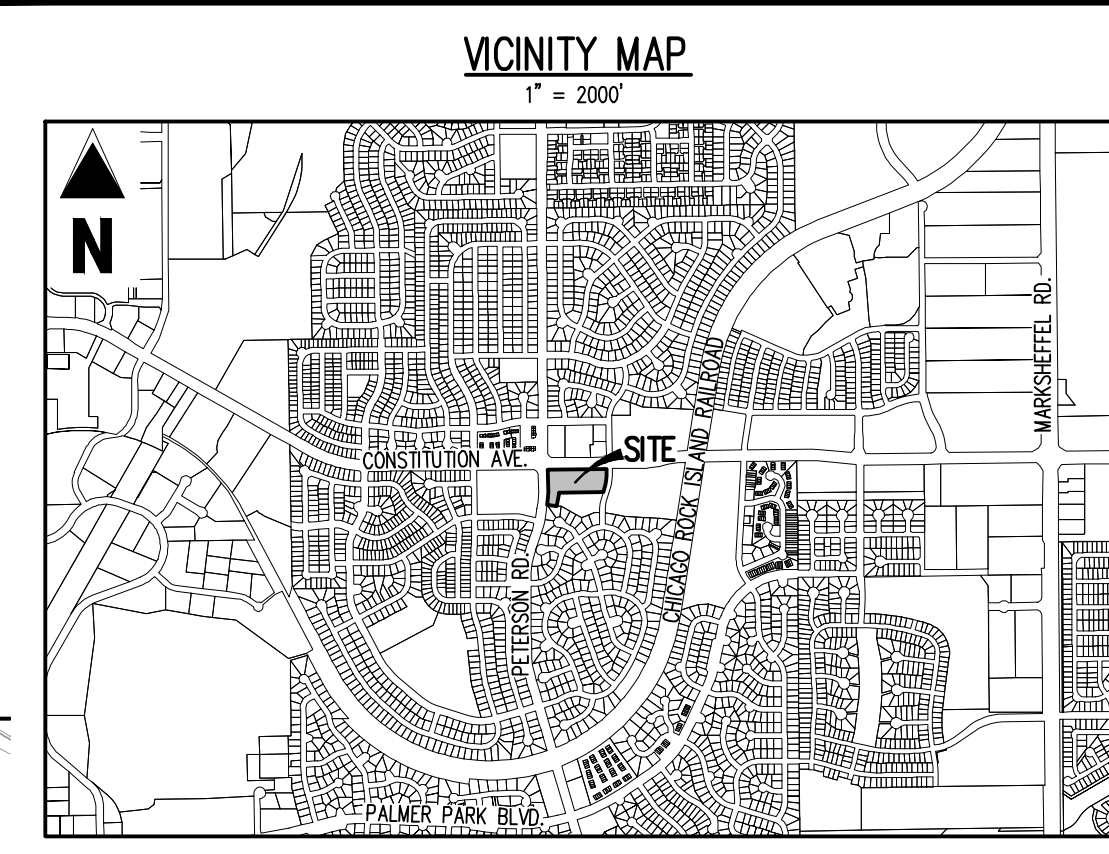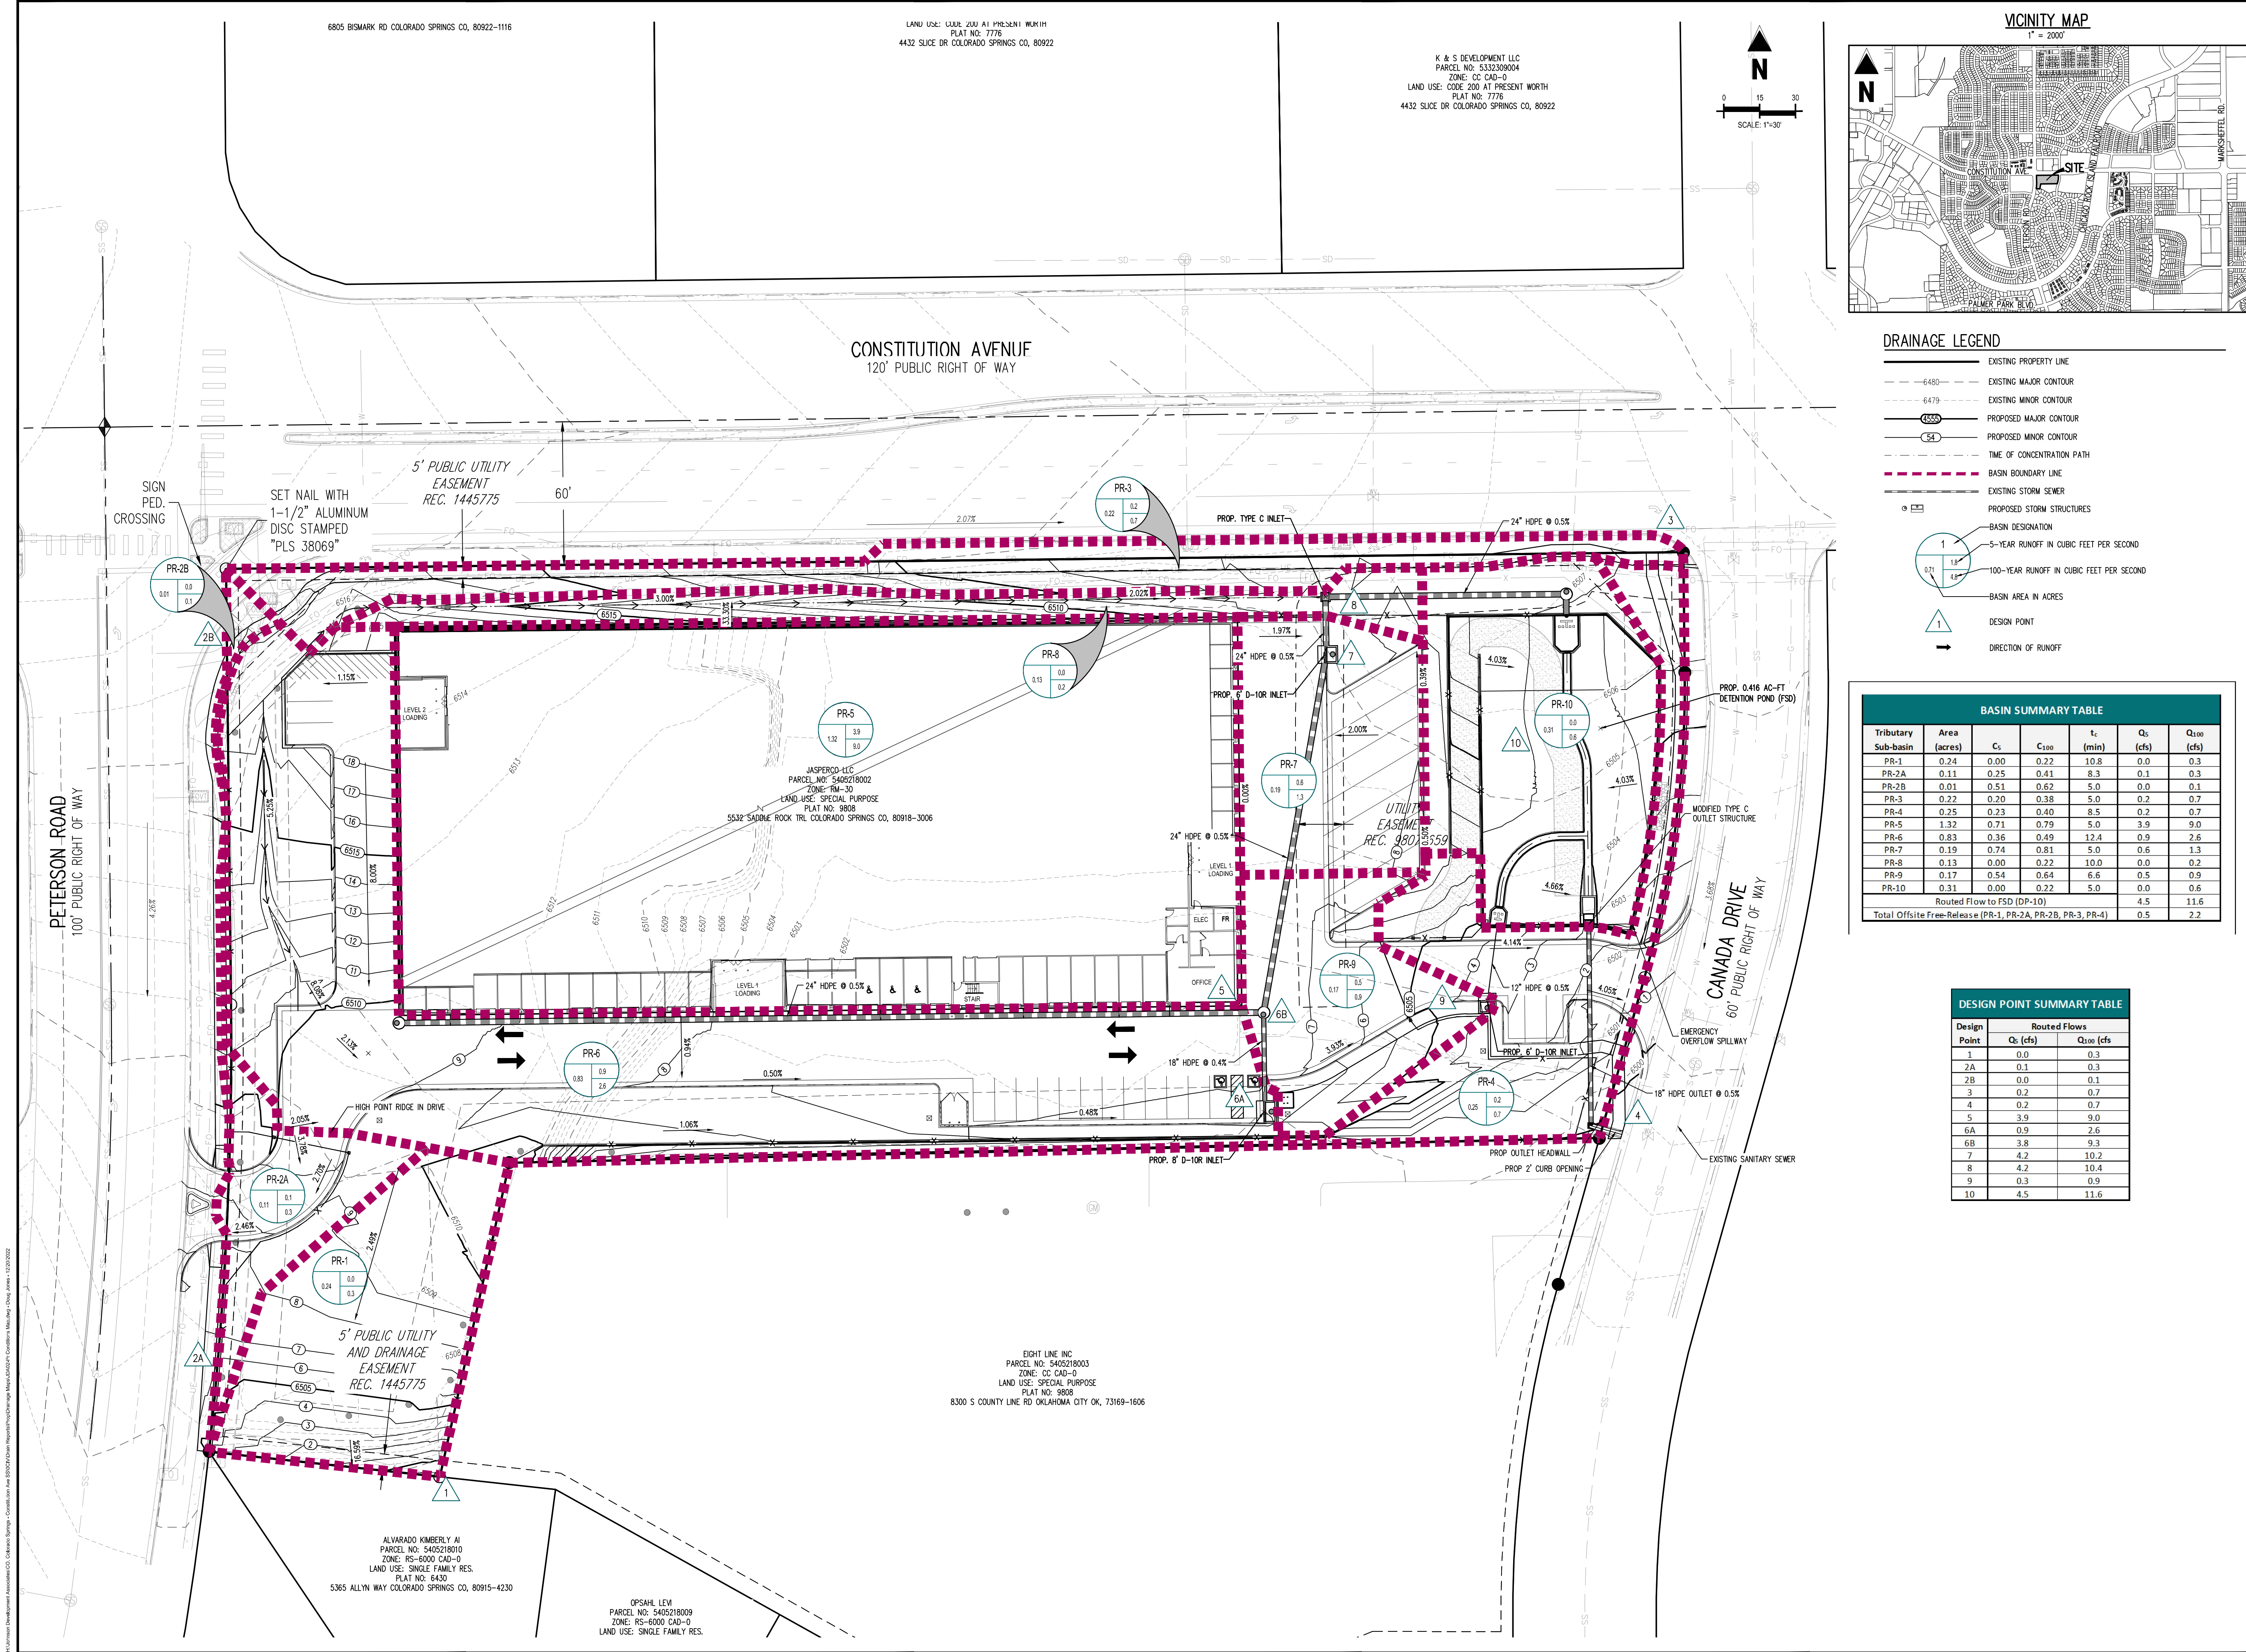

#### BASIN SUMMARY TABLE


Tributary Sub-basin	Area (acres)	$C_s$	$C_{100}$	$t_c$ (min)	$Q_s$ (cfs)	$Q_{100}$ (cfs)	
PR-1	0.24	0.00	0.22	10.8	0.0	0.3	
PR-2A	0.11	0.25	0.41	8.3	0.1	0.3	
PR-2B	0.01	0.51	0.62	5.0	0.0	0.1	
PR-3	0.22	0.20	0.38	5.0	0.2	0.7	
PR-4	0.25	0.23	0.40	8.5	0.2	0.7	
PR-5	1.32	0.71	0.79	5.0	3.9	9.0	
PR-6	0.83	0.36	0.49	12.4	0.9	2.6	
PR-7	0.19	0.74	0.81	5.0	0.6	1.3	
PR-8	0.13	0.00	0.22	10.0	0.0	0.2	
PR-9	0.17	0.54	0.64	6.6	0.5	0.9	
PR-10	0.31	0.00	0.22	5.0	0.0	0.6	
Routed Flow to FSD (DP-10)						4.5	11.6
Total Offsite Free-Release (PR-1, PR-2A, PR-2B, PR-3, PR-4)						0.5	2.2

#### DESIGN POINT SUMMARY TABLE

Design Point	Routed Flows	
	$Q_s$ (cfs)	$Q_{100}$ (cfs)
1	0.0	0.3
2A	0.1	0.3
2B	0.0	0.1
3	0.2	0.7
4	0.2	0.7
5	3.9	9.0
6A	0.9	2.6
6B	3.8	9.3
7	4.2	10.2
8	4.2	10.4
9	0.3	0.9
10	4.5	11.6

**PRELIMINARY**  
NOT FOR BIDDING  
NOT FOR CONSTRUCTION

**COPYRIGHT**  
THESE PLANS ARE AN INSTRUMENT OF SERVICE AND ARE THE PROPERTY OF GALLOWAY, AND MAY NOT BE DUPLICATED, DISCLOSED, OR REPRODUCED WITHOUT THE WRITTEN CONSENT OF GALLOWAY. COPYRIGHTS AND INFRINGEMENTS WILL BE ENFORCED AND PROSECUTED.

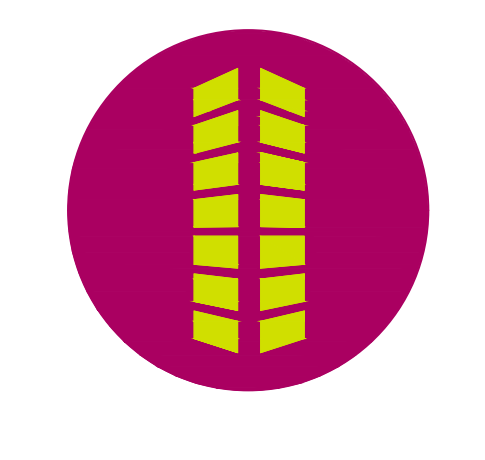

6855 CONSTITUTION AVE. STORAGE SITE  
COMMERCIAL DEVELOPMENT  
DRAINAGE MAP  
FOR JOHNSON DEVELOPMENT ASSOCIATES

LOT 1 OF THE EIGHT LINE SUBDIVISION  
COLORADO SPRINGS, CO 80915

#	Date	Issue / Description	Init.

Project No: JDA02.20  
Drawn By: DDJ  
Checked By: SMB  
Date: 12.20.2022

PROPOSED DRAINAGE MAP

**DR-2**