

PRELIMINARY/FINAL DRAINAGE REPORT

FOR

APPALOOSA HWY 24 SUBDIVISION FILING NO. 1A, LOTS 1, 2 & 3

Prepared For:

**Platte Valley, LLC
1378 Promontory Bluff View
Colorado Springs, CO 80921
719-491-0801**

Prepared By:

**Associated Design Professionals, Inc.
3520 Austin Bluffs Parkway Suite 102
Colorado Springs, CO 80918
719.266-5212**

**ADP Project No. 160504
November 9, 2018**

Please state when improvements will be completed and who will maintain all drainage and WQ structures, please include who currently and in the future is responsible to maintain the concrete channel.





ENGINEER'S STATEMENT:

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports, and said report is in conformity with the master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.

Michael A. Bartusek, P.E. #23329

DEVELOPER'S STATEMENT:

I, the Developer, have read and will comply with all of the requirements specified in this drainage report and plan.

By: _____
Ron Waldthausen

Title: President

Address: Platte Valley, LLC
1378 Promontory Bluff View
Colorado Springs, CO 80921

Filed in accordance the El Paso County Land Development Code, Drainage Criteria Manual Volumes 1 and 2, and the Engineering Criteria Manual, as amended.

Jennifer Irvine, County Engineer/ECM Administrator

Date

Conditions:

PRELIMINARY/FINAL DRAINAGE REPORT
APPALOOSA HWY 24 SUBDIVISION
FILING No. 1A, Lots 1, 2 & 3

PROJECT DESCRIPTION

This drainage report is for the development of the Appaloosa Hwy 24 Subdivision, Filing No. 1A, Lots 1, 2 & 3. The currently vacant 4.67 acre site is located north of U.S. Hwy 24 and east of Amelia Street. It is further described as the southern portion of Section 7, Township 14 South, Range 65 West of the 6th Principal Meridian in El Paso County, Colorado.

All of this lot is located in Sand Creek drainage basin and drains into the central tributary of Sand Creek. An existing 4'x4' box culvert is located at the southeast corner of U.S. Hwy 24 and Amelia St. Also an existing concrete channel is located on the east side of proposed Lot 3.

SOILS

The soil on the site can be described as having a rapid permeability, medium-surface runoff, and moderate to high hazard of erosion. The soils within the site are Truckton Sandy Loams. These soils are classified as Hydrologic Group 'B'.

FLOODPLAIN STATEMENT

A small portion of the developed site is located within a designated FEMA 100-year floodplain according to the information published in the Federal Emergency Management Agency Flood Plain Map No. 08041C0754F, dated March 17, 1997, and LOMR 05-08-0368P dated May 23, 2007. This area falls within the existing concrete channel.

METHOD OF COMPUTATION

The methodology utilized for this report is in accordance with the *El Paso County Drainage Criteria Manual, Volumes 1*, dated May 2014. The Rational Method for computation of runoff was used for determining Sub-Basin flows.

$Q = cia$

Where Q = maximum rate of runoff in cubic feet per second
 c = runoff coefficient representing drainage area characteristics
 i = average rainfall intensity, in inches per hour, for the duration
 required for the runoff to become established
 a = drainage basin size in acres

EXISTING DRAINAGE CONDITIONS

The existing site has been overlotted graded and is covered with rangeland grasses. The western portion of the site drains in a southerly direction toward the existing 4' x 4' box culvert under U.S. Hwy 24. The eastern portion of the site drains westerly toward the 4' x 4' box culvert. An existing concrete channel is located on the east side of the lot, but no flows from this parcel drain to the concrete channel. A portion of the concrete channel has failed with other portions showing signs of joint failure.

The existing sub-basin AEX produces flows of 1.0 cfs for the 5-year storm and 7.9 cfs for the 100-year storm.

DEVELOPED DRAINAGE CONDITIONS

The developed site will be divided into three (3) lots. Lots 1 and 2 will encompass 1.003 acres and 1.008 acres respectively and Lot 3 will encompass 2.655 acres. The proposed land is zoned I-2 (Limited Industrial). Drainage from each lot will be self-contained with flows intercepted by swales along the property lines and directed into proposed Type C inlets and transported to a proposed extended detention basin (EDB) facility in the southwest corner of Lot 3 through a private storm sewer

Lot 1, Sub-basin A1, is located in the northern portion of the site. Sub-basin A1 will produce flows of 2.1 cfs for the 5-year storm and 4.5 cfs for the 100-year storm. These flows will continue south and be intercepted by a proposed swale located along the southerly property line. The flows will then travel west to a proposed type 'C' inlet at the southwest corner of the lot. An 18" HDPE storm sewer will transport these flows through Lot 2.

Lot 2, Sub-basin A2, is located in the center of the site. Sub-basin A2 will produce flows of 2.2 cfs for the 5-year storm and 4.5 cfs for the 100-year storm. As with Lot 1 the site flows will be intercepted by a swale located along the property line. These flows will be intercepted by a type 'C' inlet at the southwest corner of the lot. These flows will combine with the flows from Sub-basin A1 at DP1 to produce flows of 4.3 cfs for the 5-year storm and 8.9 cfs for the 100-year storm. An 18" HDPE storm sewer will transport these flows into the proposed EDB in Lot 3.

Lot 3, Sub-basin A3, is located in the southern portion of the site. Sub-basin A3 will produce flows of 5.9 cfs and 10.8 cfs respectively. These flows will be intercepted by a proposed swale located along the south property line and into the proposed EDB. The combined flows into the basin at DP2 will be 9.3 cfs for the 5-year storm and 19.2 cfs for the 100-year storm.

The proposed 0.648 ac.ft. Private EDB will reduce the site flows into the existing 4' x 4' box culvert to 0.2 cfs for the 5-year storm and 5.3 cfs for the 100-year storm at DP3.

CONCRETE CHANNEL REPAIR

Approximately 120 lf of the existing concrete channel will need to be removed and replaced. The channel section is 6 feet wide and 7 feet deep. The new concrete channel section will be doweled into the concrete channel sections which remain. The channel is currently owned and maintained by the adjacent property owners. Once the repairs to the channel are made the same ownership will remain.

Clarify who the adjacent property owners are.

WATER QUALITY AND DETENTION

Water quality for the site will be achieved within 1 to work on the entire width of the channel, within the 0.656 ac. ft. private extended detention since the eastern half of the existing channel is owner of Lot 3. The remainder of the basin will be on the adjacent property to the east. detention. The facility will have an 18" RCP outlet pipe with a 12" restrictor plate located 6.5" above the pipe invert.

Clarify if you have an easement or permission

The GEC details show the restrictor plate is 5.8" above the invert of the pipe. Please correct.

PRIVATE DRAINAGE FACILITIES

Item	Unit	Quantity	Unit Cost	Total Cost
18" HDPE FES	EA	1	\$450	\$ 450.00
18" HDPE	LF	346	\$45	\$ 15,570.00
Outlet Structure	EA	1	\$5,000	\$ 5,000.00
Emergency Spillway	EA	1	\$1,500	\$ 1,500.00
Type 'C' Inlet	EA	2	\$3,270	\$ 6,540.00

Concrete Channel	LF	120	\$150	\$18,000.00
Concrete Forebay	SF	102	\$10	\$ 1,020.00
Concrete Trickle Channel	LF	24	\$25	\$ 600.00
18" RCP FES	EA	1	\$500	\$ 500.00
18" RCP	LF	50	\$50	\$ 2,500.00
Sub-Total				\$51,680.00
15% Contingency & Engineering				\$ 7,752.00
TOTAL				\$59,432.00

The proposed drainage improvements will be constructed at the time of plat approval. The storm sewer improvement construction and maintenance will be the responsibility of Platte Valley, LLC until such time as the property is sold. At that time the adjacent property owners will assume the maintenance responsibilities, including the EDB which will be maintained by the owner of Lot 3.

Clarify who the adjacent property owners are. Is this the property to the east on the other side of the channel or the proposed new properties with this vacation replat.

DRAINAGE BASIN FEES

Based on a resolution, No. 16-336, passed by the Board of County Commissioners on September 29, 2016, drainage and bridge fees will only be assessed on the two (2) smaller lots in the replat. The area of the two (2) smaller lots is 2.011 acres.

The proposed development is located within the Sand Creek drainage basin. The 2018 drainage basin fee calculation is as follows:

Impervious Coverage	=	75.7%
Area Subject to Fee	=	0.757 x 2.011 acres = 1.522 acre
Sand Creek Basin Fee	=	\$17,197/acre
Drainage Basin Fee	=	\$17,197 x 1.522 = \$26,174
Sand Creek Bridge Fee	=	\$5,210
Bridge Fee	=	\$5,210 x 1.522 = \$7,930

CONCLUSION

The proposed development and subsequent lot developments follow the "Four Step Process" as mandated by the EPA as follows:

Step 1: Employ runoff reduction practices

Runoff has been reduced by disconnecting impervious areas where possible, eliminating "unnecessary" impervious areas and encouraging infiltration into suitable soils.

- Impervious areas have been directed to earth swales to encourage infiltration.
- Gravel will be used in portions of the lots to reduce the impervious of the areas.

Step 2: Stabilize drainageways

All drainageways, ditches and channels have been stabilized by the following methods:

- Tributaries have been left in their relatively natural state where possible.
- New drainageways and swales have been stabilized with either riprap or erosion control fabric depending on the erosion potential.
- No new roadside ditches are proposed for the development.

Step 3: Provide water quality capture volume (WQCV)

The proposed development will disturb approximately 4.5 acres, although the initial disturbance will only be 0.6 acres.

Step 4: Consider need for industrial and commercial BMP's.


The development of this project will not affect sensitive waters.
The development of this site will have little impact on downstream properties once the EDB is constructed.

REFERENCES

1. City of Colorado Springs and El Paso County (1994). *Drainage Criteria Manual Volume 1* (DCM).
2. City of Colorado Springs and El Paso County (1994). *Drainage Criteria Manual Volume II* (DCM).
3. Soil Survey of El Paso County Area, Colorado by USDA, NRCS.
4. *El Paso County (January 2006) Engineering Criteria Manual*.
5. Urban Drainage and Flood Control District (June 2011). *Urban Storm Drainage Criteria Manual, Volume 1-3*.
6. Sand Creek Drainage Basin Planning Study (DBPS).
7. Preliminary/Final Drainage Plan and Report for the Appaloosa Hwy 24 Subdivision by Oliver E. Watts, Consulting Engineer, dated November, 2000.
8. Resolution No. 16-336. Board of County Commissioners, County of El Paso, State of Colorado.

APPENDIX A

MAPS


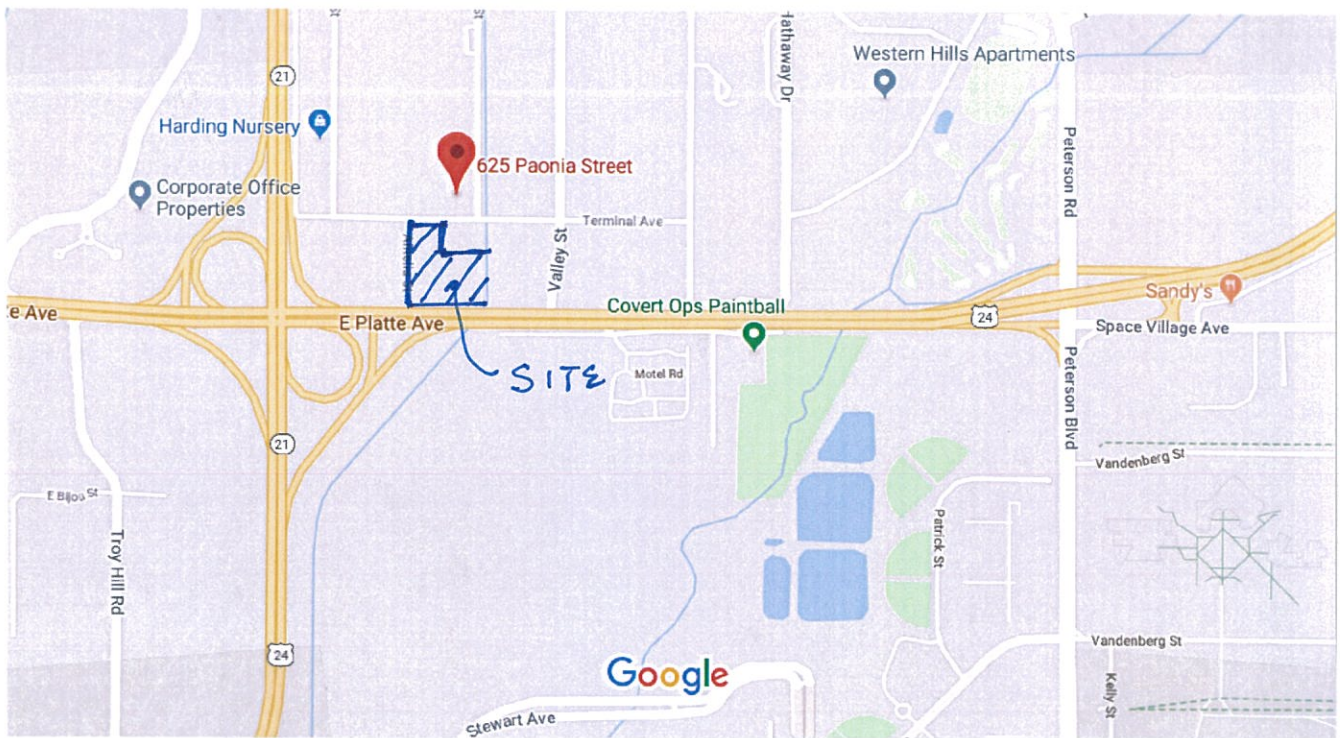


VICINITY MAP

N.T.S.



3520 Austin Bluffs Pkwy, Suite 102
Colorado Springs, CO 80918
(719) 266-5212
fax: (719) 266-5341

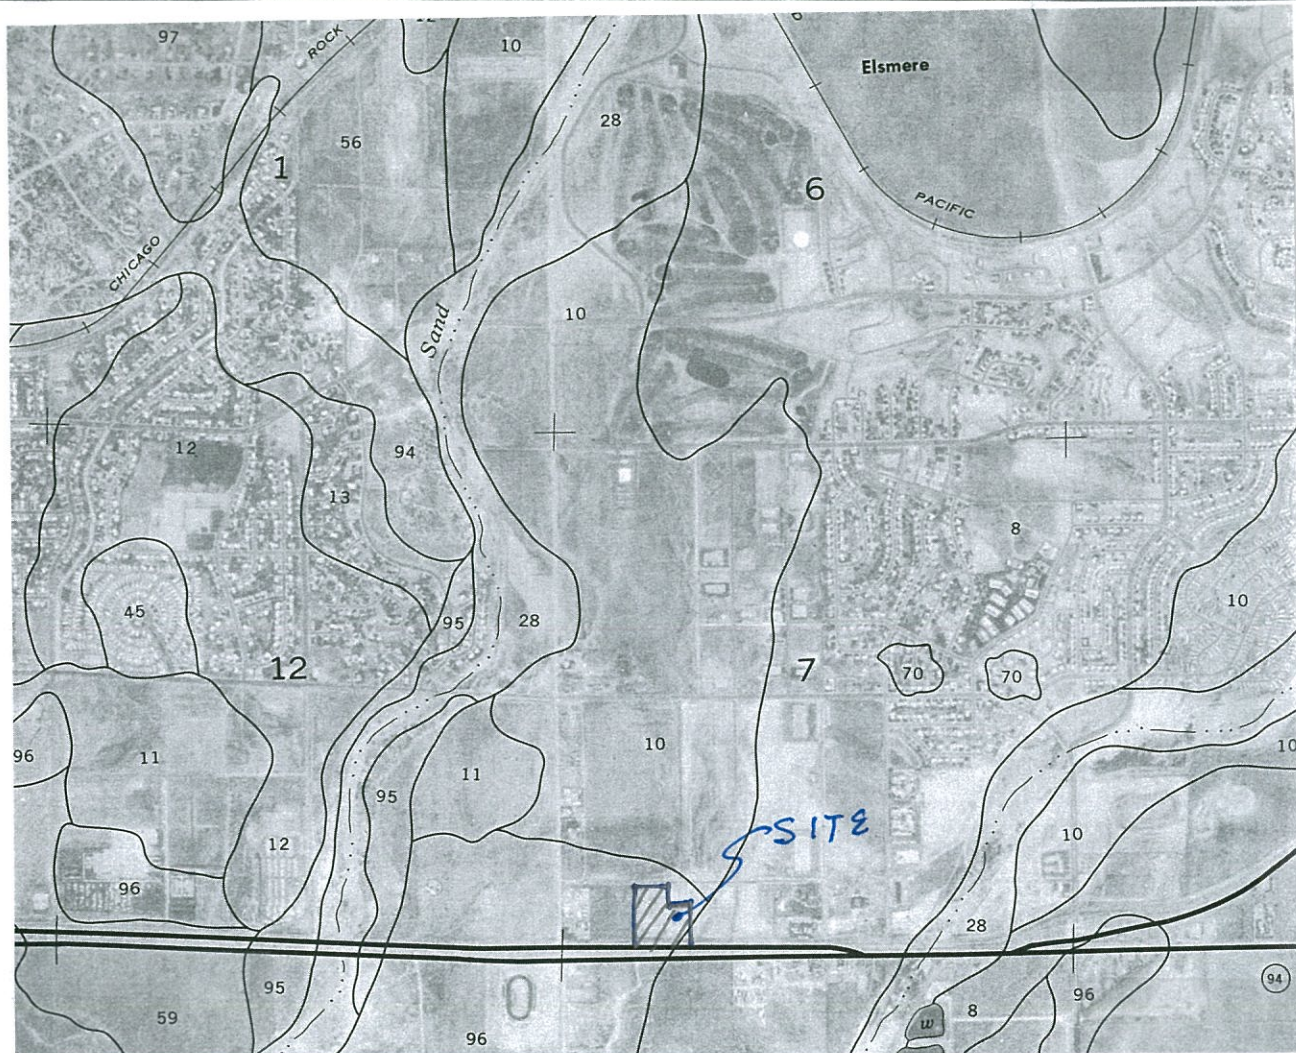

SOILS MAP

N.T.S.

ADPcIVIL
ENGINEERING FOR THE FUTURE

3520 Austin Bluffs Pkwy, Suite 102
Colorado Springs, CO 80918
(719) 266-5212
fax: (719) 266-5341


APPENDIX B

DESIGN CALCULATIONS

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

Project: Appaloosa Hwy 24 Sub Fill 1A

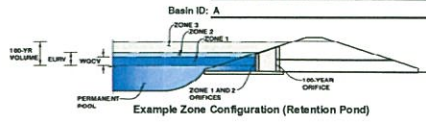

Required Volume Calculation

Selected BMP Type =	EDB
Watershed Area =	4.58 acre
Watershed Length =	550 ft
Watershed Slope =	0.012 ft/ft
Watershed Imperviousness =	75.70% percent
Percentage Hydrologic Soil Group A =	0.0% percent
Percentage Hydrologic Soil Group B =	100.0% percent
Percentage Hydrologic Soil Group C/D =	0.0% percent
Desired WQCV Drain Time =	40.0 hours
Location for 1-hr Rainfall Depth =	Denser - Capital Building
Water Quality Capture Volume (WQCV) =	0.116 acre-foot
Excess Urban Runoff Volume (EURV) =	0.383 acre-foot
2-yr Runoff Volume (P1 = 1.19 in.) =	0.322 acre-foot
5-yr Runoff Volume (P1 = 1.5 in.) =	0.425 acre-foot
10-yr Runoff Volume (P1 = 1.75 in.) =	0.532 acre-foot
25-yr Runoff Volume (P1 = 2 in.) =	0.657 acre-foot
50-yr Runoff Volume (P1 = 2.25 in.) =	0.751 acre-foot
100-yr Runoff Volume (P1 = 2.52 in.) =	0.875 acre-foot
500-yr Runoff Volume (P1 = 3.01 in.) =	1.093 acre-foot
Approximate 2-yr Detention Volume =	0.302 acre-foot
Approximate 5-yr Detention Volume =	0.400 acre-foot
Approximate 10-yr Detention Volume =	0.499 acre-foot
Approximate 25-yr Detention Volume =	0.536 acre-foot
Approximate 50-yr Detention Volume =	0.557 acre-foot
Approximate 100-yr Detention Volume =	0.591 acre-foot

Stage-Storage Calculation

Zone 1 Volume (WQCV) =	0.116 acre-foot
Zone 2 Volume (EURV - Zone 1) =	0.267 acre-foot
Zone 3 (100yr + 1/2 WQCV - Zones 1 & 2) =	0.265 acre-foot
Total Detention Basin Volume =	0.648 acre-foot
Initial Surcharge Volume (SV) =	USEF ft³
Initial Surcharge Depth (SD) =	USEF ft
Total Available Detention Depth (H _{det}) =	USEF ft
Depth of Trickle Channel (H _{tr}) =	USEF ft
Slope of Trickle Channel (S _{tr}) =	USEF ft/ft
Slopes of Main Basin Sides (S _{mb}) =	USEF H:V
Basin Length-to-Width Ratio (R _{L/W}) =	USEF
Initial Surcharge Area (A _{sv}) =	USEF ft²
Surcharge Volume Length (L _{sv}) =	USEF ft
Surcharge Volume Width (W _{sv}) =	USEF ft
Depth of Basin Floor (H _{100yr}) =	USEF ft
Length of Basin Floor (L _{100yr}) =	USEF ft
Width of Basin Floor (W _{100yr}) =	USEF ft
Area of Basin Floor (A _{100yr}) =	USEF ft²
Volume of Basin Floor (V _{100yr}) =	USEF ft³
Depth of Main Basin (H _{mb}) =	USEF ft
Length of Main Basin (L _{mb}) =	USEF ft
Width of Main Basin (W _{mb}) =	USEF ft
Area of Main Basin (A _{mb}) =	USEF ft²
Volume of Main Basin (V _{mb}) =	USEF ft³
Calculated Total Basin Volume (V _{total}) =	USEF acre-foot

Stage - Storage Description	Stage (ft)	Optional Override Stage (ft)	Length (ft)	Width (ft)	Area (ft²)	Optional Override Area (ft²)	Area (acre)	Volume (ft³)	Volume (ac-ft)
Top of Micropool	--	0.00	--	--	--	30	0.001	271	0.006
	--	0.25	--	--	--	2,320	0.053	880	0.020
	--	0.50	--	--	--	2,580	0.059	1,555	0.036
	--	0.75	--	--	--	2,840	0.065	2,295	0.053
	--	1.00	--	--	--	3,100	0.071	3,100	0.071
	--	1.25	--	--	--	3,360	0.077	3,970	0.091
	--	1.50	--	--	--	3,620	0.083	4,905	0.113
	--	1.75	--	--	--	3,880	0.089	5,005	0.126
	--	2.00	--	--	--	4,140	0.095	7,014	0.161
	--	2.25	--	--	--	4,400	0.101	8,148	0.187
	--	2.50	--	--	--	4,660	0.107	9,344	0.214
	--	2.75	--	--	--	4,920	0.113	10,606	0.243
	--	3.00	--	--	--	5,180	0.119	11,934	0.274
	--	3.25	--	--	--	5,440	0.125	13,326	0.306
	--	3.50	--	--	--	5,700	0.131	14,784	0.339
	--	3.75	--	--	--	5,960	0.137	16,306	0.374
	--	4.00	--	--	--	6,220	0.143	17,894	0.411
	--	4.25	--	--	--	6,480	0.149	19,546	0.449
	--	4.50	--	--	--	6,740	0.155	21,264	0.488
	--	4.75	--	--	--	7,000	0.161	23,046	0.529
	--	5.00	--	--	--	7,260	0.167	24,894	0.571
	--	5.25	--	--	--	7,520	0.173	26,806	0.615
	--	5.50	--	--	--	7,780	0.179	28,784	0.661
	--	5.75	--	--	--	8,040	0.185	30,826	0.708
	--	6.00	--	--	--	8,300	0.191	32,934	0.756
	--	6.25	--	--	--	8,560	0.197	35,106	0.806
	--	6.50	--	--	--	8,820	0.202	37,344	0.857
	--	6.75	--	--	--	9,080	0.208	39,646	0.910
	--	7.00	--	--	--	9,340	0.214		

EL @ 6209 on GEC shows an area of 2,888 sf


EL @ 6211 on GEC shows an area of 4,589 sf

These were just spot checks on two elevations showing that the areas in the spreadsheet and on the GEC do not match. Please revise so that the areas in the design spreadsheet and the GEC match.

These volumes do not meet the minimum required for WQCV and EURV.

DETENTION BASIN STAGE-STORAGE TABLE BUILDER

UD-Detention, Version 3.07 (February 2017)

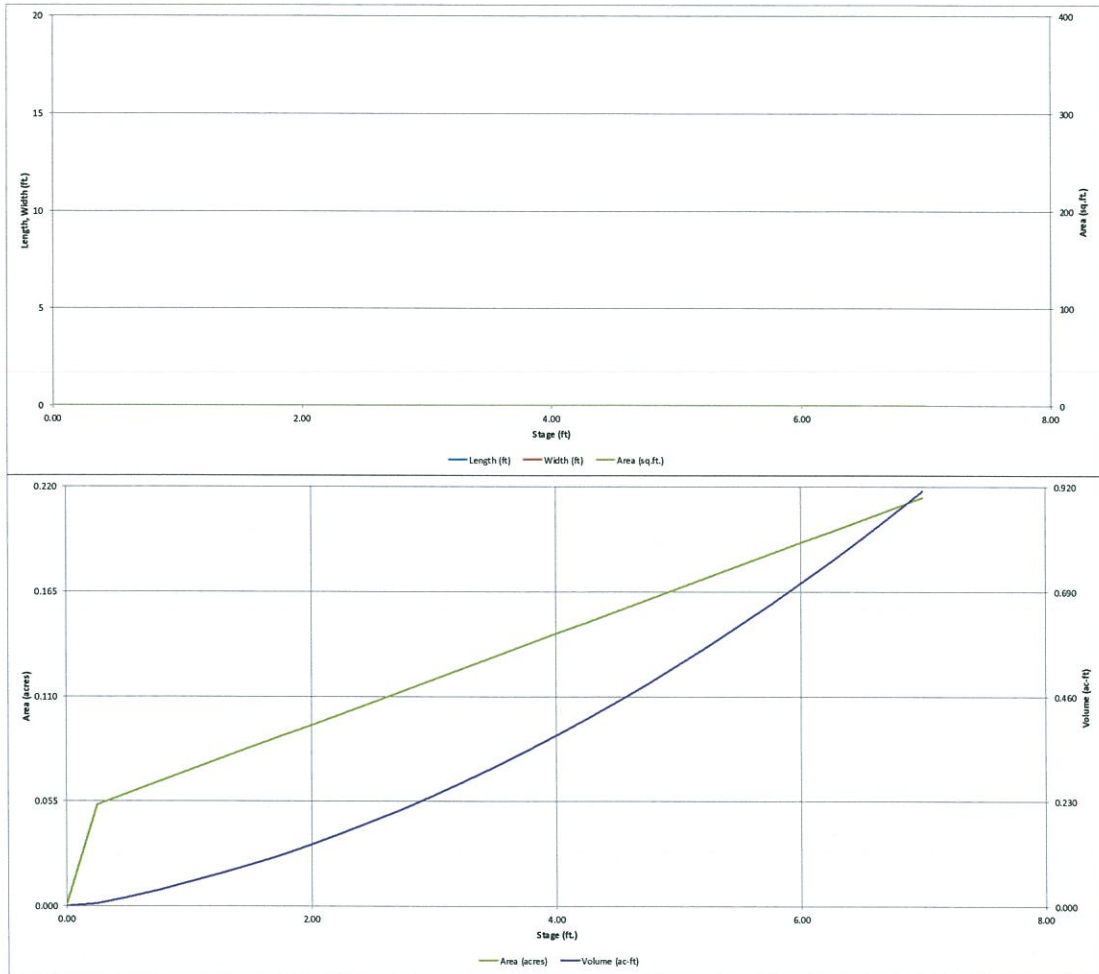


Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Project: Appaloosa Hwy 24 Sub Fil 1A

Basin ID: A

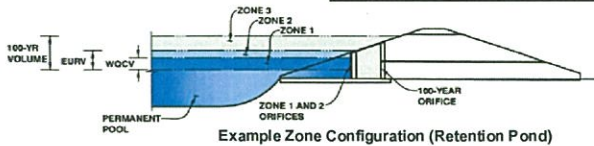

	Stage (ft)	Zone Volume (ac-ft)	Outlet Type
Zone 1 (WQCV)	1.78	0.116	Orifice Plate
Zone 2 (EURV)	4.07	0.267	Orifice Plate
Zone 3 (100+1/2WQCV)	5.69	0.265	Weir & Pipe (Restrict)
		0.648	Total

User Input: Orifice at Underdrain Outlet (typically used to drain WQCV in a filtration BMP)

Underdrain Orifice Invert Depth = N/A ft (distance below the filtration media surface)
Underdrain Orifice Diameter = N/A inches

Calculated Parameters for Underdrain

Underdrain Orifice Area = N/A ft²
Underdrain Orifice Centroid = N/A feet

User Input: Orifice Plate with one or more orifices or Elliptical Slot Weir (typically used to drain WQCV and/or EURV in a sedimentation BMP)

Invert of Lowest Orifice = 0.00 ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Orifice Plate = 4.20 ft (relative to basin bottom at Stage = 0 ft)
Orifice Plate: Orifice Vertical Spacing = 16.80 inches
Orifice Plate: Orifice Area per Row = N/A inches

Calculated Parameters for Plate

WQ Orifice Area per Row = N/A ft²
Elliptical Half-Width = N/A feet
Elliptical Slot Centroid = N/A feet
Elliptical Slot Area = N/A ft²

User Input: Stage and Total Area of Each Orifice Row (numbered from lowest to highest)

	Row 1 (required)	Row 2 (optional)	Row 3 (optional)	Row 4 (optional)	Row 5 (optional)	Row 6 (optional)	Row 7 (optional)	Row 8 (optional)
Stage of Orifice Centroid (ft)	0.00	1.40	2.80					
Orifice Area (sq. inches)	1.12	1.12	1.12					

	Row 9 (optional)	Row 10 (optional)	Row 11 (optional)	Row 12 (optional)	Row 13 (optional)	Row 14 (optional)	Row 15 (optional)	Row 16 (optional)
Stage of Orifice Centroid (ft)								
Orifice Area (sq. inches)								

User Input: Vertical Orifice (Circular or Rectangular)

Invert of Vertical Orifice = Not Selected ft (relative to basin bottom at Stage = 0 ft)
Depth at top of Zone using Vertical Orifice = Not Selected ft (relative to basin bottom at Stage = 0 ft)
Vertical Orifice Diameter = Not Selected inches

Calculated Parameters for Vertical Orifice

Vertical Orifice Area = Not Selected ft²
Vertical Orifice Centroid = Not Selected feet

The overflow weir height should be 4.07 feet based on the GEC.

User Input: Overflow Weir (Dropbox) and Gate (Flat or Sloped)

Overflow Weir Front Edge Height, H_o = 4.26 ft (relative to basin bottom at Stage = 0 ft)
Overflow Weir Front Edge Length = 3.00 feet
Overflow Weir Slope = 4.00 H:V (enter zero for flat gate)
Horiz. Length of Weir Sides = 3.00 feet
Overflow Gate Open Area % = 70%
Debris Clogging % = 50%

Calculated Parameters for Overflow Weir

Overflow Weir Upper Edge, H_u = 4.95 feet
Overflow Weir Slope Length = 3.09 feet
Gate Open Area / 100-yr Orifice Area = 13.19
Overflow Gate Open Area w/o Debris = 6.49 ft²
Overflow Gate Open Area w/ Debris = 3.25 ft²

Based on the GEC, this should be 4 feet.

User Input: Outlet Pipe w/ Flow Restriction Plate (Circular Orifice, Restrictor Plate, or Rectangular Orifice)

Depth to Invert of Outlet Pipe = Zone 3 Restrictor 0.00 ft (distance below basin bottom at Stage = 0 ft)
Outlet Pipe Diameter = Not Selected 18.00 inches
Restrictor Plate Height Above Pipe Invert = Not Selected 5.80 inches

Calculated Parameters for Outlet Pipe w/ Flow Restriction Plate

Outlet Orifice Area = Zone 3 Restrictor 0.49 ft²
Outlet Orifice Centroid = Not Selected 0.28 feet
Half-Central Angle of Restrictor Plate on Pipe = Not Selected 1.21 radians

User Input: Emergency Spillway (Rectangular or Trapezoidal)

Spillway Invert Stage = 5.80 ft (relative to basin bottom at Stage = 0 ft)
Spillway Crest Length = 15.00 feet
Spillway End Slopes = 4.00 H:V
Freeboard above Max Water Surface = 1.00 feet

Calculated Parameters for Spillway

Spillway Design Flow Depth = 0.44 feet
Stage at Top of Freeboard = 7.24 feet
Basin Area at Top of Freeboard = 0.21 acres




Routed Hydrograph Results

	WQCV	EURV	2 Year	5 Year	10 Year	25 Year	50 Year	100 Year	500 Year
Design Storm Return Period =	0.53	1.07	1.19	1.50	1.75	2.00	2.25	2.52	3.01
One-Hour Rainfall Depth (in) =	0.116	0.383	0.322	0.425	0.532	0.657	0.751	0.875	1.093
Calculated Runoff Volume (acre-ft) =									
OPTIONAL Override Runoff Volume (acre-ft) =									
Inflow Hydrograph Volume (acre-ft) =	0.116	0.383	0.321	0.424	0.531	0.656	0.750	0.875	1.092
Predevelopment Unit Peak Flow, q (cfs/acre) =	0.00	0.00	0.01	0.02	0.20	0.67	0.93	1.25	1.77
Predevelopment Peak Q (cfs) =	0.0	0.0	0.1	0.1	0.9	3.1	4.3	5.7	8.1
Peak Inflow Q (cfs) =	2.0	6.4	5.4	7.1	8.9	11.0	12.5	14.6	18.2
Peak Outflow Q (cfs) =	0.1	0.2	0.2	0.2	1.4	3.6	5.1	5.3	6.7
Ratio Peak Outflow to Predevelopment Q =	N/A	N/A	N/A	1.9	1.5	1.2	1.2	0.9	0.8
Structure Controlling Flow =	Plate	Plate	Plate	Plate	Overflow Gate 1	Overflow Gate 1	Outlet Plate 1	Outlet Plate 1	Spillway
Max Velocity through Gate 1 (fps) =	N/A	N/A	N/A	N/A	0.2	0.5	0.8	0.8	0.8
Max Velocity through Gate 2 (fps) =	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Time to Drain 97% of Inflow Volume (hours) =	38	60	57	62	62	60	59	57	55
Time to Drain 99% of Inflow Volume (hours) =	40	65	61	67	68	67	67	66	65
Maximum Ponding Depth (ft) =	1.67	3.89	3.46	4.17	4.52	4.76	4.90	5.22	5.88
Area at Maximum Ponding Depth (acres) =	0.09	0.14	0.13	0.15	0.16	0.16	0.16	0.17	0.19
Maximum Volume Stored (acre-ft) =	0.106	0.359	0.301	0.399	0.452	0.490	0.511	0.565	0.685

Must release at or below the predeveloped rate. Revise.

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

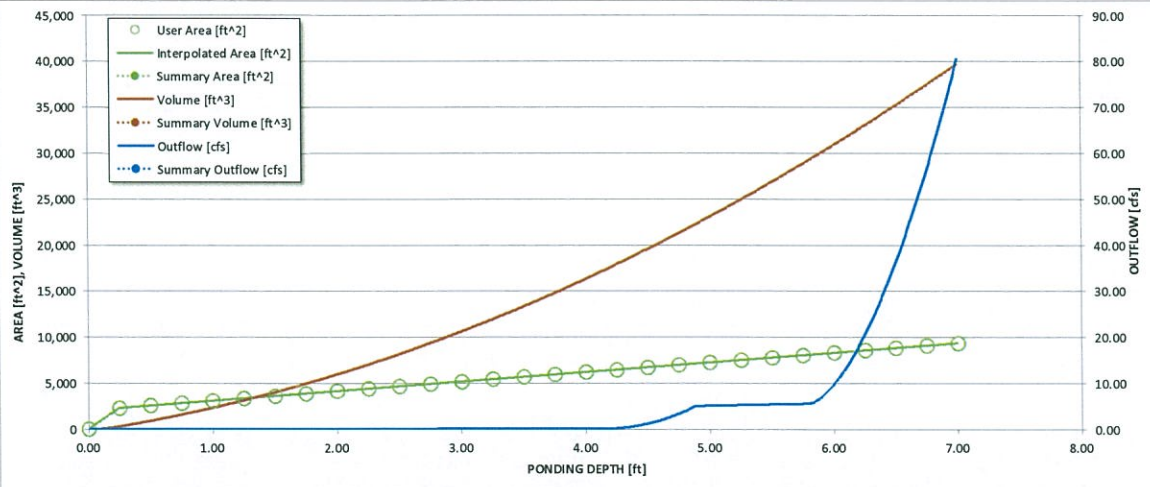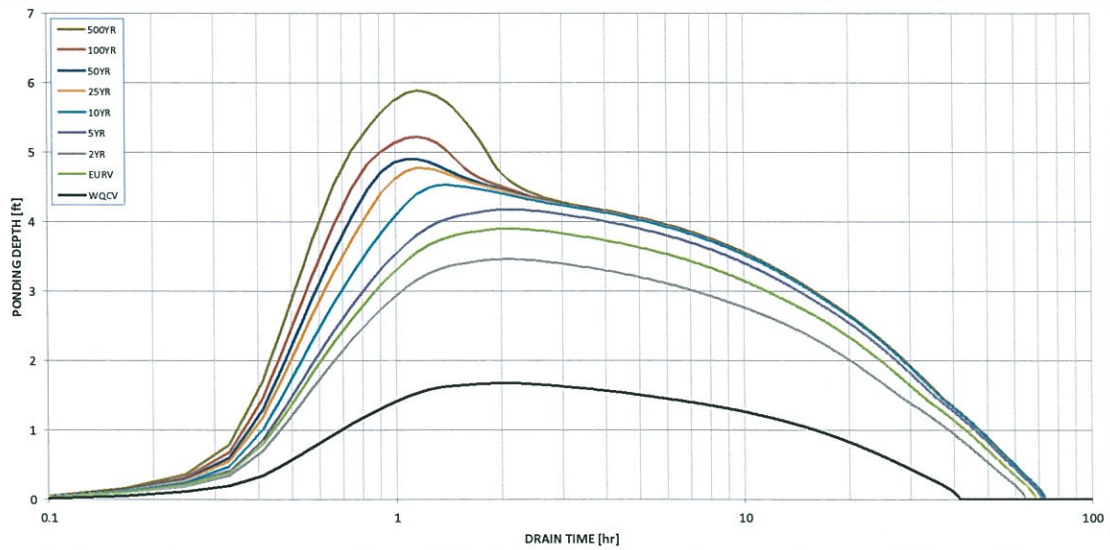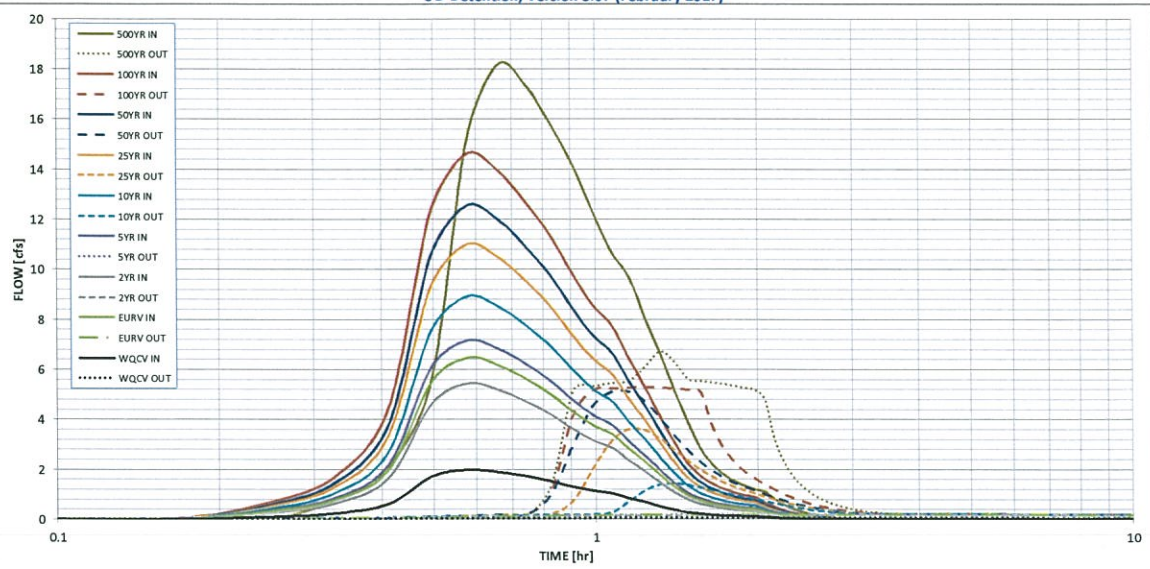

S-A-V-D Chart Axis Override	X-axis	Left Y-Axis	Right Y-Axis
minimum bound			
maximum bound			

Detention Basin Outlet Structure Design

UD-Detention, Version 3.07 (February 2017)

Summary Stage-Area-Volume-Discharge Relationships

The user can create a summary S-A-V-D by entering the desired stage increments and the remainder of the table will populate automatically.

The user should graphically compare the summary S-A-V-D table to the full S-A-V-D table in the chart to confirm it captures all key transition points.

[illegible]

For best results, include the stages of all grade slope changes (e.g. ISV and Floor) from the S-A-V table on Sheet 'Basin'.

Also include the inverts of all outlets (e.g. vertical orifice, overflow grate, and spillway, where applicable).

Also include the inverts of all outlets (e.g. vertical orifice, overflow grate, and spillway, where applicable).

APPENDIX C

DESIGN CHARTS

Table 6-6. Runoff Coefficients for Rational Method
(Source: UDFCD 2001)

Land Use or Surface Characteristics	Percent Impervious	Runoff Coefficients											
		2-year		5-year		10-year		25-year		50-year		100-year	
		HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D	HSG A&B	HSG C&D
Business													
Commercial Areas	95	0.79	0.80	0.81	0.82	0.83	0.84	0.85	0.87	0.87	0.88	0.88	0.89
Neighborhood Areas	70	0.45	0.49	0.49	0.53	0.53	0.57	0.58	0.62	0.60	0.65	0.62	0.68
Residential													
1/8 Acre or less	65	0.41	0.45	0.45	0.49	0.49	0.54	0.54	0.59	0.57	0.62	0.59	0.65
1/4 Acre	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
1/3 Acre	30	0.18	0.22	0.25	0.30	0.32	0.38	0.39	0.47	0.43	0.52	0.47	0.57
1/2 Acre	25	0.15	0.20	0.22	0.28	0.30	0.36	0.37	0.46	0.41	0.51	0.46	0.56
1 Acre	20	0.12	0.17	0.20	0.26	0.27	0.34	0.35	0.44	0.40	0.50	0.44	0.55
Industrial													
Light Areas	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Heavy Areas	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Parks and Cemeteries	7	0.05	0.09	0.12	0.19	0.20	0.29	0.30	0.40	0.34	0.46	0.39	0.52
Playgrounds	13	0.07	0.13	0.16	0.23	0.24	0.31	0.32	0.42	0.37	0.48	0.41	0.54
Railroad Yard Areas	40	0.23	0.28	0.30	0.35	0.36	0.42	0.42	0.50	0.46	0.54	0.50	0.58
Undeveloped Areas													
Historic Flow Analysis-- Greenbelts, Agriculture	2	0.03	0.05	0.09	0.16	0.17	0.26	0.26	0.38	0.31	0.45	0.36	0.51
Pasture/Meadow	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Forest	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50
Exposed Rock	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Offsite Flow Analysis (when landuse is undefined)	45	0.26	0.31	0.32	0.37	0.38	0.44	0.44	0.51	0.48	0.55	0.51	0.59
Streets													
Paved	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Gravel	80	0.57	0.60	0.59	0.63	0.63	0.66	0.66	0.70	0.68	0.72	0.70	0.74
Drive and Walks	100	0.89	0.89	0.90	0.90	0.92	0.92	0.94	0.94	0.95	0.95	0.96	0.96
Roofs	90	0.71	0.73	0.73	0.75	0.75	0.77	0.78	0.80	0.80	0.82	0.81	0.83
Lawns	0	0.02	0.04	0.08	0.15	0.15	0.25	0.25	0.37	0.30	0.44	0.35	0.50

Figure 6-25. Estimate of Average Concentrated Shallow Flow


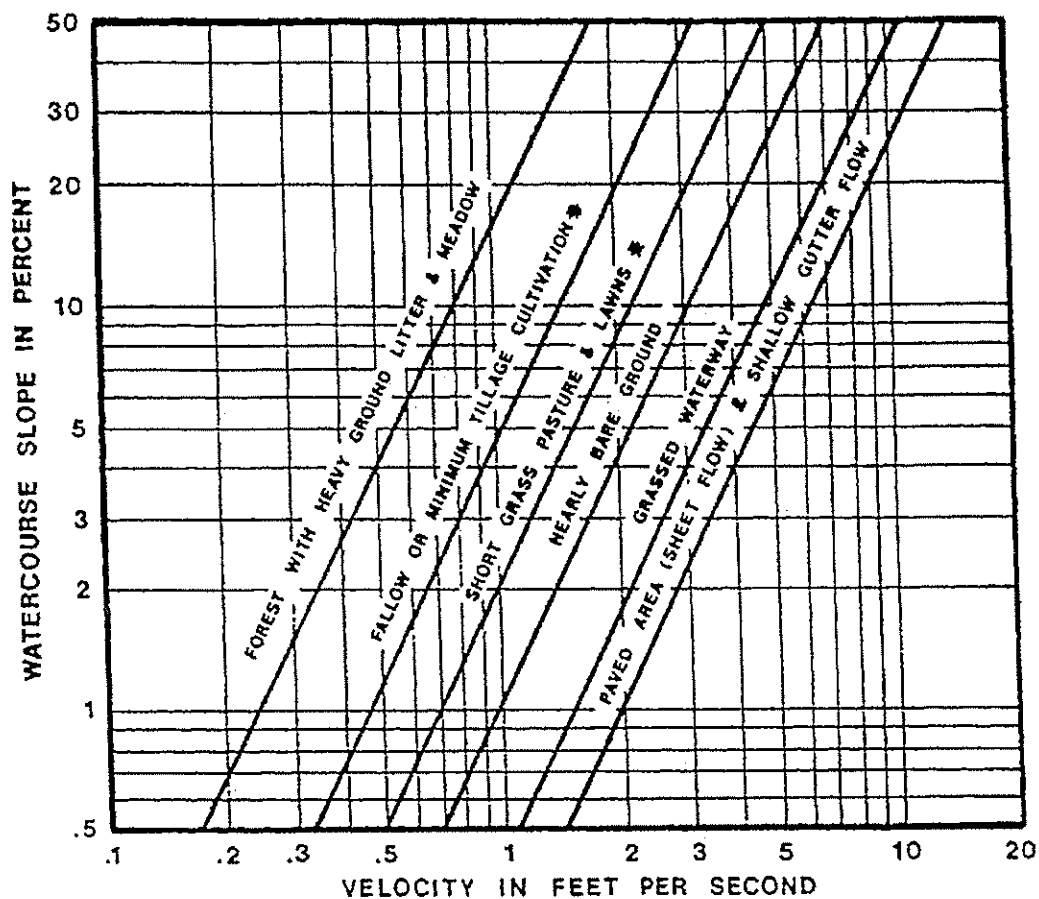


Figure 6-5. Colorado Springs Rainfall Intensity Duration Frequency

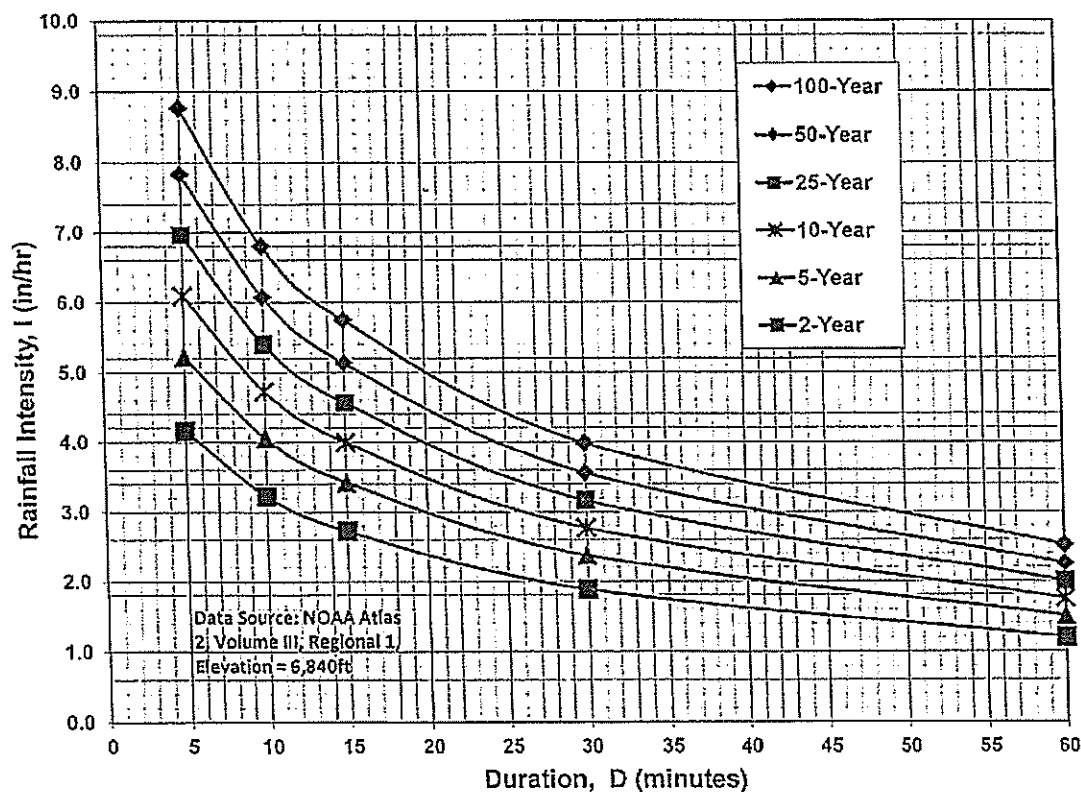

IDF Equations

$$I_{100} = -2.52 \ln(D) + 12.735$$

$$I_{50} = -2.25 \ln(D) + 11.375$$

$$I_{25} = -2.00 \ln(D) + 10.111$$

$$I_{10} = -1.75 \ln(D) + 8.847$$

$$I_5 = -1.50 \ln(D) + 7.583$$

$$I_2 = -1.19 \ln(D) + 6.035$$

Note: Values calculated by equations may not precisely duplicate values read from figure.



ADPCivil
ENGINEERING FOR THE FUTURE

[illegible]

S H E E T

1 of 2

A diagram of a circular basin. The top half of the circle is labeled "A1A" and the bottom half is labeled "1.0". Two arrows point from text labels to the circle: one from "BASIN DESIGNATION" to the "A1A" label, and another from "BASIN AREA, ACRES" to the "1.0" label.

XX

XX

5 YEAR STORM, CFS

100 YEAR STORM, CFS

DESIGN POINT

XX XX.X
XX.X

5 YEAR ACCUMULATED FLOW, CFS


100 YEAR ACCUMULATED FLOW, CFS

SUB-BASIN BOUNDARY

DIRECTION OF DRAINAGE FLOW



(IN FEET)
1 inch = 50 ft.

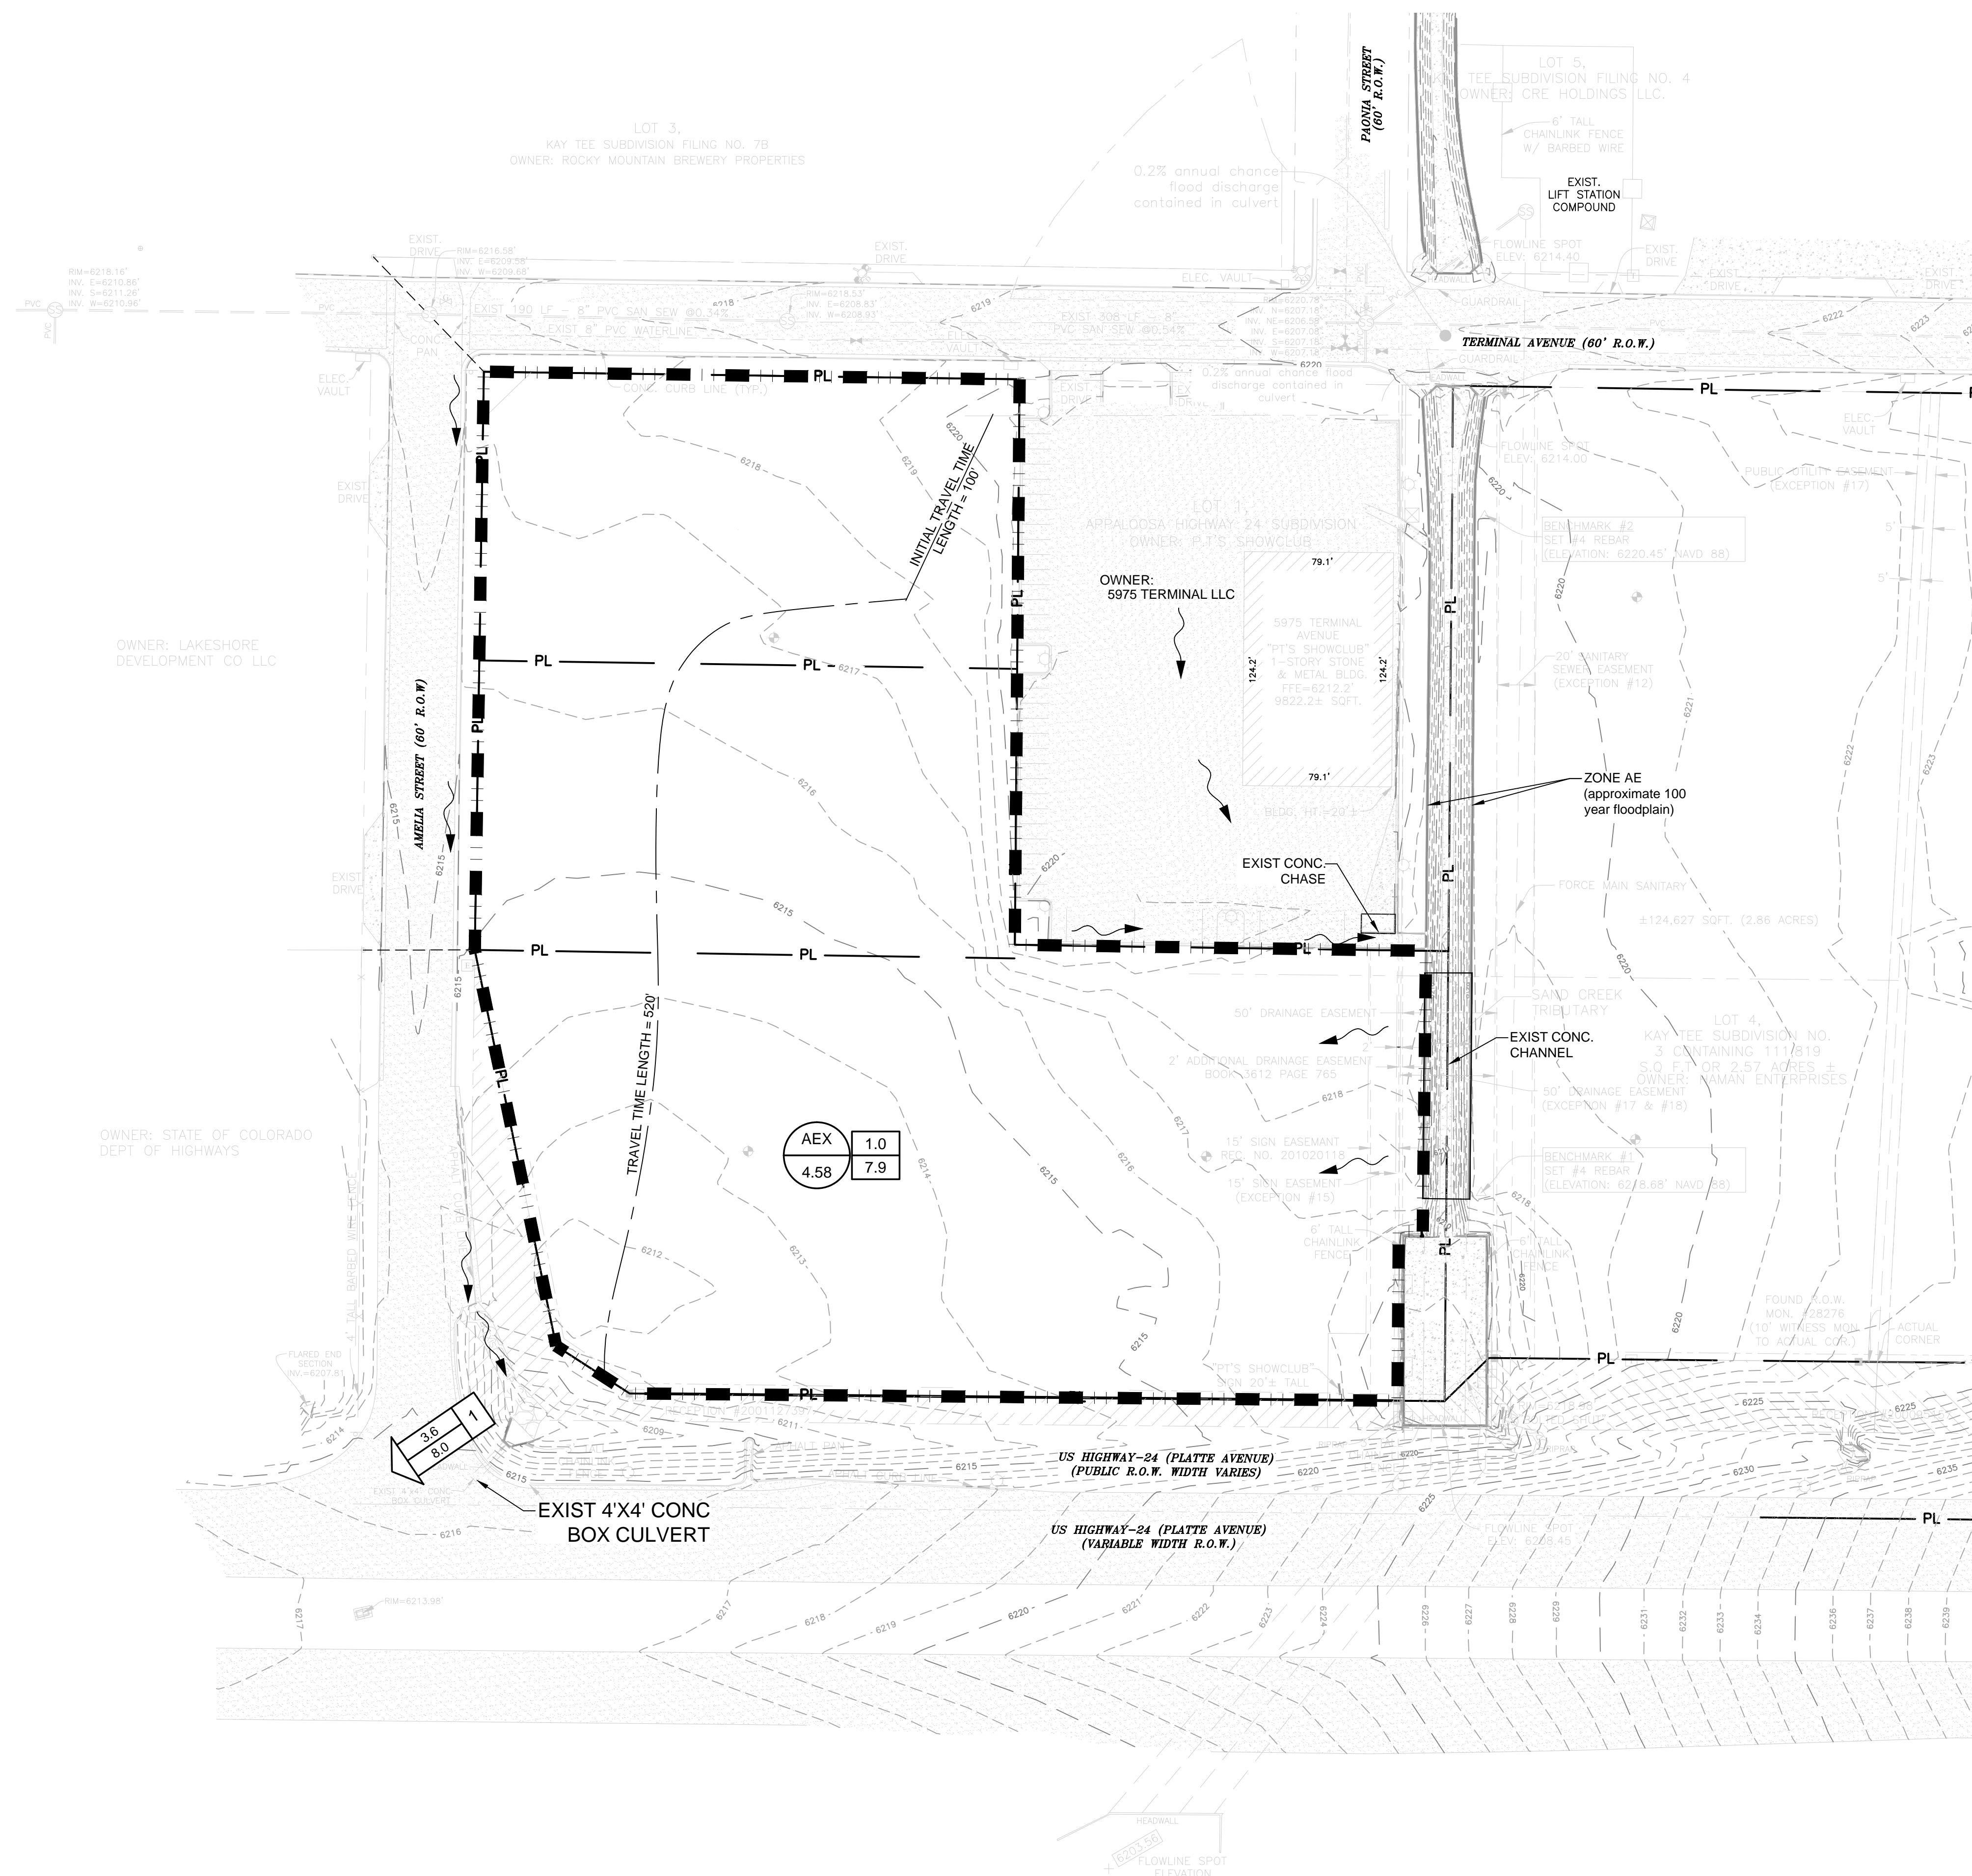



ADPCivil
ENGINEERING FOR THE FUTURE

[illegible]

S H E E T

2 of 2

A diagram of a circular basin. The basin is represented by a circle divided horizontally. The top half contains the text 'A1A' and the bottom half contains the text '1.0'. An arrow points from the text 'BASIN DESIGNATION' to the 'A1A' label. Another arrow points from the text 'BASIN AREA, ACRES' to the '1.0' label.

XX

XX

5 YEAR STORM, CFS

100 YEAR STORM, CF

DESIGN POINT



XX XX.X XX.X

5 YEAR ACCUMULATED FLOW, CFS

100 YEAR ACCUMULATED FLOW, CFS


SUB-BASIN BOUNDARY

DIRECTION OF DRAINAGE FLOW

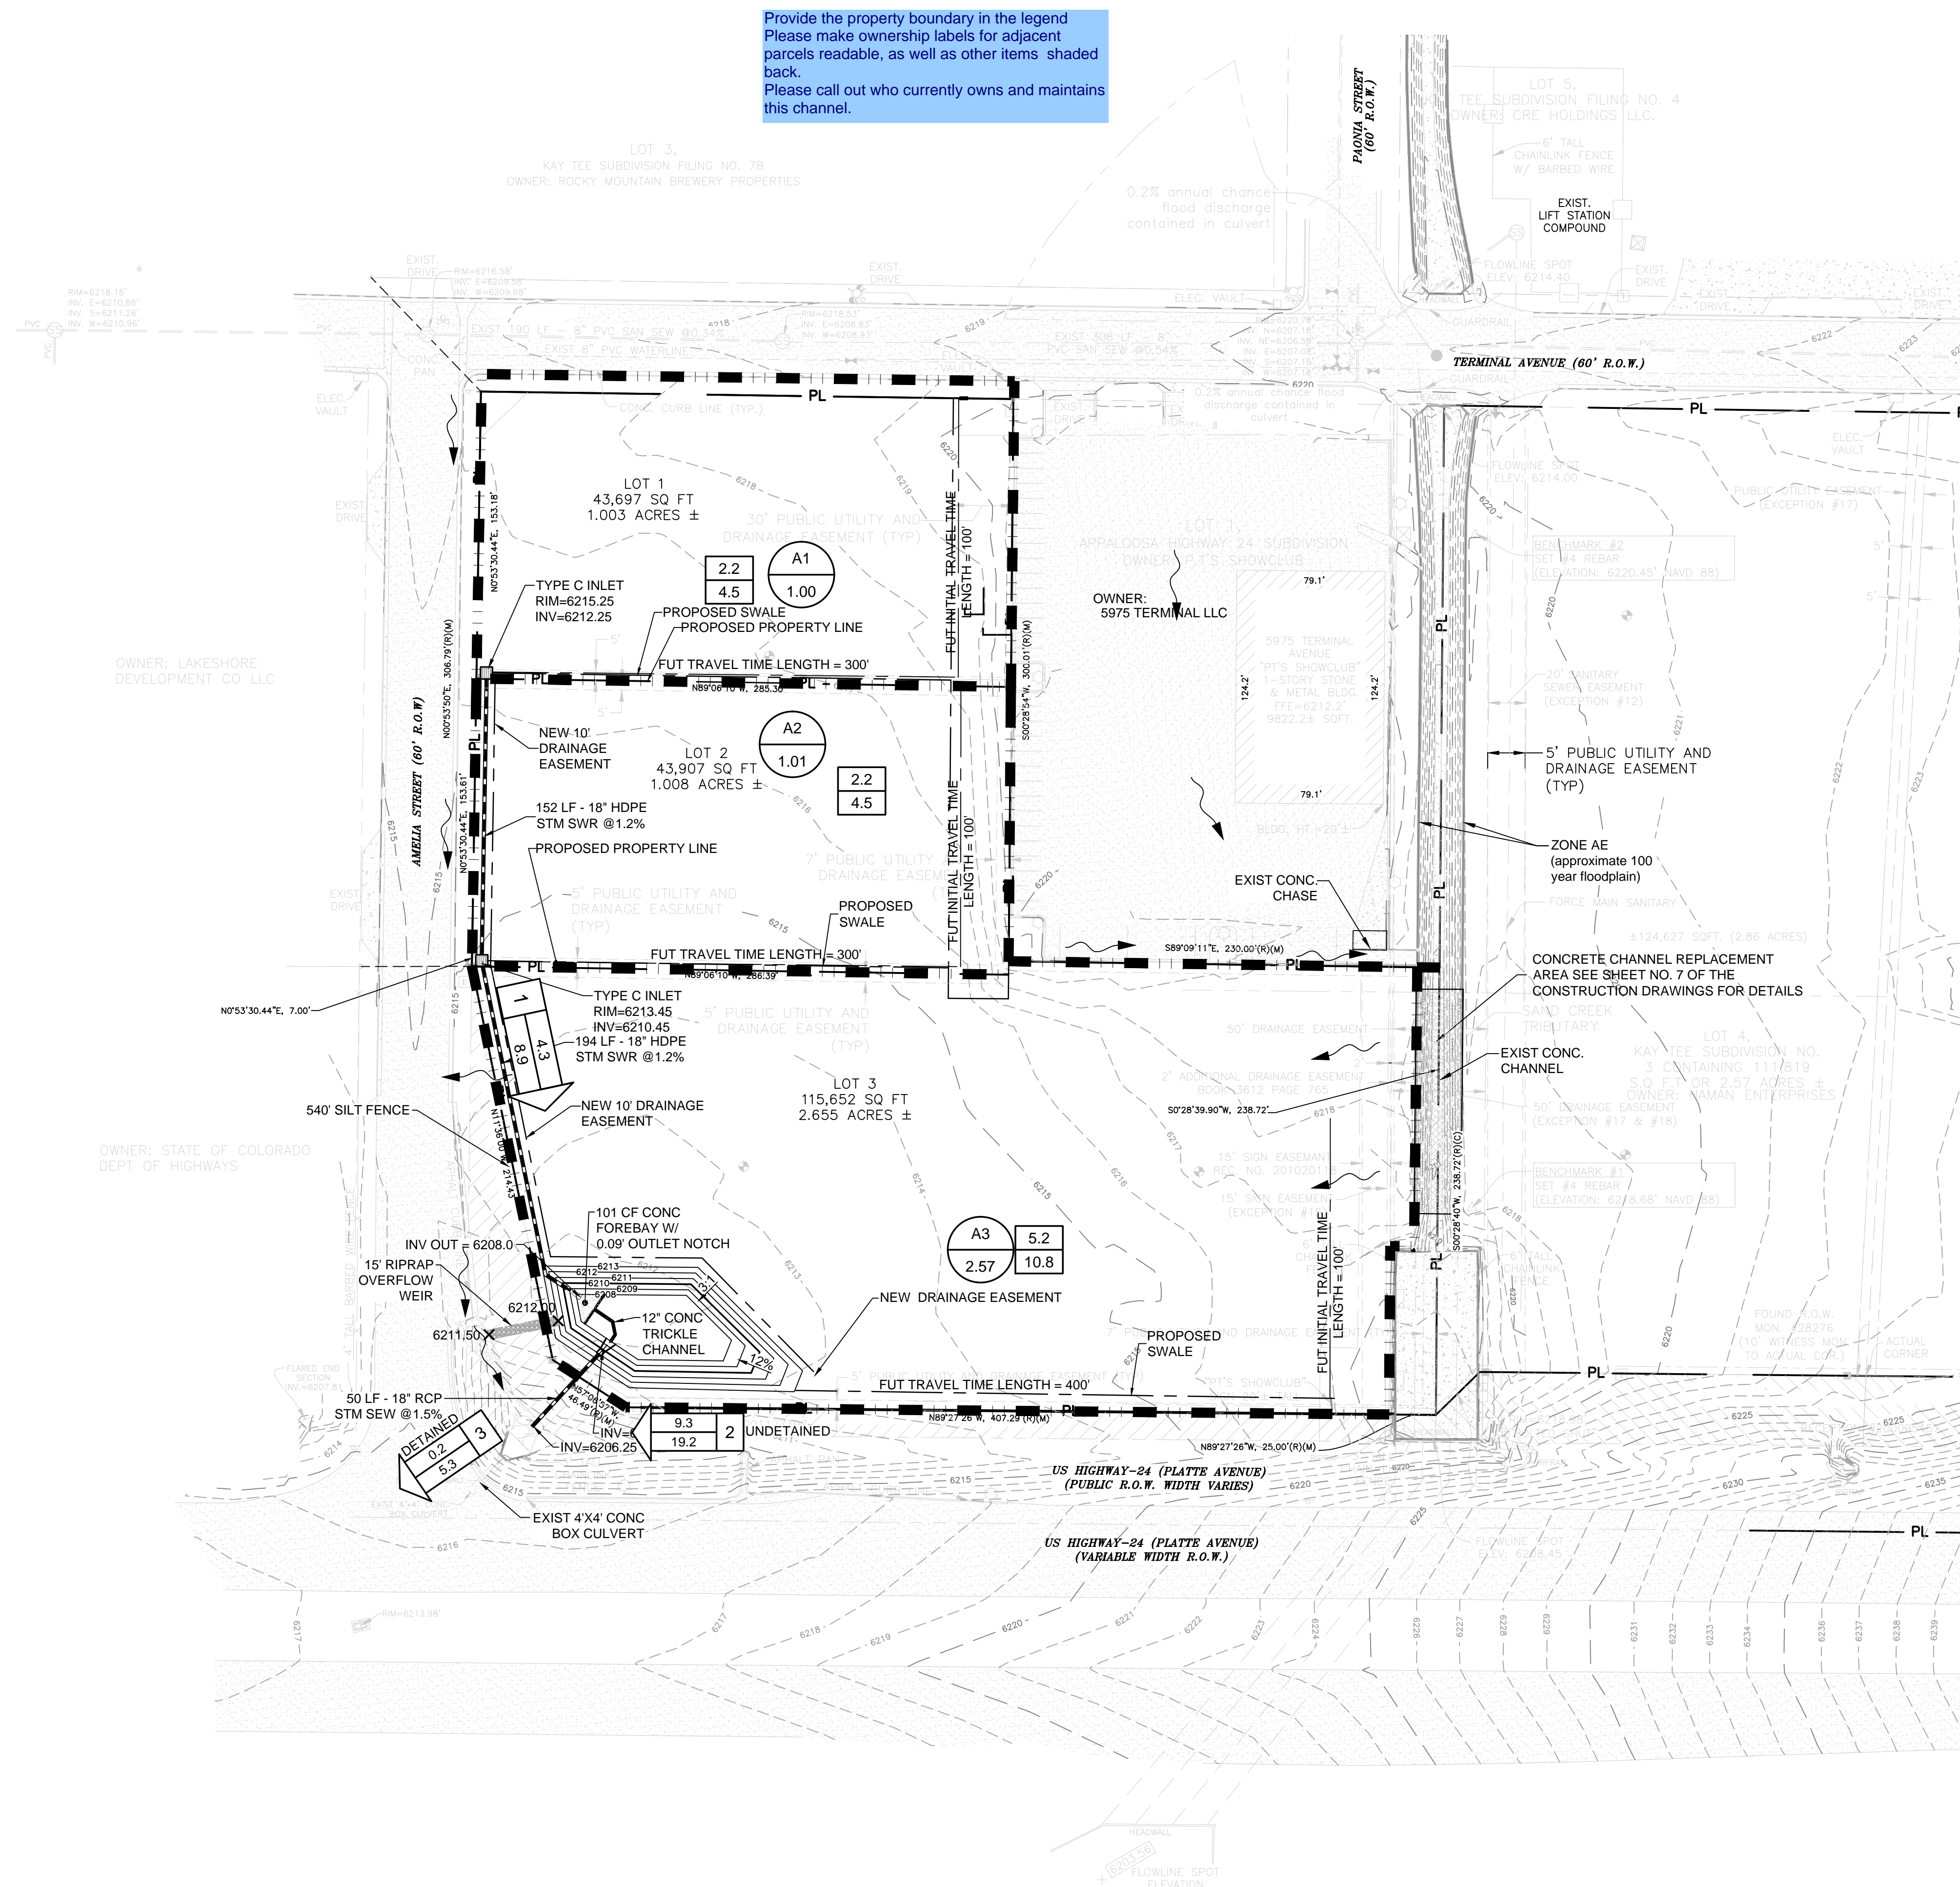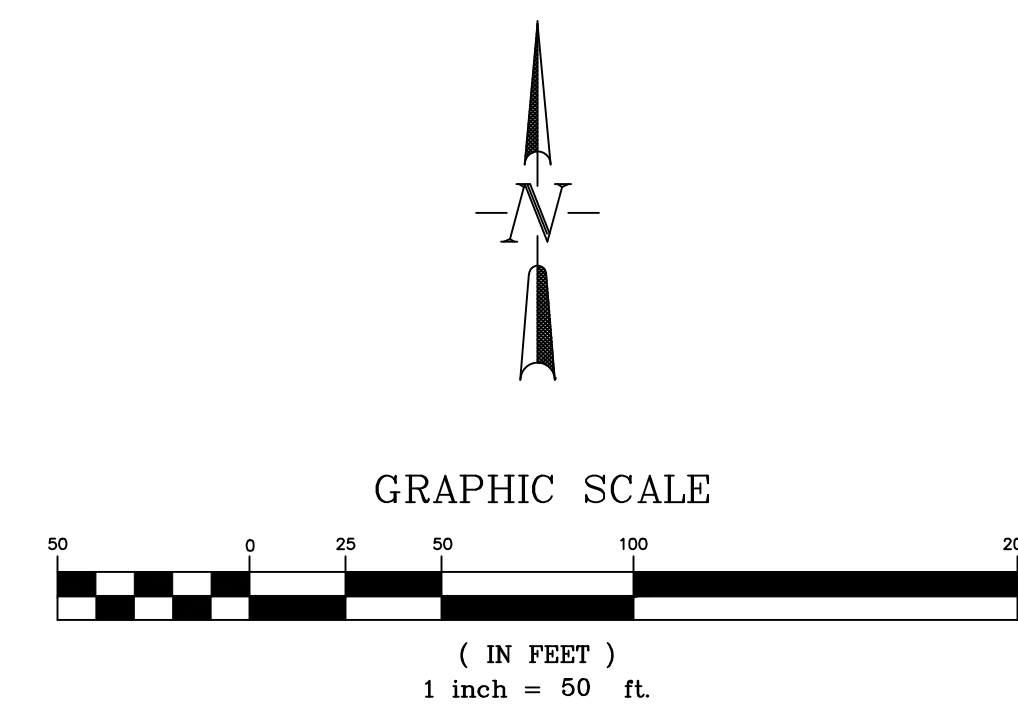


Markup Summary

dsdgrimm (11)




Subject: Engineer
Page Label: 25
Lock: Unlocked
Author: dsdgrimm
Date: 12/10/2018 8:30:56 AM
Color: ■

Provide the property boundary in the legend
Please make ownership labels for adjacent parcels readable, as well as other items shaded back.
Please call out who currently owns and maintains this channel.




Subject: Engineer
Page Label: 1
Lock: Unlocked
Author: dsdgrimm
Date: 12/10/2018 8:31:28 AM
Color: ■

Please state when improvements will be completed and who will maintain all drainage and WQ structures, please include who currently and in the future is responsible to maintain the concrete channel.




Subject: Engineer
Page Label: 14
Lock: Unlocked
Author: dsdgrimm
Date: 12/10/2018 9:19:15 AM
Color: ■

These volumes do not meet the minimum required for WQCV and EURV.



Subject: Engineer
Page Label: 16
Lock: Unlocked
Author: dsdgrimm
Date: 12/10/2018 9:20:50 AM
Color: ■

The overflow weir height should be 4.07 feet based on the GEC.




Subject: Engineer
Page Label: 14
Lock: Unlocked
Author: dsdgrimm
Date: 12/10/2018 9:59:18 AM
Color: ■

EL @ 6209 on GEC shows an area of 2,888 sf

EL @ 6211 on GEC shows an area of 4,589 sf

These were just spot checks on two elevations showing that the areas in the spreadsheet and on the GEC do not match. Please revise so that the areas in the design spreadsheet and the GEC match.



Subject: Engineer
Page Label: 4
Lock: Unlocked
Author: dsdgrimm
Date: 12/5/2018 2:05:08 PM
Color: ■

southerly

[illegible]

existing concrete channel will need to be removed and replaced.
: wide and 7 feet deep. The new concrete channel section will be
hannel sections which remain. The channel is currently owned and
property owners. Once the repairs to the channel are made the
Clarify who the adjacent property owners are.


ENTION Clarify if you have an easement or permission to work on the entire width of the channel, since the eastern half of the existing channel is on the adjacent property to the east.

ction is 6 feet wide and 7 feet deep. The new concrete channel section will be be concrete channel sections which remain. The channel is currently owned and the adjacent property owners. Once the repairs to the channel are made the in will remain.

ITY AND DETENTION
for the site will be achieved within by 0.110 acre-feet of storage, 1.85 ft deep
46 ac. ft private extended detention basin (EDB) which will be maintained by the
The remainder of the basin will provide the storage volume required for
facility will have an 18" RCP outlet pipe with a 12" restrictor plate located
pipe invert.

The GEC details show the restrictor plate is 5.8" above the invert of the pipe. Please correct

	0.021	0.024	0.031	0.036	0.040
1	0.031	0.03	0.03	0.04	0.040
2	0.03	0.03	0.03	0.03	0.03
3	0.04	0.04	0.04	0.04	0.04
4	0.04	0.04	0.04	0.04	0.04
5	0.04	0.04	0.04	0.04	0.04
6	0.04	0.04	0.04	0.04	0.04
7	0.04	0.04	0.04	0.04	0.04
8	0.04	0.04	0.04	0.04	0.04
9	0.04	0.04	0.04	0.04	0.04
10	0.04	0.04	0.04	0.04	0.04
11	0.04	0.04	0.04	0.04	0.04
12	0.04	0.04	0.04	0.04	0.04
13	0.04	0.04	0.04	0.04	0.04
14	0.04	0.04	0.04	0.04	0.04
15	0.04	0.04	0.04	0.04	0.04
16	0.04	0.04	0.04	0.04	0.04
17	0.04	0.04	0.04	0.04	0.04
18	0.04	0.04	0.04	0.04	0.04
19	0.04	0.04	0.04	0.04	0.04
20	0.04	0.04	0.04	0.04	0.04

Subject: Engineer
Page Label: 16
Lock: Unlocked
Author: dsdgrimm
Date: 12/7/2018 12:50:59 PM
Color: 

Must release at or below the predeveloped rate. Revise.