

0N0032208

5217004001
EL PASO COUNTY HEALTH DEPARTMENT
COLORADO SPRINGS, COLORADO

P 20

SEWAGE DISPOSAL INSPECTION FORM

permit # 1238
DATE 7/27/81
ENVIRONMENTALIST Krueger

APPROVAL:
YES NO

LOCATION (street number) 6902 Juniper Dr OCCUPANT Dell

LEGAL DESCRIPTION

TYPE OF CONSTRUCTION Temporary MH NO. OF BEDROOMS 3

SYSTEM INSTALLED BY Dell

COMMERCIAL MFG. yes SIZE 1250


TYPE OF MATERIAL concrete NO. COMPARTMENTS 2

WIDTH LENGTH DEPTH (total) LIQ. CAP.

DISPOSAL FIELD: BED OR TRENCH DEPTH 24" WIDTH 36" LENGTH 160' SQ. FT. 480

DISTANCE BETWEEN LINES 25' ROCK river DEPTH 12" UNDER 6" OVER 2'

LEACHING PITS (NO.) LINING MATERIAL CAPACITY SQ. FT.

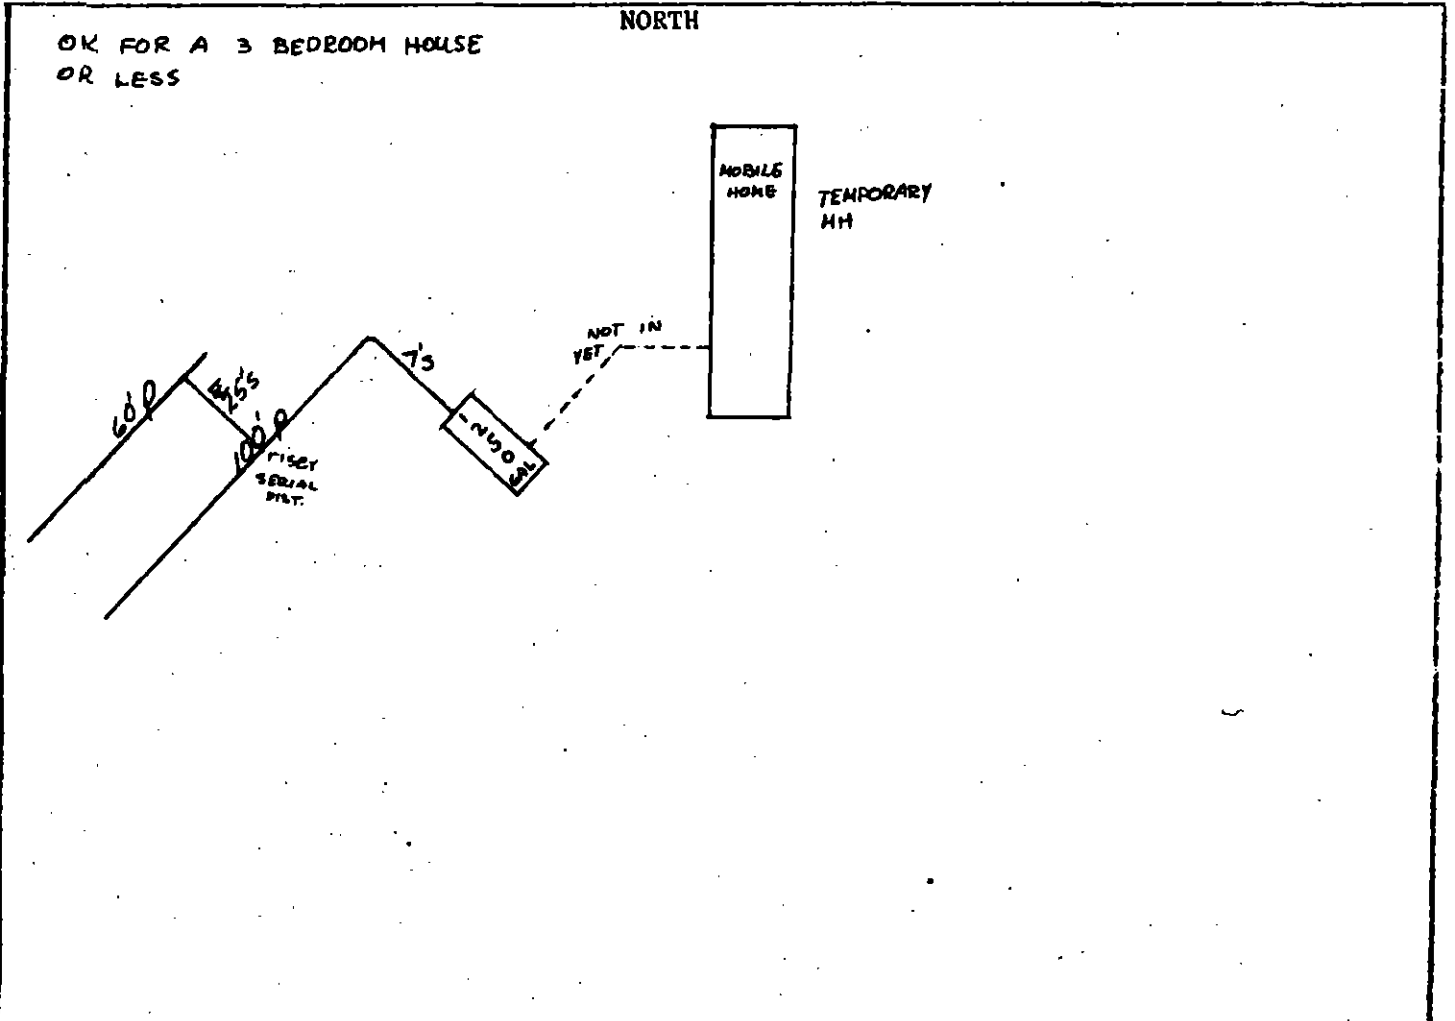

1238

Acres 0.70

EL PASO COUNTY • COUNTY HEALTH DEPARTMENT
501 North Footh Avenue • Colorado Springs, Colorado • 475-8240

Receipt No. 4227

PERMIT

TO CONSTRUCT, ALTER, REPAIR OR MODIFY AN INDIVIDUAL SEWAGE DISPOSAL SYSTEM

Issued To George E. Dell Date June 26, 1981

Address of Property 12125 Black Forest Road, Black Forest, CO.

6902 Juniper Dr
(Permit valid at this address only)

Sewage-Disposal System work to be performed by Same Phone _____

This Permit is issued in accordance with 25-10-108 Colorado Revised Statutes 1973, as amended. PERMIT EXPIRES upon completion-installation of sewage-disposal system or at the end of six (6) months from date of issue - whichever occurs first - (unless work is in progress).

This Permit does not denote approval of zoning and other requirements.

Permit Fee 108.00 Director, City & County Health Department

Date of Expiration December 26, 1981 Environmentalist

NOTE: LEAVE ENTIRE SEWAGE-DISPOSAL SYSTEM UNCOVERED FOR FINAL INSPECTION. 471 Sq.Ft.
24-HOUR ADVANCE NOTICE REQUIRED

Septic tank	<u>1250</u> gals.	Field	<u>157</u>	Feet of trench	<u>36</u>	Inches wide
		OR. Field	<u>236</u>	Feet of trench	<u>24</u>	Inches wide
Seepage bed	_____ ft. long	_____ ft. wide.	Seepage pit	_____ sq. ft.	_____ diam.	_____ w/d

The Health Officer shall assume no responsibility in case of failure or inadequacy of a sewage-disposal system, beyond consulting in good faith with the property owner or representative. Free access to the property shall be authorized at reasonable times for the purpose of making such inspections as are necessary to determine compliance with requirements of this law.

Date 6/14/81

EL PASO COUNTY HEALTH DEPARTMENT
501 NORTH FOOTE AVENUE
COLORADO SPRINGS, COLORADO
636-0125

tax Schedule

see attached

Application for permit to construct, remodel, or install a Sewage Disposal System.

Name of Owner George E. Dell Phone 596-9022

Address of Property 6902 JUNIPER DR. & 6910 JUNIPER DR.

Legal Description of Property S2 NW 4 E1 W 1020' 0" FN. 187.79 FT SEC 17-12-65

Owner's Address (if different) 1714 TESLA DR. CO. SP. CO 80909 Phone 596-9022

Systems Contractor Self Address _____

Type of Construction House source and type of water supply _____

Size of Lot 39.7 or .8 ?

The construction of the Sewage Disposal System will comply with all applicable Laws, Ordinances, Standards or Resolutions.

HEALTH DEPARTMENT USE ONLY

Permit Number _____ Receipt Number _____

Number of Bedrooms 3 Tank Capacity 1250 gallons Absorption area 47 Sq. ft.

Remarks OK Pending satisfactory perc test as JIM

discussed = Mr. Dell

3' TRENCH = 157' - 2' TRENCH = 236

RECEIVED
8 1981
El Paso County
Planning Department

APPLICATION IS APPROVED DENIED

ENVIRONMENTALIST Koves DATE 6/12 19 81

PLOT PLAN WILL INCLUDE THE FOLLOWING

Plot plan may be drawn on the back of this sheet or on a separate sheet.

1. Streams, Lakes, Ponds, Irrigation Ditches and other Water Courses
2. North Direction
3. Location of Property Line
4. Buildings
5. Wells
6. Location of Proposed Septic System
7. Location of percolation test
8. Geographical features
9. Other Information as required