



Final Drainage Report

**Peerless Farms**  
**16975 Falcon Hwy**  
**Peyton, CO 80831**

Prepared for (Owner):  
**Robert S Williams**  
**4075 Golf Club Dr.**  
**Colorado Springs CO, 80922**  
**Contact: Robert S Williams**  
**(460) 438-1874**

Prepared by:  
**Kimley-Horn and Associates, Inc.**  
**2 North Nevada Avenue, Suite 900**  
**Colorado Springs, Colorado 80903**  
**Contact: Mitchell Hess, P.E.**  
**(719) 453-0180**

Project #: 19611400

PCD File No. SF242

Prepared: September 11, 2024

**Kimley»Horn**



**CERTIFICATION**

**ENGINEERS STATEMENT**

The attached drainage plan and report were prepared under my direction and supervision and are correct to the best of my knowledge and belief. Said drainage report has been prepared according to the criteria established by the County for drainage reports and said report is in conformity with the applicable master plan of the drainage basin. I accept responsibility for any liability caused by any negligent acts, errors or omissions on my part in preparing this report.



SIGNATURE (Affix Seal): \_\_\_\_\_  
Mitchell Hess, Colorado P.E. No. 53916

**DEVELOPER'S STATEMENT**

I, the owner/developer have read and will comply with all of the requirements specified in this drainage report and plan.

Robert S. Williams

\_\_\_\_\_  
Name of Developer

Robert S. Williams

9/13/2024

\_\_\_\_\_  
Authorized Signature Date

Robert Williams

\_\_\_\_\_  
Printed Name

owner

\_\_\_\_\_  
Title

16975 Falcon Hwy

\_\_\_\_\_  
Address:

**EL PASO COUNTY**

Filed in accordance with the requirements of the Drainage Criteria Manual, Volumes 1 and 2, El Paso County Engineering Criteria Manual and Land Development Code as amended.

\_\_\_\_\_  
Joshua Palmer, P.E.

County Engineer / ECM Administrator

\_\_\_\_\_  
Date

Conditions:

**TABLE OF CONTENTS**

**CERTIFICATION ..... 1**

ENGINEERS STATEMENT ..... 1

DEVELOPER’S STATEMENT ..... 1

EL PASO COUNTY ..... 1

**INTRODUCTION ..... 4**

PURPOSE AND SCOPE OF STUDY ..... 4

GENERAL PROJECT DESCRIPTION ..... 4

**PROJECT CHARACTERISTICS ..... 4**

DRAINAGE BASIN PLANNING STUDY INFRASTRUCTURE AND ANALYSIS ..... 5

SOILS CONDITIONS ..... 5

**DRAINAGE DESIGN CRITERIA ..... 5**

REGULATIONS ..... 5

DEVELOPMENT DESIGN CRITERIA REFERENCE AND CONSTRAINTS ..... 5

HYDROLOGIC CRITERIA ..... 5

HYDRAULIC CRITERIA ..... 6

VARIANCES FROM CRITERIA ..... 6

**EXISTING DRAINAGE CONDITIONS ..... 6**

EXISTING DRAINAGE BASIN ..... 6

*Sub-Basin EX1* ..... 6

*Sub-Basin EX2* ..... 6

*Sub-Basin EX3* ..... 6

*Sub-Basin EX3B* ..... 6

*Sub-Basin T3-02* ..... 7

*Sub-Basin T4* ..... 7

*Sagecreek South Drainage* ..... 7

**PROPOSED DRAINAGE CONDITIONS ..... 7**

*Sub-Basin 1* ..... 7

*Sub-Basin 2* ..... 8

*Sub-Basin 3* ..... 8

*Sub-Basin 4* ..... 8

*Sub-Basin 5* ..... 8

*Sub-Basin 6* ..... 8

*Sub-Basin 7* ..... 9

*Sub-Basin 8* ..... 9

*Sub-Basin EX3* ..... 9

*Sub-Basin EX3B* ..... 9

*Sub-Basin T3-02* ..... 9

*Sub-Basin T4* ..... 9

*Sagecreek South Drainage* ..... 10

PUBLIC ROADWAY AND PRIVATE DRIVEWAY DITCHES ..... 10

PUBLIC ROADWAY AND PRIVATE DRIVEWAY CULVERTS ..... 10

CONFORMANCE WITH THE DBPS ..... 10

EMERGENCY OVERFLOW ROUTING ..... 11

HYDRAULIC ANALYSIS METHODOLOGY ..... 11

*Four-Step Process* ..... 11

---

|   |           |
|---|-----------|
| WATER QUALITY AND DETENTION REQUIREMENTS .....                  | 12        |
| <b>EROSION CONTROL PLAN .....</b>                               | <b>13</b> |
| <b>FLOODPLAIN STATEMENT .....</b>                               | <b>14</b> |
| <b>FEES DEVELOPMENT .....</b>                                   | <b>14</b> |
| APPLICABLE FEES.....  | 14        |
| CONSTRUCTION COST OPINION.....                                  | 14        |
| MAINTENANCE AND OPERATIONS.....                                 | 14        |
| GROUNDWATER CONSIDERATIONS .....                                | 14        |
| <b>SUMMARY .....</b>  | <b>15</b> |
| COMPLIANCE WITH STANDARDS.....                                  | 15        |
| <b>REFERENCES .....</b>   | <b>16</b> |
| <b>APPENDIX .....</b>   | <b>17</b> |
| APPENDIX A – VICINITY MAP                                       |           |
| APPENDIX B – SOILS MAP AND FEMA FIRM PANEL                      |           |
| APPENDIX C – HYDROLOGIC CALCULATIONS                            |           |
| APPENDIX D – HYDRAULIC CALCULATIONS                             |           |
| APPENDIX E – EOPCC AND TEMPORARY SEDIMENT BASIN STANDARD DETAIL |           |
| APPENDIX F – UNNAMED DRAINAGEWAY PHOTOGRAPHS                    |           |
| APPENDIX G – EXCERPTS FROM THE DBPS                             |           |
| APPENDIX H – DRAINAGE EXHIBITS                                  |           |

## INTRODUCTION

### **PURPOSE AND SCOPE OF STUDY**

The purpose of this final drainage report is to outline the drainage facilities for 16975 Falcon Hwy Peyton, CO (the “Property”), El Paso County, Colorado (the “County”). This final drainage report identifies drainage patterns and infrastructure for the Site and proposes to safely route storm water to adequate outfalls. The Property is 40 acres in size.

The Property is located in the Haegler Ranch major drainage basin and is tributary to Black Squirrel Creek. The Site is discussed in the *Haegler Ranch Basin Drainage Basin Planning Study*, dated May 2009 and prepared by URS (“DBPS”).

### **GENERAL PROJECT DESCRIPTION**

The project improvements consist of the construction of a single public road (60’ ROW), two private driveways, and private utilities (the “Project”) within the Property (the “Site”). The Project will be processed through El Paso County.

The Project is located in a portion of the northwest quarter of Section 13, Township 13 south, Range 64 west of the 6th P.M., County of El Paso, State of Colorado (see Vicinity Map in Appendix A). More specifically, the site is located at 16975 Falcon Hwy Peyton, CO 80831. The Property is bound by Falcon Hwy to the north, privately owned pastures to the west and south, and Sagecreek South Filing No. 1 to the east. The Property is mostly vacant but contains a single family house and associated auxiliary structure, one large barn and some small chicken coops and sheds. The Site is to be replatted as 7 individual lots approximately 5-6 acres each with two private driveways connected to a public access road branching from Falcon Hwy. Stormwater will ultimately outfall to Black Squirrel Creek after initially discharging into an unnamed vegetated creek along the western portion of the Property.

A field survey was completed by Centennial Surveying, dated January 2021, and is the basis for design for the drainage improvements.

## PROJECT CHARACTERISTICS

The Project Site is 40 acres in size. The Project involves the construction of a public road with two private driveways, roadside ditches, and culverts. The Site will be subdivided into large-lot residential lots for future single-family residences. The proposed impervious area consists of 0.66 acres for the public/paved roadway in addition to any future single-family residences constructed as part of the development.

The existing Project Site generally slopes from east to west as well as from the southeast to the north at grades of approximately 1.5 – 3.5%. The historical drainage patterns will be generally maintained. The Site consists of a single-family home, associated auxiliary structure, a large barn and some small chicken coops and sheds. The Site does not have any existing stormwater infrastructure with the exception of a 24” culvert beneath Falcon Highway that allows the unnamed drainageway to drain from the north side of Falcon Highway to the Site. A design analysis is provided in the DBPS for this culvert, identified as Facility Number 610 for Tributary Area 4 (Sub-basin T4), which is included in the Appendix.

**DRAINAGE BASIN PLANNING STUDY INFRASTRUCTURE AND ANALYSIS**

The Project Site is contained within the Haegler Ranch Basin and is discussed within the DBPS. Haegler Ranch Drainage Basin consists of 16.6 square miles in unincorporated El Paso County. The basin mostly consists of residential lots greater than 2-acres in size and large agricultural parcels. According to the DBPS, "...the subregional detention alternative is preferred and recommended for implementation" as the drainage basin continues to develop and more dense zoning uses are developed. The DBPS does not recommend that a subregional detention basin be constructed on the subject Site. The DBPS recommends that the existing storm drain culvert that is beneath Falcon Highway which discharges stormwater onto the property be upsized to a 66" RCP Culvert. As no improvements are proposed for Falcon Highway, this culvert will not be upsized as part of this Project.

**SOILS CONDITIONS**

NRCS soil data is available for this Site and it has been noted that onsite soils are primarily USCS Type A. The following soils

| <u>Soil Name</u>                   | <u>Area (%)</u> | <u>USCS Hydrologic Soil Group</u> |
|------------------------------------|-----------------|-----------------------------------|
| Blakeland Loamy Sand               | 7.4%            | A                                 |
| Blakeland-Fluvaquentic Haplaquolis | 39.7%           | A                                 |
| Truckton Loamy Sand                | 52.9%           | A                                 |

The NRSC Soils map has been provided in Appendix B.

**DRAINAGE DESIGN CRITERIA**

**REGULATIONS**

The proposed development does not propose any deviations from The City of Colorado Springs/El Paso County Drainage Criteria Manual, dated October 12, 1994 or any subsequent revisions.

**DEVELOPMENT DESIGN CRITERIA REFERENCE AND CONSTRAINTS**

The custom Flood Insurance Rate Map (FIRM) map listed in Appendix B shows the western portion of the Site to be located inside the 100-year flood plain. The proposed private storm facilities follow The City of Colorado Springs/El Paso County Drainage Criteria Manual (the "CRITERIA"), El Paso County Engineering Criteria Manual (the "ECM), and the Urban Storm Drainage Criteria Manual (the "MANUAL"). Site drainage is not significantly impacted by constraints such as utilities or existing development. Further detail regarding onsite drainage patterns has been provided in the Proposed Drainage Conditions Section.

**HYDROLOGIC CRITERIA**

The 5-year and 100-year design storm events were used in determining rainfall and runoff for the proposed drainage system per Chapter 6 of the CRITERIA. Table 6-2 of the CRITERIA is the source for rainfall data for the 5-year and 100-year design storm events. Design runoff was

calculated using the Rational Method for developed conditions as established in the CRITERIA and MANUAL. Runoff coefficients for the proposed development were determined using Table 6-6 of the CRITERIA by calculating weighted impervious values for each specific site sub-basin.

### **HYDRAULIC CRITERIA**

The proposed drainage facilities are designed in accordance with the CRITERIA and MANUAL. Floodplain identification was determined using a custom FIRMette map by FEMA and information provided in the CRITERIA. Results of hydraulic calculations are summarized in Appendix D.

### **VARIANCES FROM CRITERIA**

Due to existing grades and to match the historical flows presented at the Site, some drainage will be directed back to the county ROW. This is an existing condition. Besides this condition, no variances from the CRITERIA have been proposed for this development.

## **EXISTING DRAINAGE CONDITIONS**

### **EXISTING DRAINAGE BASIN**

#### **Sub-Basin EX1**

Sub-basin EX1 is 35.36 acres with a basin impervious value of 2% and consists of agricultural fields, gravel driveways, single-family residences and multiple agricultural barns and sheds. The existing runoff within this sub-basin drains directly to the unnamed drainageway. Runoff during the 5-year and 100-year storm events is anticipated to be 5.99 and 38.94 cfs respectively. The total 100-year storm event direct runoff value (5-year values are unknown for T3-02 and T4), inclusive of the upstream Sub-Basins EX3, EX3B, EX2, T3-02 and T4 is 1,097.15 cfs. Refer to the Existing Drainage Map for the location of the design points associated with the upstream sub-basins.

#### **Sub-Basin EX2**

Sub-basin EX2 is 4.64 acres with a basin impervious value of 4% and consists of agricultural fields, gravel driveways and a portion of an agricultural barn. The existing runoff within this sub-basin drains to an existing roadside ditch within Sub-Basin EX3 before flowing into the unnamed drainageway. Runoff during the 5-year and 100-year storm events is anticipated to be 1.03 and 6.07 cfs respectively.

#### **Sub-Basin EX3**

Sub-Basin EX3 consists of a portion of the northern property frontage within the ROW that drains to the property. Sub-Basin EX3 is 2.63 acres with a basin impervious value of 27% and 5-year and 100-year storm event direct runoff values of 2.18 and 7.47 cfs respectively. Total 5-year and 100-year storm event direct runoff values, inclusive of the upstream Sub-Basins EX2 and EX3B (Design Point EX2 and EX3B flows), are 5.35 and 28.21 cfs respectively.

#### **Sub-Basin EX3B**

Sub-Basin EX3B is an offsite sub-basin which consists of the south half of Falcon Highway and the west half of Peerless Farms Road adjacent to Lot 1 of Sagecreek South Filing No. 1 as well

as all of Lot 1. Stormwater runoff within Sub-Basin EX3B flows into the Falcon Highway ROW before flowing west to Sub-Basin EX3. Sub-Basin EX3B is 5.97 acres with a basin impervious value of 9% and 5-year and 100-year storm event direct runoff values of 2.14 and 14.67 cfs respectively.

### **Sub-Basin T3-02**

Sub-Basin T3-02 consists of a named tributary discussed in the DBPS and is made up of Sub-Basins HR0290 and HR0300. Sub-Basin T3-02 is 289 acres in size and consists of agricultural/vacant land and large-lot single-family residential properties. A sub-basin impervious value was not identified in the DBPS for this area, but the 100-year storm event direct runoff was found to be 460 cfs. Stormwater runoff within Sub-Basin T3-02 will continue to follow its historical path.

### **Sub-Basin T4**

Sub-Basin T4 consists of a named tributary discussed in the DBPS and is made up of Sub-Basins HR0260, HR0270 and HR0280. Sub-Basin T4 is 350 acres in size and consists of agricultural/vacant land and large-lot single-family residential properties. A sub-basin impervious value was not identified in the DBPS for this area, but the 100-year storm event direct runoff was found to be 570 cfs. Stormwater runoff within Sub-Basin T4 will continue to follow its historical path.

### **Sagecreek South Drainage**

As part of the Project drainage design, the Sagecreek South Drainage Final Drainage Report was reviewed and an onsite field visit was conducted. To the best of our knowledge, it appears that when the Sagecreek South Subdivision was constructed, grading at the western fence line/property line was done such that stormwater is not anticipated to drain directly from the Sagecreek South residential lots directly onto the Peerless Farms Property. Instead, stormwater runoff is anticipated to flow north to the Falcon Highway roadside ditch. A portion of these flows will enter Sub-Basin EX3 and eventually will flow onto the Peerless Farms Property. This Sagecreek South Subdivision related sub-Basin has been identified as Sub-Basin EX3B. The remaining flows from Sagecreek South Subdivision flow east or south, away from the Site. This drainage condition will remain the same in the proposed drainage condition, except a proposed stormwater culvert will be installed as part of the proposed extension of Sagecreek Road in order for flows to continue to follow their historic path.

## **PROPOSED DRAINAGE CONDITIONS**

The developed runoff from the Project will generally be collected by means of roadside ditches located adjacent to the proposed public road and private gravel driveways. The runoff collected in the roadside ditches will be conveyed to the unnamed drainageway, following historical runoff patterns. The Property has been divided into 8 on-site sub-basins, Sub-Basins 1 - 8 and 4 off-site sub-basins, Sub-Basin EX3, Sub-Basin EX3B, Sub-Basin T3-02, and Sub-Basin T4. The proposed conditions map is provided in Appendix H.

### **Sub-Basin 1**

Sub-basin 1 is 19.97 acres with a basin impervious value of 10% and consists of the unnamed drainageway as well as future single-family residential lots. The runoff developed within this sub-basin drains directly to the unnamed drainageway. Developed runoff during the 5-year and 100-year storm events will be 6.21 and 27.04 cfs respectively. Stormwater runoff within Sub-Basin 1 will continue to generally follow its historical path. The total 100-year storm event direct runoff value (5-year values are unknown for T3-02 and T4), inclusive of the upstream Sub-Basins 2 – 8,



EX3, EX3B, T3-02 and T4 is 1,115.63 cfs. Refer to the Proposed Drainage Map for the location of the design points associated with the upstream sub-basins.

### **Sub-Basin 2**

Sub-basin 2 is 1.78 acres with a basin impervious value of 17% and consists primarily of a portion of a gravel driveway and driveway drainage ditch. Sub-Basin 2 also includes a small portion of the proposed public road. The runoff developed within this sub-basin will be collected within a proposed driveway ditch before flowing into the unnamed drainageway. Developed runoff during the 5-year and 100-year storm events will be 0.87 and 3.24 cfs respectively. Stormwater runoff within Sub-Basin 2 will continue to generally follow its historical path. Total 5-year and 100-year storm event direct runoff values, inclusive of the upstream Sub-Basin 3 (Design Point 3 flows), are 1.73 and 5.72 cfs respectively.

### **Sub-Basin 3**

Sub-basin 3 is 0.78 acres with a basin impervious value of 31% and consists primarily of a portion of a gravel driveway and driveway drainage ditch. Sub-Basin 3 also includes a small portion of the proposed public road. The runoff developed within this sub-basin will be collected within a proposed driveway ditch before flowing through a proposed 18" culvert (Culvert 4) and into a drainage ditch within Sub-Basin 2 and being routed to the unnamed drainageway. Hydraulic calculations for Culvert 4 are provided in the Appendix. Developed runoff during the 5-year and 100-year storm events will be 0.86 and 2.48 cfs respectively. Stormwater runoff within Sub-Basin 3 will continue to generally follow its historical path.

### **Sub-Basin 4**

Sub-basin 4 is 0.42 acres with a basin impervious value of 57% and consists of a portion of the proposed public road. The runoff developed within this sub-basin will be collected within a proposed roadside ditch before flowing through a proposed 18" culvert (Culvert 1) and into a driveway ditch within Sub-Basin 6 and being routed to the unnamed drainageway. Hydraulic calculations for Culvert 1 are provided in the Appendix. Developed runoff during the 5-year and 100-year storm events will be 1.03 and 2.21 cfs respectively. Stormwater runoff within Sub-Basin 4 will continue to generally follow its historical path.

### **Sub-Basin 5**

Sub-basin 5 is 0.85 acres with a basin impervious value of 40% and consists of a portion of the proposed public road, a portion of a gravel driveway and a driveway ditch. The runoff developed within this sub-basin will be collected within proposed roadside and driveway ditches before flowing through a proposed 18" culvert (Culvert 2) and into a drainage ditch within Sub-Basin 6 and being routed to the unnamed drainageway. Hydraulic calculations for Culvert 2 are provided in the Appendix. Developed runoff during the 5-year and 100-year storm events will be 1.12 and 2.84 cfs respectively. Stormwater runoff within Sub-Basin 5 will continue to generally follow its historical path.

### **Sub-Basin 6**

Sub-basin 6 is 5.55 acres with a basin impervious value of 13% and consists of a portion of a gravel driveway, a driveway ditch and future single-family lots. The runoff developed within this sub-basin will be collected within proposed roadside and driveway ditches before flowing through a proposed 24" culvert (Culvert 3) and into the unnamed drainageway. Hydraulic calculations for Culvert 3 are provided in the Appendix. Developed runoff during the 5-year and 100-year storm events will be 2.32 and 9.26 cfs respectively. Stormwater runoff within Sub-Basin 6 will continue to generally follow its historical path. Total 5-year and 100-year storm event direct runoff values,

inclusive of the upstream Sub-Basins 4 and 5 (Design Point 4 and 5 flows), are 4.47 and 14.31 cfs respectively.

### **Sub-Basin 7**

Sub-basin 7 is 1.57 acres with a basin impervious value of 6% and consists of a portion of the proposed public road, roadside ditches and a future single-family lot. The runoff developed within this sub-basin will be collected within an existing roadside ditch within Sub-Basin EX3 before flowing into the unnamed drainageway. Developed runoff during the 5-year and 100-year storm events will be 0.54 and 2.77 cfs respectively. Stormwater runoff within Sub-Basin 7 will continue to follow its historical path.

### **Sub-Basin 8**

Sub-basin 8 is 9.09 acres with a basin impervious value of 10% and consists of future single-family residential lots. The runoff developed within this sub-basin drains directly to the unnamed drainageway. Developed runoff during the 5-year and 100-year storm events will be 3.14 and 13.65 cfs respectively. Stormwater runoff within Sub-Basin 8 will continue to generally follow its historical path.

### **Sub-Basin EX3**

Sub-Basin EX3 consists of a portion of the northern property frontage within the ROW that drains to the property. Sub-Basin EX3 is 2.63 acres with a basin impervious value of 27% and 5-year and 100-year storm event direct runoff values of 2.18 and 7.47 cfs respectively. Stormwater runoff within Sub-Basin EX3 will continue to follow its historical path. Total 5-year and 100-year storm event direct runoff values, inclusive of the upstream Sub-Basin 7 and EX3B (Design Point 7 and EX3B flows), are 4.86 and 24.91 cfs respectively. Total flows within Sub-Basin EX3 will decline in the proposed condition due to loss of the onsite flows flowing directly to Sub-Basin EX3.

### **Sub-Basin EX3B**

Sub-Basin EX3B is an offsite sub-basin which consists of the south half of Falcon Highway and the west half of Peerless Farms Road adjacent to Lot 1 of Sagecreek South Filing No. 1 as well as all of Lot 1. Stormwater runoff within Sub-Basin EX3B flows into the Falcon Highway ROW before flowing west through an existing roadside swale, before flowing through a proposed 19"x30" Elliptical RCP culvert (Culvert 5) to be placed under the Sagecreek Road access point to Falcon Highway within the existing swale and continuing into Sub-Basin EX3. Sub-Basin EX3B is 5.97 acres with a basin impervious value of 9% and 5-year and 100-year storm event direct runoff values of 2.14 and 14.67 cfs respectively.

### **Sub-Basin T3-02**

Sub-Basin T3-02 consists of a named tributary discussed in the DBPS and is made up of Sub-Basins HR0290 and HR0300. Sub-Basin T3-02 is 289 acres in size and consists of agricultural/vacant land and large-lot single-family residential properties. A sub-basin impervious value was not identified in the DBPS for this area, but the 100-year storm event direct runoff was found to be 460 cfs. Stormwater runoff within Sub-Basin T3-02 will continue to follow its historical path.

### **Sub-Basin T4**

Sub-Basin T4 consists of a named tributary discussed in the DBPS and is made up of Sub-Basins HR0260, HR0270 and HR0280. Sub-Basin T4 is 350 acres in size and consists of agricultural/vacant land and large-lot single-family residential properties. A sub-basin impervious value was not identified in the DBPS for this area, but the 100-year storm event direct runoff was

found to be 570 cfs. Stormwater runoff within Sub-Basin T4 will continue to follow its historical path.

### **Sagecreek South Drainage**

As part of the Project drainage design, the Sagecreek South Drainage Final Drainage Report was reviewed and an onsite field visit was conducted. To the best of our knowledge, it appears that when the Sagecreek South Subdivision was constructed, final grading restrict stormwater flows from draining from the Sagecreek South Subdivision lots to the Peerless Farms lot.

### ***PUBLIC ROADWAY AND PRIVATE DRIVEWAY DITCHES***

Ditches have been proposed adjacent to the proposed public roadway and the proposed private gravel driveways. Ditches adjacent to the Public ROW (Sub-basin 4) will be constructed to meet the requirements of El Paso County Standard Detail SD\_2-11. These Ditches are considered roadside ditches and per Section 3.3.4 of the ECM, are not considered drainage ditches and therefore are not required to meet open channel standards. These ditches will provide over 2' of freeboard according to the design ditch depth of 2.5' and a maximum flow depth of 5.6" according to the calculations provided in Appendix D. Ditches adjacent to the private gravel driveways will be constructed to similar standards as feasible. The southern roadway ditches have a depth of 2' and the northern roadway ditches will have a minimum depth of 1' due to grading constraints before transitioning to a full ditch depth of 2'. Minimum ditch depths occur near the start of the ditch where flows will be minimal and under emergency overflow conditions, the water will spread northwest of the roadway, and no overtopping of the roadways will occur.

Where these roadside ditches transition away from the private gravel drives, they are considered open channels and have been designed to the relevant standards, each having a bottom width of 4' and 4:1 side slopes of 7.5' and 6' for the N and S ditches (Sub-basin 6 and Sub-basin 2), respectively. This provides 1' of freeboard based on calculated flow depths as provided in Appendix D.

Ditch calculations for each applicable Sub-Basin have been included in Appendix D. Ditches will be seeded/lined with Bermudagrass.

### ***PUBLIC ROADWAY AND PRIVATE DRIVEWAY CULVERTS***

Reinforced Concrete Pipes (RCP) and Concrete Flared-End Sections (FES) have been proposed as necessary where proposed public roadway or private gravel driveways intersect with roadside ditches. Culvert calculations have been included in Appendix D. Culvert sizes are 18" RCP or 19"X30" Elliptical RCP depending on the proposed stormwater runoff that will pass through the culvert in the 100-year storm event. Riprap will be provided at both ends of culverts. Riprap has been sized for the culvert with the highest flows and this size and type of riprap will be used on both ends of each culvert (18" thick Type L Riprap D50 = 9"). Riprap calculations have been included in Appendix D and a standard culvert detail for the riprap has been included on the Grading and Erosion Control Plans.

### ***CONFORMANCE WITH THE DBPS***

The proposed Project includes single-family lots which are all greater than 5-acres in size. The proposed Site imperviousness for the Project, inclusive of the proposed public road) is 12%. Individual lots will be limited to up to 10% imperviousness. The 5-year and 100-year storm event direct runoff for the site will be 16.08 and 63.49 cfs respectively. The proposed development is in general conformance with the DBPS and will not negatively affect downstream drainage.

## **EMERGENCY OVERFLOW ROUTING**

All overflow routing will be directed to the existing unnamed drainageway that is located on the western side of the site. This flow path matches the historical stormwater runoff path.

## **HYDRAULIC ANALYSIS METHODOLOGY**

The proposed drainage facilities were designed in accordance with the CRITERIA and MANUAL. Floodplain identification was determined using a custom FIRMette map by FEMA and information provided in the CRITERIA. Apart from road culverts, no underground storm drain pipes as proposed for the development. Culvert sizing calculations were computed using Flow master and are included in Appendix D. There are no proposed variances from the City of Colorado Springs/El Paso County Criteria for the proposed development.

No inlets have been proposed as part of the Project. Stormwater runoff will be routed above ground through roadside ditches and culverts beneath the public roadway and private driveways.

## **Four-Step Process**

The Site was designed in accordance with the four-step process to minimize adverse impacts of urbanization, as outlined in Section I.7.2 BMP Selection of the CRITERIA. The four-step process per the CRITERIA provides guidance and requirements for the selection of siting of structural Best Management Practices (BMPs) for new development and significant redevelopment.

### **Step 1: Employ Runoff Reduction Practices**

Currently the site is mostly vacant land. Development of the site will increase current runoff conditions due to increased imperviousness values. The increase in impervious area is minimal though due to the Site size of 40-acres and the proposed large residential lot sizes.

As discussed in Section I.7.1B of Appendix I of the ECM, water-quality facilities are not required for the Project as the development consists of 5-acre residential lots. Water quality treatment will be provided for the Proposed Public ROW though through means of runoff reduction. Stormwater within the Public ROW will drain to vegetated roadside ditches which will promote stormwater infiltration. A 94% WQVC reduction will be achieved to accomplish the requirements of the 60% Runoff Reduction Standard as outlined by the County's MS4. Calculations showing the runoff reduction amounts have been included in Appendix C.

The Site was designed to conserve as much of the existing vegetation as possible and to minimize the extent of paved areas. Additionally, the Site was designed to eliminate underground storm drains and storm drain culverts will only be used to route water beneath the public road and private driveways, allowing more opportunities for stormwater to infiltrate into the ground.

### **Step 2: Stabilize Drainageways**

An existing unnamed drainageway flows through the western portion of the Site. During a Site visit, it was found that the drainageway is currently well-stabilized and extremely vegetated. Site visit photos of the drainageway have been included in Appendix F. As the drainageway is currently stable and the development of the large-lot subdivision will only minimally increase the stormwater runoff it has been determined that leaving the unnamed drainageway as-is, currently stabilized and vegetated, will allow the channel to remain stabilized. As discussed in the DBPS, "The disturbance of the native vegetation and failure to properly revegetate areas impacted by site development, utility, roadway and landscape construction activities have in some cases negatively affected downstream areas." Furthermore, as noted in Chapter 1, Section 1.4 of the CRITERIA, "Natural channel systems, primarily the designated Major

Drainageways and Primary outfalls, serve to store flood waters, enhance water quality, provide for ground water recharge and preserve riparian corridors. The use of historical channels to convey storm water runoff from developed and developing areas is acceptable. However, if historical storm water flows are increased, or if historical channels are unstable in their natural conditions, these channels must be adequately stabilized to prevent excessive erosion.” Additionally, Chapter 2, Section 2.2 of the CRITERIA states, “A stable natural channel reaches ‘equilibrium’ over many years. Therefore, channel modifications should be minimal.” Because the existing drainageway is properly stabilized, it is felt that attempts to change the natural channel may lead to destabilization of the drainageway and therefore, no changes to the unnamed drainageway, with the exception of stabilization at the location of the proposed ditches, are recommended.

The proposed Project involves construction of roadside ditches which will discharge into the unnamed drainageway. To reduce the opportunity for erosion where the ditches outfall, riprap will be added to dissipate energy from stormwater runoff.

### **Step 3: Provide Water Quality Capture Volume (WQCV)**

The proposed Project development includes large-lot single-family lots which include minimal impervious areas. The single-family lots will be restricted to a maximum impervious value of 10% per lot. Lots 2, 6 and 7 include private/shared gravel driveways which will count towards the 10% maximum impervious allotment of those lots. As all of the lots are built out with future impervious coverings such as houses, out-buildings, driveways, sidewalks and patios, impervious values for each lot will be considered up to a maximum of 10% for each lot. As discussed above in Step 1, the residential lots are exempt from WQCV requirements and the Public ROW will meet County MS4 requirements by using runoff reduction methods which will meet the 60% runoff reduction standard.

### **Step 4: Consider Need for Industrial and Commercial BMPs**

The proposed Project consists of a single-family subdivision. No industrial and commercial uses or developments are anticipated as part of the proposed development.

## ***WATER QUALITY AND DETENTION REQUIREMENTS***

The proposed Project development includes large-lot single-family lots which include minimal impervious areas. As discussed above in Step 1 of the Four-Step Process, the residential lots are exempt from WQCV requirements and the Public ROW will meet County MS4 requirements by using runoff reduction methods which will meet the 60% runoff reduction standard.

The Project does not include a proposed detention pond for this development. Large-Lot Residential Developments, especially those in excess of 5-acre lots, do not increase post-development stormwater flows as substantially as smaller-lot residential and non-residential developments. Stormwater flows collected from this development will drain to the existing unnamed drainageway. As documented in the DBPS, the unnamed drainageway is made up of the combination of the T3-02 and T4 Tributaries which both cross Falcon Highway using corrugated metal pipes known as Facility Numbers 609 and 610. The proposed 100-year flows for these tributaries at these locations are 460 cfs and 570 cfs respectively. Therefore, the unnamed drainageway is expected to have proposed 100-year storm event flows of 1,030 cfs.

The Project currently contributes 7.02 cfs and 45.01 cfs to the unnamed drainageway during the 5-year and 100-year storm events respectively, and it is proposed that 16.08 cfs and 63.49 cfs will discharge to the unnamed drainageway in the redeveloped condition and during the 5-year and 100-year storm events respectively. A portion of on-site flows, Sub-basin 7, do not drain through the site, but rather outlet offsite into the ditch along Falcon Highway (Sub-basin EX3)

where they travel west and outfall to the same existing drainage channel as the overall site's ultimate outfall. Under existing conditions, a larger tributary area follows this drainage path to the Falcon Highway roadside ditch, and under proposed conditions a lesser amount of flows will be routed through this roadside ditch. During a 100-year storm event, the existing stormwater flows for the Site account for 4.37% of the total flows in the unnamed drainageway (45.01 cfs of 1,030 cfs). During a 100-year storm event, the proposed stormwater flows for the Site will account for 6.16% of the total flows in the unnamed drainageway (63.49 cfs of 1,030 cfs) which results in an increase of 18.48 cfs, or 1.79% of the total flows. The unnamed drainageway has planned for future flows of 1,030 cfs within the channel according to the DBPS, which is assumed to include developed conditions of the upstream basin, including this proposed development. A channel calculations showing these flows contained within the channel's cross-section at the site's outfall near the southwest corner of the site is included in the Hydraulics section of the Appendix.

Because the unnamed drainageway flows directly through the Site, it is advantageous to allow stormwater from the Project to flow directly and undetained into the unnamed drainage as the Project stormwater peak flows can enter the unnamed drainageway and flow downstream before the peak flows from the off-site upstream drainage basins can arrive at this area of the drainage basin. There are five upstream drainage sub-basins identified in the DBPS. They are identified as HR0260, HR0270, HR0280, HR0290 and HR0300, with the lower numbered sub-basins located further from the Site. The lag times associated with each of these sub-basins are 11, 23, 42, 17 and 31 minutes respectively. The three proposed sub-basins for the Project which contribute the largest peak flows are also the three sub-basins with the longest time of concentrations. Each of these sub-basins, 1, 6 and 8 also drain directly into the unnamed drainageway. Their time of concentrations are 39.28, 29.41 and 33.25 minutes respectively. Based on these time of concentrations being less than the longest lag time identified for the upstream DBPS sub-basins and the fact that the lag times identified above do not account for channel flow times for the stormwater to arrive at the Site, it has been concluded that not detaining stormwater flows for this Project will allow the peak stormwater flows to beat the peak stormwater flows from the overall drainage basin. Conversely, detaining stormwater flows on-site in a private extended detention basin, would negatively impact the channel as peak flows would be released at a later time which could coincide with the peak flows in the channel, allowing higher volumes and velocities in the unnamed drainageway.

Due to the minimal increase of stormwater flows caused by the redevelopment (a net increase of 18.48 cfs, or a 1.79% increase within the existing unnamed drainageway, the large 5-acre and larger residential lot configuration, the recommendations of the DBPS for regional detention ponds as opposed to private onsite detention, the negligible impact to the overall flows within the unnamed drainageway and the ability of the peak stormwater flows from the Site to beat the peak flows in the unnamed drainageway, no stormwater detention has been proposed for this Project.

## **EROSION CONTROL PLAN**

Erosion Control Plans will be submitted separately as a standalone construction document. During construction temporary control measures will be installed to reduce erosion onsite. The temporary controls are anticipated to consist, at a minimum, of silt fencing, vehicle tracking control, ditches, check dams, culvert protection, erosion control blankets, seeding and mulching and temporary sediment basins.

As part of the construction associated with this subdivision, two temporary sediment basins will be constructed to meet County MS4 and State requirements. Although the sediment basins will be temporary erosion controls, permanent ditches will be constructed which will route stormwater

to the temporary sediment basins during construction and to the unnamed drainageway post-construction. The temporary sediment basins will be sized according to El Paso County Standard Detail 900-TSB-2. This standard detail has been included in Appendix E. Final sizing for the temporary sediment basins will be included in the Grading and Erosion Control Plans and Stormwater Management Plan.

**FLOODPLAIN STATEMENT**

The western portion of the Site is within Area AE, special flood hazard areas with base flood elevations and Zone X, 0.2% annual chance flood hazard, areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile.

The remaining portion of the Site is located outside of the 100-year floodplain as determined by the custom FIRMette map created on April 20, 2021 and contained with Appendix B.

**FEES DEVELOPMENT**

**APPLICABLE FEES**

Drainage and Bridge Fees are required to be paid at the time of Final Plat recording for the Project. The Site is within the Haegler Ranch Drainage Basin. Drainage Fees are based on the number of impervious acres for the development. The 2024 Drainage and Bridge Fees are \$13,971 and \$2,062, respectively, per impervious acre. Fee calculation is provided below:

Total Acreage (40-acres) x Total Development (inclusive of Prop. Public ROW) Impervious Value (12%) = Impervious Acres (4.8)

|                                      |                                  |                          |
|--------------------------------------|----------------------------------|--------------------------|
| 2024 Drainage Basins Fees            | = 4.8-acres x (\$ 13,971)        | = \$ 67,060.80           |
| 2024 Bridge Fees                     | = 4.8-acres x (\$ 2,062)         | = \$ 9,897.60            |
| Subtotal                             |                                  | = \$ 76,958.40           |
| <i>25% Reduction for 5-acre lots</i> | = 0.25 * ( <b>\$ 67,060.80</b> ) | = ( <b>\$16,765.20</b> ) |

**Final Fee = \$60,193.20**

**CONSTRUCTION COST OPINION**

An opinion of probable construction cost for the construction of the private drainage facilities for the Project has been included in Appendix E. There are no public drainage ponds or permanent control measures proposed as part of the Project.

**MAINTENANCE AND OPERATIONS**

No detention has been proposed as part of this Project. The public roadside ditches and culverts within the proposed Public ROW which provide water quality treatment will be maintained by El Paso County, upon acceptance. Other proposed ditches, swales and culverts located outside of the proposed Public ROW will be maintained by property owners of the development. Easements will be provided over the shared driveways and ditches to allow all property owners the ability to access and maintain ditches and culverts as needed.

**GROUNDWATER CONSIDERATIONS**

A Geotechnical Evaluation by RMG and dated 4/14/2021 was performed for the Site. According to the Geotechnical Evaluation, "Groundwater was encountered in all three test borings at depths ranging from between 11.0 feet to 18.0 feet below the existing ground surface at the time of boring. When checked five days subsequent to drilling, groundwater was encountered at depths ranging

between 4.0 feet to 18.6 feet. Groundwater levels are anticipated to have sufficient separation from the bottom of proposed crawlspace and basement foundation components on Lots 2, 4, 6 and 7. Due to the shallow groundwater conditions encountered near the unnamed intermittent creek, the use of basements on Lots 1 and 5 may be limited. Groundwater conditions should be considered in the site-specific soils investigations and OWTS designs.”

## **SUMMARY**

### ***COMPLIANCE WITH STANDARDS***

The drainage design presented within this report for the Peerless Farms Large-Lot Single-Family Development conforms to the City of Colorado Springs/El Paso County Storm Drainage Criteria and the Urban Drainage and Flood Control District Manual. Additionally, the Site runoff and private storm sewer facilities will not adversely affect the downstream and surrounding developments or waterways. This report and its findings are consistent with the drainage requirements documented in the DBPS. During construction at the Site, erosion control measures will be implemented as briefly discussed in the Erosion Control Plan Section above and as further detailed in the Grading and Erosion Control Plans and Stormwater Management Plan. The total anticipated project disturbance area for this Project as part of the proposed public road and site infrastructure is 7.3 acres.




## REFERENCES

1. The City of Colorado Springs Drainage Criteria Manual, May 2014
2. El Paso County Drainage Criteria Manual, Vol. 1 and 2, October 1994
3. Urban Drainage and Flood Control District Drainage Criteria Manual (UDFCDCM), Vol. 1, prepared by Wright-McLaughlin Engineers, June 2001, with latest revisions.
4. Flood Insurance Rate Map, El Paso County, Colorado and Incorporated Areas, Map Number 08041C0553G, Effective Date December 7, 2018, prepared by the Federal Emergency Management Agency (FEMA).
5. Haegler Ranch Basin Drainage Basin Planning Study. Prepared by URS, May 2009.
6. Geotechnical Evaluation prepared by RMG. April 14, 2021.

**APPENDIX**

***APPENDIX A - VICINITY MAP***

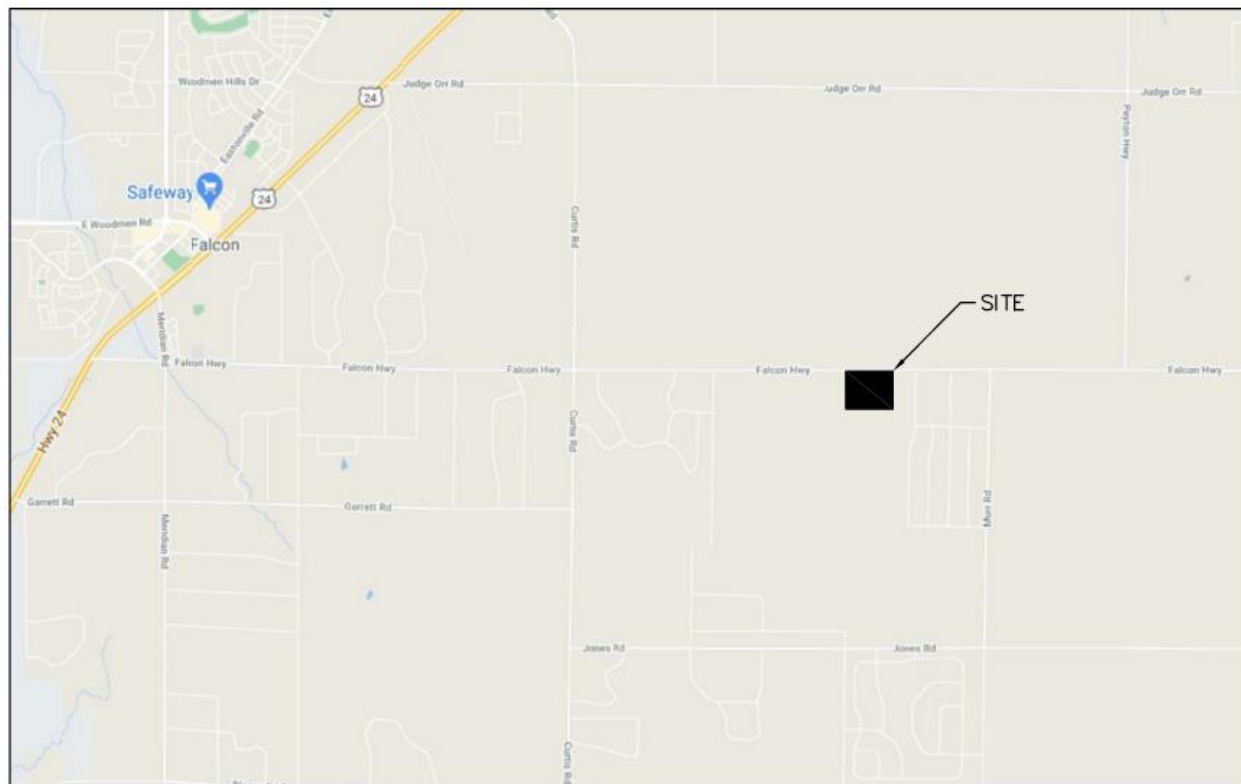

***APPENDIX B - SOILS MAP AND FEMA FIRM PANEL***




United States  
Department of  
Agriculture

**NRCS**

Natural  
Resources  
Conservation  
Service

A product of the National  
Cooperative Soil Survey,  
a joint effort of the United  
States Department of  
Agriculture and other  
Federal agencies, State  
agencies including the  
Agricultural Experiment  
Stations, and local  
participants

# Custom Soil Resource Report for El Paso County Area, Colorado

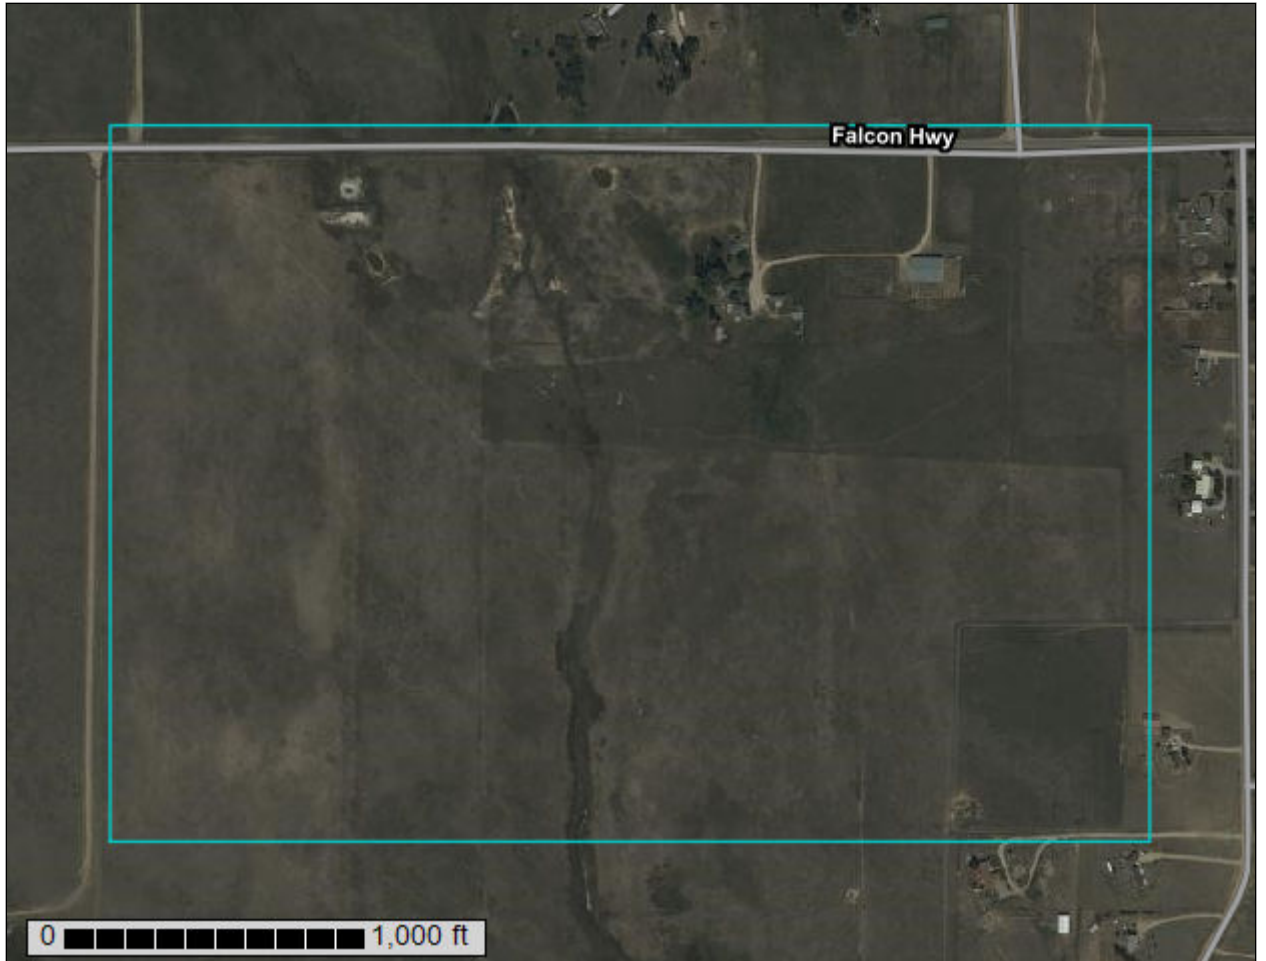

# Preface

---

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist ([http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2\\_053951](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951)).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.



# Contents

---

|  |    |
|--|----|
| <b>Preface</b> .....                               | 2  |
| <b>How Soil Surveys Are Made</b> .....             | 5  |
| <b>Soil Map</b> .....                              | 8  |
| Soil Map.....                                      | 9  |
| Legend.....  | 10 |
| Map Unit Legend.....                               | 11 |
| Map Unit Descriptions.....                         | 11 |
| El Paso County Area, Colorado.....                 | 13 |
| 8—Blakeland loamy sand, 1 to 9 percent slopes..... | 13 |
| 9—Blakeland-Fluvaquentic Haplaquolls.....          | 14 |
| 95—Truckton loamy sand, 1 to 9 percent slopes..... | 16 |
| <b>Soil Information for All Uses</b> .....         | 18 |
| Soil Properties and Qualities.....                 | 18 |
| Soil Erosion Factors.....                          | 18 |
| K Factor, Whole Soil.....                          | 18 |
| Wind Erodibility Group.....                        | 21 |
| Soil Qualities and Features.....                   | 24 |
| Hydrologic Soil Group.....                         | 24 |
| <b>References</b> .....                            | 29 |

# How Soil Surveys Are Made

---

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

## Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

## Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

# Soil Map

---

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

# Custom Soil Resource Report Soil Map



Map Scale: 1:6,130 if printed on A landscape (11" x 8.5") sheet.

0 50 100 200 300 Meters


0 250 500 1000 1500 Feet

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84


## Custom Soil Resource Report


### MAP LEGEND

#### Area of Interest (AOI)

 Area of Interest (AOI)


#### Soils


 Soil Map Unit Polygons


 Soil Map Unit Lines


 Soil Map Unit Points

#### Special Point Features

 Blowout

 Borrow Pit


 Clay Spot

 Closed Depression

 Gravel Pit

 Gravelly Spot


 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water


 Perennial Water

 Rock Outcrop


 Saline Spot

 Sandy Spot

 Severely Eroded Spot


 Sinkhole

 Slide or Slip


 Sodic Spot


 Spoil Area

 Stony Spot


 Very Stony Spot

 Wet Spot

 Other

 Special Line Features

#### Water Features

 Streams and Canals


#### Transportation

 Rails


 Interstate Highways

 US Routes

 Major Roads

 Local Roads

#### Background

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 11, 2018—Oct 20, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Custom Soil Resource Report

## Map Unit Legend

| Map Unit Symbol                    | Map Unit Name                               | Acres in AOI | Percent of AOI |
|------------------------------------|---|--------------|----------------|
| 8                                  | Blakeland loamy sand, 1 to 9 percent slopes | 13.9         | 7.4%           |
| 9                                  | Blakeland-Fluvaquentic Haplaquolls          | 75.0         | 39.7%          |
| 95                                 | Truckton loamy sand, 1 to 9 percent slopes  | 99.9         | 52.9%          |
| <b>Totals for Area of Interest</b> |   | <b>188.9</b> | <b>100.0%</b>  |

## Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or



## Custom Soil Resource Report

landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Custom Soil Resource Report

## El Paso County Area, Colorado

### 8—Blakeland loamy sand, 1 to 9 percent slopes

#### Map Unit Setting

*National map unit symbol:* 369v  
*Elevation:* 4,600 to 5,800 feet  
*Mean annual precipitation:* 14 to 16 inches  
*Mean annual air temperature:* 46 to 48 degrees F  
*Frost-free period:* 125 to 145 days  
*Farmland classification:* Not prime farmland

#### Map Unit Composition

*Blakeland and similar soils:* 98 percent  
*Minor components:* 2 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

#### Description of Blakeland

##### Setting

*Landform:* Hills, flats  
*Landform position (three-dimensional):* Side slope, talf  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Parent material:* Alluvium derived from sedimentary rock and/or eolian deposits derived from sedimentary rock

##### Typical profile

*A - 0 to 11 inches:* loamy sand  
*AC - 11 to 27 inches:* loamy sand  
*C - 27 to 60 inches:* sand

##### Properties and qualities

*Slope:* 1 to 9 percent  
*Depth to restrictive feature:* More than 80 inches  
*Drainage class:* Somewhat excessively drained  
*Runoff class:* Low  
*Capacity of the most limiting layer to transmit water (Ksat):* High to very high (5.95 to 19.98 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Calcium carbonate, maximum content:* 5 percent  
*Available water capacity:* Low (about 4.5 inches)

##### Interpretive groups

*Land capability classification (irrigated):* 3e  
*Land capability classification (nonirrigated):* 6e  
*Hydrologic Soil Group:* A  
*Ecological site:* R049XB210CO - Sandy Foothill  
*Hydric soil rating:* No

#### Minor Components

##### Pleasant

*Percent of map unit:* 1 percent

## Custom Soil Resource Report

*Landform:* Depressions

*Hydric soil rating:* Yes

### **Other soils**

*Percent of map unit:* 1 percent

*Hydric soil rating:* No

## **9—Blakeland-Fluvaquentic Haplaquolls**

### **Map Unit Setting**

*National map unit symbol:* 36b6

*Elevation:* 3,500 to 5,800 feet

*Mean annual precipitation:* 13 to 17 inches

*Mean annual air temperature:* 46 to 55 degrees F

*Frost-free period:* 110 to 165 days

*Farmland classification:* Not prime farmland

### **Map Unit Composition**

*Blakeland and similar soils:* 60 percent

*Fluvaquentic haplaquolls and similar soils:* 38 percent

*Minor components:* 2 percent

*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Blakeland**

#### **Setting**

*Landform:* Hills, flats

*Landform position (three-dimensional):* Side slope, talf

*Down-slope shape:* Linear

*Across-slope shape:* Linear

*Parent material:* Sandy alluvium derived from arkose and/or eolian deposits  
derived from arkose

#### **Typical profile**

*A - 0 to 11 inches:* loamy sand

*AC - 11 to 27 inches:* loamy sand

*C - 27 to 60 inches:* sand

#### **Properties and qualities**

*Slope:* 1 to 9 percent

*Depth to restrictive feature:* More than 80 inches

*Drainage class:* Somewhat excessively drained

*Runoff class:* Low

*Capacity of the most limiting layer to transmit water (Ksat):* High to very high (5.95  
to 19.98 in/hr)

*Depth to water table:* More than 80 inches

*Frequency of flooding:* None

*Frequency of ponding:* None

*Calcium carbonate, maximum content:* 5 percent

*Available water capacity:* Low (about 4.5 inches)

## Custom Soil Resource Report

### Interpretive groups

*Land capability classification (irrigated): 3e*  
*Land capability classification (nonirrigated): 6e*  
*Hydrologic Soil Group: A*  
*Ecological site: R049XB210CO - Sandy Foothill*  
*Hydric soil rating: No*

### Description of Fluvaquentic Haplaquolls

#### Setting

*Landform: Swales*  
*Down-slope shape: Linear*  
*Across-slope shape: Linear*  
*Parent material: Alluvium*

#### Typical profile

*H1 - 0 to 12 inches: variable*

#### Properties and qualities

*Slope: 1 to 2 percent*  
*Depth to restrictive feature: More than 80 inches*  
*Drainage class: Poorly drained*  
*Runoff class: Very high*  
*Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high*  
*(0.20 to 6.00 in/hr)*  
*Depth to water table: About 0 to 24 inches*  
*Frequency of flooding: Occasional*  
*Frequency of ponding: None*  
*Maximum salinity: Nonsaline to slightly saline (0.0 to 4.0 mmhos/cm)*

### Interpretive groups

*Land capability classification (irrigated): 6w*  
*Land capability classification (nonirrigated): 6w*  
*Hydrologic Soil Group: D*  
*Hydric soil rating: Yes*

### Minor Components

#### Other soils

*Percent of map unit: 1 percent*  
*Hydric soil rating: No*

#### Pleasant

*Percent of map unit: 1 percent*  
*Landform: Depressions*  
*Hydric soil rating: Yes*

Custom Soil Resource Report

**95—Truckton loamy sand, 1 to 9 percent slopes**

**Map Unit Setting**

*National map unit symbol:* 36bd  
*Elevation:* 6,000 to 7,000 feet  
*Mean annual precipitation:* 14 to 16 inches  
*Mean annual air temperature:* 46 to 50 degrees F  
*Frost-free period:* 125 to 145 days  
*Farmland classification:* Not prime farmland

**Map Unit Composition**

*Truckton and similar soils:* 95 percent  
*Minor components:* 5 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

**Description of Truckton**

**Setting**

*Landform:* Hills, flats  
*Landform position (three-dimensional):* Side slope, talf  
*Down-slope shape:* Linear  
*Across-slope shape:* Linear  
*Parent material:* Arkosic alluvium derived from sedimentary rock and/or arkosic residuum weathered from sedimentary rock

**Typical profile**

*A - 0 to 8 inches:* loamy sand  
*Bt - 8 to 24 inches:* sandy loam  
*C - 24 to 60 inches:* coarse sandy loam

**Properties and qualities**

*Slope:* 1 to 9 percent  
*Depth to restrictive feature:* More than 80 inches  
*Drainage class:* Well drained  
*Runoff class:* Low  
*Capacity of the most limiting layer to transmit water (Ksat):* High (1.98 to 6.00 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Available water capacity:* Low (about 5.4 inches)

**Interpretive groups**

*Land capability classification (irrigated):* 4e  
*Land capability classification (nonirrigated):* 6e  
*Hydrologic Soil Group:* A  
*Ecological site:* R049XB210CO - Sandy Foothill  
*Hydric soil rating:* No

## Custom Soil Resource Report

### Minor Components

#### Other soils

*Percent of map unit:* 4 percent

*Hydric soil rating:* No

#### Pleasant

*Percent of map unit:* 1 percent

*Landform:* Depressions

*Hydric soil rating:* Yes

# **Soil Information for All Uses**

---

## **Soil Properties and Qualities**

The Soil Properties and Qualities section includes various soil properties and qualities displayed as thematic maps with a summary table for the soil map units in the selected area of interest. A single value or rating for each map unit is generated by aggregating the interpretive ratings of individual map unit components. This aggregation process is defined for each property or quality.

## **Soil Erosion Factors**

Soil Erosion Factors are soil properties and interpretations used in evaluating the soil for potential erosion. Example soil erosion factors can include K factor for the whole soil or on a rock free basis, T factor, wind erodibility group and wind erodibility index.


### **K Factor, Whole Soil**

Erosion factor K indicates the susceptibility of a soil to sheet and rill erosion by water. Factor K is one of six factors used in the Universal Soil Loss Equation (USLE) and the Revised Universal Soil Loss Equation (RUSLE) to predict the average annual rate of soil loss by sheet and rill erosion in tons per acre per year. The estimates are based primarily on percentage of silt, sand, and organic matter and on soil structure and saturated hydraulic conductivity (Ksat). Values of K range from 0.02 to 0.69. Other factors being equal, the higher the value, the more susceptible the soil is to sheet and rill erosion by water.


"Erosion factor Kw (whole soil)" indicates the erodibility of the whole soil. The estimates are modified by the presence of rock fragments.

Factor K does not apply to organic horizons and is not reported for those layers.

### Custom Soil Resource Report Map—K Factor, Whole Soil

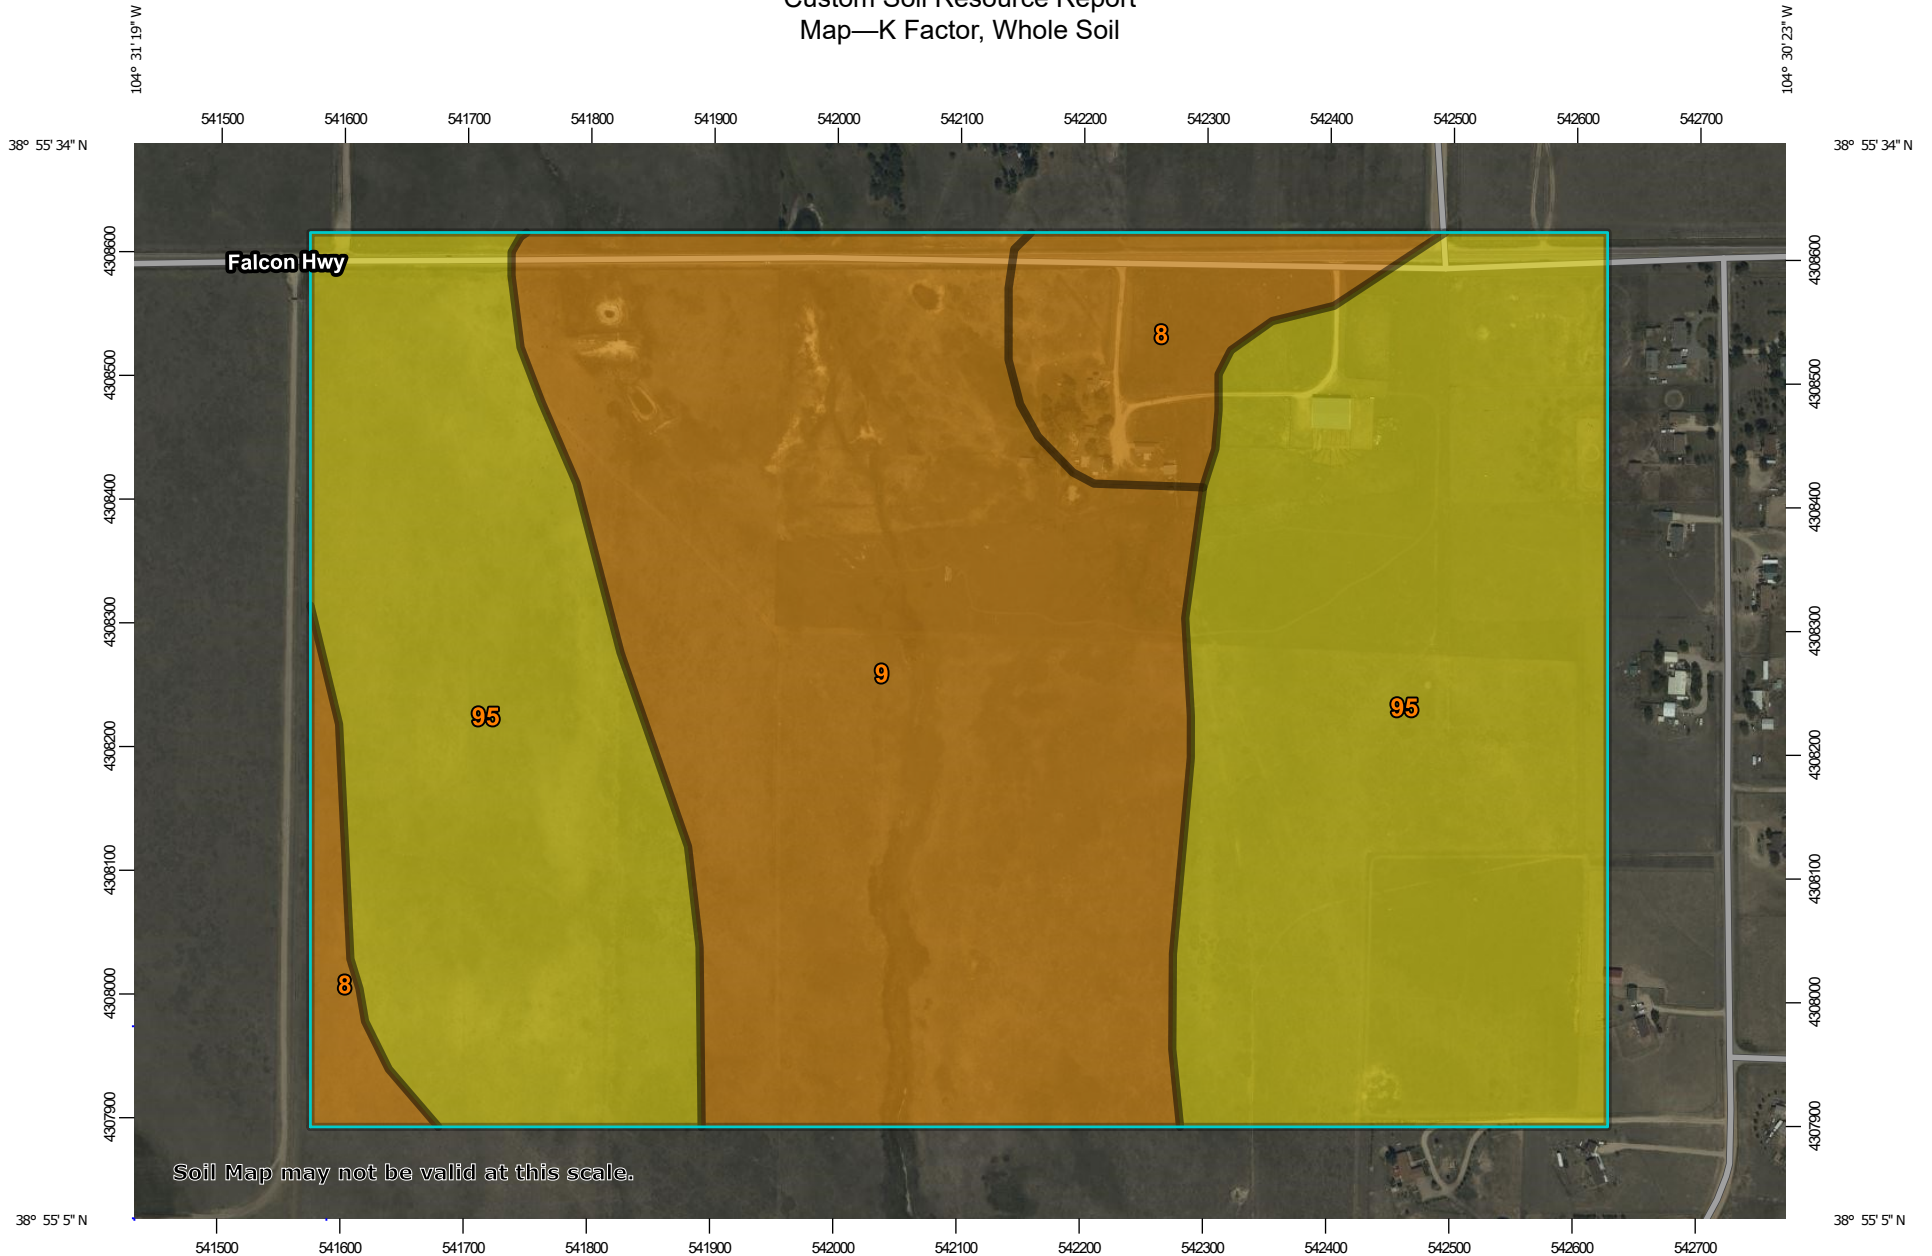

Soil Map may not be valid at this scale.

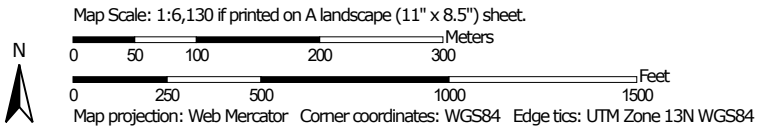




### Custom Soil Resource Report
















#### MAP LEGEND

**Area of Interest (AOI)**







 Area of Interest (AOI)










**Soils**

**Soil Rating Polygons**
















-  .02
-  .05
-  .10
-  .15
-  .17
-  .20
-  .24
-  .28
-  .32
-  .37
-  .43
-  .49
-  .55
-  .64
-  Not rated or not available

**Soil Rating Lines**








-  .02
-  .05
-  .10
-  .15
-  .17
-  .20

-  .24
-  .28
-  .32
-  .37
-  .43
-  .49
-  .55
-  .64
-  Not rated or not available

**Soil Rating Points**

-  .02
-  .05
-  .10
-  .15
-  .17
-  .20
-  .24
-  .28
-  .32
-  .37
-  .43
-  .49
-  .55
-  .64
-  Not rated or not available

**Water Features**

-  Streams and Canals
- Transportation**
-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads
- Background**
-  Aerial Photography

#### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 11, 2018—Oct 20, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Custom Soil Resource Report

**Table—K Factor, Whole Soil**

| Map unit symbol                    | Map unit name                               | Rating | Acres in AOI | Percent of AOI |
|------------------------------------|---|--------|--------------|----------------|
| 8                                  | Blakeland loamy sand, 1 to 9 percent slopes | .10    | 13.9         | 7.4%           |
| 9                                  | Blakeland-Fluvaquentic Haplaquolls          | .10    | 75.0         | 39.7%          |
| 95                                 | Truckton loamy sand, 1 to 9 percent slopes  | .17    | 99.9         | 52.9%          |
| <b>Totals for Area of Interest</b> |   |        | <b>188.9</b> | <b>100.0%</b>  |

**Rating Options—K Factor, Whole Soil**

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified


*Tie-break Rule:* Higher

*Layer Options (Horizon Aggregation Method):* Surface Layer (Not applicable)


**Wind Erodibility Group**

A wind erodibility group (WEG) consists of soils that have similar properties affecting their susceptibility to wind erosion in cultivated areas. The soils assigned to group 1 are the most susceptible to wind erosion, and those assigned to group 8 are the least susceptible.

# Custom Soil Resource Report Map—Wind Erodibility Group

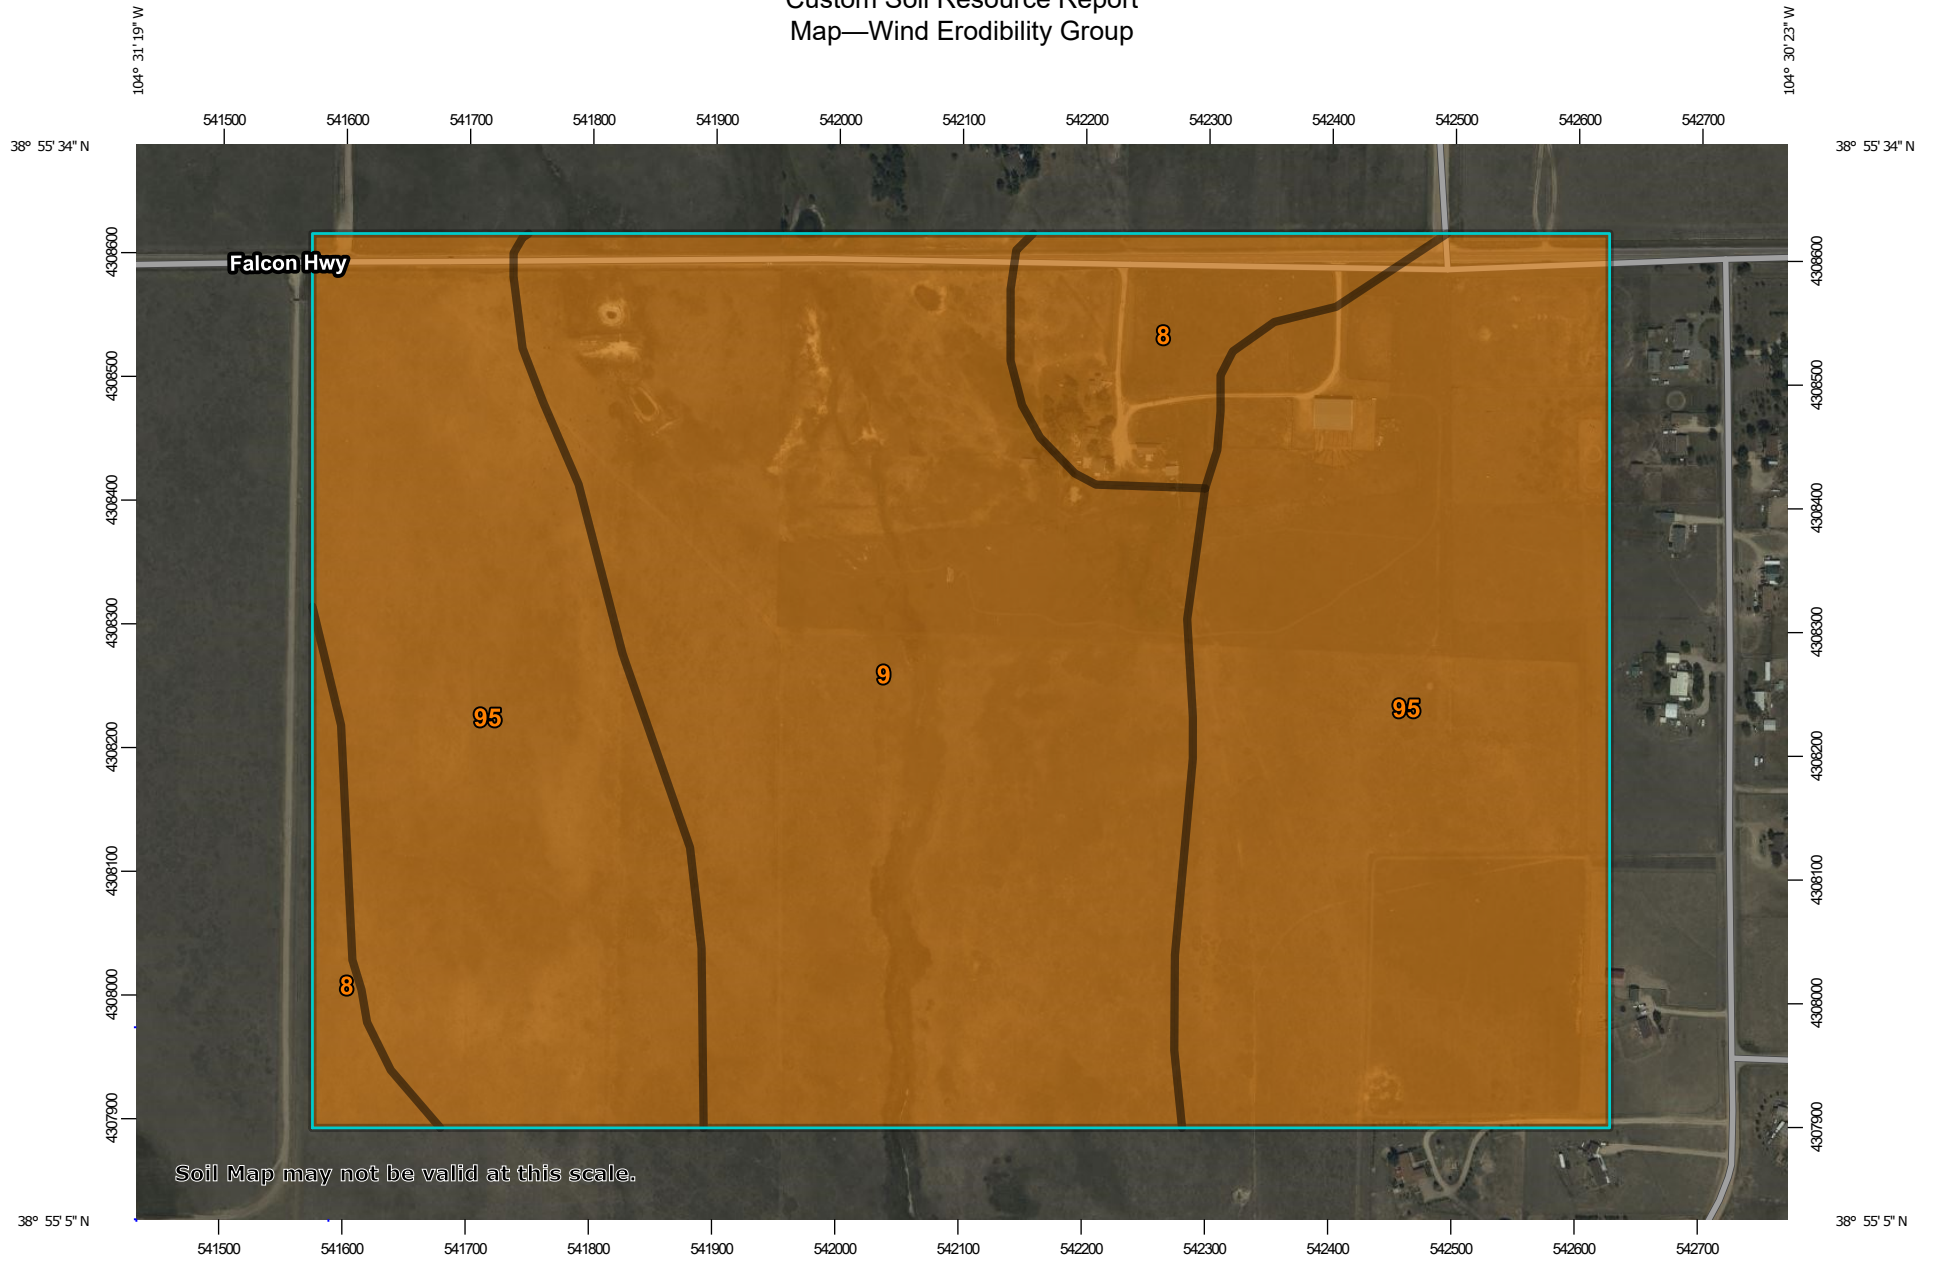



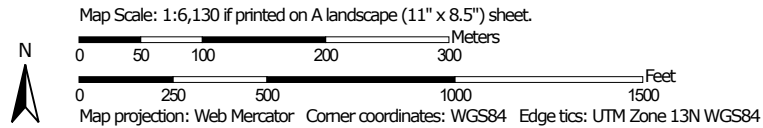



































Soil Map may not be valid at this scale.



## Custom Soil Resource Report

### MAP LEGEND

|  |  |  |
|--|--|--|
| <b>Area of Interest (AOI)</b>  |  |  1                          |
|  Area of Interest (AOI)       |  |  2                          |
| <b>Soils</b>   |  |  3                          |
| <b>Soil Rating Polygons</b>  |  |  4                          |
|  1                            |  |  4L                         |
|  2                            |  |  5                          |
|  3                            |  |  6                          |
|  4                            |  |  7                          |
|  4L                           |  |  8                          |
|  5                            |  |  Not rated or not available |
|  6                            |  |  |
|  7                            |  | <b>Water Features</b>  |
|  8                            |  |  Streams and Canals         |
|  Not rated or not available   |  | <b>Transportation</b>  |
| <b>Soil Rating Lines</b>   |  |  Rails                      |
|  1                            |  |  Interstate Highways        |
|  2                            |  |  US Routes                  |
|  3                            |  |  Major Roads                |
|  4                          |  |  Local Roads                |
|  4L                         |  | <b>Background</b>  |
|  5                          |  |  Aerial Photography       |
|  6                          |  |  |
|  7                          |  |  |
|  8                          |  |  |
|  Not rated or not available |  |  |
| <b>Soil Rating Points</b>  |  |  |

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 11, 2018—Oct 20, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Custom Soil Resource Report

**Table—Wind Erodibility Group**

| Map unit symbol                    | Map unit name                               | Rating | Acres in AOI | Percent of AOI |
|------------------------------------|---|--------|--------------|----------------|
| 8                                  | Blakeland loamy sand, 1 to 9 percent slopes | 2      | 13.9         | 7.4%           |
| 9                                  | Blakeland-Fluvaquentic Haplaquolls          | 2      | 75.0         | 39.7%          |
| 95                                 | Truckton loamy sand, 1 to 9 percent slopes  | 2      | 99.9         | 52.9%          |
| <b>Totals for Area of Interest</b> |   |        | <b>188.9</b> | <b>100.0%</b>  |

**Rating Options—Wind Erodibility Group**

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Lower

**Soil Qualities and Features**

Soil qualities are behavior and performance attributes that are not directly measured, but are inferred from observations of dynamic conditions and from soil properties. Example soil qualities include natural drainage, and frost action. Soil features are attributes that are not directly part of the soil. Example soil features include slope and depth to restrictive layer. These features can greatly impact the use and management of the soil.

**Hydrologic Soil Group**

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained

## Custom Soil Resource Report


soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.


Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

# Custom Soil Resource Report Map—Hydrologic Soil Group

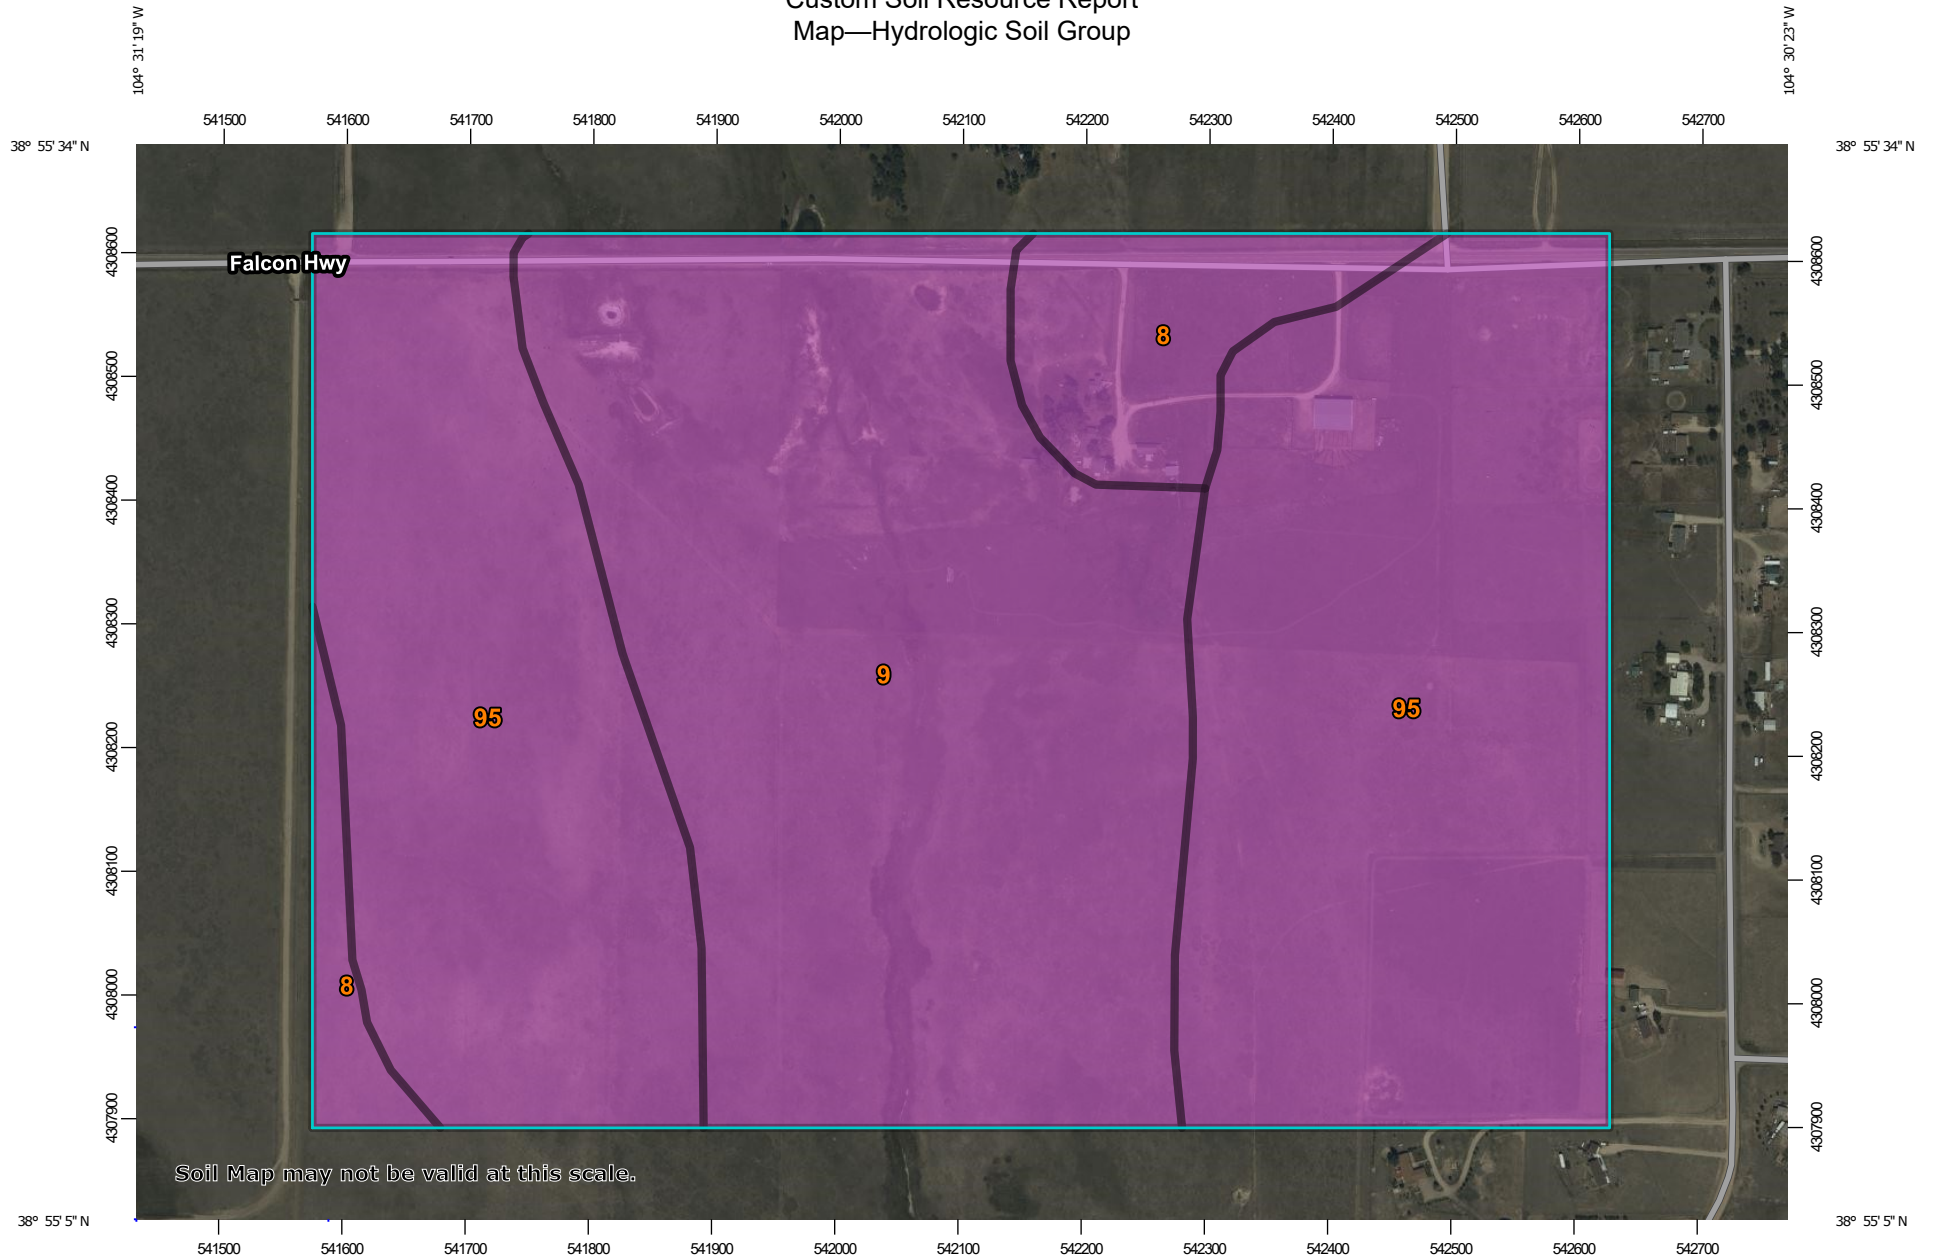


Soil Map may not be valid at this scale.

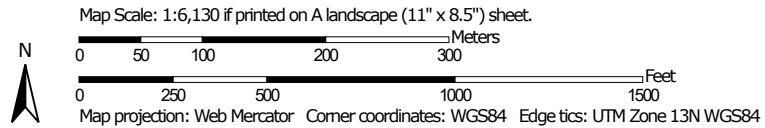

## Custom Soil Resource Report

### MAP LEGEND

#### Area of Interest (AOI)









 Area of Interest (AOI)

#### Soils

##### Soil Rating Polygons





 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

##### Soil Rating Lines


 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

##### Soil Rating Points






 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

#### Water Features

 Streams and Canals

#### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

#### Background

 Aerial Photography

### MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: El Paso County Area, Colorado  
 Survey Area Data: Version 18, Jun 5, 2020

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 11, 2018—Oct 20, 2018

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.



Custom Soil Resource Report

**Table—Hydrologic Soil Group**

| Map unit symbol                    | Map unit name                               | Rating | Acres in AOI | Percent of AOI |
|------------------------------------|---|--------|--------------|----------------|
| 8                                  | Blakeland loamy sand, 1 to 9 percent slopes | A      | 13.9         | 7.4%           |
| 9                                  | Blakeland-Fluvaquentic Haplaquolls          | A      | 75.0         | 39.7%          |
| 95                                 | Truckton loamy sand, 1 to 9 percent slopes  | A      | 99.9         | 52.9%          |
| <b>Totals for Area of Interest</b> |   |        | <b>188.9</b> | <b>100.0%</b>  |

**Rating Options—Hydrologic Soil Group**

*Aggregation Method: Dominant Condition*

*Component Percent Cutoff: None Specified*

*Tie-break Rule: Higher*

## References

---

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_054262](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262)
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053577](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577)
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053580](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580)
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2\\_053374](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374)
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

## Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2\\_054242](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242)


United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. [http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2\\_053624](http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624)

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. [http://www.nrcs.usda.gov/Internet/FSE\\_DOCUMENTS/nrcs142p2\\_052290.pdf](http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf)

# National Flood Hazard Layer FIRMMette



104°31'16"W 38°55'35"N

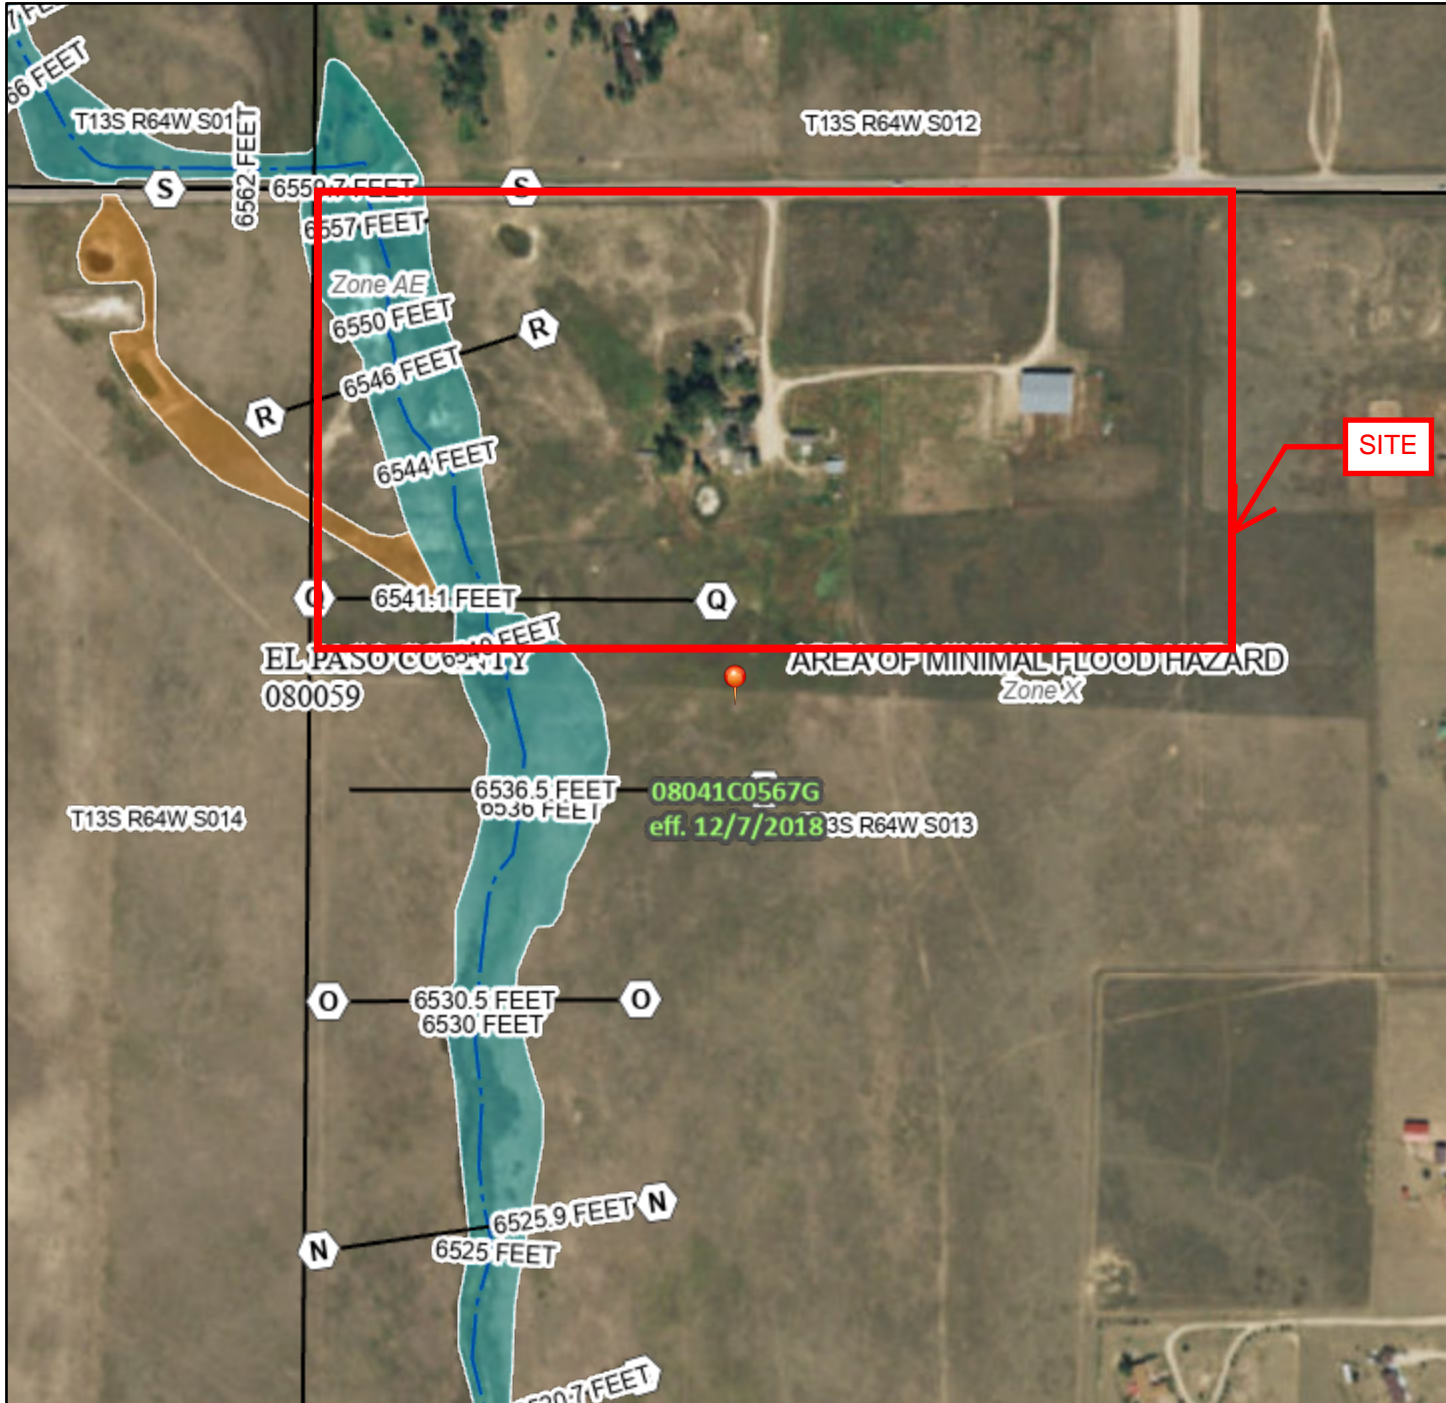

## Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

- |                                    |  |
|------------------------------------|--|
| <b>SPECIAL FLOOD HAZARD AREAS</b>  | Without Base Flood Elevation (BFE)<br><i>Zone A, V, A99</i>  |
|                                    | With BFE or Depth <i>Zone AE, AO, AH, VE, AR</i>   |
|                                    | Regulatory Floodway  |
| <b>OTHER AREAS OF FLOOD HAZARD</b> | 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile <i>Zone X</i> |
|                                    | Future Conditions 1% Annual Chance Flood Hazard <i>Zone X</i>  |
|                                    | Area with Reduced Flood Risk due to Levee. See Notes. <i>Zone X</i>  |
|                                    | Area with Flood Risk due to Levee <i>Zone D</i>  |
| <b>OTHER AREAS</b>                 | NO SCREEN Area of Minimal Flood Hazard <i>Zone X</i>   |
|                                    | Effective LOMRs  |
|                                    | Area of Undetermined Flood Hazard <i>Zone D</i>  |
| <b>GENERAL STRUCTURES</b>          | Channel, Culvert, or Storm Sewer   |
|                                    | Levee, Dike, or Floodwall  |
| <b>OTHER FEATURES</b>              | Cross Sections with 1% Annual Chance Water Surface Elevation <b>20.2</b>   |
|                                    | Cross Sections with 1% Annual Chance Water Surface Elevation <b>17.5</b>   |
|                                    | Coastal Transect   |
|                                    | Base Flood Elevation Line (BFE)  |
|                                    | Limit of Study   |
|                                    | Jurisdiction Boundary  |
|                                    | Coastal Transect Baseline  |
|                                    | Profile Baseline   |
|                                    | Hydrographic Feature   |
| <b>MAP PANELS</b>                  | Digital Data Available   |
|                                    | No Digital Data Available  |
|                                    | Unmapped   |



The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **4/20/2021 at 4:13 PM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

***APPENDIX C - HYDROLOGIC CALCULATIONS***



**EXISTING  
RUNOFF COEFFICIENTS - IMPERVIOUS CALCULATION**

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 8/28/2024

| SOIL:                  |                 |                      |                           |                          |                        |                       |      |      |       |        |       |
|------------------------|-----------------|----------------------|---------------------------|--------------------------|------------------------|-----------------------|------|------|-------|--------|-------|
| LAND USE:              |                 | Roof<br>AREA         | Landscape<br>AREA         | Pavement<br>AREA         | Gravel<br>AREA         |                       |      |      |       |        |       |
| 2-YEAR COEFF.          |                 | 0.71                 | 0.02                      | 0.89                     | 0.57                   |                       |      |      |       |        |       |
| 5-YEAR COEFF.          |                 | 0.73                 | 0.08                      | 0.90                     | 0.59                   |                       |      |      |       |        |       |
| 10-YEAR COEFF.         |                 | 0.75                 | 0.15                      | 0.92                     | 0.63                   |                       |      |      |       |        |       |
| 100-YEAR COEFF.        |                 | 0.81                 | 0.35                      | 0.96                     | 0.70                   |                       |      |      |       |        |       |
| IMPERVIOUS %           |                 | 90%                  | 0%                        | 100%                     | 80%                    |                       |      |      |       |        |       |
| DESIGN<br>BASIN        | DESIGN<br>POINT | Roof<br>AREA<br>(AC) | Landscape<br>AREA<br>(AC) | Pavement<br>AREA<br>(AC) | Gravel<br>AREA<br>(AC) | TOTAL<br>AREA<br>(AC) | C(2) | C(5) | C(10) | C(100) | Imp % |
| <b>On-Site Basins</b>  |                 |                      |                           |                          |                        |                       |      |      |       |        |       |
| EX1                    | EX1             | 0.26                 | 34.58                     | 0.06                     | 0.46                   | 35.36                 | 0.03 | 0.09 | 0.16  | 0.36   | 2%    |
| EX2                    | EX2             | 0.09                 | 4.45                      | 0.00                     | 0.10                   | 4.64                  | 0.05 | 0.10 | 0.17  | 0.37   | 4%    |
|                        |                 | 0.35                 | 39.03                     | 0.06                     | 0.56                   | 40.00                 | 0.04 | 0.09 | 0.16  | 0.36   | 2%    |
| <b>BASIN SUBTOTAL</b>  |                 | <b>1%</b>            | <b>98%</b>                | <b>0%</b>                | <b>1%</b>              | <b>100%</b>           |      |      |       |        |       |
| <b>Off-Site Basins</b> |                 |                      |                           |                          |                        |                       |      |      |       |        |       |
| EX3                    | EX3             | 0.00                 | 1.93                      | 0.70                     | 0.00                   | 2.63                  | 0.25 | 0.30 | 0.35  | 0.51   | 27%   |
| EX3B                   | EX3B            | 0.13                 | 5.40                      | 0.44                     | 0.00                   | 5.97                  | 0.10 | 0.15 | 0.22  | 0.40   | 9%    |
| T3-02                  | T3              | -                    | -                         | -                        | -                      | 289                   | -    | -    | -     | -      | -     |
| T4                     | T4              | -                    | -                         | -                        | -                      | 350                   | -    | -    | -     | -      | -     |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.



### EXISTING Time of Concentration

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 8/28/2024

| SUB-BASIN DATA         |             |        | INITIAL TIME (T <sub>i</sub> ) |             |                         | TRAVEL TIME (T <sub>t</sub> ) |             |                    |              |                          | T <sub>c</sub> CHECK (URBANIZED BASINS) |                   |                  |                 | FINAL T <sub>c</sub>     |      |
|------------------------|-------------|--------|--------------------------------|-------------|-------------------------|-------------------------------|-------------|--------------------|--------------|--------------------------|---|-------------------|------------------|-----------------|--------------------------|------|
| DESIGN BASIN (1)       | AREA Ac (2) | C5 (3) | LENGTH Ft (4)                  | SLOPE % (5) | T <sub>i</sub> Min. (6) | LENGTH Ft. (7)                | SLOPE % (8) | C <sub>v</sub> (9) | VEL fps (11) | T <sub>t</sub> Min. (12) | COMP. t <sub>c</sub> (13)               | TOTAL LENGTH (14) | TOTAL SLOPE (15) | TOTAL IMP. (16) | T <sub>c</sub> Min. (17) | Min. |
| <b>On-Site Basins</b>  |             |        |                                |             |                         |                               |             |                    |              |                          |   |                   |                  |                 |                          |      |
| EX1                    | 35.36       | 0.093  | 300                            | 1.6%        | 27.3                    | 1,618                         | 3.4%        | 2.5                | 0.5          | 58.5                     | 85.8                                    | 1918              | 3.1%             | 2%              | 45.2                     | 45.2 |
| EX2                    | 5           | 0.104  | 300                            | 2.8%        | 22.4                    | 569                           | 1.9%        | 2.5                | 0.3          | 27.5                     | 50.0                                    | 869               | 2.2%             | 4%              | 35.7                     | 35.7 |
| <b>Off-Site Basins</b> |             |        |                                |             |                         |                               |             |                    |              |                          |   |                   |                  |                 |                          |      |
| EX3                    | 2.63        | 0.30   | 40                             | 2.5%        | 6.9                     | 1,500                         | 1.9%        | 20.0               | 2.8          | 9.1                      | 15.9                                    | 1540              | 1.9%             | 27%             | 36.1                     | 15.9 |
| EX3B                   | 5.97        | 0.15   | 20                             | 2.0%        | 6.2                     | 1,034                         | 1.5%        | 20.0               | 2.4          | 7.0                      | 13.2                                    | 1054              | 1.5%             | 9%              | 38.3                     | 13.2 |
| T3-02                  | 289         | -      | -                              | -           | -                       | -                             | -           | -                  | -            | -                        | -                                       | -                 | -                | -               | -                        | -    |
| T4                     | 350         | -      | -                              | -           | -                       | -                             | -           | -                  | -            | -                        | -                                       | -                 | -                | -               | -                        | -    |

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L_i}}{S_o^{0.33}}$$

$$t_i = \frac{L_i}{60K\sqrt{S_o}} = \frac{L_i}{60V_i}$$

$$t_i = (26 - 17i) + \frac{L_i}{60(14i + 9)\sqrt{S_o}}$$

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.



**EXISTING  
STORM DRAINAGE DESIGN - RATIONAL METHOD 5 YEAR EVENT**

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 1.96E+08  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 8/28/2024

$P_1$  (1-Hour Rainfall) = **1.5**

| (1)<br>STORM LINE      | (2)<br>DESIGN POINT | DIRECT RUNOFF       |                  |                     |                    |                    |                    |                  |                              |                     | CUMULATIVE RUNOFF      |                     |                   |                   | STREET                   |                          | PIPE              |                        |                     | TRAVEL TIME            |   |  | (22)<br>REMARKS |
|------------------------|---------------------|---------------------|------------------|---------------------|--------------------|--------------------|--------------------|------------------|------------------------------|---------------------|------------------------|---------------------|-------------------|-------------------|--------------------------|--------------------------|-------------------|------------------------|---------------------|------------------------|---|--|-----------------|
|                        |                     | (3)<br>DESIGN BASIN | (4)<br>AREA (AC) | (5)<br>RUNOFF COEFF | (6)<br>$t_c$ (min) | (7)<br>$C^*A$ (ac) | (8)<br>$I$ (in/hr) | (9)<br>$Q$ (cfs) | (9B)<br>$Q^{**}$ (Cum) (cfs) | (10)<br>$t_c$ (max) | (11)<br>$S(C^*A)$ (ac) | (12)<br>$I$ (in/hr) | (13)<br>$Q$ (cfs) | (14)<br>SLOPE (%) | (15)<br>STREET FLOW(cfs) | (16)<br>DESIGN FLOW(cfs) | (17)<br>SLOPE (%) | (18)<br>PIPE SIZE (in) | (19)<br>LENGTH (ft) | (20)<br>VELOCITY (fps) | (21)<br>$t_t$ (min)                             |  |                 |
| <b>On-Site Basins</b>  |                     |                     |                  |                     |                    |                    |                    |                  |                              |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        |   |  |                 |
|                        | EX1                 | EX1                 | 35.36            | 0.09                | 45.23              | 3.28               | 1.83               | 5.99             | <b>11.33</b>                 |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        | Cummulative Flows from EX1, EX2, EX3B, and EX 3 |  |                 |
|                        | EX2                 | EX2                 | 4.64             | 0.10                | 35.66              | 0.48               | 2.12               | 1.03             | <b>3.16</b>                  |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        | Cummulative Flows from EX2, EX3B                |  |                 |
| <b>Off-Site Basins</b> |                     |                     |                  |                     |                    |                    |                    |                  |                              |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        |   |  |                 |
|                        | EX3                 | EX3                 | 2.63             | 0.25                | 15.93              | 0.66               | 3.31               | 2.18             | <b>5.34</b>                  |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        | Cummulative Flows from EX2, EX3B, and EX3       |  |                 |
|                        | EX3B                | EX3B                | 5.97             | 0.10                | 13.19              | 0.59               | 3.61               | 2.14             | <b>2.14</b>                  |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        |   |  |                 |
|                        | T3                  | T3-02               | 289              | -                   | -                  | -                  | -                  | -                | -                            |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        |   |  |                 |
|                        | T4                  | T4                  | 350              | -                   | -                  | -                  | -                  | -                | -                            |                     |                        |                     |                   |                   |                          |                          |                   |                        |                     |                        |   |  |                 |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

\*\*Refer to Drainage Map for cummulative flows accumulation paths





**EXISTING  
STORM DRAINAGE DESIGN - RATIONAL METHOD 100 YEAR EVENT**

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 1.96E+08  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 8/28/2024

$P_1$  (1-Hour Rainfall) = **2.52**

| STORM LINE             | DESIGN POINT | DIRECT RUNOFF |           |              |          |         |           |         |                 |         | TOTAL RUNOFF |           |         |           | STREET           |                  | PIPE      |                |             | TRAVEL TIME    |          |   | REMARKS |
|------------------------|--------------|---------------|-----------|--------------|----------|---------|-----------|---------|-----------------|---------|--------------|-----------|---------|-----------|------------------|------------------|-----------|----------------|-------------|----------------|----------|---|---------|
|                        |              | DESIGN BASIN  | AREA (AC) | RUNOFF COEFF | tc (min) | C*A(ac) | I (in/hr) | Q (cfs) | Q** (Cum) (cfs) | tc(max) | S(C*A) (ac)  | I (in/hr) | Q (cfs) | SLOPE (%) | STREET FLOW(cfs) | DESIGN FLOW(cfs) | SLOPE (%) | PIPE SIZE (in) | LENGTH (ft) | VELOCITY (fps) | tt (min) |   |         |
| (1)                    | (2)          | (3)           | (4)       | (5)          | (6)      | (7)     | (8)       | (9)     | (9B)            | (10)    | (11)         | (12)      | (13)    | (14)      | (15)             | (16)             | (17)      | (18)           | (19)        | (20)           | (21)     | (22)  |         |
| <b>On-Site Basins</b>  |              |               |           |              |          |         |           |         |                 |         |              |           |         |           |                  |                  |           |                |             |                |          |   |         |
|                        | EX1          | EX1           | 35.36     | 0.36         | 45.23    | 12.69   | 3.07      | 38.94   | 67.16           |         |              |           |         |           |                  |                  |           |                |             |                |          | Cummulative Flows from EX1, EX2, EX3B, and EX 3 |         |
|                        | EX2          | EX2           | 4.64      | 0.37         | 35.66    | 1.70    | 3.56      | 6.07    | 20.74           |         |              |           |         |           |                  |                  |           |                |             |                |          | Cummulative Flows from EX2, EX3B                |         |
| <b>Off-Site Basins</b> |              |               |           |              |          |         |           |         |                 |         |              |           |         |           |                  |                  |           |                |             |                |          |   |         |
|                        | EX3          | EX3           | 2.63      | 0.51         | 15.93    | 1.34    | 5.56      | 7.47    | 28.21           |         |              |           |         |           |                  |                  |           |                |             |                |          | Cummulative Flows from EX2, EX3B, and EX3       |         |
|                        | EX3B         | EX3B          | 5.97      | 0.40         | 13.19    | 2.42    | 6.07      | 14.67   | 14.67           |         |              |           |         |           |                  |                  |           |                |             |                |          |   |         |
|                        | T3           | T3-02         | 289       | -            | -        | -       | -         | 460     | -               |         |              |           |         |           |                  |                  |           |                |             |                |          |   |         |
|                        | T4           | T4            | 350       | -            | -        | -       | -         | 570     | -               |         |              |           |         |           |                  |                  |           |                |             |                |          |   |         |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

\*\*Refer to Drainage Map for cummulative flows accumulation paths



PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 9/10/2024

**EXISTING RATIONAL CALCULATIONS SUMMARY**

| DESIGN POINT           | TRIBUTARY BASINS | TRIBUTARY AREA (AC) | IMPERVIOUSNESS % | PEAK FLOWS (CFS) |                |
|------------------------|------------------|---------------------|------------------|------------------|----------------|
|                        |                  |                     |                  | Q5               | Q100           |
| <b>On-Site Basins</b>  |                  |                     |                  |                  |                |
| EX1                    | EX1              | 35.36               | 2%               | 5.99             | 38.94          |
| EX2                    | EX2              | 4.64                | 4%               | 1.03             | 6.07           |
| <b>TOTAL</b>           |                  | <b>40.00</b>        | <b>2%</b>        | <b>7.02</b>      | <b>45.01</b>   |
| <b>Off-Site Basins</b> |                  |                     |                  |                  |                |
| EX3                    | EX3              | 2.63                | 27%              | 2.18             | 7.47           |
| EX3B                   | EX3B             | 5.97                | 9%               | 2.14             | 14.67          |
| T3-02                  | T3-02            | 289.00              | -                | -                | 460.00         |
| T4                     | T4               | 350.00              | -                | -                | 570.00         |
| <b>TOTAL SITE</b>      |                  | <b>647.60</b>       | <b>-</b>         | <b>4.32</b>      | <b>1052.14</b> |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

| DESIGN BASIN           |      | DESIGN POINT | Roof AREA (AC) | Landscape AREA (AC) | Pavement AREA (AC) | Gravel AREA (AC) | TOTAL AREA (AC) | C(2)        | C(5)        | C(10)       | C(100)      | Imp %      |
|------------------------|------|--------------|----------------|---------------------|--------------------|------------------|-----------------|-------------|-------------|-------------|-------------|------------|
| <b>On-Site Basins</b>  |      |              |                |                     |                    |                  |                 |             |             |             |             |            |
| 1                      | 1    |              | 2.30           | 17.64               | 0.00               | 0.03             | 19.97           | 0.10        | 0.16        | 0.22        | 0.40        | 10%        |
| 2                      | 2    |              | 0.00           | 1.43                | 0.09               | 0.26             | 1.78            | 0.14        | 0.20        | 0.26        | 0.43        | 17%        |
| 3                      | 3    |              | 0.00           | 0.49                | 0.04               | 0.26             | 0.78            | 0.24        | 0.29        | 0.35        | 0.50        | 31%        |
| 4                      | 4    |              | 0.00           | 0.18                | 0.24               | 0.00             | 0.42            | 0.51        | 0.55        | 0.59        | 0.70        | 57%        |
| 5                      | 5    |              | 0.00           | 0.47                | 0.16               | 0.22             | 0.85            | 0.33        | 0.37        | 0.42        | 0.56        | 40%        |
| 6                      | 6    |              | 0.56           | 4.70                | 0.06               | 0.23             | 5.55            | 0.12        | 0.18        | 0.24        | 0.42        | 13%        |
| 7                      | 7    |              | 0.00           | 1.48                | 0.09               | 0.00             | 1.57            | 0.07        | 0.13        | 0.19        | 0.38        | 6%         |
| 8                      | 8    |              | 1.00           | 8.03                | 0.03               | 0.03             | 9.09            | 0.10        | 0.16        | 0.22        | 0.40        | 10%        |
| <b>BASIN SUBTOTAL</b>  |      |              | <b>3.86</b>    | <b>34.42</b>        | <b>0.71</b>        | <b>1.02</b>      | <b>40.00</b>    | <b>0.12</b> | <b>0.17</b> | <b>0.23</b> | <b>0.41</b> | <b>12%</b> |
| <b>Off-Site Basins</b> |      |              |                |                     |                    |                  |                 |             |             |             |             |            |
| EX3                    | EX3  |              | 0.00           | 1.93                | 0.70               | 0.00             | 2.63            | 0.25        | 0.30        | 0.35        | 0.51        | 27%        |
| EX3B                   | EX3B |              | 0.13           | 5.40                | 0.44               | 0.00             | 5.97            | 0.10        | 0.15        | 0.22        | 0.40        | 9%         |
| T3-02                  | T3   |              | -              | -                   | -                  | -                | 289             | -           | -           | -           | -           | -          |
| T4                     | T4   |              | -              | -                   | -                  | -                | 350             | -           | -           | -           | -           | -          |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.



## PROPOSED Time of Concentration

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 9/11/2024

| SUB-BASIN DATA         |             |        | INITIAL TIME (T <sub>i</sub> ) |             |                         | TRAVEL TIME (T <sub>t</sub> ) |             |                    |              |                          | T <sub>c</sub> CHECK (URBANIZED BASINS) |                   |                  |                 | FINAL T <sub>c</sub>     |      |
|------------------------|-------------|--------|--------------------------------|-------------|-------------------------|-------------------------------|-------------|--------------------|--------------|--------------------------|---|-------------------|------------------|-----------------|--------------------------|------|
| DESIGN BASIN (1)       | AREA Ac (2) | C5 (3) | LENGTH Ft (4)                  | SLOPE % (5) | T <sub>i</sub> Min. (6) | LENGTH Ft. (7)                | SLOPE % (8) | C <sub>v</sub> (9) | VEL fps (11) | T <sub>t</sub> Min. (12) | COMP. t <sub>c</sub> (13)               | TOTAL LENGTH (14) | TOTAL SLOPE (15) | TOTAL IMP. (16) | T <sub>c</sub> Min. (17) | Min. |
| <b>On-Site Basins</b>  |             |        |                                |             |                         |                               |             |                    |              |                          |   |                   |                  |                 |                          |      |
| 1                      | 19.97       | 0.16   | 300                            | 6.0%        | 16.5                    | 1,090                         | 1.1%        | 5.0                | 0.5          | 34.6                     | 51.1                                    | 1390              | 2.2%             | 10%             | 39.3                     | 39.3 |
| 2                      | 1.78        | 0.20   | 300                            | 2.5%        | 21.1                    | 1,243                         | 3.2%        | 20.0               | 3.6          | 5.8                      | 26.9                                    | 1543              | 3.1%             | 17%             | 36.1                     | 26.9 |
| 3                      | 0.78        | 0.29   | 61                             | 5.0%        | 6.8                     | 981                           | 2.9%        | 20.0               | 3.4          | 4.8                      | 11.6                                    | 1042              | 3.0%             | 31%             | 28.2                     | 11.6 |
| 4                      | 0.42        | 0.55   | 61                             | 5.0%        | 4.6                     | 477                           | 1.7%        | 20.0               | 2.6          | 3.0                      | 7.7                                     | 538               | 2.1%             | 57%             | 20.0                     | 7.7  |
| 5                      | 0.85        | 0.37   | 61                             | 5.0%        | 6.1                     | 1,056                         | 1.5%        | 20.0               | 2.4          | 7.2                      | 13.3                                    | 1117              | 1.7%             | 40%             | 29.1                     | 13.3 |
| 6                      | 5.55        | 0.18   | 300                            | 2.0%        | 23.3                    | 1,036                         | 2.0%        | 20.0               | 2.8          | 6.1                      | 29.4                                    | 1336              | 2.0%             | 13%             | 38.2                     | 29.4 |
| 7                      | 1.57        | 0.13   | 260                            | 2.0%        | 22.9                    | 5                             | 3.0%        | 5.0                | 0.9          | 0.1                      | 23.0                                    | 265               | 2.0%             | 6%              | 28.2                     | 23.0 |
| 8                      | 9.09        | 0.16   | 300                            | 4.6%        | 18.0                    | 958                           | 4.4%        | 5.0                | 1.0          | 15.2                     | 33.3                                    | 1258              | 4.4%             | 10%             | 33.7                     | 33.3 |
| <b>Off-Site Basins</b> |             |        |                                |             |                         |                               |             |                    |              |                          |   |                   |                  |                 |                          |      |
| EX3                    | 2.63        | 0.30   | 40                             | 2.5%        | 6.9                     | 1,500                         | 1.9%        | 20.0               | 2.8          | 9.1                      | 15.9                                    | 1540              | 1.9%             | 27%             | 36.1                     | 15.9 |
| EX3B                   | 5.97        | 0.15   | 20                             | 2.0%        | 6.2                     | 1,034                         | 1.5%        | 20.0               | 2.4          | 7.0                      | 13.2                                    | 1054              | 1.5%             | 9%              | 38.3                     | 13.2 |
| T3-02                  | 289         | -      | -                              | -           | -                       | -                             | -           | -                  | -            | -                        | -                                       | -                 | -                | -               | -                        | -    |
| T4                     | 350         | -      | -                              | -           | -                       | -                             | -           | -                  | -            | -                        | -                                       | -                 | -                | -               | -                        | -    |

$$t_i = \frac{0.395(1.1 - C_s)\sqrt{L_i}}{S_o^{0.33}}$$

$$t_i = \frac{L_i}{60K\sqrt{S_o}} = \frac{L_i}{60V_i}$$

$$t_i = (26 - 17i) + \frac{L_i}{60(14i + 9)\sqrt{S_o}}$$

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.



**PROPOSED  
STORM DRAINAGE DESIGN - RATIONAL METHOD 5 YEAR EVENT**

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 1.96E+08  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

P<sub>1</sub> (1-Hour Rainfall) = **1.5**

DATE: 9/11/2024

| STORM LINE             | DESIGN POINT | DIRECT RUNOFF |           |              |                      |         |           |         |                 |                      | TOTAL RUNOFF |           |         |           | STREET           |                  | PIPE      |                |             | TRAVEL TIME    |                      |  | REMARKS |
|------------------------|--------------|---------------|-----------|--------------|----------------------|---------|-----------|---------|-----------------|----------------------|--------------|-----------|---------|-----------|------------------|------------------|-----------|----------------|-------------|----------------|----------------------|--|---------|
|                        |              | DESIGN BASIN  | AREA (AC) | RUNOFF COEFF | t <sub>c</sub> (min) | C*A(ac) | I (in/hr) | Q (cfs) | Q** (Cum) (cfs) | t <sub>c</sub> (max) | S(C*A) (ac)  | I (in/hr) | Q (cfs) | SLOPE (%) | STREET FLOW(cfs) | DESIGN FLOW(cfs) | SLOPE (%) | PIPE SIZE (in) | LENGTH (ft) | VELOCITY (fps) | t <sub>t</sub> (min) |  |         |
| (1)                    | (2)          | (3)           | (4)       | (5)          | (6)                  | (7)     | (8)       | (9)     | (9B)            | (10)                 | (11)         | (12)      | (13)    | (14)      | (15)             | (16)             | (17)      | (18)           | (19)        | (20)           | (21)                 | (22)   |         |
| <b>On-Site Basins</b>  |              |               |           |              |                      |         |           |         |                 |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | 1            | 1             | 19.97     | 0.16         | 39.28                | 3.11    | 2.00      | 6.21    | <b>20.40</b>    |                      |              |           |         |           |                  |                  |           |                |             |                |                      | Cummulative Flows from All Sub-basins                  |         |
|                        | 2            | 2             | 1.78      | 0.20         | 26.92                | 0.35    | 2.51      | 0.87    | <b>11.05</b>    |                      |              |           |         |           |                  |                  |           |                |             |                |                      | Cummulative Flows from 2, 3, 4, 5, 6, 7, EX 3, EX3B    |         |
|                        | 3            | 3             | 0.78      | 0.29         | 11.60                | 0.23    | 3.82      | 0.86    | <b>0.86</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | 4            | 4             | 0.42      | 0.55         | 7.69                 | 0.23    | 4.47      | 1.03    | <b>1.03</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | 5            | 5             | 0.85      | 0.37         | 13.32                | 0.31    | 3.60      | 1.12    | <b>1.12</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | 6            | 6             | 5.55      | 0.18         | 29.41                | 0.97    | 2.38      | 2.32    | <b>9.32</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      | Cummulative Flows from 4, 5, 6, 7, EX 3, EX3B          |         |
|                        | 7            | 7             | 1.57      | 0.13         | 22.96                | 0.20    | 2.74      | 0.54    | <b>3.71</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      | Cummulative Flows from 4, 7, EX 3B                     |         |
|                        | 8            | 8             | 9.09      | 0.16         | 33.25                | 1.42    | 2.21      | 3.14    | <b>14.19</b>    |                      |              |           |         |           |                  |                  |           |                |             |                |                      | Cummulative Flows from 2, 3, 4, 5, 6, 7, 8, EX3, EX 3B |         |
| <b>Off-Site Basins</b> |              |               |           |              |                      |         |           |         |                 |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | EX3          | EX3           | 2.63      | 0.25         | 15.93                | 0.66    | 3.31      | 2.18    | <b>5.89</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      | Cummulative Flows from 4, 7, EX3B, EX3                 |         |
|                        | EX3B         | EX3B          | 5.97      | 0.10         | 13.19                | 0.59    | 3.61      | 2.14    | <b>2.14</b>     |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | T3           | T3-02         | 289       | -            | -                    | -       | -         | -       | -               |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |
|                        | T4           | T4            | 350       | -            | -                    | -       | -         | -       | -               |                      |              |           |         |           |                  |                  |           |                |             |                |                      |  |         |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

\*\*Refer to Drainage Map for cummulative flows accumulation paths



**PROPOSED  
STORM DRAINAGE DESIGN - RATIONAL METHOD 100 YEAR EVENT**

PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 1.96E+08  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 9/11/2024

P<sub>1</sub> (1-Hour Rainfall) = **2.52**

| STORM LINE             | DESIGN POINT | DIRECT RUNOFF |           |              |                      |         |           |         |                   |                      | TOTAL RUNOFF |           |         |           | STREET           |                  | PIPE      |                |             | TRAVEL TIME    |         |  | REMARKS |
|------------------------|--------------|---------------|-----------|--------------|----------------------|---------|-----------|---------|-------------------|----------------------|--------------|-----------|---------|-----------|------------------|------------------|-----------|----------------|-------------|----------------|---------|--|---------|
|                        |              | DESIGN BASIN  | AREA (AC) | RUNOFF COEFF | t <sub>c</sub> (min) | C*A(ac) | I (in/hr) | Q (cfs) | Q** (Cummm) (cfs) | t <sub>c</sub> (max) | S(C*A) (ac)  | I (in/hr) | Q (cfs) | SLOPE (%) | STREET FLOW(cfs) | DESIGN FLOW(cfs) | SLOPE (%) | PIPE SIZE (in) | LENGTH (ft) | VELOCITY (fps) | t (min) |  |         |
| (1)                    | (2)          | (3)           | (4)       | (5)          | (6)                  | (7)     | (8)       | (9)     | (9B)              | (10)                 | (11)         | (12)      | (13)    | (14)      | (15)             | (16)             | (17)      | (18)           | (19)        | (20)           | (21)    | (22)   |         |
| <b>On-Site Basins</b>  |              |               |           |              |                      |         |           |         |                   |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | 1            | 1             | 19.97     | 0.40         | 39.28                | 8.06    | 3.36      | 27.04   | 85.63             |                      |              |           |         |           |                  |                  |           |                |             |                |         | Cummulative Flows from All Sub-basins                  |         |
|                        | 2            | 2             | 1.78      | 0.43         | 26.92                | 0.77    | 4.21      | 3.24    | 44.94             |                      |              |           |         |           |                  |                  |           |                |             |                |         | Cummulative Flows from 2, 3, 4, 5, 6, 7, EX 3, EX3B    |         |
|                        | 3            | 3             | 0.78      | 0.50         | 11.60                | 0.39    | 6.42      | 2.48    | 2.48              |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | 4            | 4             | 0.42      | 0.70         | 7.69                 | 0.29    | 7.51      | 2.21    | 2.21              |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | 5            | 5             | 0.85      | 0.56         | 13.32                | 0.47    | 6.04      | 2.84    | 2.84              |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | 6            | 6             | 5.55      | 0.42         | 29.41                | 2.32    | 4.00      | 9.26    | 39.22             |                      |              |           |         |           |                  |                  |           |                |             |                |         | Cummulative Flows from 4, 5, 6, 7, EX 3, EX3B          |         |
|                        | 7            | 7             | 1.57      | 0.38         | 22.96                | 0.60    | 4.60      | 2.77    | 19.65             |                      |              |           |         |           |                  |                  |           |                |             |                |         | Cummulative Flows from 4, 7, EX 3B                     |         |
|                        | 8            | 8             | 9.09      | 0.40         | 33.25                | 3.67    | 3.72      | 13.65   | 58.59             |                      |              |           |         |           |                  |                  |           |                |             |                |         | Cummulative Flows from 2, 3, 4, 5, 6, 7, 8, EX3, EX 3B |         |
| <b>Off-Site Basins</b> |              |               |           |              |                      |         |           |         |                   |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | EX3          | EX3           | 2.63      | 0.51         | 15.93                | 1.34    | 5.56      | 7.47    | 27.12             |                      |              |           |         |           |                  |                  |           |                |             |                |         | Cummulative Flows from 4, 7, EX3B, EX3                 |         |
|                        | EX3B         | EX3B          | 5.97      | 0.40         | 13.19                | 2.42    | 6.07      | 14.67   | 14.67             |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | T3           | T3-02         | 289       | -            | -                    | -       | -         | 460     | -                 |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |
|                        | T4           | T4            | 350       | -            | -                    | -       | -         | 570     | -                 |                      |              |           |         |           |                  |                  |           |                |             |                |         |  |         |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.



PROJECT NAME: Peerless Farms  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

DATE: 9/11/2024

**PROPOSED RATIONAL CALCULATIONS SUMMARY**

| DESIGN POINT           | TRIBUTARY BASINS | TRIBUTARY AREA (AC) | IMPERVIOUSNESS % | PEAK FLOWS (CFS) |                |
|------------------------|------------------|---------------------|------------------|------------------|----------------|
|                        |                  |                     |                  | Q5               | Q100           |
| <b>On-Site Basins</b>  |                  |                     |                  |                  |                |
| 1                      | 1                | 19.97               | 10%              | 6.21             | 27.04          |
| 2                      | 2                | 1.78                | 17%              | 0.87             | 3.24           |
| 3                      | 3                | 0.78                | 31%              | 0.86             | 2.48           |
| 4                      | 4                | 0.42                | 57%              | 1.03             | 2.21           |
| 5                      | 5                | 0.85                | 40%              | 1.12             | 2.84           |
| 6                      | 6                | 5.55                | 13%              | 2.32             | 9.26           |
| 7                      | 7                | 1.57                | 6%               | 0.54             | 2.77           |
| 8                      | 8                | 9.09                | 10%              | 3.14             | 13.65          |
| <b>TOTAL</b>           |                  | <b>40.00</b>        | <b>12%</b>       | <b>16.08</b>     | <b>63.49</b>   |
| <b>Off-Site Basins</b> |                  |                     |                  |                  |                |
| EX3                    | EX3              | 2.63                | 27%              | 2.18             | 7.47           |
| EX3B                   | EX3B             | 5.97                | 9%               | 2.14             | 14.67          |
| T3-02                  | T3-02            | 289                 | -                | -                | 460.00         |
| T4                     | T4               | 350                 | -                | -                | 570.00         |
| <b>TOTAL</b>           |                  | <b>647.60</b>       | <b>-</b>         | <b>4.32</b>      | <b>1052.14</b> |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

**Design Procedure Form: Runoff Reduction**

UD-BMP (Version 3.07, March 2018)

Sheet 1 of 1

Designer: Mitchell Hess  
 Company: Kimley-Horn  
 Date: October 7, 2023  
 Project: Peerless Farms  
 Location: Proposed Public ROW

**SITE INFORMATION (User Input in Blue Cells)**

WQCV Rainfall Depth = 0.60 inches  
 Depth of Average Runoff Producing Storm,  $d_e$  = 0.43 inches (for Watersheds Outside of the Denver Region, Figure 3-1 in USDCM Vol. 3)

| Area Type                    | UIA:RPA | UIA:RPA | UIA:RPA | UIA:RPA | UIA:RPA | UIA:RPA | UIA:RPA | SPA   | UIA:RPA |  |  |
|------------------------------|---------|---------|---------|---------|---------|---------|---------|-------|---------|--|--|
| Area ID                      | A       | B       | C1      | D       | E       | F       | G       | H     | C2      |  |  |
| Downstream Design Point ID   | A       | B       | C1      | D       | E       | F       | G       | H     | C2      |  |  |
| Downstream BMP Type          | None    | None    | None    | None    | None    | None    | None    | None  | None    |  |  |
| DCIA (ft <sup>2</sup> )      | --      | --      | --      | --      | --      | --      | --      | --    | --      |  |  |
| UIA (ft <sup>2</sup> )       | 1,903   | 1,903   | 8,495   | 2,144   | 6,606   | 3,553   | 999     | --    | 1,940   |  |  |
| RPA (ft <sup>2</sup> )       | 1,189   | 1,190   | 3,770   | 1,093   | 3,013   | 538     | 122     | --    | 1,212   |  |  |
| SPA (ft <sup>2</sup> )       | --      | --      | --      | --      | --      | --      | --      | 5,523 | --      |  |  |
| HSG A (%)                    | 100%    | 100%    | 100%    | 100%    | 100%    | 100%    | 100%    | 100%  | 100%    |  |  |
| HSG B (%)                    | 0%      | 0%      | 0%      | 0%      | 0%      | 0%      | 0%      | 0%    | 0%      |  |  |
| HSG C/D (%)                  | 0%      | 0%      | 0%      | 0%      | 0%      | 0%      | 0%      | 0%    | 0%      |  |  |
| Average Slope of RPA (ft/ft) | 0.330   | 0.330   | 0.330   | 0.330   | 0.330   | 0.330   | 0.330   | --    | 0.330   |  |  |
| UIA:RPA Interface Width (ft) | 119.00  | 119.00  | 424.00  | 118.00  | 314.00  | 125.00  | 19.00   | --    | 121.00  |  |  |

**CALCULATED RUNOFF RESULTS**

| Area ID                             | A      | B      | C1     | D      | E      | F      | G      | H    | C2     |  |  |
|-------------------------------------|--------|--------|--------|--------|--------|--------|--------|------|--------|--|--|
| UIA:RPA Area (ft <sup>2</sup> )     | 3,092  | 3,093  | 12,265 | 3,237  | 9,619  | 4,091  | 1,121  | --   | 3,152  |  |  |
| L / W Ratio                         | 0.22   | 0.22   | 0.07   | 0.23   | 0.10   | 0.26   | 3.11   | --   | 0.22   |  |  |
| UIA / Area                          | 0.6155 | 0.6153 | 0.6926 | 0.6623 | 0.6868 | 0.8685 | 0.8912 | --   | 0.6155 |  |  |
| Runoff (in)                         | 0.00   | 0.00   | 0.00   | 0.00   | 0.00   | 0.15   | 0.20   | 0.00 | 0.00   |  |  |
| Runoff (ft <sup>3</sup> )           | 0      | 0      | 0      | 0      | 0      | 52     | 18     | 0    | 0      |  |  |
| Runoff Reduction (ft <sup>3</sup> ) | 79     | 79     | 354    | 89     | 275    | 96     | 23     | 276  | 81     |  |  |

**CALCULATED WQCV RESULTS**

| Area ID                           | A    | B    | C1   | D    | E    | F   | G   | H  | C2   |  |  |
|-----------------------------------|------|------|------|------|------|-----|-----|----|------|--|--|
| WQCV (ft <sup>3</sup> )           | 79   | 79   | 354  | 89   | 275  | 148 | 42  | 0  | 81   |  |  |
| WQCV Reduction (ft <sup>3</sup> ) | 79   | 79   | 354  | 89   | 275  | 96  | 23  | 0  | 81   |  |  |
| WQCV Reduction (%)                | 100% | 100% | 100% | 100% | 100% | 65% | 56% | 0% | 100% |  |  |
| Untreated WQCV (ft <sup>3</sup> ) | 0    | 0    | 0    | 0    | 0    | 52  | 18  | 0  | 0    |  |  |

**CALCULATED DESIGN POINT RESULTS (sums results from all columns with the same Downstream Design Point ID)**

| Downstream Design Point ID               | A     | B     | C1     | D     | E     | F     | G     | H     | C2    |  |  |
|--|-------|-------|--------|-------|-------|-------|-------|-------|-------|--|--|
| DCIA (ft <sup>2</sup> )                  | 0     | 0     | 0      | 0     | 0     | 0     | 0     | 0     | 0     |  |  |
| UIA (ft <sup>2</sup> )                   | 1,903 | 1,903 | 8,495  | 2,144 | 6,606 | 3,553 | 999   | 0     | 1,940 |  |  |
| RPA (ft <sup>2</sup> )                   | 1,189 | 1,190 | 3,770  | 1,093 | 3,013 | 538   | 122   | 0     | 1,212 |  |  |
| SPA (ft <sup>2</sup> )                   | 0     | 0     | 0      | 0     | 0     | 0     | 0     | 5,523 | 0     |  |  |
| Total Area (ft <sup>2</sup> )            | 3,092 | 3,093 | 12,265 | 3,237 | 9,619 | 4,091 | 1,121 | 5,523 | 3,152 |  |  |
| Total Impervious Area (ft <sup>2</sup> ) | 1,903 | 1,903 | 8,495  | 2,144 | 6,606 | 3,553 | 999   | 0     | 1,940 |  |  |
| WQCV (ft <sup>3</sup> )                  | 79    | 79    | 354    | 89    | 275   | 148   | 42    | 0     | 81    |  |  |
| WQCV Reduction (ft <sup>3</sup> )        | 79    | 79    | 354    | 89    | 275   | 96    | 23    | 0     | 81    |  |  |
| WQCV Reduction (%)                       | 100%  | 100%  | 100%   | 100%  | 100%  | 65%   | 56%   | 0%    | 100%  |  |  |
| Untreated WQCV (ft <sup>3</sup> )        | 0     | 0     | 0      | 0     | 0     | 52    | 18    | 0     | 0     |  |  |

**CALCULATED SITE RESULTS (sums results from all columns in worksheet)**

|  |        |
|--|--------|
| Total Area (ft <sup>2</sup> )            | 45,193 |
| Total Impervious Area (ft <sup>2</sup> ) | 27,543 |
| WQCV (ft <sup>3</sup> )                  | 1,148  |
| WQCV Reduction (ft <sup>3</sup> )        | 1,077  |
| WQCV Reduction (%)                       | 94%    |
| Untreated WQCV (ft <sup>3</sup> )        | 71     |



***APPENDIX D - HYDRAULIC CALCULATIONS***

## Worksheet for Culvert 1

| Project Description         |                     |
|-----------------------------|---------------------|
| Friction Method             | Manning Formula     |
| Solve For                   | Normal Depth        |
| Input Data                  |                     |
| Roughness Coefficient       | 0.013               |
| Channel Slope               | 0.005 ft/ft         |
| Diameter                    | 18.0 in             |
| Discharge                   | 2.21 cfs            |
| Results                     |                     |
| Normal Depth                | 6.7 in              |
| Flow Area                   | 0.6 ft <sup>2</sup> |
| Wetted Perimeter            | 2.0 ft              |
| Hydraulic Radius            | 3.7 in              |
| Top Width                   | 1.45 ft             |
| Critical Depth              | 6.7 in              |
| Percent Full                | 37.4 %              |
| Critical Slope              | 0.005 ft/ft         |
| Velocity                    | 3.67 ft/s           |
| Velocity Head               | 0.21 ft             |
| Specific Energy             | 0.77 ft             |
| Froude Number               | 1.003               |
| Maximum Discharge           | 7.99 cfs            |
| Discharge Full              | 7.43 cfs            |
| Slope Full                  | 0.000 ft/ft         |
| Flow Type                   | Supercritical       |
| GVF Input Data              |                     |
| Downstream Depth            | 0.0 in              |
| Length                      | 0.0 ft              |
| Number Of Steps             | 0                   |
| GVF Output Data             |                     |
| Upstream Depth              | 0.0 in              |
| Profile Description         | N/A                 |
| Profile Headloss            | 0.00 ft             |
| Average End Depth Over Rise | 0.0 %               |
| Normal Depth Over Rise      | 37.4 %              |
| Downstream Velocity         | Infinity ft/s       |
| Upstream Velocity           | Infinity ft/s       |
| Normal Depth                | 6.7 in              |
| Critical Depth              | 6.7 in              |
| Channel Slope               | 0.005 ft/ft         |
| Critical Slope              | 0.005 ft/ft         |

## Worksheet for Culvert 1

Notes:

Flows from Sub-Basin 4.

## Worksheet for Culvert 2

| Project Description         |                     |
|-----------------------------|---------------------|
| Friction Method             | Manning Formula     |
| Solve For                   | Normal Depth        |
| Input Data                  |                     |
| Roughness Coefficient       | 0.013               |
| Channel Slope               | 0.005 ft/ft         |
| Diameter                    | 18.0 in             |
| Discharge                   | 2.84 cfs            |
| Results                     |                     |
| Normal Depth                | 7.7 in              |
| Flow Area                   | 0.7 ft <sup>2</sup> |
| Wetted Perimeter            | 2.1 ft              |
| Hydraulic Radius            | 4.1 in              |
| Top Width                   | 1.48 ft             |
| Critical Depth              | 7.7 in              |
| Percent Full                | 42.9 %              |
| Critical Slope              | 0.005 ft/ft         |
| Velocity                    | 3.92 ft/s           |
| Velocity Head               | 0.24 ft             |
| Specific Energy             | 0.88 ft             |
| Froude Number               | 0.991               |
| Maximum Discharge           | 7.99 cfs            |
| Discharge Full              | 7.43 cfs            |
| Slope Full                  | 0.001 ft/ft         |
| Flow Type                   | Subcritical         |
| GVF Input Data              |                     |
| Downstream Depth            | 0.0 in              |
| Length                      | 0.0 ft              |
| Number Of Steps             | 0                   |
| GVF Output Data             |                     |
| Upstream Depth              | 0.0 in              |
| Profile Description         | N/A                 |
| Profile Headloss            | 0.00 ft             |
| Average End Depth Over Rise | 0.0 %               |
| Normal Depth Over Rise      | 55.2 %              |
| Downstream Velocity         | Infinity ft/s       |
| Upstream Velocity           | Infinity ft/s       |
| Normal Depth                | 7.7 in              |
| Critical Depth              | 7.7 in              |
| Channel Slope               | 0.005 ft/ft         |
| Critical Slope              | 0.005 ft/ft         |

## Worksheet for Culvert 2

Notes:

Flows from Sub-Basin 5.

## Worksheet for Culvert 3

| Project Description         |                     |
|-----------------------------|---------------------|
| Friction Method             | Manning Formula     |
| Solve For                   | Normal Depth        |
| Input Data                  |                     |
| Roughness Coefficient       | 0.013               |
| Channel Slope               | 0.005 ft/ft         |
| Diameter                    | 24.0 in             |
| Discharge                   | 14.31 cfs           |
| Results                     |                     |
| Normal Depth                | 17.7 in             |
| Flow Area                   | 2.5 ft <sup>2</sup> |
| Wetted Perimeter            | 4.1 ft              |
| Hydraulic Radius            | 7.2 in              |
| Top Width                   | 1.76 ft             |
| Critical Depth              | 16.4 in             |
| Percent Full                | 73.8 %              |
| Critical Slope              | 0.006 ft/ft         |
| Velocity                    | 5.76 ft/s           |
| Velocity Head               | 0.52 ft             |
| Specific Energy             | 1.99 ft             |
| Froude Number               | 0.854               |
| Maximum Discharge           | 17.21 cfs           |
| Discharge Full              | 16.00 cfs           |
| Slope Full                  | 0.004 ft/ft         |
| Flow Type                   | Subcritical         |
| GVF Input Data              |                     |
| Downstream Depth            | 0.0 in              |
| Length                      | 0.0 ft              |
| Number Of Steps             | 0                   |
| GVF Output Data             |                     |
| Upstream Depth              | 0.0 in              |
| Profile Description         | N/A                 |
| Profile Headloss            | 0.00 ft             |
| Average End Depth Over Rise | 0.0 %               |
| Normal Depth Over Rise      | 55.2 %              |
| Downstream Velocity         | Infinity ft/s       |
| Upstream Velocity           | Infinity ft/s       |
| Normal Depth                | 17.7 in             |
| Critical Depth              | 16.4 in             |
| Channel Slope               | 0.005 ft/ft         |
| Critical Slope              | 0.006 ft/ft         |

## Worksheet for Culvert 3

Notes:

Flows from Sub-Basin 4, 5, and 6.

## Worksheet for Culvert 4

| Project Description         |                     |
|-----------------------------|---------------------|
| Friction Method             | Manning<br>Formula  |
| Solve For                   | Normal Depth        |
| Input Data                  |                     |
| Roughness Coefficient       | 0.013               |
| Channel Slope               | 0.005 ft/ft         |
| Diameter                    | 18.0 in             |
| Discharge                   | 2.48 cfs            |
| Results                     |                     |
| Normal Depth                | 7.2 in              |
| Flow Area                   | 0.7 ft <sup>2</sup> |
| Wetted Perimeter            | 2.0 ft              |
| Hydraulic Radius            | 3.8 in              |
| Top Width                   | 1.47 ft             |
| Critical Depth              | 7.2 in              |
| Percent Full                | 39.8 %              |
| Critical Slope              | 0.005 ft/ft         |
| Velocity                    | 3.78 ft/s           |
| Velocity Head               | 0.22 ft             |
| Specific Energy             | 0.82 ft             |
| Froude Number               | 0.998               |
| Maximum Discharge           | 7.99 cfs            |
| Discharge Full              | 7.43 cfs            |
| Slope Full                  | 0.001 ft/ft         |
| Flow Type                   | Subcritical         |
| GVF Input Data              |                     |
| Downstream Depth            | 0.0 in              |
| Length                      | 0.0 ft              |
| Number Of Steps             | 0                   |
| GVF Output Data             |                     |
| Upstream Depth              | 0.0 in              |
| Profile Description         | N/A                 |
| Profile Headloss            | 0.00 ft             |
| Average End Depth Over Rise | 0.0 %               |
| Normal Depth Over Rise      | 55.2 %              |
| Downstream Velocity         | Infinity ft/s       |
| Upstream Velocity           | Infinity ft/s       |
| Normal Depth                | 7.2 in              |
| Critical Depth              | 7.2 in              |
| Channel Slope               | 0.005 ft/ft         |
| Critical Slope              | 0.005 ft/ft         |



## Worksheet for Culvert 4

Notes:

Flows from Sub-Basin 3

## Worksheet for Culvert 5

| Project Description         |                     |
|-----------------------------|---------------------|
| Friction Method             | Manning<br>Formula  |
| Solve For                   | Normal Depth        |
| Input Data                  |                     |
| Roughness Coefficient       | 0.013               |
| Channel Slope               | 0.005 ft/ft         |
| Rise                        | 1.6 ft              |
| Span                        | 2.5 ft              |
| Discharge                   | 14.67 cfs           |
| Results                     |                     |
| Normal Depth                | 14.4 in             |
| Flow Area                   | 2.5 ft <sup>2</sup> |
| Wetted Perimeter            | 4.1 ft              |
| Hydraulic Radius            | 7.3 in              |
| Top Width                   | 2.14 ft             |
| Critical Depth              | 14.0 in             |
| Percent Full                | 75.8 %              |
| Critical Slope              | 0.005 ft/ft         |
| Velocity                    | 5.81 ft/s           |
| Velocity Head               | 0.53 ft             |
| Specific Energy             | 1.72 ft             |
| Froude Number               | 0.944               |
| Maximum Discharge           | 16.39 cfs           |
| Discharge Full              | 15.33 cfs           |
| Slope Full                  | 0.005 ft/ft         |
| Flow Type                   | Subcritical         |
| GVF Input Data              |                     |
| Downstream Depth            | 0.0 in              |
| Length                      | 0.0 ft              |
| Number Of Steps             | 0                   |
| GVF Output Data             |                     |
| Upstream Depth              | 0.0 in              |
| Profile Description         | N/A                 |
| Profile Headloss            | 0.00 ft             |
| Average End Depth Over Rise | 0.0 %               |
| Normal Depth Over Rise      | 0.0 %               |
| Downstream Velocity         | 0.00 ft/s           |
| Upstream Velocity           | 0.00 ft/s           |
| Normal Depth                | 14.4 in             |
| Critical Depth              | 14.0 in             |
| Channel Slope               | 0.005 ft/ft         |
| Critical Slope              | 0.005 ft/ft         |

## Worksheet for Culvert 5

Notes:

Flows from Sub-Basin EX3B. Pipe is a 24" elliptical pipe (19"x30").

### Sub-Basin 2 - Ditch (Low)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.010 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Bottom Width          | 4.00 ft             |
| Discharge             | 5.72 cfs            |
| Results               |                     |
| Normal Depth          | 5.1 in              |
| Flow Area             | 2.4 ft <sup>2</sup> |
| Wetted Perimeter      | 7.5 ft              |
| Hydraulic Radius      | 3.9 in              |
| Top Width             | 7.42 ft             |
| Critical Depth        | 4.2 in              |
| Critical Slope        | 0.020 ft/ft         |
| Velocity              | 2.34 ft/s           |
| Velocity Head         | 0.09 ft             |
| Specific Energy       | 0.51 ft             |
| Froude Number         | 0.719               |
| Flow Type             | Subcritical         |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | 0.00 ft/s           |
| Upstream Velocity     | 0.00 ft/s           |
| Normal Depth          | 5.1 in              |
| Critical Depth        | 4.2 in              |
| Channel Slope         | 0.010 ft/ft         |
| Critical Slope        | 0.020 ft/ft         |

Notes:

Flows from Sub-Basin 2 and 3.

## Sub-Basin 2 - Ditch (High)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.063 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Bottom Width          | 4.00 ft             |
| Discharge             | 5.72 cfs            |
| Results               |                     |
| Normal Depth          | 3.1 in              |
| Flow Area             | 1.3 ft <sup>2</sup> |
| Wetted Perimeter      | 6.1 ft              |
| Hydraulic Radius      | 2.5 in              |
| Top Width             | 6.06 ft             |
| Critical Depth        | 4.2 in              |
| Critical Slope        | 0.020 ft/ft         |
| Velocity              | 4.41 ft/s           |
| Velocity Head         | 0.30 ft             |
| Specific Energy       | 0.56 ft             |
| Froude Number         | 1.683               |
| Flow Type             | Supercritical       |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 3.1 in              |
| Critical Depth        | 4.2 in              |
| Channel Slope         | 0.063 ft/ft         |
| Critical Slope        | 0.020 ft/ft         |

Notes:

Flows from Sub-Basin 2 and 3.

### Sub-Basin 3 - Ditch (Low)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.010 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Discharge             | 2.48 cfs            |
| Results               |                     |
| Normal Depth          | 6.6 in              |
| Flow Area             | 1.2 ft <sup>2</sup> |
| Wetted Perimeter      | 4.5 ft              |
| Hydraulic Radius      | 3.2 in              |
| Top Width             | 4.40 ft             |
| Critical Depth        | 5.7 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 2.05 ft/s           |
| Velocity Head         | 0.07 ft             |
| Specific Energy       | 0.62 ft             |
| Froude Number         | 0.691               |
| Flow Type             | Subcritical         |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 6.6 in              |
| Critical Depth        | 5.7 in              |
| Channel Slope         | 0.010 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |



Notes:

Flows from Sub-Basin 3.

### Sub-Basin 3 - Ditch (High)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.045 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Discharge             | 2.48 cfs            |
| Results               |                     |
| Normal Depth          | 5.0 in              |
| Flow Area             | 0.7 ft <sup>2</sup> |
| Wetted Perimeter      | 3.4 ft              |
| Hydraulic Radius      | 2.4 in              |
| Top Width             | 3.32 ft             |
| Critical Depth        | 5.7 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 3.61 ft/s           |
| Velocity Head         | 0.20 ft             |
| Specific Energy       | 0.62 ft             |
| Froude Number         | 1.397               |
| Flow Type             | Supercritical       |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 5.0 in              |
| Critical Depth        | 5.7 in              |
| Channel Slope         | 0.045 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |

Notes:

Flows from Sub-Basin 3.

### Sub-Basin 4 - Ditch (Low)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.005 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 3.260 H:V           |
| Discharge             | 2.21 cfs            |
| Results               |                     |
| Normal Depth          | 7.5 in              |
| Flow Area             | 1.4 ft <sup>2</sup> |
| Wetted Perimeter      | 4.7 ft              |
| Hydraulic Radius      | 3.6 in              |
| Top Width             | 4.52 ft             |
| Critical Depth        | 5.6 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 1.57 ft/s           |
| Velocity Head         | 0.04 ft             |
| Specific Energy       | 0.66 ft             |
| Froude Number         | 0.496               |
| Flow Type             | Subcritical         |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 7.5 in              |
| Critical Depth        | 5.6 in              |
| Channel Slope         | 0.005 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |

Notes:

Flows from Sub-Basin 4.

### Sub-Basin 4 - Ditch (High)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning             |
|                       | Formula             |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.030 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 3.260 H:V           |
| Discharge             | 2.21 cfs            |
| Results               |                     |
| Normal Depth          | 5.3 in              |
| Flow Area             | 0.7 ft <sup>2</sup> |
| Wetted Perimeter      | 3.4 ft              |
| Hydraulic Radius      | 2.6 in              |
| Top Width             | 3.23 ft             |
| Critical Depth        | 5.6 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 3.07 ft/s           |
| Velocity Head         | 0.15 ft             |
| Specific Energy       | 0.59 ft             |
| Froude Number         | 1.148               |
| Flow Type             | Supercritical       |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 5.3 in              |
| Critical Depth        | 5.6 in              |
| Channel Slope         | 0.030 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |

Notes:

Flows from Sub-Basin 4.

### Sub-Basin 5 - Ditch (Low)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning             |
|                       | Formula             |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.005 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Discharge             | 2.84 cfs            |
| Results               |                     |
| Normal Depth          | 7.9 in              |
| Flow Area             | 1.7 ft <sup>2</sup> |
| Wetted Perimeter      | 5.4 ft              |
| Hydraulic Radius      | 3.8 in              |
| Top Width             | 5.27 ft             |
| Critical Depth        | 6.0 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 1.64 ft/s           |
| Velocity Head         | 0.04 ft             |
| Specific Energy       | 0.70 ft             |
| Froude Number         | 0.503               |
| Flow Type             | Subcritical         |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 7.9 in              |
| Critical Depth        | 6.0 in              |
| Channel Slope         | 0.005 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |



Notes:

Flows from Sub-Basin 5.

### Sub-Basin 5 - Ditch (High)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.050 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Discharge             | 2.84 cfs            |
| Results               |                     |
| Normal Depth          | 5.1 in              |
| Flow Area             | 0.7 ft <sup>2</sup> |
| Wetted Perimeter      | 3.5 ft              |
| Hydraulic Radius      | 2.5 in              |
| Top Width             | 3.42 ft             |
| Critical Depth        | 6.0 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 3.88 ft/s           |
| Velocity Head         | 0.23 ft             |
| Specific Energy       | 0.66 ft             |
| Froude Number         | 1.480               |
| Flow Type             | Supercritical       |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 5.1 in              |
| Critical Depth        | 6.0 in              |
| Channel Slope         | 0.050 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |

Notes:

Flows from Sub-Basin 5.

### Sub-Basin 6 - Ditch (Low)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.005 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Bottom Width          | 4.00 ft             |
| Discharge             | 14.31 cfs           |
| Results               |                     |
| Normal Depth          | 9.9 in              |
| Flow Area             | 6.0 ft <sup>2</sup> |
| Wetted Perimeter      | 10.8 ft             |
| Hydraulic Radius      | 6.7 in              |
| Top Width             | 10.61 ft            |
| Critical Depth        | 7.2 in              |
| Critical Slope        | 0.018 ft/ft         |
| Velocity              | 2.37 ft/s           |
| Velocity Head         | 0.09 ft             |
| Specific Energy       | 0.91 ft             |
| Froude Number         | 0.555               |
| Flow Type             | Subcritical         |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | 0.00 ft/s           |
| Upstream Velocity     | 0.00 ft/s           |
| Normal Depth          | 9.9 in              |
| Critical Depth        | 7.2 in              |
| Channel Slope         | 0.005 ft/ft         |
| Critical Slope        | 0.018 ft/ft         |

Notes:

Flows from Sub-Basin 4, 5 and 6.

### Sub-Basin 6 - Ditch (High)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.067 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Bottom Width          | 4.00 ft             |
| Discharge             | 14.31 cfs           |
| Results               |                     |
| Normal Depth          | 5.0 in              |
| Flow Area             | 2.4 ft <sup>2</sup> |
| Wetted Perimeter      | 7.5 ft              |
| Hydraulic Radius      | 3.8 in              |
| Top Width             | 7.36 ft             |
| Critical Depth        | 7.2 in              |
| Critical Slope        | 0.018 ft/ft         |
| Velocity              | 6.00 ft/s           |
| Velocity Head         | 0.56 ft             |
| Specific Energy       | 0.98 ft             |
| Froude Number         | 1.856               |
| Flow Type             | Supercritical       |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 5.0 in              |
| Critical Depth        | 7.2 in              |
| Channel Slope         | 0.067 ft/ft         |
| Critical Slope        | 0.018 ft/ft         |

Notes:

Flows from Sub-Basin 4, 5 and 6.

### Sub-Basin 7 - Ditch (Low)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.005 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Discharge             | 2.77 cfs            |
| Results               |                     |
| Normal Depth          | 7.8 in              |
| Flow Area             | 1.7 ft <sup>2</sup> |
| Wetted Perimeter      | 5.4 ft              |
| Hydraulic Radius      | 3.8 in              |
| Top Width             | 5.22 ft             |
| Critical Depth        | 5.9 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 1.63 ft/s           |
| Velocity Head         | 0.04 ft             |
| Specific Energy       | 0.69 ft             |
| Froude Number         | 0.502               |
| Flow Type             | Subcritical         |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 7.8 in              |
| Critical Depth        | 5.9 in              |
| Channel Slope         | 0.005 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |



Notes:

Flows from Sub-Basin 7.

### Sub-Basin 7 - Ditch (High)

| Project Description   |                     |
|-----------------------|---------------------|
| Friction Method       | Manning Formula     |
| Solve For             | Normal Depth        |
| Input Data            |                     |
| Roughness Coefficient | 0.030               |
| Channel Slope         | 0.040 ft/ft         |
| Left Side Slope       | 4.000 H:V           |
| Right Side Slope      | 4.000 H:V           |
| Discharge             | 2.77 cfs            |
| Results               |                     |
| Normal Depth          | 5.3 in              |
| Flow Area             | 0.8 ft <sup>2</sup> |
| Wetted Perimeter      | 3.6 ft              |
| Hydraulic Radius      | 2.6 in              |
| Top Width             | 3.53 ft             |
| Critical Depth        | 5.9 in              |
| Critical Slope        | 0.022 ft/ft         |
| Velocity              | 3.55 ft/s           |
| Velocity Head         | 0.20 ft             |
| Specific Energy       | 0.64 ft             |
| Froude Number         | 1.331               |
| Flow Type             | Supercritical       |
| GVF Input Data        |                     |
| Downstream Depth      | 0.0 in              |
| Length                | 0.0 ft              |
| Number Of Steps       | 0                   |
| GVF Output Data       |                     |
| Upstream Depth        | 0.0 in              |
| Profile Description   | N/A                 |
| Profile Headloss      | 0.00 ft             |
| Downstream Velocity   | Infinity ft/s       |
| Upstream Velocity     | Infinity ft/s       |
| Normal Depth          | 5.3 in              |
| Critical Depth        | 5.9 in              |
| Channel Slope         | 0.040 ft/ft         |
| Critical Slope        | 0.022 ft/ft         |

Notes:

Flows from Sub-Basin 7.

### Rip-Rap Calculation

Culvert 100-Year Outflow

Riprap Apron N4.1

Applicable Equations:

|  |                         |
|--|-------------------------|
| $L_p = (1/2 \tan \theta)(A_i Y_i - D)$               | Equation 9-11 per USDCM |
| $A_t = Q/V$  | Equation 9-12 per USDCM |
| $\theta = \tan^{-1}(1/(2 * \text{ExpansionFactor}))$ | Equation 9-13 per USDCM |
| $W = 2(L_p \tan \theta) + D$                         | Equation 9-14 per USDCM |
| $T = 2D_{50}$  | Equation 9-15 per USDCM |

Assumptions

Input parameters:

| Description   | Variable                    | Input   | Unit        |
|---|-----------------------------|---------|-------------|
| Width of the conduit (use diameter for circular conduits),        | D:                          | 2.00    | ft          |
| HGL Elevation   |                             | 6567.93 | ft          |
| Invert Elevation  |                             | 6566.45 | ft          |
| Tailwater depth (ft),   | $Y_i$ :                     | 0.89    | ft          |
| Expansion angle of the culvert flow                               | $\theta$ :                  | 0.09    | radians     |
| Design discharge (cfs)*   | Q:                          | 14.31   | cfs         |
| Froude Number   | $F_r$                       | 0.85    | Subcritical |
| Unitless Variables for Tables:                                    |                             |         |             |
|   | For Figure 9-35 $Q/D^{2.5}$ | 2.53    |             |
|   | For Figure 9-35 $Y_i/D$     | 0.45    |             |
|   | For Figure 9-38 $Q/D^{1.5}$ | 5.06    |             |
|   | For Figure 9-38 $Y_i/D$     | 0.45    |             |
| Allowable non-eroding velocity in the downstream channel (ft/sec) | V:                          | 7       | ft/sec      |
| Expansion Factor (Figure 9-35), $1/(2 \tan(\theta))$              |                             | 5.85    |             |

Solve for:

| Description   | Variable                  | Output | Unit            |
|---|---------------------------|--------|-----------------|
| 1. Required area of flow at allowable velocity (ft <sup>2</sup> ) | $A_i$ :                   | 2.04   | ft <sup>2</sup> |
| 2. Length of Protection   | $L_p$ :                   | 1.71   | ft              |
|   | $L_p < 3D$ ?              | Yes    |                 |
|   | $L_p > 10D$ ?             | No     |                 |
|   | $L_p > 10D$ & $F_r > 6$ ? | No     |                 |
|   | $L_{pmin}$ :              | 6.00   | ft              |
| 3. Width of downstream riprap protection                          | W:                        | 3.00   | ft              |
| 4. Rip Rap Type (Figure 9-38)                                     | -                         | L      |                 |
| 5. Rip Rap Size (Figure 8-34)                                     | $D_{50}$ :                | 9      | inches          |

Rip Rap Summary

|           |           |      |        |
|-----------|-----------|------|--------|
| Length    | $L_p$     | 6.00 | ft     |
| Width     | $W_{min}$ | 3.00 | ft     |
| Size      | $D_{50}$  | 9    | inches |
| Type      | -         | L    |        |
| Thickness | T         | 18   | inches |

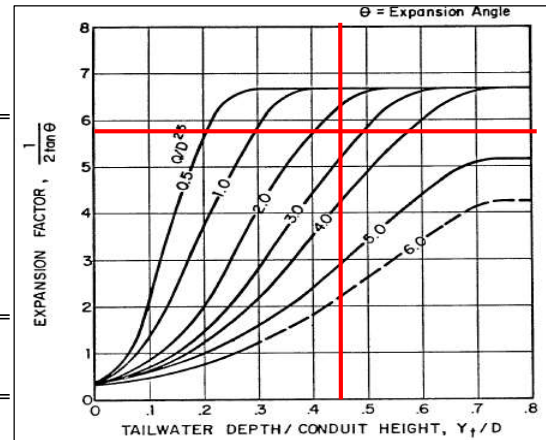


Figure 9-35. Expansion factor for circular conduits


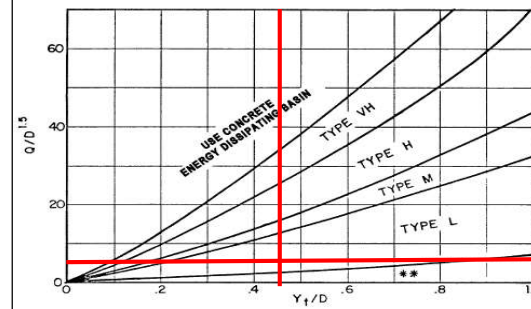


Figure 9-38. Riprap erosion protection at circular conduit outlet (valid for  $Q/D_{2.5} \leq 6.0$ )

| RIPRAP DESIGNATION | % SMALLER THAN GIVEN SIZE BY WEIGHT | INTERMEDIATE ROCK DIMENSION (INCHES) | $D_{50}^*$ (INCHES) |
|--------------------|-------------------------------------|--------------------------------------|---------------------|
| TYPE VL            | 70 - 100                            | 12                                   | 6                   |
|                    | 50 - 70                             | 9                                    |                     |
|                    | 35 - 50                             | 6                                    |                     |
|                    | 2 - 10                              | 2                                    |                     |
| TYPE L             | 70 - 100                            | 15                                   | 9                   |
|                    | 50 - 70                             | 12                                   |                     |
|                    | 35 - 50                             | 9                                    |                     |
|                    | 2 - 10                              | 3                                    |                     |
| TYPE M             | 70 - 100                            | 21                                   | 12                  |
|                    | 50 - 70                             | 18                                   |                     |
|                    | 35 - 50                             | 12                                   |                     |
|                    | 2 - 10                              | 4                                    |                     |
| TYPE H             | 70 - 100                            | 30                                   | 18                  |
|                    | 50 - 70                             | 24                                   |                     |
|                    | 35 - 50                             | 18                                   |                     |
|                    | 2 - 10                              | 6                                    |                     |

\* $D_{50}$  = MEAN ROCK SIZE

Figure 8-34. Riprap and soil riprap placement and gradation (part 1 of 3)

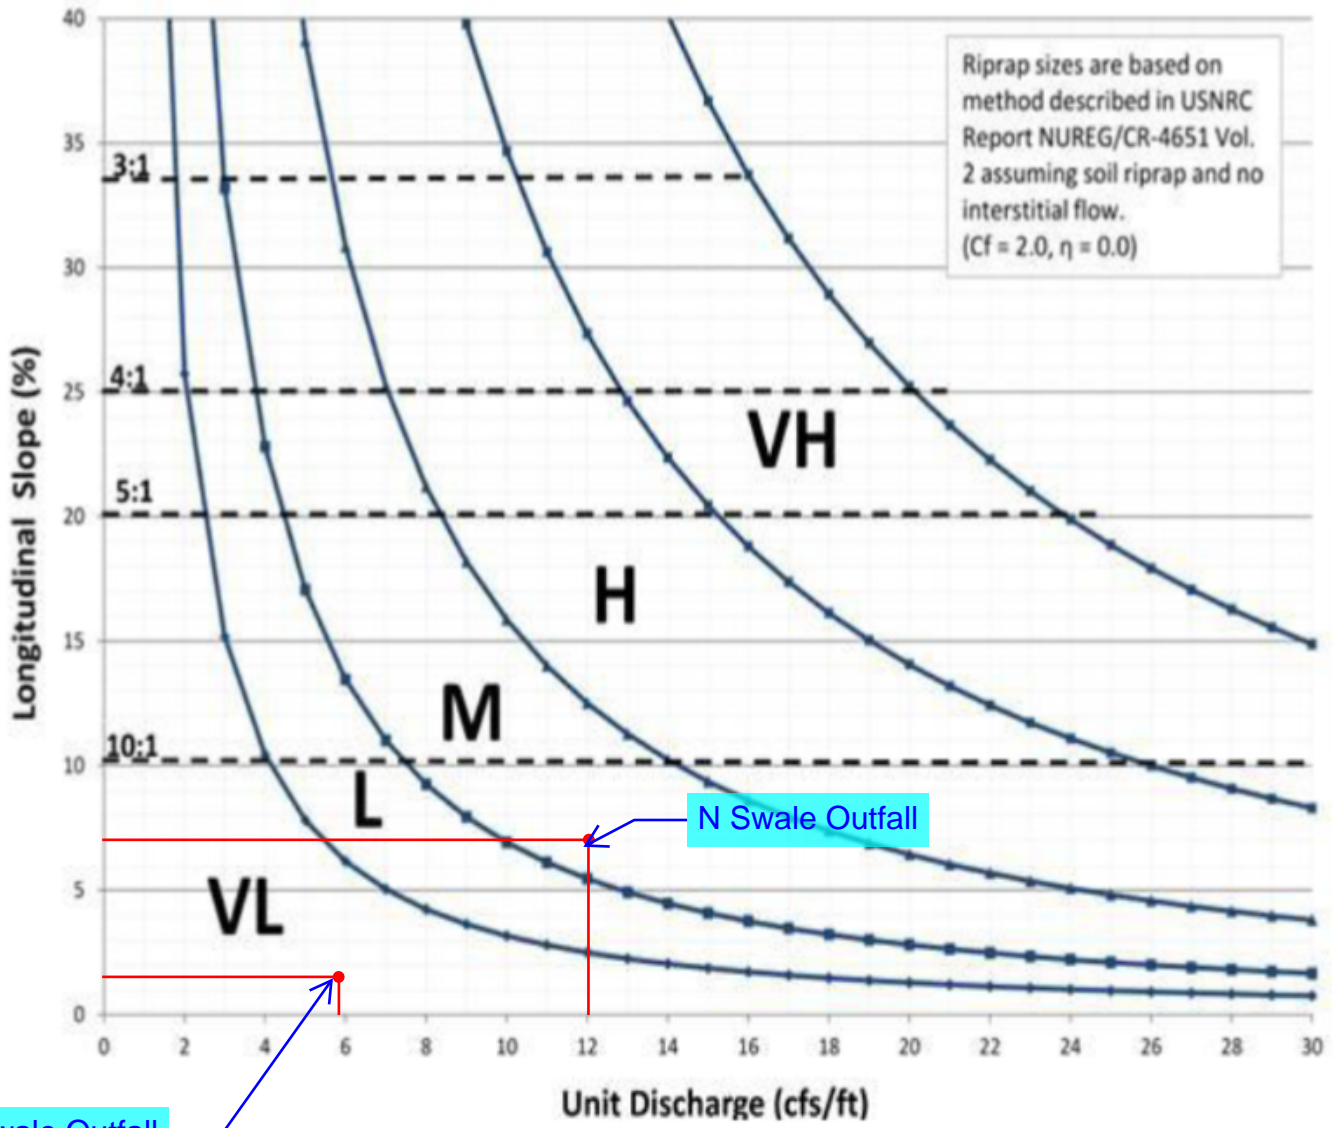

## Worksheet for Drainage Channel (DBPS Full Build-Out 100-Year Storm)

|                            |                 |
|----------------------------|-----------------|
| <b>Project Description</b> |                 |
| Friction Method            | Manning Formula |
| Solve For                  | Normal Depth    |
| <b>Input Data</b>          |                 |
| Channel Slope              | 0.025 ft/ft     |
| Discharge                  | 1,030.00 cfs    |

### Section Definitions

| Station (ft) | Elevation (ft) |
|--------------|----------------|
| 0+00         | 42.66          |
| 0+37         | 41.58          |
| 0+88         | 38.53          |
| 1+05         | 38.53          |
| 1+18         | 38.03          |
| 1+48         | 38.03          |
| 1+62         | 39.64          |
| 1+82         | 40.22          |
| 2+66         | 40.27          |
| 3+12         | 41.91          |

### Roughness Segment Definitions

| Start Station | Ending Station | Roughness Coefficient |
|---------------|----------------|-----------------------|
| (0+00, 42.66) | (3+12, 41.91)  | 0.050                 |

#### Options

|                                   |                     |
|-----------------------------------|---------------------|
| Current Roughness Weighted Method | Pavlovskii's Method |
| Open Channel Weighting Method     | Pavlovskii's Method |
| Closed Channel Weighting Method   | Pavlovskii's Method |

#### Results

|                       |                       |
|-----------------------|-----------------------|
| Normal Depth          | 29.3 in               |
| Roughness Coefficient | 0.050                 |
| Elevation             | 40.47 ft              |
| Elevation Range       | 38.0 to 42.7 ft       |
| Flow Area             | 218.0 ft <sup>2</sup> |
| Wetted Perimeter      | 216.1 ft              |
| Hydraulic Radius      | 12.1 in               |
| Top Width             | 215.93 ft             |
| Normal Depth          | 29.3 in               |
| Critical Depth        | 25.3 in               |
| Critical Slope        | 0.033 ft/ft           |
| Velocity              | 4.73 ft/s             |
| Velocity Head         | 0.35 ft               |
| Specific Energy       | 2.79 ft               |

## Worksheet for Drainage Channel (DBPS Full Build-Out 100-Year Storm)

| Results             |               |
|---------------------|---------------|
| Froude Number       | 0.829         |
| Flow Type           | Subcritical   |
| GVF Input Data      |               |
| Downstream Depth    | 0.0 in        |
| Length              | 0.0 ft        |
| Number Of Steps     | 0             |
| GVF Output Data     |               |
| Upstream Depth      | 0.0 in        |
| Profile Description | N/A           |
| Profile Headloss    | 0.00 ft       |
| Downstream Velocity | Infinity ft/s |
| Upstream Velocity   | Infinity ft/s |
| Normal Depth        | 29.3 in       |
| Critical Depth      | 25.3 in       |
| Channel Slope       | 0.025 ft/ft   |
| Critical Slope      | 0.033 ft/ft   |

## Cross Section for Drainage Channel (DBPS Full Build-Out 100-Year Storm)

---

**Project Description**

---

|                 |              |
|-----------------|--------------|
| Friction Method | Manning      |
|                 | Formula      |
| Solve For       | Normal Depth |


---

**Input Data**

---

|               |              |
|---------------|--------------|
| Channel Slope | 0.025 ft/ft  |
| Normal Depth  | 29.3 in      |
| Discharge     | 1,030.00 cfs |

---

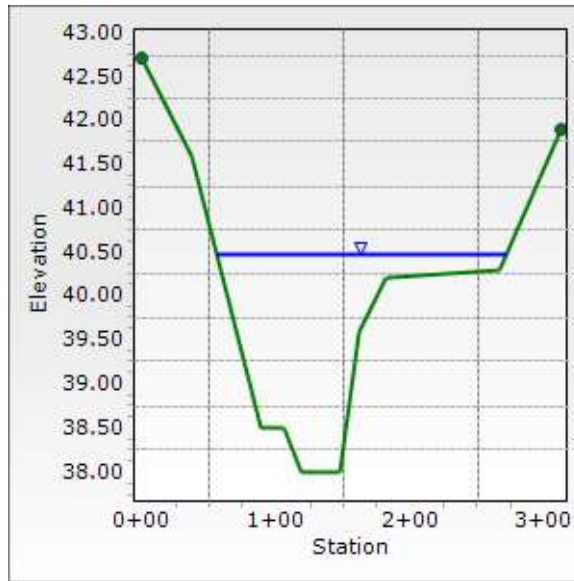



## Worksheet for Drainage Channel (DBPS Full Build-Out + Peerless Development 100-Year Storm)

| Project Description |                 |
|---------------------|-----------------|
| Friction Method     | Manning Formula |
| Solve For           | Normal Depth    |

---

| Input Data    |              |
|---------------|--------------|
| Channel Slope | 0.025 ft/ft  |
| Discharge     | 1,048.48 cfs |

### Section Definitions

| Station (ft) | Elevation (ft) |
|--------------|----------------|
| 0+00         | 42.66          |
| 0+37         | 41.58          |
| 0+88         | 38.53          |
| 1+05         | 38.53          |
| 1+18         | 38.03          |
| 1+48         | 38.03          |
| 1+62         | 39.64          |
| 1+82         | 40.22          |
| 2+66         | 40.27          |
| 3+12         | 41.91          |

### Roughness Segment Definitions

| Start Station | Ending Station | Roughness Coefficient |
|---------------|----------------|-----------------------|
| (0+00, 42.66) | (3+12, 41.91)  | 0.050                 |

| Options                           |                     |
|-----------------------------------|---------------------|
| Current Roughness Weighted Method | Pavlovskii's Method |
| Open Channel Weighting Method     | Pavlovskii's Method |
| Closed Channel Weighting Method   | Pavlovskii's Method |

| Results               |                       |
|-----------------------|-----------------------|
| Normal Depth          | 29.4 in               |
| Roughness Coefficient | 0.050                 |
| Elevation             | 40.48 ft              |
| Elevation Range       | 38.0 to 42.7 ft       |
| Flow Area             | 220.5 ft <sup>2</sup> |
| Wetted Perimeter      | 216.6 ft              |
| Hydraulic Radius      | 12.2 in               |
| Top Width             | 216.47 ft             |
| Normal Depth          | 29.4 in               |
| Critical Depth        | 27.9 in               |
| Critical Slope        | 0.038 ft/ft           |
| Velocity              | 4.75 ft/s             |
| Velocity Head         | 0.35 ft               |
| Specific Energy       | 2.80 ft               |

## Worksheet for Drainage Channel (DBPS Full Build-Out + Peerless Development 100-Year Storm)

---

Results

|               |             |
|---------------|-------------|
| Froude Number | 0.830       |
| Flow Type     | Subcritical |

---

GVF Input Data

|                  |        |
|------------------|--------|
| Downstream Depth | 0.0 in |
| Length           | 0.0 ft |
| Number Of Steps  | 0      |

---

GVF Output Data

|                     |               |
|---------------------|---------------|
| Upstream Depth      | 0.0 in        |
| Profile Description | N/A           |
| Profile Headloss    | 0.00 ft       |
| Downstream Velocity | Infinity ft/s |
| Upstream Velocity   | Infinity ft/s |
| Normal Depth        | 29.4 in       |
| Critical Depth      | 27.9 in       |
| Channel Slope       | 0.025 ft/ft   |
| Critical Slope      | 0.038 ft/ft   |

---

## Cross Section for Drainage Channel (DBPS Full Build-Out + Peerless Development 100-Year Storm)

---

Project Description

---

|                 |              |
|-----------------|--------------|
| Friction Method | Manning      |
|                 | Formula      |
| Solve For       | Normal Depth |


---

Input Data

---

|               |              |
|---------------|--------------|
| Channel Slope | 0.025 ft/ft  |
| Normal Depth  | 29.4 in      |
| Discharge     | 1,048.48 cfs |

---

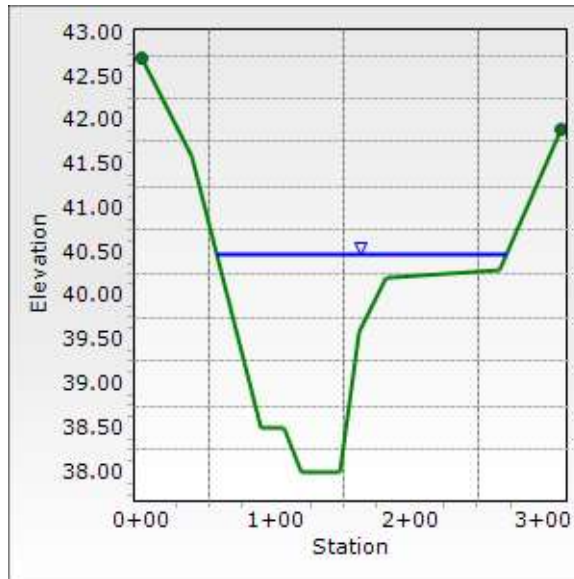

***APPENDIX E – EOPCC AND TEMPORARY SEDIMENT BASIN STANDARD DETAIL***



Kimley-Horn & Associates, Inc.

Opinion of Probable Construction Cost

|  |                         |
|--|-------------------------|
| <b>Client:</b> Robert S. Williams                  | <b>Date:</b> 9/12/2024  |
| <b>Project:</b> Peerless Farms, El Paso County, CO | <b>Prepared By:</b> GMP |
| <b>KHA No.:</b> 196114000                          | <b>Checked By:</b> MOH  |

|                      |
|----------------------|
| <b>Sheet:</b> 1 of 1 |
|----------------------|

This OPC is not intended for basing financial decisions, or securing funding. Review all notes and assumptions. Since Kimley-Horn & Associates, Inc. has no control over the cost of labor, materials, equipment, or services furnished by others, or over methods of determining price, or over competitive bidding or market conditions, any and all opinions as to the cost herein, including but not limited to opinions as to the costs of construction materials, shall be made on the basis of experience and best available data. Kimley-Horn & Associates, Inc. cannot and does not guarantee that proposals, bids, or actual costs will not vary from the opinions on costs shown herein. The total costs and other numbers in this Opinion of Probable Cost have been rounded.

| Item No.                              | Item Description                  | Quantity | Unit | Unit Price | Item Cost       |
|---------------------------------------|-----------------------------------|----------|------|------------|-----------------|
| <b>Storm Sewer (Non-Reimbursible)</b> |                                   |          |      |            |                 |
| 1                                     | 18" RCP Storm Pipe                | 90       | LF   | \$82.00    | \$7,380         |
| 2                                     | 19"x30" Elliptical RCP Storm Pipe | 47       | LF   | \$100.00   | \$4,700         |
| 3                                     | 18" FES                           | 6        | EA   | \$490.20   | \$2,941         |
| 4                                     | 24" FES                           | 4        | EA   | \$586.95   | \$2,348         |
| 5                                     | 19"x30" FES                       | 2        | EA   | \$586.95   | \$1,174         |
| 6                                     | Riprap, d50 (Varies)              | 31       | Ton  | \$104.00   | \$3,266         |
| 7                                     | 24" RCP Storm Pipe                | 27       | LF   | \$95.00    | \$2,565         |
| Subtotal:                             |                                   |          |      |            | \$24,374        |
| Contingency (%,+/-)                   |                                   |          |      | 10%        | \$2,437         |
| <b>Project Total:</b>                 |                                   |          |      |            | <b>\$26,811</b> |

**Basis for Cost Projection:**

- No Design Completed
- Preliminary Design
- Final Design

Design Engineer:



Mitchell O. Hess  
Registered Professional Engineer, State of Colorado No. 53916

Refer to EPC 2024 Financial Assurance Estimate Form for Additional information.

# TEMPORARY SEDIMENT BASIN

## TSB



## 1.0 DESCRIPTION

- Temporary sediment basins are small impoundments of water with a small outlet structure built on a construction site.

## 2.0 PURPOSE

- Used to capture and slowly release runoff prior to discharge from a construction site to allow sediment to settle out.

## 3.0 IMPLEMENTATION


- Temporary sediment basins for drainage areas larger than 15 acres must be individually designed by engineer.
- Erosion and other sediment controls should be implemented upstream of temporary sediment basins.

## 4.0 TIMING



- Install prior to upstream land disturbance.
- Remove temporary sediment basin after upstream area has been stabilized. Permanently stabilize area after basin has been removed.

## 5.0 MAINTENANCE


- Remove sediment from basin as needed to maintain the effectiveness of the temporary sediment basin. This is typically when sediment depth reaches one foot.
- Inspect sediment basin embankments for stability and seepage.
- Inspect the inlet and outlet of the basin, repair damage, and remove debris.

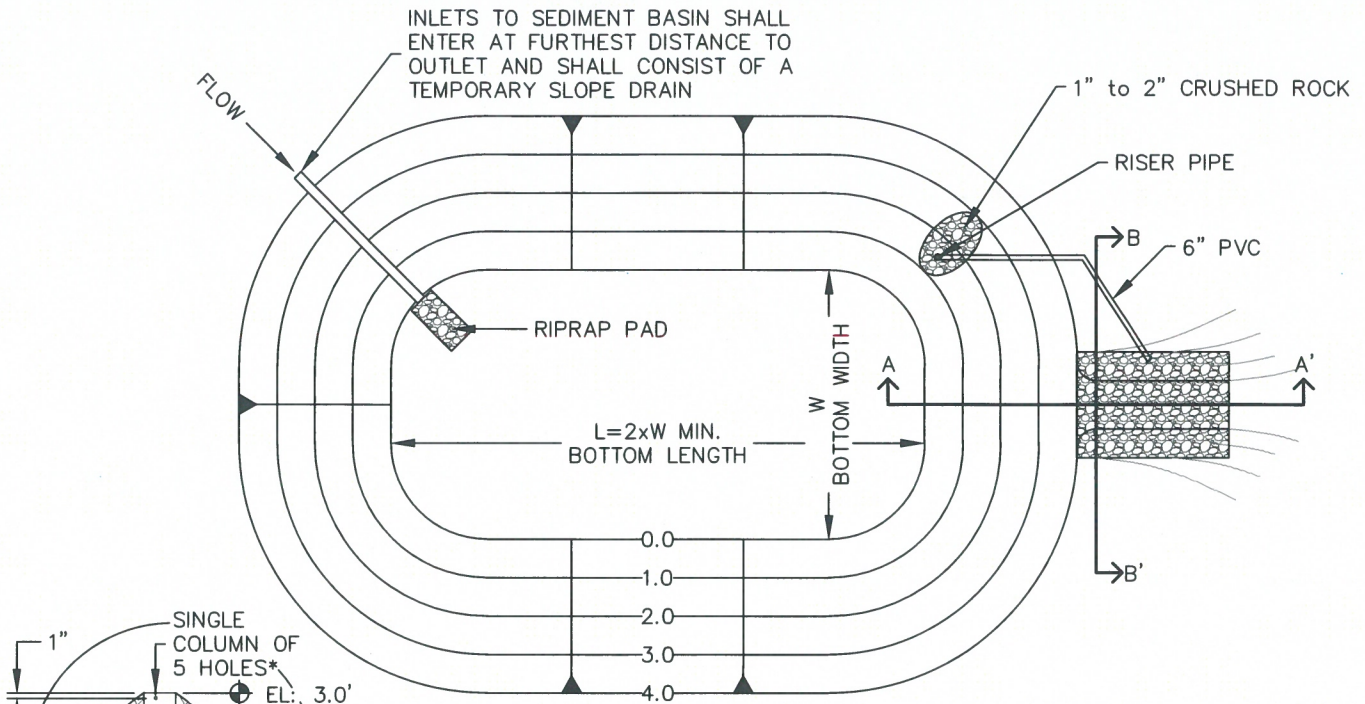

**SEDIMENT BASIN PLAN**

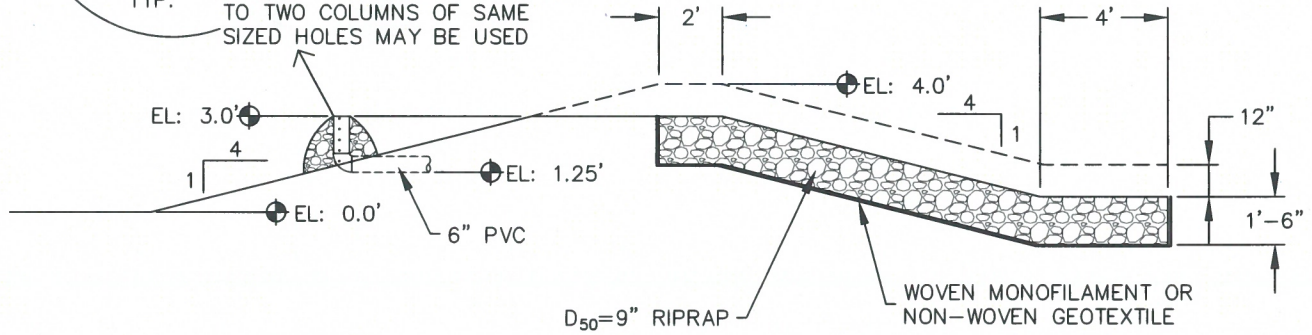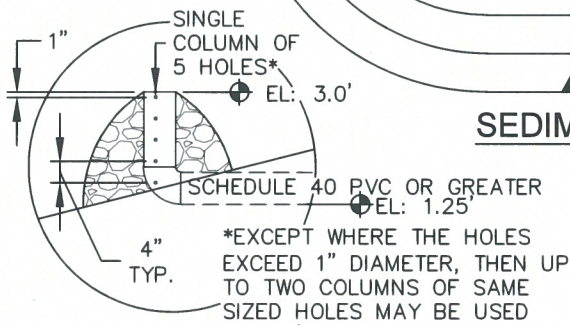


**SECTION A-A'**

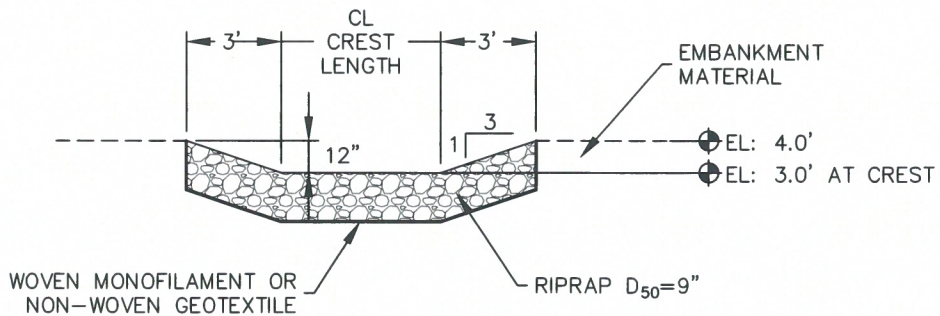

**SECTION B-B'**



**TEMPORARY  
SEDIMENT BASIN**

APPROVED:   
SWENT MANAGER

|                    |                       |                          |
|--------------------|-----------------------|--------------------------|
| ISSUED:<br>10/7/19 | REVISED:<br>8/19/2020 | DRAWING NO.<br>900-TSB-1 |
|--------------------|-----------------------|--------------------------|



TABLE SB-1, SIZING INFORMATION FOR STANDARD SEDIMENT BASIN

| UPSTREAM DRAINAGE AREA (ROUNDED TO NEAREST ACRE), (AC) | BASIN BOTTOM WIDTH (W), (FT) | SPILLWAY CREST LENGTH (CL), (FT) | HOLE DIAMETER (HD), (IN) |
|--|------------------------------|----------------------------------|--------------------------|
| 1  | 12½"                         | 2                                | 9/32                     |
| 2  | 21                           | 3                                | 13/16                    |
| 3  | 28                           | 5                                | ½                        |
| 4  | 33½                          | 6                                | 9/16                     |
| 5  | 38½                          | 8                                | 2½/32                    |
| 6  | 43                           | 9                                | 2½/32                    |
| 7  | 47¼                          | 11                               | 25/32                    |
| 8  | 51                           | 12                               | 27/32                    |
| 9  | 55                           | 13                               | 7/8                      |
| 10   | 58¼                          | 15                               | 15/16                    |
| 11   | 61                           | 16                               | 3½/32                    |
| 12   | 64                           | 18                               | 1                        |
| 13   | 67½                          | 19                               | 1¼/6                     |
| 14   | 70½                          | 21                               | 1½/8                     |
| 15   | 73¼                          | 22                               | 1¾/6                     |

INSTALLATION NOTES

- FOR STANDARD BASIN, BOTTOM DIMENSION MAY BE MODIFIED AS LONG AS BOTTOM AREA IS NOT REDUCED.
- EMBANKMENT MATERIAL SHALL CONSIST OF SOIL FREE OF DEBRIS, ORGANIC MATERIAL, AND ROCKS OR CONCRETE GREATER THAN 3 INCHES, AND SHALL HAVE A MINIMUM OF 15 PERCENT BY WEIGHT PASSING THE No. 200 SIEVE
- EMBANKMENT MATERIAL SHALL BE COMPACTED TO AT LEAST 95 PERCENT OF MAXIMUM DENSITY IN ACCORDANCE WITH ASTM D-698.
- PIPE SCHEDULE 40 OR GREATER SHALL BE USED.
- THE DETAILS SHOWN ON THESE SHEETS PERTAIN TO STANDARD SEDIMENT BASIN(S) FOR DRAINAGE AREAS LESS THAN 15 ACRES. SEE CONSTRUCTION DRAWINGS FOR EMBANKMENT, STORAGE VOLUME, SPILLWAY, OUTLET, AND OUTLET PROTECTION DETAILS FOR ANY SEDIMENT BASIN(S) THAT HAVE BEEN INDIVIDUALLY DESIGNED FOR DRAINAGE AREAS LARGER THAN 15 ACRES. DESIGN CALCULATIONS MUST BE APPROVED PRIOR TO IMPLEMENTATION.

MAINTENANCE NOTES

- FREQUENT OBSERVATIONS AND MAINTENANCE ARE NECESSARY TO MAINTAIN CONTROL MEASURES IN EFFECTIVE OPERATING CONDITION. INSPECTIONS AND CORRECTIVE MEASURES SHOULD BE DOCUMENTED THOROUGHLY.
- SEDIMENT ACCUMULATED IN BASIN SHALL BE REMOVED AS NEEDED TO MAINTAIN CONTROL MEASURE EFFECTIVENESS, TYPICALLY WHEN SEDIMENT DEPTH REACHES ONE FOOT (I.E. TWO FEET BELOW SPILLWAY CREST).
- SEDIMENT BASINS ARE TO REMAIN IN PLACE UNTIL THE UPSTREAM DISTURBED AREA IS PERMANENTLY STABILIZED.
- PERMANENTLY STABILIZE AREA AFTER SEDIMENT BASIN REMOVAL.



|   |                       |                          |
|---|-----------------------|--------------------------|
| <b>TEMPORARY<br/>SEDIMENT BASIN</b>   |                       |                          |
| APPROVED:  |                       |                          |
| SWENT MANAGER   |                       |                          |
| ISSUED:<br>10/7/19  | REVISED:<br>8/19/2020 | DRAWING NO.<br>900-TSB-2 |

***APPENDIX F – UNNAMED DRAINAGEWAY PHOTOGRAPHS***



**Figure 1: Storm Drain Culver Beneath Falcon Highway**



**Figure 2: Looking East Towards the Unnamed Drainageway**



**Figure 3: Looking East Towards the Unnamed Drainageway**



**Figure 4: Looking North Towards Falcon Highway**



**Figure 5: Looking Southeast at the Unnamed Drainageway**



**Figure 6: Unnamed Drainageway**



**Figure 7: Looking North at the Unnamed Drainageway**



**Figure 8: Looking East at the Unnamed Drainageway at the South End of the Site**



**Figure 9: Looking North toward the Proposed Site Entrance (Ditch Flows West)**



**Figure 10: Looking South from the Proposed Site Entrance (Ditch Flows West)**

***APPENDIX G – EXCERPTS FROM DBPS***



**Table 6-5 Regional Detention Pond Summary**

| Pond  | Volume (AF) | Peak Inflow (cfs) |        | Peak Outflow (cfs) |        |
|-------|-------------|-------------------|--------|--------------------|--------|
|       |             | 2-yr              | 100-yr | 2-yr               | 100-yr |
| RG-01 | 9.02        | 100               | 320    | 11                 | 63     |
| RG-02 | 170         | 600               | 4800   | 150                | 2200   |
| RG-03 | 0.04        | 3                 | 70     | 2                  | 9      |
| RG-04 | 1.07        | 19                | 140    | 1                  | 55     |
| RG-05 | 0.03        | 12                | 120    | 11                 | 3      |

For the 100-year peak flow, flood impacts downstream from the regional detention pond will not increase.

**6.3.1.1. Channels**

Channels upstream of the regional detention ponds need to be sized for the future undetained 100-year peak flow rates from development, while culverts and channels downstream of regional ponds are sized for the existing 100-year peak flow rates. Proposed channel improvements along the corresponding reaches are summarized in Table 6-6.

**Table 6-6 Channel Designs for Regional Detention Alternative**

| Channel             | Existing 100-yr Flow (cfs) | Proposed 100-yr Flow (cfs) | Design Flow (cfs) | Channel Length (ft) | Material |
|---------------------|----------------------------|----------------------------|-------------------|---------------------|----------|
| Main Stem (MS-04)   | 1700                       | 3400                       | 3500              | 7140                | Riprap   |
| Main Stem (MS-05)   | 1500                       | 3000                       | 3000              | 11100               | Grass    |
| Main Stem (MS-06)   | 590                        | 890                        | 900               | 7330                | Grass    |
| Main Stem (MS-06)   | 660                        | 930                        | 1000              | 3170                | Grass    |
| Main Stem (MS-06)   | 720                        | 1500                       | 1500              | 4450                | Grass    |
| Main Stem (MS-06)   | 750                        | 1600                       | 2000              | 3330                | Grass    |
| Tributary 3 (T3-01) | 720                        | 1500                       | 1500              | 10710               | Grass    |
| Tributary 4 (T4)    | 200                        | 570                        | 600               | 1840                | Grass    |
| Tributary 5 (T5)    | 150                        | 240                        | 300               | 930                 | Grass    |
| Tributary 5 (T5)    | 270                        | 410                        | 500               | 7770                | Grass    |
| Tributary 6 (T6)    | 200                        | 440                        | 500               | 4270                | Grass    |
| Tributary 6 (T6)    | 240                        | 570                        | 600               | 3940                | Grass    |

**6.3.1.2. Culverts**

As with the channels, culverts upstream of a regional detention pond need to be sized for the future undetained 100-year peak flow rates, while culverts and channels downstream are sized for the existing 100-year peak flow rates. Proposed culvert improvements along the corresponding reaches are summarized in Table 6-7 for the Regional Detention Alternative.

**Table 6-7 Culvert Designs for Regional Detention**

| Facility Number | Road Crossing                | Channel             | Existing Size   | Proposed 100-yr Flow (cfs) | Deficiency  | Necessary Facility for Proposed 100-year Flow |
|-----------------|------------------------------|---------------------|-----------------|----------------------------|-------------|---|
| 405             | Murr Road                    | Main Stem (MS-04)   | 66" RCP         | 3,400                      | Overtops    | 6-10'X6' RCBs                                 |
| 507             | Peerless Farms Road          | Tributary 3 (T3-01) | 60" CMP         | 1200                       | Overtops    | 2-10'X6' RCBs                                 |
| 609             | Falcon Highway               | Tributary 3 (T3-02) | 18" CMP         | 460                        | Overtops    | 2-66" RCPs                                    |
| 610             | Falcon Highway               | Tributary 4 (T4)    | 24" CMP         | 570                        | Overtops    | 2-72" RCPs                                    |
| 612             | Falcon Highway               | Tributary 5 (T5)    | 24" CMP         | 240                        | Overtops    | 72" RCP                                       |
| 628             | Falcon Highway               | Main Stem (MS-05)   | 2-60" CMPs      | 2,200                      | Overtops    | 4-10'X6' RCBs                                 |
| 702             | Curtis Road                  | Tributary 6 (T6)    | 36" CMP         | 140                        | Overtops    | 60" RCP                                       |
| 703             | Curtis Road                  | Main Stem (MS-06)   | 24" CMP         | 890                        | Overtops    | 2-8'X6' RCBs                                  |
| 704             | Judge Orr Road               | Main Stem (MS-06)   | Blocked Culvert | 830                        | Overtops    | 2-8'X6' RCBs                                  |
| 1001            | Future Pastura Street        | Main Stem (MS-06)   | N/A             | 930                        | Future Road | 2-8'X6' RCBs                                  |
| 1002            | Future Arroyo Hondo Blvd. N. | Main Stem (MS-06)   | N/A             | 930                        | Future Road | 2-8'X6' RCBs                                  |
| 1003            | Future Arroyo Hondo Blvd. S. | Main Stem (MS-06)   | N/A             | 1500                       | Future Road | 3-8'X6' RCBs                                  |
| 1004            | Future Pastura Street        | Tributary 6 (T6)    | N/A             | 440                        | Future Road | 2-66" RCPs                                    |
| 1005            | Future El Vado Road          | Tributary 6 (T6)    | N/A             | 440                        | Future Road | 2-66" RCPs                                    |
| 1006            | Future Socorro Trail         | Tributary 6 (T6)    | N/A             | 440                        | Future Road | 2-66" RCPs                                    |


Note: Changes recommended to other culverts under existing conditions still apply

**6.3.2. Subregional Detention**

For this alternative, subregional detention ponds are located and sized to address development as it will occur. Locations of proposed subregional detention ponds are shown in Figure 6-2 and are summarized in Table 6-8. A connectivity diagram for the sub-regional HEC-HMS model is shown in Figure 6-3.

***APPENDIX H – DRAINAGE EXHIBITS***

K:\COS\_LA\196114000 - Peerless Farms\CADD\Exhibits\Existing Drainage Map.dwg

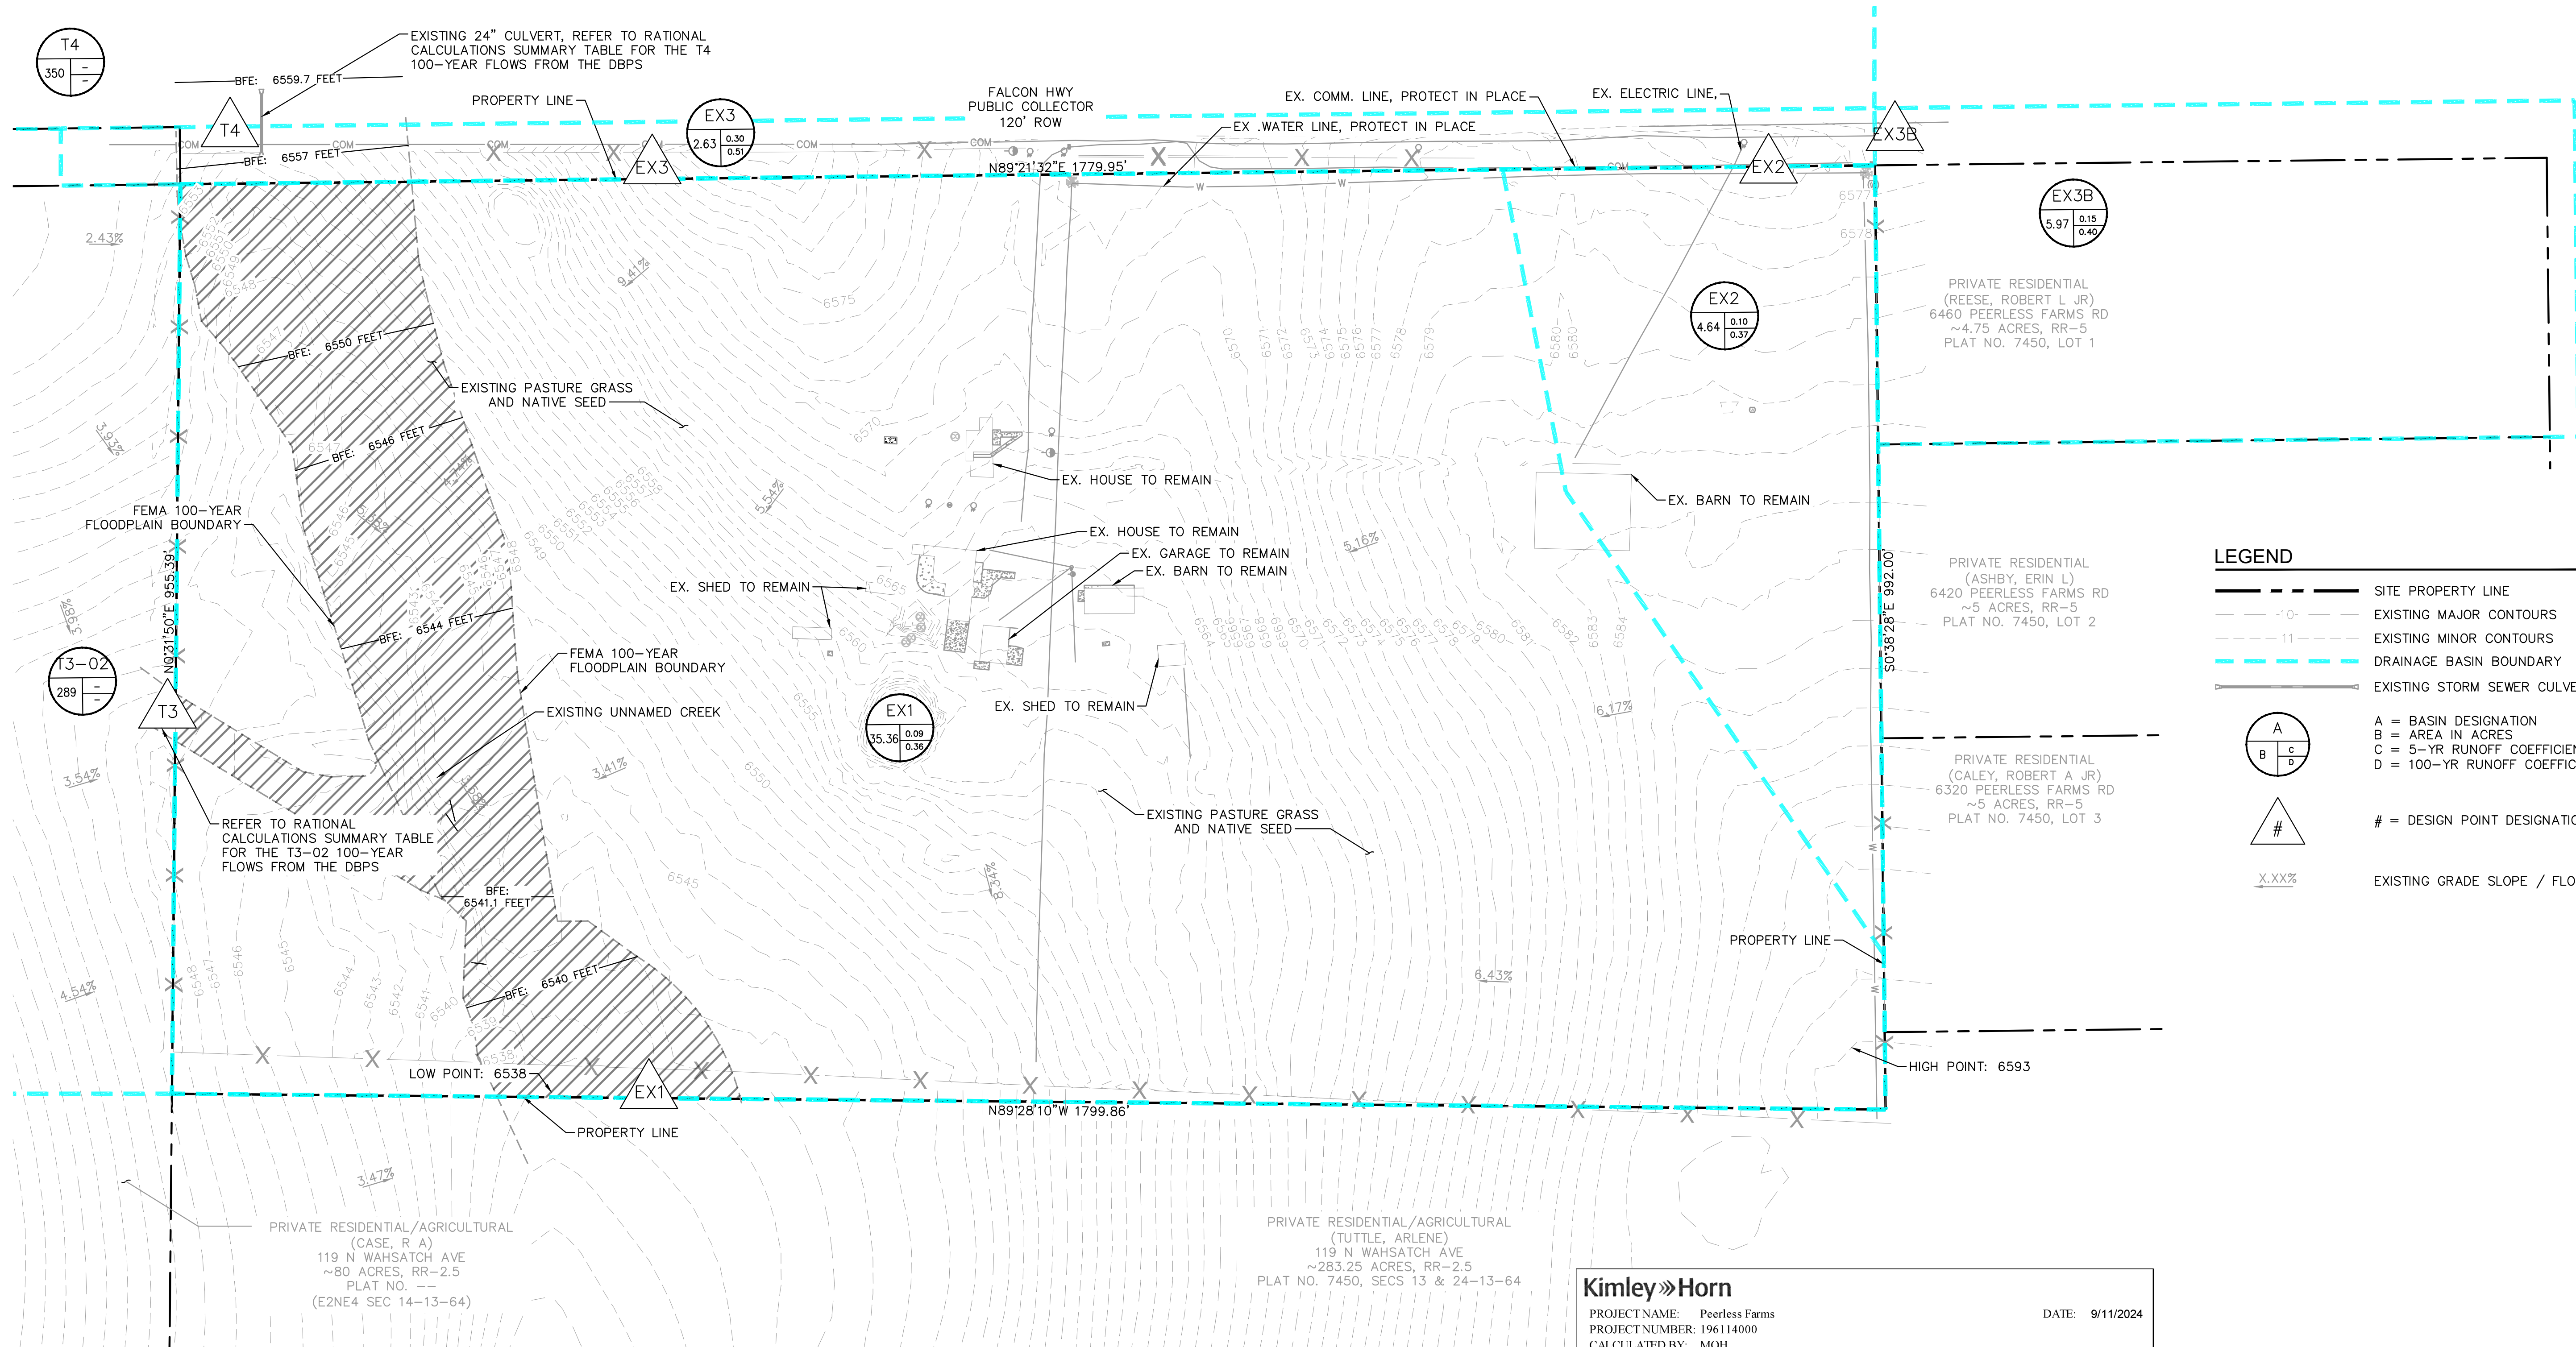

**LEGEND**

- SITE PROPERTY LINE
- EXISTING MAJOR CONTOURS
- EXISTING MINOR CONTOURS
- DRAINAGE BASIN BOUNDARY
- EXISTING STORM SEWER CULVERT
- A = BASIN DESIGNATION  
B = AREA IN ACRES  
C = 5-YR RUNOFF COEFFICIENT  
D = 100-YR RUNOFF COEFFICIENT
- # = DESIGN POINT DESIGNATION
- EXISTING GRADE SLOPE / FLOW DIRECTION


- NOTES:**
- OFF-SITE SUB-BASINS T3-02 AND T4 ARE TRIBUTARY AREAS TO THE UNNAMED DRAINAGEWAY WHICH ARE DOCUMENTED IN THE HAEGLER RANCH DBPS. 5 AND 100-YR RUNOFF COEFFICIENTS ARE UNKNOWN FOR THESE AREAS, BUT 100-YEAR FLOWS FOR T3-02 AND T4 AFTER FULL BUILD-OUT OF THE DRAINAGE BASIN ARE EXPECTED TO BE 460 CFS AND 570 CFS, RESPECTIVELY (REFER TO TABLE 6-7 FROM THE DBPS).
  - Offsite areas not included in survey, but estimated based on aerial imagery for drainage calculations.

**Kimley»Horn**

PROJECT NAME: Peerless Farms DATE: 9/11/2024  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

| EXISTING RATIONAL CALCULATIONS SUMMARY |                  |                     |                  |                  |                |
|--|------------------|---------------------|------------------|------------------|----------------|
| DESIGN POINT                           | TRIBUTARY BASINS | TRIBUTARY AREA (AC) | IMPERVIOUSNESS % | PEAK FLOWS (CFS) |                |
|  |                  |                     |                  | Q5               | Q100           |
| <b>On-Site Basins</b>                  |                  |                     |                  |                  |                |
| EX1                                    | EX1              | 35.36               | 2%               | 5.99             | 38.94          |
| EX2                                    | EX2              | 4.64                | 4%               | 1.03             | 6.07           |
| <b>TOTAL</b>                           |                  | <b>40.00</b>        | <b>2%</b>        | <b>7.02</b>      | <b>45.01</b>   |
| <b>Off-Site Basins</b>                 |                  |                     |                  |                  |                |
| EX3                                    | EX3              | 2.63                | 27%              | 2.18             | 7.47           |
| EX3B                                   | EX3B             | 5.97                | 9%               | 2.14             | 14.67          |
| T3-02                                  | T3-02            | 289.00              | -                | -                | 460.00         |
| T4                                     | T4               | 350.00              | -                | -                | 570.00         |
| <b>TOTAL SITE</b>                      |                  | <b>647.60</b>       | <b>-</b>         | <b>4.32</b>      | <b>1052.14</b> |


\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

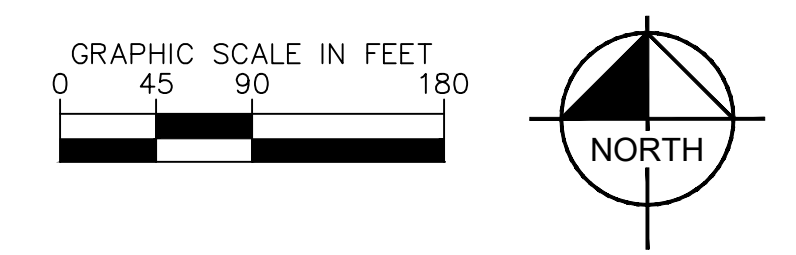

EXISTING DRAINAGE MAP  
 PEERLESS FARMS  
 09/11/2024

**Kimley»Horn**

© 2024 KIMLEY-HORN AND ASSOCIATES, INC.  
 2 N NEVADA AVE., SUITE 900, COLORADO SPRINGS, 80903  
 PHONE: 719-453-0180

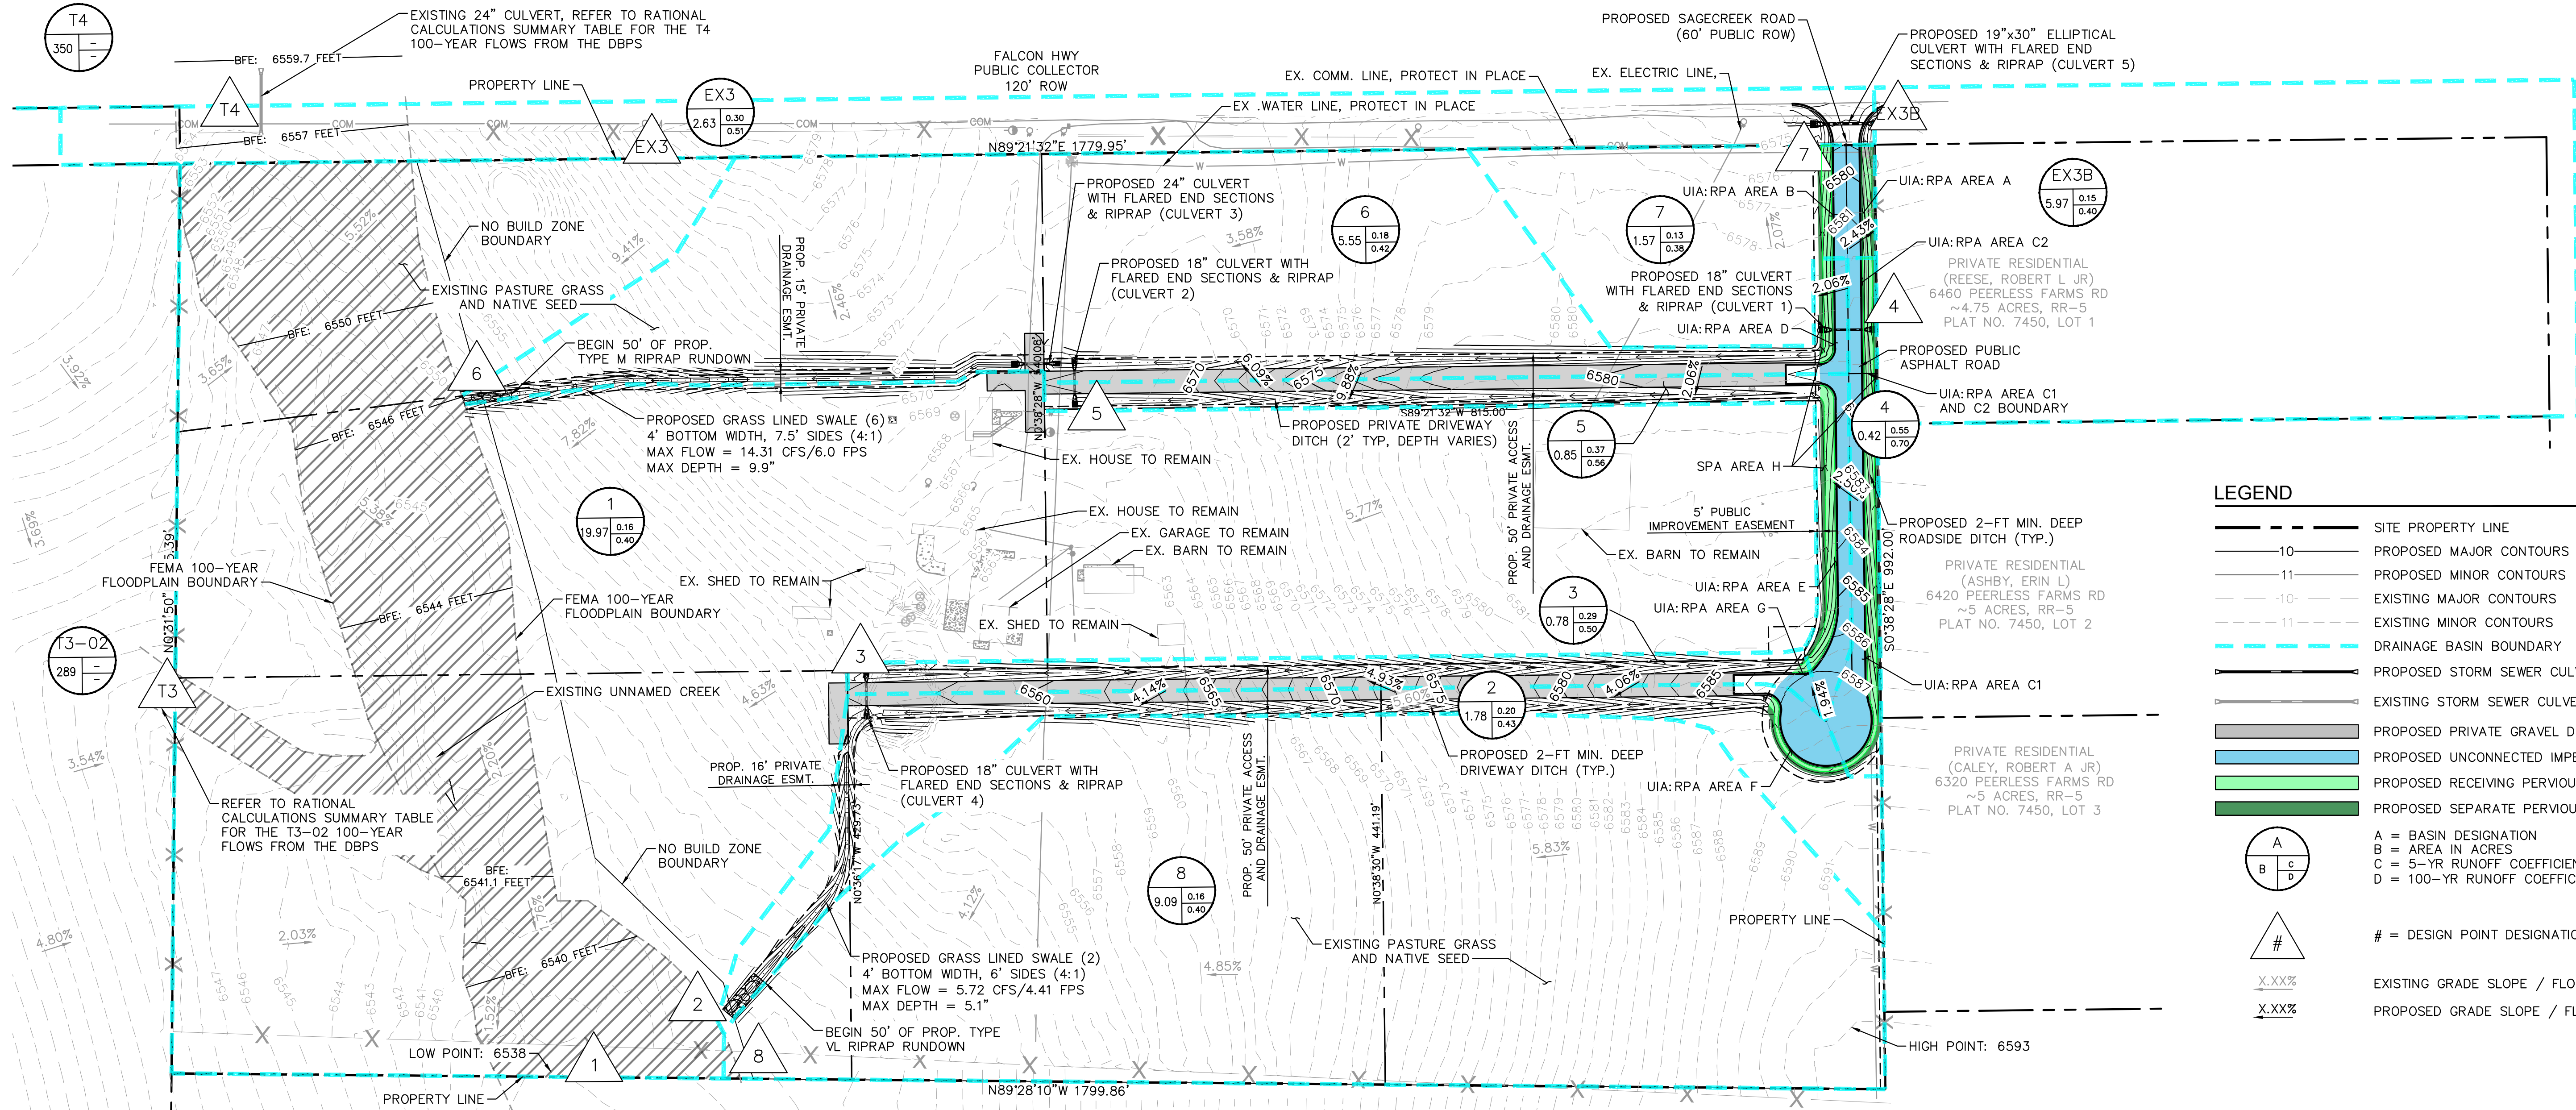

**LEGEND**

- SITE PROPERTY LINE
- 10- PROPOSED MAJOR CONTOURS
- 11- PROPOSED MINOR CONTOURS
- 10- EXISTING MAJOR CONTOURS
- 11- EXISTING MINOR CONTOURS
- - - DRAINAGE BASIN BOUNDARY
- PROPOSED STORM SEWER CULVERT
- EXISTING STORM SEWER CULVERT
- PROPOSED PRIVATE GRAVEL DRIVEWAY
- PROPOSED UNCONNECTED IMPERVIOUS AREA
- PROPOSED RECEIVING PERVIOUS AREA
- PROPOSED SEPARATE PERVIOUS AREA

|   |   |   |   |
|---|---|---|---|
| A | B | C | D |
|---|---|---|---|

- A = BASIN DESIGNATION
- B = AREA IN ACRES
- C = 5-YR RUNOFF COEFFICIENT
- D = 100-YR RUNOFF COEFFICIENT

# = DESIGN POINT DESIGNATION

X.XX% EXISTING GRADE SLOPE / FLOW DIRECTION

X.XX% PROPOSED GRADE SLOPE / FLOW DIRECTION

**NOTES:**


- OFF-SITE SUB-BASINS T3-02 AND T4 ARE TRIBUTARY AREAS TO THE UNNAMED DRAINAGEWAY WHICH ARE DOCUMENTED IN THE HAEGLER RANCH DBPS. 5 AND 100-YR RUNOFF COEFFICIENTS ARE UNKNOWN FOR THESE AREAS, BUT 100-YEAR FLOWS FOR T3-02 AND T4 AFTER FULL BUILD-OUT OF THE DRAINAGE BASIN ARE EXPECTED TO BE 460 CFS AND 570 CFS, RESPECTIVELY (REFER TO TABLE 6-7 FROM THE DBPS).
- REFERENCE GRADING AND EROSION CONTROL PLANS FOR RIPRAP PLACEMENT AND SIZING DETAIL (SHEET C2.2)

**Kimley»Horn**

PROJECT NAME: Peerless Farms DATE: 9/11/2024  
 PROJECT NUMBER: 196114000  
 CALCULATED BY: MOH  
 CHECKED BY: MOH

| DESIGN POINT           | PROPOSED RATIONAL CALCULATIONS SUMMARY |                     |                  | PEAK FLOWS (CFS) |                |
|------------------------|--|---------------------|------------------|------------------|----------------|
|                        | TRIBUTARY BASINS                       | TRIBUTARY AREA (AC) | IMPERVIOUSNESS % | Q5               | Q100           |
| <b>On-Site Basins</b>  |  |                     |                  |                  |                |
| 1                      | 1                                      | 19.97               | 10%              | 6.21             | 27.04          |
| 2                      | 2                                      | 1.78                | 17%              | 0.87             | 3.24           |
| 3                      | 3                                      | 0.78                | 31%              | 0.86             | 2.48           |
| 4                      | 4                                      | 0.42                | 57%              | 1.03             | 2.21           |
| 5                      | 5                                      | 0.85                | 40%              | 1.12             | 2.84           |
| 6                      | 6                                      | 5.55                | 13%              | 2.32             | 9.26           |
| 7                      | 7                                      | 1.57                | 6%               | 0.54             | 2.77           |
| 8                      | 8                                      | 9.09                | 10%              | 3.14             | 13.65          |
| <b>TOTAL</b>           |  | <b>40.00</b>        | <b>12%</b>       | <b>16.08</b>     | <b>63.49</b>   |
| <b>Off-Site Basins</b> |  |                     |                  |                  |                |
| EX3                    | EX3                                    | 2.63                | 27%              | 2.18             | 7.47           |
| EX3B                   | EX3B                                   | 5.97                | 9%               | 2.14             | 14.67          |
| T3-02                  | T3-02                                  | 289                 | -                | -                | 460.00         |
| T4                     | T4                                     | 350                 | -                | -                | 570.00         |
| <b>TOTAL</b>           |  | <b>647.60</b>       | -                | <b>4.32</b>      | <b>1052.14</b> |

\*Acreages and Q100 values for T3-02 and T4 were taken from the DBPS. Other values are not available.

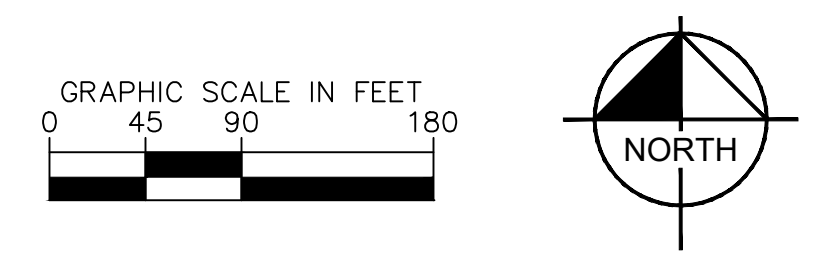

PROPOSED DRAINAGE MAP  
 PEERLESS FARMS  
 09/11/2024

**Kimley»Horn**

© 2024 KIMLEY-HORN AND ASSOCIATES, INC.  
 2 N NEVADA AVE., SUITE 900, COLORADO SPRINGS, 80903  
 PHONE: 719-453-0180

K:\COS\_LA\196114000 - Peerless Farms\CADD\Exhibits\Drainage Map.dwg

**Certificate Of Completion**

|   |                               |
|---|-------------------------------|
| Envelope Id: 262557F7862B40D39A698D441697D71C                         | Status: Completed             |
| Subject: Complete with DocuSign: Final Drainage Report - Peerless.pdf |                               |
| Source Envelope:  |                               |
| Document Pages: 124   | Signatures: 1                 |
| Certificate Pages: 1  | Initials: 0                   |
| AutoNav: Enabled  | Envelope Originator:          |
| Envelope Stamping: Enabled  | Larry Salazar                 |
| Time Zone: (UTC-05:00) Eastern Time (US & Canada)                     | 401 Fayetteville St.          |
|   | Suite 600                     |
|   | Raleigh, NC 27601             |
|   | Larry.Salazar@kimley-horn.com |
|   | IP Address: 4.2.48.102        |


**Record Tracking**

|                       |                               |                    |
|-----------------------|-------------------------------|--------------------|
| Status: Original      | Holder: Larry Salazar         | Location: DocuSign |
| 9/13/2024 10:28:58 AM | Larry.Salazar@kimley-horn.com |                    |

**Signer Events**

Robert S. Williams  
 Stuing@protonmail.com  
 Security Level: Email, Account Authentication (None)

**Signature**

DocuSigned by:  
  
 AF42CBD1A97948D...

**Timestamp**

Sent: 9/13/2024 10:32:03 AM  
 Viewed: 9/13/2024 10:38:24 AM  
 Signed: 9/13/2024 10:42:26 AM

Signature Adoption: Pre-selected Style  
 Using IP Address: 174.198.130.67  
 Signed using mobile

**Electronic Record and Signature Disclosure:**  
 Not Offered via DocuSign

**In Person Signer Events**

**Signature**

**Timestamp**

**Editor Delivery Events**

**Status**

**Timestamp**

**Agent Delivery Events**

**Status**

**Timestamp**

**Intermediary Delivery Events**

**Status**

**Timestamp**

**Certified Delivery Events**

**Status**

**Timestamp**

**Carbon Copy Events**

**Status**

**Timestamp**

**Witness Events**

**Signature**

**Timestamp**

**Notary Events**

**Signature**

**Timestamp**

**Envelope Summary Events**

**Status**

**Timestamps**

|                     |                  |                       |
|---------------------|------------------|-----------------------|
| Envelope Sent       | Hashed/Encrypted | 9/13/2024 10:32:03 AM |
| Certified Delivered | Security Checked | 9/13/2024 10:38:24 AM |
| Signing Complete    | Security Checked | 9/13/2024 10:42:26 AM |
| Completed           | Security Checked | 9/13/2024 10:42:26 AM |

**Payment Events**

**Status**

**Timestamps**